

NOTICE TO ALL CONTRACTORS AND SUB-CONTRACTORS – January 14, 2022

Architecture
Interior Design
Graphic Design
Facility Planning

The Heritage at Abilene – New Building, Restoration & Rehab Apartment Units
Abilene, Texas – Proj. 20-3065

ADDENDUM NO. 1

YOU ARE INSTRUCTED TO READ AND TO NOTE THE FOLLOWING DESCRIBED CHANGES, CORRECTIONS, CLARIFICATIONS, OMISSIONS, DELETIONS, ADDITIONS, APPROVALS AND STATEMENTS PERTINENT TO THE CONTRACT AND CONSTRUCTION DOCUMENTS. THIS ADDENDUM IS A PART OF THE CONTRACT AND CONSTRUCTION DOCUMENTS AND SHALL GOVERN IN THE PERFORMANCE OF THE WORK.

ARCHITECTURAL – Drawings

1. Sheet CFP1
 - a. Legend – Construction Type designation has been corrected.
 - b. Building A – Building area has corrected, along with the correct floor designation.
 - c. Building B – Building’s Assumed Construction Type, allowable area increase, actual building area, basic allowable stories and heights, and fire restricted ratings have all been corrected.
 - d. Building C - Building’s Construction Type, allowable area increase, actual building area, basic allowable stories and heights, and fire restricted ratings have all been corrected.
2. Sheet CFP2
 - a. Legend – Construction Type designation has been corrected.
 - b. Detail D, Building B First Floor Plan – Fire Extinguisher has been added to corridor.
 - c. Detail E, Building C First Floor Plan – 1/2 Fire Partition has been extended across the entirety of the Corridor.

Jeff Gillam
Charles Renz
Maggie Gillam
Chris Gillam

Attachments
Revised Sheets CFP1 & CFP2 (2) 24x36

END OF ADDENDUM NO. 1



730 N. Ninth (67401)
P.O. Box 2928
Salina, KS 67402-2928
(785) 827-0386
Fax (785) 827-0392

PROJECT INFORMATION

TYPES OF CONSTRUCTION	INTERIOR REMODEL, ADDITION & NEW CONSTRUCTION
FACILITY NAME	HERITAGE AT ABILENE APARTMENTS
FACILITY ADDRESS	1101 S. 9th Street ABILENE, TEXAS 79602
COUNTY	TAYLOR COUNTY
LOCAL FIRE DEPARTMENT	CITY OF ABILENE
WATER SUPPLY	CITY OF ABILENE
LOCAL BUILDING INSPECTION DEPARTMENT	CITY OF ABILENE
ARCHITECT	JONES GILLAM RENZ ARCHITECTS 730 N. NINTH ST. SALINA, KS 67401
CODES/REGULATIONS	2012 INTERNATIONAL BUILDING CODE 2012 INTERNATIONAL MECHANICAL CODE 2012 INTERNATIONAL PLUMBING CODE 2014 NATIONAL ELECTRICAL CODE 2015 INTERNATIONAL FIRE CODE 2012 INTERNATIONAL ENERGY CONSERVATION CODE FAIR HOUSING ACT DESIGN MANUAL 2010 ADA STANDARDS FOR ACCESSIBLE DESIGN 2009 ICC A117.1 ACCESSIBLE & USABLE BUILDINGS and FACILITIES

LEGEND

DESIGNATED EMERGENCY EXIT 68' / 24.4' ← EXIT WIDTH (ACTUAL/REQUIRED)
122 / 340 ← OCCUPANT LOAD (ACTUAL/ALLOWED)

ADDENDUM #1 1-14-22

0 HOUR CONSTRUCTION

1/2 HOUR FIRE PARTITION CORRIDOR (PER IBC TABLE 1020.1)
75' 20" MIN. OPENINGS (PER IBC TABLE 716.5)

1 HOUR FIRE PARTITION WITH 90 MIN. OPENINGS
(PER IBC 708.3 & 716.5)

EXIT/EMERGENCY LIGHT

EMERGENCY LIGHT

FIRE EXTINGUISHER

FIRE HYDRANT

FIRE ALARM CONTROL PANEL

OCCUPANCY GROUP (AU - ACCESSORY USE)	A-1
OCCUPANCY USE	ASSEMBLY HALL
ROOM SQUARE FOOTAGE/OCCUPANT LOAD FACTOR	5,550 15
OCCUPANT LOAD/REQUIRED NUMBER OF EXITS	370 2

BUILDING A CODE INFORMATION

OCCUPANCY OVERALL: RESIDENTIAL
CONSTRUCTION TYPE: III-B (ASSUMED - EXISTING BUILDING)
III-B (NEW ADDITION)

OCCUPANCY BASIC: R-2 APARTMENTS

*BUILDING HAS AN NFPA 13R SPRINKLER SYSTEM, SECTION 903.3.1.2
*ALLOWABLE AREA AND HEIGHT BASED ON DIFFERENT USES NOT BEING SEPARATED BY FIRE BARRIERS, MOST RESTRICTIVE ALLOWANCE.

SITE DESCRIPTION
NORTH SIDE HAS A PUBLIC WAY, DISTANCE TO PUBLIC WAY = 41.2; WIDTH = 40.0
LENGTH OF PERIMETER FACING THE PUBLIC WAY = 98.7. THIS SIDE CAN BE ACCESSED FROM A STREET.
EAST SIDE HAS A PUBLIC WAY, DISTANCE TO PUBLIC WAY = 115.3; WIDTH = 50.0
LENGTH OF PERIMETER FACING THE PUBLIC WAY = 59.4. THIS SIDE CAN BE ACCESSED FROM A STREET OR OPEN AREA.
SOUTH SIDE HAS AN IMAGINARY LINE BETWEEN TWO BUILDINGS, DISTANCE TO BUILDING = 104.5;
THE IMAGINARY LINE = 52.3
LENGTH OF PERIMETER FACING THE OTHER BUILDING = 98.7. THIS SIDE CAN BE ACCESSED FROM AN APPROVED FIRE LANE.
WEST SIDE HAS AN IMAGINARY LINE BETWEEN TWO BUILDINGS, DISTANCE TO BUILDING = 26.0;
THE IMAGINARY LINE = 13.0
LENGTH OF PERIMETER FACING THE OTHER BUILDING = 72.1. THIS SIDE CAN BE ACCESSED FROM OPEN AREA.
PERIMETER OF ENTIRE BUILDING = 328.8 FEET
PERIMETER WHICH FRONTS A PUBLIC WAY OR ACCESSIBLE OPEN SPACE = 328.8 FEET
ALLOWABLE AREA INCREASED 72.81% DUE TO FRONTAGE.

ALLOWABLE AREA INCREASE:

	R-2
BASE ALLOWABLE	7,000 SF
AREA INCREASE (72.81%)	11,649 SF
TOTAL FLOOR ALLOWABLE	27,649 SF

ACTUAL BUILDING AREA:

FIRST FLOOR	6,578 SF
SECOND FLOOR	6,326 SF
THIRD FLOOR	6,324 SF
TOTAL BLDG AREA	19,228 SF

BASIC ALLOWABLE STORIES: 4 (PER IBC TABLE 503)	ACTUAL STORIES: 2
BASIC ALLOWABLE HEIGHT: 55' (PER IBC TABLE 503)	ACTUAL HEIGHT: 43'

FIRE RESISTANCE RATING FOR BUILDING ELEMENTS: III-B

EXTERIOR BEARING WALLS: 2 HOUR (Historic: Existing Masonry)
STRUCTURAL FRAME: 0 HOUR (Historic: Existing Concrete)
INTERIOR BEARING WALLS: 0 HOUR
INTERIOR NON-BEARING WALLS: 0 HOUR
SHAFT ENCLOSURES: 1 HOUR (New: Elevator)
STAIRS: 0 HOUR (Historic: open 3 floors)
FLOOR/CEILING ASSEMBLY: 0 HOUR
CEILING/ROOF ASSEMBLY: 0 HOUR
CORRIDOR/DWELLING UNITS: 1/2 HOUR (Historic: Existing plaster walls)
DWELLING UNITS - 1 HR FIRE PARTITIONS (Historic: Existing plaster walls)
DWELLING UNITS - 1/2 HR FLR/CEILING (Historic: Existing Concrete with plaster)

ROOF COVERINGS: CLASS C OR BETTER

REQUIRED SEPARATION OF OCCUPANCIES (PER IBC 508.4.4 & TABLE 508.4)
USES ARE NOT SEPARATED BY FIRE BARRIERS. CONSTRUCTION IS BASED ON THE MOST RESTRICTIVE USE.
DWELLING UNITS - 1 HR FIRE PARTITIONS
*THE MAJORITY OF DWELLING UNITS ARE SEPARATED BY EXISTING HISTORIC PLASTER WALLS; ALL NEW WALLS WILL BE 1-FIRE PARTITIONS.

AUTOMATIC FIRE SUPPRESSION SYSTEM:
REQUIRED, PROVIDED PER NFPA 13R - ENTIRE BUILDING

PORTABLE FIRE EXTINGUISHERS:
REQUIRED - PROVIDED.
EACH DWELLING UNIT SHALL BE PROVIDED WITH A PORTABLE FIRE EXTINGUISHER HAVING A MINIMUM RATING OF 1-A:10-B:C

SMOKE CONTROL: NOT REQUIRED
SMOKE PARTITIONS: NOT REQUIRED
STANDPIPES: NOT REQUIRED (TOP FLR <30')

FIRE ALARM REQUIREMENTS:
REQUIRED, PROVIDED - MANUAL & AUTOMATIC FIRE ALARM SYSTEM PER NFPA 72
SIGNALING SYSTEM IS AUDIBLE/VISUAL PER NFPA 72 & ADA INSTALLED THROUGHOUT
INITIATING DEVICES: PULL STATIONS; SMOKE DETECTION @ SLEEPING & COMMON AREAS, SPRINKLER SYSTEM FLOW AND TAMPER SWITCHES MONITORED.

SMOKE ALARM REQUIREMENTS:
REQUIRED, PROVIDED - SLEEPING ROOMS, OUTSIDE SLEEPING ROOMS & AT EACH FLOOR

EMERGENCY POWER SOURCE:
EXIT SIGNS, EXIT ILLUMINATION & EMERGENCY LIGHTING IS BY BATTERY BACK-UP

TOTAL OCCUPANT LOAD: 56
EXITING: REFERENCE PLAN

OCCUPANT LOAD FACTORS: (TABLES 1004.1.2, 1015.1):

OCCUPANCY	USE	LOAD FACTOR	MAX.OCC/STRY 1 EXIT
R-2	APARTMENT	200 sf/OCCUPANT	10
B	BUSINESS	100 sf/OCCUPANT	49
S-1	STORAGE	300 sf/OCCUPANT	29
M	MECHANICAL	300 sf/OCCUPANT	49

BUILDING B CODE INFORMATION

OCCUPANCY OVERALL: RESIDENTIAL
CONSTRUCTION TYPE: V-B (ASSUMED - EXISTING BUILDING) **ADDENDUM #1** 1-14-22

OCCUPANCY BASIC: R-2 APARTMENTS

*BUILDING HAS AN NFPA 13R SPRINKLER SYSTEM, SECTION 903.3.1.2
*ALLOWABLE AREA AND HEIGHT BASED ON DIFFERENT USES NOT BEING SEPARATED BY FIRE BARRIERS, MOST RESTRICTIVE ALLOWANCE.

SITE DESCRIPTION
NORTH SIDE HAS A PUBLIC WAY, DISTANCE TO PUBLIC WAY = 41.3; WIDTH = 40.0
LENGTH OF PERIMETER FACING THE PUBLIC WAY = 32.75. THIS SIDE CAN BE ACCESSED FROM A STREET.
EAST SIDE HAS AN IMAGINARY LINE BETWEEN TWO BUILDINGS, DISTANCE TO BUILDING = 26.0;
THE IMAGINARY LINE = 13.0
LENGTH OF PERIMETER FACING THE PUBLIC WAY = 95.0. THIS SIDE CAN BE ACCESSED FROM AN OPEN AREA.
SOUTH SIDE HAS A PROPERTY LINE, DISTANCE TO PROPERTY LINE = 375.5
LENGTH OF PERIMETER FACING THE PROPERTY LINE = 49.0. THIS SIDE CAN BE ACCESSED FROM AN APPROVED FIRE LANE.
WEST SIDE HAS A PUBLIC WAY, DISTANCE TO PUBLIC WAY = 11.75; WIDTH = 60.0
LENGTH OF PERIMETER FACING THE PUBLIC WAY = 95.0. THIS SIDE CAN BE ACCESSED FROM A STREET.
PERIMETER OF ENTIRE BUILDING = 288.0 FEET
PERIMETER WHICH FRONTS A PUBLIC WAY OR ACCESSIBLE OPEN SPACE = 288 FEET
ALLOWABLE AREA INCREASED 92.9% DUE TO FRONTAGE.

ALLOWABLE AREA INCREASE:

	R-2
BASE ALLOWABLE	7,000 SF
AREA INCREASE (92.9%)	6,503 SF
TOTAL FLOOR ALLOWABLE	13,503 SF

ACTUAL BUILDING AREA:

FIRST FLOOR	3,626 SF
TOTAL BLDG AREA	3,626 SF

BASIC ALLOWABLE STORIES: 2 (PER IBC TABLE 503)	ACTUAL STORIES: 1
BASIC ALLOWABLE HEIGHT: 40' (PER IBC TABLE 503)	ACTUAL HEIGHT: 16'

FIRE RESISTANCE RATING FOR BUILDING ELEMENTS: V-B

EXTERIOR BEARING WALLS: 0 HOUR (Historic: Existing Masonry)
STRUCTURAL FRAME: 0 HOUR (Historic: Existing Masonry & Steel)
INTERIOR BEARING WALLS: 0 HOUR
INTERIOR NON-BEARING WALLS: 0 HOUR
STAIRS: 0 HOUR N/A
FLOOR/CEILING ASSEMBLY: 0 HOUR
CEILING/ROOF ASSEMBLY: 0 HOUR
CORRIDOR/DWELLING UNITS: 1/2 HOUR
DWELLING UNITS - 1 HR FIRE PARTITIONS

ROOF COVERINGS: CLASS C OR BETTER

REQUIRED SEPARATION OF OCCUPANCIES (PER IBC 508.4.4 & TABLE 508.4)
USES ARE NOT SEPARATED BY FIRE BARRIERS. CONSTRUCTION IS BASED ON THE MOST RESTRICTIVE USE.
DWELLING UNITS - 1 HR FIRE PARTITIONS

AUTOMATIC FIRE SUPPRESSION SYSTEM:
REQUIRED, PROVIDED PER NFPA 13R - ENTIRE BUILDING

PORTABLE FIRE EXTINGUISHERS:
REQUIRED - PROVIDED.
EACH DWELLING UNIT SHALL BE PROVIDED WITH A PORTABLE FIRE EXTINGUISHER HAVING A MINIMUM RATING OF 1-A:10-B:C

SMOKE CONTROL: NOT REQUIRED
SMOKE PARTITIONS: NOT REQUIRED
STANDPIPES: NOT REQUIRED (TOP FLR <30')

FIRE ALARM REQUIREMENTS:
REQUIRED, PROVIDED - MANUAL & AUTOMATIC FIRE ALARM SYSTEM PER NFPA 72
SIGNALING SYSTEM IS AUDIBLE/VISUAL PER NFPA 72 & ADA INSTALLED THROUGHOUT
INITIATING DEVICES: PULL STATIONS; SMOKE DETECTION @ SLEEPING & COMMON AREAS, SPRINKLER SYSTEM FLOW AND TAMPER SWITCHES MONITORED.

SMOKE ALARM REQUIREMENTS:
REQUIRED, PROVIDED - SLEEPING ROOMS, OUTSIDE SLEEPING ROOMS & AT EACH FLOOR

EMERGENCY POWER SOURCE:
EXIT SIGNS, EXIT ILLUMINATION & EMERGENCY LIGHTING IS BY BATTERY BACK-UP

TOTAL OCCUPANT LOAD: 12
EXITING: REFERENCE PLAN

OCCUPANT LOAD FACTORS: (TABLES 1004.1.2, 1015.1):

OCCUPANCY	USE	LOAD FACTOR	MAX.OCC/STRY 1 EXIT
R-2	APARTMENT	200 sf/OCCUPANT	10
M	MECHANICAL	300 sf/OCCUPANT	49

BUILDING C CODE INFORMATION

OCCUPANCY OVERALL: RESIDENTIAL
CONSTRUCTION TYPE: V-B (New) **ADDENDUM #1** 1-14-22

OCCUPANCY BASIC: R-2 APARTMENTS

*BUILDING HAS AN NFPA 13R SPRINKLER SYSTEM, SECTION 903.3.1.2
*ALLOWABLE AREA AND HEIGHT BASED ON DIFFERENT USES NOT BEING SEPARATED BY FIRE BARRIERS, MOST RESTRICTIVE ALLOWANCE.

SITE DESCRIPTION
NORTH SIDE HAS A PUBLIC WAY, DISTANCE TO PUBLIC WAY = 227.3; WIDTH = 40.0
LENGTH OF PERIMETER FACING THE PUBLIC WAY = 67.0. THIS SIDE CAN BE ACCESSED FROM A STREET OR APPROVED FIRE LANE.
EAST SIDE HAS A PUBLIC WAY, DISTANCE TO PUBLIC WAY = 28.0; WIDTH = 50.0
LENGTH OF PERIMETER FACING THE PUBLIC WAY = 139.8. THIS SIDE CAN BE ACCESSED FROM A STREET OR APPROVED FIRE LANE.
SOUTH SIDE HAS A PROPERTY LINE, DISTANCE TO PROPERTY LINE = 145.4
LENGTH OF PERIMETER FACING THE PROPERTY LINE = 67.0. THIS SIDE CAN BE ACCESSED FROM AN OPEN AREA.
WEST SIDE HAS A PUBLIC WAY, DISTANCE TO PUBLIC WAY = 206.3; WIDTH = 60.0
LENGTH OF PERIMETER FACING THE PUBLIC WAY = 139.8. THIS SIDE CAN BE ACCESSED FROM A STREET OR APPROVED FIRE LANE.
PERIMETER OF ENTIRE BUILDING = 413.5 FEET
PERIMETER WHICH FRONTS A PUBLIC WAY OR ACCESSIBLE OPEN SPACE = 413.5 FT.
ALLOWABLE AREA INCREASED 75% DUE TO FRONTAGE.

ALLOWABLE AREA INCREASE:

	R-2
BASE ALLOWABLE	7,000 SF
AREA INCREASE (75.0%)	5,250 SF
TOTAL FLOOR ALLOWABLE	12,250 SF

ACTUAL BUILDING AREA:

FIRST FLOOR	8,244 SF
TOTAL BLDG AREA	8,244 SF

BASIC ALLOWABLE STORIES: 2 (PER IBC TABLE 503)	ACTUAL STORIES: 1
BASIC ALLOWABLE HEIGHT: 40' (PER IBC TABLE 503)	ACTUAL HEIGHT: 17'

FIRE RESISTANCE RATING FOR BUILDING ELEMENTS: V-B

EXTERIOR BEARING WALLS: 0 HOUR
STRUCTURAL FRAME: 0 HOUR
INTERIOR BEARING WALLS: 0 HOUR
INTERIOR NON-BEARING WALLS: 0 HOUR
STAIRS: 0 HOUR N/A
FLOOR/CEILING ASSEMBLY: 0 HOUR
CEILING/ROOF ASSEMBLY: 0 HOUR
CORRIDOR/DWELLING UNITS: 1/2 HOUR
DWELLING UNITS - 1 HR FIRE PARTITIONS

ROOF COVERINGS: CLASS C OR BETTER

REQUIRED SEPARATION OF OCCUPANCIES (PER IBC 508.4.4 & TABLE 508.4)
USES ARE NOT SEPARATED BY FIRE BARRIERS. CONSTRUCTION IS BASED ON THE MOST RESTRICTIVE USE.
DWELLING UNITS - 1 HR FIRE PARTITIONS

AUTOMATIC FIRE SUPPRESSION SYSTEM:
REQUIRED, PROVIDED PER NFPA 13R - ENTIRE BUILDING

DRAFTSTOPPING (PER IBC 718.4.1.1 & 718.4.2)
DRAFTSTOPPING SHALL BE INSTALLED IN LINE WITH UNIT SEPARATION WALLS THAT DO NOT EXTEND TO THE ROOF SHEATHING OR ATTIC SPACE MAY BE SUBDIVIDED INTO AREAS NOT EXCEEDING 3,000 SF OF ABOVE EVERY TWO DWELLING UNITS, WHICHEVER IS SMALLER. OPENING IN THE PARTITIONS SHALL BE PROTECTED BY SELF-CLOSING DOORS WITH AUTOMATIC LATCHES CONSTRUCTED AS REQUIRED FOR THE PARTITIONS.

PORTABLE FIRE EXTINGUISHERS:
REQUIRED - PROVIDED.
EACH DWELLING UNIT SHALL BE PROVIDED WITH A PORTABLE FIRE EXTINGUISHER HAVING A MINIMUM RATING OF 1-A:10-B:C

SMOKE CONTROL: NOT REQUIRED
SMOKE PARTITIONS: NOT REQUIRED
STANDPIPES: NOT REQUIRED (TOP FLR <30')

FIRE ALARM REQUIREMENTS:
REQUIRED, PROVIDED - MANUAL & AUTOMATIC FIRE ALARM SYSTEM PER NFPA 72
SIGNALING SYSTEM IS AUDIBLE/VISUAL PER NFPA 72 & ADA INSTALLED THROUGHOUT
INITIATING DEVICES: PULL STATIONS; SMOKE DETECTION @ SLEEPING & COMMON AREAS, SPRINKLER SYSTEM FLOW AND TAMPER SWITCHES MONITORED.

SMOKE ALARM REQUIREMENTS:
REQUIRED, PROVIDED - SLEEPING ROOMS, OUTSIDE SLEEPING ROOMS & AT EACH FLOOR


EMERGENCY POWER SOURCE:
EXIT SIGNS, EXIT ILLUMINATION & EMERGENCY LIGHTING IS BY BATTERY BACK-UP

TOTAL OCCUPANT LOAD: 60
EXITING: REFERENCE PLAN


OCCUPANT LOAD FACTORS: (TABLES 1004.1.2, 1015.1):

OCCUPANCY	USE	LOAD FACTOR	MAX.OCC/STRY 1 EXIT
R-2	APARTMENT	200 sf/OCCUPANT	10
A-3	CLUB ROOM	20 sf/OCCUPANT	49
B	OFFICE	100 sf/OCCUPANT	49
S-1	STORAGE	300 sf/OCCUPANT	29
M	MECHANICAL	300 sf/OCCUPANT	49

Architects Planners Designers
1772 Main Street
Kansas City, MO 64108
730 N. Ninth
P.O. BOX 2828
Salina, KS 67402
785.827.0386
jgr@jgarchitects.com

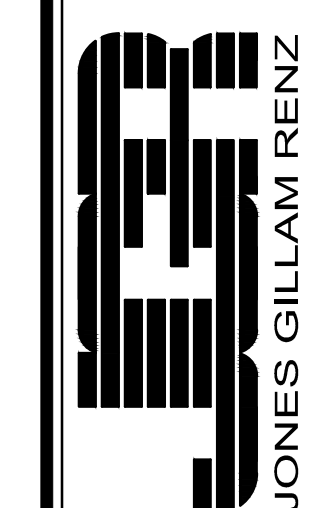

THE HERITAGE at ABILENE
NEW BUILDING, RESTORATION & REHAB APARTMENTS
ABILENE, TEXAS

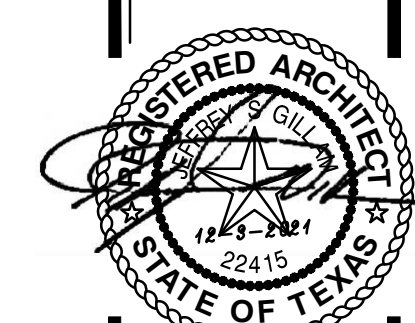

REVISION:
ADDENDUM #1 1-14-22

DATE:
12-17-2021

JOB:
20-3065

SHEET:
CFP1

CFP1

COPYRIGHTED ©

PROJECT INFORMATION

TYPES OF CONSTRUCTION INTERIOR REMODEL, ADDITION & NEW CONSTRUCTION
 FACILITY NAME HERITAGE AT ABILENE APARTMENTS
 FACILITY ADDRESS 1101 S. 9th Street
 ABILENE, TEXAS 79602
 COUNTY TAYLOR COUNTY
 LOCAL FIRE DEPARTMENT CITY OF ABILENE
 WATER SUPPLY CITY OF ABILENE
 LOCAL BUILDING CITY OF ABILENE
 INSPECTION DEPARTMENT
 ARCHITECT JONES GILLAM RENZ ARCHITECTS
 730 N. NINTH ST.
 SALINA, KS 67401

CODES/REGULATIONS 2012 INTERNATIONAL BUILDING CODE
 2012 INTERNATIONAL MECHANICAL CODE
 2012 INTERNATIONAL PLUMBING CODE
 2014 NATIONAL ELECTRICAL CODE
 2015 INTERNATIONAL FIRE CODE
 2012 INTERNATIONAL ENERGY CONSERVATION CODE
 FAIR HOUSING ACT DESIGN MANUAL
 2010 ADA STANDARDS for ACCESSIBLE DESIGN
 2009 ICC A117.1 ACCESSIBLE & USABLE BUILDINGS
 and FACILITIES


LEGEND

DESIGNATED EMERGENCY EXIT 68' / 24.4" (← EXIT WIDTH (ACTUAL/REQUIRED))
 122 / 340 (← OCCUPANT LOAD (ACTUAL/ALLOWED))


0 HOUR CONSTRUCTION
 1 1/2 HOUR FIRE PARTITION, CORRIDOR (PER IBC TABLE 1020.1)
 WITH 20 MIN. OPENINGS (PER IBC TABLE 716.5)
 1 HOUR FIRE PARTITION WITH 90 MIN. OPENINGS
 (PER IBC 708.3 & 716.5)

EXIT LIGHT
 EXIT/EMERGENCY LIGHT
 EMERGENCY LIGHT
 FIRE EXTINGUISHER
 FIRE HYDRANT
 FIRE ALARM CONTROL PANEL


OCCUPANCY GROUP (AU - ACCESSORY USE)	A-1
OCCUPANCY USE	ASSEMBLY HALL
ROOM SQUARE FOOTAGE/OCCUPANT LOAD FACTOR	5,550 / 15
OCCUPANT LOAD/REQUIRED NUMBER OF EXITS	370 / 2

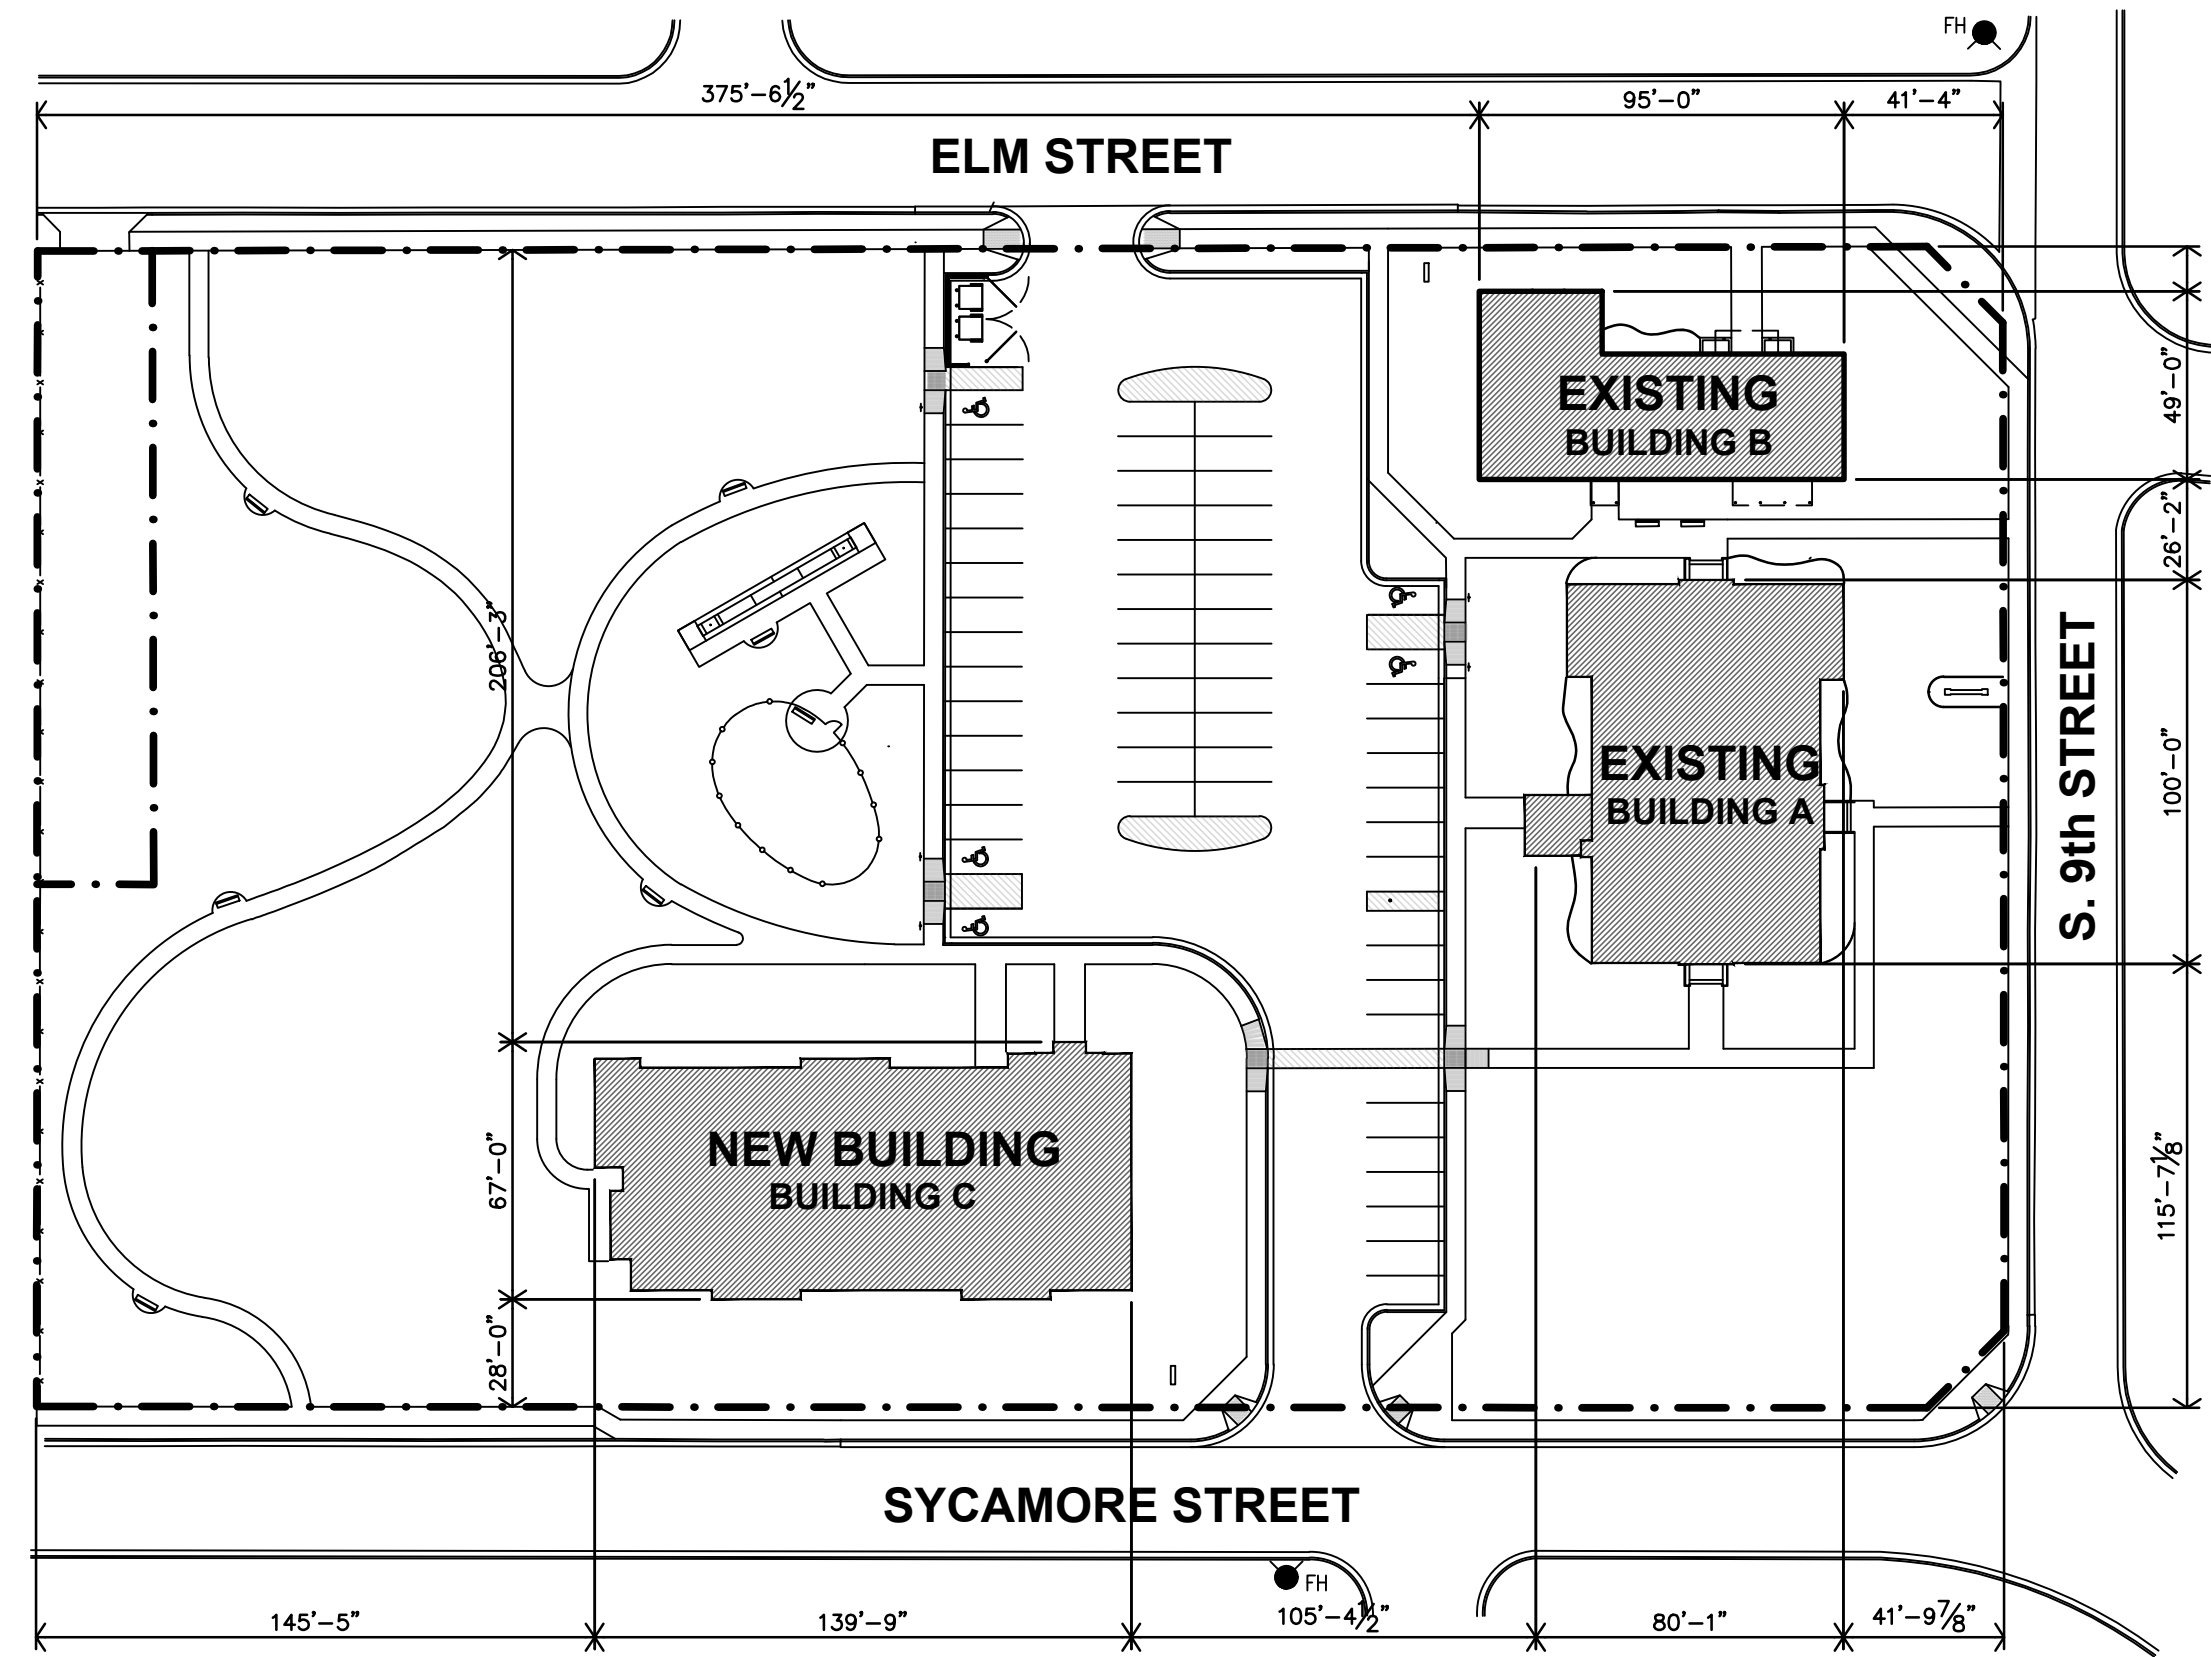


F SITE PLAN

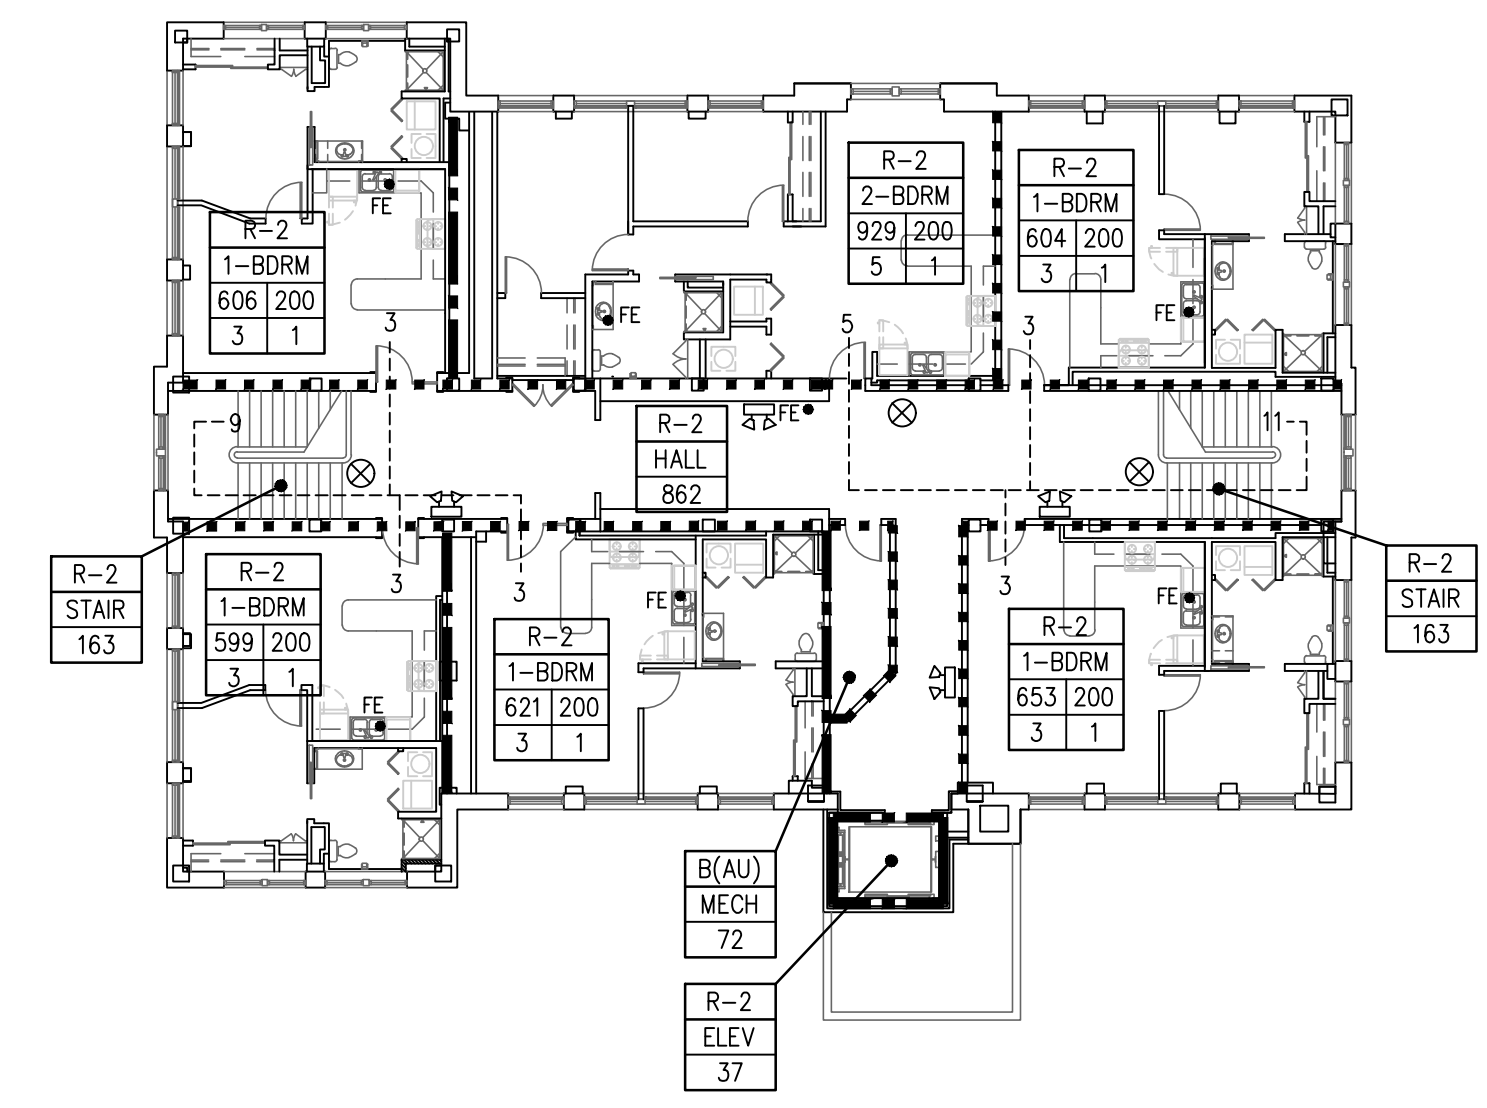


C BUILDING A THIRD FLOOR PLAN

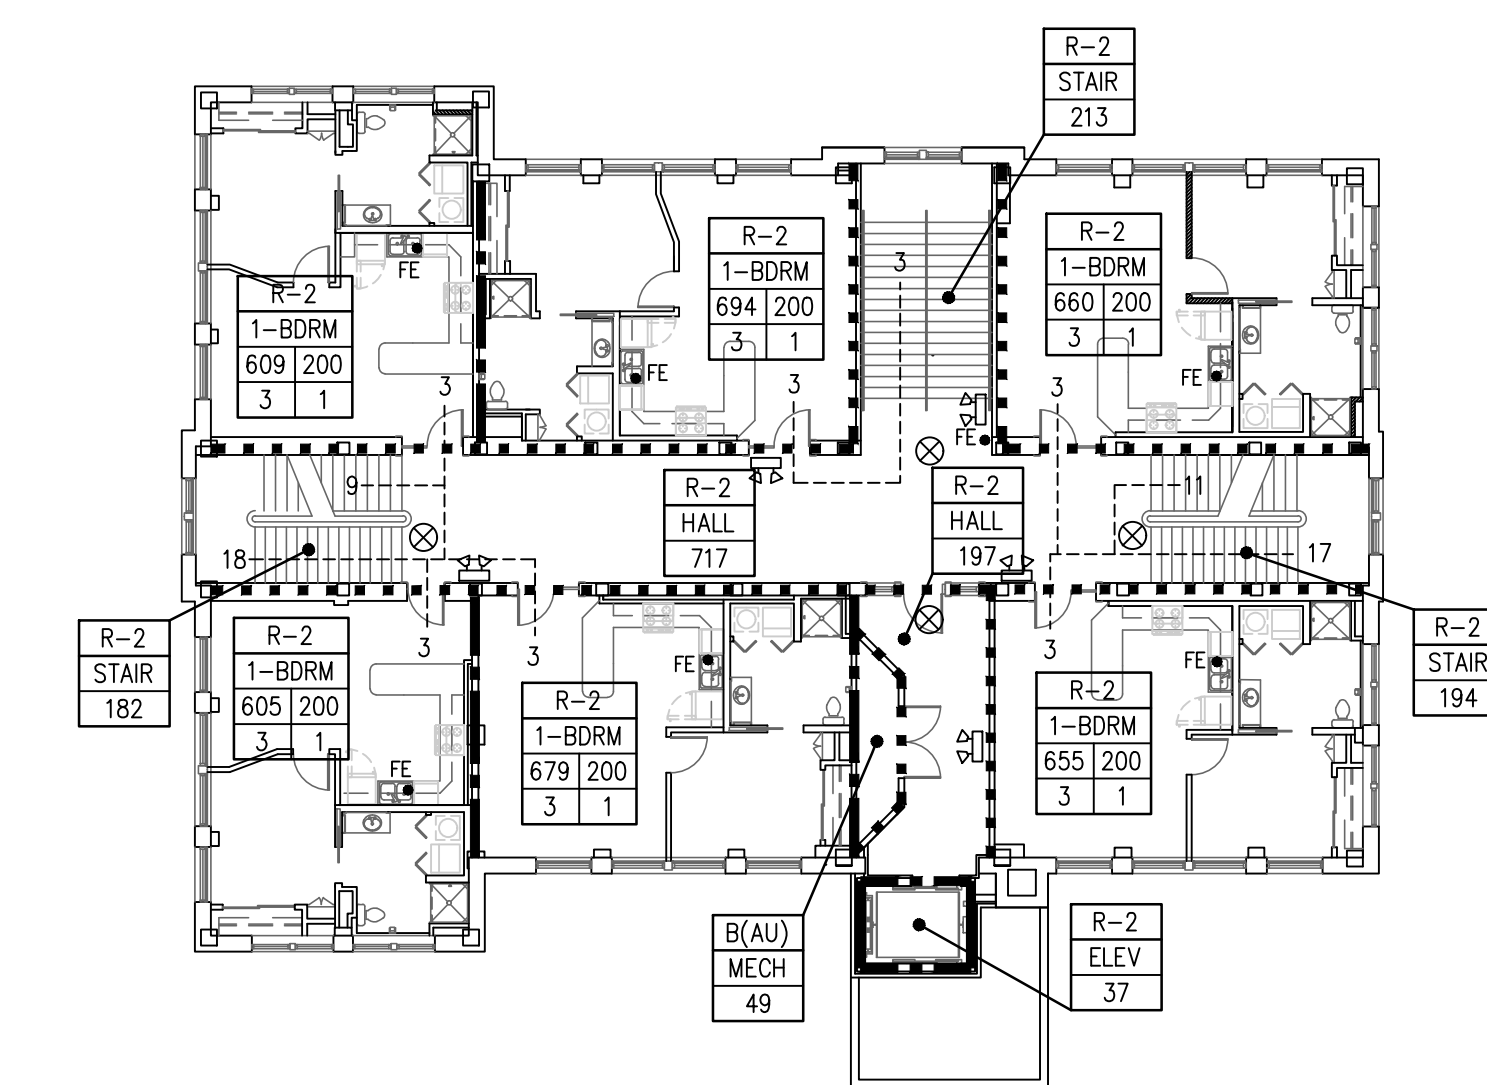


B BUILDING A SECOND FLOOR PLAN

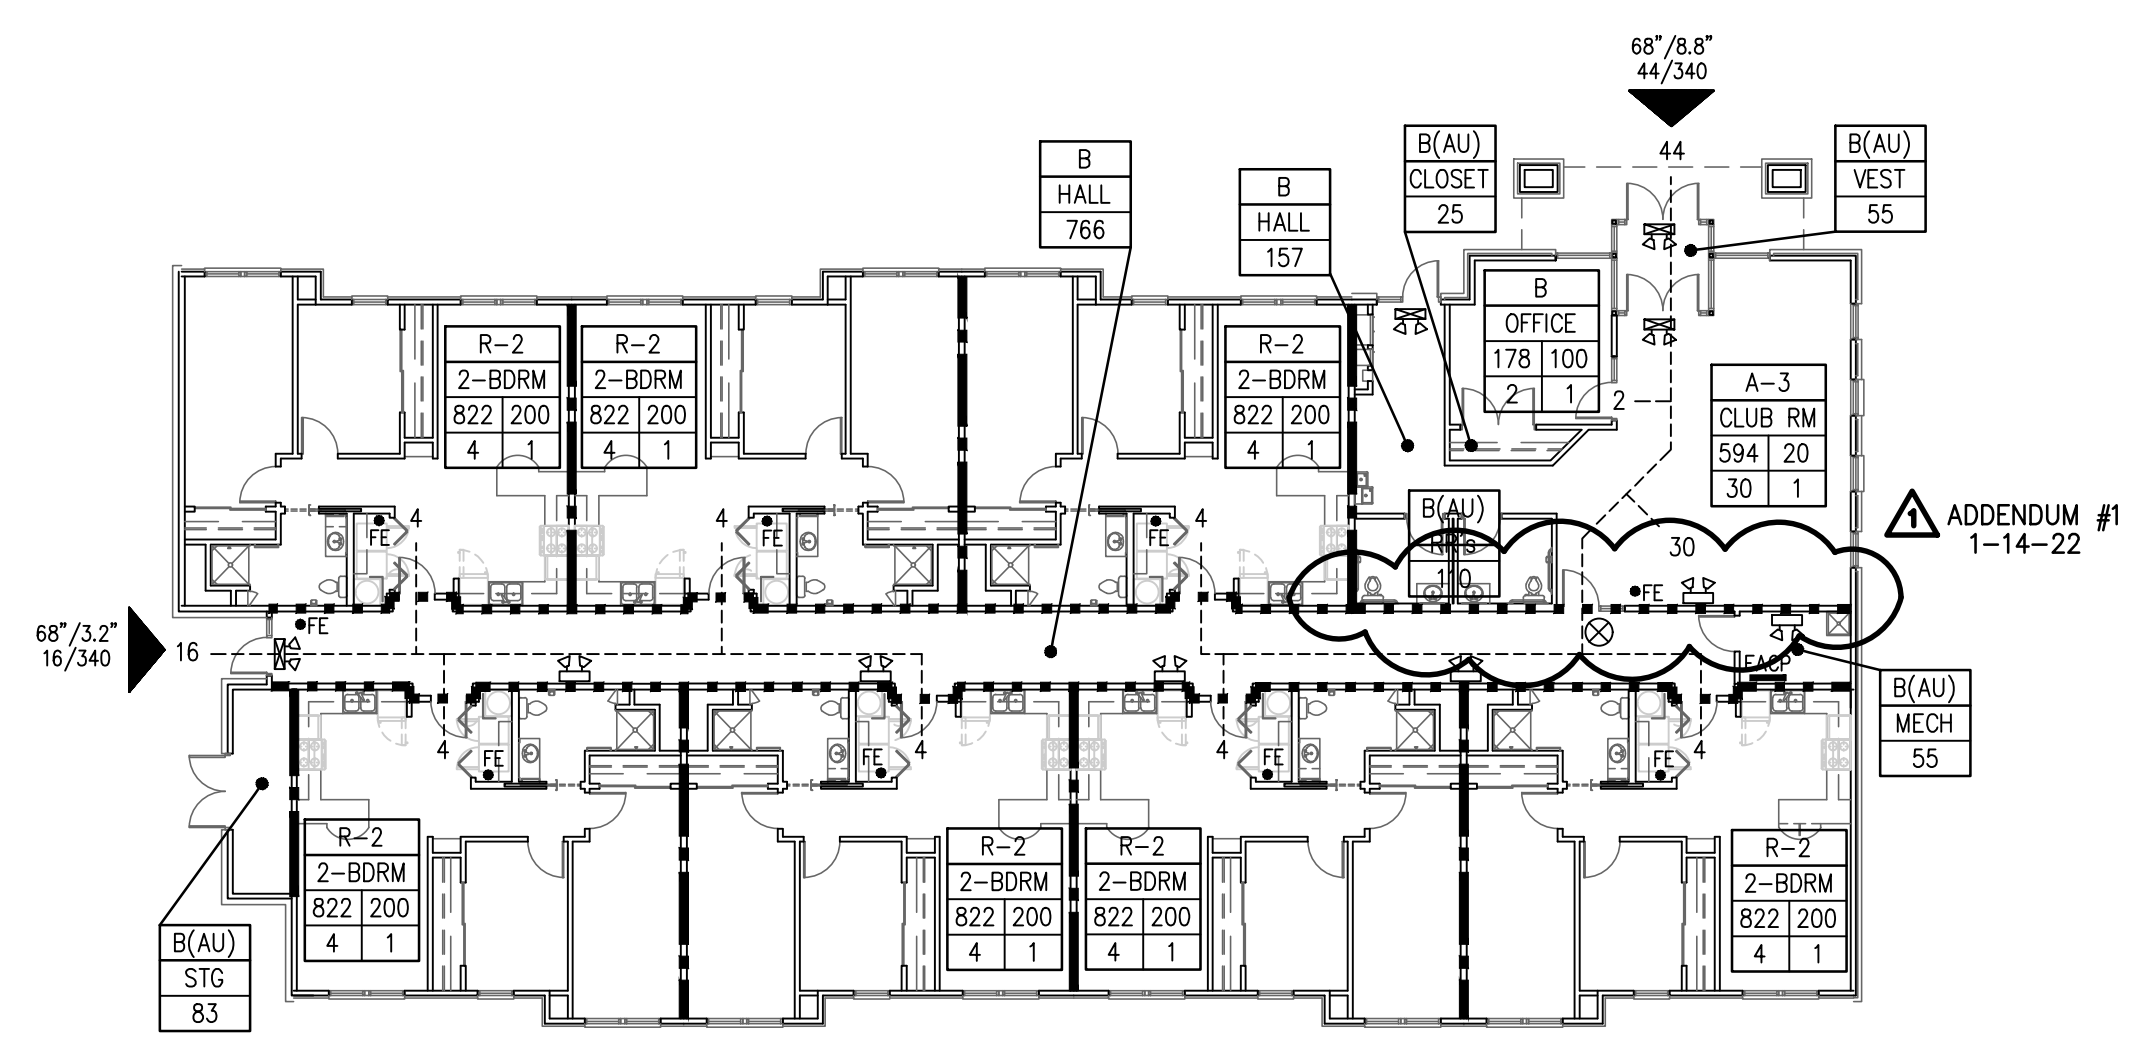


E BUILDING C FIRST FLOOR PLAN

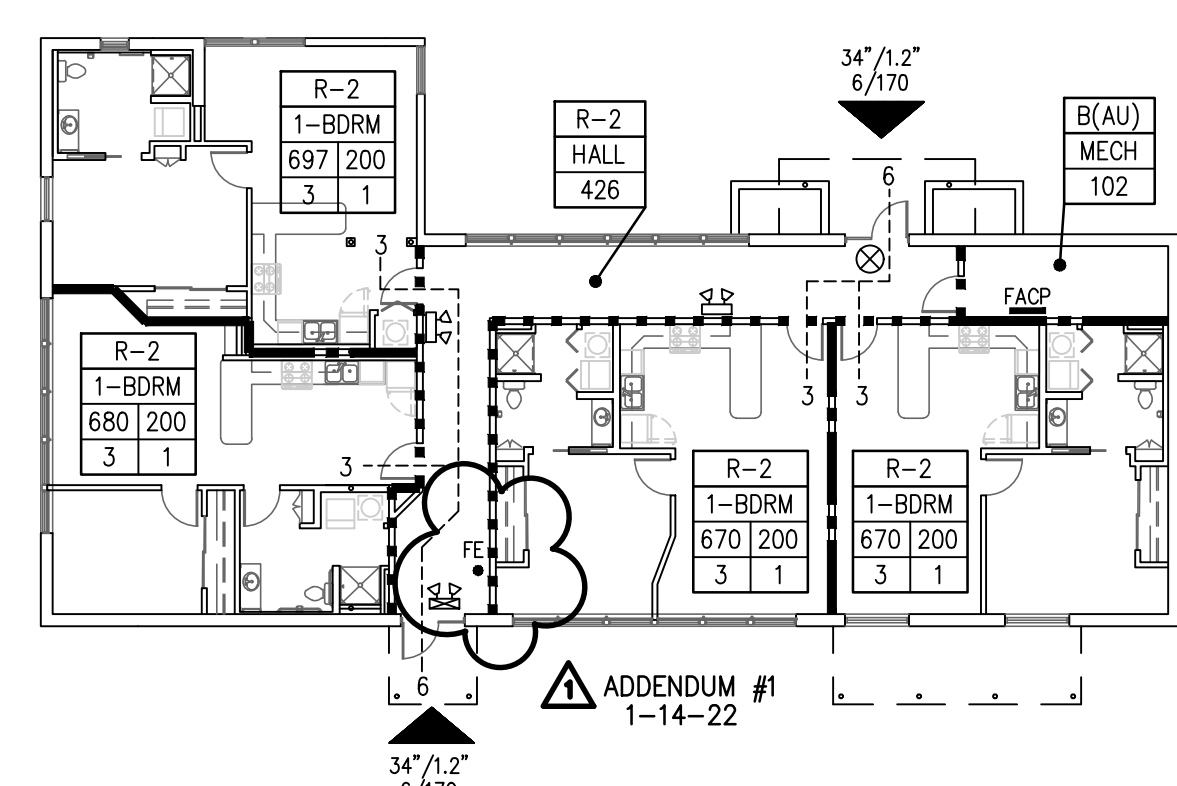


D BUILDING B FIRST FLOOR PLAN

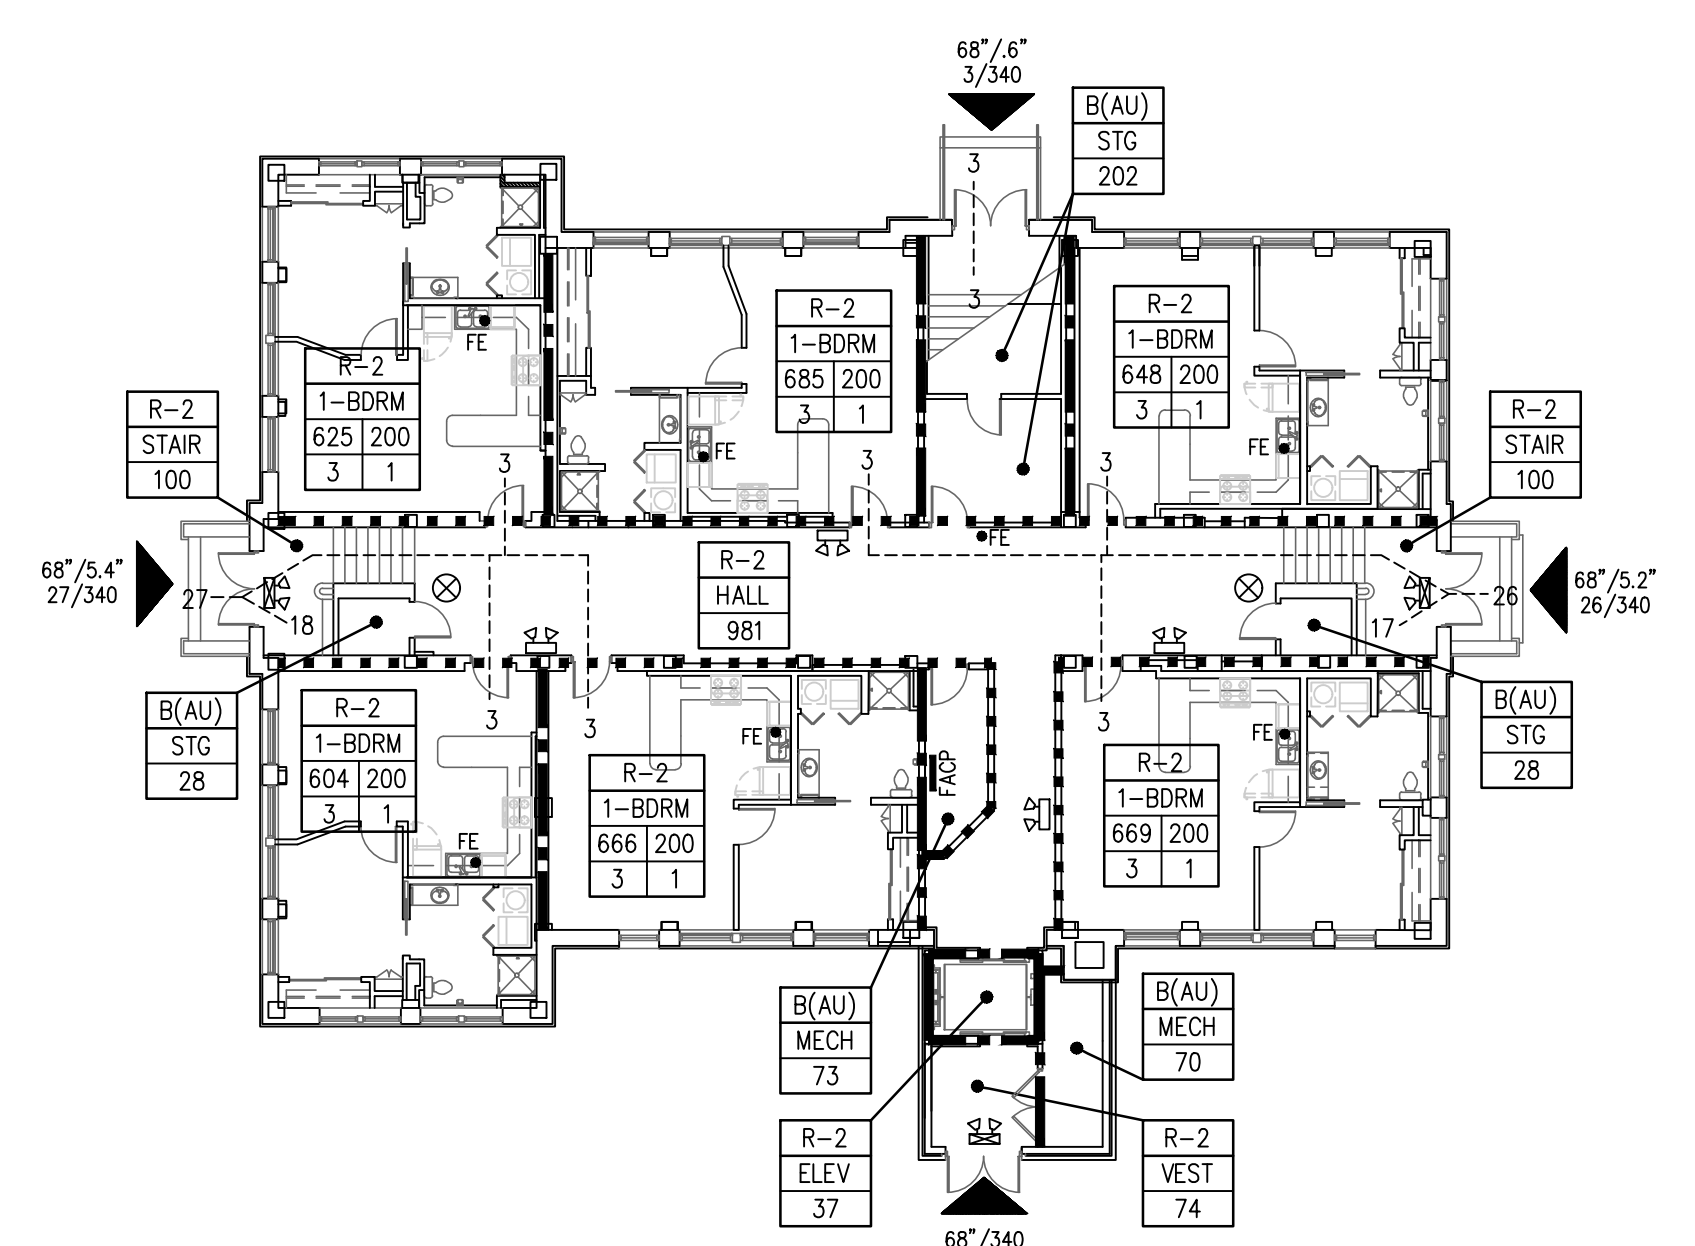

A BUILDING A FIRST FLOOR PLAN

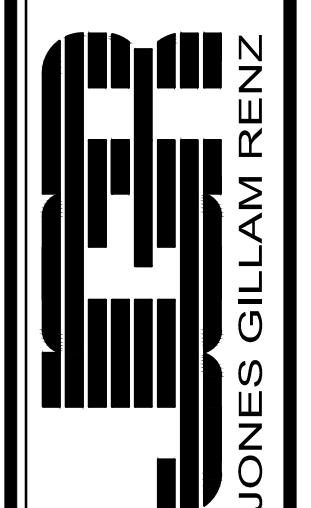

THE HERITAGE at ABILENE
 NEW BUILDING, RESTORATION & REHAB APARTMENTS
 ABILENE, TEXAS

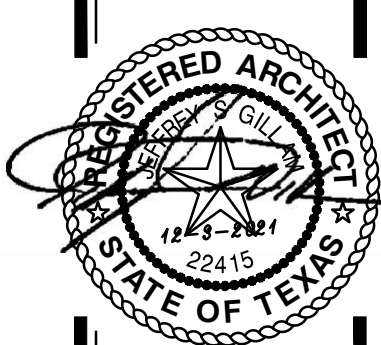

REVISION:

1-14-22

DATE: 12-17-2021

JOB: 20-3065

SHEET: