

General Information

- A. The contractor shall verify dimensions and conditions before construction and notify the engineer of any discrepancies, inconsistencies, or difficulties affecting the work before proceeding.
- B. The contractor shall coordinate all disciplines, verifying size and location of all openings, whether shown on structural drawings or not, as called for on architectural, mechanical, or electrical drawings. In the case of work in an existing building the contractor shall scan existing structure to locate all rebar in the area of the new core/opening using ground penetrating radar and notify the engineer of record for any necessary reconfiguring. Conflicts, inconsistencies, or other difficulties affecting structural work shall be called to the architect or engineer's attention for direction before proceeding.
- C. All design and construction details for this project shall conform to the requirements of the following governing design codes:
 - 1. International Residential Code (IRC 2018) and referenced standards as amended by the city of Lenexa, Kansas.
 - 2. Minimum Design Loads for Buildings and Other Structures (ASCE7-16)
 - 3. Specification for Structural Steel Buildings (AISC 360-16)
 - 4. Member Design Basis is Allowable Stress Design (ASD)
 - 5. Connection Design Basis is Allowable Stress Design (ASD)
 - 4. Structural Welding Code (AWS D1.1/D1.4M - 2017)
 - 6. Building Code Requirements for Structural Concrete (ACI 318-14)
 - 7. Building Code Requirements for Masonry Structures (TMS 402-16)
 - 8. North American Specification for the Design of Cold-Formed Steel Structural Members (ANSI S100-16)
 - 8. National Design Specification (NDS) for Wood Construction with 2018 Supplements (ANSI/APA NDS 2018)
 - 9. Special Design Provisions for Wind and Seismic (AWC SDPWS-2015)
- D. These drawings are for a specific project and no other use is authorized.

2. Structural Load Design Criteria

- A. Live Loads**
- a. Roofs = 25 psf
 - b. Floors = 40 psf
 - c. Balconies = 60 psf
 - d. "An allowance of 15psf has been made for partitions as a uniformly distributed live load where the live load stated above is 80psf or less
- B. Roof Live Load = 20 psf**
- C. Snow:** Pg = 20psf, Pf = 14psf, Is = 1.0, Ce = 1.0, Ct = 1.0, Drift per ASCE/SEI 7
- D. Rain:** 15-Minute Rainfall Intensity = 7.62 in./h
60-minute Rainfall Intensity = 3.60 in./h
- A. Lateral Loads:**
- 1. Wind:
 - V = 110 mph, Exposure C
 - Occupancy [Risk] Category II, Iw=1.0 G.Cp/+-0.18
 - Design wind pressures to be used for the design of exterior component and cladding materials on the designated zones of wall and roof surfaces shall be per section 30.7 and Table 30.7-2 of ASCE/SEI 7. Tabulated pressures shall be multiplied by effective area reduction factors, exposure adjustment factors and topographic factors where applicable
 - 2. Seismic:
 - Ss = 0.095, S1 = 0.069
 - Occupancy [Risk] Category II, Ie=1.0,
 - Site Classification D, Sds = 0.101, Sd1 = 0.110
 - Seismic Design Category B
 - Basic Seismic Force-resisting System: Light-Framed Walls with shear panels of all other materials
 - Equivalent Lateral Force Procedure
 - R = 2.0, V = 0.05*Wt, Omega = 2.5, Cd=2.0
- B. This project is designed to resist the most critical effects resulting from the load combinations of section 1605.3 of the International Building Code,**

3. Concrete

- A. All concrete for foundations (walls, grade beams, footings and piers) shall develop minimum ultimate compressive design strength of 3500 psi in 28 days, but not less than 500 pounds of cement shall be used per cubic yard of concrete regardless of strength obtained, not over 6 gallons of water per 100 pounds of cement, with 6% +/- air entrainment, and not over 4 inches of slump.
- B. All concrete for interior framework shall develop minimum ultimate compressive design strength of 4000 psi in 28 days, but not less than 540 pounds of cement shall be used per cubic yard of concrete regardless of strengths obtained, not over 5.40 gallons of water per 100 pounds of cement, with 6% +/- air entrainment, and not over 4 inches of slump. Concrete mix shop drawing shall contain testing data proving concrete design mix shrinkage is less than 0.034% at 28 days when tested according to ASTM C157 (air drying method only).
- C. All concrete for exterior framework shall have a minimum design compressive strength of 4000 psi in 28 days, with not less than 560 pounds of cement per cubic yard of concrete, not over 5 gallons of water per 100 pounds of cement, with 6% +/- 1% air entrainment, and a maximum of 4 inches of slump.
- D. The preceding minimum mix requirements may have water-reducing admixtures substituted for water, provided the mix is at manufacturer's dosage rates for improved workability.
- E. The preceding minimum mix requirements may have up to 15% maximum of the cement content replaced with an approved ASTM C618 Class C fly ash, provided the total minimum cementitious content is not reduced.
- F. Concrete (concrete) shall be placed well graded from coarsest to finest with no more than 18 percent and not less than 8 percent retained on an individual sieve, except that less than 8 percent may be retained on coarsest sieve and on No. 50 and finer sieves. Submit this gradation report with the concrete mix design shop drawings.
- G. All interior concrete slabs grade shall be placed over 15 ml. Class A Vapor Barrier per ASTM E1745 with not less than 0.01 perms, tested after mandatory conditioning. All joints shall be lapped and sealed per manufacturer's recommendations. All penetrations, as well as damaged vapor barrier material shall also be sealed per manufacturer's recommendation prior to concrete placement. Insulation shall be per manufacturer's recommendation at all discontinuous edges (at interior columns, exterior edge of slab, etc.) to ensure terms of warranty are followed. The vapor barrier shall be placed over free-draining granular material as prescribed by the project soils report.
- H. All interior concrete shall be placed at the base and top of wall by the contractor until the slab on grade at the base and the floor framing/slab at the top of wall is complete and the concrete has achieved 75% of the design strength. The contractor is responsible for engineering and design of the wall bracing, if required. All concrete is reinforced concrete unless specifically called out as unreinforced. Insulation shall be per manufacturer's recommendation in the same manner as areas. Any details not shown shall be detailed per ACI 315 and meet requirements of ACI 318, current editions.
- I. Control joints in dirt formed slab to be as shown on plans. Where not shown, limit controlled areas to not more than 144 square feet, or 12 feet on any side. Slab panel shall be 12 feet by 12 feet.
- J. Contractor shall verify that all concrete inserts, reinforcing and embedded items are correctly located and rigidly secured prior to concrete placement.
- K. L. Construction joints in beams, slabs, and grade beams shall occur at midspan (midheight) unless noted otherwise. Provide 2 x 4 horizontal keys at construction joints for shear transfer.
- M. No aluminum items shall be embedded in any concrete.

4. Reinforcing Steel

- A. All reinforcing steel shall conform to the requirements of ASTM A615 or A706 grade 60 steel. Welded plain wire fabric shall be supplied in sheets and conform to the requirements of ASTM A185.
- B. Clear coverage of concrete over reinforcing steel shall be as follows:
 - 1. Concrete placed against form: 2"
 - 2. Formed concrete against earth: 2"
 - 3. Slabs: 1" 1"
 - 4. Beams or Columns: 2" 1-1/2"
 - 5. Other: 2"
- C. All coverage shall be nominal bar diameter minimum.
- D. All dowels shall be the same size and spacing as adjoining main bars (splice lap 48 bar diameters or 24" minimum unless noted otherwise).
- E. At corners of all walls, beams, and grade beams supply corner bars (minimum 2'-0" in each direction or 48 bar diameters) in outside face of wall, matching size and spacing of horizontal bars. Supply 2'-48 bars in vertical bars in outside face of wall, supply 3'-#4 vertical support bars for corner bars.
- F. Bars marked continuous and all vertical steel shall be lapped 48 bar diameters (2'-0" minimum) at splices and embedments, unless shown otherwise. Splice top bars near midspan and splice bottom bars over supports, unless noted otherwise.
- G. Reinforcing steel shall be spaced at a maximum of 20" x 20" on center and coordinated with the architect. Every other horizontal wall reinforcing bar shall be discontinuous at control joints except heavy top and bottom bars unless noted otherwise. Provide base steel waterproof system 772 (by Greenstreak Inc. or approved equal) on dirt face side of wall at all walls below grade.
- H. Accessories shall be as specified in latest edition of the ACI Detailing Handbook and the Reinforcing Steel Institute Design Handbook. Maximum accessory spacing shall be 4'-0" on center, and all accessories on exposed surfaces are to have plastic coated feet.
- I. All slabs and stairs not shown otherwise shall be 6" thick with #4 bars at 12" on center each way. All exterior porches and stoops not otherwise detailed may be constructed by any standard manner, solid or hollow, but must be reinforced with #4 bars at 12" on center each way minimum. Porches shall be detailed to adjacent walls or grade beams with #4 bars at 12" on center, hooked or embedded 48 diameters into both members. Slope porches 1/8" per foot for drainage unless noted otherwise.
- J. Allow 1 ton of reinforcing bars #4 or larger to be used as directed in the field for special conditions by the engineer of record (labor for placing same to be included).

5. Structural Steel

- A. All structural steel beams and columns shall be ASTM A592, grade 50 steel and all miscellaneous steel shall be ASTM A36 grade steel (except at moment connections where plates shall be ASTM A572, grade 50). Hollow Structural Sections (HSS) shall be as specified in the Fabrication and Erection of Structural Steel in accordance with AWS "Code of Standard Practice for Steel Buildings and Bridges" in the referenced edition of the AISC Steel Construction Manual.
- B. All welding shall conform to the recommendations of the AWS.
- C. All exterior steel connections, and brack relief angles shall be hot-dip galvanized.
- D. All bolts shall be A325 bolts. All bolts shall be high strength bolts (ASTM A325-N). All bolts shall be fully pretensioned. All beam connections shall be designed per the AISC Manual of Steel Construction "Frame Beam Connections" for the indicated reactions or at least a 0.4 x beam total shear capacity. V_n/Ω , shown in the maximum total uniform load diagram. However, if the shear and moment diagram for the anchorages shows more than 2" from the end of the support. All connections must be two bolt minimum. Additional connection elements may not be specifically shown in the conceptual details in this set but may be required by the final connection design, such as stiffener plates, doublers, plates, supplement/reinforcing plates or other connection material. Connector plates shall be designed and fabricated by a professional engineer licensed in the state the project is located and shop drawings and connection calculations shall bear his/her seal.
- E. All anchor bolts shall be 3/4" diameter, ASTM F1554, Grade 36 unless noted otherwise. Anchor bolts shall be installed in accordance with the anchor design in Table 4.2-2 of the AISC Steel Construction Manual shall be provided at every column anchor bolt. Plate washers shall have a standard size hole for the anchor bolt. At 3/16" frames, plate washers shall be welded all around to the column base plate with 3/16" fillet weld. Loose linings for support of masonry veneer over all openings up to 8'-0" wide in new and existing walls and not used for support of masonry veneer shall be 1/2" thick 60,000 psi bearing at each end. All exterior linings shall be hot-dip galvanized.

6. Post-installed Anchors

- A. Post-installed anchors shall be used only where specified on the drawings unless approved in writing by the engineer of record. See drawings for anchor diameter, spacing and embedment. Performance values of the anchors shall be obtained for specified products using appropriate design procedures and/or standards as required by the governing building code. All anchors installed in concrete shall have an ICC-ES Evaluation Service Report. Special Inspection is required for all post installed anchors. The contractor shall coordinate an on-site meeting with the post installed anchor manufacturer field representative to educate the construction team on the anchor installation guidelines and requirements.
- B. Mechanical anchors used in cracked and uncracked concrete shall have been tested and qualified for use in accordance with ACI 308.2 and ICC-ES AC108. All anchors shall be installed per the anchor manufacturer's written instructions.
- C. Adhesive anchors used in cracked and uncracked concrete shall have been tested and qualified for use in accordance with ICC-ES AC108 and ICC-ES AC308. All anchors shall be installed per the anchor manufacturer's written instructions.
- D. Mechanical anchors used in solid grouted masonry shall have been tested and qualified for use in accordance with ICC-ES AC01. All anchors shall be installed per the anchor manufacturer's written instructions.
- E. Adhesive anchors used in solid grouted masonry shall have been tested and qualified for use in accordance with ICC-ES AC58. All anchors shall be installed per the anchor manufacturer's written instructions.
- F. Anchors used in hollow concrete masonry shall have been tested and qualified in accordance with ICC-ES AC106 or ICC-ES AC58 as appropriate. All anchors shall be installed per the anchor manufacturer's written instructions with appropriate screen tubes used for adhesives.

7. Foundations

- A. The soil investigation was prepared by Kansas City Testing & Engineering (KCTE). The report number is G-15-175.
- B. Spread footings, grade beams, and retaining walls are designed to bear on engineered fill or undisturbed soil capable of safely sustaining 2,500 psf.
- C. Retaining walls are designed for an active lateral load of 60 pc equivalent fluid pressure.
- D. Basement walls are designed for an at rest lateral load of 60 pc equivalent fluid pressure. See General Note 3.H for wall bracing requirements.
- E. Contractor shall provide for dewatering at excavations from either surface water or seepage.
- F. All foundation excavations shall be inspected by a qualified soil engineer, approved by the architect and/or structural engineer, prior to placement of steel or concrete. This inspection shall be at the owner's expense.
- G. All concrete in the structural portion retaining the backfill shall have attained its design strength prior to being backfilled.
- H. Moisture content in soils beneath building locations should not be allowed to change after frost excavations and after grading for slabs on grade are completed. If subgrade materials are excavated or softened by water or other conditions, recompact materials to the density and water content specified for engineered fill. Do not place concrete on frozen ground.

8. Concrete Masonry Units

- A. Concrete block used in exterior walls or load bearing walls shall meet the requirements of ASTM C90 and have a minimum net compressive strength of 2650 psi and laid up using type N mortar such that f_m equals 2000 psi. Mortar shall be volume proportion based cement lime mortar. Proportioning shall be completed by block measure. Any block in contact with earth shall be normal weight units, laid using type "S" mortar and grouted solid.
- B. The contractor shall provide adequate temporary bracing for all masonry walls during construction.
- C. All concrete block shall have 9 gage (or larger) horizontal joint reinforcing (ladder or cross) and vertical architectural drawings and specifications (16" maximum vertical spacing).
- D. Cavity wall construction shall be reinforced as designed for specific concrete block used. The horizontal joint reinforcing shall be of the ladder or truss style per specification and continuous between brick and block, as prescribed by the architectural drawings.
- E. Concrete block shall be reinforced per schedule and/or details on the drawings. Where not specifically noted, non-load-bearing interior partition walls shall be reinforced as follows in 6", 8", 10", and 12" walls:
 - 1. Vertical reinforcing shall be a minimum of 1 - #4 bar in 6" and 8" walls and 2 - #4 bars in 10" and 12" walls at 4'-0" on center, at each corner, at each door and window jamb, each side of control joints and in the end of each length of wall. Lap splices for vertical reinforcing shall be staggered.
 - 2. Horizontal reinforcing:
 - A. Horizontal joint reinforcing as noted above.
 - B. Continuous horizontal bars shall be included per section or detail in bond beam or optional running bond beam where noted. Where bond beams are continuous at corners of walls, supply and install 2" wide, 1/4" thick matching size of horizontal bars (minimum 16" on center) at 4'-0" or 40 bar diameters in each direction.
- F. GROUT, where noted above, shall have a minimum design ultimate compressive strength of 2500 psi at 28 day test and 3/8" maximum aggregate size.
- G. Non-load bearing concrete block walls shall be isolated from adjacent structural elements with vertical 3/8" control joints and at the top of the wall with 1" air space or non-combustible material and supported per architectural detail.
- H. Unless otherwise covered on architectural plans or specifications, vertical control joints in masonry construction shall be 3/8" wide, full height of wall. Joints shall be spaced at a maximum of 24'-0" on center and coordinated with the architect. All horizontal joint reinforcing shall be discontinuous at control joints in masonry. All bond beam horizontal reinforcing shall be continuous.
- I. Lintels over all openings up to 8'-0" wide in new and existing masonry walls not otherwise noted shall be one L6x3 1/2x5 1/8 (LLV) for each 4' width of masonry. All exterior lintels shall be galvanized.
- J. Walls shall be anchored top and bottom by dowels matching wall vertical reinforcing (unless noted otherwise) from floor slab bottom and bracing angles at the top, per details on the drawings.

9. Timber and Wood Framing

- A. Quality and construction of wood framing members and their fasteners for load supporting purposes not otherwise indicated on the drawings shall be in accordance with the International Building Code.
- B. All studs and top and bottom plates shall be Douglas Fir No. 2 grade visually graded lumber, with a shear stress in bending of 100 psi minimum and an elastic modulus of 1,600,000 psi unless noted otherwise. All joist, truss members, and headers to be No. 2 grade (min.) unless noted otherwise. All lumber for exterior decks and balconies shall be treated Southern Yellow Pine No. 2 grade.
- C. Blocking of stud bearing walls and shear walls shall be solid, matching sheathing joints.
- D. Joist blocking and bracing shall be solid wood or cross-briding of either wood or metal straps. Spacing, in any case, shall not exceed 8'-0".
- E. Wood members and sheathing shall be fastened with number and size of fasteners not less than that set forth in Table 2304.9.1 of the International Building Code. Floor sheathing shall be 1/2" thick tongue and groove flooring, No. 2 grade, S-P-F, glued and nailed with 8d ring shank nails or # 10 screws at 12" on center in all supports. Sheathing of shear walls or roof diaphragms shall be edge nailed with 8d common nails at 6" on center and nailed to intermediate framing and/or blocking members with 8d common nails at 12" on center unless otherwise noted on the drawings. All floor sheathing shall be installed with 1/8 inch gaps between joists and blocking and joint edges.
- F. Sill plates shall be bolted to concrete walls or steel beams with 1/2" diameter bolts at 32" on center. Sill plates in direct contact with concrete or masonry shall be treated lumber w/ hot-dip galvanized bolts.
- G. Joist hangers shall have International Building Code approval and shall be equal to Simpson Strong-Tie LUS for wood application and LB for steel weld-on application.
- H. Service condition - dry with moisture content at or below 19% in service.
- I. Laminated veneer lumber (LVL) shall have an allowable flexural stress (Fb) of 2,600 psi (reduced by size factor) and an elastic modulus (E) of 1,900,000 psi.
- J. Parallel Strand Lumber (PSL) shall have an allowable flexural stress (Fb) of 2,900 psi (reduced by size factor) and an elastic modulus (E) of 2,000,000 psi.
- K. Pre-engineered wood trusses shall be designed in accordance with the Truss Plate Institute's national design standard for metal-plate connected wood truss construction (ANSI/TP1 - latest edition). Trusses shall be designed and manufactured by an authorized member of the Truss Plate Institute of America (WTCA). Truss design shall conform to specified codes, allowable stress design, and design load limits. The manufacturer shall provide all applicable criteria of the governing code.
- L. Shop drawings showing complete erection and fabrication details and calculations (including connections) shall be submitted to the project architect/engineer for review prior to fabrication and/or erection. Such drawings shall bear the seal of a professional engineer, registered in the state of the project location. Shop drawings shall also be submitted to the engineer for review and control before erection is requested by that agency.
- M. All trusses shall be securely braced both during erection and permanently, as indicated on the approved truss design drawings and in accordance with TPI's commentary and recommendations for handling, installing and bracing metal-plate connected wood trusses.
- N. The truss manufacturer shall supply all hardware and fasteners for joining truss members together and fastening truss members to their supports. Metal connector plates shall be manufactured by a member of the Wood Truss Council of America (WTCA) and shall be 20 gauge minimum. Connector plates shall meet or exceed ASTM A653, grade 33, with a minimum yield strength of 45,000 psi.
- O. Shipment, handling, and erection of trusses shall be by experienced, qualified persons and shall be performed in a manner so as not to endanger life or property. Apparent truss damage shall be reported to the truss manufacturer for evaluation prior to erection. Cutting or alteration of trusses is not permitted.
- P. Contractor shall coordinate truss layout for openings and penetrations required by other trades including for plumbing, HVAC, electrical, roof access hatches, chases, etc.
- Q. Pre-engineered floor truss and Joist design load and deflection criteria are as follows:
- Top Chord Dead Load = 20psf
 - Top Chord Live Load = Per General Note 2A
 - Bottom Chord Dead Load = 20psf
 - Allowable Total Load Deflection = L/480
 - Allowable Live Load Deflection = L/360, 1/2" maximum
- R. Pre-engineered roof truss design load and deflection criteria are as follows:
- Top Chord Dead Load = 15psf
 - Top Chord Live Load = 20psf
 - Bottom Chord Dead Load = 10psf
 - Allowable Total Load Deflection = L/360
 - Allowable Live Load Deflection = L/360
- Roof trusses shall be designed for wind uplift loads indicated in Building Components & Cladding Wind Loads Diagram.

10. Shop Drawings and Deferred Submittals






- A. Bob D. Campbell and Company, Inc. will review the General Contractor's (GC) shop drawings and related submittals (as indicated below) with respect to the ability of the detailed work, when complete, to be a properly functioning integral element of the overall structural system designed by Bob D. Campbell and Company, Inc.
- B. Permit to be submitted to the project of record for review. The reviewer shall forward to the building official for review and approval. Design calculations for deferred submittals shall be submitted at the same time as the shop drawings for review. Design calculations shall be prepared and sealed by a Professional Engineer licensed in the state of the project. The deferred submittal items shall not be installed until the deferred Submittal documents have been approved by the building official.
- C. The following items shall be a shop drawing or any related material to Bob D. Campbell and Company, Inc. the GC shall:
1. Review each submission for conformance with the means, methods, techniques, sequences and operations of construction and safety precautions and programs inherent thereto, all of which are the sole responsibility of the GC.
 2. Review and approve each submission.
 3. Stamp each submission as approved.
- D. Bob D. Campbell and Company, Inc. shall assume that no submission comprises a variation unless the GC advises Bob D. Campbell and Company, Inc. with written documentation.
- E. Bob D. Campbell and Company, Inc. shall review shop drawings and related materials with the GC and provide the GC with the submission has met the above requirements. Bob D. Campbell and Company, Inc. shall return without comment/unrequired material or submissions without GC approval stamp.
- F. Required shop drawings and related material (if any) are indicated below. Should Bob D. Campbell and Company, Inc. require more than ten (10) working days to perform the review, Bob D. Campbell and Company, Inc. shall notify the GC.
1. Concrete: All design and construction submittals including admixtures and compounds applied to the concrete after placement.
 2. Reinforcing steel shop drawings including erection drawings and bending details. Bar list will not be reviewed for correct quantities.
 3. Construction and control joint plans and/or elevations.
 4. Structural steel shop drawings including erection drawings and piece details.
 5. Include pipe, decking and miscellaneous submittals including miscellaneous framing specified on the structural drawings, but do not submit framing specified on non-structural drawings for Bob D. Campbell and Company, Inc. review.
 6. Deferred Submittal: Railings and guardrails
 7. Deferred Submittal: Metal stair framing
 8. Miscellaneous anchors shown on the structural drawings.
 9. Deferred Submittal: Wood truss design calculations and detailed erection and fabrication drawings. Standard stick framing shop drawings need not be submitted.

11. Statement of Structural Special Inspections


- A. The structural design for this project is based on completion of special inspections during construction in accordance with section 1704 of the International Building Code. The owner shall employ one or more qualified special inspectors to provide the required special inspections.
- B. The special inspector shall furnish inspection reports to the building official, owner, architect and structural engineer, and any other designated person.
- C. All discrepancies shall be brought to the immediate attention of the contractor for correction, then, if uncorrected, to the proper design authority, building official and structural engineer.
- D. The special inspector shall submit a final signed report stating that the work requiring special inspection was, to the best of the inspector's knowledge, in conformance with the approved plans and specifications and the applicable workmanship provisions of the building code.
- E. The following inspections and tests are required with the frequency (continuous or periodic) as defined within the referenced section or standard listed below. The General Contractor shall provide notification to the inspector when items requiring inspection are ready to be inspected and provide access for those inspections.
 - 1. Shop Fabrication – structural steel per Section 1704.2.5 unless AISI certified shop
 - 2. Shop Fabrication – pre-engineered wood trusses per Section 1704.2.5 unless TPI certified shop
 - 3. Steel Construction per Section 1705.2 and the quality assurance requirements of AISI 341 Chapter J (as referenced by AISI 360)
 - 4. Concrete Construction per Section 1705.3 and Table 1705.3
 - a. Reinforcing Steel Placement
 - b. Reinforcing Steel Welding
 - c. Cast in Place Anchors
 - d. Post Installed Anchors
 - e. Design Mix Verification
 - f. Concrete Sampling and Testing
 - g. Concrete Placement
 - h. Concrete Curing
 - i. Formwork Shape, Location and Dimensions
 - 5. Masonry Construction per Section 1705.4 and the quality assurance requirements of TMS 402/AISC530/ASCE5 and TMS602/A530.1/ASCE6 Level 2
 - 6. Wood Construction- Metal-Plate-Connected wood trusses spanning 60 feet or greater per Section 1705.3.2
 - 7. Verification of Soils per Table 1705.6
- F. Wood Lateral System (periodic)
 - a. Wood shearwalls (include sheathing, rim board and bottom plate attachments)
 - b. Portal frames
 - c. Shear wall and portal frame holdowns
 - d. Shear wall tension system
- G. Wood Gravity Framing and Placement (adjust frequency of random sampling where indicated as required)
 - a. Heavy beam/SC/Lglulam beams and supports (periodic)
 - b. Headers and jamps (random sampling)
 - c. Bearing walls (random sampling)
 - d. Connector/hardware installation (random sampling)
 - e. Floor and roof trusses (random sampling).

12. Copyright and Disclaimer

- A. All drawings in the structural set (S-series drawings) are the copyrighted work of Bob D. Campbell and Company, Inc. These drawings may not be photocopied, traced, scanned, or otherwise reproduced in any form without the written permission of Bob D. Campbell and Company, Inc. Exception: Original drawings may be printed for distribution to the owner, architect, and general contractor for coordination, bidding, and construction. Subcontractors may not reproduce these drawings for any purpose or in any form.
- B. I, Ryan M. Hagedorn, P.E., registered engineer and a representative of Bob D. Campbell and Company, Inc., do hereby accept professional responsibility as a professional engineer for the design of the above referenced project and the design drawings consisting of S-series drawings. I hereby disclaim responsibility for all other drawings in the construction document package, they being the responsibility of the architect or other professional. Any and all signed statements may appear elsewhere in the construction document package.

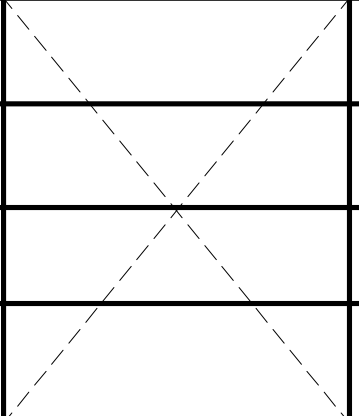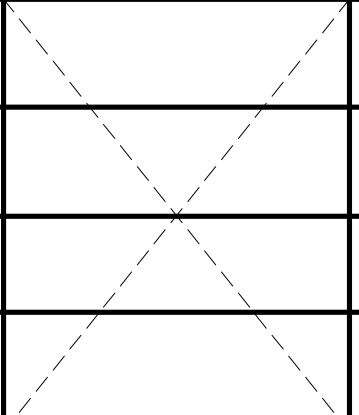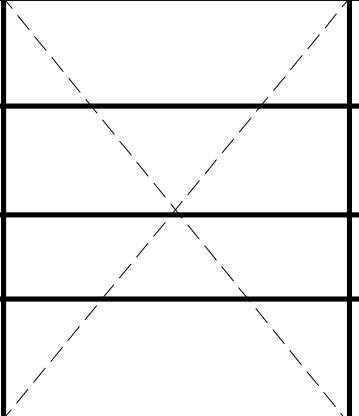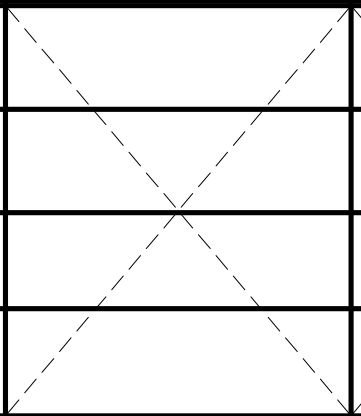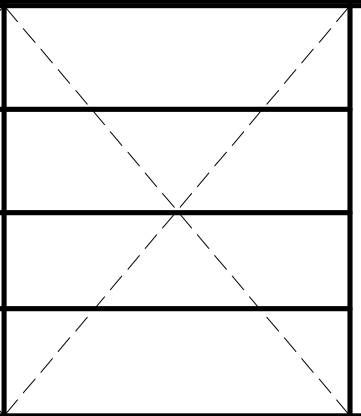SHEARWALL SCHEDULE					
SHEARWALL TYPE		FLOOR			PLATE CONNECTION (SILL TO RIM BOARD & RIM BOARD TO TOP PLATE) (RE: NOTES 6 & 7)
		1st FLOOR WALLS	2nd FLOOR WALLS	3rd FLOOR WALLS	
SW-1	MATERIAL & THICKNESS	19/32" OSB SHEATHING EACH SIDE w/ EDGES BLOCKED	15/32" OSB SHEATHING ONE SIDE w/ EDGES BLOCKED	15/32" OSB SHEATHING ONE SIDE w/ EDGES BLOCKED	3rd FLR: 16d NAILS @4"oc 2nd FLR: 30d NAILS @ 2"oc
	NAIL SIZE & SPACING	10d NAILS 2/12	10d NAILS 3/12	10d NAILS 6/12	
	NO. OF STUDS AT HOLD-DOWN	(4)2x6	(3)2x6	(2)2x6	
	HOLD-DOWN TYPE	HDU14-SDS2.5 (RE: 11/S4.1)	HDU8-SDS2.5	HDU4-SDS2.5	
SW-2	MATERIAL & THICKNESS		18"Lg SIMPSON STRONG WALL EACH SIDE OF GARAGE DOOR OPENING. FOLLOW MANUFACTURER REQUIREMENTS FOR ANCHORAGE AND ATTACHMENT TO STRUCTURE.	7/16" OSB SHEATHING ONE SIDE w/ EDGES BLOCKED	
	NAIL SIZE & SPACING			8d NAILS 6/12	
	NO. OF STUDS AT HOLD-DOWN			(2)2x6	
	HOLD-DOWN TYPE			HDU8-SDS2.5	
SW-3	MATERIAL & THICKNESS		15/32" OSB SHEATHING ONE SIDE w/ EDGES BLOCKED	15/32" OSB SHEATHING ONE SIDE w/ EDGES BLOCKED	
	NAIL SIZE & SPACING		10d NAILS 3/12	10d NAILS 4/12	
	NO. OF STUDS AT HOLD-DOWN		(4)2x6	(2)2x6	
	HOLD-DOWN TYPE		HDU11-SDS2.5	HDU11-SDS2.5	
SW-4	MATERIAL & THICKNESS	7/16" OSB SHEATHING ONE SIDE w/ EDGES BLOCKED	7/16" OSB SHEATHING ONE SIDE w/ EDGES BLOCKED	7/16" OSB SHEATHING ONE SIDE w/ EDGES BLOCKED	
	NAIL SIZE & SPACING	8d NAILS 6/12	8d NAILS 6/12	8d NAILS 6/12	
	NO. OF STUDS AT HOLD-DOWN	(2)2x6	(2)2x6	(2)2x6	
	HOLD-DOWN TYPE	HDU5-SDS2.5	HDU5-SDS2.5	HDU5-SDS2.5	
SW-5	MATERIAL & THICKNESS	15/32" OSB SHEATHING ONE SIDE w/ EDGES BLOCKED	7/16" OSB SHEATHING ONE SIDE w/ EDGES BLOCKED	7/16" OSB SHEATHING ONE SIDE w/ EDGES BLOCKED	
	NAIL SIZE & SPACING	8d NAILS 3/12	8d NAILS 4/12	8d NAILS 6/12	
	NO. OF STUDS AT HOLD-DOWN	(2)2x6	(2)2x6	(2)2x6	
	HOLD-DOWN TYPE	HDU8-SDS2.5	HDU8-SDS2.5	HDU5-SDS2.5	
SW-6	MATERIAL & THICKNESS		15/32" OSB SHEATHING ONE SIDE w/ EDGES BLOCKED	15/32" OSB SHEATHING ONE SIDE w/ EDGES BLOCKED	3rd FLR: 16d NAILS @4"oc 2nd FLR: 30d NAILS @ 2"oc
	NAIL SIZE & SPACING		10d NAILS 2/12	10d NAILS 4/12	
	NO. OF STUDS AT HOLD-DOWN		(4)2x6	(3)2x6	
	HOLD-DOWN TYPE		HDU14-SDS2.5	HDU8-SDS2.5	
SW-7	MATERIAL & THICKNESS	19/32" OSB SHEATHING ONE SIDE w/ EDGES BLOCKED	19/32" OSB SHEATHING ONE SIDE w/ EDGES BLOCKED	19/32" OSB SHEATHING ONE SIDE w/ EDGES BLOCKED	3rd FLR: 16d NAILS @4"oc 2nd FLR: 30d NAILS @ 2"oc
	NAIL SIZE & SPACING	10d NAILS 2/12	10d NAILS 3/12	10d NAILS 6/12	
	NO. OF STUDS AT HOLD-DOWN	(4)2x6	(3)2x6	(2)2x6	
	HOLD-DOWN TYPE	HDU14-SDS2.5	HDU8-SDS2.5	HDU4-SDS2.5	
SW-8	MATERIAL & THICKNESS	7/16" OSB SHEATHING ONE SIDE w/ EDGES BLOCKED			
	NAIL SIZE & SPACING	8d NAILS 6/12			
	NO. OF STUDS AT HOLD-DOWN	(6)2x6			
	HOLD-DOWN TYPE	HDU5-SDS2.5			

- NOTES:
- NAILING SHALL BE TO ALL STUDS, TOP & BOTTOM PLATES, AND BLOCKING WHERE INDICATED. NAILS FOR GYPSUM SHEATHING ARE COOLER NAILS AND NAILS FOR OSB SHEATHING ARE COMMON NAILS. GYPSUM CAN BE ATTACHED WITH DRYWALL SCREWS AT SAME SPACING INDICATED FOR NAILS.
 - HOLD-DOWNS PER PLAN & SCHEDULE.
 - WHERE THE ENDS OF PERPENDICULAR SHEAR WALLS INTERSECT AND ONLY ON HOLDOWN SHOWN ON PLAN, FASTEN ALL STUDS TOGETHER PER SCHEDULE AND USE LARGER OF THE TWO HOLD-DOWNS SHOWN IN THE SHEARWALL SCHEDULE.
 - PROVIDE 2 WALL STUDS AT EACH HOLDOWN UNLESS NOTED OTHERWISE IN SCHEDULE.
 - NAIL AND STAPLE SPACING SHOWN AS (##) INDICATES FASTENERS SPACING IN INCHES AT THE EDGES/FIELD WHERE FIELD IS THE INTERMEDIATE MEMBERS.
 - TYPICAL SILL PLATE TO WOOD (RIM BOARD) AND WOOD (RIM BOARD) TO TOP PLATES SHALL BE 16d NAILS AT 12"oc UNLESS NOTED OTHERWISE IN SCHEDULE.
 - TYPICAL SILL PLATE TO CONCRETE SHALL BE 1/2"x6" Lg SIMPSON TITEN HD ANCHOR:
AT 2x4 WALLS SPACE AT 24"oc MAX WITH 1/4"x2 1/2"x2 1/2" PLATE WASHER OR SIMPSON BPS1/2-3 @ CONTRACTORS OPTION
AT 2x6 WALLS SPACE AT 24"oc MAX WITH 1/4"x2 1/2"x4 1/2" PLATE WASHER OR SIMPSON BPS1/2-6 @ CONTRACTORS OPTION
AT 2x8 WALLS SPACE AT 18"oc MAX WITH 1/4"x2 1/4"x2 1/2" PLATE WASHER OR SIMPSON BPS1/2-3 @ CONTRACTORS OPTION
 - PLATE WASHERS TO MAINTAIN MAX OF 1/2" BETWEEN EDGE OF SILL PLATE AND EDGE OF PLATE WASHER.
 - OSB @ INTERIOR WALL SHALL BE IN ADDITION TO 5/8" GYP SHEATHING.
 - SHEARWALL SHEATHING CALLED OUT AT CORRIDOR WALLS SHALL BE LOCATED AT UNIT SIDE OF WALL.
 - REFER TO NOTE 10.T ON S0.01 FOR FIRE RETARDANT TREATED SHEATHING REQUIREMENTS.

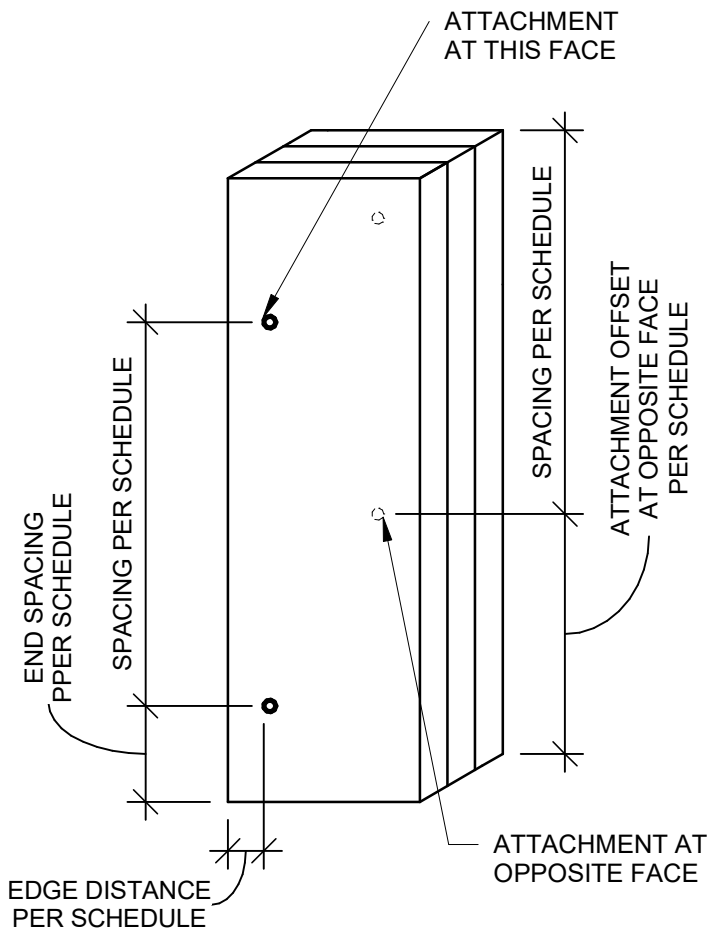

TYPICAL BUILT-UP STUD PACK CONNECTION

A
1 1/2" = 1'-0"

FLOOR AND ROOF FRAMING HEADERS SCHEDULE

MARK	HEADER	JAMB STUDS (2x6 U.N.O.)	NOTES
H1	(3) 2x8	1 JACK / 1 KING	
H2	(3) 2x8	1 JACK / 2 KING	
H3	(3) 2x10	1 JACK / 1 KING	
H4	(3) 2x8	SEE PLAN	
H5	(3) 2x12	1 JACK / 1 KING	
H6	(3) 1 1/2"x14" LVL	2 JACK / 2 KING	
H7	(3) 1 1/2"x9 1/2" LVL	3 JACK / 2 KING	
H8	(3) 1 1/2"x11-7/8" LVL	3 JACK / 2 KING	

- NOTES:
- JAMB STUDS SHALL MATCH SIZE & GRADE OF WALL STUDS U.N.O.
 - WHERE BEAM IS NOTED "UPSET", ALL JAMB STUDS NOTED WILL EXTEND TO DOUBLE TOP PLATE.
 - ALL EXTERIOR LUMBER TO BE TREATED. REFER TO NOTE 12.T ON SHEET S001 FOR FIRE RETARDANT TREATED HEADER AND STUD REQUIREMENTS.
 - PROVIDE SQUASH BLOCKS AT TRUSSES & BLOCKING FRAMING WHERE JAMBS OR STUD PACKS ARE DISCONT. QUANTITY TO MATCH JAMB OR STUD PACK ABOVE.
 - PROVIDE 1/2" PLYWOOD SPACER PLATES AT INTERIOR HEADERS CONSTRUCTED WITH 2x LUMBER.
 - AT CONTRACTOR'S OPTION, PROVIDE GLULAM IN LIEU OF PSL OF EQUAL OR GREATER STRENGTH.
 - REFER TO DETAIL 4/S002 FOR MULTI-PLY MEMBER CONNECTION REQUIREMENTS.
 - ATTACH JAMB & KING STUDS TOGETHER PER CONNECTION TYPE 24 ON NAILING SCHEDULE ON S001.

STRUCTURAL DECK & SLAB SCHEDULE

MARK	DESCRIPTION
SOG-1	4" CONCRETE ATOP 15 MIL VAPOR BARRIER PER GENERAL NOTES ATOP 4" FREE DRAINING GRANULAR LEVELING COURSE, ATOP 18" LOW VOLUME CHANGE MATERIAL PER GEOTECH REPORT. REINFORCE SLAB w/ 6x6-W2.9/W2.9 WWF. T/SLAB VARIES PER PLAN AND ARCH.
SOG-2	8" CONCRETE ATOP 15 MIL VAPOR BARRIER PER GENERAL NOTES ATOP 4" FREE DRAINING GRANULAR LEVELING COURSE, ATOP 18" LOW VOLUME CHANGE MATERIAL PER GEOTECH REPORT. REINFORCE SLAB w/ #5@8"oc EACH WAY. T/SLAB VARIES PER PLAN AND ARCH.
FD-1	3/4" T&G APA-RATED SHEATHING. SHEATHING SHALL BE GLUED AND NAILED w/ 8d NAILS @6"oc @ EDGES AND @12"oc @ FIELD OF PANEL.
RD-1	19/32" APA-RATED, EXP-1 SHEATHING ATTACHED w/ 8d NAILS @6"oc @EDGES AND @12"oc FIELD OF PANEL.

- NOTES:
- SOG = SLAB-ON-GRADE TYPE
 - FD = FLOOR DECK TYPE
 - RD - ROOF DECK TYPE


BUILT-UP STUD PACK COLUMN ATTACHMENT SCHEDULE		
NUMBER OF PLYS	ATTACHMENT AT JAMB STUD PACKS	ATTACHMENT AT WALL STUD PACKS
2-PLY MEMBERS	8d NAILS AT 12"oc, 1" FROM EDGE, w/ OPPOSITE EDGE NAILED FROM OPPOSITE SIDE OFFSET 6", @ 12"oc w/ FIRST NAIL 2" FROM EA. END	8d NAILS AT 12"oc, 1" FROM EDGE, w/ OPPOSITE EDGE NAILED FROM OPPOSITE SIDE OFFSET 6", @ 12"oc w/ FIRST NAIL 2" FROM EA. END
3-PLY MEMBERS	20d NAILS AT 16"oc, 1 1/2" FROM EDGE w/ OPPOSITE EDGE NAILED FROM OPPOSITE SIDE OFFSET 6", @ 16"oc w/ FIRST NAIL 4" FROM EA. END	8d NAILS AT 12"oc, 1" FROM EDGE, w/ OPPOSITE EDGE NAILED FROM OPPOSITE SIDE OFFSET 6", @ 12"oc w/ FIRST NAIL 2" FROM EA. END
4-PLY MEMBERS	SDWS22500 SCREWS AT 16"oc, 1 1/2" FROM EDGE w/ OPPOSITE EDGE SCREWED FROM OPPOSITE SIDE OFFSET 8", @ 16"oc w/ FIRST SCREW 4" FROM EA. END	3 PLYS ATTACHED PER 3-PLY ATTACHMENT w/ 4th PLY ATTACHED w/ 8d NAILS AT 12"oc IN 2 ROWS, 1 1/2" FROM EDGE, OFFSET ROW 6"
5-PLY MEMBERS	SDWS22600 SCREWS AT 12"oc, 1 1/2" FROM EDGE w/ OPPOSITE EDGE SCREWED FROM OPPOSITE SIDE OFFSET 6", @ 12"oc w/ FIRST SCREW 4" FROM EA. END	3 PLYS ATTACHED PER 3-PLY ATTACHMENT w/ 4th & 5th PLY ATTACHED w/ 8d NAILS AT 12"oc IN 2 ROWS, 1 1/2" FROM EDGE, OFFSET ROW 6"
6-PLY MEMBERS	SDWS22800 SCREWS AT 12"oc, 1 1/2" FROM EDGE w/ OPPOSITE EDGE SCREWED FROM OPPOSITE SIDE OFFSET 6", @ 12"oc w/ FIRST SCREW 4" FROM EA. END	3 PLYS ATTACHED PER 3-PLY ATTACHMENT w/ 4th PLY ATTACHED w/ 8d NAILS AT 12"oc IN 2 ROWS, 1 1/2" FROM EDGE, OFFSET ROW 6" AND 5th AND 6th PLYS ATTACHED w/ SDWS22500 SCREWS @ 12"oc IN 2 ROWS, 1 1/2" FROM EDGE, OFFSET ROWS 8"oc w/ FIRST SCREW 4" FROM EA. END

- NOTES:
- ALL BUILT-UP STUD PACKS MUST ALIGN FLOOR-TO-FLOOR WITH SOLID BLOCKING (SQUASH BLOCKS) AT FLOOR CAVITIES.
 - EXTEND ALL STUD PACKS TO LOWEST LEVEL UNLESS NOTED OTHERWISE.
 - ALL NAILS ARE COMMON NAILS UNLESS NOTED OTHERWISE.
 - JAMB STUD PACKS ARE STUDS SUPPORTING STRUCTURAL MEMBERS SUCH AS BEAMS, HEADERS, GIRDER TRUSSES, ETC.
 - WALL STUD PACKS ARE REPETITIVE STUDS BETWEEN WALL PLATES AS SCHEDULED IN THE "STUD BEARING WALL SCHEDULE".

NAILING SCHEDULE (REFER TO NOTES #1 and #2)

CONNECTION	ATTACHMENTS (REF NOTE #3 and #4)
JOIST TO SILL OR GIRDER	3- 3" x 0.131" NAILS-TOENAIL 3-8d NAILS-TOENAIL
BRIDGING TO JOIST	2- 3" x 0.131" NAILS-TOENAIL EACH END 2-8d NAILS-TOENAIL EACH END
SOLE PLATE TO JOIST OR BLOCKING	3" x 0.131" NAILS AT 8"o.c.- TYPICAL FACE NAIL 4-3" x 0.131" NAILS AT 6"o.c. BRACED WALL PANELS 16d BOX NAILS AT 16"o.c. MAX. FACE NAILING 3-16d BOX NAILS AT 16"o.c. BRACED WALL PANEL
TOP PLATE TO STUD	3- 3" x 0.131" NAILS-END NAIL 2-16d NAILS-END NAIL
STUD TO SOLE PLATE	4- 3" x 0.131" NAILS-TOENAIL OR 3- 3" x 0.131" NAILS-END NAIL 4-8d NAILS-TOENAIL OR 2-16d NAILS-END
DOUBLE STUDS	3" x 0.131" NAILS AT 8"o.c.-FACE NAIL 16d BOX NAILS AT 24"o.c. MAX. FACE NAIL
DOUBLED TOP PLATES	3" x 0.131" NAILS AT 12"o.c.-FACE NAIL 16d BOX NAILS AT 16"o.c. MAX. FACE NAIL
DOUBLE TOP PLATE LAPS AND INTERSECTIONS	12-3" x 0.131" NAILS 8-16d NAILS
BLOCKING BETWEEN JOISTS OR RAFTERS TO TOP PLATE	3-3" x 0.131" NAILS -TOENAIL 3-8d NAILS-TOENAIL
RIM JOIST TO TOP PLATE	3" x 0.131" NAILS AT 6"o.c.-TOENAIL 8d NAILS AT 6"o.c. MAX.-TOENAIL
TOP PLATE LAPS AND INTERSECTIONS	3- 3" x 0.131" NAILS-FACE NAIL 2-16d NAILS-FACE NAIL
CONTINUOUS HEADER, TWO PIECES	3" x 0.131" NAILS AT 10"o.c. ALONG EACH EDGE 16d NAILS AT 16"o.c. MAX. ALONG EACH EDGE-TOENAIL
CEILING JOISTS TO PLATE	5- 3" x 0.131" NAILS-TOENAIL 3-8d NAILS-TOENAIL
CONTINUOUS HEADER TO STUD	4- 3" x 0.131" NAILS-TOENAIL 4-8d NAILS-TOENAIL
CEILING JOISTS, LAPS OVER PARTITIONS	4- 3" x 0.131" NAILS-FACE NAIL 3-16d NAILS-FACE NAIL
CEILING JOISTS TO PARALLEL RAFTERS	4- 3" x 0.131" NAILS-FACE NAIL 3-16d NAILS-FACE NAIL
RAFTER TO PLATE	3- 3" x 0.131" NAILS-TOENAIL 3-8d NAILS-TOENAIL
1" BRACE TO EACH STUD AND PLATE	2- 3" x 0.131" NAILS-FACE NAIL 2-8d NAILS-FACE NAIL
BUILT-UP CORNER AND MULTIPLE STUDS	3" x 0.131" NAILS AT 16"o.c. 16d NAILS AT 24"o.c. MAX.
BUILT-UP GIRDER AND BEAMS	3" x 0.131" NAILS AT 24"o.c. FACE NAILED TOP AND BOTTOM STAGGERED ON OPPOSITE SIDES 3- 3" x 0.131" NAILS AT ENDS AND EACH SPLICE 20d NAILS AT 32"o.c. MAX. TOP AND BOTTOM, STAGGERED ON OPPOSITE SIDES 2-20d NAILS AT ENDS AND EACH SPLICE
BUILT-UP LAMINATED VENEER LUMBER BEAMS	3" x 0.131" NAILS AT 6"o.c. TOP AND BOTTOM ALONG EDGE 16d NAILS AT 12"o.c. TOP AND BOTTOM ALONG EDGE
2" PLANKING	4- 3" x 0.131" NAILS AT EACH SUPPORT 16d NAILS AT EACH SUPPORT

- NOTES:
- ALL NAILS SHALL BE AS NOTED UNLESS OTHERWISE SPECIFIED ON STRUCTURAL DRAWINGS OR ALTERNATE PROVIDED BY ENGINEER IN WRITING.
 - CONDITIONS NOT SPECIFIED SHALL BE IN ACCORDANCE WITH CURRENT INTERNATIONAL BUILDING CODE.
 - ALL NAILS NOTED AS 8d, 10d, 16d, ETC. SHALL BE COMMON NAILS UNLESS NOTED BOX.
 - NAILING DESIGNATION:

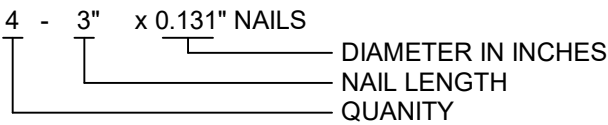

KING STUD(S). FASTEN MULTIPLE KING STUDS TOGETHER PER BUILT-UP STUD PACK ATTACHMENT SCHEDULE INDEPENDENT OF JACK STUDS

ADDITIONAL JACK STUD(S) (SEE SCHEDULE OR PLAN NOTES FOR EXACT QUANTITIES OF JACK STUDS)

FASTEN SUCCESSIVE JACK STUDS w/ 0.131"x3" OR 10d COMMON NAILS. FACE NAILS @ 12"oc STAGGERED AND MIRRORED FROM PREVIOUS PLY

1" EDGE DIST.

TYPICAL JACK STUD ATTACHMENT

B
1 1/2" = 1'-0"

JonesGillamRenz
1881 Main Street, Suite 301
Kansas City, MO 64108
jgr@jgarchitects.com

JGR

LENEXA CITY CENTER _ NORTH VILLAGE TOWNHOMES
NEW TOWNHOMES COMPLEX
KANSAS
LENEXA,




REVISION:

DATE: 8/12/2025
JOB: 25-3090
SHEET NO.:


S0.2

COPYRIGHTED ©

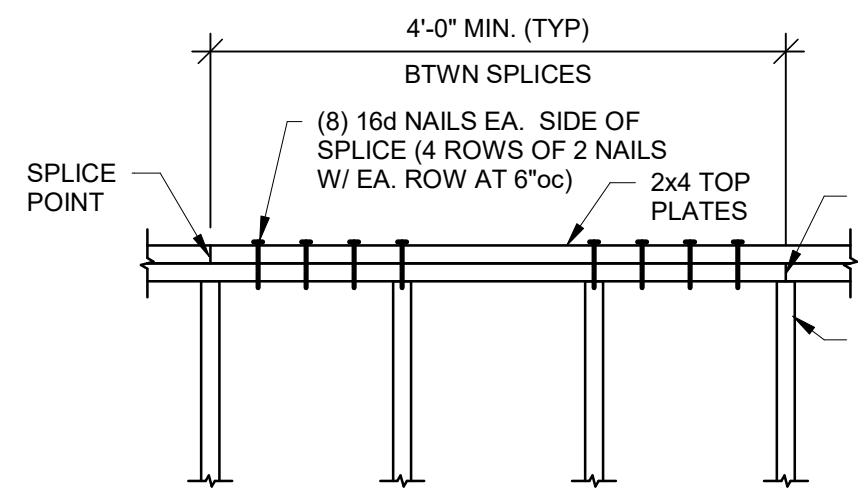


1 DETAIL
3/4" = 1'-0"

- NOTES:
1. INSTALL ENDS OF TOP PLATES TIGHT FOR COMPRESSION CHORD AXIAL FORCE.
2. PROVIDE STRAPS PER DETAIL 1A WHERE THIS DETAIL IS NOT SATISFIED.

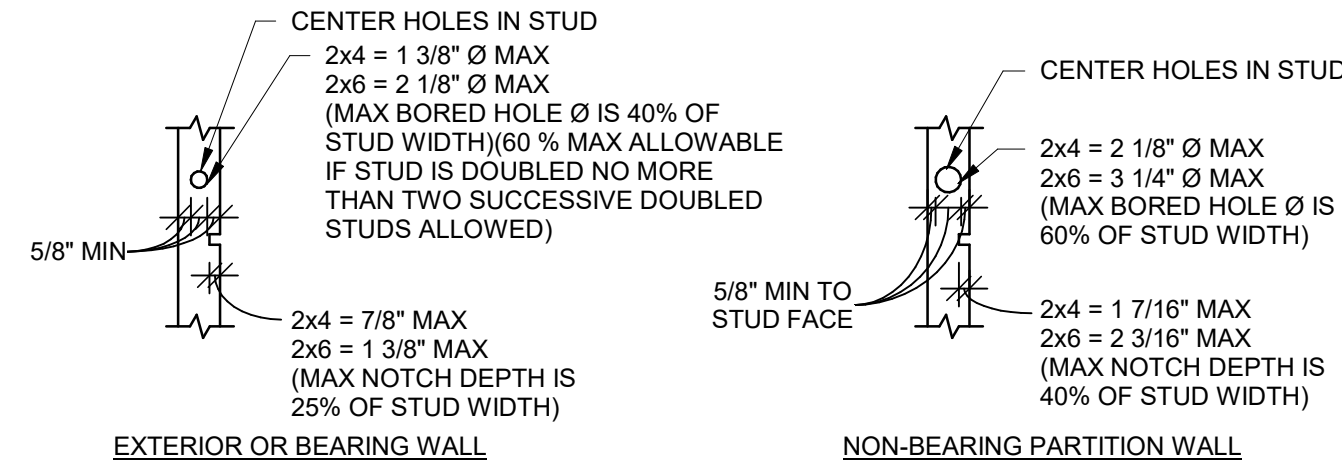


2 DETAIL
3/4" = 1'-0"

- TYPICAL NOTES FOR BEARING WALLS
1. HOLES SHALL NOT BE LOCATED IN THE SAME STUD AS A CUT OR NOTCH.
2. CONTACT ARCHITECT PRIOR TO CUTTING OR NOTCHING TO VERIFY SIZE AND LOCATION IF HOLE IS GREATER THAN 20% STUD WIDTH OR NOTCHES GREATER THAN 10% STUD WIDTH ARE REQUIRED IN TWO OR MORE CONSECUTIVE STUDS.
3. NOTCHES OR HOLES ARE NOT PERMITTED IN JAMBS, STUD PACKS AND AT ENDS OF SHEARWALLS.
4. STUD SHOES ARE NOT AN ACCEPTABLE REMEDIATION OF OVER-NOTCHED OR OVER-CUT STUDS WITHOUT PRIOR APPROVAL BY EOR.

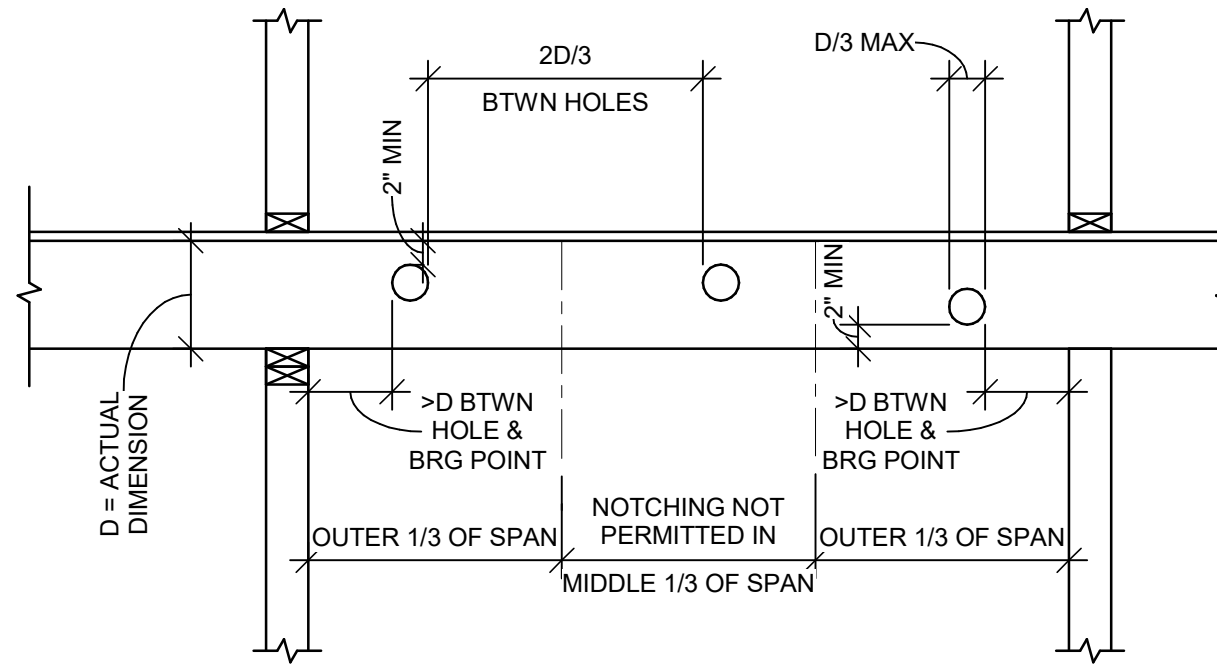


- NOTES:
1. CONTACT ARCHITECT PRIOR TO CUTTING JOISTS TO VERIFY SIZE AND LOCATION.
2. DETAIL APPLIES TO 2x FRAMING ONLY. REFER TO ENGINEERED OR COMPOSITE LUMBER MANUFACTURER'S RECOMMENDATIONS AT PSL's, LVL's, LSL's & GLULAM's.


3 DETAIL
3/4" = 1'-0"

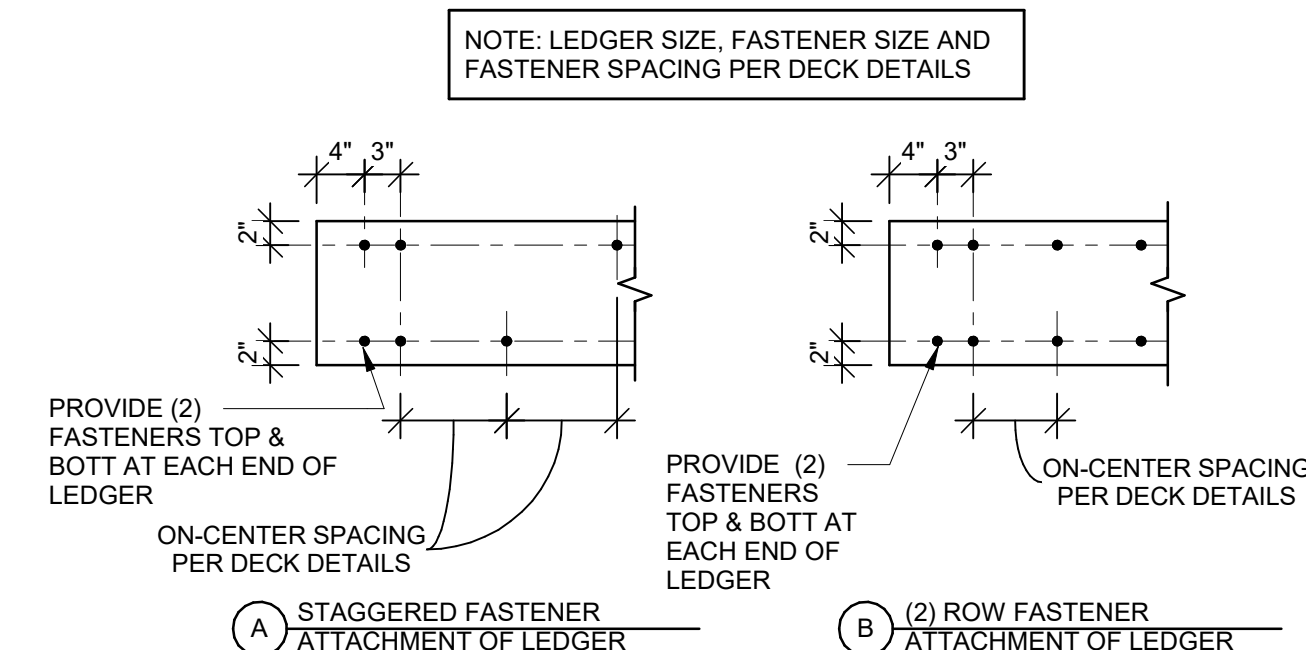


4 DETAIL
3/4" = 1'-0"

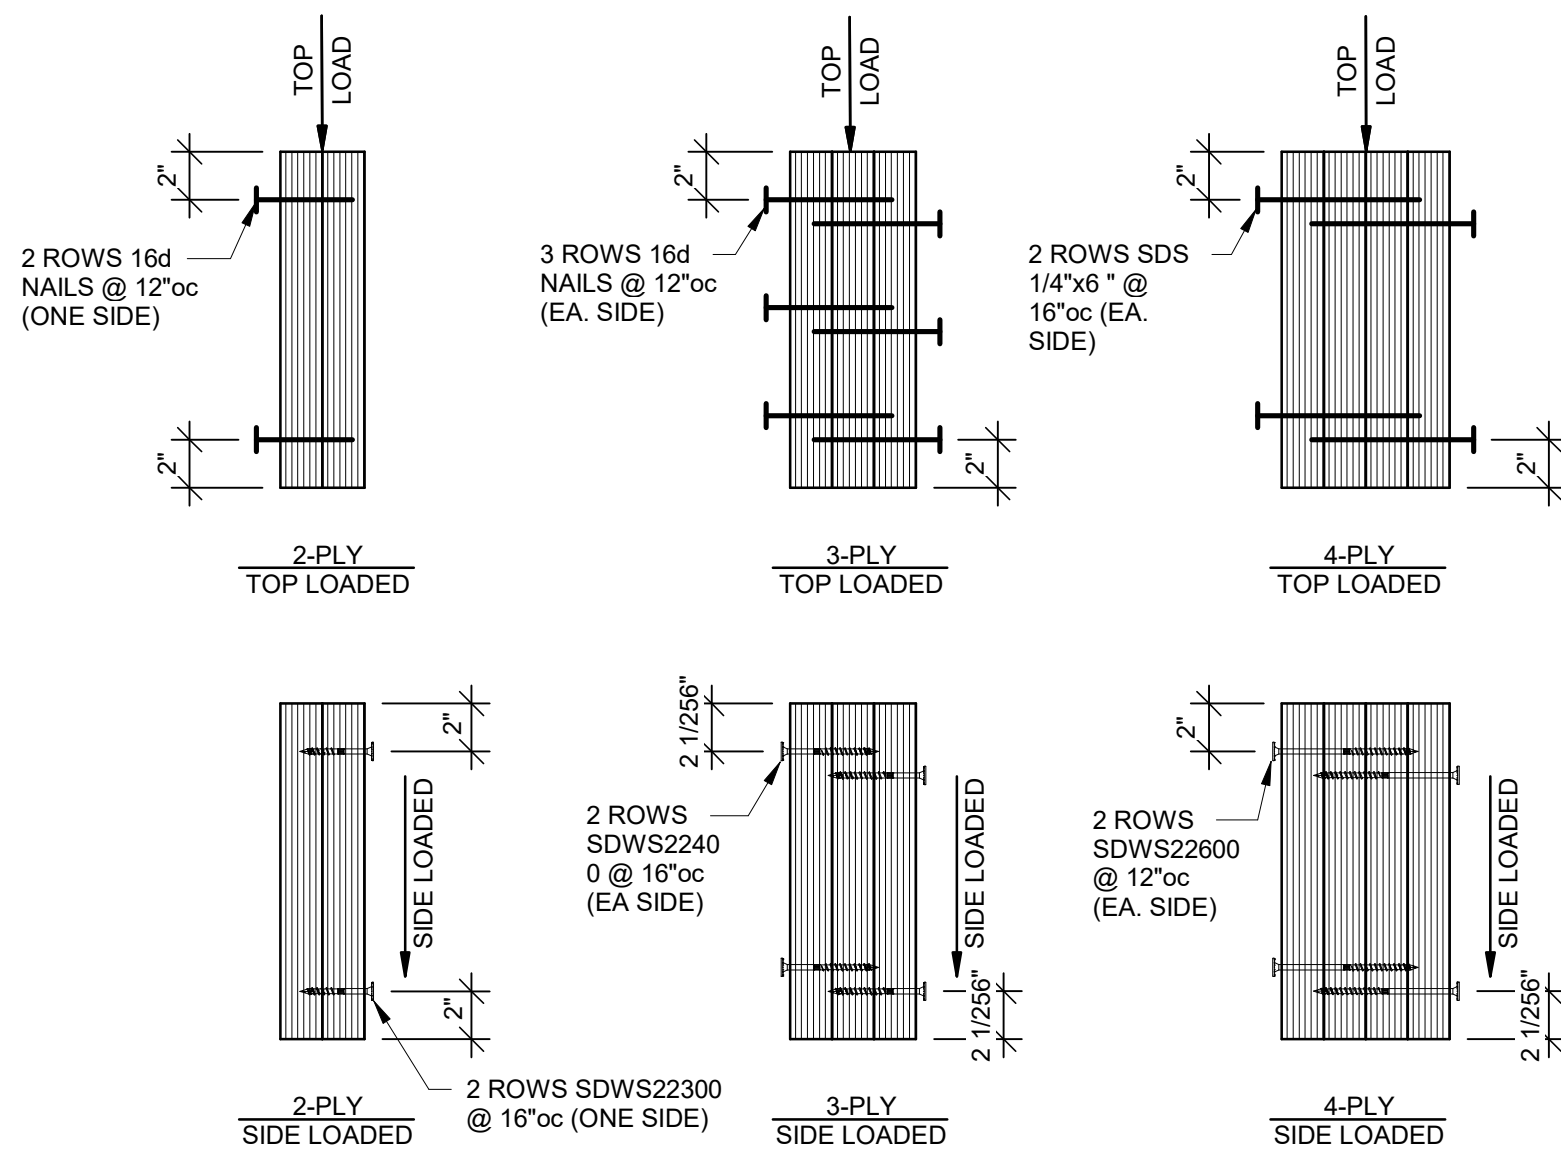


5 DETAIL
1 1/2" = 1'-0"

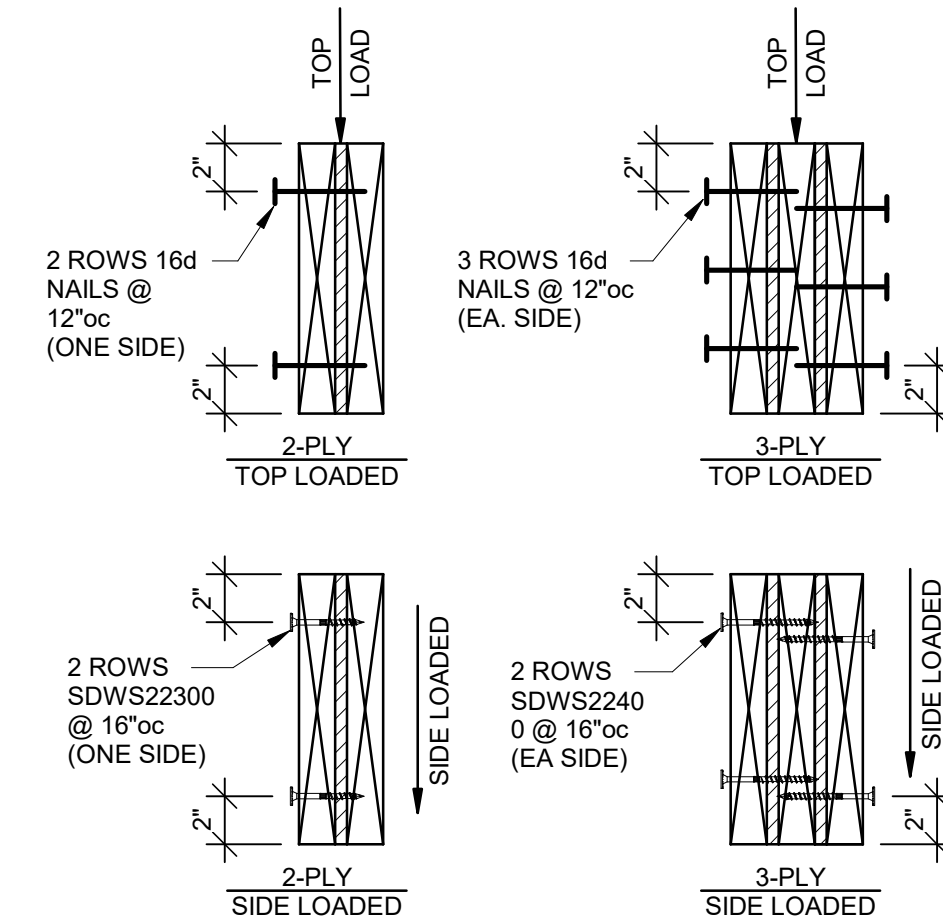


6 DETAIL
1 1/2" = 1'-0"

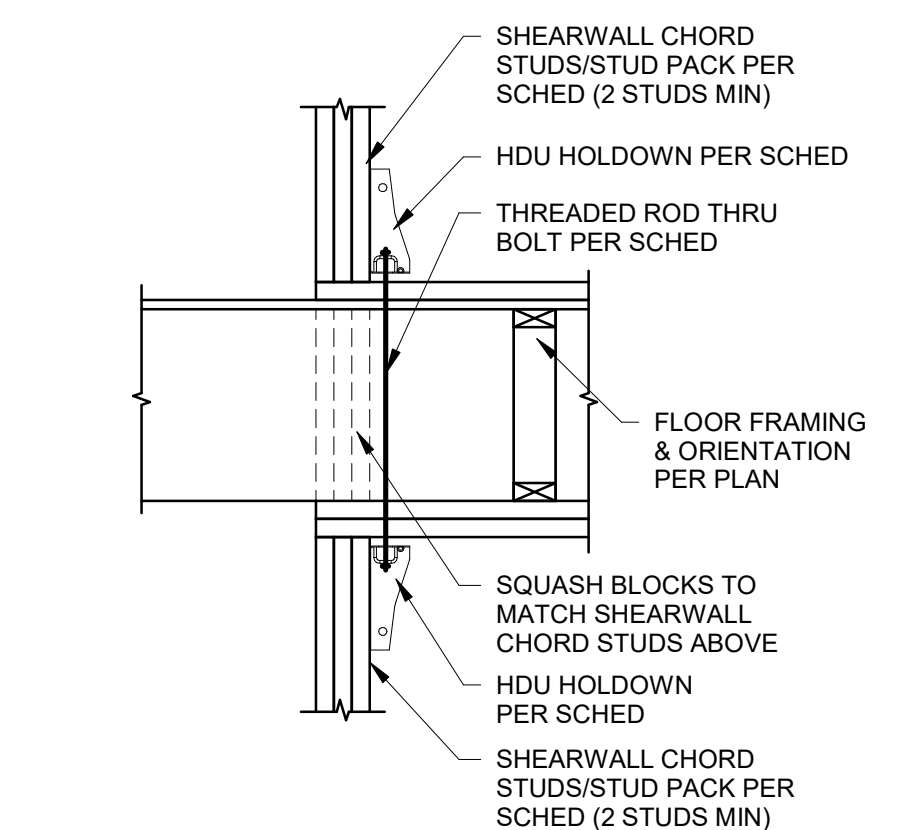


7 SECTION
3/4" = 1'-0"

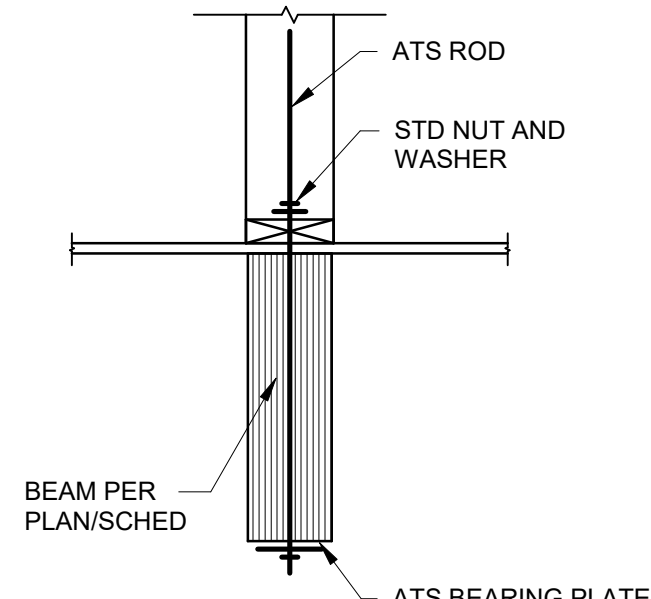


8 SECTION
1" = 1'-0"

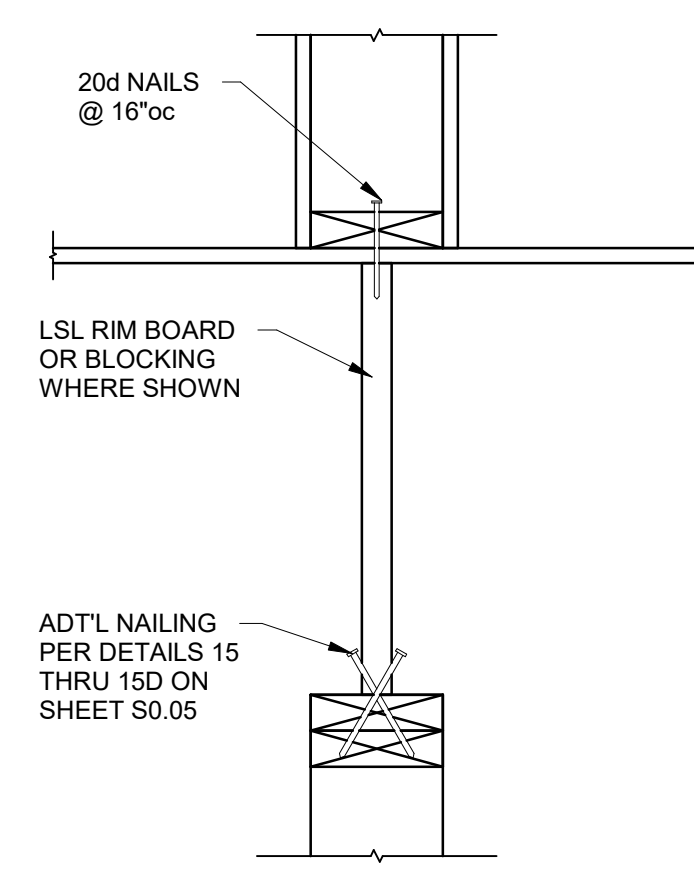

9 SECTION
1 1/2" = 1'-0"

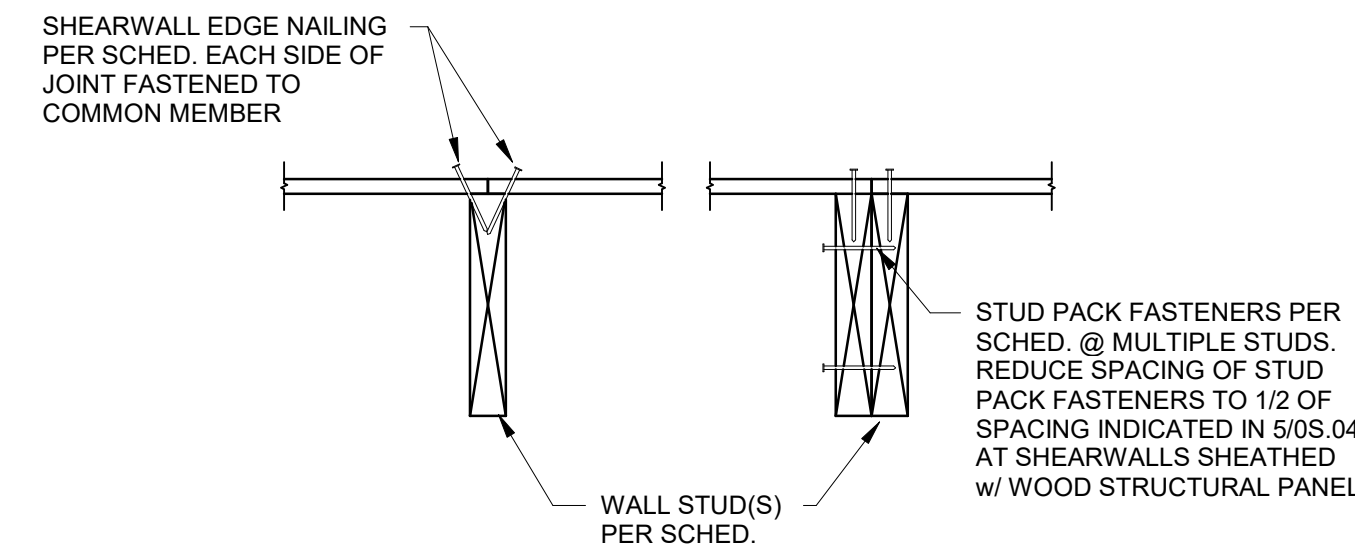


10 SECTION
1 1/2" = 1'-0"

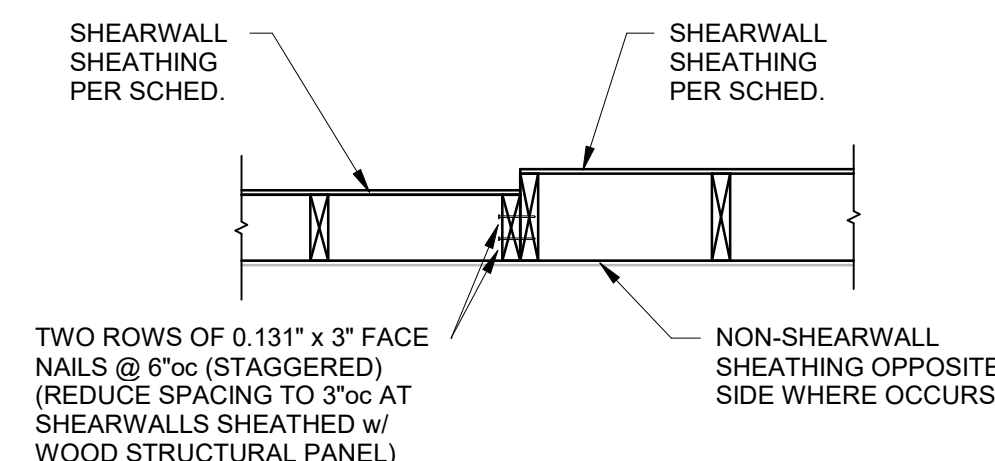


11 SECTION
1 1/2" = 1'-0"

12 SECTION
3/4" = 1'-0"

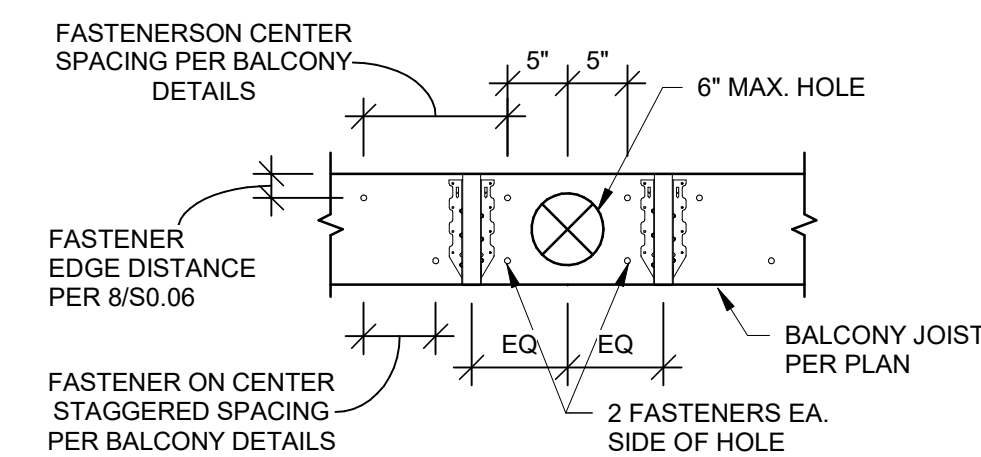

13 SECTION
3/4" = 1'-0"

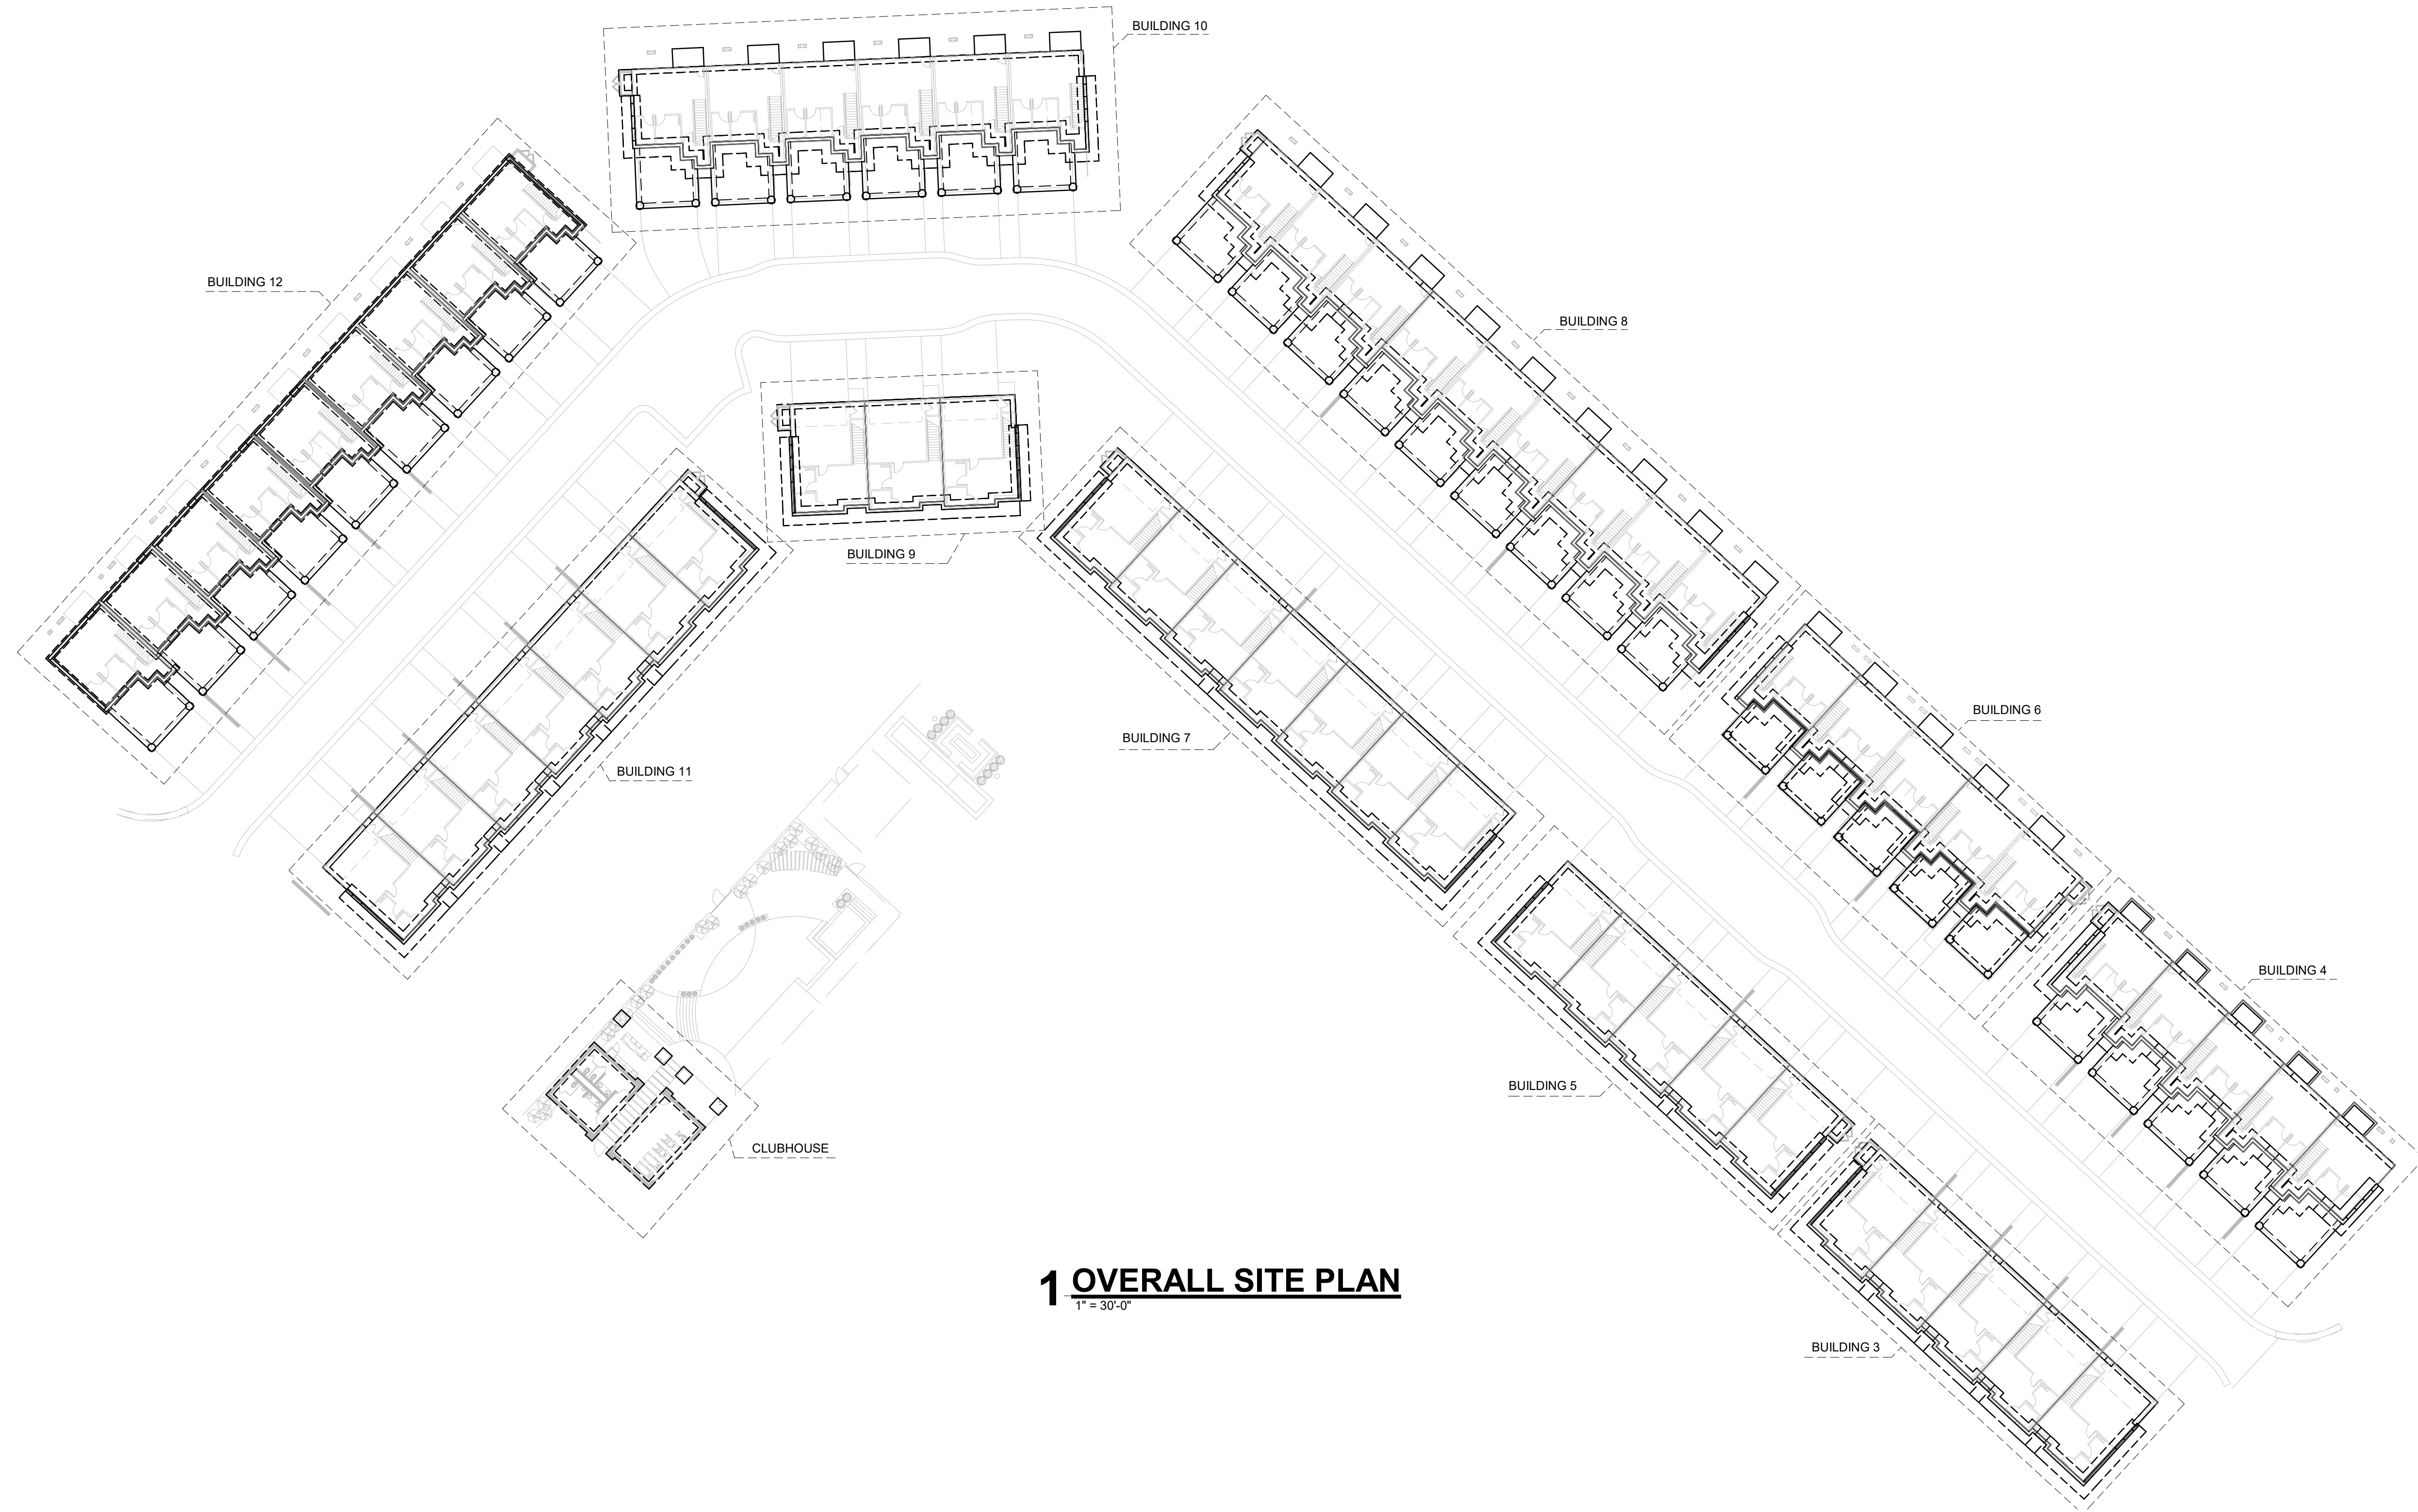

1 OVERALL SITE PLAN
1" = 30'-0"



REVISION:	
DATE:	8/12/2025
JOB:	25-3090
SHEET NO.:	

S1.0


COPYRIGHTED

LENEXA CITY CENTER _ NORTH VILLAGE TOWNHOMES
NEW TOWNHOMES COMPLEX
LENEXA, KANSAS

JGR JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386
jgr@jgarchitects.com
1881 Main Street, Suite 301
Kansas City, MO 64108




REVISION:	
DATE:	8/12/2025
JOB:	25-3090
SHEET NO.:	

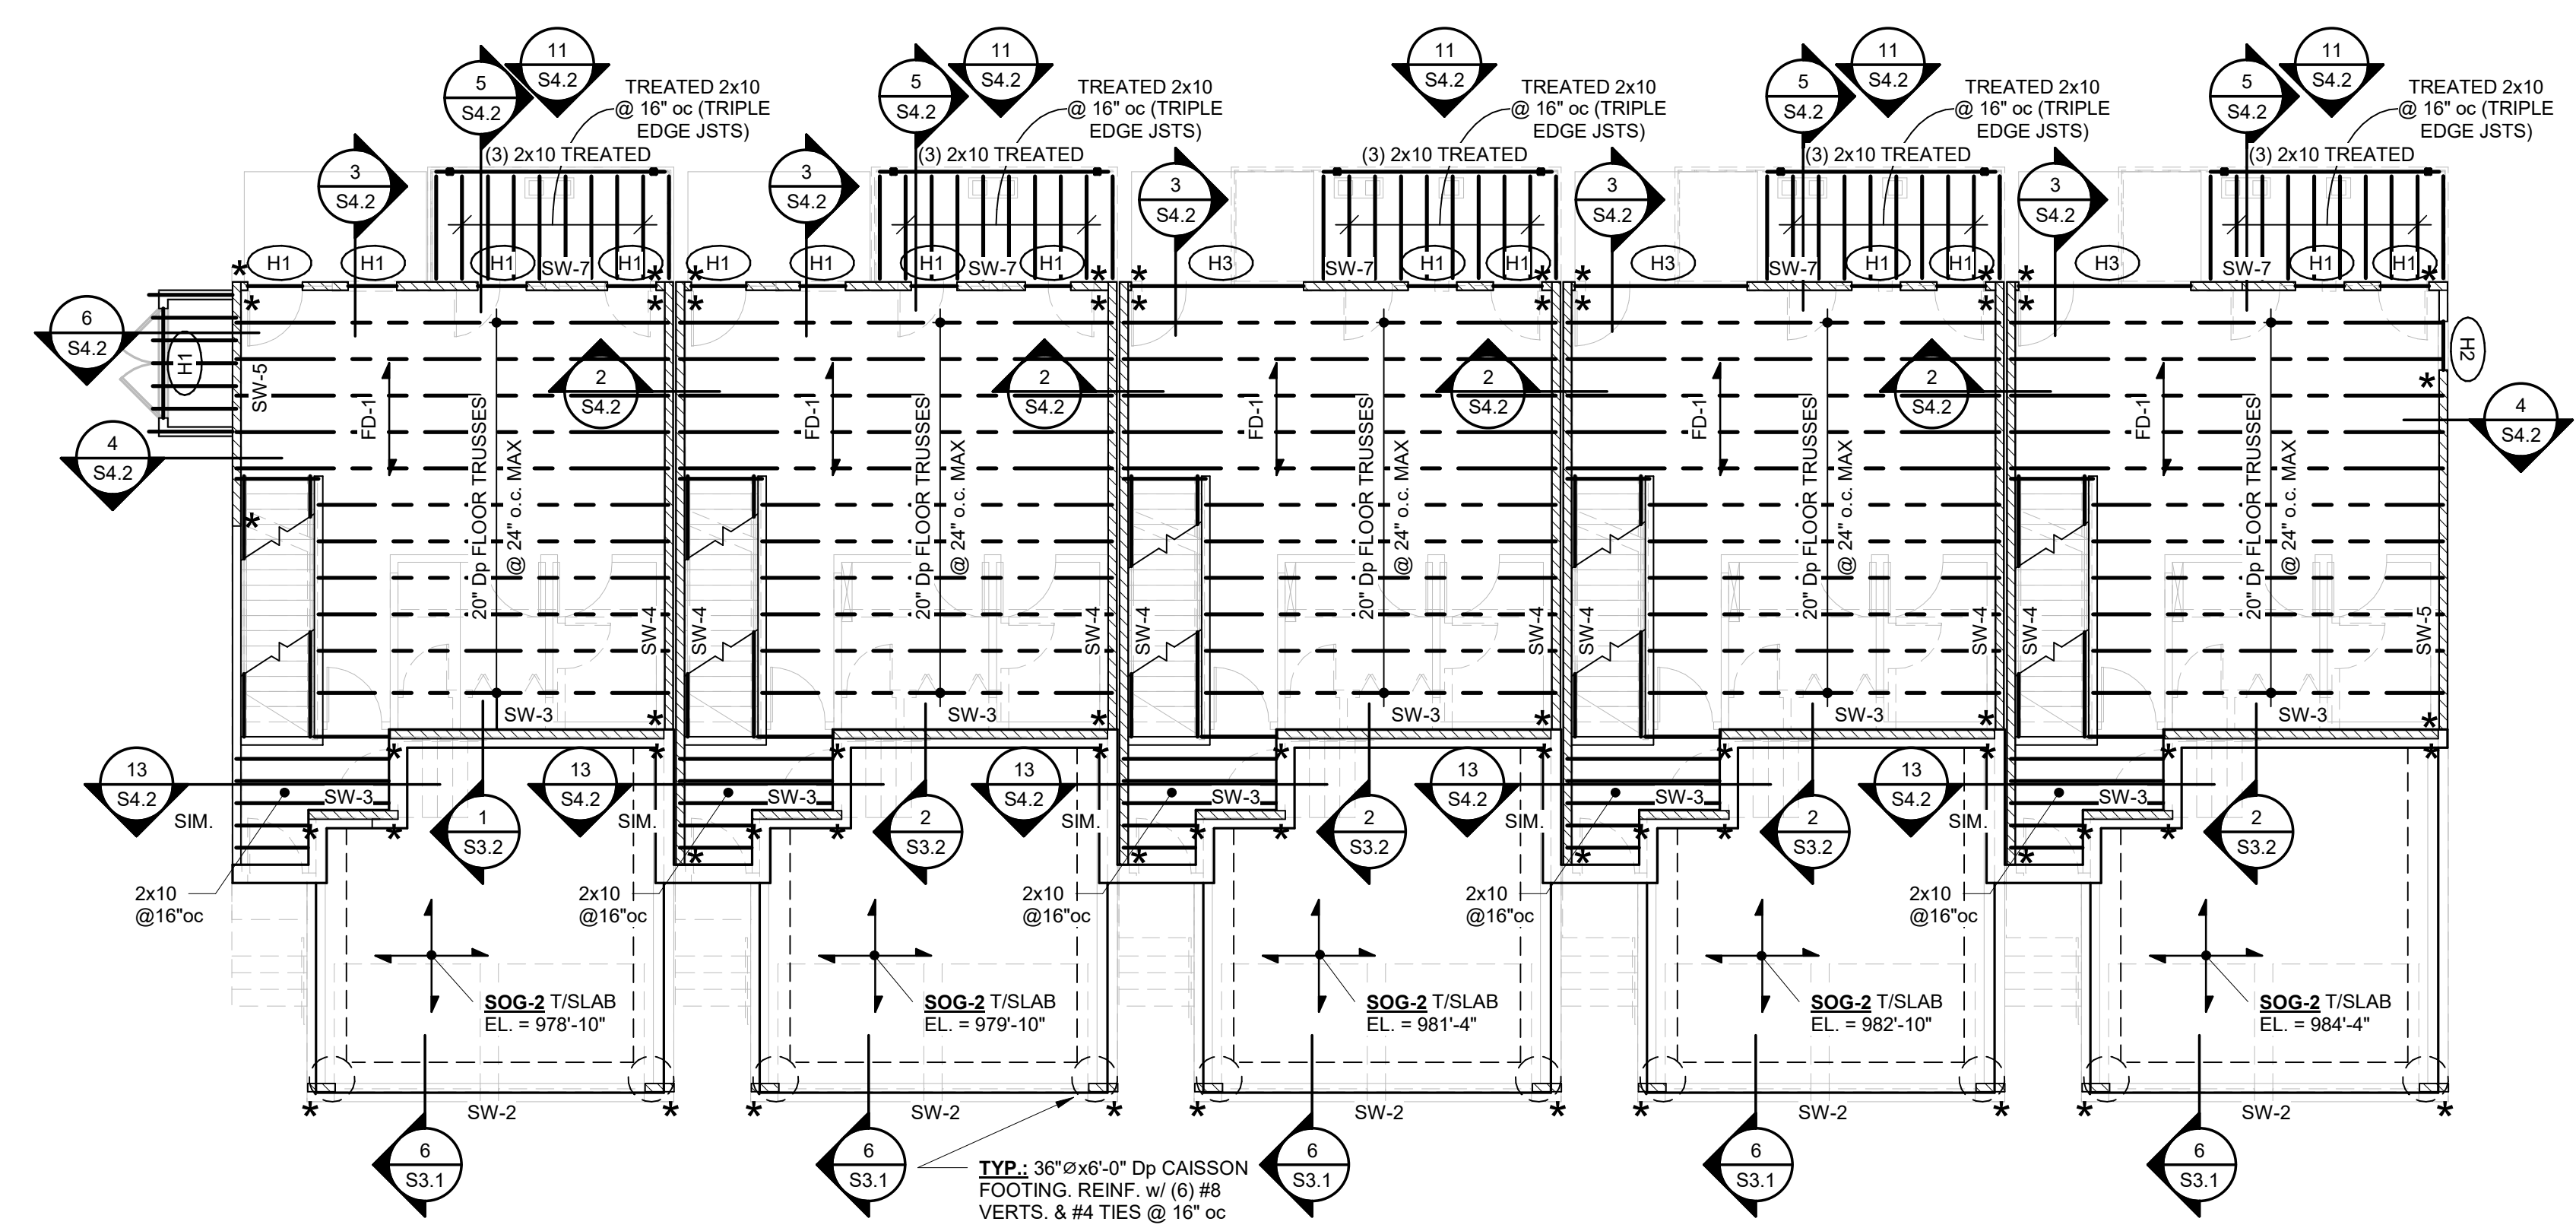


2 BUILDING 4 - LEVEL 2 FRAMING PLAN

- 1/8" = 1'-0"
- NOTES:
1. REFER TO STRUCTURAL GENERAL NOTES ON SHEET S0.1
 2. VERIFY ALL DIMENSIONS AND ELEVATIONS WITH ARCHITECTURAL DRAWINGS.
 3. ** DENOTES HOLD-DOWN LOCATION; RE: SHEAR WALL SCHEDULE.

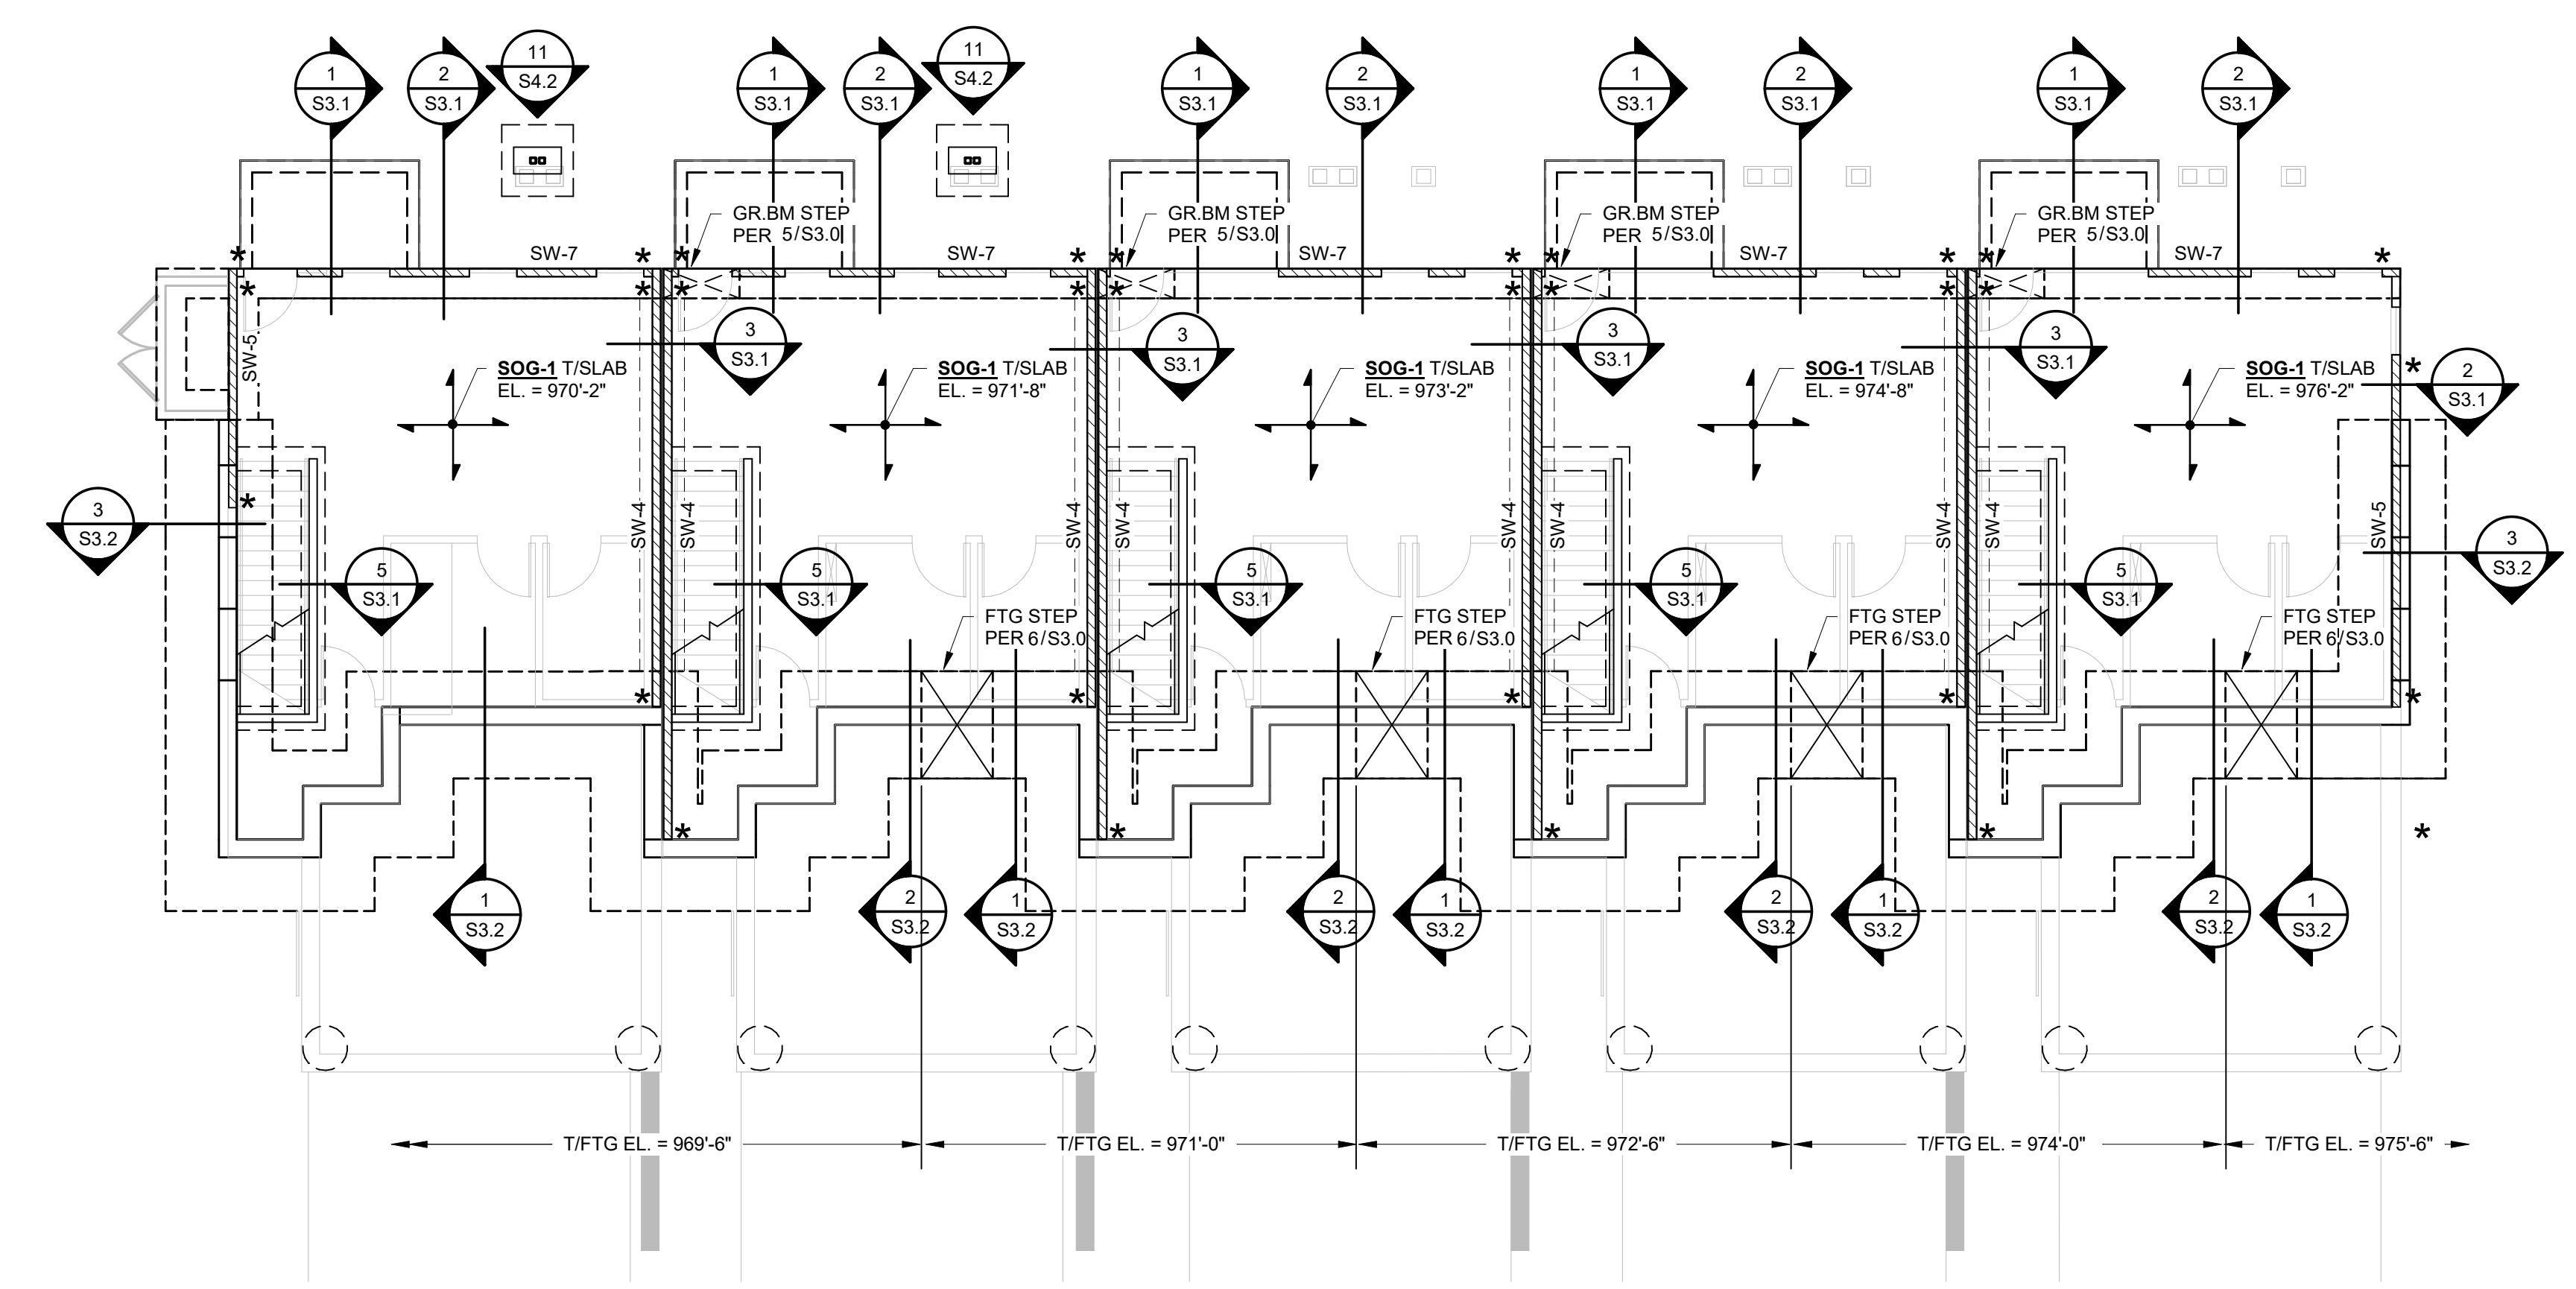


1 BUILDING 4 - FOUNDATION PLAN

- 1/8" = 1'-0"
- NOTES:
1. REFER TO STRUCTURAL GENERAL NOTES ON SHEET S0.1
 2. VERIFY ALL DIMENSIONS AND ELEVATIONS WITH ARCHITECTURAL DRAWINGS.
 3. ** DENOTES HOLD-DOWN LOCATION; RE: SHEAR WALL SCHEDULE.

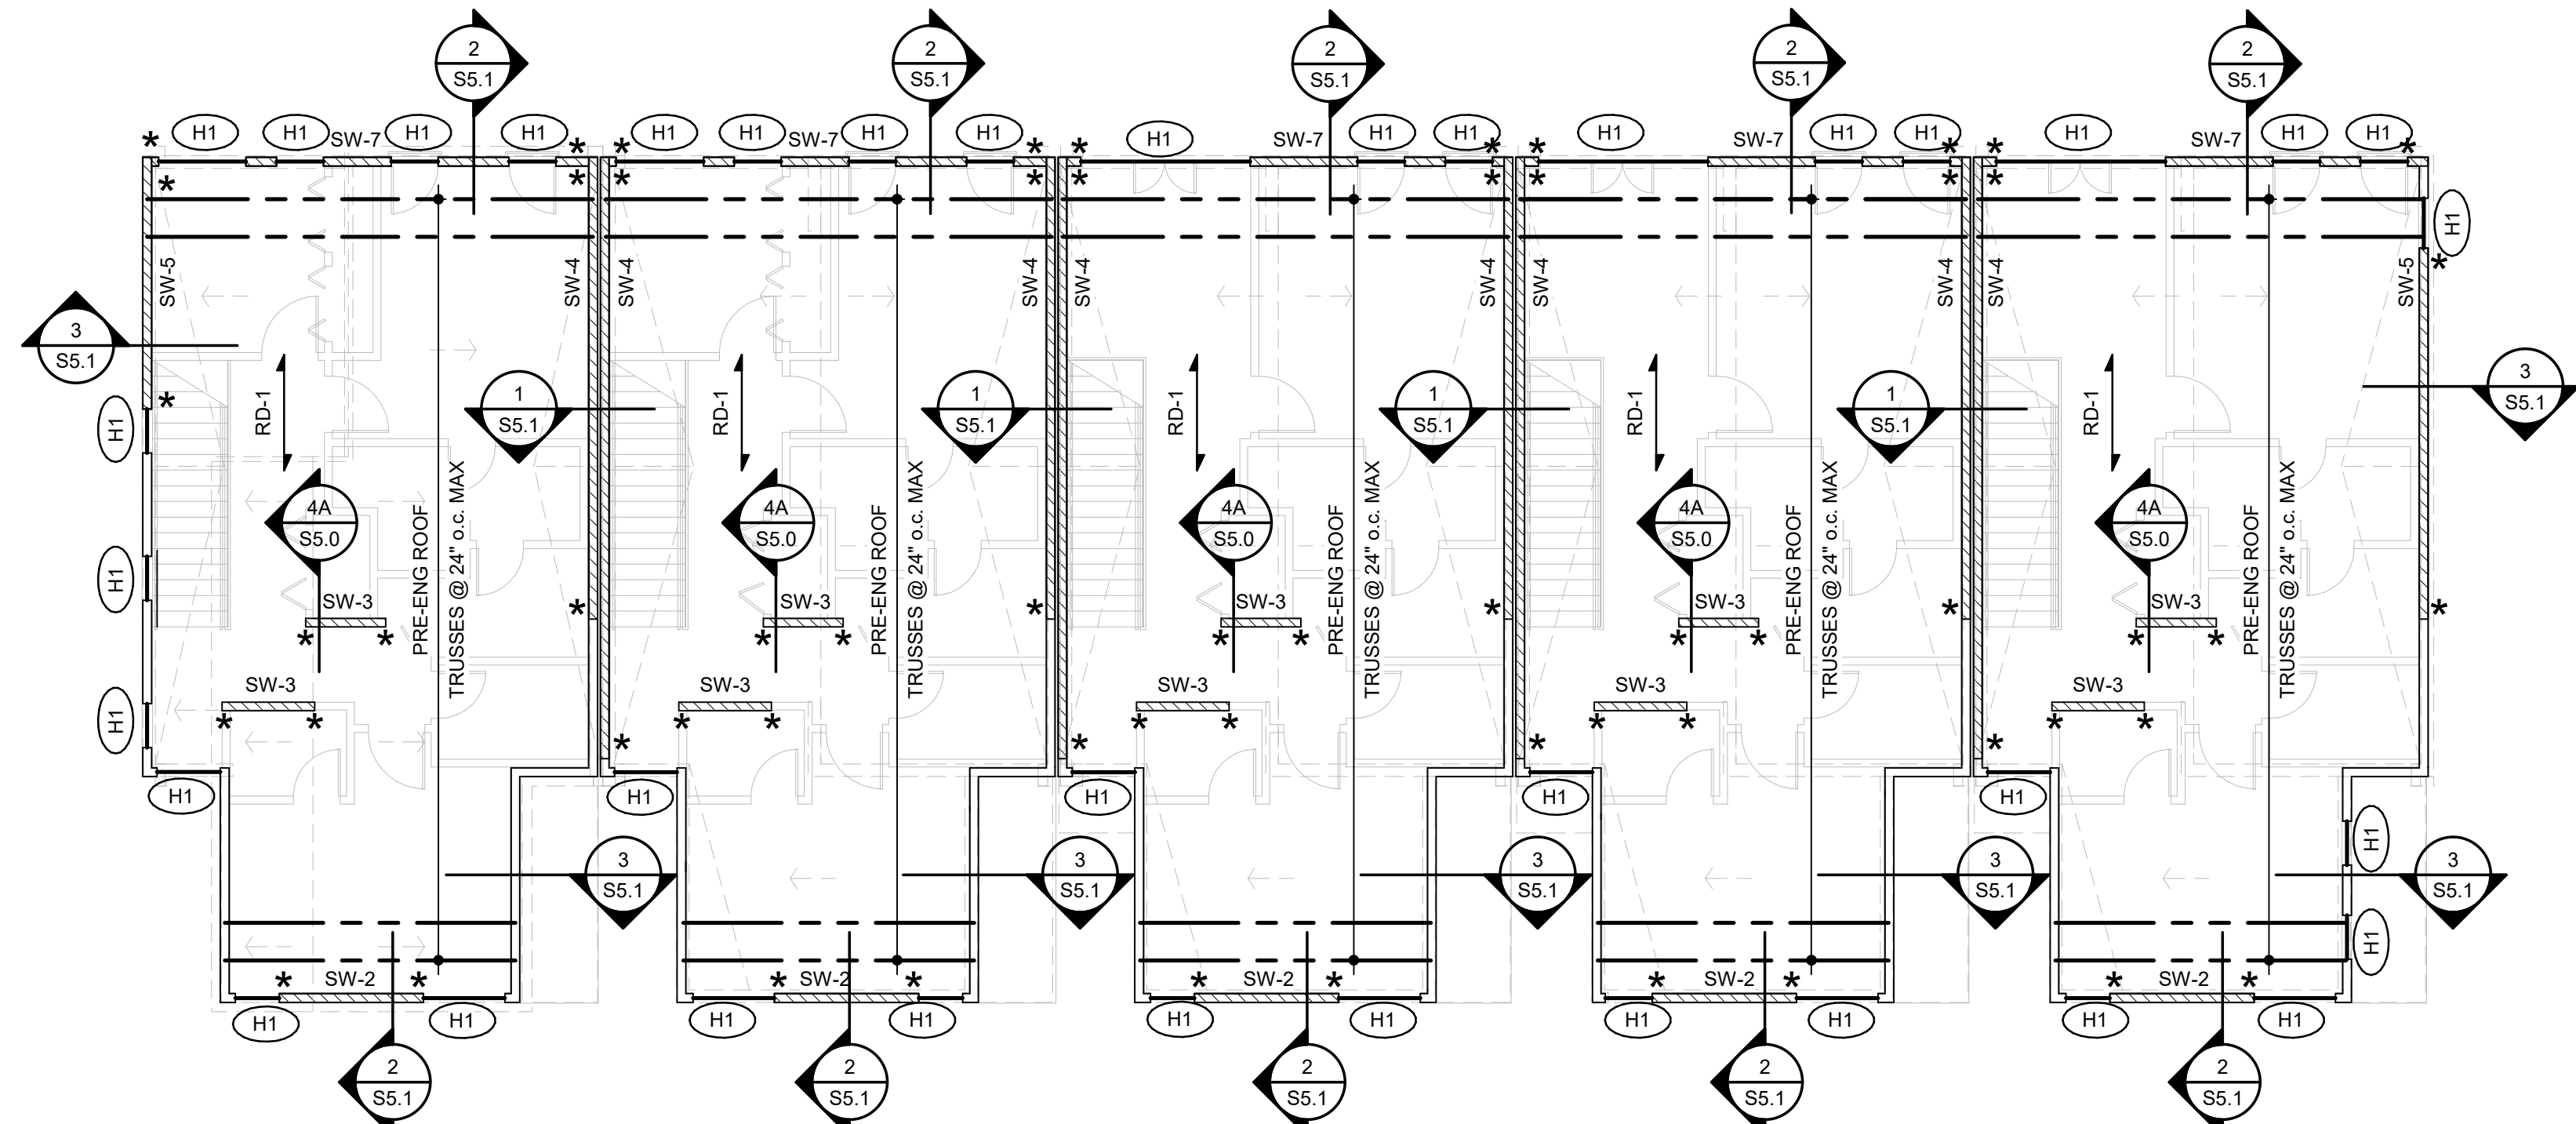

2 BUILDING 4 - ROOF FRAMING PLAN

- 1/8" = 1'-0"
- NOTES:**
1. REFER TO STRUCTURAL GENERAL NOTES ON SHEET S0.1
 2. VERIFY ALL DIMENSIONS AND ELEVATIONS WITH ARCHITECTURAL DRAWINGS.
 3. ** DENOTES HOLD-DOWN LOCATION; RE: SHEAR WALL SCHEDULE.

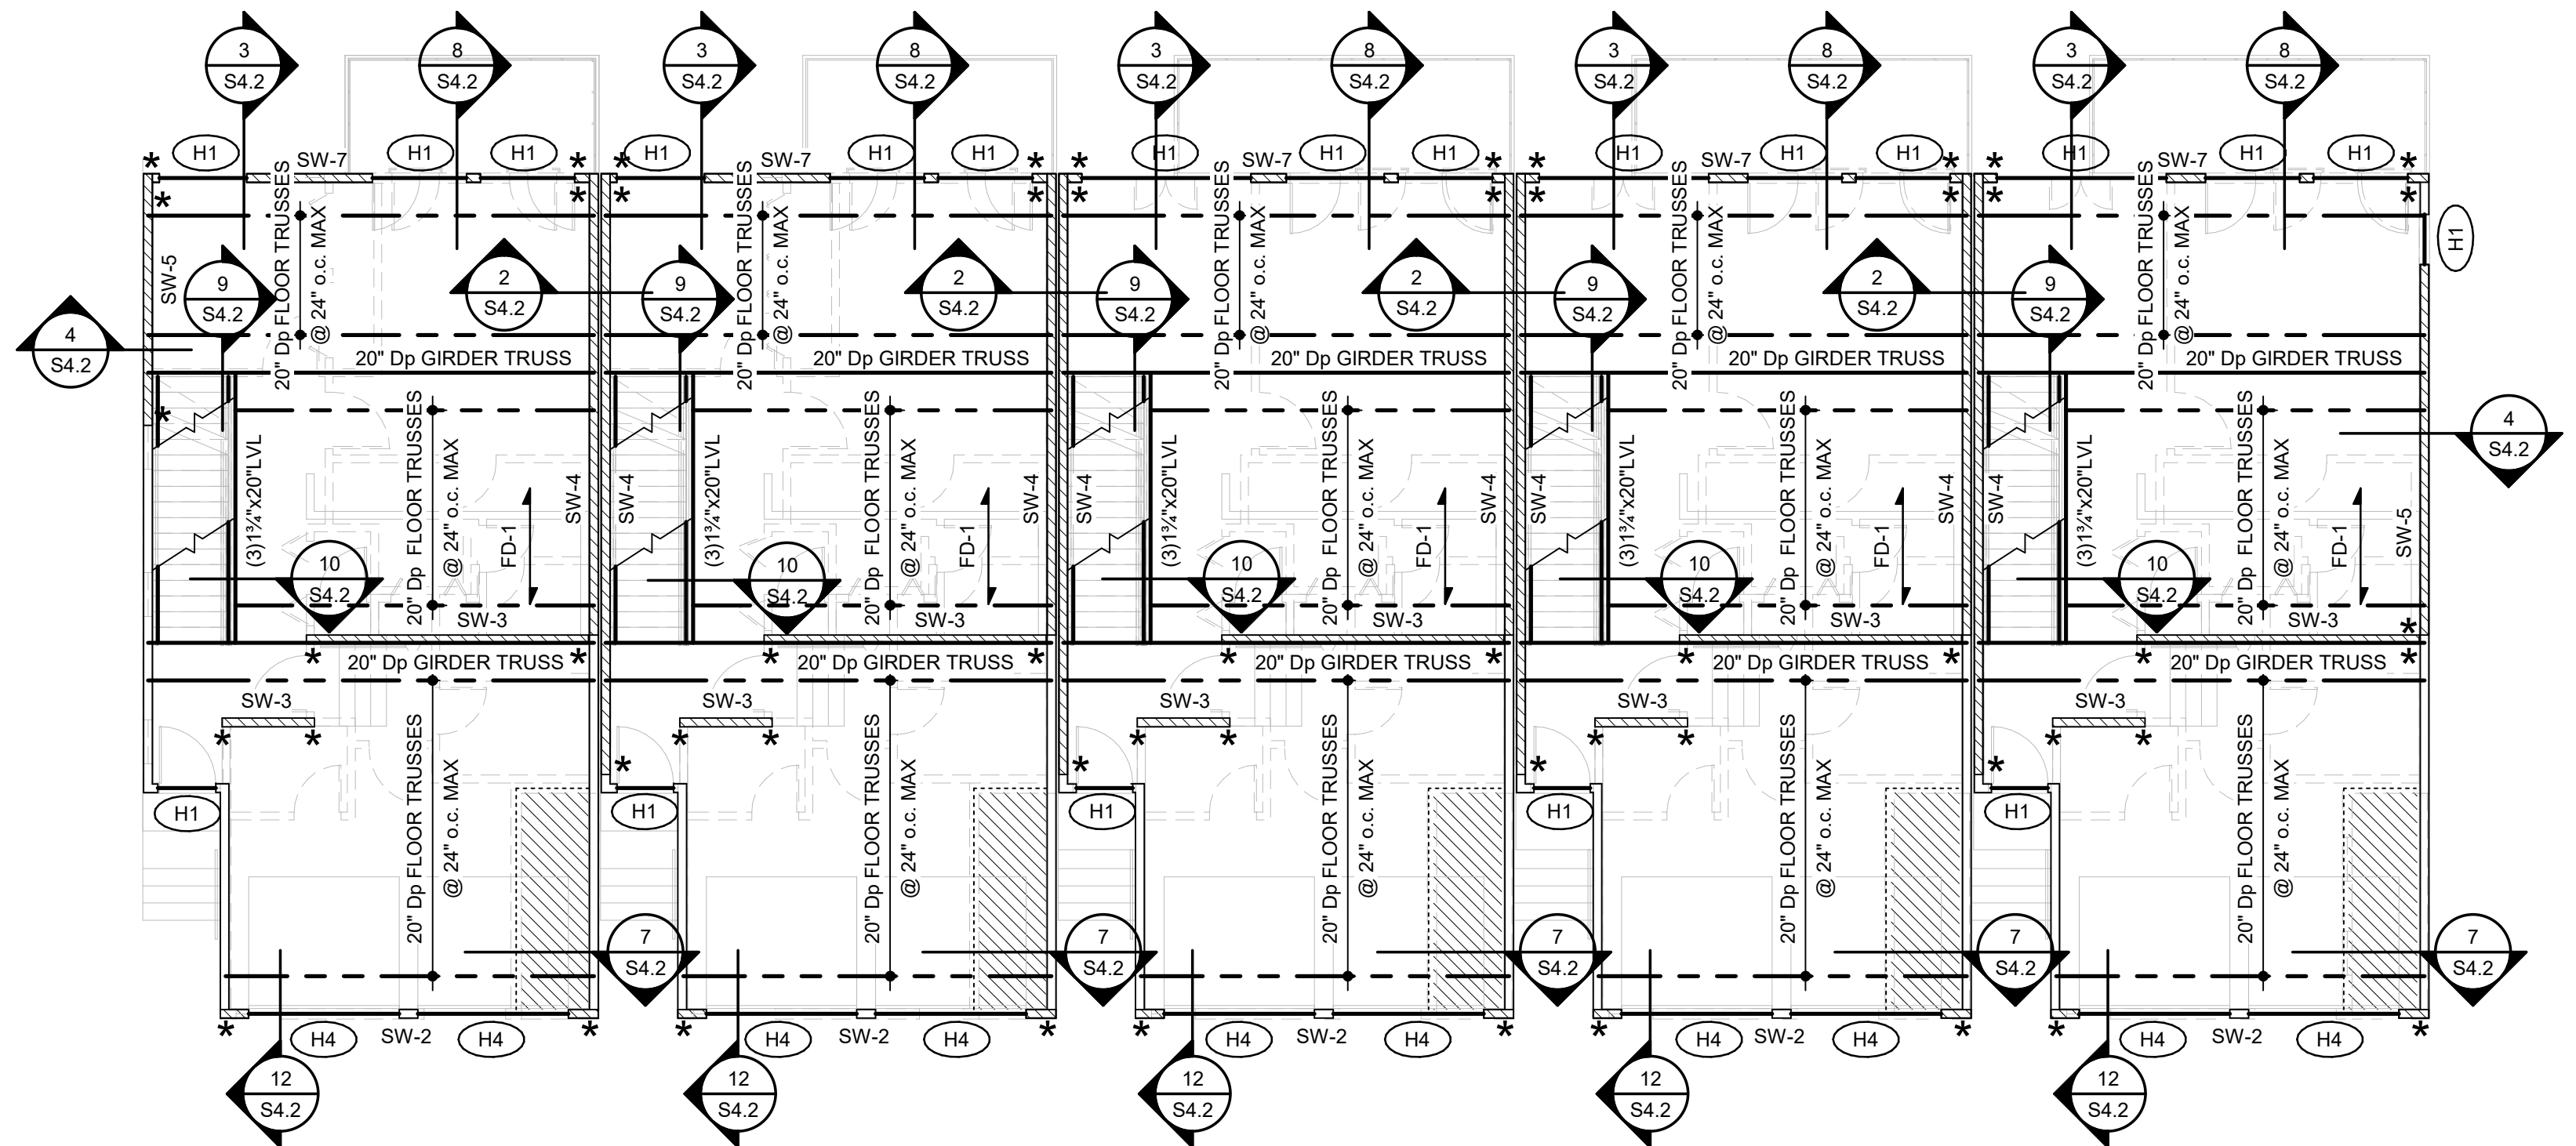


1 BUILDING 4 - LEVEL 3 FRAMING PLAN


- 1/8" = 1'-0"
- NOTES:**
1. REFER TO STRUCTURAL GENERAL NOTES ON SHEET S0.1
 2. VERIFY ALL DIMENSIONS AND ELEVATIONS WITH ARCHITECTURAL DRAWINGS.
 3. ** DENOTES HOLD-DOWN LOCATION; RE: SHEAR WALL SCHEDULE.




REVISION:	
DATE:	8/12/2025
JOB:	25-3090
SHEET NO.:	

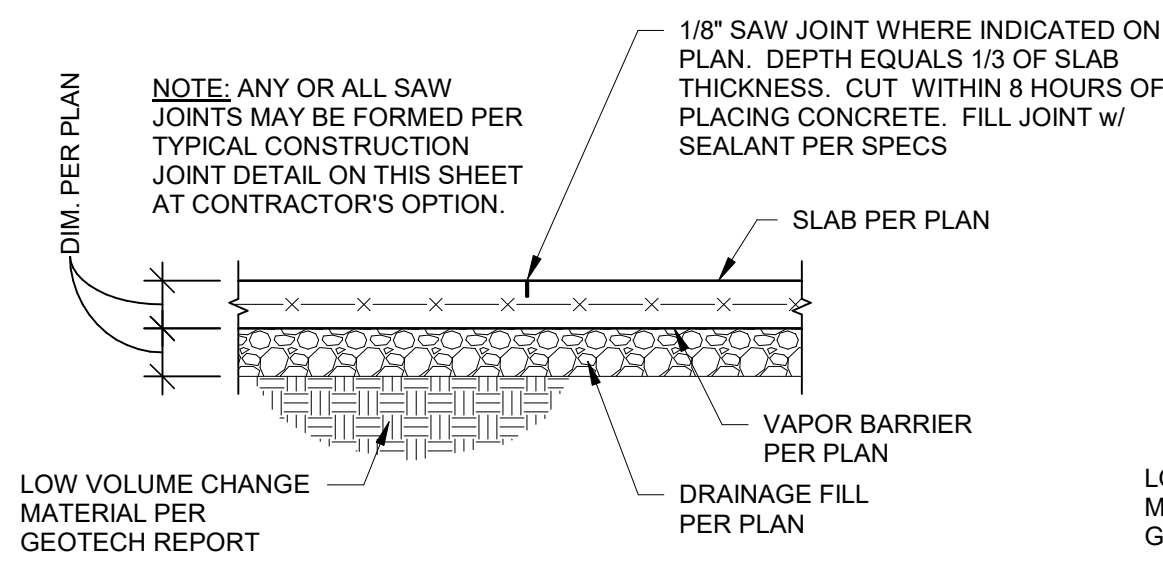


**TYPICAL SAW JOINT
NOTED "SJ" ON PLAN**
1 SECTION
3/4" = 1'-0"

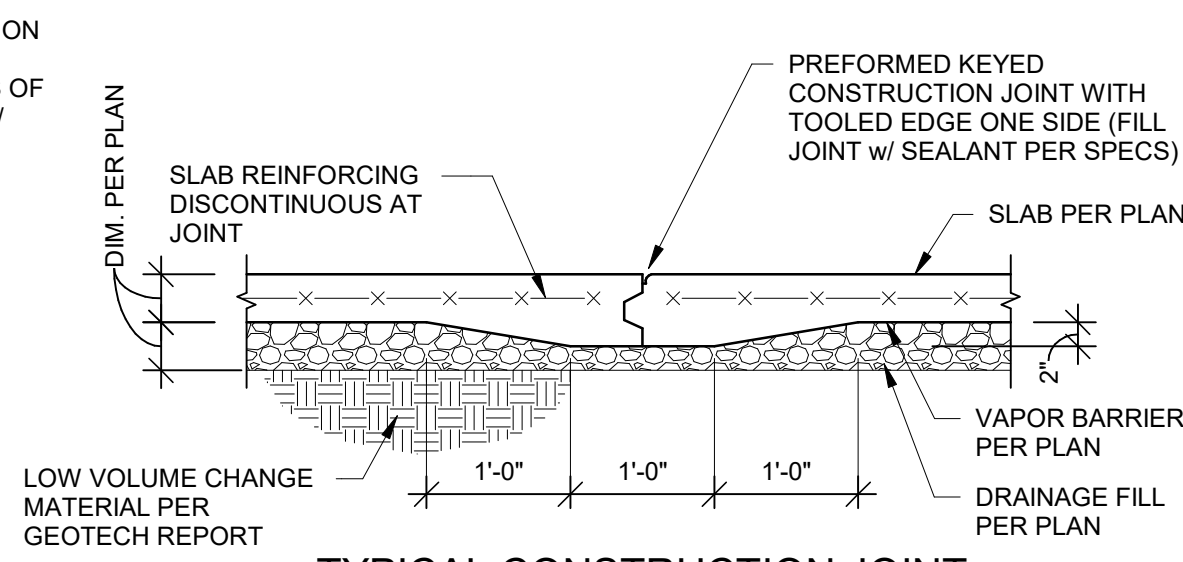


**TYPICAL CONSTRUCTION JOINT
NOTED "CJ" ON PLAN**
2 SECTION
3/4" = 1'-0"

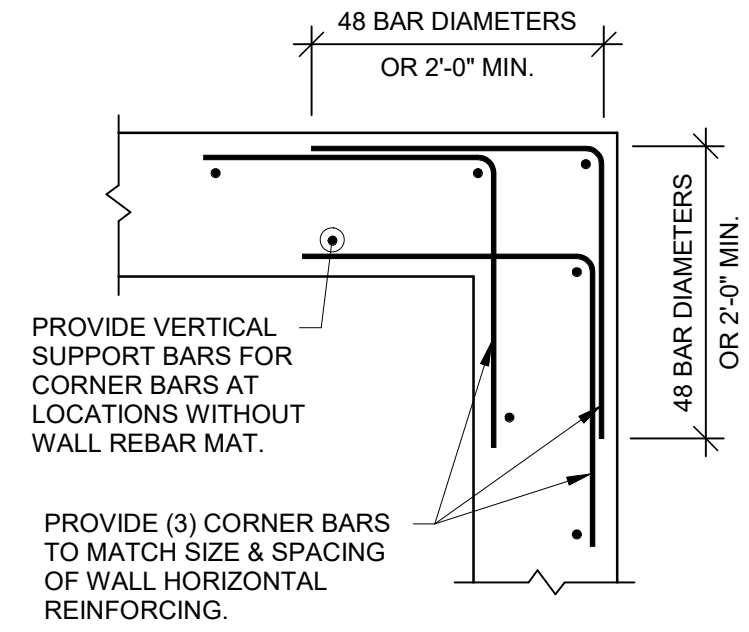


**TYPICAL CORNER BARS AT
CONCRETE WALLS & FOUNDATIONS**

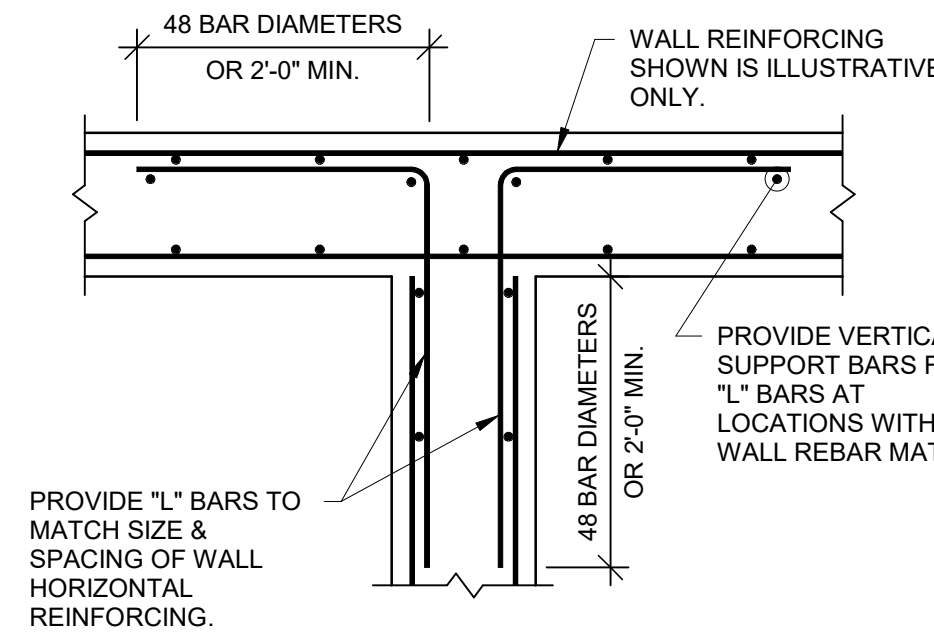

**TYPICAL T-INTERSECTION REINFORCING
AT CONCRETE WALLS & FOUNDATIONS**

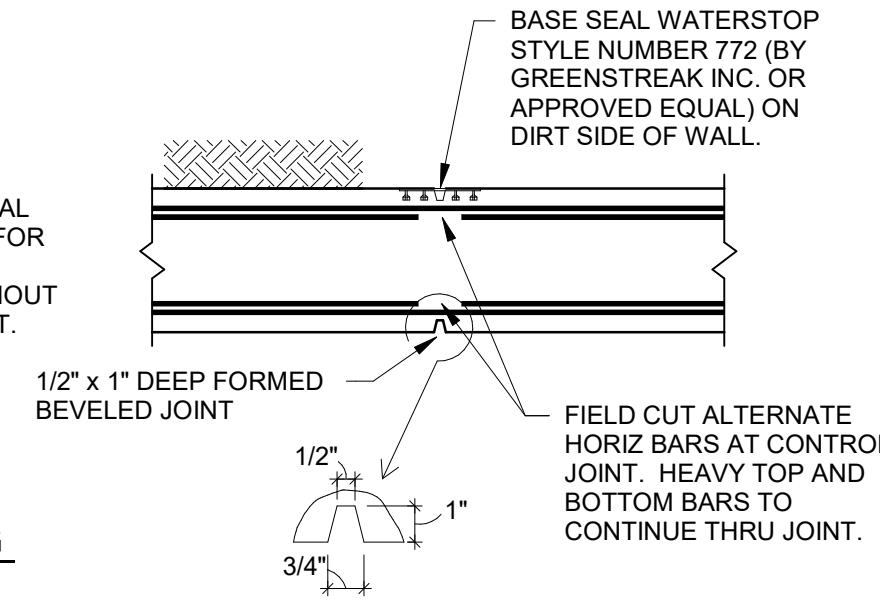


VERTICAL WALL CONTROL JOINT
MAXIMUM SPACING = 25'-0"
(COORDINATE LOCATIONS WITH ARCHITECT/ALIGN WITH MASONRY CONTROL/EXPANSION JOINTS ABOVE)

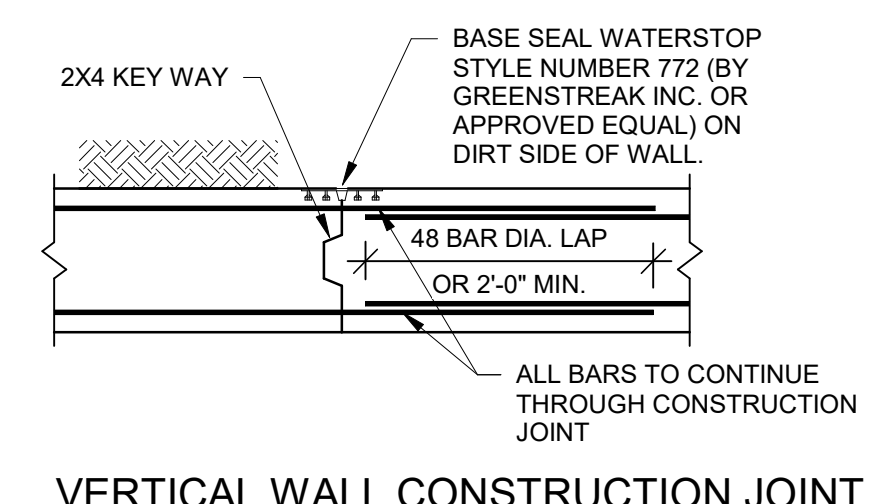


VERTICAL WALL CONSTRUCTION JOINT
MAXIMUM SPACING = 100'-0"

**TYPICAL INTERSECTING CONCRETE
3 WALL REINFORCING**
3/4" = 1'-0"

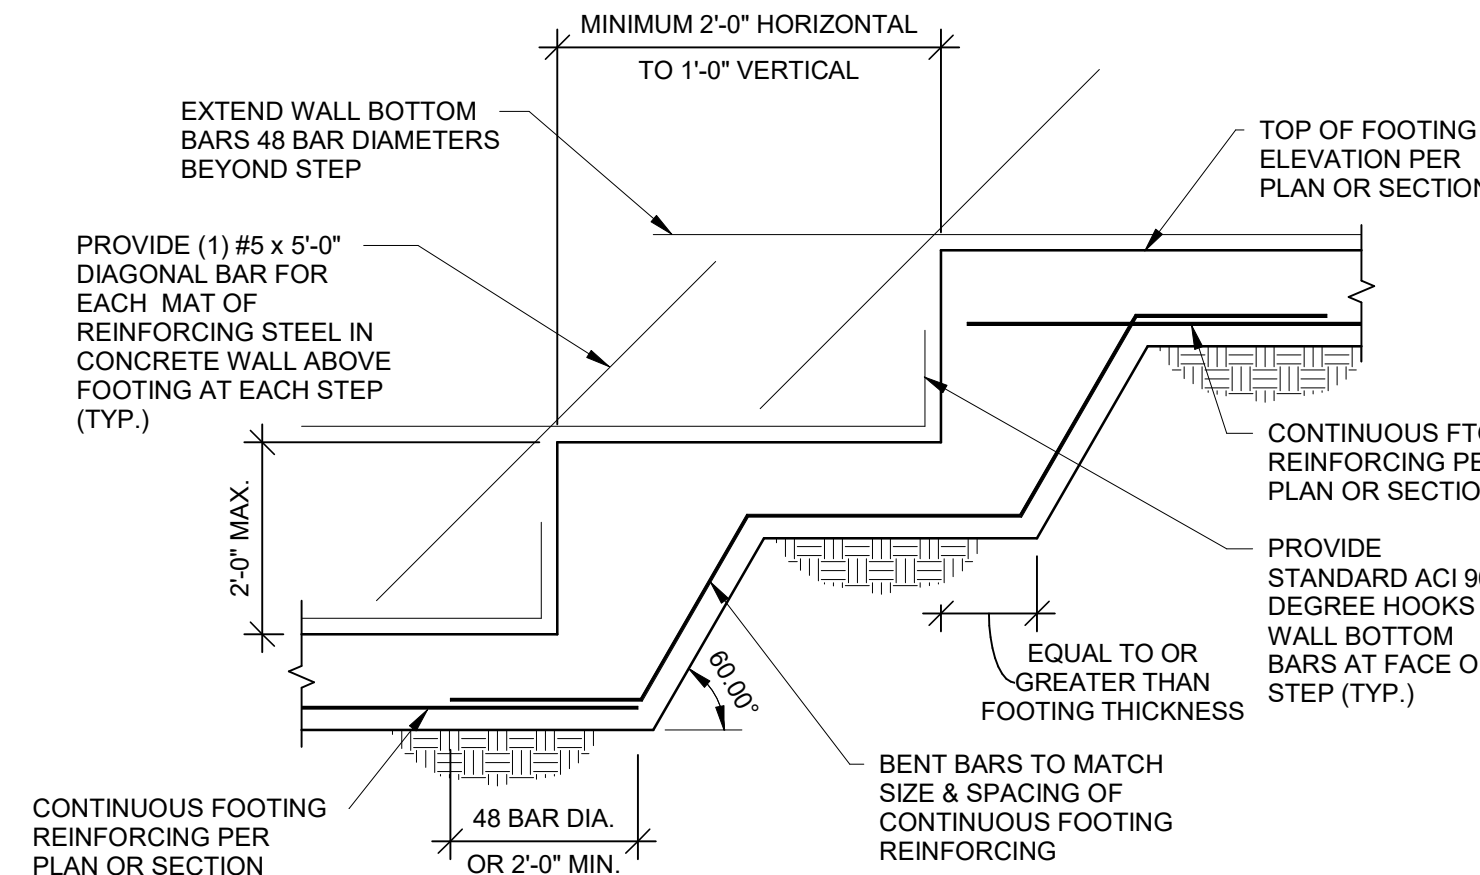


6 TYPICAL FOOTING STEP
1/2" = 1'-0"

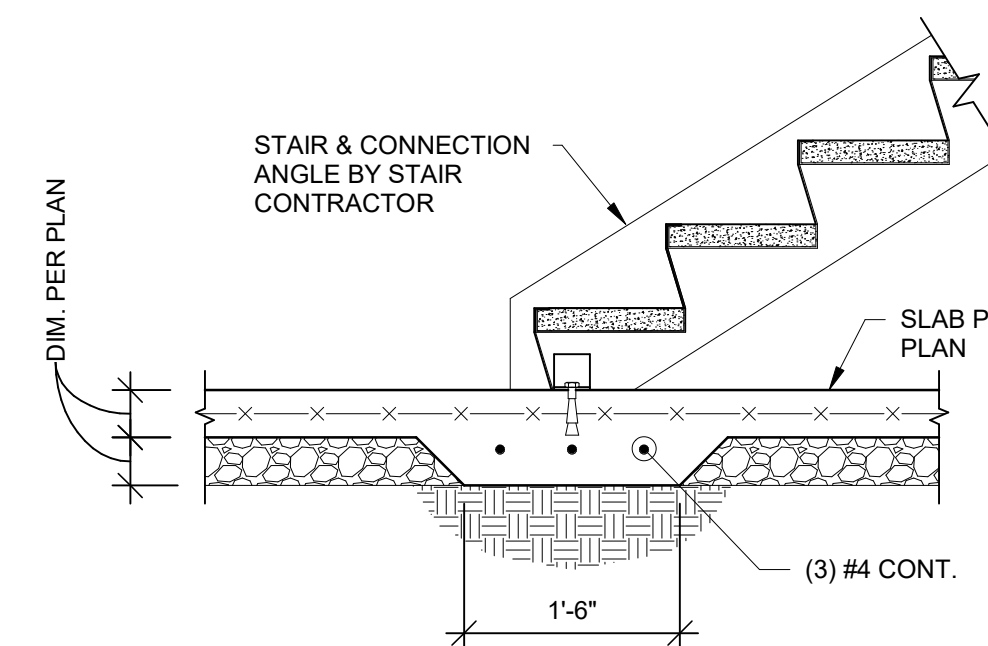


TYPICAL THICKENED SLAB AT BASE OF STAIR

7 SECTION
3/4" = 1'-0"

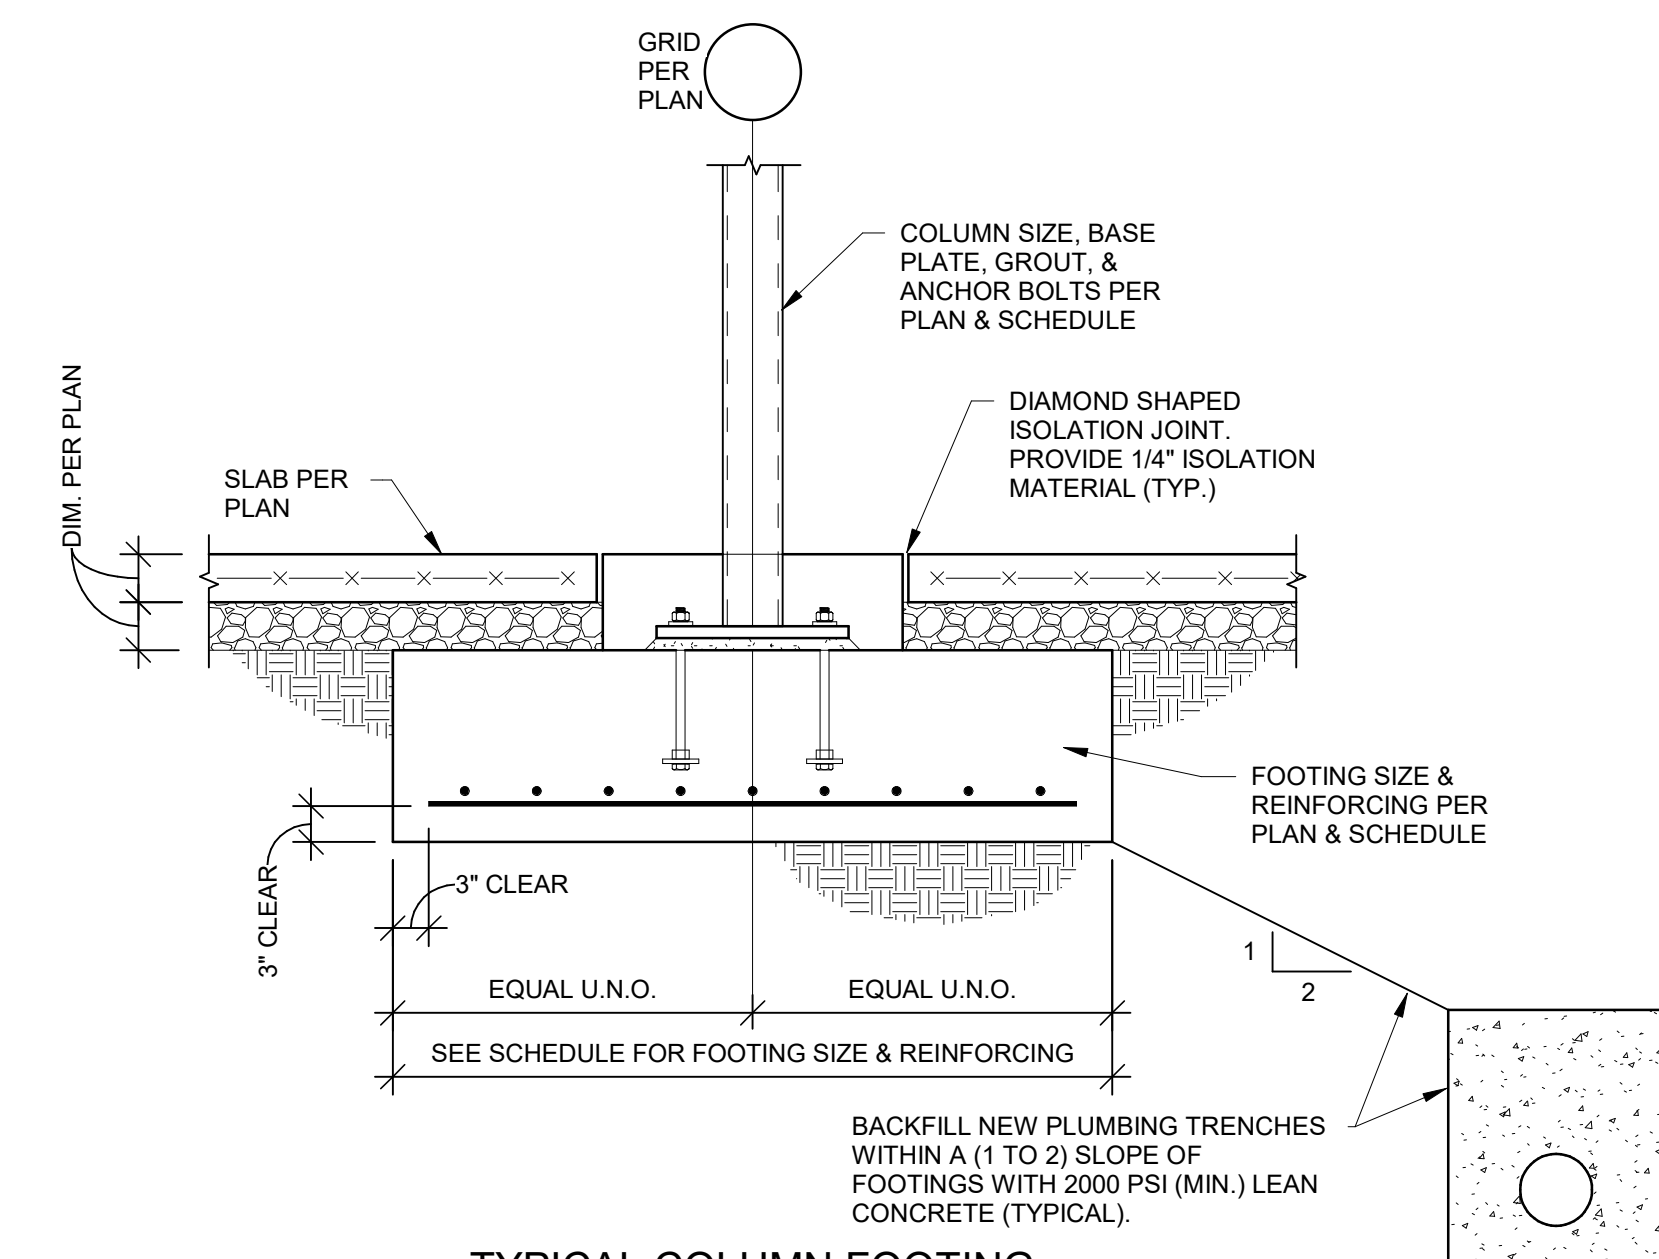


TYPICAL COLUMN FOOTING

9 SECTION
3/4" = 1'-0"

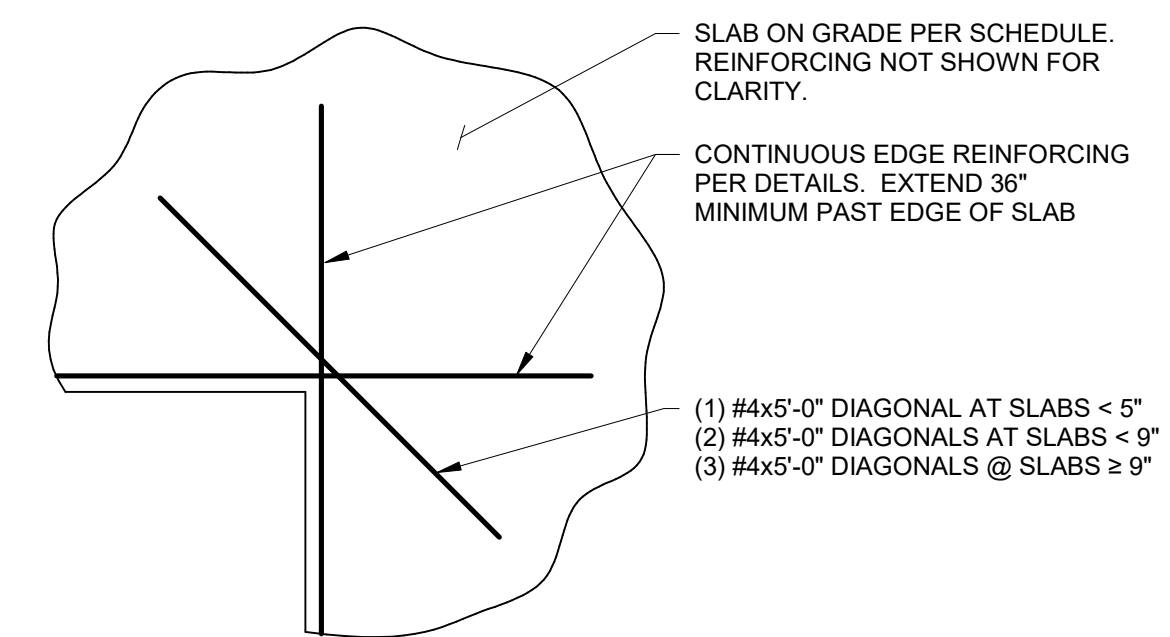


TYPICAL SLAB ON GRADE RE-ENTRANT CORNER BARS

18 DETAIL
1/2" = 1'-0"

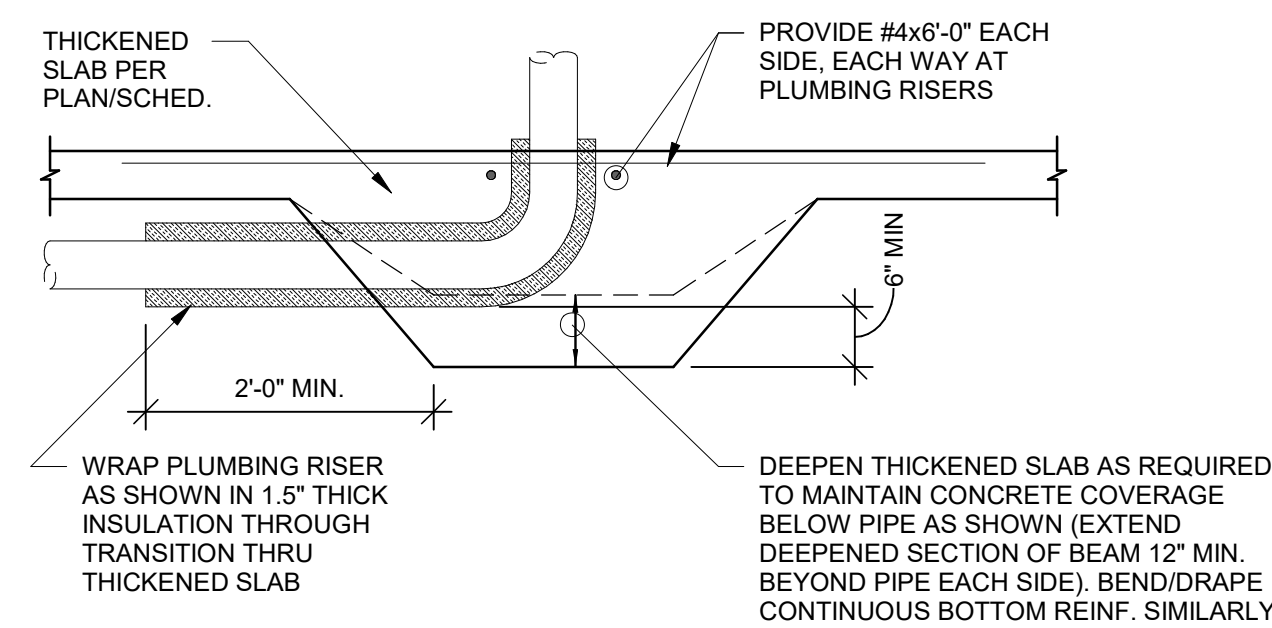


TYPICAL PLUMBING RISER THRU THICKENED SLAB

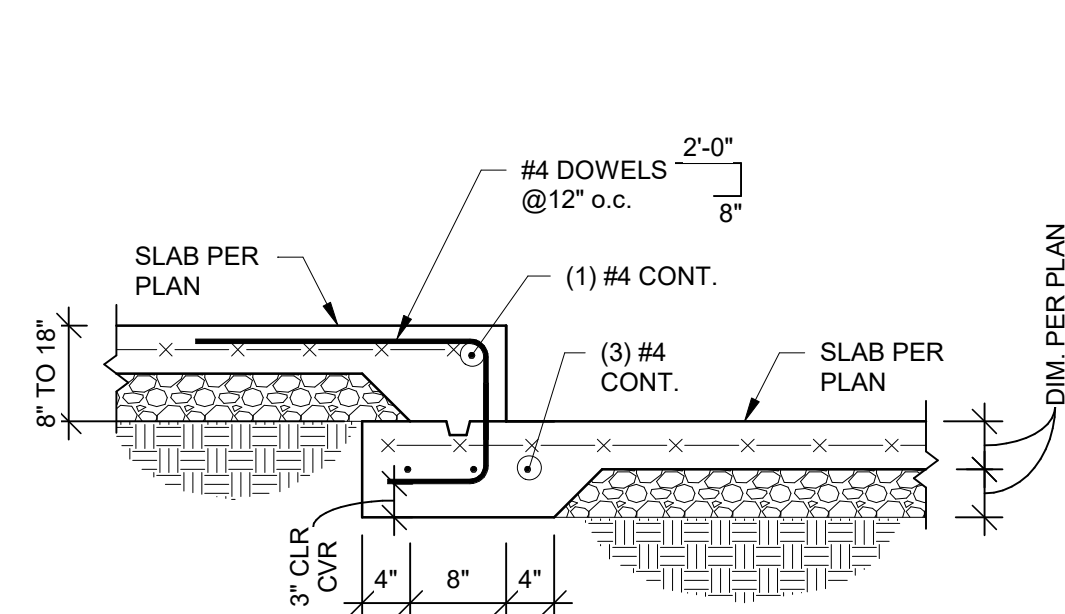


TYPICAL DEPRESSED SLAB

4A SECTION
3/4" = 1'-0"

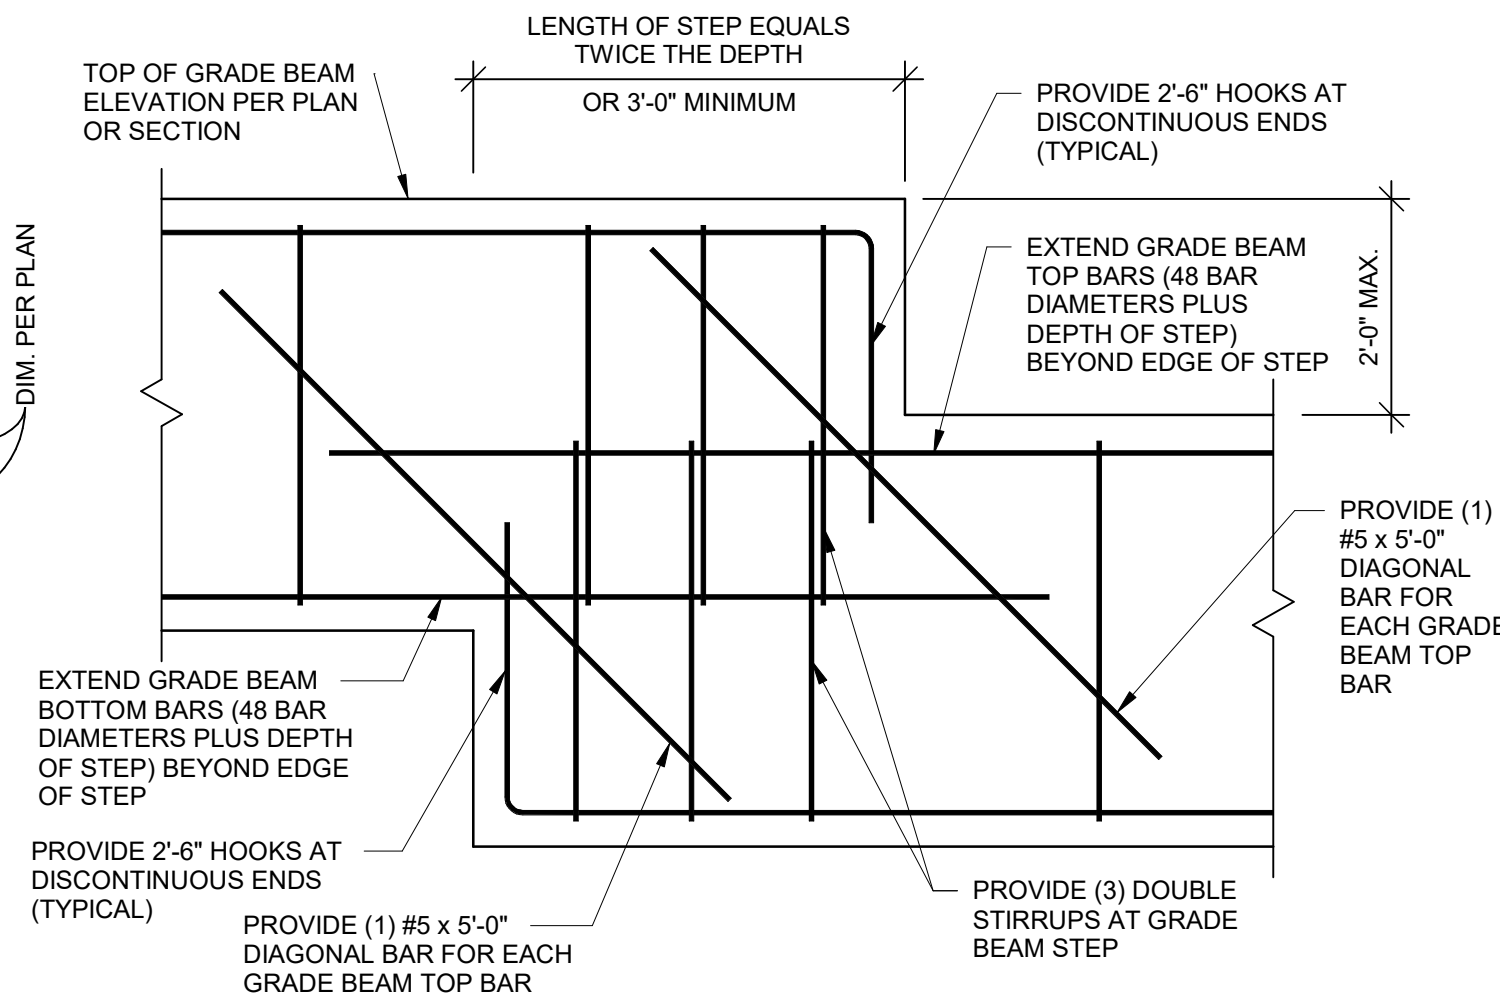


5 TYPICAL GRADE BEAM STEP
3/4" = 1'-0"

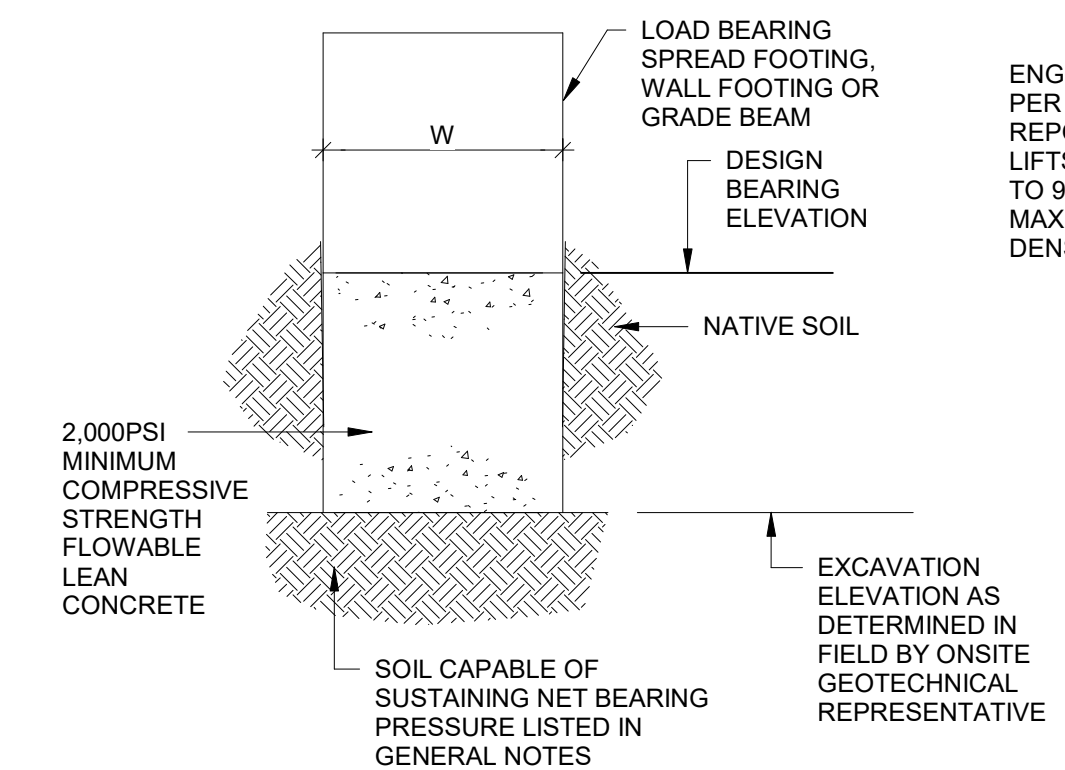


LEAN CONCRETE BACKFILL

8 OVEREXCAVATION DETAIL
3/4" = 1'-0"

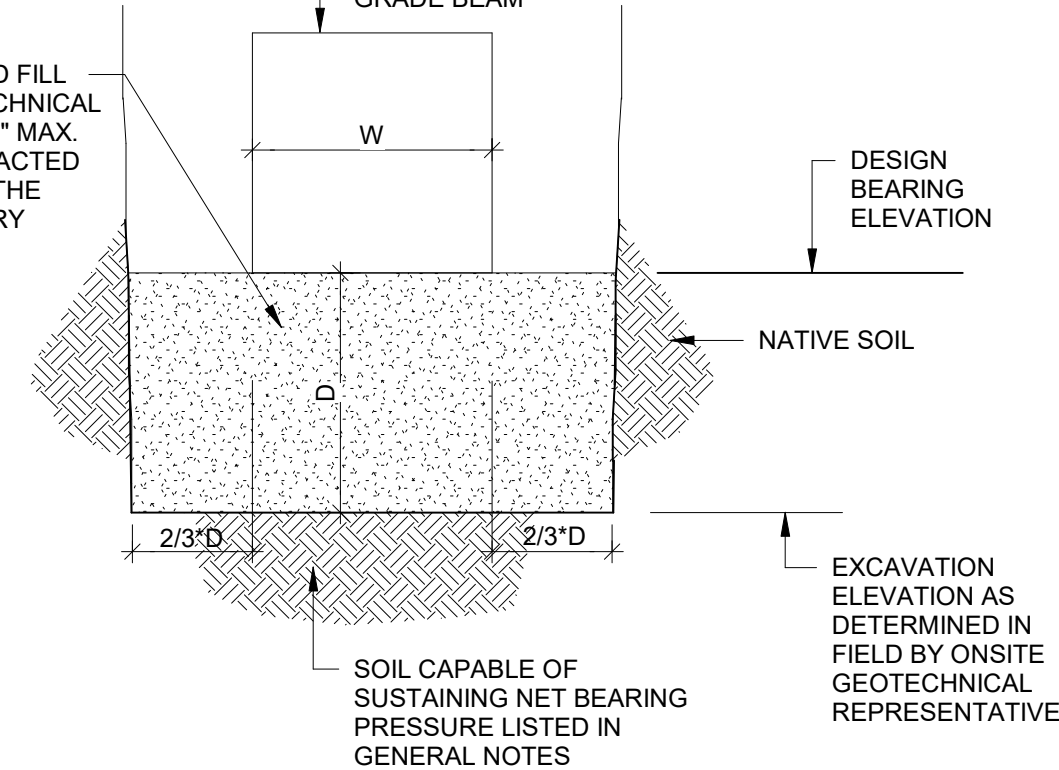


ENGINEERED FILL BACKFILL

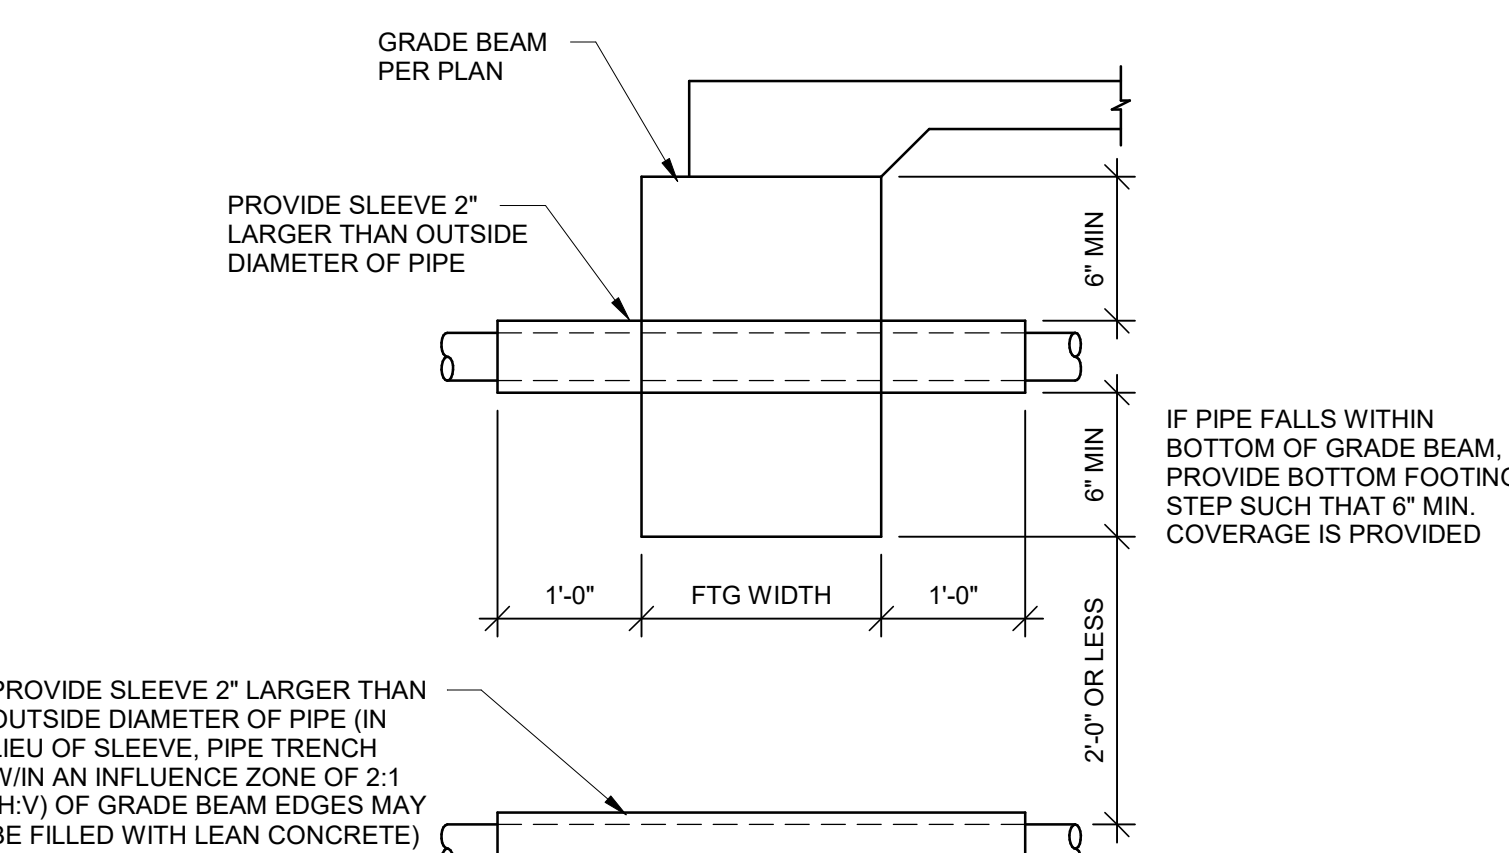

NOTES:
1. IF PIPE IS MORE THAN 2'-0" BELOW BOTTOM OF GRADE BEAM, SLEEVE IS NOT REQUIRED
2. PIPES SHALL NOT CROSS BELOW OR THROUGH A SPREAD FOOTING.

TYPICAL GRADE BEAM SLEEVE

10 SECTION
3/4" = 1'-0"

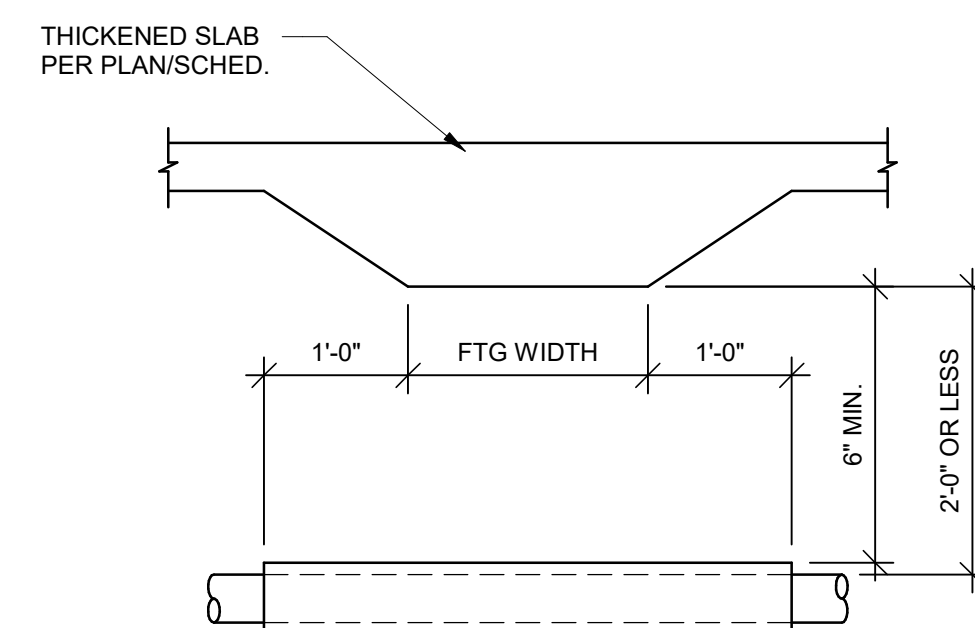


PROVIDE SLEEVE 2" LARGER THAN OUTSIDE DIAMETER OF PIPE (IN LIEU OF SLEEVE, PIPE TRENCH W/IN AN INFLUENCE ZONE OF 2:1 (H:V) OF GRADE BEAM EDGES MAY BE FILLED WITH LEAN CONCRETE)

NOTE:
1. IF PIPE IS MORE THAN 2'-0" BELOW BOTTOM OF FOOTING, SLEEVE IS NOT REQUIRED


TYPICAL PLUMBING SLEEVE AT THICKENED SLAB

11 SECTION
3/4" = 1'-0"


12 SECTION
3/4" = 1'-0"

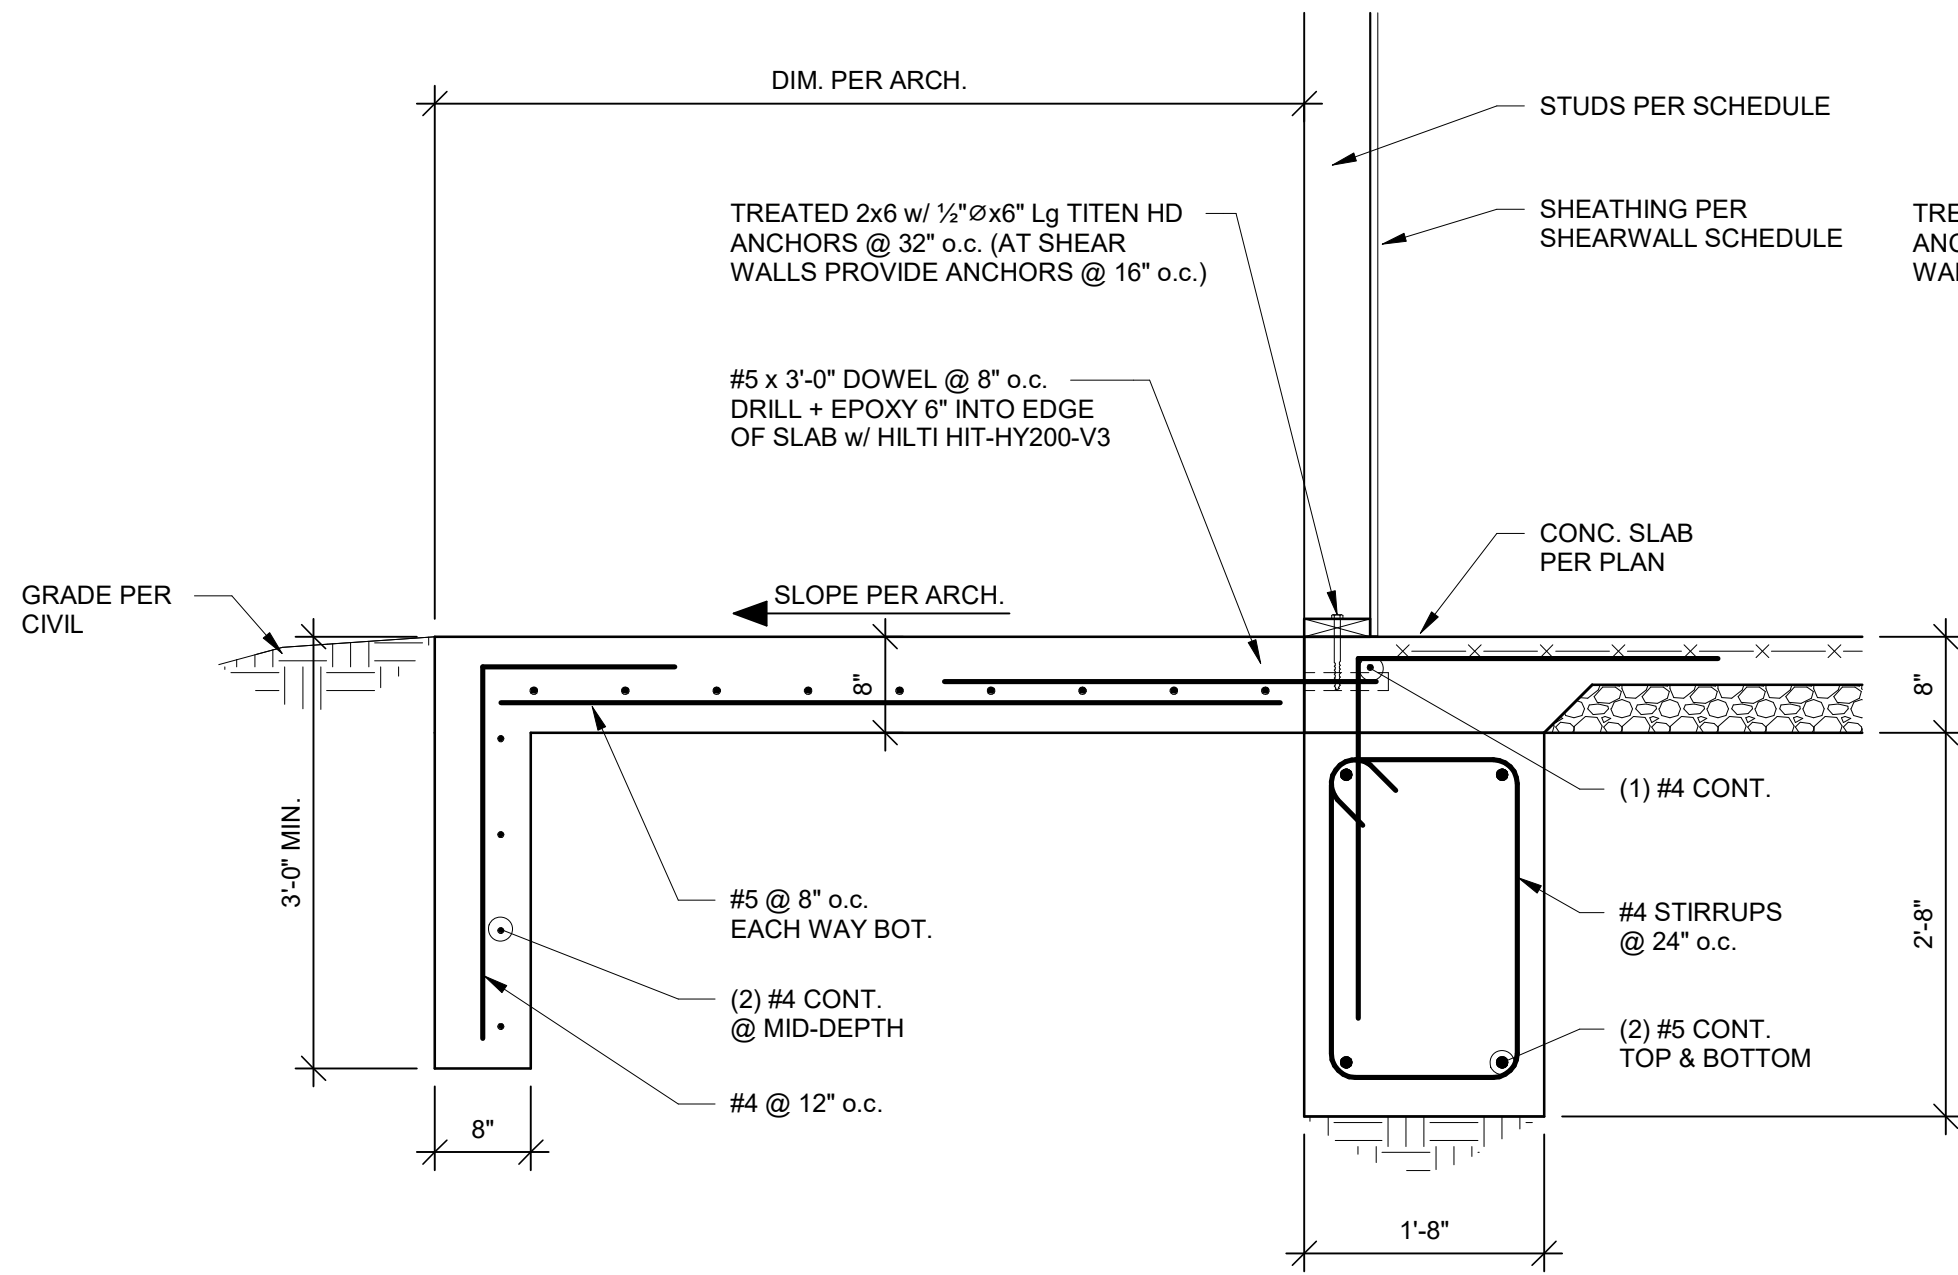


1 SECTION
3/4" = 1'-0"

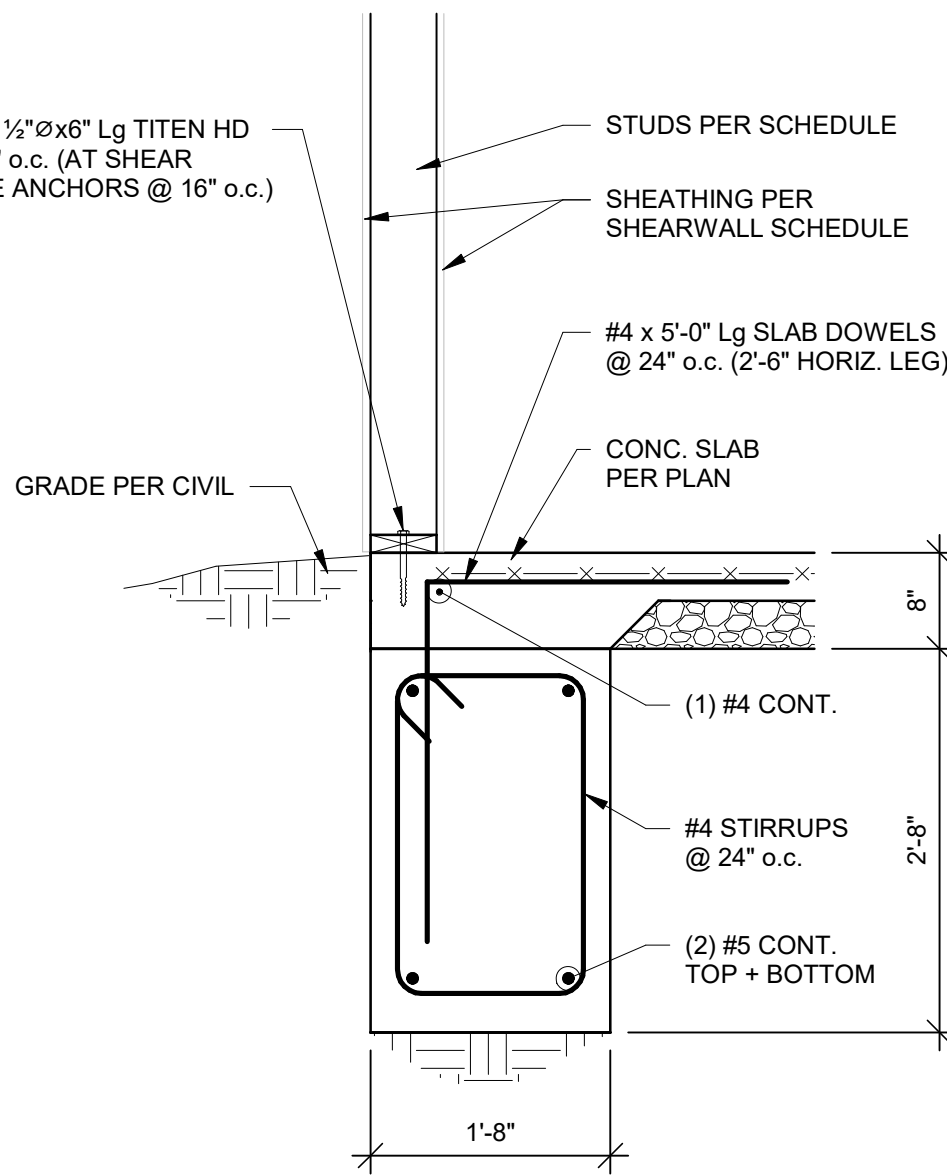


2 SECTION
3/4" = 1'-0"

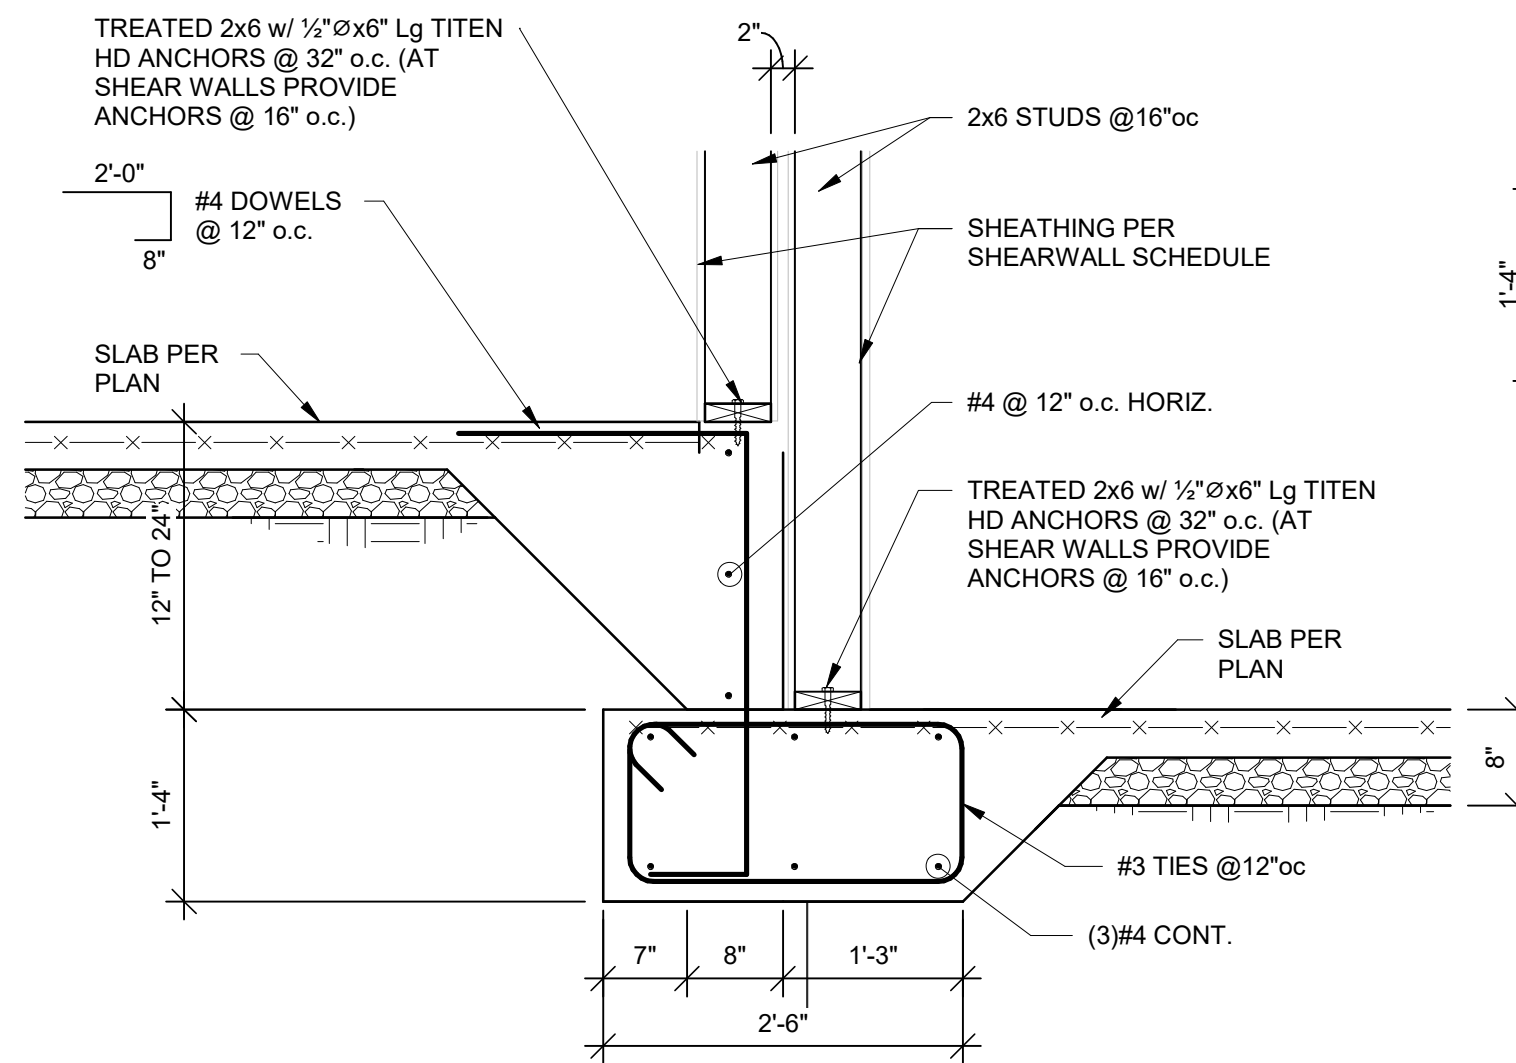


3 SECTION
3/4" = 1'-0"

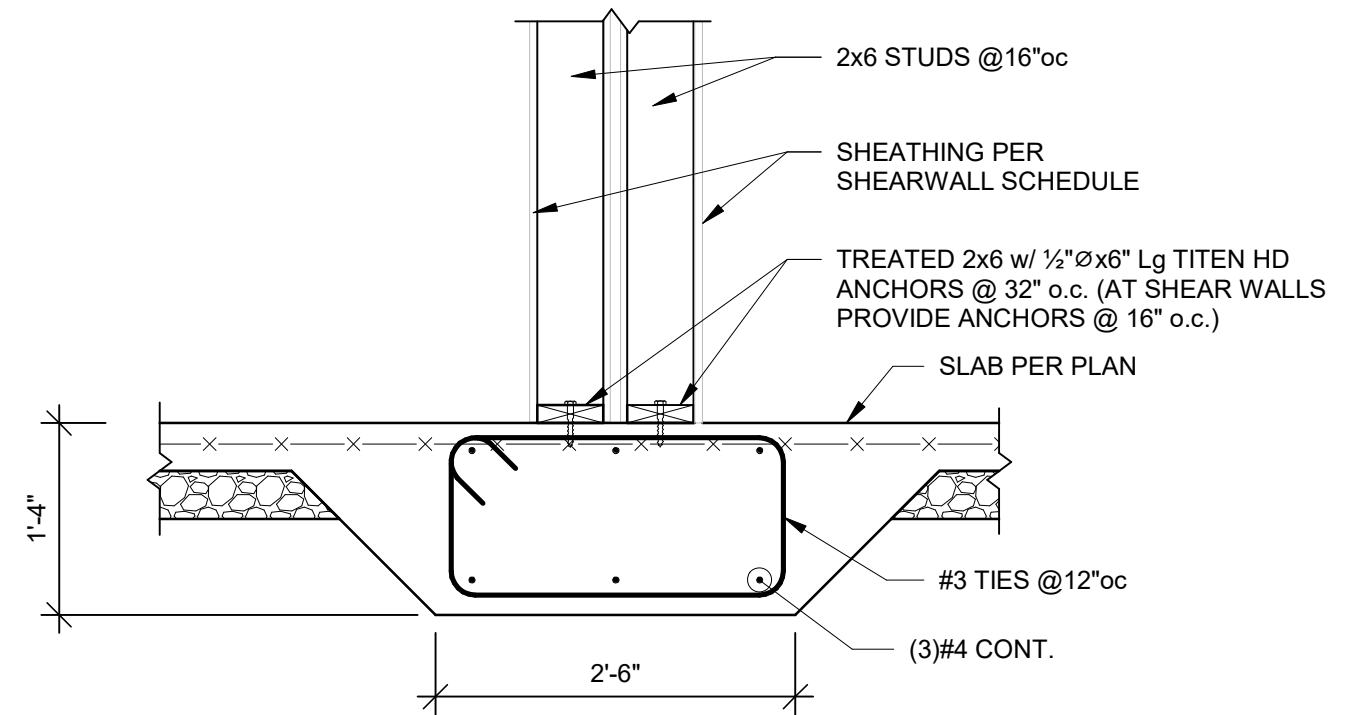

4 SECTION
3/4" = 1'-0"

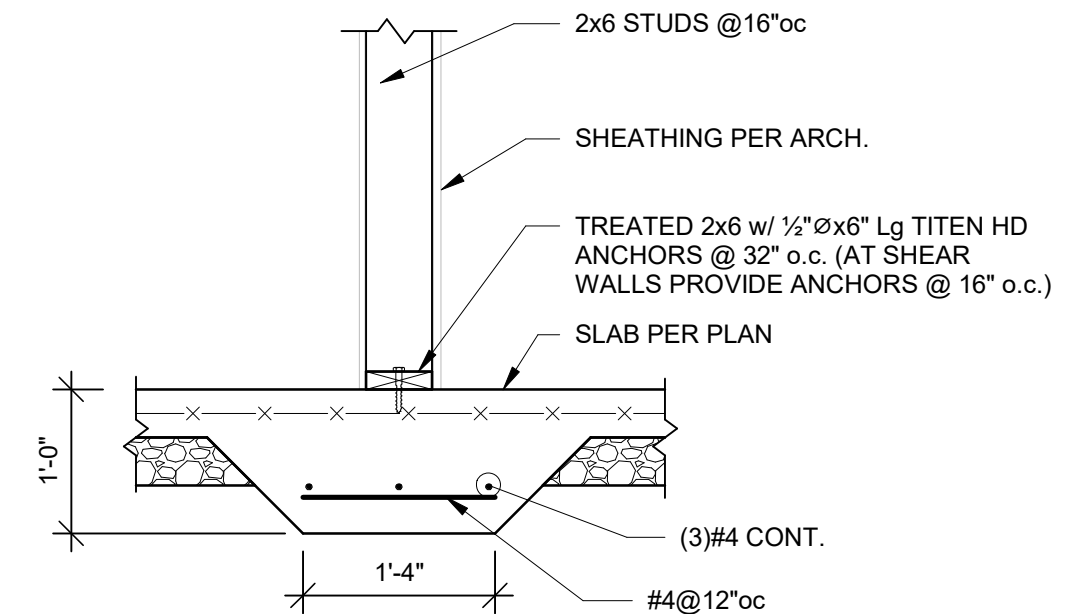

5 SECTION
3/4" = 1'-0"

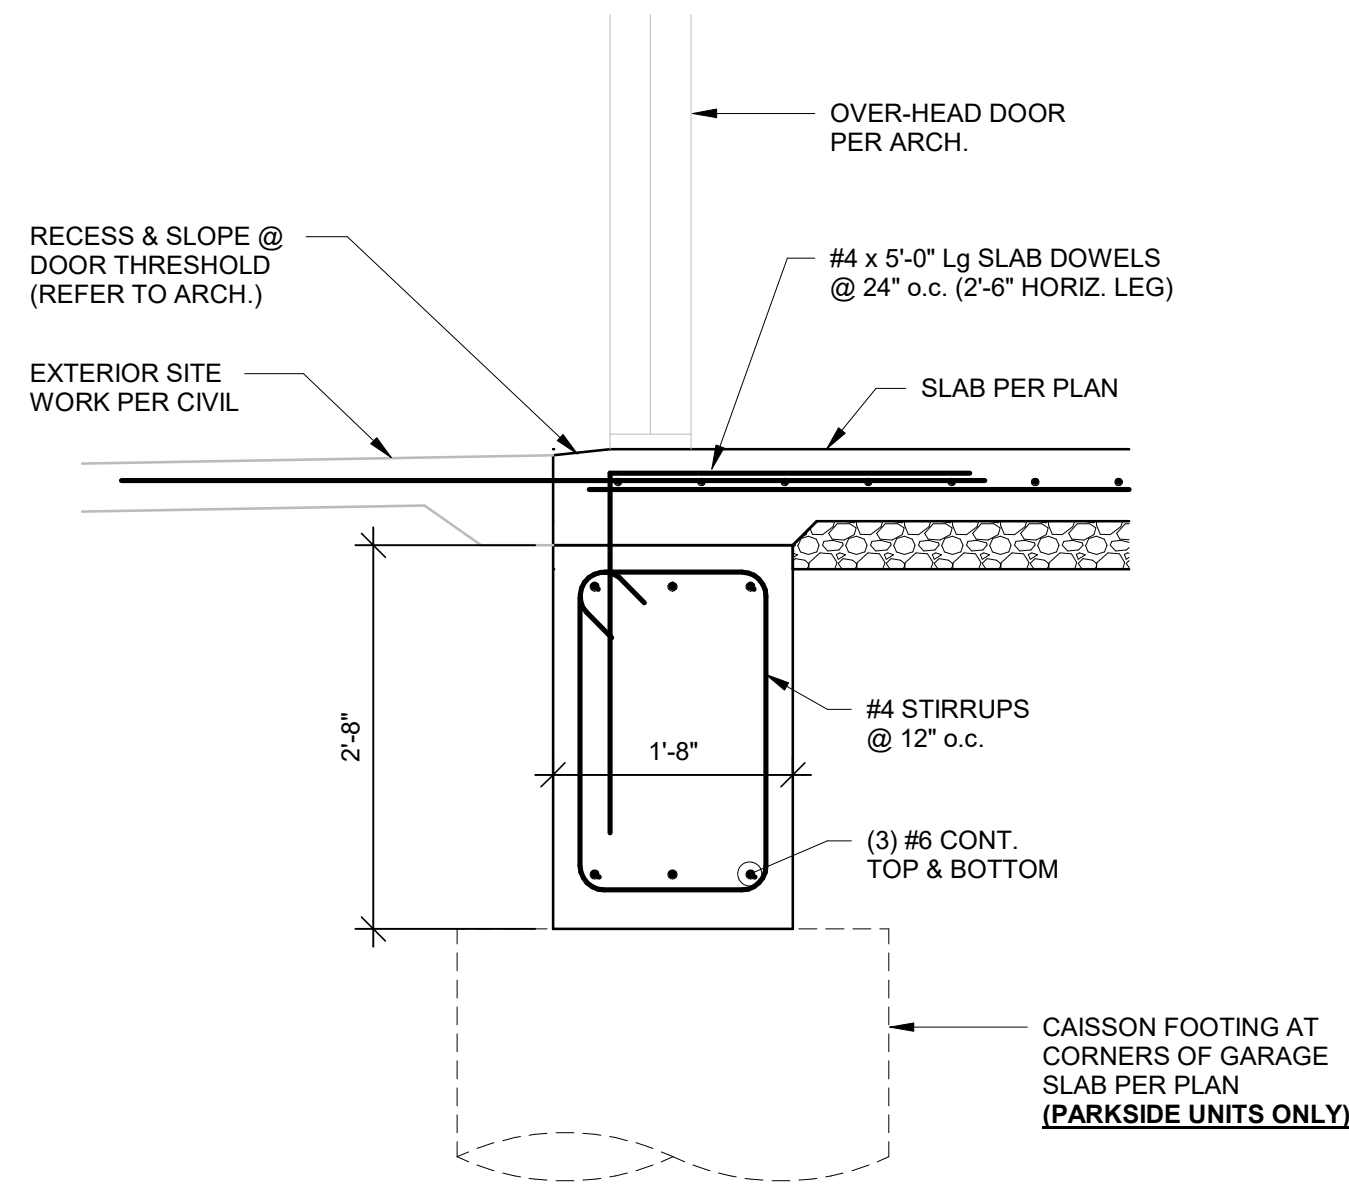

6 SECTION
3/4" = 1'-0"

JonesGillamRenz
1881 Main Street, Suite 301
Kansas City, MO 64108
jgr@jgarchitects.com

730 N. Ninth
Salina, KS 67401
785.827.0386

LENEXA CITY CENTER _ NORTH VILLAGE TOWNHOMES
NEW TOWNHOMES COMPLEX
LENEXA, KANSAS







REVISION:


DATE: 8/12/2025
JOB: 25-3090
SHEET NO.:

S3.1


COPYRIGHTED

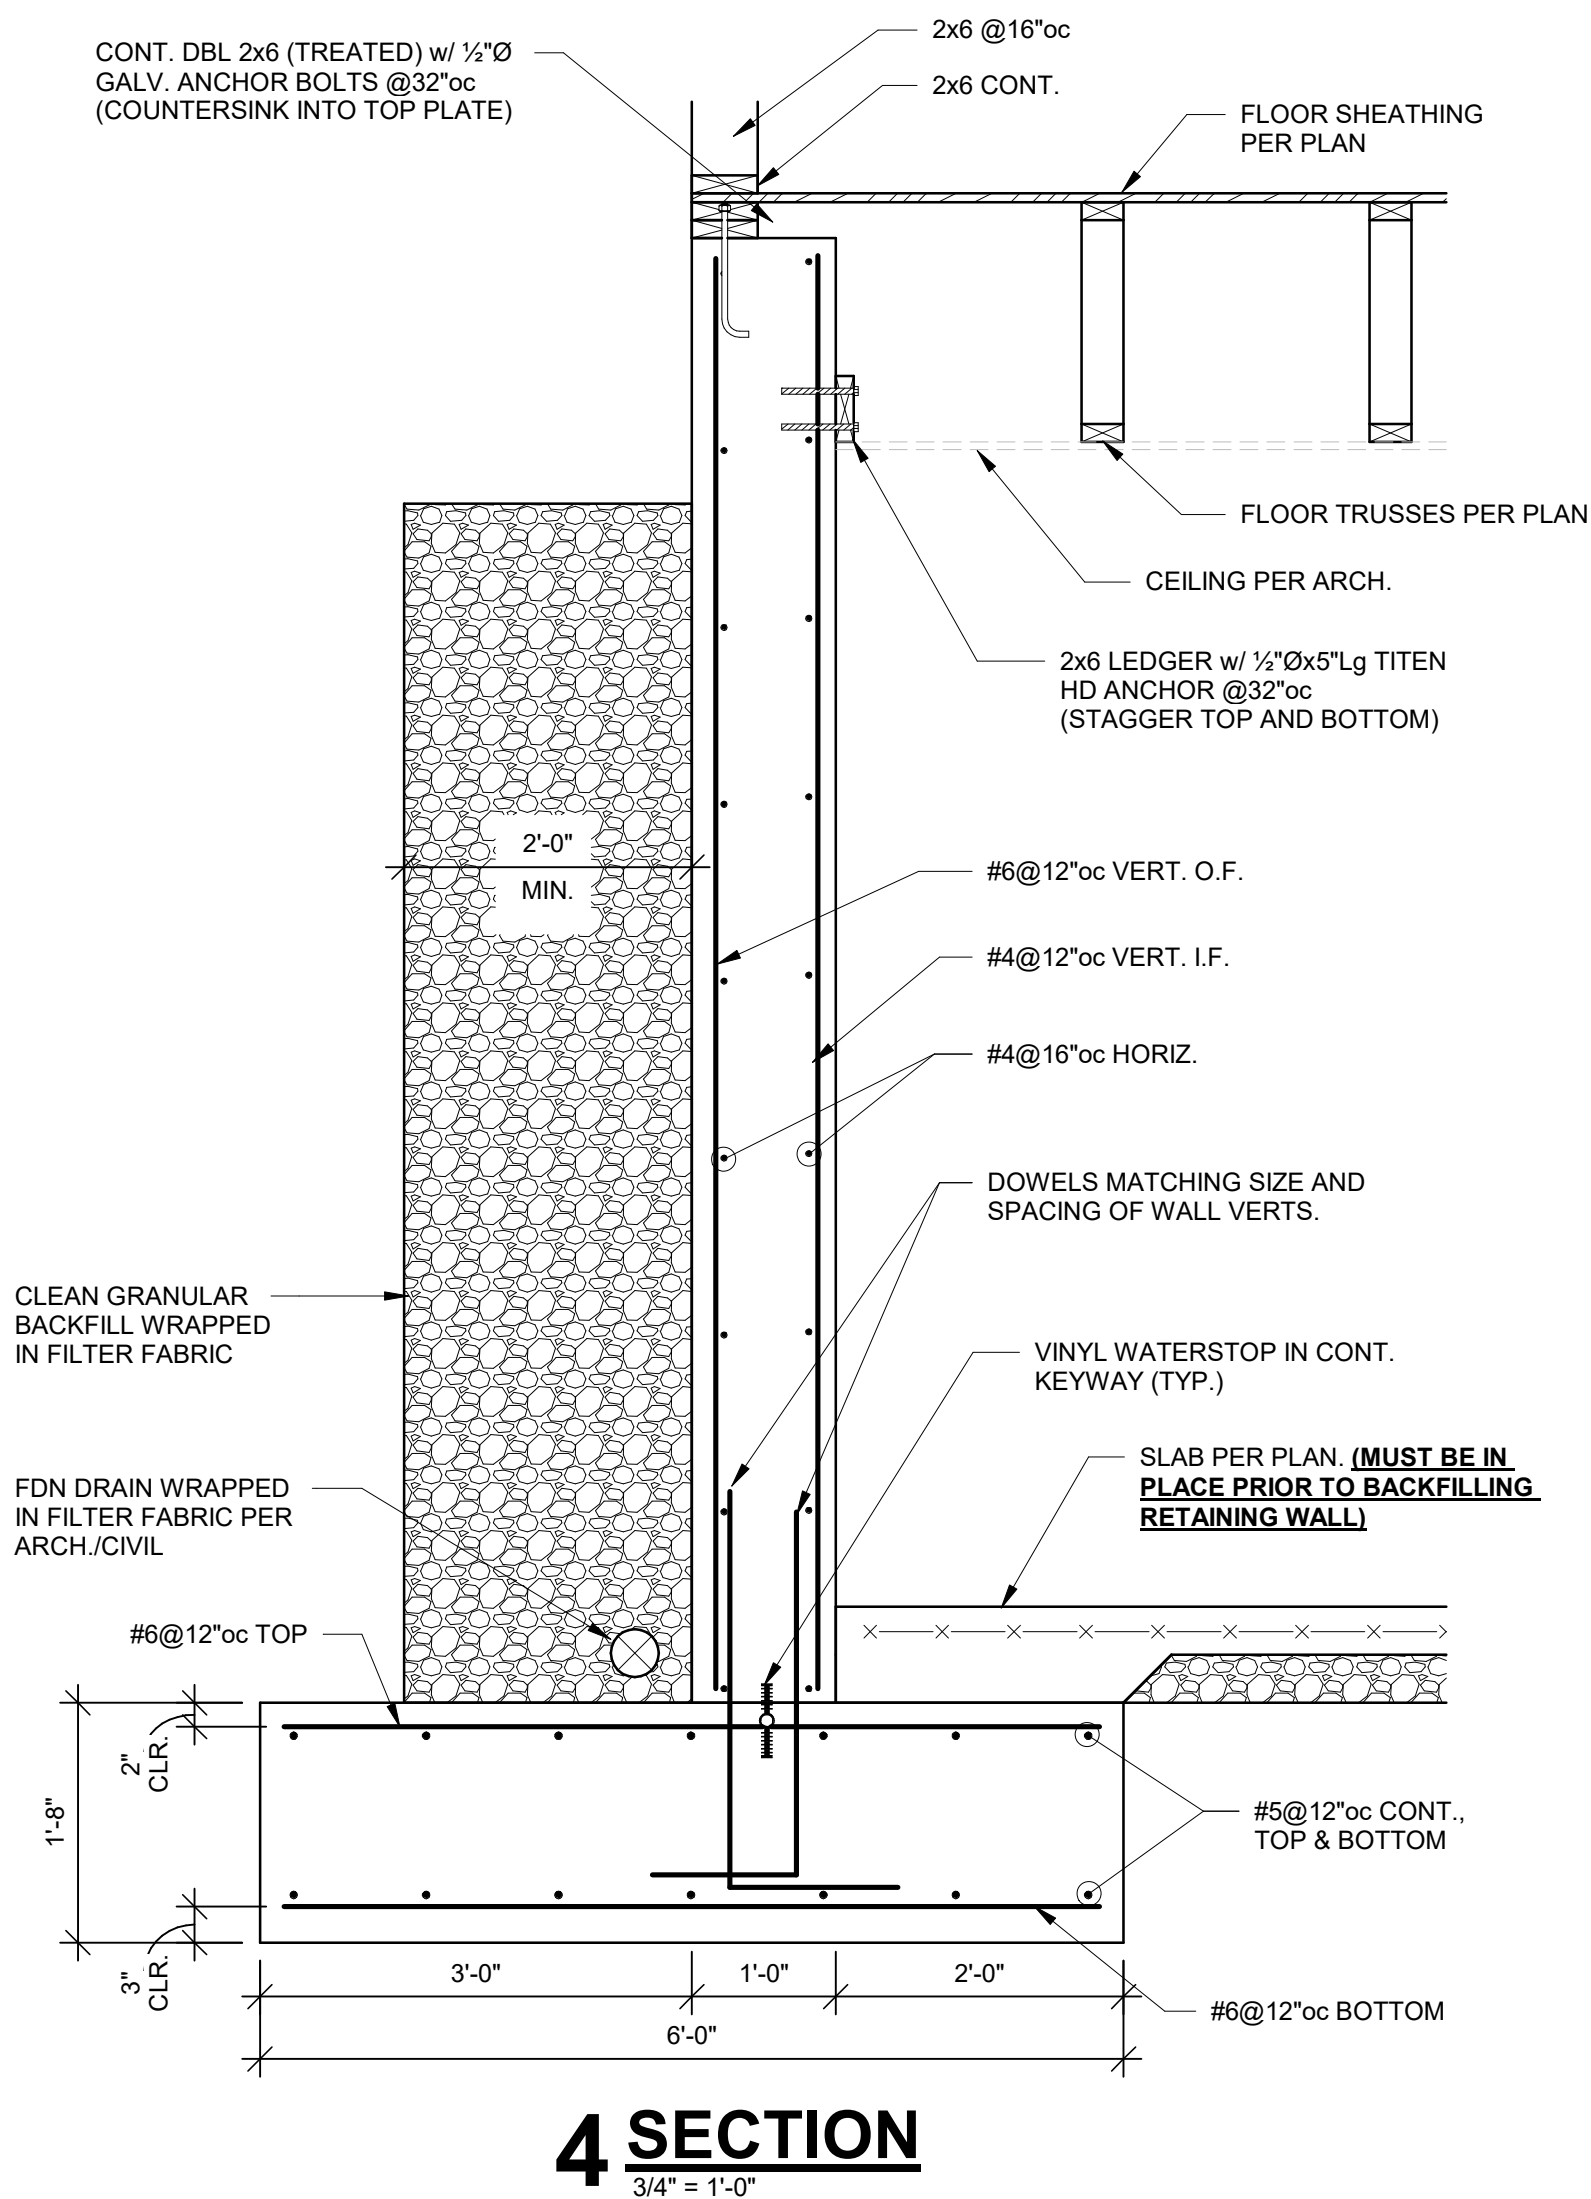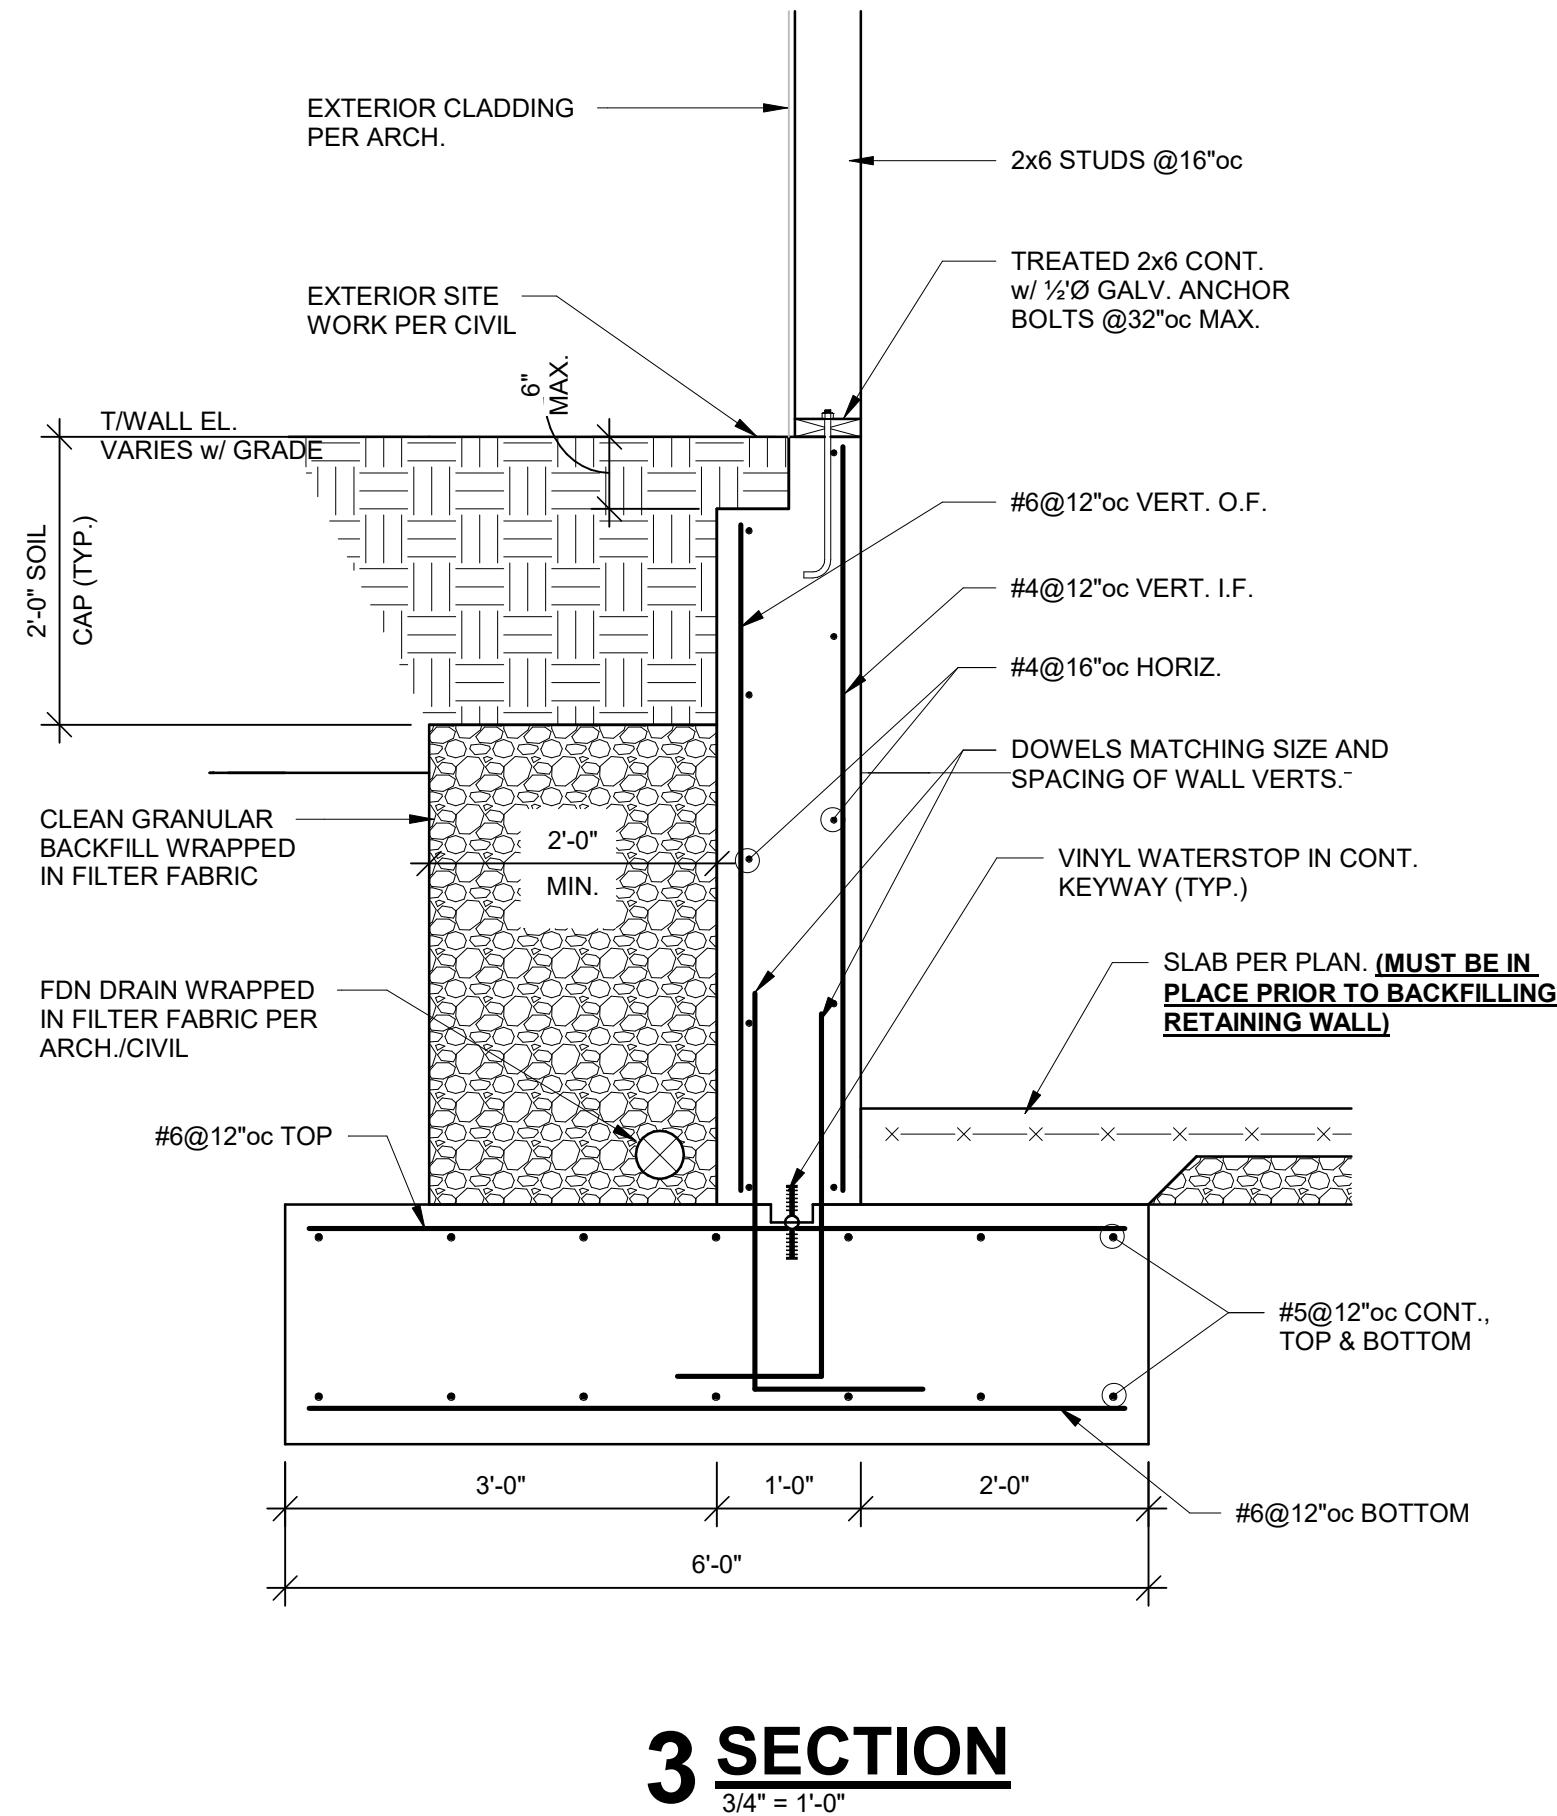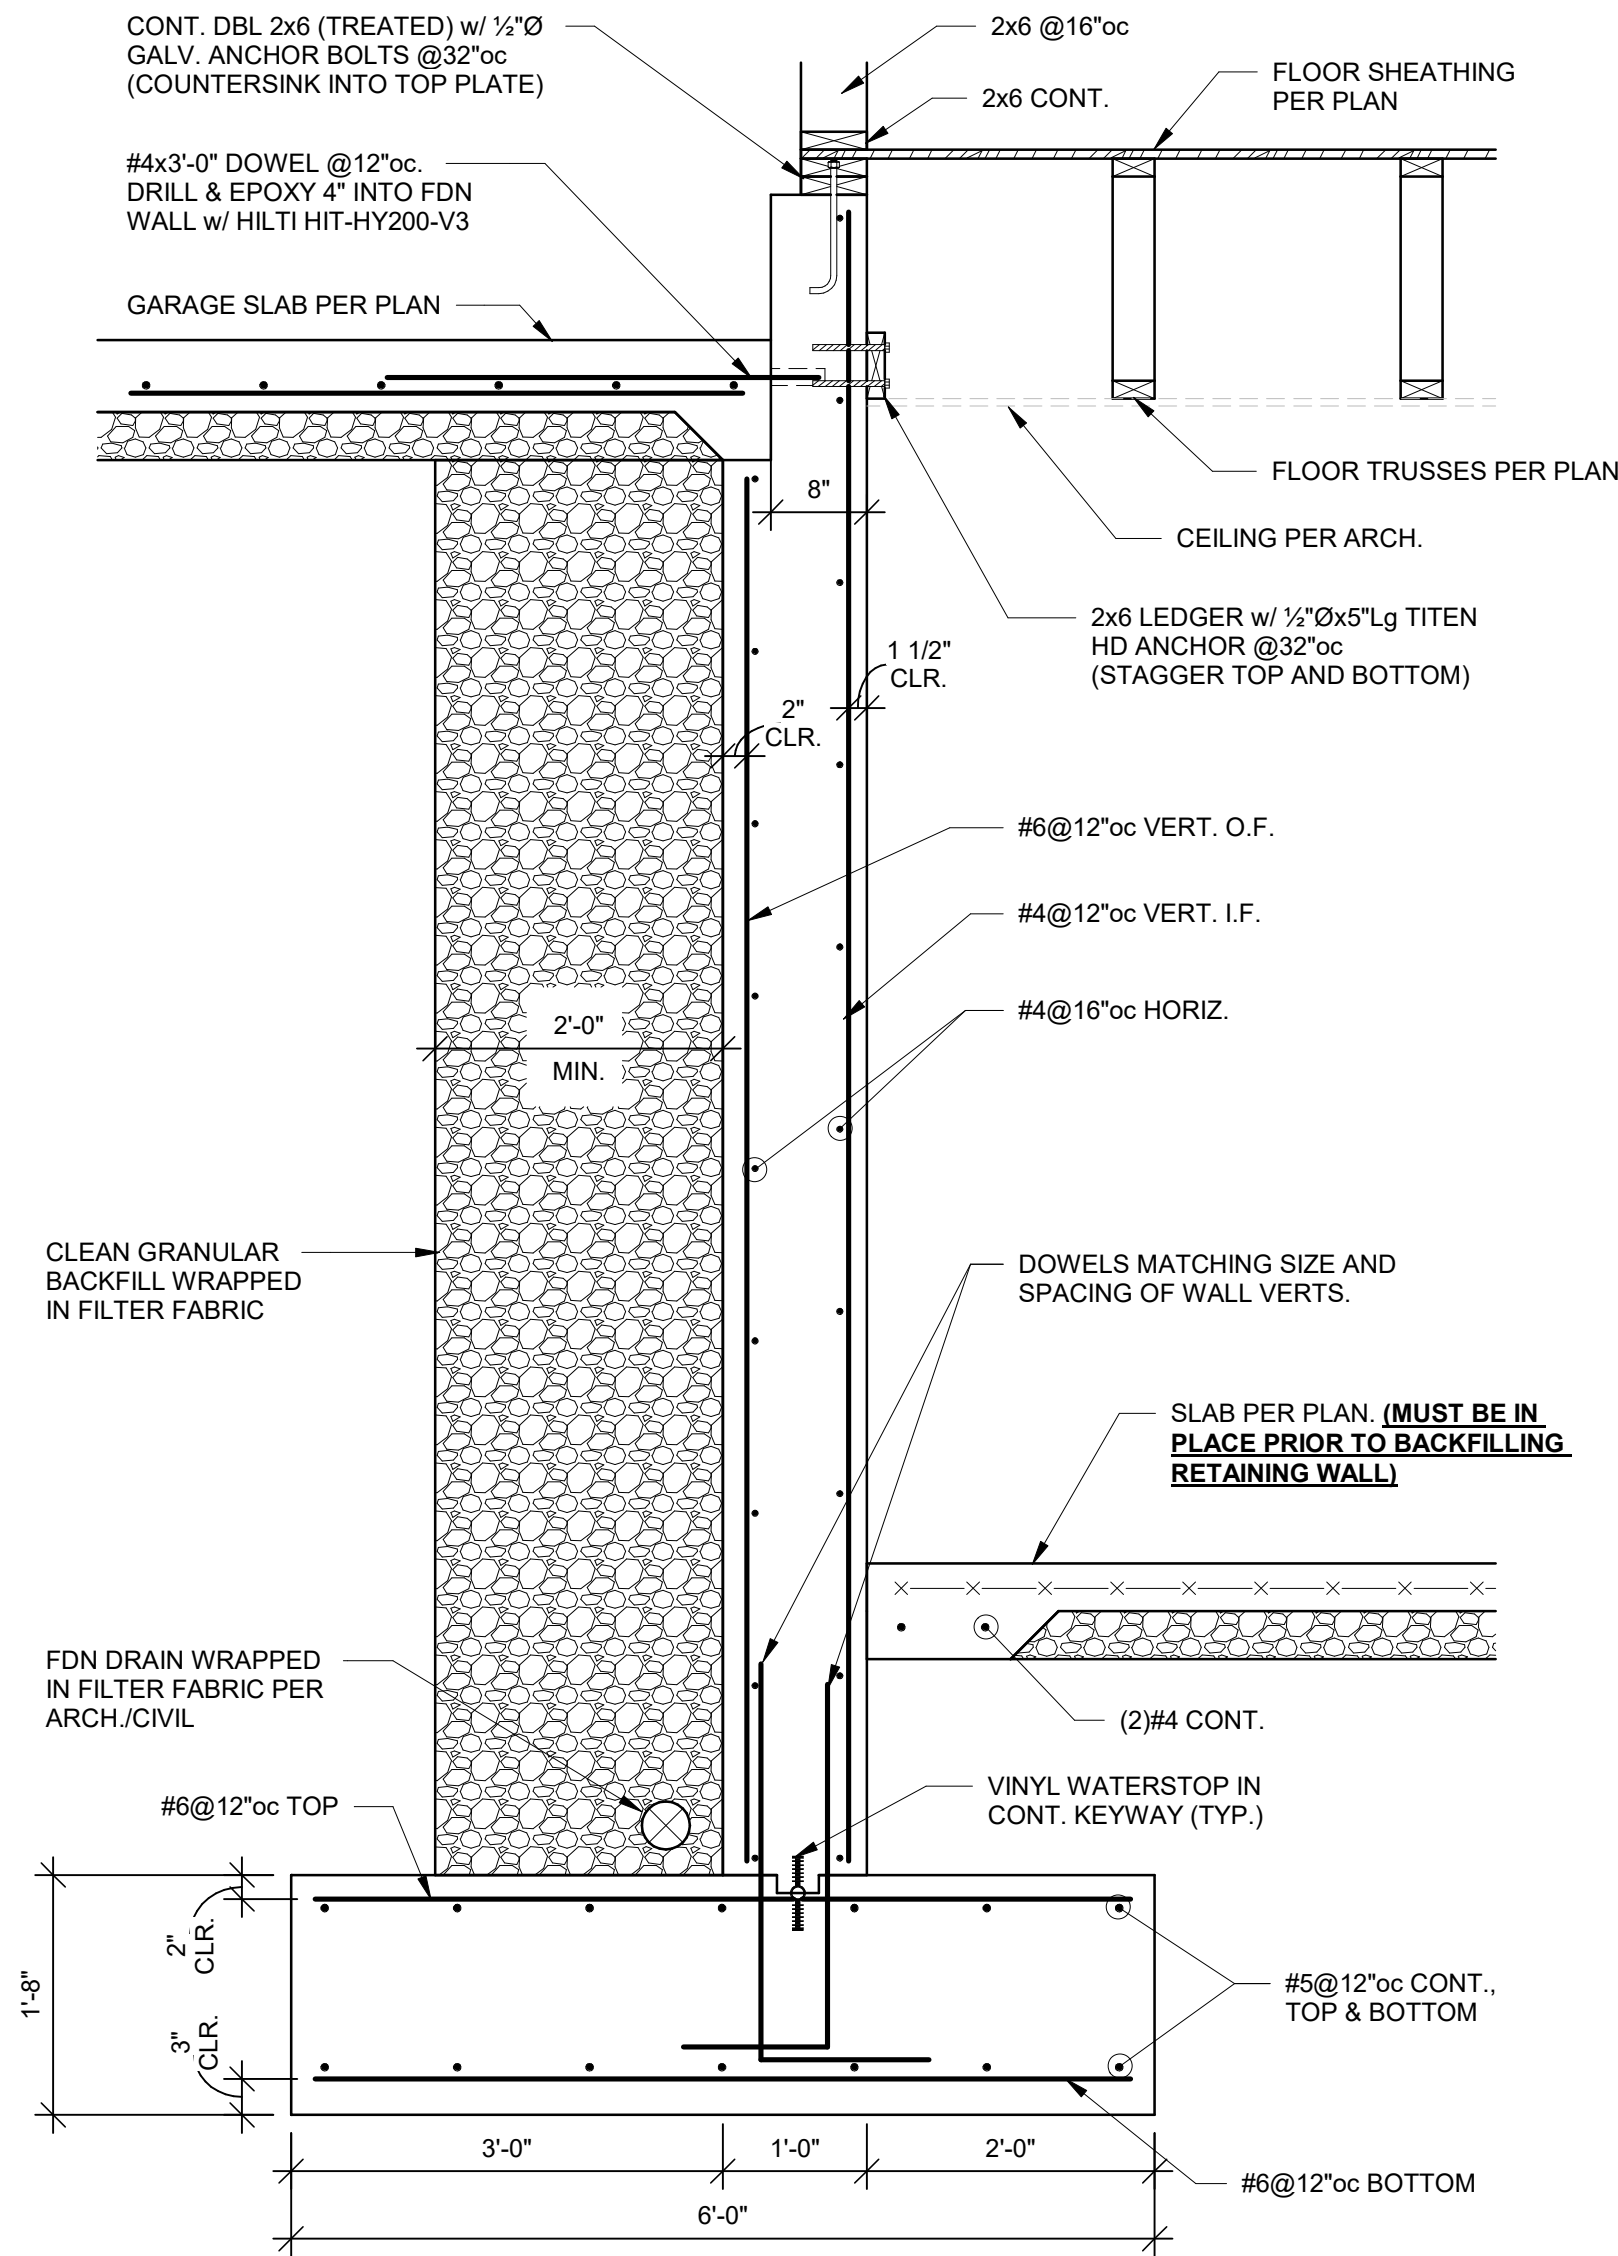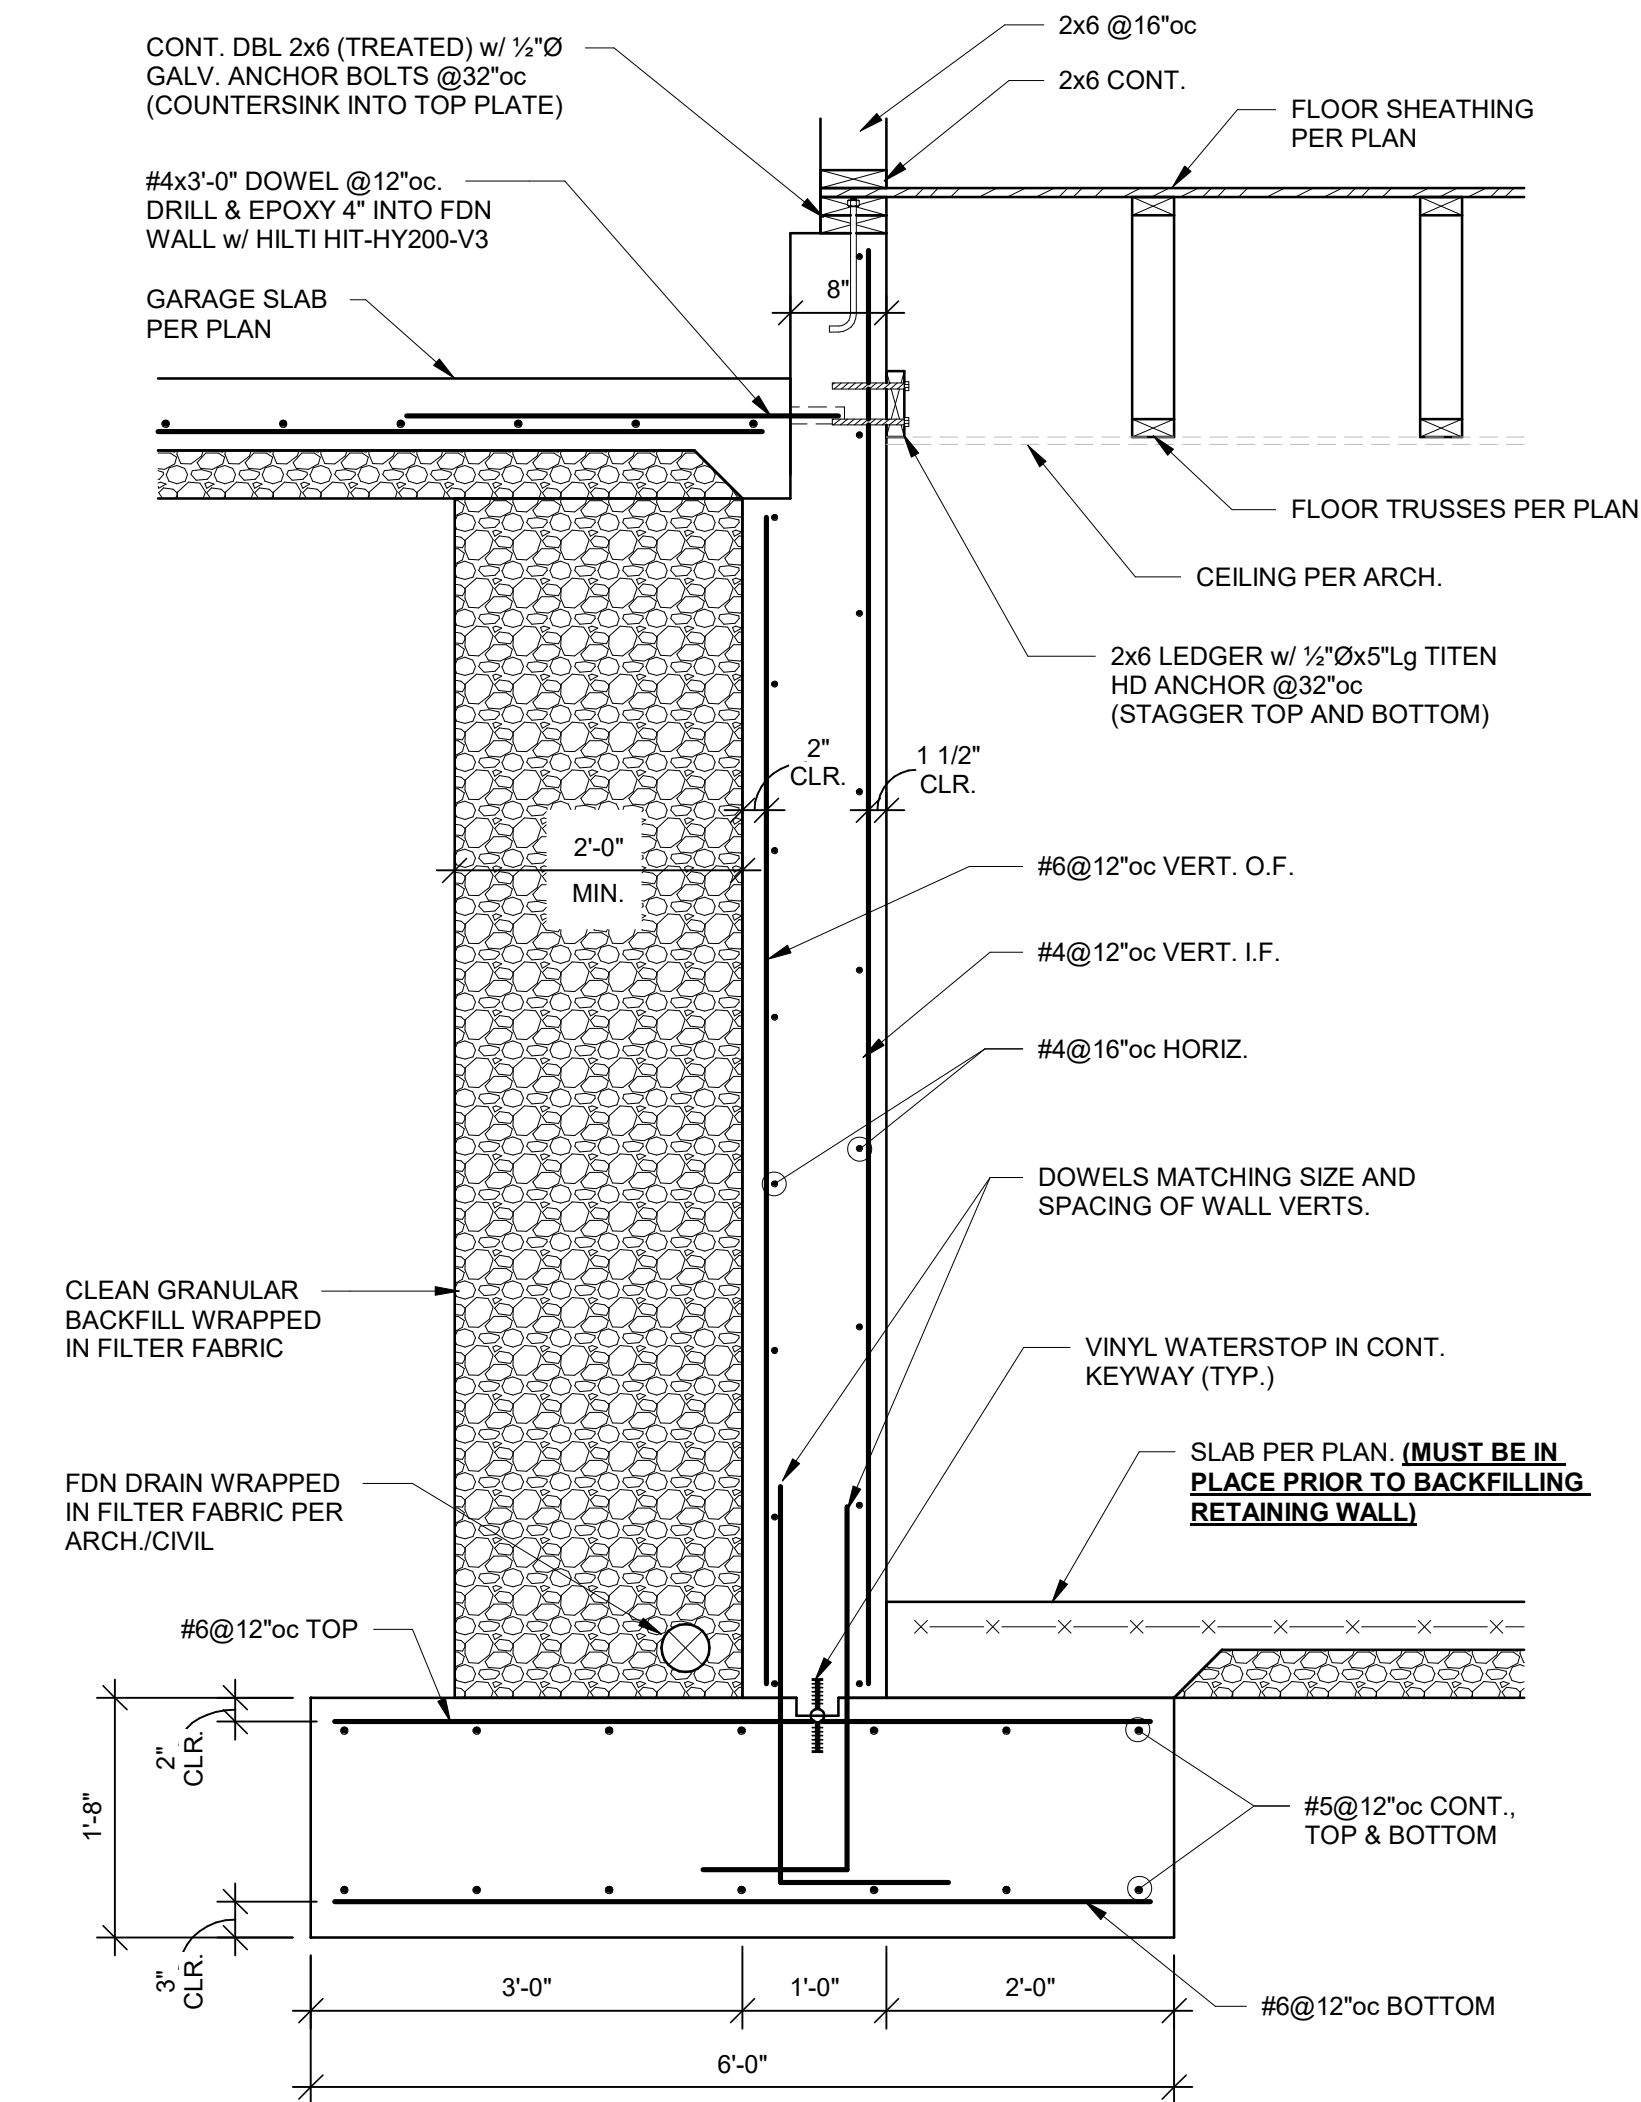


REVISION:
DATE: 8/12/2025
JOB: 25-3090
SHEET NO.:

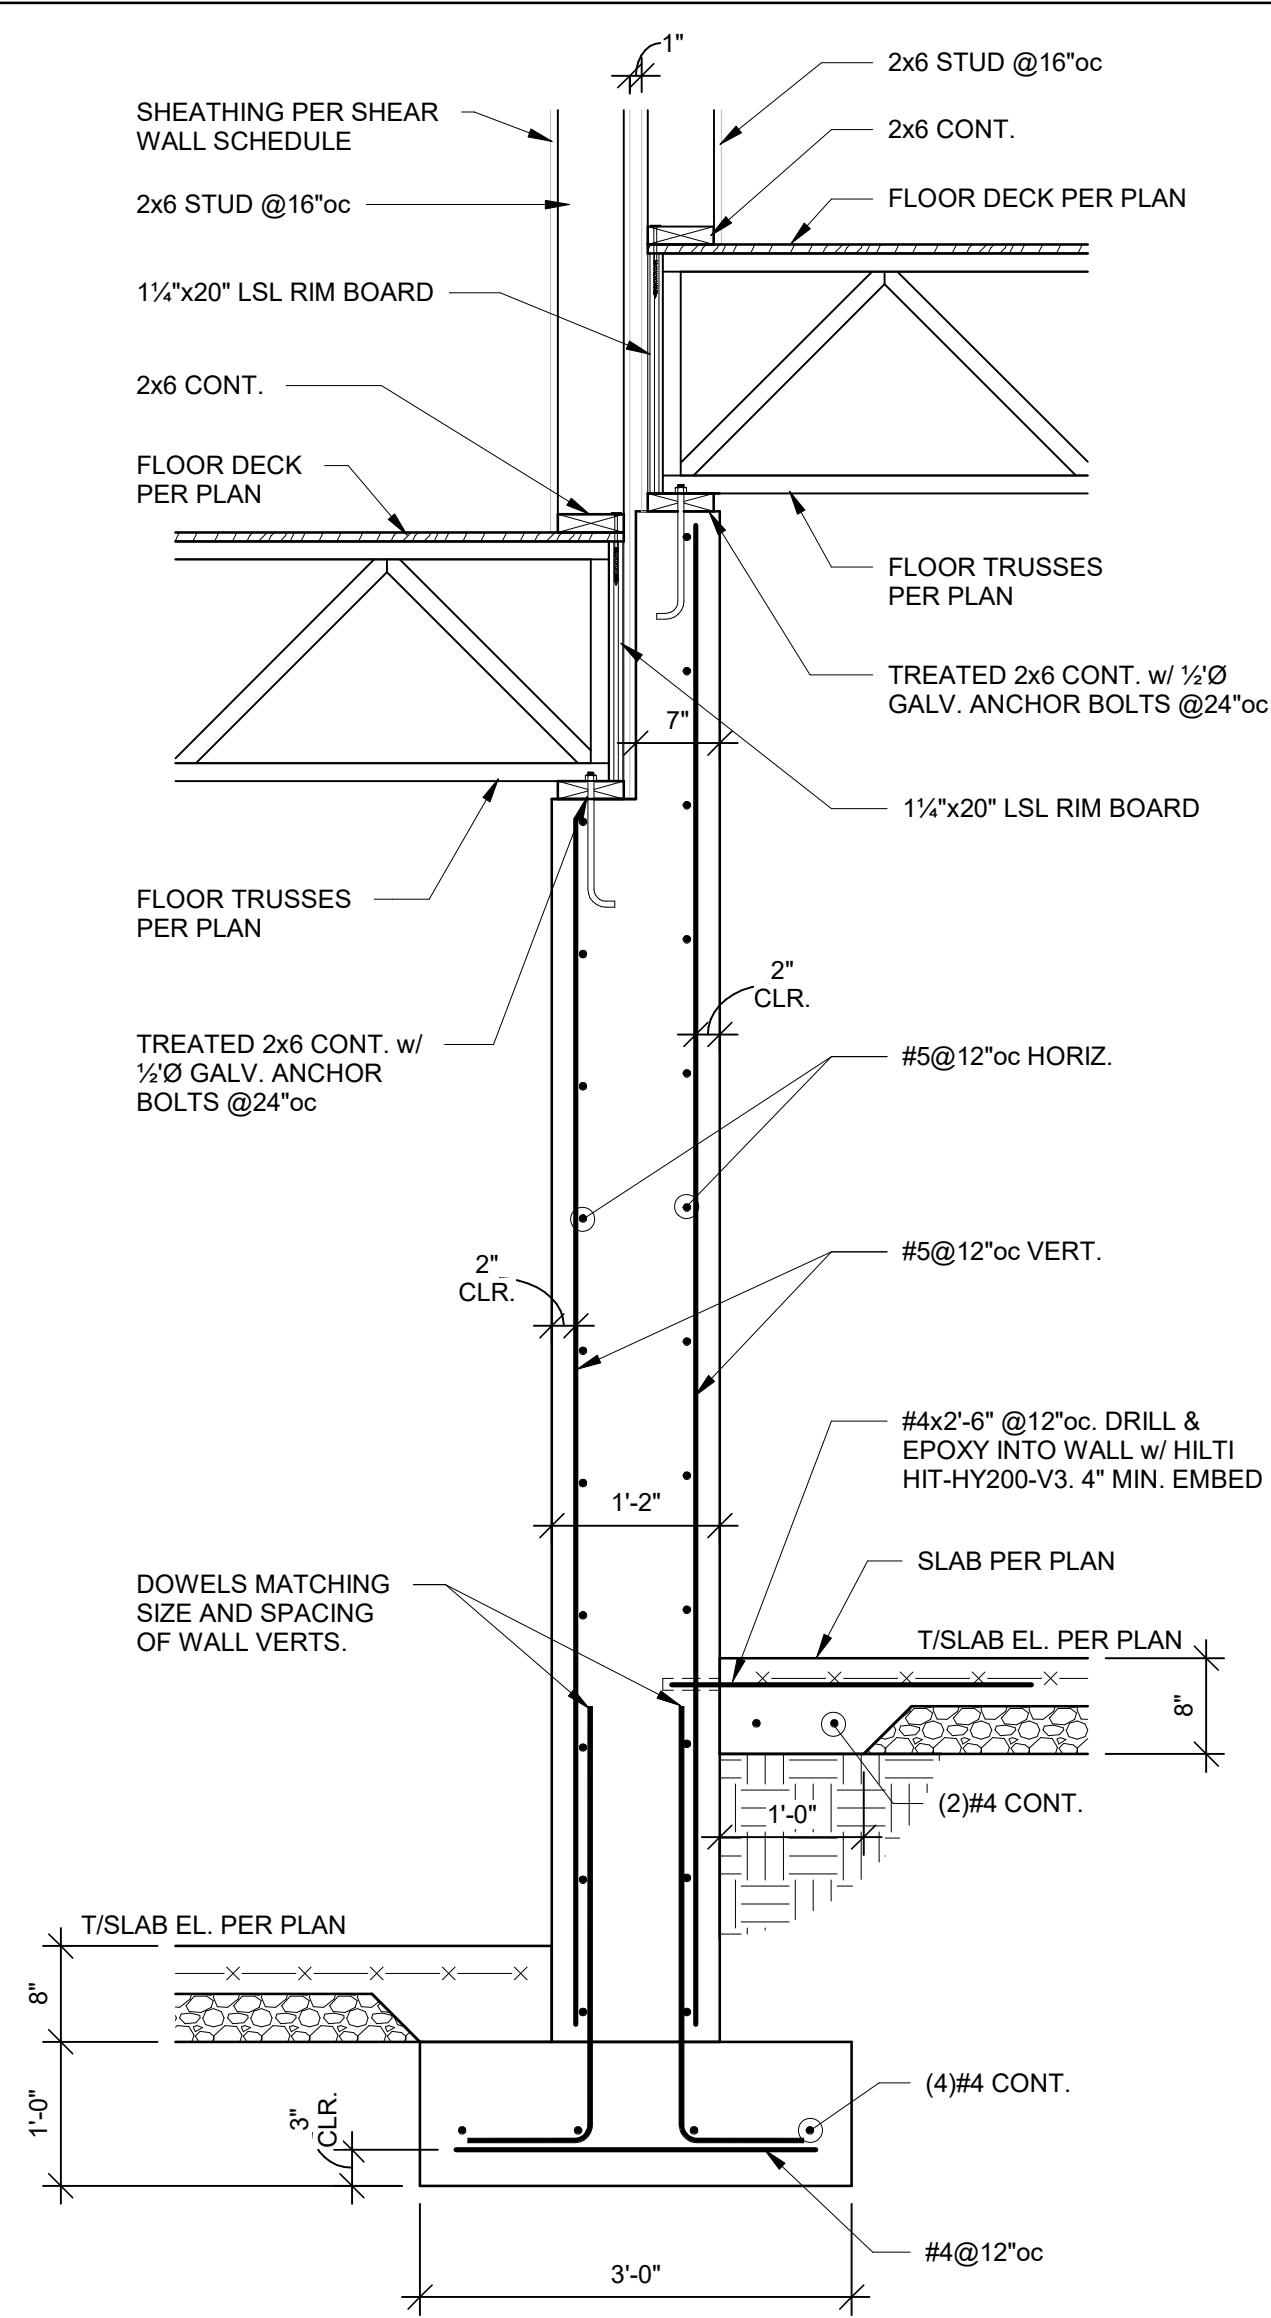


1 SECTION
3/4" = 1'-0"

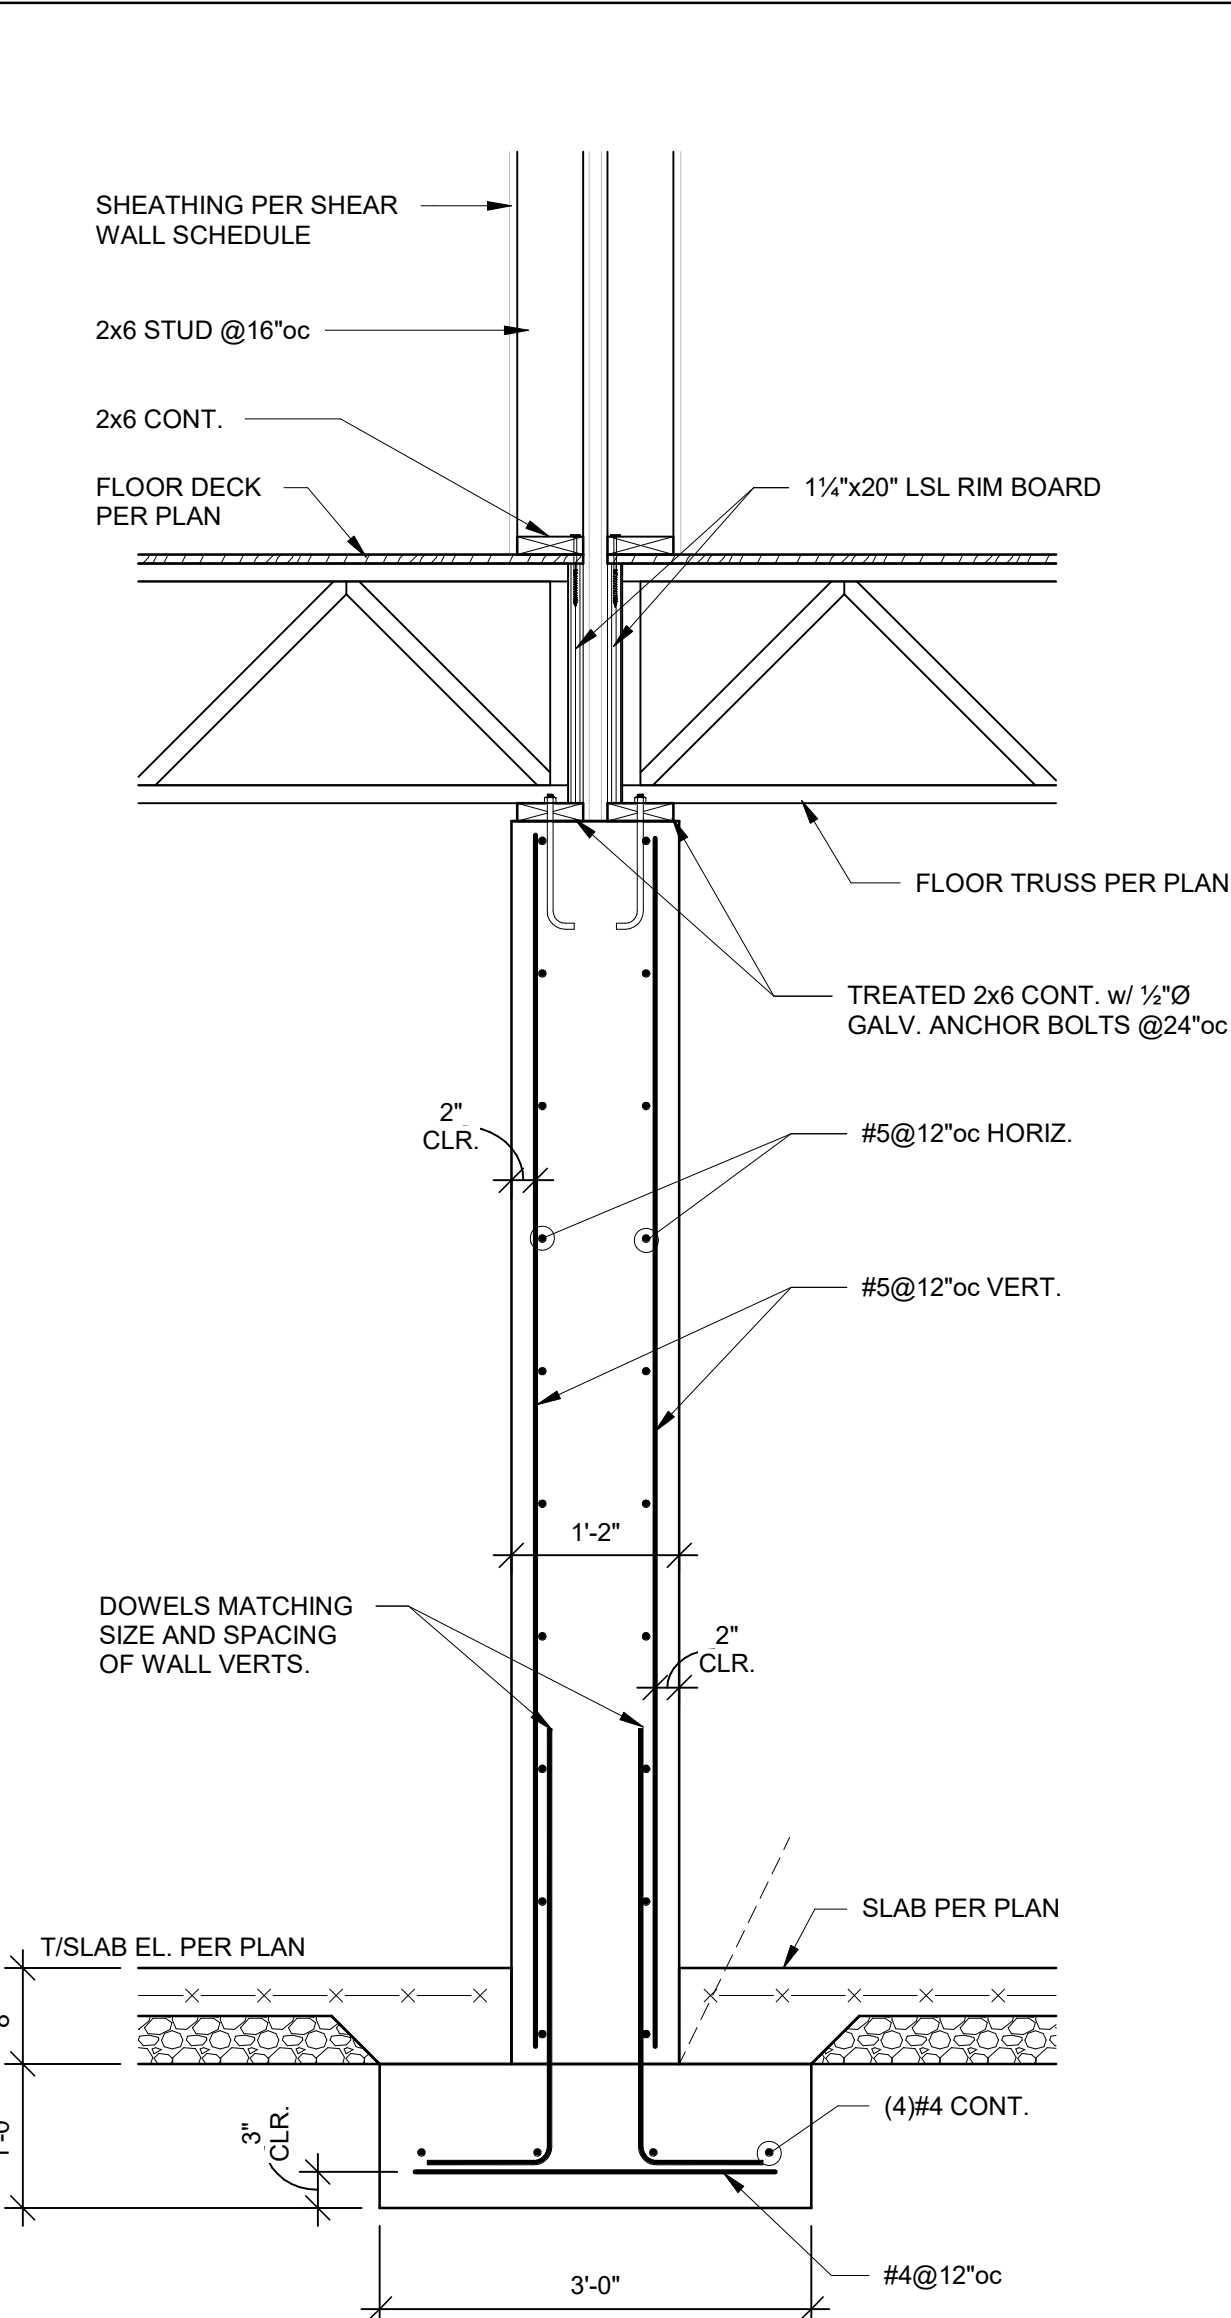


2 SECTION
3/4" = 1'-0"

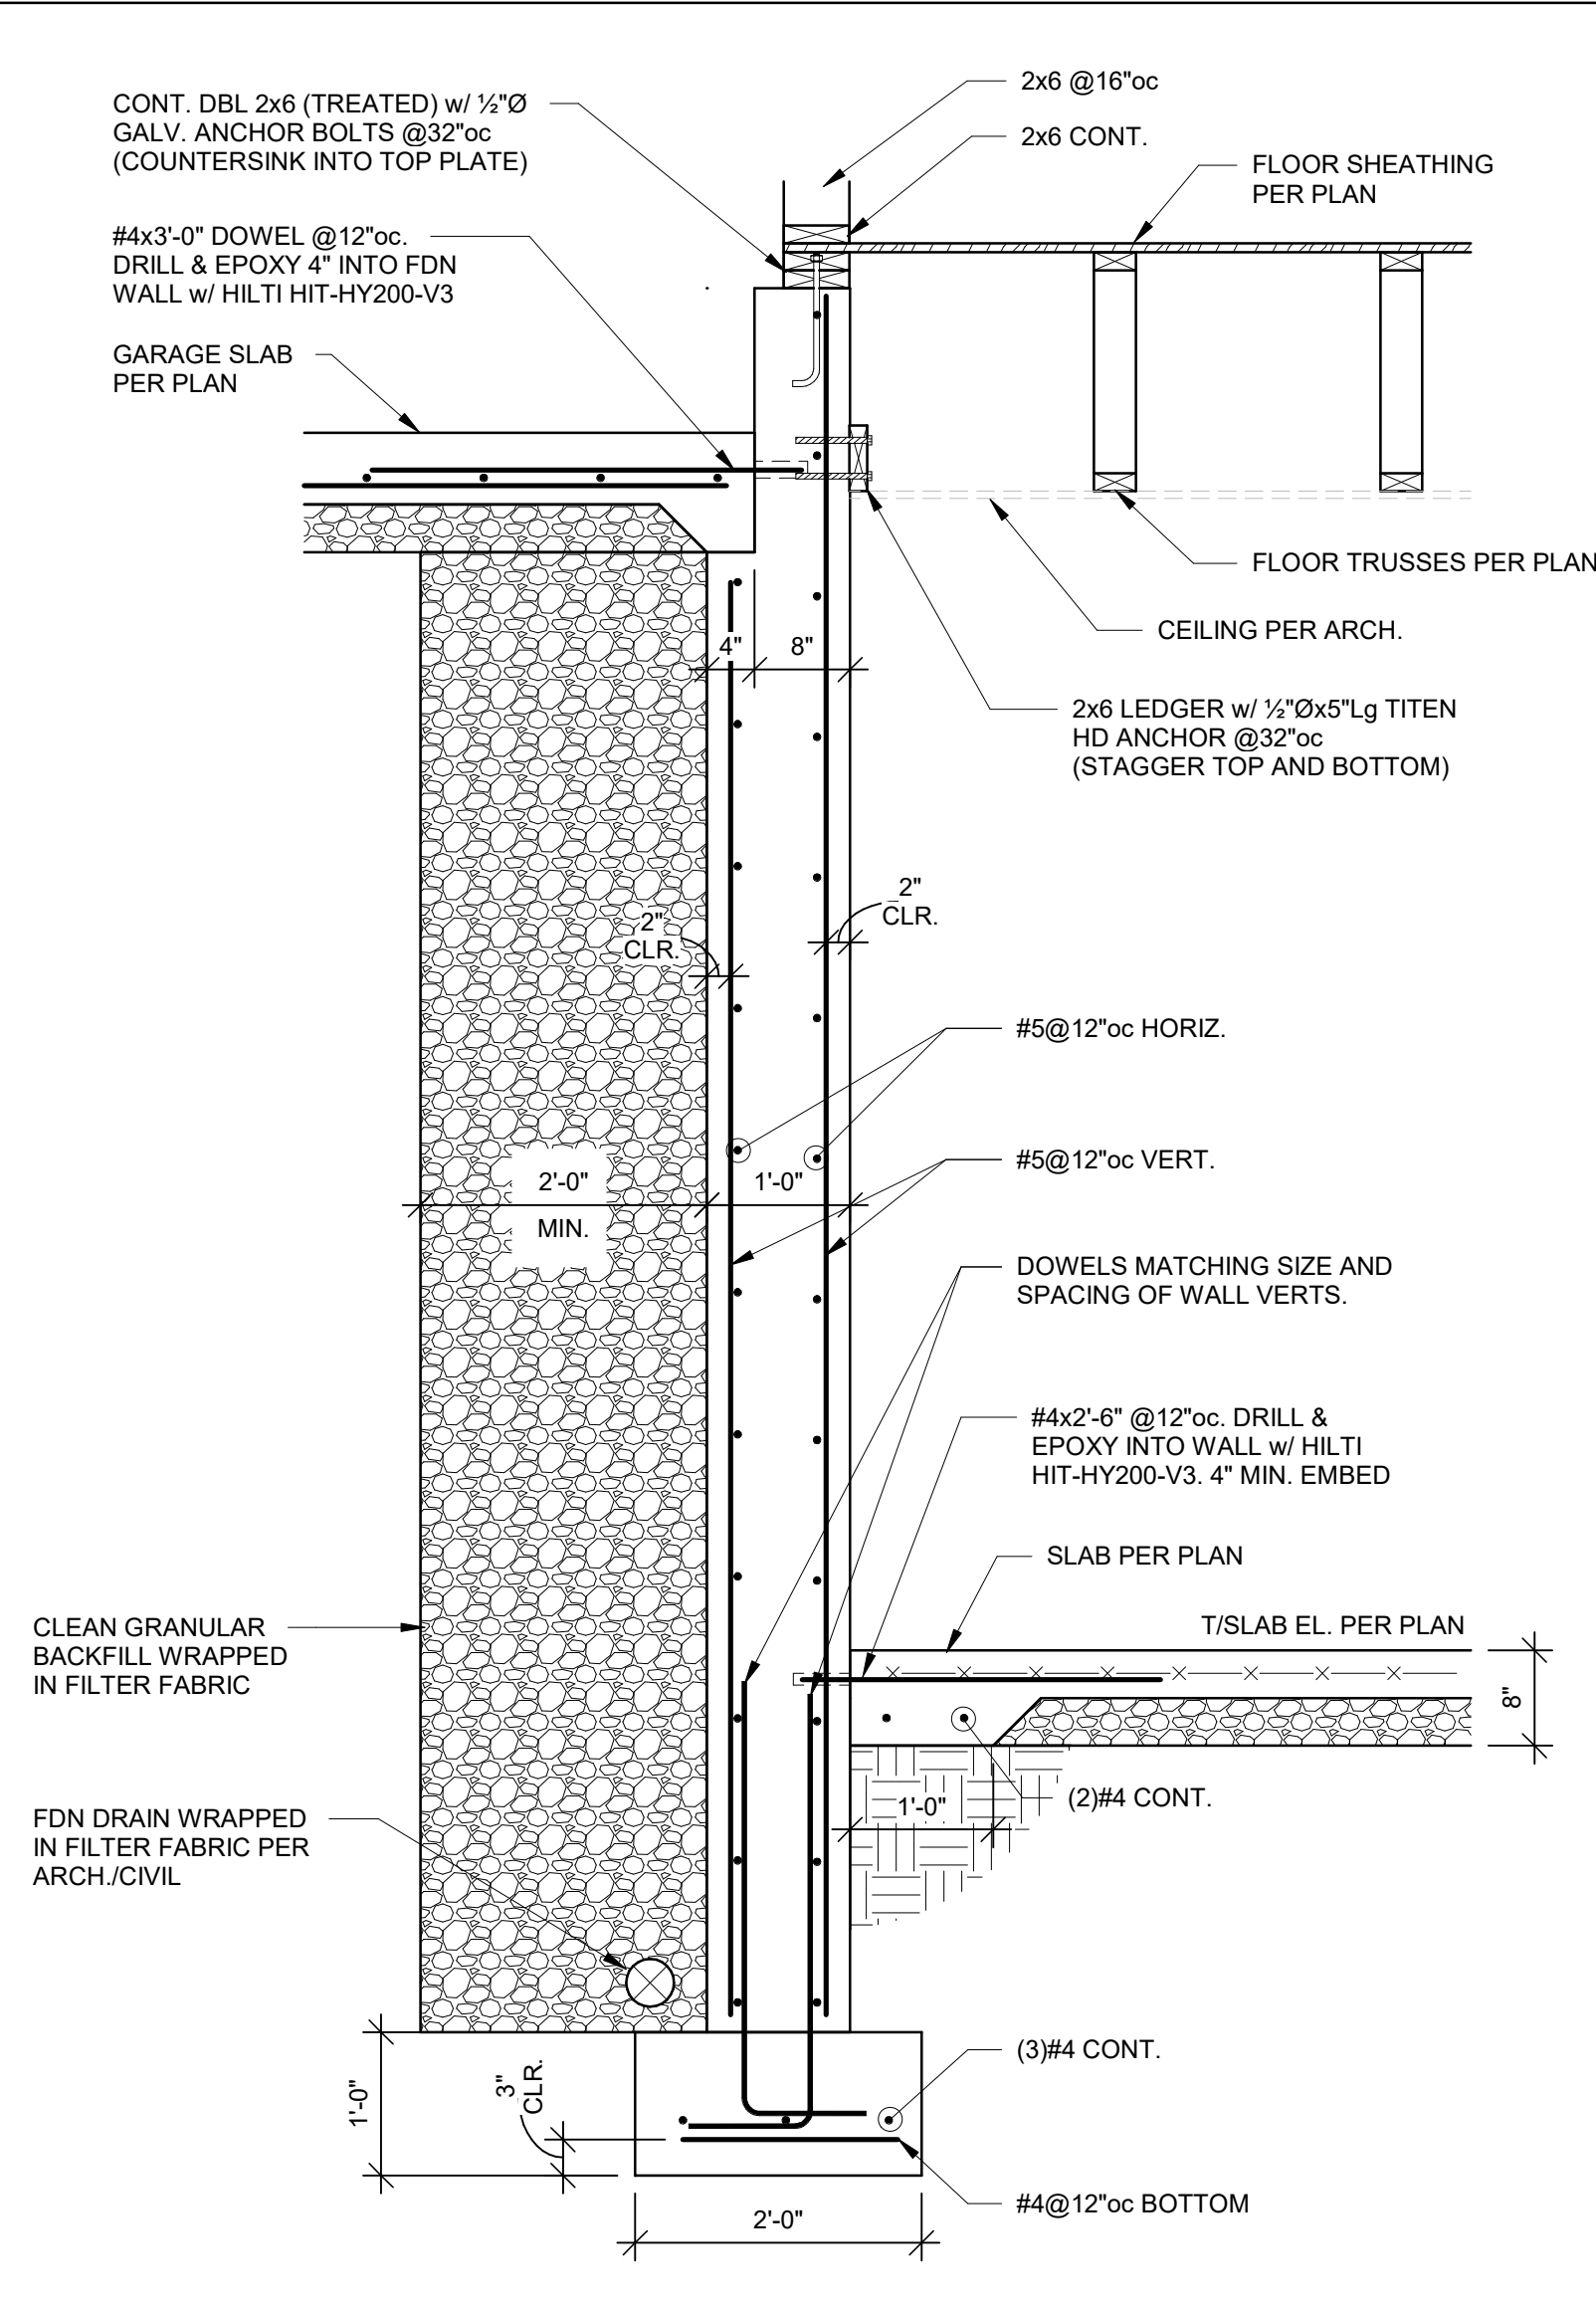


3 SECTION
3/4" = 1'-0"

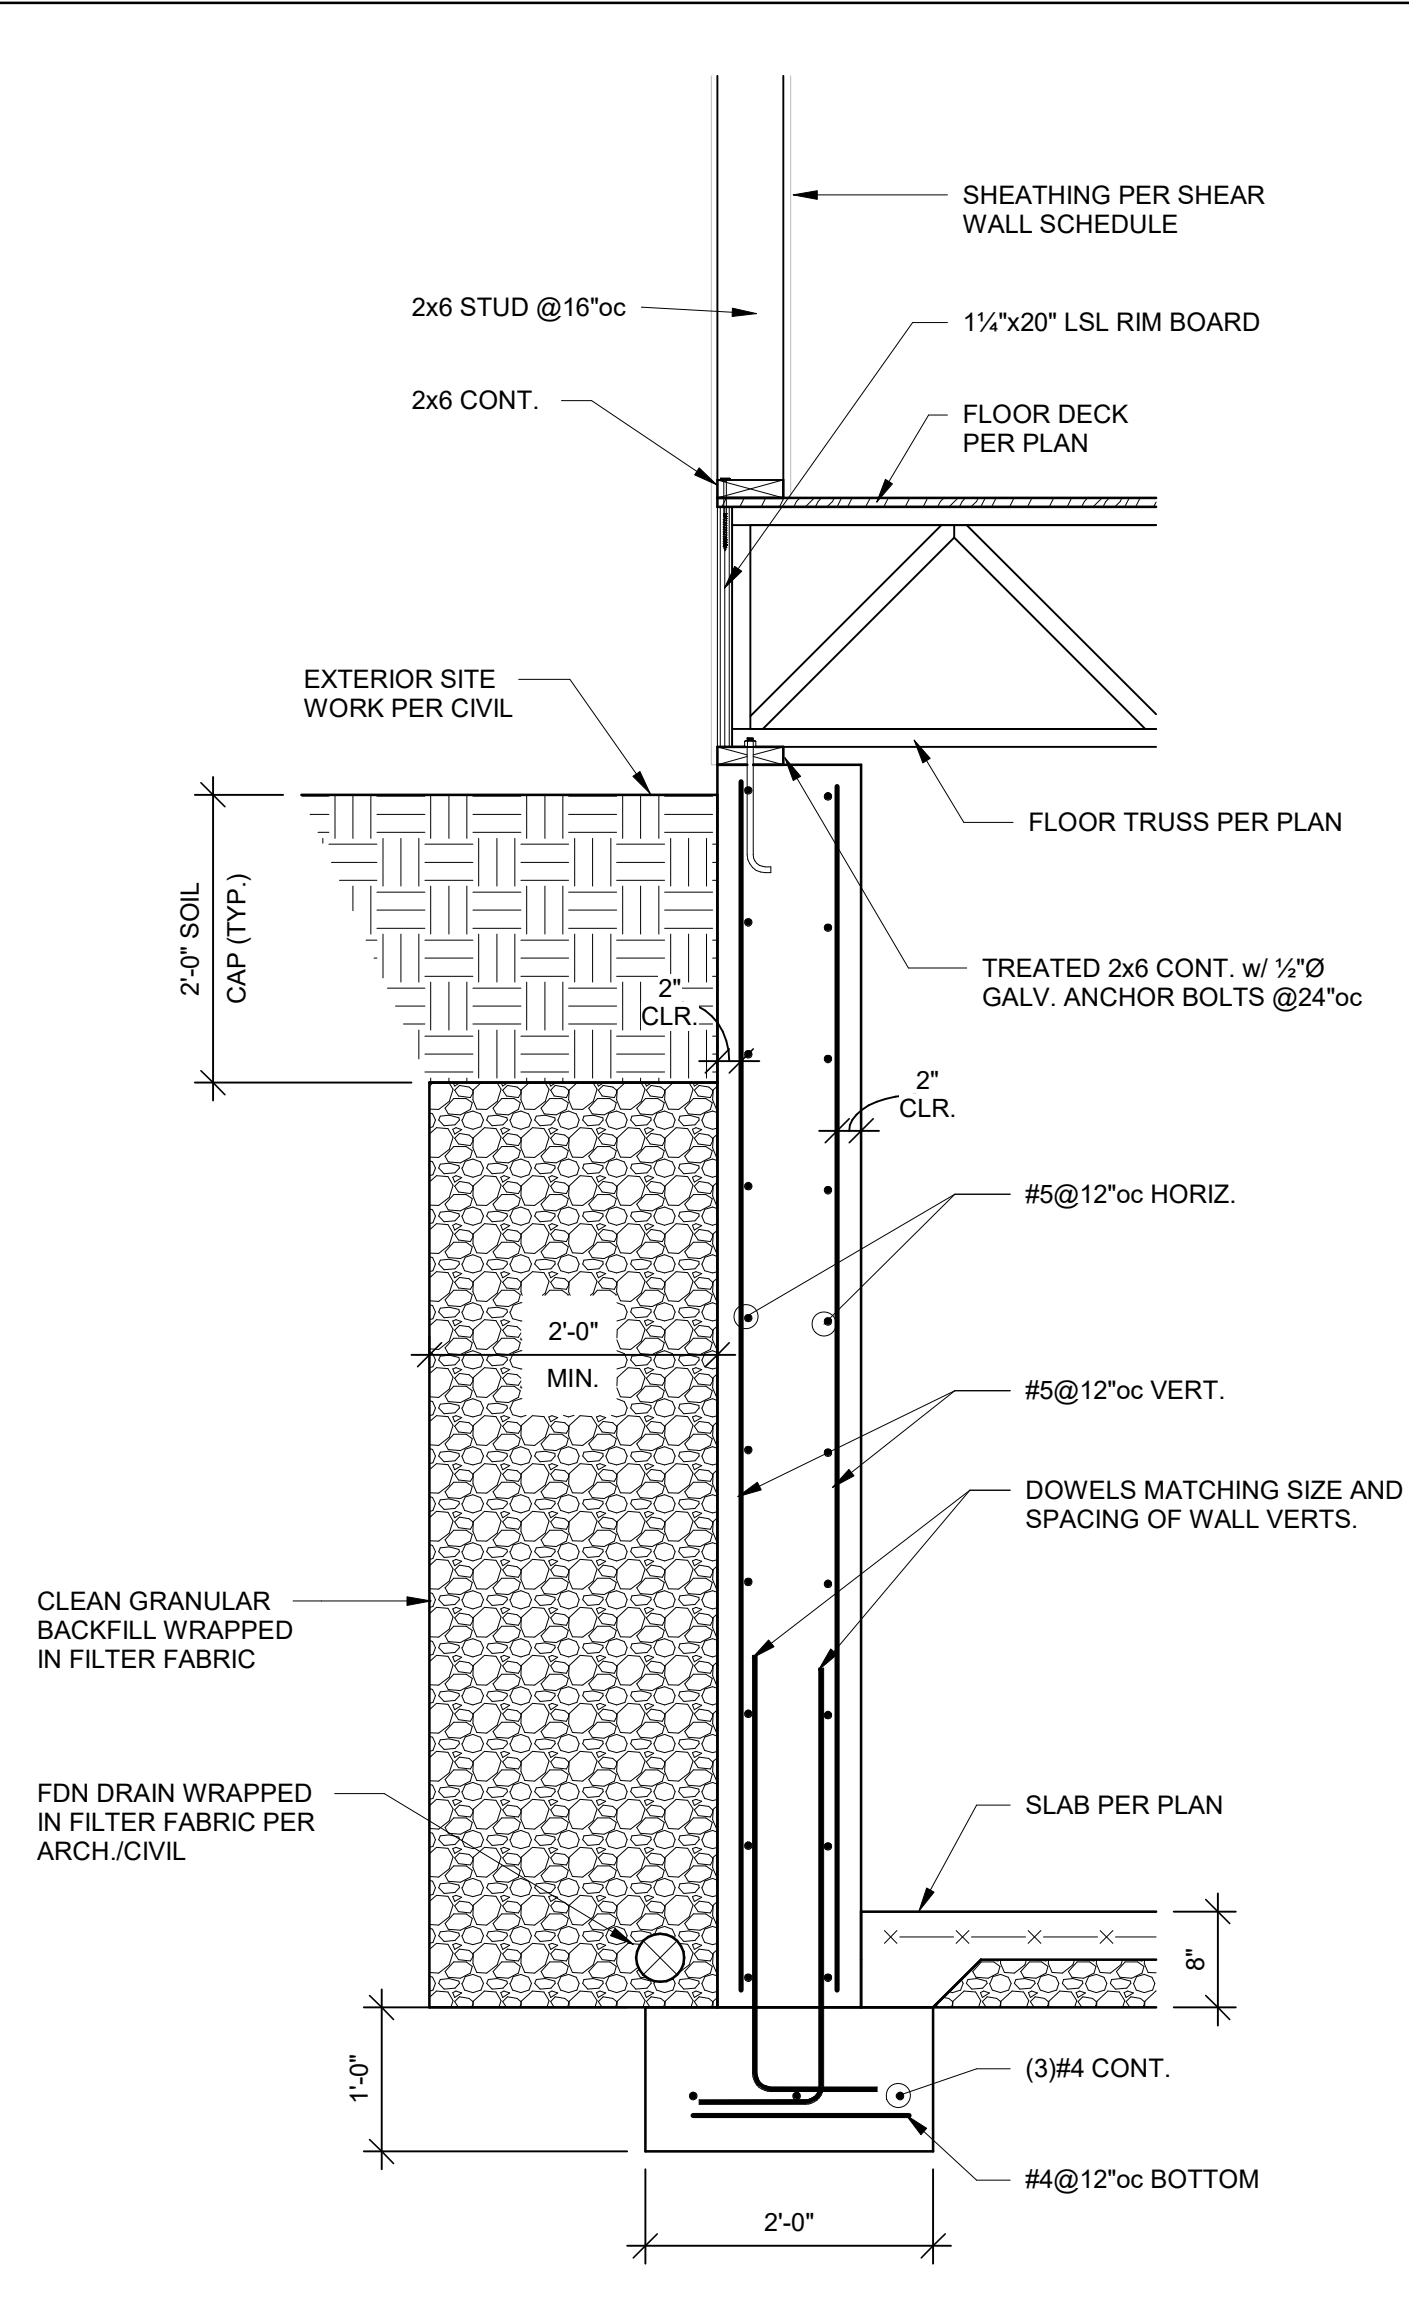

4 SECTION
3/4" = 1'-0"

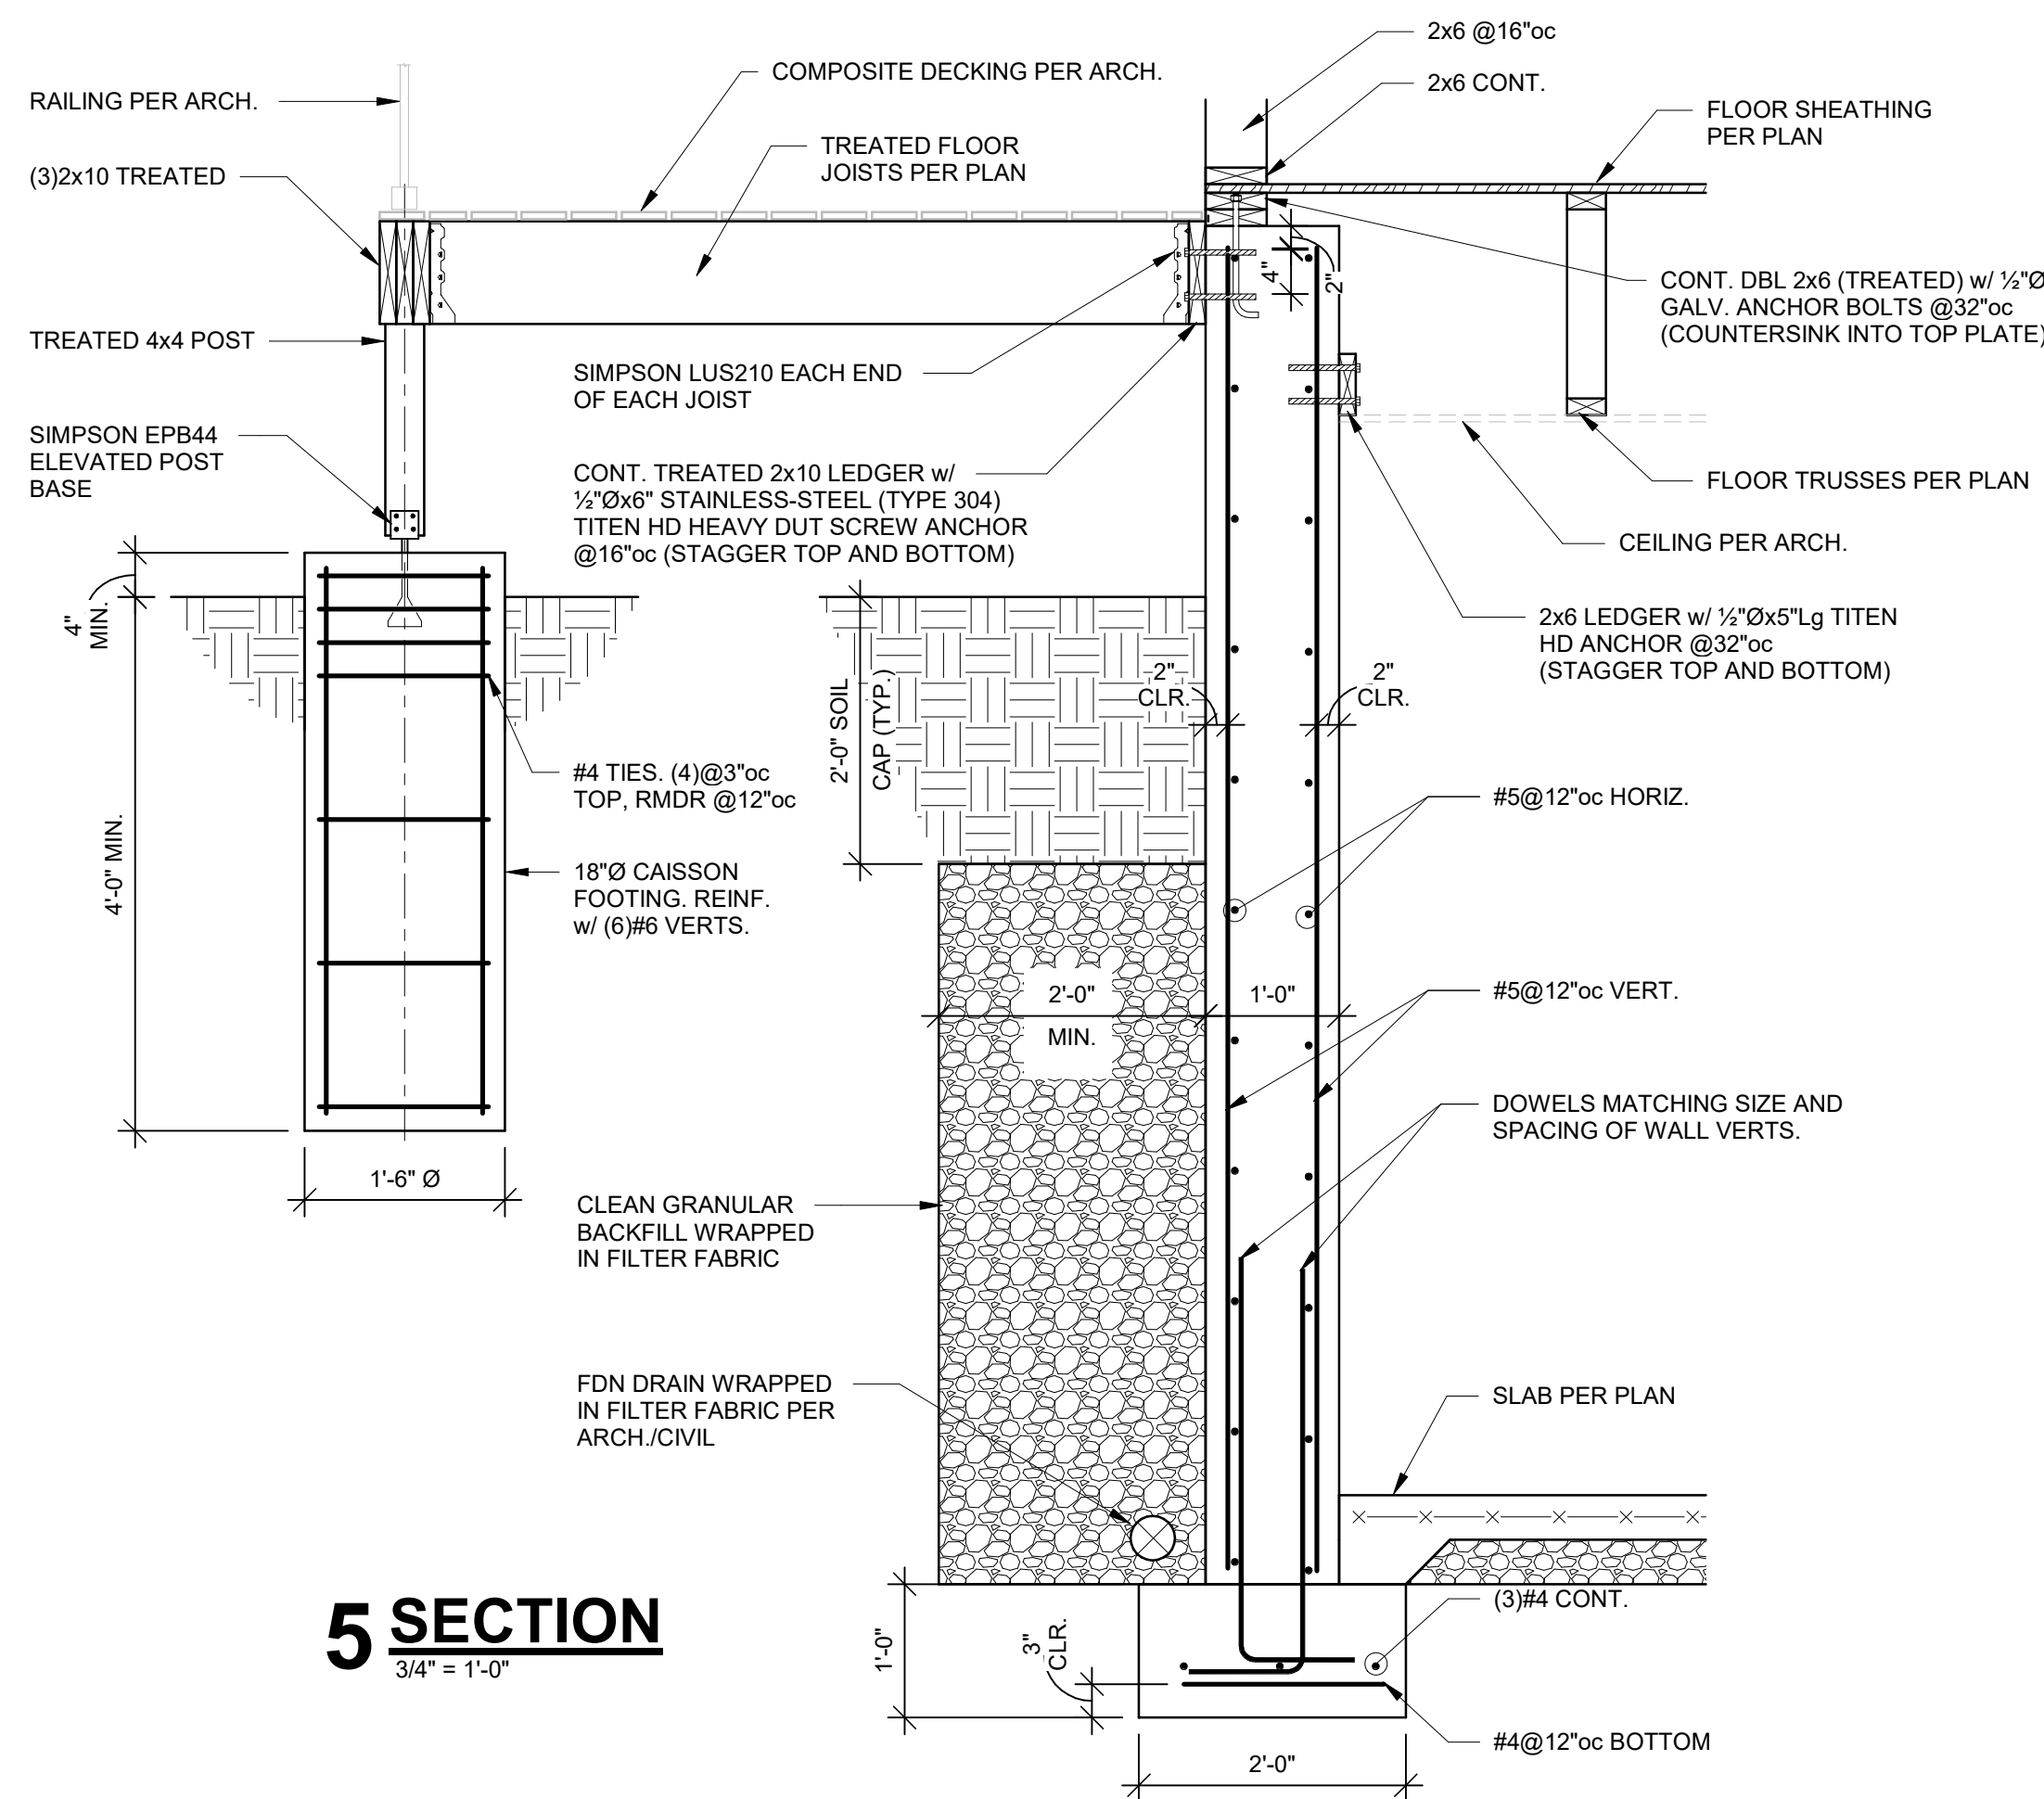

5 SECTION
3/4" = 1'-0"

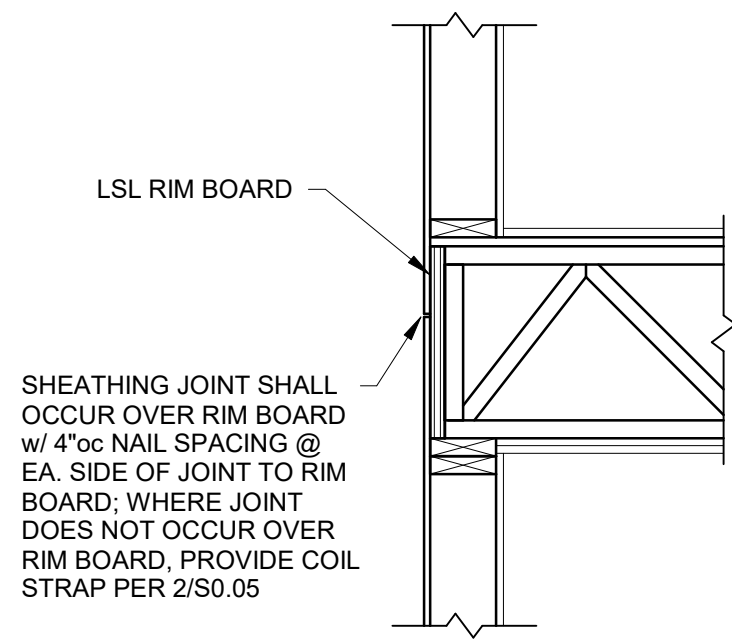


TYPICAL EXTERIOR SHEATHING JOINT

1 SECTION

3/4" = 1'-0"

NOTE: STRAPS @ CORNERS & RE-ENTRANT CORNERS REQ'D ONLY WHERE EXTERIOR SHEATHING JOINTS DO NOT OCCUR OVER CONTINUOUS LSL RIM BOARD. STRAPS SHALL BE INSTALLED TIGHT & W/OUT SLACK. DO NOT INSTALL STRAPS AT A TIME WHEN SUBFLOOR OR WALL PALTES ARE WET/DAMP DUE TO RAIN AS TEMPORARY SWELLING MAY CAUSE SLACK IN STRAPS AFTER DRYING. STRAPS MAY BE INSTALLED ON INTERIOR OF BLDG WHERE BULGING OF STRAP WOULD NEGATIVELY IMPACT EXTERIOR FINISH (STUCCO, SIDING, ETC.)

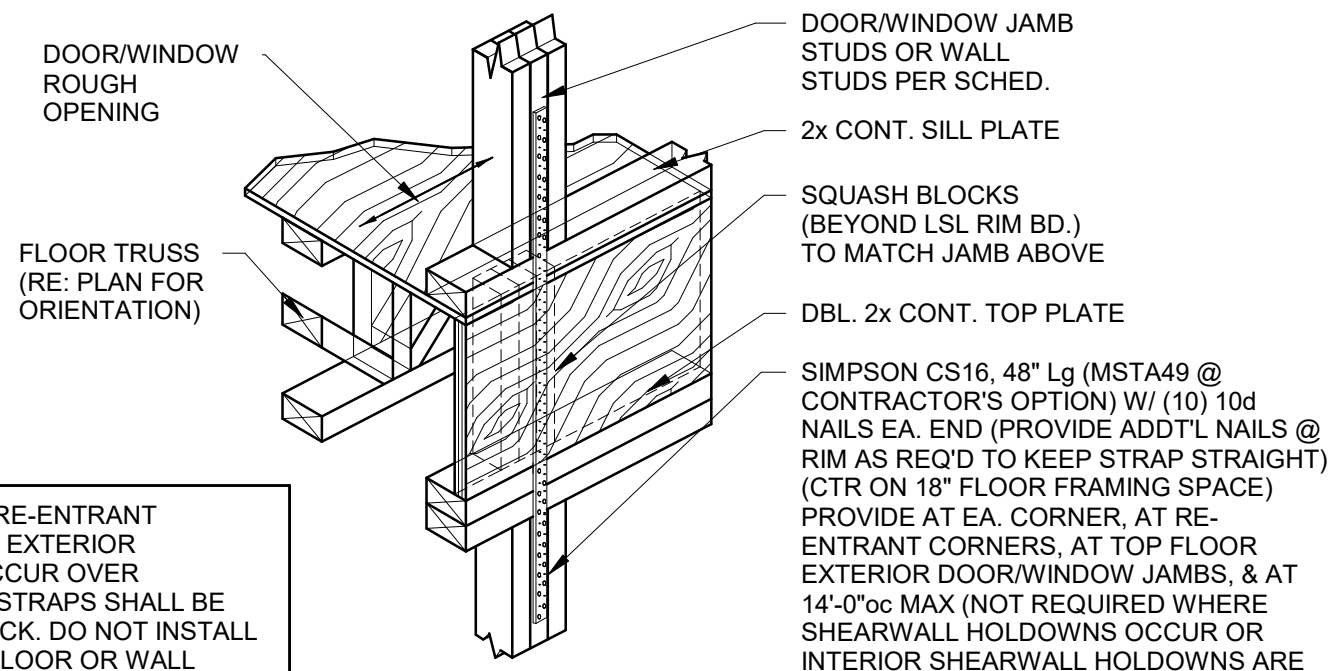


TYPICAL COIL STRAP @ EXTERIOR JAMBS SUPPORTING ROOF FRAMING AT FLOOR DIRECTLY BELOW ROOF AND FLOOR TO FLOOR TIES WHERE DETAIL 1/S0.05 IS NOT FOLLOWED

2 SECTION

3/4" = 1'-0"


NOTE: USE DETAIL 2A/S0.05 IN LIEU OF STRAPS @ CONTRACTORS OPTION

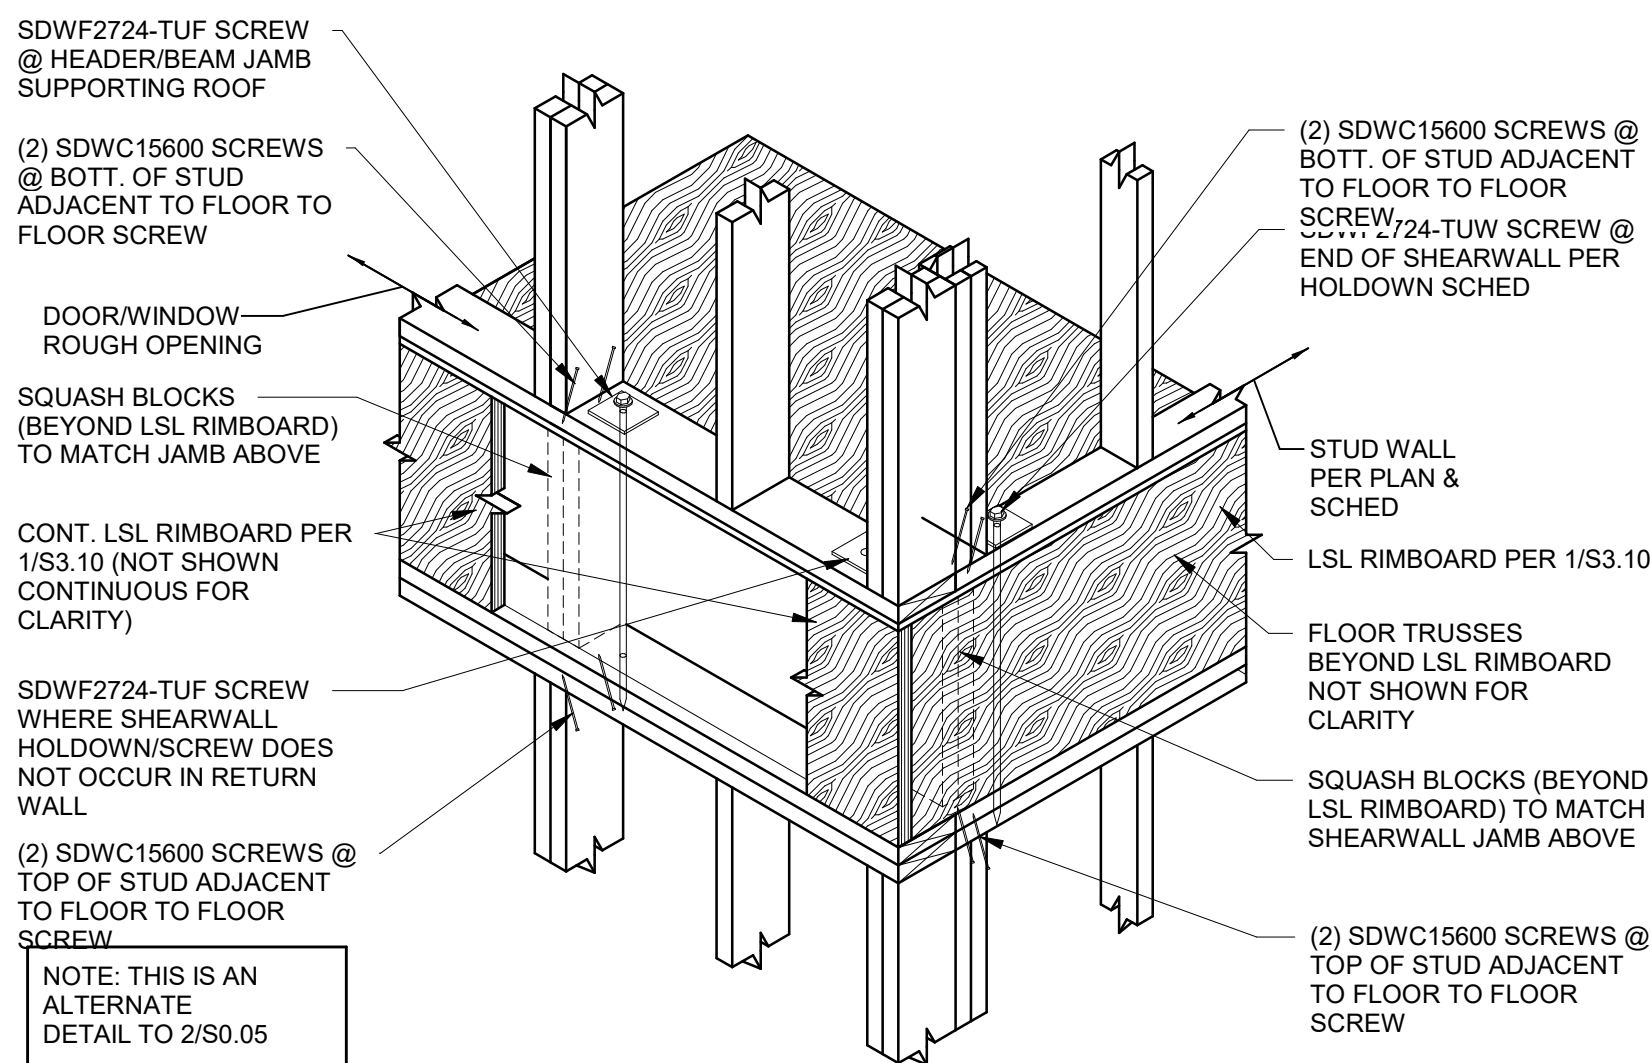

TYPICAL FLOOR-TO-FLOOR SCREW @ EXTERIOR JAMBS SUPPORTING ROOF FRAMING AT FLOOR DIRECTLY BELOW ROOF AND FLOOR TO FLOOR TIES WHERE DETAIL 1/S0.05 IS NOT FOLLOWED

2A SECTION


3/4" = 1'-0"

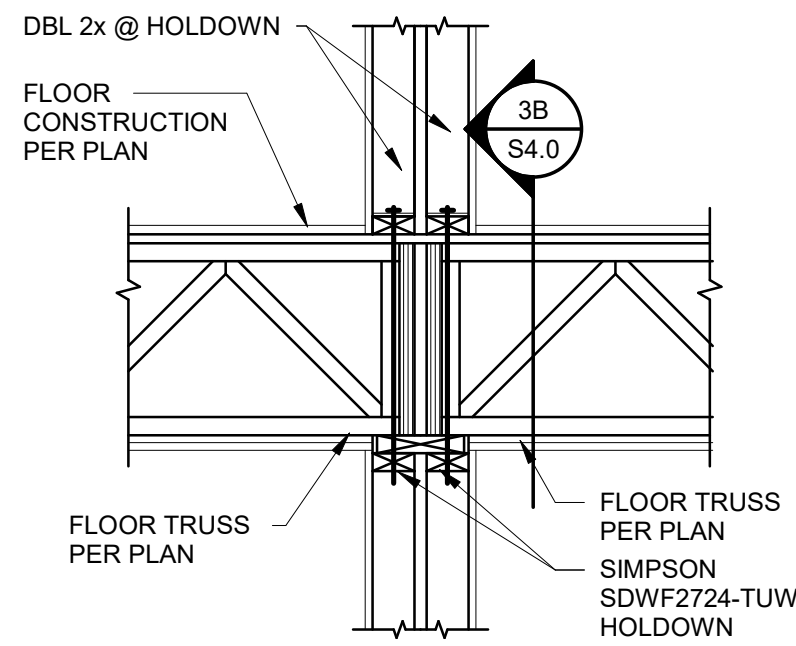

TYPICAL UNIT UPLIFT HOLDOWN DETAIL @ TOP FLOOR ROOF TRUSS BEARING WALLS

3 SECTION

3/4" = 1'-0"

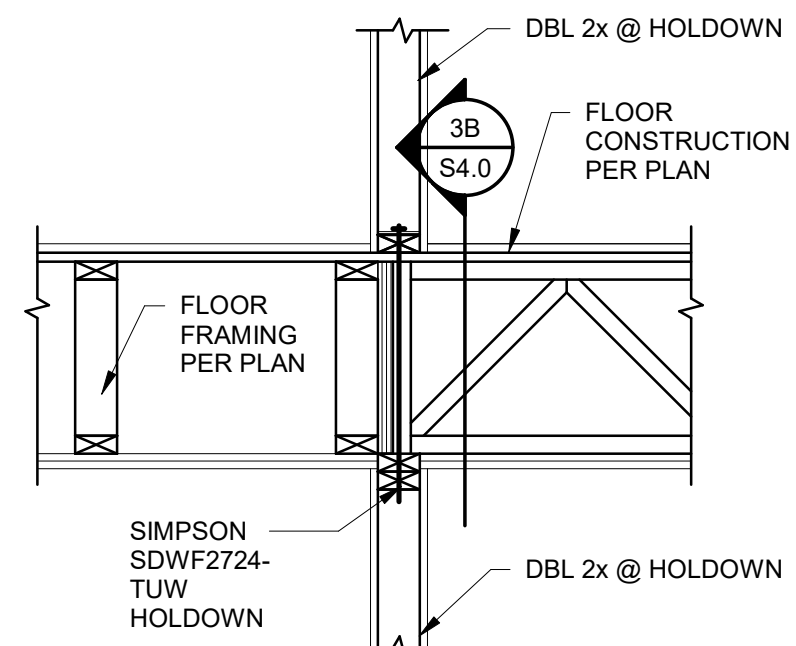


TYPICAL UNIT UPLIFT HOLDOWN DETAIL @ TOP FLOOR ROOF TRUSS BEARING WALLS

3A SECTION

3/4" = 1'-0"

PROVIDE UNIT UPLIFT HOLDOWNS @ 48"OC MAX @ LOAD BEARING INTERIOR WALLS SUPPORTING ROOF TRUSSES. HOLDOWNS SHALL BE PROVIDED WITHIN 6" OF JAMBS OF ALL INTERIOR LOAD BEARING ROOF OF HEADERS & GIRDER TRUSS BEARING AND WITHIN 48" OF SHEARWALL HOLDOWNS


SIMPSON SDWC15600 @ EA. STUD ADJACENT TO SDWF SCREW USE TEMPLATE FOR 22 DEG INSTALLATION

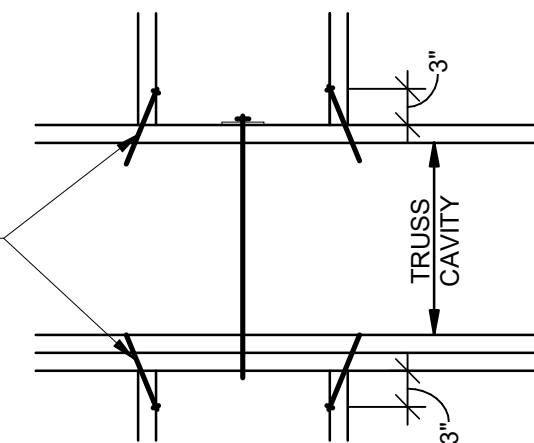

TYP SIDE VIEW AT DBL STUD SCREWS AT HOLDOWN

3B DETAIL


3/4" = 1'-0"

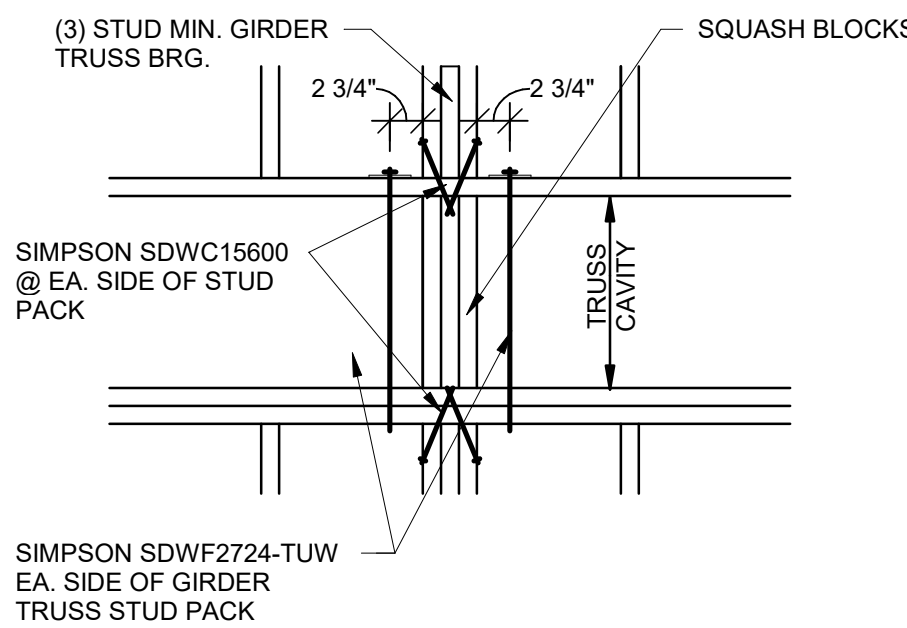

TYPICAL GIRDER TRUSS UPLIFT HOLDOWN DETAIL @ TOP FLOOR

4 SECTION


3/4" = 1'-0"

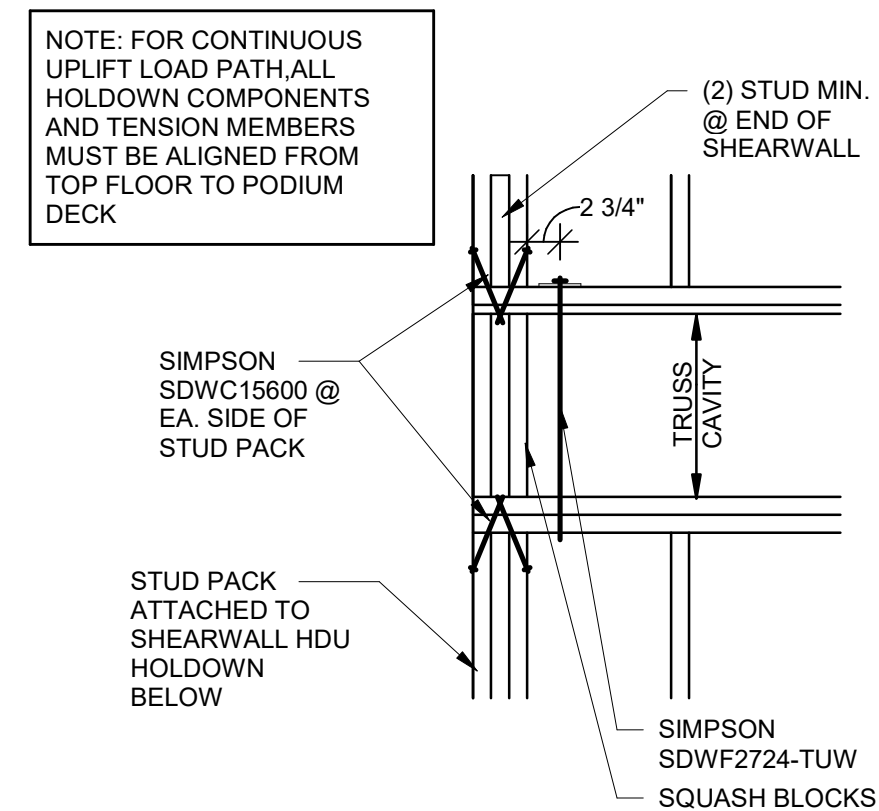

ALTERNATE FLOOR TO FLOOR TIE-DOWN AT END OF WALL

5 SECTION

3/4" = 1'-0"

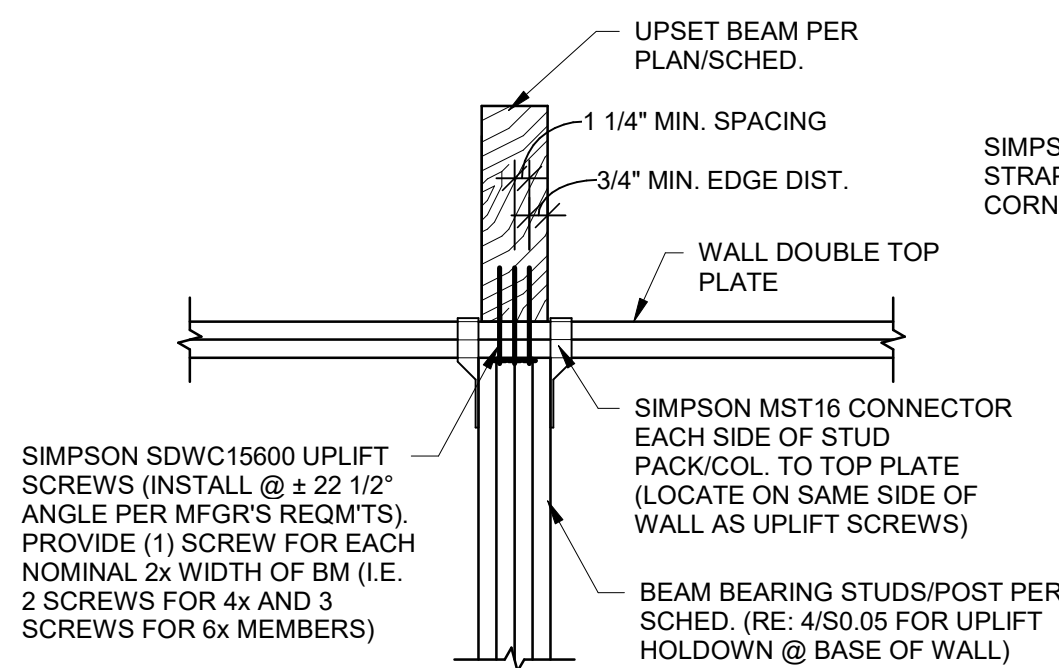


TYPICAL AT PERPENDICULAR WALL


TYPICAL UPSET WOOD BEAM UPLIFT HOLDOWN AT BEAMS SUPPORTING ROOF TRUSS BEARING WALLS OR WHERE INDICATED

6 SECTION


3/4" = 1'-0"

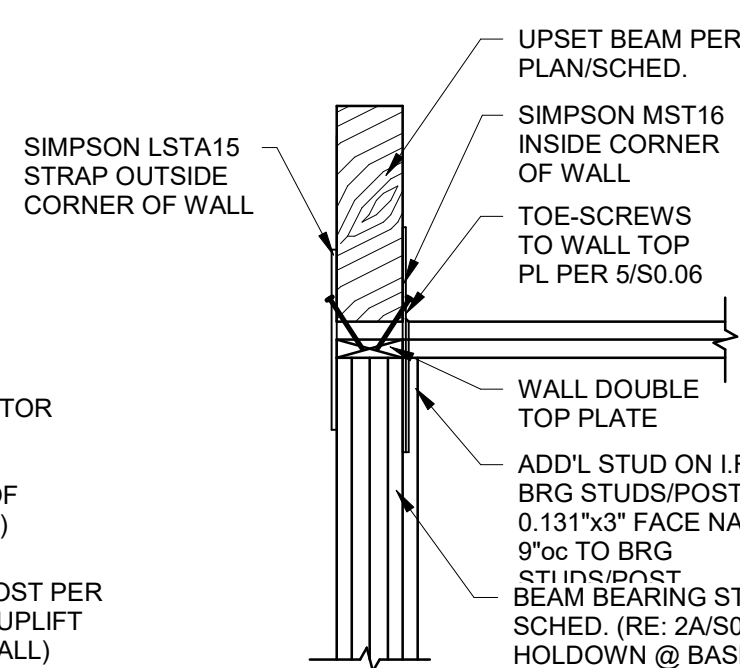

TYPICAL AT WALL CORNERS

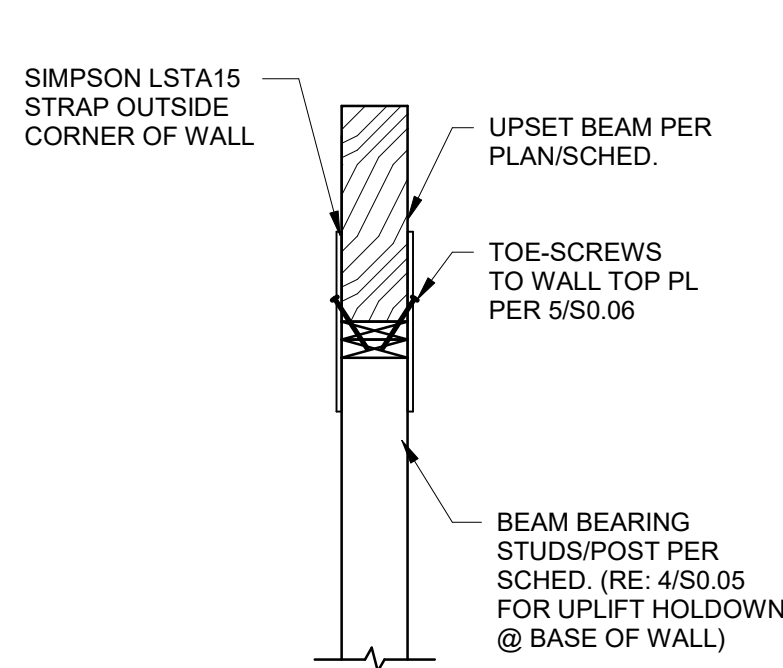


TYPICAL AT PARALLEL WALL

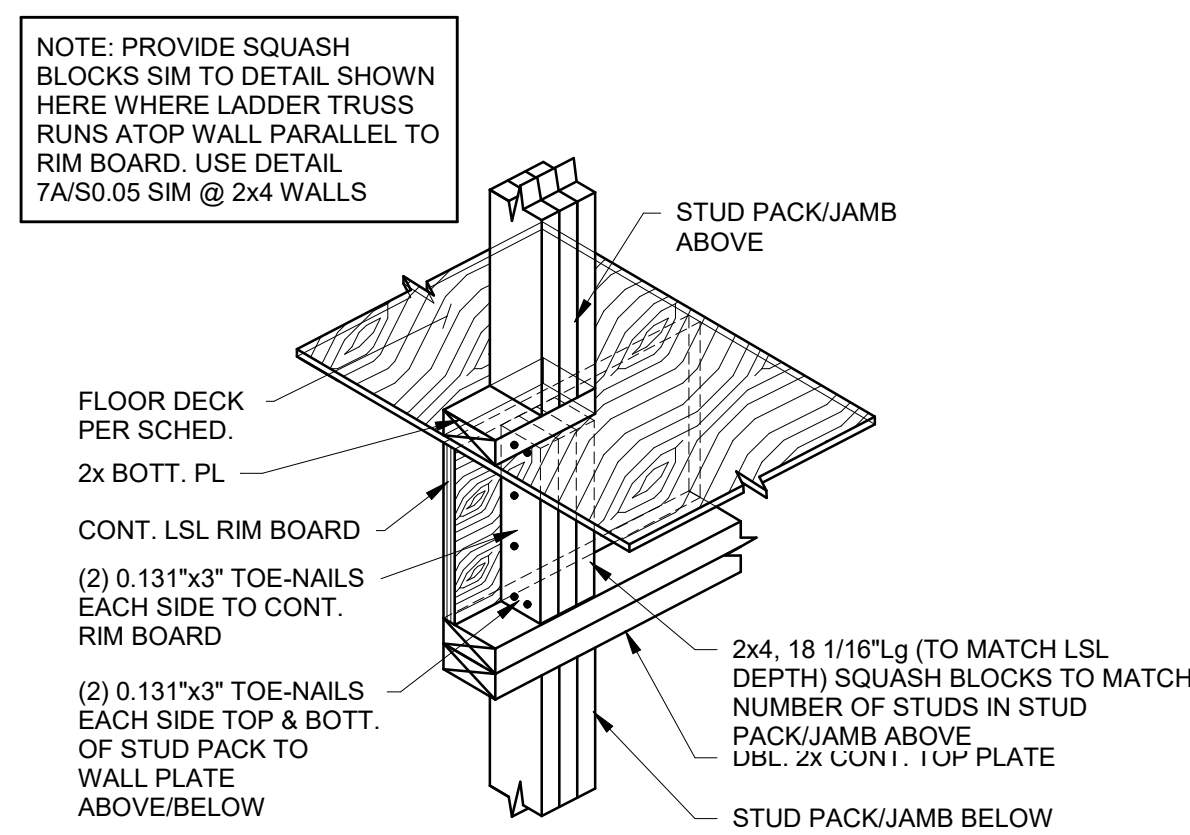

TYPICAL SQUASH BLOCK DETAIL AT CONTINUOUS RIM BOARD

7 SECTION


3/4" = 1'-0"

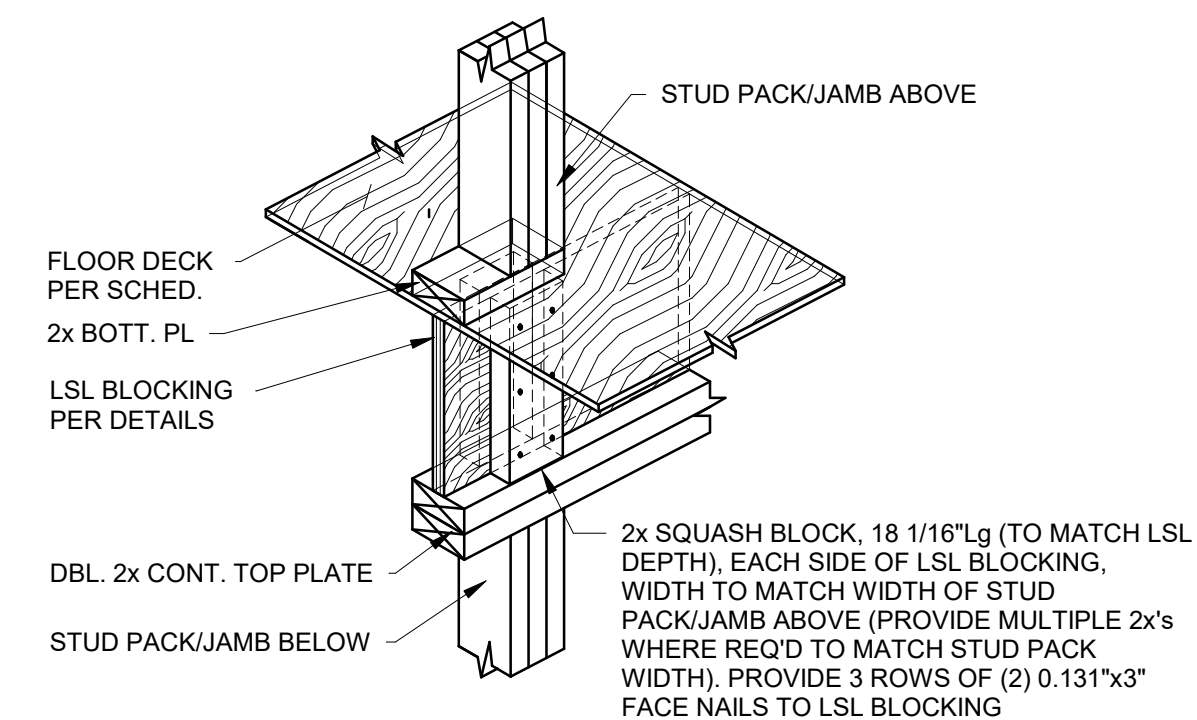


TYPICAL SQUASH BLOCK DETAIL AT LSL BLOCKING

7A SECTION


3/4" = 1'-0"

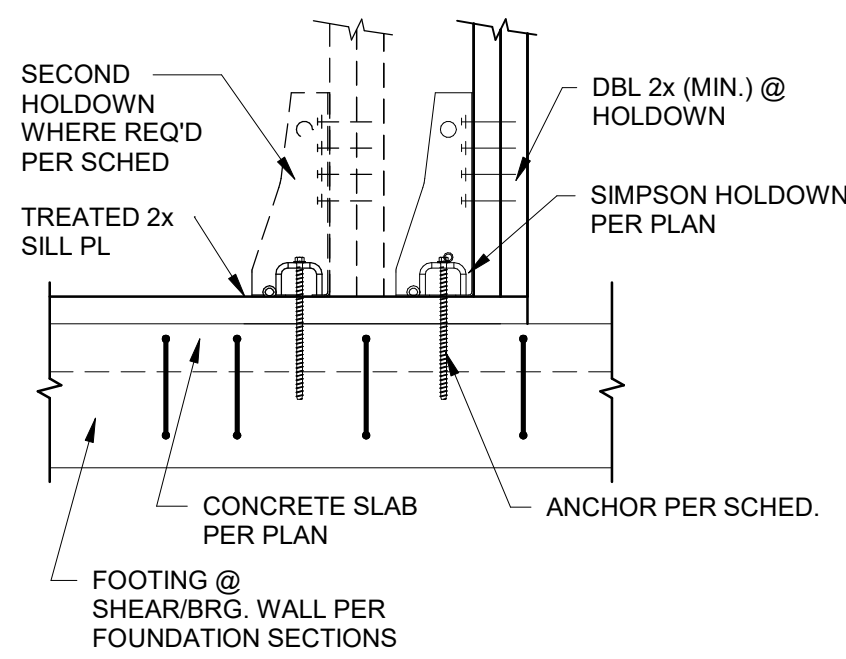


1 SECTION
3/4" = 1'-0"

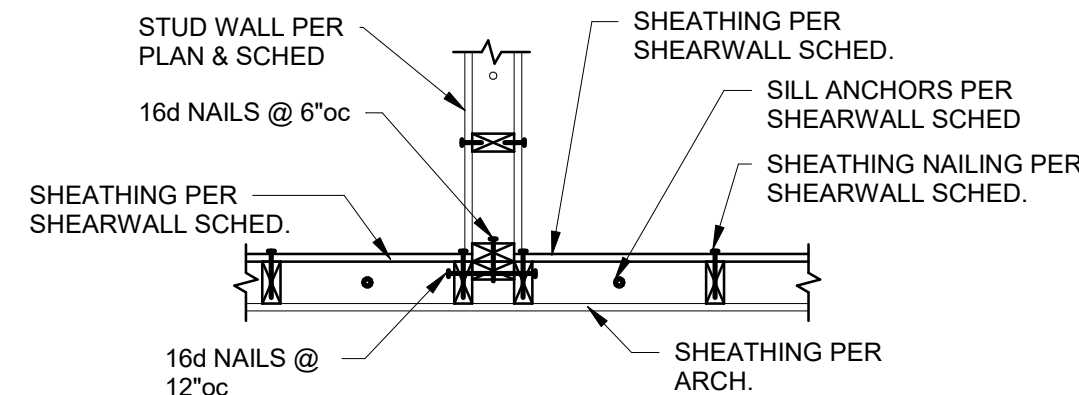


TYPICAL @ DISCONTINUOUS SHEARWALL SHEATHING

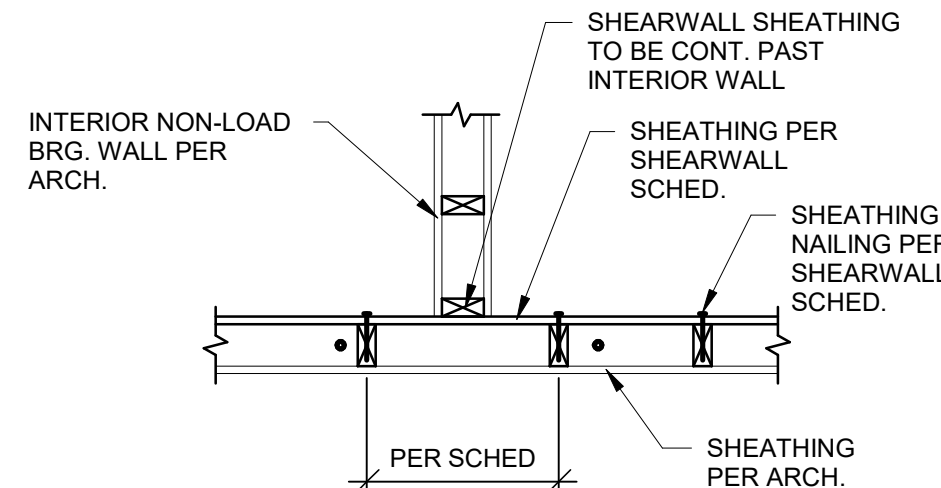


TYPICAL @ SHEARWALL SHEATHING CONTINUOUS PAST NON-LOAD BRG WALL

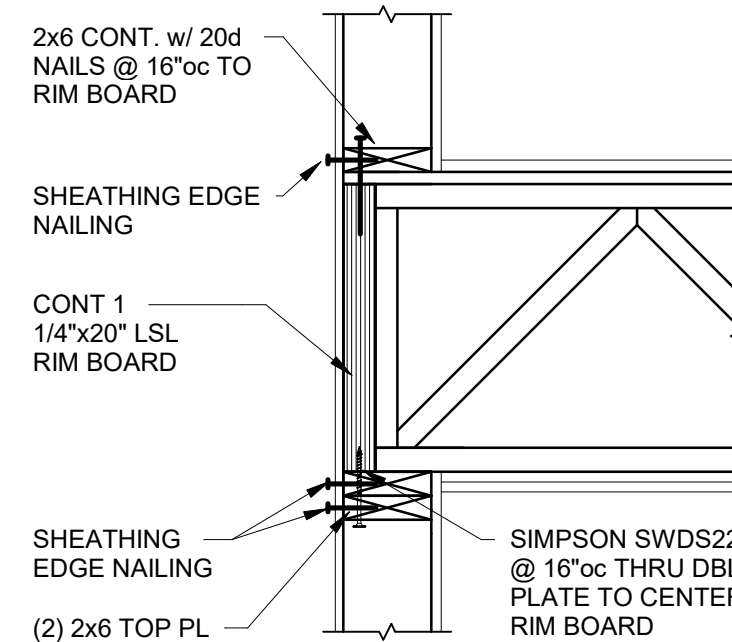

TYPICAL LATERAL NAILING AT EXTERIOR WALL WITH TRUSS BEARING

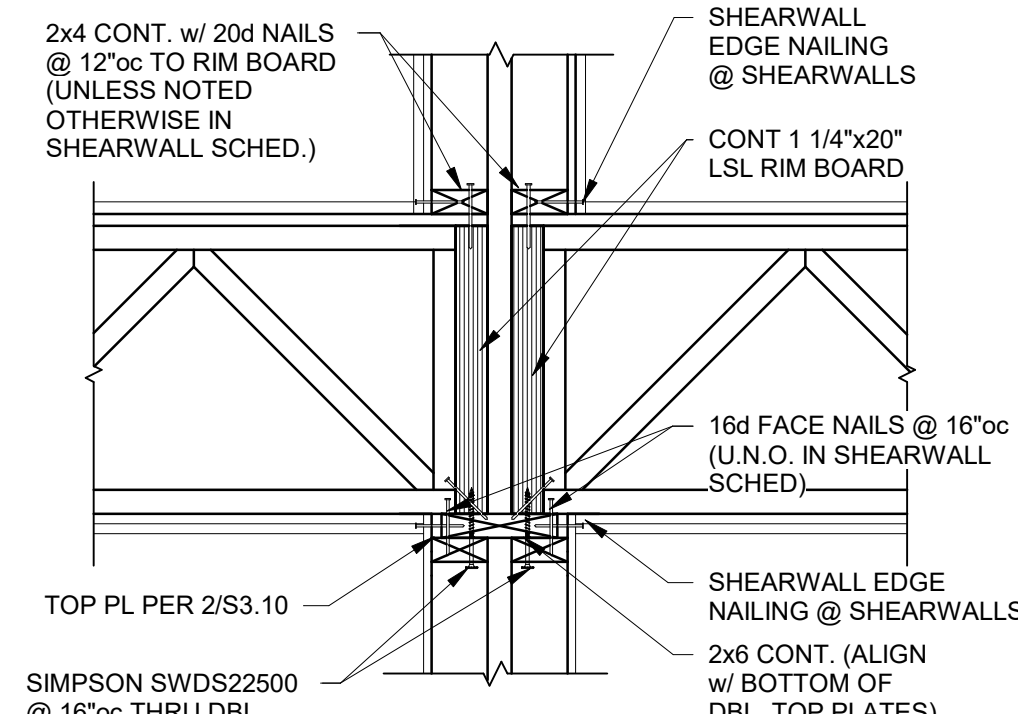


TYPICAL LATERAL NAILING AT DOUBLE UNIT DEMISING WALLS WITH TRUSS BEARING

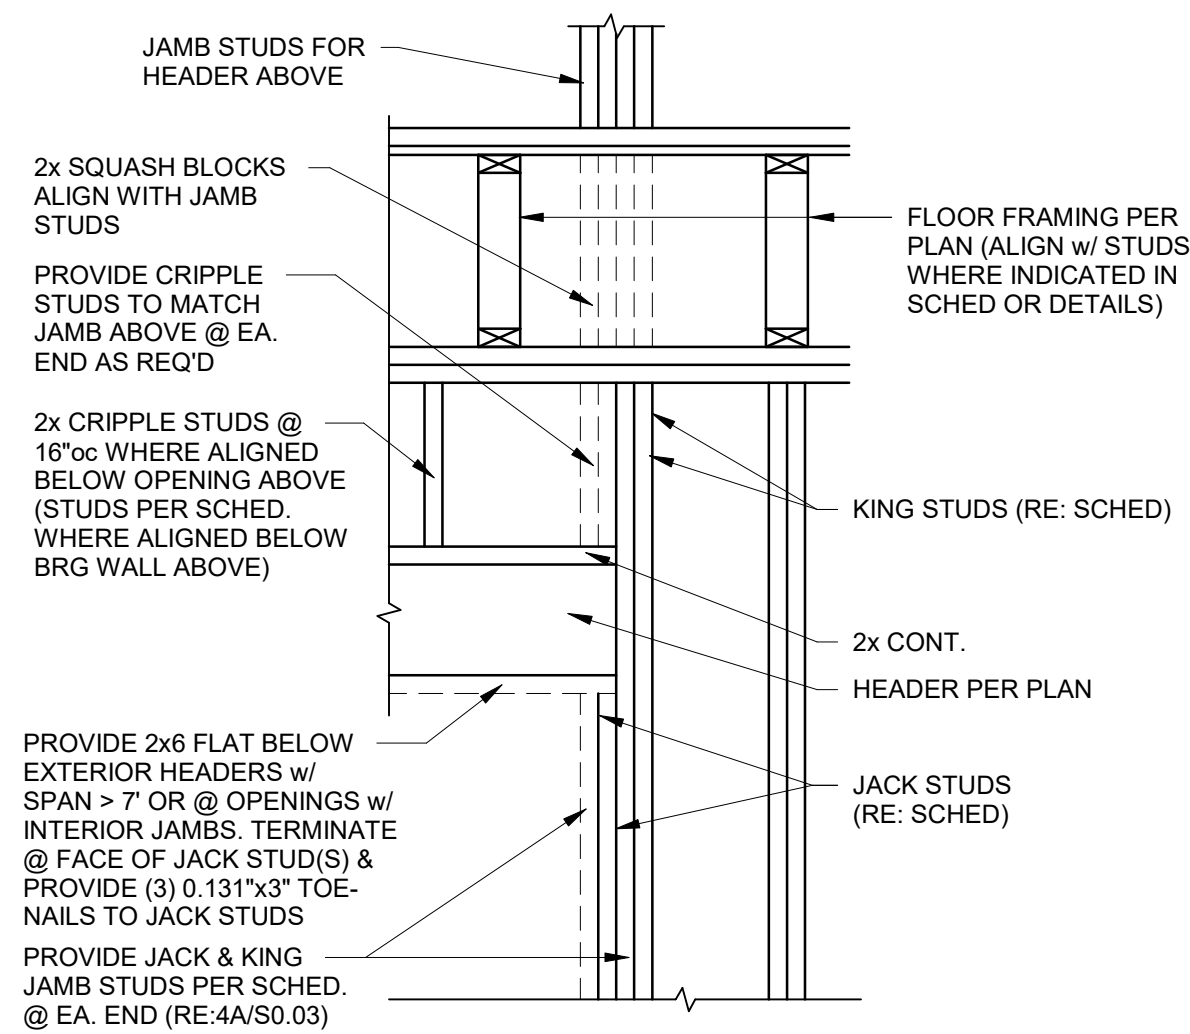


TYPICAL HEADER DETAIL

6 SECTION
3/4" = 1'-0"

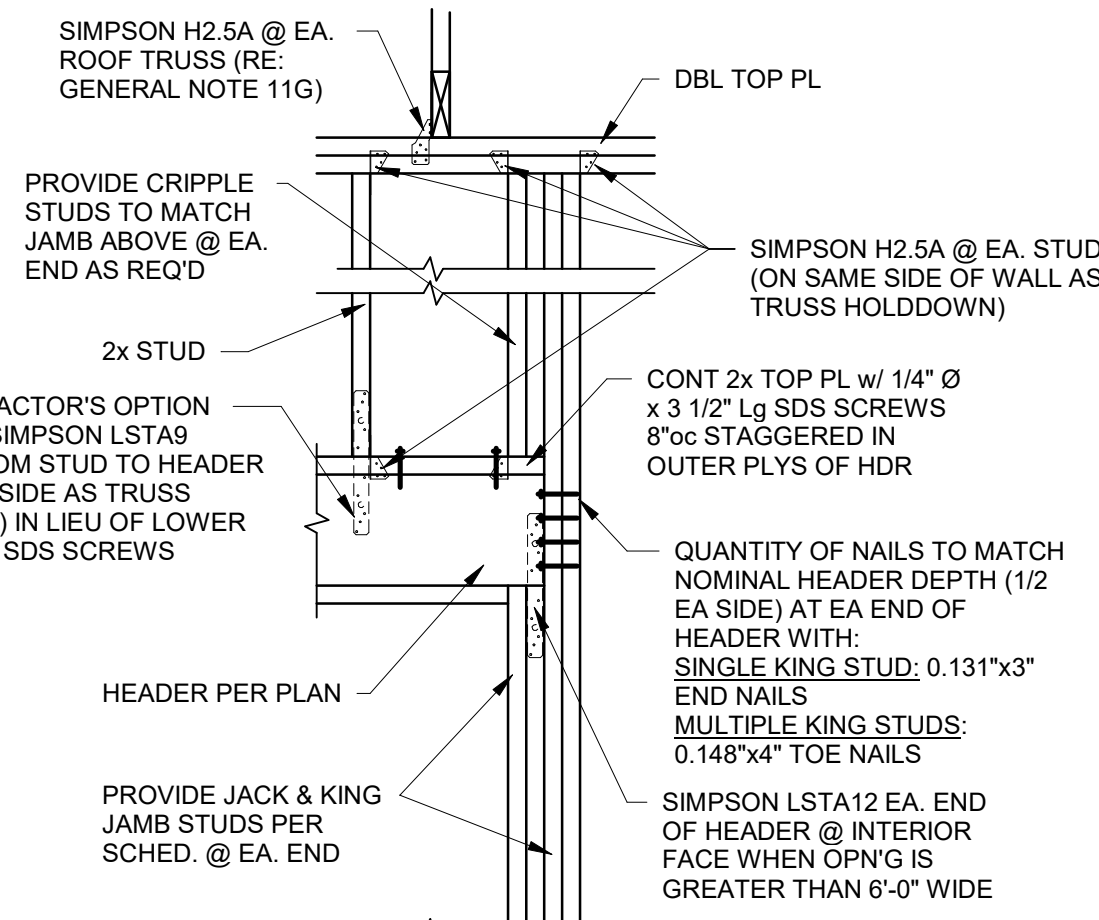


TYPICAL HEADER DETAIL @ ROOF TRUSS BRG LOCATIONS

7 SECTION
3/4" = 1'-0"

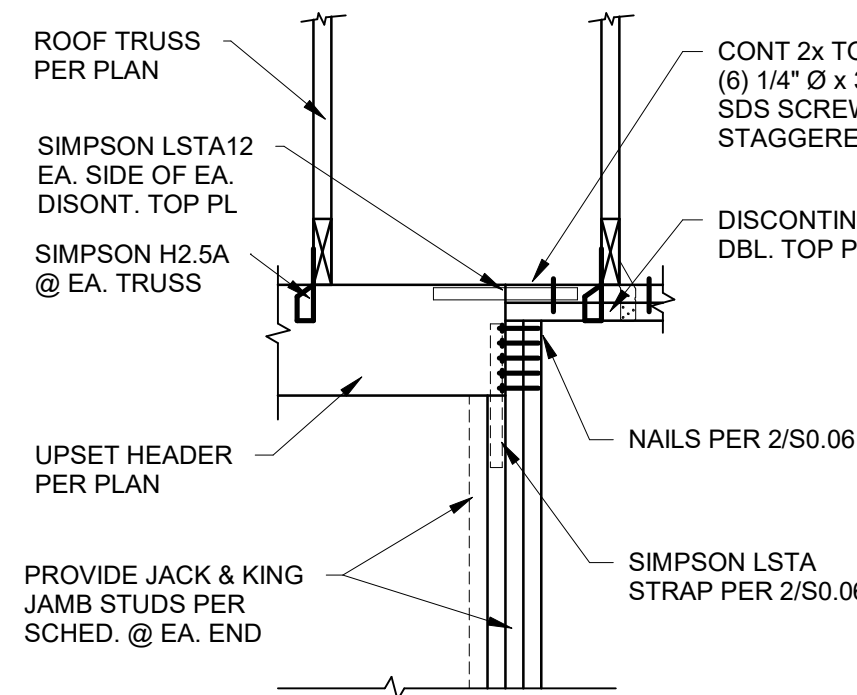


TYPICAL HEADER DETAIL AT DISCONTINUOUS TOP PLATE AT ROOF

8 SECTION
3/4" = 1'-0"

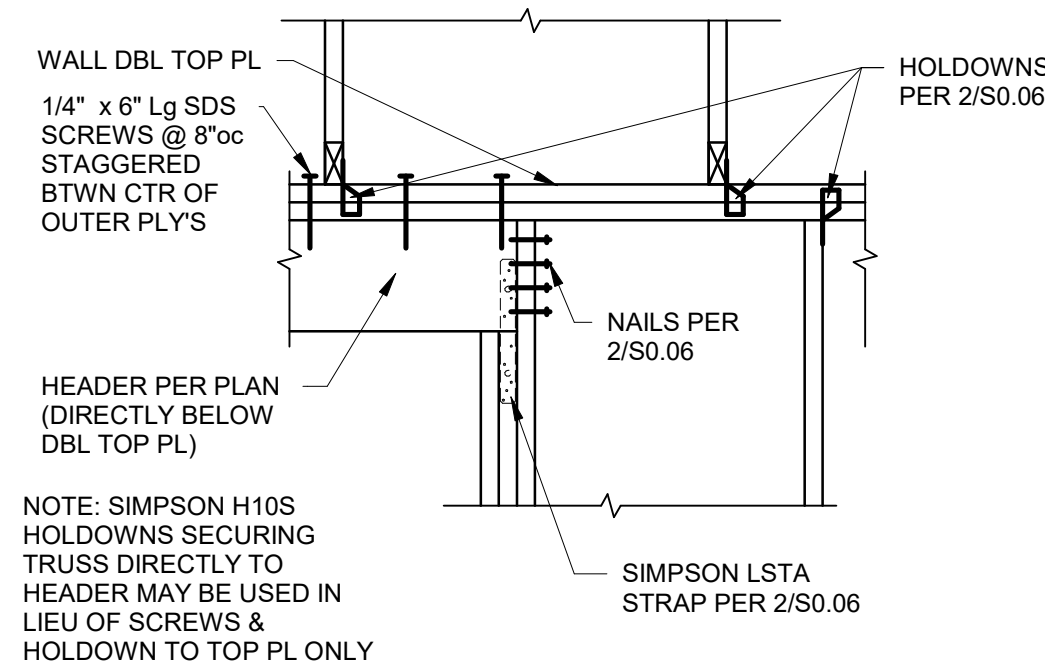


TYPICAL HEADER DETAIL AT ROOF TRUSS BRG LOCATIONS w/HEADER DIRECTLY BELOW DBL TOP PL

9 SECTION
3/4" = 1'-0"

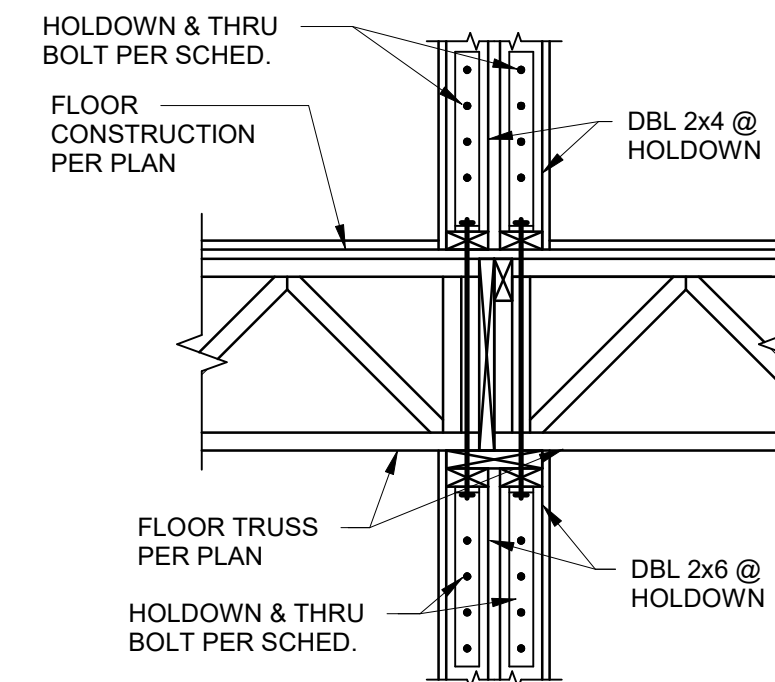


TYP HOLDOWN DETAIL

10 DETAIL
3/4" = 1'-0"

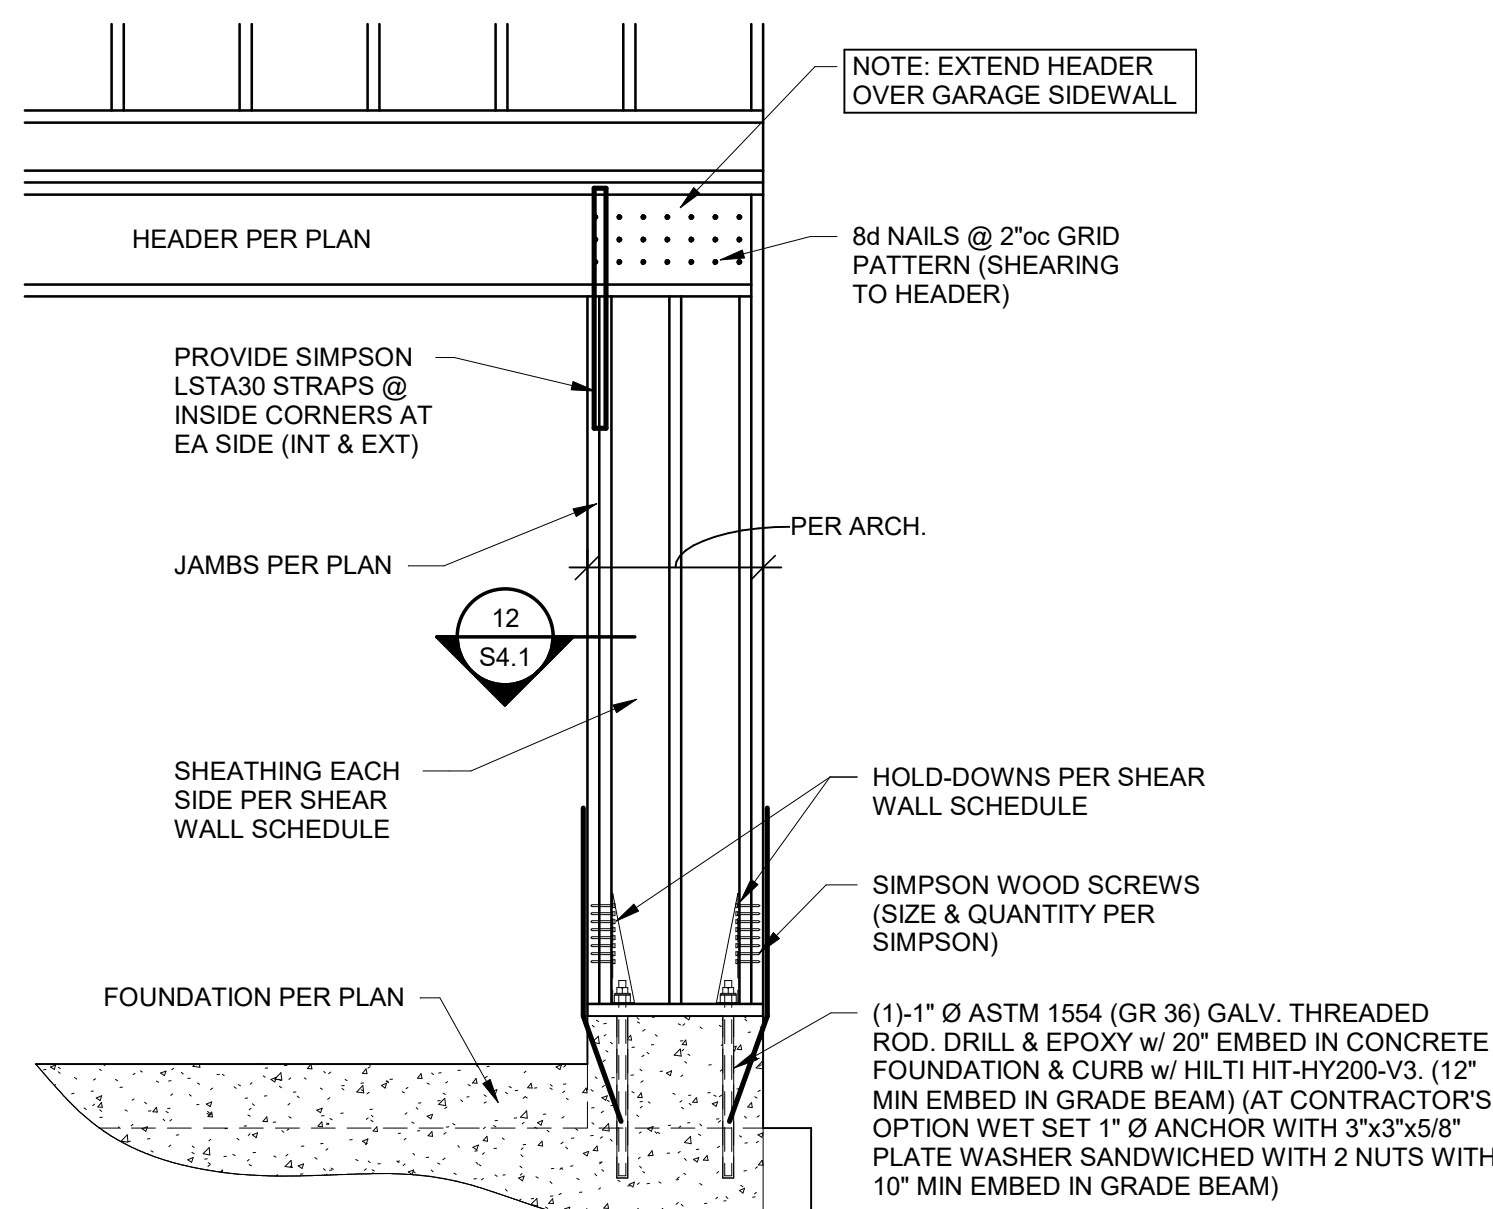


GARAGE PORTAL FRAMING DETAIL

11 DETAIL
1/2" = 1'-0"

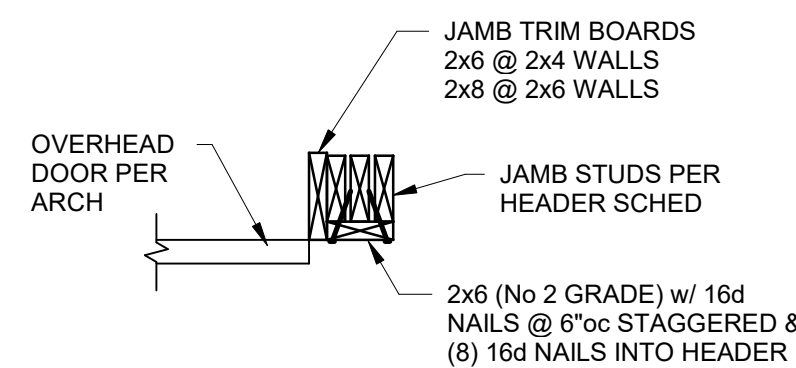


TYP GARAGE SILL DETAIL

12 DETAIL
3/4" = 1'-0"

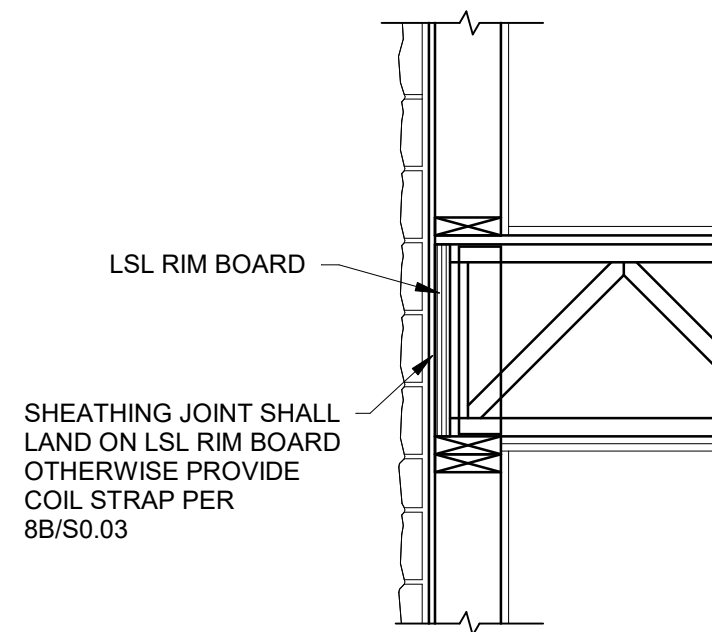


TYPICAL EXTERIOR SHEATHING JOINT

13 DETAIL
3/4" = 1'-0"

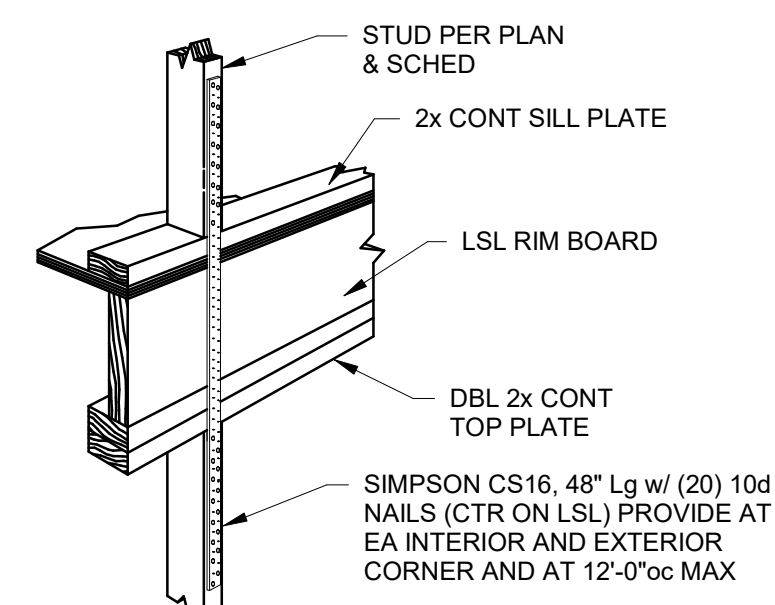


TYP COIL STRAP AT EXTERIOR


14 DETAIL
3/4" = 1'-0"

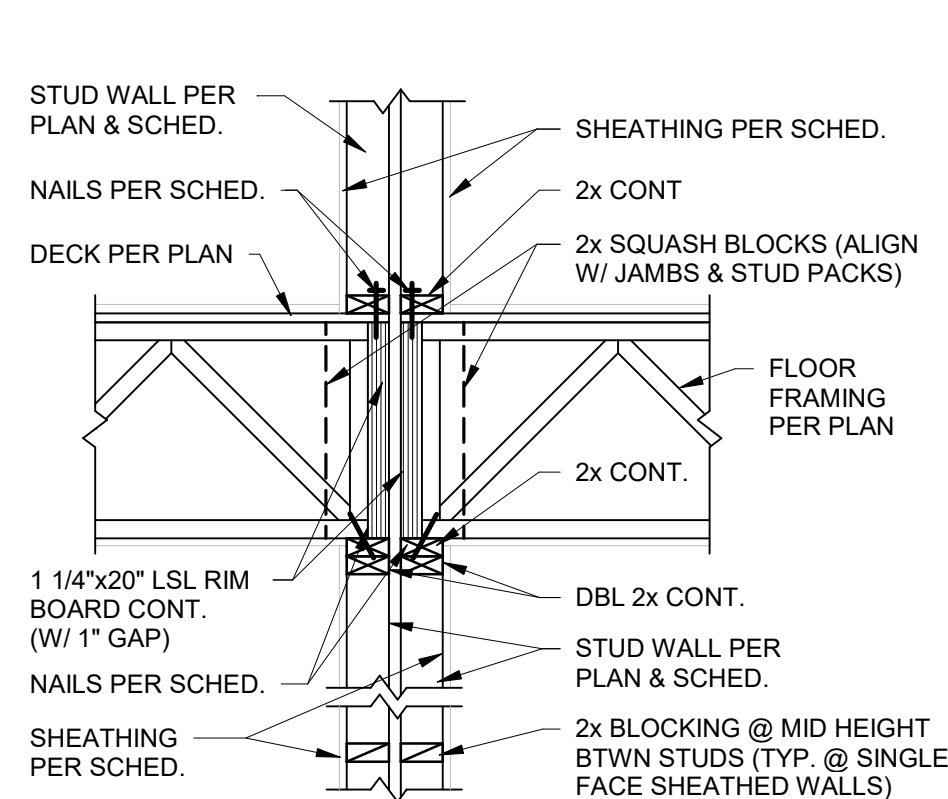


1 SECTION
3/4" = 1'-0"

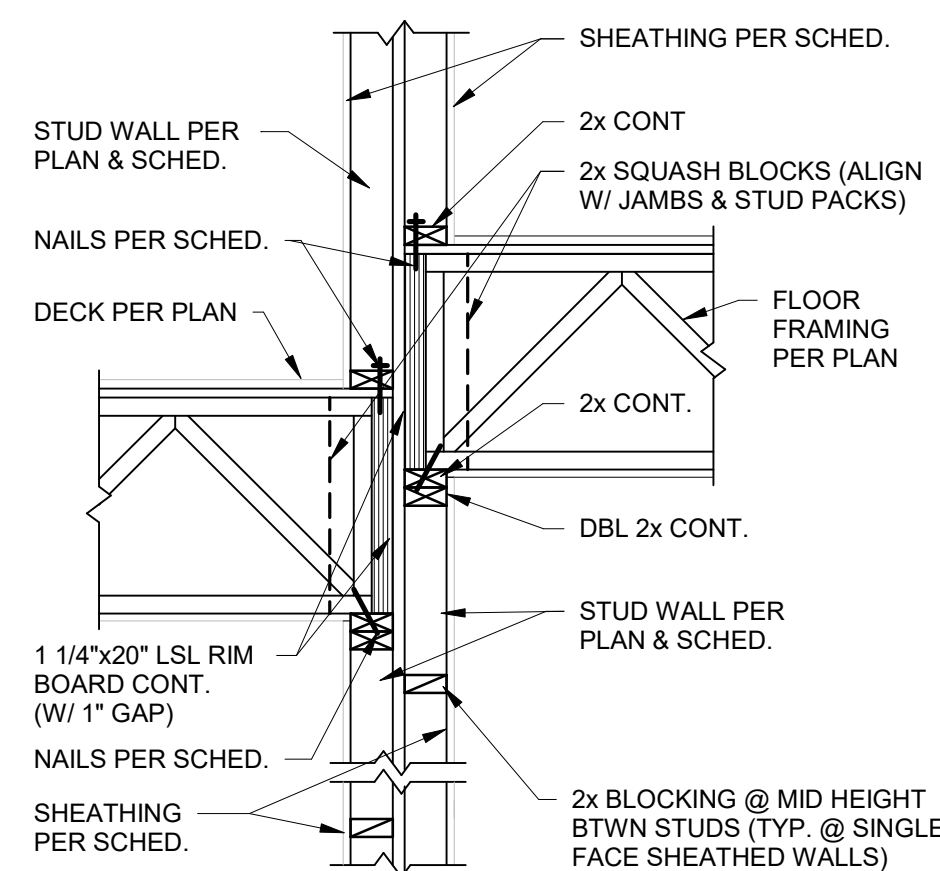


2 SECTION
3/4" = 1'-0"

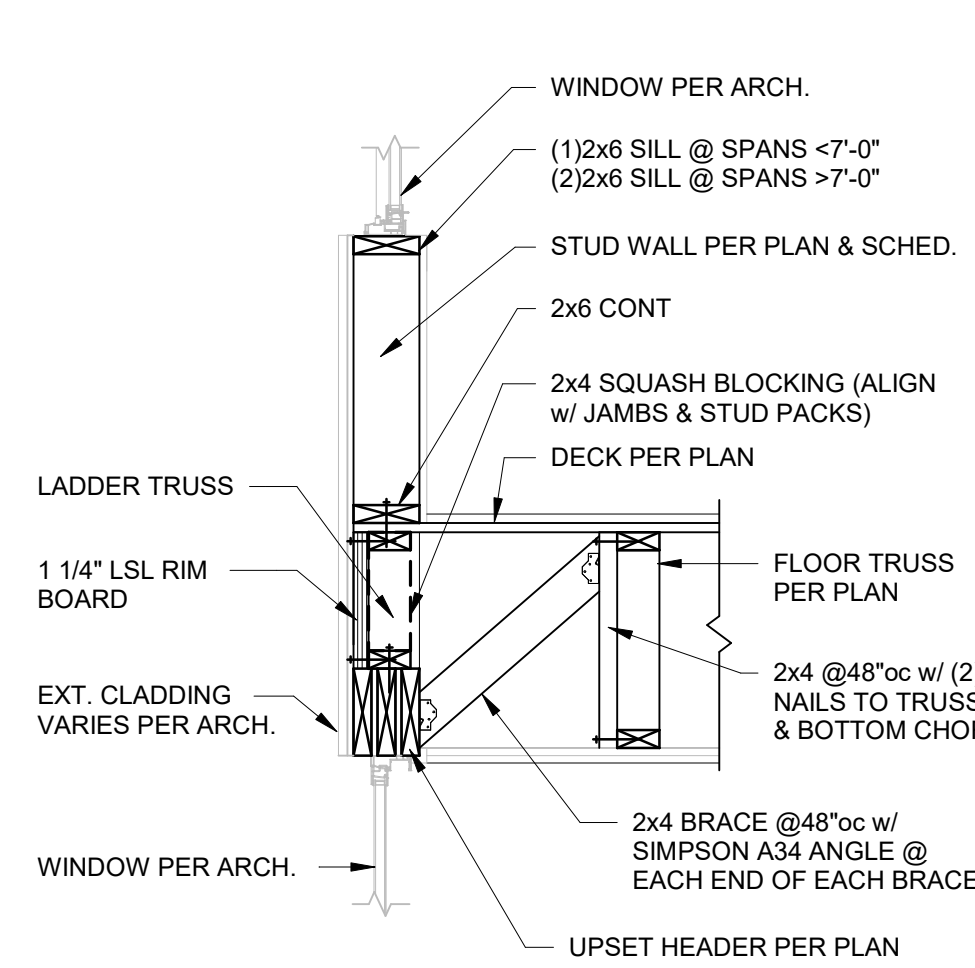


3 SECTION
3/4" = 1'-0"

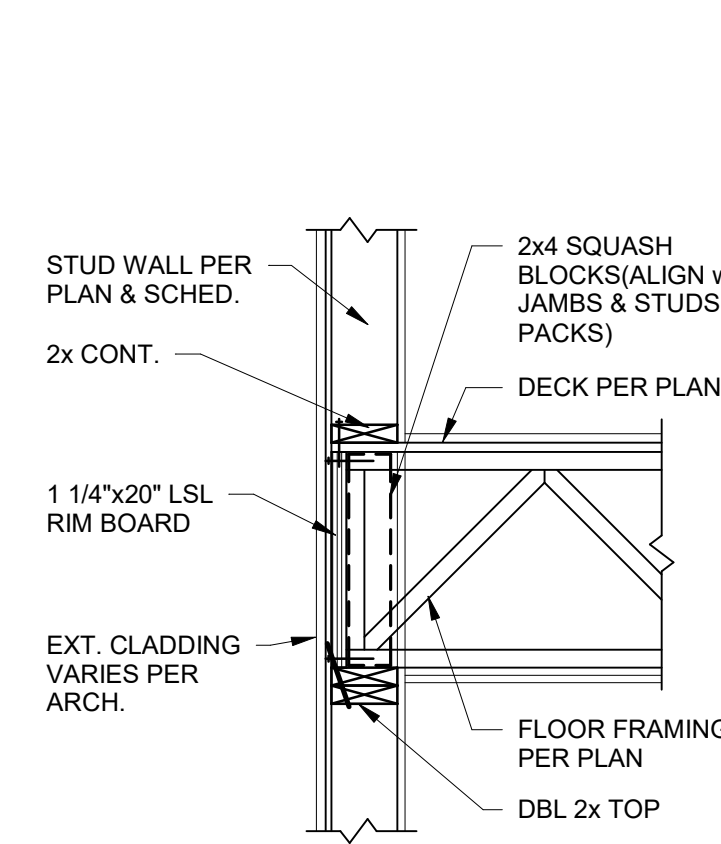


4 SECTION
3/4" = 1'-0"

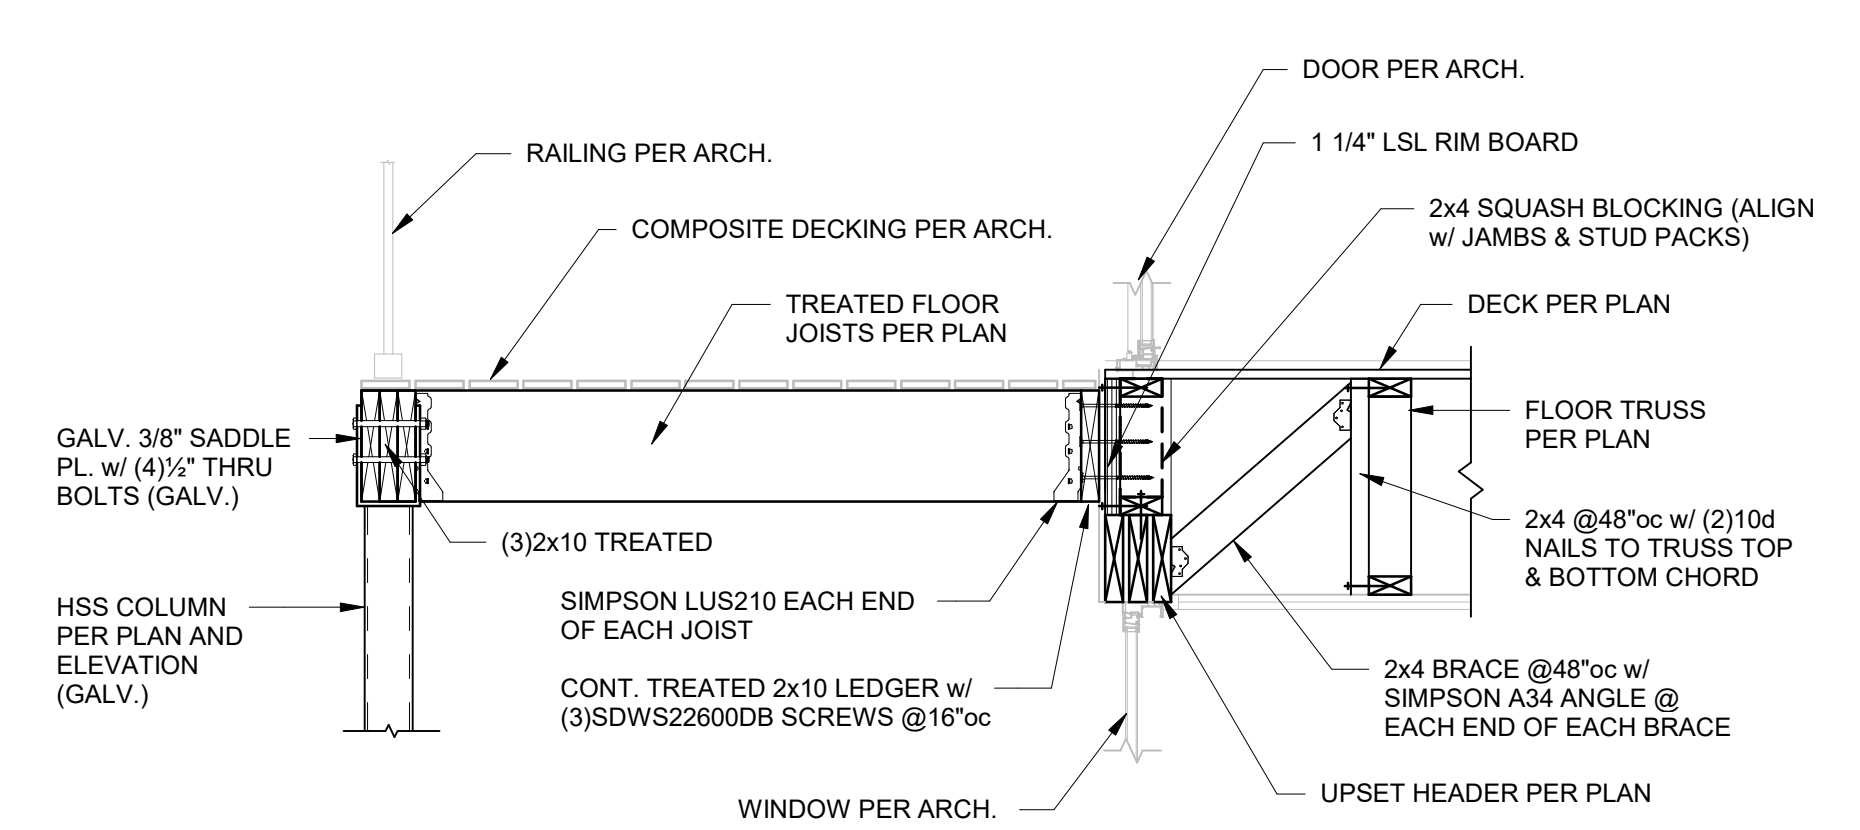


5 SECTION
3/4" = 1'-0"

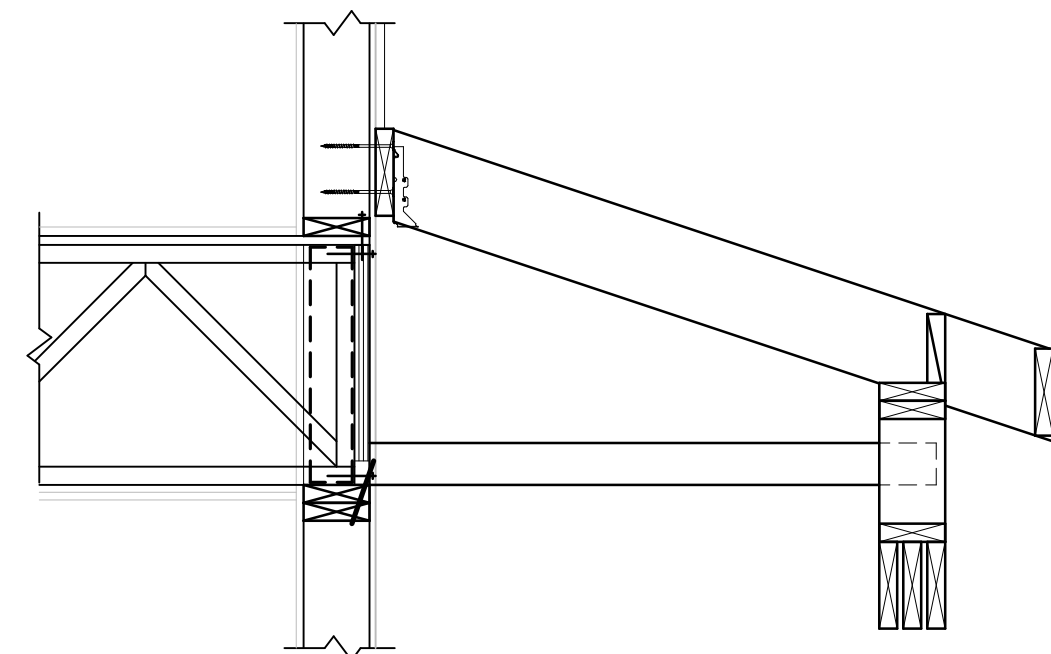


6 SECTION
3/4" = 1'-0"

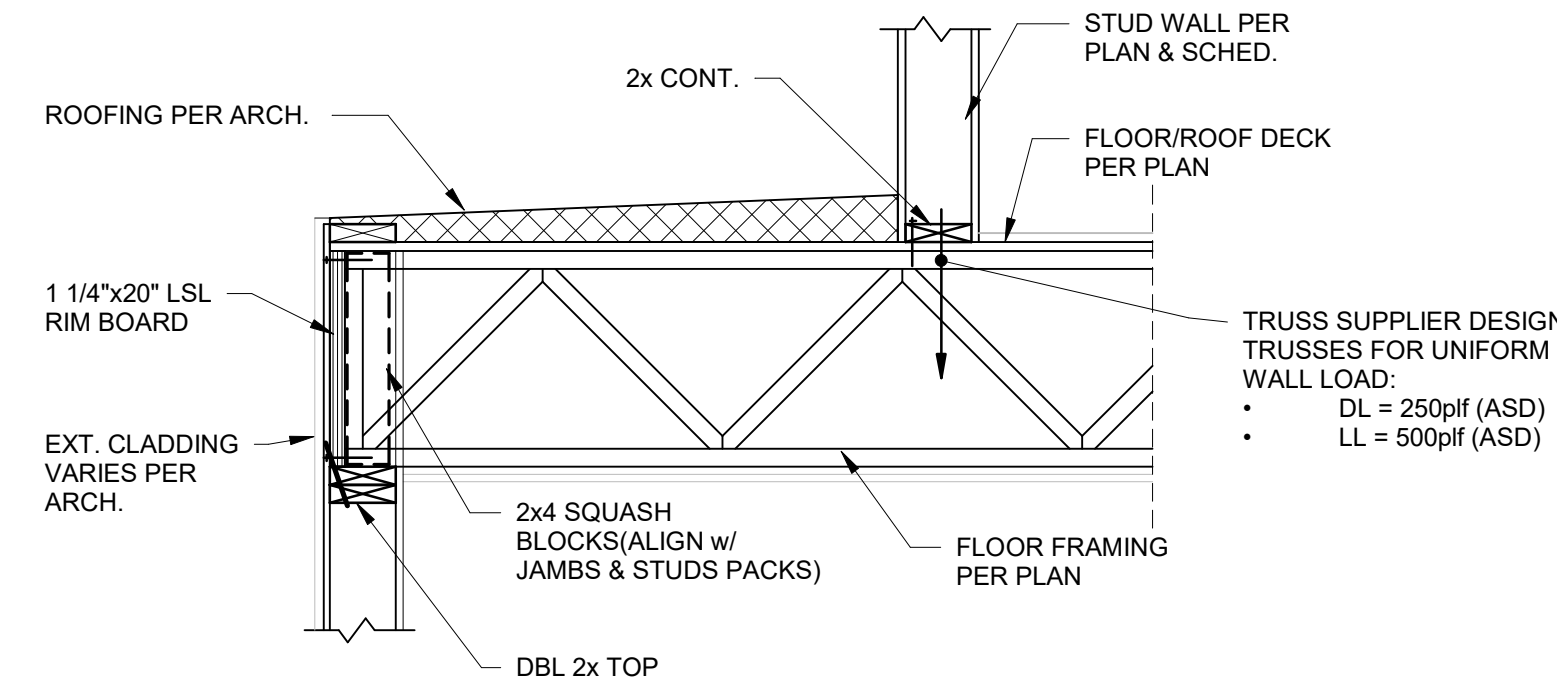


7 SECTION
3/4" = 1'-0"

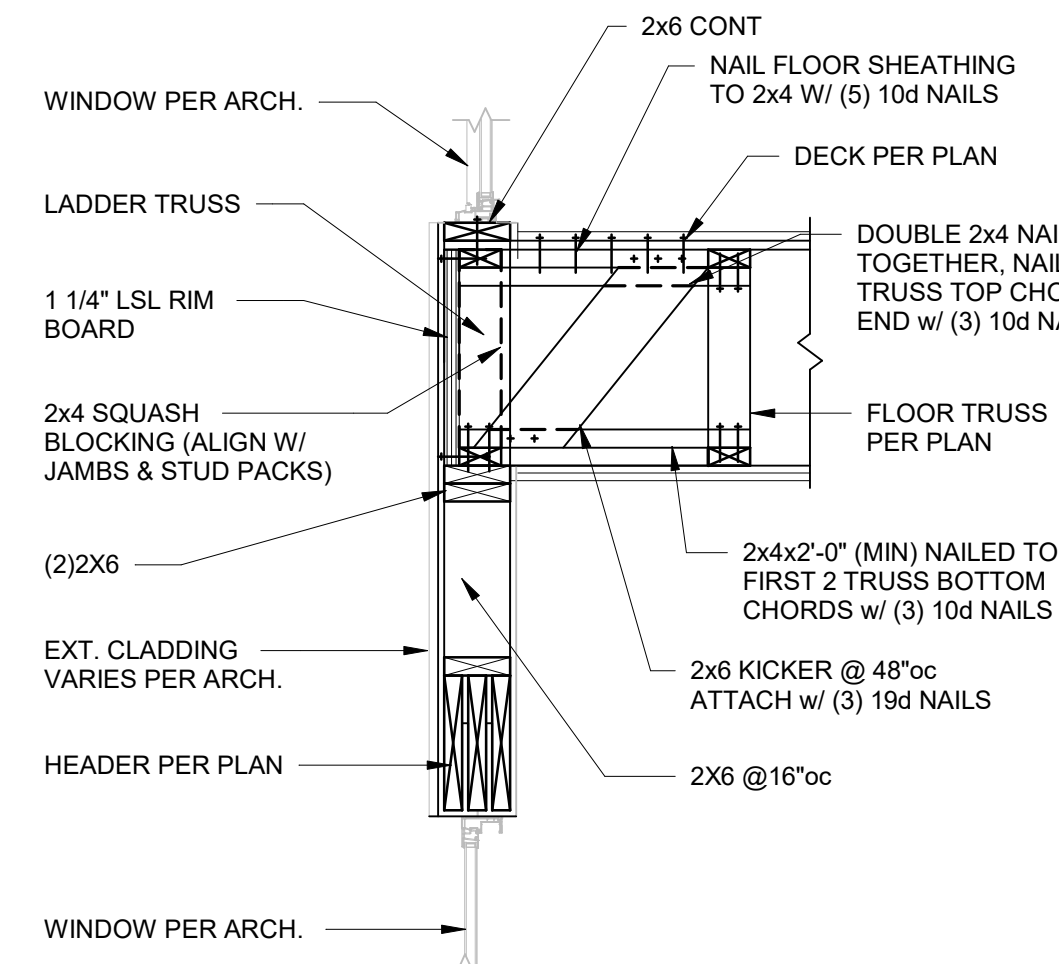


8 SECTION
3/4" = 1'-0"

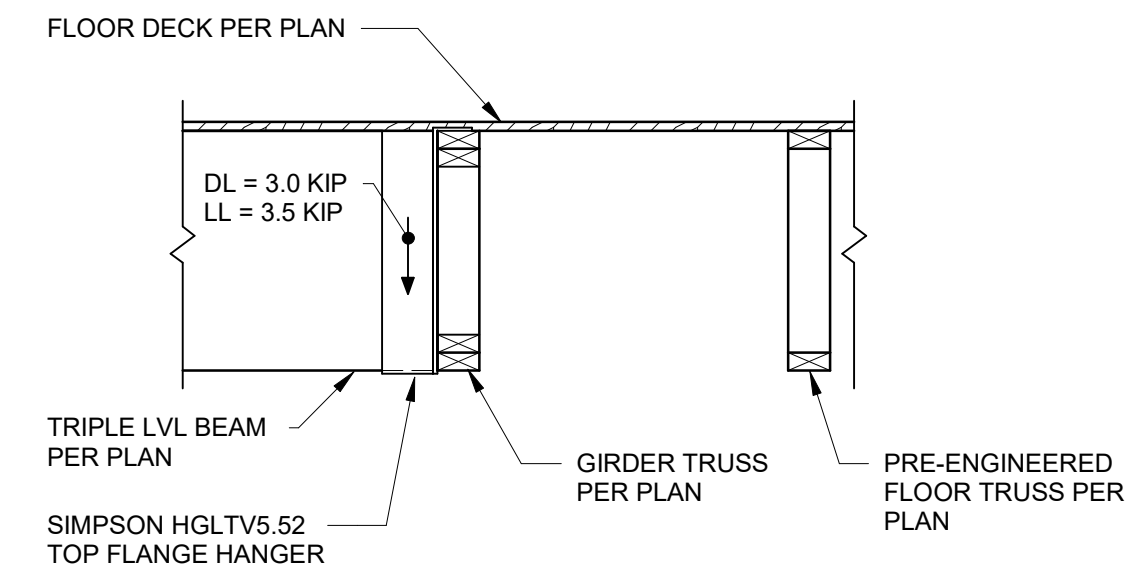


9 SECTION
3/4" = 1'-0"

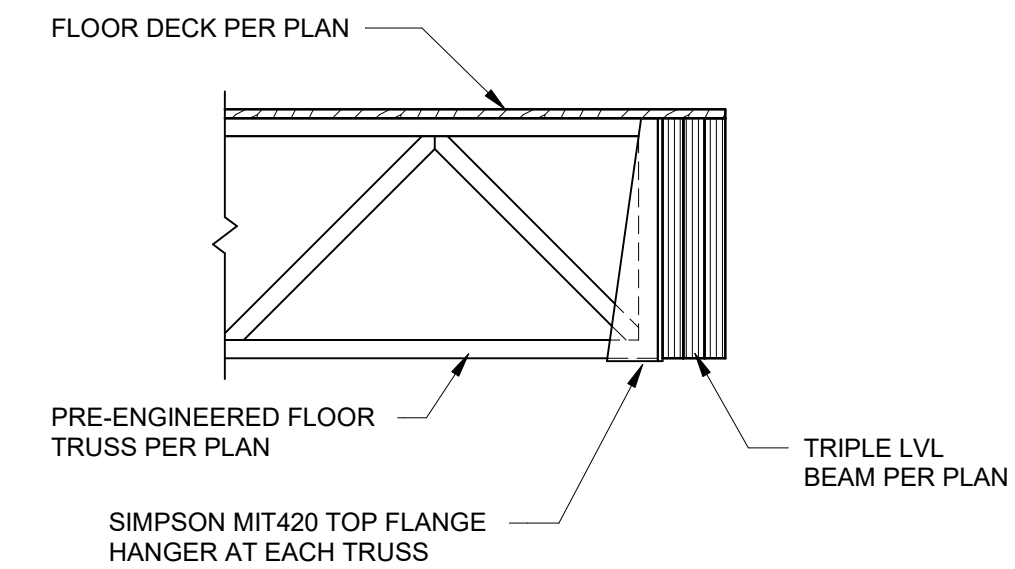


10 SECTION
3/4" = 1'-0"

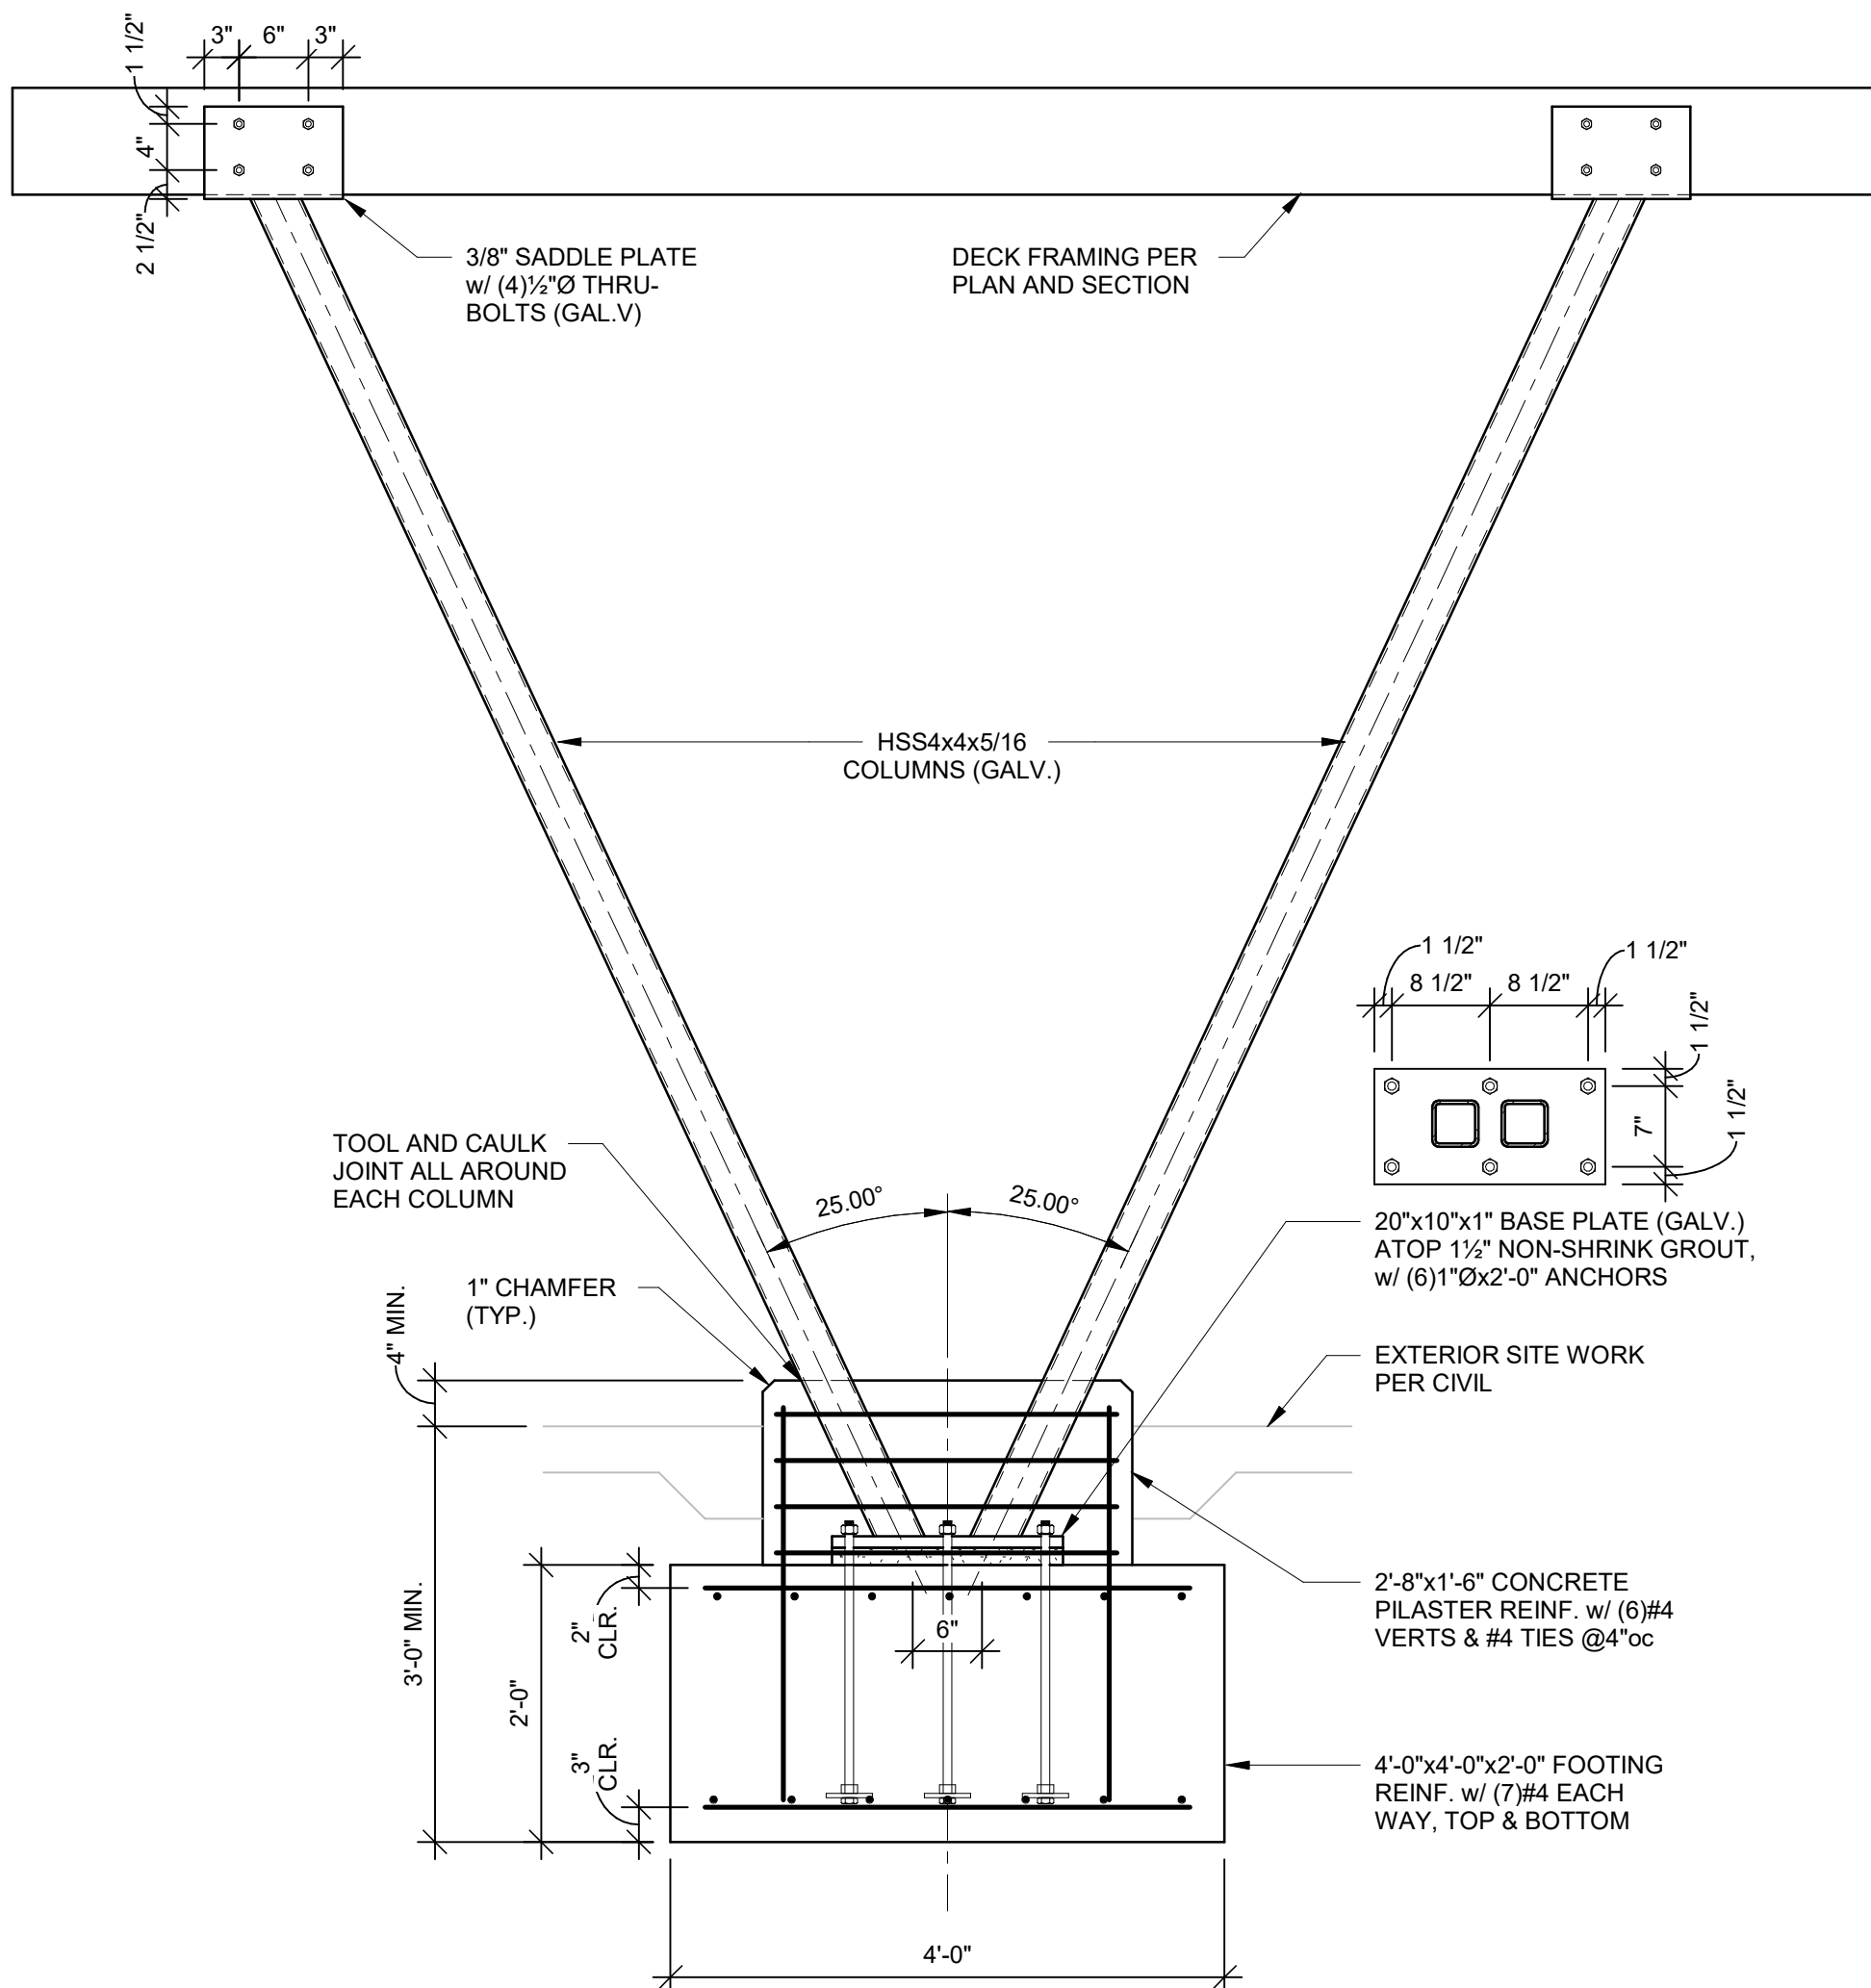


11 SECTION
3/4" = 1'-0"

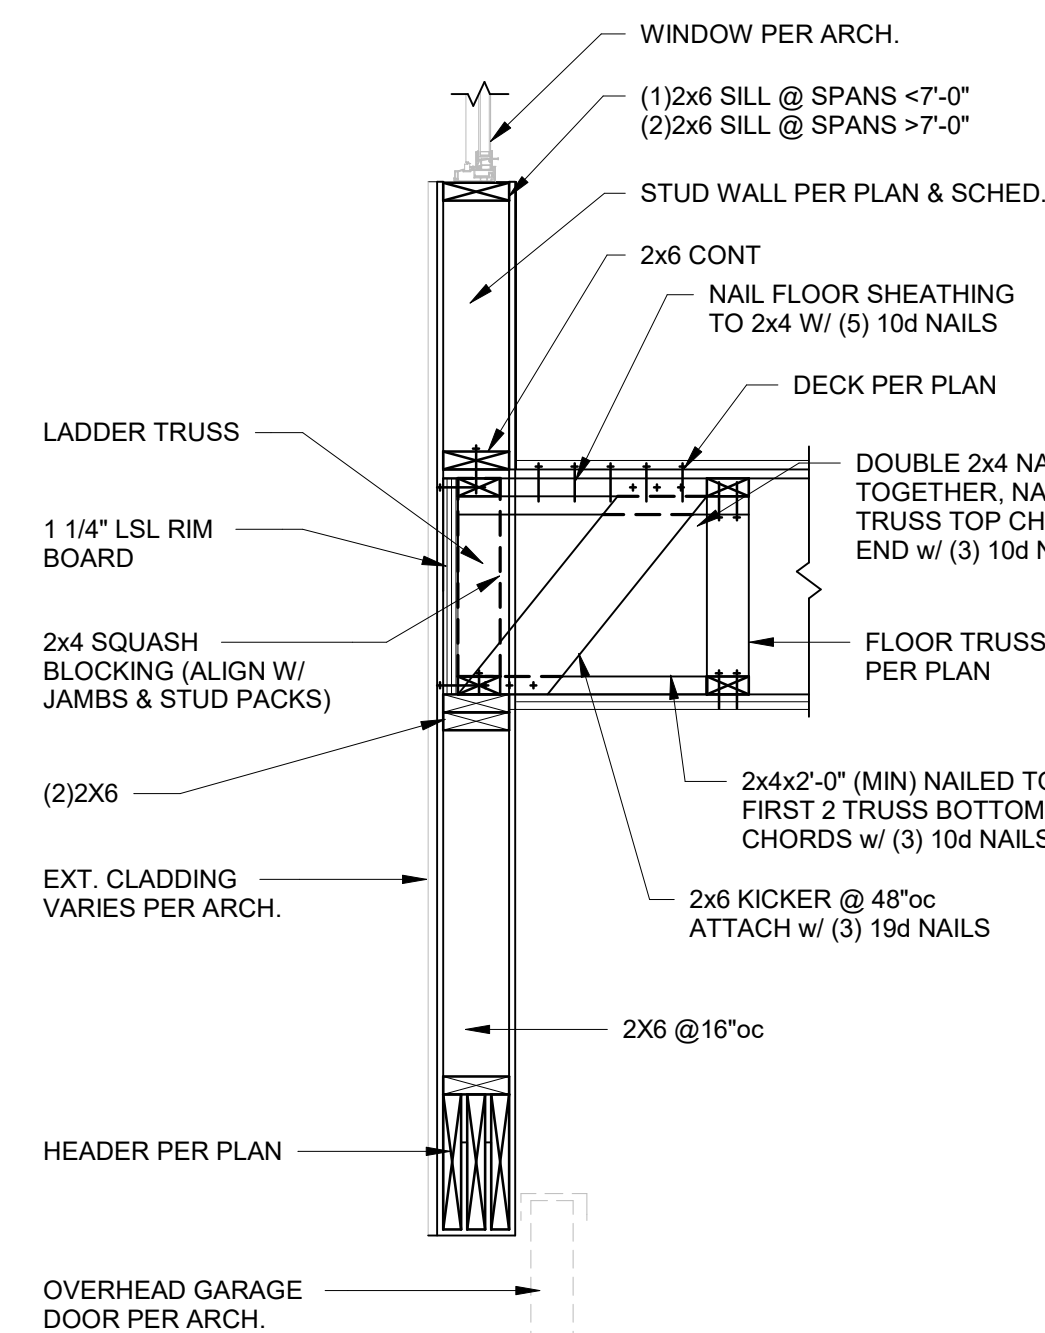


12 SECTION
3/4" = 1'-0"

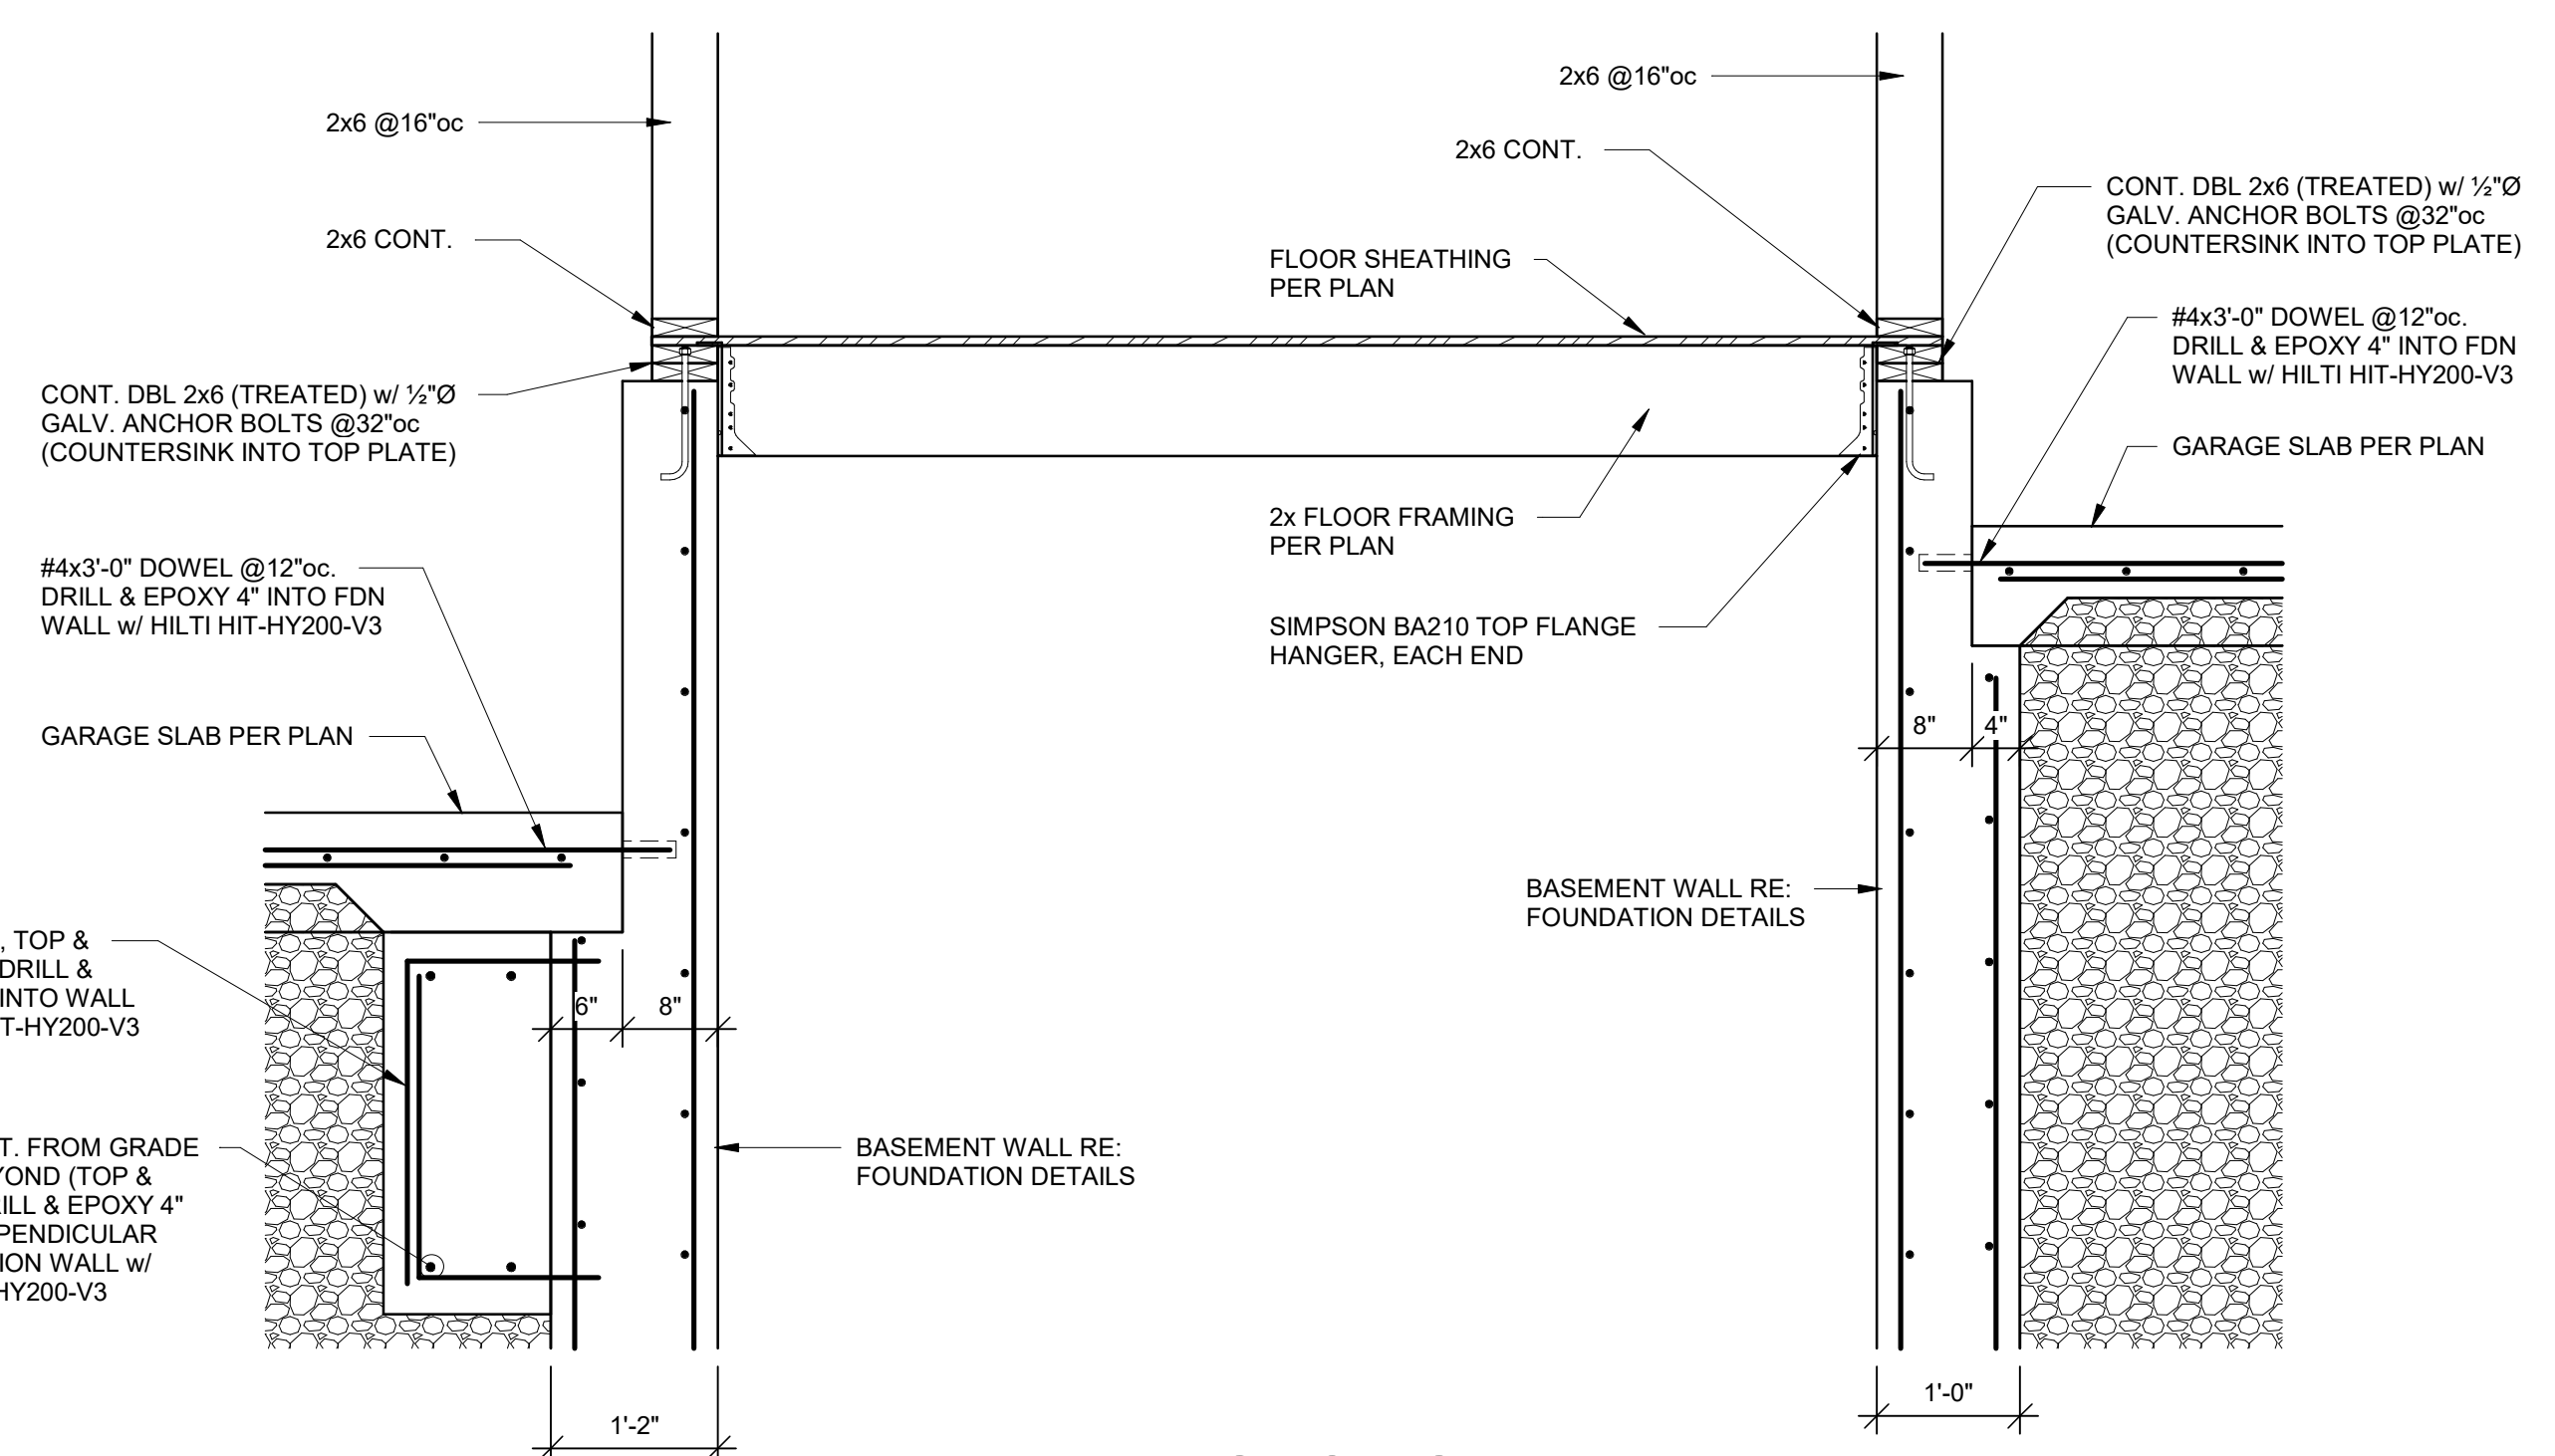


13 SECTION
3/4" = 1'-0"

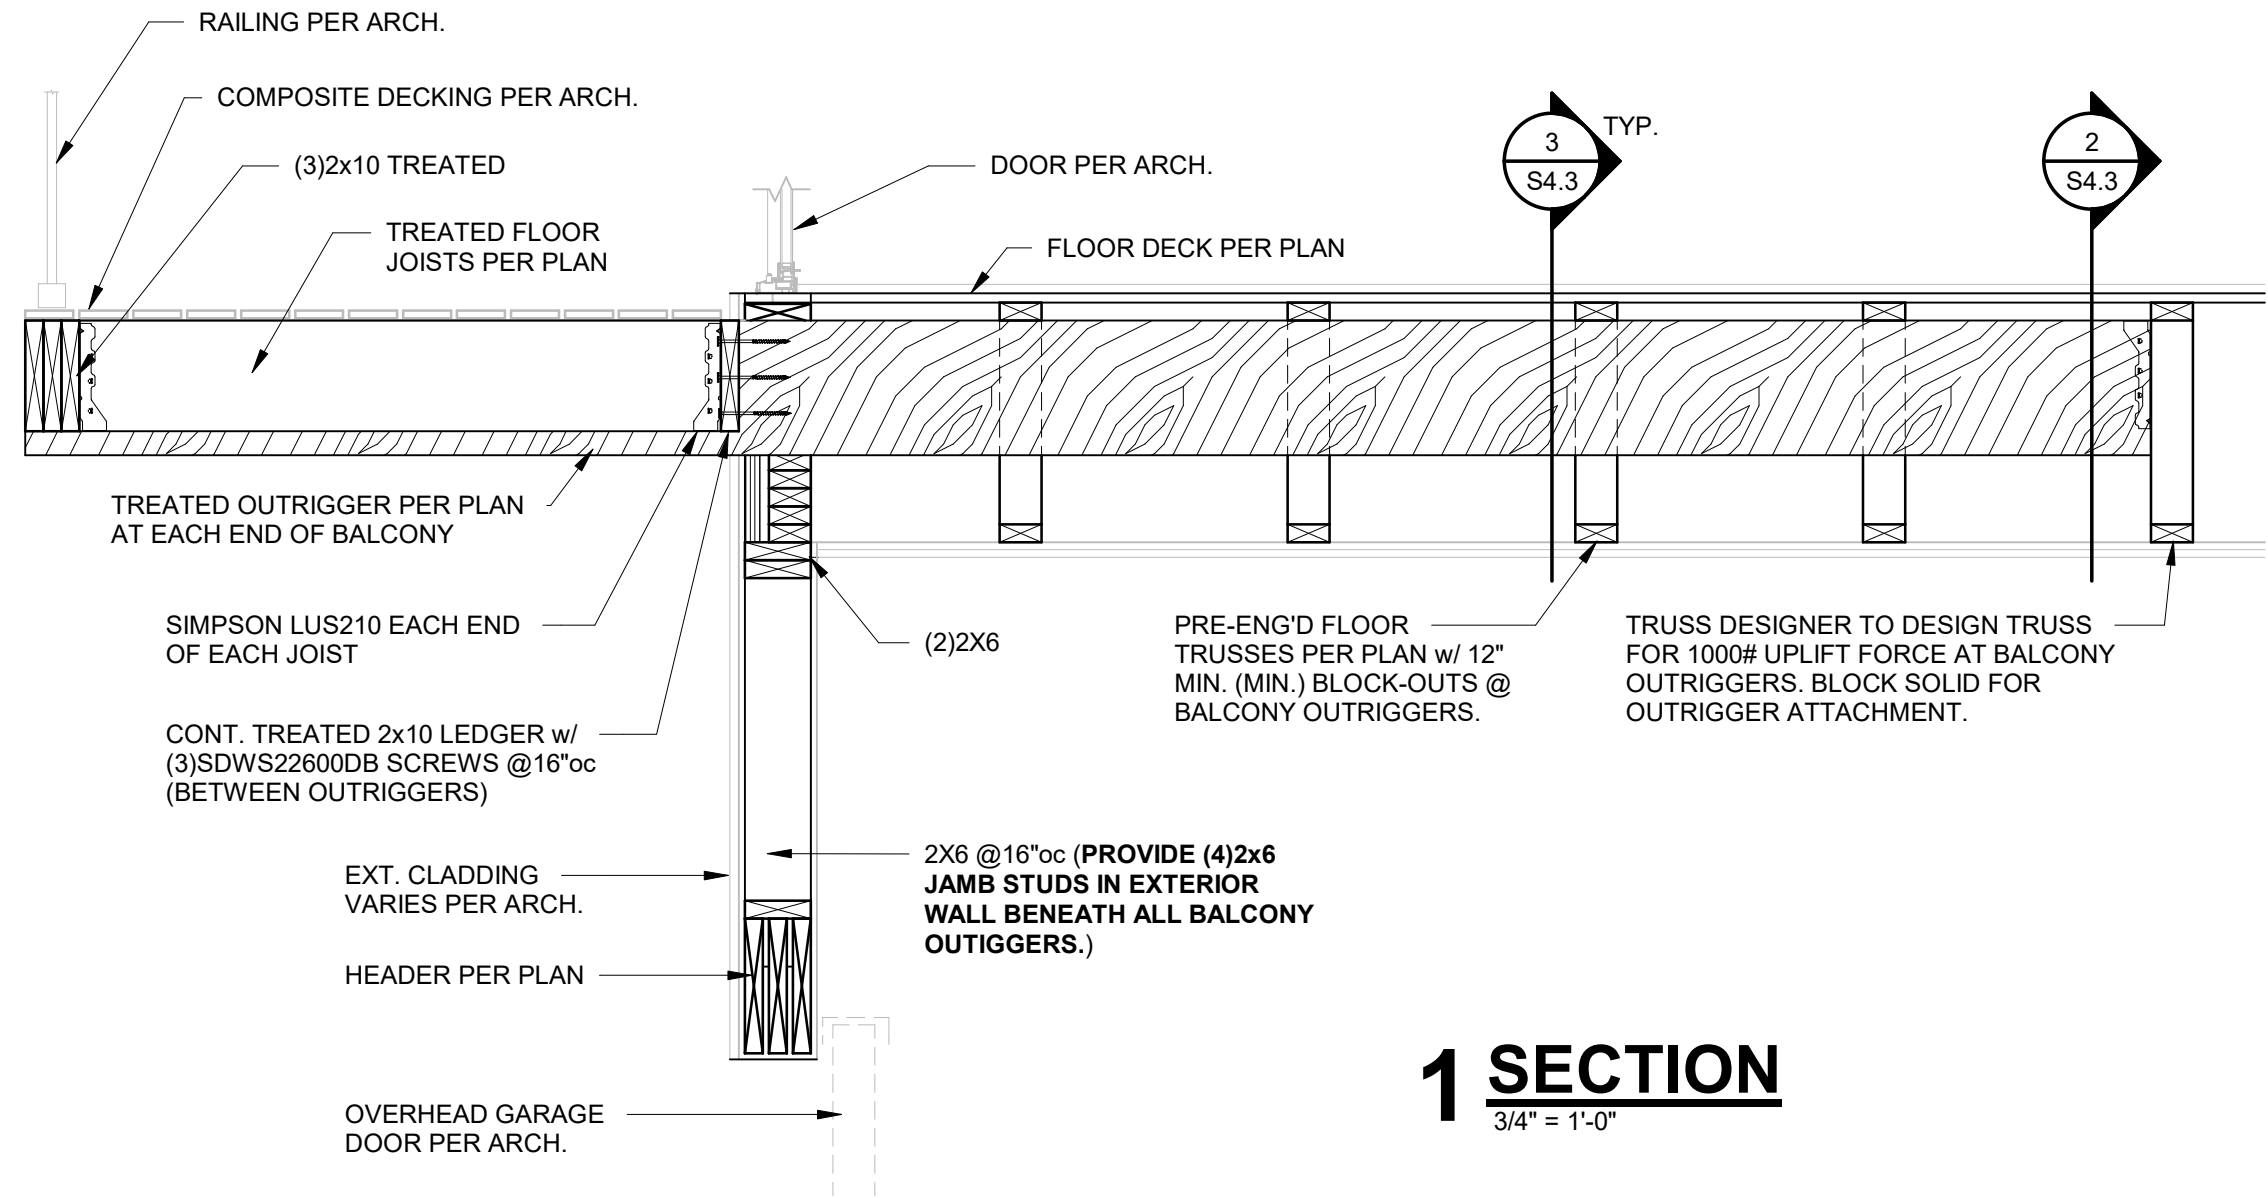

1 SECTION
3/4" = 1'-0"

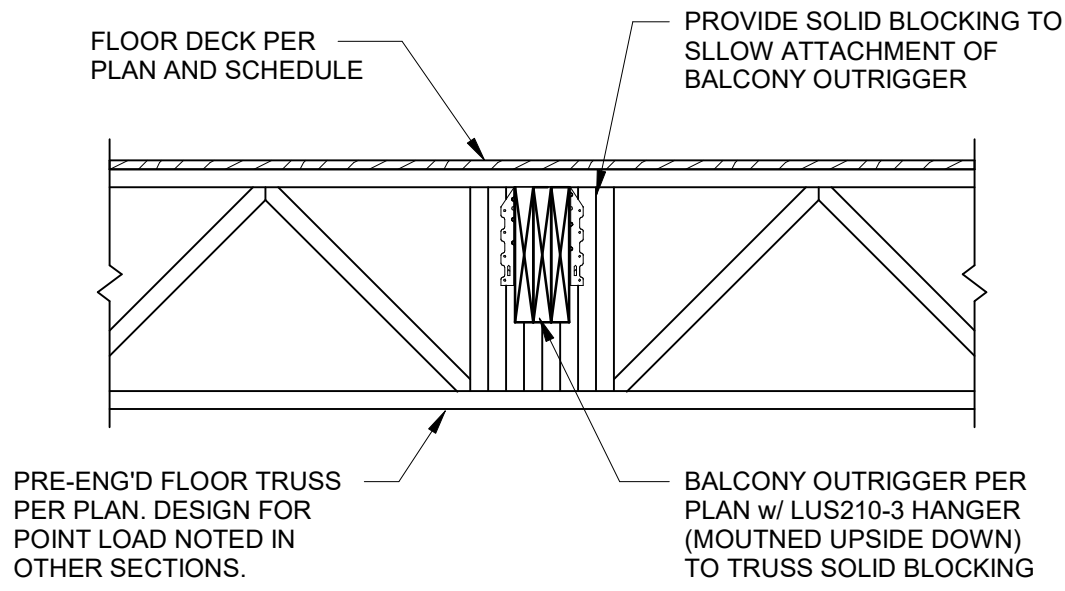



2 SECTION
3/4" = 1'-0"

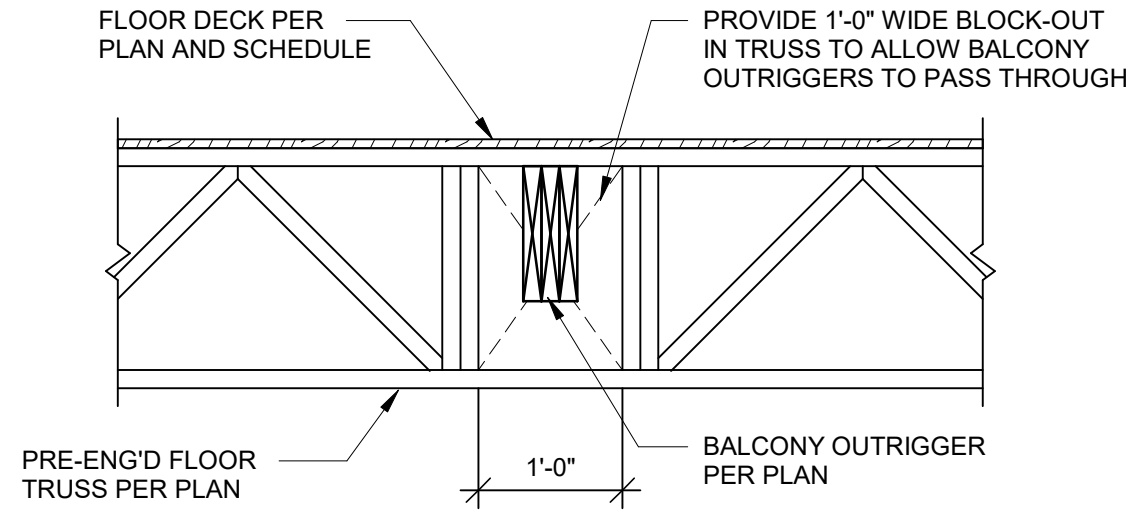


3 SECTION
3/4" = 1'-0"






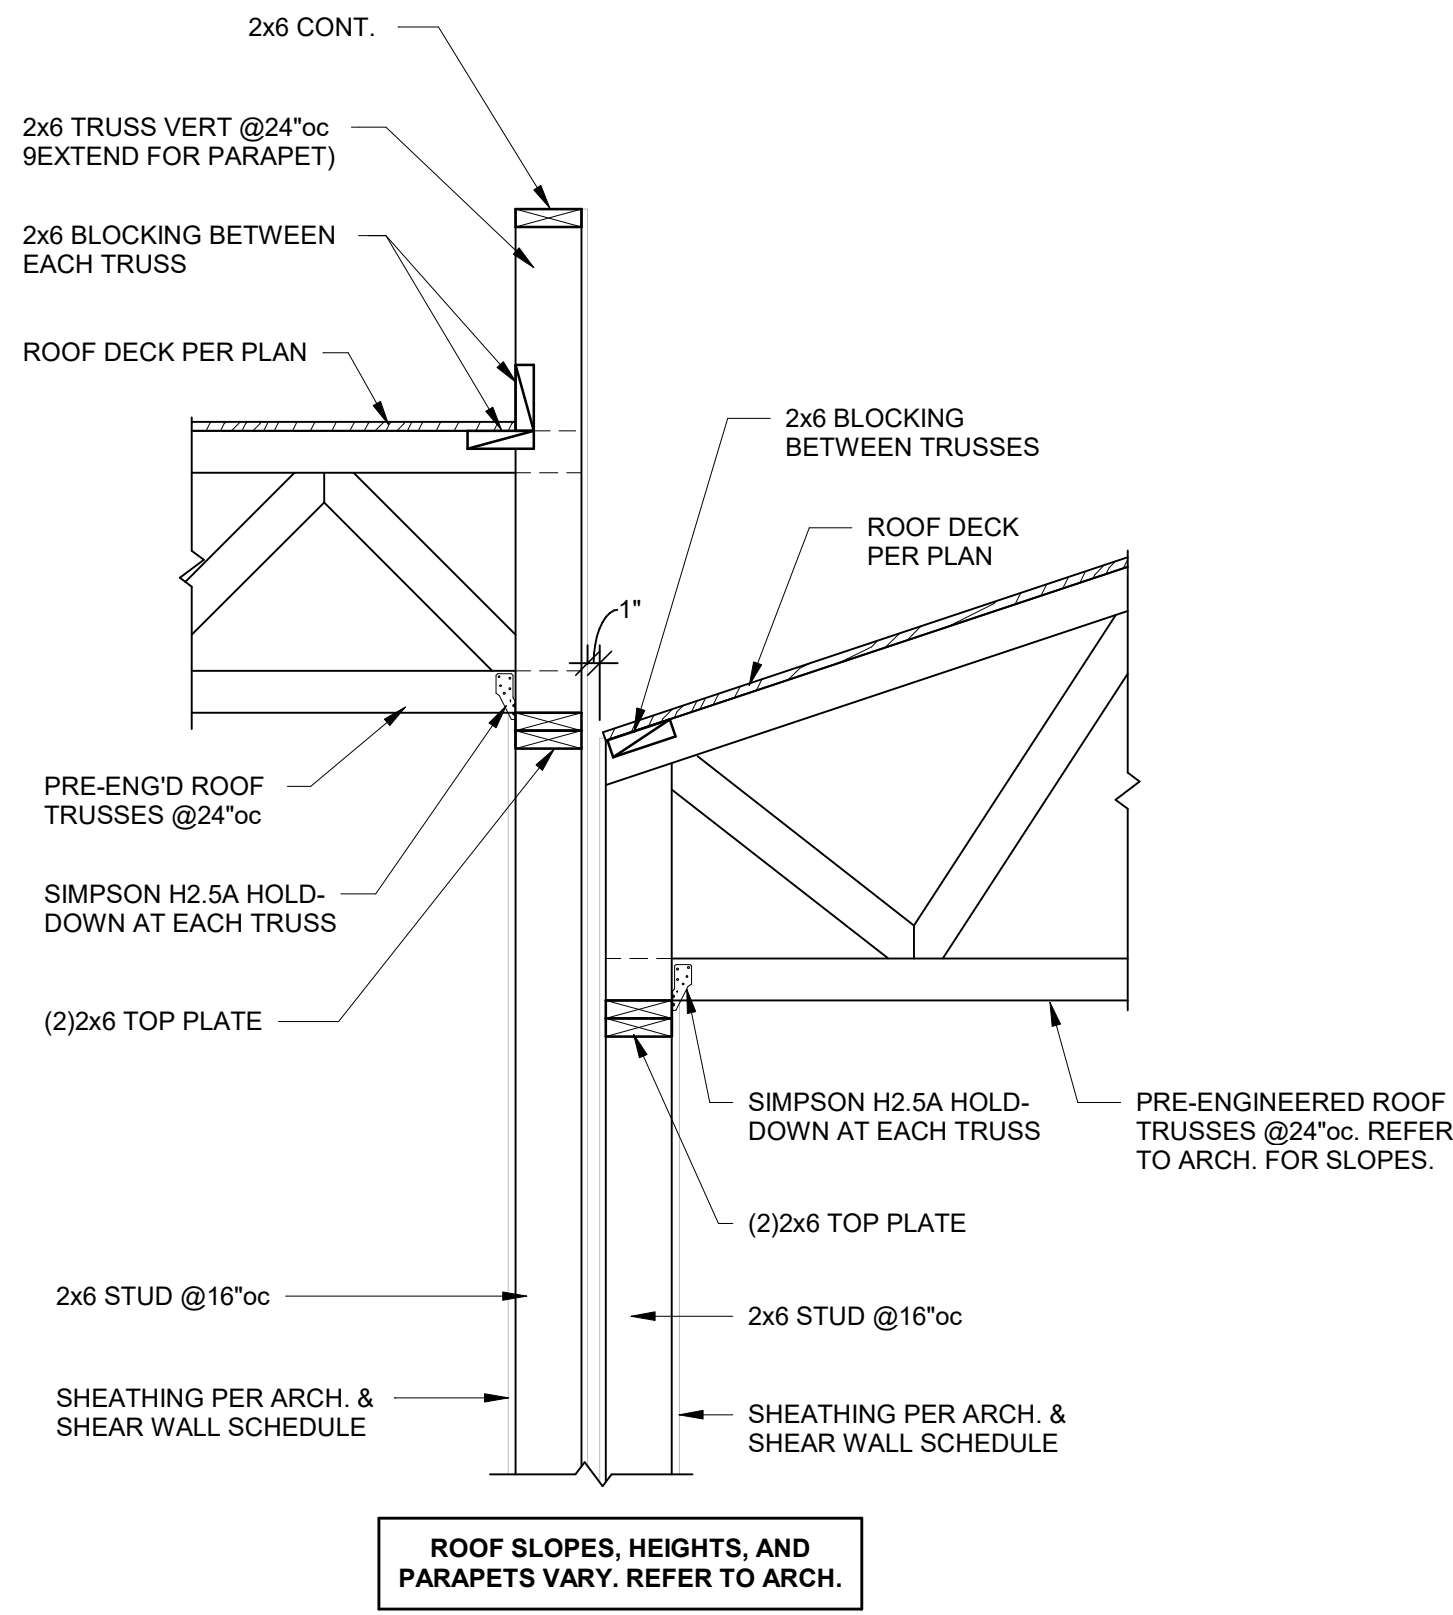

1 SECTION
3/4" = 1'-0"

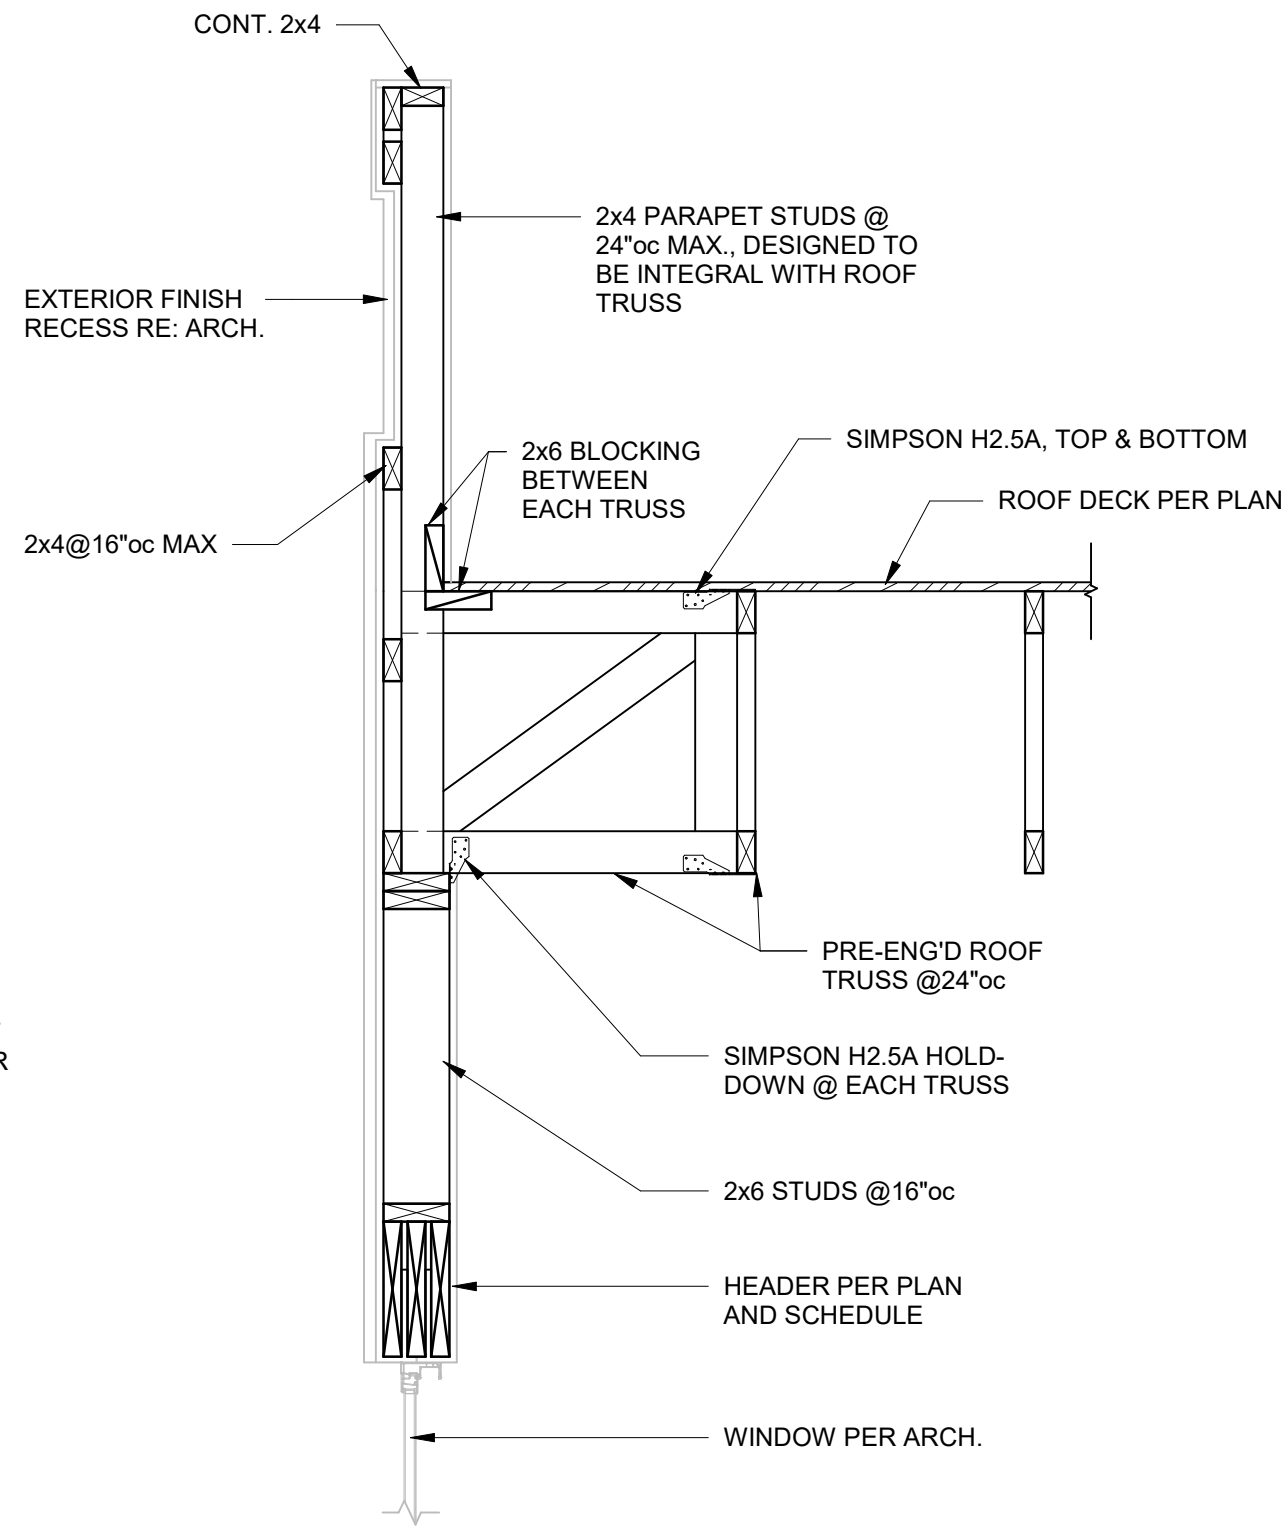

2 SECTION
3/4" = 1'-0"

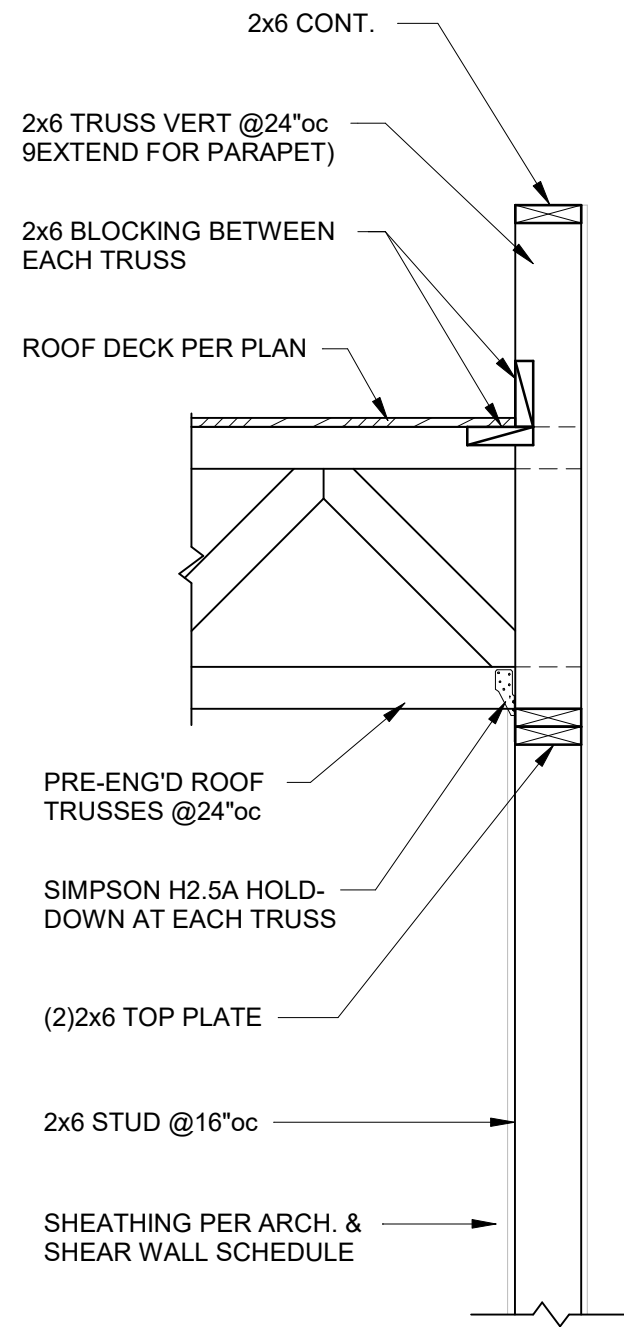

3 SECTION
3/4" = 1'-0"



REVISION:

DATE: 8/12/2025

JOB: 25-3090

SHEET NO.:

LENEXA CITY CENTER _ NORTH VILLAGE TOWNHOMES

LENEXA, KANSAS

NEW TOWNHOMES COMPLEX

JCR JonesGillamRenz

730 N. Ninth
Salina, KS 67401
785.827.0386
jgr@jgarchitects.com

1881 Main Street, Suite 301
Kansas City, MO 64108