



REVISIONS:		
2	ASI #2	03-27-2025
5	ASI #8	10-14-2025

DATE: 01-10-2025
 JOB: 24-3379
 SHEET NO.:


- NOTES BY SYMBOL**
- SWITCHED RECEPTACLE BELOW COUNTER FOR GARBAGE DISPOSAL. COORDINATE EXACT LOCATION OF SWITCH WITH ARCHITECT.
 - PROVIDE RECEPTACLE BELOW COUNTER FOR CORD AND PLUG CONNECTION OF DISHWASHER. PROVIDE CORD AND GROUNDING PLUG AS REQUIRED.
 - PROVIDE 120V CONNECTION TO RANGE HOOD/MICROWAVE. STANDARD AND ADAPTABLE UNITS WILL HAVE MICROWAVE ABOVE RANGE. ACCESSIBLE UNITS WILL HAVE RANGE HOOD. COORDINATE EXACT ELECTRICAL ROUGH-IN REQUIREMENTS WITH UTILITY PROVIDER. IF EQUIPMENT IS CORD AND PLUG, PROVIDE RECEPTACLE INSIDE CABINET ABOVE RANGE.
 - PROVIDE TIMER SWITCH EQUAL TO AIR CYCLER 'SMART EXHAUST' FOR CONTROL OF EXHAUST FAN. SET SWITCH PER MANUFACTURER'S INSTRUCTIONS TO OPERATE FAN AS INDICATED BELOW:
 1 BEDROOM: 36 MINUTES PER HOUR
 2 BEDROOM: 54 MINUTES PER HOUR
 NOTE: CONTRACTOR MAY OMIT TIMER SWITCH IN 2 BEDROOM UNITS AND WIRE EXHAUST FAN FOR CONTINUOUS OPERATION.
 - SWITCH CLOSEST TO DOOR SHALL CONTROL ALL LIGHTS IN BATHROOM, AND THE OTHER SWITCH SHALL CONTROL THE EXHAUST FAN.
 - CONNECT EXHAUST FANLIGHT PROVIDED BY MECHANICAL CONTRACTOR.
 - PROVIDE 30A/2P SNAP SWITCH AND CONNECT WATER HEATER. INSTALL SWITCH ADJACENT TO WATER HEATER.
 - COORDINATE FINAL LOCATIONS OF ALL CATV AND PHONE OUTLETS WITH OWNER. TELECOM DISTRIBUTION DEVICE APPROXIMATELY 4'-0" AFF. COORDINATE EXACT REQUIREMENTS WITH UTILITY PROVIDER SELECTED BY OWNER.
 - PROVIDE 30A/2P, SINGLE THROW, MANUAL MOTOR CONTROLLER SNAP SWITCH IN NEMA 1 ENCLOSURE. HUBBELL #HBL7833D OR EQUAL. MAKE FINAL FLEXIBLE CONNECTION TO BLOWER COIL/ELECTRIC HEAT.
 - CEILING MOUNTED SMOKE ALARM IN APARTMENTS TO BE 120VAC WITH 9V BATTERY BACKUP, INTERCONNECTED TO OTHERS IN SAME APARTMENT. DEVICE SHALL HAVE CARBON MONOXIDE DETECTOR AND PHOTOELECTRIC TYPE SMOKE DETECTOR WITH SOUNDER HORN HAVING AN 85 dB OUTPUT AT 10'. SHALL HAVE A SINGLE BUTTON FOR TEST/SILENCE AND LED INDICATOR LIGHTS, AND SHALL BE UL 217 LISTED, BRK #SC7010B OR EQUAL.
 - PROVIDE 40A/2P, SINGLE THROW, MANUAL MOTOR CONTROLLER SNAP SWITCH IN NEMA 1 ENCLOSURE. HUBBELL #HBL7842D OR EQUAL. MAKE FINAL FLEXIBLE CONNECTION TO BLOWER COIL/ELECTRIC HEAT.
 - COORDINATE EXACT MOUNTING LOCATION OF DRINKING FOUNTAIN RECEPTACLE WITH PLUMBING CONTRACTOR.
 - INSTALL LIGHT FIXTURES IN ARCHITECTURAL DROP CEILING. COORDINATE REQUIREMENTS WITH G.C. AND ARCHITECT.
 - COORDINATE ELECTRICAL ROUGH-IN LOCATIONS WITH FINAL CASEWORK DESIGN.
 - INSTALL RECEPTACLE ON WALL OF ELEVATOR PIT. VERIFY EXACT LOCATION WITH ELEVATOR EQUIPMENT INSTALLER.
 - INSTALL LUMINAIRE ON WALL OF ELEVATOR PIT. VERIFY EXACT LOCATION WITH ELEVATOR EQUIPMENT INSTALLER. INSTALL LIGHT SWITCH ADJACENT TO PIT LADDER AT 48" ABOVE FLOOR LANDING.
 - PROVIDE LINE VOLTAGE OCCUPANCY SENSOR FOR CONTROL OF ROOM LIGHTS. TIMECLOCK AND CONTACTORS FOR EXTERIOR LIGHTING AND OFFICE RECEPTACLE CONTROL. RE: 2-E.1.
 - PROVIDE PUSH BUTTON ROUGH-IN AND PREP DOOR JAM WITH RACEWAY AS INDICATED IN DETAIL 3-M.1 FOR AUTOMATIC DOOR OPENER. COORDINATE EXACT REQUIREMENTS WITH OWNER.
 - ROUTE 120V CIRCUIT FOR HOT WATER RECIRCULATION PUMP THROUGH ADJACENT AQUASTAT. PROVIDE 20A/1P SNAP SWITCH ADJACENT TO PUMP AND MAKE FINAL FLEXIBLE CONNECTION. COORDINATE WITH PLUMBING CONTRACTOR.
 - ROUGH-IN FOR DECORATIVE LIGHT FIXTURE. FIXTURE TO BE SELECTED BY INTERIOR DESIGNER, PROVIDED BY E.C.
 - INSTALL DOORBELL SYSTEM AS SELECTED BY INTERIOR DESIGNER. CIRCUIT TRANSFORMER TO NEAREST UNSWITCHED LIGHTING CIRCUIT. PROVIDE ALL COMPONENTS REQUIRED FOR COMPLETE INSTALLATION. COORDINATE EXACT REQUIREMENTS WITH ARCHITECT AND G.C.
 - PROVIDE 30A/1P SNAP SWITCH AND CONNECT WATER HEATER. INSTALL SWITCH ADJACENT TO WATER HEATER.

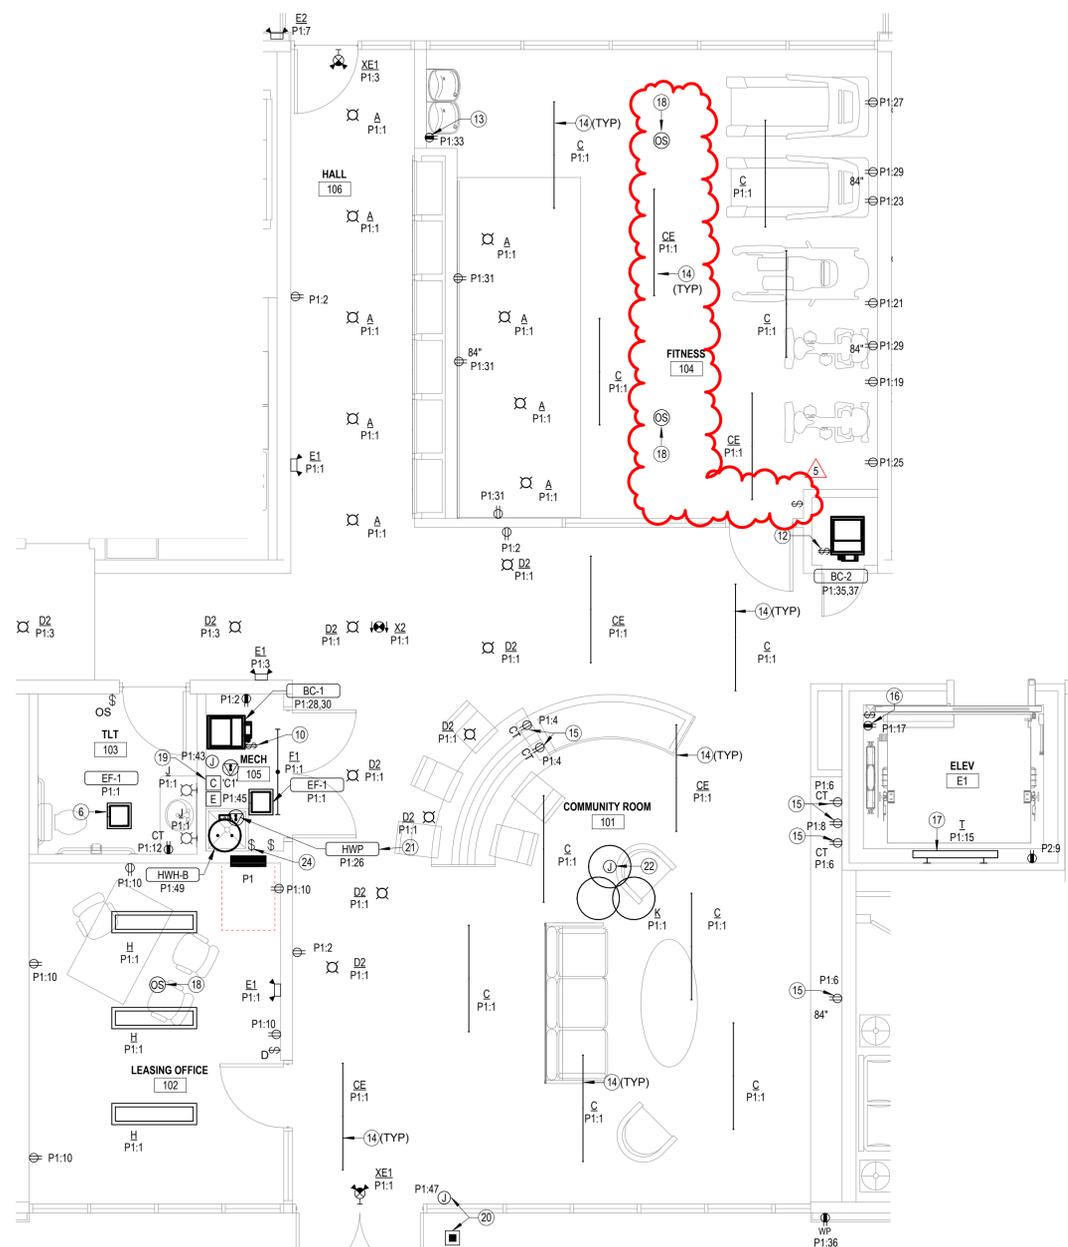


5 COMMON SPACE ENLARGED ELECTRICAL PLAN
 E4.1 1/4" = 1'-0"

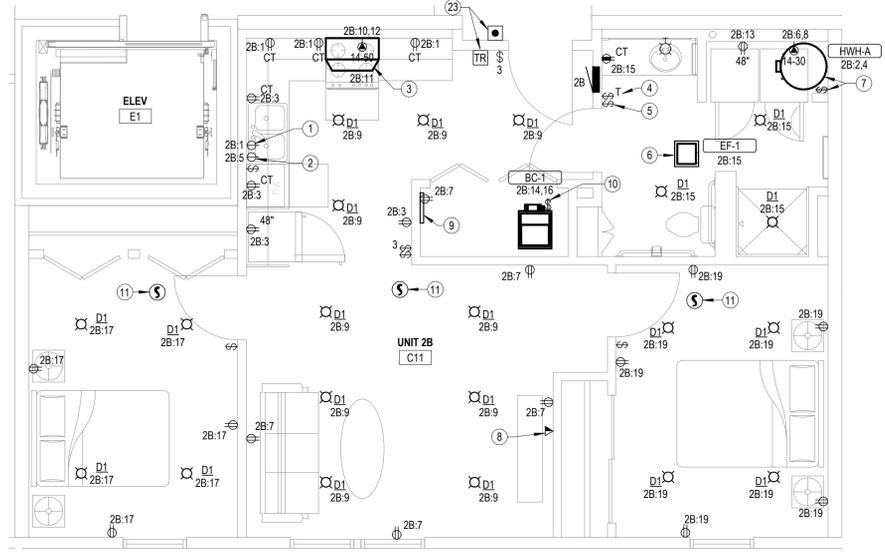

4 2 BEDROOM (UNIT 2B) ENLARGED ELECTRICAL PLAN
 E4.1 1/4" = 1'-0"

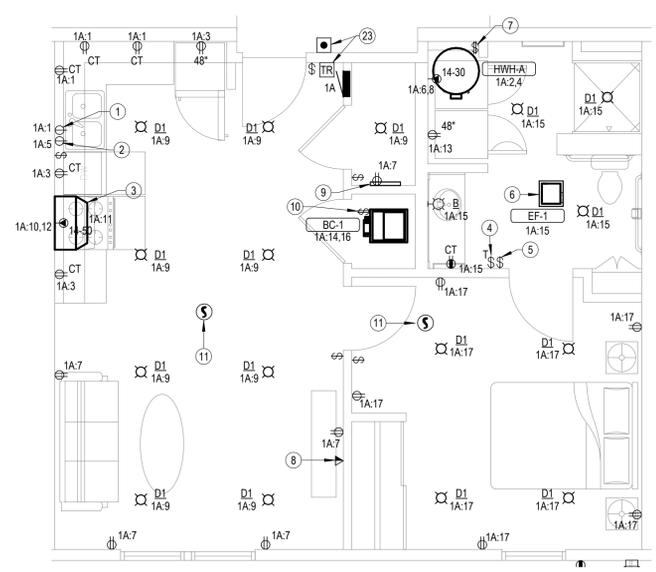

2 1 BEDROOM (UNIT 1A) ENLARGED ELECTRICAL PLAN
 E4.1 1/4" = 1'-0"

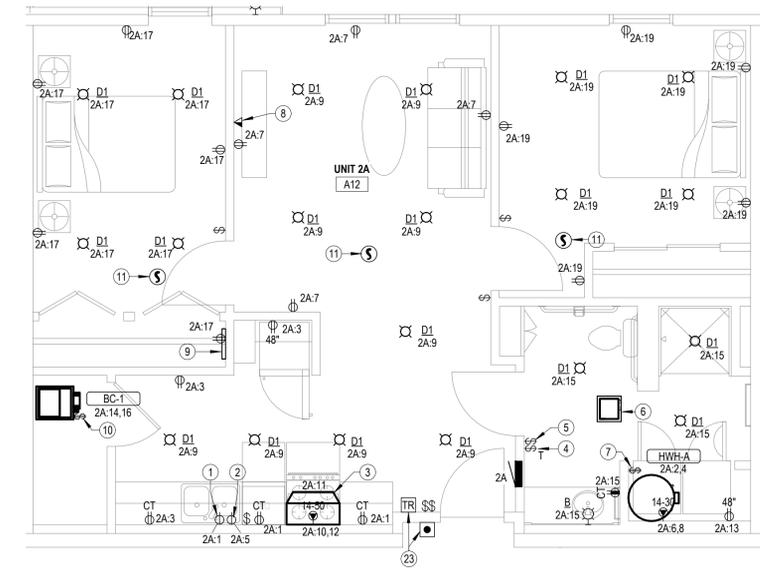

3 2 BEDROOM (UNIT 2A) ENLARGED ELECTRICAL PLAN
 E4.1 1/4" = 1'-0"