THE RESIDENCES AT RED CEDAR

SENIOR - LIVING FACILITY

CORSICANA, **24-3392** **TEXAS**

REFERENCE LEGEND

- 1-A1 — DETAIL REFERENCE REF # – SHT. #
- A-A1 SIM — DETAIL REFERENCE REF # – SHT #
- A A1.1 — INTERIOR ELEVATION REFERENCE
- 100'-0" FIN. FLR. — ELEVATION DESIGNATION
- 1 — DOOR MARK
- A — WINDOW MARK
- CUT LINE
- 4 — PARTITION MARK
- 1 — REVISIONS
- WAITING 101 — ROOM NAME & NUMBER
- A-A1 — PROJECTED VIEW OF PHOTOGRAPH REF # – SHT. #
- SB 10'-0" (BTM) — CEILING ELEVATION & MATERIAL
- PROJECT NORTH
- TRUE NORTH
- DRAWING NAME
- A DETAIL SCALE — DRAWING SCALE; DRAWING REF #

MATERIAL LEGEND

BATT INSULATION	PLYWOOD
BRICK MASONRY	ROUGH WOOD
COMPACTED EARTH	FINISH WOOD
RIGID INSULATION	METAL STUD
POURED CONCRETE	GLASS LARGE SCALE
WALL W/ BRICK VENEER	STRUCTURAL STEEL
METAL STUD WALL	CONC. MASONRY UNIT SECTION
CONCRETE WALL	MTL JOIST
WOOD STUD WALL	MTL FURRING
C.M.U. WALL	PRECAST CONC. SLAB

PROJECT ADDRESS

xxxxxxxxxxxxxxx, Corsicana, Texas

JonesGillamRenz

730 N. Ninth St. 1881 Main St, Ste 301
Salina, KS 67401 Kansas City, MO 64108
785.827.0386 jgr@jgrarchitects.com

CITY ADOPTED CODES

2018 INTERNATIONAL BUILDING CODE
2018 INTERNATIONAL EXISTING BUILDING CODE
2018 INTERNATIONAL PLUMBING CODE
2018 INTERNATIONAL MECHANICAL CODE
2018 INTERNATIONAL FIRE CODE
2020 NATIONAL ELECTRIC CODE
2018 INTERNATIONAL ENERGY CODE

TEXAS DEPARTMENT OF LICENSING AND REGULATION ARCHITECTURAL BARRIERS PROJECT REGISTRATION NUMBER
TABS2025004511

SHEET INDEX

GENERAL

	COVER SHEET
CFP	CODE FOOT PRINT
ADA	2010 ADA STANDARD FOR ACCESSIBLE DESIGN
TAS1	TEXAS ACCESSIBILITY STANDARDS DIAGRAMS
TAS2	TEXAS ACCESSIBILITY STANDARDS DIAGRAMS
ANSI–1	UNIFORM FEDERAL ACCESSIBILITY STANDARDS
ANSI–2	UNIFORM FEDERAL ACCESSIBILITY STANDARDS
ANSI–3	UNIFORM FEDERAL ACCESSIBILITY STANDARDS
UFAS1	UNIFORM FEDERAL ACCESSIBILITY STANDARDS
UFAS2	UNIFORM FEDERAL ACCESSIBILITY STANDARDS
UFAS3	UNIFORM FEDERAL ACCESSIBILITY STANDARDS

ARCHITECTURAL

A1.1	SITE PLAN & DETAILS
A1.2	SITE DETAILS
A1.3	SITE DETAILS
A2.1	FIRST & SECOND FLOOR PLANS
A2.2	THIRD FLOOR PLAN & ASSEMBLY DETAILS
A2.3	ENLARGED UNIT PLANS
A2.4	ADAPTABLE (TYPE–B) ENLARGED BATH & KITCHEN DETAILS
A2.5	ACCESSIBLE ENLARGED BATH & KITCHEN DETAILS
A2.6	BATH & KITCHEN CABINET DETAILS
A2.7	ENLARGED COMMUNITY ROOM PLAN
A3.1	EXTERIOR ELEVATIONS
A3.2	EXTERIOR ELEVATIONS
A3.3	BUILDING SECTION
A4.1	WALL SECTIONS
A4.2	WALL SECTIONS
A4.3	WALL SECTIONS & CONSTRUCTION DETAILS
A4.4	CONSTRUCTION DETAILS
A4.5	FIRE PENETRATION DETAILS
A5.1	ROOF PLAN & SHINGLE ROOFING DETAILS
A5.2	TPO ROOF DETAILS
A6.1	STAIR PLANS, SECTIONS & DETAILS
A6.2	STAIR & ELEVATOR SECTIONS & DETAILS
A6.3	MANUFACTURED STONE DETAILS
A6.4	HARDIE LAP SIDING DETAILS
A6.5	HARDIE PANEL SIDING DETAILS
A7.1	FIRST FLOOR REFLECTED CLG PLANS
A7.2	SECOND & THIRD FLOORS REFLECTED CLG PLAN
A8.1	INTERIOR ELEVATIONS & DETAILS
A9.1	FIRST & SECOND FINISHED FLOORING PLANS
A9.2	INTERIOR ELEVATIONS & DETAILS
A10.1	DOOR, WINDOW & FINISH SCHEDULES
A10.2	DOOR & WINDOW DETAILS

CIVIL

C–1	CIVIL COVER SHEET
C–2	EXISTING SURVEY
C–3	SITE PLAN
C–4	UTILITY PLAN
C–5	GRADING PLAN
C–6	EROSION CONTROL PLAN
C–7	EROSION CONTROL DETAILS
C–8	DETAILS
C–9	DETAILS
C–10	DETAILS
C–11	DETAILS
C–12	LANDSCAPE PLAN

STRUCTURAL

S001	GENERAL NOTES
S002	GENERAL NOTES
S003	SPECIAL INSPECTIONS
S004	SCHEDULES
S100	FOUNDATION PLAN
S101	LEVEL 1 FRAMING PLAN
S102	LEVEL 2 FRAMING PLAN
S103	LEVEL 3 FRAMING PLAN
S104	ROOF FRAMING PLAN
S500	TYPICAL CONCRETE DETAILS
S501	FOUNDATION DETAILS
S502	TYPICAL WOOD FRAMING DETAILS
S503	TYPICAL FLOOR FRAMING DETAILS
S510	FLOOR FRAMING DETAILS
S511	FLOOR FRAMING DETAILS
S515	ROOF FRAMING DETAILS
S516	ROOF FRAMING DETAILS
S520	MASONRY DETAILS
S530	SHEAR WALL DETAILS

ELECTRICAL

E0.1	LEGENDS & SYMBOLS
E1.1	FIRST FLOOR POWER & LIGHTING PLANS
E1.2	2ND & 3RD FLOOR ELECTRICAL PLANS
E1.3	FIRST FLOOR SPECIAL SYSTEMS PLANS
E1.4	2ND & 3RD FLOOR SPECIAL SYSTEMS PLANS
E4.1	POWER – ENLARGED UNIT PLANS
E6.1	LIGHT FIXTURE SCHEDULES & DIAGRAMS
E6.2	PANEL SCHEDULES AND DIAGRAMS
E6.3	PANEL SCHEDULES

MECHANICAL

M0.1	LEGENDS & SYMBOLS
M1.1	FIRST FLOOR HVAC PLANS
M1.2	2ND & 3RD FLOOR HVAC PLANS
M6.1	EQUIPMENT SCHEDULES & DIAGRAMS
ME1.1	M&E SITE PLAN
P0.1	LEGENDS & SYMBOLS
P1.1	UNDERFLOOR & FIRST FLR WASTE AND VENT PLANS
P1.2	2ND & 3RD FLOOR WASTE AND VENT PLANS
P1.3	FIRST FLOOR DOMESTIC WATER PLANS
P1.4	2ND & 3RD FLOOR DOMESTIC WATER PLANS
P4.1	DOMESTIC WATER– ENLARGED UNIT PLANS
P6.1	PLUMBING FIXTURE SCHEDULE & DIAGRAMS
P9.1	WASTE AND VENT RISER DIAGRAMS
P9.2	DOMESTIC WASTER RISER DIAGRAMS
P9.3	RISER DIAGRAMS

CONSULTANTS

Civil Engineer

mma
civil engineering surveying landscape architecture planning
tbpels registration number: f – 2759
tbpels registration/license number: 10088000

MMA Engineering
519 East Border
Arlington, TX 76010
PH 817.469.1671; FAX 817.274.8757
www.mmatexas.com

Structural Engineer ;

McCLURE™
2001 W Broadway,
Columbia, MO 65203
(573) 234-2658
jbarnes@mcclurevision.com

Mechanical & Electrical Engineer ;

LST

LST Consulting Engineers, PA
4809 Vue Du Lac Place, Suite 301
MANHATTAN, KS. 66503
ph. (785) 587-8042
fax (785) 587-8039
mail@LSTengineers.com

ABBREVIATIONS

&	AND
∠	Angle
@	At
℄	Centerline
ø	Diameter or Round
#	Pound or Number
Acous.	Acoustical
Adj.	Adjustable
A.F.F.	Above Finished Floor
Aggr.	Aggregate
Al.	Aluminum
Approx.	Approximate
Arch.	Architect or Architectural
Asb.	Asbestos
Asph.	Asphalt
A.V.	Audio Visual
Bd.	Board
Bitum.	Bituminous
Bldg.	Building
Blk.	Block
Blk g.	Blocking
Bm.	Beam
Bot.	Bottom
BO	BY OWNER
Brg.	Bearing
Brk.	Brick
Cab.	Cabinet
Clg.	Ceiling
Clr.	Clear
Cntr.	Counter
Col.	Column
Conc.	Conc. Concrete
C.T.	Ceramic Tile
CMU	Concrete Masonry Unit
Ctr.	Center
Dbl.	Double
Det.	Detail
D.F.	Drinking Fountain
Dia.	Diameter
Dim.	Dimension
Dn.	Down
Dr.	Door
Ds.	Downspout
Dwg.	Drawing
Dwr.	Drawer
(E)	Existing
E.	East or Existing
Ea.	Each
E.J.	Expansion Joint
El.	Elevation
Elec.	Electrical
Elev.	Elevator
Eq.	Equal
Equip.	Equipment
E.W.	Each Way
E.W.C.	Elec. Water Cooler
Exist.	Existing
Expo.	Exposed
Exp.	Expansion
Ext.	Exterior
F.A.	Fire Alarm
F.D.	Floor Drain
Fdn.	Foundation
F.E.	Fire Extinguisher
F.E.C.	F.E. Cabinet
Fin.	Finish
Fl.	Floor
Flash.	Flashing
fl.	Flow line
Ft.	Foot or feet
Ftg.	Footing
Furr.	Furring
Fut.	Future
Ga.	Gauge
Galv.	Galvanized
G.B.	Grab Bar
Gl.	Glass
Gnd.	Ground
Gr.	Grade
Gyp.	Gypsum
H.B.	Hose Bibb
H.C.	Hollow Core
Hdwd.	Hardwood
Hdwr.	Hardware
H.M.	Hollow Metal
Horiz.	Horizontal
Hr.	Hour
Hgt.	Height
I.D.	Inside Diameter
Insul.	Insulation
Int.	Interior
Jan	Janitor
Jt.	Joint
Kit.	Kitchen
Lab.	Laboratory
Lam.	Laminate
Lav.	Lavatory
Lkr.	Locker
Lt.	Light
Mas.	Masonry
Max.	Maximum
M.C.	Medicine Cabinet
Mech.	Mechanical
Memb.	Membrane
Met.	Metal
Mfr.	Manufacturer
Mh.	Manhole
Min.	Minimum
Mir.	Mirror
Misc.	Miscellaneous
M.O.	Masonry Opening
Mtd.	Mounted
N.	North
N.I.C.	Not In Contract
No. or #	Number
Nom.	Nominal
N.T.S.	Not To Scale
O/	On or Over
Obs.	Obscure
O.C.	On Center
O.D.	Diameter
Off.	Office
Opng.	Opening
Opp.	Opposite
P.	Paint
Pl.	Plate
P.Lam.	Plastic Laminate
Plas.	Plaster
Plywd.	Plywood
Pr.	Pair
Pt.	Point
P.T.D.	Paper Towel Dispenser
Ptn.	Partition
P.T.R.	Paper Towel Receptacle
Q.T.	Quarry Tile
R.	Riser
Rad.	Radius
R.D.	Roof Drain
Ref.	Reference
Reinf.	Reinforced
Req'd	Required
Resil.	Resilient
Rm.	Room
R.O.	Rough Opening
S.	South
S.B.	Splash Block
S.C.	Solid Core
Sched.	Schedule
S.D.	Soap Dispenser
Sect.	Section
Shr.	Shower
Sht.	Sheet
Sim.	Similar
S.N.D.	Sanitary Napkin Disp.
S.N.R..	Sanitary Napkin Recep.
Spec.	Specification
Sq.	Square
SSt.	Stainless Steel
Std.	Standard
Stl.	Steel
Stor.	Storage
Strl.	Structural
Susp.	Suspended
S.V.	Sheet Vinyl
Sym.	Symmetrical
Tex.	Texture
T.B.	Towel Bar
T.Bd.	Tack Board
Temp.	Tempered
T.&G.	Tongue & Groove
Thk.	Thick
T.O.M.	Top Of Masonry
T.O.S.	Top Of Steel
T.P.	Top Of Pavement
T.P.D.	Toilet Paper Dispenser
T.V.	Television
T.W.	Tackwall
Typ.	Typical
Trd.	Tread
U.O.N.	Unless Otherwise Noted
Ur.	Urinal
V.C.T.	Vinyl Composition Tile
V.T.	Vinyl Tile
V.B.	Vapor Barrier
Vert.	Vertical
Vest.	Vestibule
Vyl.	Vinyl
W.	West
w/	With
w/o	Without
W.C.	Wall Covering
Wd.	Wood
Wp.	Waterproof
Wdw.	Window
Wsct.	Wainscot
Wt.	Weight

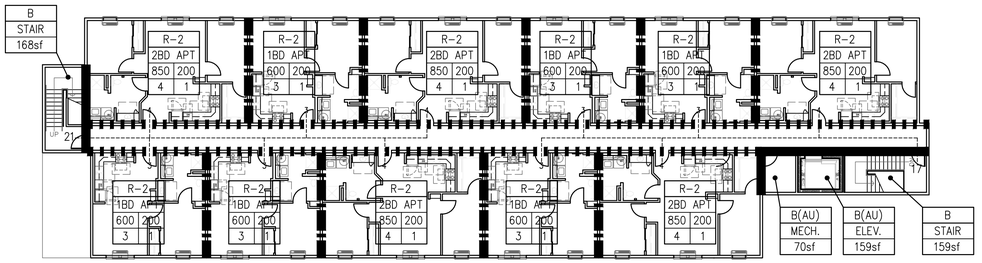

D THIRD FLOOR PLAN

0 8' 16' 32'

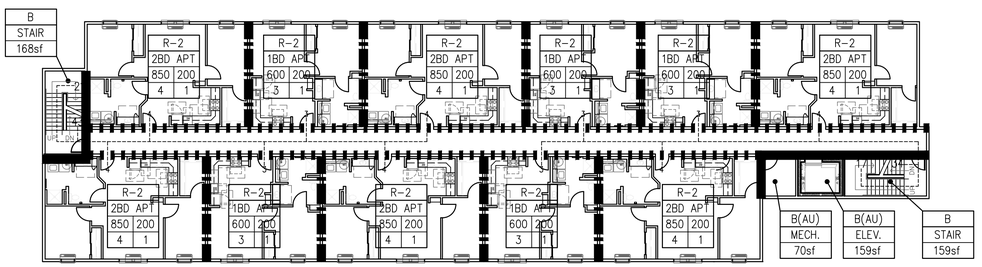

C SECOND FLOOR PLAN

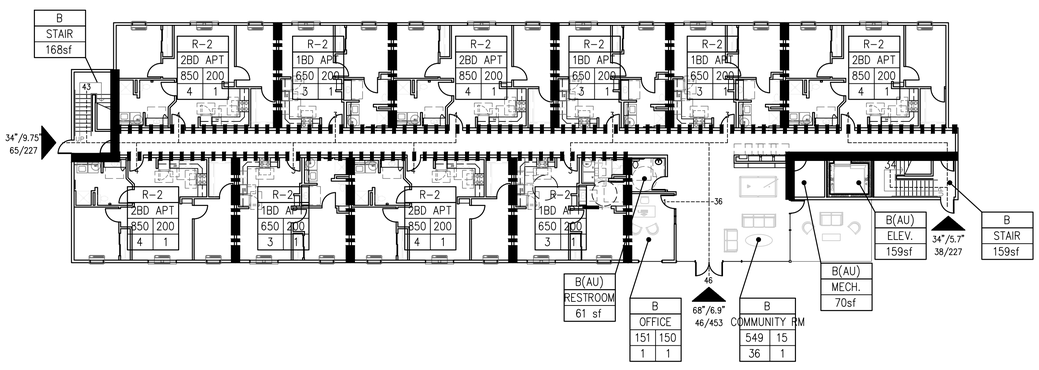

B FIRST FLOOR PLAN

0 8' 16' 32'

CODE INFORMATION

OCCUPANCY OVERALL: MIXED OCCUPANCY

OCCUPANCY GROUPS: B OFFICE; R-2 APARTMENTS

CONSTRUCTION TYPE: V-A

BASIC ALLOWABLE AREA: B 18,000 SF; R-2 12,000 SF

ALLOWABLE AREA INCREASE: *(NON-SEPARATED USES PER IBC SEC. 302.3.2)*

	R-2
BASE ALLOWABLE	12,000 SF
AREA INCREASE (20.83%)	2,500 SF
FIRE SPRINKLER S13R	
SUB-TOTAL ALLOWABLE (PER FLOOR)	14,500 SF
3 FLOORS	x3
TOTAL BUILDING ALLOWABLE AREA	43,500 SF

ACTUAL BUILDING AREA:

FIRST FLOOR	9,986 SF
SECOND FLOOR	9,741 SF
THIRD FLOOR	9,741 SF
TOTAL BLDG AREA	29,468 SF

BASIC ALLOWABLE STORIES: 4
STORIES – S13R *(PER IBC SEC. 504.4)*
TOTAL ALLOWABLE STORIES 4

BASIC ALLOWABLE HEIGHT: 60'
HEIGHT – S13R *(PER IBC SEC. 504.3)*
TOTAL ALLOWABLE HEIGHT 60'

ACTUAL STORIES: 3

ACTUAL HEIGHT: 35'

FIRE RESISTANCE RATING FOR BUILDING ELEMENTS: V-A

EXTERIOR BEARING WALLS:	1 HOUR	*(INTERIOR RATING ONLY, PER IBC SEC. 705.5, FS>10')*
STRUCTURAL FRAME:	1 HOUR	
INTERIOR BEARING WALLS:	1 HOUR	
INTERIOR NON-BEARING WALLS:	0 HOUR	
SHAFT ENCLOSURES:	1 HOUR	(Less than 4 stories)
FLOOR/CEILING ASSEMBLY:	1 HOUR	
CEILING/ROOF ASSEMBLY:	1 HOUR	
CORRIDOR/DWELLING UNITS:	1/2 HOUR	*(Table 1020.1)*

OCCUPANCY SEPARATIONS:
(NON-SEPARATED USES PER IBC SEC. 302.3.2)
ALLOWABLE AREA & HEIGHT CALCULATIONS ARE BASED ON THE MOST RESTRICTIVE USE. DIFFERENT USES ARE NOT SEPARATED BY FIRE BARRIERS.
R2 TO R2 SEPARATION OF DWELLING UNITS = 1HR, 45 MIN. OPNGS

ROOF COVERINGS *CLASS B OR BETTER*

INCIDENTAL SEPARATIONS: *(PER IBC TABLE 508.2.5)*
STORAGE ROOMS OVER 100 SF – SPRINKLER SYSTEM (SMOKE BARRIER)
DWELLING UNITS –1 HR FIRE PARTITIONS

SPECIAL CONDITIONS:
EXIT & EMERGENCY LIGHTING, PORTABLE FIRE EXTINGUISHERS, MANUAL FIRE ALARM
EGRESS – NO STEPS EXISTING OR PROPOSED AT REQUIRED EXITS
RATED STAIR ENCLOSURES

FIRE ALARM REQUIREMENTS:
REQUIRED, PROVIDED – MANUAL & AUTOMATIC FIRE ALARM SYSTEM PER NFPA 72
SIGNALING SYSTEM IS AUDIBLE/VISUAL PER NFPA 72 & ADA INSTALLED THROUGHOUT
INITIATING DEVICES: PULL STATIONS; SMOKE DETECTION @ SLEEPING & COMMON AREAS, SPRINKLER SYSTEM FLOW AND TAMPER SWITCHES MONITORED.

SMOKE ALARM REQUIREMENTS:
REQUIRED, PROVIDED – SLEEPING ROOMS & AT EACH FLOOR

AUTOMATIC FIRE SUPPRESSION SYSTEM:
REQUIRED, PROVIDED PER NFPA 13R

EMERGENCY POWER SOURCE:
EXIT SIGNS, EXIT ILLUMINATION & EMERGENCY LIGHTING IS BY BATTERY BACK-UP

HAZARDOUS MATERIALS: *(PER IBC TABLE 307.1(1))*
NO HAZARDOUS MATERIALS ARE TO BE STORED

SMOKE CONTROL: NOT REQUIRED
SMOKE PARTITIONS: NOT REQUIRED
STANDPIPES: NOT REQUIRED

ASSEMBLY
SIGNS TO BE MOUNTED IN ASSEMBLY AREAS OF MAXIMUM OCCUPANT LOAD

TOTAL OCCUPANT LOAD: 1st–72, 2nd–39, 3rd–39 =150

EXITING: REFERENCE PLAN

OCCUPANT LOAD FACTORS:

OCCUPANCY	USE	LOAD FACTOR	MAX. OCC LD=1 EXIT
B	LOBBY	15 sf/OCCUPANT	49
B	OFFICE	150 sf/OCCUPANT	49
B	MECH/ELEC	300 sf/OCCUPANT	49
R-2	APARTMENT	200 sf/OCCUPANT	10

PROJECT INFORMATION

TYPE OF CONSTRUCTION	NEW SENIOR LIVING UNITS
FACILITY NAME	RESIDENCES AT RED CEDAR
FACILITY ADDRESS	xxxxxxxxxxxx xxxxxxxxxxxxx
OWNER NAME	OPG RED CEDAR PARTNERS,
OWNER ADDRESS	LLC 227 N SANTA FE, STE 310 SALINA, KS 67401 ph: 913–396–6310 fax: 913–396–6312
REASON FOR SUBMITTAL	NEW CONSTRUCTION
COUNTY	NAVARRO
FIRE DEPARTMENT	CORSICANA
WATER SUPPLY	CORSICANA
BUILDING INSPECTION DEPT	CORSICANA
AUTHORITY HAVING JURISDICTION	CORSICANA
ARCHITECT	JONES GILLAM RENZ ARCHITECTS, INC. 730 N. NINTH ST. SALINA, KS 67401 ph: 785–827–0386 fax: 785–827–0392
CODES/REGULATIONS	2018 INTERNATIONAL BUILDING CODE 2018 INTERNATIONAL MECHANICAL CODE 2018 INTERNATIONAL PLUMBING CODE 2020 NATIONAL ELECTRICAL CODE 2018 INTERNATIONAL FIRE CODE 2018 INTERNATIONAL ENERGY CONSERVATION CODE FAIR HOUSING ACT DESIGN MANUAL 2010 ADA STANDARDS for ACCESSIBLE DESIGN 2009 ICC A117.1 ACCESSIBLE & USABLE BUILDINGS and FACILITIES

LEGEND

DESIGNATED EMERGENCY EXIT — 68"/24.4" ⟵ EXIT WIDTH (ACTUAL/REQUIRED); 122/340 ⟵ OCCUPANT LOAD (ACTUAL/ALLOWED)

1 HOUR CONSTRUCTION (LD BRG WALLS)

1/2 HOUR FIRE PARTITION; CORRIDOR *(PER IBC TABLE 1018.1)* W/ 20 MIN OPENINGS *(PER IBC TABLE 716.5)*

1 HOUR FIRE PARTITION; BETWEEN DWELLING, SLEEPING UNITS W/ 45 MIN OPENINGS *(PER IBC 709.3 & 715.4)*

1 HOUR CONSTRUCTION; EXIT ENCLOSURE, SHAFT WALLS, W/ 60 MIN OPENINGS *(PER IBC TABLE 716.5)*

EXIT LIGHT
EMERGENCY LIGHT — EL
EXIT/EMERGENCY LIGHT — EL
FIRE EXTINGUISHER — FE
FIRE HYDRANT — FH
FIRE ALARM REMOTE ANNUNCIATOR PANEL — FAAP
FIRE ALARM CONTROL PANEL — FACP

EXAMPLE:

OCCUPANCY GROUP (AU – ACCESSORY USE)	A–1	
OCCUPANCY USE	ASSEMBLY	HALL
ROOM SQUARE FOOTAGE/OCCUPANT LOAD FACTOR	5,550	15
OCCUPANT LOAD/REQUIRED NUMBER OF EXITS	370	2

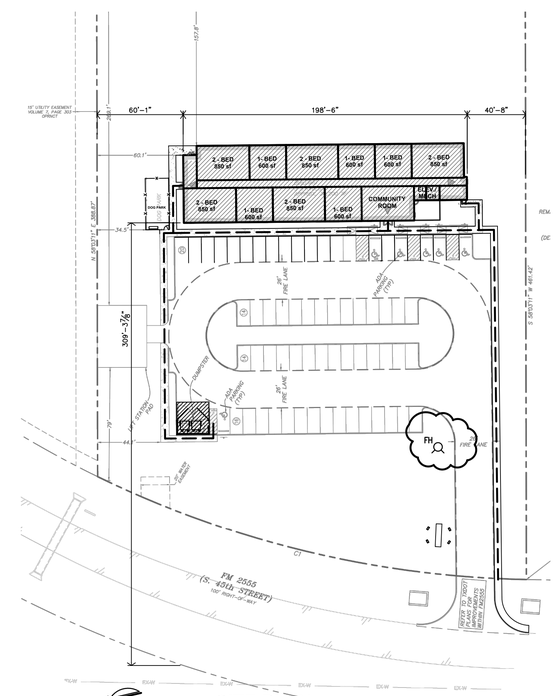

A SITE PLAN

0 25' 50' 100'
1"=50'-0"

JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386
1881 Main Street, Suite
Kansas City, MO 641
jgr@jgrarchitects.com

RESIDENCES AT RED CEDAR

SENIOR LIVING

CORSICANA, TEXAS

CODE FOOT PRINT & INFORMATION

REVISION:

DATE: 12–9–2024
JOB: 24–3392
SHEET NO.:

CFP

COPYRIGHTED ©

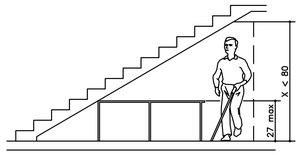

Vertical Clearance

S STANDARD VERTICAL CLEARANCE

NO SCALE

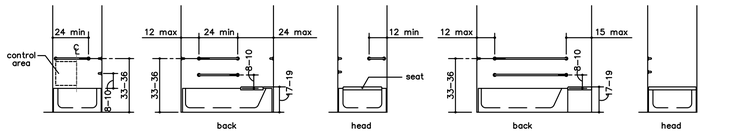

Controls Location | Grab Bars at Removable Seat | Grab Bars at Removable Seat | Grab Bars at Permanent Seat | Grab Bars at Permanent Seat

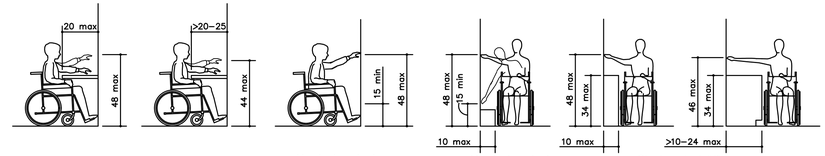

Obstructed High Forward Reach | Unobstructed Forward Reach | Unobstructed Side Reach | Obstructed High Side Reach

R STANDARD REACH ADA DIAGRAMS

NO SCALE

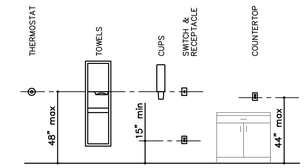

Q STANDARD CONTROL REACH LIMITATIONS DETAILS

NO SCALE



Beveled Change in Level

P THRESHOLD ADA DIAGRAMS

NO SCALE

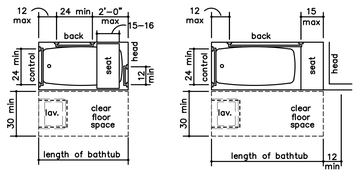

Clear Floor Space at Bathtub With Removable Seat | Clear Floor Space at Bathtub With Permanent Seat

O STANDARD BATHROOM/TUB ADA DIAGRAMS

NO SCALE



Hoistway and Elevator Entrances



Minimum Dimensions for Elevator Car



Car Control Height



Panel Detail

N STANDARD ELEVATOR ADA DIAGRAMS

NO SCALE

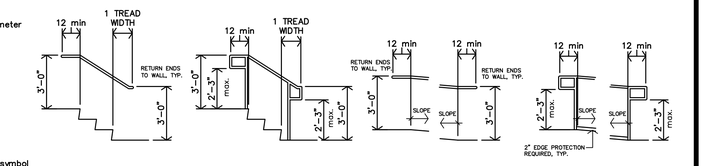

Stair Handrail Extensions at Walls | Stair Handail Extensions at Freestanding Handrails | Ramp Handrail Extensions at Walls | Ramp Handail Extensions at Freestanding Handrails

M STANDARD RAMP/STAIR HANDRAIL EXTENSIONS

NO SCALE

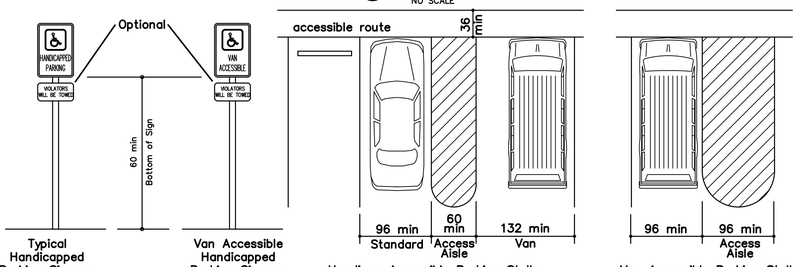

Typical Handicapped Parking Signage | Van Accessible Handicapped Parking Signage | Handicap Accessible Parking Stalls | Van Accessible Parking Stall (per 502.2 exception)

L STANDARD PARKING ADA DIAGRAMS

NO SCALE

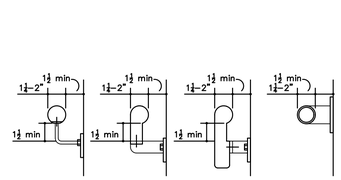

Handrail | Handrail | Handrail | Grab Bar

K STANDARD HANDRAIL/GRAB BAR DETAILS

NO SCALE

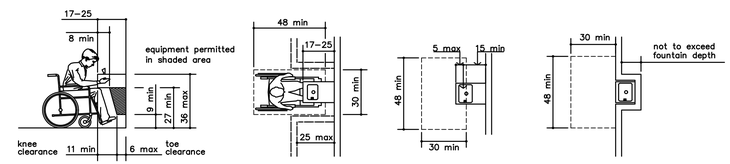

Toe and Knee Clearance Elevation | Toe and Knee Clearance Plan | Drinking Fountain Spout Location | Built–in Fountain or Cooler

J STANDARD DRINKING FOUNTAIN DETAILS

NO SCALE

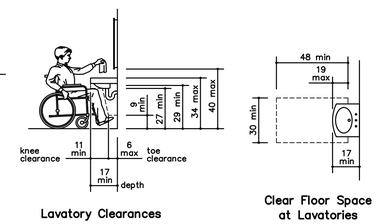

Lavatory Clearances | Clear Floor Space at Lavatories

H STANDARD LAVATORY DETAILS

NO SCALE

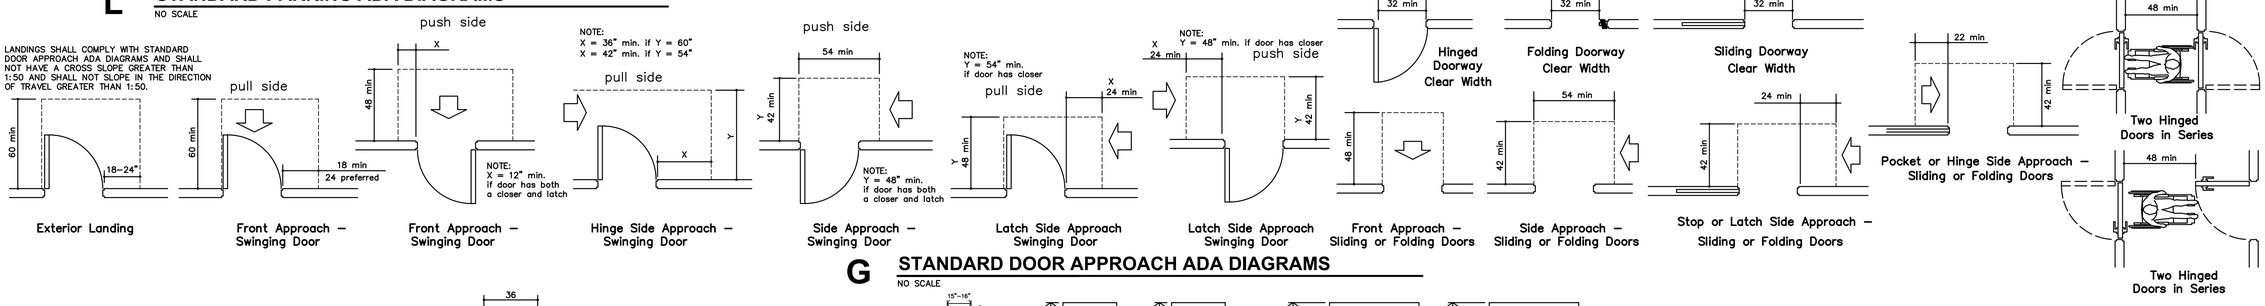

Exterior Landing | Front Approach – Swinging Door | Front Approach – Swinging Door | Hinge Side Approach – Swinging Door | Side Approach – Swinging Door | Latch Side Approach Swinging Door | Latch Side Approach Swinging Door | Front Approach – Sliding or Folding Doors | Side Approach – Sliding or Folding Doors | Stop or Latch Side Approach – Sliding or Folding Doors | Two Hinged Doors in Series

G STANDARD DOOR APPROACH ADA DIAGRAMS

NO SCALE

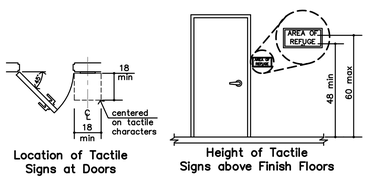

Location of Tactile Signs at Doors | Height of Tactile Signs above Finish Floors

F TACTILE SIGN DIAGRAM

NO SCALE

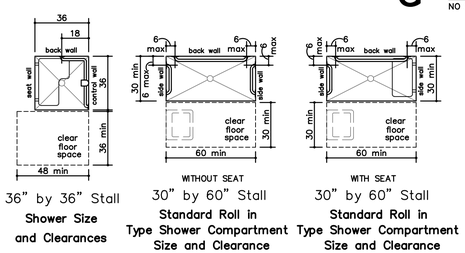

36" by 36" Stall Shower Size and Clearances | 30" by 60" Stall Standard Roll in Type Shower Compartment Size and Clearance | 30" by 60" Stall Standard Roll in Type Shower Compartment Size and Clearance | Seat Design

E STANDARD SHOWER ADA DIAGRAMS

NO SCALE

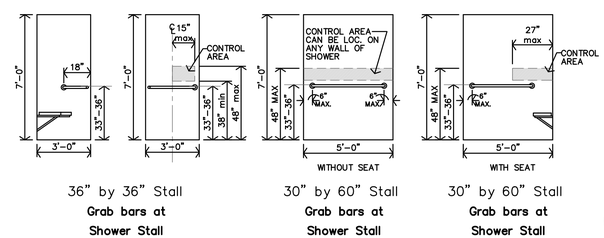

36" by 36" Stall Grab bars at Shower Stall | 30" by 60" Stall Grab bars at Shower Stall | 30" by 60" Stall Grab bars at Shower Stall

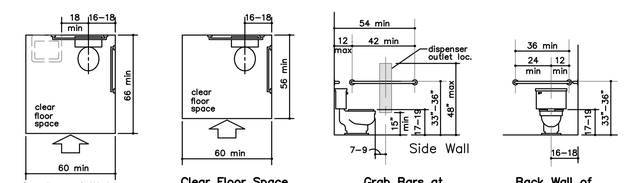

Overlap of Water Closet Clearance in Residential Dwelling Units (Exception) | Clear Floor Space at Water Closet | Grab Bars at Water Closets | Back Wall of Standard Stall

D STANDARD TOILET ADA DIAGRAMS

NO SCALE



Clear Floor Space at Urinal | Heights at Urinal

C STANDARD URINAL ADA DIAGRAMS

NO SCALE

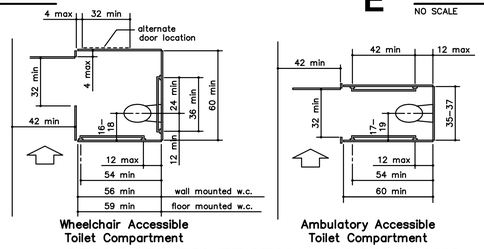

Wheelchair Accessible Toilet Compartment | Ambulatory Accessible Toilet Compartment

B STANDARD TOILET STALL ADA DIAGRAMS

NO SCALE

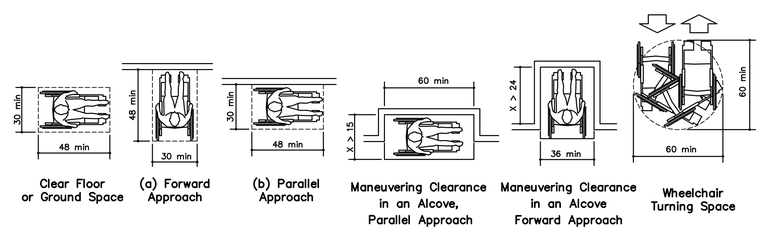

Clear Floor or Ground Space | (a) Forward Approach | (b) Parallel Approach | Maneuvering Clearance in an Alcove, Parallel Approach | Maneuvering Clearance in an Alcove Forward Approach | Wheelchair Turning Space

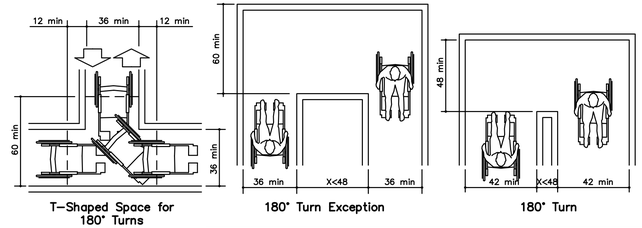

T–Shaped Space for 180° Turns | 180° Turn Exception | 180° Turn

A STANDARD ADA DIAGRAMS

NO SCALE

FOR REFERENCE ONLY

JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386
1881 Main Street, Suite 3
Kansas City, MO 6410
jgr@jgrarchitects.com

THE RESIDENCE AT RED CEDAR

NEW SENIOR-LIVING FACILITY

CORSICANA, TEXAS

REVISION:

DATE: 12–10–2024
JOB: 24–3392
SHEET NO.:

ADA

COPYRIGHTED ©

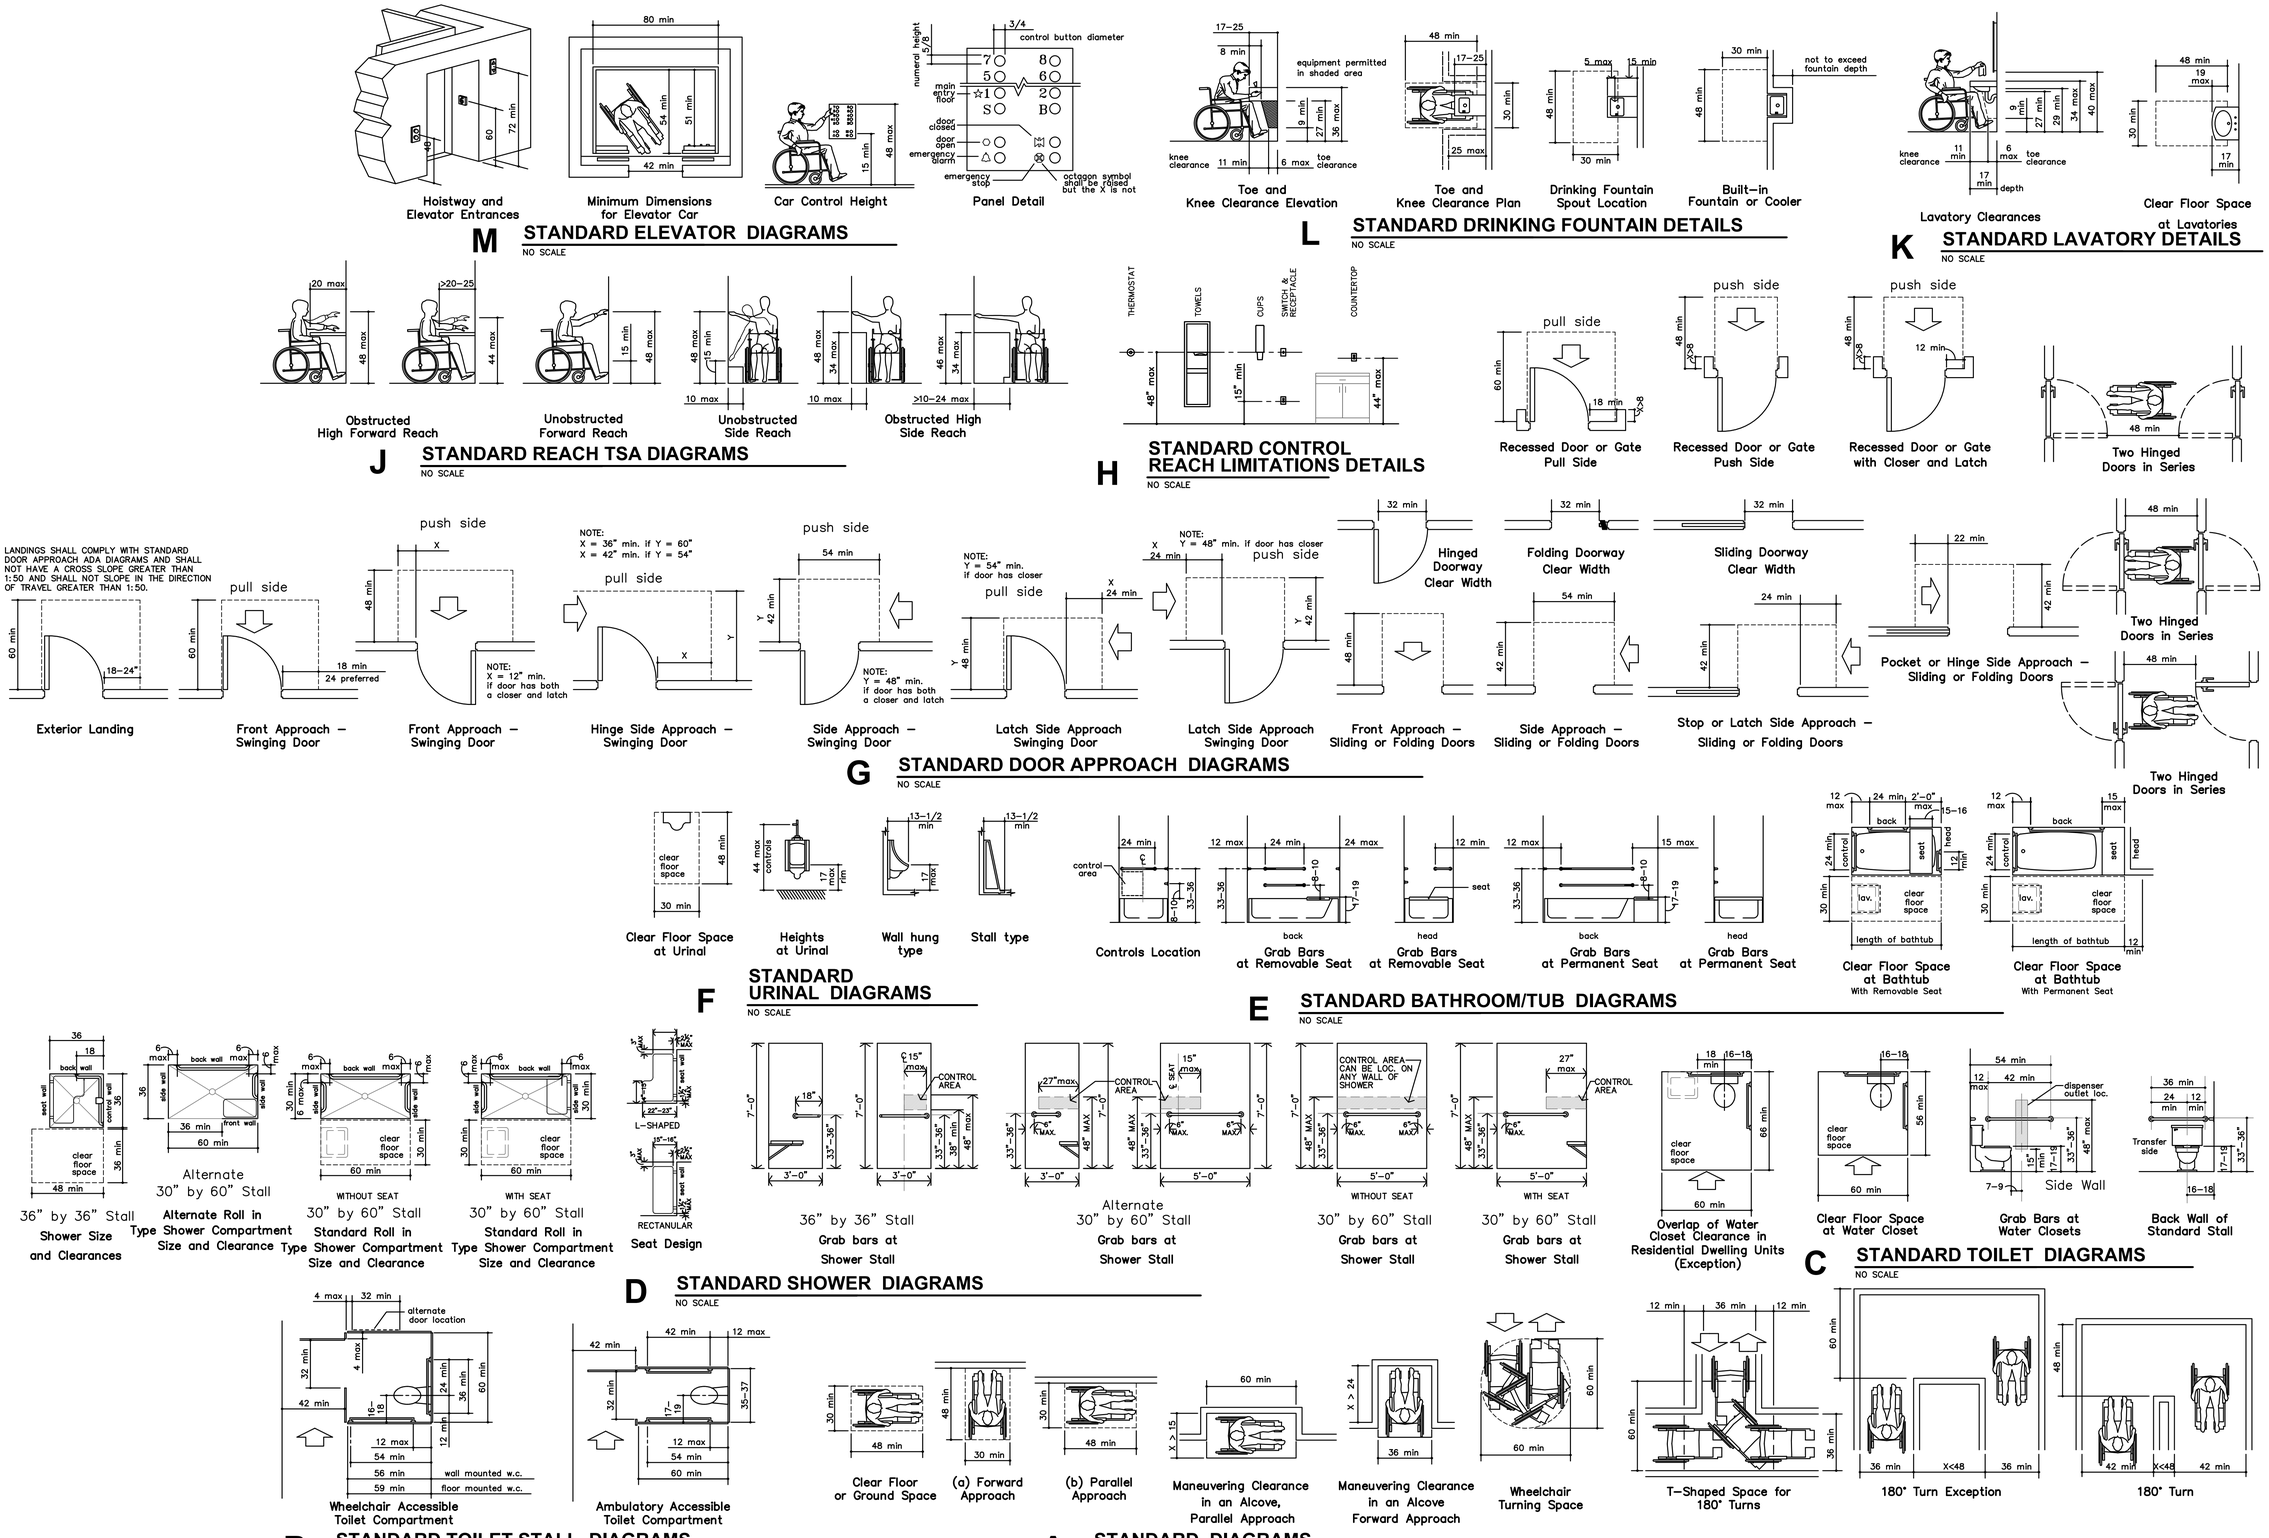

FOR REFERENCE ONLY

JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386
1881 Main Street, Suite 30
Kansas City, MO 64108
jgr@jgrarchitects.com

THE RESIDENCE AT RED CEDAR

NEW SENIOR-LIVING FACILITY

CORSICANA, TEXAS

REVISION:

DATE: 12-10-2024
JOB: 24-3392
SHEET NO.:

TAS1

COPYRIGHTED ©



Beveled Change in Level Vertical Change in Level

K THRESHOLD DIAGRAMS
NO SCALE



Top loading Front loading

J LAUNDRY
NO SCALE

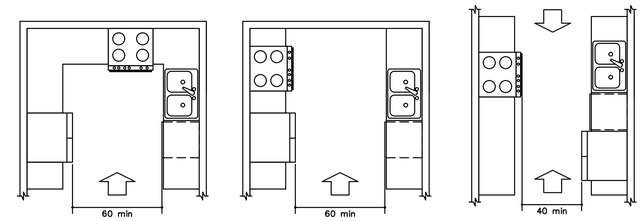

U–shaped Kitchens Pass Through Kitchens

H KITCHENS
NO SCALE



Location of Tactile Signs at Doors

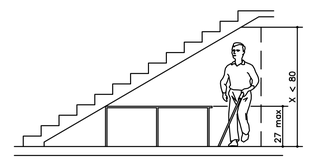

Vertical Clearance

G STANDARD VERTICAL CLEARANCE
NO SCALE



Handrail Handrail Handrail Grab Bar

F STANDARD HANDRAIL/GRAB BAR DETAILS
NO SCALE



Height of Tactile Signs above Finish Floors

E TACTILE SIGN DIAGRAM
NO SCALE



Radius of Tread Edge (typical for all profiles)



Curved Nosing Beveled Nosing

D STANDARD STAIR NOSING DETAILS
NO SCALE

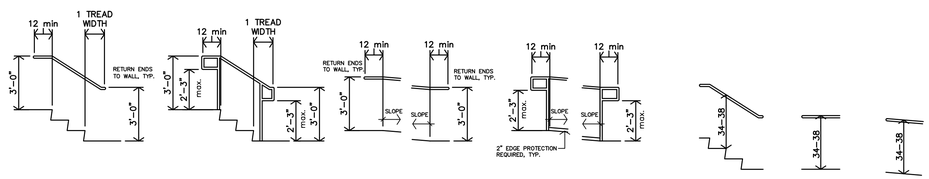

Stair Handrail Extensions at Walls Stair Handail Extensions at Freestanding Handrails Ramp Handrail Extensions at Walls Ramp Handail Extensions at Freestanding Handrails Stairs Walking Surfaces Ramps

Handrail height

C STANDARD RAMP/STAIR HANDRAIL EXTENSIONS
NO SCALE



Sides and Landing of Curb Ramps

Counter Slope of Surfaces Adjacent to Curb Ramps

B STANDARD CURB RAMPS DIAGRAMS
NO SCALE



Typical Handicapped Parking Signage Van Accessible Handicapped Parking Signage

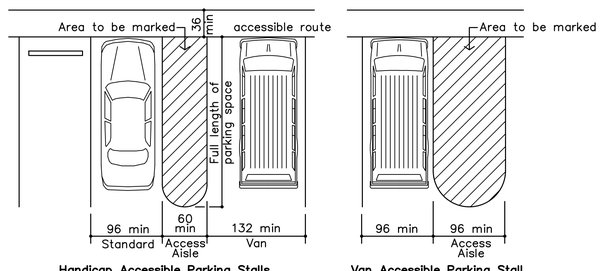

Handicap Accessible Parking Stalls Van Accessible Parking Stall (per 502.2 exception)

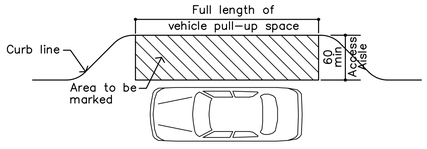

A STANDARD PARKING DIAGRAMS
NO SCALE

FOR REFERENCE ONLY

JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386
1881 Main Street, Suite 30
Kansas City, MO 64108
jgr@jgrarchitects.com

THE RESIDENCE AT RED CEDAR
NEW SENIOR-LIVING FACILITY
CORSICANA, TEXAS

REVISION:

DATE: 12–10–2024
JOB: 24–3392
SHEET NO.:

TAS2

COPYRIGHTED ©



Figure 19(c)
Stair Handrails - Extension at Bottom of Run

Note: X is the 12 in minimum handrail extension required at each top riser. Y is the minimum handrail extension of 12 in plus the width of one tread that is required at each bottom riser.

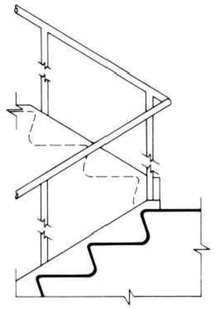



Figure 19(d)
Stair Handrails - Extension at Top of Run

Note: X is the 12 in minimum handrail extension required at each top riser. Y is the minimum handrail extension of 12 in plus the width of one tread that is required at each bottom riser.

J STANDARD UFAS HANDRAILS
NO SCALE

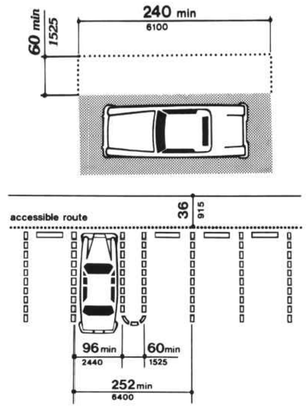

B STANDARD UFAS PARKING SPACES
NO SCALE



F GENERAL UFAS DIAGRAM
NO SCALE

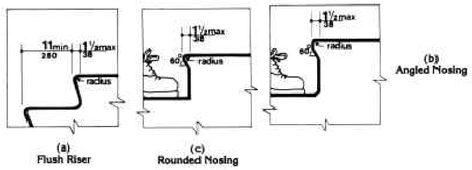

C STAIR NOSINGS
NO SCALE



Figure 12(a)

4.7.5 SIDES OF CURB RAMPS. If a curb ramp is located where pedestrians must walk across the ramp, or where it is not protected by handrails or guardrails, then it shall have flared sides; the maximum slope of the flare shall be 1:10 (see Fig. 12(a)). Curb ramps with returned curbs may be used where pedestrians would not normally walk across the ramp (see Fig. 12(b)).

Note: If X is less than 48 inches, then the slope of the flared side shall not exceed 1:12.

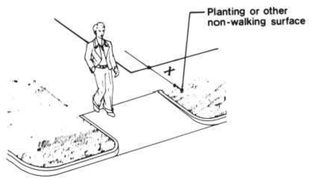

Figure 12(b)

H STANDARD UFAS CURB RAMPS
NO SCALE

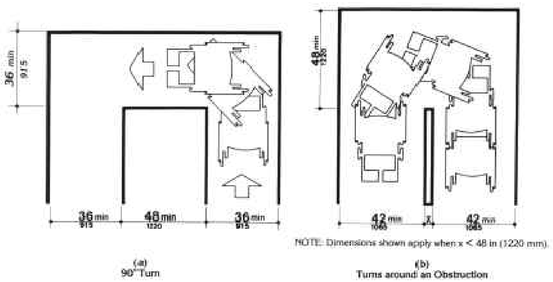

NOTE: Dimensions shown apply when x < 48 in (1220 mm).

(a) 90° Turn
(b) Turns around an Obstruction

E UFAS WIDTH DIAGRAMS
NO SCALE

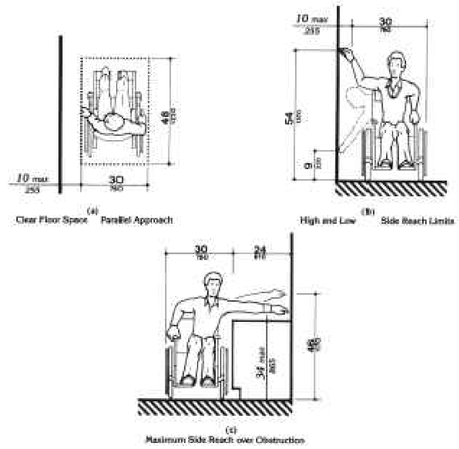

(a) Clear Floor Space Parallel Approach
(b) High and Low Side Reach Limits
(c) Maximum Side Reach over Obstruction

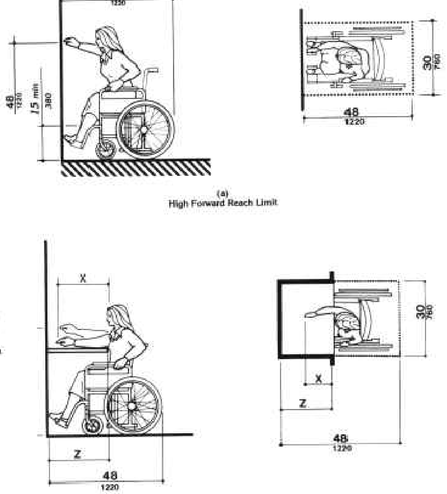

(a) High Forward Reach Limit

d be ≤ 25 in (635 mm); x shall be ≥ x. When x < 20 in (510 mm), then y shall be 48 in (1220 mm) maximum. to 25 in (510 to 635 mm), then y shall be 44 in (1120 mm) maximum.

(b) Maximum Forward Reach over an Obstruction

A STANDARD UFAS REACH DIAGRAMS
NO SCALE



G STANDARD UFAS SLOPE
NO SCALE

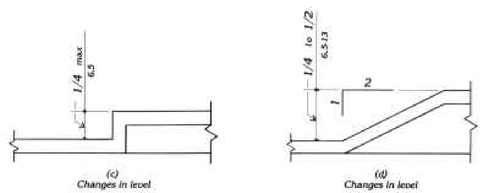

(c) Changes in level
(d) Changes in level

D UFAS CHANGE IN LEVEL DIAGRAM
NO SCALE

NOTE:
REFERENCE FULL UNIFORM FEDERAL ACCESSIBILITY STANDARDS FOR ADDITIONAL INFORMATION.

FOR REFERENCE ONLY

JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386
1881 Main Street, Suite 30
Kansas City, MO 64108
jgr@jgrarchitects.com

THE RESIDENCE AT RED CEDAR
NEW SENIOR-LIVING FACILITY
CORSICANA, TEXAS

REVISION:

DATE: 12-10-2024
JOB: 24-3392
SHEET NO.:
UFAS 1

COPYRIGHTED ©

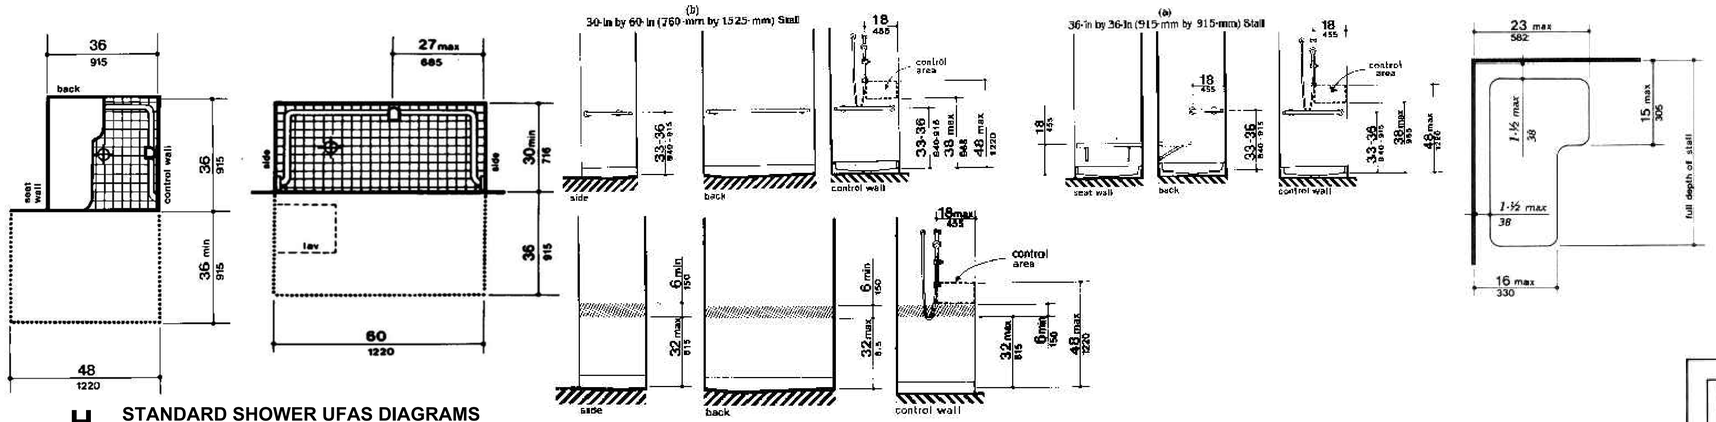

H STANDARD SHOWER UFAS DIAGRAMS

NO SCALE



G UFAS LAVRATORY CLEARANCES

NO SCALE

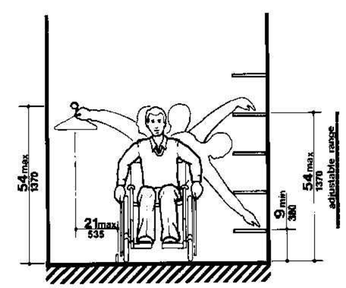

F STANDARD UFAS CLOSET/STORAGE HEIGHT

NO SCALE

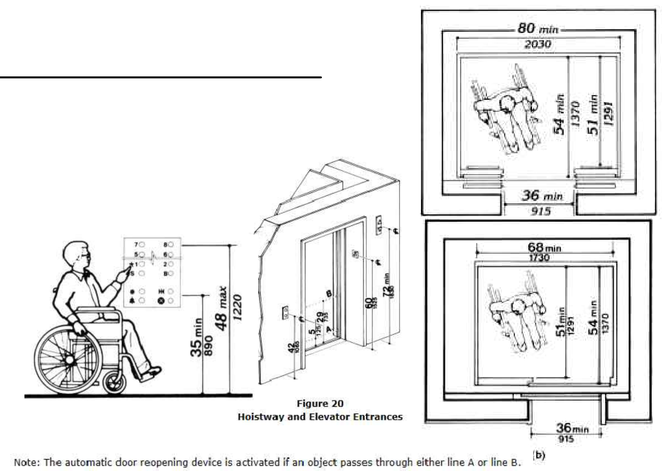

Figure 20
Hoistway and Elevator Entrances

Note: The automatic door reopening device is activated if an object passes through either line A or line B. Line A and line B represent the vertical locations of the door reopening device not requiring contact.

E STANDARD UFAS ELEVATOR DETAILS

NO SCALE

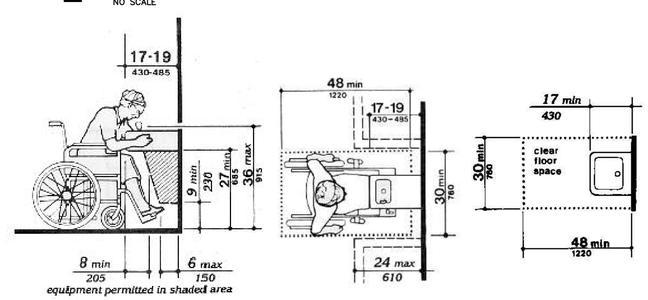

B STANDARD UFAS DRINKING FOUNTAIN CLEARANCE

NO SCALE

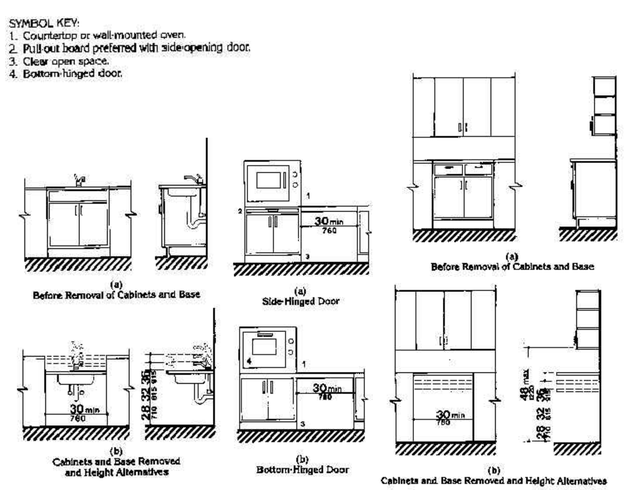

D STANDARD UFAS KITCHEN DIAGRAMS

NO SCALE

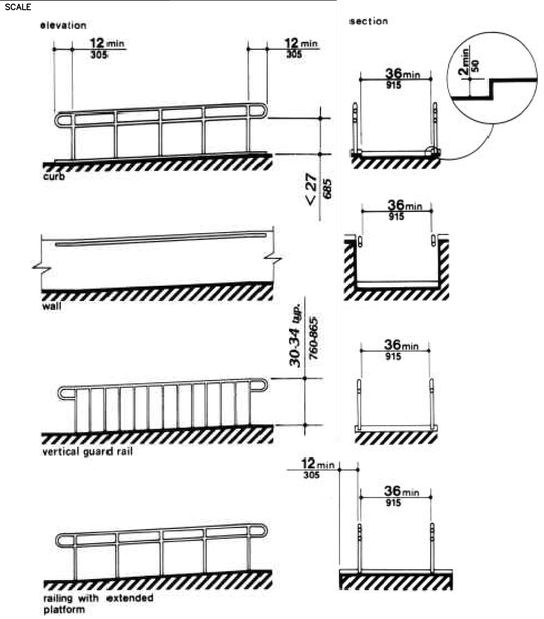

C UFAS EDGE PROTECTION

NO SCALE

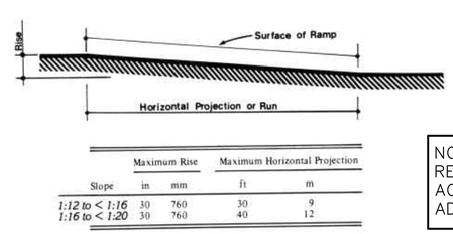

Slope	Maximum Rise in	Maximum Rise mm	Maximum Horizontal Projection ft	Maximum Horizontal Projection m
1:12 to < 1:16	30	760	30	9
1:16 to < 1:20	30	760	40	12

NOTE:
REFERENCE FULL UNIFORM FEDERAL ACCESSIBILITY STANDARDS FOR ADDITIONAL INFORMATION.

A SLOPE AND RISE

NO SCALE

FOR REFERENCE ONLY

JonesGillamRenz
730 N. Ninth 1881 Main Street, Suite 3
Salina, KS 67401 Kansas City, MO 6410
785.827.0386 jgr@jgrarchitects.com

THE RESIDENCE AT RED CEDAR

NEW SENIOR-LIVING FACILITY

CORSICANA, TEXAS

REVISION:

DATE: 12-10-2024
JOB: 24-3392
SHEET NO.:

UFAS 2

COPYRIGHTED ©

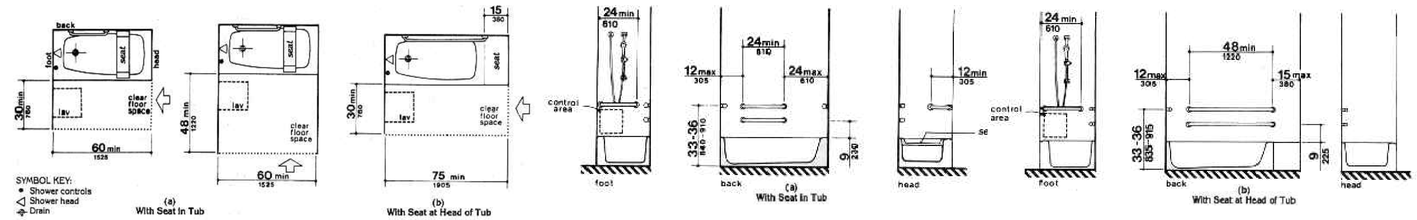

C STANDARD BATHROOM/TUB DIAGRAMS

NO SCALE

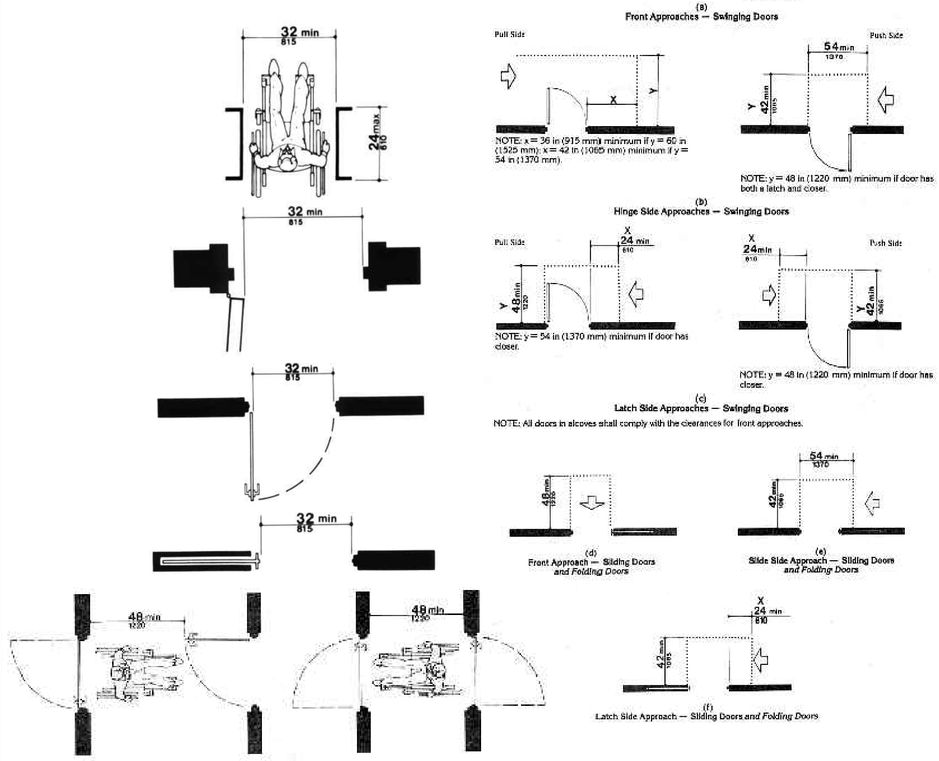

B STANDARD UFAS DOOR APRROACH/CLEARANCES

NO SCALE

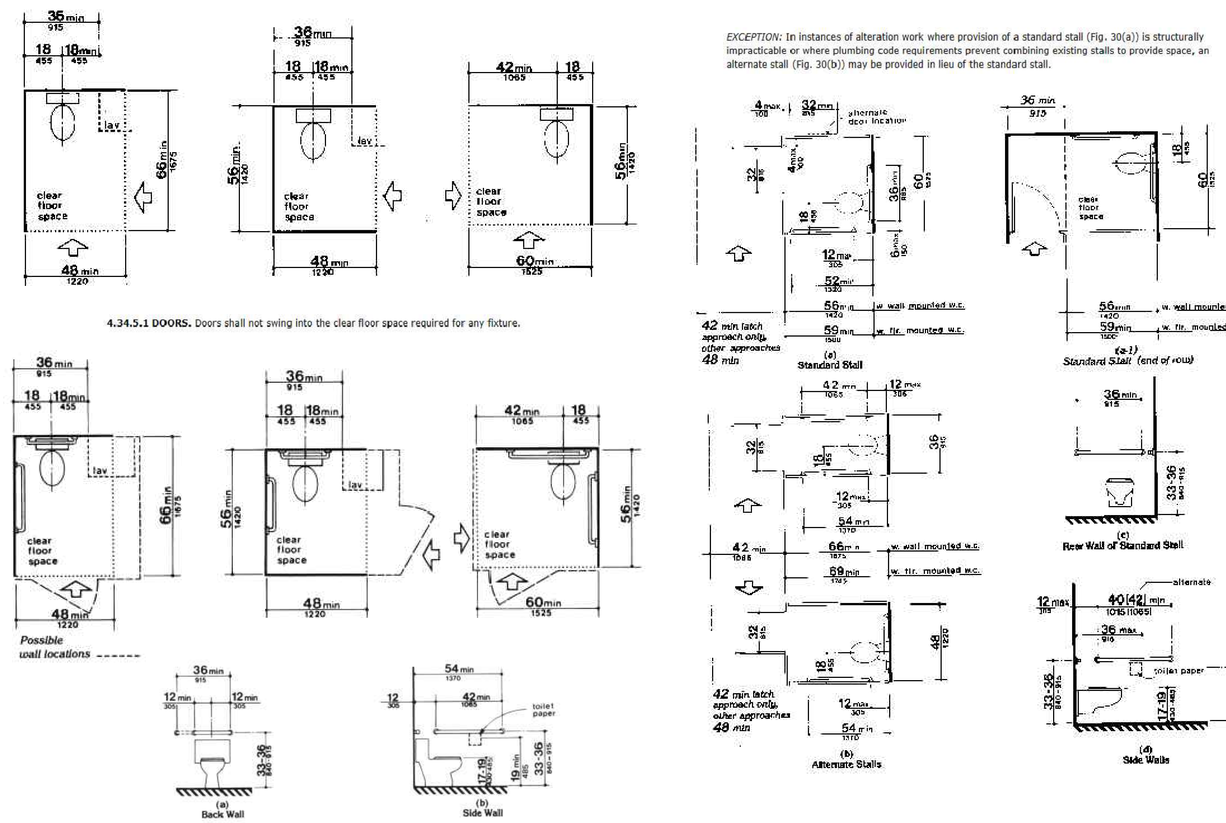

A STANDARD UFAS TOILERT/WATER CLOSET DIAGRAMS

NO SCALE

NOTE:
REFERENCE FULL UNIFORM FEDERAL ACCESSIBILITY STANDARDS FOR ADDITIONAL INFORMATION.

FOR REFERENCE ONLY

JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386
1881 Main Street, Suite 3
Kansas City, MO 6410
jgr@jgrarchitects.com

THE RESIDENCE AT RED CEDAR

NEW SENIOR-LIVING FACILITY

CORSICANA, TEXAS

REVISION:

DATE: 12-10-2024
JOB: 24-3392
SHEET NO.:

UFAS 3

COPYRIGHTED ©

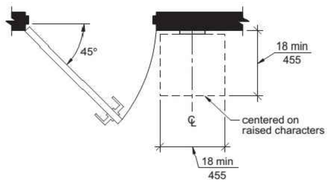

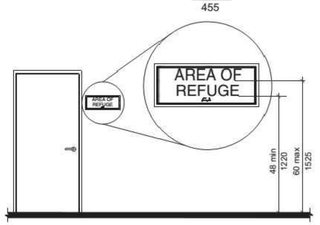

Note: For braille character mounting height see Section 703.4.5

V SIGNAGE (Section 703)
NO SCALE



U HANDRAIL CROSS SECTION (Section 505)
NO SCALE



S HANDRAIL HEIGHT (Section 505)
NO SCALE

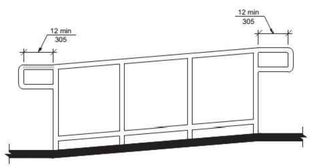

T RAMP TOP & BOTTOM HANDRAIL EXTENTION (Section 505)
NO SCALE



R STAIR TOP & BOTTOM HANDRAIL EXTENTION (Section 505)
NO SCALE



Q STAIR TREAD & RISER (Section 504)
NO SCALE

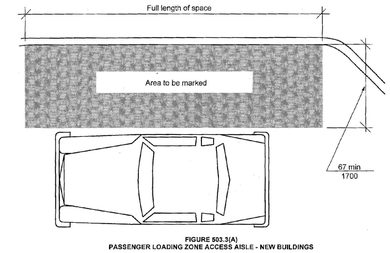

P PASSENGER LOADING ZONE (Section 503)
NO SCALE

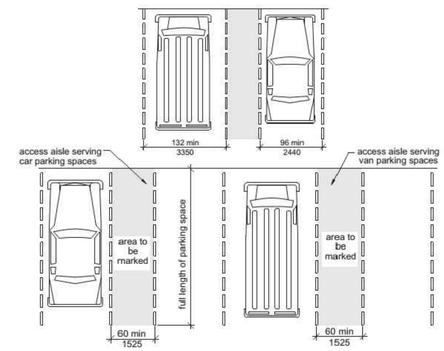

O ACCESSIBLE PARKING SPACES (Section 502)
NO SCALE

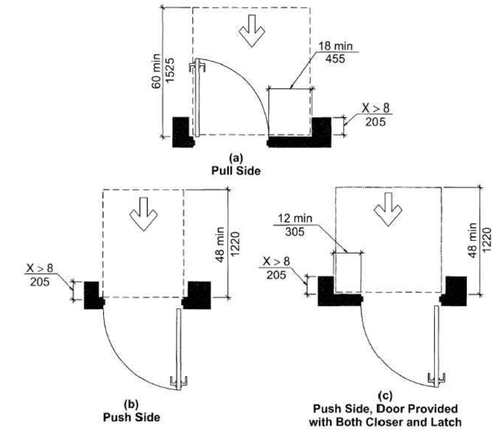

N MANEUVERING CLEARANCES AT RECESSED DOORS (Section 404)
NO SCALE

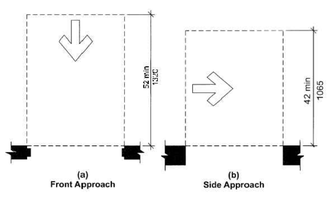

M MANEUVERING CLEARANCES AT DOORWAYS without DOORS (Section 404)
NO SCALE

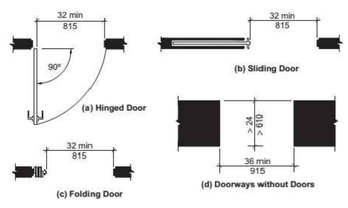

L CLEAR WIDTH OF DOORWAYS (Section 404)
NO SCALE

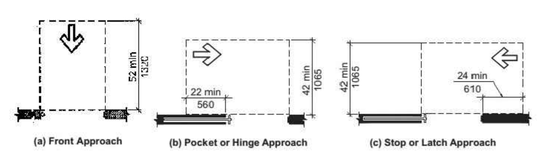

K MANEUVERING CLEARANCES AT SLIDING & FOLDING DOORS (Section 404)
NO SCALE

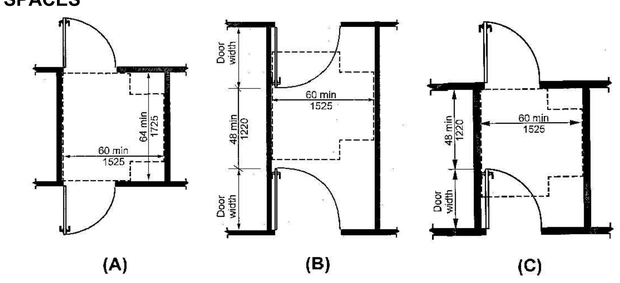

J TWO DOORS IN SERIES (Section 404)
NO SCALE

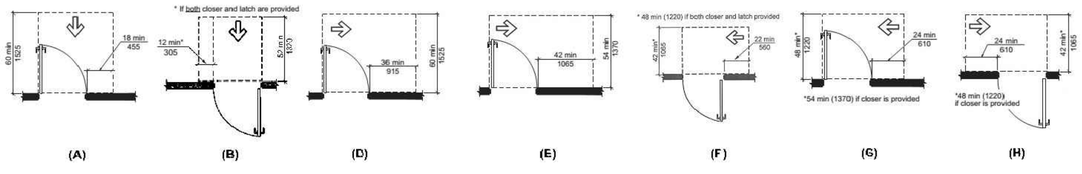

H MANEUVERING CLEARANCE AT MANUAL SWINGING DOORS (Section 404)
NO SCALE

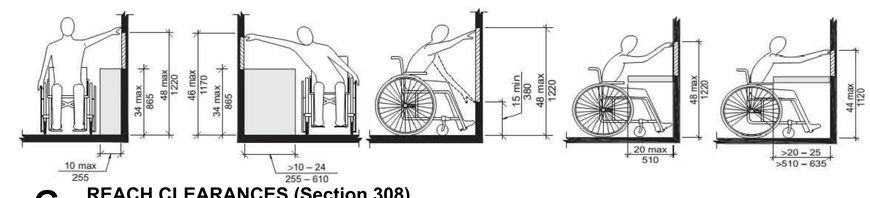

G REACH CLEARANCES (Section 308)
NO SCALE



F VERTICAL CLEARANCE (Section 307)
NO SCALE

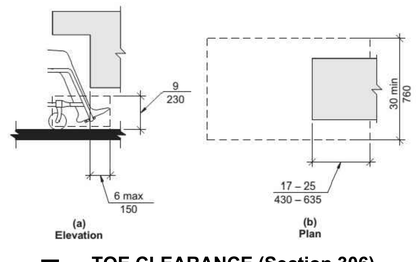

E TOE CLEARANCE (Section 306)
NO SCALE

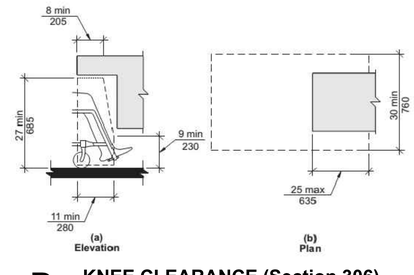

D KNEE CLEARANCE (Section 306)
NO SCALE



C CHANGES IN LEVEL (Section 303)
NO SCALE



B CLEAR FLOOR SPACE (305)
NO SCALE

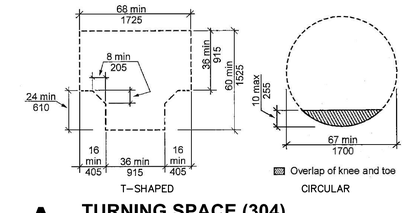

A TURNING SPACE (304)
NO SCALE

THIS SHEET IS FOR INFORMATIONAL PURPOSES ONLY & CONTAINS KEY ILLUSTRATIONS OF ICC A117.1-2017, ACCESSIBLE and USEABLE BUILDINGS and FACILITIES, FOR MORE INFORMATION REFERENCE ENTIRE REQUIREMENTS.

JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386
1881 Main Street, Suite 30
Kansas City, MO 64108
jgr@jgrarchitects.com

THE RESIDENCE AT RED CEDAR

NEW SENIOR-LIVING FACILITY

CORSICANA, TEXAS

REVISION:

DATE: 12–10–2024
JOB: 24–3392
SHEET NO.:

ANSI-1

COPYRIGHTED ©

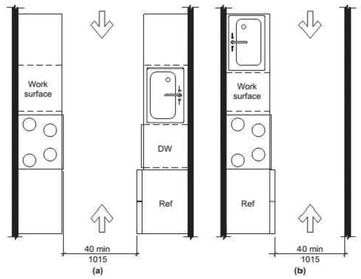

V PASS-THRU KITCHEN CLEARANCE (Section 804)
NO SCALE

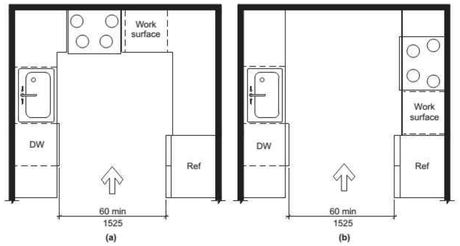

U U-SHAPED KITCHEN CLEARANCE (Section 804)
NO SCALE

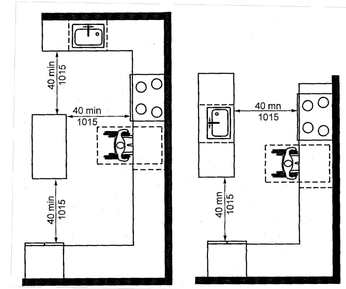

T U-SHAPED KITCHEN CLEARANCE EXCEPTION (Section 804)
NO SCALE

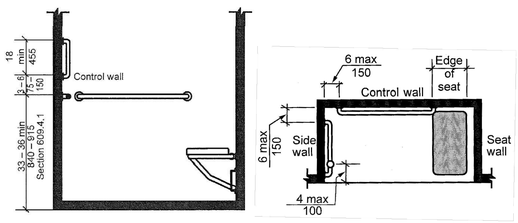

S ROLL-IN SHOWER GRAB BARS (Section 608)
NO SCALE

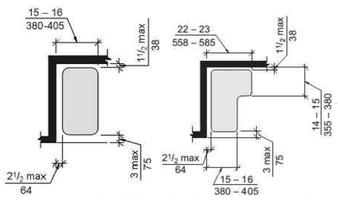

O SHOWER SEATS (Section 610)
NO SCALE





Note: inside finished dimensions measured at the center points of opposing sides

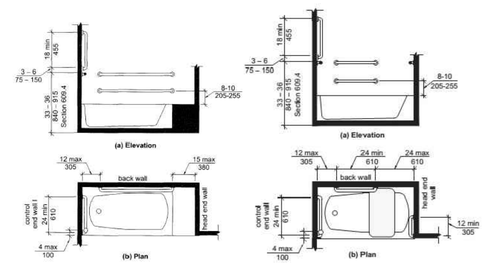

L GRAB BARS FOR BATHTUBS (Section 607)
NO SCALE

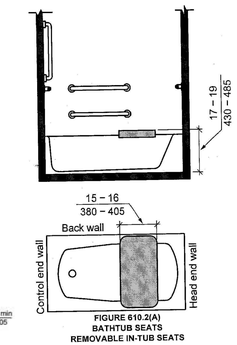

K BATHTUB SEAT (Section 610)
NO SCALE



R ROLL-IN SHOWER CONTROLS LOCATION (Section 608)
NO SCALE



Q ROLL-IN SHOWER SIZE & CLEARANCE (Section 608)
NO SCALE



O TRANSFER SHOWER CONTROLS LOCATION (Section 608)
NO SCALE



N TRANSFER SHOWER GRAB BARS (Section 608)
NO SCALE

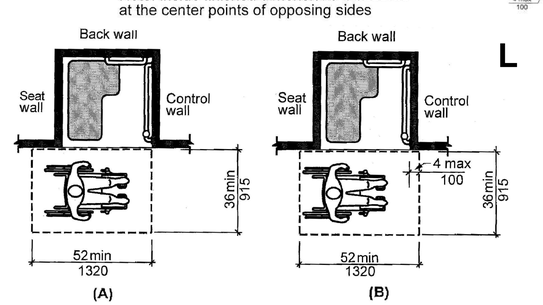

M TRANSFER SHOWER SIZE & CLEARANCE (Section 608)
NO SCALE



J BATHTUB CONTROLS (Section 607)
NO SCALE

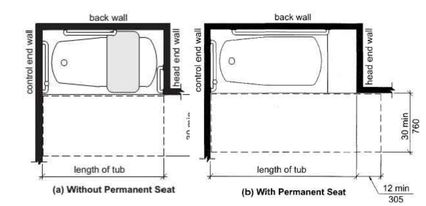

H CLEARANCES FOR BATHTUBS (Section 607)
NO SCALE



G HEIGHT OF LAVATORIES & SINKS (Section 606)
NO SCALE



F HEIGHT OF URINALS (Section 605)
NO SCALE

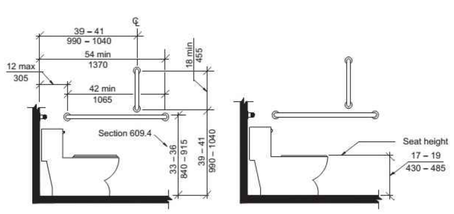

E WATER CLOSET HEIGHT & SIDE WALL GRAB BAR (Section 604)
NO SCALE

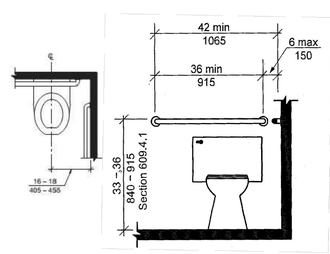

D WATER CLOSET LOCATION & REAR WALL GRAB BAR (Section 604)
NO SCALE



C CLEARANCES AT WATER CLOSET (Section 604)
NO SCALE

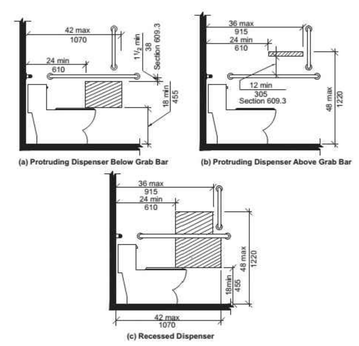

B DISPENCER OUTLET LOCATION (Section 604)
NO SCALE

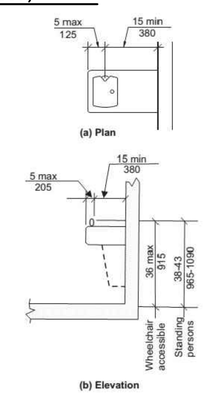

A DRINKING FOUNTAIN (Section 602)
NO SCALE

THIS SHEET IS FOR INFORMATIONAL PURPOSES ONLY & CONTAINS KEY ILLUSTRATIONS OF ICC A117.1-2017, ACCESSIBLE and USEABLE BUILDINGS and FACILITIES, FOR MORE INFORMATION REFERENCE ENTIRE REQUIREMENTS.

JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386
1881 Main Street, Suite 30
Kansas City, MO 64108
jgr@jgrarchitects.com

THE RESIDENCE AT RED CEDAR

NEW SENIOR-LIVING FACILITY

CORSICANA, TEXAS

REVISION:

DATE: 12–10–2024
JOB: 24–3392
SHEET NO.:

ANSI-2

COPYRIGHTED ©

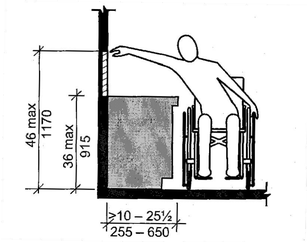

P REACH RANGE OVER KTICHEN or BATH CABINET - TYPE B UNITS (Section 1104)
NO SCALE



O BATHTUB CLEARANCES AT TYPE B UNITS - OPT B BATH (Section 1104)
NO SCALE



N BATHTUB CLEARANCES AT TYPE B UNITS - OPT A BATH (Section 1104)
NO SCALE

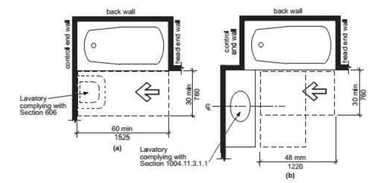

M BATHTUB CLEARANCES AT TYPE B UNITS - OPT A BATH (Section 1104)
NO SCALE

L LAVATORY AT TYPE B UNITS - OPT A BATH (Section 1104)
NO SCALE

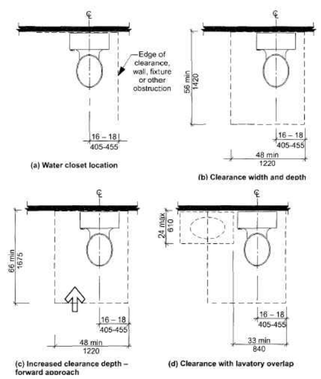

K WATER CLOSET CLEARANCES TYPE B UNITS (Section 1104)
NO SCALE



J TRANSFER SHOWER AT TYPE B UNITS (Section 1104)
NO SCALE

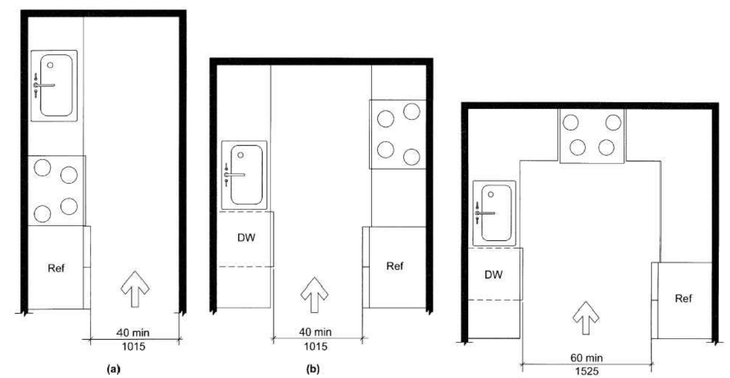

H MIN KITCHEN CLEARANCE - TYPE B UNITS (Section 1104)
NO SCALE

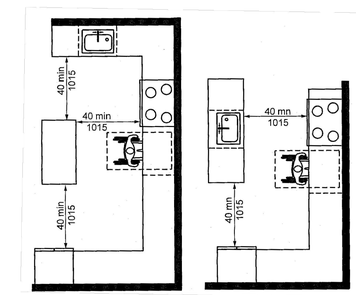

G U-SHAPED KITCHEN CLEARANCE -TYPE B UNITS - EXCEPTION (Section 1104)
NO SCALE



F ROLL-IN SHOWER CLEARANCES TYPE A UNITS (Section 1103)
NO SCALE

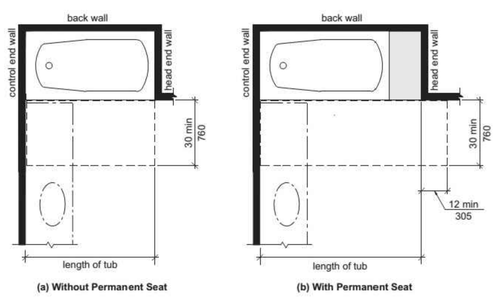

E BATHTUB CLEARANCES TYPE A UNITS (Section 1003)
NO SCALE

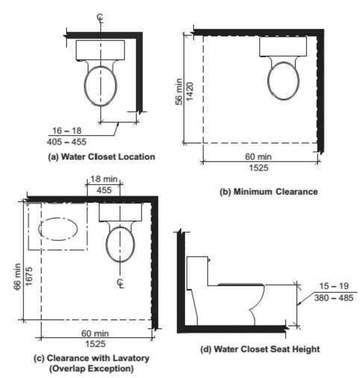

D WATER CLOSET CLEARANCES TYPE A UNITS (Section 1103)
NO SCALE



C WORK SURFACE - TYPE A UNITS (Section 1103)
NO SCALE



B KITCHEN SINK - TYPE A UNITS (Section 1103)
NO SCALE

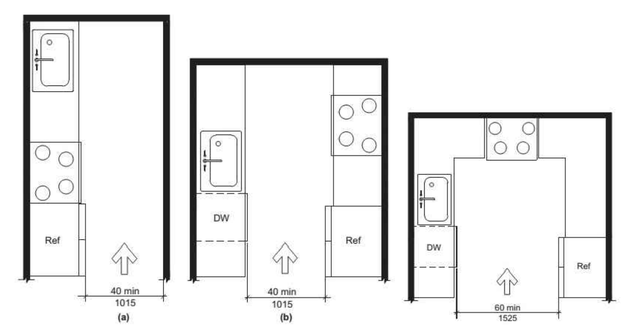

A MIN KITCHEN CLEARANCE - TYPE A UNITS (Section 1103)
NO SCALE

THIS SHEET IS FOR INFORMATIONAL PURPOSES ONLY & CONTAINS KEY ILLUSTRATIONS OF ICC A117.1-2017, ACCESSIBLE and USEABLE BUILDINGS and FACILITIES, FOR MORE INFORMATION REFERENCE ENTIRE REQUIREMENTS.

JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386
1881 Main Street, Suite 30
Kansas City, MO 64108
jgr@jgrarchitects.com

THE RESIDENCE AT RED CEDAR
NEW SENIOR-LIVING FACILITY
CORSICANA, TEXAS

REVISION:

DATE: 12–10–2024
JOB: 24–3392
SHEET NO.:
ANSI-3

COPYRIGHTED ©

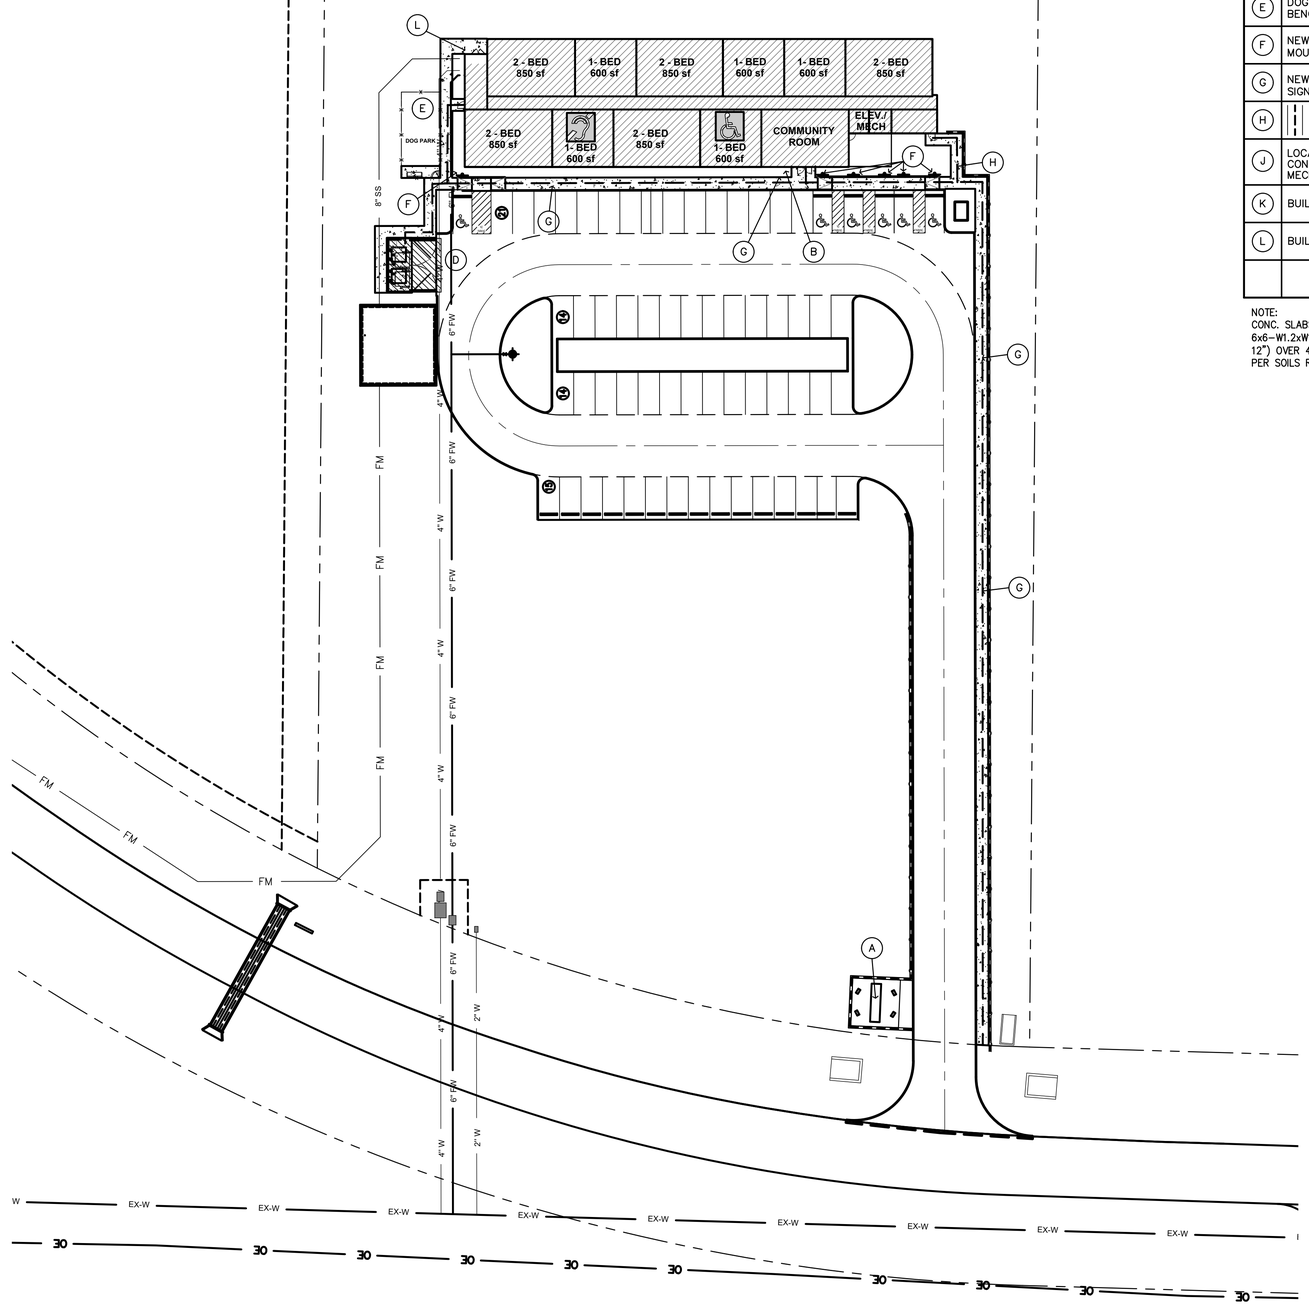

A SITE PLAN
1"=30'-0"

SITE PLAN KEY NOTES

A	MONUMENT SIGN, BASE BID REF. SHEET A1.2
B	KNOX BOX COORD. W/ FIRE DEPT. (TYP)
C	BUILDING TRANSFORMER REF. ELECT. DWGS. CONTRACTOR TO COORDINATE SIZE OF CONC. PAD WITH ELECT. COMPANY
D	HC TRASH ENCLOSURE REF. SHEET A1.2
E	DOG PARK, 4' TALL ALUM. FENCE, GATE, CONCRETE PAD, BENCHES, AS INDICATED, REF ENLARGED PLAN A–A1.3
F	NEW POLE MOUNTED H.C. PARKING SIGN MOUNT BTM. OF SIGN @ 60"A.F.F. (TYP)
G	NEW POLE MOUNTED H.C. "VAN" PARKING SIGN MOUNT BTM. OF SIGN @ 60"A.F.F. (TYP)
H	DASHED LINE INDICATES ACCESSIBLE PATH
J	LOCATION OF CONDENSING UNIT, REF. MECH. DWGS. CONTRACTOR TO COORDINATE SIZE OF CONC. PAD WITH MECH. COMPANY
K	BUILDING METER CENTER REF. ELECT. DWGS
L	BUILDING FIRE SPRINKLER ROOM REF. MECH. DWGS

NOTE:
CONC. SLABS @ SITE AMENITIES SHALL BE 4"th. 3,500 PSI W/ 6x6–W1.2xW1.2 WWF. SLOPE ACROSS SLAB NO MORE THAN 2% (1/8" PER 12") OVER 4"th. GRANULAR FILL (MIN.) COMPACTED OVER SUBGRADE, PREP PER SOILS REPORT.

LOT COVERAGE

SITE ACRES	SITE SQUARE FOOT	BLDG COVERAGE (GSF FOOTPRINT)	LOT COVERAGE
3.00 ACRES	130,680	10,219 sf	7.8%

ACCESSIBLE UNIT LEGEND

(2) UNITS SHALL BE ACCESSIBLE – 5% of total
(1) 1–bedroom
(1) 2–bedroom

(1) UNITS SHALL BE HEARING & VISION IMPAIRED ACCESSIBLE – 2% of total
(1) 1–bedroom

ACCESSIBLE WALK OR PATH

PARKING SUMMARY

CODE REQUIRED	
TOTAL STALLS	64
HANDICAP STALLS	3

PROVIDED	
HANDICAP PARKING STALLS	6
STANDARD PARKING STALLS	58
TOTAL PARKING STALLS	64
PARKING RATIO (STALLS/UNITS)	2.00

FLOOD PLAIN

BASED ON THE FEMA FLOOD PLAIN MAPS, THIS PROJECT SITE IS LOCATED IN ZONE X.

STORM WATER RETENTION

ON SITE STORM WATER DETENTION IS REQUIRED AND SHOWN

JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386
1881 Main Street, Suite 3
Kansas City, MO 6410
jgr@jgrarchitects.com

THE RESIDENCE AT RED CEDAR
NEW SENIOR-LIVING FACILITY
CORSICANA, TEXAS

REVISION:

DATE: 12–10–2024
JOB: 24–3392
SHEET NO.:

A1.1

COPYRIGHTED ©

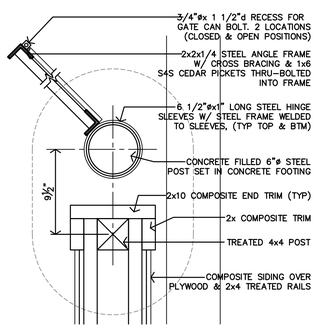

D DETAIL
1 1/2"=1'-0"

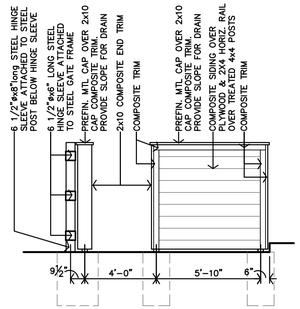

C TRASH ENCLOSURE SIDE ELEVATION
1/4"=1'-0"

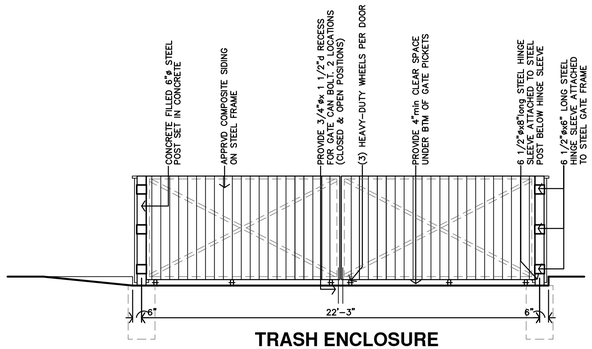

B TRASH ENCLOSURE FRONT ELEVATION
1/4"=1'-0"

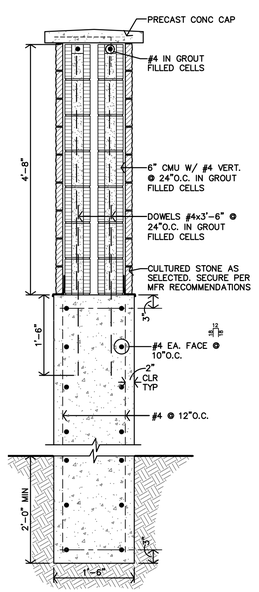

K MONUMENT SIGN SECTION
3/8"=1'-0"

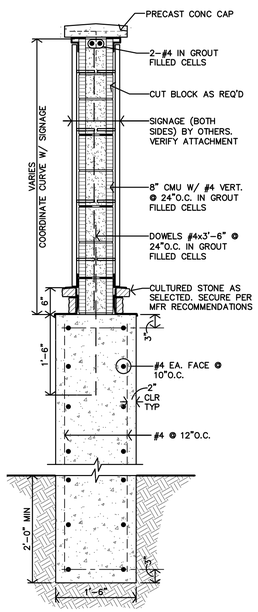

J MONUMENT SIGN SECTION
3/8"=1'-0"

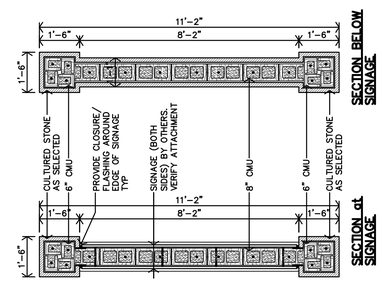

H MONUMENT SIGN SECTION
3/8"=1'-0"

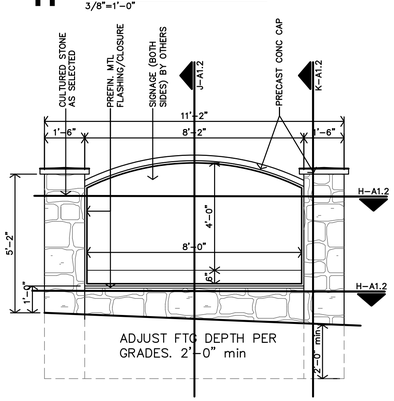

G MONUMENT SIGN ELEVATION
3/8"=1'-0"

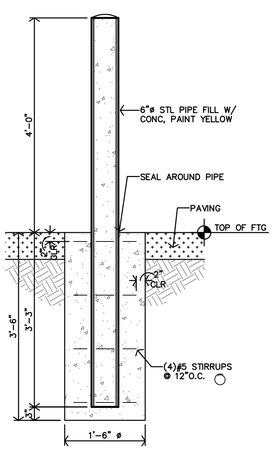

F BOLLARD DETAIL
3/4"=1'-0"

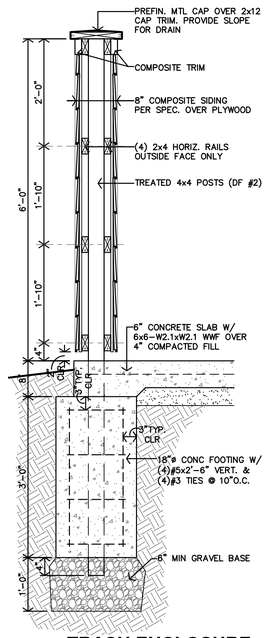

E TRASH ENCLOSURE SECTION
3/4"=1'-0"

DO NOT CONSTRUCT ANY PART OF THE TRASH PAD, ENCLOSURE AND/OR ACCESS TO, UNTILL AFTER CONFIRMATION AND COORDINATION OF LOCAL TRASH SERVICE. DUE TO DIFFERENT TRASH COMPANIES, TRUCKS AND PICK-UP PROCESSES, CONFIRMATION OF THE TRASH SERVICE AND COORDINATION OF THE DESIGN AND LAYOUT OF THE PAD, ENCLOSURE AND ACCESS MUST BE COMPLETED.

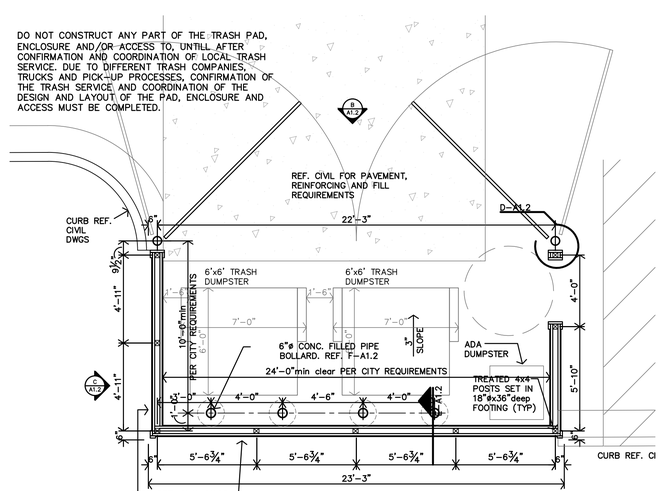

A DOUBLE CONTAINER TRASH ENCLOSURE PLAN
1/4"=1'-0"

JonesGillamRenz
730 N. Ninth 1881 Main Street, Suite 3
Salina, KS 67401 Kansas City, MO 6410
785.827.0386 jgr@jgrarchitects.com

THE RESIDENCE AT RED CEDAR
NEW SENIOR-LIVING FACILITY
CORSICANA, TEXAS

REVISION:

DATE: 12-10-2024
JOB: 24-3392
SHEET NO.:

A1.2

COPYRIGHTED ©

B TYPICAL IMAGE OF 4'-0" tall ALUM. FENCE - DOG PARK

NO SCALE

COMPLETE DOG WASTE STATION, SINGLE PULL BY DOG-ON-IT PARKS. MODEL #74085
COLOR: BLACK

D DOG WASTE STATION

NO SCALE

C BENCH DETAILS

NO SCALE

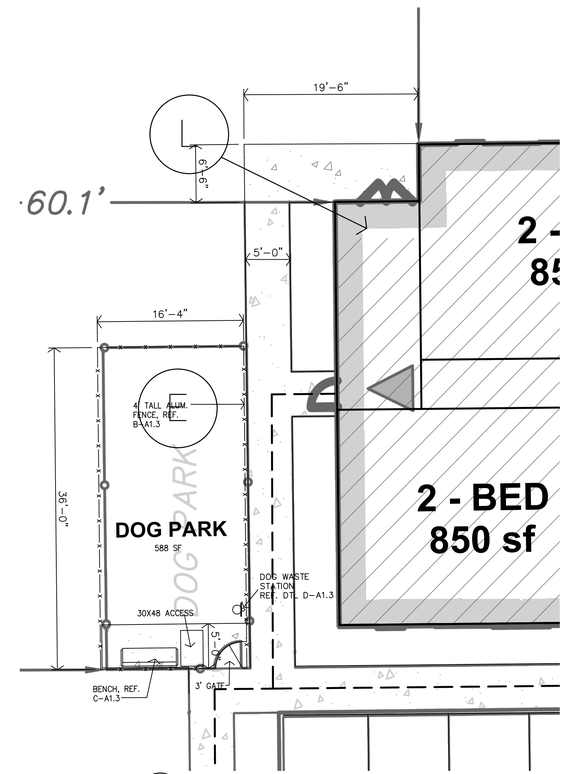

A DOG PARK

1/8"=1'-0"

JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386
1881 Main Street, Suite 3
Kansas City, MO 64108
jgr@jgrarchitects.com

THE RESIDENCE AT RED CEDAR

NEW SENIOR-LIVING FACILITY

CORSICANA, TEXAS

REVISION:

DATE: 12-10-2024
JOB: 24-3392
SHEET NO.:

A1.3

COPYRIGHTED ©

EXTERIOR PARTITION SCHEDULE

- REF. SHEET CFP FOR ADDITIONAL CODE INFORMATION

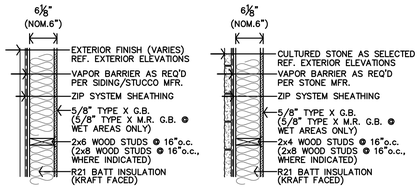

1 TYPE 1

INTERIOR PARTITION SCHEDULE

- ALL WALLS TO BE EXTEND TO STRUCTURE, UNLESS NOTED OR DETAILED OTHERWISE
- LOAD BEARING WALLS & FIRE PARTITIONS SHALL EXTEND TO DECK, SEALED SMOKE TIGHT.
- REF. SHEET CFP FOR ADDITIONAL CODE INFORMATION

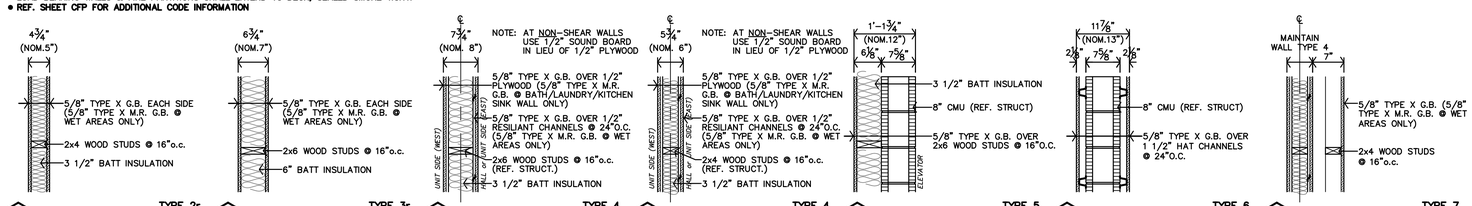

2r	TYPE 2r	STC 34	1-HOUR RATED (UL U305) ATTACH PER ul REQUIREMENTS
2	TYPE 2	NON-RATED	
3r	TYPE 3r	STC 35	1-HOUR RATED (UL U305) ATTACH PER ul REQUIREMENTS
3	TYPE 3	NON-RATED	
4.1	TYPE 4	STC 52	1-HOUR RATED (UL U311) ATTACH PER ul REQUIREMENTS NOTE: HALL TO BE 30MIN RATED
4.2	TYPE 4	STC 52	1-HOUR RATED (UL U311) ATTACH PER ul REQUIREMENTS NOTE: HALL TO BE 30MIN RATED
5	TYPE 5	STC 60	1-HOUR RATED (UL U905) (UL RATING 1HR)
6	TYPE 6	STC 60	2-HOUR RATED FIRE WALL (UL U910) (UL RATING 2HR)
7	TYPE 7	STC 52	

ASSEMBLIES



FLOOR/CEILING A

1-HOUR RATED (UL L528)
ATTACH PER ul REQUIREMENTS

NOTES:
1. DRAFTSTOPPING AT CONCEALED SPACES NOT REQUIRED PER 2018 IBC SEC. 708.4.2, EXCEPTION #2.
2. FIRE BLOCKING REQUIRED PER 2018 IBC SEC. 718.2. (1) LAYER – 5/8" TYPE X G.B. OR 1/2" PLYWOOD TO EXTEND THRU



FLOOR/CEILING B

1-HOUR RATED (UL L501)
ATTACH PER ul REQUIREMENTS

NOTES:
1. DRAFTSTOPPING AT CONCEALED SPACES NOT REQUIRED PER 2018 IBC SEC. 708.4.2, EXCEPTION #2.
2. FIRE BLOCKING REQUIRED PER 2018 IBC SEC. 718.2 (1) LAYER – 5/8" TYPE X G.B. OR 1/2" PLYWOOD TO EXTEND THRU



ROOF/CEILING

1-HOUR RATED (UL P522)
ATTACH PER ul REQUIREMENTS

LEGEND

A	RADON PIPE THROUGH ROOF. REF. T-A4.4 & MECH. DWGS.
B	KNOX BOX. REFERECE A1.1 FOR LOCATION. COORDINATE WITH LOCAL FIRE MARSHAL OFFICE.
C	ROOF HATCH & WALL MOUNTED LADDER
	SYMBOL INDICATES ACCESSIBLE UNIT (2 TOTAL) APARTMENTS 11(111) & 30(303)
	SYMBOL INDICATES HEARING IMPAIRED UNITS (1 TOTAL) APARTMENT 20(203)
	ALL OTHER UNITS TO BE ADAPTABLE (TYPE-B)

UNIT NUMBERS SHOWN ARE FOR CONSTRUCTION PURPOSES ONLY AND DO NOT REFLECT FINAL UNIT NUMBERING/LETTERING.

ARCHITECTURAL GENERAL NOTES

1. CONTRACTOR SHALL FIELD VERIFY ALL DIMENSIONS & CONDITIONS.
2. INSTALL MATERIALS AND/OR FINISHES AS INDICATED, IMPLIED OR AS REQUIRED FOR COMPLETE & FINISHED INSTALLATION.
3. ALL WORK SHALL BE IN CONFORMANCE W/ APPLICABLE BUILDING CODES & ORDINANCES.
4. ALL NEW CONSTRUCTION SHALL BE IN CONFORMANCE TO ADA REQUIREMENTS. REFERENCE ADA FOR TYPICAL MINIMUM CLEARANCE REQ.
5. IF THERE IS A DISCREPANCY BETWEEN DRAWINGS AND FIELD CONDITIONS NOTIFY ARCHITECT PRIOR TO PROCEEDING WITH WORK SO THAT ANY ISSUES MAY BE CLARIFIED.
6. DOORS ARE TYPICALLY LOCATED WITH HINGE-SIDE JAMB 4" FROM ADJACENT WALL UNLESS NOTED OTHERWISE OR REQUIRED TO MEET LATCH-SIDE CLEARANCE PER ADA.
7. FEC – INDICATES LOCATION OF RECESSED FIRE EXTINGUISHER CABINET. REF SPECS. AND DETAILS B/C-A2.1
8. MHO – INDICATES DOOR WITH MAGNETIC HOLD OPEN.
9. F.O.S. – DIMENSIONS TO THE EXTERIOR WALLS ARE TO THE FACE OF STUD U.N.O.
10. FURNITURE SHOWN IS BY OWNER.
11. REFERENCE SHEET A2.1 FOR PARTITION SCHEDULES AND ASSEMBLIES



C **TYPICAL FEC MOUNTING HGT**
3/4"=1'-0"



B **FIRE EXTINGUISHER CABINET DTL @ 1HR WALL**
1 1/2"=1'-0"

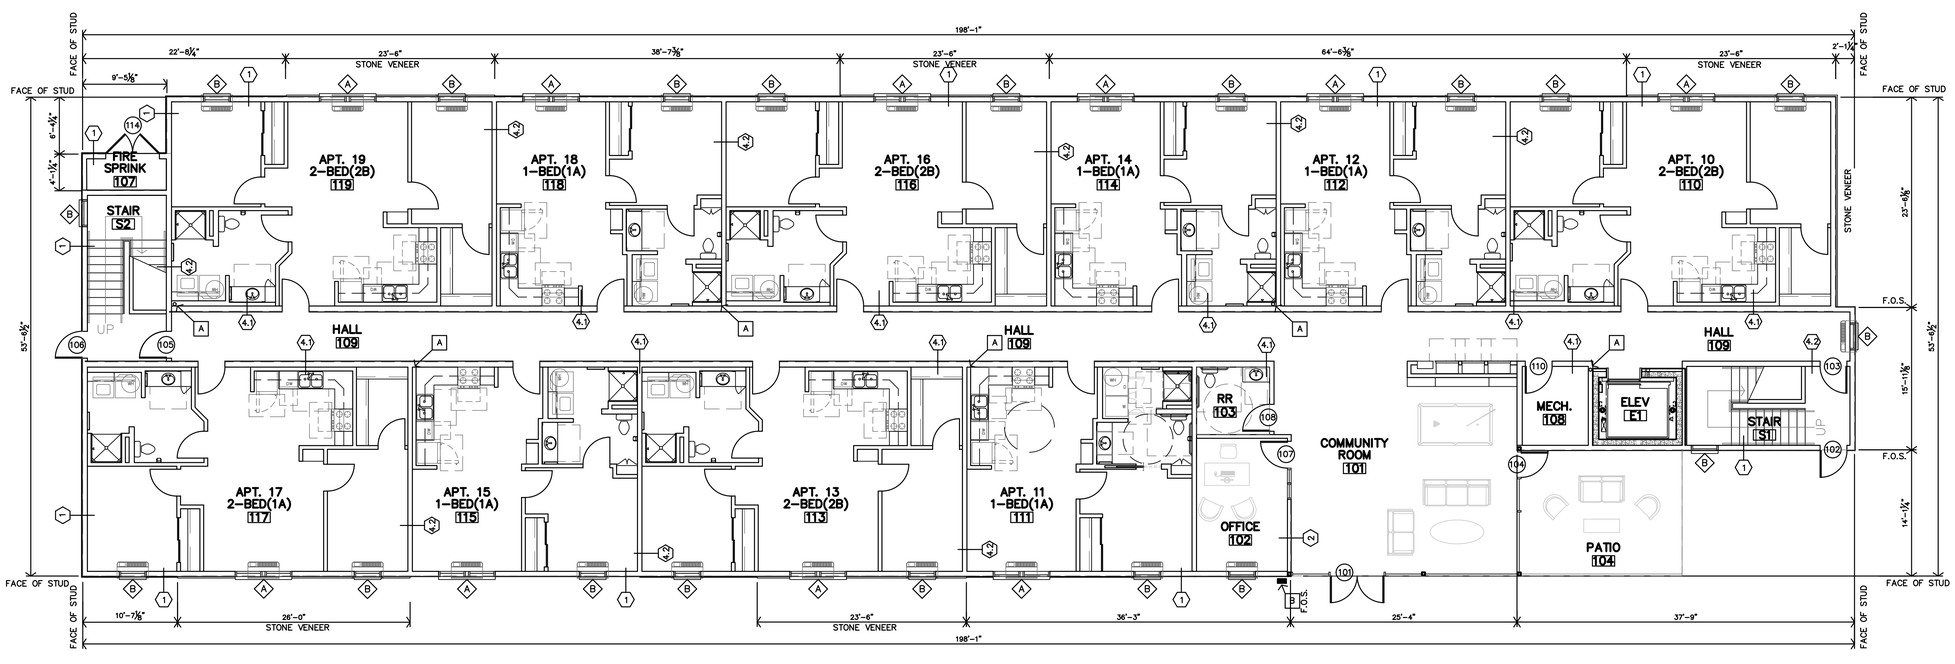

A **FIRST FLOOR PLAN**
1/8"=1'-0"

JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386
1881 Main Street, Suite 3
Kansas City, MO 64108
jgr@jgrarchitects.com

THE RESIDENCE AT RED CEDAR

NEW SENIOR-LIVING FACILITY

CORSICANA, TEXAS

REVISION:

DATE: 12-10-2024
JOB: 24-3392
SHEET NO.:

A2.1

COPYRIGHTED ©

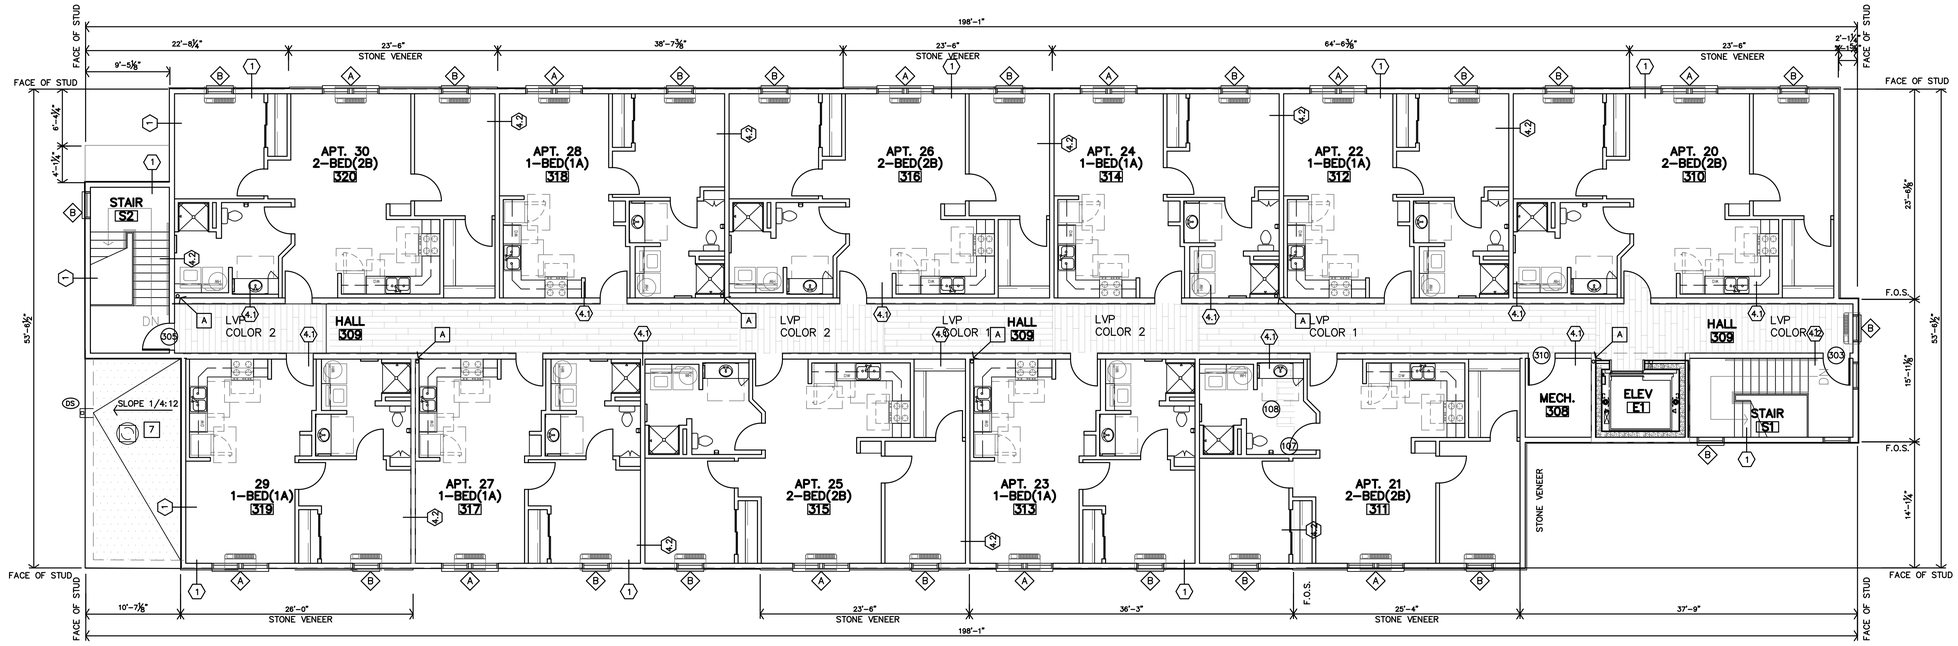

B **THIRD FLOOR PLAN**
1/8"=1'-0"

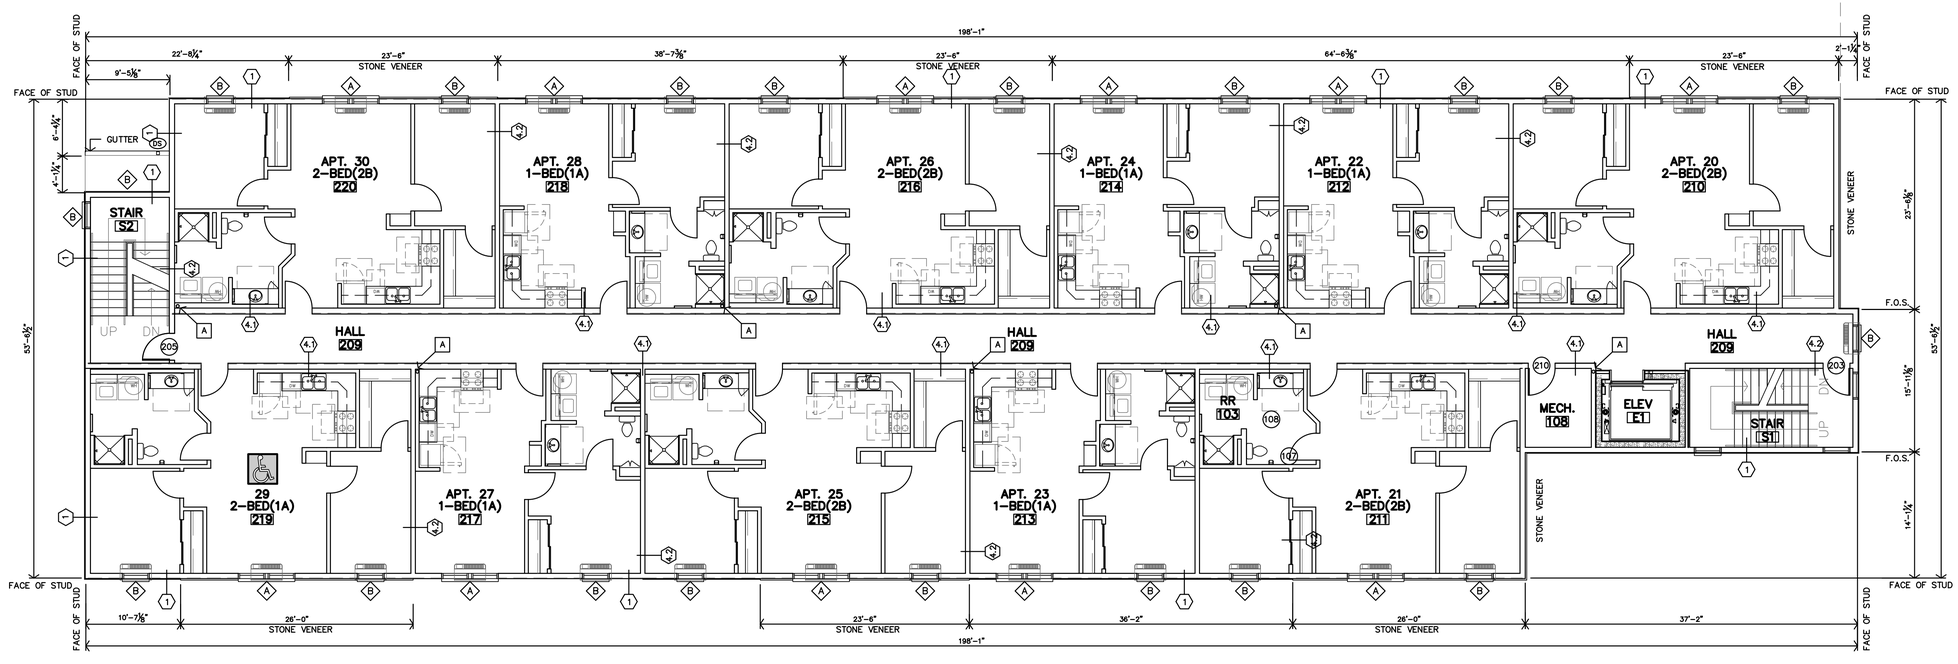

A **SECOND FLOOR PLAN**
1/8"=1'-0"

JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386
1881 Main Street, Suite 3
Kansas City, MO 64108
jgr@jgrarchitects.com

THE RESIDENCE AT RED CEDAR

NEW SENIOR-LIVING FACILITY

CORSICANA, TEXAS

REVISION:

DATE: 12-10-2024
JOB: 24-3392
SHEET NO.:

A2.2

COPYRIGHTED ©

APARTMENT GENERAL NOTES

1. REF STRUCTURAL DRAWINGS FOR SHEAR WALL LOCATIONS.
2. TYPICAL GROUND FLOOR FINISH FLOOR ELEVATION IS REFERENCED AS 100'–0". CONTRACTOR SHALL VERIFY BUILDING ELEVATION WITH SITE CIVIL DRAWINGS.
3. REFERENCE SITE PLAN SHEET A1.1 FOR LOCATION & ORIENTATION OF BUILDING.
4. CONTRACTOR SHALL PROVIDE PLASTIC COATED WIRE SHELVES & ROD AT ALL CLOSETS U.N.O.
5. CONTRACTOR SHALL PROVIDE BLOCKING, ANCHOR BOLTS AND ANY REQUIRED SHEAR WALL BLOCKING AS REQUIRED BY STRUCTURAL DRAWINGS.
6. CONTRACTOR TO PROVIDE FIRE BLOCKING AT PARTY WALL AT 10'–0" O.C. VERT. & HORIZ. TYP., AND AT ALL BACK TO BACK ELECTRICAL OUTLETS. PROVIDED AND INSTALL ALL FIRE BLOCKING AND DRAFTSTOPS PER 2018 IBC, SECTION 708 & 718.
7. FIRE EXTINGUISHERS SHALL BE INSTALLED & PROVIDED IN ACCORDANCE WITH NFPA 10 & 2018 IBC, SECTION 906.1, LOCATED PER FLOOR PLAN.
8. ALL PENETRATIONS THRU RATED WALLS AND/OR FLOOR ASSEMBLIES SHALL BE FIRESTOPPED PER APPROVED U.L. DESIGNS. REFERENCE SHEET A4.5 FOR FIRE PENTRATION ASSEMBLIES
9. HOSE BIBS TO BE LOCATED 6"min. ABOVE WAINSCOT (30"MIN ABV. FIN. FLOOR).
10. KITCHEN RECEPTACLES TO BE @ 44"max ABOVE FIN FLR.
11. SUBMIT VERIFICATION THAT ALL CONSTRUCTION MATERIAL WILL MEET US EPA CRITERIA PARTICULARLY MATERIALS THAT WILL BE OBTAINED FROM INTERNATIONAL SOURCES. ALSO PROVIDE VERIFICATION THAT THE CONSTRUCTION WILL NOT RESULT IN OR CONTAIN HAZARDOUS MATERIALS.
12. ALL INTERIOR WALL DIMENSIONS ARE TO FACE OF GYP. BD. UNLESS NOTED OTHERWISE.
13. HEARING/VISION IMPAIRED UNIT (WHERE INDICATED ON BUILDING PLANS):
    - CONTRACTOR SHALL PROVIDE & INSTALL EQUIPMENT REQUIRED PER 2010 ADA SEC. 809.5.
    - REF. ELECT. DWGS
14. REF SHEET A2.1 AND THIS SHEET FOR PARTITION SCHEDULE.
15. DOORS ARE TYPICALLY LOCATED 4" FROM CORNER U.N.O.
16. F.O.S. = FACE OF STUD

ADAPTABLE (TYPE-B) UNIT NOTES

18. ADAPTABLE (TYPE–B) UNITS (WHERE INDICATED ON BUILDING PLANS):
    - REFERENCE ENLARGED PLANS AND DETAILS FOR ADDITIONAL INFORMATION
    - *ALL UNITS:*
      - CONTRACTOR TO INSTALL 2x8 BLOCKING IN WALLS FOR FUTURE GRAB BARS @ ALL TOILETS & TUBS AND COUNTERTOPS AT BATH #03
      - TOILETS SHALL BE ADA COMPLIANT (17"–19" HIGH).
      - CONTRACTOR TO INSTALL BLOCKING PER ICC/ANSI A117.1–2017.
      - ALL CLOSETS TO HAVE PLASTIC WIRE CLOTHES SHELF & ROD WITH ADJUSTABLE BRACKETS (UNLESS OTHERWISE NOTED). MOUNT TOP OF SHELF AT 68" AFF.
      - ALL SWITCHES, OUTLETS, THERMOSTATS, AND OTHER ENVIRONMENTAL CONTROLS MUST BE MOUNTED A MAX. OF 48" A.F.F. (NOT LESS THAN 15" A.F.F.)

ACCESSIBLE UNITS NOTES

19. ACCESSIBLE UNITS (WHERE INDICATED ON SHEET ON BUILDING PLANS):
    - REFERENCE ENLARGED PLANS AND DETAILS FOR ADDITIONAL INFORMATION
    - *ALL UNITS:*
      - CONTRACTOR TO INSTALL 2x8 BLOCKING IN WALLS FOR GRAB BARS @ ALL TOILETS, SHOWERS AND BLOCKING @ SINKS & COUNTERTOPS AT BATH #03
      - OPEN KNEE SPACE SHALL BE PROVIDED @ SINKS & WORK SPACE IN KITCHEN #01
      - CONTRACTOR SHALL INSTALL HOT WATER & DRAIN PIPES COVERS.
      - TOILETS SHALL BE ADA COMPLIANT (17"–19" HIGH).
      - CONTRACTOR TO INSTALL BLOCKING AND PROVIDE & INSTALL GRAB BARS PER ICC/ANSI A117.1–2017.
      - ALL CLOSETS TO HAVE PLASTIC WIRE CLOTHES SHELF & ROD WITH ADJUSTABLE BRACKETS (UNLESS NOTED OTHERWISE). MOUNT TOP OF SHELF AT 48" AFF MAX.
      - KITCHEN COUNTERTOPS SHALL BE MAX. 34" A.F.F. BATHROOM SINK RIM SHALL BE MAX. 34" A.F.F.
      - ALL SWITCHES, OUTLETS, THERMOSTATS, AND OTHER ENVIRONMENTAL CONTROLS MUST BE MOUNTED A MAX. OF 48" A.F.F. (NOT LESS THAN 15" A.F.F.)
      - HEIGHT OF OPERABLE WINDOW PARTS (LATCHES/LOCKS, ETC.) SHALL BE LOCATED MAX 48" A.F.F.

UNIT FINISH SCHEDULE - 30 UNITS

FINISHES & INSTRUCTIONS

P LATEX ENAMEL — VP VINYL LVP TILE — CT CERAMIC TILE
C CARPET — ST STAIN & SEAL — TX TEXTURE

NO.	DESCRIPTION	FLOOR		BASE		N.WALL		E.WALL		S.WALL		W.WALL		CEILING		REMARKS
		CARPET	VINYL LVP TILE	WOOD		5/8" FIRE RATED G.B.		5/8" FIRE RATED G.B.		5/8" FIRE RATED G.B.		5/8" FIRE RATED G.B.		5/8" FIRE RATED G.B.		
01	KITCHEN		VP		P		P		P		P		P		P	
02	LIVING ROOM		VP		P		P		P		P		P		P	
03	BATH		VP		P		P		P		P		P		P	
04	CLOSET		VP		P		P		P		P		P		P	
05	BEDROOM		VP		P		P		P		P		P		P	
06	BEDROOM		VP		P		P		P		P		P		P	
07	CLOSET		VP		P		P		P		P		P		P	

GENERAL NOTES:

A. INSTALL VINYL, RUBBER, OR ALUMINUM TRANSITION STRIP BETWEEN FLOOR MATERIAL OF DIFFERING HEIGHTS, INCLUDING BUT NOT LIMITED TO CONCRETE/VCT TRANSITIONS.
B. ALL GYPSUM BOARD AREAS WHICH ARE ACCESSORIES TO THE ROOM INCLUDING BUT NOT LIMITED TO SOFFITS, BULKHEADS, TRIM, ETC. SHALL BE PAINTED REGARDLESS OF WHETHER IT IS SPECIFICALLY INDICATED PER SCHEDULE.
C. WALL TYPE SHOWN FOR GENERAL INFORMATION ONLY. CONTRACTOR SHALL COORDINATE WALL MATERIAL W/ DRAWINGS AND FIELD CONDITIONS. ALL AREAS INDICATED TO RECEIVE NEW FINISH SHALL RECEIVE COMPLETE FINISH AS SCHEDULED AT ENTIRE ROOM.
D. CONTRACTOR SHALL COORDINATE FINISHES AND ACCENTS WITH DETAILS AND INTERIOR ELEVATIONS.
E. FLOORING CONTRACTOR SHALL VERIFY THAT SUBFLOOR IS LEVEL AND PROPERLY PREPPED PRIOR TO INSTALLATION OF ANY FLOORING MATERIALS.
F. CONTRACTOR SHALL VERIFY THAT FLOORS ARE PREPPED/"FLOORSTONED" FOR LEVEL TRANSITION BETWEEN DIFFERING MATERIALS.
G. ALL H.M. DOORS & FRAMES TO BE PAINTED W/ INDUSTRIAL ENAMEL UNLESS NOTED OTHERWISE. H.M. DOORS AND FRAMES SHALL BE SANDED SMOOTH PRIOR TO PAINTING. SPRAY FINISH ONLY. NO BRUSH FINISH.
H. CONTRACTOR SHALL COORDINATE WITH INTERIOR ELEVATIONS, FLOOR PLANS AND MISCELLANEOUS DETAILS TO VERIFY ALL AESTHETIC ACCENTS AND DETAILS.
I. REFERENCE INTERIOR ELEVATIONS, WALL SECTIONS AND DETAILS FOR WOOD BASE AND TRIM LOCATIONS.
J. LEVEL 4 FINISH WITH ORANGE PEEL TEXTURE ON ALL WALLS AND CEILINGS.

INTERIOR PARTITION SCHEDULE

- ALL WALLS TO BE EXTEND TO STRUCTURE, UNLESS NOTED OR DETAILED OTHERWISE
- LOAD BEARING WALLS & FIRE PARTITIONS SHALL EXTEND TO DECK, SEALED SMOKE TIGHT.
- REF. SHEET CFP FOR ADDITIONAL CODE INFORMATION

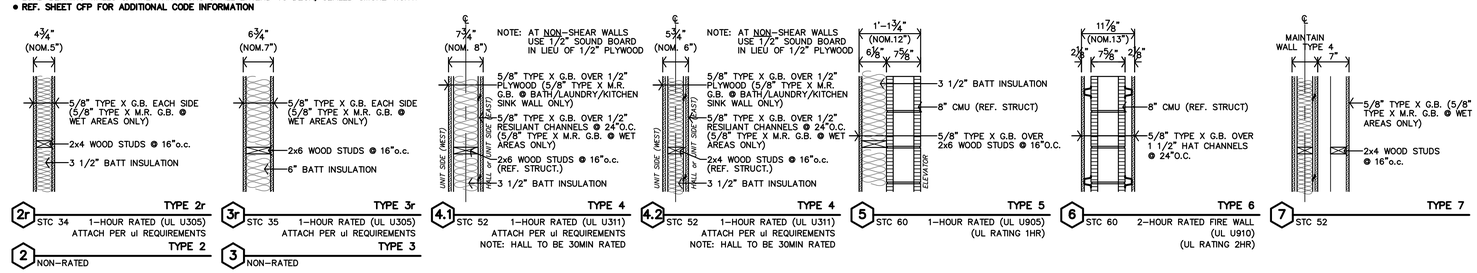

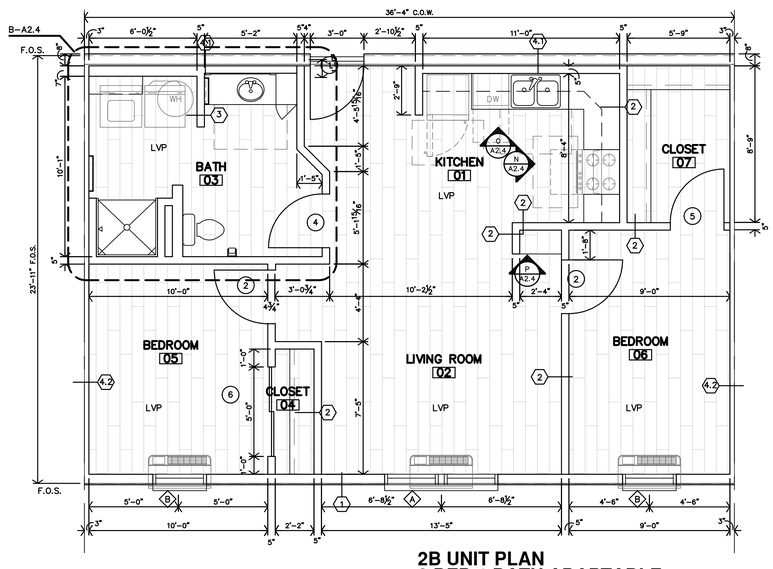

D 2B UNIT PLAN
2 BED 1 BATH ADAPTABLE
1/4" = 1'–0" TDHCA: 850 sf NRA

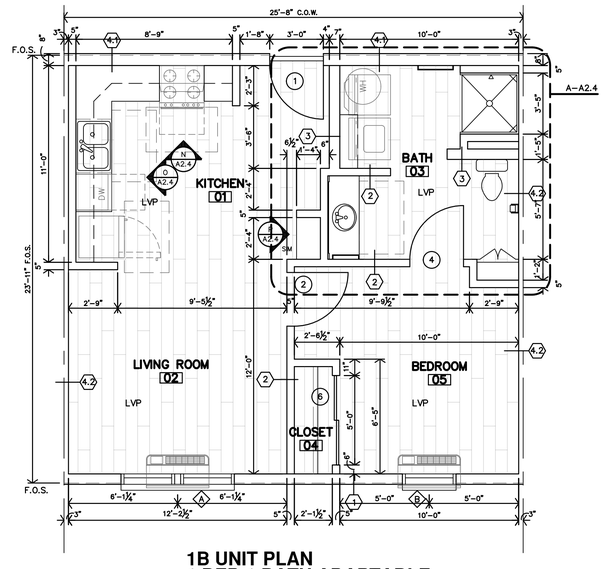

B 1B UNIT PLAN
1 BED 1 BATH ADAPTABLE
1/4" = 1'–0" TDHCA: 600 sf NRA

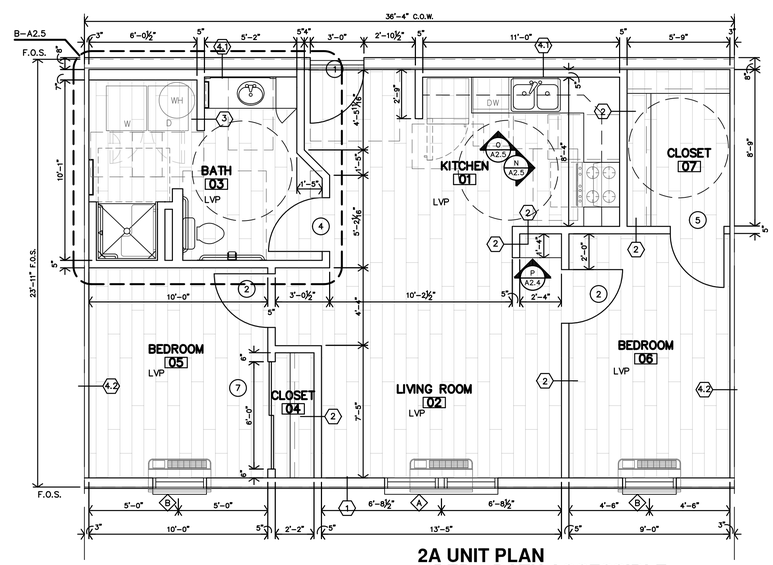

C 2A UNIT PLAN
2 BED 1 BATH ACCESSIBLE
1/4" = 1'–0" TDHCA: 850 sf NRA

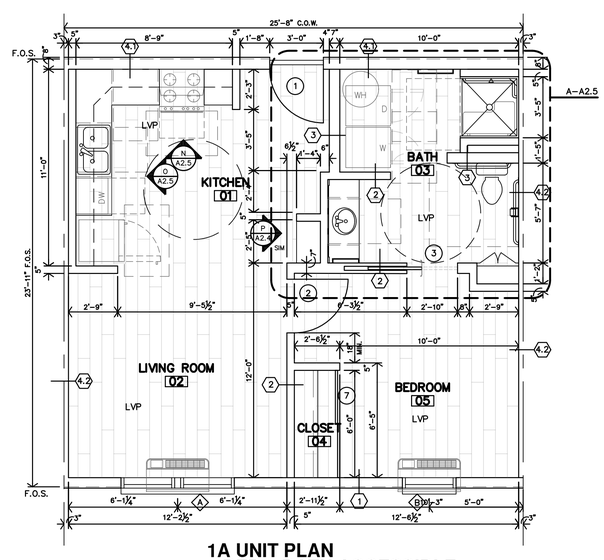

A 1A UNIT PLAN
1 BED 1 BATH ACCESSIBLE
1/4" = 1'–0" TDHCA: 600 sf NRA

JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386
1881 Main Street, Suite 3
Kansas City, MO 6410
jgr@jgrarchitects.com

THE RESIDENCE AT RED CEDAR
NEW SENIOR-LIVING FACILITY
CORSICANA, TEXAS

REVISION:

DATE: 12–10–2024
JOB: 24–3392
SHEET NO.:
A2.3

COPYRIGHTED ©

EXTERIOR PARTITION SCHEDULE

- REF. SHEET CFP FOR ADDITIONAL CODE INFORMATION

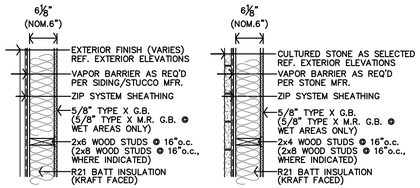

1 TYPE 1

INTERIOR PARTITION SCHEDULE

- ALL WALLS TO BE EXTEND TO STRUCTURE, UNLESS NOTED OR DETAILED OTHERWISE
- LOAD BEARING WALLS & FIRE PARTITIONS SHALL EXTEND TO DECK, SEALED SMOKE TIGHT.
- REF. SHEET CFP FOR ADDITIONAL CODE INFORMATION

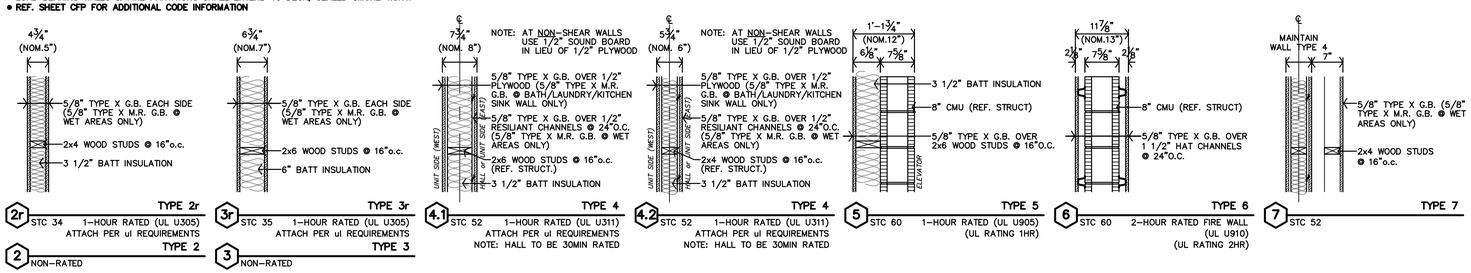

2r	TYPE 2r	STC 34	1-HOUR RATED (UL U305) ATTACH PER ul REQUIREMENTS
2	TYPE 2	NON-RATED	
3r	TYPE 3r	STC 35	1-HOUR RATED (UL U305) ATTACH PER ul REQUIREMENTS
3	TYPE 3	NON-RATED	
4.1	TYPE 4	STC 52	1-HOUR RATED (UL U311) ATTACH PER ul REQUIREMENTS NOTE: HALL TO BE 30MIN RATED
4.2	TYPE 4	STC 52	1-HOUR RATED (UL U311) ATTACH PER ul REQUIREMENTS NOTE: HALL TO BE 30MIN RATED
5	TYPE 5	STC 60	1-HOUR RATED (UL U905) (UL RATING 1HR)
6	TYPE 6	STC 60	2-HOUR RATED FIRE WALL (UL U910) (UL RATING 2HR)
7	TYPE 7	STC 52	

ASSEMBLIES

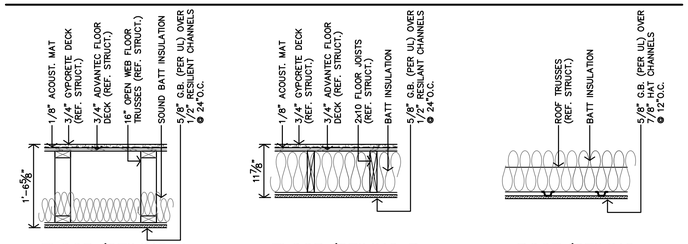

FLOOR/CEILING A

1-HOUR RATED (UL L528)
ATTACH PER ul REQUIREMENTS

NOTES:
1. DRAFTSTOPPING AT CONCEALED SPACES NOT REQUIRED PER 2018 IBC SEC. 708.4.2, EXCEPTION #2.
2. FIRE BLOCKING REQUIRED PER 2018 IBC SEC. 718.2. (1) LAYER – 5/8" TYPE X G.B. OR 1/2" PLYWOOD TO EXTEND THRU

FLOOR/CEILING B

1-HOUR RATED (UL L501)
ATTACH PER ul REQUIREMENTS

NOTES:
1. DRAFTSTOPPING AT CONCEALED SPACES NOT REQUIRED PER 2018 IBC SEC. 708.4.2, EXCEPTION #2.
2. FIRE BLOCKING REQUIRED PER 2018 IBC SEC. 718.2 (1) LAYER – 5/8" TYPE X G.B. OR 1/2" PLYWOOD TO EXTEND THRU

ROOF/CEILING

1-HOUR RATED (UL P522)
ATTACH PER ul REQUIREMENTS

LEGEND

A	RADON PIPE THROUGH ROOF. REF. T-A4.4 & MECH. DWGS.
B	KNOX BOX. REFERECE A1.1 FOR LOCATION. COORDINATE WITH LOCAL FIRE MARSHAL OFFICE.
C	ROOF HATCH & WALL MOUNTED LADDER
	SYMBOL INDICATES ACCESSIBLE UNIT (2 TOTAL) APARTMENTS 11(111) & 30(303)
	SYMBOL INDICATES HEARING IMPAIRED UNITS (1 TOTAL) APARTMENT 20(203)
	ALL OTHER UNITS TO BE ADAPTABLE (TYPE-B)

UNIT NUMBERS SHOWN ARE FOR CONSTRUCTION PURPOSES ONLY AND DO NOT REFLECT FINAL UNIT NUMBERING/LETTERING.

ARCHITECTURAL GENERAL NOTES

1. CONTRACTOR SHALL FIELD VERIFY ALL DIMENSIONS & CONDITIONS.
2. INSTALL MATERIALS AND/OR FINISHES AS INDICATED, IMPLIED OR AS REQUIRED FOR COMPLETE & FINISHED INSTALLATION.
3. ALL WORK SHALL BE IN CONFORMANCE W/ APPLICABLE BUILDING CODES & ORDINANCES.
4. ALL NEW CONSTRUCTION SHALL BE IN CONFORMANCE TO ADA REQUIREMENTS. REFERENCE ADA FOR TYPICAL MINIMUM CLEARANCE REQ.
5. IF THERE IS A DISCREPANCY BETWEEN DRAWINGS AND FIELD CONDITIONS NOTIFY ARCHITECT PRIOR TO PROCEEDING WITH WORK SO THAT ANY ISSUES MAY BE CLARIFIED.
6. DOORS ARE TYPICALLY LOCATED WITH HINGE-SIDE JAMB 4" FROM ADJACENT WALL UNLESS NOTED OTHERWISE OR REQUIRED TO MEET LATCH-SIDE CLEARANCE PER ADA.
7. FEC – INDICATES LOCATION OF RECESSED FIRE EXTINGUISHER CABINET. REF SPECS. AND DETAILS B/C-A2.1
8. MHO – INDICATES DOOR WITH MAGNETIC HOLD OPEN.
9. F.O.S. – DIMENSIONS TO THE EXTERIOR WALLS ARE TO THE FACE OF STUD U.N.O.
10. FURNITURE SHOWN IS BY OWNER.
11. REFERENCE SHEET A2.1 FOR PARTITION SCHEDULES AND ASSEMBLIES



C **TYPICAL FEC MOUNTING HGT**
3/4"=1'-0"



B **FIRE EXTINGUISHER CABINET DTL @ 1HR WALL**
1 1/2"=1'-0"

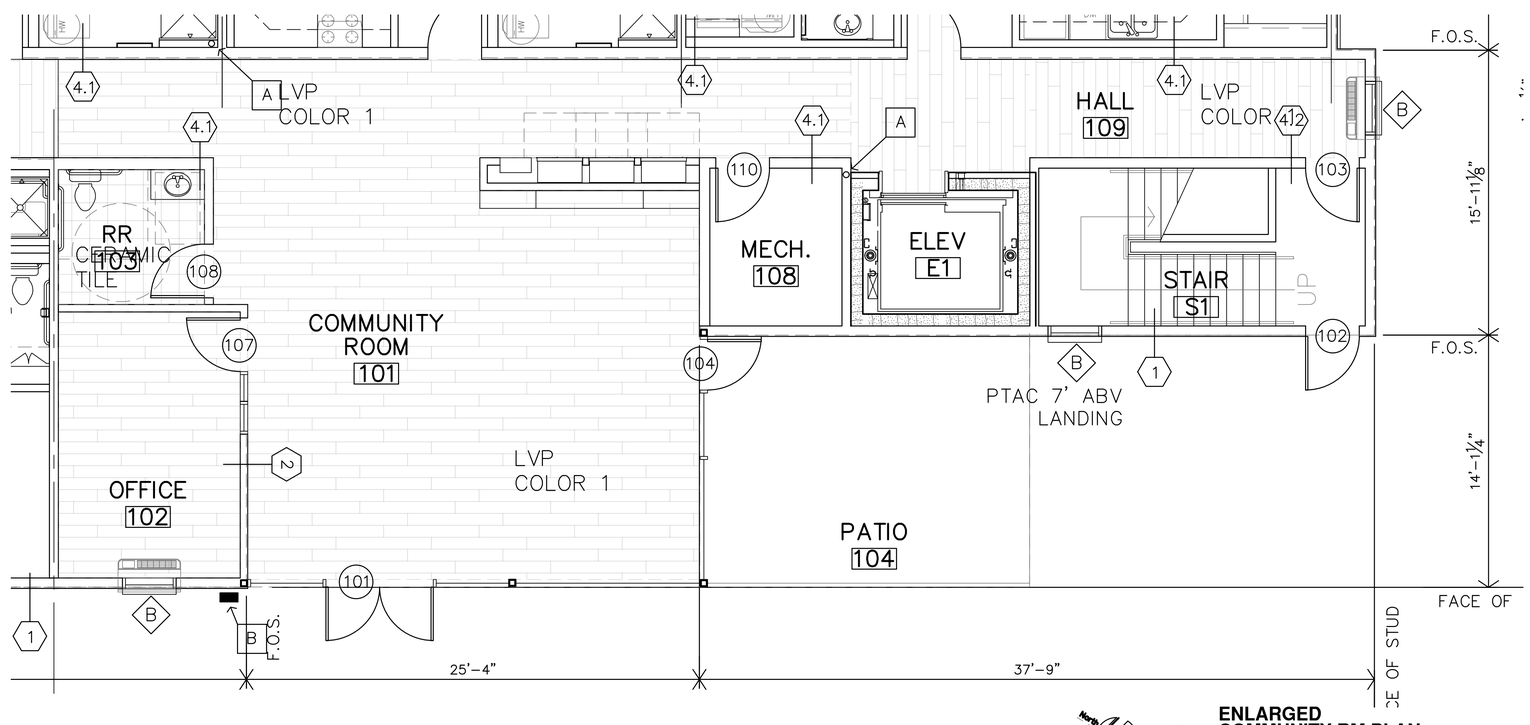

A **ENLARGED COMMUNITY RM PLAN**
1/4" = 1'-0"

JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386
1881 Main Street, Suite 3
Kansas City, MO 64108
jgr@jgrarchitects.com

THE RESIDENCE AT RED CEDAR

NEW SENIOR-LIVING FACILITY

CORSICANA, TEXAS

REVISION:

DATE: 12-10-2024
JOB: 24-3392
SHEET NO.:

A2.7

COPYRIGHTED ©

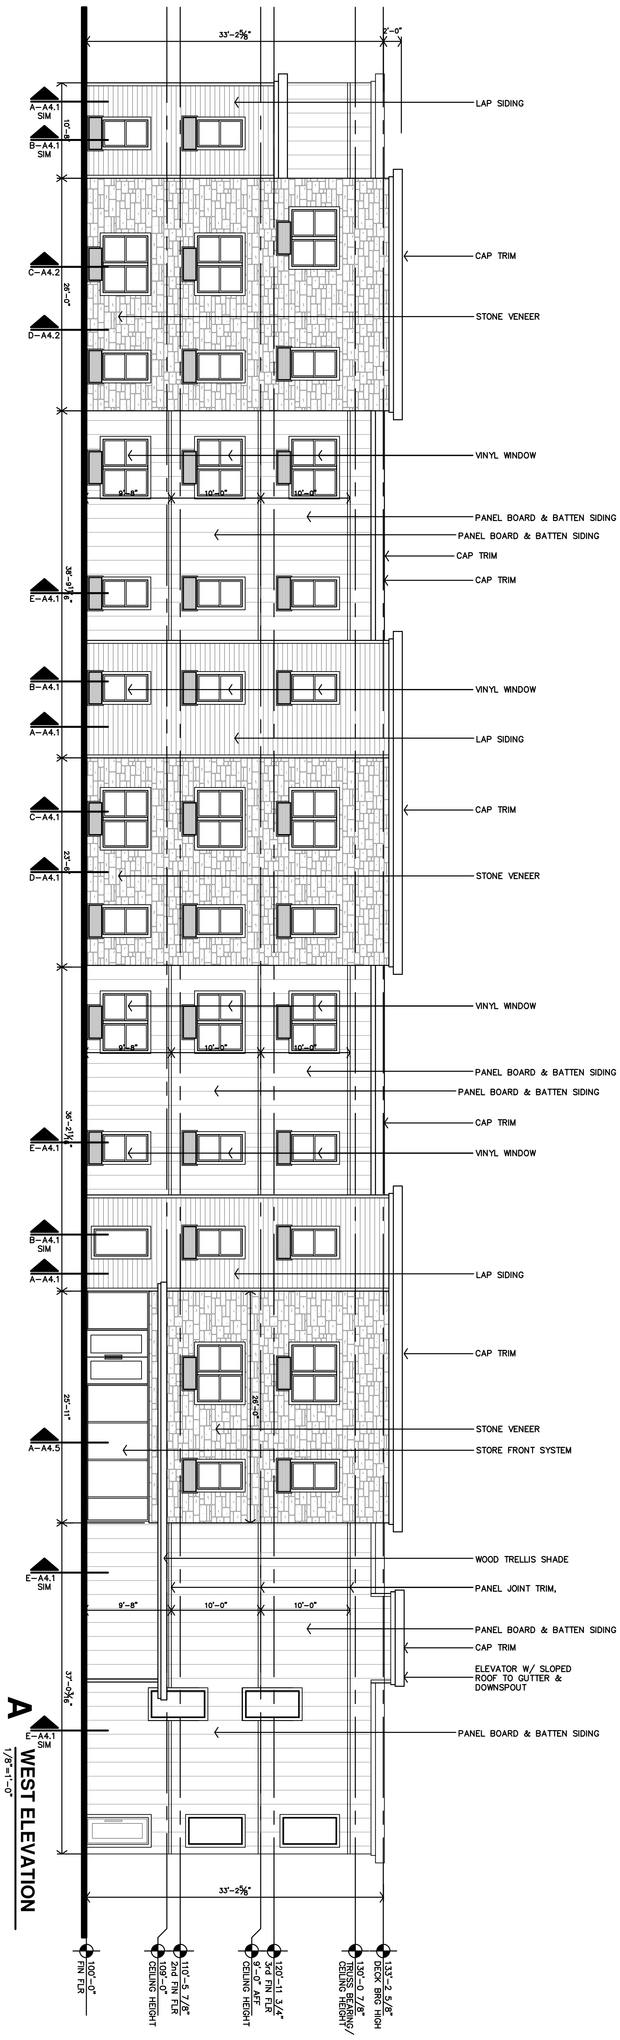

A
WEST ELEVATION
1/8"=1'-0"

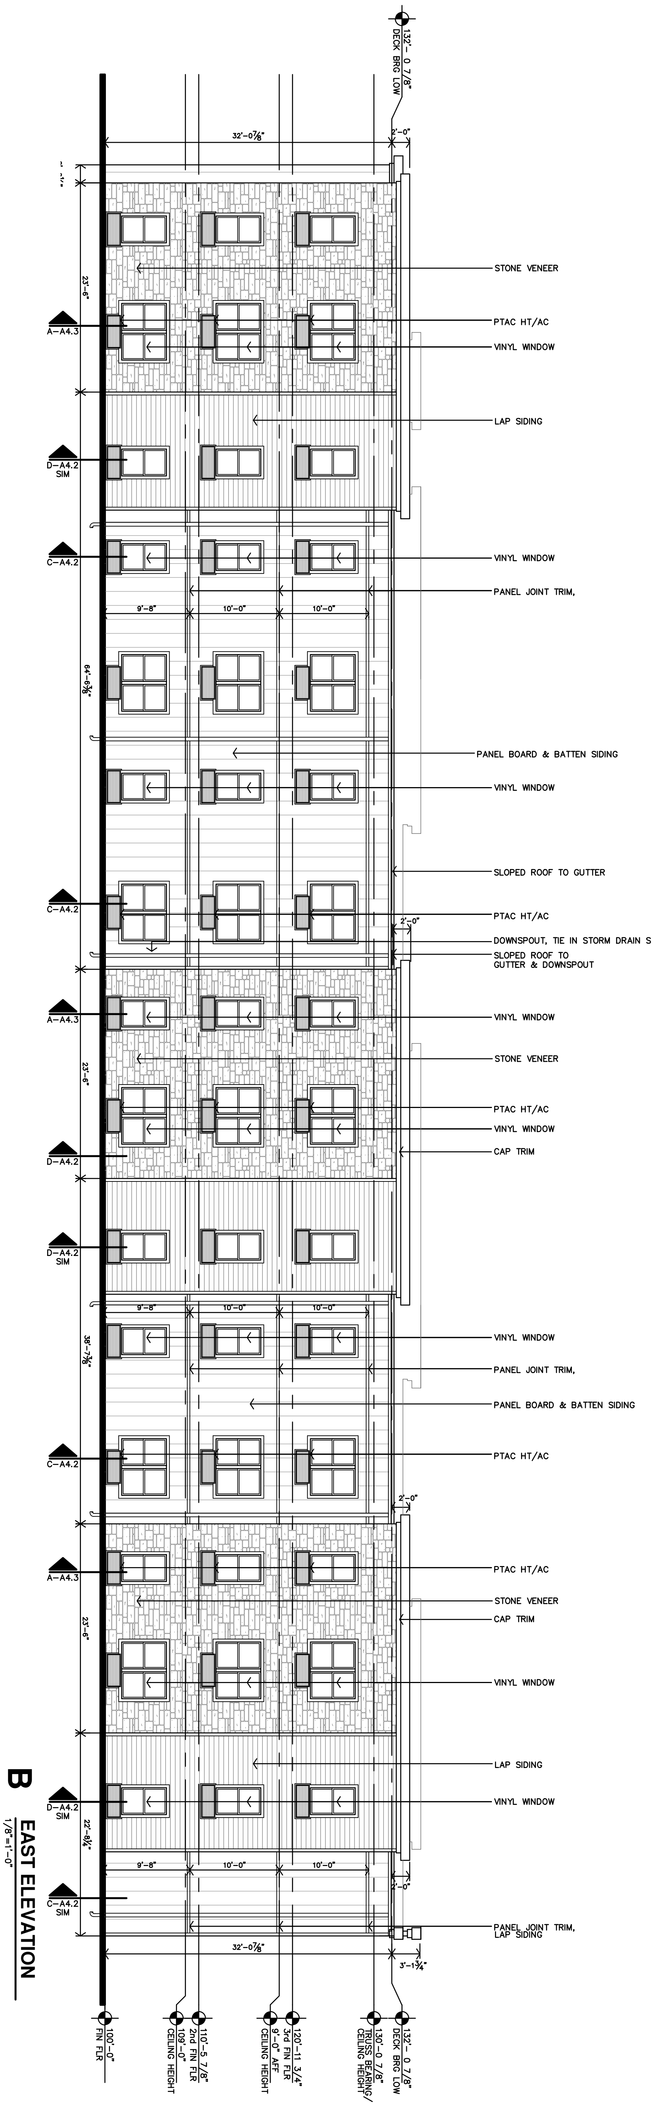

B
EAST ELEVATION
1/8"=1'-0"

A3.1

DATE: 12-10-2024
JOB:
SHEET NO.: 24-3392

REVISION:

THE RESIDENCE AT RED CEDAR

NEW SENIOR-LIVING FACILITY

CORSICANA, TEXAS

JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386
1881 Main Street, Suite
Kansas City, MO 641
jgr@jgrarchitects.com

COPYRIGHTED ©

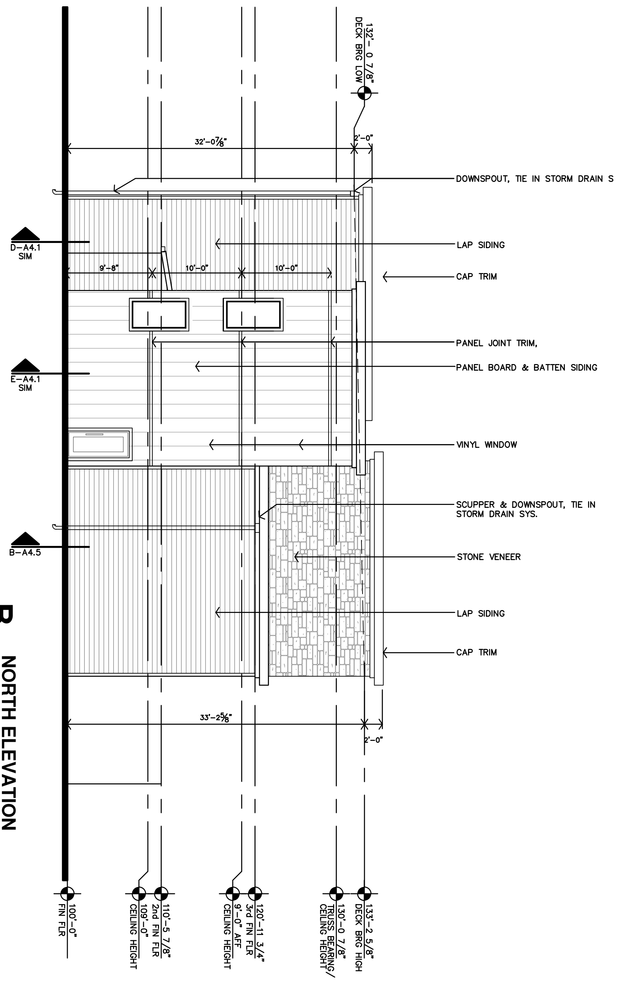

B NORTH ELEVATION
1/8"=1'-0"

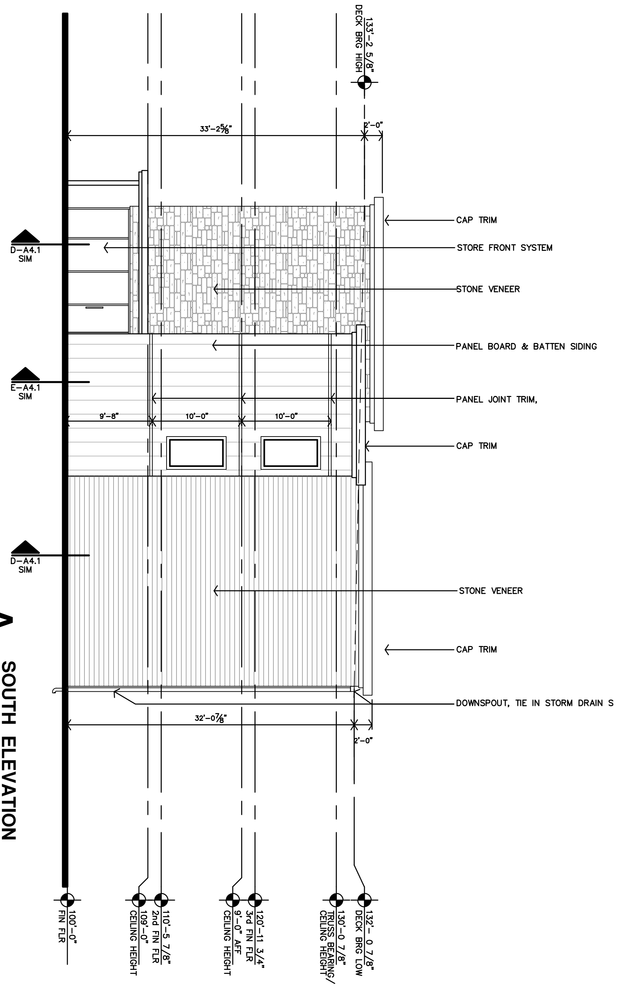

A SOUTH ELEVATION
1/8"=1'-0"

A3.2

DATE: 12-10-2024
JOB: 24-3392
SHEET NO.:

REVISION:

THE RESIDENCE AT RED CEDAR

NEW SENIOR-LIVING FACILITY

CORSICANA, TEXAS

JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386
1881 Main Street, Suite
Kansas City, MO 641
jgr@jgrarchitects.com

COPYRIGHTED ©

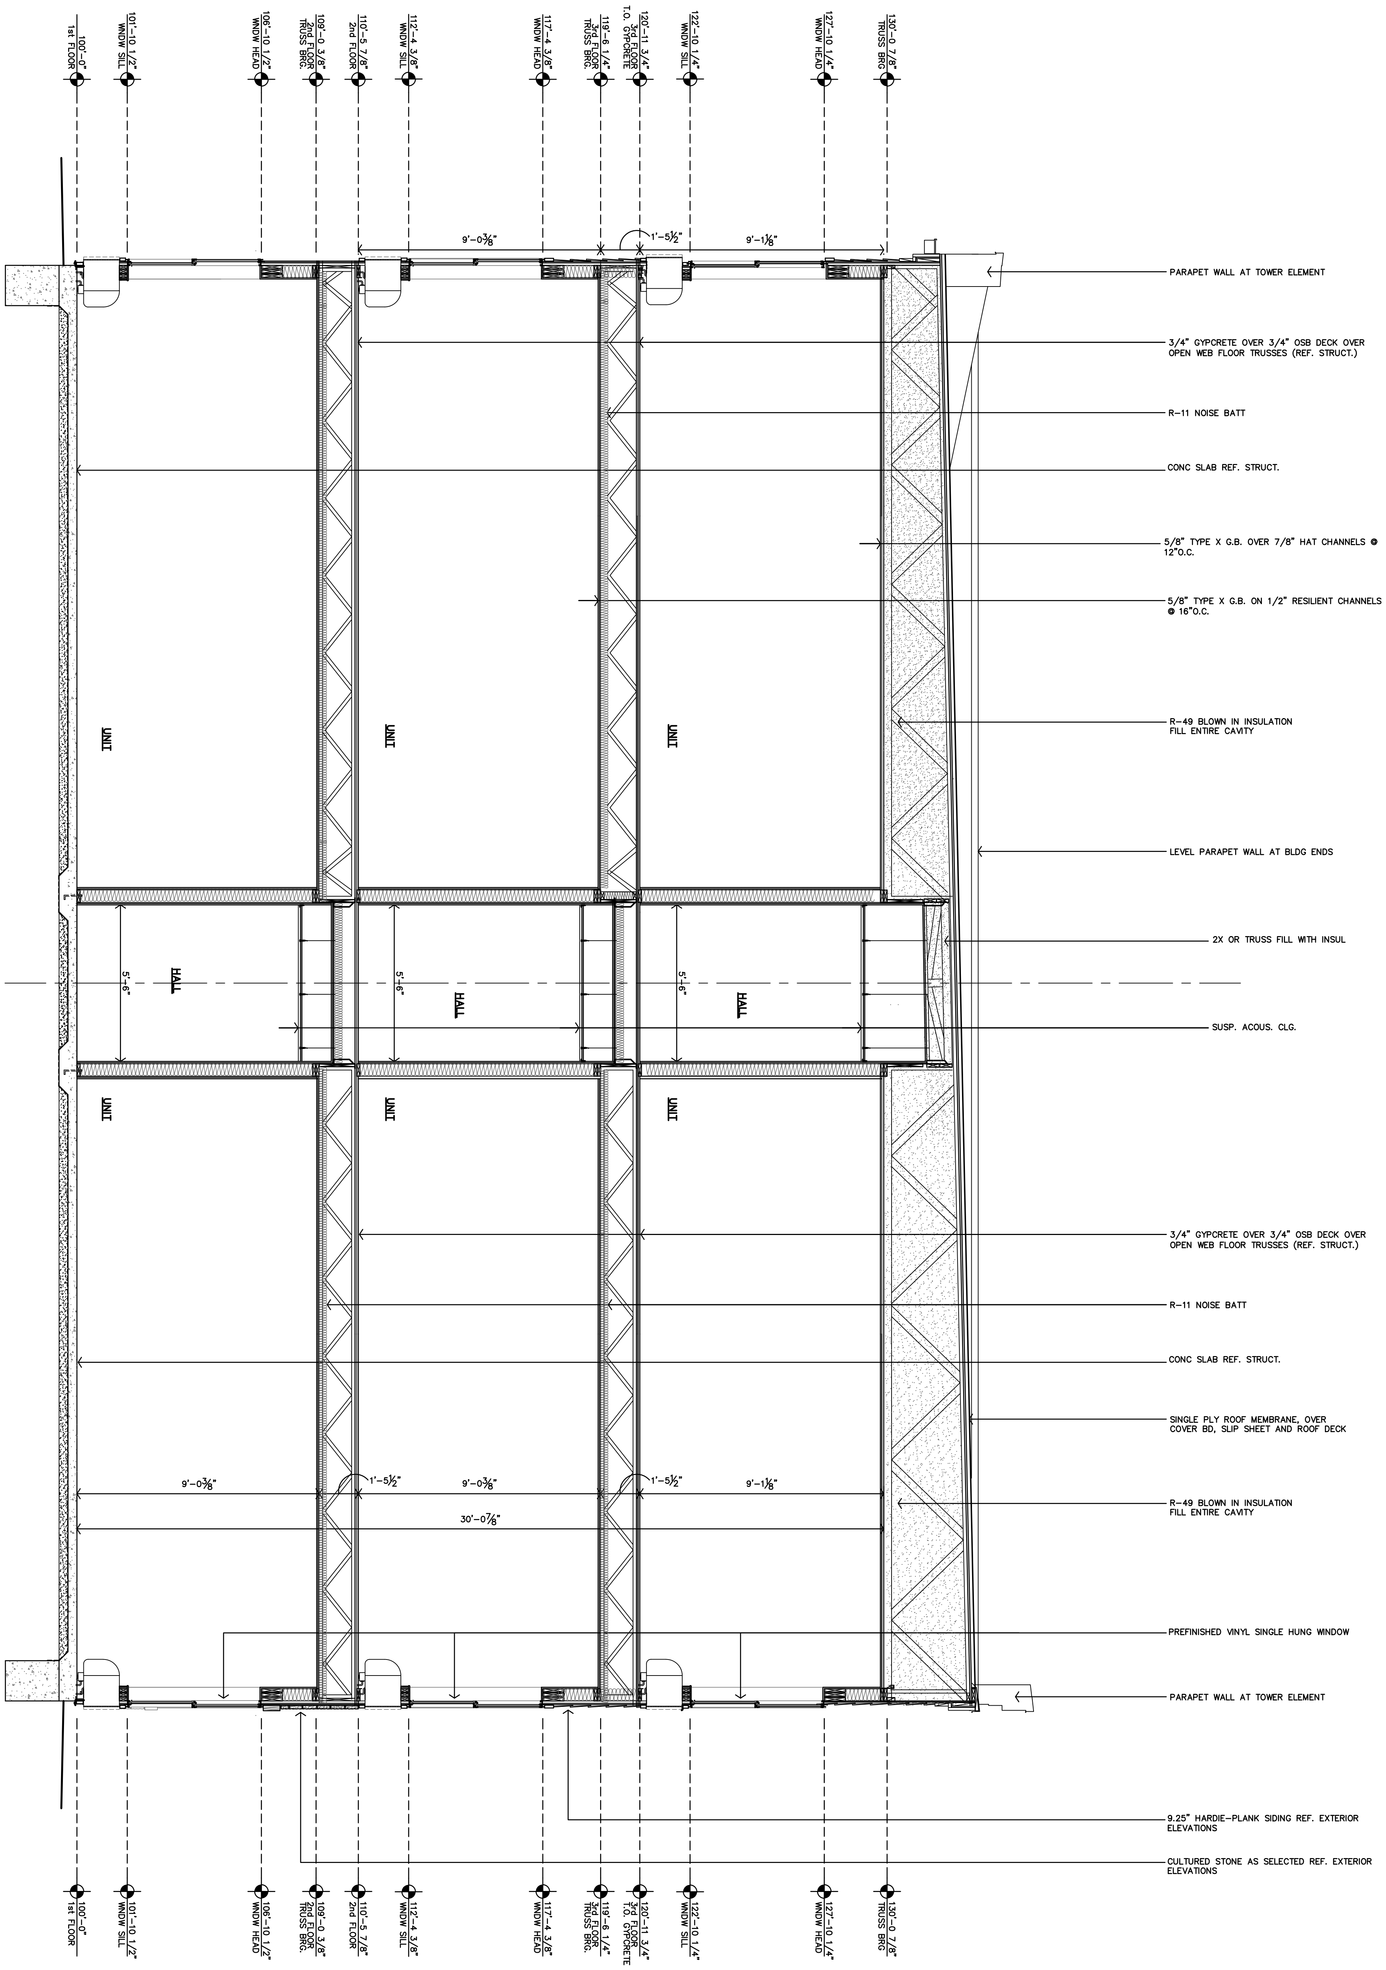

A BUILDING SECTION
3/16"=1'-0"

THE RESIDENCE AT RED CEDAR

NEW SENIOR-LIVING FACILITY

CORSICANA, TEXAS

JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386
1881 Main Street, Suite 301
Kansas City, MO 64108
jgr@jgrarchitects.com

REVISION:

DATE: 12-10-2024
JOB: 24-3392
SHEET NO.: **A3.3**

COPYRIGHTED ©

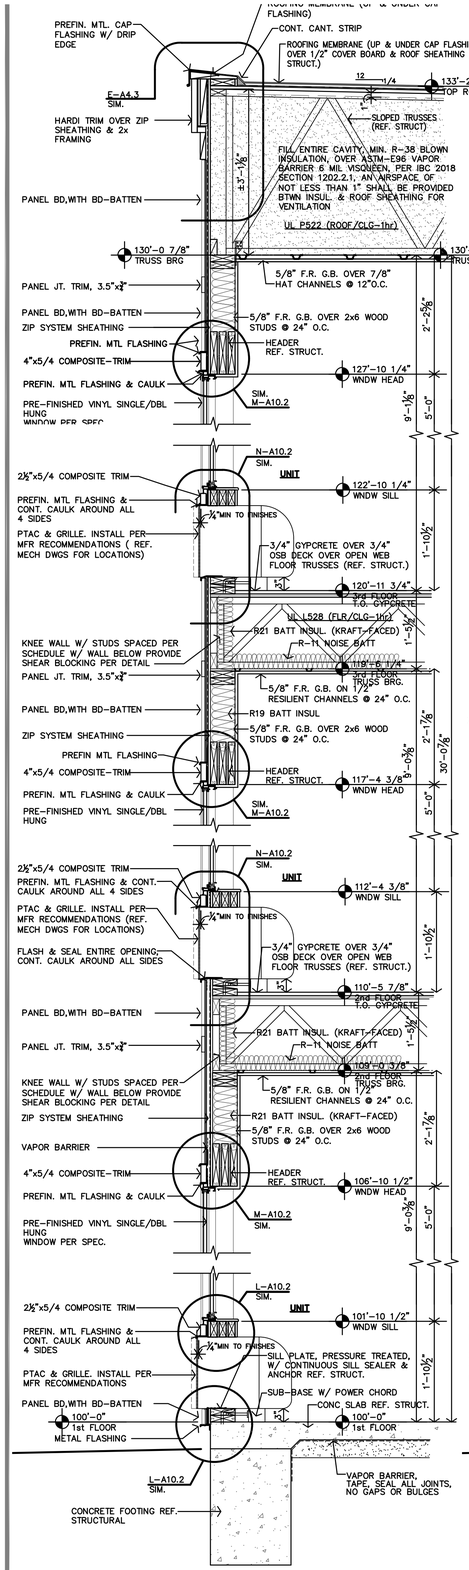

E TYP BD BATTEN WALL SECTION
3/4"=1'-0"

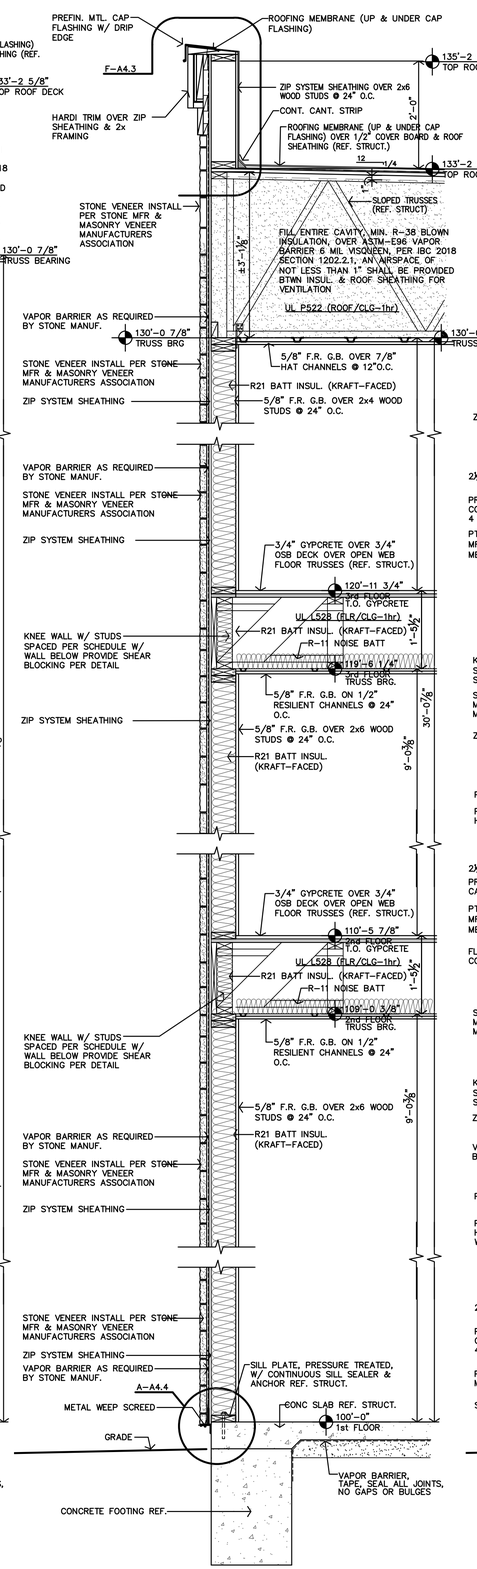

D TYP TOWER STONE WALL SECTION
3/4"=1'-0"

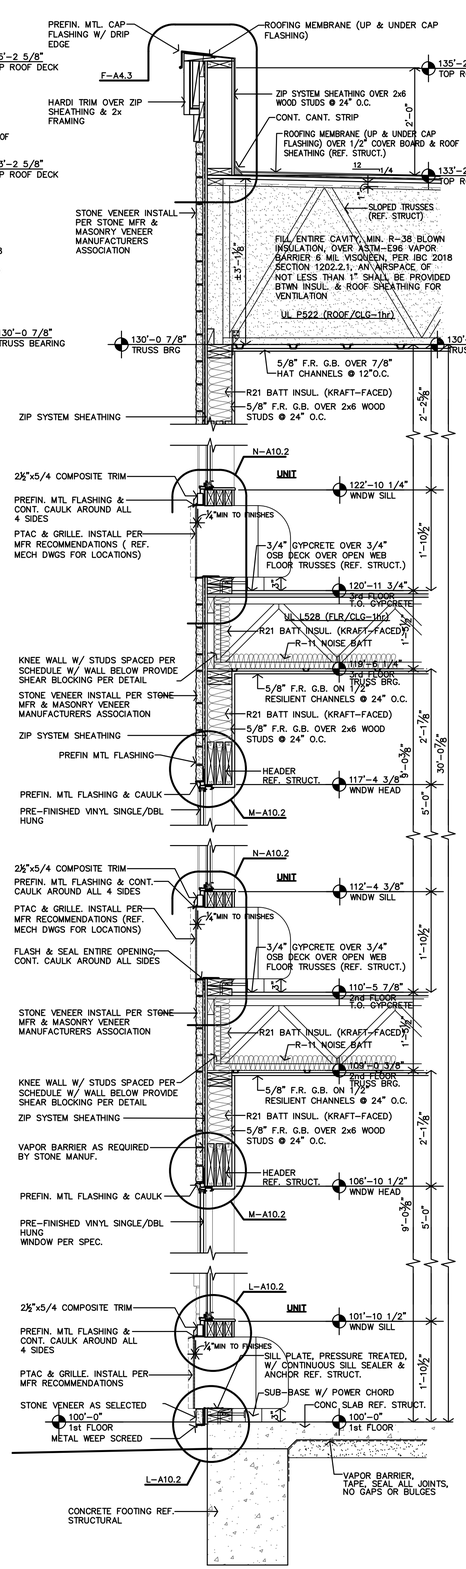

C TYP TOWER STONE WALL SECTION
3/4"=1'-0"

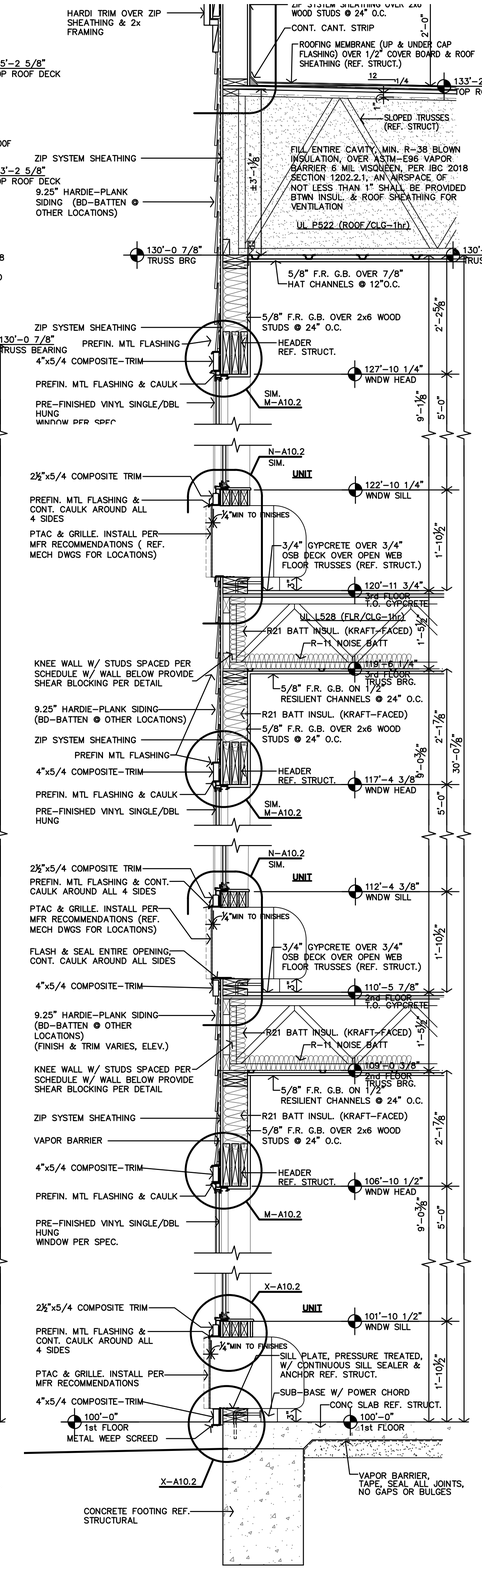

B TYP STONE/SIDING WALL SECTION
3/4"=1'-0"

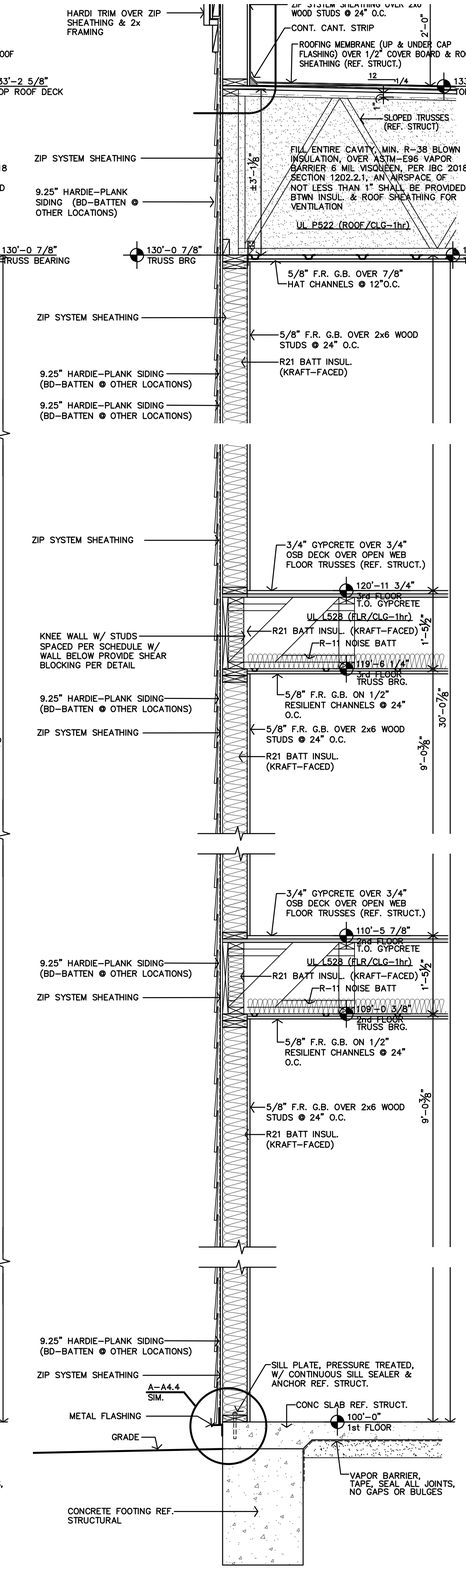

A TYP SIDING WALL SECTION
3/4"=1'-0"

JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386
1881 Main Street, Suite
Kansas City, MO 641
jgr@jgrarchitects.com

THE RESIDENCE AT RED CEDAR

NEW SENIOR-LIVING FACILITY

CORSICANA, TEXAS

REVISION:

DATE: 12-10-2024
JOB: 24-3392
SHEET NO.:

A4.1

COPYRIGHTED ©

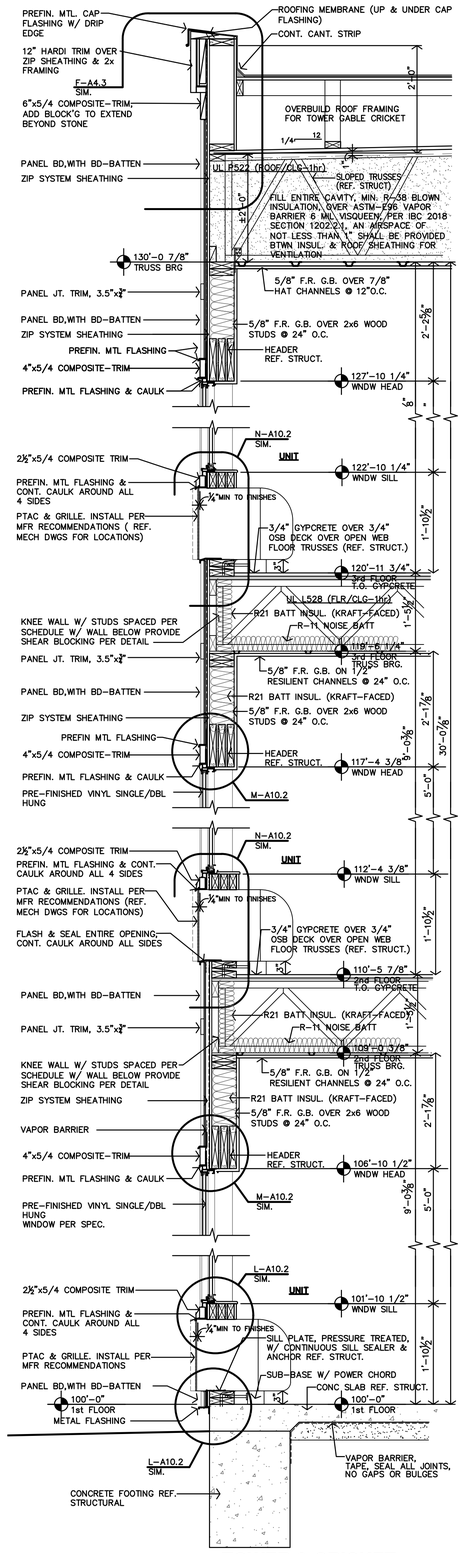

D TOWER & CRICKET REAR WALL SECT.

3/4"=1'-0"

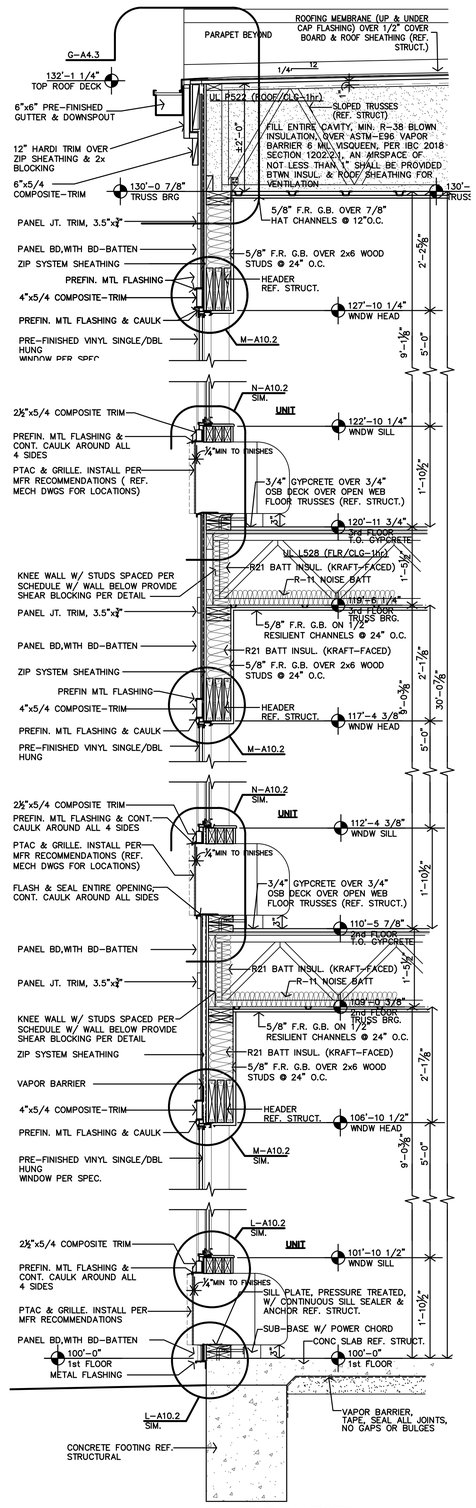

C TYP 3-STORY REAR WALL SECT.

3/4"=1'-0"

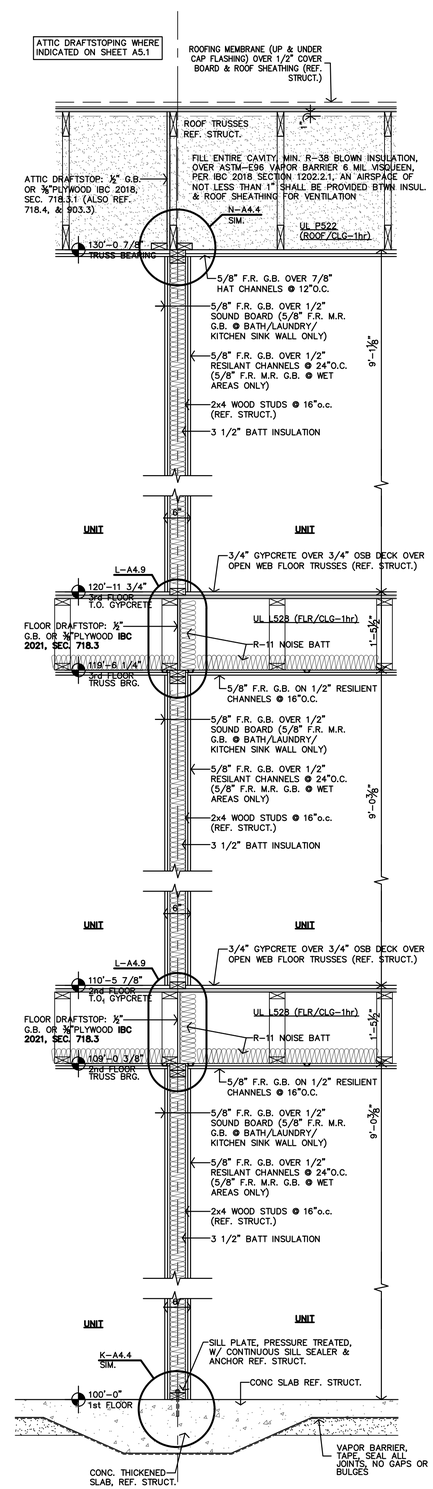

B TYP UNIT/UNIT WALL SECTION

3/4"=1'-0"

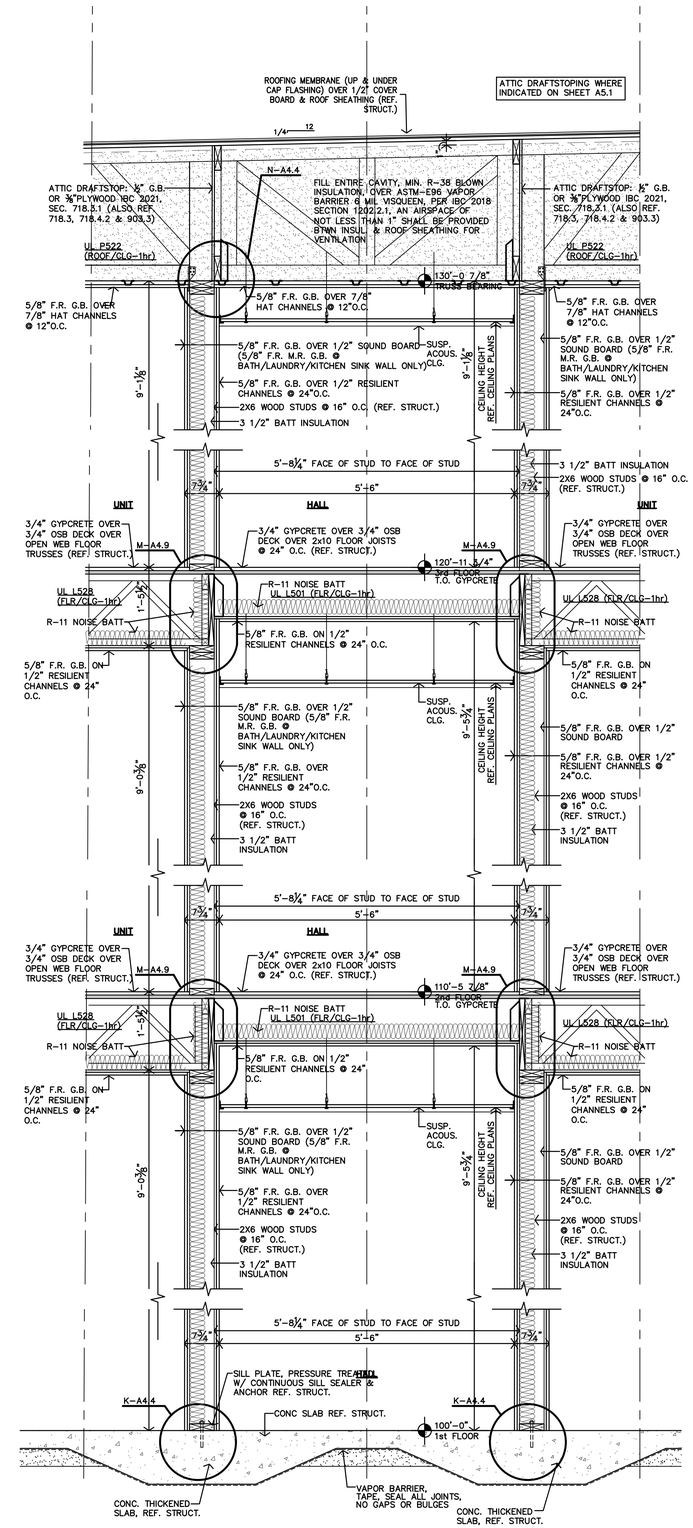

A TYPICAL HALL WALL SECTION

3/4"=1'-0"

JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386
1881 Main Street, Suite
Kansas City, MO 641
jgr@jgrarchitects.com

THE RESIDENCE AT RED CEDAR

NEW SENIOR-LIVING FACILITY

CORSICANA, TEXAS

REVISION:

DATE: 12-10-2024

JOB: 24-3392

SHEET NO.:

A4.2

COPYRIGHTED ©

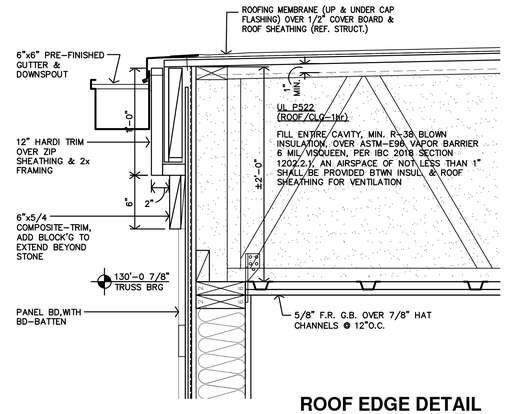

G ROOF EDGE DETAIL REAR WALL SECT.
3/4"=1'-0"

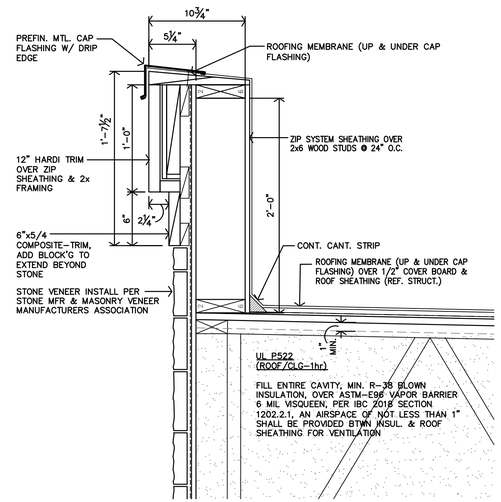

F ROOF EDGE DETAIL FRONT WALL SECT.
3/4"=1'-0"

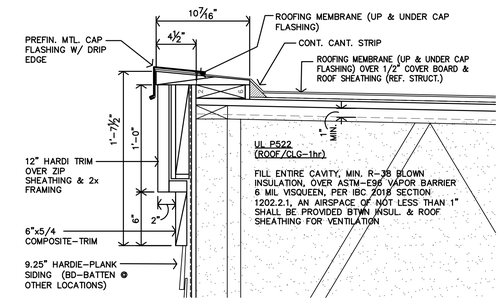

E ROOF EDGE DETAIL FRONT WALL SECT.
3/4"=1'-0"

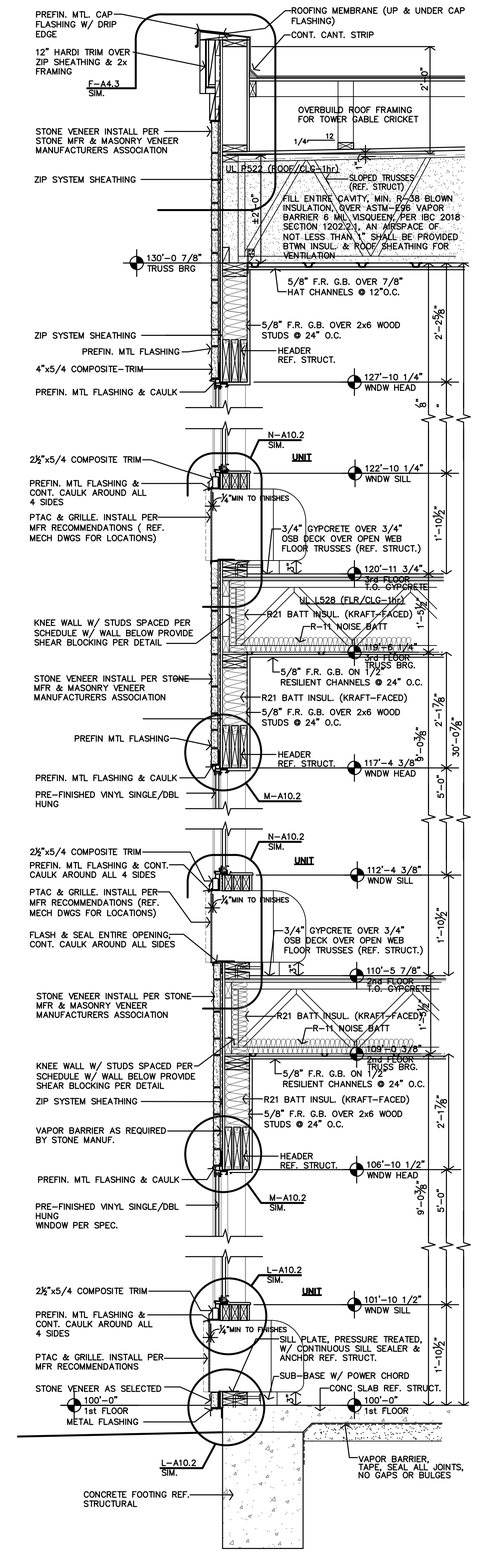

A TOWER & CRICKET REAR WALL SECT.
3/4"=1'-0"

JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386
1881 Main Street, Suite
Kansas City, MO 641
jgr@jgrarchitects.com

THE RESIDENCE AT RED CEDAR

NEW SENIOR-LIVING FACILITY

CORSICANA, TEXAS

REVISION:

DATE: 12-10-2024
JOB: 24-3392
SHEET NO.:

A4.3

COPYRIGHTED ©



U DETAIL @ EXTERIOR LIGHTS
1 1/2"=1'-0"

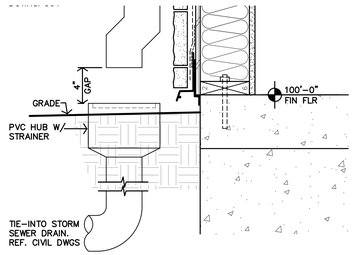

S DETAIL
1 1/2"=1'-0"

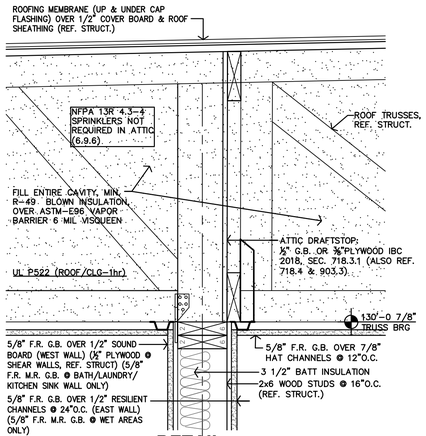

N DETAIL
1 1/2"=1'-0"



F DRAFTSTOP ACCESS DETAIL
1 1/2"=1'-0"

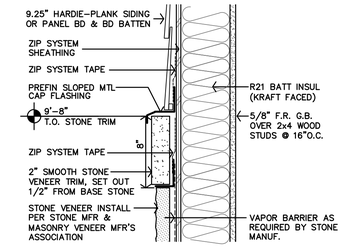

E TRIM DETAIL
1 1/2"=1'-0"

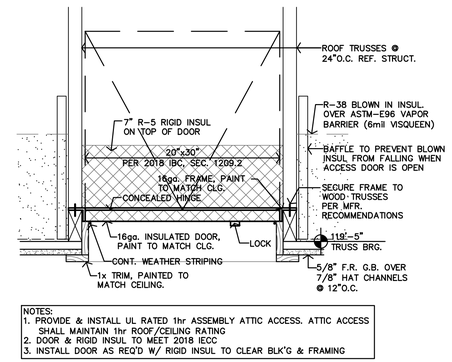

NOTES:
1. PROVIDE & INSTALL UL RATED 1hr ASSEMBLY ATTIC ACCESS. ATTIC ACCESS SHALL MAINTAIN 1hr ROOF/CEILING RATING
2. DOOR & RIGID INSUL TO MEET 2018 IECC
3. INSTALL DOOR AS REQ'D W/ RIGID INSUL TO CLEAR BLK'G & FRAMING

D ATTIC ACCESS DETAIL
1 1/2"=1'-0"

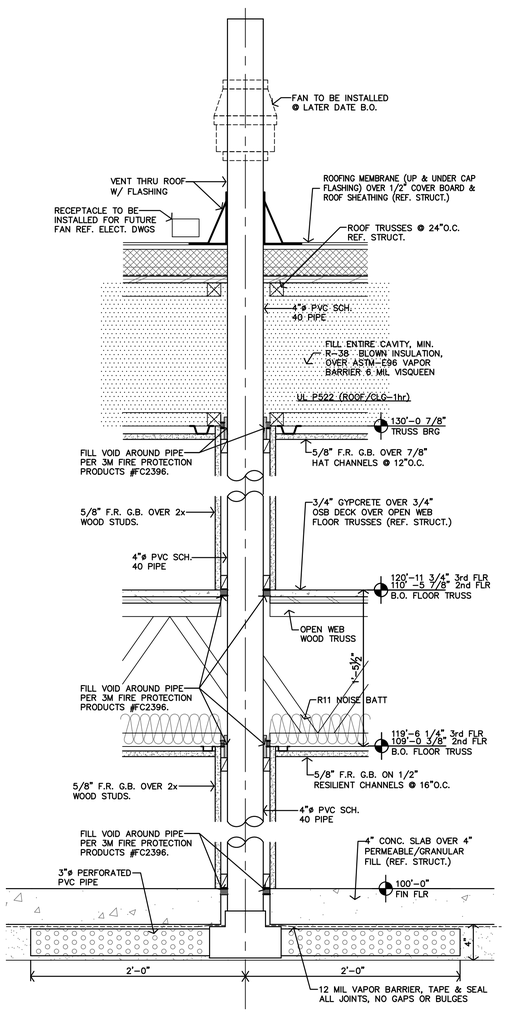

T RADON PIPE DETAIL
1 1/2"=1'-0"

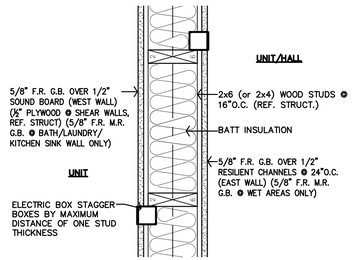

R FIRE BLOCKING @ J-BOX
1 1/2"=1'-0"

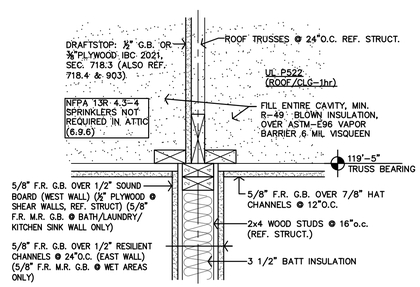

Q PARTY WALL DRAFTSTOP
1 1/2"=1'-0"

M DETAIL
1 1/2"=1'-0"

C THRESHOLD DETAIL
1 1/2"=1'-0"

L DETAIL
1 1/2"=1'-0"

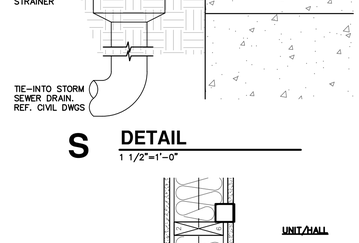

P EXT. WALL DETAIL
1 1/2"=1'-0"

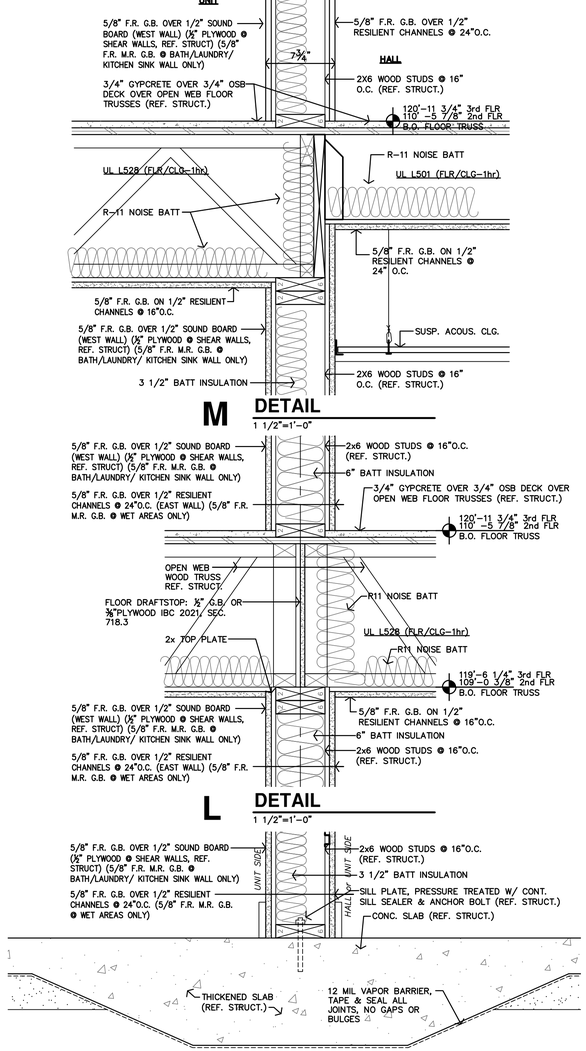

K DETAIL
1 1/2"=1'-0"

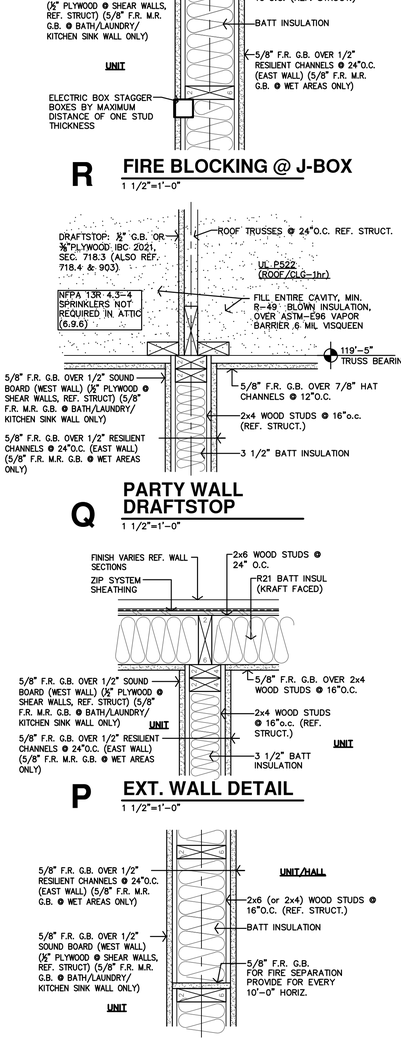

O FIRE BLOCKIING DETAIL
1 1/2"=1'-0"

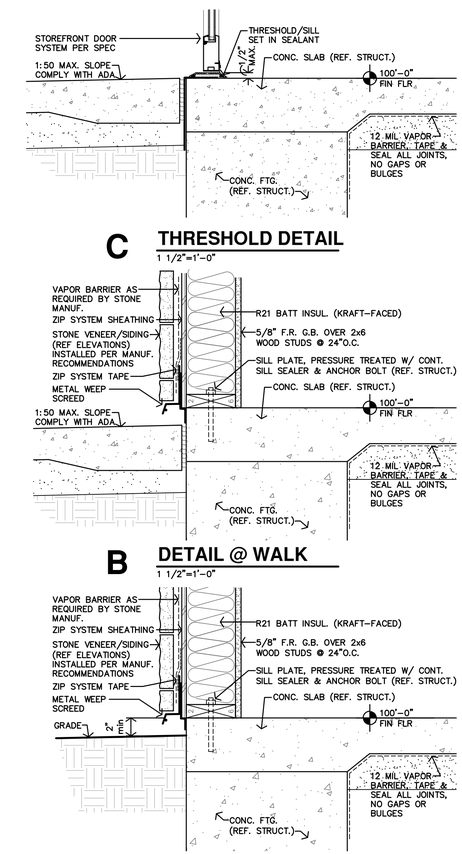

A FOUNDATION DETAIL
1 1/2"=1'-0"

JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386
1881 Main Street, Suite 3(
Kansas City, MO 6410(
jgr@jgrarchitects.com

THE RESIDENCE AT RED CEDAR
NEW SENIOR-LIVING FACILITY
CORSICANA, TEXAS

REVISION:

DATE: 12-10-2024
JOB: 24-3392
SHEET NO.:
A4.4

COPYRIGHTED ©

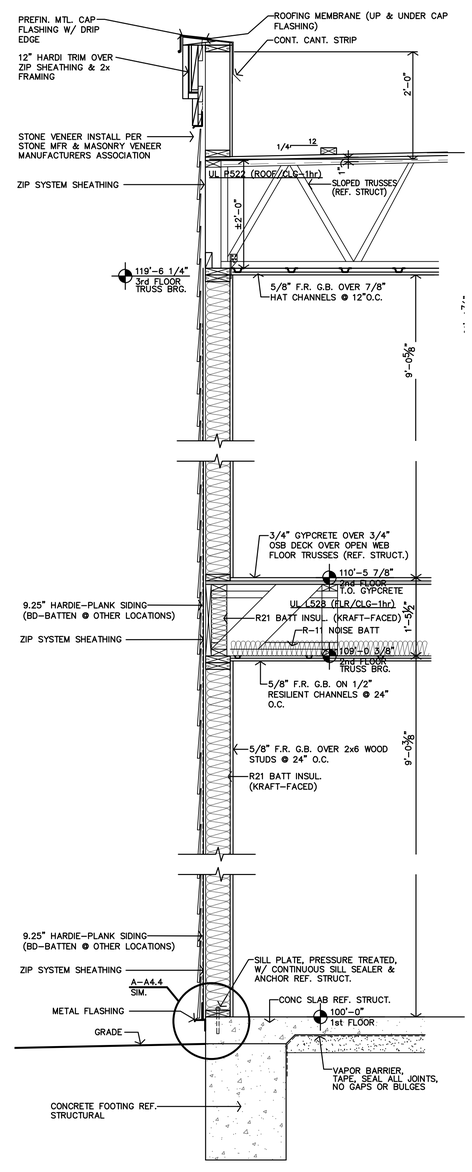

B TYP SIDING WALL SECTION

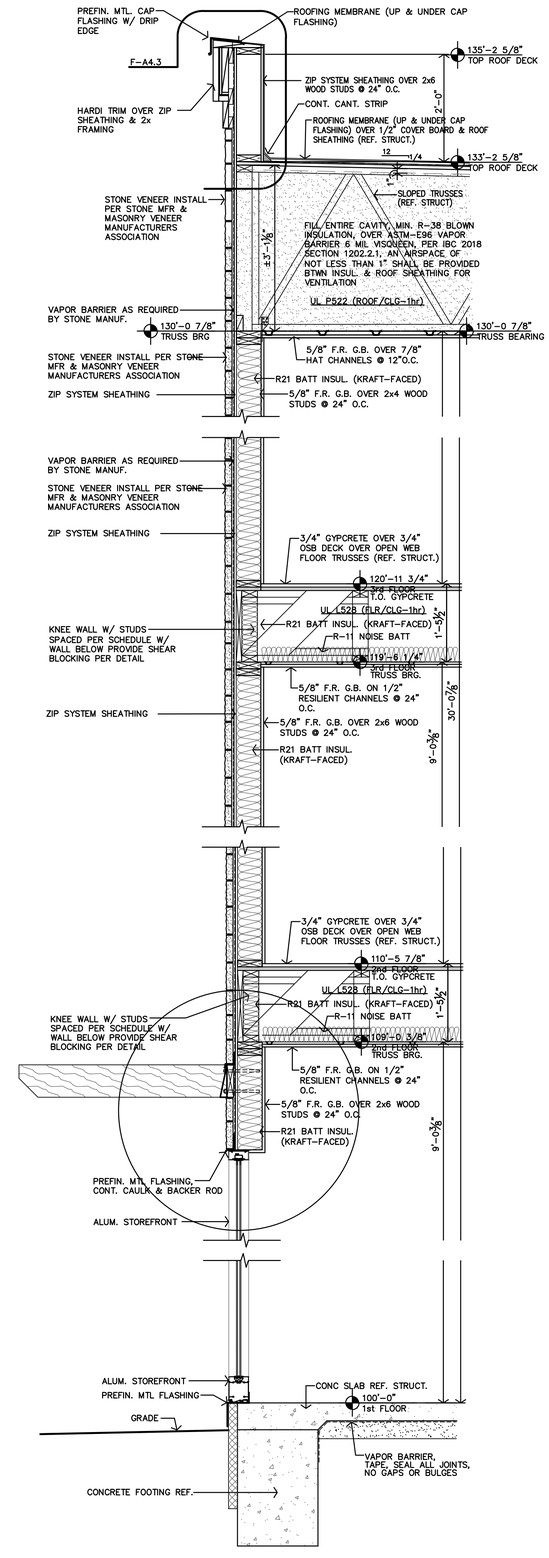

A TYP TOWER STONE WALL SECTION

JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386
1881 Main Street, Suite 3(
Kansas City, MO 6410(
jgr@jgrarchitects.com

THE RESIDENCE AT RED CEDAR

NEW SENIOR-LIVING FACILITY

CORSICANA, TEXAS

REVISION:

DATE: 12-10-2024
JOB: 24-3392
SHEET NO.:

A4.5

COPYRIGHTED ©

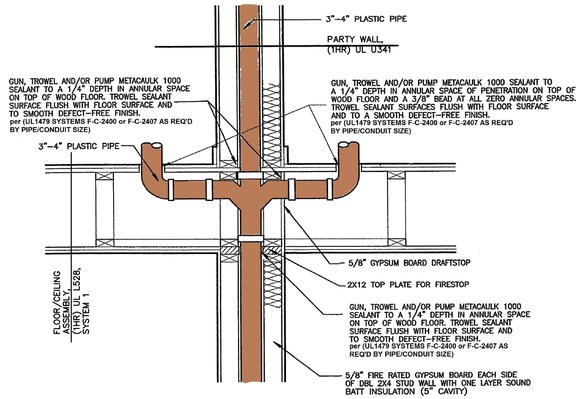

1 PENETRATION ASSEMBLY
NO SCALE

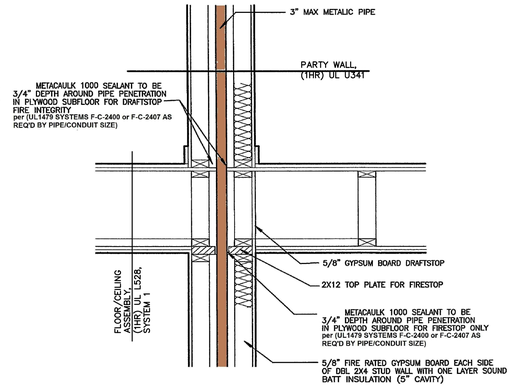

2 PENETRATION ASSEMBLY
NO SCALE

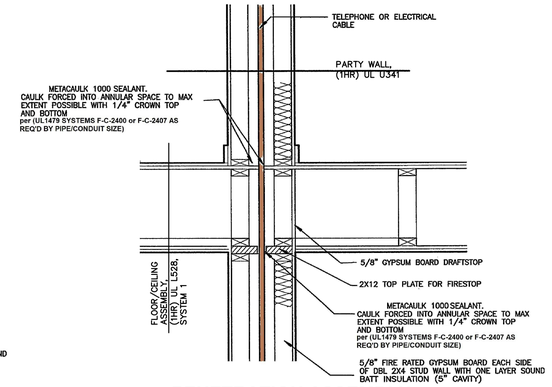

3 PENETRATION ASSEMBLY
NO SCALE

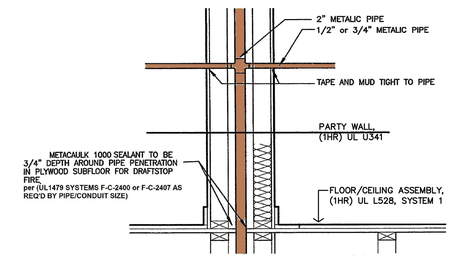

4 PENETRATION ASSEMBLY
NO SCALE

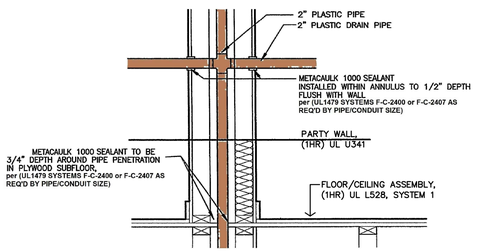

5 PENETRATION ASSEMBLY
NO SCALE

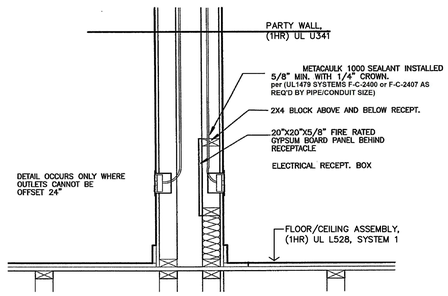

6 PENETRATION ASSEMBLY
NO SCALE

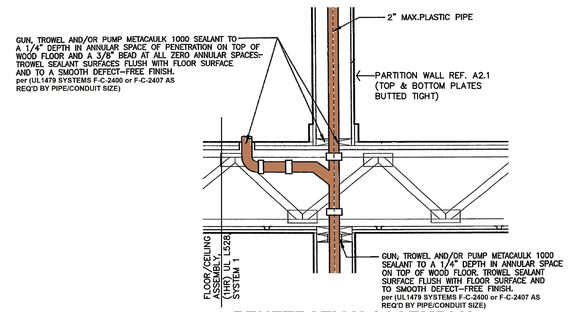

7 PENETRATION ASSEMBLY
NO SCALE

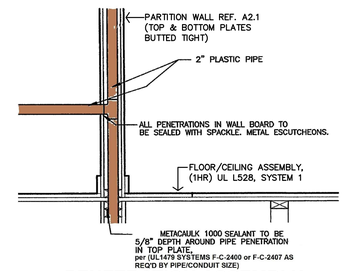

8 PENETRATION ASSEMBLY
NO SCALE

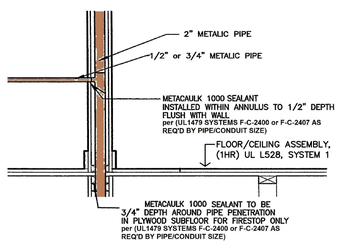

9 PENETRATION ASSEMBLY
NO SCALE

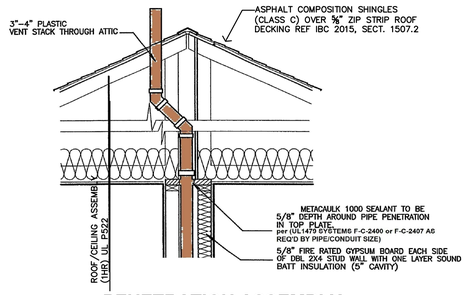

10 PENETRATION ASSEMBLY
NO SCALE

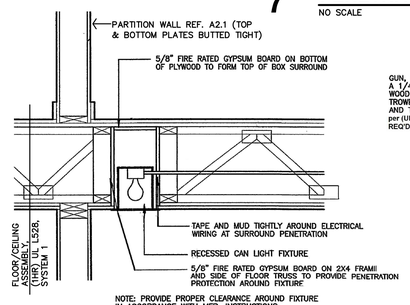

11 PENETRATION ASSEMBLY
NO SCALE

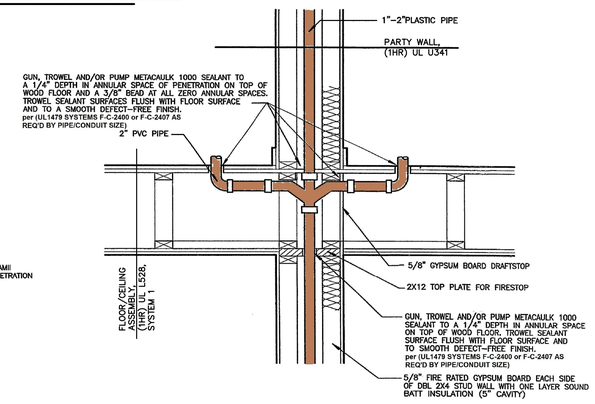

12 PENETRATION ASSEMBLY
NO SCALE

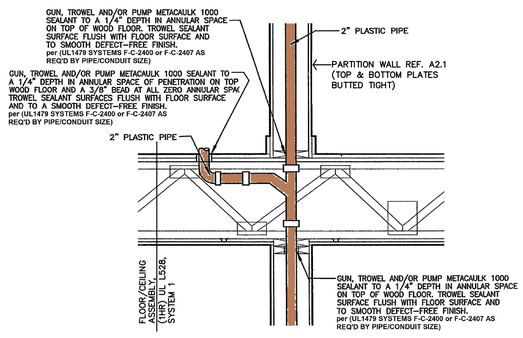

13 PENETRATION ASSEMBLY
NO SCALE

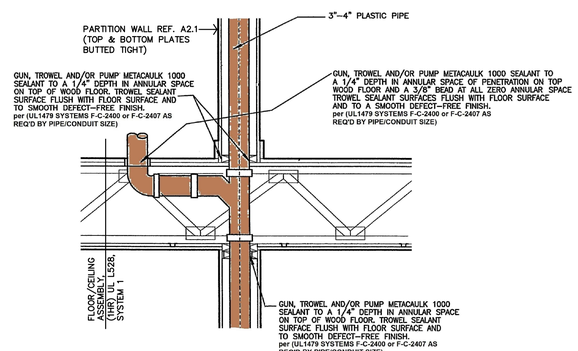

14 PENETRATION ASSEMBLY
NO SCALE

FIRE PENETRATION ASSEMBLIES
NOT TO SCALE

JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386
1881 Main Street, Suite 301
Kansas City, MO 64108
jgr@jgrarchitects.com

THE RESIDENCE AT RED CEDAR
NEW SENIOR-LIVING FACILITY
CORSICANA, TEXAS

REVISION:

DATE: 12–10–2024
JOB: 24–3392
SHEET NO.:
A4.9

COPYRIGHTED ©

ROOF GENERAL NOTES

1. CONTRACTOR SHALL FIELD VERIFY ALL DIMENSIONS & CONDITIONS.
2. MANUFACTURER & INSTALLER SHALL BE RESPONSIBLE FOR TOTAL ROOF SYSTEM INCLUDING TRANSITIONS, FLASHINGS, ETC. TO MAINTAIN WATER TIGHT ROOF SYSTEM. SUBMIT MANUFACTURERS AND ROOFING SYSTEMS PER THE GENERAL CONDITIONS.
3. MANUFACTURER SHALL WARRANT TOTAL ROOF SYSTEM.
4. REF STRUCTURAL DRAWINGS FOR SHEAR WALL LOCATIONS.
5. PLUMBING VENT STACKS, FLUES, FRESH AIR INTAKES, ETC. NOT SHOWN FOR CLARITY. VERIFY LOCATION WITH MECHANICAL & PLUMBING DRAWINGS.
6. CONTRACTOR SHALL TIE-IN AND COORDINATE WITH UNDERGROUND ROOF COLLECTOR, EACH DOWNSPOUT LOCATION. REFERENCE CIVIL DRAWINGS.
7. INSTALL FIREBLOCKING, ANCHOR BOLTS AND ANY REQUIRED SHEAR WALL BLOCKING AS REQUIRED BY STRUCTURAL DRAWINGS.
8. CAULK & SEAL WATERTIGHT ALL JOINTS & TRANSITIONS.
9. ALL METAL MATERIALS (I.E. VALLEYS, FLASHINGS, ETC...) SHALL BE .0217" THICK (26 GA) PREFINISHED GALVANIZED OR ALUM. ZINC ALLOY. ALL FASTENERS MUST BE COMPATIBLE WITH ASSOCIATED METALS/MATERIALS. METALS MUST BE INSTALLED PER SMACNA's "ARCHITECTURAL SHEET METAL MANUAL."
10. CONTRACTOR MUST COMPLY WITH ALL STATE & LOCAL CODES & REGULATIONS.
11. PROVIDE PERMANENT IDENTIFICATION ACCEPTABLE TO LOCAL AUTHORITIES AT ALL DRAFTSTOPS AND DRAFTSTOP ACCESS
12. CONTRACTOR TO INSTALL ICE & WATER SHIELD @ ALL TRANSITIONS & METAL FLASHING. (IF APPLICABLE)
13. BUILDING EQUIPPED THROUGHOUT W/ AN AUTOMATIC SPRINKLER SYSTEM IN ACCORDANCE IN ACCORDANCE W/ 2018 IBC SECTION 903.3.1.2. PROTECTION NOT REQUIRED IN ATTIC SPACE PER IBC SECTION 903.3.1.2.3
14. MAINTAIN A 36" CLEARANCE AROUND ALL MECH UNITS.
15. REFERENCE SITE PLAN SHEET A1.1 FOR LOCATION & ORIENTATION OF BUILDINGS
16. AT LOWER ROOF – INSTALL ATTIC VENTILATION OF NOT LESS THAN 1/150 OF THE ATTIC AREA WITH 50% OF REQ'D VENTILATION LOCATED IN THE UPPER PORTION OF THE ROOF AREA, PER IBC 2018, SECTION 1203.2
17. INSTALL ATTIC ACCESS PER DETAIL H–A4.5. LOCATE PER ROOF PLAN
18. AT UPPER ROOF – INSTALL DRAFTSTOPS PER IBC 2018, SECTION 718.3 & 718.4 (REF. ALSO 718.3.2, & 718.4.2). DRAFTSTOPPING SHALL BE INSTALLED ABOVE AND IN LINE WITH DWELLING UNITS AND SEPARATION WALLS. PER IBC 2018 SECTION 718.4.2, EXCEPTION 3: DRAFTSTOP COMPARTMENTS NOT TO EXCEED 3,000sf OR (2) DWELLING UNITS.
19. CONTRACTOR TO USE NAILS FOR FASTENING NEW SHINGLES. STAPLES ARE NOT ALLOWED.
16. ROOFING INSTALLATION: DETAILS INDICATED ON THIS SHEET ARE GENERIC/GENERAL. CONTRACTOR SHALL COMPLY WITH MANUFACTURER'S WRITTEN INSTRUCTIONS & RECOMMENDATIONS, BUT NOT LESS THAN THOSE RECOMMENDED BY NRCA's "THE ROOFING & WATERPROOFING MANUAL" & "STEEP SLOPE ROOF SYSTEMS".

LOWER ROOF - DRAFTSTOPPING & ATTIC VENTILATION

DRAFTSTOPPING IS NOT REQUIRED, PER IBC 2018 SECTION 718.4. AREA IS LESS THAN 3,000 SF.

ATTIC VENTILATION PER IBC 2018, SECTION 1202.2 (EXCEPTION 2), 1/300 WITH ASTM 396 VAPOR BARRIER RIDGE VENT SHALL PROVIDE A MIN. OF 18 SQUARE INCHES OF NET FREE AREA, (NFA) OF VENTILATION PER LINEAR FOOT, OR ADDITONAL AND OPTIONAL VENTS MUST BE INSTALLED.

AREA 1 (929 SF)
ATTIC AREA MUST PROVIDE
(929/300 = 3.10/2 = 1.55 HIGH & LOW EACH)
1.55sf OF NET FREE AREA @ THE RIDGE & SOFFITS.

UPPER ROOF - DRAFTSTOPPING & ATTIC VENTILATION

DRAFTSTOPPING IS PROVIDED IN THE ATTIC SPACE ACCORDING TO 2018 IBC SECTIONS 708.4.2 & 718.4.
DRAFTSTOPPING AREA CALCULATIONS SHOWN ON ROOF PLAN, THIS SHEET.

AREA 1 (1,597 SF)
ATTIC AREA MUST PROVIDE
(376/150 = 10.65 (of NET FREE AREA VENTILATION)

AREA 3 (1,188 SF)
ATTIC AREA MUST PROVIDE
(1,181/150 = 7.92 (of NET FREE AREA VENTILATION)

AREA 4 (840 SF)
ATTIC AREA MUST PROVIDE
(840/150 = 5.60 (of NET FREE AREA VENTILATION)

AREA 5 (1,426 SF)
ATTIC AREA MUST PROVIDE
(1,426/150 = 9.51 (of NET FREE AREA VENTILATION)

AREA 5 (1,416 SF)
ATTIC AREA MUST PROVIDE
(1,416/150 = 9.44 (of NET FREE AREA VENTILATION)

AREA 7 (822 SF)
ATTIC AREA MUST PROVIDE
(822/150 = 5.48 (of NET FREE AREA VENTILATION)

AREA 8 (1,409 SF)
ATTIC AREA MUST PROVIDE
(1,409/150 = 9.39 (of NET FREE AREA VENTILATION)

LEGEND

1. INSTALL 60–MIL TPO ROOFING MEMBRANE OVER 1/2" COVER BOARD, XPS RIGID INSUL. (5"min), (TAPERED INSULATION AS REQUIRED FOR ROOF DRAINAGE, REFERENCE ROOF PLAN), ROOF SHEATHING & ROOF TRUSSES (REF. STRUCT). PROVIDE TERMINATION BARS, FLASHING, SEALANT, & CAULKING. RUN ROOFING MEMBRANE UP BACKSIDE OF PARAPETS AND INSTALL PARAPET METAL FLASHING CAPS (COLOR TO BE DETERMINED). ENTIRE ROOF ASSEMBLY SHALL BE PROVIDED AND INSTALLED AS REQUIRED & RECOMMENDED BY MANUFACTURER FOR A 20–YEAR, FULL COVERAGE WARRANTY.
2. 1–HR FIRE PARTITION TO UNDERSIDE OF DECK. (ELEVATOR SHAFT BELOW)
3. LOCATION OF ROOF HATCH & SAFETY RAIL PER SPEC
4. NOT USED
5. INSTALL DRAFTSTOP DOOR(S) PER IBC 2018, SECTION 718.4.1.1. REFERENCE DETAIL F–A4.4
6. INSTALL ATTIC ACCESS PER IBC 2018, SECTION 1209.2. REFERENCE DETAIL D–A4.4
7. INSTALL GRAVITY VENTILATOR, SIM. TO GREENHECK GRS–16–QD, (MUST HAVE 1.45 SF OF NFA OR GREATER).
8. RADON PIPE THROUGH ROOF. REF. T–A4.4 & MECH. DWGS.

INDICATES 60–MIL TPO ROOFING MATERIAL

CEMENT BOARD SOFFIT OR HARDI BOARD (TYP)

(DS) INDICATES LOCATION OF A PREFIN. 3x4 DOWNSPOUT

MINIMUM GUTTER & DOWNSPOUT

GUTTER – PREFIN. 4x5
DOWNSPOUT – PREFIN. 3x4

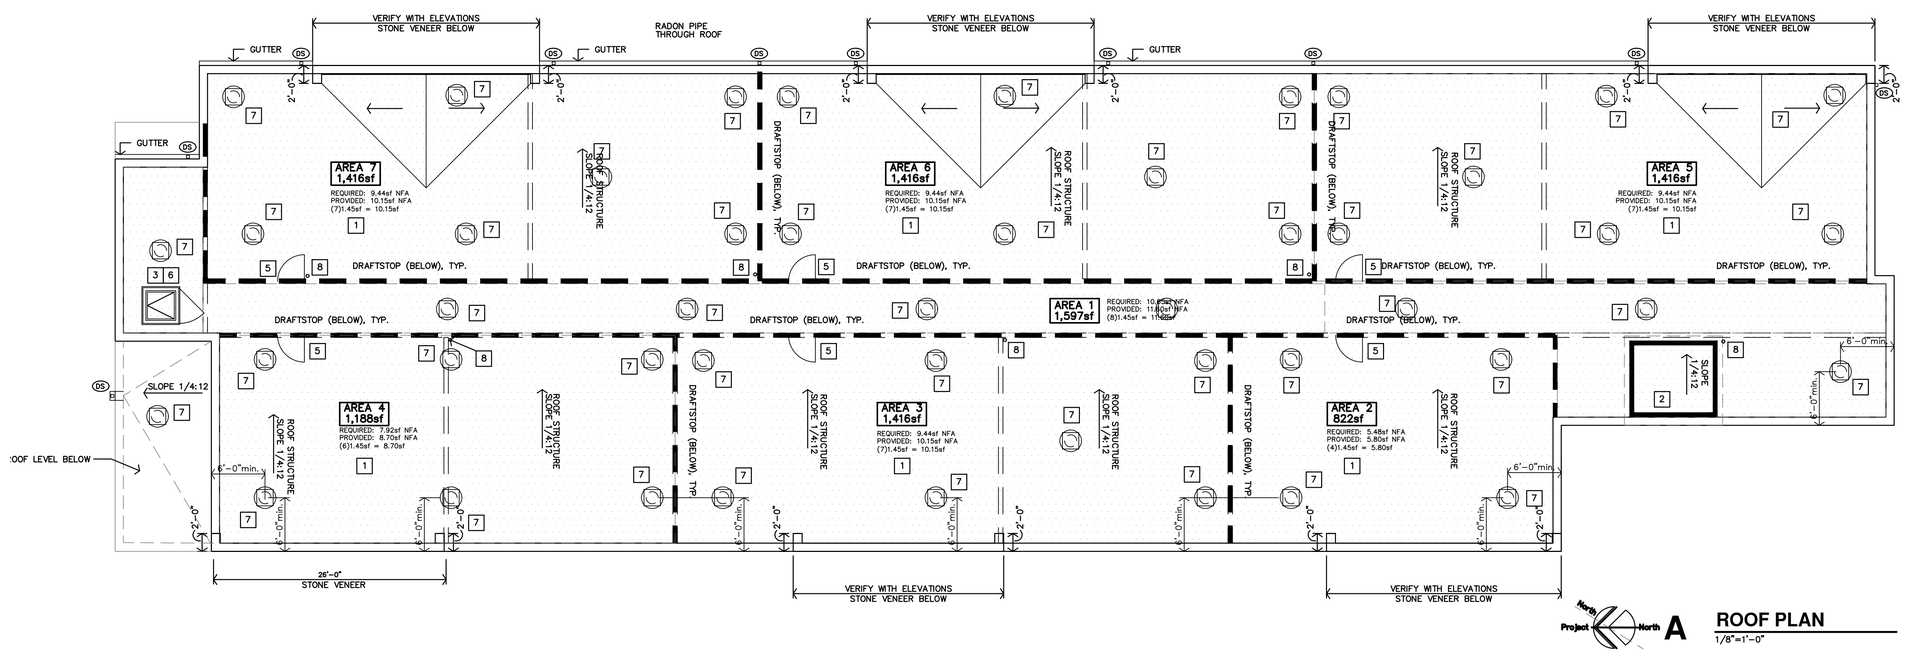

Project North / True North

A **ROOF PLAN**
1/8"=1'–0"

JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386
1881 Main Street, Suite 3
Kansas City, MO 64108
jgr@jgrarchitects.com

THE RESIDENCE AT RED CEDAR
NEW SENIOR-LIVING FACILITY
CORSICANA, TEXAS

REVISION:

DATE: 12–10–2024
JOB: 24–3392
SHEET NO.:
A5.1

COPYRIGHTED ©

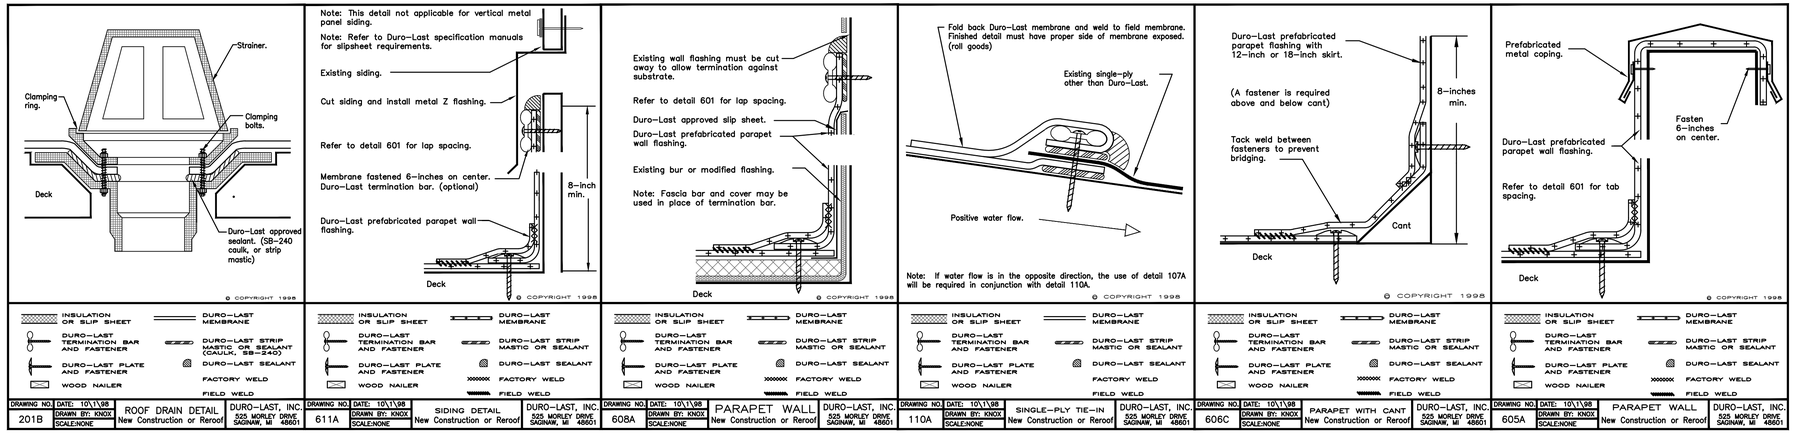

DURO-LAST MECHANICALLY ATTACHED ROOFING DETAILS

BASIS OF SPECIFICATION. ACTUAL FIELD AND SUBSTRATE CONDITIONS VARY-REFERENCE SPECIFICATIONS

ROOFING DETAILS THIS SHEET ARE FOR BASE BID, DUROLAST OR FIRESTONE TPO MEMBRANE ROOF SYSTEM. THESE ARE MANUFACTURER'S STANDARD DETAILS FOR BASIS OF SPECIFICATION, AND FOR REFERENCE PURPOSES ONLY. FIELD CONDITIONS VARY. CONTRACTOR IS RESPONSIBLE TO INSTALL A COMPLETE, WEATHER-TIGHT ASSEMBLY IN FULL COMPLIANCE WITH THE SPECIFIED WARRANTIES.

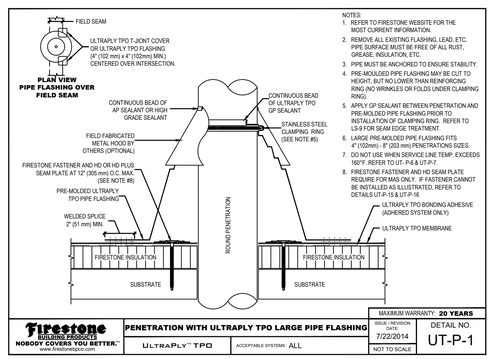

NOTES:
1. REFER TO FIRESTONE WEBSITE FOR THE MOST CURRENT INFORMATION.
2. REMOVE ALL EXISTING FLASHING, LEAD, ETC. PIPE SURFACE MUST BE FREE OF ALL RUST, GREASE, INSULATION, ETC.
3. PIPE MUST BE ANCHORED TO ENSURE STABILITY.
4. PRE-MOULDED PIPE FLASHING MAY BE CUT TO HEIGHT, BUT NO LOWER THAN REINFORCING RING (NO WRINKLES OR FOLDS UNDER CLAMPING RING).
5. APPLY GP SEALANT BETWEEN PENETRATION AND PRE-MOLDED PIPE FLASHING PRIOR TO INSTALLATION OF CLAMPING RING. REFER TO LS-9 FOR SEAM EDGE TREATMENT.
6. LARGE PRE-MOLDED PIPE FLASHING FITS 4" (102mm) - 8" (203 mm) PENETRATIONS SIZES.
7. DO NOT USE WHEN SERVICE LINE TEMP. EXCEEDS 160°F. REFER TO UT-P-6 & UT-P-7.
8. FIRESTONE FASTENER AND HD SEAM PLATE REQUIRE FOR MAS ONLY. IF FASTENER CANNOT BE INSTALLED AS ILLUSTRATED, REFER TO DETAILS UT-P-15 & UT-P-16

Firestone BUILDING PRODUCTS — NOBODY COVERS YOU BETTER.™ www.firestonepro.com
PENETRATION WITH ULTRAPLY TPO LARGE PIPE FLASHING | ULTRAPLY™ TPO | ACCEPTABLE SYSTEMS: ALL
MAXIMUM WARRANTY: 20 YEARS | ISSUE / REVISION DATE: 7/22/2014 | NOT TO SCALE | DETAIL NO. UT-P-1

G LARGE PIPE DTL.
NO SCALE

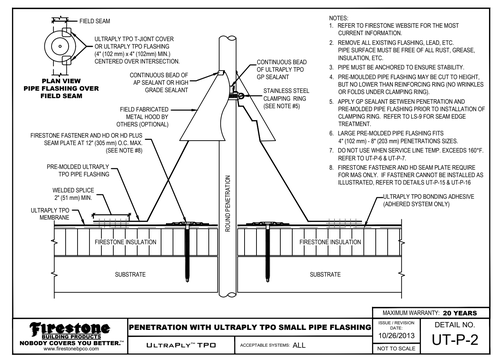

NOTES:
1. REFER TO FIRESTONE WEBSITE FOR THE MOST CURRENT INFORMATION.
2. REMOVE ALL EXISTING FLASHING, LEAD, ETC. PIPE SURFACE MUST BE FREE OF ALL RUST, GREASE, INSULATION, ETC.
3. PIPE MUST BE ANCHORED TO ENSURE STABILITY.
4. PRE-MOULDED PIPE FLASHING MAY BE CUT TO HEIGHT, BUT NO LOWER THAN REINFORCING RING (NO WRINKLES OR FOLDS UNDER CLAMPING RING).
5. APPLY GP SEALANT BETWEEN PENETRATION AND PRE-MOLDED PIPE FLASHING PRIOR TO INSTALLATION OF CLAMPING RING. REFER TO LS-9 FOR SEAM EDGE TREATMENT.
6. LARGE PRE-MOLDED PIPE FLASHING FITS 4" (102 mm) - 8" (203 mm) PENETRATIONS SIZES.
7. DO NOT USE WHEN SERVICE LINE TEMP. EXCEEDS 160°F. REFER TO UT-P-6 & UT-P-7.
8. FIRESTONE FASTENER AND HD SEAM PLATE REQUIRE FOR MAS ONLY. IF FASTENER CANNOT BE INSTALLED AS ILLUSTRATED, REFER TO DETAILS UT-P-15 & UT-P-16

Firestone BUILDING PRODUCTS — NOBODY COVERS YOU BETTER.™ www.firestonepro.com
PENETRATION WITH ULTRAPLY TPO SMALL PIPE FLASHING | ULTRAPLY™ TPO | ACCEPTABLE SYSTEMS: ALL
MAXIMUM WARRANTY: 20 YEARS | ISSUE / REVISION DATE: 10/26/2013 | NOT TO SCALE | DETAIL NO. UT-P-2

F SMALL PIPE DTL.
NO SCALE

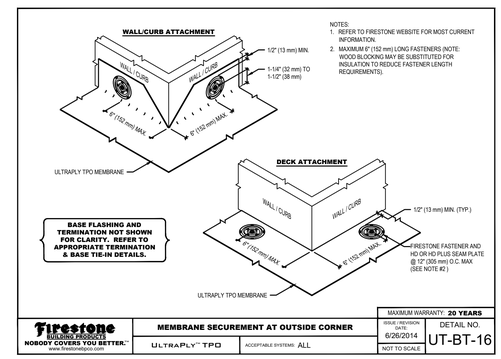

NOTES:
1. REFER TO FIRESTONE WEBSITE FOR MOST CURRENT INFORMATION.
2. MAXIMUM 8" (152 mm) LONG FASTENERS (NOTE: WOOD BLOCKING MAY BE SUBSTITUTED FOR INSULATION TO REDUCE FASTENER LENGTH REQUIREMENTS).

Firestone BUILDING PRODUCTS — NOBODY COVERS YOU BETTER.™ www.firestonepro.com
MEMBRANE SECUREMENT AT OUTSIDE CORNER | ULTRAPLY™ TPO | ACCEPTABLE SYSTEMS: ALL
MAXIMUM WARRANTY: 20 YEARS | ISSUE / REVISION DATE: 6/26/2014 | NOT TO SCALE | DETAIL NO. UT-BT-16

E OUTSIDE CORNER DTL.
NO SCALE

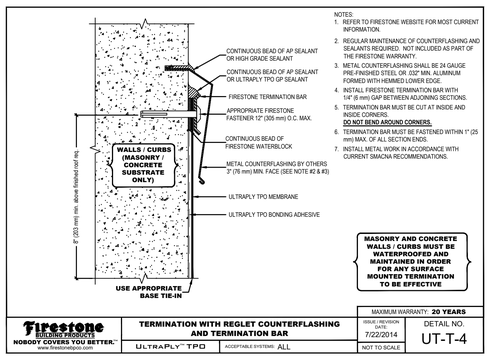

NOTES:
1. REFER TO FIRESTONE WEBSITE FOR MOST CURRENT INFORMATION.
2. REGULAR MAINTENANCE OF COUNTERFLASHING AND SEALANTS REQUIRED. NOT INCLUDED AS PART OF THE FIRESTONE WARRANTY.
3. METAL COUNTERFLASHING SHALL BE 24 GAUGE PRE-FINISHED STEEL OR .032" MIN. ALUMINUM FORMED WITH HEMMED LOWER EDGE.
4. INSTALL FIRESTONE TERMINATION BAR WITH 1/4" (6 mm) GAP BETWEEN ADJOINING SECTIONS.
5. TERMINATION BAR MUST BE CUT AT INSIDE AND INSIDE CORNERS.
DO NOT BEND AROUND CORNERS.
6. TERMINATION BAR MUST BE FASTENED WITHIN 1" (25 mm) MAX. OF ALL SECTION ENDS.
7. INSTALL METAL WORK IN ACCORDANCE WITH CURRENT SMACNA RECOMMENDATIONS.

Firestone BUILDING PRODUCTS — NOBODY COVERS YOU BETTER.™ www.firestonepro.com
TERMINATION WITH REGLET COUNTERFLASHING AND TERMINATION BAR | ULTRAPLY™ TPO | ACCEPTABLE SYSTEMS: ALL
MAXIMUM WARRANTY: 20 YEARS | ISSUE / REVISION DATE: 7/22/2014 | NOT TO SCALE | DETAIL NO. UT-T-4

D FLASHING DETAIL
NO SCALE

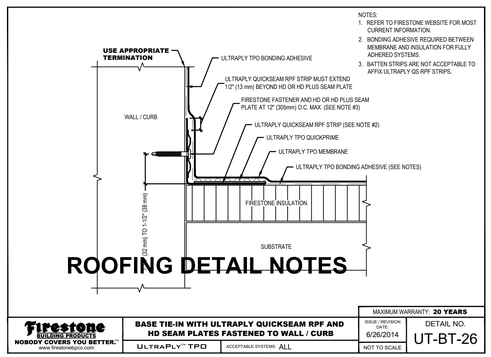

NOTES:
1. REFER TO FIRESTONE WEBSITE FOR MOST CURRENT INFORMATION.
2. BONDING ADHESIVE REQUIRED BETWEEN MEMBRANE AND INSULATION FOR FULLY ADHERED SYSTEMS.
3. BATTEN STRIPS ARE NOT ACCEPTABLE TO AFFIX ULTRAPLY QS RPF STRIPS.

ROOFING DETAIL NOTES

Firestone BUILDING PRODUCTS — NOBODY COVERS YOU BETTER.™ www.firestonepro.com
BASE TIE-IN WITH ULTRAPLY QUICKSEAM RPF AND HD SEAM PLATES FASTENED TO WALL / CURB | ULTRAPLY™ TPO | ACCEPTABLE SYSTEMS: ALL
MAXIMUM WARRANTY: 20 YEARS | ISSUE / REVISION DATE: 6/26/2014 | NOT TO SCALE | DETAIL NO. UT-BT-26

C ROOF-TO-WALL TIE-IN
NO SCALE

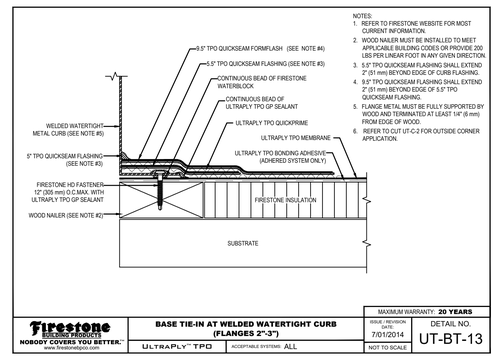

NOTES:
1. REFER TO FIRESTONE WEBSITE FOR MOST CURRENT INFORMATION.
2. WOOD NAILER MUST BE INSTALLED TO MEET APPLICABLE BUILDING CODES OR PROVIDE 200 LBS PER LINEAR FOOT IN ANY GIVEN DIRECTION.
3. 5.5" TPO QUICKSEAM FLASHING SHALL EXTEND 2" (51 mm) BEYOND EDGE OF CURB FLASHING.
4. 9.5" TPO QUICKSEAM FLASHING SHALL EXTEND 2" (51 mm) BEYOND EDGE OF 5.5" TPO QUICKSEAM FLASHING.
5. FLANGE METAL MUST BE FULLY SUPPORTED BY WOOD AND TERMINATED AT LEAST 1/4" (6 mm) FROM EDGE OF WOOD.
6. REFER TO CUT UT-C-2 FOR OUTSIDE CORNER APPLICATION.

Firestone BUILDING PRODUCTS — NOBODY COVERS YOU BETTER.™ www.firestonepro.com
BASE TIE-IN AT WELDED WATERTIGHT CURB (FLANGES 2"-3") | ULTRAPLY™ TPO | ACCEPTABLE SYSTEMS: ALL
MAXIMUM WARRANTY: 20 YEARS | ISSUE / REVISION DATE: 7/01/2014 | NOT TO SCALE | DETAIL NO. UT-BT-13

B EQUIP. CURB DETAIL
NO SCALE

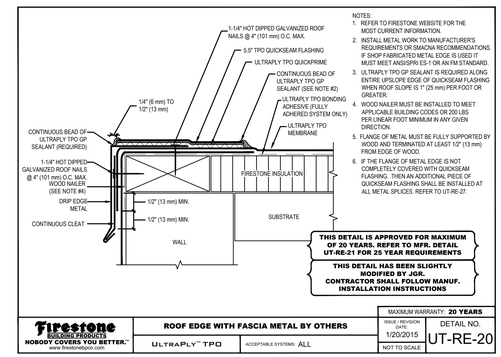

NOTES:
1. REFER TO FIRESTONE WEBSITE FOR THE MOST CURRENT INFORMATION.
2. INSTALL METAL WORK TO MANUFACTURER'S REQUIREMENTS OR SMACNA RECOMMENDATIONS. IF SHOP FABRICATED METAL EDGE IS USED IT MUST MEET ANSI/SPRI ES-1 OR AN FM STANDARD.
3. ULTRAPLY TPO GP SEALANT IS REQUIRED ALONG ENTIRE UPSLOPE EDGE OF QUICKSEAM FLASHING WHEN ROOF SLOPE IS 1" (25 mm) PER FOOT OR GREATER.
4. WOOD NAILER MUST BE INSTALLED TO MEET APPLICABLE BUILDING CODES OR 200 LBS PER LINEAR FOOT MINIMUM IN ANY GIVEN DIRECTION.
5. FLANGE OF METAL MUST BE FULLY SUPPORTED BY WOOD AND TERMINATED AT LEAST 12" (13 mm) FROM EDGE OF WOOD.
6. IF THE FLANGE OF METAL EDGE IS NOT COMPLETELY COVERED WITH QUICKSEAM FLASHING, THEN AN ADDITIONAL PIECE OF QUICKSEAM FLASHING SHALL BE INSTALLED AT ALL METAL SPLICES. REFER TO UT-RE-27.

Firestone BUILDING PRODUCTS — NOBODY COVERS YOU BETTER.™ www.firestonepro.com
ROOF EDGE WITH FASCIA METAL BY OTHERS | ULTRAPLY™ TPO | ACCEPTABLE SYSTEMS: ALL
MAXIMUM WARRANTY: 20 YEARS | ISSUE / REVISION DATE: 1/20/2015 | NOT TO SCALE | DETAIL NO. UT-RE-20

A ROOF EDGE DTL.
NO SCALE

FIRESTONE FULLY ADHERED TPO ROOFING STANDARD DETAILS

BASIS OF SPECIFICATION. ACTUAL FIELD AND SUBSTRATE CONDITIONS VARY-REFERENCE SPECIFICATIONS

JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386
1881 Main Street, Suite
Kansas City, MO 641
jgr@jgrarchitects.com

THE RESIDENCE AT RED CEDAR
NEW SENIOR-LIVING FACILITY
CORSICANA, TEXAS

REVISION:

DATE: 12-10-2024
JOB: 24-3392
SHEET NO.:
A5.2

COPYRIGHTED ©

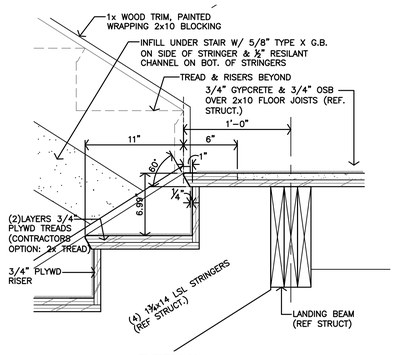

K DETAIL
1 1/2"=1'-0"

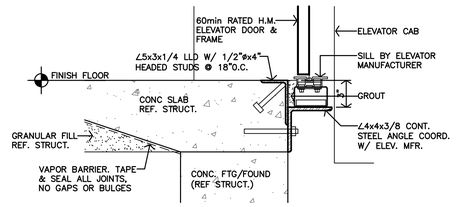

M ELEVATOR DETAIL
1 1/2"=1'-0"

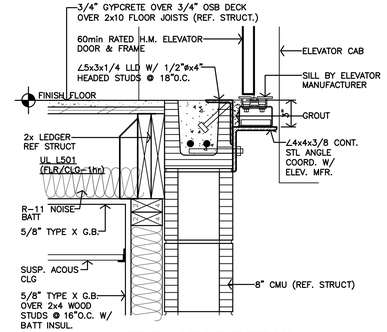

L ELEVATOR DETAIL
1 1/2"=1'-0"

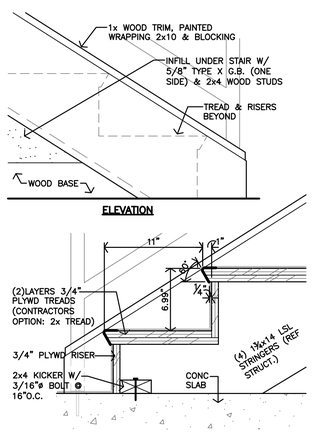

J DETAIL
1 1/2"=1'-0"

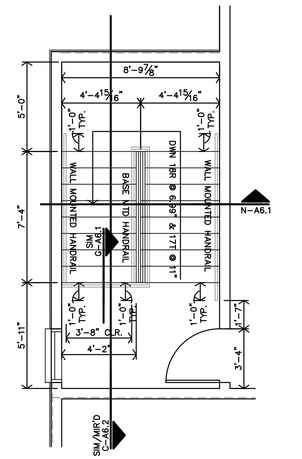

F STAIR S2 3RD FLOOR PLAN
1/4"=1'-0" 3RD FLOOR SIM

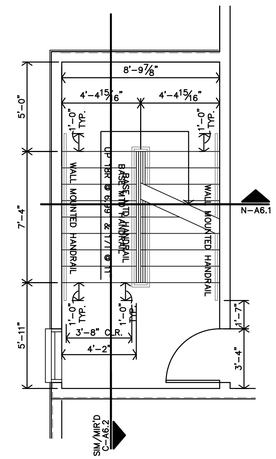

E STAIR S2 2ND FLOOR PLAN
1/4"=1'-0"

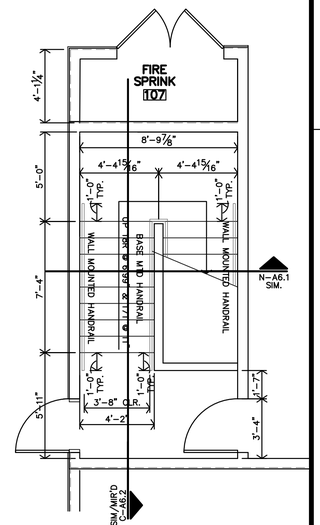

D STAIR S2 1ST FLOOR PLAN
1/4"=1'-0"

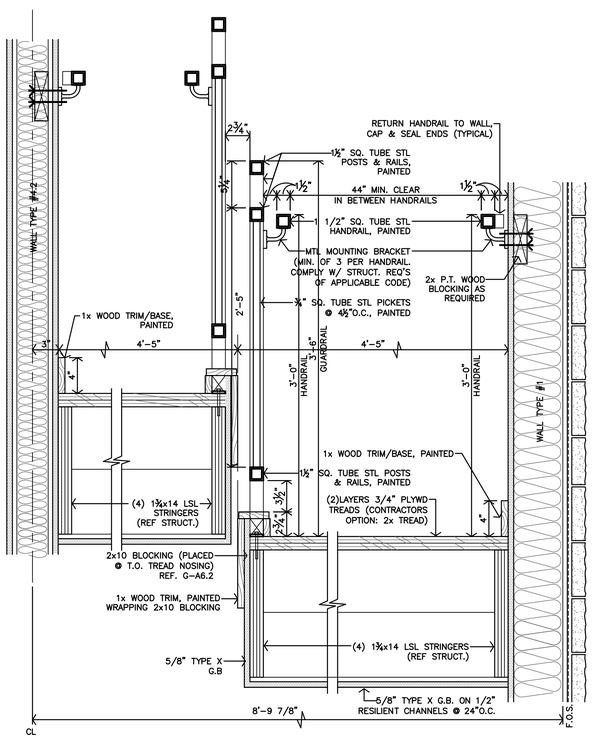

H DETAIL
1 1/2"=1'-0"

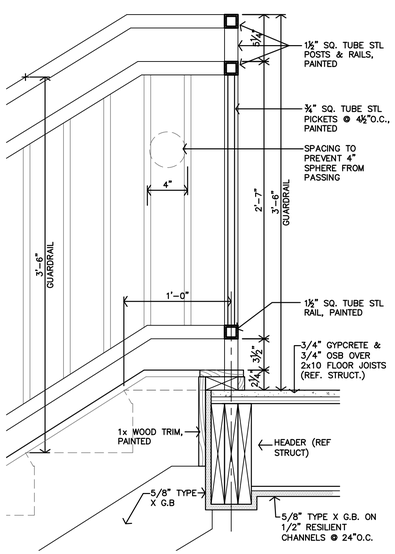

G STAIR RAILING DETAIL
1 1/2"=1'-0"

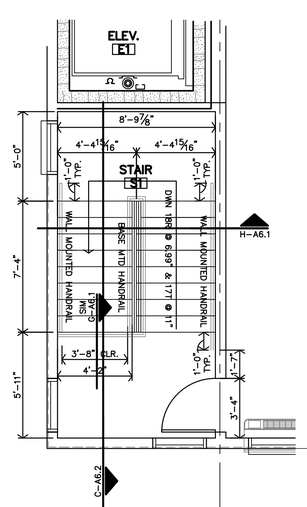

C STAIR S1 3RD FLOOR PLAN
1/4"=1'-0"

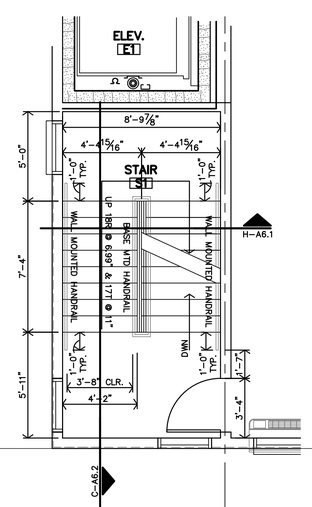

B STAIR S1 2ND FLOOR PLAN
1/4"=1'-0"

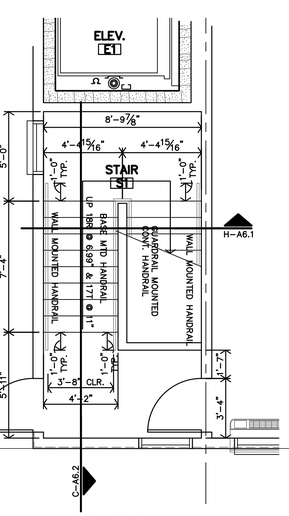

A STAIR S1 FIRST FLOOR PLAN
1/4"=1'-0"

JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386
1881 Main Street, Suite 301
Kansas City, MO 64108
jgr@jgrarchitects.com

THE RESIDENCE AT RED CEDAR

NEW SENIOR-LIVING FACILITY

CORSICANA, TEXAS

REVISION:

DATE: 12-10-2024
JOB: 24-3392
SHEET NO.:

A6.1

COPYRIGHTED ©

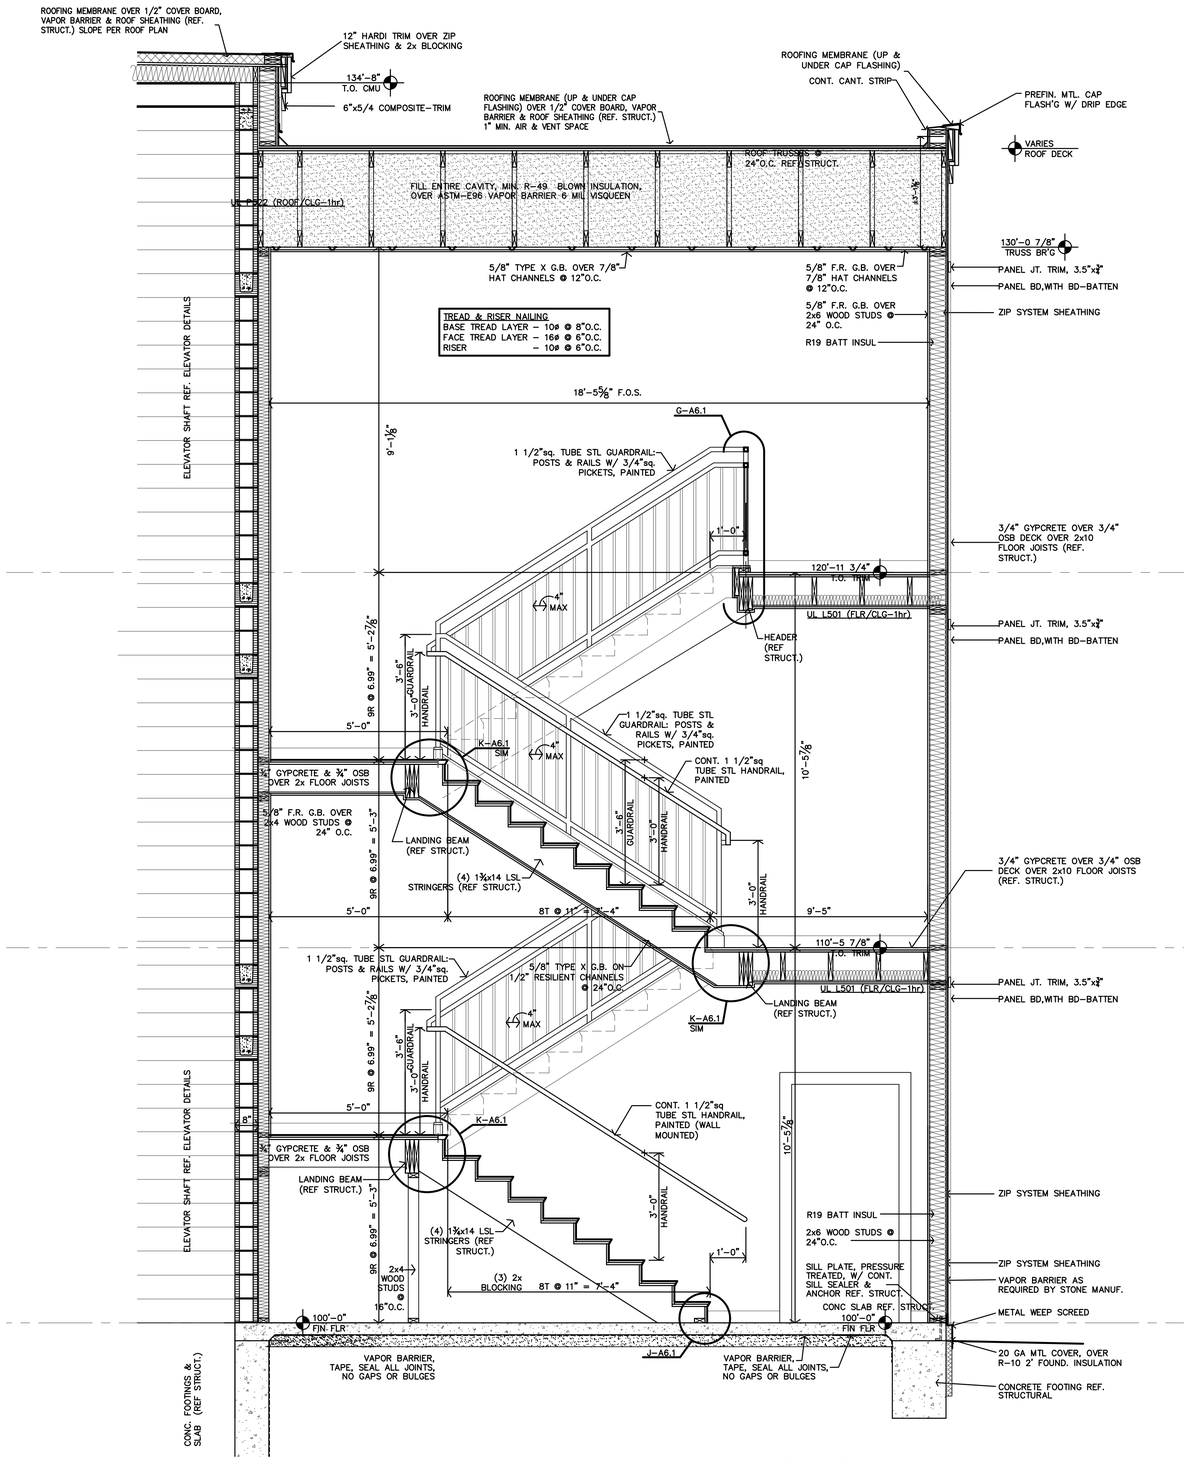

C STAIR S1 SECTION

1/2"=1'-0" STAIR 2 SIMILAR

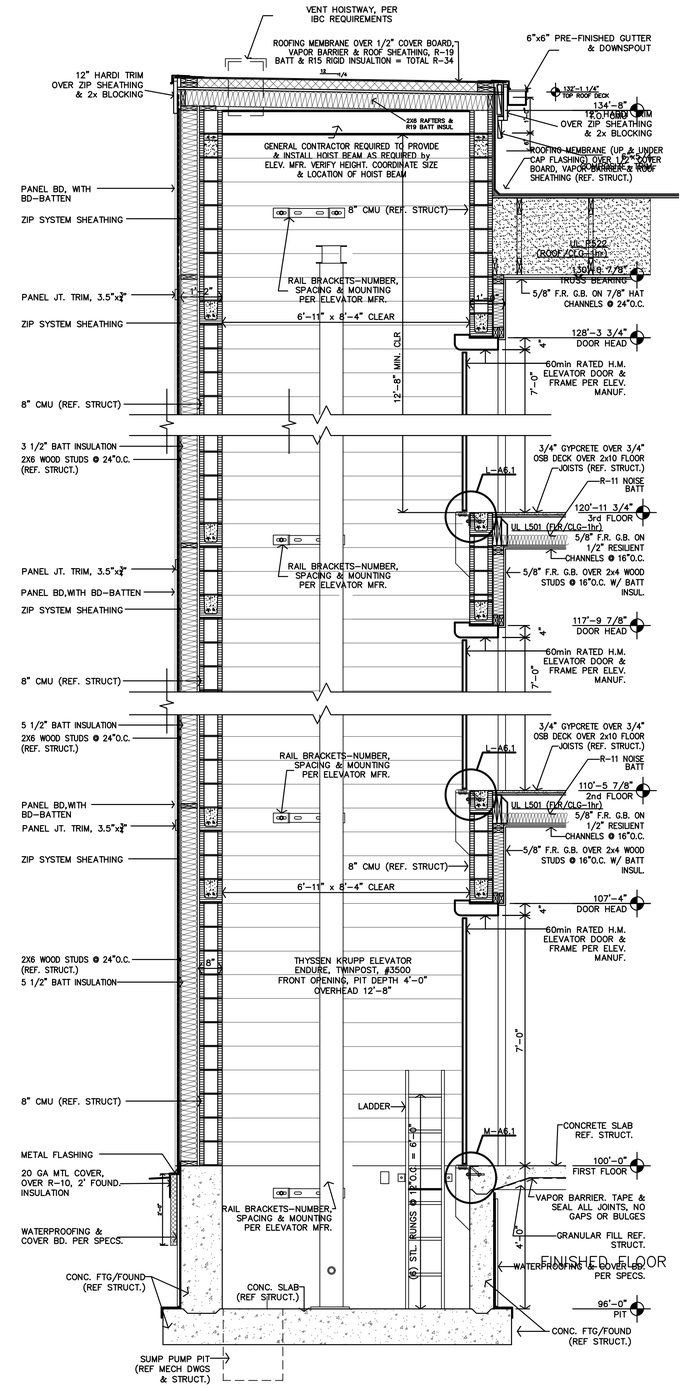

B ELEVATOR SECTION

1/2"=1'-0"

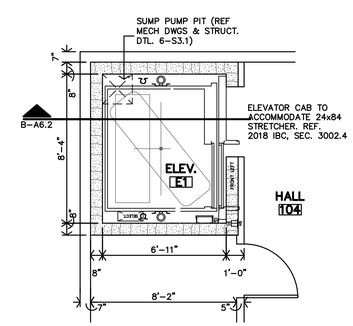

HYDRAULIC ELEVATOR CONTRACT DATA

TYPE: Hydraulic MRL, Type Elevat

SPEED: FPM UP MAX 150 FPM DOWN MAX. CAPACITY: 3000

OPERATION:

DOOR TYPE: ONE SPEED - LEFT HAND

PLATFORM TWO: 0.8

BOTTOM CAR RUNBY: 6"

BETWEEN PIT FLR. & CAR BOLSTER ON COMPRESSED BUFFER: 2'-3 1/8"

A ELEVATOR 1st, 2nd & 3rd FLOORS

1/4"=1'-0"

JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386
1881 Main Street, Suite 301
Kansas City, MO 64108
jgr@jgrarchitects.com

THE RESIDENCE AT RED CEDAR

NEW SENIOR-LIVING FACILITY

CORSICANA, TEXAS

REVISION:

DATE: 12-10-2024

JOB: 24-3392

SHEET NO.:

A6.2

COPYRIGHTED ©

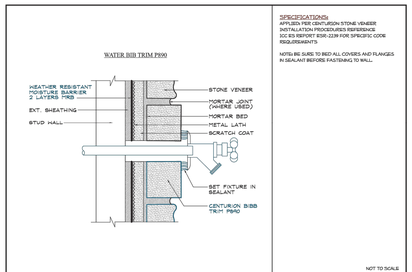

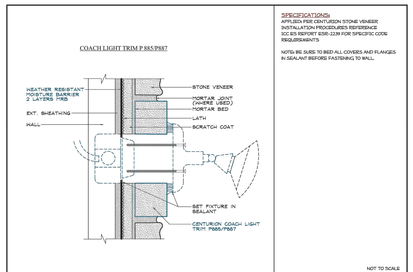

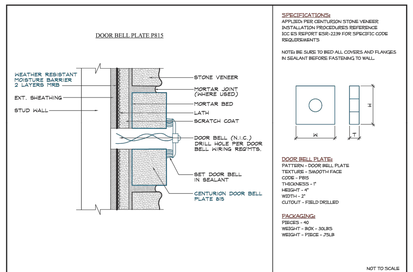

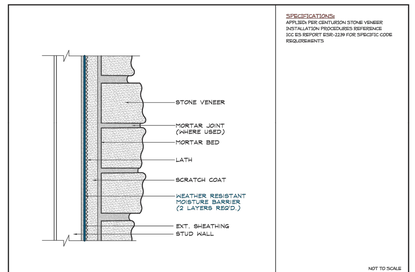

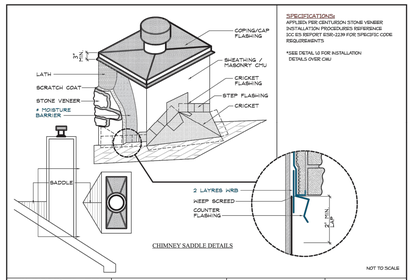

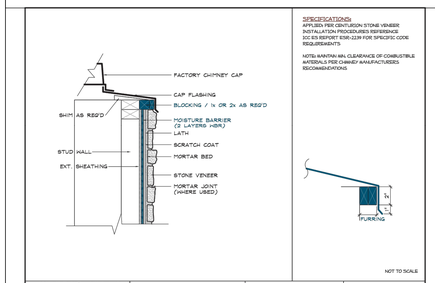

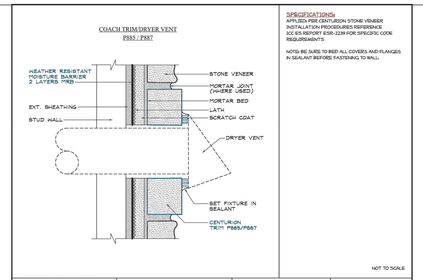

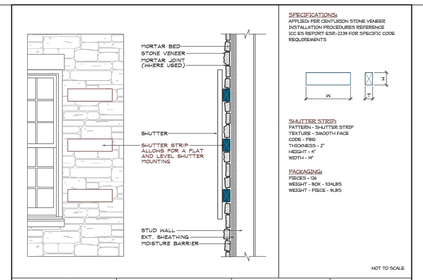

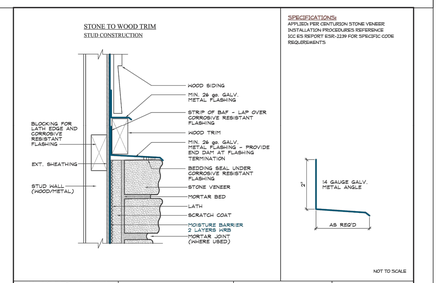

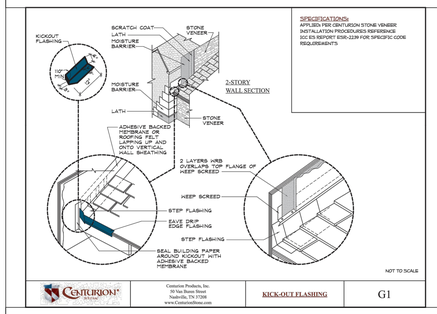

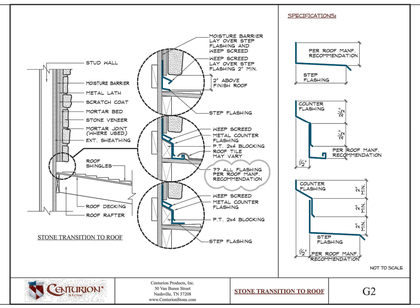

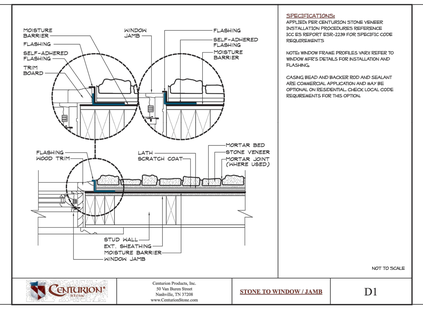

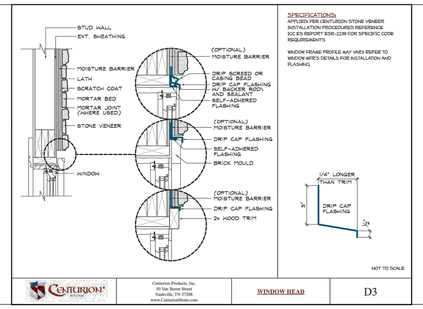

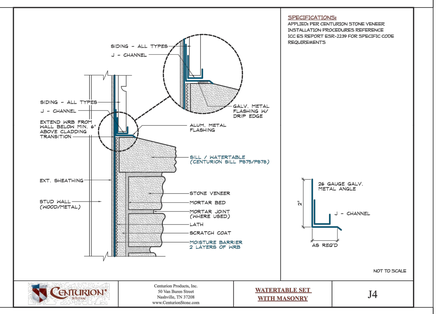

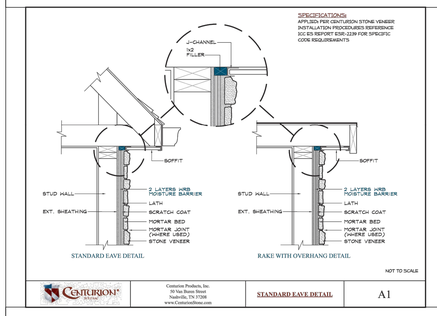

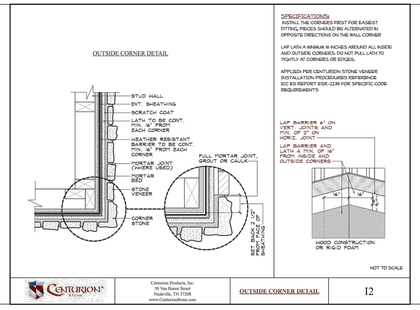

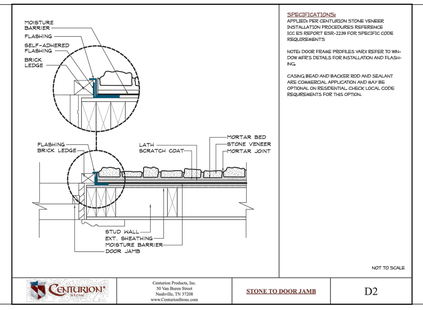

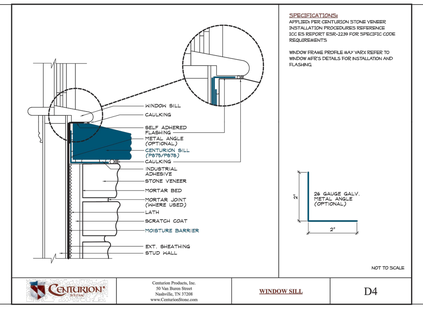

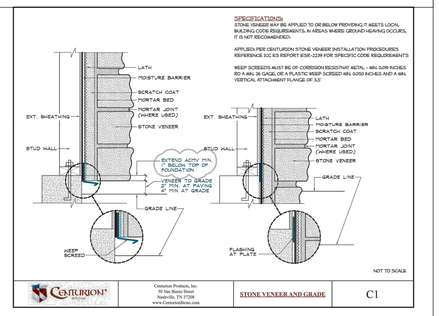

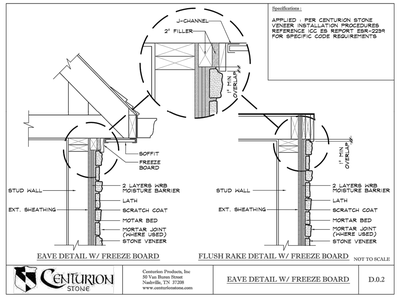

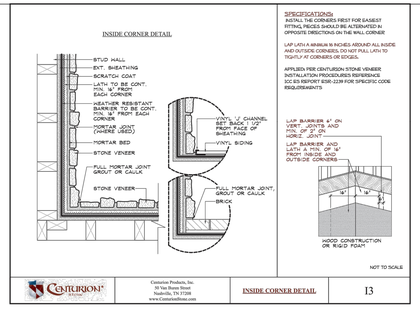

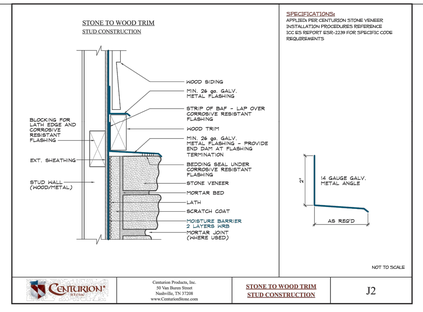

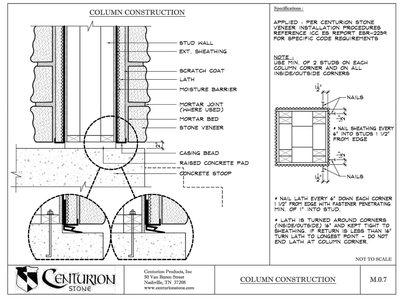

MANUFACTURED STONE

Manufacturers Installation Details,
Contractor to install as indicated
Actual Conditions May Vary

DETAILS ARE NOT TO SCALE

JonesGillamRenz
730 N. Ninth, 1881 Main Street, Suite 301
Salina, KS 67401 Kansas City, MO 64108
785.827.0386 jgr@jgrarchitects.com

THE RESIDENCE AT GREEN MEADOW

NEW SENIOR-LIVING FACILITY

SAN ANGELO, TEXAS

REVISION:

DATE: 10-3-2024
JOB: 24-3395
SHEET NO.:

A6.3

COPYRIGHTED ©

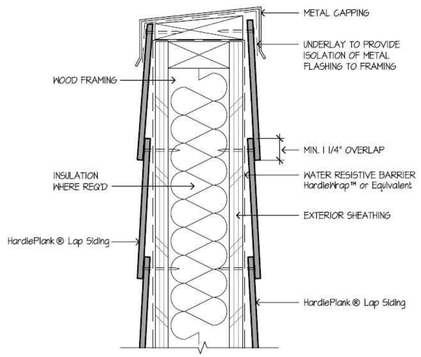

9 PARAPET

SCALE: 3"=1'-0"

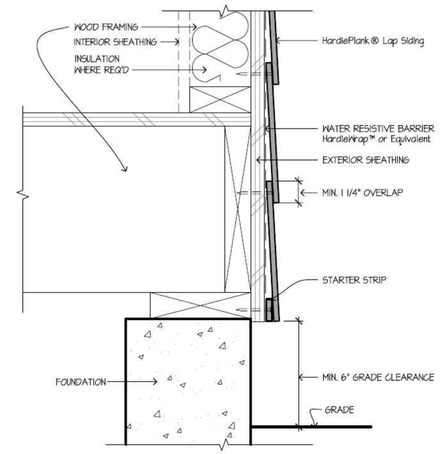

6 GRADE CLEARANCE

SCALE: 3"=1'-0"

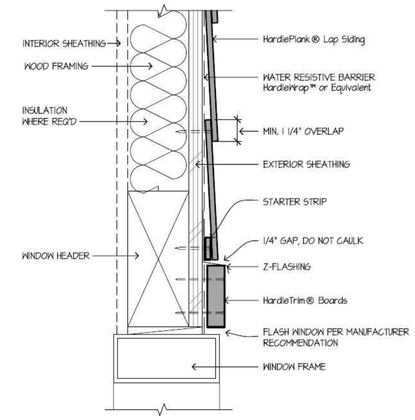

3 WINDOW/DOOR HEAD

SCALE: 3"=1'-0"

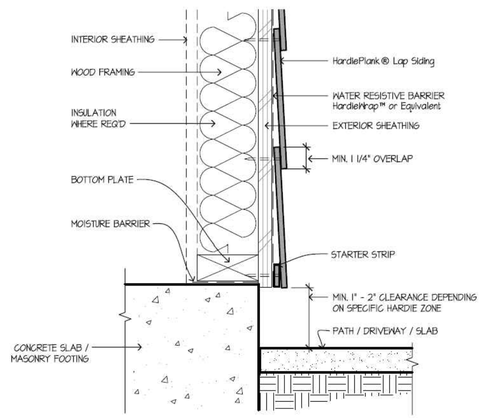

8 HARDSCAPE CLEARANCES, DECKS, PORCHES, PATIOS, WALKWAYS, ROOFS, ETC.

SCALE: 1/2"=1'-0"

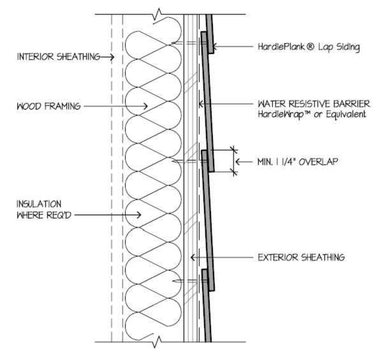

5 HORIZONTAL LAP VIEW

SCALE: 3"=1'-0"

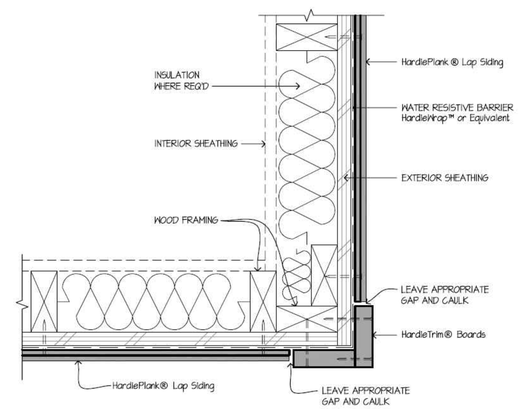

2 OUTSIDE CORNER

SCALE: 3"=1'-0"

HARDIE LAP SIDING

Manufacturers Installation Details,
Contractor to install as indicated
Actual Conditions May Vary

DETAILS ARE NOT TO SCALE

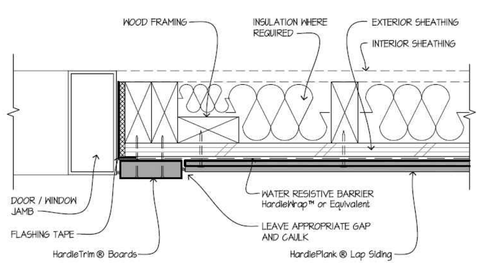

10 DOOR / WINDOW JAMB

SCALE: 3"=1'-0"

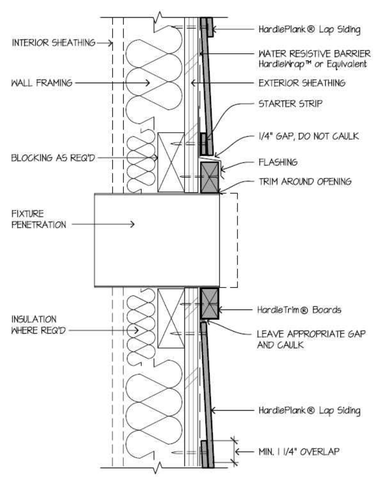

7 FIXTURE PENETRATION

SCALE: 3"=1'-0"

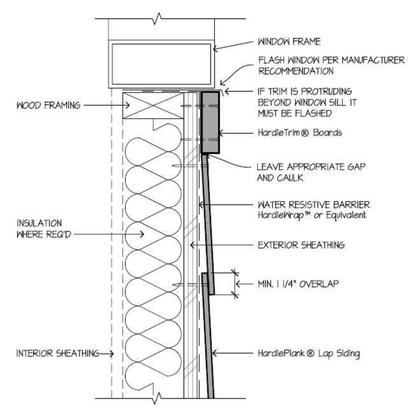

4 WINDOW SILL

SCALE: 3"=1'-0"

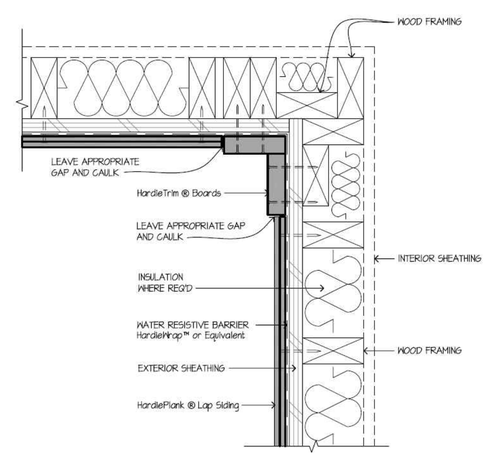

1 INSIDE CORNER

SCALE: 3"=1'-0"

JonesGillamRenz
730 N. Ninth 1881 Main Street, Suite 301
Salina, KS 67401 Kansas City, MO 64108
785.827.0386 jgr@jgrarchitects.com

THE RESIDENCE AT GREEN MEADOW

NEW SENIOR-LIVING FACILITY

SAN ANGELO, TEXAS

REVISION:

DATE: 10-3-2024
JOB: 24-3395
SHEET NO.:

A6.4

COPYRIGHTED ©

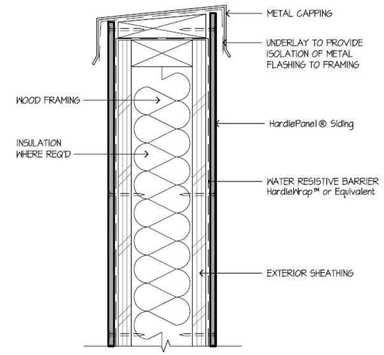

9 PARAPET

SCALE: 3"=1'-0"

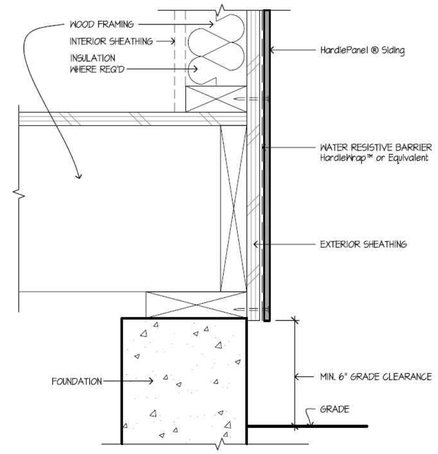

6 GRADE CLEARANCE

SCALE: 3"=1'-0"

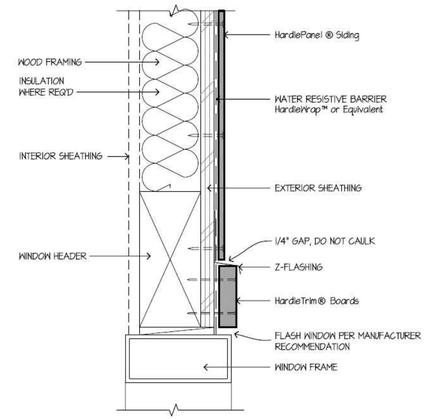

3 WINDOW/DOOR HEAD

SCALE: 3"=1'-0"

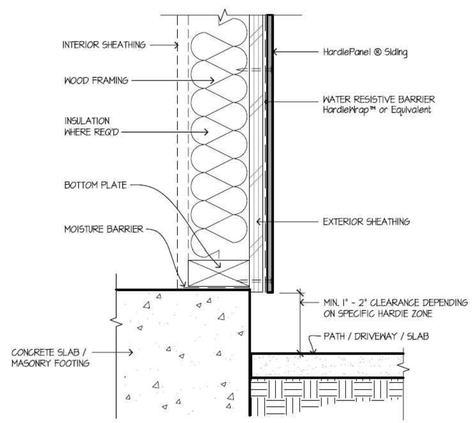

8 HARDSCAPE CLEARANCES, DECKS, PORCHES, PATIOS, WALKWAYS, ROOFS, ETC.

SCALE: 1/2"=1'-0"

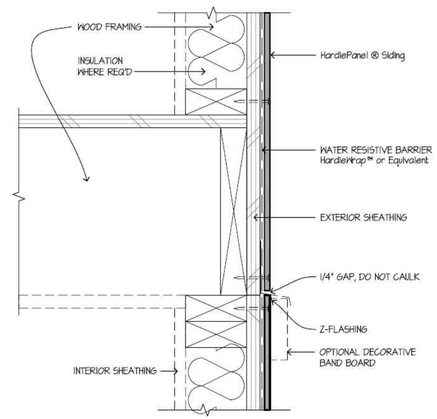

5 HORIZONTAL VIEW

SCALE: 3"=1'-0"

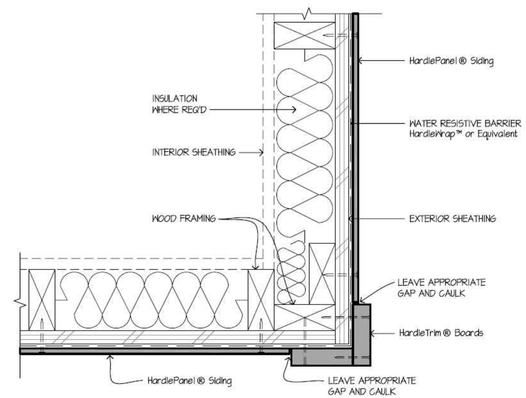

2 OUTSIDE CORNER

SCALE: 3"=1'-0"

HARDIE PANEL SIDING

Manufacturers Installation Details,
Contractor to install as indicated
Actual Conditions May Vary

DETAILS ARE NOT TO SCALE

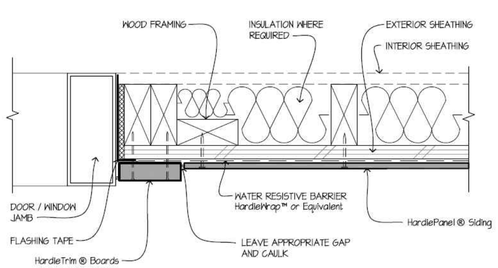

10 DOOR / WINDOW JAMB

SCALE: 3"=1'-0"

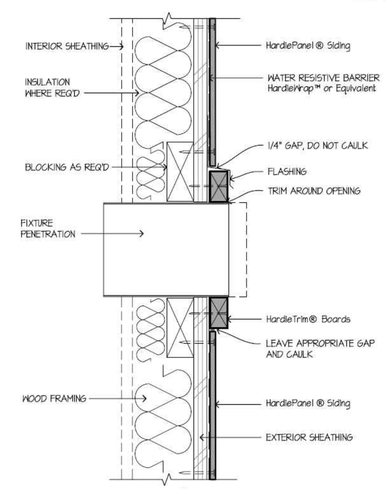

7 FIXTURE PENETRATION

SCALE: 3"=1'-0"

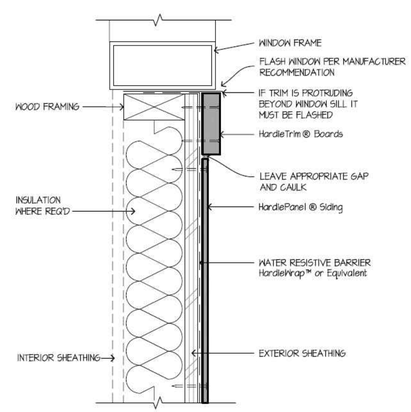

4 WINDOW SILL

SCALE: 3"=1'-0"

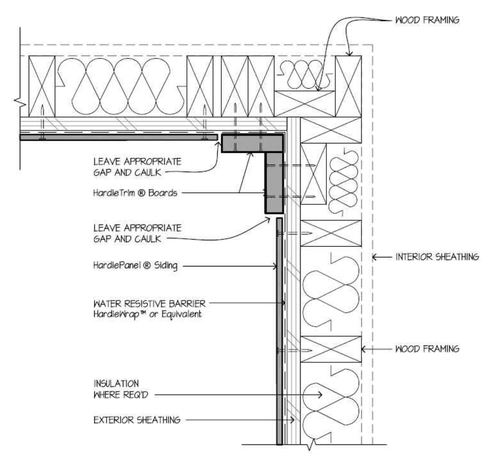

1 INSIDE CORNER

SCALE: 3"=1'-0"

JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386
1881 Main Street, Suite 301
Kansas City, MO 64108
jgr@jgrarchitects.com

THE RESIDENCE AT RED CEDAR

NEW SENIOR-LIVING FACILITY

CORSICANA, TEXAS

REVISION:

DATE: 12-10-2024
JOB: 24-3392
SHEET NO.:

A6.5

COPYRIGHTED ©

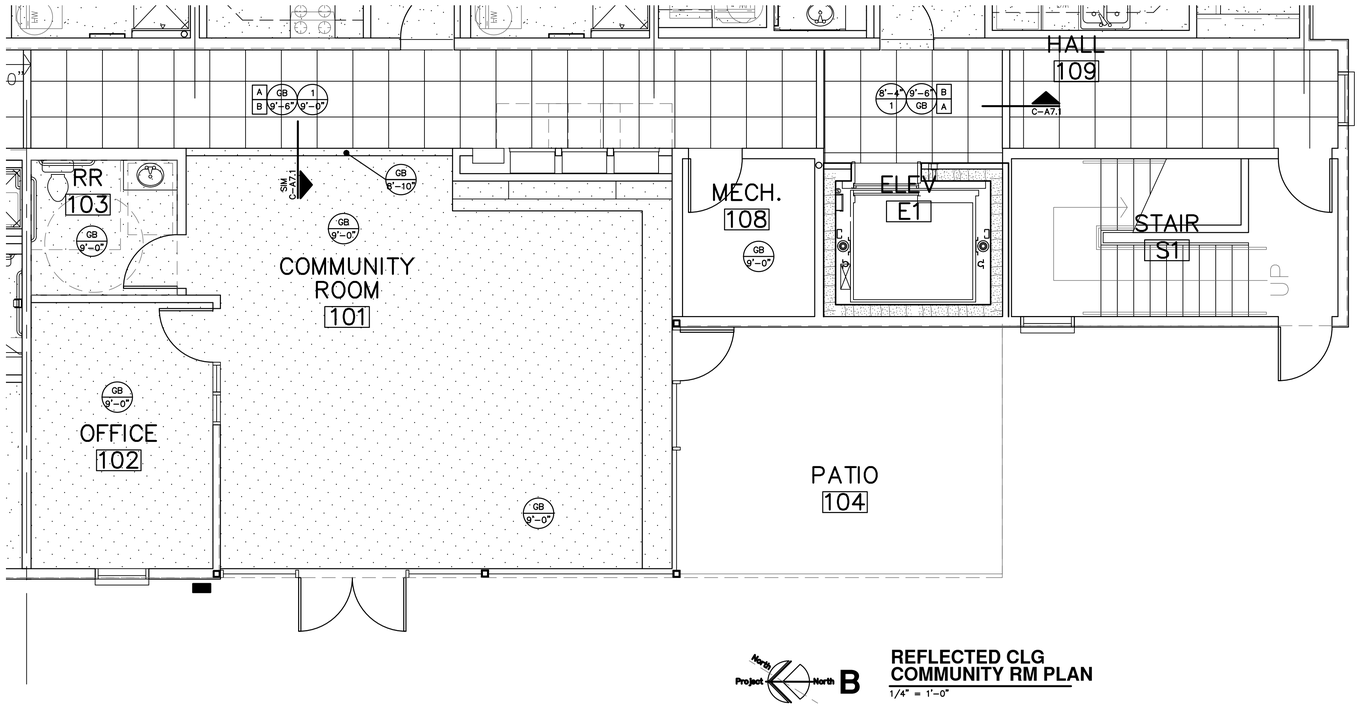

Project North — North **B**

REFLECTED CLG COMMUNITY RM PLAN

1/4" = 1'-0"

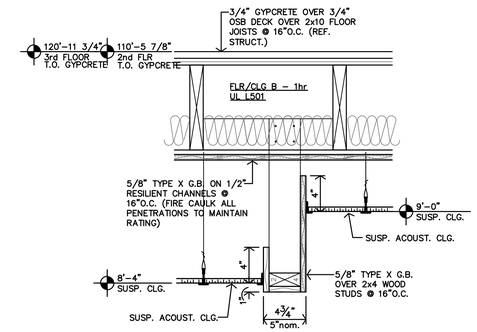

C **CEILING DETAIL**

1 1/2"=1'-0"

REFLECTED CEILING PLAN NOTES

1. CONTRACTOR SHALL COORDINATE CEILING LAYOUT WITH MECHANICAL AND ELECTRICAL FIXTURE LOCATIONS. NOTIFY ARCHITECT IMMEDIATELY OF ANY CONFLICT OR DISCREPANCY.
2. MECHANICAL/ELECTRICAL FIXTURES @ RATED CEILINGS SHALL BE HUNG IN CONFORMANCE TO U.L. SYSTEM REQUIREMENTS.
3. CEILING MOUNTED MECHANICAL EQUIPMENT AND SUSPENDED MECHANICAL EQUIPMENT MUST BE SUSPENDED DIRECTLY FROM THE STRUCTURE.
4. WHERE SUSPENSION DEVICES, WIRES, RODS, ETC. PENETRATE CEILING GRID AND/OR TILE OR G.B. PENETRATIONS SHALL BE NEAT AND CLEANLY CUT. PENETRATION OPENING SHALL BE AS SMALL AS POSSIBLE. SEAL AT G.B.

NON-RATED WALLS
– EXTEND TO BOTTOM OF FLOOR TRUSSES
1 HOUR LOAD BEARING WALLS
– EXTEND TO DECK
1/2 HOUR FIRE PARTITION; CORRIDOR
1 HOUR CONSTRUCTION; SHAFT WALLS
1 HOUR FIRE PARTITION; BETWEEN DWELLING UNITS

SEAL VOIDS AT TOPS OF WALLS AND PENETRATIONS WITH U.L. LISTED FIRE BATT INSULATION, PILLOWS, AND/OR FIRE SEALANT AS REQUIRED BY CONDITION. AT RATED WALLS.

KEY NOTES

- A — FIRE RATED G.B. CEILING at BOT. OF FRAMING TO BE CONTINUOUS
- B — VALVES TO INSTALLED ABOVE SUSPENDED CEILING
- C — ATTIC ACCESS. MIN. 20"x30". COORDINATE LOCATION WITH ROOF TRUSSES. REF. DTL. D-A4.4
- D — ROOF HATCH AND LADDER, PER SPEC. COORDINATE LOCATION WITH ROOF TRUSSES.

CEILING TYPES
REFER SPECIFICATIONS

1	2x2 NON-RATED
2	2x2 NON-RATED, WASHABLE
ST	EXPOSED STRUCTURE,
GB	GYP BD (PAINTED)

1 / 8'-8" — CLG. TYPE / CLG. HEIGHT

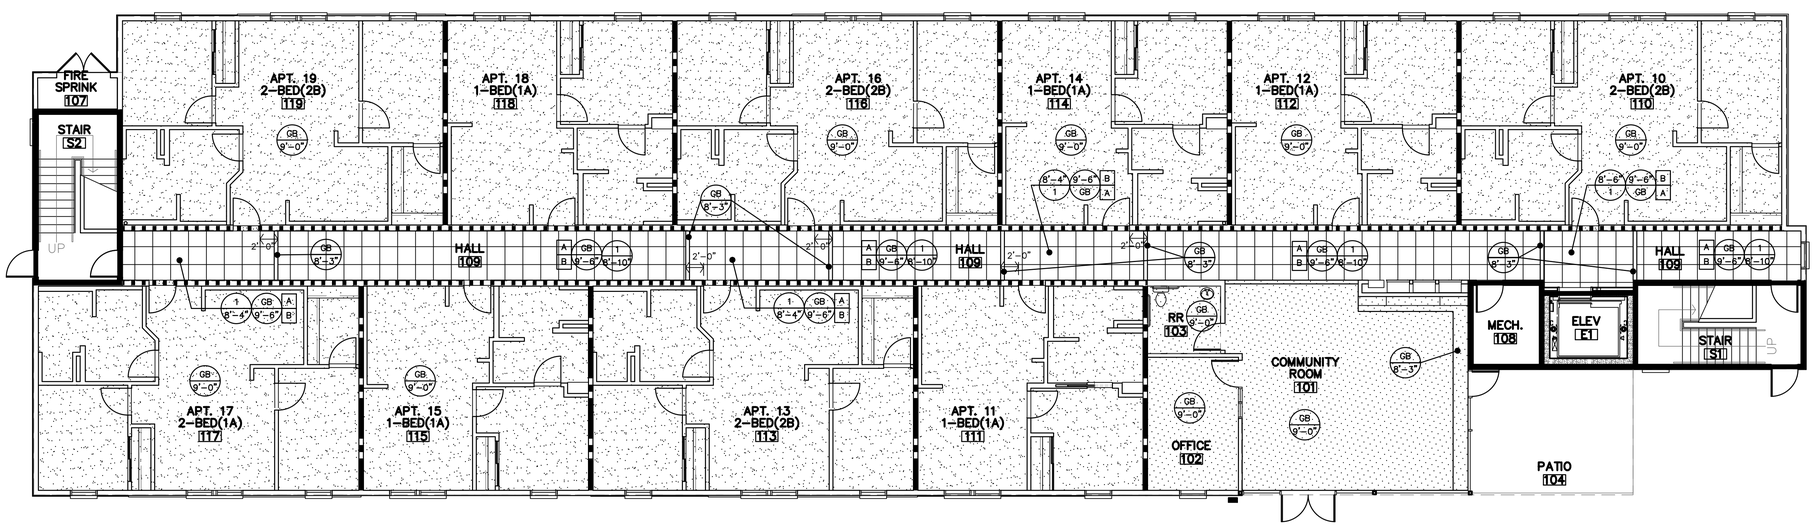

Project North — North **A**

REFLECTIVE CEILING FIRST FLOOR PLAN

1/8"=1'-0"

JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386
1881 Main Street, Suite 3
Kansas City, MO 64108
jgr@jgrarchitects.com

THE RESIDENCE AT RED CEDAR

NEW SENIOR-LIVING FACILITY

CORSICANA, TEXAS

REVISION:

DATE: 12-10-2024
JOB: 24-3392
SHEET NO.:

A7.1

COPYRIGHTED ©

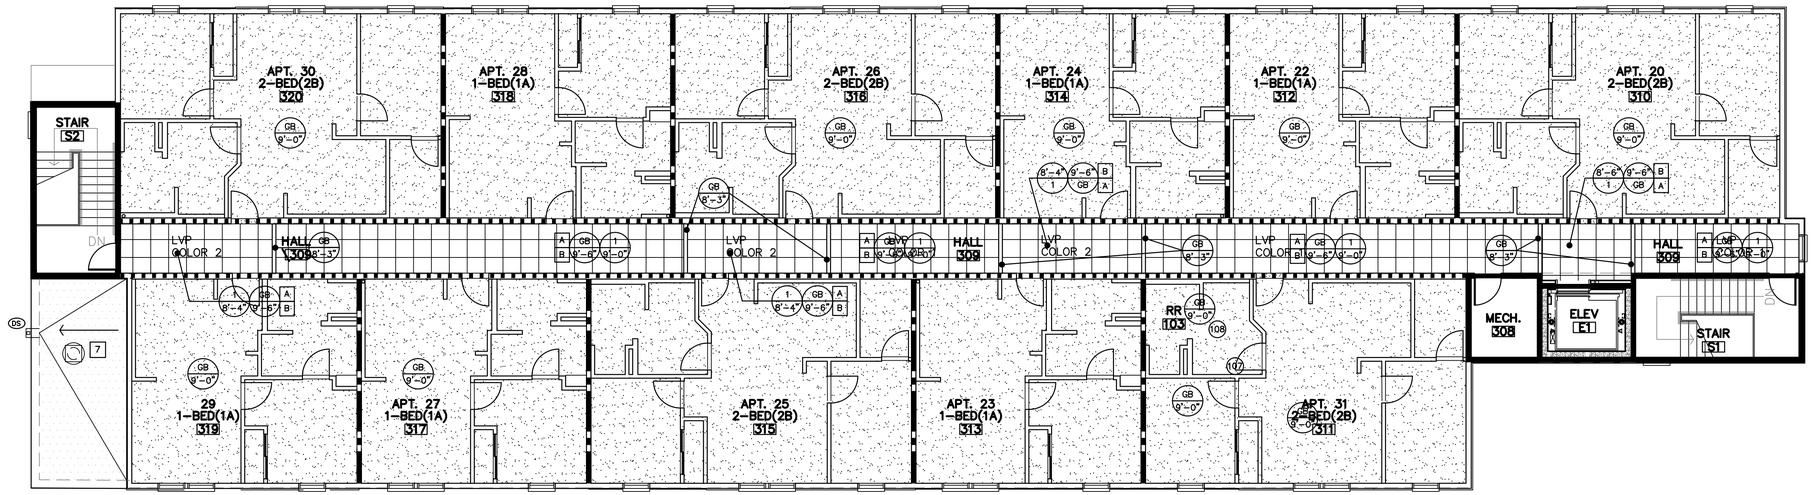

B

REFLECTED CEILING THIRD FLOOR PLAN

1/8"=1'-0"

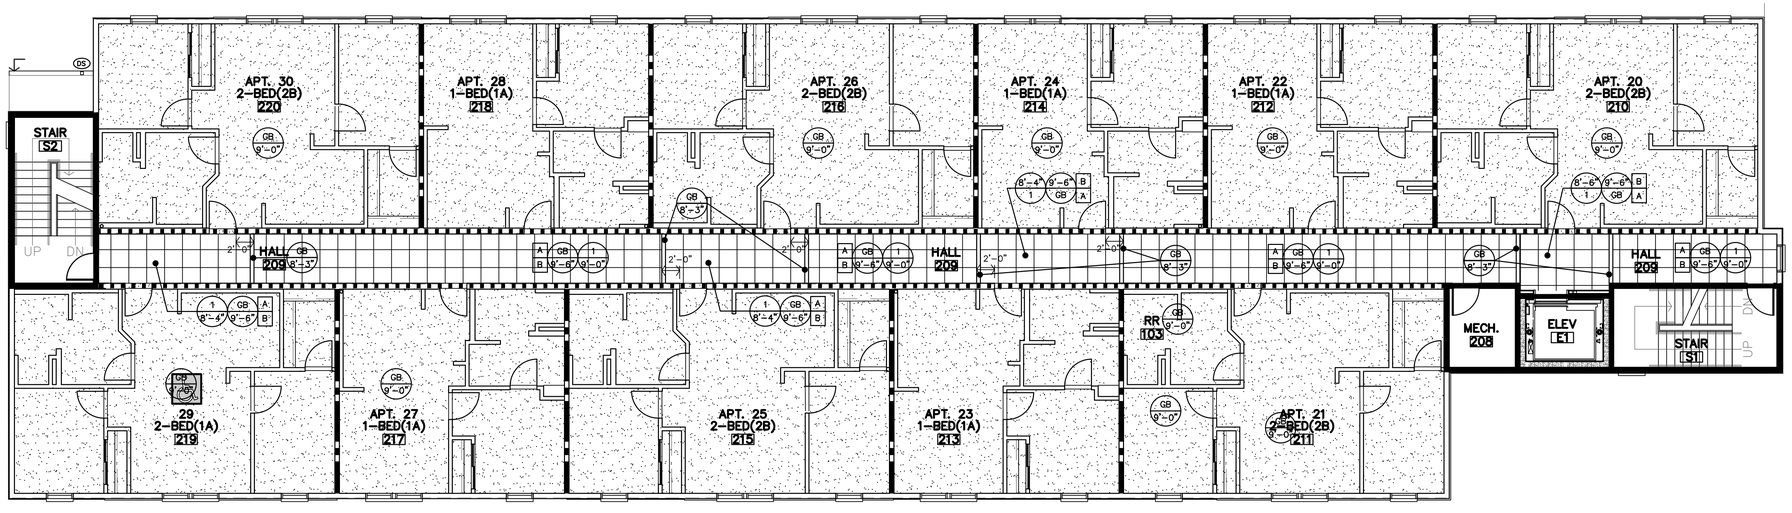

A

REFLECTED CEILING SECOND FLOOR PLAN

1/8"=1'-0"

JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386
1881 Main Street, Suite 3
Kansas City, MO 64108
jgr@jgrarchitects.com

THE RESIDENCE AT RED CEDAR

NEW SENIOR-LIVING FACILITY

CORSICANA, TEXAS

REVISION:

DATE: 12-10-2024

JOB: 24-3392

SHEET NO.:

A7.2

COPYRIGHTED ©

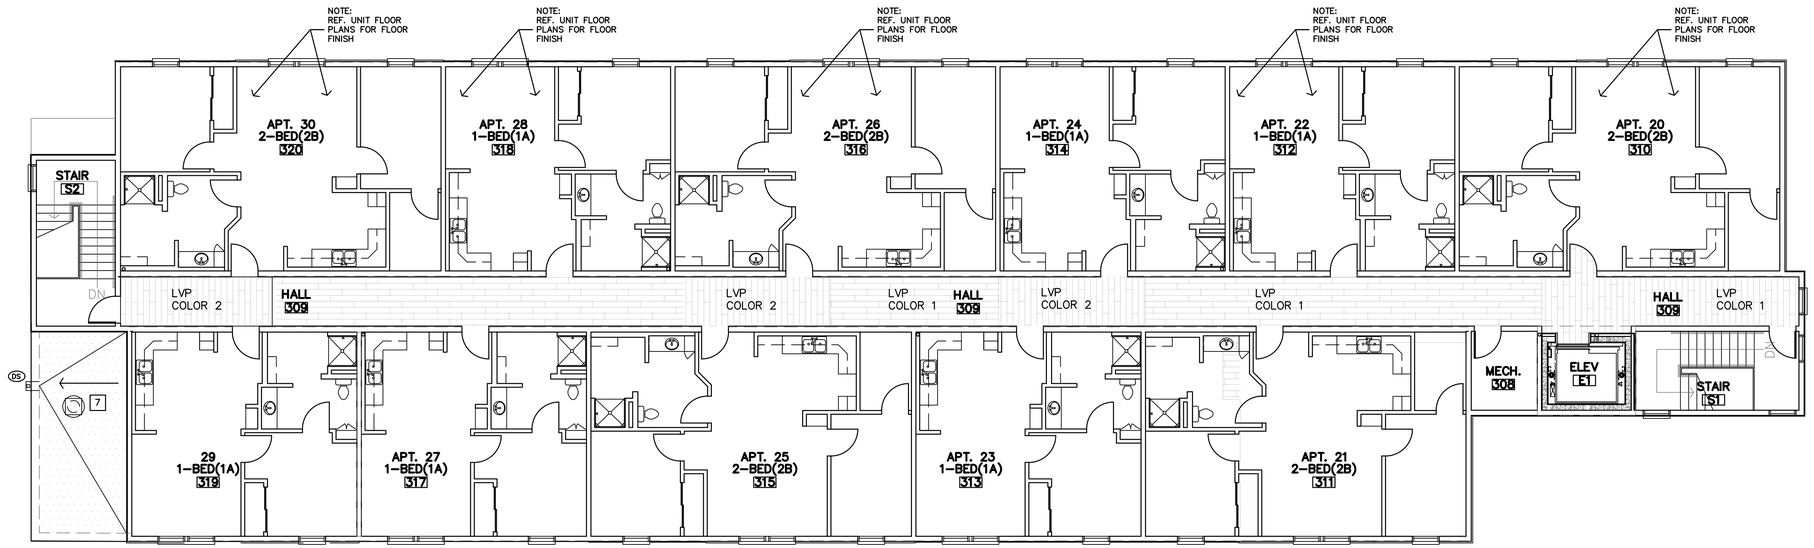

North Project North B

REFLECTED CEILING SECOND & THIRD FLOOR PLAN

1/8"=1'-0"

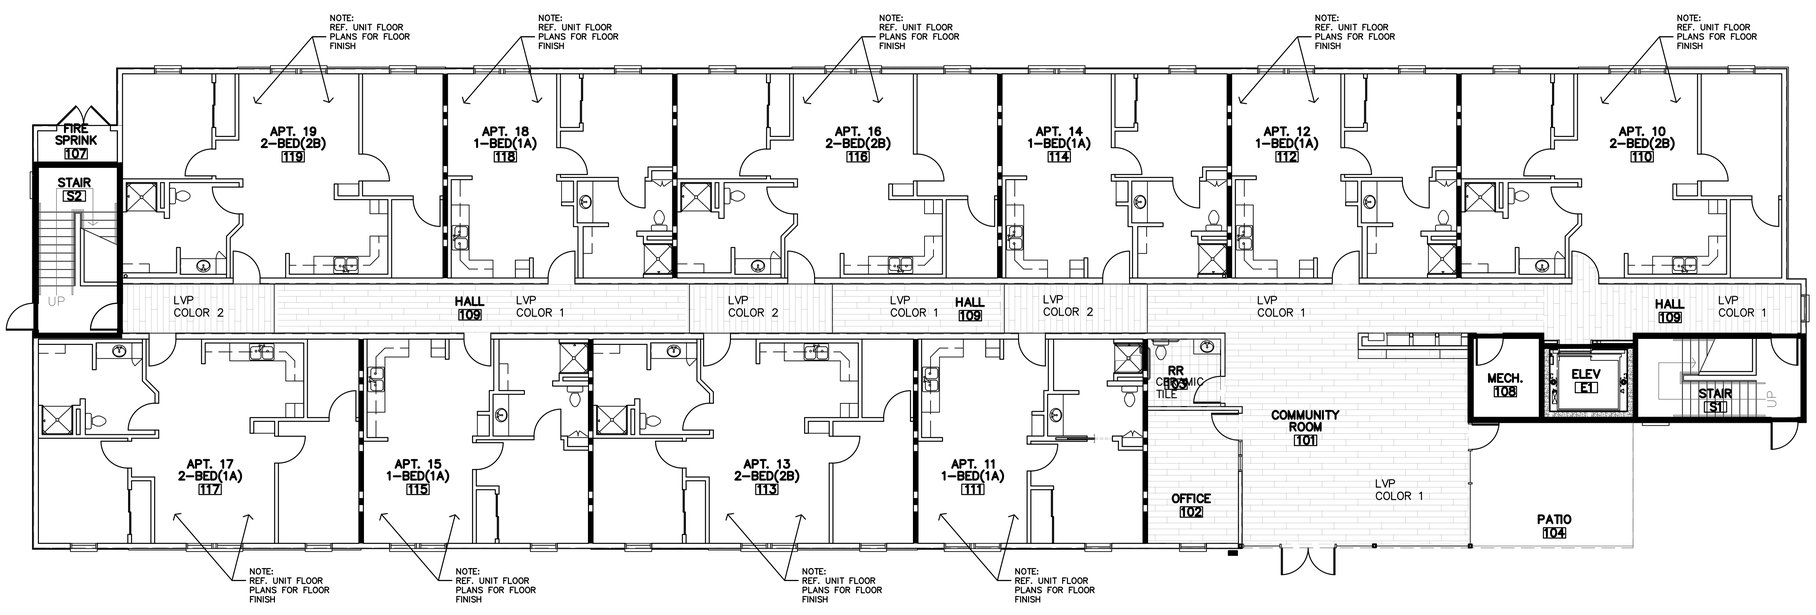

North Project North A

FINISHES FIRST FLOOR PLAN

1/8"=1'-0"

JonesGillamRenz
730 N. Ninth 1881 Main Street, Suite 3
Salina, KS 67401 Kansas City, MO 6410
785.827.0386 jgr@jgrarchitects.com

THE RESIDENCE AT RED CEDAR

NEW SENIOR-LIVING FACILITY

CORSICANA, TEXAS

REVISION:

DATE: 12-10-2024

JOB: 24-3392

SHEET NO.:

A9.1

COPYRIGHTED ©

D HALLS 209 & 309 SOUTH INTERIOR ELEVATION

1/8"=1'-0"

C HALLS 209 & 309 NORTH INTERIOR ELEVATION

1/8"=1'-0"

B HALL #109, SOUTH INTERIOR ELEVATION

1/8"=1'-0"

A HALL #109, WEST INTERIOR ELEVATION

1/8"=1'-0"

NOTE:
1. G.B. CONTROL JOINT @ 30'-0"
2. C.J. = CONTROL JOINT

JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386
1881 Main Street, Suite
Kansas City, MO 641
jgr@jgrarchitects.com

THE RESIDENCE AT RED CEDAR

NEW SENIOR-LIVING FACILITY

CORSICANA, TEXAS

REVISION:

DATE: 12-10-2024
JOB: 24-3392
SHEET NO.:

A9.3

COPYRIGHTED ©

PUBLIC DOOR SCHEDULE

MARK	DOOR SIZE W	DOOR SIZE H	DOOR SIZE T	DOOR MATERIAL ALUMINUM	DOOR MATERIAL HOLLOW METAL	DOOR MATERIAL S.C. WOOD	DOOR TYPE TYPE	DOOR FINISH PREFINISHED	DOOR FINISH PAINT-STAIN	FRAME MATERIAL ALUMINUM	FRAME MATERIAL HOLLOW METAL	FRAME TYPE TYPE	FRAME FINISH PREFINISHED	FRAME FINISH PAINT	RATING	DETAILS	REMARKS/NOTES
FIRST FLOOR																	
101	3'-0"	7'-0"	1 3/4"	●			E	●		●		2	●			A/B/C/D/E-A10.2	2,4,5
102	3'-0"	7'-0"	1 3/4"		●		E		●		●	1		●		F/G/H-A10.2	2,4,
103	3'-0"	6'-8"	1 3/4"			●	D		●		●	1		●	60min	Q/R-A10.2	3
104	3'-0"	7'-0"	1 3/4"	●			E	●		●		3	●			A/B/C/D/E-A10.2	2,4,
105	3'-0"	6'-8"	1 3/4"			●	D		●		●	1		●	60min	Q/R-A10.2	3
106	3'-0"	7'-0"	1 3/4"		●		E		●		●	1		●		F/G/H-A10.2	2,4,
107	3'-0"	7'-0"	1 3/4"			●	F		●		●	4		●	20min	J/K-A10.2	3
108	3'-0"	7'-0"	1 3/4"			●	H		●		●	1		●	20min	J/K-A10.2	3
110	3'-0"	6'-8"	1 3/4"			●	J		●		●	1		●	20min	Q/R-A10.2	3
114	PR3'-0"	7'-0"	1 3/4"		●		H		●		●	1		●		F/G/H-A10.2	
SECOND FLOOR																	
203	3'-0"	7'-0"	1 3/4"			●	D		●		●	1		●	60min	Q/R-A10.2	3
205	3'-0"	6'-8"	1 3/4"			●	D		●		●	1		●	60min	Q/R-A10.2	3
210	3'-0"	6'-8"	1 3/4"			●	J		●		●	1		●	20min	Q/R-A10.2	3
THIRD FLOOR																	
303	3'-0"	7'-0"	1 3/4"			●	D		●		●	1		●	60min	Q/R-A10.2	3
305	3'-0"	6'-8"	1 3/4"			●	D		●		●	1		●	60min	Q/R-A10.2	3
310	3'-0"	6'-8"	1 3/4"			●	J		●		●	1		●	20min	Q/R-A10.2	3
ELEVATOR																	
E1	3'-6"	7'-0"													60min		REF. SHT. A6.4
E2	3'-6"	7'-0"													60min		REF. SHT. A6.4
E3	3'-6"	7'-0"													60min		REF. SHT. A6.4

GENERAL NOTES:
1. ALL EXPOSED LINTELS TO BE PAINTED AT INTERIOR AND EXTERIOR.

SPECIFIC NOTES:
1. PROVIDE MAGNETIC HOLD-OPEN DEVICES FOR EACH DOOR.
2. DOOR(S) TO BE PROVIDED WITH PANIC HARDWARE AND DEVICES
3. PROVIDE SMOKE GASKET
4. CONTRACTOR MUST INSTALL MTL. FLASHINGS & CONT. CAULK FOR WEATHER & WATERTIGHT CONDITIONS ● ALL EXTERIOR DOORS & DOOR FRAMES/UNITS
5. PROVIDE AUTOMATIC DOOR OPENER BUTTON (AND ASSOCIATED HARDWARE) ON ADJACENT WALL.

UNIT DOOR SCHEDULE - 30 UNITS - REF. SHEET A2.3

MARK	DOOR SIZE W	DOOR SIZE H	DOOR SIZE T	DOOR MATERIAL S.C. WOOD, PANEL	DOOR MATERIAL H.C. WOOD, PANEL	DOOR MATERIAL H.C. WOOD, LOUVER	DOOR TYPE TYPE	DOOR TYPE BI-FOLD	DOOR TYPE BI-PASS	DOOR TYPE POCKET	DOOR FINISH PREFINISHED	DOOR FINISH PAINT	FRAME MATERIAL WOOD	FRAME MATERIAL METAL	FRAME TYPE TYPE	FRAME FINISH PAINT	RATING	DETAILS	REMARKS	LOCATION
1	3'-0"	6'-8"	1 3/4"	●			A				●			●	1	●	20min	Q/R-A10.2	2, 3, 4	ENTRY
2	3'-0"	6'-8"	1 3/4"		●		B					●	●		1	●		S/T-A10.2	1	BEDROOM
3	3'-0"	6'-8"	1 3/4"		●		B			●		●	●		1	●		S/T-A10.2 SIM	5	BATH
4	3'-0"	6'-8"	1 3/4"		●		B					●	●		1	●		S/T-A10.2	1	BATH
5	3'-0"	6'-8"	1 3/4"		●		B					●	●		1	●		S/T-A10.2	5	CLOSET
6	(2)2'-6"	6'-8"	1 3/4"		●		C		●			●	●		1	●		U/V-A10.2	6	CLOSET
7	(2)3'-0"	6'-8"	1 3/4"		●		C		●			●	●		1	●		U/V-A10.2	6	CLOSET

GENERAL NOTES:
A. ALL DOOR HARDWARE SHALL BE LEVER TYPE LATCH SETS UNLESS NOTED OTHERWISE.PROVIDED & INSTALLED PER SPECIFICATIONS SECTION 8710
B. COORDINATE W/ MFR. FOR ADA INSTALLATION REQUIREMENTS. COORDINATE KEYING REQUIREMENTS WITH OWNER.
C. UNDERCUT DOORS PER MECH DWGS.
D. CONTRACTOR TO REVIEW AND ENSURE THE FOLLOWING ITEMS AND STATUTES HAVE BEEN MET AS WELL.
http://codes.lp.findlaw.com/txstatutes/PR/8/92/D/92.153

SPECIFIC NOTES:
1. BEDROOM & BATH DOOR – HARDWARE TO BE PRIVACY LEVER TYPE LATCH SET.
2. ENTRY DOOR – HARDWARE TO BE LEVER TYPE LATCH SETS, KEYED OUTSIDE, RELEASE INSIDE AND DEADBOLT W/ THUMB TURN INSIDE, DEADBOLT SHALL HAVE NO KEY OUTSIDE, W/ 1" MIN THROW. COORDINATE W/ MFR. FOR ADA INSTALLATION REQUIREMENTS. COORDINATE KEYING REQUIREMENTS WITH OWNER.
3. ENTRY DOOR – 180° PEEP HOLES at ADAPTABLE UNITS: (1) PEEP HOLE TO BE INSTALLED @ 60"AFF.
4. ENTRY DOOR – 180° PEEP HOLES at ACCESSIBLE UNITS: (2) PEEP HOLES TO BE INSTALLED @ 43"AFF & 60"AFF.
5. POCKET DOOR – 32" MIN CLEAR OPENING, w/ ADA COMPLIANT HANDLE SIMILAR TO TRIMCO SERIES 1069.
6. BI-PASS/BI-FOLD DOORS – VERIFY OPENING w/ SIZE OF DOOR HARDWARE. PROVIDE FINGER PULLS ON BOTH DOORS.

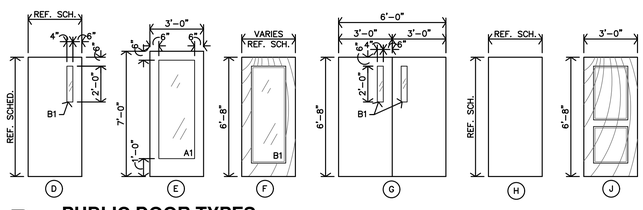

D PUBLIC DOOR TYPES
1/4"=1'-0"

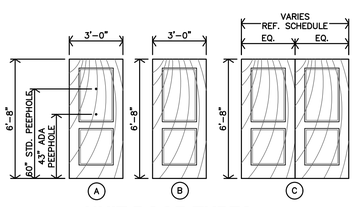

C UNIT DOOR TYPES
1/4"=1'-0"

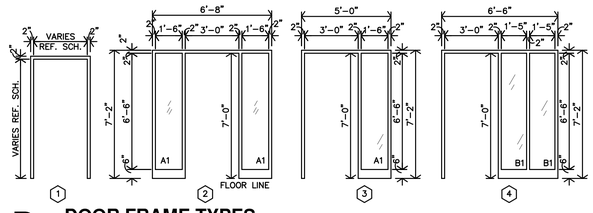

B DOOR FRAME TYPES
1/4"=1'-0"

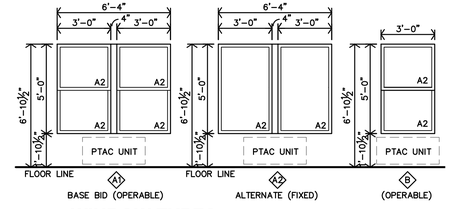

A WINDOW TYPES
1/4"=1'-0"

PUBLIC FINISH SCHEDULE

FINISHES & INSTRUCTIONS

P LATEX ENAMEL — VP VINYL PLANK FLR'G TILE — CT CERAMIC TILE — FP FIBERGLAS REINF. PANEL
C CARPET — VT VINYL TILE — ST STAIN & SEAL — TX TEXTURE
C1 COMMERCIAL CARPET — SC SEALED CONCRETE — GT GLUE-UP TILE

NO.	DESCRIPTION	FLOOR CARPET	FLOOR CERAMIC TILE	FLOOR VINYL PLANK FLR'G TILE	FLOOR VINYL TILE	FLOOR RUBBER NOSING	FLOOR HDWD TREADS & RISERS	BASE SELF COVE RUBBER BASE	BASE SEALED CONCRETE	BASE WOOD	BASE CERAMIC TILE	BASE NONE	N.WALL 5/8" FIRE RATED G.B.	N.WALL CERAMIC WALL TILE	N.WALL CMU	E.WALL 5/8" FIRE RATED G.B.	E.WALL CERAMIC WALL TILE	E.WALL CMU	S.WALL 5/8" FIRE RATED G.B.	S.WALL CERAMIC WALL TILE	S.WALL CMU	W.WALL 5/8" FIRE RATED G.B.	W.WALL CERAMIC WALL TILE	W.WALL CMU	CEILING 2x2 SUSPENDED	CEILING 5/8" FIRE RATED G.B.	REMARKS
FIRST FLOOR																											
101	COMMUNITY ROOM			VP						P			P			P			P			P				P	1, 4, 5
102	OFFICE			VP						P			P			P			P			P				P	4
103	RESTROOM		CT								CT		P	CT		P	CT			CT		P	CT			P	
104	OUTDOOR PATIO								SC																		
106	– NOT USED –												REFERENCE EXTERIOR ELEVATIONS AND WALL SECTIONS														
107	FIRE SPRINKLER							SC	RB				P			P			P			P				P	
108	MECH							SC	RB				P			P			P			P				P	3
109	HALL			VP						P			P			P			P			P				P	1, 6
SECOND FLOOR																											
208	MECH							SC	RB				P			P			P			P				P	
209	HALL			VP						P			P			P			P			P			●	P	1, 6
THIRD FLOOR																											
308	MECH							SC	RB				P			P			P			P				P	
309	HALL			VP						P			P			P			P			P			●	P	1, 6
STAIR & ELEVATOR																											
E1	ELEVATOR			VP				REMAINDER OF FINISHES BY ELEVATOR MANUFACTURER																			
S1	STAIR	C		VP	●					P			P			P			P			P				P	2, 7
S2	STAIR	C		VP	●					P			P			P			P			P				P	2, 7

FINISH SCHEDULE NOTES

GENERAL NOTES:
A. INSTALL VINYL, RUBBER, OR ALUMINUM TRANSITION STRIP BETWEEN FLOOR MATERIAL OF DIFFERING HEIGHTS, INCLUDING BUT NOT LIMITED TO CONCRETE/VCT TRANSITIONS.
B. ALL GYPSUM BOARD AREAS WHICH ARE ACCESSORIES TO THE ROOM INCLUDING BUT NOT LIMITED TO SOFFITS, BULKHEADS, TRIM, ETC. SHALL BE PAINTED REGARDLESS OF WHETHER IT IS SPECIFICALLY INDICATED PER SCHEDULE.
C. ALL G.B. WALLS & PERMANENT PARTITIONS SHALL RECEIVE RUBBER BASE UNLESS NOTED OTHERWISE.
D. WALL TYPE SHOWN FOR GENERAL INFORMATION ONLY. CONTRACTOR SHALL COORDINATE WALL MATERIAL W/ DRAWINGS AND FIELD CONDITIONS. ALL AREAS INDICATED TO RECEIVE NEW FINISH SHALL RECEIVE COMPLETE FINISH AS SCHEDULED AT ENTIRE ROOM. CONTRACTOR SHALL COORDINATE FINISHES AND ACCENTS WITH DETAILS AND INTERIOR ELEVATIONS.
E. FLOORING CONTRACTOR SHALL VERIFY THAT SUBFLOOR IS LEVEL AND PROPERLY PREPPED PRIOR TO INSTALLATION OF ANY FLOORING MATERIALS.
F. CONTRACTOR SHALL VERIFY THAT FLOORS ARE PREPPED/"FLOORSTONED" FOR LEVEL TRANSITION BETWEEN DIFFERING MATERIALS.
G. INSTALL PAINTABLE SILICONE SEALANT AT ALL G.B. TO CMU AND G.B. TO CONCRETE WALL TRANSITIONS.
H. ALL CONTROL JOINTS AT EXPOSED CONCRETE FLOORS SHALL RECEIVE SEALANT COMPATIBLE W/ FLOOR SEALER.
I. ALL H.M. DOORS & FRAMES TO BE PAINTED W/ INDUSTRIAL ENAMEL UNLESS NOTED OTHERWISE. H.M. DOORS AND FRAMES SHALL BE SANDED SMOOTH PRIOR TO PAINTING. SPRAY FINISH ONLY. NO BRUSH FINISH. CONTRACTOR SHALL
J. COORDINATE WITH INTERIOR ELEVATIONS, FLOOR PLANS AND MISCELLANEOUS DETAILS TO VERIFY ALL AESTHETIC ACCENTS AND DETAILS.
K. REFERENCE INTERIOR ELEVATIONS, WALL SECTIONS AND DETAILS FOR WOOD BASE AND TRIM LOCATIONS.
L. LEVEL 4 FINISH AND ORANGE PEEL TEXTURES ON ALL WALLS AND CEILINGS.

SPECIFIC NOTES:
1. REFERENCE REFLECTED CEILING PLAN, COORDINATE LOCATION OF CEILING ACCENTS.
2. CARPET AT ALL LANDINGS. INSTALL RUBBER STAIR NOSING AT EACH RISER. EXTEND CARPET UP THE RISER BEHIND THE NOSING.
3. INSTALL FRP PANEL TO 4'-0" ABOVE MOP SINK AND EXTEND 1'-0" MINIMUM BEYOND EDGES OF SINK; CLASS "A" FIRE RESISTIVE MATERIAL.
4. MULTIPLE WALL PAINT COLORS.
5. CERAMIC WALL TILE BEHIND DRINKING FOUNTAINS. REFERENCE INTERIOR ELEVATIONS.
6. FLOORING: MULTIPLE COLORS TO BE INSTALLED. REFERENCE FINISH FLOOR PLANS ON SHEET A9.1
7. STAIRS: LANDINGS AT EACH FLOOR: 1ST, 2ND AND 3RD FLOOR TO BE LVP FLOORING. REFERENCE SHEET A9.1. INTERMEDIATE LANDINGS ARE TO BE CARPET, SIMILAR TO STAIR RISERS/TREADS.

GLAZING SCHEDULE

MARK	INTERIOR	EXTERIOR	1/4"	1" INSULATED	TINTED	TEMPERED
A1		●		●	●	●
A2		●		●	●	
B1	●		●			●
B2	●		●			

WINDOW SCHEDULE

MARK	WIDTH	HEIGHT	STYLE	QUANTITY	INTERIOR	EXTERIOR	DETAILS	REMARKS
A1	6'-4"	5'-0"	VINYL – SINGLE/DBL HUNG	33		●	L/M/N/W-A10.2	1
A2	6'-4"	5'-0"	VINYL – PICTURE/FIXED	33		●	L/M/N/W-A10.2	1
B	3'-0"	5'-0"	VINYL – SINGLE/DBL HUNG	55		●	L/M/N/W-A10.2	

NOTES:
1. CONTRACTOR MUST INSTALL MTL. FLASHINGS & CONT. CAULK FOR A WEATHER & WATERTIGHT CONDITIONS @ ALL EXTERIOR WINDOW UNITS.
2. CONTRACTOR MUST INSTALL 1/4" INSUL. OR THERMAL BREAK. CONTINUOUS AROUND WINDOW.
3. CONTRACTOR TO PROVIDE & INSTALL MANUFACTURERS COORDINATING PANNING SYSTEM FOR ALUM. WINDOWS.
4. WINDOWS A & B MUST BE SIZED TO MEET EGRESS REQUIREMENTS.
5. ALL SECOND FLOOR WINDOWS AND OPERABLE WINDOWS W/ THE SILL 6'-0" ABOVE GRADE, SHALL BE PROVIDE W/ WINDOW OPENING CONTROL DEVICE PER ASTM 2090 & 2009 IBC SEC. 1015.8.1
6. PROVIDE & INSTALL SAFETY GLASS AT HAZARDOUS LOCATIONS, PER 2018 IBC CODE 2406. IN DOORS, ADJACENT & WITHIN 24" TO DOORS, LESS THAN 18" ABV FLOOR, IN GUARDS & HANDRAILS, ADJACENT TO STAIRS AND RAMPS, STAIRS AND RAMPS.
7. EMERGENCY ESCAPE & RESCUE: PER 2021 IBC SEC. 1030. 20"w X 24"h MIN. OPENINGS, 5.7sf MIN. AREA (ALSO REF. 1030.4)
8. WINDOWS LOCATED WITHIN ACCESSIBLE UNITS (#111 & #303) SHALL BE EQUIPPED WITH LOCKING MECHANISMS AND OPERATIONAL DEVICES THAT ARE LOCATED ON THE BOTTOM HALF OF THE WINDOW (WITHIN 48" A.F.F.)

SPECIFIC NOTES:
1. A1 IS CONSIDERED A BASE BID ITEM, WITH OPERABLE WINDOWS. A2 IS CONSIDERED AN ALTERNATE BID ITEM, WITH FIXED WINDOWS.

JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386
1881 Main Street, Suite 3
Kansas City, MO 64108
jgr@jgrarchitects.com

THE RESIDENCE AT RED CEDAR
NEW SENIOR-LIVING FACILITY
CORSICANA, TEXAS

REVISION:

DATE: 12-10-2024
JOB: 24-3392
SHEET NO.:

A10.1

COPYRIGHTED ©



T DOOR HEAD DTL.
1 1/2"=1'-0"

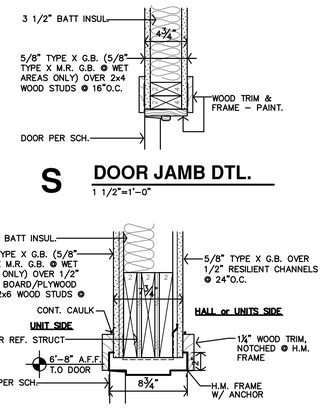

R DOOR HEAD DTL.
1 1/2"=1'-0"

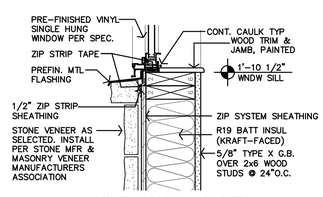

W WINDOW SILL DTL.
1 1/2"=1'-0"

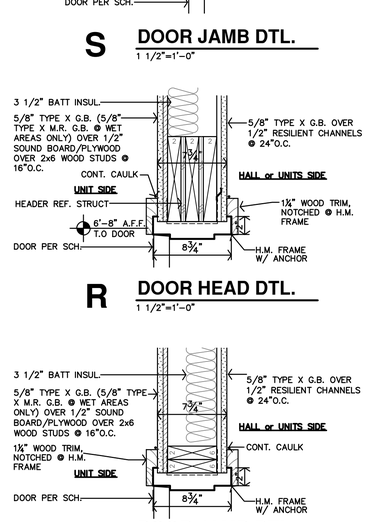

Q DOOR JAMB DTL.
1 1/2"=1'-0"



V BASE DETAIL @ BI-FOLD & BI-PASS DOOR
1 1/2"=1'-0"

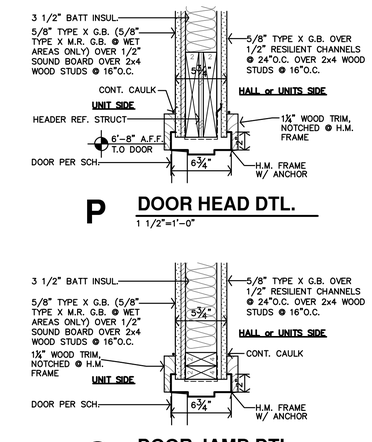

P DOOR HEAD DTL.
1 1/2"=1'-0"



U DOOR HEAD DTL.
1 1/2"=1'-0"

O DOOR JAMB DTL.
1 1/2"=1'-0"

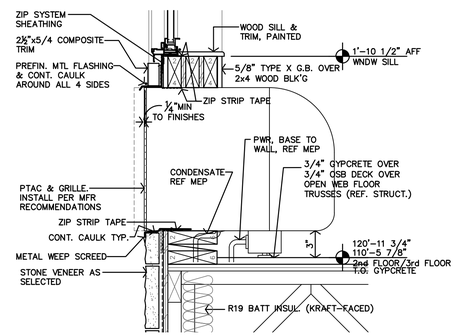

N WINDOW SILL/PTAC DTL.
1 1/2"=1'-0"

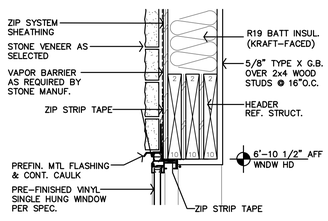

M WINDOW HEAD DTL.
1 1/2"=1'-0" JAMB SIM.

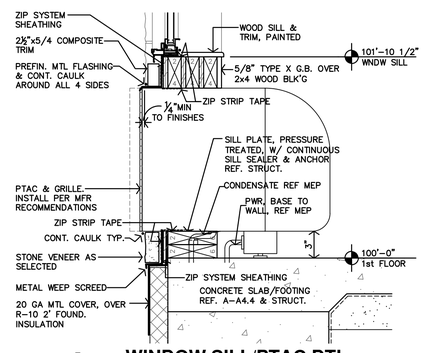

L WINDOW SILL/PTAC DTL.
1 1/2"=1'-0"



K H.M. DOOR JAMB DTL.
1 1/2"=1'-0"



J H.M. DOOR HEAD DTL.
1 1/2"=1'-0"



H H.M. THRESHOLD DTL.
1 1/2"=1'-0"

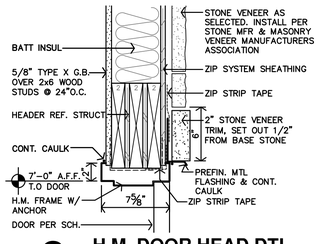

G H.M. DOOR HEAD DTL.
1 1/2"=1'-0"

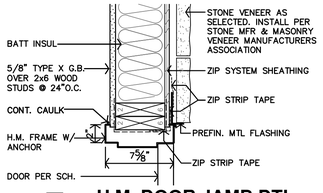

F H.M. DOOR JAMB DTL.
1 1/2"=1'-0"



E STOREFRONT SILL DTL.
1 1/2"=1'-0"



D STOREFRONT JAMB DTL. @ DOOR/SIDELITE
1 1/2"=1'-0" HEAD SIMILAR



C STOREFRONT THRESHOLD DTL.
1 1/2"=1'-0"

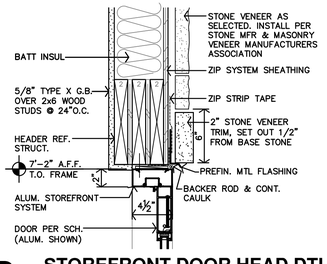

B STOREFRONT DOOR HEAD DTL.
1 1/2"=1'-0"

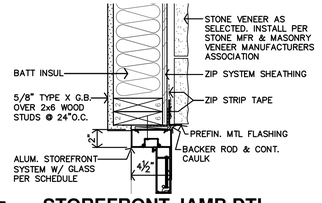

A STOREFRONT JAMB DTL.
1 1/2"=1'-0"

JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386
1881 Main Street, Suite
Kansas City, MO 641
jgr@jgrarchitects.com

THE RESIDENCE AT RED CEDAR

NEW SENIOR-LIVING FACILITY

CORSICANA, TEXAS

REVISION:

DATE: 12-10-2024
JOB: 24-3392
SHEET NO.:

A10.2

COPYRIGHTED ©