


A. DESIGN CRITERIA

1. Design Codes:
a. International Building Code (IBC 2021)
b. Minimum Design Loads for Buildings and Other Structures: ASCE 7-16

2. Design Loads:
a. Dead Loads
Floor (Units w/Interior Partitions) = 40 psf
Floor (Breezeway) = 32 psf
Roof = 22 psf

b. Live Loads (reducible per code UNO)
Residential = 40 psf
Corridors/Exits = 100 psf
Mechanical/Storage = 125 psf (non-reducible)
Typical Roof = 20 psf

c. Roof Snow Load
Ground Snow Load (psf) = 10 psf
Floor Snow Load (psf) = 10 psf
Snow Exposure Factor (C_o) = 1.0
Snow Load Importance (I_s) = 1.0
Thermal Factor (C_t) = 1.0
Slope Factor (C_s) = 1.0
Snow Drift Surgeon
Clubhouse and Low Roofs
Drift Surgeon (pd) = 53 psf
Drift Width (w) = 14 ft

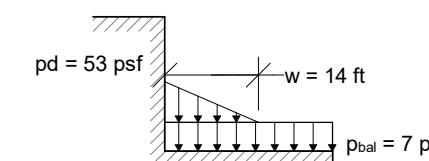

d. Wind Load
Ultimate Wind Speed, V_u = 105 mph (3 sec. Gust)
Nominal Wind Speed, V_{ad} = 81.3 mph
Reference Height, Z = 10 ft
Wind Exposure = C
Internal pressure Coefficient (C_g) = 0.18
Components and Cladding (psf):

Zone	A=10ft	A=50 ft ²	A=100 ft ²
1	+22/25	+16/29	+16/25
2-2r	+22/35	+16/41	+16/35
3	+22/55	+16/41	+16/35
4	+30/32	+27/29	+30/28
5	+30/40	+27/34	+30/31

Notes:
1. A is the Effective Wind Area as defined in ASCE 7 Ch. 26.
2. Linear interpolation between tabulated values is permitted.
3. Elements with Tributary Area (A) > 700 ft² shall be permitted to be designed using provisions for MWFRS.

e. Earthquake Load
Risk Category II
Site Importance Factor (I_s) = 1.0
Mapped Spectral Response Acceleration Parameters: S₈ = 0.902g S₁ = 0.318g
Design Spectral Response Acceleration Parameters: S_{8D} = 0.685 S_{1D} = 0.630

Soil Site Class: D
Seismic Design Category: D
Basic Seismic Force Resisting System
Light-Frame Wood Walls with structural wood shear panels (ASCE 7 Table 12.2-1 Line A.15)
R = 6.5 I_o = 2.5 C_s = .105 C_d = 4
Design Base Shear Bldgs A,B,C V = 103 kips
Design Base Shear Bldg A Clubhouse V = 52 kips
Analysis Procedure = Equivalent Lateral Force Procedure (ASCE 7-16 Chapter 12.8)

f. Rain Load
100 Year 15 Min. Rain Intensity (I) = 6.06 in/hr

3. Allowable Deflections:
Total Load Live/Snow/Wind Load Absolute Maximum

Floor Joists/Trusses	L/360	L/480	1"
Roof Joists/Trusses	L/360	L/360	1.5"
Wall Framing (flexible finish)	L/240	L/240	0.75"
Wall Framing (brick/brick finish)	L/480	L/480	0.5"

Cantilever deflection limits are the more restrictive of 2- α the appropriate L/ α limit (e.g. 2L/360 = L/180) or absolute maximum value listed above, measured at the tip of the cantilever U.N.O.

4. Soil Properties:
a. Soil properties are based on the project geotechnical report entitled "Geotechnical Exploration The Reserves at Cobalt Circle Brownsville, Tennessee", prepared by UES Professional Solutions 25, LLC on February 27, 2025 (herein known as "Geotechnical Report").
b. Allowable Soil Bearing Pressure = 2,000 psf (Strip Footing)
c. Frost Depth = 18 in (per Geotechnical Report)
d. Soil mitigation for soft, moisture sensitive soils must be performed in accordance with the Geotechnical Report

B. STRUCTURAL ENGINEERING DESIGN NARRATIVE

1. McClure Engineering Company (McClure, MEC) is the Structural Engineer of Record (EOR) responsible for the documentation of structural design criteria, strength and stability of the primary vertical and lateral load-carrying systems in their completed form, and conformance of the structural design to the applicable building codes. These drawings produced by McClure convey the structural engineering design for the project, which includes the following components and systems:

a. Foundations consisting of strip footings and isolated column footings.
b. Slabs on grade.

c. Residential framing above the slab on grade consisting of:
i. Load-bearing wood wall and opening framing.
ii. Wood T&G Sheathing over wood joists, floor and roof trusses.

d. The lateral force resisting system of the structure consisting of wood sheathed wood shear walls and wood sheathed diaphragms.

2. The following items are Deferred Submittals. Framing intent and additional requirements for these structural components are provided within these drawings*:
a. Structural steel stair framing and connections - see general notes section "Structural Steel" | see S002 for applicable design criteria
b. Wood Floor & Roof Trusses* - see general notes section "Wood Framing and Fastening" | see S002 for applicable design criteria.
c. Connection of Wood Trusses to the supporting structure*

* Reference section "D. Submittal Requirements." Coordinate requirements of these drawings with those of other design consultant drawings and the Project Specifications.

3. The following items are specifically excluded from McClure's design scope as represented on these drawings:
a. Requirements for fire rating of assemblies or fire protection of structural members
b. Global stability of soil masses
c. Any exterior slab, bollards, curbs, and any enclosures not shown on these drawings
d. Interior non-load-bearing wood wall or ceiling framing

e. Shoring design, formwork design, temporary bracing, and other means and methods items

C. GENERAL NOTES

1. All construction shall conform to the Design Codes in Section "A. Design Criteria," including all applicable standards and documents referenced within those codes.
2. Plan and detail notes provided on specific sheets within these drawings supplement information in these General Notes. Always coordinate the requirements of these notes with what is shown within the drawings.
3. Unless noted specifically on a plan, all floor plans show framing for the floor indicated and vertical framing (walls, openings, posts, columns) below that floor.
4. Contract Document Coordination:
a. The drawings contained herein are intended to be utilized in conjunction with other design consultant's drawings (architectural, civil, mechanical, etc.). It is the responsibility of the Contractor to coordinate the requirements of the drawings with their shop drawings and pads, and dimensions not shown on these drawings.
b. Refer to the architectural, mechanical, electrical, and civil drawings for location and size of block outs, inserts, openings, curbs, bases & pads, and dimensions not shown on these drawings.
c. Refer to the architectural drawings for size and location of doors and window openings, exterior wall assemblies, and floor, wall, and roof finishes. Refer to the mechanical and electrical drawings for additional information including locations of mechanical units, generators, etc.
d. Omissions or conflicts between various elements of the drawings, notes and details shall be brought to the attention of the engineer and resolved before proceeding with the work.

5. Use Drawings and Construction Details:
a. The Contractor shall verify all dimensions and conditions at the job site before commencing work and shall report any discrepancies to the engineer responsible for the design of that work.
b. Do not use scaled dimensions; use written dimensions or, where no dimension is provided, consult the engineer for clarification before proceeding with the work.

c. Details and keynotes shall be incorporated into the project at all appropriate locations, whether or not they are specifically referenced on the drawings.

d. McClure may provide the contractor with electronic files for their convenience and use in the preparation of shop drawings. These drawings shall be used for the preparation of shop drawings, unless otherwise specified in the contract documents.

e. The contractor is responsible for the protection of their electronic files for their convenience and use in the preparation of shop drawings. These drawings shall be used for the preparation of shop drawings, unless otherwise specified in the contract documents.

f. Changes During Construction:
a. Openings shall not be cut or otherwise made in any structural member unless that opening is specifically shown on these drawings. The Contractor shall seek approval in writing from the engineer for any design incorporating additional openings.
b. Support details shown for Architectural, Mechanical, Electrical, and Plumbing equipment as well as elevators is based upon available information from the manufacturer (if any). The Contractor shall coordinate requirements of actual equipment supplied with details and dimensions as required by the manufacturer.

c. The Contractor has the responsibility to notify the engineer of any architectural, mechanical, electrical, or plumbing load imposed on the structure that is not documented on the Contract Documents or differs from what is originally shown. Provide documentation of location, load, size, and anchorage of all undocumented loads in excess of 250 lbs.

7. Construction Sequence and Methods:
a. These drawings and the related Specifications represent the finished structure and, except where specifically shown, do not indicate the method or means of construction. Loads on the structure during construction shall not exceed the design loads indicated in Section "A. Design Criteria" as a maximum. The Contractor shall supervise and direct the work and shall be solely responsible for all construction means, methods, procedures, techniques, and sequences.

b. The Contractor is responsible for compliance with all applicable job-related safety standards proceeding from governing organizations (e.g. OSHA). It is the responsibility of the Contractor to ensure the stability of the structural elements during construction as a result of means and sequence by providing shoring, bracing, etc. as required.

c. It is the responsibility of the Contractor to ensure the stability of the structural elements during construction as a result of means and sequence by providing shoring, bracing, etc. as required.

i. Stability considerations should include all applicable temporary construction and environmental loads per ASCE 37 which may include wind and seismic forces.

ii. Temporary bracing shall remain in place until positive connection is made between the braced element and the floor/roof diaphragm. Diaphragms shall be braced and those diaphragms in turn are structurally complete and connected to the vertical elements of the lateral force resisting system. This is a means and methods item.

iii. The Contractor may at their discretion employ a Specialty Structural Engineer, licensed in the state where the project is located, for the design of any temporary bracing, lifting, rigging, and shoring. Any sealed drawings, calculations, reports, etc. prepared for construction stability shall be submitted to the engineer for review.

d. The Contractor shall consider the effects of thermal movements due to hot or cold weather construction and the potential for extreme temperature variations before the structure is complete.

e. The Contractor is responsible for the protection and repair of any adjacent existing structures, surfaces, and areas which may be damaged as a result of the work.

D. SUBMITTAL REQUIREMENTS

1. General Procedures:
a. The Contractor shall provide all submittals in PDF format unless otherwise requested or indicated in the Project Specifications.
b. All submittals must be reviewed by the Contractor prior to McClure's review. The Contractor is responsible for reviewing each submittal for basic coordination with these drawings and to verify that all the required components of the submittal are incorporated. The submittal must bear the electronic review stamp of the Contractor before McClure will proceed with the review.

c. Incomplete submittals or submittals not meeting the requirements of this section will not be reviewed. McClure will notify the contractor that the submittal is incomplete or unacceptable and that resubmission is required.

i. Submittals requiring engineering calculations for all or a portion of the work are considered incomplete without the sealed calculations and will not be reviewed.

ii. Shop Drawings shall be original drawings. Submissions incorporating any portion or reproduction of the contract documents will not be reviewed.

iii. Deferred Submittals not meeting the seal requirements of section D.2.b are considered incomplete and will not be reviewed.

d. Allow two weeks for review of all submittals unless an agreement for expedited review is made in writing by McClure.

e. McClure's submittal review scope of work includes a single submittal review and one review of the revised submittal if required (two to be submitted). The contractor shall be responsible for any additional cost required for more than two reviews of a submittal is considered an additional service and will be billed hourly. McClure reserves the right to withhold review of a submittal surpassing this allowance until proper billing to the responsible party can be established.

f. Submittals must be returned to the Contractor by McClure bearing a stamp marked "Reviewed No Exception Taken" or "Reviewed With Comments/Exceptions" prior to proceeding with the work. Submittals marked "Rejected/Resubmit" must be revised according to the comments provided prior to proceeding with the respective scope of work.

2. Deferred Submittals:
a. See Section "B. Structural Engineering Design Narrative" for the list of items considered Deferred Submittals.

b. Deferred Submittals shall bear the seal of a professional engineer licensed in the state where the project is located. If the project is located in a state where there is no professional engineer license, the engineer sealing the Deferred Submittals.

c. Deferred Submittal items shall not be installed until the Deferred Submittal documents have been approved by the Building Official.

a. Submittals (product data, test records, shop drawings, and/or calculations) are required for the following:

Submittal Name	Items Required:				
	Product Data	Shop Drawings	Test Records	Engineering Drawings	Engineering Calculations
1. Concrete Mix Designs	X		X		
2. Concrete Break Reports			X		
3. Concrete Reinforcing Layout				X	
4. Concrete Anchor Bolts & Embedded Plates	X	X			
5. Concrete Anchors (Post-Installed)	X				
6. Post-Installed Anchor Substitutions (If used)	X				X
7. Post-Installed Connection (Grounding Attention (If used))	X			X	X
8. Steel Stair Framing and Connections to Supports		X		X	X
9. Wood Framing Materials	X				
10. Wood Floor & Roof Trusses incl. Reactions		X		X	
11. Wood Truss Connections to Supporting Structure				X	X
12. Specialty Wood Fasteners	X				X
13. All Cladding Systems & Attachments as identified in the Architectural Drawings (If used)	X			X	X

b. "Product Data" may indicate mill certifications, material data sheets, Evaluation Service Reports (ESRs), etc. See requirements of each material section of the General Notes for further information.

c. Where "Engineering Drawings" and/or "Engineering Calculations" are indicated, the submittal must comply with the requirements of item "2. Deferred Submittals" above.

d. Submittals For Record:
i. The Contractor shall inspect the structural design and therefore must be submitted to the engineer; however, they do not require review.

ii. Mechanical Equipment Shop Drawings with Weight

iii. Brick & Stone Veneer with Weight

E. CONCRETE

1. Reinforced concrete shall have the following minimum 28 day compressive strengths:
a. Slab on grade, unless noted otherwise 4000 psi normal weight
b. Foundations 5000 psi normal weight
2. All concrete exposed to weather shall have 6% (+/- 1%) entrainment.
3. Submit mix designs for all concrete mixes prior to placement. All submittals shall include the following:
a. Batch quantities including admixture dosage rates.
b. Strength test results for trial mixes.
c. Aggregate source and gradation(s).
d. Product data for cement, fly ash and other cementitious materials.
e. Product data for all admixtures.


4. Provide protection for reinforcing bars as follows:
a. Concrete cast against and permanently exposed to earth 3"
b. Concrete exposed to earth and weather (formed)
i. #5 and smaller 1-1/2"
ii. #6 and larger 2"
c. Concrete not exposed to weather and not in contact with ground 3/4"
i. Slabs and walls 1-1/2"

Project Number	Set Issue Date
2024002664	05/09/2025

Engineer Drawn By Checked By
 CAS CAS JTB

NOTICE:
 McClure Engineering Co. is not
 responsible or liable for any issues,
 claims, damages, or losses (collectively,
 "losses") which arise from failure to follow
 these Plans, Specifications, and the
 engineering intent they convey, or for
 losses which arise from failure to obtain
 and/or follow the engineers' or surveyors'
 guidance with respect to any alleged
 errors, omissions, inconsistencies,
 ambiguities, or conflicts contained within
 the Plans or Specifications.

TENNESSEE CERTIFICATE OF
 AUTHORITY
 NO. 8231

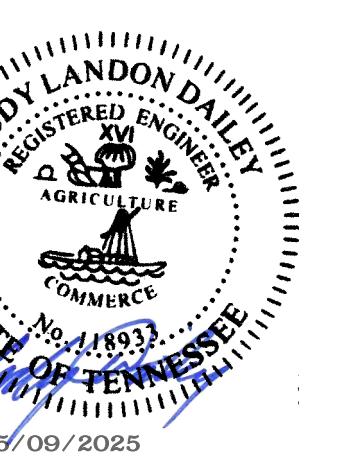

I HEREBY CERTIFY THAT THIS
 ENGINEERING DOCUMENT WAS
 PREPARED BY ME OR UNDER MY
 DIRECT PERSONAL SUPERVISION AND
 THAT I AM A FULLY
 LICENSED PROFESSIONAL ENGINEER
 UNDER THE LAWS OF THE STATE OF
 TENNESSEE.

No.	Description	Date
00	PERMIT SET	05/09/2025

I. POST-INSTALLED ANCHORS TO CONCRETE AND MASONRY

1. Post installed anchors shall be expansion, adhesive, or screw anchors as indicated in the details, unless noted otherwise. Only use the anchor type indicated. All anchors on the project of each type must be by the same manufacturer, see below for substitution requirements.

- a. Expansion anchors:
 - i. Concrete:
 - Hilti HIT RE 500-SD (ICC-ES ESR2322) or Hilti HIT-HY 200 (ICC-ES ESR3187).
 - Simpson Strong-Bolt 2 (ICC-ES ESR3037).
 - Powers Power-Stud+ SD2 (ICC-ES ESR2502).
 - ii. At equilibrium (EMC) = 8%
- b. Adhesive anchors (threaded rods shall be ASTM A193 B7 for all anchors):
 - i. Concrete:
 - Hilti Kwik T2 (ICC-ES ESR1917).
 - Simpson Strong-Bolt 2 (ICC-ES ESR3037).
 - Powers Power-Stud+ SD2 (ICC-ES ESR2502).
 - ii. Provide oversized long slotted holes at pipe penetrations. Holes must be within conformance of typical penetration details.
 - iii. Rigid connections shall be adjusted before completion of construction of closing of wall and ceiling assemblies.
 - iv. All vertical sheet metal down spouts shall have intermediate slip joints.
 - v. Roof Drains shall utilize adjustable fittings. Fittings must be adjusted at the completion of construction and then as required to maintain proper drainage.
- c. Screw anchors:
 - i. Concrete:
 - Hilti Kwik HUS EZ (ICC-ES ESR3027)
 - Simpson Titen HD (ICC-ES ESR2713)
 - Powers Wedge-Bolt+ (ICC-ES ESR2526)

2. Post-installed anchors shall only be used where specified in the drawings. The Contractor shall obtain approval from the engineer prior to using post-installed anchors for missing or misplaced cast-in-place anchors.

3. All personnel installing anchors shall be trained and certified by the anchoring system manufacturer or by ACI. Contractor shall submit current certifications for all personnel. ACI certification required for all personnel installing adhesive anchors in a horizontal or overhead condition. If a failure occurs at any time during testing or construction, personnel shall be retrained and recertified.

4. Installation:

- a. Do not cut existing reinforcing.
- b. The hole through the supported steel member shall be 1/16" larger in diameter (1/8" for screw anchors) than the anchor unless noted otherwise. Use plate washers with a standard size hole welded to steel members where oversized holes must be used.
- c. Holes shall be drilled per the manufacturer's written instructions as outlined in the ESR.
- d. Where applicable, installation shall follow cleaning procedure indicated in the ESR. Holes shall be made with a hammer drill. Use of a power drill is not recommended.

5. Special attention shall be provided for all post installed anchors as required by the building code and/or ICC-ES report. Written special inspection reports shall be submitted to the registered design professional in responsible charge by the special inspector. The reports shall record and report the following as a minimum:

- a. One of every ten anchors installed by each technician in locations listed below shall be randomly tested in direct tension. At least one anchor shall be tested on each day that anchors are installed.
- i. Test anchors in following locations:
 - Shear wall hold down anchors
 - Shear wall tie-in anchors
 - Braced frame base plate anchors
 - Anchors supporting dead or live loads in tension
- ii. Test anchor to twice the allowable tension load as provided in the ESR. Test load shall not exceed 80 percent of the yield strength of the anchor (0.8 x A_{yield} x f_u).
- iii. Post-installed anchors shall not be tested using a torque wrench.
- iv. If any anchor fails quality control testing, all anchors of the same type shall be randomly tested until (10) consecutive anchors pass. Resulted normal freedom after test will be approved by engineer. The failed anchor(s) shall be removed and the affected area patched by engineer's direction. Contractor engineer to provide replacement instructions. The cost for additional work and testing required due to anchor failure is the responsibility of the installing contractor.

b. Prior to and during installation of anchors, the following shall be reviewed and noted in the inspection report:

- i. That the Installer has reviewed manufacturer's ESR report and written installation procedures and has been certified by the manufacturer or ACI.
- ii. General concrete or CMU block conditions (cracked or un-cracked, wet or dry, grouted or hollow, etc).
- iii. Whether manufacturer's written procedures for preparation of hole were followed. Indicate if hole is wet or dry.
- iv. Whether hole was made with a hammer drill
- v. Whether anchor manufacturer's written procedures for anchor installation were followed.
- vi. Embedment depth and concrete or block thickness.
- vii. Anchor diameter, length and type.

c. After installing anchors, the following shall be reviewed and noted in the inspection report:

- i. All test locations.
- ii. Anchor size and/or type.
- iii. Applied load, loading procedure, load increments and rate of loading.
- iv. Method of failure.
- v. Product details of test equipment and typical failures.

6. Substitution requests for products other than those listed above shall be submitted to the engineer with calculations that are prepared and sealed by a registered structural engineer at least two weeks prior to scheduled installations. Calculations shall demonstrate that the substituted product will achieve an equivalent capacity using the appropriate design procedure required by the building code. Product ICC-ES code reports shall be included with the submittal package.

J. STRUCTURAL STEEL

1.

- a. Materials shall conform to the following, unless noted otherwise.
 - i. Rolled Wf shapes ASTM A992
 - ii. Plates and Angles ASTM A572 Grade 50
 - iii. Channels ASTM A36
 - iv. HSS: Rectangular ASTM A500, Grade C
 - v. HSS: Round¹ ASTM A500, Grade C
 - vi. Bolts ASTM F3125
 - 1. All bolts shall be Grade A325 or Grade A490
 - 2. Bolts designed as "A490" shall be Grade A490 or F2280
 - vii. Nuts ASTM A563 DH or A194
 - viii. Washers ASTM F436
 - ix. Anchor Bolts ASTM F1554 Grade 36, UNO
 - x. Threaded Rod ASTM A36
 - xi. Studs ASTM A108, Type B Nelson headed shear stud connectors or equal.
 - xii. Electrodes Matching weld metal, 70 ksi minimum strength.
- b. Finishes:
 - i. Prepare all surfaces that will be exposed in accordance with SSPC SP3 "Power Tool Cleaning".
 - ii. Do not prime surfaces to be fireproofed, field welded, in contact with concrete, or high-strength bolted.
 - iii. All exterior steel components exposed to view or weather shall be galvanized in accordance with ASTM A123 for framing members and ASTM A153 for bolts and threaded fasteners.
 - iv. All exterior welded connections shall be cold galvanized in accordance with ASTM A780.
- 2. Fabricator:
 - a. Steel Fabricator shall be AISC Certified.
 - b. Structural members shall be detailed, fabricated, and erected in accordance with the latest edition AISC 303 "Code of Standard Practice for Steel Buildings and Bridges."
 - c. Structural steel fabrication drawings must be submitted to the engineer for review prior to fabrication.
 - d. The Fabricator shall engage a professional engineer registered in the state where the project is located for the design and detailing of:
 - i. Steel Stairs.
 - ii. Temporary bracing.
- 3. Steel Stairs:
 - a. Design of steel stairs shown on drawings is the responsibility of the fabricator.
 - b. Stair tread type and thickness shall be as noted on the architectural drawings.
 - c. Stairs completely sealed, shop drawings including engineering calculations for each stair. Drawings shall include all members and components, including connections to supporting structure.
 - d. Unless otherwise noted, all connections to steel structure shall be welded and all connections to concrete or wood shall be post-installed anchors (screw or bolt).
 - e. Supporting members have been designed for all loads imposed by stair system.
 - i. Check supporting members for local effects at connections and provide stiffeners, doublers, etc. as necessary.
 - f. Design stairs for the following loads:
 - i. Live Load = 100 psf or 300 lb. point load on 4" square area.
 - ii. Dead Load = Self weight plus 10 psf superimposed dead load.
 - g. Design stairs for the following deflection criteria:
 - i. Live Load = L/480
 - ii. Total Load = L/360

G. WOOD FRAMING AND CONNECTIONS

1. Install rough carpentry according to the American Institute of Timber Construction Manual.
2. Material:
 - a. Sawn lumber
 - i. Sawn lumber shall be grade stamped and visually graded with maximum 18% moisture content
 - ii. All lumber shall meet strength requirements in NDS "National Design Specification for Wood Construction".
 - iii. Joists, rafters, and nailing with nominal depth 8" or less shall be Southern Pine (SP) or Douglas Fir-Larch (DFL), No. 2 or better.
 - iv. Joists, rafters, and nailing with nominal depth greater than 8" shall be Southern Pine (SP) or Douglas Fir-Larch (DFL), No. 1 or better.
 - v. All exterior posts shall be Western Red Cedar No. 2 or better.
 - vi. Bearing and shear wall studs, and wall plates, shall be Douglas Fir-Larch (DFL), No. 2 or better.
 - b. Structural Composite Lumber
 - i. SCL shall meet material specifications in ASTM D5456
 - ii. Other studs, rafter, and nailing veneer lumber (LVL), laminated strand lumber (LSL), oriented strand lumber (OSL) and parallel strand lumber (PSL).
 - iii. All LVL shall be stress class 2.0E-2600F.
 - iv. Other SCL materials shall be graded as indicated on the plans.
 - c. Glued-laminated timber (Glulam) shall be manufactured and identified as required in ANSI/AITC A-190.1 and ASTM D3737.
 - d. Structural Panels
 - i. All plywood or oriented strand board (OSB) panels shall meet the strength requirements in Department of Commerce (DOC) PS 1 and PS 2.
 - ii. All gypsum board (Gypsum) and drywall (Drywall) shall meet the Structural 1 grading standard
 - e. Connectors and Fasteners
 - i. Metal connectors and associated fasteners used for the applications indicated shall meet the following minimum standards:
 1. Untreated Lumber
 - a. Connectors ASTM A653 G90
 - b. Bolts and Anchor Rods ASTM F1554 Gr36
 - c. Nails and Staples ASTM A1667
 2. Sodium Borate (SBX) Pressure Treated Lumber
 - a. Connectors ASTM A653 G90
 - b. Bolts ASTM A307
 - c. Anchor Rods ASTM F1554 Gr 55
 - d. Nails and Staples ASTM F1667 with A153 Hot Dipped Galvanized
 3. All Other Pressure Treated Lumber (e.g. ACQ-C, ACQ-D, CA-B, CBA-A, AC2A)
 4. All wood preservative treated lumber shall be treated with AWPA U1 and M4
 5. All framing indicated to be fire-retardant treated or fire resistive on the drawings (Architectural or Structural) shall comply with AWPA U1 UCFA, Type A or ICC-ES ESR 2645 and shall have UL FR-S surface burning characteristics.
 6. All wood preservative treated lumber shall be held in place to prevent warping, cupping, bowing, crooking and twisting. Use only material that is straight. All bowed wood shall be held off the ground with sacrificial damage blocks.
 7. Wood connectors shall be installed to prevent wood from splitting on otherwise damaging either member.
 8. Use 4x4, 4x6 and 6x6 columns as shown on plans. Built-up sections of 2x studs shall not be substituted for timber posts.
 9. All multi-ply beams, joists and headers shall be fastened together.
 - i. Fasten lawn lumber members per schedule below.
 - ii. Fasten structural composite lumber per manufacturer's literature.
 10. Standard cut washers shall be used under bolt heads and nuts bearing against wood, unless noted otherwise per shear wall anchorage details.
 11. Walls are designed based on being fully braced by sheathing. Design of temporary or permanent blocking or bridging for support of construction loads by unsheathed walls is the responsibility of the contractor.
 12. Joists shall bear on the full width of supporting members (stud walls, beams, nailing, etc.) unless noted otherwise.
 13. Subject to compliance with the project requirements, wood connectors, joist hangers, post caps and bases, holdowns, and related hardware shall be manufactured by Simpson Strong-Tie Company, Inc. San Leandro, CA
 - i. Contractor shall follow the manufacturer's latest recommendations for installation of connectors.
 - ii. Other manufacturers may be acceptable. Submit substitution request demonstrating that the proposed hardware has the same or greater capacity for each connection. At two weeks prior to the start of construction, the proposed hardware shall be submitted to the engineer for review.
 14. All bearing walls shall be fastened to the floor joists using Simpson joist hangers. Use LU (or equal) for single joists and type LUS for double joist unless noted otherwise. The joist hangers shall be installed using nails or screws supplied by the hanger manufacturer as required for the hanger type.
 15. Bottom plates of all bearing walls on concrete shall be anchored with 3/8" diameter x 6" screw anchors spaced not more than 4'-0" o.c., unless noted otherwise. Sill plate anchors shall be located a maximum of 1'-0" from corners, ends of walls and sill plate splices. Provide (2) anchors minimum in each sill plate section Refer to plans and details for shear wall anchorage requirements.
 16. Nailing shall be anchored to steel beams and columns with 1/2" diameter A307 bolts with required washers at a maximum spacing of 24" on center (alternate sides), unless noted otherwise.
 17. Joist, stud, jamb studs, and beam support studs shall have adequate vertical blocking installed to transfer all vertical loads to the foundation.
 18. Wood Floor and Roof Trusses:
 - a. Provide wood trusses capable of withstanding the design loads within the limits and under the conditions indicated. Truss design shall be in accordance with the Building Code and TPI-1 Nation Design Standard for Metal Plate Connected Wood Truss Construction.
 - b. Wood trusses shall be of sawn lumber with 2x nominal thickness.
 - c. In addition to the loads indicated, wood trusses shall be designed for all applicable wind, seismic, and snow (including drift) loads resulting from the Code and the project specific drawing preparation shall be supervised by a registered professional engineer licensed in the state where the project is located.
 - d. Submittals shall be signed and sealed and include comprehensive truss layout plans, design calculations that indicate species and grades of lumber, design stresses, size and type of connector plates used.
 - e. Fabricator shall determine truss diagonal loadings. Truss configurations shown on drawings are diagrammatic only. Bearing points shall coincide with intersections of diagonals and chords.
 - f. Truss member design shall consider unbalanced snow load with full dead load, as well as full dead and snow load.
 - g. The following loadings shall be used for truss design:
 - i. Dead Load Top Chord = 12 psf
 - ii. Dead Load Bottom Chord = 10 psf
 - iii. Live load = 20 psf on the top chord horizontal projection
 - iv. Snow Load = 7 psf with additional drift load noted in Design Criteria on sheet S001.
 - v. Wind uplift = 25 psf (=0.6W)
 - h. Floor trusses shall be designed for the following loads:
 - i. Dead Load Top Chord = 30 psf (units w/ interior partitions)
 - ii. Dead Load Bottom Chord = 10 psf
 - iii. Live Load = 40 psf. Private Rooms, offices and corridors serving them
 - iv. Common and public areas, including stairs and landings = 125 psf. Mechanical and communication rooms
 - i. The maximum allowable deflection shall be:
 - i. Roof Trusses: Total Load: L/240, Roof Live or Snow Load: L/360
 - ii. Floor Trusses: Total Load: L/360, Live Load: L/480, 1 1/4" max
 - j. The following shall be used for all open web trusses and accessories as shown on the structural and architectural drawings and as required for a complete project.
 - k. All truss to connection and truss to supporting member connections shall be designed and detailed by the truss supplier and the size and type of connectors included in the shop drawing submittal. Coordinate size, species and grade of supporting chord and web members with the truss hanger selected.
 - l. All temporary and permanent bracing shall be in accordance with the TPI standards for bracing. The bracing shall be furnished and installed by the Contractor. Do not use ceilings as uplift bracing at truss bottom chord.
 - m. Girder trusses shown on drawings shall be designed to carry concentrated reactions from supported members.
 - n. Wood trusses shall be unloaded and stored in bundles in an upright position out of contact with the ground until ready for installation.
 - o. Any damage to the trusses shall be brought to the immediate attention of the Structural Engineer and truss supplier. Field repair and modification of trusses shall not be made with prior written approval from the supplier.

H. WOOD SHRINKAGE


1. IBC 2004 3.3 requires that architectural, mechanical, electrical, and plumbing systems be designed to accommodate movement due to shrinkage. McClure Engineering Co. takes no responsibility for the naturally occurring shrinking that will occur.

2. Estimated values are based upon the following moisture content:
 - a. At installation (MC) = 10%
 - b. At equilibrium (EMC) = 8%
3. The following recommendations are intended to minimize the potential issues associated to wood shrinkage. Implementation and liability are ultimately up to the contractor or design professional responsible for the impacted trade.
 - a. Mechanical, Electrical, Plumbing
 - i. Allow construction gaps in the wood framing to close by delaying installation of MEP as long as possible to allow for additional dead load to be installed.
 - ii. Provide oversized long slotted holes at pipe penetrations. Holes must be within conformance of typical penetration details.
 - iii. Rigid connections shall be adjusted before completion of construction of closing of wall and ceiling assemblies.
 - iv. All vertical sheet metal down spouts shall have intermediate slip joints.
 - v. Roof Drains shall utilize adjustable fittings. Fittings must be adjusted at the completion of construction and then as required to maintain proper drainage.
 - b. Architectural Considerations
 - i. Stucco, EIFS and brittle finishes shall have horizontal expansion joints, slip joints with appropriate waterproofing.
 - ii. Brick and stone finishes shall have ties that accommodate differential movement.
 - iii. Provide adjustable thresholds or transitions at rigid transitions such as CMU or concrete stair and elevator shafts.
 - c. Construction tolerance
 - i. Limit shortening due to nesting by cutting all studs level square and tight against plates.
 - ii. Structural wood panels shall have 1/8" relief gaps at each floor to limit bulging.
 - iii. Floor sheathing shall have 1/8" gaps on all sides during installation to accommodate movement.
 - iv. Shear wall hold downs shall be checked and retightened immediately prior to sheathing walls.
 - v. Delay gyp topping around concrete and CMU stair or elevator shafts until completion of construction.
 - d. Material storage
 - i. Stored materials shall be covered and elevated from the elements.
 - ii. Do not allow water to pond on floor sheathing. Provide drain holes if required to allow water to quickly drain if water does temporarily pond.
 - e. Post occupancy
 - i. McClure recommends a review of roof drains every 3 months for the first 24 months of occupancy and then annually. Adjust drains as required to maintain watertight integrity.
 - ii. McClure recommends review of joints at exterior doors, windows and finish transitions. Waterproof as needed where original joints fail per the architect's recommendations.
 - iii. Remedial self-leveling work may be required around concrete or CMU stair and elevator towers to accommodate shrinkage.

Schedule of minimum nailing for standard connections ¹				
-------------------------------------------------------------------	--	--	--	--

NOTICE:
McClure Engineering Co. is not
responsible or liable for any issues,
claims, damages, or losses (collectively,
"Losses") which arise from failure to follow
these Plans, Specifications, and the
engineering intent they convey, or for
Losses which arise from failure to obtain
and/or follow the engineers' or surveyors'
guidance with respect to any alleged
errors, omissions, inconsistencies,
ambiguities, or conflicts contained
within the Plans or Specifications.

TENNESSEE CERTIFICATE OF
AUTHORITY
NO. 8231

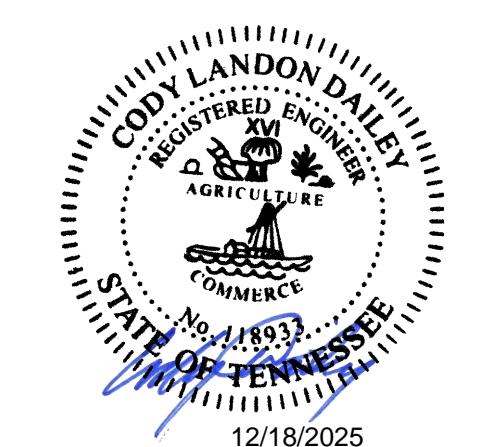

CODY L. DAILEY
118933
EXP: 2/28/2026

I HEREBY CERTIFY THAT THIS
ENGINEERING DOCUMENT WAS
PREPARED BY ME OR UNDER MY
DIRECT PERSONAL SUPERVISION AND
THAT I AM THE ONLY
LICENSED STRUCTURAL ENGINEER
UNDER THE LAWS OF THE STATE OF
TENNESSEE.

No.	Description	Date
1	ASI 3 - WALL SCHED & TYP DETAIL	10/22/25
2	ASI 5 - BLDG C REVISION	12/05/2025
3	ASI 6 - SHEAR WALL SCHED REV	12/18/2025

PROJECT NUMBER 2024002664 SET ISSUE DATE 05/09/2025
ENGINEER DRAWN BY CHECKED BY
CAS CAS JTB

JONES GILLAM RENZ
COBALT CIRCLE
BROWNSVILLE, TENNESSEE

FOUNDATION SCHEDULE		
Mark	Size	Reinforcing
F2.5	2'-6" x 2'-6" x 1'-0"	(3) #4 BARS Top & Bottom (Each Way)
F3.0	3'-0" x 3'-0" x 1'-0"	(3) #4 BARS Top & Bottom (Each Way)

Notes:
1. All footings must be centered on walls and columns U.N.O.

FLOOR AND ROOF SCHEDULE				
Type	Membrane/Sheathing	Fastening	Concrete/Topping	Reinforcing
Slab on Grade	12mil Vapor Retarder	Taped Edges	4" NW Concrete U.N.O.	6x6-W2.9xW2.9 WWF
Breezeway Floor	3/4" Plywood	Glue and Nail to Trusses w/10d @ 6/12	1 1/2" Lightweight Concrete Topping	---
Interior Floors	3/4" Plywood	Glue and Nail to Trusses w/10d @ 6/12	3/4" Gypcrete Topping	---
Roof	15/32" Plywood	10d @ 6/12 UNO	---	---

Notes:
1. Vapor barrier to be placed over compacted fill per general notes.
2. Plywood sheathing to be fastened per detail 2/S505. Individual panels to span a minimum of two framing bays.
3. Floor/Roof diaphragm are unblocked unless noted otherwise on plan.
4. Plywood to be APA rated Structural Grade 1 Material
5. See architectural drawings for full floor and roof assemblies including nonstructural elements.

WOOD WALL SCHEDULE				
Wood Wall Location	Wall Stud Size, number of plys, and spacing			Sheathing & Fastening U.N.O. (See Note 5)
	Level 1	Level 2	Level 3	
Exterior & Breezeway Walls	(1) 2x6 @ 24" o.c.	(1) 2x6 @ 24" o.c.	(1) 2x6 @ 24" o.c.	15/32" Structural wood sheathing fastened w/ 10d nails. 6" o.c. edge fastening, 12" o.c. field fastening
Single Bearing Walls Within Units	(3) 2x4 @ 24" o.c.	(2) 2x4 @ 24" o.c.	(1) 2x4 @ 24" o.c.	5/8" Gypsum wallboard fastened w/ 1 5/8" Type W screws. 7" o.c. edge fastening, 7" o.c. field fastening
Double Walls Separating Units	(2) 2x4 @ 24" o.c.	(1) 2x4 @ 24" o.c.	(1) 2x4 @ 24" o.c.	All Unit Separation Walls are Shear Walls. See Shear Wall Schedule for Sheathing & Fastening

Notes:
1. Wall stud spacing is to be per schedule unless noted otherwise.
2. All framing (studs and wood floor trusses) shall align floor to floor.
3. All roof trusses spanning exterior wall to corridor shall align with studs and framing below unless a triple top plate is provided.
4. Roof trusses less than 12'-0" long spanning exterior wall to girder truss are not required to align with studs and framing below.
5. Bottom sill plates at foundation to be fastened w/ 3/8"Ø x 6" Hill Kwik HUS-EZ Bolts @ 48" o.c. U.N.O.
6. Sill and top plates at all other levels to be fastened w/ (1) 16d nails with same spacing as wall studs U.N.O. on shear wall schedule.
7. Shear walls shall be sheathed & fastened per shear wall schedule.
8. Non-load bearing walls not shown, refer to architectural drawings.
9. All top plates are to be continuous. Splice per 3/S505.

10. U.N.O. bottom sill plates shall be (1) 2x member matching wall thickness, and top plates shall be (2) 2x members.
11. Where architectural drawings show 2x6 walls and structural drawings/schedule indicates 2x4 walls, architectural drawings shall control.


TYPICAL WALL HEADER SCHEDULE (WALLS SHOWN ON FRAMING PLANS ARE WALLS BELOW)						
Header Type	Header	Kings/Jacks				
		Level 1	Level 2	Level 3		
HA	(3) 2x8	(1) 2x6 K	(1) 2x6 J	(1) 2x6 K	(1) 2x6 J	(1) 2x6 K
HB	(3) 2x8	(1) 2x6 K	(2) 2x6 J	(1) 2x6 K	(2) 2x6 J	
HC	(3) 1 3/4" x 7 1/4" LVL				(1) 2x6 K	(2) 2x6 J
HD	(2) 2x8	(1) 2x4 K	(2) 2x4 J	(1) 2x4 K	(2) 2x4 J	(1) 2x4 K
HE	(2) 2x10	(1) 2x4 K	(2) 2x4 J	(1) 2x4 K	(2) 2x4 J	
HF	(3) 2x10	(1) 2x6 K	(3) 2x6 J			

Notes:
1. See 5/S505 for typical opening framing.
2. Coordinate all dimensions and elevations with architectural drawings.
3. Provide double sills below windows at openings greater than 6'-0" in length.
4. All Laminated Strand Lumber (LSL) shall be stress class 1.3E-1700Fb.
5. All Laminate Veneer Lumber (LVL) shall be stress class 2.0E-2600Fb.

WOOD SHEAR WALL SCHEDULE							
Mark	Level	Sheathing/ Fastener Layout	Post	Hold-Down	Base Connection	ASD Truss Drag Load plf	
						0.6 Wind	0.7 Seismic
SW1	Level 3	(1) Sided, Wood Structural Panels - S1 - 15/32" 10d Nail, 6" Edge fastening	(2) 2x6	MSTC28 (16) .148 x 3 1/4 NAILS	(2) 16d nails @ 24" o.c.	144	92
	Level 2	(1) Sided, Wood Structural Panels - S1 - 15/32" 10d Nail, 6" Edge fastening	(2) 2x6	MST60 (46) .162 x 2 1/2 NAILS	(2) 16d nails @ 12" o.c.	252	200
	Level 1	(1) Sided, Wood Structural Panels - S1 - 15/32" 10d Nail, 4" Edge fastening	(3) 2x6	HDU14-SDS2.5 w/ (36) 1/4"Øx2-1/2"SDS Screws 1"Ø Anchor Rod 8" Embed	(1) HILTI KH-EZ 3/8"Øx 6" @ 12" o.c.	475	308
SW2	Level 3	(1) Sided, Wood Structural Panels - S1 - 15/32" 10d Nail, 6" Edge fastening	(2) 2x6	MSTC28 (16) .148 x 3 1/4 NAILS	(2) 16d nails @ 24" o.c.	144	92
	Level 2	(1) Sided, Wood Structural Panels - S1 - 15/32" 10d Nail, 6" Edge fastening	(2) 2x6	MST60 (46) .162 x 2 1/2 NAILS	(2) 16d nails @ 12" o.c.	252	200
	Level 1	(1) Sided, Wood Structural Panels - S1 - 15/32" 10d Nail, 4" Edge fastening	(3) 2x6	HDU14-SDS2.5 w/ (36) 1/4"Øx2-1/2"SDS Screws 1"Ø Anchor Rod 8" Embed	(1) HILTI KH-EZ 3/8"Øx 6" @ 12" o.c.	353	254
SW3	Level 3	(1) Sided, Wood Structural Panels - S1 - 15/32" 10d Nail, 6" Edge fastening	(2) 2x6	MSTC28 (16) .148 x 3 1/4 NAILS	(2) 16d nails @ 24" o.c.	119	76
	Level 2	(1) Sided, Wood Structural Panels - S1 - 15/32" 10d Nail, 4" Edge fastening	(2) 2x6	MST37 (22) .162 x 2 1/2 NAILS	(2) 16d nails @ 24" o.c.	208	165
	Level 1	(1) Sided, Wood Structural Panels - S1 - 15/32" 10d Nail, 4" Edge fastening	(3) 2x6	HDU8-SDS2.5 (20) 1/4"Øx2-1/2"SDS Screws 5/8"Ø Anchor Rod 8" Embed	(1) HILTI KH-EZ 3/8"Øx 6" @ 24" o.c.	292	210
SW4	Level 3	(1) Sided, Wood Structural Panels - S1 - 15/32" 10d Nail, 6" Edge fastening	(2) 2x6	MSTC37 (22) .162 x 2 1/2 NAILS	(2) 16d nails @ 24" o.c.	205	131
	Level 2	(1) Sided, Wood Structural Panels - S1 - 15/32" 10d Nail, 4" Edge fastening	(2) 2x6	MST60 (46) .162 x 2 1/2 NAILS	(2) 16d nails @ 12" o.c.	357	284
	Level 1	(1) Sided, Wood Structural Panels - S1 - 15/32" 10d Nail, 4" Edge fastening	(3) 2x6	HDU11-SDS2.5 (30) 1/4"Øx2-1/2"SDS Screws 1"Ø Anchor Rod 8" Embed	(1) HILTI KH-EZ 3/8"Øx 6" @ 12" o.c.	501	360
SW5	Level 3	(1) Sided, Wood Structural Panels - S1 - 15/32" 10d Nail, 6" Edge fastening	(2) 2x4	MSTC28 (16) .148 x 3 1/4 NAILS	(2) 16d nails @ 24" o.c.	72	46
	Level 2	(1) Sided, Wood Structural Panels - S1 - 15/32" 10d Nail, 6" Edge fastening	(2) 2x4	MSTC28 (16) .148 x 3 1/4 NAILS	(2) 16d nails @ 24" o.c.	125	100
	Level 1	(1) Sided, Wood Structural Panels - S1 - 15/32" 10d Nail, 6" Edge fastening	(2) 2x4	HDU2-SDS2.5 (14) 1/4"Øx2-1/2"SDS Screws 5/8"Ø Anchor Rod 8" Embed	(1) HILTI KH-EZ 3/8"Øx 6" @ 24" o.c.	176	126
SW6	Level 3	(1) Sided, Wood Structural Panels - S1 - 15/32" 10d Nail, 6" Edge fastening	(2) 2x6	MSTC28 (16) .148 x 3 1/4 NAILS	(2) 16d nails @ 24" o.c.	67	137
	Level 2	(1) Sided, Wood Structural Panels - S1 - 15/32" 10d Nail, 6" Edge fastening	(2) 2x6	MST60 (46) .162 x 2 1/2 NAILS	(2) 16d nails @ 12" o.c.	107	298
	Level 1	(

NOTICE:
McClure Engineering Co. is not responsible or liable for any issues, claims, damages, or losses (collectively, "Losses") which arise from failure to follow these Plans, Specifications, and the engineering intent they convey, or for Losses which arise from failure to obtain and/or follow the engineers' or surveyors' guidance with respect to any alleged errors, omissions, inconsistencies, ambiguities, or conflicts contained within the Plans or Specifications.

TENNESSEE CERTIFICATE OF AUTHORITY
NO. 8231

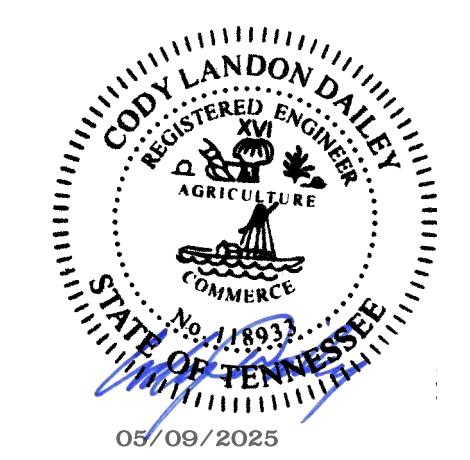

CODY L. DAILEY
118933
EXP: 2/28/2026

I HEREBY CERTIFY THAT THIS ENGINEERING DOCUMENT WAS PREPARED BY ME OR UNDER MY DIRECT PERSONAL SUPERVISION AND THAT I AM A FULLY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF TENNESSEE.


No.	PERMIT SET	Description	Date
00			05/09/2025

PROJECT NUMBER
2024002664
SET ISSUE DATE
05/09/2025

ENGINEER
DRAWN BY
CAS
CHECKED BY
CAS
JTB

**JONES GILLAM RENZ
COBALT CIRCLE
BROWNSVILLE, TENNESSEE**

Autodesk Docs://202402664 - JGR_Cobalt Circle/202402664 - JGR_Cobalt Circle R24.M

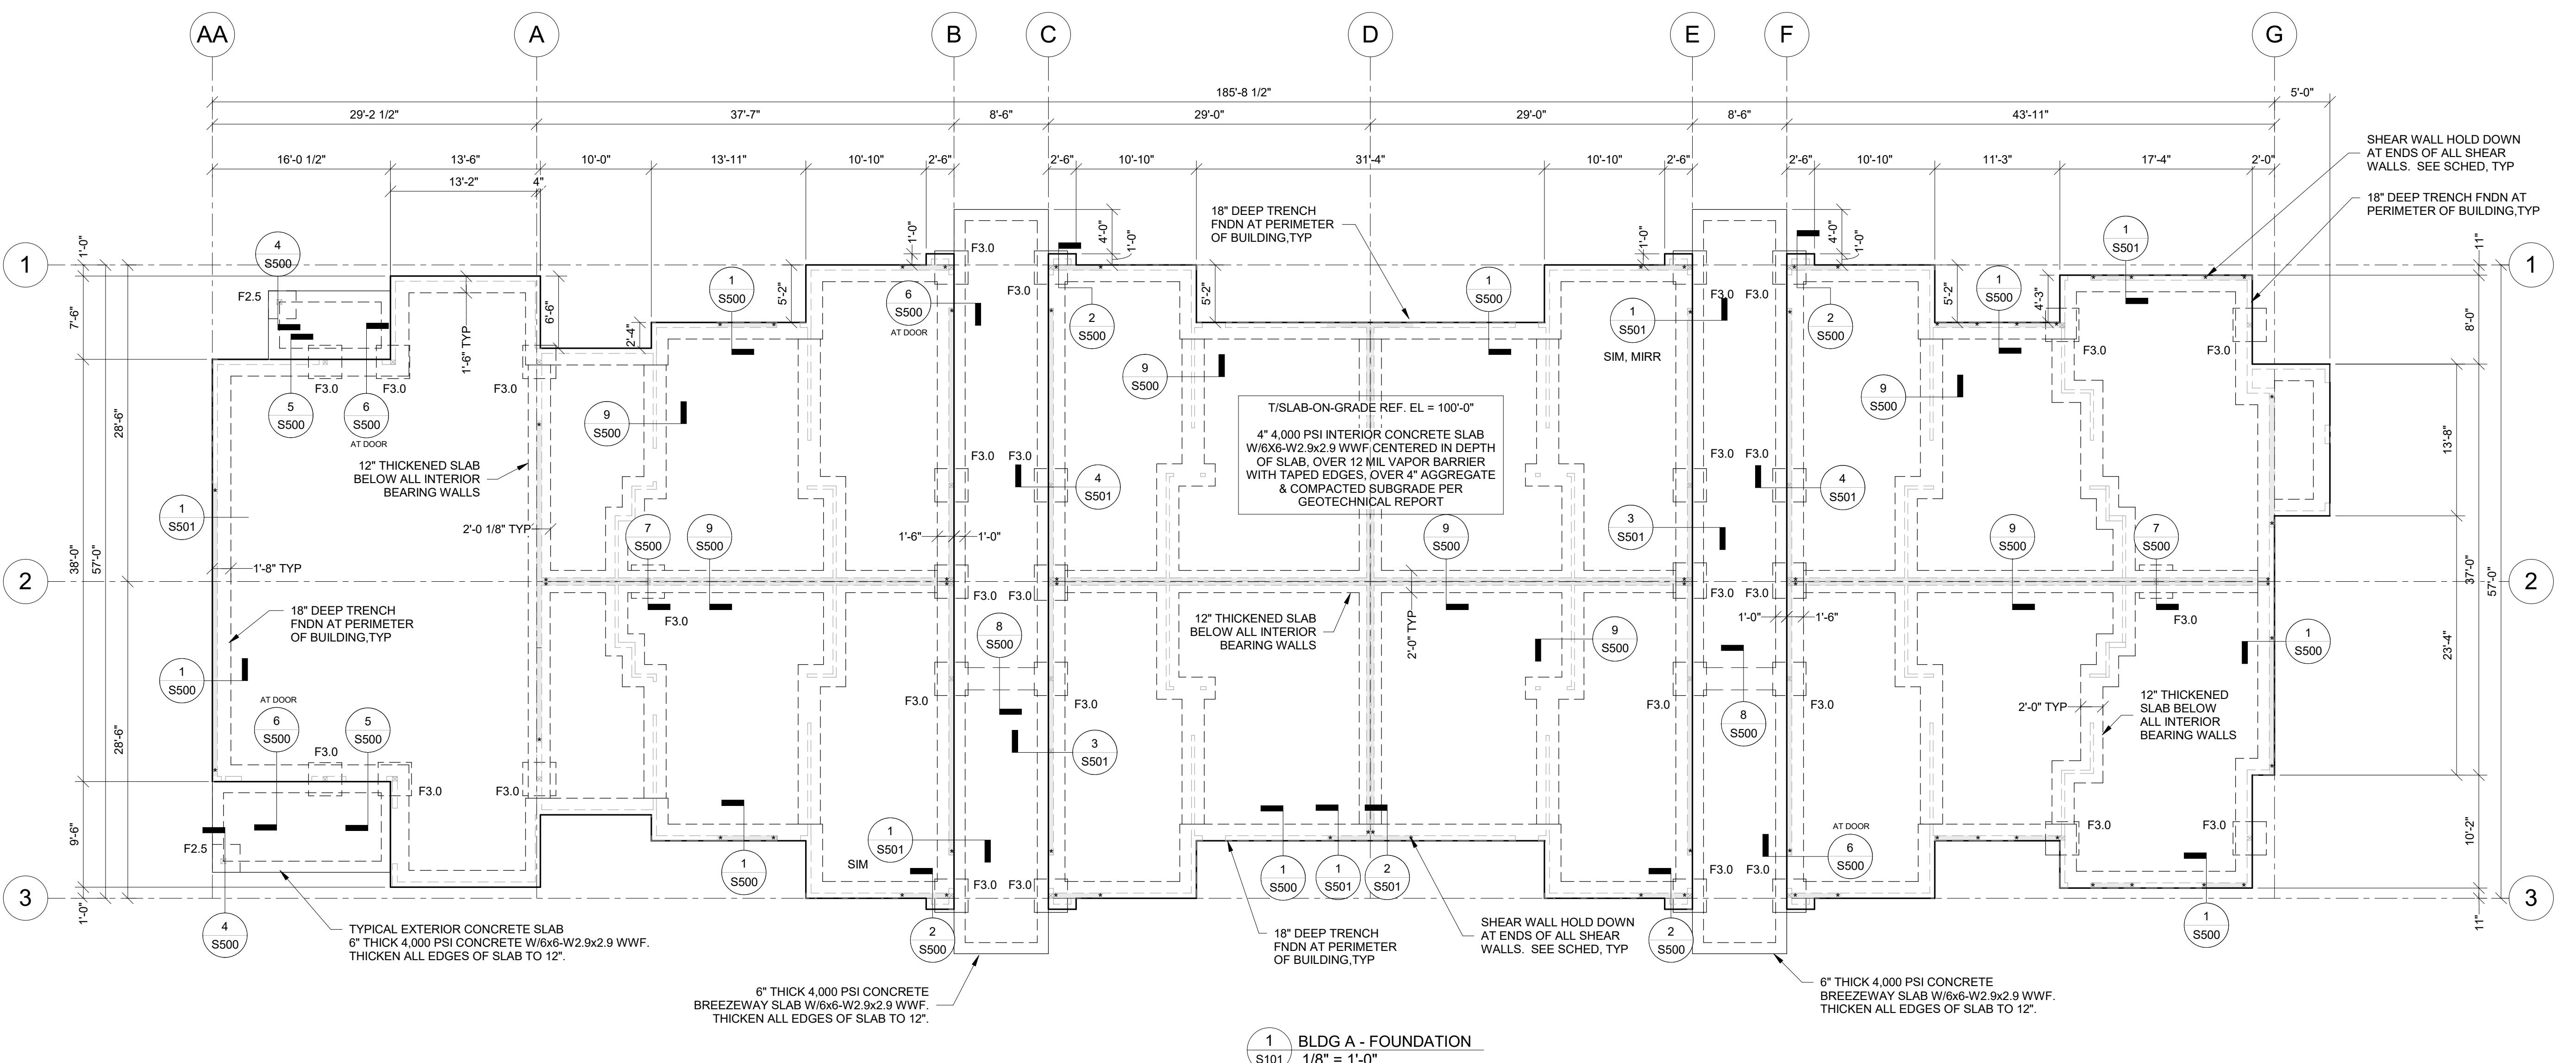

FOUNDATION PLAN NOTES:

- SEE ARCHITECTURAL DRAWINGS FOR SITE PLAN BENCHMARK ELEVATION. FOR REFERENCE ELEVATIONS, SEE BELOW (VERIFY ALL ELEVATIONS AND DIMENSIONS WITH ARCHITECTURAL DRAWINGS)
- PROVIDE CONTROL JOINTS IN SLAB ON GRADE PER DETAIL 10/S500 AND PER GENERAL NOTES.
- COORDINATE PLUMBING FIXTURES AND FLOOR DRAINS WITH ARCH. & MEP DRAWINGS.
- ALL EXTERIOR AND INTERIOR LOAD BARING WALLS ARE PER WALL SCHEDULE ON SHEET S003. SEE ARCHITECTURAL FLOOR PLAN FOR NON-BEARING WALLS AND ALL DOOR AND WINDOW SIZES AND LOCATIONS.
- REFER TO MANUFACTURER'S GUIDELINES FOR INSTALLATION OF STRAP TIES, HOLD DOWNS & OTHER CONNECTIONS. SEE SHEET S500 & S501 FOR DETAILS.

FOUNDATION SCHEDULE		
Mark	Size	Reinforcing
F2.5	2'-6"x2'-6"x1'-0"	(3) #4 BARS Top & Bottom (Each Way)
F3.0	3'-0"x3'-0"x1'-0"	(3) #4 BARS Top & Bottom (Each Way)

Notes:
1. All footings must be centered on walls and columns U.N.O.

DRAWING NO.
S101

2001 W Broadway
Columbia, MO 65203
P 573-814-1568

Architectural floor plan for Building A, Level 2, showing structural details for roof trusses, floor joists, and shear walls. The plan includes sections AA, A, B, C, D, E, F, and G. Key structural components include:

- Roof Trusses:** SHAPED ROOF TRUSSES PER MFR @ 24" O.C. TYP and 16" DEEP FLOOR TRUSSES PER MFR @ 24" O.C. TYP.
- Sheathing:** ROOF TRUSS SHEATHING SHALL RUN PERPENDICULAR TO TRUSSES. WHEN TRUSSES DO NOT RUN WITH SLOPE, LOWER TOP CHORD 1 1/2" AND RUN 2x4 PURLINS 24" O.C. FOR SHEATHING SUPPORT, TYP.
- Shear Walls:** Solid shade indicates ROOF TRUSS OVERBUILD, TYP. Note: SHEAR WALL END POSTS ARE IN ADDITION TO HEADER POSTS, KINGS, AND JACKS, TYP.
- Joists:** 2x12 @ 16" O.C. TYP and 2x12 @ 16" O.C. TYP.
- Header Beams:** HB (Header Beam) and HA (Header Joist) are shown throughout the plan.
- Columns:** S521, S510, S511, S505, and S512 are labeled as support columns.
- Bracing:** HT (Hip Truss) and SW (Shear Wall) are indicated at various points.
- Dimensions:** 1/8" = 1'-0" is indicated at the bottom right.

FRAMING PLAN LEGEND:


- [H?]** HEADER PER SCHEDULE
- [SW#]** SHEAR WALL TYPE, SHEAR WALL INDICATED BY
- F.F.** FINISHED FLOOR

PLAN NOTES:

1. SEE ARCHITECTURAL DRAWINGS FOR SITE PLAN BENCHMARK ELEVATION. FOR REFERENCE ELEVATIONS, SEE BELOW (VERIFY ALL ELEVATIONS AND DIMENSIONS WITH ARCHITECTURAL DRAWINGS)
 - T.O. SLAB-ON-GRADE: 100'-0"
 - LEVEL 2 F.F. : 110'-5 7/8"
 - LEVEL 3 F.F. : 120'-11 3/4"
 - TRUSS BRG: 130'-0 7/8"
2. FLOOR SHEATHING: 15/32" STRUCTURAL GRADE PLYWOOD. FASTEN TO FRAMING W/ 10d COMMON NAILS SPACED 6" O.C. AT EDGES, 12" O.C. WITHIN FIELD.
3. ROOF SHEATHING: 15/32" STRUCTURAL GRADE PLYWOOD. FASTEN TO FRAMING W/ 10d COMMON NAILS SPACED 6" O.C. AT EDGES, 12" O.C. WITHIN FIELD.
4. COORDINATE PLUMBING FIXTURES, SHAFTS, AND FLOOR DRAINS WITH ARCH. & MEP DRAWINGS.
5. ALL EXTERIOR AND INTERIOR LOAD BEARING WALLS ARE PER WALL SCHEDULE ON SHEET S003. SEE ARCHITECTURAL FLOOR PLAN FOR NON-BEARING WALL, DOOR, AND WINDOW LOCATIONS.
6. FLOOR PLAN SHOWS FRAMING FOR THE FLOOR INDICATED & VERTICAL FRAMING (WALLS, HEADERS, POSTS, COLUMNS) SUPPORTING THAT FLOOR.
7. SEE ARCHITECTURAL DRAWINGS FOR ALL RAILING DETAILS. REFER TO GENERAL NOTES FOR DESIGN CRITERIA.
8. REFER TO MANUFACTURER'S GUIDELINES FOR INSTALLATION OF STRAP TIES, HOLD DOWNS & OTHER CONNECTIONS.
9. ALL EXTERIOR LUMBER (POSTS, BEAMS, DECKING, ETC.) TO BE TREATED.
10. WOOD FLOOR TRUSSES TO BE DESIGNED BY MANUFACTURER AND ARE SHOWN FOR THE INTENT OF SPAN DIRECTION AND LOAD PATH ONLY. REFER TO GENERAL NOTES FOR DESIGN CRITERIA. REFER TO SHEAR WALL SCHEDULE FOR DRAG LOADS.
11. TRUSS MANUFACTURER TO DESIGN & PROVIDE GIRDER TRUSSES AT ALL FLOOR OPENINGS & SPECIFY HANGERS FOR GIRDERS & SUPPORTED FRAMING.
12. REFER TO ARCHITECTURAL PLANS FOR STAIR DIMENSIONS AND REQUIREMENTS. REFER TO STRUCTURAL GENERAL NOTES FOR STAIR DESIGN CRITERIA.
13. COLUMN FRAMING MAY BE USED IN LIEU OF SHEAR WALL END POST FRAMING AT END OF SHEAR WALLS.

JONES GILLAM RENZ COBALT CIRCLE

BI DG A - I EVEI 2 PI AN

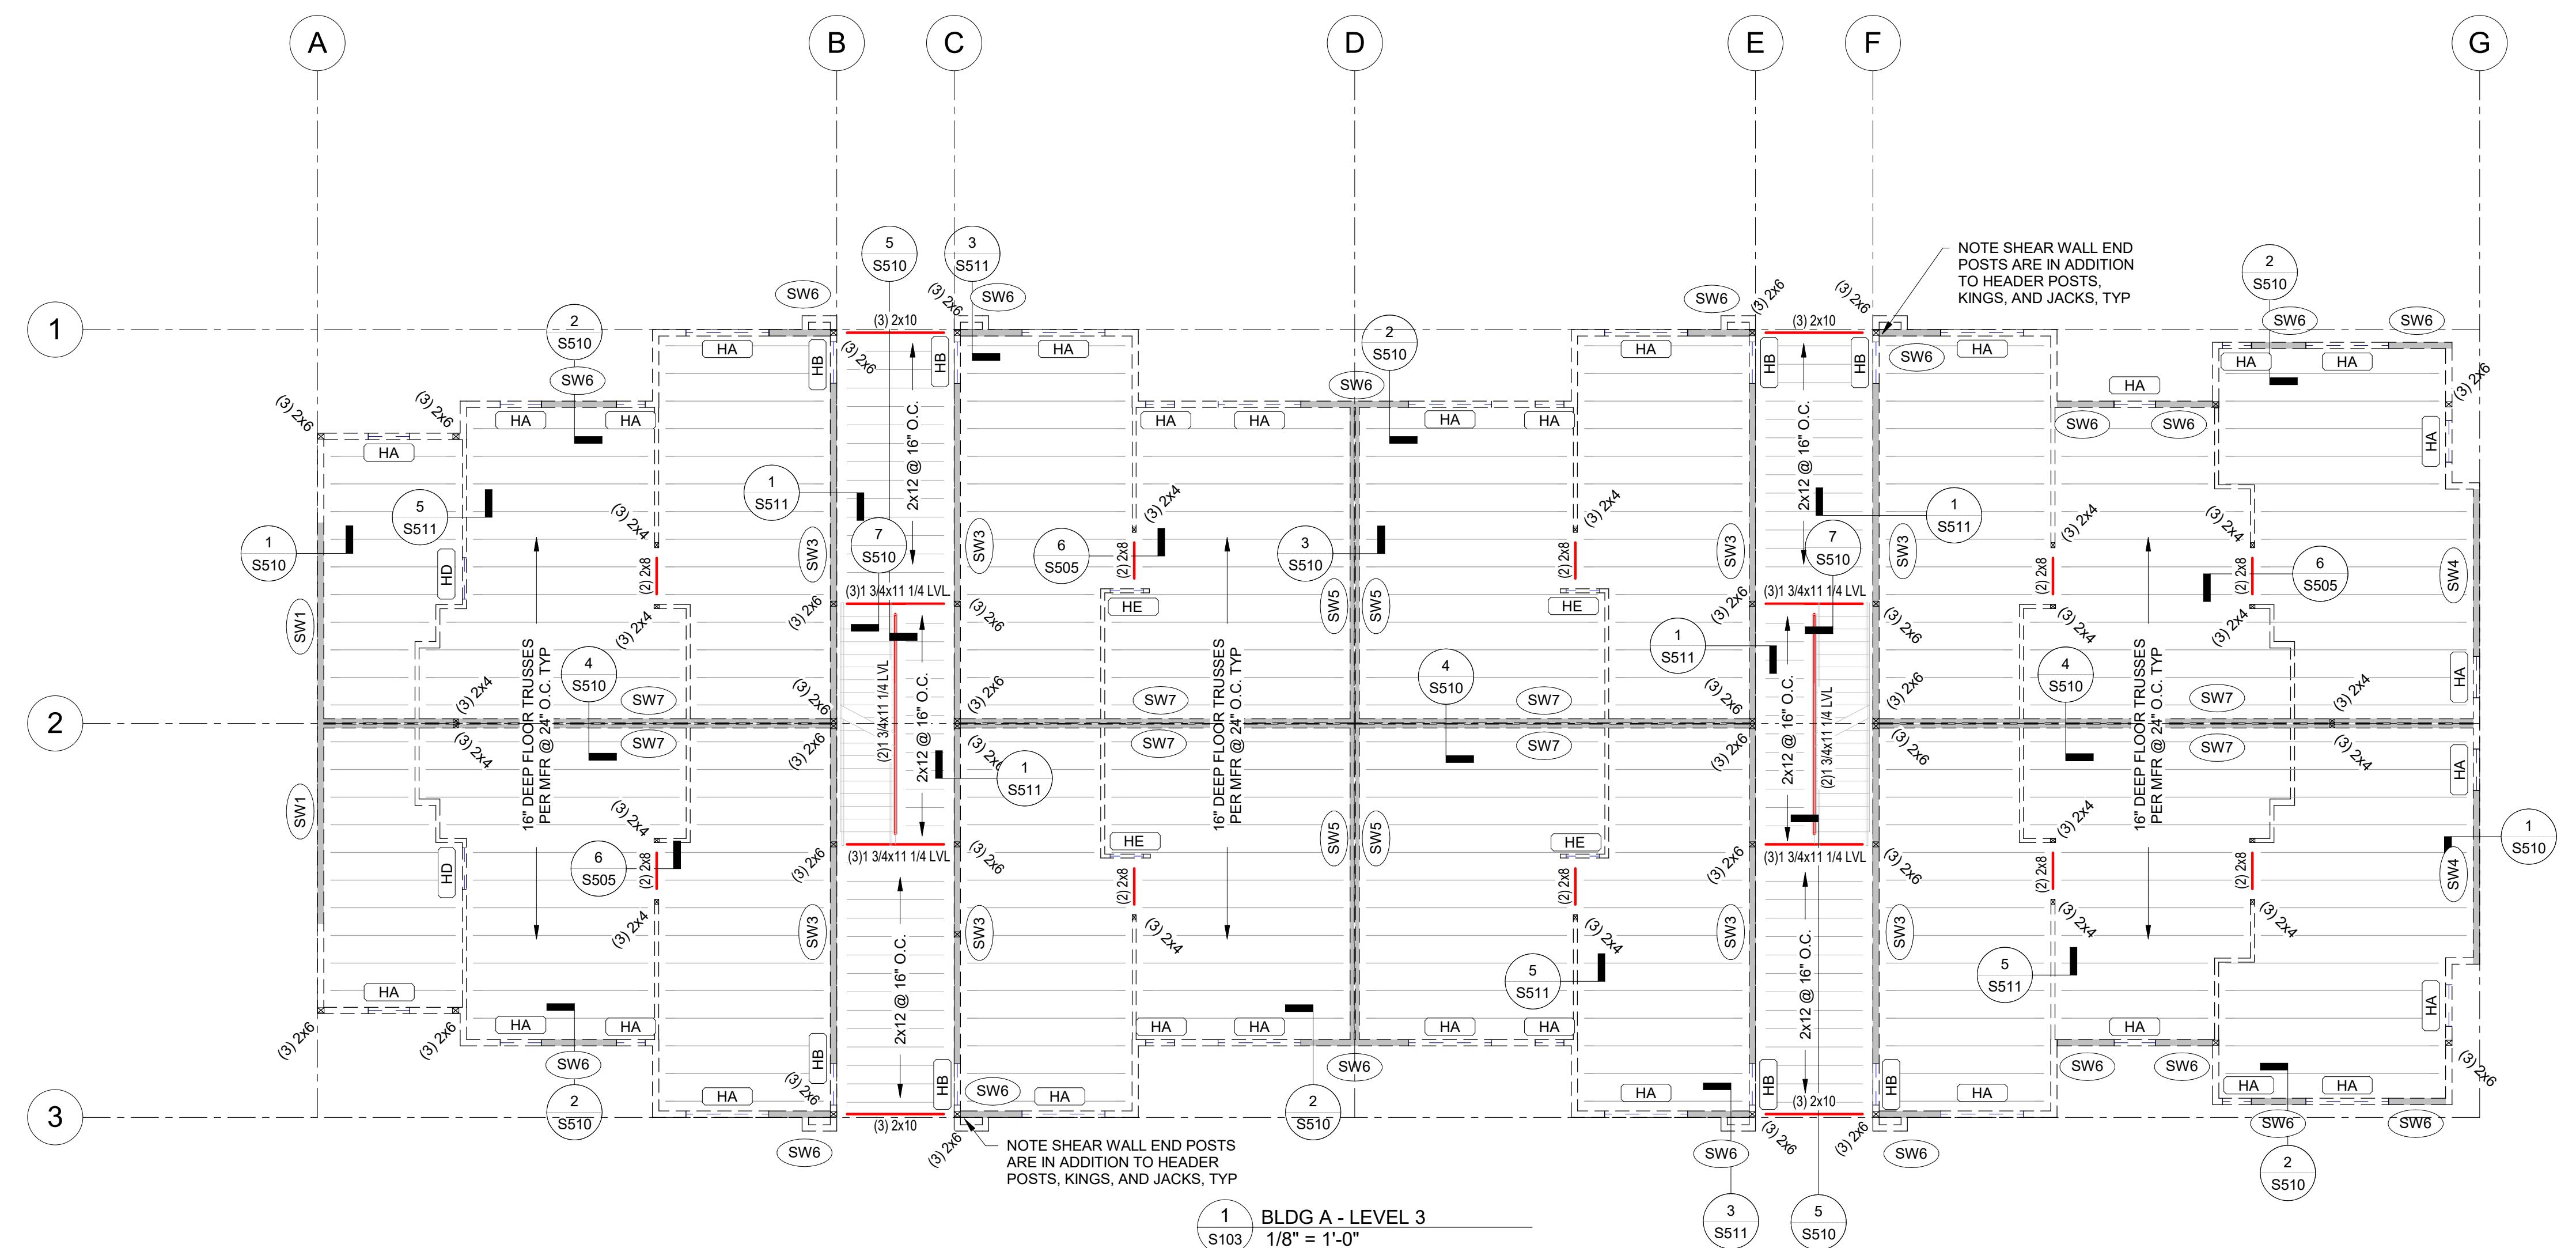

FRAMING PLAN LEGEND:


- (H#)** HEADER PER SCHEDULE
- (SW#)** SHEAR WALL TYPE, SHEAR WALL INDICATED BY 
- F.F.** FINISHED FLOOR

JONES GILLAM RENZ
COBALT CIRCLE
BROWNSVILLE, TENNESSEE

BLDG A - LEVEL 3 PLAN

Autodesk DocId:202402664 - JGR_CobaltCircle202402664_JGR_COBALT CIRCLE R24.M

DRAWING NO.
S103

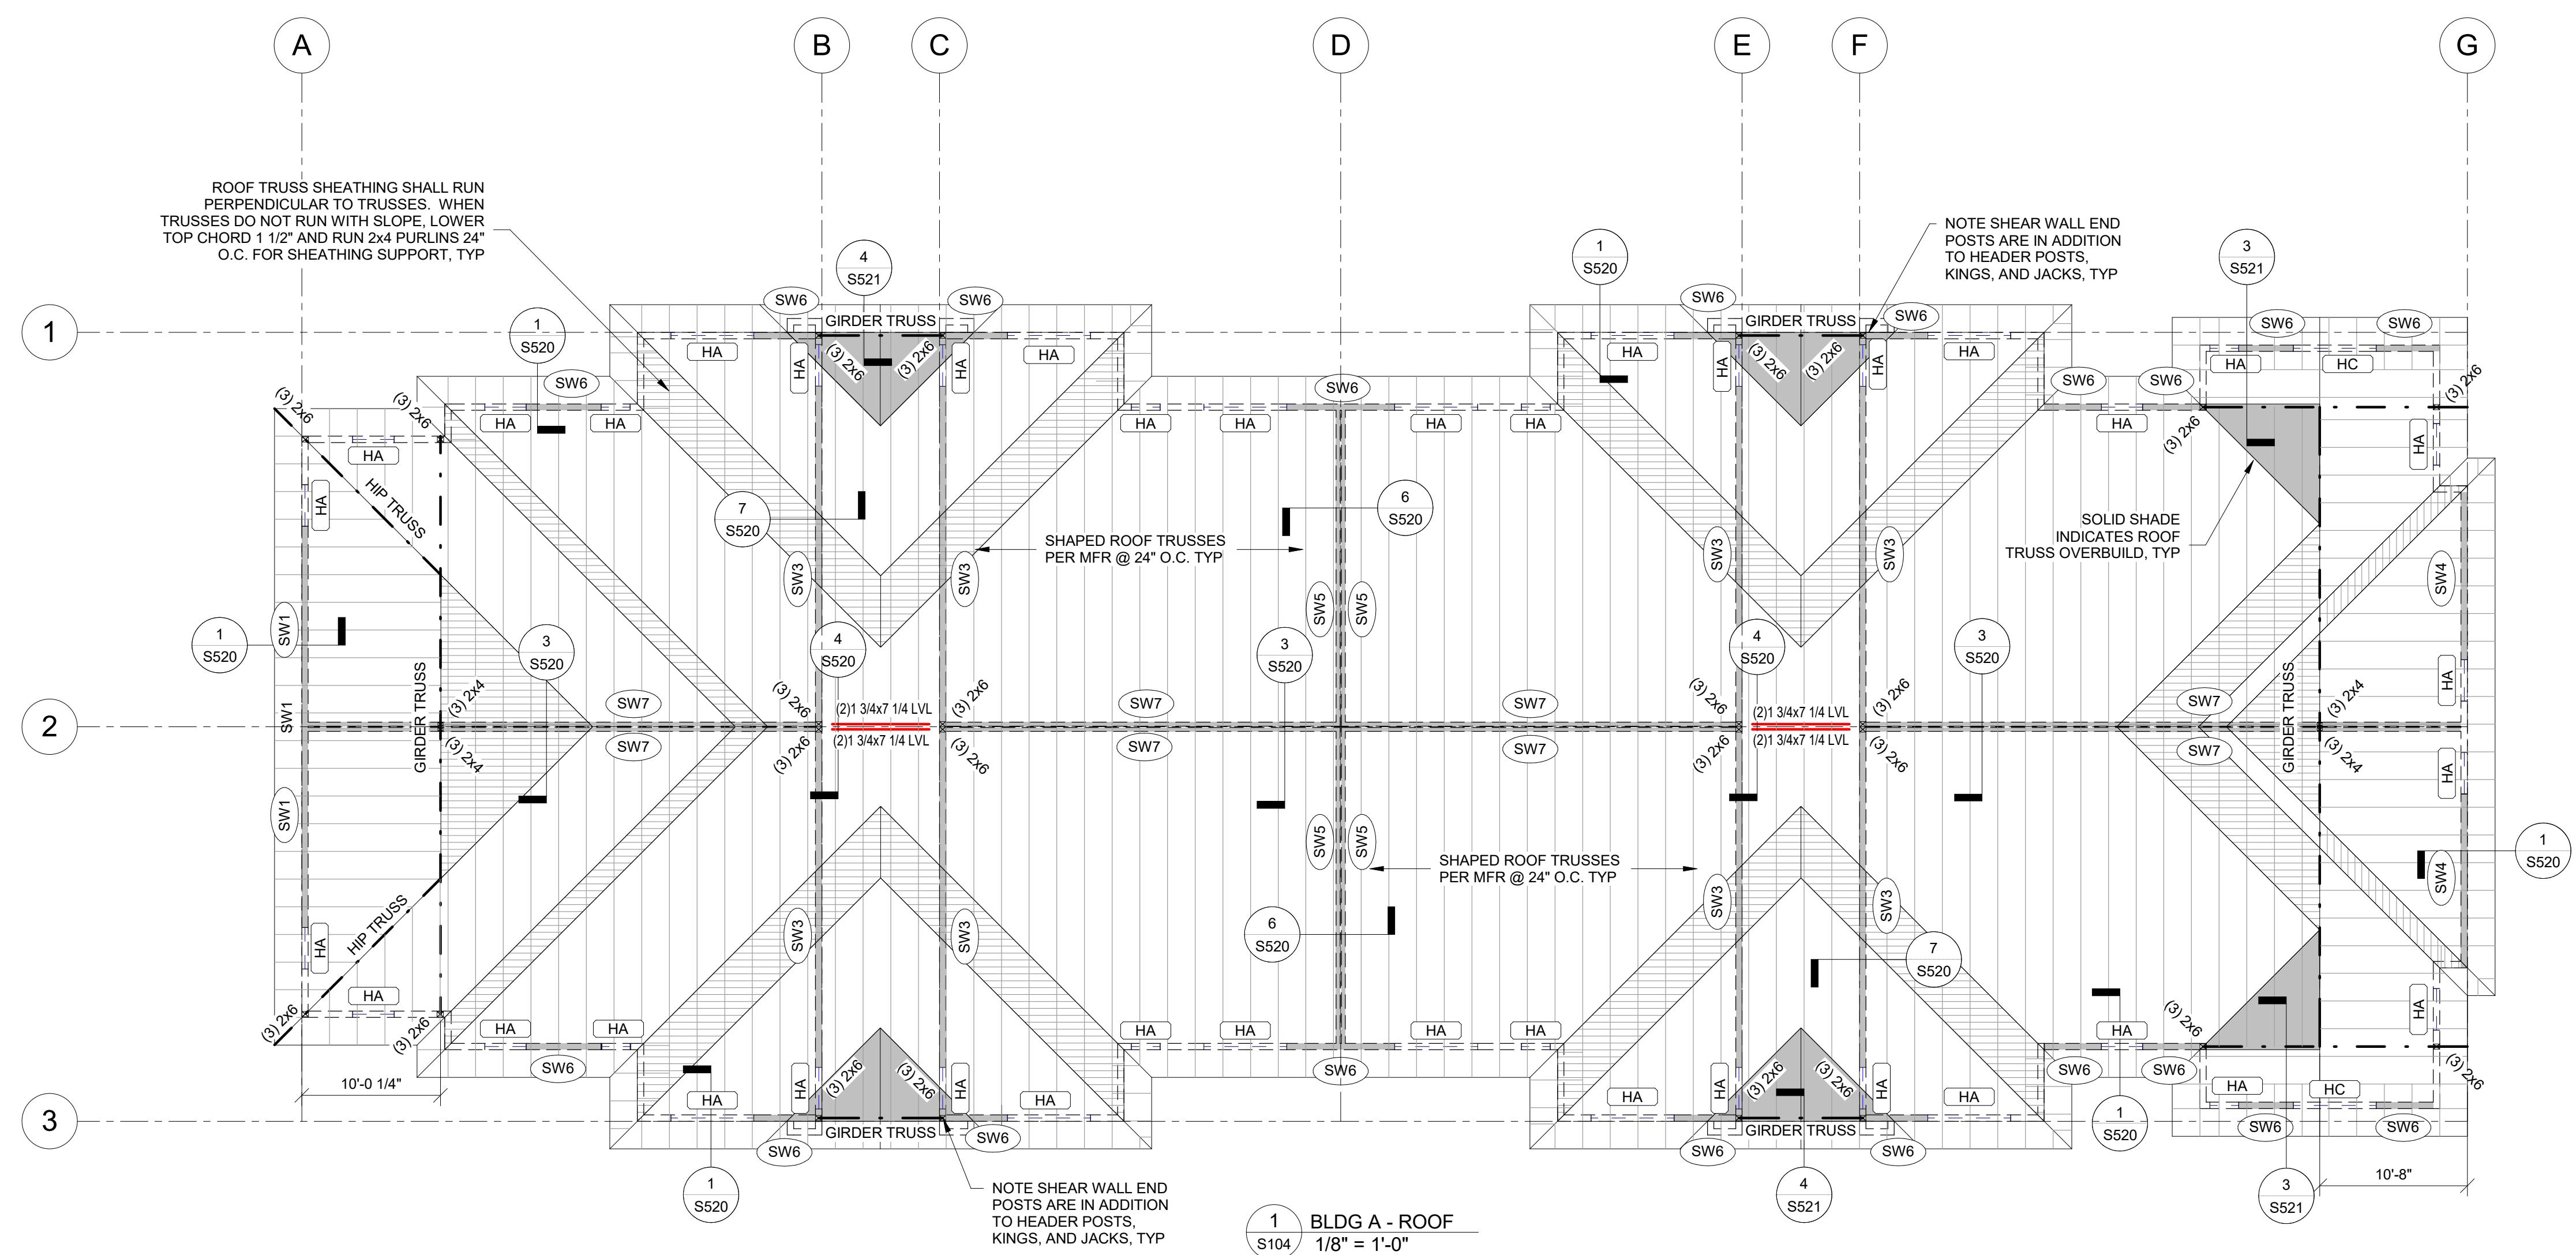

ROOF PLAN NOTES:

1. SEE ARCHITECTURAL DRAWINGS FOR SITE PLAN BENCHMARK ELEVATION. FOR REFERENCE ELEVATION, SEE BELOW (VERIFY ALL ELEVATIONS AND DIMENSIONS WITH ARCHITECTURAL DRAWINGS):

- * TOP SLAB ON GRADE 100'-0"
- * LEVEL 2 F. 110'-5 7/8"
- * LEVEL 3 F. 120'-5 11 3/4"
- * ROOF TRUSS BEARING 130'-0 7/8"

2. ROOF SHEATHING: 15/32" STRUCTURAL GRADE PLYWOOD FASTENED TO ROOF TRUSSES W/ 10d COMMON NAILS SPACED 6" O.C. AT EDGES, 12" O.C. WITHIN THE FIELD.

3. RTU PENETRATIONS TO BE COORDINATED W/ ARCH. & MEP DRAWINGS.

4. REFER TO MANUFACTURER'S GUIDELINES FOR INSTALLATION OF STRAP TIES, HOLD DOWNS AND OTHER CONNECTIONS.

5. ALL EXTERIOR LUMBER (POSTS, BEAMS, DECKING, ETC.) TO BE TREATED.

6. WOOD ROOF TRUSSES (DESIGN PER MANUFACTURER) ARE SHOWN FOR THE INTENT OF SPAN REDUCTION. REFER TO MANUFACTURER'S SPECIFICATIONS FOR DESIGN CRITERIA. REFER TO SHEAR WALL SCHEDULE FOR DRAUL LOADS.

7. TRUSS MANUFACTURER TO DESIGN & PROVIDE GIRDERS TRUSSES AT ALL OPENINGS AND LOCATIONS SHOWN ON PLAN & SPECIFY HANGERS FOR GIRDERS & SUPPORTED FRAMING WHERE REQUIRED.

FRAMING PLAN LEGEND:

(H#) HEADER PER SCHEDULE

(SW#) SHEAR WALL TYPE, SHEAR WALL INDICATED BY


F.F. FINISHED FLOOR

JONES GILLAM RENZ
COBALT CIRCLE
BROWNSVILLE, TENNESSEE

BLDG A - ROOF PLAN

Autodesk Docs/202402664 - JGR_Cobalt Circle/202402664 - JGR - COBALT CIRCLE R24.M

2001 W Broadway
Columbia, MO 65203
P 573-814-1568

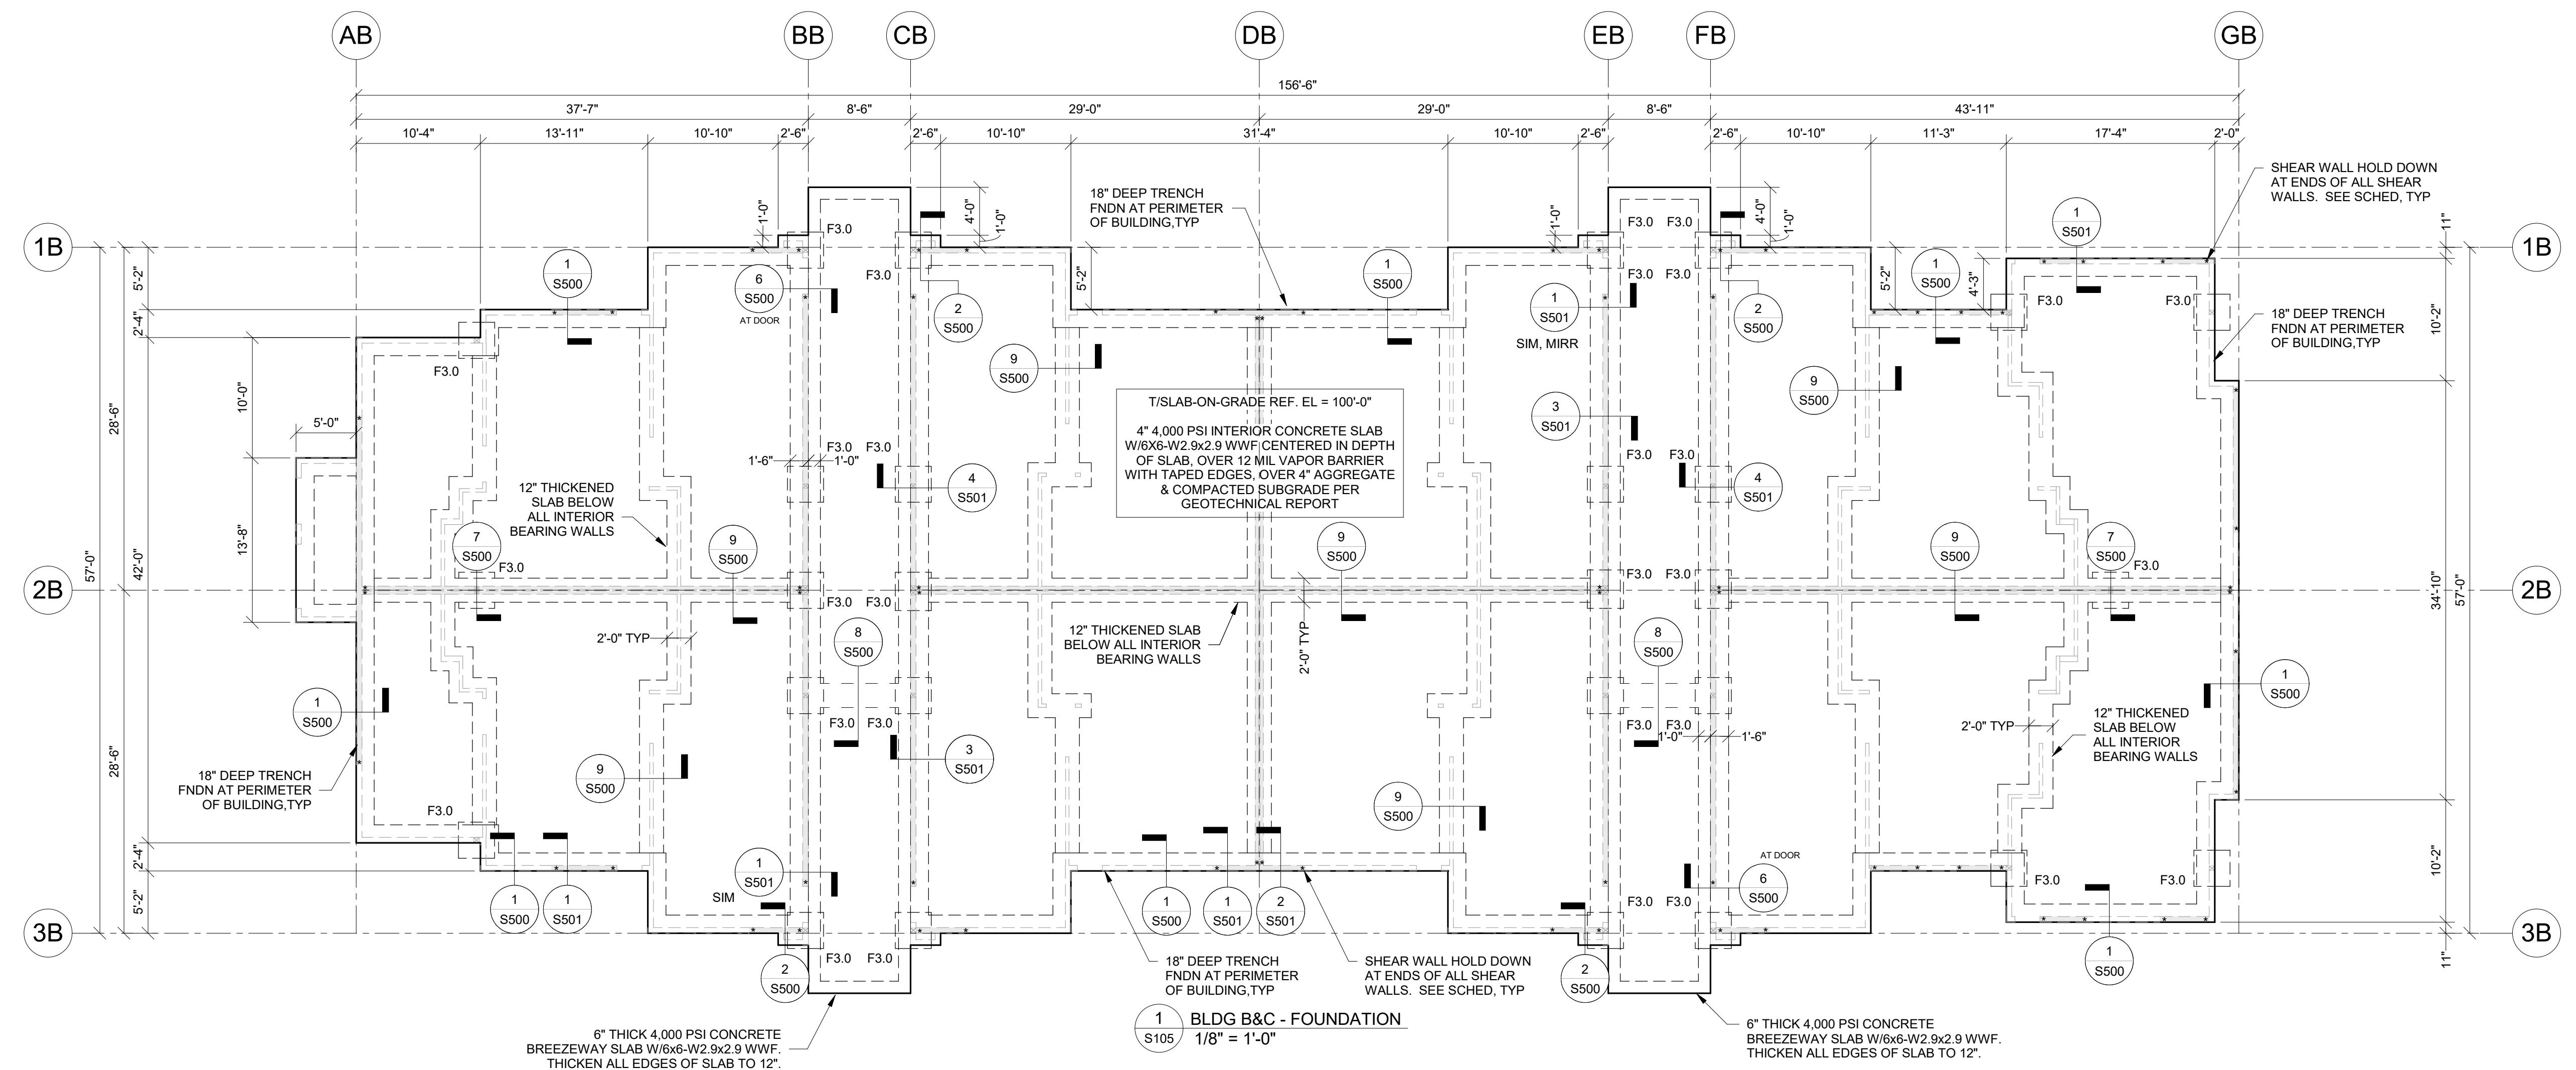

FOUNDATION PLAN NOTES:

SEE ARCHITECTURAL DRAWINGS FOR SITE PLAN BENCHMARK ELEVATION. FOR REFERENCE ELEVATIONS, SEE BELOW (VERIFY ALL ELEVATIONS AND DIMENSIONS WITH ARCHITECTURAL DRAWINGS)

- T.O. SLABE-ON-GRADE: 100'-0"

PROVIDE CONTROL JOINTS IN SLAB ON GRADE PER DETAIL 10/S500 AND PER GENERAL NOTES.

COORDINATE PLUMBING FIXTURES AND FLOOR DRAINS WITH ARCH. & MEP DRAWINGS.

ALL EXTERIOR AND INTERIOR LOAD BARING WALLS ARE PER WALL SCHEDULE ON SHEET S003. SEE ARCHITECTURAL FLOOR PLAN FOR NON-BEARING WALLS AND ALL DOOR AND WINDOW SIZES AND LOCATIONS.

REFER TO MANUFACTURER'S GUIDELINES FOR INSTALLATION OF STRAP TIES, HOLD DOWNS & OTHER CONNECTIONS.

SEE SHEET S500 & S501 FOR DETAILS

FOUNDATION SCHEDULE		
Mark	Size	Reinforcing
F2.5	2'-6" x 2'-6" x 1'-0"	(3) #4 BARS Top & Bottom (Each Way)
F3.0	3'-0" x 3'-0" x 1'-0"	(3) #4 BARS Top & Bottom (Each Way)

Notes:
All footings must be centered on walls and columns U.N.O.

JONES GILLAM RENZ COBALT CIRCLE

BLDG B&C - FOUNDATION PLAN

Autodesk Docs://20240026664 - [GB - Cobalt Circle/20240026664 - [GB - COBALT CIRCLE B24 nt



2001 W Broadway
Columbia, MO 65203
P 573-814-1568

1B

2B

3B

AB

BB

CB

DB

EB

FB

GB

NOTE SHEAR WALL END POSTS ARE IN ADDITION TO HEADER POSTS, KINGS, AND JACKS, TYP

16" DEEP FLOOR TRUSSES PER MFR @ 24" O.C. TYP

NOTE SHEAR WALL END POSTS ARE IN ADDITION TO HEADER POSTS, KINGS, AND JACKS, TYP

BLDG B&C - LEVEL 2

S106 1/8" = 1'-0"

PLAN NOTES:

1. SEE ARCHITECTURAL DRAWINGS FOR SITE PLAN BENCHMARK ELEVATION. FOR REFERENCE ELEVATIONS, SEE BELOW (VERIFY ALL ELEVATIONS AND DIMENSIONS WITH ARCHITECTURAL DRAWINGS)
 - T.O. SLAB-ON-GRADE: 100'-0"
 - LEVEL 2 F.F. : 110'-5 7/8"
 - LEVEL 3 F.F. : 120'-11 3/4"
 - TRUSS BRG: 130'-0 7/8"
2. FLOOR SHEATHING: 15/32" STRUCTURAL GRADE PLYWOOD. FASTEN TO FRAMING W/ 10d COMMON NAILS SPACED 6" O.C. AT EDGES, 12" O.C. WITHIN FIELD.
3. ROOF SHEATHING: 15/32" STRUCTURAL GRADE PLYWOOD. FASTEN TO FRAMING W/ 10d COMMON NAILS SPACED 6" O.C. AT EDGES, 12" O.C. WITHIN FIELD.
4. COORDINATE PLUMBING FIXTURES, SHAFTS, AND FLOOR DRAINS WITH ARCH. & MEP DRAWINGS.
5. ALL EXTERIOR AND INTERIOR LOAD BEARING WALLS ARE PER WALL SCHEDULE ON SHEET S003. SEE ARCHITECTURAL FLOOR PLAN FOR NON-BEARING WALL, DOOR, AND WINDOW LOCATIONS.
6. FLOOR PLAN SHOWS FRAMING FOR THE FLOOR INDICATED & VERTICAL FRAMING (WALLS, HEADERS, POSTS, COLUMNS) SUPPORTING THAT FLOOR.
7. SEE ARCHITECTURAL DRAWINGS FOR ALL RAILING DETAILS. REFER TO GENERAL NOTES FOR DESIGN CRITERIA.
8. REFER TO MANUFACTURER'S GUIDELINES FOR INSTALLATION OF STRAP TIES, HOLD DOWNS & OTHER CONNECTIONS.
9. ALL EXTERIOR LUMBER (POSTS, BEAMS, DECKING, ETC.) TO BE TREATED.
10. WOOD FLOOR TRUSSES TO BE DESIGNED BY MANUFACTURER AND ARE SHOWN FOR THE INTENT OF SPAN DIRECTION AND LOAD PATH ONLY. REFER TO GENERAL NOTES FOR DESIGN CRITERIA. REFER TO SHEAR WALL SCHEDULE FOR DRAG LOADS.
11. TRUSS MANUFACTURER TO DESIGN & PROVIDE GIRDER TRUSSES AT ALL FLOOR OPENINGS & SPECIFY HANGERS FOR GIRDERS & SUPPORTED FRAMING.
12. REFER TO ARCHITECTURAL PLANS FOR STAIR DIMENSIONS AND REQUIREMENTS. REFER TO STRUCTURAL GENERAL NOTES FOR STAIR DESIGN CRITERIA.
13. COLUMN FRAMING MAY BE USED IN LIEU OF SHEAR WALL END POST FRAMING AT END OF SHEAR WALLS.

FRAMING PLAN LEGEND:

H? HEADER PER SCHEDULE
 SW# SHEAR WALL TYPE, SHEAR WALL INDICATED BY
 FF FINISHED FLOOR

JONES GILLAM RENZ COBALT CIRCLE

B| DG B&C = | EVE| 2 PI AN


BEDRÉ B&C - ELEVÉZ I ÉRÉN

DRAWING NO.
S106



MCCCLURE™

2001 W Broadway
Columbia, MO 65203
P 573-814-1568

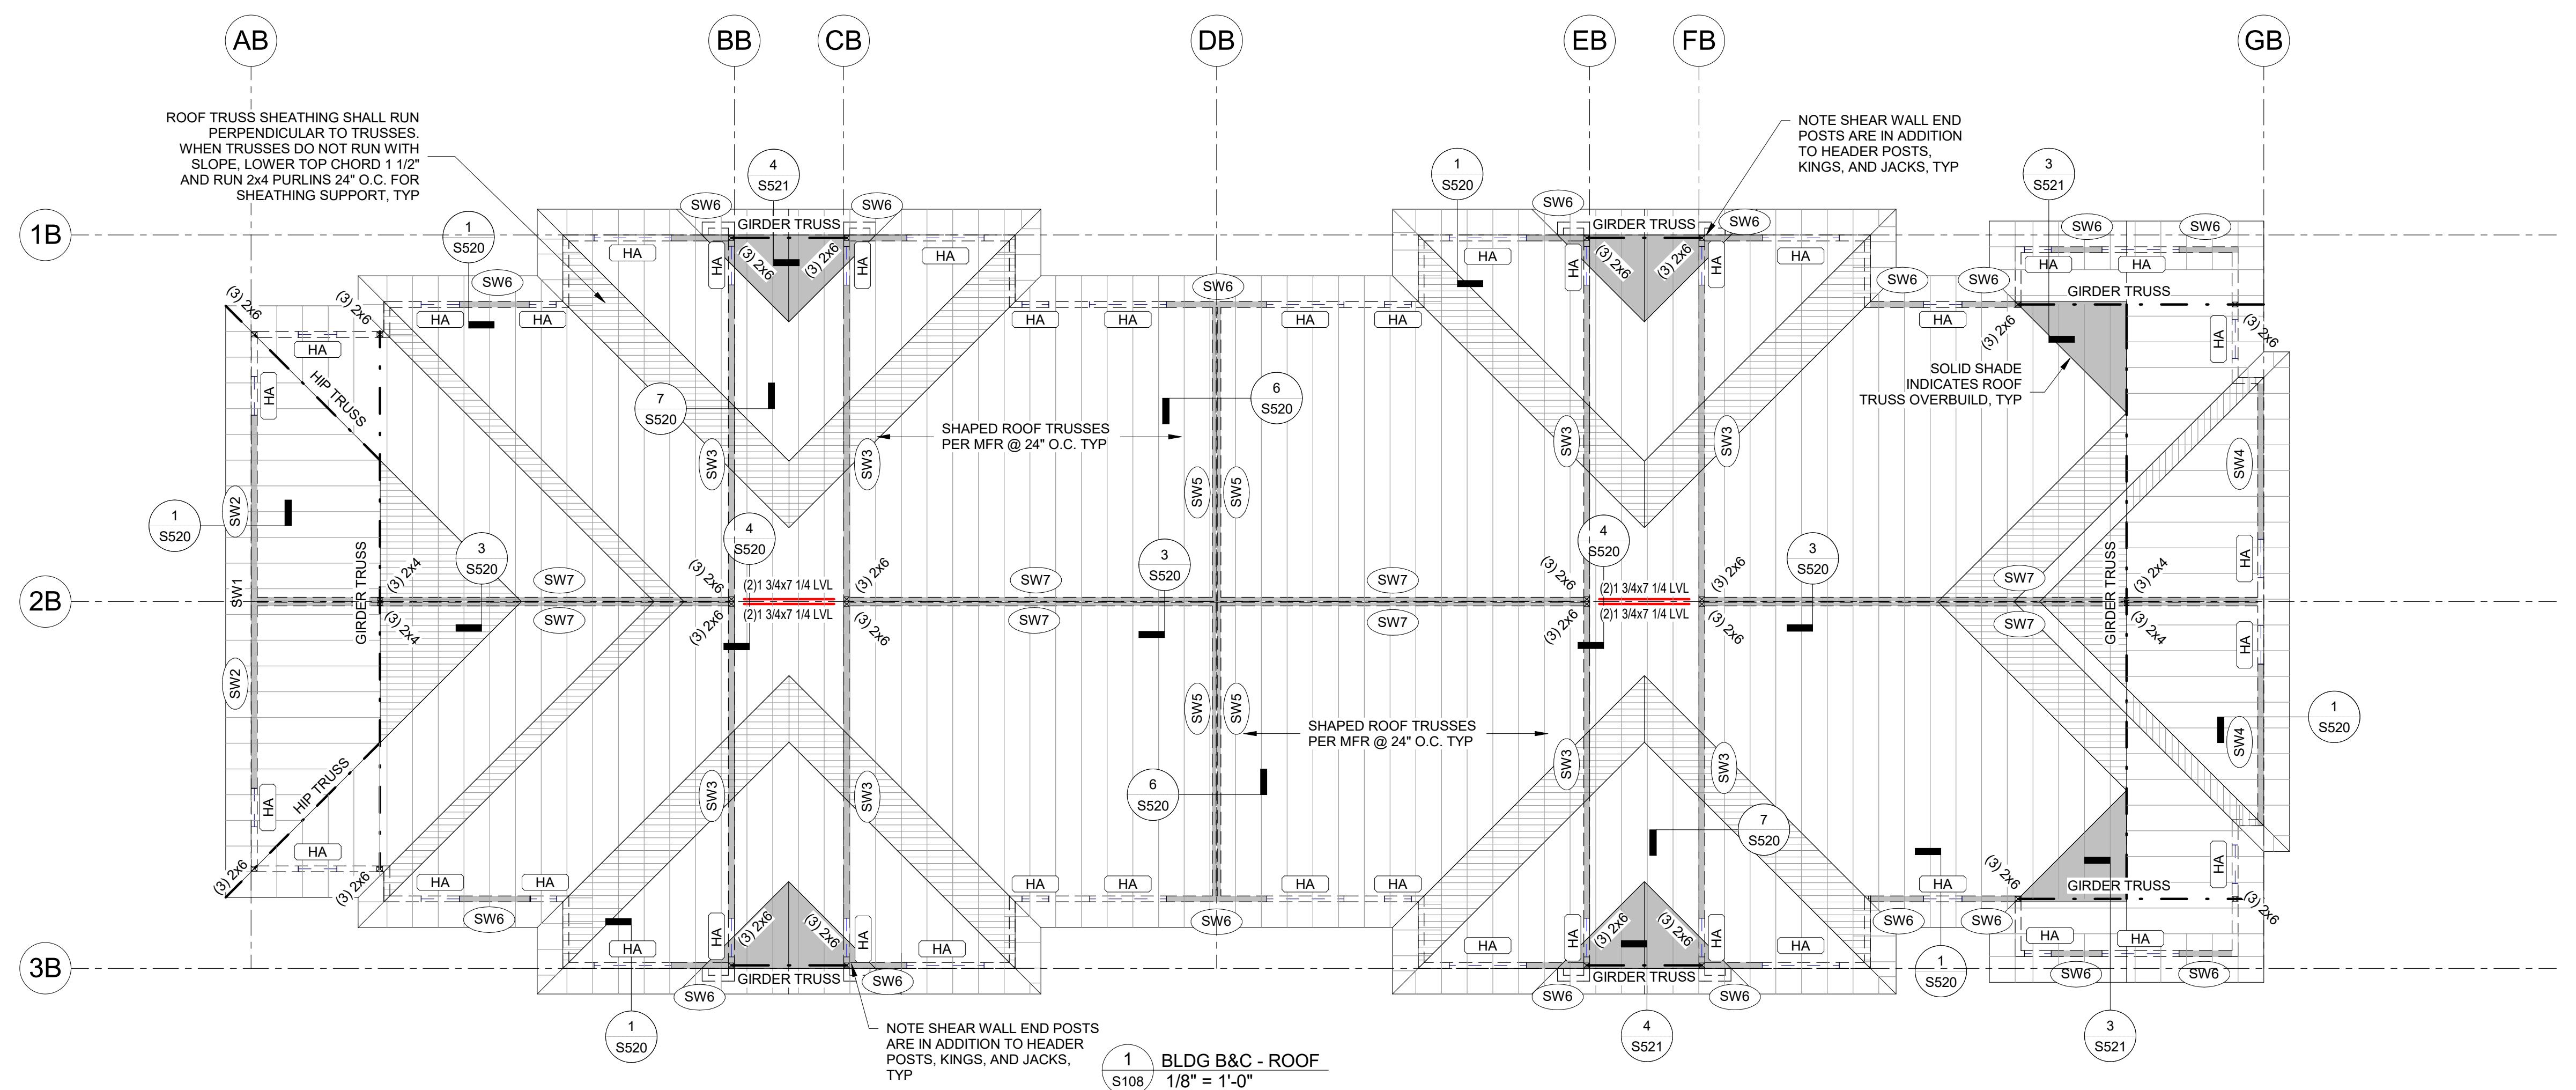

ROOF PLAN NOTES:

ROOF PLAN NOTES:

1. SEE ARCHITECTURAL DRAWINGS FOR SITE PLAN BENCHMARK ELEVATION. FOR REFERENCE ELEVATION, SEE BELOW (VERIFY ALL ELEVATIONS AND DIMENSIONS WITH ARCHITECTURAL DRAWINGS.)

* T.O. SLAB ON GRADE	100'-0"
* LEVEL 2 F.F.	110'-5 7/8"
* LEVEL 3 F.F.	120'-11 3/4"
* ROOF TRUSS BEARING	130'-0 7/8"
2. ROOF SHEATHING: 15/32" STRUCTURAL GRADE PLYWOOD FASTENED TO ROOF TRUSSES W/ 10d COMMON NAILS SPACED 6" O.C. AT EDGES, 12" O.C. WITHIN THE FIELD.
3. RTU PENETRATIONS TO BE COORDINATED W/ ARCH. & MEP DRAWINGS.
4. REFER TO MANUFACTURER'S GUIDELINES FOR INSTALLATION OF STRAP TIES, HOLD DOWNS AND OTHER CONNECTIONS.
5. ALL EXTERIOR LUMBER (POSTS, BEAMS, DECKING, ETC.) TO BE TREATED.
6. WOOD ROOF TRUSSES (DESIGN PER MANUFACTURER) ARE SHOWN FOR THE INTENT OF SPAN DIRECTION AND LOAD PATH ONLY. REFER TO GENERAL NOTES FOR DESIGN CRITERIA. REFER TO SHEAR WALL SCHEDULE FOR DRAG LOADS.
7. TRUSS MANUFACTURER TO DESIGN & PROVIDE GIRDER TRUSSES AT ALL OPENINGS AND LOCATIONS SHOWN ON PLAN & SPECIFY HANGERS FOR GIRDERS & SUPPORTED FRAMING WHERE REQUIRED.

FRAMING PLAN LEGEND:

PRIMING PLAN LEGEND:


H?	HEADER PER SCHEDULE
SW#	SHEAR WALL TYPE, SHEAR WALL INDICATED

JONES GILLAM RENZ COBALT CIRCLE

BI DG B&C - BOOE PI AN

BEDGE B&C - 1991 - 1

DRAWING NO.
S108

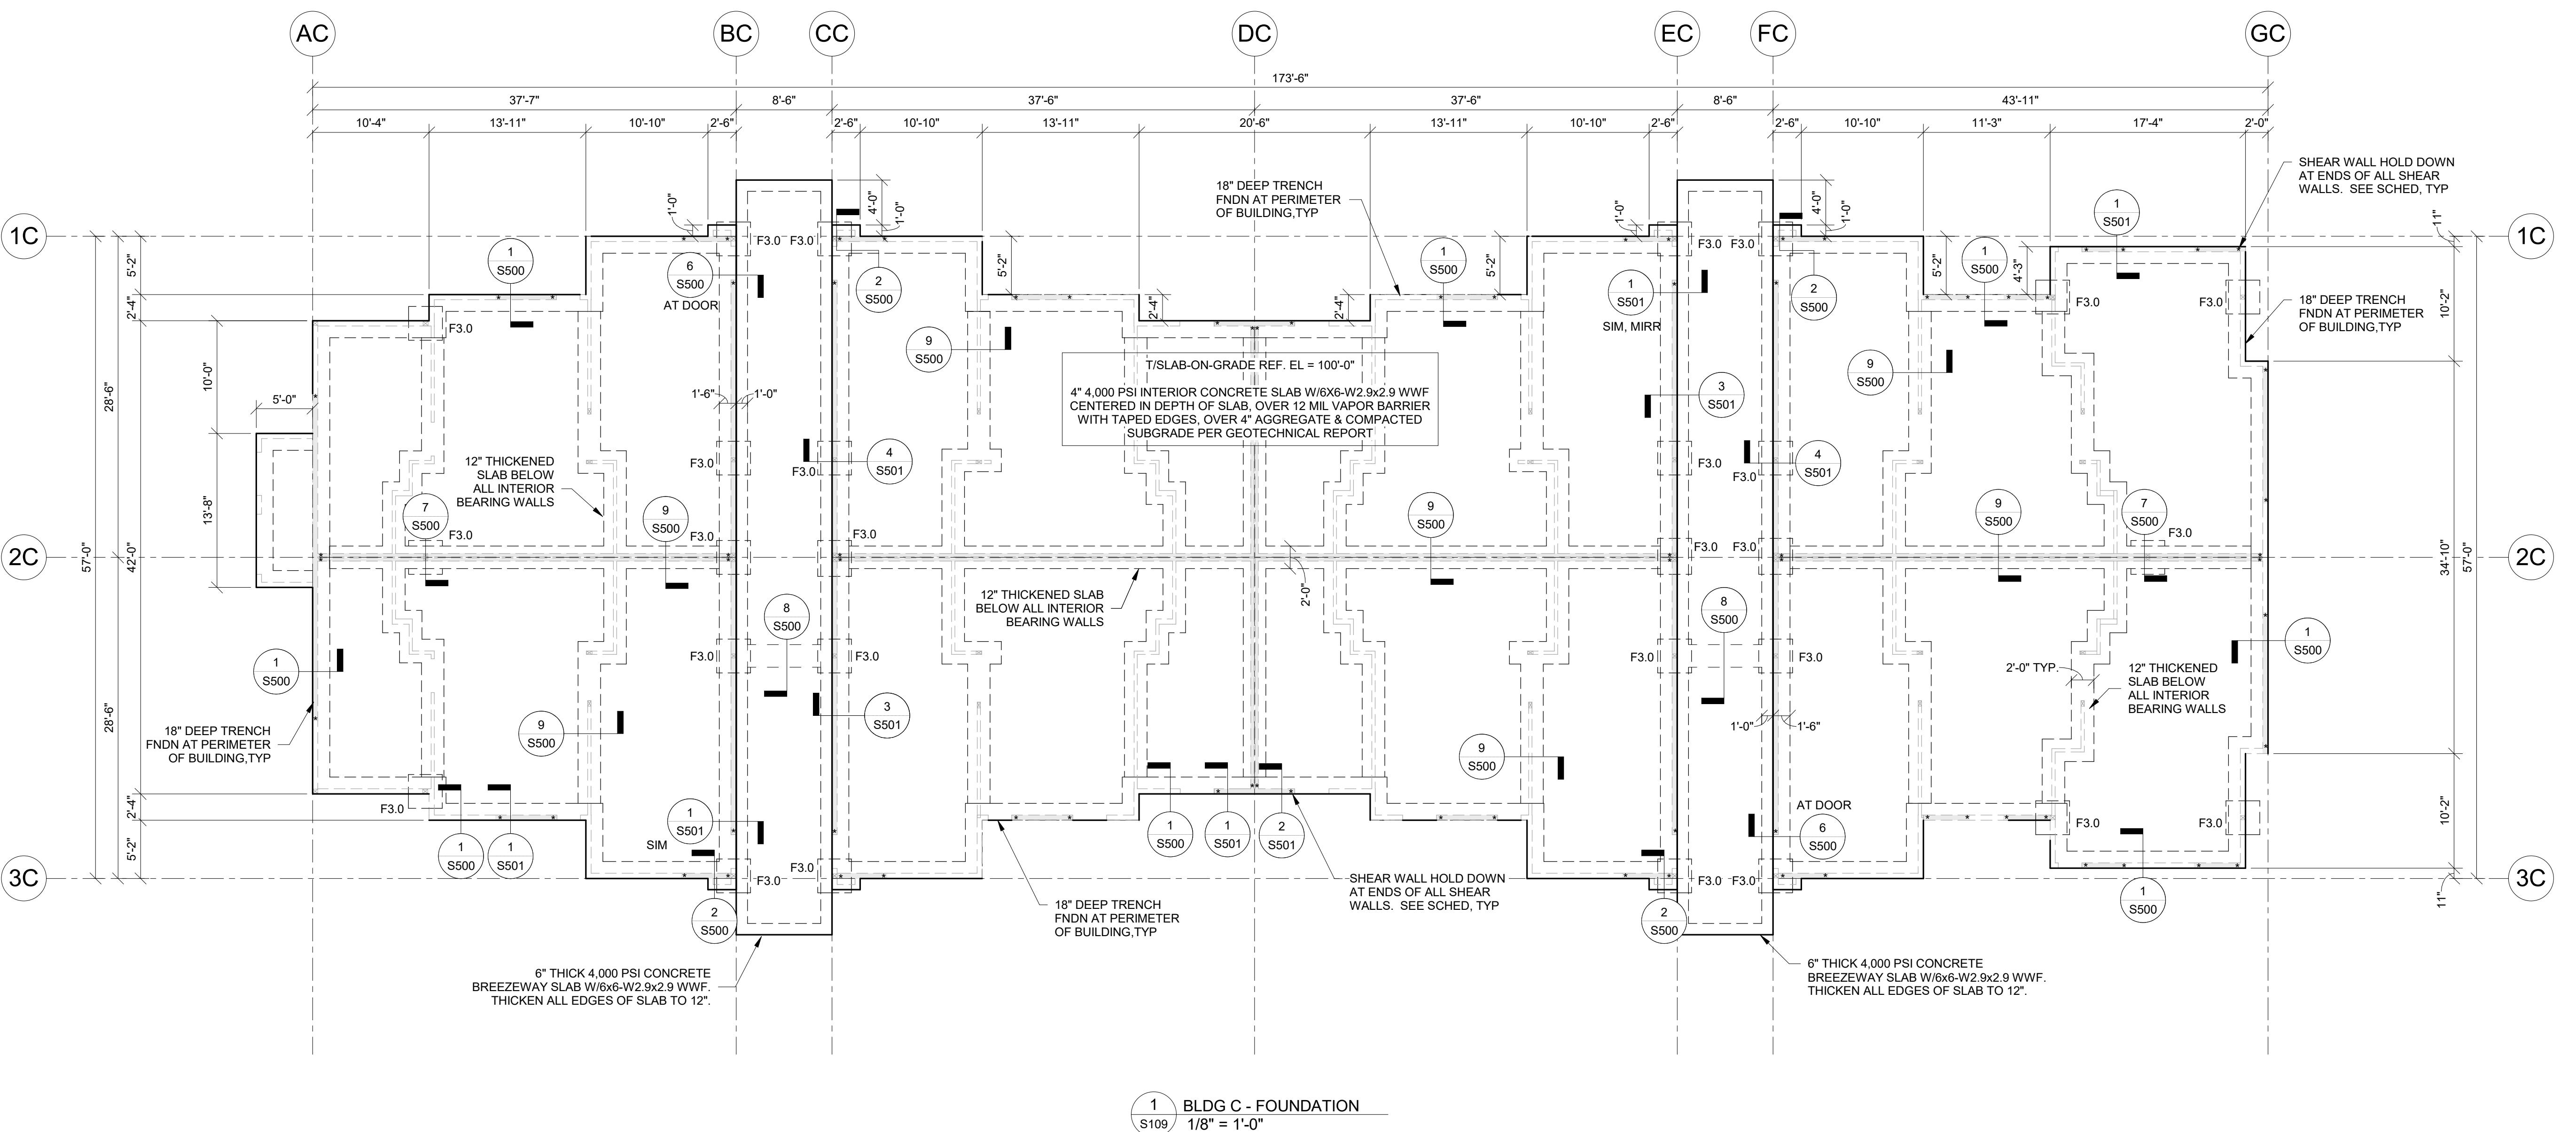

FOUNDATION PLAN NOTES:

- SEE ARCHITECTURAL DRAWINGS FOR SITE PLAN BENCHMARK ELEVATIONS AND REFERENCE ELEVATIONS. SEE BELOW (VERIFY ALL ELEVATIONS AND DIMENSIONS WITH ARCHITECTURAL DRAWINGS)
 - TO SLAB-ON-GRADE: 100'-0"
- PROVIDE CONTROL JOINTS IN SLAB ON GRADE PER DETAIL 10/S500 AND PER GENERAL NOTES.
- COORDINATE PLUMBING FIXTURES AND FLOOR DRAINS WITH ARCH. & MEP DRAWINGS.
- ALL EXTERIOR AND INTERIOR LOAD BARING WALLS ARE PER WALL SCHEDULE ON SHEET S003. SEE ARCHITECTURAL FLOOR PLAN FOR NON-BEARING WALLS AND ALL DOOR AND WINDOW SIZES AND LOCATIONS.
- REFER TO MANUFACTURER'S GUIDELINES FOR INSTALLATION OF STRAP TIES, HOLD DOWNS & OTHER CONNECTIONS. SEE SHEET S500 & S501 FOR DETAILS.
- 6"

FOUNDATION SCHEDULE		
Mark	Size	Reinforcing
F2.5	2'-6" x 2'-6" x 1'-0"	(3) #4 BARS Top & Bottom (Each Way)
F3.0	3'-0" x 3'-0" x 1'-0"	(3) #4 BARS Top & Bottom (Each Way)

Notes:
1. All footings must be centered on walls and columns U.N.O.

**JONES GILLAM RENZ
COBALT CIRCLE
BROWNSVILLE, TENNESSEE**


Autodesk DocId:202402664 - JGR_CobaltCircle202402664_JGR_COBALT CIRCLE R24.1.M

DRAWING NO.
S109

NEW SHEET

NOTICE:
McClure Engineering Co. is not responsible or liable for any issues, claims, damages, or losses (collectively, "Losses") which arise from failure to follow these Plans, Specifications, and the engineering intent they convey, or for Losses which arise from the engineers' or surveyors' guidance with respect to any alleged errors, omissions, inconsistencies, ambiguities, or conflicts contained within the Plans or Specifications.

TENNESSEE CERTIFICATE OF AUTHORITY
NO. 8231

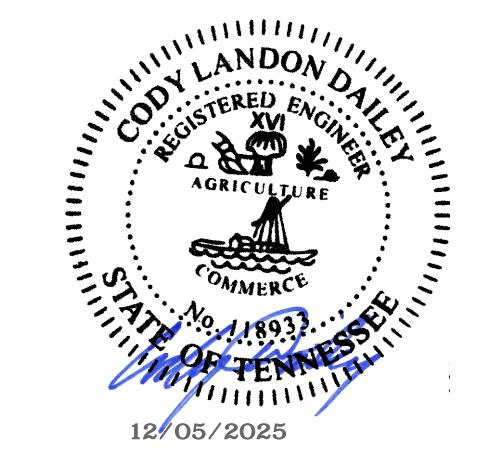


I HEREBY CERTIFY THAT THIS ENGINEERING DOCUMENT WAS PREPARED BY ME OR UNDER MY DIRECT PERSONAL SUPERVISION AND THAT I AM A FULLY LICENSED STRUCTURAL ENGINEER UNDER THE LAWS OF THE STATE OF TENNESSEE.

No.	Description	Date
1	AS 5 - BLDG C REVISION	12/05/2025

PROJECT NUMBER
2024002664
SET ISSUE DATE
05/09/2025

ENGINEER
DRAWN BY
CAS
CHECKED BY
CAS
JTB

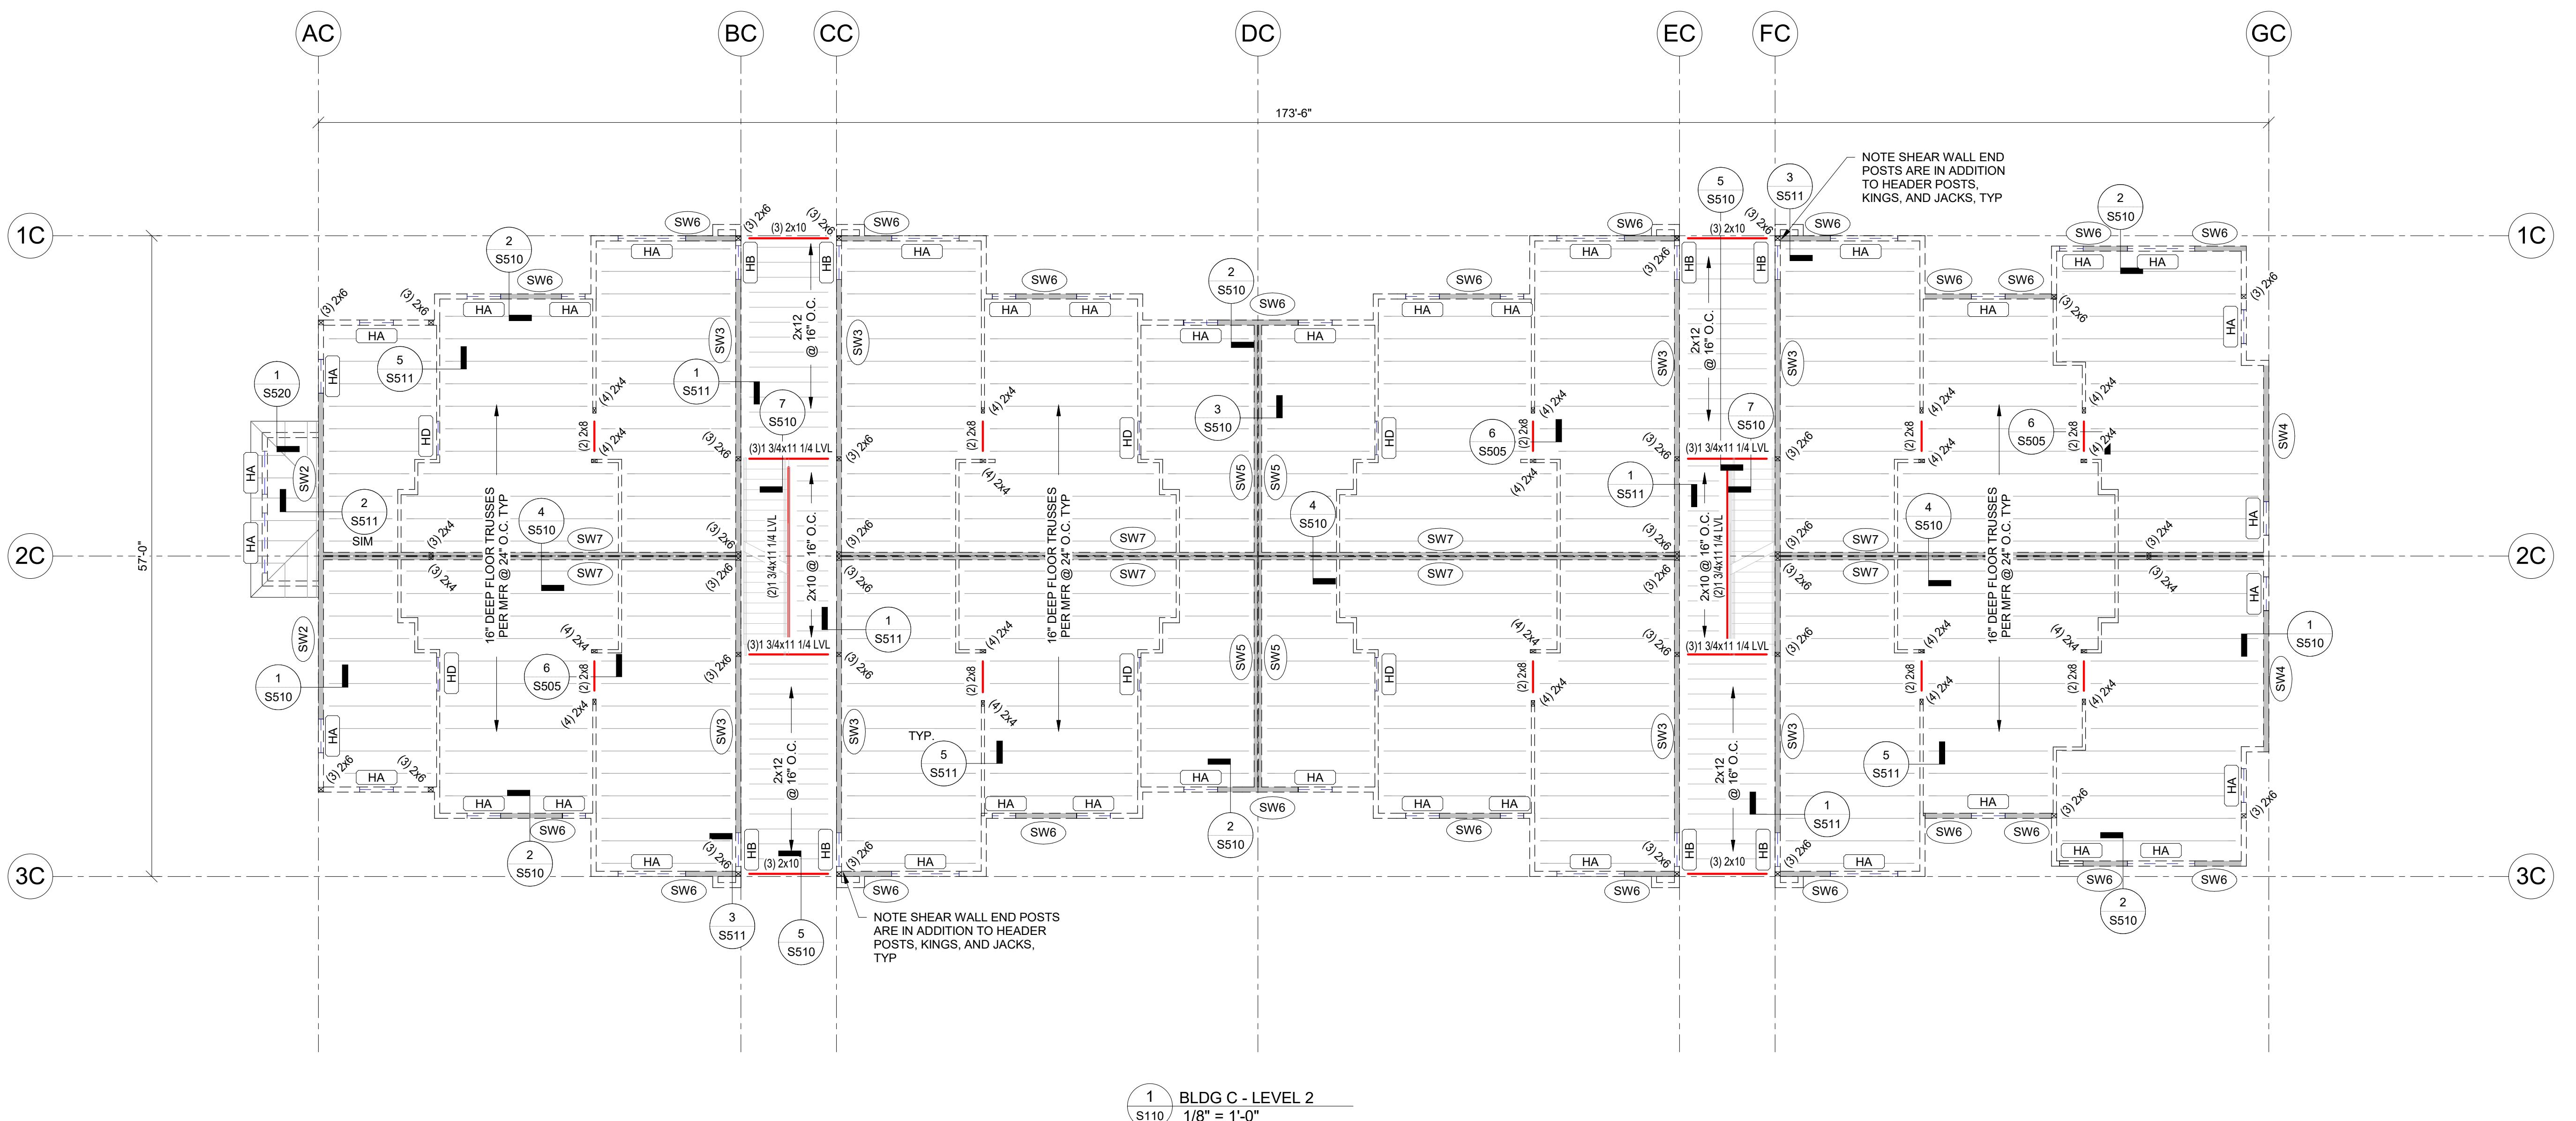

FRAMING PLAN LEGEND:

- (H?) HEADER PER SCHEDULE
- (SW#) SHEAR WALL TYPE, SHEAR WALL INDICATED BY
- F.F. FINISHED FLOOR

PLAN NOTES:

- SEE ARCHITECTURAL DRAWINGS FOR SITE PLAN BENCHMARK ELEVATION. FOR REFERENCE ELEVATIONS, SEE BELOW (VERIFY ALL ELEVATIONS AND DIMENSIONS WITH ARCHITECTURAL DRAWINGS)
 - T.O. SLAB-ON-GRADE: 100'-0"
 - LEVEL 2 F.F.: 110'-5 7/8"
 - LEVEL 3 F.F.: 120'-11 3/4"
 - TRUSS BRG.: 130'-0 7/8"
- FLOOR SHEATHING: 15/32" STRUCTURAL GRADE PLYWOOD. FASTEN TO FRAMING W/ 10d COMMON NAILS SPACED 6" O.C. AT EDGES, 12" O.C. WITHIN FIELD.
- ROOF SHEATHING: 15/32" STRUCTURAL GRADE PLYWOOD. FASTEN TO FRAMING W/ 10d COMMON NAILS SPACED 6" O.C. AT EDGES, 12" O.C. WITHIN FIELD.
- COORDINATE PLUMBING FIXTURES, SHAFTS, AND FLOOR DRAINS WITH ARCH. & MEP DRAWINGS.
- ALL EXTERIOR AND INTERIOR LOAD BEARING WALLS ARE PER WALL SCHEDULE ON SHEET S100. SEE ARCHITECTURAL FLOOR PLAN FOR NON-BEARING WALL, DOOR, AND WINDOW LOCATIONS.
- FLAT SHEET FOR FRAMING FOR THE FLOOR INDICATED & VERTICAL FRAMING (WALLS, HEADERS, POSTS, COLUMNS) SUPPORTING THAT FLOOR.
- SEE ARCHITECTURAL DRAWINGS FOR ALL RAILING DETAILS. REFER TO GENERAL NOTES FOR DESIGN CRITERIA.
- REFER TO MANUFACTURER'S GUIDELINES FOR INSTALLATION OF STRAP TIES, HOLD DOWNS & OTHER CONNECTIONS.
- ALL EXTERIOR LUMBER (POSTS, BEAMS, DECKING, ETC.) TO BE TREATED.
- WOOD FLOOR TRUSSES TO BE DESIGNED BY MANUFACTURER AND ARE SHOWN FOR THE INTENT OF SPAN DIRECTION AND LOAD PATH ONLY. REFER TO GENERAL NOTES FOR DESIGN CRITERIA. REFER TO SHEAR WALL SCHEDULE FOR DRAG LOADS.
- TRUSS MANUFACTURER TO DESIGN & PROVIDE GIRDERS TRUSSES AT ALL FLOOR OPENINGS & SPECIFY HANGERS FOR GIRDERS & SUPPORTED FRAMING.
- REFER TO ARCHITECTURAL PLANS FOR STAIR DIMENSIONS AND REQUIREMENTS. REFER TO STRUCTURAL GENERAL NOTES FOR STAIR DESIGN CRITERIA.
- COLUMN FRAMING MAY BE USED IN LIEU OF SHEAR WALL END POST FRAMING AT END OF SHEAR WALLS.

**JONES GILLAM RENZ
COBALT CIRCLE
BROWNSVILLE, TENNESSEE**


Autodesk Docs/2024002664 - JGR_Cobalt Circle/2024002664 - JGR_Cobalt Circle R24.M

DRAWING NO.
S110

NEW SHEET

NOTICE:
McClure Engineering Co. is not responsible or liable for any issues, claims, damages, or losses (collectively, "Losses") which arise from failure to follow these Plans, Specifications, and the engineering intent they convey, or for Losses which arise from the engineers' or surveyors' guidance with respect to any alleged errors, omissions, inconsistencies, ambiguities, or conflicts contained within the Plans or Specifications.

TENNESSEE CERTIFICATE OF AUTHORITY
NO. 8231

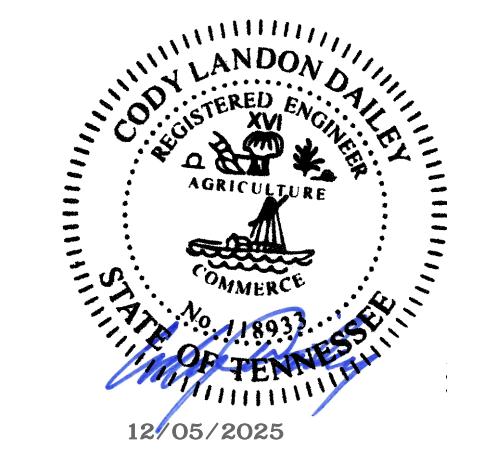


I HEREBY CERTIFY THAT THIS ENGINEERING DOCUMENT WAS PREPARED BY ME OR UNDER MY DIRECT PERSONAL SUPERVISION AND THAT I AM A FULLY LICENSED STRUCTURAL ENGINEER UNDER THE LAWS OF THE STATE OF TENNESSEE.

No.	Description	Date
1	AS 5 - BLDG C REVISION	12/05/2025

PROJECT NUMBER
2024002664
SET ISSUE DATE
05/09/2025

ENGINEER
DRAWN BY
CAS
CHECKED BY
CAS
JTB

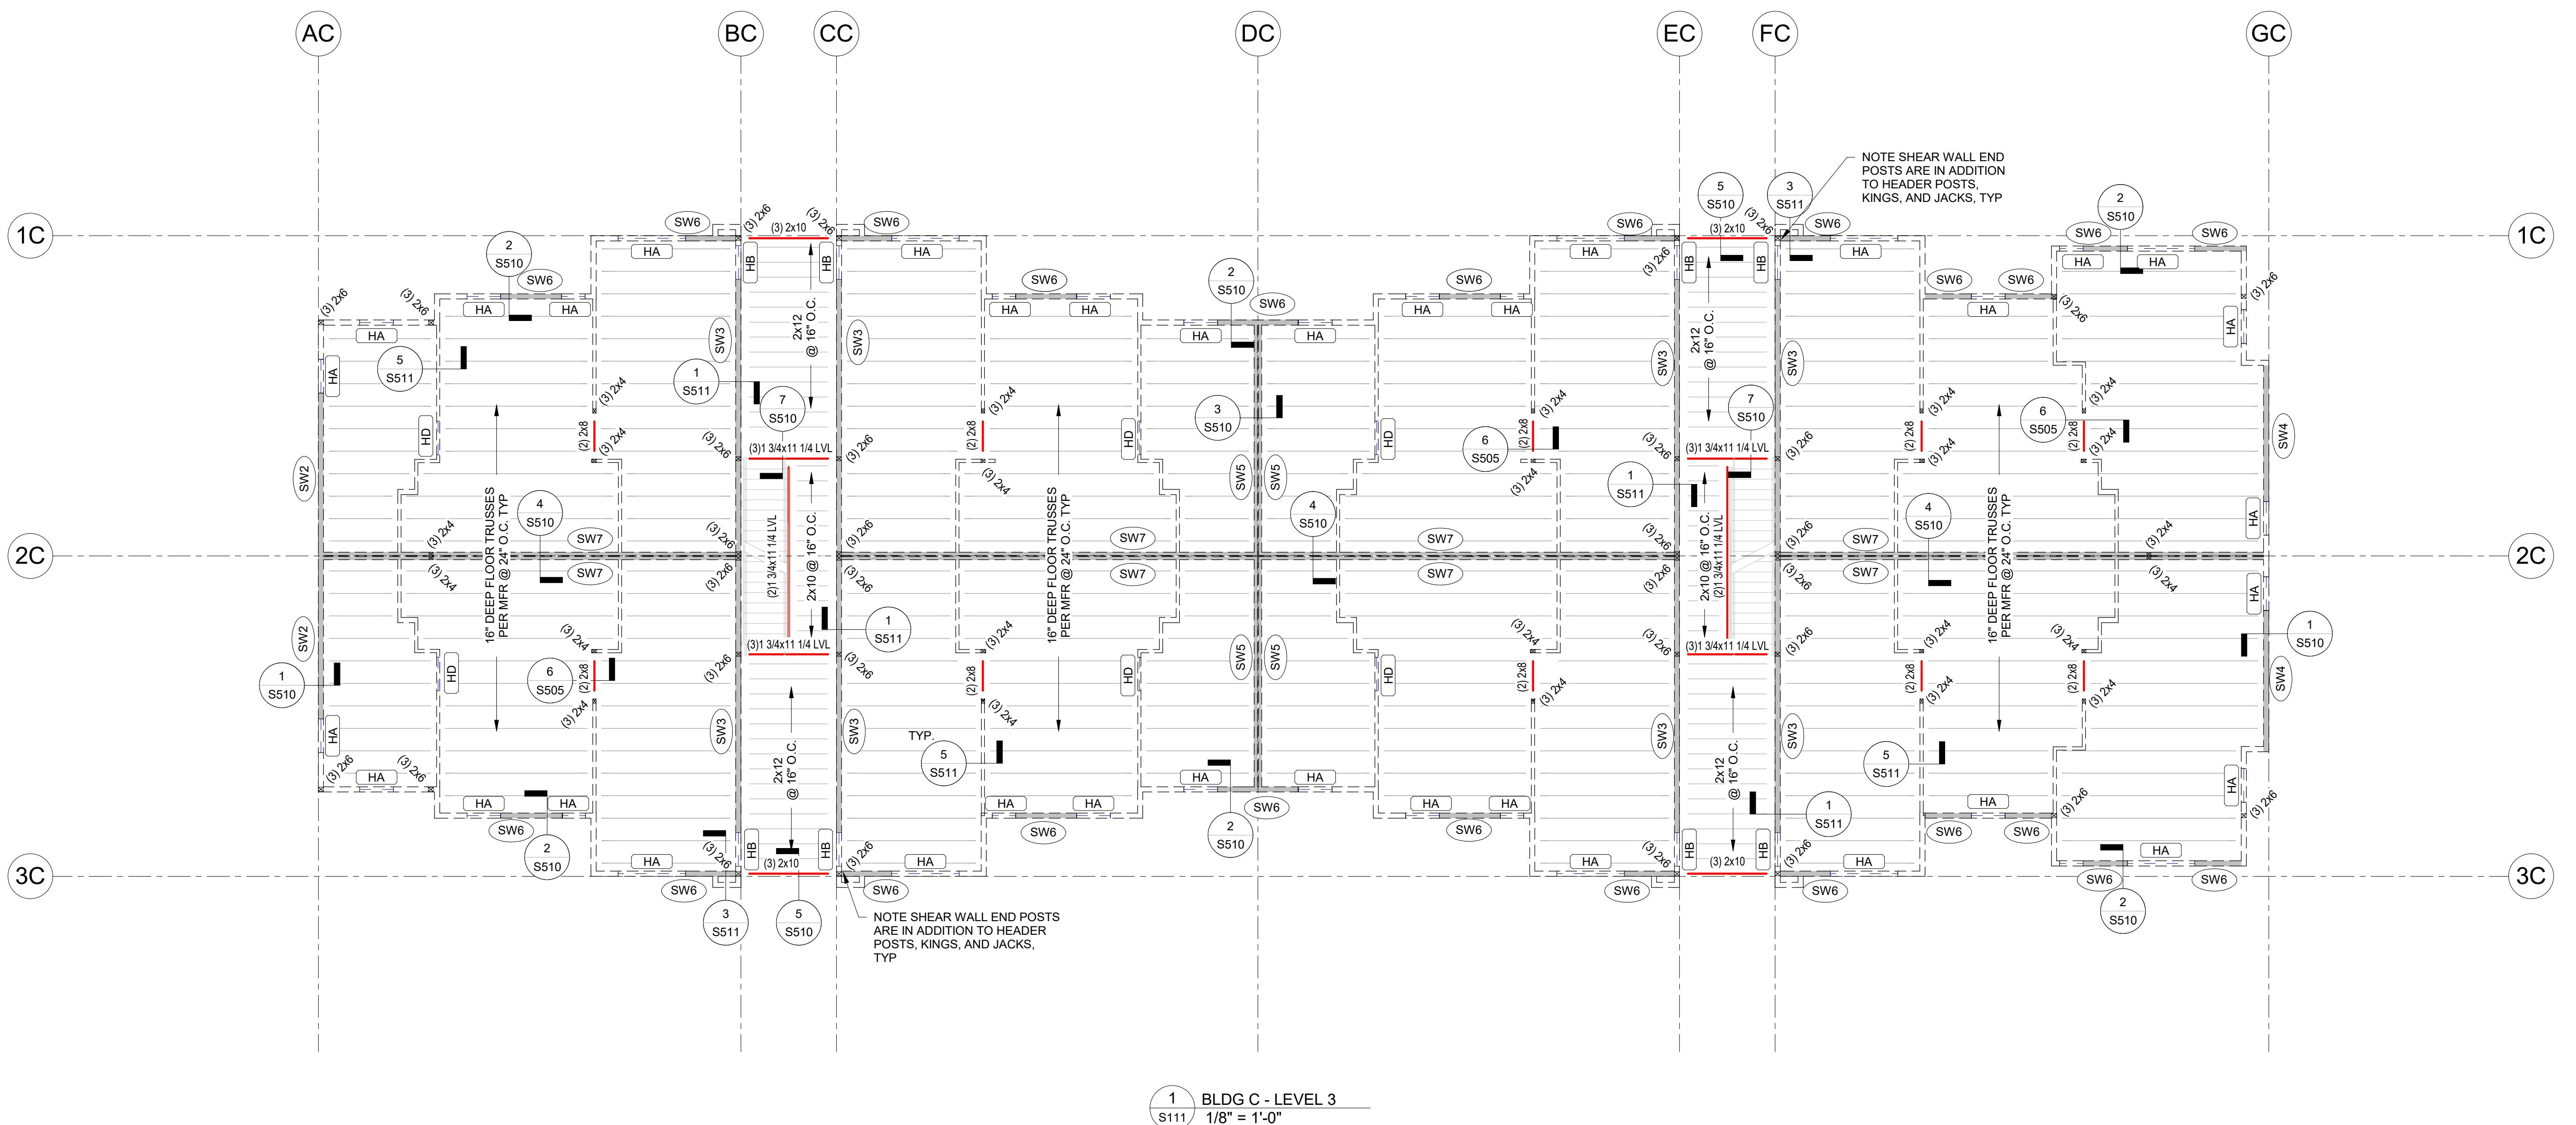

1 BLDG C - LEVEL 3
S111 1/8" = 1'-0"

PLAN NOTES:

- SEE ARCHITECTURAL DRAWINGS FOR SITE PLAN BENCHMARK ELEVATION. FOR REFERENCE ELEVATIONS, SEE BELOW (VERIFY ALL ELEVATIONS AND DIMENSIONS WITH ARCHITECTURAL DRAWINGS)
 - T.O. SLAB-ON-GRADE: 100'-0"
 - LEVEL 2 F.F.: 110'-5 7/8"
 - LEVEL 3 F.F.: 120'-11 3/4"
 - TRUSS BRG.: 130'-0 7/8"
- FLOOR SHEATHING: 15/32" STRUCTURAL GRADE PLYWOOD. FASTEN TO FRAMING W/ 10d COMMON NAILS SPACED 6" O.C. AT EDGES, 12" O.C. WITHIN FIELD.
- ROOF SHEATHING: 15/32" STRUCTURAL GRADE PLYWOOD. FASTEN TO FRAMING W/ 10d COMMON NAILS SPACED 6" O.C. AT EDGES, 12" O.C. WITHIN FIELD.
- COORDINATE PLUMBING FIXTURES, SHAFTS, AND FLOOR DRAINS WITH ARCH. & MEP DRAWINGS.
- ALL EXTERIOR AND INTERIOR LOAD BEARING WALLS ARE PER WALL SCHEDULE ON SHEET S001. SEE ARCHITECTURAL FLOOR PLAN FOR NON-BEARING WALL, DOOR, AND WINDOW LOCATIONS.
- FLAT SHEET METAL FRAMING FOR THE FLOOR INDICATED & VERTICAL FRAMING (WALLS, HEADERS, POSTS, COLUMNS) SUPPORTING THAT FLOOR.
- SEE ARCHITECTURAL DRAWINGS FOR ALL RAILING DETAILS. REFER TO GENERAL NOTES FOR DESIGN CRITERIA.
- REFER TO MANUFACTURER'S GUIDELINES FOR INSTALLATION OF STRAP TIES, HOLD DOWNS & OTHER CONNECTIONS.
- ALL EXTERIOR LUMBER (POSTS, BEAMS, DECKING, ETC.) TO BE TREATED.
- WOOD FLOOR TRUSSES TO BE DESIGNED BY MANUFACTURER AND ARE SHOWN FOR THE INTENT OF SPAN DIRECTION AND LOAD PATH ONLY. REFER TO GENERAL NOTES FOR DESIGN CRITERIA. REFER TO SHEAR WALL SCHEDULE FOR DRAG LOADS.
- TRUSS MANUFACTURER TO DESIGN & PROVIDE GIRDERS TRUSSES AT ALL FLOOR OPENINGS & SPECIFY HANGERS FOR GIRDERS & SUPPORTED FRAMING.
- REFER TO ARCHITECTURAL PLANS FOR STAIR DIMENSIONS AND REQUIREMENTS. REFER TO STRUCTURAL GENERAL NOTES FOR STAIR DESIGN CRITERIA.
- COLUMN FRAMING MAY BE USED IN LIEU OF SHEAR WALL END POST FRAMING AT END OF SHEAR WALLS.


FRAMING PLAN LEGEND:
 HEADER PER SCHEDULE
 SW# SHEAR WALL TYPE, SHEAR WALL INDICATED BY
 F.F. FINISHED FLOOR

**JONES GILLAM RENZ
COBALT CIRCLE
BROWNSVILLE, TENNESSEE**

BLDG C - LEVEL 3 PLAN


Autodesk Docs/2024002664 - JGR_Cobalt Circle/2024002664 - JGR_Cobalt Circle R24.M

DRAWING NO.
S111
NEW SHEET

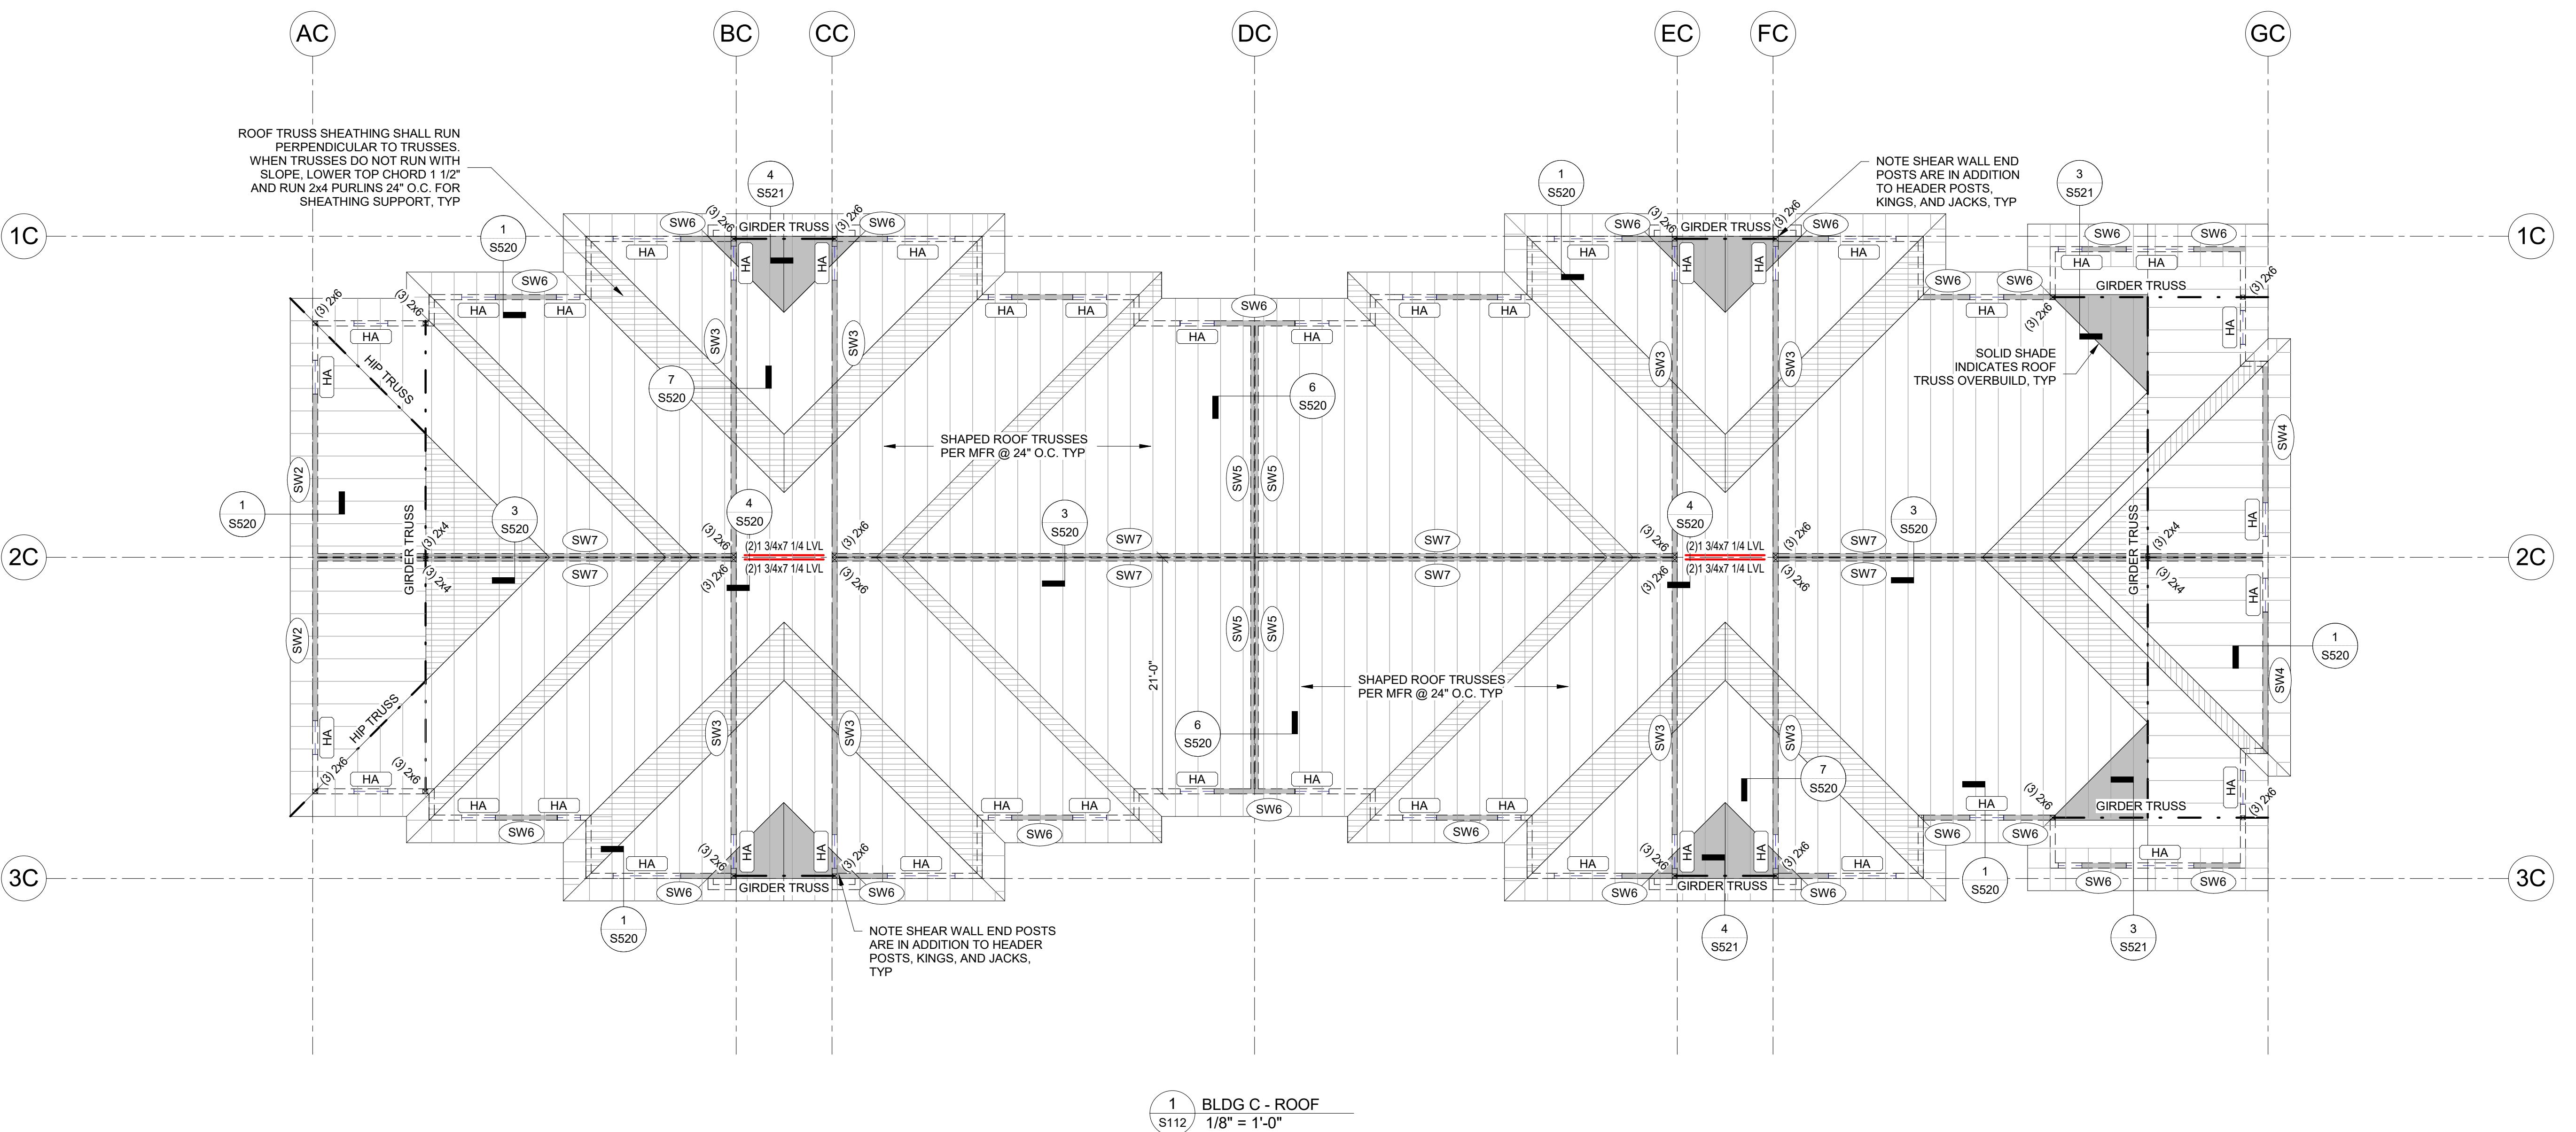

NOTICE:
McClure Engineering Co. is not responsible or liable for any issues, claims, damages, or losses (collectively, "Losses") which arise from failure to follow these Plans, Specifications, and the engineering intent they convey, or for Losses which arise from failure to obtain and/or follow the engineers' or surveyors' guidance with respect to any alleged errors, omissions, inconsistencies, ambiguities, or conflicts contained within the Plans or Specifications.

TENNESSEE CERTIFICATE OF AUTHORITY
NO. 8231

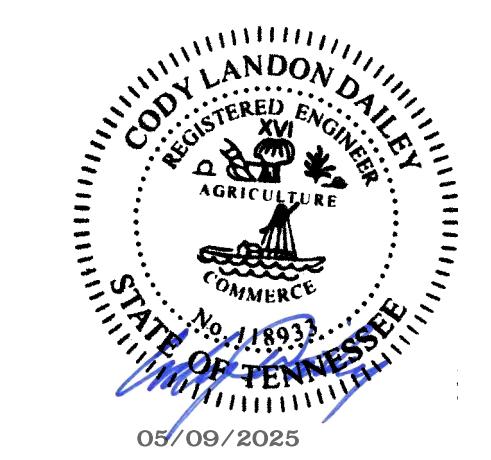

CODY L. DAILEY
118933
EXP: 2/28/2026
I HEREBY CERTIFY THAT THIS
ENGINEERING DOCUMENT WAS
PREPARED BY ME OR UNDER MY
DIRECT PERSONAL SUPERVISION
THAT I AM A FULLY
LICENSED PROFESSIONAL ENGINEER
UNDER THE LAWS OF THE STATE OF
TENNESSEE.

No. PERMIT SET Description Date
00 PERMIT SET 05/09/2025












PROJECT NUMBER 2024002664
SET ISSUE DATE 05/09/2025
ENGINEER DRAWN BY CHECKED BY
CAS CAS JTB

JONES GILLAM RENZ
COBALT CIRCLE
BROWNSVILLE, TENNESSEE

Autodesk DocID:202402664-JGR-CobaltCircleR24.M

DRAWING NO.
S500


FOUNDATION DETAILS

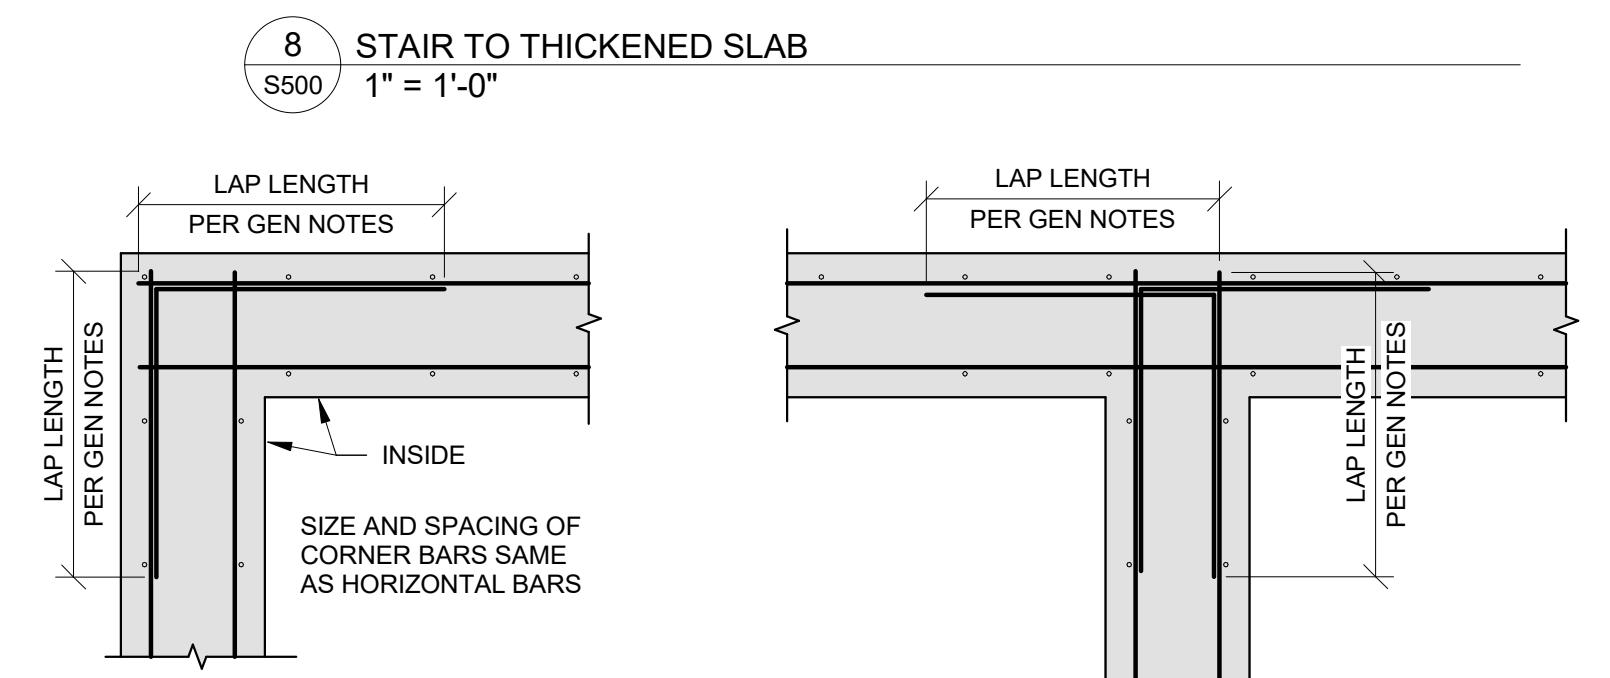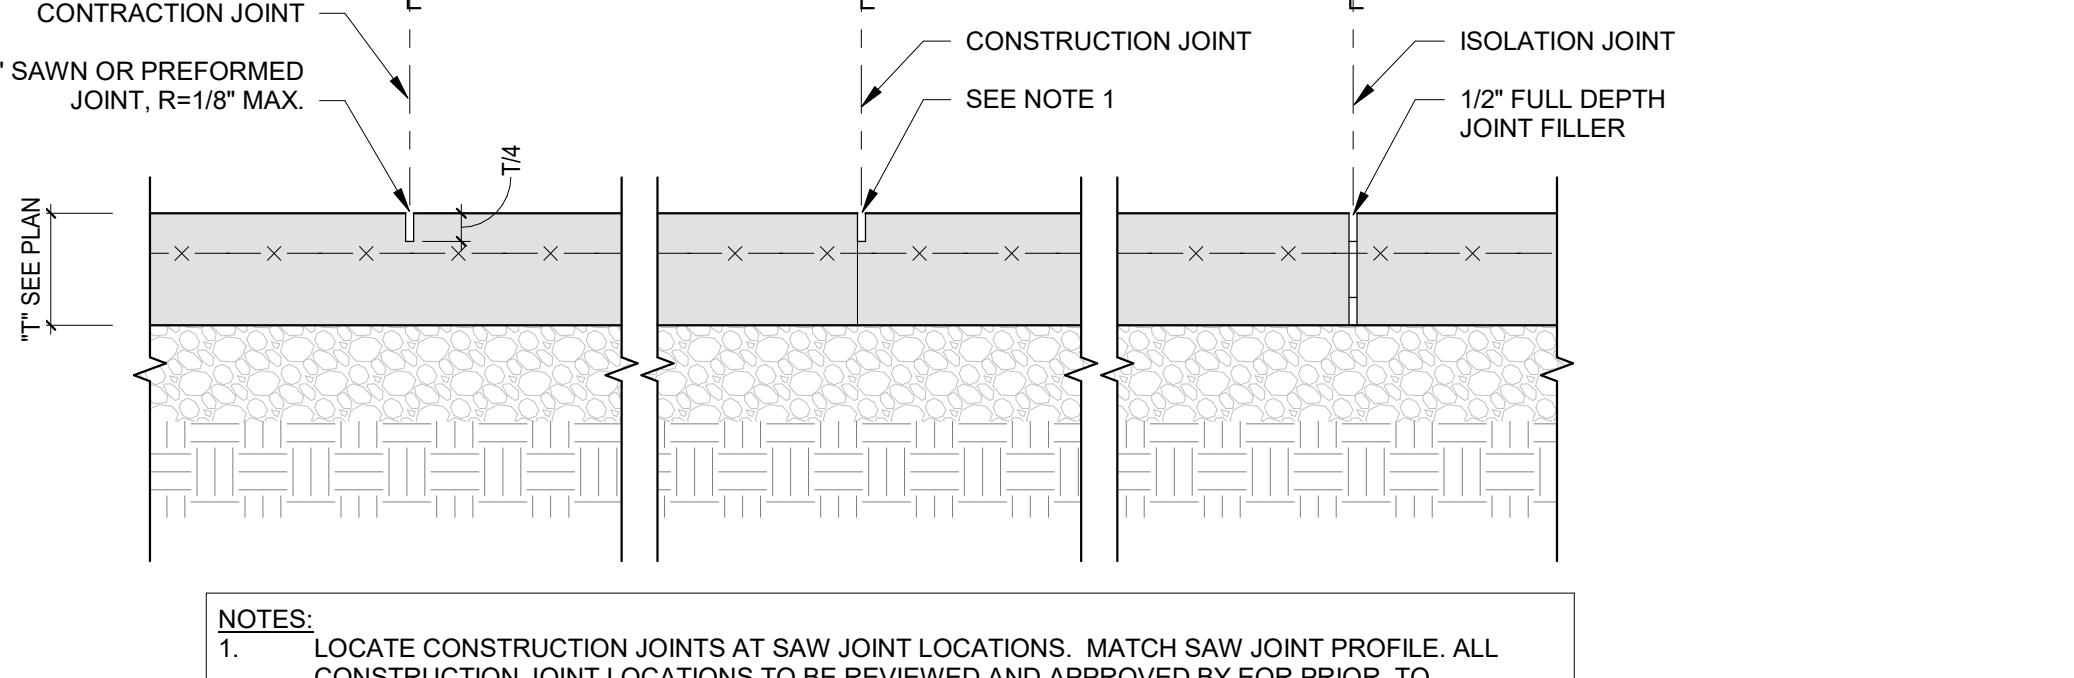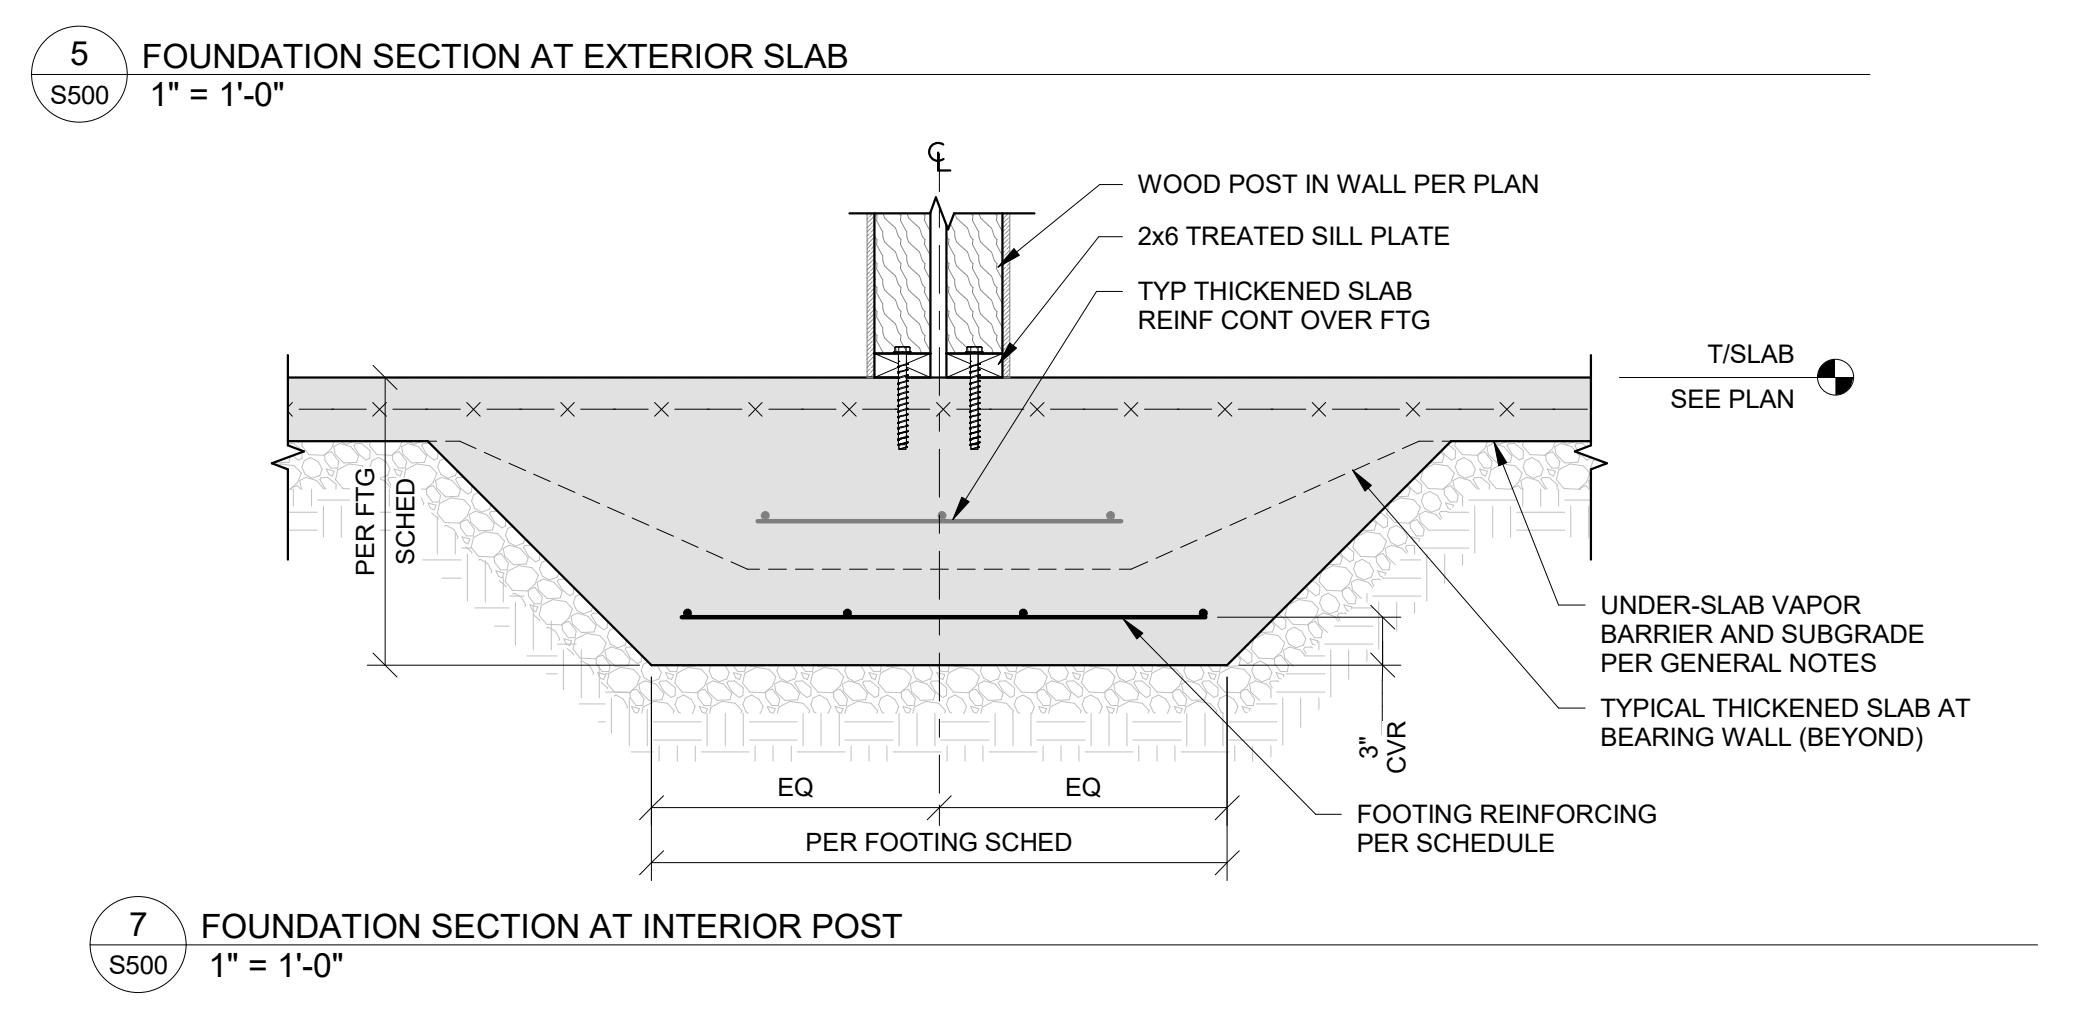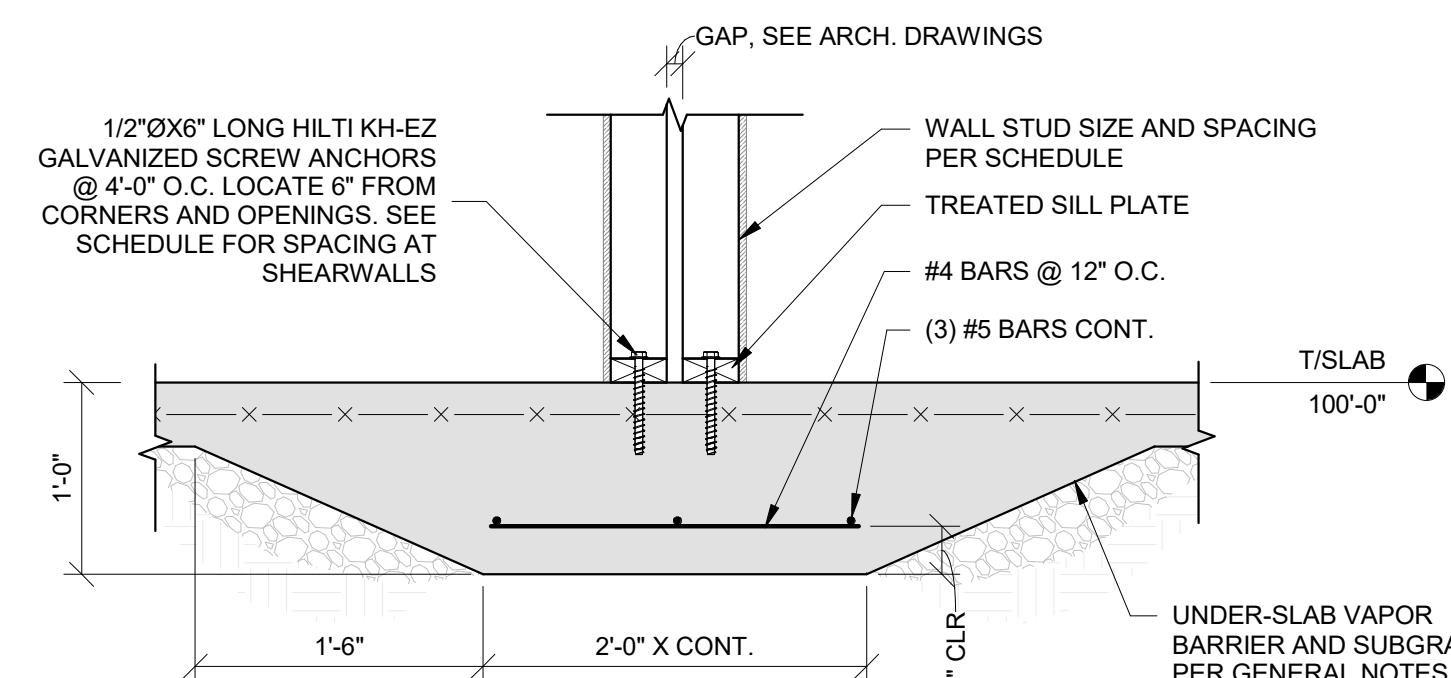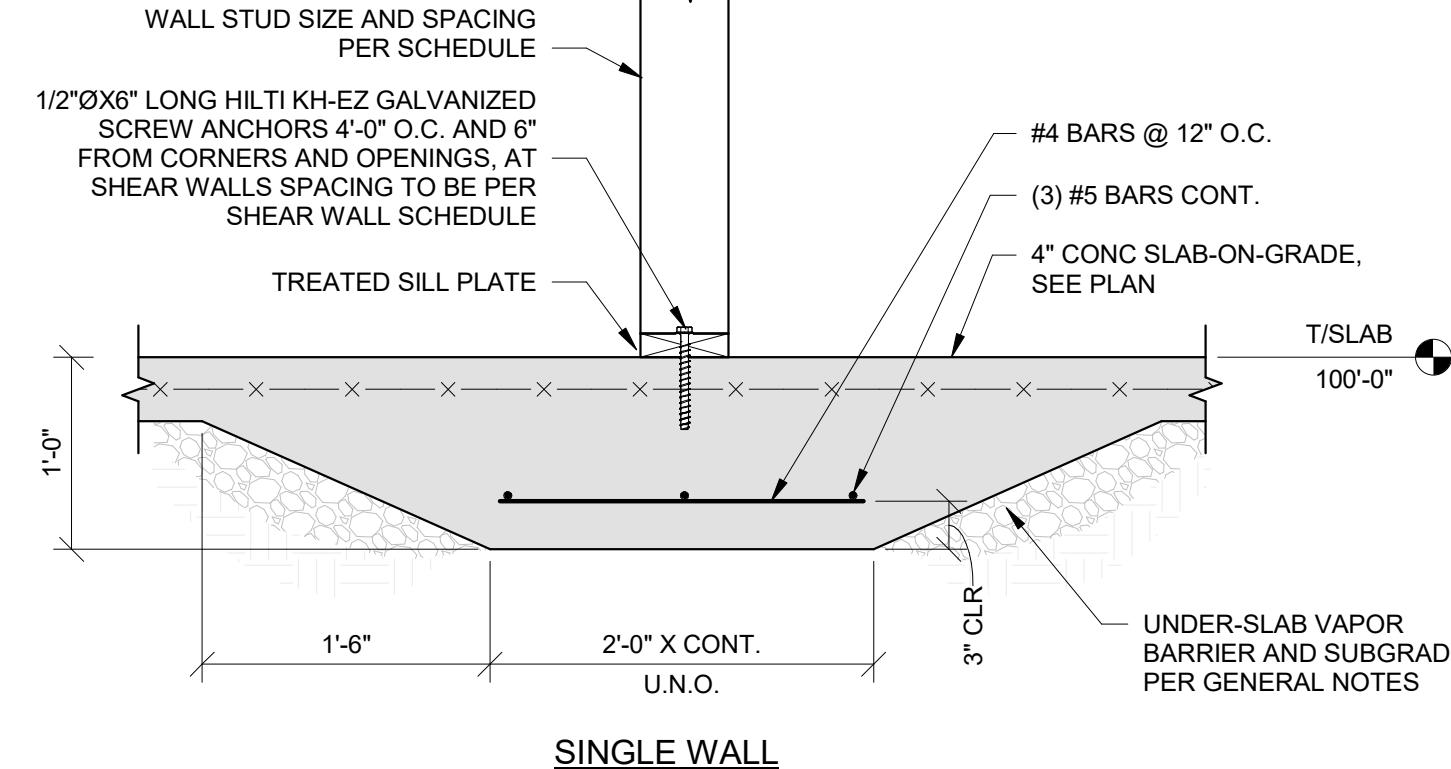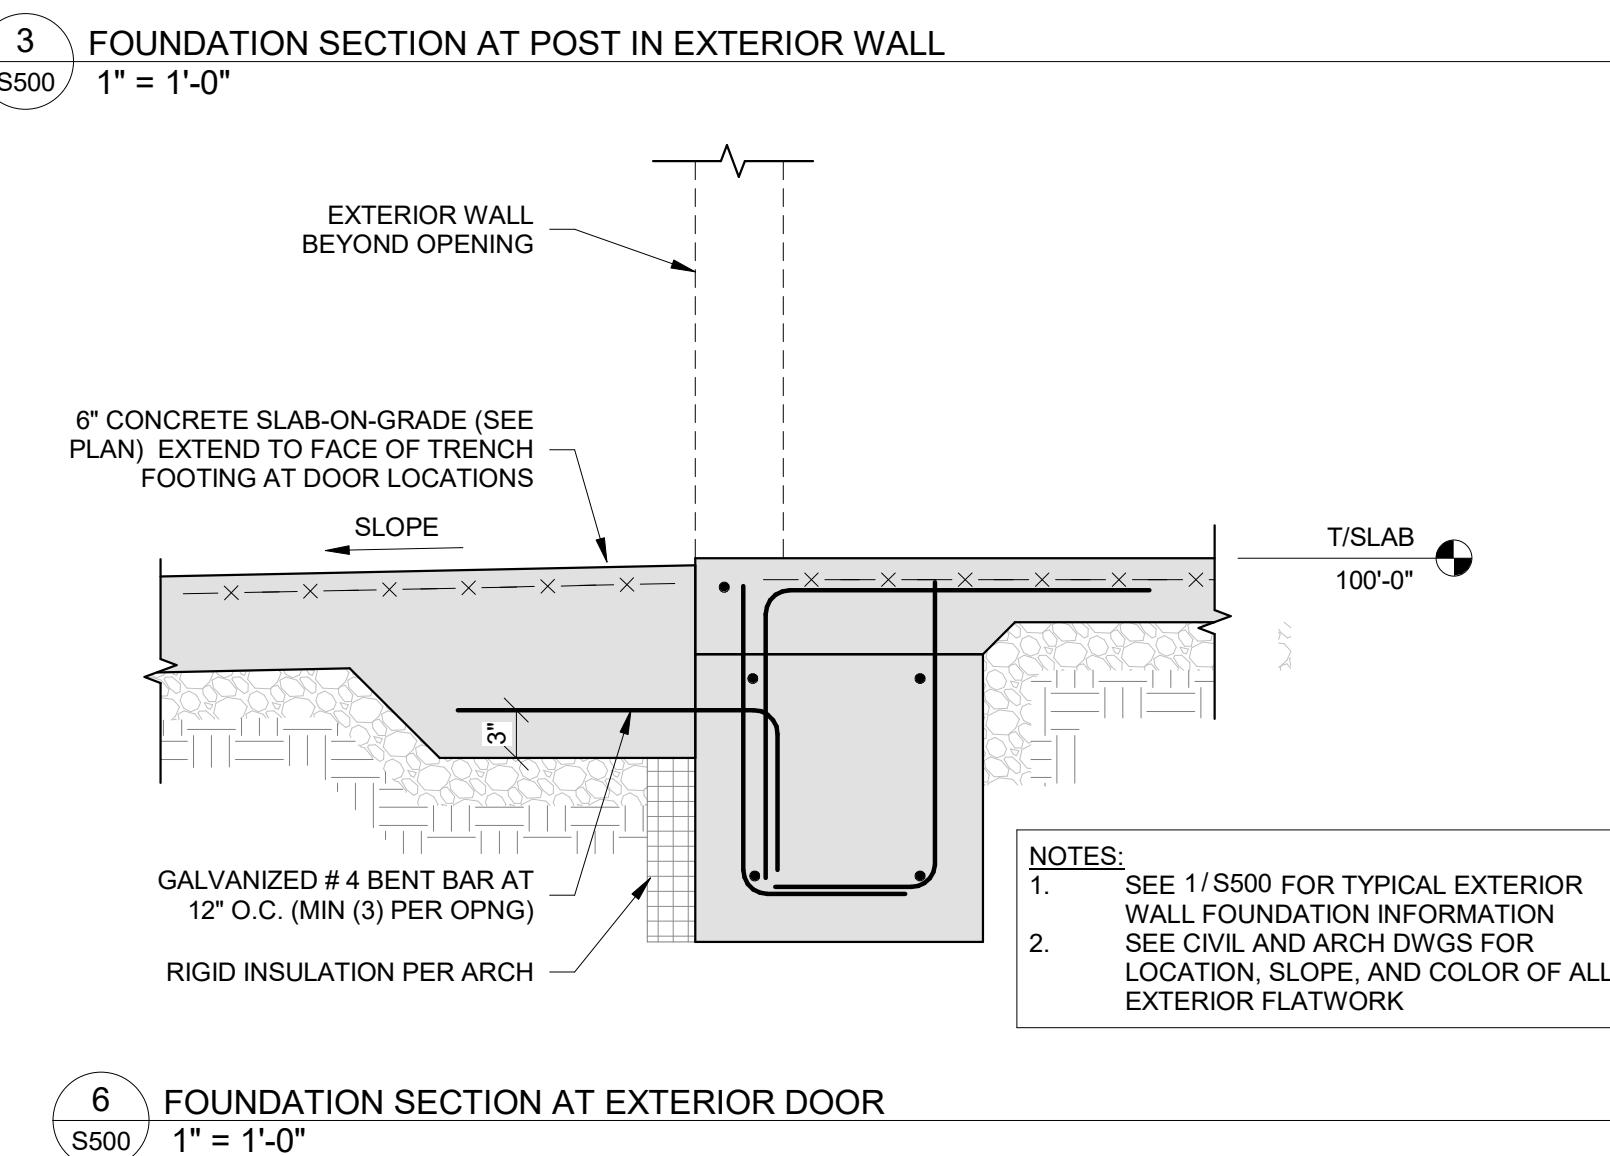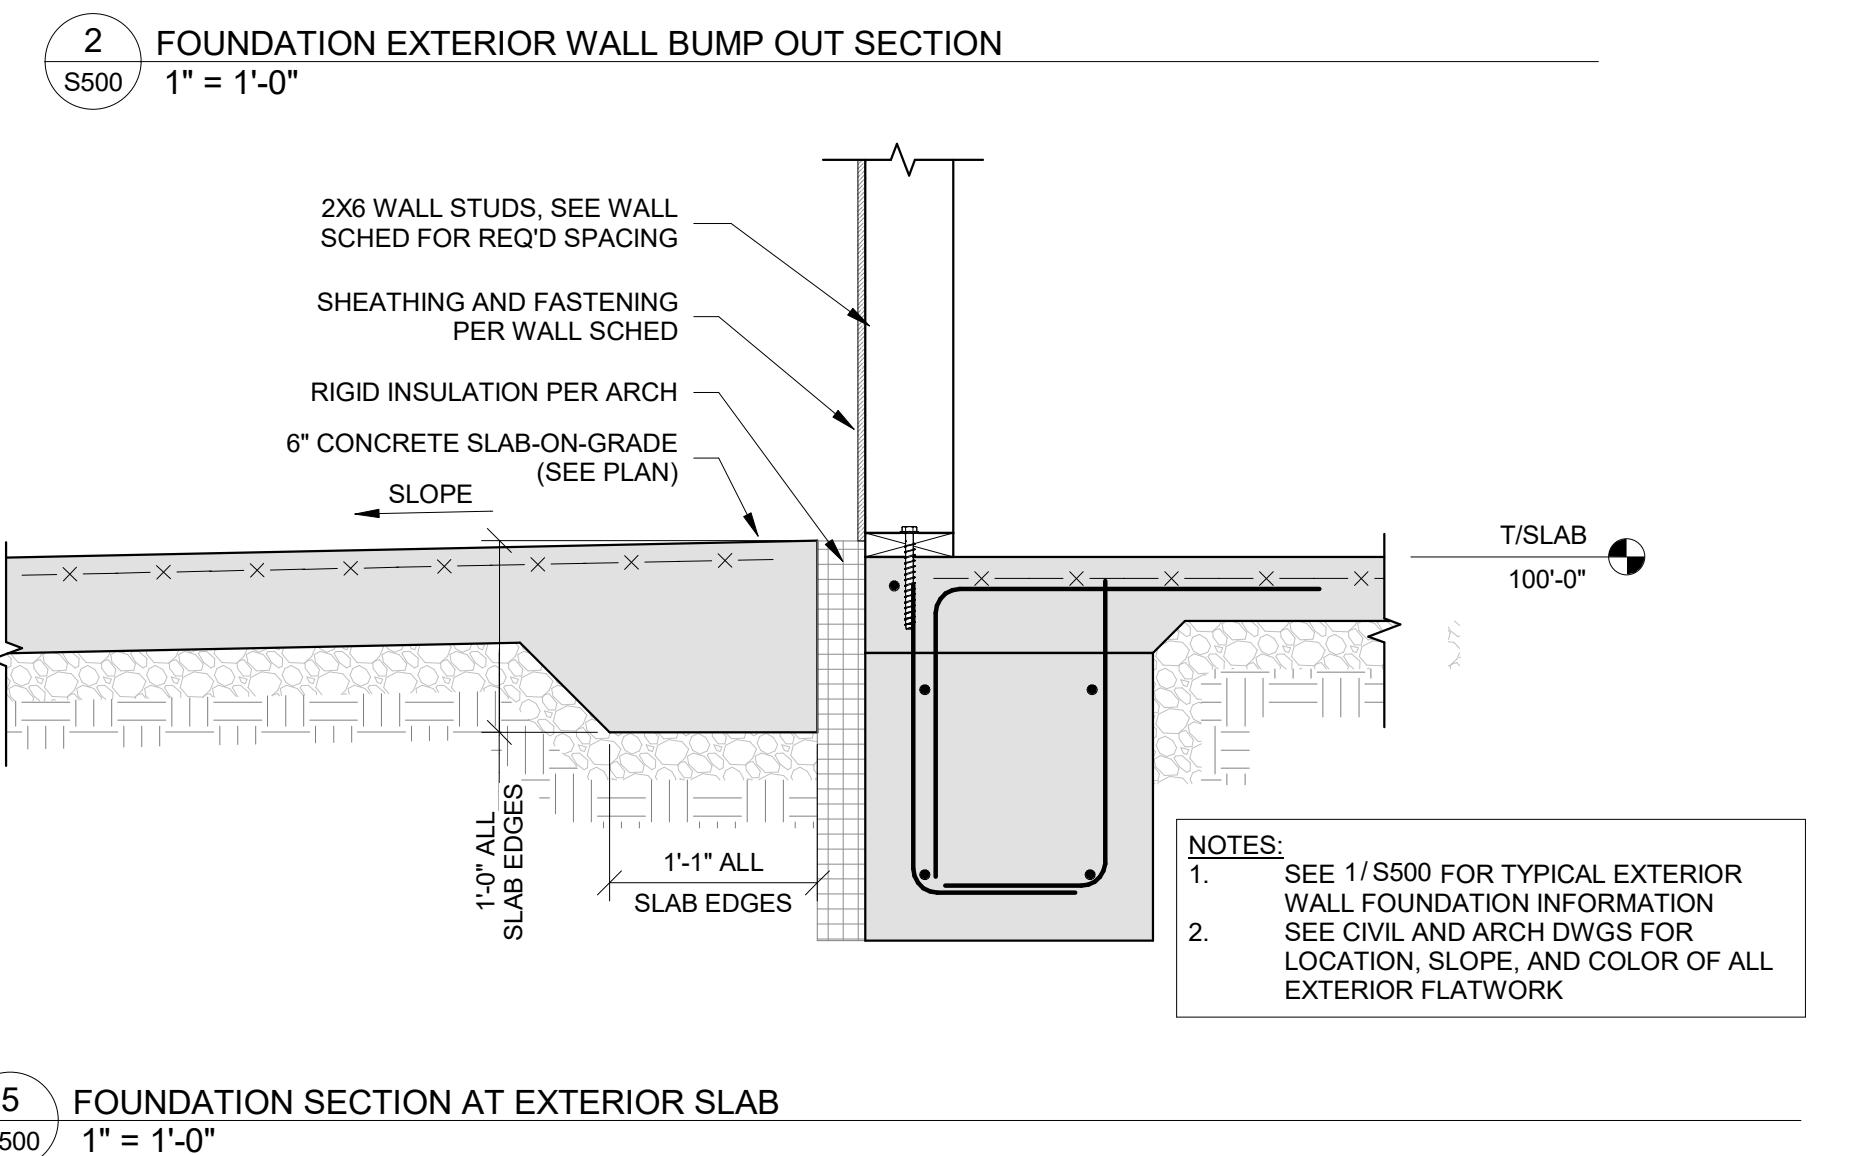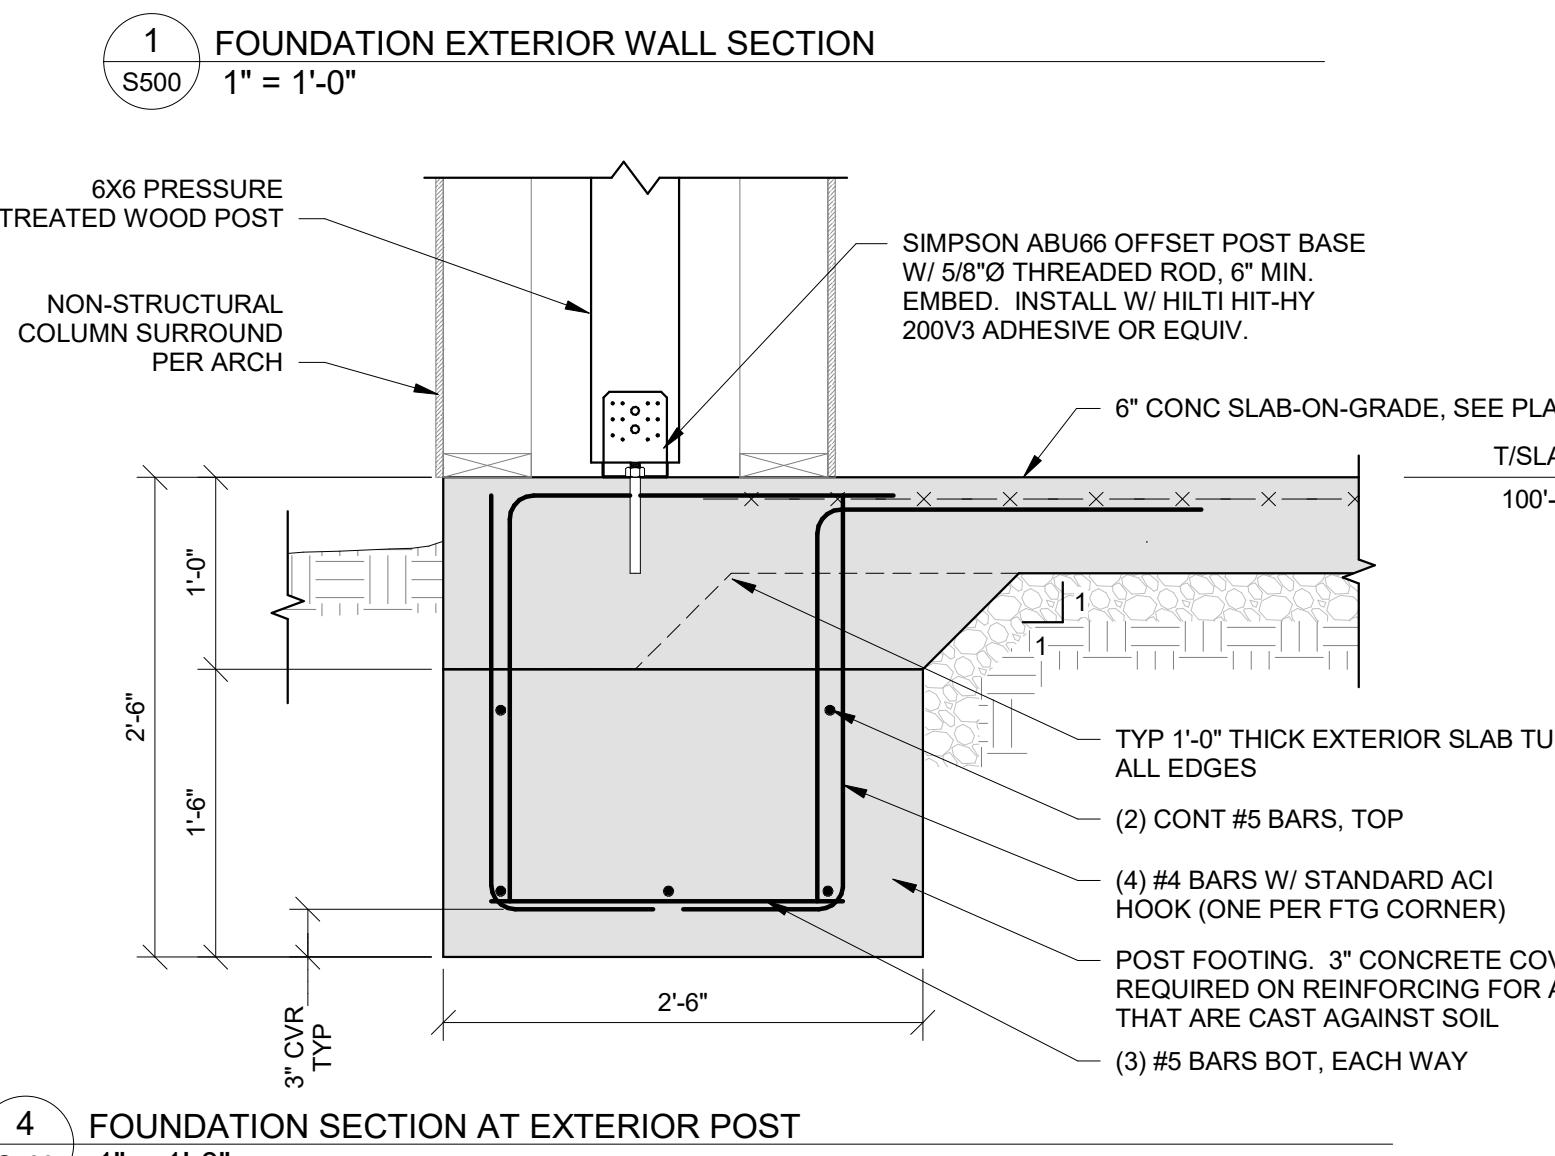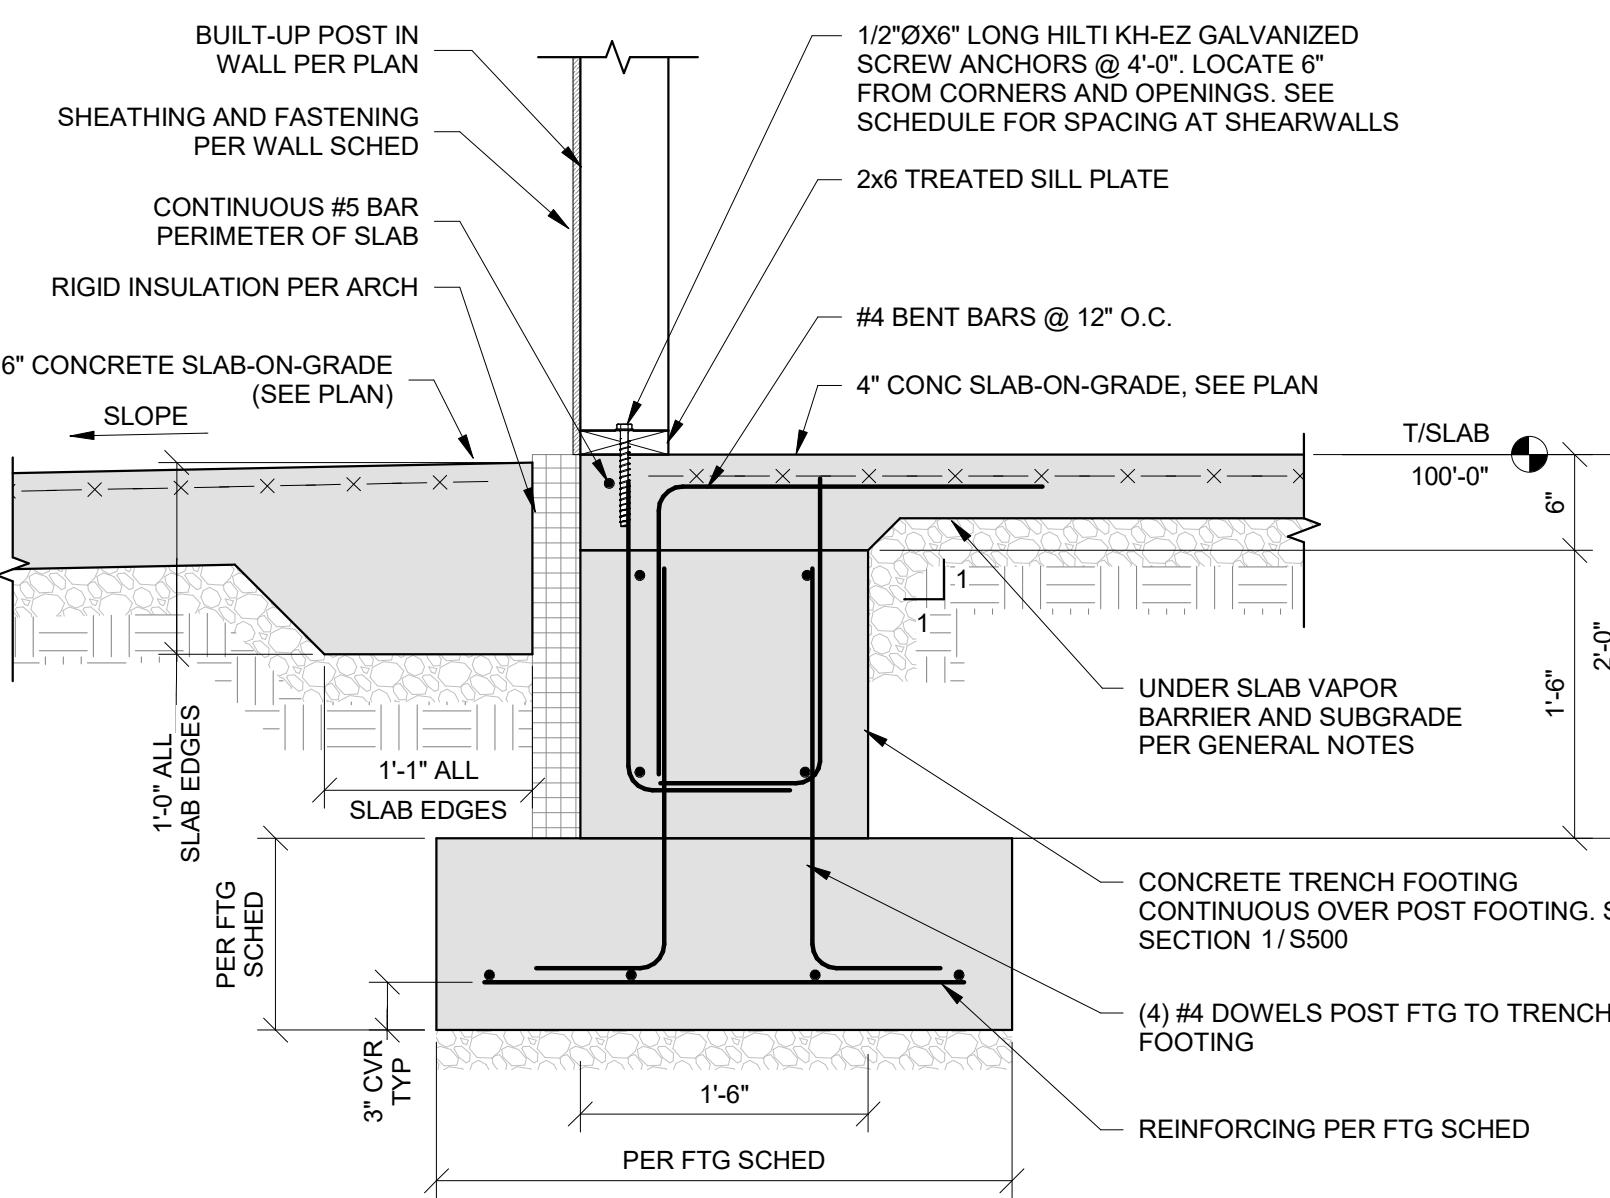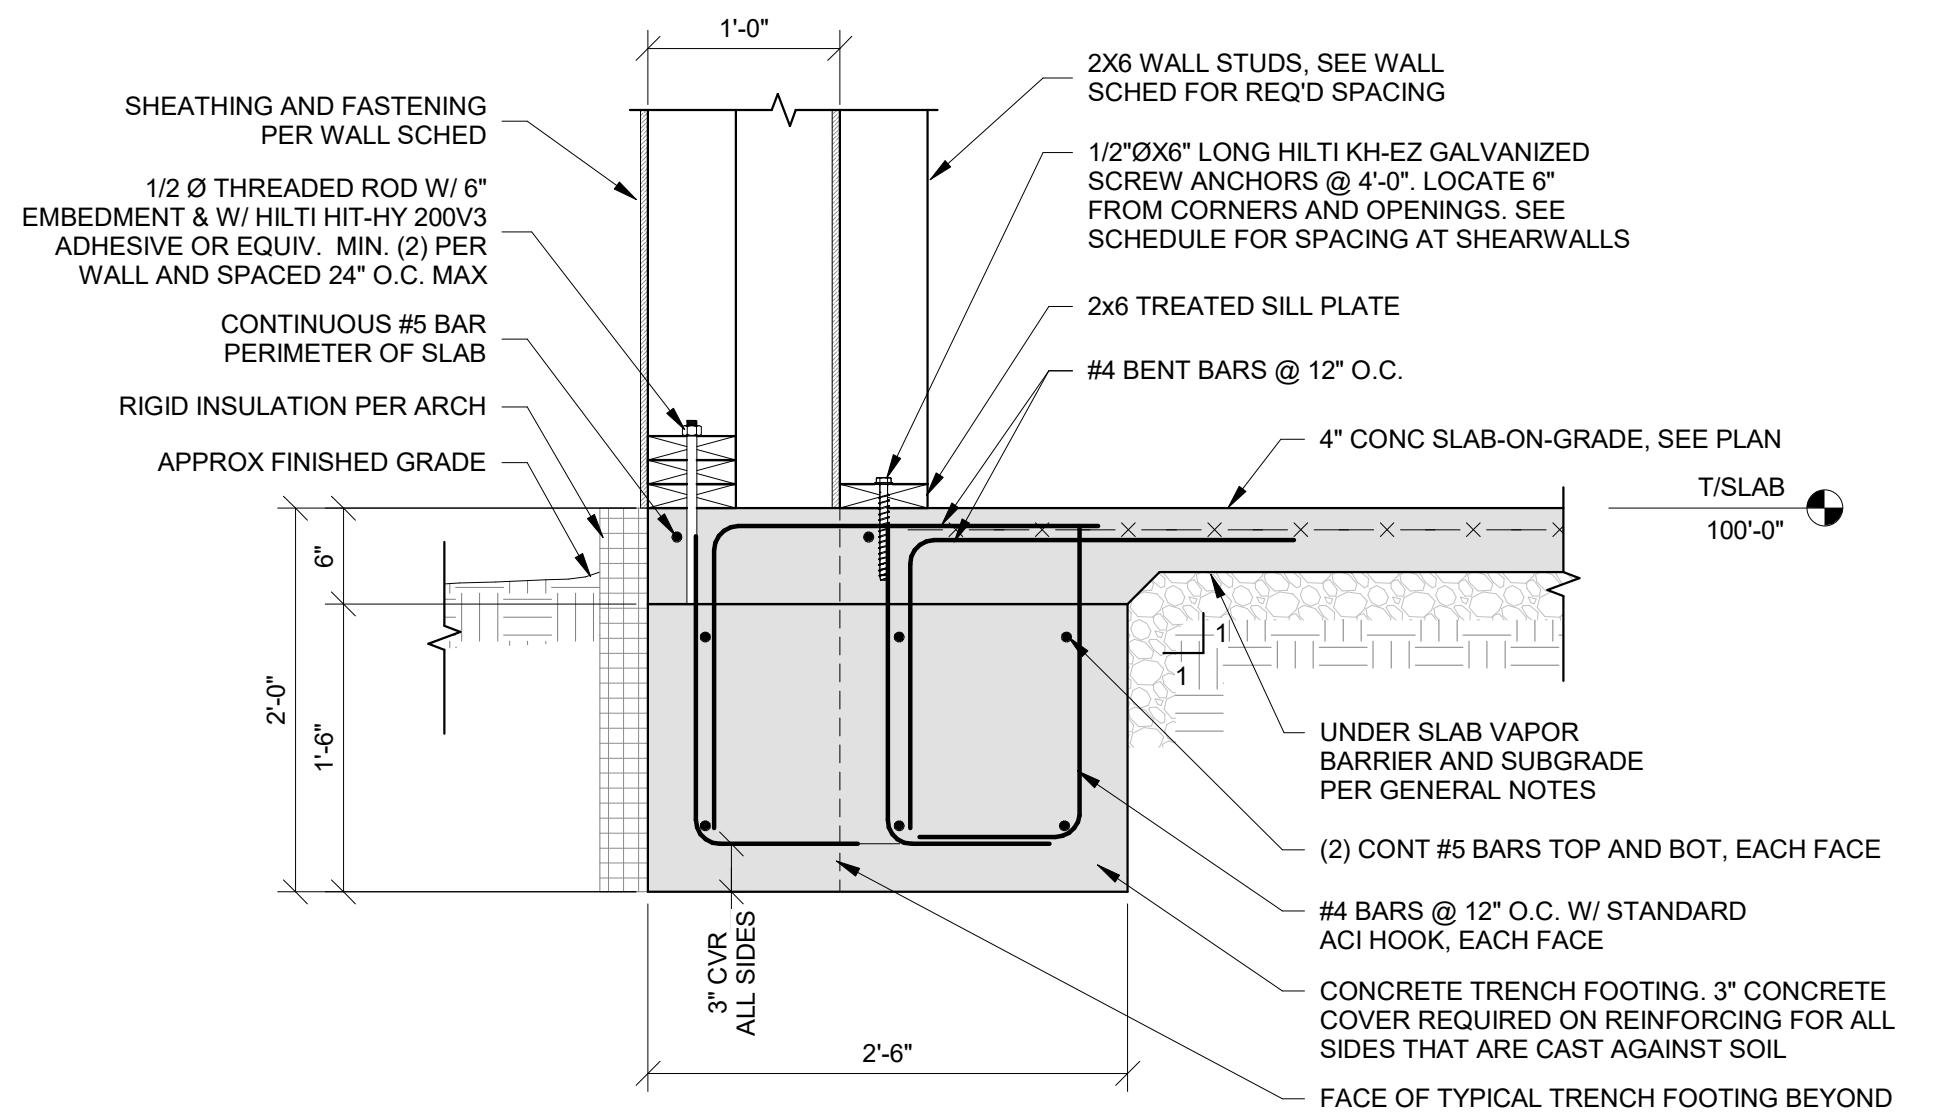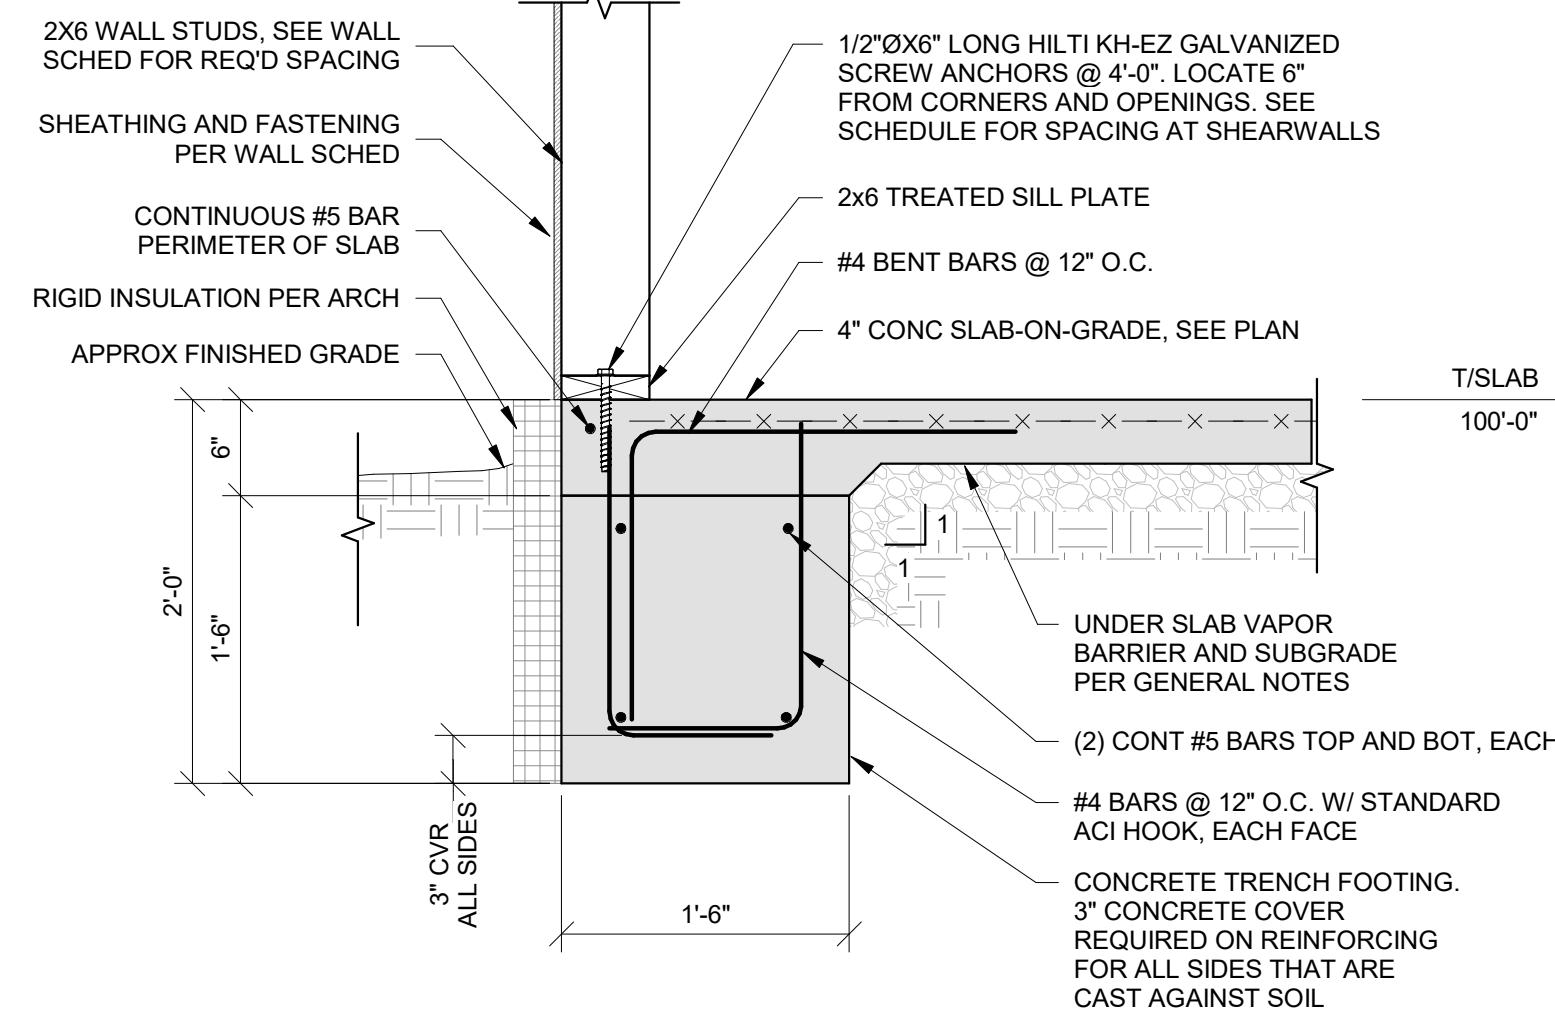




M^CCLURETM


2001 W Broadway
Columbia, MO 65203
P 573-814-1568

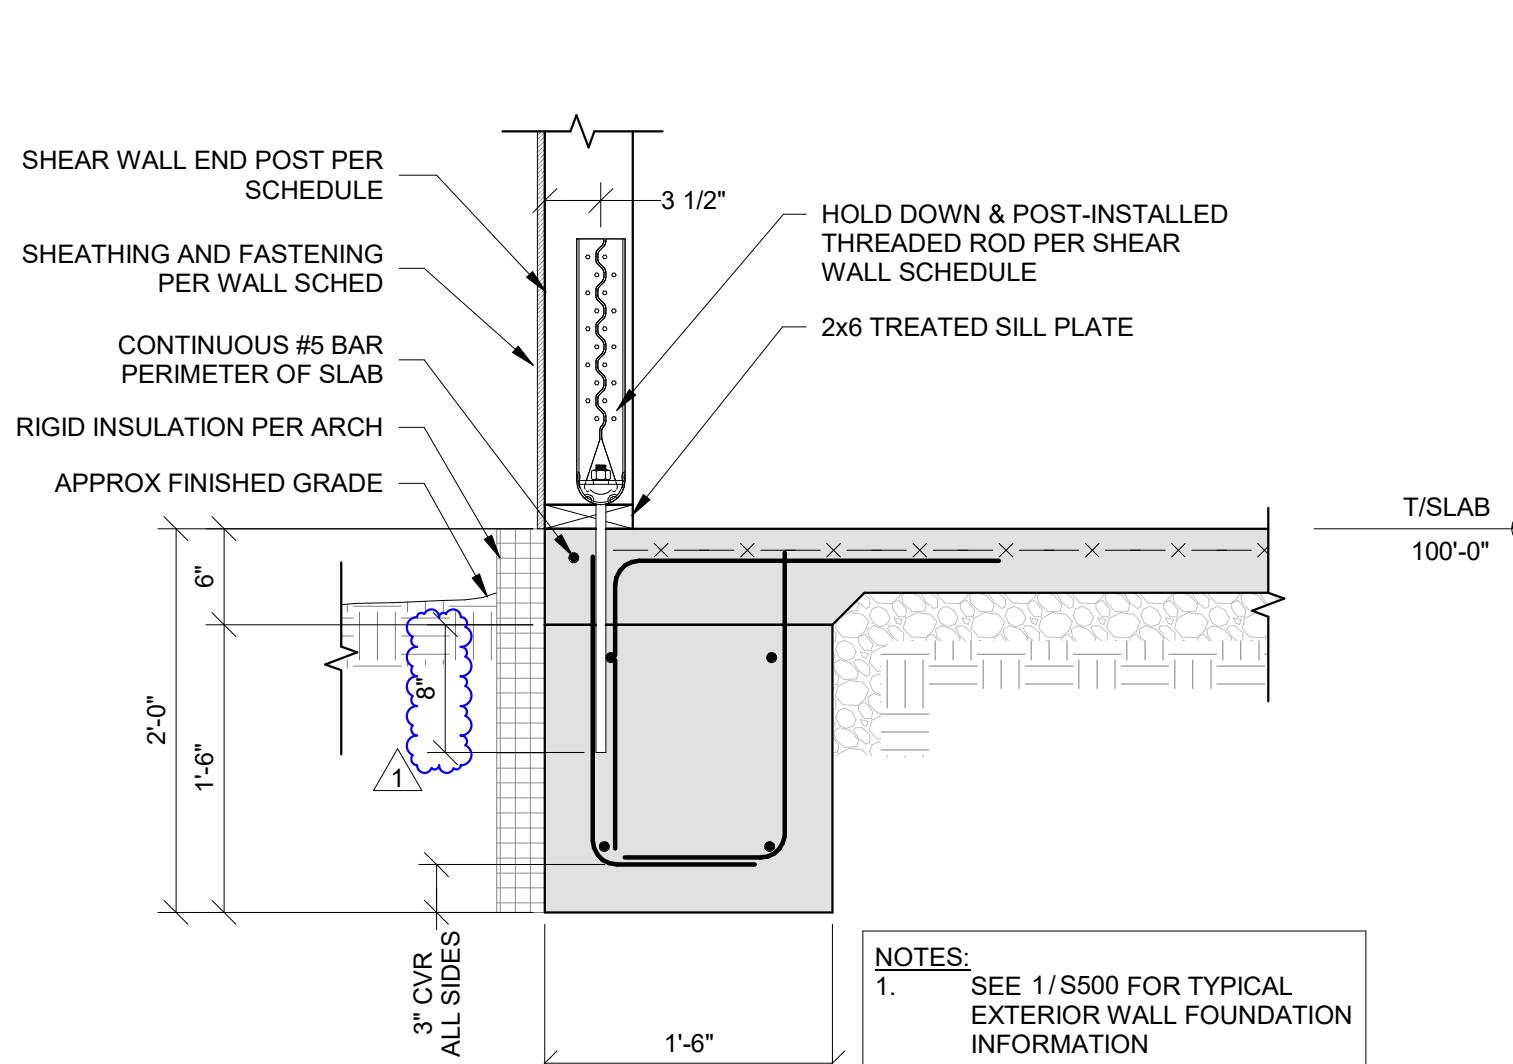


1 EXTERIOR SHEAR WALL SECTION AT HOLD DOWN
S501 1" = 1'-0"

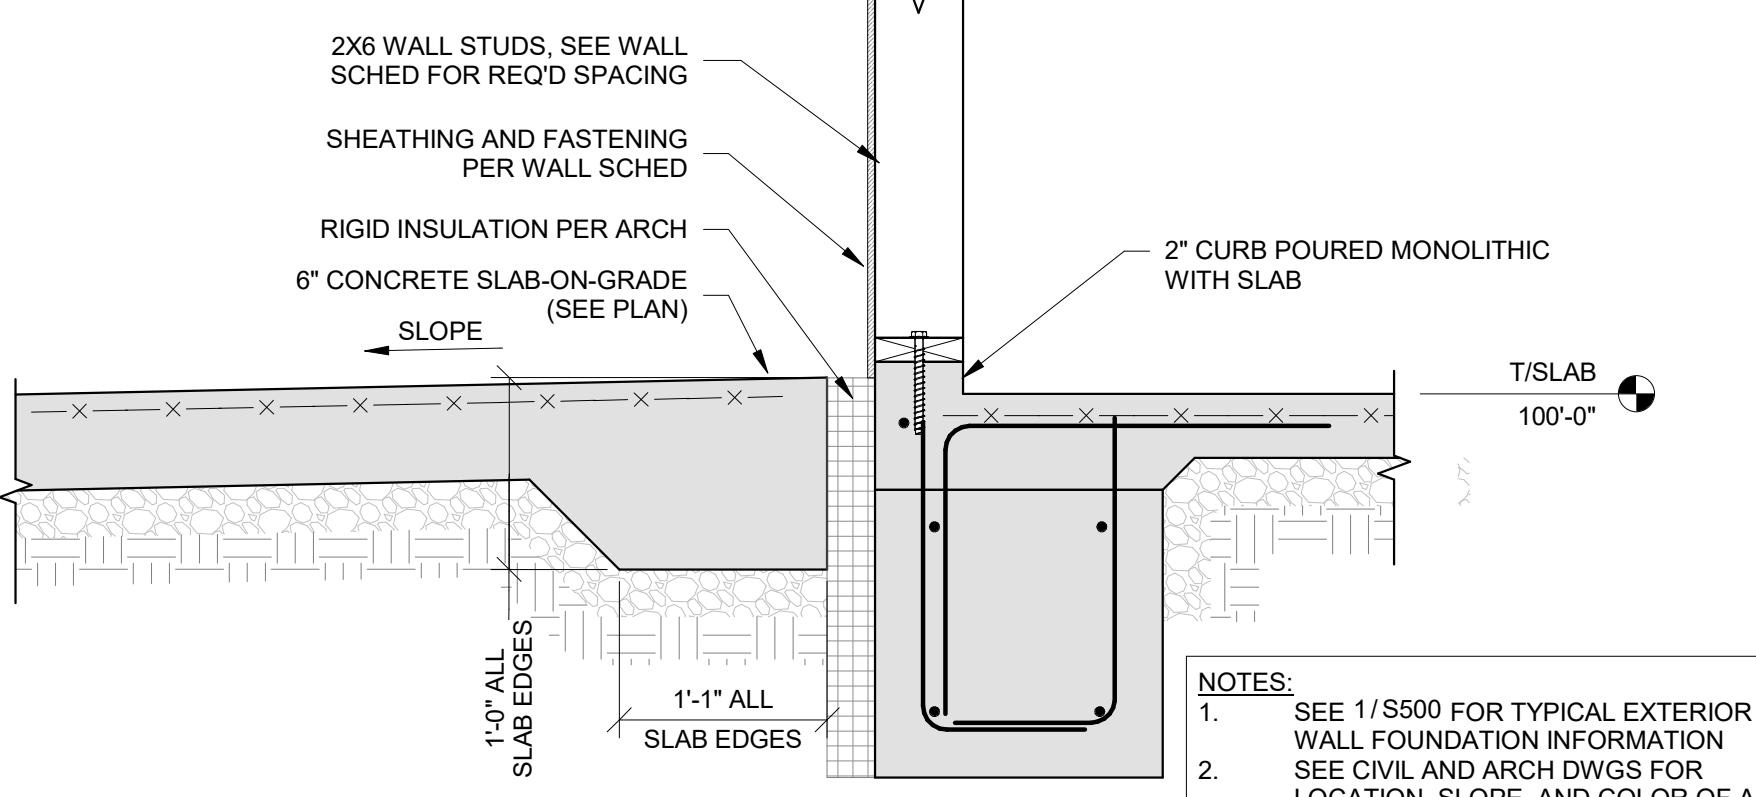

3 FOUNDATION SECTION AT BREEZEWAY
S501 1" = 1'-0"

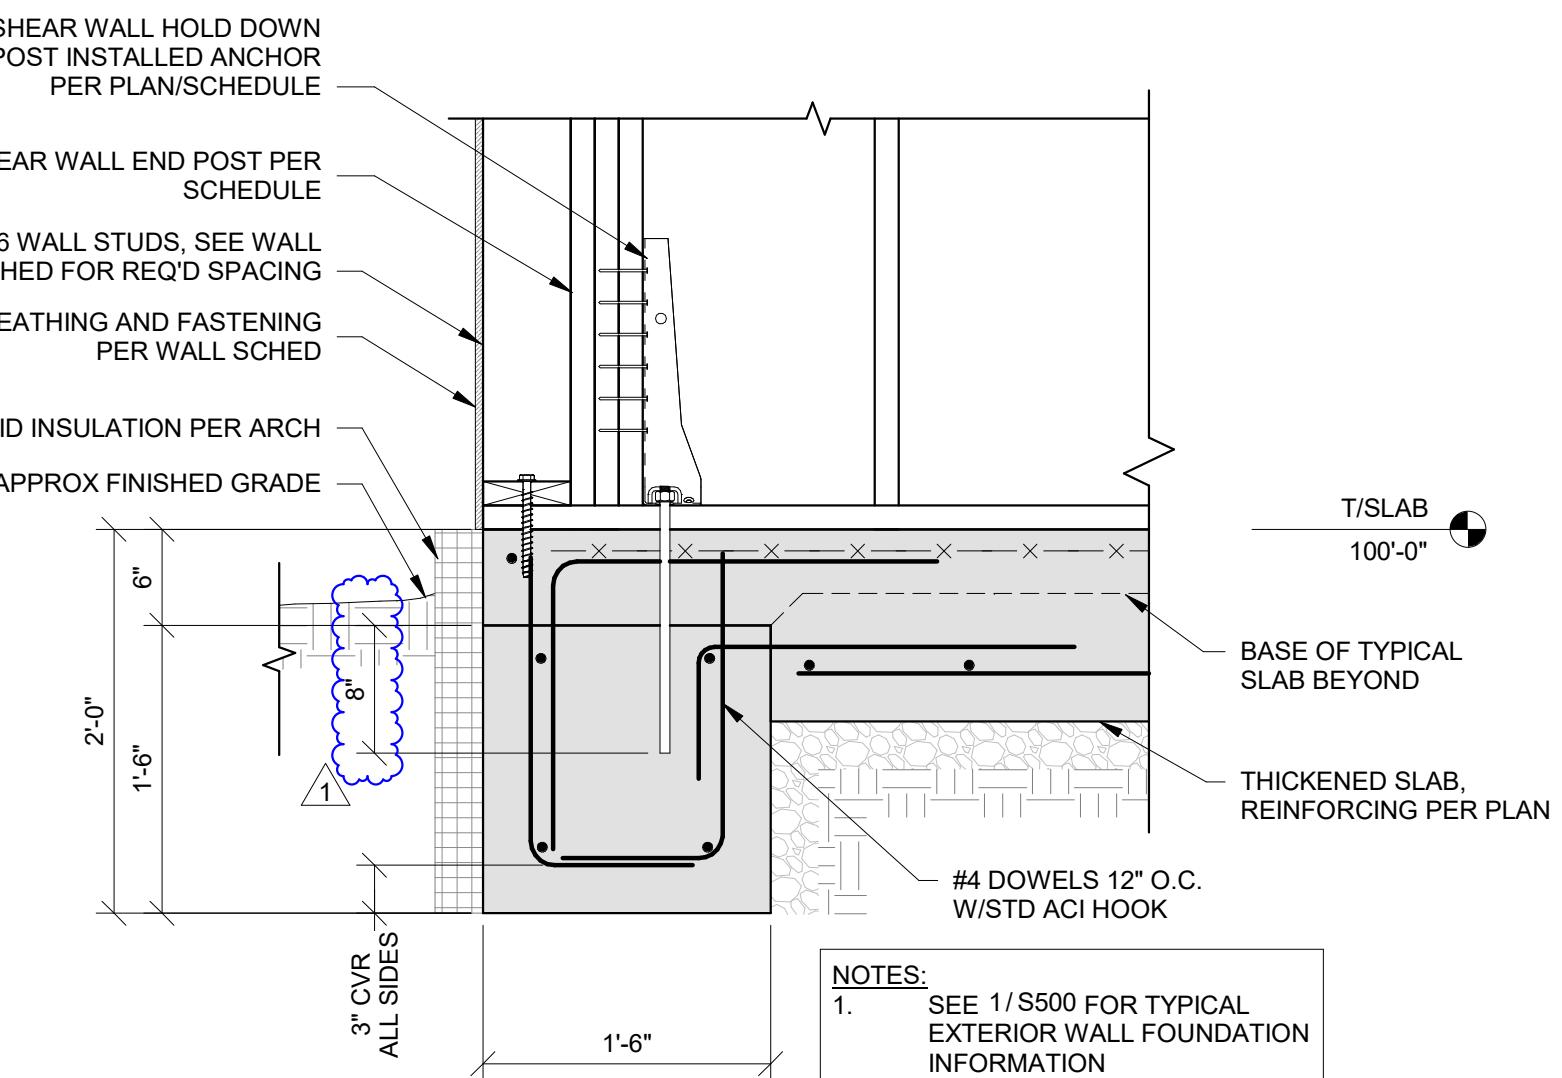

2 S501 INTERIOR SHEAR WALL SECTION AT HOLD DOWN
1" = 1'-0"

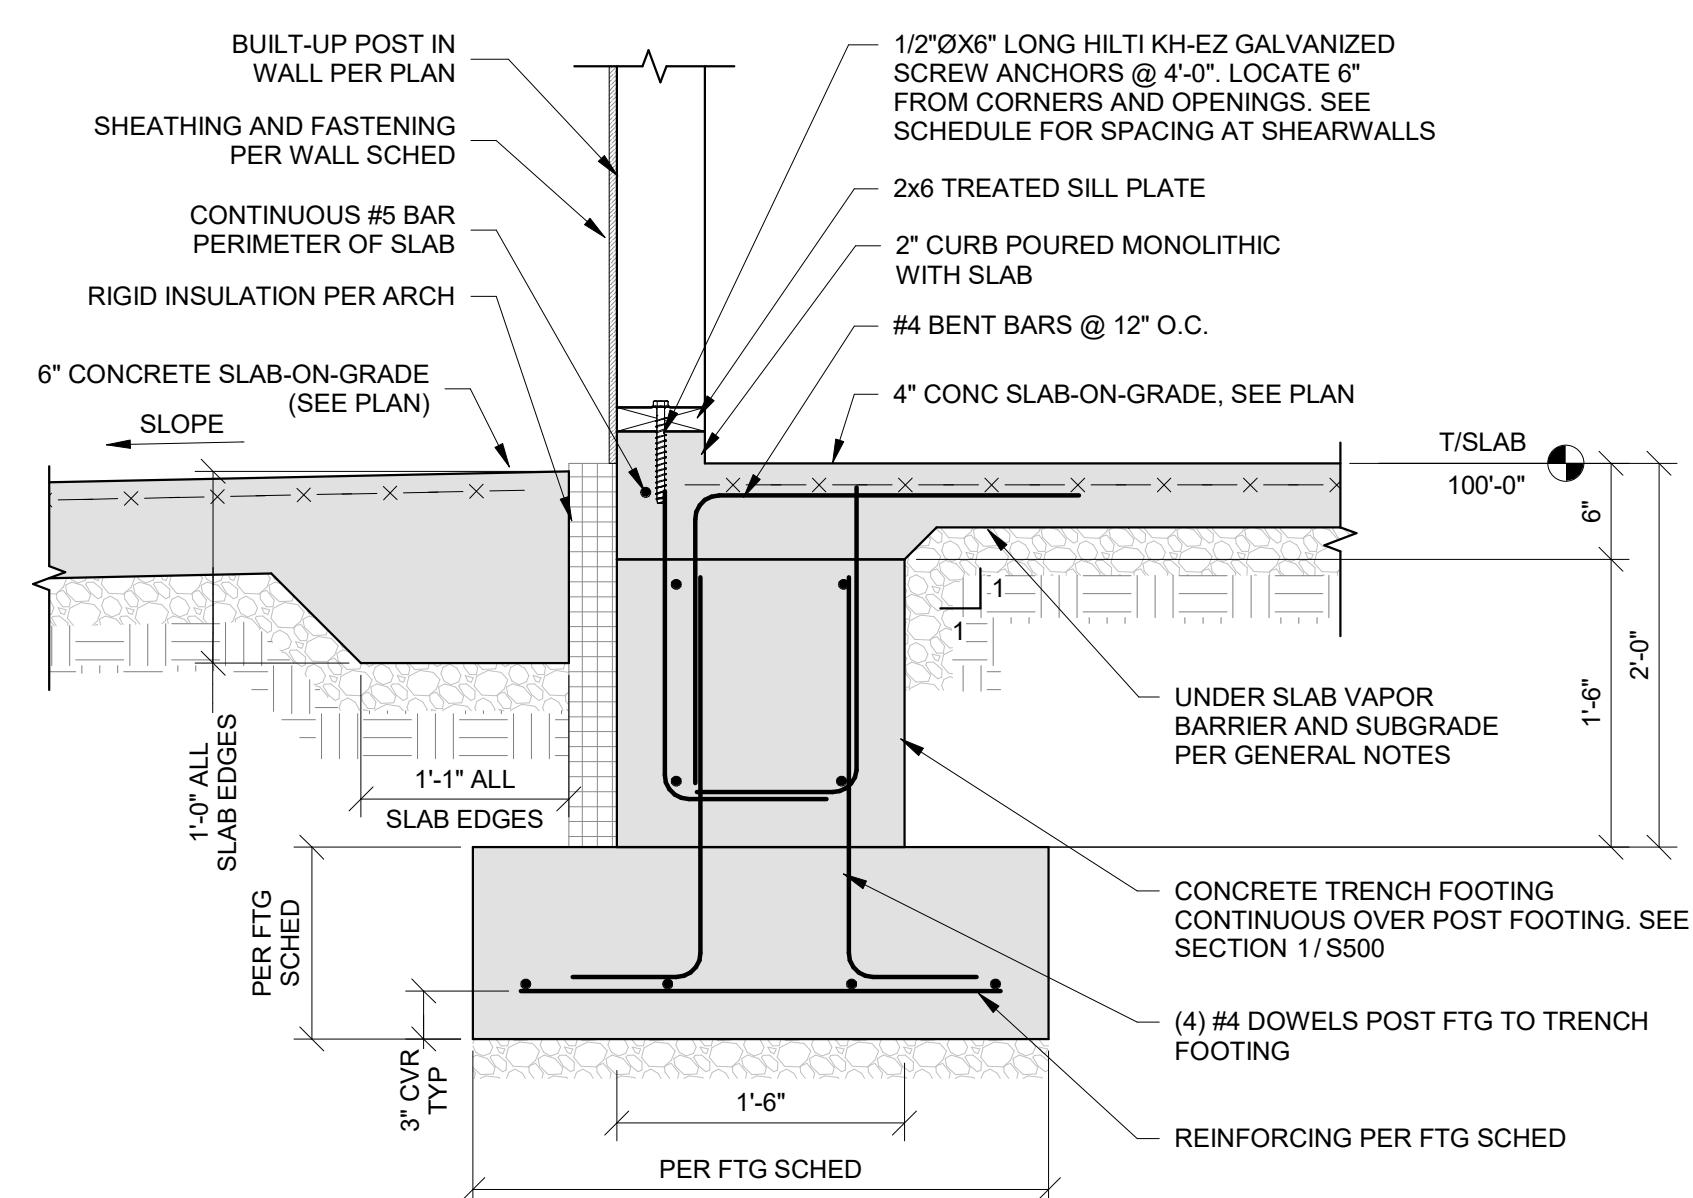


4 FOUNDATION SECTION AT POST IN BREEZEWAY EXTERIOR WALL
S501 1" = 1'-0"

JONES GILLAM RENZ
COBALT CIRCLE
BROWNSVILLE TENNESSEE

FOUNDATION DETAILS

NOTICE:
McClure Engineering Co. is not responsible or liable for any issues, claims, damages, or losses (collectively, "Losses") which arise from failure to follow these Plans, Specifications, and the engineering intent they convey, or for Losses which arise from failure to obtain and/or follow the engineers' or surveyors' guidance with respect to any alleged errors, omissions, inconsistencies, ambiguities, or conflicts contained within the Plans or Specifications.

TENNESSEE CERTIFICATE OF AUTHORITY
NO. 8231

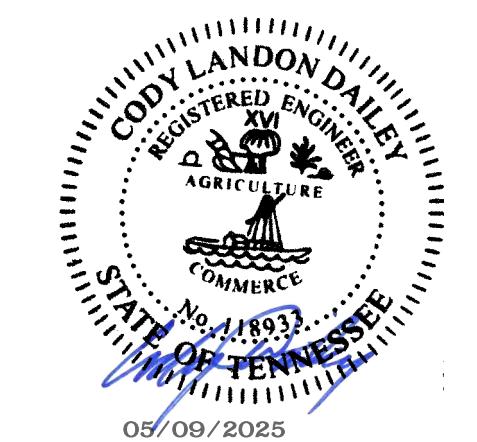

CODY L. DAILEY
118933
EXP: 2/28/2026

I HEREBY CERTIFY THAT THIS ENGINEERING DOCUMENT WAS PREPARED BY ME OR UNDER MY DIRECT PERSONAL SUPERVISION AND THAT I AM A FULLY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF TENNESSEE.

No.	Description	Date
00	PERMIT SET	05/09/2025
01		
02		
03		
04		
05		
06		
07		


PROJECT NUMBER
2024002664
SET ISSUE DATE
05/09/2025

ENGINEER
DRAWN BY
CAS
CHECKED BY
CAS
JTB

JONES GILLAM RENZ
COBALT CIRCLE
BROWNSVILLE, TENNESSEE

Autodesk DocID:202402664 - JGR_CobaltCircle202402664 - JGR_CobaltCircleR24.M

TYPICAL WOOD DETAILS

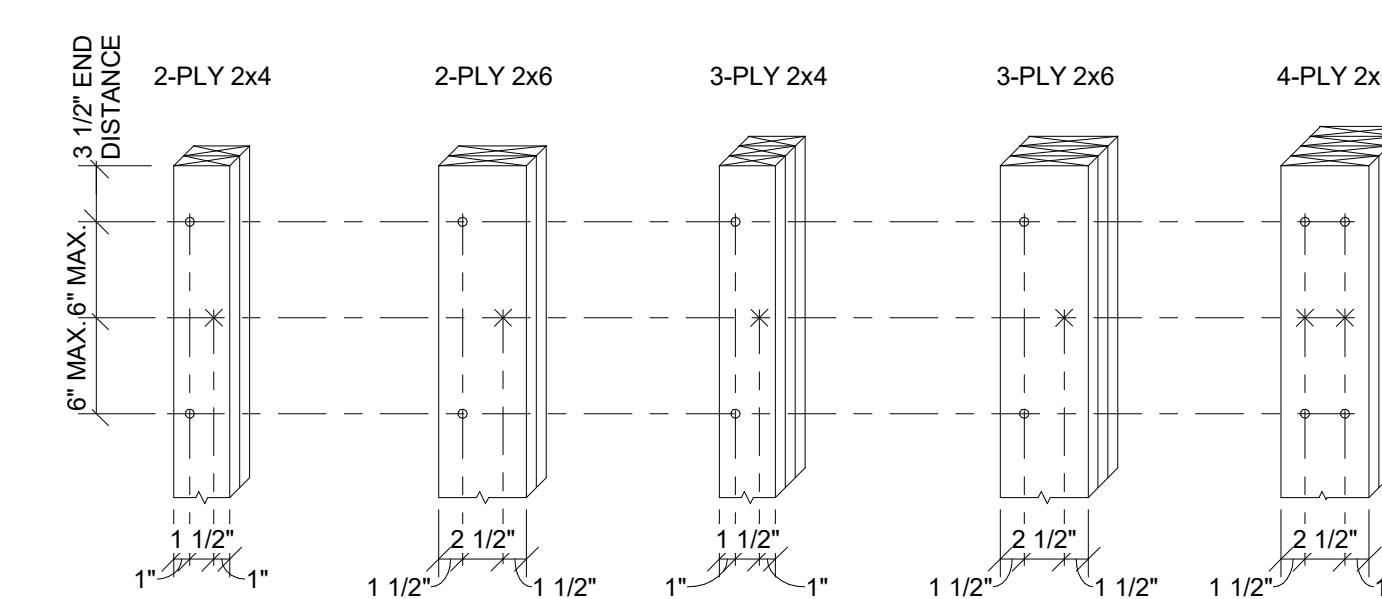


LEGEND
° NAIL FROM THIS SIDE X NAIL FROM OPPOSITE SIDE


COLUMN NOTES:
1. USE 10d NAILS FOR 2-PLY & 30d FOR REST.
2. ADJACENT NAILS ARE TO BE DRIVEN FROM OPPOSITE SIDES OF COLUMN

BUILT UP COLUMN


1 **TYPICAL BUILT-UP MEMBERS**
S505 1" = 1'-0"

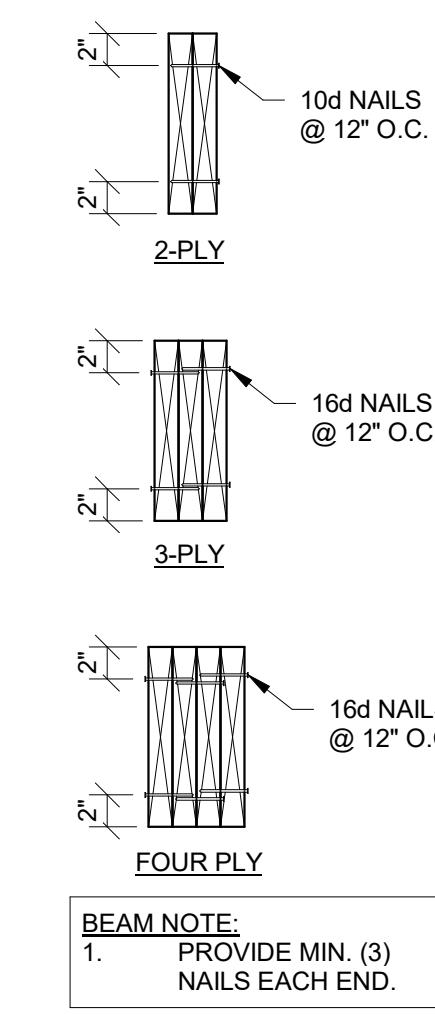


BUILT UP BEAM

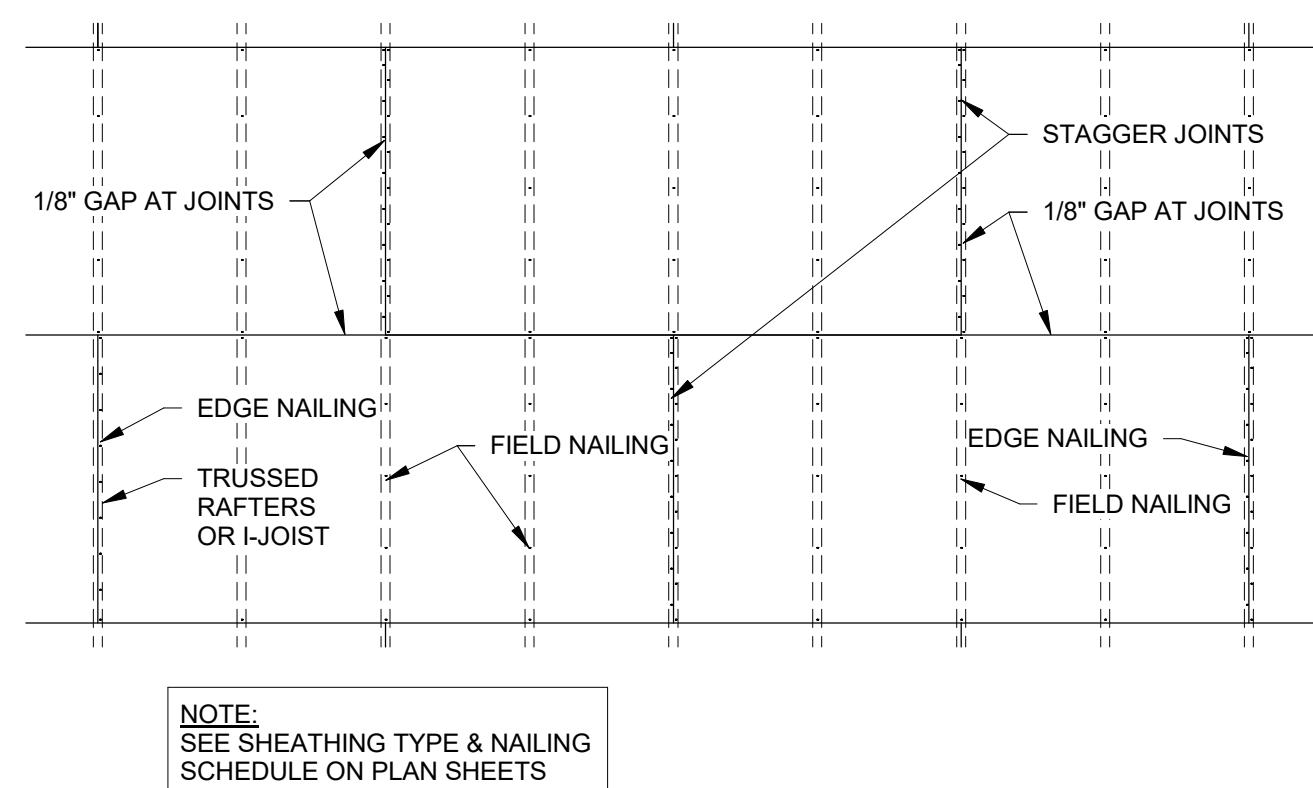


NOTE:
SEE SHEATHING TYPE & NAILING SCHEDULE ON PLAN SHEETS

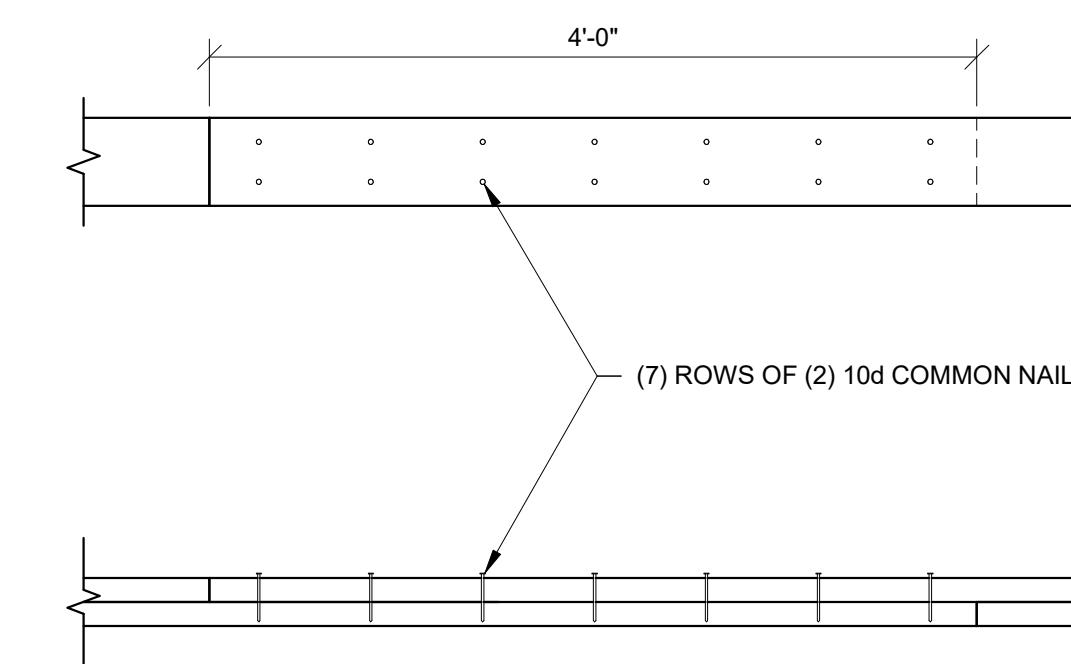


3 **TOP PLATE SPLICE**
S505 1" = 1'-0"

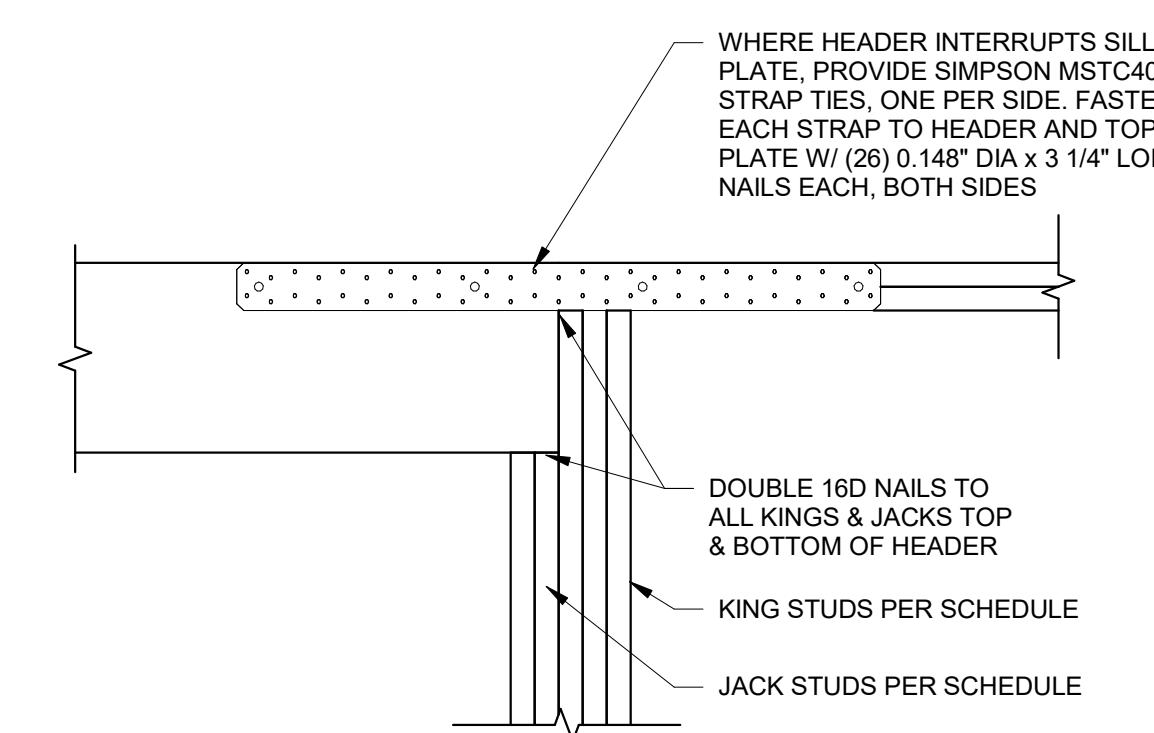


4 **FRAMING AT OPENING - RAISED HEADER**
S505 1" = 1'-0"

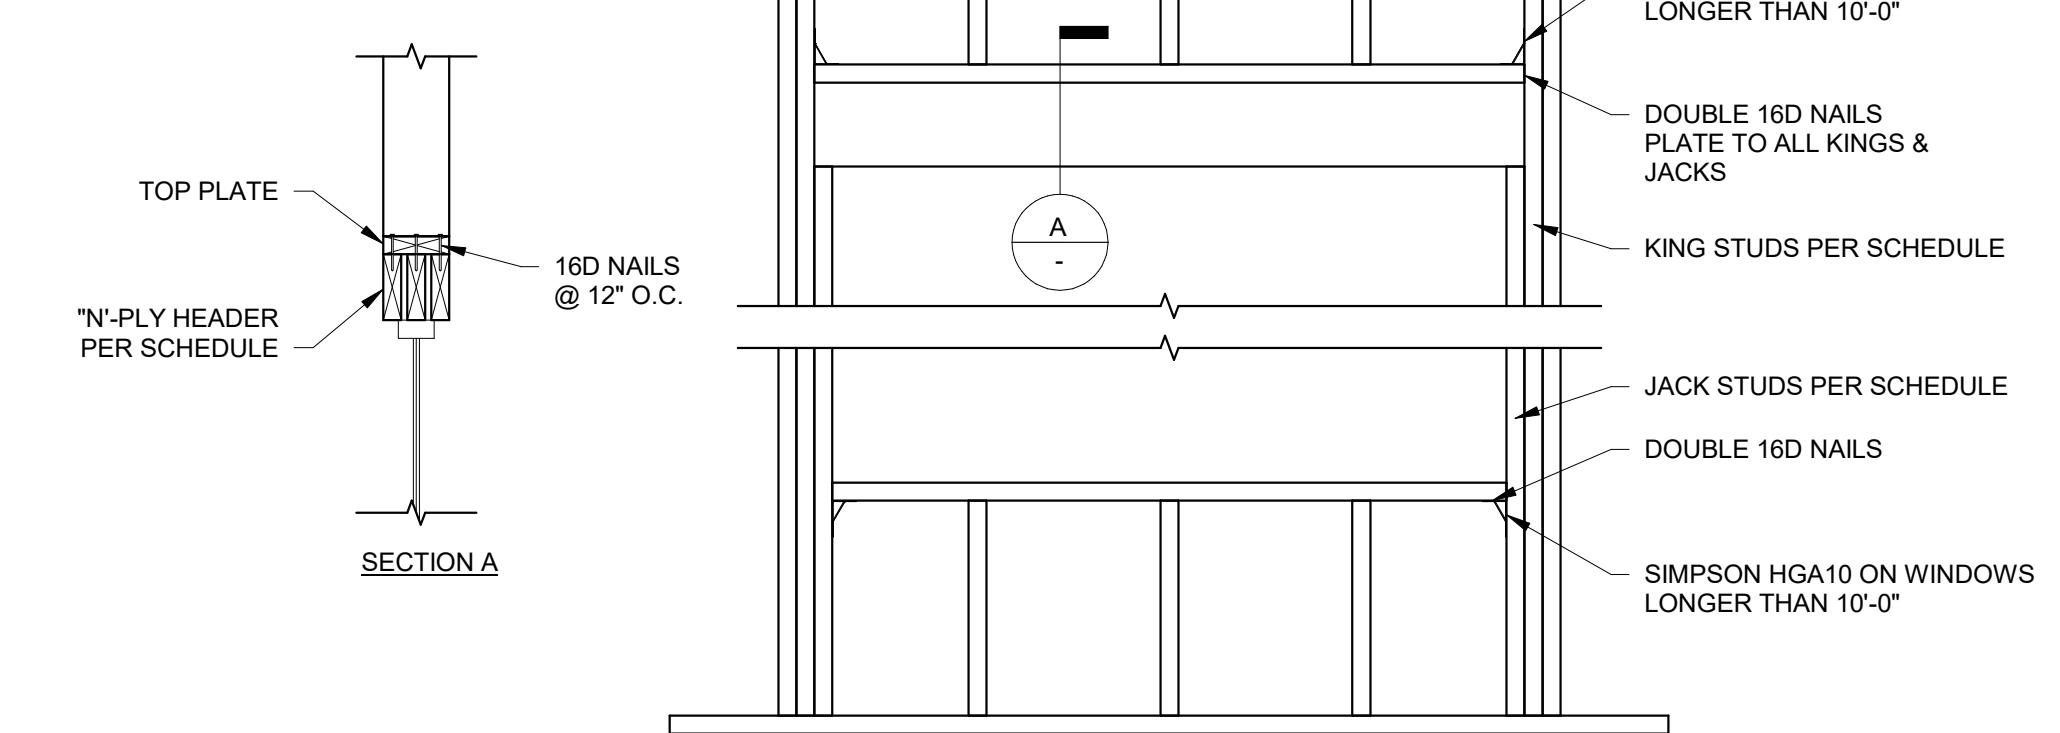


5 **FRAMING AT OPENING**
S505 3/4" = 1'-0"

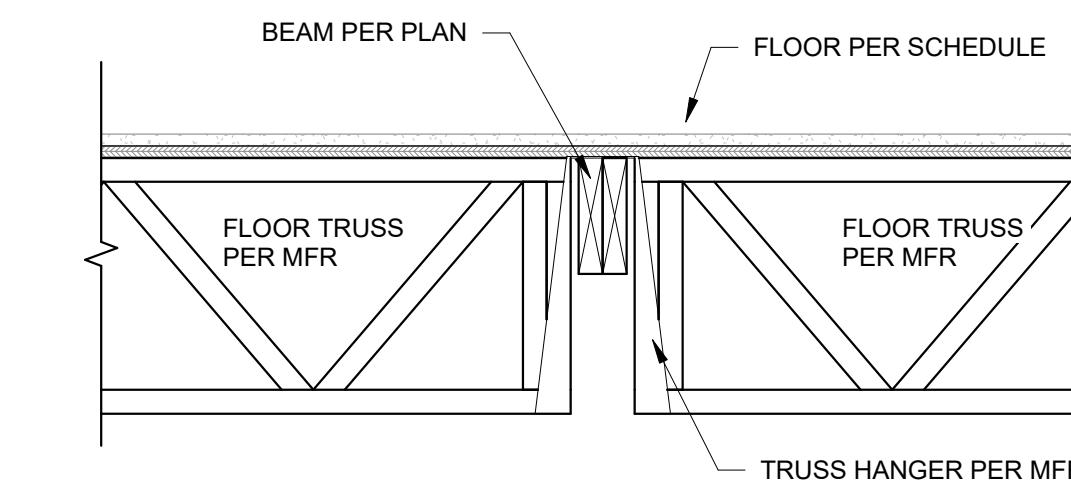

6 **FLOOR TRUSS TO BEAM**
S505 1" = 1'-0"

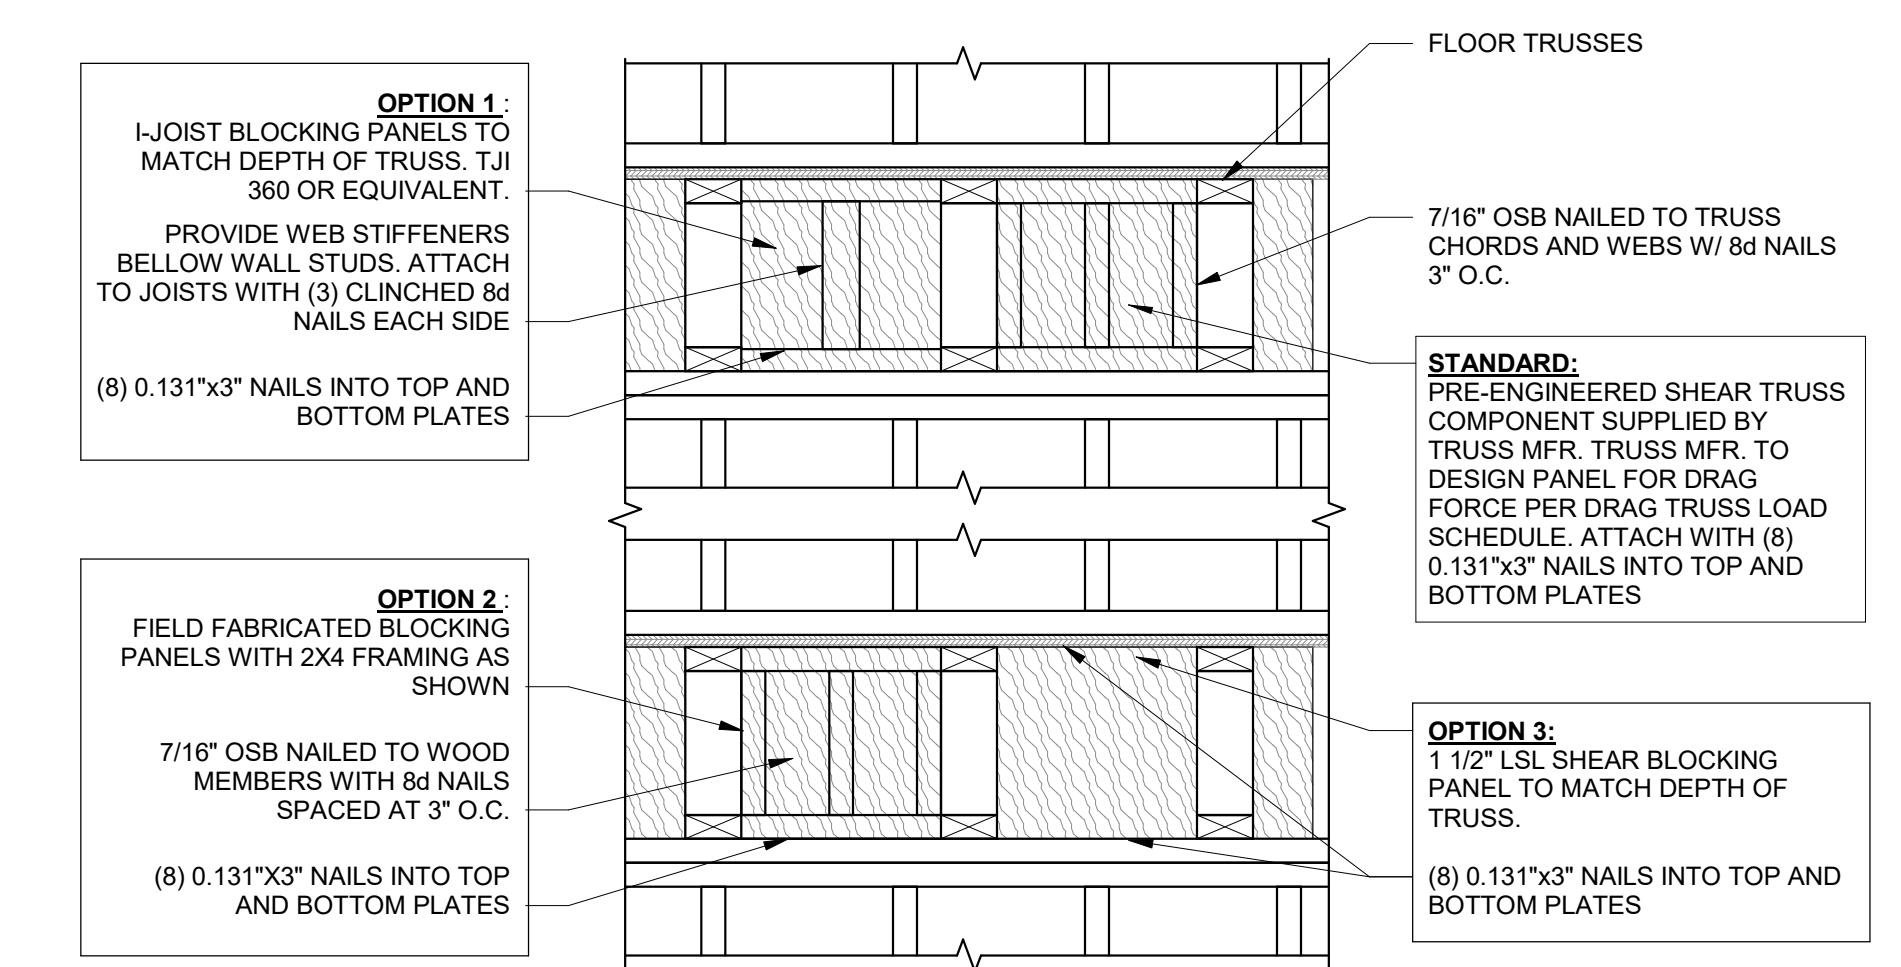


ELEVATION

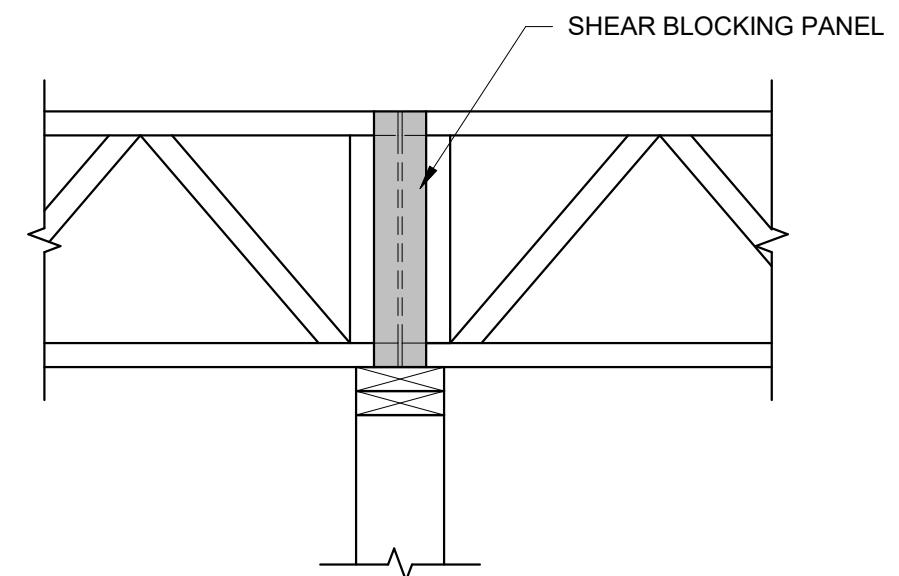


SECTION


7 **SHEAR BLOCKING OPTIONS AT SHEAR WALLS**
S505 1" = 1'-0"

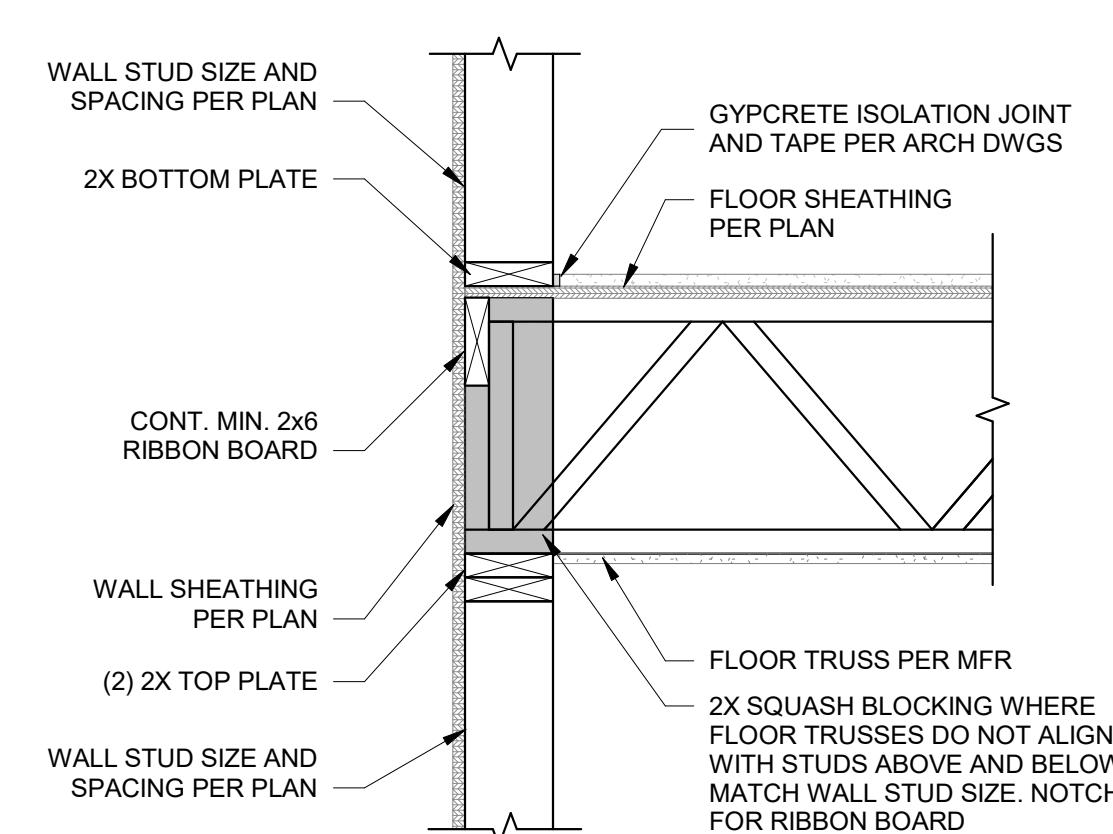


1 FRAMING AT EXTERIOR WALL - JOIST BEARING
S510 1" = 1'-0"

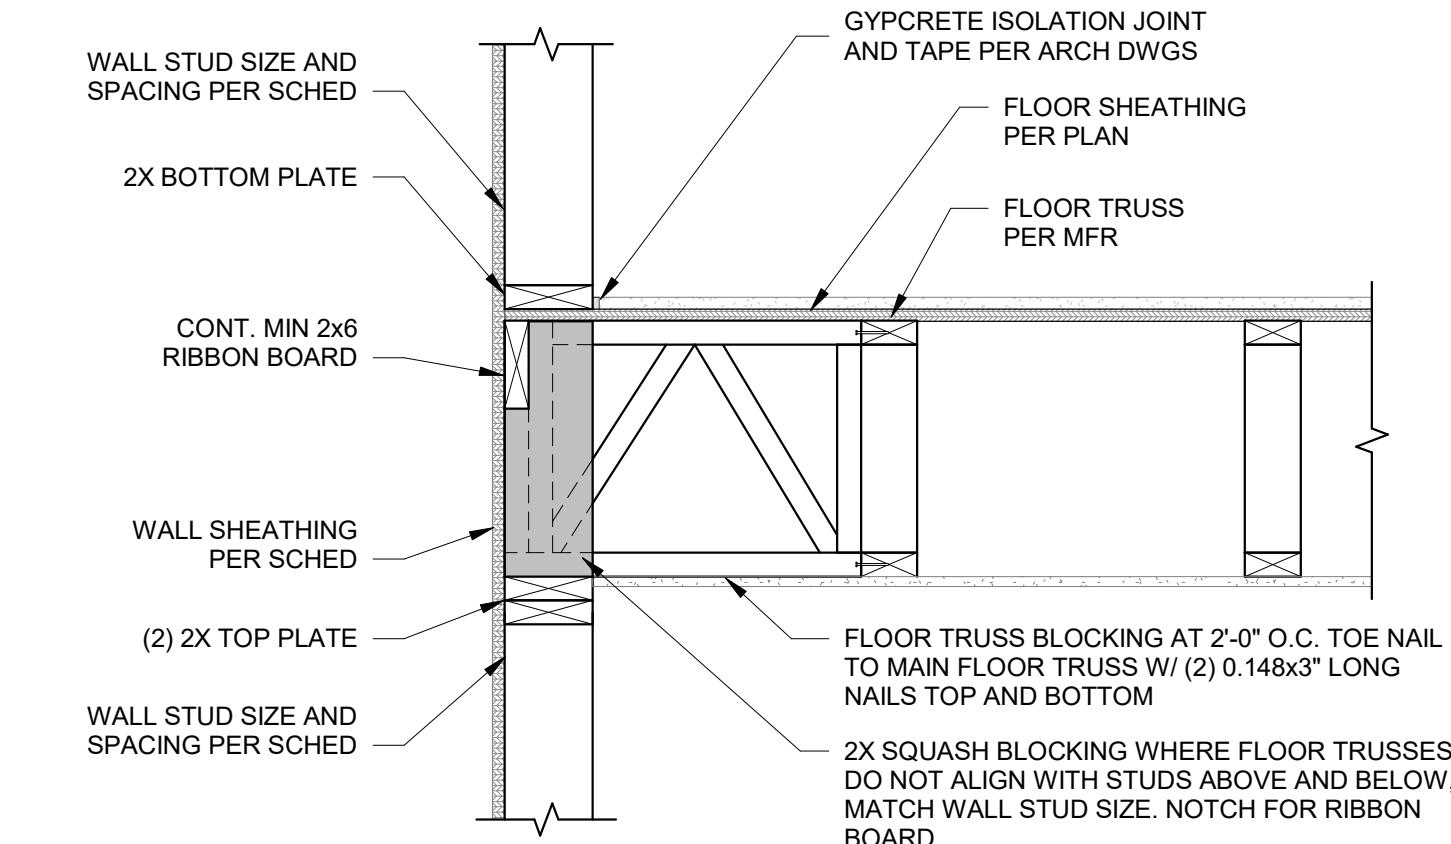


2 FRAMING AT EXTERIOR WALL - JOIST PARALLEL
S510 1" = 1'-0"

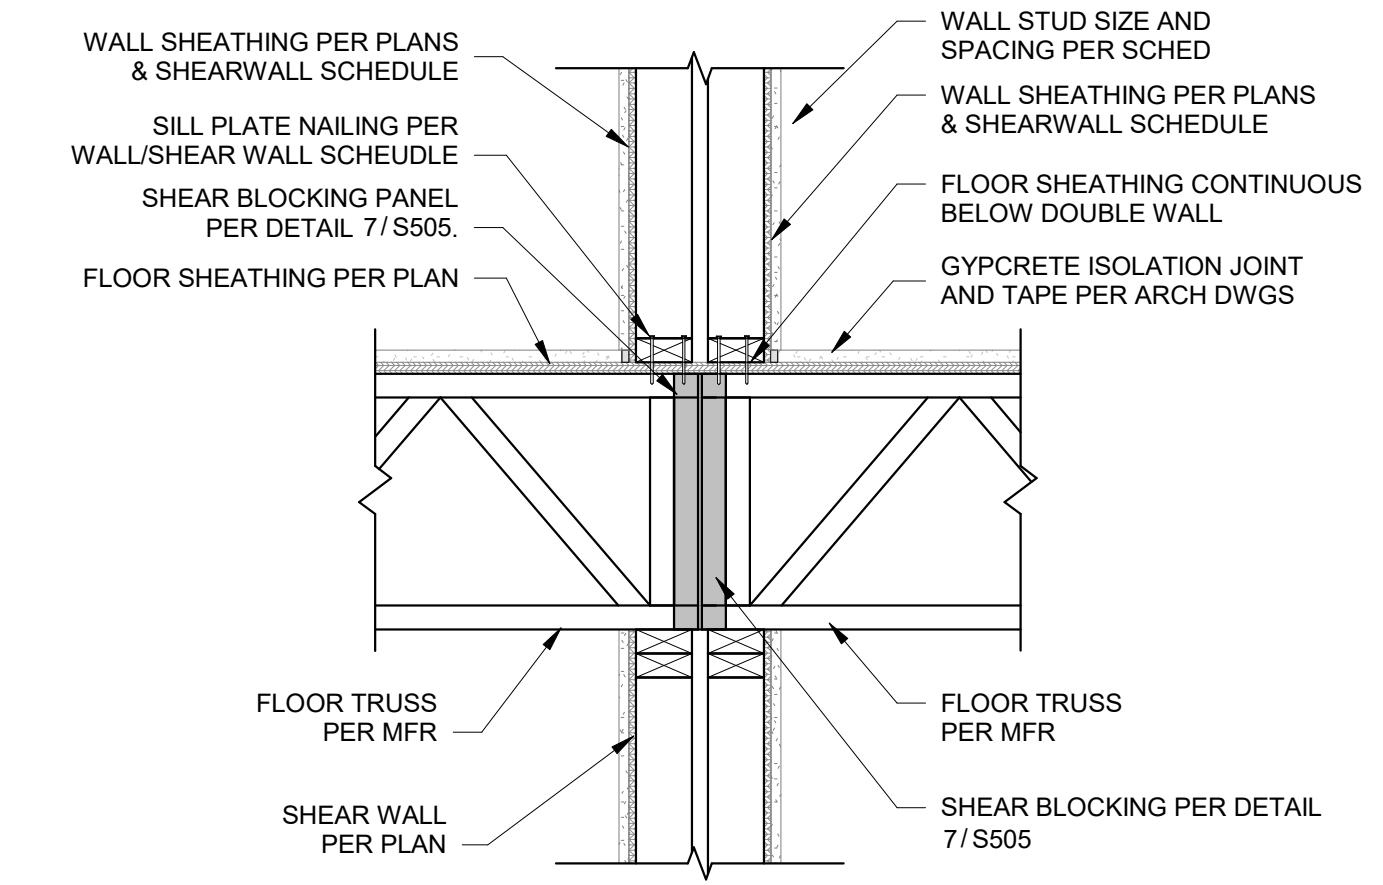


3 FRAMING AT PARTY WALL - JOIST BEARING
S510 1" = 1'-0"

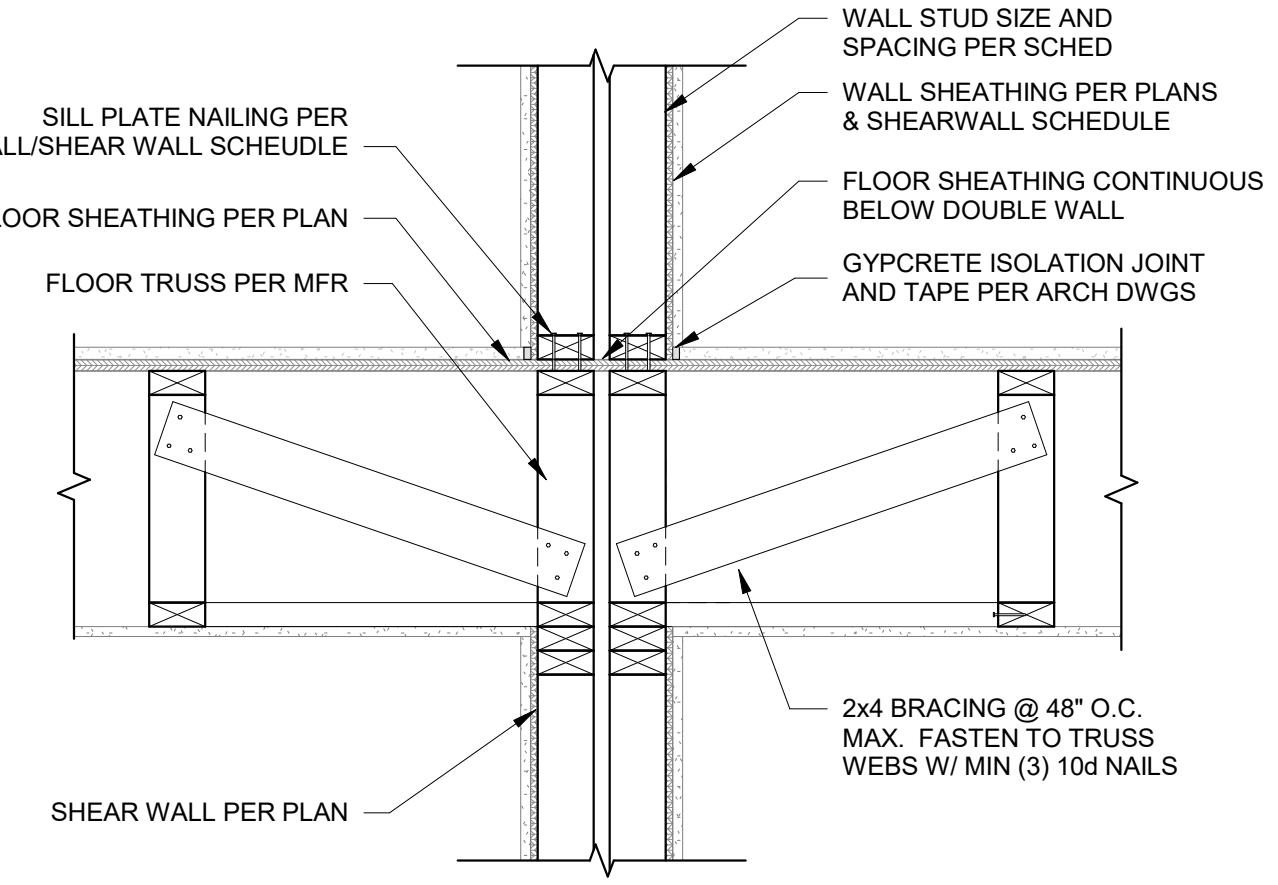


4 FRAMING AT PARTY WALL - JOIST PARALLEL
S510 1" = 1'-0"

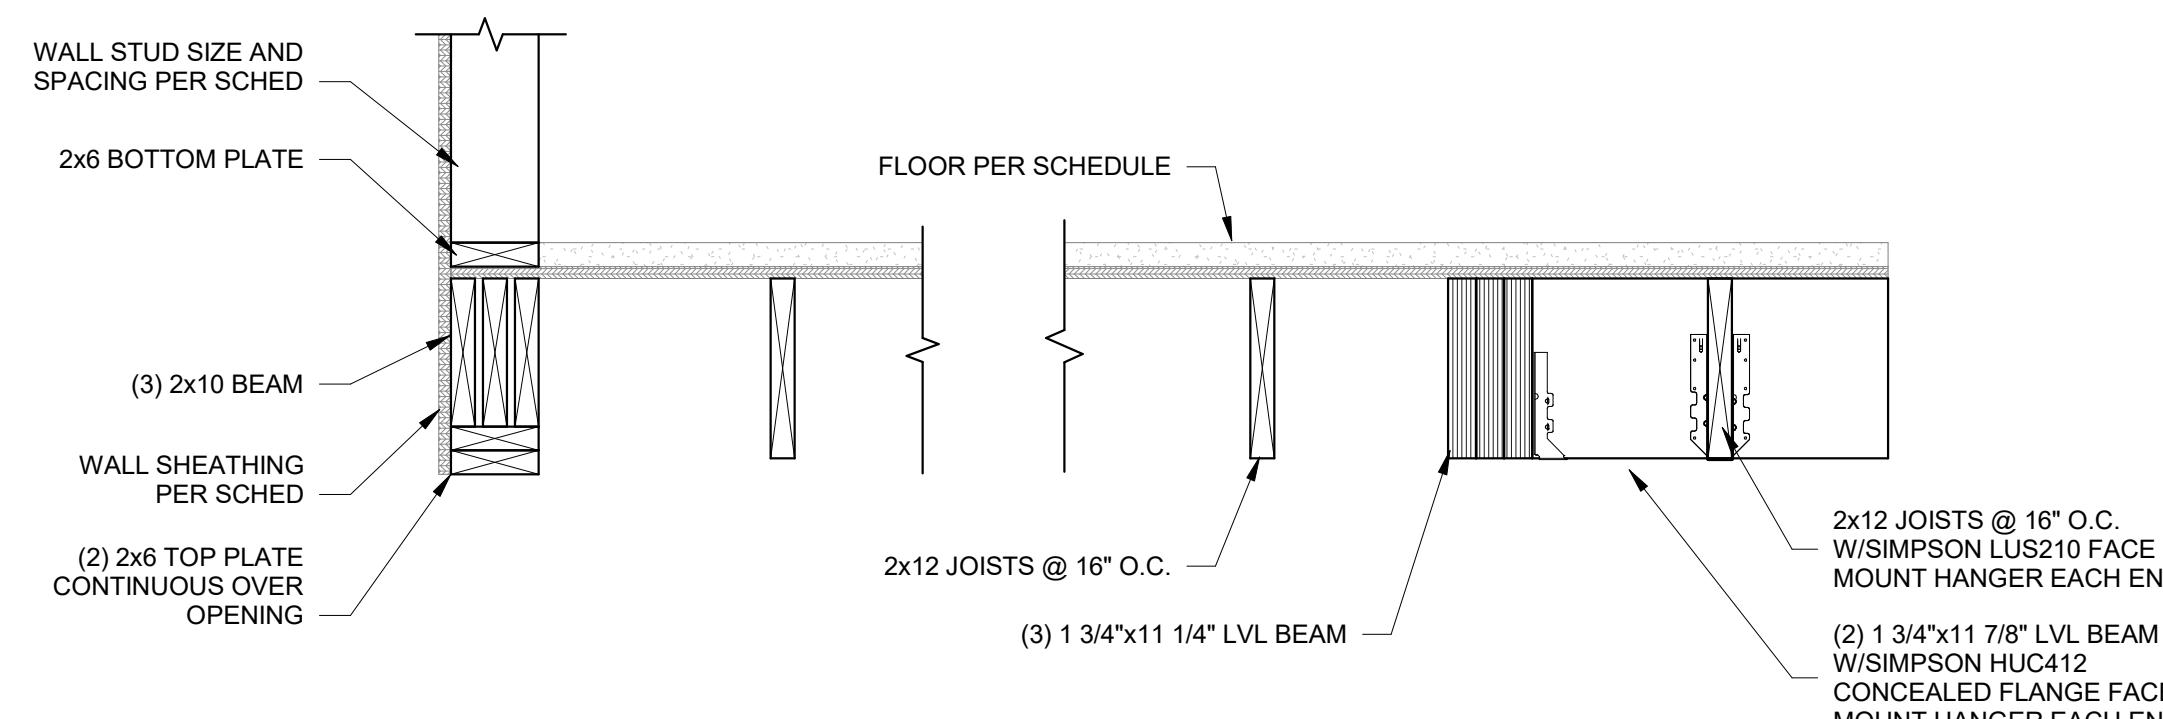

5 JOIST BEARING ON BEAM AT EXTERIOR WALL
S510 1" = 1'-0"

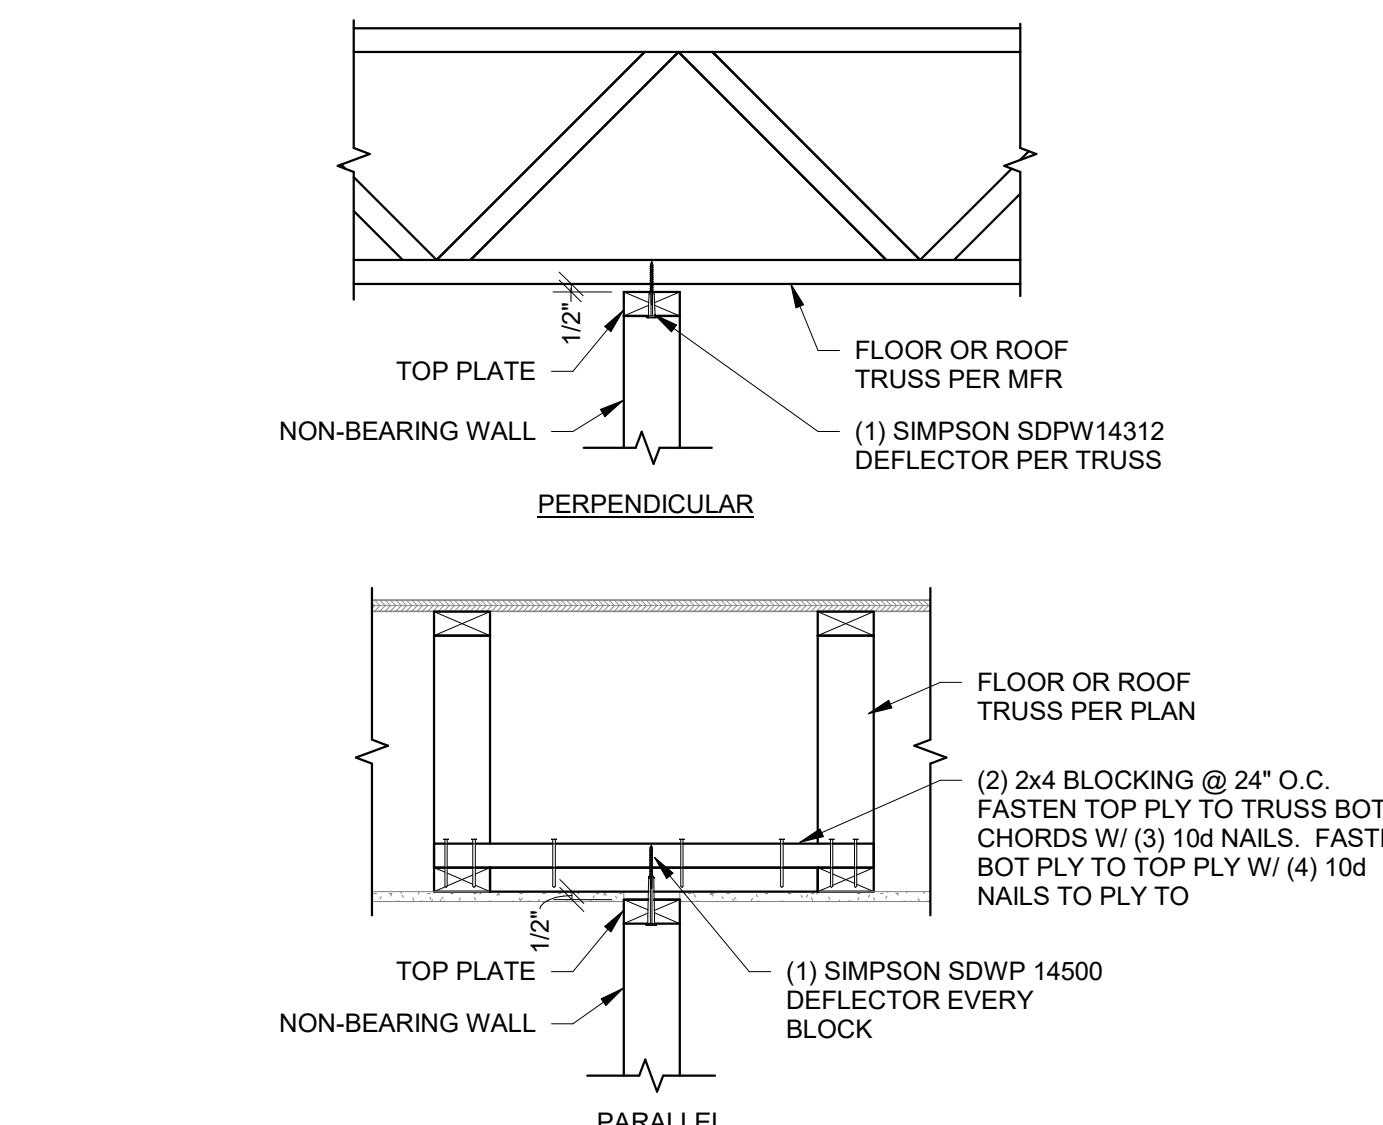

6 NON-STRUCTURAL PARTITION WALL DEFLECTION GAP AND BRACING
S510 1" = 1'-0"

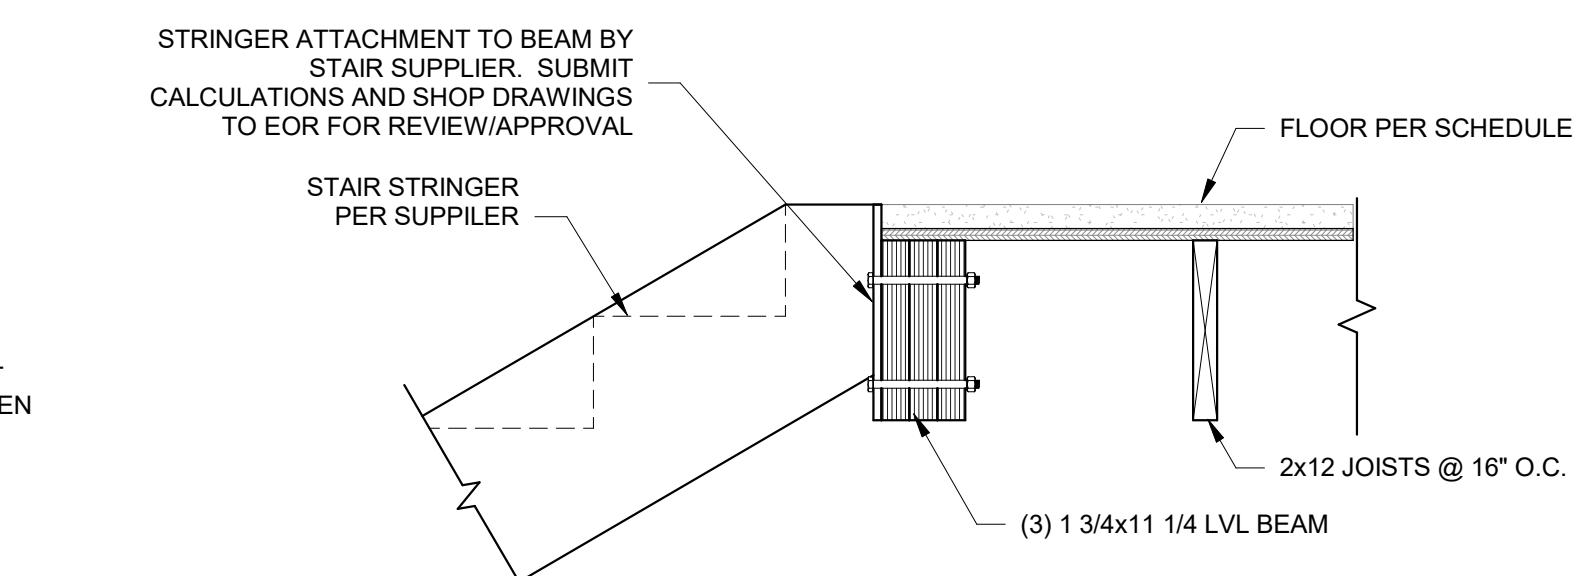

7 LANDING AT FLOOR JOIST
S510 1" = 1'-0"

JONES GILLAM RENZ
COBALT CIRCLE
BROWNSVILLE, TENNESSEE

FRAMING DETAILS


Autodesk DocID:202402664 - JGR_Cobalt Circle/202402664 - JGR - COBALT CIRCLE R24.1M



McCLURETM
2001 W Broadway
Columbia, MO 65203
P 573.814.1568

NOTICE:
McClure Engineering Co. is not responsible or liable for any issues, claims, damages, or losses (collectively, "losses") which arise from failure to follow these Plans, Specifications, and the engineering intent they convey, or for losses which arise from failure to obtain and/or follow the engineers' or surveyors' guidance with respect to any alleged errors, omissions, inconsistencies, ambiguities, or conflicts contained within the Plans or Specifications.

TENNESSEE CERTIFICATE OF AUTHORITY
NO. 8231

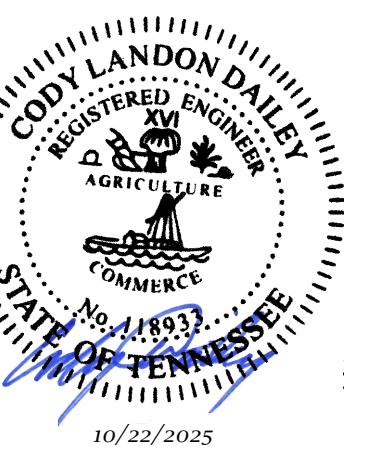

10/22/2025

CODY L. DAILEY
118933
EXP: 2/28/2026

I HEREBY CERTIFY THAT THIS ENGINEERING DOCUMENT WAS PREPARED BY ME OR UNDER MY DIRECT PERSONAL SUPERVISION AND THAT I AM A FULLY LICENSED STRUCTURAL ENGINEER UNDER THE LAWS OF THE STATE OF TENNESSEE.

No.	Description	Date
1	ASI 3 - WALL SCHED & TYP DETAIL	10/22/25
2		
3		
4		
5		


PROJECT NUMBER 2024002664 SET ISSUE DATE 05/09/2025

ENGINEER DRAWN BY CHECKED BY
CAS CAS JTB


JONES GILLAM RENZ
COBALT CIRCLE
BROWNSVILLE, TENNESSEE

Autodesk DocID:202402664 - JGR_Cobalt Circle/202402664 - JGR - COBALT CIRCLE R24.M


FRAMING DETAILS

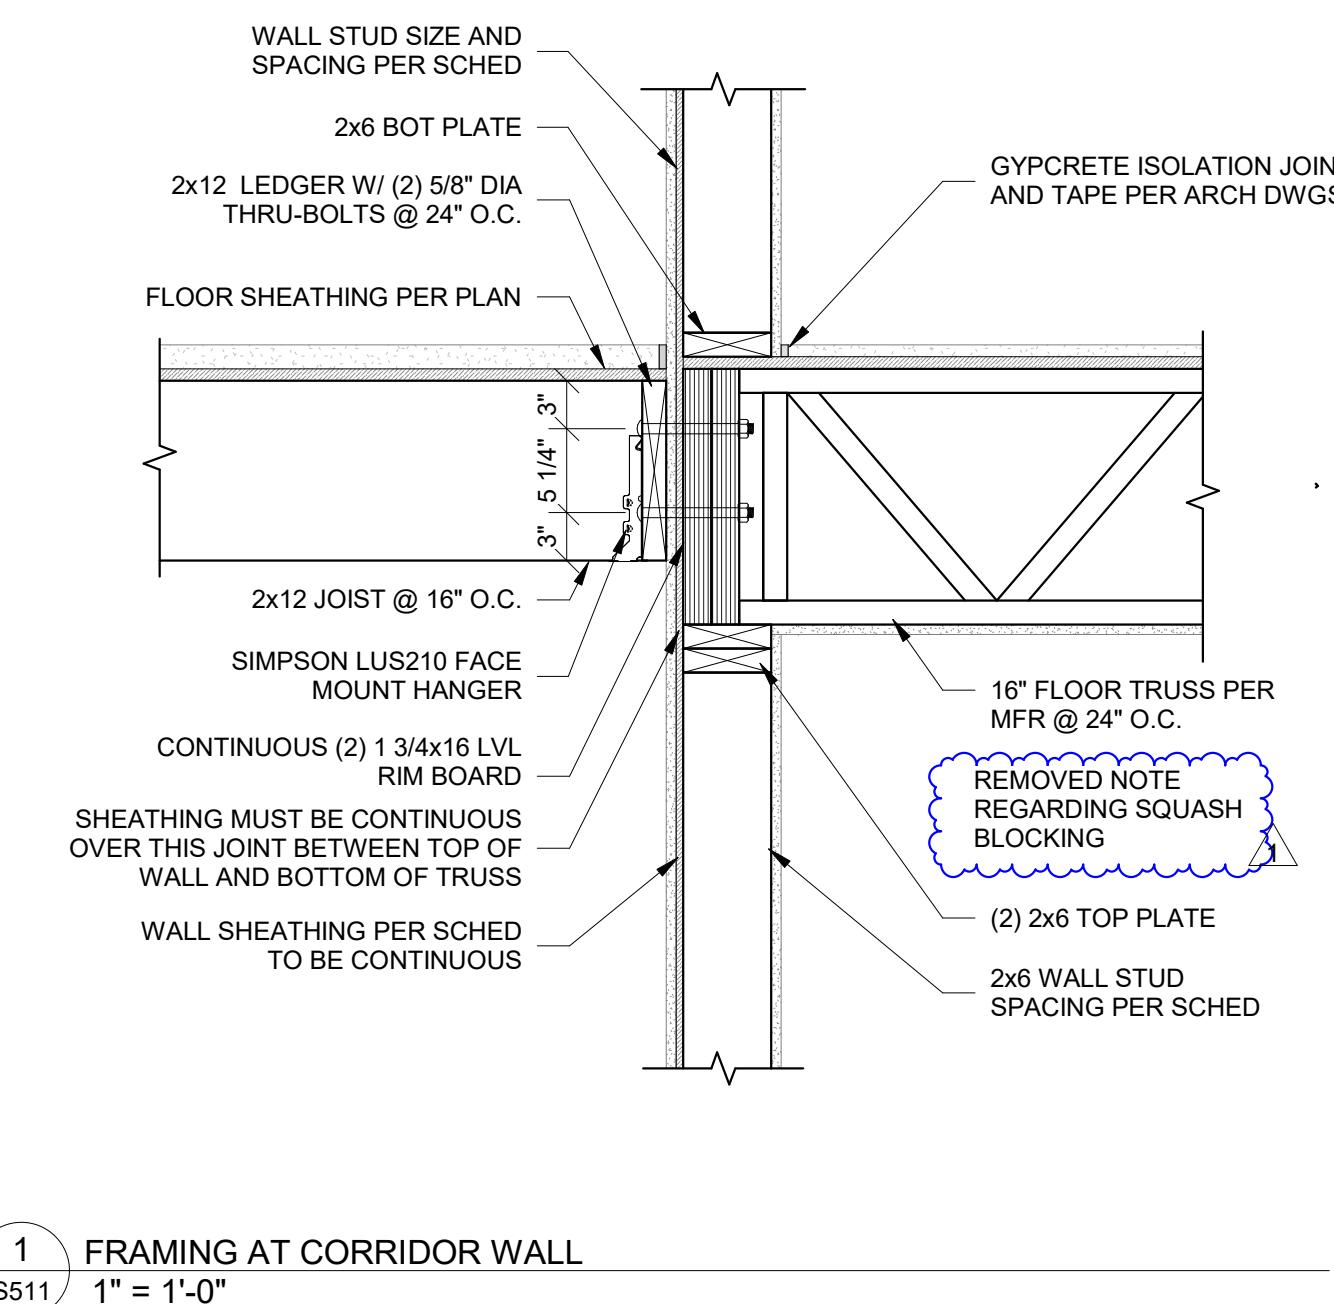


1 FRAMING AT CORRIDOR WALL
S511 1" = 1'-0"

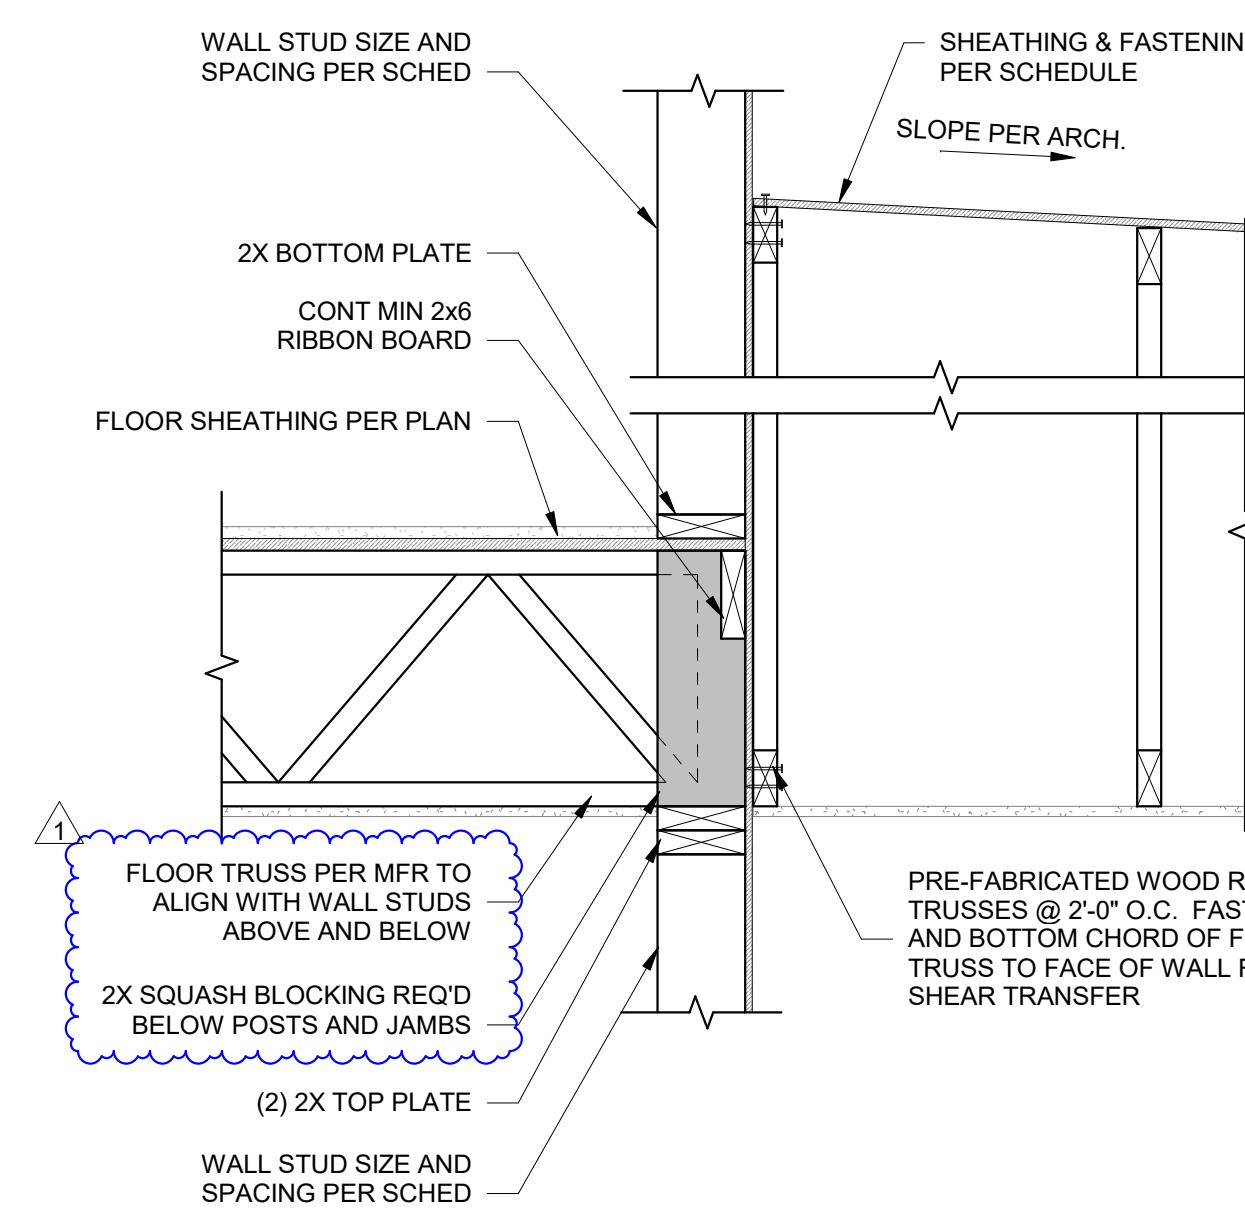

2 LOW ROOF PARALLEL TO WALL
S511 1" = 1'-0"

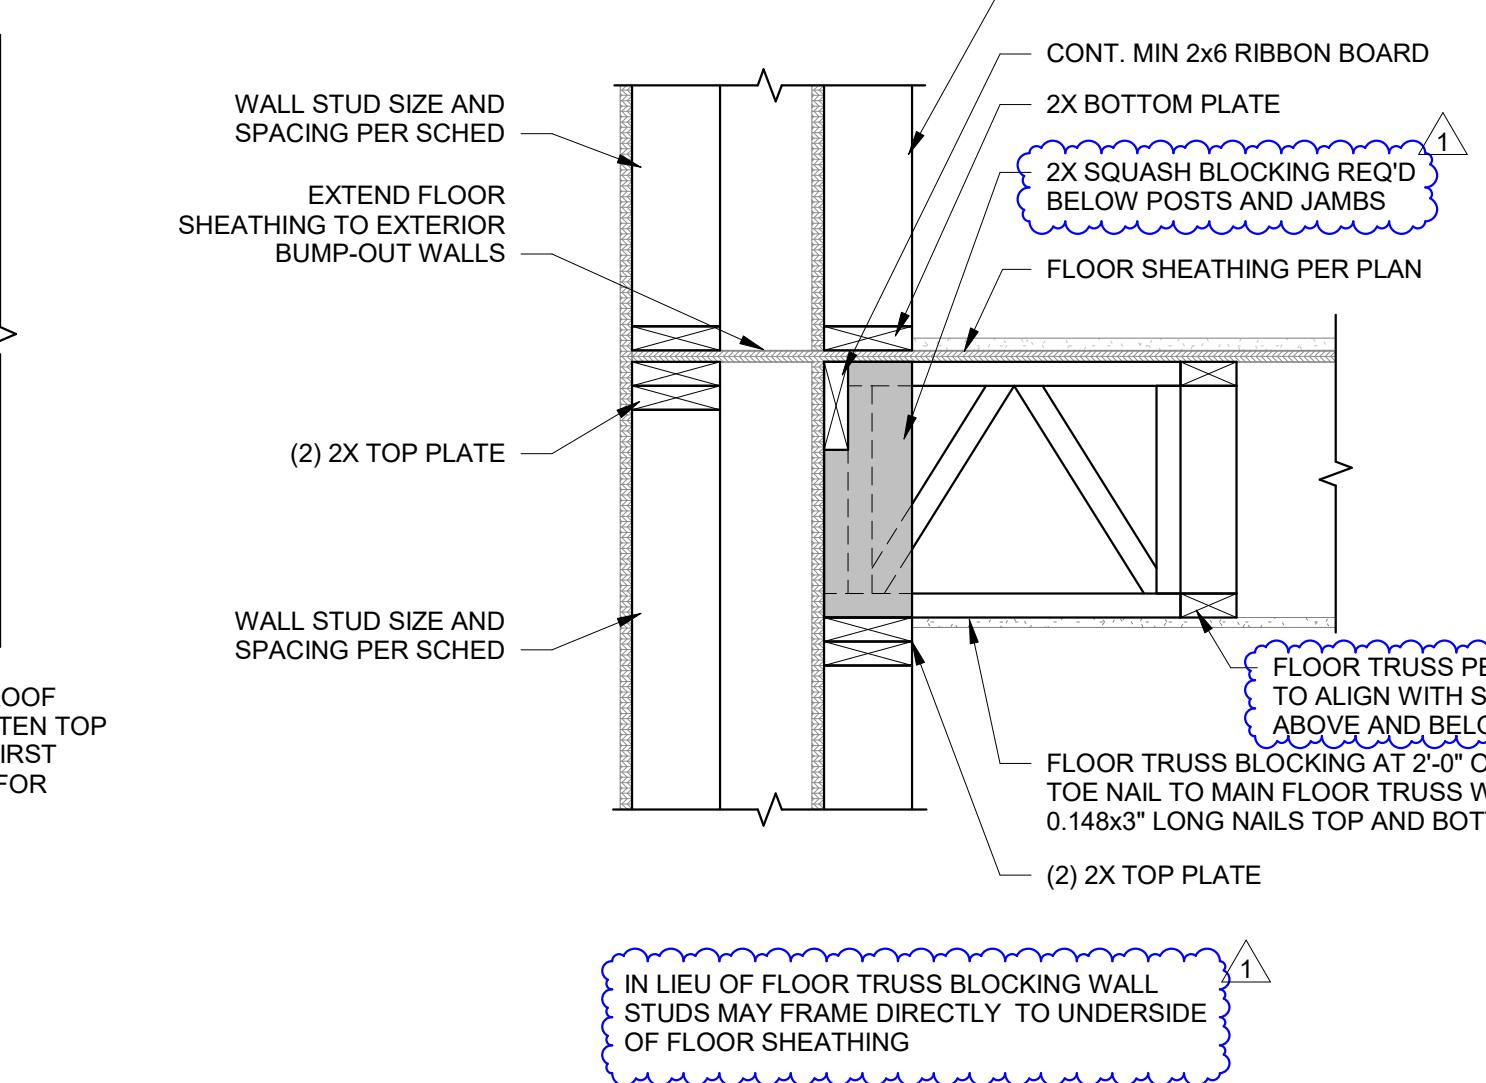

3 FLOOR FRAMING AT BUMP OUT
S511 1" = 1'-0"

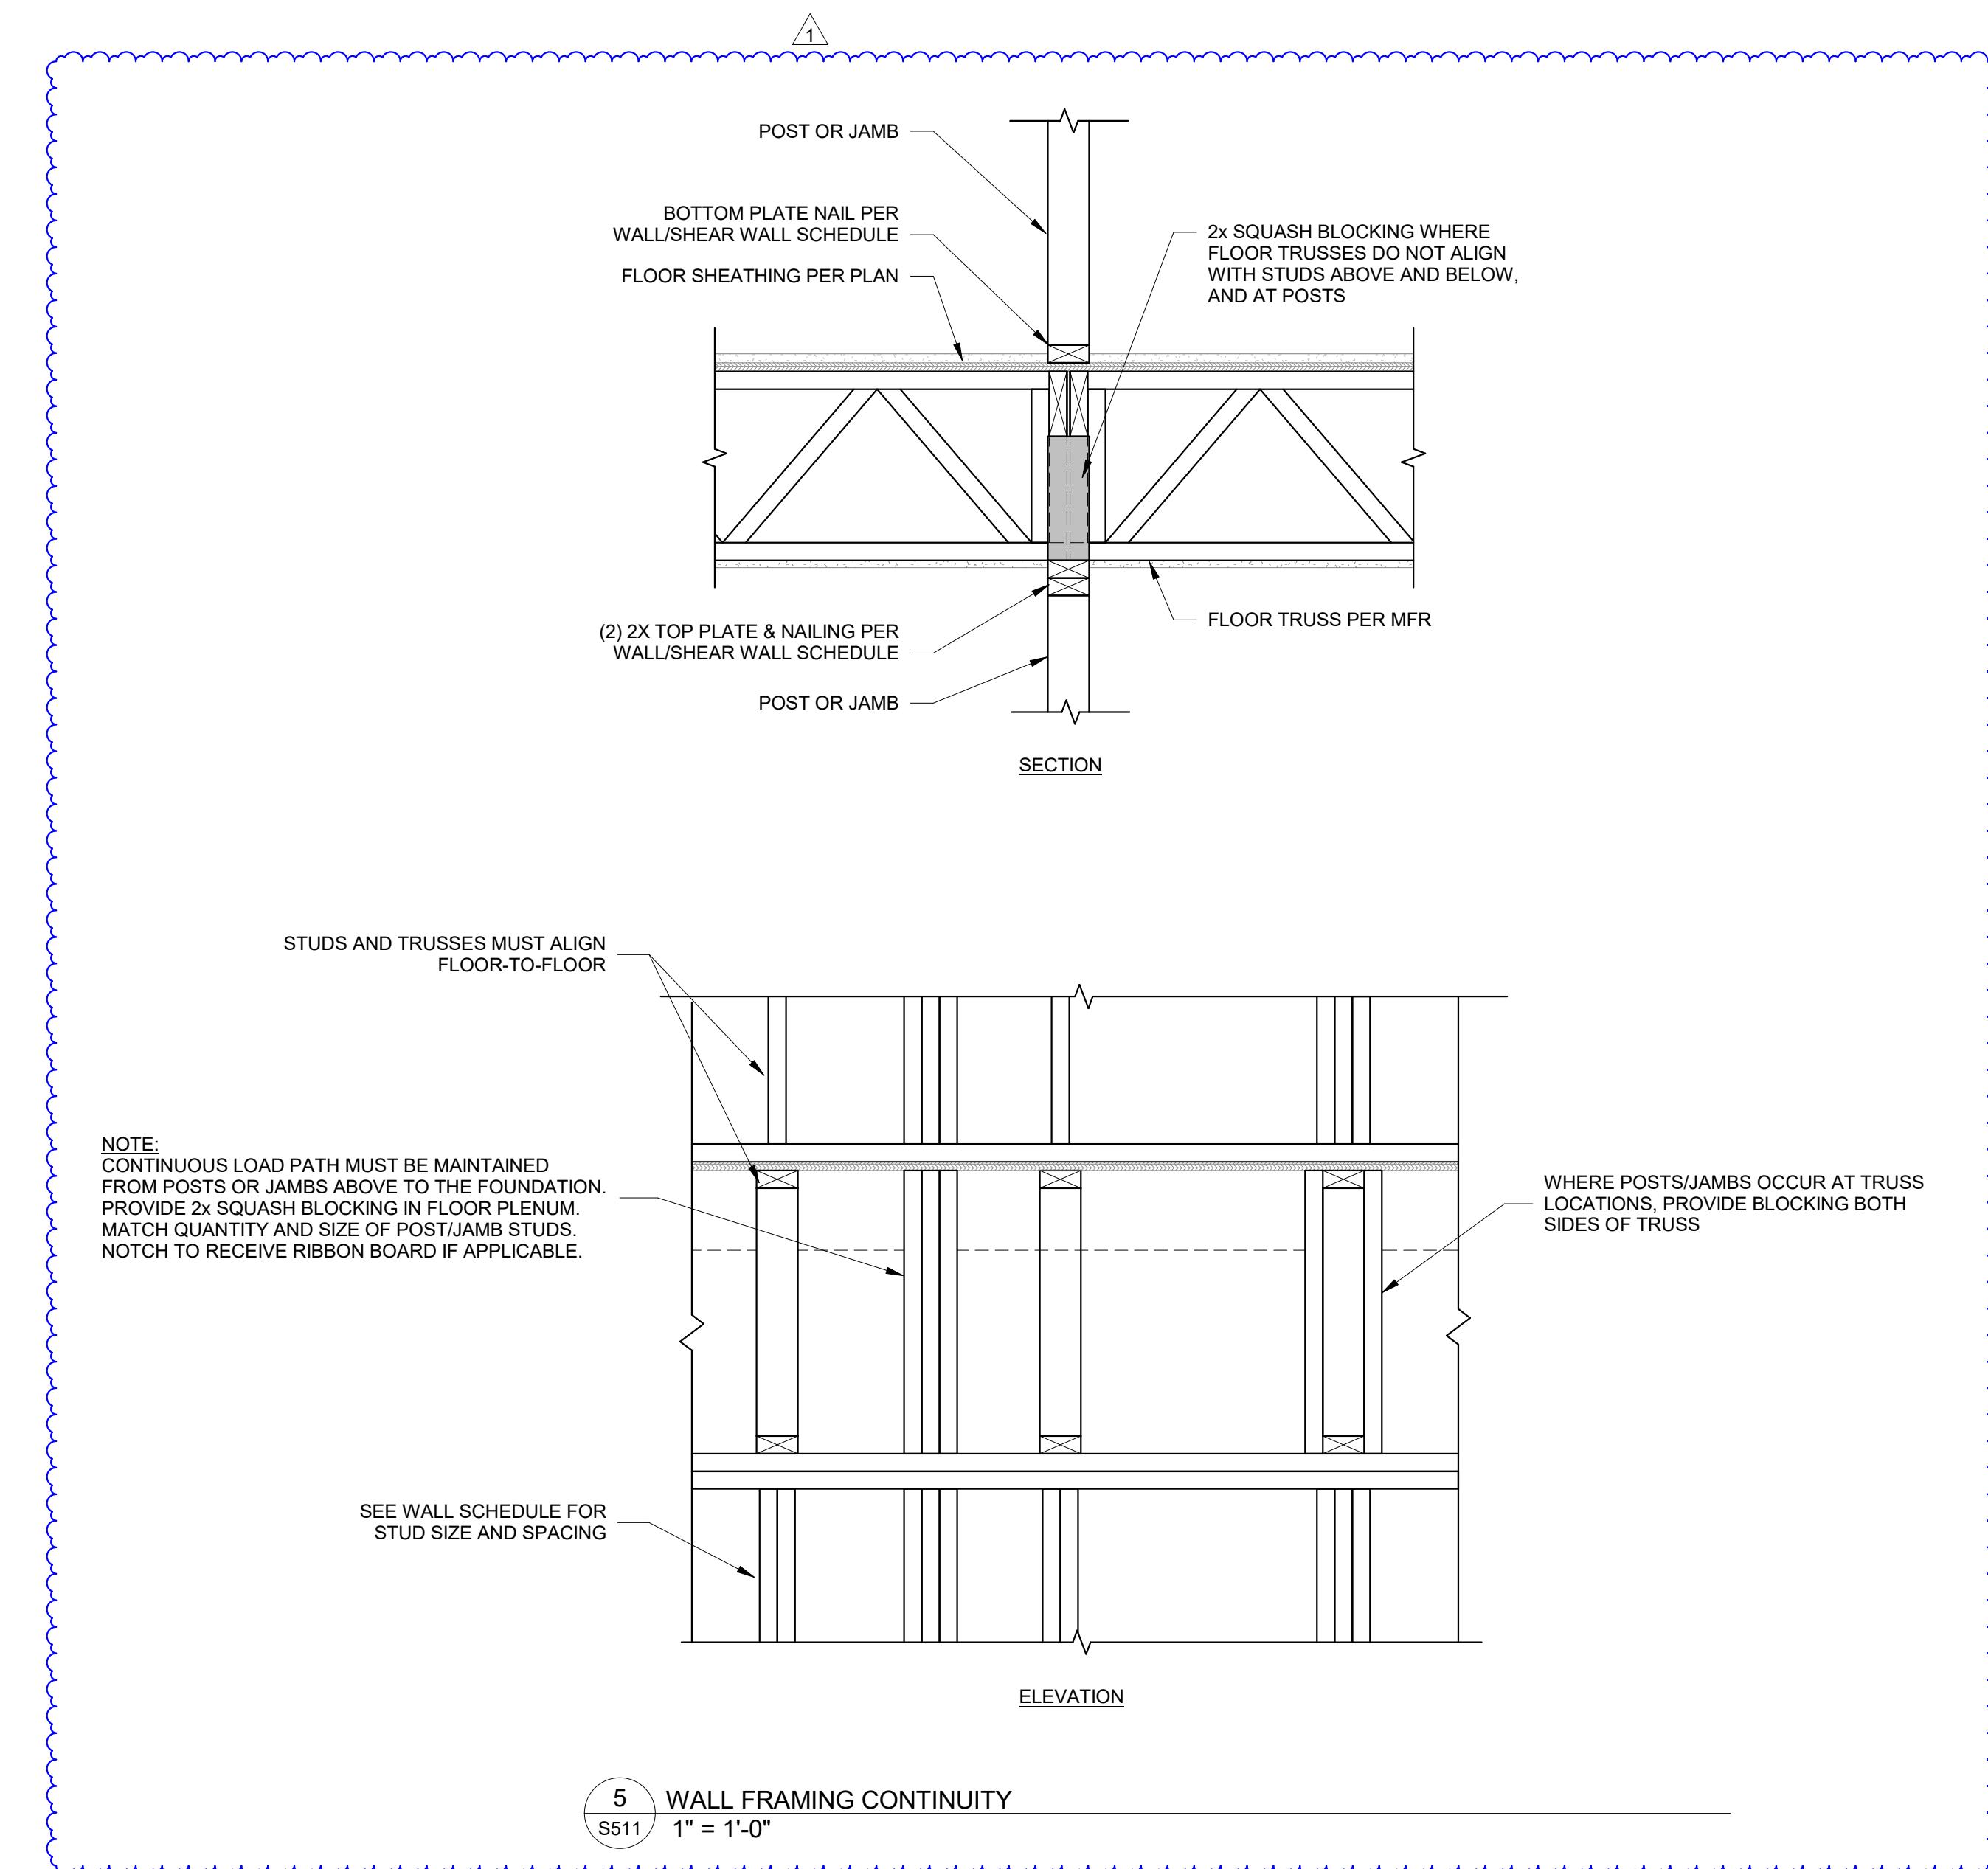

5 WALL FRAMING CONTINUITY
S511 1" = 1'-0"

DRAWING NO.
S511

NOTICE:
McClure Engineering Co. is not
responsible or liable for any issues,
claims, damages, or losses (collectively,
"Losses") which arise from failure to follow
these Plans, Specifications, and
the engineering intent they convey, or for
Losses which arise from failure to obtain
and/or follow the engineers' or surveyors'
guidance with respect to any alleged
errors, omissions, inconsistencies,
ambiguities, or conflicts contained within
the Plans or Specifications.

TENNESSEE CERTIFICATE OF
AUTHORITY
NO. 8231



I HEREBY CERTIFY THAT THIS
ENGINEERING DOCUMENT WAS
PREPARED BY ME OR UNDER MY
DIRECT PERSONAL SUPERVISION AND
THAT I AM A FULLY
LICENSED PROFESSIONAL ENGINEER
UNDER THE LAWS OF THE STATE OF
TENNESSEE.


No.	Description	Date
00	PERMIT SET	05/09/2025
01		
02		
03		
04		
05		
06		
07		
08		

PROJECT NUMBER
2024002664
SET ISSUE DATE
05/09/2025


ENGINEER
Cody L. Dailey
DRAWN BY
Cody L. Dailey
CHECKED BY
JTB

JONES GILLAM RENZ
COBALT CIRCLE
BROWNSVILLE, TENNESSEE


ROOF DETAILS
Autodesk Docs/202402664 - JGR_Cobalt Circle/202402664 - JGR - COBALT CIRCLE R24.M

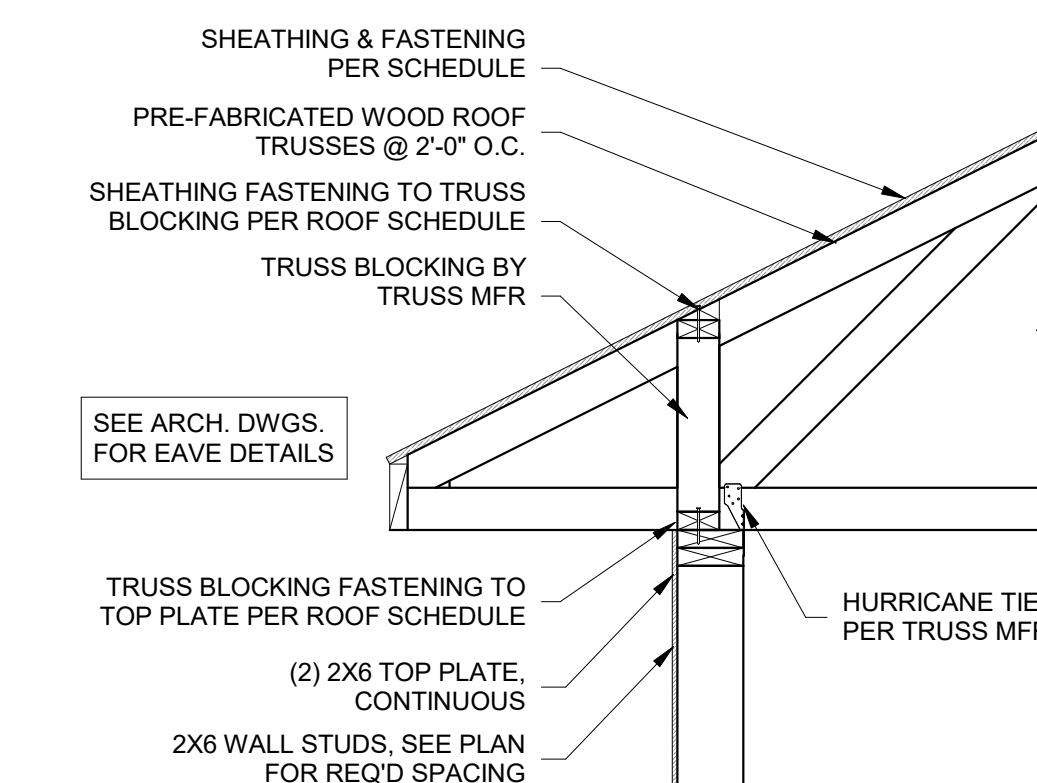


1 ROOF TRUSS BEARING AT EXTERIOR WALL
S520 3/4" = 1'-0"

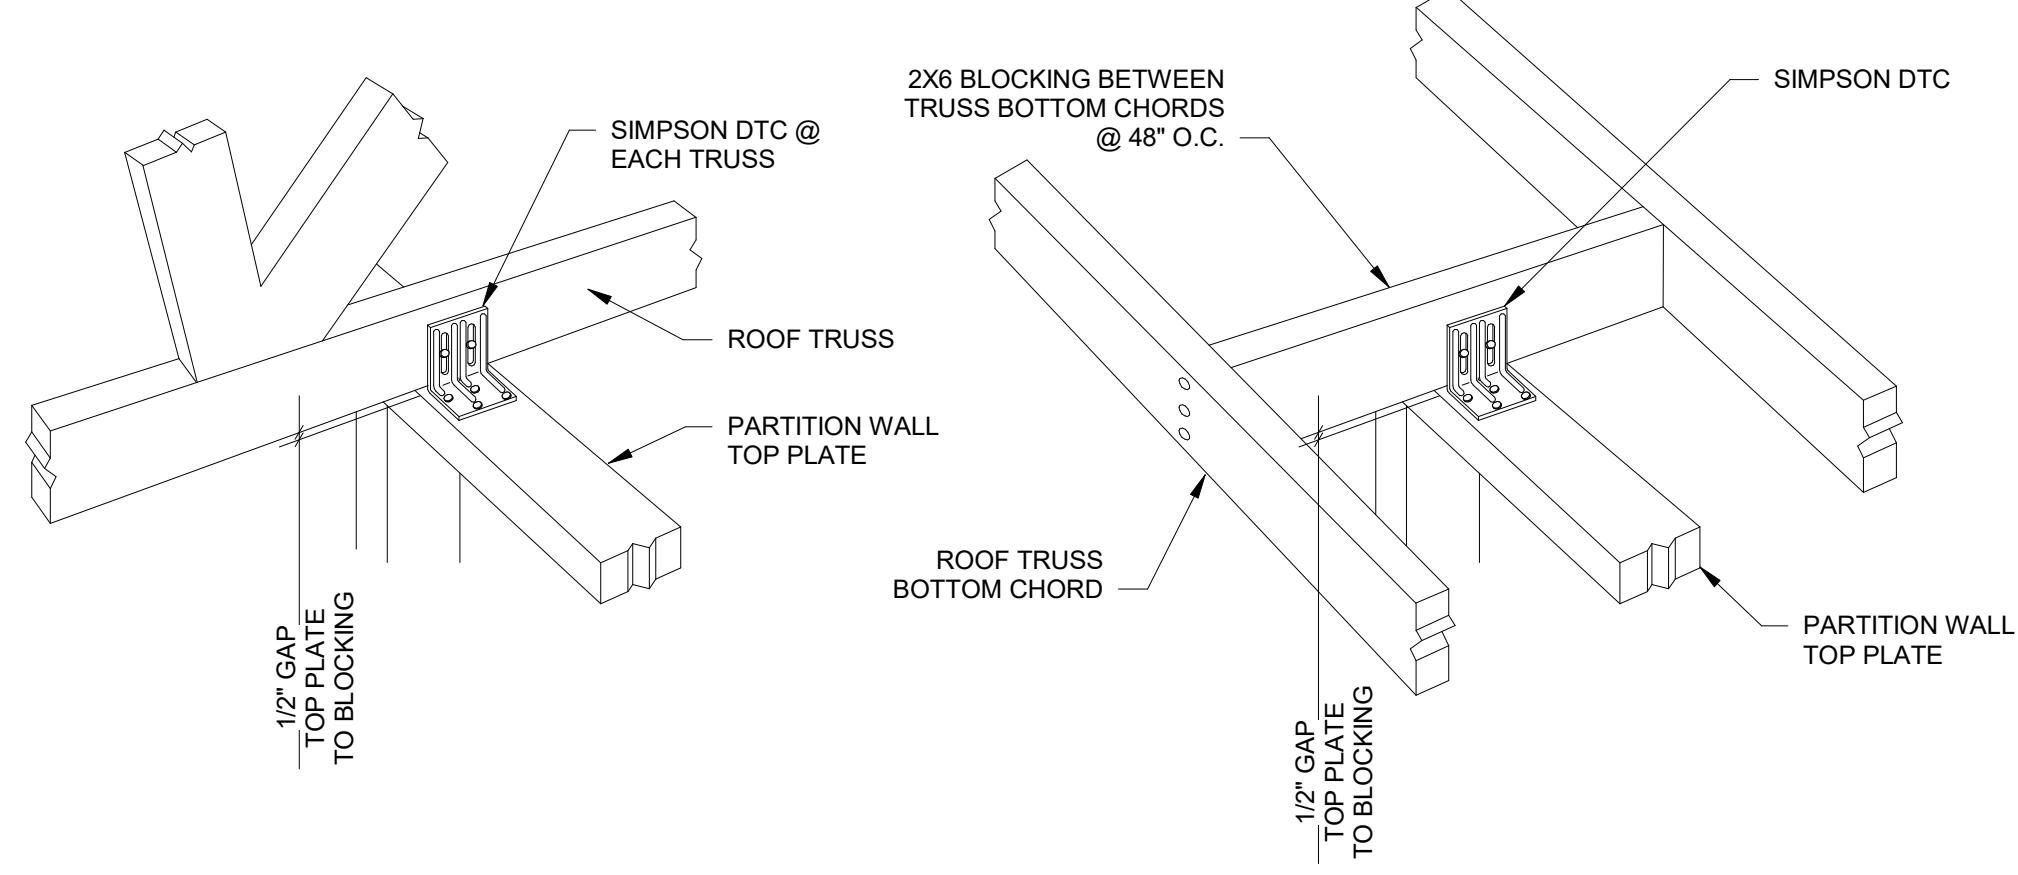


2 NON-STRUCTURAL PARTITION WALL AT ROOF TRUSS
S520 1" = 1'-0"

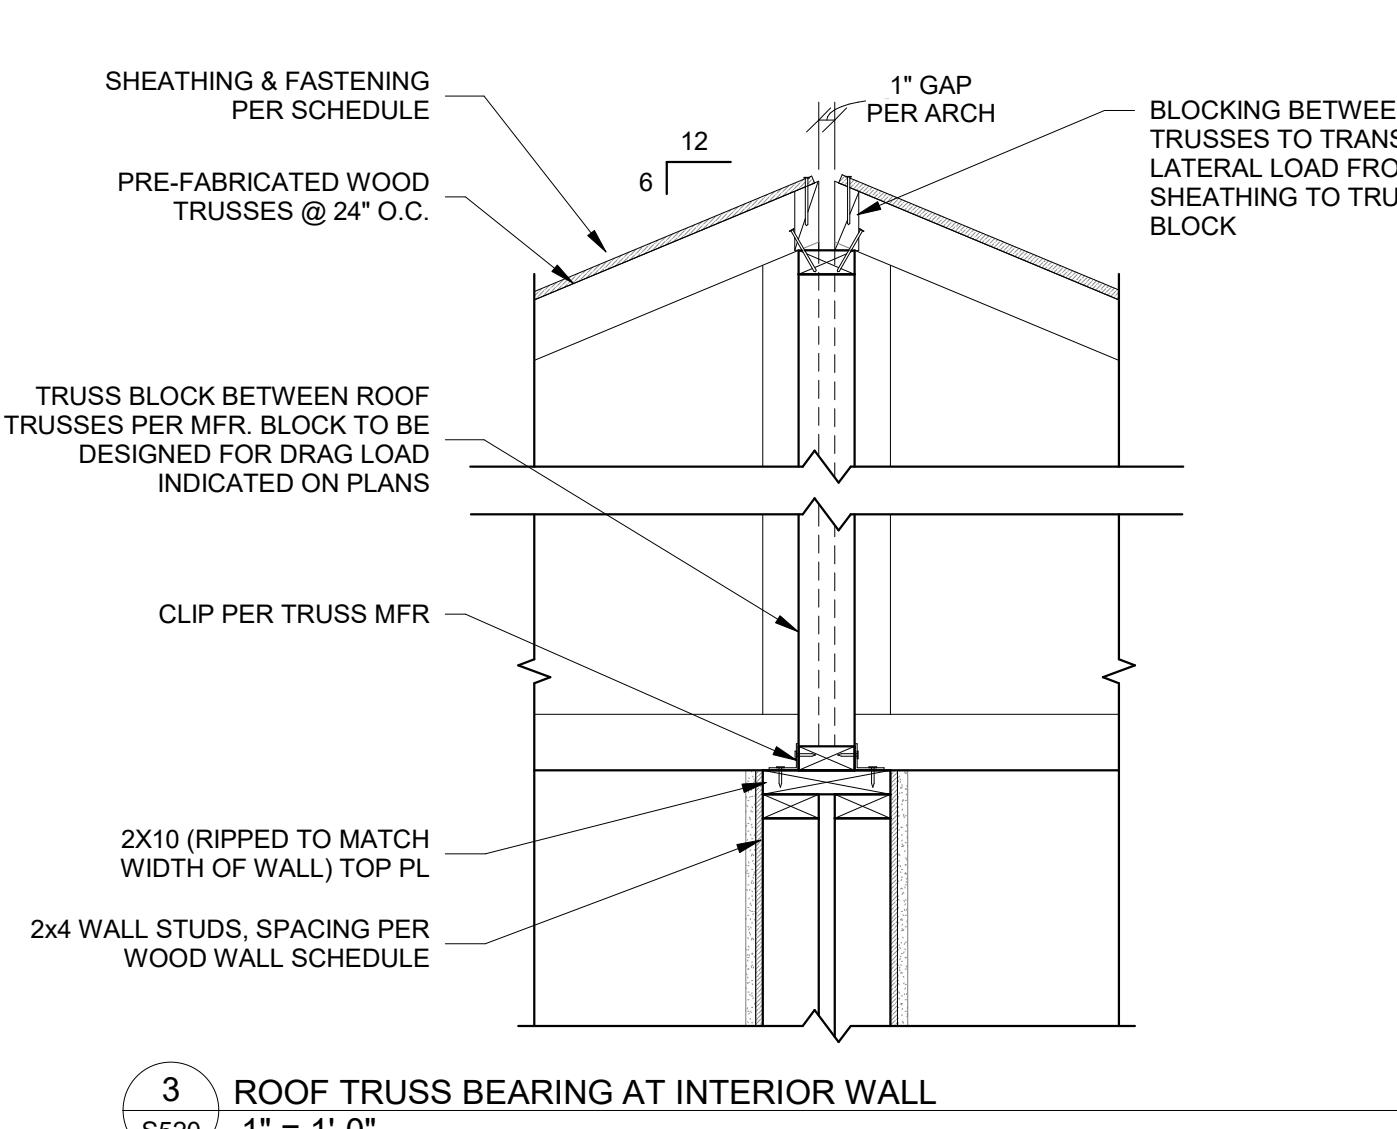


3 ROOF TRUSS BEARING AT INTERIOR WALL
S520 1" = 1'-0"

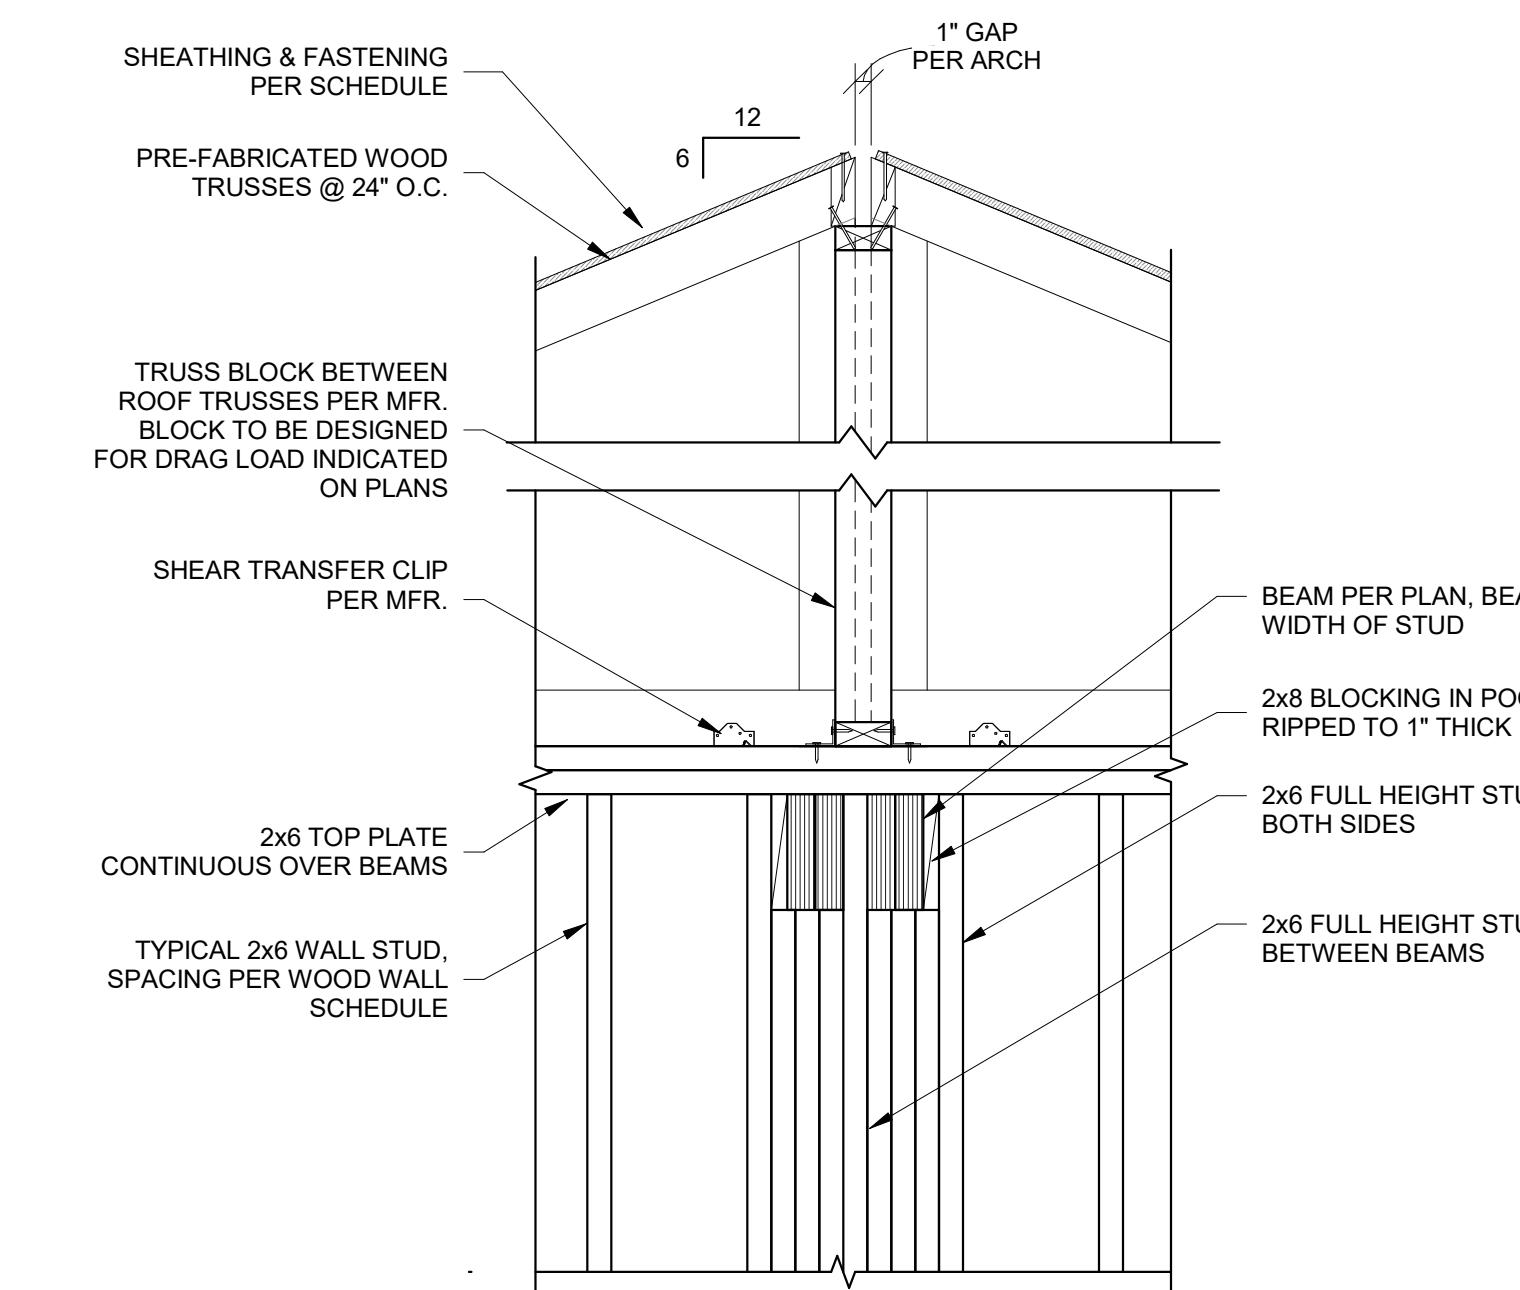



4 BEAM POCKET
S520 1" = 1'-0"

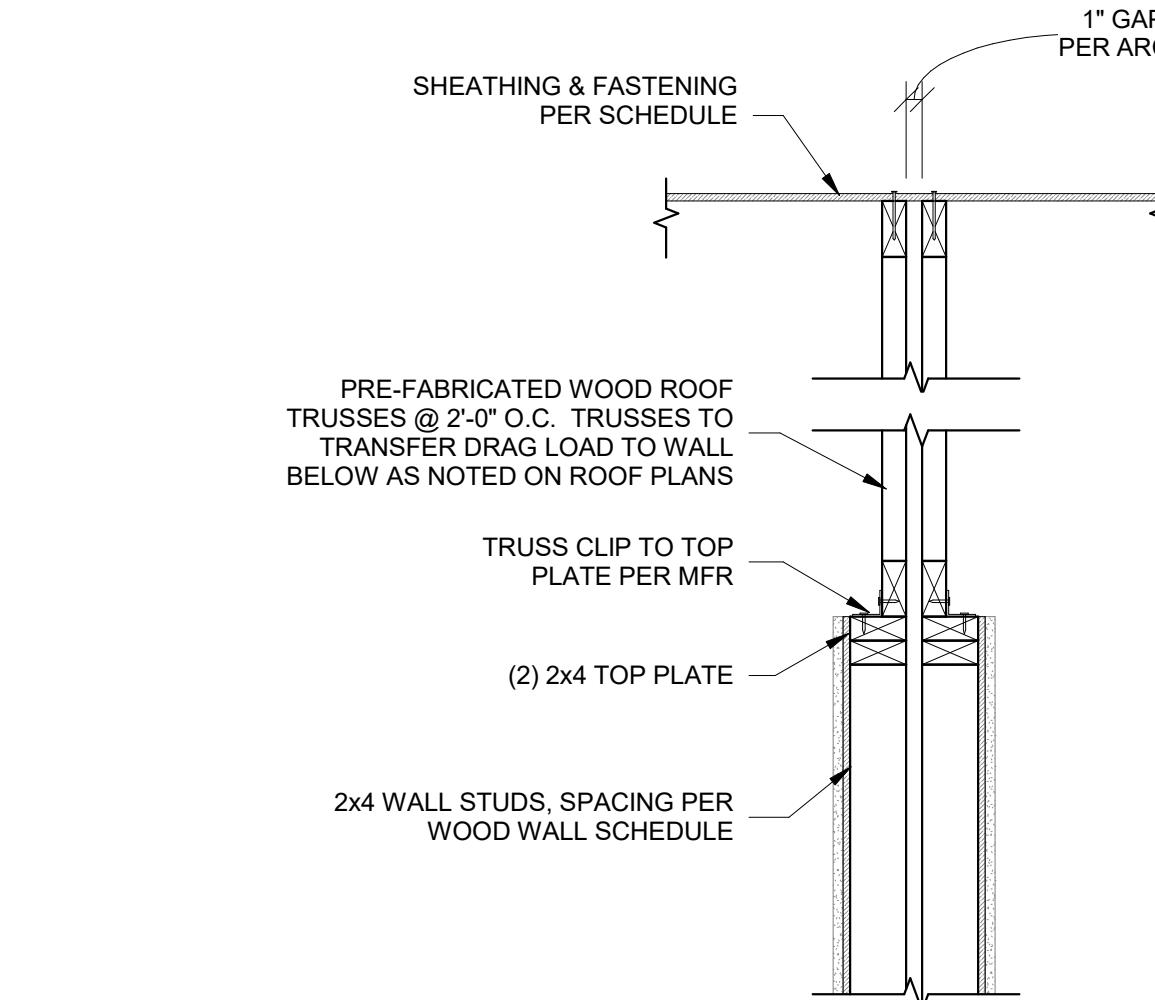

6 ROOF DOUBLE DEMISING WALL SECTION
S520 1" = 1'-0"

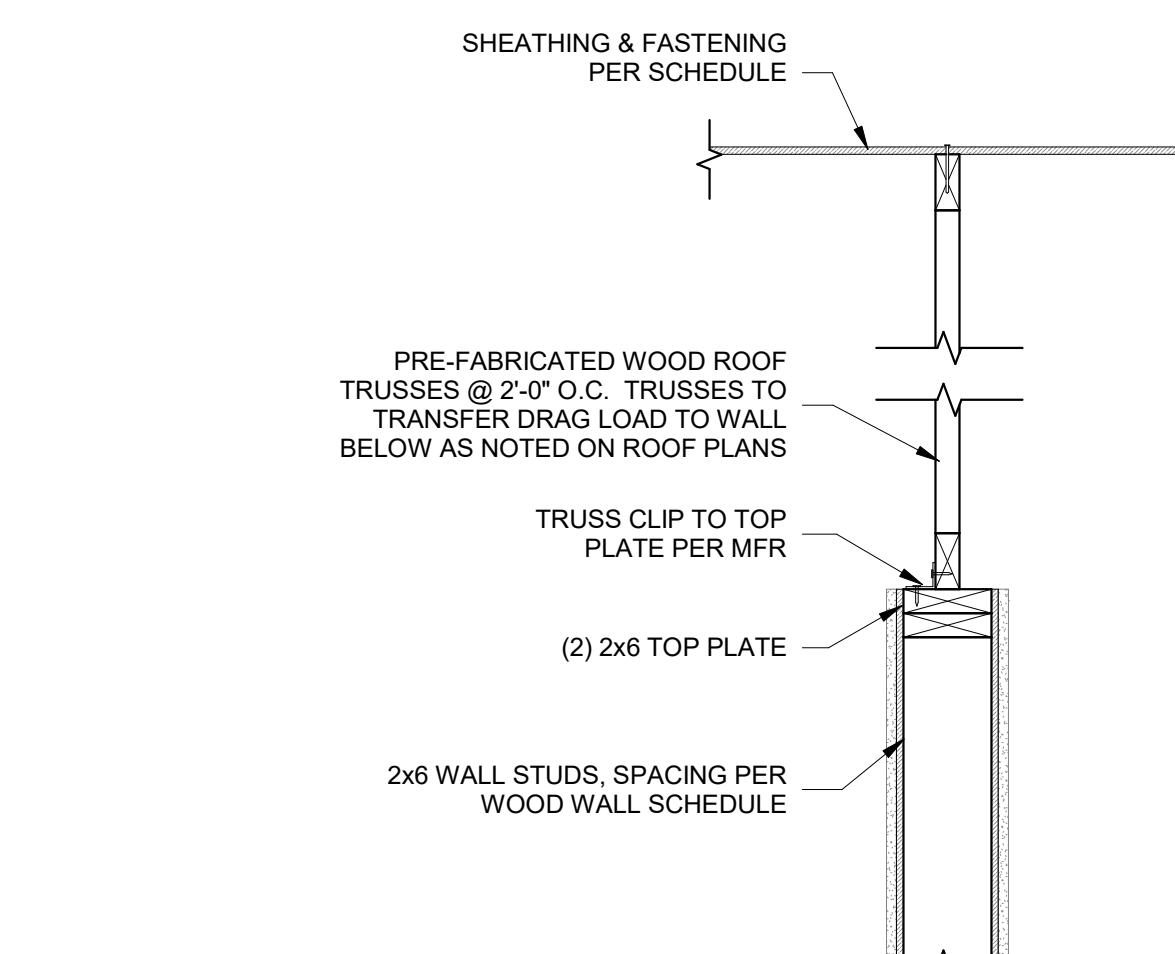

7 ROOF BREEZEWAY/UNIT WALL SECTION
S520 1" = 1'-0"

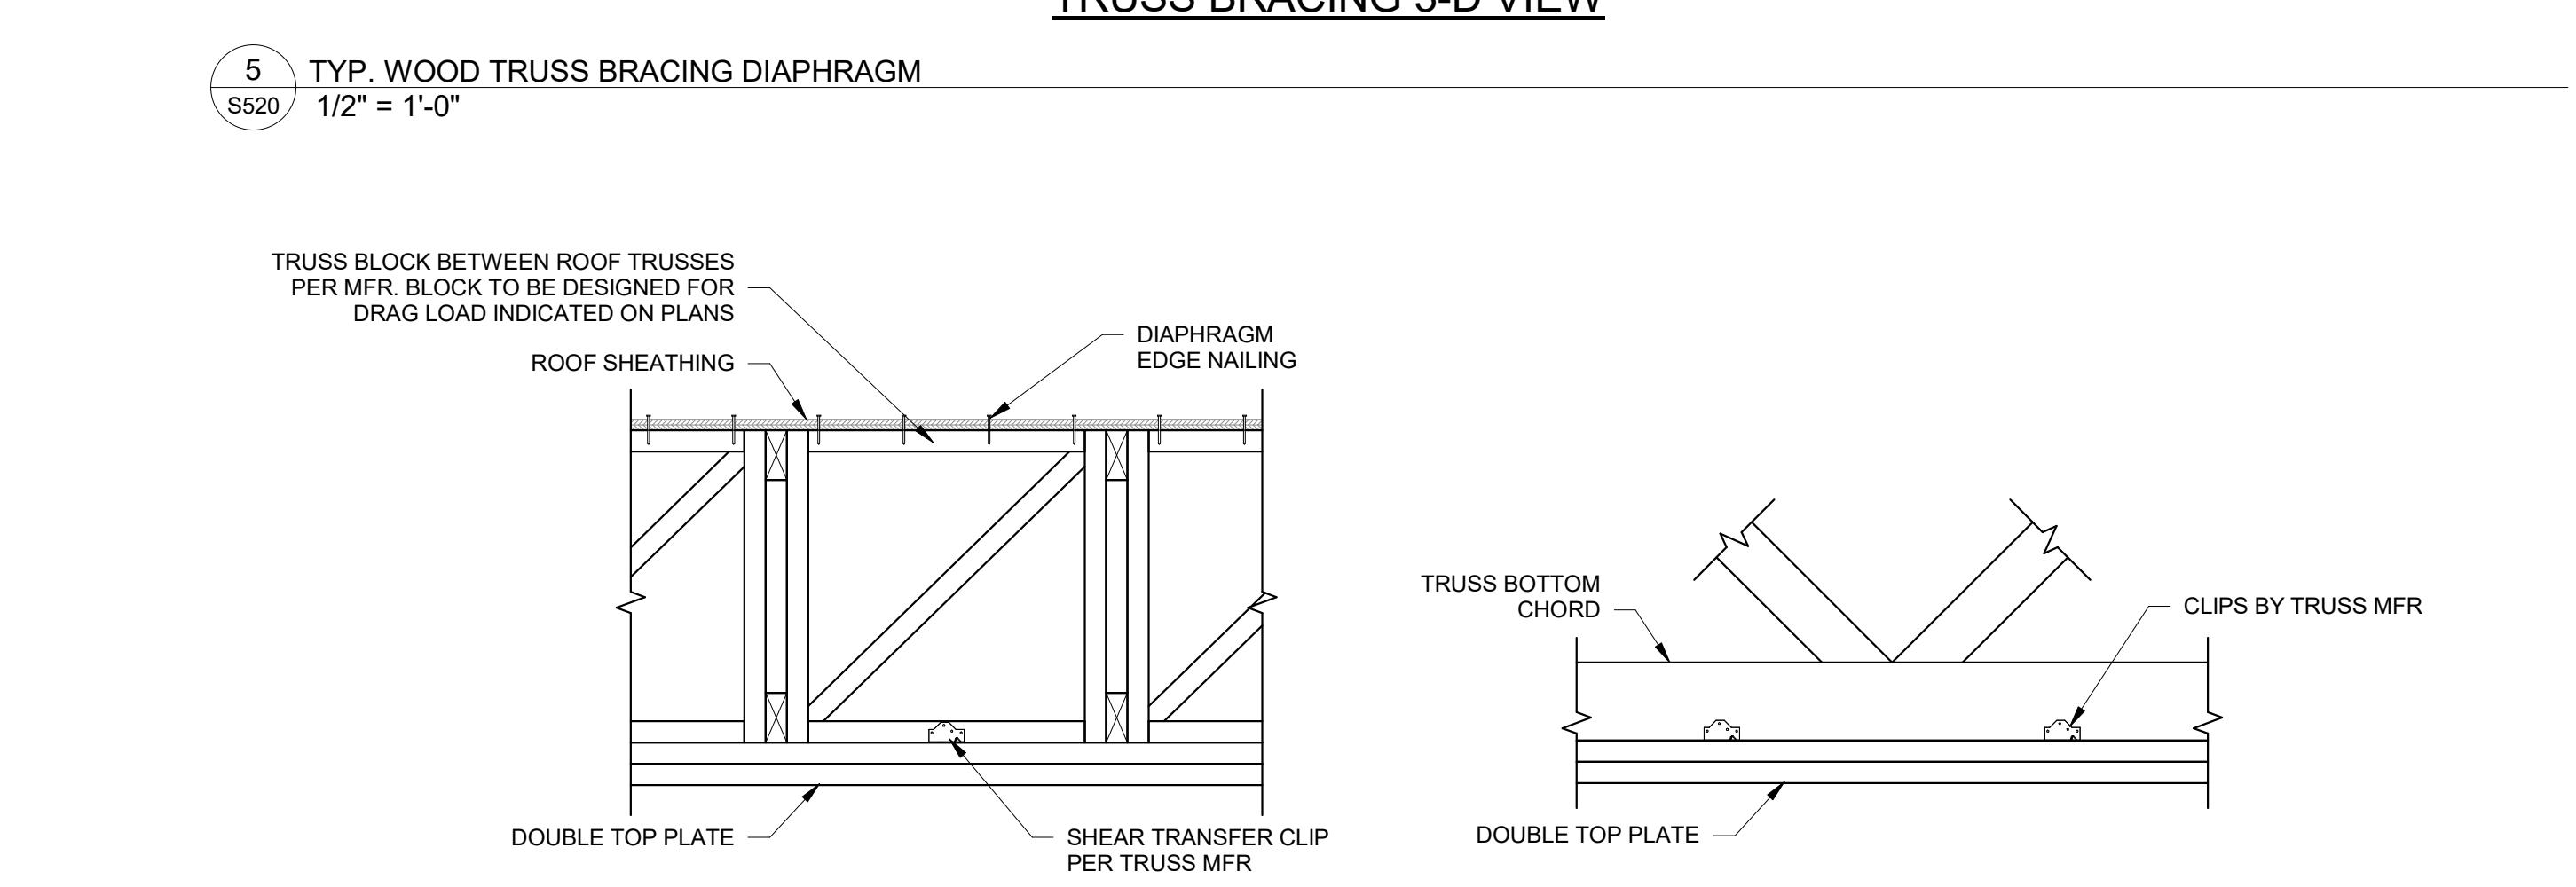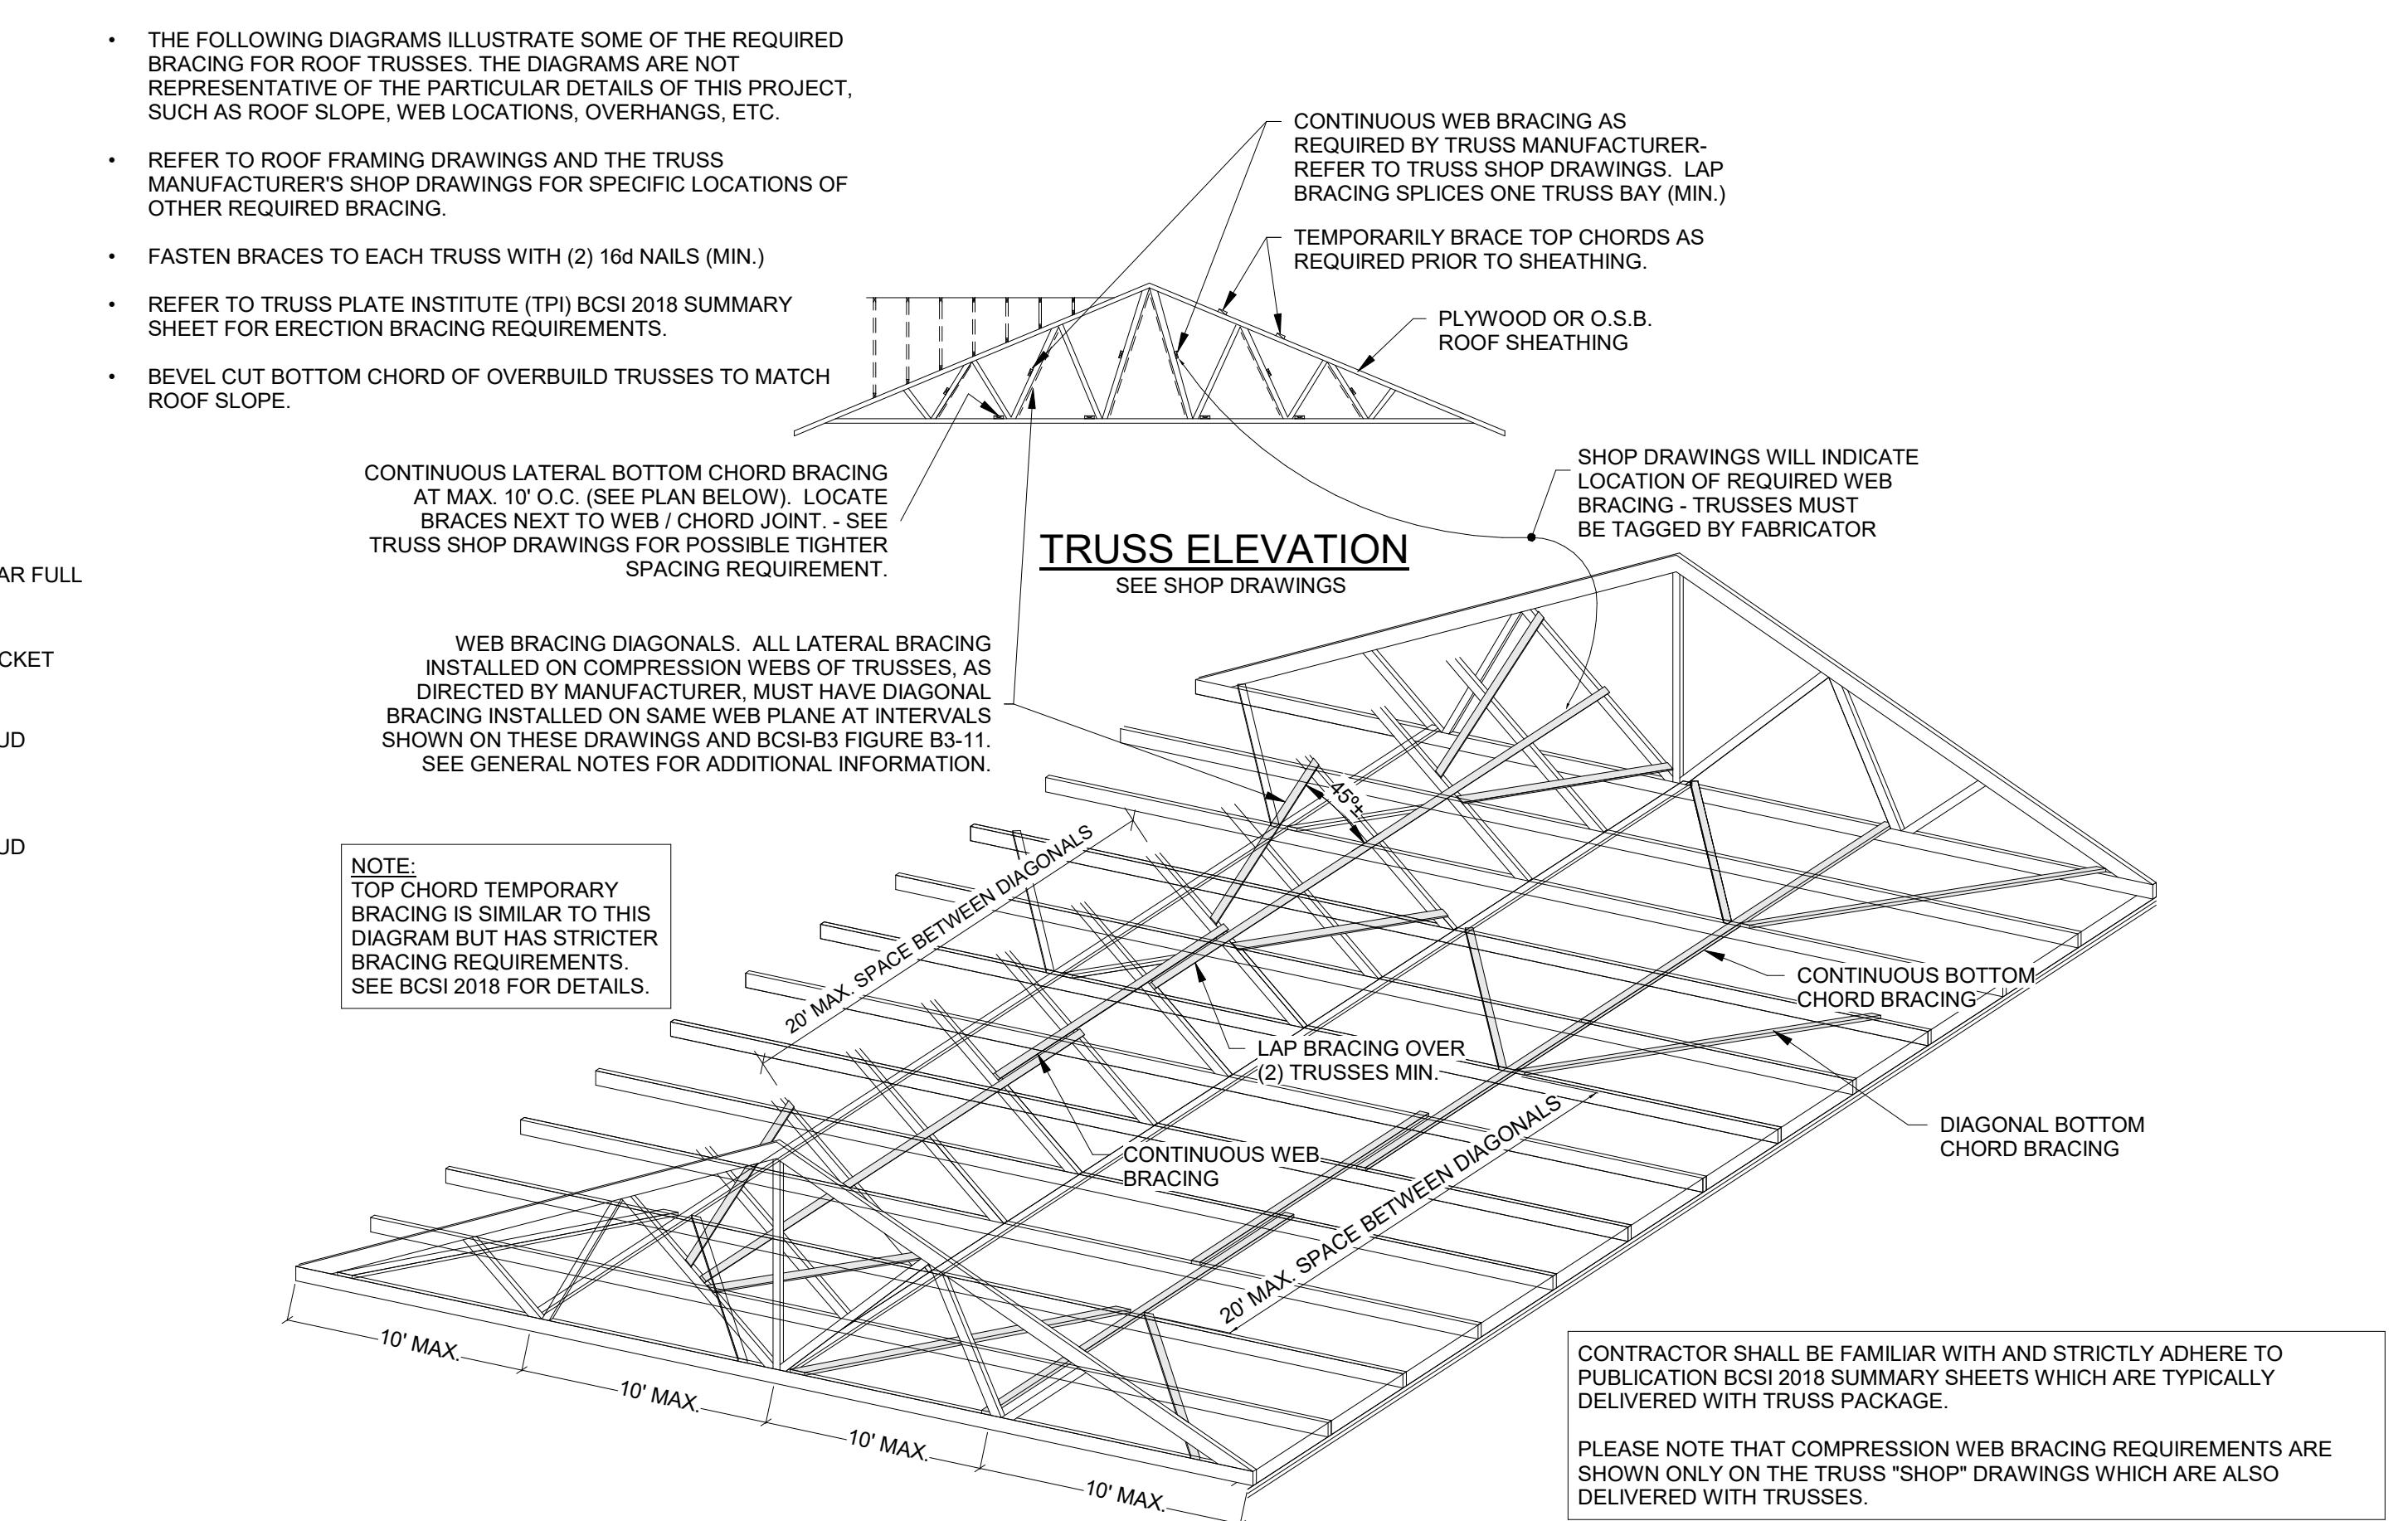

5 TYP. WOOD TRUSS BRACING DIAPHRAGM
S520 1/2" = 1'-0"


6 ROOF DOUBLE DEMISING WALL SECTION
S520 1" = 1'-0"

7 ROOF BREEZEWAY/UNIT WALL SECTION
S520 1" = 1'-0"

8 TRUSS AT SHEAR WALL
S520 1" = 1'-0"



2001 W Broadway
Columbia, MO 65203
P 573-814-1568

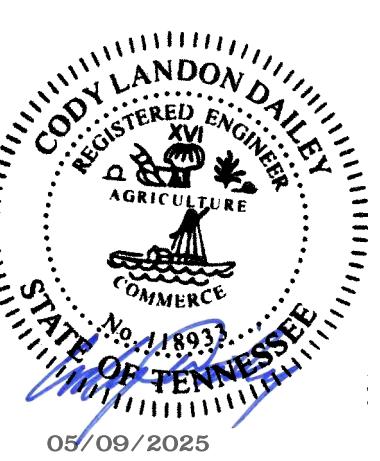

CODY L. DAILEY
118933
EXP: 2/28/2026

HEREBY CERTIFY THAT THIS
ENGINEERING DOCUMENT WAS
PREPARED BY ME OR UNDER MY
PERSONAL SUPERVISION AND
THAT I AM A DULY
LICENSED PROFESSIONAL ENGINEER
UNDER THE LAWS OF THE STATE OF
TENNESSEE.


SET NUMBER
002664

INEER DRAWN BY CHECKED BY
AS CAS JTB


COBALT CIRCLE

ROOF DETAILS


Autodesk Docs://2024002664 - JGR - Cobalt Circle/2024002664 - JGR - COBALT CIRCLE R24.rvt

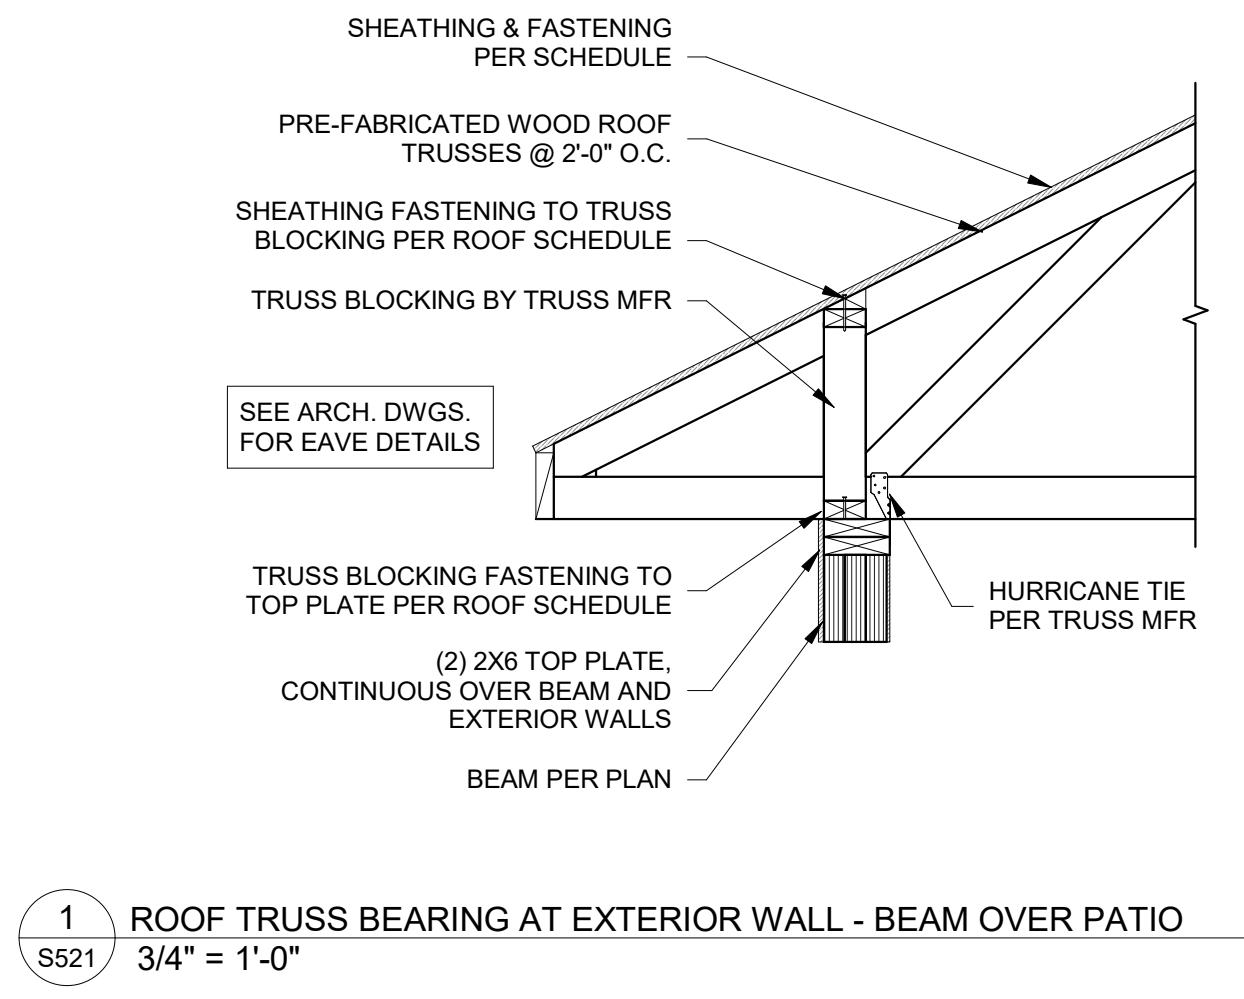


1 ROOF TRUSS BEARING AT EXTERIOR WALL - BEAM OVER PATIO
S521 3/4" = 1'-0"

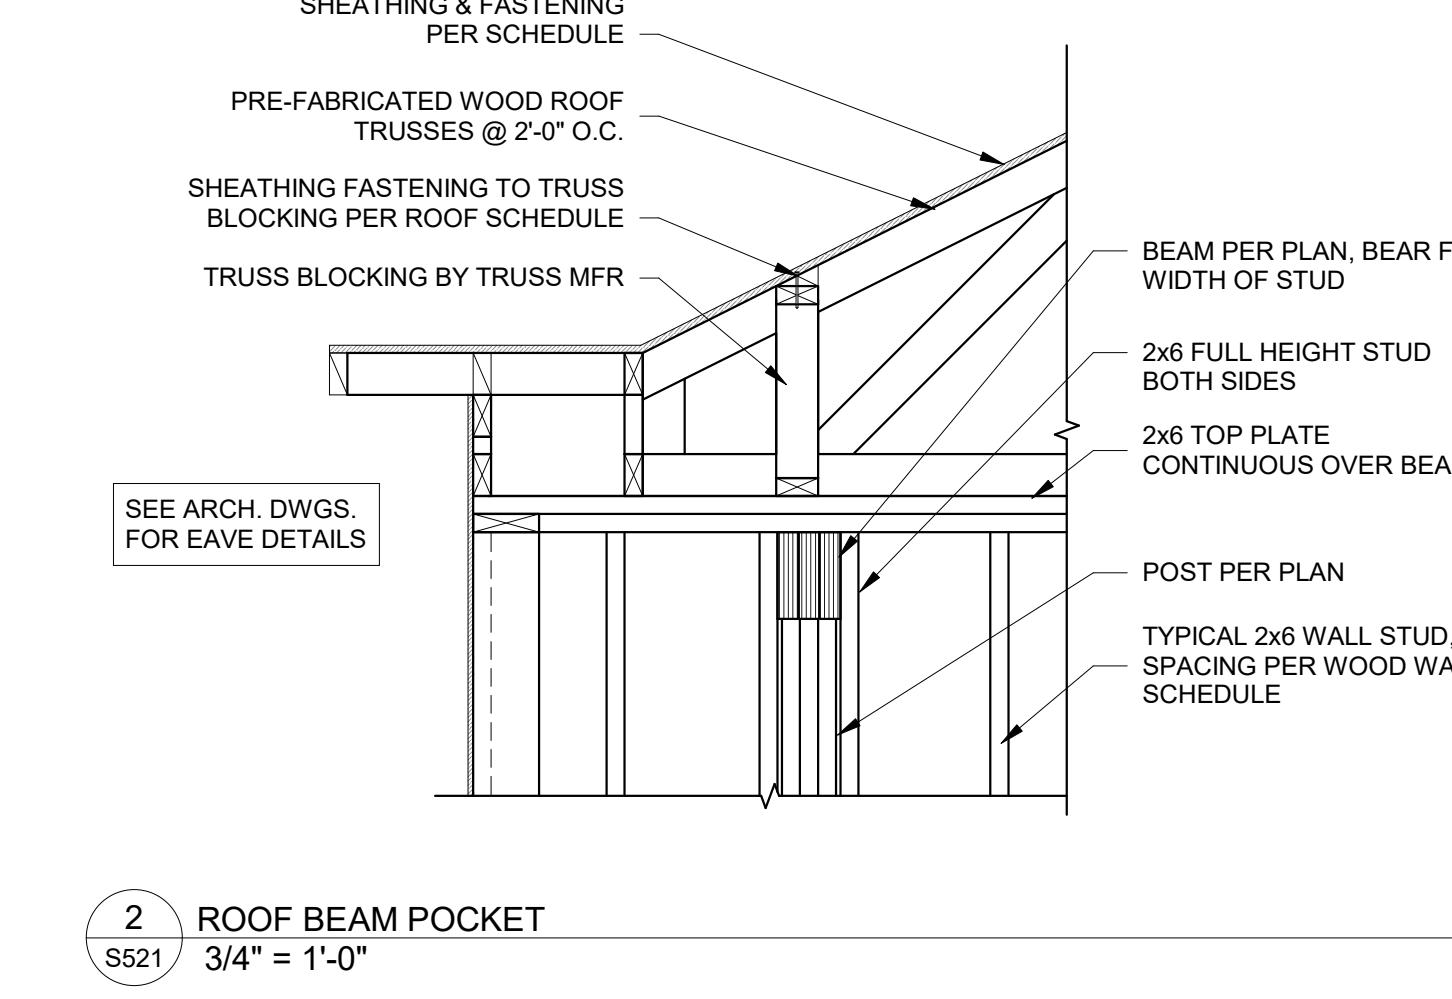

2
S521 ROOF BEAM POCKET
3/4" = 1'-0"

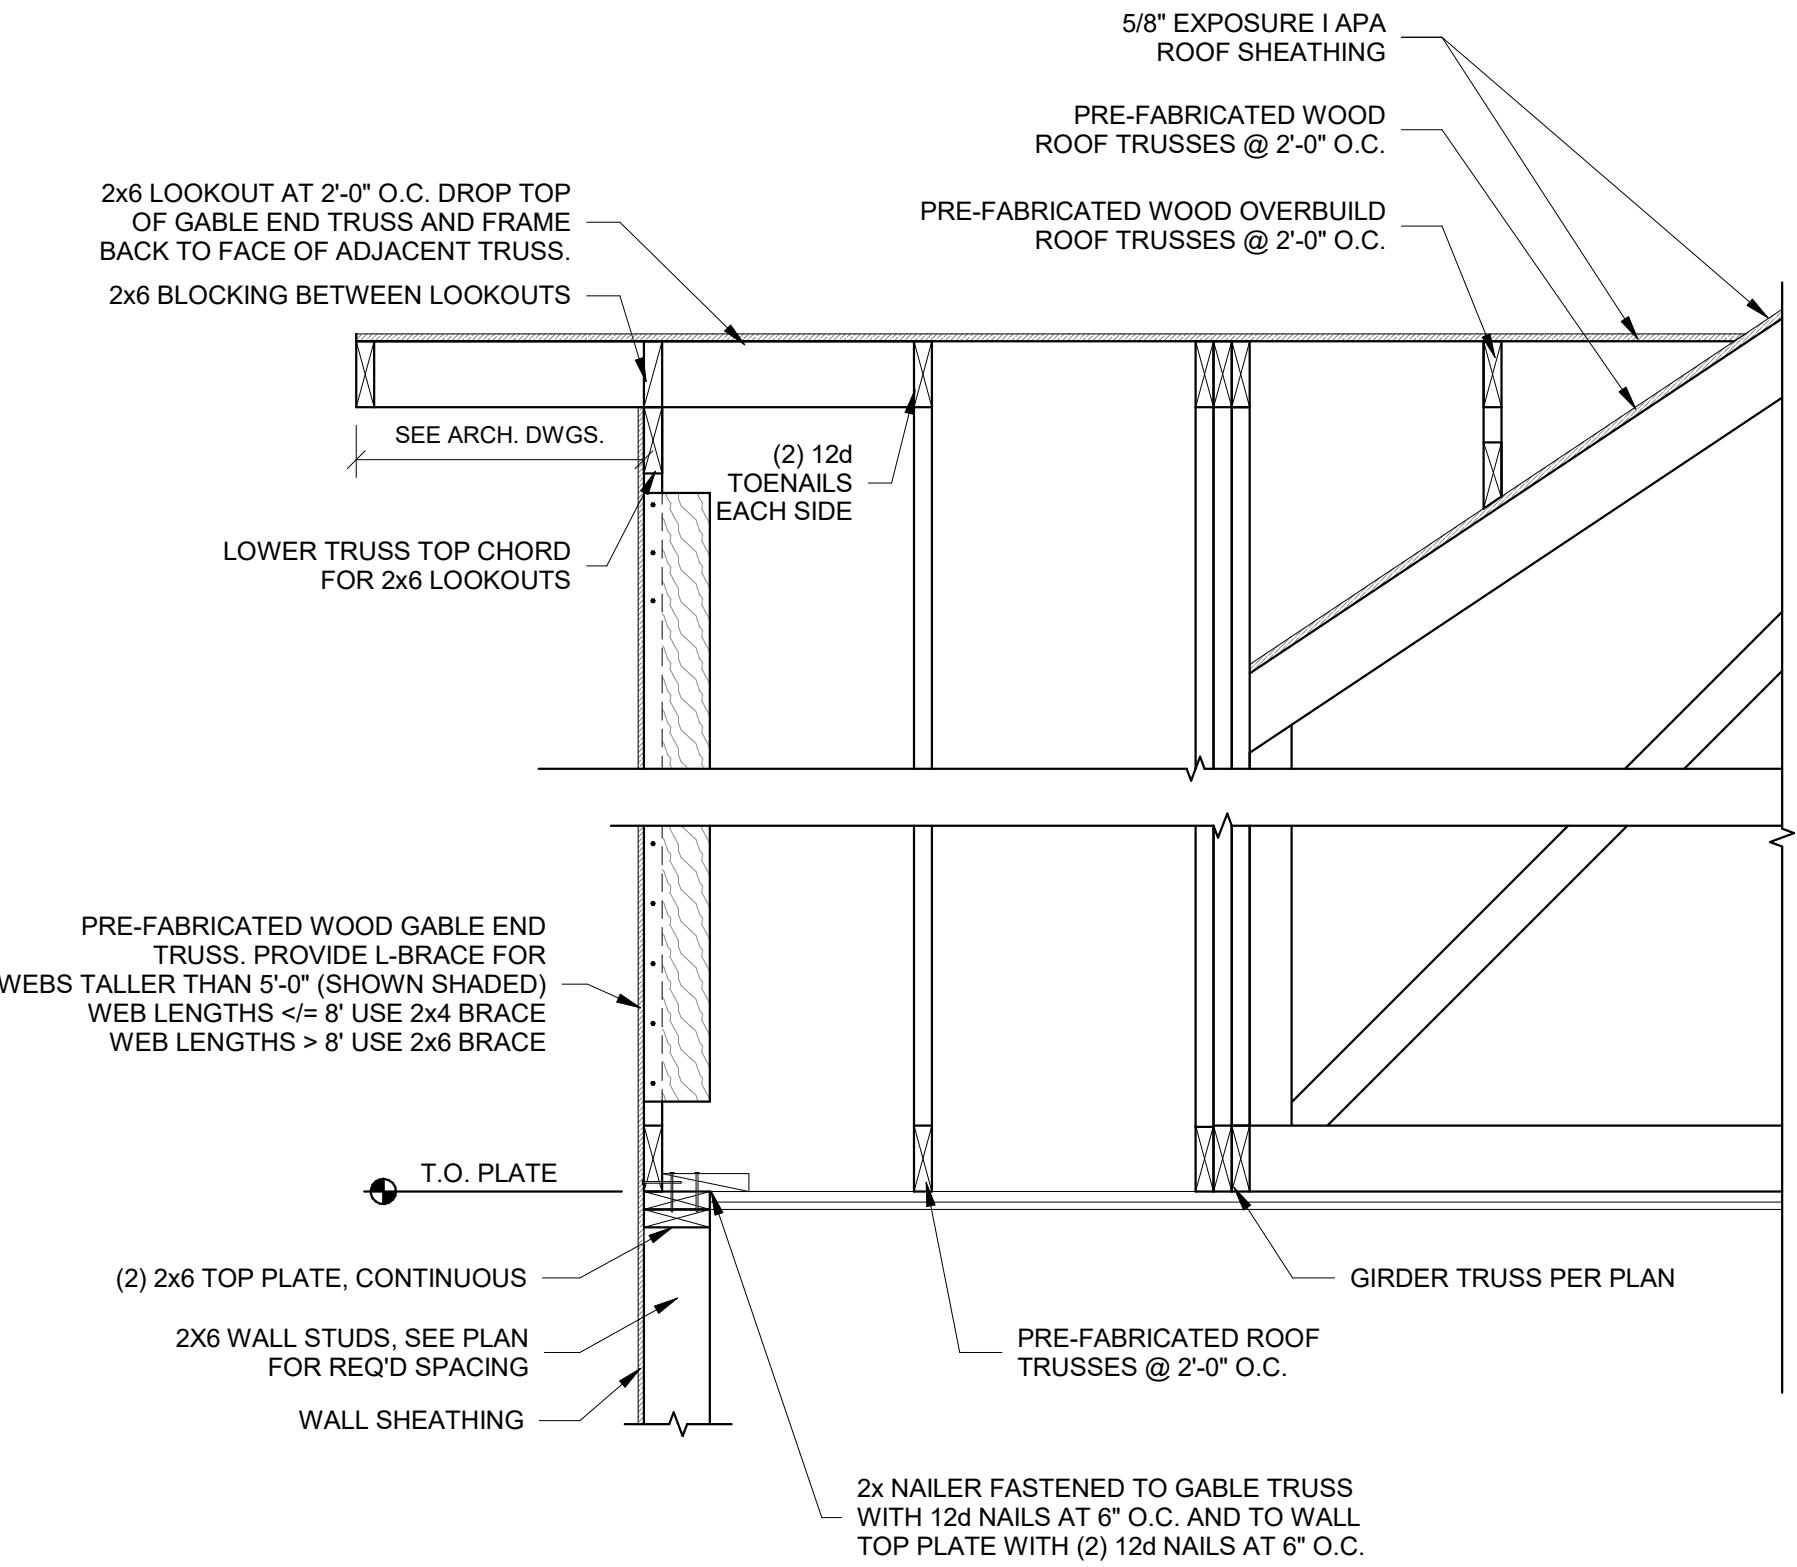

3
S521 ROOF TRUSS GABLE END SECTION
3/4" = 1'-0"

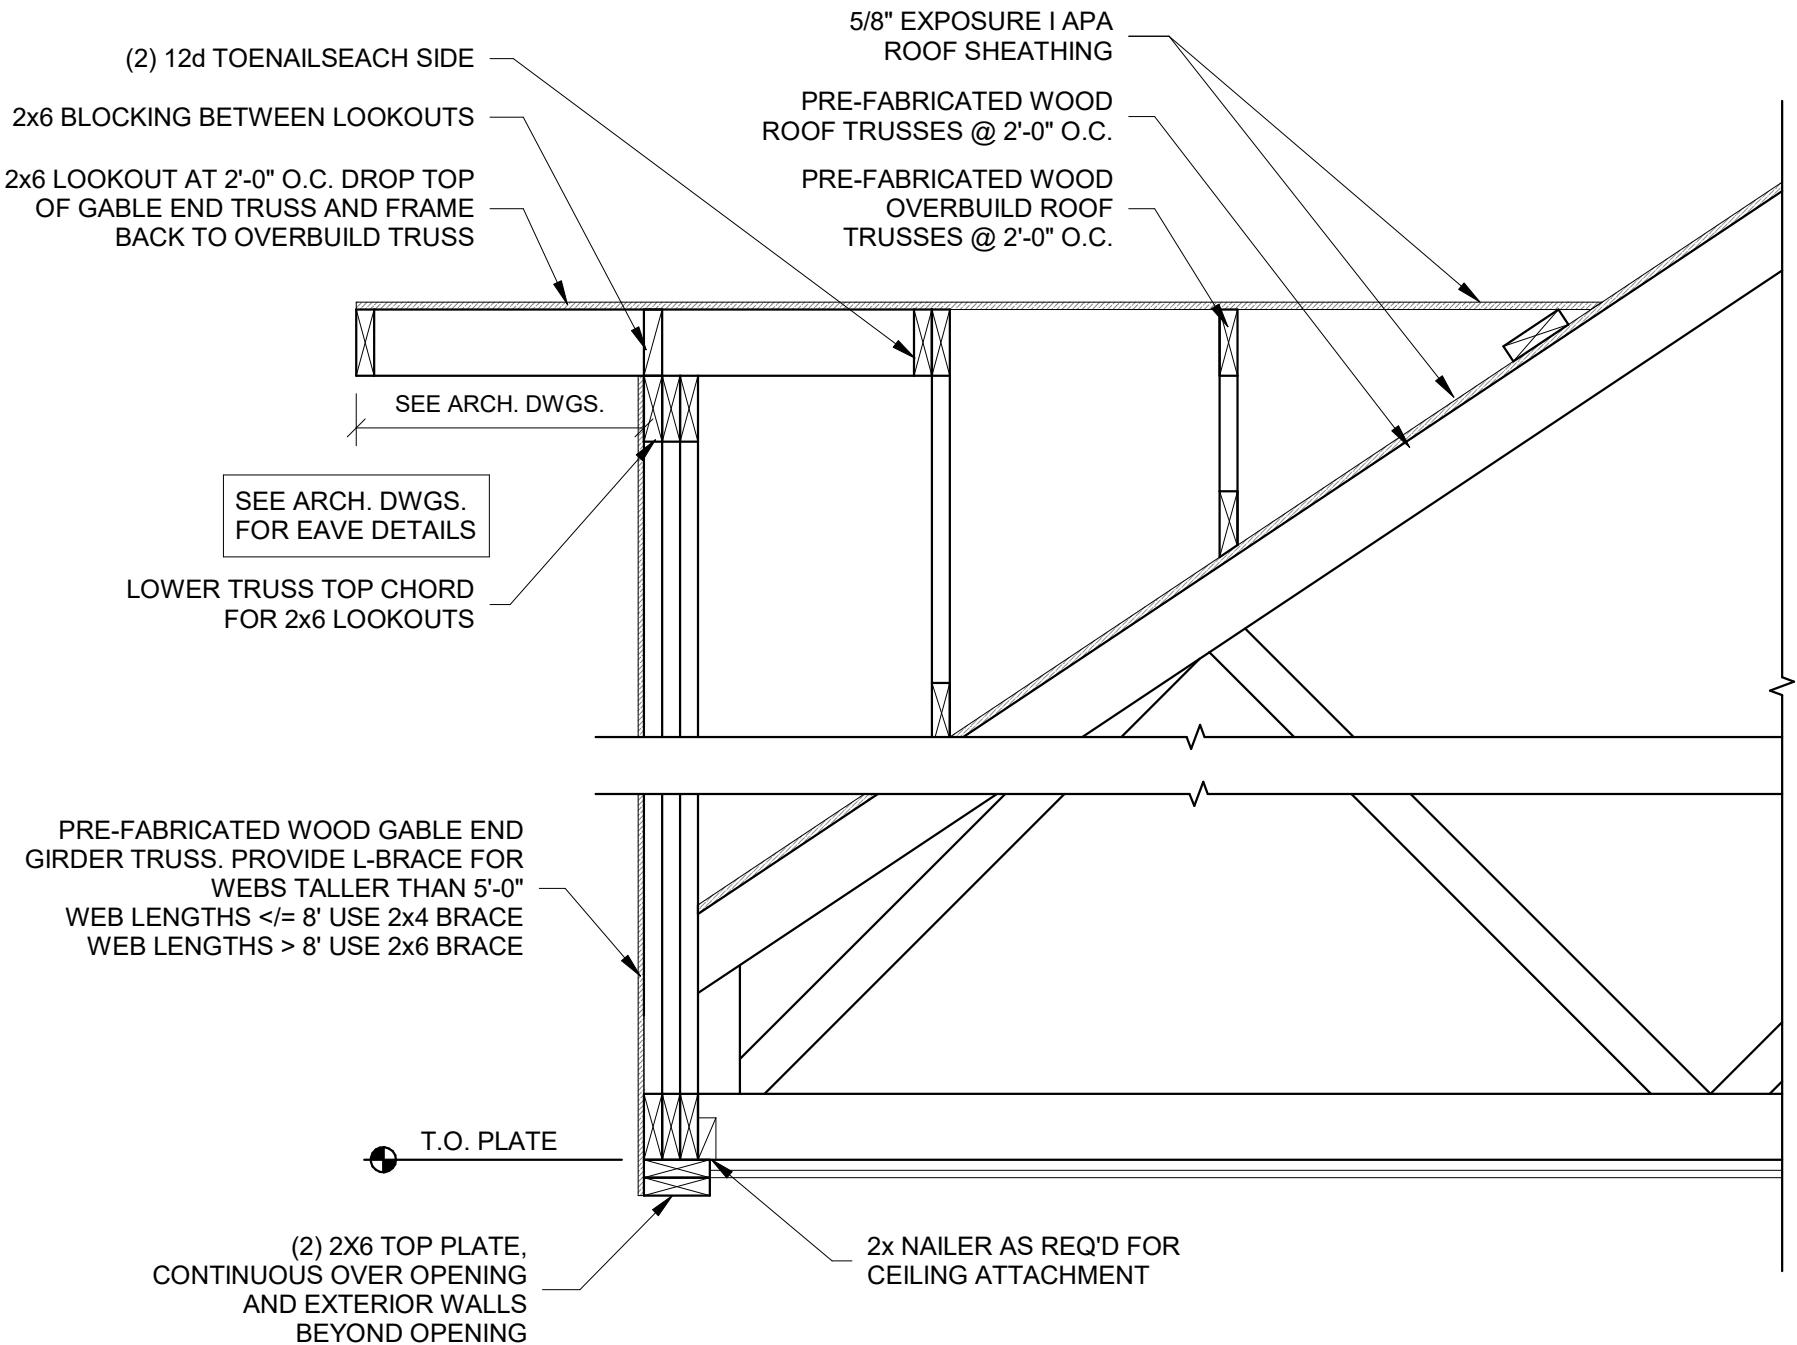


4 ROOF TRUSS GABLE END SECTION AT BREEZEWAY
S521 3/4" = 1'-0"

DRAWING NO.
S521

NOTICE:
McClure Engineering Co. is not responsible or liable for any issues, claims, damages, or losses (collectively, "Losses") which arise from failure to follow these Plans, Specifications, and the engineering intent they convey, or for Losses which arise from failure to obtain and/or follow the engineers' or surveyors' guidance with respect to any alleged errors, omissions, inconsistencies, ambiguities, or conflicts contained within the Plans or Specifications.

TENNESSEE CERTIFICATE OF AUTHORITY
NO. 8231

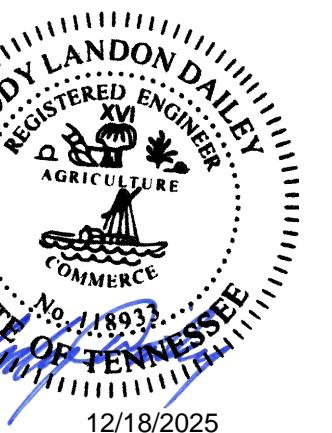

CODY L. DAILEY
118933
EXP: 2/28/2026

I HEREBY CERTIFY THAT THIS ENGINEERING DOCUMENT WAS PREPARED BY ME OR UNDER MY DIRECT PERSONAL SUPERVISION AND THAT I AM A FULLY LICENSED STRUCTURAL ENGINEER UNDER THE LAWS OF THE STATE OF TENNESSEE.

No.	Description	Date
1	ASI 6 - SHEAR WALL SCHED REV	12/18/2025

PROJECT NUMBER 2024002664 SET ISSUE DATE 05/09/2025
ENGINEER DRAWN BY CHECKED BY
CAS CAS JTB

JONES GILLAM RENZ
COBALT CIRCLE
BROWNSVILLE, TENNESSEE
SHEAR WALL DETAILS
Autodesk DocId:202402664 - JGR - Cobalt Circle/202402664 - JGR - COBALT CIRCLE R24.1M

