

REFERENCE LEGEND





ABBREVIATIONS

SHEET INDEX

CONSULTANTS

PO.1 PLUMBING GENERAL NOTES & LEGEND
PC1.1 BUILDING C - DOMESTIC WATER & WASTE AND VENT PLANS
P6.1 SCHEDULES & DETAILS
P9.1 BUILDING C - WASTE AND VENT RISER DIAGRAM

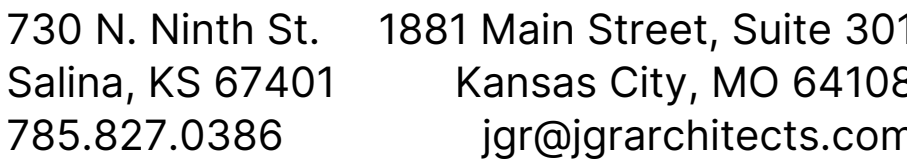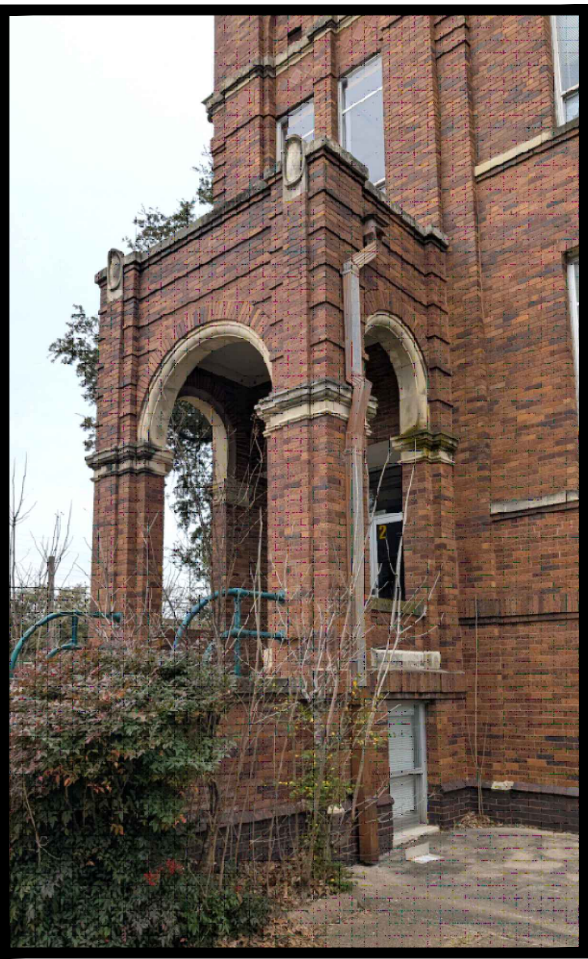

BUILDING C - PERMIT SET - 11-20-2025

PROJECT INFORMATION

Types of Construction

Facility Name

Facility Address

Owner Name

Owner Address

Reason for Submittal

County

Local Fire Department

Water Supply

Local Building

Inspection Department

Architect

Codes/Regulations

Exterior Renovation, Interior Renovation & Remodel

The Irving Lofts

1108 N Anglin St
Cleburne, Texas 76031

OPG — Irving Lofts Partners, LLC

254 N Santa Fe Ave, Ste A
Salina, KS 67401
ph: 913-396-6310

Change in Use, Prior School
to Multi-Family Housing

Johnson

City of Cleburne

City of Cleburne

City of Cleburne

Jones Gillam Renz Architects, Inc.
730 N. Ninth St.
Salina, KS 67401
ph: 785-827-0386

2021 International Building Code
2021 International Mechanical Code
2021 International Plumbing Code
2023 National Electrical Code
2021 International Fire Code
2021 International Energy Conservation Code
Fair Housing Act Design Manual
2010 ADA Standards for Accessible Design
2017 ICC A117.1 Accessible & Usable Buildings

LEGEND

Designated Emergency Exit

68"/24.4"

Exit Width (Actual/Required)

122/340

Occupant Load (Actual/Allowed)

0 Hour Construction

1/2 Hour Fire Partition

W/ 20 Min Openings (Per IBC Table 716.5)

1 Hour Fire Partition

W/ 45 Min. Openings (Per IBC 708.3 & 716.1(2))

1 Hour Construction, Shaft Walls

W/ 60 Min. Openings (Per IBC Table 716.1(2))

Exit Light

Exit/Emergency Light

Emergency Light

Fire Extinguisher

Fire Hydrant

Fire Alarm Control Panel

Fire Alarm Remote Annunciator Panel

Knox Box

PH

FACP

FAL

KB

Occupancy Group (AU — Accessory Use)

Occupancy Use

Room Square Footage/Occupant Load Factor

Occupant Load/Required Number of Exits

A-1

Assembly Hall

5,550

15

370

2

BUILDING A CODE INFORMATION

Occupancy Overall: Residential

Construction Type: III-A (Assumed Construction Type — Existing Building)

Occupancy Basic

R-2 Apartments

*Building Has an NFPA 13R Sprinkler System, Section 903.3.1.2

*Allowable Area and Height Based on Different Uses Not Being Separated by Fire Barriers, Most Restrictive Allowance.

Allowable Area Increase:

R-2

Actual Building Area:

First Floor

11,260 SF

Second Floor

6,839 SF

Third Floor

6,889 SF

Total Bldg Area

24,988 SF

Base Allowable

24,000 SF

Area Increase (37.30%)

8,952 SF

Total Flr Allowable/Floor

32,952 SF

Basic Allowable Stories:

4

Actual Stories:

3

Basic Allowable Height:

60'

Actual Height:

47'

Fire Resistance Rating for Building Elements: III-A

Exterior Bearing Walls:

2 Hour

Primary Structural Frame:

1 Hour

Interior Bearing Walls:

1 Hour

Interior Non-Bearing Walls:

0 Hour

Shaft Enclosures:

1 Hour

Stairs

0 Hour

Floor/Ceiling Assembly:

1 Hour

Ceiling/Roof Assembly:

0 Hour

Corridor/Dwelling Units:

1/2 Hour

Dwelling Units

1 HR Fire Partitions

Elevator Requirements

Hoistway Opening Protection: Not Required per 3006.2.

Elevator Hoistway Does Not Connect More Than 3 Stories

Building is Equipped with an Automatic Sprinkler System

An Approved Pictorial Sign of a Standardized Design Shall be Posted Adjacent to Elevator Call Station on All Floors Instructing Occupants to Use the Exit Stairways and Not to Use the Elevators in Case of Fire.

Plumbing and Mechanical Systems Shall Not be Located in an Elevator Hoistway Enclosure (Exceptions: Flr Drains, Sumps & Sump Pumps)

Openings Shall be Self-Closing or Automatic Closing by Smoke Detection.

Penetrations Other Than Those Necessary for the Purpose of the Shaft Shall Not be Permitted.

Elevators Shall be Provided with Phase I Emergency Recall Operation and Phase II Emergency In-Car Operation in Accordance with ASME A17.1/CSA B44 (3003.2)

An Area of Refuge is Not Required in Buildings Equipped with an Automatic Sprinkler System. (Section 1009.4.2, Exception 2)

Occupancy & Incidental Separations: (Non-Separated Uses, Per IBC Sec. 508.3)

Walls Separating Dwelling and Sleeping Units Shall Have a Fire-Resistive Rating Not Less Than 1-HR (Sect. 708.3)

Horizontal Assemblies Serving as Dwelling or Sleeping Unit Separations Shall Not be Less Than 1-HR Rated (Sect. 711.2.4.3)

Laundry Rooms Over 100 SF — 1 HR Rated

Roof Coverings

Class C or Better (Table 1505.1)

Required Separation of Occupancies (Per IBC 508.4.4 & Table 508.4)

Uses are Not Separated by Fire Barriers. Construction is Based on the Most Restrictive Use.

Dwelling Units — 1 HR Fire Partitions

*The Majority of Dwelling Units are Separated by Existing Historic Plaster Walls; All New Walls Will be 1-Fire Partitions.

Draftstopping (Sect. 708.4.2)

Fire Partitions Shall Extend to the Underside of the Roof Deck Above.

Automatic Fire Suppression System:

Required, NFPA 13 System Provided

Portable Fire Extinguishers

Required — Provided.

Each Dwelling Unit Shall be Provided with a Portable Fire Extinguisher Having a Minimum Rating of 1-A:10-B:C

Smoke Alarm Requirements:

Required, Provided as Specified Below According to Sect. 907.2.11.2

— On the Ceiling or Wall Outside Each Separate Sleeping Area

— In Each Room Used for Sleeping

— On Each Story

Smoke Alarms Shall be Installed Not Less Than 3 Feet Horizontally from the Door or Opening of a Bathroom that Contains a Bathtub or Shower Unless This Would Prevent Placement as Required Above.

Where More Than One Smoke Alarm is Required, Smoke Alarms Shall be Interconnected in Such a Manner that the Activation of One Alarm Will Activate All the Alarms.

Wiring and Alarm Shall be Equipped with a Battery Backup.

Fire Alarm Requirements:

Required, Provided — Manual & Automatic Fire Alarm System per NFPA 72

Signaling System is Audible/Visual per NFPA 72 & ADA Installed Throughout

Initiating Devices: Pull Stations; Smoke Detection @ Sleeping & Common Areas, Sprinkler System Flow and Tamper Switches Monitored.

Smoke Alarm Requirements:

Required, Provided — Sleeping Rooms, Outside Sleeping Rooms & at Each Floor

Emergency Power Source:

Exit Signs, Exit Illumination & Emergency Lighting is by Battery Back-Up

Hazardous Materials: (Per IBC Table 307.1(1))

No Hazardous Materials are to be Stored

Smoke Control:

Smoke Partitions:

Standpipes:

Not Required

Not Required

Not Required (Top Flr <30')

Total Occupant Load:

88

Exiting:

Reference Plan

Occupant Load Factors: (Tables 1004.1.2, 1015.1):

Occupancy

Use

Load Factor

Max.Occ/Stry 1 Exit

R-2

Apartment

200 sf/Occupant

10

B

Business

100 sf/Occupant

49

S-1

Storage

300 sf/Occupant

29

M

Mechanical

300 sf/Occupant

49

BUILDING B CODE INFORMATION

Occupancy Overall: Residential

Construction Type: II-B (Assumed — Existing Building)

Occupancy Basic

R-2 Apartments

*Building Has an NFPA 13R Sprinkler System, Section 903.3.1.2

*Allowable Area and Height Based on Different Uses Not Being Separated by Fire Barriers, Most Restrictive Allowance.

Allowable Area Increase:

R-2

Actual Building Area:

First Floor

5,780 SF

Second Floor

5,780 SF

Base Allowable

16,000 SF

Area Increase (25%)

4,000 SF

Total Floor Allowable

20,000 SF

Basic Allowable Stories:

2

Actual Stories:

1

Basic Allowable Height:

40'

Actual Height:

16'

Fire Resistance Rating for Building Elements: V-B

Exterior Bearing Walls:

0 Hour

Structural Frame:

0 Hour

Interior Bearing Walls:

0 Hour

Interior Non-Bearing Walls:

0 Hour

Stairs

0 Hour

Floor/Ceiling Assembly:

0 Hour

Ceiling/Roof Assembly:

0 Hour

Corridor/Dwelling Units:

1/2 Hour

Dwelling Units

1 HR Fire Partitions

Roof Coverings

Class C or Better

Required Separation of Occupancies (Per IBC 508.4.4 & Table 508.4)

Uses are Not Separated by Fire Barriers. Construction is Based on the Most Restrictive Use.

Dwelling Units — 1 HR Fire Partitions

Draftstopping (Per IBC 718.4.1.1 & 718.4.2)

Draftstopping Shall be Installed in Line with Unit Separation Walls that Do Not Extend to the Roof Sheathing or Attic Space May be Subdivided into Areas Not Exceeding 3,000 SF of Above Every Two Dwelling Units, Whichever is Smaller.

Opening in the Partitions Shall be Protected by Self-Closing Doors with Automatic Latches Constructed as Required for the Partitions.

Automatic Fire Suppression System:

Required, Provided per NFPA 13R — Entire Building

Portable Fire Extinguishers

Required — Provided.

Each Dwelling Unit Shall be Provided with a Portable Fire Extinguisher Having a Minimum Rating of 1-A:10-B:C

Smoke Alarm Requirements:

Required, Provided as Specified Below According to Sect. 907.2.11.2

— On the Ceiling or Wall Outside Each Separate Sleeping Area

— In Each Room Used for Sleeping

Smoke Alarms Shall be Installed Not Less Than 3 Feet Horizontally from the Door or Opening of a Bathroom that Contains a Bathtub or Shower Unless This Would Prevent Placement as Required Above.

Where More Than One Smoke Alarm is Required, Smoke Alarms Shall be Interconnected in Such a Manner that the Activation of One Alarm Will Activate All the Alarms.

Wiring and Alarm Shall be Equipped with a Battery Backup.

Fire Alarm Requirements:

Required, Provided — Manual & Automatic Fire Alarm System per NFPA 72

Signaling System is Audible/Visual per NFPA 72 & ADA Installed Throughout

Initiating Devices: Pull Stations; Smoke Detection @ Sleeping & Common Areas, Sprinkler System Flow and Tamper Switches Monitored.

Smoke Alarm Requirements:

Required, Provided — Sleeping Rooms, Outside Sleeping Rooms & at Each Floor

Emergency Power Source:

Exit Signs, Exit Illumination & Emergency Lighting is by Battery Back-Up

Hazardous Materials: (Per IBC Table 307.1(1))

No Hazardous Materials are to be Stored

Smoke Control:

Smoke Partitions:

Standpipes:

Not Required

Not Required

Not Required (Top Flr <30')

Total Occupant Load:

24

Exiting:

Reference Plan

Occupant Load Factors: (Tables 1004.1.2, 1015.1):

Occupancy

Use

Load Factor

Max.Occ/Stry 1 Exit

R-2

Apartment

200 sf/Occupant

10

M

Mechanical

300 sf/Occupant

49

BUILDING C CODE INFORMATION

Occupancy Overall: Residential

Construction Type: II-B (Assumed — Existing Building)

Occupancy Basic

R-2 Apartments

*Building Has an NFPA 13R Sprinkler System, Section 903.3.1.2

*Allowable Area and Height Based on Different Uses Not Being Separated by Fire Barriers, Most Restrictive Allowance.

Allowable Area Increase:

R-2

Actual Building Area:

First Floor

5,922 SF

Second Floor

5,922 SF

Base Allowable

16,000 SF

Area Increase (25%)

4,000 SF

Total Floor Allowable

20,000 SF

Basic Allowable Stories:

2

Actual Stories:

1

Basic Allowable Height:

40'

Actual Height:

16'

Fire Resistance Rating for Building Elements: V-B

Exterior Bearing Walls:

0 Hour

Structural Frame:

0 Hour

Interior Bearing Walls:

0 Hour

Interior Non-Bearing Walls:

0 Hour

Stairs

0 Hour

Floor/Ceiling Assembly:

0 Hour

Ceiling/Roof Assembly:

0 Hour

Corridor/Dwelling Units:

1/2 Hour

Dwelling Units

1 HR Fire Partitions

Roof Coverings

Class C or Better

Required Separation of Occupancies (Per IBC 508.4.4 & Table 508.4)

Uses are Not Separated by Fire Barriers. Construction is Based on the Most Restrictive Use.

Dwelling Units — 1 HR Fire Partitions

Draftstopping (Per IBC 718.4.1.1 & 718.4.2)

Draftstopping Shall be Installed in Line with Unit Separation Walls that Do Not Extend to the Roof Sheathing or Attic Space May be Subdivided into Areas Not Exceeding 3,000 SF of Above Every Two Dwelling Units, Whichever is Smaller.

Opening in the Partitions Shall be Protected by Self-Closing Doors with Automatic Latches Constructed as Required for the Partitions.

Automatic Fire Suppression System:

Required, Provided per NFPA 13R — Entire Building

Portable Fire Extinguishers

Required — Provided.

Each Dwelling Unit Shall be Provided with a Portable Fire Extinguisher Having a Minimum Rating of 1-A:10-B:C

Smoke Alarm Requirements:

Required, Provided as Specified Below According to Sect. 907.2.11.2

— On the Ceiling or Wall Outside Each Separate Sleeping Area

— In Each Room Used for Sleeping

Smoke Alarms Shall be Installed Not Less Than 3 Feet Horizontally from the Door or Opening of a Bathroom that Contains a Bathtub or Shower Unless This Would Prevent Placement as Required Above.

Where More Than One Smoke Alarm is Required, Smoke Alarms Shall be Interconnected in Such a Manner that the Activation of One Alarm Will Activate All the Alarms.

Wiring and Alarm Shall be Equipped with a Battery Backup.

Fire Alarm Requirements:

Required, Provided — Manual & Automatic Fire Alarm System per NFPA 72

Signaling System is Audible/Visual per NFPA 72 & ADA Installed Throughout

Initiating Devices: Pull Stations; Smoke Detection @ Sleeping & Common Areas, Sprinkler System Flow and Tamper Switches Monitored.

Smoke Alarm Requirements:

Required, Provided — Sleeping Rooms, Outside Sleeping Rooms & at Each Floor

Emergency Power Source:

Exit Signs, Exit Illumination & Emergency Lighting is by Battery Back-Up

Hazardous Materials: (Per IBC Table 307.1(1))

No Hazardous Materials are to be Stored

Smoke Control:

Smoke Partitions:

Standpipes:

Not Required

Not Required

Not Required (Top Flr <30')

Total Occupant Load:

24

Exiting:

Reference Plan

Occupant Load Factors: (Tables 1004.1.2, 1015.1):

Occupancy

Use

Load Factor

Max.Occ/Stry 1 Exit

R-2

Apartment

200 sf/Occupant

10

B

Office

100 sf/Occupant

49

JonesGillamRenz

1881 Main Street, Suite 301
Kansas City, MO 64108
jgr@jgarchitects.com

730 N. Ninth
Salina, KS 67401
785.827.0386

JCR

THE IRVING LOFTS

HISTORIC RESTORATION & REHAB APARTMENTS

CLEBURNE, TEXAS



Revision:

12-16-2025

Date:


11-20-2025

Job:






25-3479

Sheet No.:

BUILDING C:
TOTAL OCCUPANT LOAD: 24

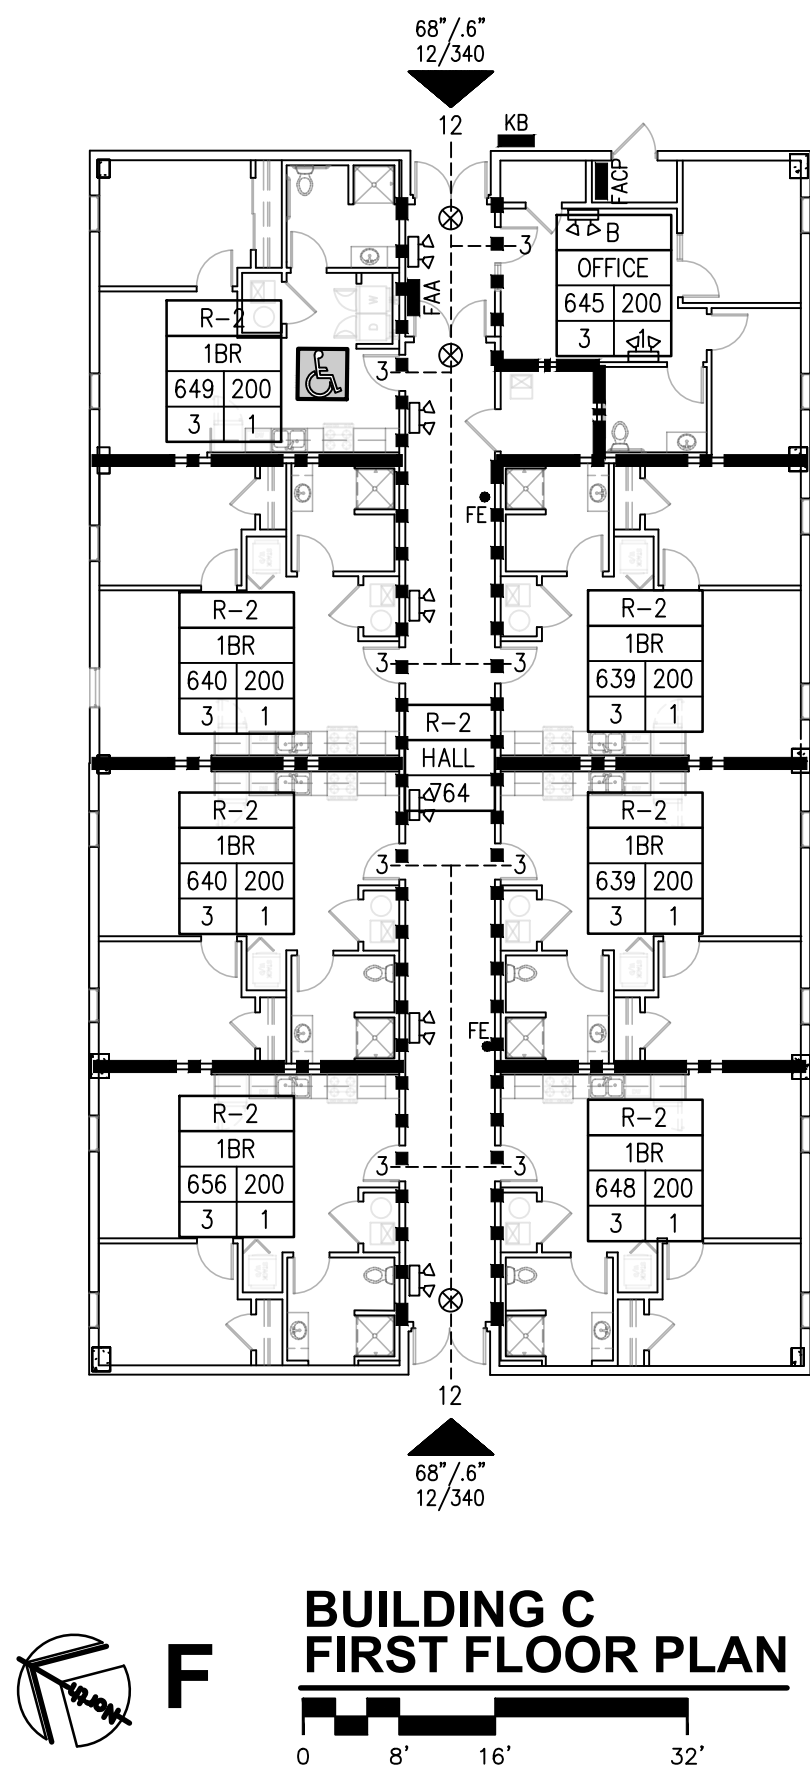

BUILDING B:
TOTAL OCCUPANT LOAD: 24

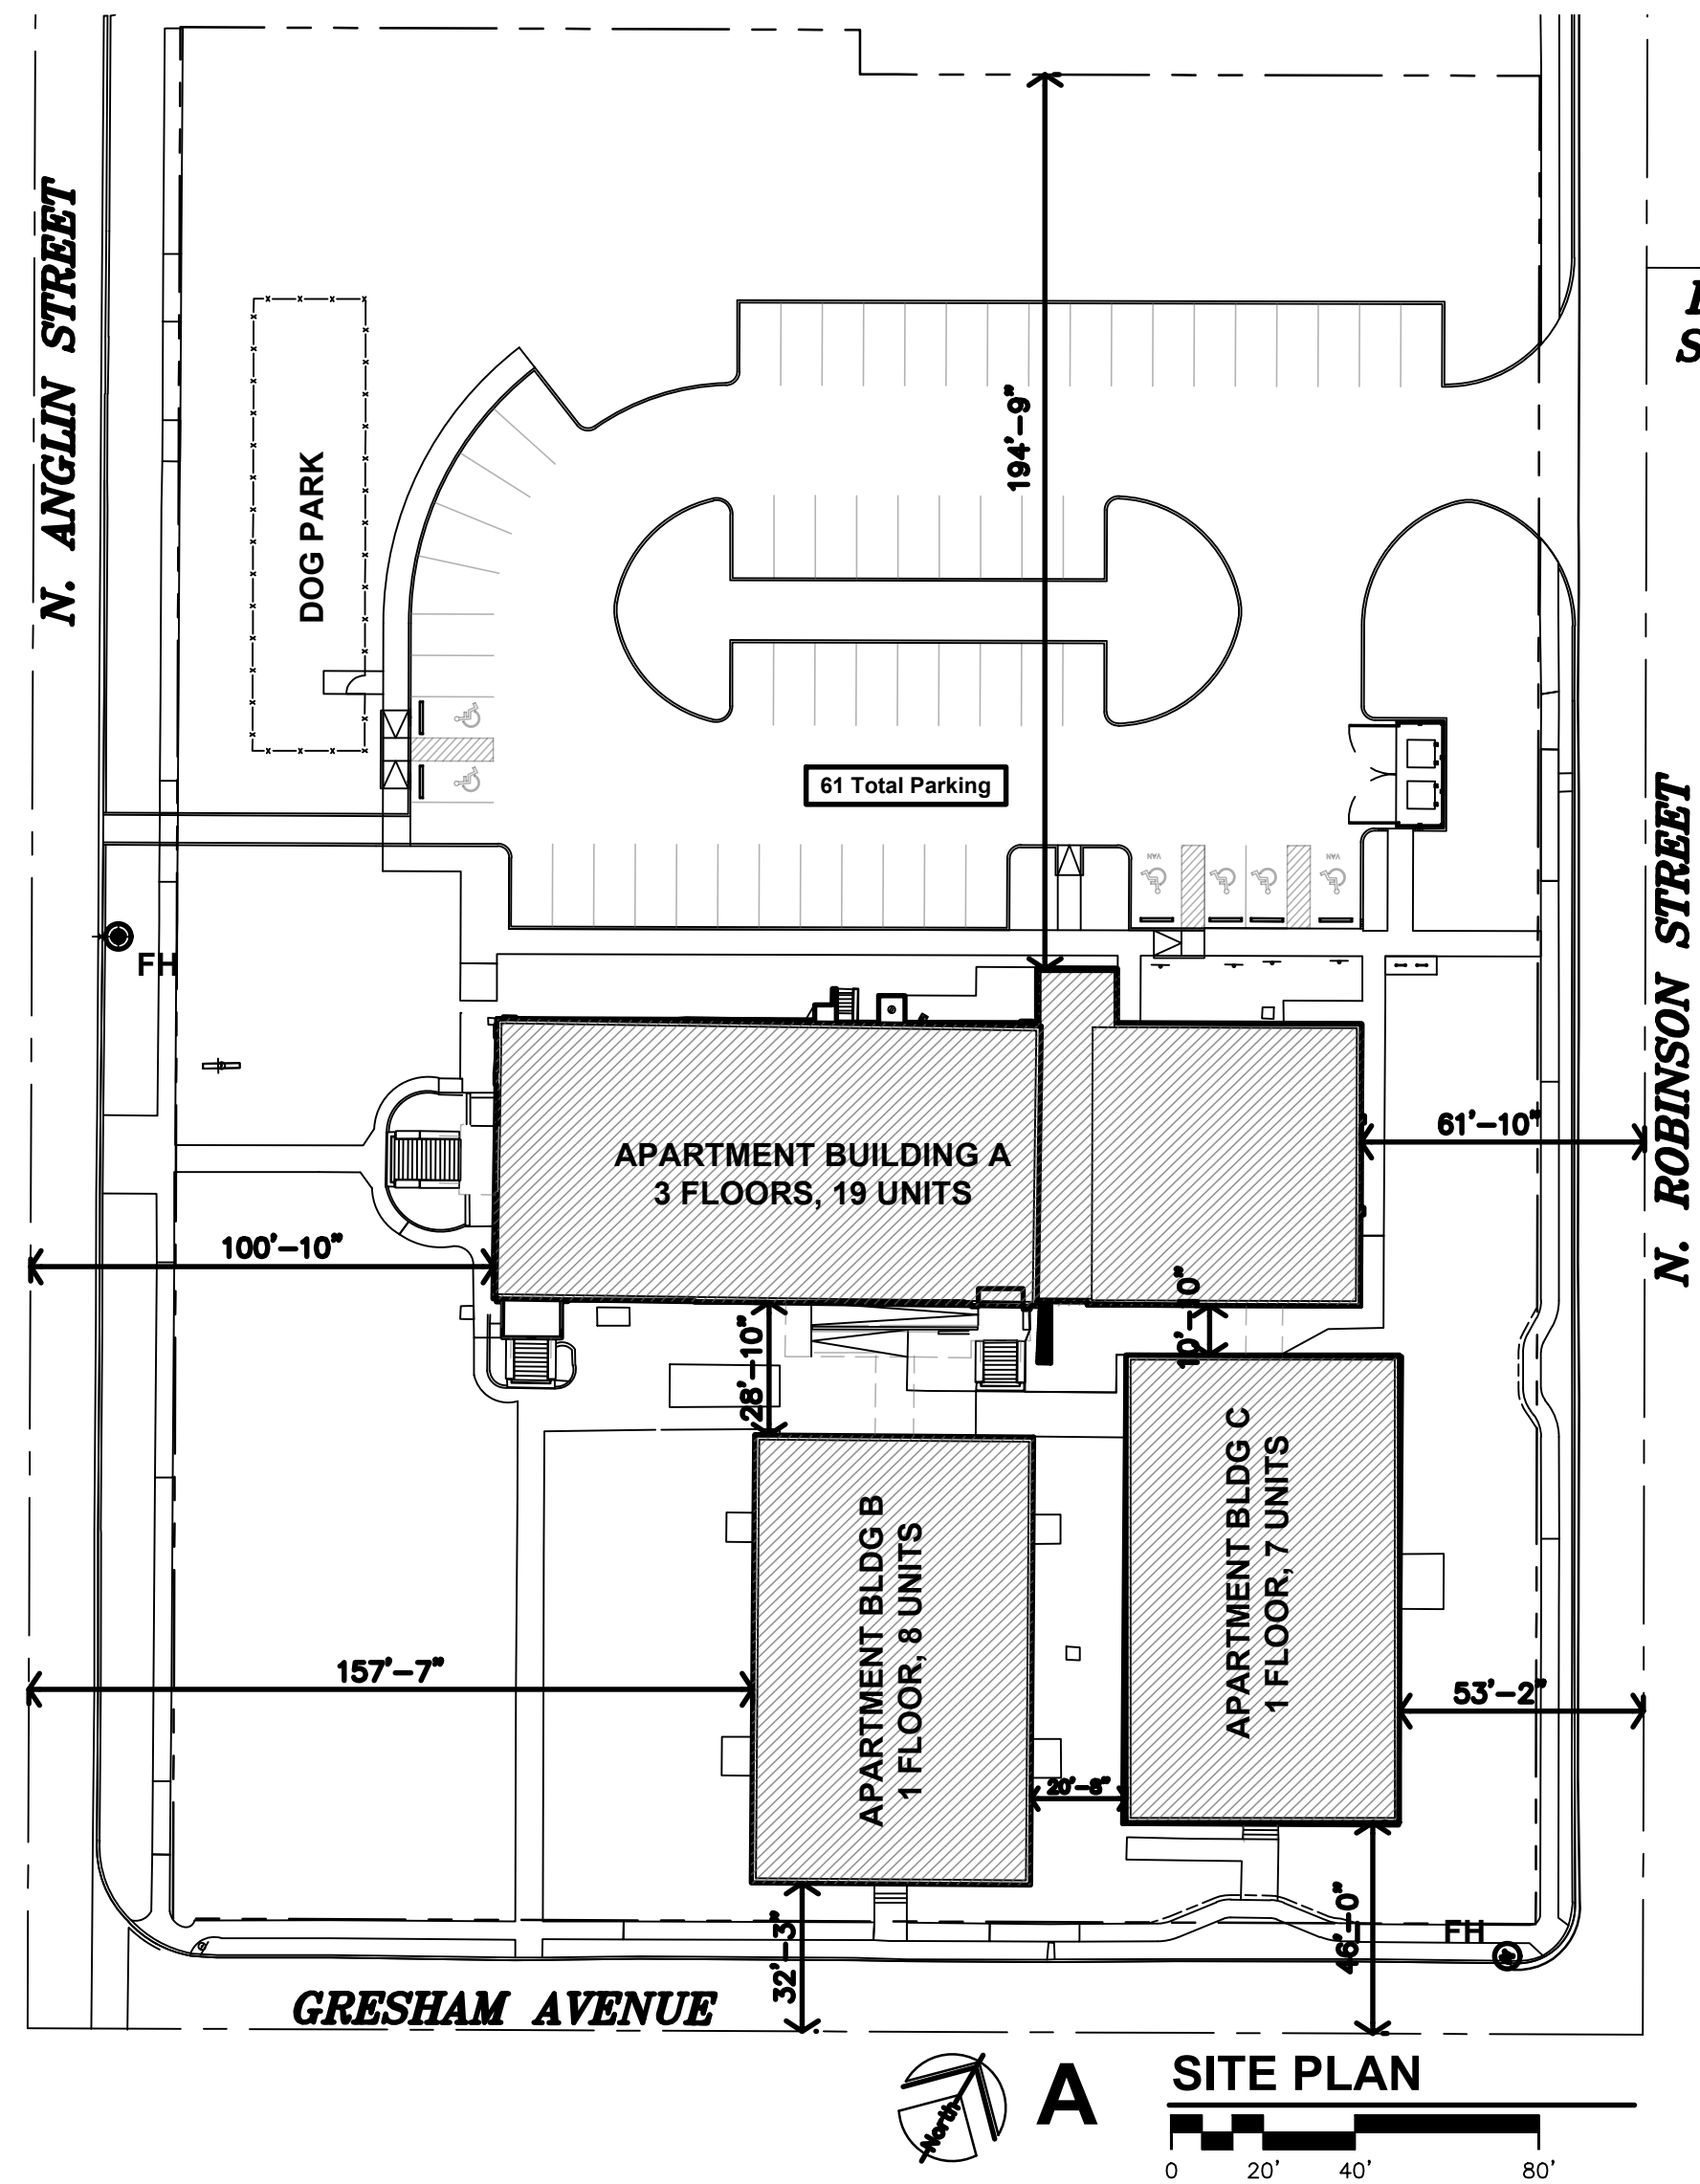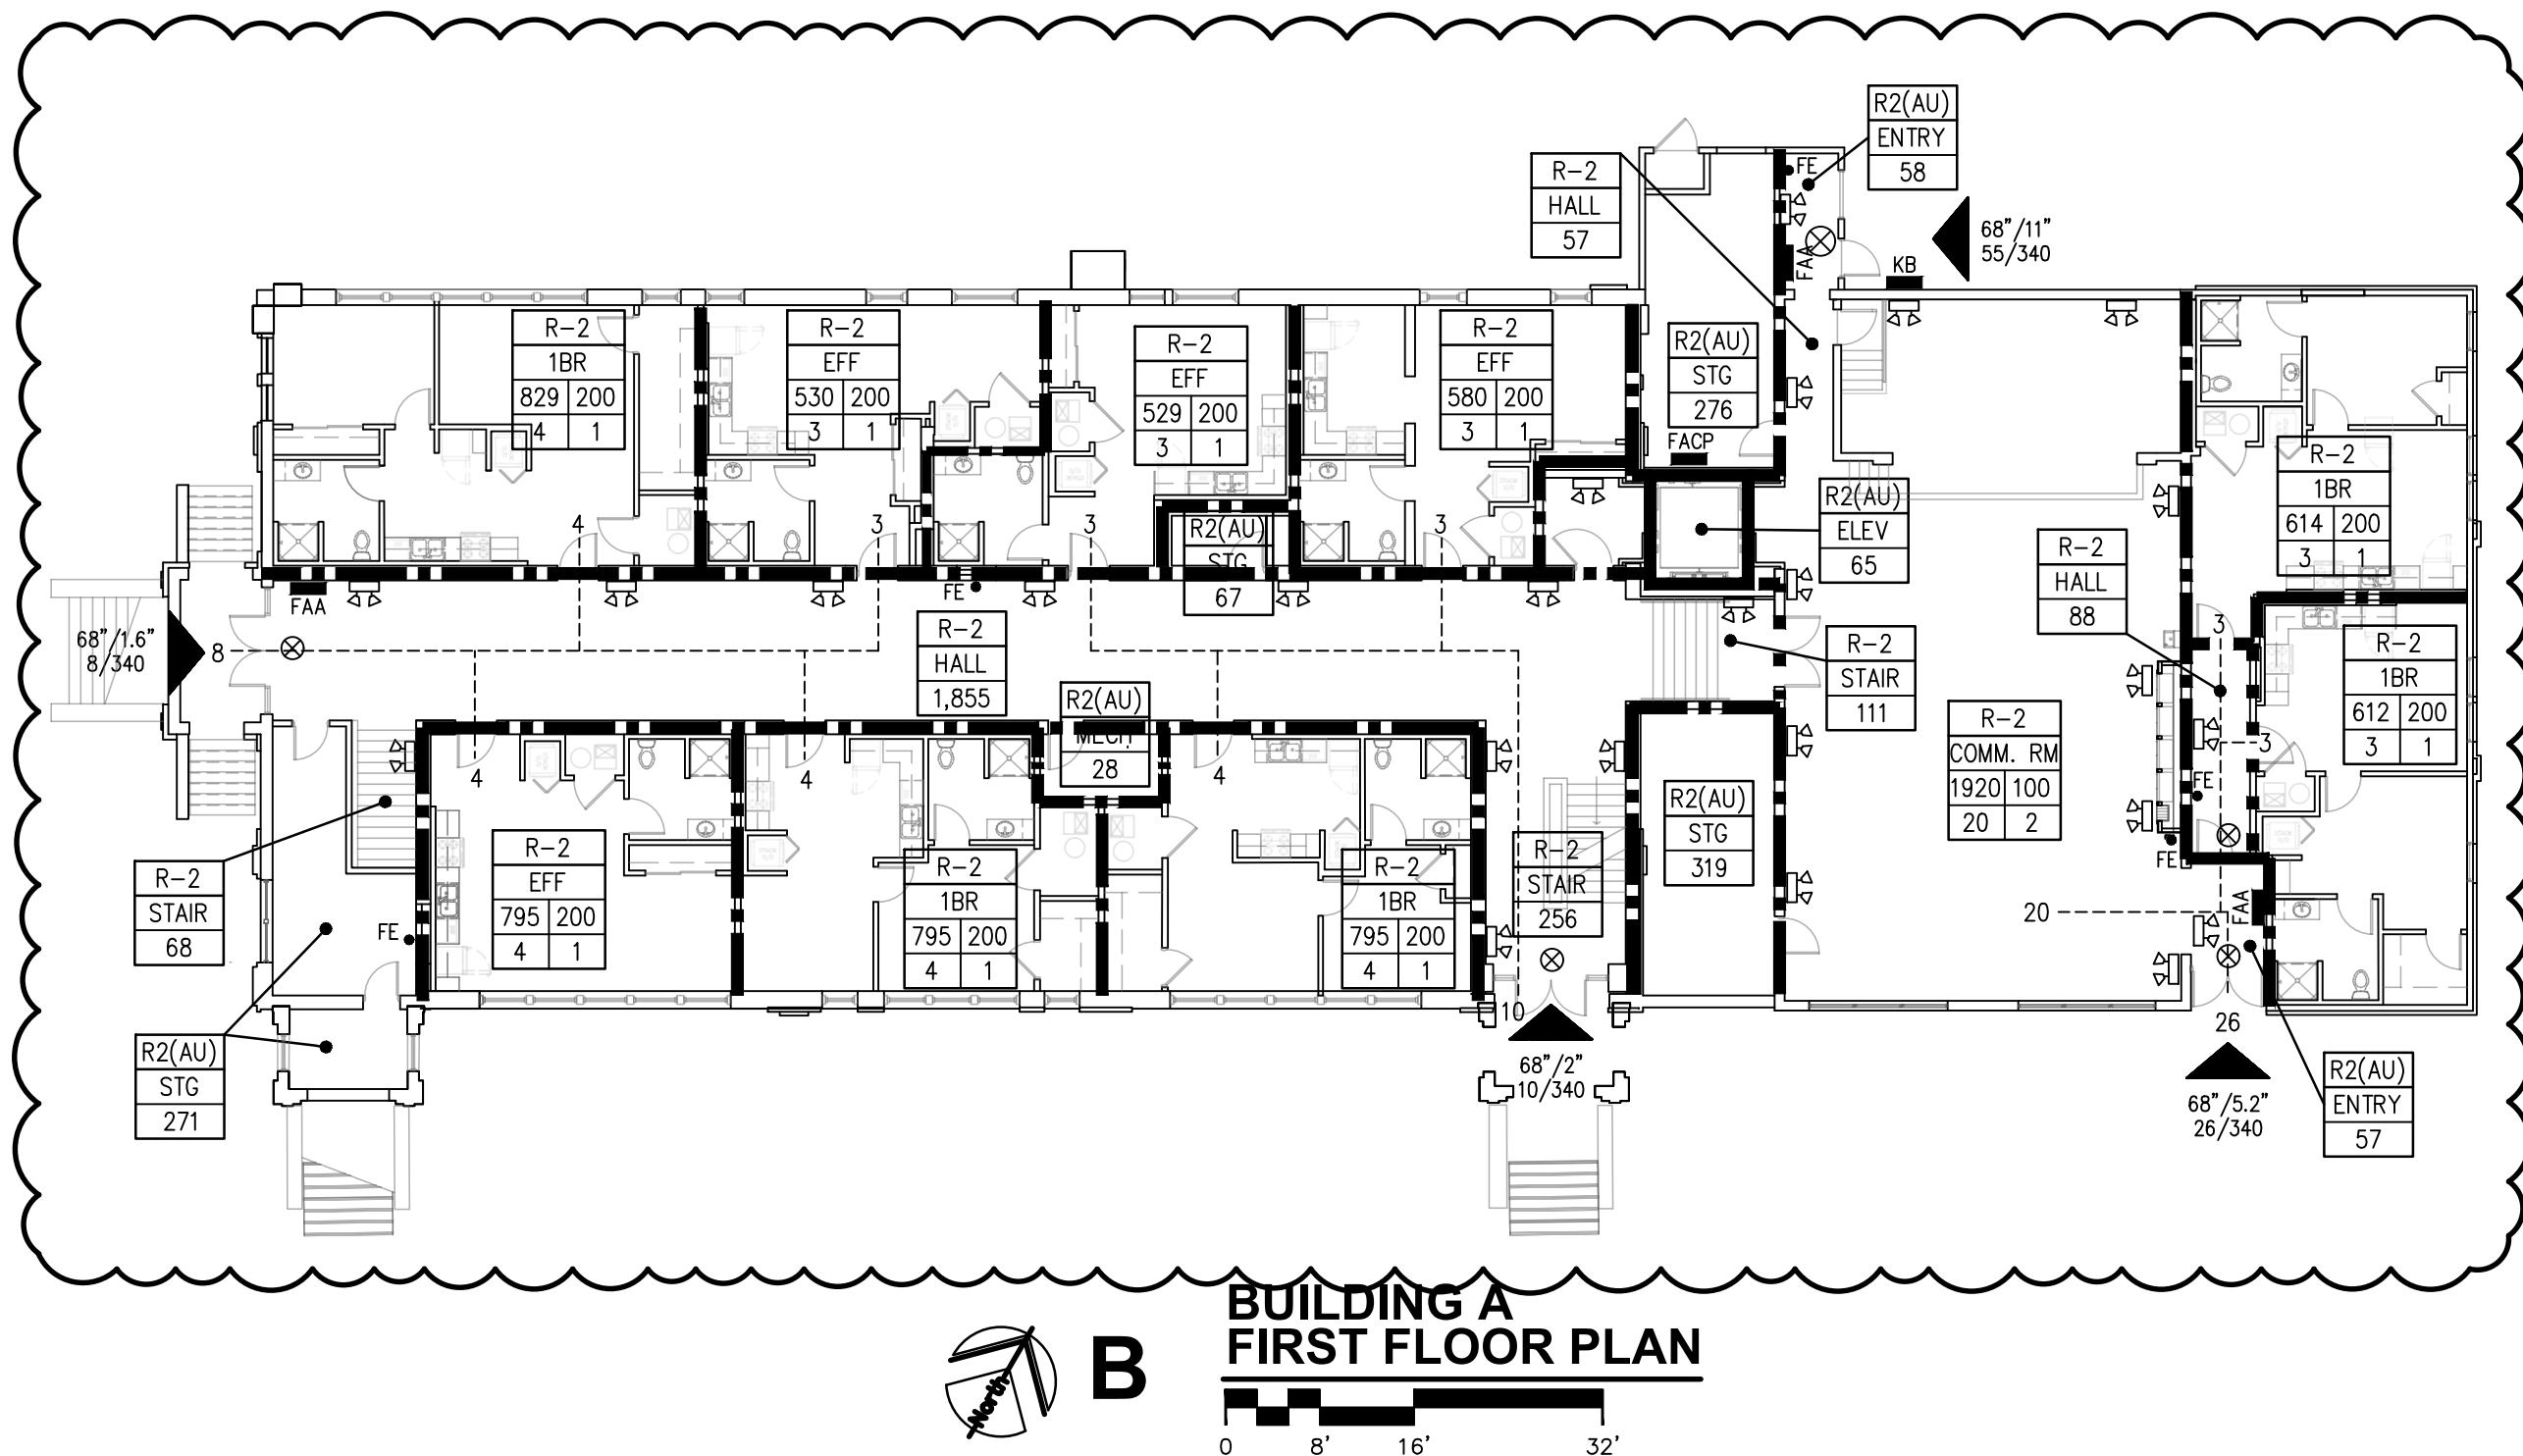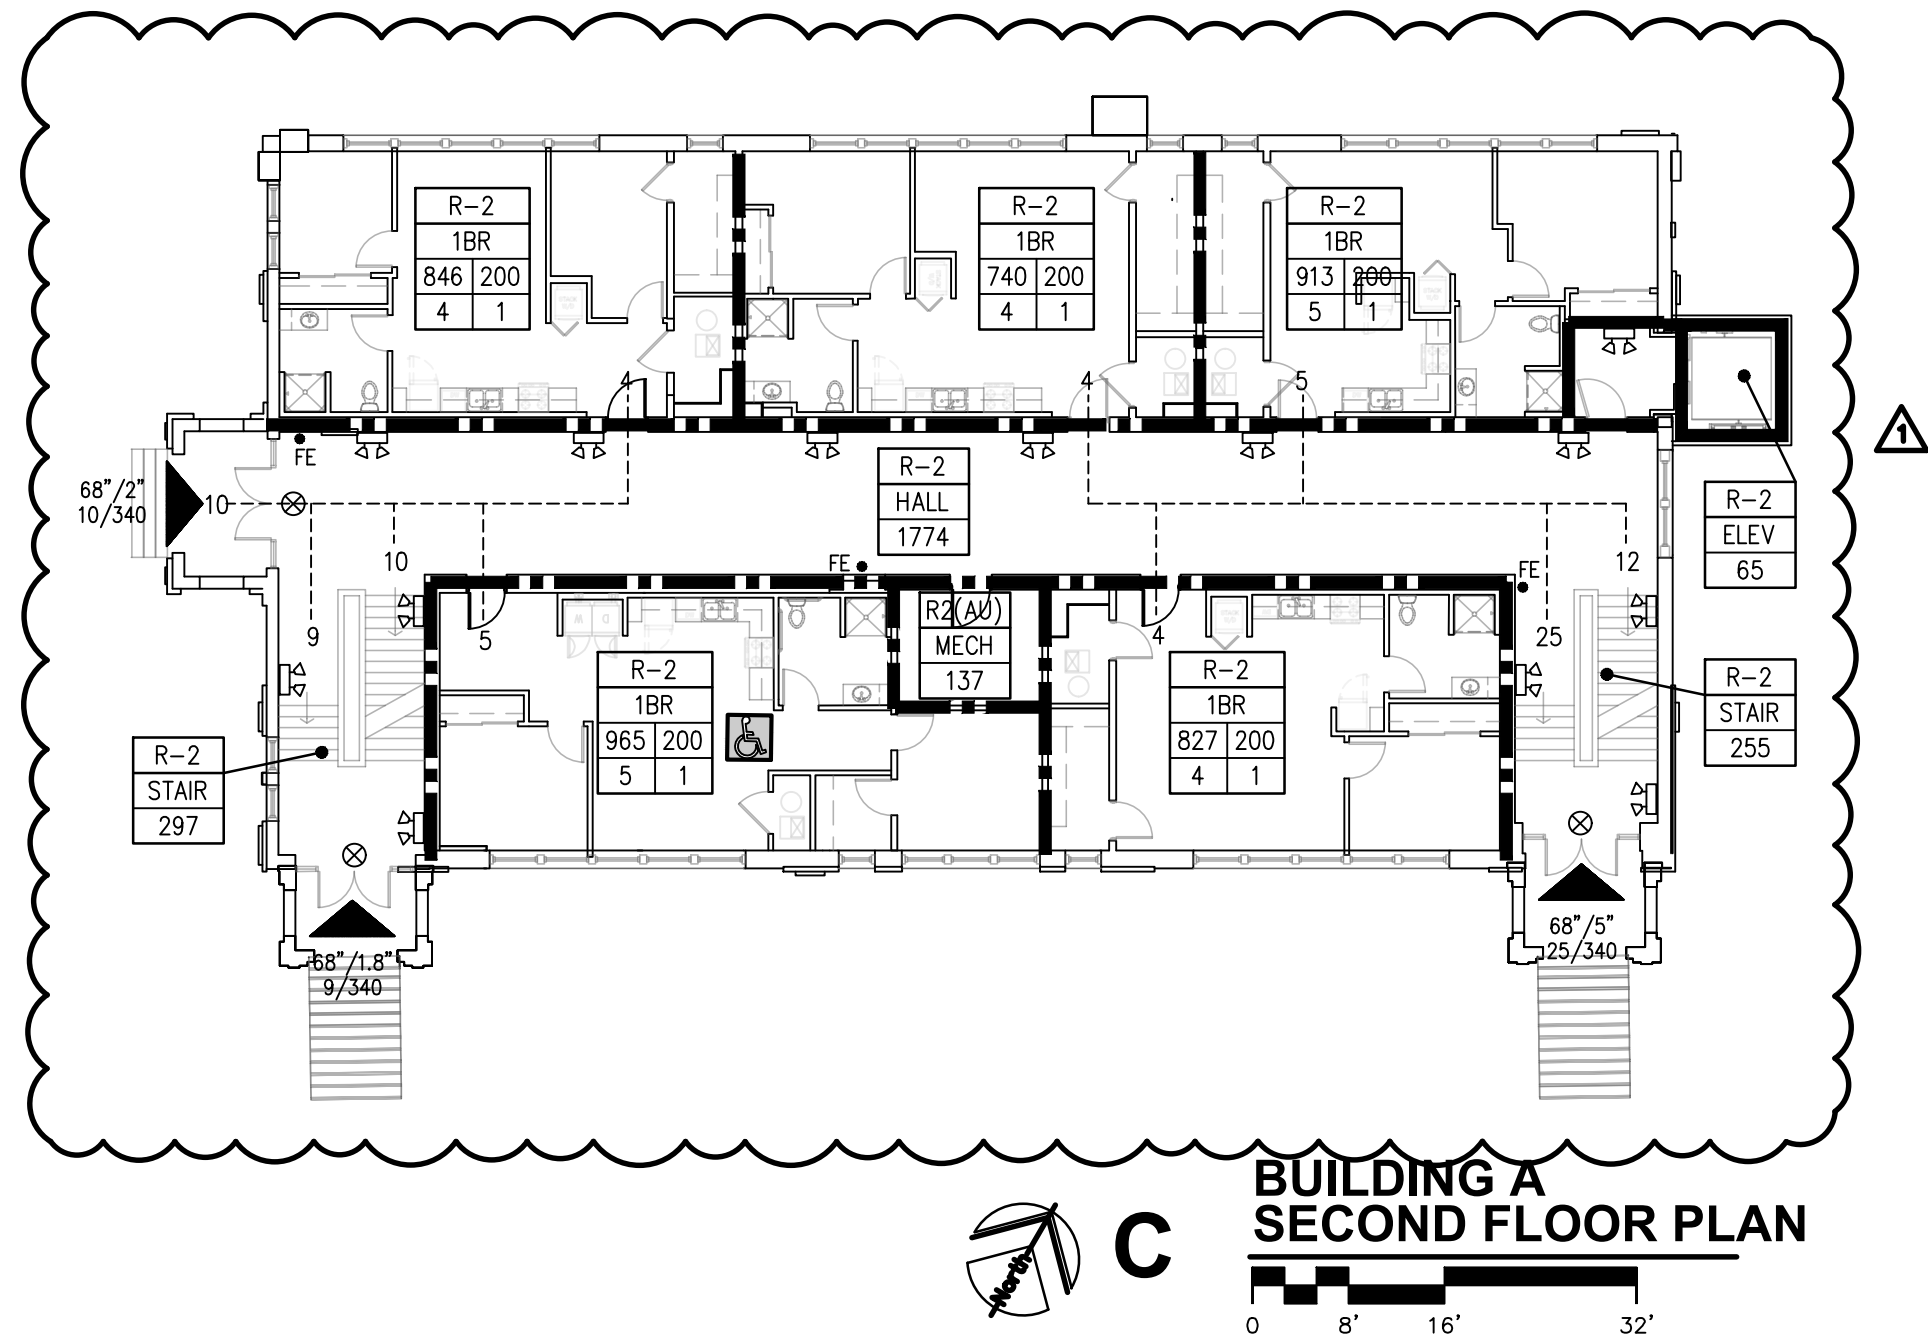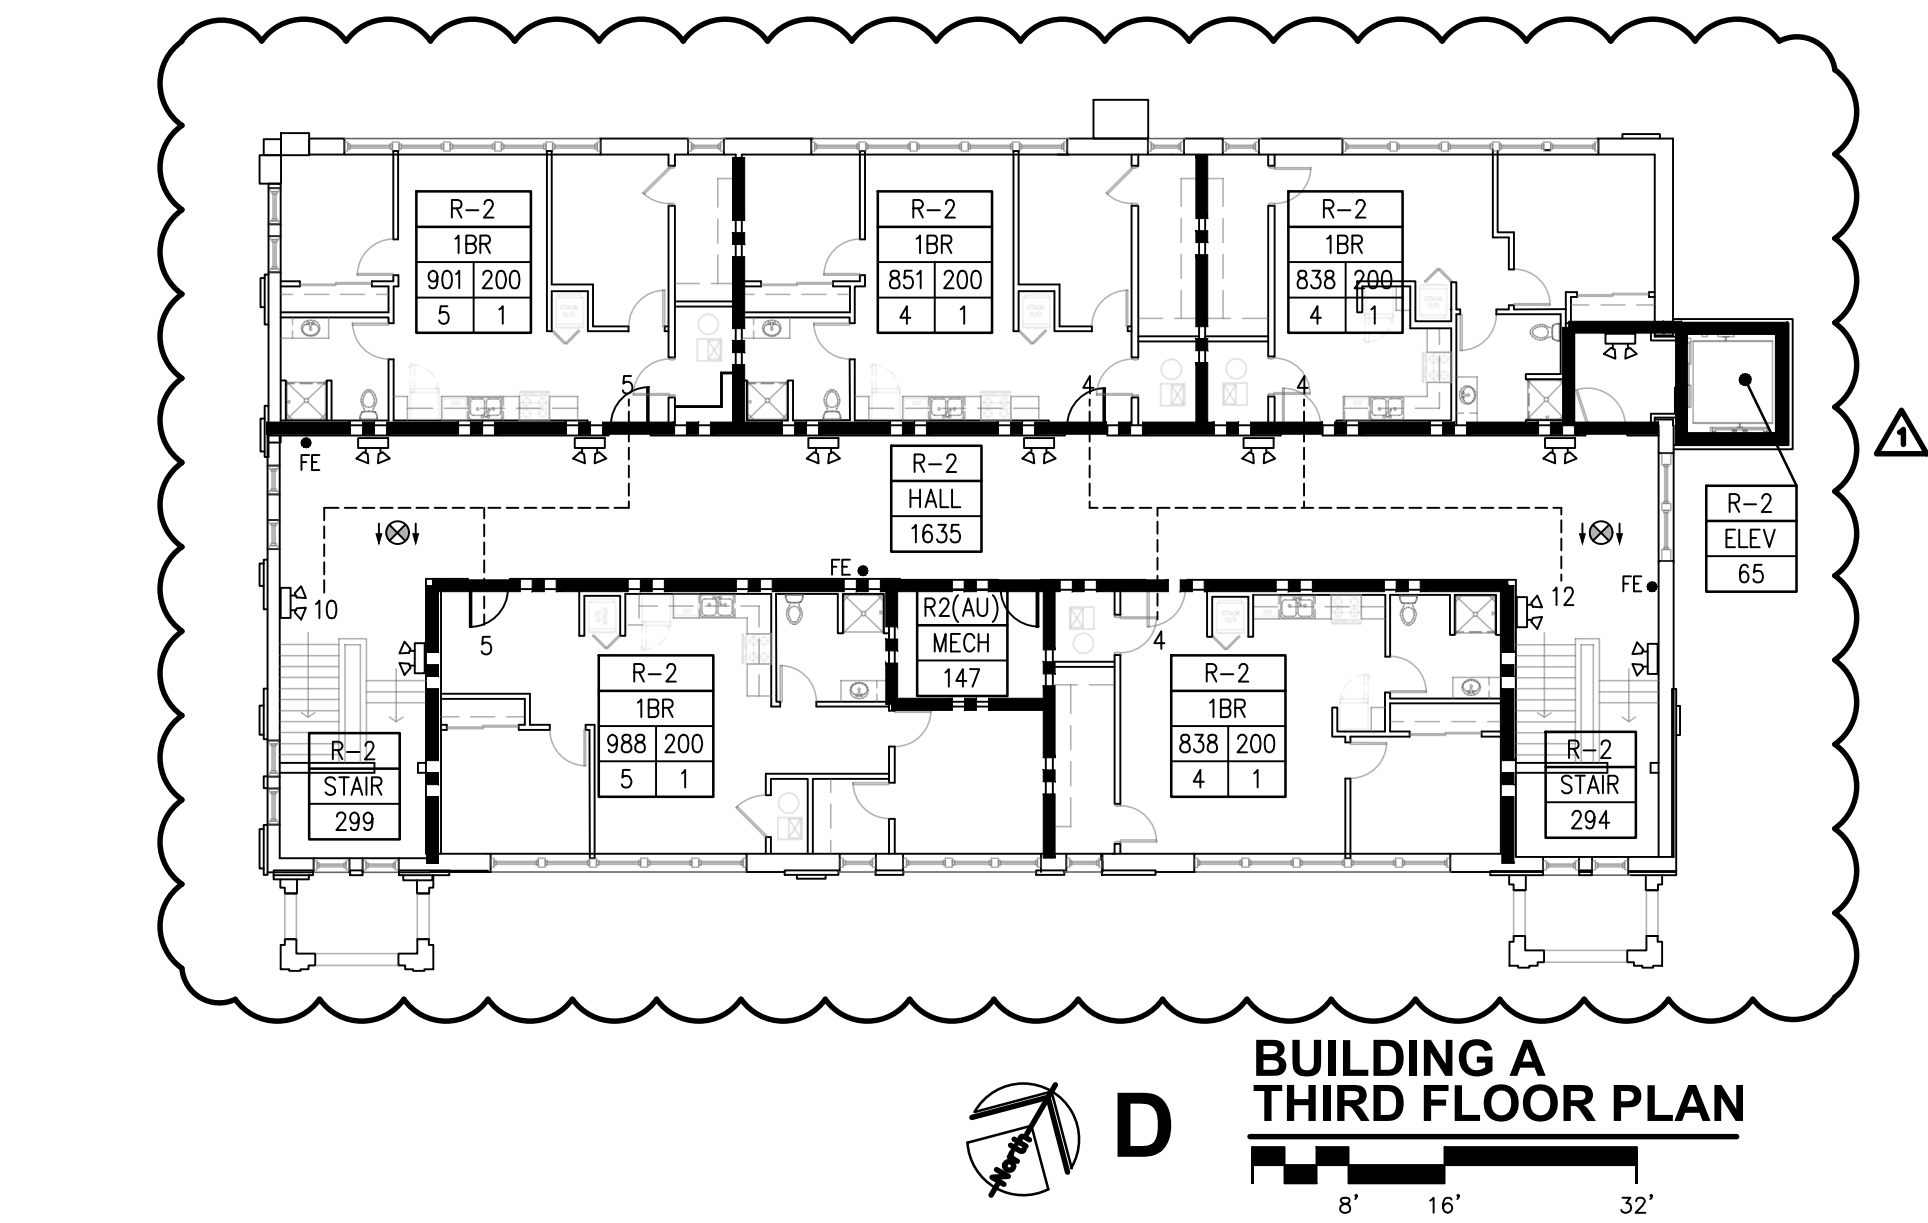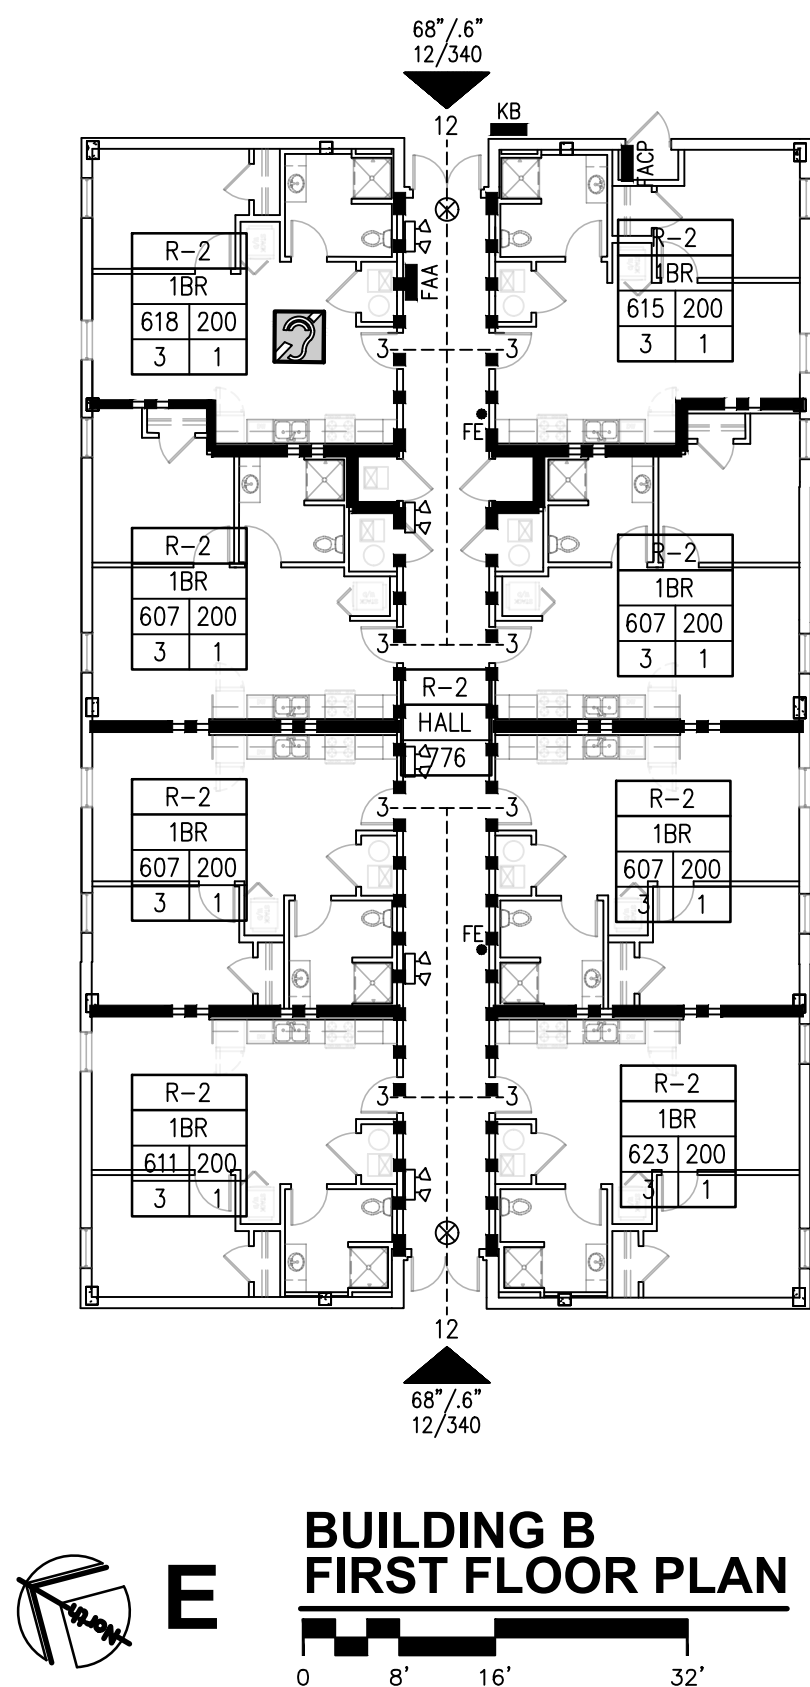

PROJECT INFORMATION

TYPE OF CONSTRUCTION	EXTERIOR RENOVATION, INTERIOR RENOVATION & REMODEL
FACILITY NAME	THE IRVING LOFTS
FACILITY ADDRESS	1108 N ANGLIN ST CLEBURNE, TEXAS 76031
OWNER NAME	OPG - IRVING LOFTS PARTNERS, LLC
OWNER ADDRESS	254 N SANTA FE AVE, STE A SALINA, KS 67401 ph: 913-396-6310
REASON FOR SUBMITTAL	CHANGE IN USE, PRIOR SCHOOL TO MULTI-FAMILY HOUSING
COUNTY	JOHNSON
LOCAL FIRE DEPARTMENT	CITY OF CLEBURNE
WATER SUPPLY	CITY OF CLEBURNE
LOCAL BUILDING INSPECTION DEPARTMENT	CITY OF CLEBURNE
ARCHITECT	JONES GILLAM RENZ ARCHITECTS, INC. 730 N. NINTH ST. SALINA, KS 67401 ph: 785-827-0386
CODES/REGULATIONS	2021 INTERNATIONAL BUILDING CODE 2021 INTERNATIONAL MECHANICAL CODE 2021 INTERNATIONAL PLUMBING CODE 2023 NATIONAL ELECTRICAL CODE 2021 INTERNATIONAL FIRE CODE 2021 INTERNATIONAL ENERGY CONSERVATION CODE FAIR HOUSING ACT DESIGN MANUAL 2010 ADA STANDARDS for ACCESSIBLE DESIGN 2017 ICC A117.1 ACCESSIBLE & USABLE BUILDINGS

LEGEND

DESIGNATED EMERGENCY EXIT	68"/24.4" ← EXIT WIDTH (ACTUAL/REQUIRED) 122/340 ← OCCUPANT LOAD (ACTUAL/ALLOWED)
0 HOUR CONSTRUCTION	---
1/2 HOUR FIRE PARTITION W/ 20 MIN. OPENINGS (PER IBC TABLE 716.5)	----
1 HOUR FIRE PARTITION W/ 45 MIN. OPENINGS (PER IBC 708.3 & 716.1(2))	-----
1 HOUR CONSTRUCTION, SHAFT WALLS W/ 60 MIN. OPENINGS (PER IBC TABLE 716.1(2))	=====
EXIT LIGHT	⊗
EXIT/EMERGENCY LIGHT	⊗
EMERGENCY LIGHT	⊗
FIRE EXTINGUISHER	•FE
FIRE HYDRANT	⊗
FIRE ALARM CONTROL PANEL	⊗
FIRE ALARM REMOTE ANNUNCIATOR PANEL	⊗
KNOX BOX	•KNOX
FIRE HYDRANT	⊗
FIRE ALARM CONTROL PANEL	⊗
FIRE ALARM REMOTE ANNUNCIATOR PANEL	⊗
KNOX BOX	•KNOX
OCCUPANCY GROUP (AU - ACCESSORY USE)	A-1
OCCUPANCY USE	ASSEMBLY HALL
ROOM SQUARE FOOTAGE/OCCUPANT LOAD FACTOR	5,550 15
OCCUPANT LOAD/REQUIRED NUMBER OF EXITS	370 2

JonesGillamRenz
1881 Main Street, Suite 301
730 N. Ninth
Salina, KS 67401
785.827.0386
jgr@jrchitects.com

JGR

THE IRVING LOFTS
HISTORIC RESTORATION & REHAB APARTMENTS
CLEBURNE, TEXAS










REVISION:
12-16-2025


DATE: 11-20-2025
JOB: 25-3479
SHEET NO.:

CFP2


COPYRIGHTED ©

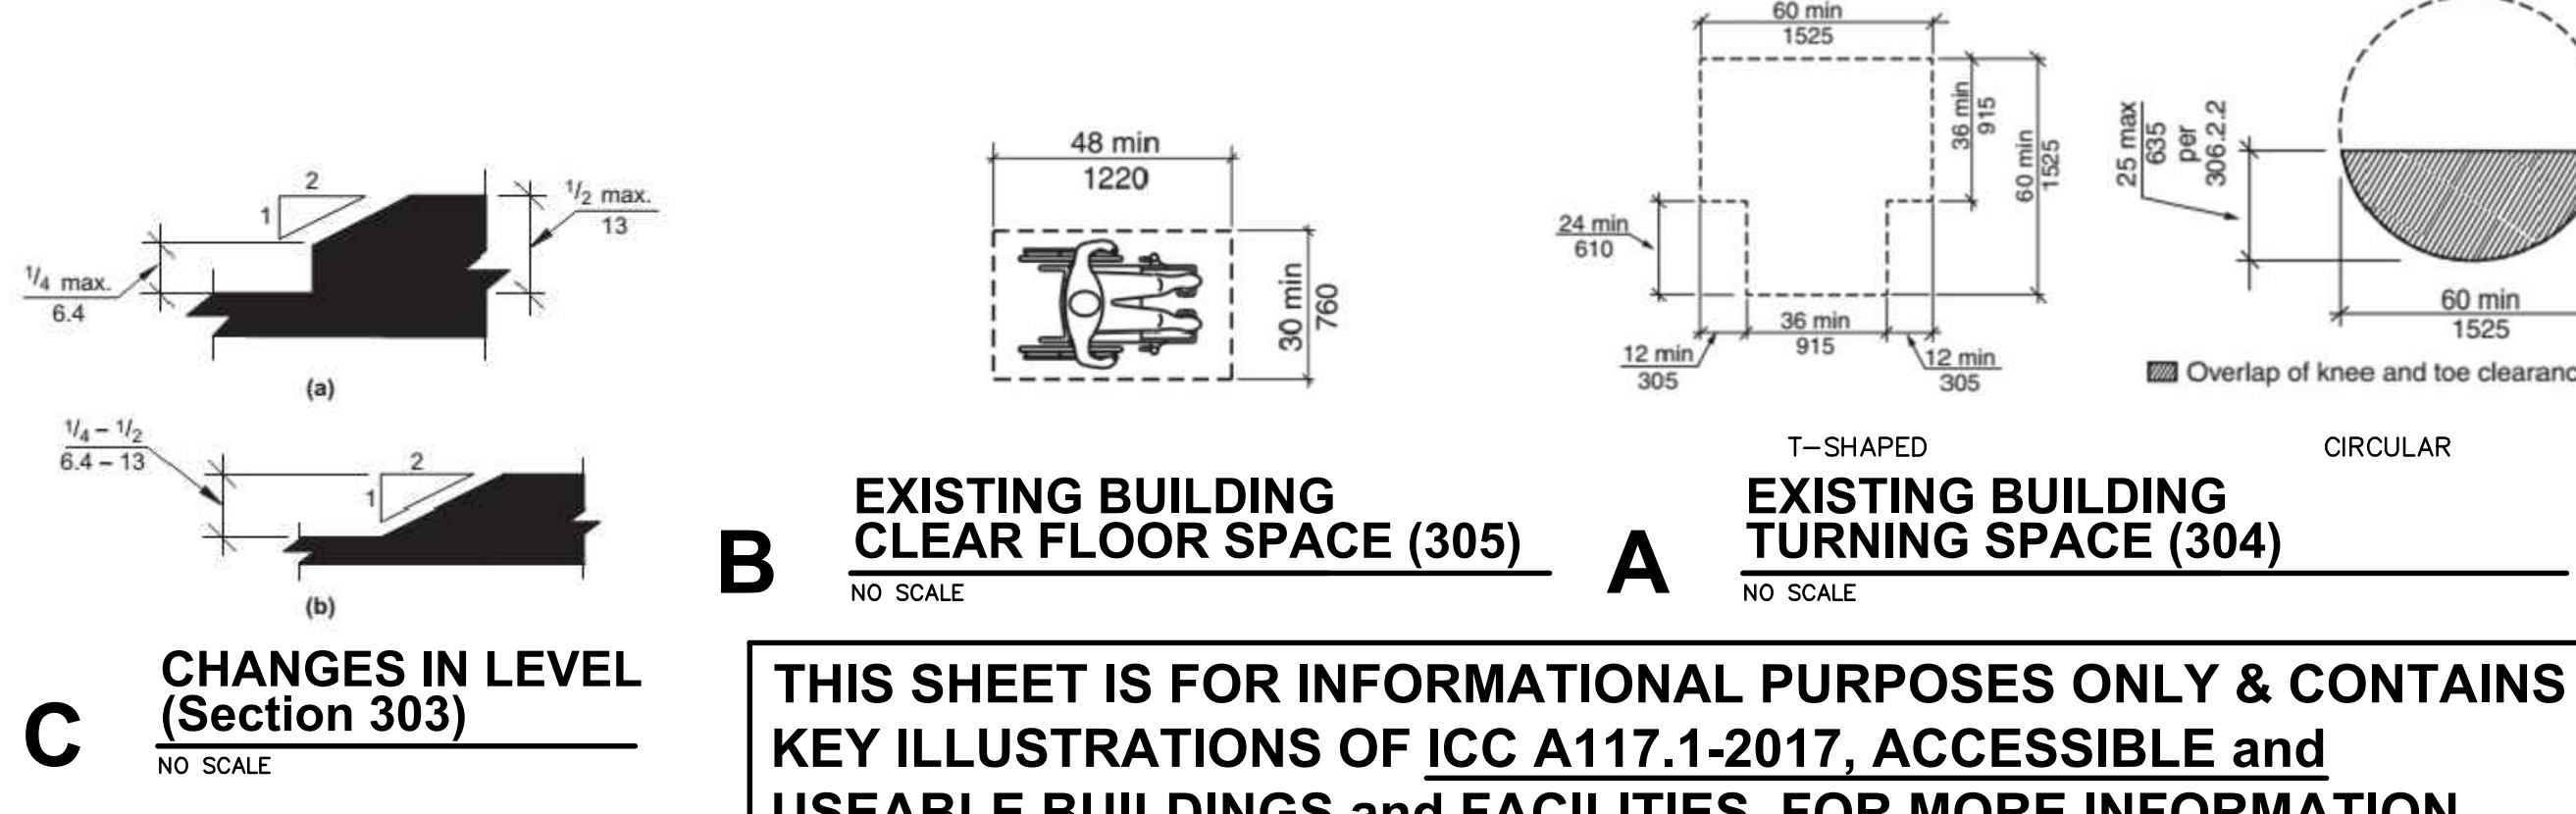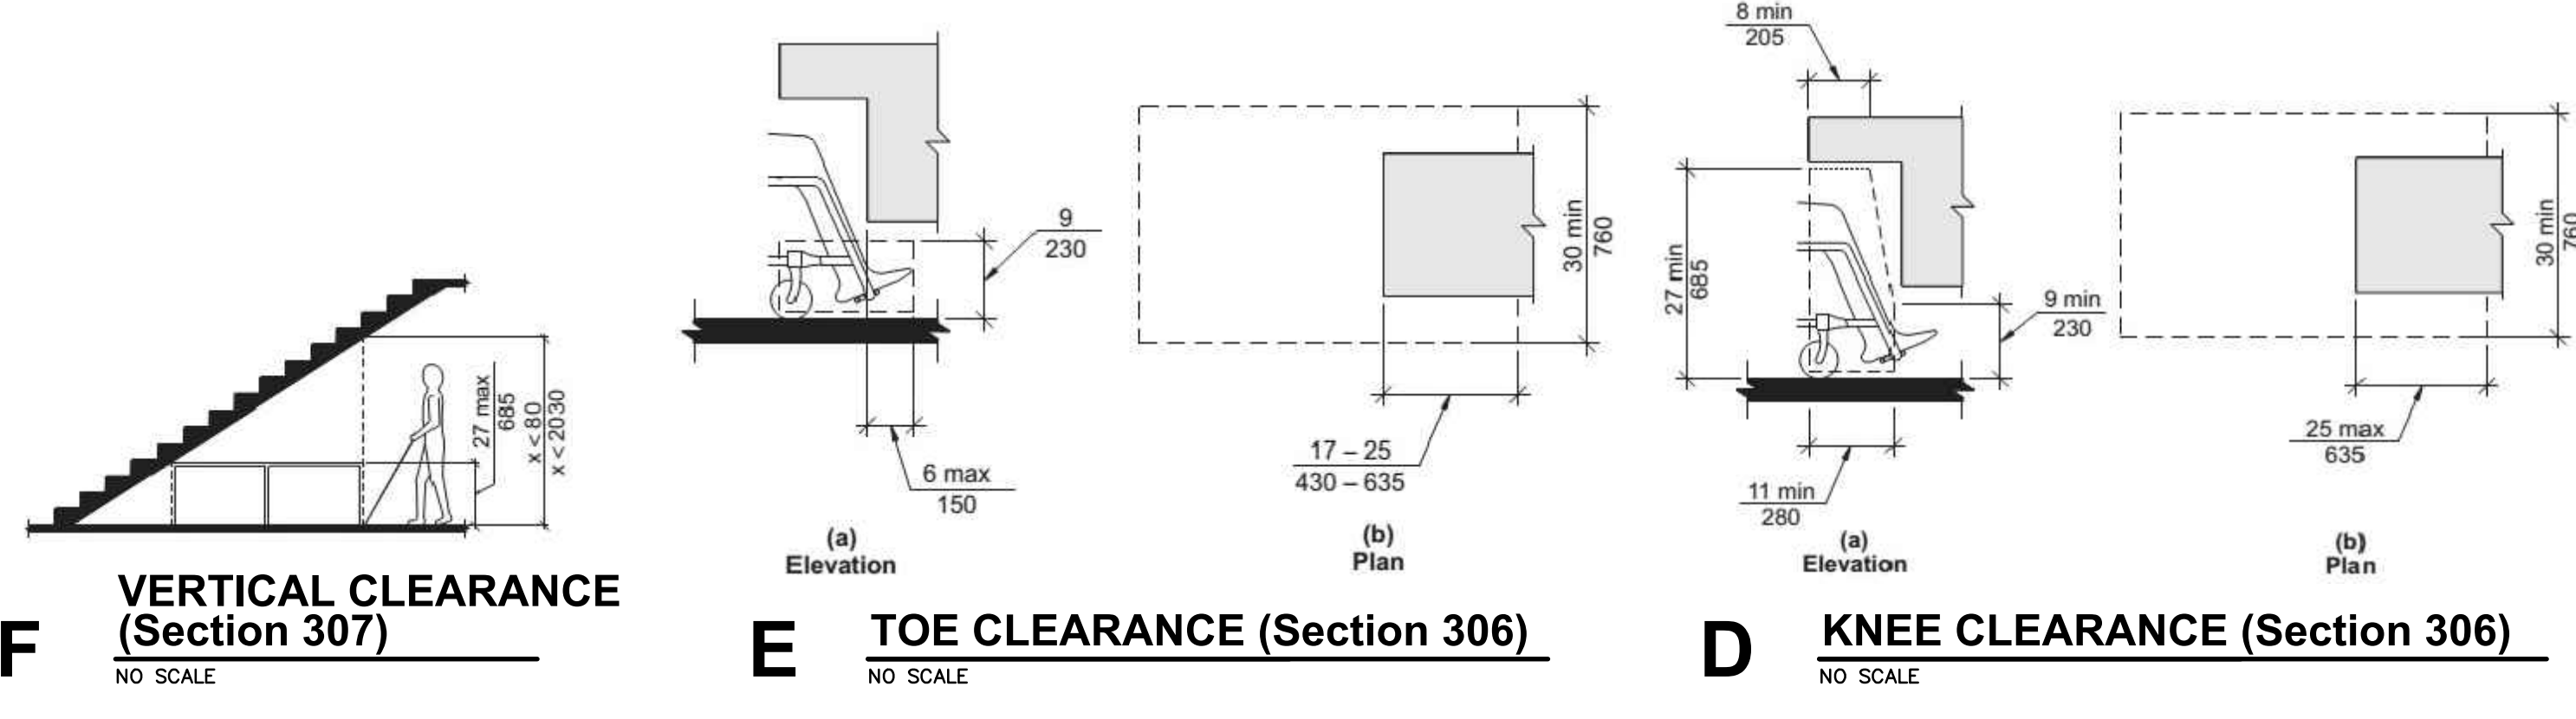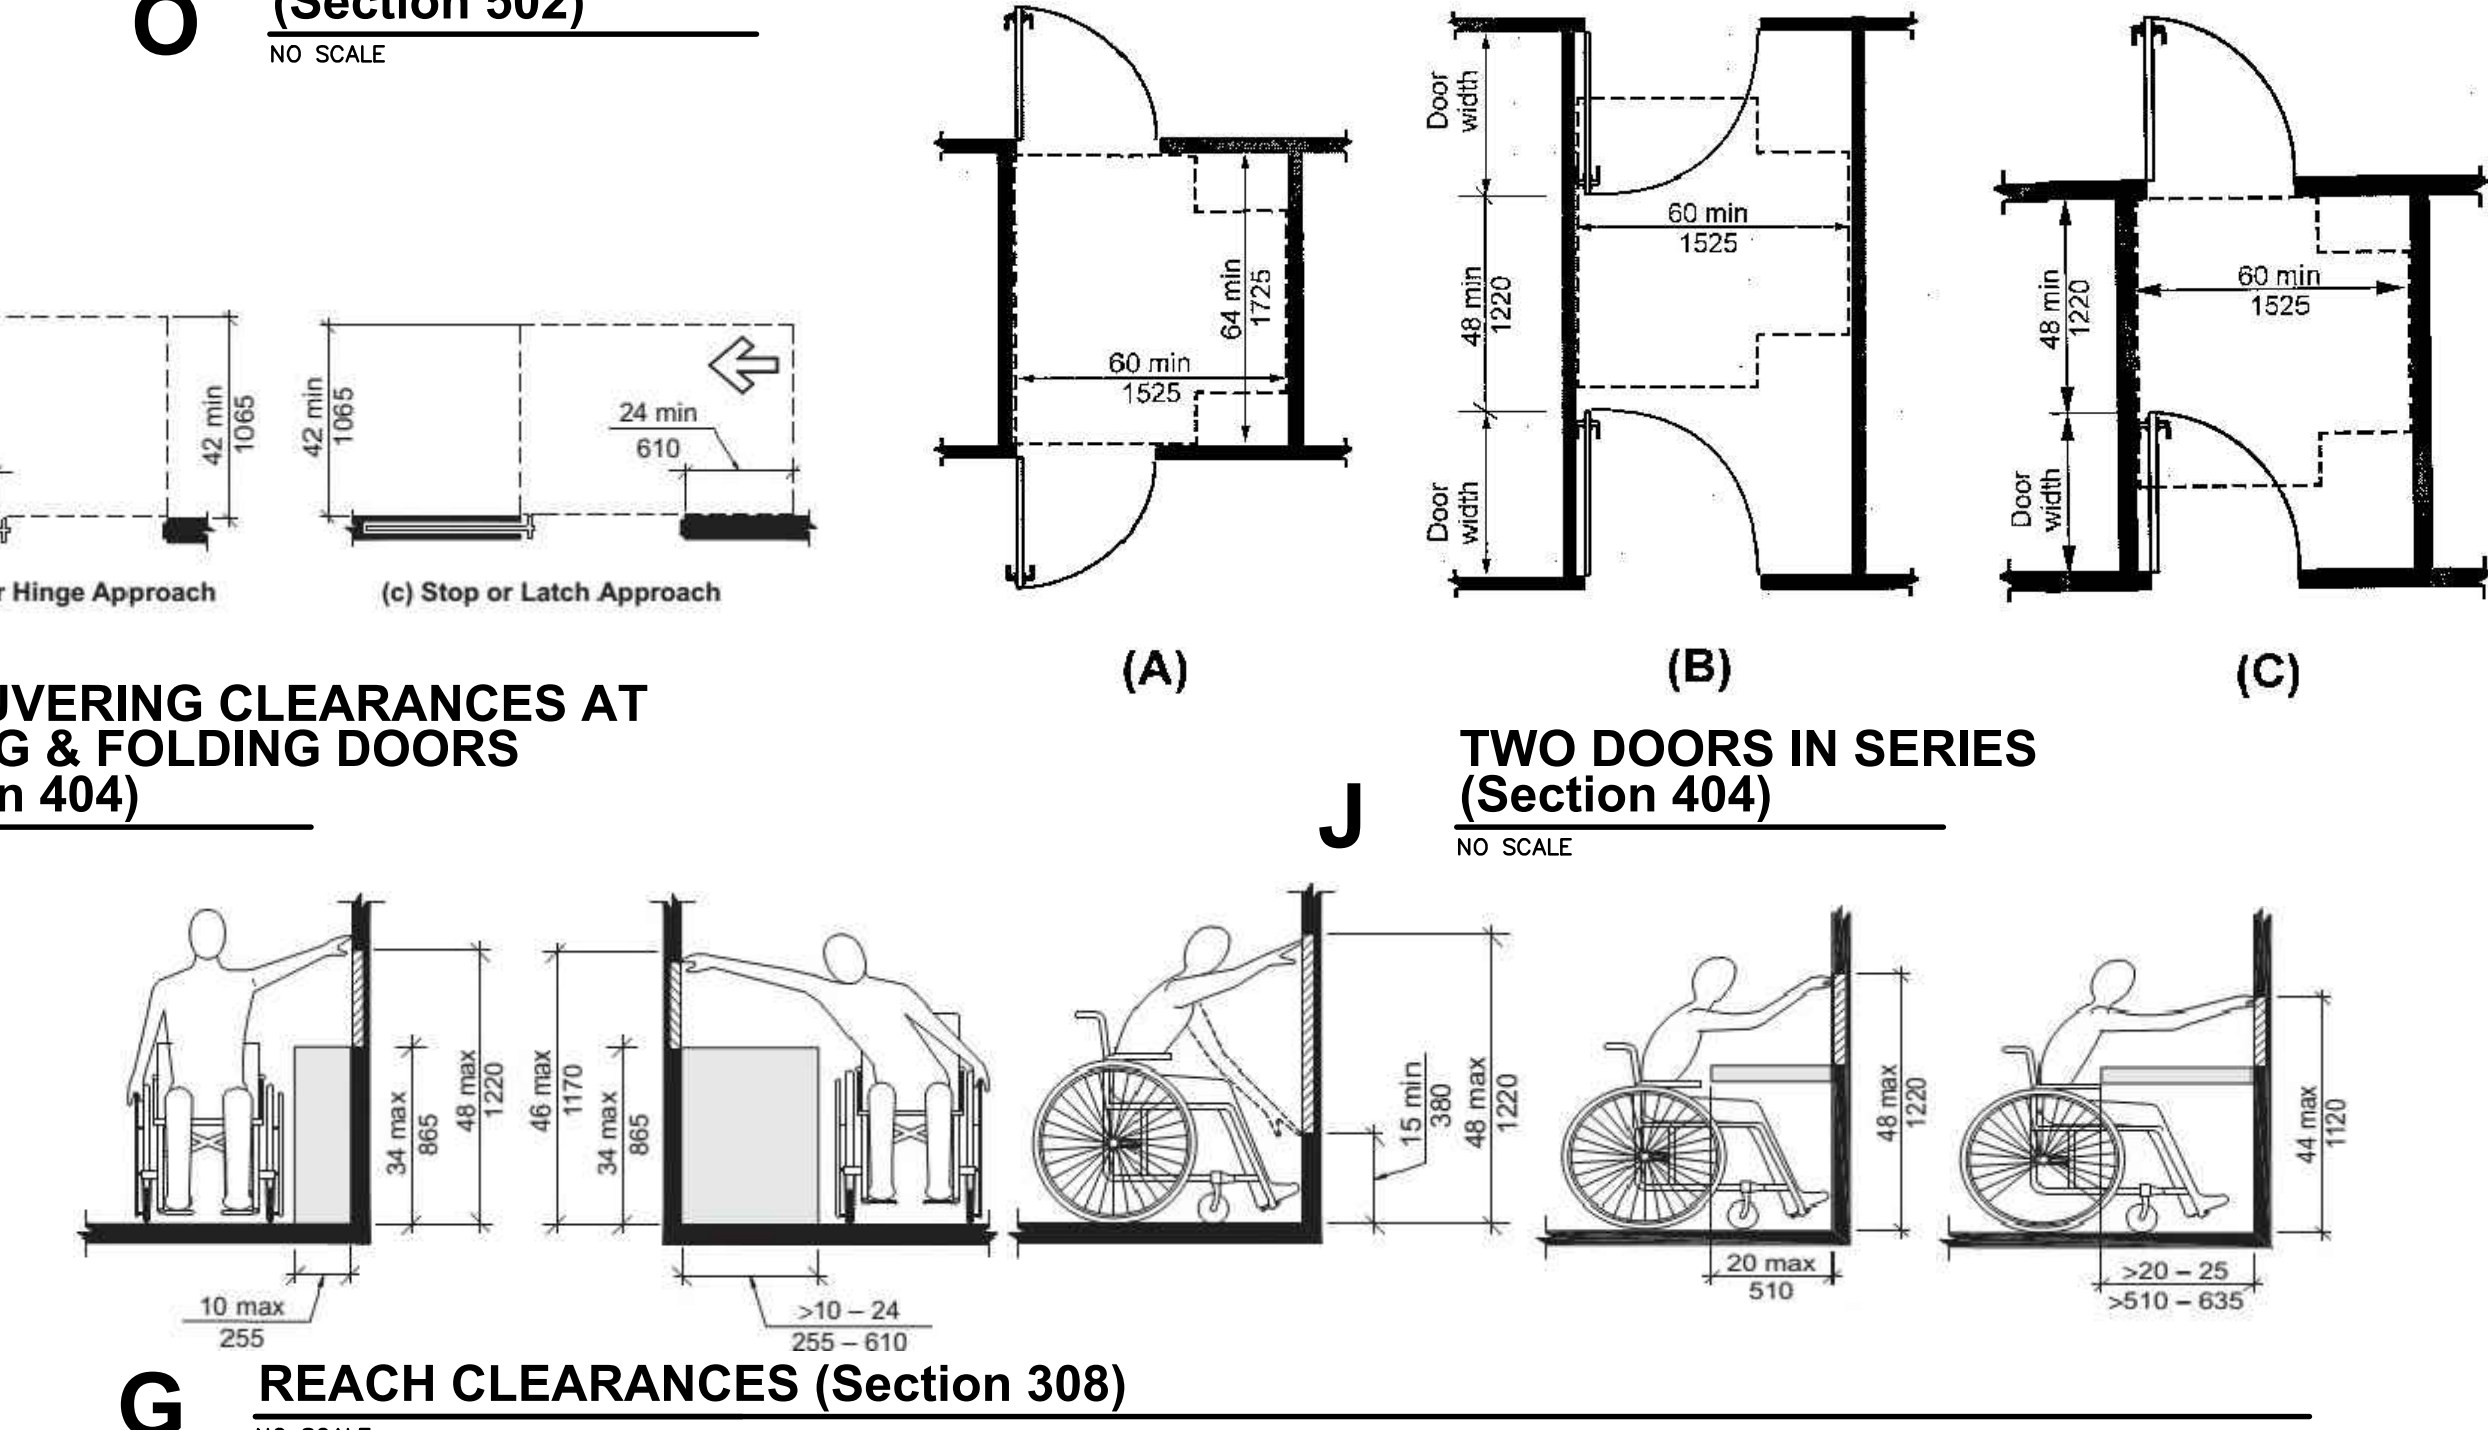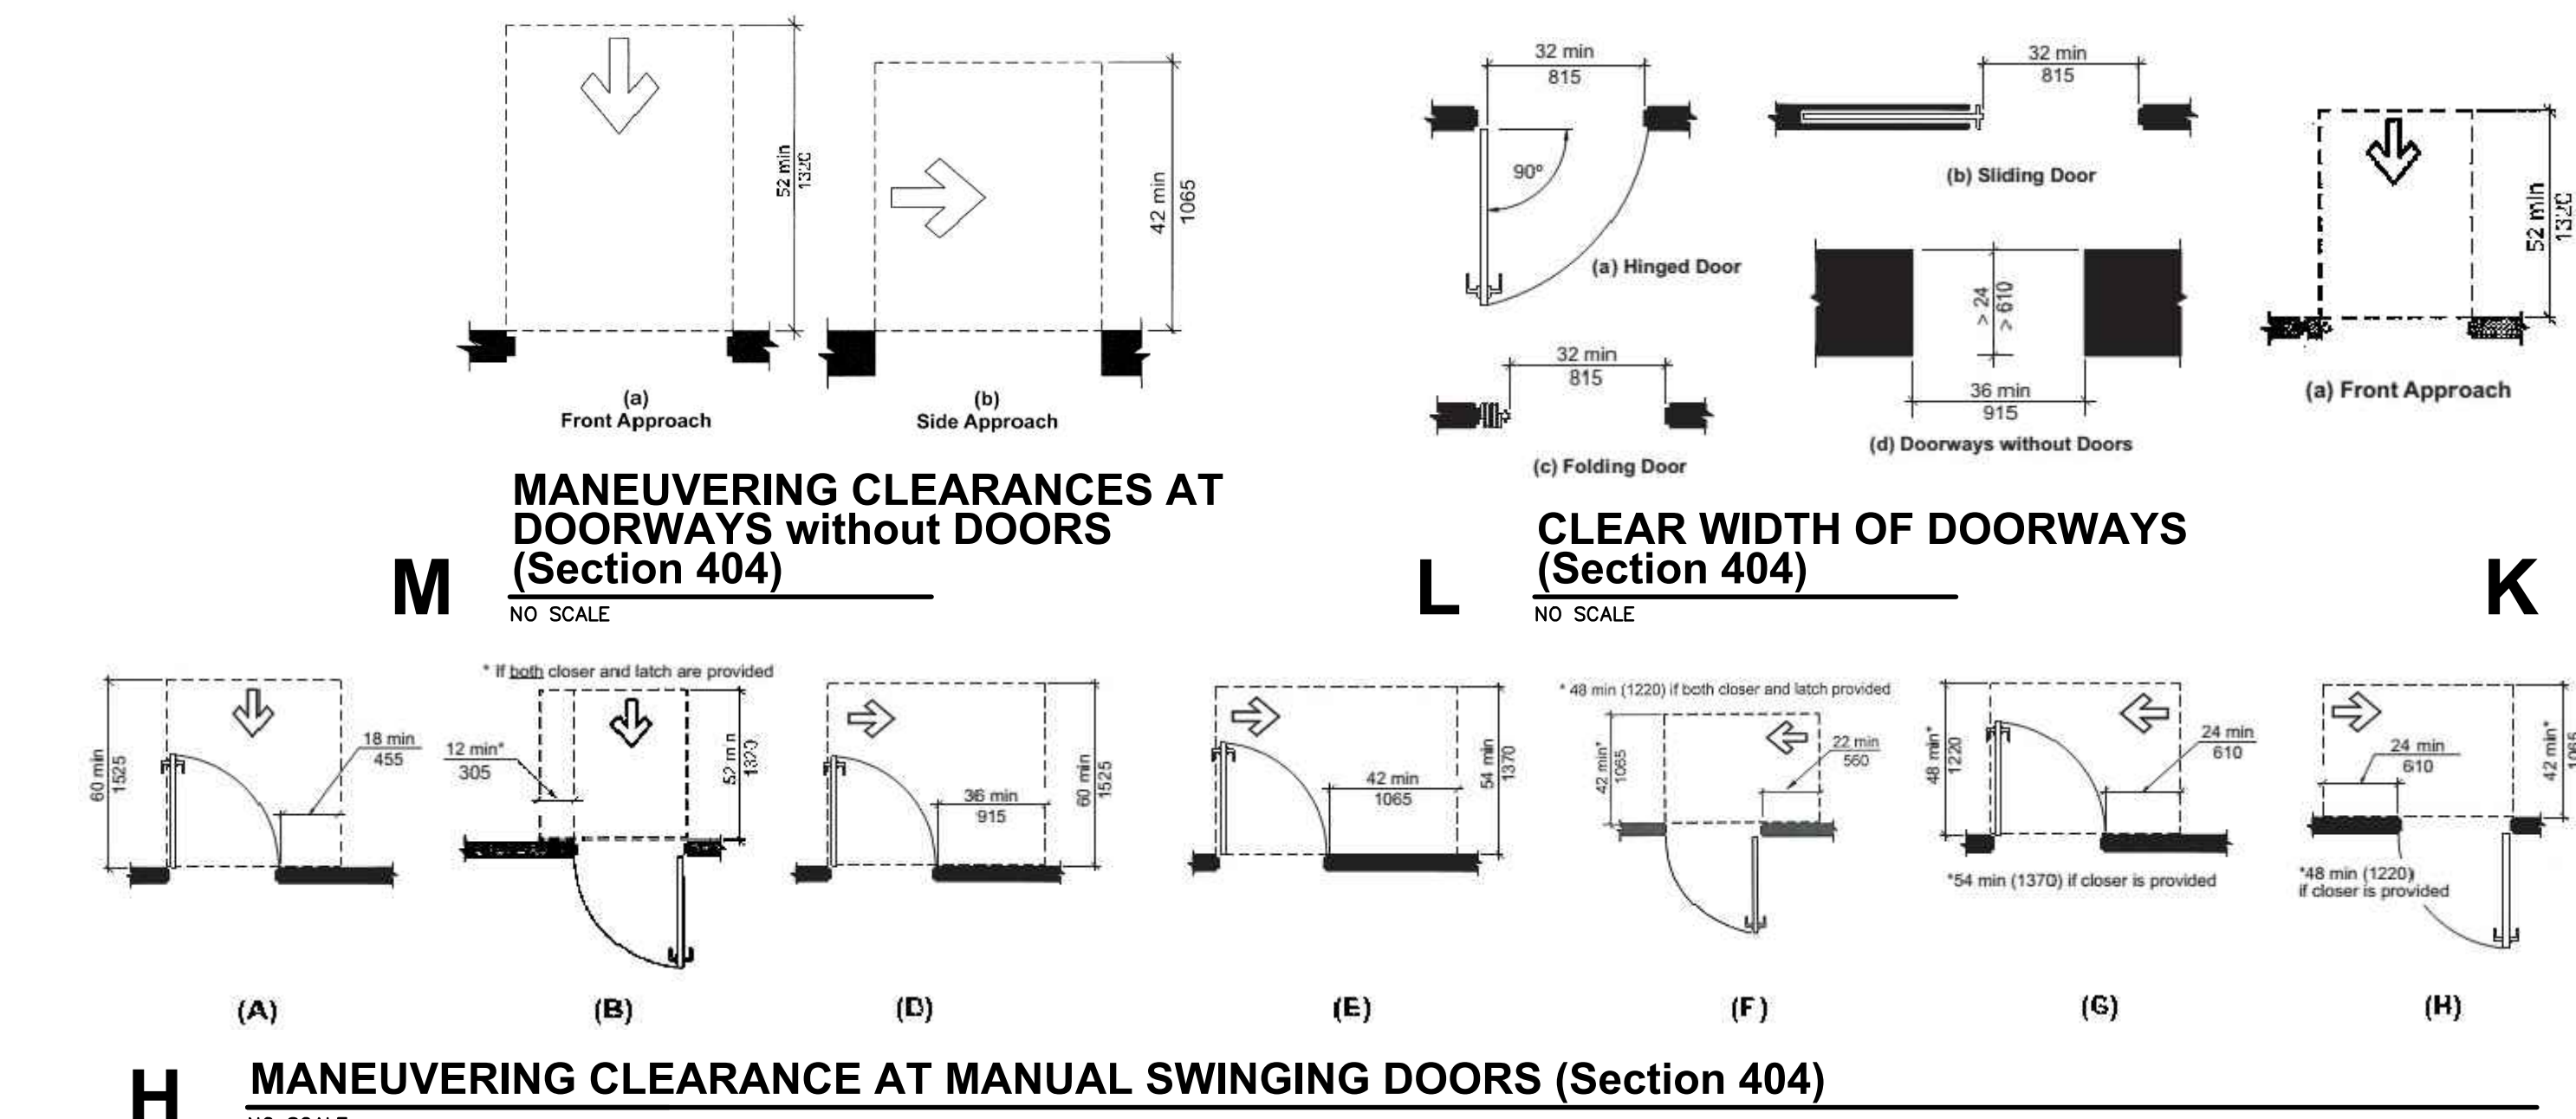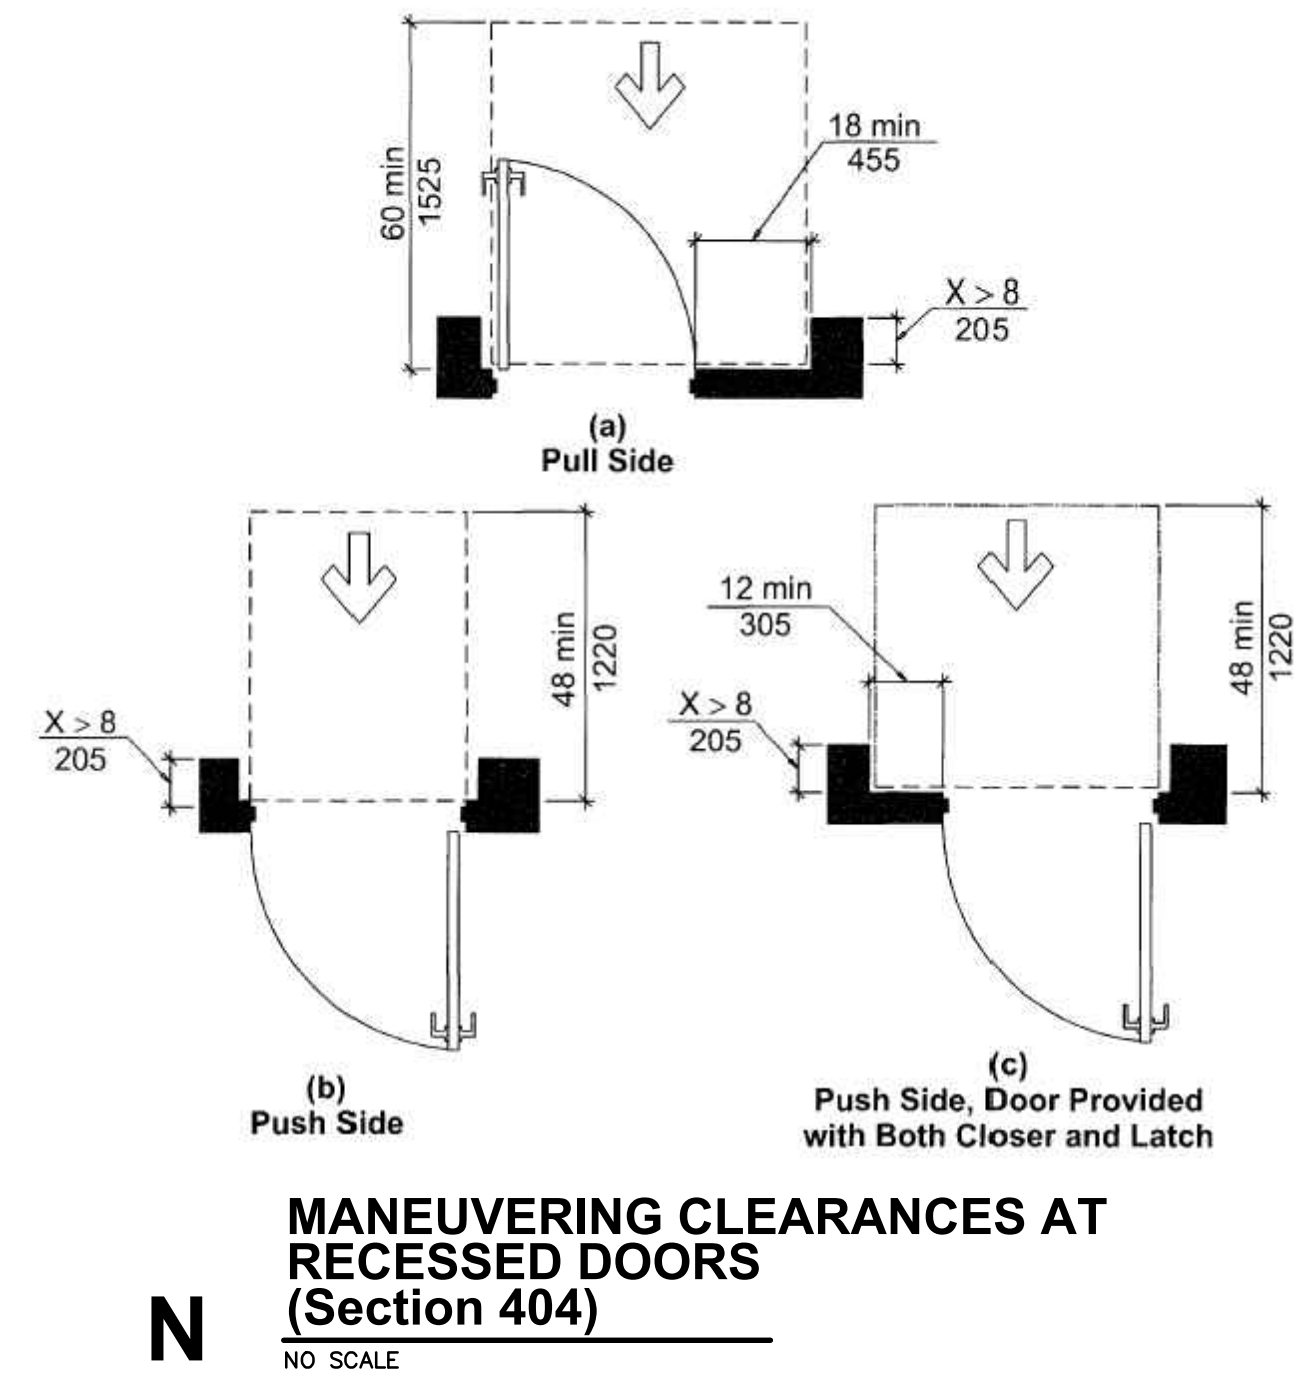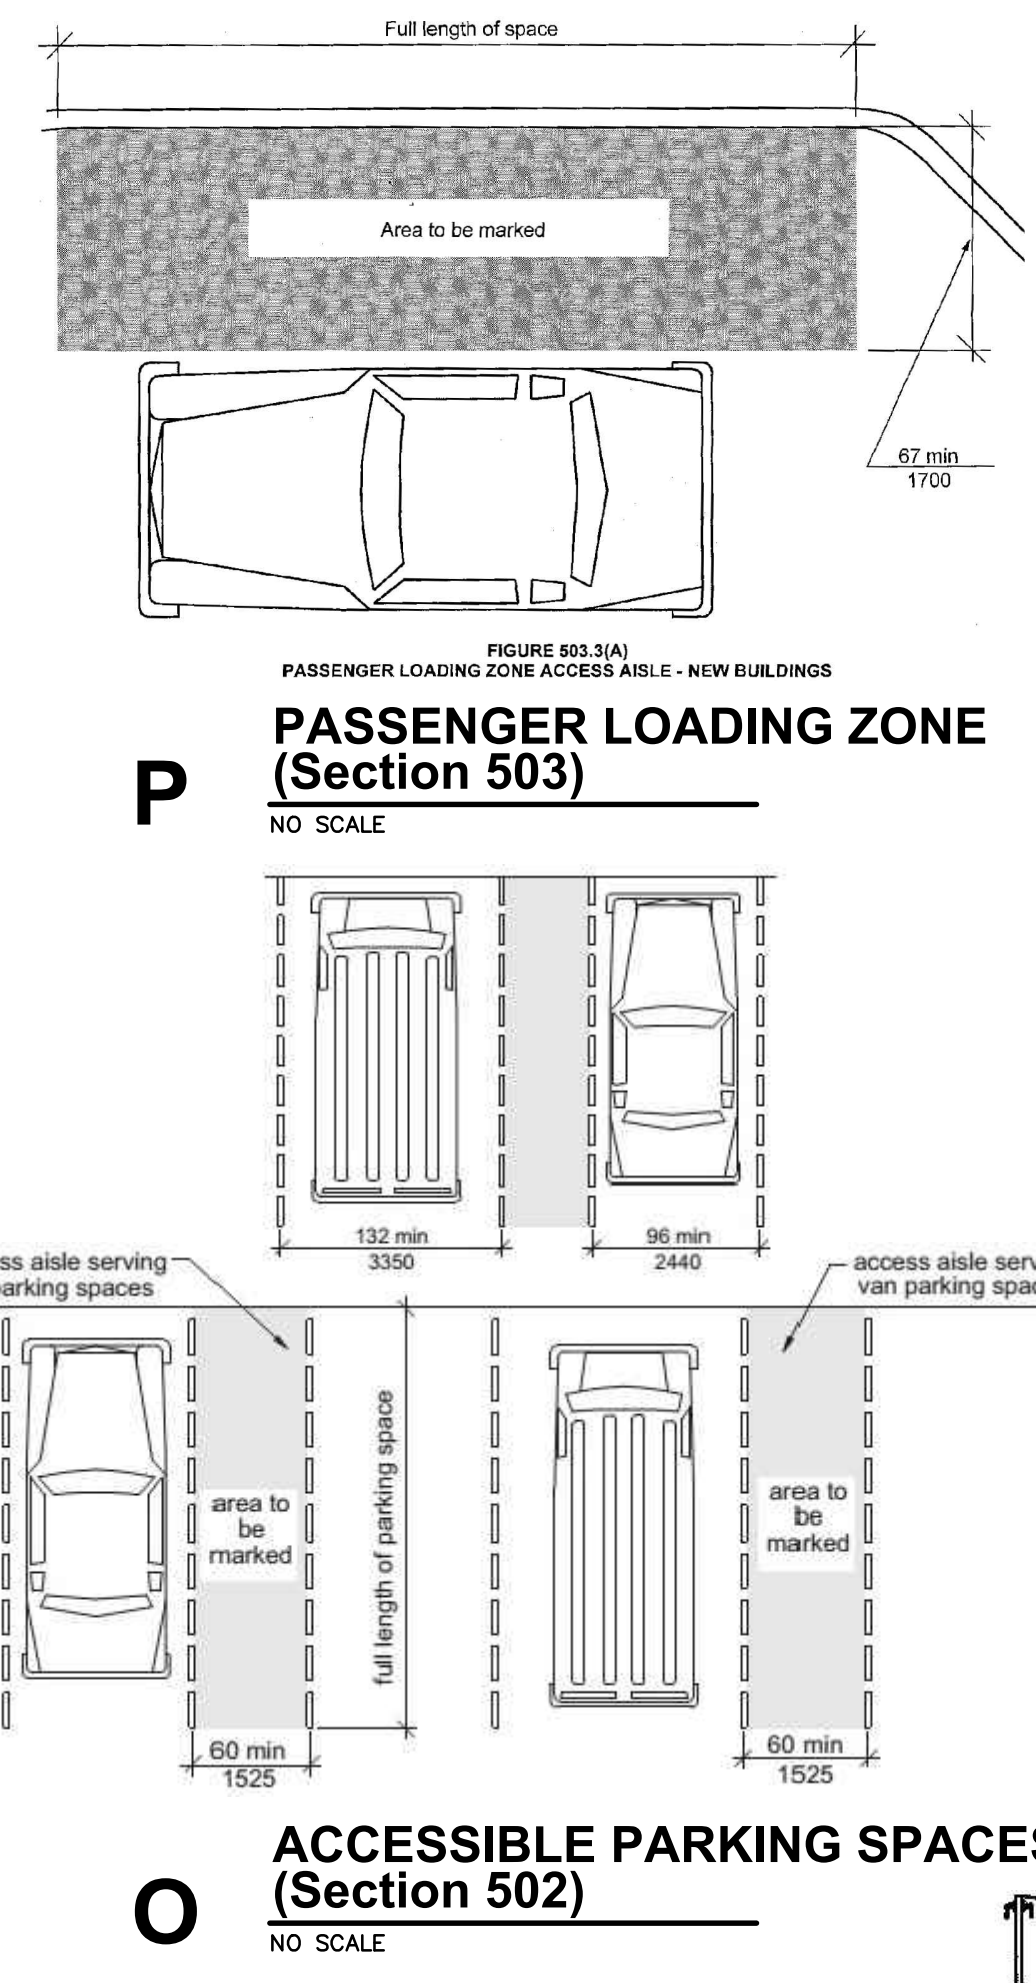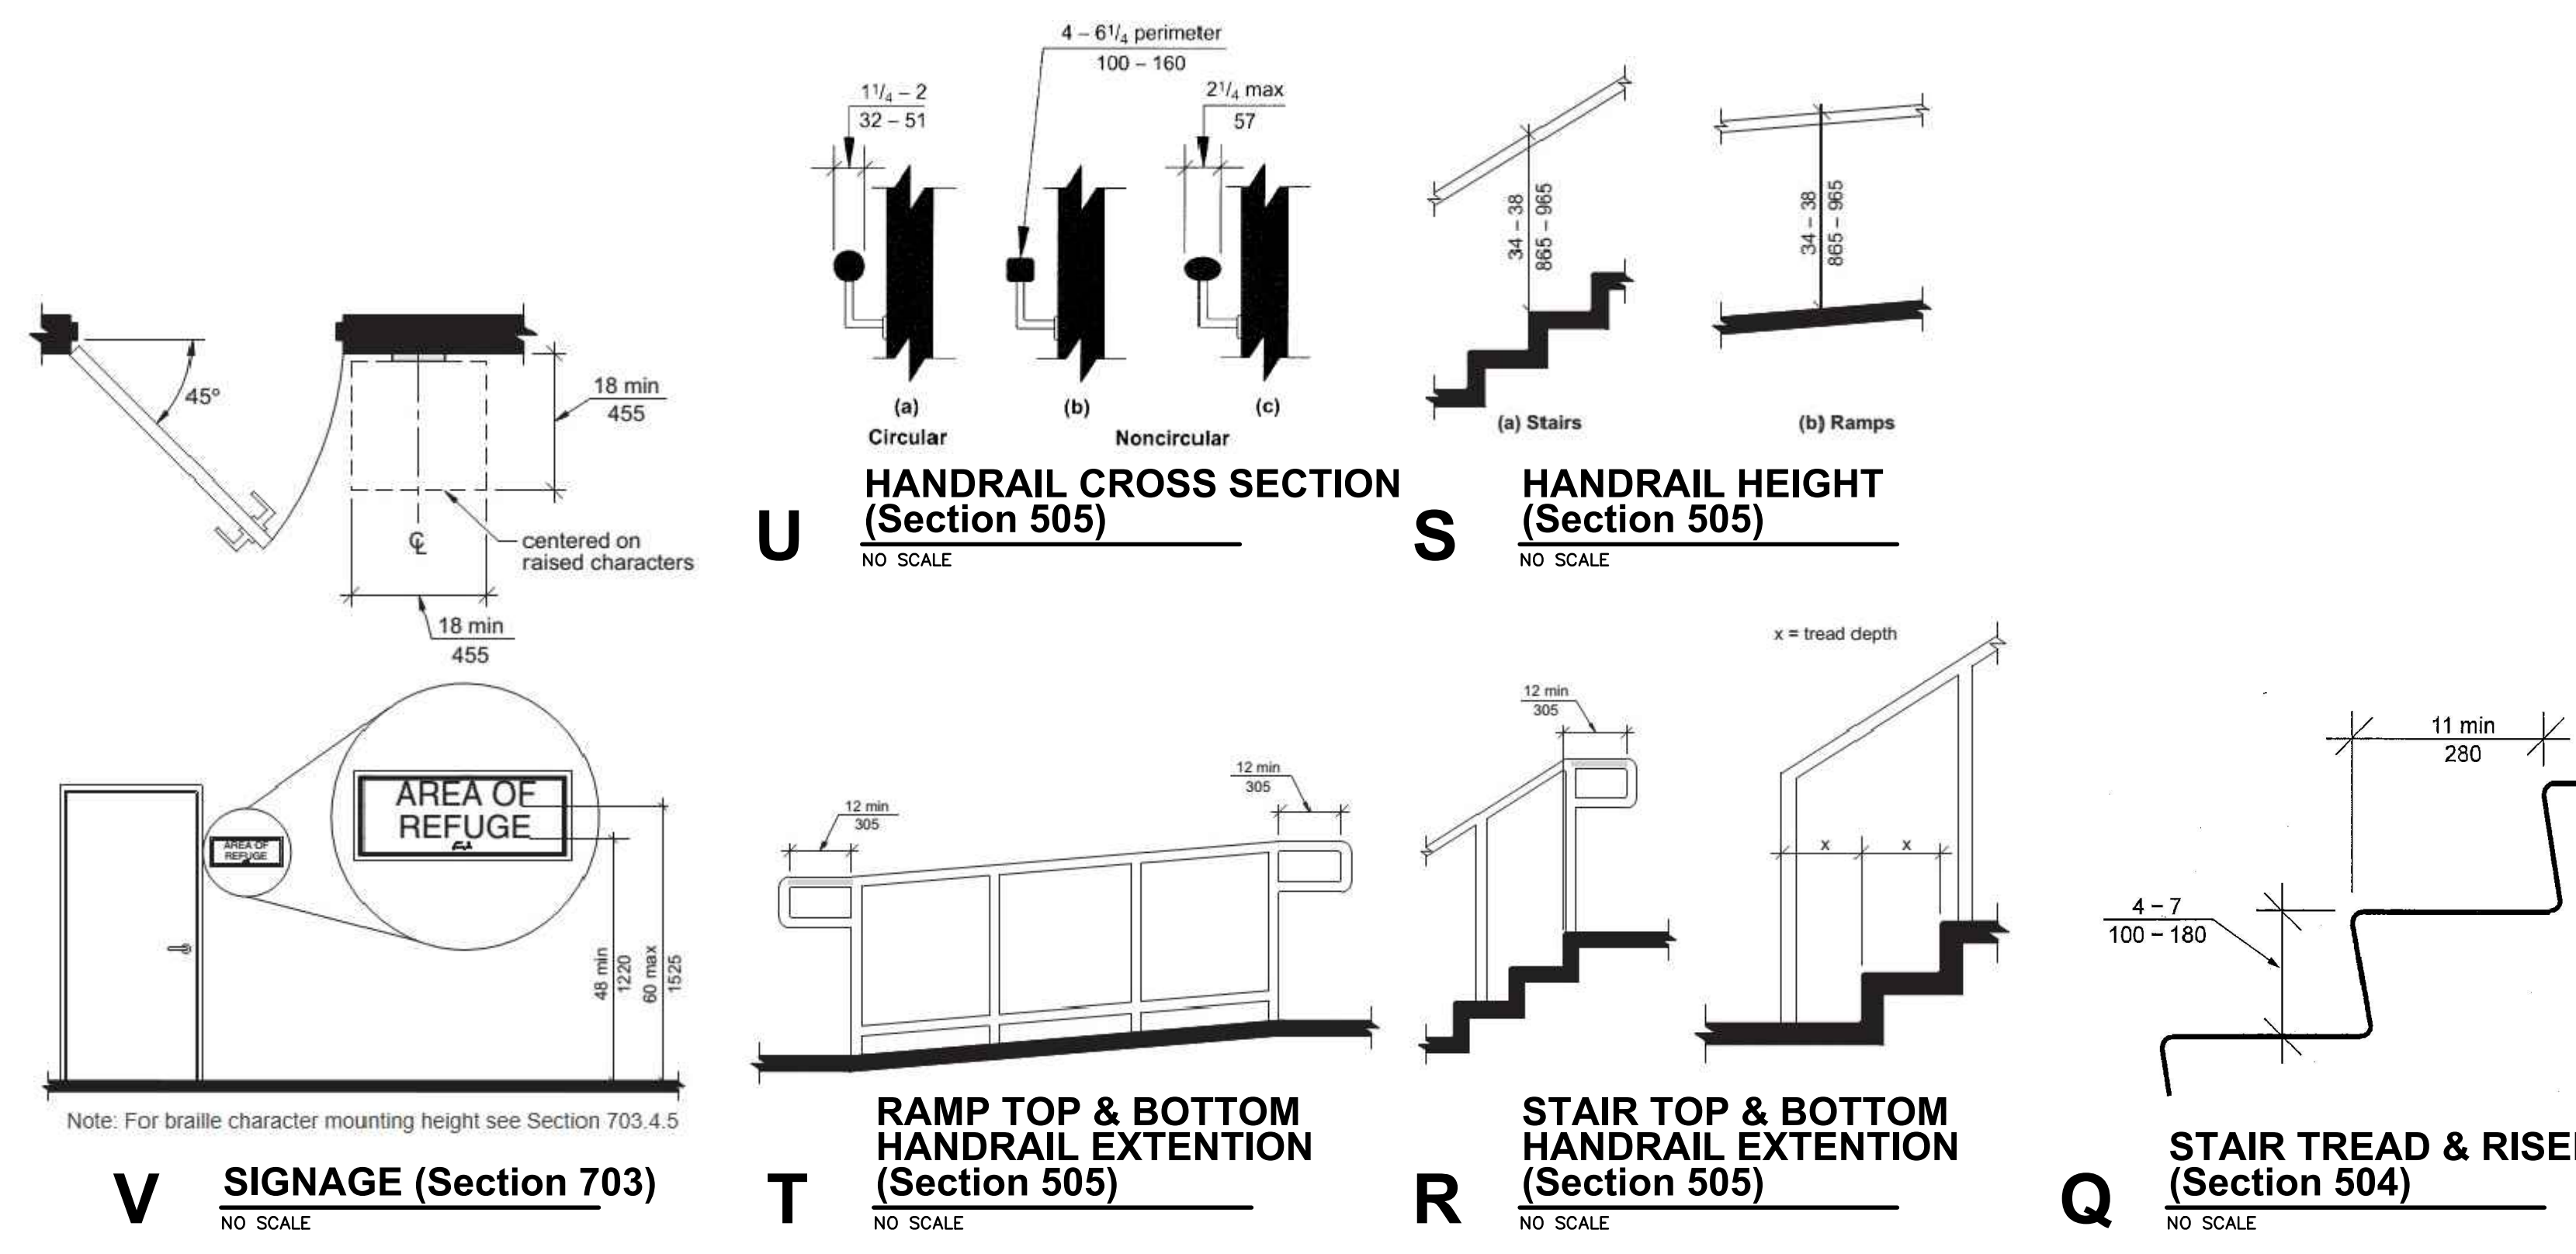


THIS SHEET IS FOR INFORMATIONAL PURPOSES ONLY & CONTAINS KEY ILLUSTRATIONS OF ICC A117.1-2017, ACCESSIBLE and USEABLE BUILDINGS and FACILITIES, FOR MORE INFORMATION REFERENCE ENTIRE REQUIREMENTS.

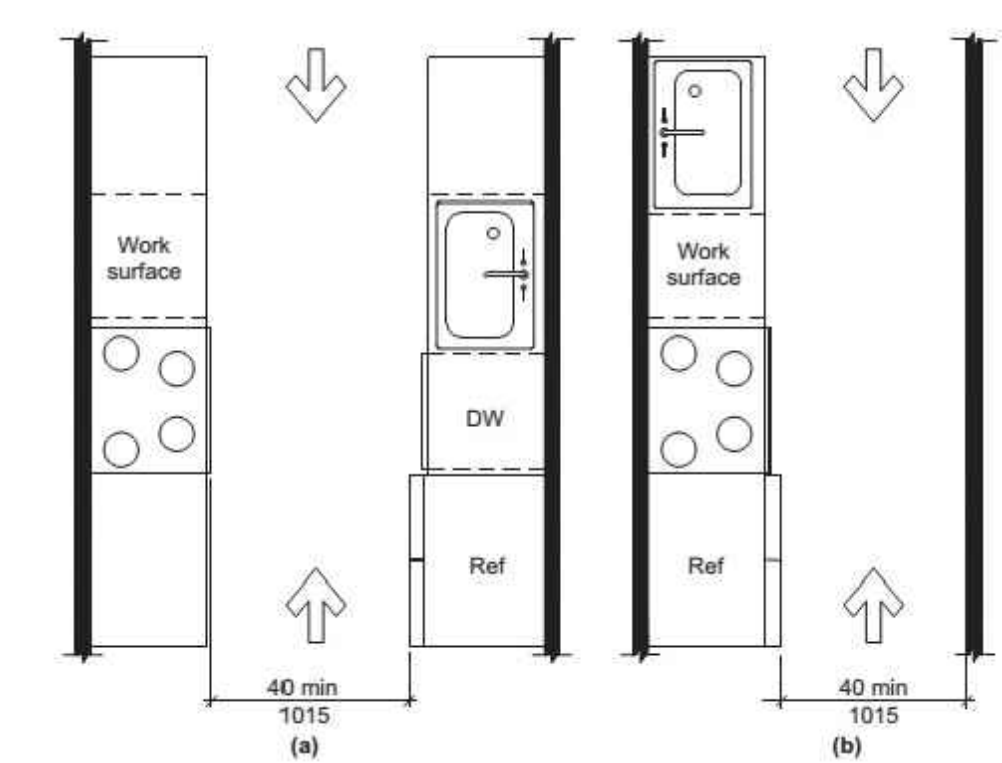


N PASS-THRU KITCHEN CLEARANCE
(Section 804)
NO SCALE

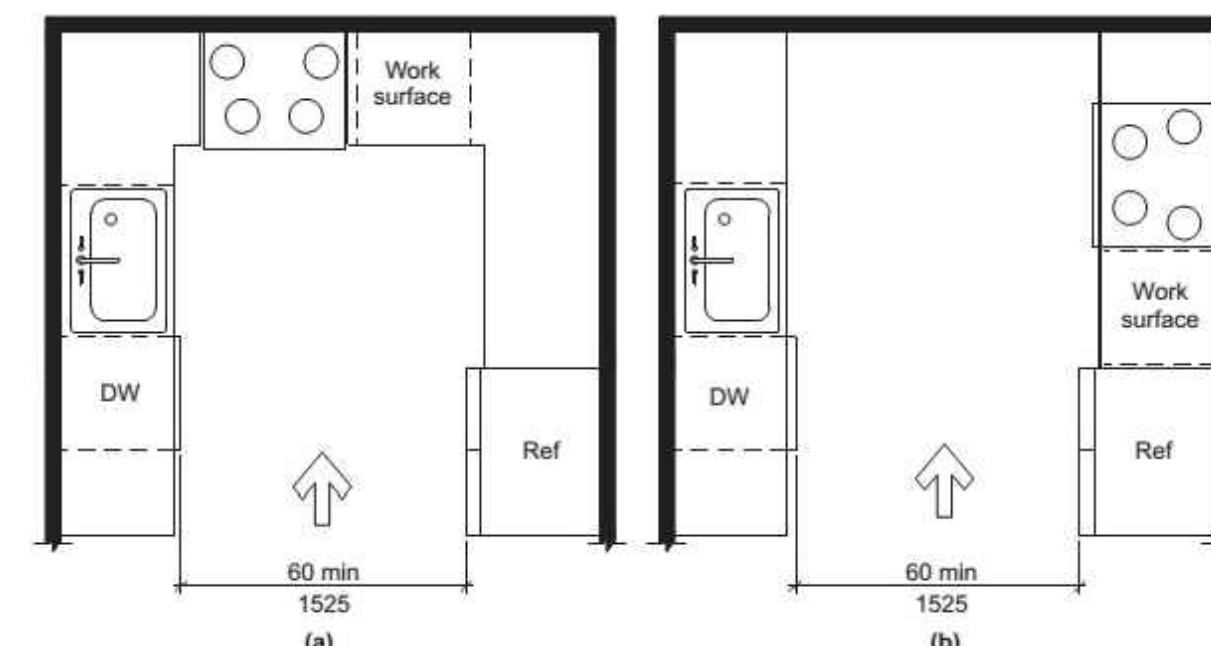


M U-SHAPED KITCHEN CLEARANCE
(Section 804)
NO SCALE

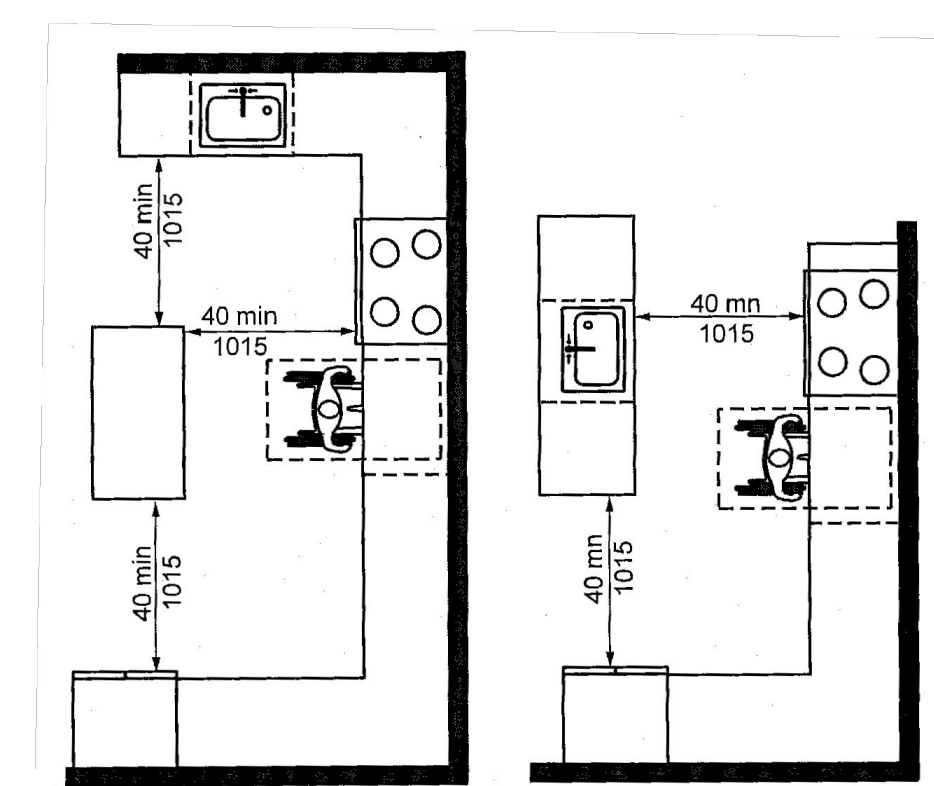


L U-SHAPED KITCHEN CLEARANCE
EXCEPTION (Section 804)
NO SCALE

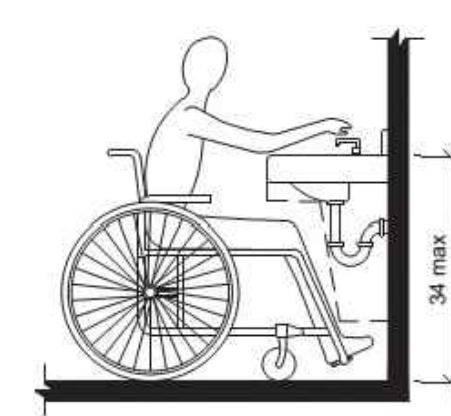


F HEIGHT OF
LAVATORIES & SINKS
(Section 606)
NO SCALE

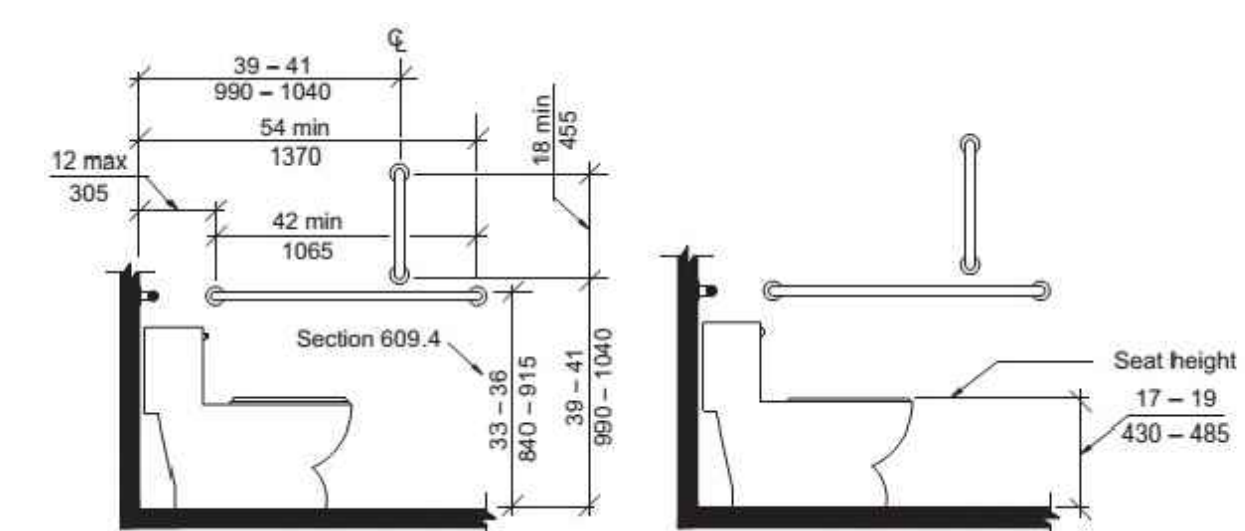


E WATER CLOSET HEIGHT
& SIDE WALL GRAB BAR
(Section 604)
NO SCALE

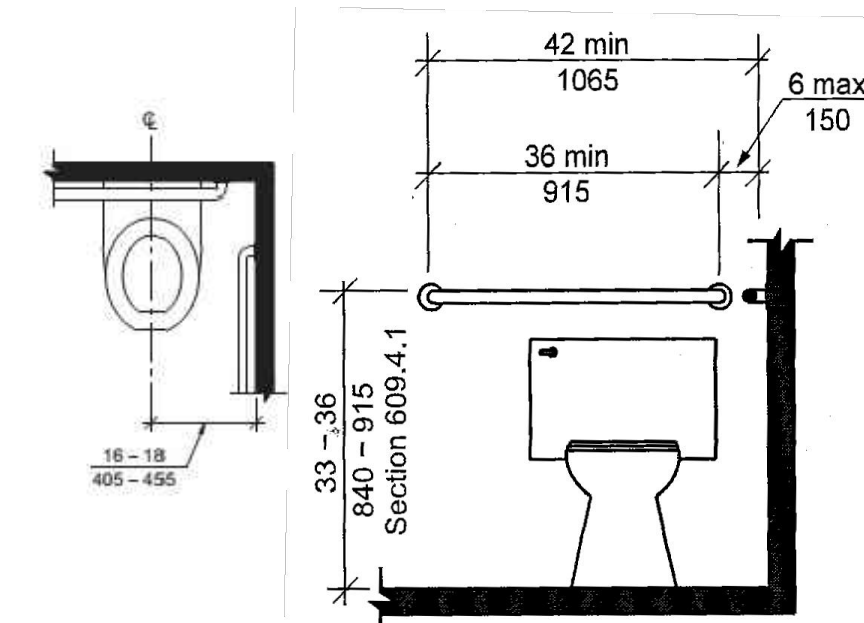


D WATER CLOSET LOCATION
& REAR WALL GRAB BAR
(Section 604)
NO SCALE

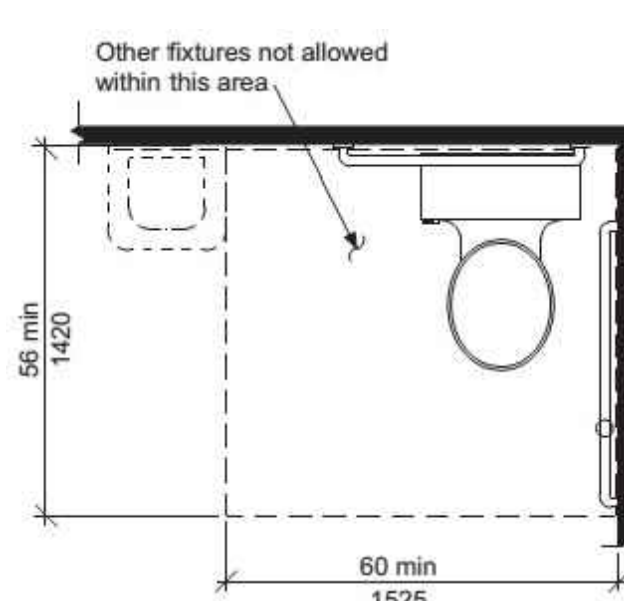


C CLEARANCES AT
WATER CLOSET
(Section 604)
NO SCALE

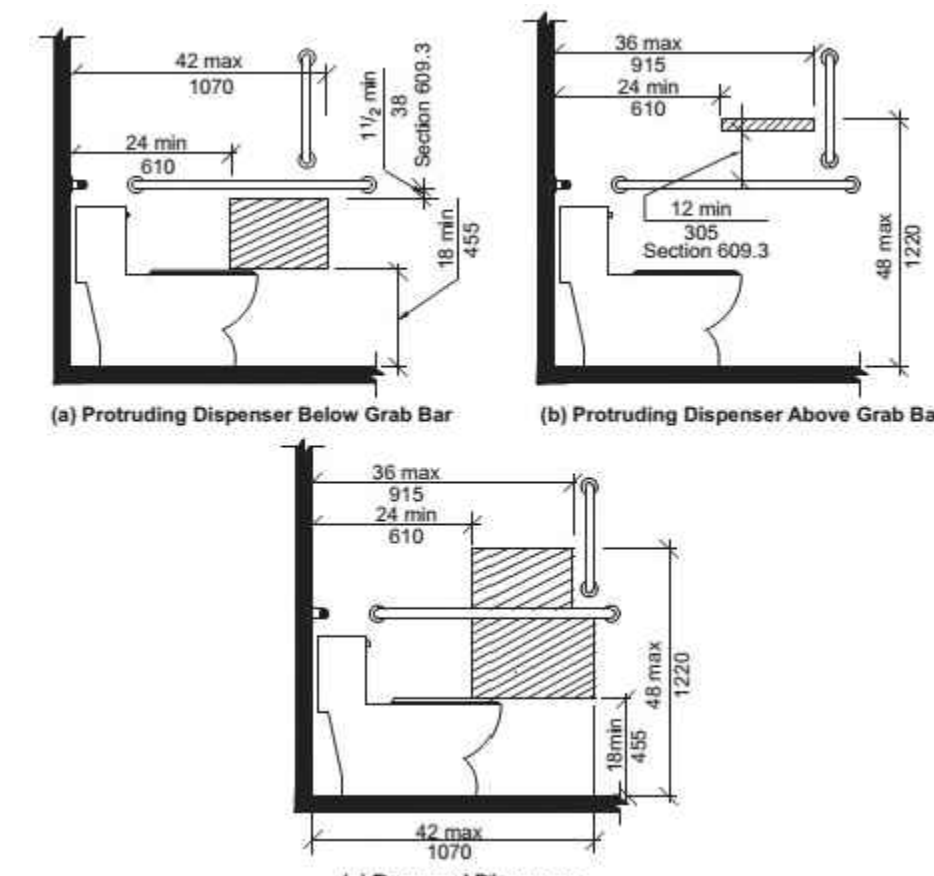


B DISPENSER OUTLET LOCATION
(Section 604)
NO SCALE

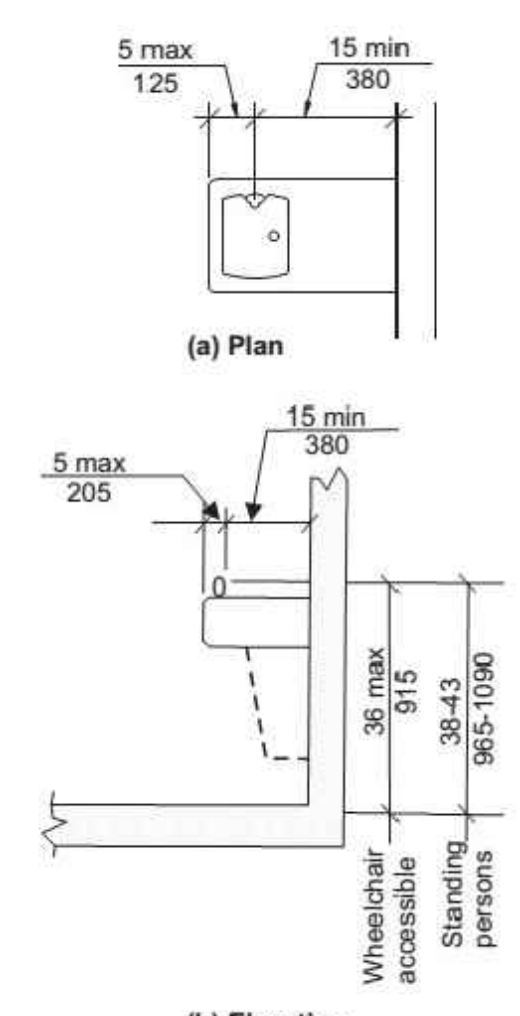


A DRINKING FOUNTAIN
(Section 602)
NO SCALE

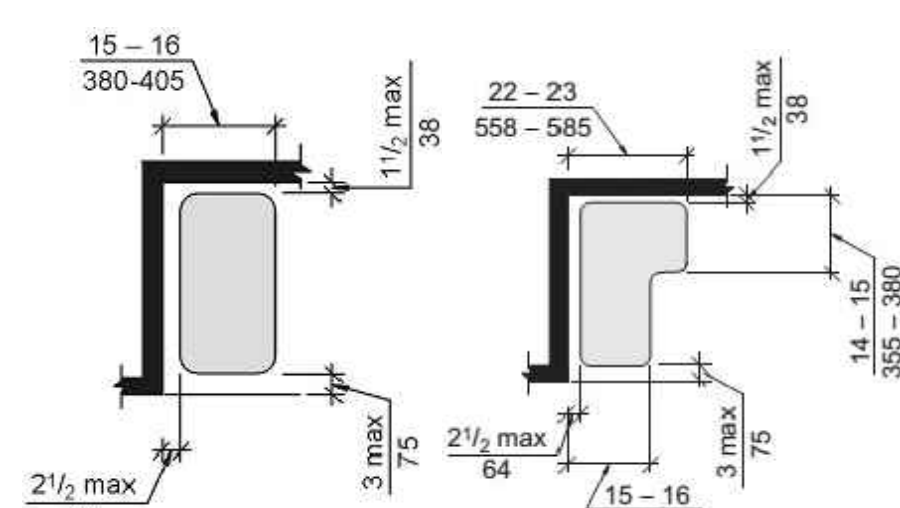


K SHOWER SEATS
(Section 610)
NO SCALE

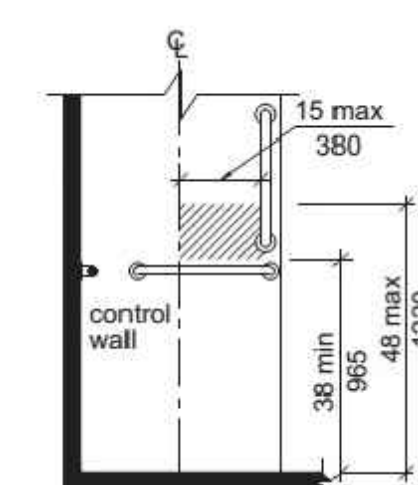

J TRANSFER SHOWER
CONTROLS LOCATION
(Section 608)
NO SCALE

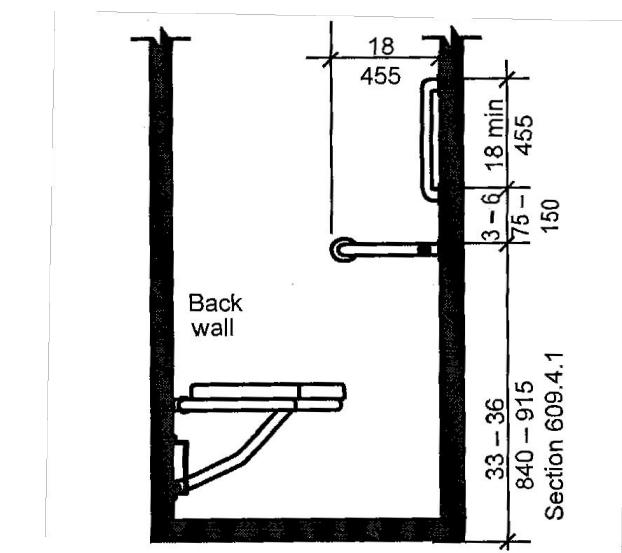


H TRANSFER SHOWER
GRAB BARS
(Section 608)
NO SCALE

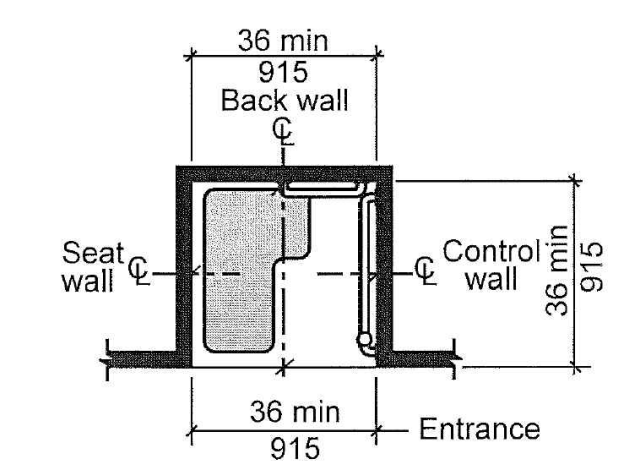


G EXISTING BUILDING
TRANSFER SHOWER
SIZE & CLEARANCE
(Section 608)
NO SCALE


THIS SHEET IS FOR INFORMATIONAL PURPOSES ONLY & CONTAINS
KEY ILLUSTRATIONS OF ICC A117.1-2017, ACCESSIBLE and
USEABLE BUILDINGS and FACILITIES, FOR MORE INFORMATION
REFERENCE ENTIRE REQUIREMENTS.

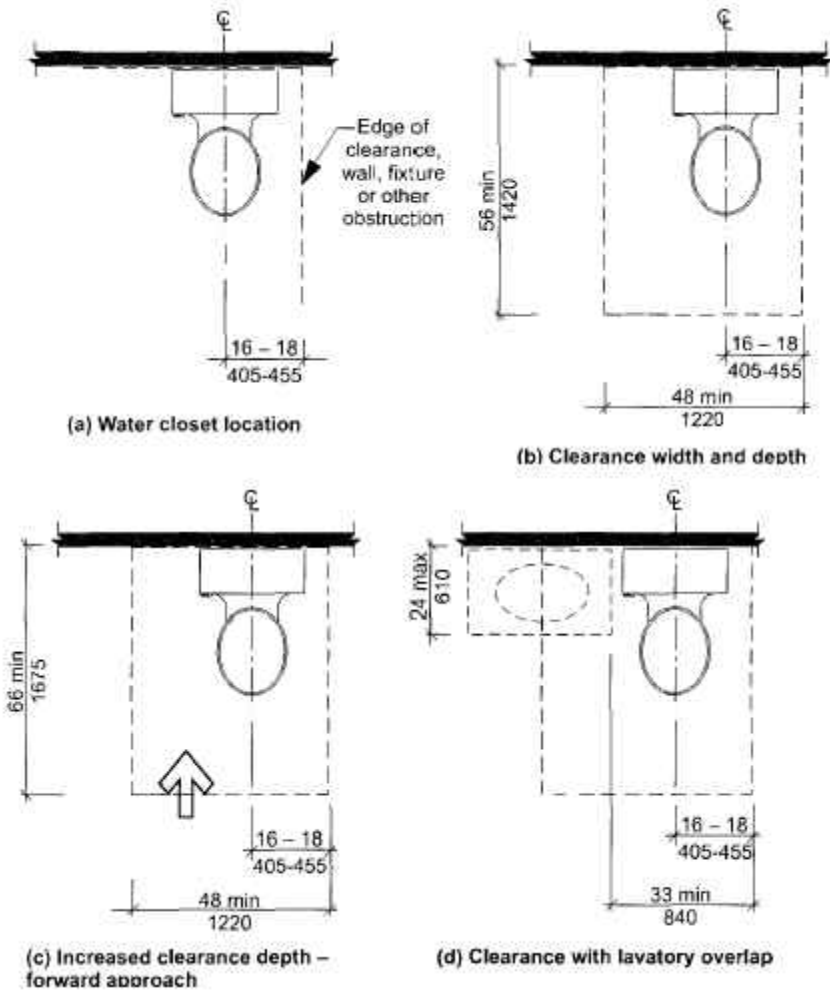




K **WATER CLOSET CLEARANCES**
TYPE B UNITS
(Section 1104)
NO SCALE

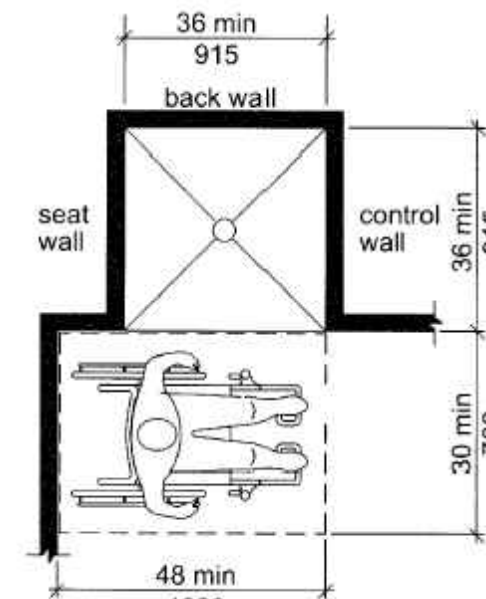


J **TRANSFER SHOWER**
AT TYPE B UNITS
(Section 1104)
NO SCALE

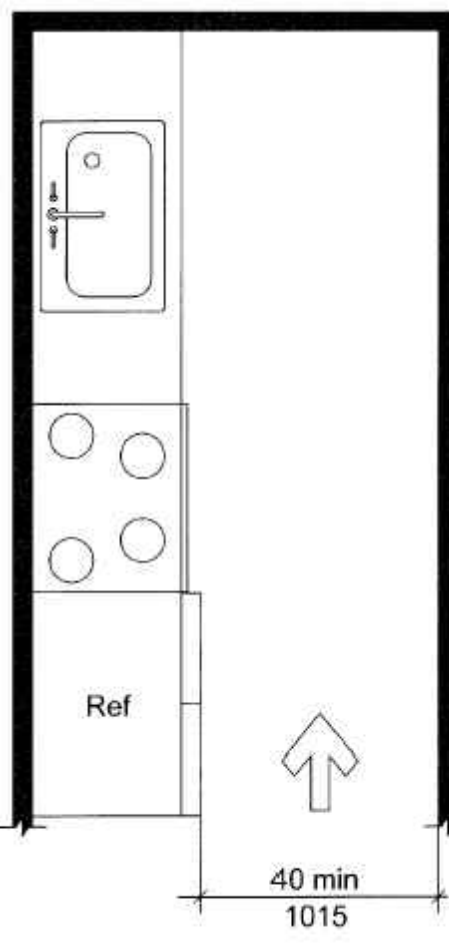


H **MIN KITCHEN CLEARANCE - TYPE B UNITS**
(Section 1104)
NO SCALE

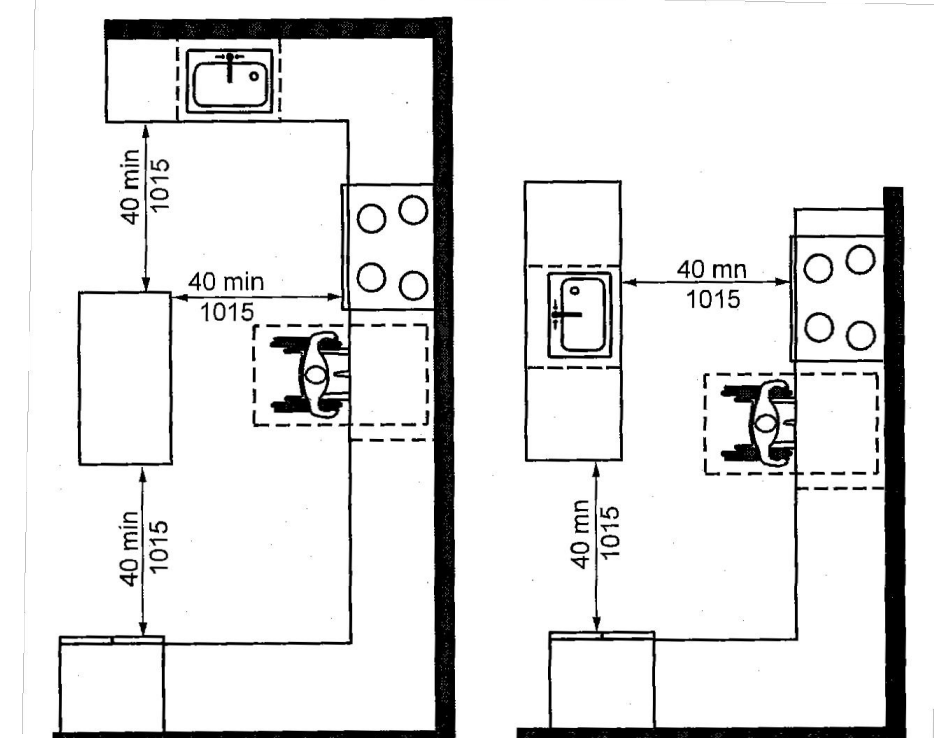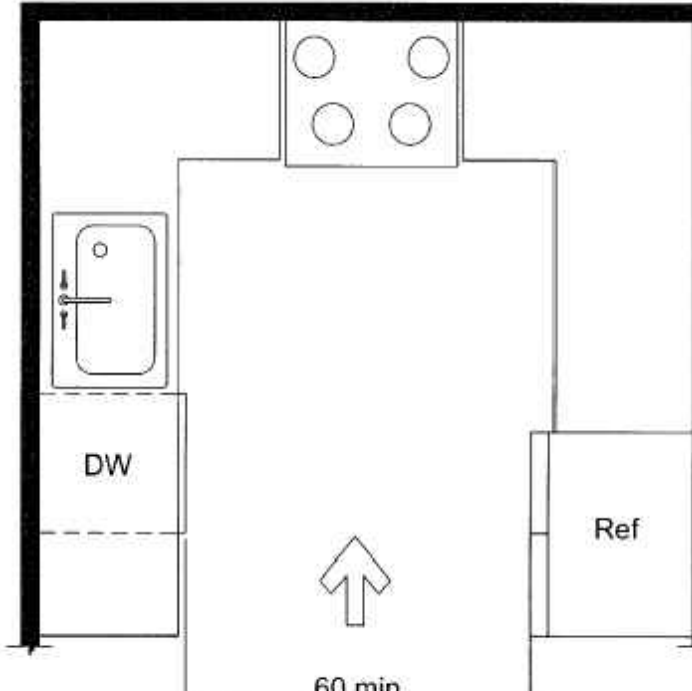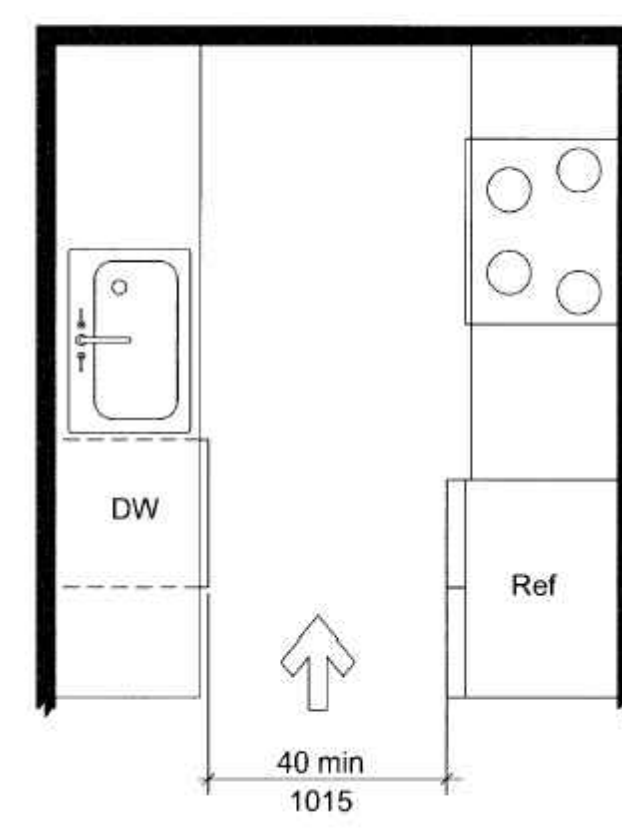


G **U-SHAPED KITCHEN CLEARANCE**
-TYPE B UNITS - EXCEPTION (Section 1104)
NO SCALE

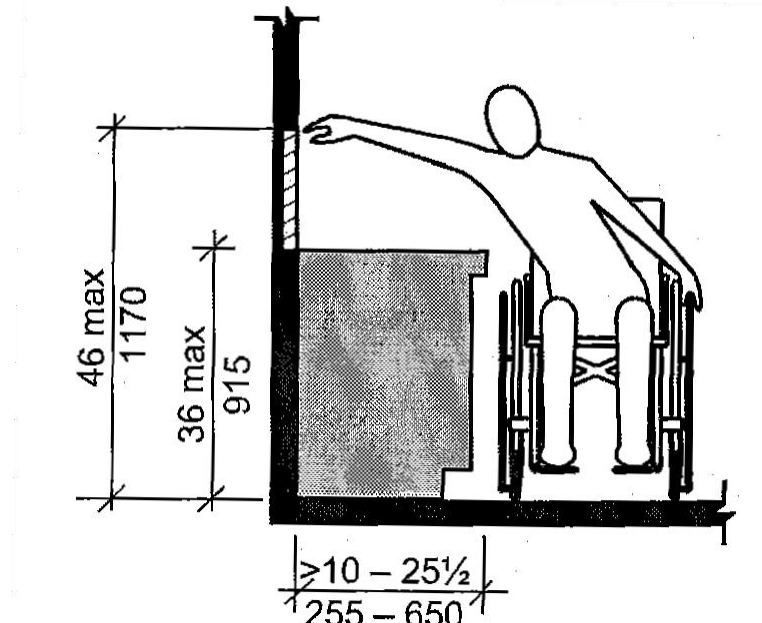


M **REACH RANGE OVER KITCHEN**
or BATH CABINET - TYPE B UNITS
(Section 1104)
NO SCALE

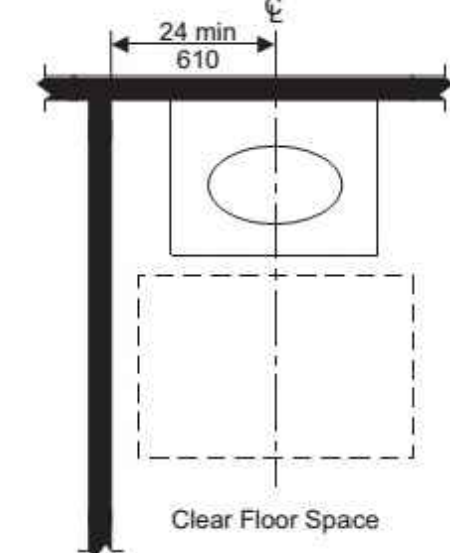


L **LAVATORY AT**
TYPE B UNITS - OPT A BATH
(Section 1104)
NO SCALE

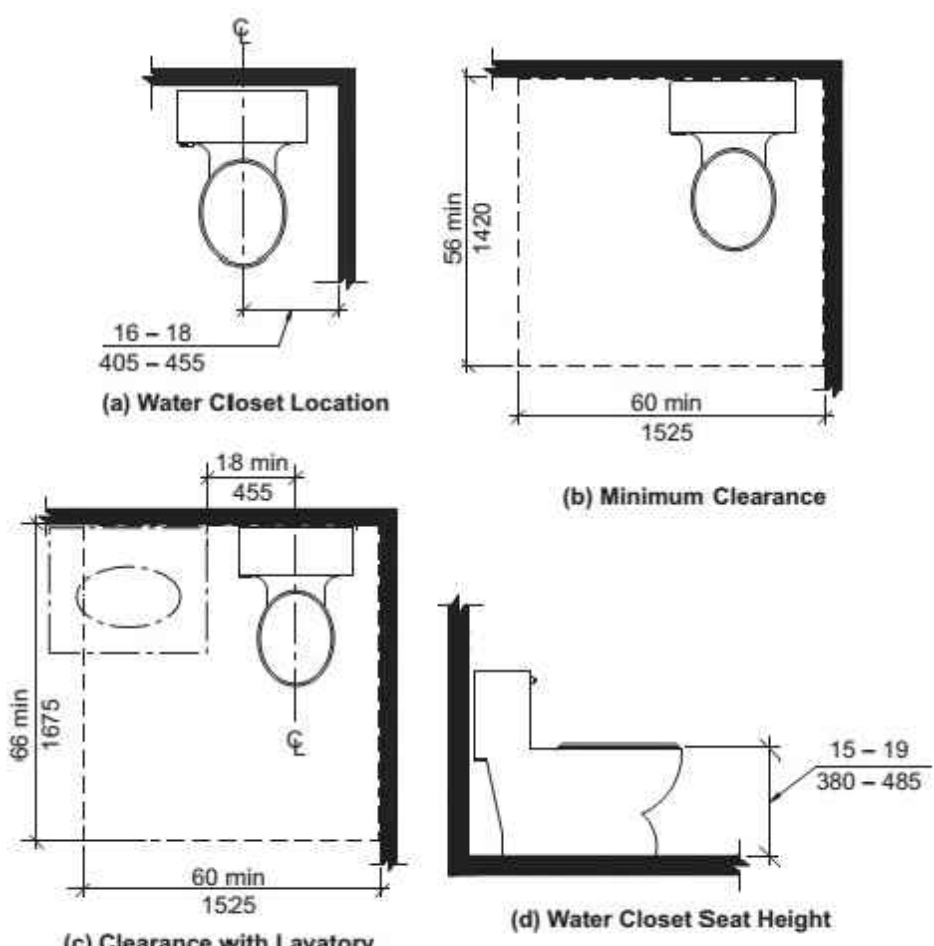


D **WATER CLOSET CLEARANCES**
TYPE A UNITS
(Section 1103)
NO SCALE

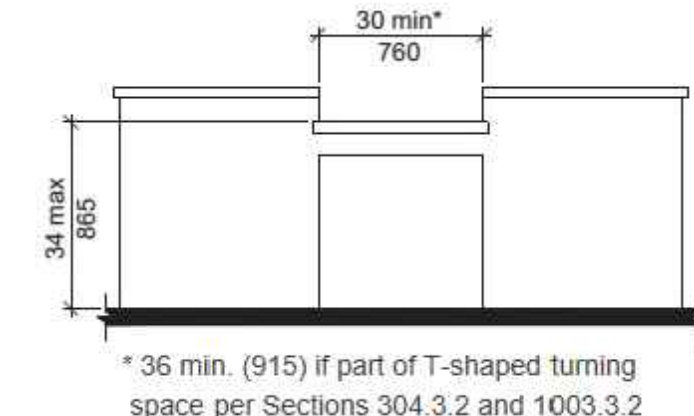

C **WORK SURFACE -**
TYPE A UNITS
(Section 1103)
NO SCALE

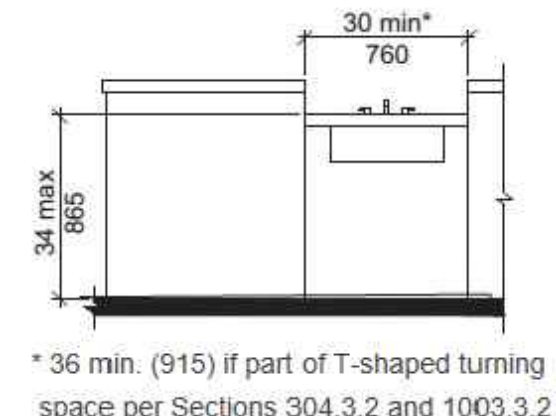


B **KITCHEN SINK -**
TYPE A UNITS
(Section 1103)
NO SCALE

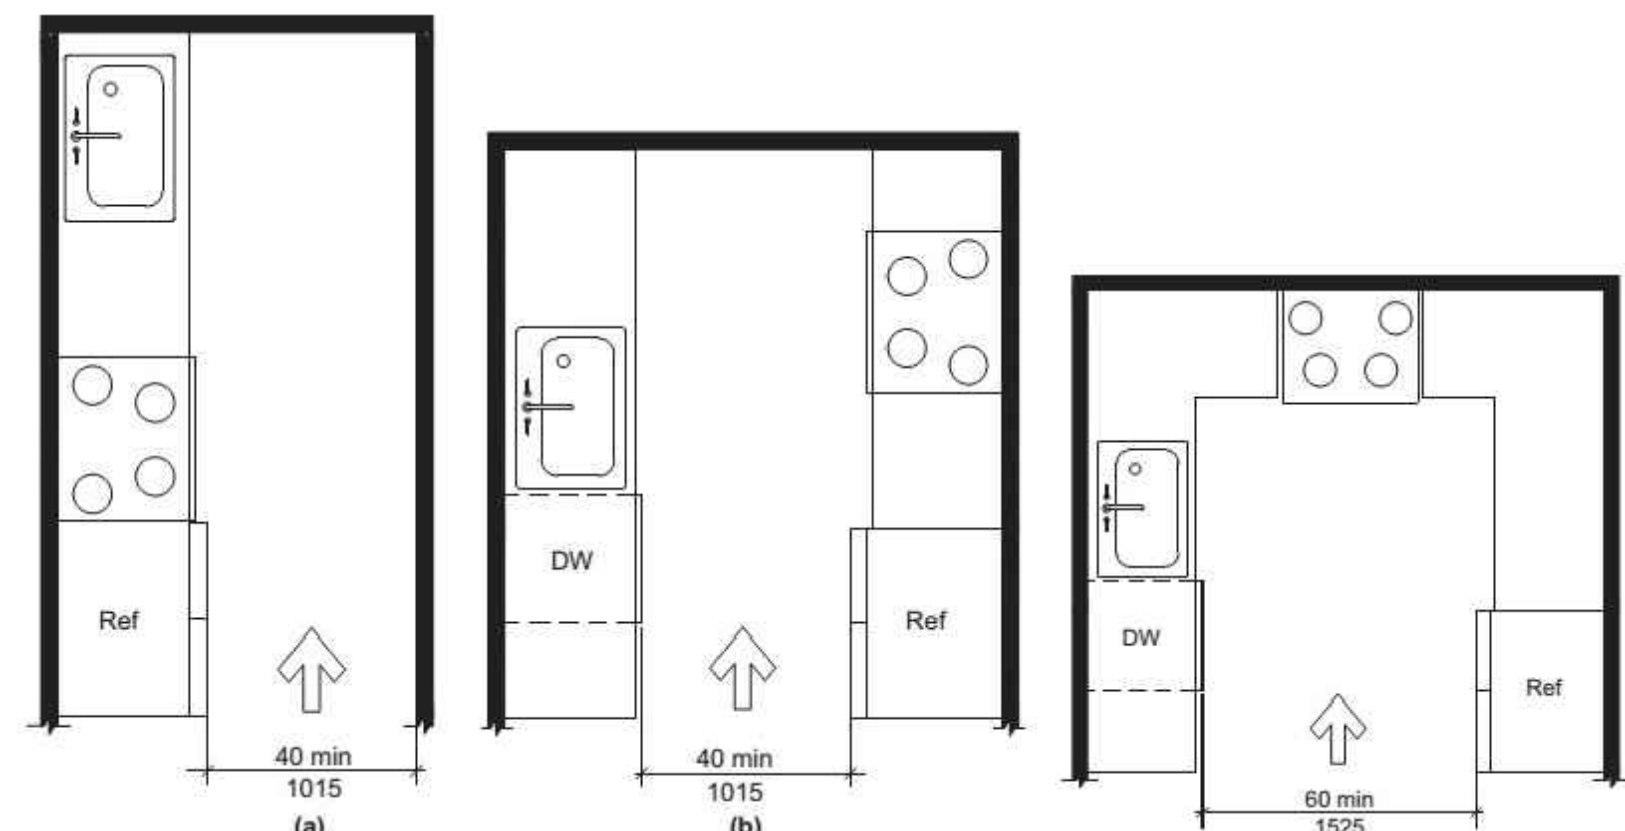

A **MIN KITCHEN CLEARANCE - TYPE A UNITS**
(Section 1103)
NO SCALE


THIS SHEET IS FOR INFORMATIONAL PURPOSES ONLY & CONTAINS
KEY ILLUSTRATIONS OF ICC A117.1-2017, ACCESSIBLE and
USEABLE BUILDINGS and FACILITIES, FOR MORE INFORMATION
REFERENCE ENTIRE REQUIREMENTS.

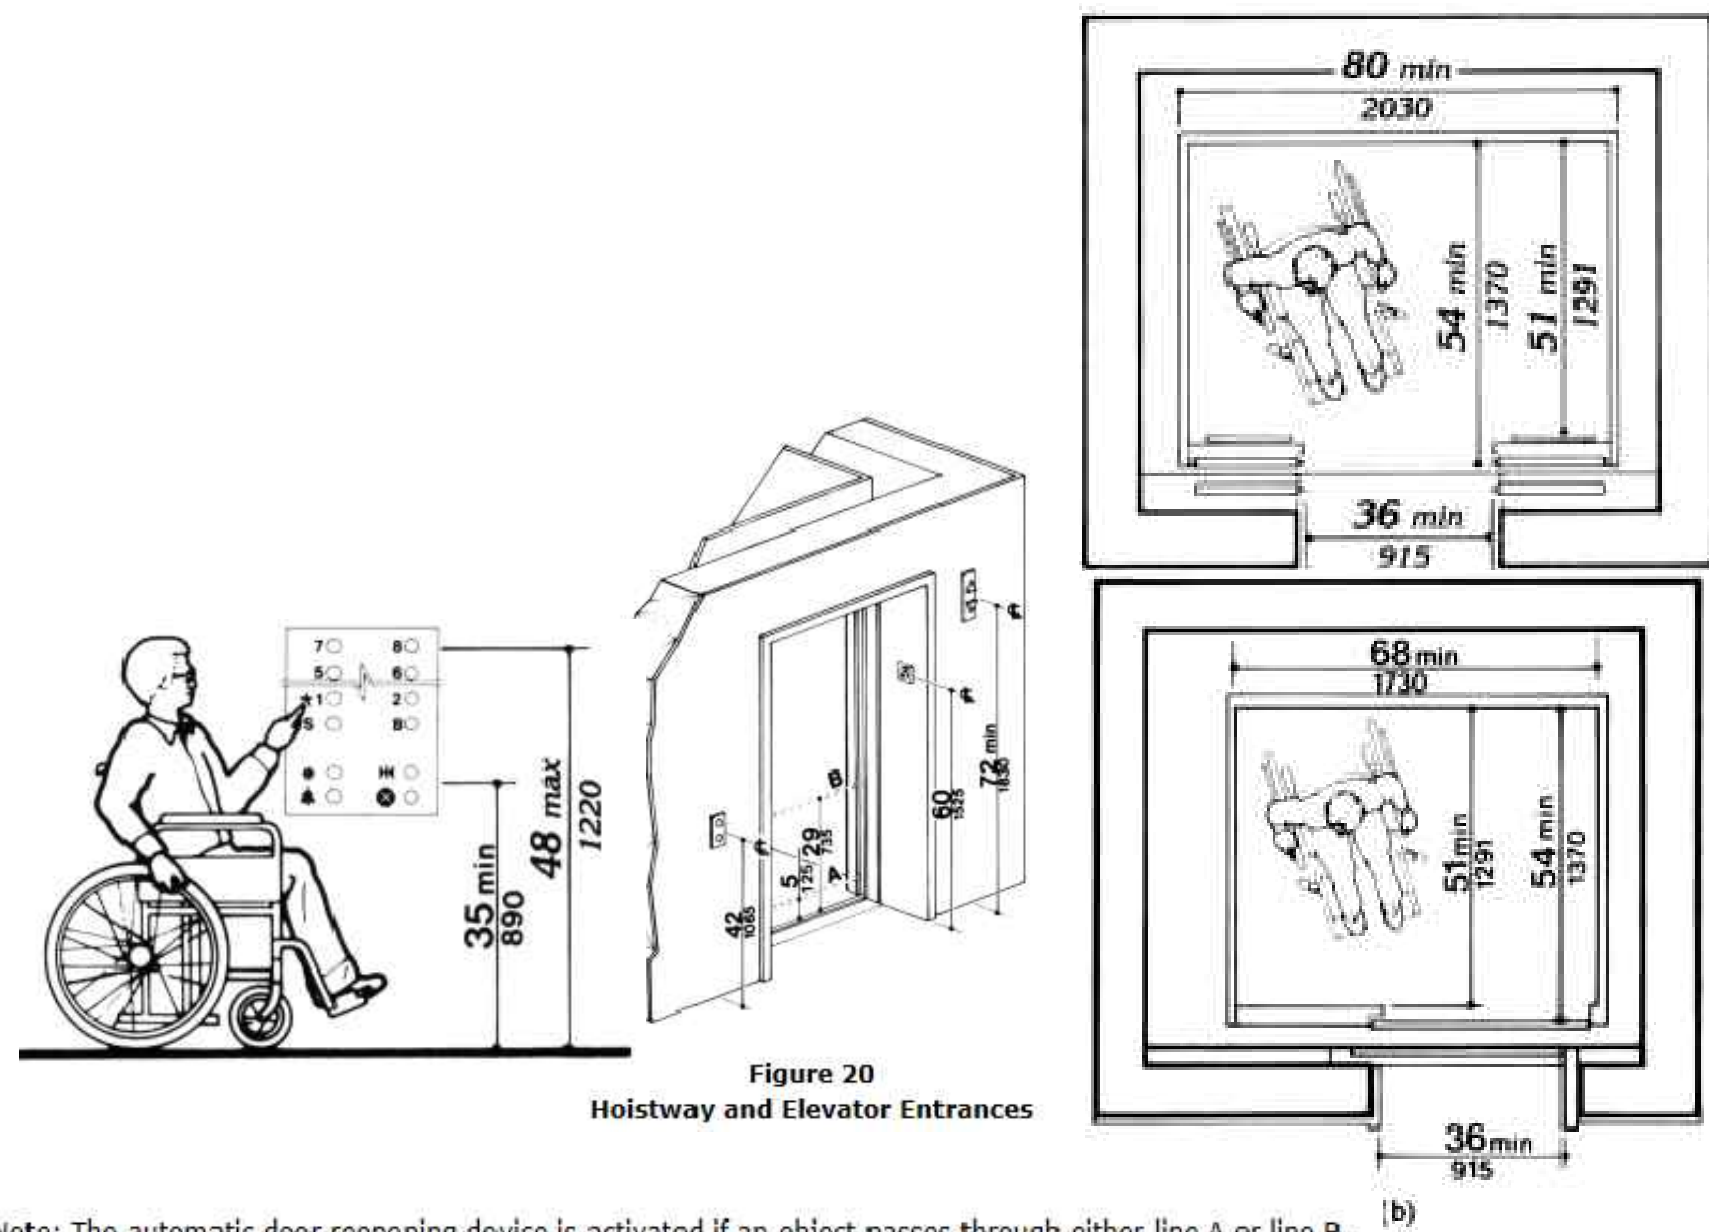

Note: The automatic door reopening device is activated if an object passes through either line A or line B. Line A and line B represent the vertical locations of the door reopening device not requiring contact.


F STANDARD UFAS ELEVATOR DETAILS

NO SCALE

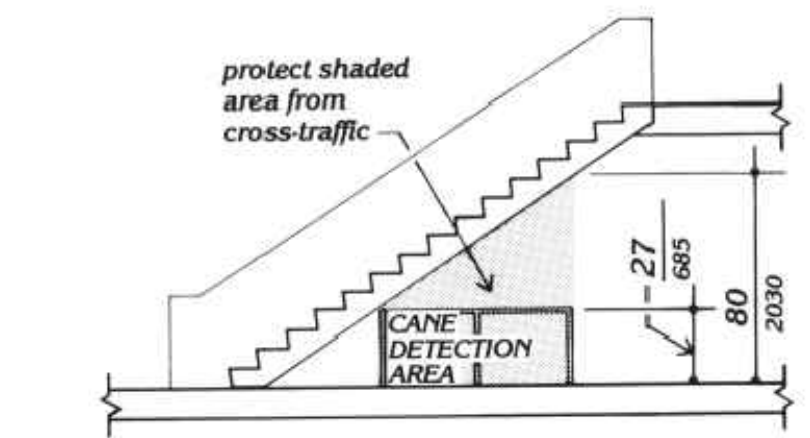


D GENERAL UFAS DIAGRAM

NO SCALE

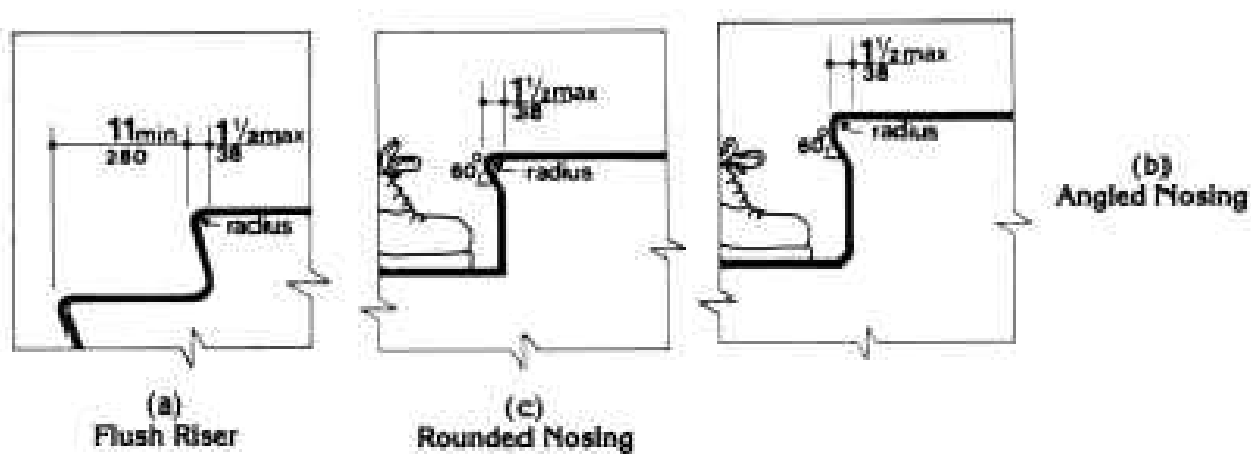

C STAIR NOSINGS


NO SCALE

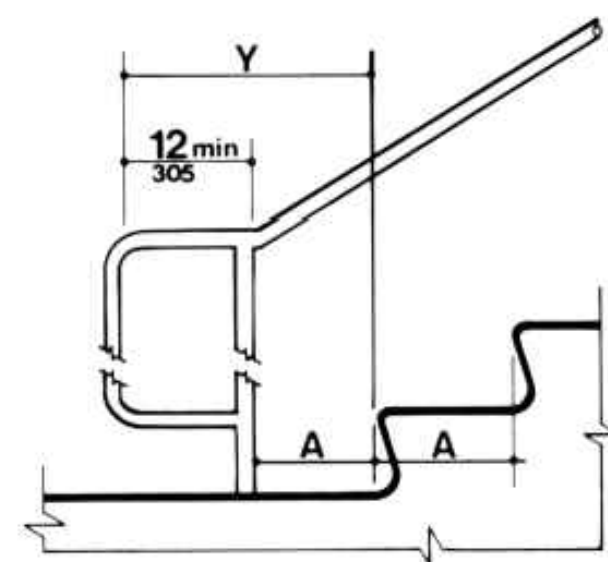

Note: X is the 12 in minimum handrail extension required at each top riser. Y is the minimum handrail extension of 12 in plus the width of one tread that is required at each bottom riser.

E STANDARD UFAS HANDRAILS



NO SCALE

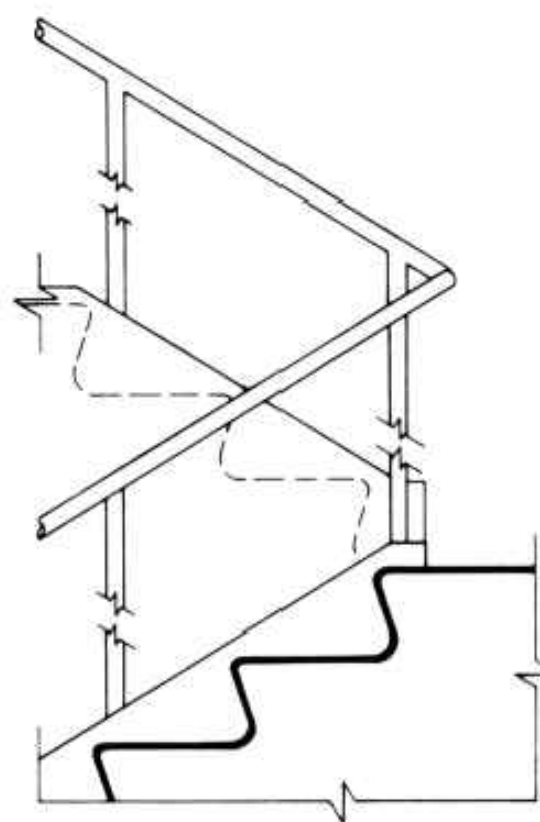

Note: X is the 12 in minimum handrail extension required at each top riser. Y is the minimum handrail extension of 12 in plus the width of one tread that is required at each bottom riser.

B UFAS CHANGE IN LEVEL DIAGRAM


NO SCALE

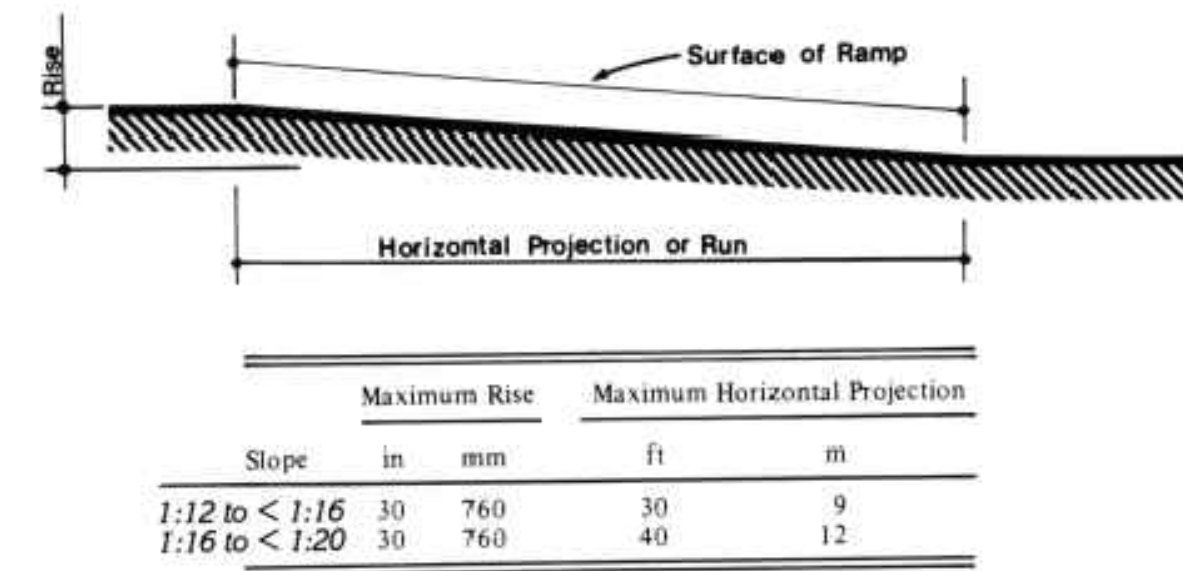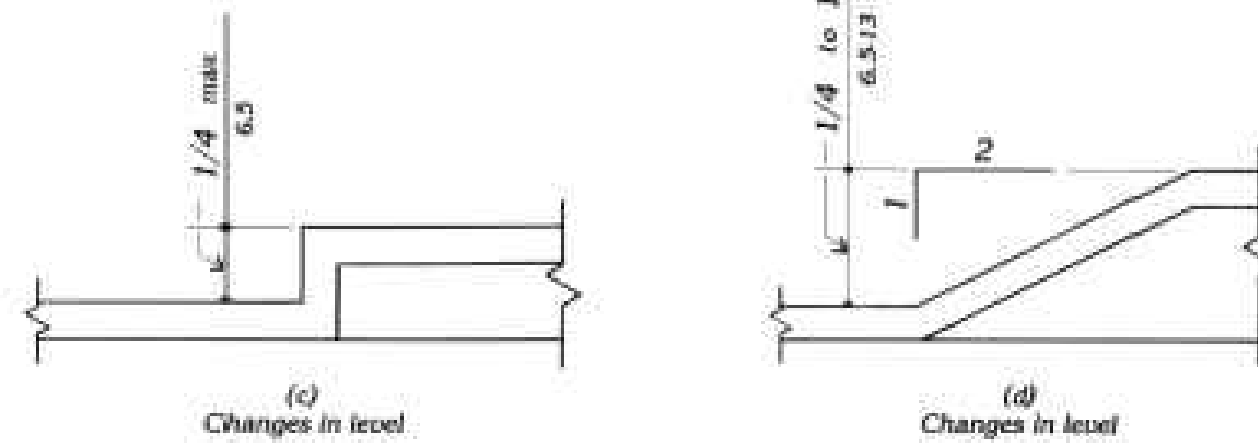

A SLOPE AND RISE

NO SCALE


SYMBOL KEY:
1. Countertop or wall-mounted oven.
2. Pull out board preferred with side-opening door.
3. Clear open space.
4. Bottom-hinged door.

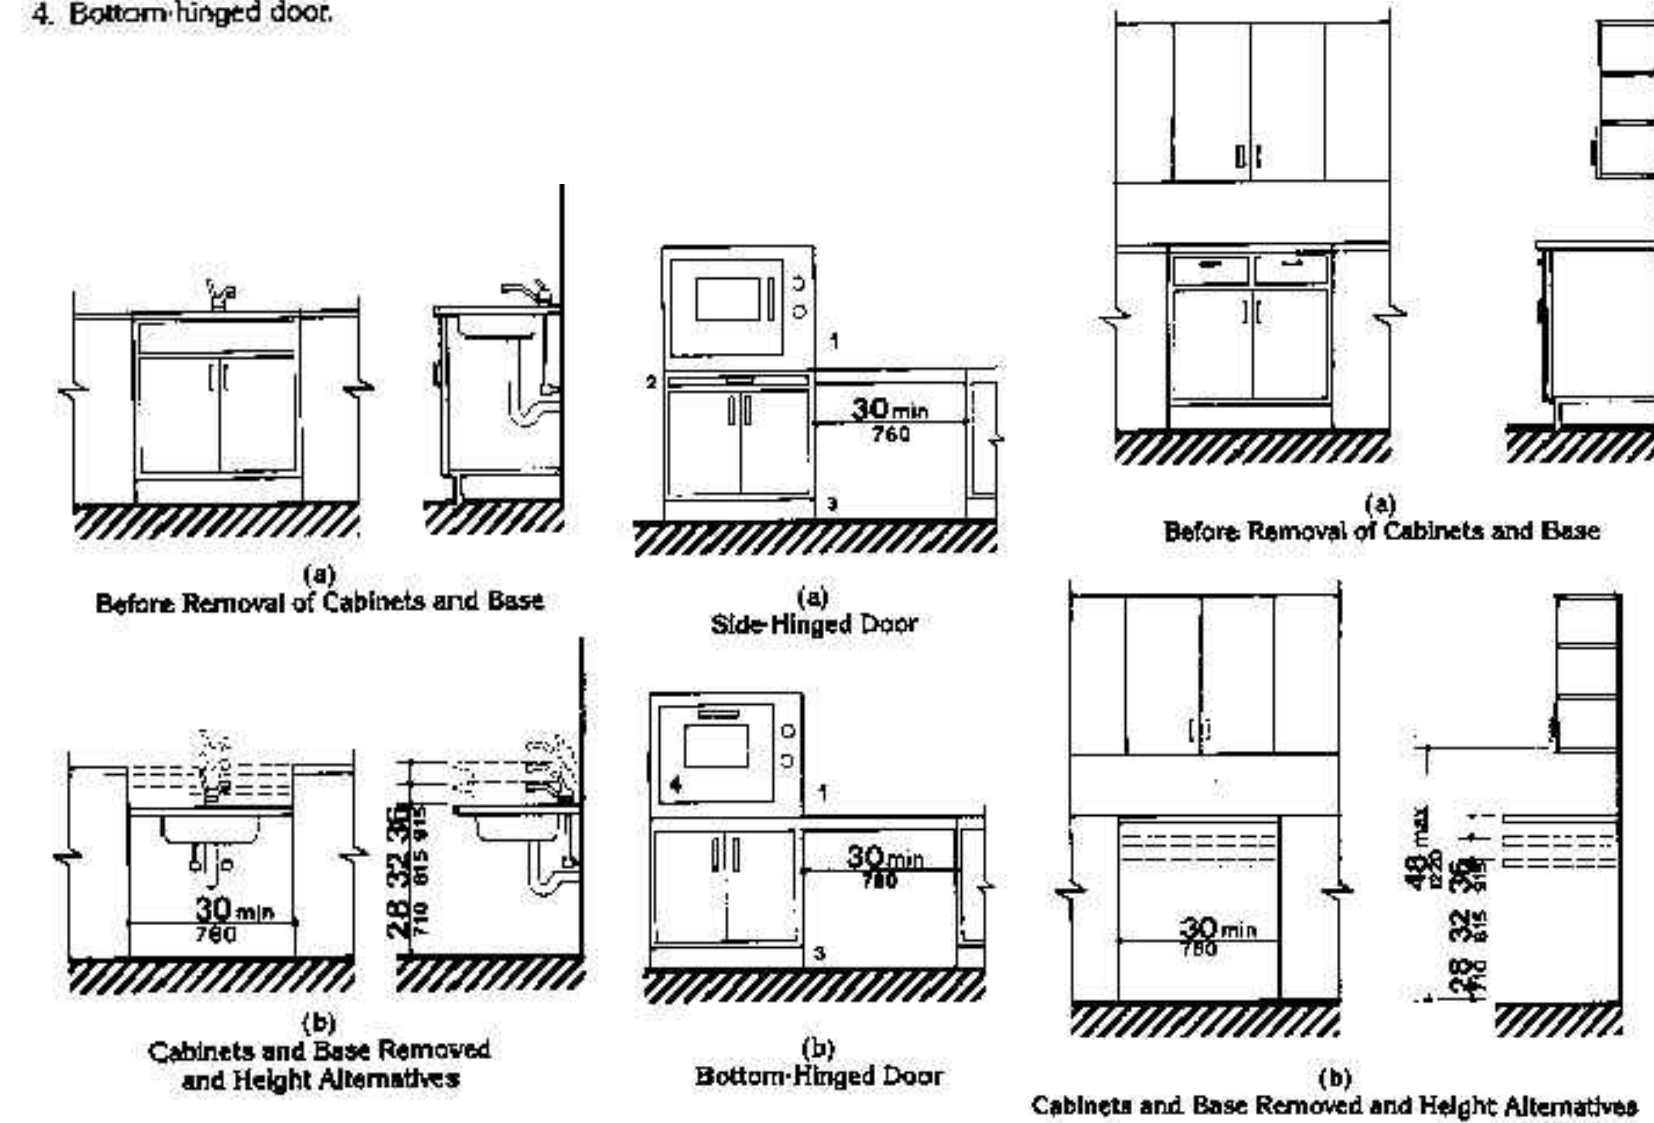


G STANDARD UFAS KITCHEN DIAGRAMS


NO SCALE

THIS UNIFORM FEDERAL ACCESSIBILITY STANDARD SHEET IS FOR INFORMATIONAL PURPOSES ONLY & CONTAINS KEY ILLUSTRATIONS THAT ARE NOT INDICATED ON ANSI-1, ANSI-2 & ANSI-3 (ICC A117.1-2017, ACCESSIBLE and USEABLE BUILDINGS and FACILITIES)

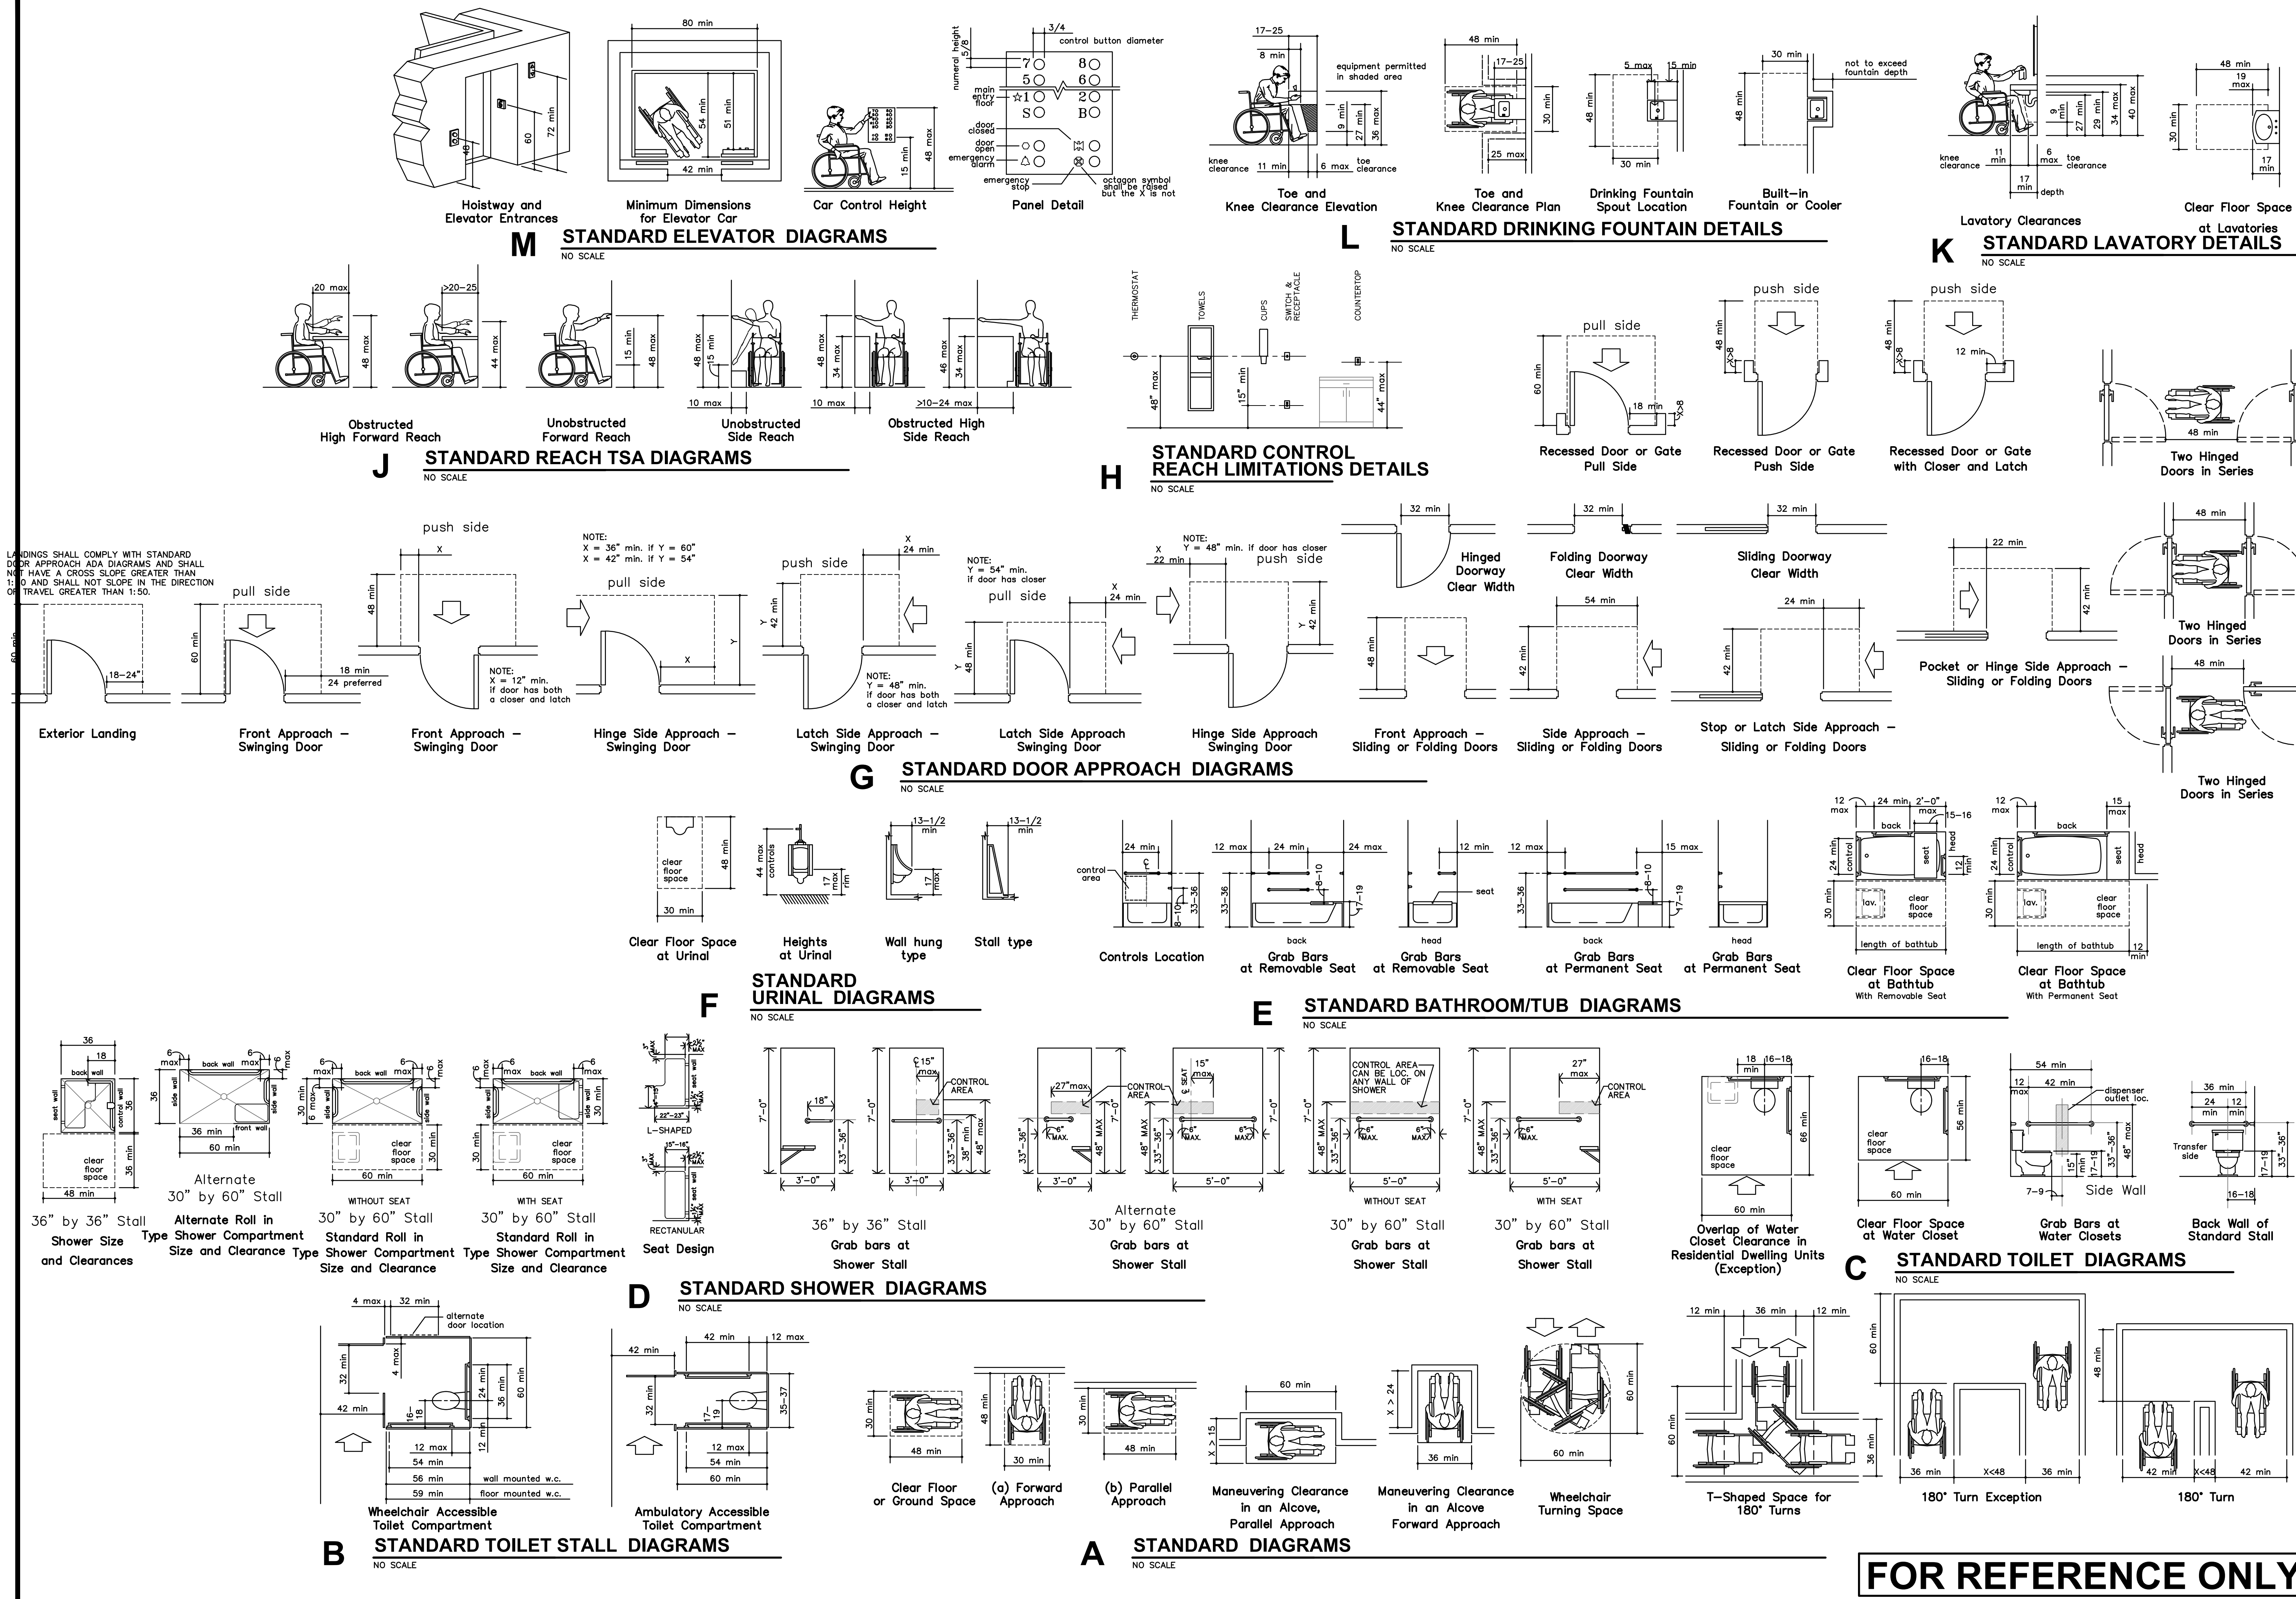


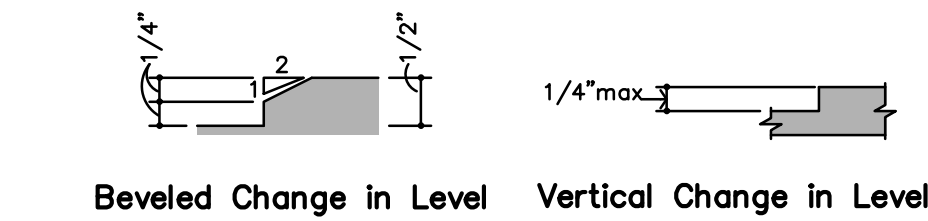


K THRESHOLD DIAGRAMS
NO SCALE

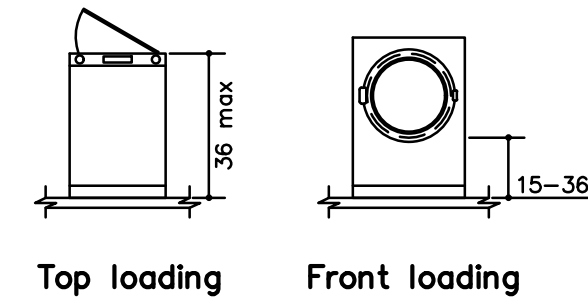


J LAUNDRY
NO SCALE

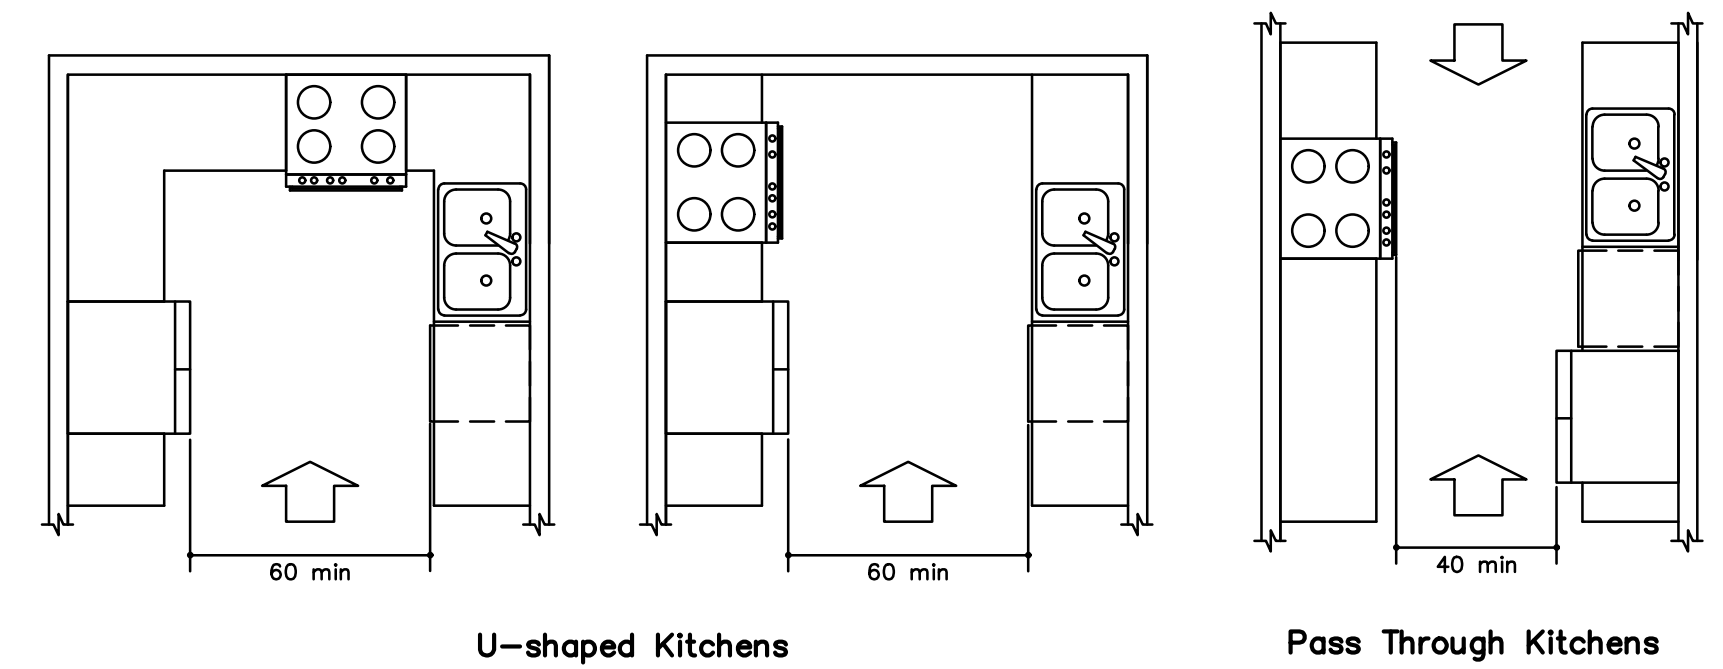



H KITCHENS
NO SCALE

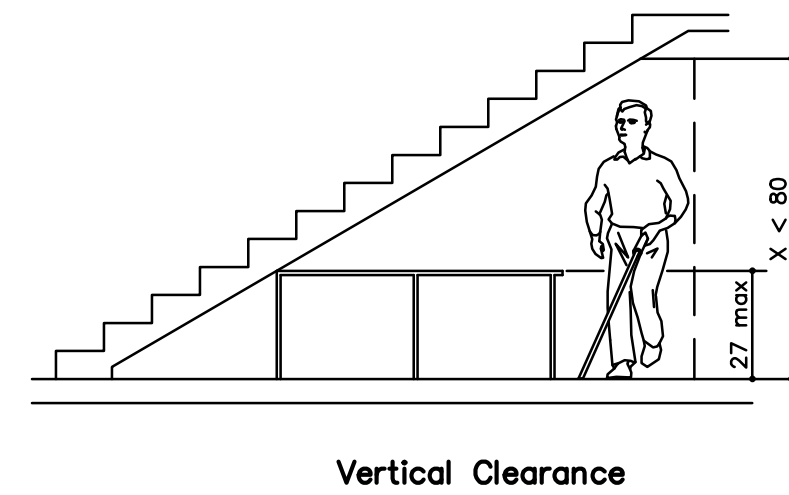


G STANDARD VERTICAL CLEARANCE
NO SCALE

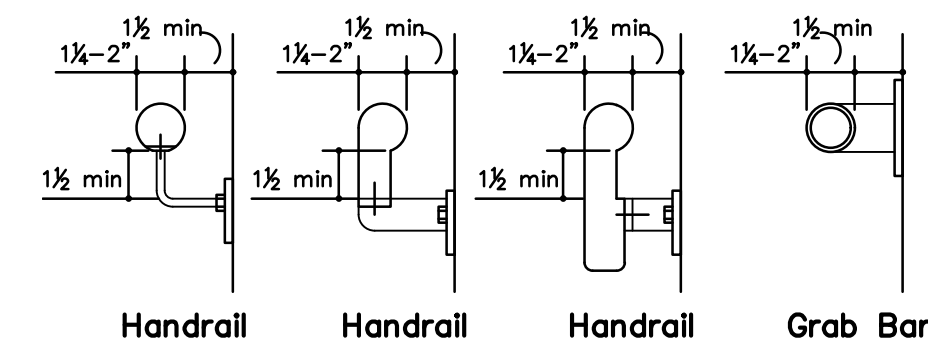


F STANDARD HANDRAIL/GRAB BAR DETAILS
NO SCALE

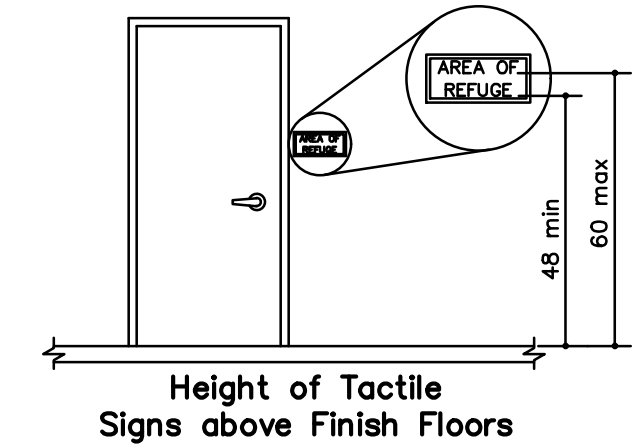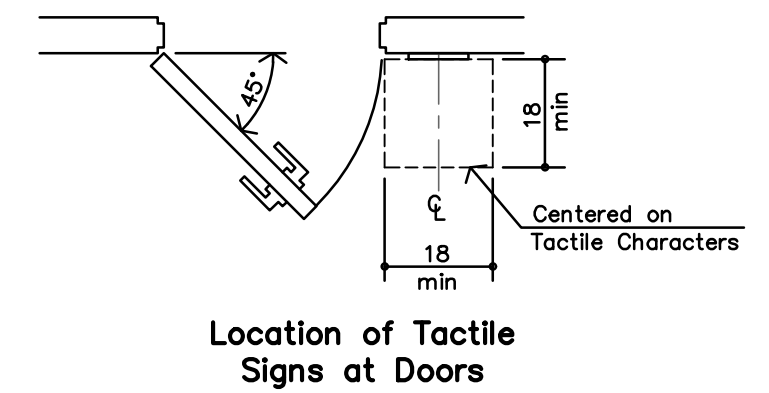




E TACTILE SIGN DIAGRAM
NO SCALE

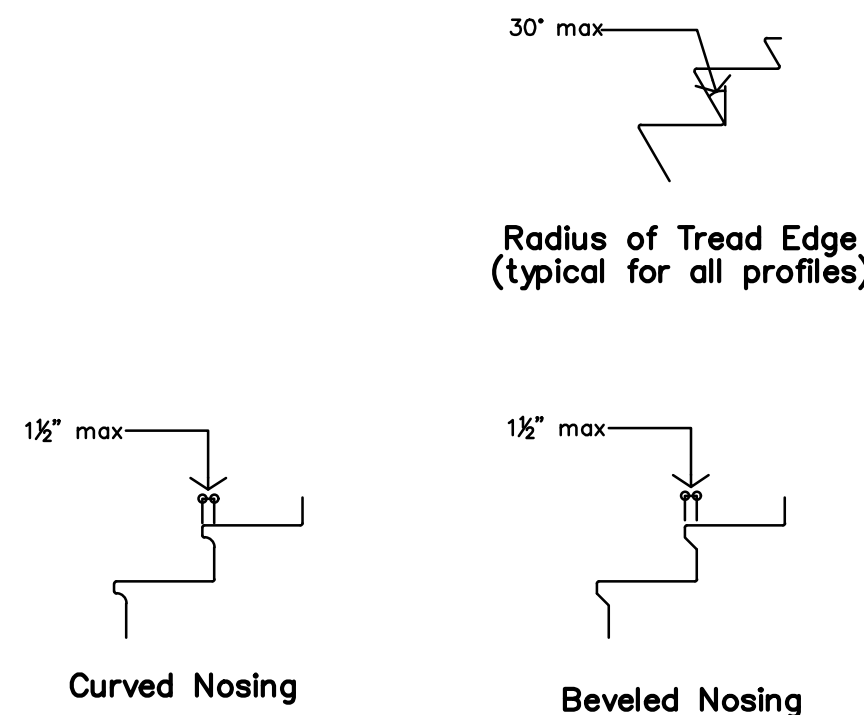



D STANDARD STAIR NOSING DETAILS
NO SCALE

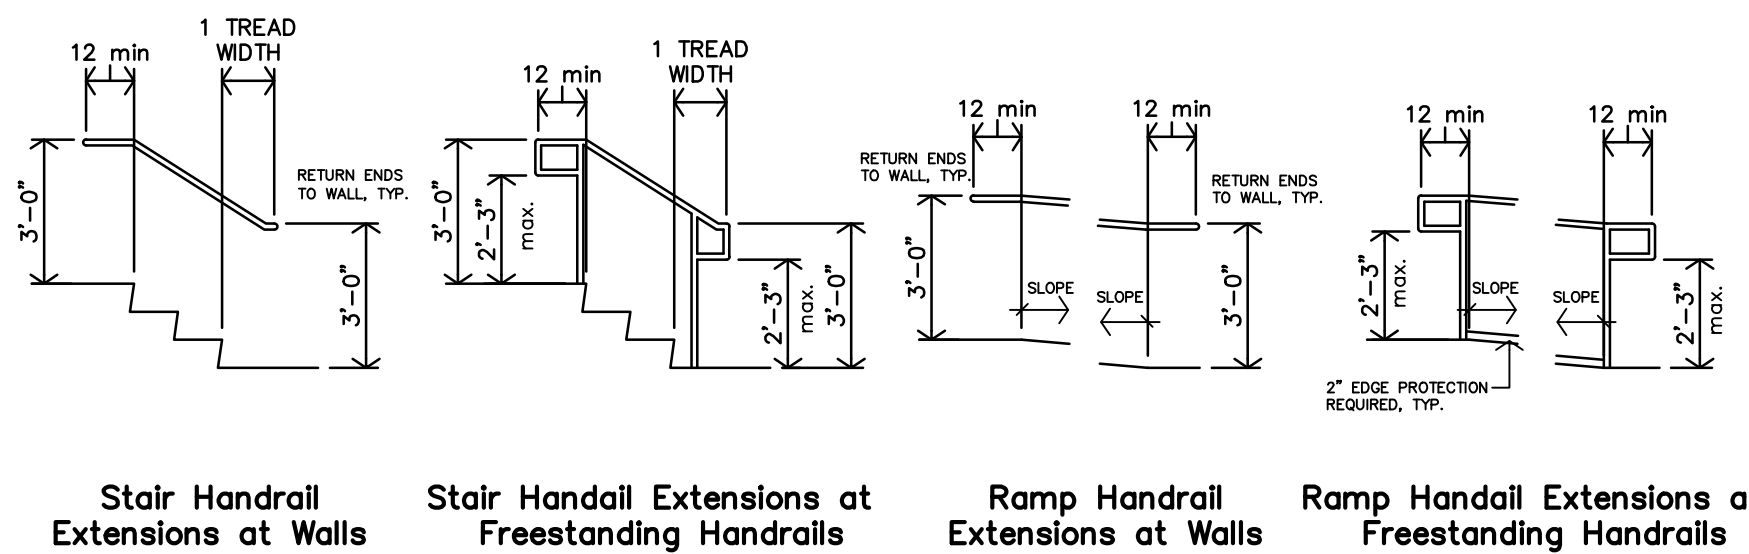


C STANDARD RAMP/STAIR HANDRAIL EXTENSIONS
NO SCALE

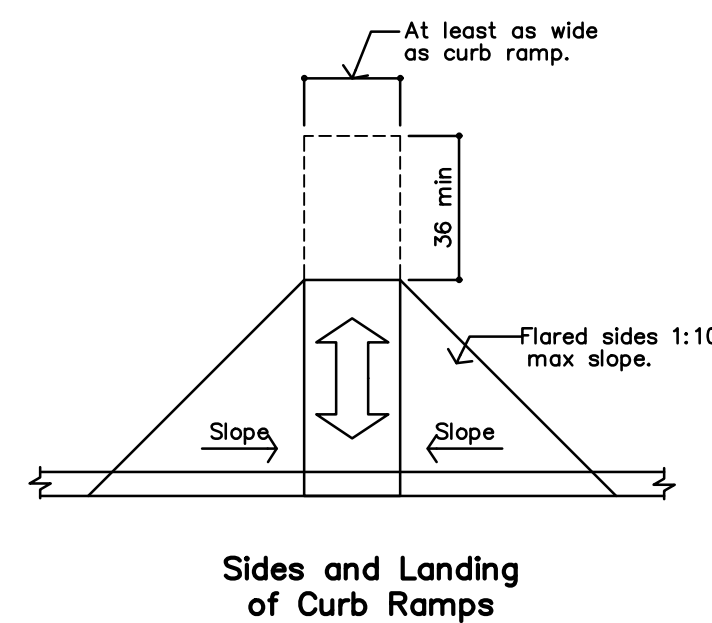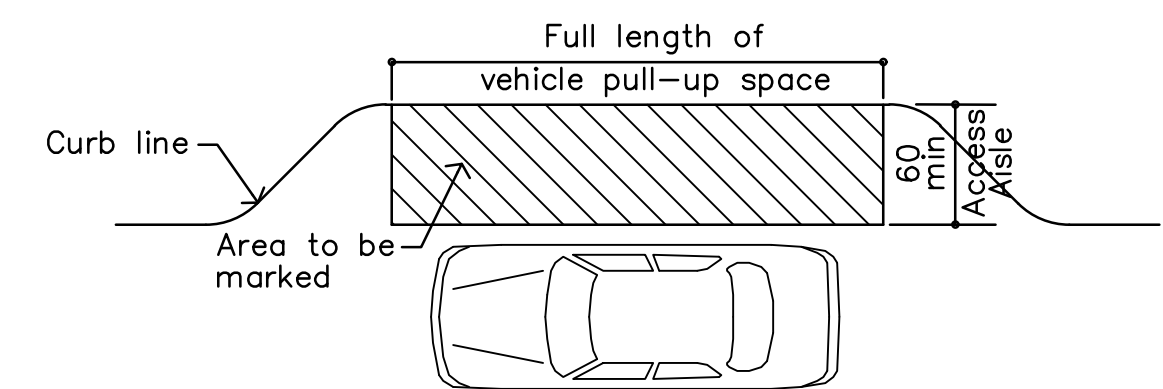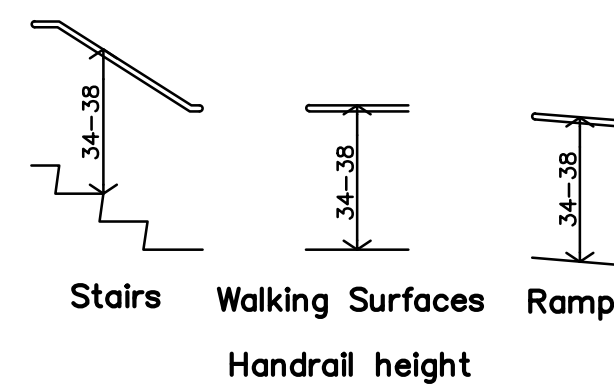


B STANDARD CURB RAMPS DIAGRAMS
NO SCALE

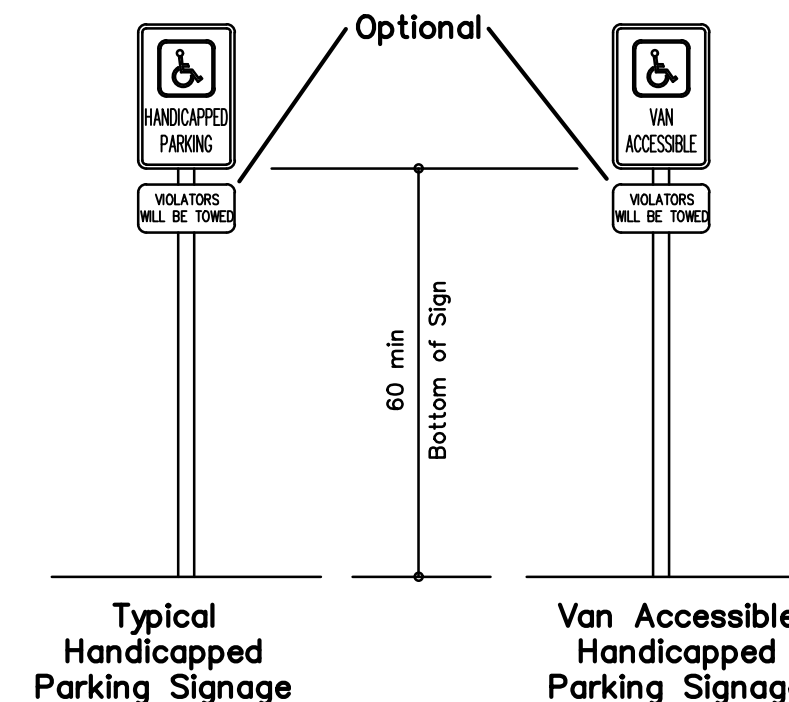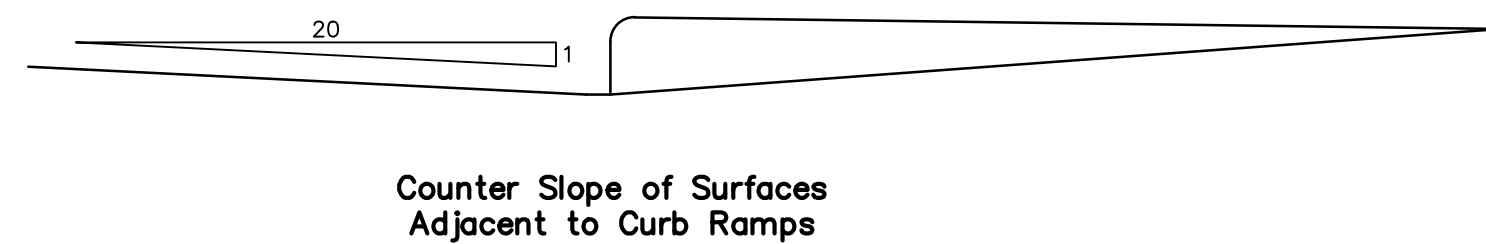


A STANDARD PARKING DIAGRAMS
NO SCALE

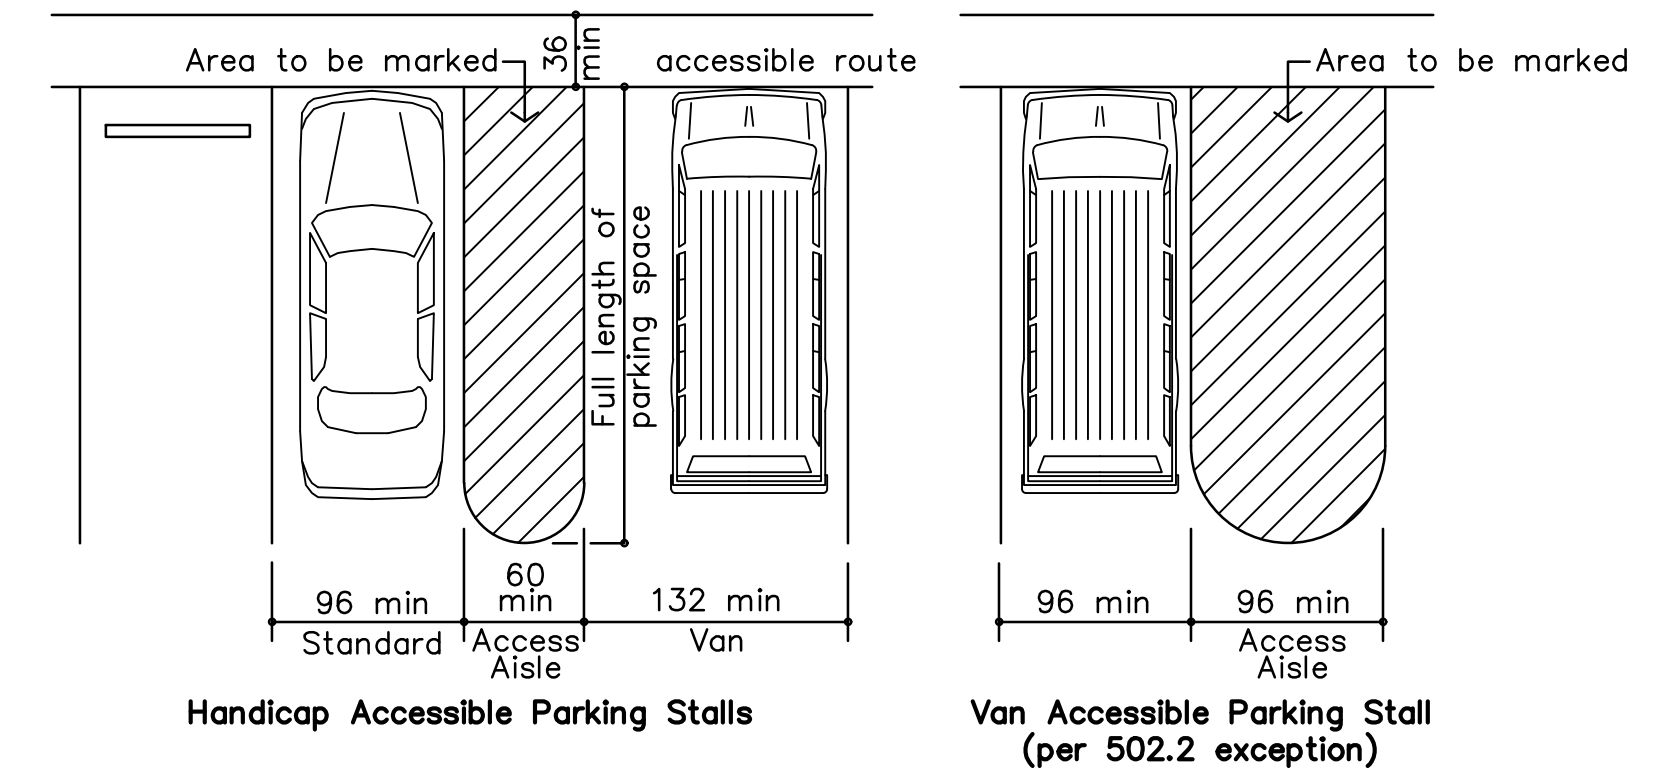


FOR REFERENCE ONLY

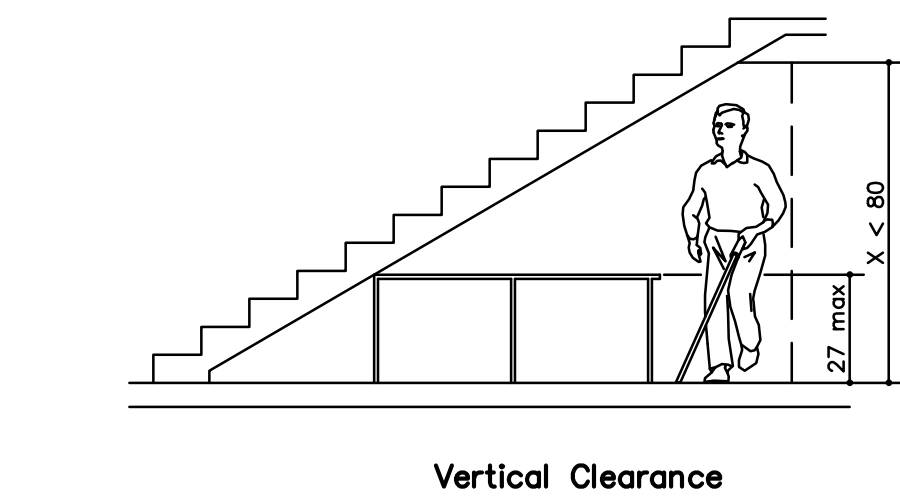


S STANDARD VERTICAL CLEARANCE
NO SCALE

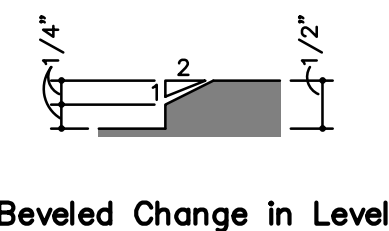


P THRESHOLD ADA DIAGRAMS
NO SCALE

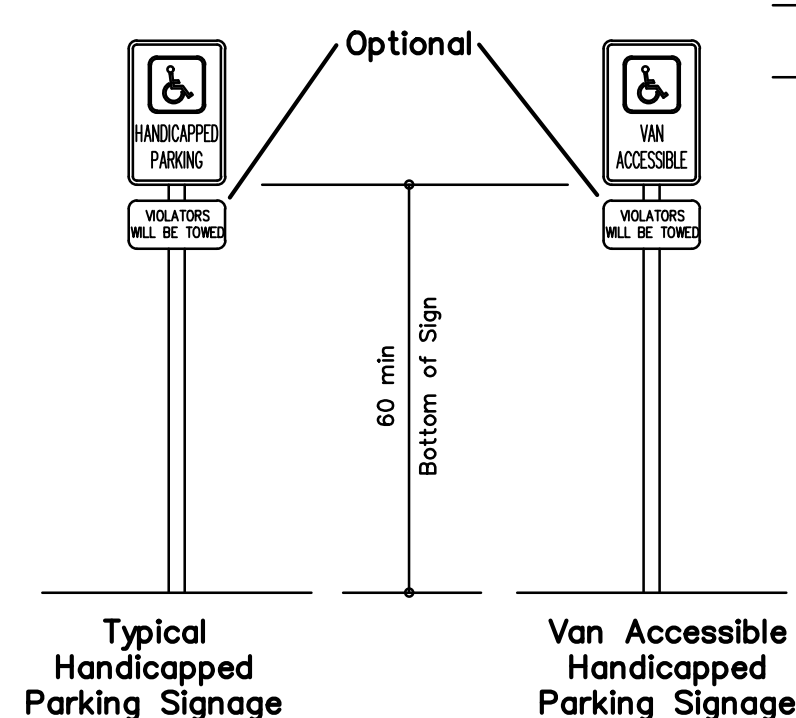


L STANDARD PARKING ADA DIAGRAMS
NO SCALE

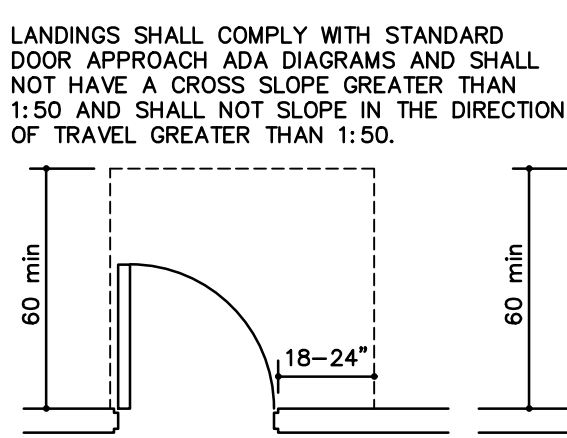


F TACTILE SIGN DIAGRAM
NO SCALE

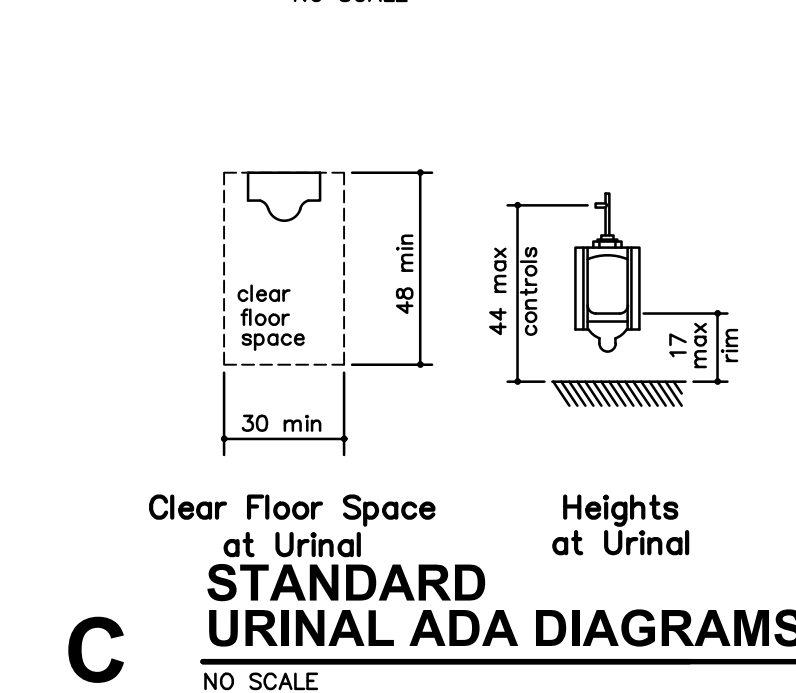


C STANDARD URINAL ADA DIAGRAMS
NO SCALE

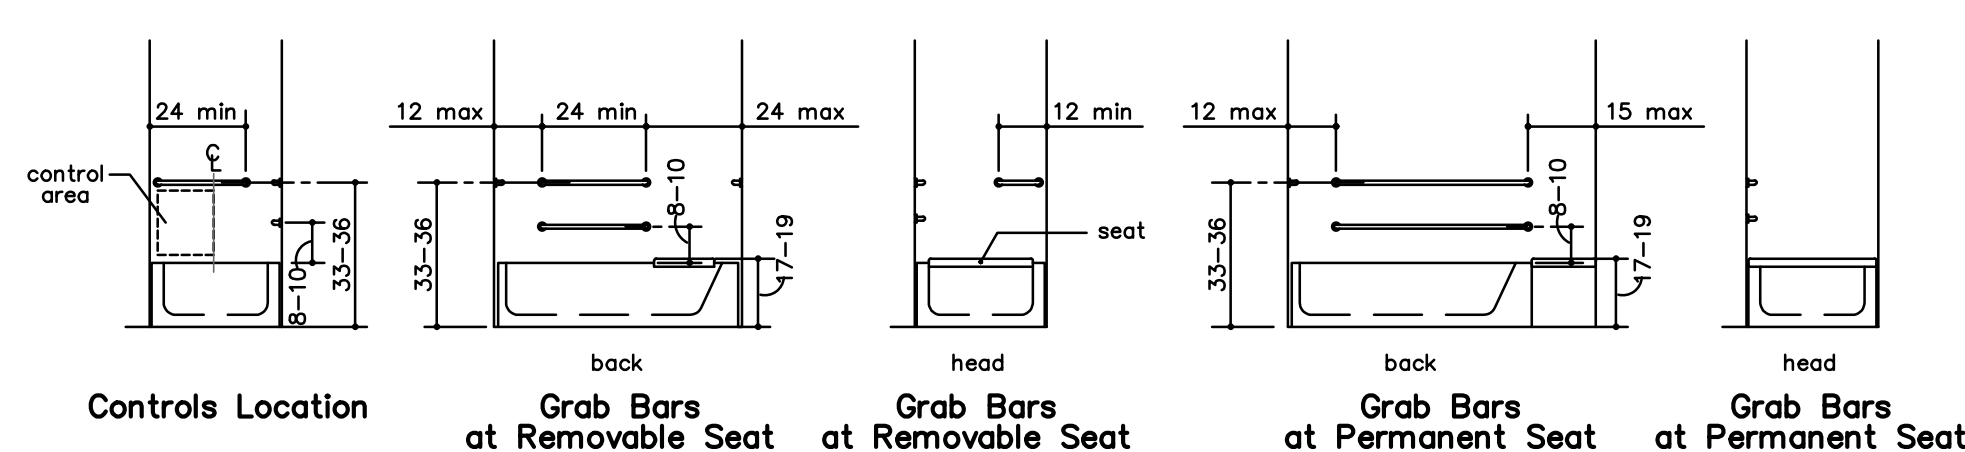


O STANDARD BATHROOM/TUB ADA DIAGRAMS
NO SCALE

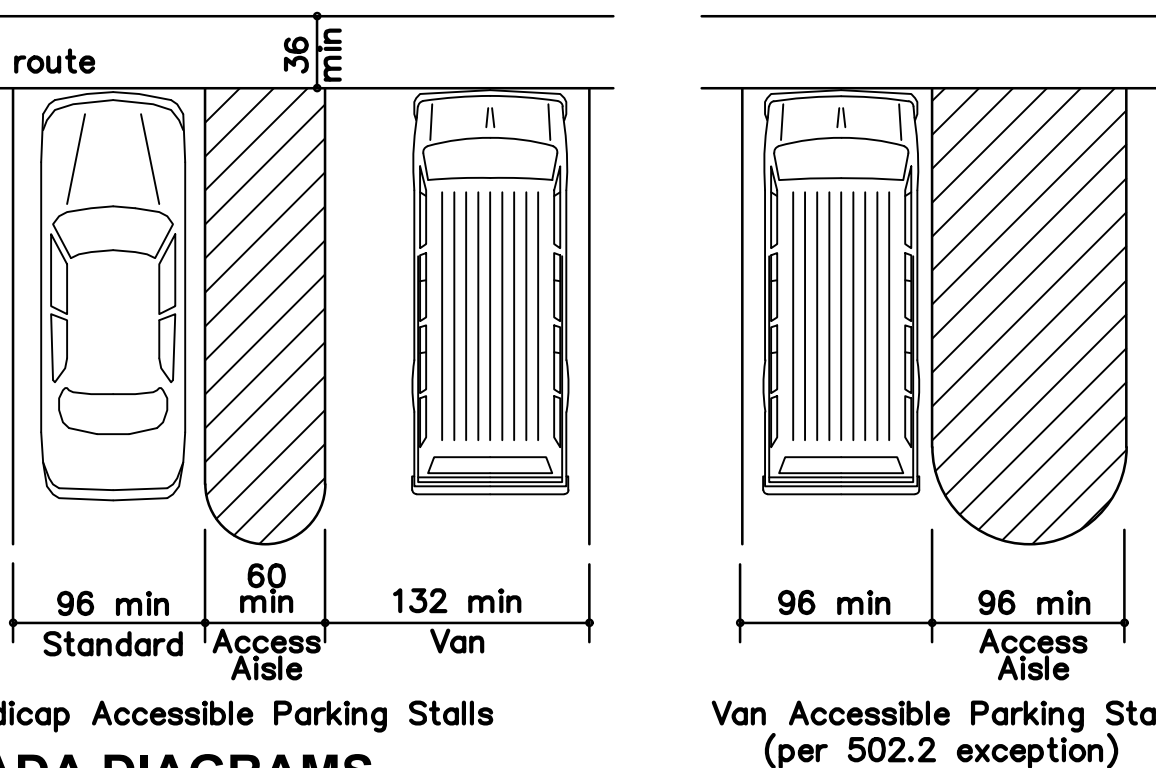


H STANDARD LAVATORY DETAILS
NO SCALE

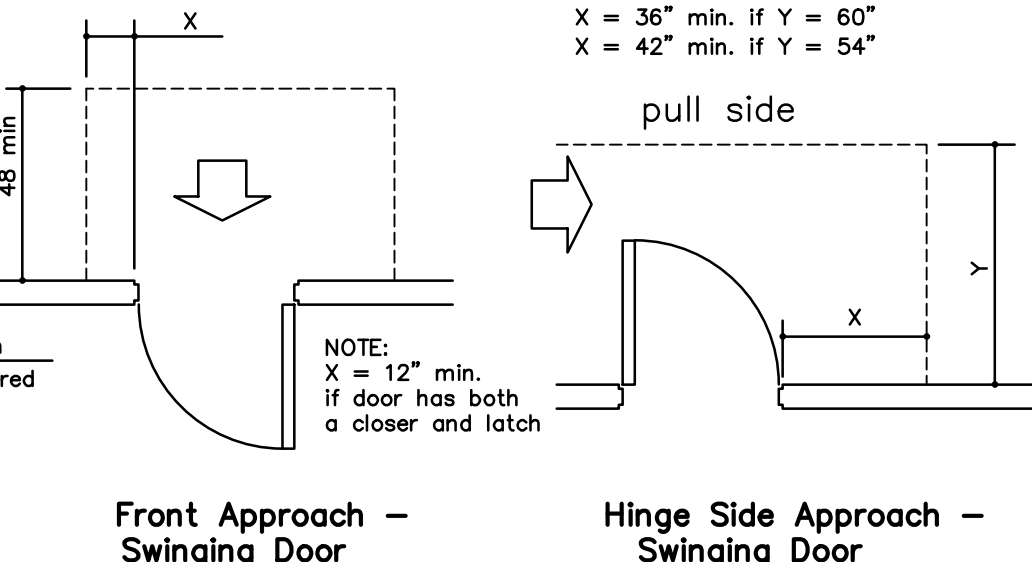


G STANDARD DOOR APPROACH ADA DIAGRAMS
NO SCALE

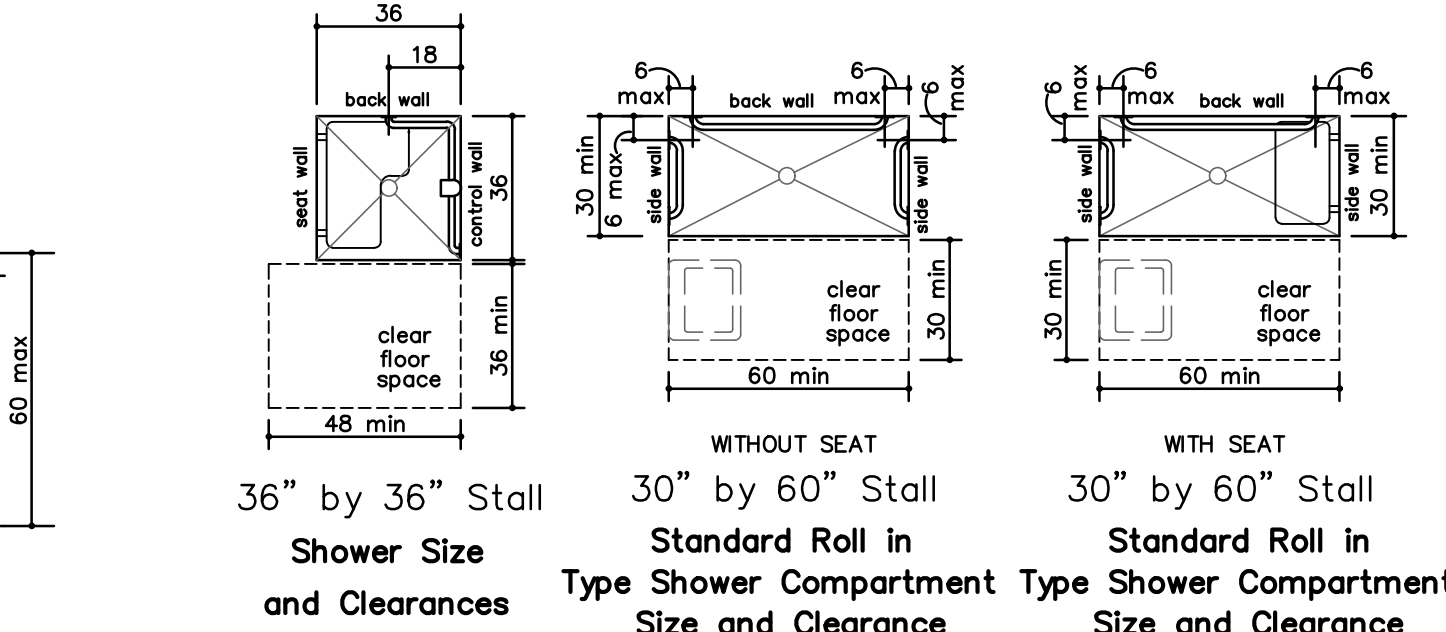


E STANDARD SHOWER ADA DIAGRAMS
NO SCALE

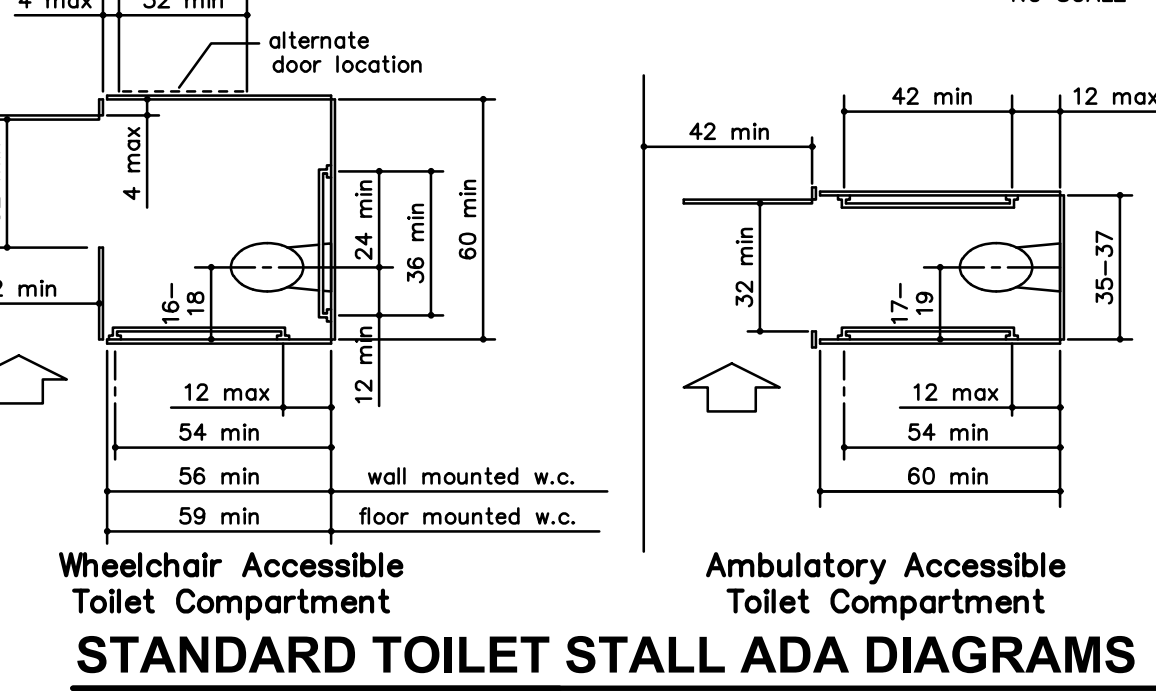


B STANDARD TOILET STALL ADA DIAGRAMS
NO SCALE

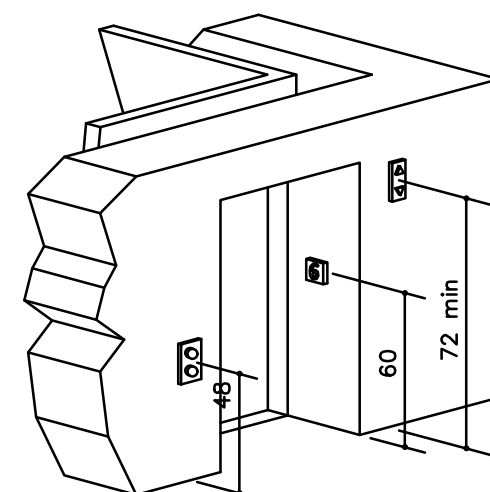


R STANDARD REACH ADA DIAGRAMS
NO SCALE

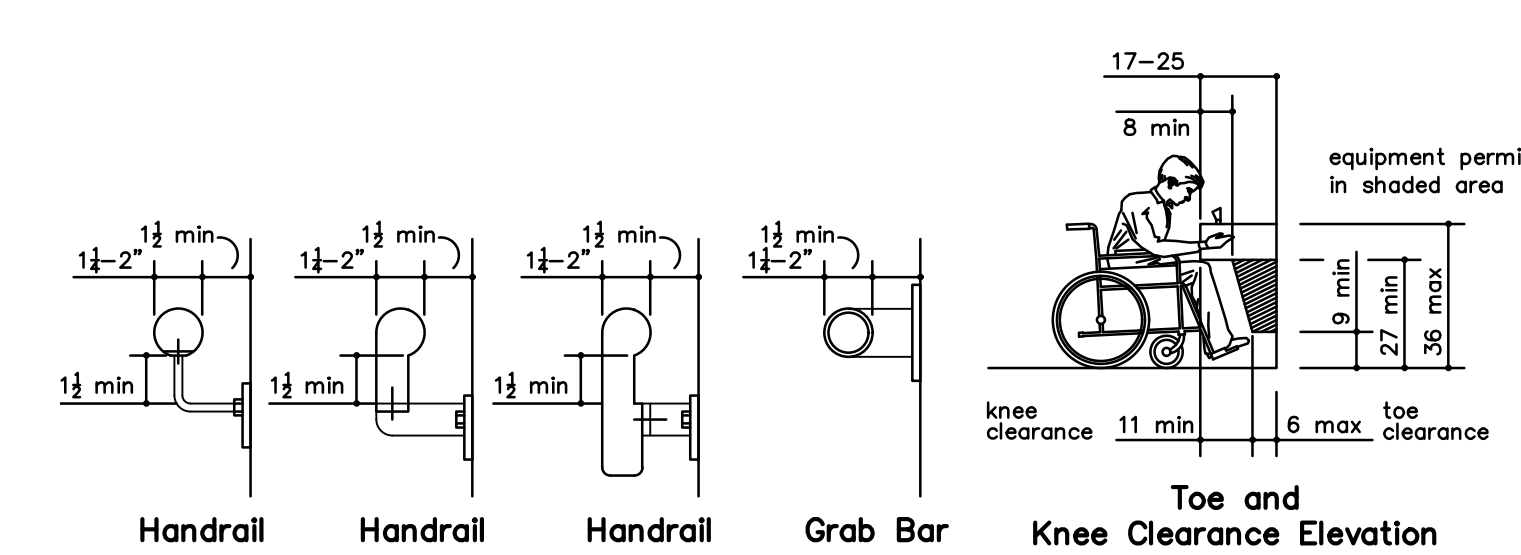


K STANDARD HANDRAIL/GRAB BAR DETAILS
NO SCALE

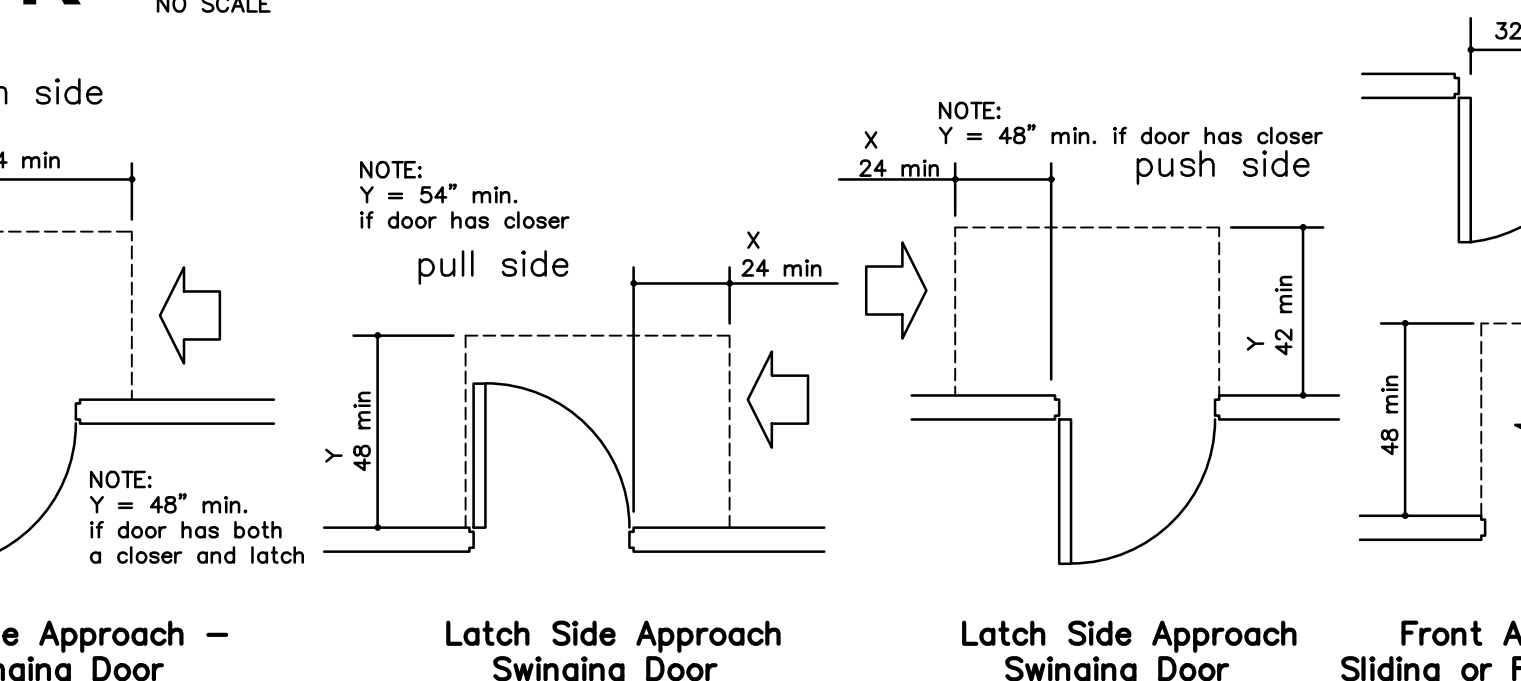


J STANDARD DRINKING FOUNTAIN DETAILS
NO SCALE

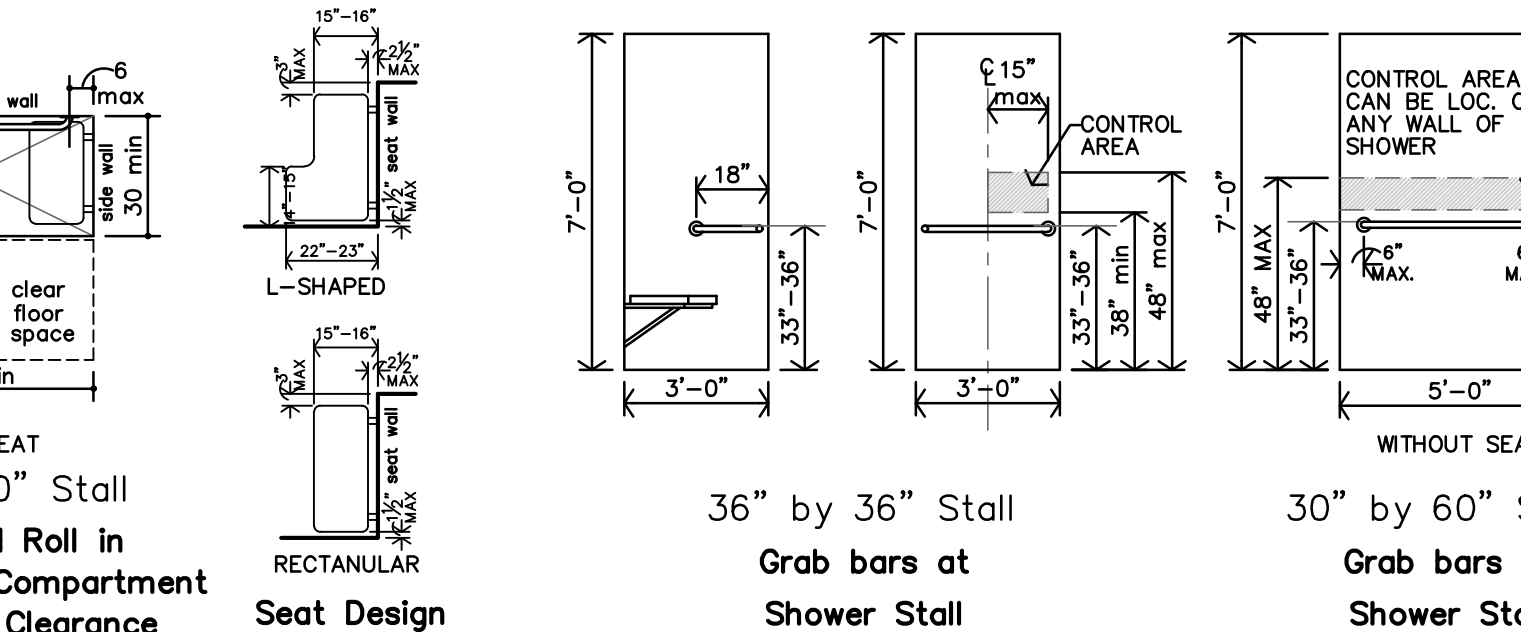


A STANDARD ADA DIAGRAMS
NO SCALE

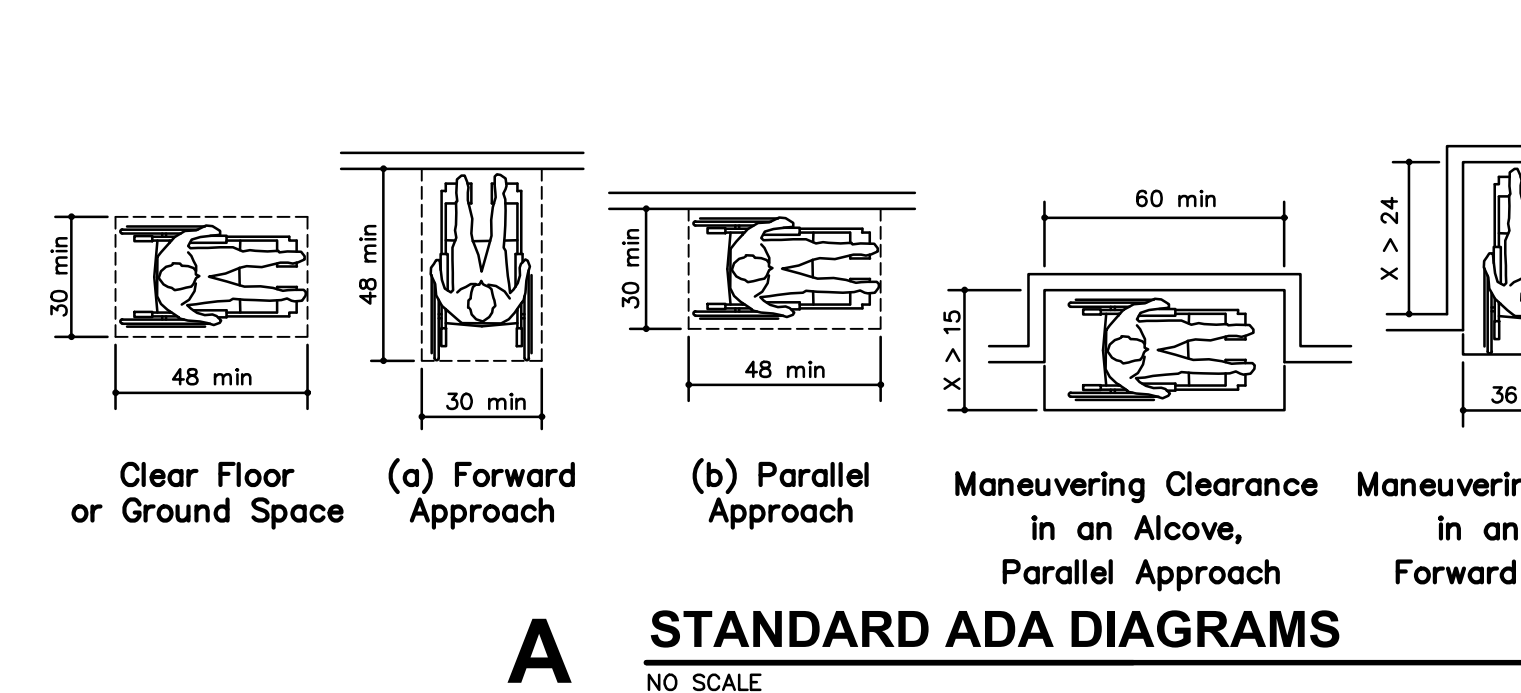


D STANDARD TOILET ADA DIAGRAMS
NO SCALE

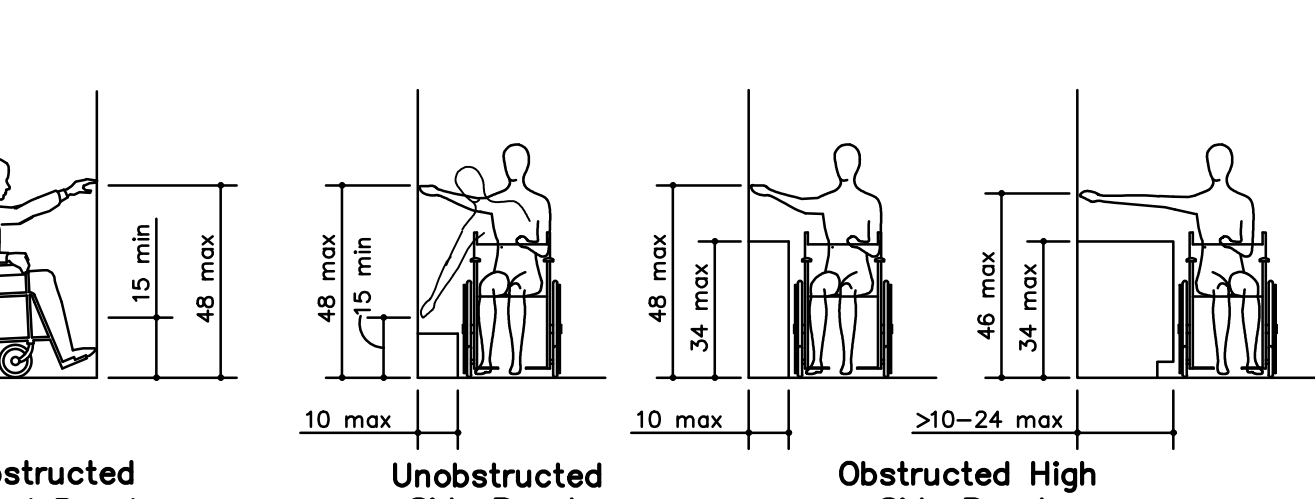


Q STANDARD CONTROL REACH LIMITATIONS DETAILS
NO SCALE

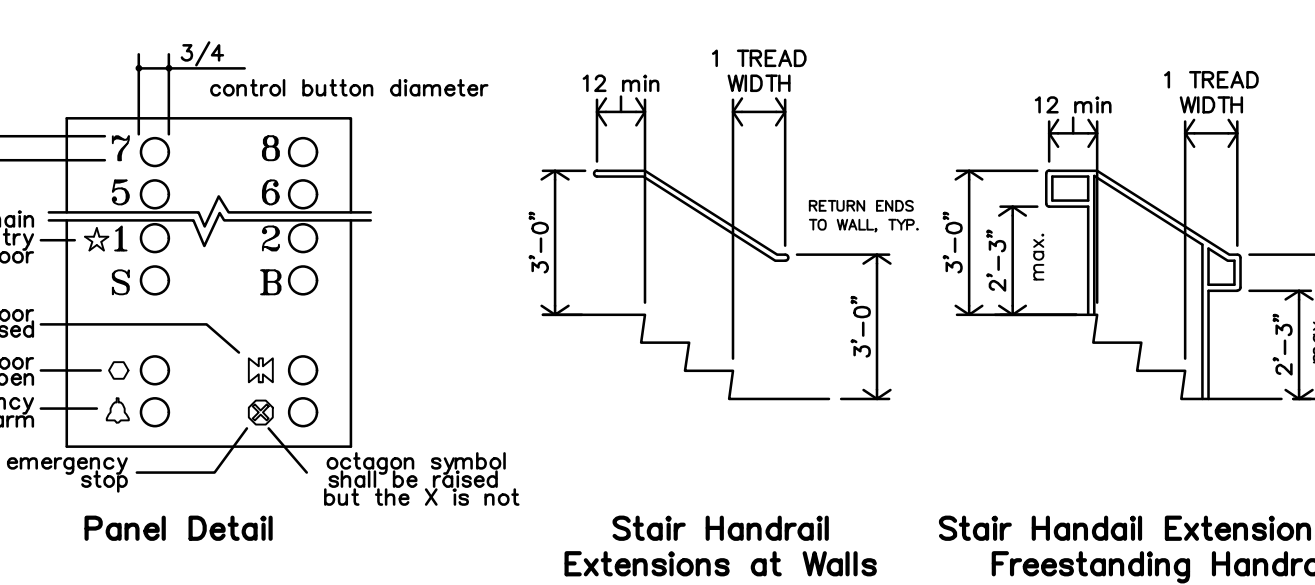


M STANDARD RAMP/STAIR HANDRAIL EXTENSIONS
NO SCALE

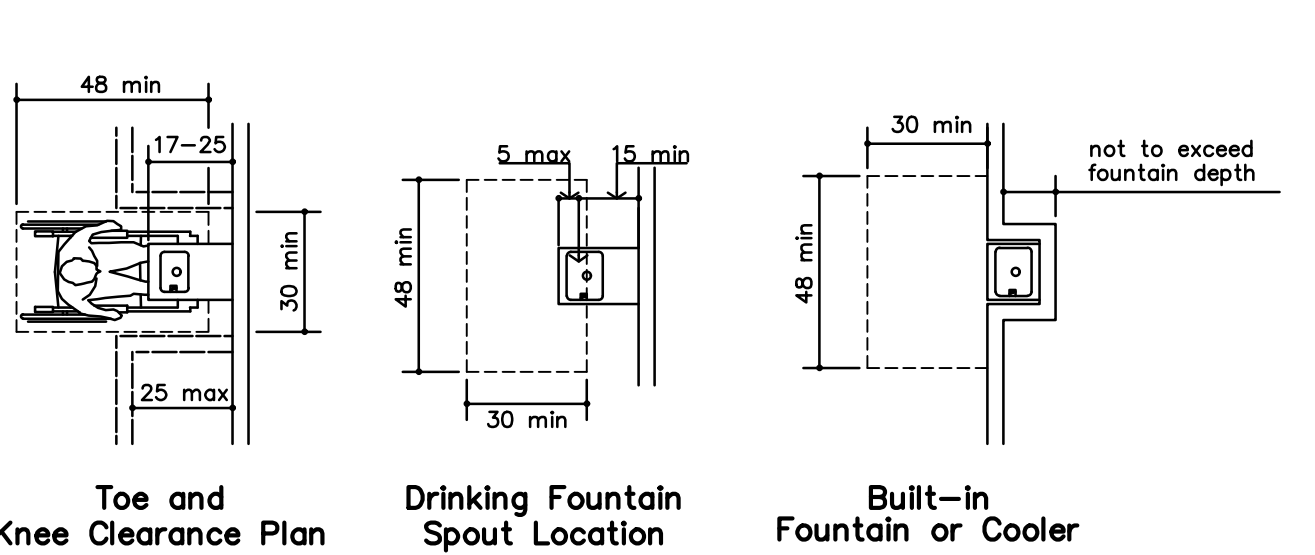


N STANDARD ELEVATOR ADA DIAGRAMS
NO SCALE

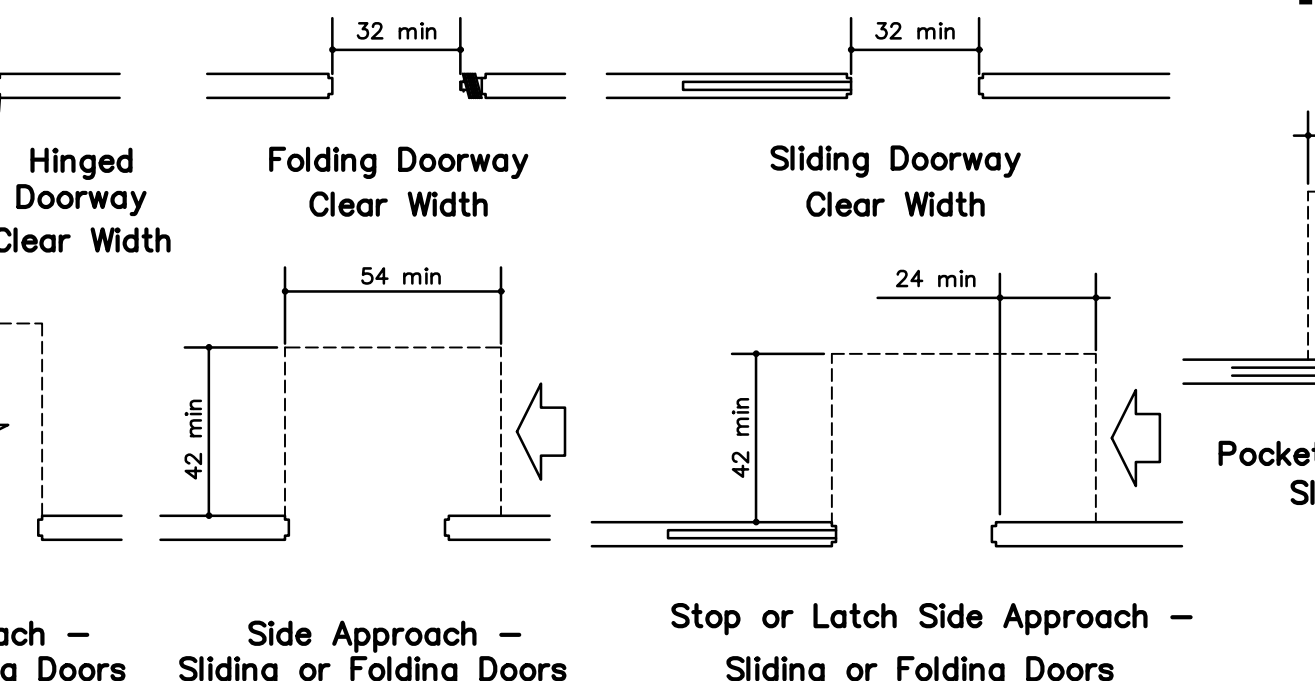


P THRESHOLD ADA DIAGRAMS
NO SCALE

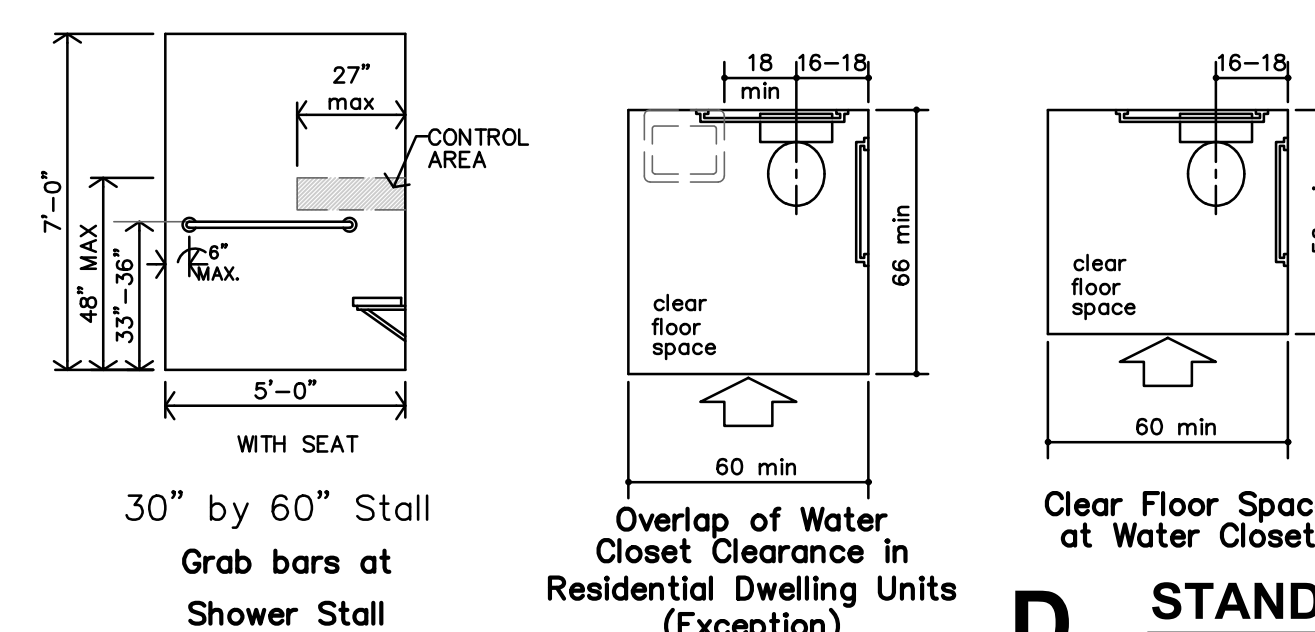


S STANDARD VERTICAL CLEARANCE
NO SCALE

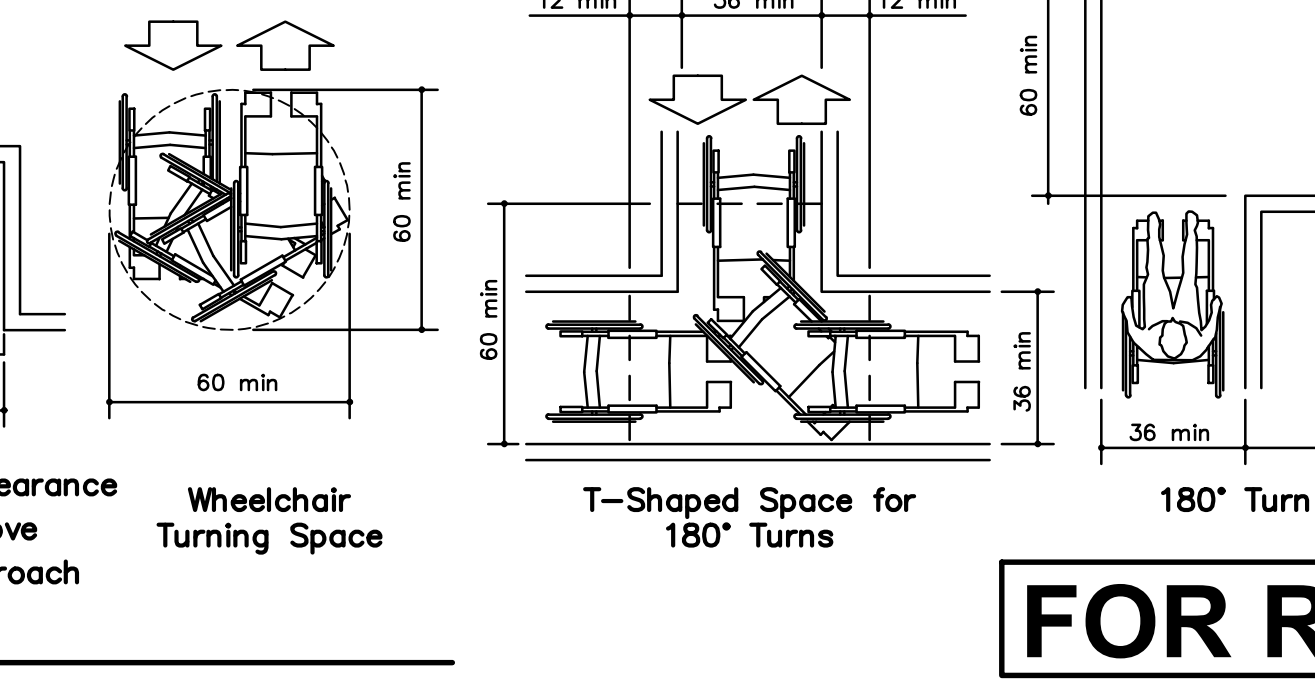


T STANDARD TACTILE SIGN DIAGRAM
NO SCALE

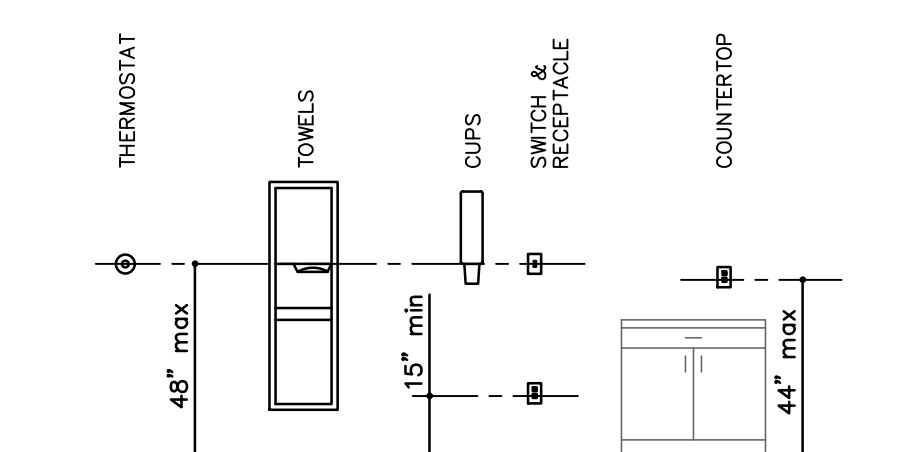


U STANDARD URINAL ADA DIAGRAMS
NO SCALE

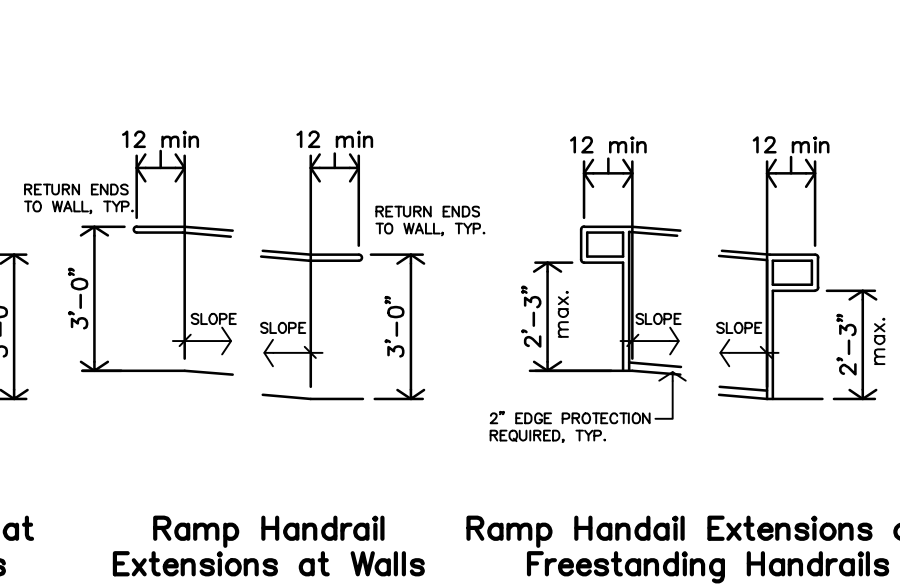


V STANDARD VERTICAL CLEARANCE
NO SCALE

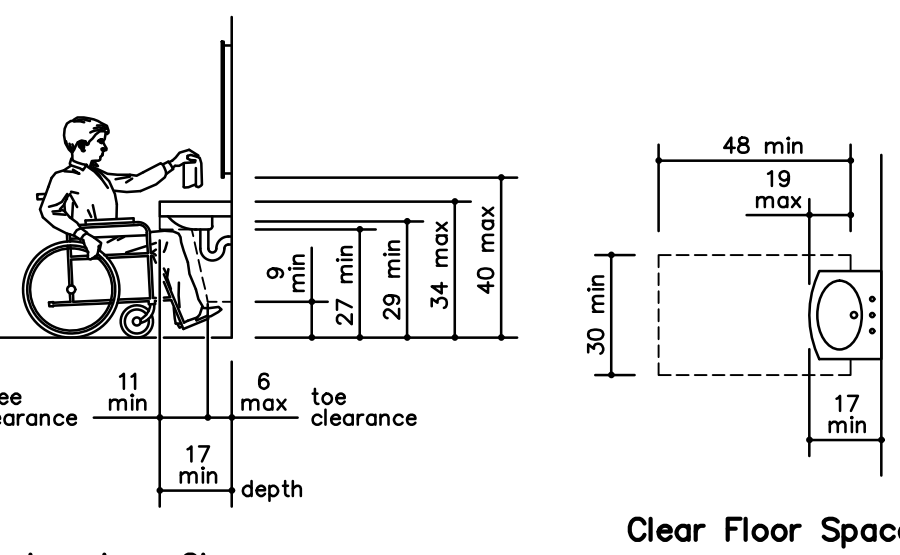


W STANDARD WHEELCHAIR TURNING SPACE
NO SCALE

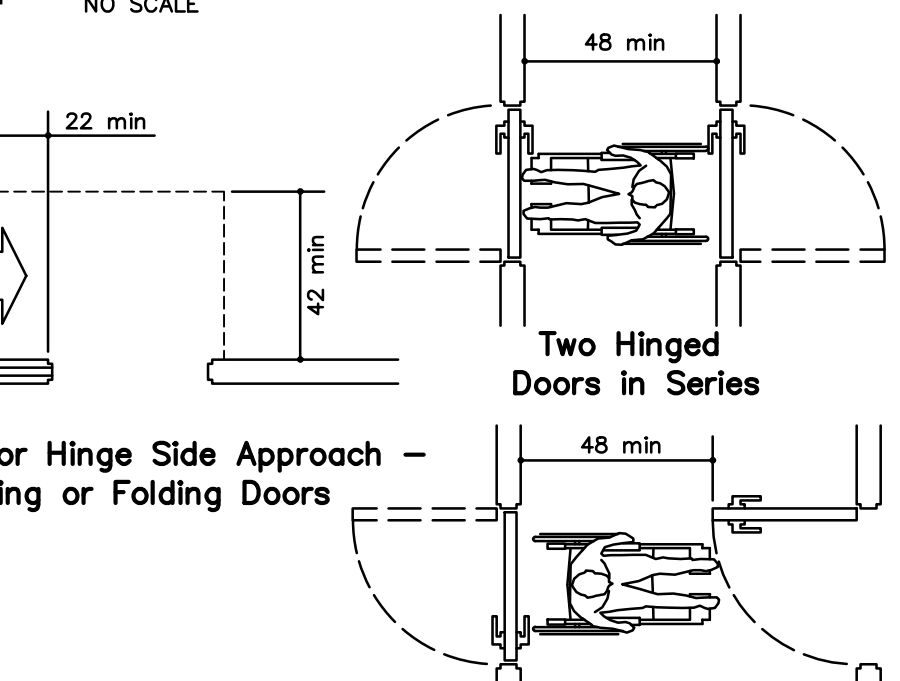

X STANDARD X-RAY
NO SCALE

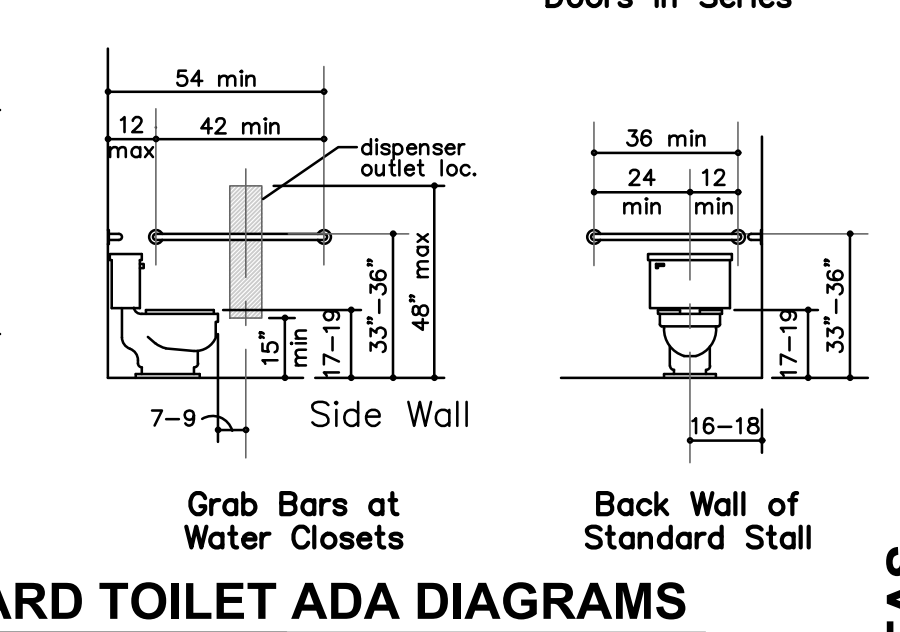

Y STANDARD Y-AXIS
NO SCALE

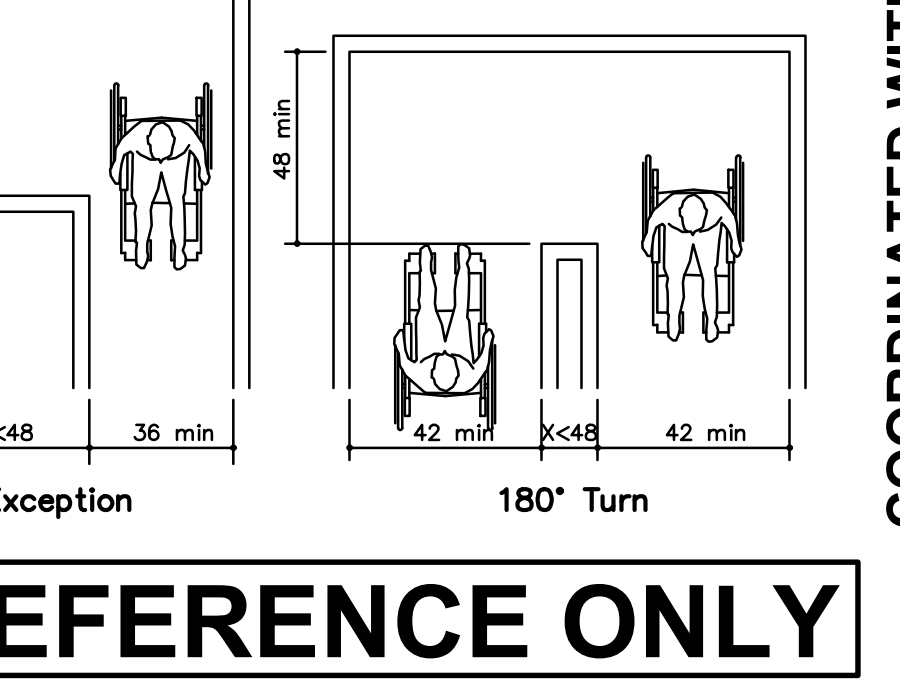

Z STANDARD Z-AXIS
NO SCALE

HISTORIC PRESERVATION NOTES

- STRUCTURE, MASONRY AND EXTERIOR WALLS
1. ANY STRUCTURAL REPAIRS SHOULD BE MINIMALLY VISIBLE FROM THE EXTERIOR.
 2. ALL DECORATIVE MASONRY MUST REMAIN.
 3. MASONRY/BRICK CLEANING MUST BE OF THE GENTLEST MEANS POSSIBLE. CLEANING SHALL BE IN ORDINANCE WITH NPS BREIF 1, AND THE GSA GUIDELINES FOR CLEANING EXTERIOR BRICK. CONTACT AND REFER TO HISTORIC CONSULTANTS/SPECIALISTS FOR TREATMENT OPTIONS.
 4. MASONRY REHABILITATION SHALL CONSIST OF SPOT REPOINTING AND REPAIR/REPLACEMENT OF ISOLATED DETERIORATION. ALL WORK SHALL CONFORM TO PRESERVATION STANDARDS OUTLINED IN THE NATIONAL PARK SERVICE PRESERVATION BRIEF'S 1.2 & 6. DETERIORATED MORTAR SHOULD BE REMOVED TO SOUND MORTAR. NEW MORTAR SHOULD MATCH EXISTING IN COLOR, TEXTURE, COMPOSITION, AND JOINT PROFILE.
 5. NATIONAL PARK SERVICE BRIEF 2 SPECIFIES THE RECOMMENDED COMPOSITION OF MORTARS USED IN HISTORIC BUILDINGS.

- WINDOWS
1. EXISTING WINDOWS MAY REMAIN.
 2. NEW WINDOWS ARE PROPOSED, THEY ARE TO MATCH WINDOWS VISIBLE IN HISTORIC IMAGES. NEW WINDOWS CAN BE WOOD, CLAD-WOOD, OR ALUMINUM. IF ALUMINUM, THEY SHOULD HAVE A PAINT-LIKE OR BAKED ON FINISH. NEW WINDOWS CAN BE TRUE DIVIDED OR SIMULATED; IF SIMULATED, THEY SHOULD HAVE BOTH EXTERIOR AND INTERIOR MUNTIN GRIDS. IF INSULATED, THERE SHOULD BE A SPACER GRID BETWEEN PANES OF GLASS. WINDOWS DO NOT NEED TO BE OPERABLE BUT NEED TO HAVE AN OISET UPPER SASH SO THAT THEY MIMIC THE HUNG WINDOW CONFIGURATION OF HISTORIC. GLASS IN NEW WINDOWS MUST BE CLEAR, COLORLESS, AND NON-REFLECTIVE WITH NO LESS THAN 69% VLT AND NO GREATER THAN 11% VLR.
 3. ANY EXISTING WINDOWS BEING RETAINED ARE TO BE REPAIRED TO THE GREATEST MEANS POSSIBLE WITH ANY MISSING OR DETERIORATED PARTS REPLACED IN KIND.

- ROOFS
1. EXISTING COPING MUST REMAIN, ANY NEW FLASHING OR COPING SHALL NOT BE VISIBLE FROM THE GROUND.
 2. SCUPPERS AND DOWNSPOUTS SHOULD BE REPAIRED WHEREEVER POSSIBLE, ANY NEW DOWNSPOUTS SHOULD MATCH EXISTING.

- INTERIOR
1. THE WOOD STAGE IS TO REMAIN AND BE REPAIRED AS NEEDED. REPAIRS ARE TO BE KNITTED INTO THE EXISTING PATTERN.
 2. CMU IN THE CAFETERIUM CAN BE PAINTED.
 3. THE CORRIDOR CONFIGURATION IS TO REMAIN INTACT
 4. EXISTING OFFICE AND CLASSROOM AND OFFICE OPENINGS SHOULD BE RETAINED AND REUSED WHERE POSSIBLE.
 5. WHERE DOORS ARE NOT USED, THEY SHOULD BE FIXED IN PLACE. PLASTER WALLS AND CEILINGS THROUGHOUT ARE TO BE RETAINED AND REPAIRED IN ACCORDANCE WITH PRESERVATION BRIEF 21.
 6. HEX TILE FLOORS MUST REMAIN AND BE REPAIRED. ANY MISSING TILES ARE TO BE REPLACED IN KIND.
 7. CONCRETE FLOORS IN THE BASEMENT MUST REMAIN BUT MAY BE REPAINTED.
 8. LAY-IN GRID CEILINGS ARE TO BE REMOVED THROUGHOUT. PROTECT HISTORIC PLASTER CEILINGS DURING LAY-IN DEMO.
 9. SOFFITS & EXPOSED MEP SHOULD BE AVOIDED IN ALL CORRIDORS.
 10. WHERE PARTITIONS INTERSECT WITH MULLIONS, PARTITION MUST BE NO WIDER THAN THE MULLTION FOR 18" BACJ FROM WINDOW.
 11. AREAS OF DROPPED CEILINGS/SOFFITS ARE TO BE HELD BACK FROM WINDOWS A MINIMUM OF 4 FEET.
 12. CARPETS ARE TO BE REMOVED TO REVEAL HISTORIC FLOORING. HISTORIC FLOOR IS TO BE RETAINED AND REPAIRED.
 13. CHALKBOARDS/MILLWORK SHOULD BE RETAINED WHERE POSSIBLE.
 14. IF ANY HISTORIC FINISHES, OR FEATURES NOT PREVIOUSLY NOTED ARE UNCOVERED, CONTACT THE ARCHITECT IMMEDIATELY.

- VERTICAL CIRCULATION
1. STAIRS MUST REMAIN, AND BE REPAIRED AS NEEDED.
 2. IF ADDITIONAL RAILINGS ARE REQUIRED TO MEET CODE, THEY SHOULD BE SIMPLE AND COMPATIBLE WITH THE BUILDING.
 3. THE NEW ELEVATOR TOWER IS TO BE COMPATIBLE WITH THE MATERIALS AND MASSING OF THE 1915 BUILDING.

MECHANICAL, ELECTRICAL, PLUMBING, & SINGAGE

1. NEW HVAC SHALL RUN ABOVE CEILINGS AND DUCTS ARE NOT TO BE EXPOSED.
2. ROOFTOP EQUIPMENT SHALL NOT BE VISIBLE FROM GROUND.
3. NEW PLUMBING SHALL NOT BE EXPOSED.
4. ORIGINAL CAFETERIUM SPOTLIGHTS ARE TO REMIAN.
5. THE ORIGINAL IRVING SIGN IS TO BE REPAIRED AS NEEDED
6. NEW SINGAGE IS TO BE COMPATIBLE WITH BUILDING CHARACTER.




D PHOTO AERIAL VIEW SOUTH
NTS



C PHOTO AERIAL VIEW NW
NTS



B PHOTO AERIAL VIEW NORTH
NTS

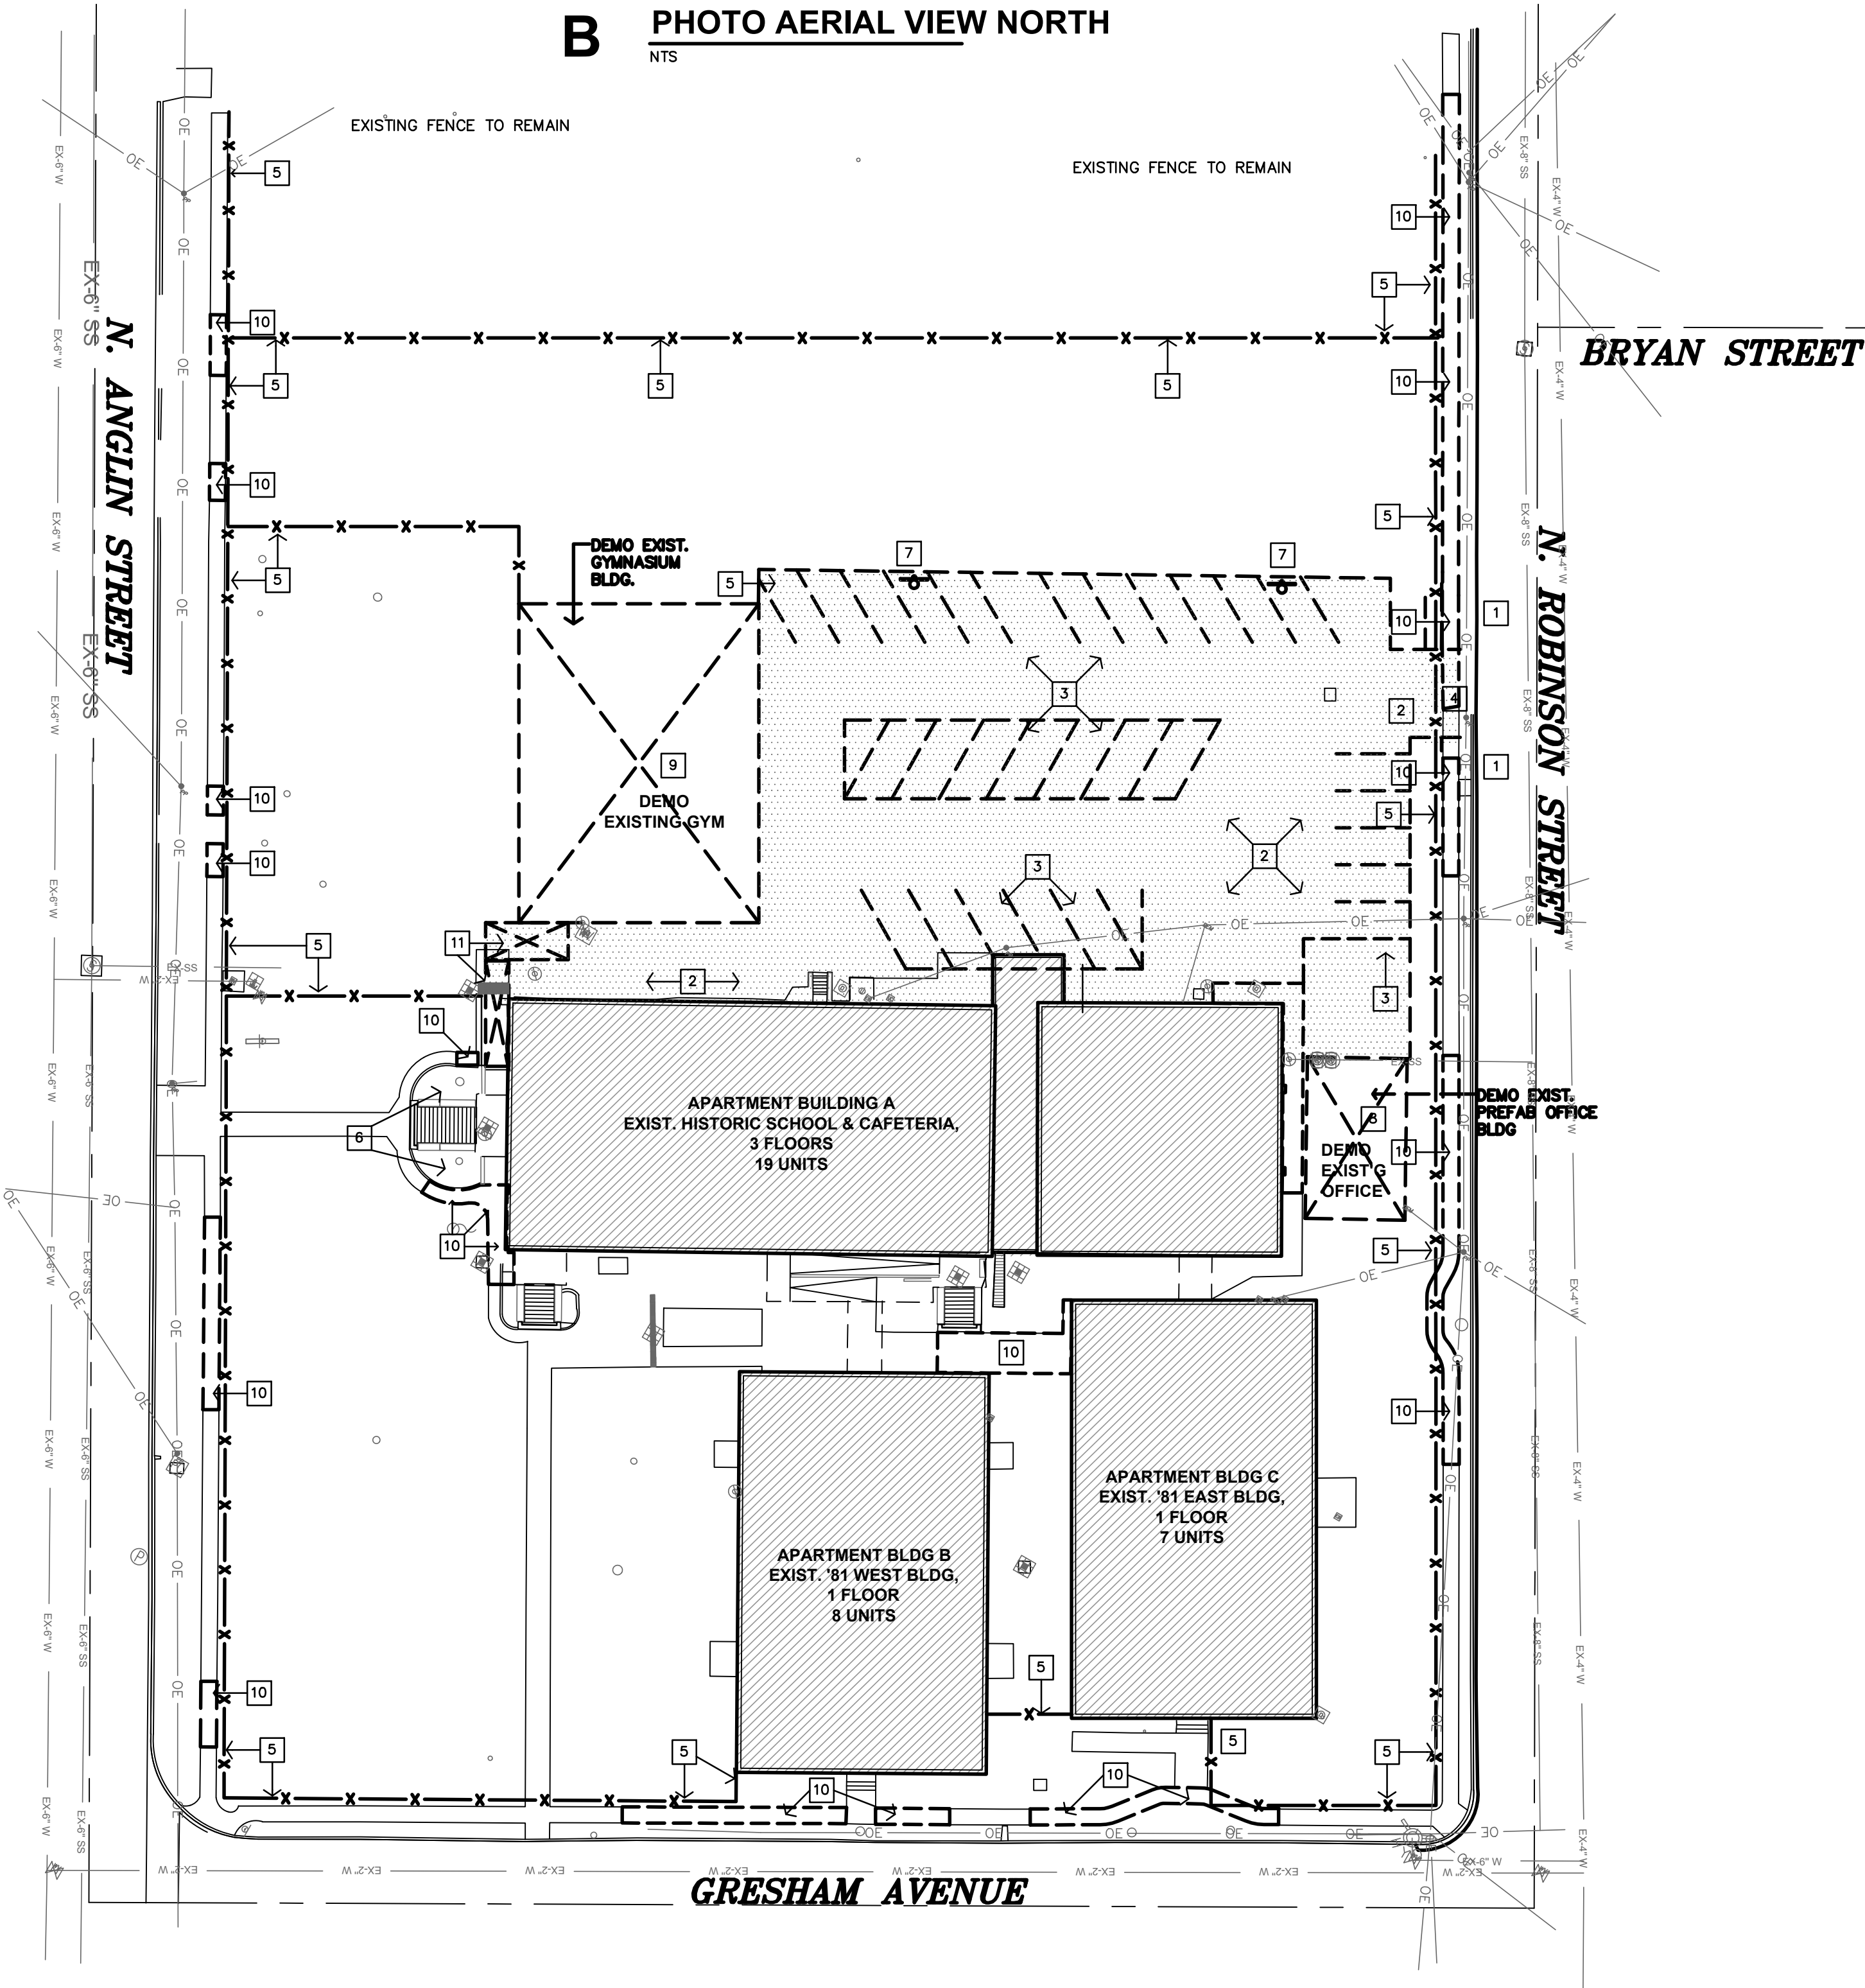

A SITE DEMOLITION PLAN
1"=30'-0"


DEMOLITION SITE PLAN NOTES	
GENERAL	
1. GENERAL CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS & DIMENSIONS.	
2. CONTRACTOR SHALL COORDINATE ALL WORK WITH THE REQUIREMENTS OF THE UTILITY COMPANIES AND THE CITY OF ABILENE, TEXAS.	
3. WHERE EXISTING BLDG. & SITE COMPONENTS ARE TO BE REMOVED, PATCH & REPAIR THE SURFACES TO MATCH EXIST. UNLESS NOTED OTHERWISE.	
4. REMOVE EXIST. BLDG. & SITE COMPONENTS AS INDICATED, IMPLIED OR AS REQUIRED SCHEMATICALLY SHOWN AS DASHED LINES. FIELD VERIFY ALL LOCATIONS.	
5. THE ELECTRICAL & MECHANICAL CONTRACTORS SHALL BE RESPONSIBLE FOR ALL CORE DRILLING FOR PIPING & CONDUIT INSTALLATION.	
6. ALL OTHER CUTTING, PATCHING & FINISHING, U.N.O. SHALL BE THE RESPONSIBILITY OF THE GENERAL CONTRACTOR.	
7. DEMOLITION PLAN IS SCHEMATIC AND FOR REFERENCE PURPOSES. CONTRACTOR SHALL BE RESPONSIBLE FOR ALL DEMOLITION, REMOVAL OF ITEMS, PATCHING, AS REQUIRED FOR NEW CONSTRUCTION. CONTRACTOR SHALL VISIT AND BECOME FAMILIAR WITH THE SITE PRIOR TO BIDDING AND INCLUDE IN HIS BID ALL DEMOLITION PLANS.	
8. REFERENCE COMPLETE CONSTRUCTION DOCUMENTS FOR ADDITIONAL SPECIFIC DEMOLITION REQUIREMENTS.	
9. REFERENCE SURVEY, MECHANICAL & ELECTRICAL DRAWINGS FOR ADDITIONAL SITE DEMOLITION AND SITE ELEMENTS.	
SPECIFIC	
1	REMOVE EXIST. CONCRETE DRIVE AND CURBS INTO PARKING LOT. AREA TO RECEIVE NEW CURB AND GUTTER AND NEW LANDSCAPING. REFERENCE SHEET A1.1 AND SHEET L1.1.
2	REMOVE PORTION OF EXIST. ASPHALT/CONCRETE PARKING LOT OR STREET(SHOWN AS DOTTED HATCH). REFERENCE SHEET A1.1 AND L1.1.
3	REMOVE EXISTING PARKING STRIPES & DRIVE DESIGNATIONS. ENTIRE PARKING LOT TO BE RE-SURFACED AND RE-STRIPED. REFERENCE SHEET A1.1.
4	REMOVE EXISTING DRIVE/CURBS AND GUTTERS. APPROACH/DRIVE TO BE RE-CONFIGURED. REFERENCE SHEET A1.1.
5	REMOVE EXISTING CHAIN LINK FENCE AND ALL ASSOCIATED POSTED, GATES, ACCESSORIES, ETC.
6	REMOVE EXISTING TREE.
7	REMOVE EXISTING BASKETBALL POLE, BACKBD & RIM.
8	REMOVE EXISTING OFFICE AND ALL ASSOCIATED FOUNDATIONS AND SLABS.
9	REMOVE EXISTING GYMNASIUM AND ALL ASSOCIATED FOUNDATIONS AND SLABS.
10	REMOVE EXISTING SIDEWALK/PATH. SHOWN AS CONCRETE HATCH
11	REMOVE EXISTING CANOPY & ALL ASSOCIATED FOUNDATIONS & COLUMNS



D PHOTO OF EXTERIOR
NTS




C PHOTO INTERIOR HALLWAY
NTS

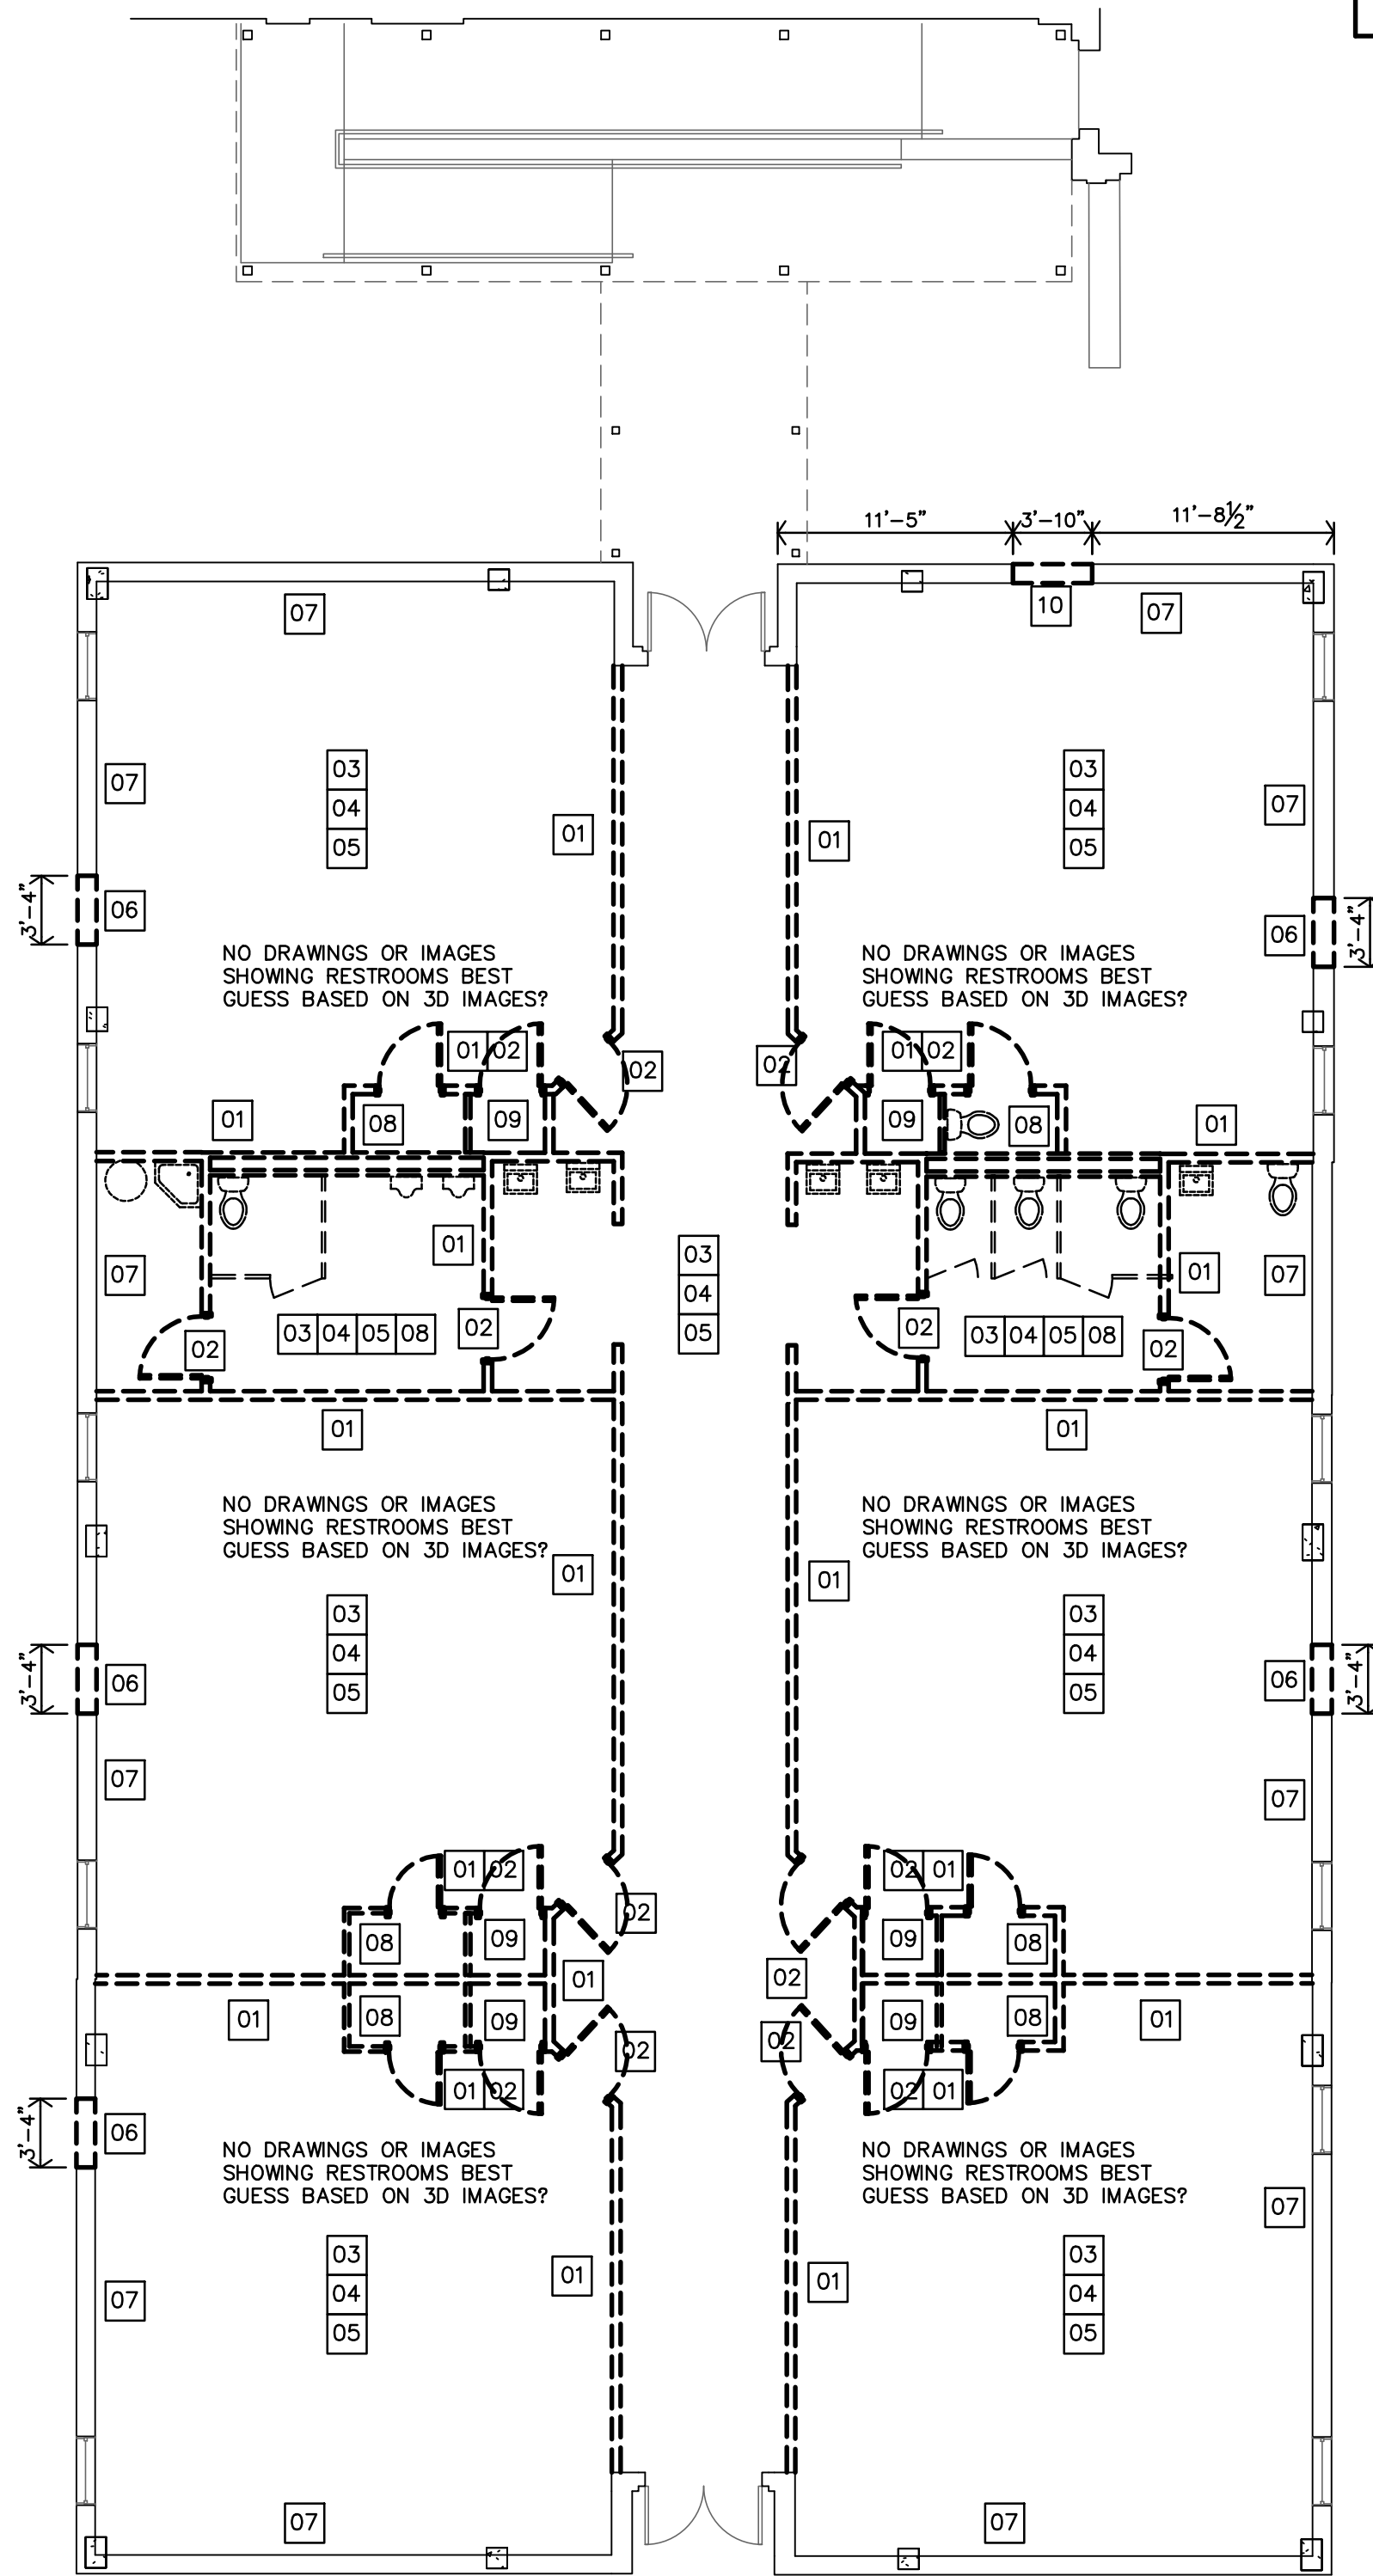

B '81 (WEST) BLDG
BLDG B DEMO FLR PLAN
1/8"=1'-0" 5,780 SF

- SPECIFIC DEMOLITION NOTES**
- 01 REMOVE EXISTING WALLS WITH ASSOCIATED ATTACHMENTS, CHALK &/OR TACK BOARDS, AS SHOWN SCHEMATICALLY BY DASHED LINES. PATCH AND REPAIR EXISTING CEILING, ADJACENT WALLS AND FLOOR AS NEEDED.
 - 02 REMOVE EXISTING DOOR AND FRAME, PREP FOR NEW AS SCHEDULED.
 - 03 REMOVE EXISTING FIXTURES, SHELVES, AND CASEWORKS
 - 04 REMOVE EXISTING ACOUSTIC DROPPED CEILINGS & ASSOCIATED LIGHTS, GRILLS, DUCTWORK, CONDUIT, WIRING, PIPING, ETC.
 - 05 REMOVE EXISTING FLOOR FINISHES, TILE AND/OR CARPET, PREP FOR NEW
 - 06 SAWCUT AND REMOVE PORTION OF WALL FOR NEW WINDOW, ADD HEADER & FRAMING AS REQUIRED
 - 07 ** INVESTIGATE IF GYP WALLS & INSULATION STAYS, IECC ?** OR FURR OUT ?
 - 08 REMOVE RESTROOM PARTITIONS, PLUMBING FIXTURES, GRAB BARS, PIPING, ETC. CAP DRAIN LINES AT SEWER CONNECTION. REFERENCE MEP NOTES & DRAWINGS.
 - 09 REMOVE ALL HVAC, DUCTWORK, WIRING, ELECTRICAL & PIPING, AND ANY ATTACHED OR ASSOCIATED EQUIPMENT OR ACCESSORIES. REFERENCE MEP NOTES & DRAWINGS.
 - 10 SAWCUT AND REMOVE PORTION OF WALL FOR NEW DOOR & FRAME, ADD HEADER & FRAMING AS REQUIRED

- GENERAL DEMOLITION NOTES**
- 1. WHERE EXISTING BLDG. COMPONENTS ARE TO BE REMOVED; PATCH & REPAIR THE SURFACES TO MATCH EXISTING FINISH, UNLESS NEW FINISHES ARE CALLED FOR IN THE FINISH SCHEDULE.
 - 2. REMOVE EXISTING BLDG. COMPONENTS AS INDICATED, IMPLIED OR AS REQUIRED SCHEMATICALLY SHOWN AS DASHED LINES. FIELD VERIFY ALL LOCATIONS.
 - 3. THE ELECTRICAL & MECHANICAL CONTRACTORS SHALL BE RESPONSIBLE FOR ALL CORE DRILLING FOR PIPING & CONDUIT INSTALLATION.
 - 4. ALL OTHER CUTTING, PATCHING & FINISHING, U.N.O. SHALL BE THE RESPONSIBILITY OF THE GENERAL CONTRACTOR.
 - 5. SHORING OF EXISTING STRUCTURE SHALL BE THE RESPONSIBILITY OF THE GENERAL CONTRACTOR.
 - 6. NOTIFY ARCHITECT IMMEDIATELY IF ASBESTOS IS SUSPECTED ON SITE. DO NOT DISTURB UNLESS DIRECTED.
 - 7. IT SHALL BE THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO COORDINATE THE DEMOLITION BY DIFFERING TRADES.
 - 8. CONTRACTOR COORDINATE SCHEDULE & LOCATION OF ANY OR ALL EXISTING RECEPTACLES, SWITCHES, DEVICES, ETC. PRIOR TO DEMOLITION, RELOCATE OR ABANDON ACCORDINGLY.
 - 9. COORDINATE & REFERENCE MECHANICAL & ELECTRICAL DRAWINGS FOR ADDITIONAL DEMOLITION ITEMS AND DETAILS

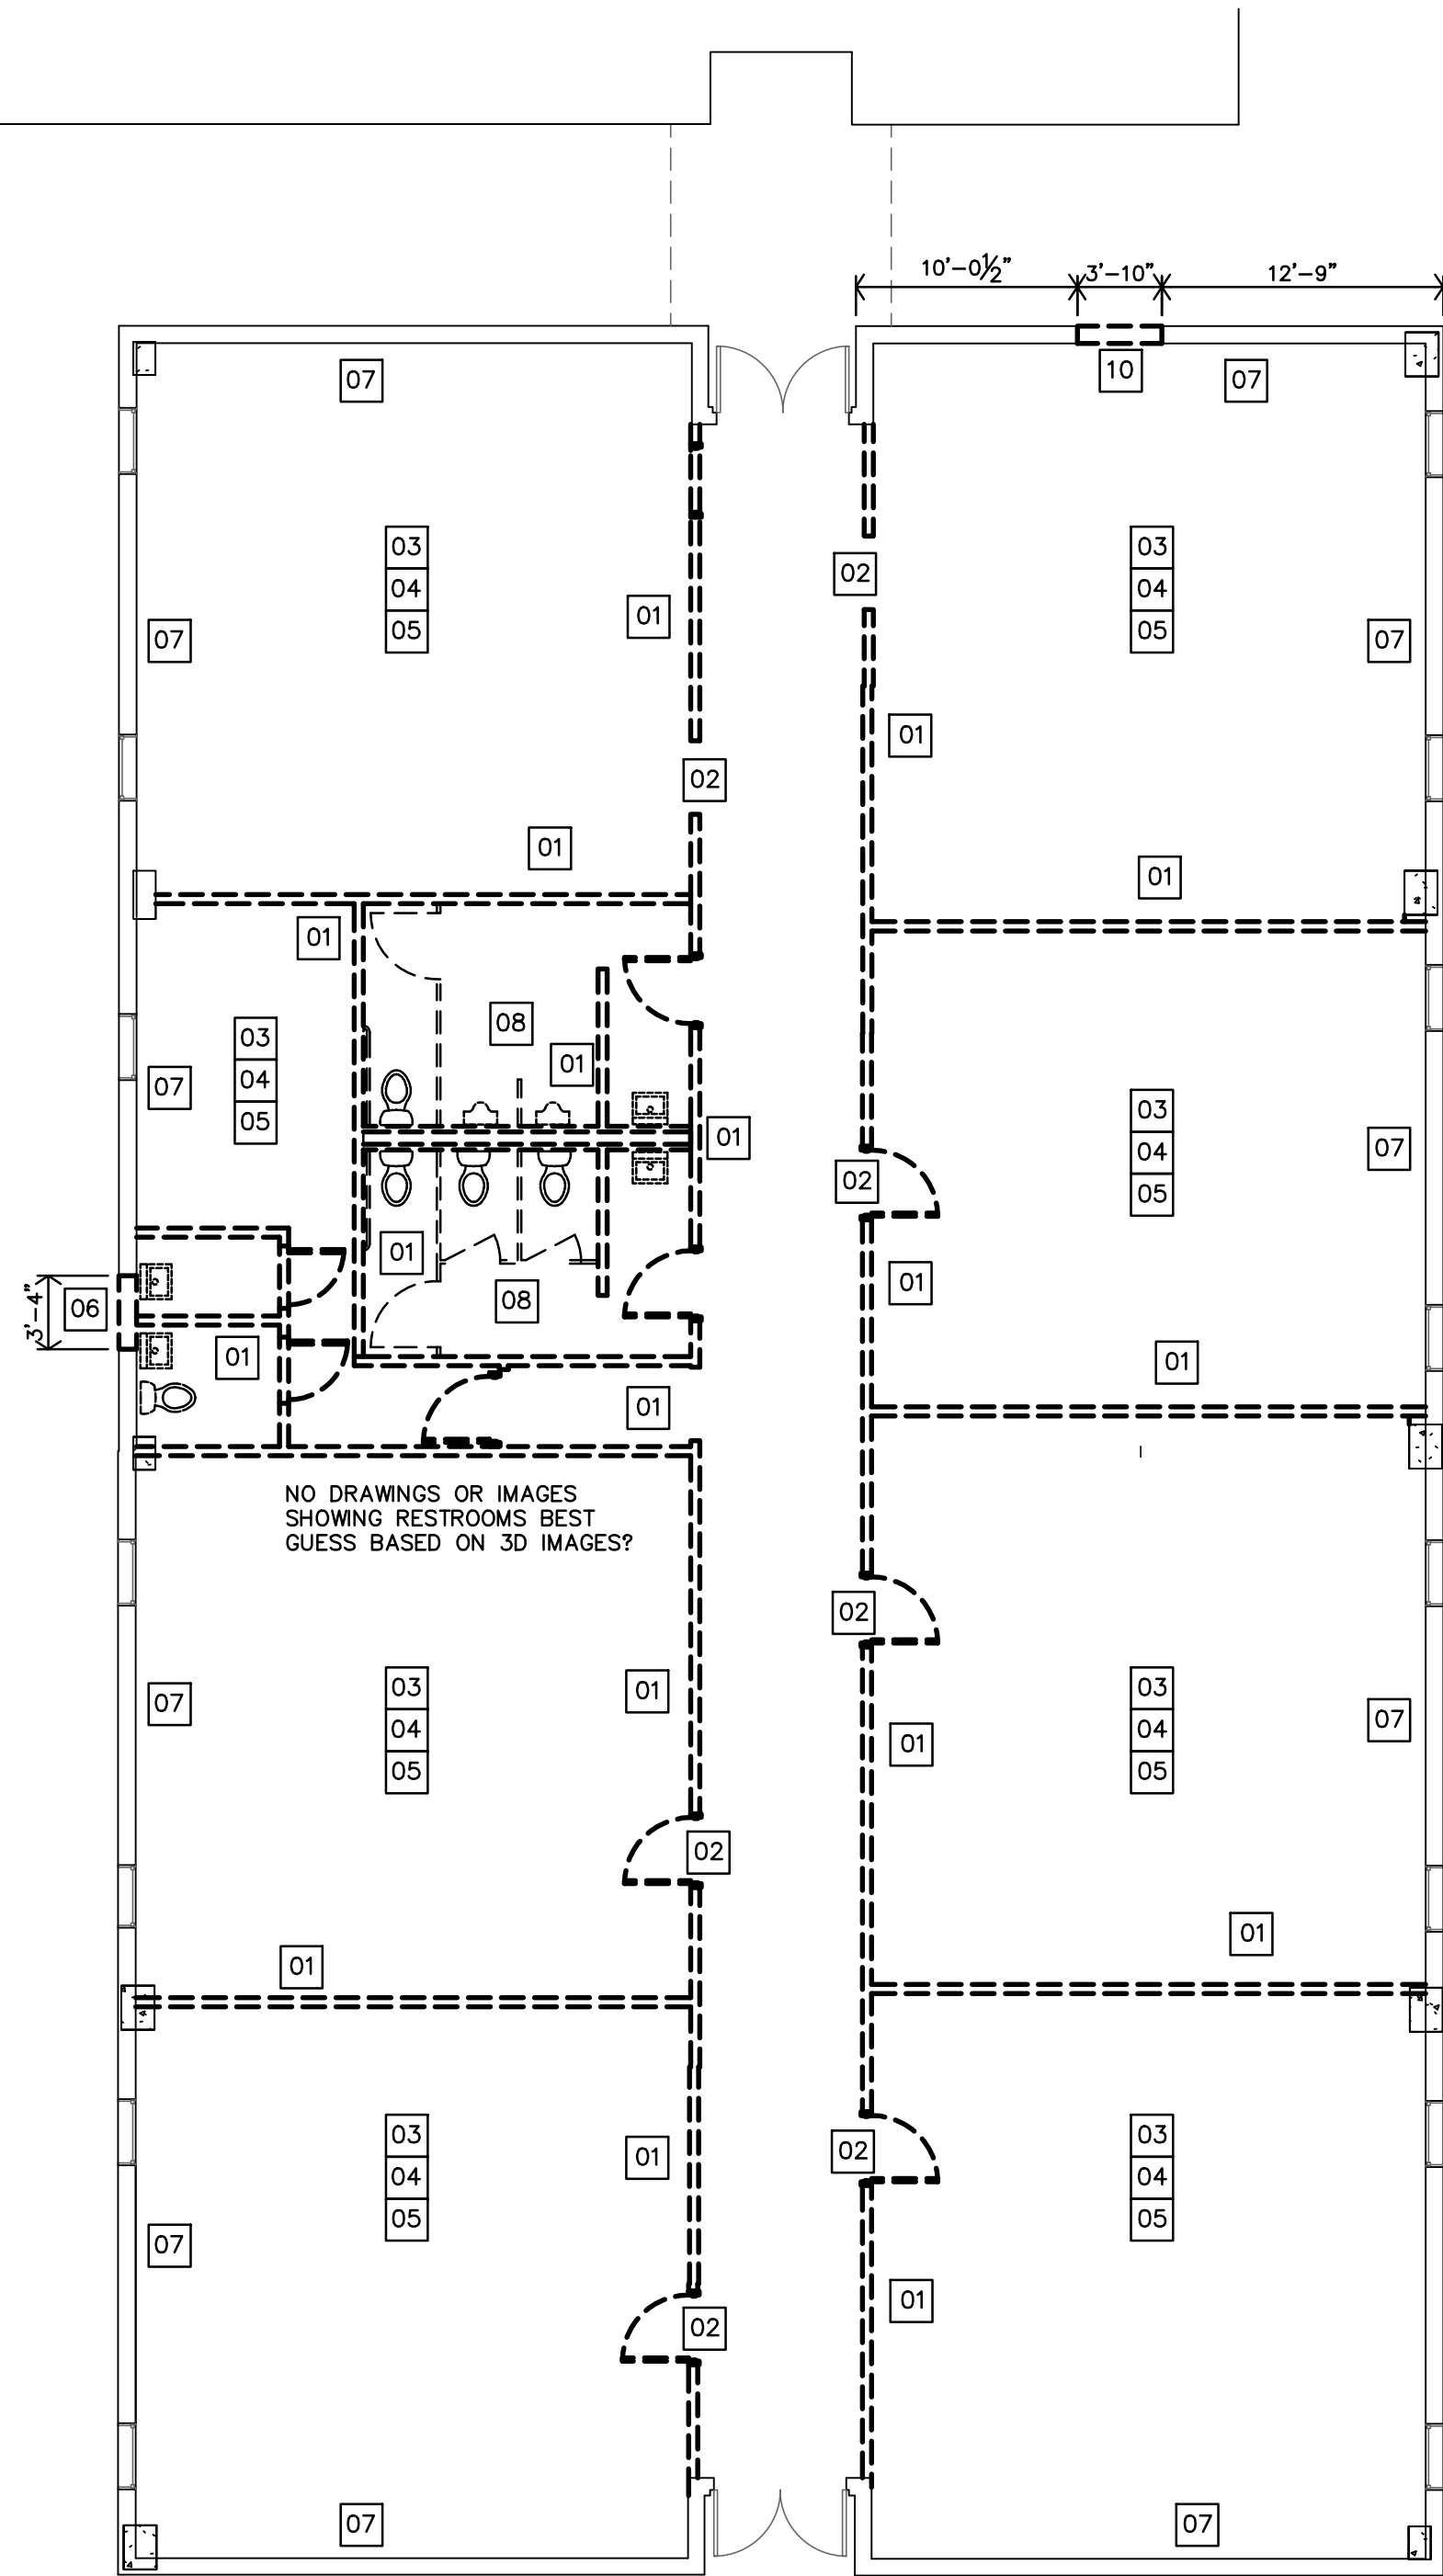

A '81 (EAST) BLDG
BLDG C DEMO FLR PLAN
1/8"=1'-0" 5,922 SF

BUILDINGS B & C



REVISION:

DATE: 11-20-2025
JOB: 25-3479
SHEET NO.:

DBC2.3

THE IRVING LOFTS
HISTORIC RESTORATION & REHAB APARTMENTS
CLEBURNE, TEXAS

JCR JonesGillamRenz
1881 Main Street, Suite 301
Kansas City, MO 64108
730 N. Ninth
Salina, KS 67401
785-827-0386
jgr@jgarchitects.com

COPYRIGHTED ©

HISTORIC PRESERVATION NOTES

- STRUCTURE, MASONRY AND EXTERIOR WALLS
- STRUCTUTURAL REPAIRS SHALL BE MINIMALLY VISIBLE FROM THE EXTERIOR.
 - ALL DECORATIVE MASONRY MUST REMAIN.
 - MASONRY/BRICK CLEANING MUST BE OF THE GENTLEST MEANS POSSIBLE. CLEANING SHALL BE IN ORDINANVE WITH NPS BREIF 1, AND THE GSA GUIDELINES FOR CLEANING EXTERIOR BRICK. CONTACT AND REFER TO HISTORIC CONSULTANTS/SPECIALISTS FOR TREATMENT OPTIONS.
 - MASONRY REHABILITATION SHALL CONSIST OF SPOT REPOINTING AND REPAIR/REPLACEMENT OF ISOLATED DETERIORATION. ALL WORK SHALL CONFORM TO PRESERVATION STANDARDS OUTLINED IN THE NATIONAL PARK SERVICE PRESERVATION BRIEFS 1.2 & 6. DETERIORATED MORTAR SHOULD BE REMOVED TO SOUND MORTAR. NEW MORTAR SHOULD MATCH EXISTING IN COLOR, TEXTURE, COMPOSITION, AND JOINT PROFILE.
 - NATIONAL PARK SERVICE BRIEF 2 SPECIFIES THE RECOMMENDED COMPOSITION OF MORTARS USED IN HISTORIC BUILDINGS..
- WINDOWS
- EXISTING WINDOWS IN THE 1915 ARE NOT HISTORICAL, AND WILL BE REPLACED. WINDOWS IN THE 1952 CAFETORIUM ARE TO BE CLEANED, REPAIRED AND PROTECTED. NEW WINDOWS ARE PROPOSED, MATCH WINDOWS VISIBLE IN HISTORIC IMAGES. NEW WINDOWS WILL BE CLAD-WOOD, OR ALUMINUM. ALUMINUM WILL HAVE A PAINT-LIKE OR BAKED ON FINISH. NEW WINDOWS SHALL BE TRUE DIVIDED OR SIMULATED. SIMULATED WILL HAVE BOTH EXTERIOR AND INTERIOR MUNTIN GRIDS. INSULATED, SHALL HAVE GRID BETWEEN PANES OF GLASS S WELL. WINDOWS WILL BE OPERABLE AND/OR FIXED TO HAVE AN OFFSET UPPER SASH SO THAT THEY MIMIC THE HUNG WINDOW CONFIGURATION. HISTORIC GLASS IN NEW WINDOWS MUST BE CLEAR, COLORLESS, AND NON-REFLECTIVE WITH NO LESS THAN 69% VLT AND NO GREATER THAN 11% VLR.
 - ANY EXISTING WINDOWS BEING RETAINED ARE TO BE REPAIRED TO THE GREATEST MEANS POSSIBLE WITH ANY MISSING OR DETERIORATED PARTS REPLACED IN KIND.
- ROOFS
- EXISTING COPING MUST REMAIN, ANY NEW FLASHING OR COPING SHALL NOT BE VISIBLE FROM THE GROUND.
 - SCUPPERS AND DOWNSPOUTS SHOULD BE REPAIRED WHERE EVER POSSIBLE, ANY NEW DOWNSPOUTS SHOULD MATCH EXISTING.
- VERTICAL CIRCULATION
- STAIRS TO REMAIN, AND BE REPAIRED & RE-FINISHED AS NEEDED.
 - IF ADDITIONAL RAILINGS ARE REQUIRED TO MEET CODE, THEY SHOULD BE SIMPLE AND COMPATIBLE WITH THE BUILDING.
 - THE NEW ELEVATOR TOWER SHALL BE COMPATIBLE WITH THE MATERIALS AND MASSING OF THE 1915 BUILDING.
- INTERIOR
- THE WOOD STAGE SHALL REMAIN AND BE REPAIRED AS NEEDED. REPAIRS ARE TO BE KNITTED INTO THE EXISTING PATTERN.
 - CMU IN THE CAFETORIUM WILL BE PAINTED.
 - THE CORRIDOR CONFIGURATION SHALL REMAIN INTACT
 - EXISTING OFFICE AND CLASSROOM OPENINGS SHALL BE RETAINED AND REUSED WHERE POSSIBLE.
 - WHERE DOORS ARE NOT USED, THEY SHALL BE FIXED IN PLACE.
 - PLASTER WALLS AND CEILINGS THROUGHOUT ARE TO BE RETAINED AND REPAIRED IN ACCORDANCE WITH PRESERVATION BRIEF 21.
 - HEX TILE FLOORS MUST REMAIN AND BE REPAIRED. ANY MISSING TILES ARE TO BE REPLACED TO MATCH.
 - CONCRETE FLOORS IN THE BASEMENT SHALL REMAIN AND TO BE REPAINTED.
 - LAY-IN GRID CEILINGS ARE TO BE REMOVED THROUGHOUT. PROTECT HISTORIC PLASTER CEILINGS DURING LAY-IN DEMO.
 - SOFFITS & EXPOSED MEP WILL BE AVOIDED IN ALL CORRIDORS.
 - WHERE PARTITIONS INTERSECT WITH MULLIONS, PARTITION WILL BE NO WIDER THAN THE MULLION FOR 18" BACK FROM WINDOW.
 - AREAS OF DROPPED CEILINGS/SOFFITS WILL BE HELD BACK FROM WINDOWS A MINIMUM OF 4 FEET.
 - CARPETS ARE TO BE REMOVED TO REVEAL HISTORIC FLOORING. HISTORIC FLOOR IS TO BE RETAINED AND REPAIRED.
 - CHALKBOARDS/MILLWORK SHOULD BE RETAINED AND RE-USED WHERE POSSIBLE.
 - ANY HISTORIC FINISHES, OR FEATURES NOT PREVIOUSLY NOTED OR UNCOVERED, WILL BE SALVAGED AND RE-USED WHERE POSSIBLE.
- MECHANICAL, ELECTRICAL, PLUMBING, & SIGNAGE
- NEW HVAC SHALL RUN ABOVE CEILINGS AND DUCTS ARE NOT TO BE EXPOSED.
 - ROOFTOP EQUIPMENT SHALL NOT BE VISIBLE FROM GROUND.
 - NEW PLUMBING SHALL NOT BE EXPOSED.
 - ORIGINAL CAFETORIUM SPOTLIGHTS ARE TO REMAIN.
 - THE ORIGINAL IRVING SIGN IS TO BE REPAIRED AS NEEDED.
 - NEW SINAGE IS TO BE COMPATIBLE WITH BUILDING CHARACTER.
- LIGHTING & SIGNAGE
- NEW EXTERIOR LIGHTING FIXTURES SHOULD BE COMPATIBLE WITH THE CHARACTER OF THE BUILDING. ACCENT LIGHTING SHOULD BE VISIBLY UNOBTRUSIVE.
 - NEW INTERIOR LIGHTING SHOULD BE COMPATIBLE WITH THE CHARACTER OF THE BUILDING.
 - THE BLADE SIGN COULD BE REFERENCED IN SHAPE, SCALE, AND STYLE IN A NEW BLADE SIGN WITH THE BUILDING'S NEW NAME.
 - SMALLER SIGNS AT THE STOREFRONT LEVEL SHOULD BE INSTALLED ABOVE WINDOWS OR, IF NECESSARY, ANCHORED INTO MASONRY.





GENERAL DEMOLITION NOTES


- WHERE EXISTING BLDG. COMPONENTS ARE TO BE REMOVED; PATCH & REPAIR THE SURFACES TO MATCH EXISTING FINISH, UNLESS NEW FINISHES ARE CALLED FOR IN THE FINISH SCHEDULE.
- REMOVE EXISTING BLDG. COMPONENTS AS INDICATED, IMPLIED OR AS REQUIRED SCHEMATICALLY SHOWN AS DASHED LINES. FIELD VERIFY ALL LOCATIONS.
- THE ELECTRICAL & MECHANICAL CONTRACTORS SHALL BE RESPONSIBLE FOR ALL CORE DRILLING FOR PIPING & CONDUIT INSTALLATION.
- ALL OTHER CUTTING, PATCHING & FINISHING, U.N.O. SHALL BE THE RESPONSIBILITY OF THE GENERAL CONTRACTOR.
- SHORING OF EXISTING STRUCTURE SHALL BE THE RESPONSIBILITY OF THE GENERAL CONTRACTOR.
- NOTIFY ARCHITECT IMMEDIATELY IF ASBESTOS IS SUSPECTED ON SITE. DO NOT DISTURB UNLESS DIRECTED.
- IT SHALL BE THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO COORDINATE THE DEMOLITION BY DIFFERING TRADES.
- CONTRACTOR COORDINATE SCHEDULE & LOCATION OF ANY OR ALL EXISTING RECEPTACLES, SWITCHES, DEVICES, ETC. PRIOR TO DEMOLITION, RELOCATE OR ABANDON ACCORDINGLY.
- COORDINATE & REFERENCE MECHANICAL & ELECTRICAL DRAWINGS FOR ADDITIONAL DEMOLITION ITEMS AND DETAILS

SPECIFIC DEMOLITION NOTES

- 01 REMOVE NON HISTORIC LAY-IN TILE CEILING AND GRID. PROTECT HISTORIC PLASTER CEILINGS ABOVE
- 02 REMOVE NON HISTORIC ADHESIVE TILE CEILING
- 03 REMOVE NON HISTORIC GYPSUM CEILING
- 04 AREA OF HISTORIC PLASTER CEILINGS, DO NOT DEMO.

CEILING LEGEND

-  NON-HISTORIC LAY IN TILE CEILING
-  HISTORIC PLASTER CEILING
-  NON-HISTORIC ADHESIVE TILE CEILING
-  NON-HISTORIC GYPSUM CEILING

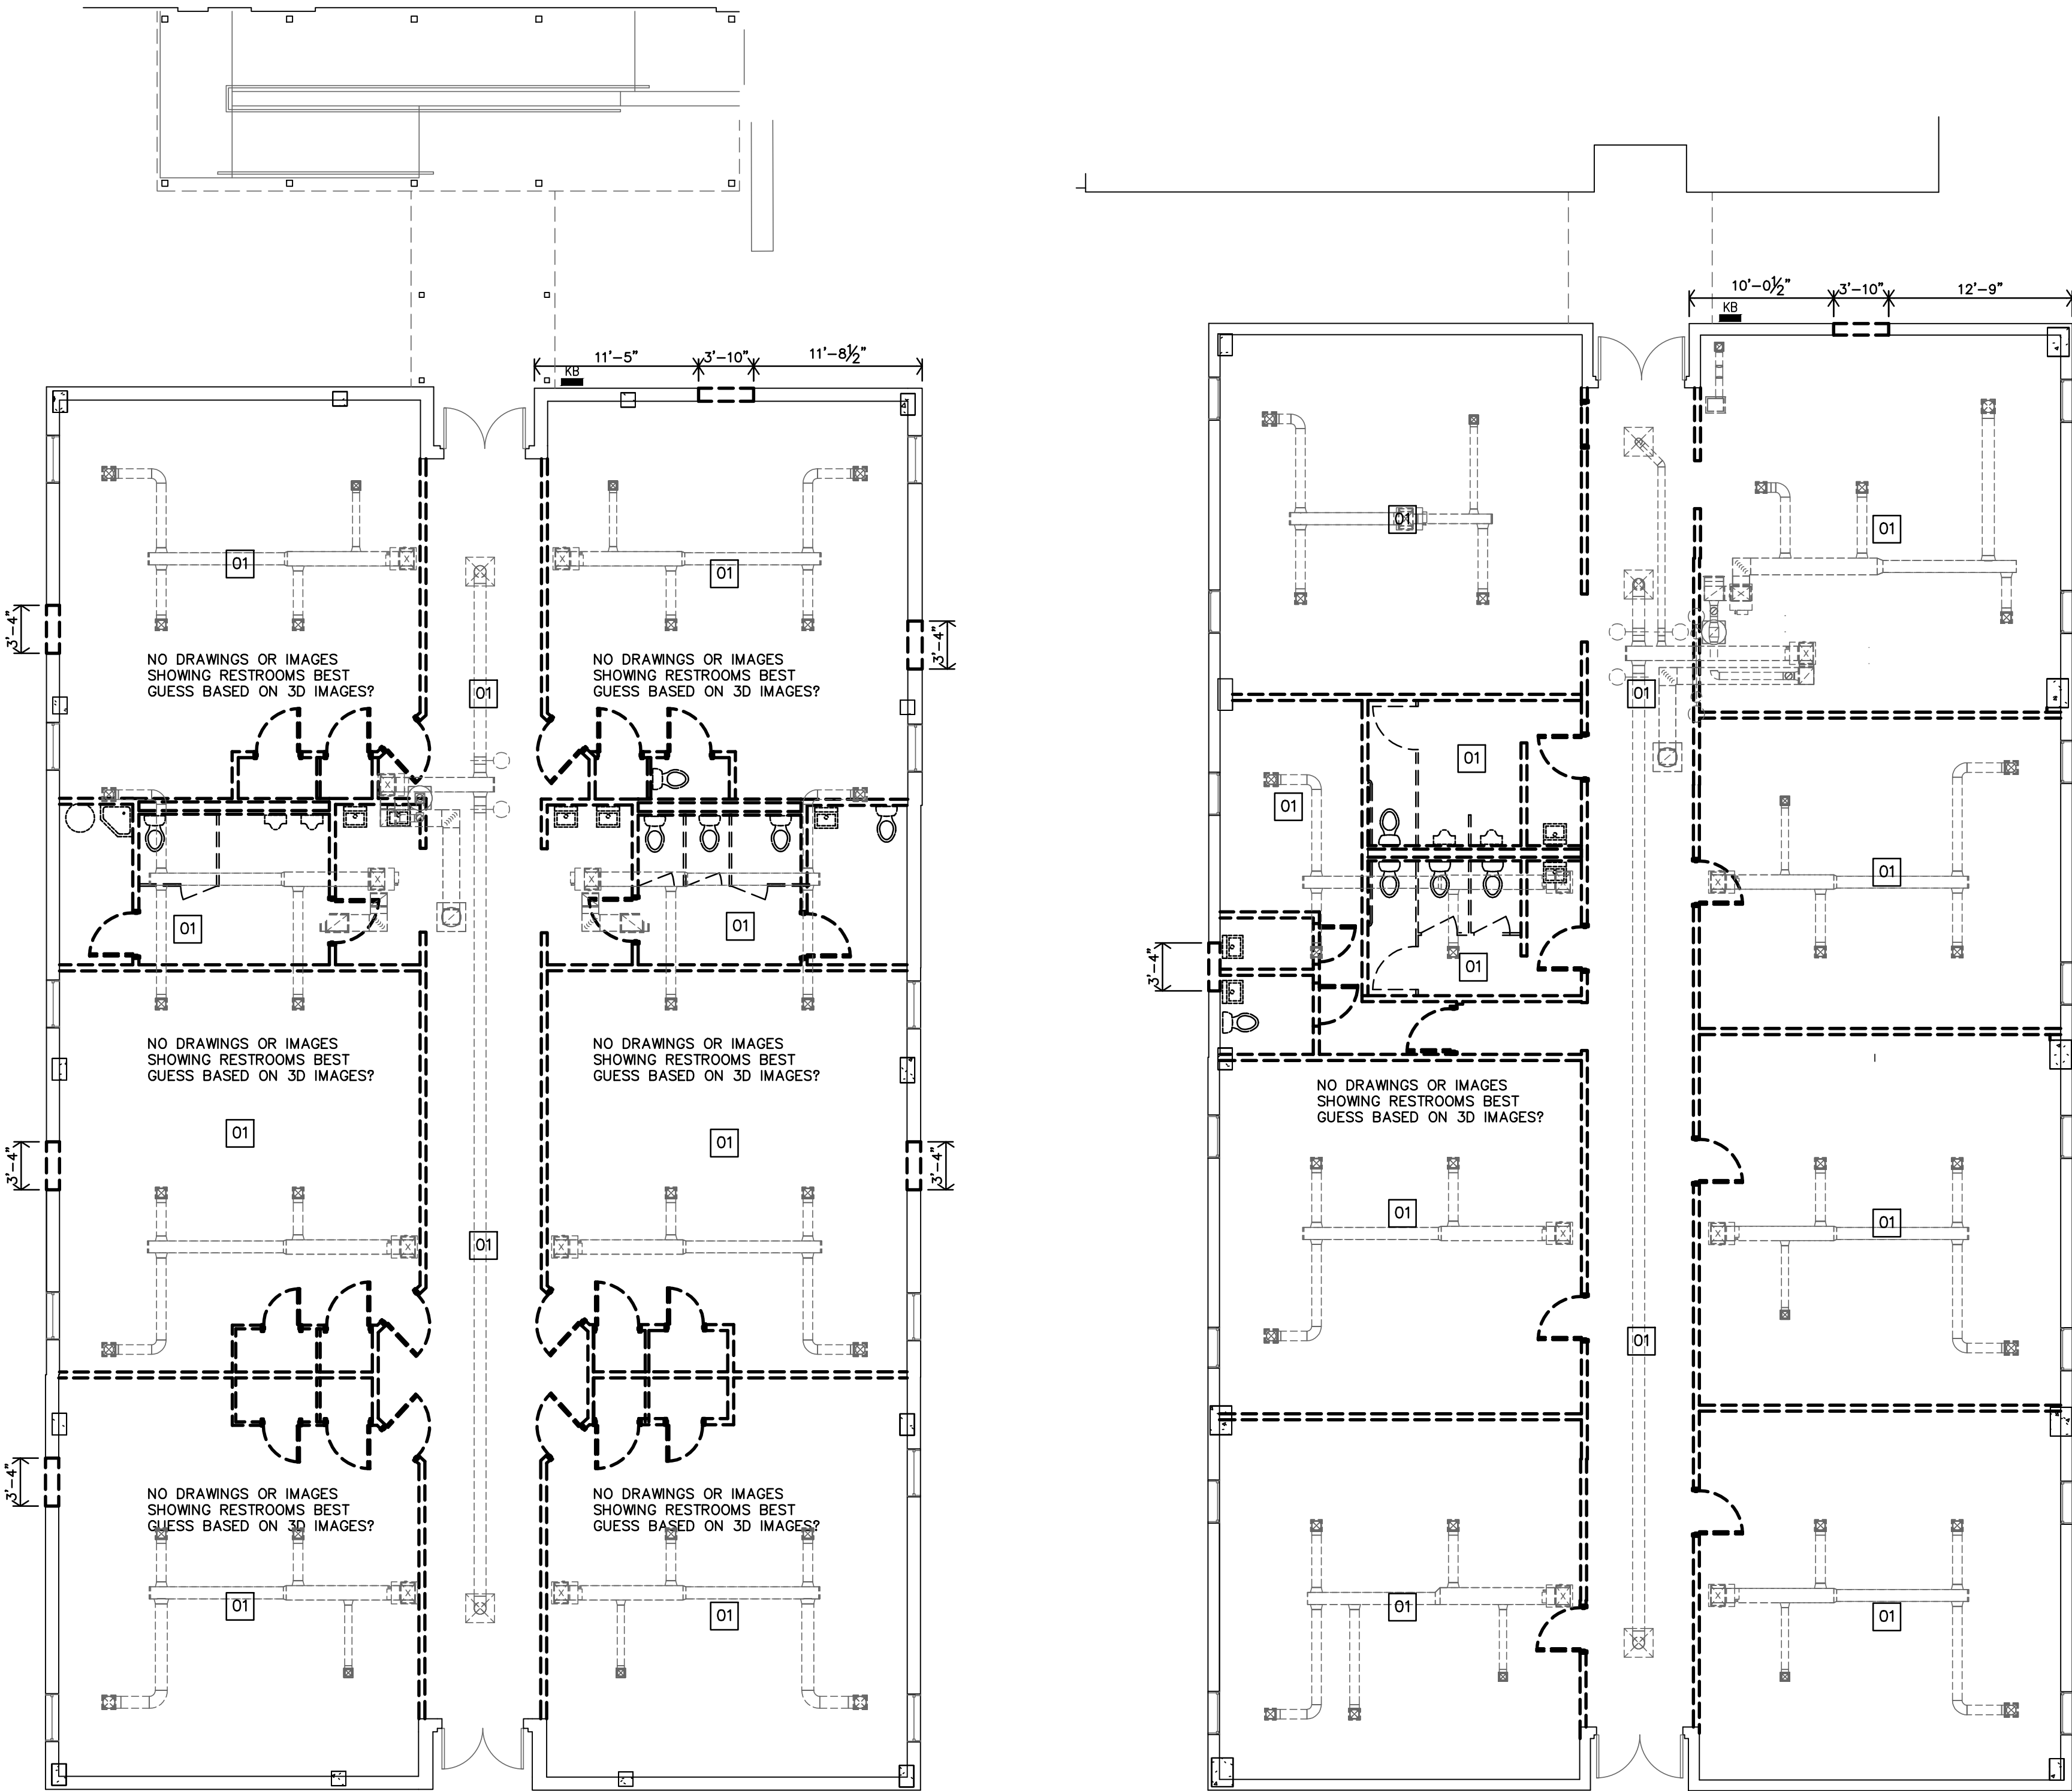

'81 (WEST) BLDG
BLDG B DEMO FLR REFLEC CLG
1/8"=1'-0" 5,780 SF

REMOVE DOORS, WALLS, FINISHES, ROOFING, MECH & ELECT EQUIPMENT AS INDICATED OR REQUIRED TO INSTALL NEW. HEAVY DOTTED LINES REPRESENT ITEMS AND ASSEMBLIES TO BE REMOVED.



'81 (EAST) BLDG
BLDG C DEMO FLR REFLEC CLG
1/8"=1'-0" 5,922 SF



REVISION:

DATE: 11-20-2025
JOB: 25-3479
SHEET NO.:



PHOTO 6

NTS



PHOTO 5

NTS



PHOTO 4

NTS



PHOTO 3

NTS





PHOTO 2

NTS





PHOTO 1

NTS

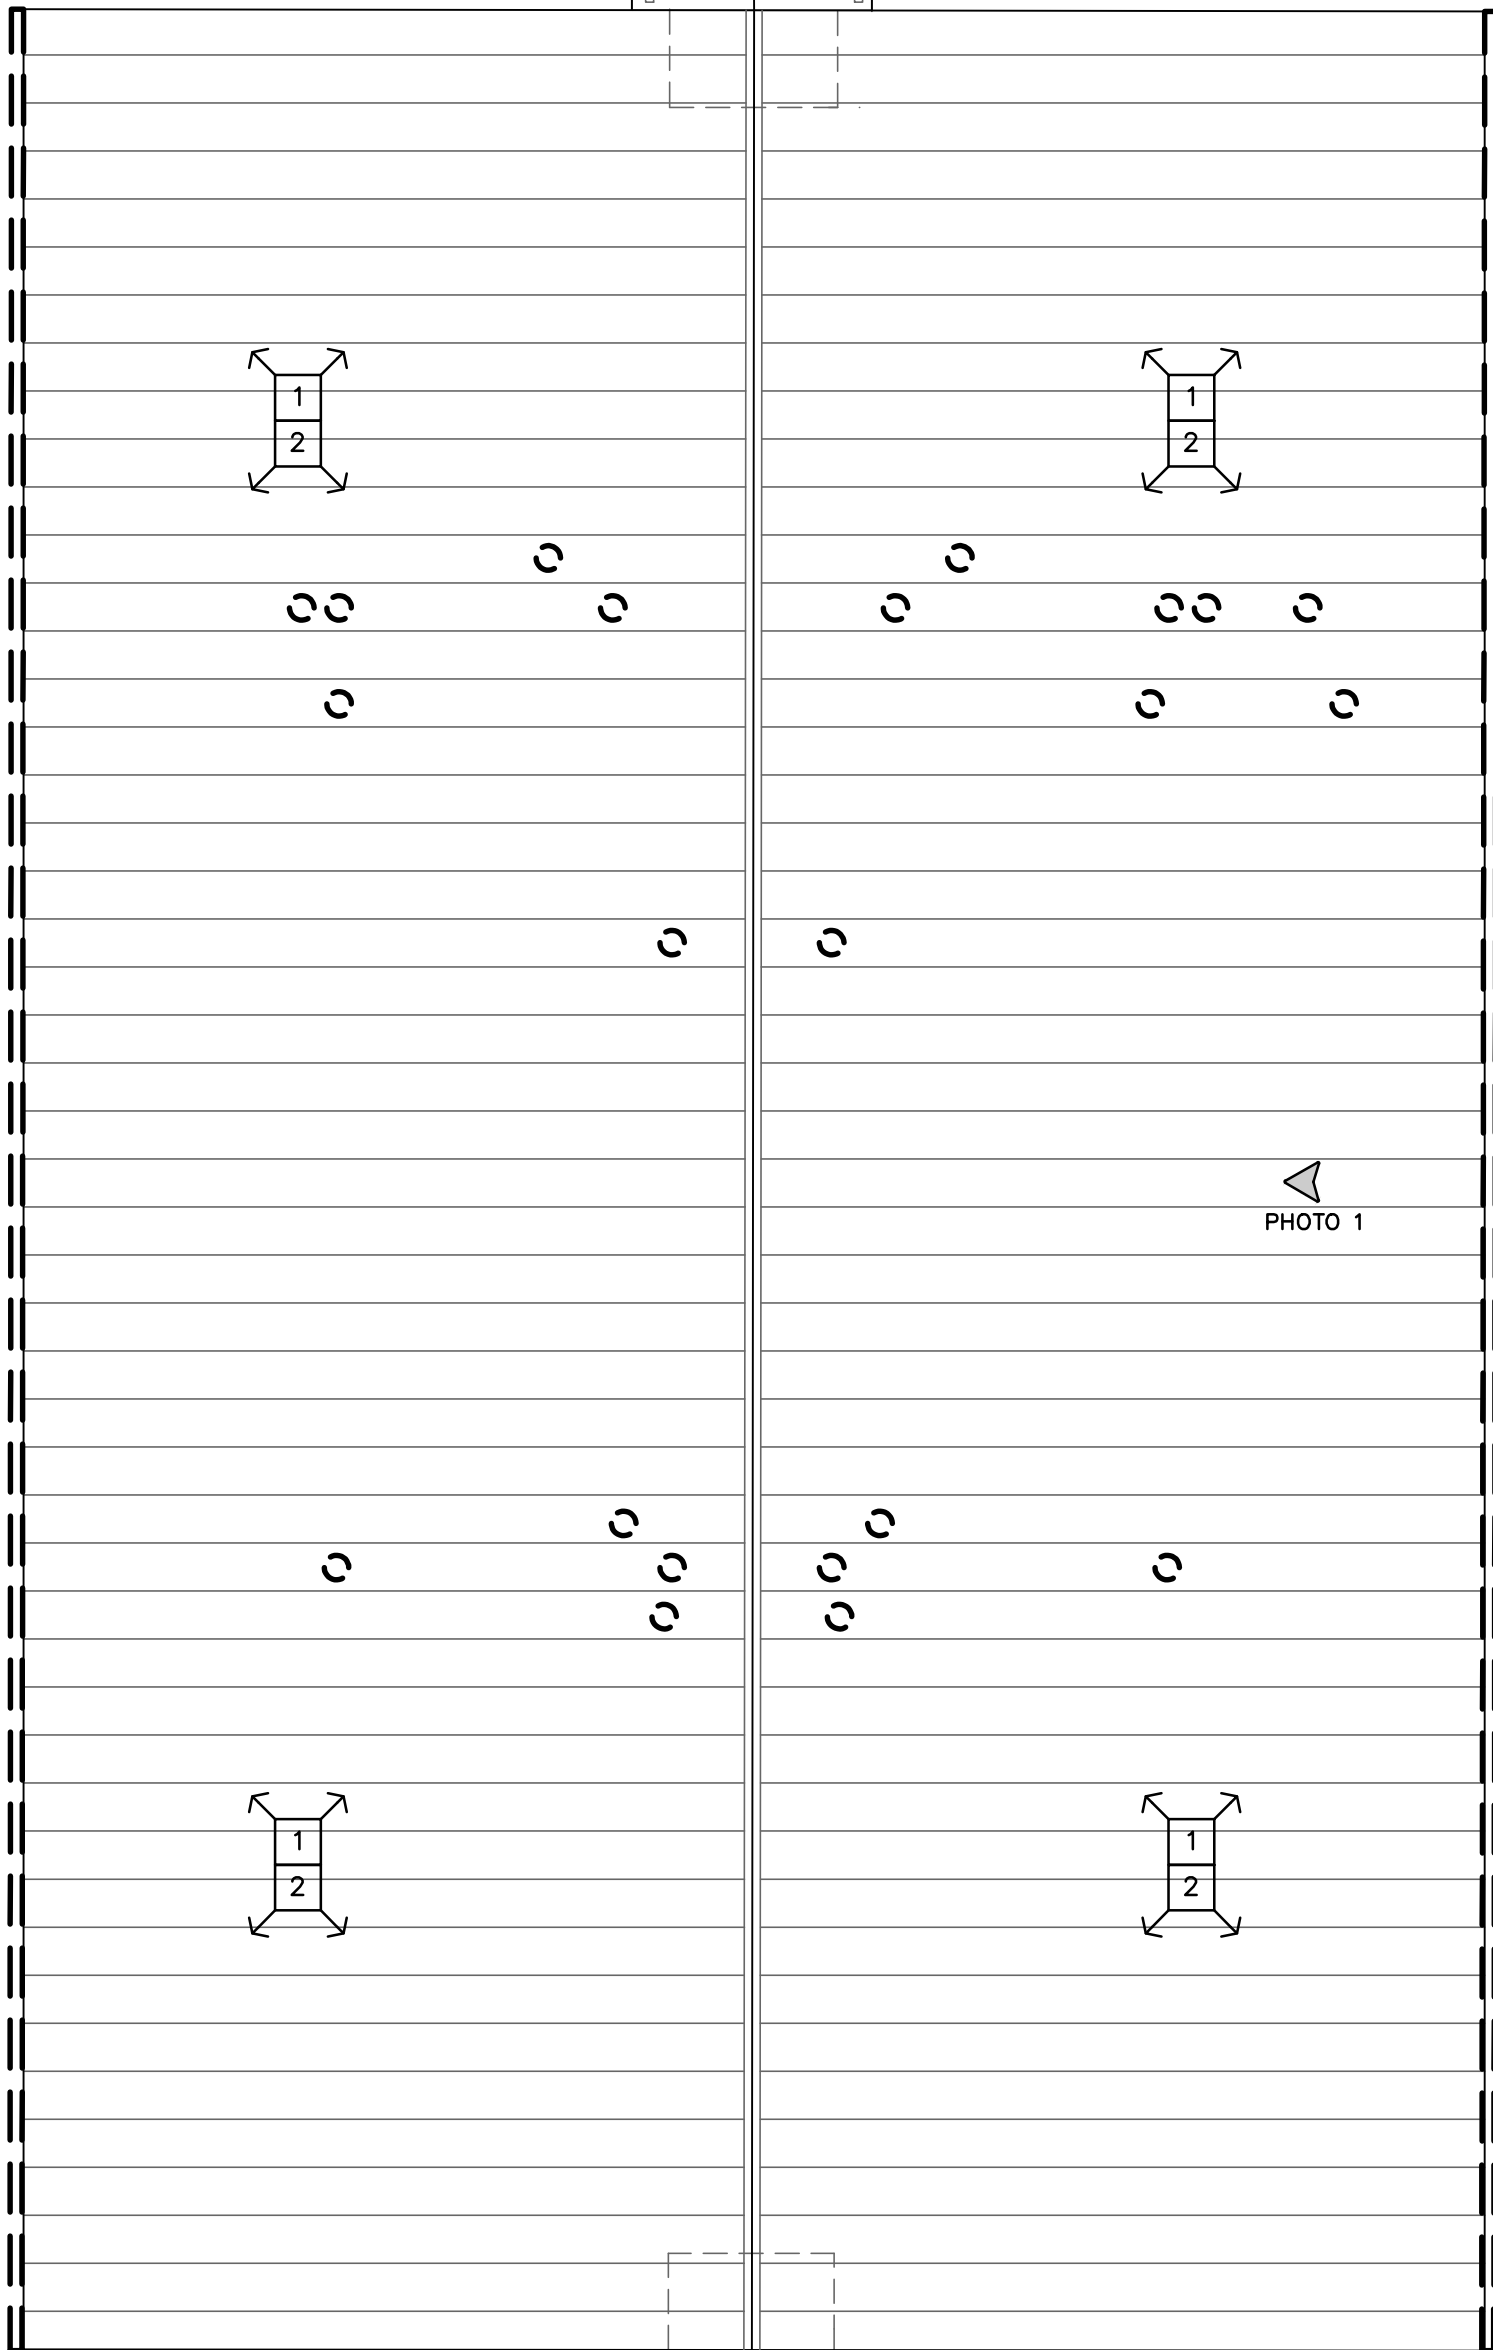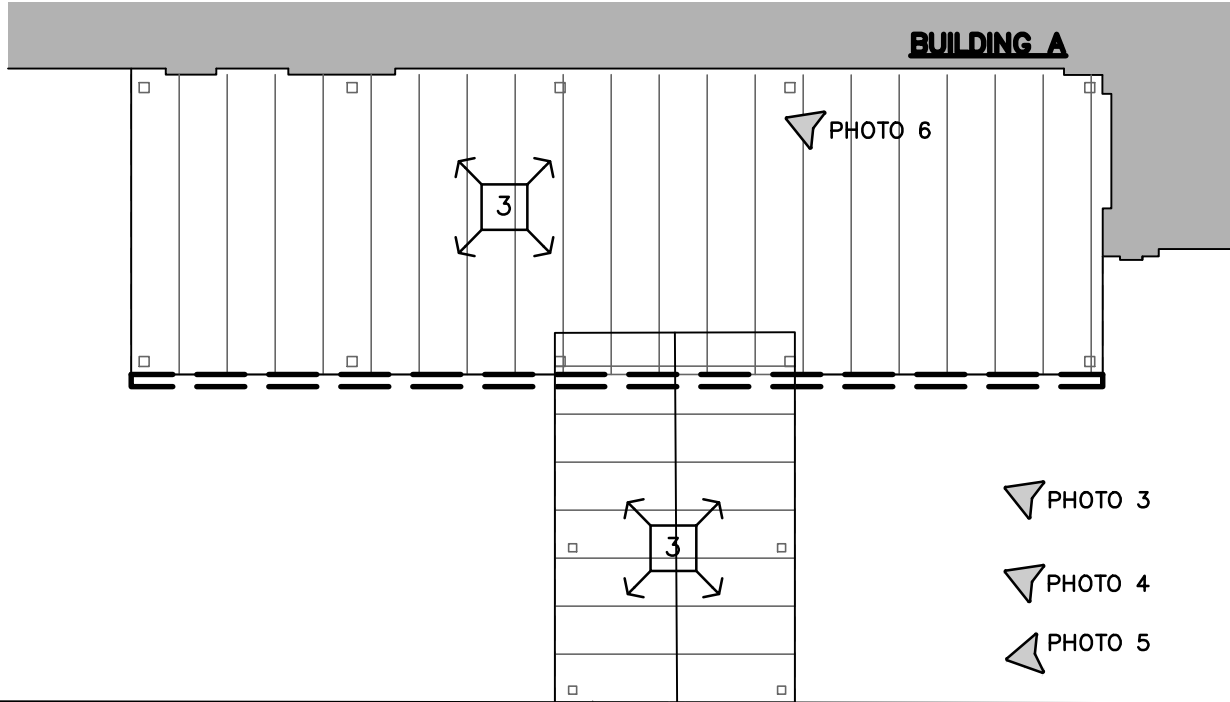

B

'81 (WEST) BLDG
BLDG B ROOF PLAN
1/8"=1'-0"

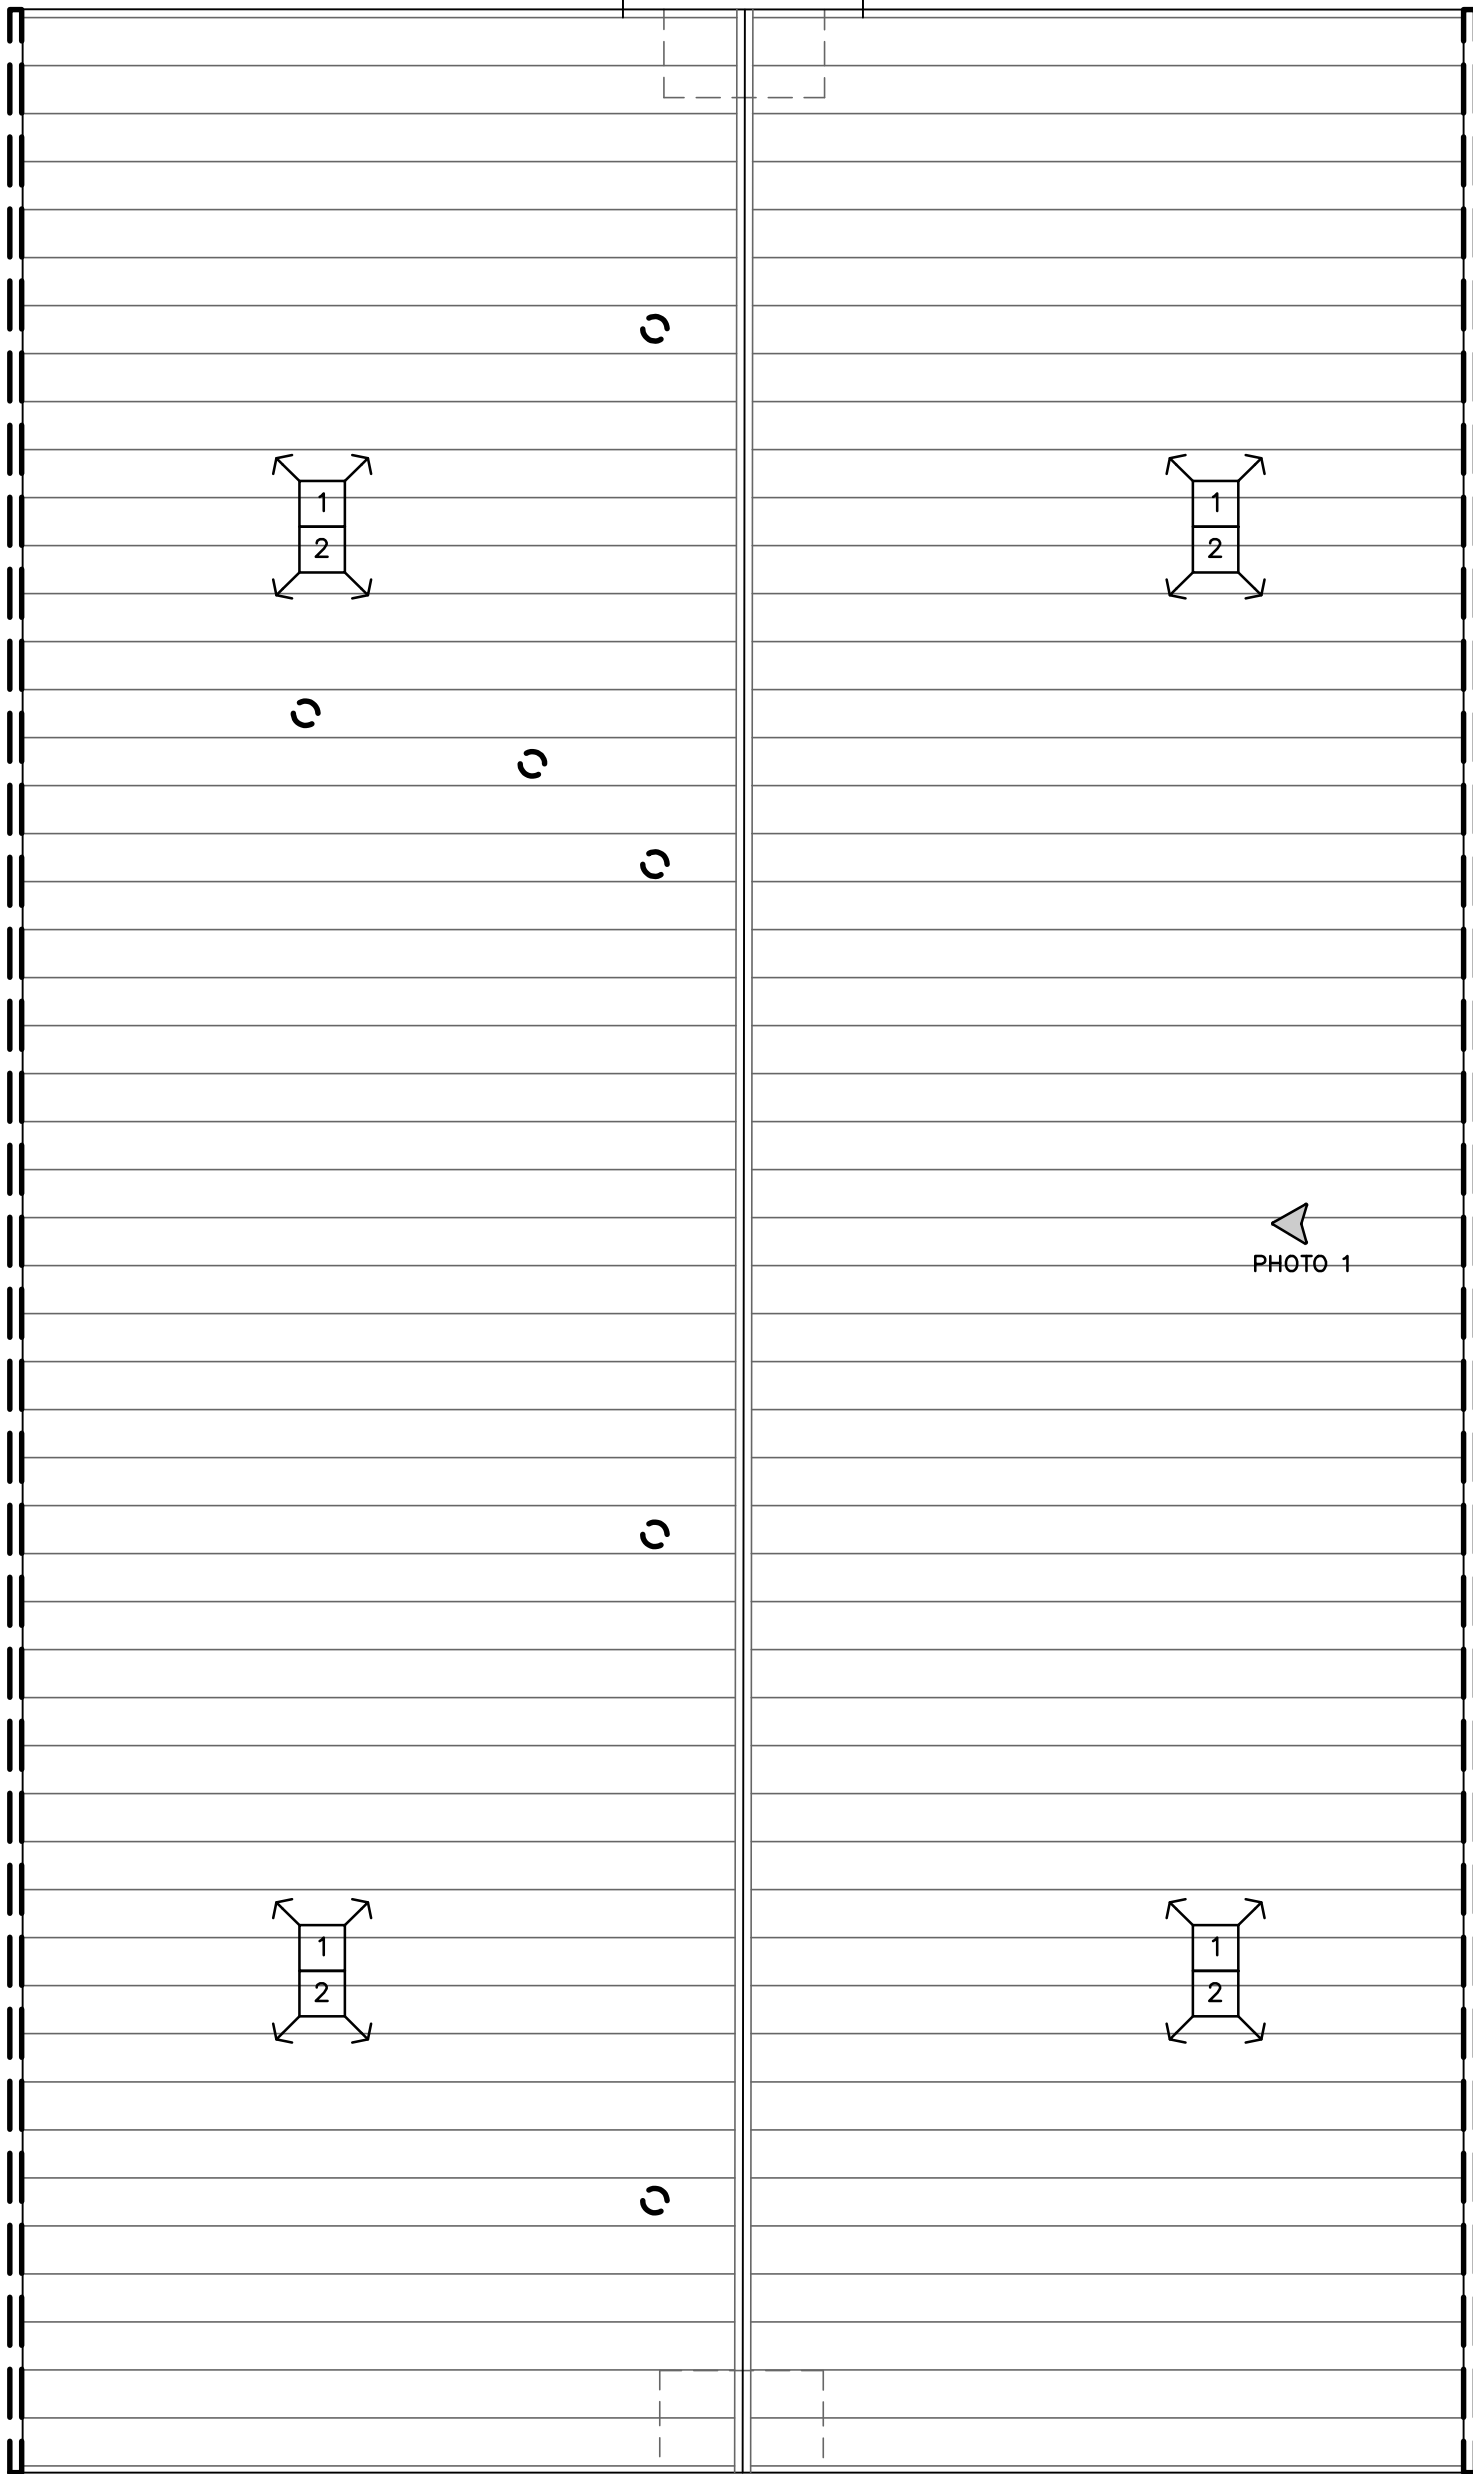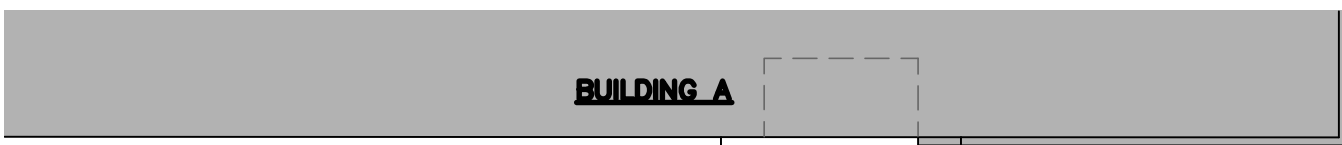

A

'81 (EAST) BLDG
BLDG C ROOF PLAN
1/8"=1'-0"

GENERAL DEMOLITION NOTES

1. WHERE EXISTING BLDG. COMPONENTS ARE TO BE REMOVED; PATCH & REPAIR THE SURFACES TO MATCH EXISTING FINISH, UNLESS NEW FINISHES ARE CALLED FOR IN THE FINISH SCHEDULE.
2. REMOVE EXISTING BLDG. COMPONENTS AS INDICATED, IMPLIED OR AS REQUIRED SCHEMATICALLY SHOWN AS DASHED LINES. FIELD VERIFY ALL LOCATIONS.
3. THE ELECTRICAL & MECHANICAL CONTRACTORS SHALL BE RESPONSIBLE FOR ALL CORE DRILLING FOR PIPING & CONDUIT INSTALLATION.
4. ALL OTHER CUTTING, PATCHING & FINISHING, U.N.O. SHALL BE THE RESPONSIBILITY OF THE GENERAL CONTRACTOR.
5. SHORING OF EXISTING STRUCTURE SHALL BE THE RESPONSIBILITY OF THE GENERAL CONTRACTOR.
6. NOTIFY ARCHITECT IMMEDIATELY IF ASBESTOS IS SUSPECTED ON SITE. DO NOT DISTURB UNLESS DIRECTED.
7. IT SHALL BE THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO COORDINATE THE DEMOLITION BY DIFFERING TRADES.
8. CONTRACTOR COORDINATE SCHEDULE & LOCATION OF ANY OR ALL EXISTING RECEPTACLES, SWITCHES, DEVICES, ETC. PRIOR TO DEMOLITION, RELOCATE OR ABANDON ACCORDINGLY.
9. COORDINATE & REFERENCE MECHANICAL & ELECTRICAL DRAWINGS FOR ADDITIONAL DEMOLITION ITEMS AND DETAILS

SPECIFIC ROOF DEMOLITION NOTES

1. BUILDING MTL ROOFS; RE-USE METAL ROOFING, REMOVE & REPLACE DAMAGED PANELS. REPLACE FLASHINGS, GUTTERS DOWNSPOUTS, RELATED ITEMS & MATERIALS. INSTALL NEW FLASHINGS, GUTTERS DOWNSPOUTS, RELATED ITEMS & MATERIALS.
2. COORDINATE ALL NEW, ROOF PENETRATIONS; EXHAUST, VENTS, PIPES, EQUIPMENT, ETC., PROVIDE ROOF CURBS, FLASHINGS AND ACCESSORIES FOR WATER TIGHT INSTALLATION.
3. CANOPIES; REMOVE & REPLACE EXISTING ALL ROOFING PANELS, FLASHINGS, GUTTERS DOWNSPOUTS, RELATED ITEMS & MATERIALS. REPAIR AND/OR REPLACE DAMAGED STRUCTURE, & PAINT. PROVIDE ALL NEW TRANSITION OR CONNECTION FLASHINGS, SEALANT, & CAULKING. ENTIRE ROOF ASSEMBLY SHALL BE PROVIDED AND INSTALLED AS REQUIRED & RECOMMENDED BY MANUFACTURER WITH 20 YEAR WATER TIGHTNESS WARRANTY. REF. SPEC.



REVISION:

DATE: 11-20-2025
JOB: 25-3479
SHEET NO.:

BUILDING B & C

THE IRVING LOFTS
HISTORIC RESTORATION & REHAB APARTMENTS
CLEBURNE, TEXAS

JCR
JonesGillamRenz
1881 Main Street, Suite 301
Salina, KS 67401
785-827-0386
jgr@jgarchitects.com

DBC2.8

COPYRIGHTED ©

STRUCTURE, MASONRY AND EXTERIOR WALLS

1. ANY STRUCTURAL REPAIRS SHOULD BE MINIMALLY VISIBLE FROM THE EXTERIOR.
2. ALL DECORATIVE MASONRY MUST REMAIN.
3. MASONRY/BRICK CLEANING MUST BE OF THE GENTLEST MEANS POSSIBLE. CLEANING SHALL BE IN ACCORDANCE WITH THE GSA BREF 1, AND THE GSA GUIDELINES FOR CLEANING EXTERIOR BRICK. CONTACT AND REFER TO HISTORIC CONSULTANTS/SPECIALISTS FOR TREATMENT OPTIONS.
4. MASONRY REHABILITATION SHALL CONSIST OF SPOT REPOINTING AND REPAIR/REPLACEMENT OF ISOLATED DETERIORATION. ALL WORK SHALL CONFORM TO PRESERVATION STANDARDS OUTLINED IN THE NATIONAL PARK SERVICE PRESERVATION BRIEFS 1.2 & 6. DETERIORATED MORTAR SHOULD BE REMOVED TO SOUND MORTAR. NEW MORTAR SHOULD MATCH EXISTING IN COLOR, TEXTURE, AND COMPOSITION, AND MATCH THE PROFILE.
5. NATIONAL PARK SERVICE BREF 1 SPECIFIES THE RECOMMENDED COMPOSITION OF MORTARS USED IN HISTORIC BUILDINGS.

WINDOWS

1. EXISTING WINDOWS MAY REMAIN.
2. NEW WINDOWS ARE PROPOSED. THEY ARE TO MATCH WINDOWS OF THE HIGH RISE BUILDING. WINDOWS CAN BE WOOD, CLAD-WOOD, OR ALUMINUM. IF ALUMINUM, THEY SHOULD HAVE PAINT-LIKE OR BAKED ON FINISH. NEW WINDOWS CAN BE TRUE DIVIDED OR SIMULATED; IF SIMULATED, THEY SHOULD HAVE BOTH INSIDE AND OUTSIDE DIVIDED LINES. IF TRUE DIVIDED, THERE SHOULD BE A SPACER GRID BETWEEN PANES OF GLASS. WINDOWS DO NOT NEED TO BE OPERABLE BUT NEED TO HAVE AN OFFSET UPPER SASH SO THAT THEY MIMIC THE HUNG WINDOW OPERATION OF THE CLAD-WOOD. GLASS SHOULD BE CLEAR, COLORLESS, AND NON-REFLECTIVE WITH NO LESS THAN 69% VLT AND NO GREATER THAN 11% VLR.
3. ANY EXISTING WINDOWS BEING RETAINED ARE TO BE REPAIRED TO THE GREATEST MEASURE POSSIBLE WITH ANY MISSING OR DETERIORATED PARTS REPLACED IN KIND.

ROOFS

1. EXISTING COPING MUST REMAIN, ANY NEW FLASHING OR COPING SHALL NOT BE VISIBLE FROM THE GROUND.
2. SCUPPERS AND DOWNSPOUTS SHOULD BE REPAIRED WHEREVER POSSIBLE, ANY NEW DOWNSPOUTS SHOULD MATCH EXISTING.

INTERIOR

1. THE WOOD STAGE IS TO REMAIN AND BE REPAIRED AS NEEDED. REPAIRS ARE TO BE KNITTED INTO THE EXISTING PATTERN.
2. GUM IN THE GUTTERFLOOR IS TO REMAIN.
3. THE CORRIDOR CONFIGURATION IS TO REMAIN INTACT.
4. EXISTING OFFICE AND CLASSROOM AND OFFICE OPENINGS SHOULD BE MAINTAINED.
5. WHERE DOORS ARE NOT USED, THEY SHOULD BE FIXED IN PLACE.
6. PLASTER WALLS AND CEILINGS THROUGHOUT ARE TO BE RETAINED AND REPAIRED IN ACCORDANCE WITH PRESERVATION BRIEF 21.
7. TILE FLOOR IN THE CORRIDOR IS TO BE REPAIRED, ANY MISSING TILES ARE TO BE REPLACED IN KIND.
8. CONCRETE FLOORS IN THE BASEMENT MUST REMAIN BUT MAY BE REPAIRED.
9. GRID CEILINGS ARE TO BE REMOVED THROUGHOUT.
10. PROTECT HISTORIC PLASTER CEILINGS DURING LAY-IN DEMO.
11. SOFFITS & EXPOSED MEP SHOULD BE AVOIDED IN ALL CORRIDORS
12. WHERE PARTITIONS INTERSECT WITH MULLIONS, PARTITION MUST BE NOTED. THE PARTITION FOR 18" BACU FROM WINDOW.
13. AREA OF DROPPED CEILING/SOFFITS ARE TO BE HELD BACK FROM WINDOWS A MINIMUM OF 4 FEET.
14. CARPETS ARE TO BE REMOVED TO REVEAL HISTORIC FLOORING. HISTORIC FLOOR IS TO BE RETAINED AND REPAIRED.
15. CHANGES AND ADDITIONS TO BE REFINED WHEN POSSIBLE.
16. IF ANY HISTORIC FINISHES, OR FEATURES NOT PREVIOUSLY NOTED ARE UNCOVERED, CONTACT THE ARCHITECT IMMEDIATELY.

VERTICAL CIRCULATION

1. STAIRS MUST REMAIN, AND BE REPAIRED AS NEEDED.
2. IF ADDITIONAL RAILINGS ARE REQUIRED TO MEET CODE, THEY SHOULD BE SIMPLE AND COMPATIBLE WITH THE BUILDING.
3. THE NEW ELEVATOR TOWER IS TO BE COMPATIBLE WITH THE MATERIALS AND MASSING OF THE 1915 BUILDING.

MECHANICAL, ELECTRICAL, PLUMBING, & SINGAGE



1. NEW HVAC SHALL RUN ABOVE CEILINGS AND DUCTS ARE NOT TO BE EXPOSED.
2. ROOFTOP EQUIPMENT SHALL NOT BE VISIBLE FROM GROUND.
3. NEW PLUMBING SHALL NOT BE EXPOSED.
4. ORIGINAL CAFETERIUM SPOTLIGHTS ARE TO REMAIN.
5. THE ORIGINAL IRVING SIGN IS TO BE REPAIRED AS NEEDED
6. NEW SIGNAGE IS TO BE COMPATIBLE WITH BUILDING CHARACTER.

Q4 REMOVE EXISTING URINAL REEF FOR NEW URINAL INSTALLATION


- | | |
|----|--|
| 01 | REMOVE EXISTING WNDW; PREP FOR NEW WNDW INSTALLATION.
PROTECT HISTORIC SIGNAGE |
| 02 | REMOVE EXISTING AIR CONDITIONING UNIT & ALL ASSOCIATED
BRACKETS, ANCHORS, AND ATTACHMENTS |
| 03 | REMOVE EXISTING LOUVER, TUCKPOINT & INFILL OPENING TO MATCH |
| 04 | REMOVE EXISTING DOOR, TUCKPOINT & INFILL OPENING TO MATCH. |
| 05 | EXISTING DOOR TO BE SEALED IN PLACE |
| 06 | REMOVE EXISTING METAL COVERING. |
| 07 | REMOVE PORTION OF WALL, PREP FOR NEW WNDW/DOOR |
| 08 | REMOVE EXISTING WNDW, TUCKPOINT AND INFILL TO MATCH |
| 09 | REMOVE EXISTING EXHAUST, TUCKPOINT AND INFILL TO MATCH |
| 10 | REMOVE EXISTING WNDW, PREP FOR NEW DOOR |
| 11 | REMOVE EXISTING DOOR, PREP FOR NEW DOOR |
| 12 | REMOVE EXISTING SIGNAGE |

1. WHERE EXISTING BLDG COMPONENTS ARE TO BE REMOVED:


1. PATCH & REPAIR THE SURFACES TO MATCH EXISTING FINISH, UNLESS NEW FINISHES ARE CALLED FOR IN THE FINISH SCHEDULE.
2. REMOVE EXISTING BLDG. COMPONENTS AS INDICATED, IMPLIES AS REQUIRED. SCHEMATICALLY SHOWN AS DASHED LINES. FIELD VERIFY ALL LOCATIONS.
3. THE ELECTRICAL & MECHANICAL CONTRACTORS SHALL BE RESPONSIBLE FOR ALL CORE DRILLING FOR PIPING & CONDUIT INSTALLATION.
4. ALL OTHER CUTTING, PATCHING & FINISHING, U.N.O. SHALL BE THE RESPONSIBILITY OF THE GENERAL CONTRACTOR.
5. SHORING OF EXISTING STRUCTURE SHALL BE THE RESPONSIBILITY OF THE GENERAL CONTRACTOR.
6. NOTIFY ARCHITECT IMMEDIATELY IF ASBESTOS IS SUSPECTED ON SITE. DO NOT DISTURB UNLESS DIRECTED.
7. IT SHALL BE THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO COORDINATE THE DEMOLITION BY DIFFERING TRADES.
8. CONTRACTOR COORDINATE SCHEDULE & LOCATION OF ANY OR ALL EXISTING RECEPTACLES, SWITCHES, DEVICES, ETC. PRIOR TO DEMOLITION, RELOCATE OR ABANDON ACCORDINGLY.
9. COORDINATE & REFERENCE MECHANICAL & ELECTRICAL DRAWINGS FOR ADDITIONAL DEMOLITION ITEMS AND DETAILS.

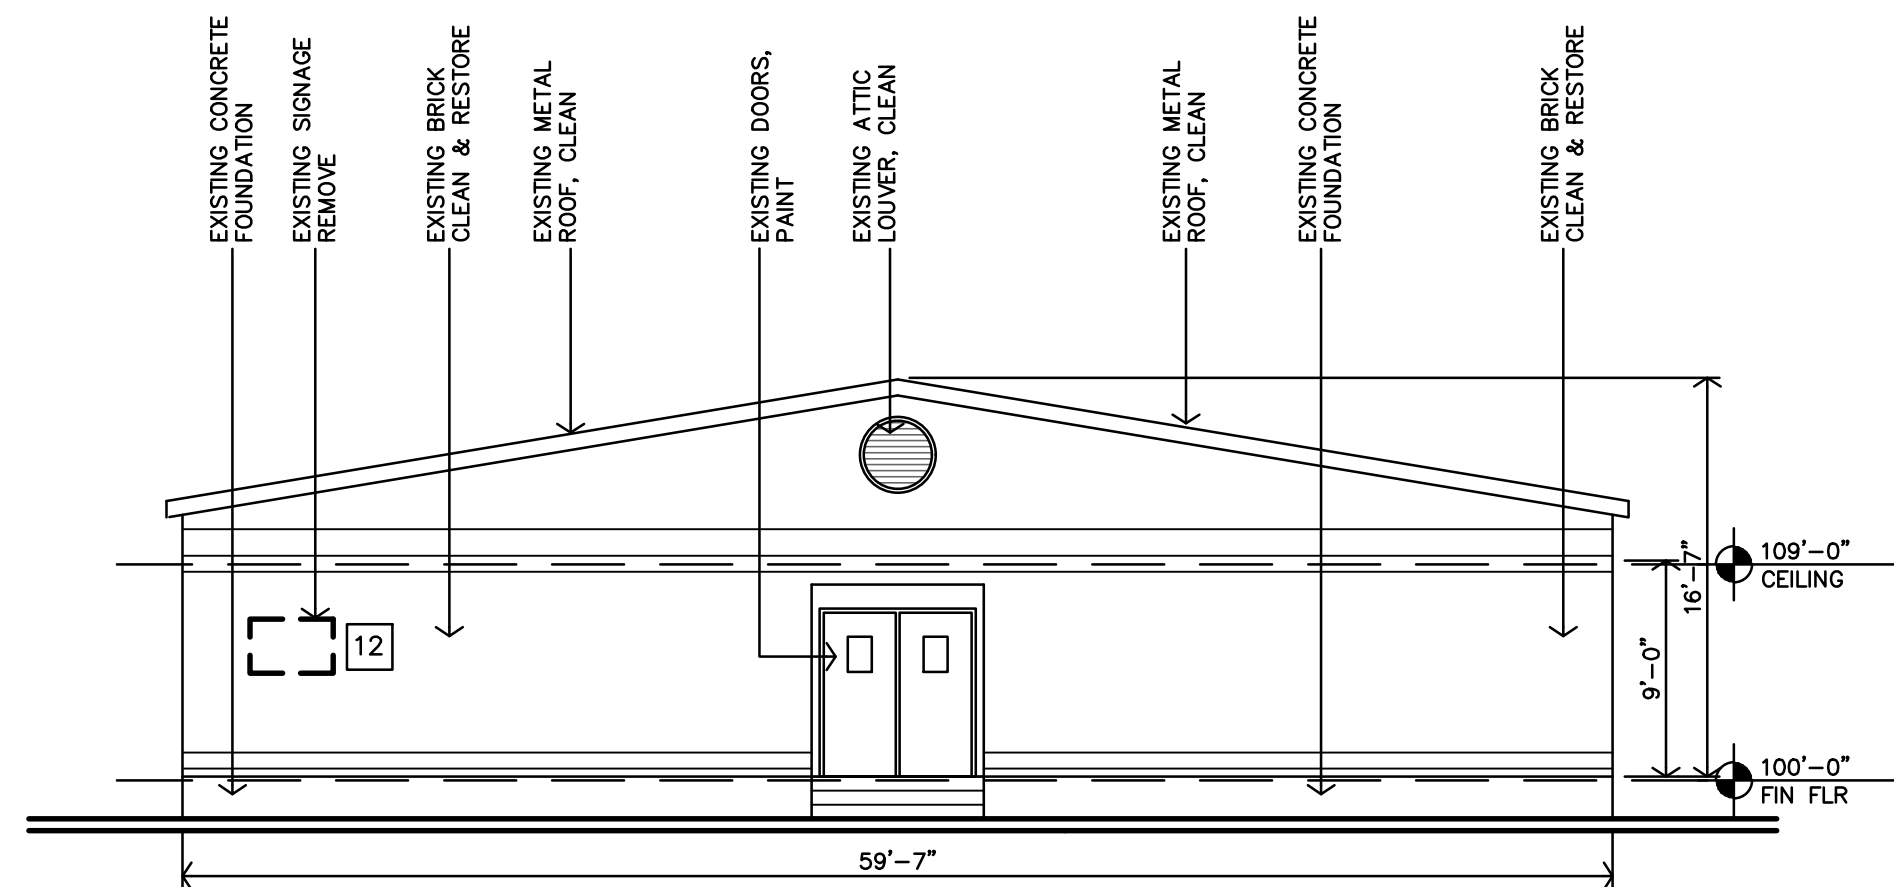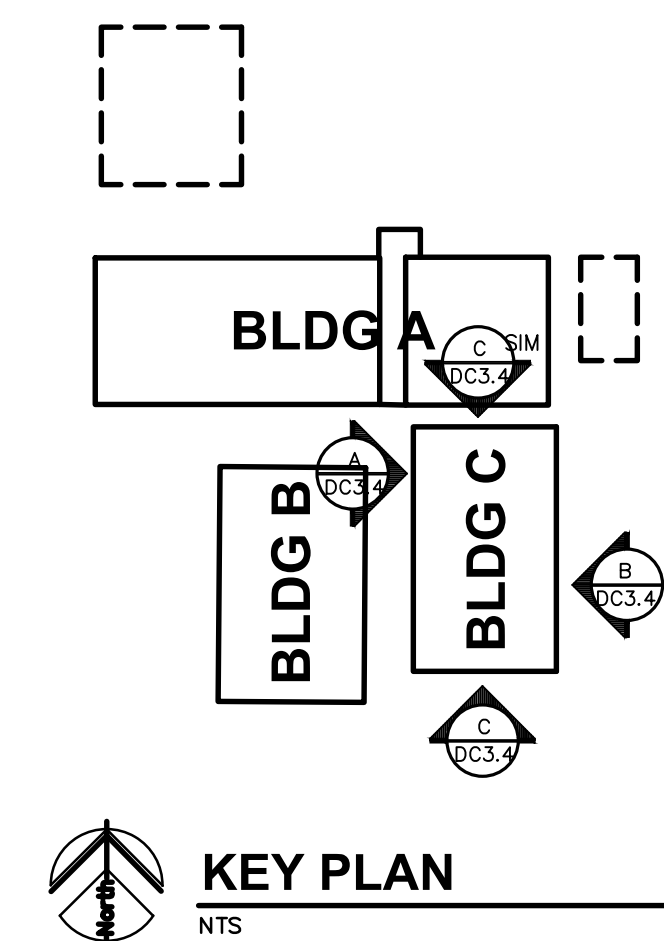


D **BLDG C - DEMO**
SOUTH ELEVATION
1/8"=1'-0"

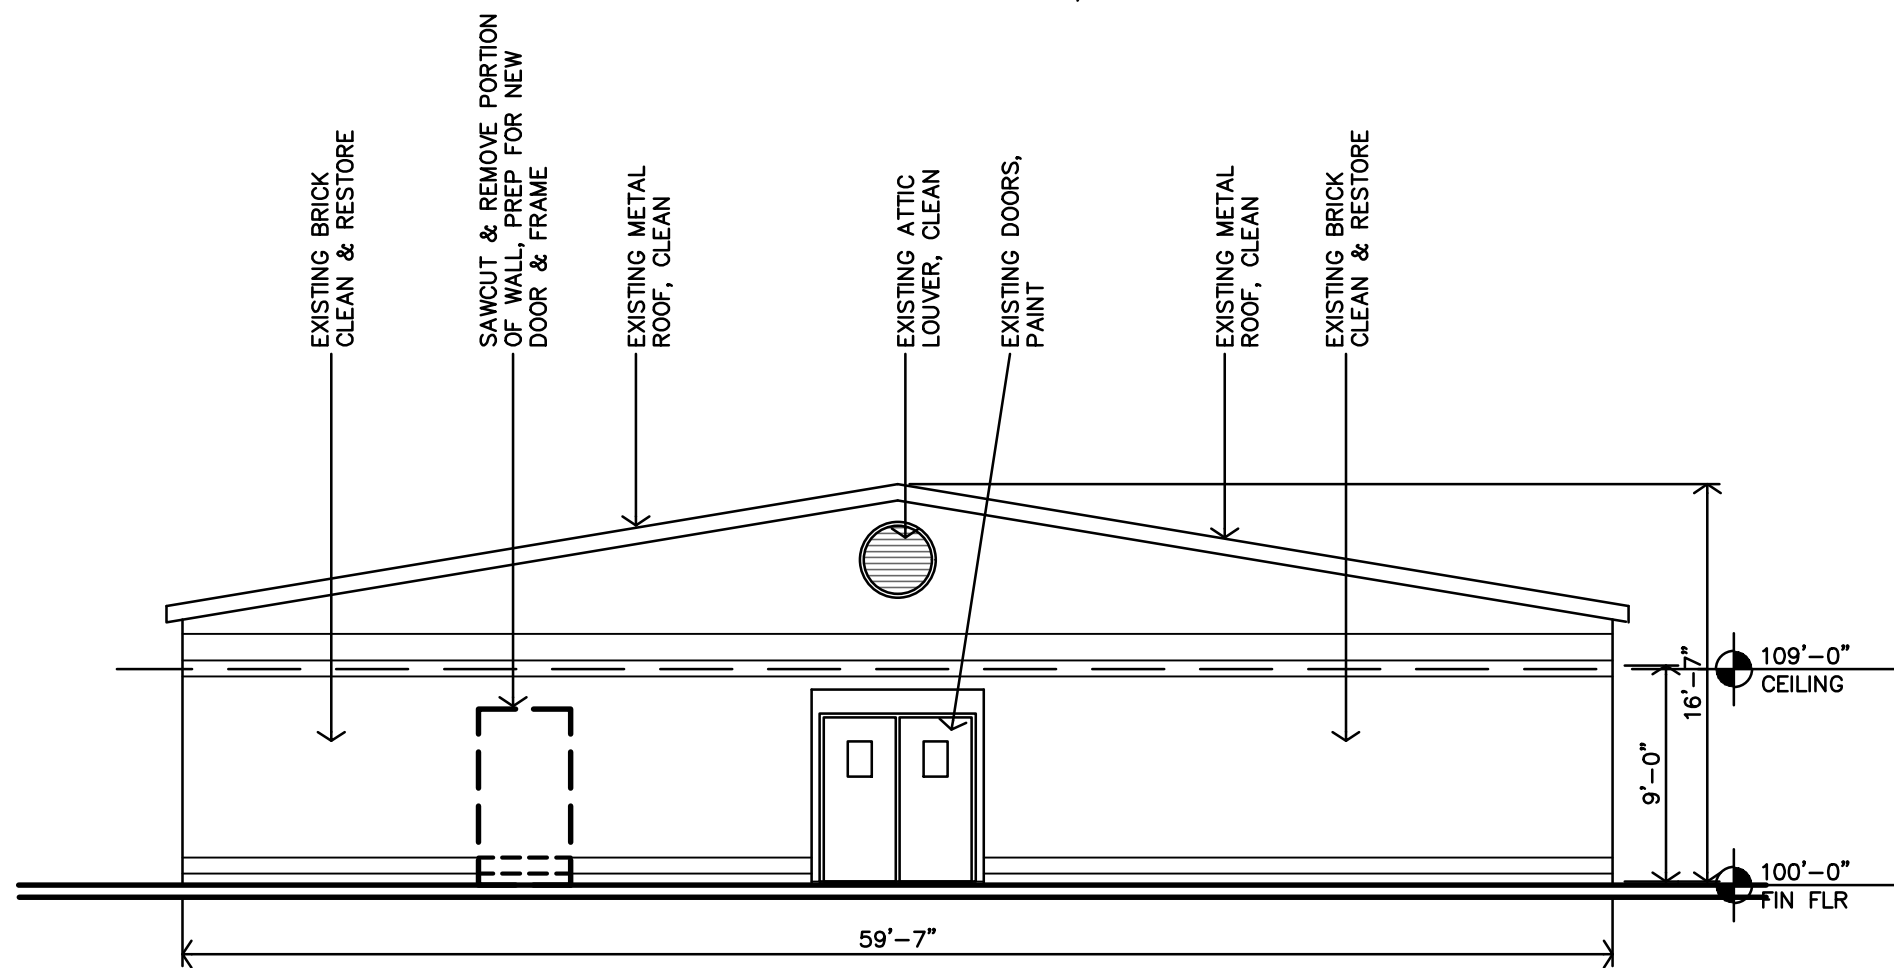

B **BLDG C - DEMO**
NORTH ELEVATION
1/8"=1'-0"

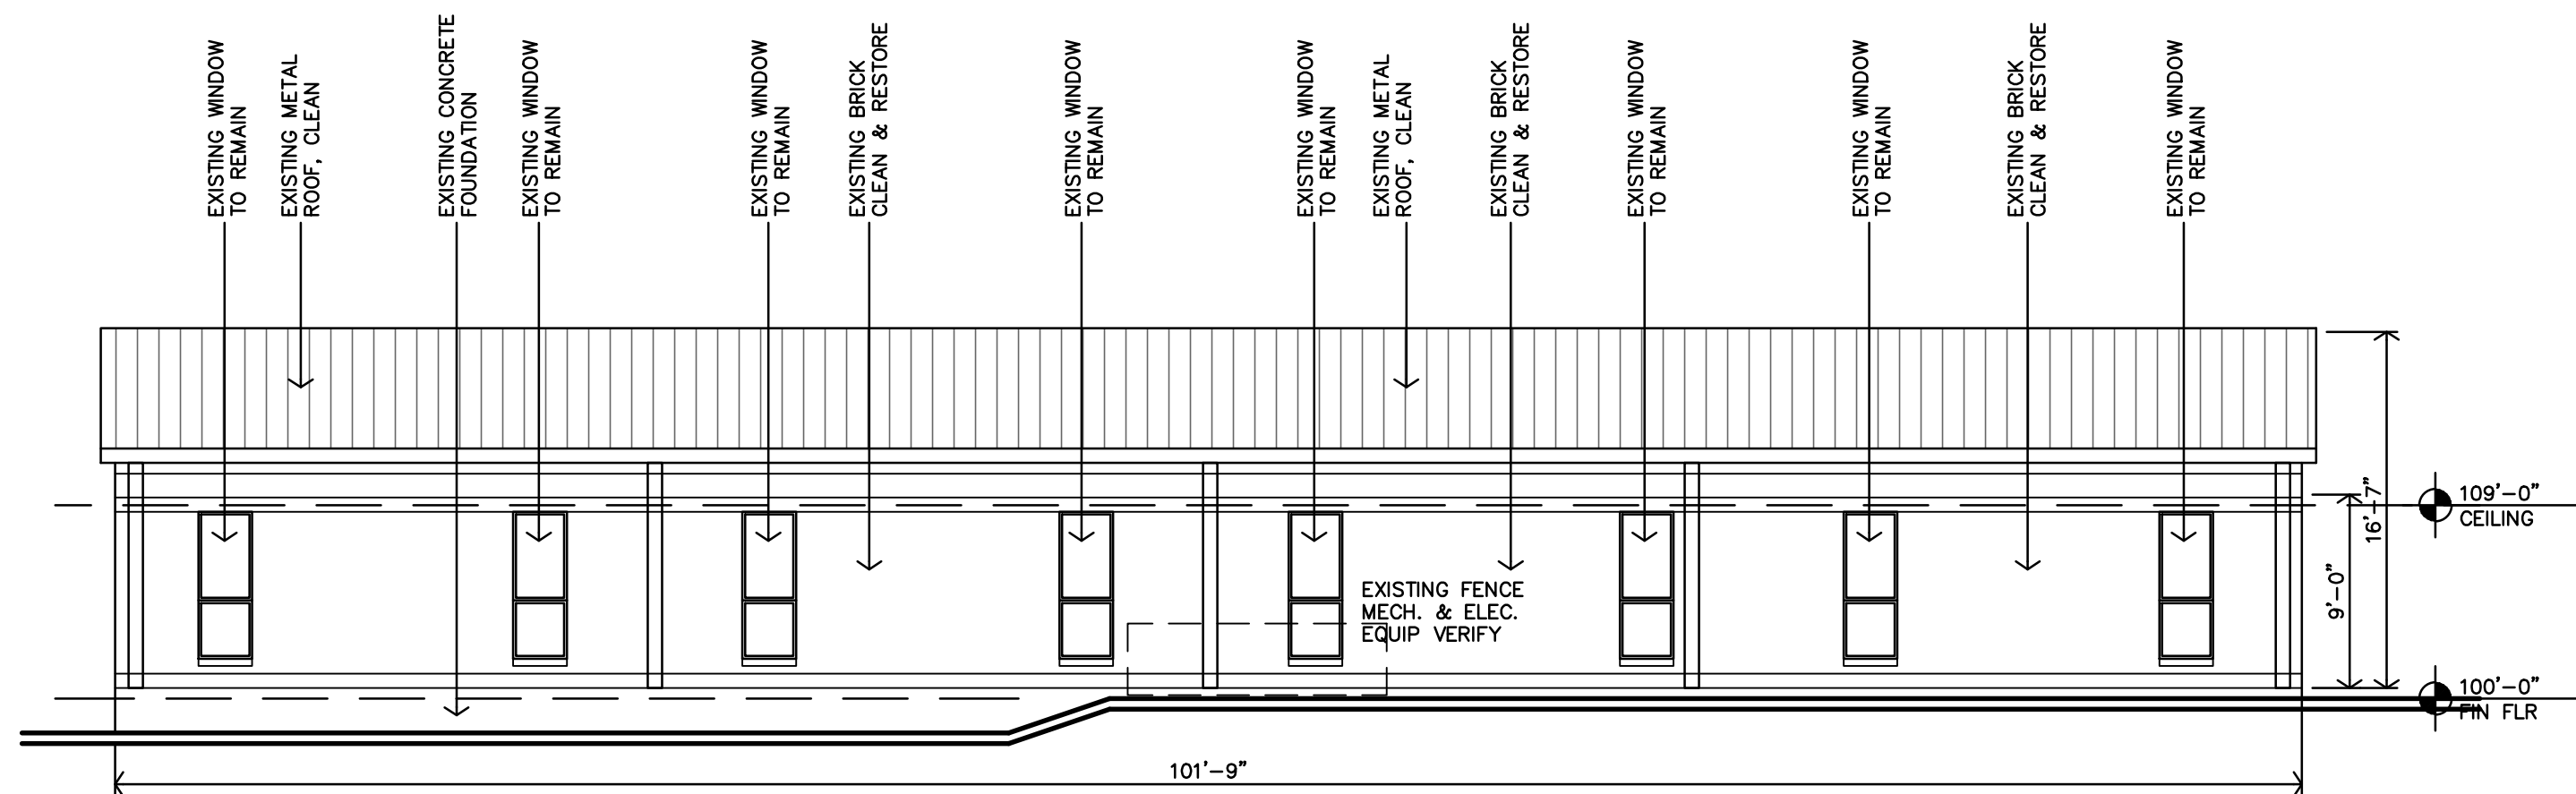

C **BLDG C - DEMO**
EAST ELEVATION
1/8"=1'-0"

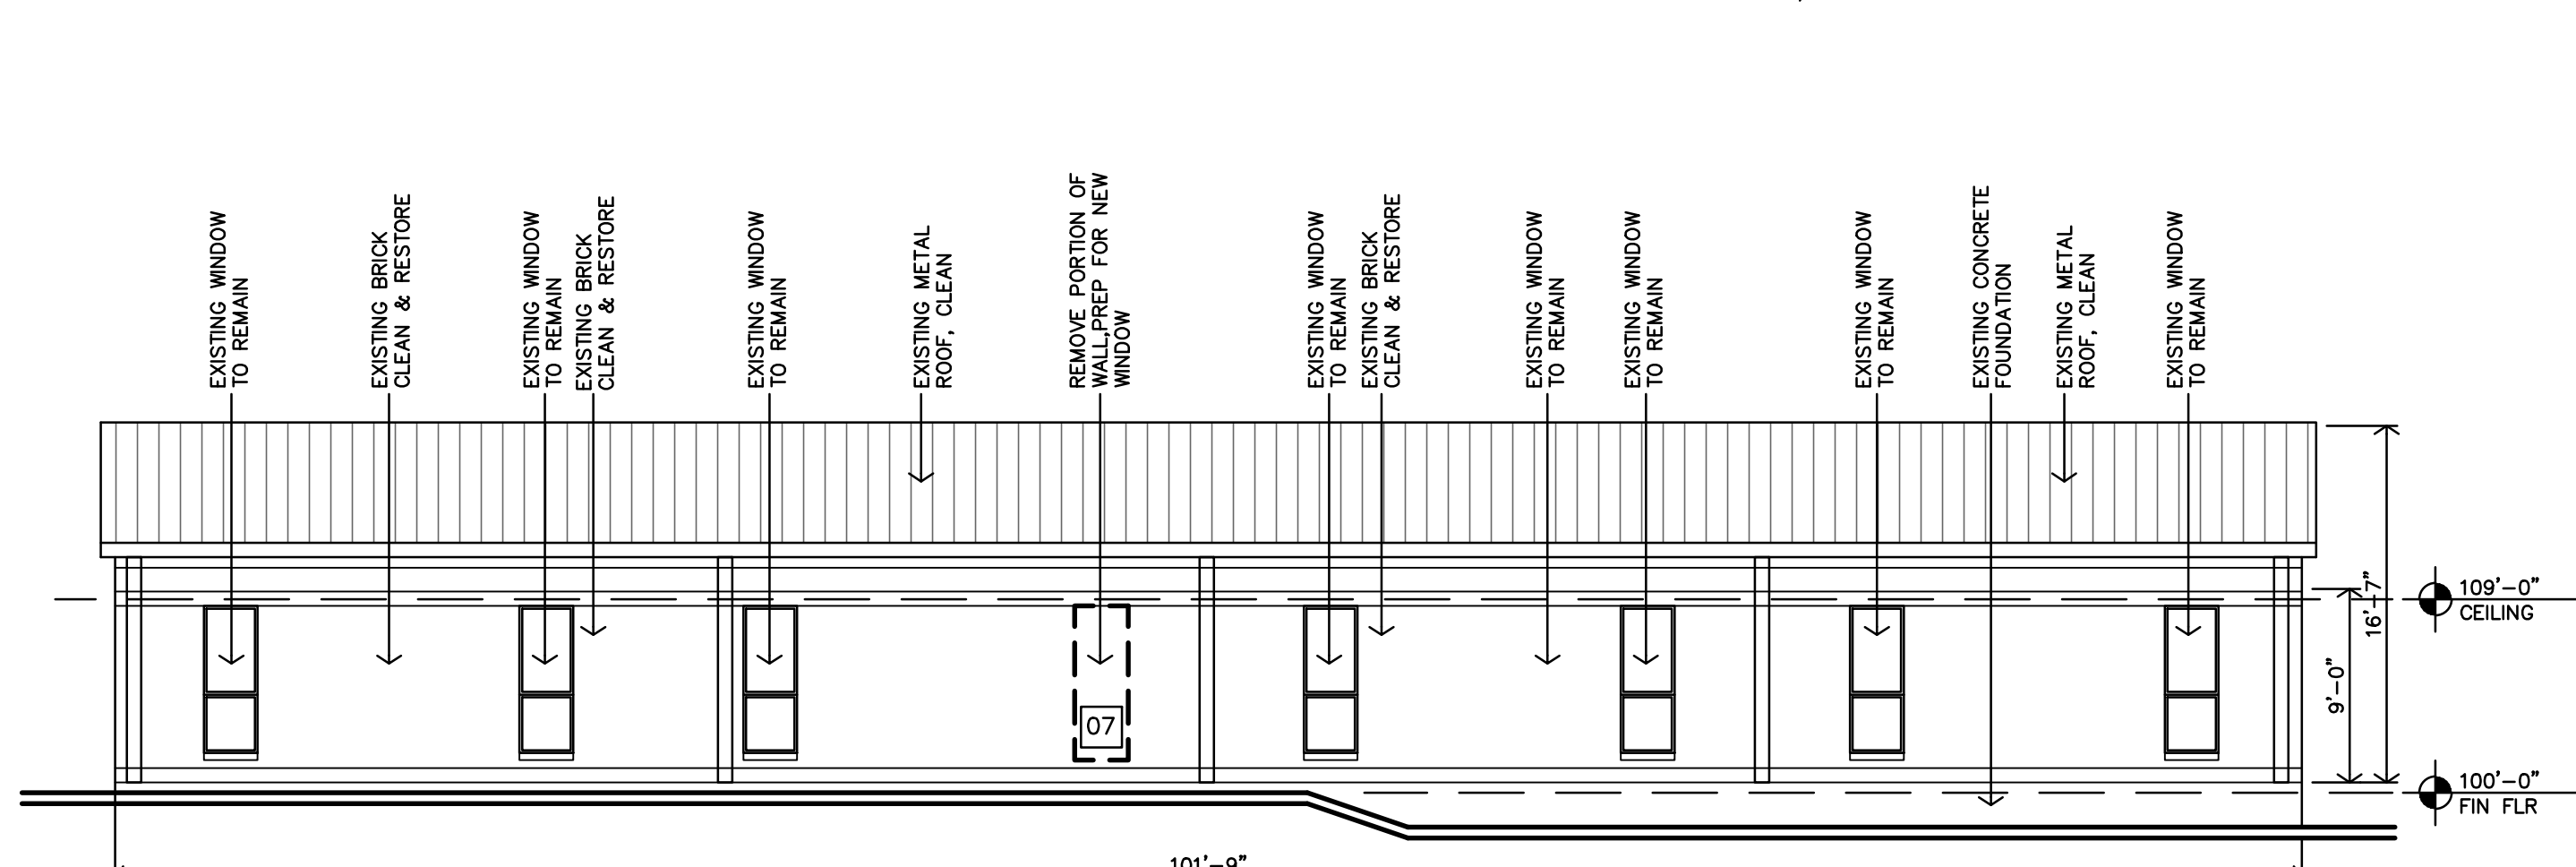

A **BLDG C - DEMO**
WEST ELEVATION
1/8"=1'-0"

BUILDING C

JGR

JonesGillamRenz

730 N. Ninth
1881 Main Street, Suite 301
Salina, KS 67401
785.827.0386
jgr@jgrarchitects.com

THE IRVING LOFTS
HISTORIC RESTORATION & REHAB APARTMENTS
CLEBURNE, TEXAS



REVISION:



DATE: 11-20-2025

JOB: 25-3479

SHEET NO.:

DC3.4

COPYRIGHTED ©

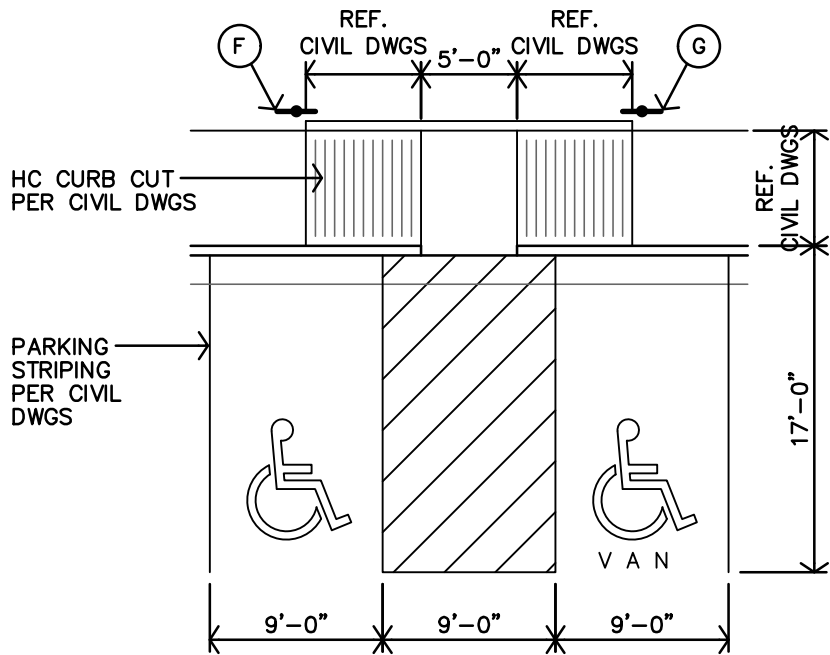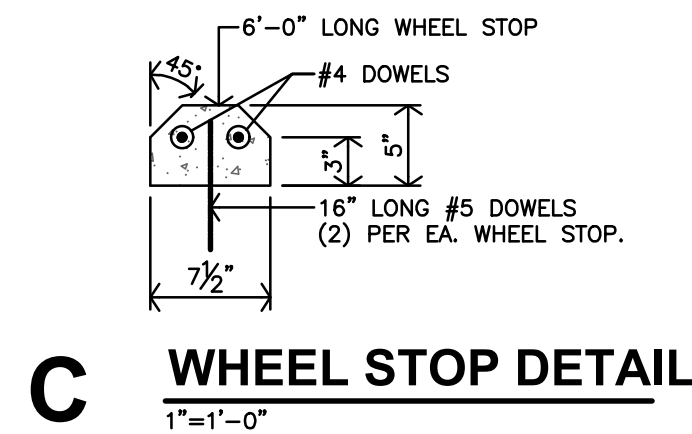


SITE PLAN KEY NOTES

A	EXISTING MONUMENT SIGN, MODIFIED BY OWNER
B	KNOX BOX COORD. W/ FIRE DEPT. (TYP)
C	TRASH ENCLOSURE REF. SHEET A1.2
D	DOG PARK W/ 4'-0"tall FENCE, REF. A1.2
E	POLE MOUNTED H.C. "VAN" PARKING SIGN MOUNT BTM. OF SIGN @ 60"A.F.F. (TYP)
F	POLE MOUNTED H.C. PARKING SIGN MOUNT BTM. OF SIGN @ 60"A.F.F. (TYP)
G	BIKE RACK - FOR 5 BIKES
H	DASHED LINE INDICATES ACCESSIBLE PATH
J	PAINTED STRIPPING
K	BUILDING METER CENTER REF. ELECT. DWGS
L	BUILDING TRANSFORMER REF. ELECT. DWGS. CONTRACTOR TO COORDINATE SIZE OF CONC. PAD WITH ELECT. COMPANY
M	NEW BENCH, REF. SHEET A1.2
N	NEW PERIMETER FENCE WITH GATES SIMILAR TO DOG PARK FENCE, REF. A1.2
O	DOG WASTE STATION (1) REF. A1.2
P	8'-0"x12'-0" CONCRETE SLAB AT DOG PARK ENTRANCE.
Q	PROTECTIVE COVERS (CARPORTS) BY PREMIER CARPORTS. REFERENCES SPECIFICATIONS. (16) STALLS TOTAL (INCLUDING 2 ADA STALLS). CONTRACTOR TO COORDINATE STRUCTURE COLUMN LOCATIONS WITH PREMIER CARPORTS.

NOTE: CONC. SLAB SHALL BE 4"th. 3,500 PSI W/ 6#6-W1.2W1.2 WWF. SLOPE ACROSS SLAB NO MORE THAN 2% (1/8" PER 12") OVER 4"th. GRANULAR FILL (MIN.) COMPACTED OVER SUBGRADE, PREP PER SOILS REPORT.

GENERAL SITE PLAN NOTES

- GENERAL CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS & DIMENSIONS.
- INSTALL MATERIALS AND FINISHES AS INDICATED, IMPLIED OR AS REQUIRED FOR FINISH INSTALLATION.
- WHERE NEW CONCRETE ABUTS THE BUILDING, PROVIDE 3/4" EXPANSION JOINT & SEAL TOP WITH EPOXY SEALER.
- INSTALL EXPANSION JOINTS IN CONCRETE SIDEWALK PAVING AT ±60" O.C. PROVIDE FILLER MATERIAL AND SEALANT. COORDINATE WITH ARCHITECT FOR FINAL LOCATIONS OF EXPANSION JOINTS.
- INSTALL CONTROL JOINTS IN CONCRETE ROUGHLY SQUARE AND AREAS NOT TO EXCEED 100 S.F.
- EXTERIOR DOOR LANDINGS SHALL BE WITHIN 1/2" OF INTERIOR FINISH FLOOR ELEVATION. MAXIMUM SLOPE IN ANY DIRECTION SHALL BE 1:50
- FINISH FLOOR ELEVATION SHALL BE VERIFIED BY GENERAL CONTRACTOR AND CONFIRMED W/ PROPOSED GRADING TO PROVIDE DRAINAGE AWAY FROM THE BUILDING
- LANDSCAPING, SEEDING, PLANTINGS, ETC. TO BE BY OTHERS. ALL AREAS AROUND THE SITE AND AS INDICATED ON THE SITE PLAN SHALL BE FINE GRADED WITH MIN. 2" TOP SOIL AREAS SHALL BE FREE OF ROCKS AND CLUMPS AS SUITABLE FOR SEEDING OR SODDING.
- NEW PEDESTRIAN SIDEWALKS SHALL NOT HAVE A CROSS SLOPE GREATER THAN 1:50 AND SHALL NOT SLOPE IN THE DIRECTION OF TRAVEL GREATER THAN 1:20.
- CONTRACTOR SHALL COORDINATE ALL WORK WITH THE REQUIREMENTS OF THE UTILITY COMPANIES AND THE CITY OF CONROE.
- ALL DAMAGED PAVING AND LANDSCAPING CAUSED BY CONSTRUCTION ACTIVITIES SHALL BE REPAIRED OR REPLACED AT CONTRACTOR'S EXPENSE.
- DO NOT CONSTRUCT ANY PART OF THE TRASH PAD, ENCLOSURE AND/OR ACCESS TO, TILL AFTER CONFIRMATION AND COORDINATION OF LOCAL TRASH SERVICE. DUE TO DIFFERENT TRASH COMPANIES, TRUCKS AND PICK-UP PROCESSES, CONFIRMATION OF THE TRASH SERVICE AND COORDINATION OF THE DESIGN AND LAYOUT OF THE PAD, ENCLOSURE AND ACCESS MUST BE COMPLETED.
- AT ALL AREAS OF CONCRETE/ASPHALT SIDEWALK, PATIO, PARKING, ETC. THAT ARE EXISTING TO REMAIN:
 - CONTRACTOR TO MAKE REPAIRS AND CORRECTIONS AS REQUIRED TO MAINTAIN THE ADA ACCESSIBLE ROUTE AND MEET ALL ADA STANDARDS FOR PARKING AND ACCESSIBLE ROUTES.
 - CONTRACTOR TO CLEAN-UP AND REPAIR CRACKS, DE-WEED, AND TIDY-UP ALL EXISTING CONCRETE/ASPHALT.
- REF. SHEETS A2.0 - A22.6 FOR LOCATION OF ACCESSIBLE UNITS & HEARING IMPAIRED UNITS.
- EXISTING PLANTER AREAS/BED - CLEAN OUT ALL WEEDS, DEBRIS, OLD MULCH, ETC. ADD NEW LANDSCAPE FABRIC WHERE MISSING & 2" BLACK MULCH (OR OTHER AS SPECIFIED BY OWNER). COORDINATE WITH LOCATION OF NEW PLANTINGS. REF. L1.1, L1.2 & L1.3.

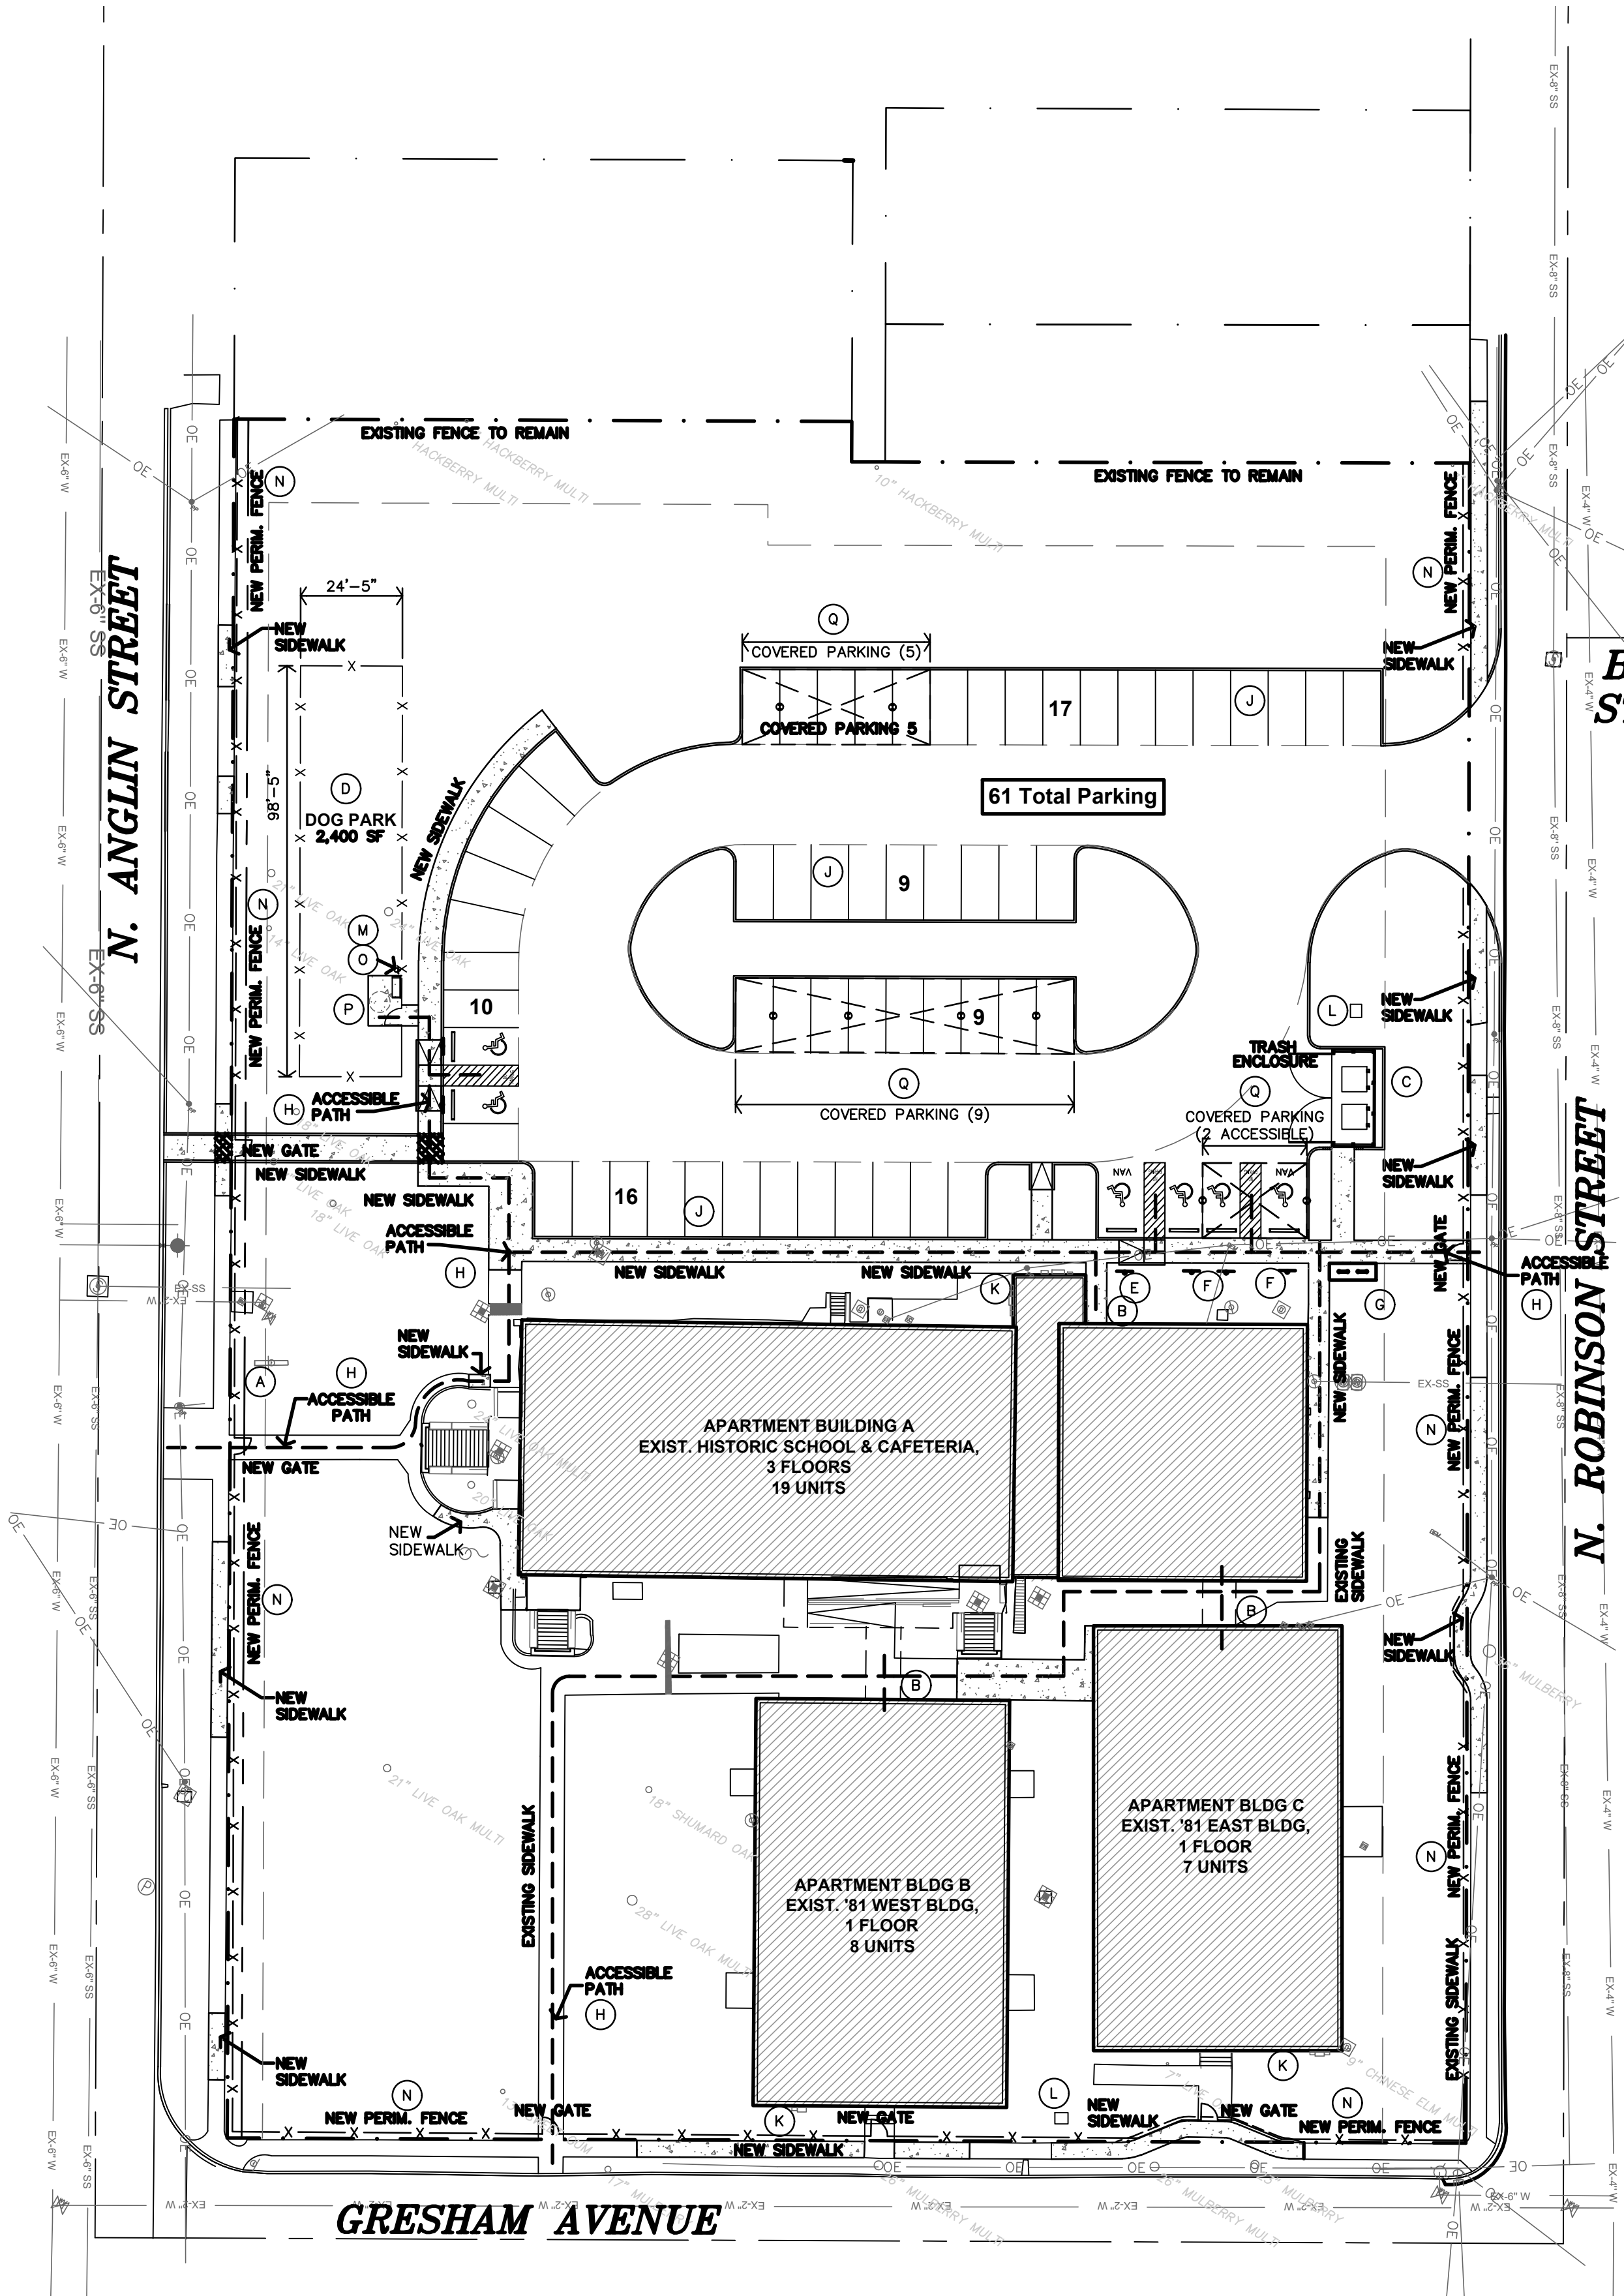

REVISION:

DATE: 11-20-2025
JOB: 25-3479
SHEET NO.:

A1.1

JGR
Jones Gillam Renz
730 N. Ninth
Salina, KS 67401
785.827.0386
1881 Main Street, Suite 301
Kansas City, MO 64108
jgr@jgarchitects.com

THE IRVING LOFTS
HISTORIC RESTORATION & REHAB APARTMENTS
CLEBURNE, TEXAS

COPYRIGHTED ©



5 BIKE WAVE RACK (2 total)

L BIKE RACK
NO SCALE



J DOG WASTE STATION
NO SCALE



G TYPICAL IMAGE OF 4'-0" tall FENCE - DOG PARK
NO SCALE



POLYWOOD TRADITIONAL GARDEN 60" BENCH
1 TOTAL
COLOR TBD BY ARCHITECT/OWNER



H OUTDOOR BENCH
NO SCALE




©Premier Carports

T-Style


K T-STYLE CARPORT BY PREMIER CARPORTS
NO SCALE

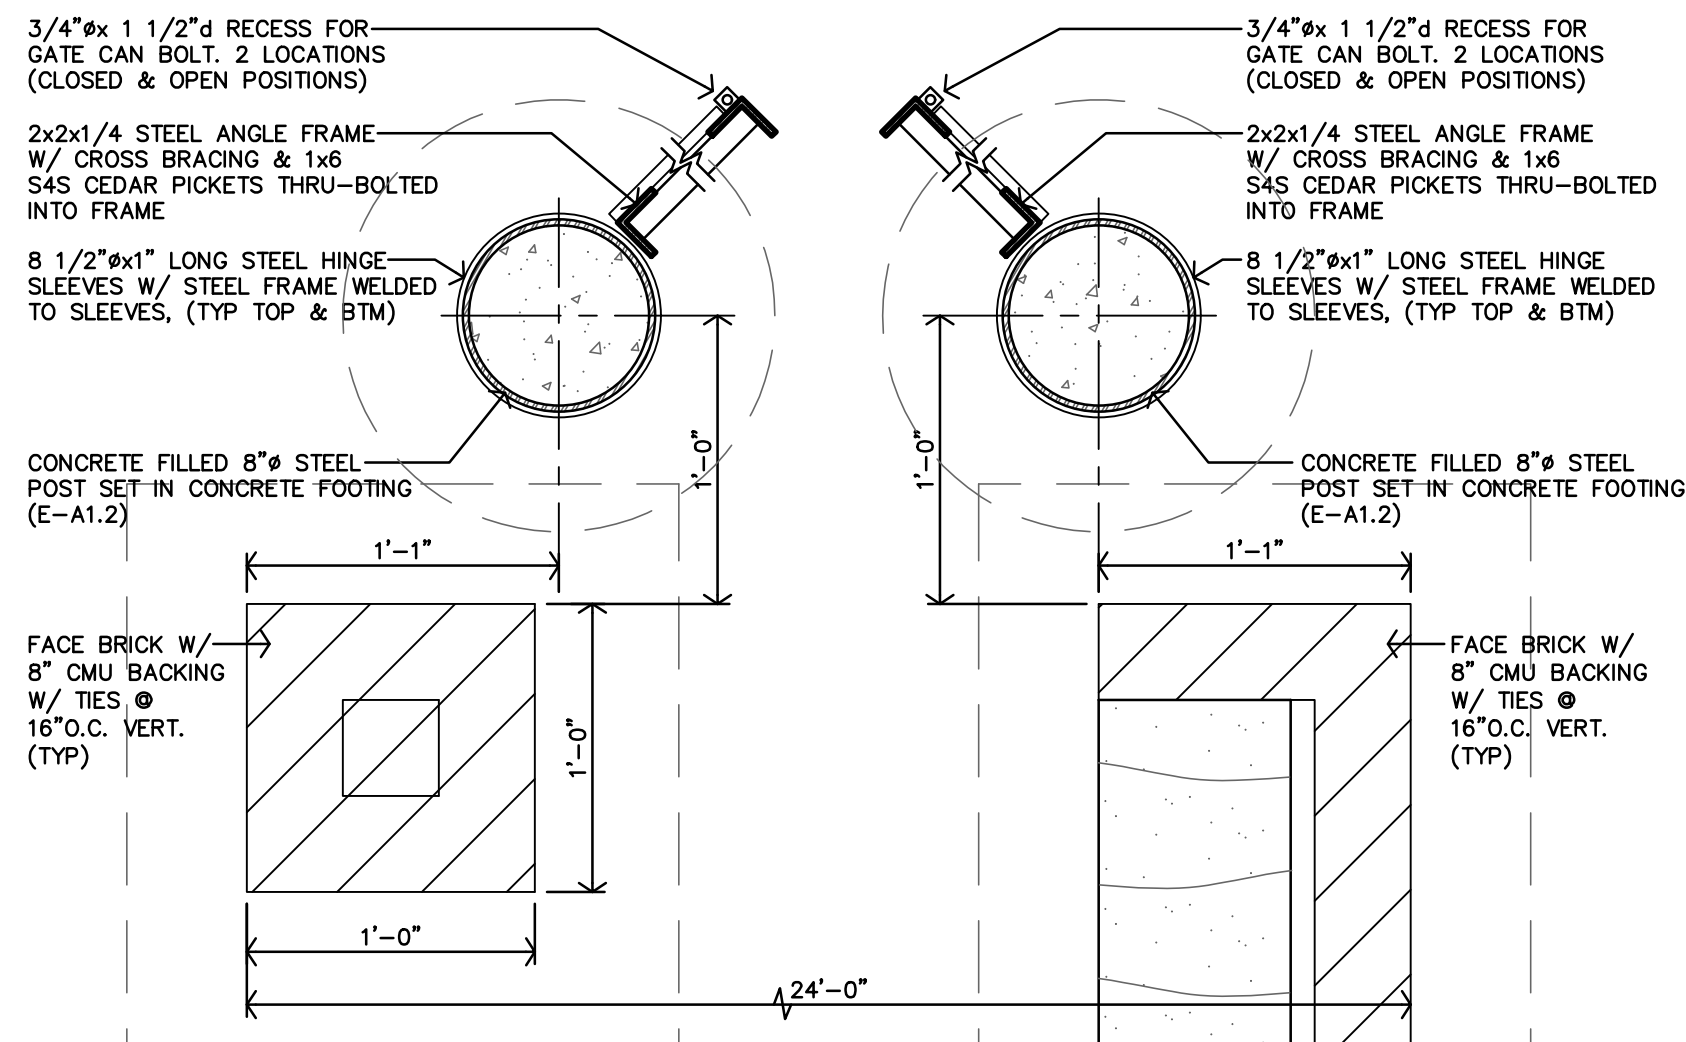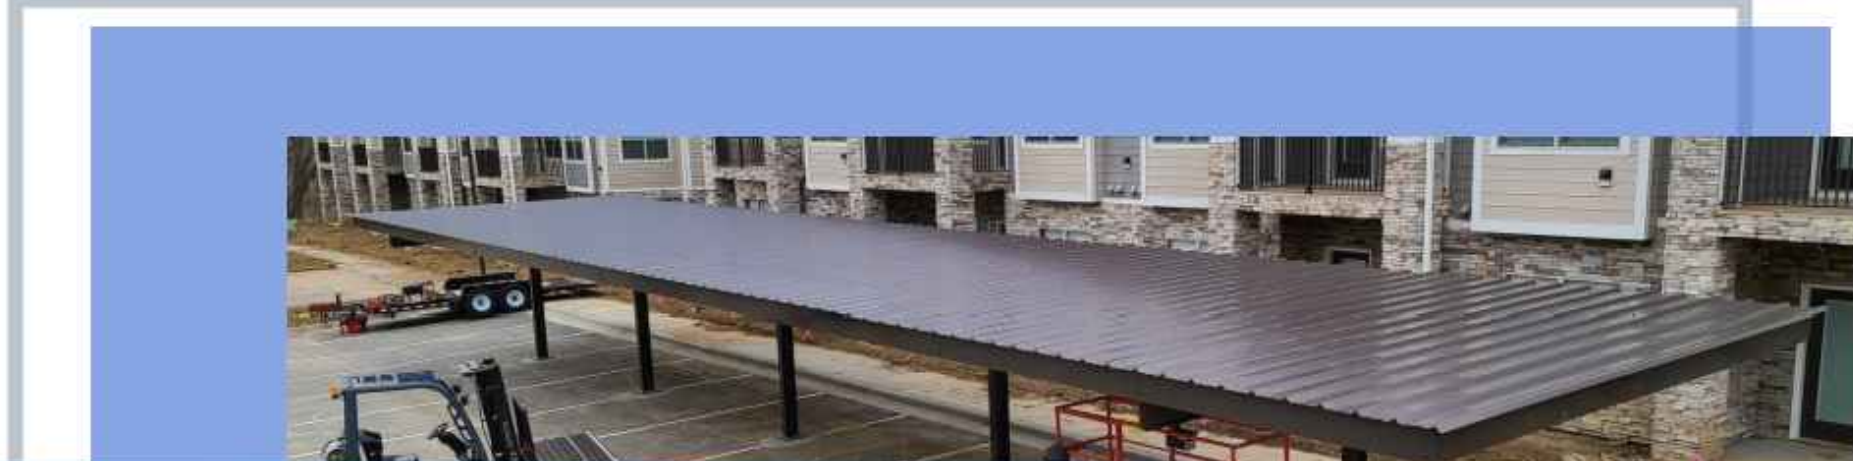


D GATE POST DETAILS
1 1/2"=1'-0"

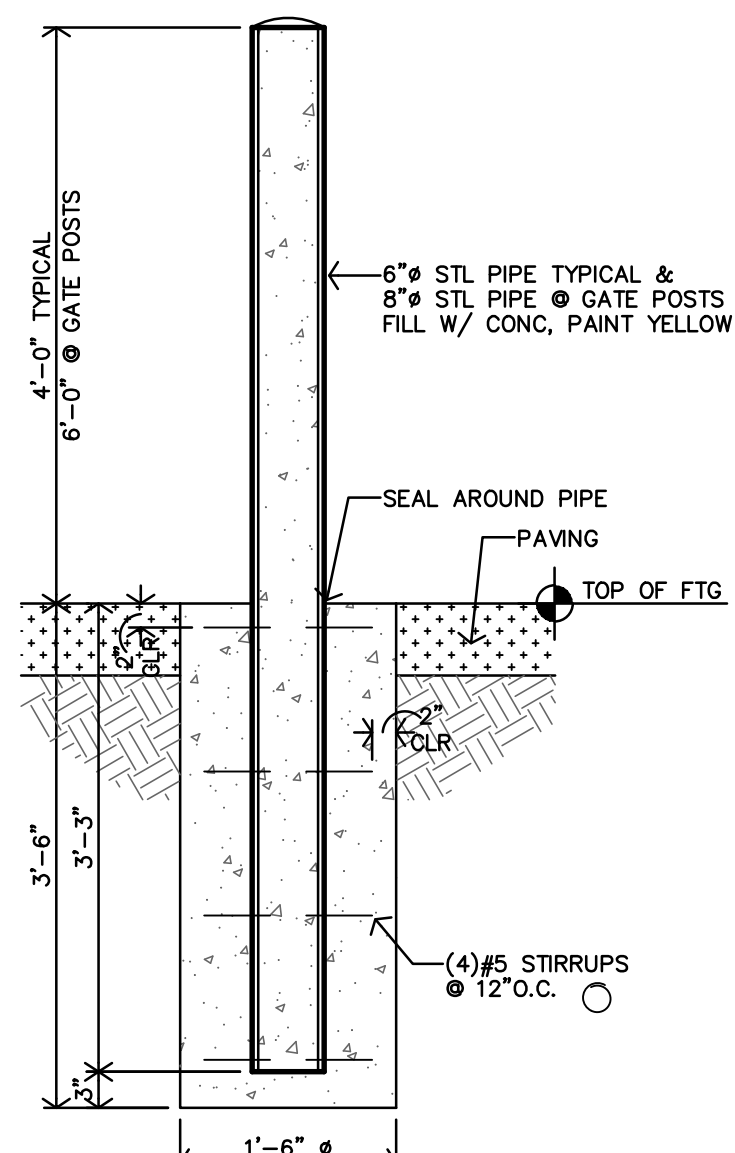


F BOLLARD DETAIL
3/4"=1'-0"

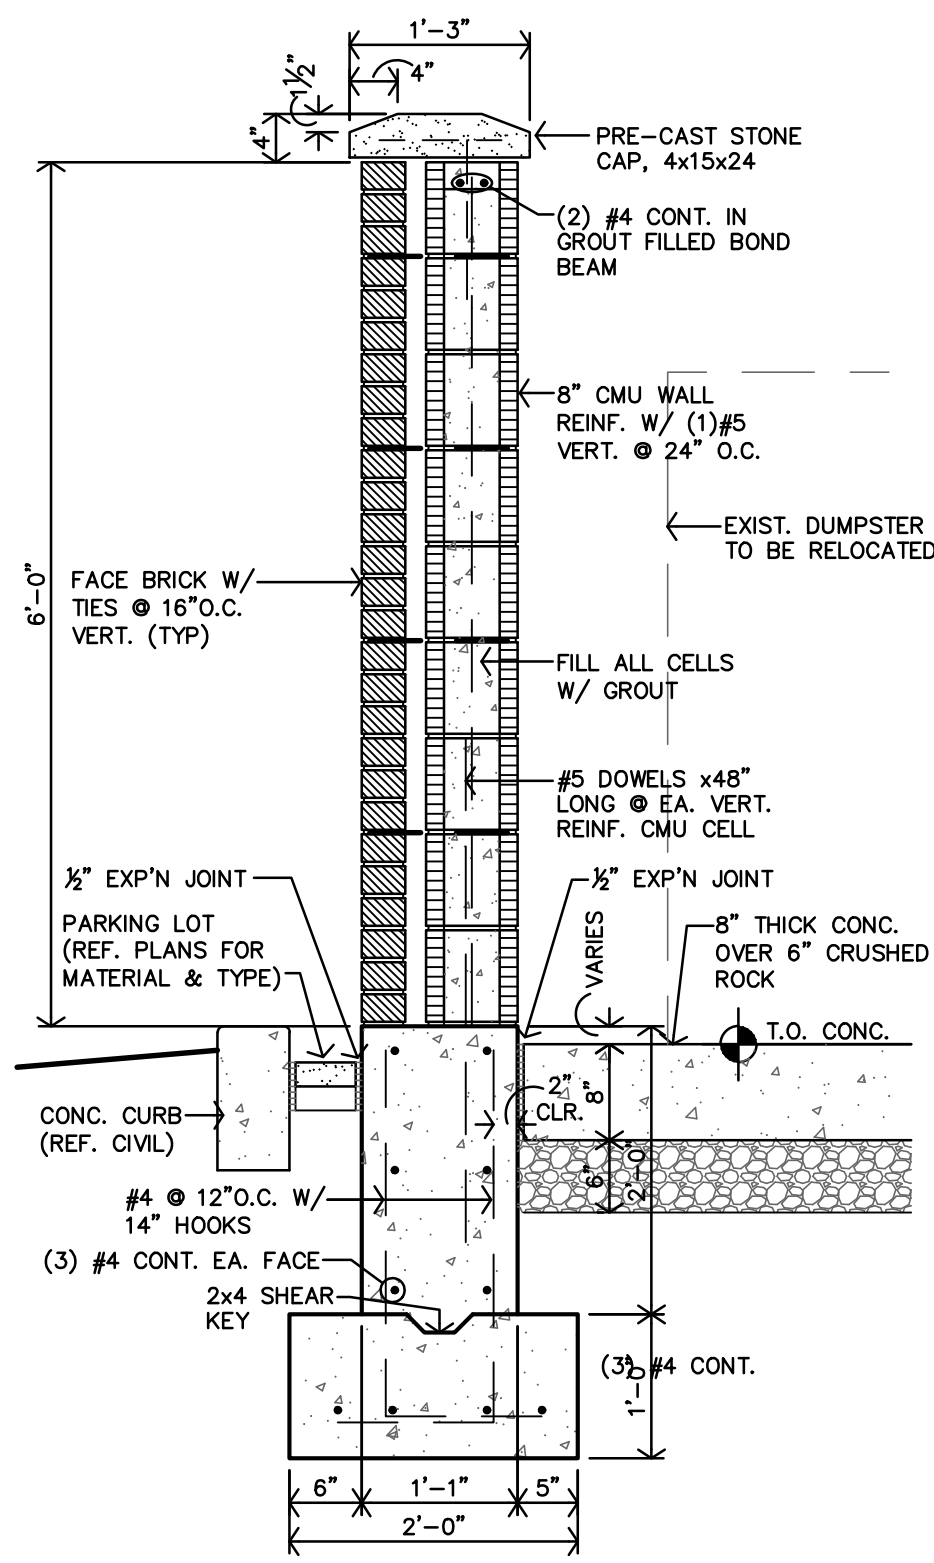


E TRASH ENCLOSURE SECTION
3/4"=1'-0"

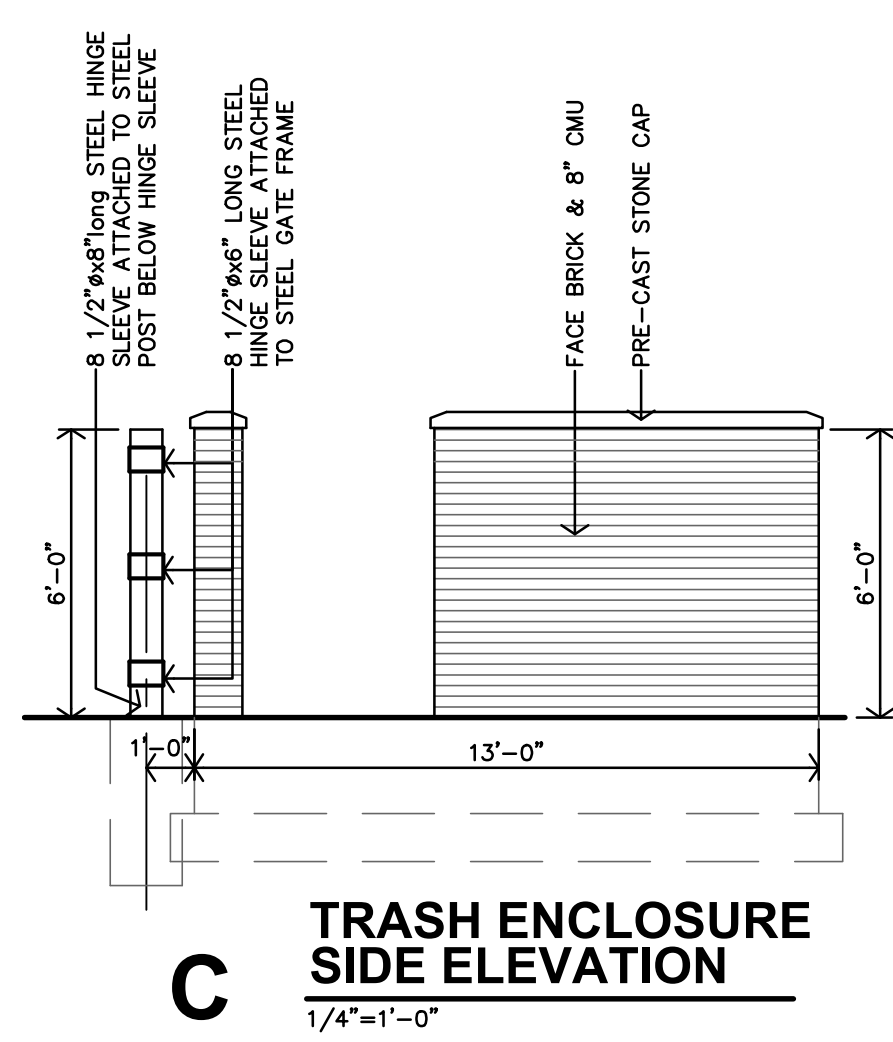

C TRASH ENCLOSURE SIDE ELEVATION
1/4"=1'-0"

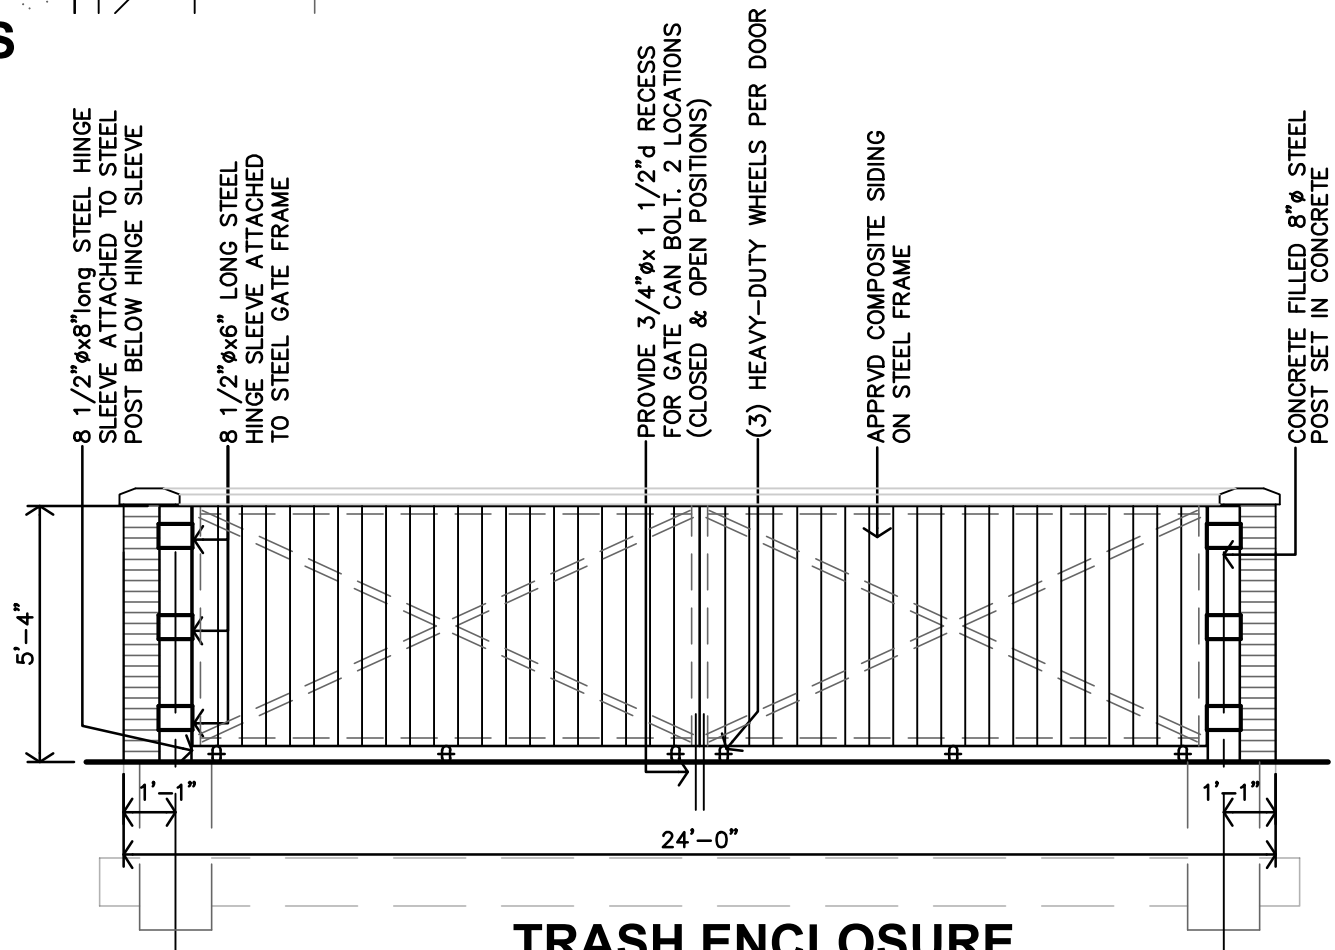

B TRASH ENCLOSURE FRONT ELEVATION
1/4"=1'-0"

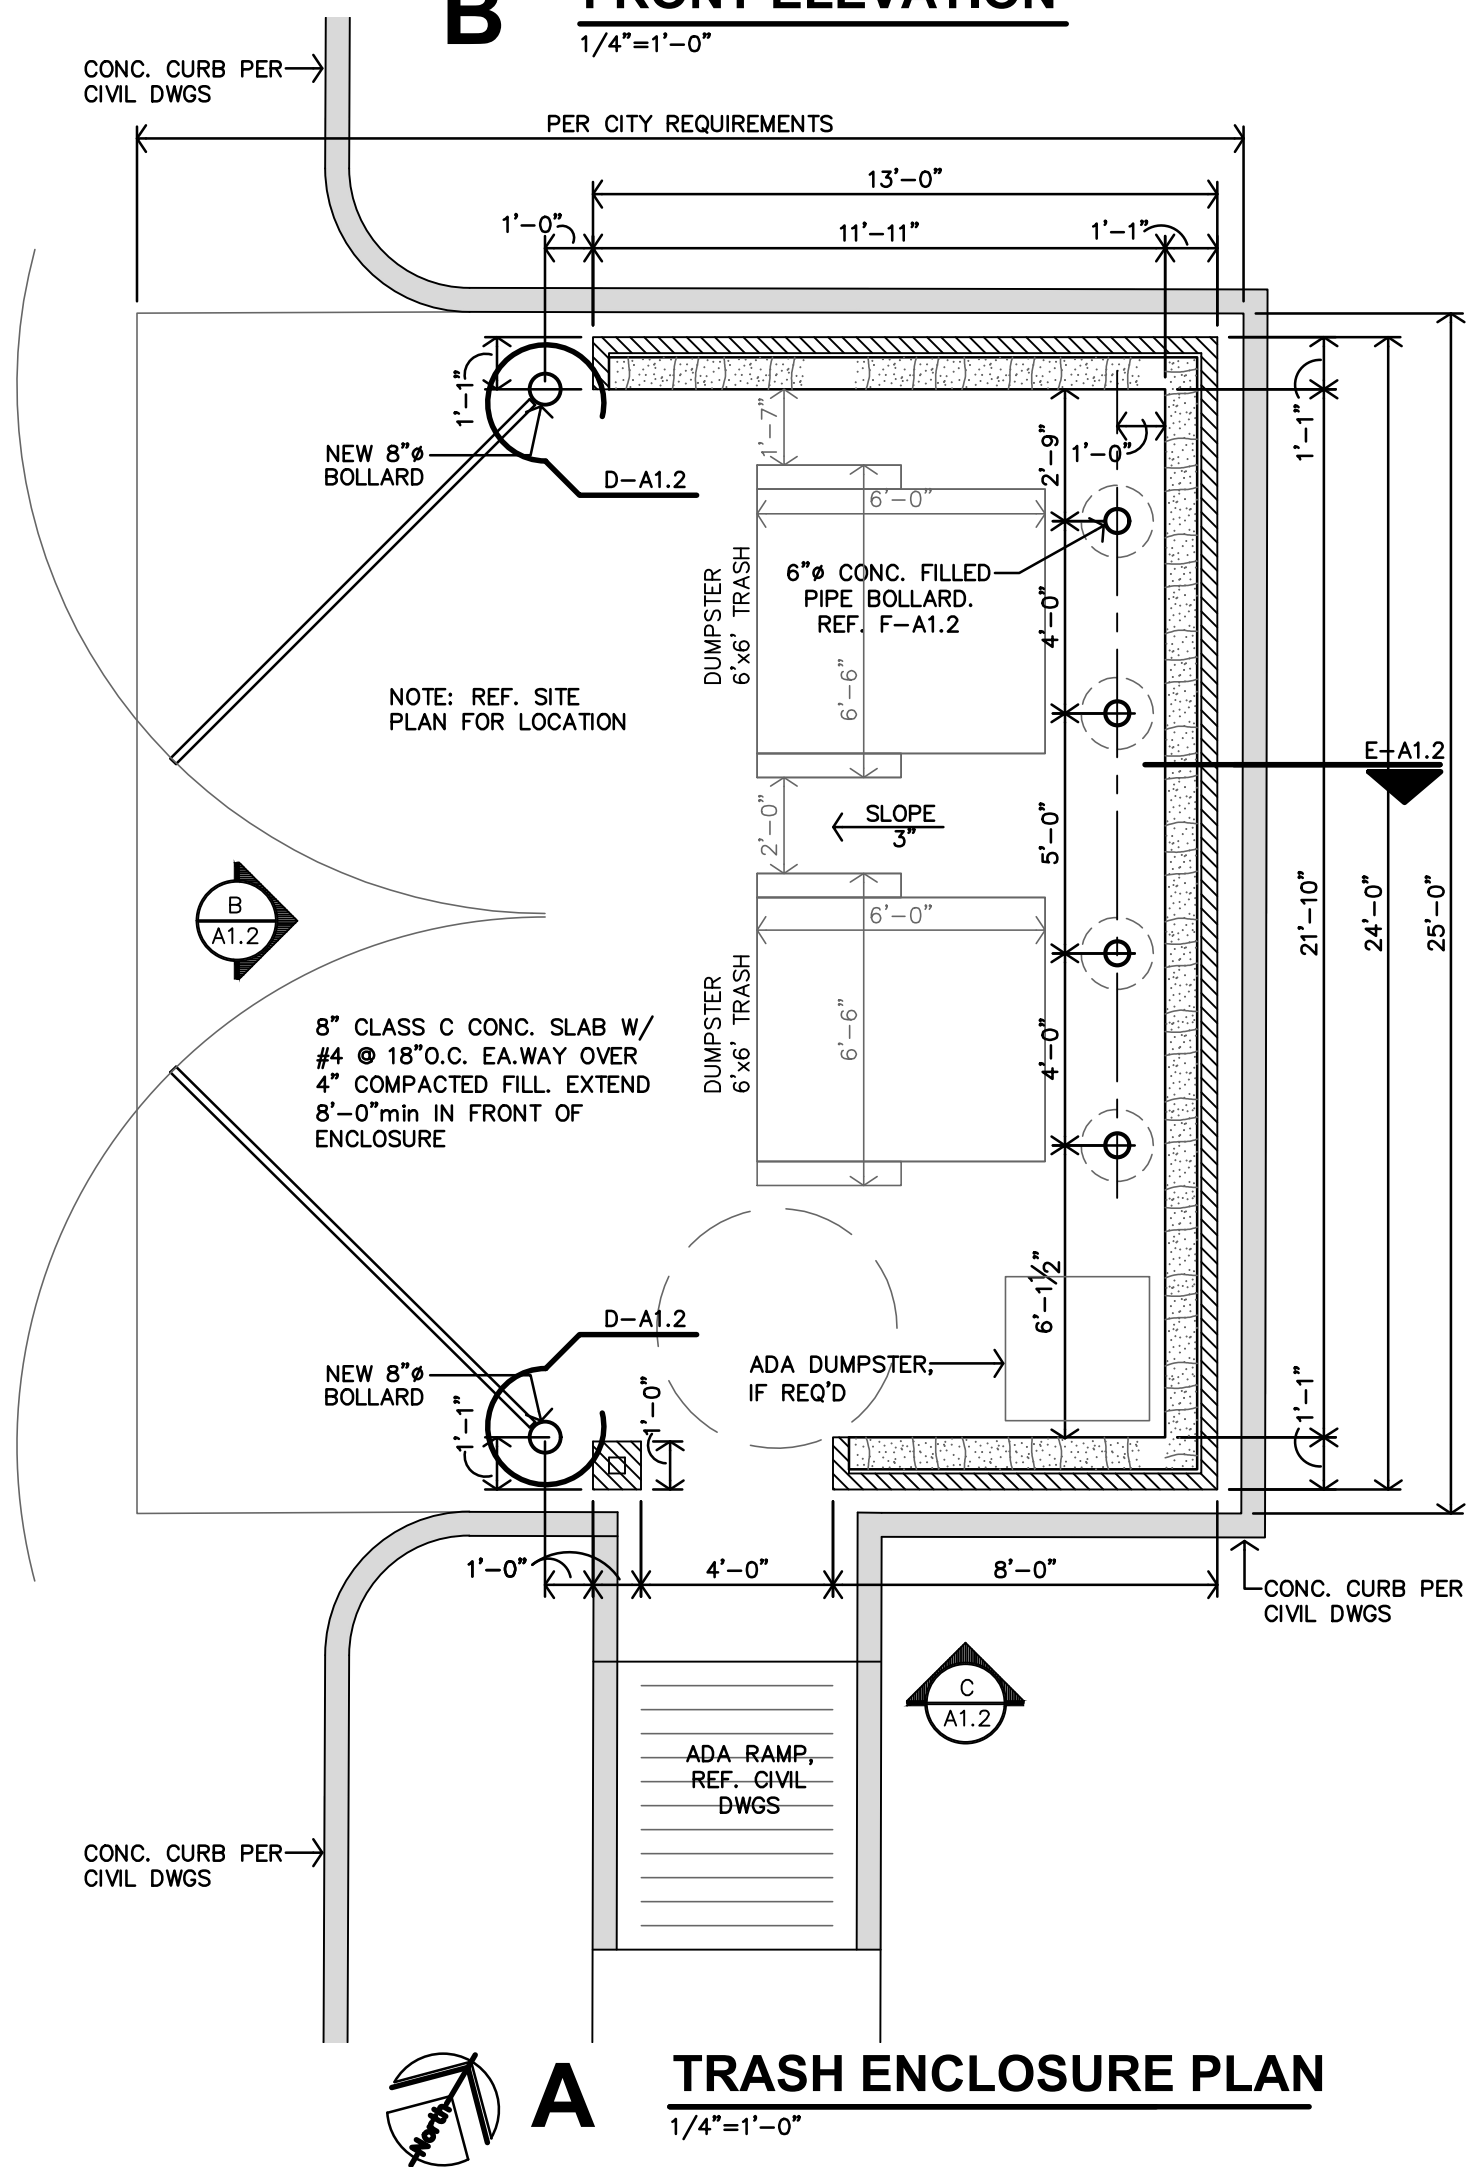

A TRASH ENCLOSURE PLAN
1/4"=1'-0"



REVISION:

DATE: 11-20-2025

JOB: 25-3479


SHEET NO.:

A1.2

THE IRVING LOFTS
HISTORIC RESTORATION & REHAB APARTMENTS
CLEBURNE, TEXAS

JGR
Jones Gillam Renz
1881 Main Street, Suite 301
Kansas City, MO 64108
730 N. Ninth
Salina, KS 67401
785.827.0386
jgr@jgarchitects.com

COPYRIGHTED ©



1. REF SHEET A2.0 FOR UNIT GENERAL NOTES, PARTITION SCHEDULE, KITCHEN/BATH MATRIX AND STANDARD DETAILS.

VCT	NEW VINYL COMPOSITION TILE	LVT	NEW LUXURY VINYL TILE (NOT SIM. WOOD)
WOOD	EXISTING WOOD, REFINISHED	HIST. TILE	HISTORIC TILE TO REMAIN, CLEAN & REPAIR
E CONC.	EXISTING PAINTED CONCRETE SQUARES		

FINISHES & INSTRUCTIONS												
P1 LATEX PAINT		EWD ENGINEERED WOOD FLR'G					CT CERAMIC TILE					
P2 EPOXY PAINT		VET VINYL ENHANCED TILE					TX TEXTURE					
C CARPET		LVT LUXURY VINYL TILE					E EXISTING					
DESCRIPTION	FLOOR		BASE		WALLS		CEILING		REMARKS			
	LUXURY VINYL TILE		NEW WOOD, PAINT		GYPSUM BOARD EXIST. PLASTER (note 15)		(E) PLASTER & BEAMS NEW GYP BD. SUSP					
ALL APARTMENT UNITS												
KITCHEN	LVT		WD		P1			P1				
LIVING ROOM	LVT		WD		P1			P1				
BEDROOM	LVT		WD		P1			P1				
CLOSET	LVT		WD		P1			P1				
BATH	LVT		WD		P2			P2				
LAUNDRY	LVT		WD		P1			P1				


FINISHES & INSTRUCTIONS											
P1 LATEX PAINT		EWD ENGINEERED WOOD FLR'G				CT CERAMIC TILE					
P2 EPOXY PAINT		VET VINYL ENHANCED TILE				TX TEXTURE					
C CARPET		LVT LUXURY VINYL TILE				E EXISTING					
NO.	DESCRIPTION	FLOOR		BASE		WALLS		CEILING		REMARKS	
		EXIST. CONCRETE REFINISH EXISTING C.T. RESTORE	LUXURY VINYL CERAMIC TILE	WOOD CASE	EXIST. TO REMAIN SELF COVER RUBBER BASE	GYPSUM BOARD CMU BLOCK	PRE-FINISHED	GYP. BOARD	STRUCT. EXPOSED PRE-FINISHED		
C108	HALLWAY	LVT	WD					P1		NOTE 4	
C109	VESTIBULE	LVT	WD			P1		P1		NOTE 4	
C110	MECHANICAL	LVT		RB		P1		P1			
C111	TOILET		CT			P1		P1			
C112	STORAGE	LVT		RB		P1		P1			
C113	OFFICE	LVT		RB		P1		P1			
C114	SITTING RM	LVT	WD	P1		P1		P1		NOTE 4	
C115	I.T. RM	LVT						E			
C116	FIRE SPRINK	E		RB		P1		P1			

GENERAL NOTES:

- INSTALL VINYL, RUBBER, OR ALUMINUM TRANSITION STRIP BETWEEN FLOOR MATERIAL OF DIFFERING HEIGHTS INCLUDING BUT NOT LIMITED TO CONCRETE/VCT TRANSITIONS.
- ALL GYPSUM BOARD AREAS WHICH ARE ACCESSORIES TO THE ROOM INCLUDING BUT NOT LIMITED TO SOFFITS, BULKHEADS, TRIM, ETC. SHALL BE PAINTED REGARDLESS OF WHETHER IT IS ORIGINALLY INDICATED PER SCHEDULE.
- ALL G.B. WALLS & PERMANENT PARTITIONS SHALL RECEIVE WOOD BASE UNLESS NOTED OTHERWISE.
- WALL TYPE: SHOW FOR GENERAL INFORMATION ONLY. CONTRACTOR SHALL COORDINATE WALL MATERIAL W/ DRAWINGS AND FIELD CONDITIONS. ALL AREAS INDICATED TO RECEIVE NEW FINISH SHALL RECEIVE COMPLETE FINISH AS SCHEDULED AT ENTIRE ROOM. CONTRACTOR SHALL COORDINATE FINISHES AND ACCENTS WITH DETAIL AND INTERIOR ELEVATIONS.
- FLOORING CONTRACTOR SHALL VERIFY THAT SUBFLOOR IS LEVEL AND PROPERLY PREPPED, PRIOR TO INSTALLATION OF ANY FLOORING MATERIALS.
- CONTRACTOR SHALL VERIFY THAT FLOORS ARE PREPPED /"FLOORSTORED" FOR LEVEL TRANSITION BETWEEN DIFFERING MATERIALS.
- ALL H.M. DOORS & FRAMES TO BE PAINTED W/ INDUSTRIAL ENAMEL UNLESS NOTED OTHERWISE. H.M. DOORS AND FRAMES SHALL BE SANDED SMOOTH PRIOR TO PAINTING. SPRAY FINISH ONLY. NO BRUSH FINISH.
- CONTRACTOR SHALL COORDINATE WITH INTERIOR ELEVATIONS, FLOOR PLANS AND MISCELLANEOUS DETAILS TO VERIFY ALL AESTHETIC ACCENTS AND DETAILS. SHAIRED AREA REPRESENTS INTERIOR ELEVATIONS, WALL SECTIONS AND DETAILS FOR WOOD BASE AND TRIM LOCATIONS.
- STAIRS & LANDINGS, INSTALL CARPET WITH RUBBER NOSINGS.
- GRADE 4 FINISH WITH ORANGE PEEL TEXTURE AT ALL WALLS & GYP CEILINGS.

SPECIFIC FINISH NOTES:

- TYPES OF FLOORING AND LOCATION MAY VARY. REFERENCE FLOOR PLANS FOR MATERIAL CHANGES AND PATTERNS.
- FINISHES ELEVATOR MANUFACTURER RECOMMENDATIONS AND SELECTIONS. FINAL COLORS TO BE DETERMINED BY OWNER.
- STAIR TREADS AND RISERS TO BE RUBBER. LANDINGS TO BE VET TO MATCH HALLWAYS. SHAIRED AREA REPRESENTS LVT COLOR 2. UNSHADED AREA REPRESENTS LVT COLOR 1 (REFERENCE SPECIFICATIONS)

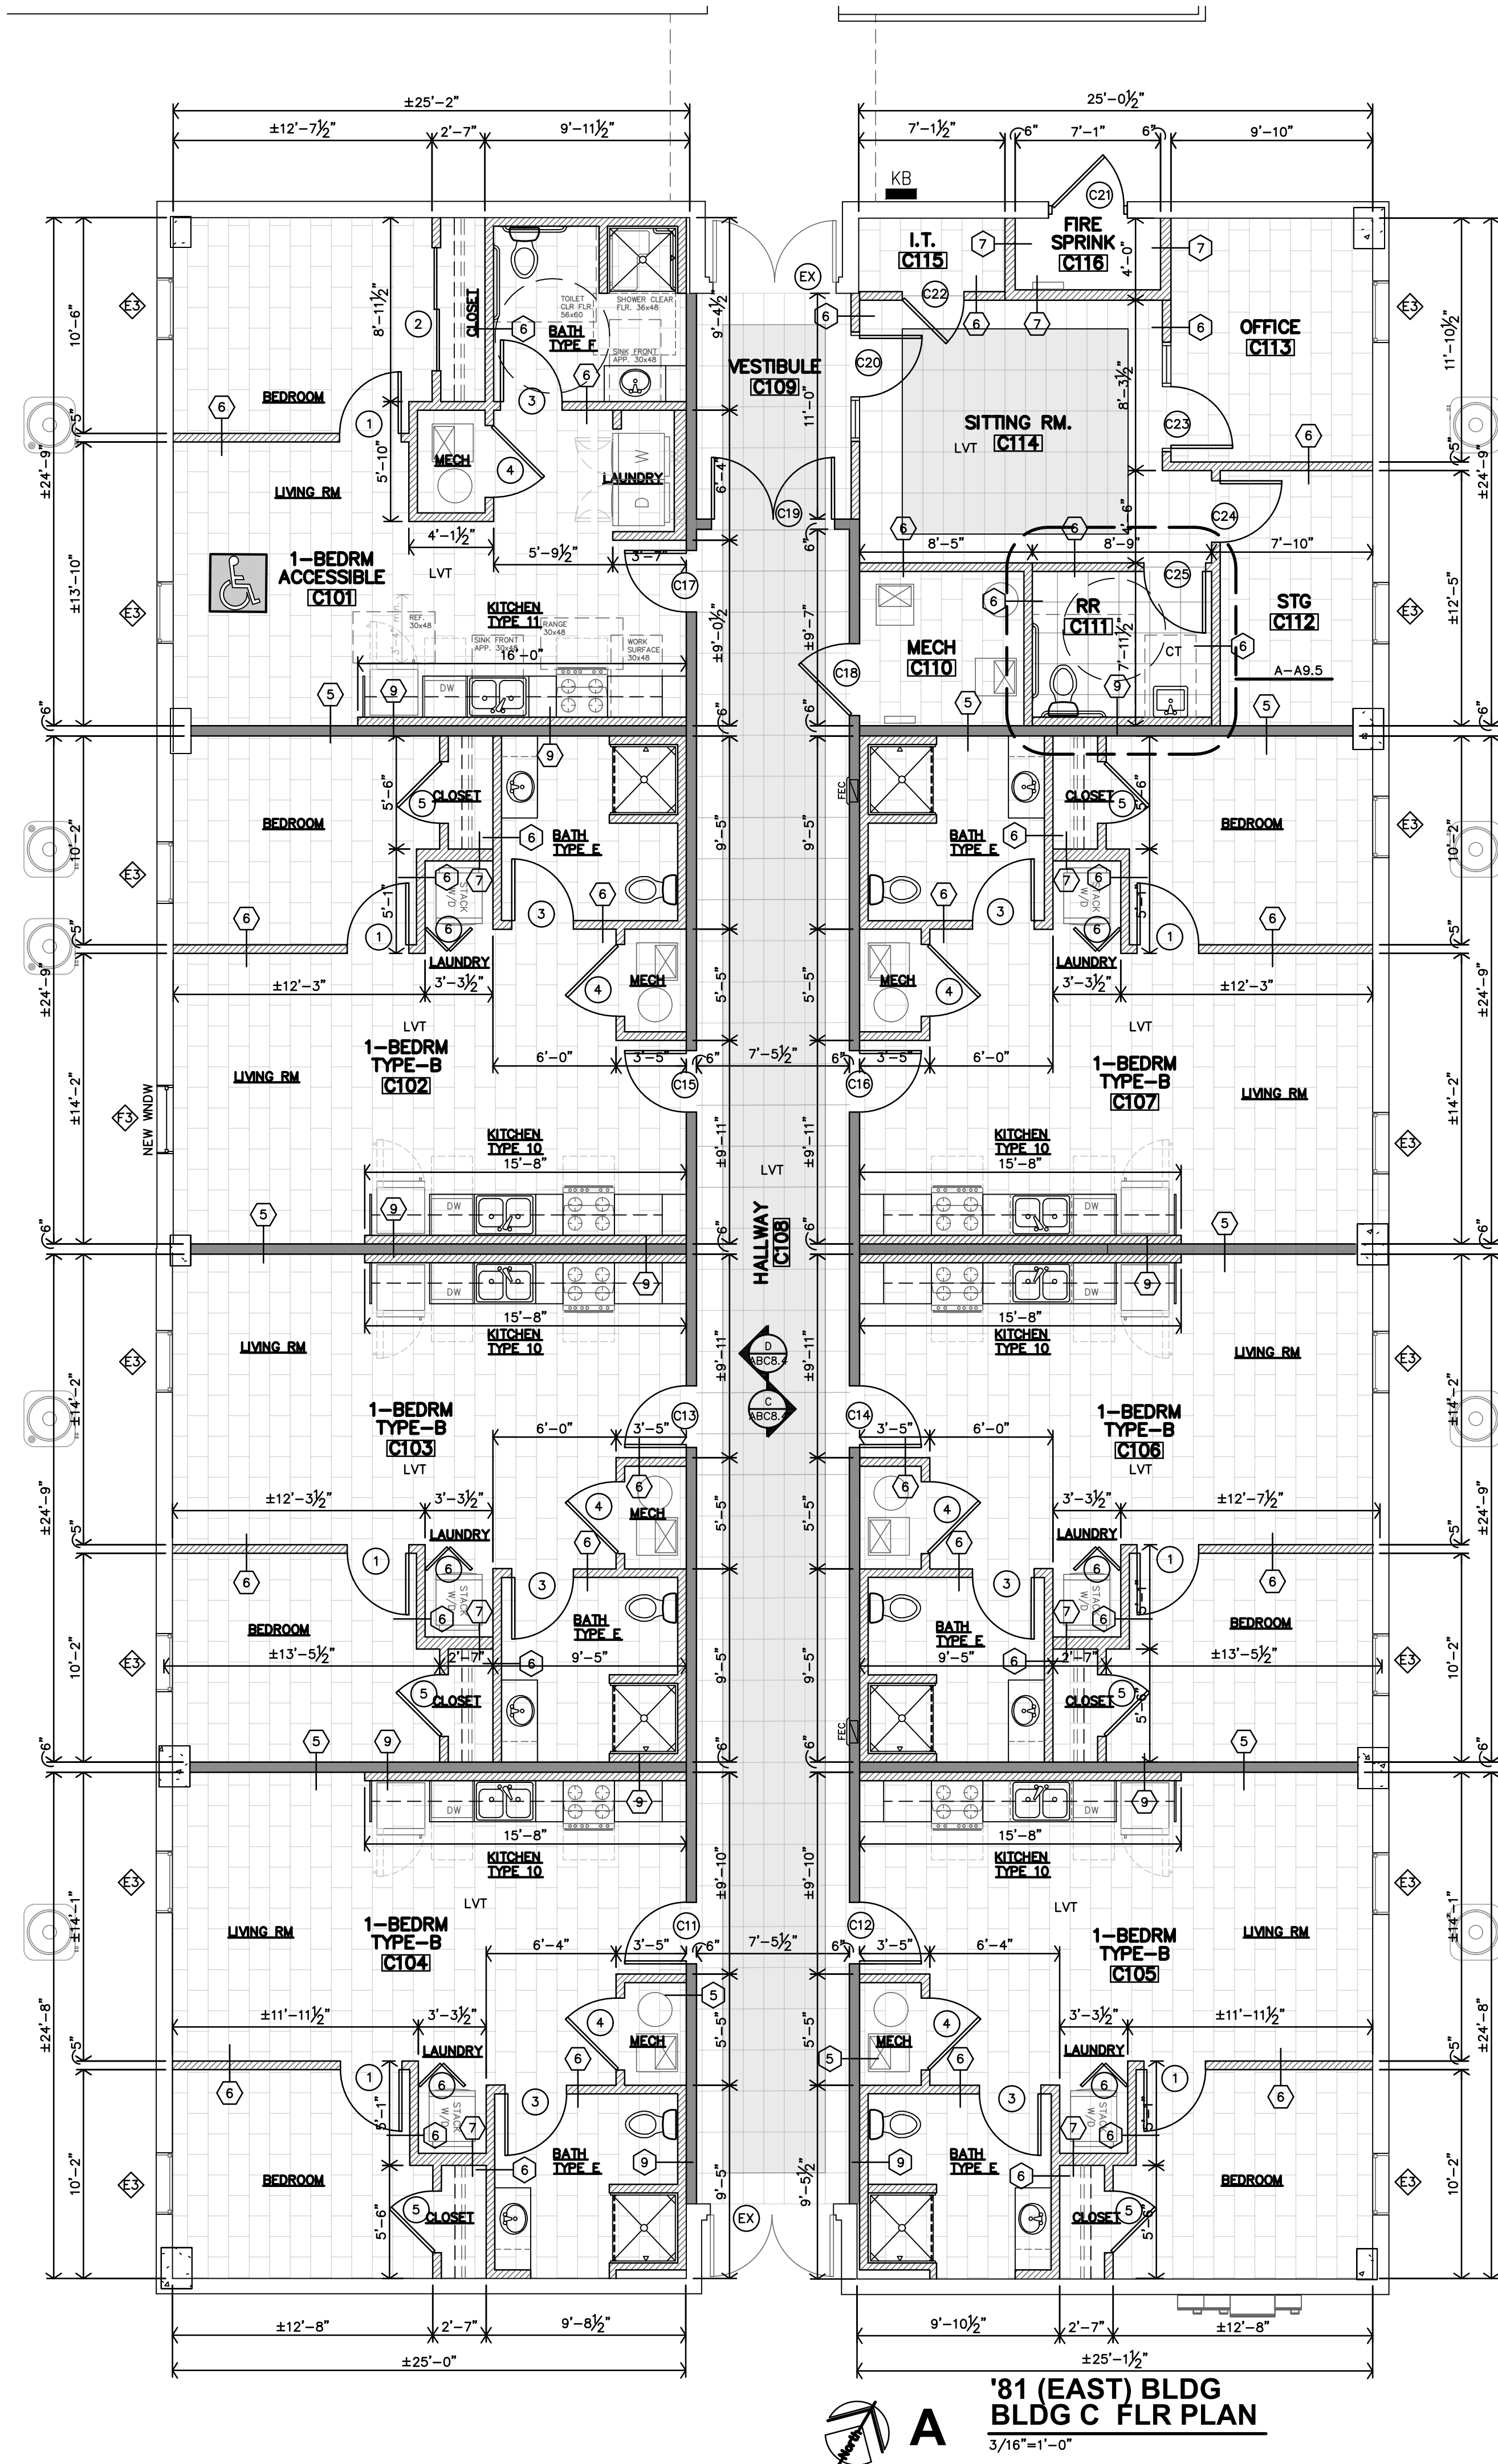

Reference Specifications & Preservation Briefs

Remove gutters and downspouts and associated hardware adjacent to masonry and prepare for replacement. Install new after tuckpointing is complete.

- Rake out and repoint joints to the following extent:
All joints in areas indicated, Joints indicated to receive sealant—filled. Seal these joints according to Section 079200 "Joint Sealants."

- Holes and missing mortar.
- Cracks that can be penetrated 1/4 inch (6 mm) or more by a knife blade 0.027 inch (0.7 mm) thick.
- Cracks 1/16 inch (1.6 mm) or more in width and of any depth.
- Hollow-sounding joints when tapped by metal object.
- Eroded surfaces 1/4 inch (6 mm) or more deep.
- Deterioration to point that mortar can be easily removed by hand, without tools.
- Joints filled with substances other than mortar.

- Remove mortar from joints to 2 times joint width, but not less than 3/4 inch (20 mm) or not less than that required to expose sound, unweathered mortar. Do not remove unsound mortar more than 2 inches (50 mm) deep; consult Architect or Engineer for direction.
- Remove mortar from masonry surfaces within raked-out joints to provide recessed surface for contact with new masonry or contact with reinforcing mortar. Brush, vacuum, or flush joints to remove dirt and loose debris.
- Do not spall edges of masonry units or wide joints. Replace or patch damaged masonry units as directed by Architect.

- Rinse joint surfaces with water to remove dust and mortar particles. Time rinsing application so, at time of pointing, joint surfaces are damp but free of standing water. If rinse water dries, dampen joint surfaces before pointing.
- Apply pointing mortar first to areas where existing mortar was removed to depths greater than surrounding areas. Apply in layers not greater than 3/8 inch (9 mm) until a uniform depth is formed. Fully compact each layer, and allow it to become thumbprint hard before applying next layer.
- After deep areas have been filled to same depth as remaining joints, point joints by placing mortar in layers not greater than 3/8 inch (9 mm). Fully compact each layer and allow to become thumbprint hard before applying next layer. Where existing masonry units have worn or rounded edges, slightly recess finished mortar surface below face of masonry to avoid widened joint faces. Take care not to spread mortar beyond joint edges onto exposed masonry surfaces or to feather edge the mortar.
- When mortar is thumbprint hard, tool joints to match original appearance of joints as demonstrated in approved mockup. Remove excess mortar from edge of joint by brushing.
- Cure mortar by maintaining in thoroughly damp condition for at least 72

Where repointing work precedes cleaning of existing masonry, allow mortar to harden at least 30 days before beginning cleaning work.

After mortar has fully hardened, thoroughly clean exposed masonry surfaces of excess mortar and foreign matter; use wood scrapers, stiff-nylon or -fiber brushes, and clean water, applied by low pressure spray.

- Do not use metal scrapers or brushes.
- Do not use acidic or alkaline cleaners.

Reference Specifications & Preservation Briefs

Preservation Brief 38 includes information regarding removing graffiti, means and methods, testing, protection, and other information. Reference entire brief for direction on how to safely remove graffiti from brick and stone (both exterior and interior)

Reference Specifications & Preservation Briefs

The general nature and source of dirt or soiling material on a building must be identified to remove it in the gentlest means possible—that is, in the most effective, yet least harmful, manner. Soot and smoke, for example, require a different cleaning agent to remove than oil stains or metallic stains. Other common cleaning problems include biological growth such as mold or mildew, and organic matter such as the tendrils left on masonry after removal of ivy.

Some gypsum or sulfate crusts may have become integral with the stone and, if cleaning could result in removing some of the stone surface, it may be preferable not to clean. Even where unpainted masonry is appropriate, the retention of the paint may be more practical than removal in terms of long range preservation of the masonry. In some cases, however, removal of the paint may be desirable. For example, the old paint layers may have built up to such an extent that removal is necessary to ensure a sound surface to which the new paint will adhere.

Although not always necessary, in some instances it can be beneficial to have the coating or paint type, color, and layering on the masonry researched before attempting its removal. Analysis of the nature of the salting or of the paint to be removed from the masonry, as well as the type of masonry, will determine the most appropriate cleaning method, may be provided by professional consultants, including architectural conservators, conservation scientists, and preservation architects. The State Historic Preservation Office (SHPO), local historic district commissions, architectural review boards, and preservation-oriented websites may also be able to supply useful information on masonry cleaning techniques.

Previous treatments of the building and its surroundings should be researched and building maintenance records should be obtained, if available. Sometimes if streaked or spotty areas do not seem to get cleaner following an initial cleaning, closer inspection and analysis may be warranted. The discoloration may turn out not to be dirt but the remnant of a water-repellent coating applied long ago which has darkened the surface of the masonry over time. Successful removal may require testing several cleaning agents to find something that will dissolve and remove the coating. Complete removal may not always be possible. Repairs may have been stained to match a dirty building, and cleaning may make these differences apparent. De-icing salts used near the building that have dissolved can migrate into the masonry. Cleaning may draw the salts to the surface, where they will appear as efflorescence (a powdery, white substance), which may require a second treatment to be removed. Allowances for dealing with such unknown factors, any of which can be a potential problem, should be included when investigating cleaning methods and materials. Just as more than one kind of masonry on a historic building may necessitate multiple cleaning approaches, unknown conditions that are encountered may also require additional cleaning treatments.

The importance of testing cleaning methods and materials cannot be over emphasized. Applying the wrong cleaning agents to historic masonry can have disastrous results. Acid cleaners can be extremely damaging to acid-sensitive stones, such as marble and limestone, resulting in etching and dissolution of these stones. Other kinds of masonry can also be damaged by incompatible cleaning agents or even by cleaning agents that are usually compatible. There are also numerous kinds of sandstone, each with a considerably different geological composition. While an acid-based cleaner may be safely used on some sandstones, others are acid-sensitive and can be severely etched or dissolved by an acid cleaner. Some sandstones contain water-soluble minerals and can be eroded by water cleaning. And, even if the stone type is correctly identified, stones, as well as some bricks, may contain unexpected impurities, such as iron particles, that may react negatively with a particular cleaning agent and result in staining. Thorough understanding of the physical and chemical properties of the masonry will help avoid the inadvertent selection of damaging cleaning agents. Other building materials also may be affected by the cleaning process. Some chemicals, for example, may have a corrosive effect on paint or glass. The portions of building elements most vulnerable to deterioration may not be visible, such as embedded ends of iron window bars. Other totally unseen items, such as leaded glass panes or lead flashing, may be structurally weakened and may be subject to corrosion from the use of chemicals or from plain water. The only way to prevent problems in these cases is to study the building construction in detail and evaluate proposed cleaning methods with this information in mind. However, due to the very likely possibility of encountering unknown factors, any cleaning project involving historic masonry should be viewed as unique to that particular building.

Reference specifications & Preservation Briefs.

- Removal of interior and exterior paint;
- Removal and repair of sash (including glazing where necessary);
- Repairs to frame;
- Weatherstripping and reinstallation of the sash;
- Repainting

Paint removal should begin on the interior frames, being careful to remove the paint from the interior stop and the parting bead, particularly along the seam where these stops meet the jamb. This can be accomplished by running a utility knife along the length of the seam, breaking the paint bond. It will then be much easier to remove the stop, the parting bead and the sash. The interior stop may be initially loosened from the sash side to avoid visible scarring of the wood and then gradually pried loose using a pair of putty knives, working up and down the stop in small increments. With the stop removed, the lower or interior sash may be withdrawn. The sash cords should be detached from the sides of the sash and their ends may be pinned with a nail or tied in a knot to prevent them from falling into the weight pocket.

Removal of the upper sash on double-hung units is similar but the parting bead which holds it in place is set into a groove in the center of the stile and is thinner and more delicate than the interior stop. After removing any paint along the seam, the parting bead should be carefully pried out and worked free in the same manner as the interior stop. The upper sash can then be removed in the same manner as the lower one and both sash taken to a convenient work area (in order to remove the sash the interior stop and parting bead need only be removed from one side of the window). Window openings can be covered with polyethylene sheets or plywood sheathing while the sash are out for repair.

The sash can be stripped of point using appropriate techniques, but if any heat treatment is used, the glass should be removed or protected from the sudden temperature change which can cause breakage. An overlay of aluminum foil on gypsum board or asbestos can protect the glass from such rapid temperature change. It is important to protect the glass because it may be historic and often adds character to the window. Deteriorated putty should be removed manually, taking care not to damage the wood along the rabbet. If the glass is to be removed, the glazing points which hold the glass in place can be extracted and the panes numbered and removed for cleaning and reuse in the same openings. With the glass pane out, the rabbet putty can be removed and the sash can be sanded, scraped, and primed with a preservative primer. Hardened putty in the rabbets may be softened by heating with a soldering iron at the point of removal. Putty remaining on the glass may be softened by soaking the panes in linseed oil, and then removed with less risk of breaking the glass. Before reinstalling the glass, a bead of glazing compound or linseed oil putty should be laid around the rabbet to cushion and seal the glass. Glazing compound should only be used on wood which has been brushed with linseed oil and primed with an oil-based primer or paint. The pane is then pressed into place and the glazing points are pushed into the wood around the perimeter of the pane.

The final glazing compound or putty is applied and beveled to complete the seal. The sash can be refinished as desired on the inside and painted on the outside as soon as a "skin" has formed on the putty, usually in 2 or 3 days. Exterior paint should cover the beveled glazing compound or putty and lap over onto the glass slightly to complete a weather-tight seal. After the proper curing times have elapsed for paint and putty, the sash will be ready for reinstallation.

While the sash are out of the frame, the condition of the wood in the jamb and sill can be evaluated. Repair and refinishing of the frame may proceed concurrently with repairs to the sash, taking advantage of the curing times for the paints and putty used on the sash. One of the most common work items is the replacement of the sash cords with new rope cords or with chains. The weight pocket is frequently accessible through a door on the face of the frame near the sill, but if no door exists, the weight pocket on the interior face may be removed for access. Sash weights may be greased for easier window operation by elderly or handicapped persons. Additional repairs to the frame and sash may include consolidation or replacement of deteriorated wood. Techniques for these repairs are discussed in the following sections.

The operations just discussed summarize the efforts necessary to restore a window with minor deterioration to "like new" condition. The techniques can be applied by an unskilled person with minimal training and experience. To demonstrate the practicality of this approach, and photograph it, a Technical Preservation Services staff member repaired a wooden double-hung, two over two window which had been in service over ninety years. The wood was structurally sound but the window had one broken pane, many layers of paint, broken sash cords and inadequate, worn-out weatherstripping. The staff member painted both sides of the frame, covered the paint and the sash cords with a quite elastic paint, and the glass was glazed and glazed about one hour for each sash, and the reglazing of both sash was accomplished in about one hour. Weatherstripping of the sash and frame, replacement of the sash cords and reinstallation of the sash, parting bead, and stop required an hour and a half. These times refer only to individual operations; the entire process took several days due to the drying and curing times for putty, primer, and paint, however, work on other window units could have been in progress during these lag times.

- Dry the wood;
- Treat decayed areas with a fungicide;
- Waterproof with two or three applications of boiled linseed oil (applications every 24 hours);
- Fill cracks and holes with putty;
- After a 'skin' forms on the putty, paint the surface.

Care should be taken with the use of fungicide which is toxic. Follow the manufacturers' directions and use only on areas which will be painted. When using any technique of building up or patching a flat surface, the finished surface should be sloped slightly to carry water away from the window and not allow it to puddle. Caulking of the joints between the sill and the jamb will help reduce further water penetration.

When sills or other members exhibit surface weathering, they may also be built-up using wood putties or homemade mixtures such as sawdust and resorcinol glue, or whitening and varnish. These mixtures can be built up in successive layers, then sanded, primed, and painted. The same caution about proper slope for flat surfaces applies to this technique.

Wood may also be strengthened and stabilized by consolidation, using semirigid epoxies which saturate the porous decayed wood and then harden. The surface of the consolidated wood can then be filled with a semirigid epoxy patching compound, sanded and painted. Epoxy patching compounds can be used to build up missing sections or decayed ends of members. Profiles can be duplicated using hand molds, which are created by pressing a ball of patching compound over a sound section of the profile which has been rubbed with butcher's wax. This can be a very efficient technique where there are many typical repairs to be done. The process has been widely used and proven in marine applications; and proprietary products are available at hardware and marine supply stores. Although epoxy materials may be comparatively expensive, they hold the promise of being among the most durable and long-lasting materials available for wood repair. More information on epoxies can be found in the publication "Epoxies for Wood Repairs in Historic Buildings," cited in the bibliography.

Any of the three techniques discussed can stabilize and restore the appearance of the window unit. There are times, however, when the degree of deterioration is so advanced that stabilization is impractical, and the only way to retain some of the original fabric is to replace damaged parts.

When parts of the frame or sash are so badly deteriorated that they cannot be stabilized there are methods which permit the retention of some of the existing or original fabric. These methods involve replacing the deteriorated parts with new matching pieces, or splicing new wood into existing members. The technique requires great skill and is usually quite expensive. In the previous discussion of alternatives, it is necessary to remove the sash and/or the affected parts of the frame and have a carpenter or woodworker mill reproduce the damaged or missing parts. Most millwork firms can duplicate parts, such as muntins, bottom rails, or sills, which can then be incorporated into the existing window, but it may be necessary to shop around because there are several factors controlling the practicality of this approach. Some woodworking mills do not like to repair old sash because nails or other foreign objects in the sash can damage expensive knives (which cost far more than their profits on small repair jobs); others do not have cutting knives to duplicate muntin profiles. Some firms prefer to concentrate on larger jobs with more profit potential, and some may not have a craftsman capable of duplicating the intricate shapes and profiles of old sash. One will do the job, and at a reasonable price, if such a firm does not exist locally, there are firms which undertake this kind of repair and ship nationwide. It is possible, however, for the advanced do-it-yourselfer or craftsman with a table saw to duplicate moulding profiles using techniques discussed by Gordie Whittington in "Simplified Methods for Reproducing Wood Mouldings," Bulletin of the Association for Preservation Technology, Vol. III, No. 4, 1971, or illustrated more recently in *The Old House, Time-Life Books, Alexandria, Virginia, 1979.*

The repairs discussed in this section involve window frames which may be in very deteriorated condition, possibly requiring removal; therefore, caution is in order. The actual construction of wooden window frames and sash is not complicated. Pegged mortise and tenon units can be disassembled easily, if the units are out of the building. The installation or connection of some frames to the surrounding structure, especially masonry walls, can complicate the work immeasurably, and may even require dismantling of the wall. It may be useful, therefore, to take the following approach to frame repair:

1. conduct regular maintenance of sound frames to achieve the longest life possible,
2. make necessary repairs in place, wherever possible, using stabilization and splicing techniques, and
3. if removal is necessary, thoroughly investigate the structural detailing and seek appropriate professional consultation.


Another alternative may be considered if parts replacement is required, and that is sash replacement. If extensive replacement of parts is necessary and the job becomes prohibitively expensive it may be more practical to purchase new sash which can be installed into the existing frames. Such sash are available as exact custom reproductions, reasonable facsimiles (custom windows with similar profiles), and contemporary wooden sash which are similar in appearance. There are companies which still manufacture high quality wooden sash which would duplicate most historic sash. A few calls to local building suppliers may provide a source of appropriate replacement sash, but if not, check with local historical associations, the state historic preservation office, or preservation related magazines and supply catalogs for information.

If a rehabilitation project has a large number of windows such as a commercial building or an industrial complex, there may be less of a problem arriving at a solution. Once the evaluation of the windows is completed and the scope of the work is known, there may be a potential economy of scale. Woodworking mills may be interested in the work from a large project; new stock in volume may be considerably less expensive per unit; crews can be assembled and trained on site to perform all of the window repairs; and a few extensive repairs can be absorbed (without undue burden) into the total budget for a large number of saved windows. While it may be expensive for the average historic home owner to pay seventy dollars or more for a mill to grind a custom knife to duplicate four or five bad muntins, that cost becomes negligible on large commercial projects which may have several hundred windows.


Most windows should not require the extensive repairs discussed in this section. The ones which do are usually in buildings which have been abandoned for long periods or have totally lacked maintenance for years. It is necessary to thoroughly investigate the alternatives for windows which do require extensive repairs. The aim is at a solution which retains the historic significance and is economically feasible. Even for projects requiring repairs identified in this section, if the percentage of parts replacement per window is low, or the number of windows requiring repair is small, repair can still be a cost-effective solution.

A window which is repaired should be made as energy efficient as possible by the use of appropriate weatherstripping to reduce air infiltration. A wide variety of products are available, particularly at the hardware store. They may be fastened to the top, bottom, and/or leading rails, but may have the disadvantage of absorbing and holding moisture, particularly at the sash and jamb. Rolled vinyl strips may also be tacked into place in appropriate locations to reduce infiltration. Metal strips or new plastic spring strips may be used on the rails and, if space permits, in the channels between the sash and jamb. Weatherstripping is a historic treatment, but old weatherstripping (felt) is not likely to perform very satisfactorily. Appropriate contemporary weatherstripping should be considered an integral part of the repair process for windows. The use of sealant to fill the gaps between the meeting surfaces of the sashes are kept tightly closed so that the weatherstripping will function more effectively to reduce infiltration. Although such locks will not always be historically accurate, they will usually be viewed as an acceptable contemporary modification in the interest of improved thermal performance.


Many styles of storm windows are available to improve the thermal performance of existing windows. The use of exterior storm windows should be investigated whenever feasible because they are thermally efficient, cost-effective, reversible, and allow the retention of original windows (see "Preservation Briefs: 3"). Storm window frames may be made of wood, aluminum, vinyl, or plastic; however, the use of unfinished aluminum storms should be avoided. The visual impact of storms may be minimized by selecting colors which match existing trim color. Arched top storms are available for windows with special shapes. Although interior storm windows appear to offer an attractive option for achieving double glazing with minimal visual impact, the potential for damaging condensation problems must be addressed. Moisture which becomes trapped between the layers of glazing can condense on the colder, outer prime window, potentially leading to deterioration. The correct approach to using interior storms is to create a seal on the interior storm while allowing some ventilation around the prime window. In actual practice, the creation of such a durable, airtight seal is difficult.

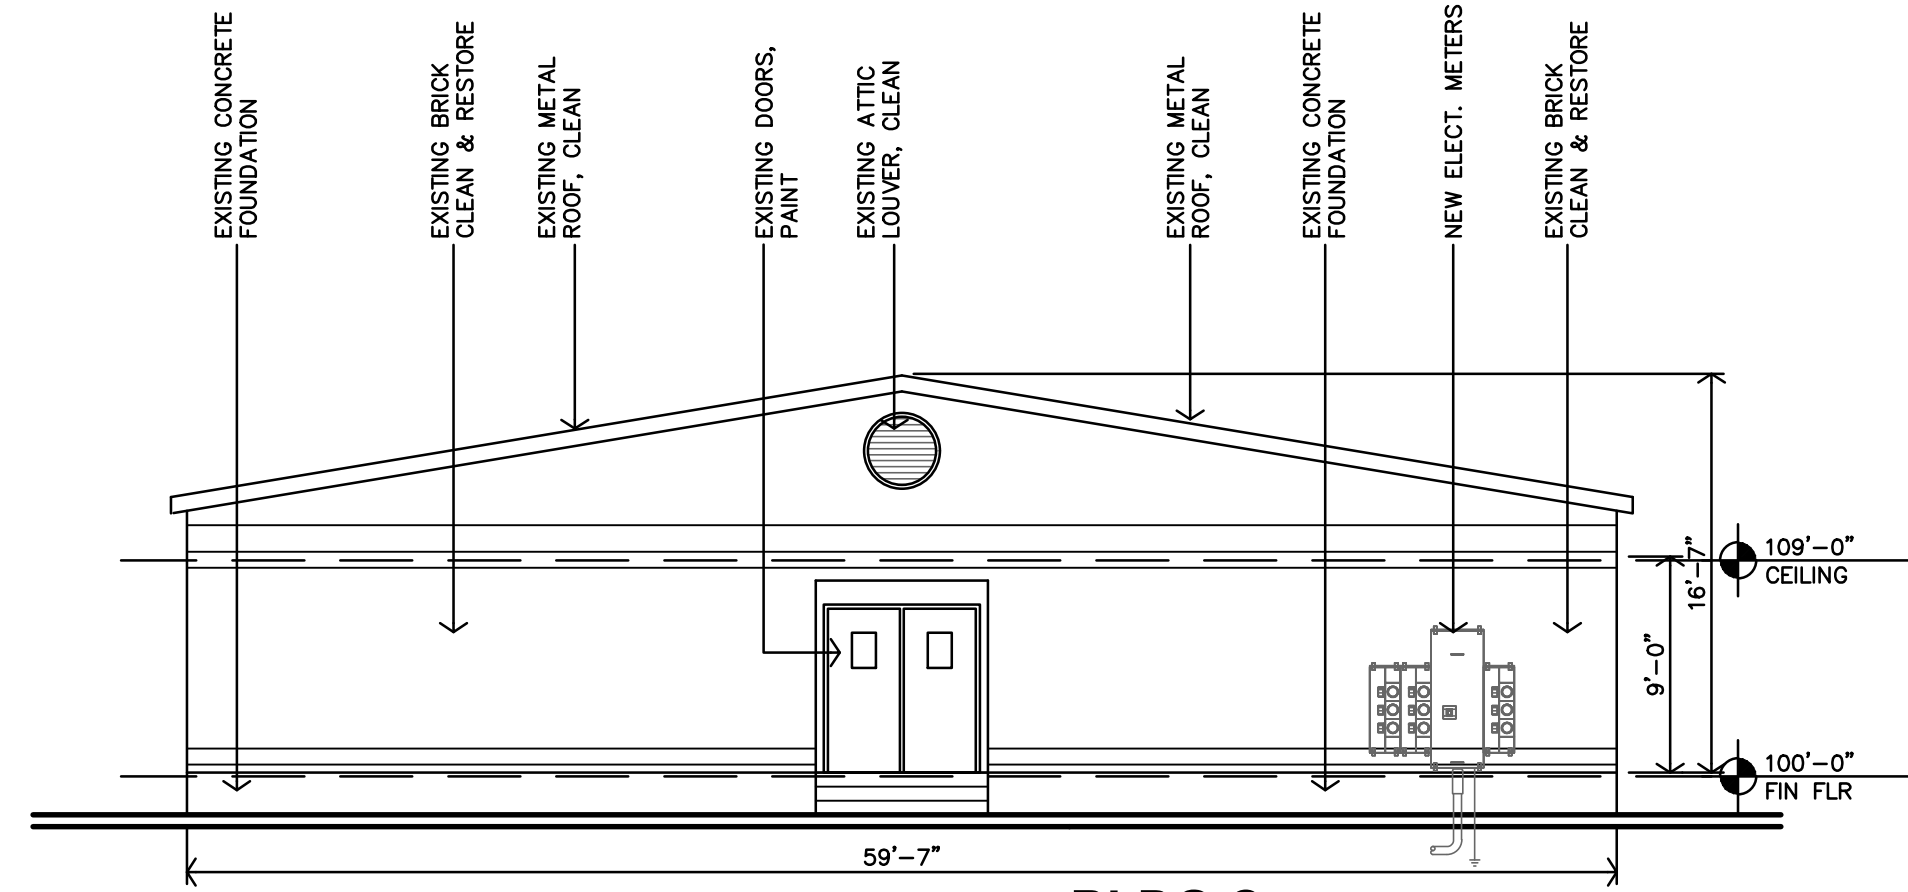


D
BLDG C
SOUTH ELEVATION
1/8"=1'-0"

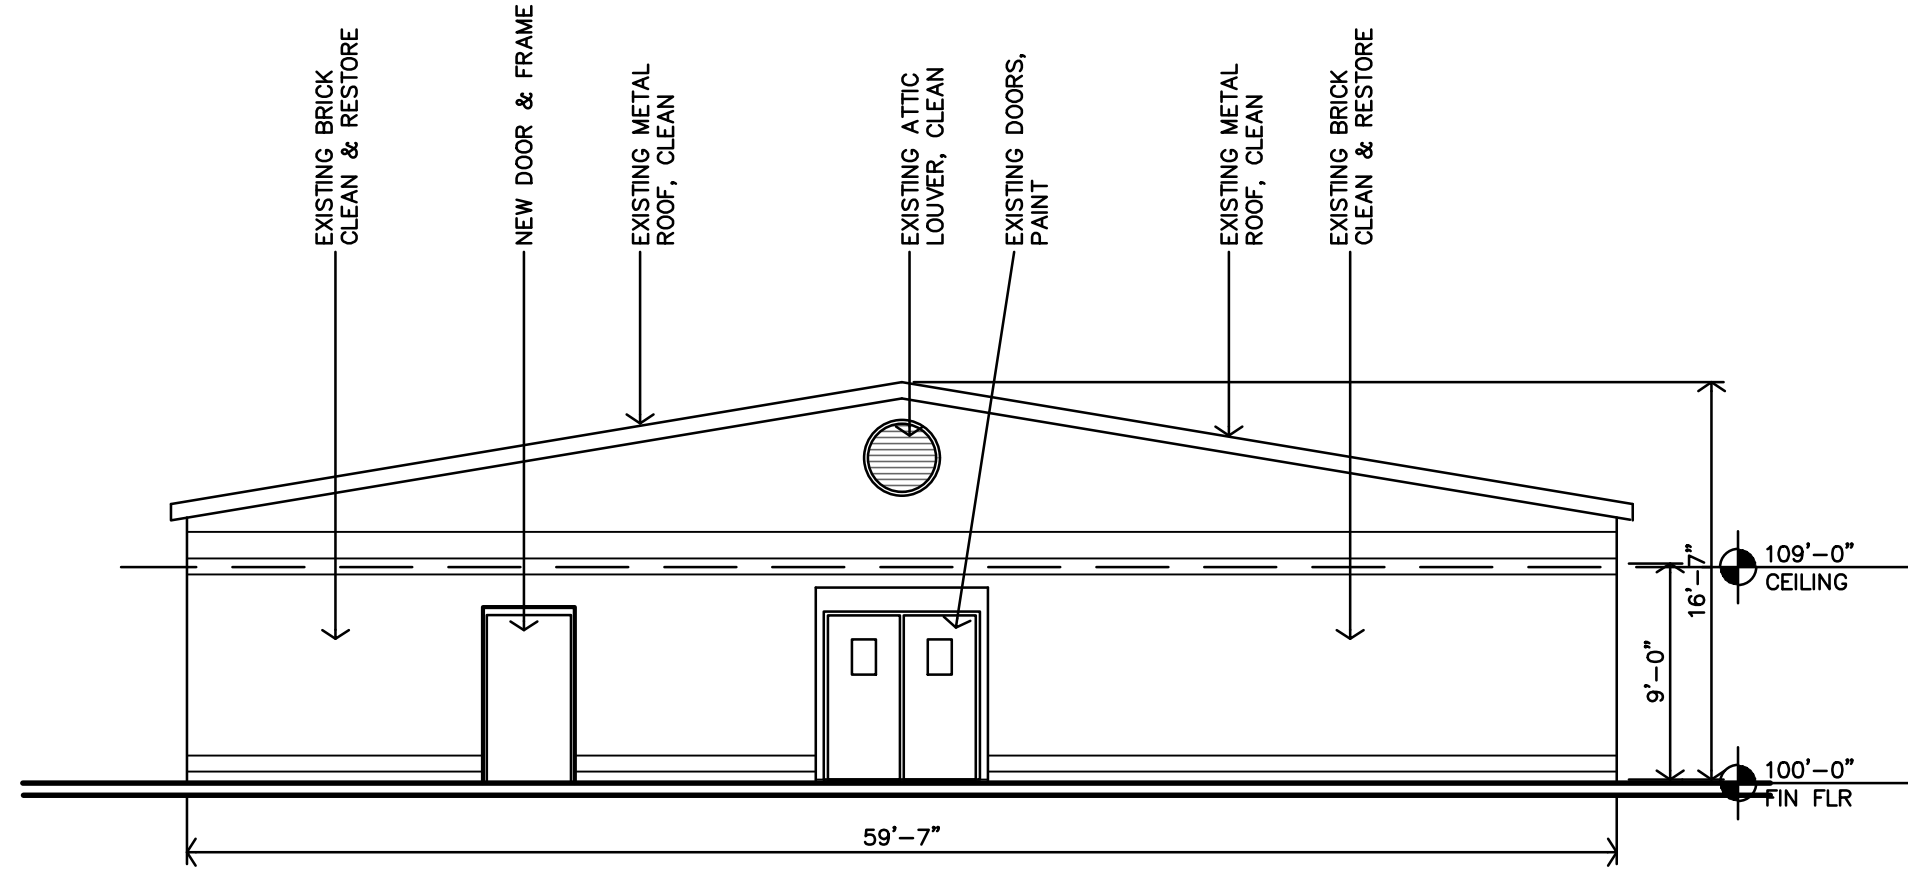


B
BLDG C
NORTH ELEVATION
1/8"=1'-0"

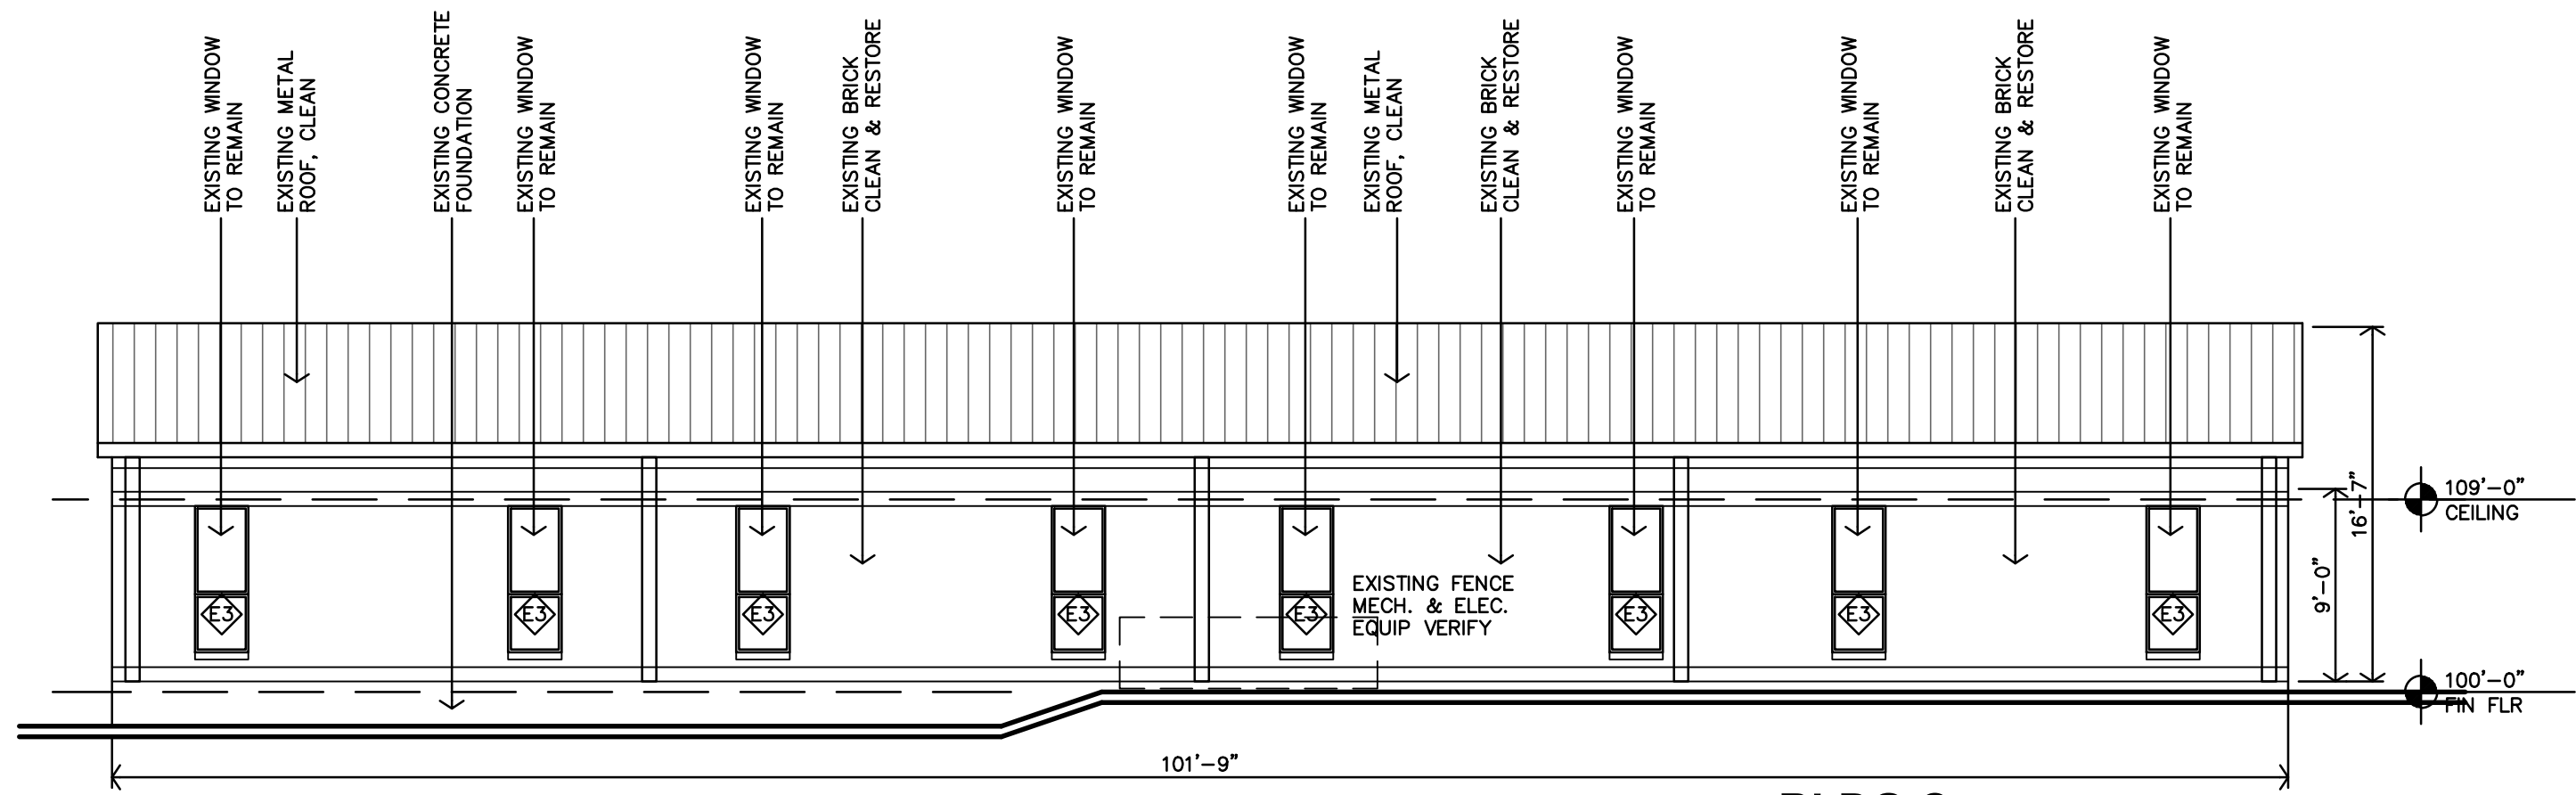

C
BLDG C
EAST ELEVATION
1/8"=1'-0"

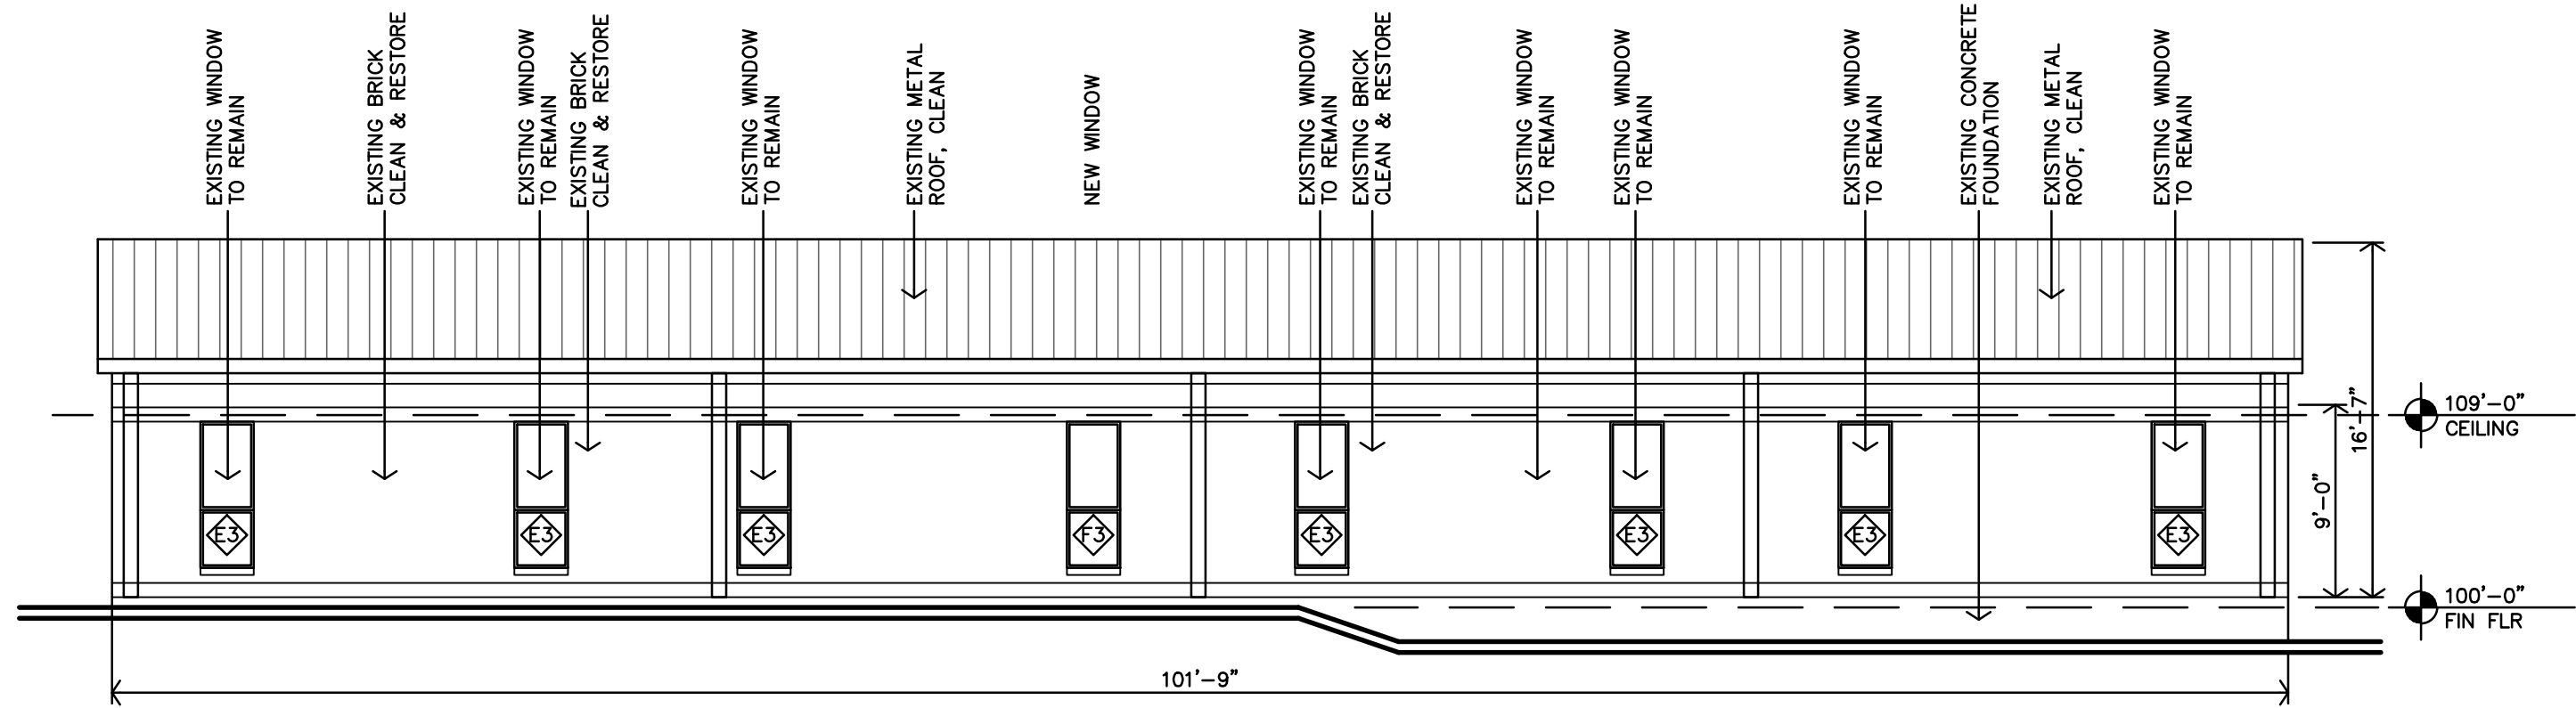

A
BLDG C
WEST ELEVATION
1/8"=1'-0"

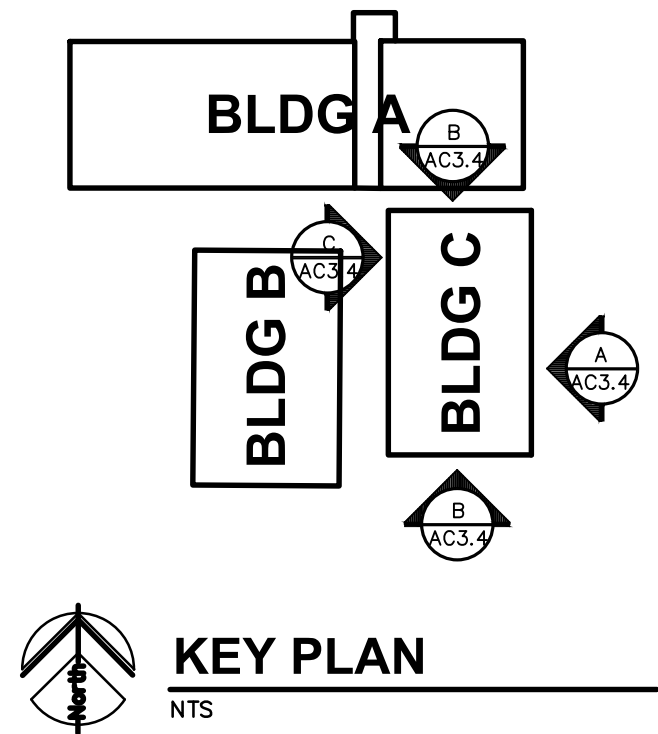

BUILDING C



REVISION:

DATE: 11-20-2025

JOB: 25-3479

SHEET NO.:

AC3.4

THE IRVING LOFTS
HISTORIC RESTORATION & REHAB APARTMENTS
CLEBURNE, TEXAS

JGR
Jones Gillam Renz
730 N. Ninth
Salina, KS 67401
785.827.0386
jgr@jgarchitects.com
1881 Main Street, Suite 301
Kansas City, MO 64108
785.827.0386
jgr@jgarchitects.com

COPYRIGHTED ©

GENERAL NOTES

1

CONTRACTOR SHALL FIELD VERIFY ALL CONDITIONS PRIOR TO BIDDING. CONTACT ARCHITECT IMMEDIATELY W/ ANY DISCREPANCIES.

2

ROOFING INSTALLATION: MANUFACTURERS DETAILS ARE GENERIC/GENERAL. CONTRACTOR SHALL COMPLY TO SPECIFICATIONS, MANUFACTURER'S DETAILS & RECOMENDATIONS & THOSE RECOMMENDED BY NRCA's "THE ROOFING & WATERPROOFING MANUAL".

3

CONTRACTOR MUST COMPLY W/ ALL STATE & LOCAL CODES & REGULATIONS.

4

CONTRACTOR TO REPLACE ALL EXISTING VENT BOOTS EXISTING VENTS & FLASHINGS TO REMAIN. PROTECT DURING CONSTRUCTION.

5

CAULK & SEAL WATERTIGHT ALL JOINTS & TRANSITIONS.

6

DIMENSIONS ON ROOF PLAN REFLECT DIMENSIONS PARALLEL WITH FLOOR PLANE. ACTUAL ROOF AREA IS LARGER DUE TO ROOF SLOPE.

7

ALL METAL MATERIALS (I.E. FLASHINGS, ETC...) SHALL BE .0217" (26 GA.) THICK PREFINISHED GALVANIZED OR ALUM. ZINC ALLOY. ALL FASTENERS MUST BE COMPATIBLE WITH ASSOCIATED METALS/MATERIALS. METALS MUST BE INSTALLED PER SMACNA's "ARCHITECTURAL SHEET METAL MANUAL."

8

EXISTING ROOFING MUST BE REMOVED, INSPECT AND REPAIR DAMAGED DECKING PRIOR TO PROCEEDING WITH NEW ROOF ASSEMBLY.

LEGEND

1

BUILDING MTL ROOFS; RETAIN EXISTING METAL ROOFING, REMOVE & REPLACE DAMAGED PANELS, REPLACE FLASHINGS, GUTTERS DOWNSPOUTS, RELATED ITEMS & MATERIALS. INSTALL NEW FLASHINGS, GUTTERS DOWNSPOUTS, RELATED ITEMS & MATERIALS.

2


COORDINATE ALL NEW, ROOF PENETRATIONS; EXHAUST, VENTS, PIPES, EQUIPMENT, ETC., PROVIDE ROOF CURBS, FLASHINGS AND ACCESSORIES FOR WATER TIGHT INSTALLATION.


3

CANOPIES; REMOVE & REPLACE EXISTING ALL ROOFING PANELS, FLASHINGS, GUTTERS DOWNSPOUTS, RELATED ITEMS & MATERIALS. REPAIR AND/OR REPLACE DAMAGED STRUCTURE, & PAINT. PROVIDE ALL NEW TRANSITION OR CONNECTION FLASHINGS, SEALANT, & CAULKING; ENTIRE ROOF ASSEMBLY SHALL BE PROVIDED AND INSTALLED AS REQUIRED & RECOMMENDED BY MANUFACTURER WITH 20 YEAR WATER TIGHTNESS WARRANTY. REF. SPEC.


4


CONTRACTOR TO INSTALL R49 BLOWN-IN INSULATION IN THE ATTIC SPACE AT BUILDINGS B & C

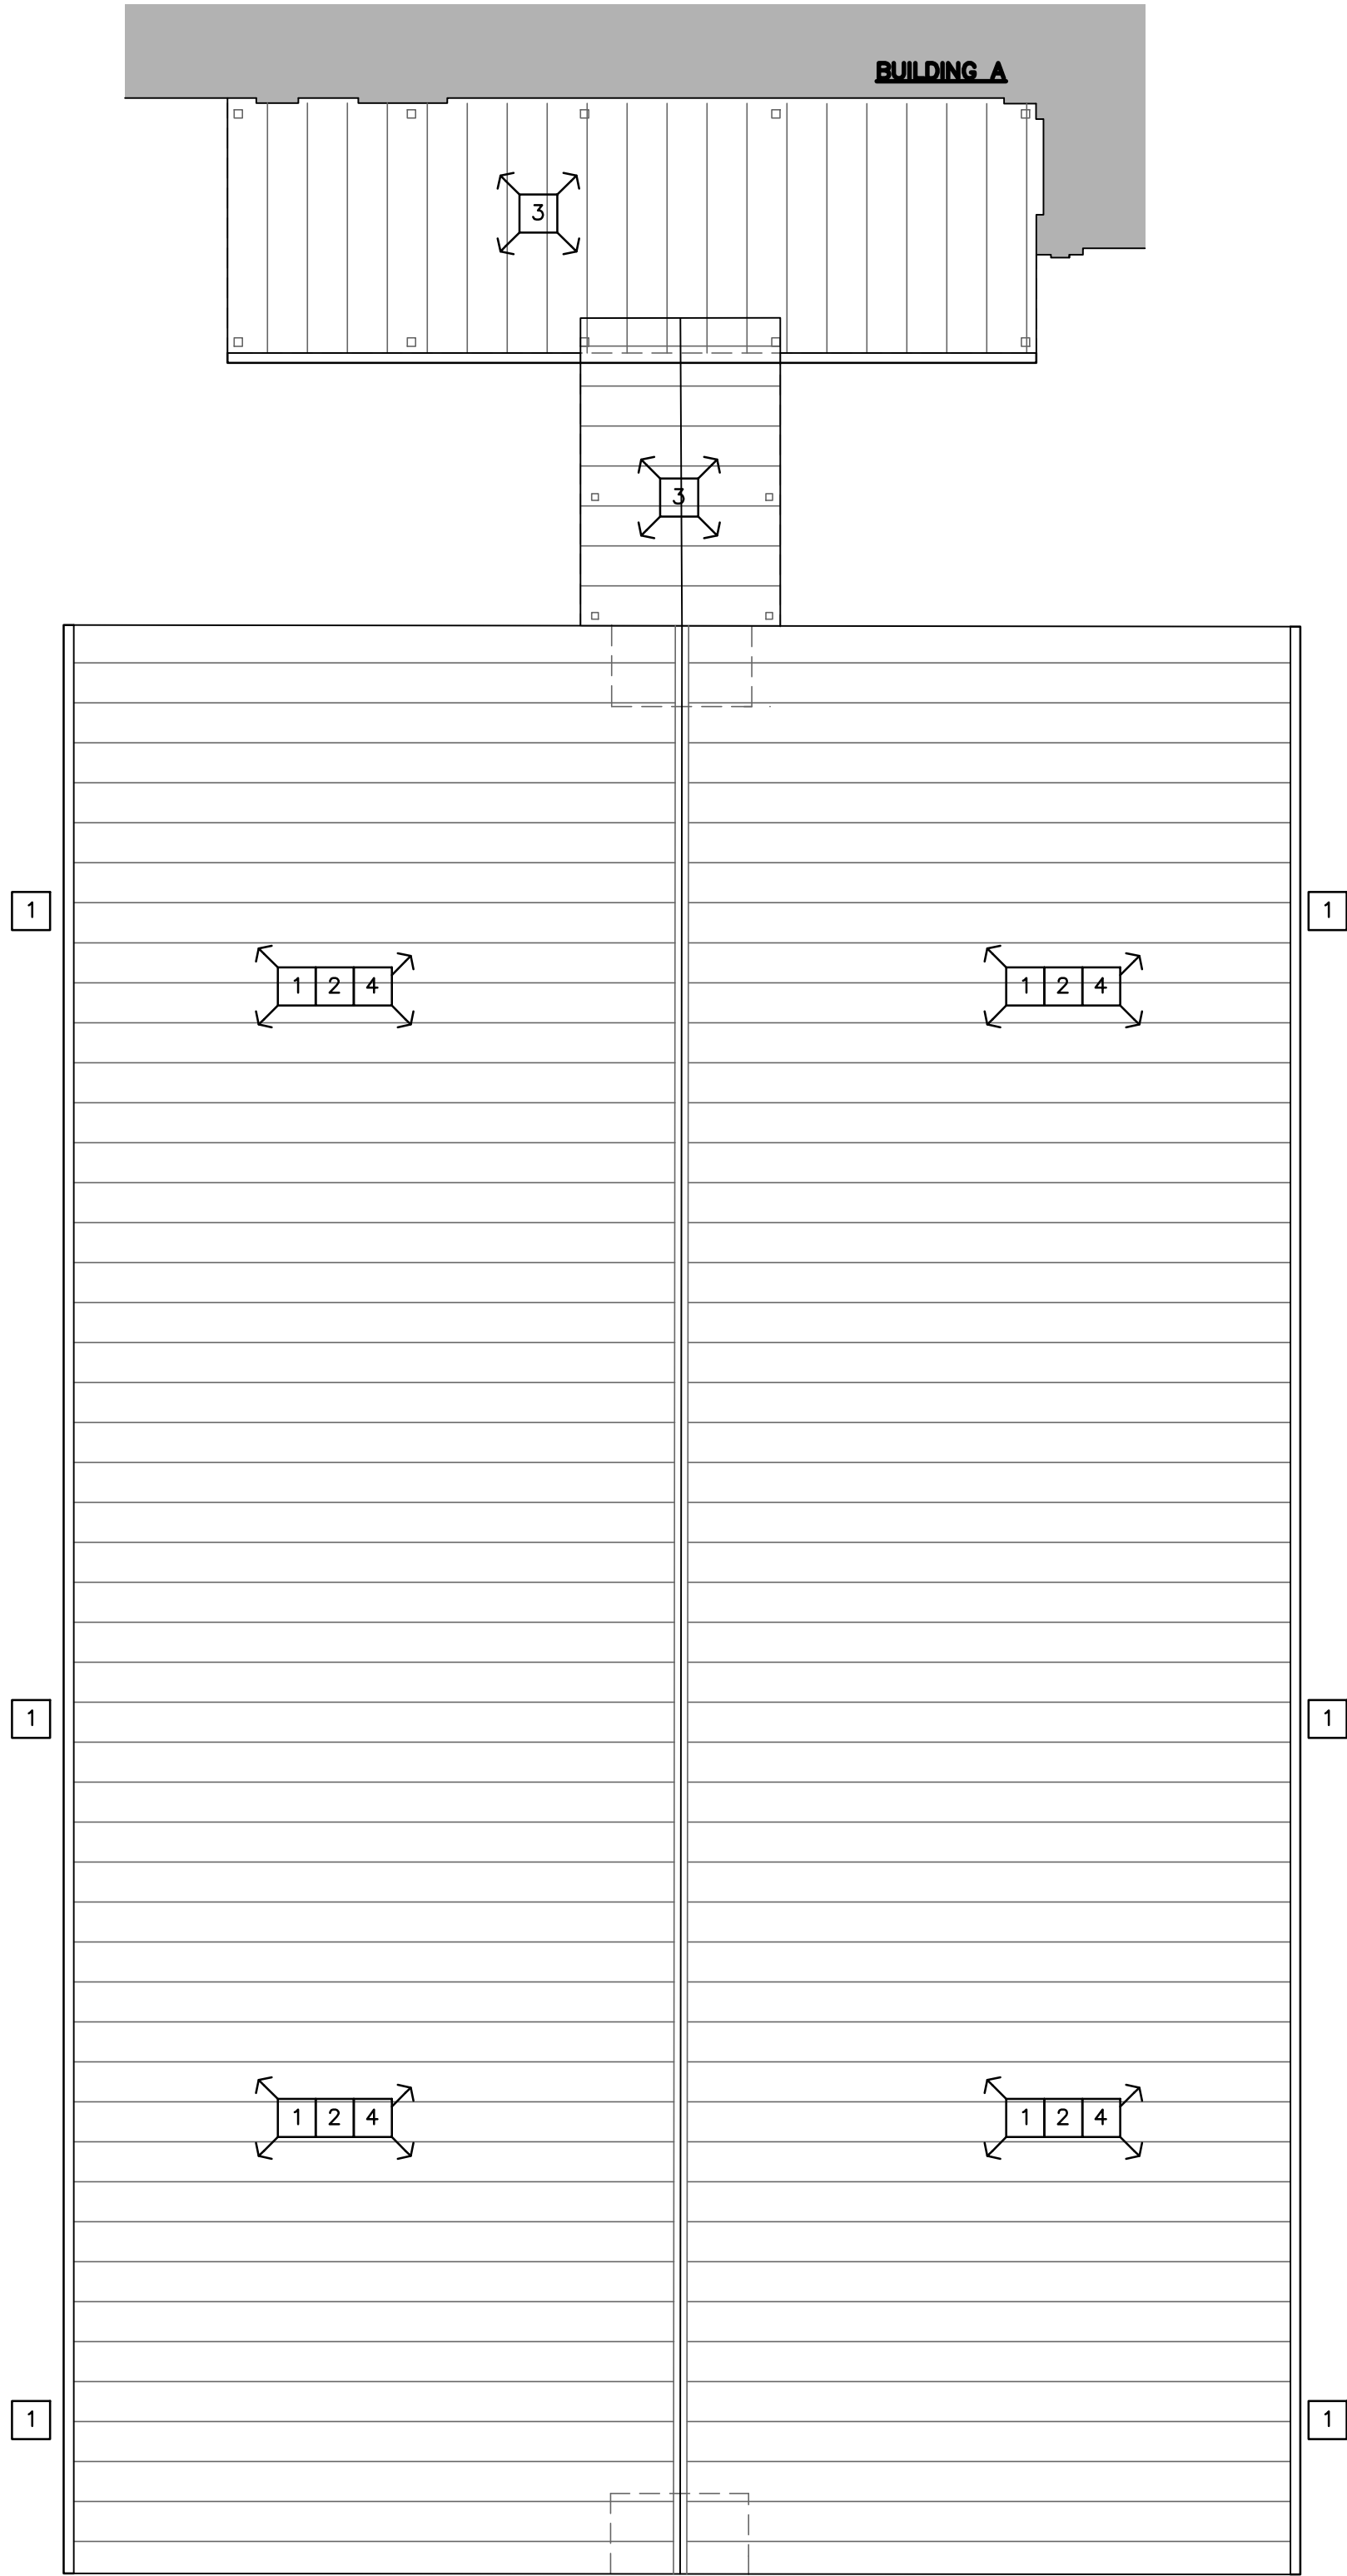

**B**

**'81 (WEST) BLDG
BLDG B ROOF PLAN**
1/8"=1'-0"

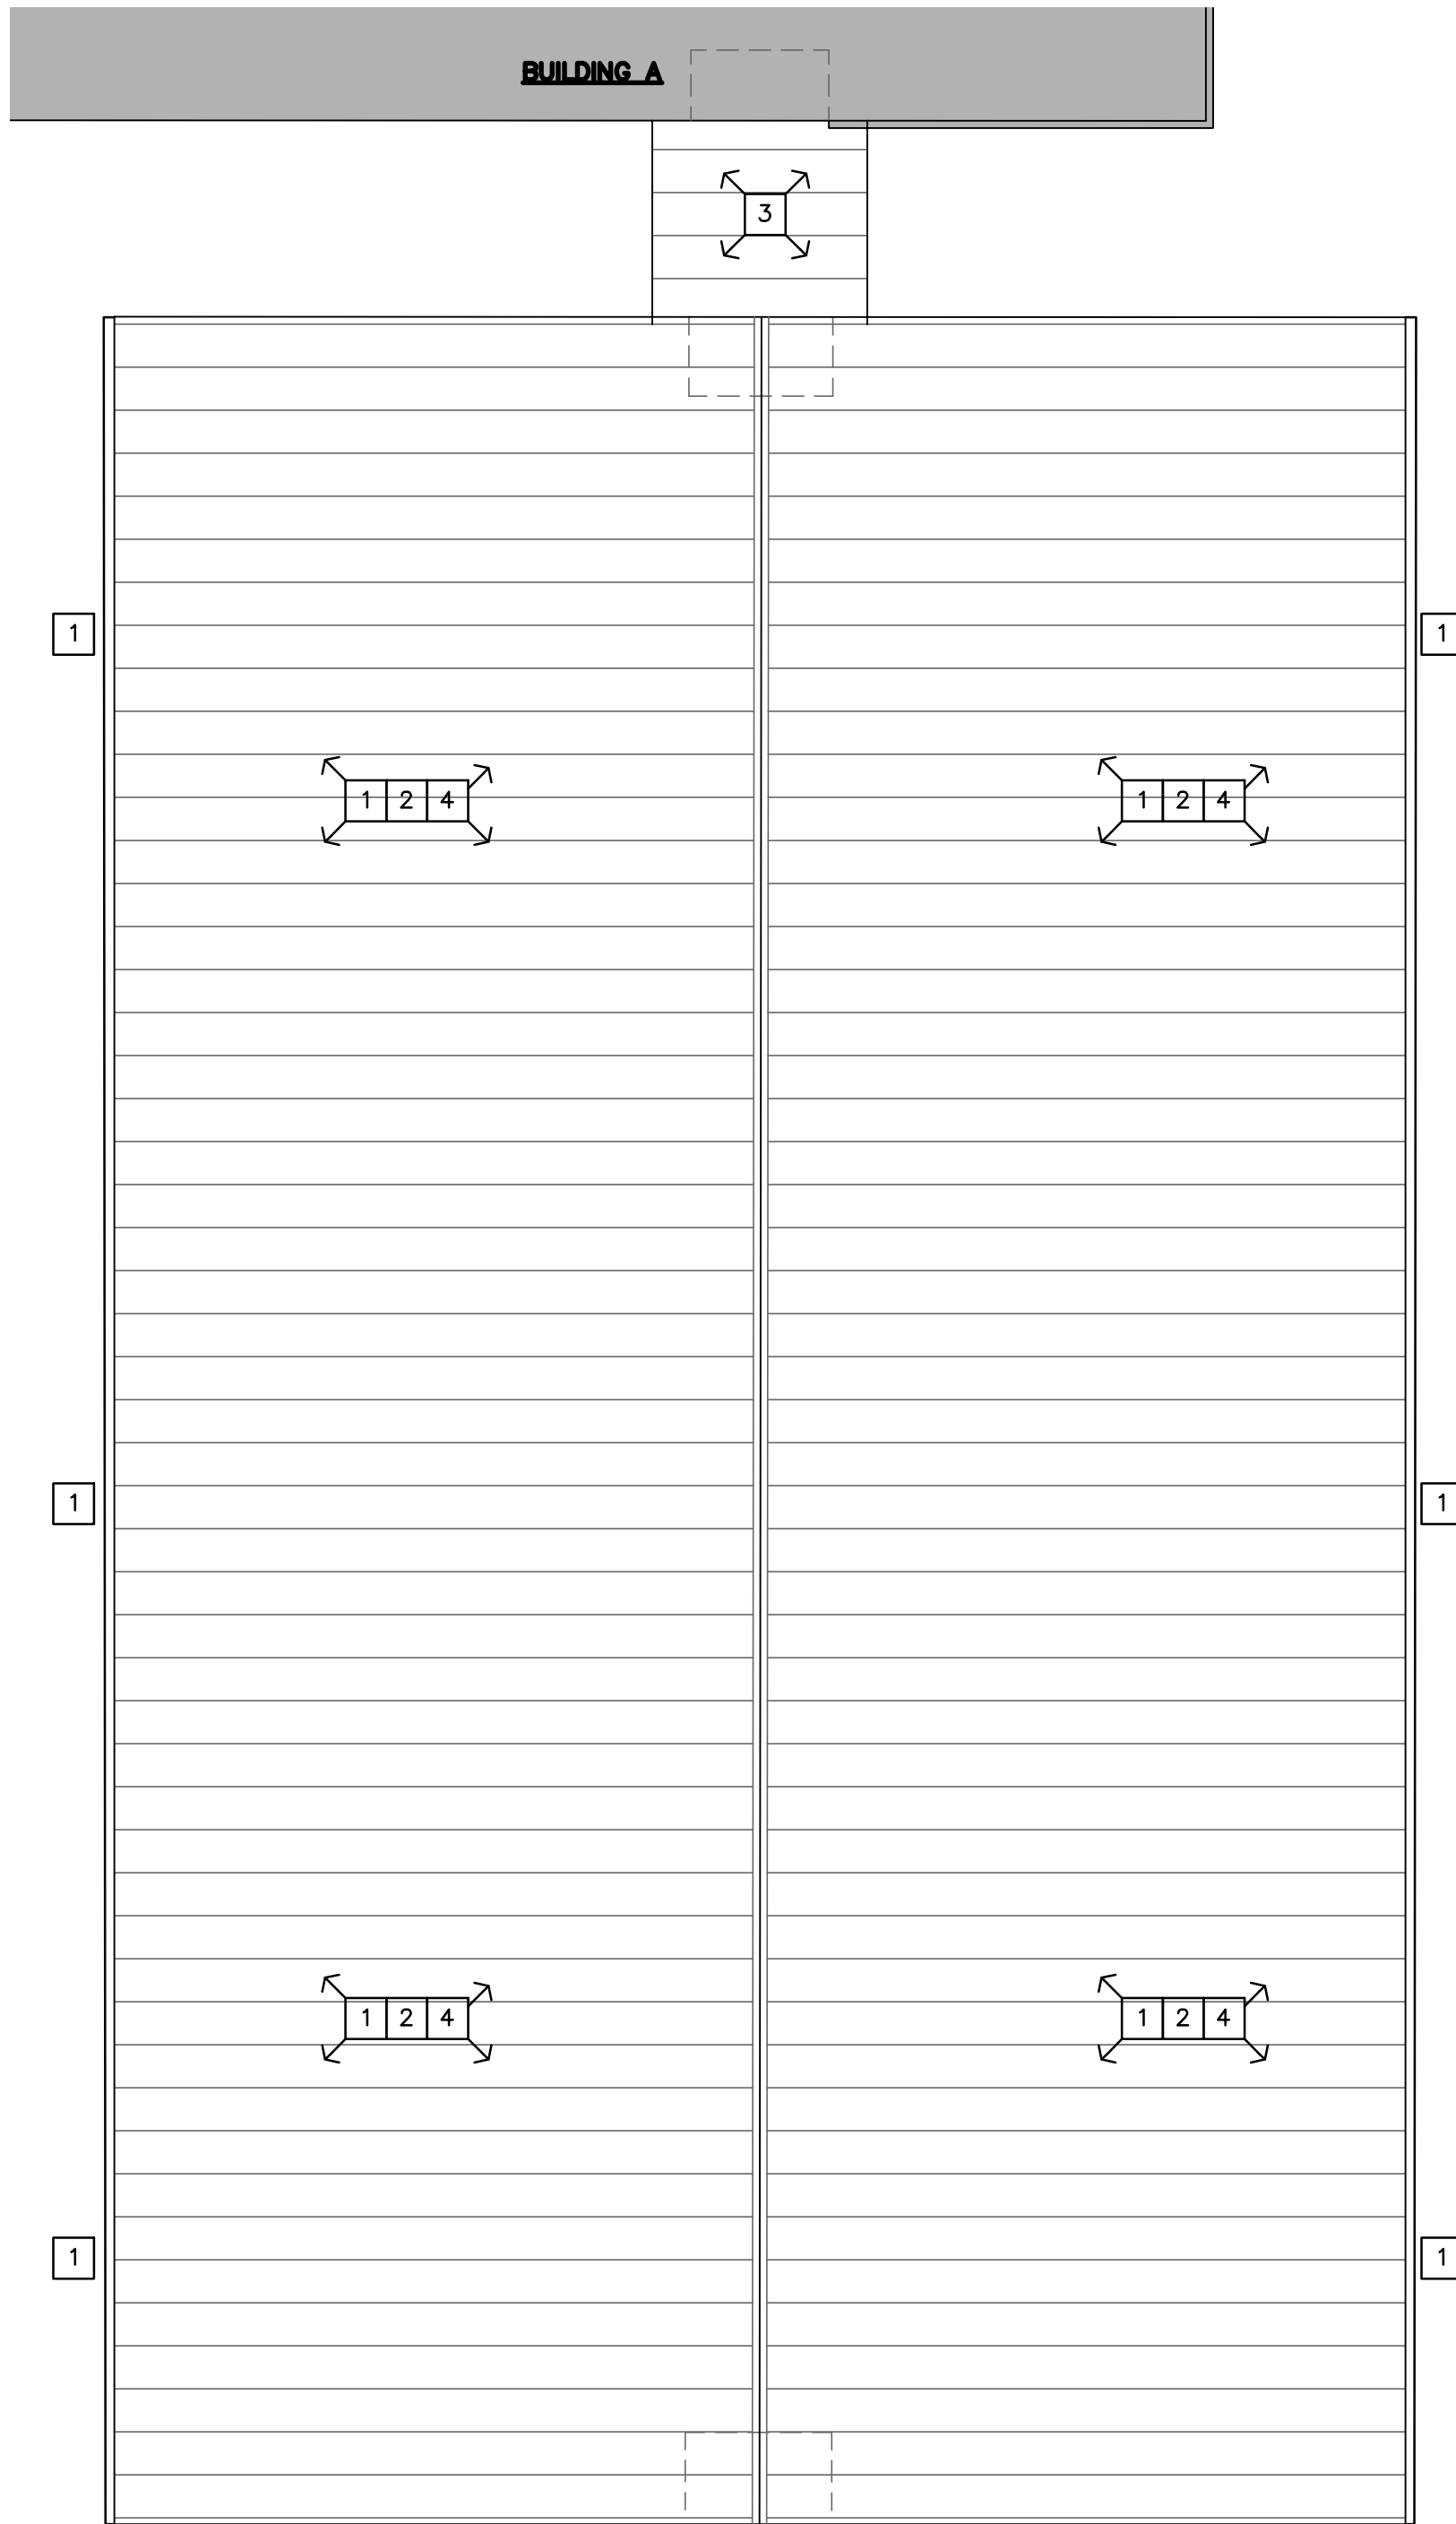

**A**

**'81 (EAST) BLDG
BLDG C ROOF PLAN**
1/8"=1'-0"

BUILDING B & C



REVISION:	
DATE:	11-20-2025
JOB:	25-3479
SHEET NO.:	

ABC5.2

THE IRVING LOFTS
HISTORIC RESTORATION & REHAB APARTMENTS
CLEBURNE, TEXAS

JGR
JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386
jgr@jgrarchitects.com

COPYRIGHTED ©

REFLECTED CLG. PLAN NOTES

- GENERAL NOTES
- CONTRACTOR SHALL COORDINATE CEILING LAYOUT WITH MECHANICAL AND ELECTRICAL FIXTURE LOCATIONS. NOTIFY ARCHITECT IMMEDIATELY OF ANY CONFLICT OR DISCREPANCY.
 - MECHANICAL/ELECTRICAL FIXTURES @ RATED CEILINGS SHALL BE HUNG IN CONFORMANCE TO U.L. SYSTEM REQUIREMENTS.
 - CEILING MOUNTED MECHANICAL EQUIPMENT AND SUSPENDED MECHANICAL EQUIPMENT MUST BE SUSPENDED DIRECTLY FROM THE STRUCTURE.
 - WHERE SUSPENSION DEVICES, WIRES, RODS, ETC. PENETRATE CEILING GRID AND/OR TILE OR G.B. PENETRATIONS SHALL BE NEAT AND CLEANLY CUT. PENETRATION OPENING SHALL BE AS SMALL AS POSSIBLE. SEAL AT G.B.


- HISTORIC FINISH NOTES
- SCHOOL BUILDING:
- ALL EXISTING PLASTER CEILINGS SHALL REMAIN. DAMAGED AREAS SHALL BE REPAIRED AND PATCHED TO MATCH EXISTING IN TEXTURE AND APPEARANCE.
 - ALL DUCTS, WASTE & VENT PLUMBING, WATER LINES, AND PENETRATIONS SHALL BE CONCEALED WITHIN G.B. CEILINGS.
 - SPRINKLER PIPES MAY BE BOTH CONCEALED AND EXPOSED.
 - NO DUCTWORK SHALL RUN THROUGH THE HALLWAYS/STAIRS. ALL DUCTWORK SERVING THE HALLWAY AREA SHALL BE RUN BEHIND CORRIDOR WALLS (IN CEILING) AND SIDE-WALL GRILLS WILL BE UTILIZED TO CONDITION THE SPACE.
 - NO DROPPED G.B. SOFFITS OR CEILINGS SHALL BE LOCATED WITHIN 36" OF AN EXTERIOR WINDOW.
 - ALL PLASTER CEILINGS SHALL REMAIN OPEN AND EXPOSED WHERE POSSIBLE.
 - SOME EXTERIOR FACADE PENETRATIONS WILL BE REQUIRED, PER CODE, ON FLOORS 1 & 2 FOR LAUNDRY AND BATHROOM EXHAUST. THESE GRILLS WILL BE "BRICK VENTS" THAT ARE DESIGNED TO FIT WITHIN THE FOOTPRINT OF (1) BRICK. THEY WILL BE COLORED (EITHER PAINTED OR PRE-FINISHED) TO MATCH THE COLOR OF THE SURROUNDING BRICK.

- CAFETERIA BUILDING:
- IN THE OPEN CAFETERIA DINING AREA: EXISTING CEILINGS ARE GLUE-UP ACOUSTIC TILES, ATTACHED DIRECTLY TO CONCRETE DECK. GLUE UP TILES WILL BE REMOVED. A SUSPENDED G.B. CEILING WILL BE INSTALLED TO CONCEAL ANY AND ALL CONDUITS AND SPRINKLER LINES. WHILE MAINTAIN CEILINGS AS HIGH AS POSSIBLE. SOFFIT WILL RUN ALONG THE WEST WALL TO CONCEAL NEW DUCTS.
 - AT THE STAGE AND STORAGE/MECHANICAL ROOMS, CEILING WILL REMAIN OPEN TO STRUCTURE ABOVE.
 - APARTMENT UNITS (LOCATED IN THE KITCHEN ADDITION) WILL HAVE SUSPENDED G.B. CEILINGS.

- NON-RATED WALLS
- 1/2 HOUR FIRE PARTITION (CORRIDOR) W/ 20 MIN. OPENINGS
- 1 HOUR FIRE PARTITION: BETWEEN DWELLING UNITS
- 1 HOUR RATED WITH 60 min. OPENINGS
- DUCT RUNS (ABOVE CEILING)

SEAL VOIDS AT TOPS OF WALLS AND PENETRATIONS WITH U.L. LISTED FIRE BATT INSULATION, PILLOWS, AND/OR FIRE SEALANT AS REQUIRED BY CONDITION. AT RATED WALLS.

SPECIFIC CEILING NOTES	CEILING TYPES	
	REFER SPECIFICATIONS	
01	GB	GYP BD (PAINTED)
	1	2x2 SUSP. ACOUST. CLG
	ST	EXPOSED STRUCTURE
	EP	EXIST. PLASTER (PAINTED)
1	CLG. TYPE	
	CLG. HEIGHT	

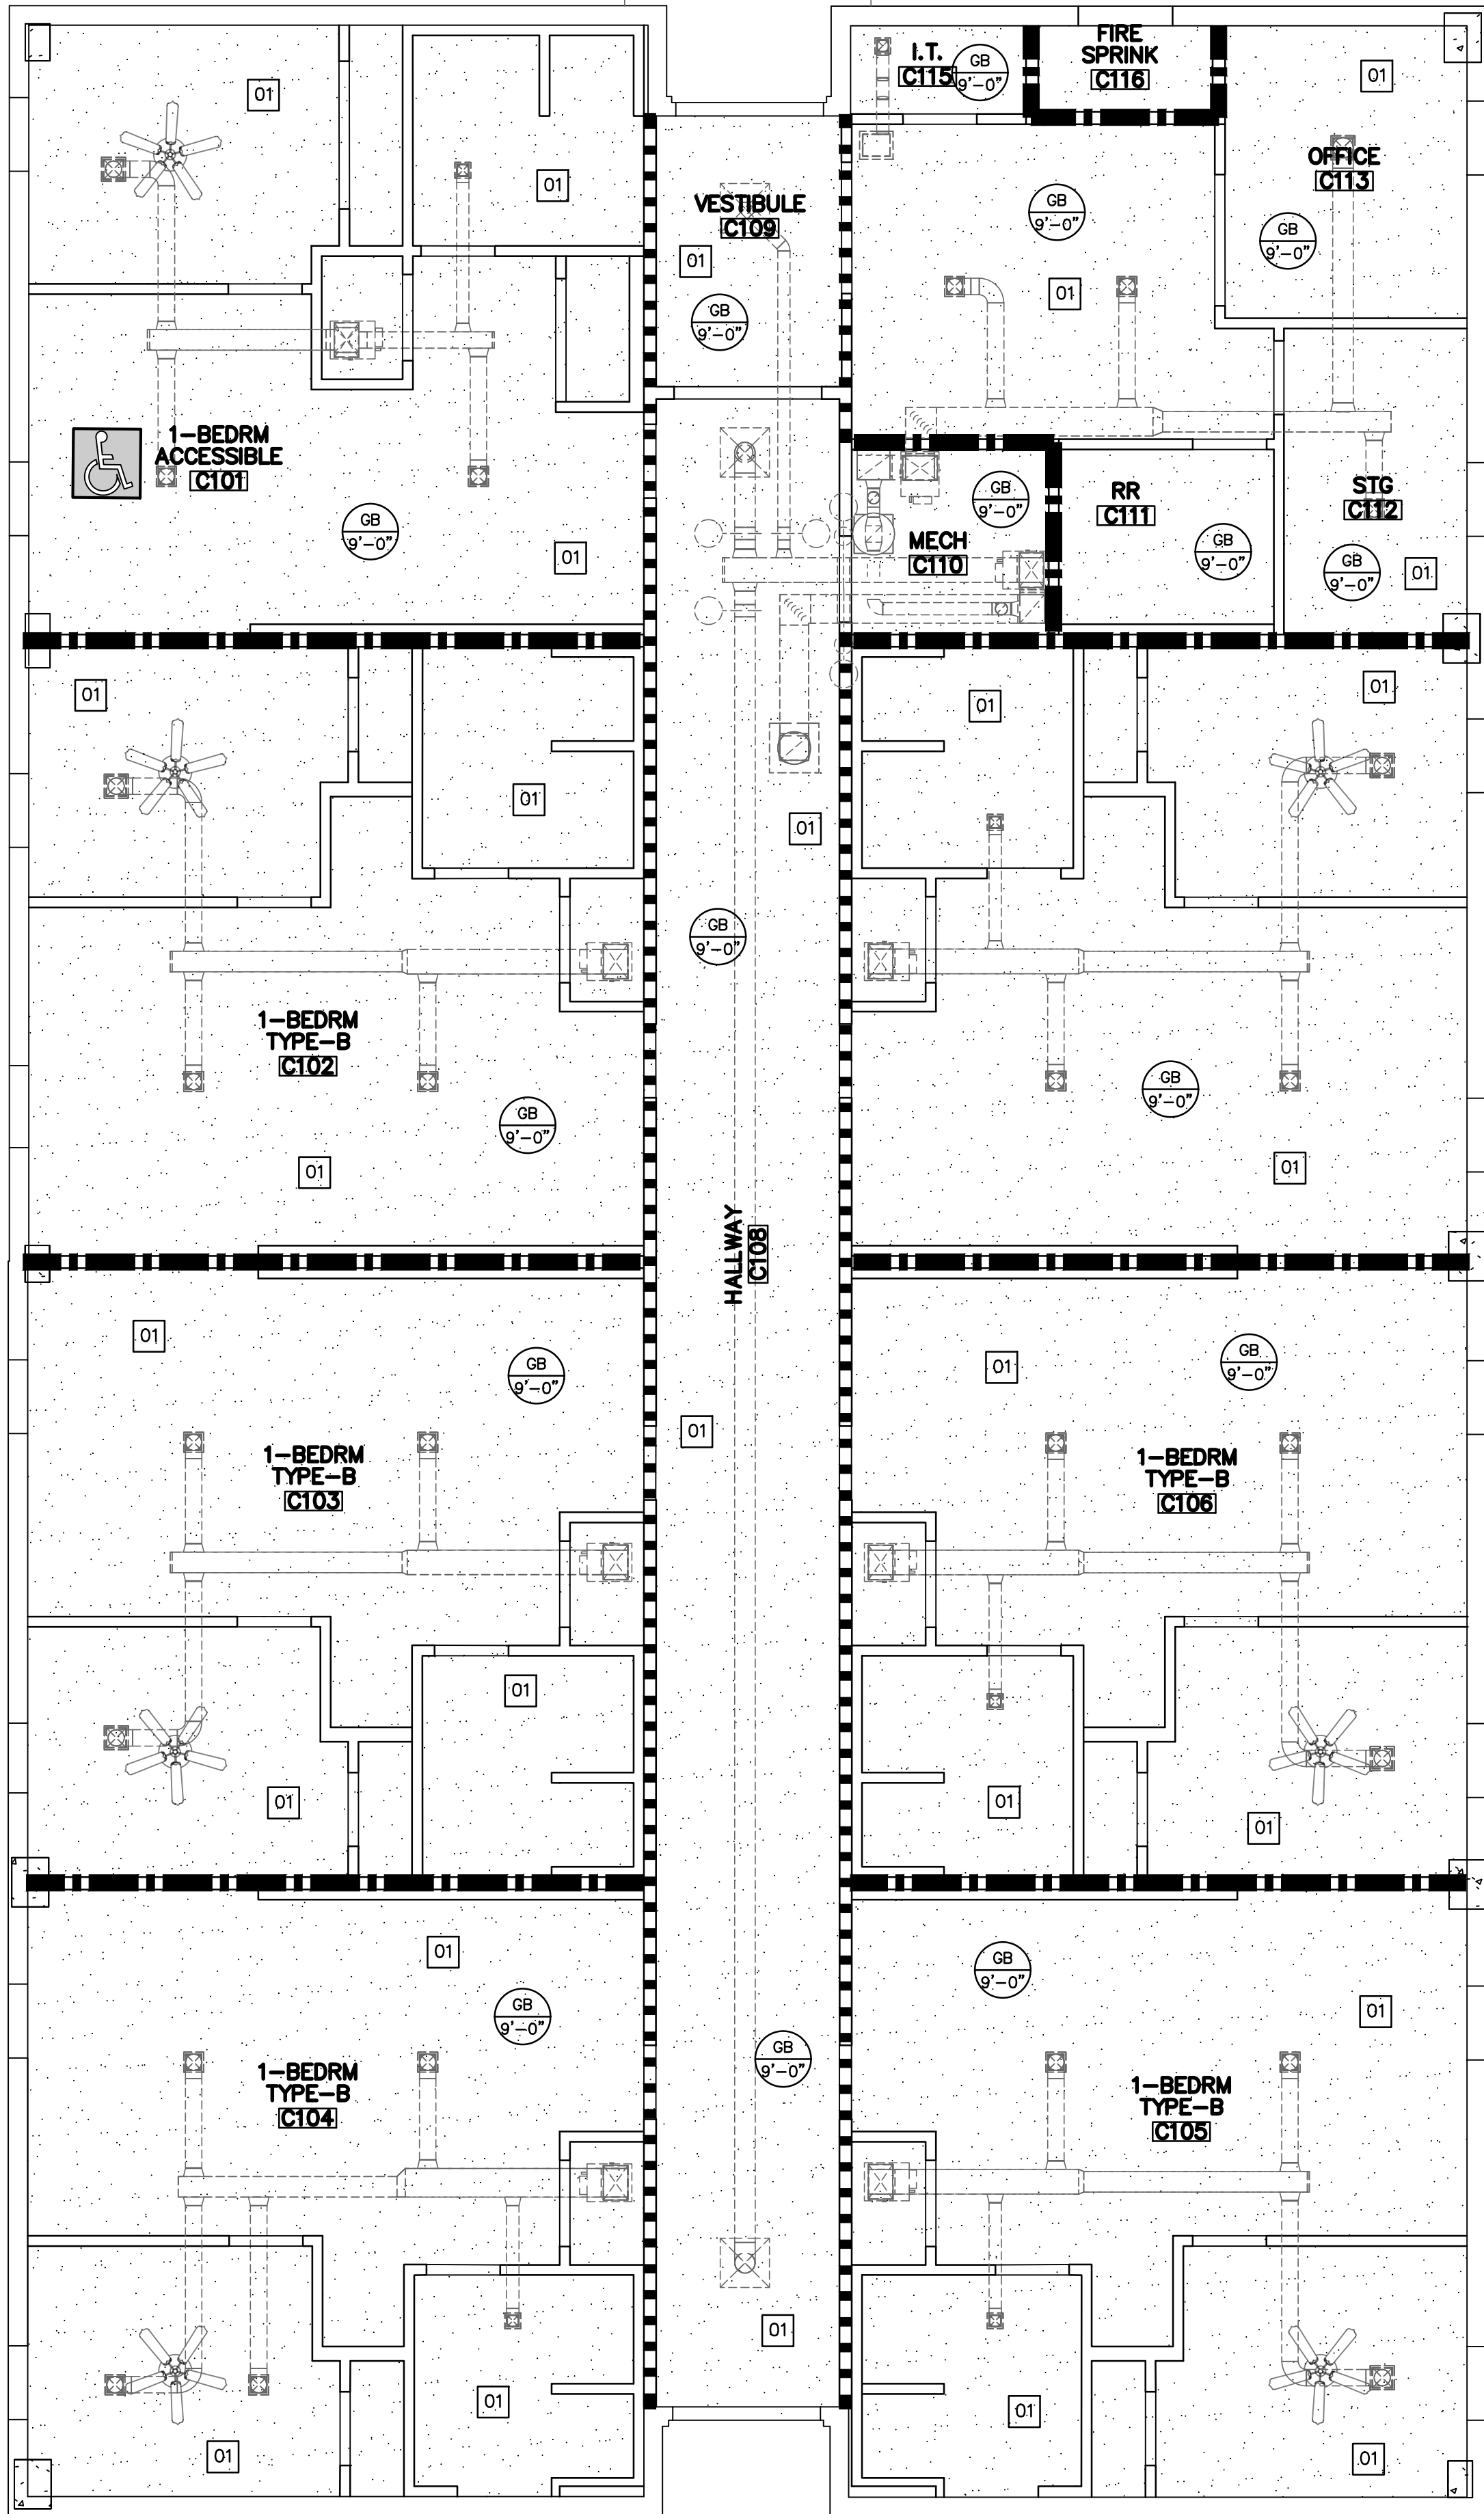

'81 (EAST) BLDG
BLDG C FLR PLAN
3/16"=1'-0"

BUILDING C



REVISION:


DATE: 11-20-2025
JOB: 25-3479
SHEET NO.:

AC7.4


THE IRVING LOFTS
HISTORIC RESTORATION & REHAB APARTMENTS
CLEBURNE, TEXAS

Jones Gillam Renz
1881 Main Street, Suite 301
Kansas City, MO 64108
730 N. Ninth
Salina, KS 67401
785.827.0386
jgr@jgarchitects.com


COPYRIGHTED ©

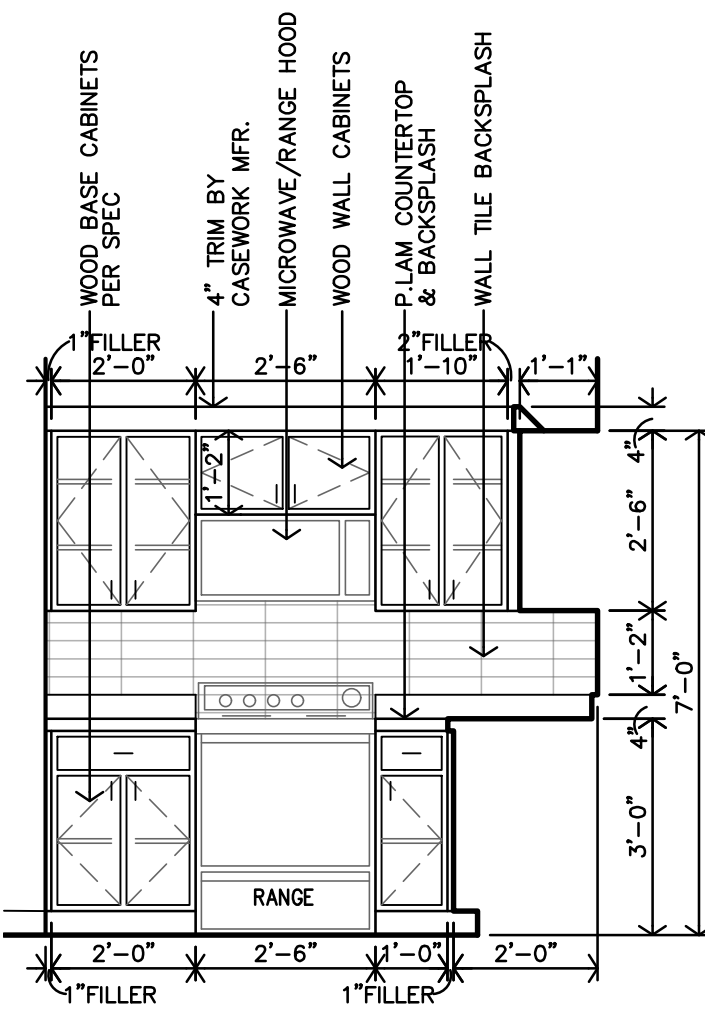


T TYPE B KITCHEN - TYPE #9 INTERIOR ELEVATIONS
3/8\"/>

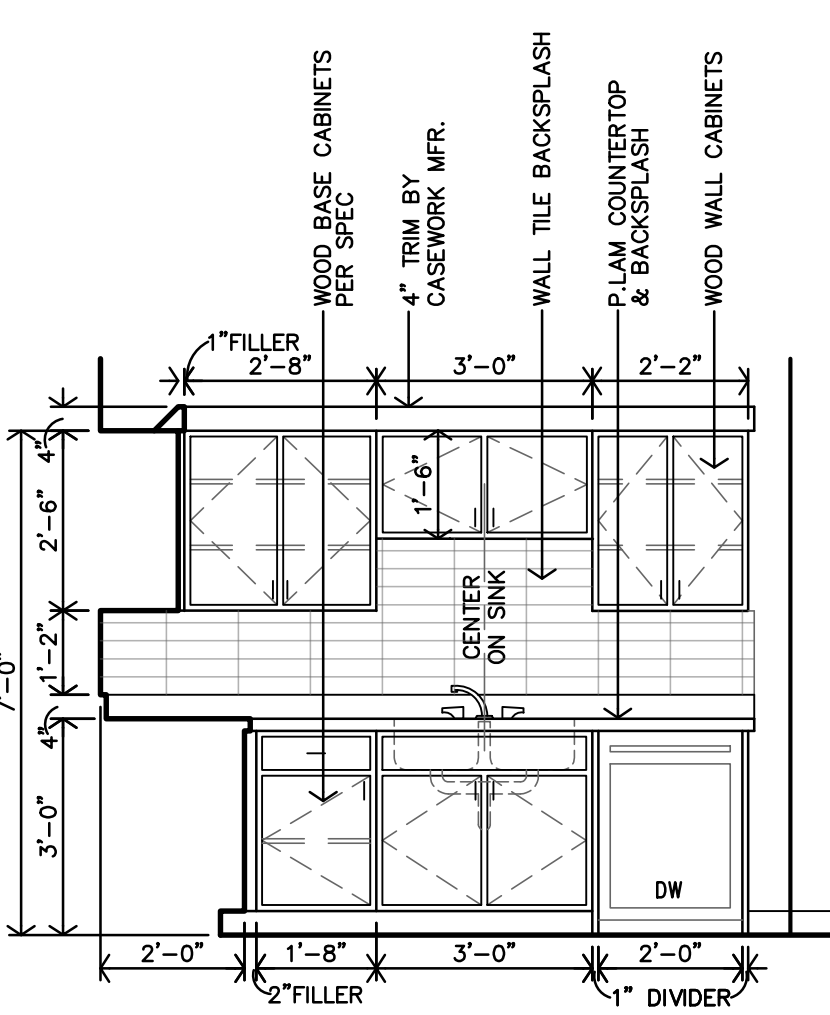


S TYPE B KITCHEN - TYPE #9 INTERIOR ELEVATIONS
3/8\"/>

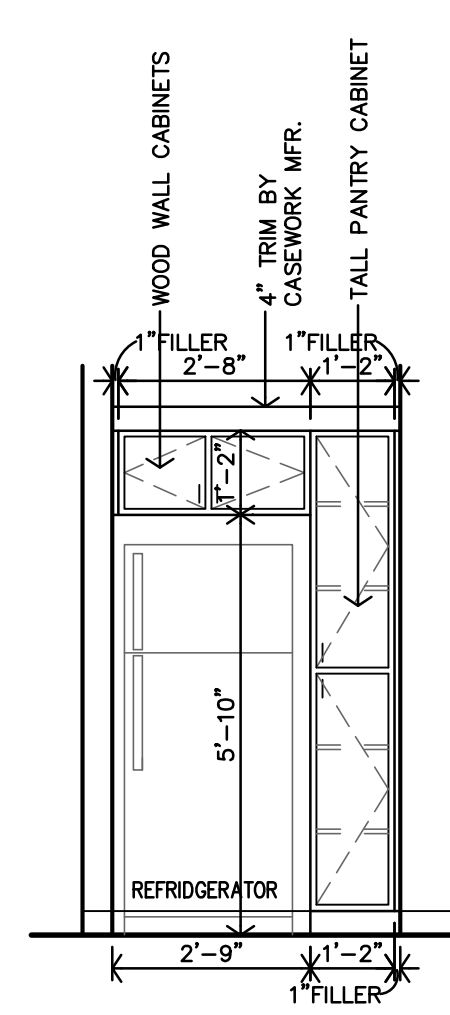


R TYPE B KITCHEN - TYPE #9 INTERIOR ELEVATIONS
3/8\"/>

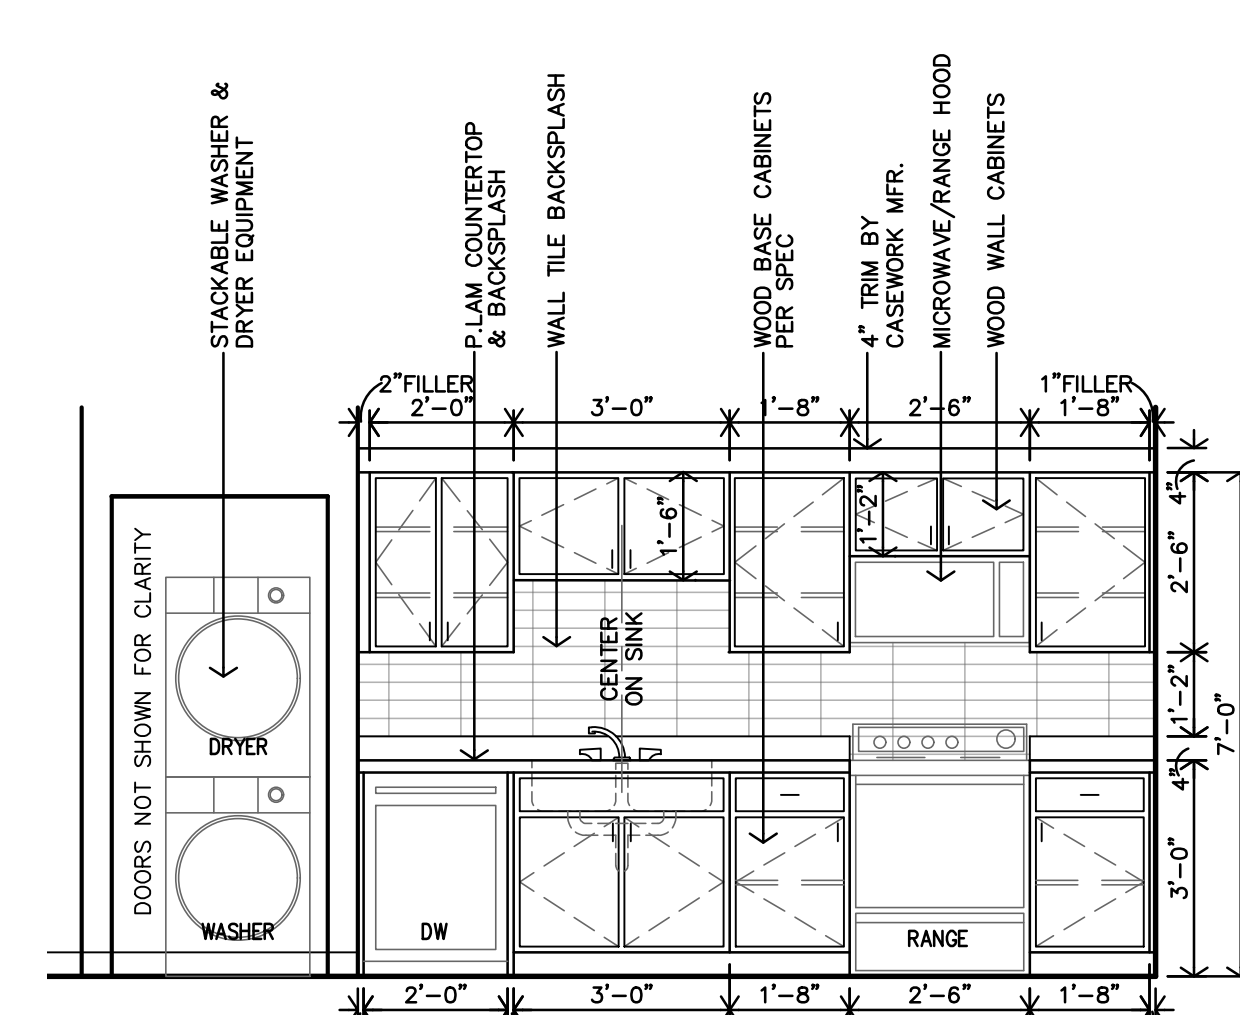


Q TYPE B KITCHEN - TYPE #8 INTERIOR ELEVATIONS
3/8\"/>

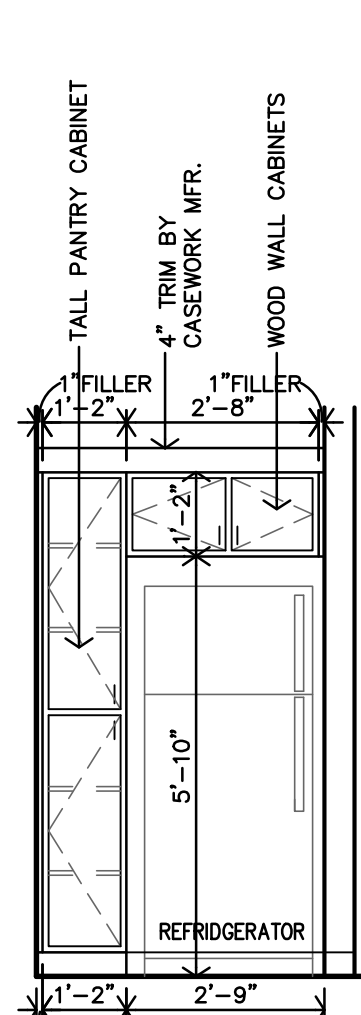


P TYPE B KITCHEN - TYPE #8 INTERIOR ELEVATIONS
3/8\"/>

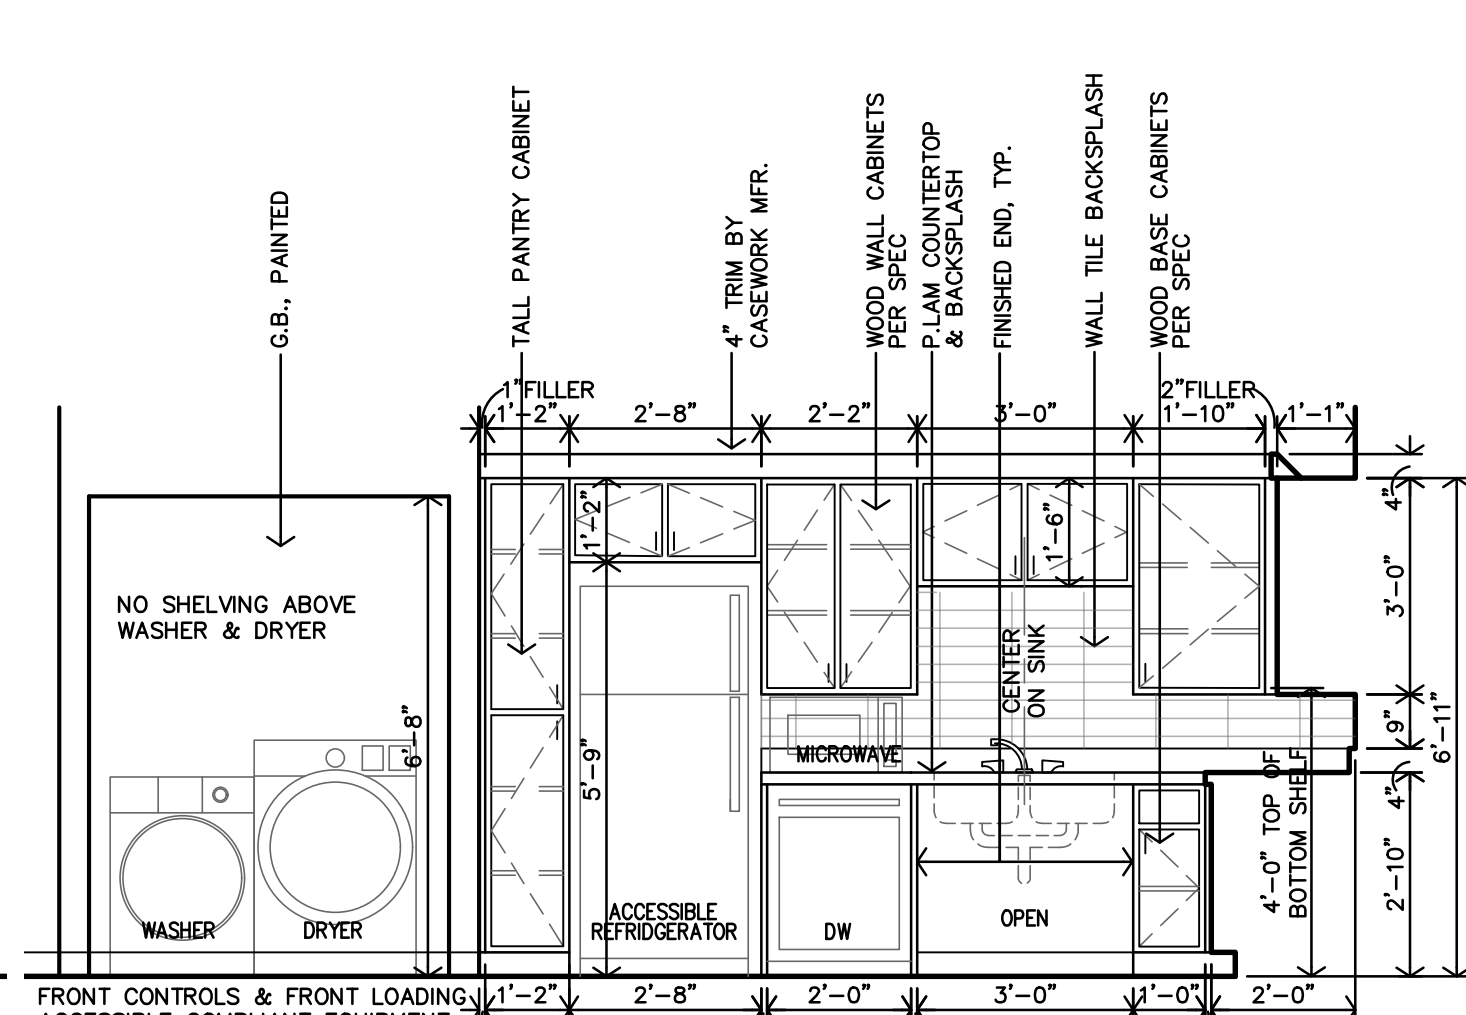


O ACCESSIBLE KITCHEN - TYPE #7 INTERIOR ELEVATIONS
3/8\"/>

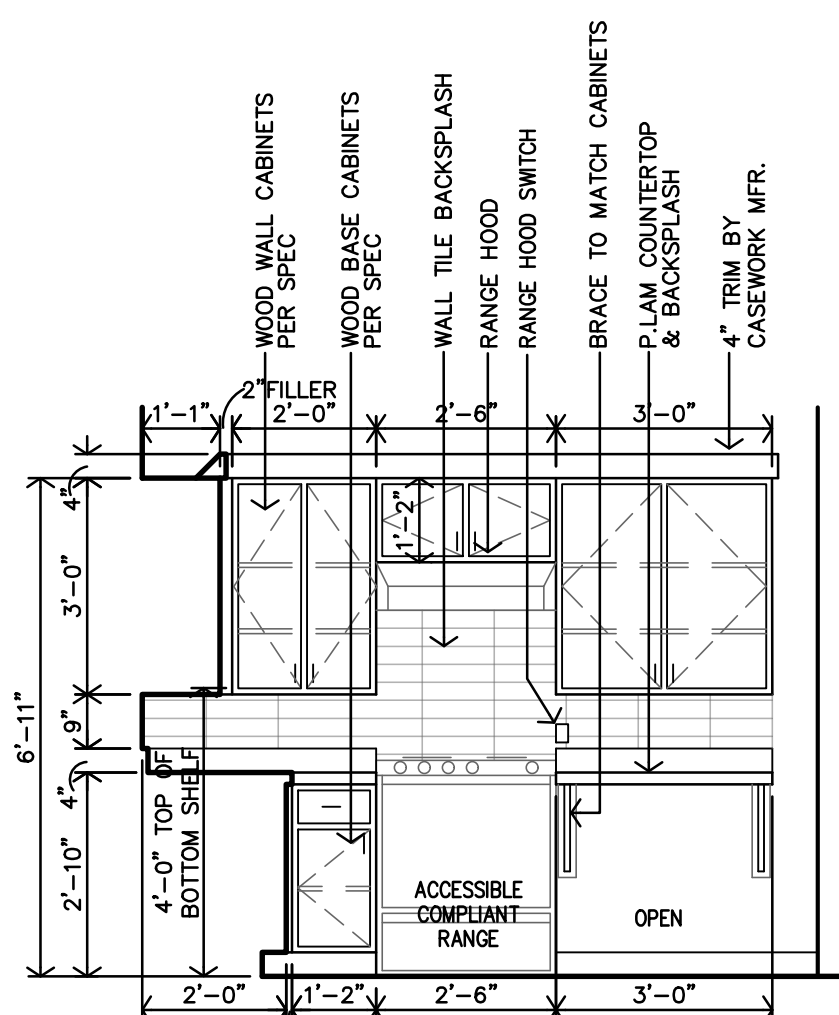


N ACCESSIBLE KITCHEN - TYPE #7 INTERIOR ELEVATIONS
3/8\"/>

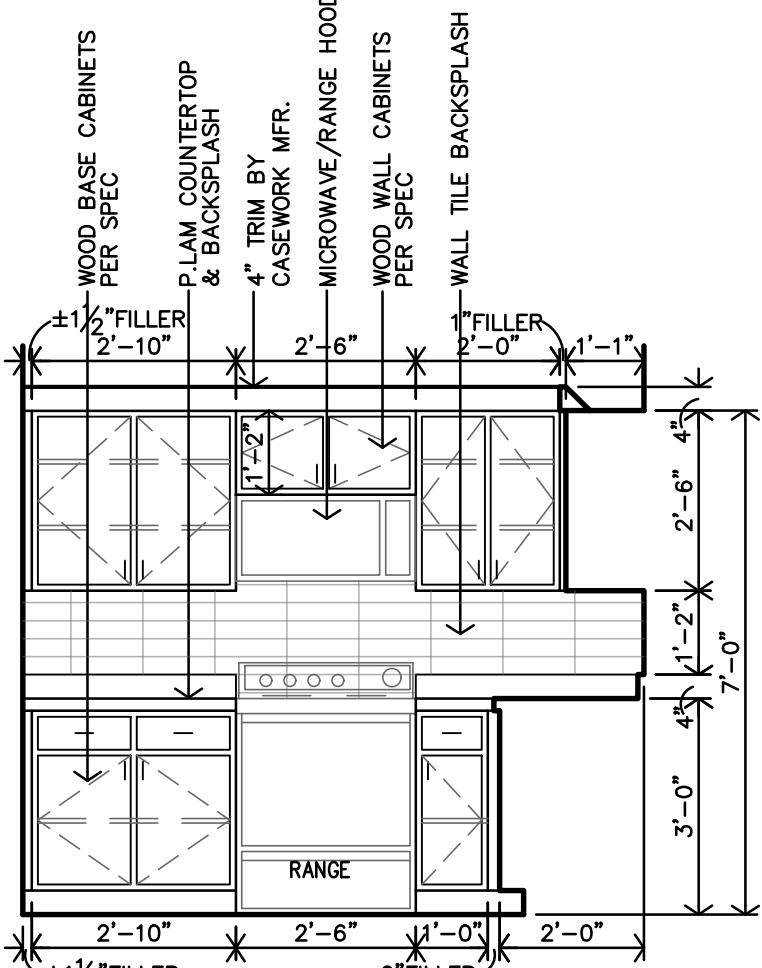


M TYPE B KITCHEN - TYPE #6 INTERIOR ELEVATIONS
3/8\"/>

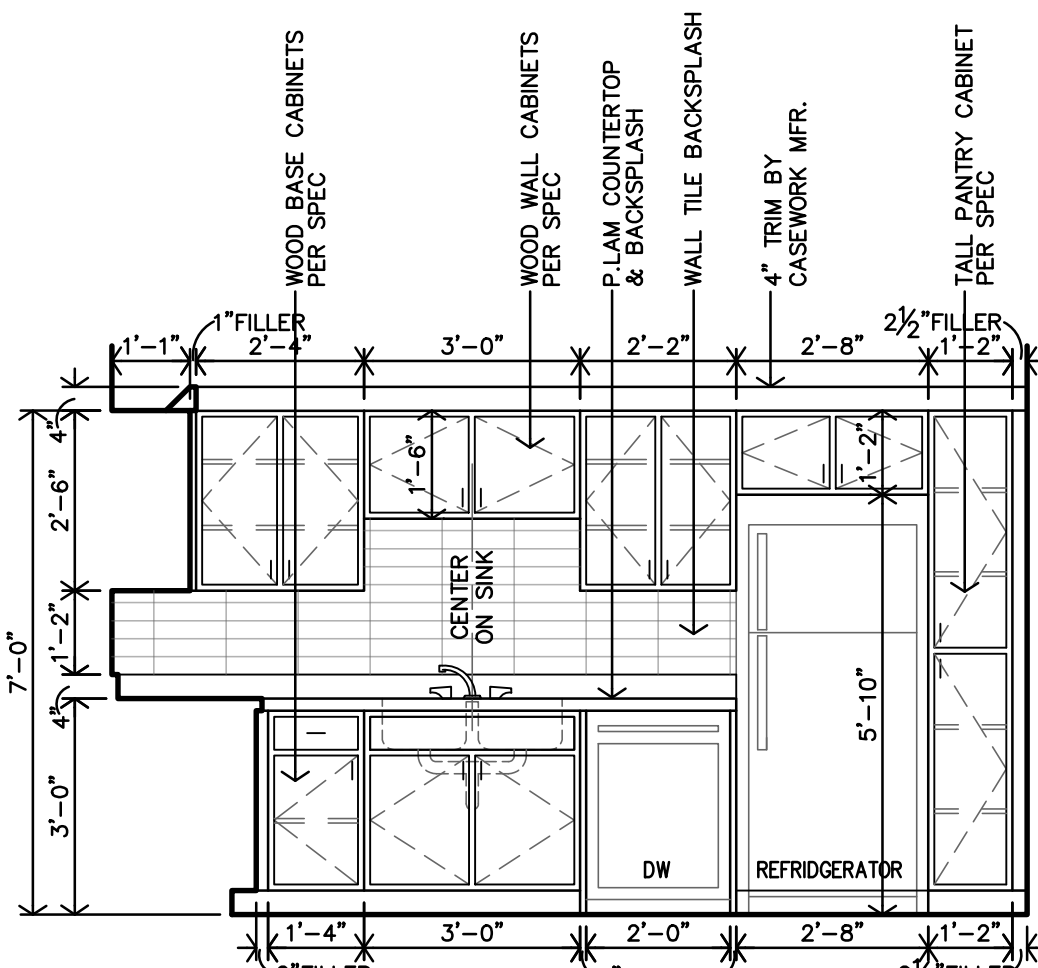


L TYPE B KITCHEN - TYPE #6 INTERIOR ELEVATIONS
3/8\"/>

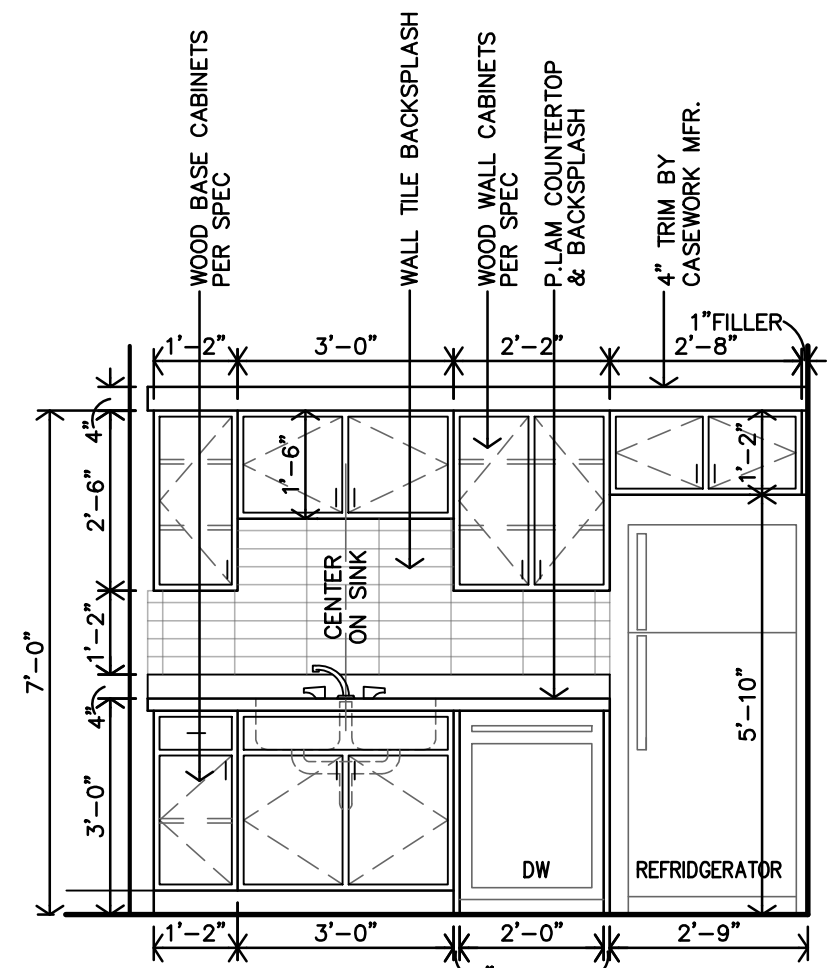


K TYPE B KITCHEN - TYPE #5 INTERIOR ELEVATIONS
3/8\"/>

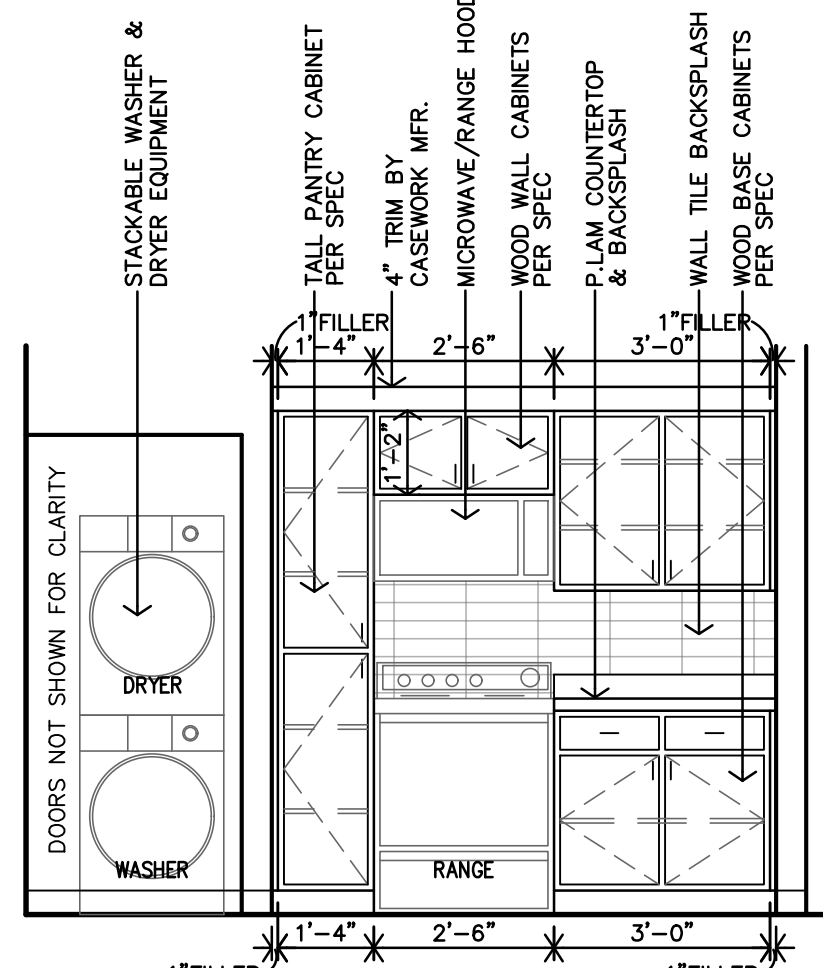


J TYPE B KITCHEN - TYPE #5 INTERIOR ELEVATIONS
3/8\"/>

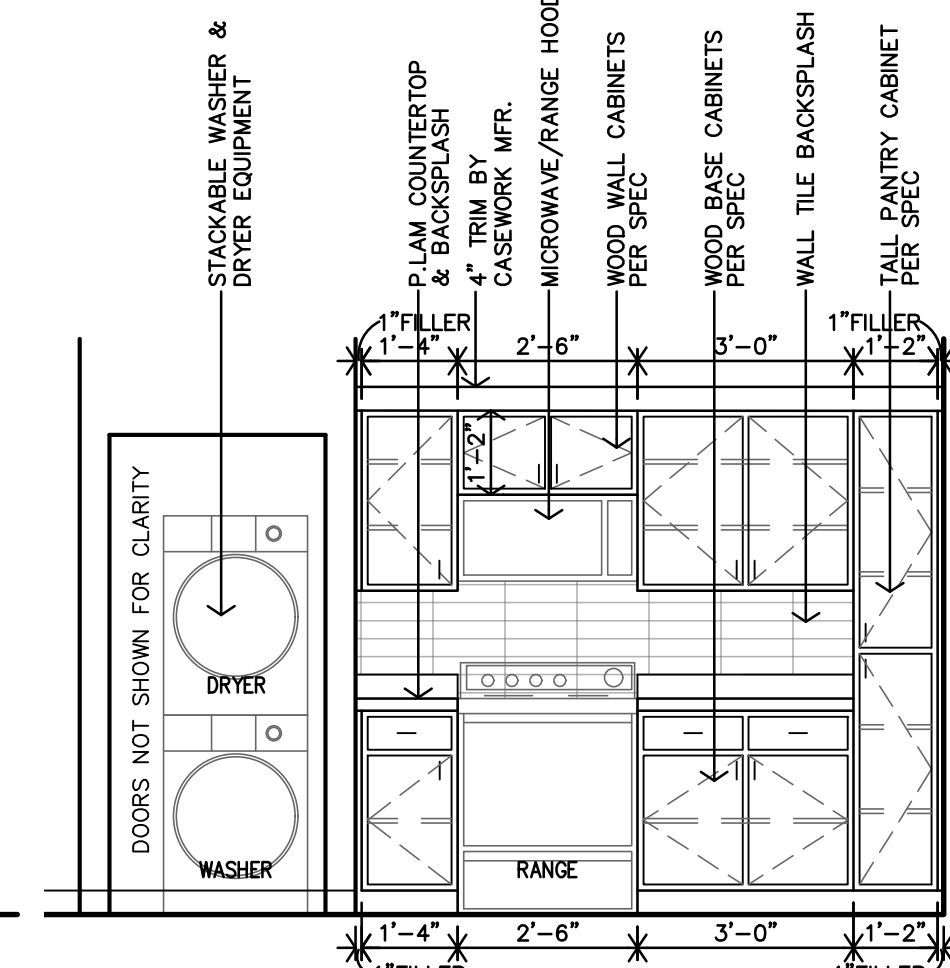


H TYPE B KITCHEN - TYPE #4 INTERIOR ELEVATIONS
3/8\"/>

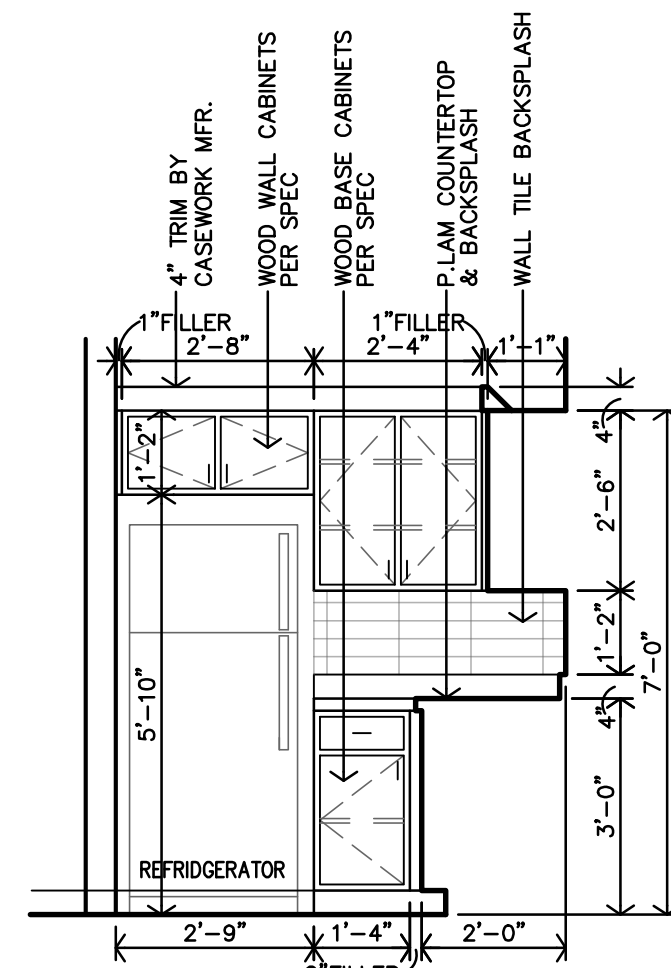


G TYPE B KITCHEN - TYPE #4 INTERIOR ELEVATIONS
3/8\"/>

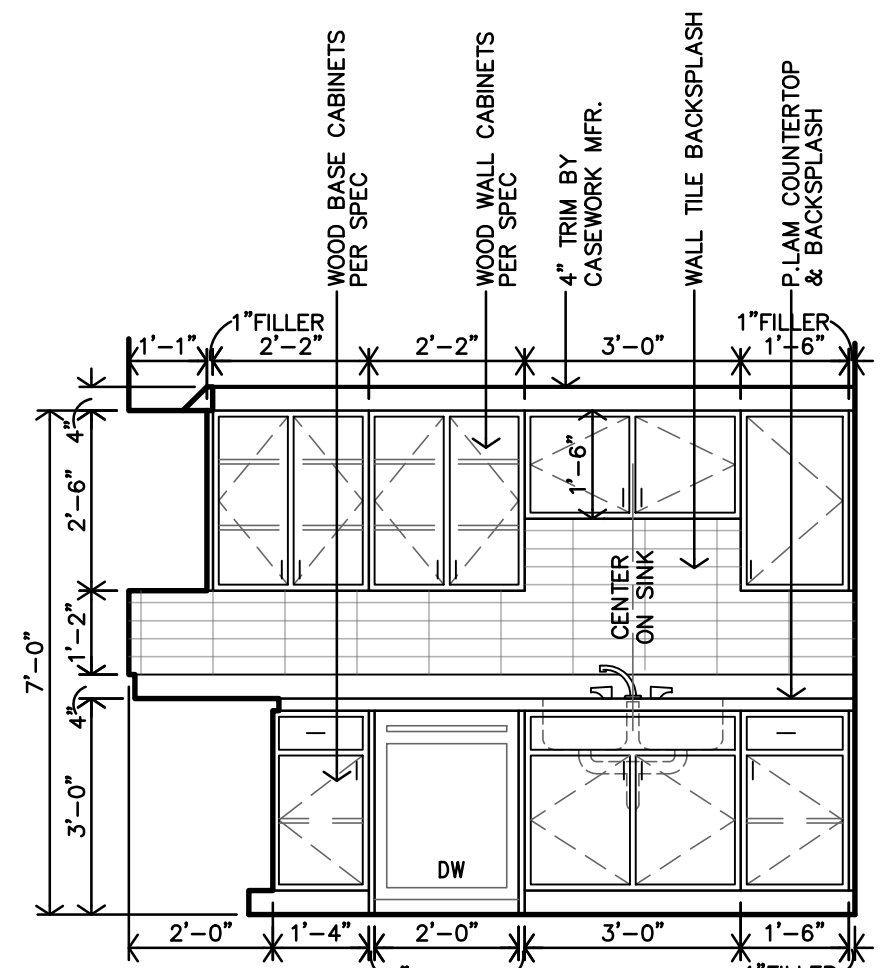


F TYPE B KITCHEN - TYPE #4 INTERIOR ELEVATIONS
3/8\"/>

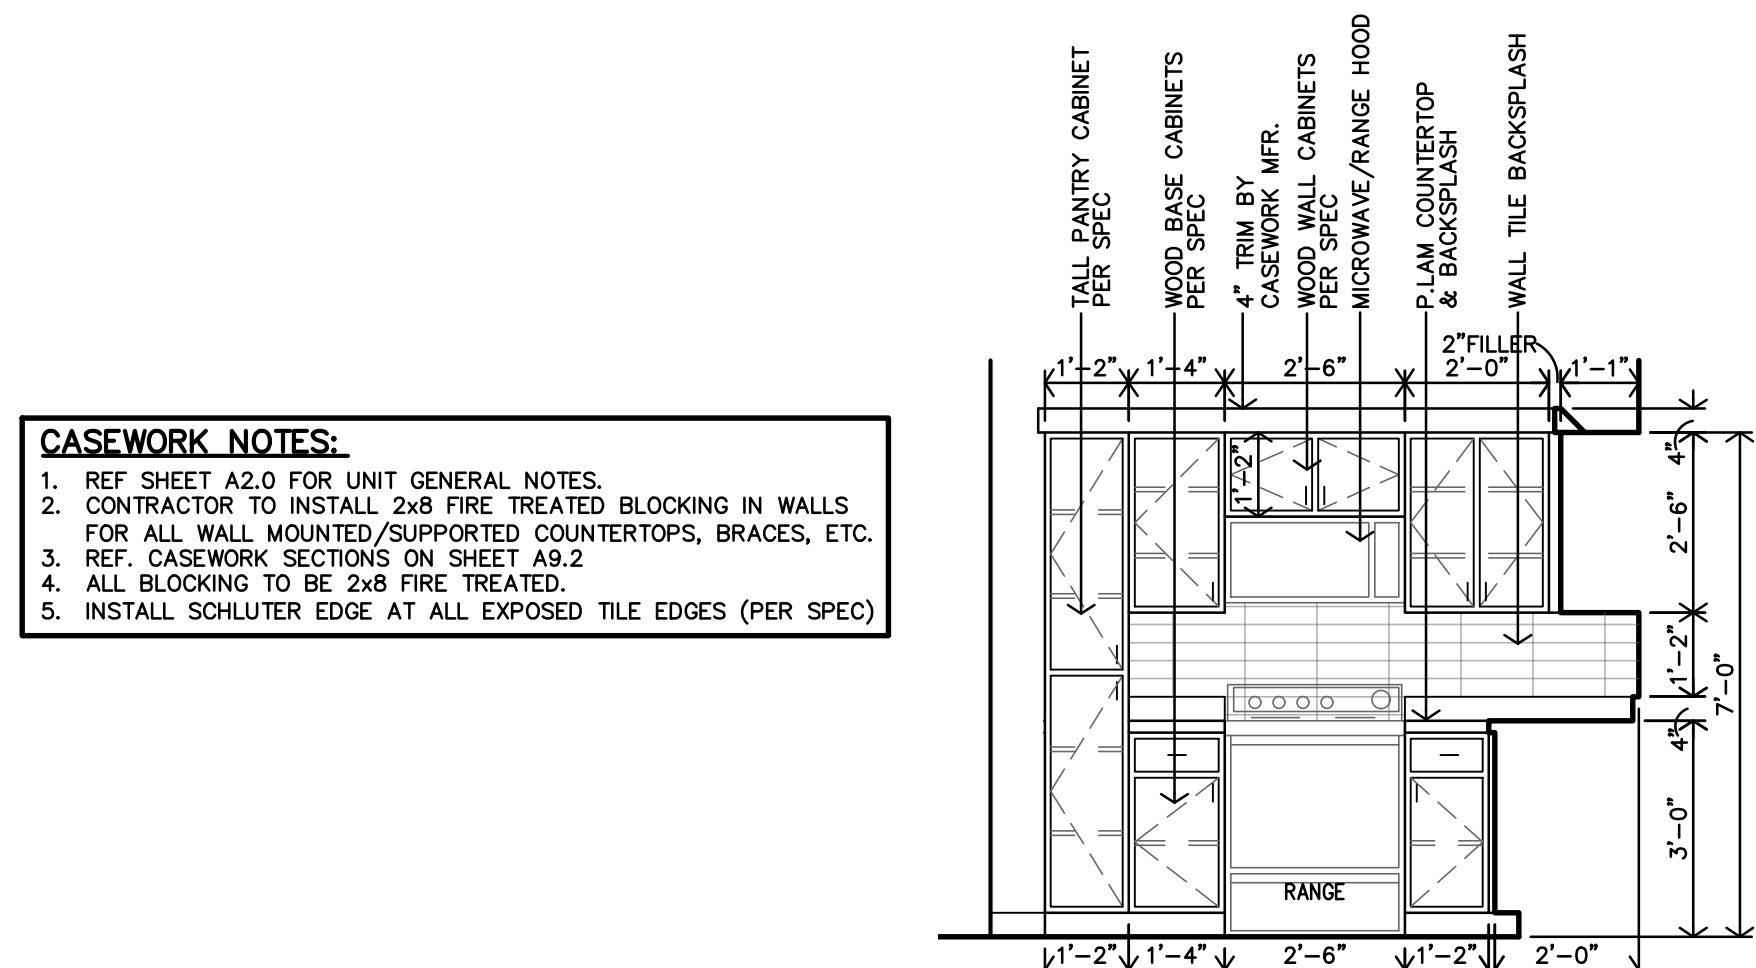


E TYPE B KITCHEN - TYPE #3 INTERIOR ELEVATIONS
3/8\"/>

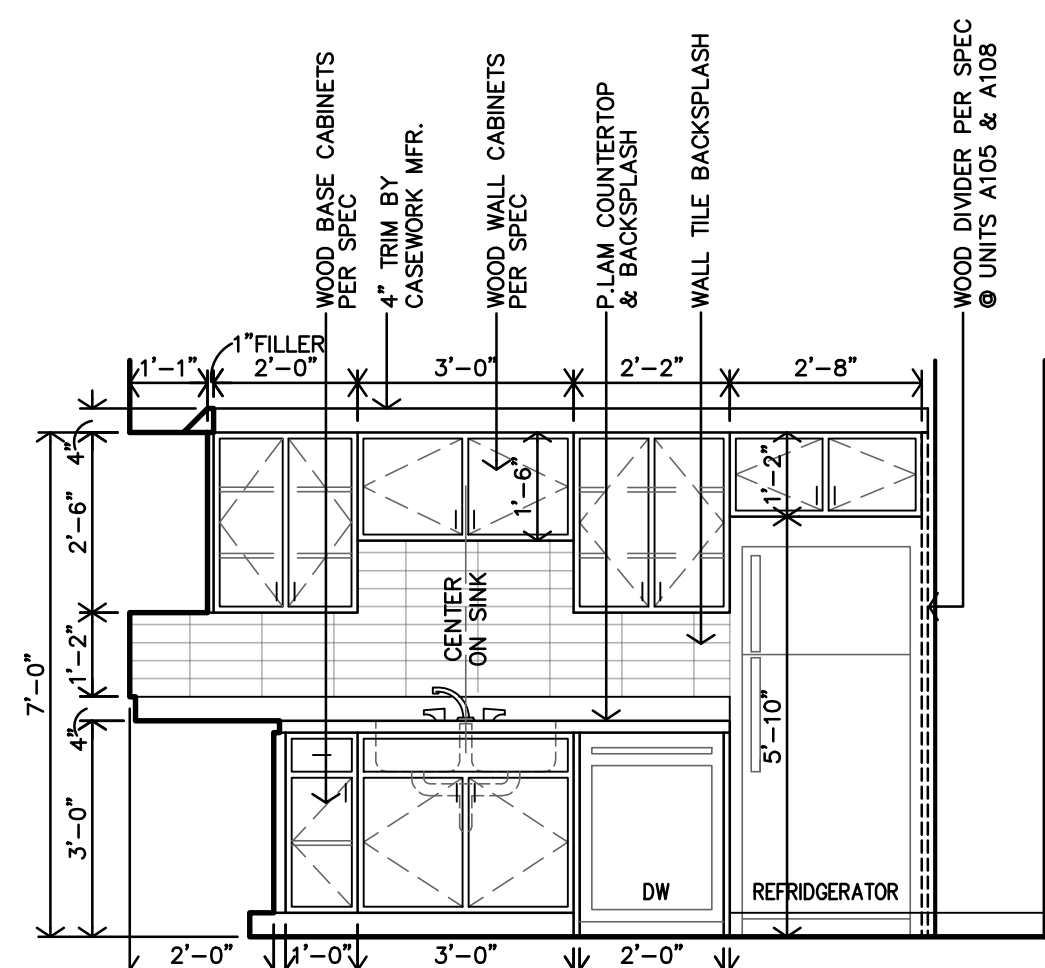


D TYPE B KITCHEN - TYPE #3 INTERIOR ELEVATIONS
3/8\"/>

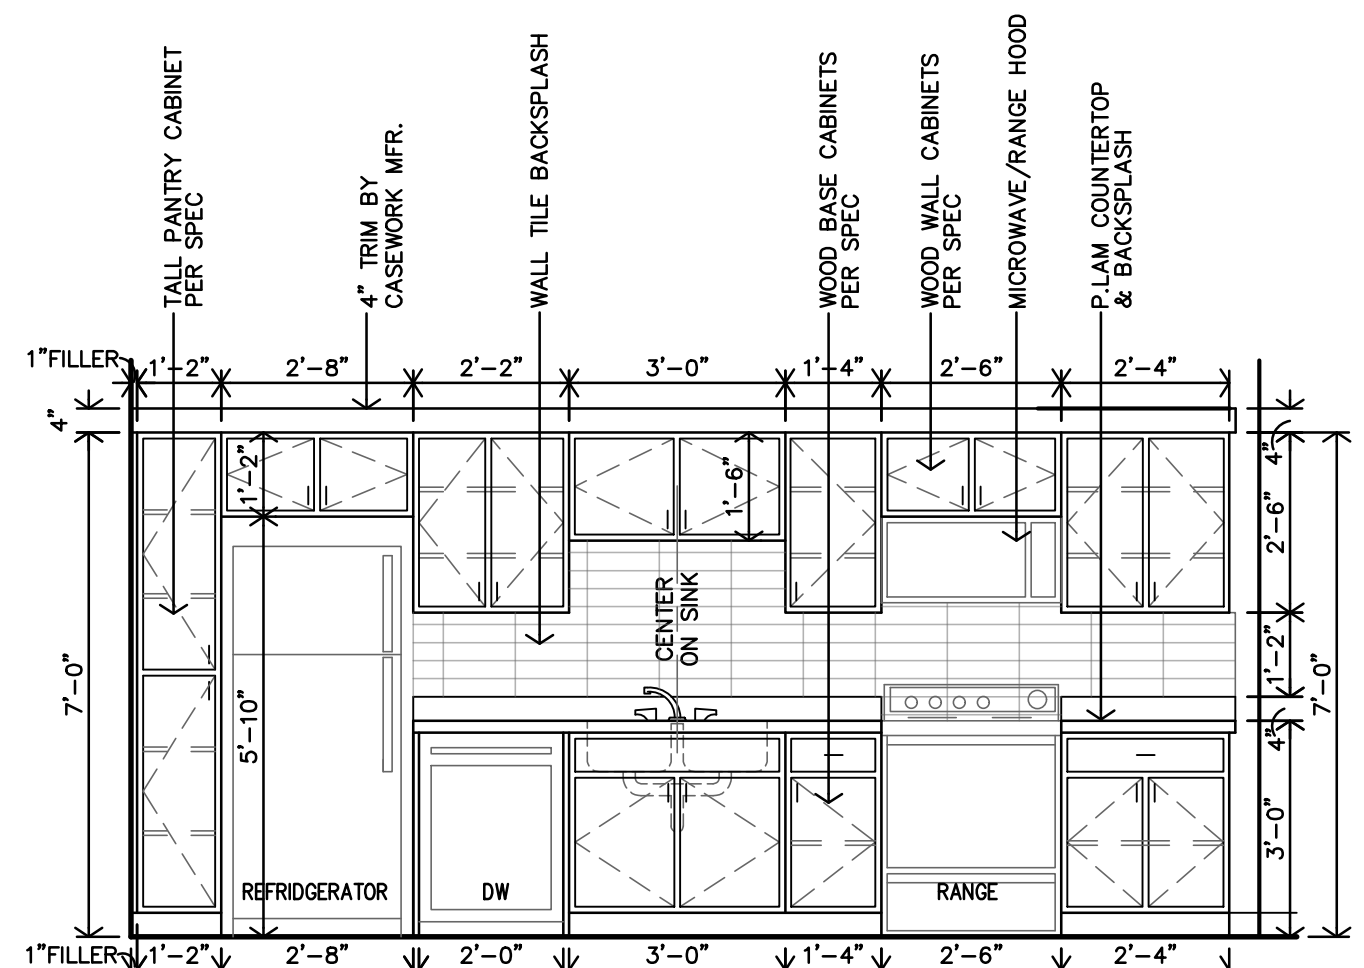

C TYPE B KITCHEN - TYPE #2 INTERIOR ELEVATIONS
3/8\"/>

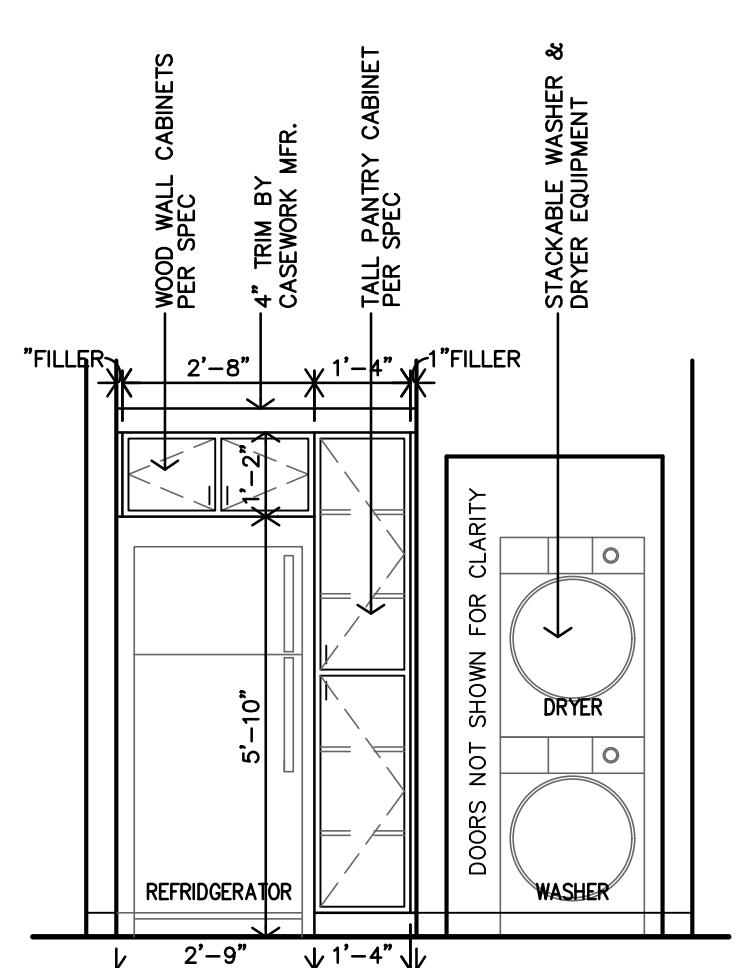

B TYPE B KITCHEN - TYPE #1 INTERIOR ELEVATIONS
3/8\"/>

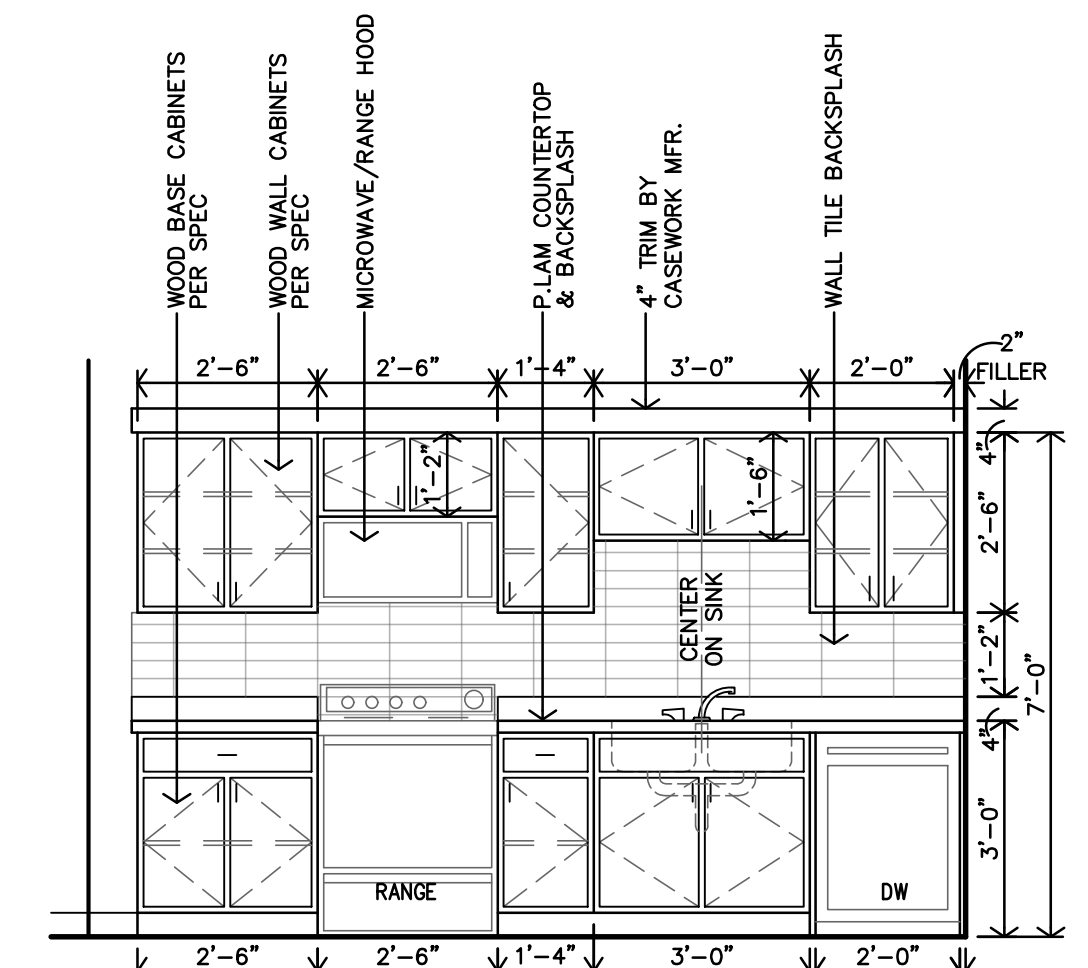

A TYPE B KITCHEN - TYPE #1 INTERIOR ELEVATIONS
3/8\"/>

CASEWORK NOTES:
1. REF. SHEET A2.0 FOR UNIT GENERAL NOTES.
2. CONTRACTOR TO INSTALL 2x8 FIRE TREATED BLOCKING IN WALLS FOR ALL WALL MOUNTED/SUPPORTED COUNTERTOPS, BRACES, ETC.
3. REF. CASEWORK SECTIONS ON SHEET A9.2
4. ALL BLOCKING TO BE 2x8 FIRE TREATED
5. INSTALL SCHLUTER EDGE AT ALL EXPOSED TILE EDGES (PER SPEC)



REVISION:

DATE: 11-20-2025
JOB: 25-3479
SHEET NO.:

ENLARGED BATH GENERAL NOTES:

- REF SHEET A2.0 FOR UNIT GENERAL NOTES.
- CONTRACTOR TO INSTALL 2x8 FIRE TREATED BLOCKING IN WALLS FOR ALL WALL MOUNTED/SUPPORTED COUNTERTOPS & BRACES, SHOWER UNIT, TOWEL BARS & FUTURE GRABS BARS, FUTURE SHOWER SEAT AS REQ'D. (REF. SHEET A9.4).
- SHOWER SEAT TO BE INSTALLED PER TENANT REQUEST IN ADAPTABLE UNITS.
- ALL SHOWERS MUST HAVE MIN. CLEAR INSIDE DIMENSIONS OF 36"x36".

BATH KEYNOTES:

- VERIFY ROUGH OPENING SIZE W/ ACTUAL SHOWER UNIT, REF. MECH DWGS.
- ACCESSIBLE SHOWER UNITS SHALL NOT HAVE SOAP DISH OR CORNER LEDGES.

LEGEND

M MIRROR
TP TOILET PAPER DISPENSER
TB TOWEL BAR
SR SHOWER ROD
CL CORNER LEDGE
SH SHOWER HEAD
SS SHOWER SEAT
GB GRAB BAR

CASEWORK NOTES:

- REF SHEET A2.0 FOR UNIT GENERAL NOTES.
- CONTRACTOR TO INSTALL 2x8 FIRE TREATED BLOCKING IN WALLS FOR ALL WALL MOUNTED/SUPPORTED COUNTERTOPS, BRACES, ETC.
- REF. CASEWORK SECTIONS ON SHEET A9.2
- ALL BLOCKING TO BE 2x8 FIRE TREATED.
- INSTALL SCHLUTER EDGE AT ALL EXPOSED TILE EDGES (PER SPEC)

E TYPE B UNIT KITCHEN CASEWORK SECTION
3/4"=1'-0"

VARIES
T.O. UPPER CABINET (REF. ELEV.)
TOP & BTM: DADOED INTO ALL SIDES
KILN DRIED HARDWOOD LUMBER
FRAME 3/4"x1 3/4" STILES & RAILS
W/ HANGING RAILS
SHELF: ADJUSTABLE W/ FINISHED EDGE
NOTE: 2 SHELVES @ CABINETS GREATER THAN 2'-6" HIGH
1/8" BACK
DOOR: STYLE TO BE SELECT BY OWNER W/ FINISHED EDGES
DRAWER
COUNTERTOP & BACKSPLASH W/ FINISHED ENDS WHERE EXPOSED
FRAME 3/4"x1 3/4" STILES & RAILS
W/ HANGING RAILS
1/8" BACK
SHELF: ADJUSTABLE W/ FINISHED EDGE
DOOR: STYLE TO BE SELECT BY OWNER W/ FINISHED EDGES
BTM: DADOED INTO ALL SIDES
TOE KICK
FIN. FLR.

NOTES:
1. MANUFACTURER SHALL SUBMIT SHOP DRAWINGS FOR APPROVAL.
2. MANUFACTURER SHALL PROVIDE ALL FILLERS/BRACES TO MATCH CABINETS.

D ACCESSIBLE KITCHEN CASEWORK SECTION
3/4"=1'-0"

VARIES
T.O. SHELF
REF. ELEV.
CABINET TOP
KILN DRIED HARDWOOD LUMBER
FRAME 3/4"x1 3/4" STILES & RAILS
W/ HANGING RAILS
SHELF: ADJUSTABLE W/ FINISHED EDGE
1/8" BACK
DOOR: STYLE TO BE SELECT BY OWNER W/ FINISHED EDGES
CABINET BOTTOM
DRAWER
COUNTERTOP & BACKSPLASH W/ FINISHED ENDS WHERE EXPOSED
FRAME 3/4"x1 3/4" STILES & RAILS
W/ HANGING RAILS
1/8" BACK
SHELF: ADJUSTABLE W/ FINISHED EDGE
DOOR: STYLE TO BE SELECT BY OWNER W/ FINISHED EDGES
BTM: DADOED INTO ALL SIDES
TOE KICK
FIN. FLR.

NOTES:
1. MANUFACTURER SHALL SUBMIT SHOP DRAWINGS FOR APPROVAL.
2. MANUFACTURER SHALL PROVIDE ALL FILLERS/BRACES TO MATCH CABINETS.

C ACCESSIBLE KITCHEN CASEWORK SECTION
3/4"=1'-0"

VARIES
T.O. SHELF
REF. ELEV.
CABINET TOP
KILN DRIED HARDWOOD LUMBER
FRAME 3/4"x1 3/4" STILES & RAILS
W/ HANGING RAILS
SHELF: ADJUSTABLE W/ FINISHED EDGE
1/8" BACK
DOOR: STYLE TO BE SELECT BY OWNER W/ FINISHED EDGES
CABINET BOTTOM
COUNTERTOP & BACKSPLASH W/ FINISHED ENDS WHERE EXPOSED
FRAME 3/4"x1 3/4" STILES & RAILS
W/ HANGING RAILS
1/8" BACK
SHELF: ADJUSTABLE W/ FINISHED EDGE
DOOR: STYLE TO BE SELECT BY OWNER W/ FINISHED EDGES
BTM: DADOED INTO ALL SIDES
TOE KICK
FIN. FLR.

NOTES:
1. MANUFACTURER SHALL SUBMIT SHOP DRAWINGS FOR APPROVAL.
2. MANUFACTURER SHALL PROVIDE ALL FILLERS/BRACES TO MATCH CABINETS.

B ACCESSIBLE KITCHEN - TYPE #11 INTERIOR ELEVATIONS
3/8"=1'-0"

1" FILLER
TALL PANTRY CABINET PER SPEC
WOOD WALL CABINETS PER SPEC
BRACE TO MATCH CABINETS
RANGE HOOD SWITCH
RANGE HOOD
WOOD BASE CABINETS PER SPEC
4" TRIM BY CASEWORK MFR.
CENTER ON SINK
FINISHED END, TP.
WALL TILE BACKSPLASH
PLAN COUNTERTOP & BACKSPLASH
4'-0" TOP OF BOTTOM SHELF
5'-9" REFRIGERATOR
1" DIVIDER
FINISHED PANEL

A TYPE B KITCHEN - TYPE #10 INTERIOR ELEVATIONS
3/8"=1'-0"

1" FILLER
TALL PANTRY CABINET PER SPEC
WOOD BASE CABINETS PER SPEC
WOOD WALL CABINETS PER SPEC
MICROWAVE/RANGE HOOD
WALL TILE BACKSPLASH
4" TRIM BY CASEWORK MFR.
PLAN COUNTERTOP & BACKSPLASH
5'-10" REFRIGERATOR
1" DIVIDER
FINISHED PANEL

Q TYPE-B UNIT BATH - TYPE B INTERIOR ELEVATION
3/8"=1'-0"

6'-0" 1-PIECE SHOWER SURROUND W/ (2) SOAP DISHES & BASE
SHOWER CURTAIN ROD
1-1/4" WOOD BASE TRIM
M.R. G.B., PAINTED
18" TOWEL BAR
SOLID SURFACE COUNTERTOP & BACKSPLASH
BASE CABINET PER SPEC.
2x8 BLK'G FOR FUTURE GRAB BARS
2'-10" (MAX) T.O. SINK RIM

P TYPE-B UNIT BATH - TYPE B INTERIOR ELEVATION
3/8"=1'-0"

EXISTING PLASTER
TOILET PAPER DISPENSER
1-1/4" WOOD BASE TRIM
1-PIECE SHOWER SURROUND W/ (2) SOAP DISHES & BASE
SHOWER CURTAIN ROD
2x8 BLK'G FOR FUTURE GRAB BARS
6'-2" 6'-0"

O TYPE-B UNIT BATH - TYPE B INTERIOR ELEVATION
3/8"=1'-0"

M.R. G.B., PAINTED
DOOR PER SCH.
1-1/4" WOOD BASE TRIM
M.R. G.B., PAINTED
TOILET PAPER DISPENSER
EXISTING PLASTER
2x8 BLK'G FOR FUTURE GRAB BARS

N TYPE-B UNIT BATH - TYPE B INTERIOR ELEVATION
3/8"=1'-0"

SOLID SURFACE COUNTERTOP & BACKSPLASH
30x40 MIRROR
CENTER LIGHT ON MIRROR & SINK
BASE CABINET PER SPEC.
M.R. G.B., PAINTED
1-1/4" WOOD BASE TRIM
M.R. G.B., PAINTED
2'-10" (MAX) T.O. SINK RIM
1'-0" 3'-0"

M TYPE-B UNIT BATH - TYPE B ENLARGED PLAN
3/8"=1'-0"

ROOMS VARY SLIGHTLY, DUE TO EXISTING CONDITIONS, REF. PLANS
5" 8'-7" 1'-9" 24" TB 18" TB
F.V. W/ SHOWER UNIT
F.V. W/ SHOWER UNIT
F.V. 1'-6" 5" 6" 8'-7"

L TYPE-B UNIT BATH - TYPE A INTERIOR ELEVATION
3/8"=1'-0"

6'-2" 7'-0" 7'-0" 1'-6" 1'-0" 3'-0" 2'-10" (MAX) T.O. SINK RIM
SHOWER CURTAIN ROD
1-PIECE SHOWER SURROUND W/ (2) SOAP DISHES & BASE
MIRROR 26x42
CENTER LIGHT ON MIRROR & SINK
BASE CABINET PER SPEC.
1-1/4" WOOD BASE TRIM
M.R. G.B., PAINTED
2x8 BLK'G FOR FUTURE GRAB BARS

K TYPE-B UNIT BATH - TYPE A INTERIOR ELEVATION
3/8"=1'-0"

1-PIECE SHOWER SURROUND W/ (2) SOAP DISHES & BASE
SHOWER CURTAIN ROD
M.R. G.B., PAINTED
24" TOWEL BAR
1-1/4" WOOD BASE TRIM
BASE CABINET PER SPEC.
18" TOWEL BAR
SOLID SURFACE COUNTERTOP & BACKSPLASH
2'-10" (MAX) T.O. SINK RIM
1'-9" 1'-6" 6'-0" 6'-2" 2x8 BLK'G FOR FUTURE GRAB BARS

J TYPE-B UNIT BATH - TYPE A INTERIOR ELEVATION
3/8"=1'-0"

1-PIECE SHOWER SURROUND W/ (2) SOAP DISHES & BASE
SHOWER CURTAIN ROD
M.R. G.B., PAINTED
24" TOWEL BAR
1-1/4" WOOD BASE TRIM
BASE CABINET PER SPEC.
18" TOWEL BAR
SOLID SURFACE COUNTERTOP & BACKSPLASH
2'-10" (MAX) T.O. SINK RIM
1'-9" 1'-6" 6'-0" 6'-2" 2x8 BLK'G FOR FUTURE GRAB BARS

H TYPE-B UNIT BATH - TYPE A INTERIOR ELEVATION
3/8"=1'-0"

M.R. G.B., PAINTED
1-1/4" WOOD BASE TRIM
SHOWER CURTAIN ROD
1-PIECE SHOWER SURROUND W/ (2) SOAP DISHES & BASE
TOILET PAPER DISP.
1-1/4" WOOD BASE TRIM
DOOR PER SCH.
M.R. G.B., PAINTED
2x8 BLK'G FOR FUTURE GRAB BARS

G TYPE-B UNIT BATH - TYPE A INTERIOR ELEVATION
3/8"=1'-0"

TOILET PAPER DISP.
1-1/4" WOOD BASE TRIM
DOOR PER SCH.
M.R. G.B., PAINTED
2x8 BLK'G FOR FUTURE GRAB BARS

F TYPE-B UNIT BATH - TYPE A ENLARGED PLAN
3/8"=1'-0"

ROOMS VARY SLIGHTLY, DUE TO EXISTING CONDITIONS, BLDG PLANS
8'-6" 9'-3" 1'-6" 24" TB 18" TB
F.V. W/ SHOWER UNIT
F.V. W/ SHOWER UNIT
F.V. 1'-6" 5" 6" 8'-7"

ENLARGED BATH GENERAL NOTES:
1. REF UNIT GENERAL NOTES FOR ADDITIONAL DIRECTION ON SHEET A2.0.
2. ALL DIMENSIONS ARE TO FACE OF GYP. BD. UNLESS NOTED OTHERWISE.
3. CONTRACTOR TO INSTALL 2x8 BLOCKING IN WALLS FOR ALL WALL MOUNTED/SUPPORTED COUNTERTOPS & BRACES, SHOWER UNIT, TOWEL BARS & FUTURE GRABS BARS, FUTURE SHOWER SEAT AS REQ'D. (REF. SHEET A9.4).
4. SHOWER SEAT TO BE INSTALLED PER TENANT REQUEST IN ADAPTABLE UNITS.
5. ALL SHOWERS MUST HAVE MIN. CLEAR INSIDE DIMENSIONS OF 36"x36".

BATH KEYNOTES:
① VERIFY ROUGH OPENING SIZE W/ ACTUAL SHOWER UNIT. REF. MECH DWGS.
② ACCESSIBLE SHOWER UNITS SHALL NOT HAVE SOAP DISH OR CORNER LEDGES.

LEGEND
M MIRROR
TP TOILET PAPER DISPENSER
TB TOWEL BAR
SR SHOWER ROD
CL CORNER LEDGE
SH SHOWER HEAD
SS SHOWER SEAT
GB GRAB BAR

Diagram E shows the interior elevation of a Type-B Unit Bath - Type C. It features a toilet with a 2x8 blocking for future grab bars, a 1x4 wood base trim, a toilet paper dispenser, and a shower unit with a 1-piece shower surround, soap dishes, and base. The shower unit is 6'-2" high and 6'-0" wide. The toilet is 1'-6" high. The wall is 6'-2" high. The floor is 6'-0" high.

E
TYPE-B UNIT
BATH - TYPE C
INTERIOR ELEVATION
3/8"=1'-0"

Diagram D shows the interior elevation of a Type-B Unit Bath - Type C. It features a toilet with a 2x8 blocking for future grab bars, a 1x4 wood base trim, a toilet paper dispenser, and a shower unit with a 1-piece shower surround, soap dishes, and base. The shower unit is 6'-2" high and 6'-0" wide. The toilet is 1'-6" high. The wall is 6'-2" high. The floor is 6'-0" high.

D
TYPE-B UNIT
BATH - TYPE C
INTERIOR ELEVATION
3/8"=1'-0"

Diagram C shows the interior elevation of a Type-B Unit Bath - Type C. It features a toilet with a 2x8 blocking for future grab bars, a 1x4 wood base trim, a toilet paper dispenser, and a shower unit with a 1-piece shower surround, soap dishes, and base. The shower unit is 6'-2" high and 6'-0" wide. The toilet is 1'-6" high. The wall is 6'-2" high. The floor is 6'-0" high.

C
TYPE-B UNIT
BATH - TYPE C
INTERIOR ELEVATION
3/8"=1'-0"

Diagram B shows the interior elevation of a Type-B Unit Bath - Type C. It features a toilet with a 2x8 blocking for future grab bars, a 1x4 wood base trim, a toilet paper dispenser, and a shower unit with a 1-piece shower surround, soap dishes, and base. The shower unit is 6'-2" high and 6'-0" wide. The toilet is 1'-6" high. The wall is 6'-2" high. The floor is 6'-0" high.

B
TYPE-B UNIT
BATH - TYPE C
INTERIOR ELEVATION
3/8"=1'-0"

Diagram A shows the enlarged plan of a Type-B Unit Bath - Type C. It features a toilet, a shower unit, and a sink. The toilet is 1'-6" high. The shower unit is 6'-2" high and 6'-0" wide. The sink is 1'-6" high. The wall is 6'-2" high. The floor is 6'-0" high.

A
TYPE-B UNIT
BATH - TYPE C
ENLARGED PLAN
3/8"=1'-0"

Diagram L shows the interior elevation of an Accessible Bath - Type D. It features a toilet with a 2x8 blocking for future grab bars, a 1x4 wood base trim, a toilet paper dispenser, and a shower unit with a 1-piece shower surround, soap dishes, and base. The shower unit is 6'-2" high and 6'-0" wide. The toilet is 1'-6" high. The wall is 6'-2" high. The floor is 6'-0" high.

L
ACCESSIBLE
BATH - TYPE D
INTERIOR ELEVATION
3/8"=1'-0"

Diagram K shows the interior elevation of an Accessible Bath - Type D. It features a toilet with a 2x8 blocking for future grab bars, a 1x4 wood base trim, a toilet paper dispenser, and a shower unit with a 1-piece shower surround, soap dishes, and base. The shower unit is 6'-2" high and 6'-0" wide. The toilet is 1'-6" high. The wall is 6'-2" high. The floor is 6'-0" high.

K
ACCESSIBLE
BATH - TYPE D
INTERIOR ELEVATION
3/8"=1'-0"

Diagram J shows the interior elevation of an Accessible Bath - Type D. It features a toilet with a 2x8 blocking for future grab bars, a 1x4 wood base trim, a toilet paper dispenser, and a shower unit with a 1-piece shower surround, soap dishes, and base. The shower unit is 6'-2" high and 6'-0" wide. The toilet is 1'-6" high. The wall is 6'-2" high. The floor is 6'-0" high.

J
ACCESSIBLE
BATH - TYPE D
INTERIOR ELEVATION
3/8"=1'-0"

Diagram H shows the interior elevation of an Accessible Bath - Type D. It features a toilet with a 2x8 blocking for future grab bars, a 1x4 wood base trim, a toilet paper dispenser, and a shower unit with a 1-piece shower surround, soap dishes, and base. The shower unit is 6'-2" high and 6'-0" wide. The toilet is 1'-6" high. The wall is 6'-2" high. The floor is 6'-0" high.

H
ACCESSIBLE
BATH - TYPE D
INTERIOR ELEVATION
3/8"=1'-0"

Diagram G shows the interior elevation of an Accessible Bath - Type D. It features a toilet with a 2x8 blocking for future grab bars, a 1x4 wood base trim, a toilet paper dispenser, and a shower unit with a 1-piece shower surround, soap dishes, and base. The shower unit is 6'-2" high and 6'-0" wide. The toilet is 1'-6" high. The wall is 6'-2" high. The floor is 6'-0" high.

G
ACCESSIBLE
BATH - TYPE D
INTERIOR ELEVATION
3/8"=1'-0"

Diagram F shows the enlarged plan of an Accessible Bath - Type D. It features a toilet, a shower unit, and a sink. The toilet is 1'-6" high. The shower unit is 6'-2" high and 6'-0" wide. The sink is 1'-6" high. The wall is 6'-2" high. The floor is 6'-0" high.

F
ACCESSIBLE
BATH - TYPE D
ENLARGED PLAN
3/8"=1'-0"

Diagram Q shows the interior elevation of a Type-B Unit Bath - Type E. It features a toilet with a 2x8 blocking for future grab bars, a 1x4 wood base trim, a toilet paper dispenser, and a shower unit with a 1-piece shower surround, soap dishes, and base. The shower unit is 6'-2" high and 6'-0" wide. The toilet is 1'-6" high. The wall is 6'-2" high. The floor is 6'-0" high.

Q
TYPE-B UNIT
BATH - TYPE E
INTERIOR ELEVATION
3/8"=1'-0"

Diagram P shows the interior elevation of a Type-B Unit Bath - Type E. It features a toilet with a 2x8 blocking for future grab bars, a 1x4 wood base trim, a toilet paper dispenser, and a shower unit with a 1-piece shower surround, soap dishes, and base. The shower unit is 6'-2" high and 6'-0" wide. The toilet is 1'-6" high. The wall is 6'-2" high. The floor is 6'-0" high.

P
TYPE-B UNIT
BATH - TYPE E
INTERIOR ELEVATION
3/8"=1'-0"

Diagram O shows the interior elevation of a Type-B Unit Bath - Type E. It features a toilet with a 2x8 blocking for future grab bars, a 1x4 wood base trim, a toilet paper dispenser, and a shower unit with a 1-piece shower surround, soap dishes, and base. The shower unit is 6'-2" high and 6'-0" wide. The toilet is 1'-6" high. The wall is 6'-2" high. The floor is 6'-0" high.

O
TYPE-B UNIT
BATH - TYPE E
INTERIOR ELEVATION
3/8"=1'-0"

Diagram N shows the interior elevation of a Type-B Unit Bath - Type E. It features a toilet with a 2x8 blocking for future grab bars, a 1x4 wood base trim, a toilet paper dispenser, and a shower unit with a 1-piece shower surround, soap dishes, and base. The shower unit is 6'-2" high and 6'-0" wide. The toilet is 1'-6" high. The wall is 6'-2" high. The floor is 6'-0" high.

N
TYPE-B UNIT
BATH - TYPE E
INTERIOR ELEVATION
3/8"=1'-0"

Diagram M shows the enlarged plan of a Type-B Unit Bath - Type E. It features a toilet, a shower unit, and a sink. The toilet is 1'-6" high. The shower unit is 6'-2" high and 6'-0" wide. The sink is 1'-6" high. The wall is 6'-2" high. The floor is 6'-0" high.

M
TYPE-B UNIT
BATH - TYPE E
ENLARGED PLAN
3/8"=1'-0"

JCR
JonesGillamRenz
1881 Main Street, Suite 301
Salina, KS 67401
785.827.0386
jg@jgarchitects.com


THE IRVING LOFTS
HISTORIC RESTORATION & REHAB APARTMENTS
CLEBURNE, TEXAS

REGISTERED ARCHITECT
STATE OF TEXAS
11-20-2025
22854









REVISION:
DATE: 11-20-2025
JOB: 25-3479
SHEET NO.:

A9.3














COPYRIGHTED ©












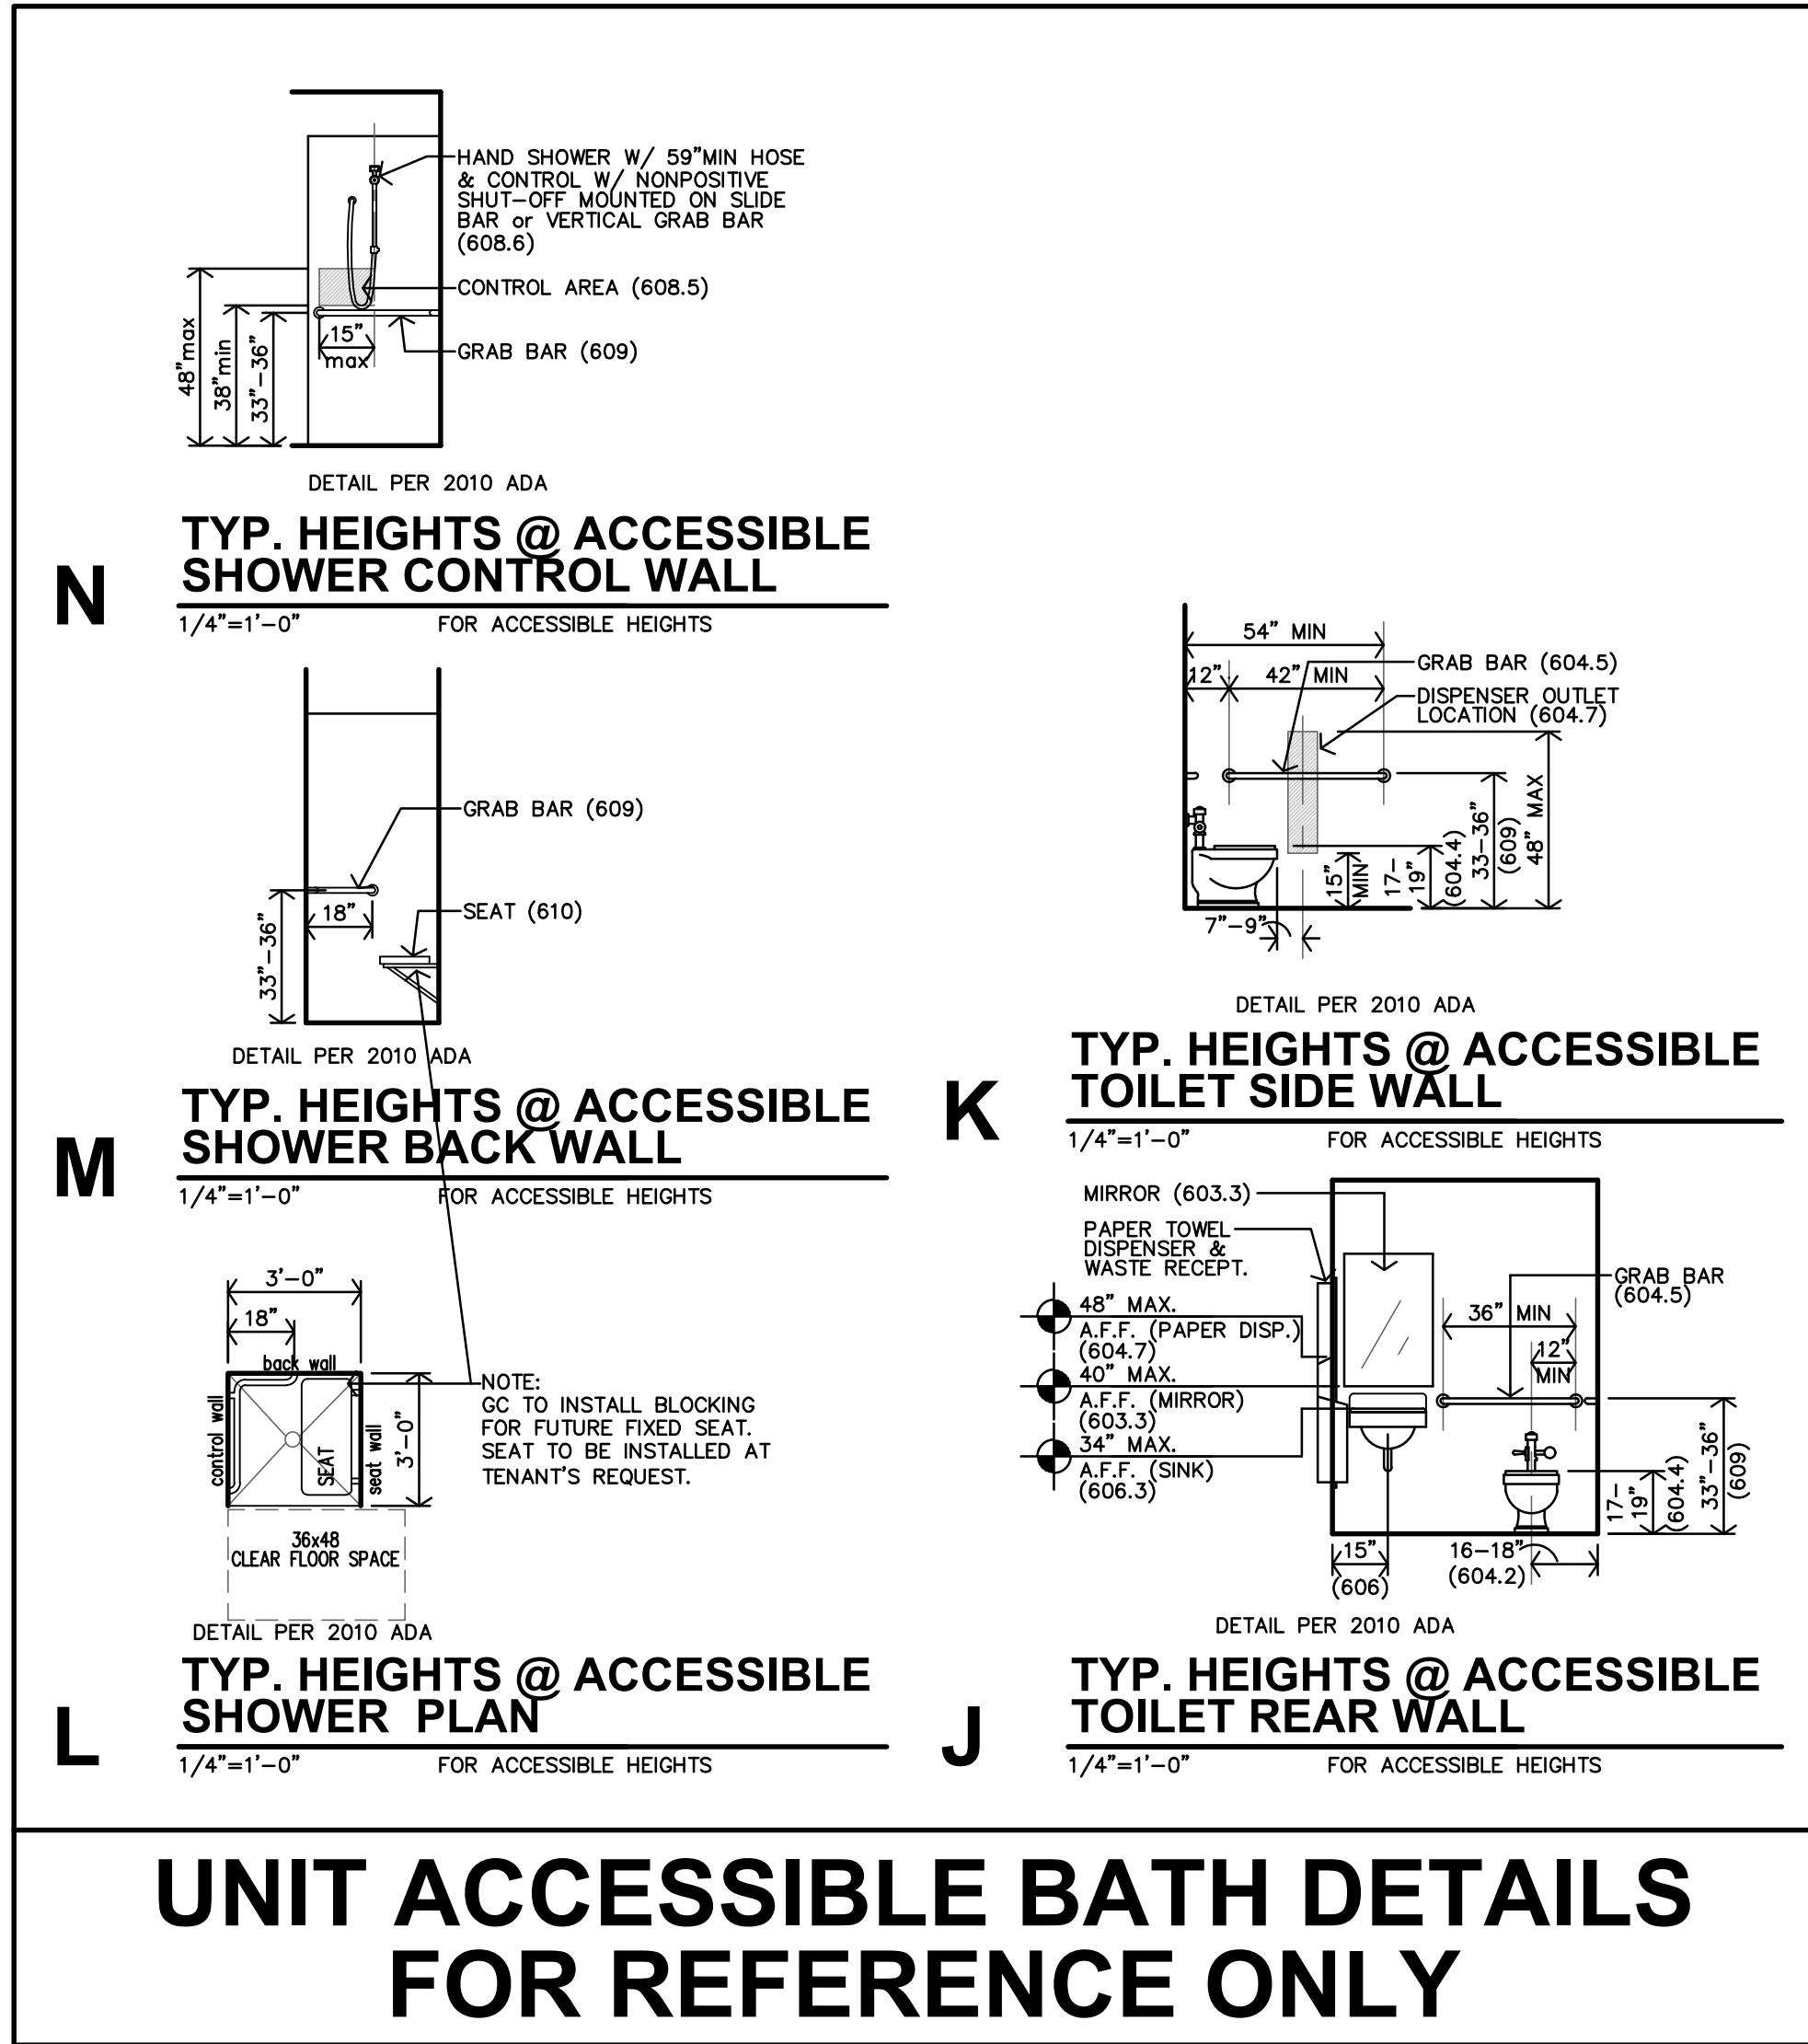


ENLARGED BATH GENERAL NOTES:	
1. REF UNIT GENERAL NOTES FOR ADDITIONAL DIRECTION ON SHEET A2.0.	
2. ALL DIMENSIONS ARE TO FACE OF GYP. BD. UNLESS NOTED OTHERWISE.	
3. CONTRACTOR TO INSTALL 2x8 BLOCKING IN WALLS FOR ALL WALL MOUNTED/SUPPORTED COUNTERTOPS & BRACES, SHOWER UNIT, TOWEL BARS & FUTURE GRABS BARS, FUTURE SHOWER SEAT AS REQ'D. (REF. SHEET A9.4.)	
4. SHOWER SEAT TO BE INSTALLED PER TENANT REQUEST IN ADAPTABLE UNITS.	
5. ALL SHOWERS MUST HAVE MIN. CLEAR INSIDE DIMENSIONS OF 36"x36".	
BATH KEYNOTES:	
1. VERIFY ROUGH OPENING SIZE w/ ACTUAL SHOWER UNIT. REF. MECH DWGS.	
2. ACCESSIBLE SHOWER UNITS SHALL NOT HAVE SOAP DISH OR CORNER LEDGES.	
LEGEND	
M MIRROR	TP TOILET PAPER DISPENSER
TB TOWEL BAR	SR SHOWER ROD
CL CORNER LEDGE	SH SHOWER HEAD
SS SHOWER SEAT	GB GRAB BAR

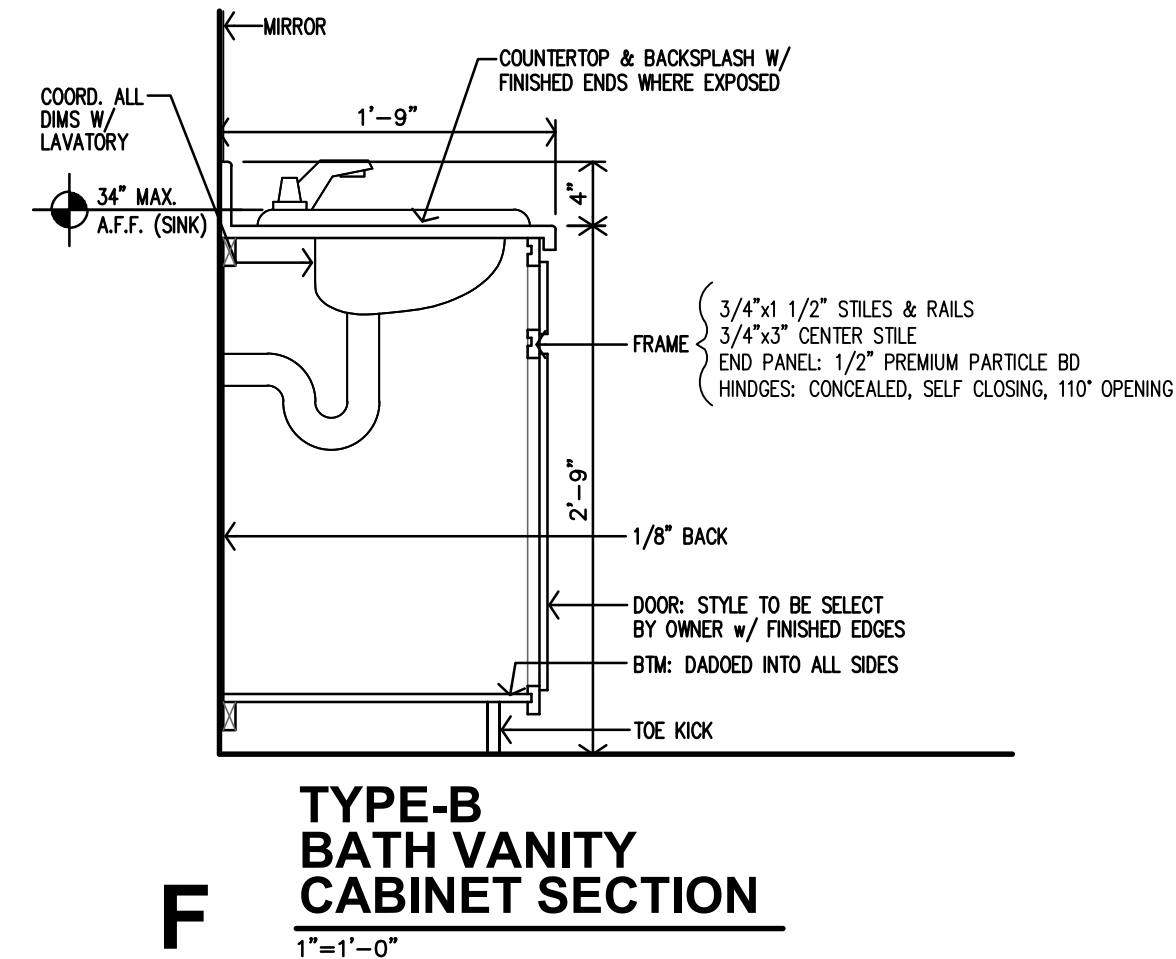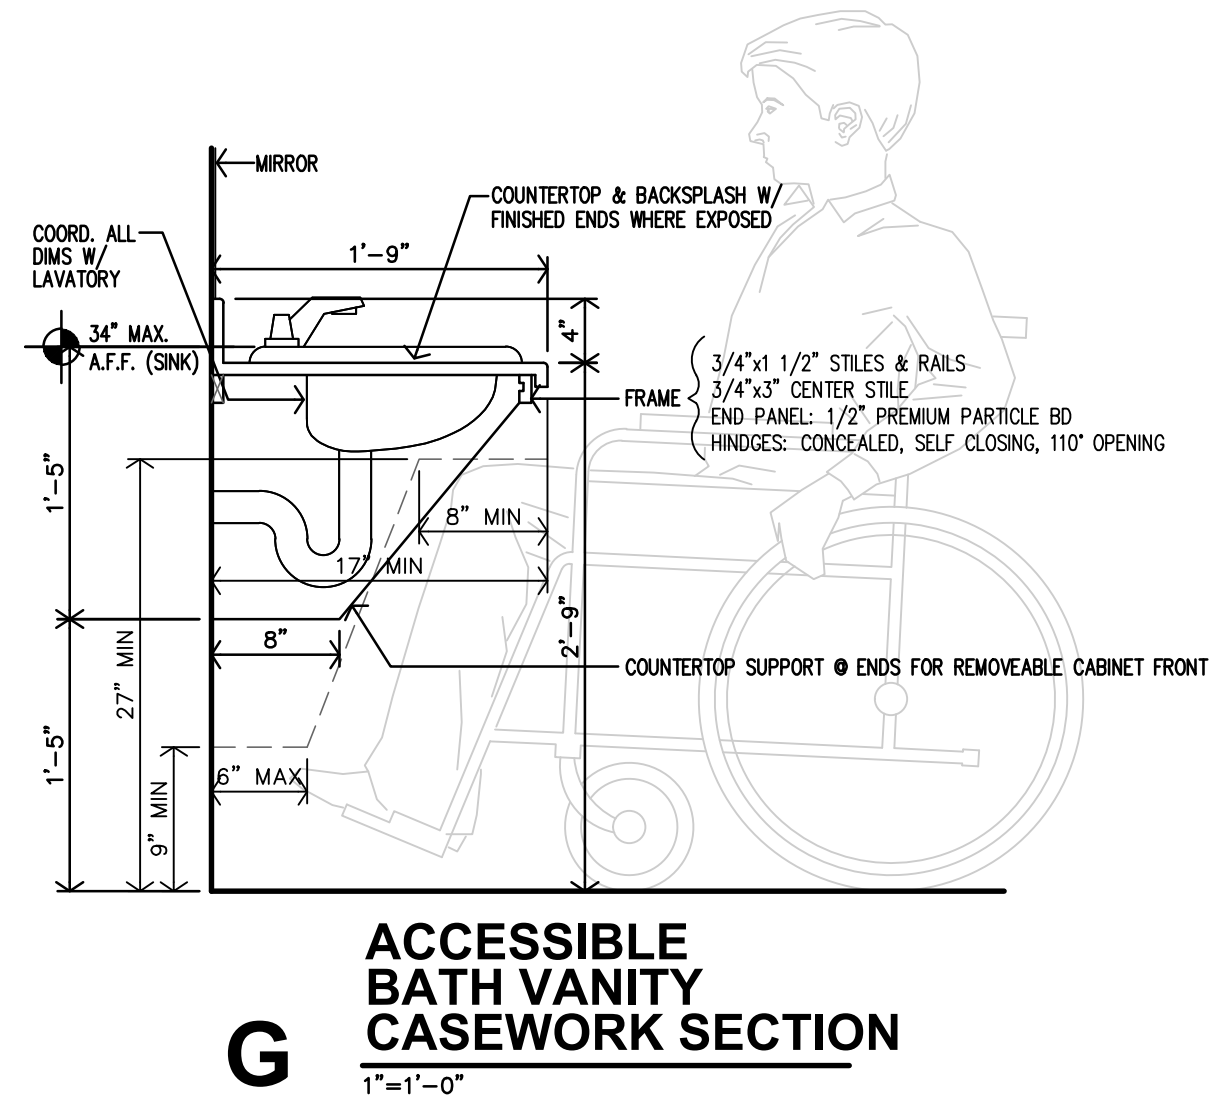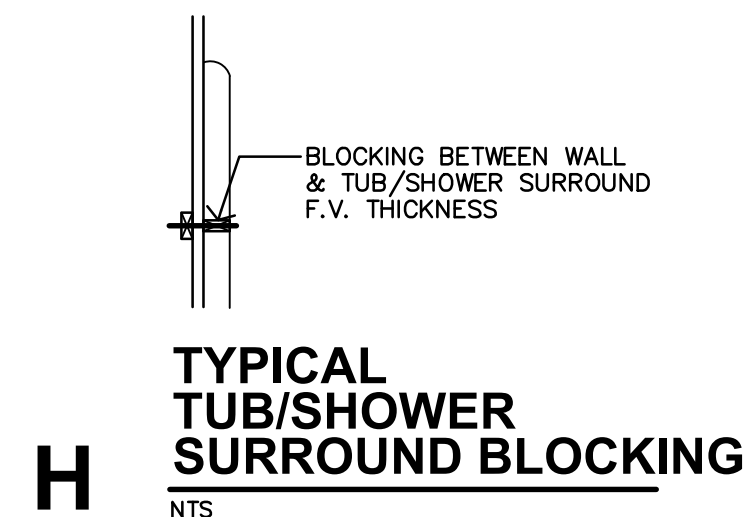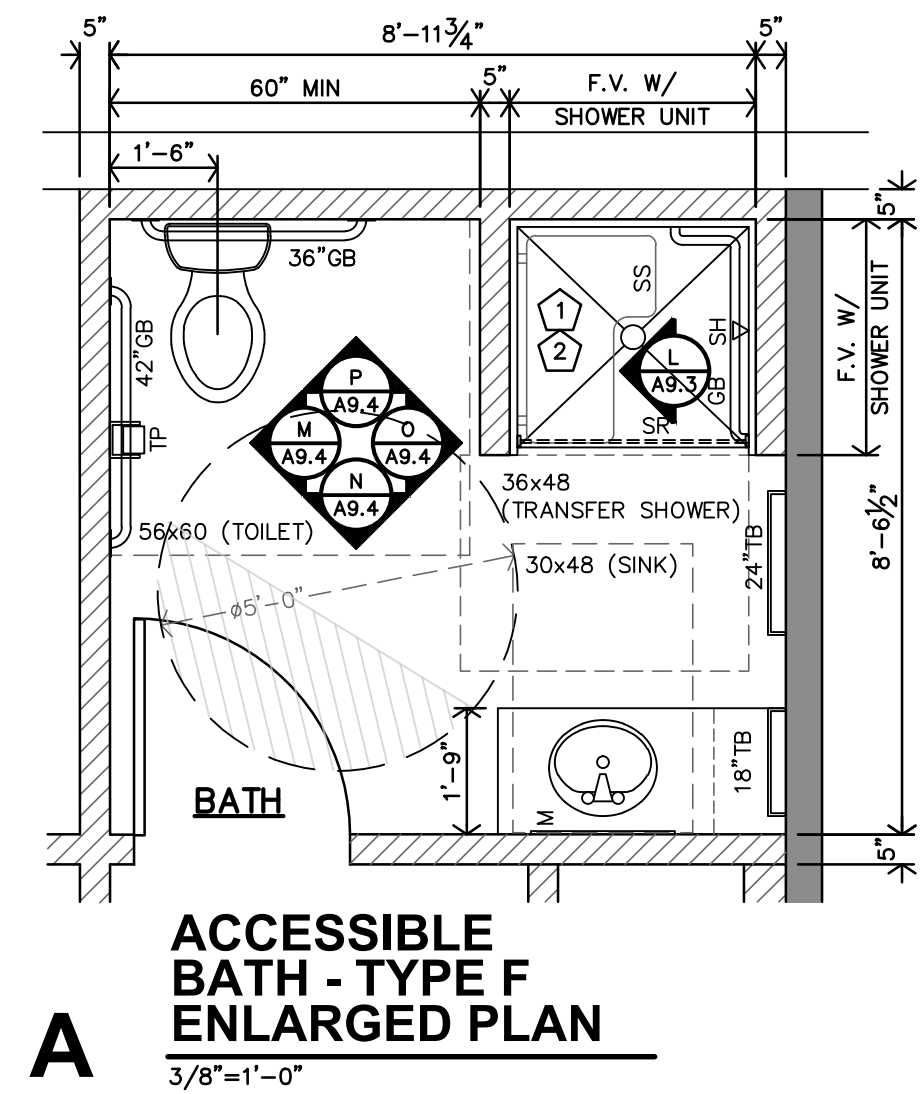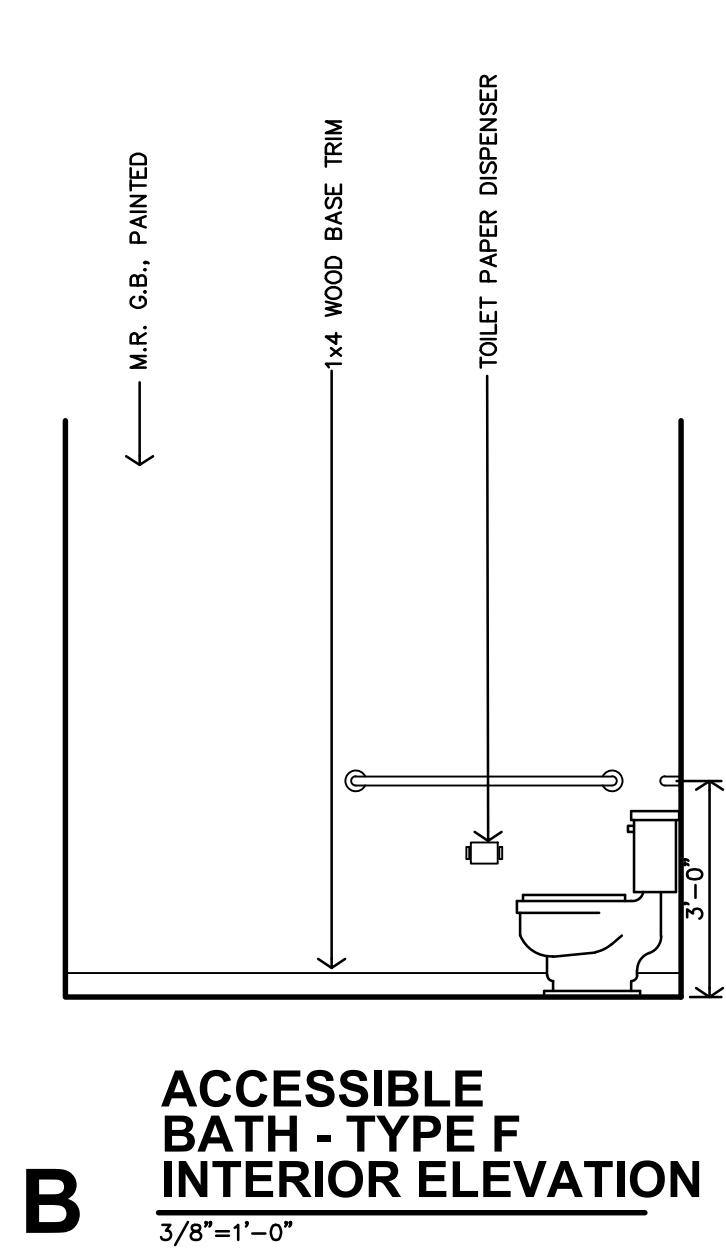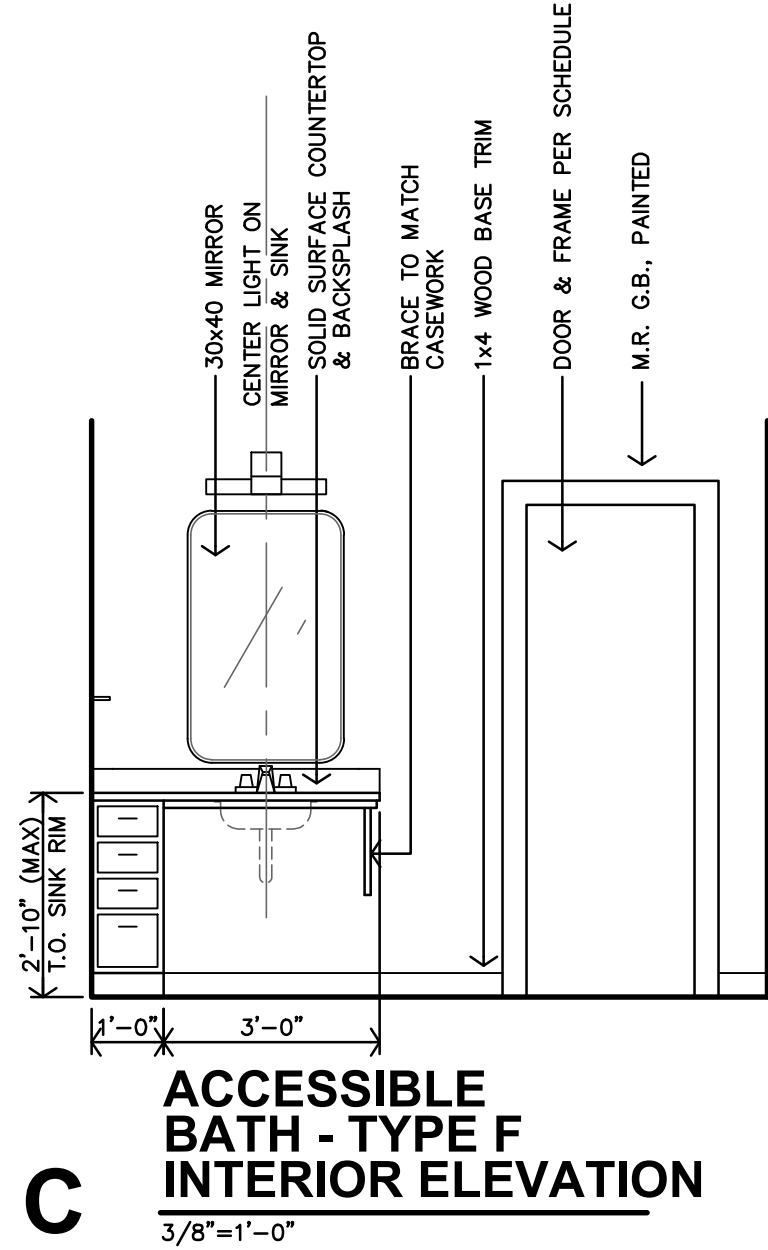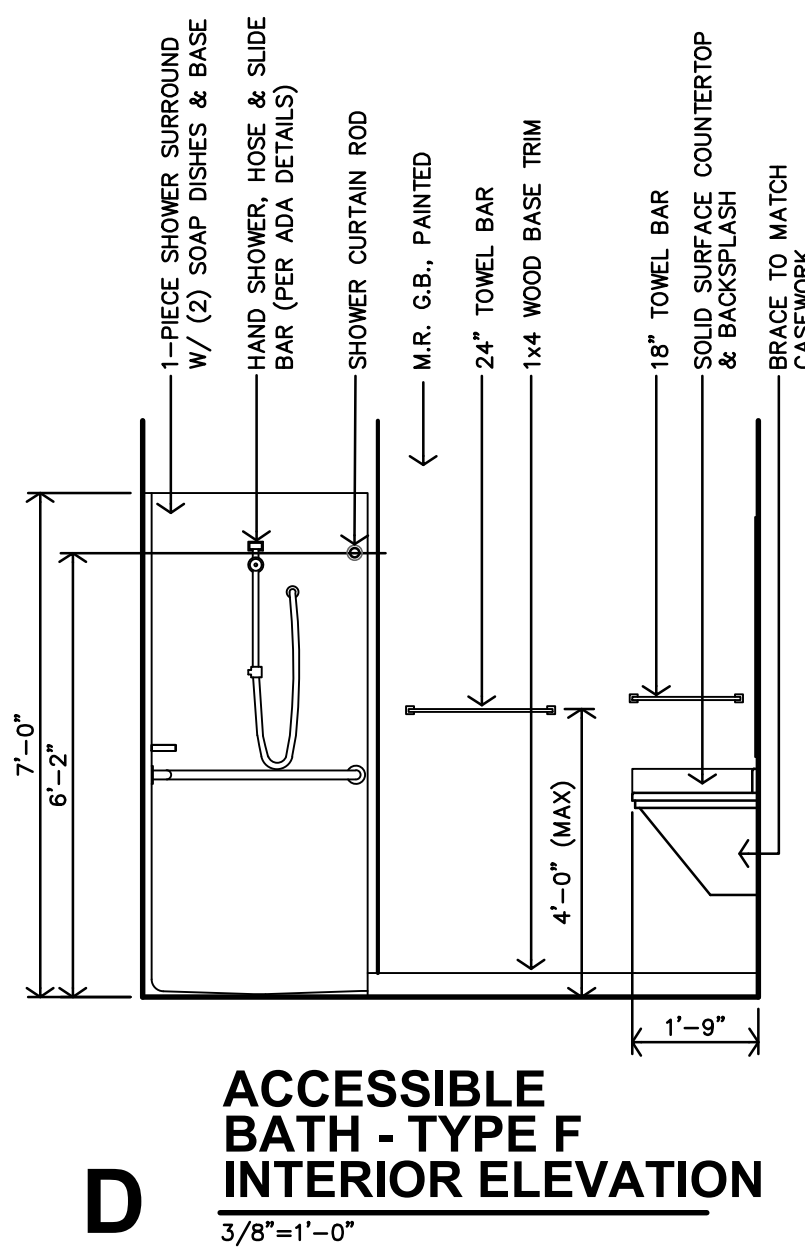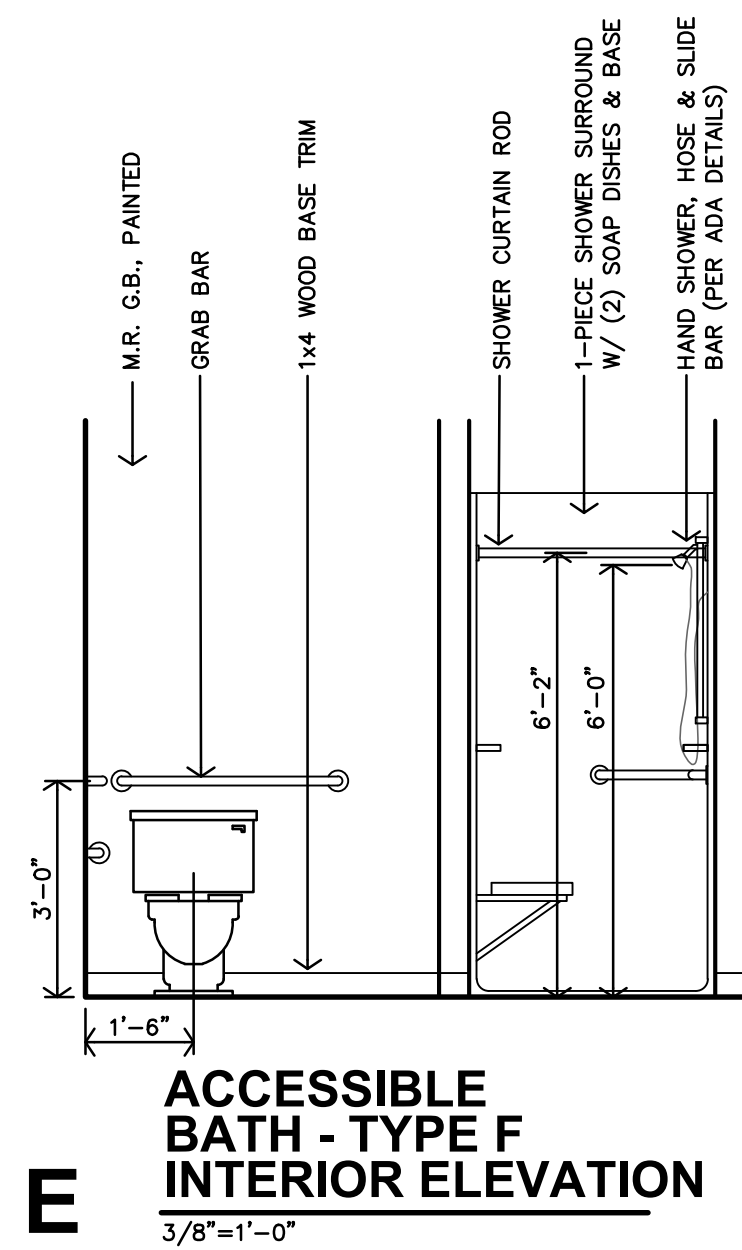

REVISION:	
DATE:	11-20-2025
JOB:	25-3479
SHEET NO.:	

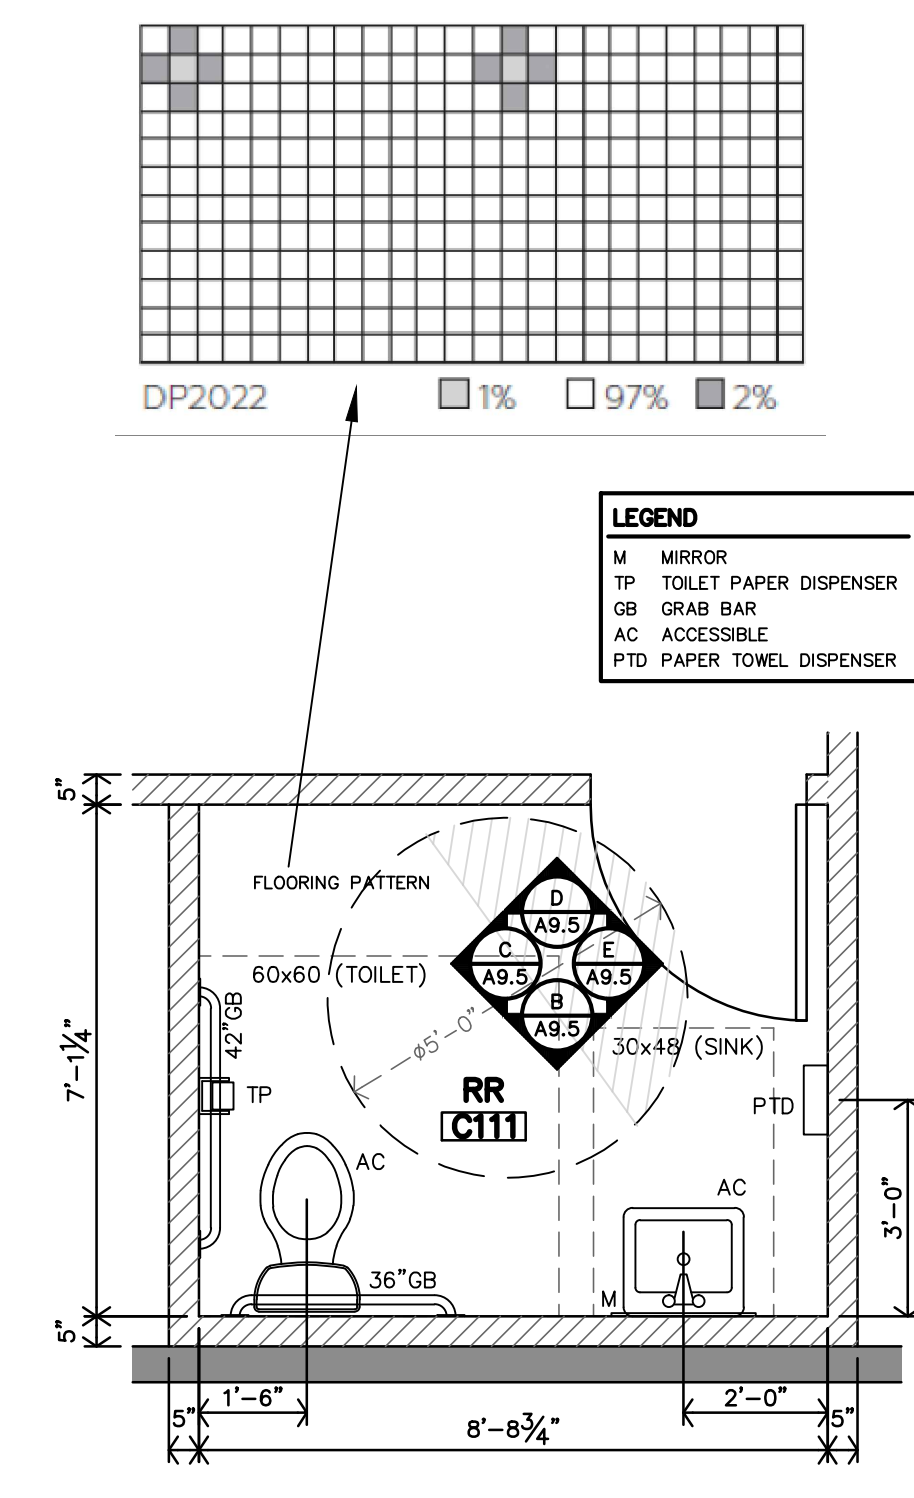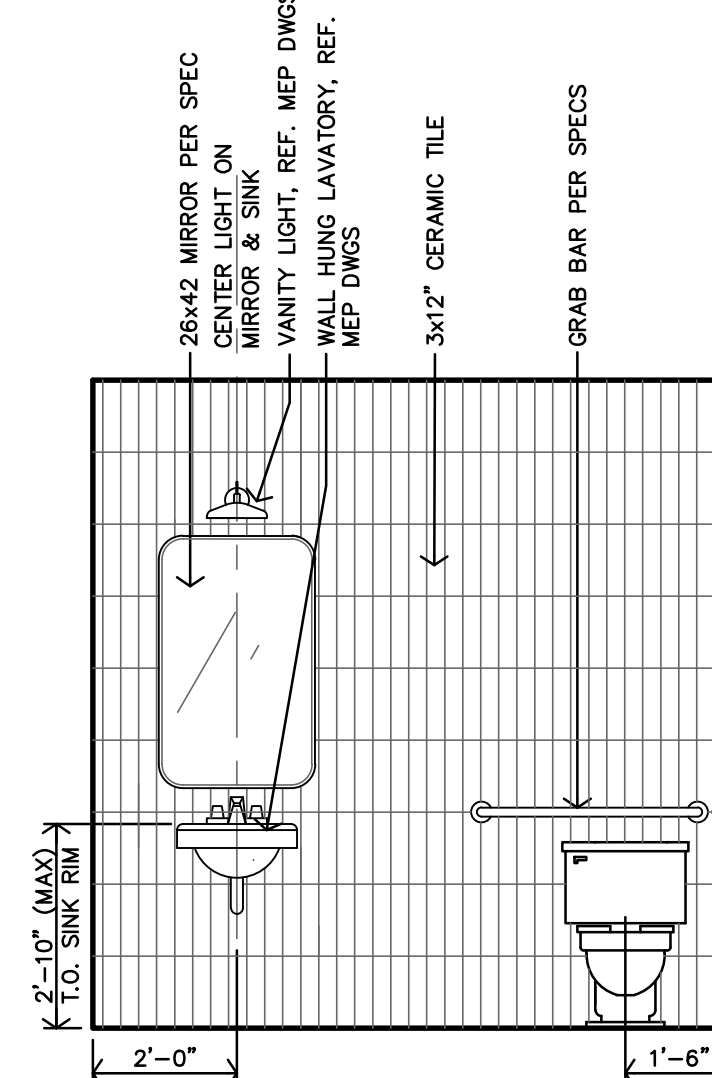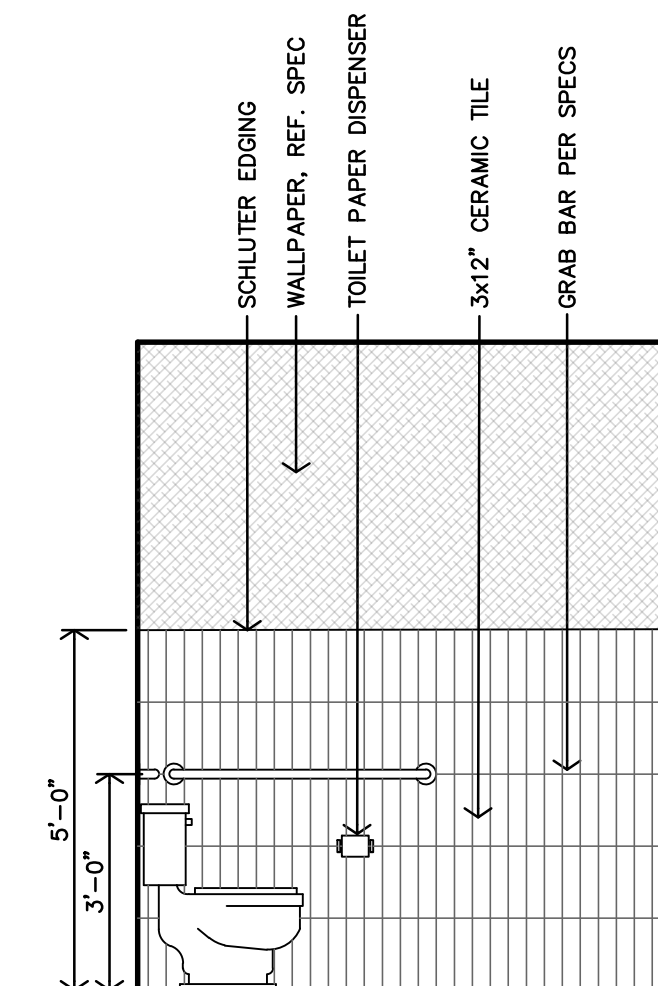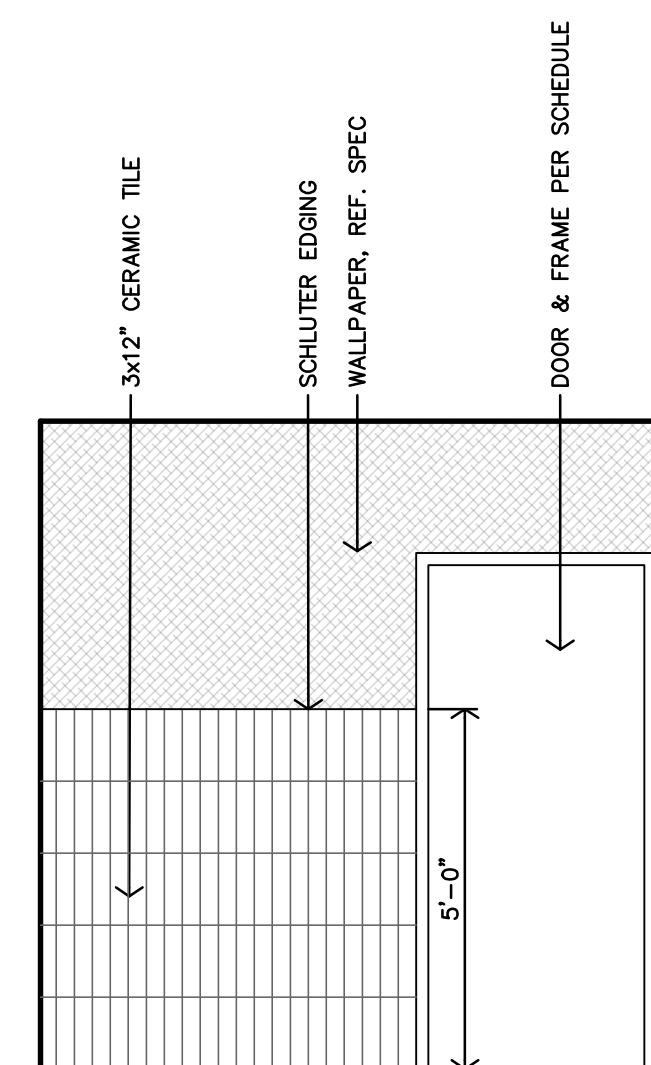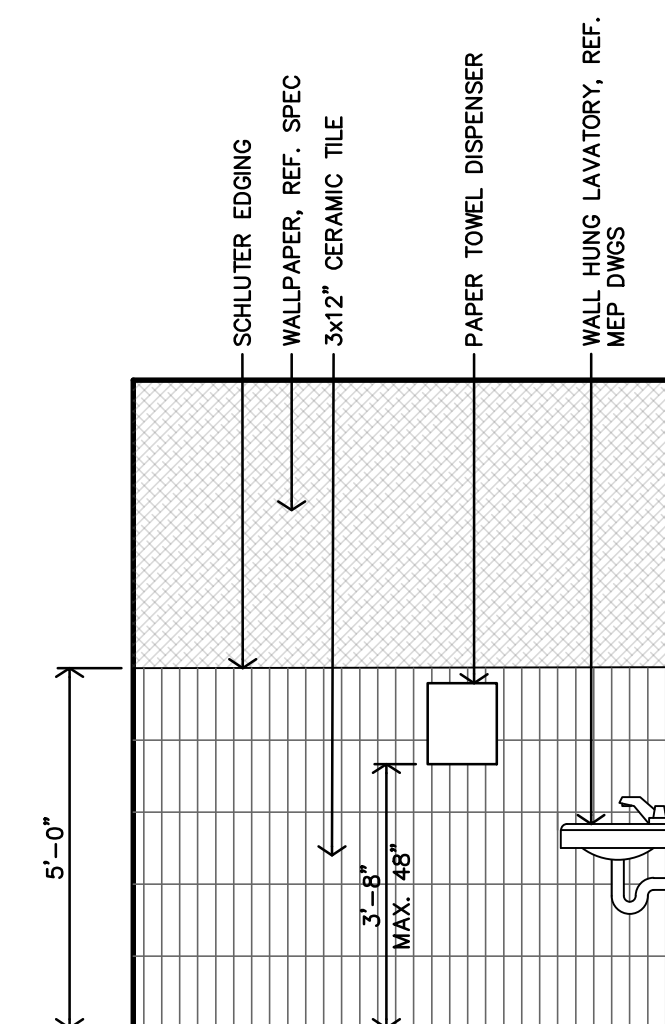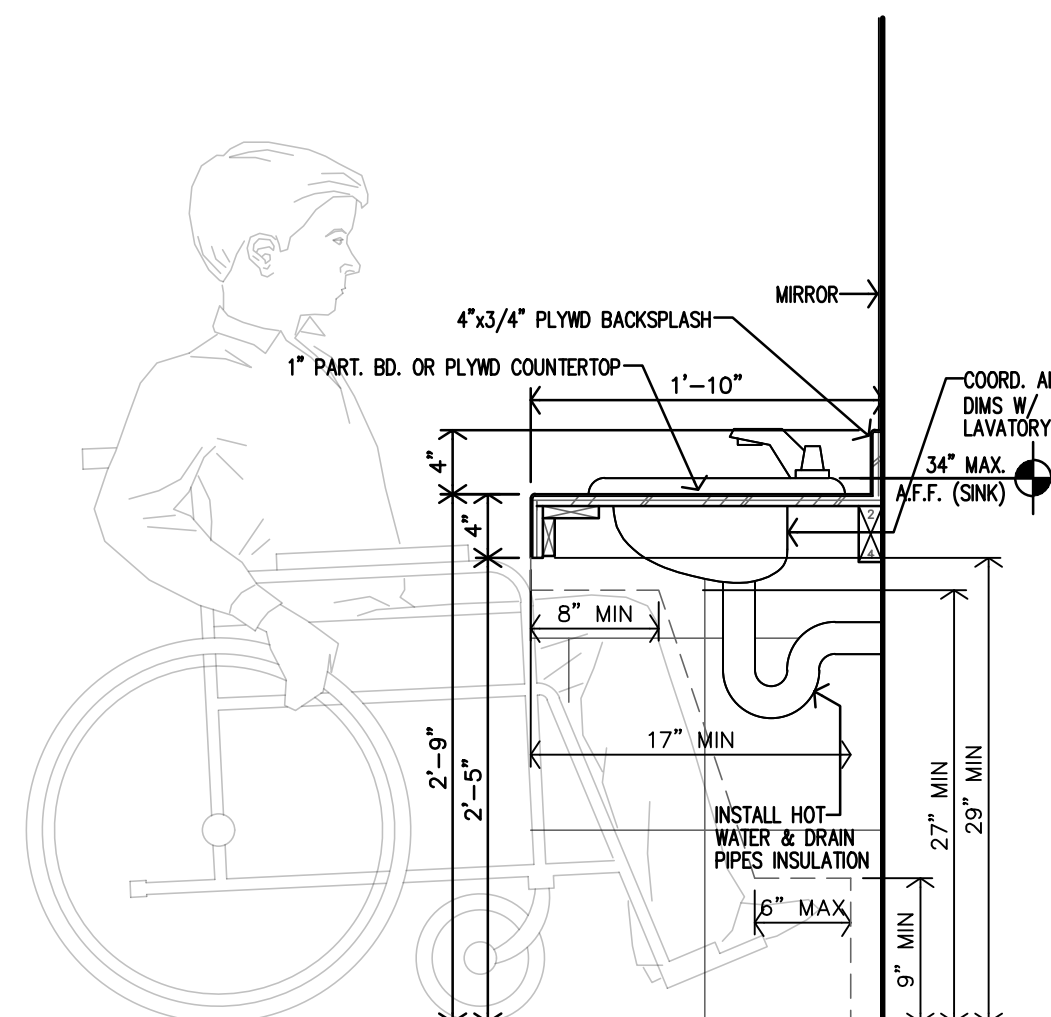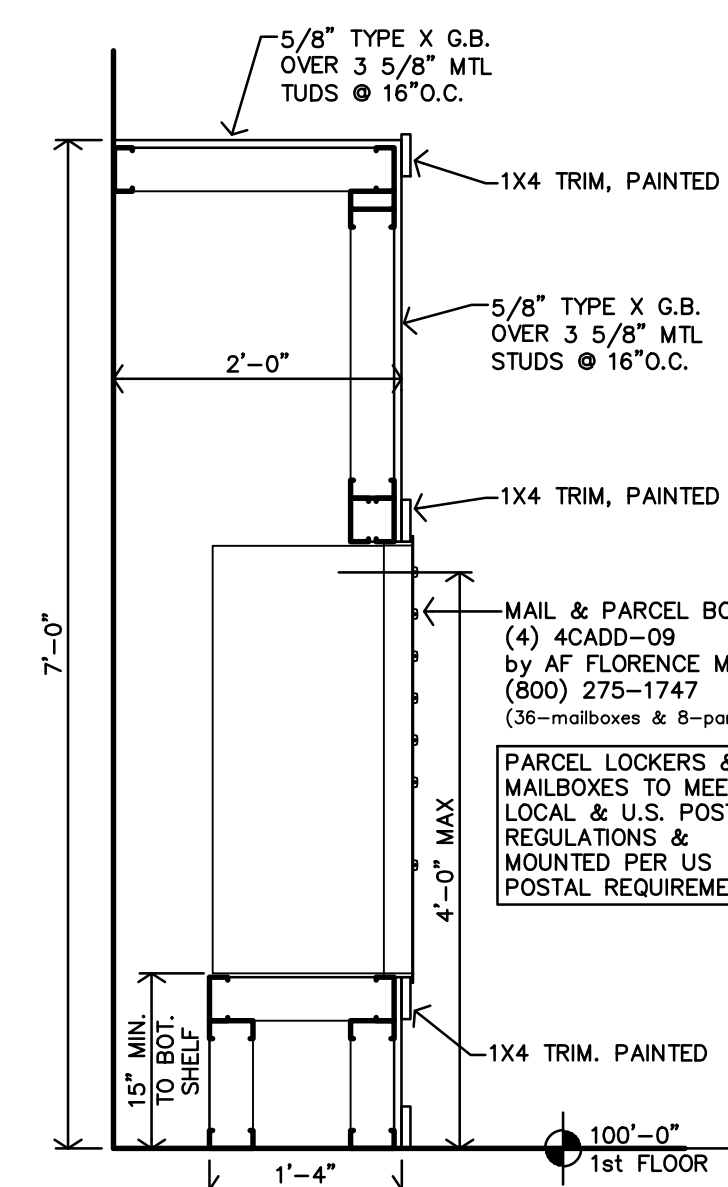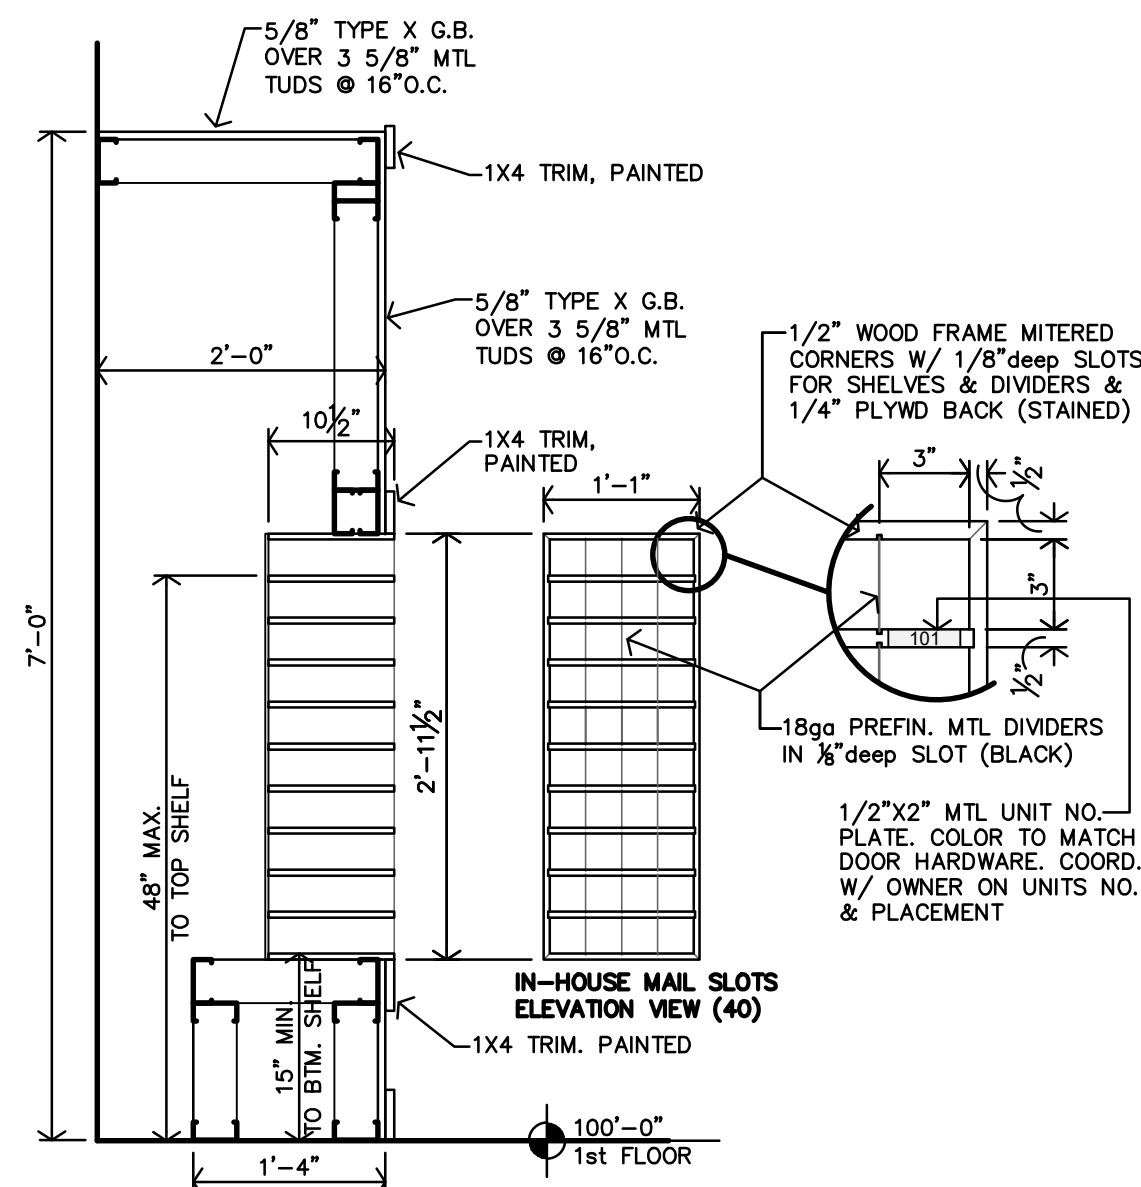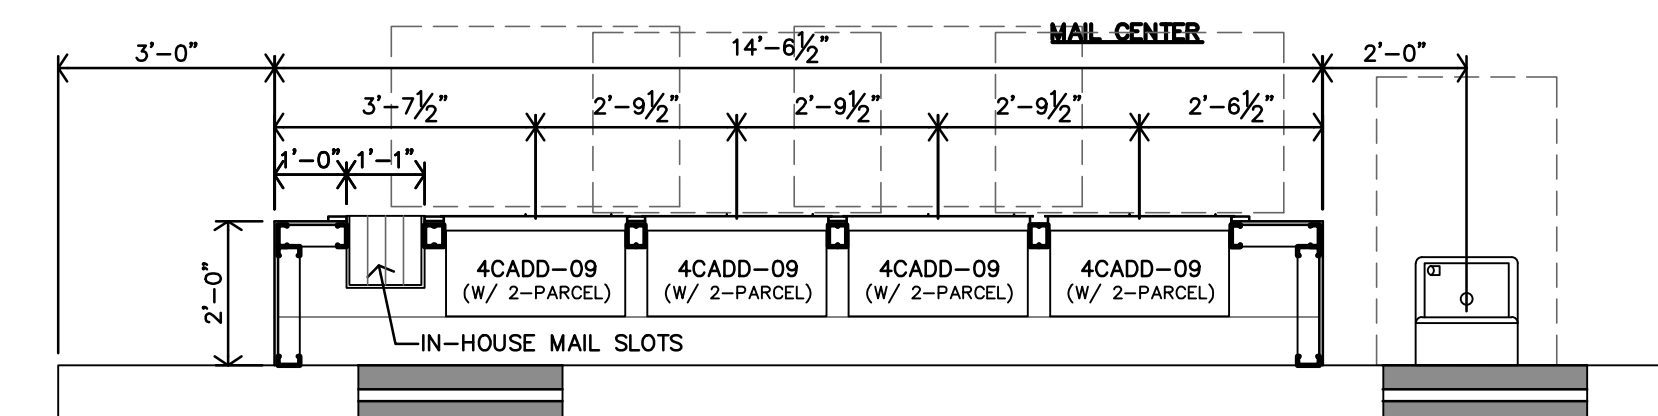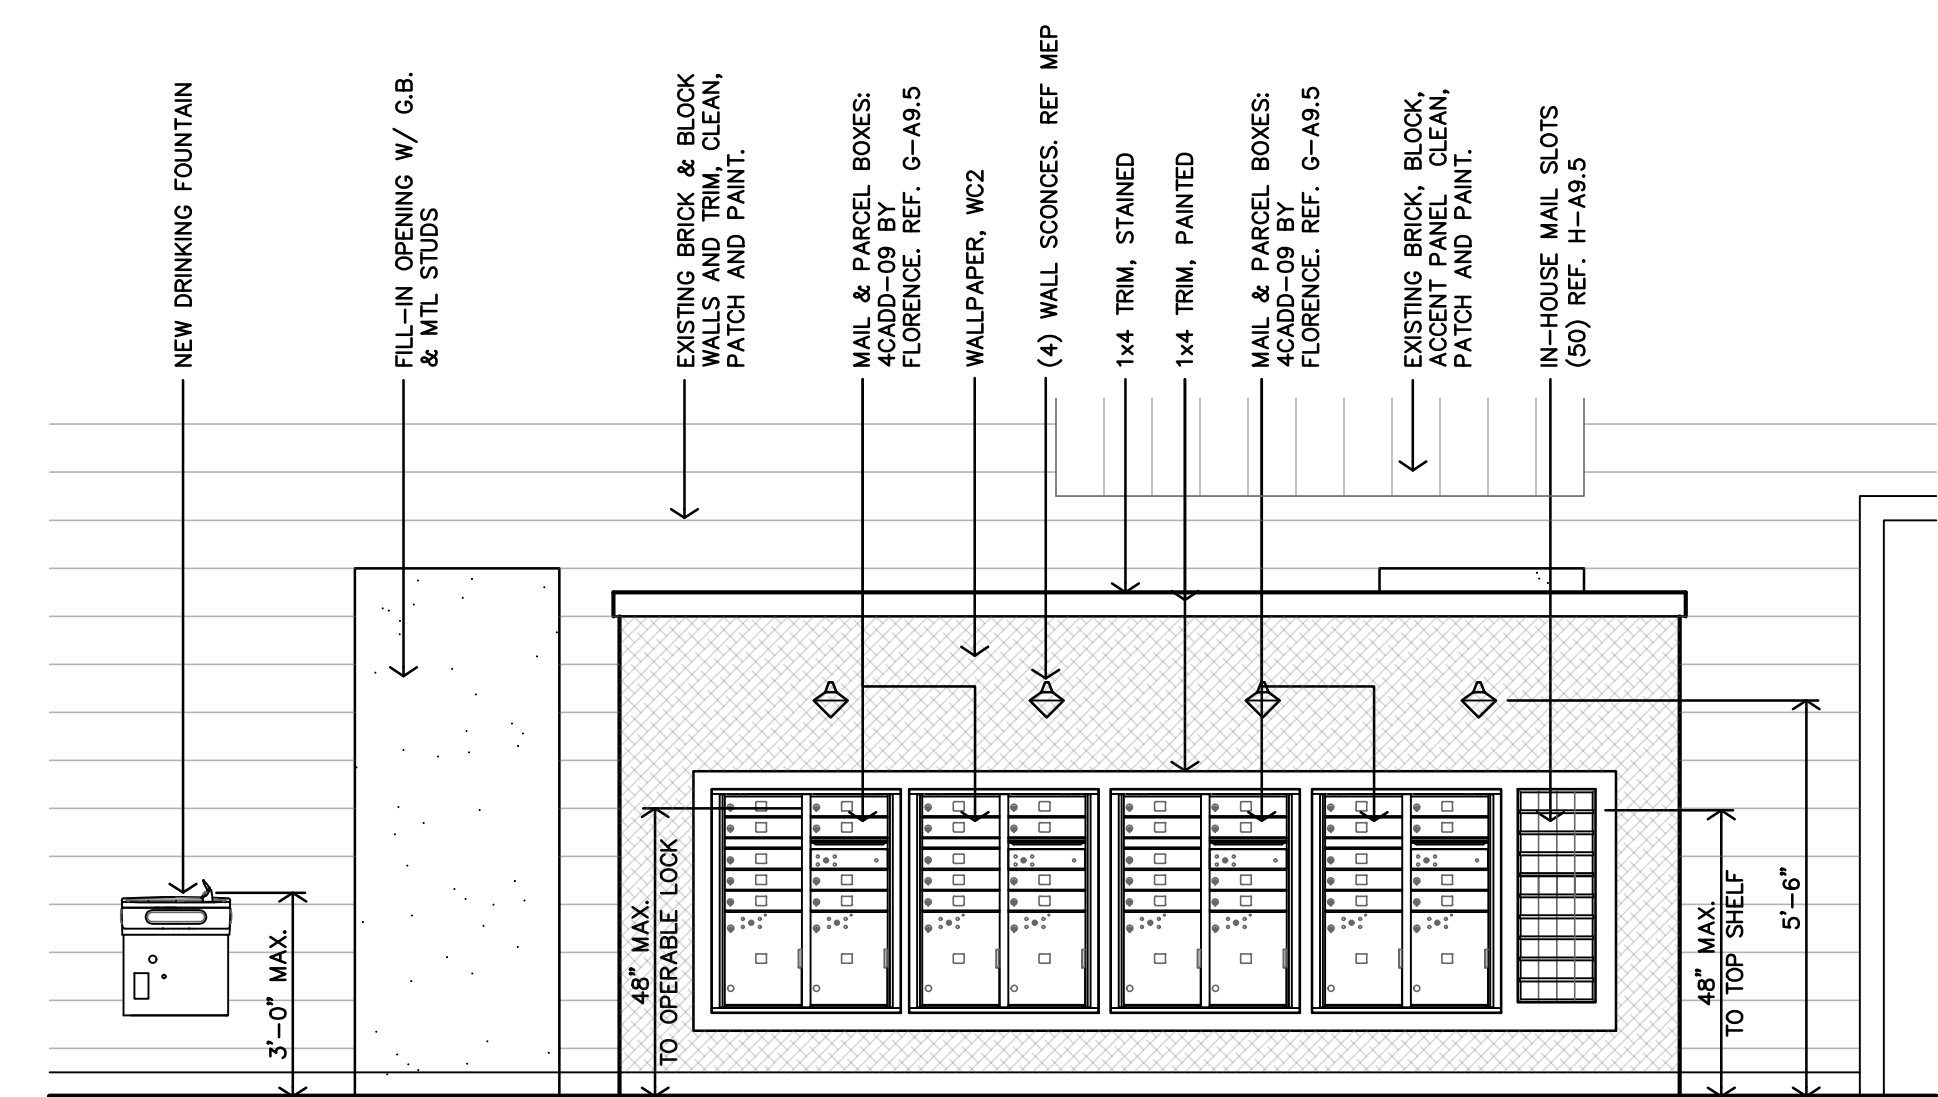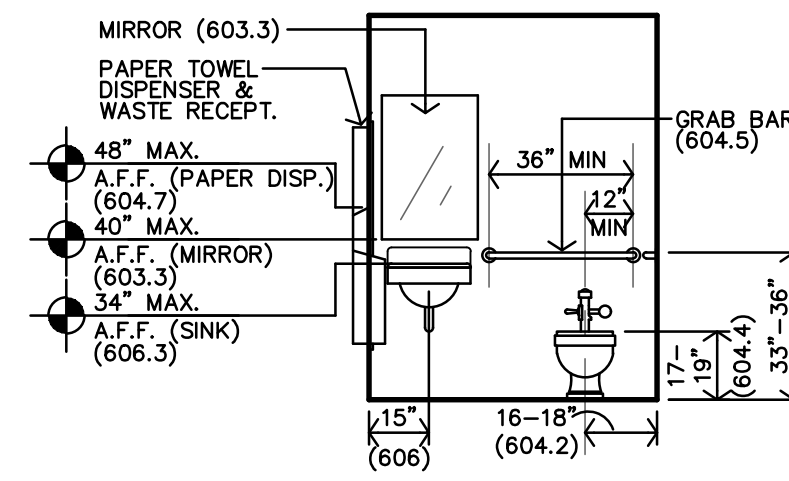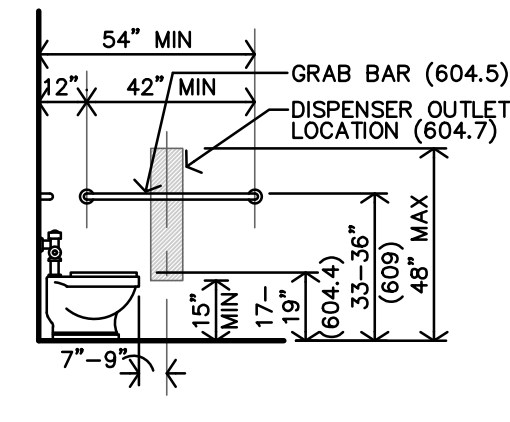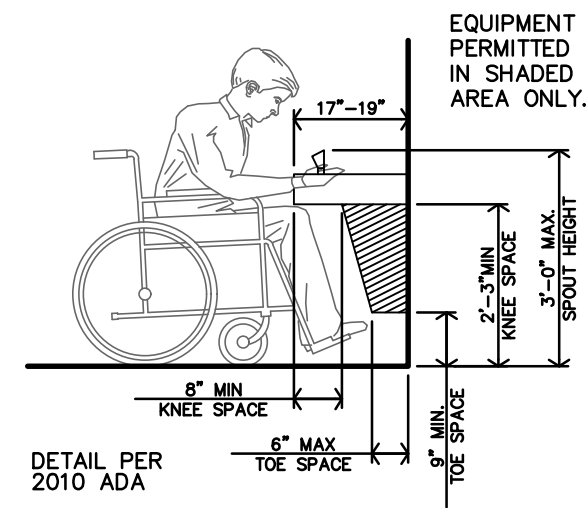

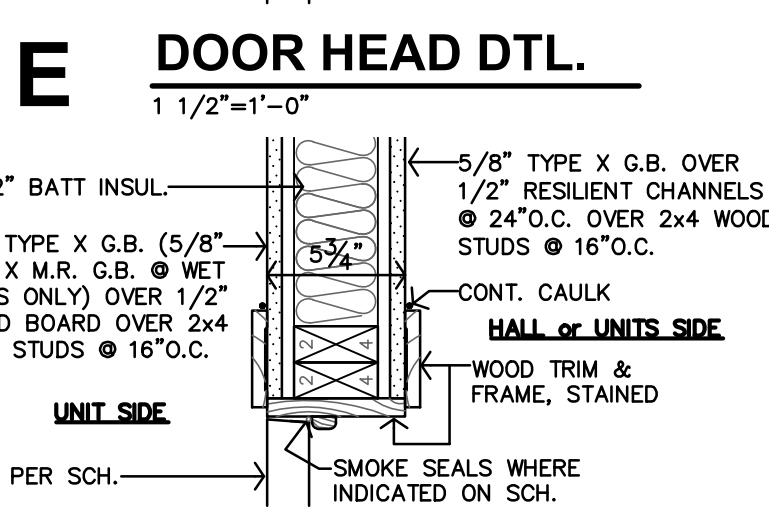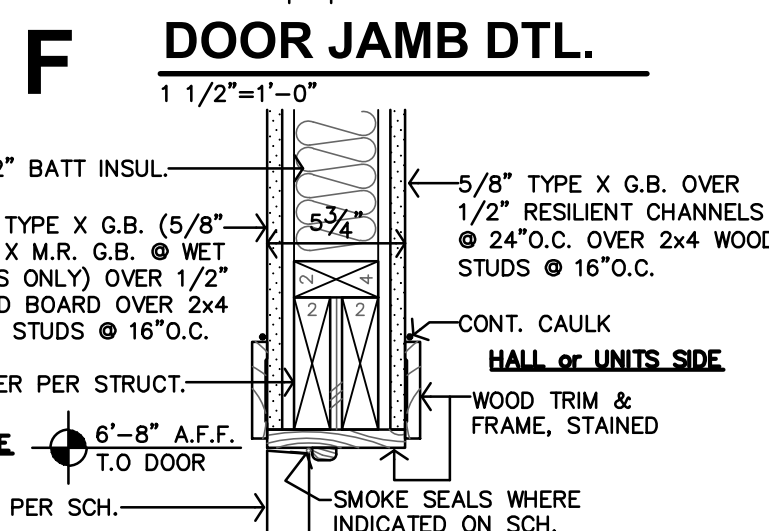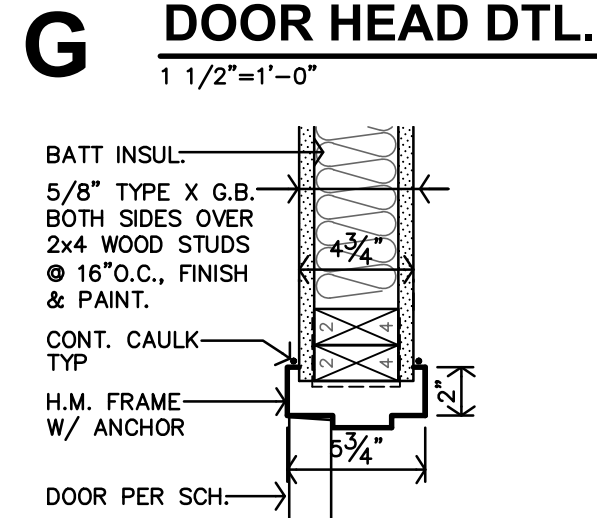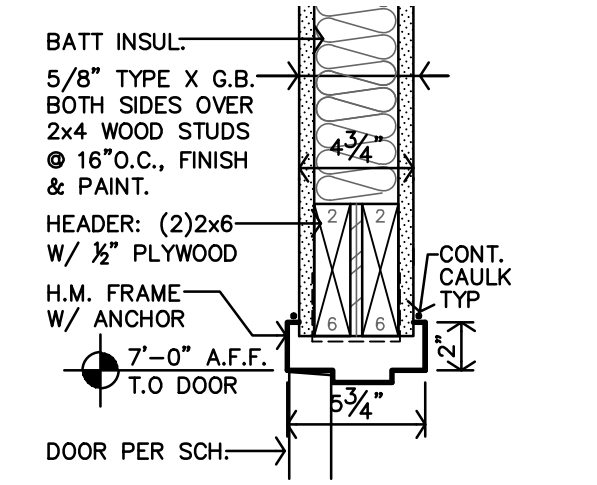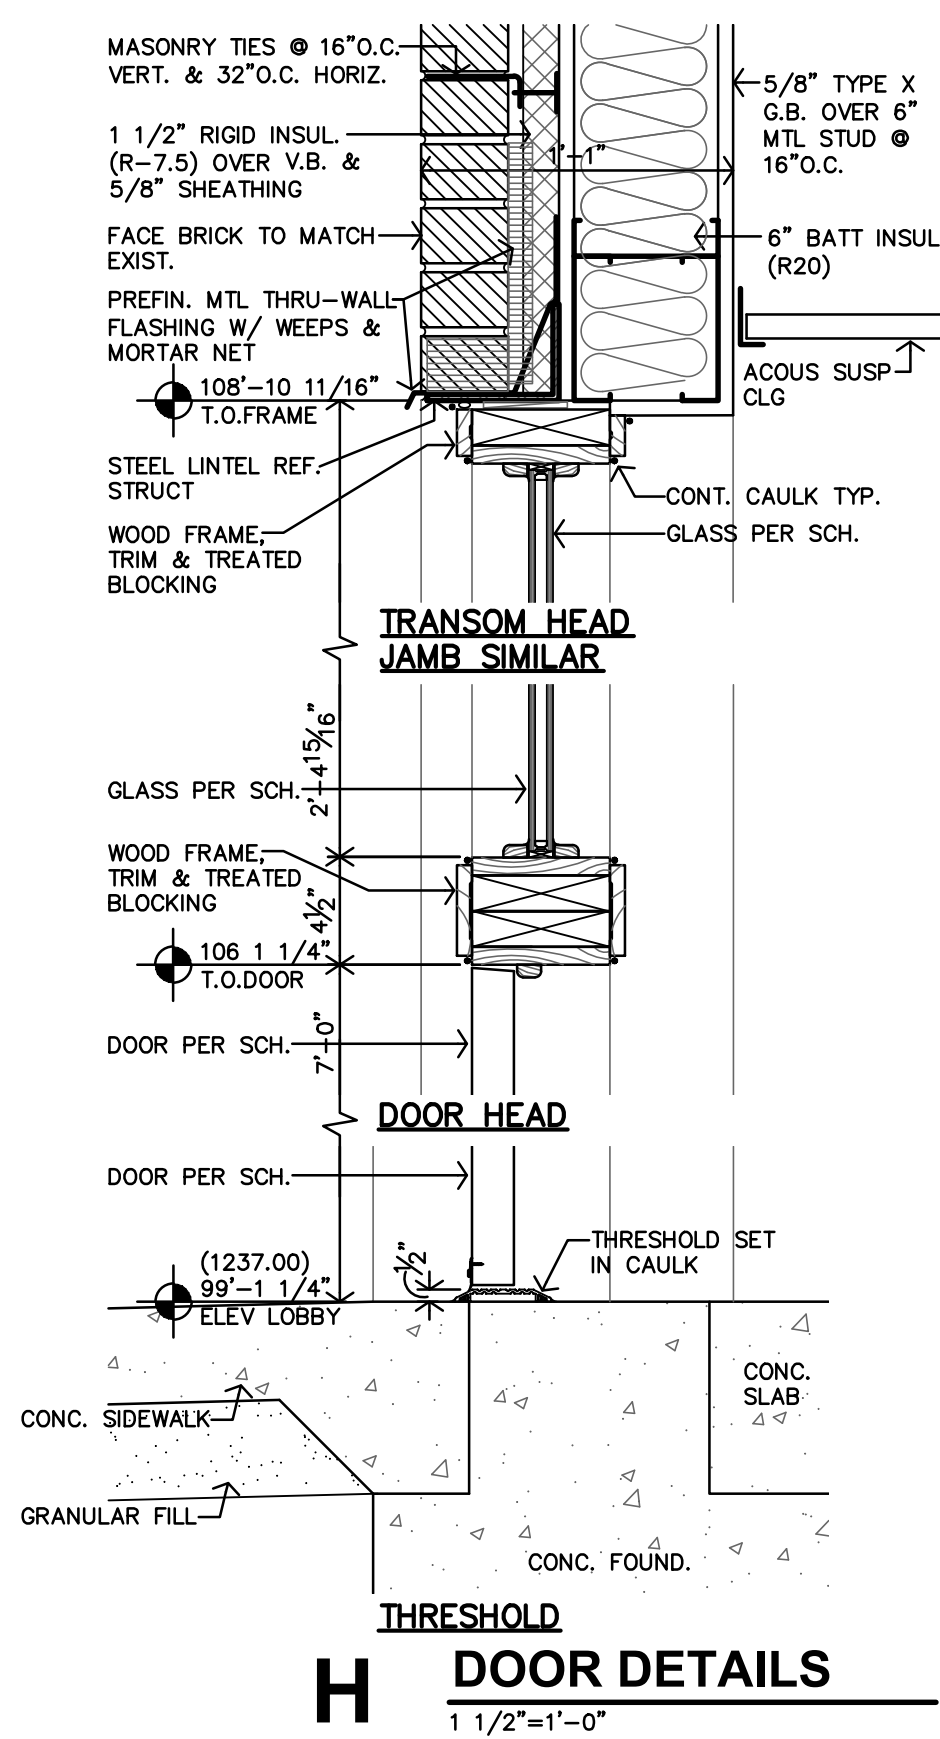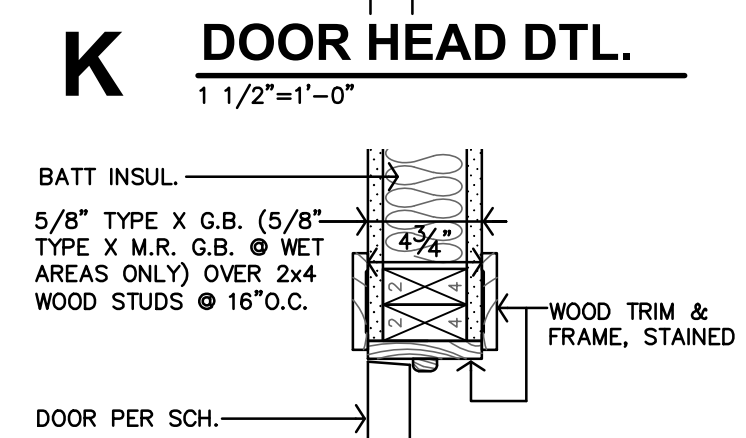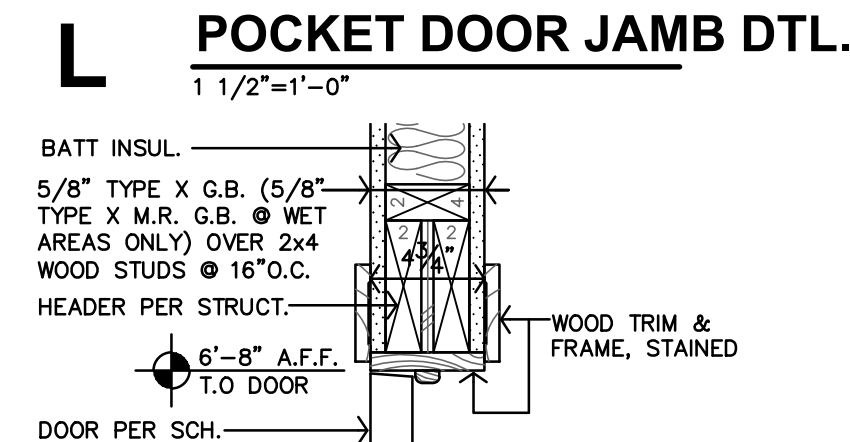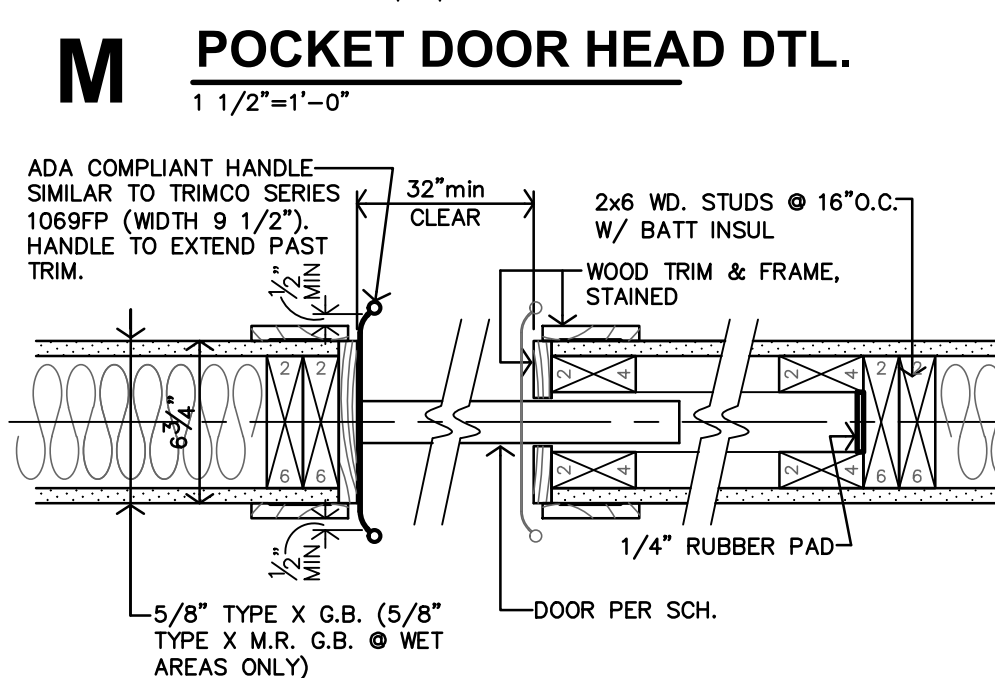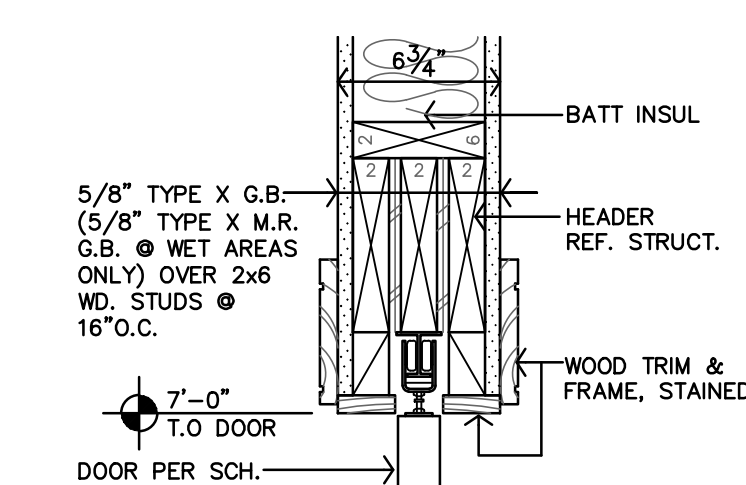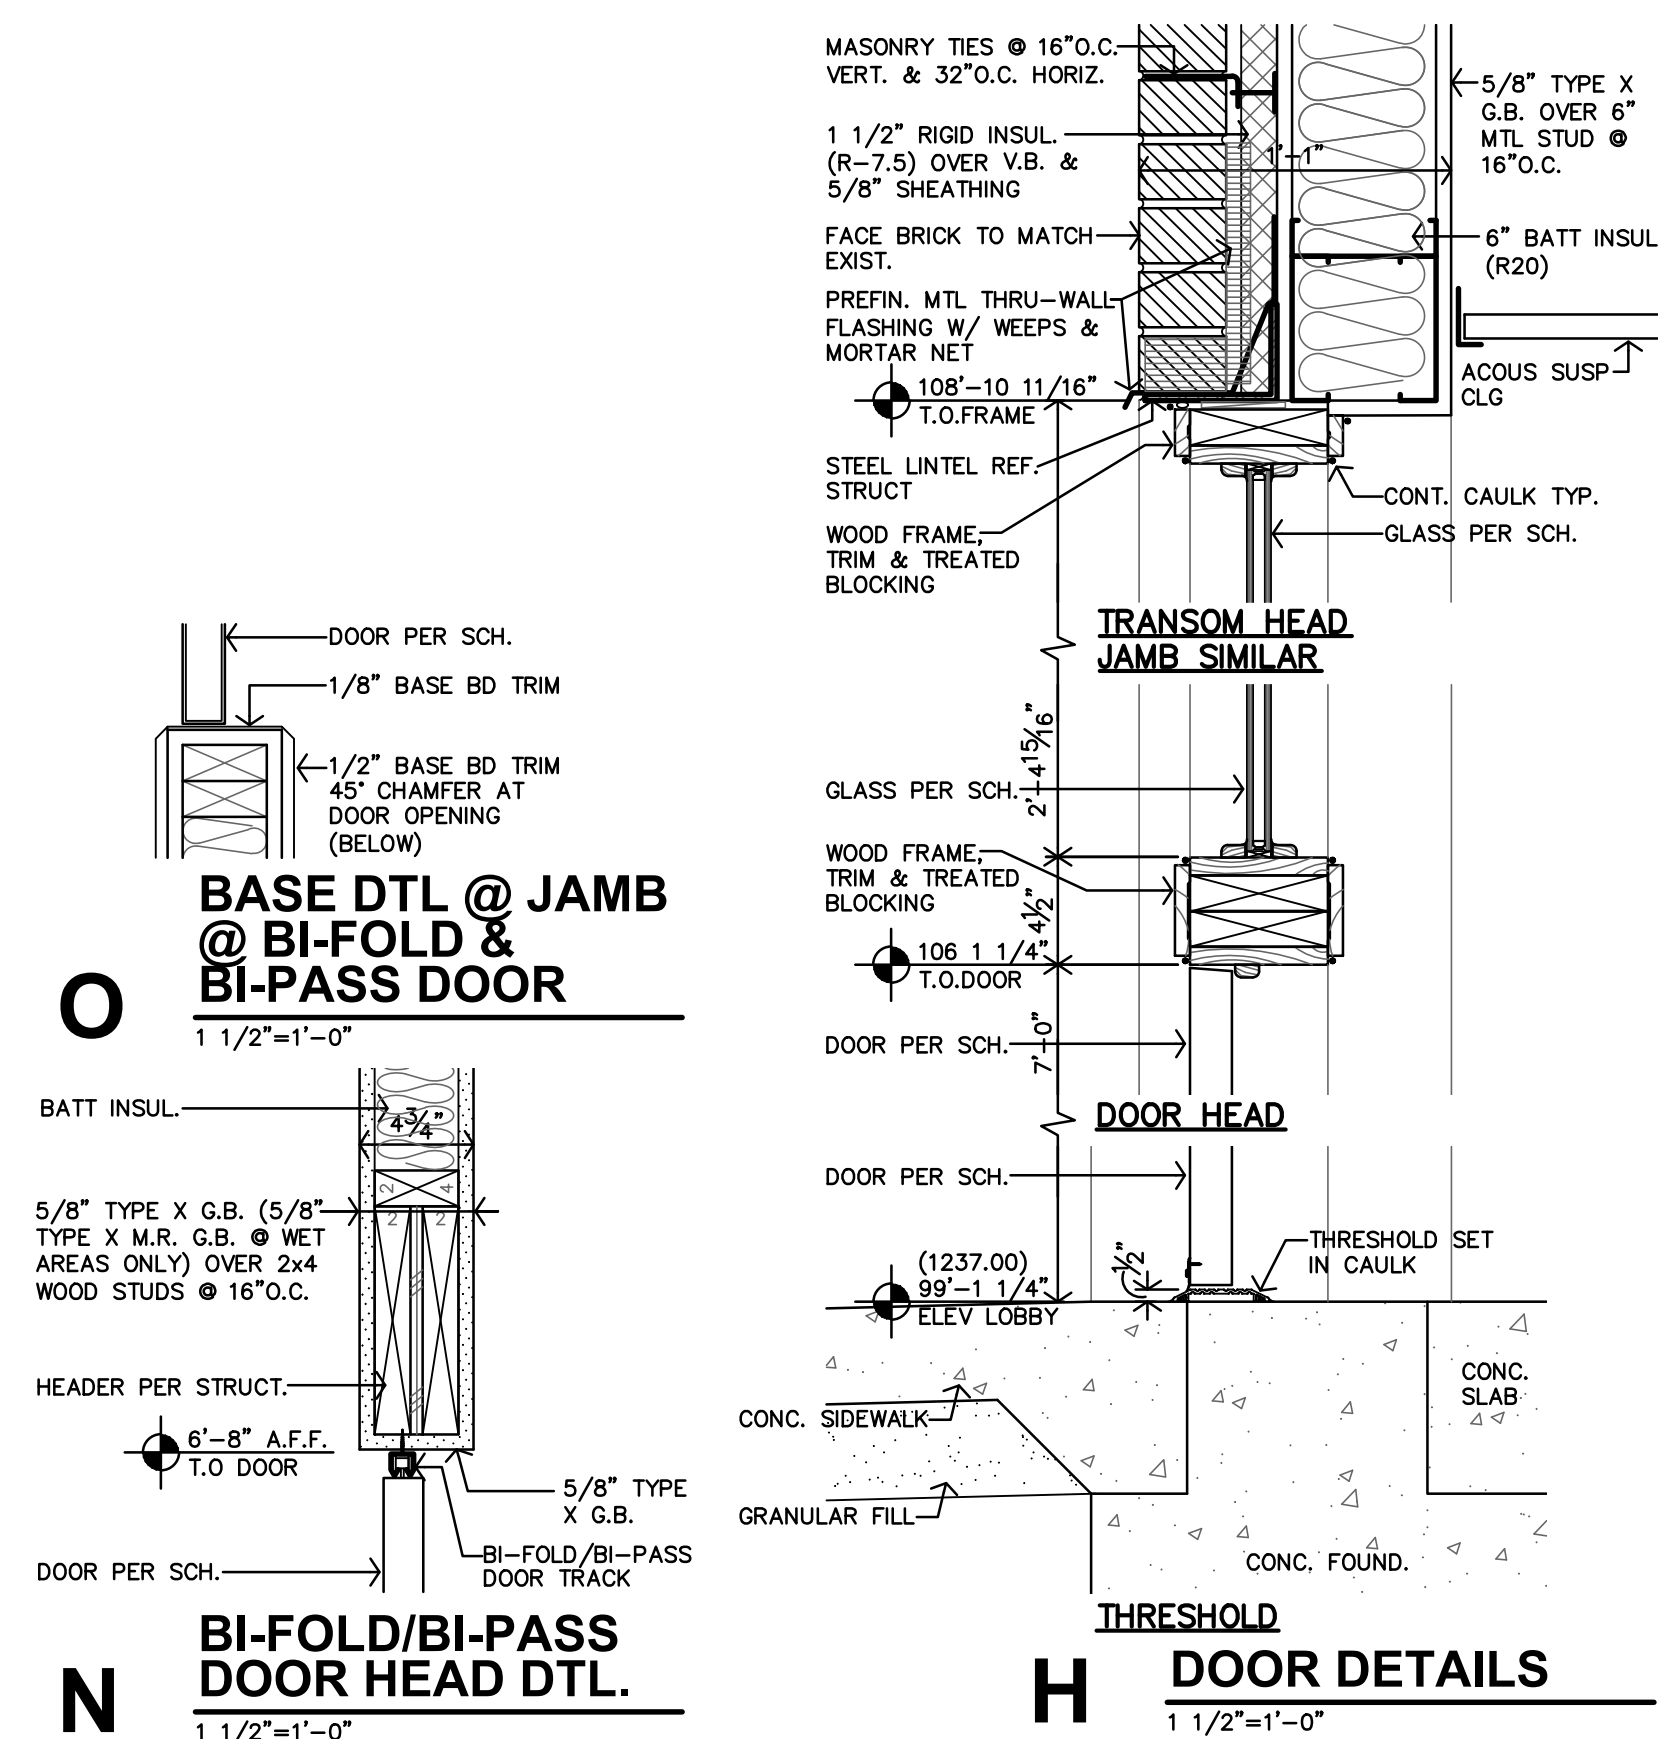

GLAZING SCHEDULE						
MARK	INTERIOR	EXTERIOR	1/4"	3/4" INSULATED	TINTED	TEMPERED
A1		●		●	●	●

BUILDING C - PUBLIC DOOR SCHEDULE																
MARK	DOOR								FRAME				RATING	DETAILS	REMARKS	
	SIZE				MATERIAL	TYPE	FINISH	MATERIAL	TYPE	FINISH						
	W	H	T		HOLLOW METAL S.C. WOOD	TYPE MATCH STR FINIT	PAINT	HOLLOW METAL WOOD	TYPE MATCH STR FINIT	PAINT						
FIRST FLOOR																
EX	EXISTING DOOR & FRAME F.V.				CLEAN, RESTORE, REFINISH (RE-SWING & REBUILD AS INDICATED)								NOTES 1,2,3,4,5,6			
C11	3'-0"	6'-8"	1 3/4"		●	C	●	●	●	1	●	●	20min	UNIT ENTRY: NOTES 7,8,11		
C12	3'-0"	6'-8"	1 3/4"		●	C	●	●	●	1	●	●	20min	UNIT ENTRY: NOTES 7,8,11		
C13	3'-0"	6'-8"	1 3/4"		●	C	●	●	●	1	●	●	20min	UNIT ENTRY: NOTES 7,8,11		
C14	3'-0"	6'-8"	1 3/4"		●	C	●	●	●	1	●	●	20min	UNIT ENTRY: NOTES 7,8,11		
C15	3'-0"	6'-8"	1 3/4"		●	C	●	●	●	1	●	●	20min	UNIT ENTRY: NOTES 7,8,11		
C16	3'-0"	6'-8"	1 3/4"		●	C	●	●	●	1	●	●	20min	UNIT ENTRY: NOTES 7,8,11		
C17	3'-0"	6'-8"	1 3/4"		●	C	●	●	●	1	●	●	20min	UNIT ENTRY: NOTES 7,8,11		
C18	3'-0"	6'-8"	1 3/4"		●	D	●	●	●	1	●	●	20min	UNIT ENTRY: NOTES 7,8,11		
C19	PR 3'-0"	6'-8"	1 3/4"		●	J	●	●	●	3	●	●		MATCH EXISTING STOREFRONT		
C20	3'-0"	6'-8"	1 3/4"		●	J	●	●	●	3	●	●	20min			
C21	3'-0"	6'-8"	1 3/4"		●	H	●	●	●	2	●	●		EXT. FS CL NOTES; 1,2,3,4,5,6		
C22	3'-0"	6'-8"	1 3/4"		●	H	●	●	●	1	●	●				
C23	3'-0"	6'-8"	1 3/4"		●	J	●	●	●	3	●	●				
C24	3'-0"	6'-8"	1 3/4"		●	H	●	●	●	1	●	●				
C25	3'-0"	6'-8"	1 3/4"		●	H	●	●	●	1	●	●				
NOTES:																
1. ALL EXPOSED LINTELS TO BE PAINTED AT INTERIOR AND EXTERIOR.																
2. CONTRACTOR MUST INSTALL MTL FLASHINGS & CONT. CAULK FOR A WEATHERTIGHT SEAL, AT ALL EXTERIOR DOORS & FRAMES.																
3. ALUMINUM THRESHOLD EXPANSION JOINT COVER BETWEEN CONCRETE AND WOOD FLOOR.																
4. RESTORE EXISTING DOOR & FRAME, INSTALL NEW HARDWARE, FIELD VERIFY CONDITIONS																
5. EXTERIOR DOORS, INSTALL NEW SIL & WEATHERSTRIPPING, FOR A WEATHERTIGHT SEAL, FIELD VERIFY CONDITIONS																
6. EXISTING DOOR, VERIFY NEW FINISHES AND COORDINATE, CUT AND FIT DOOR AS REQUIRED FOR PROPER OPERATION																
7. UNIT ENTRY DODGE -- HARDWARE TO BE LEVER TYPE LATCH SETS KEVED OUTSIDE, RELEASE INSIDE AND DEADBOLT W/ THUMB TURN INSIDE, NON-KEY OUTSIDE W/ 1" MIN THROW.																
8. UNIT ENTRY DOOR -- PEEP HOLES AT ADAPTABLE UNITS: (1) PEEP HOLE TO BE INSTALLED @ 60" AFF.																
9. UNIT ENTRY DOOR -- PEEP HOLES AT ACCESSIBLE UNITS: (2) PEEP HOLES TO BE INSTALLED @ 43" AFF & 60" AFF.																
10. EXISTING/NEW DOOR OPENING, FIELD VERIFY SIZE & CONDITIONS, REWORK, REPAIR, REFINISH, PROVIDE & INSTALL NEW: DOOR, TRIM, FRAME & HARDWARE AS REQ'D.																
11. UNIT ENTRY DOOR -- ADD SMOKE SEALS.																

BUILDING C - UNIT DOOR SCHEDULE - 8 UNITS															
MARK	LOCATION	DOOR						FRAME						DETAILS	REMARKS
		SIZE		MATERIAL	TYPE	FINISH		MATERIAL	TYPE	FINISH					
		W	H	T		S.C. WOOD PANEL	H.C. WOOD PANEL				S.C. WOOD LOUVER				
						BL-FOLD	BL-PASS				POCKET	PAINT	WOOD		
1	BEDROOM	3'-0"	6'-8"	1 3/4"	●	●	D	●	●	1	●	J/K-AA10.1	NOTES 1		
2	CLOSET	PR 3'-0"	6'-8"	1 3/4"	●	●	F	●	●	1	●	L/M-AA10.1	NOTES 3,4		
3	BATHROOM	3'-0"	6'-8"	1 3/4"	●	●	D	●	●	1	●	J/K-AA10.1	NOTES 1		
4	MECH	3'-0"	6'-8"	1 3/4"	●	●	D	●	●	1	●	J/K-AA10.1			
5	CLOSET	3'-0"	6'-8"	1 3/4"	●	●	D	●	●	1	●	J/K-AA10.1			
6	LAUNDRY	PR 2'-8"	6'-8"	1 3/4"	●	●	G	●	●	1	●	N/O-AA10.1	NOTES 3,4		

GENERAL NOTES:

A. ALL DOOR HARDWARE SHALL BE LEVER TYPE LATCH SETS UNLESS NOTED OTHERWISE PROVIDED & INSTALLED PER SPECIFICATIONS SECTION 8710

B. COORDINATE W/ MFR. FOR ADA INSTALLATION REQUIREMENTS. COORDINATE KEYING REQUIREMENTS WITH OWNER.

C. UNDERDOOR DOORS PER MECH DWGS.

D. CONTRACTOR TO REVIEW AND ENSURE THE FOLLOWING ITEMS AND STATUTES HAVE BEEN MET AS WELL

<http://codes.tn.tnlaw.com/tatstatute/PR/8/92/D/92-153>

SPECIFIC NOTES:

1. BEDROOM & BATH DOOR – HARDWARE TO BE PRIVACY LEVER TYPE LATCH SET.

2. POCKET DOOR – 32" MIN CLEAR OPENING, W/ ADA COMPLIANT HANDLE SIMILAR TO TRIMCO SPEC 1069.




3. BL-PASS/BL-FOLD DOORS – VERIFY OPENING W/ SIZE OF DOOR HARDWARE.

4. FINISHED D.B AT DOOR OPENING. NO FRAME.

5. HISTORIC DOOR FRAME TO REMAIN. CLEAN, SAND, REPAIR AS NEEDED. REPAINT. REPLACE ALL GLASS WITH NEW GLASS (FROSTED GLASS AT ALL UNIT ENTRIES). VERIFY THICKNESS OF EXISTING GLASS/FRAME.

6. NEW PAIR OF DOORS, ONE DOOR PANEL TO BE OPERABLE AND 3'-0" WIDE, OTHER DOOR PANEL TO BE PERMANENTLY FIXED, WIDTH MAY VARY BASED ON SIZE OF EXISTING OPENING. CONTRACTOR TO FIELD VERIFY.

7. NO PEEPHOLE AT BEDROOM DOOR.

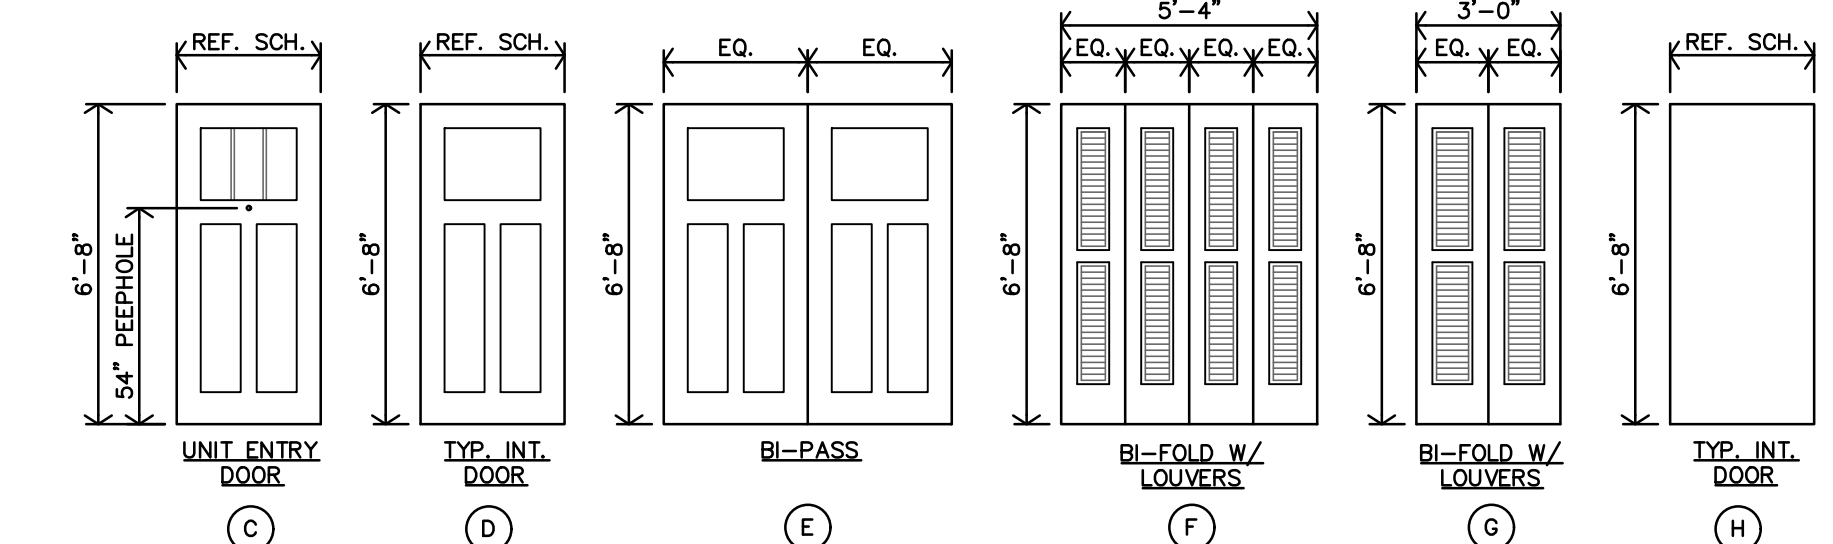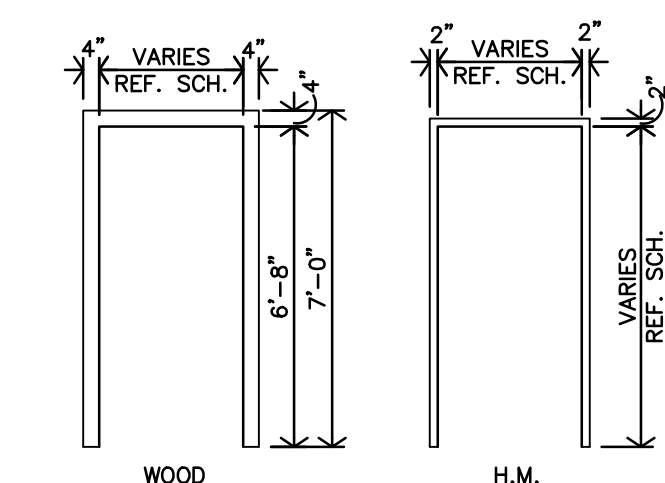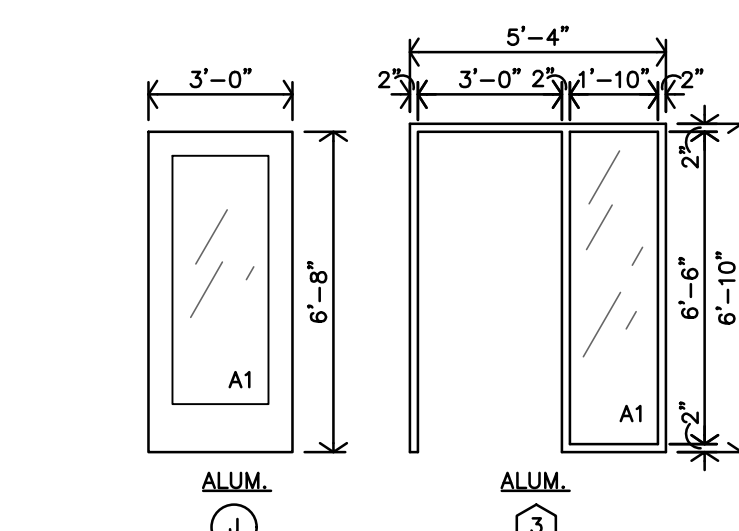



REVISION:

DATE: 11-20-2025

JOB: 25-3479

SHEET NO.:

A10.4

COPYRIGHTED ©

BUILDINGS A/B/C - WINDOW SCHEDULE

BUILDING	MARK	WIDTH	HEIGHT	STYLE	QUANTITY	INTERIOR	EXTERIOR	NOTES
A	A1	2'-11"	8'-3"	NEW - SINGLE HUNG, ALUM	9		●	
A	A2	3'-8"	8'-3"	NEW - SINGLE HUNG, ALUM	25		●	TOTAL WIDTH 21'-3" (4" MULLS)
A	A3	3'-3"	8'-3"	NEW - SINGLE HUNG, ALUM	7		●	TOT. WIDTH 10'-11" (4" MULLS)"
A	B1	2'-11"	8'-10"	NEW - SINGLE HUNG, ALUM	5		●	
A	B2	3'-8"	8'-10"	NEW - SINGLE HUNG, ALUM	25		●	TOTAL WIDTH 21'-3" (4" MULLS)
A	B3	3'-3"	8'-10"	NEW - SINGLE HUNG, ALUM	5		●	TOT. WIDTH 10'-11" (4" MULLS)"
A	C1	2'-11"	6'-4"	NEW - SINGLE HUNG, ALUM	4		●	
A	C2	3'-8"	6'-4"	NEW - SINGLE HUNG, ALUM	15		●	TOT. WIDTH 21'-3" (4" MULLS)
A	C3	3'-3"	6'-4"	NEW - SINGLE HUNG, ALUM	3		●	TOT. WIDTH 10'-11" (4" MULLS)"
A	C4	2'-11"	4'-1"	NEW - SINGLE HUNG, ALUM	2		●	
A	D1	3'-1"	4'-7"	NEW - SINGLE HUNG, ALUM	8		●	
A	D2	2'-11"	6'-4"	NEW - SINGLE HUNG, ALUM	6		●	
A	D3	3'-4"	4'-5"	NEW - SINGLE HUNG, ALUM	4		●	TOT. WIDTH 7'-0" (4" MULLS)"
A	E1	11'-10"	9'-5"	EXISTING - SINGLE HUNG, STEEL	2		●	
A	E2	3'-3"	4'-3"	EXISTING - SINGLE HUNG, ALUM	2		●	
C	E3	2'-9"	7'-0"	EXISTING - SINGLE HUNG, ALUM	15		●	
B	E4	3'-3"	4'-3"	EXISTING - SINGLE HUNG, ALUM	11		●	
A	F1	3'-4"	4'-6"	NEW - SINGLE HUNG, ALUM	6		●	
B	F2	3'-4"	3'-9"	NEW - SINGLE HUNG, ALUM	5		●	
C	F3	2'-9"	7'-0"	NEW - SINGLE HUNG, ALUM	1		●	
A	F4	4'-2"F.V.		NEW - FIXED ALUM	1		●	

- NOTES:
- CONTRACTOR MUST INSTALL MTL. FLASHINGS & CONT. CAULK FOR A WEATHER & WATERTIGHT CONDITIONS @ ALL EXTERIOR WINDOW UNITS.
 - CONTRACTOR TO INSTALL NEW LIQUID-APPLIED MEMBRANE AT EACH WINDOW OPENING. REFERENCE SPECIFICATIONS.
 - CONTRACTOR MUST INSTALL 1/4" INSUL. OR THERMAL BREAK. CONTINUOUS AROUND NEW WINDOWS.
 - CONTRACTOR TO PROVIDE & INSTALL MANUFACTURERS COORDINATING PANNING SYSTEM FOR ALUM. WINDOWS.
 - CONTRACTOR MUST FIELD VERIFY ALL OPENING SIZES & EXISTING WINDOW FRAME SIZES & COORDINATE W/ NEW WINDOWS
 - ALL NEW WINDOWS ARE TO HAVE CLEAR GLAZING AND SHALL MEET THE 2021 IECC REQUIREMENTS. REFERENCE SPECIFICATIONS.

HISTORIC PRESERVATION NOTES


WINDOWS

FENESTRATION ON THE 1915 WING IS REGULAR. NON-HISTORIC ALUMINUM-FRAME WINDOWS FILL THE OPENINGS; WHICH WERE INSTALLED AT AN UNKNOWN DATE. HISTORIC PHOTOGRAPHS INDICATE THAT ORIGINAL WINDOWS WERE MULTI-LIGHT, HUNG, WOOD-FRAME UNITS THAT COMPLETELY FILLED THE WINDOW OPENINGS


- EXISTING WINDOWS MAY REMAIN & BE REPAIRED.
- IF WINDOWS ARE TO BE REPLACED, THESE SHOULD REPLICATE THE ORIGINAL, MULTI-LIGHT HUNG WINDOWS. NEW WINDOWS CAN BE WOOD, CLAD-WOOD, OR ALUMINUM. IF ALUMINUM, THEY SHOULD HAVE A PAINT-LIKE OR BAKED-LIKE FINISH. INTERIOR STORM WINDOWS ARE ANOTHER OPTION TO IMPROVE EFFICIENCY. IF WINDOWS ARE DEMONSTRABLY DETERIORATED BEYOND REPAIR, THEY MAY BE REPLACED W/ NEW WINDOWS PROVIDED THAT THE NEW WINDOWS MATCH EXISTING EXACTLY IN CONFIGURATION, DIMENSION, PROFILE, & PLACEMENT. NEW WINDOWS CAN BE ALUMINUM OR STEEL. WINDOWS DO NOT NEED TO BE OPERABLE BUT NEED TO HAVE AN OFFSET UPPER SASH SO THAT THEY MIMIC THE HUNG WINDOW CONFIGURATION OF HISTORIC. GLASS IN NEW WINDOWS MUST BE CLEAR, COLORLESS, & NON-REFLECTIVE W/ NO LESS THAN 69% VLT & NO GREATER THAN 11% VLR.

THE 1952 CAFETERIUM ADDITION RETAINS ITS ORIGINAL METAL WINDOWS W/ OPERABLE AWNING SASHES & NARROW HORIZONTAL MUNTINS. WINDOWS APPEAR TO BE IN FAIR CONDITION.


- ENERGY EFFICIENCY OF THE EXISTING WINDOWS CAN BE IMPROVED W/ SOLAR FILMS PROVIDED VLT IS NO LESS THAN 69% & VLR IS NO GREATER THAN 11%. INTERIOR STORM WINDOWS ARE ANOTHER OPTION TO IMPROVE EFFICIENCY. IF WINDOWS ARE DEMONSTRABLY DETERIORATED BEYOND REPAIR, THEY MAY BE REPLACED W/ NEW WINDOWS PROVIDED THAT THE NEW WINDOWS MATCH EXISTING EXACTLY IN CONFIGURATION, DIMENSION, PROFILE, & PLACEMENT. NEW WINDOWS CAN BE ALUMINUM OR STEEL. WINDOWS DO NOT NEED TO BE OPERABLE BUT THICKER MULLIONS SHOULD REPRESENT THE LOCATION OF OPERABLE SASHES. WINDOWS CAN BE TRUE DIVIDED OR SIMULATED DIVIDED; IF SIMULATED, THERE SHOULD BE BOTH EXTERIOR & INTERIOR MUNTIN GRIDS. IF INSULATED, THERE SHOULD BE A SPACER BAR BETWEEN PANES OF GLASS. GLASS MUST BE CLEAR, COLORLESS, & NON-REFLECTIVE W/ NO LESS THAN 69% VLT & NO GREATER THAN 11% VLR.

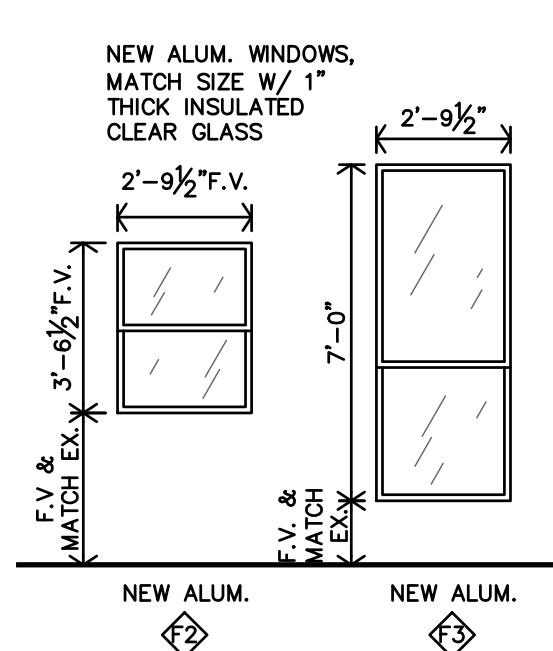


E BUILDINGS B/C - NEW WINDOWS
1/4"=1'-0"

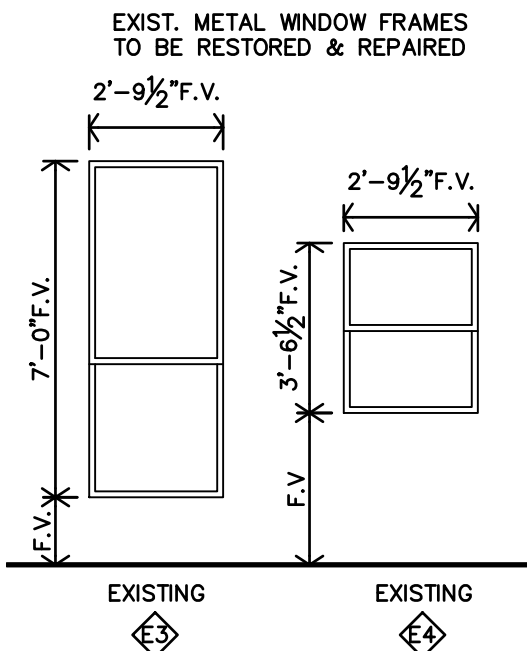


D BUILDINGS B/C - 1981 CLASSROOMS
1/4"=1'-0"

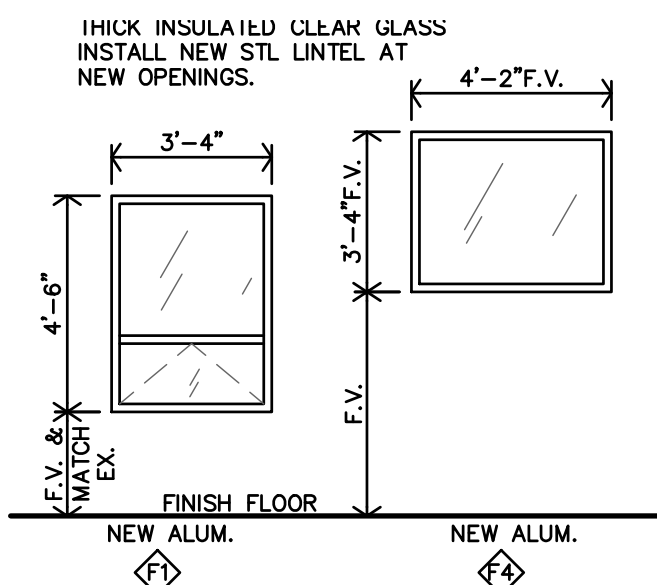

B BUILDING A - NEW WINDOWS
1/4"=1'-0"

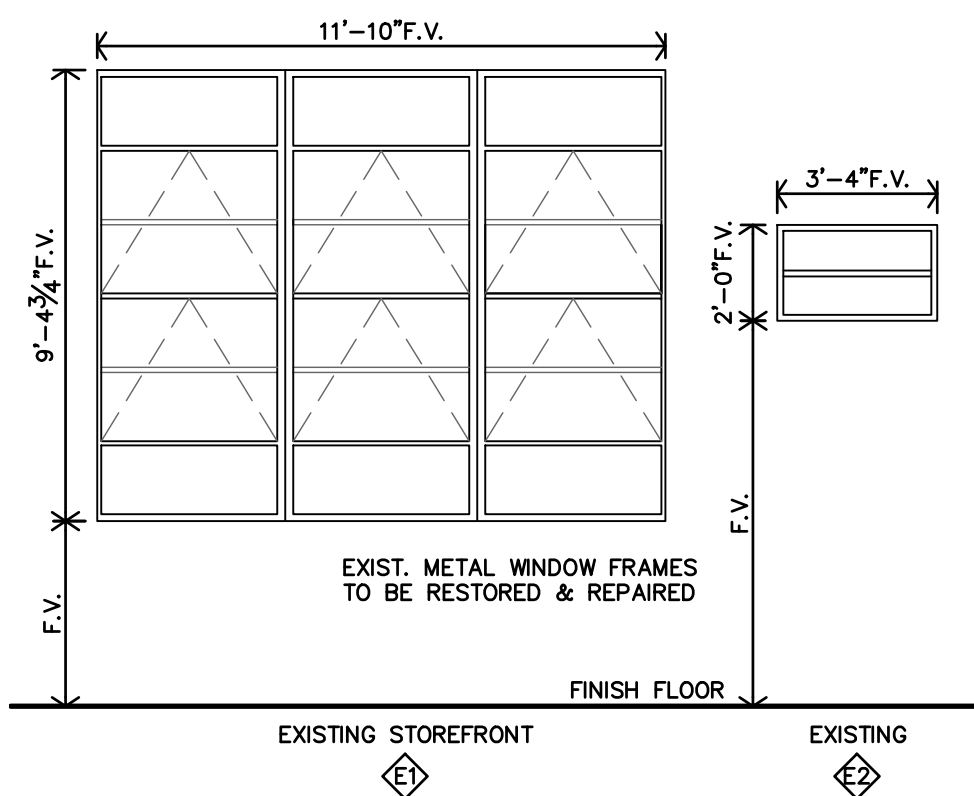

C BUILDING A - 1952 HISTORIC CAFETERIA
1/4"=1'-0"

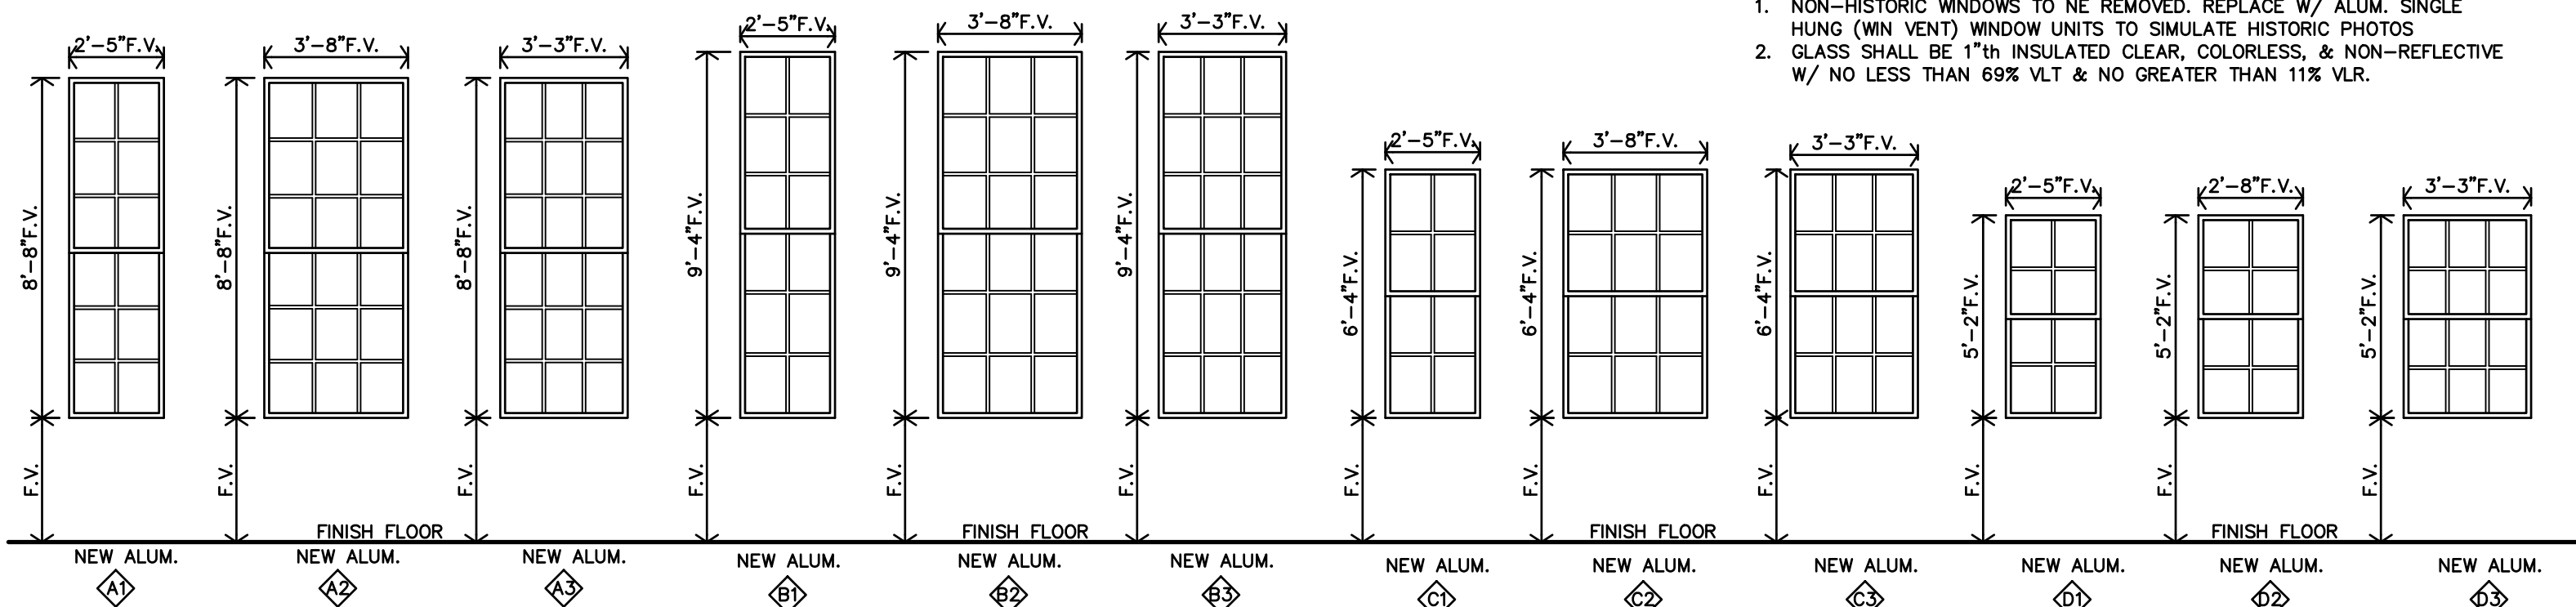










A BUILDING A - 1915 HISTORIC SCHOOL BUILDING
1/4"=1'-0"

- 1981 CLASSROOMS
- EXISTING WINDOWS ARE NON-HISTORIC SINGLE HUNG, TO BE REPAIRED AS NEEDED, CLEANED AND RESTORED TO OPERATING ORDER. EXISTING GLASS TO REMAIN.
 - NEW WINDOWS TO BE INSTALLED, USING WINVENT 2000 SINGLE HUNG SERIES.
 - GLASS SHALL BE 1"th. INSULATED. COLOR TO MATCH EXISTING.

- 1952 CAFETERIA ADDITION
- EXISTING WINDOWS ARE HISTORIC, ORIGINAL STEEL FRAMES, W/ OPERABLE AWNING SASHES & NARROW HORIZONTAL MUNTINS. THESE FRAMES WILL BE REPAIRED AS NEEDED, RESTORED TO FULL OPERATION & REFINISHED/PAINTED. NEW GLASS WILL BE INSTALLED. REFERENCE SPECIFICATIONS FOR PRESERVATION BRIEFS ON THE RESTORATION OF STEEL FRAMES.

- 1981 CAFETERIA ADDITION
- NEW WINDOWS TO BE INSTALLED ON THE EAST & SIMULATE THE EXISTING WINDOWS, USING WINVENT 900 PROJECTED & FIXED SERIES.

ALL NEW GLASS SHALL BE 1"th INSULATED CLEAR, COLORLESS, & NON-REFLECTIVE W/ NO LESS THAN 69% VLT & NO GREATER THAN 11% VLR.

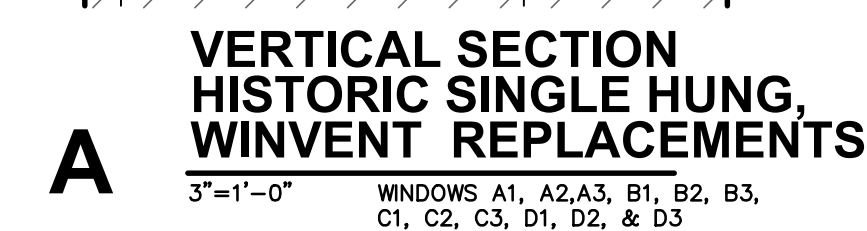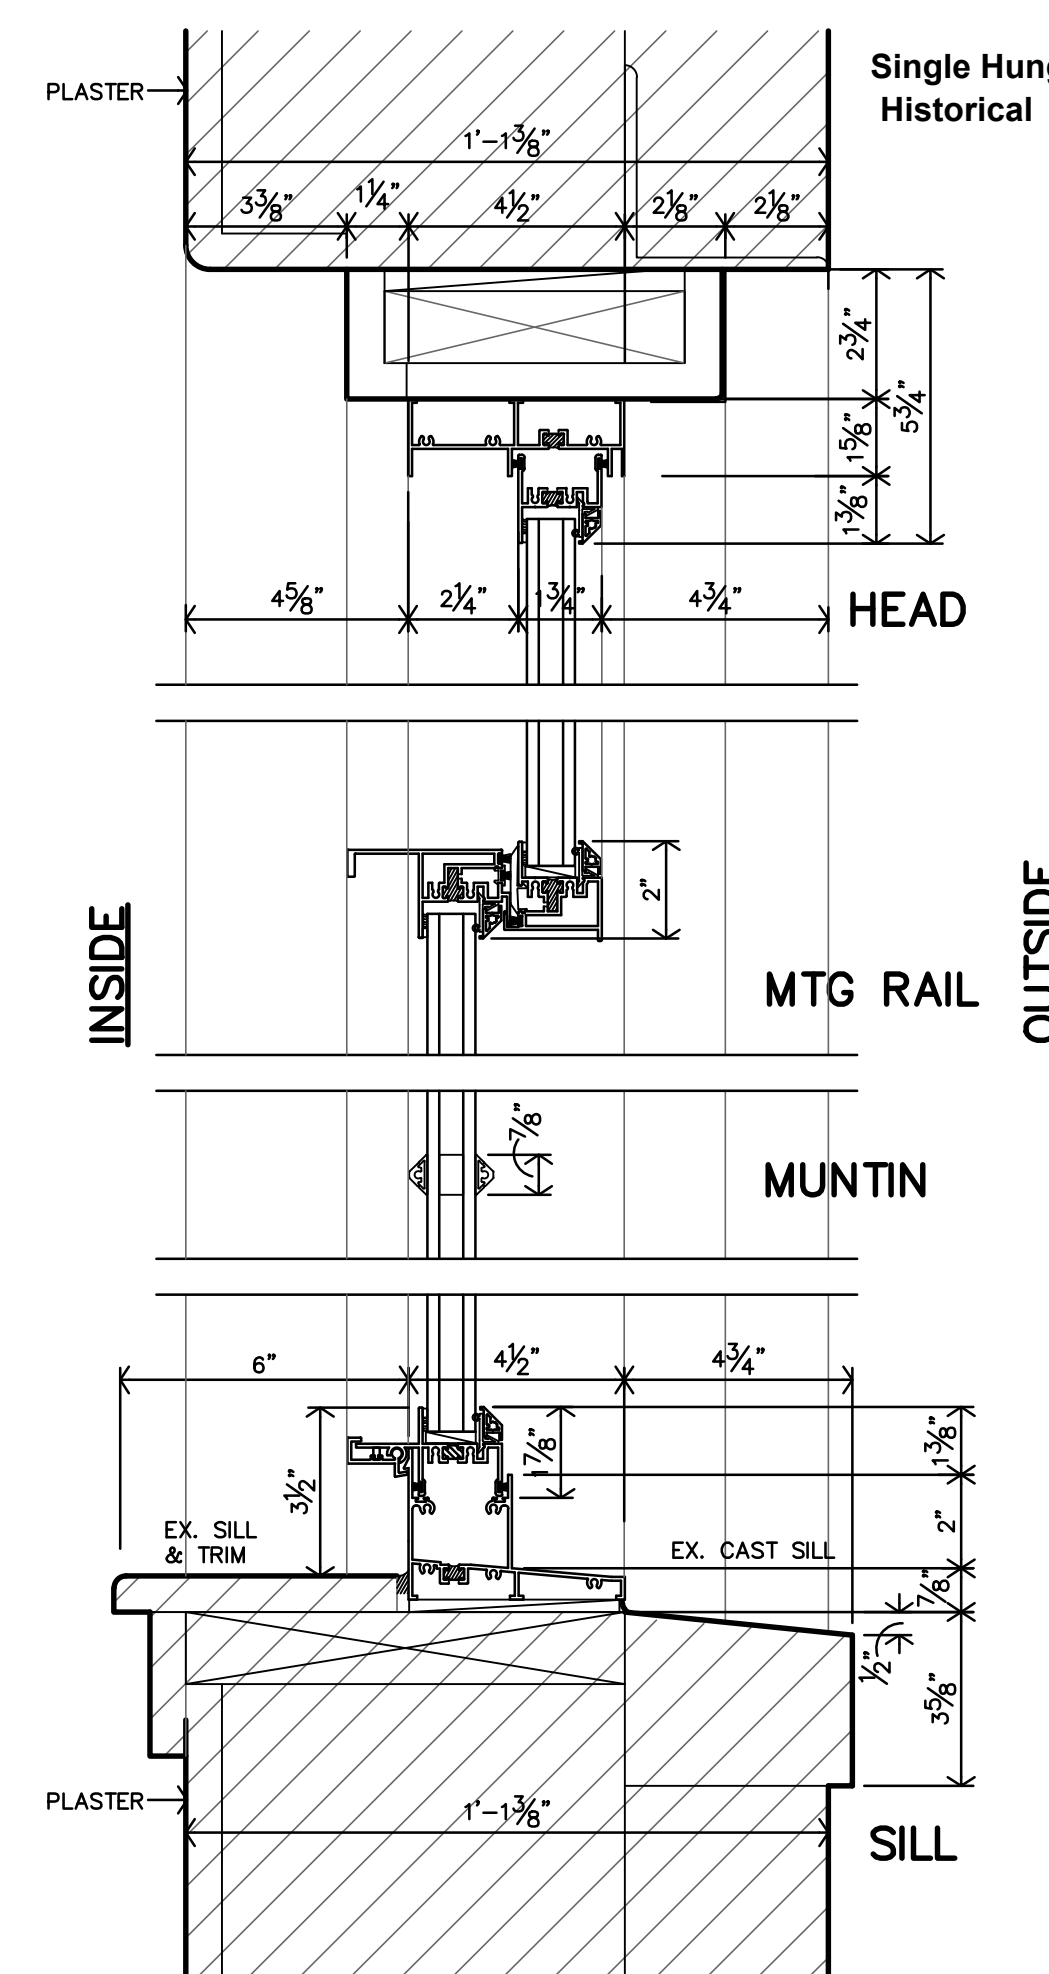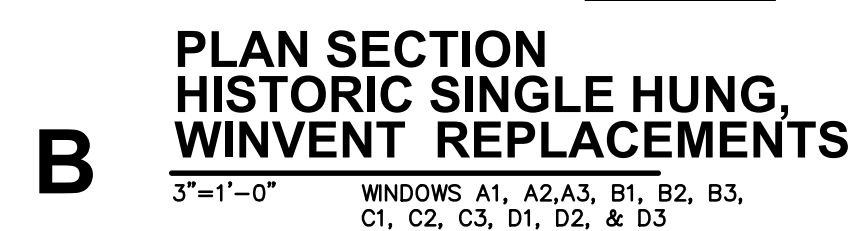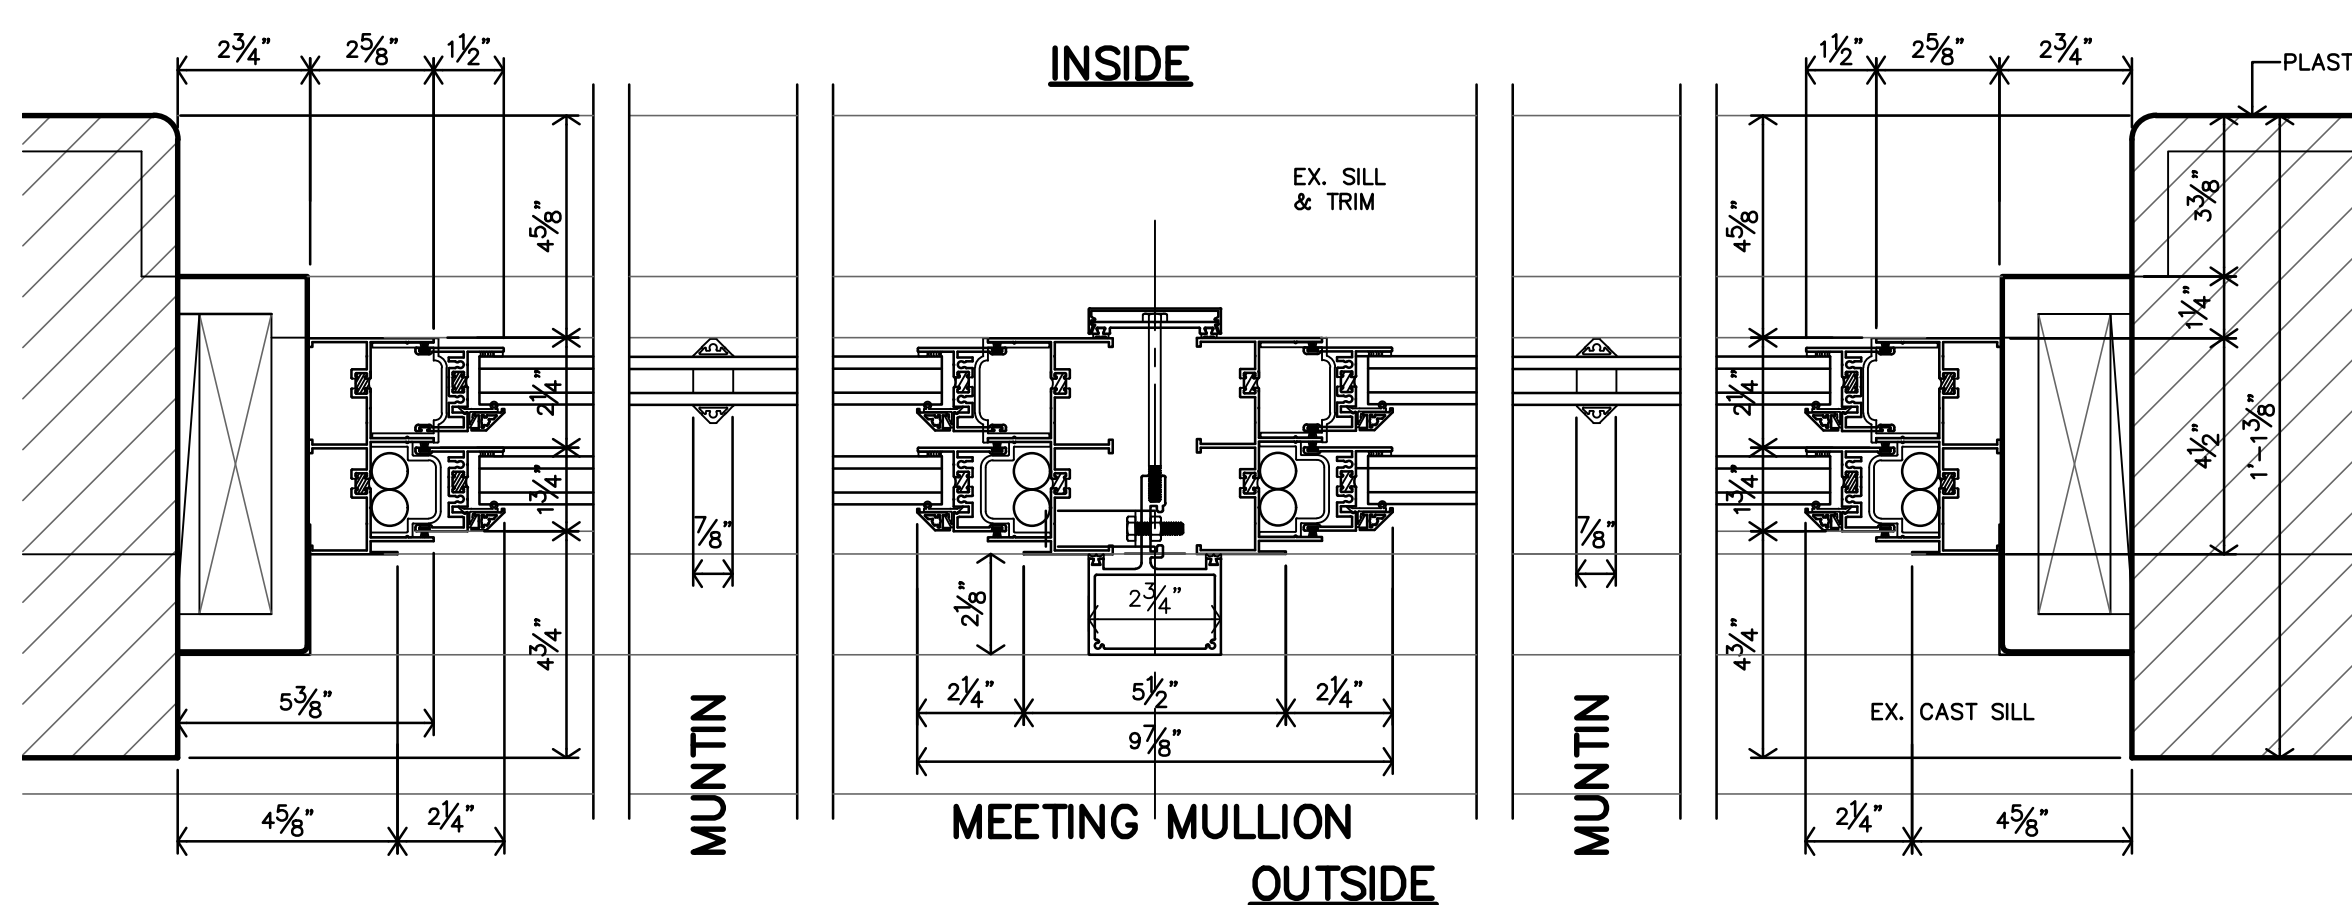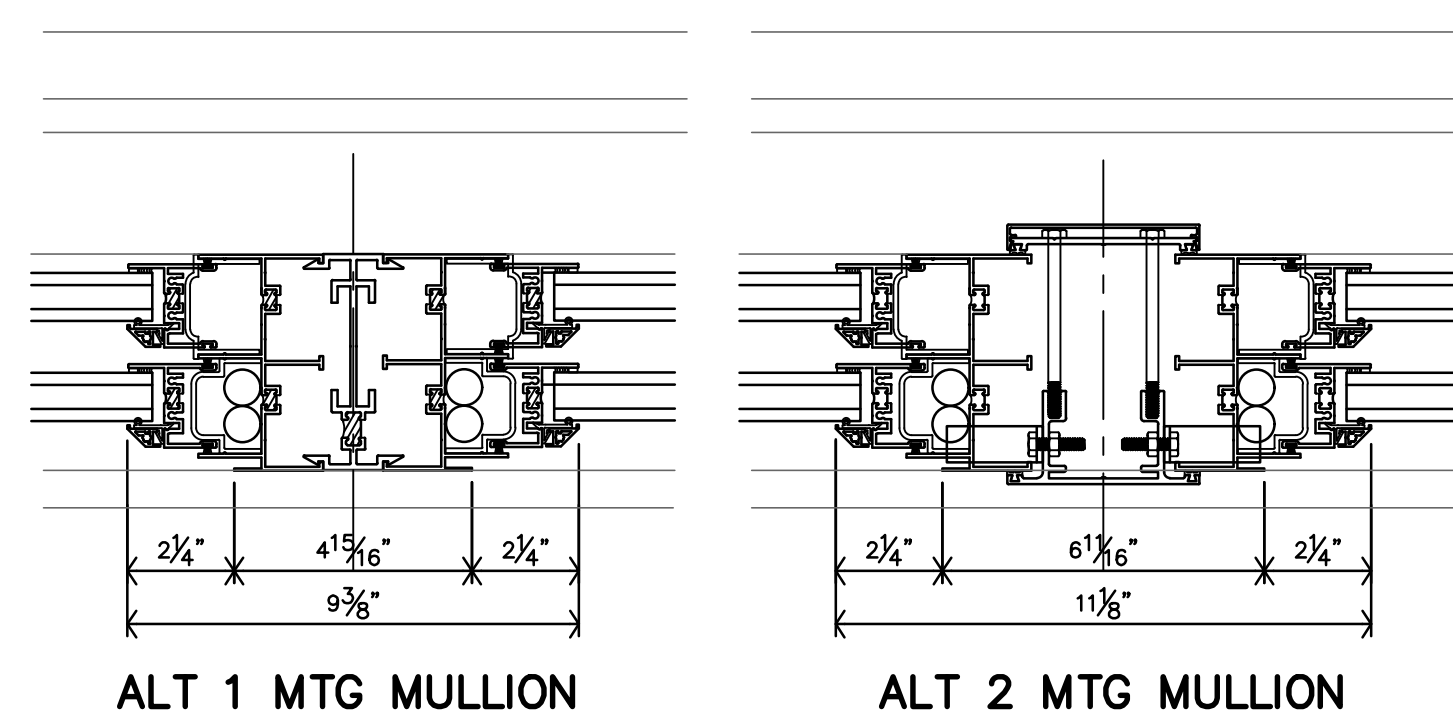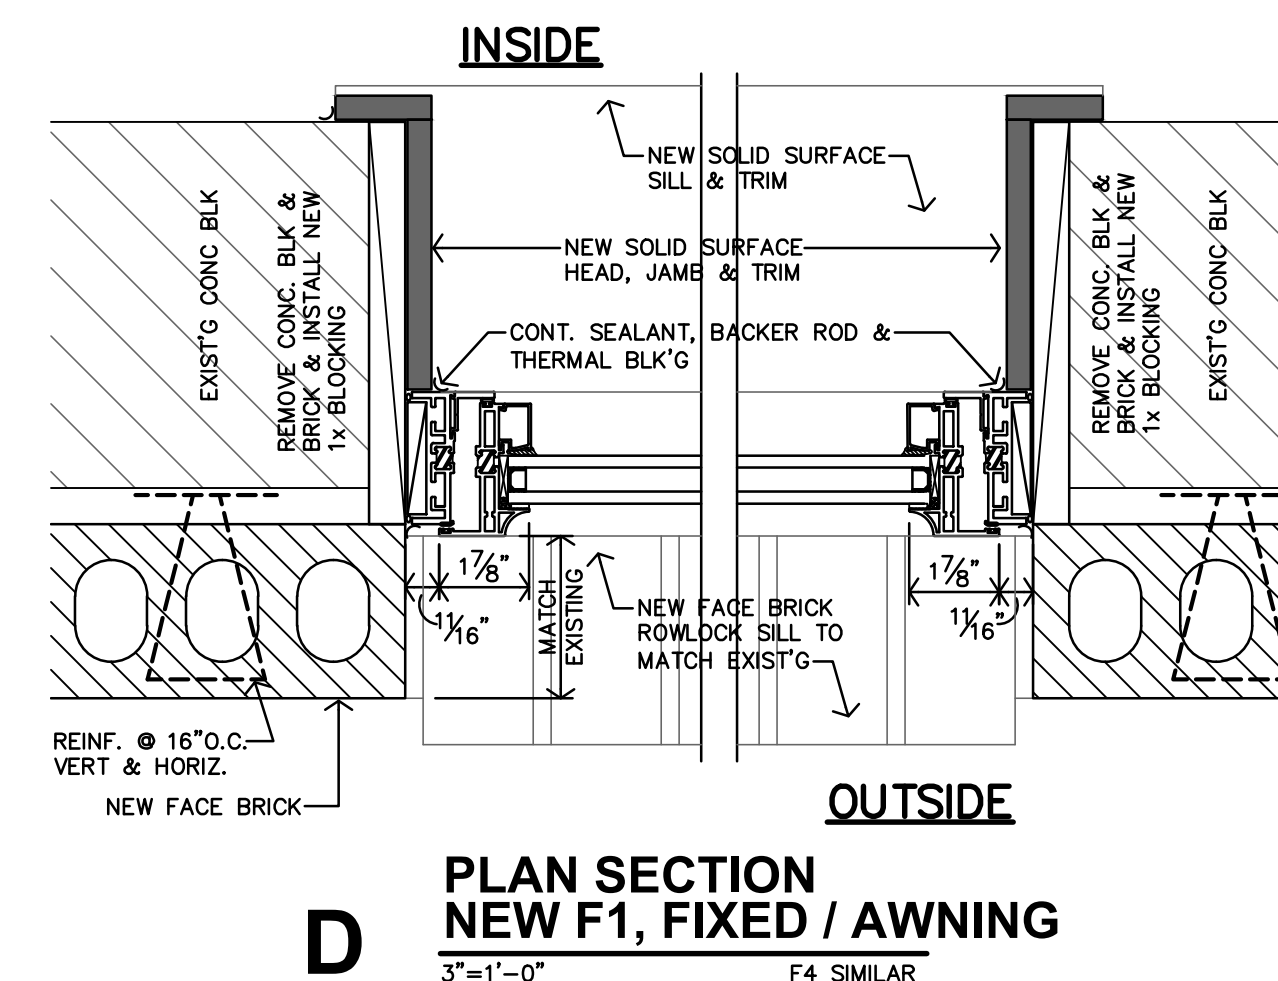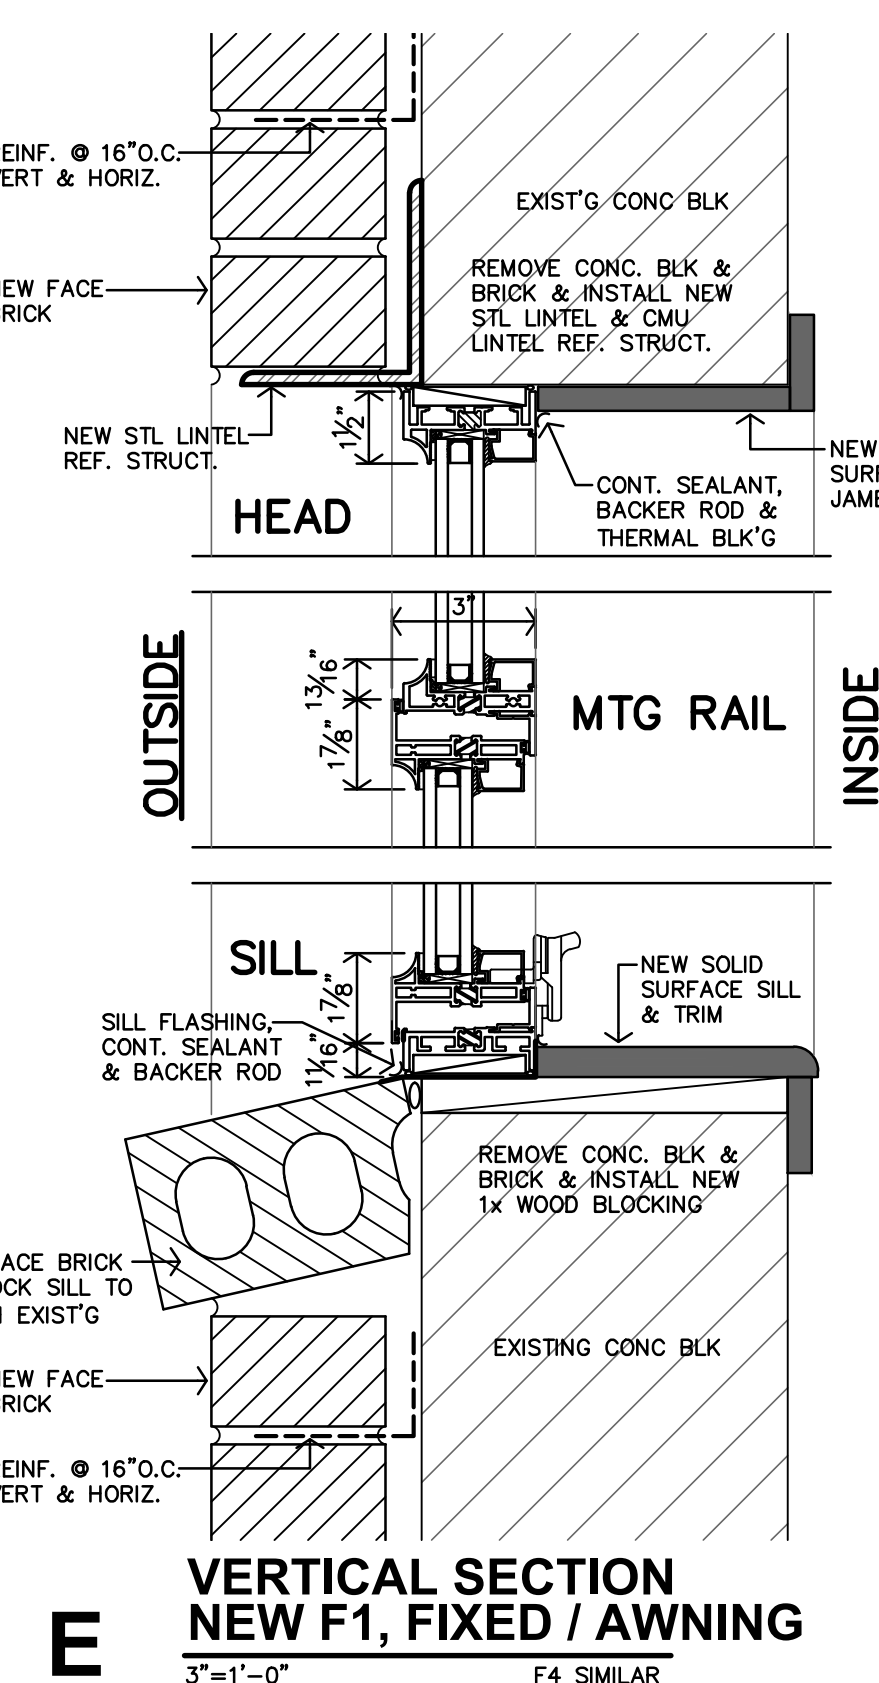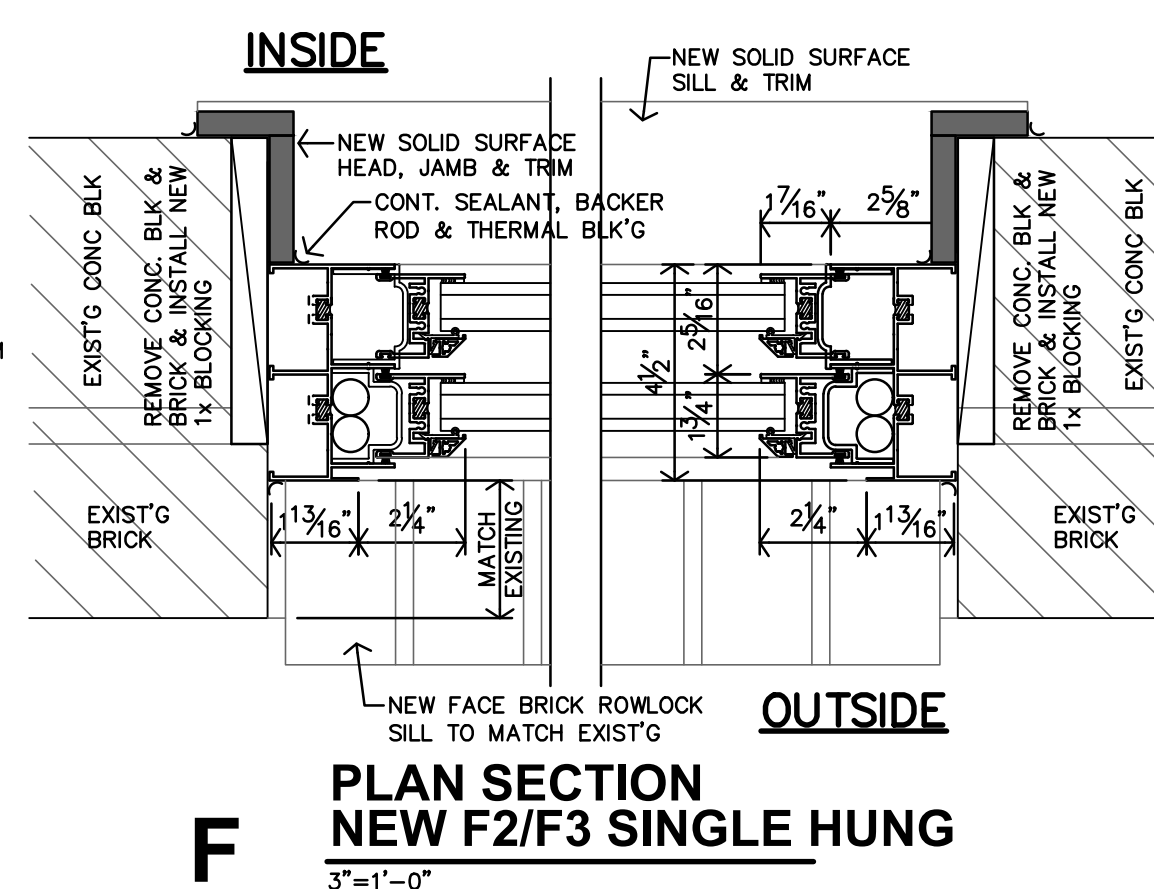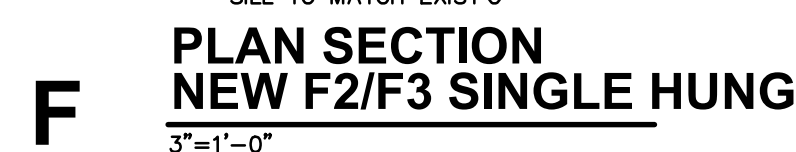

JonesGillamRenz
730 N. Ninth
Salina, KS 67401
785.827.0386

1881 Main Street, Suite 301
Kansas City, MO 64108
jgr@jgarchitects.com

THE IRVING LOFTS

HISTORIC RESTORATION & REHAB APARTMENTS

REVISIONS:

E0.1

TEXAS

Electrical Symbol Legend

Lighting Symbols

	Lighting Fixtures, Typical, Rectangular (Various Symbols)
	Lighting Fixtures, Typical, Round (Various Symbols)
	Center dot indicates pendant.
	Chevron indicates wall wash.
	Wall-mounted fixtures, Typical (Various Symbols)
	Strip Fixture
	Directional Light, Track Light, Flood Light
	Linear Light, Tape Light
	Emergency Lighting Unit, Ceiling-Mounted, Integral Battery
	Emergency Lighting Unit, Ceiling-Mounted, Remote Battery
	Emergency Lighting Unit, Wall-Mounted, Integral Battery
	Emergency Lighting Unit, Wall-Mounted, Remote Battery
	Exit Light, Ceiling-Mounted. Shading and arrows indicate faces and directional chevrons.
	Exit Light, Wall-Mounted. Shading and arrows indicate faces and directional chevrons.
	Exit/ELU Combo
	Pole/Area Lights
	Post-Top Area Light
	Bollard Light
	Hatch indicates light on an emergency or life safety circuit.
	Single-Pole Switch
	Two-Pole Switch
	Three-Pole Switch
	Switch Modifiers: 3: 3-Way OS: Occupancy Sensor 4: 4-Way VS: Vacancy Sensor K: Keyed CT: Above-Counter D: Dimming LV: Low-Voltage T: Timer M: Motor-Rated
	Lighting Contactor
	Lighting Control Panel
	Occupancy Sensor
	Daylight Harvesting Sensor

Lighting Tags

	Top Value: Fixture Type ID (<u>Underlined</u>) A MDP1a Bottom Value, Lowercase Letter: Switch ID Bottom Value, Number(s): Circuit Number Bottom Value, Uppercase Letter(s): Panel
	Absence of a switch designation on a lighting fixture indicates fixture is controlled by the only switch in the space. An "x" in place of the switch designation indicates unswitched.
	Switch ID indicated by a lowercase letter. Switch IDs are unique per space. A switch with an ID "a" controls all devices within the space in which it is located tagged with "a". A switch without a tagged ID controls all lighting fixtures within a space. ID tags may be used on control devices other than switches, such as occupancy sensors or contactors.

Miscellaneous

	Area Not in Contract
	Note by Symbol
	Callout: Top Value: Detail Number on Sheet Bottom Value: Sheet Number of Detail
	Room Name and Number

Power Symbols

	Wall
	Ceiling
	Floor
	Simplex Receptacle
	Duplex Receptacle
	Quadplex Receptacle
	Special Receptacle, Type as Indicated
	Receptacle Modifiers: ###: Height AFF(to center) CT: Device Mounted Above Counter Top IG: Isolated Ground H: Device Mounted Horizontally WP: Weatherproof In-Use Cover
	Half shading indicates split (typically switched)
	Outside shading indicates tamperproof device
	Center shading indicates GFI type
	Full shading indicates tamperproof GFI type
	Multioutlet Assembly
	Filled squares indicate 120V outlet
	Open squares indicate with USB
	Cord Reel, Device Varies
	Drop Cord, Device Varies
	Junction Box
	Floor Box, see schedule for type
	Emergency Power Off
	Door Opener Push Plate
	Power Meter
	Safety Switch, Fused
	Safety Switch, Unfused
	Motor Starter
	Combination Starter/Disconnect
	Contactor

Power Device and Equipment Tags

	Electrical Device Tags: Uppercase letter(s) indicates Panel ID and circuit number. Lowercase letter indicates designation of controlling switch (where applicable).
	Equipment Tags: Equipment ID is indicated by an underlined tag adjacent to the equipment. See the equipment connection schedule for description, electrical requirements, and panel and circuit number. Symbols/graphic appearance of equipment varies.

Wiring

	Solid, aced lines connecting equipment, devices, or fixtures indicate unswitched power circuiting. Wires are only intended to indicate to what circuit devices are connected. Actual connections, circuit routing, installation, junction boxes, etc. shall be field-determined by the contractor.
	Dashed, aced lines connecting equipment, devices, or fixtures indicate switched power.
	Home run to branch circuit panelboard. The equipment name and circuit number(s) are indicated, separated by a hyphen. Homers are only intended to indicate panel and circuit number. Actual homerun location shall be field-determined by the contractor.

Power Distribution Equipment

	MDP
	HP/A
	LP/A
	Hatched fill indicates distribution panel or switchboard.
	Dashed box indicates code-required clearance (width and depth).
	Dots indicate front of recessed panel.
	Devices and fixtures are tagged with Panel and circuit number. For example, a device tagged with "A:1" indicates the device is circuited to panel designated "A," circuit number 1.

Telecom Symbols

	Wall
	Ceiling
	Floor
	Data Outlet
	Telephone Outlet
	Data/Telephone Outlet
	Outlet Modifiers: ###: Height AFF (to center) CT: Mounted Above Counter Top
	Wireless Access Point
	TV Outlet

GENERAL ELECTRICAL NOTES	
A.	COORDINATE INSTALLATION OF ELECTRICAL WORK ABOVE THE CEILING TO PROVIDE THE GREATEST POSSIBLE CLEARANCE FOR INSTALLATION OF PLUMBING AND MECHANICAL INSTALLATION. CONDUITS SHALL BE ROUTED THROUGH JOIST WEBS WHERE POSSIBLE.
B.	VERIFY EXACT PLACEMENT OF ALL LUMINAIRES, DEVICES, AND EQUIPMENT SHOWN ON THE ELECTRICAL CONSTRUCTION DOCUMENTS WITH ARCHITECTURAL, MECHANICAL AND PLUMBING DRAWINGS PRIOR TO FINAL PLACEMENT.
C.	ELECTRICAL EQUIPMENT AND DEVICES SHALL BE "LISTED" AND "IDENTIFIED" AS RATED FOR A MINIMUM OF 75°C CONDUCTOR TERMINATION.
D.	DEFINITION OF TERMS: "SHALL": ACTION THAT IS REQUIRED WITHOUT OPTION OR QUALIFICATION. "FURNISH": CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING. "INSTALL": CONTRACTOR SHALL BE RESPONSIBLE FOR LABOR AND CONSTRUCTION EQUIPMENT NECESSARY TO SET IN PLACE, CONNECT, CALIBRATE AND TEST EQUIPMENT FURNISHED BY HIM OR OTHERS. "PROVIDE": CONTRACTOR SHALL FURNISH AND INSTALL.
MOUNTING HEIGHT REQUIREMENTS: UNLESS SPECIFICALLY INDICATED OTHERWISE, THE FOLLOWING MOUNTING HEIGHTS SHALL APPLY:	
<ul style="list-style-type: none"> • RECEPTACLES 16" TO BOTTOM • TELECOMMUNICATIONS OUTLETS 16" TO BOTTOM • LIGHT SWITCHES 48" TO TOP • THERMOSTATS 48" TO TOP • HUMIDISTATS 48" TO TOP • FIRE ALARM PULL STATIONS 48" TO TOP • FIRE ALARM NOTIFICATION DEVICES LOWER OF: 88" TO BOTTOM OR TOP AT 6' BELOW CEILING 	
GENERAL LIGHTING NOTES	
A.	THE CIRCUITING OF ALL LUMINAIRES HAS BEEN SHOWN ON THE PLANS, AND THE CONTRACTOR SHALL FOLLOW THIS CIRCUITING LAYOUT.
B.	CIRCUIT ALL EMERGENCY LIGHTING, NIGHT LIGHTS AND EXIST LIGHTS TO AN UNSWITCHED HOT CONDUCTOR, UPSTREAM OF ALL CONTROLS.
C.	DIRECT CURRENT POWER WIRING FROM EXIT SIGNS TO REMOTE EXTERIOR EMERGENCY LIGHTING HEADS SHALL BE (2) #10 IN 12" CONDUIT UNLESS NOTED OTHERWISE.
D.	IN AREAS WHERE CEILING MOUNTED OCCUPANCY SENSORS ARE USED FOR LIGHTING CONTROL, IN CONJUNCTION WITH WALL SWITCHES, OCCUPANCY SENSOR/POWER PACK SHALL SWITCH LEG SHALL BE WIRED IN SERIES WITH WALL SWITCHES TO PROVIDE OVERRIDE "OFF" CONTROL FOR LIGHTS.
E.	CONTROL WIRING FOR 0-10 vdc DIMMING SIGNAL CIRCUITS SHALL BE NEC CLASS 1, RATED IN SAME RACEWAY/CABLE WITH LIGHTING CIRCUIT POWER CONDUCTORS. WIRING SHALL CONSIST OF (2) #16 SOLID OR THIN THIN OR TFN CONDUCTORS. CONDUIT INSULATION COLOR SHALL BE VIOLET (+ V-dc) AND PINK (- V-dc). WHERE MC-CABLE IS USED FOR FINAL 6' POWER CONNECTION WHIP TO LUMINAIRE, UTILIZE "LUMINARY" TYPE MC-CABLE WITH INTEGRAL CLASS 1 CONDUIT WIRING.
GENERAL POWER NOTES	
A.	THE CIRCUITING OF ALL DEVICES HAS BEEN SHOWN ON THE PLANS, AND THE CONTRACTOR SHALL FOLLOW THIS CIRCUITING LAYOUT.
B.	VERIFY EXACT LOCATIONS OF HVAC AND PLUMBING EQUIPMENT WITH THE GENERAL CONTRACTOR AND ASSOCIATED SUBCONTRACTORS. COORDINATE CONDUIT STUB-UP AND POWER CONNECTIONS PRIOR TO COMMENCING ROUGH-IN WORK. ELECTRICAL DEVICES (DISCONNECTS, RECEPTACLES, ETC.) INSTALLED ON EQUIPMENT SHALL BE MOUNTED ON A NON-REMOVABLE PANEL OF THE EQUIPMENT. FIELD COORDINATE EXISTING POWER MOUNTING LOCATIONS PRIOR TO INSTALLATION.
C.	WALL MOUNTED HVAC CONTROL DEVICES (THERMOSTATS, TEMPERATURE SENSORS, HUMIDISTATS, CO ₂ SENSORS, ETC) SHALL BE PROVIDED BY MECHANICAL CONTRACTOR. UNLESS NOTED OTHERWISE, ELECTRICAL CONTRACTOR SHALL PROVIDE SINGLE GANG WALL BOX WITH 1/2" CONDUIT STUBBED OUT TO ABOVE ACCESSIBLE CEILING WITH NYLON BUSINGS AND PULL-STRUNG IN RACEWAY. REFER TO MECHANICAL DRAWINGS FOR LOCATIONS OF DEVICES.
GENERAL TELECOMMUNICATIONS NOTES	
OUTLET TYPES INDICATED:	
1. WALL PHONE OUTLET: 2"x2 1/2"-18" DEEP DEVICE BOX WITH (1) 3/4" CONDUIT TO ABOVE ACCESSIBLE CEILING.	
2. PHONE/DATA OUTLET: 4-11 1/16" SQUARE x 3-1/4" DEEP BOX (RACO #260 OR EQUAL) WITH 1-GANG DEVICE RING AND 1-1/4" CONDUIT TO ABOVE ACCESSIBLE CEILING.	
3. TV OUTLET: 4-11 1/16" SQUARE x 3-1/4" DEEP BOX (RACO #260 OR EQUAL) WITH 2-GANG DEVICE RING AND 1/2" CONDUIT TO ABOVE ACCESSIBLE CEILING	
B. PROVIDE NYLON BUSINGS FOR ALL CONDUIT ENDS NOT CONNECTED TO A BOX OR FITTING TO PROTECT CABLEING FROM DAMAGE.	
C. CONDUITS FROM EACH OUTLET SHALL BE STUBBED 2" ABOVE THE FINISHED CEILING IN AREAS WITH ACCESSIBLE TILES. IN AREAS WITH OPEN CEILINGS, STUB CONDUIT INTO STRUCTURAL JOIST SPACE.	
D. PROVIDE BLANK, STAINLESS STEEL COVER PLATES FOR ALL OUTLETS NOT ACTIVATED BY OWNER.	
E. PROVIDE SUITABLE PULL STRING IN ALL CONDUITS.	
F. ALL TELECOMMUNICATIONS AND AV CABLEING, JACKS, CONNECTORS, TERMINATIONS, EQUIPMENT AND TESTING SHALL BE PROVIDED BY OWNER.	
GENERAL FIRE ALARM NOTES	
A. FIRE ALARM CABLEING SHALL BE INSTALLED IN CONDUIT WHERE EXPOSED, INACCESSIBLE, AND WHERE SUBJECT TO PHYSICAL DAMAGE.	
B. DUCT TYPE SMOKE DETECTORS SHALL BE FURNISHED AND WIRED BY FIRE ALARM CONTRACTOR, INSTALLED IN DUCT BY MECHANICAL CONTRACTOR.	
C. FIRE ALARM SYSTEM HVAC SHUT DOWN RELAYS SHALL BE PROVIDED AND WIRED TO FIRE ALARM CONTROL PANEL BY FIRE ALARM CONTRACTOR. LOCATE RELAYS WITHIN 5' OF HVAC EQUIPMENT AND PROVIDE CONDUIT WITH PULL STRING FROM RELAY TO EQUIPMENT. UNIT SHUT DOWN CONTROL WIRING SHALL BE PROVIDED BY MECHANICAL CONTRACTOR.	
D. AT LOCATION OF SMOKE DAMPERS AND COMBINATION FIRE/SMOKE DAMPERS, PROVIDE DUCT OR AREA SMOKE DETECTOR (AS SHOWN ON PLANS) WITHIN 5' OF DAMPER AND WIRE TO FIRE ALARM CONTROL PANEL. PROVIDE FIRE ALARM RELAY FOR CONTROL OF 120V POWER TO DAMPER ACTUATOR. DAMPER SHALL CLOSE UPON DETECTION OF SMOKE.	
E. IN ADDITION TO VALVES INSTALLED ON FIRE SPRINKLER SYSTEM RISER, ALL VALVES INSTALLED OUTSIDE THE BUILDING (POST INDICATOR VALVE, TAPPING SLEEVE VALVE, ETC.) SHALL BE SUPERVISED BY THE FIRE ALARM SYSTEM. PROVIDE ADDRESSABLE MONITORING MODULE AND SURGE PROTECTION DEVICE (DTEK EDTX-25HLP48B) FOR EACH MONITORED VALVE. COORDINATE WITH GC AND SITE WORK CONTRACTOR FOR ALL VALVES INSTALLED. MONITORING IS NOT REQUIRED FOR VALVES INSTALLED IN ROADWAY BOXES BY THE MUNICIPALITY/PUBLIC UTILITY.	

Electrical Sheet List	
E0.1	ELECTRICAL TITLE SHEET
E0.1.1	ELECTRICAL LIGHTING-BLDG-A-FIRST FLOOR
E0.1.2	ELECTRICAL LIGHTING-BLDG-A-SECOND & THIRD FLOOR
E0.2.1	ELECTRICAL POWER-BLDG-A-FIRST FLOOR
E0.2.2	ELECTRICAL POWER-BLDG-A-SECOND & THIRD FLOOR
E0.3.1	SPECIAL SYSTEMS-BLDG-A-FIRST FLOOR
E0.3.2	SPECIAL SYSTEMS-BLDG-A-SECOND & THIRD FLOOR
E0.6.1	ELECTRICAL SCHEDULES AND DETAILS - A
E0.6.2	ELECTRICAL RISER DIAGRAMS - HOUSE - A
E0.6.3	ELECTRICAL RISER DIAGRAMS - RMC-A
E0.6.4	ELECTRICAL PANEL SCHEDULES - A
E0.1.1	ELECTRICAL-BLDG-B
E0.2.1	SPECIAL SYSTEMS-BLDG-B
E0.6.1	ELECTRICAL SCHEDULES AND DETAILS - B
E0.6.2	ELECTRICAL RISER DIAGRAMS AND PANEL SCHEDULES - B
E0.1.1	ELECTRICAL-BLDG C
E0.2.1	SPECIAL SYSTEMS-BLDG C
E0.6.1	ELECTRICAL SCHEDULES AND DETAILS - C
E0.6.2	ELECTRICAL RISER DIAGRAMS AND PANEL SCHEDULES - C

GENERAL ELECTRICAL DEMOLITION NOTES

1. REMOVE ALL NM, BM, XC, MC, AC AND OTHER CABLE SYSTEMS AND WIRING FOR ALL ABANDONED CIRCUITS.
2. REMOVE ALL ABANDONED CONDUITS ABOVE LAY-IN CEILINGS, EXPOSED CONDUITS, FLEXIBLE CONDUITS, SURFACE RACEWAY, SURFACE MOUNTED OUTLET/JUNCTION BOXES AND EQUIPMENT UNLESS NOTED OTHERWISE.
3. WHERE ABANDONED FEEDERS AND BRANCH CIRCUITS ARE CONCEALED WITHIN WALLS, FLOORS AND CEILINGS THAT ARE TO REMAIN, REMOVE ALL WIRING AND CAP CLOSURES AT BOTH ENDS.
4. WHERE ABANDONED OUTLET AND JUNCTION BOXES ARE RECESSED FLUSH IN WALLS, FLOORS AND HARD CEILINGS THAT ARE TO REMAIN, REMOVE ALL WIRING AND CAP CLOSURES. REMOVE BOXES LARGER THAN 6"X6" AND COVER PLATES FOR BOXES 6"X6" AND SMALLER. REMOVE BOXES LARGER THAN 6"X6" AND PATCH SURFACE TO MATCH EXISTING. COORDINATE WITH ARCHITECT FOR FINAL DIRECTION.
5. EQUIPMENT, FIXTURES, RACEWAY, WIRING AND DEVICES WHICH ARE REMOVED SHALL BE REMOVED FROM THE JOB SITE BY THIS CONTRACTOR, UNLESS DIRECTED OTHERWISE BY THE ARCHITECT OR OWNER'S REPRESENTATIVE. CONFORM TO ALL LAWS AND ORDINANCES IN EFFECT CONCERNING THE PROPER DISPOSAL OF LUMINAIRE AND LUMINAIRE FIXTURES.
6. COORDINATE THE REMOVAL OF MECHANICAL AND PLUMBING EQUIPMENT WITH THE MECHANICAL AND PLUMBING CONTRACTORS. ELECTRICAL CONTRACTOR SHALL DISCONNECT AND REMOVE ELECTRICAL POWER AND CONTROL CIRCUITS FOR EQUIPMENT BEING REMOVED. REMOVE ALL ELECTRICAL EQUIPMENT (COORDINATED WITH MECHANICAL AND PLUMBING CONTRACTORS) INCLUDING DISCONNECT SWITCHES, MOTOR STARTERS, RELAYS, ETC).

GENERAL ELECTRICAL REMEDIAL NOTES

1. DESIGN IS BASED ON FIELD INFORMATION, AS-BUILT DRAWINGS AND OWNER FURNISHED INFORMATION. CONTRACTOR SHALL VERIFY ADEQUACY OF ALL EXISTING CONDITIONS. IN CASE OF DISCREPANCY, PROVIDE ALL NECESSARY CONDUIT, WIRE, BOXES, FITTINGS, ETC. FOR A COMPLETE OPERATING ELECTRICAL SYSTEM.

2. EXISTING EQUIPMENT, WIRING DEVICES, LIGHTS, CONDUIT, WIRING, ETC., NOT DISTURBED BY NEW CONSTRUCTION WORK SHALL BE MAINTAINED AND UN Damaged. THESE ITEMS, IF SHOWN, ARE SHOWN FOR INFORMATION PURPOSES ONLY UNLESS NOTED OTHERWISE. THIS CONTRACTOR SHALL VISIT THE JOB SITE TO VERIFY ALL EXISTING CONDITIONS AND RECORDS ARE FAMILIAR WITH WORK TO BE PERFORMED. FAILURE TO DO SO WILL NOT RELIEVE THIS CONTRACTOR OF THE RESPONSIBILITY FOR PERFORMING ALL WORK NECESSARY TO PROVIDE A WORKMANLIKE INSTALLATION.

3. FIELD VERIFY THE LOCATION AND CONDITION OF ALL EXISTING UTILITIES AND PROVIDE PROTECTION FOR THESE UTILITIES DURING THE COURSE OF WORK. EXISTING UTILITIES, BUILDING MATERIALS AND EQUIPMENT DAMAGED BY THIS CONTRACTOR OR ANY PARTIES ASSOCIATED WITH THIS CONTRACTOR, SHALL BE REPAIRED OR REPLACED AT THIS CONTRACTOR'S EXPENSE, IN A TIMELY MANNER, AND TO THE OWNER'S WRITTEN ACCEPTANCE.

4. THERE SHALL NOT BE ANY INTERRUPTION TO EXISTING SERVICES (ELECTRICAL, FIRE ALARM, TELEPHONE, ETC.) WITHOUT PRIOR SCHEDULING OF SUCH OUTAGES WITH THE OWNER. ADVISE THE OWNER OF ALL SUCH SCHEDULED OUTAGES.

5. MAINTAIN ACCURATE RECORDS OF ALL MODIFICATIONS TO THE EXISTING SYSTEMS WHICH ARE TO REMAIN AND DELIVER ALL RECORD DRAWINGS INDICATING SUCH MODIFICATIONS TO THE OWNER UPON COMPLETION OF THE PROJECT. MAINTAIN IN THE PROJECT CONSTRUCTION OFFICE, AS THE WORK PROGRESSES, AN UP-TO-DATE, NEATLY MARKED COPY OF THESE DRAWINGS FOR REVIEW BY THE ARCHITECT, ENGINEER OR THE OWNER'S REPRESENTATIVE.

6. WHERE NEW ADDITION WORK OR REMODELING INTERFERES WITH CIRCUITS IN ROOMS OTHERWISE UNDISTURBED, EXISTING CIRCUITS SHALL BE REWORKED AS REQUIRED TO MAINTAIN SERVICE.

7. EXISTING ROUGH-IN BOXES AND CONDUIT MAY BE UTILIZED FOR NEW DEVICES IF THEY ARE OF PROPER SIZE AND MATERIAL, AND ARE IN SUITABLE LOCATIONS. WHERE NEW DEVICES ARE BEING INSTALLED IN EXISTING ROUGH-IN BOXES, WHERE EXISTING EQUIPMENT IS BEING REPLACED WITH NEW EQUIPMENT OR RELOCATED EQUIPMENT, ELECTRICAL CONTRACTOR MAY REUSE THE EXISTING CONDUIT AND ROUGH-IN LOCATIONS IF POSSIBLE, BUT ALL CONDUCTORS SHALL BE NEW.

8. CIRCUITING SOUNDED IN REMODELED AREAS MAY BE MODIFIED TO SUIT FIELD CONDITIONS. HOWEVER, REUSE OF CIRCUITS IS APPROXIMATELY AS SHOWN ON PLANS TO AVOID OVERLOADING OF CIRCUITS AND TO LIMIT VOLTAGE DROP.

9. MAINTAIN FIRE RATING OF ALL EXISTING WALLS, FLOORS AND CEILING SYSTEMS.

10. NEW DEVICES INSTALLED ON EXISTING WALLS AND CEILINGS IN OCCUPIED SPACES SHALL HAVE WRINGING CONCEALED. SURFACE RACEWAY (WIREMOULD) SHALL ONLY BE INSTALLED ON EXISTING WALLS AND HARD CEILINGS WHERE IT CANNOT BE CONCEALED. SURFACE RACEWAYS SHALL BE TYPE BRICK OR ETC. OBTAIN APPROVAL FROM ARCHITECT, ENGINEER, AND OWNER PRIOR TO EACH OCCURRENCE WHERE SURFACE RACEWAY IS INSTALLED. SURFACE RACEWAY SHALL BE STEEL, SINGLE CHANNEL TYPE, IVORY COLORED, COMPLETE WITH ALL ELBOWS, BOXES, SUPPORTS, COVERS, ETC. AS REQUIRED. SURFACE RACEWAY SYSTEMS SHALL BE NON-FLAMMABLE, MANUFACTURED BY WIREMOULD, HUBBELL, OR MONOSYSTEMS, AND SHALL BE OF TYPES A, B, OR C.

POWER AND FIRE ALARM: WIREMOULD 500 SERIES
COMMUNICATIONS AND ADV: WIREMOULD 2400 SERIES



HISTORIC RESTORATION & REHAB APARTMENTS

TEXAS



REVISIONS

DATE: 11/20/2025

JOB: 25-3479

SHEET NO.:

EC1.1

COPYRIGHT ©



ELECTRICAL PLAN-BUILDING C-FIRST FLOOR

$$3/16'' = 1'-0''$$

BUILDING C



HISTORIC RESTORATION & REHAB APARTMENTS

TEXAS



REVISIONS

DATE: 11/20/2025

JOB: 25-3479

SHEET NO.:

EC2.1

COPYRIGHT ©



1 SPECIAL SYSTEMS PLAN-BUILDING C-FIRST FLOOR

$$3/16" = 1'-0"$$

BUILDING C



REVISIONS:

DATE: 11/20/2025
JOB: 25-3479
SHEET NO.:

EC6.1

BUILDING C

COPYRIGHTED ©


LIGHT FIXTURE SCHEDULE

- GENERAL:**
- ALL LEDs SHALL BE 4000K CORRELATED COLOR TEMPERATURE, MINIMUM 80 CRI.
 - ALL LED FIXTURES SHALL ADHERE TO LM79 AND LM80 STANDARDS.
 - PROVIDE MANUFACTURERS' FLANGE KIT WHERE LAY-IN FIXTURES ARE TO BE INSTALLED IN GYP.


- NOTES:**
- PROVIDE FIXTURE WITH INTEGRAL EMERGENCY BATTERY AND CHARGER WITH SELF-DIAGNOSTIC/SELF-TESTING ELECTRONICS.
 - FIXTURE SHALL BE CAPABLE OF WALL OR CEILING MOUNT APPLICATIONS AND SHALL HAVE BREAK-OUT DIRECTIONAL CHEVRONS.
 - LIGHT FIXTURE SELECTED BY INTERIOR DESIGNER AND PROVIDED BY E.C. ALL SUBSTITUTIONS SHALL BE APPROVED BY INTERIOR DESIGNER.
 - FIXTURE SHALL BE CAPABLE OF OPERATION IN TEMPERATURES RANGING FROM -4F THROUGH 104F.
 - U.L. LISTED FOR 'WET LOCATION'.
 - U.L. LISTED FOR 'DAMP LOCATION'.
 - COORDINATE COLOR AND EXACT FIXTURE INSTALLATION LOCATION WITH ARCHITECT.
 - PROVIDE FIXTURE/POLE ASSEMBLY WITH 20" ROUND STRAIGHT STEEL POLE, BLACK TO MATCH FIXTURE.
 - PROVIDE FIXTURE/POLE ASSEMBLY WITH 10" ROUND STRAIGHT STEEL POLE, BLACK TO MATCH FIXTURE.
 - FIXTURE/POLE ASSEMBLY SHALL BE RATED FOR 100 MPH WIND LOADS. PROVIDE WITH VIBRATION DAMPER PER MANUFACTURER'S RECOMMENDATIONS.
 - WHERE INSTALLED ABOVE SHOWERS/TUBS FIXTURE SHALL BE U.L. DAMP LISTED.
 - WHERE INSTALLED OUTDOORS FIXTURE SHALL BE U.L. WET LISTED.
 - AT BUILDINGS 'B' + 'C' PROVIDE FIXTURE WITH INTEGRAL PHOTOCELL.
 - COORDINATE EXACT FIXTURE INSTALLATION LOCATION WITH INTERIOR DESIGNER.

MARK	MANUFACTURER	MODEL NUMBER	WATTAGE	LUMEN OUTPUT	DRIVER	MOUNTING	FINISH	DESCRIPTION	NOTES
A	SELECTED BY OWNER	---			STANDARD	PENDANT	---	LIGHT FIXTURE SELECTED BY OWNER, INSTALLED BY E.C.	6,7
B1	KUZCO	WV353020VB			STANDARD	SURFACE WALL	---	20" BATHROOM VANITY LIGHT SELECTED BY INTERIOR DESIGNER	3,7
B2	BARN LIGHT ELECTRIC COMPANY	BLE-W-WHU12-150			STANDARD	SURFACE WALL	---	12" ROUND SCOCNE BATHROOM VANITY LIGHT SELECTED BY INTERIOR DESIGNER	3,7
C1	SAVOY HOUSE	6-5564-1-89			STANDARD	SURFACE	---	CEILING MOUNTED LIGHT SELECTED BY INTERIOR DESIGNER	3,7
C2	BARN LIGHT ELECTRIC COMPANY	BLE-C-ULW20-300			STANDARD	PENDANT	---	CORD HUNG PENDANT LIGHT SELECTED BY INTERIOR DESIGNER	3,7
C3	KUZCO	WV4251112MBOP			STANDARD	SURFACE WALL	---	HALLWAY 12" WALL MOUNTED LIGHT SELECTED BY INTERIOR DESIGNER	3,7,14
C4	---	---			STANDARD	PENDANT	---	CHANDELIER SELECTED BY INTERIOR DESIGNER	3,7
C5	KUZCO	CH336830VB-UNV			STANDARD	PENDANT	---	CHANDELIER SELECTED BY INTERIOR DESIGNER	3,7
C6	KUZCO	WV537508BNOP			STANDARD	SURFACE WALL	---	8" ROUND WALL LIGHT SELECTED BY INTERIOR DESIGNER	3,7
D	HALO	SMX6RLSFS02W	13 W	1200 lm	LED DRIVER, DIMMABLE	CEILING SURFACE	WHITE	6" DIA ROUND SURFACE MOUNT DOWNLIGHT WITH SELECTABLE LUMEN OUTPUT	11,12
E1	LITHONIA	EU2LM12	5 W		--	WALL AT 7'-6" AFF	WHITE	TWIN HEAD POLYCARBONATE EMERGENCY LIGHT	1
E2	LITHONIA	AFF OEL DWHGXD UVOLT LTP SDRT WT			--	WALL AT 7'-6" AFF	BLACK	EXTERIOR RATED EMERGENCY LIGHT	4
F	DAY-BRITE CFI	FSS440L840-UNV-DIM	30 W	4077 lm	0-10V DIMMING TO 10%	SUSPENDED	WHITE	4' STANDARD STRIP WITH CURVED FROSTED ACRYLIC LENS	--
M	H.E. WILLIAMS	96-4-L40/835-HIAFR-WET/1-DRV-UNV	30 W	4700 lm	0-10V DIMMING TO 10%	SURFACE WALL HORIZONTAL	WHITE	4 FT. FULLY ENCLOSED AND GASKETED INDUSTRIAL FIXTURE WITH FROSTED, RIBBED, IMPACT-RESISTANT ACRYLIC LENS	--
R1	GARDCO	OPF-M-A11-840-T2M-AR1-UNV	131 W	23626 lm	LED DRIVER	ROUND POLE	BLACK	LED AREA LIGHT, SINGLE HEAD FULL CUT-OFF WITH IES TYPE II DISTRIBUTION, PROVIDE WITH HOUSE SIDE SHIELD	5,8,10
R2	GARDCO	OPF-M-A11-840-T3M-AR1-UNV	131 W	23438 lm	LED DRIVER	ROUND POLE	BLACK	LED AREA LIGHT, SINGLE HEAD FULL CUT-OFF WITH IES TYPE IIV DISTRIBUTION, PROVIDE WITH HOUSE SIDE SHIELD	5,8,10
R3	GARDCO	OPF-M-A11-840-T5M-AR1-UNV	131 W	24483 lm	LED DRIVER	ROUND POLE	BLACK	LED AREA LIGHT, SINGLE HEAD FULL CUT-OFF WITH IES TYPE IV DISTRIBUTION, PROVIDE WITH HOUSE SIDE SHIELD	5,8,10
S1	GARDCO	OPF-S-A01-840-T2M-AR1-UNV	42 W	7391 lm	LED DRIVER	ROUND POLE	BLACK	LED SITE LIGHT, SINGLE HEAD FULL CUT-OFF WITH IES TYPE II DISTRIBUTION, PROVIDE WITH HOUSE SIDE SHIELD	5,9,10
W1	GARDCO	GWM-A06-840-T2M-UNV	16 W	2599 lm	STANDARD	WALL	BLACK	EXTERIOR LED WALL PACK WITH IES TYPE II DISTRIBUTION	4,5,7,13
W1E	GARDCO	GWM-A06-840-T2M-UNV	16 W	2599 lm	STANDARD	WALL	BLACK	EXTERIOR LED WALL PACK WITH IES TYPE II DISTRIBUTION AND EMERGENCY BATTERY BACKUP	4,5,7,13
W2E	GARDCO	GWM-A06-840-T3M-UNV	16 W	2634 lm	STANDARD	WALL	BLACK	EXTERIOR LED WALL PACK WITH IES TYPE IIV DISTRIBUTION AND EMERGENCY BATTERY BACKUP	4,5,7
W3	GARDCO	GWM-A13-840-T4M-UNV	66 W	9668 lm	STANDARD	WALL	BLACK	EXTERIOR LED WALL PACK WITH IES TYPE IV DISTRIBUTION	4,5,7
X	LIFE SAFETY LIGHTING	LSXS2RWEMSDT	5 W			CEILING	WHITE	UNIVERSAL SINGLE/DOUBLE FACE POLYCARBONATE EXIT SIGN	2

- NOTES:
- COMMON GROUNDING ELECTRODE CONDUCTOR BUSBAR SHALL BE 1/4" THICK x 4" WIDE x 24" LONG, TIN PLATED COPPER BUSBAR, PROVIDE COMPLETE WITH INSULATING STAND OFFS, STAINLESS STEEL BRACKETS AND MOUNTING BOLTS. MOUNT ON WALL AT 18" AFF. ERICO #EGBA14424CCT OR EQUAL. GROUND BAR SHALL BE LISTED FOR EXTERIOR USE.
 - ALL CONNECTIONS TO GROUNDING BUSBAR SHALL BE MADE USING COMPRESSION TYPE LUGS (BURNDY "YAZ" SERIES OR EQUAL). MECHANICAL LUGS ARE NOT ACCEPTABLE.
 - INSTALL ALL GROUNDING ELECTRODE CONDUCTORS IN 3/4" CONDUIT WHERE EXPOSED AND WHERE SUBJECT TO PHYSICAL DAMAGE.
 - CONTRACTOR SHALL MEASURE RESISTANCE TO GROUND AND PROVIDE ADDITIONAL GROUND ROD OR PLATE ELECTRODES AS REQUIRED UNTIL A RESISTANCE TO GROUND OF 25 OHMS OR LESS IS ACHIEVED.

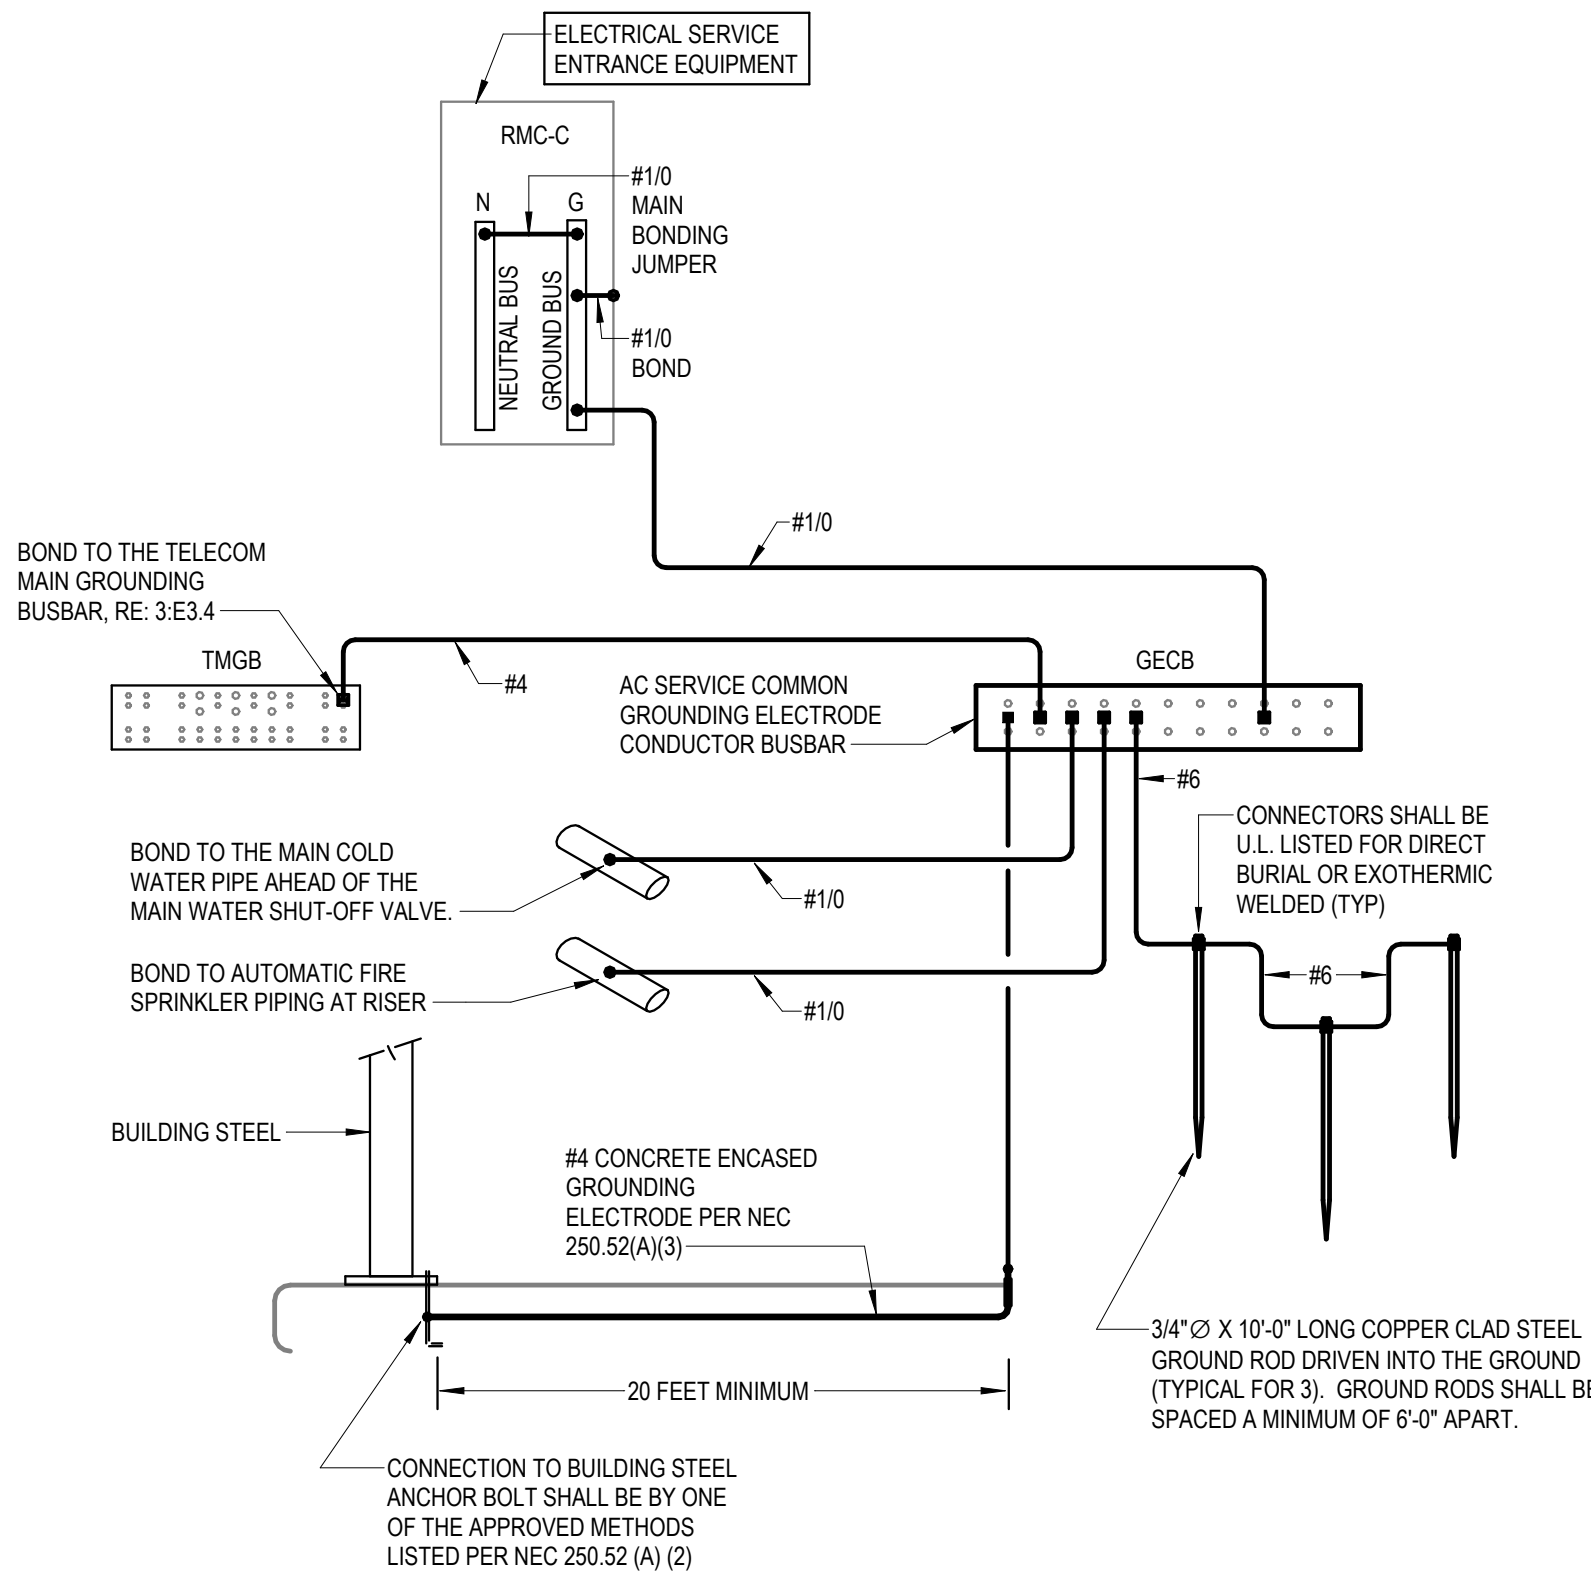

- NOTES:
- TELECOMMUNICATIONS GROUNDING BUSBARS SHALL BE 1/4" THICK, ELECTRO-TIN PLATED COPPER BUSBARS, COMPLETE WITH INSULATED STAND-OFFS AND STAINLESS STEEL BRACKETS AND MOUNTING BOLTS. MOUNT TO COMMUNICATIONS BACKBOARD AT 18" AFF.
TMGB: 4"W x 15-1/2"L, ERICO #TMGBA16L19PT
 - ALL GROUNDING / BONDING CONDUCTORS SHALL BE #4 AWG INSULATED STRANDED COPPER. INSTALL IN 3/4" CONDUIT WHERE EXPOSED AND WHERE SUBJECT TO PHYSICAL DAMAGE.
 - ALL CONNECTIONS TO TELECOM GROUNDING BUSBARS SHALL BE MADE USING COMPRESSION TYPE LUGS (BURNDY "YAL" SERIES OR EQUAL). MECHANICAL LUGS ARE NOT ACCEPTABLE.

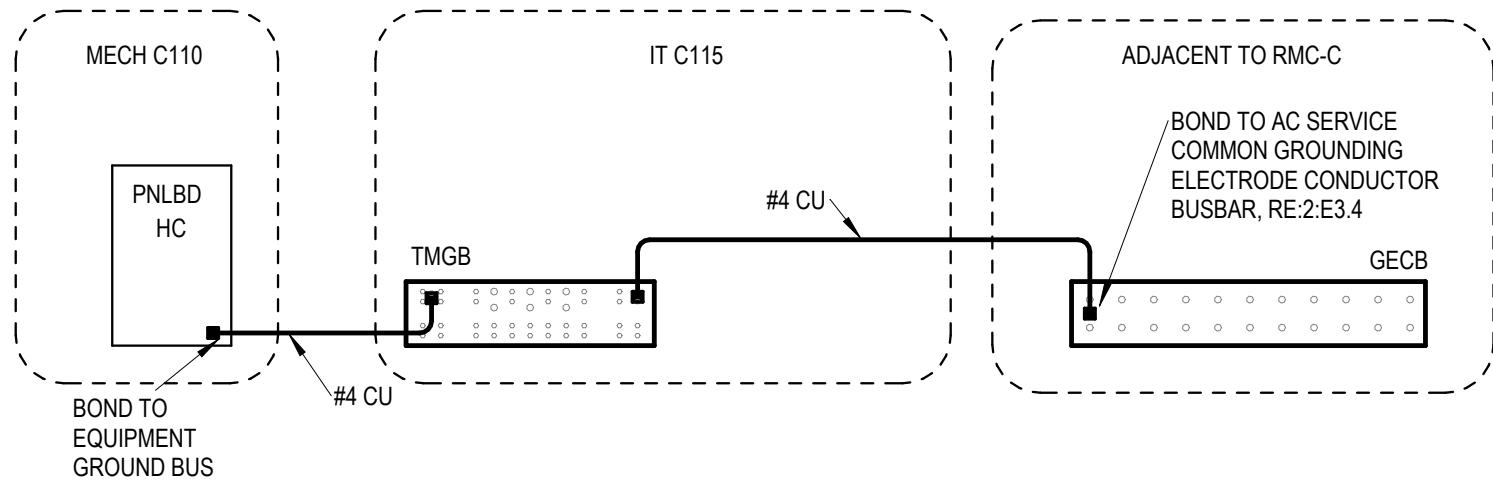

2

COMMUNICATIONS GROUNDING DETAIL - BUILDING C

NO SCALE

1

AC SERVICE GROUNDING DETAIL - BUILDING C

NO SCALE




5

HISTORIC RESTORATION & REHAB APARTMENTS

TEXAS



CLEBURNE.



DATE:	11/20/2025
JOB:	25-3479
SHEET NO.:	

EC6.2

COPYRIGHT ©

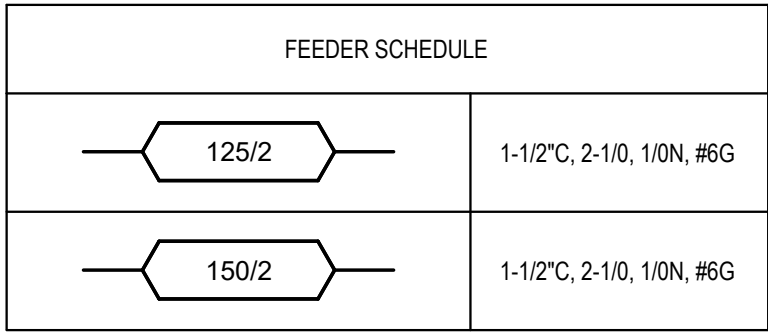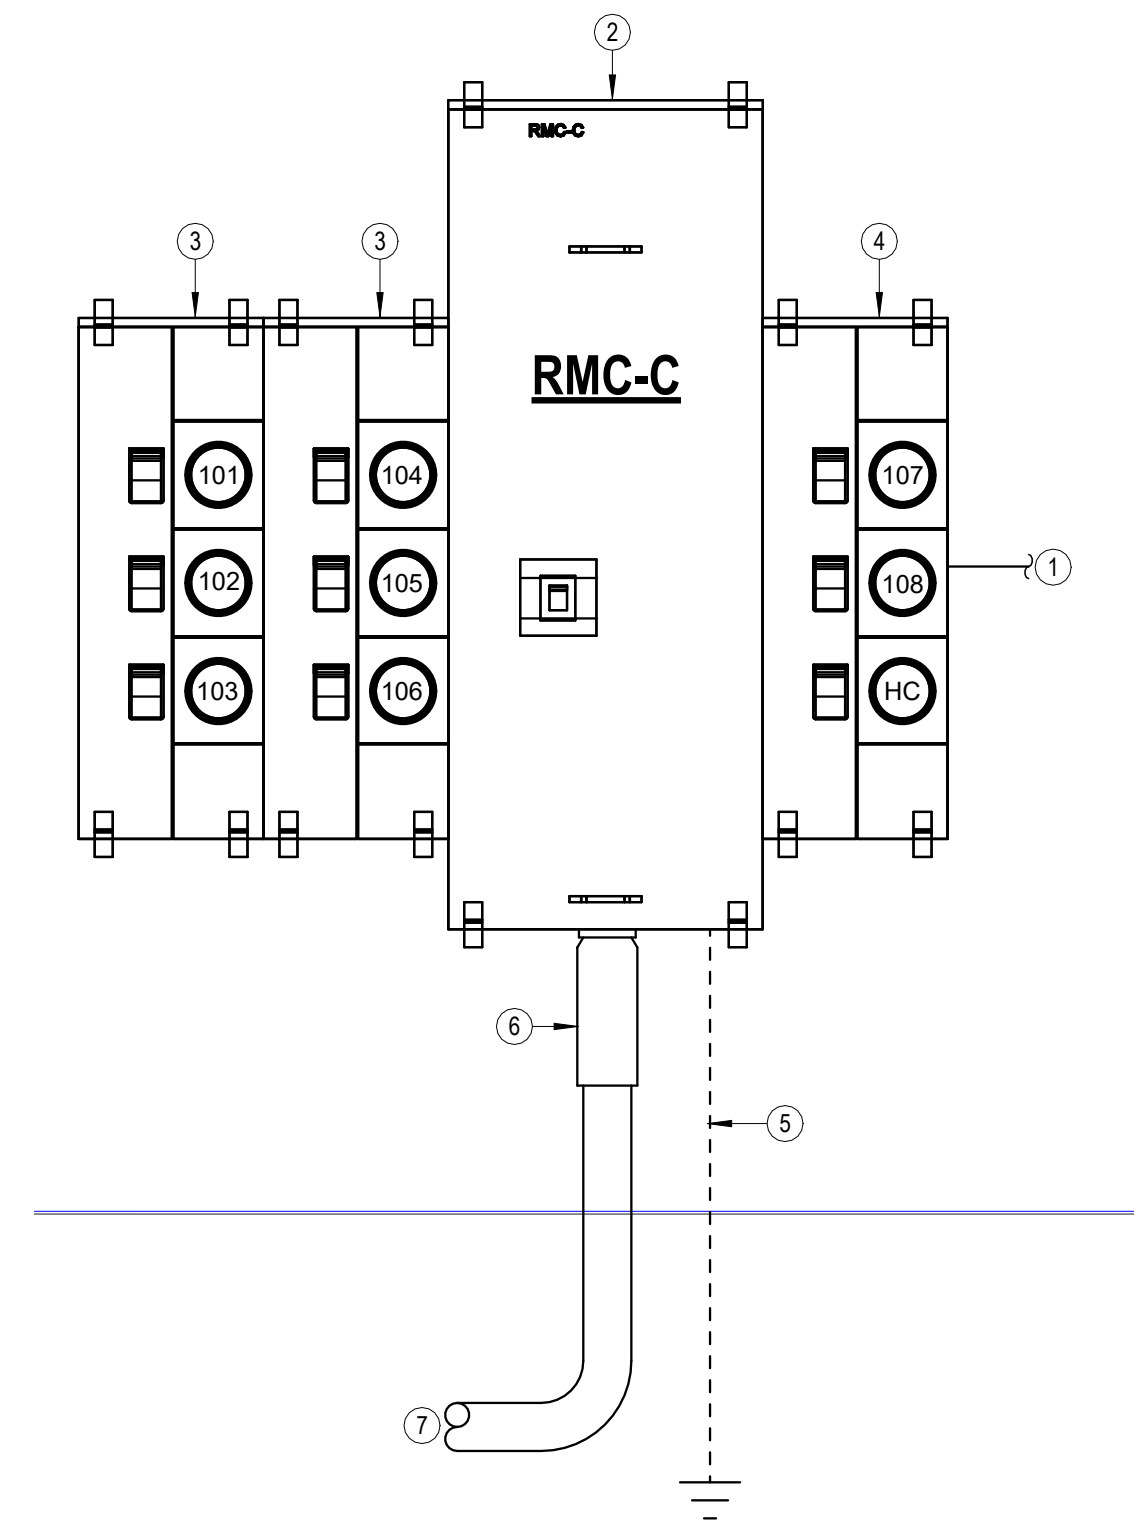
$$1'' = 1'-0''$$

$$\frac{3}{4}'' = 1'-0''$$

Ckt	Description	Circuitry	Trip (A)	FN	A	B	FN	Trip (A)	Circuitry	Description	Ckt
C101-1	REFRIGERATOR	1/2"C.1#12.#12N.#12G	20	GA	8.3 A 38.....	--	--	50	3/4"C.2#6.#6N.#10G	ELECTRIC RANGE	C101-2
C101-3	KITCHEN COUTNER RECEPTACLES	1/2"C.1#12.#12N.#12G	20	GA	--	4.5 A 38.....	--	--	--	--	C101-4
C101-5	DISHWASHER	1/2"C.1#12.#12N.#12G	20	GA	7.0 A 24.....	--	--	30	1/2"C.2#10.#10N.#10G	ELECTRIC CLOTHES DRYER	C101-6
C101-7	GARBAGE DISPOSAL	1/2"C.1#12.#12N.#12G	20	GA	--	9.8 A 24.....	--	--	--	--	C101-8
C101-9	MICROWAVE/HOOD	1/2"C.1#12.#12N.#12G	20	GA	8.3 A 21.....	--	--	30	1/2"C.2#10.#10G	ELECTRIC HOT WATER HEATER	C101-10
C101-11	WASHER	1/2"C.1#12.#12N.#12G	20	GA	--	8.3 A 21.....	--	--	--	--	C101-12
C101-13	LIVING AREA RECEPTACLES	1/2"C.1#12.#12N.#12G	20	A	12....30.....	--	--	40	1/2"C.2#8.#10G	BLOWER COIL "BC"-1"	C101-14
C101-15	BATHROOM	1/2"C.1#12.#12N.#12G	20	A	--	2.4 A 30.....	--	--	--	--	C101-16
C101-17	BEDROOM	1/2"C.1#12.#12N.#12G	20	A	8.8 A 7.8 A	--	--	20	--	--	C101-18
C101-19	CLOSE IT IN ENCLOSURE	1/2"C.1#12.#12N.#12G	20	A	--	3.0 A 7.8 A	--	20	1/2"C.2#12.#12G	HEAT PUMP "HP"-1"	C101-20
C101-21	LIVING AREA LIGHTING	1/2"C.1#12.#12N.#12G	20	A	1.1 A 0.0 A	--	--	30	--	SURGE PROTECTION	C101-22
C101-23	SPARE	--	20	A	--	0.0 A 0.0 A	--	--	--	--	C101-24

Notes:


Designation: C102									
Installed Location:					Bus Amps: 125				
Voltage: 120/208 1PH 3W-1Ph-3W					MCB Amps: MLO				
Mounting: Flush					Features &				
Enclosure: NEMA 1					Modifications: -				
					SCCR/AIC:				
					Mains FN/Note: -				

GENERAL MECHANICAL NOTES

- 1 PROVIDE SHOP DRAWINGS SHOWING EXACT ROUTING OF REFRIGERANT PIPING FOR REVIEW BY ARCHITECT AND ENGINEER.
- 2 INSTALL REFRIGERANT PIPING IN ACCORDANCE WITH ALL PROVISIONS OF ASHRAE 15 INCLUDING LATEST ADDENDA.
- 3 PROTECT PIPING PER ASHRAE 15 SECTION 9.12.
- 4 PRESSURE TEST PIPING PER ASHRAE 15 SECTION 9.13.
- 5 DUCTWORK CONSTRUCTION SHALL COMPLY WITH 2021 IECC.
- 6 APARTMENT VENTILATION IS ACHIEVED VIA BATHROOM EXHAUST FAN PER 2021 IRC SECTION M1505.4. SEE ELECTRICAL PLANS FOR TIMER SWITCH RUN TIMES, COORDINATE WITH E.C.


NOTES BY SYMBOL

- 1 RECIRCULATING RANGE HOOD BY OTHER.
 - 2 ROUTE 6"Ø EXHAUST DUCT UP TO ROOF, COORDINATE FINAL LOCATION WITH ARCHITECT. SEE MEA1.1 FOR CONTINUATION.
 - 3 MOUNT TRANSFER GRILLE IN BEDROOM 6" BELOW CEILING AND MOUNT TRANSFER GRILLE ON OPPOSITE SIDE OF WALL 6" ABOVE FINISHED FLOOR. WHERE WALL SPACE IS NOT AVAILABLE, INSTALL ABOVE DOOR AND OFFSET AS MUCH AS POSSIBLE. LINE STUD CAVITY WITH SHEET METAL DUCTWORK.
 - 4 ROUTE REFRIGERANT PIPING FROM BLOWER COIL TO CORRESPONDING HEAT PUMP UNIT AND ROUTE PIPING CONCEALED IN WALLS AND ABOVE CEILINGS.
 - 5 PROVIDE UL LISTED DRYER BOX EQUAL TO IN-O-VATE TECHNOLOGIES IN WALL INSTALLED IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS, AND ROUTE 4"Ø DRYER EXHAUST DUCT TO ROOF JACK WITH BACKDRAFT DAMPER. MAXIMUM ALLOWABLE EQUIVALENT DUCT LENGTH = 35'. UTILIZE LONG RADIUS SMOOTH ELBOWS WHERE REQUIRED. MAXIMUM EQUIVALENT DUCT LENGTH MAY BE INCREASED WHERE DRYER MANUFACTURER'S INSTALLATION INSTRUCTIONS ALLOW, AND DOCUMENTATION IS PROVIDED TO CODE OFFICIAL PRIOR TO CONCEALMENT INSPECTION. COORDINATE EXACT REQUIREMENTS WITH EQUIPMENT PROVIDED. PROVIDE PERMANENT LABEL IDENTIFYING EQUIVALENT LENGTH OF DRYER DUCT INSTALLED PER IMC 504.
- NOTE: ANNULAR SPACE AROUND DUCT IS TO BE SEALED AT ALL PENETRATIONS OF FLOORS AND CEILINGS WITH U.L. LISTED FIRE STOPPING SYSTEM.
- 6 ROUTE REFRIGERANT PIPING FROM HEAT PUMP TO BLOWER COIL. PENETRATE WALL 18" AFG AND ROUTE PIPING CONCEALED IN WALLS AND ABOVE CEILINGS. UTILIZE PIPE PENETRATION ASSEMBLY EQUAL TO AIREX TITAN OUTLET.
 - 7 MOUNT HEAT PUMP ON 3-1/2" THICK CONCRETE PAD.
 - 8 8"x8" OUTDOOR AIR DUCT UP TO INTAKE HOOD ON ROOF. PROVIDE GRAVITY ROOF INTAKE VENTILATOR WITH BIRD SCREEN EQUAL TO GREENHECK GR8-S. MINIMUM 0.37 SQUARE FOOT THROAT AREA. PROVIDE WITH ROOF CURB COMPATIBLE WITH ROOF SLOPE AND MATERIAL.
 - 9 CONNECT OUTDOOR AIR DUCT TO RETURN AIR DUCT. PROVIDE BALANCING DAMPERS AND BALANCE AS INDICATED ON PLANS, SEE DETAIL 2-M6.1 FOR MORE INFORMATION.
 - 10 ELECTRICAL EQUIPMENT SHOWN FOR COORDINATION. DO NOT ROUTE DUCT ABOVE OR BELOW EQUIPMENT AND MAINTAIN WORKING CLEARANCE SHOWN.

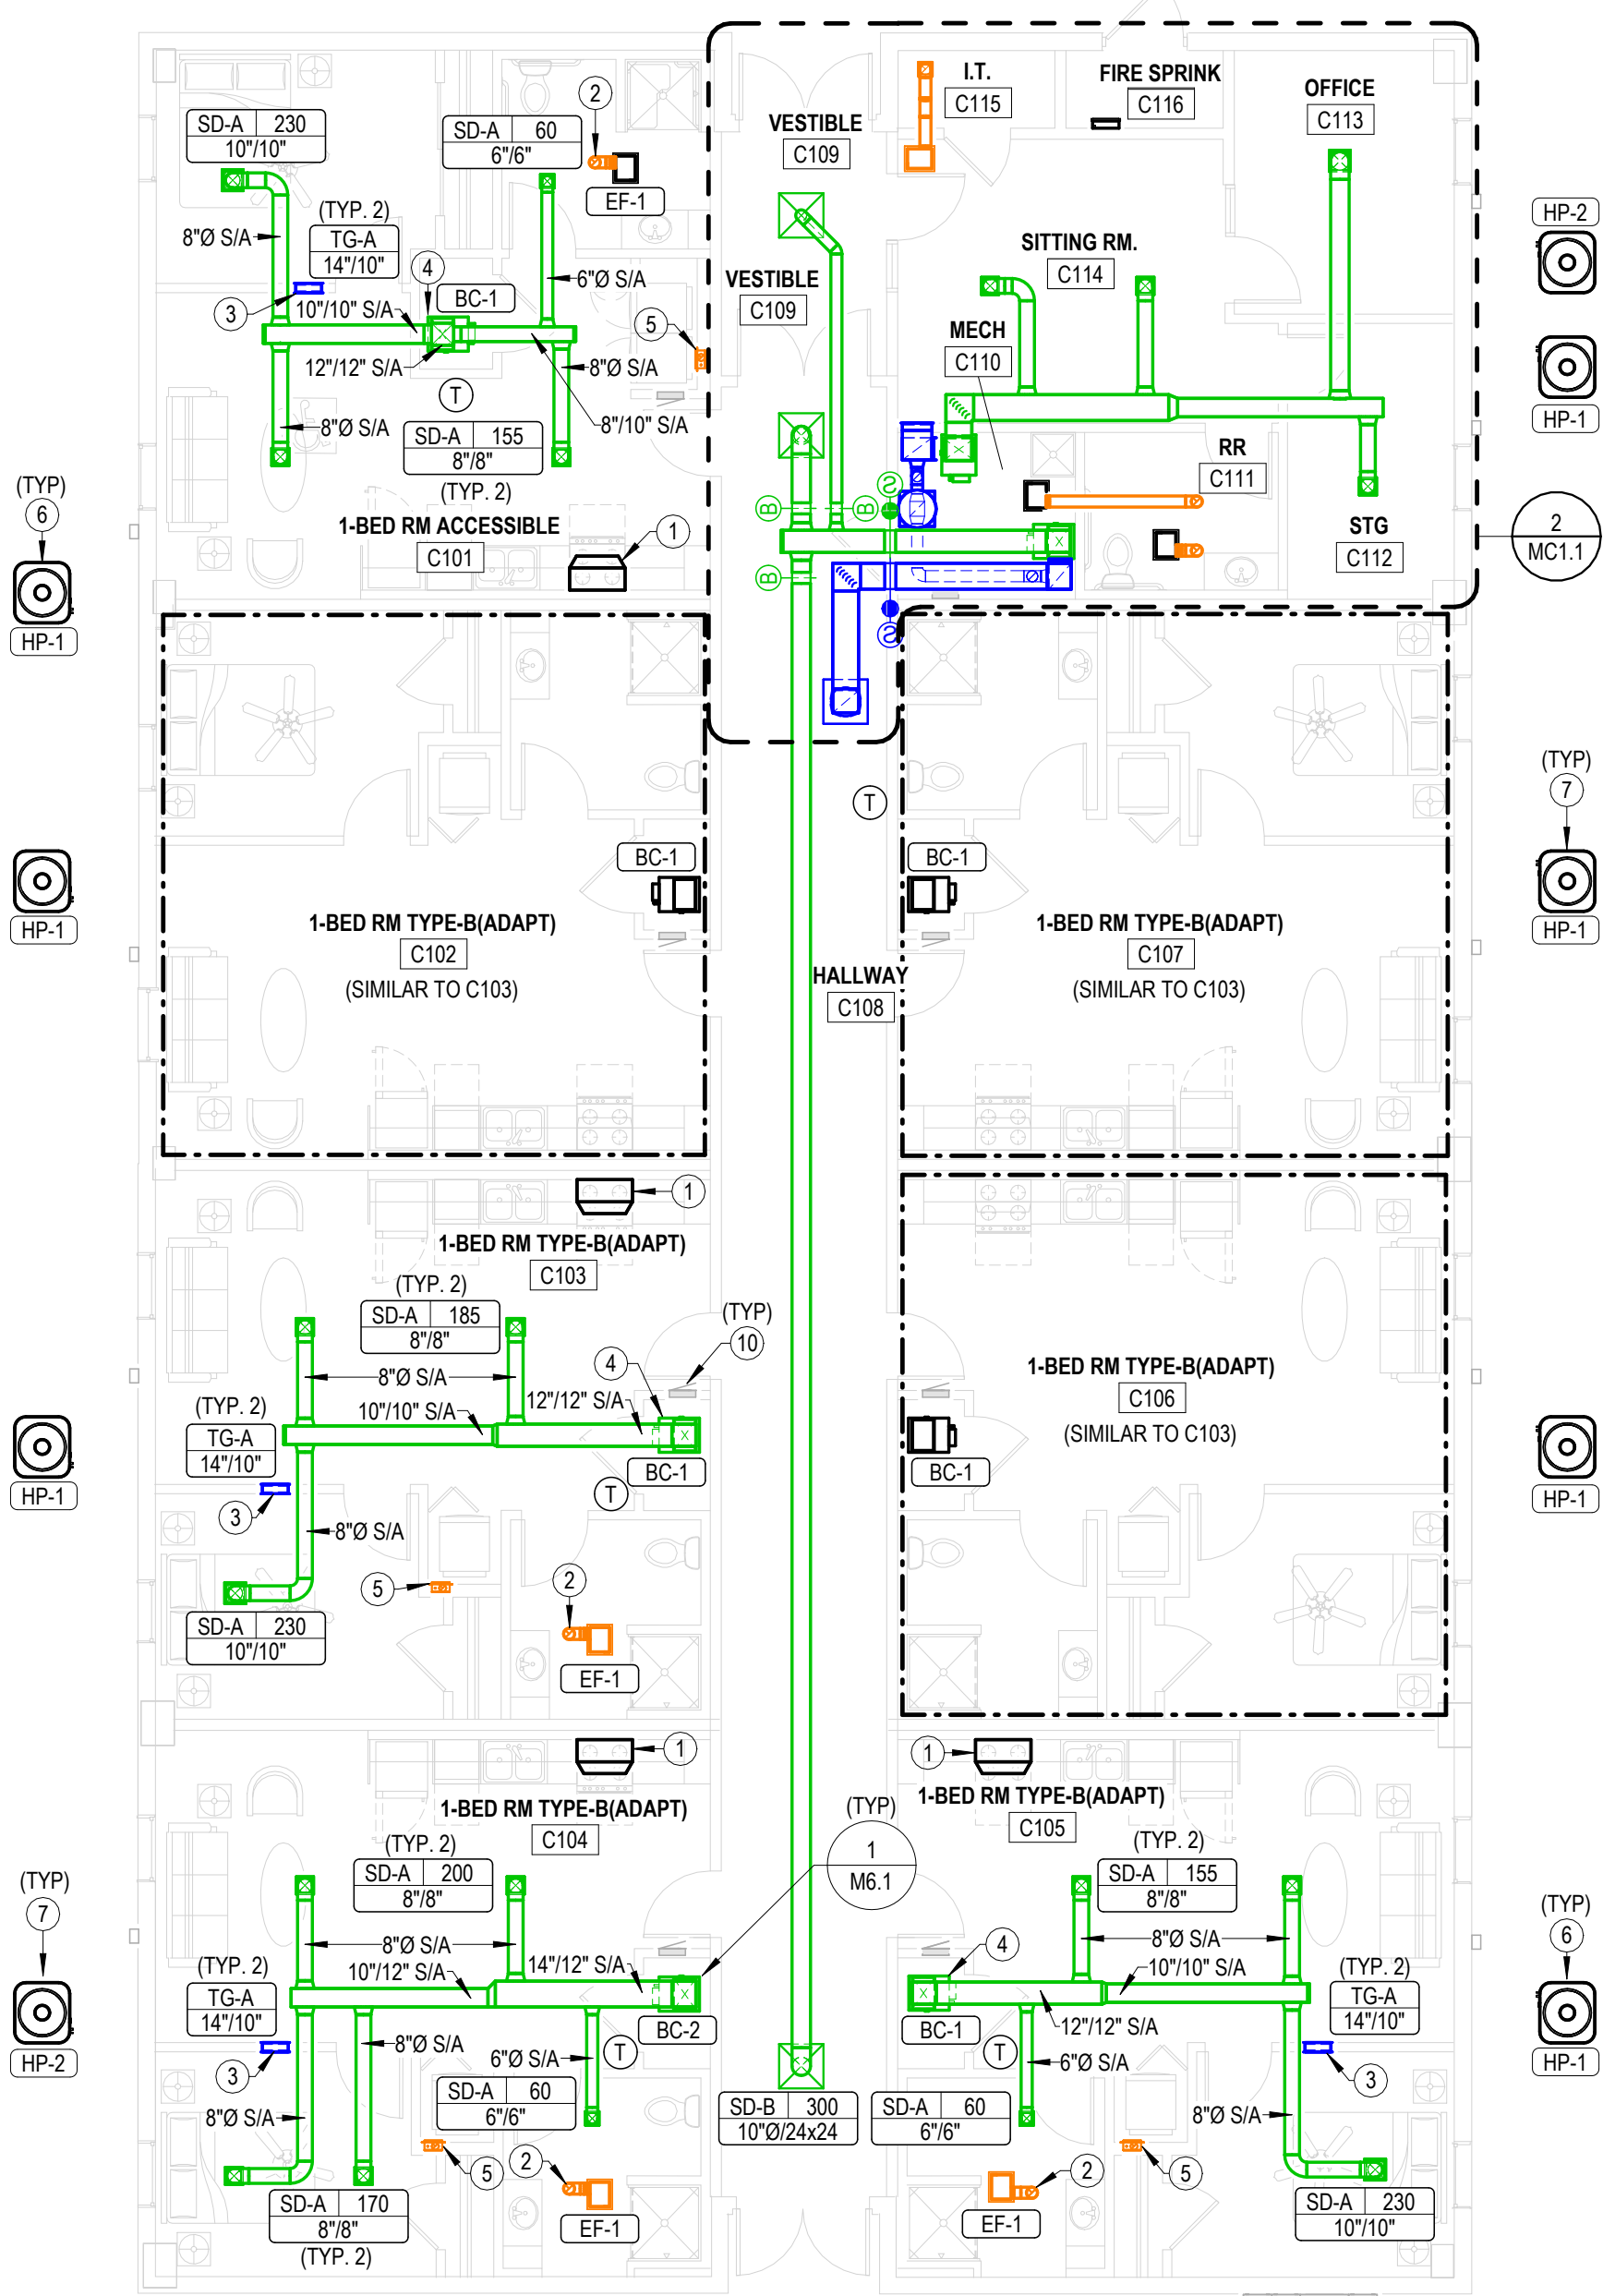


1 HVAC FLOOR PLAN-BUILDING C-1ST FLR

1/8" = 1'-0"

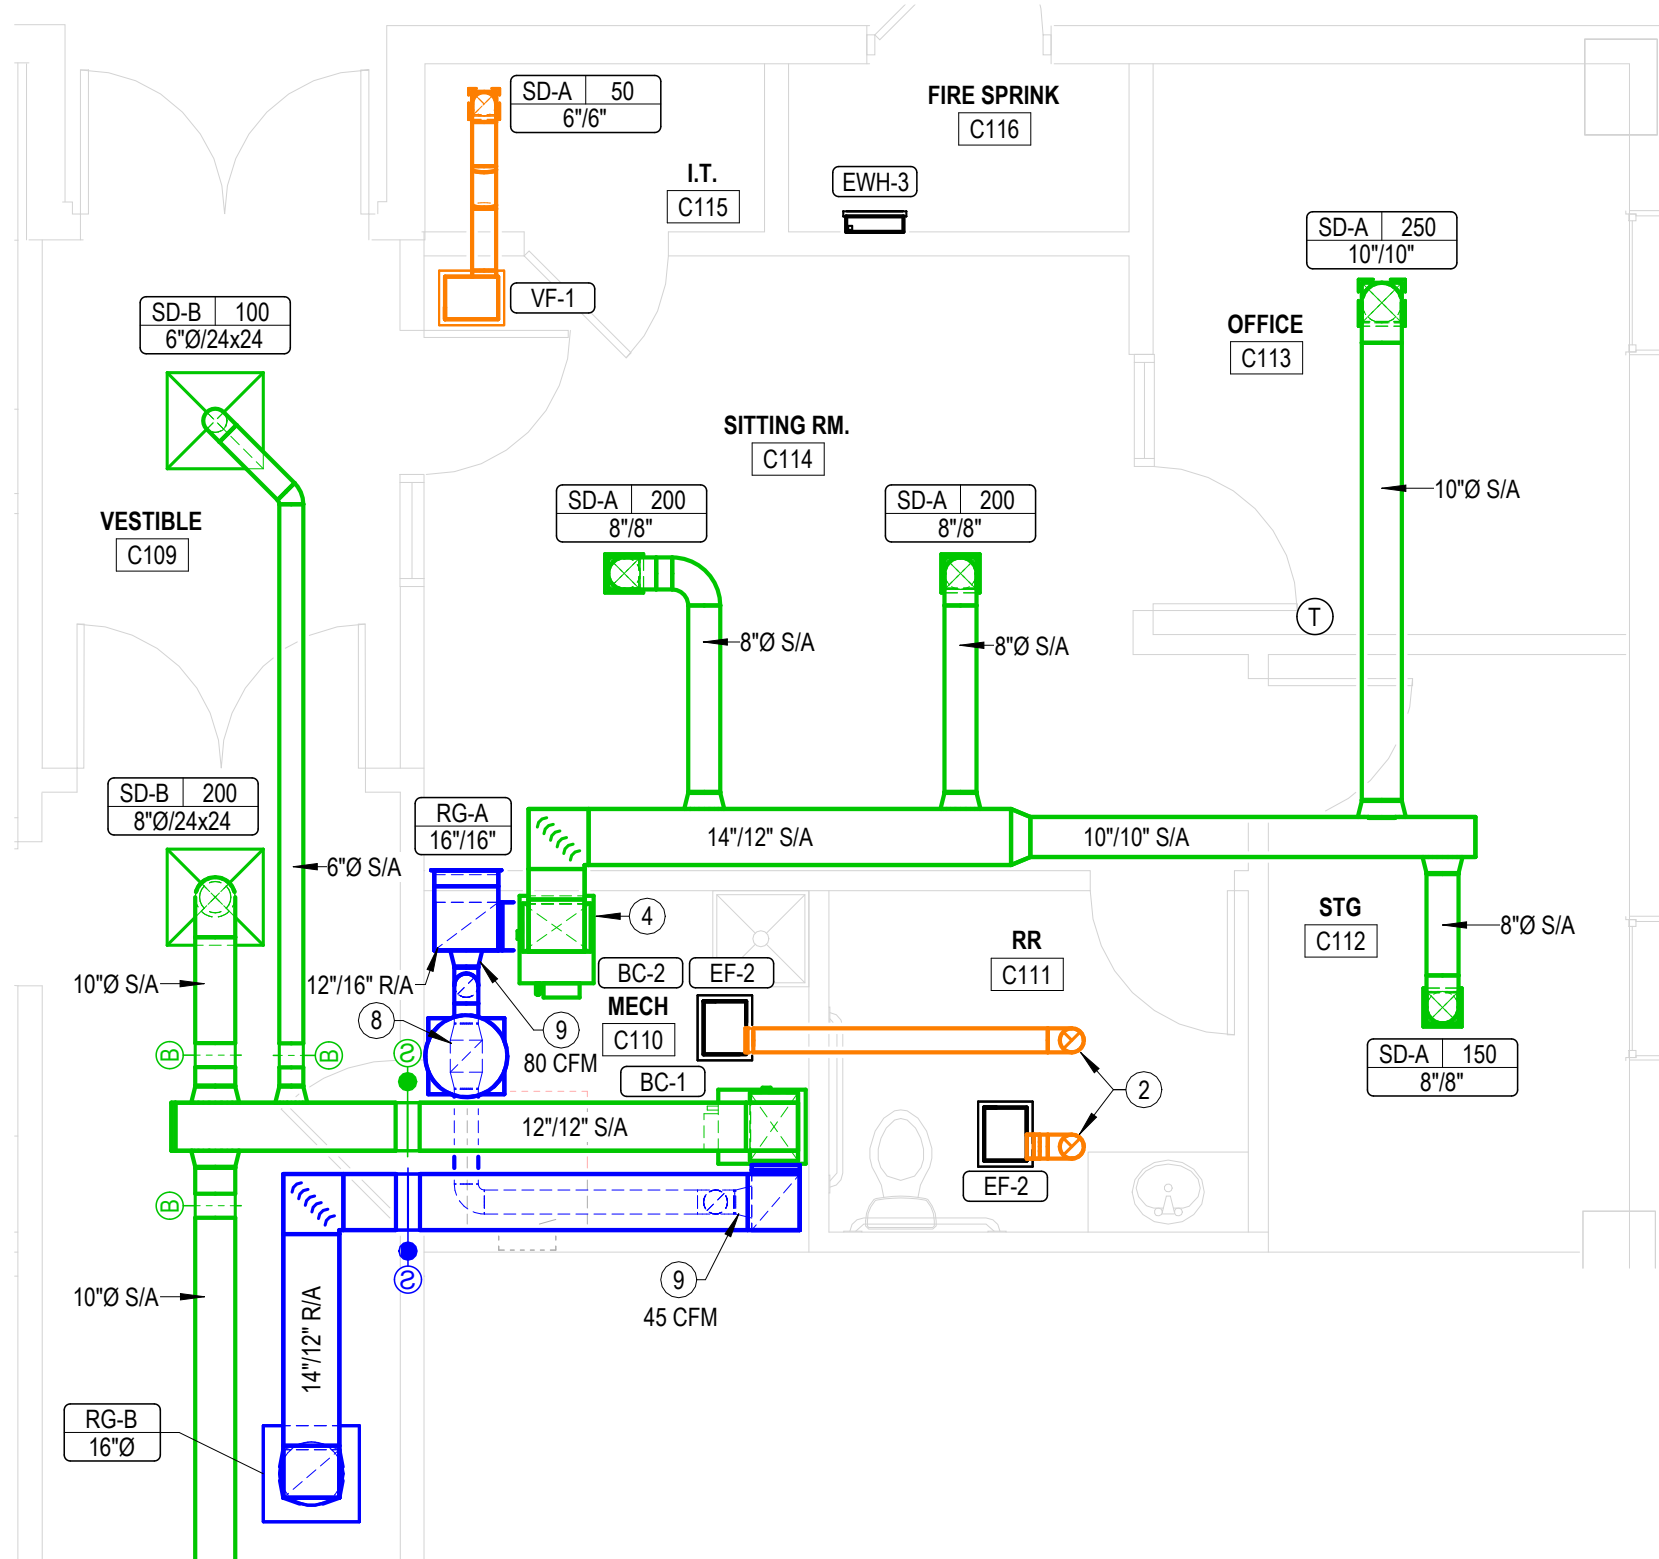


2 ENLARGED PARTIAL HVAC FLOOR PLAN

1/4" = 1'-0"

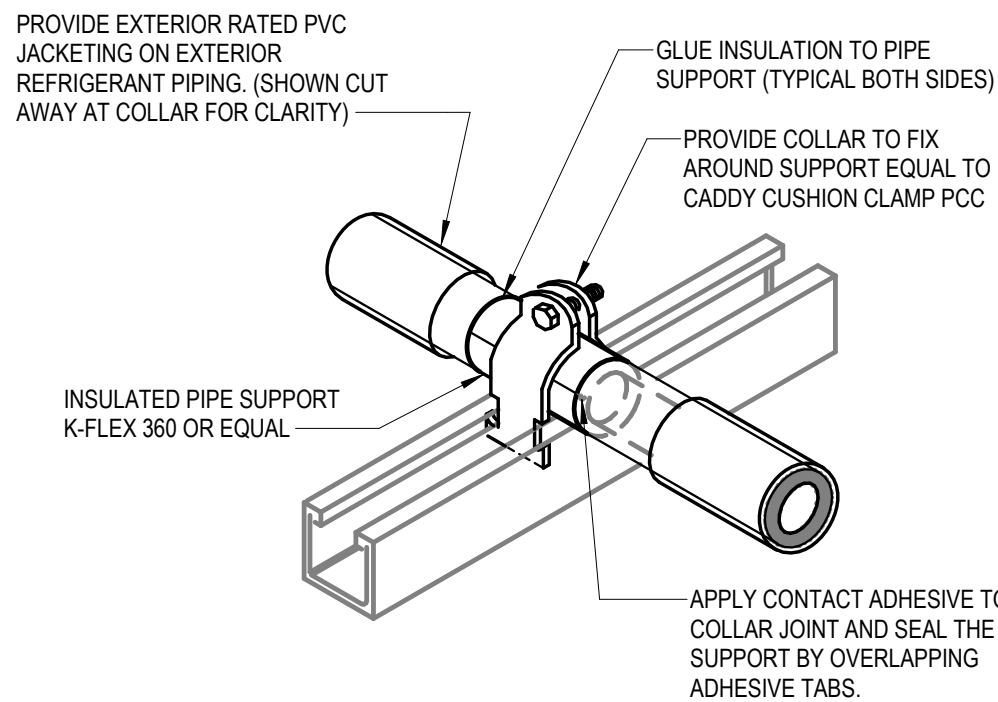


4 EXTERIOR REFRIGRANT PIPING INSULATION DETAIL

NO SCALE

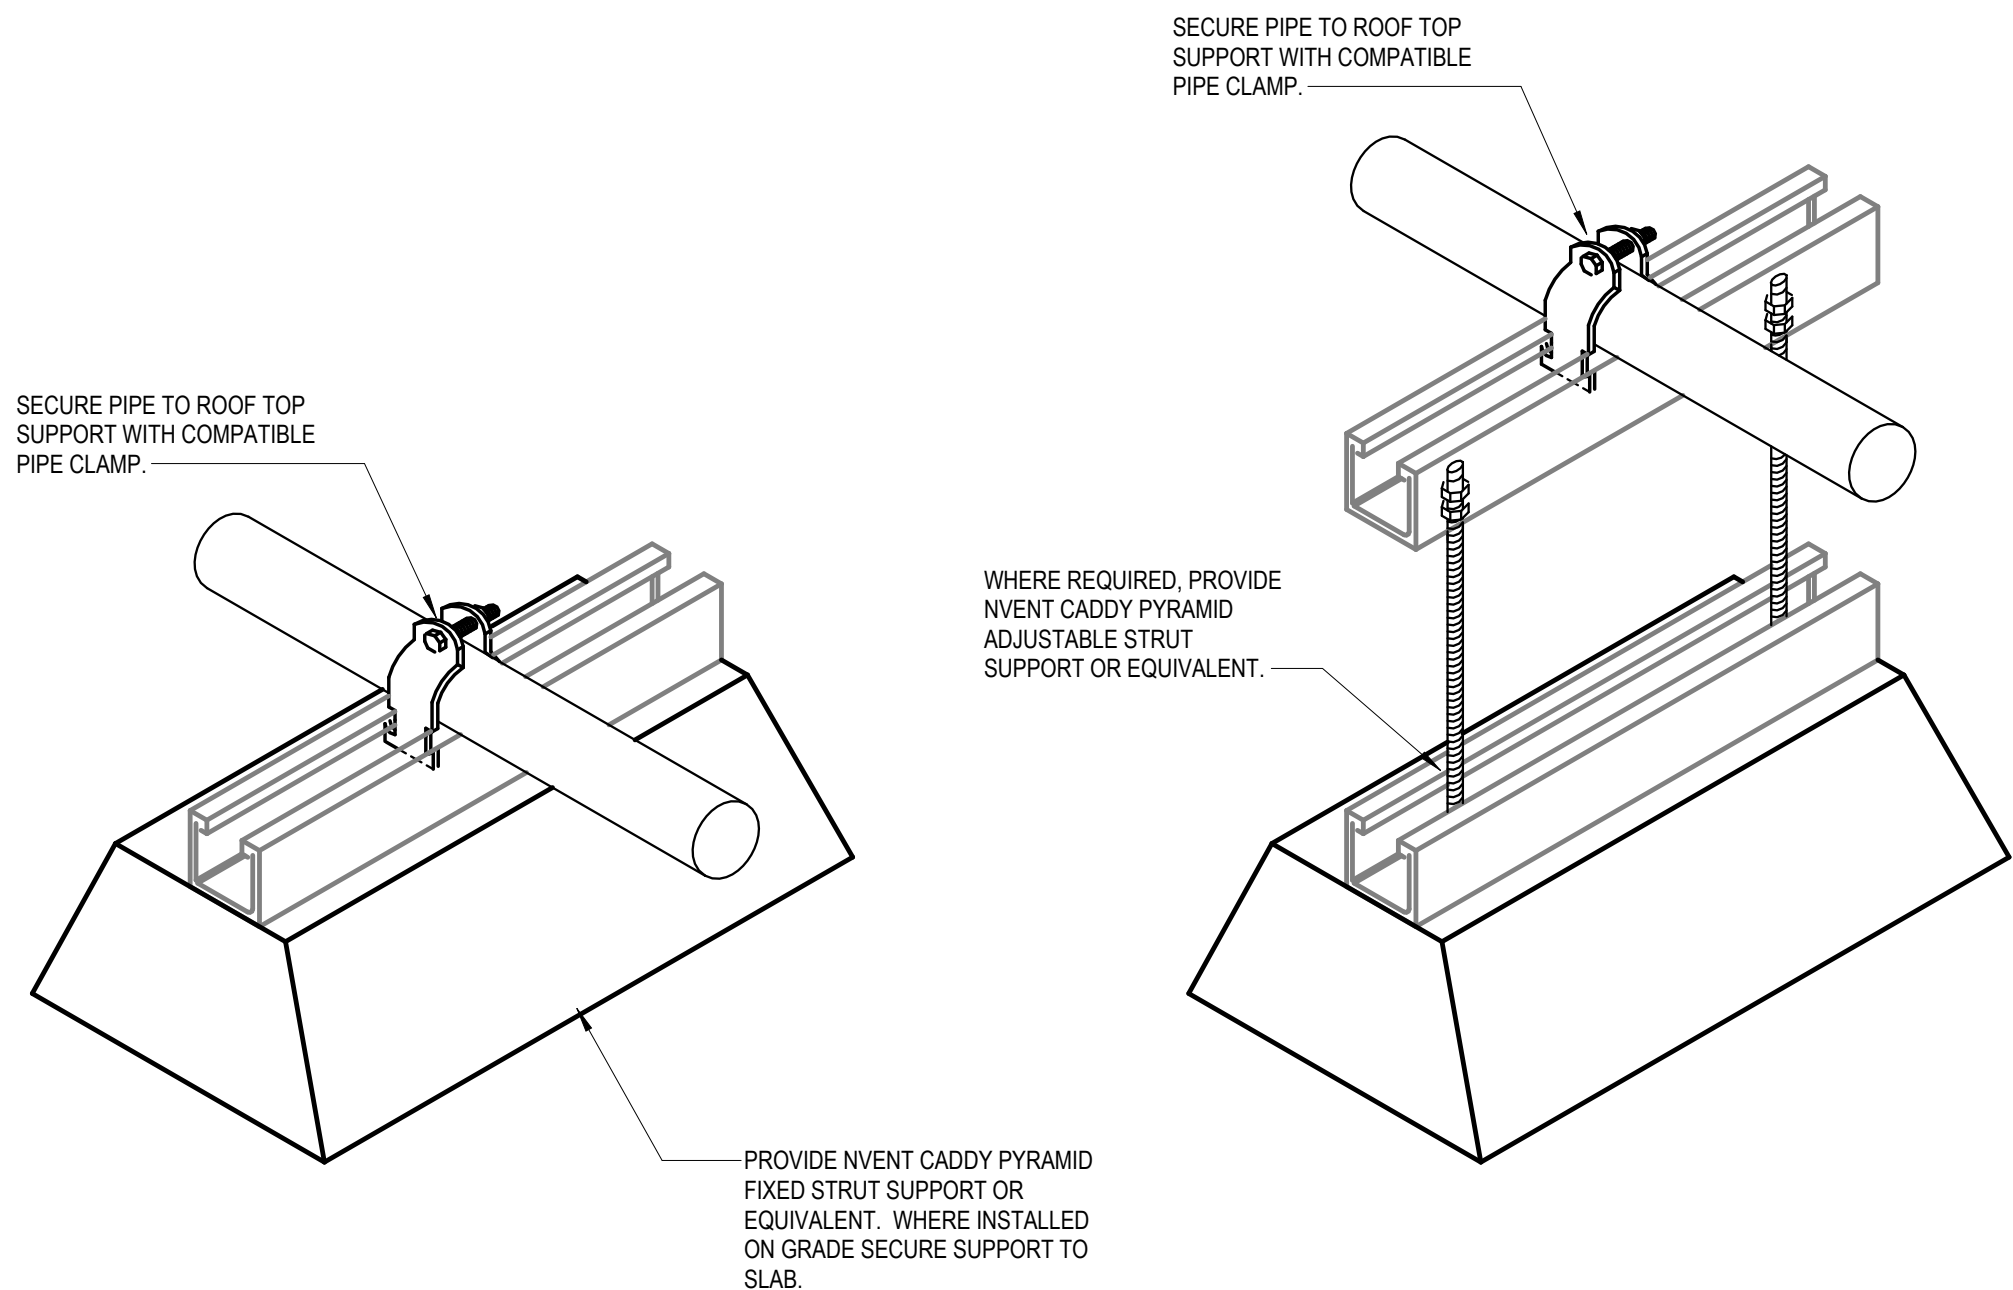


3 EXTERIOR PIPING SUPPORT DETAIL

NO SCALE

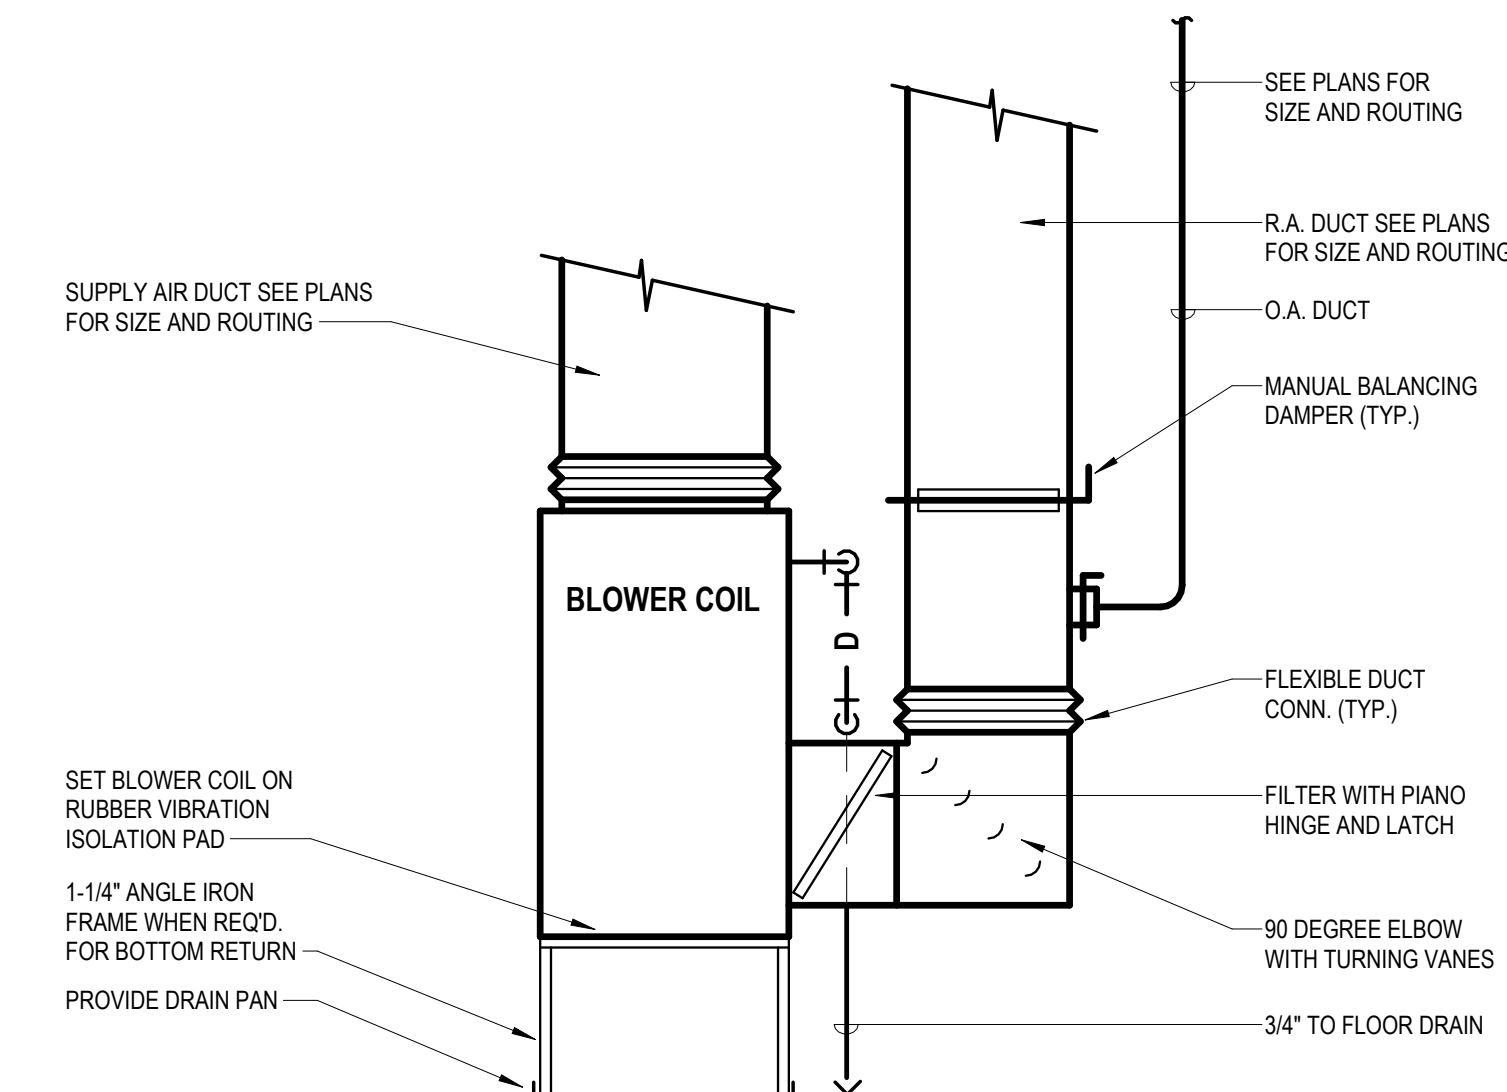

2 BLOWER COIL DETAIL

NO SCALE

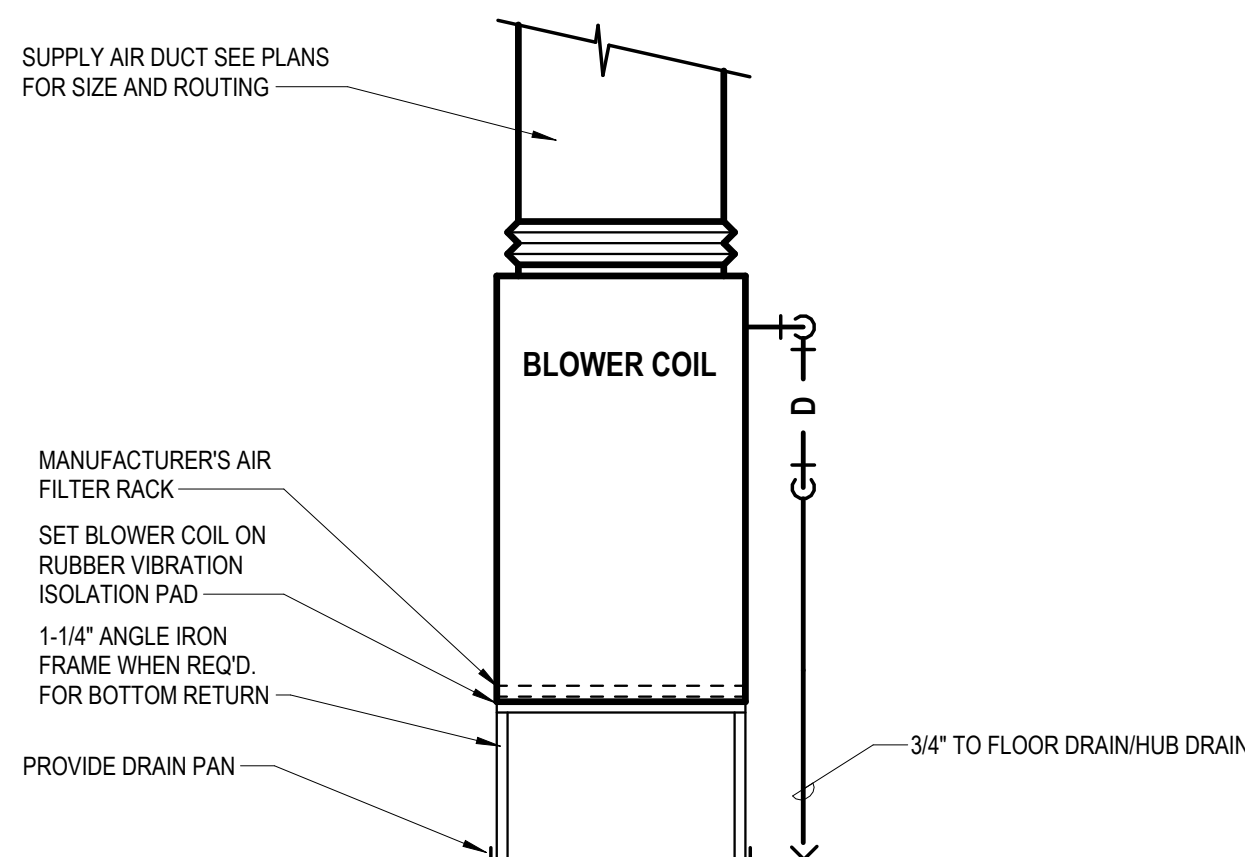

1 APARTMENT BLOWER COIL DETAIL

NO SCALE

ELECTRIC CABINET HEATER SCHEDULE						
NOTES: 1. PROVIDE WITH HIGH TEMP. THERMAL CUTOUT AND FAN DELAY. 2. PROVIDE WITH INTEGRAL THERMOSTAT AND UNIT MOUNTED DISCONNECT SWITCH. 3. PROVIDE WITH SURFACE MOUNT OR RECESSED FRAME AS REQUIRED. FIELD COORDINATE EXACT REQUIREMENTS WITH EXISTING CONDITIONS AND ARCH.						
MARK	MANUFACTURER	MODEL	WATTS	VOLT	PHASE	DESCRIPTION
EW-1	TRANE	UHWA	3.0 kW	208 V	1	Architectural fan forced wall heater
EW-2	TRANE	UHWA	3.0 kW	208 V	1	Architectural fan forced wall heater
EW-3	TRANE	UHWA	3.0 kW	208 V	1	Architectural fan forced wall heater

HEAT PUMP SCHEDULE																	
NOTES: 1. REFRIGERANT LINES SHALL BE FIELD FABRICATED. COORDINATE LINE SIZING REQUIREMENTS WITH EQUIPMENT MANUFACTURER FOR LENGTH. 2. PROVIDE WITH R454B REFRIGERANT. 3. INSTALL REFRIGERANT PIPING IN ACCORDANCE TO ASHRAE STANDARD 15.																	
MARK	MANUFACTURER	MODEL	NOMINAL CAPACITY	COOLING						HEATING				ELECTRICAL			
				EDB	EDB	EWB	NET SENSIBLE	SEER2	OA EDB	EDB	NET TOTAL	HSPF2	PHASE	MCA	MOCF	VOLTAGE	
HP-1	TRANE	5TWR4018	1.5 ton	102 °F	76 °F	64 °F	12,434 Btu/h	16.697 Btu/h	14.3	47 °F	70 °F	18,300 Btu/h	7.5	1	12.0 A	20.0 A	208 V
HP-2	TRANE	5TWR4024	2.0 ton	102 °F	76 °F	64 °F	15,640 Btu/h	20.683 Btu/h	14.3	47 °F	70 °F	22,400 Btu/h	7.5	1	13.0 A	20.0 A	208 V
HP-3	TRANE	5TWR4030	2.5 ton	102 °F	76 °F	64 °F	18,778 Btu/h	24.363 Btu/h	14.3	47 °F	70 °F	25,600 Btu/h	7.5	1	16.0 A	25.0 A	208 V
HP-4	TRANE	5TWR4036	3.0 ton	102 °F	76 °F	64 °F	20,590 Btu/h	28.355 Btu/h	14.3	47 °F	70 °F	31,600 Btu/h	7.5	1	19.0 A	30.0 A	208 V
HP-5	TRANE	5TWR4042	3.5 ton	102 °F	76 °F	64 °F	27,928 Btu/h	36.629 Btu/h	14.3	47 °F	70 °F	38,500 Btu/h	7.5	1	24.0 A	40.0 A	208 V

BLOWER COIL SCHEDULE											
NOTES: 1. SINGLE POINT CONNECTION REQUIRED, COORDINATE THE EXACT ELECTRICAL REQUIREMENTS OF EQUIPMENT PROVIDED WITH E.C. 2. ELECTRIC HEATER SHALL NOT OPERATE SIMULTANEOUSLY WITH HEAT PUMP. ELECTRIC HEATER SHALL BE USED AS BACK-UP HEAT ONLY. 3. PROVIDE 7-DAY PROGRAMMABLE THERMOSTAT COMPATIBLE WITH REQUIREMENTS OF 2021 IECC. 4. PROVIDE 2 SETS OF MERV-8 FILTERS.											
MARK	MANUFACTURER	MODEL	FAN		ELECTRIC HEAT		VOLTAGE	PHASE	ELECTRICAL		MOCF
			AIRFLOW	ESP	CIRCUIT	CIRCUIT 2			MCA	MCA 2	
BC-1	TRANE	STEM4B02AC21	600 CFM	0.50 in-wg	5.8 kW		208 V	1	39.0 A		40.0 A
BC-2	TRANE	STEM4B03AC31	800 CFM	0.50 in-wg	5.8 kW		208 V	1	39.0 A		40.0 A
BC-3	TRANE	STEM4D04AC31	1,000 CFM	0.50 in-wg	7.2 kW		208 V	1	48.0 A		50.0 A
BC-4	TRANE	STEM4D05AC41	1,050 CFM	0.50 in-wg	7.2 kW		208 V	1	48.0 A		50.0 A
BC-5	TRANE	STEM4D07AC51	1,400 CFM	0.50 in-wg	7.2 kW	3.6 kW	208 V	1	51.0 A	22.0 A	60.0 A

GRILLES, REGISTERS, & DIFFUSERS SCHEDULE									
GENERAL NOTES: 1. PROVIDE MOUNTING FRAME AS REQUIRED FOR CEILING TYPE. 2. MAXIMUM NC SHALL BE 25. 3. RUNOUTS TO DIFFUSERS SHALL BE SAME SIZE AS NECK, U.N.O. 4. PAINT OBJECTS VISIBLE THROUGH GRILLES WITH FLAT BLACK PAINT. 5. COORDINATE LOCATIONS OF ALL WALL DEVICES WITH ARCHITECT.									
MARK	MANUFACTURER	MODEL	APPLICATION			MOUNTING	DAMPER	DESCRIPTION	NOTES
RG-A	TITUS	350RL	SUPPLY	RETURN	EXHAUST	Surface Mount	No	STEEL LOUVERED RETURN GRILLE, SIZE AS INDICATED ON DRAWINGS.	
RG-B	TITUS	PAR				Lay-In Full Face	No	24"x24" STEEL PERFORATED FACE RETURN GRILLE, NECK SIZE AS INDICATED ON PLANS.	
SD-A	TITUS	300R				Surface Mount	Yes	STEEL DOUBLE DEFLECTION SUPPLY GRILLE WITH FRONT BLADES PARALLEL TO LONG DIMENSION, SIZE AS INDICATED ON DRAWINGS.	
SD-B	TITUS	TMS				Lay-In Full Face	No	24"x24" STEEL SQUARE LOUVERED DIFFUSER, NECK SIZE AS INDICATED ON DRAWINGS.	
TG-A	TITUS	350RL				Surface Mount	No	STEEL LOUVERED TRANSFER GRILLE, SIZE AS INDICATED ON DRAWINGS.	

EXHAUST FAN SCHEDULE								
NOTES: 1. PROVIDE MANUFACTURER'S ROOF JACK OR WALL CAP, SEE PLANS. 2. FIXTURE SHALL OPERATE AT < 1 SONE. 3. PROVIDE EC MOTOR WITH INTEGRAL DISCONNECT. 4. PROVIDE INTEGRAL BACKDRAFT DAMPER. 5. PROVIDE WITH MANUFACTURER'S FILTER GRILLE.								
MARK	MANUFACTURER	MODEL	CFM	ESP	POWER	ELECTRICAL VOLTAGE	PHASE	NOTES
EF-1	PANASONIC	FV-0511VQ1	80 CFM	0.25 in-wg	22 W	120 V	1	1,2,3,4
EF-2	PANASONIC	FV-0511VQ1	50 CFM	0.25 in-wg	22 W	120 V	1	1,2,3,4
EF-3	PANASONIC	FV-0511VQ1	110 CFM	0.25 in-wg	22 W	120 V	1	1,2,3,4
VF-1	GREENHECK	SP-A70	50 CFM	0.20 in-wg	16 W	120 V	1	2,3,4,5

LST Consulting Engineers, PA

MANHATTAN	WICHITA	OVERLAND PARK
4809 Vue Du Lac Place Suite 201 Manhattan, KS 66503	125 S. Washington Suite 150 Wichita, KS 67202	6701 W. 64th St. Suite 214 Overland Park, KS 66202

Project 25045

www.LSTengineers.com
mail@LSTengineers.com

11/20/2025



























































Plumbing Sheet Index	
P01	PLUMBING TIME SHEET-BLDG A, B, & C
PA1	PLUMBING SCHEDULES-BLDG A, B, & C
PA10	WASTE AND VENT-BLDG A-UNDER FLOOR
PA11	WASTE AND VENT-BLDG A-FIRST FLOOR
PA12	WASTE AND VENT-BLDG A-SECOND & THIRD FLOOR
PA21	DOMESTIC WATER-BLDG A-FIRST FLOOR
PA22	DOMESTIC WATER-BLDG A-SECOND & THIRD FLOOR
PA91	PLUMBING RISERS - A
PA92	PLUMBING RISERS - A
PA93	PLUMBING RISERS - A
PA94	PLUMBING RISERS - A
PB11	PLUMBING-BLDG B
PB91	PLUMBING RISERS - B
PC11	PLUMBING-BLDG C
PC91	PLUMBING RISERS - C

- ### GENERAL PLUMBING NOTES

- A. FIELD VERIFY ALL NEW WATER, WASTE, AND VENT PIPING CONNECTIONS AND PROVIDE NEW CONNECTIONS AS REQUIRED FOR PERIMETER VENTING AND WASTEWATER.
- B. PITCH UNDERFLOOR SANITARY WASTE PIPING OVER 2" AT 18" PER FOOT, 2" AND SMALLER AT 1/4" PER FOOT.
- C. FIELD VERIFY LOCATION AND INVERTS OF SITE UTILITIES PRIOR TO INSTALLATION.
- D. ROUTE ALL WATER AND SANITARY SEWER SERVICES TO SITE UTILITIES 5'-0" FROM BUILDING UNLESS NOTED OTHERWISE, REFER TO CIVIL PLANS.
- E. WASTE AND VENT PIPING BELOW FLOOR AND THROUGH FLOOR SHALL BE 2" MINIMUM.
- F. LOCATE ALL PIPING AND EQUIPMENT AS INDICATED ON THE DRAWINGS ARE APPROXIMATE AND SUBJECT TO MINOR ADJUSTMENTS IN THE FIELD. WORK SHALL BE COORDINATED WITH ALL OTHER TRADES TO AVOID INTERFERENCE IN THE FIELD.
- G. FIELD PRODUCT SHALL BE A COMPLETE AND FUNCTIONING SYSTEM, AND SHALL CONFORM TO ALL REQUIREMENTS OF APPLICABLE FEDERAL, STATE, AND LOCAL CODES, INCLUDING BUT NOT LIMITED TO THE INTERNATIONAL (OR UNIFORM, DEPENDING ON JURISDICTION) PLUMBING CODE AND ALL APPLICABLE LOCAL MECHANICAL CODES.
- H. LOCATE EQUIPMENT REQUIRING ACCESS 2'-0" MAXIMUM ABOVE CEILING.
- I. LOCATE PIPING AND EQUIPMENT OUTSIDE OF THE NEC REQUIRED CLEAR SPACE ABOVE AND AROUND ELECTRICAL EQUIPMENT. TRANSFER OF POWER FROM OTHER ELECTRICAL EQUIPMENT. COORDINATE WITH ELECTRICAL CONTRACTOR.
- J. PENETRATIONS OF RATED ASSEMBLIES SHALL BE FIRE STOPPED. FIRE STOPPING SHALL BE U.L. LISTED. SEE ARCHITECTURAL DRAWINGS FOR LOCATIONS OF RATED ASSEMBLIES.
- K. PROVIDE SLEEVES AND/OR OPENINGS TO RUN PIPES THROUGH FOUNDATIONS, FLOORS, WALLS, AND ROOF.
- L. MAINTAIN CLEAR ACCESS TO SERVICE EQUIPMENT AND OTHER ACCESSORIES REQUIRING SERVICE, VISUAL INSPECTION, OR HAND ACCESS TO EQUIPMENT (IF REQUIRED). PROVIDE ACCESS PANELS OF THE TYPE SELECTED TO SUIT MATERIALS IN WHICH INSTALLED.
- M. TRANSITION FROM PIPING SIZES SHOWN TO PROPERLY CONNECT TO EQUIPMENT.
- N. INSULATION SHALL BE CONTINUED IN THE DIRECTION OF FLOW UNTIL ANOTHER SIZE IS SHOWN.
- O. INSTALL ALL EQUIPMENT IN ACCORDANCE WITH THE RESPECTIVE MANUFACTURER'S WRITTEN INSTALLATION INSTRUCTIONS, AT A LEVEL OF QUALITY AND WORKMANSHIP CONSISTENT WITH THE SPECIFICATIONS.
- P. INSTALL EXPOSED PIPING AS HIGH AS PRACTICAL IN ROOMS WITHOUT CEILINGS.
- Q. PRIOR TO STARTING WORK, SUBMIT SHOP DRAWINGS FOR ALL PIPING EQUIPMENT AND MATERIALS. SUBSTITUTE EQUIPMENT AND MATERIALS SHALL BE INSTALLED WITHOUT PRIOR APPROVAL SHALL BE SUBJECT TO REPLACEMENT AT CONTRACTOR'S EXPENSE.
- R. CONTRACTOR SHALL OBTAIN AND PAY FOR ALL NECESSARY PERMITS AND SHALL ARRANGE FOR ALL INSPECTIONS AS REQUIRED.
- S. PROVIDE ONE YEAR WARRANTY FOR ALL WORKMANSHIP AND MATERIALS AFTER THE DATE OF FINAL ACCEPTANCE.

GENERAL PLUMBING DEMOLITION NOTES

- A. ALL PIPING TAKEN OUT OF SERVICE SHALL BE REMOVED. WHERE PIPING TO BE REMOVED IS CONNECTED TO EXISTING PIPING TO REMAIN, PIPING SHALL BE REMOVED BACK TO MAIN AFFECTED UNLESS INDICATED OTHERWISE. CONTRACTOR SHALL DISPOSE OF PIPING OR DELIVER TO OWNER, AS DIRECTED BY OWNER.
- B. WHERE PIPING TAKEN OUT OF SERVICE IS LOCATED BELOW SLAB AND IS UNABLE TO BE REMOVED, CAP BELOW SLAB.
- C. COORDINATE CUTTING, PATCHING OF EXISTING WALLS, FLOORS, CEILING AND DOORS AFFECTED BY MECHANICAL DEMOLITION WITH G.C.
- D. ALL EQUIPMENT TAKEN OUT OF SERVICE SHALL BE REMOVED. EQUIPMENT SHALL BE DELIVERED TO OWNER OR DISPOSED OF AS DIRECTED BY OWNER.
- E. REMOVE ALL INSTALLATION FROM PROJECT AREA, UNLESS REQUIRED FOR NEW WORK OR EXISTING INSTALLATION NOT AFFECTED BY REMODEL. COORDINATE WITH OWNER AND G.C.
- F. SERVICES TO ITEMS NOT REMOVED AS PART OF THIS WORK SHALL BE RESTORED UPON COMPLETION OF THIS WORK TO FULL OPERATIONAL CONDITION.
- G. NOT ALL ITEMS REQUIRED TO BE DEMOLISHED MAY BE INDICATED ON DRAWINGS. ALL DEMOLITION OF AFFECTED SPACE SHALL BE PERFORMED AS IF INDICATED.
- H. FIELD VERIFY EXACT LOCATION OF ALL EXISTING PLUMBING INSTALLATION INDICATED ON DRAWINGS.
- I. ALL ITEMS TO BE RE-USED OR RE-LOCATED SHALL BE CLEANED, REPAIRED, AND RESTORED TO LIKE NEW CONDITION PRIOR TO RE-USE.

General Plan Symbols		Plumbing Symbols	
	Plan Revision Number		Nominal Pipe Size
	Detail Number on Sheet		Above Ground Piping
	Sheet Number Where Detail is Placed		Pipe Slope (When Applicable)
	Keynote Symbol		Existing Pipe To Remain
	Continuation Symbol		Pipe To Be Demolished
	Point Where New Connects To Existing		Domestic Cold Water
	Room Name / Number		Non-Feasible Water
	Area Being Demolished		Soft Cold Water
	Area Not In Contract		Filtered Cold Water
	Electrical Equipment.		Reverse Osmosis Water
	Do not route HVAC installation above or below equipment. Maintain working clearance as indicated by dashed line.		Domestic Hot Water
			Domestic Hot Water 140°
			Hot Water Recirculation
			Hot Water Recirculation 140°
			Sanitary Drain
			Sanitary Vent
			Radon Mitigation
			Sanitary Wet Vent
			Combination DWV
			Condensate Drain
			Indirect Drain
			Grease Waste
			Grease Vent
			Pump Discharge
			Storm Drain
			Storm Overflow
			Compressed Air
			Natural Gas
			Liquid Propane
			Pipe Rise / Drop
Abbreviations		Pipe Accessory Notes	
Ø	ROUND		4" FCO
ABV	ABOVE		2" CHECK
AC	AIR CONDITIONING		2" BALANCE
AD	AREA DRAIN		2" CIRC
ADD	ADDENDUM		2" GATE
AFF	ABOVE FINISHED FLOOR		2" S/O
AFUE	ANNUAL FUEL UTILIZATION EFFICIENCY		2" STRAIN
ALT	ALTERNATE		1" GAS-CTRL
AP	ACCESS PANEL		1" PLUG
ARCH	ARCHITECT/ARCHITECTURAL		1" GAS COCK
BFF	BELOW FINISHED FLOOR		1" REG
BLW	BELOW		1" TV
BTU	BRITISH THERMAL UNITS		TMV-XTP
BTUH	BRITISH THERMAL UNITS PER HOUR		TMV-MVM
CAP	CAPACITY		2" PRV
CB	CATCH BASIN		2" METER
CFM	CUBIC FEET PER MINUTE		Double Check Valve
CLG	CEILING		Reduced Pressure Zone
CO	CLEAN OUT		
CW	COLD WATER		
D	DEGREE		
DB	DRY BULB		
DIA	DIAMETER		
DN	DOWN		
DIW	DISTILLED WATER		
EA	EACH		
EAT	ENTERING AIR TEMPERATURE		
ELEC	ELECTRICAL		
EQUIP	EQUIPMENT		
EWC	ELECTRIC WATER COOLER		
EWT	ENTERING WATER TEMPERATURE		
E/A	EXHAUST AIR		
EXIST	EXISTING		
F	DEGREES FAHRENHEIT		
FCO	FLOOR CLEAN OUT		
EWT	ENTERING WATER TEMPERATURE		
FDC	FIRE DEPARTMENT CONNECTION		
FL	FLOOR		
FO	FUEL OIL		
FOV	FUEL OIL VENT		</

JonesGillamRenz

SR

THE IRVING LOFTS

HISTORIC RESTORATION & REHAB APARTMENTS

TEXAS



REVISIONS:

DATE: 11/20/2025

JOB: 25-3479

SHEET NO.:

P0.1

COPYRIGHT ©



PLUMBING SHEET NOTES

- 1 EXPOSED PIPING TO BE ROUTED TIGHT TO BOTTOM OF EXISTING STRUCTURE. UTILIZE COPPER, OR RIGID PIPE FOR DOMESTIC WATER, AND PVC OR CAST IRON FOR WASTE AND VENT. ROUTE PIPING PERPENDICULAR TO BUILDING SURFACES. NEATLY TRAIN PIPING TOGETHER ALONG EXISTING CONSTRUCTION AND COORDINATE WITH OTHER TRADES. OBTAIN APPROVAL OF ROUTING FROM ARCHITECT PRIOR TO ROUGHING IN.
- 2 ROUTE INSULATED DOMESTIC WATER PIPING IN BUILDING DIRECTLY ABOVE CEILING AND ENSURE PIPING IS THOROUGHLY COVERED WITH ATTIC INSULATION.

NOTES BY SYMBOL

- 1 4" PVC PIPE FOR RADON SYSTEM. COORDINATE EXACT REQUIREMENTS WITH ARCHITECT.
- 2 ELECTRICAL EQUIPMENT SHOWN FOR COORDINATION. DO NOT ROUTE PIPING ABOVE OR BELOW ELECTRICAL EQUIPMENT UNLESS CLEARANCE IS SHOWN.
- 3 PROVIDE INDIRECT CONNECTION AT GARBAGE DISPOSER AND CONNECT DISHWASHER. ROUTE DRAIN FROM DISHWASHER AT BACK OF CABINETRY. COORDINATE EXACT ROUTING WITH G.C.
- 4 SEE SITE PLAN FOR CONTINUATION.
- 5 FIRE PROTECTION SERVICE ENTRANCE. INSTALL IN ACCORDANCE WITH NFPA 13 AND 14. COORDINATE LOCATION OF ALL VALVES AND APPURTENANCES WITH AHJ. SEE DETAIL 1.P6.1.
- 6 PROVIDE 2" SHUT-OFF VALVE AT WATER SERVICE ENTRANCE. COORDINATE REQUIREMENTS WITH CITY OF ARLINGTON.
- 7 PROVIDE 1/2" VALVED BRANCH BELOW SINK AND CONNECT DISHWASHER. ROUTE PIPING ALONG BACK OF CABINETRY. COORDINATE EXACT ROUTING WITH G.C. COORDINATE EXACT REQUIREMENTS WITH DISHWASHER PROVIDED.




TEXAS



PC1.1

COPYRIGHT ©



५२

TEXAS



PC9.1

COPYRIGHTED ©

