



Jones Gillam Renz Architects

Address

730 N 9th St.
Salina, KS 67401

1881 Main St., Suite 301
Kansas City, MO 64108

Contact

jgr@jgrarchitects.com
(785) 827-0386

Web

jgrarchitects.com

ARCHITECT'S SUPPLEMENTAL INSTRUCTIONS

JONES GILLAM RENZ DOCUMENT JGR 710

PROJECT: The Temple Elevator Rehabilitation Project
Salina, KS

OWNER: Salina Innovation Foundation
Mary Landes, Director
336 S. Santa Fe Ave
Salina, KS 67401

CONTRACTOR: Ponton Construction
1325 Armory Rd.
Salina KS 67401

Report No. Two (2)

Date Jan. 28, 2026

Architect's Proj No. 25-3499

Contract For: General Construction
Mechanical, Electrical

The work shall be carried out in accordance with the following supplemental instructions issued in accordance with the Contract Documents without change in Contract Sum or Contract Time. Prior to proceeding in accordance with these instructions, indicate your acceptance of these instructions for minor change to the Work as consistent with the Contract Documents and return a copy to the Architect.

DESCRIPTION:

- 1) Contractor to make adjustments as needed and required per the modifications as indicated on attached drawings and in the below descriptions:
 - a. Structural Sheet S1.0 – Structural revisions have been made to accommodate a 24"x24" floor access hatch at the Lower Level framing plan.
 - b. Electrical Sheet E1.1 – Receptacles, circuitry and notes have been added to storage rooms adjacent to elevator hoist way.
 - c. Electrical Sheet E6.1 – Panel Schedules have been modified for panels 'L01' and 'L71'.

Attachments:

1. Revised Sheets S1.0, E1.1, E6.2

Issued by: Jones Gillam Renz Architects PO Box 2928, Salina, KS 67402
Maggie Gillam, Project Architect 785 827 0386


mgillam@jgrarchitects.com

Copies to:


Ponton Construction
The Temple – Mary Landes, Steve Renich
LST – Justyn Leon
Structural (EC) – Brian Sherk




A SUB-BASEMENT - PIT FLOOR PLAN
1/4" = 1'-0"

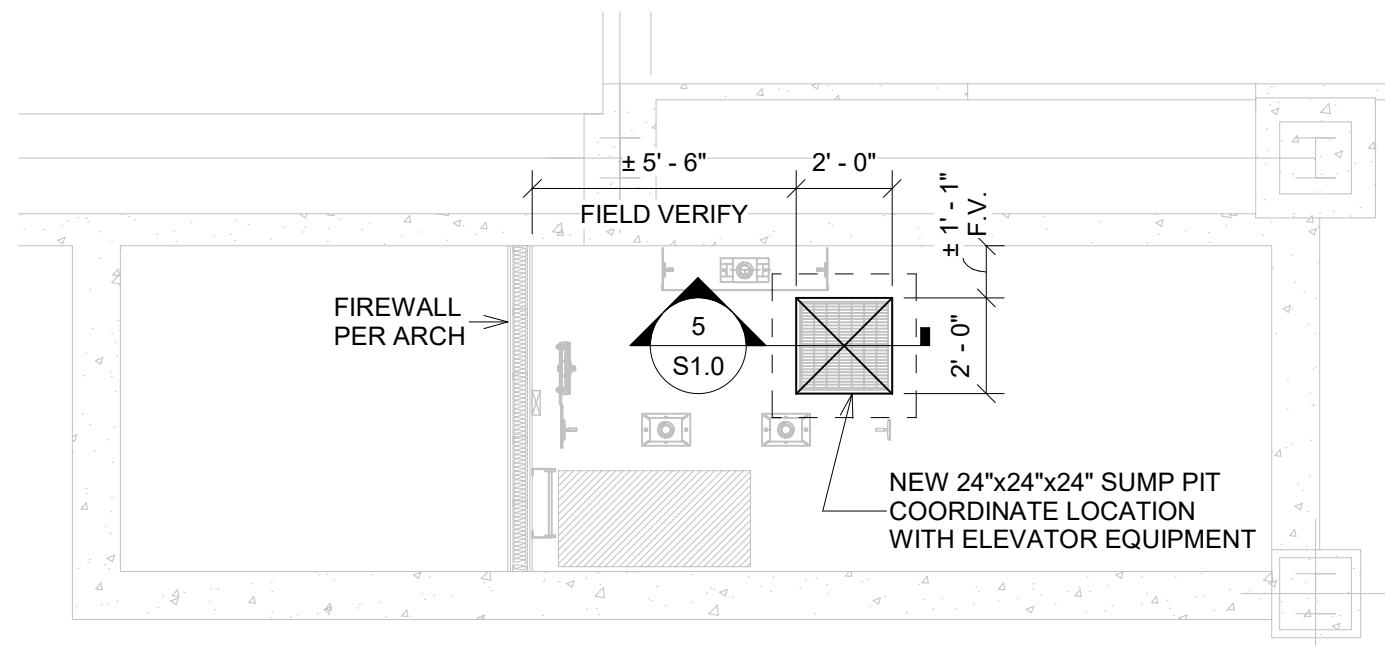


1 SECTION 1
3/4" = 1'-0"

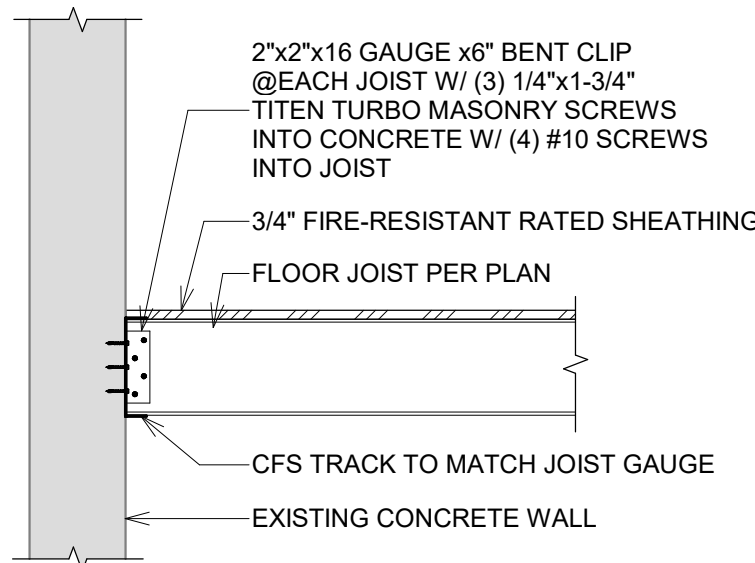


2 SECTION 2
3/4" = 1'-0"

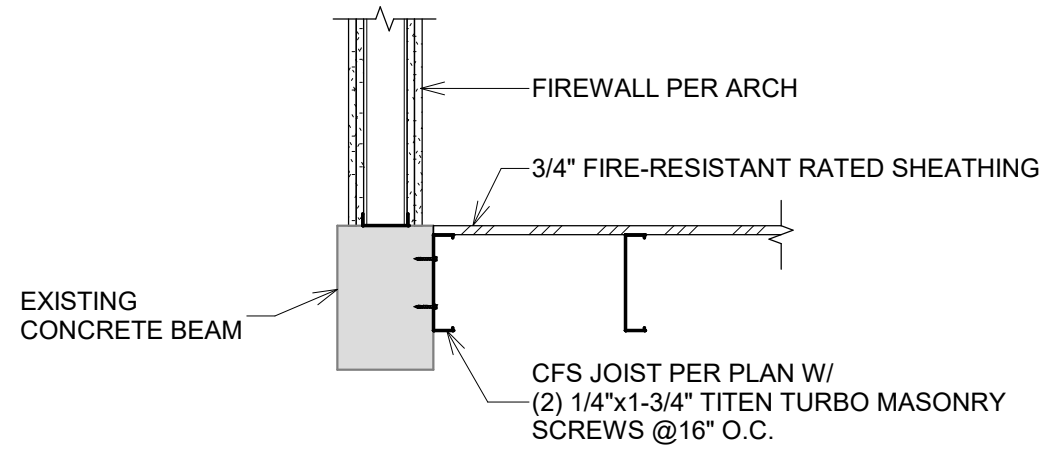


3 SECTION 3
3/4" = 1'-0"

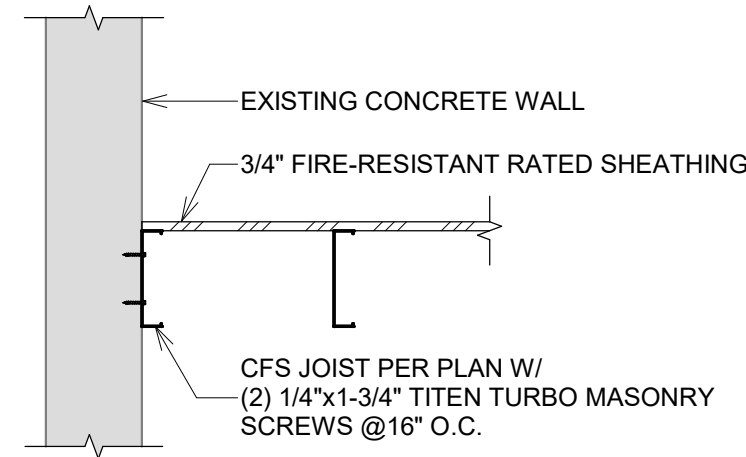


B FLOOR FRAMING PLAN - TYPICAL AT FLOORS 1-4, 6
1/4" = 1'-0"

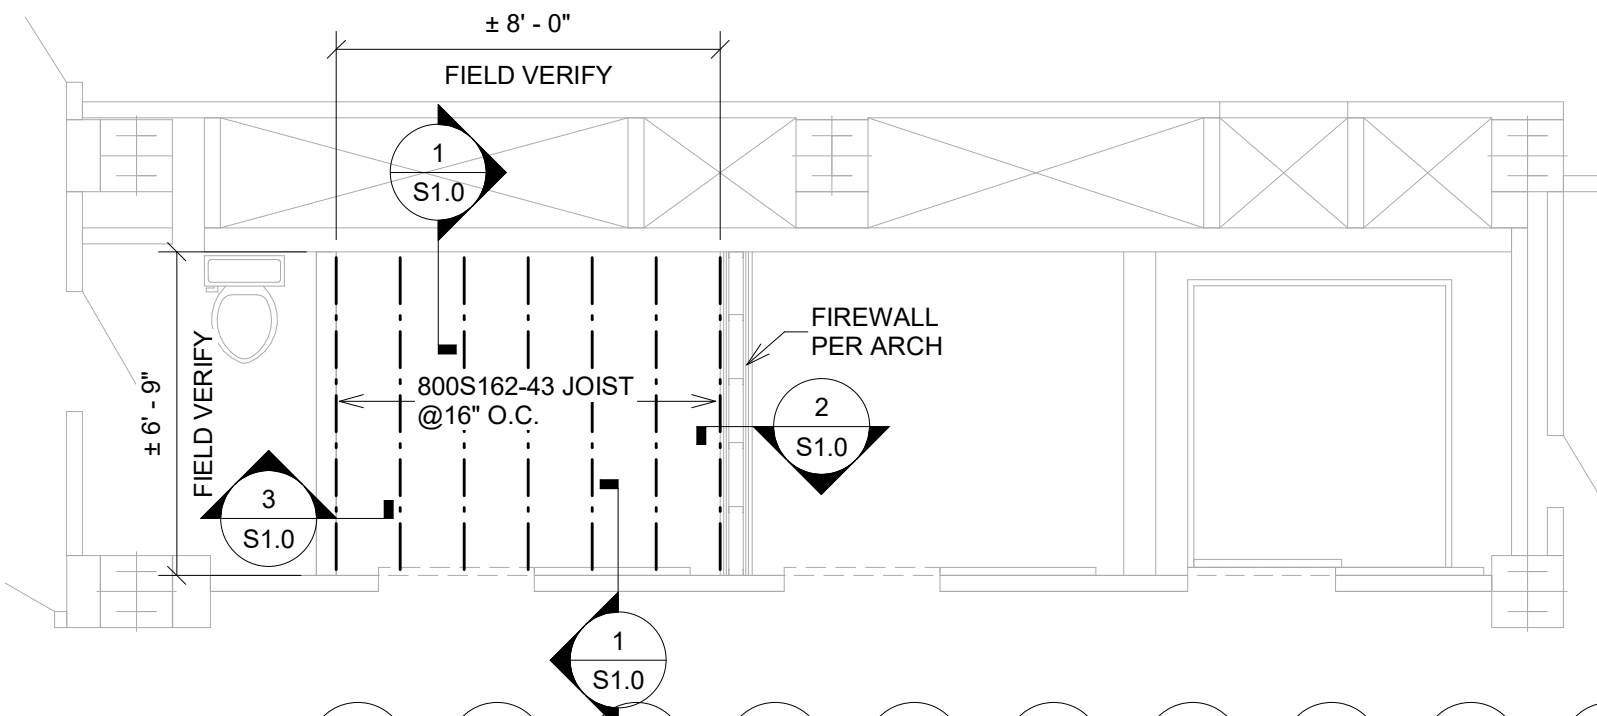



E LOWER LEVEL FLOOR FRAMING PLAN
1/4" = 1'-0"

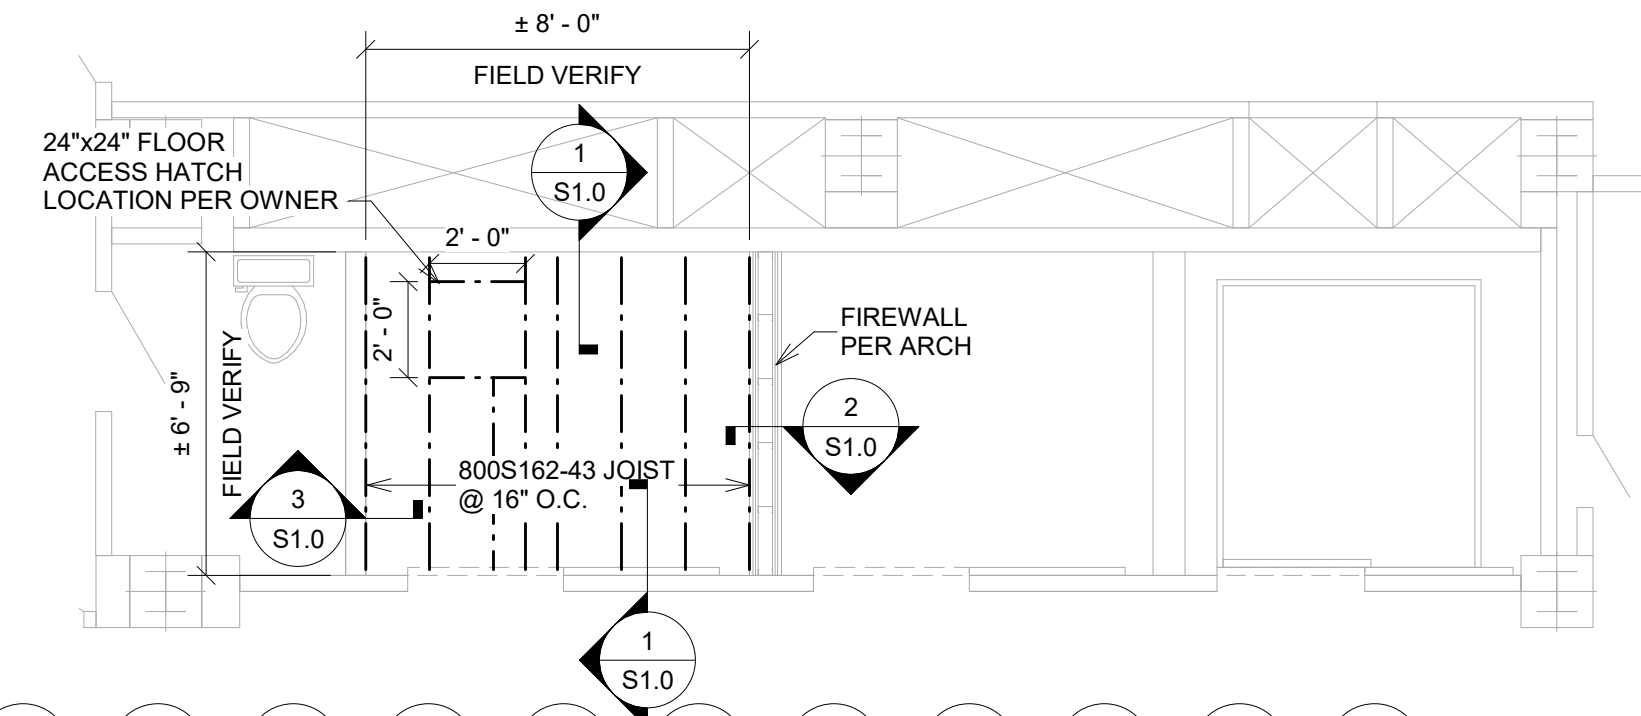

5 Section 5
3/4" = 1'-0"

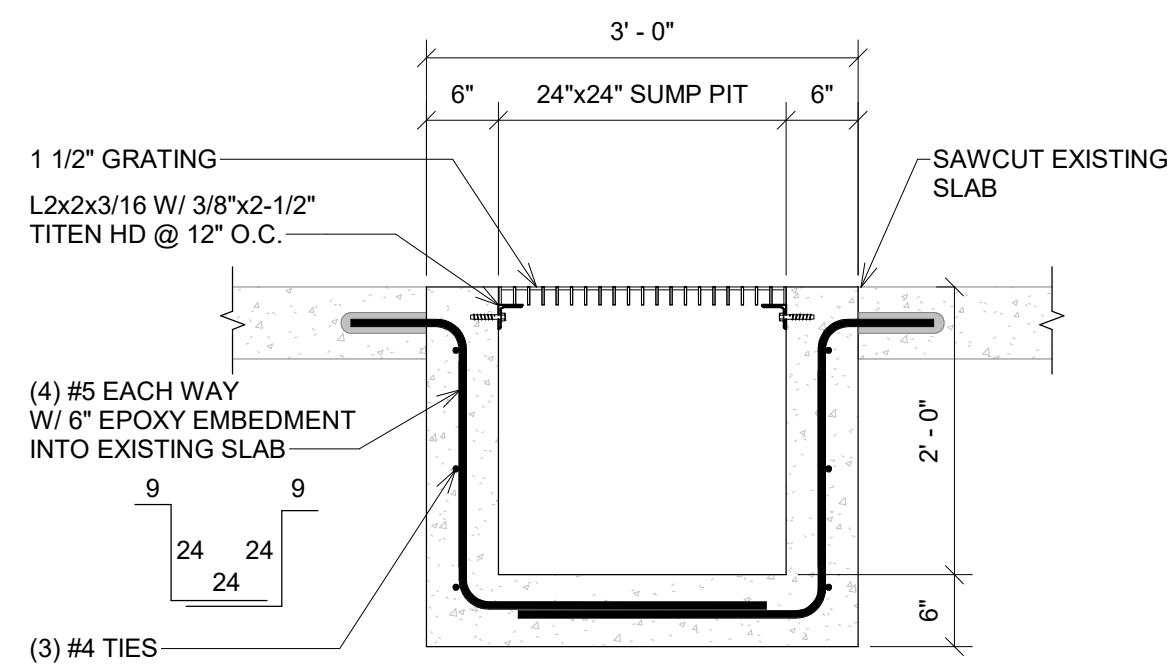


4 WOOD PANEL DETAIL
3/4" = 1'-0"

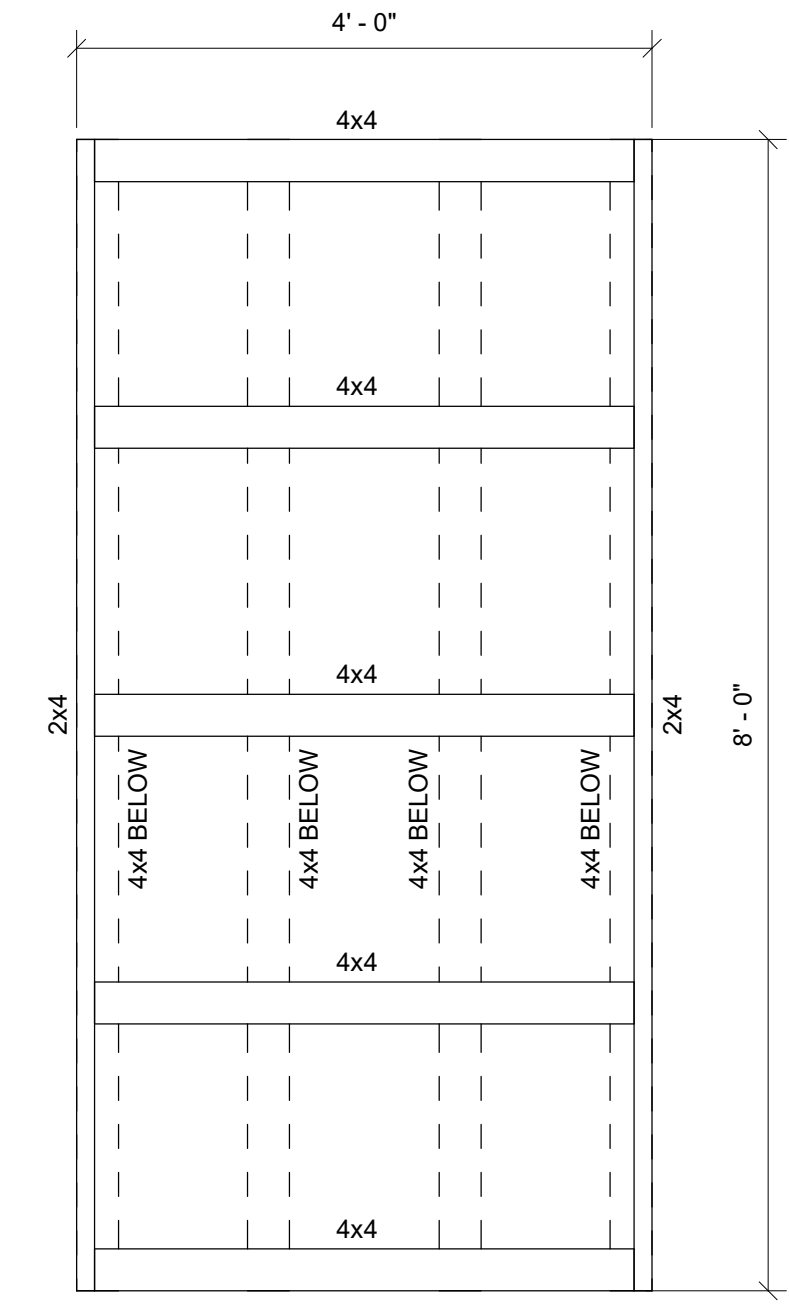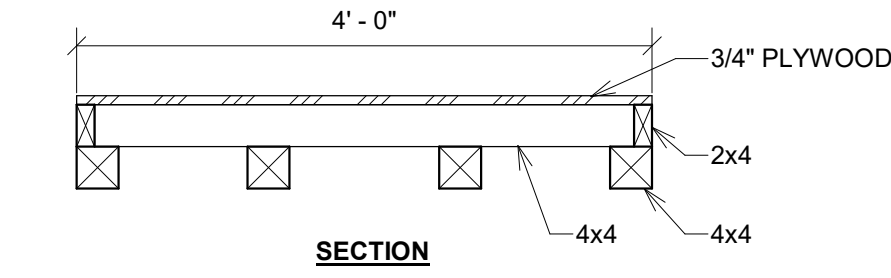


- GENERAL NOTES**
- FIELD VERIFY ALL DIMENSIONS AND EXISTING CONDITIONS PRIOR TO STARTING WORK.
 - DIMENSIONS SHOWN HERE APPLY TO STRUCTURAL ELEMENTS ONLY. SEE ARCHITECTURAL FOR ANY DIMENSIONS NOT NOTED HERE.
 - MATERIALS:**
WIDE FLANGE: A992 FY=50 KSI
COLD-FORMED STEEL: ASTM C955 GR. 33 KSI
PLYWOOD: DCC PS 1 OR 2
 - THE ENGINEER SHALL NOT BE RESPONSIBLE FOR THE ACTS OR OMISSIONS OF THE CONTRACTOR OR ANY SUB-CONTRACTORS, OR ANY OF THE CONTRACTOR'S OR SUB-CONTRACTOR'S AGENTS OR EMPLOYEES, OR ANY OTHER PERSONS PERFORMING ANY OF THE WORK.





C ROOF PLAN
1/16" = 1'-0"

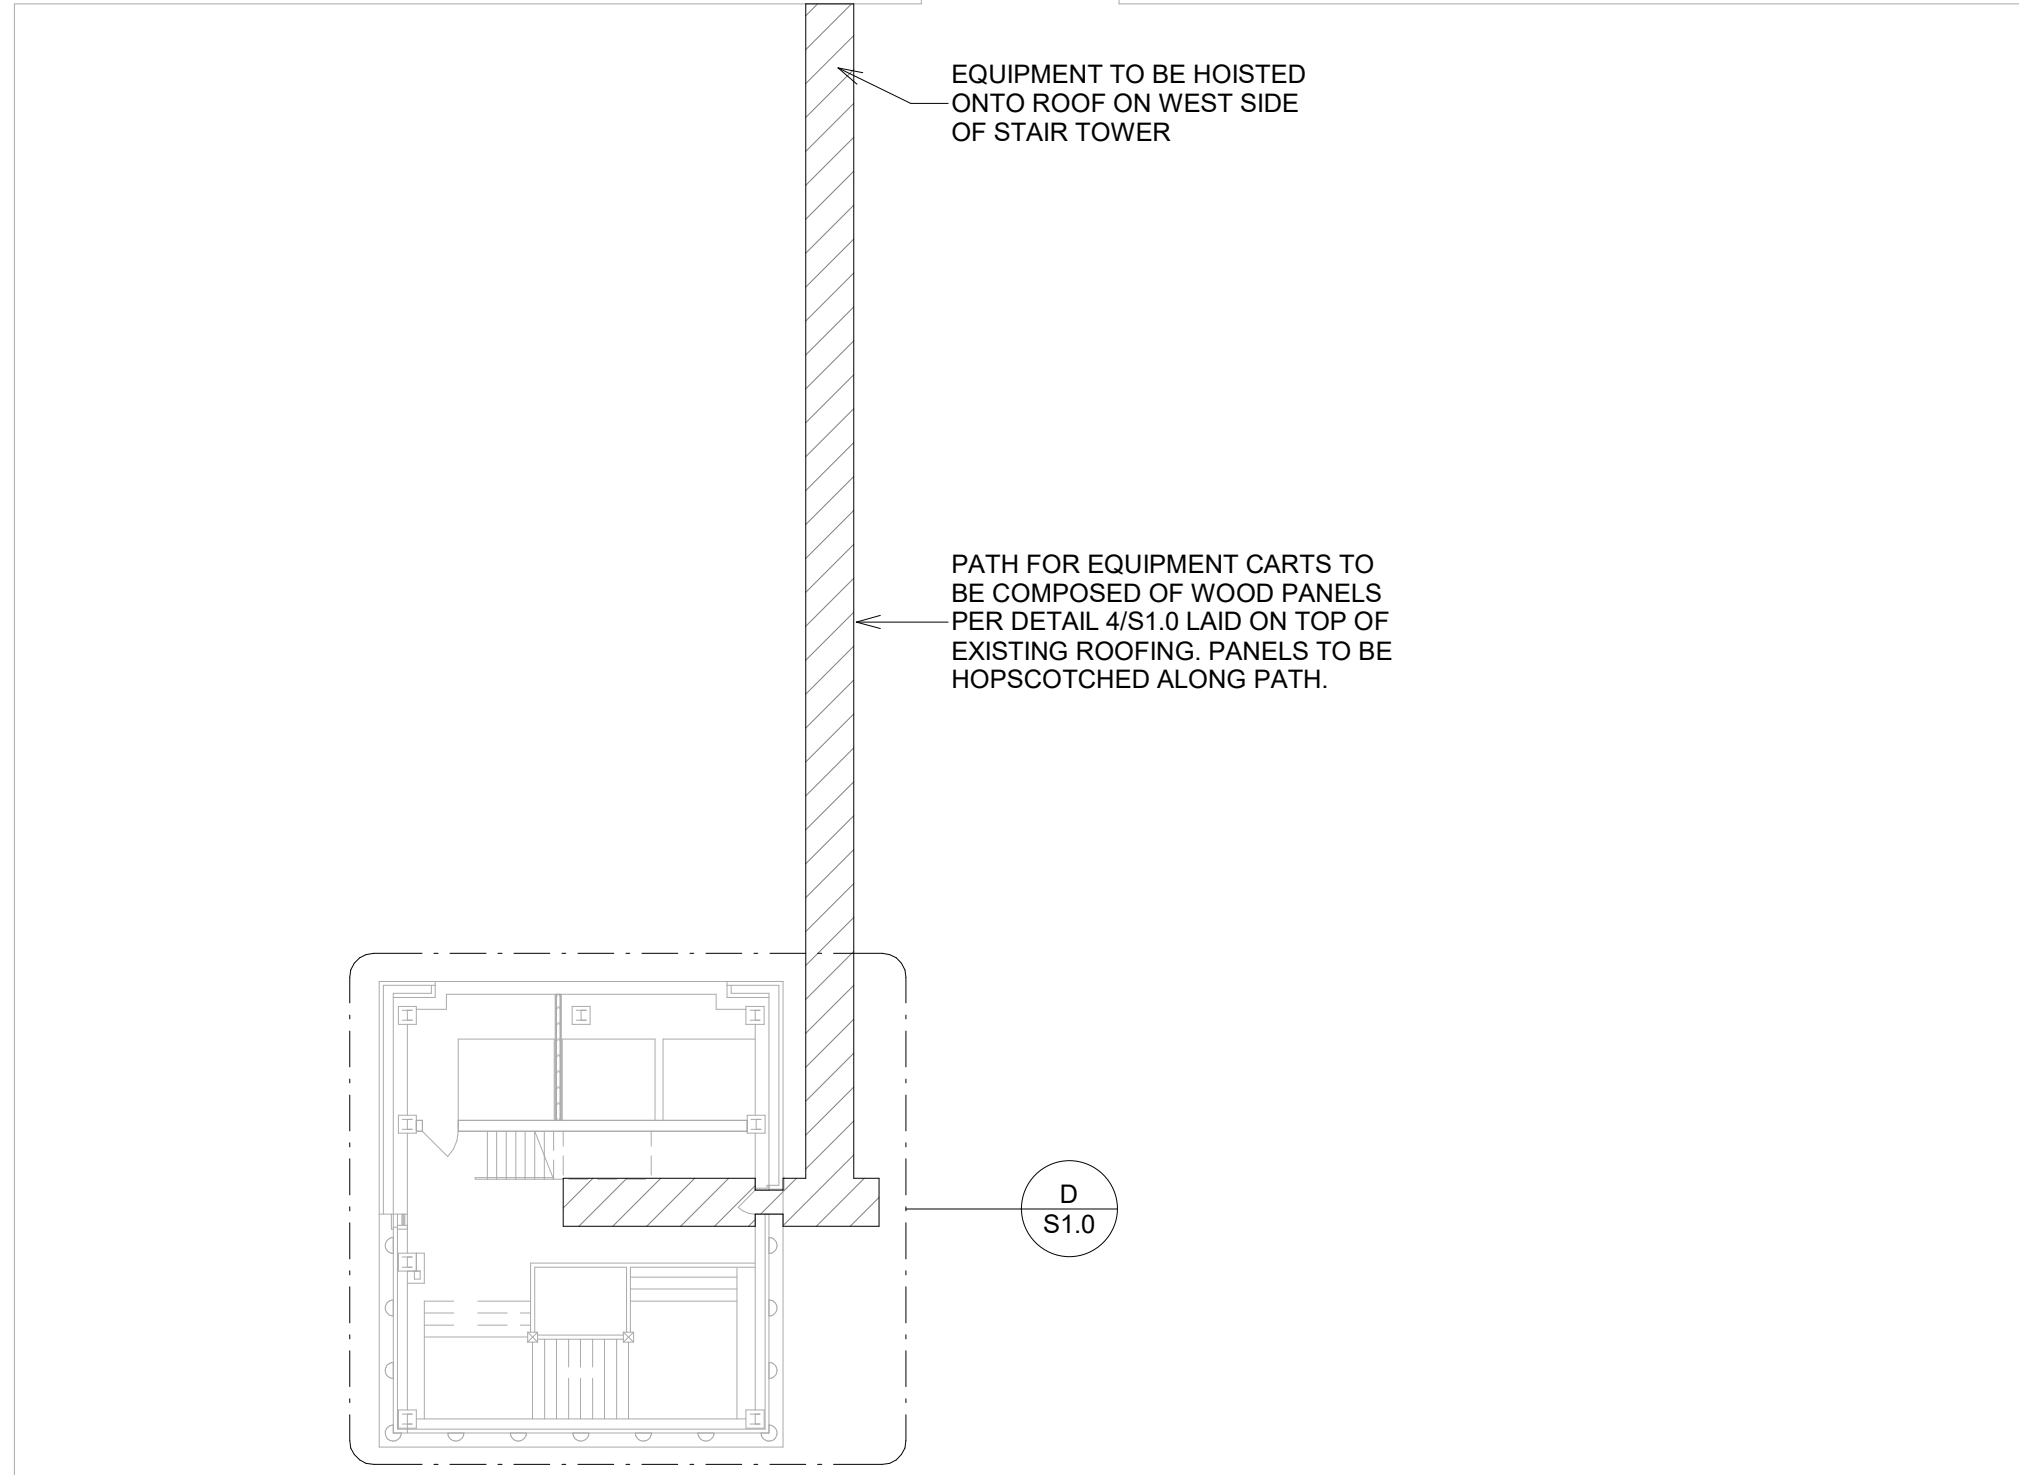

D PENTHOUSE (LOWER) FLOOR PLAN
1/4" = 1'-0"

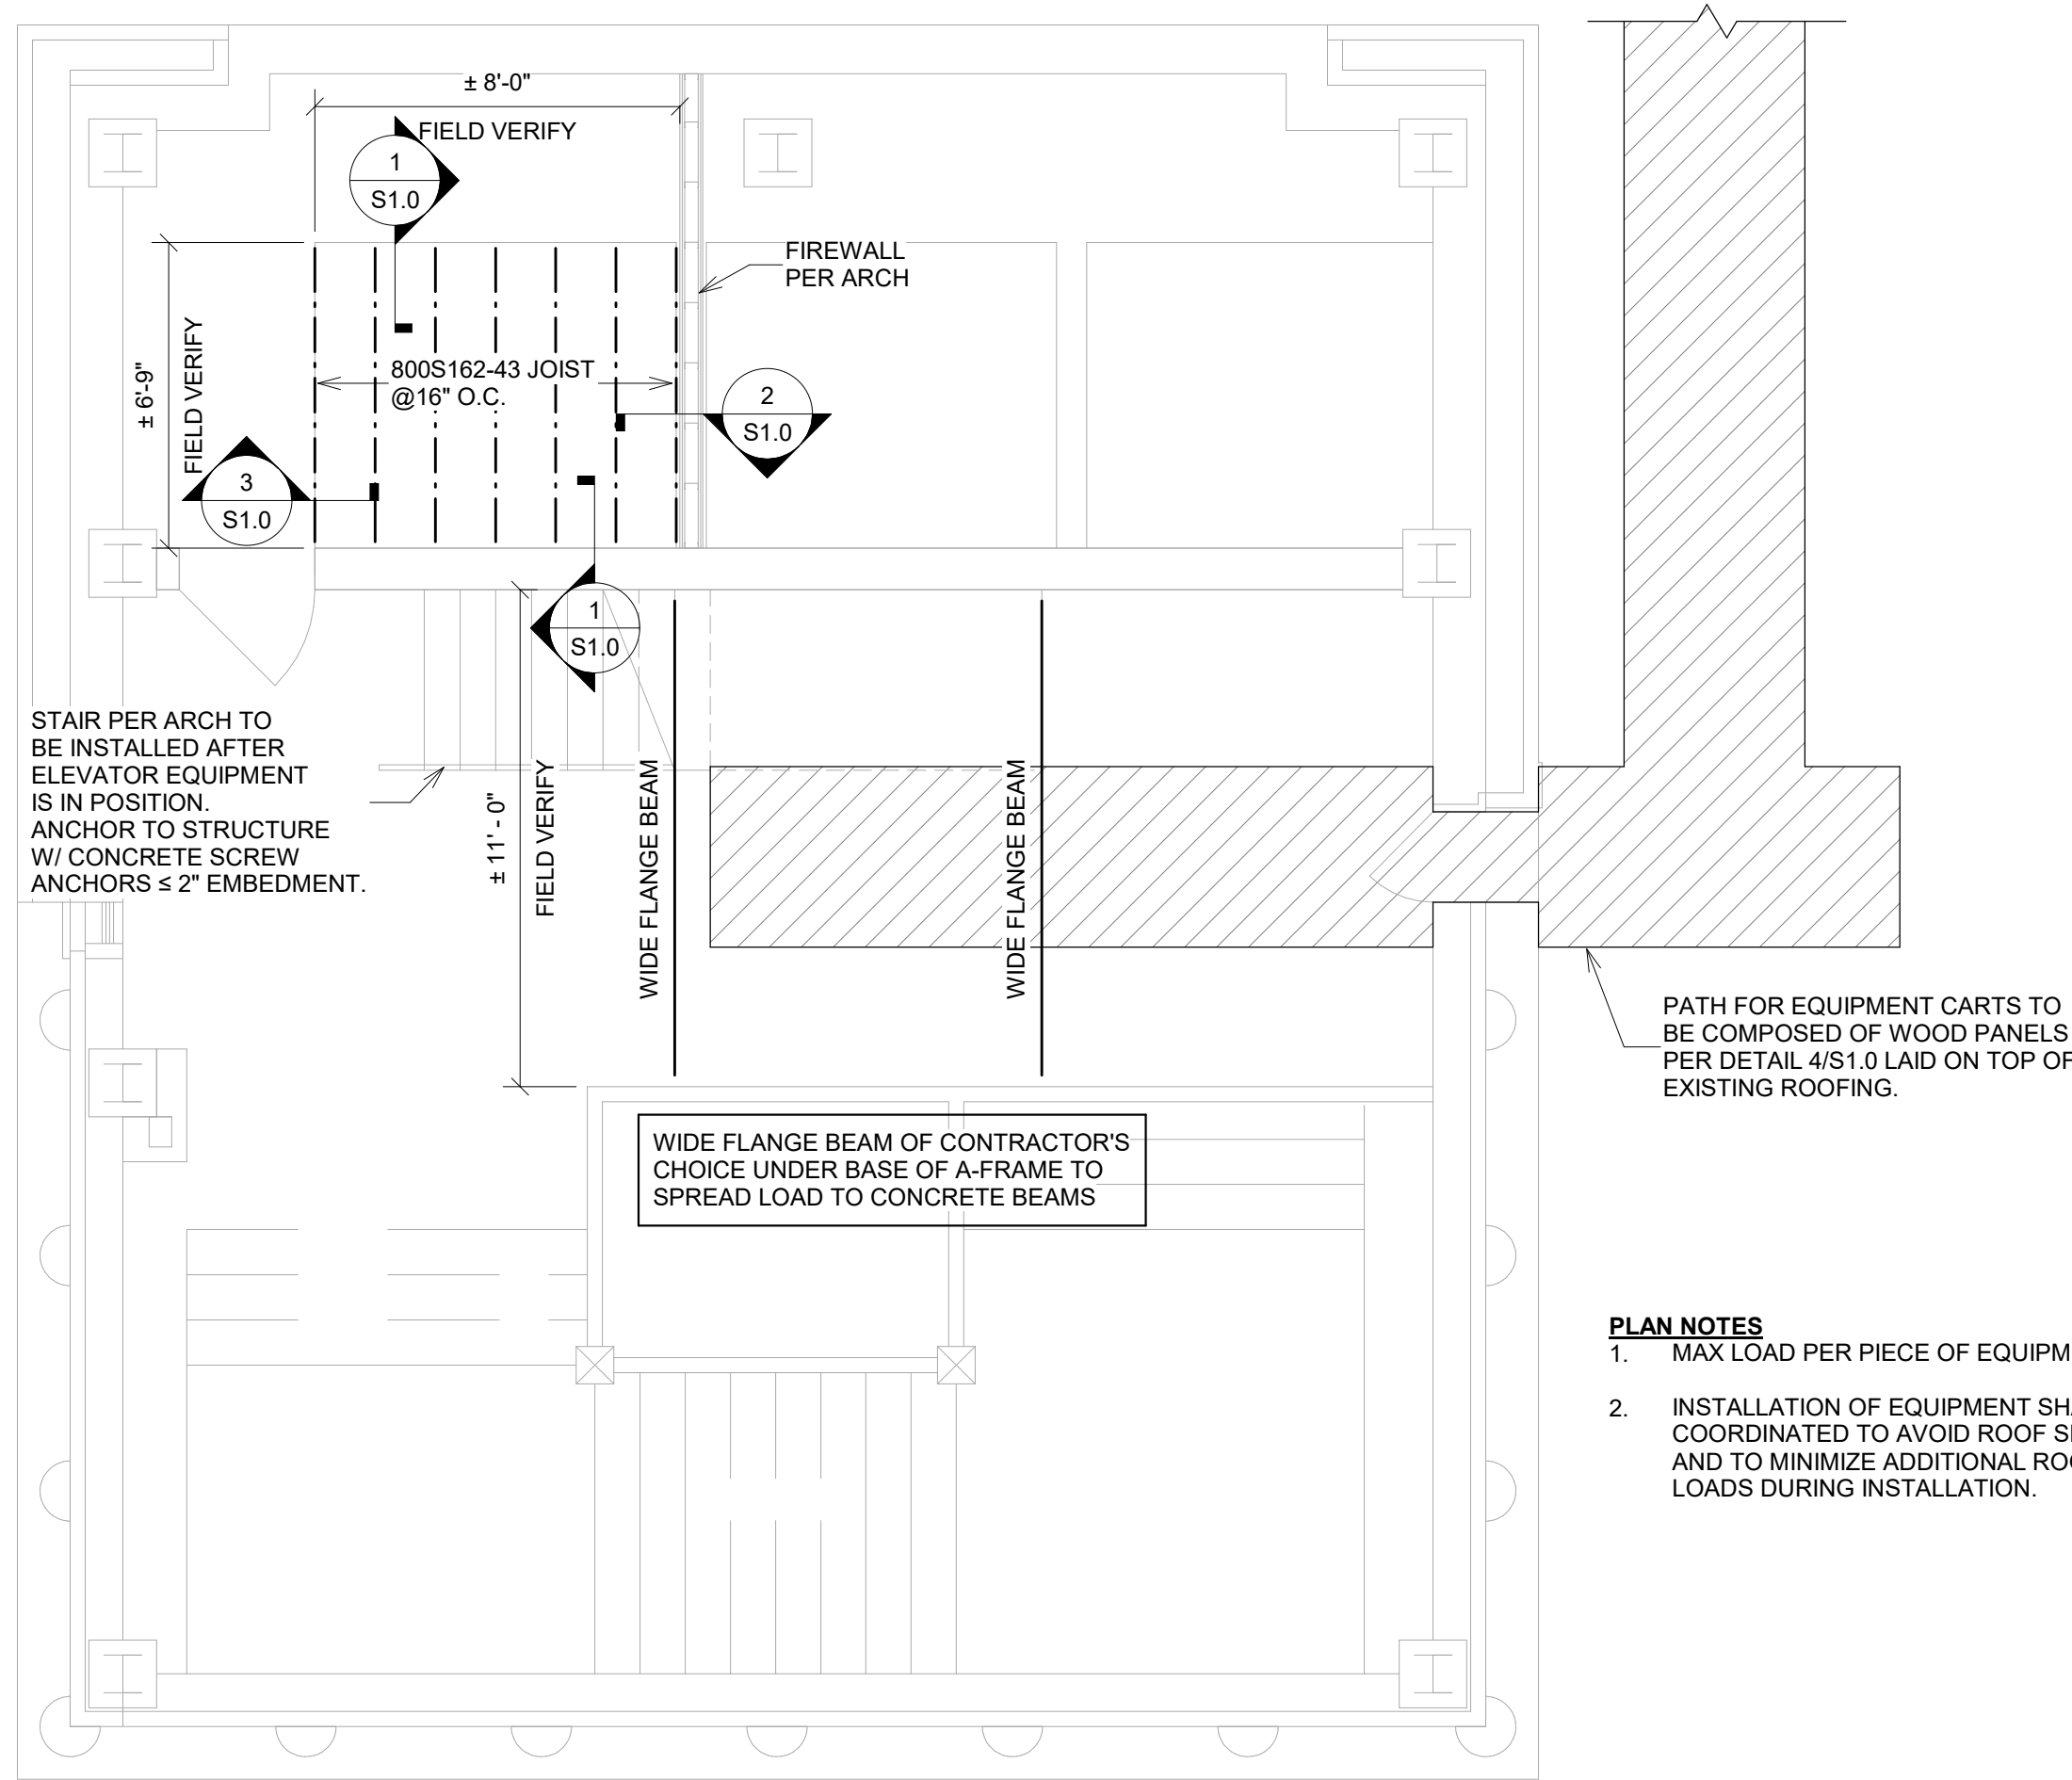

- PLAN NOTES**
- MAX LOAD PER PIECE OF EQUIPMENT: 2,500 LB
 - INSTALLATION OF EQUIPMENT SHALL BE COORDINATED TO AVOID ROOF SNOW LOADS AND TO MINIMIZE ADDITIONAL ROOF LIVE LOADS DURING INSTALLATION.

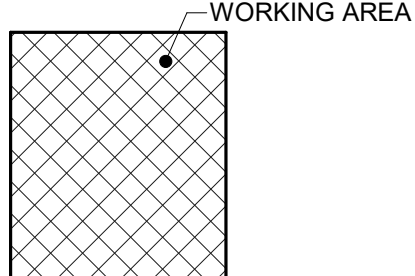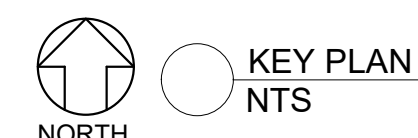


REVISION:		
1	ADD-1	8-14-2025
2	ASI #2	1-27-2026
DATE:	08/04/2025	
JOB:	25-3499	
SHEET NO.:		

S1.0

THE TEMPLE
SALINA INNOVATION FOUNDATION
ELEVATOR REHABILITATION PROJECT
KANSAS

JCR
JonesGillamRenz
1881 Main Street, Suite 301
Salina, KS 67401
785.827.038
jgr@jgarchitects.com

ENGINEERING
CONSULTANTS
P.A.
1881 MAIN STREET
SUITE 301
HUTCHINSON, KS 67504-0932
620-665-6394
info@engineering-consultants.com

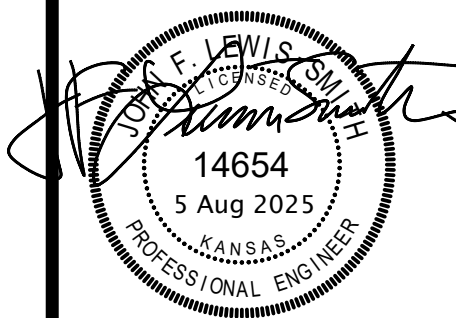


REVISION:	
Δ	ADDENDUM 1 - 8-14-2025
Δ	ADDENDUM 2 - 9-3-2025
Δ	ASI #2 - 1-28-2026
DATE: 8-5-2025	
JOB: 25-3499	
SHEET NO.:	

E1.1


COPYRIGHTED ©

ELECTRICAL PLAN NOTES BY SYMBOL


- SERVICE ENTRANCE FEEDER FROM C.T. CABINET. SEE ONE-LINE DIAGRAM ON SHEET E6.1. ROUTE OVERHEAD IN BASEMENT AND TERMINATE AT SWITCHBOARD 'SES'. KEEP RUNS AS SHORT AS POSSIBLE.
- SLEEVE AND SEAL CONDUIT PENETRATIONS THROUGH EXTERIOR WALL WATER TIGHT.
- INSTALL RECEPTACLE ON WALL OF ELEVATOR PIT. VERIFY EXACT LOCATION WITH ELEVATOR EQUIPMENT INSTALLER.
- INSTALL LIGHT FIXTURE ON WALL OF ELEVATOR PIT AND CONTROL VIA SWITCH MOUNTED ADJACENT TO PIT LADDER. VERIFY EXACT LOCATION WITH ELEVATOR EQUIPMENT INSTALLER.
- EXTEND CIRCUIT DOWN TO RECEPTACLE DIRECTLY BELOW ON MID-LEVEL STOP BETWEEN 6TH FLOOR AND PENTHOUSE, LEVEL 6, AND LEVEL 4.
- ELEVATOR LOBBY SMOKE DETECTOR. SEE DETAIL 2:E6.1. TYPICAL FOR LOWER LEVEL, FLOORS 1 THROUGH 4, FLOOR 6, AND MID-LEVEL STOP BETWEEN 6TH FLOOR AND PENTHOUSE (7 TOTAL). SEE DETAIL 2, SHEET E6.1.
- ELEVATOR MACHINE ROOM SMOKE DETECTOR. SEE DETAIL 2:E6.1.
- ADDRESSABLE FIRE ALARM RELAYS FOR ELEVATOR PRIMARY AND ALTERNATE LEVEL RECALL AND FIREMAN'S HAT. SEE DETAIL 2:E6.1.
- EXTEND CIRCUIT UP TO RECEPTACLE DIRECTLY ABOVE ON LEVEL 1, LEVEL 2 AND LEVEL 3.
- 30A FUSED DISCONNECT SWITCH WITH SOLID NEUTRAL AND (1) 20A DUAL-ELEMENT, TIME DELAY FUSE IN NEMA 1 ENCLOSURE FOR ELEVATOR CAB LIGHTS & EXHAUST. SWITCH SHALL BE CAPABLE OF BEING LOCKED "OFF". MOUNT AT 6'-0" AFF TO TOP AND LABEL WITH CORRESPONDING ELEVATOR CAR NUMBER AND CIRCUIT NUMBER. COORDINATE EXACT MOUNTING LOCATION AND REQUIREMENTS WITH ELEVATOR EQUIPMENT INSTALLER. PROVIDE FINAL ELECTRICAL CONNECTION TO ELEVATOR CONTROLLER.
- ELEVATOR DISCONNECT SWITCH: 60A/3P SWITCH COMPLETE WITH 50A DUAL ELEMENT, TIME DELAY FUSES, AND AUXILIARY CONTACTS FOR ELEVATOR RECALL SIGNAL. COORDINATE EXACT MOUNTING LOCATION AND REQUIREMENTS WITH ELEVATOR EQUIPMENT INSTALLER, AND PROVIDE FINAL ELECTRICAL CONNECTION TO ELEVATOR CONTROLLER.
- PROVIDE 4" SQUARE BOX WITH SINGLE GANG DEVICE RING AND (2) CATEGORY 5E CABLES IN 1" CONDUIT FROM TELECOM OUTLET TO MAIN TELEPHONE TERMINAL BOARD. MOUNT OUTLET AS DIRECTED BY ELEVATOR EQUIPMENT INSTALLER.
- NOTE DELETED.
- PAD MOUNTED C.T. CABINET. VERIFY EXACT LOCATION WITH EVERGY. SEE 1/E6.1 FOR MORE INFORMATION.
- POWER COMPANY PAD MOUNTED TRANSFORMER. PROVIDE 9' X 9' CONCRETE PAD PER EVERGY SERVICE STANDARDS DRAWING 10.35. COORDINATE EXACT LOCATION AND REQUIREMENTS WITH EVERGY PRIOR TO COMMENCING WORK.
- 4" CONDUIT BELOW GRADE FOR POWER COMPANY PROVIDED PRIMARY CABLING. COORDINATE ROUTING AND TERMINATION POINT AT NEW UTILITY POLE WITH EVERGY. SEE ONE-LINE DIAGRAM, SHEET E6.1.
- NEW SERVICE LATERAL BELOW GRADE FROM PAD MOUNTED UTILITY SERVICE TRANSFORMER TO C.T. CABINET. SEE ONE-LINE DIAGRAM ON SHEET E6.1.
- FIRE ALARM CONTROL PANEL DEDICATED FOR ELEVATOR RECALL AND SHUT-DOWN FUNCTIONS.
- ELECTRICAL INSTALLATION OF LIGHTS AND RECEPTACLES IS TYPICAL FOR LOWER LEVEL, LEVELS 1 THROUGH 4, LEVEL 6, AND MID-LEVEL STOP BETWEEN 6TH FLOOR AND PENTHOUSE (7 TOTAL).
- COMMON GROUNDING ELECTRODE CONDUCTOR BUSBAR. SEE DETAIL 3:E6.1.
- PROVIDE 120V POWER CONNECTION TO ELEVATOR SUMP PUMP ALARM PANEL AND 1" CONDUIT WITH PULL STRING STUBBED INTO ELEVATOR PIT FOR CONTROL CABLING. COORDINATE ALL WORK WITH PLUMBING CONTRACTOR.
- SIMPLEX RECEPTACLE IN ELEVATOR PIT FOR ELEVATOR SUMP PUMP. COORDINATE EXACT MOUNTING LOCATION WITH PLUMBING CONTRACTOR AND ELEVATOR EQUIPMENT INSTALLER.

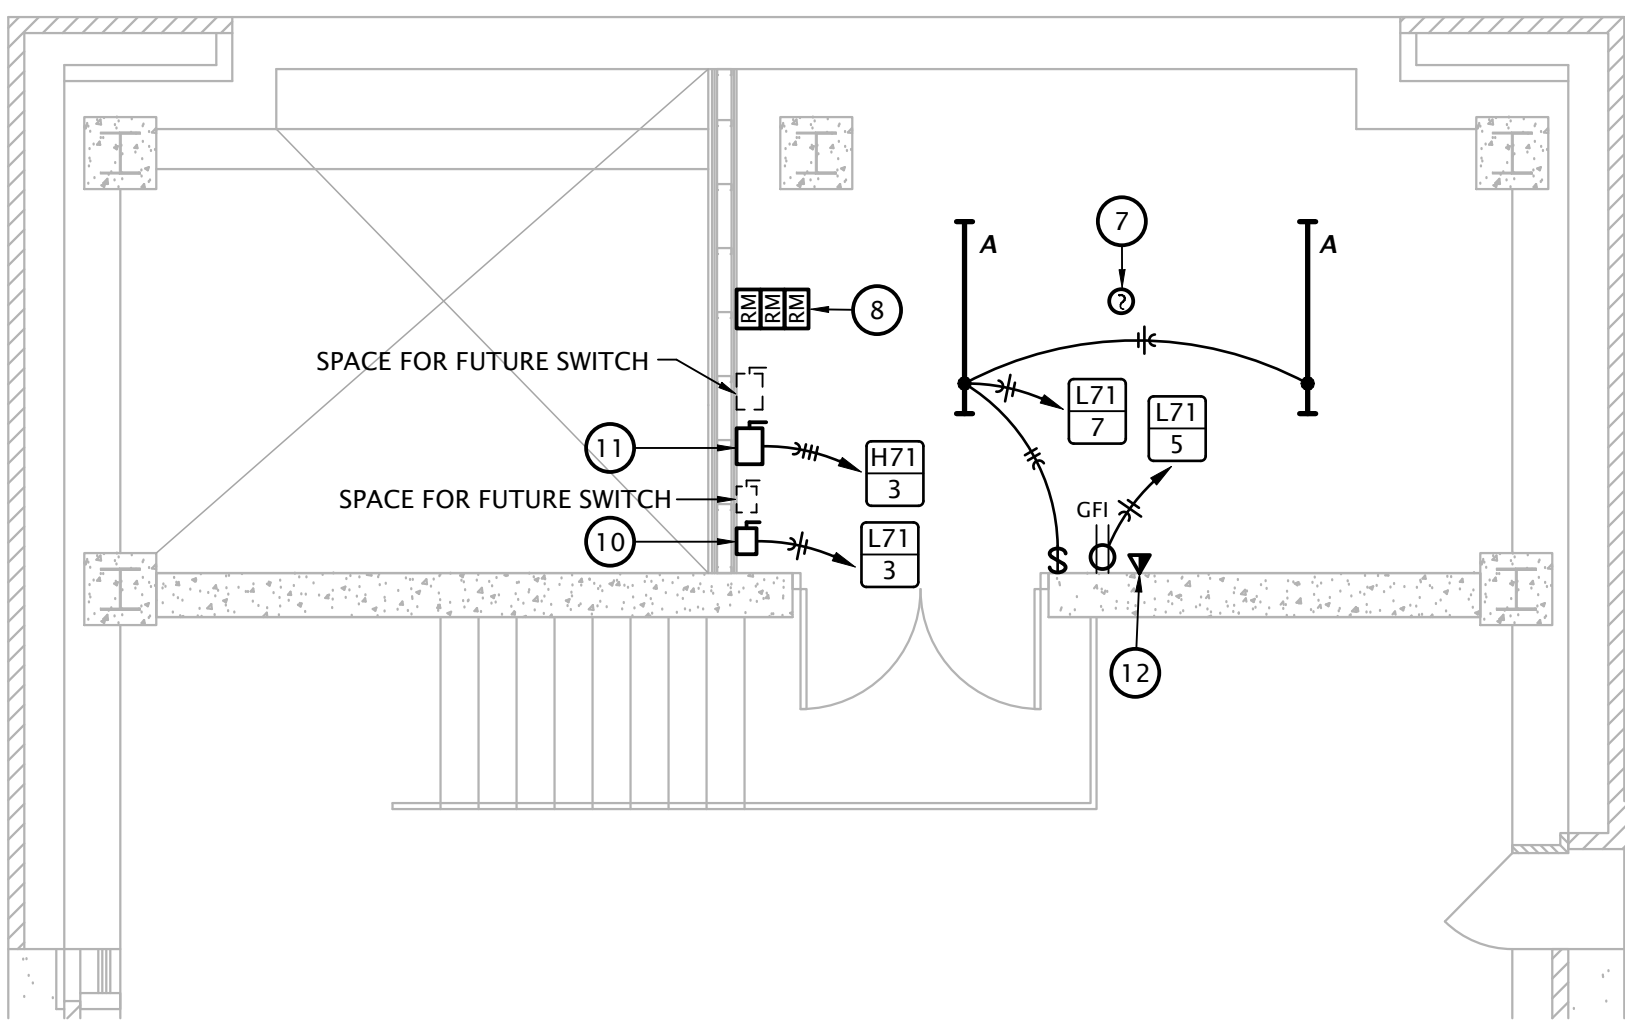


4 PARTIAL PENTHOUSE (UPPER) ELECTRICAL PLAN
1/4" = 1'-0"

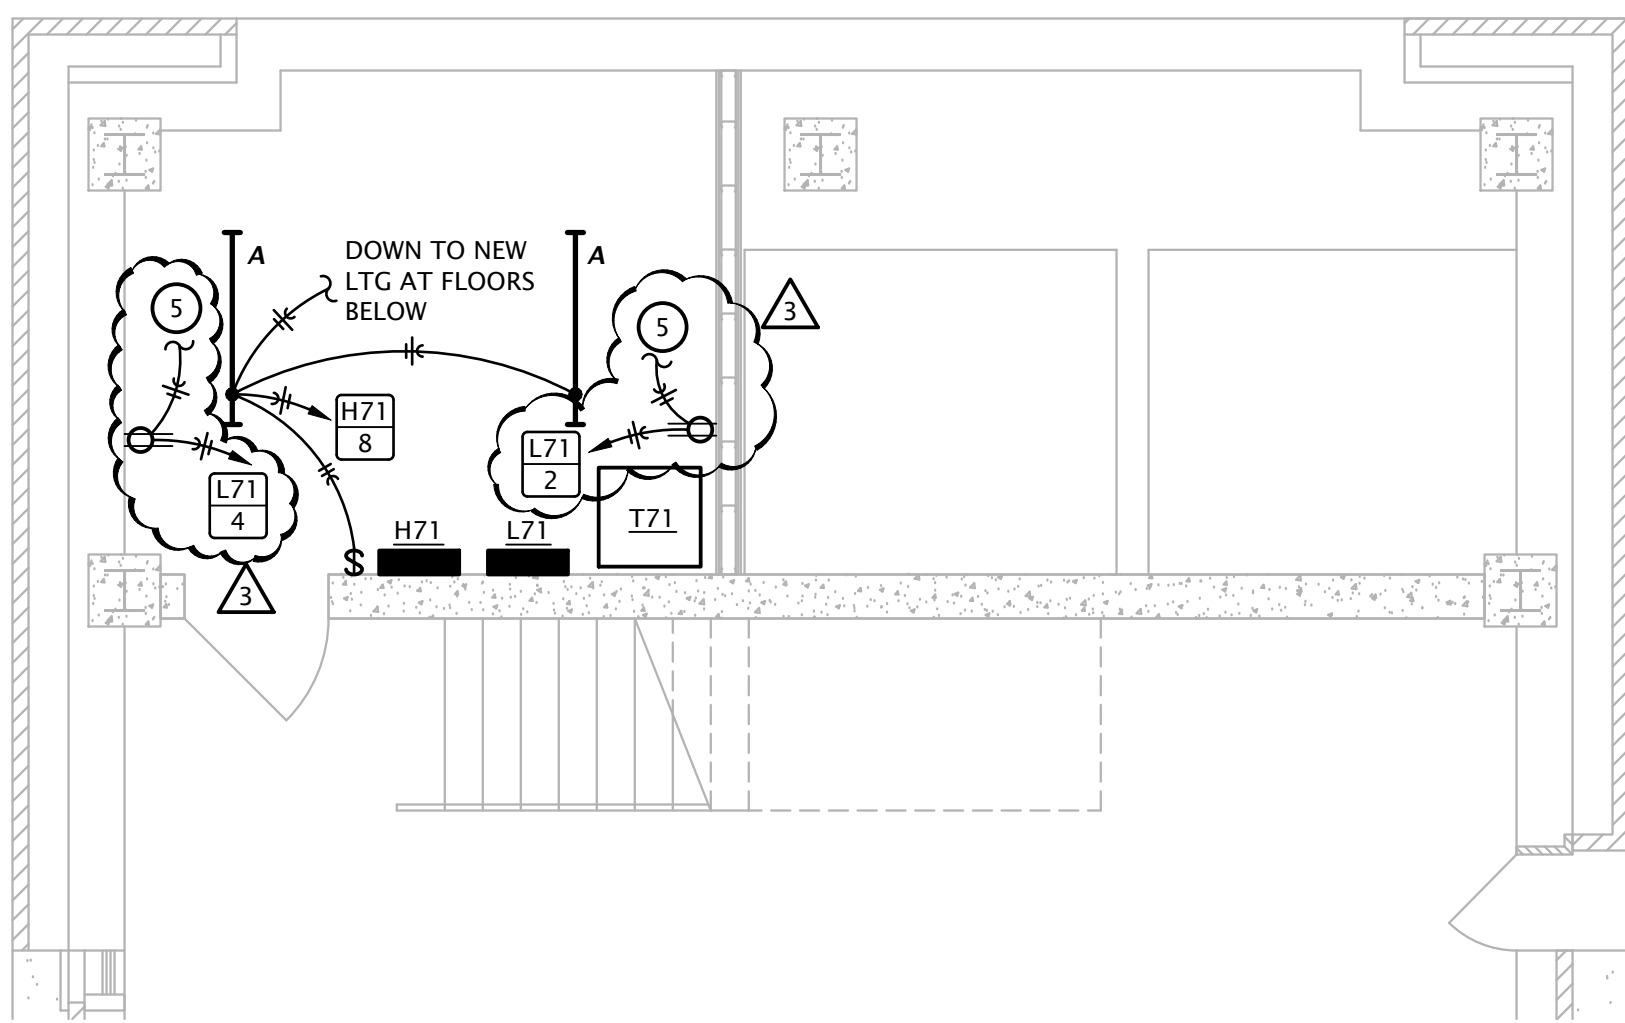

3 PARTIAL PENTHOUSE (LOWER) ELECTRICAL PLAN
1/4" = 1'-0"

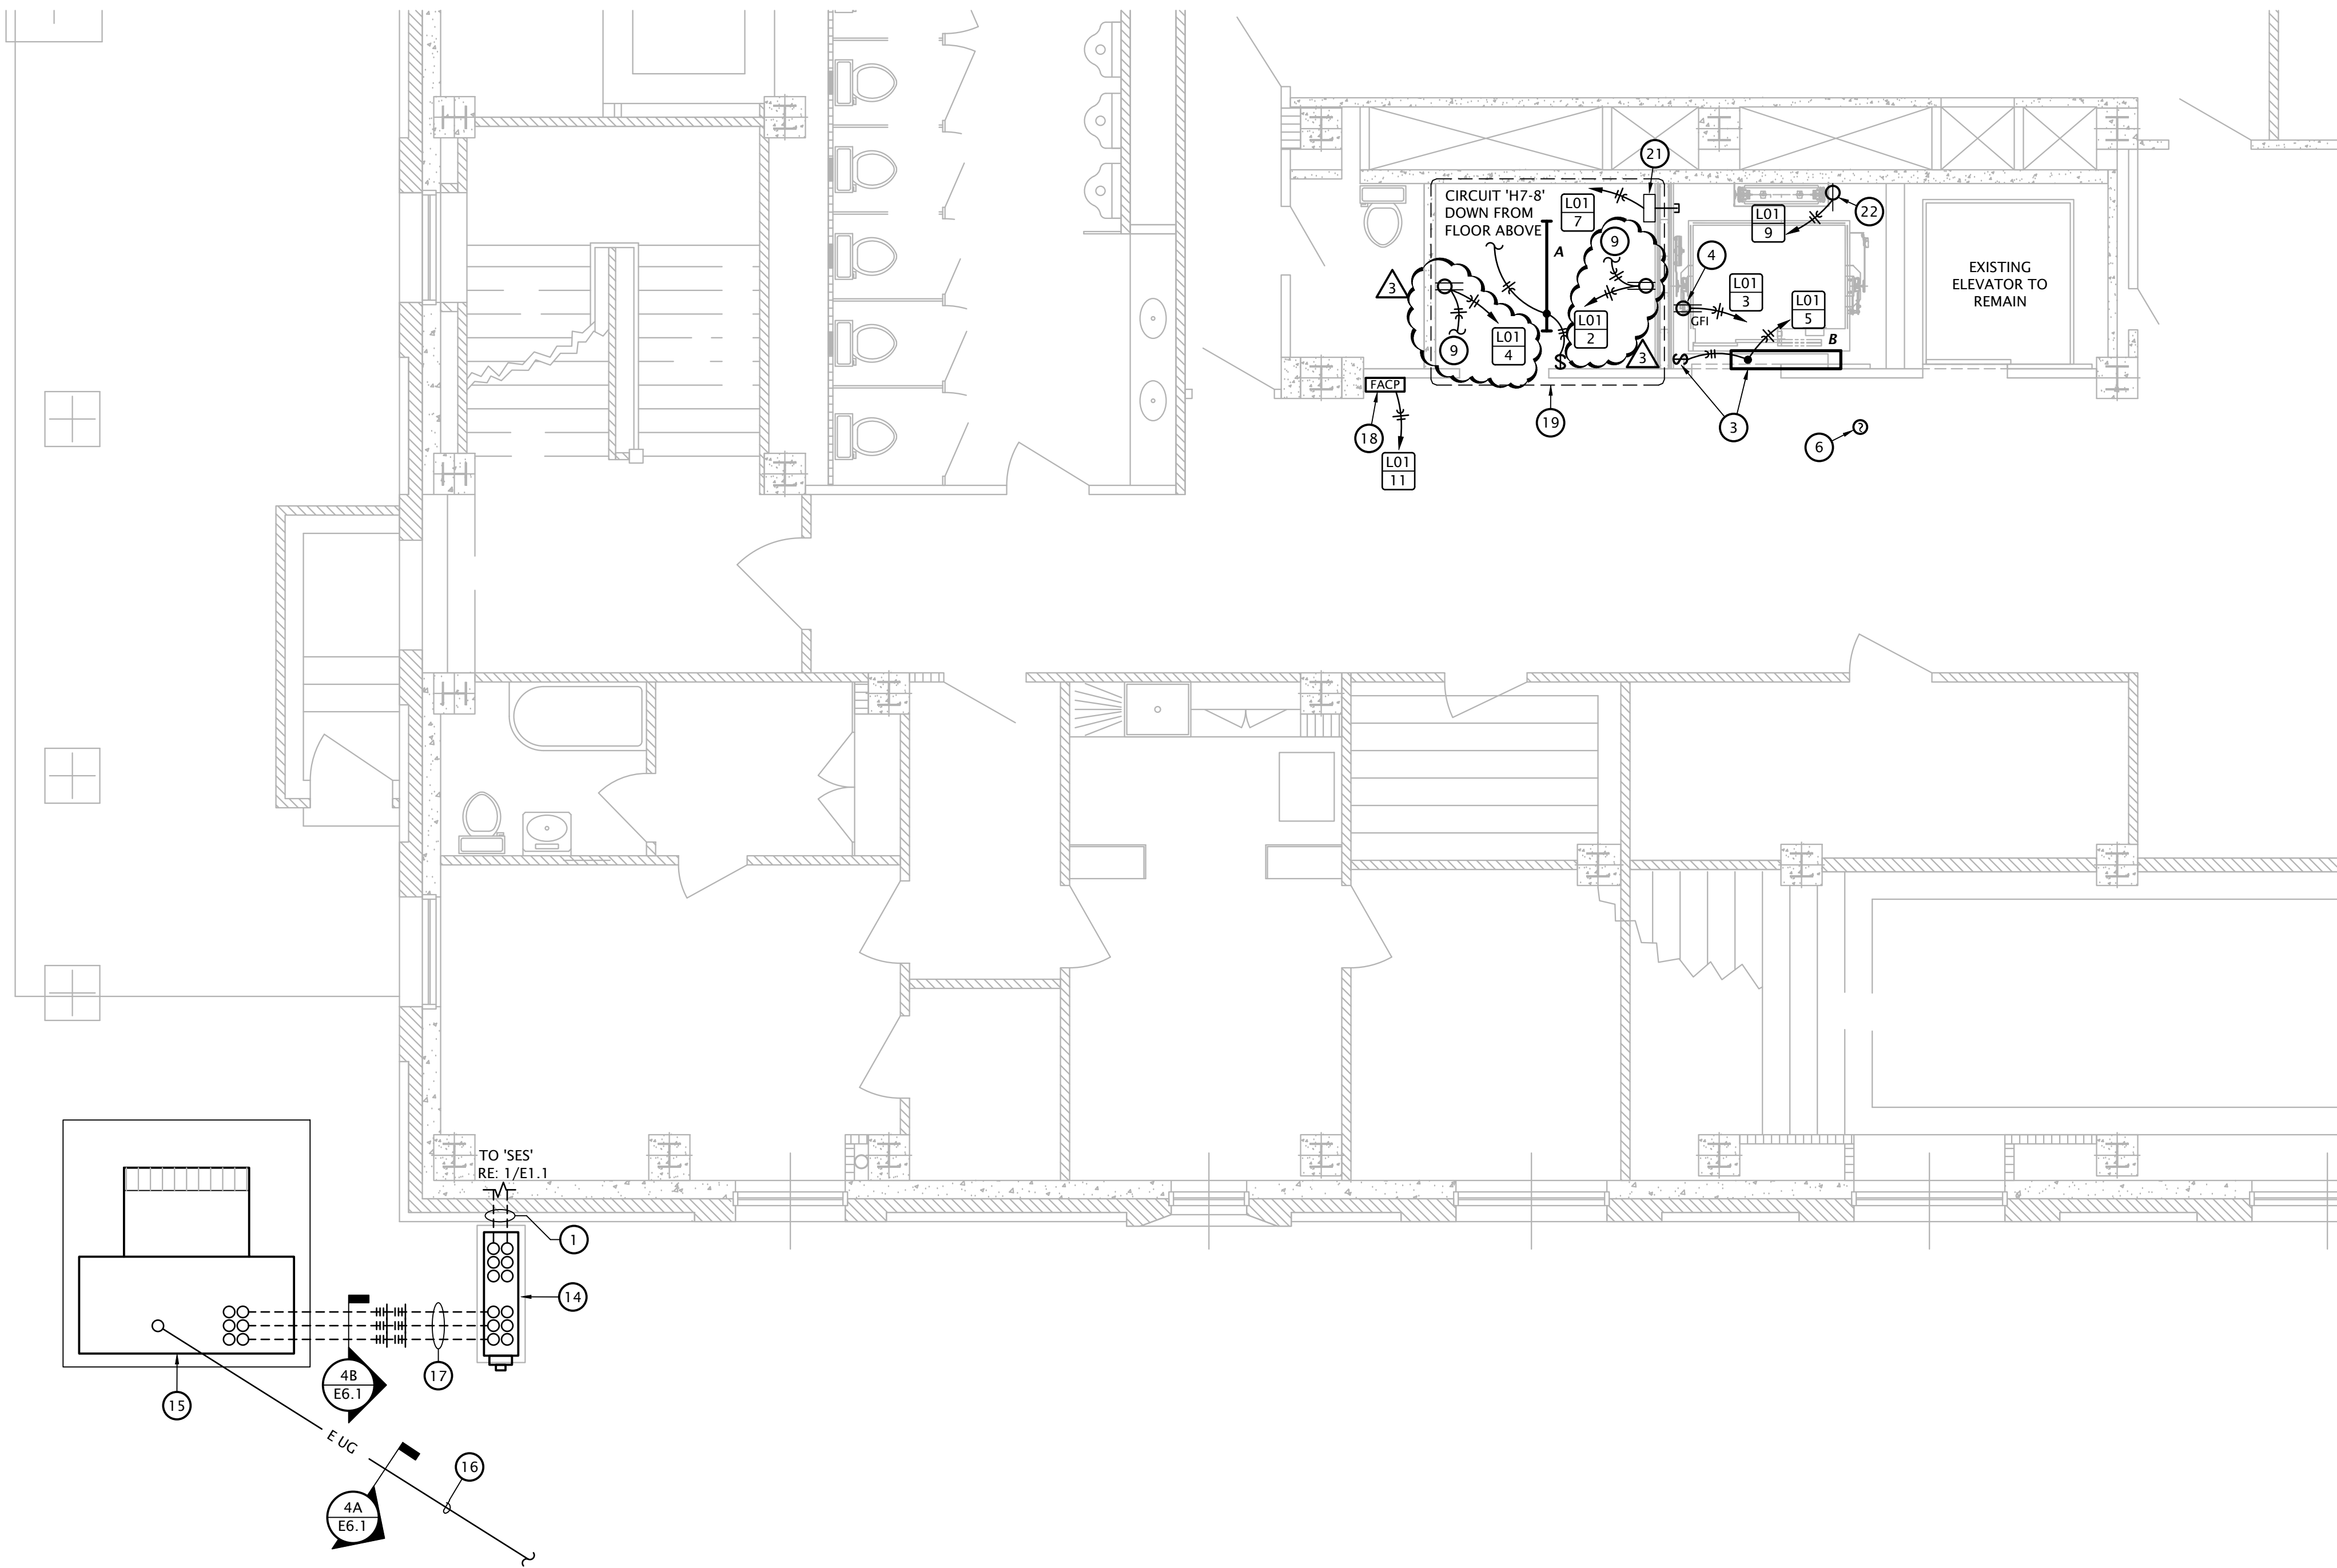

2 PARTIAL LOWER LEVEL ELECTRICAL PLAN
1/4" = 1'-0"

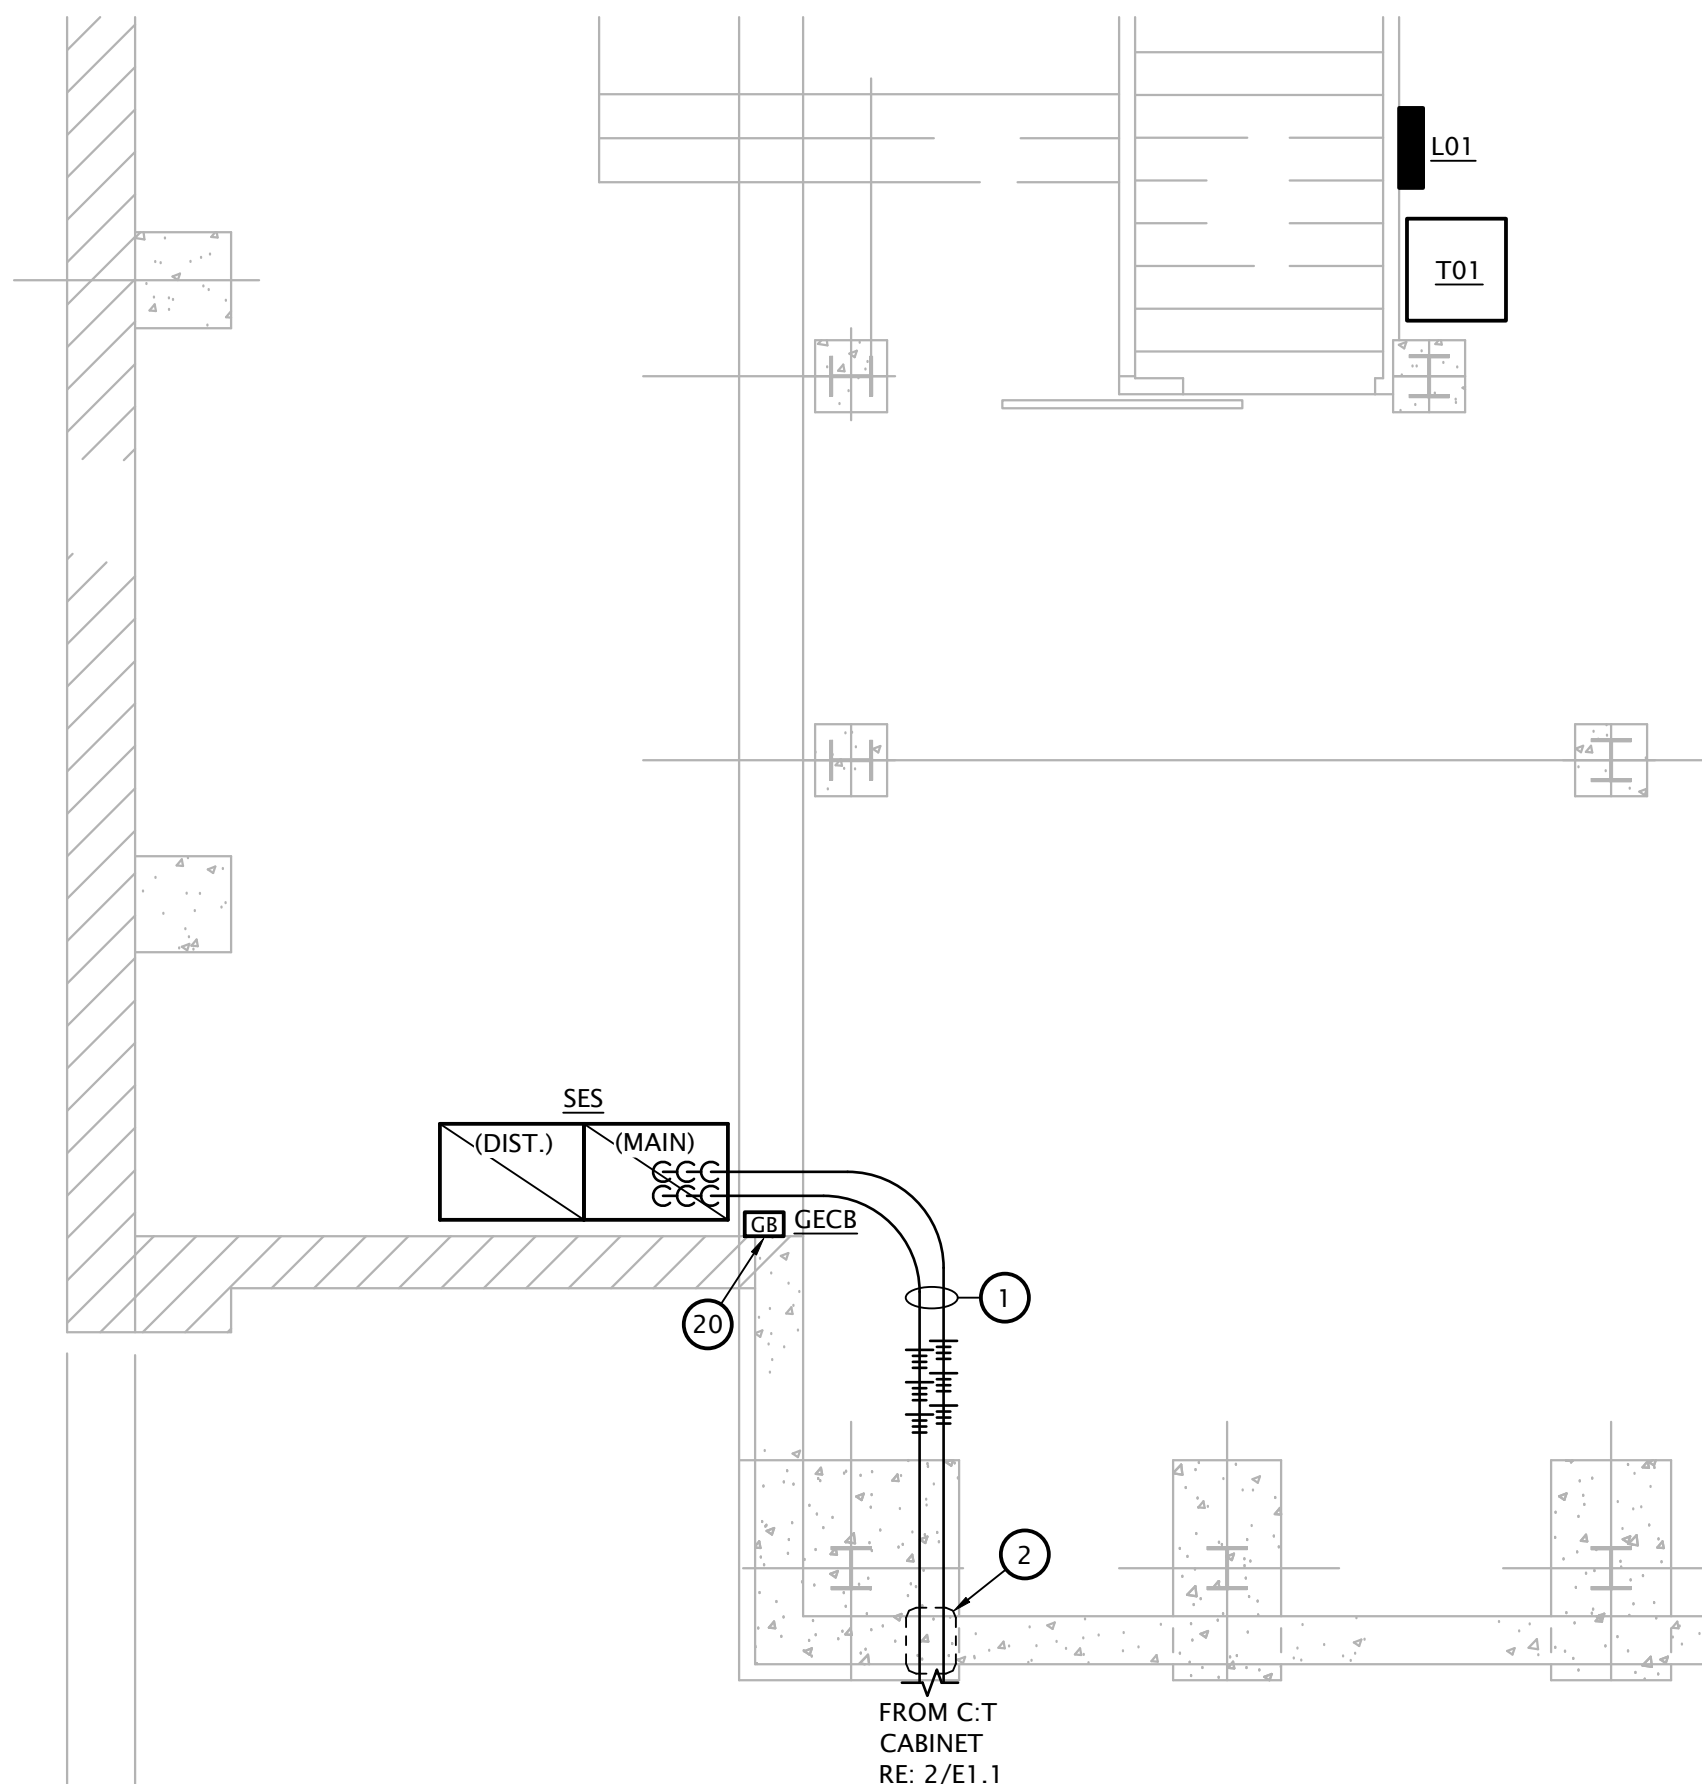

1 PARTIAL SUB-BASEMENT ELECTRICAL PLAN
1/4" = 1'-0"

LIGHT FIXTURE SCHEDULE								
MARK	MANUFACTURER	MODEL NUMBER	LAMP DATA	DRIVER	MOUNTING	FINISH	DESCRIPTION	NOTES
A	DAY-BRITE	FSS455L840-UNV-DIM-PAF	42W LED 5500 LUMEN	0-10V DIMMING	SUSPENDED TO 8'-6" AFF	WHITE	4' STRIP LIGHT WITH FROSTED ACRYLIC DIFFUSING LENS, WIDE DISTRIBUTION, ALL PARTS PAINTED AFTER FABRICATION	1
B	DAY-BRITE	DWPE43L840-4-UNV	38W LED 4400 LUMEN	0-10V DIMMING	SURFACE	WHITE	4' INDUSTRIAL VAPORTIGHT, FIBERGLASS BODY, POLYCARBONATE LENS	2
GENERAL: <ul style="list-style-type: none">All LED's shall be 4000 K correlated color temperature, minimum 80 CRI.All light fixtures shall be provided with universal drivers capable of operating at 120V or 277V UNO. NOTES: <ol style="list-style-type: none">Suspend fixture with aircraft cable to height indicated.U.L. listed for 'wet location'								

DRY-TYPE TRANSFORMER SCHEDULE							
Tag	KVA Size	Equipment Served	Primary Voltage	Secondary Voltage	Secondary Feeder Size	Grounding Electrode Conductor Size	Remarks
T01	30	PANEL 'L01'	480V-3φ,3W	208Y/120V-3φ,4W	SEE ONE-LINE DIAGRAM	#6	1
T71	30	PANEL 'L71'	480V-3φ,3W	208Y/120V-3φ,4W	SEE ONE-LINE DIAGRAM	#6	1
GENERAL NOTES: <ul style="list-style-type: none">All conductor sizes based on copperMaximum length of secondary conductors shall not exceed 25'-0" per NEC 240.21(C)(6).Bond grounding electrode conductor to nearest available grounding electrode per NEC 250.30(A)(7). REMARKS: <ol style="list-style-type: none">Mount transformer on 3'-1/2" high concrete housekeeping pad.							

Designation: H71 Location: Penthouse Voltage: 480Y/277V-3Ph-4W Enclosure: NEMA 1 Mounting: Surface				Manufacturer: Square D 'NF' Bus Amps: 125 MCB Amps: MLO AIC Rating: 14 kAIC Other: Integral Surge Protection			
Circuit #	Load Description	Conductors	C/B Size	C/B Size	Conductors	Load Description	Circuit #
1	ELEVATOR #1	3#6, #10G, 1°C	50 / 3	50 / 3	SEE ONE-LINE DIAGRAM	TRANSFORMER 'T71' (PANEL 'L71')	2
3							4
5							6
7	SPACE ONLY	---	---	20 / 1	2#12, #12G, 1/2°C	LTG. ELEC & STORAGE RMS	8
9	SPACE ONLY	---	---	---	---	SPACE ONLY	10
11	SPACE ONLY	---	---	---	---	SPACE ONLY	12
13	SPACE ONLY	---	---	---	---	SPACE ONLY	14
15	SPACE ONLY	---	---	---	---	SPACE ONLY	16
17	SPACE ONLY	---	---	---	---	SPACE ONLY	18
19	SPACE ONLY	---	---	---	---	SPACE ONLY	20
21	SPACE ONLY	---	---	---	---	SPACE ONLY	22
23	SPACE ONLY	---	---	---	---	SPACE ONLY	24
25	SPACE ONLY	---	---	---	---	SPACE ONLY	26
27	SPACE ONLY	---	---	---	---	SPACE ONLY	28
29	SPACE ONLY	---	---	---	---	SPACE ONLY	30

Designation: L71 Location: Penthouse Voltage: 208Y/120V-3Ph-4W Enclosure: NEMA 1 Mounting: Surface				Manufacturer: Square D 'NQ' Bus Amps: 100 MCB Amps: 100/3 AIC Rating: 10 kAIC Other: Integral Surge Protection			
Circuit #	Load Description	Conductors	C/B Size	C/B Size	Conductors	Load Description	Circuit #
1	SPARE BREAKER	---	20 / 1	20 / 1	2#12, #12G, 1/2°C	RCPTS: STORAGE ROOM	2
3	ELEVATOR CAB LTS/CONTROL	2#12, #12G, 1/2°C	20 / 1	20 / 1	2#12, #12G, 1/2°C	RCPTS: STORAGE ROOM	4
5	RCPT: ELEVATOR EQPM RM	2#12, #12G, 1/2°C	20 / 1	20 / 1	---	SPARE BREAKER	6
7	LTG: ELEVATOR EQPM RM	2#12, #12G, 1/2°C	20 / 1	---	---	SPACE ONLY	8
9	SPACE ONLY	---	---	---	---	SPACE ONLY	10
11	SPACE ONLY	---	---	---	---	SPACE ONLY	12
13	SPACE ONLY	---	---	---	---	SPACE ONLY	14
15	SPACE ONLY	---	---	---	---	SPACE ONLY	16
17	SPACE ONLY	---	---	---	---	SPACE ONLY	18
19	SPACE ONLY	---	---	---	---	SPACE ONLY	20
21	SPACE ONLY	---	---	---	---	SPACE ONLY	22
23	SPACE ONLY	---	---	---	---	SPACE ONLY	24
25	SPACE ONLY	---	---	---	---	SPACE ONLY	26
27	SPACE ONLY	---	---	---	---	SPACE ONLY	28
29	SPACE ONLY	---	---	---	---	SPACE ONLY	30

CIRCUIT BREAKER SWITCHBOARD SCHEDULE				
Designation: SES Location: Basement Voltage: 480Y/277V-3Ph-4W		Enclosure: NEMA 1 Mounting: Floor Manufacturer: Square D 'QED'		Bus Amps: 2000 MCB Amps: 2000/3 w/ GFPE AIC Rating: 65 kAIC
Circuit #	Equipment Served	Feeder Size	C/B Size	Remarks
1	Transformer 'T01' (Panel 'L01')	SEE ONE-LINE DIAGRAM	50/3	
2	Panel 'H71'	SEE ONE-LINE DIAGRAM	125/3	
3	250A Provisional Space	---	250A	See Note 3.
4	400A Provisional Space	---	400A	See Note 4.
Notes: <ol style="list-style-type: none">Switchboard shall be U.L. listed for use as Service Equipment.Provide switchboard with integral surge protection.Provide bussted mounting space for 12 additional 250 amp frame size future breakers.Provide bussted mounting space for 9 additional 400 amp frame size future breakers.Provide main breaker with 30mA rated Ground Fault Protection for Equipment (GFPE) and 120 V-ac shunt-trip coil.				

Designation: L01 Location: Basement Voltage: 208Y/120V-3Ph-4W Enclosure: NEMA 1 Mounting: Surface				Manufacturer: Square D 'NQ' Bus Amps: 100 MCB Amps: 100/3 AIC Rating: 10 kAIC Other: Integral Surge Protection			
Circuit #	Load Description	Conductors	C/B Size	C/B Size	Conductors	Load Description	Circuit #
1	SERVICE SHUNT-TRIP	2#12, #12G, 1/2°C	20 / 1	20 / 1	2#10, #10G, 1/2°C	RCPTS: STORAGE ROOMS	2
3	ELEVATOR PIT RCPT	2#12, #12G, 1/2°C	20 / 1	20 / 1	2#10, #10G, 1/2°C	RCPTS: STORAGE ROOMS	4
5	ELEVATOR PIT LIGHT	2#12, #12G, 1/2°C	20 / 1	20 / 1	---	SPARE BREAKER	6
7	ELEVATOR SUMP PUMP PANEL	2#12, #12G, 1/2°C	20 / 1	---	---	SPACE ONLY	8
9	ELEVATOR SUMP PUMP	2#12, #12G, 1/2°C	20 / 1	---	---	SPACE ONLY	10
11	FACP (ELEV. RECALL)	2#12, #12G, 1/2°C	20 / 1	---	---	SPACE ONLY	12
13	SPACE ONLY	---	---	---	---	SPACE ONLY	14
15	SPACE ONLY	---	---	---	---	SPACE ONLY	16
17	SPACE ONLY	---	---	---	---	SPACE ONLY	18
19	SPACE ONLY	---	---	---	---	SPACE ONLY	20
21	SPACE ONLY	---	---	---	---	SPACE ONLY	22
23	SPACE ONLY	---	---	---	---	SPACE ONLY	24
25	SPACE ONLY	---	---	---	---	SPACE ONLY	26
27	SPACE ONLY	---	---	---	---	SPACE ONLY	28
29	SPACE ONLY	---	---	---	---	SPACE ONLY	30

PANEL SCHEDULE NOTES BY SYMBOL

1. PROVIDE BREAKER WITH "LOCK ON" HASP/CLAMP DEVICE.

LST

Consulting Engineers, PA

MANHATTAN
4809 Van Duane Plaza, Suite 201
Manhattan, KS 66503
785.587.8042

WICHITA
125 S. Washington, Suite 150
Wichita, Kansas 67202
316.288.0696

Project 24088

August 2025

CIRCUIT AND RACEWAY SYMBOLS

#

#

CIRCUIT DESIGNATION:
TOP INDICATES PANEL OF CIRCUIT ORIGIN
BOTTOM INDICATES CIRCUIT NUMBER

→

→

HOMERUN - WIRING TO PANEL OF CIRCUIT ORIGIN
PARTIAL HOMERUN - WIRING TO PANEL OF CIRCUIT ORIGIN

—

—

CONDUIT CONCEALED IN WALL OR ABOVE CEILING
CONDUIT BELOW GRADE OR EMBEDDED IN CONCRETE

—

—

CONDUIT FOR UNDERGROUND ELECTRICAL PRIMARY
LINE VOLTAGE CIRCUIT CONDUCTORS

⌋

⌋

SHORT = HOT/TRACER/SWITCH LEG CONDUCTOR
LONG = NEUTRAL (GROUNDED) CONDUCTOR
CURVED = GROUNDING (BONDING) CONDUCTOR

—

—

CONDUIT STUB OUT WITH NYLON END BUSHING
CONDUIT TURNED UP

—

—

CONDUIT TURNED DOWN
GROUNDING CONNECTION

LIGHTING SYMBOLS

⌋

⌋

PENDANT OR SURFACE MOUNTED LINEAR LUMINAIRE

⌋

⌋

STANDARD LENSED STRIP LIGHT

POWER SYMBOLS

⊖

⊖

SINGLE RECEPTACLE
DUPLEX RECEPTACLE

⊖

⊖

DOUBLE DUPLEX RECEPTACLE

⊖

⊖

SINGLE POLE TOGGLE SNAP SWITCH

⊖

⊖

PUSH BUTTON OPERATOR

⊖

⊖

JUNCTION BOX

⊖

⊖

MOTOR

⊖

⊖

GROUNDING BAR

⊖

⊖

DISCONNECT SWITCH

⊖

⊖

BRANCH CIRCUIT PANELBOARD, SURFACE MOUNTED

⊖

⊖

DISTRIBUTION SWITCHBOARD

⊖

⊖

DRY-TYPE TRANSFORMER

TELECOMMUNICATIONS SYMBOLS

◀

TELECOMMUNICATIONS OUTLET

FIRE ALARM SYMBOLS

FACP

FIRE ALARM CONTROL PANEL

⊖

HEAT DETECTOR

⊖

AREA SMOKE DETECTOR

MM

ADDRESSABLE MONITORING MODULE

RM

ADDRESSABLE RELAY MODULE

⊖

CONVENTIONAL FIRE ALARM RELAY

SYMBOL MODIFYING DESIGNATORS

CLG

CEILING MOUNTED

- FLUSH MOUNTED IN SUSPENDED CEILINGS
- SURFACE MOUNTED TO STRUCTURE ABOVE IN OPEN CEILINGS

e

DEVICE IS EXISTING TO REMAIN

GFI

GROUND FAULT CIRCUIT INTERRUPTING DEVICE

NL

NIGHTLIGHT WIRED TO UNSWITCHED HOT CONDUCTOR

WP

PROVIDE WEATHERPROOF ENCLOSURE FOR DEVICE

XX"

MOUNTING HEIGHT OF DEVICE ABOVE FINISHED FLOOR

JonesGillamRenz

Salina, KS 67401
785.827.0386
jgr@jgrarchitects.com

JGR

SALINA, KANSAS

THE TEMPLE

SALINA INNOVATION FOUNDATION
ELEVATOR REHABILITATION PROJECT

Professional Engineer

14654

5 Aug 2025

KANSAS

REVISION:

- ADDENDUM 1 - 8-14-2025
- ADDENDUM 2 - 9-3-2025
- ASI #2 - 1-28-2026

DATE: 8-5-2025
JOB: 25-3499
SHEET NO.: E6.2

COPYRIGHTED