



ENGINEER: SCOTT P. EVANS
P.E. NO. 24423 EXP. 04/30/26

SITE SUMMARY	
LOT AREA (EXISTING)	± 222,916 S.F. (5.12 AC.)
LOT AREA (LOT 4A)	± 137,143 S.F. (3.15 AC.)
BUILDING AREA (FOOTPRINT)	± 18,276 S.F. (0.42 AC.)
BUILDING AREA (GROSS FLOOR AREA)	± 75,765 S.F. (1.74 AC.)
PERCENT LOT COVERAGE (LOT 4A)	13%
PERVIOUS AREA (POST CONSTRUCTION)	± 221,118 S.F. (5.08 AC.)
TOTAL IMPERVIOUS AREA (PRE-CONSTRUCTION)	± 1,788 S.F. (0.04 AC.)
TOTAL IMPERVIOUS AREA (POST CONSTRUCTION)	± 114,130 S.F. (2.62 AC.)

PARKING SUMMARY		
STANDARD AUTO PARKING	STALLS REQUIRED	STALLS PROVIDED
ACCESSIBLE AUTO PARKING	142	198
TOTAL AUTO PARKING	147	207

NOTE: BASED ON INFORMATION PROVIDED BY JGR.
1.5 UNIT (57 UNITS x 1.5 = 86 STALLS)
1,025 SF OF RETAIL AREA (15,203 SF/250 SF = 61 STALLS)

NOTES
1. SITE PLAN IS CONCEPTUAL IN NATURE AND INTENDED FOR DEVELOPMENT REVIEW. THIS CONCEPT SHOULD NOT BE USED FOR PRICING OR CONSTRUCTION.

LEGEND

- EXISTING SANITARY SEWER
- EXISTING WATER LINE
- EXISTING STORM WATER SEWER
- EXISTING GAS LINE
- EXISTING FIBER OPTIC LINE
- EXISTING FENCE
- PROPERTY LINE
- SETBACK LINE
- EASEMENT LINE
- 8" SS — 8" SS — PROPOSED SANITARY SEWER
- 30" SWS — 30" SWS — PROPOSED STORM WATER SEWER
- 8" W — 8" W — PROPOSED WATER LINE
- DW — DW — PROPOSED DOMESTIC WATER LINE
- FP — FP — PROPOSED FIRE PROTECTION LINE
- PROPOSED 5" ASPHALT PAVEMENT
- PROPOSED 4" ASPHALT PAVEMENT
- PROPOSED 6" CONCRETE
- PROPOSED 6" CONCRETE
- PROPOSED CONCRETE SIDEWALK

CONTROL POINTS

THE HORIZONTAL DATUM IS BASED ON THE KANSAS COORDINATE SYSTEM OF 1983, NAD83(2011), EPOCH: 2010.0000, SOUTH ZONE AND BASED ON THE "US SURVEY FOOT" DEFINITION. COORDINATES SHOWN HAVE BEEN MODIFIED TO THE GROUND USING A COMBINED ADJUSTMENT FACTOR OF 1.0001200144. STATE PLANE COORDINATES CAN BE CALCULATED BY MULTIPLYING THE SHOWN VALUES BY 0.99988.

THE VERTICAL DATUM IS BASED ON THE NAVD 88 DATUM, GEOID18.

CP105
N: 1675470.143 E: 1585788.537 EL: 1456.558
DESCRIPTION OF CONTROL POINT: 5/8" REBAR WITH MKEC CPA AT THE SW END OF BERM AT THE TOP OF BERM.


CP106
N: 1675478.400 E: 1586572.217 EL: 1456.589
DESCRIPTION OF CONTROL POINT: -CUT ON THE WEST END OF SIDEWALK WEST OF 183RD AND SE OF WALMART.

CP107
N: 1675172.351 E: 1586614.849 EL: 1455.989
DESCRIPTION OF CONTROL POINT: REBAR WITH 2 1/2" PLASTIC DISC STAMPED "TOPO POINT" ON THE SOUTH RETURN OF MOST SOUTHERLY DRIVE OF KPC PIPELINE ENTRANCE.

BENCHMARKS:
BM108
N: 1675478.400 E: 1586572.217 EL: 1456.589
DESCRIPTION OF BENCHMARK: -CUT ON THE WEST EDGE OF SIDEWALK WEST OF 183RD AND SE OF WALMART.

BM107
N: 1675172.351 E: 1586614.849 EL: 1455.989
DESCRIPTION OF BENCHMARK: REBAR WITH 2 1/2" PLASTIC DISC STAMPED "TOPO POINT" ON THE SOUTH RETURN OF MOST SOUTHERLY DRIVE OF KPC PIPELINE ENTRANCE.

ALL CONTROL POINTS SHOWN HAVE ELEVATIONS ESTABLISHED USING STANDARD SURVEYING PROCEDURES AND CAN BE USED AS TEMPORARY BENCHMARKS. WHEN USING A CONTROL POINT AS A TEMPORARY BENCHMARK, IT IS RECOMMENDED THAT CROSS-CHECKS BE MADE TO OTHER CONTROL POINTS OR BENCHMARKS TO CONFIRM ELEVATIONS PRIOR TO USE.

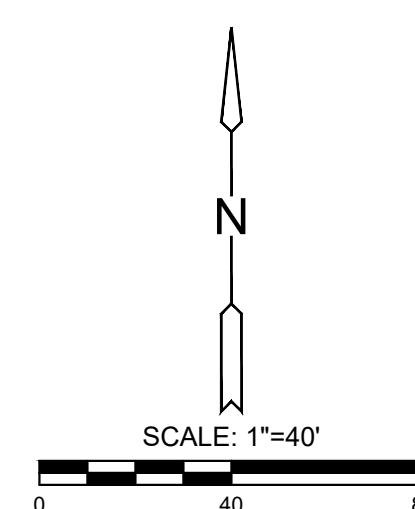

WARNING
EXISTING UNDERGROUND UTILITIES IN THE AREA. CONTRACTOR IS RESPONSIBLE FOR DETERMINING THE HORIZONTAL AND VERTICAL LOCATION OF ALL UTILITIES PRIOR TO CONSTRUCTION. CONTRACTOR IS RESPONSIBLE FOR ANY REPAIRS TO EXISTING UTILITIES DUE TO DAMAGE INCURRED DURING CONSTRUCTION. CONTRACTOR SHALL NOTIFY THE ENGINEER OF ANY DISCREPANCIES ON THE PLANS.

CIVIL PLANS FOR THE RESERVE AT THE MEADOWS

GODDARD, KS


OVERALL SITE PLAN


PROJECT NO.	2501010800	
SCALE	1"=40'	
DRAWN	DESIGNED	CHECKED
BKS	TMBB	SPE

NO.	ISSUED FOR PERMIT	DATE
0	ISSUED FOR PERMIT	04/03/26

SHEET NO. C-050


PLOTTED BY: BRYAN SMITH 4/22/2026 4:41 PM
 DWG PATH: J:\PROJECTS\2502501010800\183RD_ST_WALKWAY_RESERVE_AT_THE_MEADOWS\CAD\BIDS\CIVILISTE
 DWG NAME: 2502501010800_183RD_ST_WALKWAY_RESERVE_AT_THE_MEADOWS
 ©2026 MKEC ENGINEERING, INC. ALL RIGHTS RESERVED WWW.MKEC.COM. THESE DRAWINGS AND THEIR CONTENTS, INCLUDING, BUT NOT LIMITED TO, ALL CONCEPTS, DESIGNS, & IDEAS ARE THE EXCLUSIVE PROPERTY OF MKEC ENGINEERING, INC. (MKEC) AND MAY NOT BE USED OR REPRODUCED IN ANY WAY WITHOUT THE EXPRESS CONSENT OF MKEC.

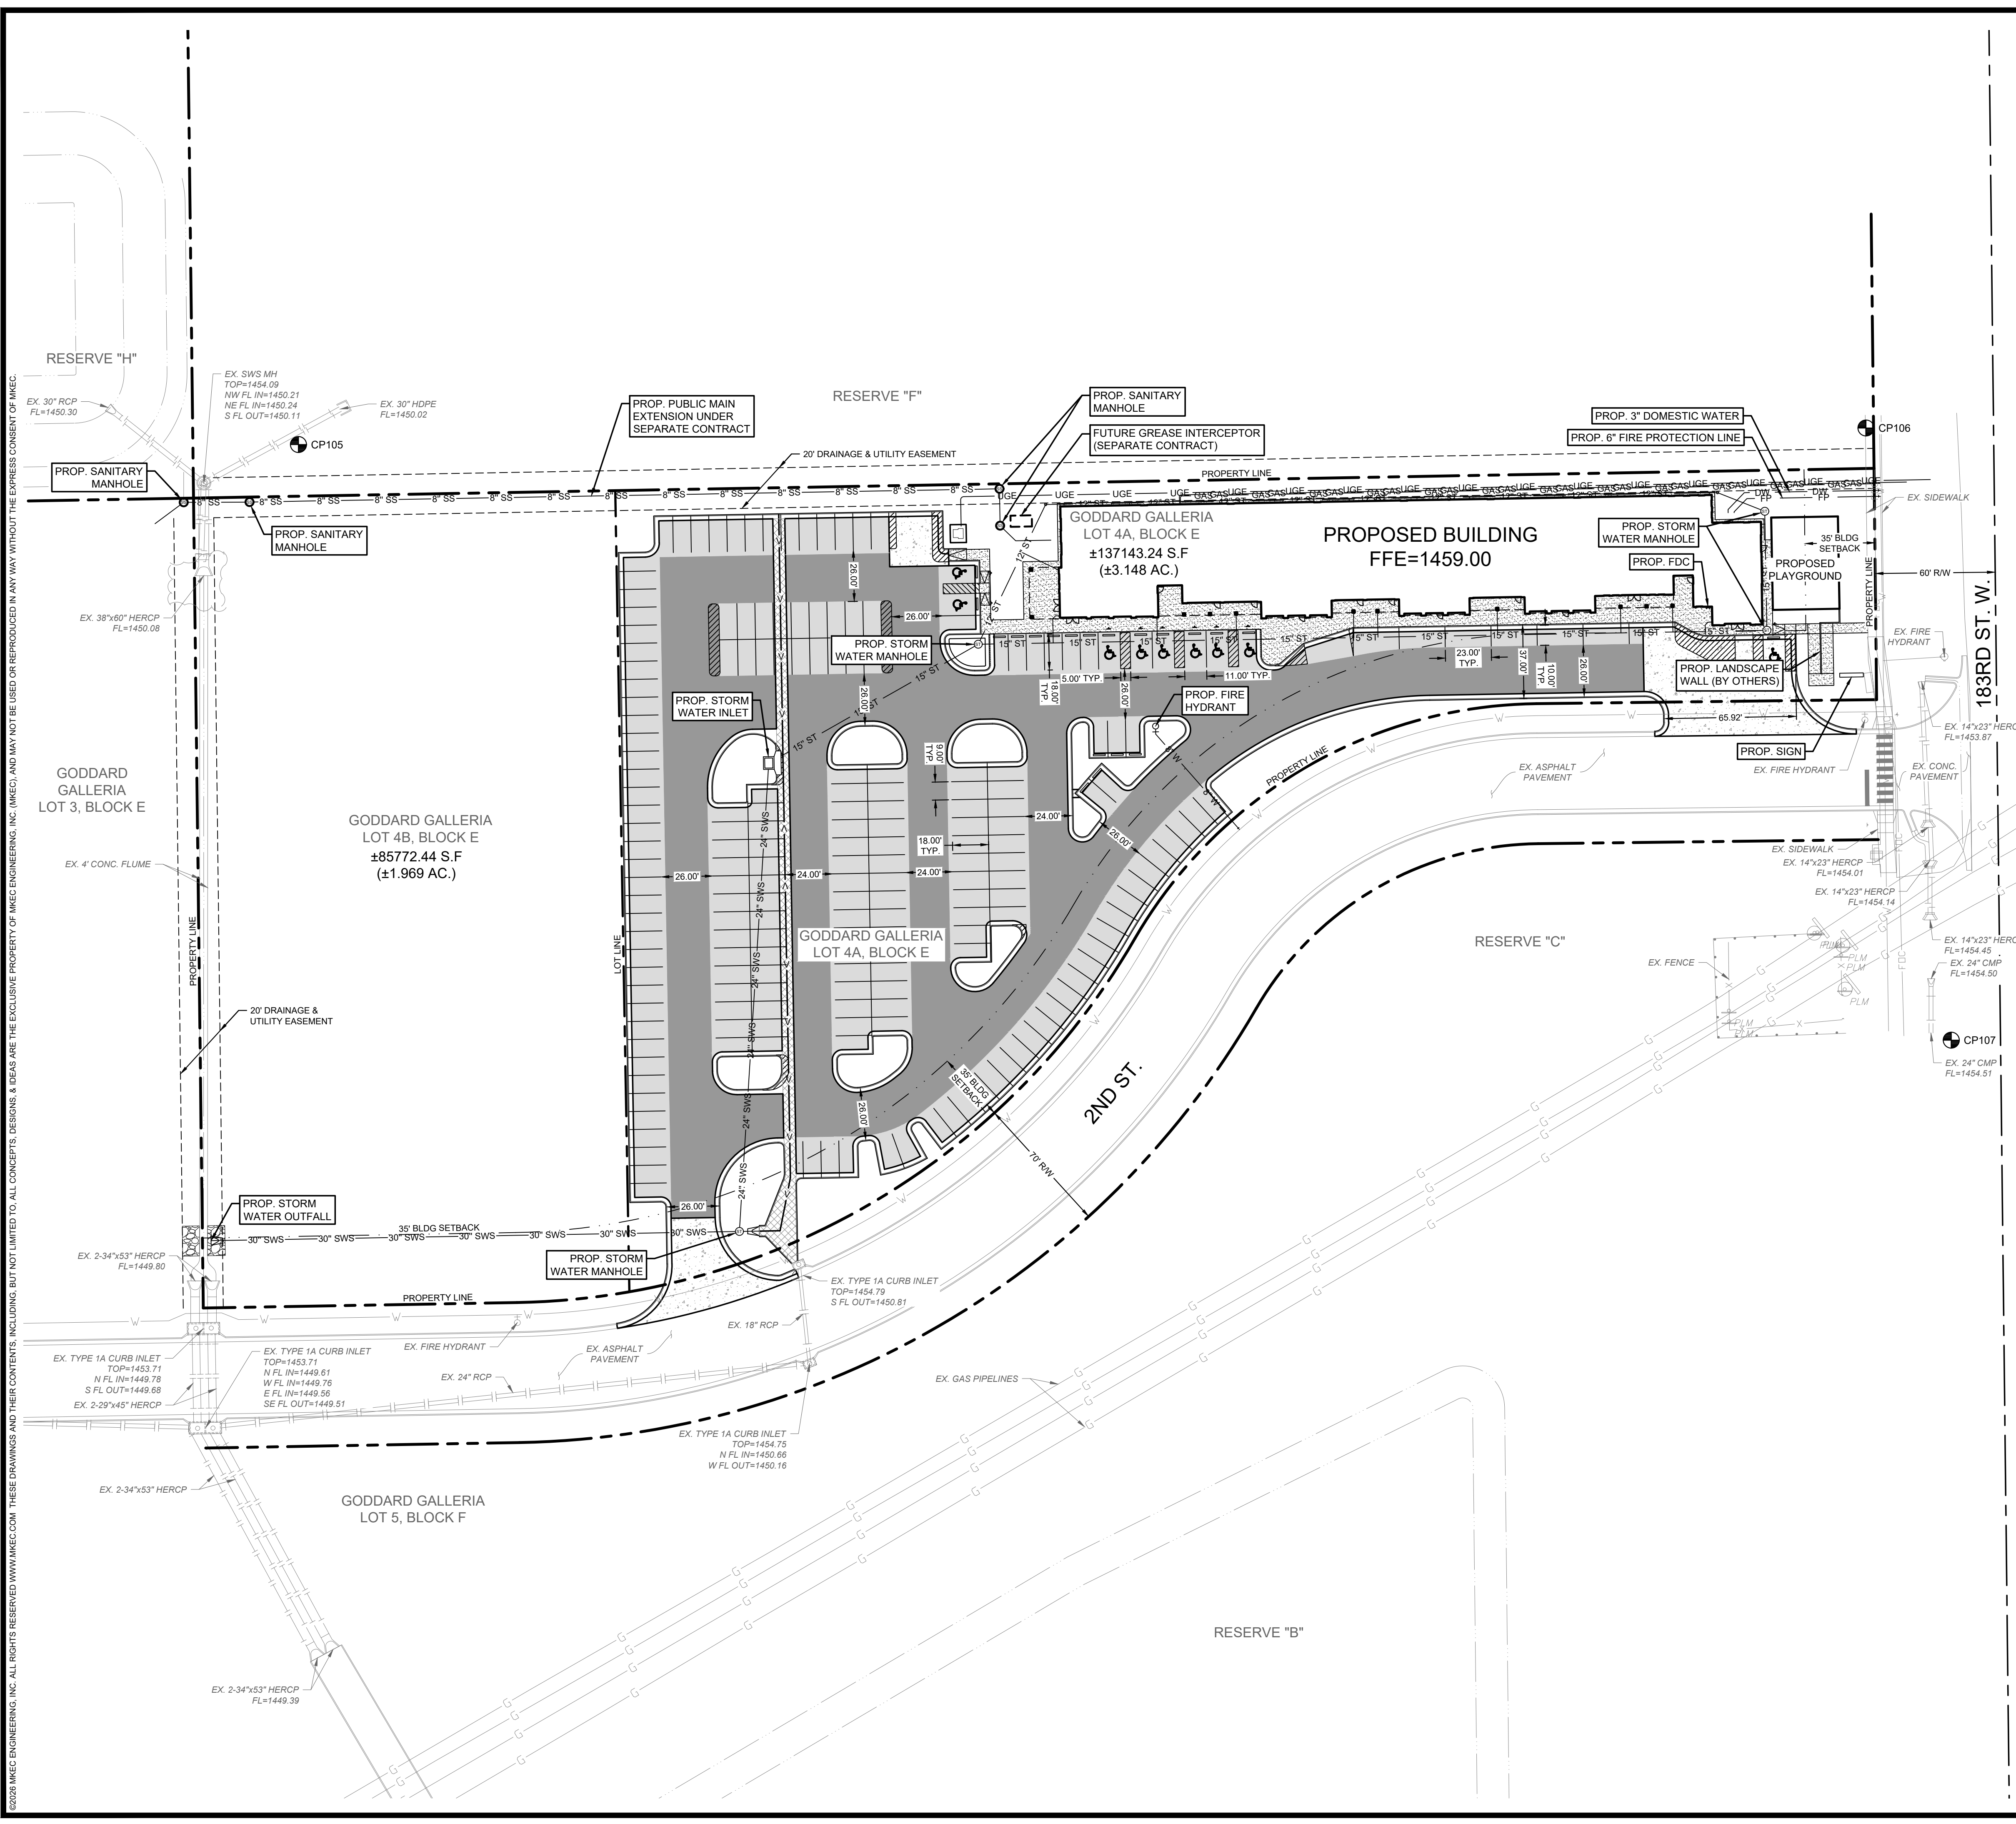

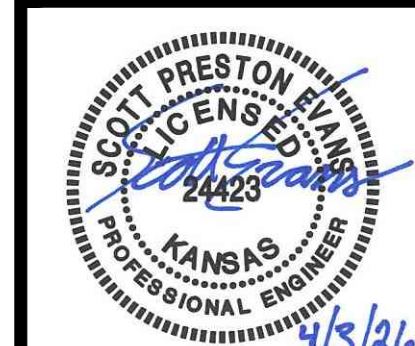

ENGINEER: SCOTT P. EVANS
P.E. NO. 24423 EXP. 04/30/26

CIVIL PLANS FOR
THE RESERVE AT THE MEADOWS
GODDARD, KS

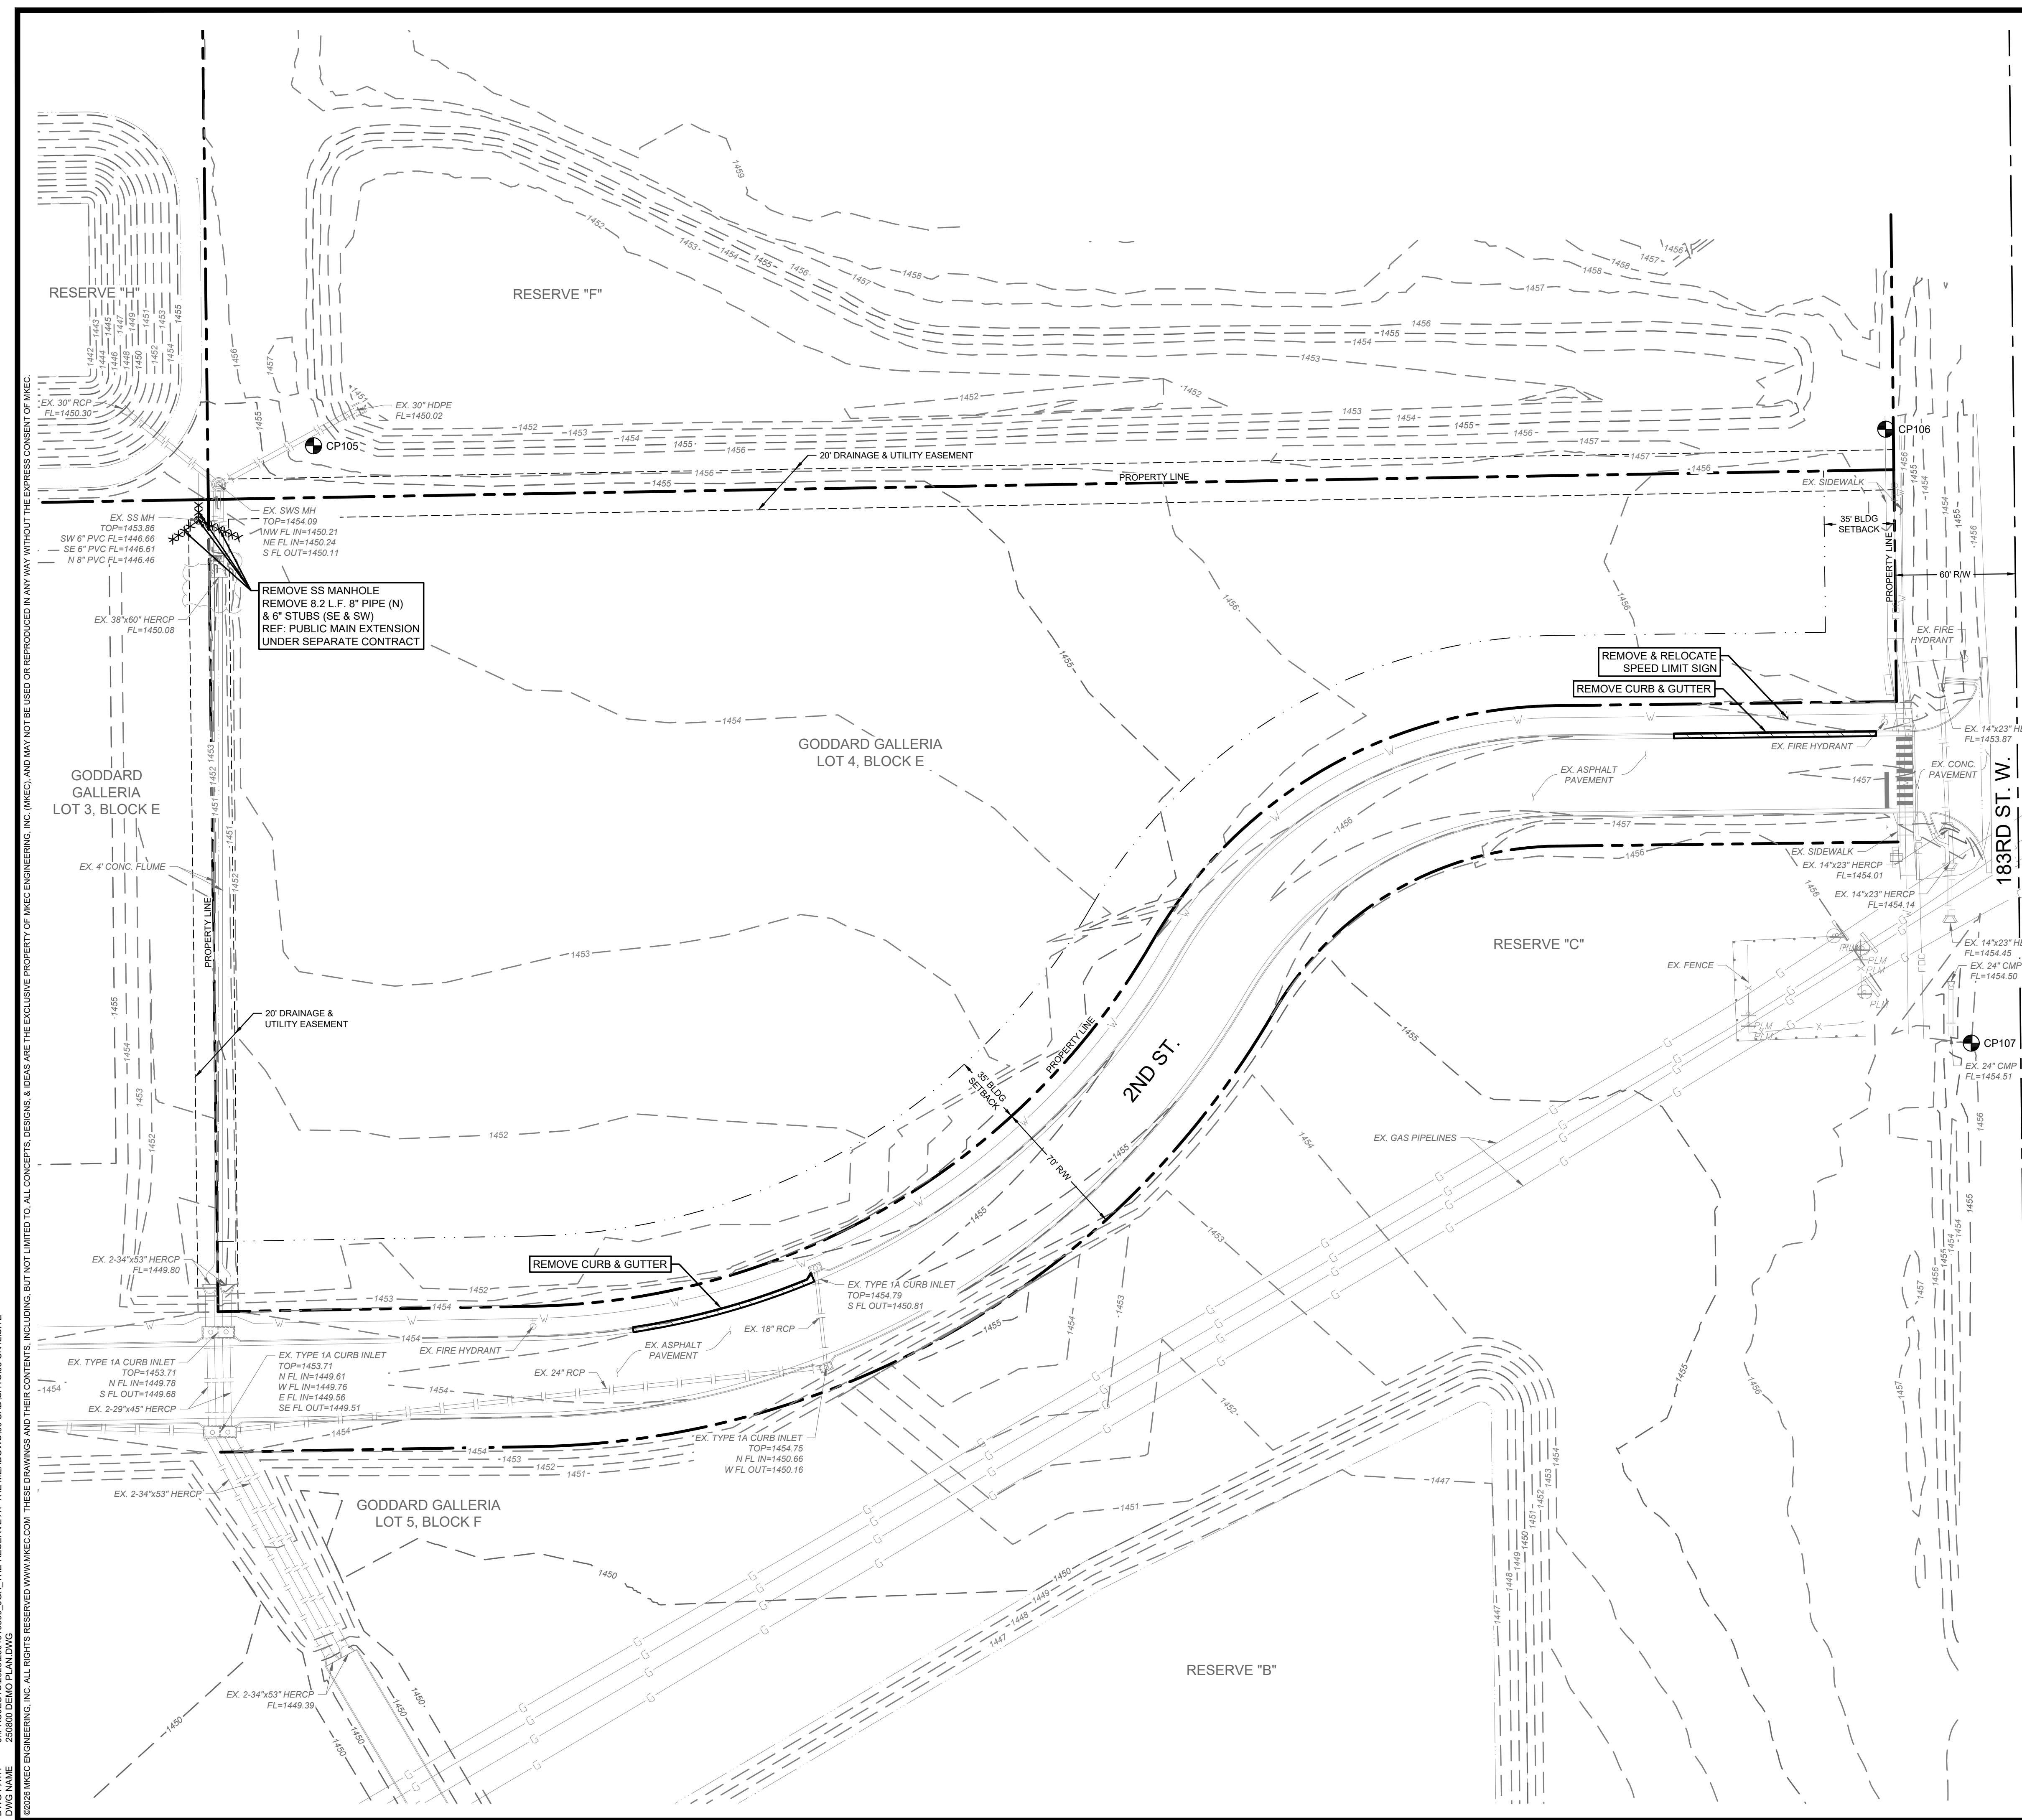

NOTES

1. PRIOR TO DEMOLITION ACTIVITIES, CONTRACTOR TO NOTIFY THE ENGINEER IMMEDIATELY SHOULD THERE BE ANY DISCREPANCIES OR IF THE EXISTING CONDITIONS VARY FROM THOSE SHOWN ON THESE PLANS.
2. ALL MATERIALS REMOVED FROM THE SITE SHALL BE DISPOSED OF PER LOCAL AND STATE REQUIREMENTS.
3. CONTRACTOR TO COORDINATE WITH FRANCHISE UTILITY PROVIDERS FOR REMOVAL/RELOCATION OF EXISTING SERVICES.
4. CONTRACTOR SHALL BE RESPONSIBLE TO REPAIR AND REPLACE EXISTING CONCRETE SIDEWALK, CURB, AND ANY EXISTING PAVEMENT DAMAGED DURING CONSTRUCTION.
5. CONTRACTOR SHALL OBTAIN ALL PERMITS NECESSARY PRIOR TO THE START OF CONSTRUCTION, INCLUDING BUT NOT LIMITED TO, RIGHT-OF-WAY, HAULING AND LAND DISTURBANCE PERMITS WITH THE APPROPRIATE LOCAL JURISDICTION.
6. MKEC MAKES NO GUARANTEE THAT THE UNDERGROUND UTILITIES SHOWN COMPRISE ALL SUCH UTILITIES IN THE AREA, EITHER IN SERVICE OR ABANDONED. MKEC FURTHER DOES NOT WARRANT THAT THE UNDERGROUND UTILITIES SHOWN ARE IN THE EXACT LOCATION INDICATED ALTHOUGH DOES CERTIFY THAT THEY ARE LOCATED AS ACCURATELY AS POSSIBLE FROM INFORMATION PROVIDED. MKEC HAS NOT PHYSICALLY LOCATED THE UNDERGROUND UTILITIES.
7. THE EXISTING SURFACE DEPICTED IN THESE DRAWINGS IS A COMBINATION OF MKEC'S FIELD SURVEY AND THE PROPOSED SURFACE FOR THE PUBLIC ROADWAY IMPROVEMENTS ALONG 2ND STREET. MKEC'S SURVEY WAS OBTAINED PRIOR TO THE PUBLIC INFRASTRUCTURE PROJECT WORK. DISCREPANCIES MAY EXIST TO THE ACTUAL EXISTING SURFACE AT THE TIME OF THIS PROJECT'S WORK. CONTRACTOR TO VERIFY EXISTING TIE IN ELEVATIONS ALONG 2ND STREET.

LEGEND

- - - - - 1454 - - - - - EXISTING CONTOURS
- - - - - EXISTING SANITARY SEWER
- - - - - EXISTING WATER LINE
- - - - - EXISTING STORM WATER SEWER
- - - - - EXISTING GAS LINE
- - - - - EXISTING FIBER OPTIC LINE
- - - - - EXISTING FENCE
- - - - - PROPERTY LINE
- - - - - SETBACK LINE
- - - - - EASEMENT LINE
- XXXXXXXXXXXXXXXXXXXXX FENCE & UTILITY REMOVAL
- XXXXXXXXXXXXXXXXXXXXX PAVEMENT REMOVAL

CONTROL POINTS

THE HORIZONTAL DATUM IS BASED ON THE KANSAS COORDINATE SYSTEM OF 1983, NAD83(2011), EPOCH 2010.0000, SOUTH ZONE AND BASED ON THE "US SURVEY FOOT" DEFINITION. COORDINATES SHOWN HAVE BEEN MODIFIED TO THE GROUND USING A COMBINED ADJUSTMENT FACTOR OF 1.0001200144. STATE PLANE COORDINATES CAN BE CALCULATED BY MULTIPLYING THE SHOWN VALUES BY 0.99988.

THE VERTICAL DATUM IS BASED ON THE NAVD 88 DATUM, GEOID18.

CP105
N: 1675470.143 E: 1585788.537 EL: 1456.558
DESCRIPTION OF CONTROL POINT: 5/8" REBAR WITH MKEC CPA AT THE SW END OF BERM AT THE TOP OF BERM.


CP106
N: 1675478.400 E: 1586572.217 EL: 1456.589
DESCRIPTION OF CONTROL POINT: 4" CUT ON THE WEST END OF SIDEWALK WEST OF 183RDI AND SE OF WALMART.

CP107
N: 1675172.351 E: 1586614.849 EL: 1455.989
DESCRIPTION OF CONTROL POINT: REBAR WITH 2 1/2" PLASTIC DISC STAMPED 'TOPO POINT' ON THE SOUTH RETURN OF MOST SOUTHERLY DRIVE OF KPC PIPELINE ENTRANCE.

BENCHMARKS:
BM106
N: 1675478.400 E: 1586572.217 EL: 1456.589
DESCRIPTION OF BENCHMARK: 4" CUT ON THE WEST END OF SIDEWALK WEST OF 183RDI AND SE OF WALMART.

BM107
N: 1675172.351 E: 1586614.849 EL: 1455.989
DESCRIPTION OF BENCHMARK: REBAR WITH 2 1/2" PLASTIC DISC STAMPED 'TOPO POINT' ON THE SOUTH RETURN OF MOST SOUTHERLY DRIVE OF KPC PIPELINE ENTRANCE.

ALL CONTROL POINTS SHOWN HAVE ELEVATIONS ESTABLISHED USING STANDARD SURVEYING PROCEDURES AND CAN BE USED AS TEMPORARY BENCHMARKS. WHEN USING A CONTROL POINT AS A TEMPORARY BENCHMARK, IT IS RECOMMENDED THAT CROSS-CHECKS BE MADE TO OTHER CONTROL POINTS OR BENCHMARKS TO CONFIRM ELEVATIONS PRIOR TO USE.

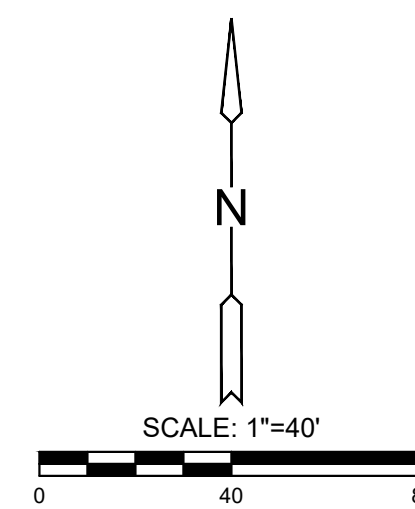

WARNING
EXISTING UNDERGROUND UTILITIES IN THE AREA. CONTRACTOR IS RESPONSIBLE FOR DETERMINING THE HORIZONTAL AND VERTICAL LOCATION OF ALL UTILITIES PRIOR TO CONSTRUCTION. CONTRACTOR IS RESPONSIBLE FOR ANY REPAIRS TO EXISTING UTILITIES DUE TO DAMAGE INCURRED DURING CONSTRUCTION. CONTRACTOR SHALL NOTIFY THE ENGINEER OF ANY DISCREPANCIES ON THE PLANS.

PLOTTED BY: BRYAN SMITH 4/22/2026 4:41 PM
 DWG PATH: J:\PROJECTS\2025\2501010800_JGR_THE RESERVE AT THE MEADOWS\00 CAD\BHS\06 CIVILISTE
 DWG NAME: 2501010800_PLAN.DWG
 ©2026 MKEC ENGINEERING, INC. ALL RIGHTS RESERVED WWW.MKEC.COM THESE DRAWINGS AND THEIR CONTENTS, INCLUDING, BUT NOT LIMITED TO, ALL CONCEPTS, DESIGNS, & IDEAS ARE THE EXCLUSIVE PROPERTY OF MKEC ENGINEERING, INC. (MKEC) AND MAY NOT BE USED OR REPRODUCED IN ANY WAY WITHOUT THE EXPRESS CONSENT OF MKEC.

DEMOLITION PLAN		
PROJECT NO.	2501010800	
SCALE	1"=40'	
DRAWN	DESIGNED	CHECKED
BKS	TMBB	SPE
0	ISSUED FOR PERMIT	04/03/26
NO.	REVISION	DATE
SHEET NO. C-101		

CIVIL PLANS FOR
THE RESERVE AT THE MEADOWS
GODDARD, KS

DIMENSIONAL CONTROL
AND PAVING PLAN
(1 OF 3)


PROJECT NO. 2501010800

SCALE 1"=20'

DRAWN	DESIGNED	CHECKED
BKS	TMBB	SPE

0	ISSUED FOR PERMIT	04/03/26
NO.	REVISION	DATE

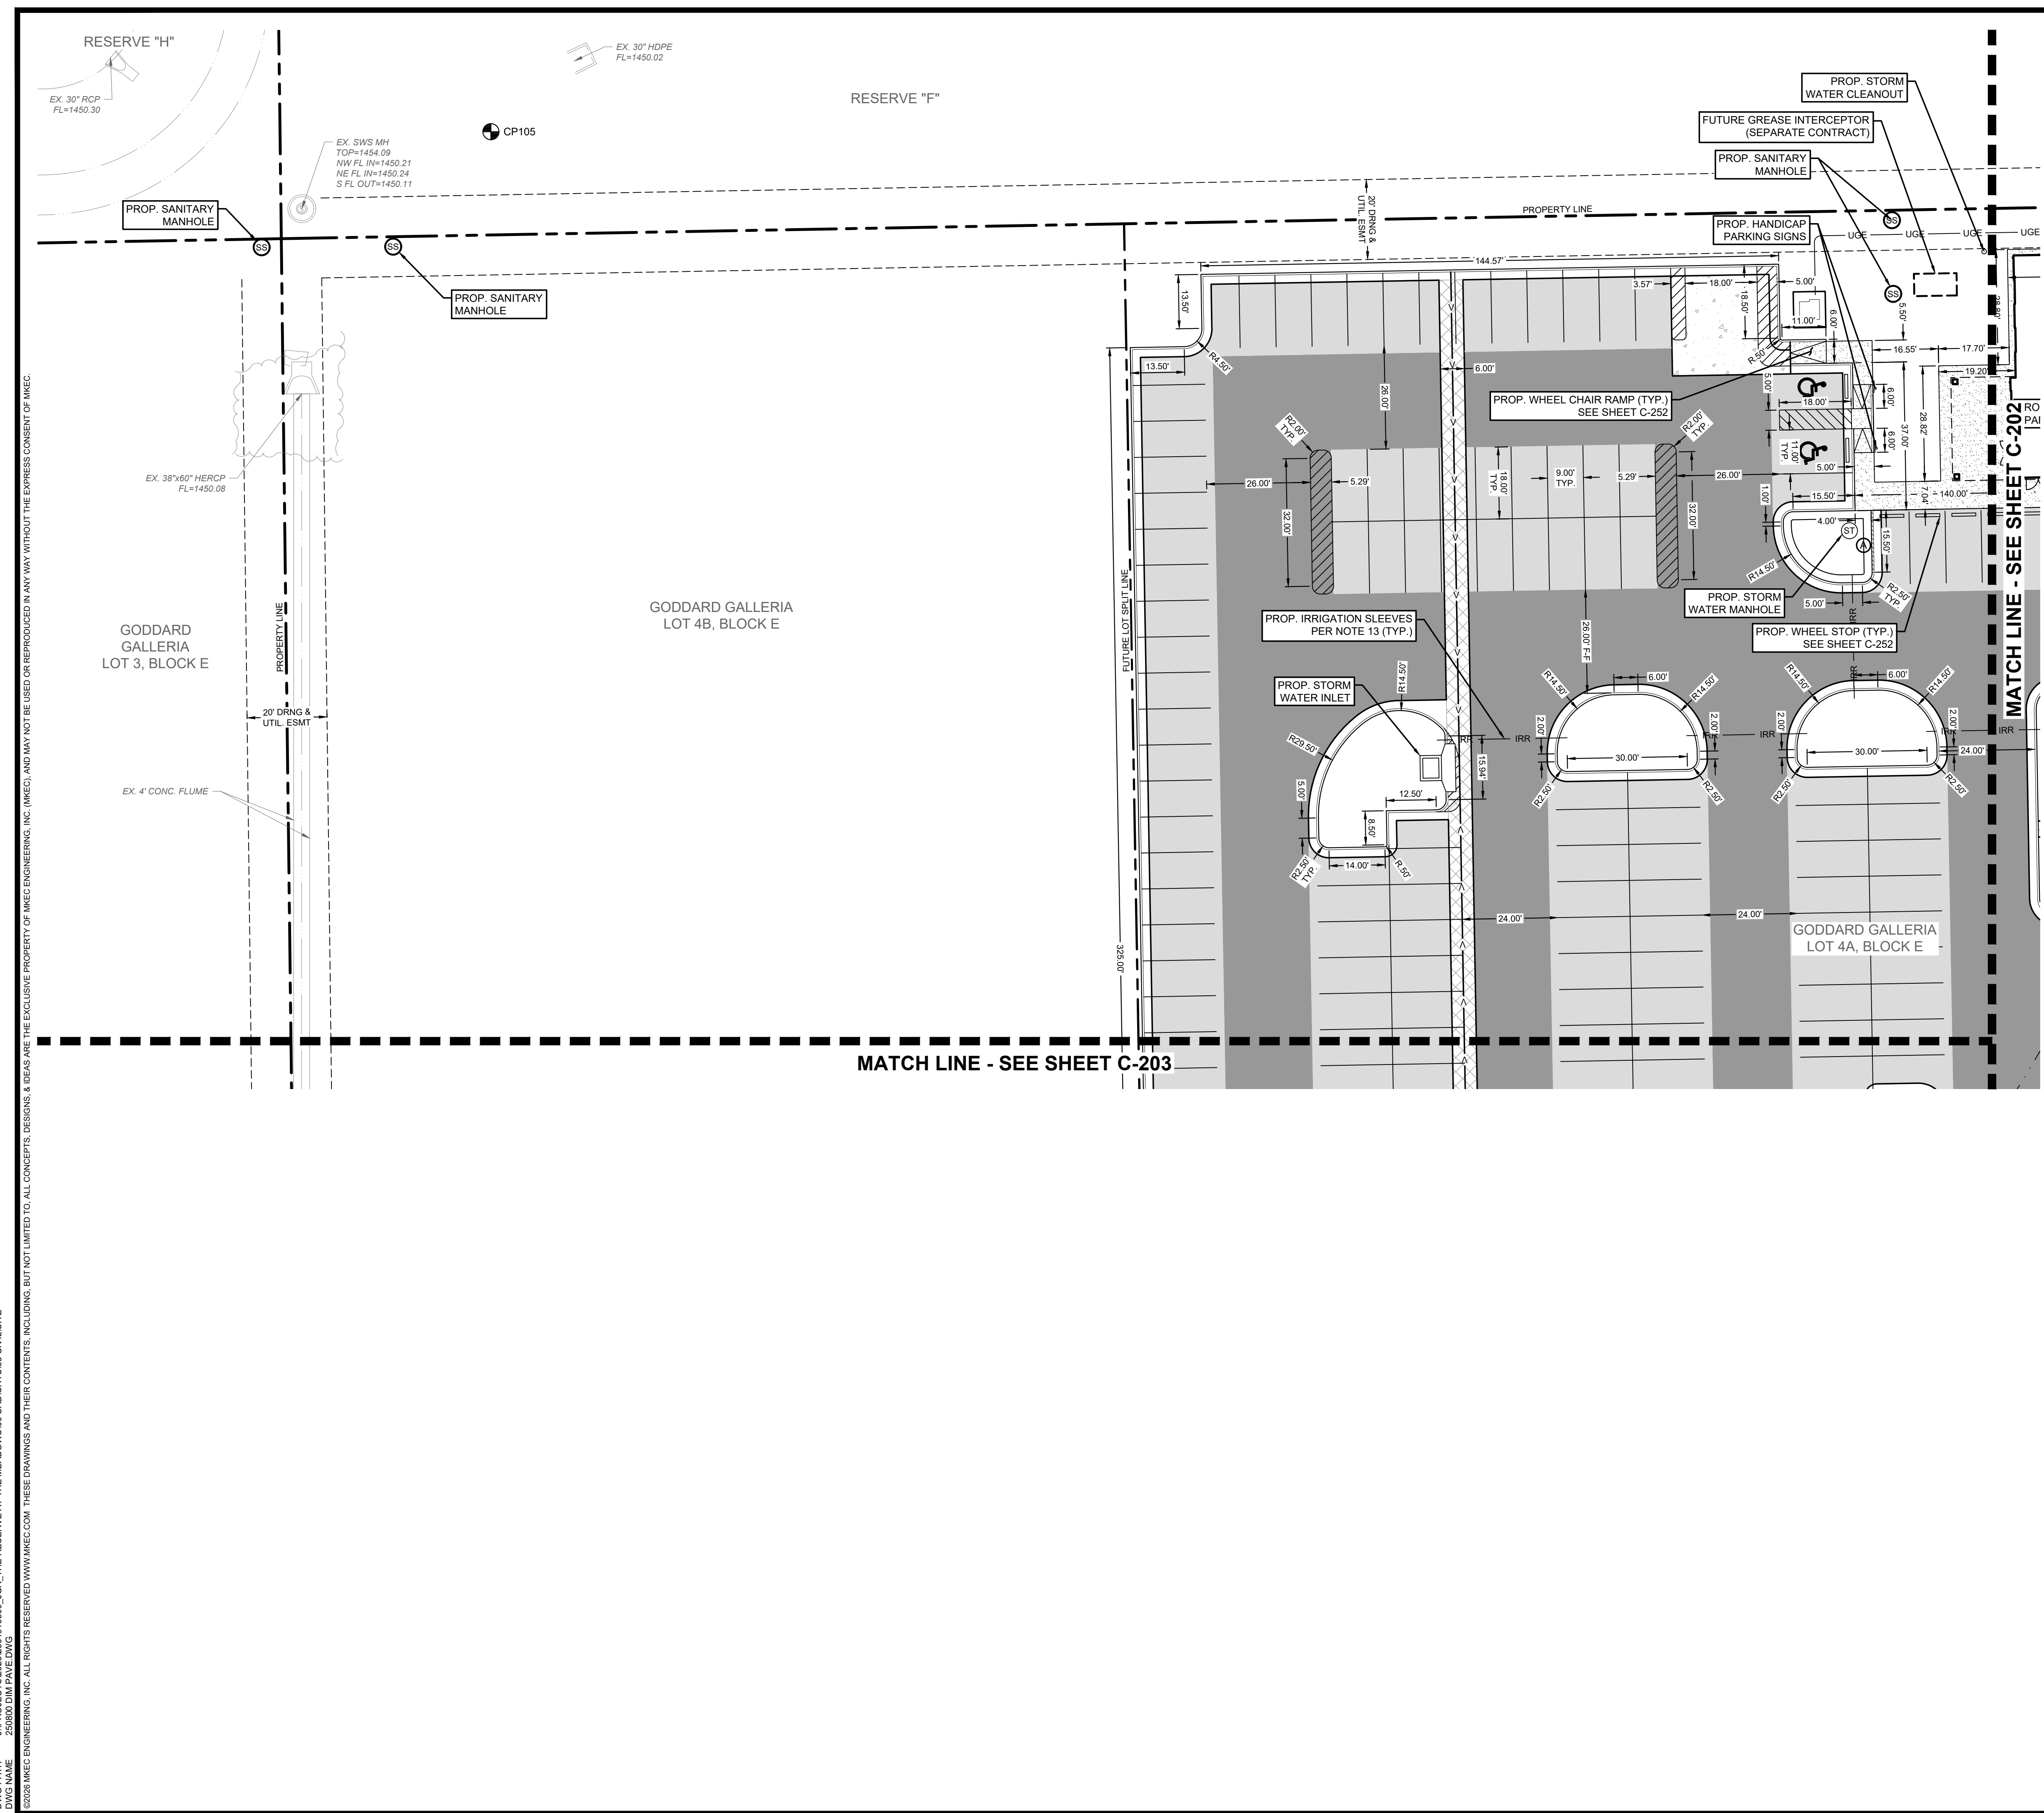










SHEET NO. C-201




NOTES

- UNLESS OTHERWISE NOTED, MATERIALS AND CONSTRUCTION SHALL BE IN ACCORDANCE WITH STANDARD SPECIFICATIONS OF AUTHORITY HAVING JURISDICTION.
- REFER TO GEOTECHNICAL REPORT PREPARED FOR JGR ARCHITECTS, PREPARED BY PROFESSIONAL SERVICE INDUSTRIES, INC., PROJECT NO. 03382639 DATED NOVEMBER 21, 2025. CONTRACTOR SHALL REFER TO REPORT FOR RECOMMENDED PAVEMENT THICKNESS, SUBGRADE PREPARATION AND TRENCH BACKFILLING. IF ANY DISCREPANCIES ARISE BETWEEN THE PLANS, SPECIFICATIONS AND GEOTECHNICAL REPORT, THE MORE CONSERVATIVE REQUIREMENT SHALL GOVERN.
- ALL DIMENSIONS ARE TO BACK OF CURB, UNLESS OTHERWISE NOTED.
- UNLESS OTHERWISE NOTED, PARKING STALLS SIZING:
 - STANDARD PARKING STALLS ARE 9'x18'. MEASURE FROM FACE OF CURB.
 - ACCESSIBLE PARKING STALLS ARE 11'x18' WITH A 5' LOADING AISLE. MEASURE FROM FACE OF CURB.
- PAVEMENT MARKINGS SHALL BE AN UNDILUTED ALKYD TRAFFIC PAINT. APPLY PAINT WITH MECHANICAL EQUIPMENT TO PRODUCE PAVEMENT MARKINGS WITH UNIFORM, STRAIGHT EDGES. APPLY AT MANUFACTURER'S RECOMMENDED RATE TO PROVIDE A MINIMUM WET FILM THICKNESS OF 15 MILS. FOLLOW MANUFACTURER'S RECOMMENDATIONS FOR SURFACE PREPARATION AND APPLICATION.
 - PARKING STRIPINGS SHALL BE 4" WIDE, WHITE IN COLOR.
 - CROSSWALK STRIPINGS SHALL BE 24" WIDE, WHITE IN COLOR.
 - ACCESSIBLE PARKING STALL LOADING AISLE STRIPING SHALL BE 4" WIDE, 2" ON CENTER AT 45° ANGLE, WHITE IN COLOR.
 - ACCESSIBLE PARKING STALL LOADING AISLE STRIPING SHALL BE 4" WIDE, 2" ON CENTER AT 45° ANGLE, WHITE IN COLOR.
- BUILDING FOOTPRINT AS SHOWN IS THE OUTSIDE FACE OF THE STRUCTURAL FOUNDATION. REFER TO STRUCTURAL PLANS FOR EXACT BUILDING DIMENSIONS.
- CONTRACTOR TO DRILL & EPOXY #4 BARS (L-2'-0", MIN. 9" EMBED) @ 24" O.C. INTO EXIST. CONCRETE PAVEMENT AND CURB & GUTTER WHEREVER PROPOSED ABUTS EXISTING.
- AGGREGATE BASE UNDER PAVEMENT SHALL EXTEND A MINIMUM OF 1' BEYOND THE BACK OF CURB.
- UNLESS OTHERWISE NOTED, ALL CURB TO BE FULL (6"), REFER TO GRADING PLAN FOR DETERMINATION OF CURB TYPE (REVERSE OR STANDARD) TO BE CONSTRUCTED.
- PRIVATE SIDEWALK CONSTRUCTION:
 - UNLESS OTHERWISE NOTED, ALL SIDEWALKS SHALL BE 4" THICK CONCRETE.
 - SIDEWALKS SHALL NOT EXCEED 2% CROSS SLOPE OR 5% LONGITUDINAL SLOPE.
 - THE MAXIMUM PERMISSIBLE SLOPES OF THE WHEELCHAIR RAMPS ARE 1:2.1.
 - SIDEWALK EXPANSION JOINT FILLER SHALL BE GREY, SELF-LEVELLING POLYURETHANE SEALANT.
 - EXPANSION JOINTS MAXIMUM DISTANCE = 50'-0", USE 1" x 4" PREMOLDED EXPANSION JOINT MATERIAL.
 - SURFACE TEXTURE OF THE RAMP SHALL BE THAT OBTAINED BY A MEDIUM BROOMING TRANSVERSE TO THE SLOPES OF THE RAMP.
 - CONCRETE SIDEWALK JOINTS SHALL BE 5'x3' (OR 6') IN GENERAL, WITH 6.25" MAXIMUM SPACING HAVING A WIDTH TO LENGTH RATIO OF 1:1.25.
 - CONCRETE SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 4,000 PSI AT 28 DAYS. CONTRACTOR SHALL SUBMIT CONCRETE MIX DESIGN TO ENGINEER FOR APPROVAL PRIOR TO CONSTRUCTION.
 - CONCRETE SHALL CONFORM TO THE CURRENT "ACI MANUAL OF CONCRETE PRACTICE".
 - PORTLAND CEMENT SHALL CONFORM TO ASTM-C-150, TYPE I OR III.
 - NORMAL WEIGHT CONCRETE AGGREGATE SHALL MEET ASTM C33.
 - REINFORCING SHALL MEET ASTM A615 OR GR60.
 - COMPACTED FILL CONTRACTOR SHALL COMPACT FILL TO 95% DENSITY (ASTM D698).
- CONTRACTOR SHALL BE RESPONSIBLE FOR REQUIRED TRAFFIC CONTROL NECESSARY ON SURROUNDING STREETS FOR CONSTRUCTION. TRAFFIC CONTROL SHALL COMPLY WITH THE LATEST EDITION OF MUTCD AND AUTHORITIES HAVING JURISDICTION STANDARDS AND SPECIFICATIONS.
- CONTRACTOR TO PROVIDE A CONCRETE JOINTING PLAN FOR ENGINEER REVIEW DURING SUBMITTAL PROCESS. THE PLAN SHOULD CLEARLY IDENTIFY LONGITUDINAL CONTRACTION AND EXPANSION JOINTS. IT IS GENERALLY EXPECTED THAT JOINTS SHOULD NOT EXCEED 24X THE PAVEMENT THICKNESS, WITH A MAX SPACING OF 12', AND NOT CREATE SMALL OR IRREGULAR SHAPED PANELS.
- INSTALL IRRIGATION SLEEVES IN THE LOCATIONS NOTED ON THE PLANS. TWO SLEEVES ARE REQUIRED AT EACH LOCATION: (1) 1.5" AND (1) 4" PVC CLASS 200 SDR 21. BOTH SHALL EXTEND 18" BEYOND THE BACK OF CURB OR SIDEWALK, BURIED 30" MIN. DEPTH AND BE MARKED WITH A TEMPORARY T-POST MARKER AT EACH END.

LEGEND

-  EXISTING FENCE
-  PROPERTY LINE
-  SETBACK LINE
-  EASEMENT LINE
-  IRRIGATION SLEEVE (SEE NOTE 13)
-  PROPOSED 5" ASPHALT PAVEMENT
-  PROPOSED 4" ASPHALT PAVEMENT
-  PROPOSED 8" CONCRETE
-  PROPOSED 6" CONCRETE
-  PROPOSED CONCRETE SIDEWALK
-  PROPOSED CURB TRANSITION (FULL TO FLUSH)

SCALE: 1"=20'

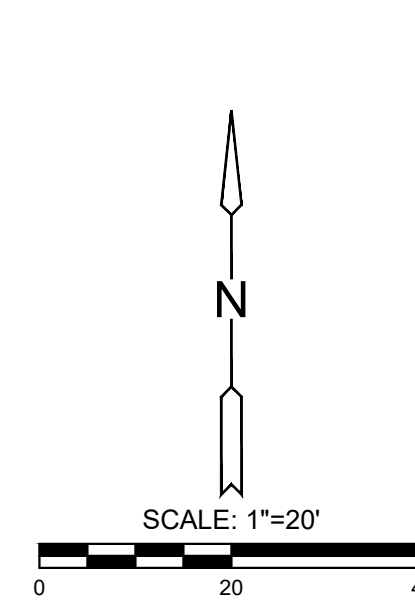

WARNING
EXISTING UNDERGROUND UTILITIES IN THE AREA. CONTRACTOR IS RESPONSIBLE FOR DETERMINING THE HORIZONTAL AND VERTICAL LOCATION OF ALL UTILITIES PRIOR TO CONSTRUCTION. CONTRACTOR IS RESPONSIBLE FOR ANY REPAIRS TO EXISTING UTILITIES DUE TO DAMAGE INCURRED DURING CONSTRUCTION. CONTRACTOR SHALL NOTIFY THE ENGINEER OF ANY DISCREPANCIES ON THE PLANS.












PLOTTED BY: BRYAN SMITH 4/22/2026 4:42 PM
 DWG PATH: J:\PROJECTS\2502501010800\THE RESERVE AT THE MEADOWS\010800_CIVIL\SITE
 DWG NAME: 2502501010800_CIVIL_SITE.DWG
 02/26/2026 MKEC ENGINEERING, INC. ALL RIGHTS RESERVED WWW.MKEC.COM THESE DRAWINGS AND THEIR CONTENTS, INCLUDING, BUT NOT LIMITED TO, ALL CONCEPTS, DESIGNS, & IDEAS ARE THE EXCLUSIVE PROPERTY OF MKEC ENGINEERING, INC. (MKEC) AND MAY NOT BE USED OR REPRODUCED IN ANY WAY WITHOUT THE EXPRESS CONSENT OF MKEC.


NO.	REVISION	DATE
0	ISSUED FOR PERMIT	04/03/26

NOTES


- UNLESS OTHERWISE NOTED, MATERIALS AND CONSTRUCTION SHALL BE IN ACCORDANCE WITH STANDARD SPECIFICATIONS OF AUTHORITY HAVING JURISDICTION.
- REFER TO GEOTECHNICAL REPORT PREPARED FOR JGR ARCHITECTS, PREPARED BY PROFESSIONAL SERVICE INDUSTRIES, INC., PROJECT NO. 03382639 DATED NOVEMBER 21, 2025. CONTRACTOR SHALL REFER TO REPORT FOR RECOMMENDED PAVEMENT THICKNESS, SUBGRADE PREPARATION AND TRENCH BACKFILLING. IF ANY DISCREPANCIES ARISE BETWEEN THE PLANS, SPECIFICATIONS AND GEOTECHNICAL REPORT, THE MORE CONSERVATIVE REQUIREMENT SHALL GOVERN.
- ALL DIMENSIONS ARE TO BACK OF CURB, UNLESS OTHERWISE NOTED.
- UNLESS OTHERWISE NOTED, PARKING STALLS SIZING:
 - STANDARD PARKING STALLS ARE 9'x18'. MEASURE FROM FACE OF CURB.
 - ACCESSIBLE PARKING STALLS ARE 11'x18' WITH A 5' LOADING AISLE. MEASURE FROM FACE OF CURB.
- PAVEMENT MARKINGS SHALL BE AN UNDILUTED ALKYD TRAFFIC PAINT. APPLY PAINT WITH MECHANICAL EQUIPMENT TO PRODUCE PAVEMENT MARKINGS WITH UNIFORM, STRAIGHT EDGES. APPLY AT MANUFACTURER'S RECOMMENDED RATE TO PROVIDE A MINIMUM WET FILM THICKNESS OF 15 MILS. FOLLOW MANUFACTURER'S RECOMMENDATIONS FOR SURFACE PREPARATION AND APPLICATION.
 - PARKING STRIPINGS SHALL BE 4" WIDE, WHITE IN COLOR.
 - CROSSWALK STRIPINGS SHALL BE 24" WIDE, WHITE IN COLOR.
 - ACCESSIBLE PARKING STALL LOADING AISLE STRIPING SHALL BE 4" WIDE, 2" ON CENTER AT 45° ANGLE, WHITE IN COLOR.
 - ACCESSIBLE PARKING STALL LOADING AISLE STRIPING SHALL BE 4" WIDE, 2" ON CENTER AT 45° ANGLE, WHITE IN COLOR.
- BUILDING FOOTPRINT AS SHOWN IS THE OUTSIDE FACE OF THE STRUCTURAL FOUNDATION. REFER TO STRUCTURAL PLANS FOR EXACT BUILDING DIMENSIONS.
- CONTRACTOR TO DRILL & EPOXY #4 BARS (L-2"x7", MIN. 9" EMBED) @ 24" O.C. INTO EXIST. CONCRETE PAVEMENT AND CURB & GUTTER WHEREVER PROPOSED AS EXISTING.
- AGGREGATE BASE UNDER PAVEMENT SHALL EXTEND A MINIMUM OF 1' BEYOND THE BACK OF CURB.
- UNLESS OTHERWISE NOTED, ALL CURB TO BE FULL (6") REFER TO GRADING PLAN FOR DETERMINATION OF CURB TYPE (REVERSE OR STANDARD) TO BE CONSTRUCTED.
- PRIVATE SIDEWALK CONSTRUCTION:
 - UNLESS OTHERWISE NOTED, ALL SIDEWALKS SHALL BE 4" THICK CONCRETE.
 - SIDEWALKS SHALL NOT EXCEED 2% CROSS SLOPE OR 5% LONGITUDINAL SLOPE.
 - THE MAXIMUM PERMISSIBLE SLOPES OF THE WHEELCHAIR RAMPS ARE 12:1.
 - SIDEWALK EXPANSION JOINT FILLER SHALL BE GREY, SELF-LEVELLING POLYURETHANE SEALANT.
 - EXPANSION JOINTS MAXIMUM DISTANCE = 50'-0", USE 1" x 4" PREMOLDED EXPANSION JOINT MATERIAL.
 - SURFACE TEXTURE OF THE RAMP SHALL BE THAT OBTAINED BY A MEDIUM BROOMING TRANSVERSE TO THE SLOPES OF THE RAMP.
 - CONCRETE SIDEWALK JOINTS SHALL BE 5/8" (OR 6") IN GENERAL, WITH 6.25" MAXIMUM SPACING HAVING A WIDTH TO LENGTH RATIO OF 1:1.25.
 - CONCRETE SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 4,000 PSI AT 28 DAYS. CONTRACTOR SHALL SUBMIT CONCRETE MIX DESIGN TO ENGINEER FOR APPROVAL PRIOR TO CONSTRUCTION.
 - CONCRETE SHALL CONFORM TO THE CURRENT "ACI MANUAL OF CONCRETE PRACTICE".
 - PORTLAND CEMENT SHALL CONFORM TO ASTM-C-150, TYPE I OR III.
 - NORMAL WEIGHT CONCRETE AGGREGATE SHALL MEET ASTM C33.
 - REINFORCING SHALL MEET ASTM A615 OR GR60.
 - COMPACTED FILL CONTRACTOR SHALL COMPACT FILL TO 95% DENSITY (ASTM D699).
- CONTRACTOR SHALL BE RESPONSIBLE FOR REQUIRED TRAFFIC CONTROL NECESSARY ON SURROUNDING STREETS FOR CONSTRUCTION. TRAFFIC CONTROL SHALL COMPLY WITH THE LATEST EDITION OF MUTCD AND AUTHORITIES HAVING JURISDICTION STANDARDS AND SPECIFICATIONS.
- CONTRACTOR TO PROVIDE A CONCRETE JOINTING PLAN FOR ENGINEER REVIEW DURING SUBMITTAL PROCESS. THE PLAN SHOULD CLEARLY IDENTIFY LONGITUDINAL, CONTRACTION AND EXPANSION JOINTS. IT IS GENERALLY EXPECTED THAT JOINTS SHOULD NOT EXCEED 24X THE PAVEMENT THICKNESS, WITH A MAX SPACING OF 12', AND NOT CREATE SMALL OR IRREGULAR SHAPED PANELS.
- INSTALL IRRIGATION SLEEVES IN THE LOCATIONS NOTED ON THE PLANS. TWO SLEEVES ARE REQUIRED AT EACH LOCATION: (1) 1.5" AND (1) 4" PVC CLASS 200 SDR 21. BOTH SHALL EXTEND 18" BEYOND THE BACK OF CURB OR SIDEWALK, BURIED 30" MIN. DEPTH AND BE MARKED WITH A TEMPORARY T-POST MARKER AT EACH END.

LEGEND

-  EXISTING FENCE
-  PROPERTY LINE
-  SETBACK LINE
-  EASEMENT LINE
-  IRRIGATION SLEEVE (SEE NOTE 13)
-  PROPOSED 5" ASPHALT PAVEMENT
-  PROPOSED 4" ASPHALT PAVEMENT
-  PROPOSED 8" CONCRETE
-  PROPOSED 6" CONCRETE
-  PROPOSED CONCRETE SIDEWALK
-  PROPOSED CURB TRANSITION (FULL TO FLUSH)

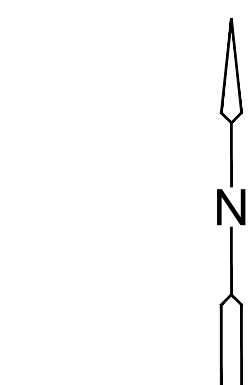


SCALE: 1"=20'

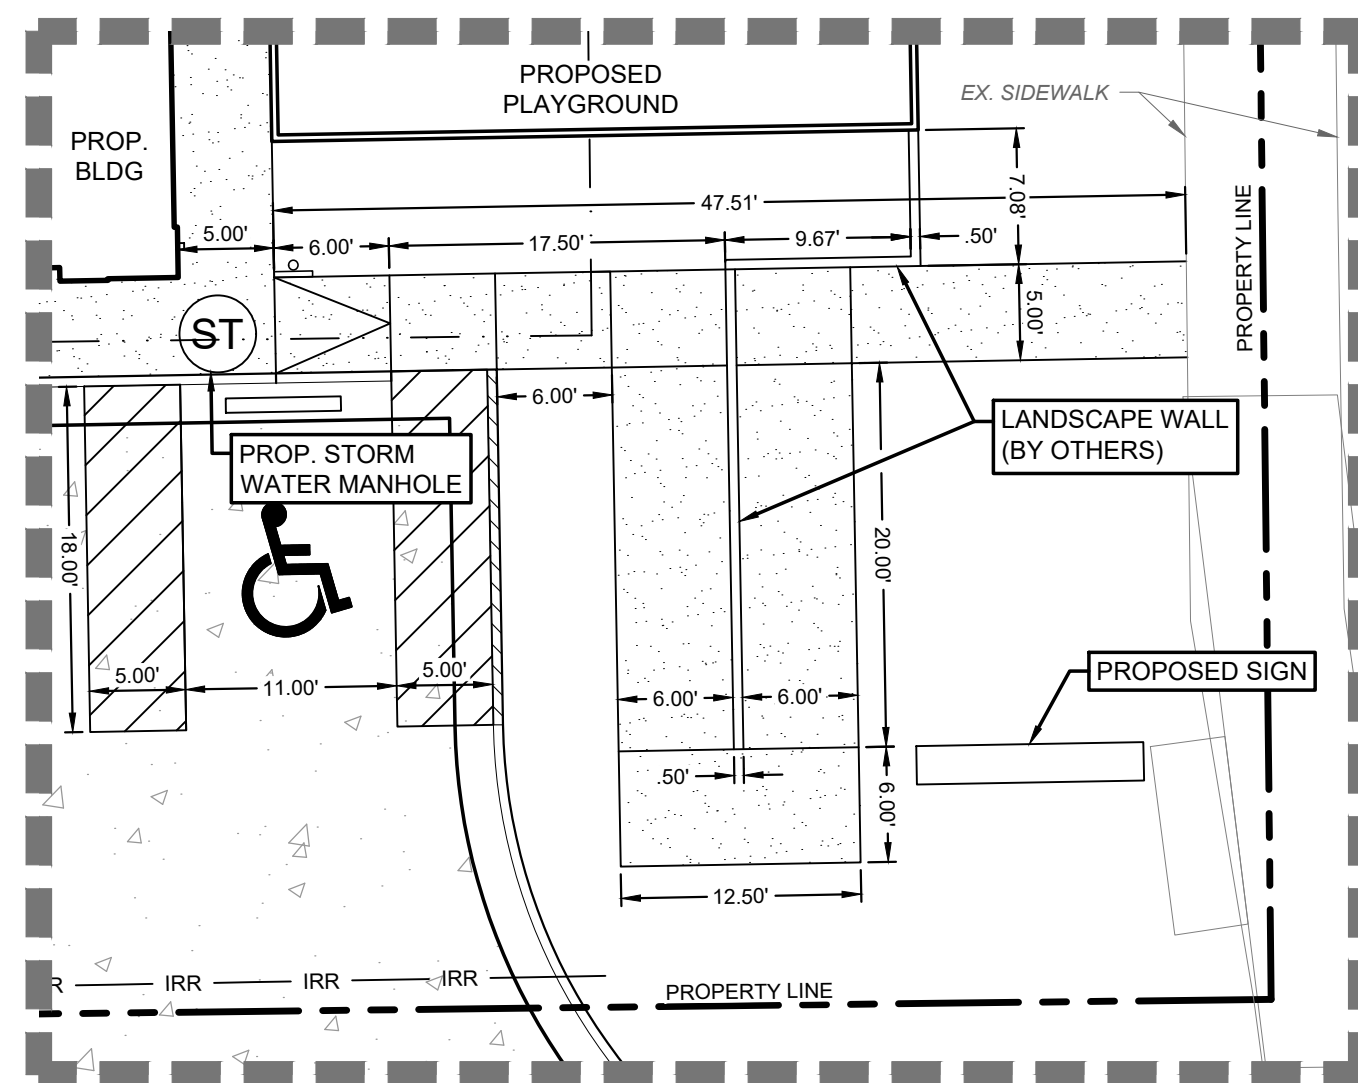


DETAIL A

SCALE: 1" = 10'

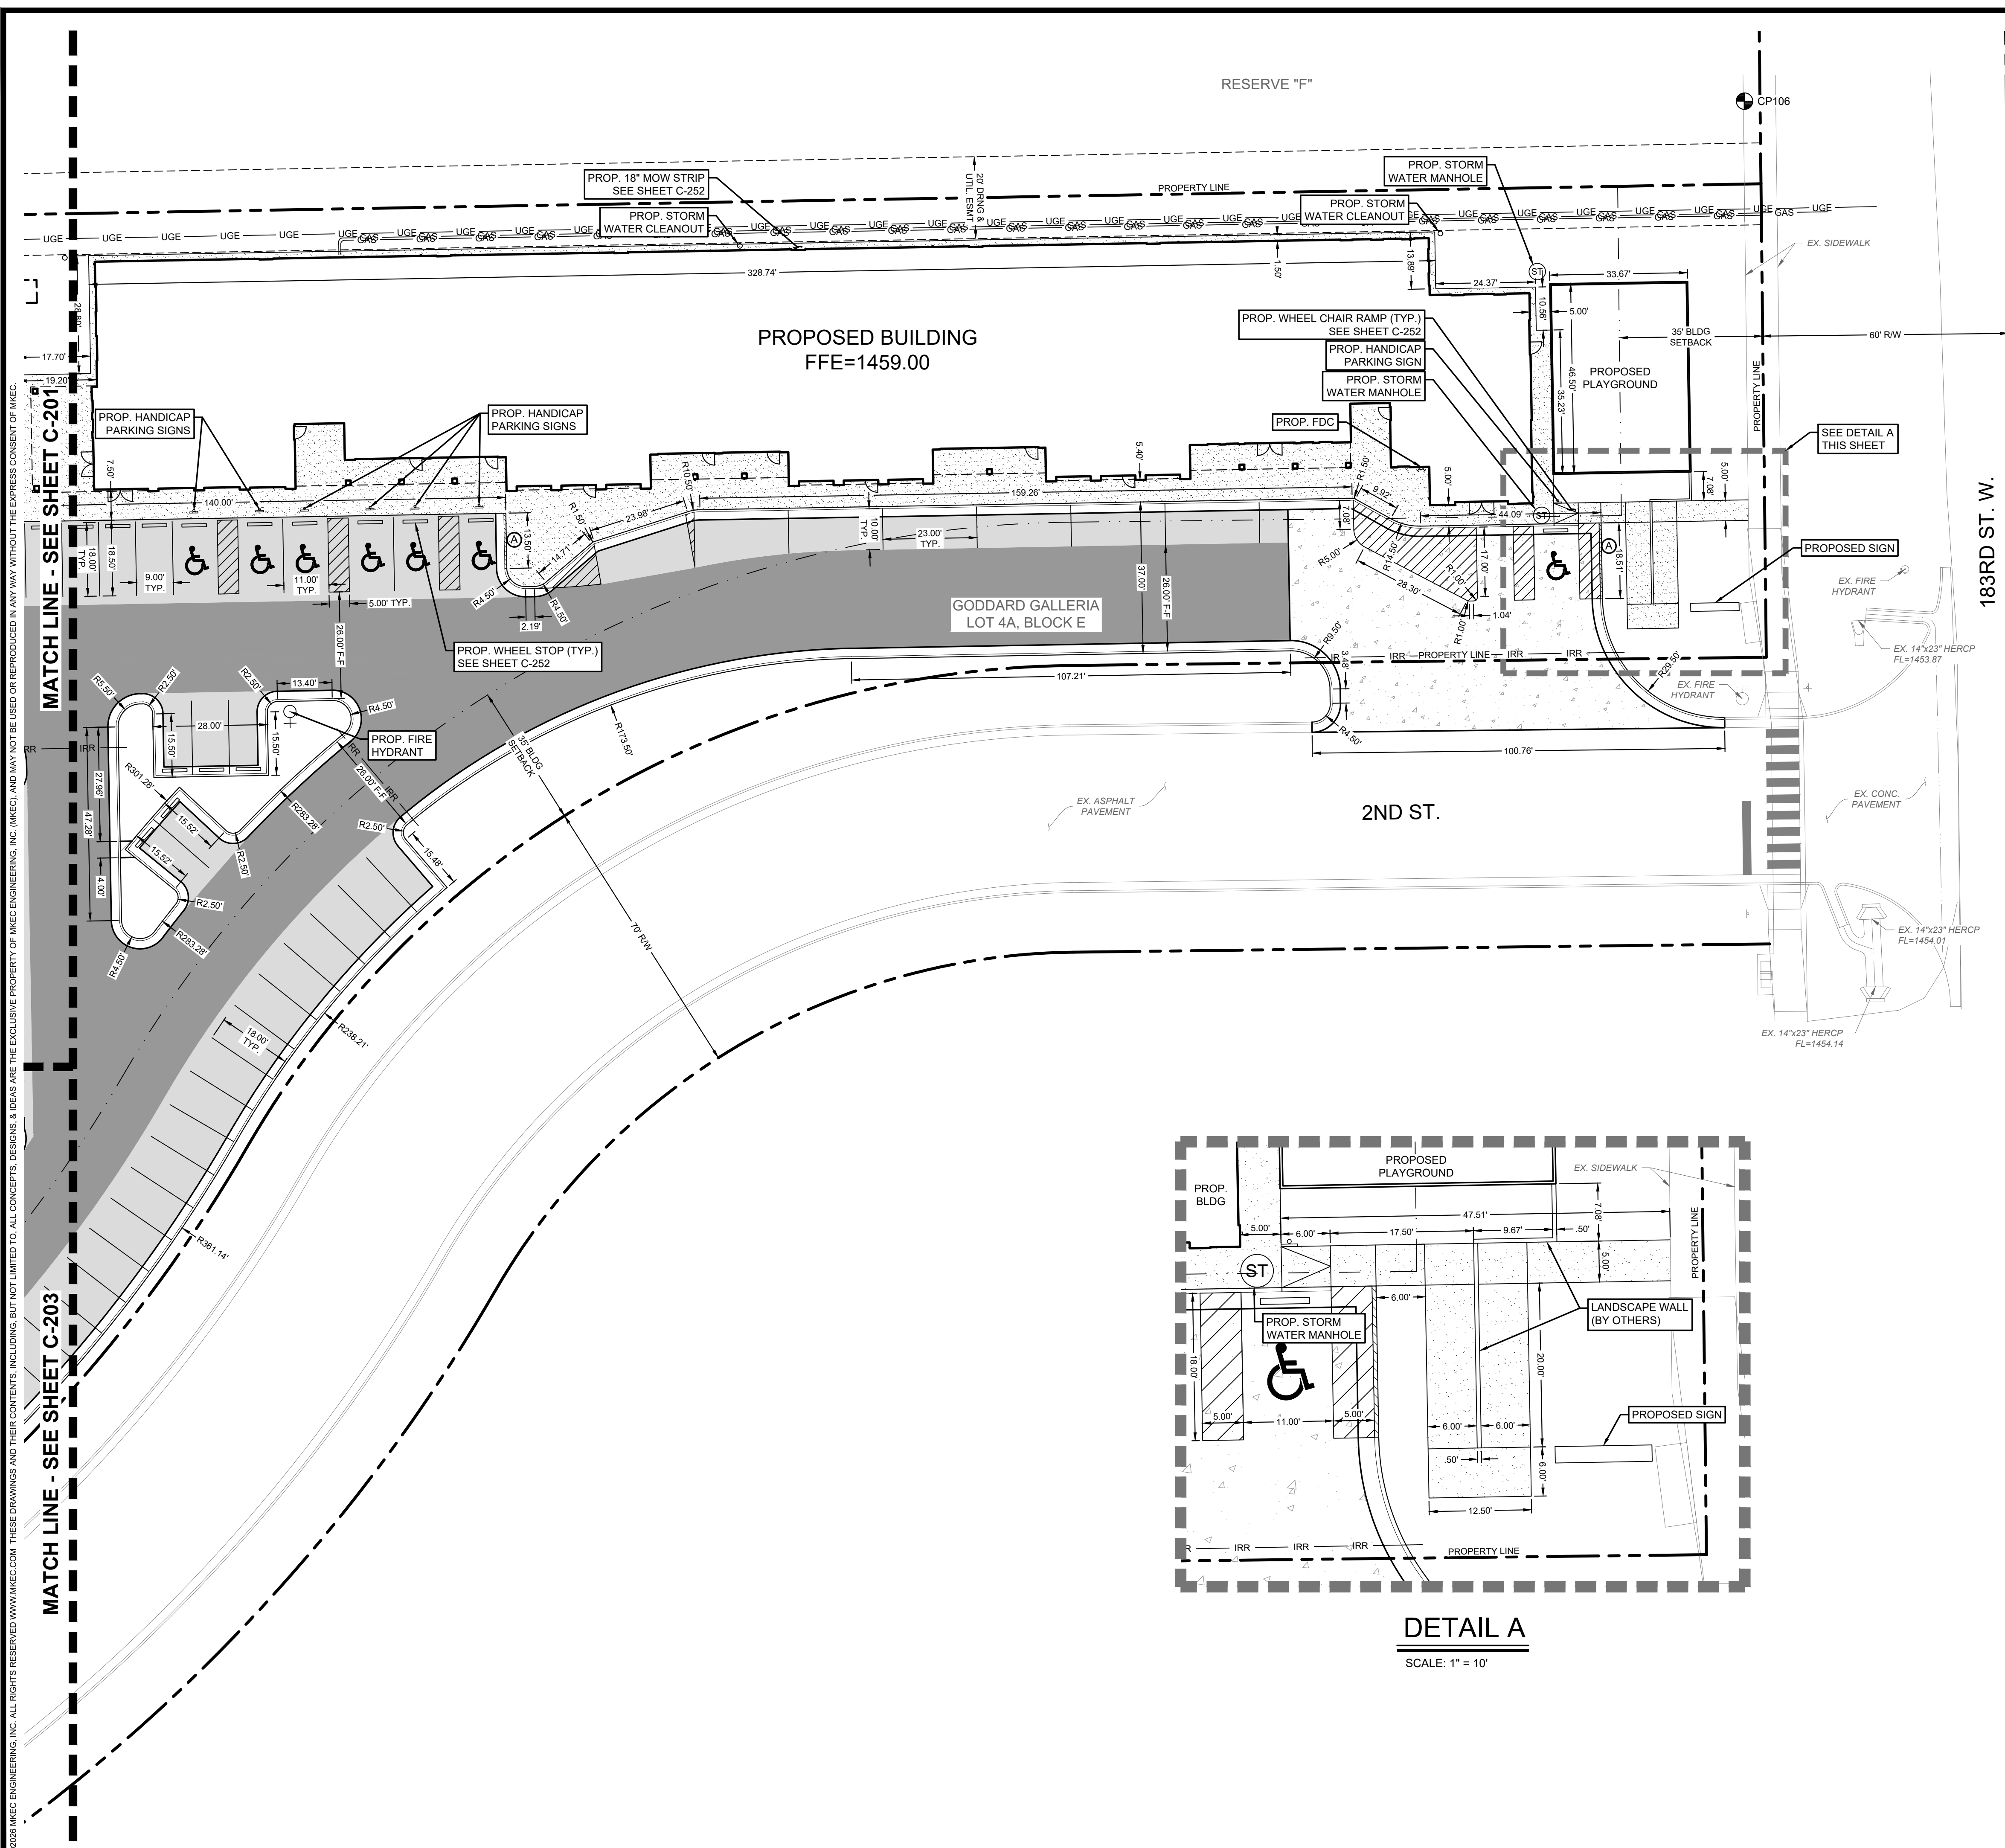





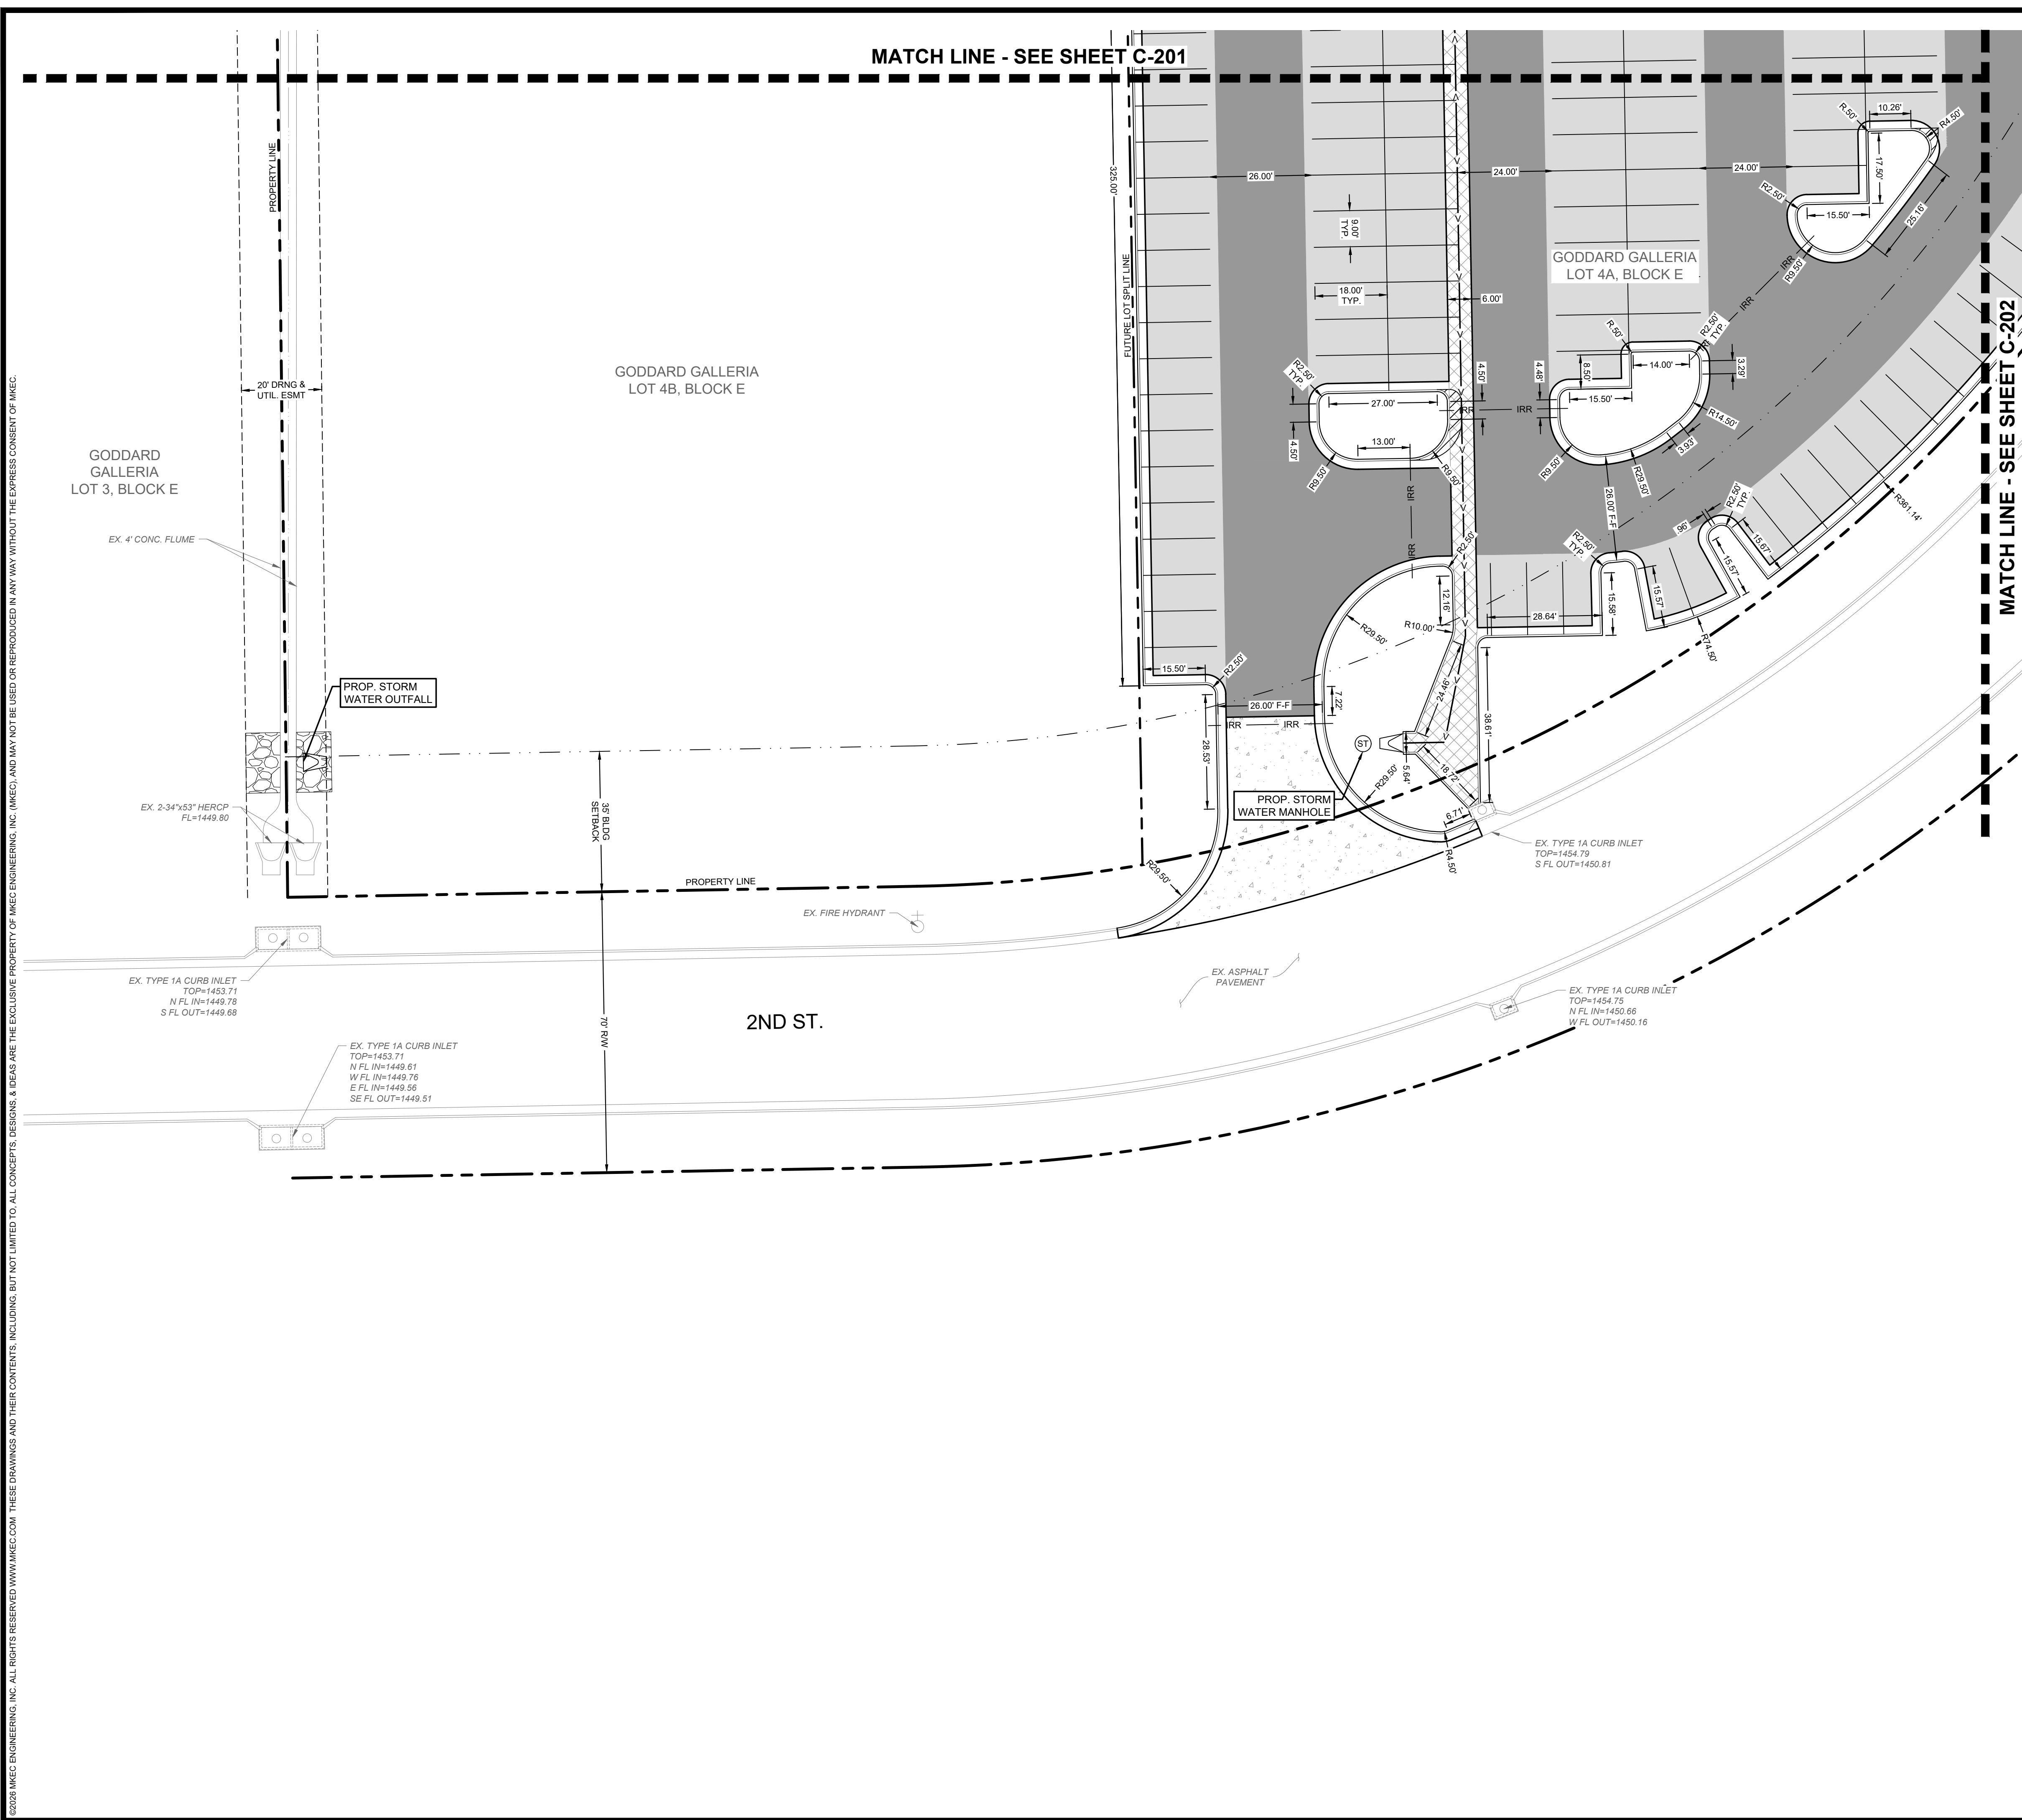






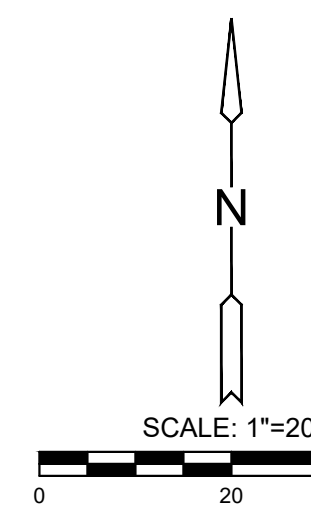
PLOTTED BY: BRYAN SMITH 4/22/2026 4:42 PM
 J:\PROJECTS\2025\2501010800_JGR_THE RESERVE AT THE MEADOWS\DWG\CAD\BHS\06 CIVIL\SITE
 DWG NAME: 25010800.DWG
 02/26 MKEC ENGINEERING, INC. ALL RIGHTS RESERVED WWW.MKEC.COM THESE DRAWINGS AND THEIR CONTENTS, INCLUDING, BUT NOT LIMITED TO, ALL CONCEPTS, DESIGNS, & IDEAS ARE THE EXCLUSIVE PROPERTY OF MKEC ENGINEERING, INC. (MKEC) AND MAY NOT BE USED OR REPRODUCED IN ANY WAY WITHOUT THE EXPRESS CONSENT OF MKEC.

NO.	REVISION	DATE
0	ISSUED FOR PERMIT	04/03/26




- ### NOTES
- UNLESS OTHERWISE NOTED, MATERIALS AND CONSTRUCTION SHALL BE IN ACCORDANCE WITH STANDARD SPECIFICATIONS OF AUTHORITY HAVING JURISDICTION.
 - REFER TO GEOTECHNICAL REPORT PREPARED FOR JGR ARCHITECTS, PREPARED BY PROFESSIONAL SERVICE INDUSTRIES, INC., PROJECT NO. 03382639 DATED NOVEMBER 21, 2025. CONTRACTOR SHALL REFER TO REPORT FOR RECOMMENDED PAVEMENT THICKNESS, SUBGRADE PREPARATION AND TRENCH BACKFILLING. IF ANY DISCREPANCIES ARISE BETWEEN THE PLANS, SPECIFICATIONS AND GEOTECHNICAL REPORT, THE MORE CONSERVATIVE REQUIREMENT SHALL GOVERN.
 - ALL DIMENSIONS ARE TO BACK OF CURB, UNLESS OTHERWISE NOTED.
 - UNLESS OTHERWISE NOTED, PARKING STALLS SIZING:
 - STANDARD PARKING STALLS ARE 9'x18', MEASURE FROM FACE OF CURB.
 - ACCESSIBLE PARKING STALLS ARE 11'x18' WITH A 5' LOADING AISLE, MEASURE FROM FACE OF CURB.
 - PAVEMENT MARKINGS SHALL BE AN UNDILUTED ALKYD TRAFFIC PAINT. APPLY PAINT WITH MECHANICAL EQUIPMENT TO PRODUCE PAVEMENT MARKINGS WITH UNIFORM, STRAIGHT EDGES. APPLY AT MANUFACTURER'S RECOMMENDED RATE TO PROVIDE A MINIMUM WET FILM THICKNESS OF 15 MILS. FOLLOW MANUFACTURER'S RECOMMENDATIONS FOR SURFACE PREPARATION AND APPLICATION.
 - PARKING STRIPINGS SHALL BE 4" WIDE, WHITE IN COLOR.
 - CROSSWALK STRIPINGS SHALL BE 24" WIDE, WHITE IN COLOR.
 - ACCESSIBLE PARKING STALL LOADING AISLE STRIPING SHALL BE 4" WIDE, 2" ON CENTER AT 45° ANGLE, WHITE IN COLOR.
 - ACCESSIBLE PARKING STALL LOADING AISLE STRIPING SHALL BE 4" WIDE, 2" ON CENTER AT 45° ANGLE, WHITE IN COLOR.
 - BUILDING FOOTPRINT AS SHOWN IS THE OUTSIDE FACE OF THE STRUCTURAL FOUNDATION. REFER TO STRUCTURAL PLANS FOR EXACT BUILDING DIMENSIONS.
 - CONTRACTOR TO DRILL & EPOXY #4 BARS (L-2'-0", MIN. 9" EMBED) @ 24" O.C. INTO EXIST. CONCRETE PAVEMENT AND CURB & GUTTER WHEREVER PROPOSED ABUTS EXISTING.
 - AGGREGATE BASE UNDER PAVEMENT SHALL EXTEND A MINIMUM OF 1' BEYOND THE BACK OF CURB.
 - UNLESS OTHERWISE NOTED, ALL CURB TO BE FULL (6"), REFER TO GRADING PLAN FOR DETERMINATION OF CURB TYPE (REVERSE OR STANDARD) TO BE CONSTRUCTED.
 - PRIVATE SIDEWALK CONSTRUCTION:
 - UNLESS OTHERWISE NOTED, ALL SIDEWALKS SHALL BE 4" THICK CONCRETE.
 - SIDEWALKS SHALL NOT EXCEED 2% CROSS SLOPE OR 5% LONGITUDINAL SLOPE.
 - THE MAXIMUM PERMISSIBLE SLOPES OF THE WHEELCHAIR RAMPS ARE 1:2.1.
 - SIDEWALK EXPANSION JOINT FILLER SHALL BE GREY, SELF-LEVELLING POLYURETHANE SEALANT.
 - EXPANSION JOINTS MAXIMUM DISTANCE = 50'-0", USE 1" X 4" PREMOLDED EXPANSION JOINT MATERIAL.
 - SURFACE TEXTURE OF THE RAMP SHALL BE THAT OBTAINED BY A MEDIUM BROOMING TRANSVERSE TO THE SLOPES OF THE RAMP.
 - CONCRETE SIDEWALK JOINTS SHALL BE 5'x3' (OR 6') IN GENERAL, WITH 6.25" MAXIMUM SPACING HAVING A WIDTH TO LENGTH RATIO OF 1:1.25.
 - CONCRETE SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 4,000 PSI AT 28 DAYS. CONTRACTOR SHALL SUBMIT CONCRETE MIX DESIGN TO ENGINEER FOR APPROVAL PRIOR TO CONSTRUCTION.
 - CONCRETE SHALL CONFORM TO THE CURRENT "ACI MANUAL OF CONCRETE PRACTICE".
 - PORTLAND CEMENT SHALL CONFORM TO ASTM-C-150, TYPE I OR III.
 - NORMAL WEIGHT CONCRETE AGGREGATE SHALL MEET ASTM C33.
 - REINFORCING SHALL MEET ASTM A615 OR GR60.
 - COMPACTED FILL CONTRACTOR SHALL COMPACT FILL TO 95% DENSITY (ASTM D698).
 - CONTRACTOR SHALL BE RESPONSIBLE FOR REQUIRED TRAFFIC CONTROL NECESSARY ON SURROUNDING STREETS FOR CONSTRUCTION. TRAFFIC CONTROL SHALL COMPLY WITH THE LATEST EDITION OF MUTCD AND AUTHORITIES HAVING JURISDICTION STANDARDS AND SPECIFICATIONS.
 - CONTRACTOR TO PROVIDE A CONCRETE JOINTING PLAN FOR ENGINEER REVIEW DURING SUBMITTAL PROCESS. THE PLAN SHOULD CLEARLY IDENTIFY LONGITUDINAL, CONTRACTION AND EXPANSION JOINTS. IT IS GENERALLY EXPECTED THAT JOINTS SHOULD NOT EXCEED 24X THE PAVEMENT THICKNESS, WITH A MAX SPACING OF 12', AND NOT CREATE SMALL OR IRREGULAR SHAPED PANELS.
 - INSTALL IRRIGATION SLEEVES IN THE LOCATIONS NOTED ON THE PLANS. TWO SLEEVES ARE REQUIRED AT EACH LOCATION: (1) 1.5" AND (1) 4" PVC CLASS 200 SDR 21. BOTH SHALL EXTEND 18" BEYOND THE BACK OF CURB OR SIDEWALK, BURIED 30" MIN. DEPTH AND BE MARKED WITH A TEMPORARY T-POST MARKER AT EACH END.

- ### LEGEND
-  EXISTING FENCE
 -  PROPERTY LINE
 -  SETBACK LINE
 -  EASEMENT LINE
 -  IRRIGATION SLEEVE (SEE NOTE 13)
 -  PROPOSED 5' ASPHALT PAVEMENT
 -  PROPOSED 4' ASPHALT PAVEMENT
 -  PROPOSED 8' CONCRETE
 -  PROPOSED 6' CONCRETE
 -  PROPOSED CONCRETE SIDEWALK
 -  PROPOSED CURB TRANSITION (FULL TO FLUSH)




WARNING
EXISTING UNDERGROUND UTILITIES IN THE AREA. CONTRACTOR IS RESPONSIBLE FOR DETERMINING THE HORIZONTAL AND VERTICAL LOCATION OF ALL UTILITIES PRIOR TO CONSTRUCTION. CONTRACTOR IS RESPONSIBLE FOR ANY REPAIRS TO EXISTING UTILITIES DUE TO DAMAGE INCURRED DURING CONSTRUCTION. CONTRACTOR SHALL NOTIFY THE ENGINEER OF ANY DISCREPANCIES ON THE PLANS.


PLOTTED BY: BRYAN SMITH 4/22/2026 4:42 PM
 DWG PATH: J:\PROJECTS\2502501010800_1\THE RESERVE AT THE MEADOWS\00 CAD\BHS\06 CIVIL\SITE DWG.DWG
 2502501010800_1\THE RESERVE AT THE MEADOWS\00 CAD\BHS\06 CIVIL\SITE DWG.DWG
 ©2026 MKEC ENGINEERING, INC. ALL RIGHTS RESERVED WWW.MKEC.COM THESE DRAWINGS AND THEIR CONTENTS, INCLUDING, BUT NOT LIMITED TO, ALL CONCEPTS, DESIGNS, & IDEAS ARE THE EXCLUSIVE PROPERTY OF MKEC ENGINEERING, INC. (MKEC) AND MAY NOT BE USED OR REPRODUCED IN ANY WAY WITHOUT THE EXPRESS CONSENT OF MKEC.

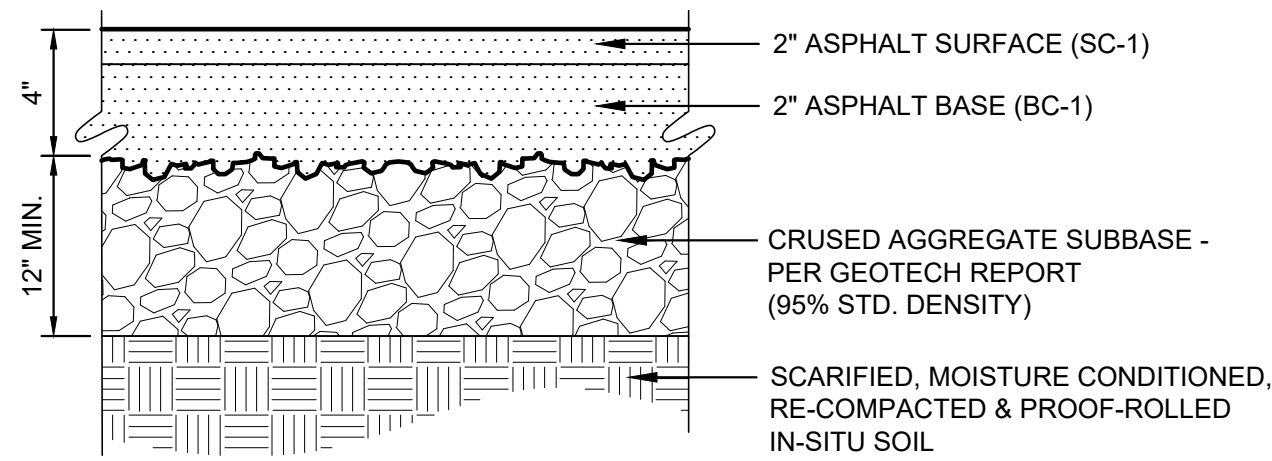


1 TYP. SECTION: 4" ASPHALTIC PVMT.
SCALE: NTS

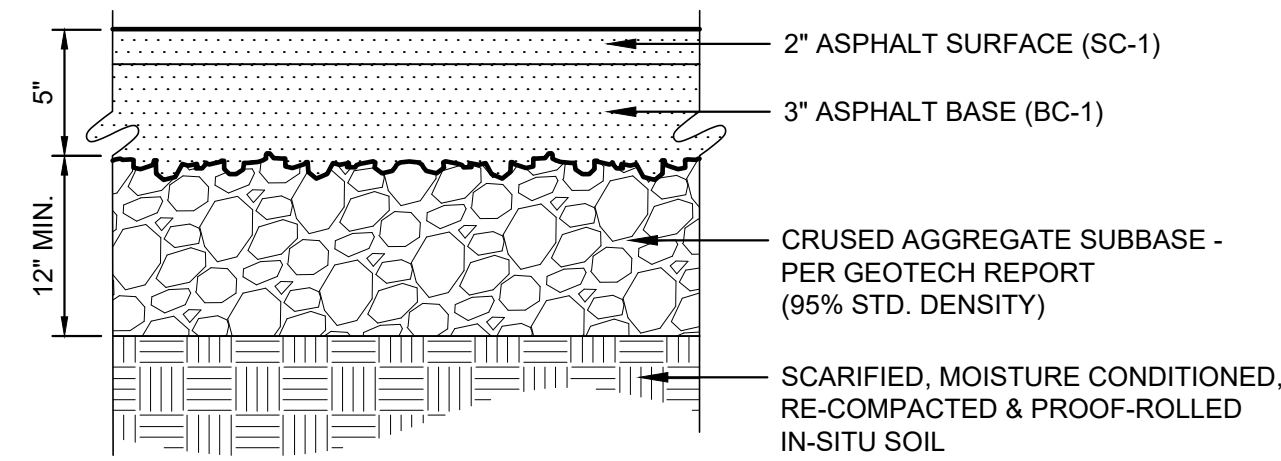


2 TYP. SECTION: 5" ASPHALTIC PVMT.
SCALE: NTS

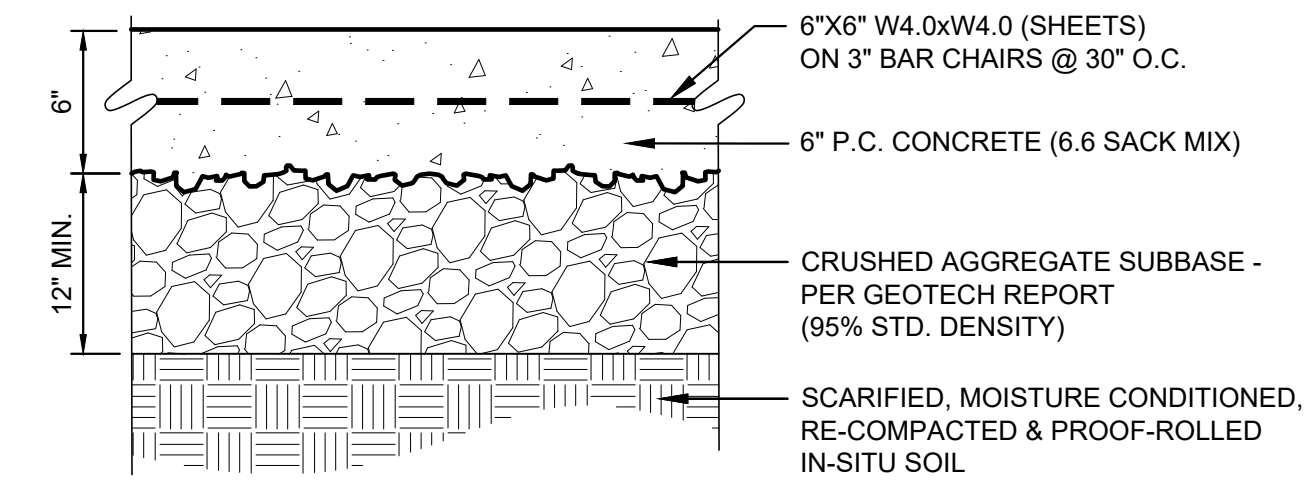


3 TYP. SECTION: 6" CONC. PVMT.
SCALE: NTS

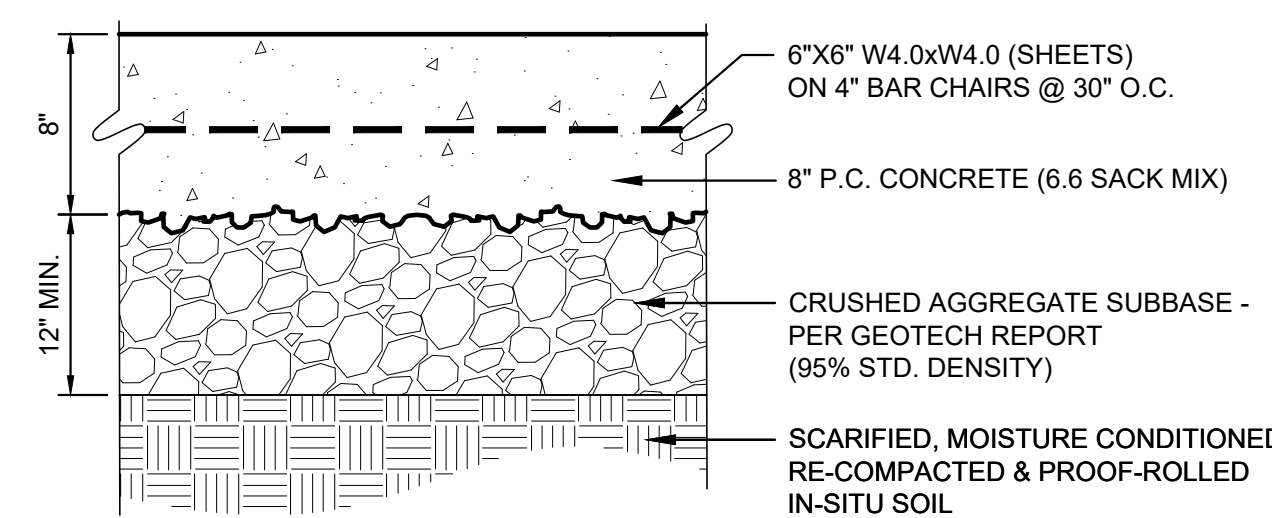


4 TYP. SECTION: 8" CONC. PVMT.
SCALE: NTS

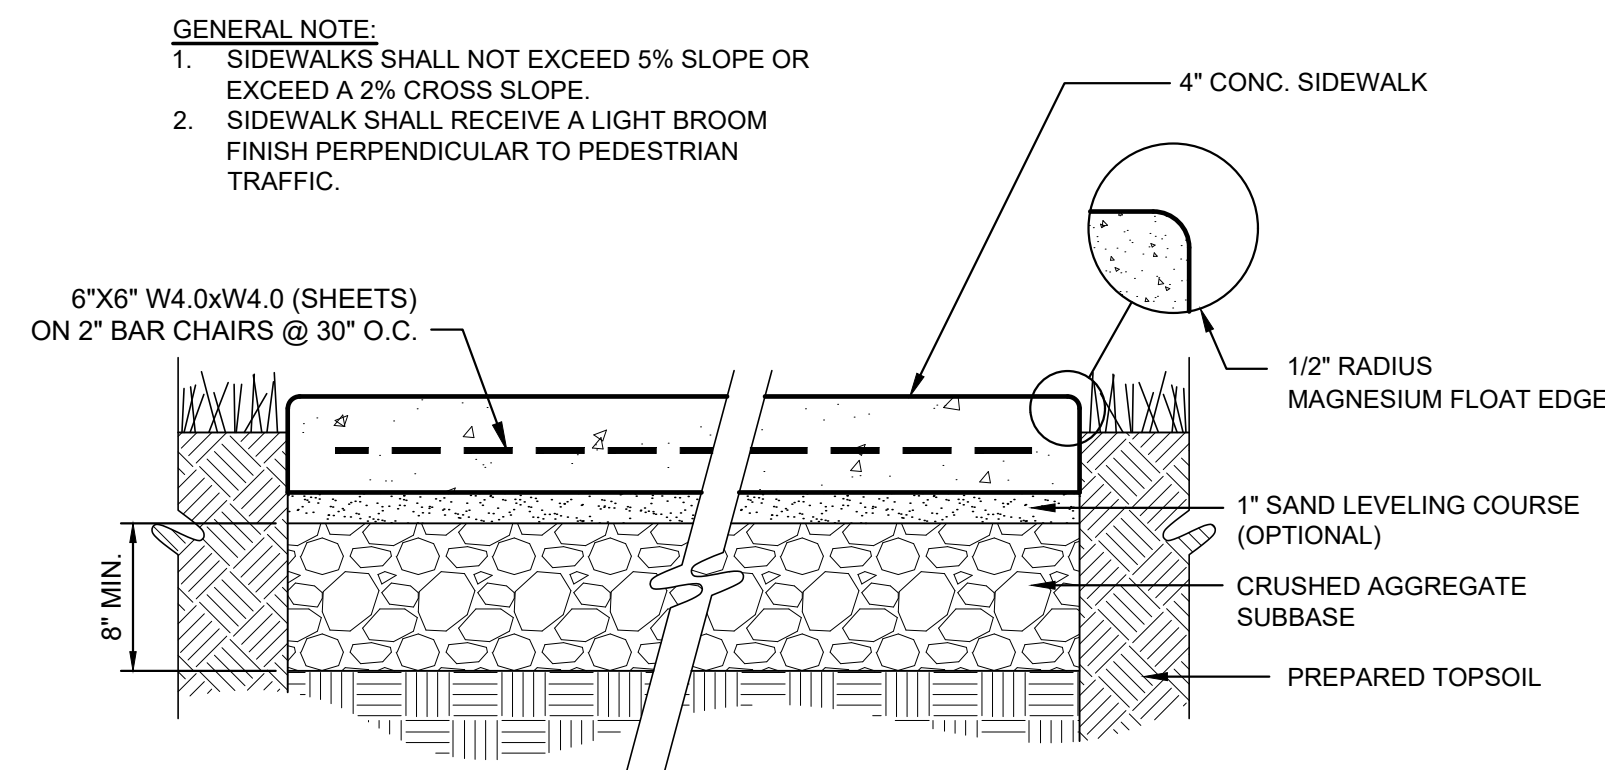


5 CONC. SIDEWALK
SCALE: NTS

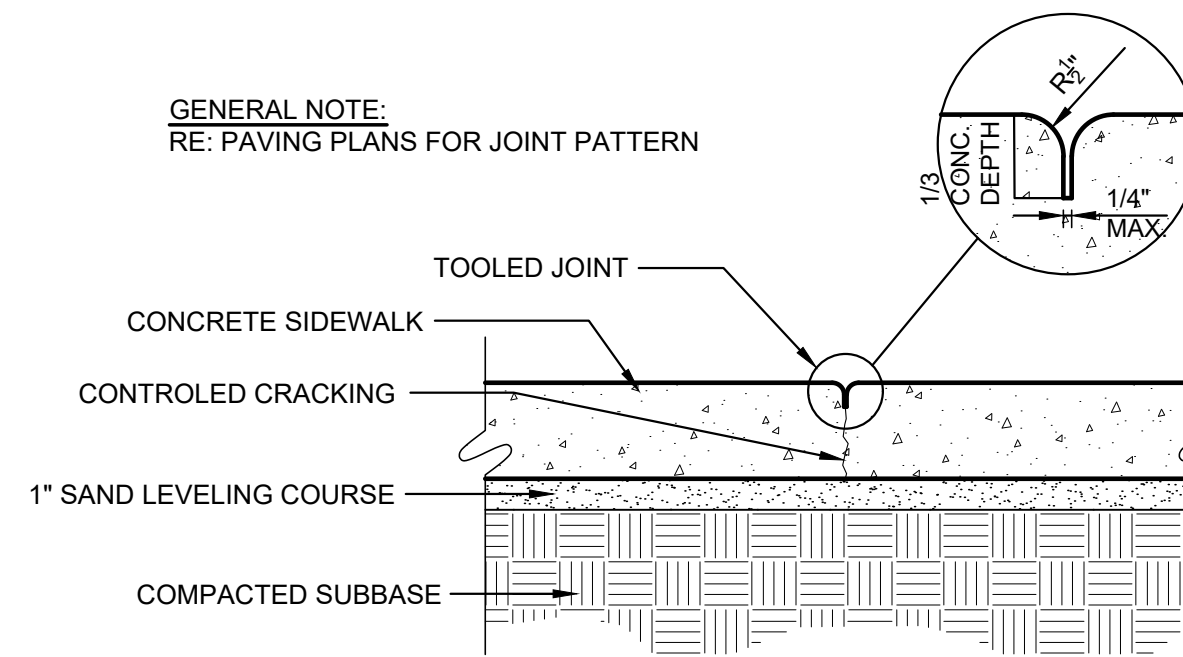


6 SIDEWALK TOOLED JOINT
SCALE: NTS

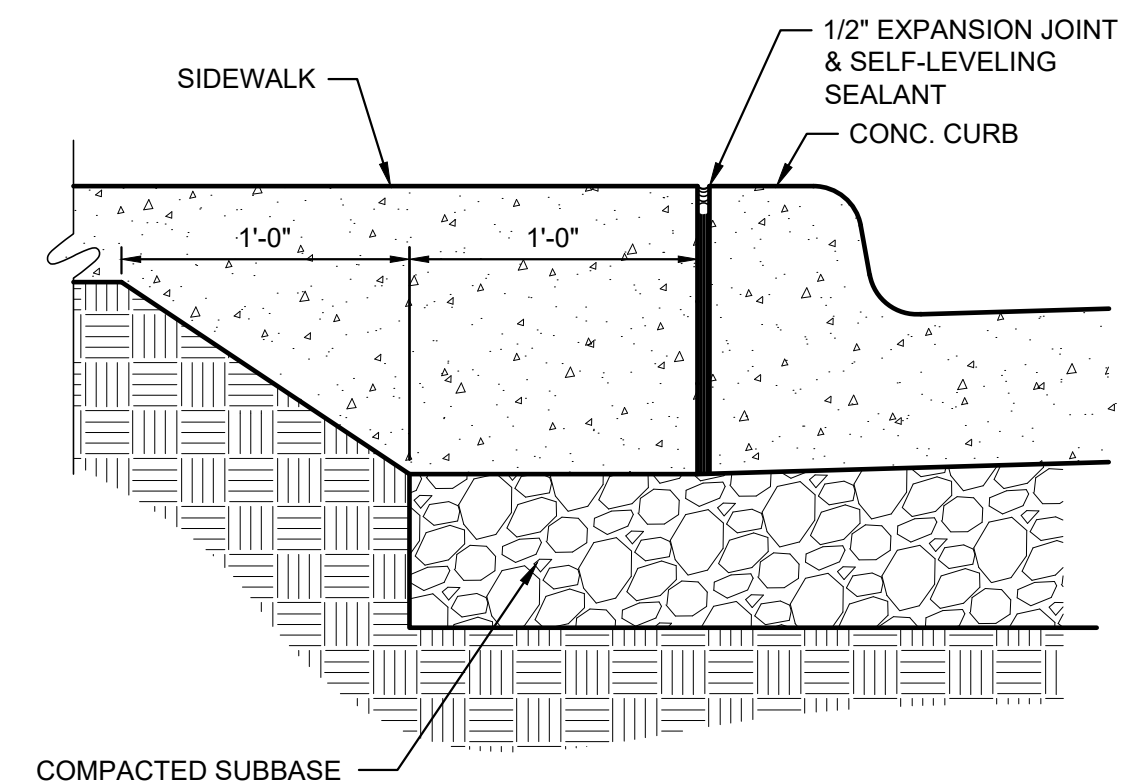


7 CONC. SIDEWALK @ CURB
SCALE: NTS

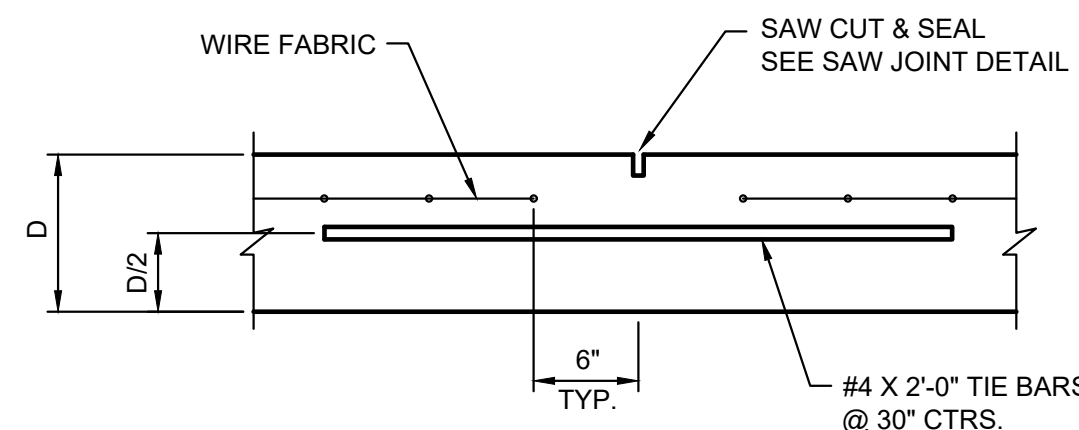


8 LONGITUDINAL JOINT DETAIL
SCALE: NTS

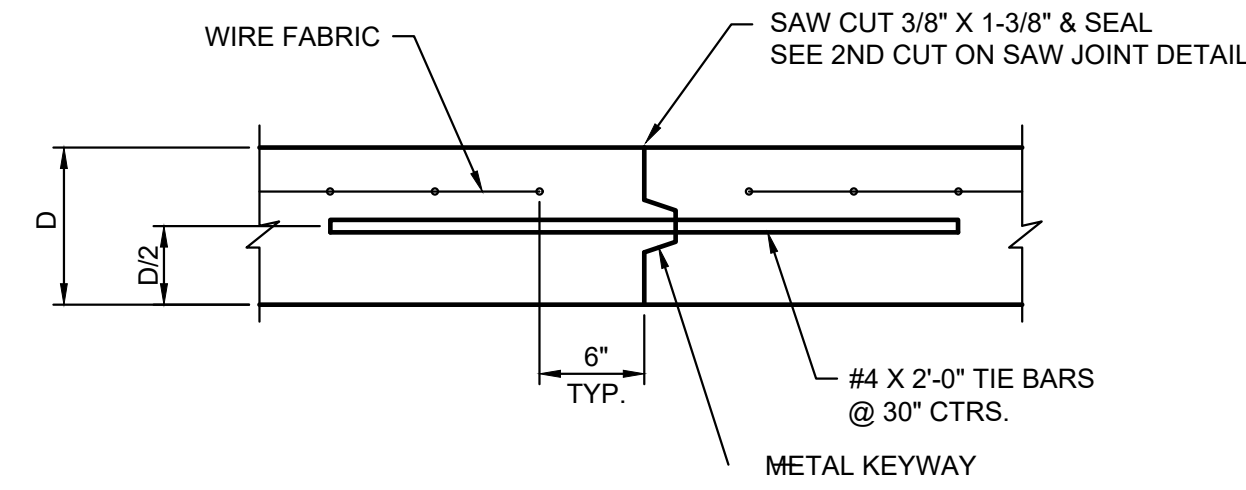


9 OPTIONAL LONGITUDINAL JOINT DETAIL
SCALE: NTS

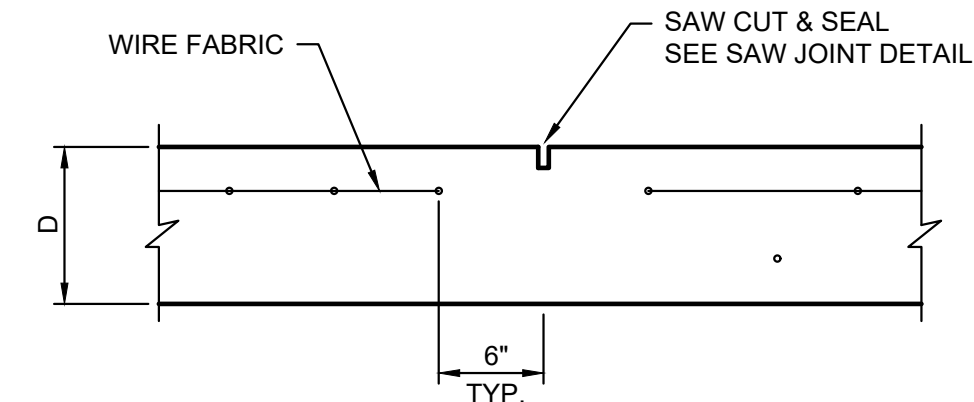


10 CONTRACTION JOINT DETAIL
SCALE: NTS

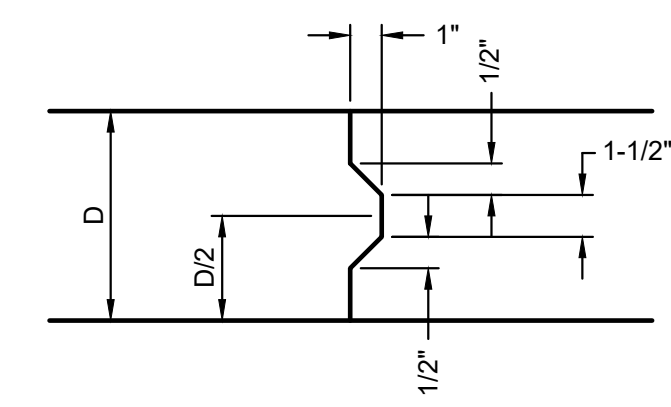


11 KEYWAY DETAIL
SCALE: NTS

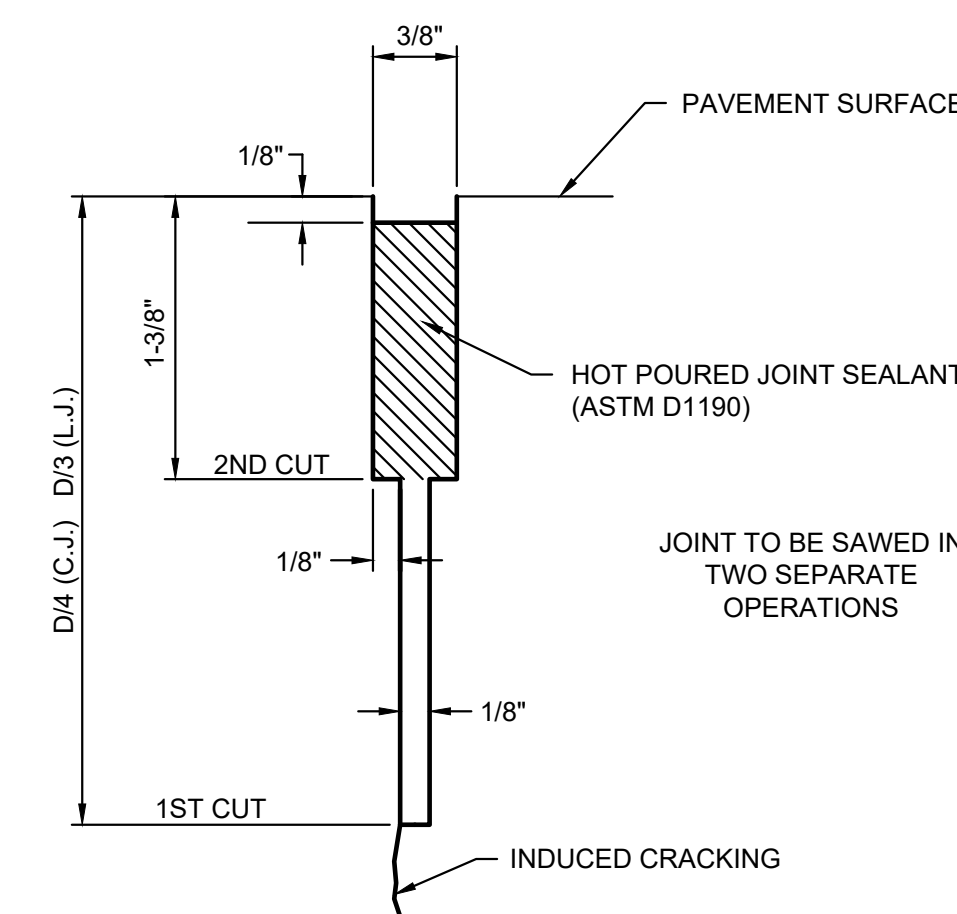


12 SAW JOINT DETAIL
SCALE: NTS

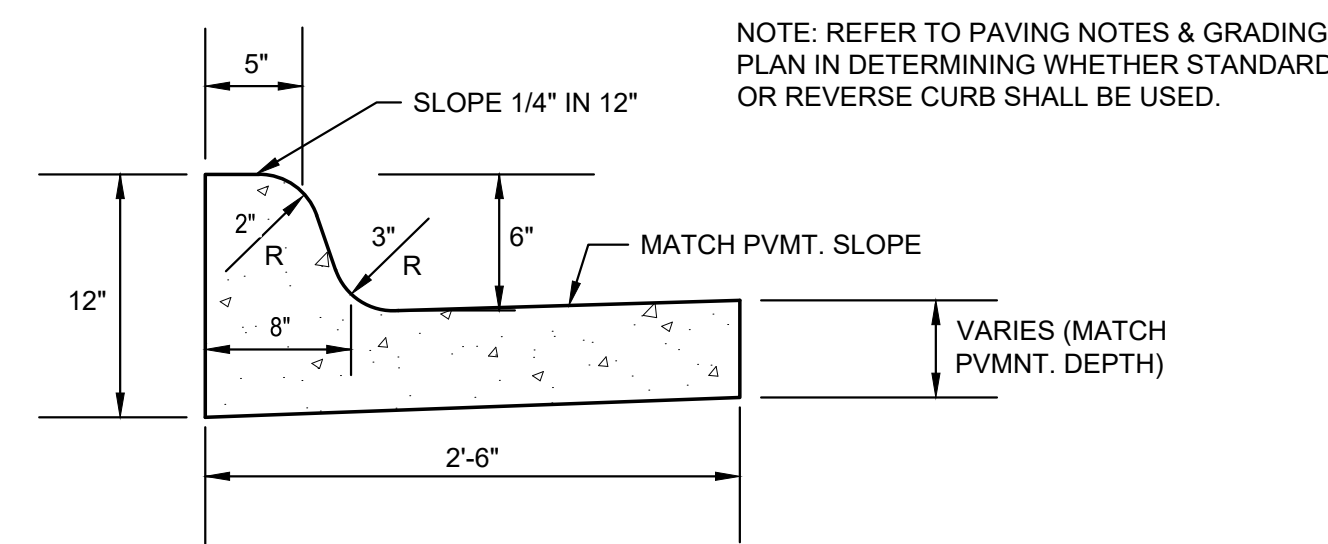

13 FULL CURB & GUTTER (STANDARD)
SCALE: NTS

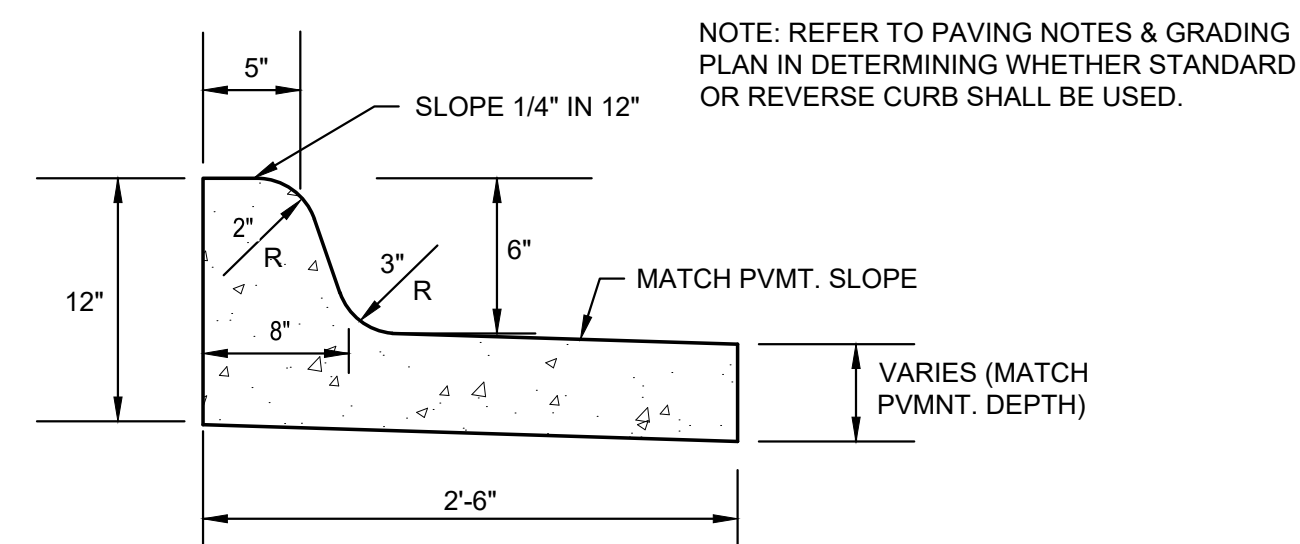



14 FULL CURB & GUTTER (REVERSE)
SCALE: NTS

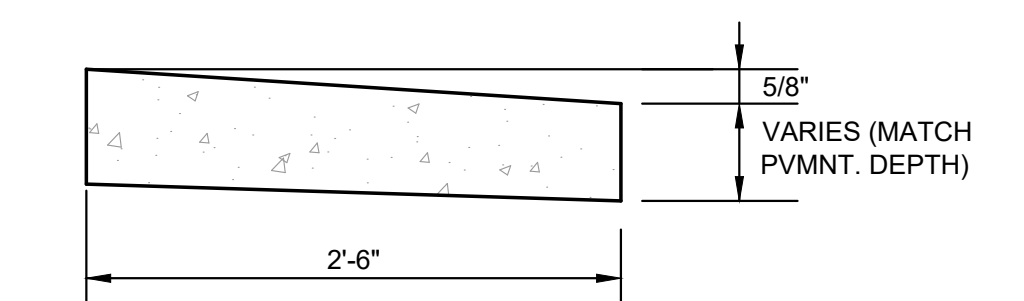


15 FLUSH CURB
SCALE: NTS

PLOTTED BY: BRYAN SMITH 4/22/2026 4:42 PM
 J:\PROJECTS\2025\2501010800_THE RESERVE AT THE MEADOWS\010800_CIVIL\LISTE
 DWG NAME: 25008 PAVING DETAILS.DWG
 ©2026 MKEC ENGINEERING, INC. ALL RIGHTS RESERVED WWW.MKEC.COM THESE DRAWINGS AND THEIR CONTENTS, INCLUDING, BUT NOT LIMITED TO, ALL CONCEPTS, DESIGNS, & IDEAS ARE THE EXCLUSIVE PROPERTY OF MKEC ENGINEERING, INC. (MKEC) AND MAY NOT BE USED OR REPRODUCED IN ANY WAY WITHOUT THE EXPRESS CONSENT OF MKEC.

NO.	REVISION	DATE

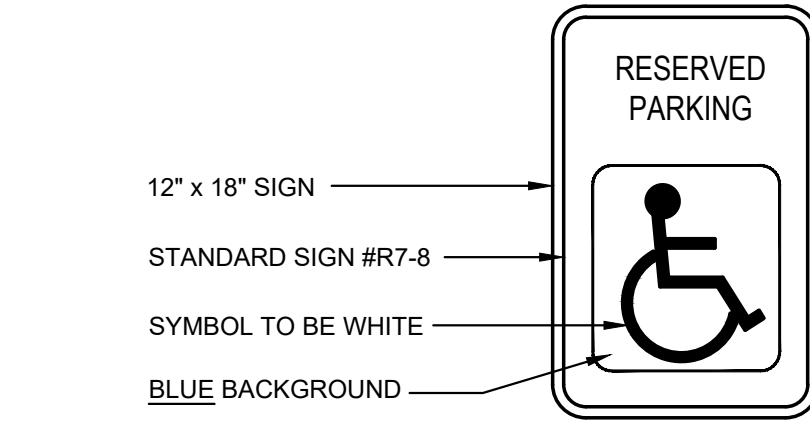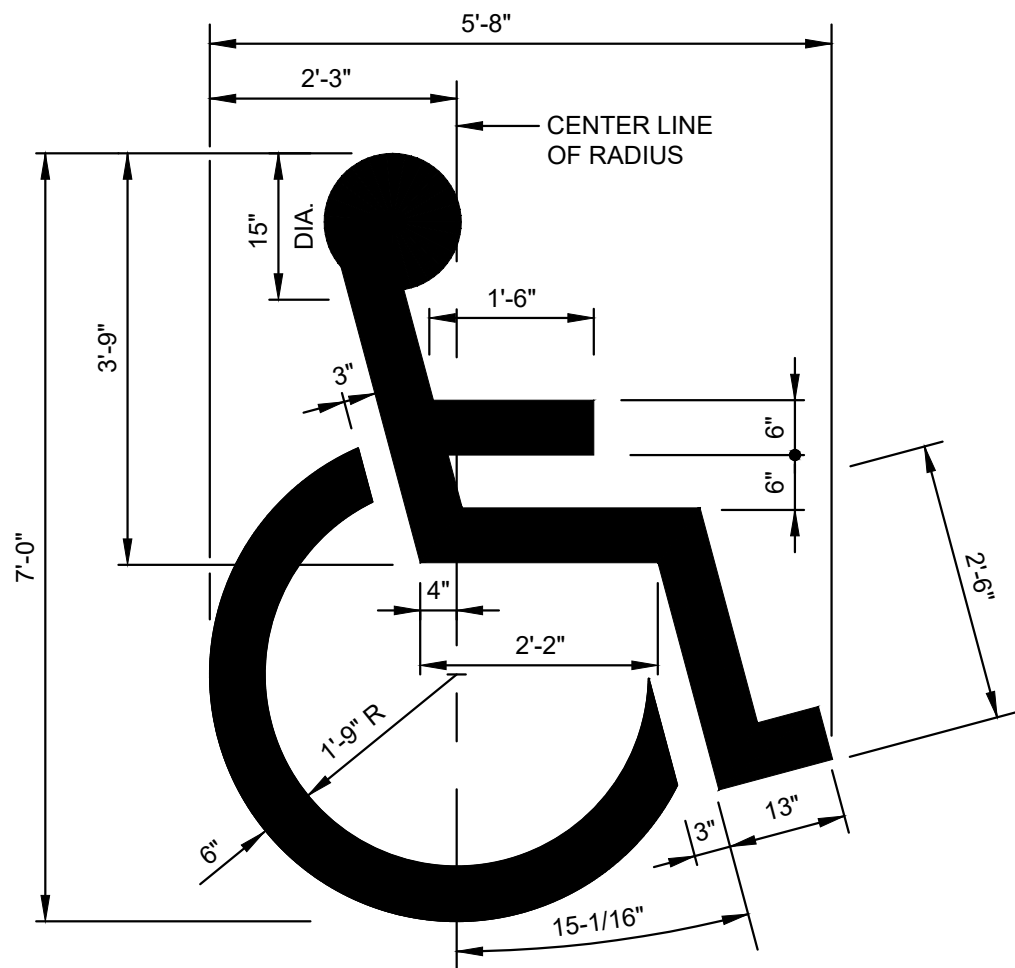

NOTES:
 1. ALL SIGNS TO BE 0.080" THICK ALUMINUM
 2. ALL SIGNS SHALL CONFORM WITH ALL CURRENT A.D.A., FEDERAL, STATE AND LOCAL CODES AND REGULATIONS.
 3. ONE AT EACH HANDICAP STALL

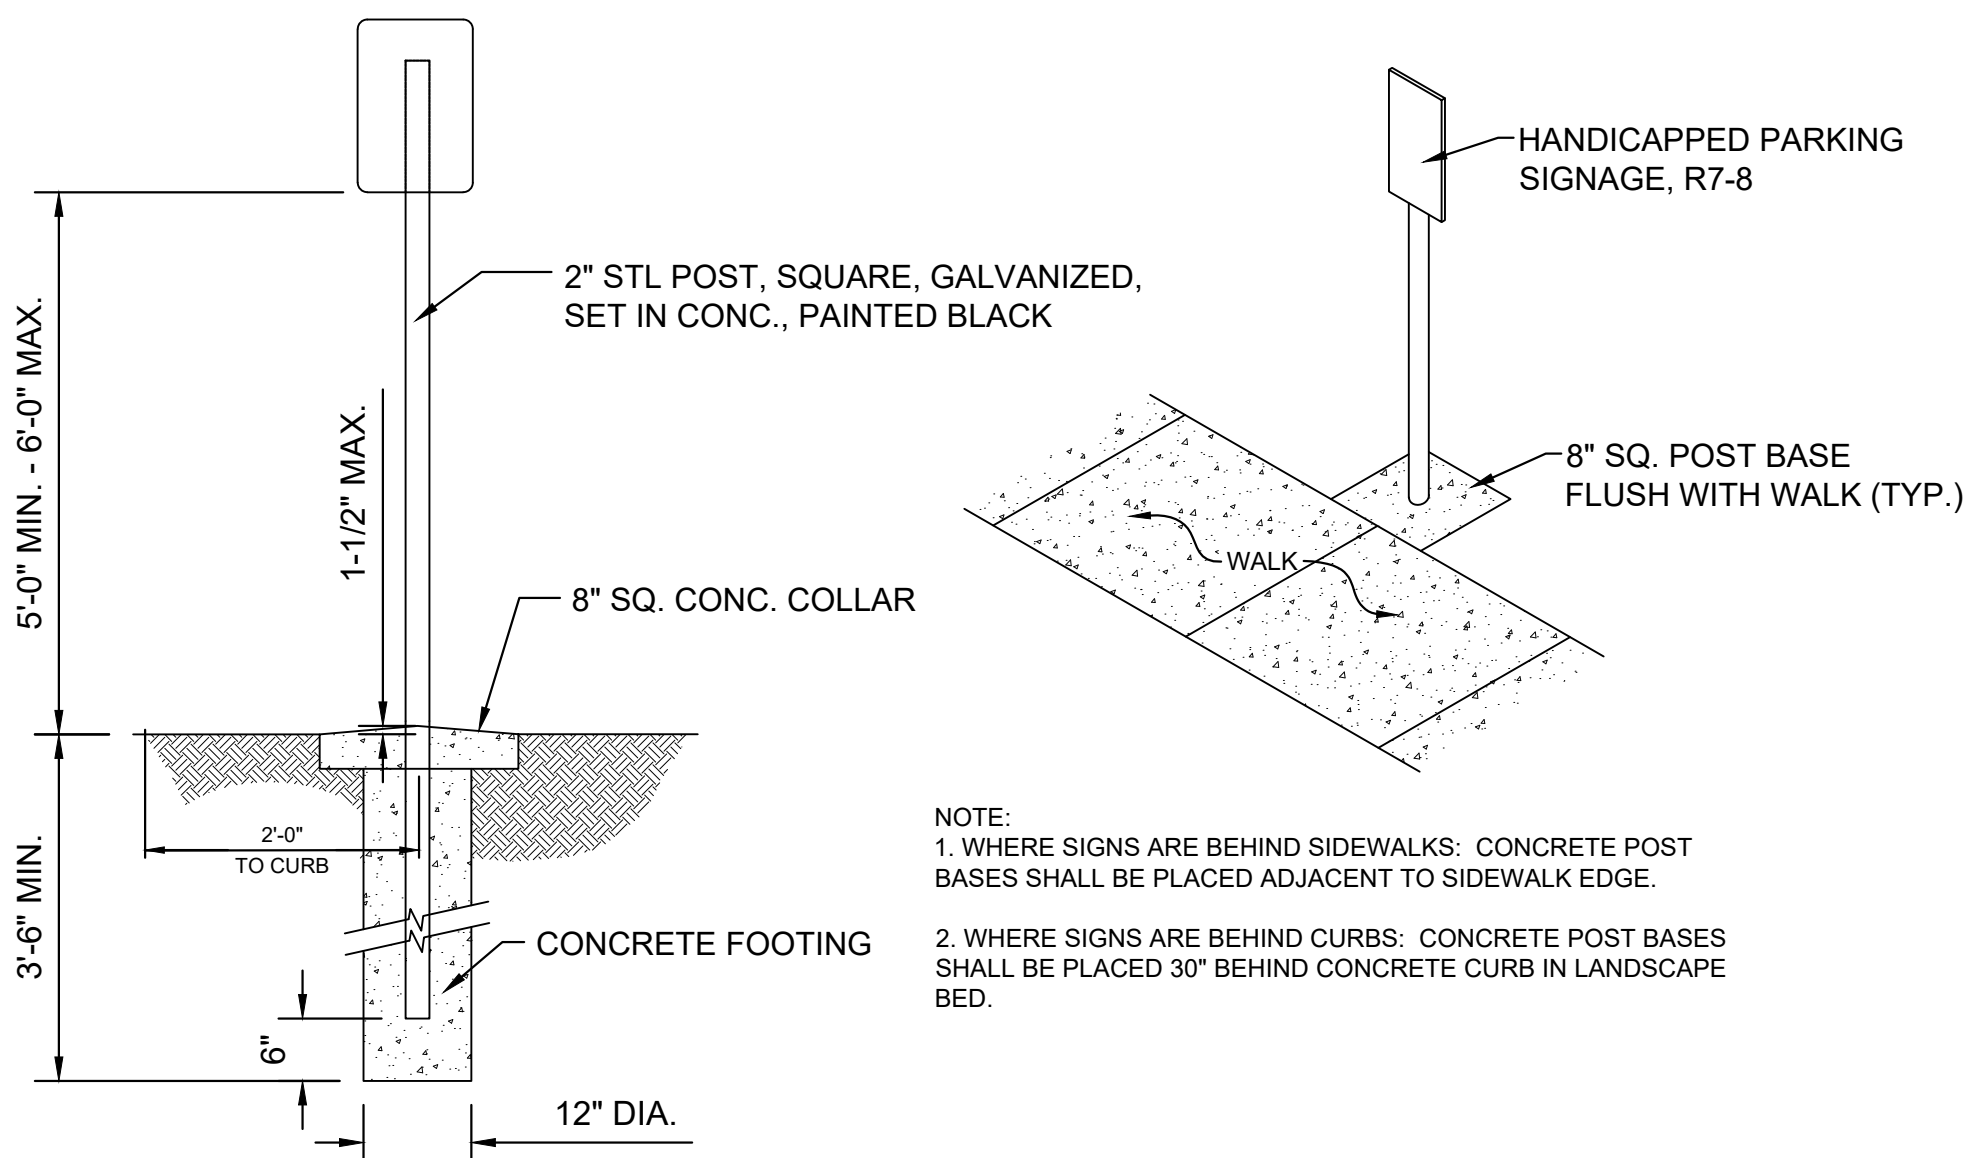

NOTE:
 1. WHERE SIGNS ARE BEHIND SIDEWALKS: CONCRETE POST BASES SHALL BE PLACED ADJACENT TO SIDEWALK EDGE.
 2. WHERE SIGNS ARE BEHIND CURBS: CONCRETE POST BASES SHALL BE PLACED 30" BEHIND CONCRETE CURB IN LANDSCAPE BED.

1 HANDICAP PAVEMENT MARKING


SCALE: NTS

2 HANDICAPPED PARKING SIGN



SCALE: NTS

3 MISC. SIGN MOUNTING DETAIL

SCALE: NTS

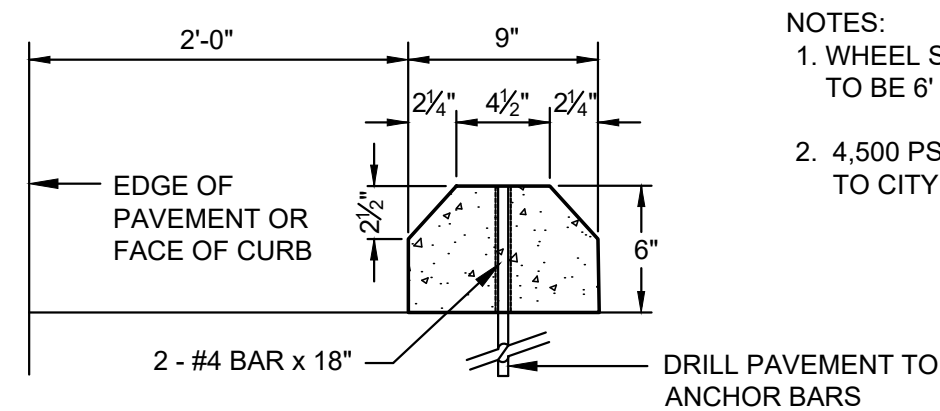

NOTES:
 1. WHEEL STOP TO BE 6' LONG
 2. 4,500 PSI CONC. TO CITY SPEC.

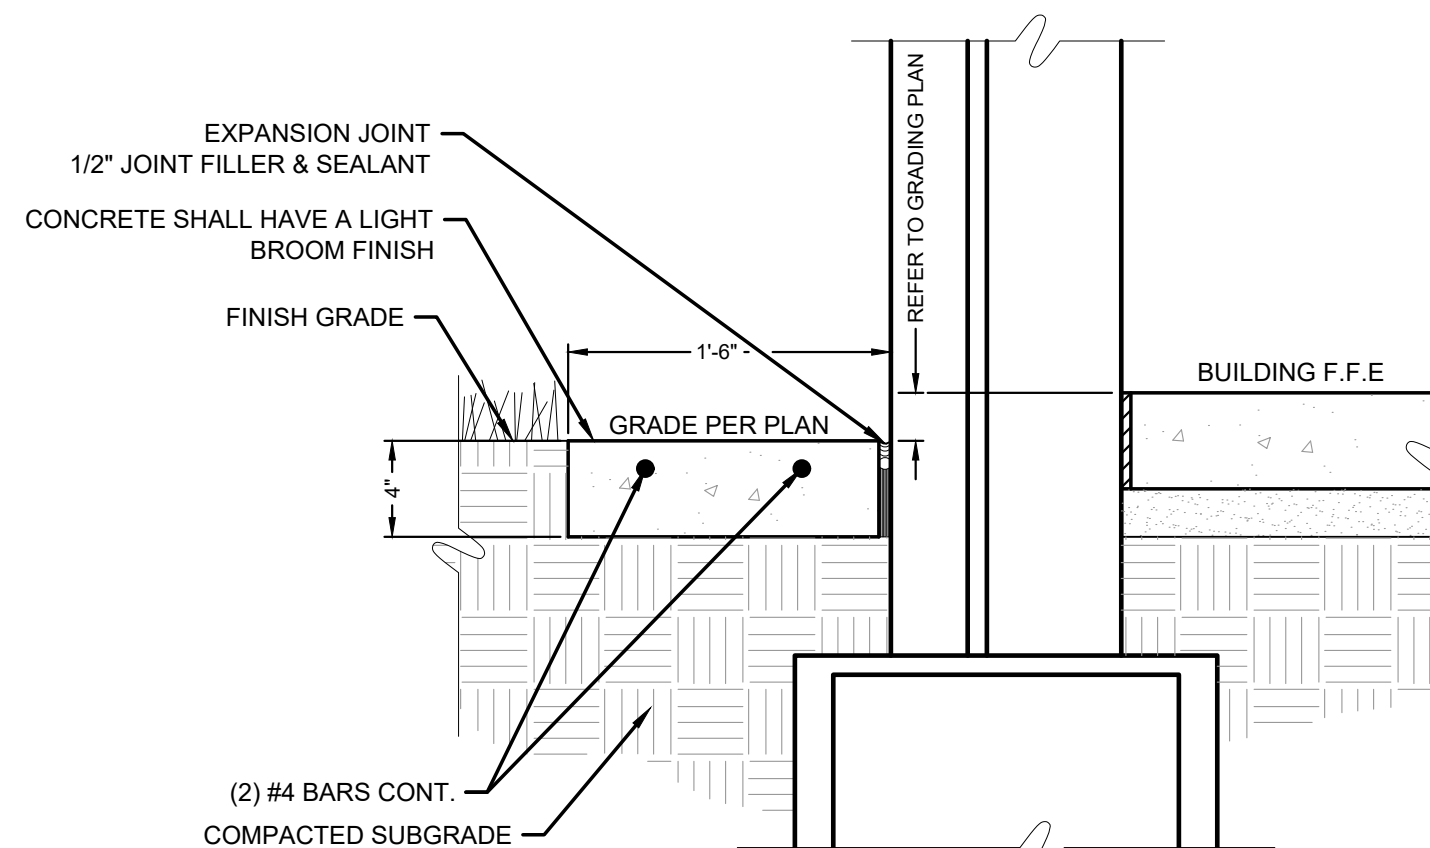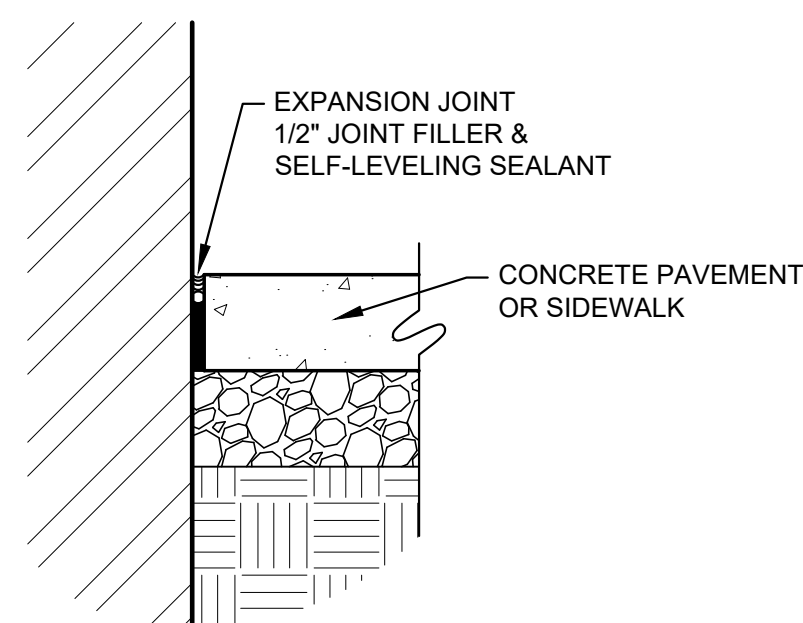

4 WHEEL STOP DETAIL


SCALE: NTS

5 EXPANSION JOINT AT BUILDING

SCALE: NTS



6 CONCRETE MOWSTRIP AT BUILDING

SCALE: NTS

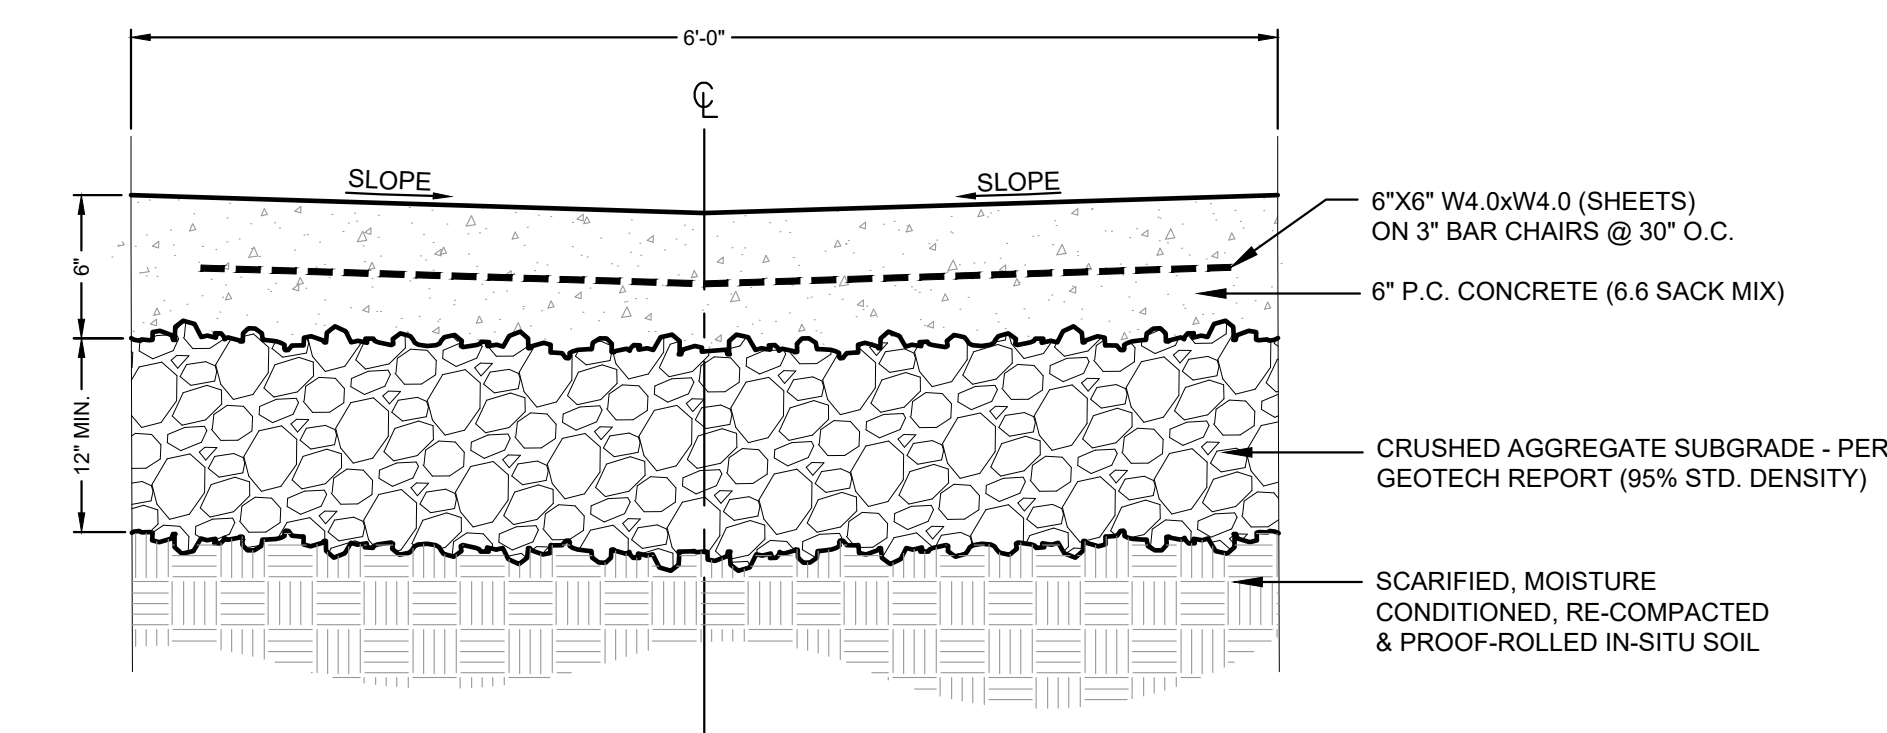

7 TYP. SECTION: 6' CONC. VALLEY GUTTER

SCALE: NTS

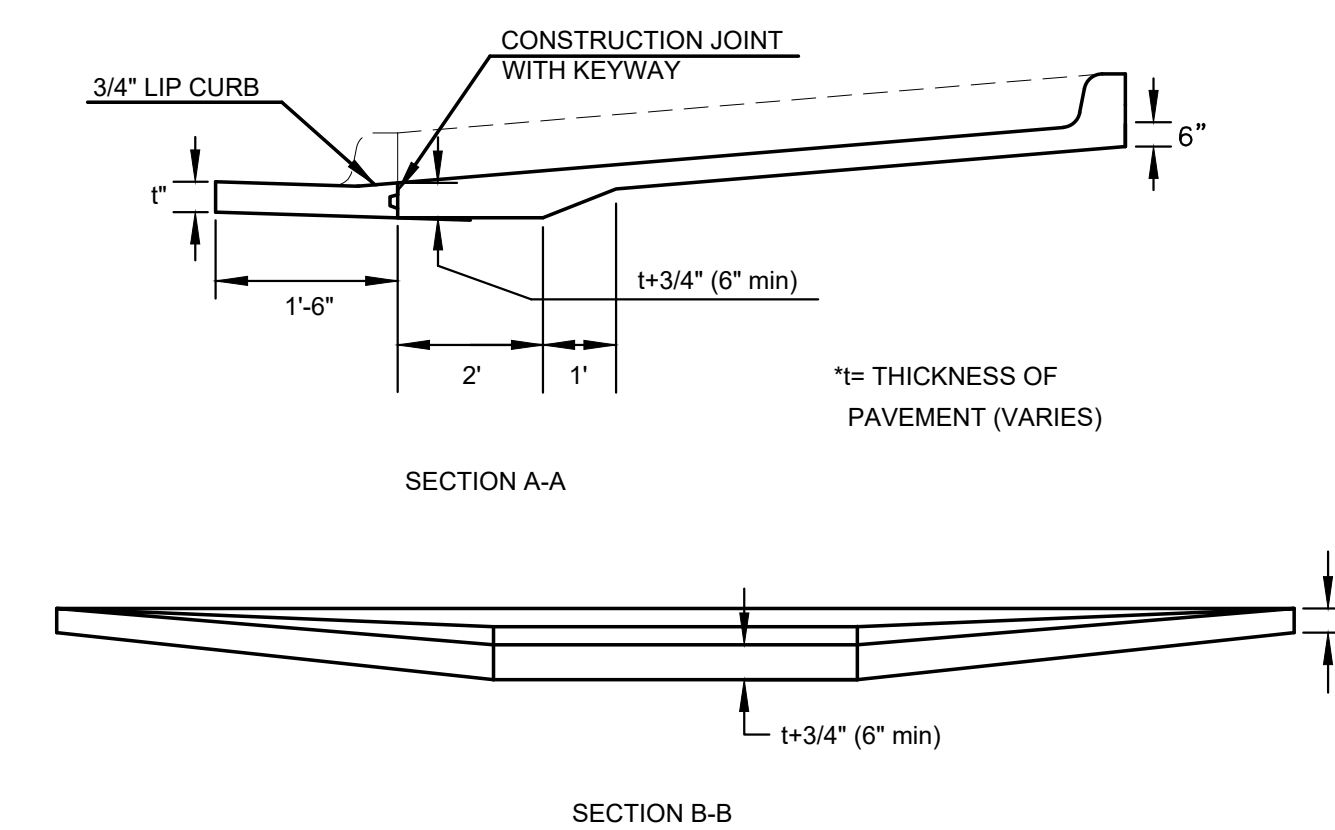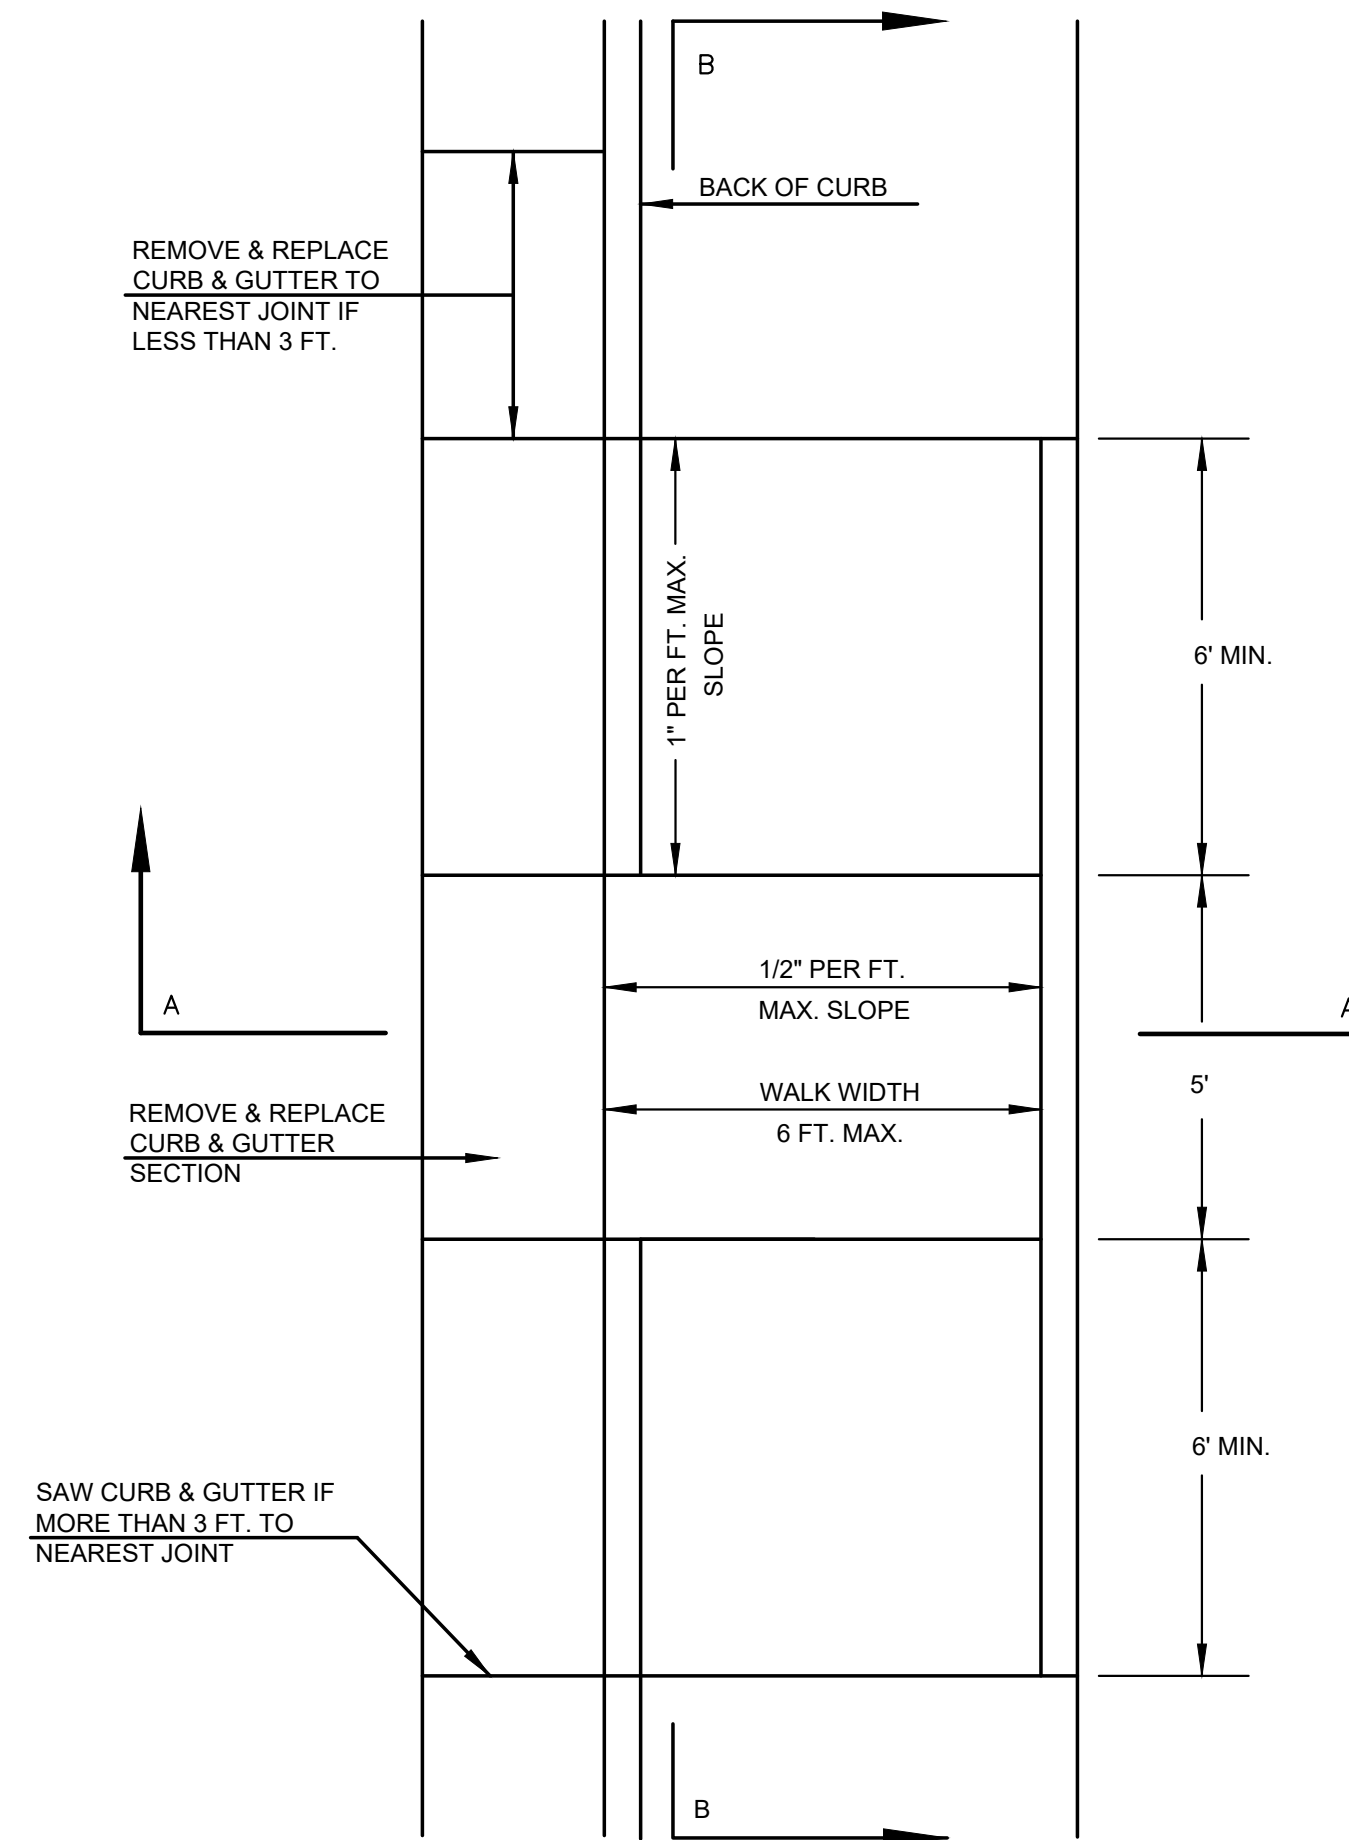


8 WHEEL CHAIR RAMP

SCALE: NTS

PAVING DETAILS (2 OF 2)	
PROJECT NO.	2501010800
SCALE	NTS
DRAWN	CNA
DESIGNED	TMBB
CHECKED	SPE
ISSUED FOR PERMIT	04/03/26
NO.	REVISION DATE
SHEET NO. C-252	

PLOTTED BY: BRYAN SMITH 4/22/2026 4:43 PM
 DWG PATH: J:\PROJECTS\2025\2501010800_THE RESERVE AT THE MEADOWS\CAD\BISHOP CIVILISTE
 DWG NAME: 2501010800_PAVING DETAILS.DWG
 02/26/2026 MKEC ENGINEERING, INC. ALL RIGHTS RESERVED WWW.MKEC.COM THESE DRAWINGS AND THEIR CONTENTS, INCLUDING, BUT NOT LIMITED TO, ALL CONCEPTS, DESIGNS, & IDEAS ARE THE EXCLUSIVE PROPERTY OF MKEC ENGINEERING, INC. (MKEC) AND MAY NOT BE USED OR REPRODUCED IN ANY WAY WITHOUT THE EXPRESS CONSENT OF MKEC.

0	ISSUED FOR PERMIT	04/03/26
NO.	REVISION	DATE

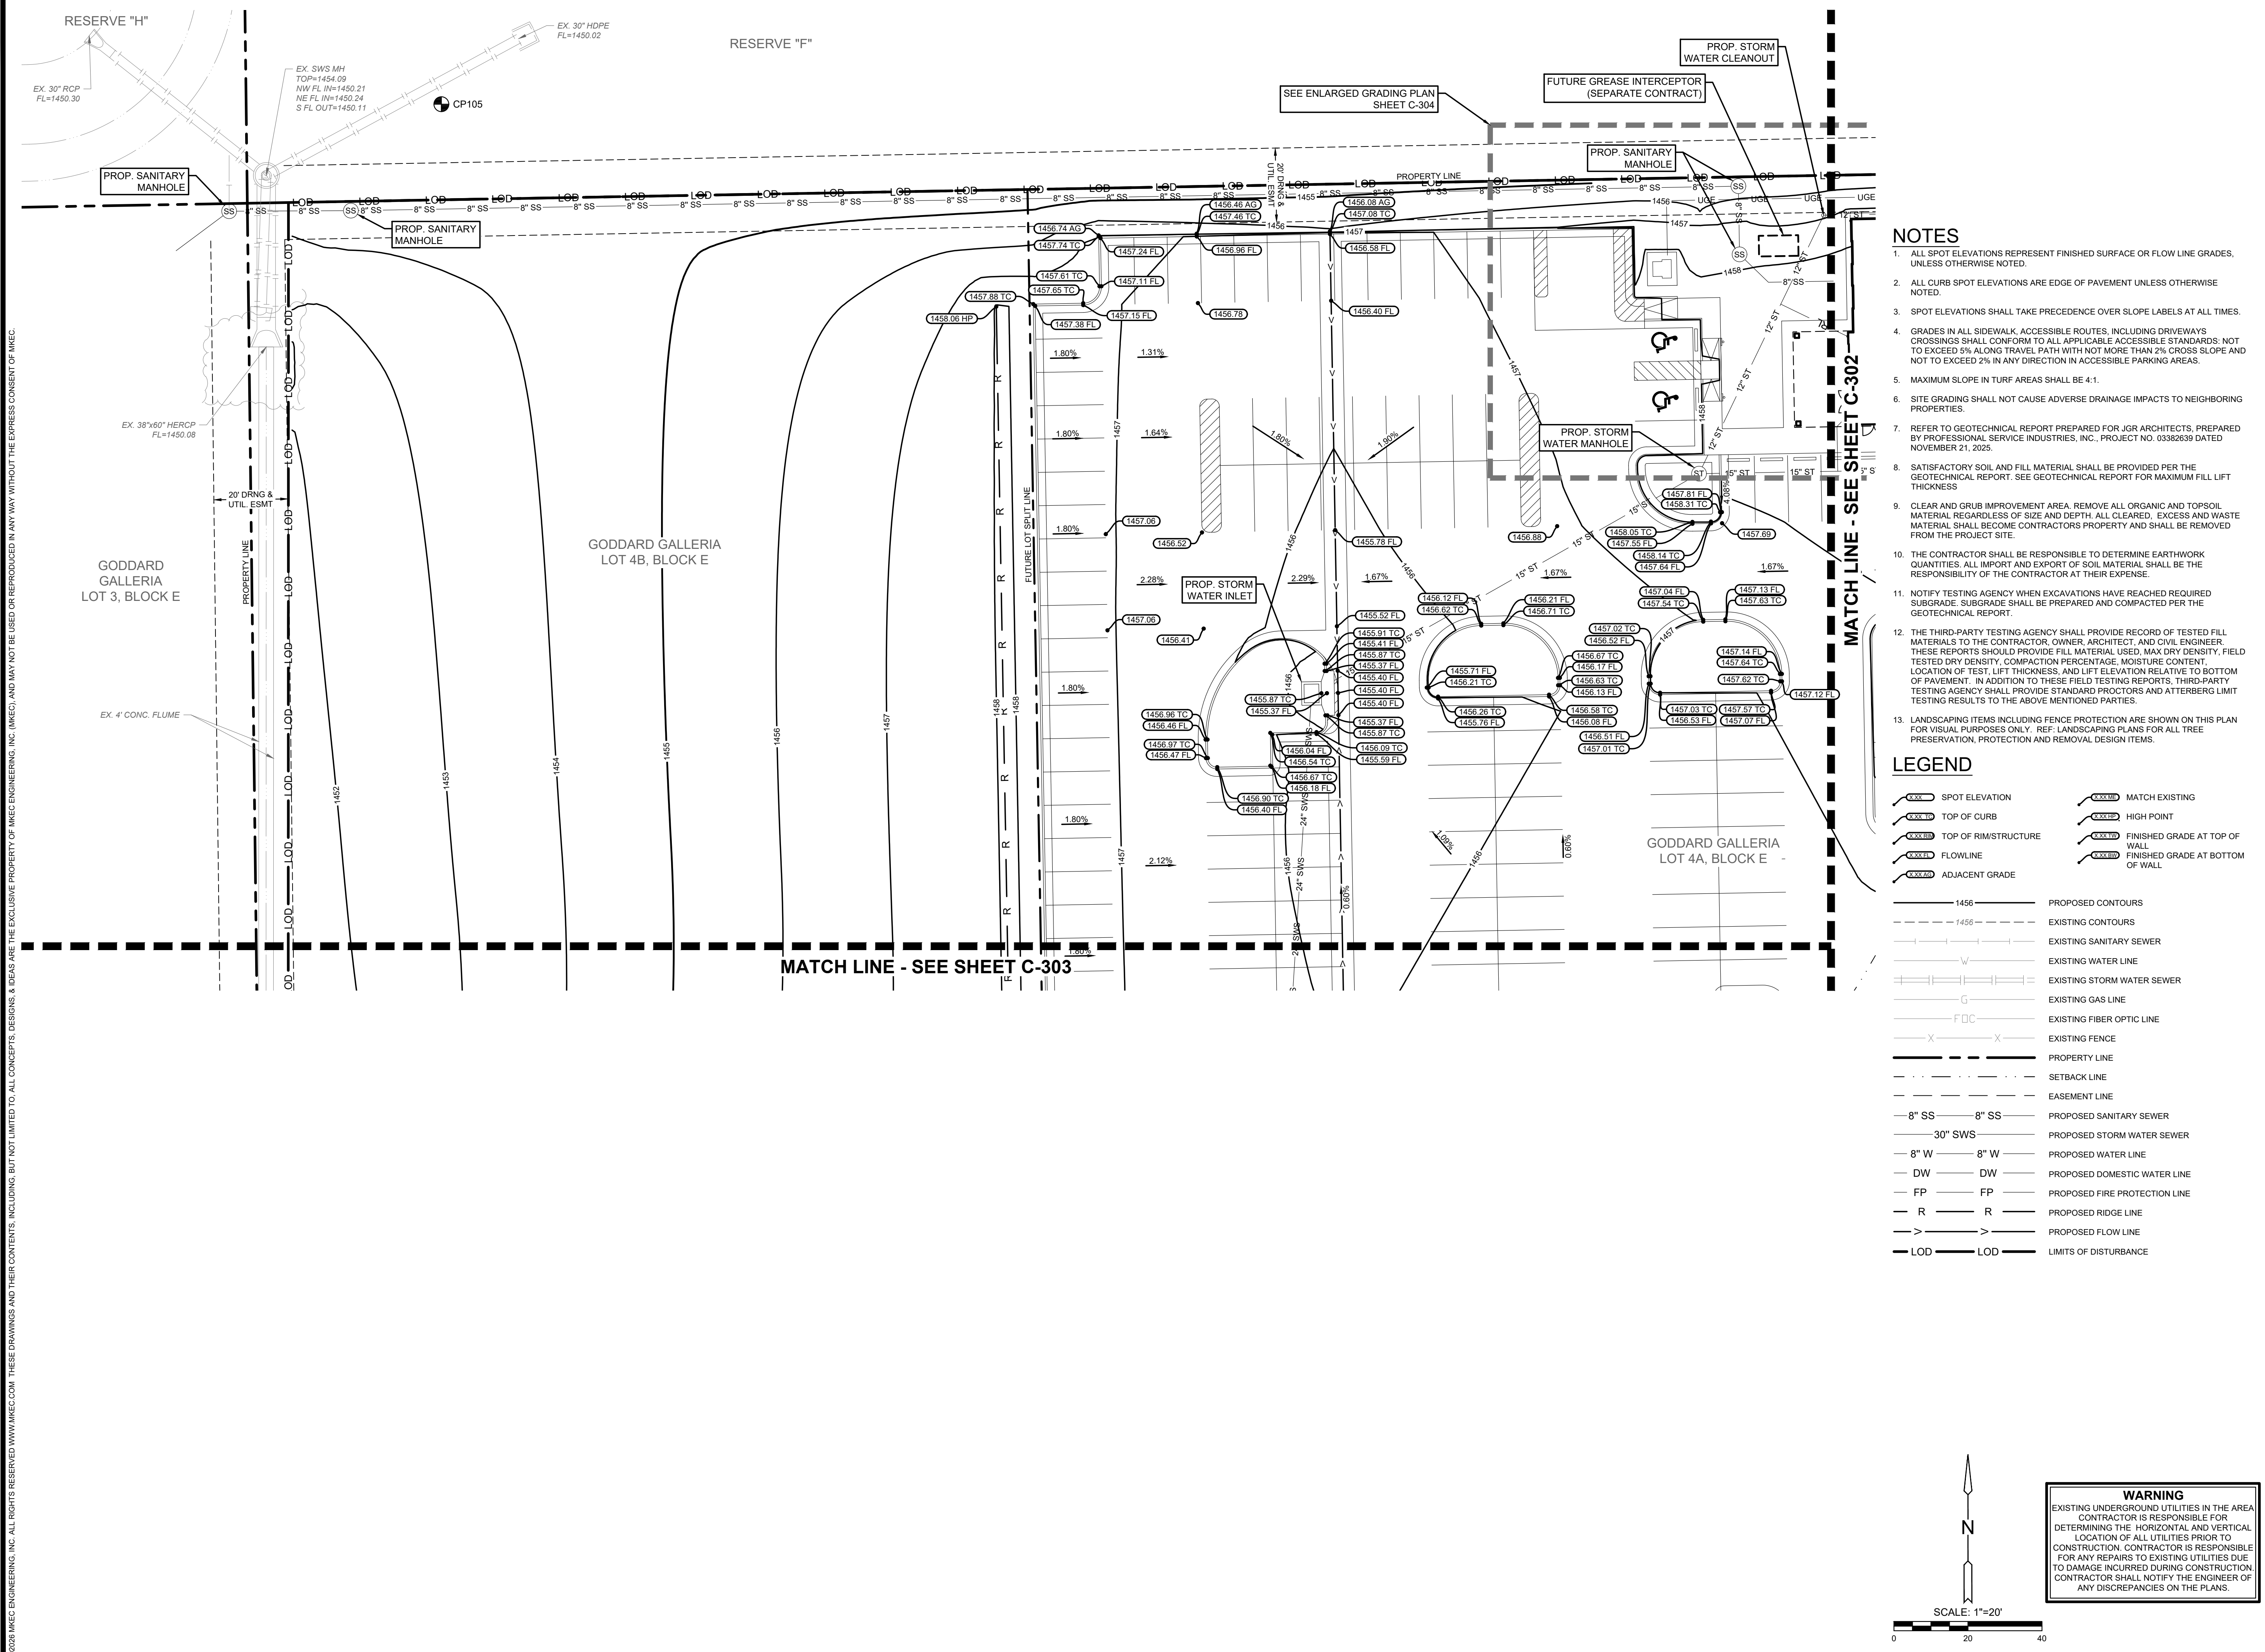

- ### NOTES
- ALL SPOT ELEVATIONS REPRESENT FINISHED SURFACE OR FLOW LINE GRADES, UNLESS OTHERWISE NOTED.
 - ALL CURB SPOT ELEVATIONS ARE EDGE OF PAVEMENT UNLESS OTHERWISE NOTED.
 - SPOT ELEVATIONS SHALL TAKE PRECEDENCE OVER SLOPE LABELS AT ALL TIMES.
 - GRADES IN ALL SIDEWALK, ACCESSIBLE ROUTES, INCLUDING DRIVEWAYS CROSSINGS SHALL CONFORM TO ALL APPLICABLE ACCESSIBLE STANDARDS; NOT TO EXCEED 5% ALONG TRAVEL PATH WITH NOT MORE THAN 2% CROSS SLOPE AND NOT TO EXCEED 2% IN ANY DIRECTION IN ACCESSIBLE PARKING AREAS.
 - MAXIMUM SLOPE IN TURF AREAS SHALL BE 4:1.
 - SITE GRADING SHALL NOT CAUSE ADVERSE DRAINAGE IMPACTS TO NEIGHBORING PROPERTIES.
 - REFER TO GEOTECHNICAL REPORT PREPARED FOR JGR ARCHITECTS, PREPARED BY PROFESSIONAL SERVICE INDUSTRIES, INC., PROJECT NO. 03362639 DATED NOVEMBER 21, 2025.
 - SATISFACTORY SOIL AND FILL MATERIAL SHALL BE PROVIDED PER THE GEOTECHNICAL REPORT. SEE GEOTECHNICAL REPORT FOR MAXIMUM FILL LIFT THICKNESS.
 - CLEAR AND GRUB IMPROVEMENT AREA. REMOVE ALL ORGANIC AND TOPSOIL MATERIAL REGARDLESS OF SIZE AND DEPTH. ALL CLEARED, EXCESS AND WASTE MATERIAL SHALL BECOME CONTRACTORS PROPERTY AND SHALL BE REMOVED FROM THE PROJECT SITE.
 - THE CONTRACTOR SHALL BE RESPONSIBLE TO DETERMINE EARTHWORK QUANTITIES. ALL IMPORT AND EXPORT OF SOIL MATERIAL SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR AT THEIR EXPENSE.
 - NOTIFY TESTING AGENCY WHEN EXCAVATIONS HAVE REACHED REQUIRED SUBGRADE. SUBGRADE SHALL BE PREPARED AND COMPACTED PER THE GEOTECHNICAL REPORT.
 - THE THIRD-PARTY TESTING AGENCY SHALL PROVIDE RECORD OF TESTED FILL MATERIALS TO THE CONTRACTOR, OWNER, ARCHITECT, AND CIVIL ENGINEER. THESE REPORTS SHOULD PROVIDE FILL MATERIAL USED, MAX DRY DENSITY, FIELD TESTED DRY DENSITY, COMPACTION PERCENTAGE, MOISTURE CONTENT, LOCATION OF TEST, LIFT THICKNESS, AND LIFT ELEVATION RELATIVE TO BOTTOM OF PAVEMENT. IN ADDITION TO THESE FIELD TESTING REPORTS, THIRD-PARTY TESTING AGENCY SHALL PROVIDE STANDARD PROCTORS AND ATTERBERG LIMIT TESTING RESULTS TO THE ABOVE MENTIONED PARTIES.
 - LANDSCAPING ITEMS INCLUDING FENCE PROTECTION ARE SHOWN ON THIS PLAN FOR VISUAL PURPOSES ONLY. REF. LANDSCAPING PLANS FOR ALL TREE PRESERVATION, PROTECTION AND REMOVAL DESIGN ITEMS.

- ### LEGEND
- | | | | |
|--|----------------------------|--|----------------------------------|
| | SPOT ELEVATION | | MATCH EXISTING |
| | TOP OF CURB | | HIGH POINT |
| | TOP OF RIM/STRUCTURE | | FINISHED GRADE AT TOP OF WALL |
| | FLOWLINE | | FINISHED GRADE AT BOTTOM OF WALL |
| | ADJACENT GRADE | | |
| | 1456 | | 1456 |
| | EXISTING SANITARY SEWER | | |
| | EXISTING WATER LINE | | |
| | EXISTING STORM WATER SEWER | | |
| | EXISTING GAS LINE | | |
| | EXISTING FIBER OPTIC LINE | | |
| | EXISTING FENCE | | |
| | PROPERTY LINE | | |
| | SETBACK LINE | | |
| | EASEMENT LINE | | |
| | 8" SS | | 30" SWS |
| | 8" W | | DW |
| | FP | | R |
| | > | | LOD |




PLOTTED BY: BRYAN SMITH 4/22/2026 4:43 PM
 DWG PATH: J:\PROJECTS\202501010800_JGR_THE RESERVE AT THE MEADOWS\00 CAD\BTS\00 CIVIL\SITE
 2501010800 GRADING.DWG
 ©2026 MKEC ENGINEERING, INC. ALL RIGHTS RESERVED WWW.MKEC.COM THESE DRAWINGS AND THEIR CONTENTS, INCLUDING, BUT NOT LIMITED TO, ALL CONCEPTS, DESIGNS, & IDEAS ARE THE EXCLUSIVE PROPERTY OF MKEC ENGINEERING, INC. (MKEC) AND MAY NOT BE USED OR REPRODUCED IN ANY WAY WITHOUT THE EXPRESS CONSENT OF MKEC.

NOTES

- ALL SPOT ELEVATIONS REPRESENT FINISHED SURFACE OR FLOW LINE GRADES, UNLESS OTHERWISE NOTED.
- ALL CURB SPOT ELEVATIONS ARE EDGE OF PAVEMENT UNLESS OTHERWISE NOTED.
- SPOT ELEVATIONS SHALL TAKE PRECEDENCE OVER SLOPE LABELS AT ALL TIMES.
- GRADES IN ALL SIDEWALK, ACCESSIBLE ROUTES, INCLUDING DRIVEWAYS CROSSINGS SHALL CONFORM TO ALL APPLICABLE ACCESSIBLE STANDARDS; NOT TO EXCEED 5% ALONG TRAVEL PATH WITH NOT MORE THAN 2% CROSS SLOPE AND NOT TO EXCEED 2% IN ANY DIRECTION IN ACCESSIBLE PARKING AREAS.
- MAXIMUM SLOPE IN TURF AREAS SHALL BE 4:1.
- SITE GRADING SHALL NOT CAUSE ADVERSE DRAINAGE IMPACTS TO NEIGHBORING PROPERTIES.
- REFER TO GEOTECHNICAL REPORT PREPARED FOR JGR ARCHITECTS, PREPARED BY PROFESSIONAL SERVICE INDUSTRIES, INC., PROJECT NO. 03362639 DATED NOVEMBER 21, 2025.
- SATISFACTORY SOIL AND FILL MATERIAL SHALL BE PROVIDED PER THE GEOTECHNICAL REPORT. SEE GEOTECHNICAL REPORT FOR MAXIMUM FILL LIFT THICKNESS.
- CLEAR AND GRUB IMPROVEMENT AREA. REMOVE ALL ORGANIC AND TOPSOIL MATERIAL REGARDLESS OF SIZE AND DEPTH. ALL CLEARED, EXCESS AND WASTE MATERIAL SHALL BECOME CONTRACTORS PROPERTY AND SHALL BE REMOVED FROM THE PROJECT SITE.
- THE CONTRACTOR SHALL BE RESPONSIBLE TO DETERMINE EARTHWORK QUANTITIES. ALL IMPORT AND EXPORT OF SOIL MATERIAL SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR AT THEIR EXPENSE.
- NOTIFY TESTING AGENCY WHEN EXCAVATIONS HAVE REACHED REQUIRED SUBGRADE. SUBGRADE SHALL BE PREPARED AND COMPACTED PER THE GEOTECHNICAL REPORT.
- THE THIRD-PARTY TESTING AGENCY SHALL PROVIDE RECORD OF TESTED FILL MATERIALS TO THE CONTRACTOR, OWNER, ARCHITECT, AND CIVIL ENGINEER. THESE REPORTS SHOULD PROVIDE FILL MATERIAL USED, MAX DRY DENSITY, FIELD TESTED DRY DENSITY, COMPACTION PERCENTAGE, MOISTURE CONTENT, LOCATION OF TEST, LIFT THICKNESS, AND LIFT ELEVATION RELATIVE TO BOTTOM OF PAVEMENT. IN ADDITION TO THESE FIELD TESTING REPORTS, THIRD-PARTY TESTING AGENCY SHALL PROVIDE STANDARD PROCTORS AND ATTERBERG LIMIT TESTING RESULTS TO THE ABOVE MENTIONED PARTIES.
- LANDSCAPING ITEMS INCLUDING FENCE PROTECTION ARE SHOWN ON THIS PLAN FOR VISUAL PURPOSES ONLY. REF. LANDSCAPING PLANS FOR ALL TREE PRESERVATION, PROTECTION AND REMOVAL DESIGN ITEMS.


LEGEND

- | | | | |
|--|-------------------------------|--|----------------------------------|
| | SPOT ELEVATION | | MATCH EXISTING |
| | TOP OF CURB | | HIGH POINT |
| | TOP OF RIM/STRUCTURE | | FINISHED GRADE AT TOP OF WALL |
| | FLOWLINE | | FINISHED GRADE AT BOTTOM OF WALL |
| | ADJACENT GRADE | | |
| | PROPOSED CONTOURS | | |
| | EXISTING CONTOURS | | |
| | EXISTING SANITARY SEWER | | |
| | EXISTING WATER LINE | | |
| | EXISTING STORM WATER SEWER | | |
| | EXISTING GAS LINE | | |
| | EXISTING FIBER OPTIC LINE | | |
| | EXISTING FENCE | | |
| | PROPERTY LINE | | |
| | SETBACK LINE | | |
| | EASEMENT LINE | | |
| | PROPOSED SANITARY SEWER | | |
| | PROPOSED STORM WATER SEWER | | |
| | PROPOSED WATER LINE | | |
| | PROPOSED DOMESTIC WATER LINE | | |
| | PROPOSED FIRE PROTECTION LINE | | |
| | PROPOSED RIDGE LINE | | |
| | PROPOSED FLOW LINE | | |
| | LIMITS OF DISTURBANCE | | |

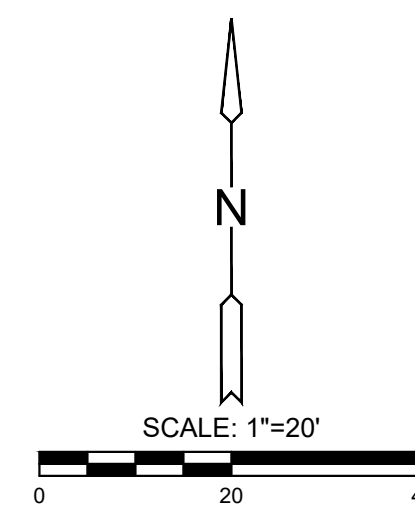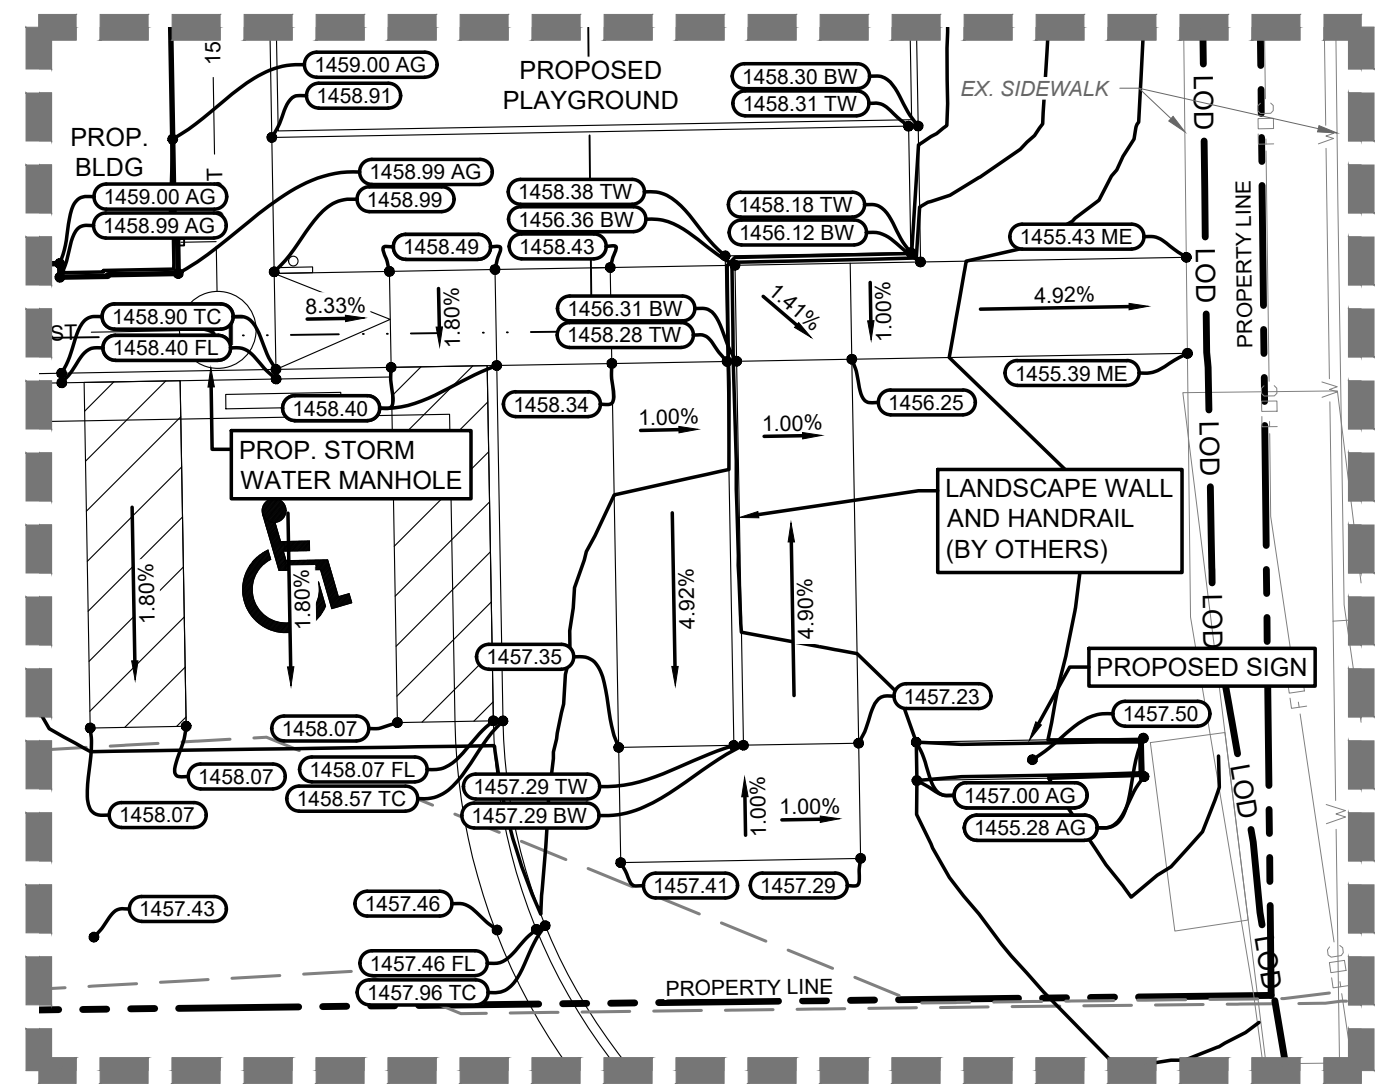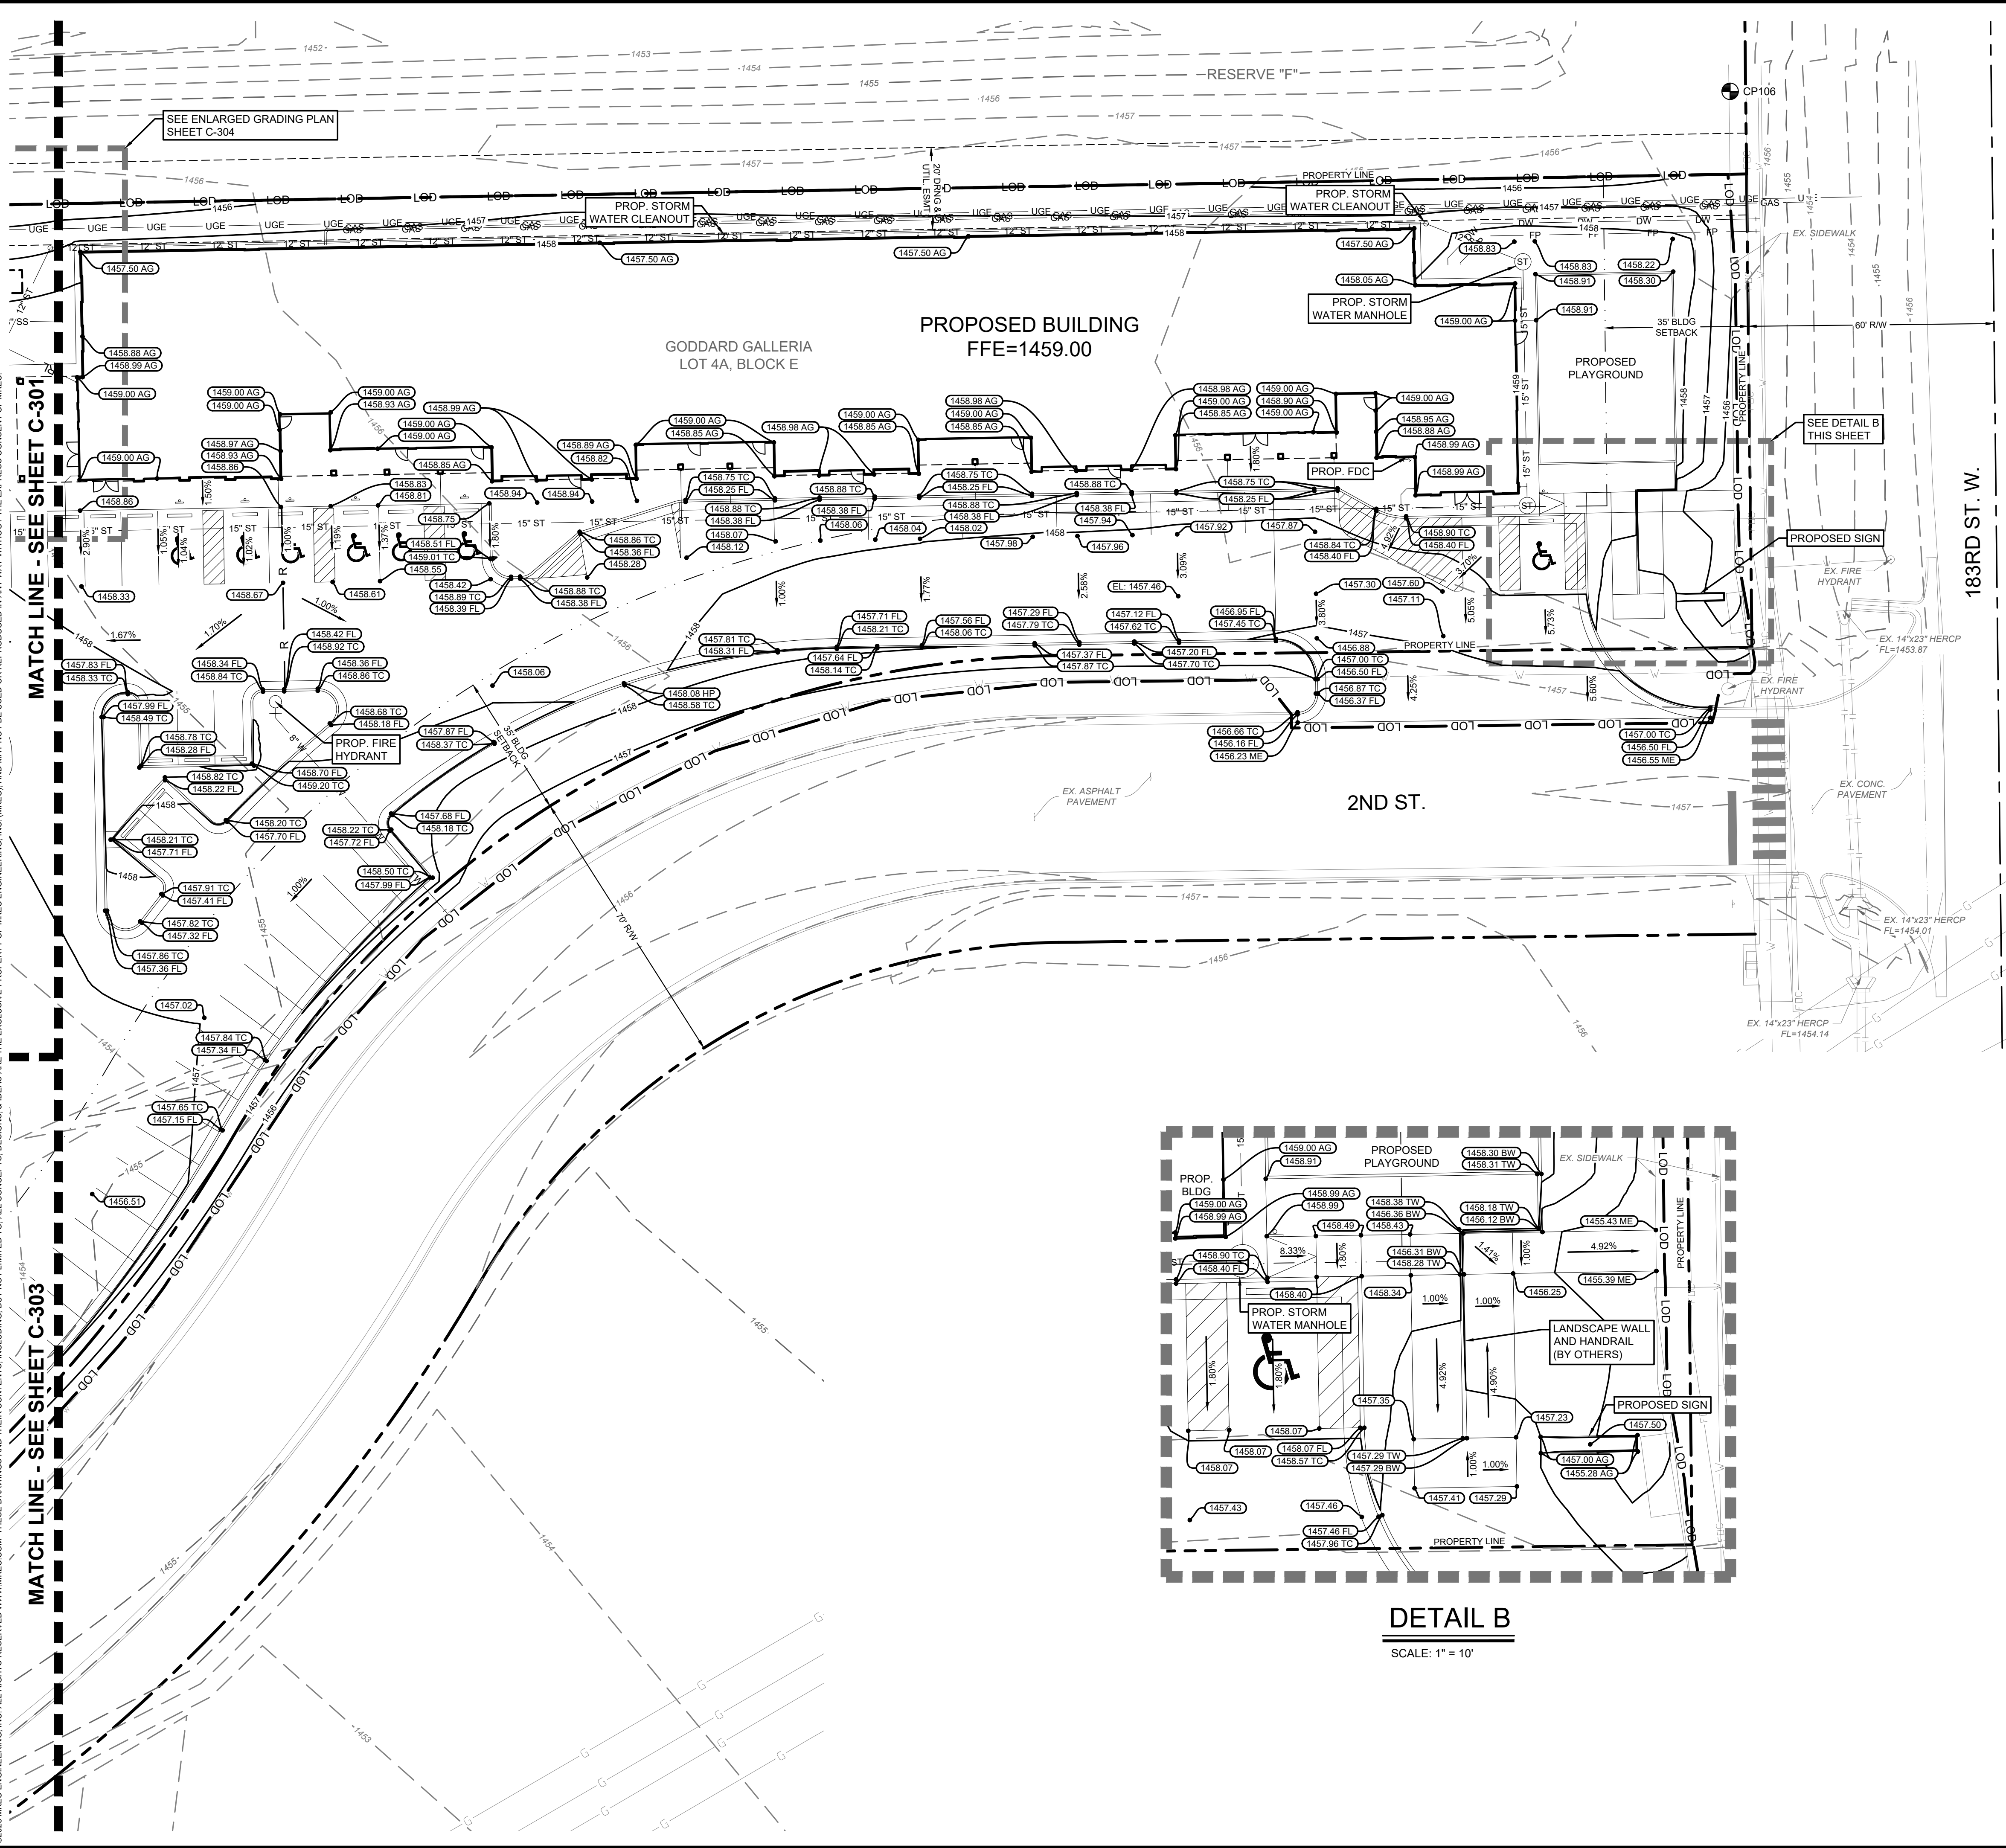


WARNING
EXISTING UNDERGROUND UTILITIES IN THE AREA. CONTRACTOR IS RESPONSIBLE FOR DETERMINING THE HORIZONTAL AND VERTICAL LOCATION OF ALL UTILITIES PRIOR TO CONSTRUCTION. CONTRACTOR IS RESPONSIBLE FOR ANY REPAIRS TO EXISTING UTILITIES DUE TO DAMAGE INCURRED DURING CONSTRUCTION. CONTRACTOR SHALL NOTIFY THE ENGINEER OF ANY DISCREPANCIES ON THE PLANS.

PLOTTED BY: BRYAN SMITH 4/22/2026 4:43 PM
J:\PROJECTS\202501010800_JGR_THE RESERVE AT THE MEADOWS\DWG\CAD\BHS\CIVIL\LISTE
DWG NAME: 2501010800 GRADING.DWG
©2026 MKEC ENGINEERING, INC. ALL RIGHTS RESERVED WWW.MKEC.COM THESE DRAWINGS AND THEIR CONTENTS, INCLUDING, BUT NOT LIMITED TO, ALL CONCEPTS, DESIGNS, & IDEAS ARE THE EXCLUSIVE PROPERTY OF MKEC ENGINEERING, INC. (MKEC) AND MAY NOT BE USED OR REPRODUCED IN ANY WAY WITHOUT THE EXPRESS CONSENT OF MKEC.

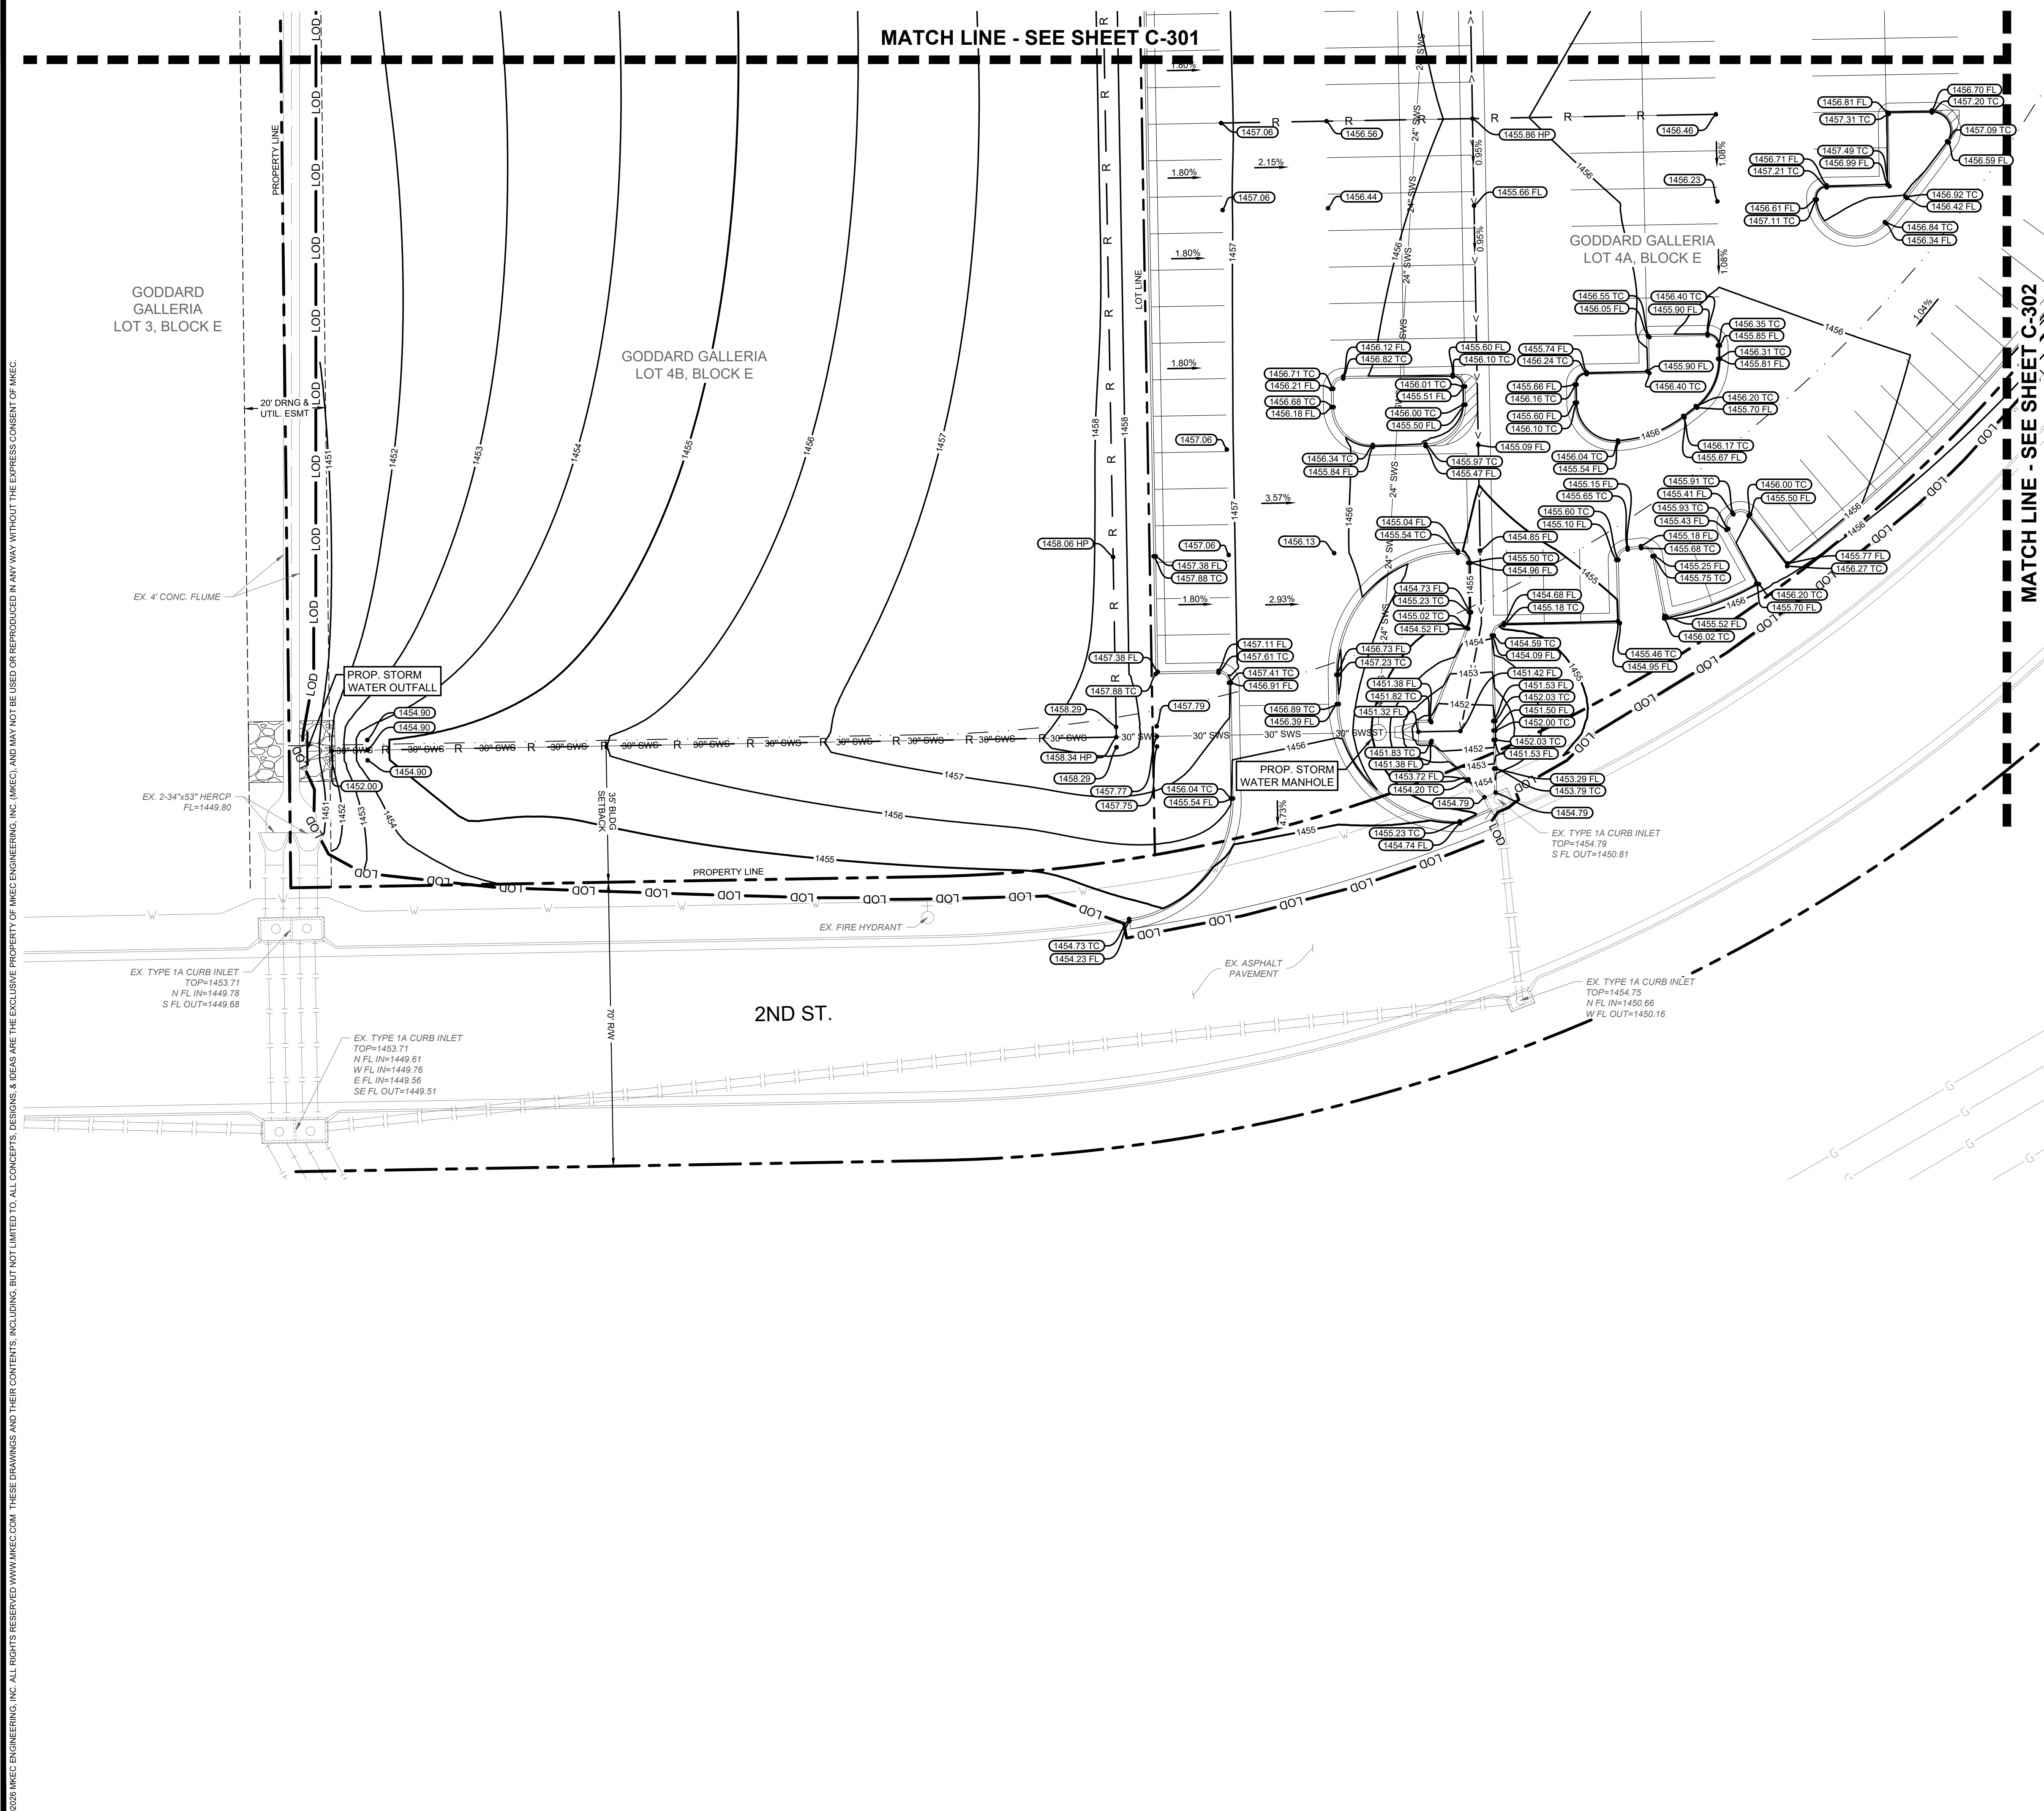

- ### NOTES
- ALL SPOT ELEVATIONS REPRESENT FINISHED SURFACE OR FLOW LINE GRADES, UNLESS OTHERWISE NOTED.
 - ALL CURB SPOT ELEVATIONS ARE EDGE OF PAVEMENT UNLESS OTHERWISE NOTED.
 - SPOT ELEVATIONS SHALL TAKE PRECEDENCE OVER SLOPE LABELS AT ALL TIMES.
 - GRADES IN ALL SIDEWALK, ACCESSIBLE ROUTES, INCLUDING DRIVEWAYS CROSSINGS SHALL CONFORM TO ALL APPLICABLE ACCESSIBLE STANDARDS; NOT TO EXCEED 5% ALONG TRAVEL PATH WITH NOT MORE THAN 2% CROSS SLOPE AND NOT TO EXCEED 2% IN ANY DIRECTION IN ACCESSIBLE PARKING AREAS.
 - MAXIMUM SLOPE IN TURF AREAS SHALL BE 4:1.
 - SITE GRADING SHALL NOT CAUSE ADVERSE DRAINAGE IMPACTS TO NEIGHBORING PROPERTIES.
 - REFER TO GEOTECHNICAL REPORT PREPARED FOR JGR ARCHITECTS, PREPARED BY PROFESSIONAL SERVICE INDUSTRIES, INC., PROJECT NO. 03362639 DATED NOVEMBER 21, 2025.
 - SATISFACTORY SOIL AND FILL MATERIAL SHALL BE PROVIDED PER THE GEOTECHNICAL REPORT. SEE GEOTECHNICAL REPORT FOR MAXIMUM FILL LIFT THICKNESS.
 - CLEAR AND GRUB IMPROVEMENT AREA. REMOVE ALL ORGANIC AND TOPSOIL MATERIAL REGARDLESS OF SIZE AND DEPTH. ALL CLEARED, EXCESS AND WASTE MATERIAL SHALL BECOME CONTRACTORS PROPERTY AND SHALL BE REMOVED FROM THE PROJECT SITE.
 - THE CONTRACTOR SHALL BE RESPONSIBLE TO DETERMINE EARTHWORK QUANTITIES. ALL IMPORT AND EXPORT OF SOIL MATERIAL SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR AT THEIR EXPENSE.
 - NOTIFY TESTING AGENCY WHEN EXCAVATIONS HAVE REACHED REQUIRED SUBGRADE. SUBGRADE SHALL BE PREPARED AND COMPACTED PER THE GEOTECHNICAL REPORT.
 - THE THIRD-PARTY TESTING AGENCY SHALL PROVIDE RECORD OF TESTED FILL MATERIALS TO THE CONTRACTOR, OWNER, ARCHITECT, AND CIVIL ENGINEER. THESE REPORTS SHOULD PROVIDE FILL MATERIAL USED, MAX DRY DENSITY, FIELD TESTED DRY DENSITY, COMPACTION PERCENTAGE, MOISTURE CONTENT, LOCATION OF TEST, LIFT THICKNESS, AND LIFT ELEVATION RELATIVE TO BOTTOM OF PAVEMENT. IN ADDITION TO THESE FIELD TESTING REPORTS, THIRD-PARTY TESTING AGENCY SHALL PROVIDE STANDARD PROCTORS AND ATTERBERG LIMIT TESTING RESULTS TO THE ABOVE MENTIONED PARTIES.
 - LANDSCAPING ITEMS INCLUDING FENCE PROTECTION ARE SHOWN ON THIS PLAN FOR VISUAL PURPOSES ONLY. REF. LANDSCAPING PLANS FOR ALL TREE PRESERVATION, PROTECTION AND REMOVAL DESIGN ITEMS.

- ### LEGEND
- | | | | |
|--|----------------------|--|----------------------------------|
| | SPOT ELEVATION | | MATCH EXISTING |
| | TOP OF CURB | | HIGH POINT |
| | TOP OF RIM/STRUCTURE | | FINISHED GRADE AT TOP OF WALL |
| | FLOWLINE | | FINISHED GRADE AT BOTTOM OF WALL |
| | ADJACENT GRADE | | |
-
- | | | |
|--|---------|-------------------------------|
| | 1456 | PROPOSED CONTOURS |
| | 1456 | EXISTING CONTOURS |
| | | EXISTING SANITARY SEWER |
| | | EXISTING WATER LINE |
| | | EXISTING STORM WATER SEWER |
| | | EXISTING GAS LINE |
| | | EXISTING FIBER OPTIC LINE |
| | | EXISTING FENCE |
| | | PROPERTY LINE |
| | | SETBACK LINE |
| | | EASEMENT LINE |
| | 8" SS | PROPOSED SANITARY SEWER |
| | 30" SWS | PROPOSED STORM WATER SEWER |
| | 8" W | PROPOSED WATER LINE |
| | DW | PROPOSED DOMESTIC WATER LINE |
| | FP | PROPOSED FIRE PROTECTION LINE |
| | R | PROPOSED RIDGE LINE |
| | > | PROPOSED FLOW LINE |
| | LOD | LIMITS OF DISTURBANCE |

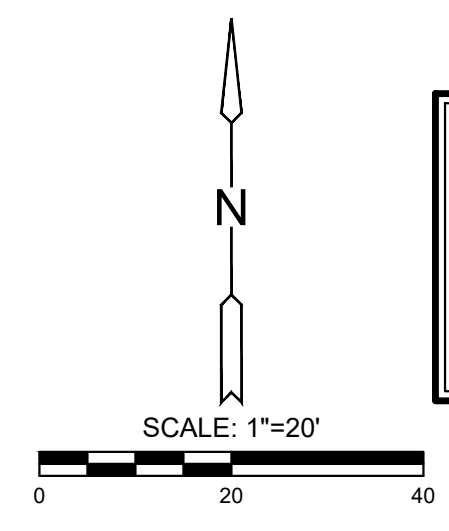

WARNING
EXISTING UNDERGROUND UTILITIES IN THE AREA. CONTRACTOR IS RESPONSIBLE FOR DETERMINING THE HORIZONTAL AND VERTICAL LOCATION OF ALL UTILITIES PRIOR TO CONSTRUCTION. CONTRACTOR IS RESPONSIBLE FOR ANY REPAIRS TO EXISTING UTILITIES DUE TO DAMAGE INCURRED DURING CONSTRUCTION. CONTRACTOR SHALL NOTIFY THE ENGINEER OF ANY DISCREPANCIES ON THE PLANS.

PLOTTED BY: BRYAN SMITH 4/22/2026 4:43 PM
 DWG PATH: J:\PROJECTS\2501010800\10800_GODDARD_RESERVE_AT_THE_MEADOWS\CAD\BHS\06_CIVIL\SITE
 DWG NAME: 2501010800_GODDARD_RESERVE_AT_THE_MEADOWS\CAD\BHS\06_CIVIL\SITE
 02/26/2026 MKEC ENGINEERING, INC. ALL RIGHTS RESERVED WWW.MKEC.COM THESE DRAWINGS AND THEIR CONTENTS, INCLUDING, BUT NOT LIMITED TO, ALL CONCEPTS, DESIGNS, & IDEAS ARE THE EXCLUSIVE PROPERTY OF MKEC ENGINEERING, INC. (MKEC) AND MAY NOT BE USED OR REPRODUCED IN ANY WAY WITHOUT THE EXPRESS CONSENT OF MKEC.





ENGINEER: SCOTT P. EVANS
P.E. NO. 24423 EXP. 04/30/26

NOTES

- ALL SPOT ELEVATIONS REPRESENT FINISHED SURFACE OR FLOW LINE GRADES, UNLESS OTHERWISE NOTED.
- ALL CURB SPOT ELEVATIONS ARE EDGE OF PAVEMENT UNLESS OTHERWISE NOTED.
- SPOT ELEVATIONS SHALL TAKE PRECEDENCE OVER SLOPE LABELS AT ALL TIMES.
- GRADES IN ALL SIDEWALK, ACCESSIBLE ROUTES, INCLUDING DRIVEWAYS CROSSINGS SHALL CONFORM TO ALL APPLICABLE ACCESSIBLE STANDARDS; NOT TO EXCEED 5% ALONG TRAVEL PATH WITH NOT MORE THAN 2% CROSS SLOPE AND NOT TO EXCEED 2% IN ANY DIRECTION IN ACCESSIBLE PARKING AREAS.
- MAXIMUM SLOPE IN TURF AREAS SHALL BE 4:1.
- SITE GRADING SHALL NOT CAUSE ADVERSE DRAINAGE IMPACTS TO NEIGHBORING PROPERTIES.
- REFER TO GEOTECHNICAL REPORT PREPARED FOR JGR ARCHITECTS, PREPARED BY PROFESSIONAL SERVICE INDUSTRIES, INC., PROJECT NO. 03362639 DATED NOVEMBER 21, 2025.
- SATISFACTORY SOIL AND FILL MATERIAL SHALL BE PROVIDED PER THE GEOTECHNICAL REPORT. SEE GEOTECHNICAL REPORT FOR MAXIMUM FILL LIFT THICKNESS.
- CLEAR AND GRUB IMPROVEMENT AREA. REMOVE ALL ORGANIC AND TOPSOIL MATERIAL REGARDLESS OF SIZE AND DEPTH. ALL CLEARED, EXCESS AND WASTE MATERIAL SHALL BECOME CONTRACTORS PROPERTY AND SHALL BE REMOVED FROM THE PROJECT SITE.
- THE CONTRACTOR SHALL BE RESPONSIBLE TO DETERMINE EARTHWORK QUANTITIES. ALL IMPORT AND EXPORT OF SOIL MATERIAL SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR AT THEIR EXPENSE.
- NOTIFY TESTING AGENCY WHEN EXCAVATIONS HAVE REACHED REQUIRED SUBGRADE. SUBGRADE SHALL BE PREPARED AND COMPACTED PER THE GEOTECHNICAL REPORT.
- THE THIRD-PARTY TESTING AGENCY SHALL PROVIDE RECORD OF TESTED FILL MATERIALS TO THE CONTRACTOR, OWNER, ARCHITECT, AND CIVIL ENGINEER. THESE REPORTS SHOULD PROVIDE FILL MATERIAL USED, MAX DRY DENSITY, FIELD TESTED DRY DENSITY, COMPACTION PERCENTAGE, MOISTURE CONTENT, LOCATION OF TEST, LIFT THICKNESS, AND LIFT ELEVATION RELATIVE TO BOTTOM OF PAVEMENT. IN ADDITION TO THESE FIELD TESTING REPORTS, THIRD-PARTY TESTING AGENCY SHALL PROVIDE STANDARD PROCTORS AND ATTERBERG LIMIT TESTING RESULTS TO THE ABOVE MENTIONED PARTIES.
- LANDSCAPING ITEMS INCLUDING FENCE PROTECTION ARE SHOWN ON THIS PLAN FOR VISUAL PURPOSES ONLY. REF. LANDSCAPING PLANS FOR ALL TREE PRESERVATION, PROTECTION AND REMOVAL DESIGN ITEMS.

LEGEND

- | | | | |
|--|----------------------|--|----------------------------------|
| | SPOT ELEVATION | | MATCH EXISTING |
| | TOP OF CURB | | HIGH POINT |
| | TOP OF RIM/STRUCTURE | | FINISHED GRADE AT TOP OF WALL |
| | FLOWLINE | | FINISHED GRADE AT BOTTOM OF WALL |
| | ADJACENT GRADE | | |
-
- | | | |
|--|---------|-------------------------------|
| | 1456 | PROPOSED CONTOURS |
| | 1456 | EXISTING CONTOURS |
| | | EXISTING SANITARY SEWER |
| | | EXISTING WATER LINE |
| | | EXISTING STORM WATER SEWER |
| | | EXISTING GAS LINE |
| | | EXISTING FIBER OPTIC LINE |
| | | EXISTING FENCE |
| | | PROPERTY LINE |
| | | SETBACK LINE |
| | | EASEMENT LINE |
| | 8" SS | PROPOSED SANITARY SEWER |
| | 30" SWS | PROPOSED STORM WATER SEWER |
| | 8" W | PROPOSED WATER LINE |
| | DW | PROPOSED DOMESTIC WATER LINE |
| | FP | PROPOSED FIRE PROTECTION LINE |
| | R | PROPOSED RIDGE LINE |
| | > | PROPOSED FLOW LINE |
| | LOD | LIMITS OF DISTURBANCE |

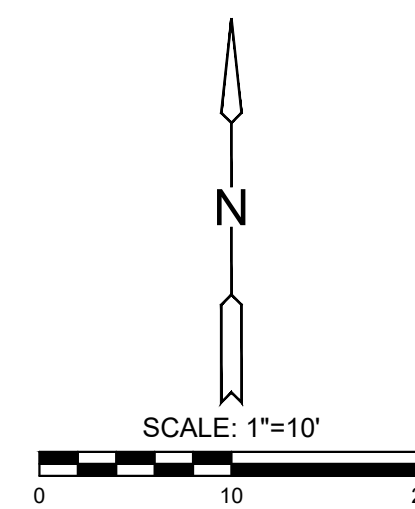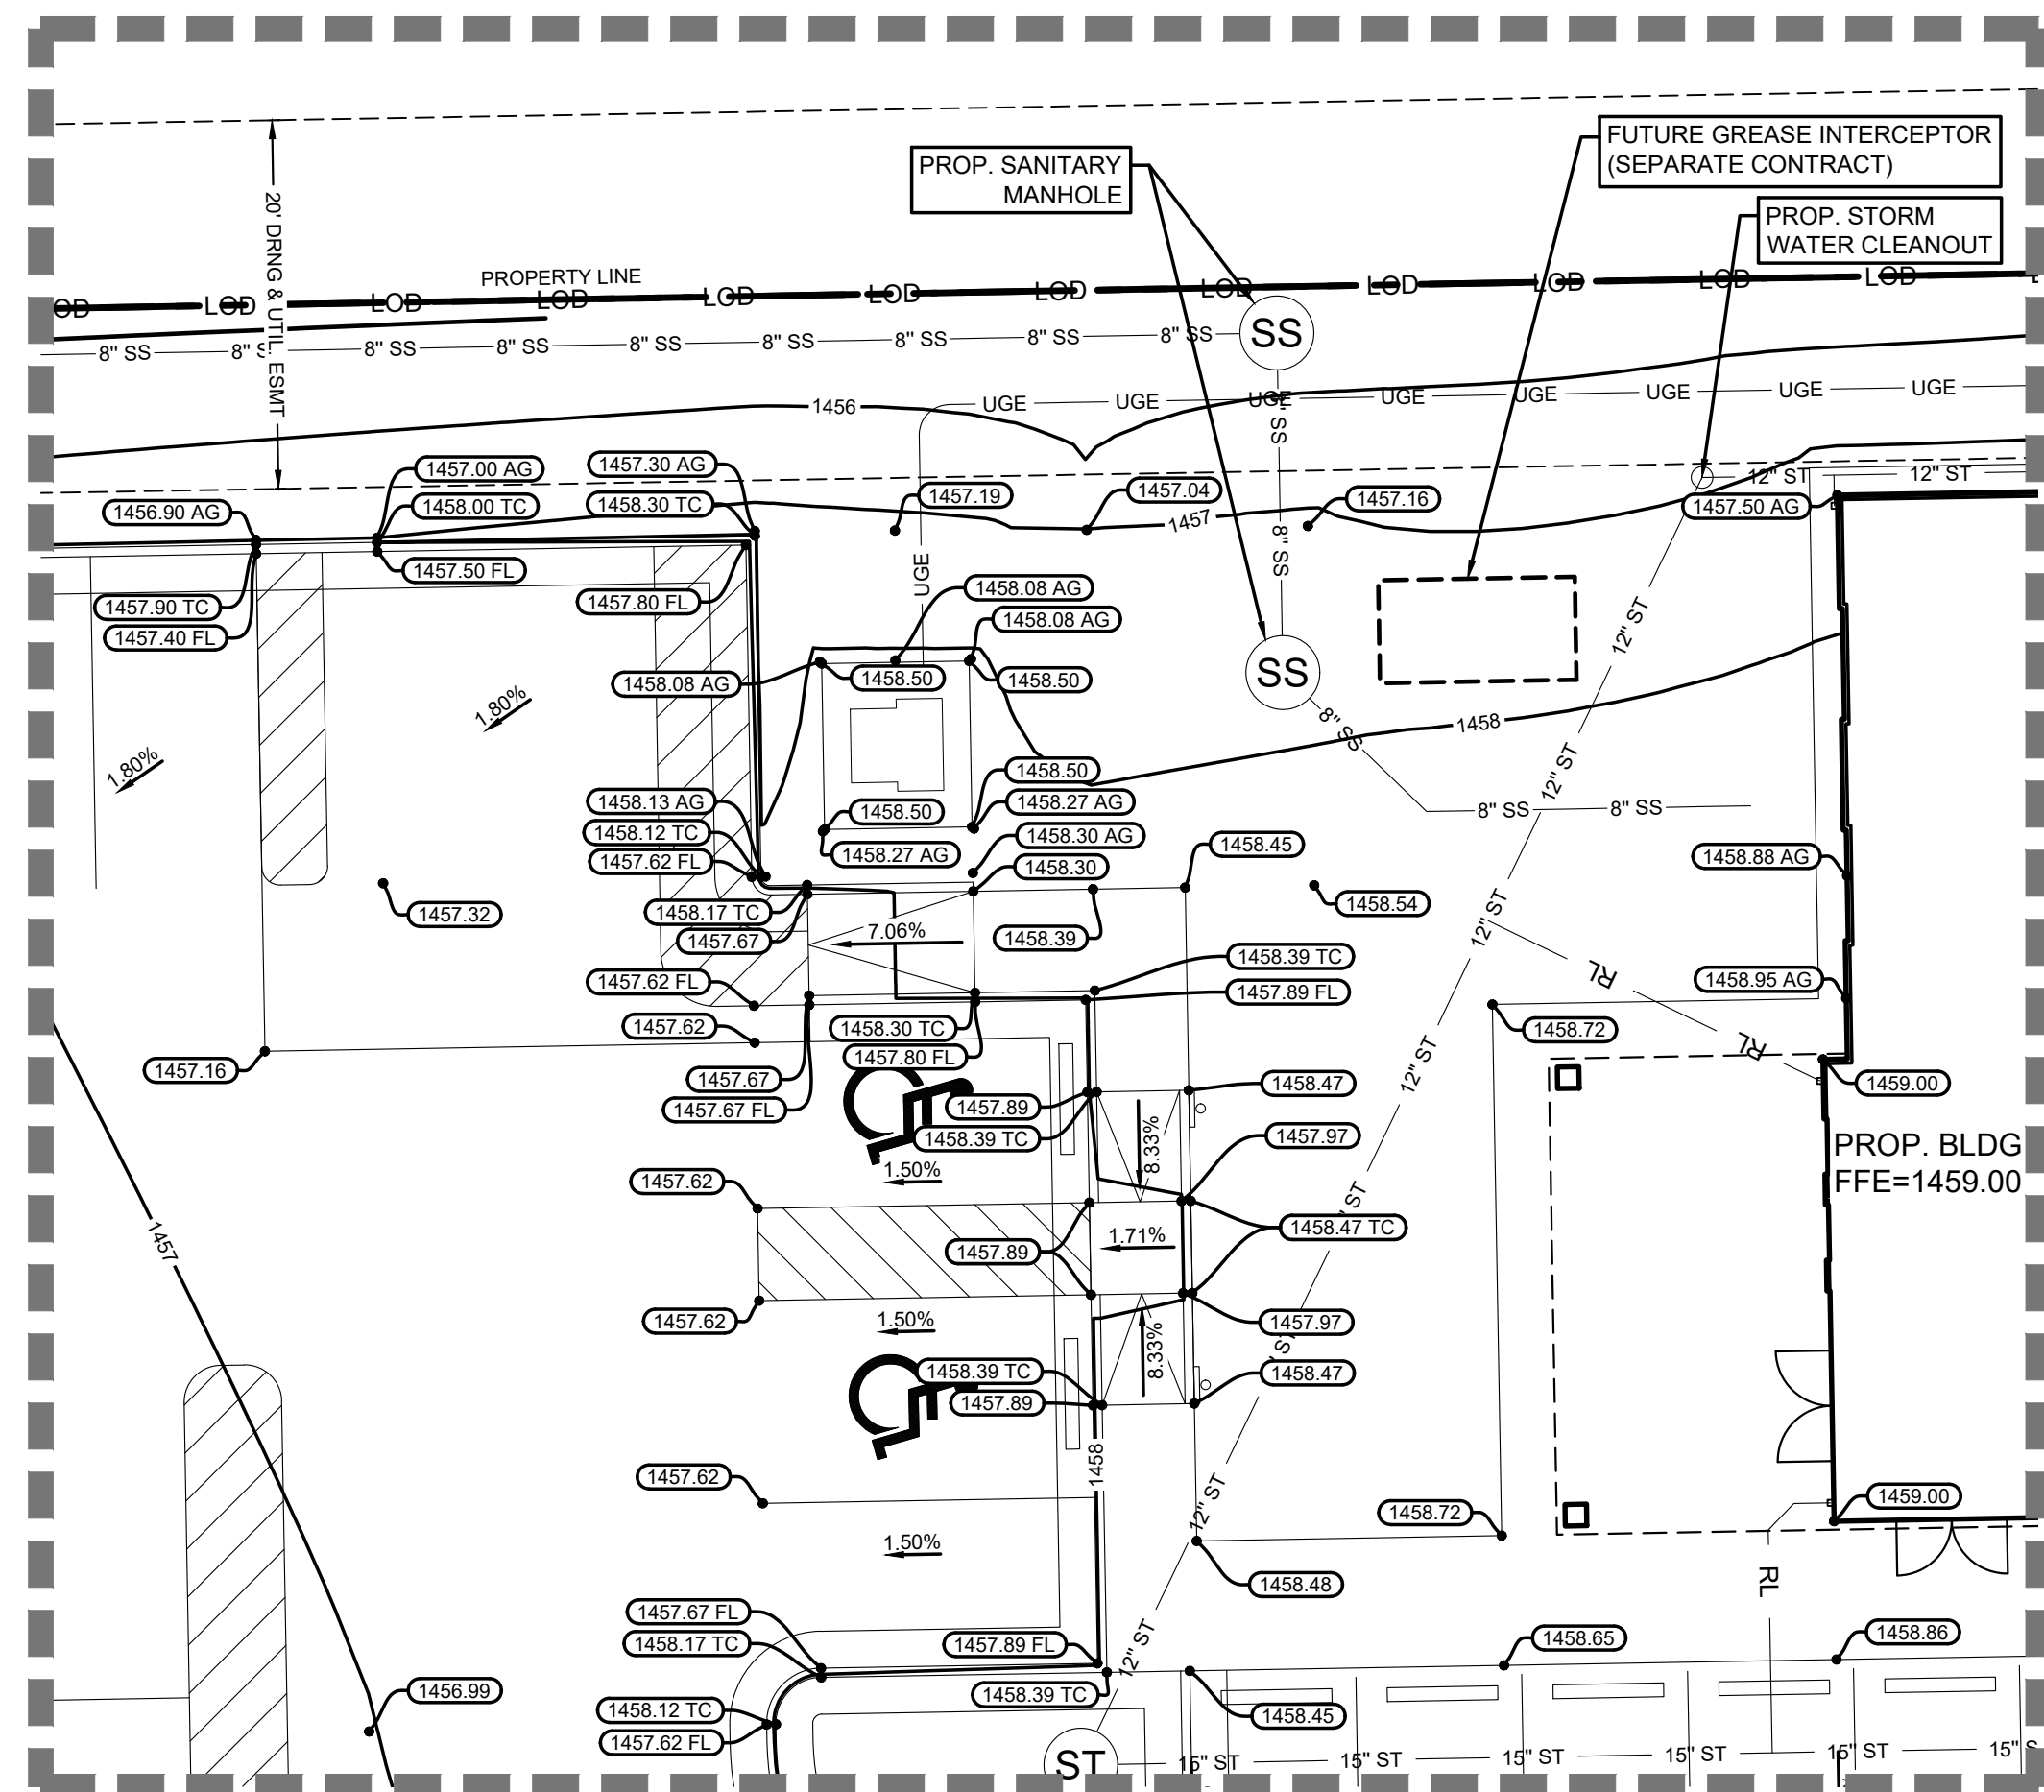

WARNING
EXISTING UNDERGROUND UTILITIES IN THE AREA. CONTRACTOR IS RESPONSIBLE FOR DETERMINING THE HORIZONTAL AND VERTICAL LOCATION OF ALL UTILITIES PRIOR TO CONSTRUCTION. CONTRACTOR IS RESPONSIBLE FOR ANY REPAIRS TO EXISTING UTILITIES DUE TO DAMAGE INCURRED DURING CONSTRUCTION. CONTRACTOR SHALL NOTIFY THE ENGINEER OF ANY DISCREPANCIES ON THE PLANS.

CIVIL PLANS FOR
THE RESERVE AT THE MEADOWS
GODDARD, KS

ENLARGED GRADING PLAN


PROJECT NO. 2501010800
SCALE 1"=10'
DRAWN DESIGNED CHECKED
BKS TMBB SPE

NO.	REVISION	DATE
0	ISSUED FOR PERMIT	04/03/26

SHEET NO. C-304

PLOTTED BY: BRYAN SMITH 4/2/2026 4:44 PM
DWG PATH: J:\PROJECTS\2501010800_GODDARD\THE RESERVE AT THE MEADOWS\100 CAD\B1506 CIVILISTE
DWG NAME: 2501010800 GRADING ENLARGED.DWG
©2026 MKEC ENGINEERING, INC. ALL RIGHTS RESERVED WWW.MKEC.COM THESE DRAWINGS AND THEIR CONTENTS, INCLUDING, BUT NOT LIMITED TO, ALL CONCEPTS, DESIGNS, & IDEAS ARE THE EXCLUSIVE PROPERTY OF MKEC ENGINEERING, INC. (MKEC) AND MAY NOT BE USED OR REPRODUCED IN ANY WAY WITHOUT THE EXPRESS CONSENT OF MKEC.


NO.	REVISION	DATE
0	ISSUED FOR PERMIT	04/03/26

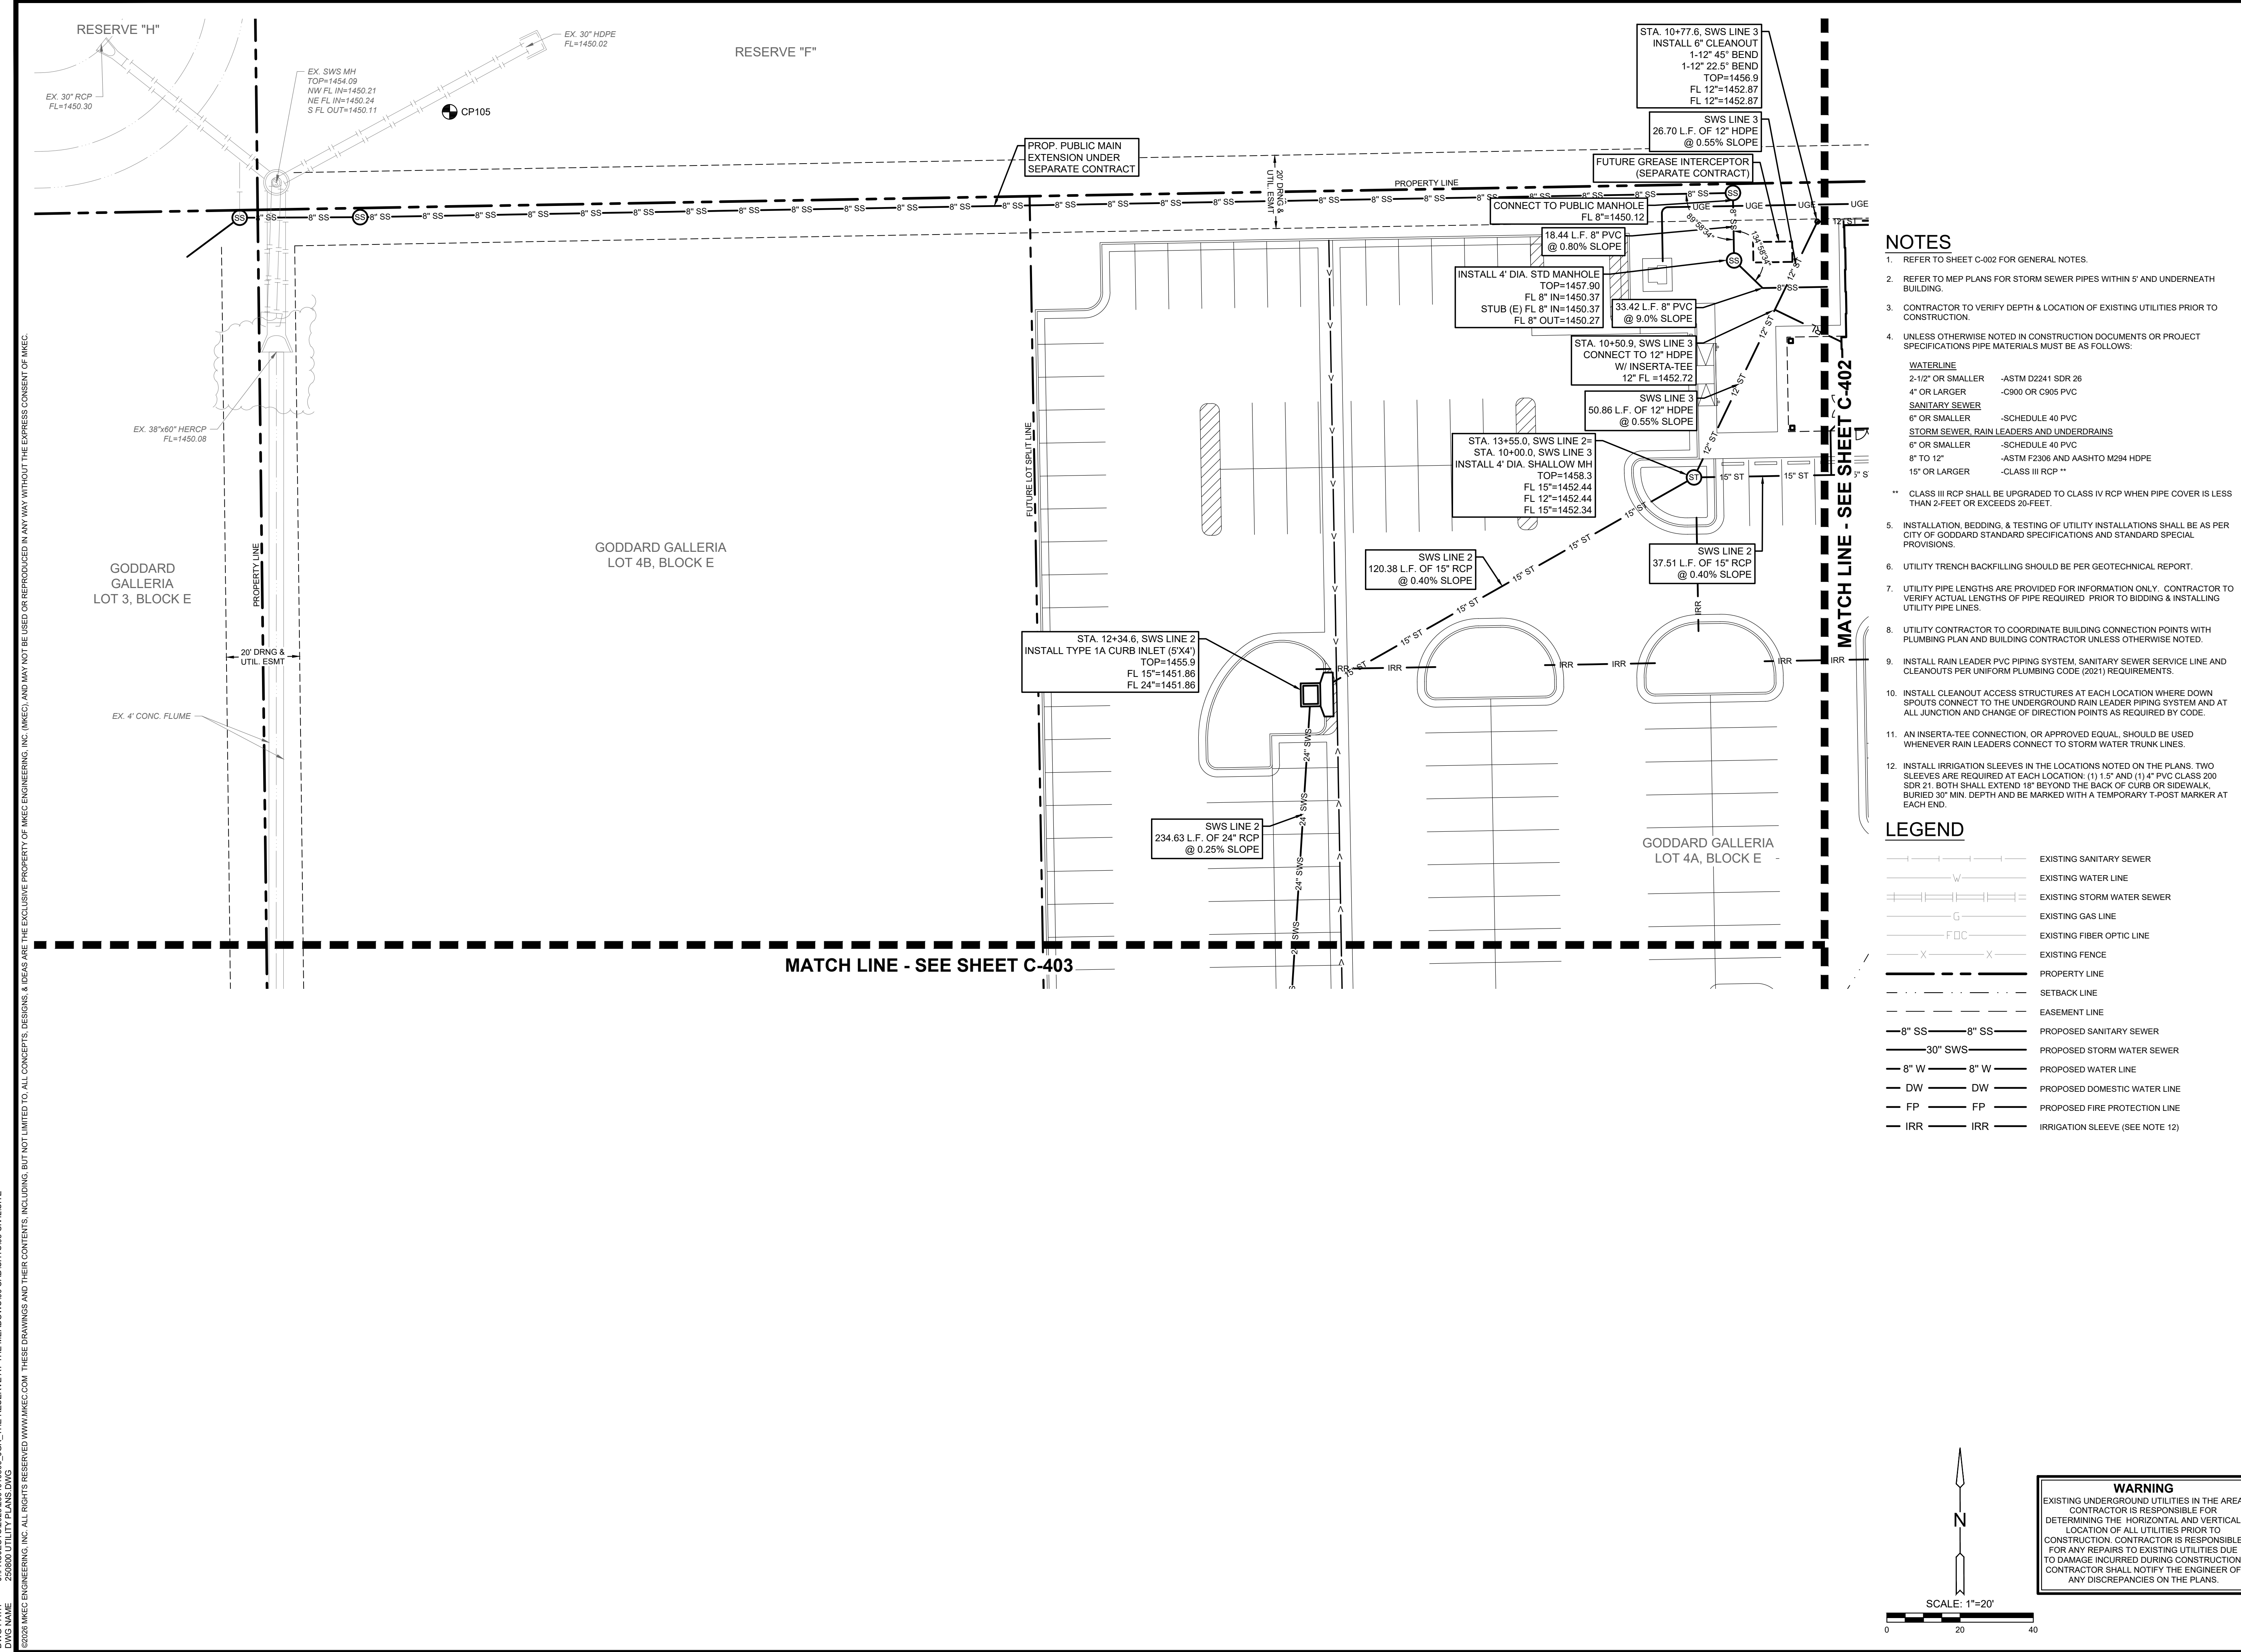

- NOTES**
- REFER TO SHEET C-002 FOR GENERAL NOTES.
 - REFER TO MEP PLANS FOR STORM SEWER PIPES WITHIN 5' AND UNDERNEATH BUILDINGS.
 - CONTRACTOR TO VERIFY DEPTH & LOCATION OF EXISTING UTILITIES PRIOR TO CONSTRUCTION.
 - UNLESS OTHERWISE NOTED IN CONSTRUCTION DOCUMENTS OR PROJECT SPECIFICATIONS PIPE MATERIALS MUST BE AS FOLLOWS:
 - WATERLINE**
 - 2-1/2" OR SMALLER -ASTM D2241 SDR 26
 - 4" OR LARGER -C900 OR C905 PVC
 - SANITARY SEWER**
 - 6" OR SMALLER -SCHEDULE 40 PVC
 - 8" OR LARGER -SCHEDULE 40 PVC
 - 8" TO 12" -ASTM F2306 AND AASHTO M294 HDPE
 - 15" OR LARGER -CLASS III RCP **
- ** CLASS III RCP SHALL BE UPGRADED TO CLASS IV RCP WHEN PIPE COVER IS LESS THAN 2-FEET OR EXCEEDS 20-FEET.
- INSTALLATION, BEDDING, & TESTING OF UTILITY INSTALLATIONS SHALL BE AS PER CITY OF GODDARD STANDARD SPECIFICATIONS AND STANDARD SPECIAL PROVISIONS.
 - UTILITY TRENCH BACKFILLING SHOULD BE PER GEOTECHNICAL REPORT.
 - UTILITY PIPE LENGTHS ARE PROVIDED FOR INFORMATION ONLY. CONTRACTOR TO VERIFY ACTUAL LENGTHS OF PIPE REQUIRED PRIOR TO BIDDING & INSTALLING UTILITY PIPE LINES.
 - UTILITY CONTRACTOR TO COORDINATE BUILDING CONNECTION POINTS WITH PLUMBING PLAN AND BUILDING CONTRACTOR UNLESS OTHERWISE NOTED.
 - INSTALL RAIN LEADER PVC PIPING SYSTEM. SANITARY SEWER SERVICE LINE AND CLEANOUTS PER UNIFORM PLUMBING CODE (2021) REQUIREMENTS.
 - INSTALL CLEANOUT ACCESS STRUCTURES AT EACH LOCATION WHERE DOWN SPOUTS CONNECT TO THE UNDERGROUND RAIN LEADER PIPING SYSTEM AND AT ALL JUNCTION AND CHANGE OF DIRECTION POINTS AS REQUIRED BY CODE.
 - AN INSERTA-TEE CONNECTION, OR APPROVED EQUAL, SHOULD BE USED WHENEVER RAIN LEADERS CONNECT TO STORM WATER TRUNK LINES.
 - INSTALL IRRIGATION SLEEVES IN THE LOCATIONS NOTED ON THE PLANS. TWO SLEEVES ARE REQUIRED AT EACH LOCATION: (1) 1.5" AND (1) 4" PVC CLASS 200 SDR 21. BOTH SHALL EXTEND 18" BEYOND THE BACK OF CURB OR SIDEWALK, BURIED 30" MIN. DEPTH AND BE MARKED WITH A TEMPORARY T-POST MARKER AT EACH END.

LEGEND


	EXISTING SANITARY SEWER
	EXISTING WATER LINE
	EXISTING STORM WATER SEWER
	EXISTING GAS LINE
	EXISTING FIBER OPTIC LINE
	EXISTING FENCE
	PROPERTY LINE
	SETBACK LINE
	EASEMENT LINE
	PROPOSED SANITARY SEWER
	PROPOSED STORM WATER SEWER
	PROPOSED WATER LINE
	PROPOSED DOMESTIC WATER LINE
	PROPOSED FIRE PROTECTION LINE
	IRRIGATION SLEEVE (SEE NOTE 12)

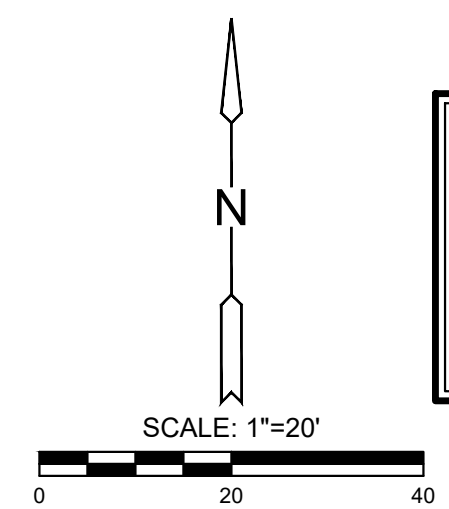

WARNING
EXISTING UNDERGROUND UTILITIES IN THE AREA. CONTRACTOR IS RESPONSIBLE FOR DETERMINING THE HORIZONTAL AND VERTICAL LOCATION OF ALL UTILITIES PRIOR TO CONSTRUCTION. CONTRACTOR IS RESPONSIBLE FOR ANY REPAIRS TO EXISTING UTILITIES DUE TO DAMAGE INCURRED DURING CONSTRUCTION. CONTRACTOR SHALL NOTIFY THE ENGINEER OF ANY DISCREPANCIES ON THE PLANS.

PLOTTED BY: BRYAN SMITH 4/22/2026 4:44 PM
 DWG PATH: J:\PROJECTS\2501010800\010800_IGR_THE RESERVE AT THE MEADOWS\010800_CIVILISTE
 DWG NAME: 2501010800 UTILITY PLANS.DWG
 ©2026 MKEC ENGINEERING, INC. ALL RIGHTS RESERVED WWW.MKEC.COM THESE DRAWINGS AND THEIR CONTENTS, INCLUDING, BUT NOT LIMITED TO, ALL CONCEPTS, DESIGNS, & IDEAS ARE THE EXCLUSIVE PROPERTY OF MKEC ENGINEERING, INC. (MKEC) AND MAY NOT BE USED OR REPRODUCED IN ANY WAY WITHOUT THE EXPRESS CONSENT OF MKEC.

NO.	ISSUED FOR PERMIT	DATE
0	ISSUED FOR PERMIT	04/03/26

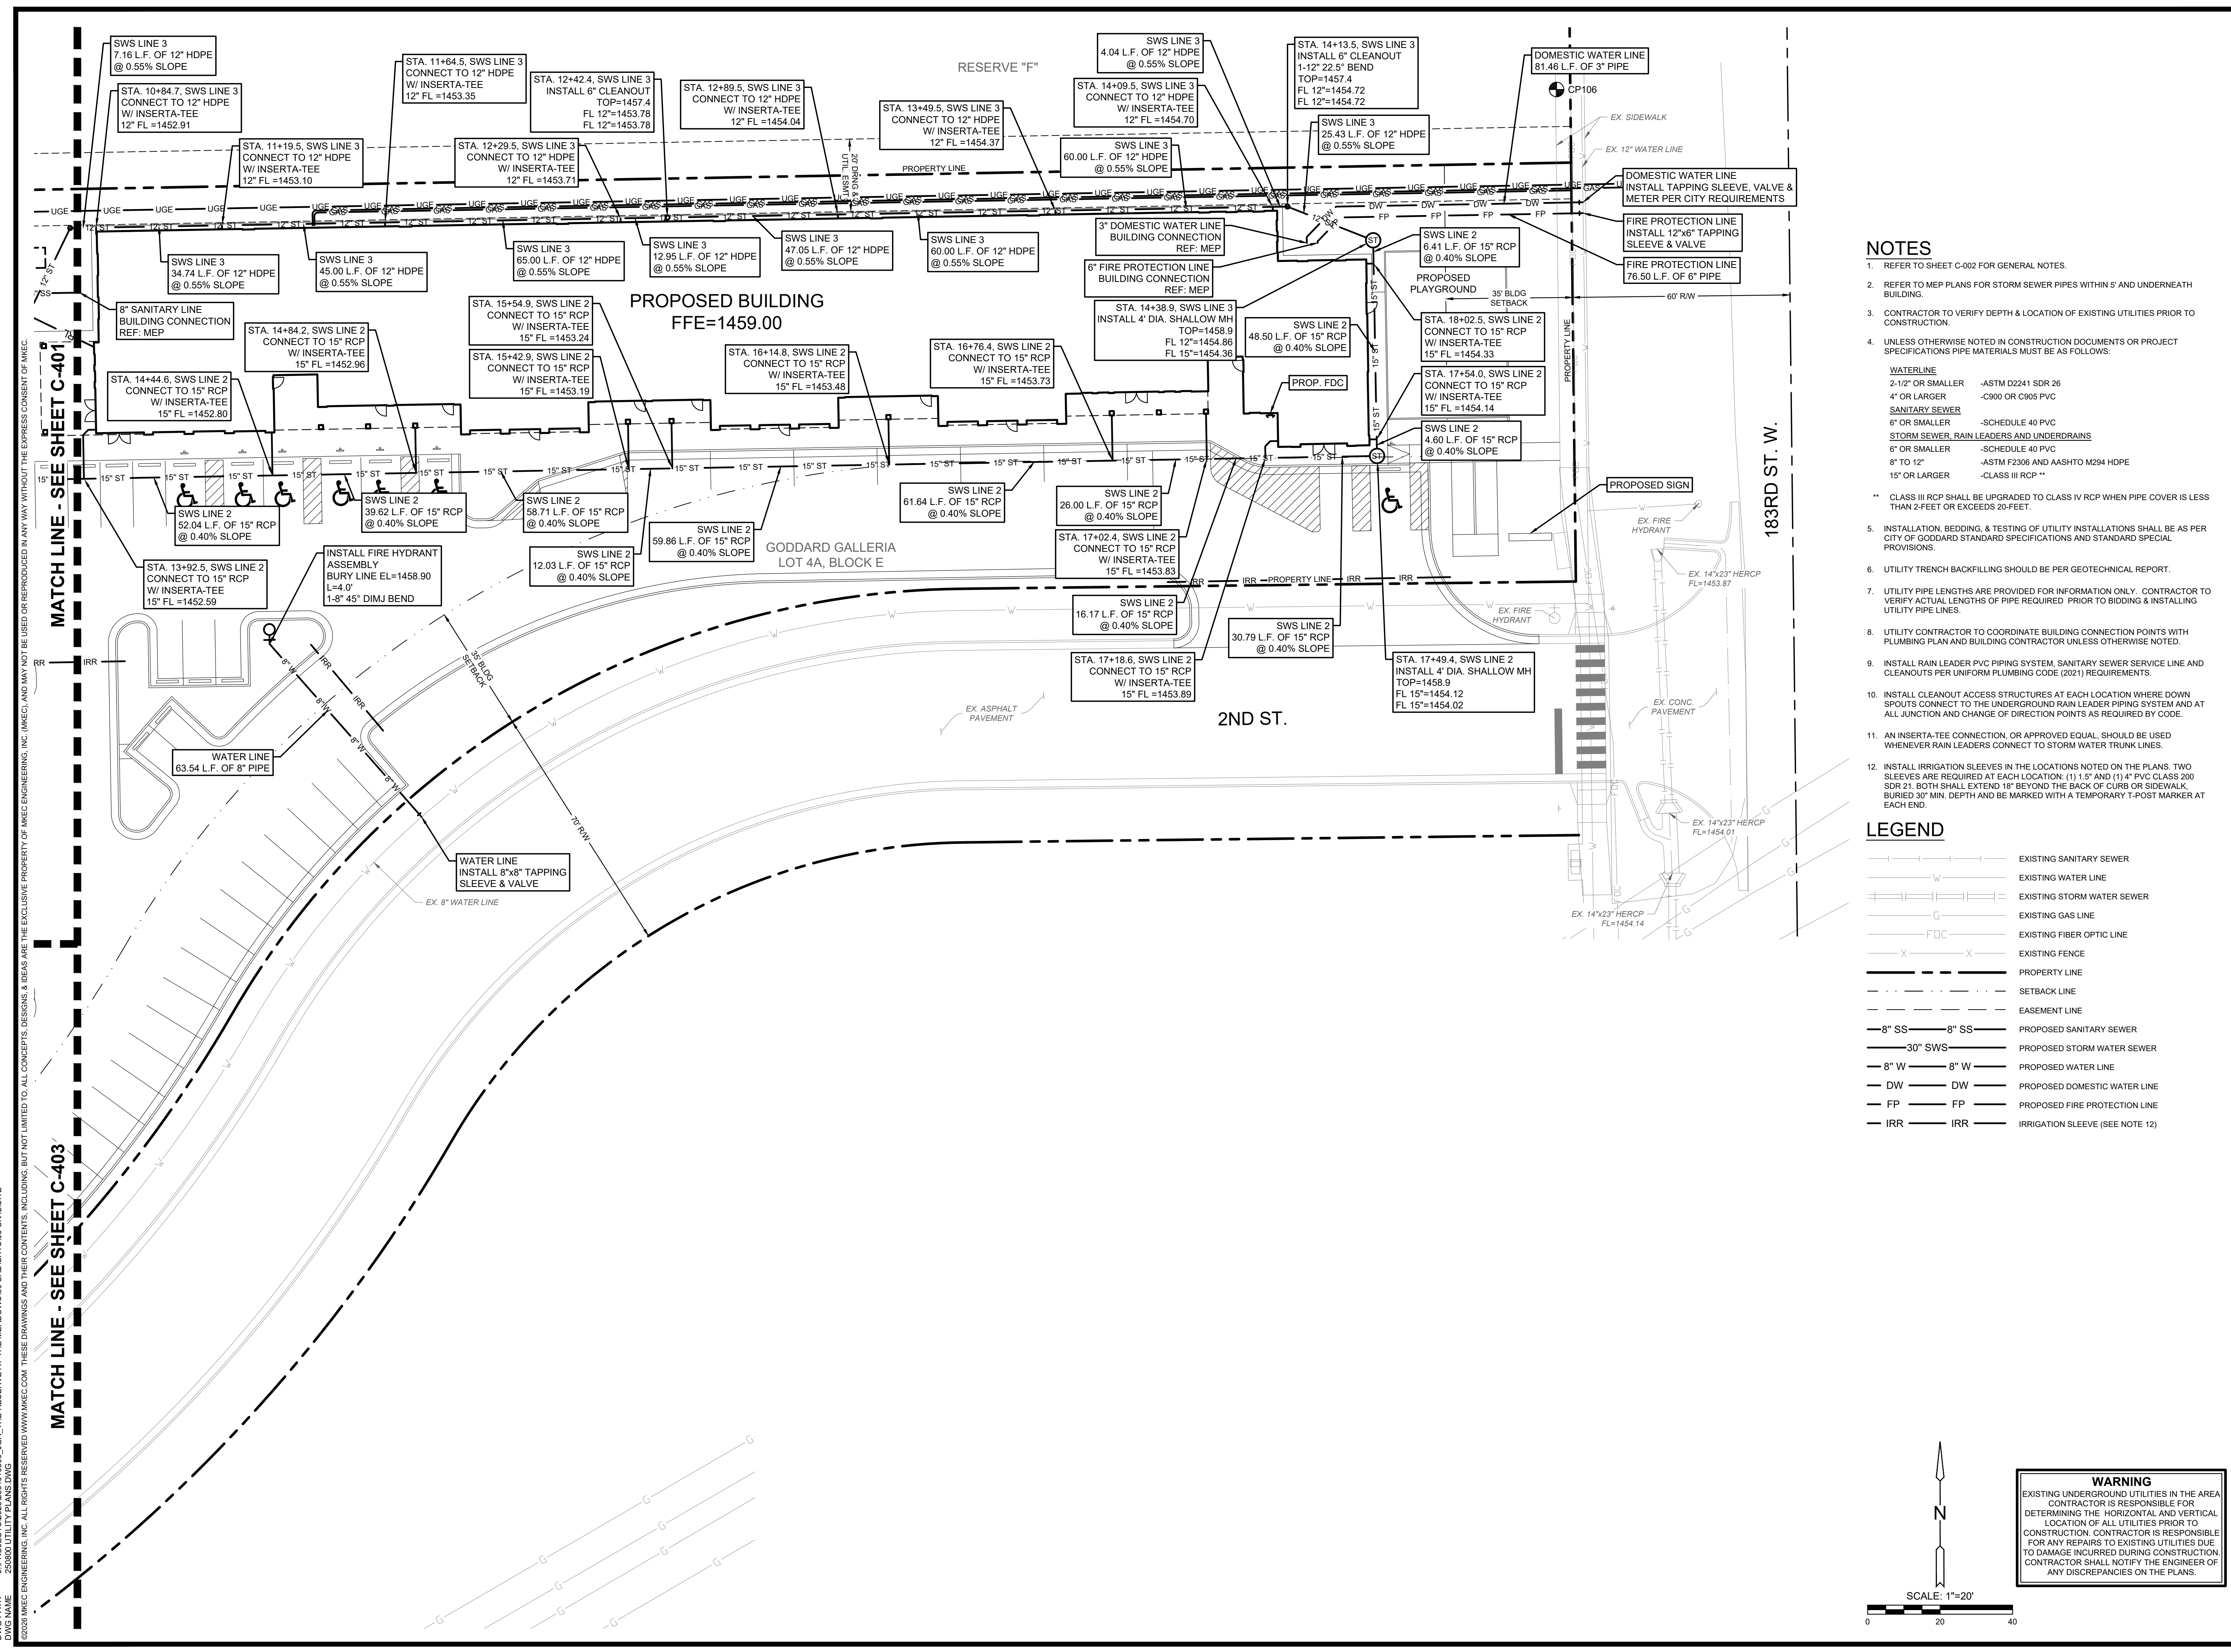

NOTES

- REFER TO SHEET C-002 FOR GENERAL NOTES.
- REFER TO MEP PLANS FOR STORM SEWER PIPES WITHIN 5' AND UNDERNEATH BUILDINGS.
- CONTRACTOR TO VERIFY DEPTH & LOCATION OF EXISTING UTILITIES PRIOR TO CONSTRUCTION.
- UNLESS OTHERWISE NOTED IN CONSTRUCTION DOCUMENTS OR PROJECT SPECIFICATIONS PIPE MATERIALS SHALL BE AS FOLLOWS:

WATERLINE	
2-1/2" OR SMALLER	-ASTM D2241 SDR 26
4" OR LARGER	-8000 OR C905 PVC

SANITARY SEWER	
6" OR SMALLER	-SCHEDULE 40 PVC
STORM SEWER, RAIN LEADERS AND UNDERDRAINS	
6" OR SMALLER	-SCHEDULE 40 PVC
8" TO 12"	-ASTM F2306 AND AASHTO M294 HDPE
15" OR LARGER	-CLASS III RCP **

** CLASS III RCP SHALL BE UPGRADED TO CLASS IV RCP WHEN PIPE COVER IS LESS THAN 2-FEET OR EXCEEDS 20-FEET.
- INSTALLATION, BEDDING, & TESTING OF UTILITY INSTALLATIONS SHALL BE AS PER CITY OF GODDARD STANDARD SPECIFICATIONS AND STANDARD SPECIAL PROVISIONS.
- UTILITY TRENCH BACKFILLING SHOULD BE PER GEOTECHNICAL REPORT.
- UTILITY PIPE LENGTHS ARE PROVIDED FOR INFORMATION ONLY. CONTRACTOR TO VERIFY ACTUAL LENGTHS OF PIPE REQUIRED PRIOR TO BIDDING & INSTALLING UTILITY PIPE LINES.
- UTILITY CONTRACTOR TO COORDINATE BUILDING CONNECTION POINTS WITH PLUMBING PLAN AND BUILDING CONTRACTOR UNLESS OTHERWISE NOTED.
- INSTALL RAIN LEADER PVC PIPING SYSTEM. SANITARY SEWER SERVICE LINE AND CLEANOUTS PER UNIFORM PLUMBING CODE (2021) REQUIREMENTS.
- INSTALL CLEANOUT ACCESS STRUCTURES AT EACH LOCATION WHERE DOWN SPOUTS CONNECT TO THE UNDERGROUND RAIN LEADER PIPING SYSTEM AND AT ALL JUNCTION AND CHANGE OF DIRECTION POINTS AS REQUIRED BY CODE.
- AN INSERTA-TEE CONNECTION, OR APPROVED EQUAL, SHOULD BE USED WHENEVER RAIN LEADERS CONNECT TO STORM WATER TRUNK LINES.
- INSTALL IRRIGATION SLEEVES IN THE LOCATIONS NOTED ON THE PLANS. TWO SLEEVES ARE REQUIRED AT EACH LOCATION: (1) 1.5" AND (1) 4" PVC CLASS 200 SDR 21. BOTH SHALL EXTEND 18" BEYOND THE BACK OF CURB OR SIDEWALK, BURIED 30" MIN. DEPTH AND BE MARKED WITH A TEMPORARY T-POST MARKER AT EACH END.

LEGEND


	EXISTING SANITARY SEWER
	EXISTING WATER LINE
	EXISTING STORM WATER SEWER
	EXISTING GAS LINE
	EXISTING FIBER OPTIC LINE
	EXISTING FENCE
	PROPERTY LINE
	SETBACK LINE
	EASEMENT LINE
	PROPOSED SANITARY SEWER
	PROPOSED STORM WATER SEWER
	PROPOSED WATER LINE
	PROPOSED DOMESTIC WATER LINE
	PROPOSED FIRE PROTECTION LINE
	IRRIGATION SLEEVE (SEE NOTE 12)

WARNING
EXISTING UNDERGROUND UTILITIES IN THE AREA. CONTRACTOR IS RESPONSIBLE FOR DETERMINING THE HORIZONTAL AND VERTICAL LOCATION OF ALL UTILITIES PRIOR TO CONSTRUCTION. CONTRACTOR IS RESPONSIBLE FOR ANY REPAIRS TO EXISTING UTILITIES DUE TO DAMAGE INCURRED DURING CONSTRUCTION. CONTRACTOR SHALL NOTIFY THE ENGINEER OF ANY DISCREPANCIES ON THE PLANS.



PLOTTED BY: BRYAN SMITH 4/22/2026 4:44 PM
DWG PATH: J:\PROJECTS\2501010800\010800_IGR_THE RESERVE AT THE MEADOWS\010800_CAD\BHS\010800_CIVIL\LISTE
DWG NAME: 2501010800 UTILITY PLANS.DWG
©2026 MKEC ENGINEERING, INC. ALL RIGHTS RESERVED WWW.MKEC.COM THESE DRAWINGS AND THEIR CONTENTS, INCLUDING, BUT NOT LIMITED TO, ALL CONCEPTS, DESIGNS, & IDEAS ARE THE EXCLUSIVE PROPERTY OF MKEC ENGINEERING, INC. (MKEC) AND MAY NOT BE USED OR REPRODUCED IN ANY WAY WITHOUT THE EXPRESS CONSENT OF MKEC.

NO.	REVISION	DATE
0	ISSUED FOR PERMIT	04/03/26

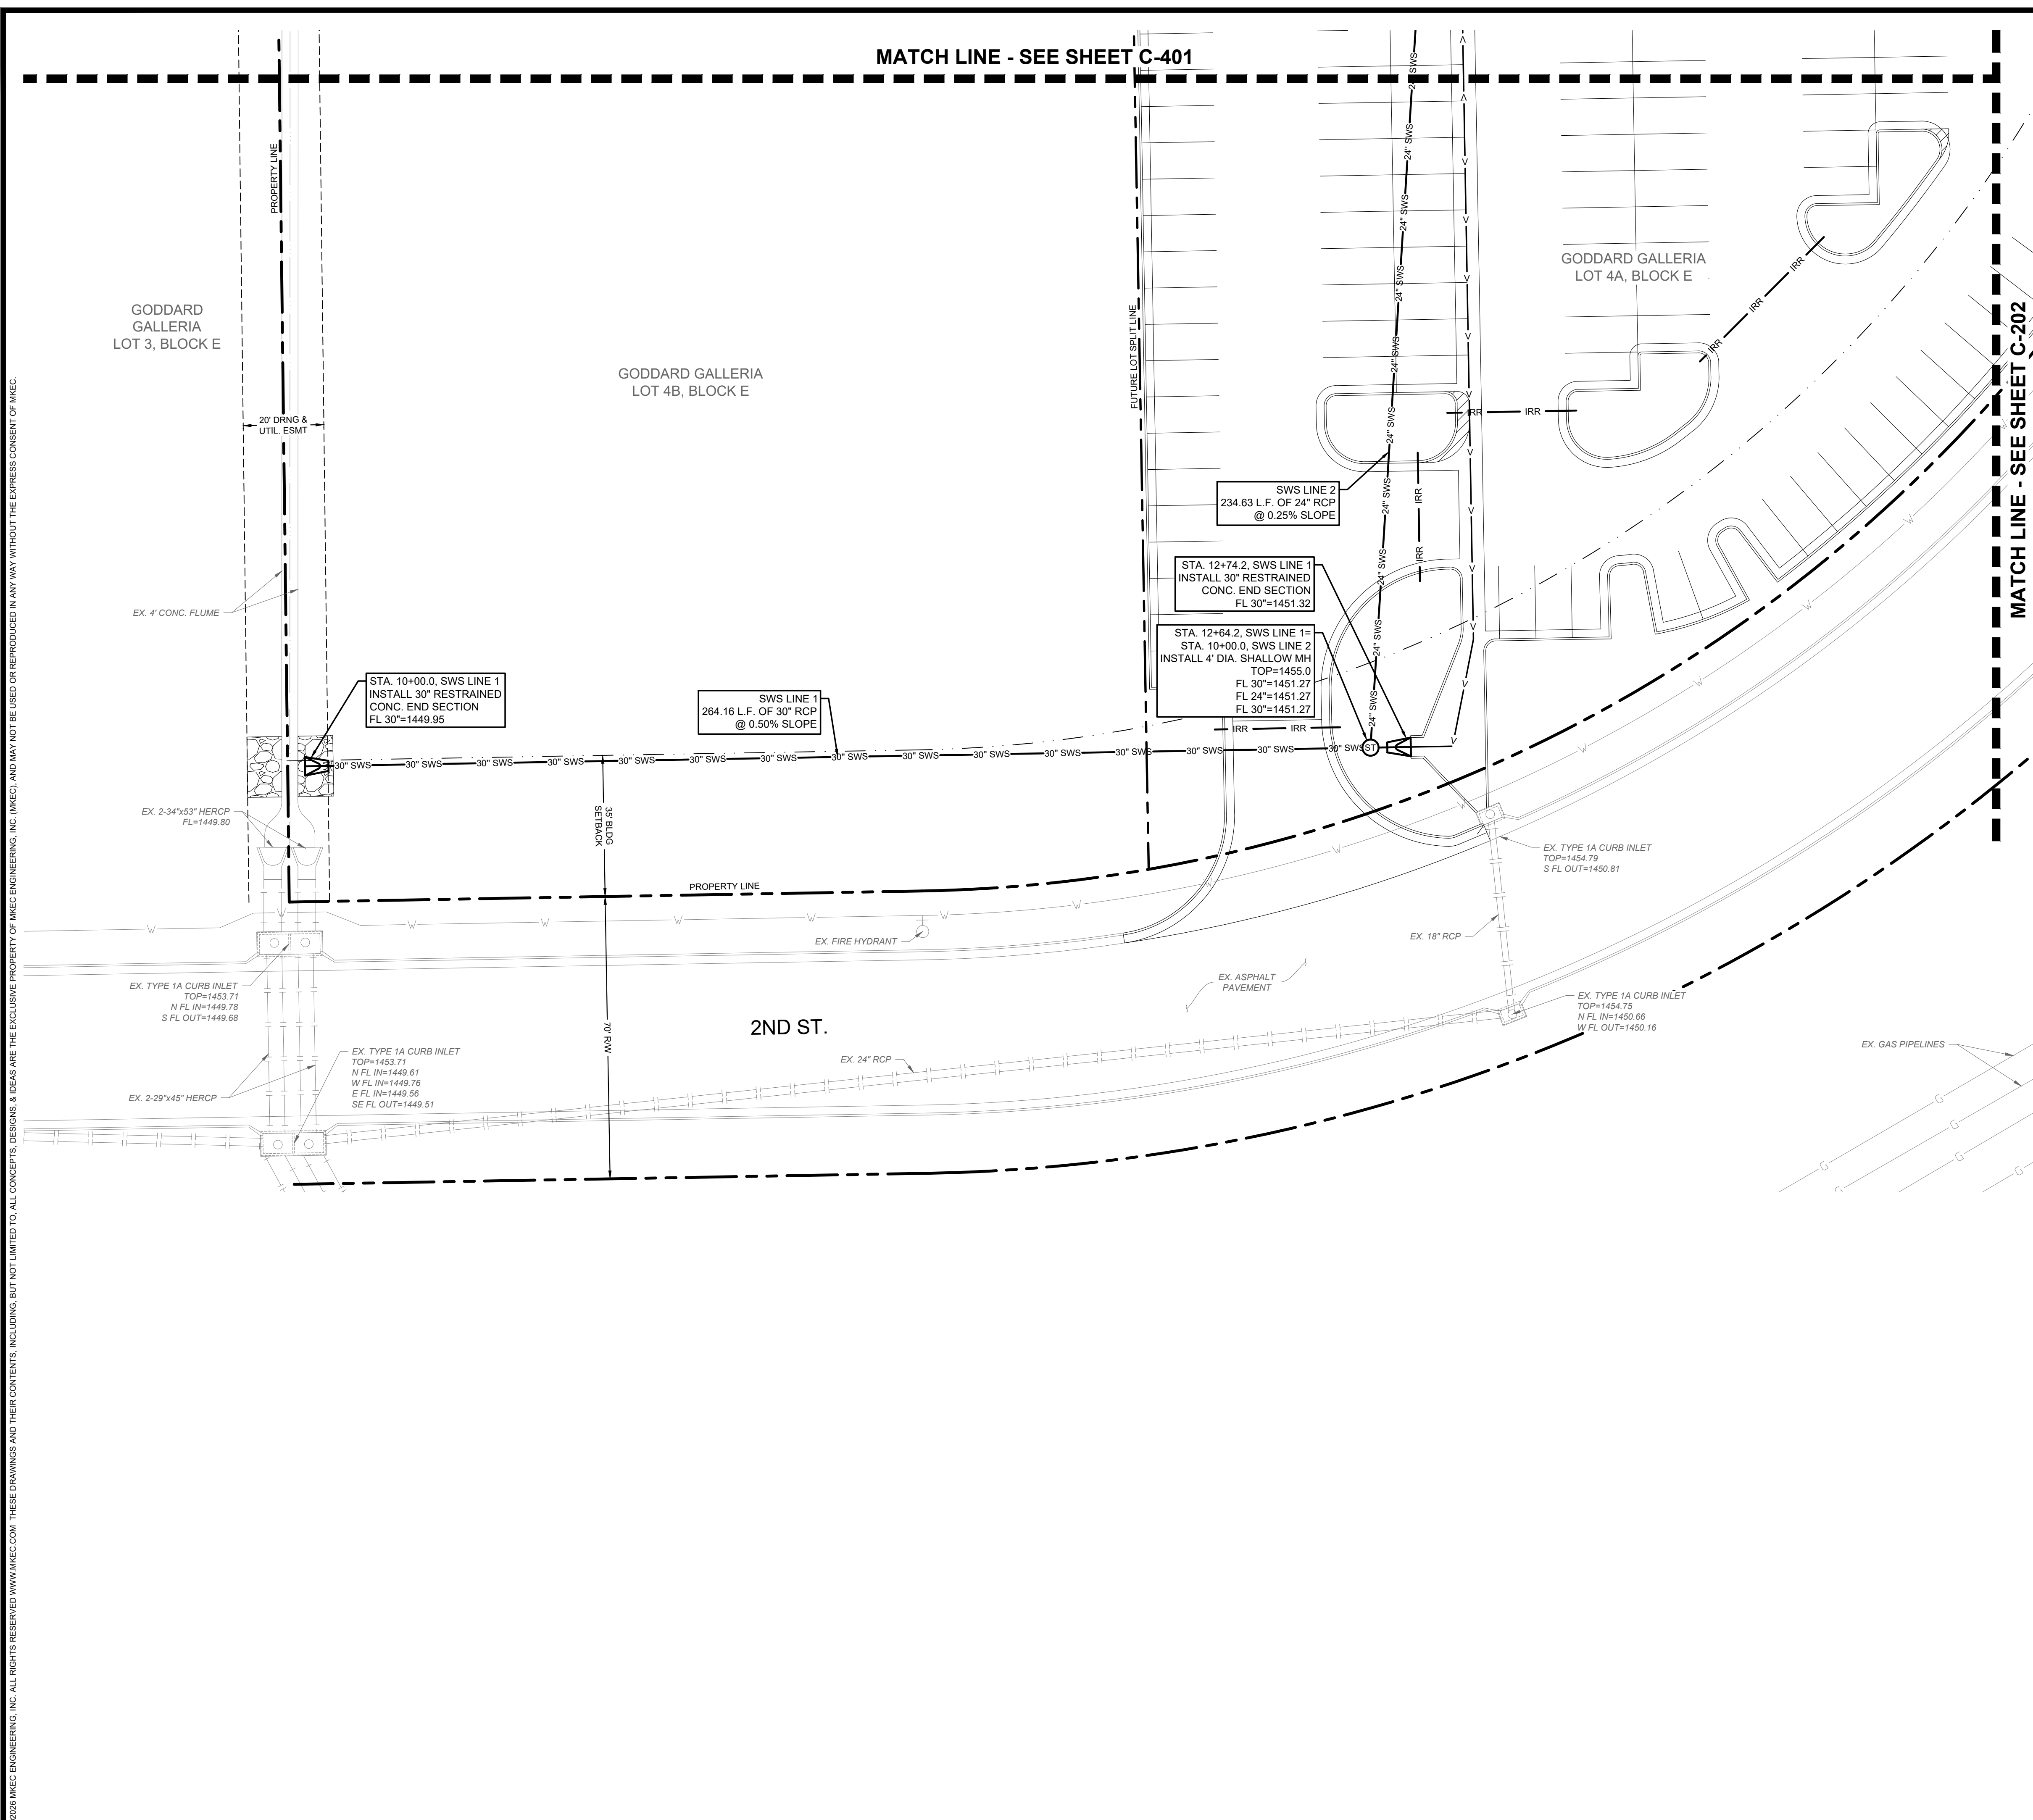


- NOTES**
- REFER TO SHEET C-002 FOR GENERAL NOTES.
 - REFER TO MEP PLANS FOR STORM SEWER PIPES WITHIN 5' AND UNDERNEATH BUILDINGS.
 - CONTRACTOR TO VERIFY DEPTH & LOCATION OF EXISTING UTILITIES PRIOR TO CONSTRUCTION.
 - UNLESS OTHERWISE NOTED IN CONSTRUCTION DOCUMENTS OR PROJECT SPECIFICATIONS PIPE MATERIALS MUST BE AS FOLLOWS:

WATERLINE	2-1/2" OR SMALLER -ASTM D2241 SDR 26
	4" OR LARGER -C900 OR C905 PVC
SANITARY SEWER	6" OR SMALLER -SCHEDULE 40 PVC
STORM SEWER, RAIN LEADERS AND UNDERDRAINS	6" OR SMALLER -SCHEDULE 40 PVC
	8" TO 12" -ASTM F2306 AND AASHTO M294 HDPE
	15" OR LARGER -CLASS III RCP **
 - CLASS III RCP SHALL BE UPGRADED TO CLASS IV RCP WHEN PIPE COVER IS LESS THAN 2-FEET OR EXCEEDS 20-FEET.
 - INSTALLATION, BEDDING, & TESTING OF UTILITY INSTALLATIONS SHALL BE AS PER CITY OF GODDARD STANDARD SPECIFICATIONS AND STANDARD SPECIAL PROVISIONS.
 - UTILITY TRENCH BACKFILLING SHOULD BE PER GEOTECHNICAL REPORT.
 - UTILITY PIPE LENGTHS ARE PROVIDED FOR INFORMATION ONLY. CONTRACTOR TO VERIFY ACTUAL LENGTHS OF PIPE REQUIRED PRIOR TO BIDDING & INSTALLING UTILITY PIPE LINES.
 - UTILITY CONTRACTOR TO COORDINATE BUILDING CONNECTION POINTS WITH PLUMBING PLAN AND BUILDING CONTRACTOR UNLESS OTHERWISE NOTED.
 - INSTALL RAIN LEADER PVC PIPING SYSTEM. SANITARY SEWER SERVICE LINE AND CLEANOUTS PER UNIFORM PLUMBING CODE (2021) REQUIREMENTS.
 - INSTALL CLEANOUT ACCESS STRUCTURES AT EACH LOCATION WHERE DOWN SPOUTS CONNECT TO THE UNDERGROUND RAIN LEADER PIPING SYSTEM AND AT ALL JUNCTION AND CHANGE OF DIRECTION POINTS AS REQUIRED BY CODE.
 - AN INSERT-A-TEE CONNECTION, OR APPROVED EQUAL, SHOULD BE USED WHENEVER RAIN LEADERS CONNECT TO STORM WATER TRUNK LINES.
 - INSTALL IRRIGATION SLEEVES IN THE LOCATIONS NOTED ON THE PLANS. TWO SLEEVES ARE REQUIRED AT EACH LOCATION: (1) 1.5" AND (1) 4" PVC CLASS 200 SDR 21. BOTH SHALL EXTEND 18" BEYOND THE BACK OF CURB OR SIDEWALK, BURIED 30" MIN. DEPTH AND BE MARKED WITH A TEMPORARY T-POST MARKER AT EACH END.


- LEGEND**
- — — — — EXISTING SANITARY SEWER
 - — — — — EXISTING WATER LINE
 - — — — — EXISTING STORM WATER SEWER
 - — — — — EXISTING GAS LINE
 - — — — — EXISTING FIBER OPTIC LINE
 - — — — — EXISTING FENCE
 - — — — — PROPERTY LINE
 - — — — — SETBACK LINE
 - — — — — EASEMENT LINE
 - 8" SS — 8" SS — PROPOSED SANITARY SEWER
 - 30" SWS — 30" SWS — PROPOSED STORM WATER SEWER
 - 8" W — 8" W — PROPOSED WATER LINE
 - DW — DW — PROPOSED DOMESTIC WATER LINE
 - FP — FP — PROPOSED FIRE PROTECTION LINE
 - IRR — IRR — IRRIGATION SLEEVE (SEE NOTE 12)

WARNING
EXISTING UNDERGROUND UTILITIES IN THE AREA. CONTRACTOR IS RESPONSIBLE FOR DETERMINING THE HORIZONTAL AND VERTICAL LOCATION OF ALL UTILITIES PRIOR TO CONSTRUCTION. CONTRACTOR IS RESPONSIBLE FOR ANY REPAIRS TO EXISTING UTILITIES DUE TO DAMAGE INCURRED DURING CONSTRUCTION. CONTRACTOR SHALL NOTIFY THE ENGINEER OF ANY DISCREPANCIES ON THE PLANS.

SCALE: 1"=20'

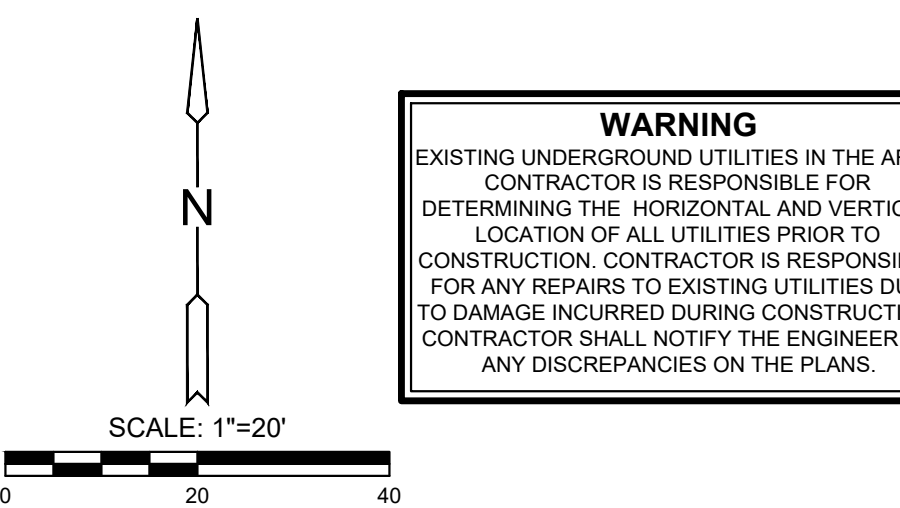

PLOTTED BY: BRYAN SMITH 4/22/2026 4:44 PM
 DWG PATH: J:\PROJECTS\2501010800\010800_UGR_THE RESERVE AT THE MEADOWS\00 CAD\BHS\06 CIVIL\SITE
 DWG NAME: 2501010800 UTILITY PLANS SWS
 ©2026 MKEC ENGINEERING, INC. ALL RIGHTS RESERVED WWW.MKEC.COM THESE DRAWINGS AND THEIR CONTENTS, INCLUDING, BUT NOT LIMITED TO, ALL CONCEPTS, DESIGNS, & IDEAS ARE THE EXCLUSIVE PROPERTY OF MKEC ENGINEERING, INC. (MKEC) AND MAY NOT BE USED OR REPRODUCED IN ANY WAY WITHOUT THE EXPRESS CONSENT OF MKEC.

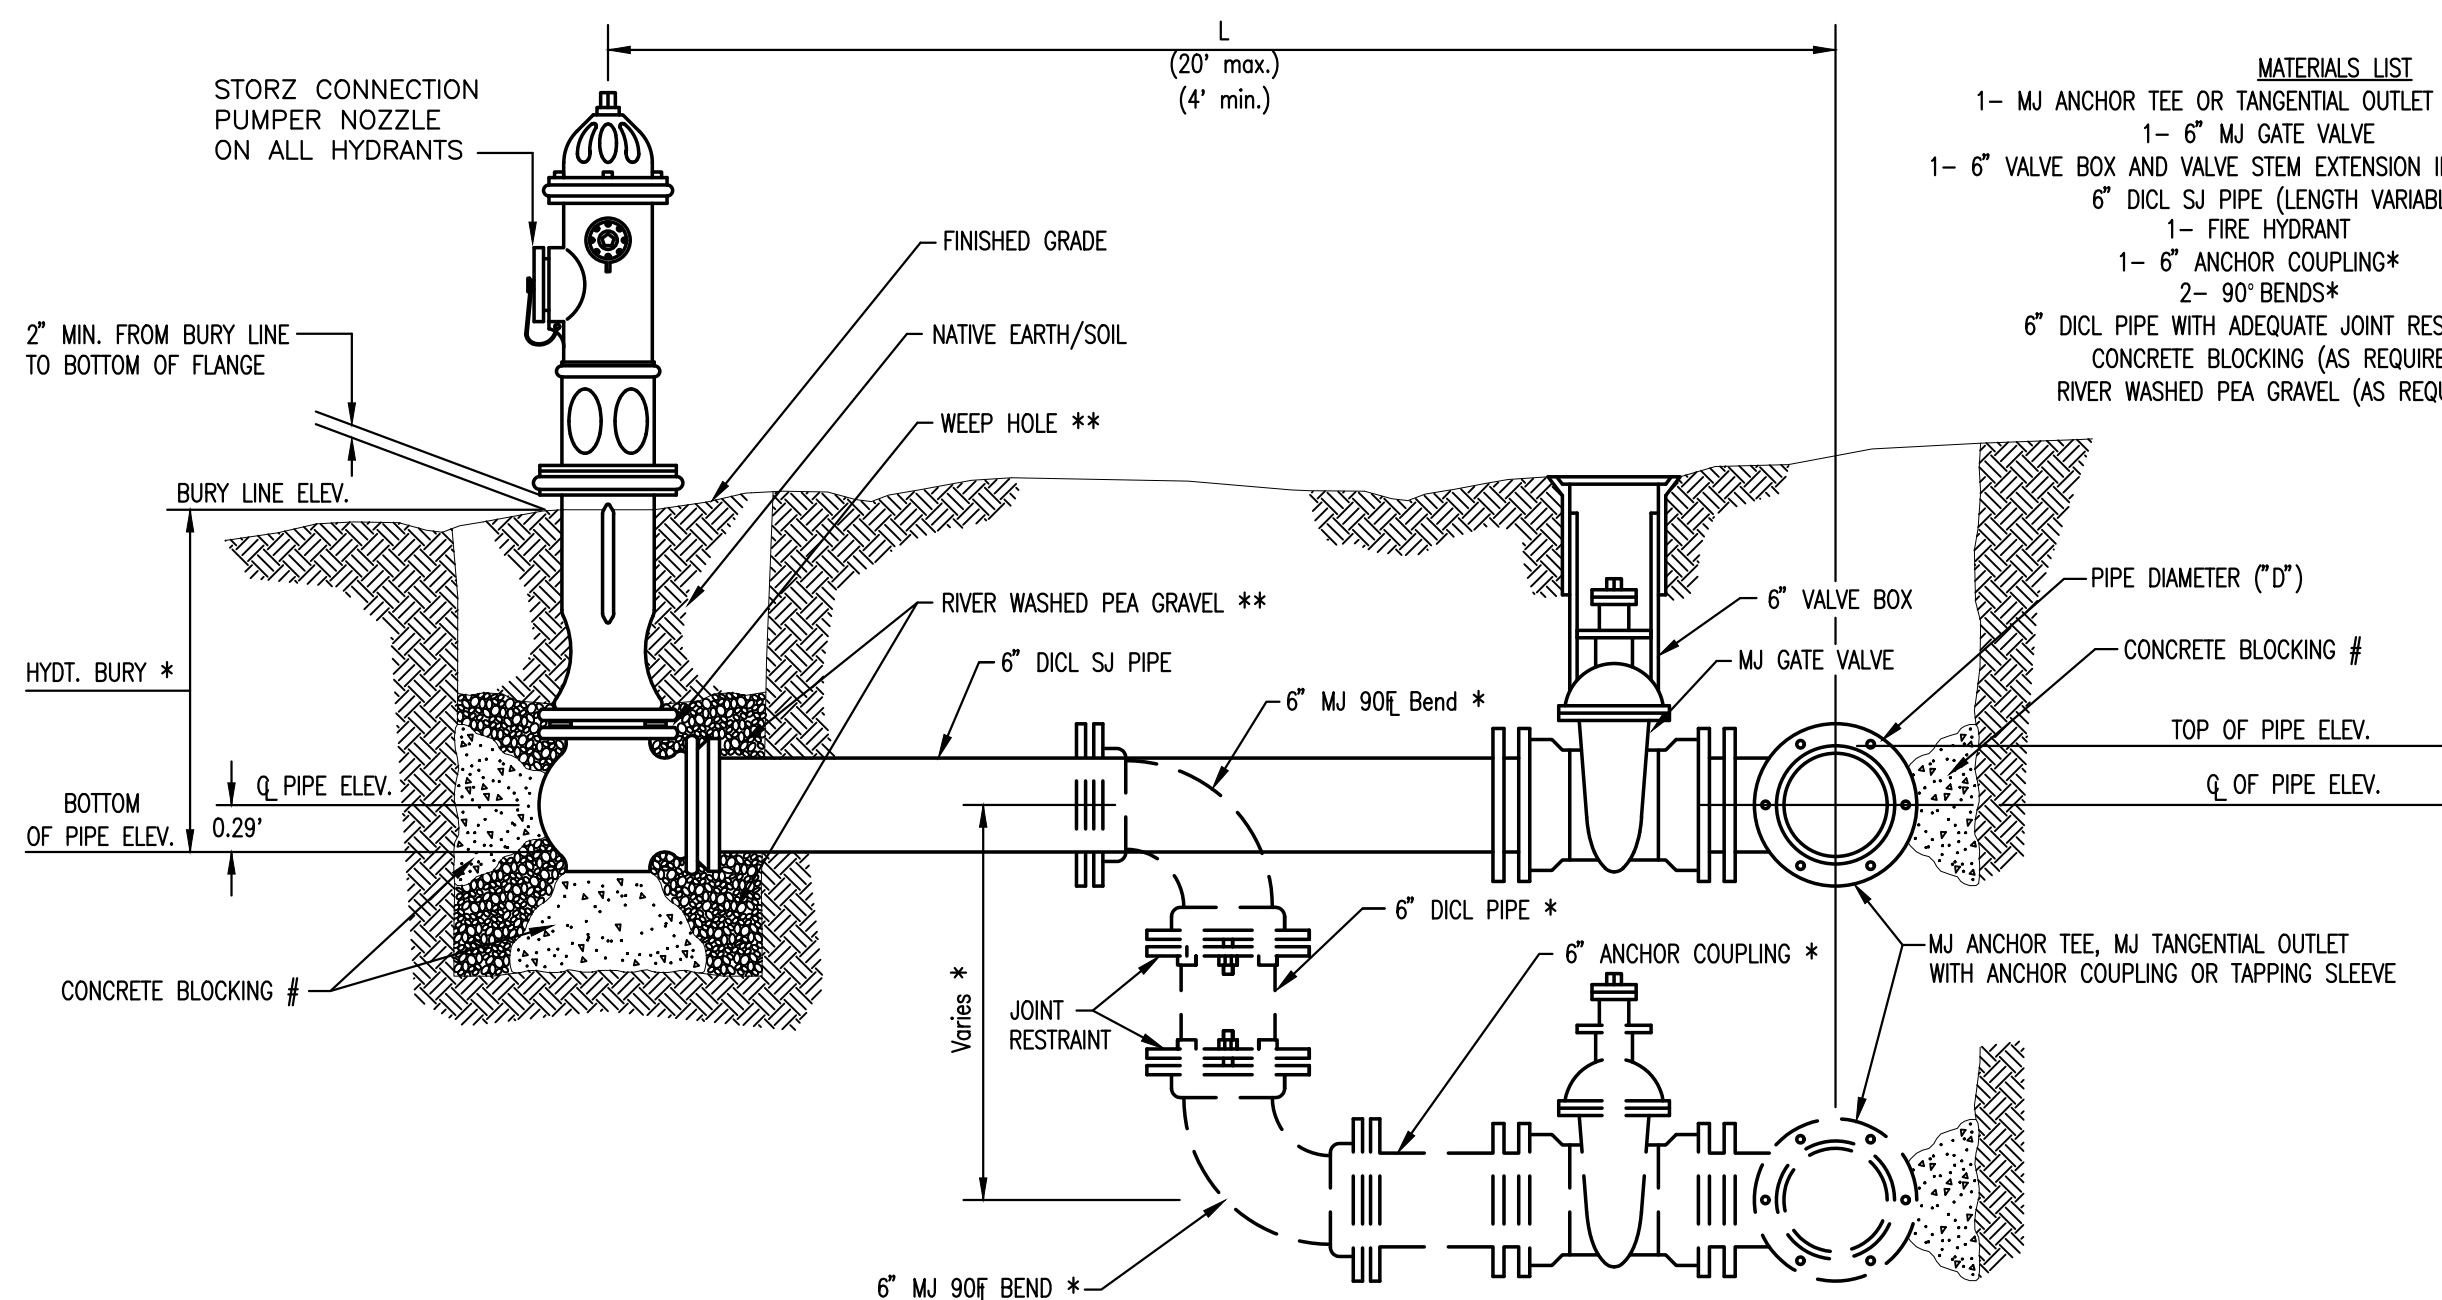


- MATERIALS LIST**
- 1- MJ ANCHOR TEE OR TANGENTIAL OUTLET ("0" x 6")
 - 1- 6" MJ GATE VALVE
 - 1- 6" VALVE BOX AND VALVE STEM EXTENSION IF REQUIRED *
 - 6" DI CL SJ PIPE (LENGTH VARIABLE)
 - 1- FIRE HYDRANT
 - 2- 90° BENDS*
 - 1- 6" ANCHOR COUPLING*
 - 6" DI CL PIPE WITH ADEQUATE JOINT RESTRAINT *
 - CONCRETE BLOCKING (AS REQUIRED)
 - RIVER WASHED PEA GRAVEL (AS REQUIRED)

* IF THE REQUIRED HYDRANT BURY IS IN EXCESS OF 5', BUT LESS THAN 7', CONTRACTOR SHALL USE STANDARD 5' HYDRANT BURY AND HYDRANT BARREL EXTENSIONS AS NECESSARY. IF THE REQUIRED HYDRANT BURY IS GREATER THAN 7', CONTRACTOR SHALL USE 5' HYDRANT BURY, 2-MJ 90° BENDS, 6" ANCHOR COUPLING AND 6" DI CL PIPE AS NECESSARY FOR VERTICAL ADJUSTMENT. THE CONTRACTOR SHALL PROVIDE ADEQUATE THRUST BLOCKING AT HYDRANT AND MEGALUGS, OR SIMILAR RESTRAINT BETWEEN 90° BENDS TO SECURE ALL FITTINGS DURING TESTING AND OPERATION. THE CONTRACTOR SHALL PROVIDE A VALVE STEM EXTENSION PER DETAIL THIS SHEET.

** CAUTION: WEEP HOLES TO BE KEPT CLEAR DURING CONSTRUCTION AND BACKFILL. CONCRETE FOR THRUST BLOCKING SHALL NOT OBSTRUCT WEEP HOLES. PLACE 1 CUBIC FOOT OF RIVER WASHED PEA GRAVEL AROUND EACH WEEP HOLE.

CONCRETE THRUST BLOCKING SHALL BE KEPT CLEAR OF BOLTS, NUTS, AND MJ ACCESSORIES.

FIRE HYDRANT ASSEMBLY
PER CITY OF WICHITA SPECIFICATIONS

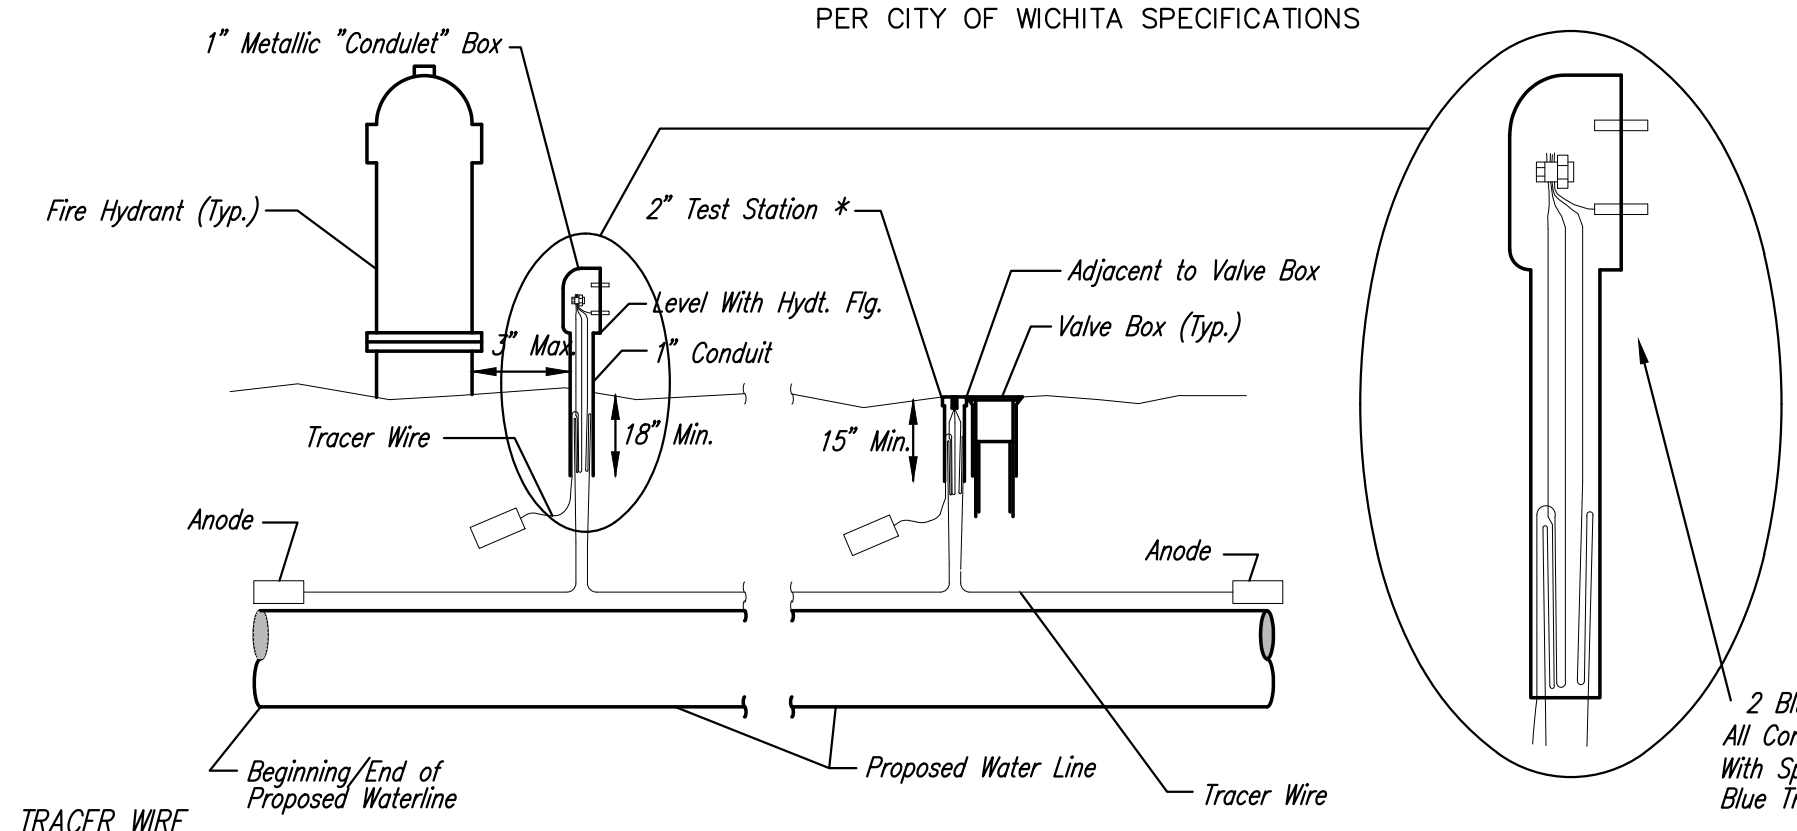

TRACER WIRE
Conductive type pipe locator/tracer wire shall be installed to locate all waterline pipe regardless of pipe material. The wire shall extend the entire length of the proposed pipe. The wire shall be taped to the waterline and pulled with the pipe. Split-bolt connectors shall be used at splice locations. Electrical tape shall cover all splices so no bare wire is exposed. Test stations shall be installed adjacent to all fire hydrants along the waterline and at blowoffs or valves near the ends of the waterlines. Any exceptions to the location of test stations shall be approved by the engineer. At each test station, the tracer wire shall be connected to a 3 lb. Zinc or magnesium anode. Anodes shall also be attached to the tracer wire at both the beginning and the end of the proposed waterline. A typical layout of the tracer wire and test station is provided in the above figure.

WIRE
The tracer wire shall be Blue No. 12 THHN annealed soft copper wire with thermal plastic insulation or Blue No. 12 AWG CCS with 30 mil HDPE insulation. The insulation shall be heat, oil, and gasoline resistant as manufactured by Temple Electric or approved equal. To allow for grade adjustment, a minimum of 12" of excess wire shall be coiled at the bottom of the test station for all wires. The insulation sheathing shall be removed such that 1" bare copper wire at all points of connection. Contractor shall attach wire being installed with proposed water main to any tracer wire installed with adjacent waterline projects.


TEST STATIONS
The test station for fire hydrant applications shall be a 1 inch galvanized "condulet" style test station as manufactured by AGRA Industries with a removable solid cover having two leads extending from the face or approved equal. The test station for valve applications shall be 2 inch flush style test station T2PS3B as manufactured by HANDLEY Industries or approved equal. The "conduit" style test station shall be attached to a 1 inch rigid galvanized conduit with a minimum length of 36" and plastic end bushing. The flush style shall have the word "WATER" stamped or molded into the lid. All test stations shall be manufactured using molded blue tops or sufficiently coated with blue enamel paint. The tracer wire and the anode wire shall be installed to allow 10 inches of wire within the test station. In concrete environments such as sidewalks or in the downtown area the contractor shall use the flush style test station. The location of all test stations shall be approved by the engineer, recorded, and shown in the as-built drawings.

ANODES
The anodes shall be 3 lb. bare zinc or magnesium. The anodes shall be buried at the same elevation as the waterline at each test station. The anodes shall be connected to Black No. 12 THHN annealed soft copper wire which shall be extended to the test station.


TRACER WIRE DETAIL
COST IS SUBSIDIARY TO PIPE INSTALLATION

FIRE HYDRANTS REQUIRED


STATION	BURY LINE ELEVATION	TOP OF PIPE ELEVATION	FIRE HYDRANT BURY REQUIRED*	VALVE STEM EXT. REQUIRED (ft)*

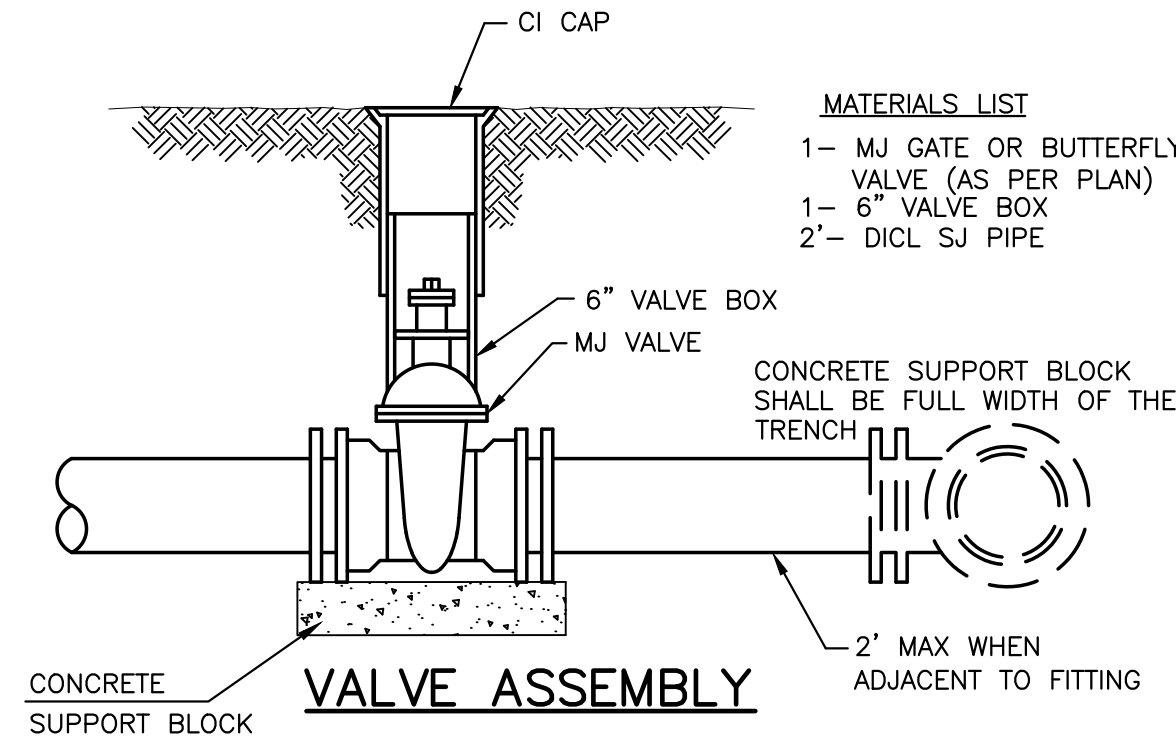

- MATERIALS LIST**
- 1- MJ GATE OR BUTTERFLY VALVE (AS PER PLAN)
 - 1- MJ ANCHOR COUPLING (12" OR SMALLER)
 - 1- 6" VALVE BOX
 - CONCRETE SUPPORT BLOCK SHALL BE FULL WIDTH OF THE TRENCH

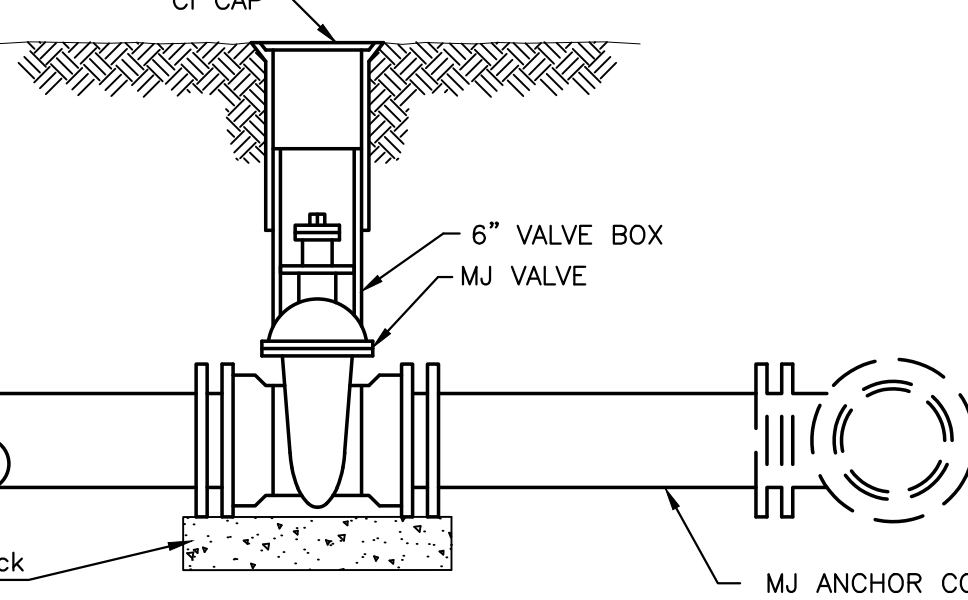

ANCHORED VALVE ASSEMBLY

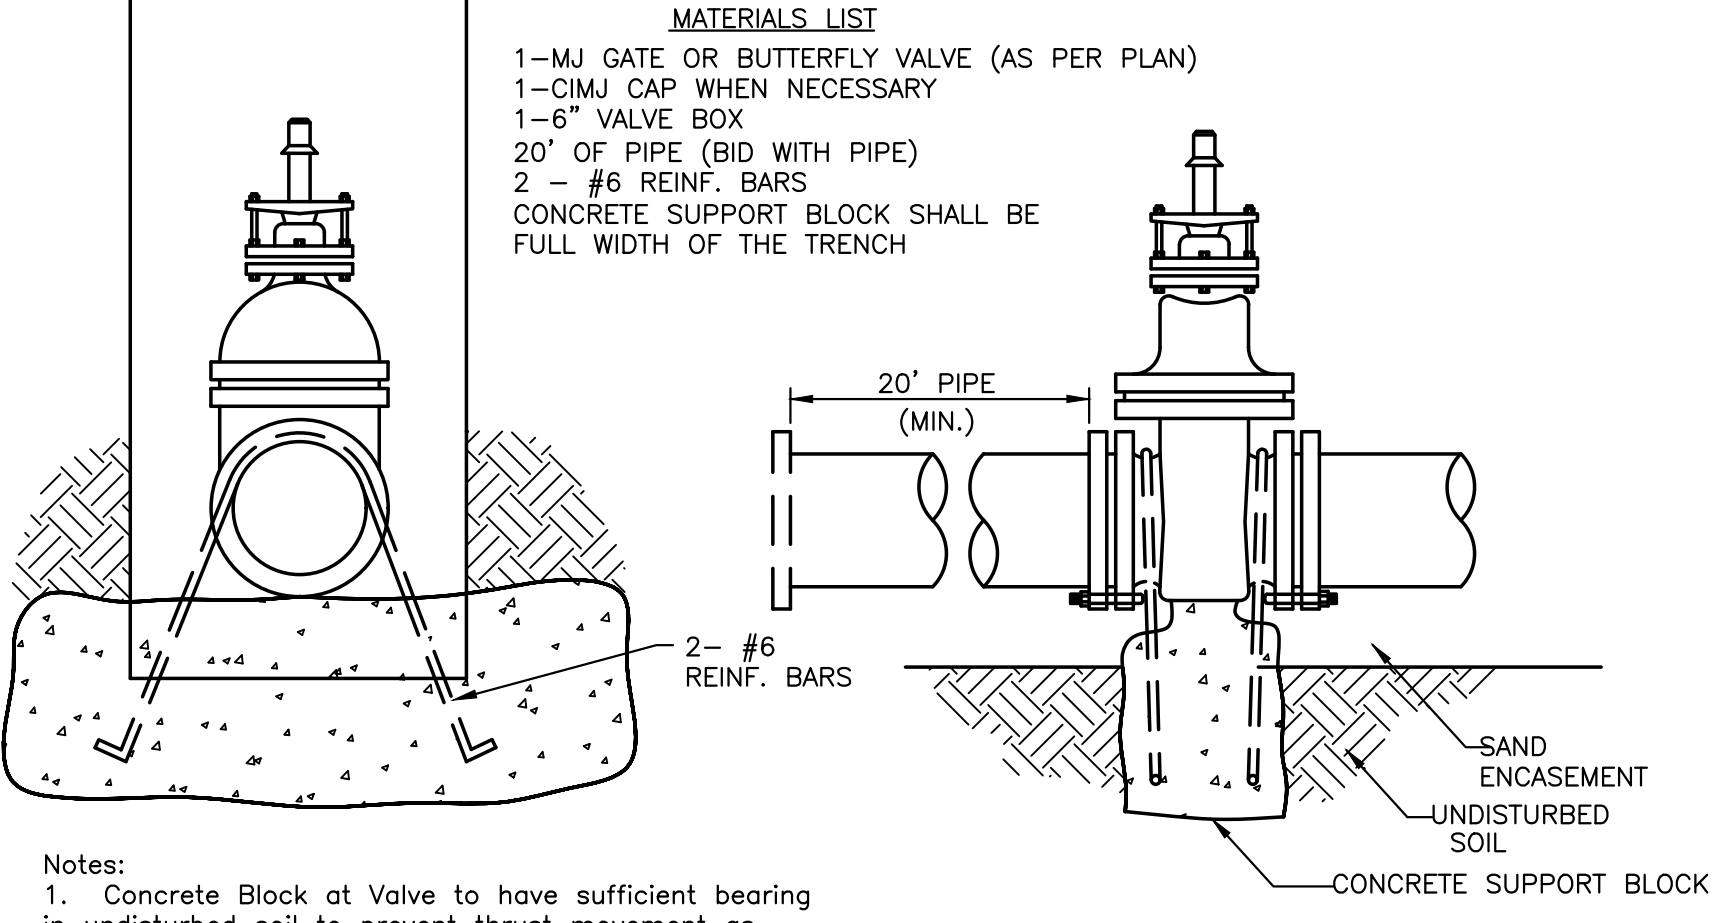


Notes:

- Concrete Block at Valve to have sufficient bearing in undisturbed soil to prevent thrust movement as shown in table at right. Field Engineer to determine thrust loading of undisturbed soil and final size of thrust block.
- The thrust block shall be constructed such that bolts, nuts, and other MJ accessories are kept clear of concrete.
- All valves at dead ends and at other locations as called out on the plans shall be blocked as shown here.


THRUST AT VALVES

VALVE	THRUST AT 150 #/sq. ft.
4"	1809 lbs.
6"	4245 lbs.
8"	7540 lbs.
12"	16965 lbs.

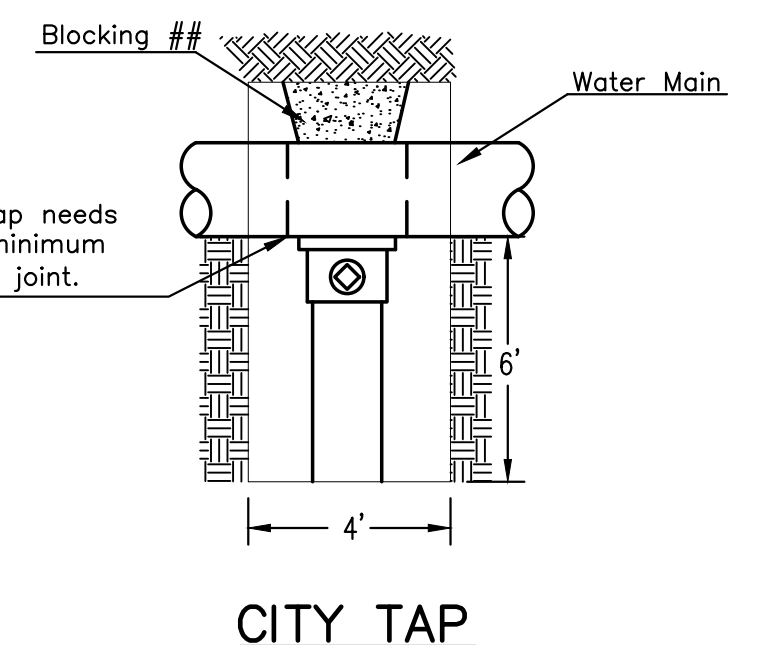


CITY TAP

When the City of Wichita makes tap, blocking is to be done by Contractor

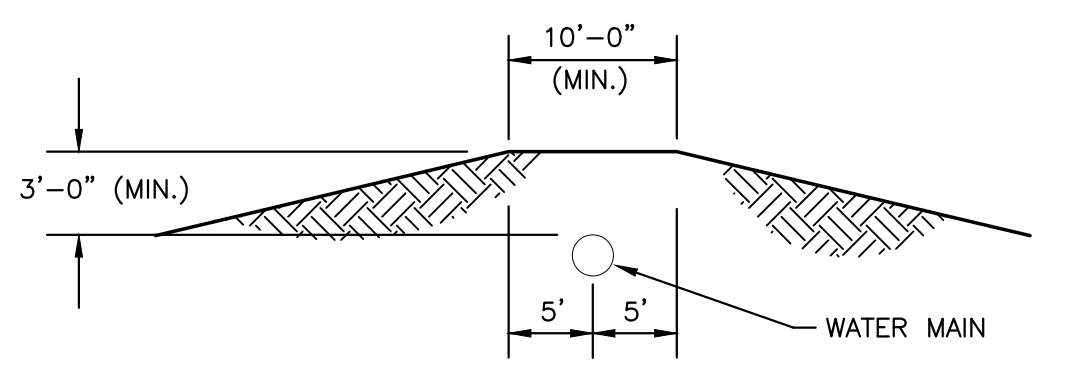

PROTECTIVE FILL DETAIL


MINIMUM PROTECTIVE FILL SHALL BE PROVIDED IN ALL INSTANCES WHERE COVER OVER THE PROP. WATER LINE IS LESS THAN 3'. (COST SUBSIDIARY TO PIPE INSTALLATION)

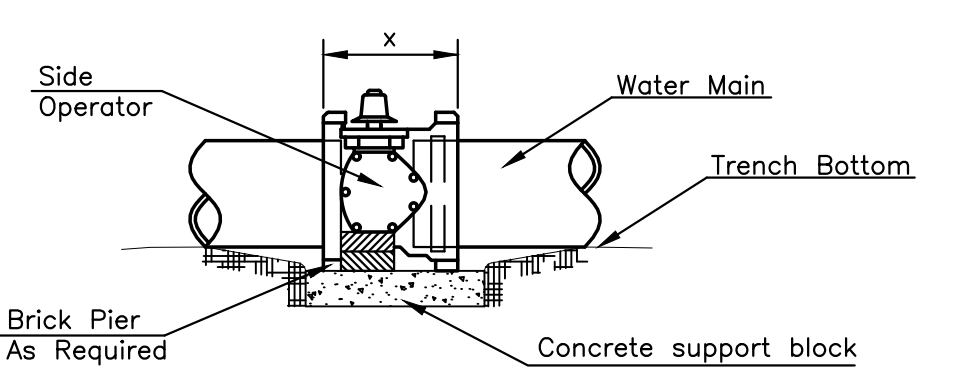

NOTES


- This detail covers Butterfly Valve installation, inclusive, regardless of type of pipe or joint used. 24" and larger lines to be detailed on plans.
- 6" Valve Box and Cover required per City of Wichita Std. Specifications.
- Conc. Support Block to be full width of trench.

CONCRETE SUPPORT BLOCKING FOR BUTTERFLY VALVE INSTALLATION

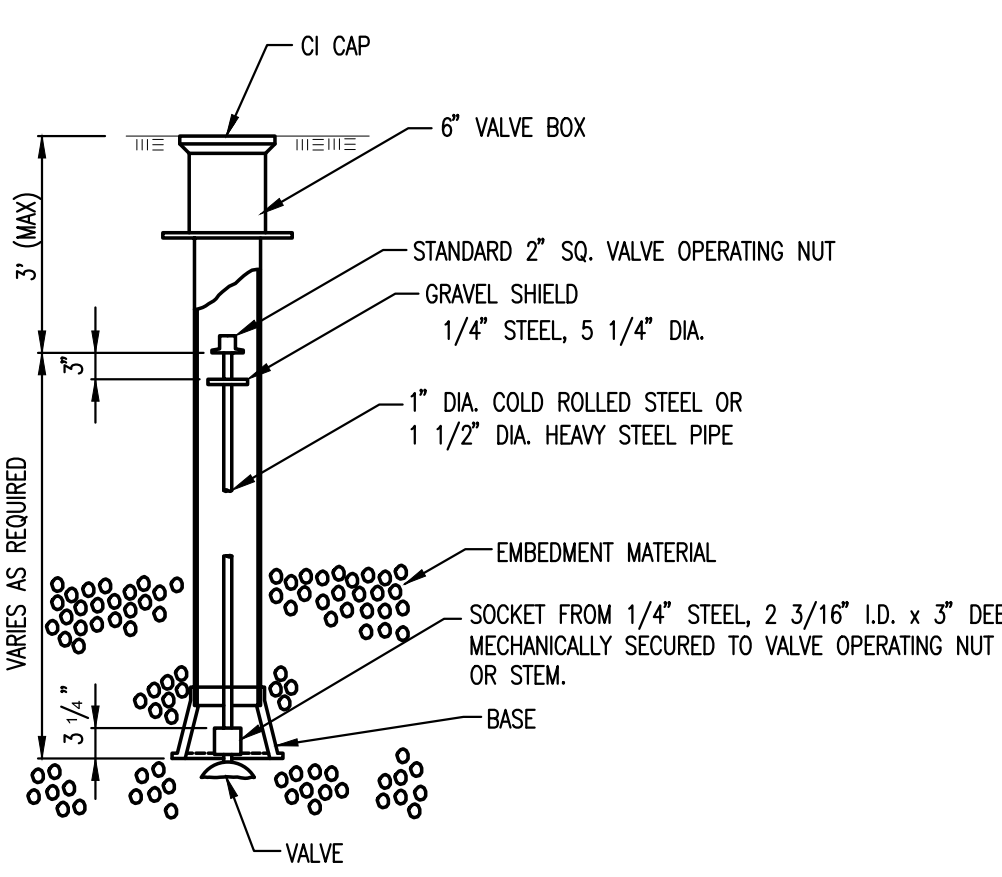

VALVE STEM EXTENSION DETAIL

NOTE: ONE VALVE STEM EXTENSION FOR EACH VALVE BURIED GREATER THAN 5'.

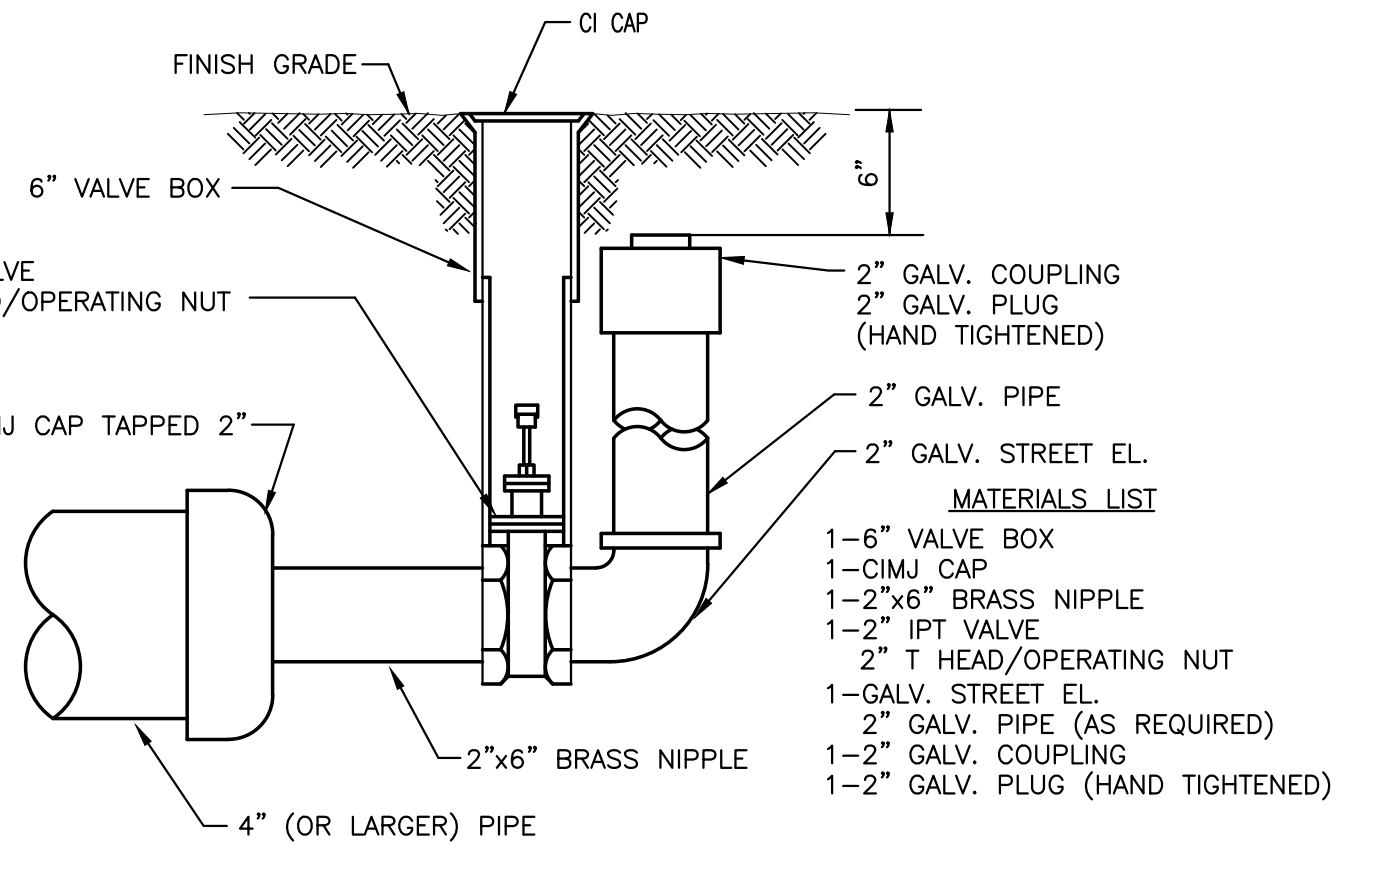


2" BLOWOFF ASSEMBLY

CIVIL PLANS FOR
THE RESERVE AT THE MEADOWS
GODDARD, KS

WATER ASSEMBLY DETAILS


PROJECT NO.	2501010800
SCALE	NTS
DRAWN	CNA
DESIGNED	TMBB
CHECKED	SPE

NO.	REVISION	DATE

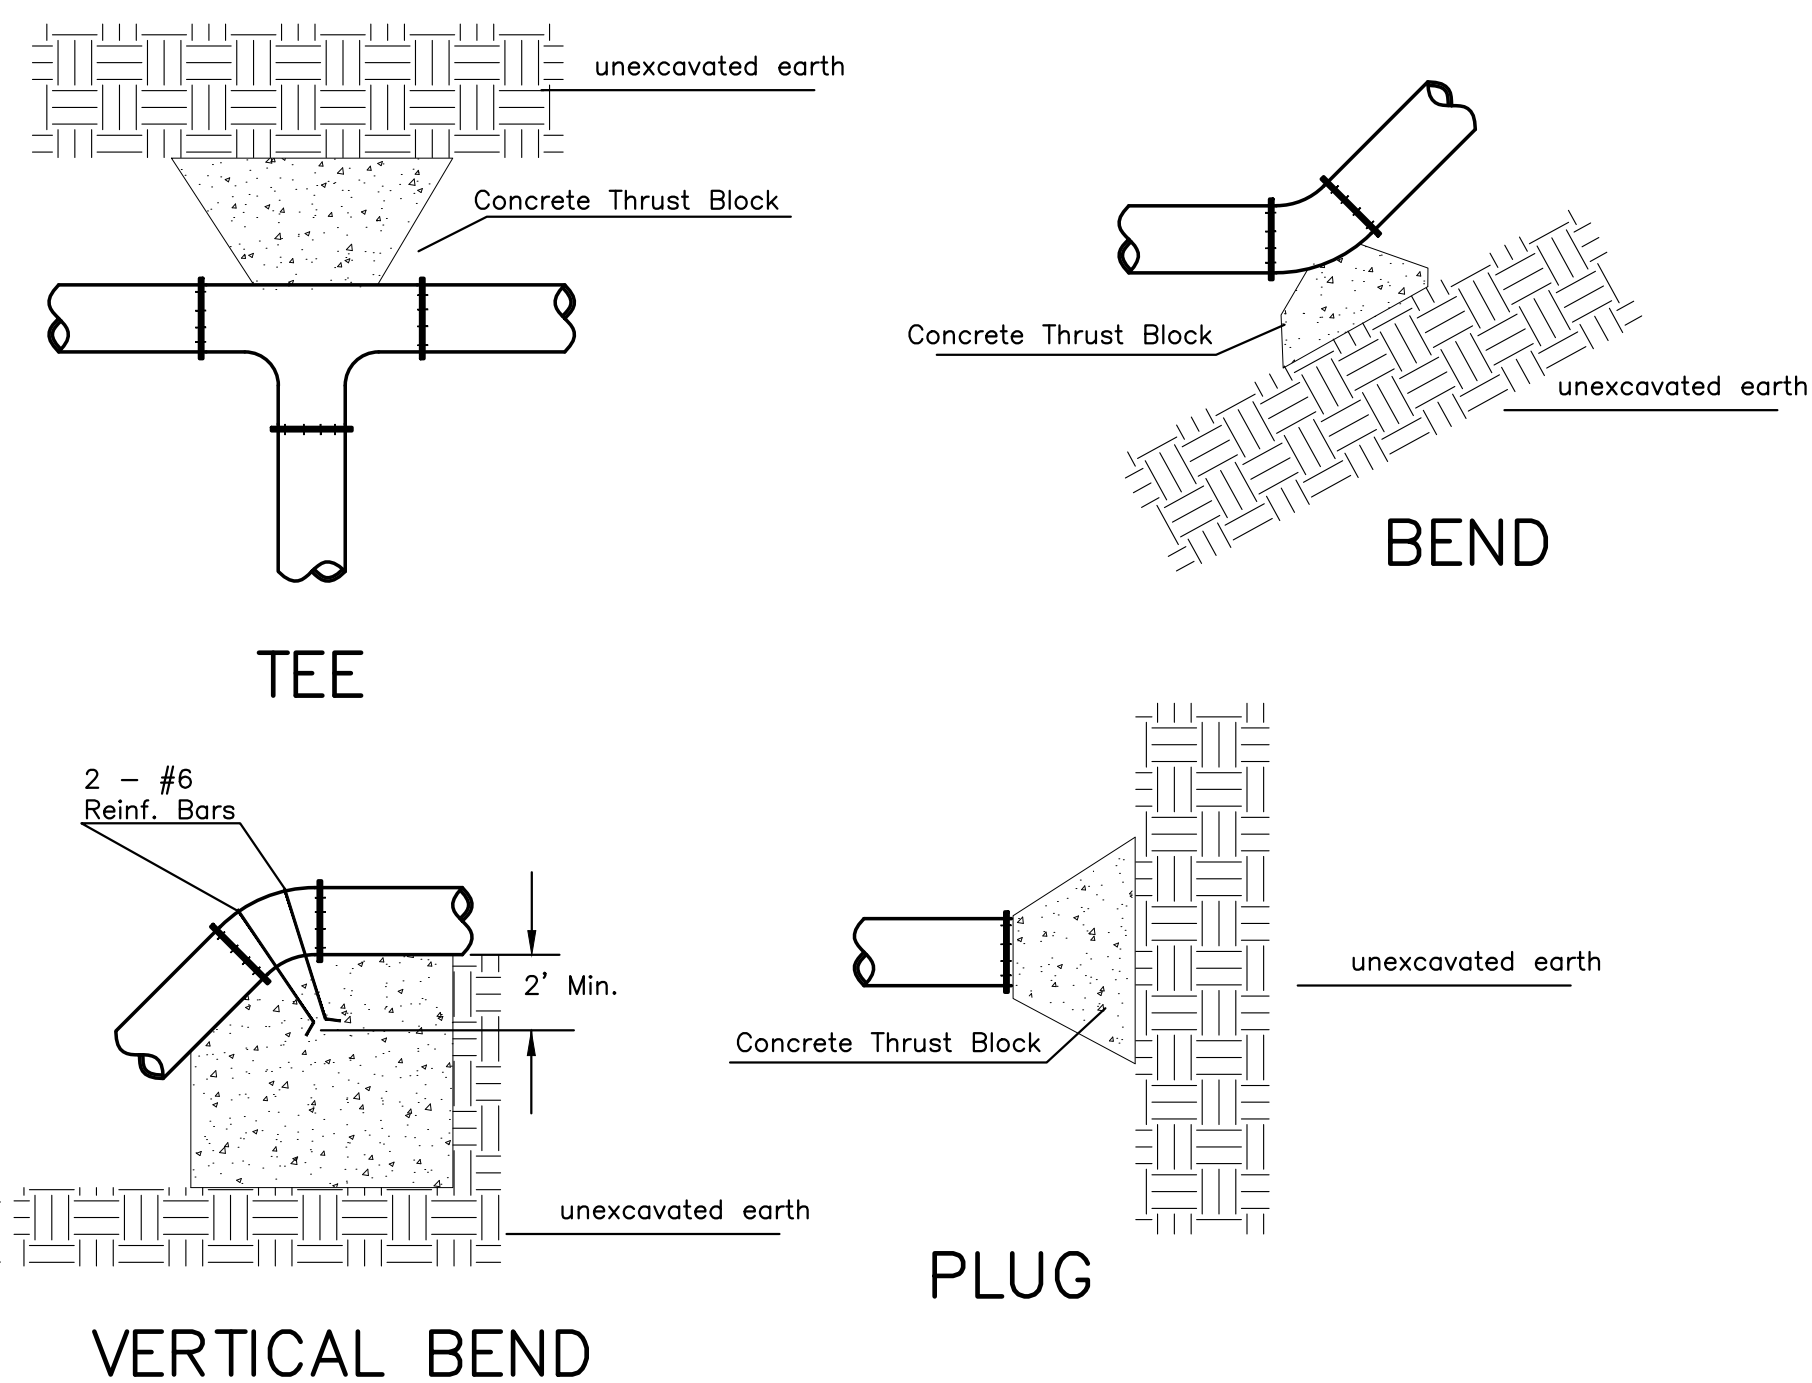


PIPE SIZE	THRUST AT FITTINGS IN TONS-AT 150#/IN P					
	PLUG	90°	45°	22 1/2°	11 1/4°	TEE
6"	2.8	3.95	2.15	1.09	.55	2.8
8"	4.9	6.95	3.75	1.90	.96	4.9
12"	11.4	16.1	8.75	4.45	2.25	11.4
16"	20.15	28.5	15.4	7.85	3.95	20.15
20"	31.15	44.0	23.85	12.15	6.10	31.15
24"	44.55	63.0	34.1	17.4	8.75	44.55

TYPICAL THRUST BLOCKS

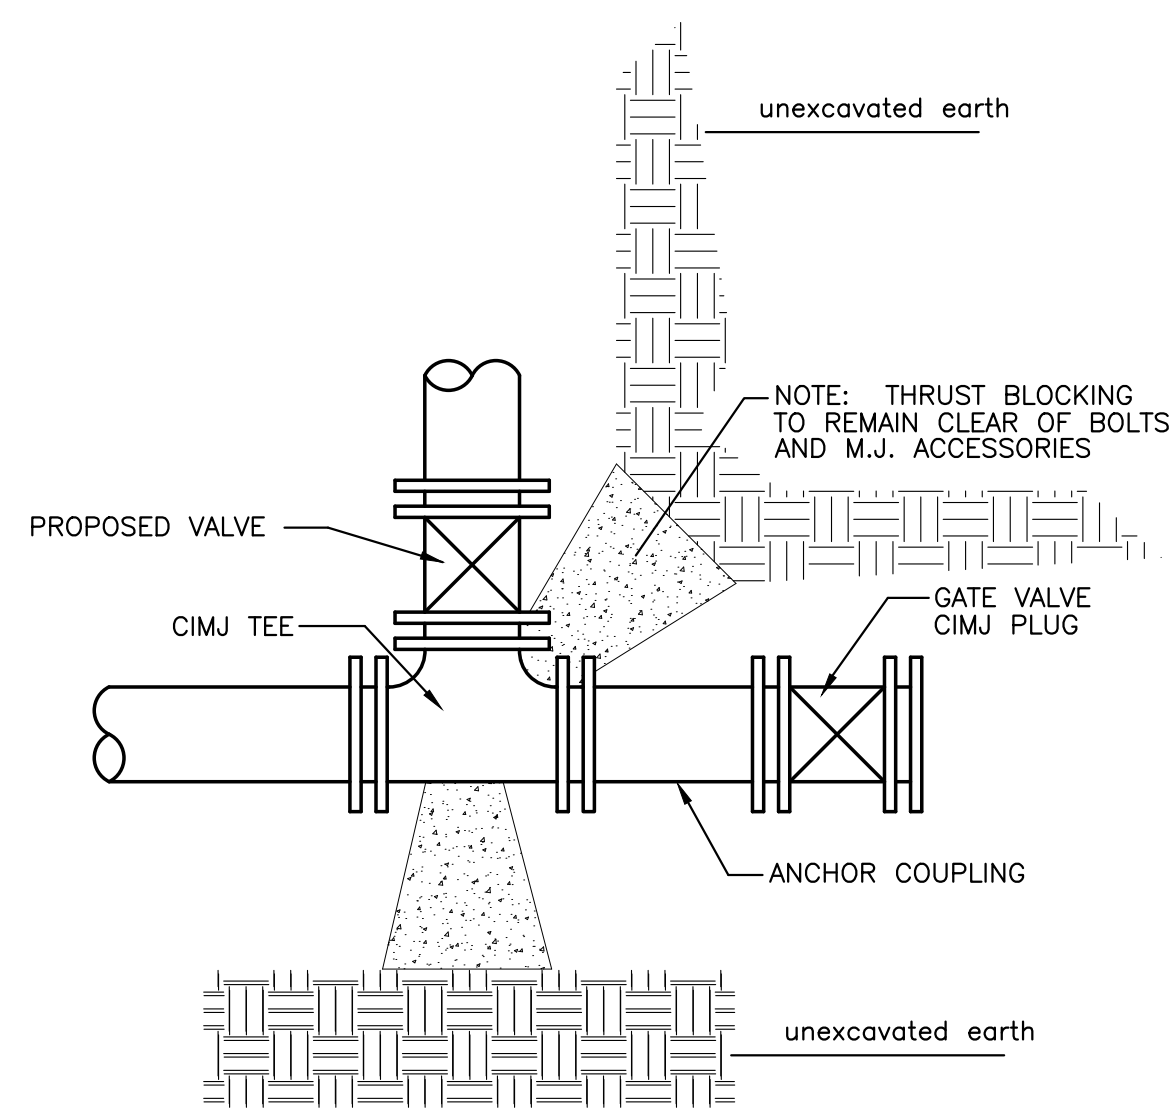


KEY BLOCK DETAIL

PLANS GOVERN
UNLESS OTHERWISE NOTED ON PLANS

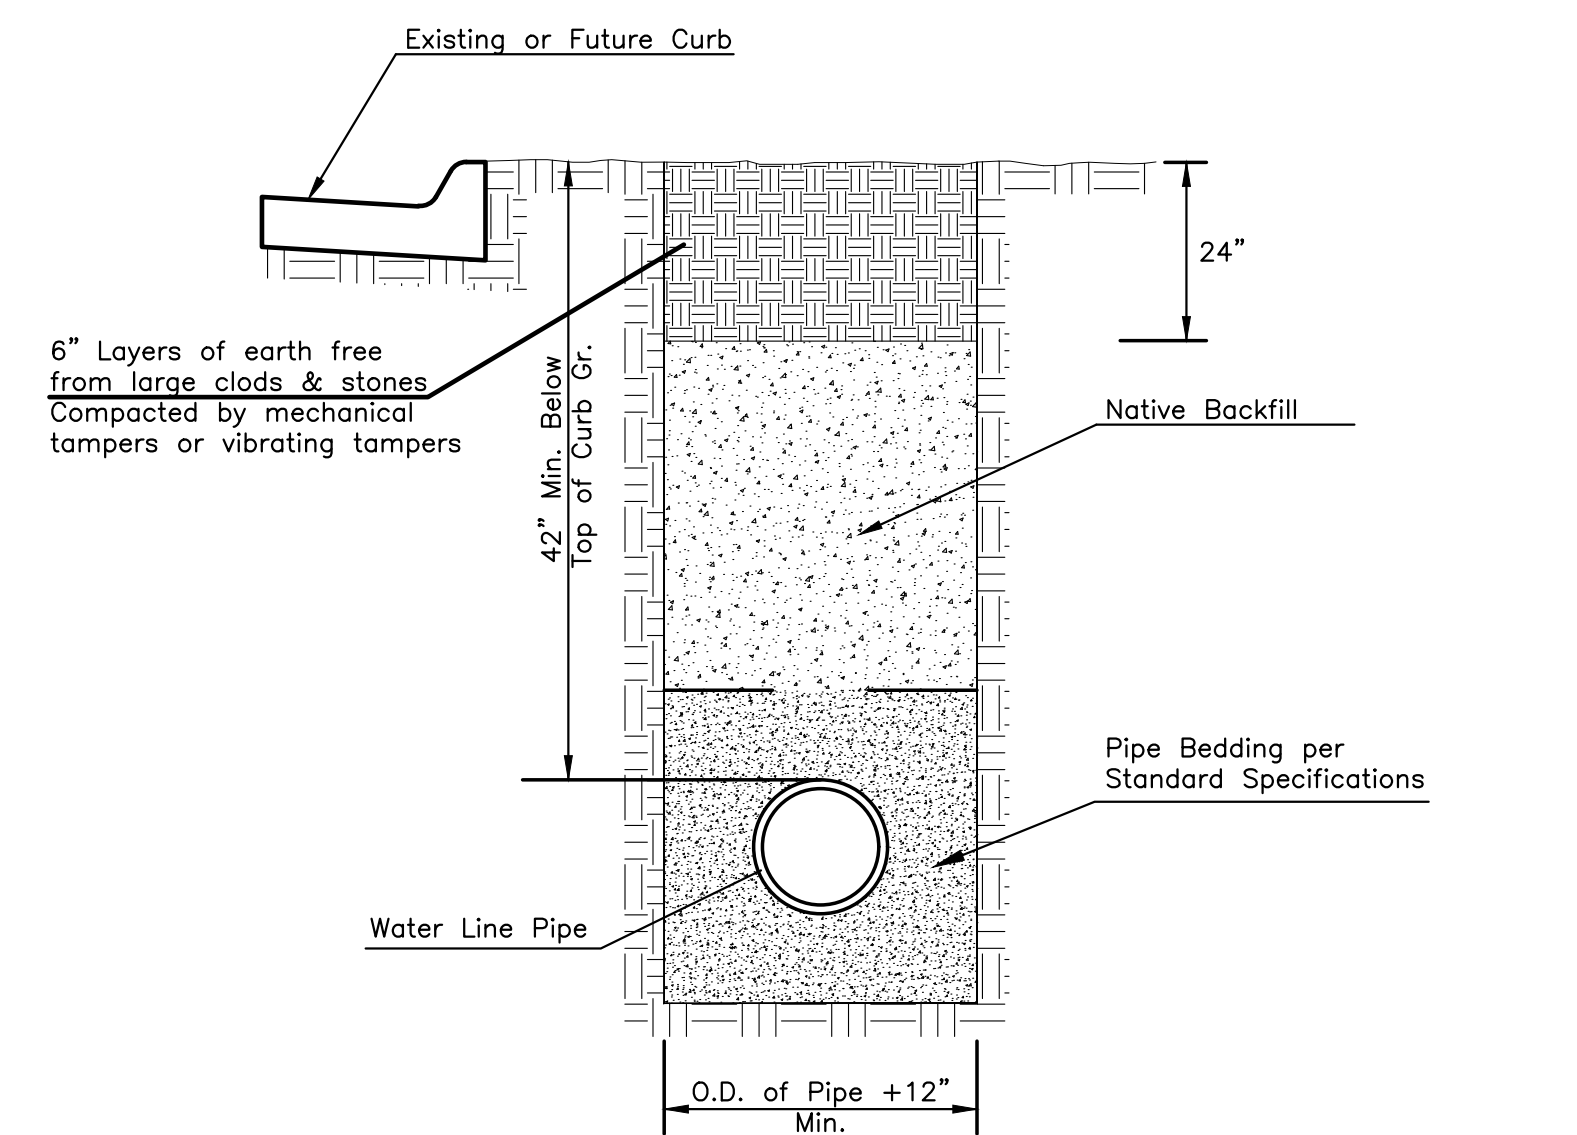


TRENCH COMPACTION IN ROAD RIGHT-OF-WAY

SIDE VIEW

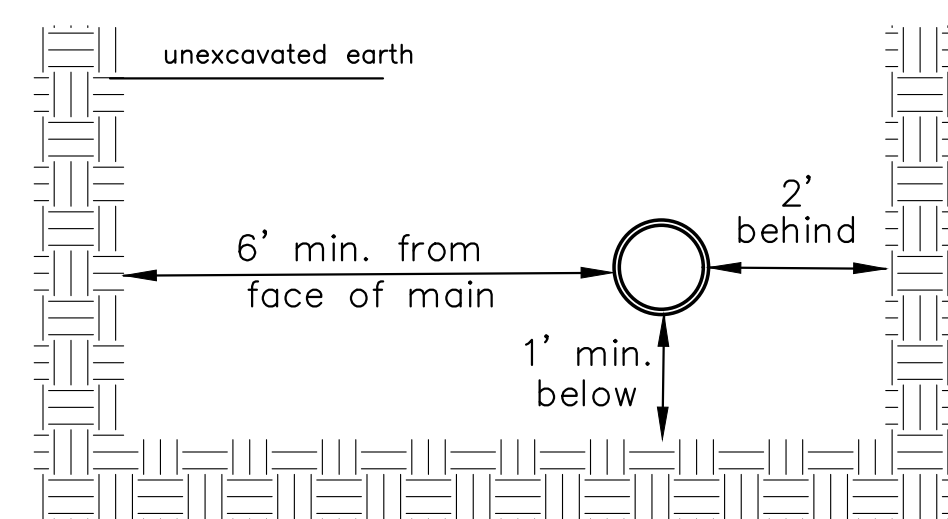


TOP VIEW

Note: When shoring is required it is to be per The City of Wichita Standard Specifications.

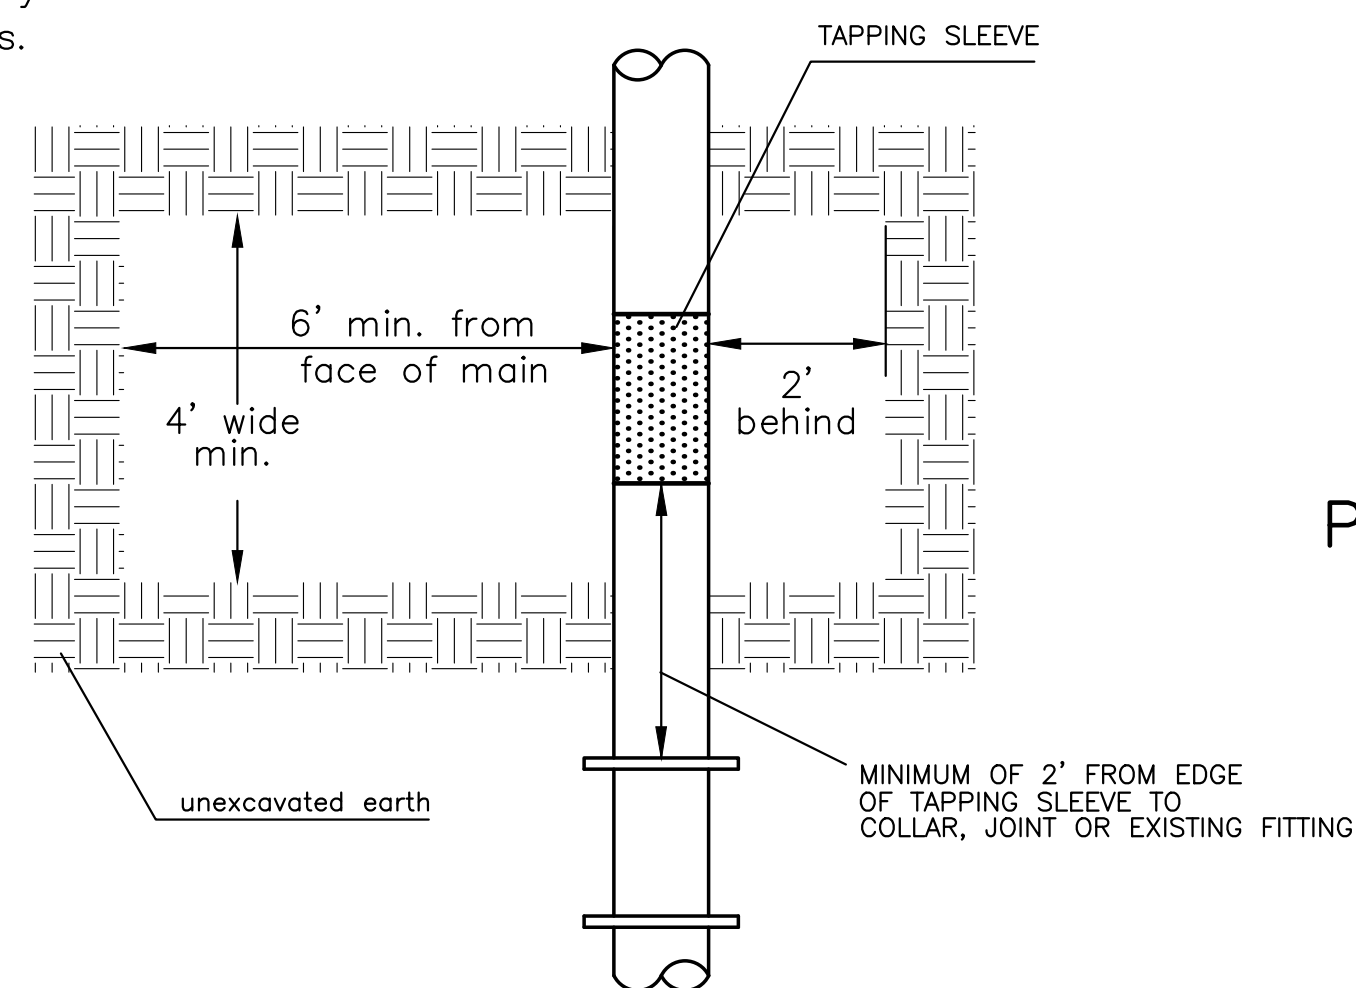


EXCAVATION FOR WET TAP

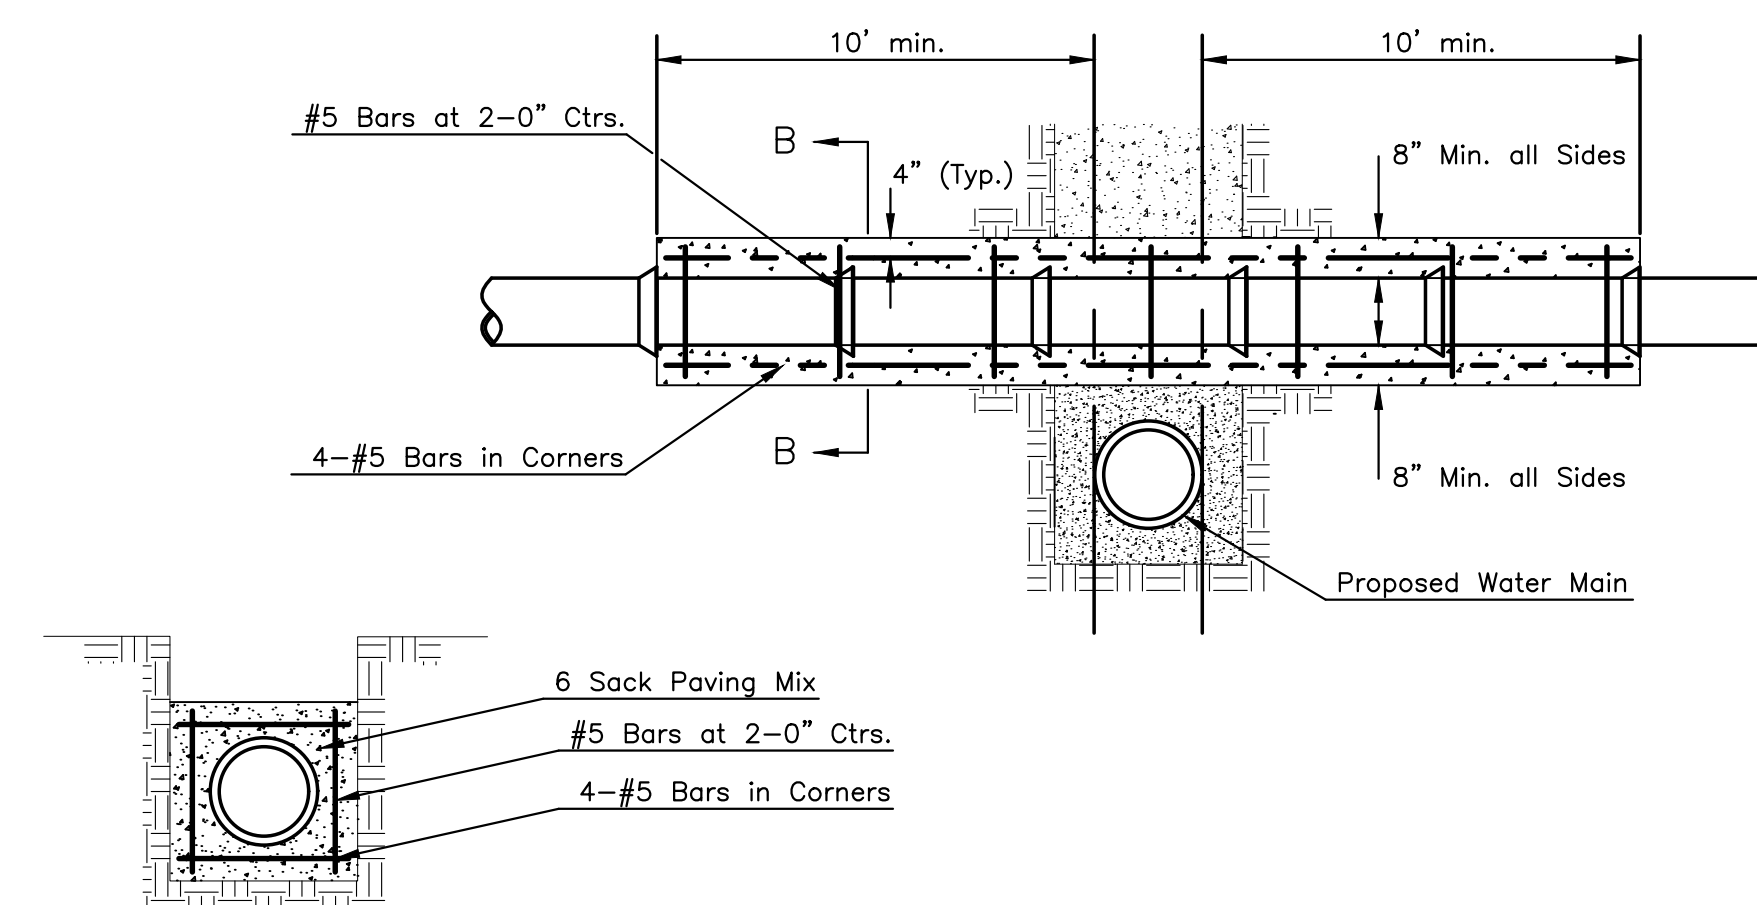





SECTION B-B

Note: Encasement to begin and end at a Bell on Sanitary Sewer Pipe.

REINFORCED CONCRETE ENCASEMENT OF SANITARY SEWER

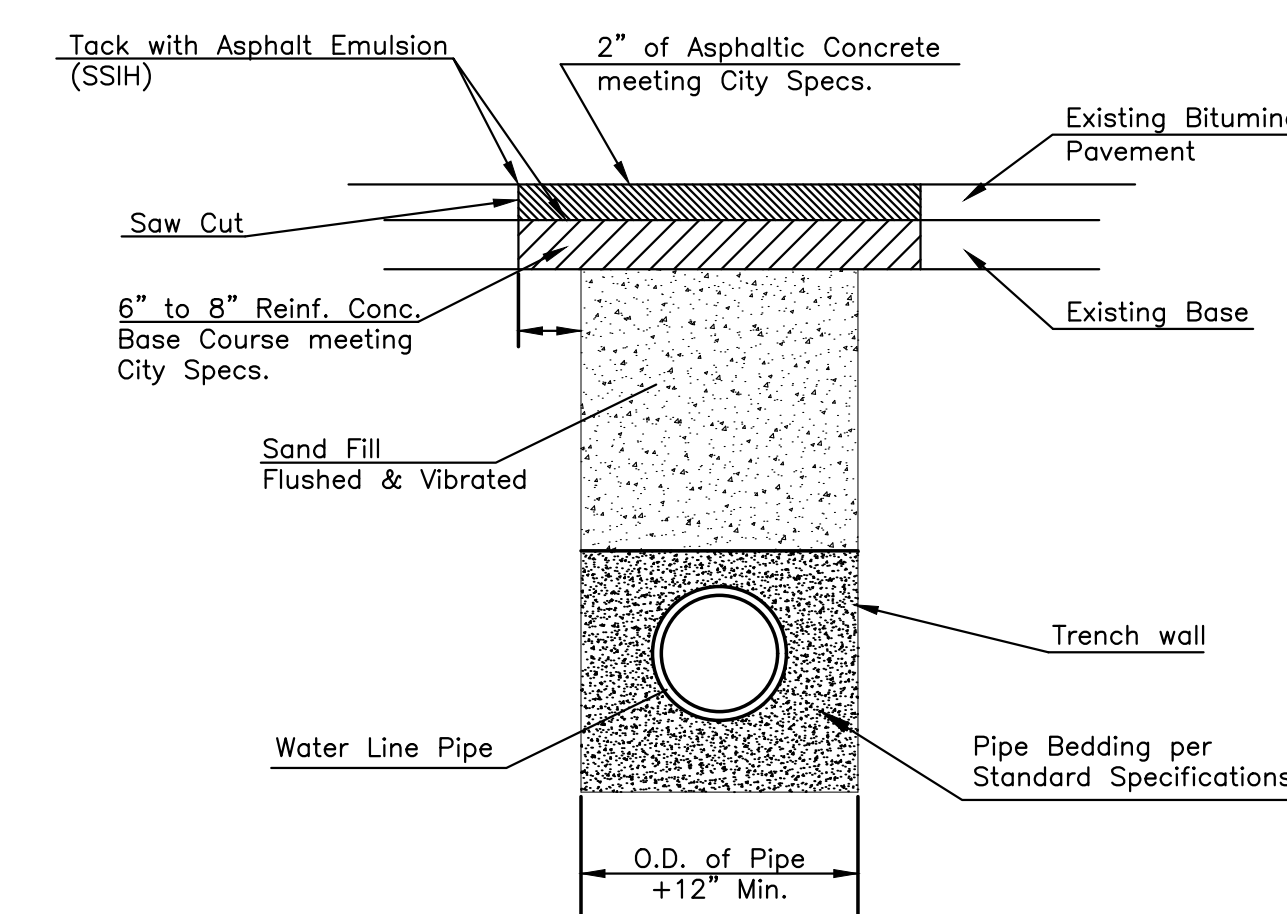

PAVEMENT REPLACEMENT & TRENCH COMPACTION UNDER EXISTING AND PROPOSED CITY ROADS

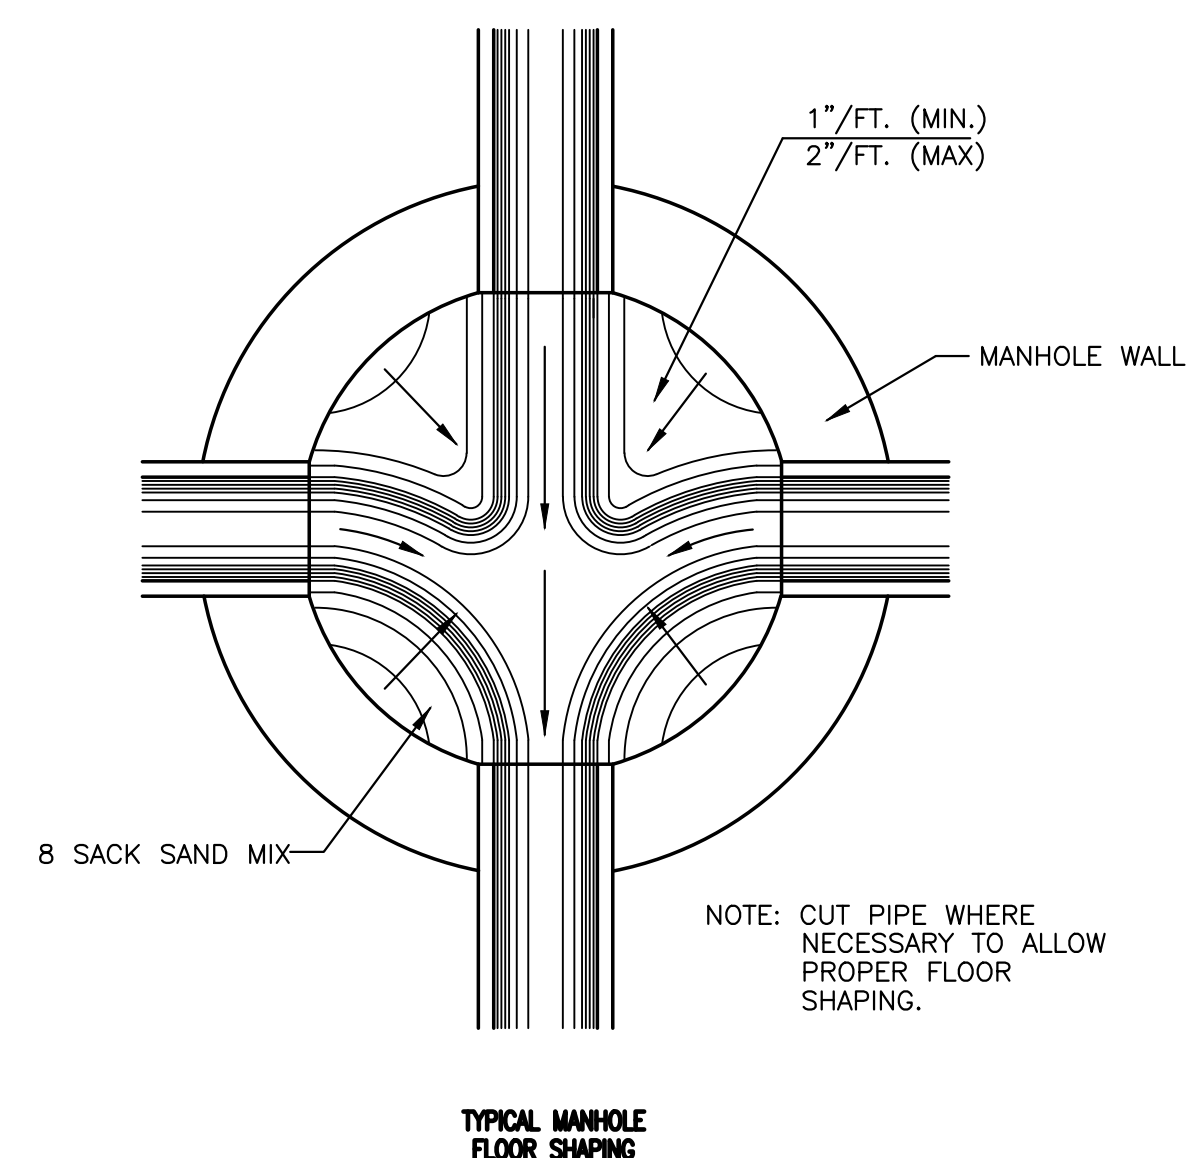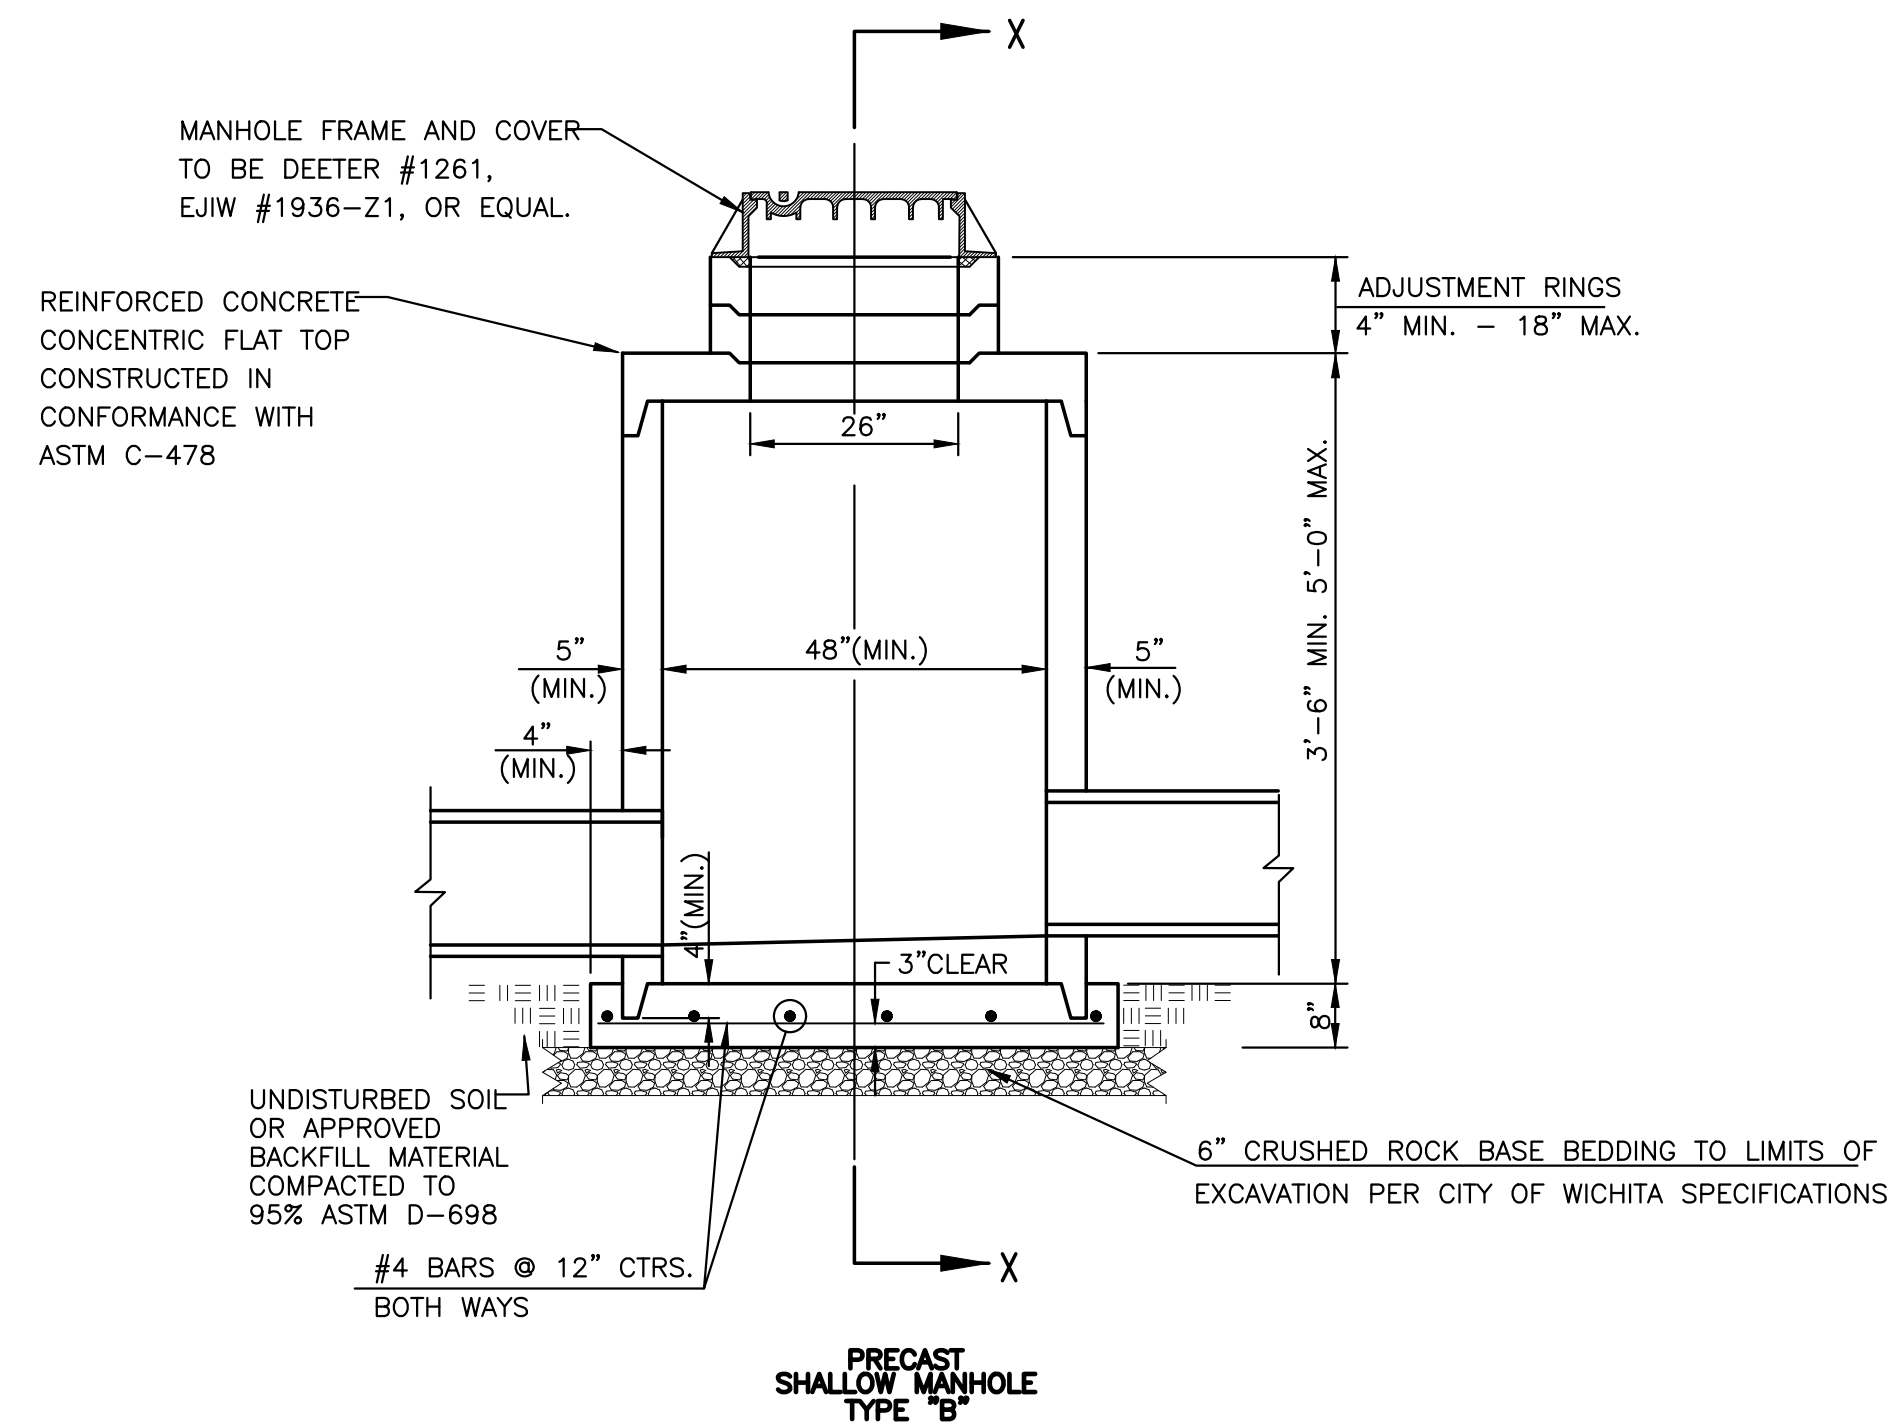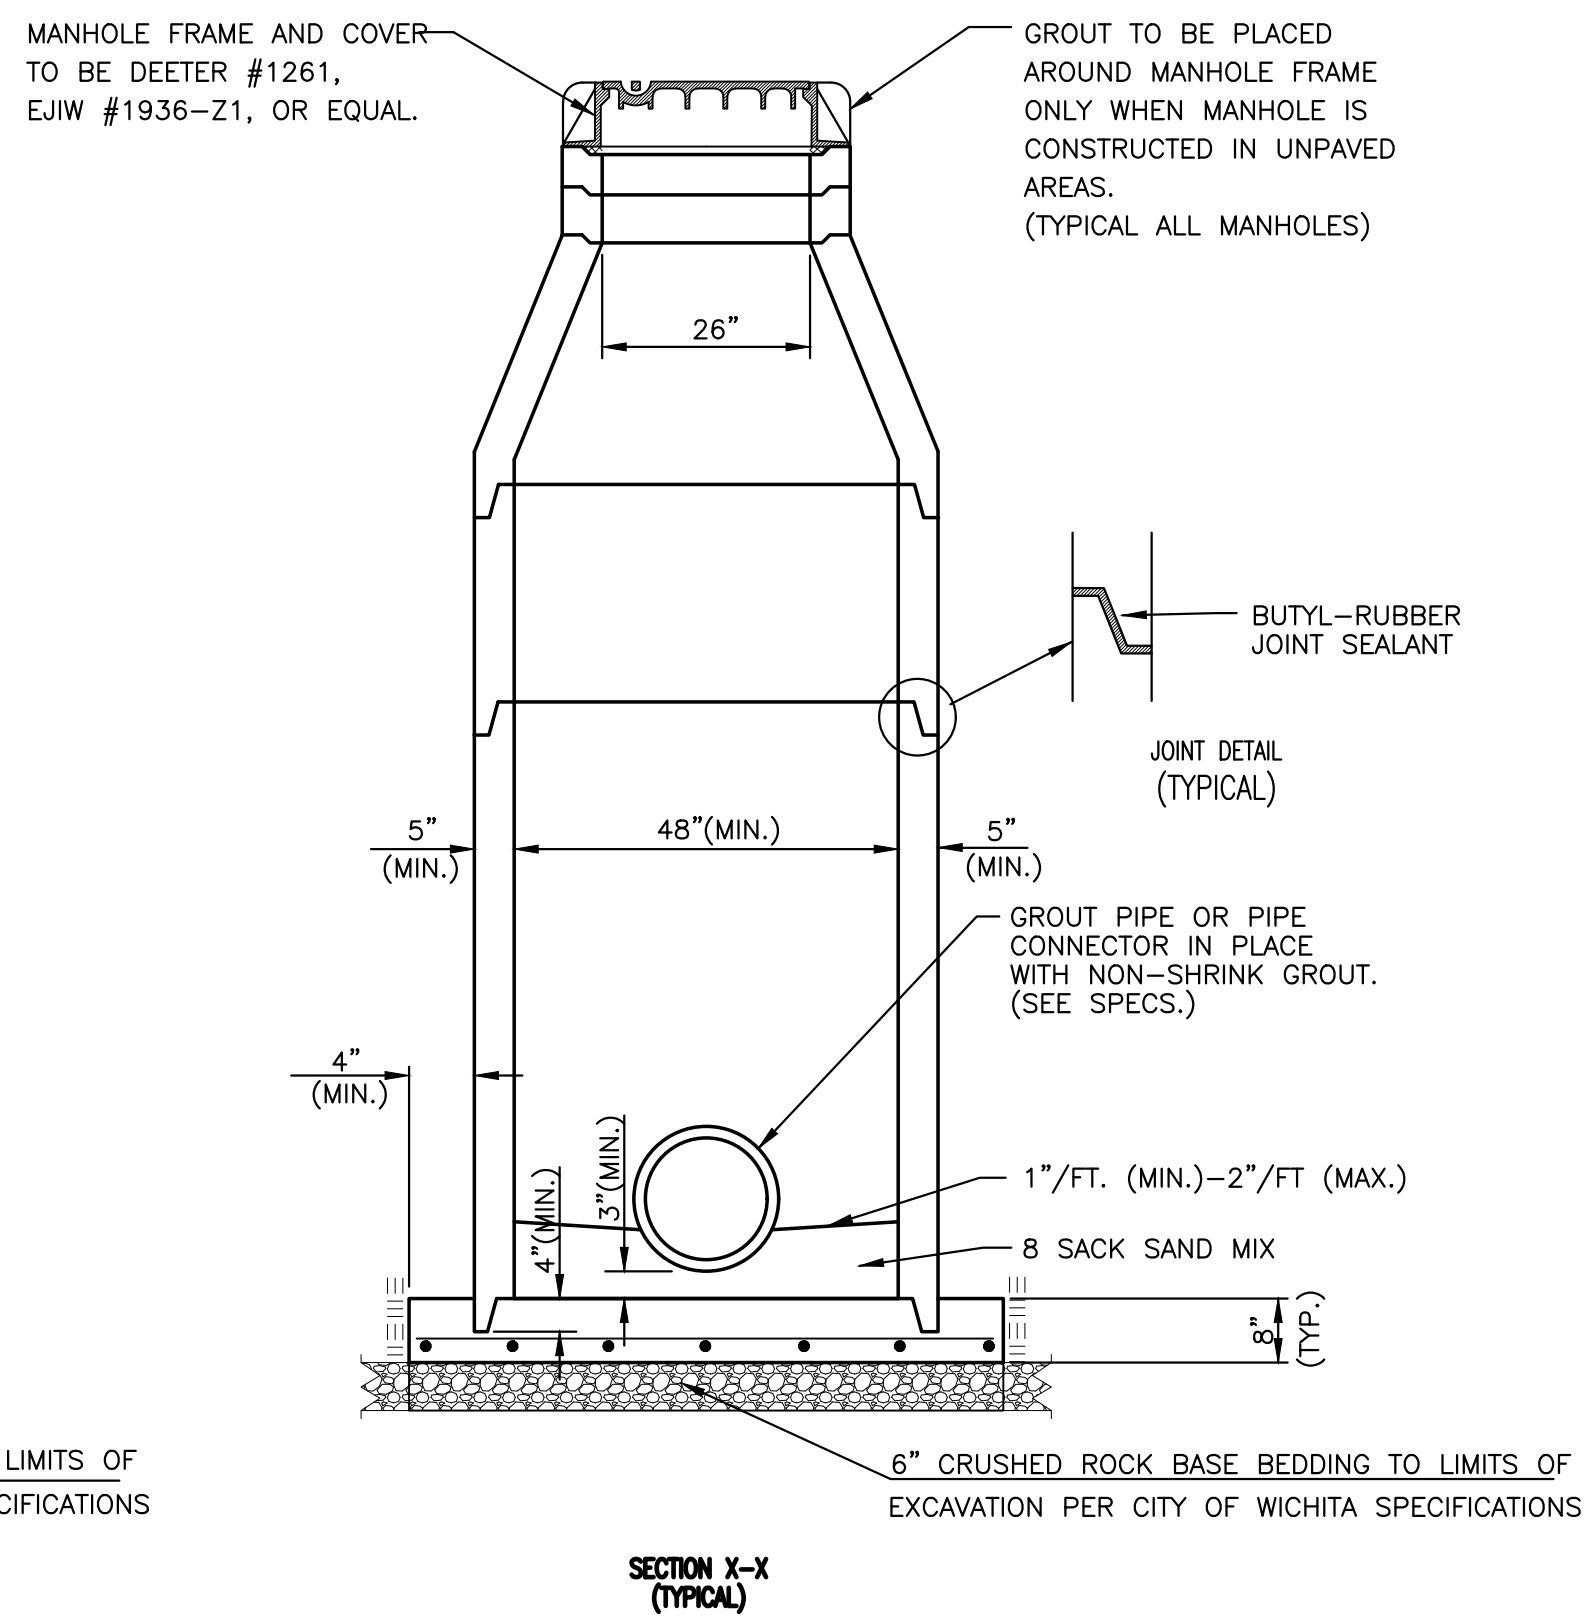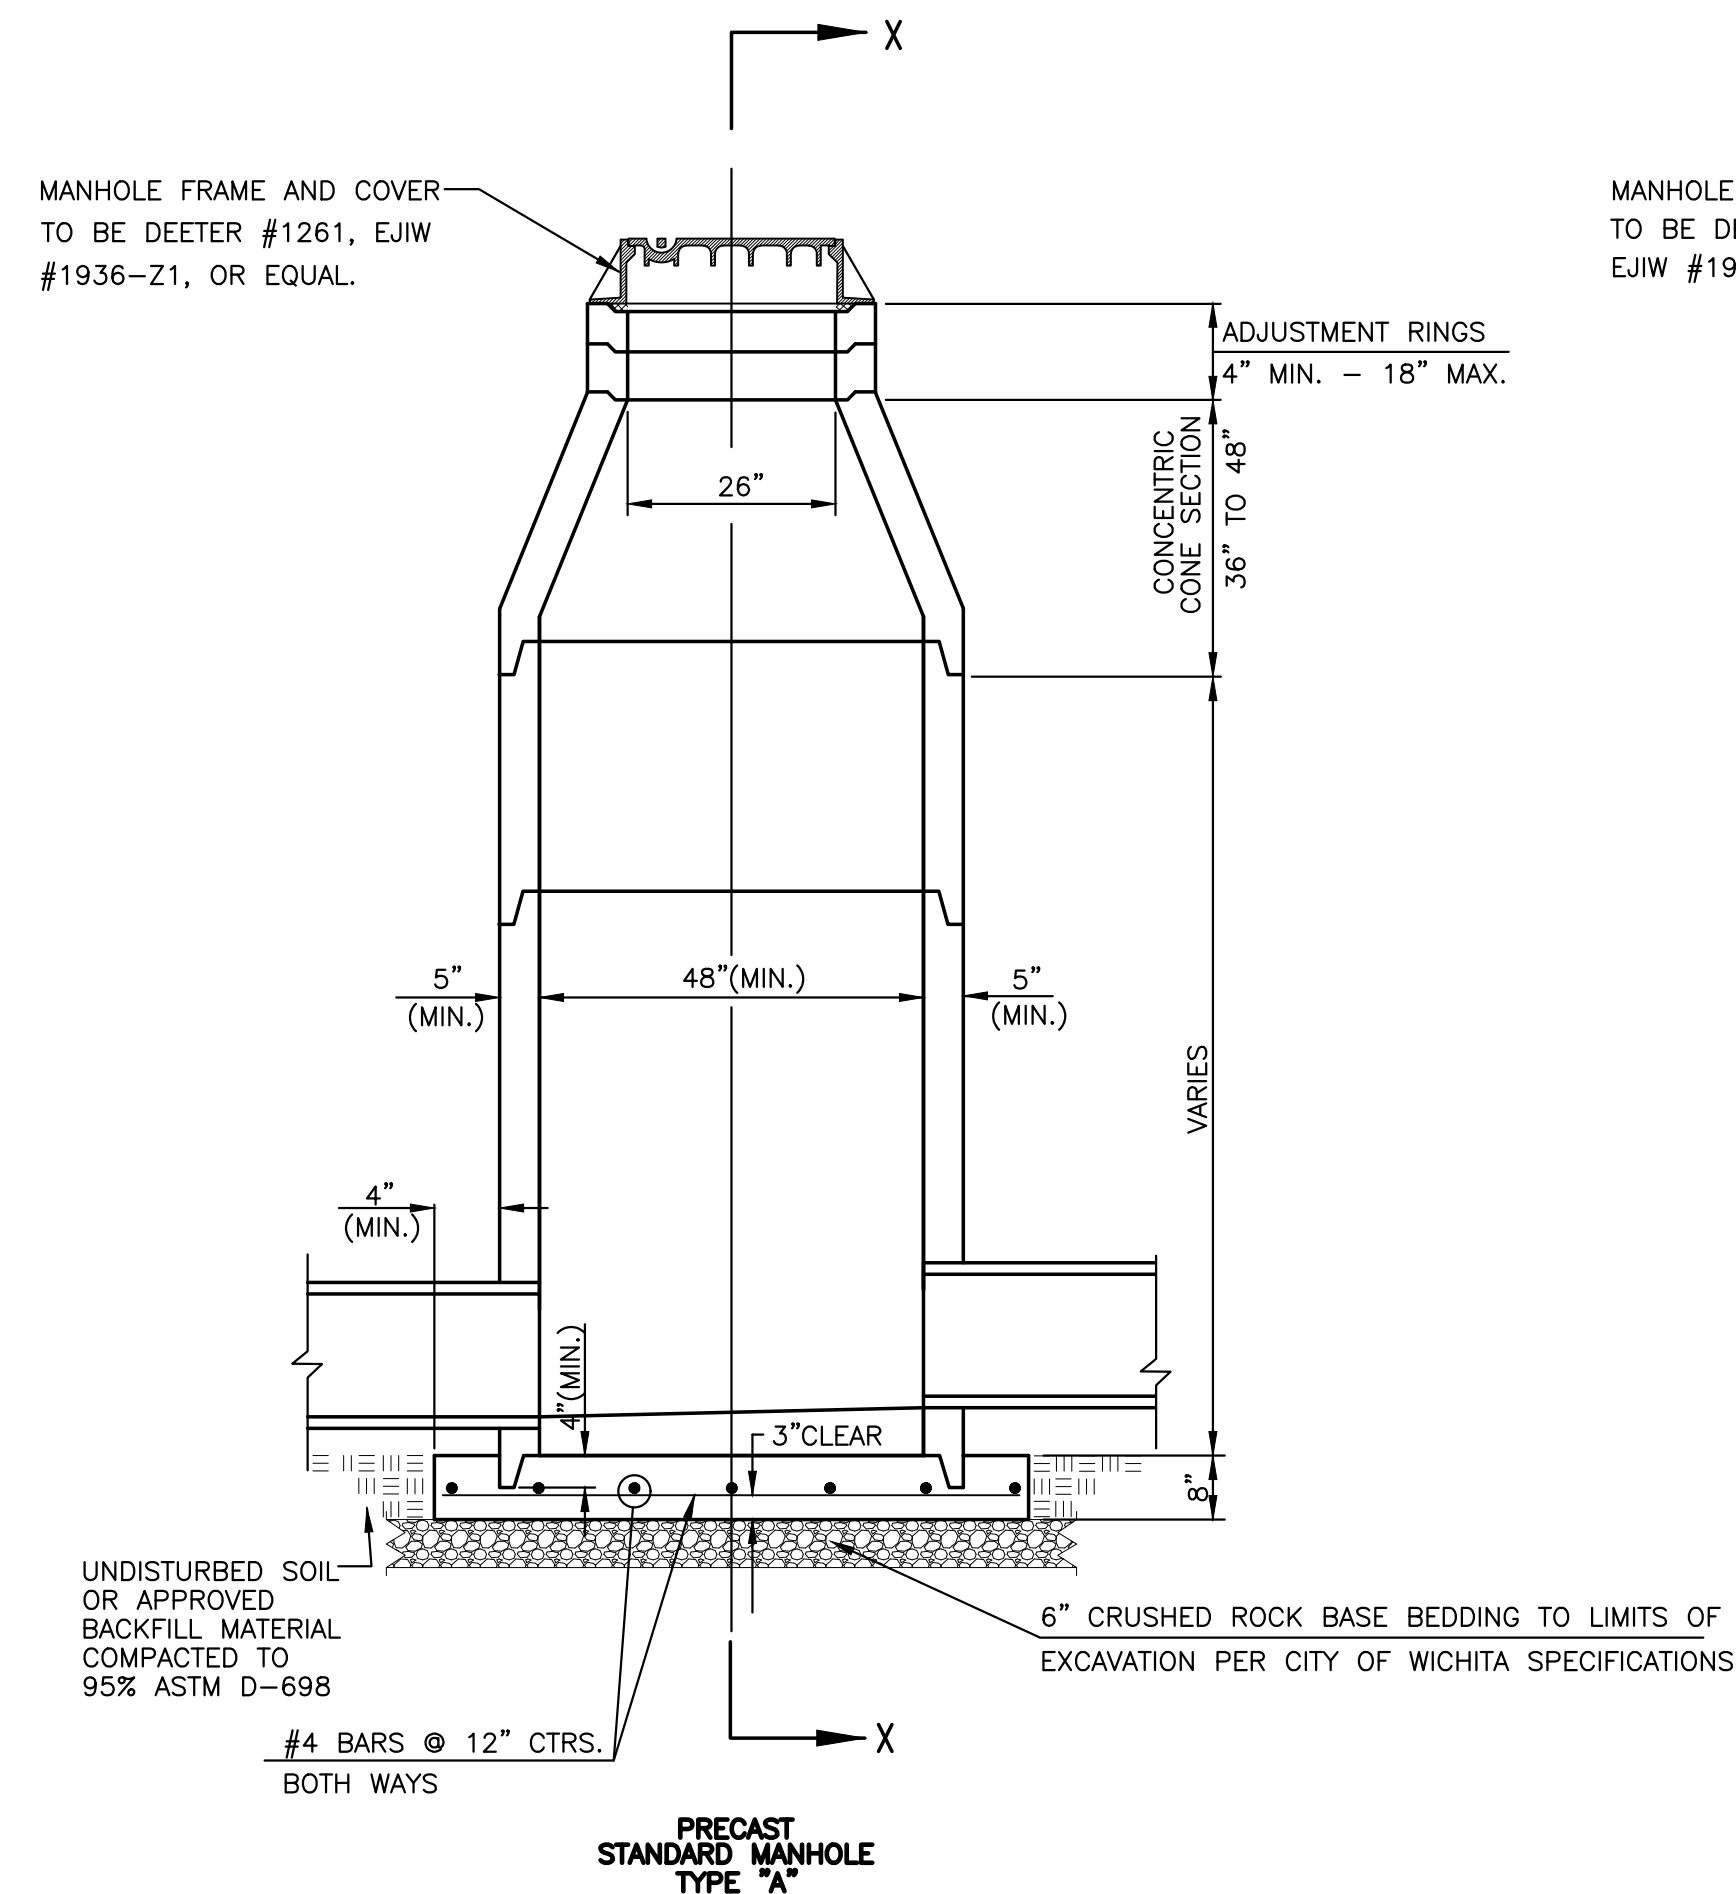

GENERAL NOTES

- IF, IN THE OPINION OF THE ENGINEER, THE MANHOLE SUBGRADE APPEARS UNSTABLE, THE CONTRACTOR WILL HAVE THE OPTION TO COMPACT SUBGRADE AS SHOWN OR INCREASE THE THICKNESS OF THE MANHOLE BASE AS DIRECTED BY THE ENGINEER.
- STEEL REINFORCING WILL BE REQUIRED IN ALL MANHOLE BASES.
- ALL MANHOLE CONSTRUCTION SHALL BE WATER TIGHT.
- TOP OF MANHOLE FLOOR SLAB SHALL BE AT LEAST 3 INCHES BELOW THE FLOW LINE OF THE OUTLET PIPE TO INSURE SUFFICIENT MINIMUM THICKNESS OF SHAPED INVERT.
- ALL PRECAST CONCRETE MANHOLE SECTIONS SHALL CONFORM TO THE LATEST REVISION OF ASTM C-478 AS MODIFIED BY THE SPECIFICATIONS.
- CONCRETE USED FOR MANHOLE CONSTRUCTION SHALL CONFORM TO CITY OF WICHITA SPECIFICATIONS FOR CONCRETE PAVEMENT MIX.
- PRECAST MANHOLES SHALL BE SET AT LEAST 4 INCHES INTO MANHOLE BASE.
- MANHOLES WITH PIPE SIZES 24" AND LARGER SHALL HAVE 5 FOOT INSIDE DIAMETER (MIN.)
- MANHOLES WITH PRECAST BASES MAY BE USED AT THE CONTRACTORS OPTION. THESE MANHOLES SHALL HAVE AN 8" MINIMUM BASE THICKNESS AND SHALL BE PLACED ON AN 8" MIN. CRUSHED ROCK BASE. PIPES SHALL BE ENCASED WITH CRUSHED ROCK TO AT LEAST 3 FEET FROM THE MANHOLE WALL.
- CONTRACTOR SHALL REMOVE LIFTING HOOKS AFTER INSTALLATION. RECESSES IN MANHOLE WALL SHALL BE GROUTED FLUSH TO THE MANHOLE WALL WITH HYDRAULIC CEMENT AFTER THE MANHOLE IS IN PLACE. LIFTING HOLES THRU THE MANHOLE WALL WILL NOT BE ACCEPTED.
- THE ENDS OF ALL PIPES IN MANHOLES SHALL BE CUT OFF FLUSH WITH THE INSIDE FACE OF THE MANHOLE WALL.
- MANHOLE INVERT SHALL BE SHAPED WITH 8 SACK SAND MIX CONCRETE TO CREATE FLOW CHANNELS AND TO INCREASE HYDRAULIC EFFICIENCY SUCH THAT THE MANHOLE WILL BE SELF CLEANING BETWEEN ALL INLET AND/OR OUTLET PIPES.
- MANHOLE FRAME AND COVER TO BE DEETER #1261, EJIW #1936-Z1, OR APPROVED EQUAL, SEE SW-303.
- FOR FLAT GRATED INLET APPLICATION, GRATE TO BE DEETER #1933, EJIW #1205 MDI, OR APPROVED EQUAL.
- FOR BEEHIVE GRATE APPLICATION, GRATE TO BE DEETER #4495, EJIW #120545, OR APPROVED EQUAL.


PLOTTED BY: BRYAN SMITH 4/22/2026 4:45 PM
 DWG PATH: J:\PROJECTS\2025\2501010800_THE RESERVE AT THE MEADOWS\010800 CAD\BISHOP CIVILISTE
 DWG NAME: 2501010800 STORM MANHOLE DETAILS.DWG
 ©2026 MKEC ENGINEERING, INC. ALL RIGHTS RESERVED WWW.MKEC.COM THESE DRAWINGS AND THEIR CONTENTS, INCLUDING, BUT NOT LIMITED TO, ALL CONCEPTS, DESIGNS, & IDEAS ARE THE EXCLUSIVE PROPERTY OF MKEC ENGINEERING, INC. (MKEC) AND MAY NOT BE USED OR REPRODUCED IN ANY WAY WITHOUT THE EXPRESS CONSENT OF MKEC.

STORM MANHOLE DETAILS

PROJECT NO.	2501010800
SCALE	NTS
DRAWN	CNA
DESIGNED	TMBB
CHECKED	SPE

0	ISSUED FOR PERMIT	04/03/26
NO.	REVISION	DATE




SHEET NO.
C-453

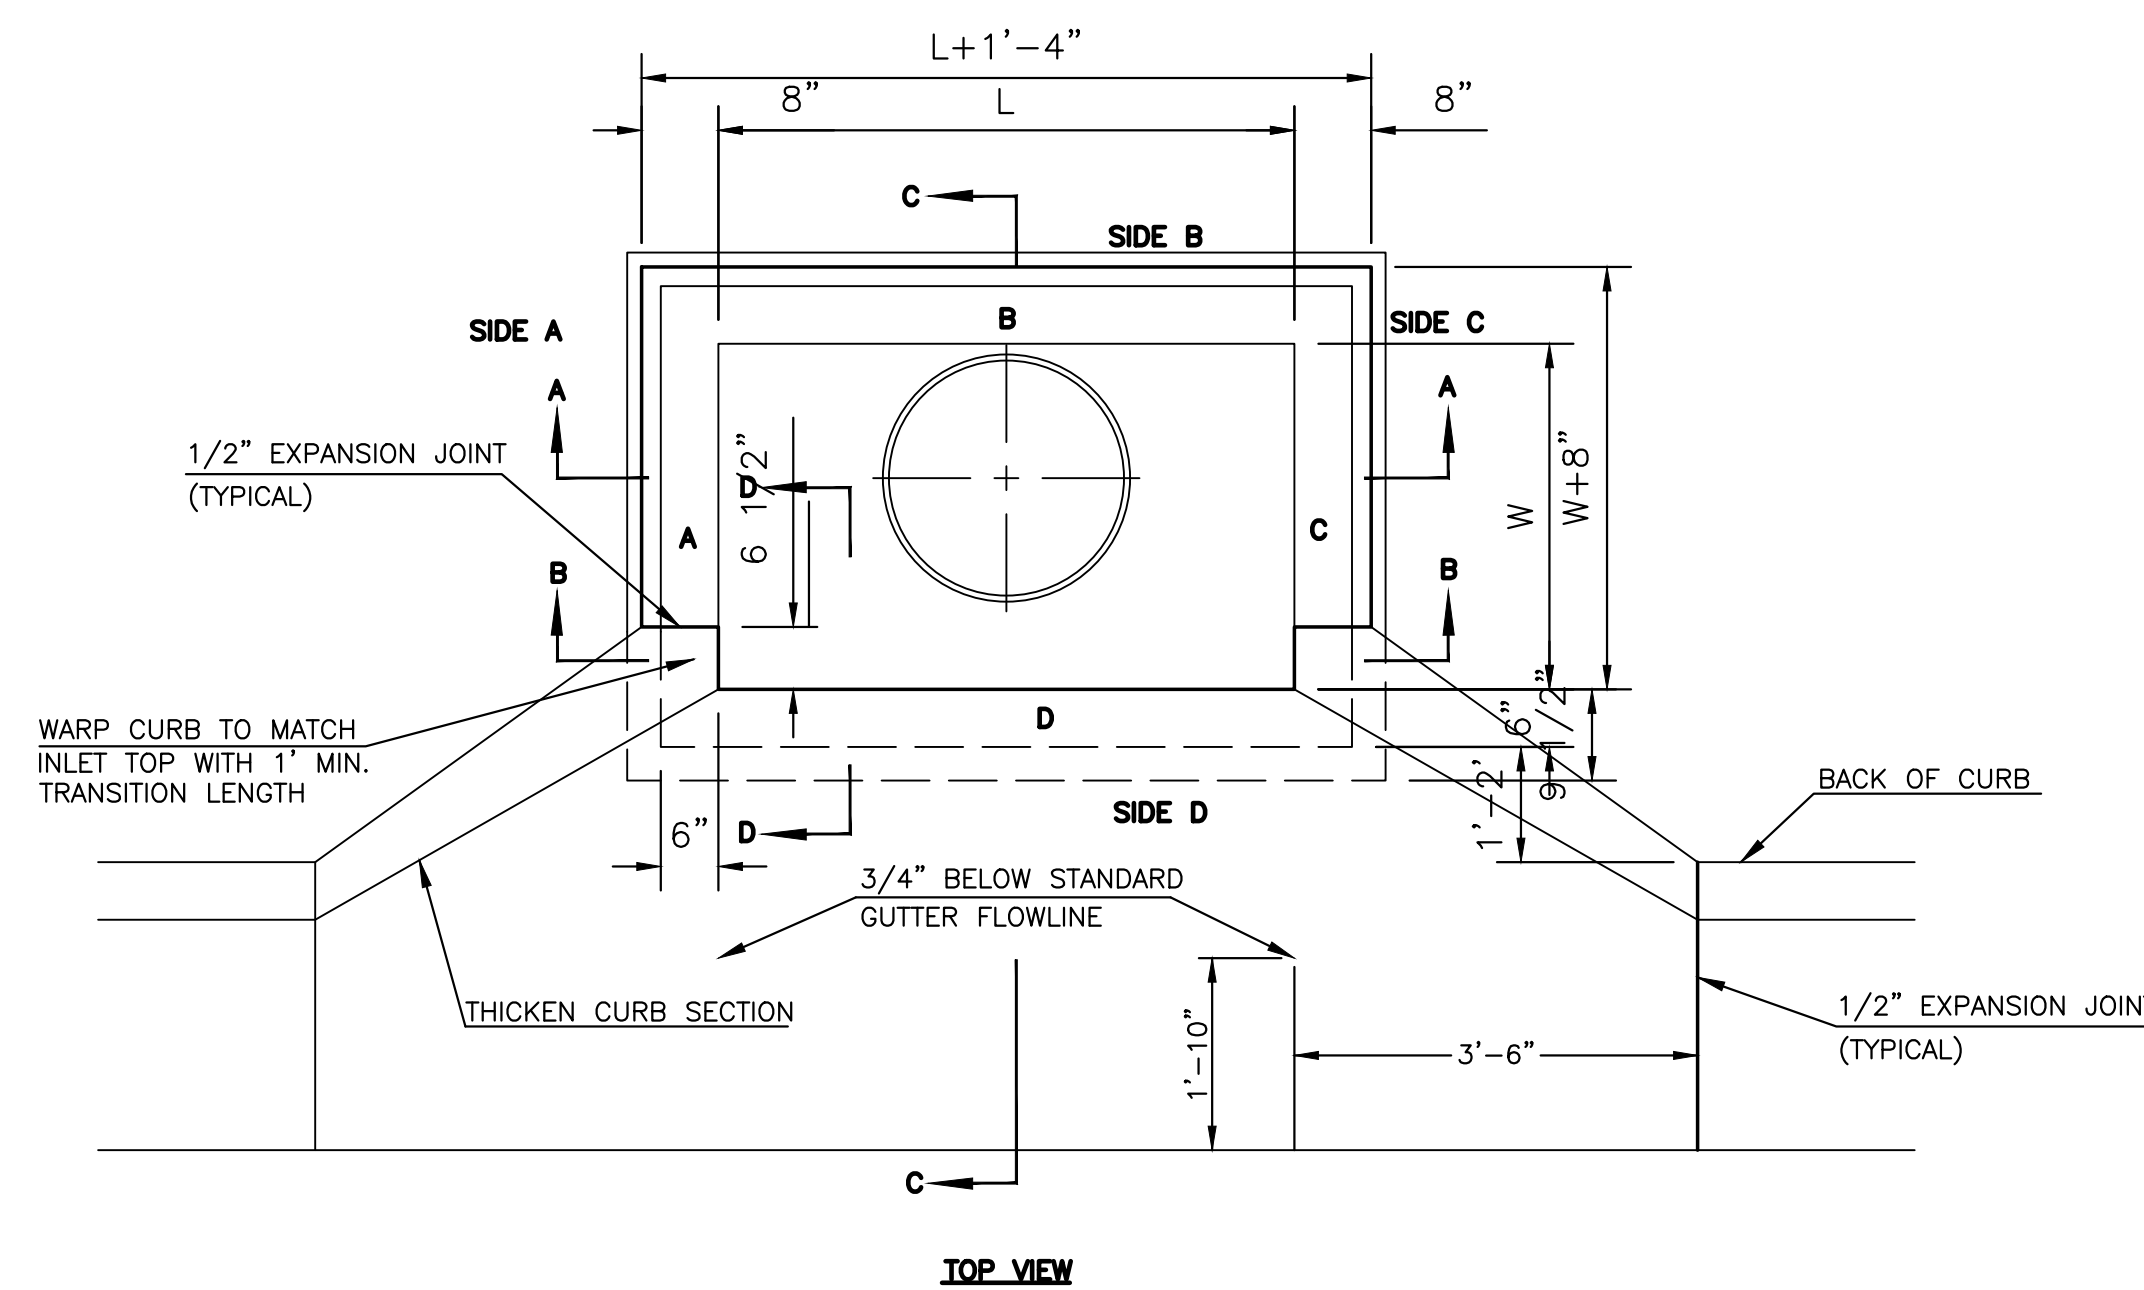

BAR SCHEDULE		
INLET OPENING	B1 BARS	SPACING
5'-0"	#4	4"
10'-0"	#6	3.5"



W	PRE-CAST TOP SIZE			PIPE DIA.**
	WIDTH	LENGTH	TOP	
3'-0"	W+8"	L+1'-4"	7 1/2"	21" & SMALLER
4'-0"	W+8"	L+1'-4"	7 1/2"	24" & 30"
5'-0"	W+8"	L+1'-4"	7 1/2"	36" & 42"
6'-0"	W+8"	L+1'-4"	7 1/2"	48" & 54"
7'-0"	W+8"	L+1'-4"	7 1/2"	60" & 66"

** FOR PIPES PERPENDICULAR TO INLET WALL

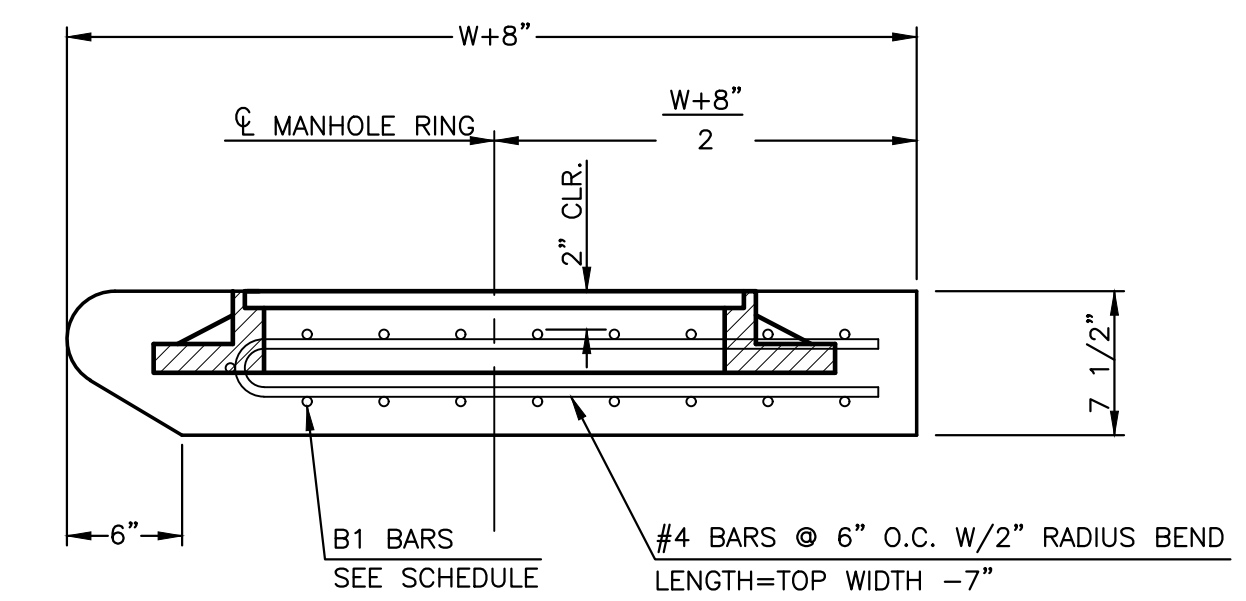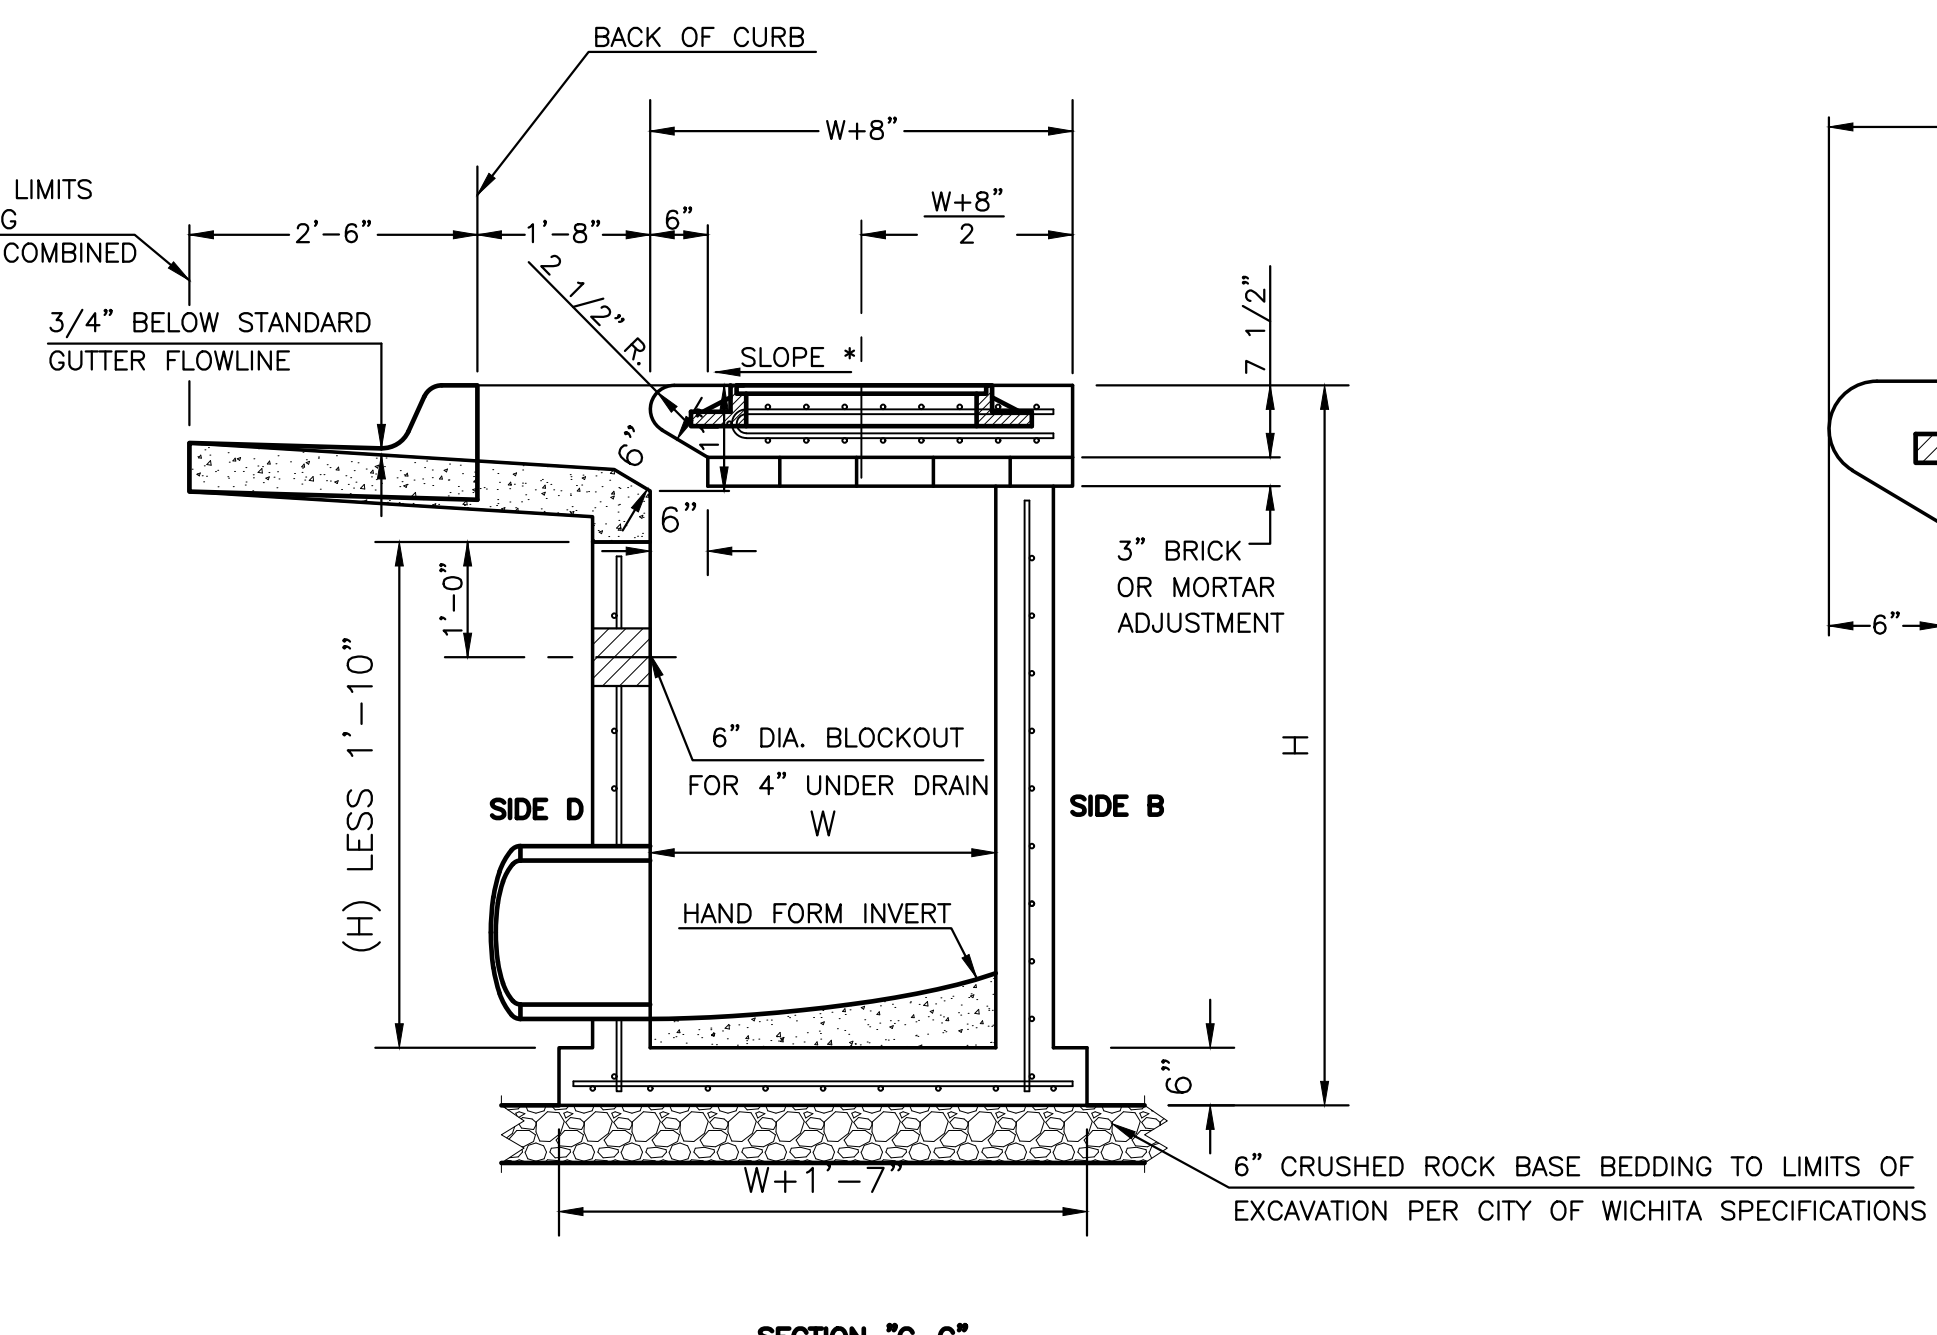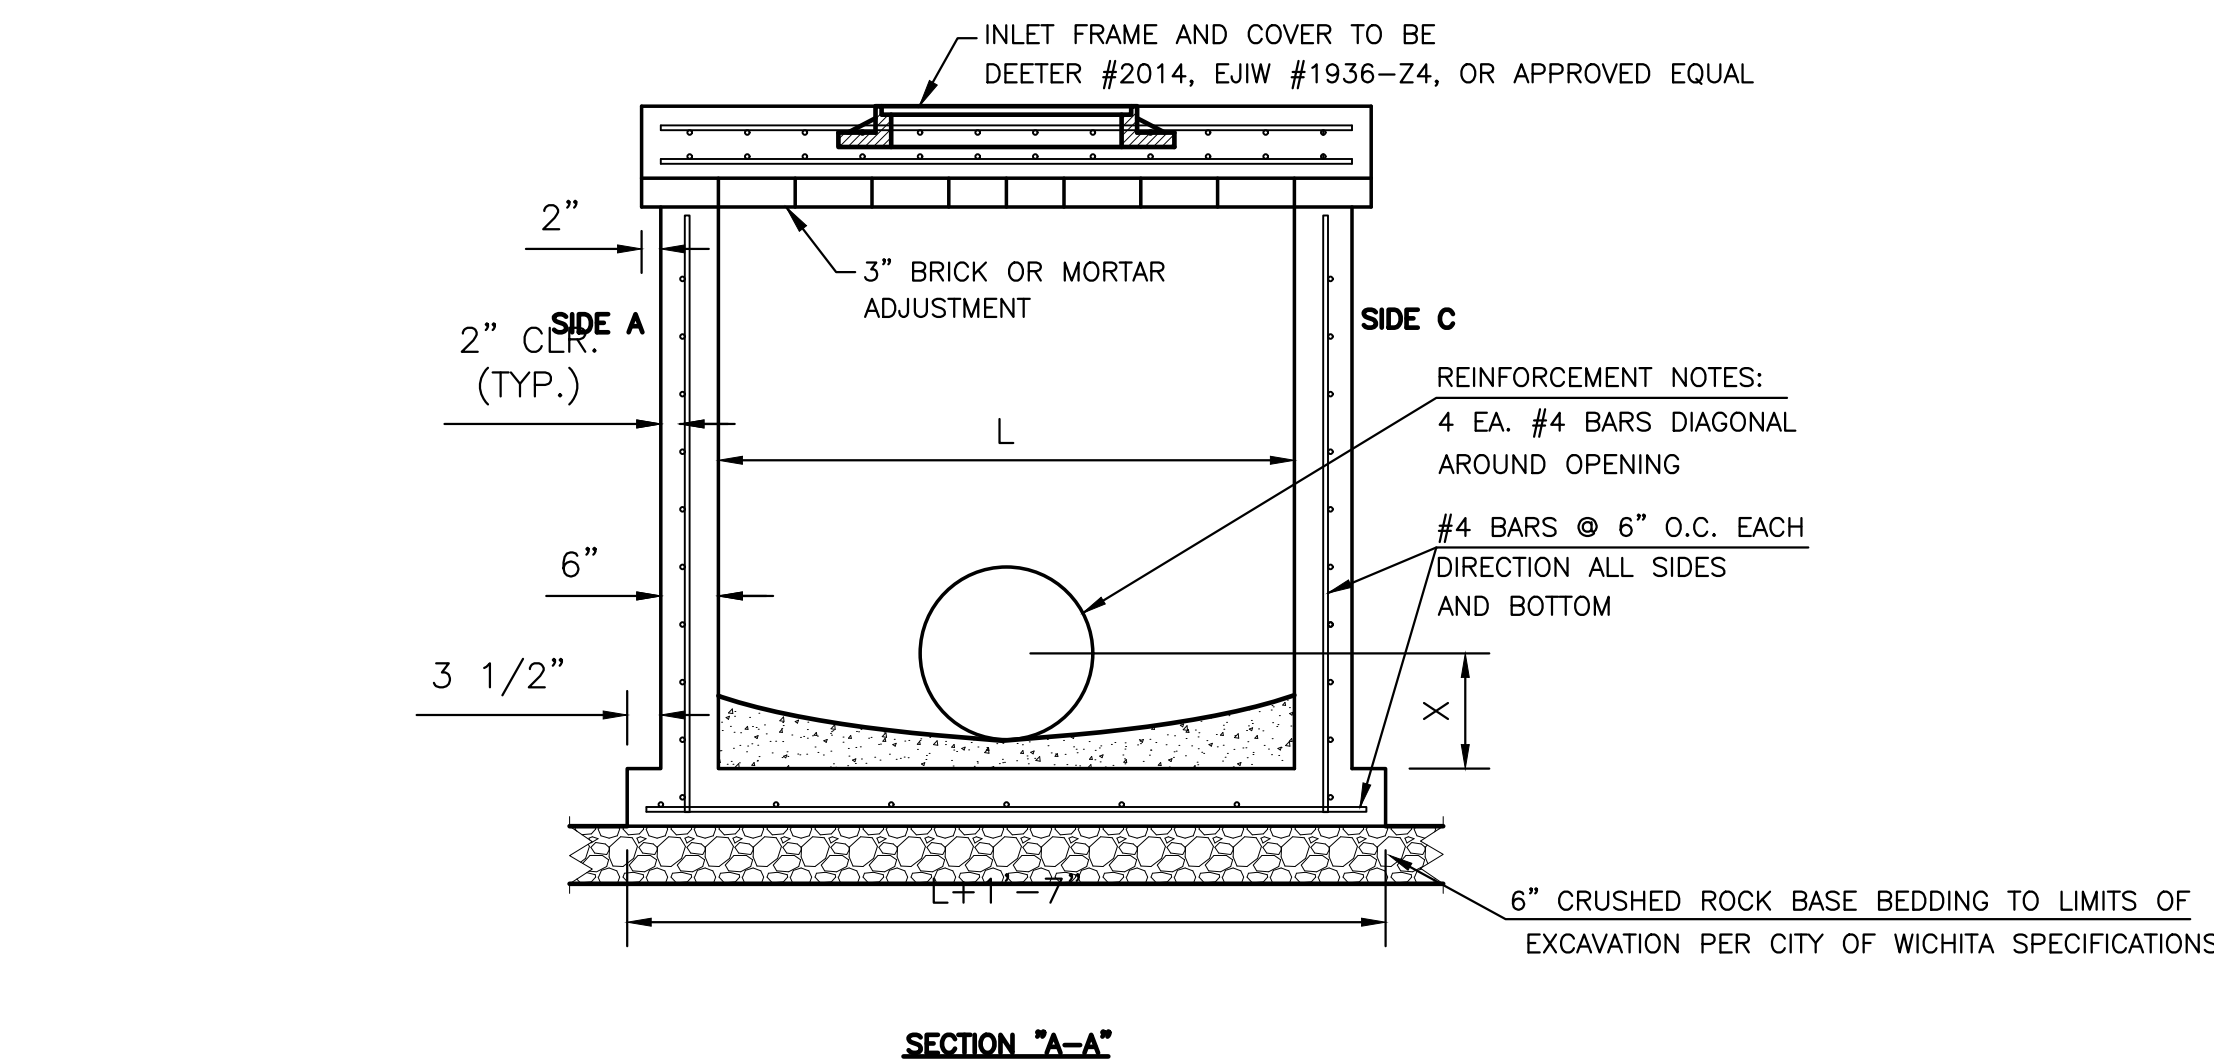

GENERAL NOTES

- CONCRETE TOPS TO BE INSTALLED ON THIN MORTAR CUSHION TO INSURE FULL SUPPORT ALONG BRICK. CONCRETE TOPS MAY BE CAST IN PLACE OR PRECAST. CONCRETE USED FOR INLET CONSTRUCTION SHALL CONFORM TO CITY OF WICHITA SPECIFICATIONS FOR CONCRETE PAVEMENT MIX.
- CONTRACTOR SHALL HAVE THE OPTION OF CONSTRUCTING 8" BRICK MASONRY WALLS BETWEEN THE CONCRETE INLET BASE AND TOP OF THIS INLET WHEN W=5'-0" AND H=7'-0" OR LESS.
- INLET INVERT SHALL BE SHAPED WITH 8 SACK SAND MIX CONCRETE TO CREATE FLOW CHANNELS AND TO INCREASE HYDRAULIC EFFICIENCY SUCH THAT THE INLET WILL BE SELF CLEANING BETWEEN ALL INLET AND/OR OUTLET PIPES.
- THE ENDS OF ALL PIPES INSTALLED IN INLETS SHALL BE CUT OFF FLUSH WITH THE INSIDE FACE OF THE INLET WALL.
- INLET FRAME AND COVER TO BE DEETER #2014, EJIW #1936-Z4, OR APPROVED EQUAL, SEE SW-303.
- CONTRACTOR SHALL REMOVE LIFTING HOOKS AFTER INSTALLATION. RECESSES IN INLET WALL SHALL BE GROUTED FLUSH TO THE INLET WALL WITH HYDRAULIC CEMENT AFTER THE INLET IS IN PLACE. LIFTING HOLES THRU THE INLET WALL WILL NOT BE ACCEPTED.

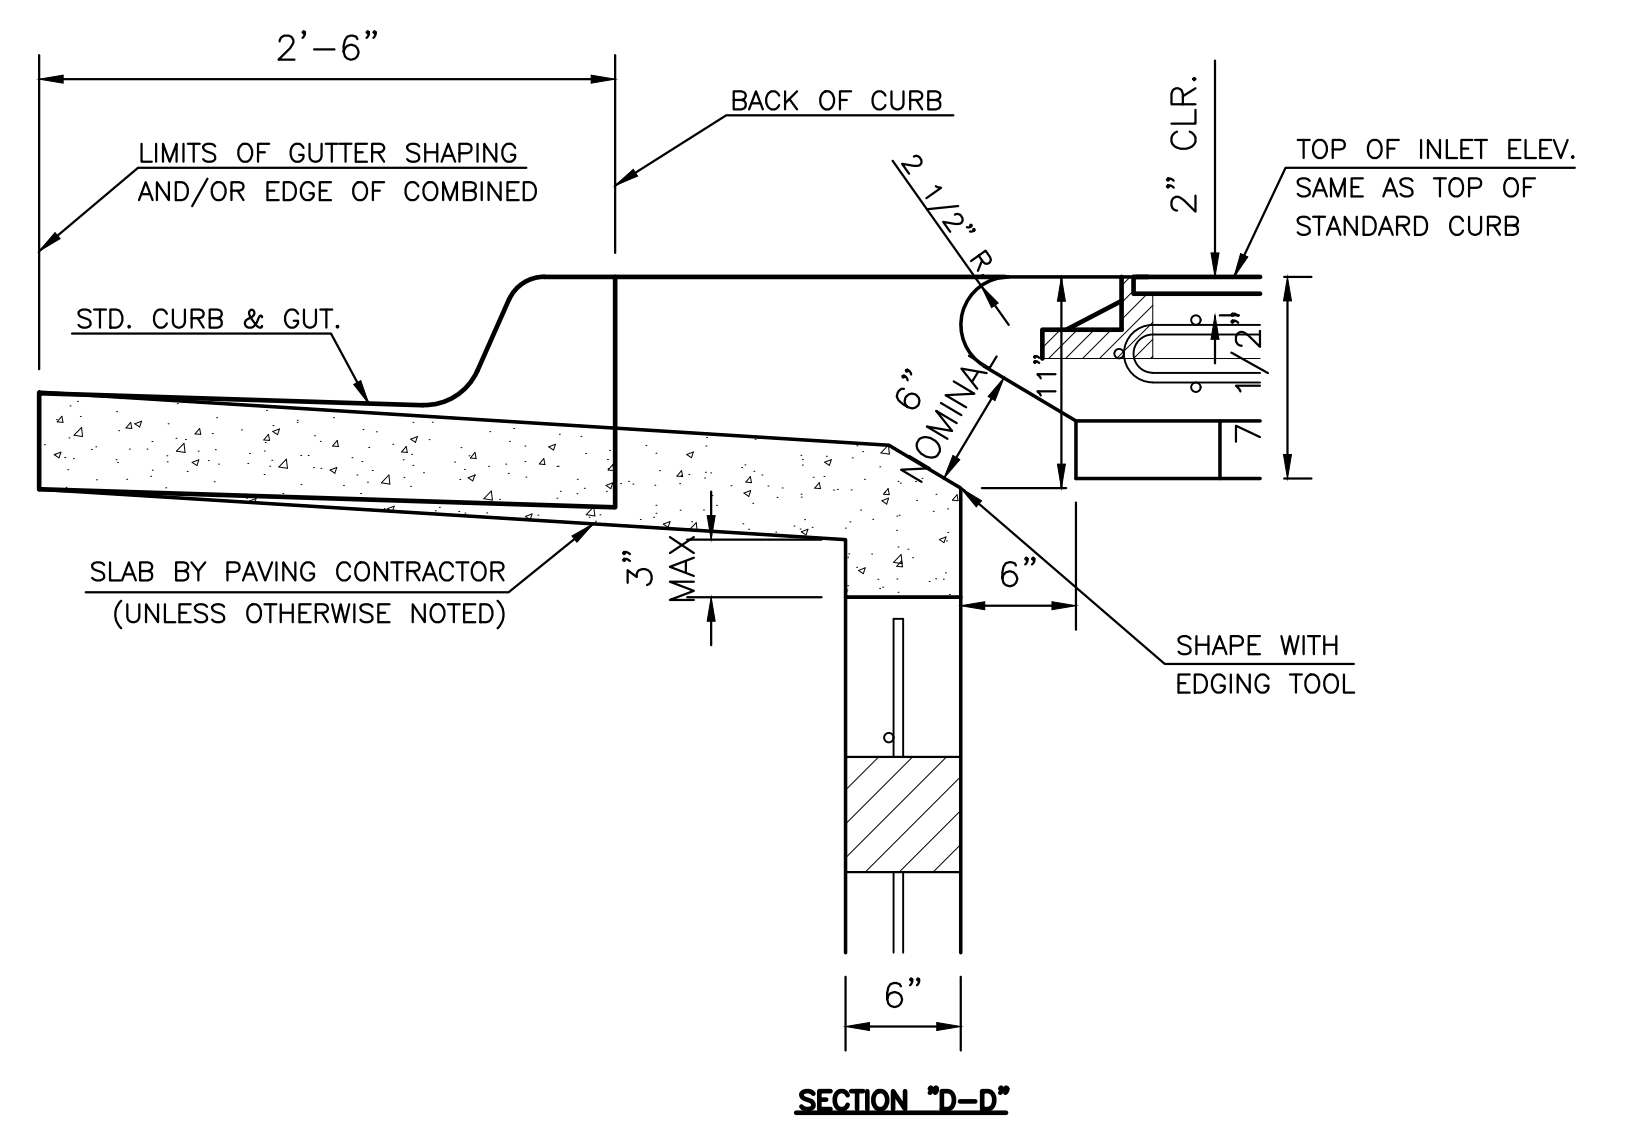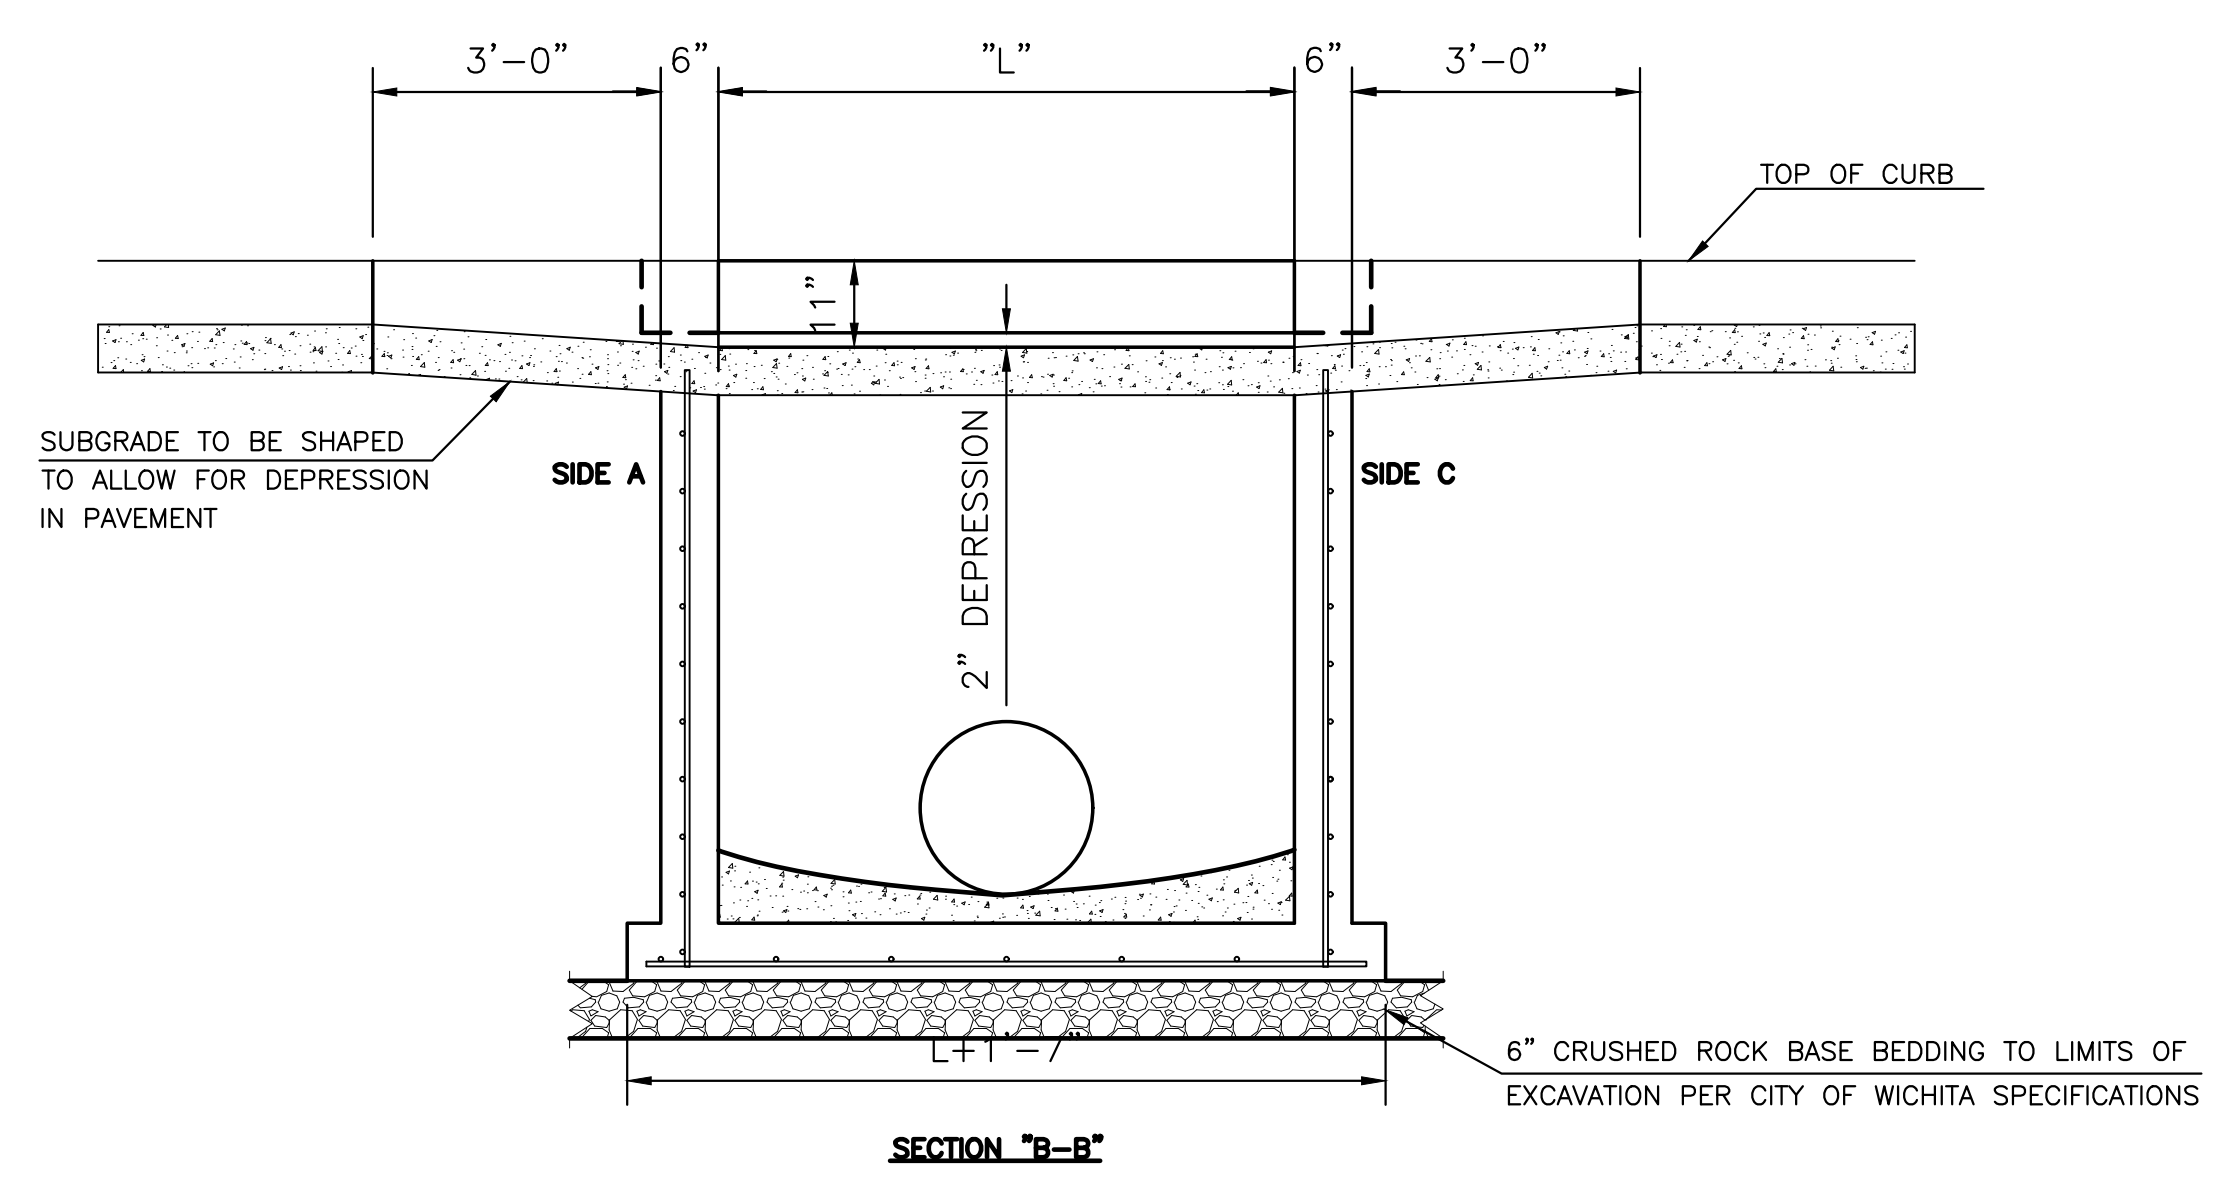

PLOTTED BY: BRYAN SMITH 4/22/2026 4:45 PM
 DWG PATH: J:\PROJECTS\2025\2501010800_JGR_THE RESERVE AT THE MEADOWS\DWG\CIVIL\TYPE 1A CURB INLET.dwg
 DWG NAME: 2501010800 TYPE 1A CURB INLET.dwg
 ©2026 MKEC ENGINEERING, INC. ALL RIGHTS RESERVED WWW.MKEC.COM THESE DRAWINGS AND THEIR CONTENTS, INCLUDING, BUT NOT LIMITED TO, ALL CONCEPTS, DESIGNS, & IDEAS ARE THE EXCLUSIVE PROPERTY OF MKEC ENGINEERING, INC. (MKEC) AND MAY NOT BE USED OR REPRODUCED IN ANY WAY WITHOUT THE EXPRESS CONSENT OF MKEC.

TYPE 1A CURB INLET	
PROJECT NO.	2501010800
SCALE	NTS
DRAWN	CNA
DESIGNED	TMBB
CHECKED	SPE
ISSUED FOR PERMIT	04/03/26
NO.	REVISION DATE
SHEET NO. C-454	



ENGINEER: SCOTT P. EVANS
 P.E. NO. 24223 EXP. 04/30/26

CIVIL PLANS FOR
THE RESERVE AT THE MEADOWS
 GODDARD, KS

NOTES

- EROSION CONTROL SHOULD MEET ALL FEDERAL, STATE, COUNTY AND LOCAL CODE STANDARDS.
- EROSION CONTROL MEASURES MAY ONLY BE PLACED IN FRONT OF INLETS, OR IN CHANNELS, DRAINAGE WAYS OR BORROW DITCHES AT RISK OF CONTRACTOR. CONTRACTOR SHALL REMAIN LIABLE FOR ANY DAMAGE CAUSED BY THE MEASURES, INCLUDING FLOODING DAMAGE, WHICH MAY OCCUR DUE TO BLOCKED DRAINAGE AT THE CONCLUSION OF ANY PROJECT. ALL CHANNELS, DRAINAGE WAYS AND BORROW DITCHES IN THE WORK ZONE SHALL BE DREDGED OF ANY SEDIMENT GENERATED BY THE PROJECT OR DEPOSITED AS A RESULT OF EROSION CONTROL MEASURES.
- SEE SEEDING NOTES FOR DISTURBED AREA STABILIZATION OUTSIDE OF HARDSCAPE AND LANDSCAPE AREAS.
- THE CONTRACTOR SHALL COMPLETE STABILIZATION WHEN SOIL DISTURBING ACTIVITIES CEASE TEMPORARILY AND WILL NOT RESUME FOR 14 DAYS OR MORE.
- CONTRACTOR SHALL PROVIDE EROSION PROTECTION THROUGHOUT PROJECT CONSTRUCTION. THE PLAN PROVIDED HERE WITHIN IS FOR FINAL PROTECTION. VARIOUS PHASES OF THIS PLAN SHALL BE IMPLEMENTED OR MODIFIED TO CONTROL EROSION.
- THE CONTRACTOR(S) ARE RESPONSIBLE FOR EROSION CONTROL IN CONFORMANCE WITH THE APPROVED DRAWINGS UNTIL PROJECT COMPLETION.
- ALL EXISTING AND PROPOSED EROSION CONTROL MEASURES SHALL BE INSTALLED PER THE STORMWATER POLLUTION PREVENTION PLAN (SWPPP) AND INFORMATION PROVIDED IN THESE PLANS AND MAINTAINED THROUGHOUT CONSTRUCTION BY THE CONTRACTOR UNTIL THE PROJECT IS COMPLETED AND THE EROSION CONTROL MEASURES ARE NO LONGER NEEDED. THE CONTRACTOR SHALL BE REQUIRED TO COMPLY WITH MAINTENANCE AND/OR REPLACEMENT OF EROSION CONTROL MEASURES AS DETERMINED BY THE ENGINEER UNTIL PROJECT IS ACCEPTED OR THE EROSION CONTROL MEASURES ARE NO LONGER NEEDED.
- IN ORDER TO PREVENT SILT OR SEDIMENT FROM ENTERING ADJACENT PROPERTIES, APPROPRIATE BMP'S SHALL BE IMPLEMENTED WITHIN THE PROJECT.
- ANY MUD TRACKED ONTO ADJACENT PAVED AREAS OR STREETS SHALL BE REMOVED AT THE END OF EACH WORK DAY.
- PER THE REQUIREMENTS OF THE NOI/SWPPP, BMP INSPECTION REPORTS SHALL BE COMPLETED BY THE CONTRACTOR WEEKLY AND WITHIN 24 HOURS AFTER A 1/2" RAIN. REPORTS SHALL BE KEPT WITH THE SWPPP ON SITE.
- LANDSCAPING ITEMS INCLUDING FENCE PROTECTION ARE SHOWN ON THIS PLAN FOR VISUAL PURPOSES ONLY. REF. LANDSCAPING PLANS FOR ALL TREE PRESERVATION, PROTECTION AND REMOVAL DESIGN ITEMS.
- CONTRACTOR SHALL PROVIDE A SIGN NEAR THE ENTRANCE WITH THE FOLLOWING INFORMATION:
 - A. CONTACT NAME AND INFORMATION
 - B. A COPY OF THE NOI
 - C. LOCATION OF SWPPP

TOTAL DISTURBED AREA = 5.2 ACRES


LEGEND

- 1456 PROPOSED CONTOURS
- 1455 EXISTING CONTOURS
- EXISTING SANITARY SEWER
- EXISTING WATER LINE
- EXISTING STORM WATER SEWER
- EXISTING GAS LINE
- EXISTING FIBER OPTIC LINE
- EXISTING FENCE
- PROPERTY LINE
- SETBACK LINE
- EASEMENT LINE
- PROPOSED SANITARY SEWER
- PROPOSED STORM WATER SEWER
- PROPOSED WATER LINE
- PROPOSED DOMESTIC WATER LINE
- PROPOSED FIRE PROTECTION LINE
- PROPOSED FLOW LINE
- LIMITS OF DISTURBANCE
- SILT FENCE
- BACK OF CURB PROTECTION
- INLET PROTECTION
- CONSTRUCTION ENTRANCE
- FLOW ARROW

WARNING
 EXISTING UNDERGROUND UTILITIES IN THE AREA. CONTRACTOR IS RESPONSIBLE FOR DETERMINING THE HORIZONTAL AND VERTICAL LOCATION OF ALL UTILITIES PRIOR TO CONSTRUCTION. CONTRACTOR IS RESPONSIBLE FOR ANY REPAIRS TO EXISTING UTILITIES DUE TO DAMAGE INCURRED DURING CONSTRUCTION. CONTRACTOR SHALL NOTIFY THE ENGINEER OF ANY DISCREPANCIES ON THE PLANS.


SCALE: 1"=40'

PLOTTED BY: BRYAN SMITH 4/22/2026 4:45 PM
 DWG PATH: J:\PROJECTS\202501010800_JGR_THE RESERVE AT THE MEADOWS\00 CAD\BISHOP CIVILISTE
 DWG NAME: 250000 EROSION PLAN.DWG
 ©2026 MKEC ENGINEERING, INC. ALL RIGHTS RESERVED WWW.MKEC.COM THESE DRAWINGS AND THEIR CONTENTS, INCLUDING, BUT NOT LIMITED TO, ALL CONCEPTS, DESIGNS, & IDEAS ARE THE EXCLUSIVE PROPERTY OF MKEC ENGINEERING, INC. (MKEC) AND MAY NOT BE USED OR REPRODUCED IN ANY WAY WITHOUT THE EXPRESS CONSENT OF MKEC.

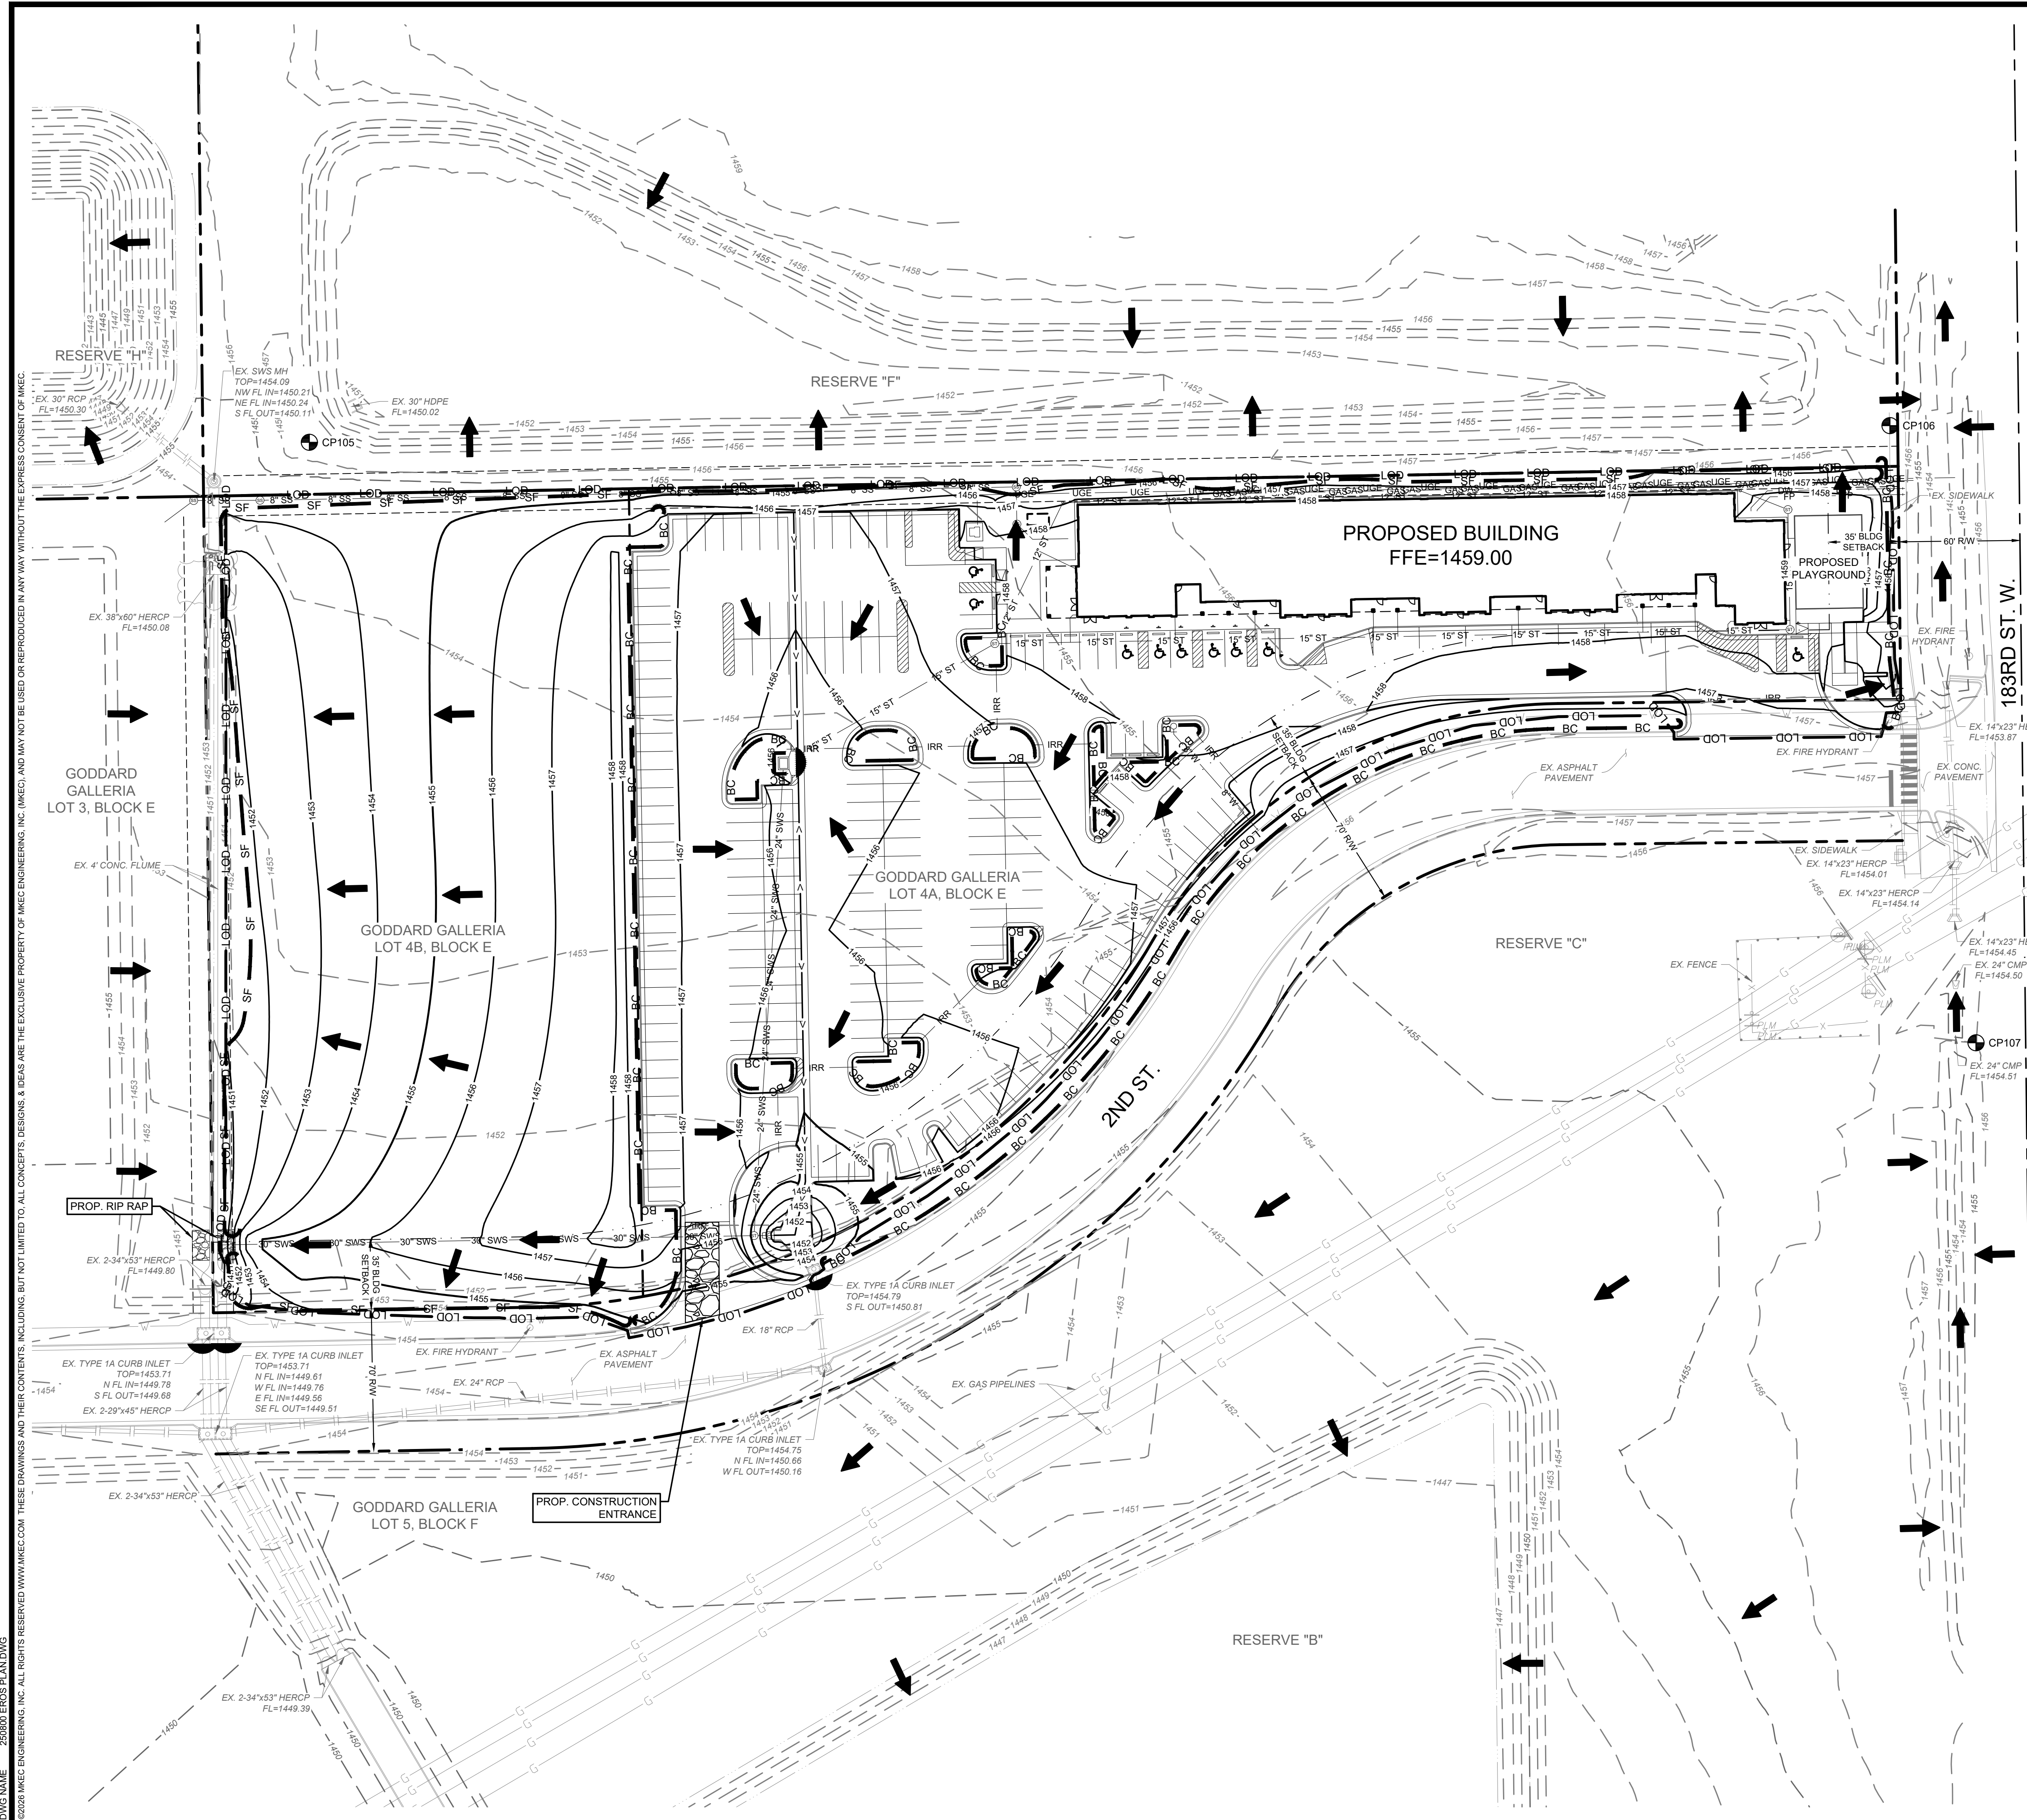


EROSION CONTROL PLAN

PROJECT NO.	2501010800	
SCALE	1"=40'	
DRAWN	DESIGNED	CHECKED
LES	TMBB	SPE
NO.	REVISION	DATE
0	ISSUED FOR PERMIT	04/03/26
SHEET NO. C-501		

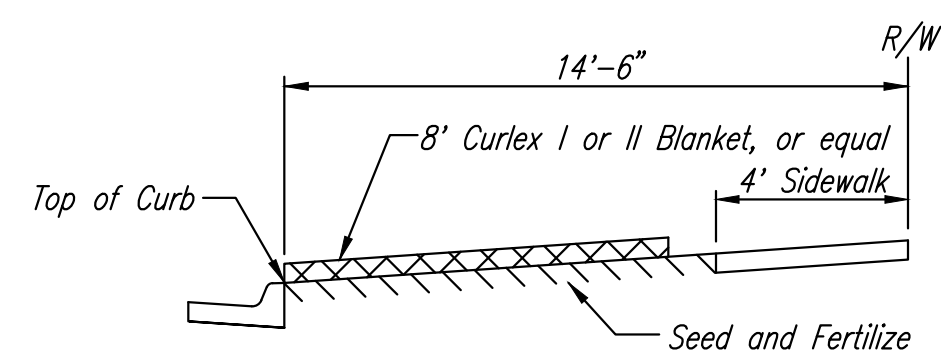


SECTION B-B

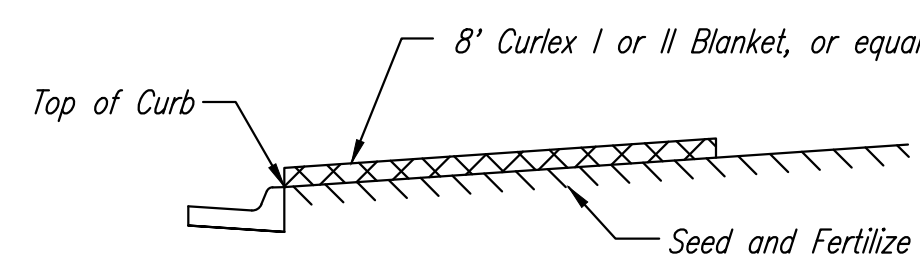


SECTION A-A

Install 8' wide Curlex I or II Excelsior Blanket, or equal, on prepared surface back of curb. Edge of blanket will be at back of curb. Install per manufacturer's recommendation, including staples. (See detail)

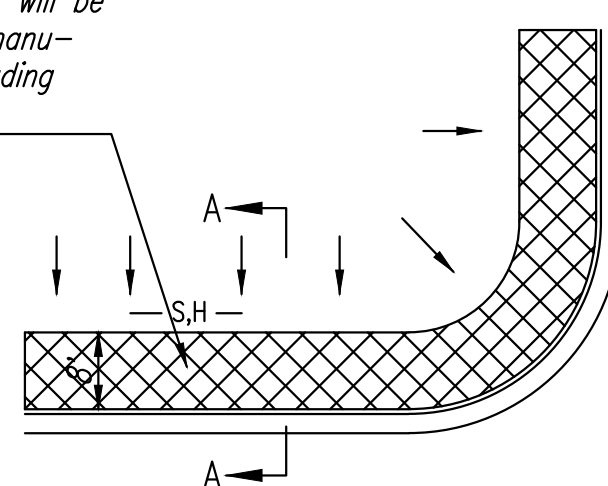

SOUTH STREET

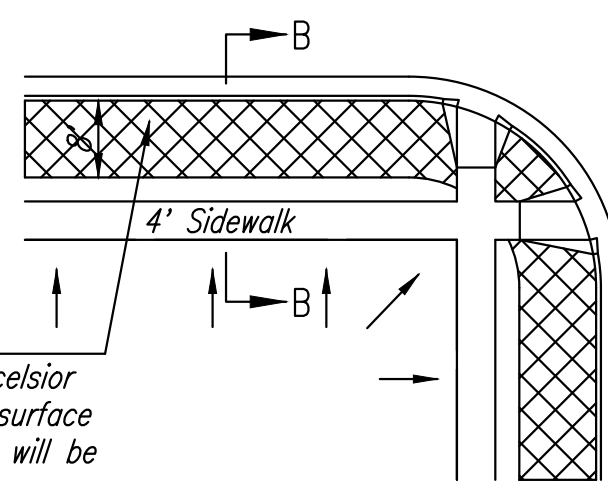


Install 8' wide Curlex I or II Excelsior Blanket, or equal, on prepared surface back of curb. Edge of blanket will be at back of curb. Install per manufacturer's recommendation, including staples. (See detail)

NOTES:

- EXCELSIOR MAT TO BE INSTALLED WHEN SOD IS NOT SPECIFIED ON PROJECT.
- EXCELSIOR BLANKET TO BE INSTALLED OVER SEED AND FERTILIZER, AS SPECIFIED IN THE PROJECT SPECIFICATIONS.
- AFTER INSTALLATION OF EXCELSIOR BLANKET, AT LOCATIONS WHERE CONCENTRATED FLOW CARRIES SEDIMENT OVER THE CURB AND INTO THE GUTTER, SUPPLEMENTAL EROSION CONTROL DEVICES WILL BE INSTALLED BY THE CONTRACTOR AS NEEDED, TO FIX THE PROBLEM.


BACK OF CURB PROTECTION DETAIL

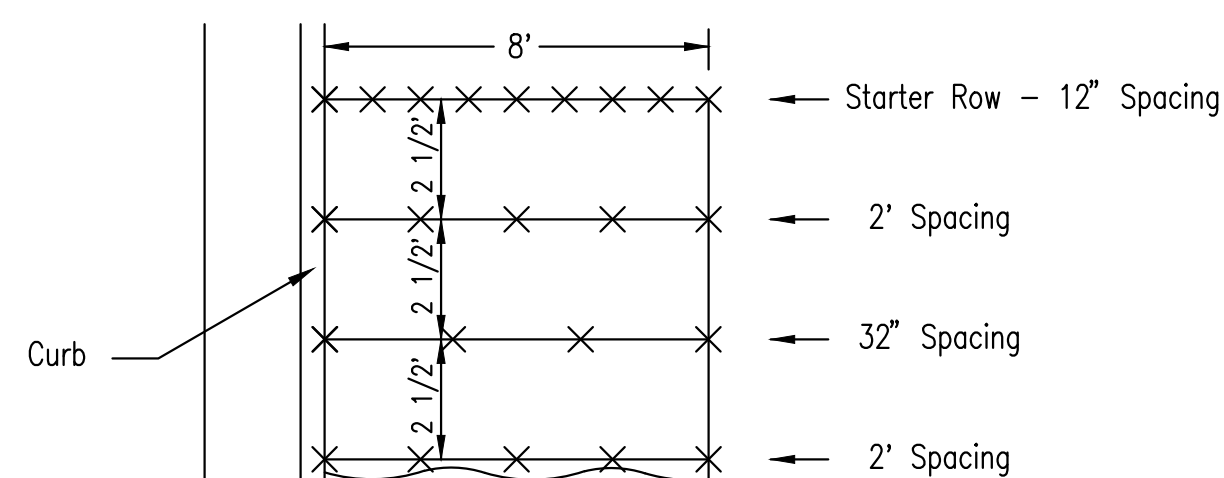

STAPLE PATTERN


NOTES: Use 6" seam overlap

DETAILS FOR CURLEX I OR II BLANKETS

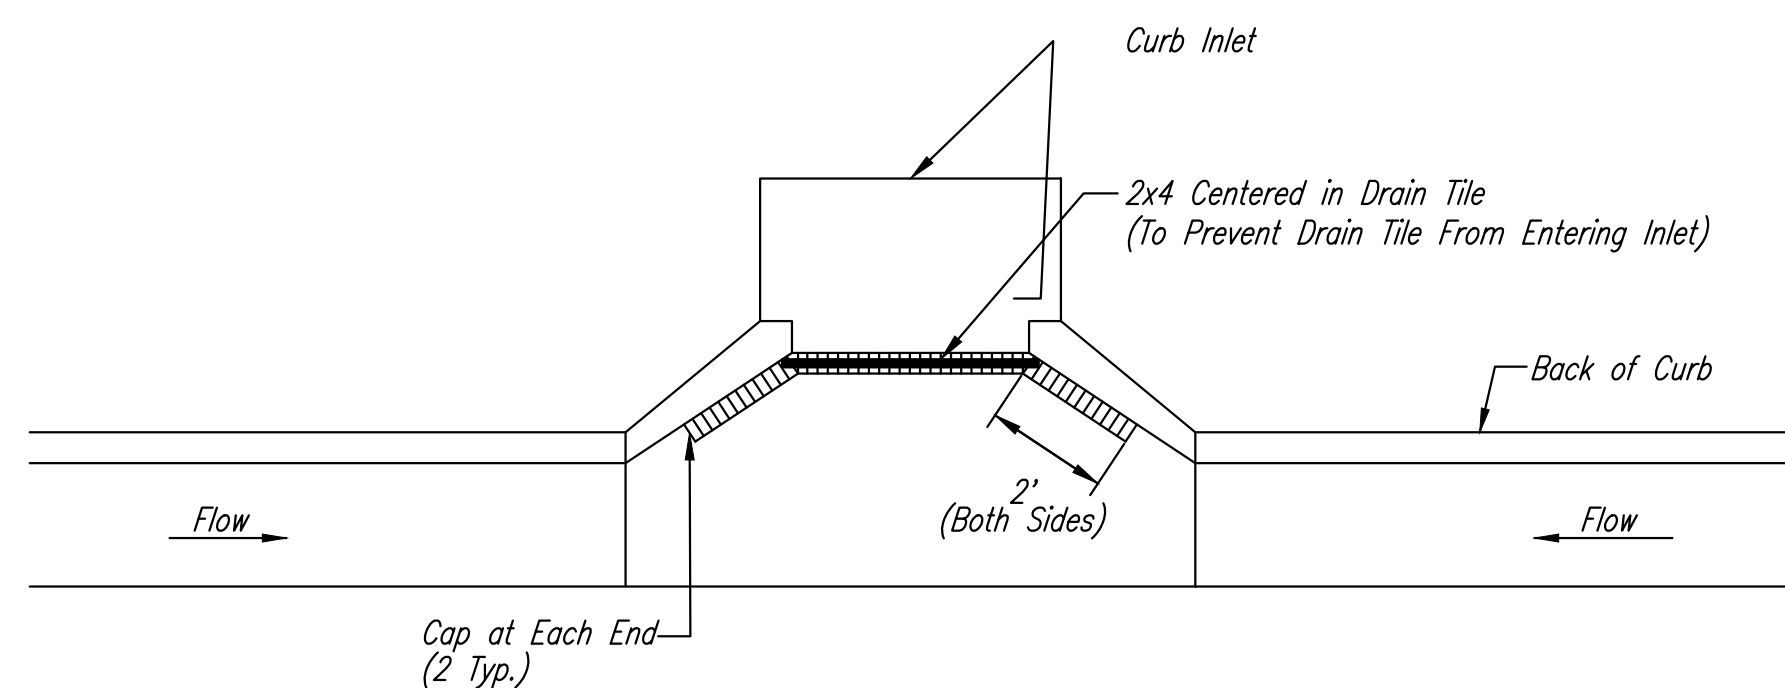


Note: Place 4" perforated PVC pipe, filled with 1/2"-1" dia. gravel, in front of curb inlet as shown.


2X4 LENGTH	INLET TYPE	INLET OPENING
5'-6"	1-A	5'-0"
10'-6"	1-A	10'-0"
15'-6"	1-A	15'-0"

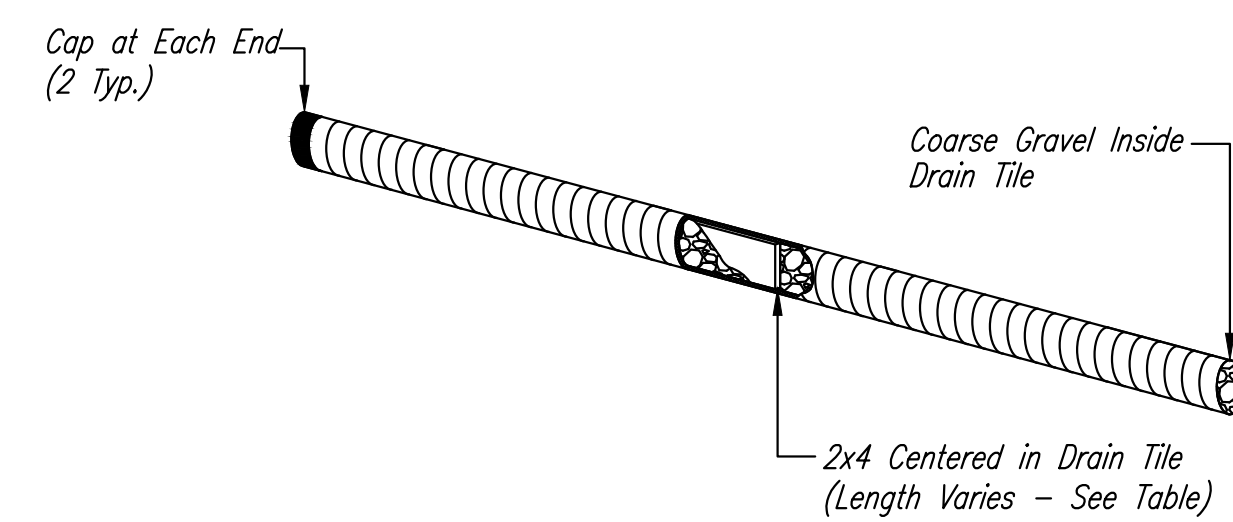

CURB INLET PROTECTION
4" PERFORATED PIPE W/ GRAVEL

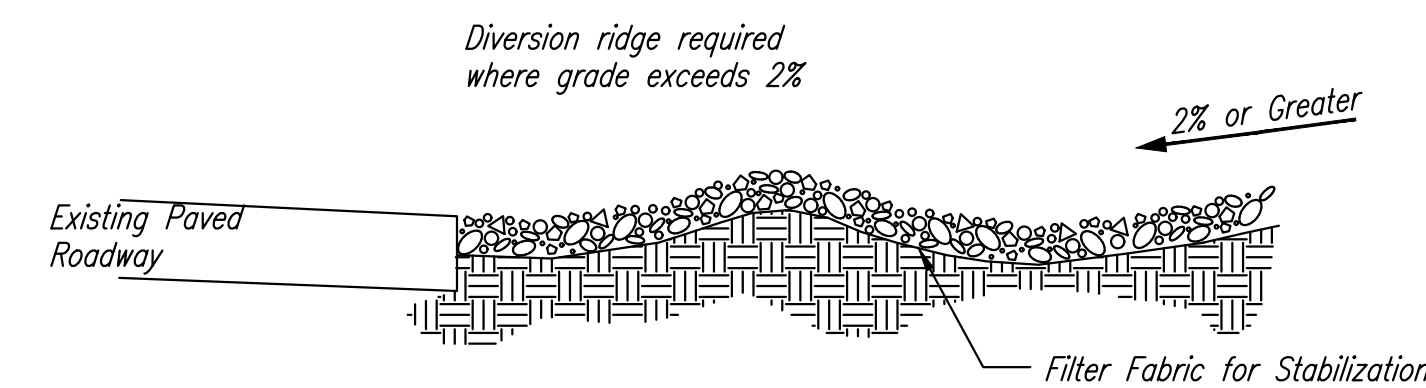

SECTION C-C

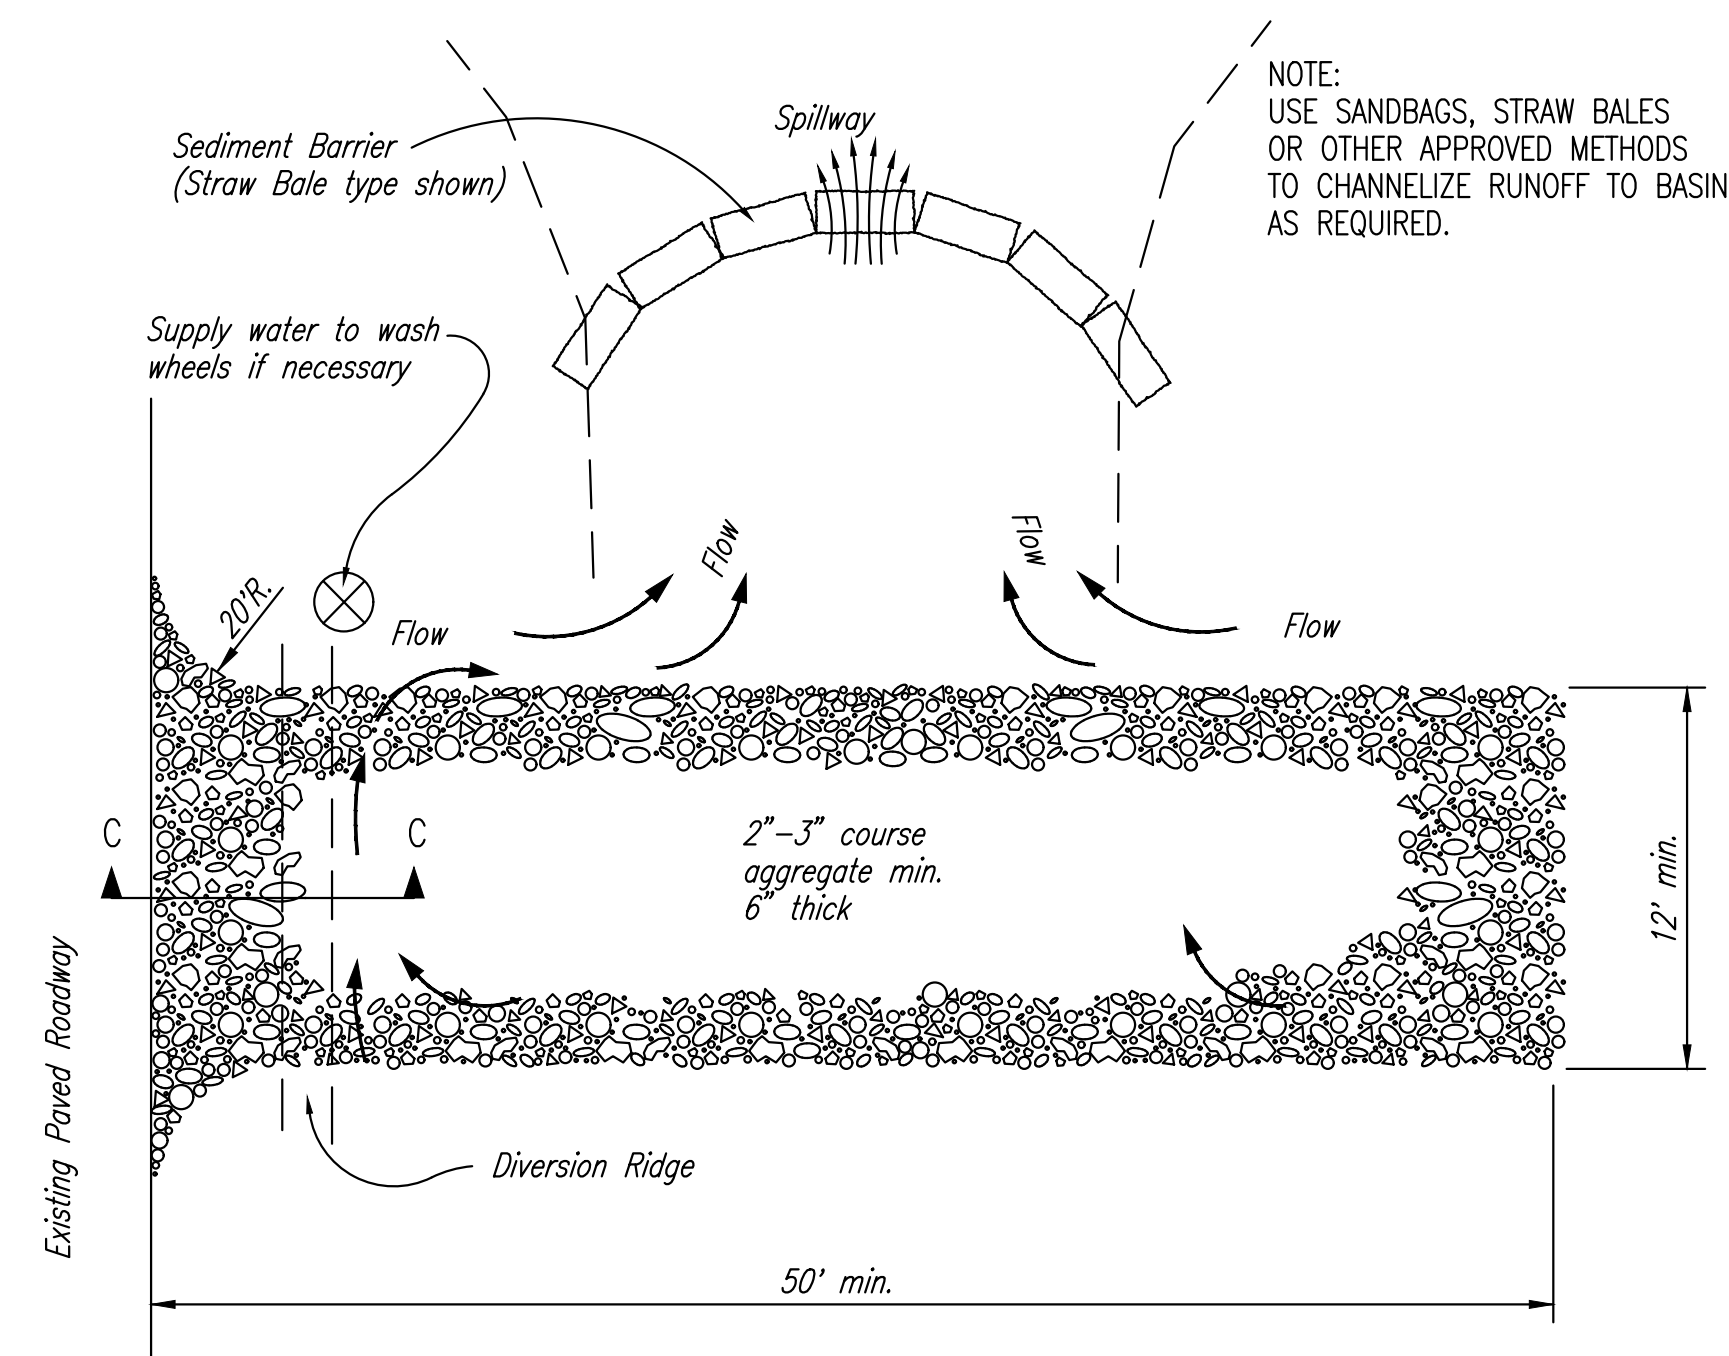

STABILIZED CONSTRUCTION ENTRANCE

NOTES:

- THE ENTRANCE SHALL BE MAINTAINED IN A CONDITION THAT WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO PUBLIC RIGHTS-OF-WAY. THIS MAY REQUIRE TOP DRESSING, REPAIR AND/OR CLEANOUT OF ANY MEASURES USED TO TRAP SEDIMENT.
- WHEN NECESSARY, WHEELS SHALL BE CLEANED PRIOR TO ENTRANCE ONTO PUBLIC RIGHT-OF-WAY.
- WHEN WASHING IS REQUIRED, IT SHALL BE DONE ON AN AREA STABILIZED WITH CRUSHED STONE THAT DRAINS INTO AN APPROVED SEDIMENT TRAP OR SEDIMENT BASIN, AS SHOWN ABOVE.
- DRIVE ENTRANCES ONTO RESIDENTIAL LOTS WILL NOT BE REQUIRED TO HAVE THE SEDIMENT BARRIER SHOWN, BUT WHEEL WASHING MAY BE REQUIRED IF STABILIZED ENTRANCE IS NOT SUFFICIENT TO KEEP MUD FROM BEING TRACKED ONTO ADJACENT STREET. ENTRANCE SHALL EXTEND FROM BACK OF CURB TO DWELLING.

BMP 1

PROJECT NO. 2501010800

SCALE NO SCALE


DRAWN LES DESIGNED TMBB CHECKED SPE

0 ISSUED FOR PERMIT 04/03/26

NO. REVISION DATE

SHEET NO.

C-502

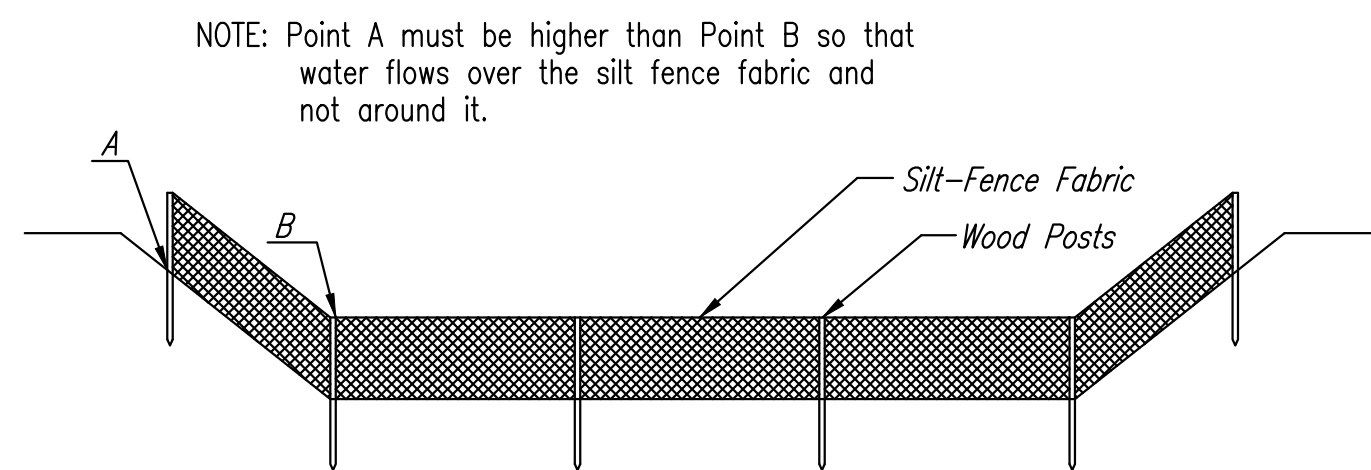

ELEVATION
SILT FENCE DITCH CHECKS
(STREAM PROTECTION)

Material Specification:

Silt fence fabric should conform to the AASHTO M288 96 silt fence specification. The posts used to support the silt fence fabric should be a hardwood material with the following minimum dimensions: 2" square (nominal) by 4' long. Silt fence fabric should be attached to the wooden posts with staples, wire, zip ties, or nails.

Placement:

Place silt fence in ditches where it is unlikely that it will be overtopped. Water should flow through a silt fence ditch check, not over it. Silt fence ditch checks often fail when overtopped. Silt fence ditch checks should be placed perpendicular to the flowline of the ditch. The silt fence should extend far enough so that the ground level at the ends of the fence is higher than the top of the low point of the fence. This prevents water from flowing around the check. Silt fence ditch checks should not be placed in ditches where high flows are expected. Rock checks should be used instead. Silt fence should be placed in ditches with slopes of 6% or less. For slopes steeper than 6%, rock checks should be used.

The following table provides check spacing for a given ditch grade:

Ditch Check Ditch grade (%)	Spacing Check Spacing (feet)
0.5	200
1.0	200
2.0	100
3.0	65
4.0	50
5.0	40
6.0	30

Proper installation method:

Excavate a trench perpendicular to the ditch flowline that is at least 12" deep by 6" wide. Extend the trench in a straight line along the entire length of the proposed ditch check. Place the soil on the upstream side of the trench for later use. Roll out a continuous length of silt fence fabric on the downstream side of the trench. Place the edge of the fabric in the trench starting at the top upstream edge of the trench. Line two sides of the trench with the fabric as shown in detail. Backfill over the fabric in the trench with the excavated soil and compact. After filling the trench, approximately 24" to 36" of silt fence fabric should remain exposed. Lay the exposed silt fence on the upstream side of the trench to clear an area for driving in the posts. Just downstream of the trench, drive posts into the ground to a depth of at least 24". Place posts no more than 4' apart. Attach the silt fence to the anchored post with staples, wire, zip ties, or nails.


List of common placement/installation mistakes to avoid:

Water should flow through a silt fence ditch check—not over it. Place silt fence in ditches where it is unlikely that it will be overtopped. Silt fence installations quickly deteriorate when water overtops them. Do not place silt fence posts on the upstream side of the silt fence fabric. In this configuration, the force of the water is not restricted by the posts, but only by the staples (wire, zip ties, nails, etc.). The silt fence will rip and fail. Do not place a silt fence ditch check directly in front of a culvert outlet. It will not stand up to the concentrated flow. Do not place silt fence ditch checks in ditches that will likely experience high flows. They will not stand up to concentrated flow. Follow prescribed ditch check spacing guidelines. If spacing guidelines are exceeded, erosion will occur between the ditch checks. Do not allow water to flow around the ditch check. Make sure that the ditch check is long enough so that the ground level at the ends of the fence is higher than the low point on the top of the fence. Do not place silt fence ditch checks in channels with shallow soils underlain by rock. If the check is not anchored sufficiently, it will wash out.


Inspection and Maintenance:

Silt fence ditch checks should be inspected every 7 days and within 24 hours of a rainfall of 1/2" or more. The following is a list of questions that should be addressed during each inspection:

- Does water flow around the ditch check?
- Does water flow under the ditch check?
- Does the silt fence sag excessively?
- Has the silt fence torn or become detached from the posts?
- Does sediment need to be removed from behind the ditch check?

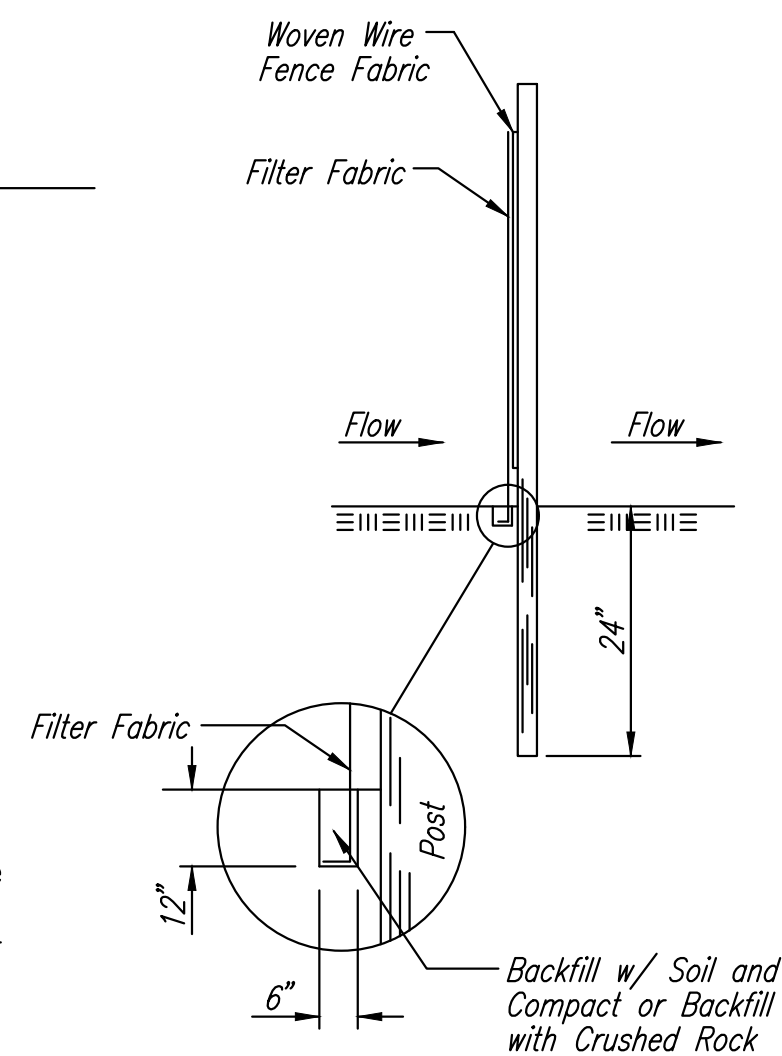

ANCHOR TRENCH DETAIL

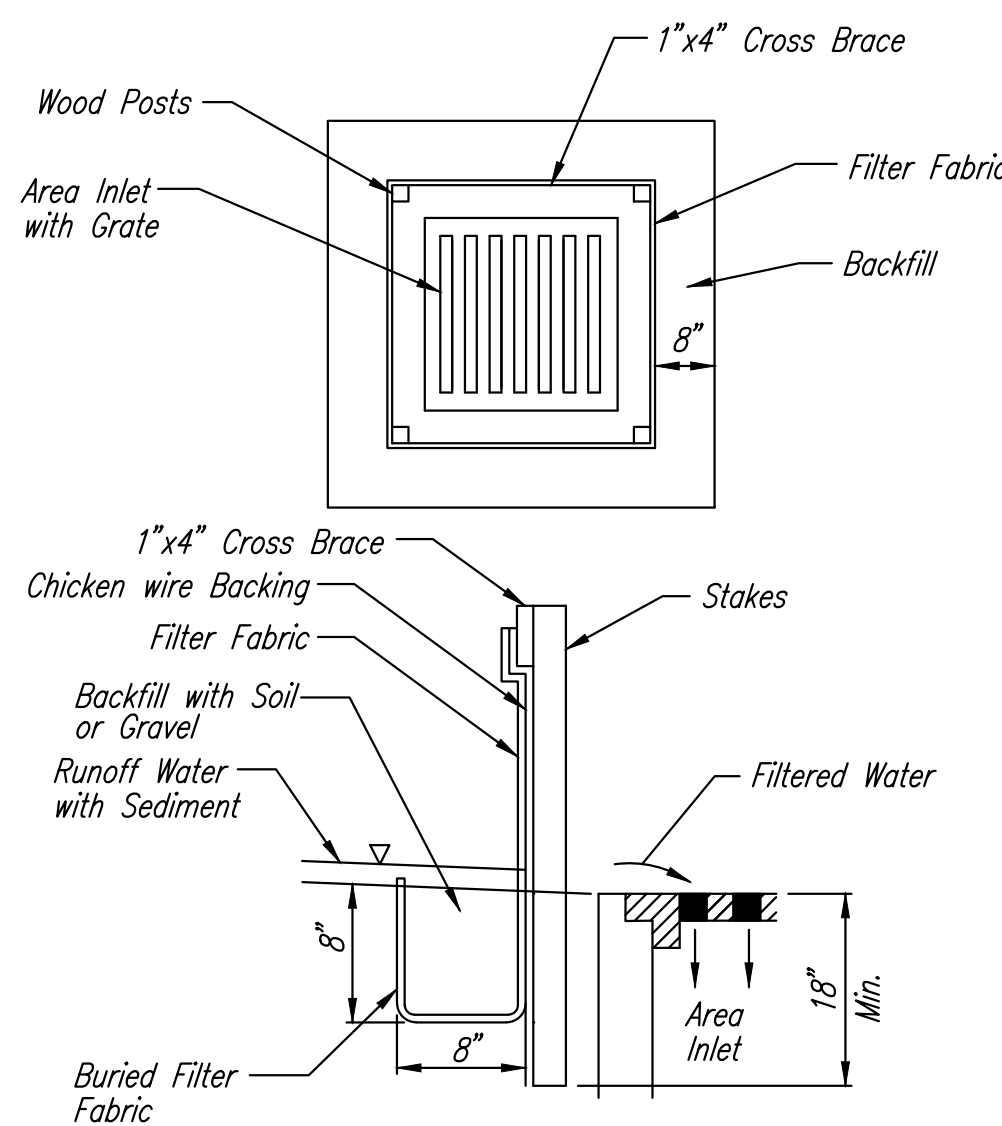

SILT FENCE BARRIERS FOR AREA INLETS
(INLET PROTECTION)

Material Specification:

Silt fence fabric should conform to the AASHTO M288 96 silt fence specification. The wire or polymeric mesh backing used to help support the silt fence fabric should conform to the AASHTO M288 96 silt fence specification. The posts used to support the silt fence fabric should be a hardwood material with the following minimum dimensions: 2" square (nominal) by 4' long. The material used to frame the tops of the posts should be 1" by 4" boards. Silt fence fabric and support backing should be attached to the wooden posts and frame with staples, wire, zip ties, or nails.

Placement:

Place a silt fence drop inlet barrier in a location where it is unlikely to be overtopped. Water should flow through silt fence, not over it. Silt fence barriers for area inlets often fail when repeatedly overtopped. When used as a barrier for area inlets, silt fence fabric and posts must be supported at the top by a wooden frame. When a silt fence barrier for area inlets is located near an inlet that has steep approach slopes, the storage capacity behind the barrier is drastically reduced. Timely removal of sediment must occur for a barrier to operate properly in this location.

Proper installation method:

Excavate a trench around the perimeter of the area inlet that is at least 8" deep by 8" wide. Drive posts to a depth of at least 18" around the perimeter of the area inlet. The distance between posts should be 4' or less. If the distance between two adjacent corner posts is more than 4', add another post(s) between them. Connect the tops of all the posts with a wooden frame made of 1" by 4" boards. Use nails or screws for fastening. Attach the wire or polymeric-mesh backing to the outside of the post/frame structure with staples, wire, zip ties, or nails. Roll out a continuous length of silt fence fabric long enough to wrap around the perimeter of the area inlet. Add more length for overlapping the fabric joint. Place the edge of the fabric in the trench, starting at the outside edge of the trench. Line all three sides of the trench with the fabric. Backfill over the fabric in the trench with the excavated soil and compact. After filling the trench, approximately 24" to 36" of silt fence fabric should remain exposed. Attach the silt fence to the outside of the post/frame structure with staples, wire, zip ties, or nails. The joint should be overlapped to the next post.

Note: When a silt fence barrier for area inlet is placed in a shallow median ditch, make sure that the top of the barrier is not higher than the paved road. In this configuration, water may spread onto the roadway causing a hazardous condition.


List of common placement/installation mistakes to avoid:

Water should flow through a silt fence barrier for area inlet—not over it. Place a silt fence barrier for area inlet in a location where it is unlikely to be overtopped. Silt fence barrier for area inlets often fail when repeatedly overtopped. Do not place posts on the outside of the silt fence barrier for area inlet. In this configuration, the force of the water is not resisted by the posts, but only by the staples (wire, zip ties, nails, etc.). The silt fence will rip and fail. Do not install silt fence barrier for area inlets without framing the top of the posts. The corner posts around area inlets are stressed in two directions whereas a normal silt fence is only stressed in one direction. This added stress requires more support.

Inspection and Maintenance:

Silt fence barrier for area inlets should be inspected every 7 days and within 24 hours of a rainfall of 1/2" or more. The following is a list of questions that should be addressed during each inspection:

- Does water flow under the silt fence?
- Does the silt fence sag excessively?
- Has the silt fence torn or become detached from the posts?
- Does sediment need to be removed from behind the area inlet barrier?

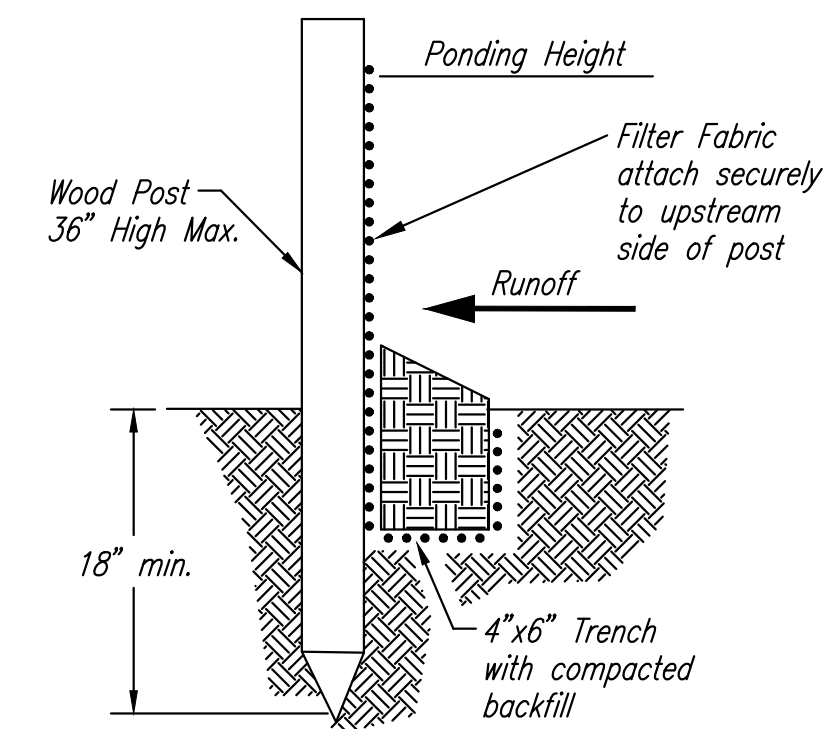

SILT FENCE BARRIERS

Material Specification:

Silt fence fabric should conform to the AASHTO M288 96 silt fence specification. The posts used to support the silt fence fabric should be a hardwood material with the following minimum dimensions: 2" square (nominal) by 4' long. Silt fence fabric should be attached to the wooden posts with staples, wire, zip ties, or nails.

Placement:

A slope barrier should be used at the toe of a slope when a ditch does not exist. The slope barrier should be placed on nearly level ground 5' to 10' away from the toe of a slope. The barrier is placed away from the toe of the slope to provide adequate storage for settling out sediment. When practicable, silt fence slope barriers should be placed along contours to avoid a concentration of flow. Silt fence slope barriers can also be placed along right-of-way fence lines to keep sediment from crossing onto adjacent property. When placed in this manner, the slope barrier will not likely follow contours.

Proper installation method:

Excavate a trench the length of the planned slope barrier that is 6" deep by 4" wide. Make sure that the trench is excavated along a single contour. When practicable, slope barriers should be placed along contours to avoid a concentration of flow. Place the soil on the upslope side of the trench for later use. Roll out a continuous length of silt fence fabric on the downslope side of the trench. Place the edge of the fabric in the trench starting at the top upslope edge. Line all three sides of the trench with the fabric. Backfill over the fabric in the trench with the excavated soil and compact. After filling the trench, approximately 24" to 36" of silt-fence fabric should remain exposed. Lay the exposed silt fence upslope of the trench to clear an area for driving in the posts. Just downslope of the trench, drive posts into the ground to a depth of at least 18". Place posts no more than 4' apart. Attach the silt fence to the anchored post with staples, wire, zip ties, or nails.

List of common placement/installation mistakes to avoid:

When practicable, do not place silt fence slope barriers across contours. Slope barriers should be placed along contours to avoid a concentration of flow. When the flow concentrates, it overtops the barrier and the silt fence slope barrier quickly deteriorates. Do not place silt-fence posts on the upslope side of the silt fence fabric. In this configuration, the force of the water is not restricted by the posts, but only by the staples (wire, zip ties, nails, etc.). The silt fence will rip and fail. Do not place silt fence slope barriers in areas with shallow soils underlain by rock. If the barrier is not sufficiently anchored, it will wash out. Silt fence slope barriers must be dug into the ground—silt fence at ground level does not work because water will flow underneath.


Inspection and Maintenance:

Silt fence slope barriers should be inspected every 7 days and within 24 hours of a rainfall of 1/2" or more. The following is a list of questions that should be addressed during each inspection:

- Are there any points along the slope barrier where water is concentrating?
- Does water flow under the slope barrier?
- Do the silt fences sag excessively?
- Has the silt fence torn or become detached from the posts?
- Does sediment need to be removed from behind the slope barrier?

PLOTTED BY: BRYAN SMITH 4/27/2026 4:48 PM
 DWG PATH: J:\PROJECTS\2025\201010800_THE RESERVE AT THE MEADOWS\CAD\BHSIG CIVILISTE
 DWG NAME: 250308 ERCS DLS3.DWG
 ©2026 MKEC ENGINEERING, INC. ALL RIGHTS RESERVED WWW.MKEC.COM THESE DRAWINGS AND THEIR CONTENTS, INCLUDING, BUT NOT LIMITED TO, ALL CONCEPTS, DESIGNS, & IDEAS ARE THE EXCLUSIVE PROPERTY OF MKEC ENGINEERING, INC. (MKEC), AND MAY NOT BE USED OR REPRODUCED IN ANY WAY WITHOUT THE EXPRESS CONSENT OF MKEC.

PROJECT NO.		BMP 2
SCALE		2501010800
DRAWN		NO SCALE
DESIGNED	CHECKED	
LES	TMBB	SPE
0	ISSUED FOR PERMIT	04/03/26
NO.	REVISION	DATE
SHEET NO.		
C-503		

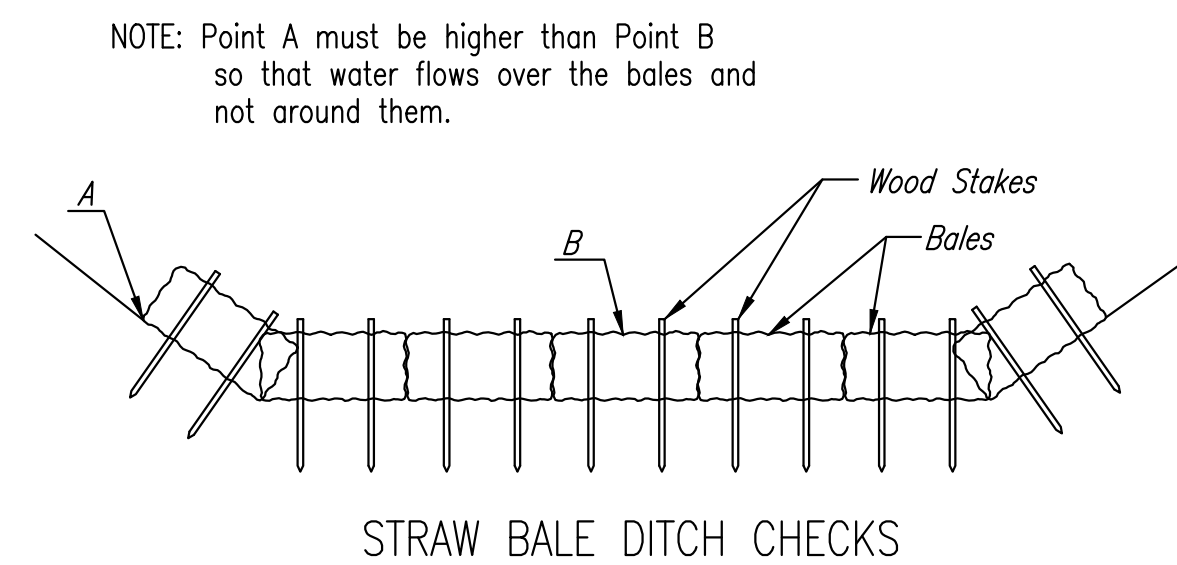

Material Specification:

Bale ditch checks may be constructed of wheat straw, oat straw, prairie hay, or bromegrass hay that is free of weeds declared noxious by the Kansas State Board of Agriculture. The stakes used to anchor the bales should be a hardwood material with the following minimum dimensions: 2" square (nominal) by 4' long. Optional: The downstream scour apron should be constructed of a double-netted straw erosion-control blanket at least 6' wide. Optional: The metal landscape staples used to anchor the erosion-control blanket should be at least 8" long.

Placement:

Bale ditch checks should be placed perpendicular to the flowline of the ditch. The ditch check should extend far enough so that the ground level at the ends of the check is higher than the top of the lowest center bale. This prevents water from flowing around the check. Straw bale ditch checks should not be placed in ditches where high flows are expected. Rock checks should be used instead. Bales should be placed in ditches with slopes of 6% or less. For slopes steeper than 6%, rock checks should be used. The following table provides check spacing for a given ditch grade:

Ditch grade (%)	Check Spacing (feet)
0.5	200
1.0	200
2.0	100
3.0	65
4.0	50
5.0	40
6.0	30

Proper installation method:

Excavate a trench perpendicular to the ditch flowline that is 4" deep and a bale's width wide. Extend the trench in a straight line along the entire length of the proposed ditch check. Place the soil on the upstream side of the trench—it will be used later. Optional: On the downstream side of the trench, roll out a length of erosion-control blanket (scour apron) equal to the length of the trench. Place the upstream edge of the erosion-control blanket along the bottom upstream edge of the trench. The erosion control blanket should be anchored in the trench with one row of 8" landscape staples placed on 18" centers. The remainder of the erosion-control blanket (the portion that is not lying in the trench) will serve as the downstream scour apron. This section of the blanket should be anchored to the ground with 8" landscape staples placed around the perimeter of the blanket on 18" centers. The remainder of the blanket should be anchored using two evenly spaced rows of 8" landscape staples on 18" centers placed perpendicular to the flowline of the ditch. Place the bales in the trench, making sure that they are butted tightly. Two stakes should be driven through each bale along the centerline of the ditch check, approximately 6" to 8" in from the bale ends. Stakes should be driven at least 12" into the ground. Once all the bales have been installed and anchored, place the excavated soil against the upstream side of the check and compact it. The compacted soil should be no more than 3" to 4" deep and extend upstream no more than 24".



List of common placement/installation mistakes to avoid:

- Do not place a bale ditch check directly in front of a culvert outlet. It will not stand up to the concentrated flow.
- Do not place bale ditch checks in ditches that will likely experience high flows. They will not stand up to concentrated flow.
- Follow prescribed ditch-check spacing guidelines. If spacing guidelines are exceeded, erosion will occur between the ditch checks.
- Do not allow water to flow around the ditch check. Make sure that the ditch check is long enough so that the ground level at the ends of the check is higher than the top of the lowest center bale.
- Do not place bale ditch checks in channels with shallow soils underlain by rock. If the check is not anchored sufficiently, it will wash out.
- Bale ditch checks must be dug into the ground. Bales at ground level do not work because they allow water to flow under the check.

Inspection and Maintenance:

Bale ditch checks should be inspected every 7 days and within 24 hours of a rainfall of 1/2" or more. The following is a list of questions that should be addressed during each inspection:

- Does water flow around the ditch check?
- Does water flow under the ditch check?
- Does water flow through spaces between abutting bales?
- Are any bales and/or scour aprons (optional) dislodged?
- Are bales decomposing due to age and/or water damage?
- Does sediment need to be removed from behind the ditch check?

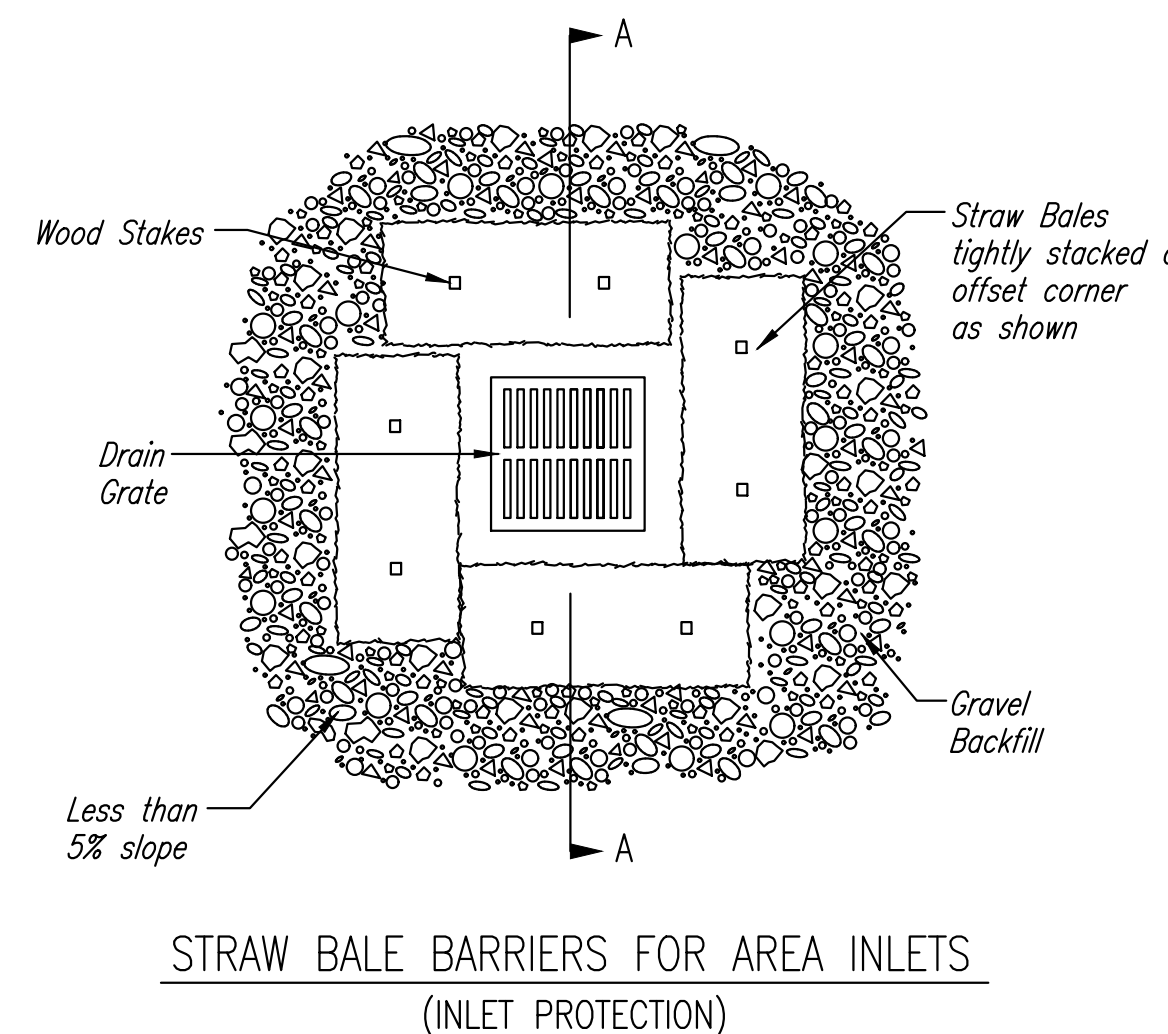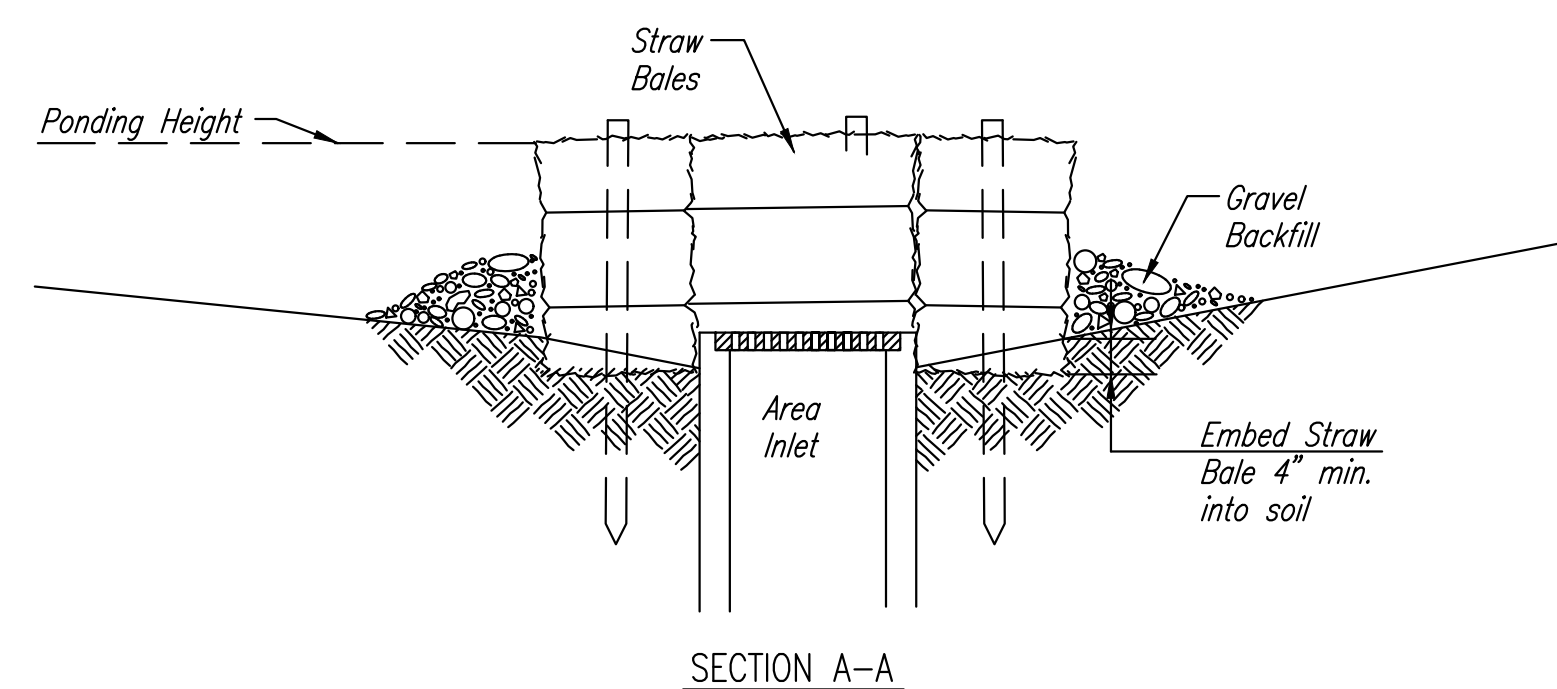

Material Specification:

Bale area inlet barriers should be constructed of wheat straw, oat straw, prairie hay, or bromegrass hay that is free of weeds declared noxious by the Kansas State Board of Agriculture. The stakes used to anchor the bales should be a hardwood material with the following minimum dimensions: 2" square (nominal) by 4' long. Twine should be used to bind bales. The use of wire binding is prohibited because it does not biodegrade readily.

Placement:

Bale area inlet barriers should be placed directly around the perimeter of a drop inlet. When a bale area inlet barrier is located near an inlet that has steep approach slopes, the storage capacity behind the barrier is drastically reduced. Timely removal of sediment must occur for a barrier to operate properly in this location.

Proper Installation Method:

Excavate a trench around the perimeter of the area inlet that is at least 4" deep by a bale's width wide. Place the bales in the trench, making sure that they are butted tightly. Some bales may need to be shortened to fit into the trench around the area inlet. Two stakes should be driven through each bale, approximately 6" to 8" in from the bale ends. Stakes should be driven at least 12" into the ground. Once all the bales have been installed and anchored, place the excavated soil against the receiving side of the barrier and compact it. The compacted soil should be no more than 3" to 4" deep. Note: When a bale area inlet barrier is placed in a shallow median ditch, make sure that the top of the barrier is not higher than the paved road. In this configuration, water may spread onto the roadway causing a hazardous condition.


List of common placement installation mistakes to avoid:

- Bales should be placed directly against the perimeter of the area inlet. This allows overtopping water to flow directly into the inlet instead of onto nearby soil causing scour.
- Bale area inlet barriers must be dug into the ground. Bales at ground level do not work because they allow water to flow under the barrier.

Inspection and Maintenance:

Bale area inlet barriers should be inspected every 7 days and within 24 hours of a rainfall of 1/2" or more. The following is a list of questions that should be addressed during each inspection:

- Does water flow under the area inlet barrier?
- Does water flow through spaces between abutting bales?
- Are any bales dislodged?
- Are bales decomposing due to age and/or water damage?
- Does sediment need to be removed from behind the area inlet barrier?

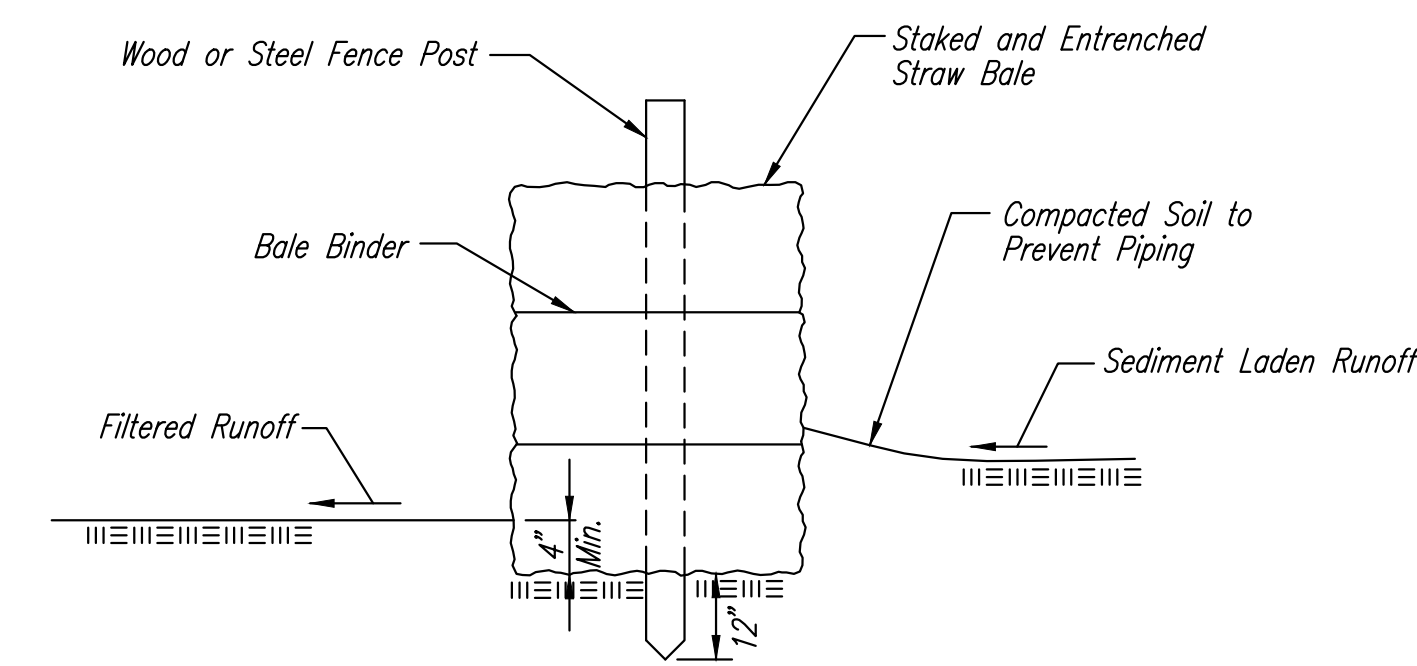

Material Specification:

Bale slope barriers may be constructed of wheat straw, oat straw, prairie hay, or bromegrass hay that is free of weeds declared noxious by the Kansas State Board of Agriculture. The stakes used to anchor the bales should be a hardwood material with the following minimum dimensions: 2" square (nominal) by 4' long. Twine should be used to bind bales. The use of wire binding is prohibited because it does not biodegrade readily.

Placement:

A slope barrier should be used at the toe of a slope when a ditch does not exist. The slope barrier should be placed on nearly level ground 5' to 10' away from the toe of a slope. The barrier is placed away from the toe of the slope to provide adequate storage for settling out sediment. When practicable, bale slope barriers should be placed along contours to avoid a concentration of flow. Bale slope barriers can also be placed along right-of-way fence lines to keep sediment from crossing onto adjacent property. When placed in this manner, the slope barrier will not likely follow contours.

Proper installation method:

Excavate a trench the length of the planned slope barrier that is 4" deep and a bale's width wide. Make sure that the trench is excavated along a single contour. When practicable, slope barriers should be placed along contours to avoid a concentration of flow. Place the soil on the upslope side of the trench for later use. Place the bales in the trench, making sure that they are butted tightly. Two stakes should be driven through each bale along the centerline of the ditch check, approximately 6" to 8" in from the bale ends. Stakes should be driven at least 12" into the ground. Once all the bales have been installed and anchored, place the excavated soil against the upslope side of the check and compact it. The compacted soil should be no more than 3" to 4" deep.

List of common placement/installation mistakes to avoid:

- When practical, do not place bale slope barriers across contours. Slope barriers should be placed along contours to avoid a concentration of flow. Concentrated flow over a slope barrier creates a scour hole on the downslope side of the barrier. The scour hole eventually undermines the bales and the barrier fails.
- Do not place bale slope barriers in areas with shallow soils underlain by rock. If the barrier is not anchored sufficiently, it will wash out.
- Bale slope barriers must be dug into the ground. Bales at ground level do not work because they allow water to flow under the barrier.

Inspection and Maintenance:



Bale slope barriers should be inspected every 7 days and within 24 hours of a rainfall of 1/2" or more. The following is a list of questions that should be addressed during each inspection:

- Are there any points along the slope barrier where water is concentrating?
- Does water flow under the slope barrier?
- Does water flow through spaces between abutting bales?
- Are any bales dislodged?
- Are bales decomposing due to age and/or water damage?
- Does sediment need to be removed from behind the slope barrier?

CIVIL PLANS FOR
THE RESERVE AT THE MEADOWS
GODDARD, KS

GENERAL NOTES:

- THIS SHEET IS INTENDED TO PROVIDE GUIDELINES AS TO WHAT TYPES OF EROSION CONTROL DEVICES WILL BE INSTALLED DURING THE CONSTRUCTION PROCESS. CONTRACTORS ARE EXPECTED TO BID PROJECTS ACCORDINGLY.
- EROSION CONTROL DEVICES MUST BE MAINTAINED BY THE CONTRACTOR THROUGHOUT THE CONSTRUCTION PROCESS AND UNTIL THE DISTURBED EARTH IS RESTABILIZED.
- IF THE PROJECT WILL DISTURB 1 ACRE OR MORE, A FEDERAL/STATE NPDES STORMWATER PERMIT IS REQUIRED. A DETAILED STORMWATER POLLUTION PREVENTION PLAN, IS REQUIRED. THE EROSION CONTROL DEVICES SHOWN ON THIS SHEET ARE CONSIDERED TO BE THE MINIMUM TO BE SHOWN IN THE POLLUTION PREVENTION PLAN.
- FOR PROJECTS DISTURBING LESS THAN 1 ACRE, CONTRACTORS ARE ENCOURAGED TO PREPARE STORMWATER POLLUTION PREVENTION PLANS PRIOR TO CONSTRUCTION. EROSION CONTROL DEVICES MUST BE USED ON ALL PROJECTS.
- FAILURE TO USE AND MAINTAIN EROSION CONTROL DEVICES IS A VIOLATION OF SECTION 16.32 OF THE CITY CODE AND WILL SUBJECT THE CONTRACTOR TO THE PENALTIES PROVIDED FOR THEREIN.
- THE APPLICATION OF EROSION CONTROL DEVICES SHOWN ON THIS SHEET IS FOR SITUATIONS NORMALLY ENCOUNTERED. FROM TIME TO TIME, SITUATIONS WILL ARISE THAT MAY REQUIRE A DIFFERENT DEVICE OTHER THAN THOSE SHOWN. EROSION CONTROL DEVICES, OTHER THAN THOSE SHOWN, MAY BE UTILIZED AS LONG AS THEY ARE EFFECTIVE AND MAINTAINED.

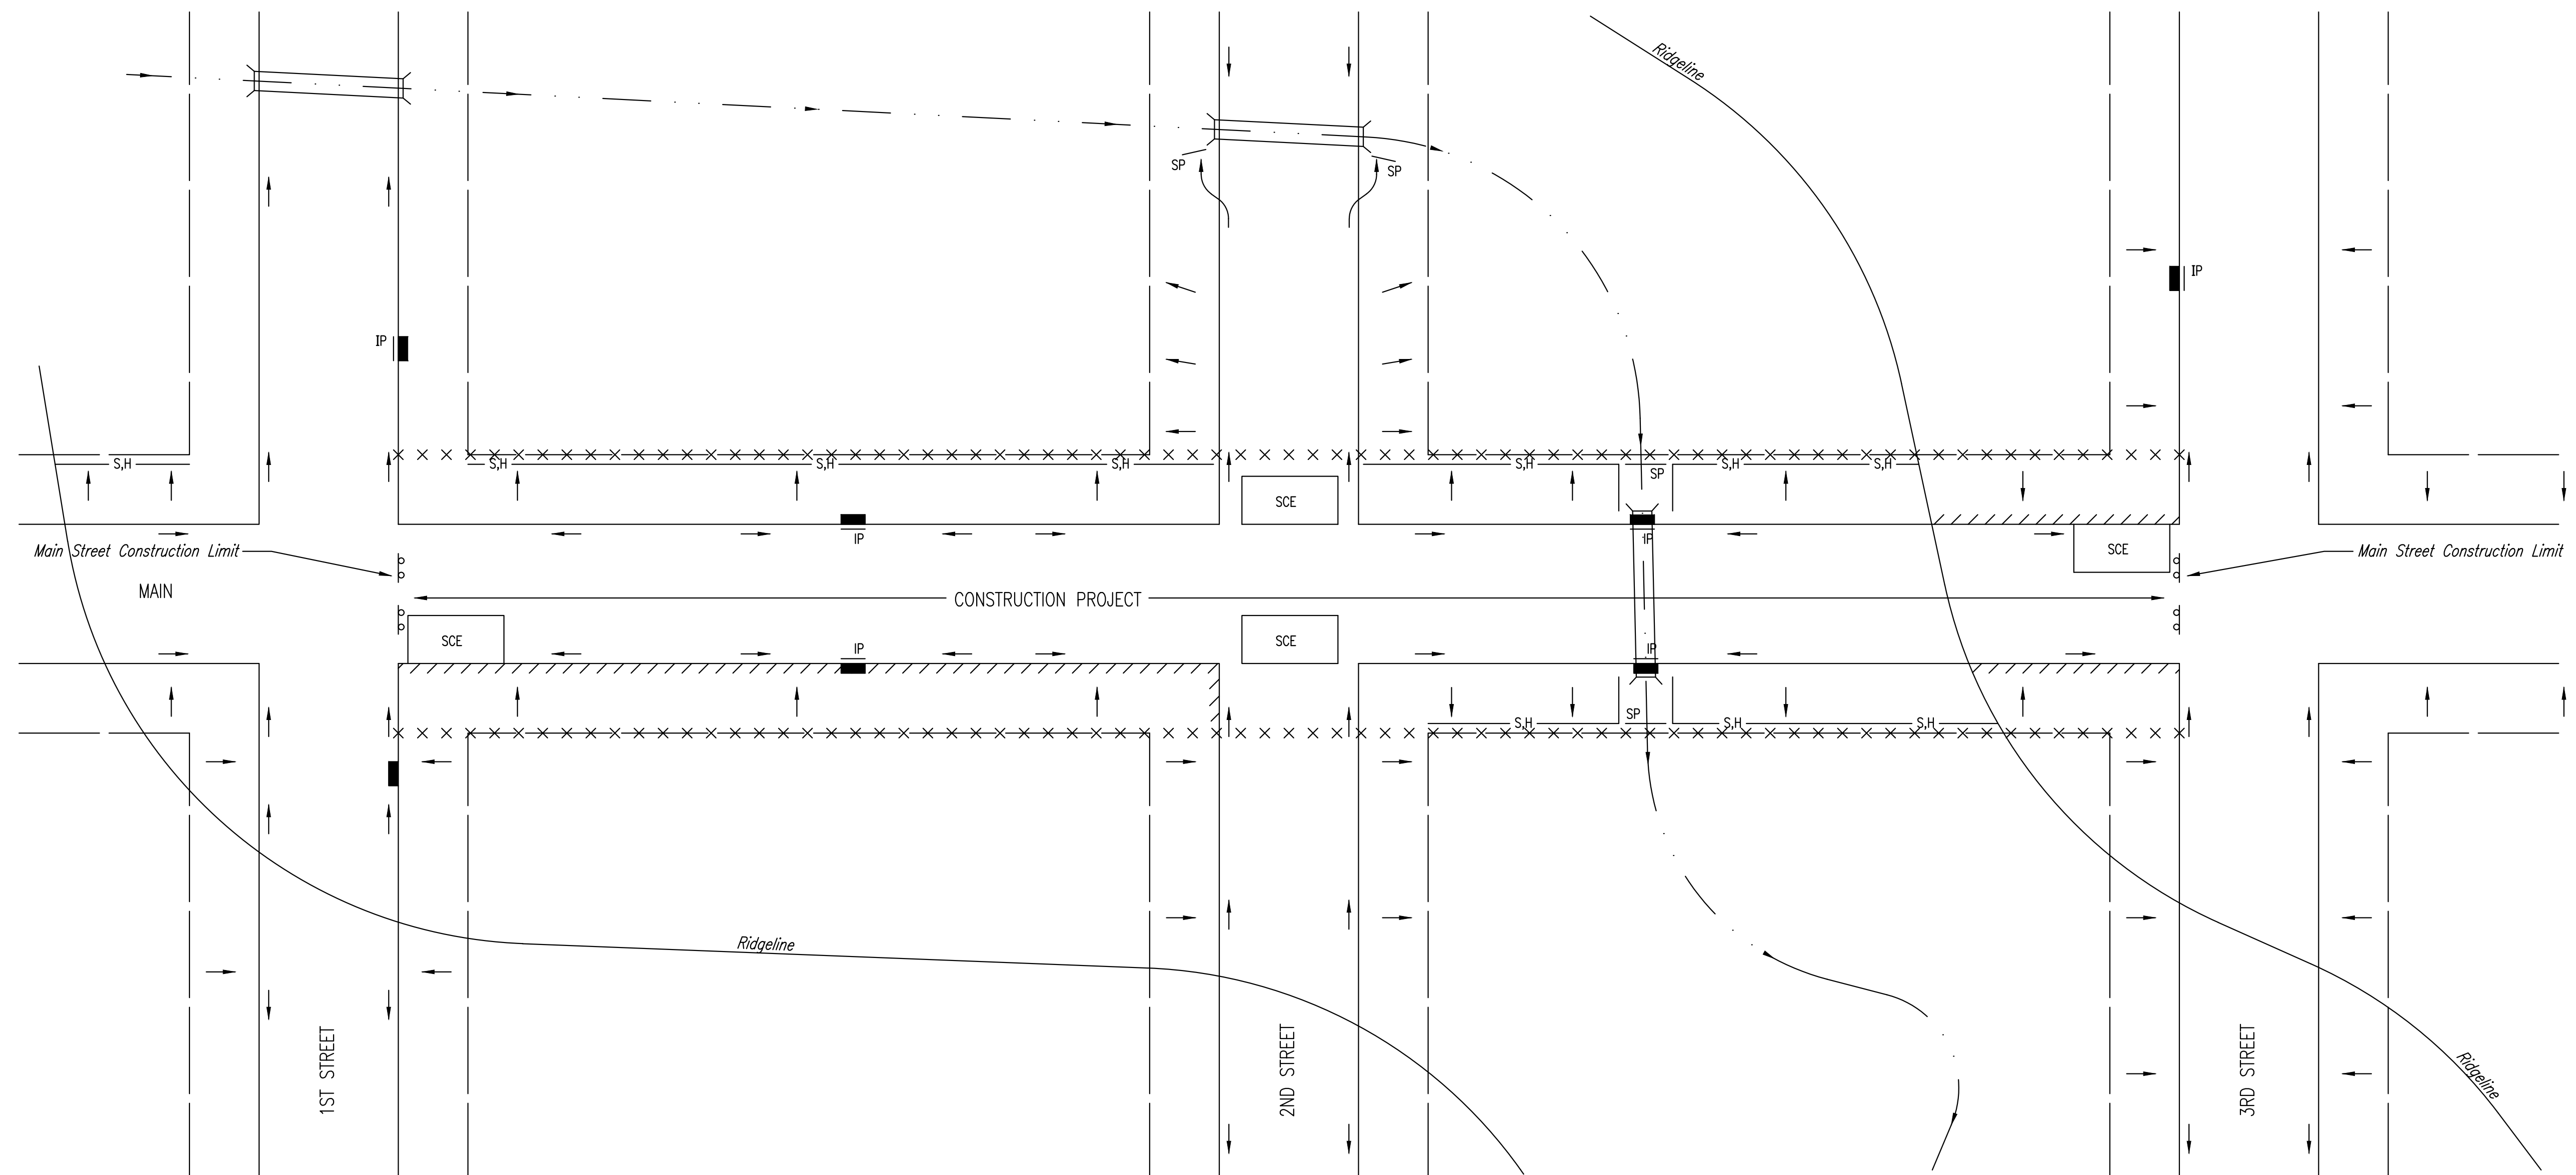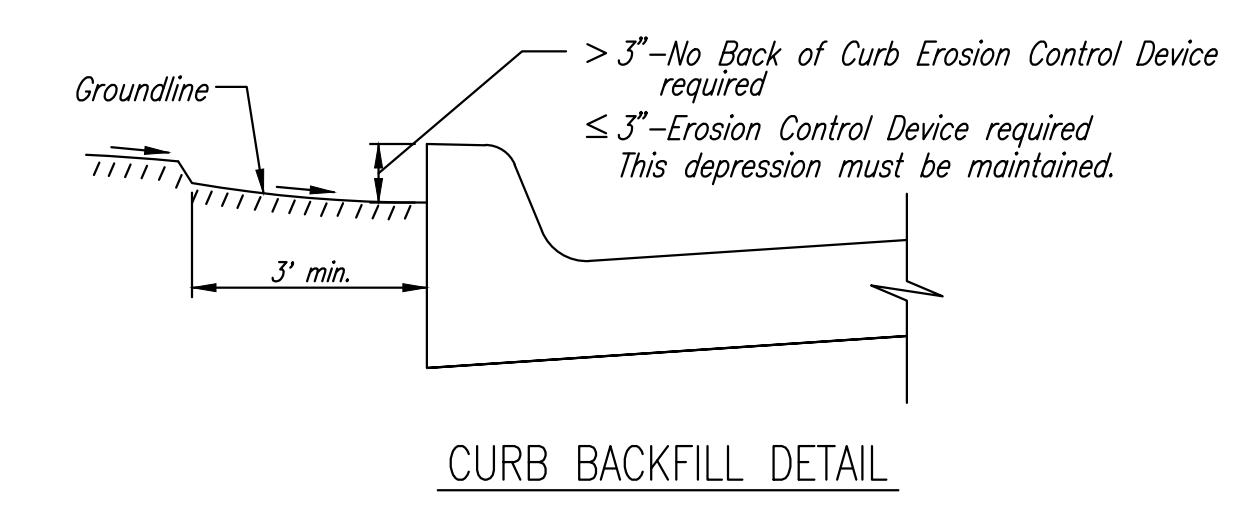

LEGEND

- R-O-W LIMITS
- DRAINAGE FLOW PATH
- × × × × R/W LIMIT WITHIN CONSTRUCTION LIMIT
- STORM WATER INLETS
- IP INLET PROTECTION
- S.H — SILT FENCE OR HAY BALE BARRIER
- SP STREAM PROTECTION
- SCE STABILIZED CONSTRUCTION ENTRANCE
- //// BACK OF CURB PROTECTION


NOTES:

- THE INTENT OF ALL EROSION CONTROL DEVICES IS TO KEEP ALL SEDIMENT CONFINED TO THE CONSTRUCTION SITE, AND OUT OF ALL UNDERGROUND PIPES, DITCHES, LAKES, AND OTHER DRAINAGE FACILITIES, AND OFF OF STREETS.
- THE POINT OF COMPLIANCE IS GENERALLY THE RIGHT-OF-WAY LINES WITHIN THE LIMITS OF CONSTRUCTION.
- EROSION CONTROL DEVICES WILL BE REQUIRED AT ALL POINTS ALONG THE PROJECT WHERE DISTURBED EARTH CAN DRAIN ONTO PRIVATE PROPERTY.
- INLET PROTECTION DEVICES WILL BE REQUIRED WHEREVER WATER CAN DRAIN OFF THE PROJECT SITE INTO AN INLET, INCLUDING ANY SIDE STREET INLETS.
- EROSION CONTROL DEVICES SHALL BE INSTALLED AT CREEK CROSSINGS SO AS TO PREVENT SEDIMENT FROM ENTERING THEREIN.
- STABILIZED CONSTRUCTION ENTRANCES SHALL BE PROVIDED, AS NEEDED, TO PREVENT MUD FROM TRACKING ONTO STREETS NOT UNDER CONSTRUCTION AND ON STREETS WITHIN THE PROJECT LIMITS IF TRAFFIC IS BEING MAINTAINED THROUGH THE PROJECT.
- ANY MUD TRACKED ONTO STREETS MUST BE REMOVED AT THE END OF EACH WORK DAY.
- THE CONTRACTOR WILL BE REQUIRED TO PLACE EROSION CONTROL DEVICES BACK OF CURB, WHENEVER WATER CAN DRAIN OVER CURB, TO KEEP ERODED SOIL OUT OF THE GUTTERLINES, IN ACCORDANCE WITH THE FOLLOWING:
 - THE DEVICE REQUIRED WILL BE CURLEX I OR II EXCELSIOR BLANKET, OR EQUAL. SAID BLANKET SHALL BE PLACED OVER THE APPROPRIATE SEED AND FERTILIZER, AS SPECIFIED IN THE PROJECT SPECIFICATIONS. (SEE SOIL EROSION BMPs - BACK OF CURB SEDIMENT BARRIER DETAILS)
 - THIS DEVICE SHALL BE INSTALLED IMMEDIATELY WHENEVER THE CURB IS BACKFILLED TO WITHIN 3" OF THE TOP OF CURB. (SEE CURB BACKFILL DETAIL) OTHER BMP'S MAY BE REQUIRED AT LOCATIONS WHERE CONCENTRATED FLOW CARRIES SEDIMENT OVER THE CURB.
 - ADDITIONALLY, OTHER EROSION CONTROL DEVICES (HAY BALES, SILT FENCE, ETC.) WILL BE INSTALLED AT LOCATIONS OF CONCENTRATED FLOW RESULTING IN SEDIMENT OVERRUNNING THE MAT.
 - SHOULD THE PROJECT PLANS SPECIFY THAT THE RIGHT-OF-WAY IS TO BE SODDED, THE EXCELSIOR MAT WILL NOT BE REQUIRED SO LONG AS THE SOD IS PLACED WITHIN 48 HOURS AFTER CURB BACKFILL REACHES A HEIGHT OF 3" OR LESS FROM TOP OF CURB. (SEE CURB BACKFILL DETAIL)

PLOTTED BY: BRYAN SMITH 4/2/2026 4:48 PM
 DWG PATH: J:\PROJECTS\2025\2501010800_GJR_THE RESERVE AT THE MEADOWS\DWG\CAD\BHS\06 CIVIL\SITE
 DWG NAME: 25006 ERCS 0133.DWG
 ©2026 MKEC ENGINEERING, INC. ALL RIGHTS RESERVED WWW.MKEC.COM THESE DRAWINGS AND THEIR CONTENTS, INCLUDING, BUT NOT LIMITED TO, ALL CONCEPTS, DESIGNS, & IDEAS ARE THE EXCLUSIVE PROPERTY OF MKEC ENGINEERING, INC. (MKEC) AND MAY NOT BE USED OR REPRODUCED IN ANY WAY WITHOUT THE EXPRESS CONSENT OF MKEC.


BMP 4		
PROJECT NO.	2501010800	
SCALE	NO SCALE	
DRAWN	DESIGNED	CHECKED
LES	TMBB	SPE
NO.	REVISION	DATE
0	ISSUED FOR PERMIT	04/03/26
SHEET NO. C-505		

PHASE 1 – INITIAL EARTHWORK AND UTILITIES (EXCEPT STORM SEWER)

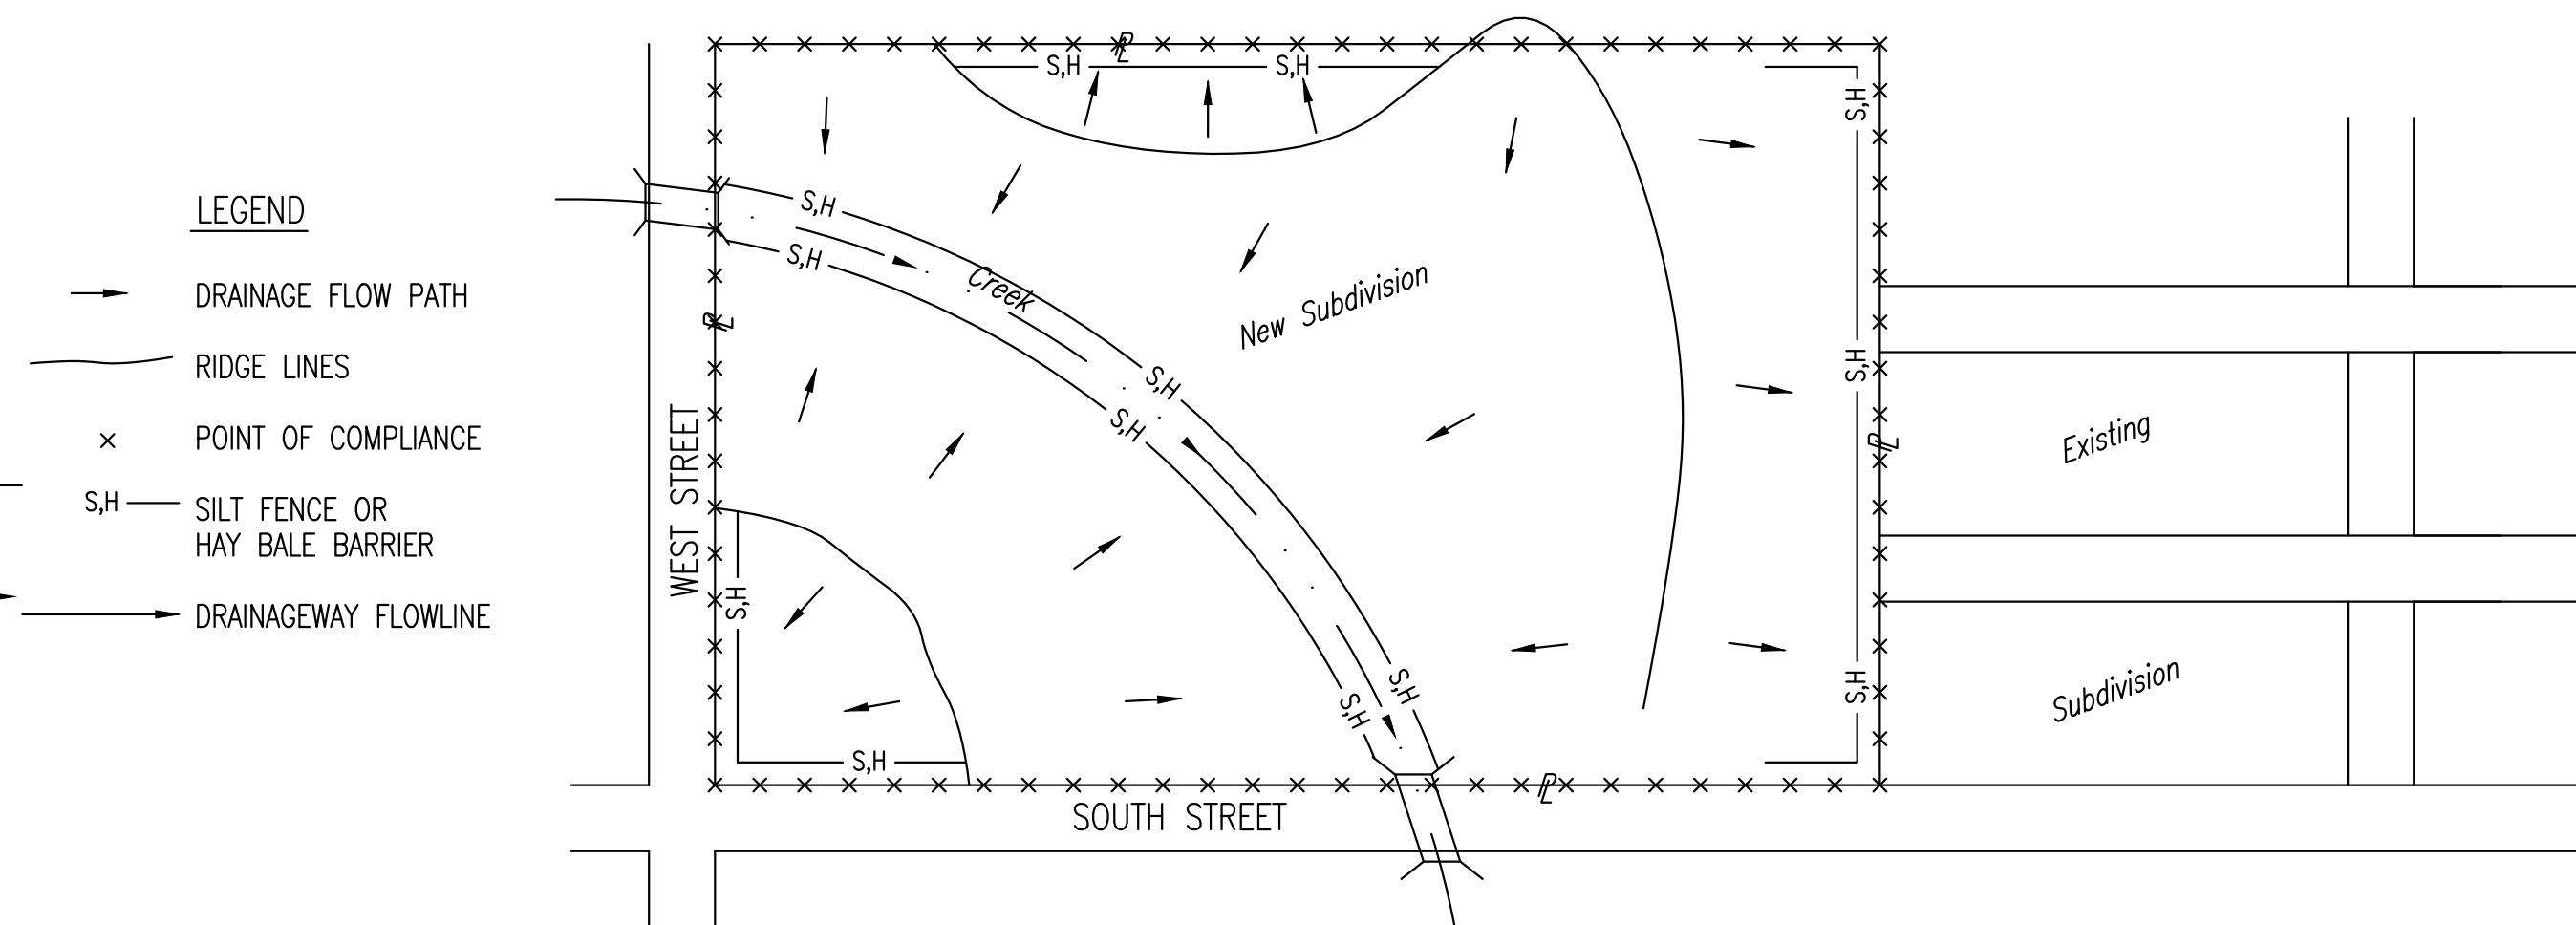


- DURING THIS PHASE OF SUBDIVISION CONSTRUCTION, THE POINTS OF COMPLIANCE ARE THE PERIMETER BOUNDARIES AND ANY DRAINAGE WAYS OR STORM SEWERS DRAINING THROUGH OR FROM THE SITE. SHOULD LAKES BE CONSTRUCTED WITHIN THE SUBDIVISION THAT WILL DISCHARGE DURING STORMS, THEY ARE ALSO A POINT OF COMPLIANCE.
- HAY BALES OR SILT FENCE MUST BE CONSTRUCTED ALONG THE PROPERTY LINE WHERE ON SITE WATER CAN DRAIN OFF THE PROPERTY. THESE EROSION CONTROL DEVICES WILL ALSO BE INSTALLED ALONG ANY DRAINAGE DITCH OR LAKE THAT CAN DISCHARGE.
- SHOULD SILT OR SEDIMENT ENTER THE DITCHES OR STREETS ON THE ADJACENT BOUNDARY STREETS, APPROPRIATE EROSION CONTROL DEVICES WILL BE PLACED WITHIN THE SUBDIVISION TO PREVENT THIS.
- ANY MUD TRACKED ONTO ADJACENT STREETS WILL BE REMOVED WITHIN 48 HOURS OR BY FRIDAY AT 6:00 PM, WHICHEVER IS EARLIER.
- CONTRACTORS WORKING WITHIN THE SITE WILL NOT BE REQUIRED TO USE INDIVIDUAL EROSION CONTROL DEVICES AS LONG AS THOSE SPECIFIED ABOVE ARE IN PLACE AND EFFECTIVE. CONTRACTORS WORKING ON THE BOUNDARY LINE STREETS OR ON ADJACENT PROPERTIES TO EXTEND UTILITIES ARE EXPECTED TO USE EROSION CONTROL DEVICES AT THEIR WORK LOCATIONS, AS NEEDED.
- UTILIZE STABILIZED CONSTRUCTION ENTRANCE AT ENTRANCE AND EXIT ONTO ANY EXISTING PUBLIC STREETS.
- IF THE INITIAL EARTH WORK AND UTILITIES ARE DONE AS PART OF A PUBLIC IMPROVEMENT PROJECT, THESE EROSION CONTROL DEVICES WILL BE INSTALLED BY THE CONTRACTOR AS SPECIFIED IN THE INDIVIDUAL PROJECT CONTRACTS. THE CONTRACTOR WILL MAINTAIN THE DEVICES UNTIL COMPLETION OF THE CONTRACT, AT WHICH TIME THE DEVELOPER WILL ASSUME MAINTENANCE RESPONSIBILITIES. IF THESE CONTRACTS ARE NOT PUBLIC IMPROVEMENT PROJECTS, THE DEVELOPER WILL BE RESPONSIBLE FOR INSTALLING AND MAINTAINING THESE DEVICES.
- WITHIN 14 DAYS OF COMPLETION OF EARTHWORK ACTIVITIES IN ANY GIVEN AREA, THAT AREA SHALL BE TEMPORARILY OR PERMANENTLY SEEDED AND MULCHED.

PHASE 3 – STREET CONSTRUCTION

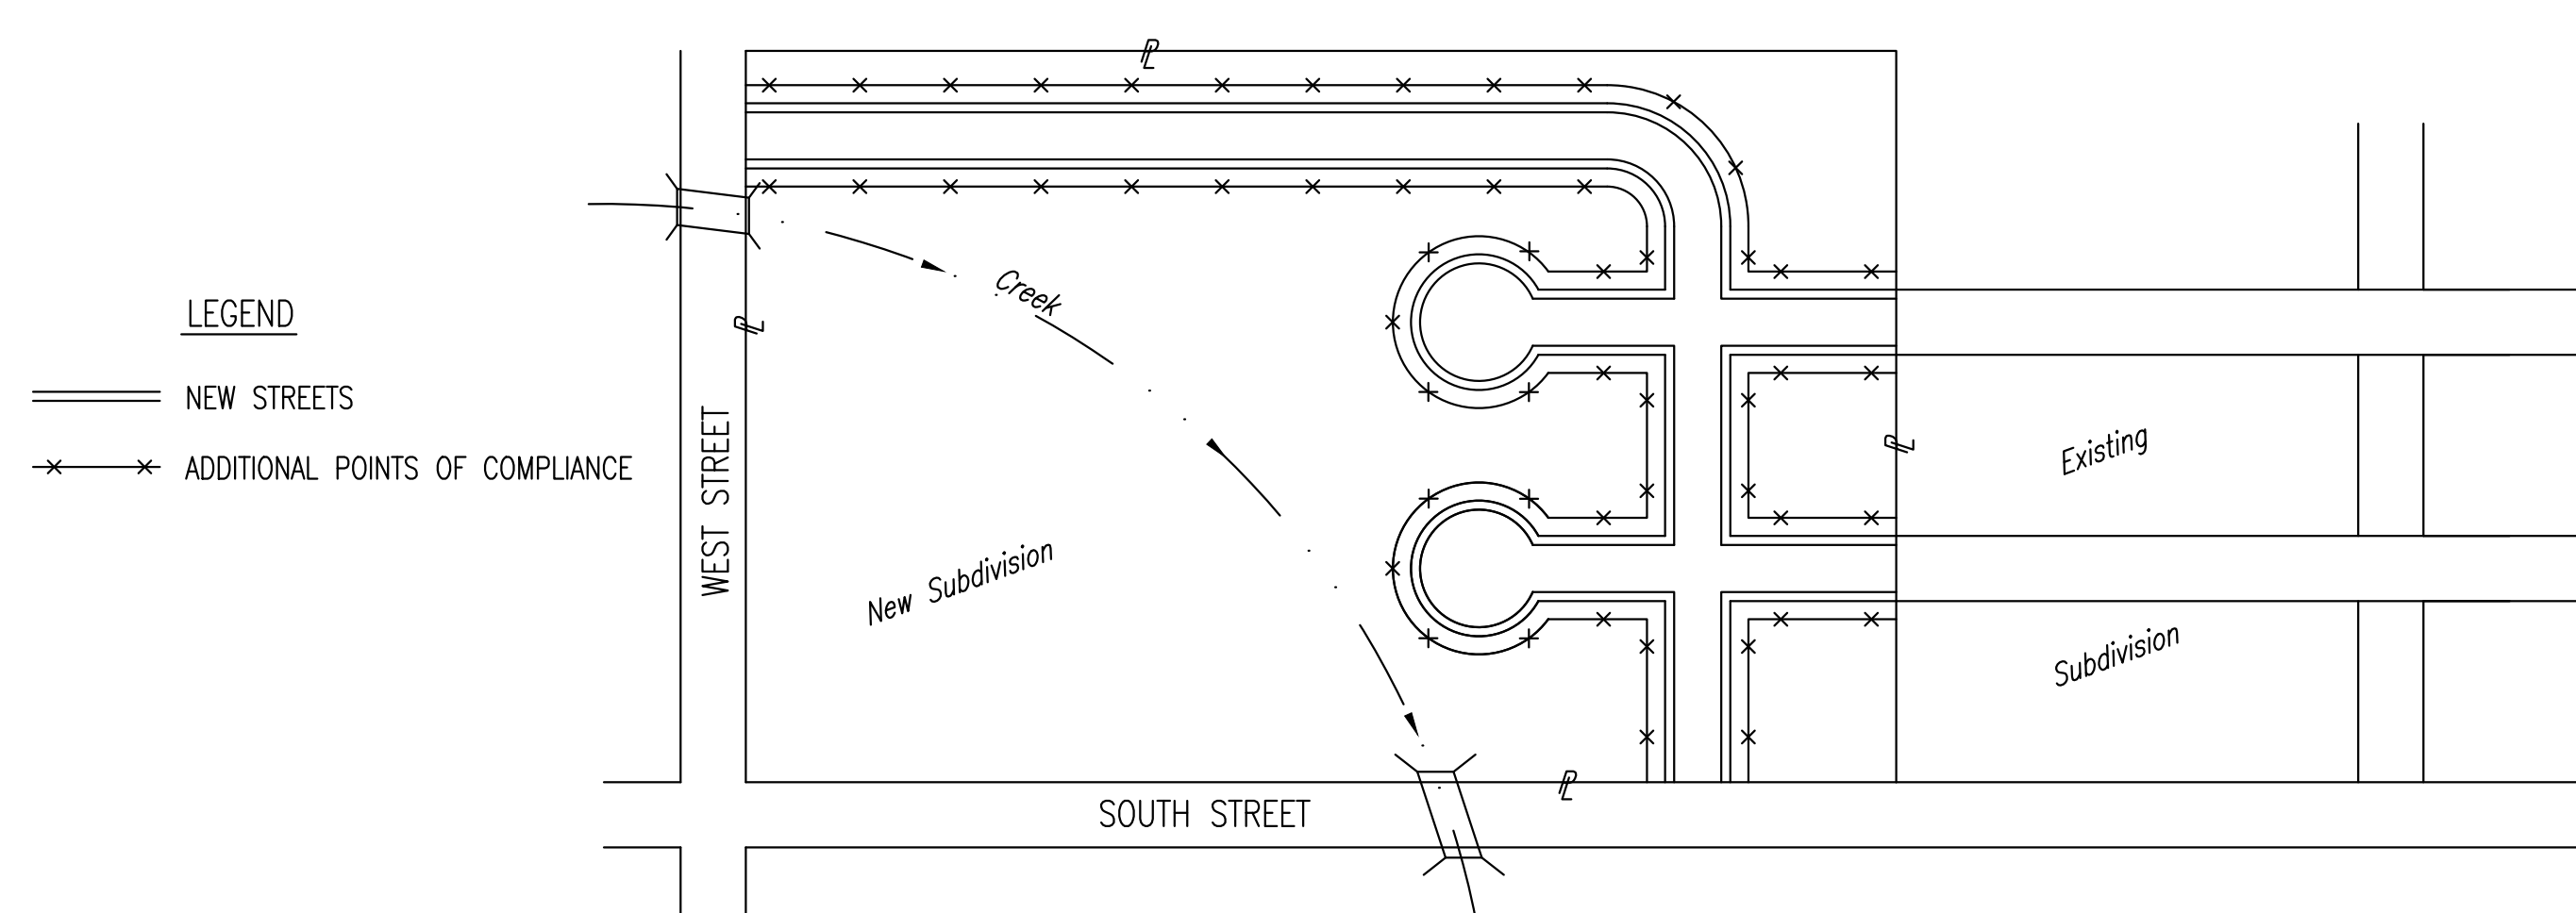

- DURING THIS PHASE OF SUBDIVISION CONSTRUCTION, NEW STREETS ARE INSTALLED. ALL EROSION CONTROL DEVICES INSTALLED DURING PHASE 1 AND 2 MUST STILL BE MAINTAINED. THE POINT OF COMPLIANCE NOW SHIFTS TO THE BACK OF CURB ALONG EACH STREET.
- CURB OPENING INLET PROTECTION:
 - SUMP AREAS – INLET PROTECTION SHALL BE PROVIDED WHEN STREET SUBGRADE WORK IS COMPLETED.
 - NON-SUMP LOCATIONS – PROVIDE INLET PROTECTION AS SOON AS BASE COURSE ASPHALT IS INSTALLED, BEFORE THE SURFACE COURSE LIFT.
- EROSION CONTROL DEVICES WILL BE REQUIRED BACK OF CURB WHEREVER WATER CAN FLOW OVER THE CURB AND THE CURB HAS BEEN BACKFILLED TO WITHIN 3" OR LESS OF THE TOP OF CURB (SEE CURB BACKFILL DETAIL). FOR CURBS NOT YET ENTIRELY BACKFILLED (3" OR MORE BELOW TOP OF CURB), ADDITIONAL DEVICES WILL BE REQUIRED AT POINTS WHERE WATER BREAKS OVER CURB WHICH COULD RESULT IN THE PLACEMENT OF SEDIMENT IN THE GUTTER.
- SEE DETAIL SHEET FOR BACK OF CURB PROTECTION.
- THE BACK OF CURB PROTECTION SPECIFIED ON THIS PLAN MAY HAVE TO BE SUPPLEMENTED WITH HAY BALE OR SILT FENCE EROSION CONTROL DEVICES AT LOCATIONS WHERE CONCENTRATED FLOW RESULTS IN SEDIMENT BEING CARRIED OVER THE EXCELSIOR MATS.
- THE STREET CONTRACTOR WILL BE RESPONSIBLE FOR INSTALLING BACK OF CURB EROSION CONTROL DEVICES.
- THE INDIVIDUAL LOT OWNERS WILL BE RESPONSIBLE FOR MAINTAINING THE BACK OF CURB EROSION CONTROL DEVICES IN FRONT OF THEIR LOTS UNTIL SUCH TIME AS ADJACENT DISTURBED EARTH IS STABILIZED WITH GRASS OR SOD.

PHASE 2 – INSTALLATION OF STORM SEWER

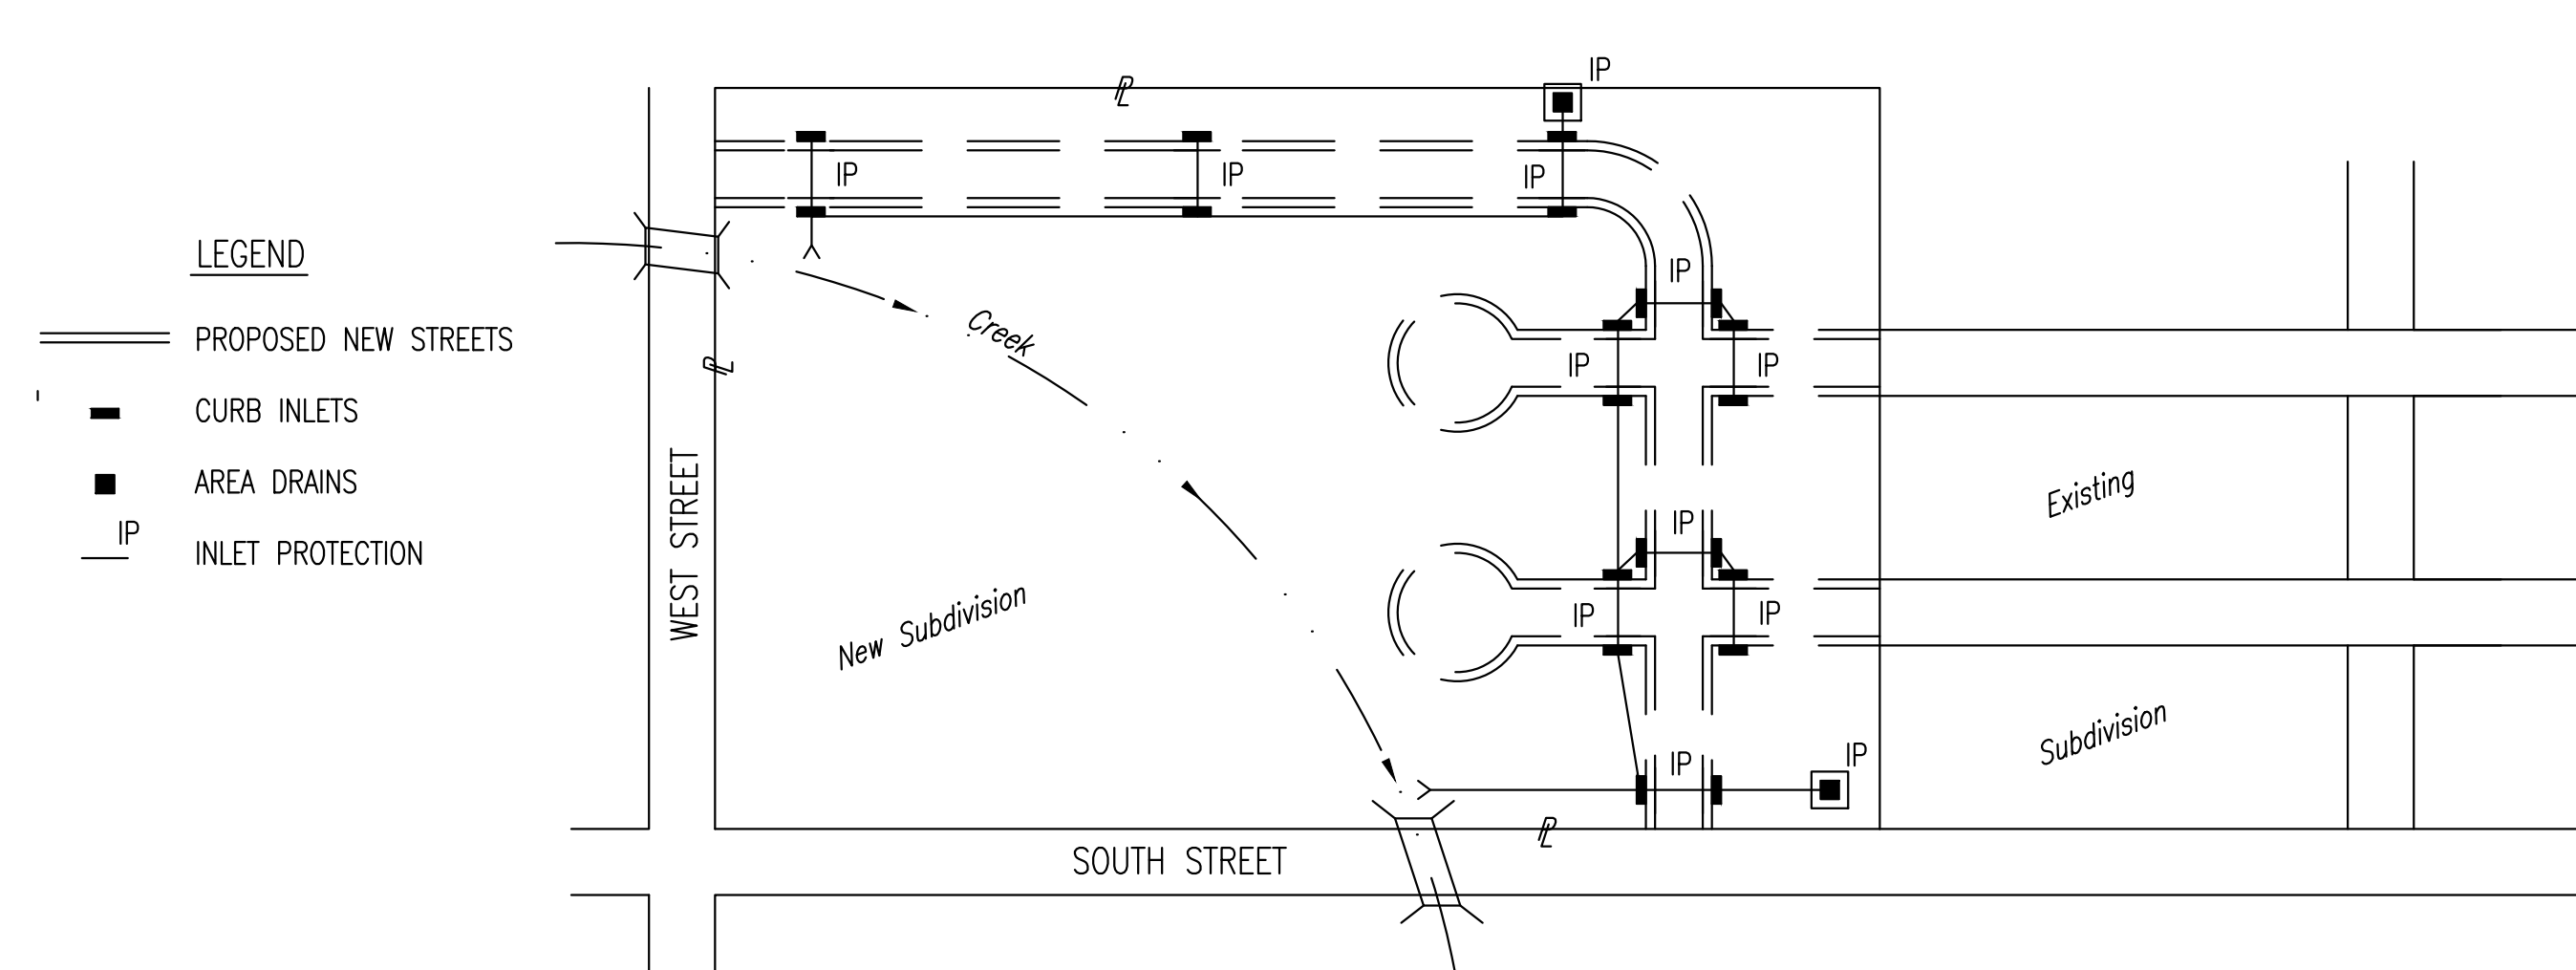


- DURING THIS PHASE OF SUBDIVISION DEVELOPMENT, ALL EROSION CONTROL DEVICES REQUIRED IN PHASE 1 SHALL REMAIN IN PLACE AND BE MAINTAINED.
- AS NEW STORM SEWERS, WITH INLETS, ARE INSTALLED, THE STORM SEWERS MUST NOW BE PROTECTED SO ALL NEW INLETS BECOME POINTS OF COMPLIANCE.
- AREA DRAINS – AS SOON AS WATER CAN FLOW INTO THESE DRAINS, HAY BALE OR SILT FENCE PROTECTION WILL BE INSTALLED AROUND THEM.
- CURB OPENING INLETS – AS SOON AS WATER CAN FLOW INTO THESE DRAINS, INLET PROTECTION DEVICES MUST BE INSTALLED. IF WATER CANNOT FLOW INTO CURB INLETS UNTIL STREET CONSTRUCTION IS COMPLETE, THEN STREET CONTRACTOR WILL INSTALL INLET PROTECTION. SEE PHASE 3 – STREET CONSTRUCTION.
- THE STORM SEWER CONTRACTOR WILL BE RESPONSIBLE FOR INSTALLING THESE DEVICES.
- THE SUBDIVISION DEVELOPER WILL MAINTAIN THESE EROSION CONTROL DEVICES ONCE INSTALLED.
- ALL DISTURBED GROUND WILL BE FINAL GRADED AND TEMPORARILY OR PERMANENTLY SEEDED WITHIN 14 DAYS IF COMPLETION OF WORK IN ANY GIVEN PART OF THE SUBDIVISION.
- ONCE ALL DISTURBED GROUND DRAINING TO AN INLET HAS BEEN RESTABILIZED WITH GRASS OR SOD, THE SUBDIVISION DEVELOPER WILL BE RESPONSIBLE FOR PERMANENTLY REMOVING THE INLET PROTECTION.

GENERAL NOTES:


- THE INTENT OF ALL EROSION CONTROL DEVICES IS TO PREVENT ERODED SOIL FROM ENTERING DITCHES, STORM SEWERS, LAKES, STREETS OR ANY OTHER OTHER DRAINAGE FEATURE.
- THIS SHEET IS INTENDED TO PROVIDE GUIDELINES AS TO WHAT TYPE OF EROSION CONTROL DEVICES WILL BE INSTALLED DURING THE CONSTRUCTION PROCESS. CONTRACTORS ARE EXPECTED TO BID PROJECTS ACCORDINGLY.
- EROSION CONTROL DEVICES SHALL BE MAINTAINED DURING THE CONSTRUCTION PROCESS TO REMAIN EFFECTIVE. MAINTENANCE SHALL BE AS INDICATED ON SOIL EROSION BMP'S DETAIL SHEETS.
- PERSONS DESTROYING EROSION CONTROL DEVICES SHALL BE RESPONSIBLE FOR IMMEDIATELY REPAIRING THEM OR INSTALLING SUITABLE REPLACEMENT DEVICES.
- THE DEVELOPMENT OF ANY SUBDIVISION THAT DISTURBS 1 ACRE OR MORE WILL REQUIRE A FEDERAL/STATE NPDES STORMWATER PERMIT. THE PREPARATION OF A STORMWATER POLLUTION PREVENTION PLAN IS REQUIRED. EROSION CONTROL DEVICES ARE REQUIRED. THE DETAILS SHOWN ON THIS SHEET ARE THE MINIMUM STANDARDS TO BE SHOWN ON POLLUTION PREVENTION PLANS.
- FOR SUBDIVISIONS SMALLER THAN 1 ACRE, SOIL EROSION DEVICES ARE REQUIRED. ALSO, DEVELOPERS AND CONTRACTORS ARE ENCOURAGED TO DEVELOP POLLUTION PREVENTION PLANS FOR EACH PROJECT PRIOR TO CONSTRUCTION.
- FAILURE TO USE AND MAINTAIN SOIL EROSION DEVICES IS A VIOLATION OF SECTION 16.32 OF THE CITY CODE AND WILL SUBJECT THE SUBDIVISION DEVELOPER AND CONTRACTORS TO THE PENALTIES PROVIDED THEREIN.
- THE APPLICATION OF EROSION CONTROL DEVICES SHOWN ON THIS SHEET IS FOR SITUATIONS NORMALLY ENCOUNTERED. FROM TIME TO TIME, SITUATIONS WILL ARISE THAT MAY REQUIRE DEVICES OTHER THAN THAT SHOWN. EROSION CONTROL DEVICES, OTHER THAN THOSE SHOWN, MAY BE UTILIZED SO LONG AS THEY ARE EFFECTIVE AND MAINTAINED.
- A STABILIZED EARTH SURFACE IS DEFINED AS ONE THAT IS HARD SURFACED WITH CONCRETE, ASPHALT, OR THE LIKE, OR ONE ON WHICH 70% OF THE GRASS HAS GERMINATED ON THE ENTIRE SURFACE.

SEE DETAIL SHEET FOR BACK OF CURB PROTECTION DETAIL

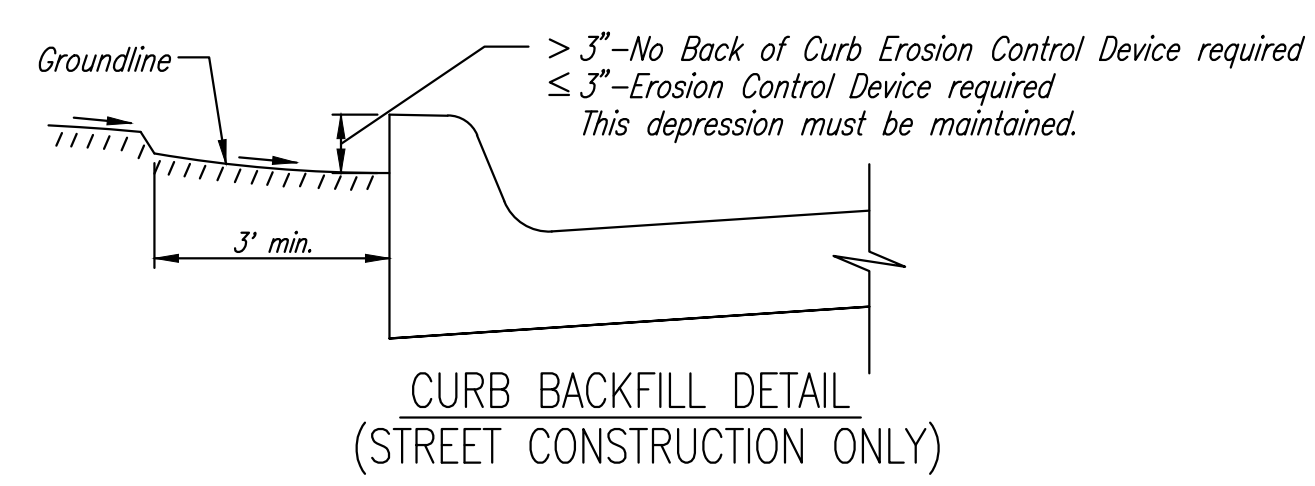


PLOTTED BY: BRYAN SMITH 4/27/2026 4:48 PM
 DWG PATH: J:\PROJECTS\2025\2501010800_JGR_THE RESERVE AT THE MEADOWS\DWG\BHS\05 CIVILISTE
 DWG NAME: 2501010800 CIVILISTE.dwg
 ©2026 MKEC ENGINEERING, INC. ALL RIGHTS RESERVED WWW.MKEC.COM THESE DRAWINGS AND THEIR CONTENTS, INCLUDING, BUT NOT LIMITED TO, ALL CONCEPTS, DESIGNS, & IDEAS ARE THE EXCLUSIVE PROPERTY OF MKEC ENGINEERING, INC. (MKEC) AND MAY NOT BE USED OR REPRODUCED IN ANY WAY WITHOUT THE EXPRESS CONSENT OF MKEC.


CIVIL PLANS FOR
THE RESERVE AT THE MEADOWS
GODDARD, KS

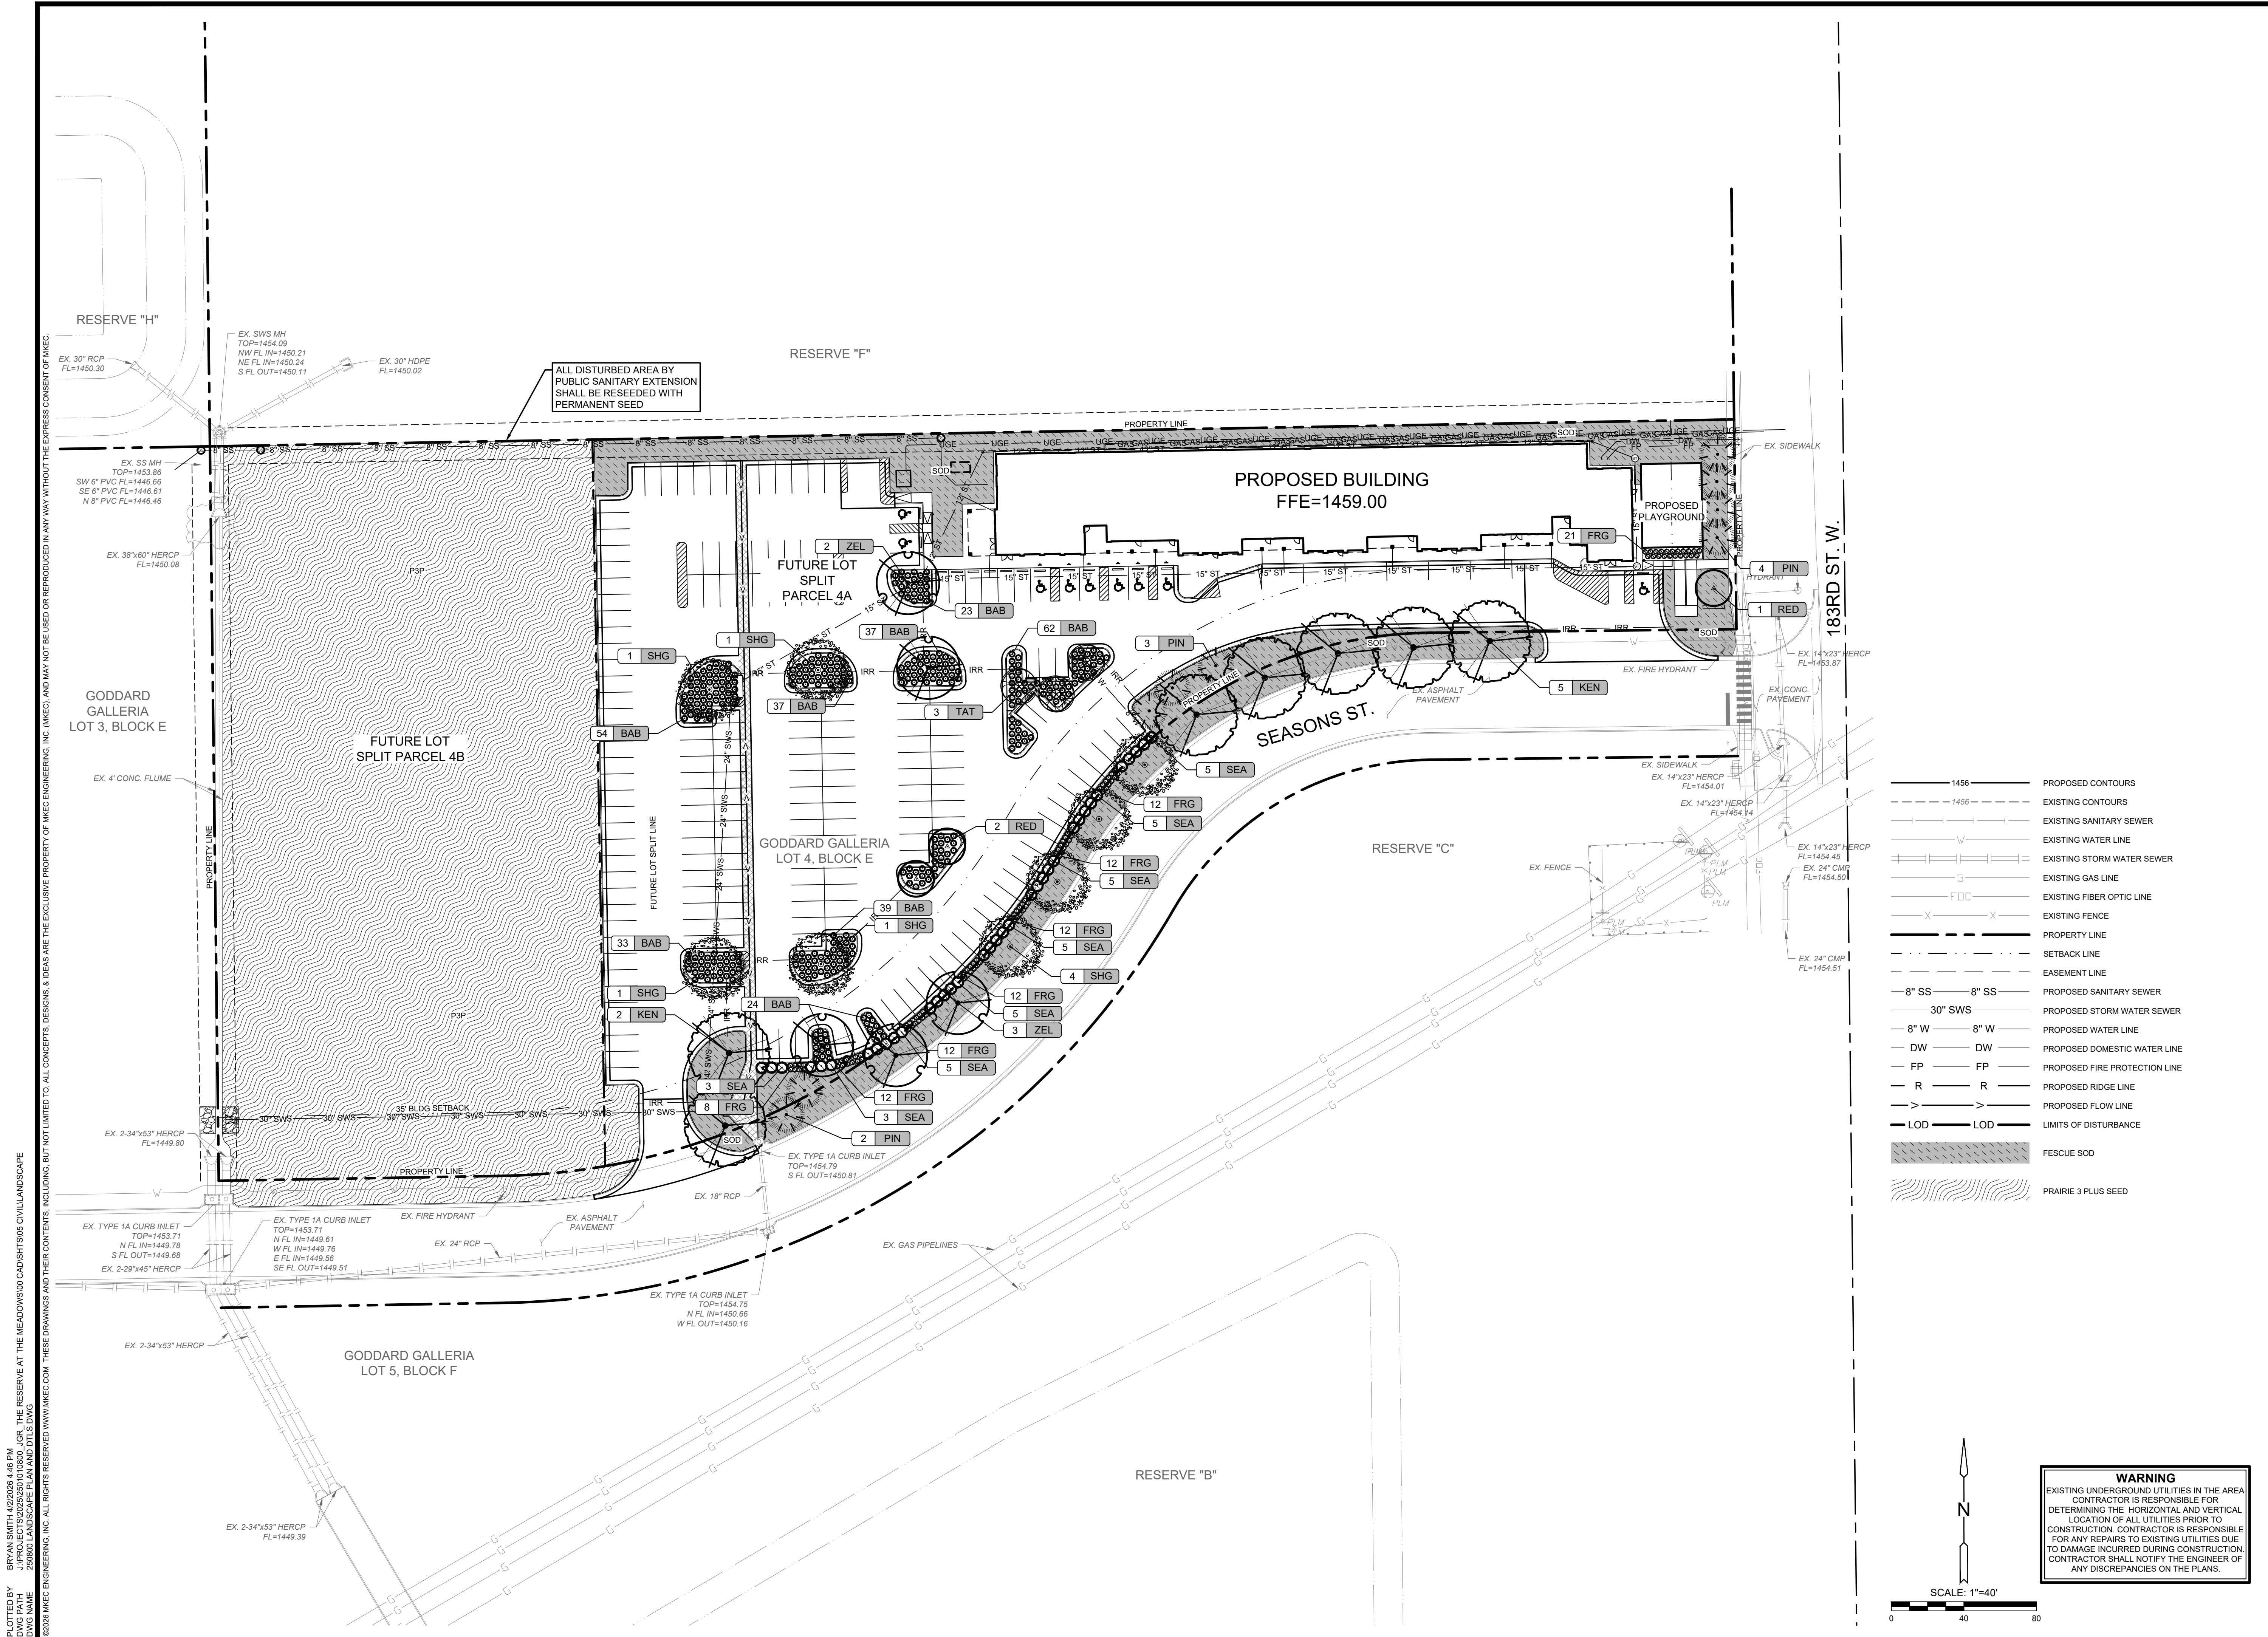

ALL DISTURBED AREA BY PUBLIC SANITARY EXTENSION SHALL BE RESEEDED WITH PERMANENT SEED

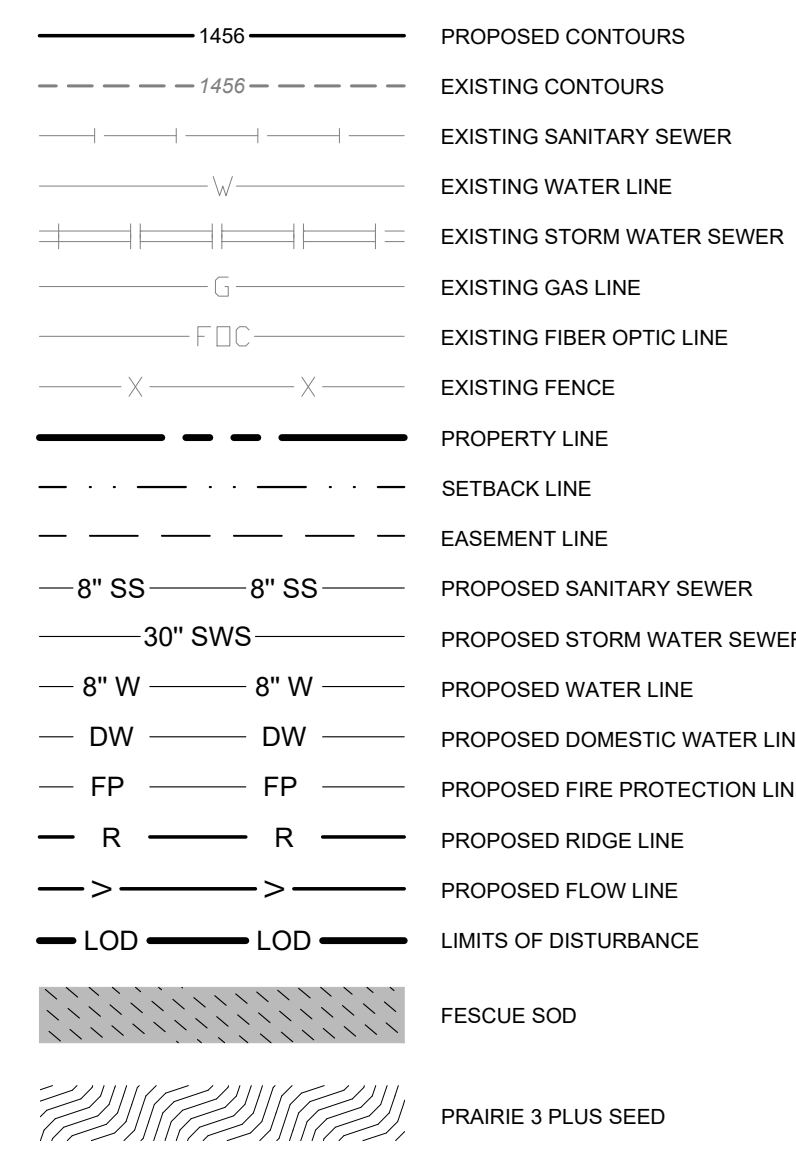

WARNING
EXISTING UNDERGROUND UTILITIES IN THE AREA CONTRACTOR IS RESPONSIBLE FOR DETERMINING THE HORIZONTAL AND VERTICAL LOCATION OF ALL UTILITIES PRIOR TO CONSTRUCTION. CONTRACTOR IS RESPONSIBLE FOR ANY REPAIRS TO EXISTING UTILITIES DUE TO DAMAGE INCURRED DURING CONSTRUCTION. CONTRACTOR SHALL NOTIFY THE ENGINEER OF ANY DISCREPANCIES ON THE PLANS.

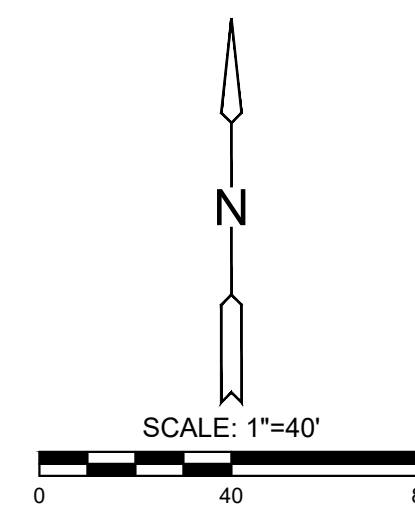

PLOTTED BY: BRYAN SMITH 4/22/2026 4:48 PM
DRAWING PATH: J:\PROJECTS\2025\2501010800_GOR_THE RESERVE AT THE MEADOWS\00 CAD\BISHOP CIVILLANDSCAPE
DRAWING NAME: 2501010800 LANDSCAPE PLAN AND UTILITIES
© 2026 MKEC ENGINEERING, INC. ALL RIGHTS RESERVED WWW.MKEC.COM THESE DRAWINGS AND THEIR CONTENTS, INCLUDING, BUT NOT LIMITED TO, ALL CONCEPTS, DESIGNS, & IDEAS ARE THE EXCLUSIVE PROPERTY OF MKEC ENGINEERING, INC. (MKEC) AND MAY NOT BE USED OR REPRODUCED IN ANY WAY WITHOUT THE EXPRESS CONSENT OF MKEC.


LANDSCAPE PLAN	
PROJECT NO.	2501010800
SCALE	1"=40'
DRAWN	WJW
DESIGNED	WJW
CHECKED	JAG
NO.	0
ISSUED FOR PERMIT	04/03/26
REVISION	DATE
SHEET NO.	L-101

GENERAL LANDSCAPE NOTES

- CONTRACTOR SHALL MAKE THEMSELVES FAMILIAR WITH ALL APPLICABLE SPECIFICATIONS RELATED TO THE LANDSCAPE AND IRRIGATION.
- LANDSCAPE CONTRACTOR IS TO VERIFY THE LOCATION OF ALL UNDERGROUND UTILITIES (INCLUDING THOSE INDICATED ON THE PLAN) PRIOR TO INSTALLATION OF PLANT MATERIAL. UTILITIES CAN BE FLAGGED BY CALLING 811, OR 1-800-344-7233, OR ONLINE AT www.kansasonecall.com. DAMAGE TO UTILITIES SHALL BE AVOIDED DURING THE COURSE OF WORK. THE LANDSCAPE CONTRACTOR IS RESPONSIBLE FOR REPAIRING ANY AND ALL DAMAGE TO UTILITIES, STRUCTURES, SITE APPURTENANCES, ETC. WHICH OCCUR AS A RESULT OF THE LANDSCAPE CONSTRUCTION.
- LANDSCAPE CONTRACTOR SHALL COORDINATE WITH THE MASS GRADING CONTRACTOR TO INSURE THEY THOROUGHLY RIP AND ALLEVIATED ALL COMPACTED SOILS FROM THEIR HAULING AND PLACEMENT OPERATIONS.
- ALL WATER REQUIRED FOR LANDSCAPE OPERATIONS AND FOR ESTABLISHING LANDSCAPE ON THIS SITE WILL BE PROVIDED BY THE OWNER FROM ON-SITE SOURCES AND SUPPLIED TO THE LANDSCAPE CONTRACTOR AT NO CHARGE.
- PLANTING DATES FOR PLANT MATERIAL SHALL BE DURING THE MONTHS BETWEEN FEB. 15TH AND MAY 31ST OR SEPT. 15TH AND DEC. 15. PLANTING SHALL ONLY BE CONDUCTED WHEN THE GROUND IS NOT FROZEN, SNOW-COVERED, OR IN AN OTHERWISE UNSUITABLE CONDITION FOR PLANTING. DEVIATION FROM THE ABOVE PLANTING DATES WILL ONLY BE PERMITTED WITH APPROVAL FROM THE OWNER'S REPRESENTATIVE.
- MULCHED LANDSCAPE BED EDGES SHALL BE LINED WITH PRO-STEEL EDGING (OR APPROVED EQUAL).
- MULCH ADJACENT TO BUILDINGS SHALL BE SIX (6) INCHES LOWER THAN BUILDING FINISH FLOOR ELEVATION.
- ALL SHRUB/PERENNIAL PLANTING BEDS SHALL BE TREATED WITH A PRE-EMERGENT HERBICIDE SUCH AS TREFLAN OR EQUAL. APPLY AS PER MANUFACTURER'S RECOMMENDATION. THE PRE-EMERGENT SHALL NOT BE APPLIED UNTIL AFTER ALL PLANTING AND MULCHING WITHIN THESE AREAS ARE COMPLETE. DO NOT DISTURB AREAS AFTER APPLICATION. WATER IN AS DIRECTED.
- INSTALL 3" MIN. DEPTH FINE-SHREDDED, DARK HARDWOOD MULCH IN ALL PLANTING BED AREAS AND WITHIN A 4' DIAMETER CIRCLE AROUND ALL TREES PLANTED IN LAWN AREAS. PULL MULCH AWAY FROM TREE TRUNKS WITHIN 3" OF TRUNK.
- IF POSSIBLE, BASED ON TIME OF YEAR SITE IS READY FOR LANDSCAPING, PLANT TREES PRIOR TO ROUTING/INSTALLING IRRIGATION LINES AND SUSTAIN TEMPORARILY BY WATERING WITH IRRIGATOR SLOW DRIP IRRIGATION BAGS OR BY HAND WATERING. FOLLOW TREE PLANTING WITH INSTALLATION OF IRRIGATION SYSTEM, THEN BY SODDING AND SEEDING (IF APPLICABLE).
- FESCUE SOD SHALL BE HARVESTED & PLACED BETWEEN THE DATES OF APRIL 1ST AND JUNE 15TH UNLESS OTHERWISE APPROVED BY THE OWNER'S REPRESENTATIVE. IT IS THE CONTRACTOR'S RESPONSIBILITY TO WATER ALL SOD UNTIL LANDSCAPE JOB IS COMPLETE.
- AREAS DENOTED AS 'SOD' SHALL BE PLANTED WITH THE FOLLOWING GRASS TYPE:
SOD:
KANSAS PREMIUM BLEND, OBTAINABLE FROM CRANMER GRASS FARM, INC., 6121 N. 119TH, MAIZE, KANSAS 67101, PH# (316) 722-7230.
- ALL SOD AREAS SHALL BE INSTALLED AS FOLLOWS: AFTER FINAL GRADE IS ESTABLISHED AND ALL SOIL AREAS DRAIN AS INTENDED, AND ALL SURFACE IRREGULARITIES HAVE BEEN REMOVED, THOROUGHLY PREPARE SODDED BY TILLING TO A MINIMUM DEPTH OF 3" AND HARROWING. ROLL SOD FOLLOWING LAYING FOR GOOD SOD/SOIL CONTACT AND KEEP IN A MOIST (BUT NOT SATURATED) CONDITION FOR FIRST TWO WEEKS TO PROMOTE GOOD ROOTING. FERTILIZE WITH 1 LB. ACTUAL NITROGEN PER 1,000 S.F. AT TIME OF PLANTING.
- ALL LANDSCAPE AND TURF AREAS SHALL BE WATERED BY AN AUTOMATIC IRRIGATION SYSTEM. IRRIGATION SYSTEM SHALL BE EQUIPPED WITH A RAIN-SENSING DEVICE TO SHUT OFF THE SYSTEM DURING PERIODS OF ADEQUATE RAIN.
- PLACEMENT OF IRRIGATION CONTROLLER SHALL BE COORDINATED WITH THE OWNER'S REPRESENTATIVE.
- COORDINATE LANDSCAPE PLANTING WITH IRRIGATION CONTRACTOR. THE TREE PLANTINGS SHALL BE IN PLACE OR STAKED BEFORE IRRIGATION LINE ROUTING BEGINS TO AVOID CONFLICTS. THE IRRIGATION SYSTEM SHALL BE COMPLETE AND FULLY FUNCTIONAL IN ALL LAWN AREAS BEFORE SOD/SEED IS PLACED.
- ALL PLANTS SHALL CONFORM TO ANSI Z60.1 FOR SIZE AND QUALITY STANDARDS.
- LABEL EACH PLANT WITH A SECURELY ATTACHED, WATERPROOF TAG BEARING LEGIBLE DESIGNATION OF BOTH BOTANICAL AND COMMON NAME. DO NOT REMOVE UNTIL AFTER PROVISIONAL ACCEPTANCE.
- SUBSTITUTION OF PLANT SPECIES FOR THOSE LISTED IN THE PLANT LIST IS NOT PERMISSIBLE. ONLY SIZE WILL BE CONSIDERED.
- ALL PLANTS MUST BE HEALTHY, VIGOROUS MATERIAL, FREE OF PEST AND DISEASES. ALL PLANTS MUST BE CONTAINER-GROWN OR BALLED AND BURLAPPED AS INDICATED IN THE PLANT LIST. ALL TREES SHALL BE STRAIGHT-TRUNKED, OR OF TYPICAL FORM TO THE SPECIES, FULL-HEADED AND MEET THE REQUIREMENTS AS SPECIFIED. ALL TREES MUST BE STAKED.
- STAKES AND GUYING SHALL BE REMOVED AT THE END OF ONE FULL GROWING SEASON.
- ALL PLANTS ARE SUBJECT TO THE APPROVAL OF THE LANDSCAPE ARCHITECT BEFORE, DURING, AND AFTER INSTALLATION. REJECTED PLANTS SHALL BE REMOVED IMMEDIATELY.
- ALL LANDSCAPE PLANTS SHALL BE GUARANTEED FOR ONE YEAR FOLLOWING INITIAL ACCEPTANCE. DEAD OR DEFICIENT PLANTINGS SHALL BE ACCEPTABLY REPLACED, IN PROPER PLANTING SEASON, ONE TIME AT NO COST TO THE OWNER. SOD AREAS MAY BE FINAL ACCEPTED AT TIME OF COMPLETION OF ESTABLISHMENT WITH NO FURTHER GUARANTEE REQUIRED.
- LANDSCAPE CONTRACTOR SHALL BE RESPONSIBLE FOR MAINTAINING, (INCLUDING WATERING AND MOWING), SOD AREAS UNTIL ACCEPTANCE OF THESE AREAS. WHEN READY, THE LANDSCAPE CONTRACTOR SHALL REQUEST INSPECTION OF ESTABLISHED SODDED AREAS BY THE OWNER'S REPRESENTATIVE.
- TOPSOIL FOR ALL LANDSCAPE BEDS AND PARKING ISLANDS SHALL BE A MINIMUM OF TWENTY-FOUR INCHES (24") DEPTH.

NOTES:

BALL OF PLANT TO BE KEPT MOIST AND PROTECTED FROM DAMAGE PRIOR TO PLANTING. ADD ROOT STIMULATOR TO SURFACE IMMEDIATELY AFTER PLANTING AS PER THE MANUFACTURER'S RECOMMENDATIONS. PLANTING DEPTH SHALL BE DETERMINED BY SETTING THE ROOT FLARE 1"-2" ABOVE FINISHED GRADE. DO NOT ASSUME ROOT FLARE IS AT TOP OF ROOTBALL. DO NOT OVERTIGHTEN GUYS.

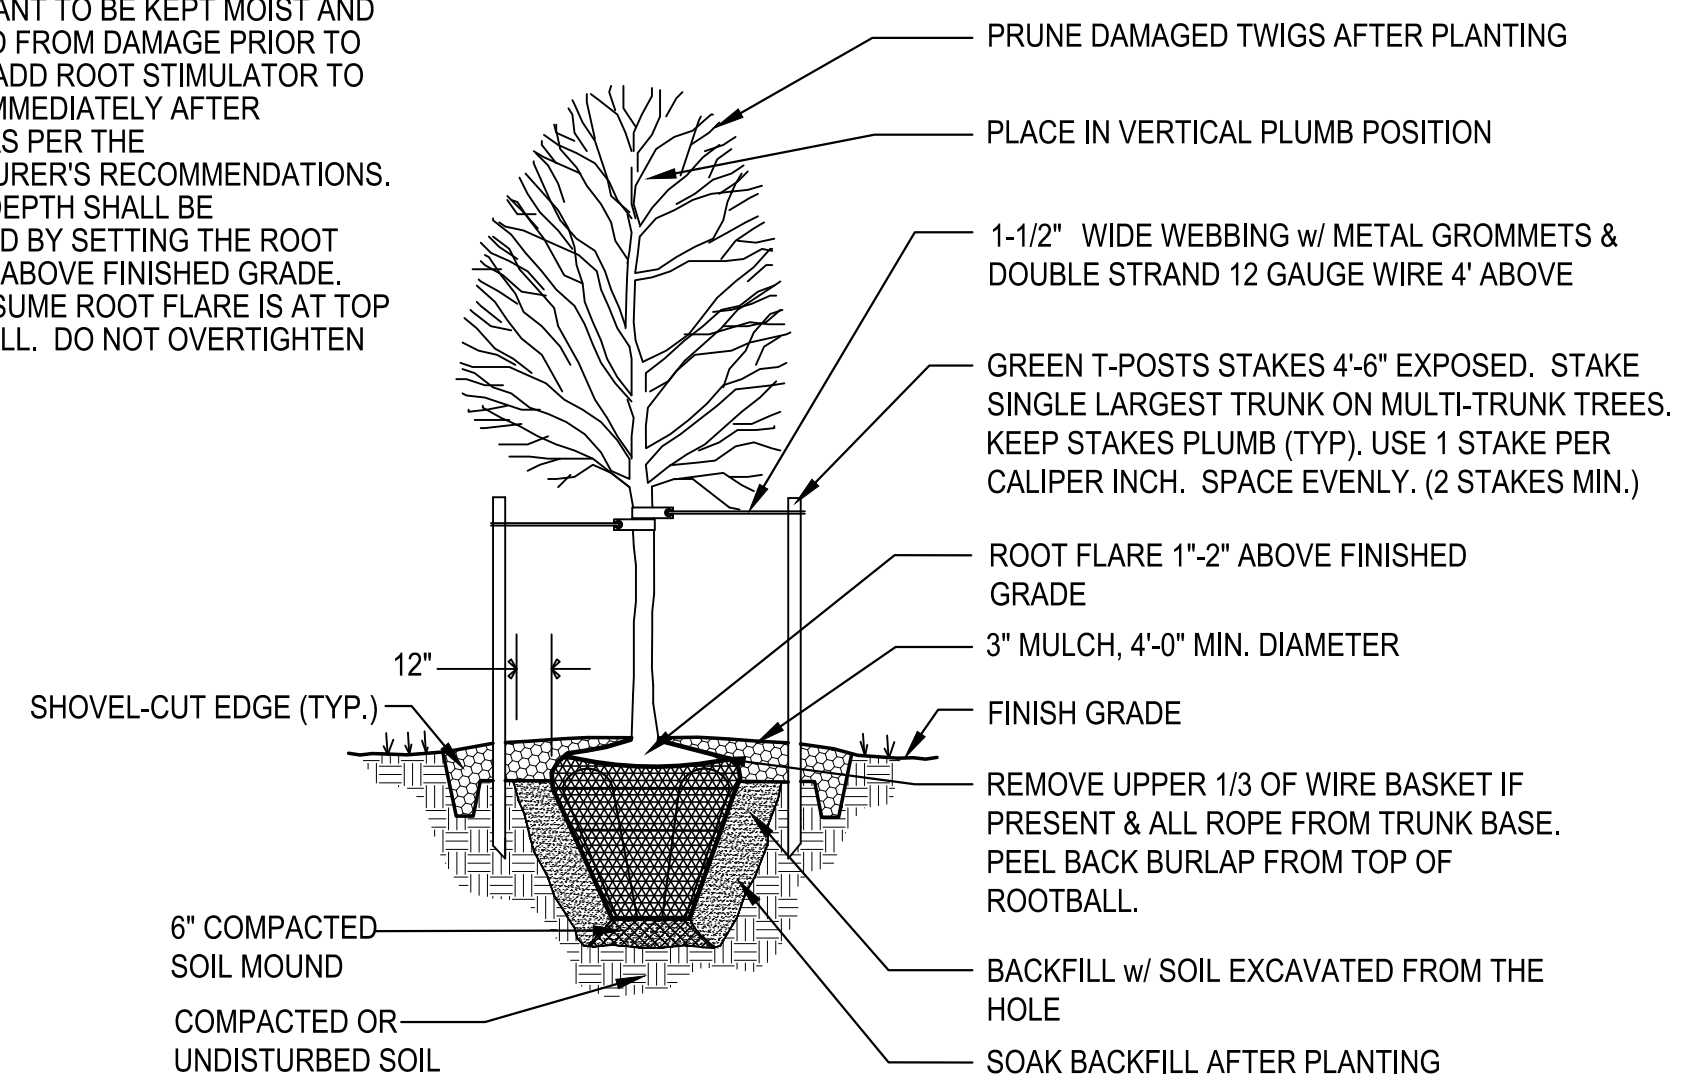


TREE PLANTING IN TURF AREA DETAIL

NOT TO SCALE

NOTES:

1. BALL OF PLANT TO BE KEPT MOIST AND PROTECTED FROM DAMAGE PRIOR TO PLANTING.
2. ADD ROOT STIMULATOR TO SURFACE IMMEDIATELY AFTER PLANTING AS PER THE MANUFACTURER'S RECOMMENDATIONS.
3. PLANTING DEPTH OF ROOTBALL SHALL BE EQUAL TO ITS ORIGINAL PLANTING DEPTH AT NURSERY.

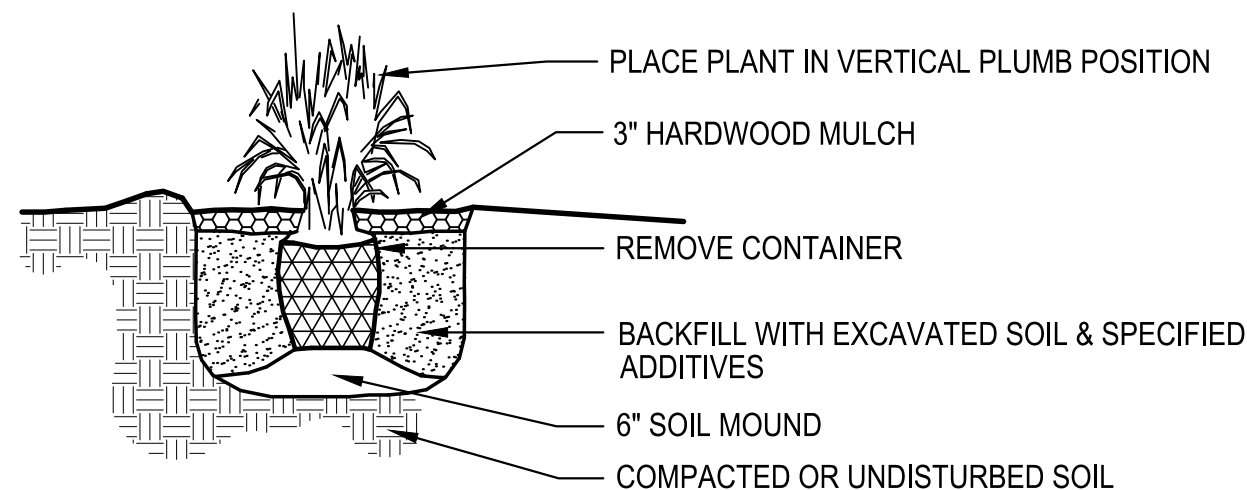


ORNAMENTAL GRASS PLANTING DETAIL

NOT TO SCALE

NOTES:

BALL OF PLANT TO BE KEPT MOIST AND PROTECTED FROM DAMAGE PRIOR TO PLANTING. ADD ROOT STIMULATOR TO SURFACE IMMEDIATELY AFTER PLANTING AS PER THE MANUFACTURER'S RECOMMENDATIONS. PLANTING DEPTH OF ROOTBALL SHALL BE EQUAL TO ITS ORIGINAL PLANTING DEPTH AT NURSERY.

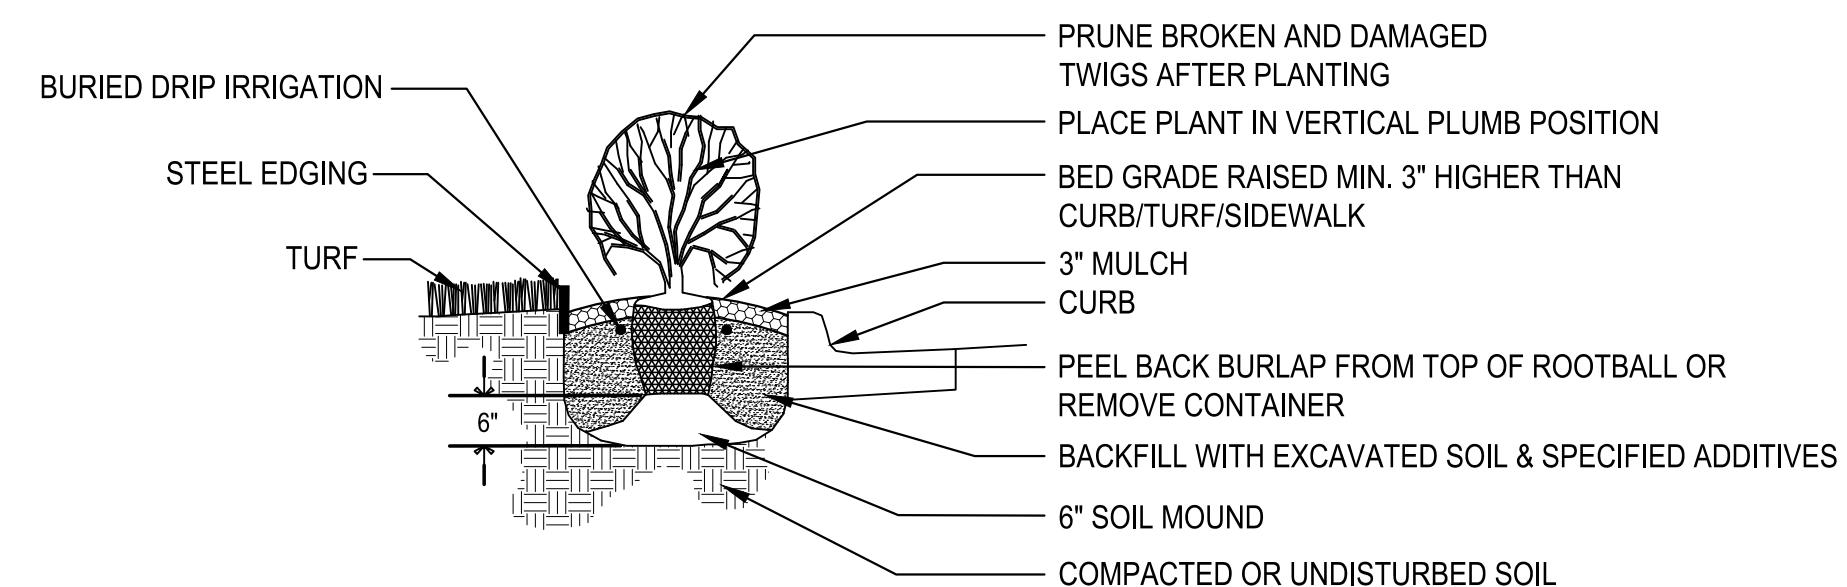

SHRUB PLANTING DETAIL

NOT TO SCALE

PLANT SCHEDULE

CODE	QTY	COMMON NAME	BOTANICAL NAME	CONT	CAL	SIZE
DECIDUOUS TREES						
KEN	7	ESPRESSO™ KENTUCKY COFFEETREE	GYMNOCLADUS DIOICUS 'ESPRESSO-JFS'	FG B&B	2" CAL MIN.	
SHG	8	SHINGLE OAK	QUERCUS IMBRICARIA	FG B&B	2" CAL MIN.	
ZEL	5	GREEN VASE JAPANESE ZELKOVA	ZELKOVA SERRATA 'GREEN VASE'	FG B&B	2" CAL MIN.	
EVERGREEN TREES						
PIN	9	PINYON PINE	PINUS CEMBROIDES EDULIS	FG B&B		8' HT. MIN.
ORNAMENTAL TREES						
RED	3	EASTERN REDBUDD	CERCIS CANADENSIS	FG B&B	1.5" CAL MIN.	
TAT	3	HOT WINGS® TATARIAN MAPLE	ACER TATARICUM 'GARANN'	FG B&B	1.5" CAL MIN.	
CODE	QTY	COMMON NAME	BOTANICAL NAME	CONT	SPACING	SIZE
EVERGREEN SHRUBS						
SEA	36	SEA GREEN JUNIPER	JUNIPERUS CHINENSIS 'SEA GREEN'	5 GAL.		
ORNAMENTAL GRASSES						
BAB	337	BLONDE AMBITION BLUE GRAMA	BOUTELOUA GRACILIS 'BLONDE AMBITION'	1 GAL.		
FRG	101	KARL FOERSTER FEATHER REED GRASS	CALAMAGROSTIS X ACUTIFLORA 'KARL FOERSTER'	1 GAL.		
GROUND COVERS						
P3P	88,102 SF	PRAIRIE 3 PLUS	PRAIRIE SEED	SEED		
SOD	24,072 SF	DROUGHT TOLERANT FESCUE BLEND	TURF SOD	SOD		