

GENERAL NOTES - STRUCTURAL

- The contractor shall verify dimensions and conditions before construction and notify the engineer of any discrepancies, inconsistencies, or difficulties affecting the work before proceeding.
- The contractor shall coordinate all disciplines, verifying size and location of all openings, whether shown on structural drawings or not, as called for on architectural or electrical drawings. All conflicts, inconsistencies, or other difficulties affecting structural work shall be called to the architect or engineer's attention for direction before proceeding.
- All design and construction work for this project shall conform to the requirements of the 2024 International Building Code, as amended by the City of Goddard, Kansas.
- These drawings are for this specific project and no other use is authorized.

Structural Design Load Criteria:

A. Dead Load:	
Roofs	= 40 psf
Roof/Top Patio	= 20 psf
B. Live Load:	
Floors	= 25 psf
Maintenance Platform	= 40 psf
Public	= 100 psf

C. Snow:
 $P_g = 24 \text{ psf}, C_e = 1.0$
 $P_f = 20 \text{ psf}, P_s = 20 \text{ psf}, P_m = 24 \text{ psf}$
 $I_s = 1.0, C_s = 1.0, C_t = 1.18$
 DNF: 4 unbalanced snow loads per ASCE/SEI 7-22

- D. Lateral Loads:
 - Wind V = 110 mph, exposure B, $C_{cp} = +/- 1.08$
 Design wind pressures to be used for the design of exterior components and cladding materials on the designated zones of walls and roof structure shall be per Section 501 and Table 301.1-2 of ASCE/SEI 7-10. Tabulated pressures shall be multiplied by effective area reduction factors, exposure adjustment factors, and topographic factors where applicable.
 - Seismic: $S_s = 0.12, S_1 = 0.06, I_e = 1.0$
 Site Classification D (Assumed).
 Seismic Design Category B.
 Basic Seismic Force-Resisting System:
 AIT - Light-Framed Walls with Shear Panels of All Other Materials
 $R=2, \Omega = 2.1/2, C_d = 2, V_s = 1.009N$
- This project is designed to resist the most critical effects resulting from the least combinations of section 1605.3 of the 2024 International Building Code.

6. Concrete:

- All concrete for foundations (walls, grade beams, and footings) shall develop minimum ultimate compressive design strength of 3500 psi in 28 days, but not less than 500 pounds of cement shall be used per cubic yard of concrete regardless of strengths obtained, not over 6 gallons of water per 100 pounds of cement and not over 4 inches of slump.
- All concrete for interior floor work shall develop minimum ultimate compressive design strength of 4000 psi in 28 days, but not less than 560 pounds of cement shall be used per cubic yard of concrete regardless of strengths obtained, not over 5 gallons of water per 100 pounds of cement and not over 4 inches of slump.
- Concrete for exterior floors shall have a minimum design compressive strength of 4500 psi in 28 days, with not less than 560 pounds of cement per cubic yard of concrete, not over 5 gallons of water per 100 pounds of cement, with 6% ± air entrainment, and a maximum of 4 inches of slump.
- The preceding minimum mix requirements may have water-reducing admixtures conforming to ASTM C494 added to the mix at manufacturer's dosage rates for improved workability.
- The preceding minimum mix requirements may have up to 15% maximum of the cement content replaced with an approved ASTM C618 Class C fly ash, provided the total minimum cementitious content is not reduced.
- All interior concrete slabs on grade shall be placed over 15 mil Class A Vapor Barrier per ASTM E1745 with less than 0.01 perms, tested after mandatory conditioning. All joints shall be lapped and sealed per manufacturer's recommendations. All penetrations, as well as damaged vapor barrier material shall also be sealed per manufacturer's recommendation prior to concrete placement. Install barrier per manufacturer recommended details at all discontinuous edges (at interior columns, exterior edge of slab, etc.) to ensure terms of warranty are followed. The vapor barrier shall be placed over free-draining granular material as prescribed by the project soils report.
- All concrete is reinforced concrete unless specifically called out as unreinforced. Reinforce all concrete not otherwise shown with same steel as in similar sections or areas. Any details not shown shall be detailed per ACI 318 and meet requirements of ACI 318, current editions.
- Contractor shall verify that all concrete inserts, reinforcing and embedded items are correctly located and rigidly secured prior to concrete placement.
- Construction joints in beams, slabs, and grade beams shall occur at midspan (middle third) unless noted otherwise. Provide 2 x 4 horizontal keys at construction joints for shear transfer.
- No minimum items shall be embedded in any concrete.

7. Reinforcing Steel:

- All reinforcing steel shall conform to the requirements of ASTM A615 or A706 grade 60 steel. Welded plain wire fabric shall be supplied in sheets and conform to the requirements of ASTM A185.
- Clear minimum coverage of concrete over reinforcing steel shall be as follows:

Concrete placed against earth	3"
Formed concrete against earth	2"
Size	1"
Other	2"
- All coverage shall be nominal bar diameter minimum.
- All dowels shall be the same size and spacing as adjoining main bars (splice top 48 bar diameters or 30" minimum unless noted otherwise).
- At corners of all walls, beams, and grade beams supply corner bars (minimum 2-6" in each direction or 48 bar diameters) in outside face of wall, matching size and spacing of horizontal bars. Where there are no vertical bars in outside face of wall, supply 3 - #4 vertical support bars for corner bars.
- Bars marked continuous shall be lapped 48 bar diameters (30" minimum) at splices and embedments, unless shown otherwise. Splice top bars near midspan and splice bottom bars over supports, unless noted otherwise.
- Accessories shall be as specified in latest edition of the ACI Detailing Handbook and the concrete Reinforcing Steel Institute Design Handbook. Maximum accessory spacing shall be 4'-0" on center, and all accessories on exposed surfaces are to have plastic coated feet.
- All slabs and stairs not shown otherwise shall be 6" thick with #4 bars at 12" on center each way.

8. Structural Steel:

- All structural steel beams and columns shall be ASTM A992, grade 50 steel and all miscellaneous steel shall be ASTM A36 grade steel. Hollow Structural Sections (HSS) shall be ASTM A500, grade C. Fabrication and erection shall be in accordance with AISC 303 "Code of Standard Practice for Steel Buildings and Bridges" in the referenced edition of the AISC Steel Construction Manual.
- All welding shall conform to the recommendations of the AWS.
- All bolts not otherwise specified shall be 3/4" diameter high strength (ASTM A325-N). All bolts shall be fully pretensioned. All beam connections shall be designed per the AISC Manual of Steel Construction "Framed Beam Connections" for 40 kip reactions, and shall account for eccentricity when the bolt line is more than 2" from the center of the support. All connections must be two bolt minimum.
- All anchor bolts shall be 3/4" diameter, ASTM F1554, Grade 36 unless noted otherwise.

9. Foundations:

- The soil investigation was prepared by Terracon, the report number is 01245160 and their telephone number is 913-442-1111.
- Spread footings and continuous wall footings are designed to bear on soil capable of safely sustaining 2500 psf.
- Contractor shall provide for dewatering at excavations from either surface water or seepage.
- All foundation excavations shall be inspected by a qualified soil engineer, approved by the architect and/or structural engineer, prior to placement of steel or concrete. This inspection shall be at the owner's expense.
- Moisture content in soils beneath building locations should not be allowed to change after footing excavations and after grading for slabs are completed. If subgrade materials become desiccated or softened by water or other conditions, recompact materials to the density and water content specified for engineered fill. Do not place concrete on frozen ground.

10. Concrete Block Masonry

- Concrete block used in exterior walls or load bearing walls shall meet the requirements of ASTM C90 and have a minimum net compressive strength of 2150 psi and laid up using type N mortar such that f_m equals 1500 psi. Mortar shall be volume proportion based cement lime mortar. Proportioning shall be completed by box measure. Any block in contact with earth shall be normal weight units, laid using type "S" mortar and grouted solid.
- The contractor shall provide adequate temporary bracing for all masonry walls during construction.
- All concrete block shall have # 3 gage (or larger) horizontal joint reinforcing (ladder or truss) per architectural drawings and specifications (6" maximum vertical spacing).
- Concrete block shall be reinforced as follows in 8" walls unless noted otherwise:
 - Vertical reinforcing shall be a minimum of 1 - #4 bar in 8" walls at 4'-0" on center, at each corner, at each door and window jamb, each side of lintels. If subgrade and void of each length of wall. Lap splices for masonry vertical reinforcing shall be 48 bar diameters or 24" minimum.
 - Horizontal reinforcing:
 - Horizontal joint reinforcing as noted above.
 - Continuous horizontal bars shall be included per section or detail in bond beam or optional running bond beam where noted. Where bond beams are continuous at corners of walls, supply corner bars matching size of horizontal bars (minimum 2'-0" or 40 bar diameters in each direction).
- Grout, where noted above, shall have a minimum design ultimate compressive strength of 2500 psi at 28 day test and 30% maximum aggregate size.
- Lintels over all openings in walls not otherwise covered shall be an 8" x 8" bond beam with 2 - #6 bars in the bottom of the bond beam.

11. Post-Installed Anchors:

- Post-installed anchors shall be used only where specified on the drawings unless approved in writing by the engineer of record. See drawings for anchor diameter, spacing and embedment. Performance values of the anchors shall be obtained for specified products using appropriate design procedures and/or standards as required by the governing building code. Anchors installed in concrete shall have an ICC-ES Evaluation Service Report. Special inspection is required for all post-installed anchors.
- Mechanical anchors used in cracked and uncracked concrete shall have been tested and qualified for use in accordance with ACI 308.2 and ICC-ES AC108.3. All anchors shall be installed per the anchor manufacturer's written instructions.
- Adhesive anchors used in cracked and uncracked concrete shall have been tested and qualified for use in accordance with ICC-ES AC308. All anchors shall be installed per the anchor manufacturer's written instructions.

12. Cold-Formed Metal Framing

- All cold formed structural studs, track, and bridging shall be of the type, size, gage and spacing as shown on the drawings, minimum.
- All materials shall be 33,000 psi minimum yield, except studs of 16 gage or heavier shall have a minimum yield of 50,000 psi.
- All properties, fabrication, and erection shall be in accordance with latest editions of the AISI "Specification for the Design of Cold-Formed Structural Members".
- All framing components shall be cut square or at an angle to fit squarely against abutting members. Splicing of axially loaded members is not permitted. Members shall be held firmly in place until properly fastened. Attachments of similar components shall be by welding, screw attachment, or bolting. Wire tying of components is not permitted.
- Tracks shall be securely anchored to floor and overhead members. Special anchorage requirements required for wind bracing shall be as shown on the plans.
- Prior to fabrication and/or erection, the contractor shall submit shop drawings complete with details of erection, fabrication, attachments, anchorages, lintels, etc. for review by the architect/engineer.

13. Timber and Wood Framing:

- Quality and construction of wood framing members and their fasteners for load supporting purposes not otherwise indicated on the drawings shall be in accordance with the 2024 International Building Code.
- All studs and top and bottom plates shall be Douglas Fir No. 2 grade visually graded lumber, with an allowable fiber stress in bending of 400 psi minimum and an elastic modulus of 1,600,000 psi unless noted otherwise. All joist, truss members and headers shall be No. 2 grade lumber (unless noted otherwise).
- Bridging of stud bearing walls and shear walls shall be solid, matching sheathing joists.
- Joist blocking and bridging shall be solid wood or cross bridging of either wood or metal straps. Spacing in any case, shall not exceed 8'-0".
- Wood members and sheathing shall be fastened with number and size of fasteners not less than that set forth in Table 2304.9.1 of the 2024 International Building Code. Floor sheathing shall be APA rated tongue and groove Suro-Floor exposure 1, glued and nailed with 10d nails or # 10 screws at 6" on center to supports at edges and 12" on center field. Sheathing of shear walls or roof diaphragms shall be edge nailed with 8d common nails at 6" on center and spaced 16" intermediate framing and/or blocking members with 8d common nails at 12" on center unless otherwise noted on the drawings.
- Slit plates shall be bolted to concrete slabs with 1/2" diameter bolts at 32" on center (NOC Re. shearwall sched). Provide plate washers at slit plate anchors for shearwalls per shearwall sched. Plates in direct contact with concrete or masonry shall be treated lumber.
- All hangers, ties and connections shown are based on Simpson Strong Tie as the basis of design, provide Simpson Strong Tie or an approved equal. Joist hangers shall be equal to "L10" for wood application and "L8" for steel weld-on application. Roof truss ties shall be equal to "H23A" and tie the roof truss to the top plate (provide 12" H23A Diagonally across from each other when split). Load shown in truss shop submittal exceeds 600lbs). Roof girder ties shall be equal to a "L6T2", "L6T3" or "L6T4" (ie dependent on number of plies) and tie the truss girder to the top plate. Provide "H4" at the top of each stud to top track when the top track has roof truss attached. Service condition - dry with moisture content at or below 19% in service.
- Laminated strand lumber (LSL) shall have an allowable flexural stress (Fb) of 1,100 psi (reduced by size factor) and an elastic modulus (E) of 1,300,000 psi.
- Laminated veneer lumber (LVL) shall have an allowable flexural stress (Fb) of 2,600 psi (reduced by size factor) and an elastic modulus (E) of 1,900,000 psi.
- Parallel Strand Lumber (PSL) shall have an allowable flexural stress (Fb) of 2,900 psi (reduced by size factor) and an elastic modulus (E) of 2,000,000 psi (E) = 2,000,000 psi for members > 18").
- Pre-engineered wood trusses shall be designed in accordance with the Truss Plate Institute's national design standard for metal-plate connected wood truss construction (ANSI/TPI-1 latest edition). Trusses shall be designed and manufactured by an authorized member of the Wood Truss Council of America (WTC/A). Truss design shall conform to specified codes, allowable stress increases, deflection limitations and other applicable criteria of the governing code.
- Truss shop drawings showing complete erection and fabrication details and calculations (including connections) shall be submitted to the project architect / engineer for review prior to fabrication and/or erection. Calculations shall bear the seal of a professional engineer, registered in the state of the project location. Shop drawings shall also be submitted to the local government controlling agency when requested by that agency.
- All trusses shall be securely braced both during erection and permanently. The approved truss design drawings and in accordance with TPI's commentary and recommendations for handling, installing and bracing metal-plate connected wood trusses (HIB-1, booklet) and the latest edition of ANSI/TPI-1.
- The truss manufacturer shall supply all hardware and fasteners for joining truss members together and fastening truss members to their supports. Metal connector plates shall be manufactured by a member of the Wood Truss Council of America (WTC/A) and shall be 20 gage minimum. Connector plates shall meet or exceed ASTM A653, grade 33, with ASTM A424 galvanized coating designation 560.
- Provide truss space directly above and centered over HVAC closets. Refer to Architectural and MEP drawings for exact locations.
- Shipment, handling, and erection of trusses shall be by experienced, qualified persons and shall be performed in a manner so as not to endanger life or property. Apparent truss damage shall be reported to the truss manufacturer for evaluation prior to erection. Cutting or alteration of trusses is not permitted.
- Pre-Engineered Floor Trusses Design Criteria:

Top Chord Dead Load	= 30 psf
Top Chord Live Load	= Per General Note 5B
Bottom Chord Dead Load	= 10 psf
Live Load Deflection	= L/360 (1/2" max)
Total Load Deflection	= L/360

 Refer to Sheet 52.4 for 4th floor roof & exterior deck load criteria.
- Roof Truss Design criteria:

Top Chord Dead Load	= 10 psf
Top Chord Live Load	= 25 psf (100 psf at Rooftop mech. zones)
Bottom Chord Dead Load	= 20 psf or 14 psf plus Drift
Bottom Chord Live Load	= 10 psf
Live Load Deflection	= 5 psf
Total Load Deflection	= L/360

 Refer to Sheet 52.4 for 4th floor roof & exterior deck load criteria.
- Roof trusses shall be designed per IBC 2024 for net uplift resulting from wind loading as calculated using components and cladding loading.
- Construction bracing shall be provided by the contractor as required to keep the building and studs plumb.
- Structural members shall not be cut for pipes, etc., unless specifically detailed. Notching and boring of studs and top of plates shall conform to the provisions of section 2308.9.1.0 and 2308.9.1.1 of the IBC. Where top plates or sole plates are cut for pipes, a metal tension tie with minimum 0.026 inches thick and 1/2" inches wide shall be fastened to each plate across and to each side of the opening with not less than (6) 16d nails, in accordance section 2308.9.1.0 of the IBC.
- All fasteners for wood to wood connections and wood connectors shall be as indicated in structural drawings or manufacturer literature to achieve full capacity of connector. Alternate fasteners may be submitted as a substitution request. Submittal must show that alternative fasteners will not reduce the capacity of the connection.

14. Shop Drawing Review:

- Bob D. Campbell and Company, Inc. will review the General Contractor's (GC) shop drawings and related submittals (as indicated below) with respect to the ability of the detailed work, when complete, to be a properly functioning integral element of the overall structural system designed by Bob D. Campbell and Company, Inc.
- Prior to submittal of a shop drawing or any related material to Bob D. Campbell and Company, Inc. the GC shall:
 - Review each submittal for conformance with the means, methods, techniques, sequences and operations of construction and safety precautions and programs indicated therein, all of which are the sole responsibility of the GC.
 - Review and approve each submittal.
 - Stamp each submittal as approved.
- Bob D. Campbell and Company, Inc. shall assume that no submission comprises a variation unless the GC advises Bob D. Campbell and Company, Inc. with written documentation. Shop drawings and related material (if any) required are indicated below. Should Bob D. Campbell and Company, Inc. require more than (10) working days to perform the review, Bob D. Campbell and Company, Inc. shall so notify the GC. 1) Concrete mix designs and material certificates including admixtures and compounds applied to the concrete after placement. 2) Reinforcing steel shop drawings including erection drawings, nail elevations (include all mech. openings) and bending details. Bar list will not be reviewed for correct quantities. 3) Structural steel shop drawings including erection drawings and piece details. Include connection submittals and miscellaneous framing. 4) Miscellaneous anchors shown on the structural drawings. 5) Wood truss design calculations and detailed erection and fabrication drawings. Standard stick framing shop drawings need not be submitted. 6) Construction and control joint plans and/or elevations. Bob D. Campbell and Company, Inc. shall review shop drawings and related materials with comments provided that each submission has met the above requirements. Bob D. Campbell and Company, Inc. shall return without comment unrepaired material or submissions without GC approval stamp.

15. Structural Special Inspection:

- The structural design for this project is based on completion of special inspections during construction in accordance with chapter 17 of the 2024 International Building Code. The owner shall employ one or more qualified special inspectors to provide the required special inspections.
- Special inspections shall be required for the items indicated below. The General Contractor shall provide notification to the inspector when items requiring inspection are ready to be inspected and provide access for those inspections.
 - Placement of Concrete
 - Testing of Concrete
 - Bolts in Concrete
 - Placement of Reinforcing Steel
 - Ventilation of Soil Bearing Capacities
 - High Strength Bolting
 - Drill & Epoxy Bolts
 - Structural Welding
 - Shear wall installation
 - Post-Installed Anchors
 - Wood shear walls and holdowns
 - Wood gravity framing and placement
- The special inspector shall furnish inspection reports to the building official, owner, architect and structural engineer, and any other designated person.
- All discrepancies shall be brought to the immediate attention of the contractor for correction, then, if uncorrected, to the proper design authority, building official and structural engineer.
- The special inspector shall submit a final signed report stating that the work requiring special inspection was, to the best of the inspector's knowledge, in conformance with the approved plans and specifications and the applicable workmanship provisions of the building code.

16. Copyright and Disclaimer:

- All drawings in the structural set (5-series drawings) are the copyrighted work of Bob D. Campbell and Company, Inc. These drawings may not be photographed, traced, or copied in any manner without the written permission of Bob D. Campbell and Company, Inc. Exception: Original drawings may be printed for distribution to the owner, architect, and general contractor for coordination, bidding, and construction. Subcontractors may not reproduce these drawings for any purpose or in any manner.
- Ryan M. Hagedorn, P.E., registered engineer and a representative of Bob D. Campbell and Company, Inc., do hereby accept professional responsibility as required by the professional registration laws of this state for the structural design drawings consisting of 5-series drawings. I hereby disclaim responsibility for all other drawings in the construction document package, being the responsibility of other design professionals whose seals and signed statements may appear elsewhere in the construction document package.

NAILING SCHEDULE (REFER TO NOTES #1 and #2)

CONNECTION	ATTACHMENTS (REF NOTE #3 and #4)
1 JOIST TO SILL OR GIRDER	3- 3" x 0.131" NAILS-TOENAIL 3-8d NAILS-TOENAIL
2 BRIDGING TO JOIST	2- 3" x 0.131" NAILS-TOENAIL EACH END 2-8d NAILS-TOENAIL EACH END
3 SOLE PLATE TO JOIST OR BLOCKING & TRUSS TO TOP P	3" x 0.131" NAILS AT 8" o.c. -TYPICAL FACE NAIL 3-16d BOX NAILS AT 16" o.c. BRACED WALL PANEL
4 TOP PLATE TO STUD	3- 3" x 0.131" NAILS-END NAIL 2-16d NAILS-END NAIL
5 STUD TO SOLE PLATE	4- 3" x 0.131" NAILS-TOENAIL OR 3- 3" x 0.131" NAILS-END NAIL 4-8d NAILS-TOENAIL OR 2-16d NAILS-END NAIL
6 DOUBLE STUDS	3" x 0.131" NAILS AT 8" o.c.-FACE NAIL 16d BOX NAILS AT 24" o.c. MAX. FACE NAIL
7 DOUBLED TOP PLATES	3" x 0.131" NAILS AT 12" o.c.-FACE NAIL 16d BOX NAILS AT 16" o.c. MAX. FACE NAIL
8 DOUBLE TOP PLATE LAPS AND INTERSECTIONS	12- 3" x 0.131" NAILS 8-16d NAILS
9 BLOCKING BETWEEN JOISTS OR RAFTERS TO TOP PLATE	3- 3" x 0.131" NAILS -TOENAIL 3-8d NAILS-TOENAIL
10 RIM JOIST TO TOP PLATE	3" x 0.131" NAILS AT 6" o.c.-TOENAIL 10d NAILS AT 6" o.c. MAX.-TOENAIL
11 TOP PLATE LAPS AND INTERSECTIONS	3- 3" x 0.131" NAILS-FACE NAIL 2-16d NAILS-FACE NAIL
12 CONTINUOUS HEADER, TWO PIECES	3" x 0.131" NAILS AT 10" o.c. ALONG EACH EDGE 16d NAILS AT 16" o.c. MAX. ALONG EACH EDGE-TOENAIL
13 CEILING JOISTS TO PLATE	5- 3" x 0.131" NAILS-TOENAIL 3-8d NAILS-TOENAIL
14 CONTINUOUS HEADER TO STUD	4- 3" x 0.131" NAILS-TOENAIL 4-8d NAILS-TOENAIL
15 CEILING JOISTS, LAPS OVER PARTITIONS	4- 3" x 0.131" NAILS-FACE NAIL 3-16d NAILS-FACE NAIL
16 CEILING JOISTS TO PARALLEL RAFTERS	4- 3" x 0.131" NAILS-FACE NAIL 3-16d NAILS-FACE NAIL
17 RAFTER TO PLATE	3- 3" x 0.131" NAILS-TOENAIL 3-8d NAILS-TOENAIL
18 1" BRACE TO EACH STUD AND PLATE	2- 3" x 0.131" NAILS-FACE NAIL 2-8d NAILS-FACE NAIL
19 BUILT-UP CORNER AND MULTIPLE STUDS	3" x 0.131" NAILS AT 16" o.c. 16d NAILS AT 24" o.c. MAX.
20 BUILT-UP GIRDER AND BEAMS	3" x 0.131" NAILS AT 24" o.c. FACE NAILED TOP AND BOTTOM STAGGERED ON OPPOSITE SIDES 3- 3" x 0.131" NAILS AT ENDS AND EACH SPLICE 2-20d NAILS AT ENDS AND EACH SPLICE
21 BUILT-UP LAMINATED VENEER LUMBER BEAMS	3" x 0.131" NAILS AT 6" o.c. TOP AND BOTTOM ALONG EDGE 16d NAILS AT 12" o.c. TOP AND BOTTOM ALONG EDGE
22 2" PLANKING	4- 3" x 0.131" NAILS AT EACH SUPPORT 16d NAILS AT EACH SUPPORT
23 RIM BOARD TO TRUSS	2- 3" x 0.131" FACE NAILS (17/B # EA TRUSS) 2-10d NAILS - FACE NAILS (17/B # EA TRUSS)
24 BUILT-UP STUD PACK COLUMNS	REFER TO DETAIL 6/5/J REFER TO DETAIL 6/5/J

NOTES:
 1) ALL NAILS SHALL BE AS NOTED UNLESS OTHERWISE SPECIFIED ON STRUCTURAL DRAWINGS OR ALTERNATE PROVIDED BY ENGINEER IN WRITING.
 2) CONDITIONS NOT SPECIFIED SHALL BE IN ACCORDANCE WITH CURRENT INTERNATIONAL BUILDING CODE.
 3) NAILING DESIGNATION:
 4- 3" x 0.131" NAILS
 DIAMETER IN INCHES
 NAIL LENGTH
 QUANTITY

- ALL NAILS NOTED AS 8d, 10d, 16d, ETC. SHALL BE COMMON NAILS UNLESS NOTED BOX.
- REFER TO SHEARWALL SCHEDULE FOR ADDTL. NAILING REQUIREMENTS

JonesGillamRenz
 730 N. Ninth 1181 Main Street, Suite 301
 Salina, KS 67401 Kansas City, MO 64108
 jgr@jgrarchitects.com
 785.827.0386

JGR

THE RESERVES AT MEADOWS 25
 NEW APARTMENTS
 KANSAS
 GODDARD,
 KANSAS



REVISION:	
DATE:	4-17-2026
JOB:	25-3465
SHEET NO.:	

BOB D. CAMPBELL & CO.
 Structural Engineers Since 1957
 4338 Bellevue Ave. 816.531.4144
 Kansas City, MO 64111 www.bdc-engrs.com

S0.1

COPYRIGHTED

HEADER SCHEDULE			
MARK	HEADER	JAMB STUDS	NOTES
A	(2) 2x10 w/ 1/2" PLYWOOD SPACER PLS	2 JACK / 1 KING (2 KING BELOW 2nd FLR)	
B	(2) 2x12 w/ 1/2" PLYWOOD SPACER UPSET	3 JACK	
C	(3) 2x10 w/ (2) 1/2" PLYWOOD SPACER PLS	1 JACK / 1 KING	
D	(3) 2x10 w/ (2) 1/2" PLYWOOD SPACER PLS	1 JACK / 2 KING	
E	(3) 2x10 w/ (2) 1/2" PLYWOOD SPACER PLS	2 JACK / 2 KING	
F	(3) 2x12 w/ (2) 1/2" PLYWOOD SPACER PLS	2 JACK / 2 KING	

- NOTES:
- JAMB STUDS SHALL MATCH SIZE & GRADE OF WALL STUDS UNO.
 - WHERE BEAM IS NOTED "UPSET", ALL JAMB STUDS NOTED WILL EXTEND TO DOUBLE TOP PLATE.
 - ALL EXTERIOR LUMBER TO BE TREATED.
 - PROVIDE SQUASH BLOCKS AT TRUSSES & BLOCKING FRAMING WHERE JAMBS OR STUD PACKS ARE DISCONT. QUANTITY TO MATCH JAMB OR STUD PACK ABOVE.
 - PROVIDE 1/2" PLYWOOD SPACER PLS AT HEADERS CONSTRUCTED WITH 2x LUMBER.
 - AT CONTRACTOR'S OPTION PROVIDE GLULAM IN LIEU OF PSLs.
 - REFER TO DTL 5/S11 FOR MULTI-PLY MEMBER CONNECTION REQUIREMENTS.
 - ATTACH JAMB AND KING STUDS TOGETHER PER CONNECTION TYPE 24 IN NAILING SCHEDULE ON SHEET S10.
 - REFER TO DETAILS 1/511 FOR TYPICAL HEADER CONDITIONS.

STUD BEARING WALL & SHEATHING SCHEDULE	
LOCATION	STUD SIZE AND SPACING
(TYP.) EXTERIOR WALL	2x6 @ 16"oc STUDS
INTERIOR WALL (EXCEPT AT NON TRUSS BRG CORRIDORS)	REFER TO SECTIONS ON SHEET S3.2
INTERIOR WALL (AT NON TRUSS BRG CORRIDORS)	REFER TO SECTIONS ON SHEET S3.2

- NOTES:
- PROVIDE 2x BLOCKING @ MID HEIGHT (5'-0" MAX) @ ALL LOAD BEARING WALLS NOT SHEATHED ON BOTH SIDES AND ALL 2x6 WALLS.
 - ALL STUDS TO BE NO. 2 GRADE UNO.
 - RE: 6/511 FOR NAILING OF MULTIPLE STUDS.
 - REFER TO ARCH/MEP DRAWING FOR LOCATIONS OF FURRED OUT WALLS TO ACCOMMODATE PLUMBING OR MEP ITEMS.

STRUCTURAL DECK & SLAB SCHEDULE	
MARK	DESCRIPTION
SOG-1	4" CONC. SLAB ATOP 15 MIL VAPOR BARRIER ATOP 4" GRAVEL ATOP 20" LOW VOLUME CHANGE MATERIALS REQ'D BY PROJECT GEOTECH. REPORT. REINF. SLAB W/ 6x6-6/8 WWF. EL. T/C = 100'-0".
SOG-2	6" CONCRETE SLAB ATOP 6" GRAVEL. REINF. SLAB W/ #4 @ 12"oc EACH WAY, CENTER. T/SLAB EL. VARIES.
FD-1	3/4" PLYWOOD SHEATHING ATTACH W/ 8d NAILS @ 6"oc AT EDGES AND 12"oc AT FIELD.
RD-1	5/8" ZIP STRIP ROOF SHEATHING ATTACH W/ 8d NAILS @ 6"oc AT EDGES AND 12"oc AT FIELD.
CD-1	4 1/2" Wx CONCRETE ATOP 3" 18ga COMPOSITE DECK (GALV.) (1 1/2" TOTAL DEPTH) REINF SLAB W/ 6x6-W2.9xW2.9 WWF



- NOTES:
- SOG = SLAB-ON-GRADE TYPE
 - FD = FLOOR DECK TYPE
 - RD = ROOF DECK TYPE
 - CD = COMPOSITE DECK TYPE

SPREAD FOOTING SCHEDULE		
MARK	SIZE	REINFORCING
50	5'-0"x5'-0"x2'-8" Dp	(7) #5 EACH WAY, TOP & BOTTOM
60	6'-0"x6'-0"x2'-8" Dp	(8) #5 EACH WAY, TOP & BOTTOM
70	7'-0"x7'-0"x2'-8" Dp	(10) #5 EACH WAY, TOP & BOTTOM
80	8'-0"x8'-0"x2'-8" Dp	(11) #5 EACH WAY, TOP & BOTTOM
90	8'-0"x12'-0"x2'-8" Dp	(9) #6 LONG & (11) #6 TRANS EACH WAY, TOP & BOTTOM
100	10'-0"x10'-0"x2'-0" Dp	(16) #6 EACH WAY, BOTTOM
110	11'-0"x11'-0"x2'-0" Dp	(18) #6 EACH WAY, BOTTOM


- NOTES:
- SPREAD FOOTINGS LOCATED AT INTERIOR SHALL BE POURED MONOLITHIC WITH THE SLAB AS A THICKENED PORTION OF SLAB UNLESS THEY HAVE A STEEL COLUMN BEARING ATOP.
 - SPREAD FOOTINGS LOCATED AT INTERIOR WITH STEEL COLUMNS BEARING ATOP SHALL BE LOCATED AT 9'-0" C.
 - SPREAD FOOTINGS LOCATED AT PERIMETER (EXTERIOR) OF BUILDING SHALL BE POURED MONOLITHIC WITH GRADE BEAMS.

COLUMN SCHEDULE				
TYPE	SIZE	BASE PL	SHAPE	ANCHOR BOLTS
1	H556x6	3/4"x12"x12"	A	(4) 3/4" @ x 1'-6"Lg
2	H558x8	3/4"x14"x14"	A	(4) 3/4" @ x 1'-6"Lg
3	H556x6	3/4"x12"x12"	B	(4) 3/4" @ x 1'-6"Lg
4	H556x6	3/4"x12"x12"	C	(4) 3/4" @ x 1'-6"Lg
5	H556x6	1"x12"x18"	D	(6) 3/4" @ x 2'-0"Lg
6	H556x6	1"x12"x18"	E	(6) 3/4" @ x 2'-0"Lg
7	H558x8	1"x14"x20"	D	(6) 3/4" @ x 2'-0"Lg
8	H556x6	1"x18"x18"	F	(9) 3/4" @ x 2'-0"Lg


- NOTES:
- SEE PLAN FOR ORIENTATION OF COLUMNS.
 - ALL COLUMNS SHALL BE CONTINUOUS WITH NO SPLICES.
 - AB LENGTH INCLUDES 4" HK & 4" PROJECTION UNO.
 - UNO, SET COLUMN BASE PLATES ON 1 1/2" GROUT TYPICAL.
 - EACH AB SHALL HAVE A 3"x3"x1/4" PLATE WASHER BOT. (IN LIEU OF HK) @ 4" PROJ. ATOP WHERE NOTED IN THE SCHED. (4"x4"x3/4" PLATE WASHER @ BOLTS 1" @ AND LARGER).
 - 3/4" @ ANCHOR BOLTS SHALL HAVE A 2"x2"x1/4" PLATE WASHER @ TOP & 1" @ ANCHOR BOLTS SHALL HAVE A 3"x3"x3/8" PLATE WASHER. WELD WASHER TO COLUMN BASE PLATE WITH 1/2" FILLET WELD @ 4- SIDES.
 - ALL ANCHOR BOLTS SHALL BE ASTM F1554, GRADE 36 UNO.

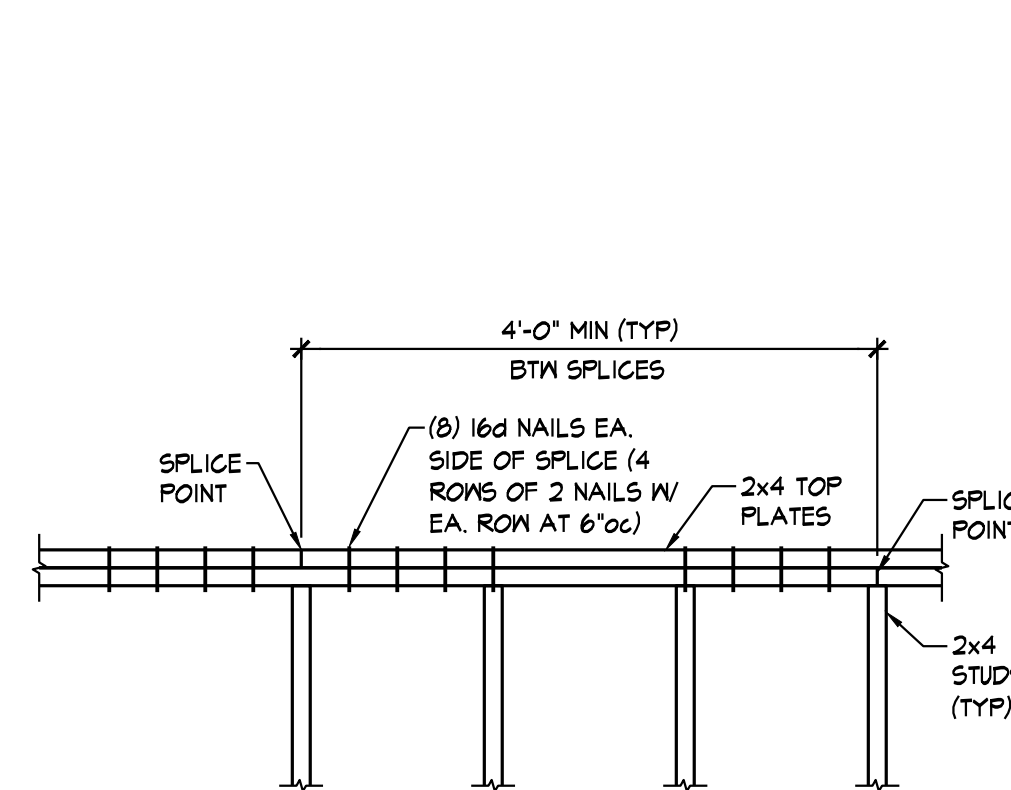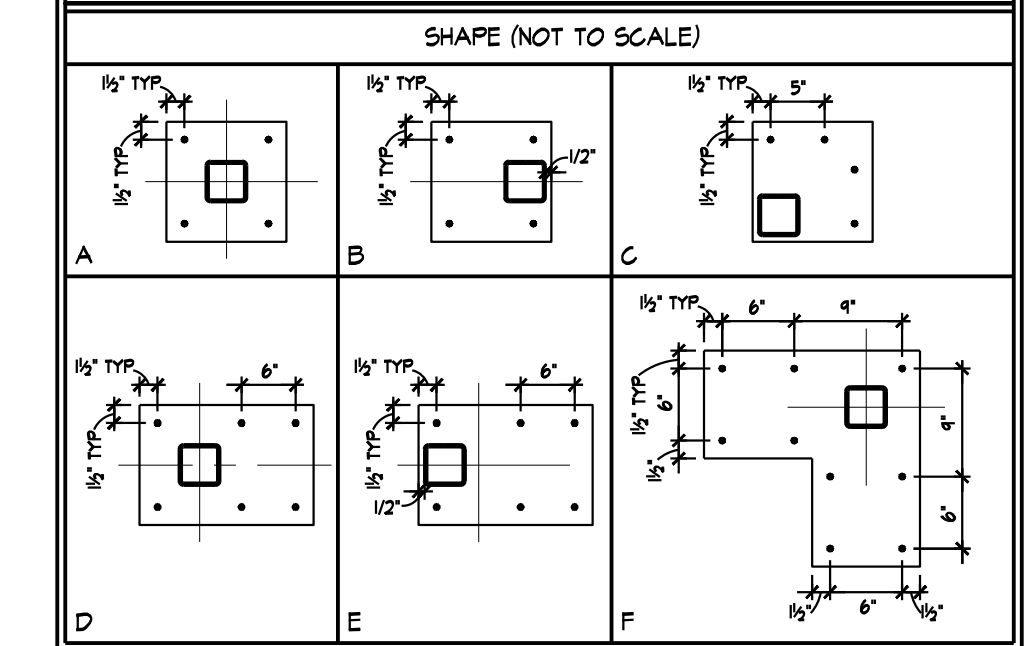


(TYP) TOP PLATE SPLICE 1
3/4" = 1'-0" S11

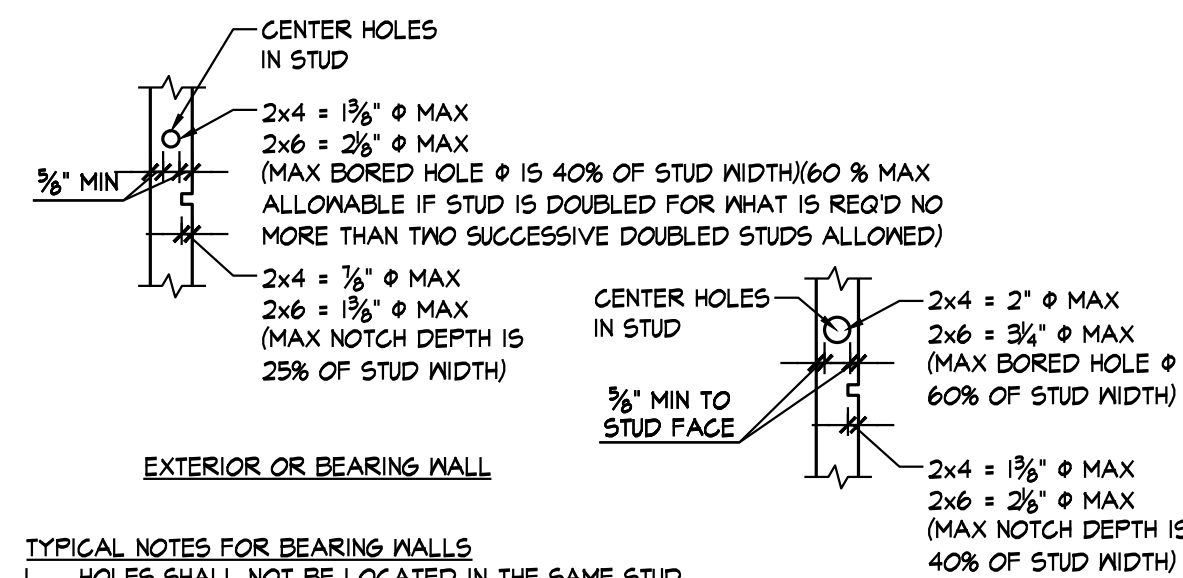


SECTION 2
3/4" = 1'-0" S11

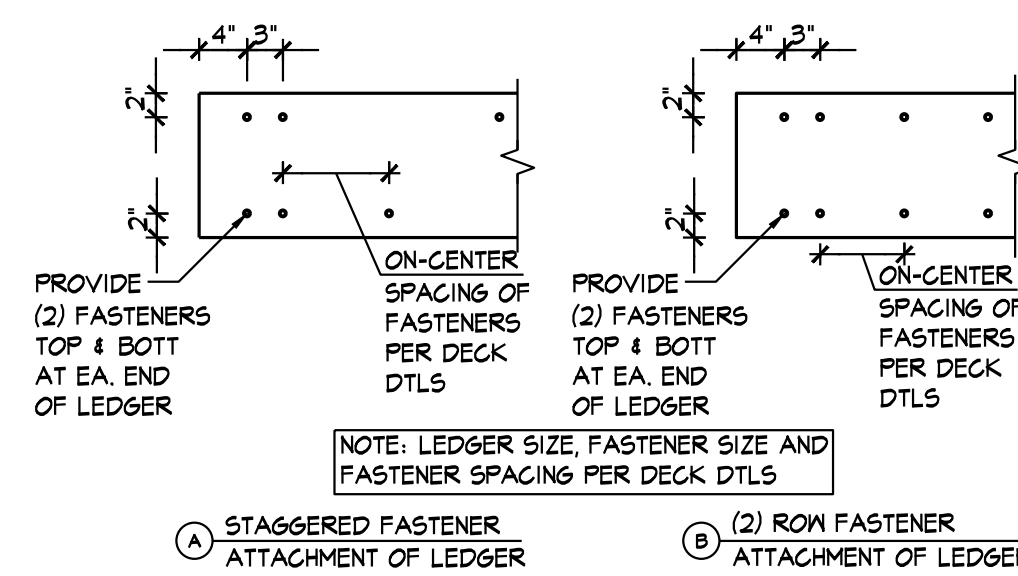


TYPICAL LEDGER CONNECTION 3
3/4" = 1'-0" S11

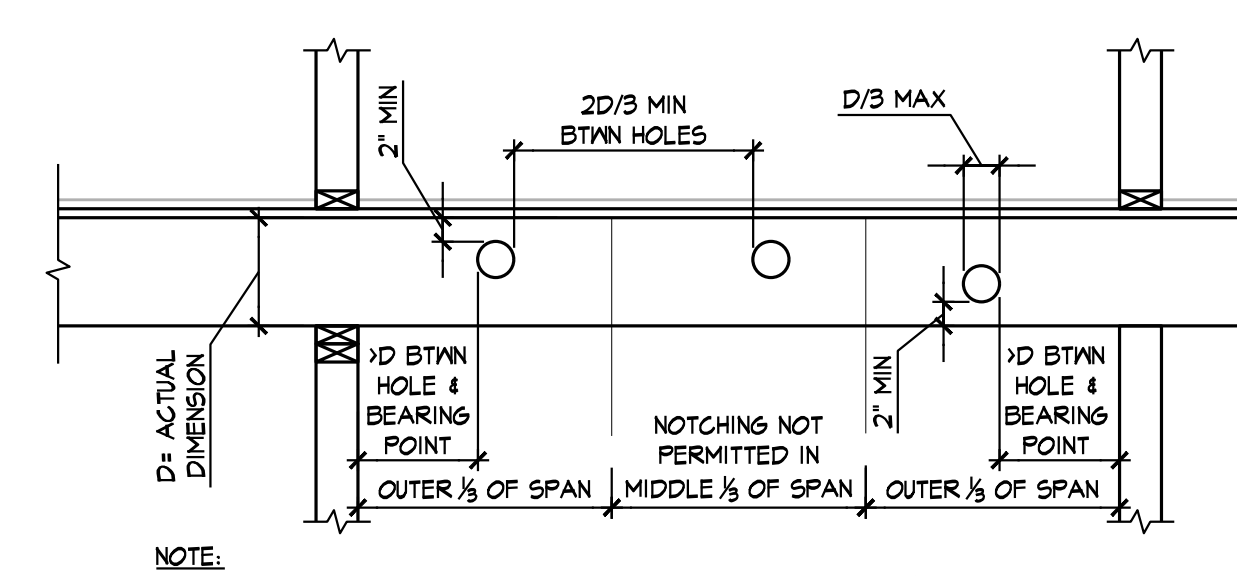

SECTION 4
3/4" = 1'-0" S11

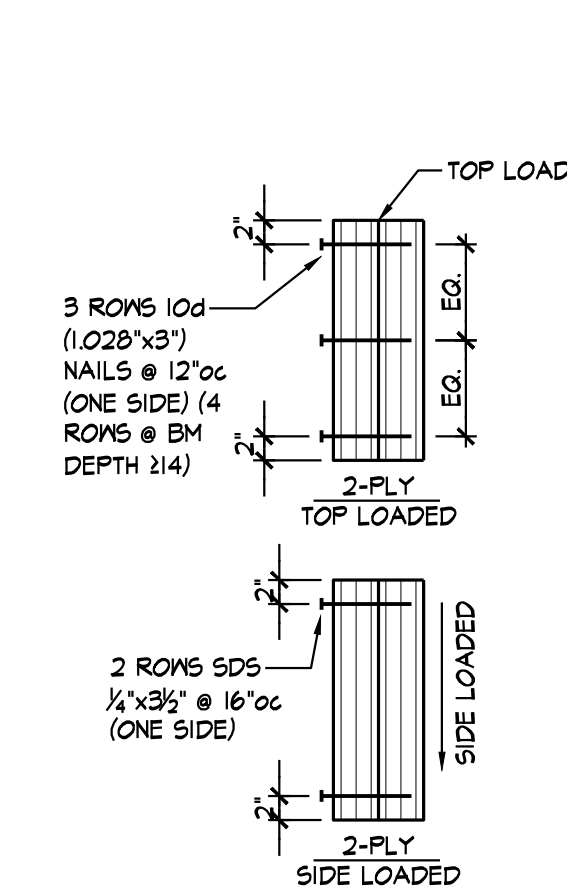


TYPICAL MULTI-PLY BEAM CONNECTION 5
3/4" = 1'-0" S11

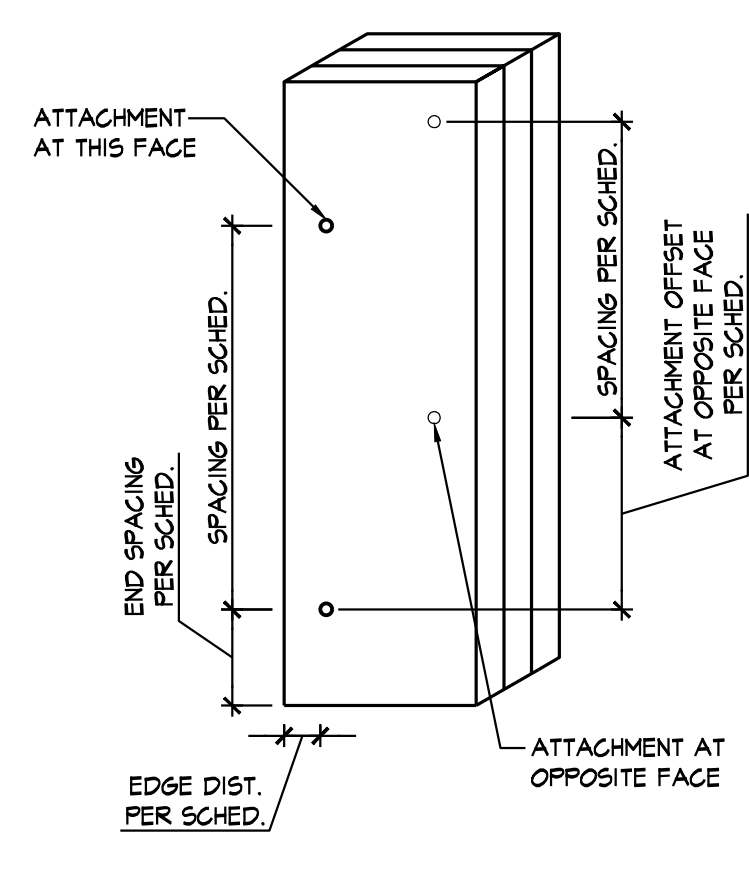

TYPICAL MULTI-PLY STUD CONNECTION 6
1/2" = 1'-0" S11

BUILT-UP STUD PACK COLUMN ATTACHMENT SCHEDULE		
NUMBER OF PLYS	ATTACHMENT AT COLUMN STUD PACKS SUPPORTING BEAMS	ATTACHMENT AT WALL STUD PACKS SUPPORTING TRUSSES
2-PLY MEMBERS	8d NAILS AT 12"oc, 1" FROM EDGE, W/ OPPOSITE EDGE NAILED FROM OPPOSITE SIDE OFFSET 6", @ 12"oc W/ FIRST NAIL 2" FROM EA. END	8d NAILS AT 12"oc, 1" FROM EDGE, W/ OPPOSITE EDGE NAILED FROM OPPOSITE SIDE OFFSET 6", @ 12"oc W/ FIRST NAIL 2" FROM EA. END
3-PLY MEMBERS	20d NAILS AT 16"oc, 1 1/2" FROM EDGE W/ OPPOSITE EDGE NAILED FROM OPPOSITE SIDE OFFSET 6", @ 16"oc W/ FIRST NAIL 3" FROM EA. END	8d NAILS AT 12"oc, 1" FROM EDGE, W/ OPPOSITE EDGE NAILED FROM OPPOSITE SIDE OFFSET 6", @ 12"oc W/ FIRST NAIL 2" FROM EA. END
4-PLY MEMBERS	1/4"x5" SIMPSON SDS SCREENS AT 16"oc, 1 1/2" FROM EDGE W/ OPPOSITE EDGE SCREENED FROM OPPOSITE SIDE OFFSET 6", @ 16"oc W/ FIRST SCREEN 4" FROM EA. END	3 PLYS ATTACHED PER 3-PLY ATTACHMENT WITH 4TH PLY ATTACHED WITH 8d NAILS AT 12"oc IN 2 ROWS, 1 1/2" FROM EDGE, OFFSET ROWS 6"
5-PLY MEMBERS	1/4"x6" SIMPSON SDS SCREENS AT 12"oc, 1 1/2" FROM EDGE W/ OPPOSITE EDGE SCREENED FROM OPPOSITE SIDE OFFSET 6", @ 12"oc W/ FIRST SCREEN 4" FROM EA. END	3 PLYS ATTACHED PER 3-PLY ATTACHMENT WITH 4TH & 5TH PLY ATTACHED AT OPPOSITE SIDES WITH 8d NAILS AT 12"oc IN 2 ROWS, 1 1/2" FROM EDGE, OFFSET ROWS 6"
6-PLY MEMBERS	1/4"x8" SIMPSON SDS SCREENS AT 12"oc, 1 1/2" FROM EDGE W/ OPPOSITE EDGE SCREENED FROM OPPOSITE SIDE OFFSET 6", @ 12"oc W/ FIRST SCREEN 4" FROM EA. END	3-PLIES ATTACHED PER 3-PLY ATTACHMENT WITH 4TH PLY ATTACHED WITH 8d NAILS AT 12"oc IN 2 ROWS, 1 1/2" FROM EDGE, OFFSET ROWS 6" AND 5TH AND 6TH PLYS ATTACHED WITH 1/4"x5" SIMPSON SDS SCREENS AT 12"oc IN 2 ROWS, 1 1/2" FROM EDGE, OFFSET ROWS 6"oc W/ FIRST SCREEN 4" FROM EA. END

- NOTES:
- ALL BUILT-UP STUD PACKS MUST ALIGN FLOOR-TO-FLOOR WITH SOLID BLOCKING (SQUASH BLOCKS) AT FLOOR CAVITIES.
 - EXTEND ALL STUD PACKS TO COLUMNS UNLESS NOTED OTHERWISE.
 - ALL NAILS ARE COMMON NAILS UNLESS NOTED OTHERWISE.

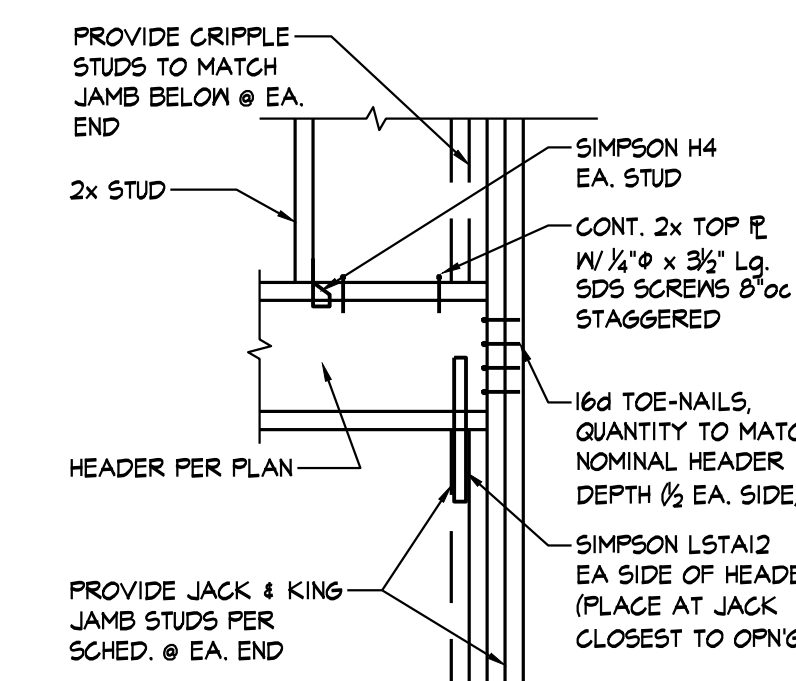

TYP. HEADER DETAIL @ ROOF TRUSS BEARING LOCATIONS SECTION 7
3/4" = 1'-0" S11







REVISION:	
DATE:	4-17-2026
JOB:	25-3465
SHEET NO.:	







REVISION:

DATE: 4-17-2026
 JOB: 25-3465
 SHEET NO.:

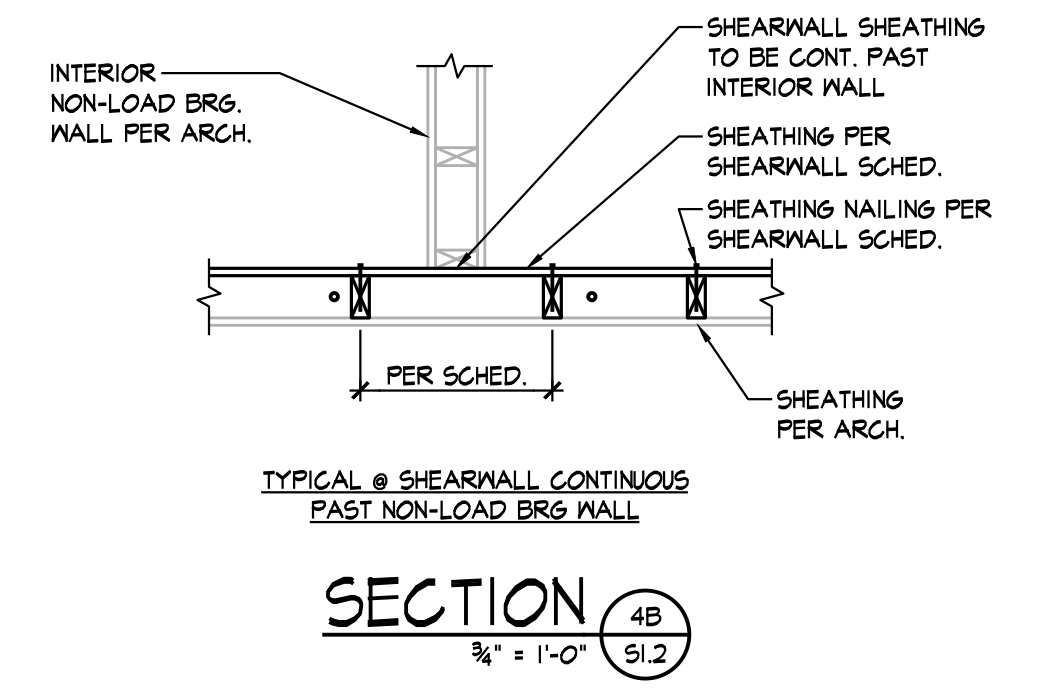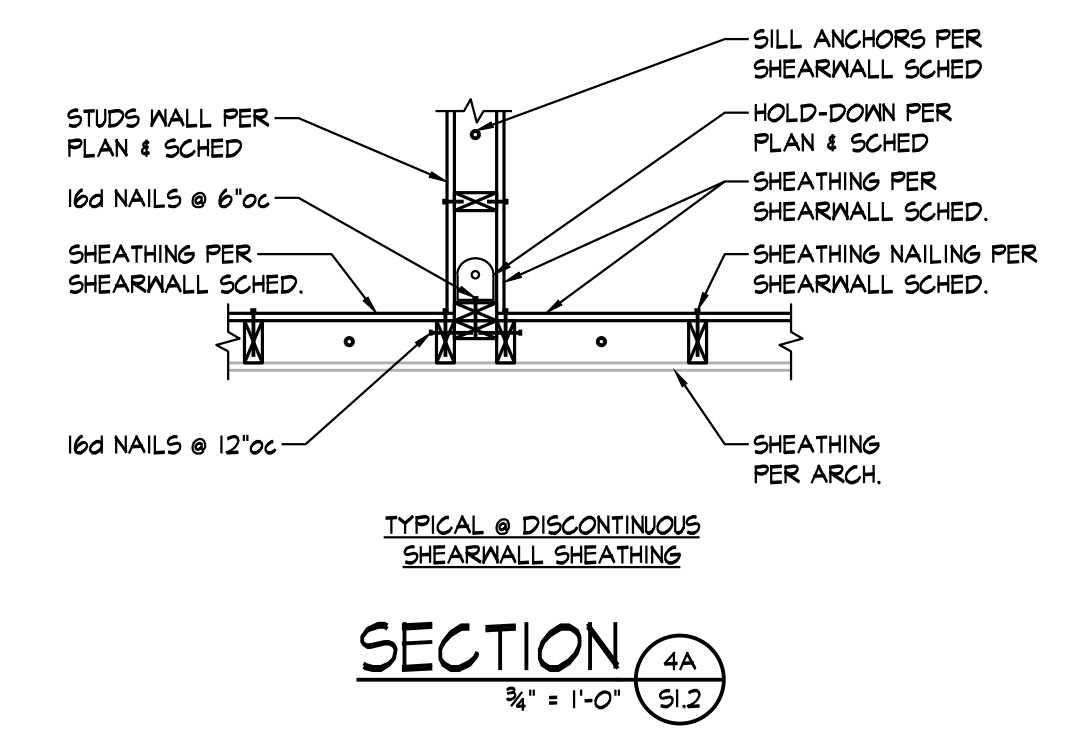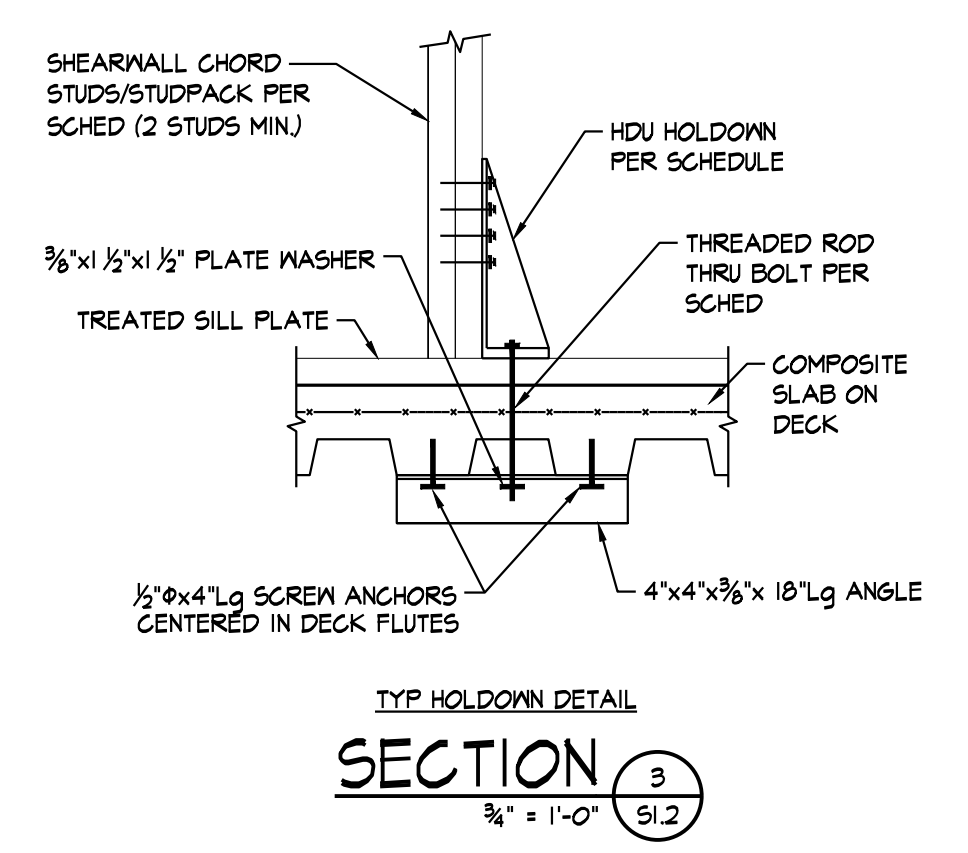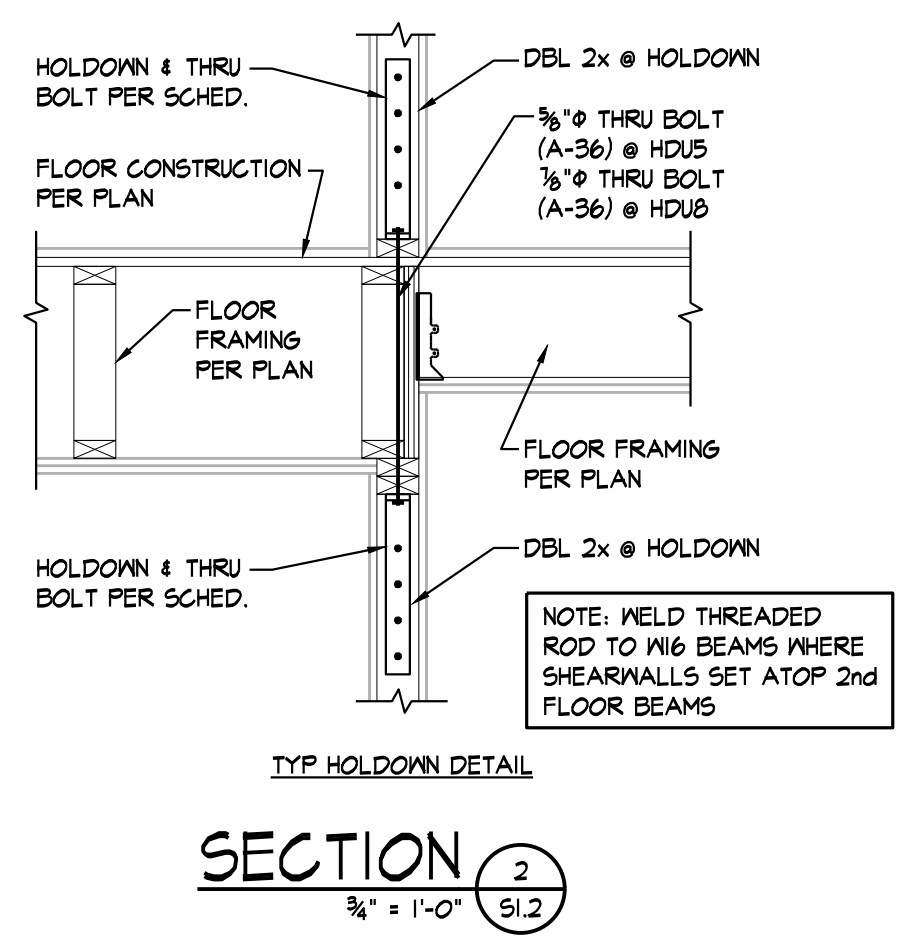


PROVIDE UNIT UPLIFT HOLD-DOWNS @ 48\"/>

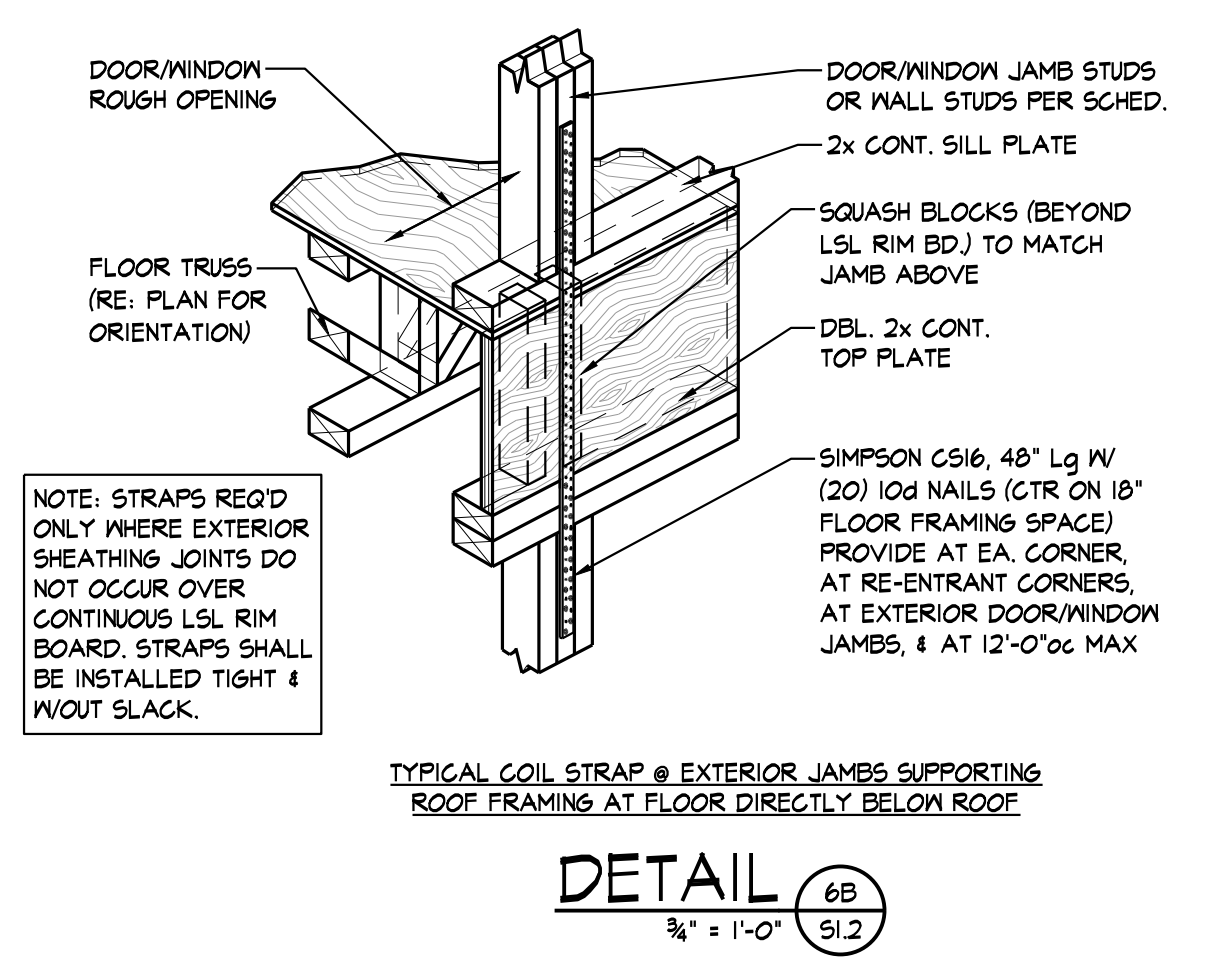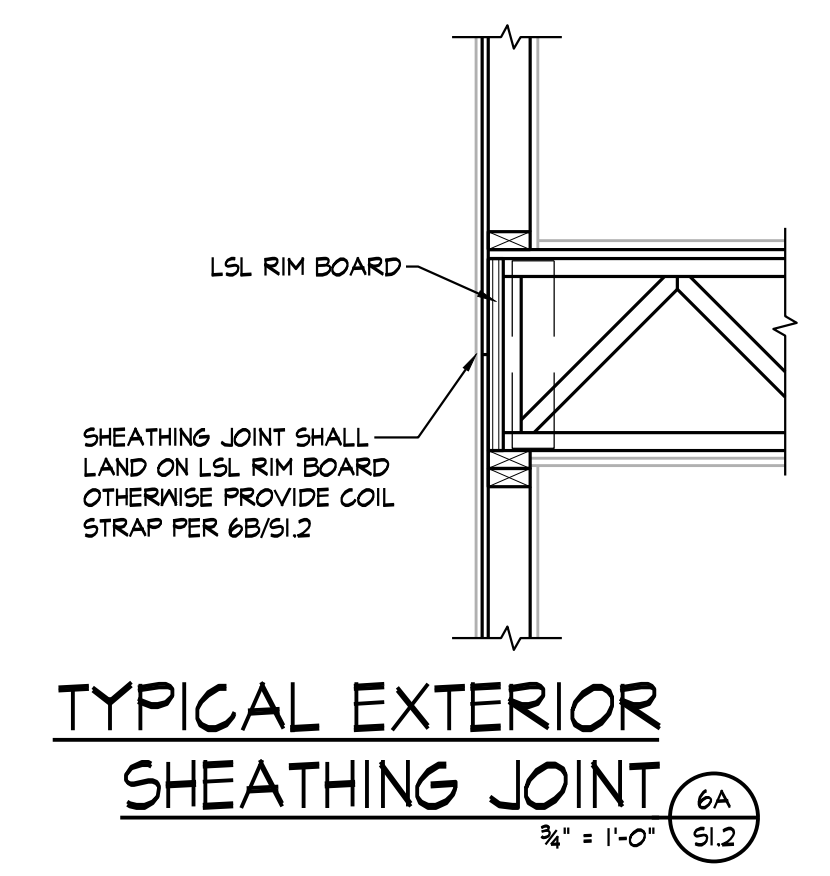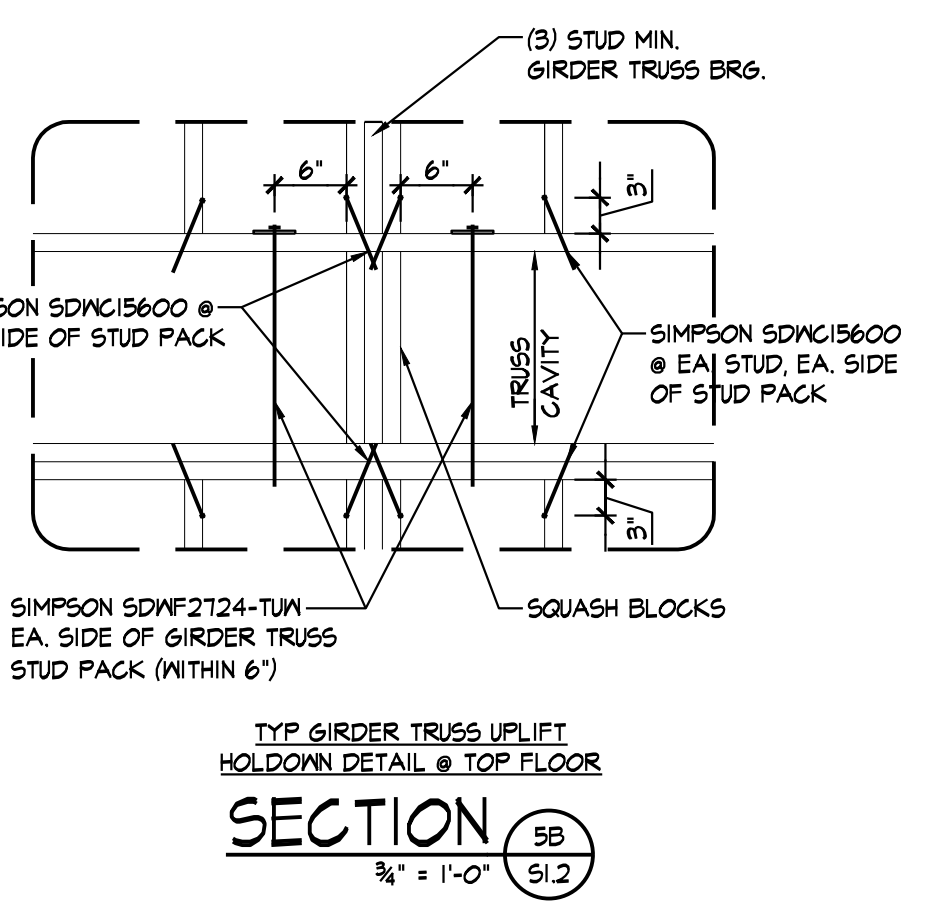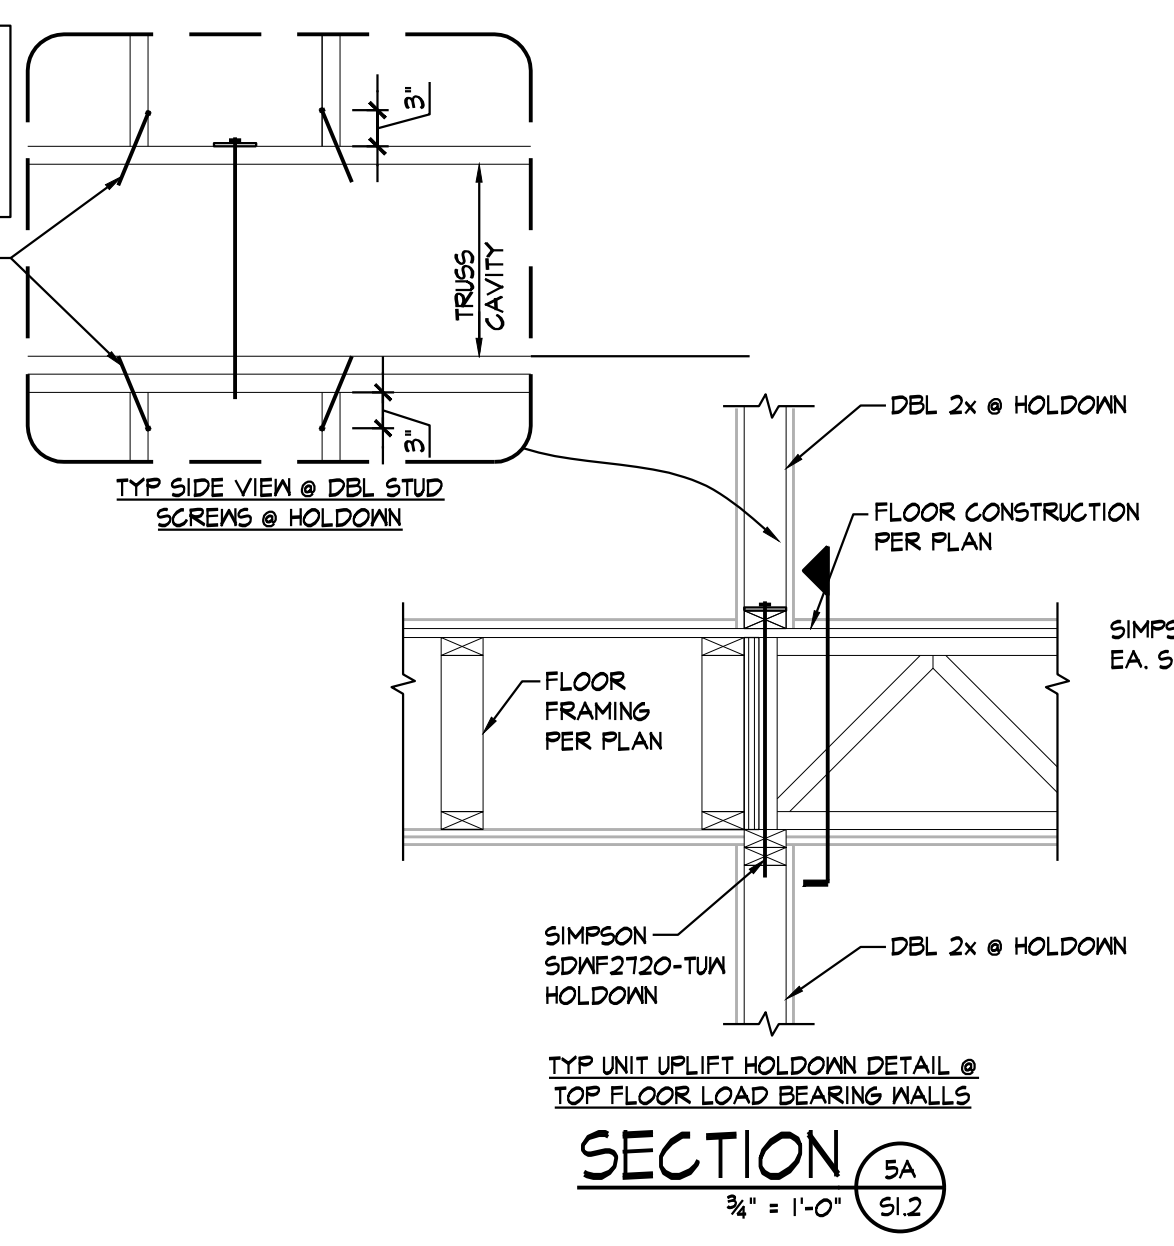


SHEARWALL SCHEDULE						
SHEARWALL LOCATION	SHEARWALL TYPE	MATERIAL & THICKNESS	FLOOR		SILL PLATE CONNECTION (RE: NOTES 6 & 7)	NUMBER OF WALL STUDS AT HOLD-DOWN (RE: NOTE 4)
			2nd FLOOR WALLS	3rd & 4th FLOOR WALLS		
AT DEMISING WALLS & EXTERIOR WALLS	SM	7/8\"/>				
AT CORRIDOR WALLS	SM	3/8\"/>				

HOLD-DOWN SCHEDULE			
MARK	FLOOR LEVEL (W/ APPLICABLE HOLD-DOWN TYPE PER FLOOR)		
	2nd FLOOR	3rd FLOOR	4th FLOOR
*	HDUE1-SDS3.5	HDUE5-SDS3	HDUE5-SDS3
**	HDUE5-SDS3	HDUE5-SDS3	HDUE5-SDS3


- NOTES:
- HOLD-DOWN TYPES ARE BASED UPON MANUFACTURER SIMPSON STRONG-TIE.
 - REFER TO SECTION DETAILS ON S1.2 FOR TYPICAL HOLD-DOWN DETAILS.
 - WHERE THE ENDS OF PERPENDICULAR SHEAR WALLS INTERSECT AND ONLY ONE HOLD-DOWN SHOWN ON PLAN, FASTEN ALL STUDS TOGETHER PER SCHEDULE AND USE LARGER OF THE TWO HOLD-DOWNS SHOWN ON THE SHEAR WALL SCHEDULE.
 - ALL HOLD-DOWN POSTS TO BE (2) 2x3 (MIN) (I.N.O.) TO MATCH STUD SIZE & GRADE NOTED IN WALL SCHEDULE. PROVIDE ADDITIONAL STUDS AS REQD TO MEET QUANTITY NOTED IN SCHED.
 - REFER TO SECTIONS 2/S1.2, 3/S1.2, 4A/S1.2 & 4B/S1.2 FOR HOLD-DOWN ANCHOR REQUIREMENTS.

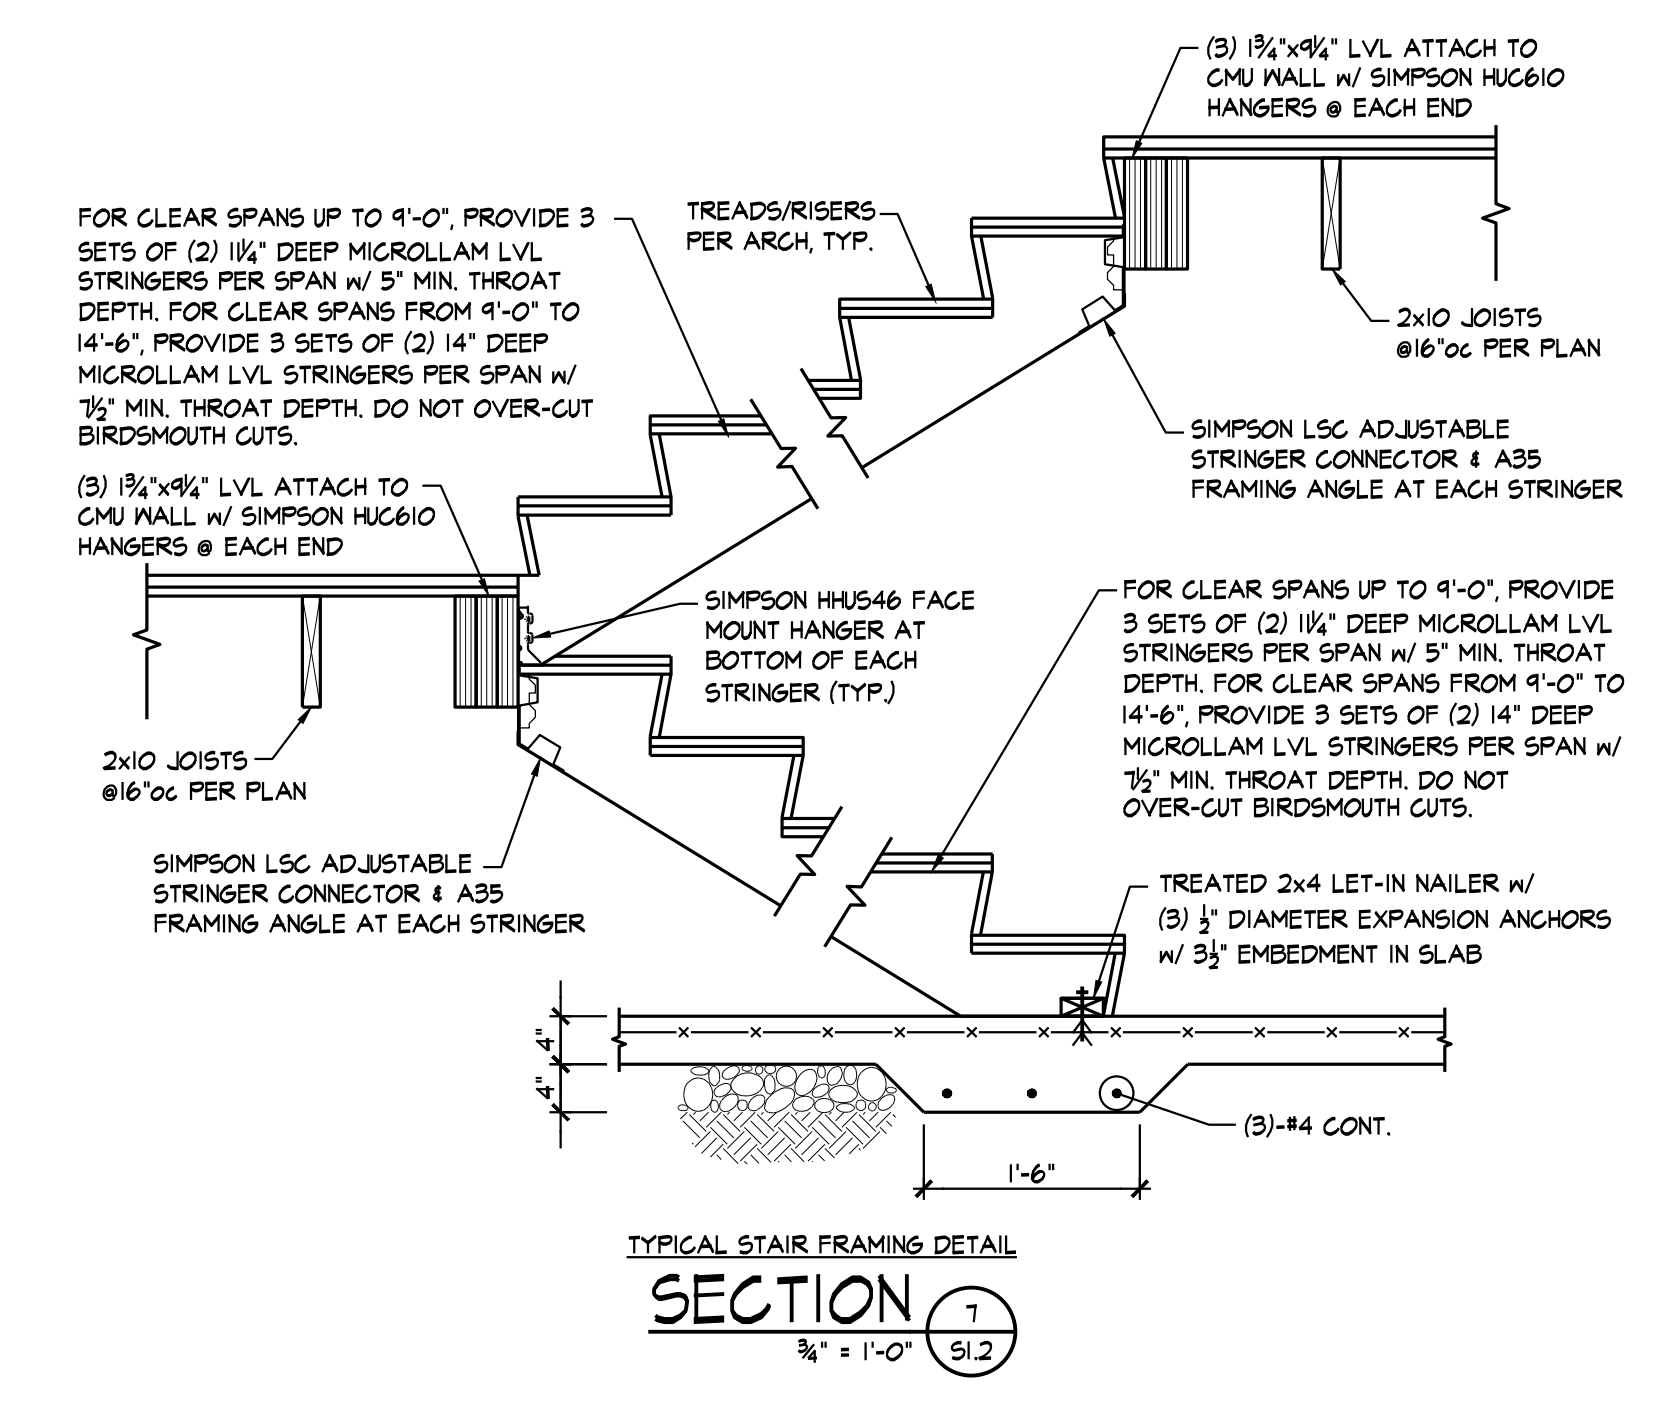

- NOTES:
- NAILING SHALL BE TO ALL STUDS, TOP & BOTTOM PLATES, AND BLOCKING WHERE INDICATED.
 - HOLD-DOWNS PER PLAN & SCHEDULE.
 - WHERE THE ENDS OF PERPENDICULAR SHEAR WALLS INTERSECT AND ONLY ONE HOLD-DOWN SHOWN ON PLAN, FASTEN ALL STUDS TOGETHER PER SCHEDULE AND USE LARGER OF THE TWO HOLD-DOWNS SHOWN IN THE SHEARWALL SCHEDULE. REFERENCE DETAILS 4A, 4B, 4C, AND 4D ON SHEET S1.2 FOR SHEATHING AND HOLD-DOWN ATTACHMENT AT PERPENDICULAR WALLS AND STUD WALL SIZE TRANSITIONS.
 - PROVIDE 2 WALL STUDS AT EACH HOLD-DOWN UNLESS NOTED OTHERWISE IN SCHEDULE. AT LOCATIONS WHERE A SHEARWALL TERMINATES AT AN OPENING JAMB, PROVIDE NUMBER OF STUDS PER JAMB SCHEDULE PLUS AN ADDITIONAL STUD FOR THE SHEARWALL. ATTACH ALL STUDS TOGETHER PER 6/S1.
 - NAIL SPACING SHOWN AS (N/I) INDICATES FASTENERS SPACING IN INCHES AT THE EDGES/FIELD WHERE FIELD IS THE INTERMEDIATE MEMBERS.
 - TYPICAL SILL PLATE TO WOOD SHALL BE 20G COMMON NAILS (1.09x2.4') AT 12\"/>

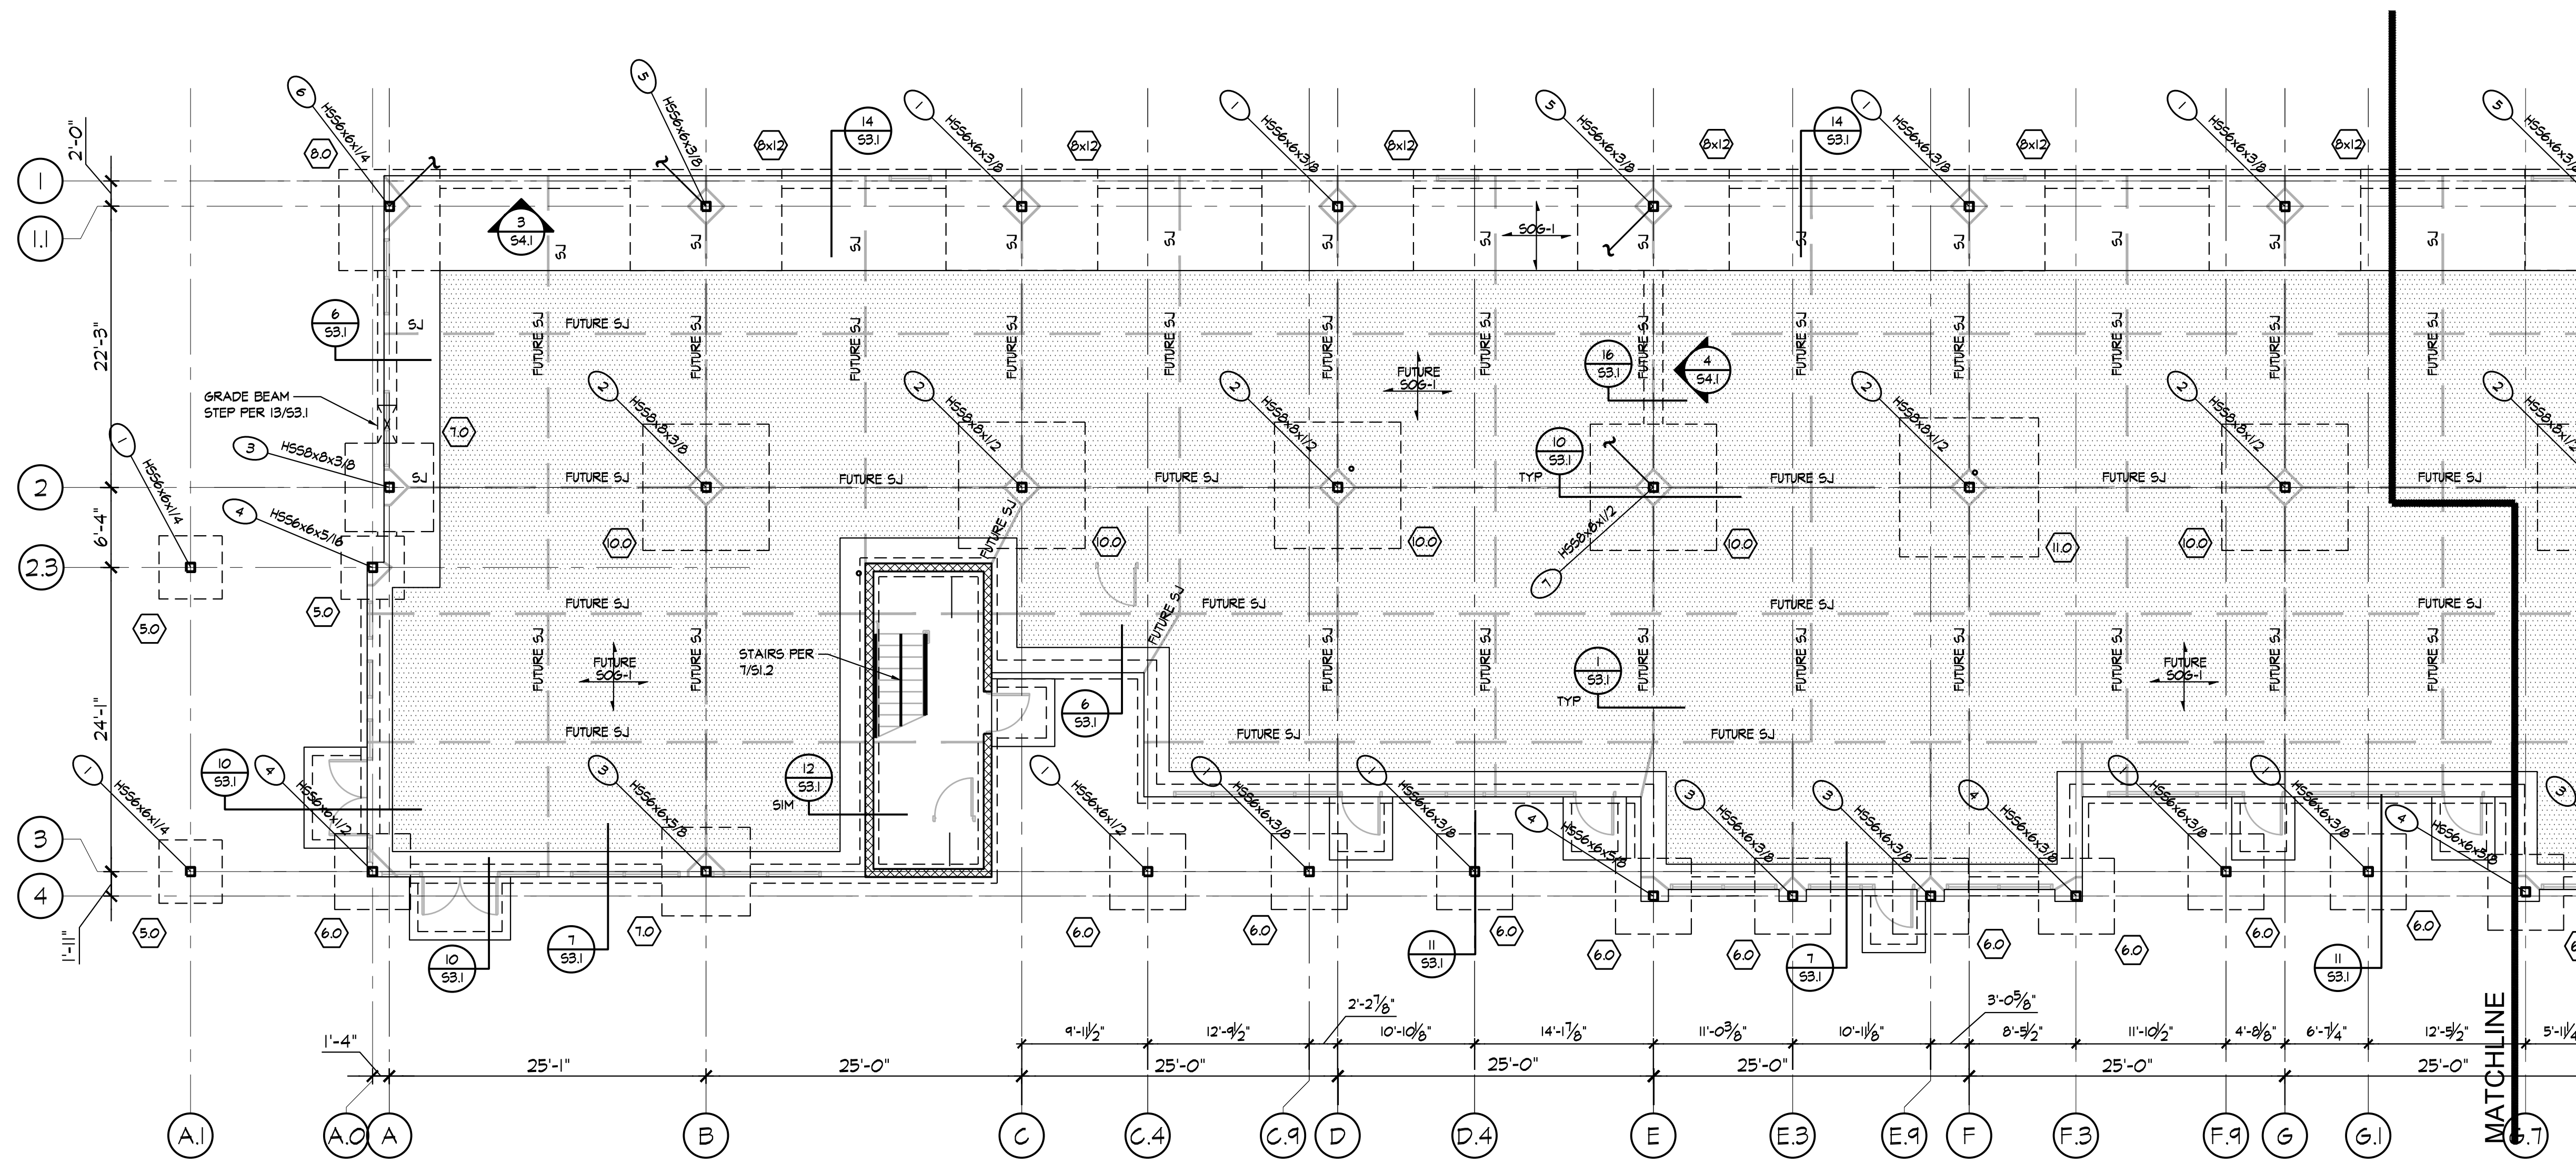

FOUNDATION PLAN
 1/8" = 1'-0"

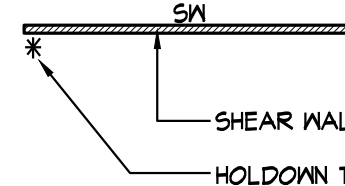- NOTES:
1. REFER TO GENERAL NOTES ON SHEET S01
 2. REFER TO COLUMN & FOOTING SCHEDULE ON SHEET S11
 3. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS NOT SHOWN
 4. REFER TO SHEETS S01 AND S11 FOR TYPICAL NAILING WOOD FRAMING DETAILS
 5. REFER TO SHEARWALL & HOLD-DOWN SCHEDULES ON SHEET S12
 6. SHEARWALLS/HOLD-DOWNS DESIGNED AS FOLLOWS:

 - SHEAR WALL EXTENTS INDICATED W/ HATCHED AREA
 - HOLD-DOWN TYPE MARK: (I) HOLD-DOWN TYPICAL EACH END OF SHEARWALL PER HOLD-DOWN ANCHOR SCHED.
 7. REFER TO SECTIONS 2/S1.2 & 3/S1.2 FOR HOLD-DOWNS AT END OF WALL

THE RESERVES AT MEADOWS 25
 NEW APARTMENTS
 GODDARD, KANSAS



REVISION:


DATE: 4-17-2026

JOB: 25-3465

SHEET NO.:

BOB D. CAMPBELL & CO.
 Structural Engineers Since 1957
 4338 Belleview Ave. 816.531.4144
 Kansas City, MO 64111 www.bdc-engrs.com

S2.1A

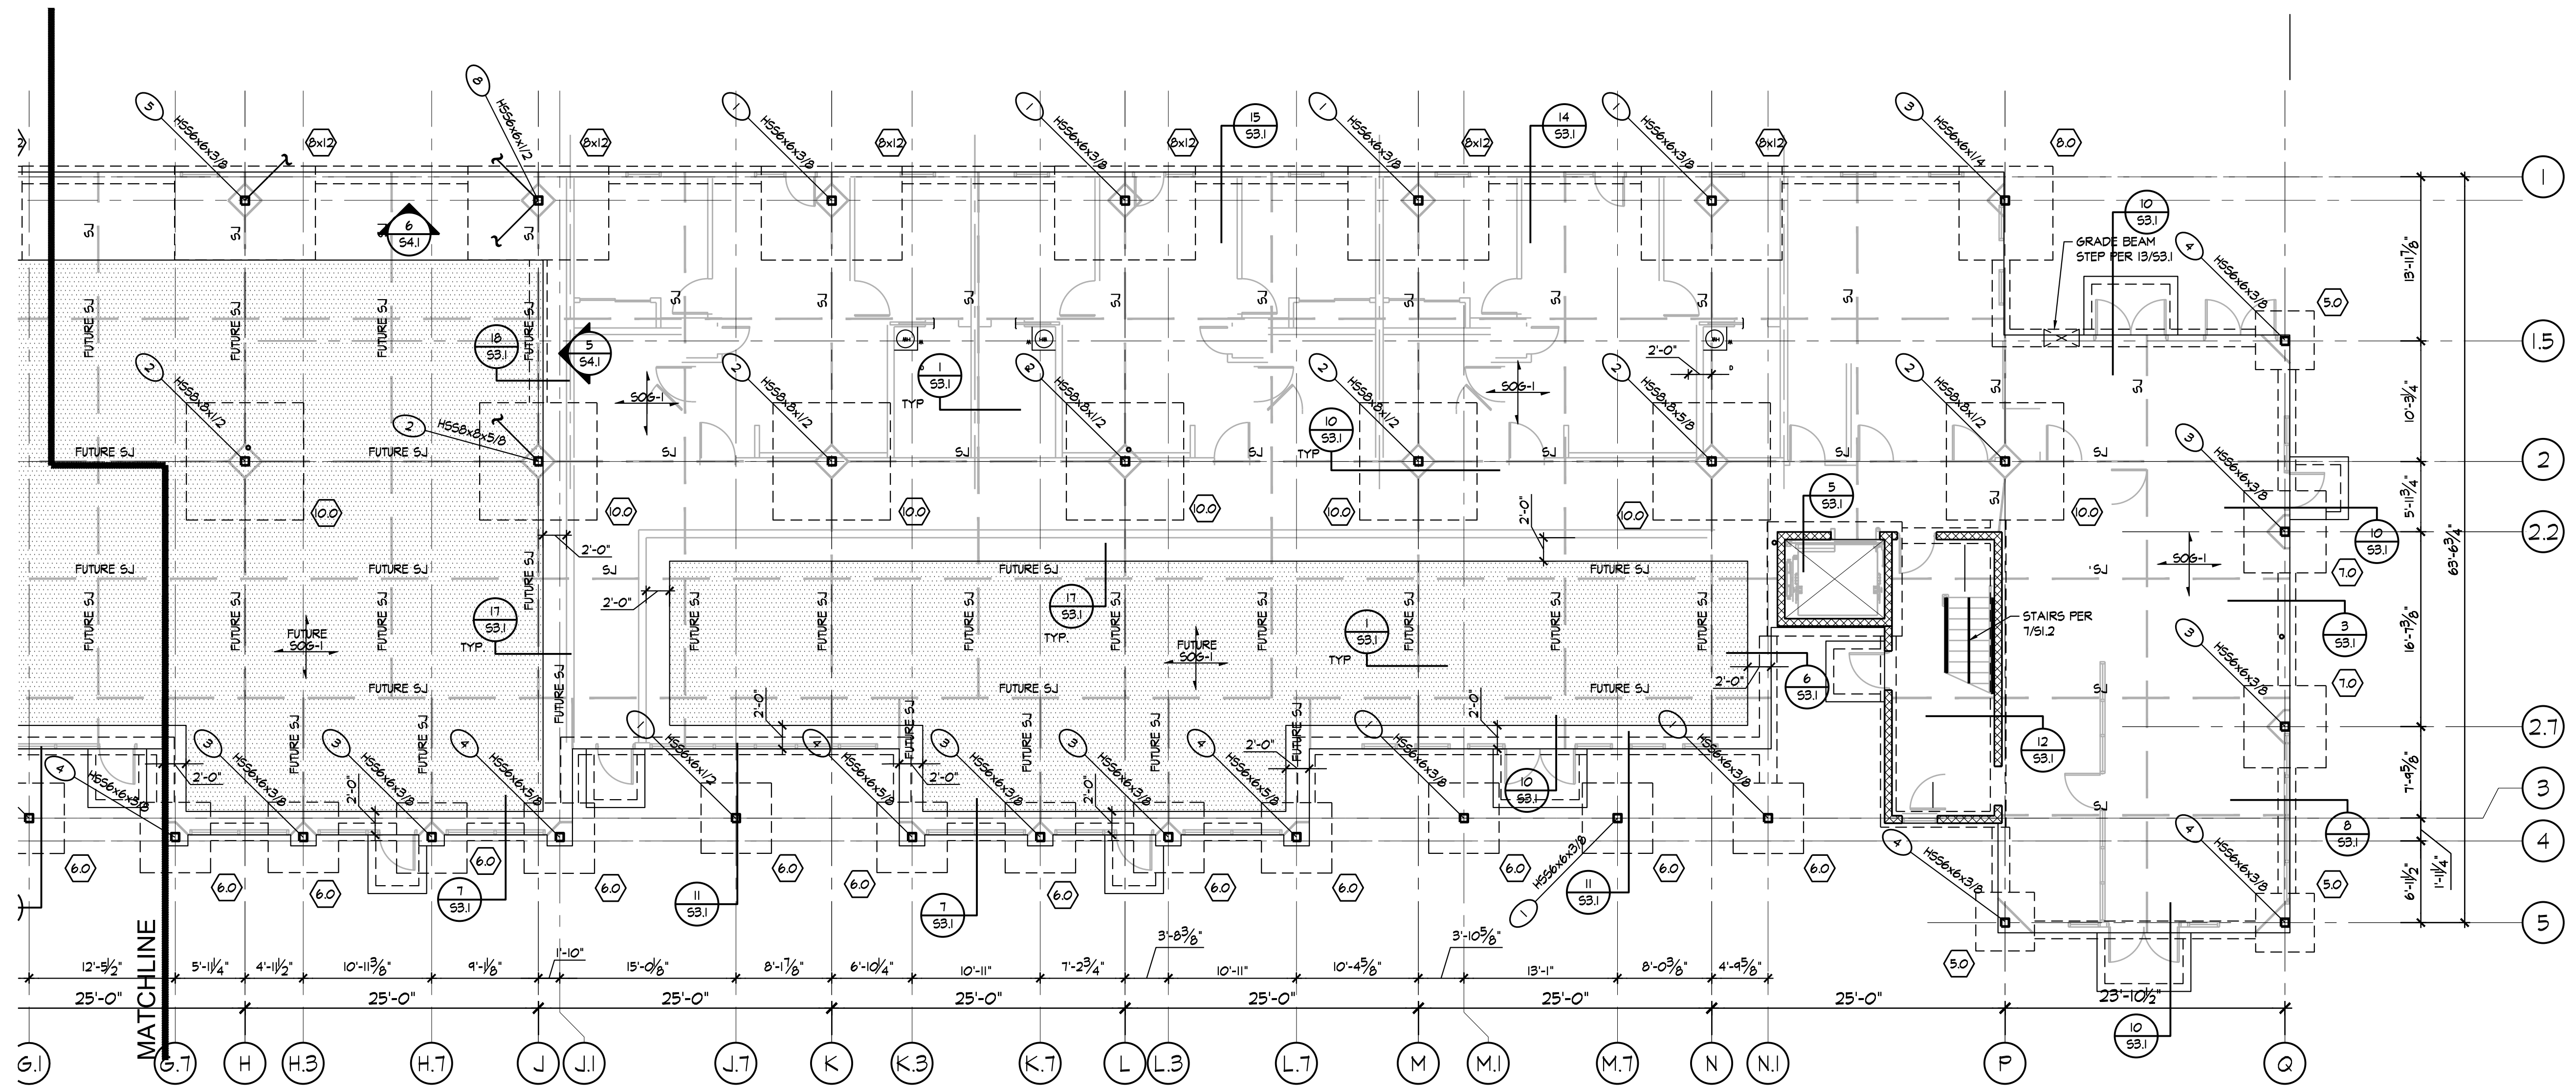


FOUNDATION PLAN
 1/8" = 1'-0"

- NOTES:
1. REFER TO GENERAL NOTES ON SHEET S01
 2. REFER TO COLUMN & FOOTING SCHEDULE ON SHEET S11
 3. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS NOT SHOWN
 4. REFER TO SHEETS S01 AND S11 FOR TYPICAL NAILING WOOD FRAMING DETAILS
 5. REFER TO SHEARWALL & HOLDOWN SCHEDULES ON SHEET S12
 6. SHEARWALLS/HOLDOWNS DESIGNED AS FOLLOWS:
 - SMK
 - SHEAR WALL EXTENTS INDICATED W/ HATCHED AREA
 - HOLDOWN TYPE MARK: (1) HOLDOWN TYPICAL EACH END OF SHEARWALL PER HOLDOWN ANCHOR SCHED.
 7. REFER TO SECTIONS 2/51.2 & 3/51.2 FOR HOLDOWNS AT END OF WALL




REVISION:	
DATE:	4-17-2026
JOB:	25-3465
SHEET NO.:	

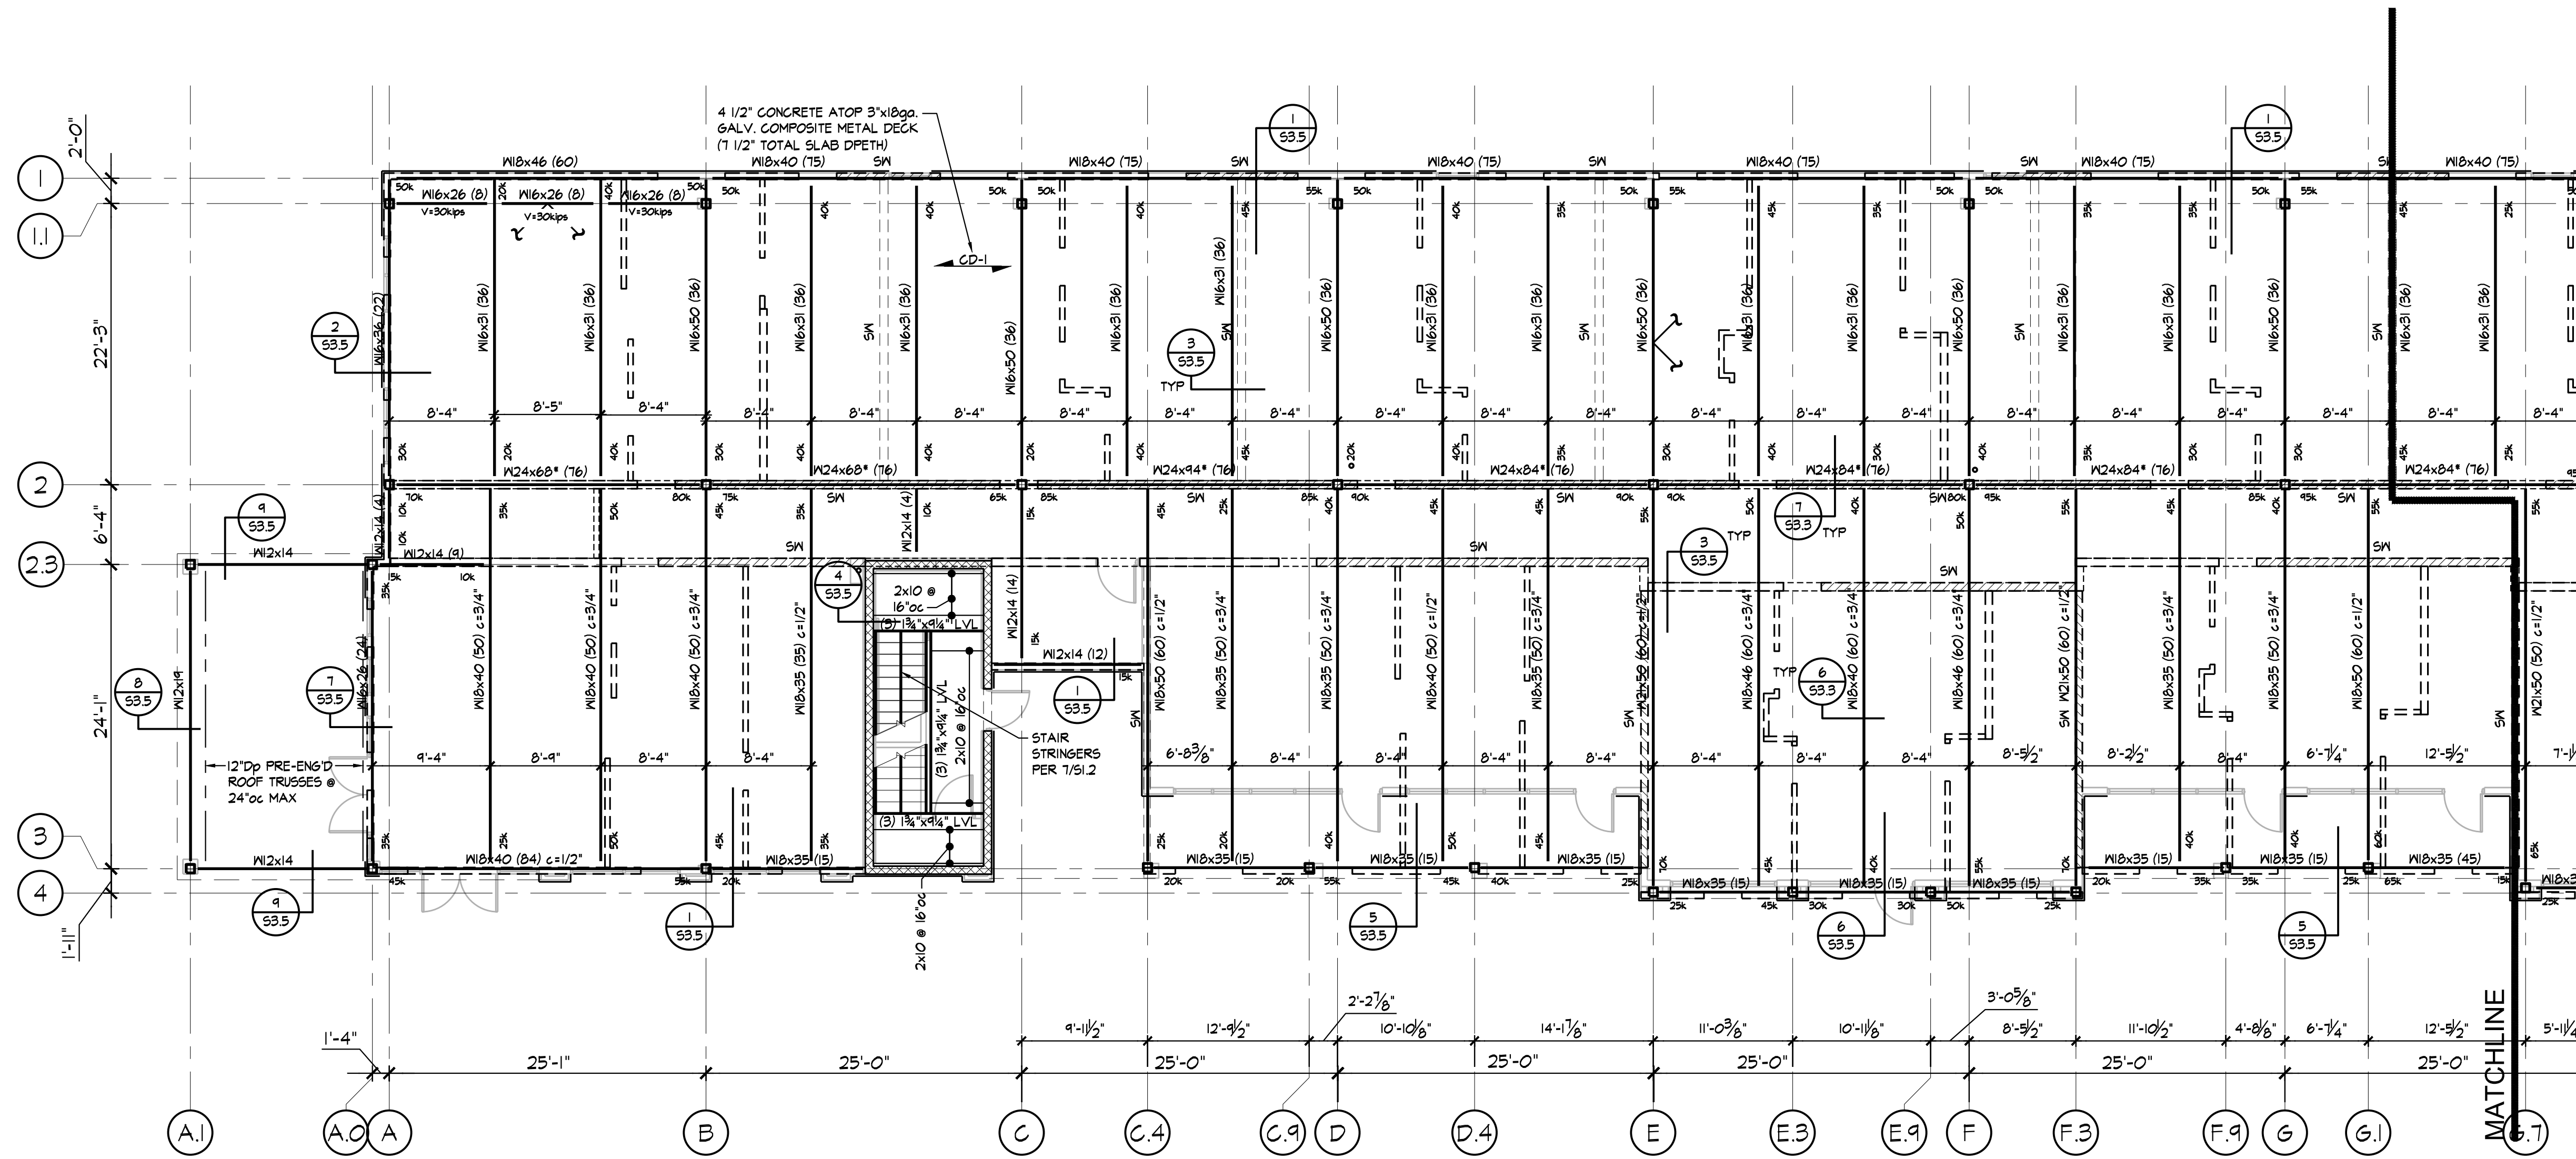

SECOND FLOOR FRAMING PLAN
 1/8" = 1'-0"

- NOTES:
1. REFER TO GENERAL NOTES ON SHEET S0.1
 2. REFER TO COLUMN & FOOTING SCHEDULE ON SHEET S1.1
 3. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS NOT SHOWN
 4. REFER TO SHEETS S0.1 AND S1.1 FOR TYPICAL NAILING WOOD FRAMING DETAILS
 5. REFER TO SHEARWALL & HOLDOWN SCHEDULES ON SHEET S1.2
 6. SHEARWALLS/HOLDOWNS DESIGNED AS FOLLOWS:

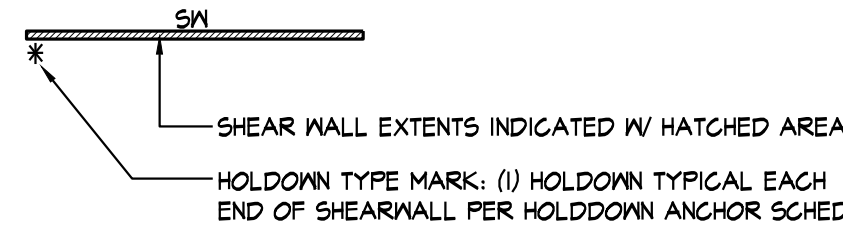

7. REFER TO SECTIONS 2/S1.2 & 3/S1.2 FOR HOLDOWNS AT END OF WALL
8. BEAMS SHOWN WITH AN * SYMBOL ARE DESIGNED TO HAVE AN 8" TALL x 12" WIDE RECTANGULAR OPENING LOCATED AT MIDSPAN & MID-DEPTH WITHOUT WEB STIFFENERS (I.E. W24x68* (60))

THE RESERVES AT MEADOWS 25
 NEW APARTMENTS
 GODDARD, KANSAS



REVISION:


DATE: 4-17-2026

JOB: 25-3465

SHEET NO.:


BOB D. CAMPBELL & CO.
 Structural Engineers Since 1957
 4338 Bellevue Ave. 816.531.4144
 Kansas City, MO 64111 www.bdc-engrs.com

S2.2A

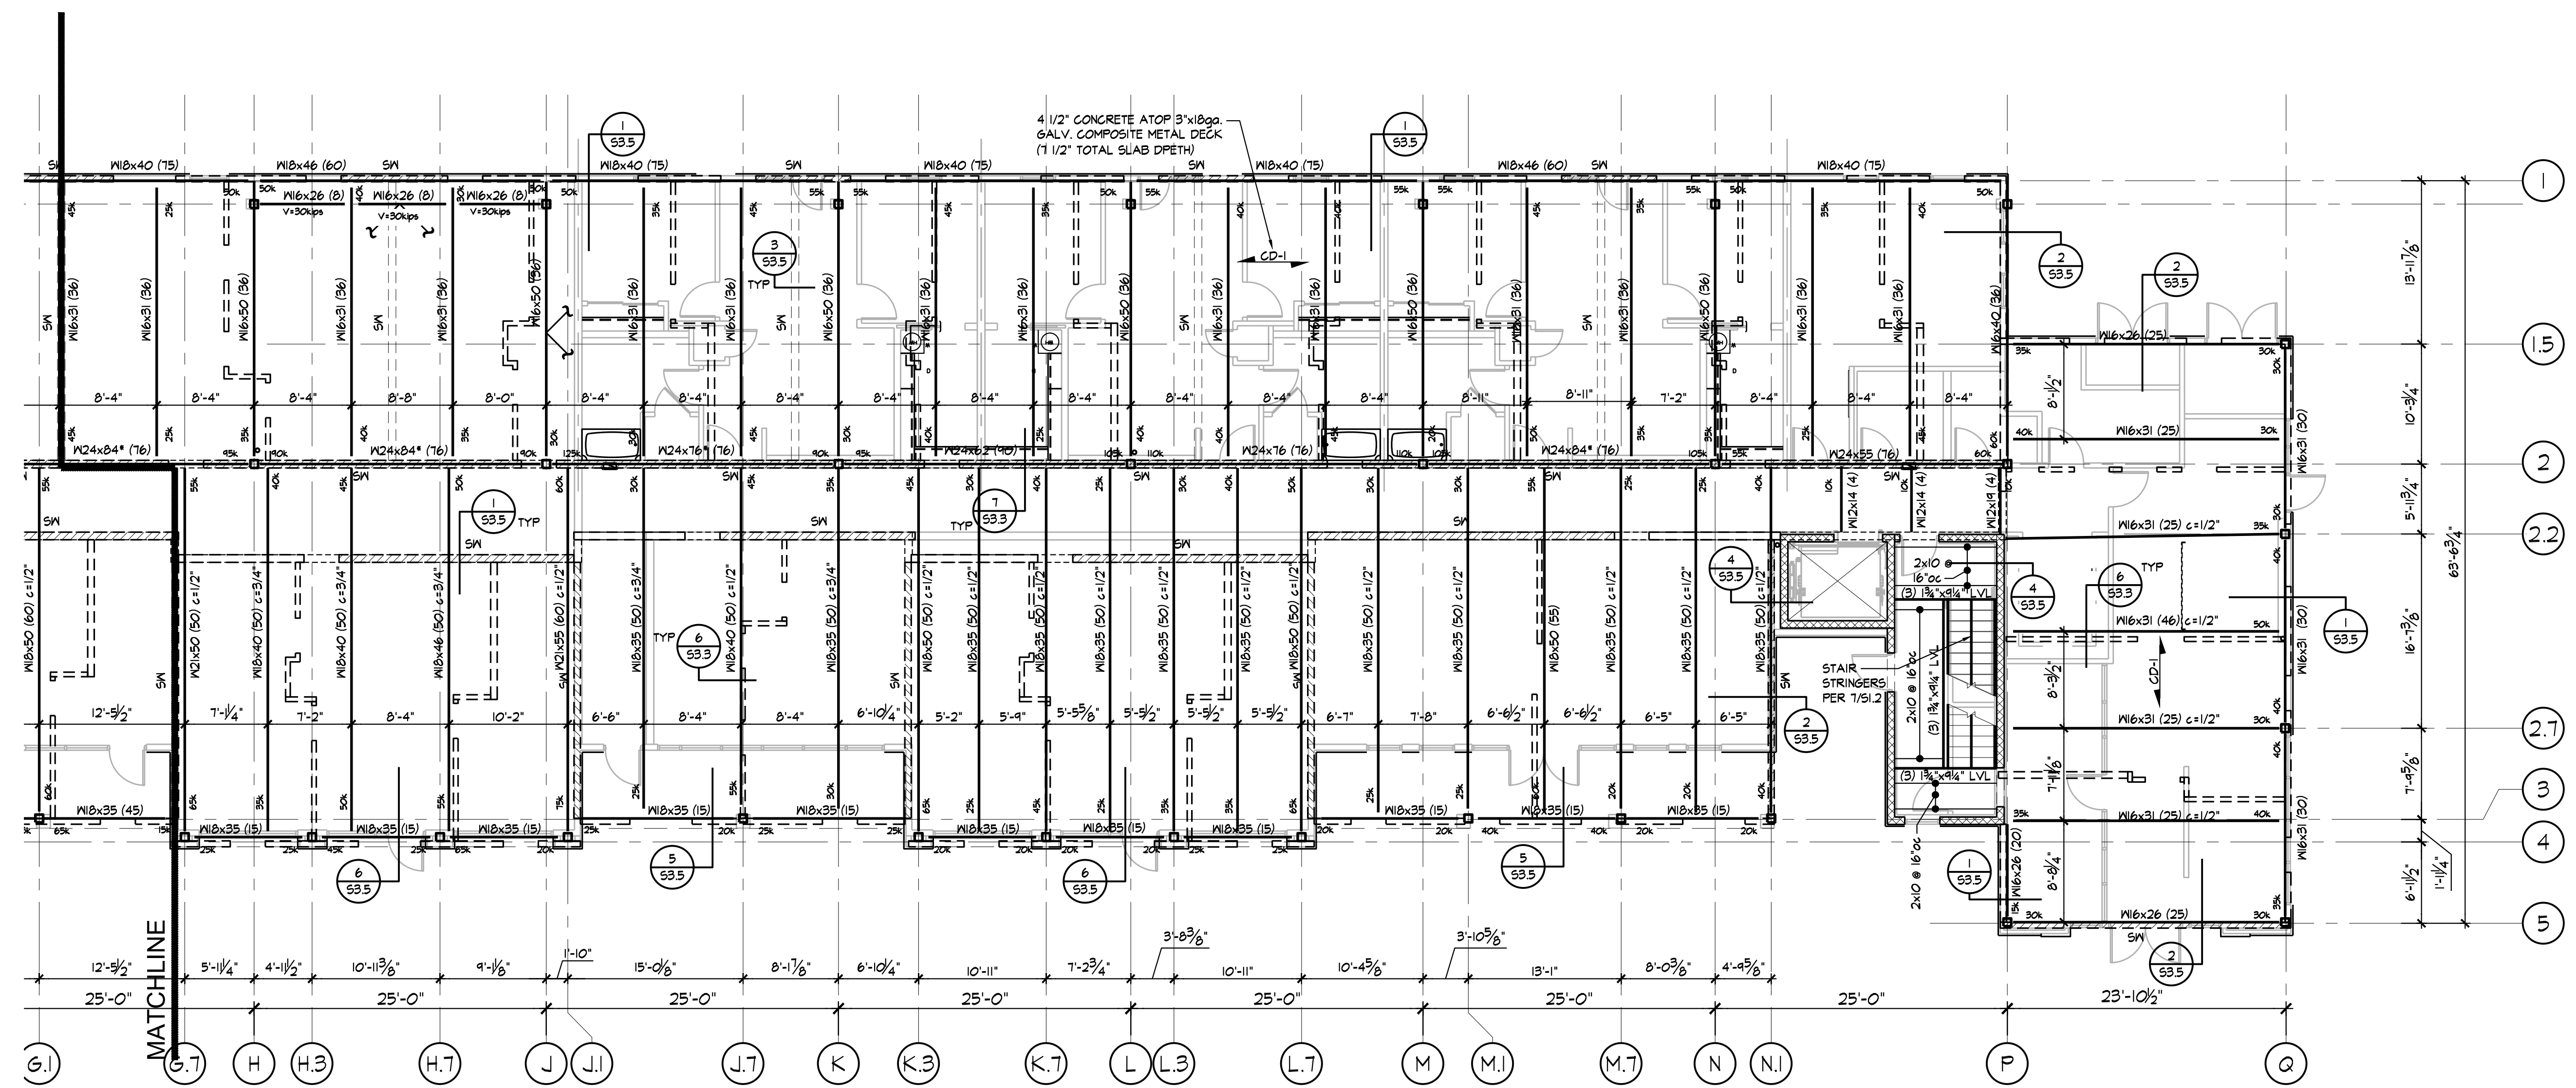

SECOND FLOOR FRAMING PLAN
 1/8" = 1'-0"

- NOTES:
1. REFER TO GENERAL NOTES ON SHEET S01.
 2. REFER TO COLUMN & FOOTING SCHEDULE ON SHEET S11.
 3. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS NOT SHOWN.
 4. REFER TO SHEETS S01 AND S11 FOR TYPICAL NAILING WOOD FRAMING DETAILS.
 5. REFER TO SHEARWALL & HOLDDOWN SCHEDULES ON SHEET S12.
 6. SHEARWALLS/HOLDDOWNS DESIGNED AS FOLLOWS:

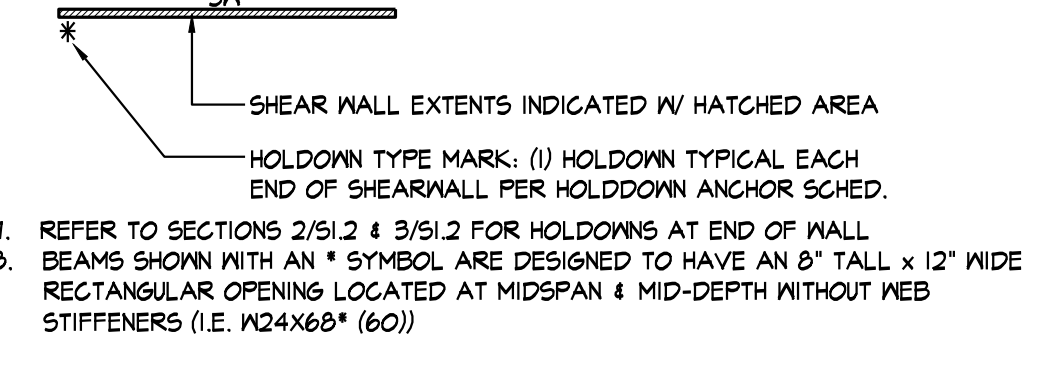


THE RESERVES AT MEADOWS 25
 NEW APARTMENTS
 GODDARD, KANSAS



REVISION:
 DATE: 4-17-2026
 JOB: 25-3465
 SHEET NO.:

BOB D. CAMPBELL & CO.
 Structural Engineers Since 1957
 4338 Bellevue Ave. 816.531.4144
 Kansas City, MO 64111 www.bdc-engrs.com


S2.2B

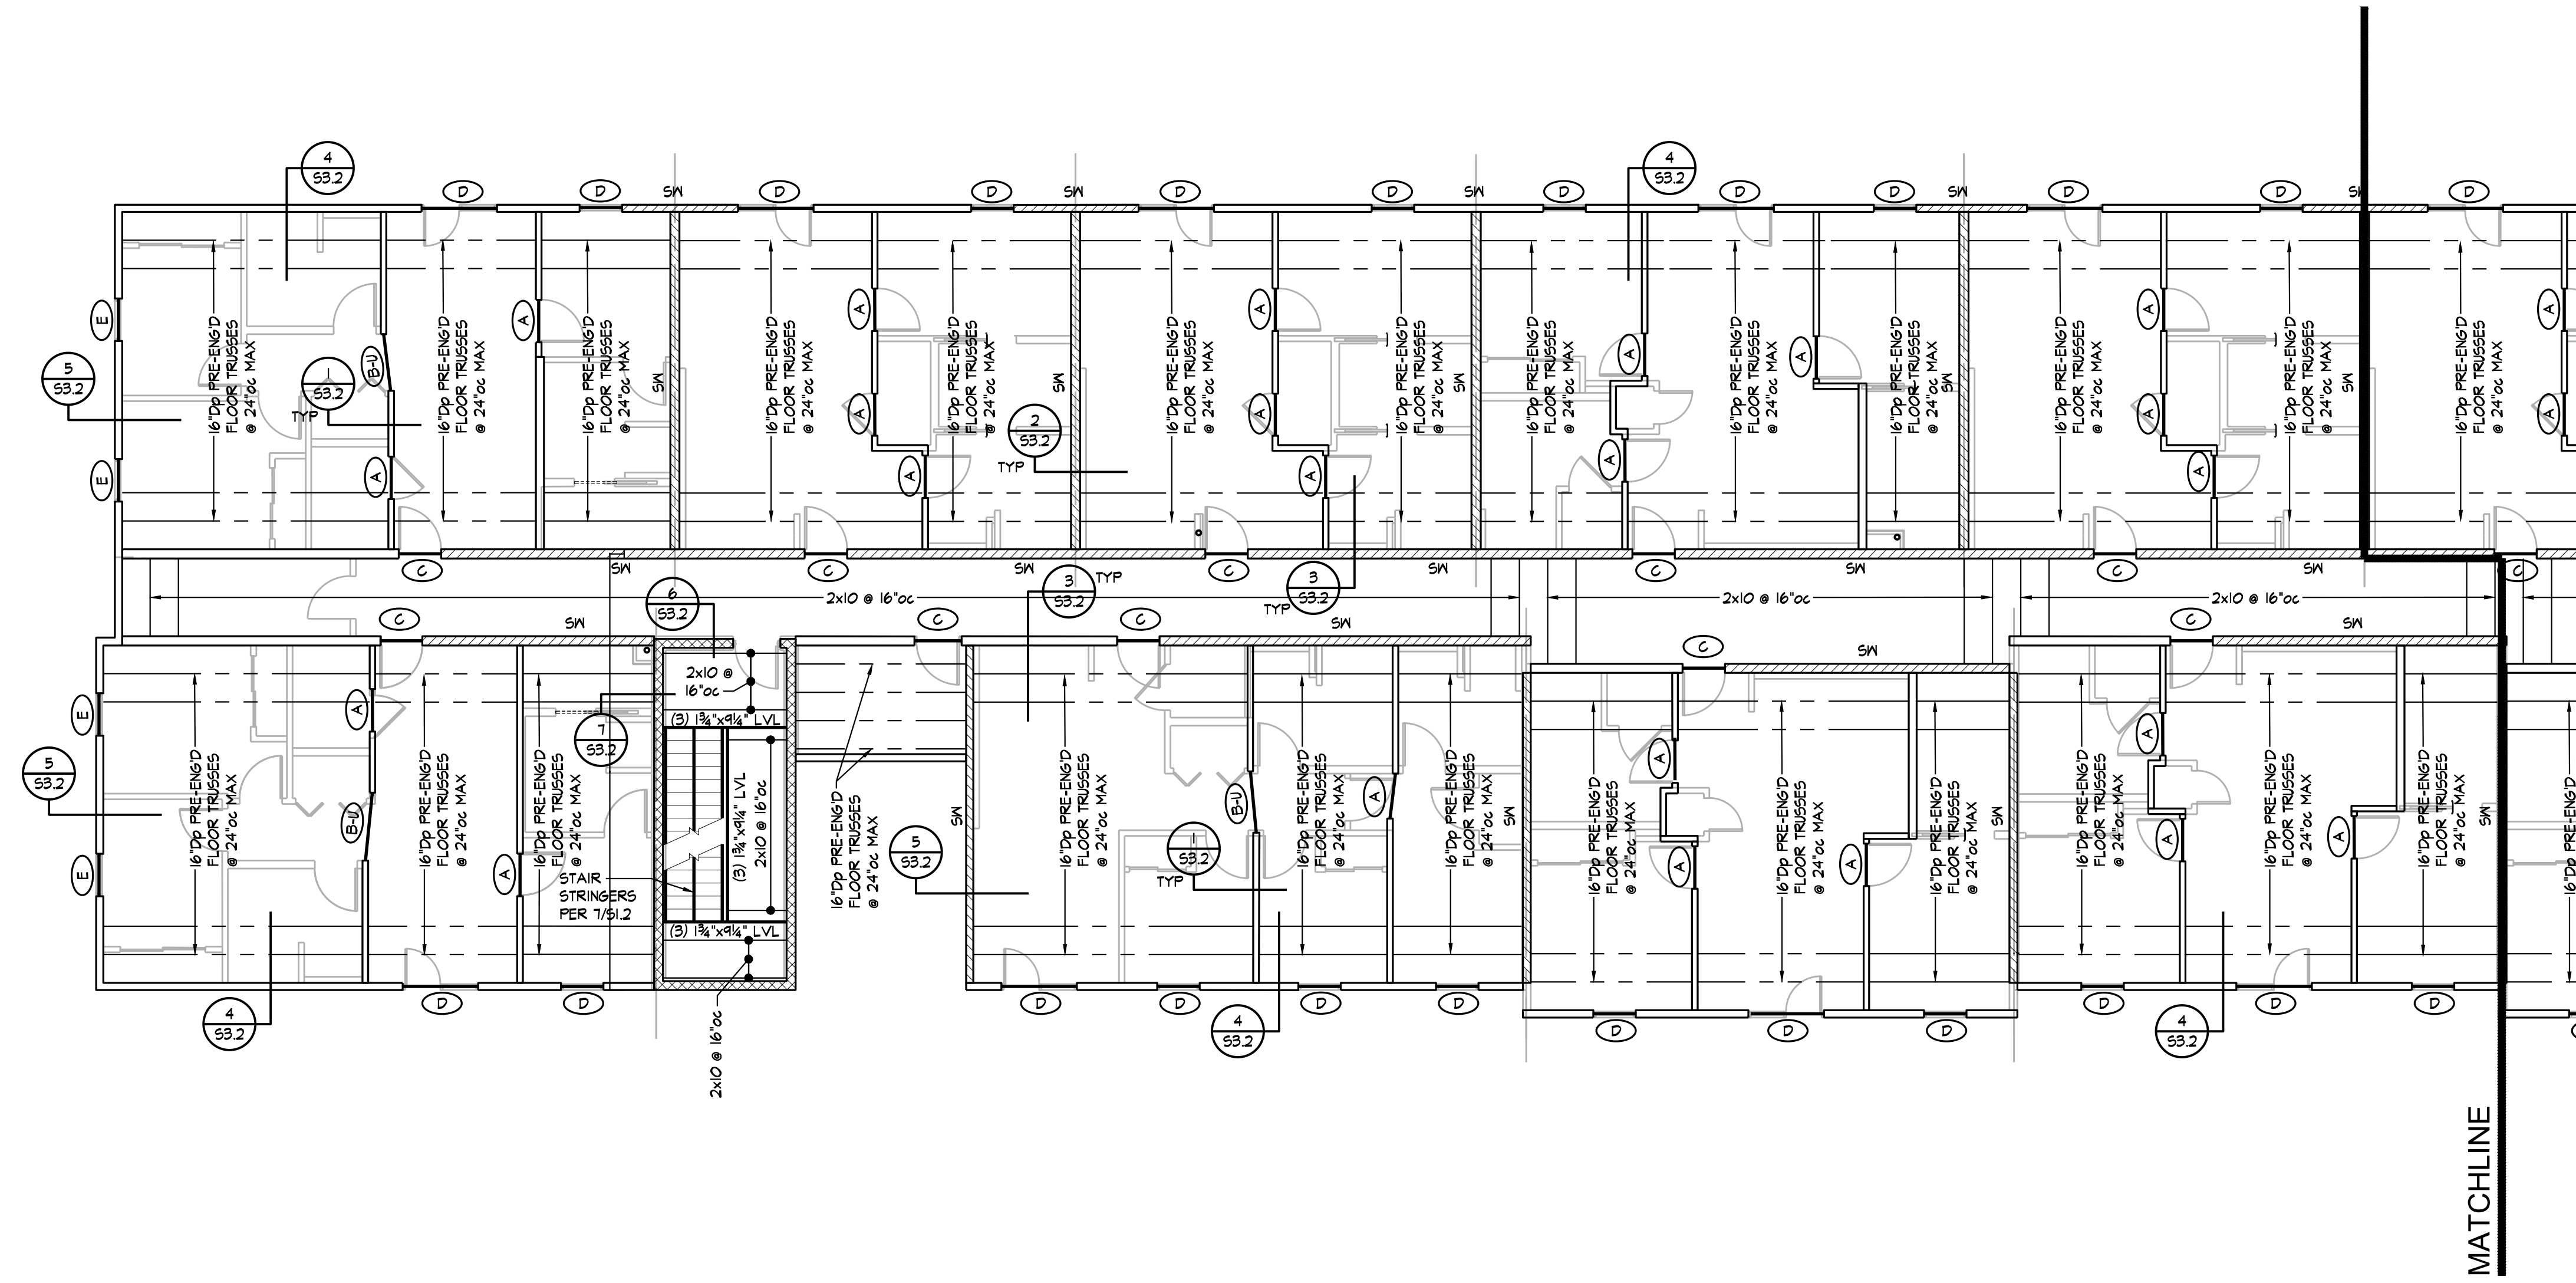

THIRD FLOOR FRAMING PLAN

1/8" = 1'-0"

- NOTES:
1. REFER TO GENERAL NOTES ON SHEET S01
 2. REFER TO COLUMN & FOOTING SCHEDULE ON SHEET S11
 3. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS NOT SHOWN
 4. REFER TO SHEETS S01 AND S11 FOR TYPICAL NAILING WOOD FRAMING DETAILS
 5. REFER TO SHEARWALL & HOLDDOWN SCHEDULES ON SHEET S12
 6. SHEARWALLS/HOLDDOWNS DESIGNED AS FOLLOWS:

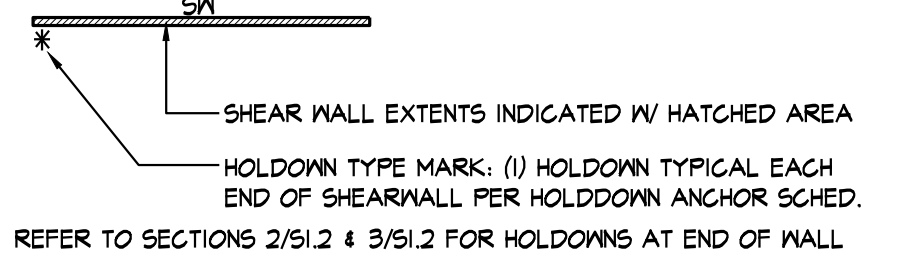

7. REFER TO SECTIONS 2/S12 & 3/S12 FOR HOLDDOWNS AT END OF WALL

THE RESERVES AT MEADOWS 25

NEW APARTMENTS

GODDARD, KANSAS



REVISION:


DATE: 4-17-2026

JOB: 25-3465

SHEET NO.:

BOB D. CAMPBELL & CO.
 Structural Engineers Since 1957
 4338 Bellevue Ave. 816.531.4144
 Kansas City, MO 64111 www.bdc-engrs.com

S2.3A

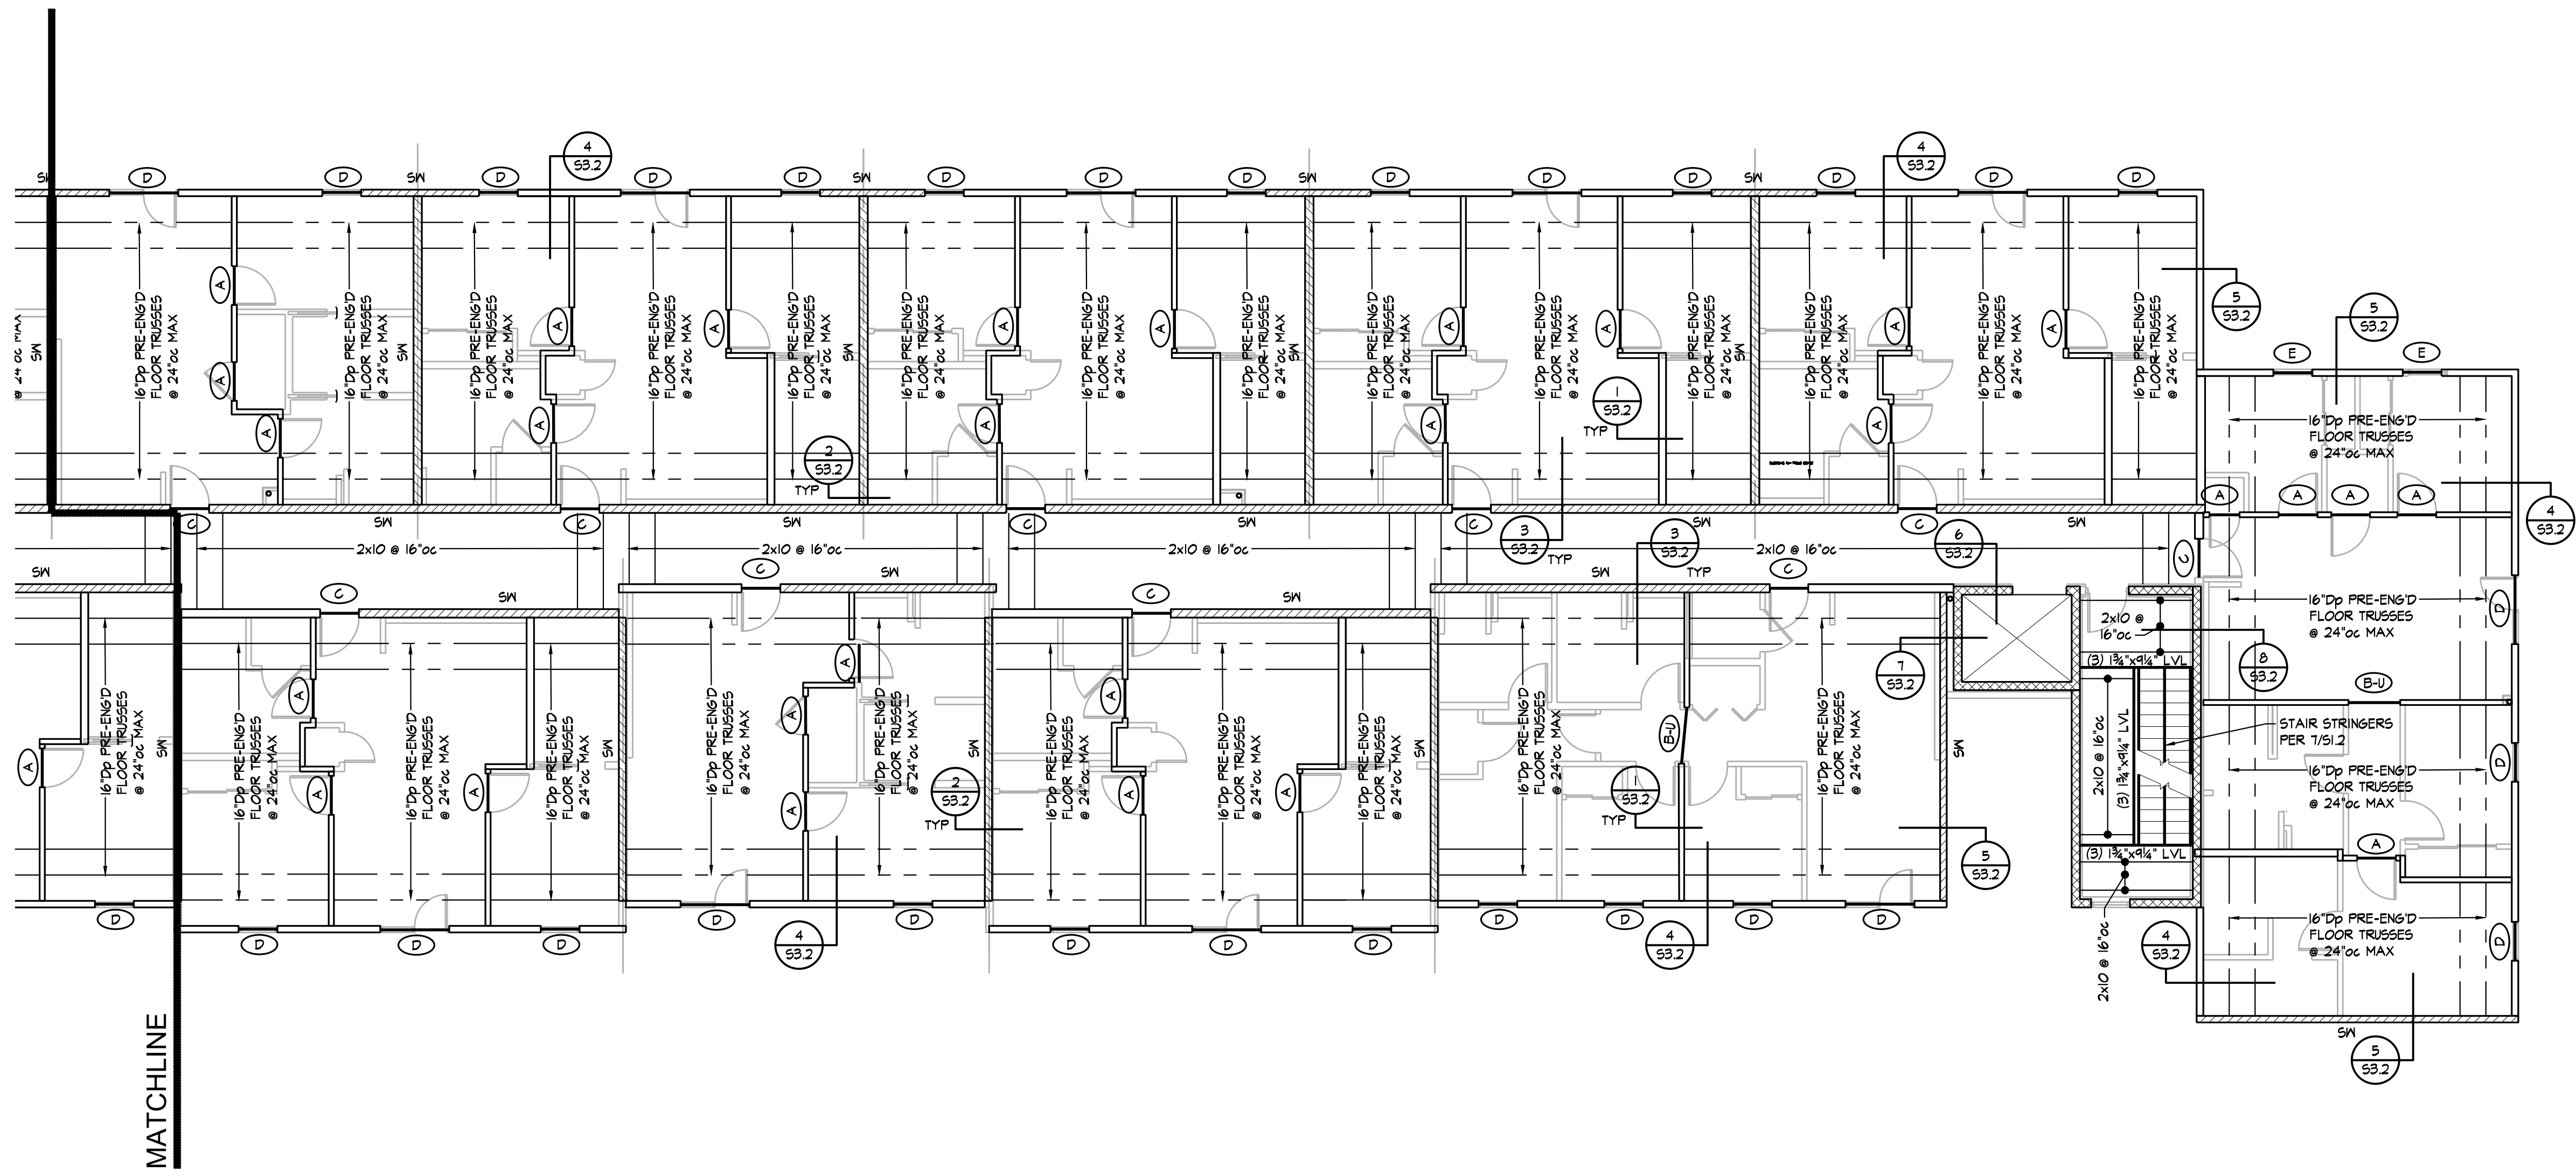


MATCHLINE

THIRD FLOOR FRAMING PLAN

1/8" = 1'-0"

- NOTES:
1. REFER TO GENERAL NOTES ON SHEET S01
 2. REFER TO COLUMN & FOOTING SCHEDULE ON SHEET S11
 3. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS NOT SHOWN
 4. REFER TO SHEETS S01 AND S11 FOR TYPICAL NAILING WOOD FRAMING DETAILS
 5. REFER TO SHEARWALL & HOLDOWN SCHEDULES ON SHEET S12
 6. SHEARWALLS/HOLDOWNS DESIGNED AS FOLLOWS:

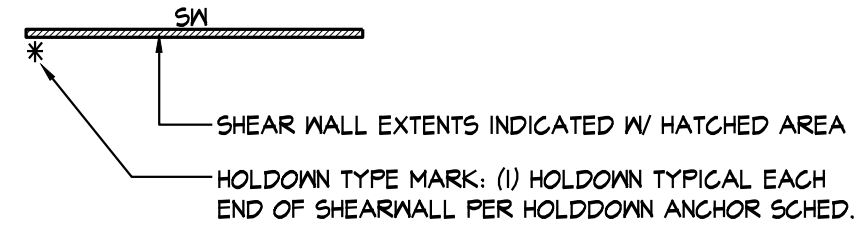

7. REFER TO SECTIONS 2/S1.2 & 3/S1.2 FOR HOLDOWNS AT END OF WALL

THE RESERVES AT MEADOWS 25

NEW APARTMENTS

GODDARD, KANSAS



REVISION:

DATE: 4-17-2026

JOB: 25-3465


SHEET NO.:

BOB D. CAMPBELL & CO.
Structural Engineers Since 1957
4338 Belleview Ave. 816.531.4144
Kansas City, MO 64111 www.bdc-engrs.com

S2.3B

COPYRIGHTED ©


JGR
Jones Gillam Renz
730 N. Ninth 1881 Main Street, Suite 301
Salina, KS 67401 Kansas City, MO 64108
785.827.0386 jgr@jgrarchitects.com

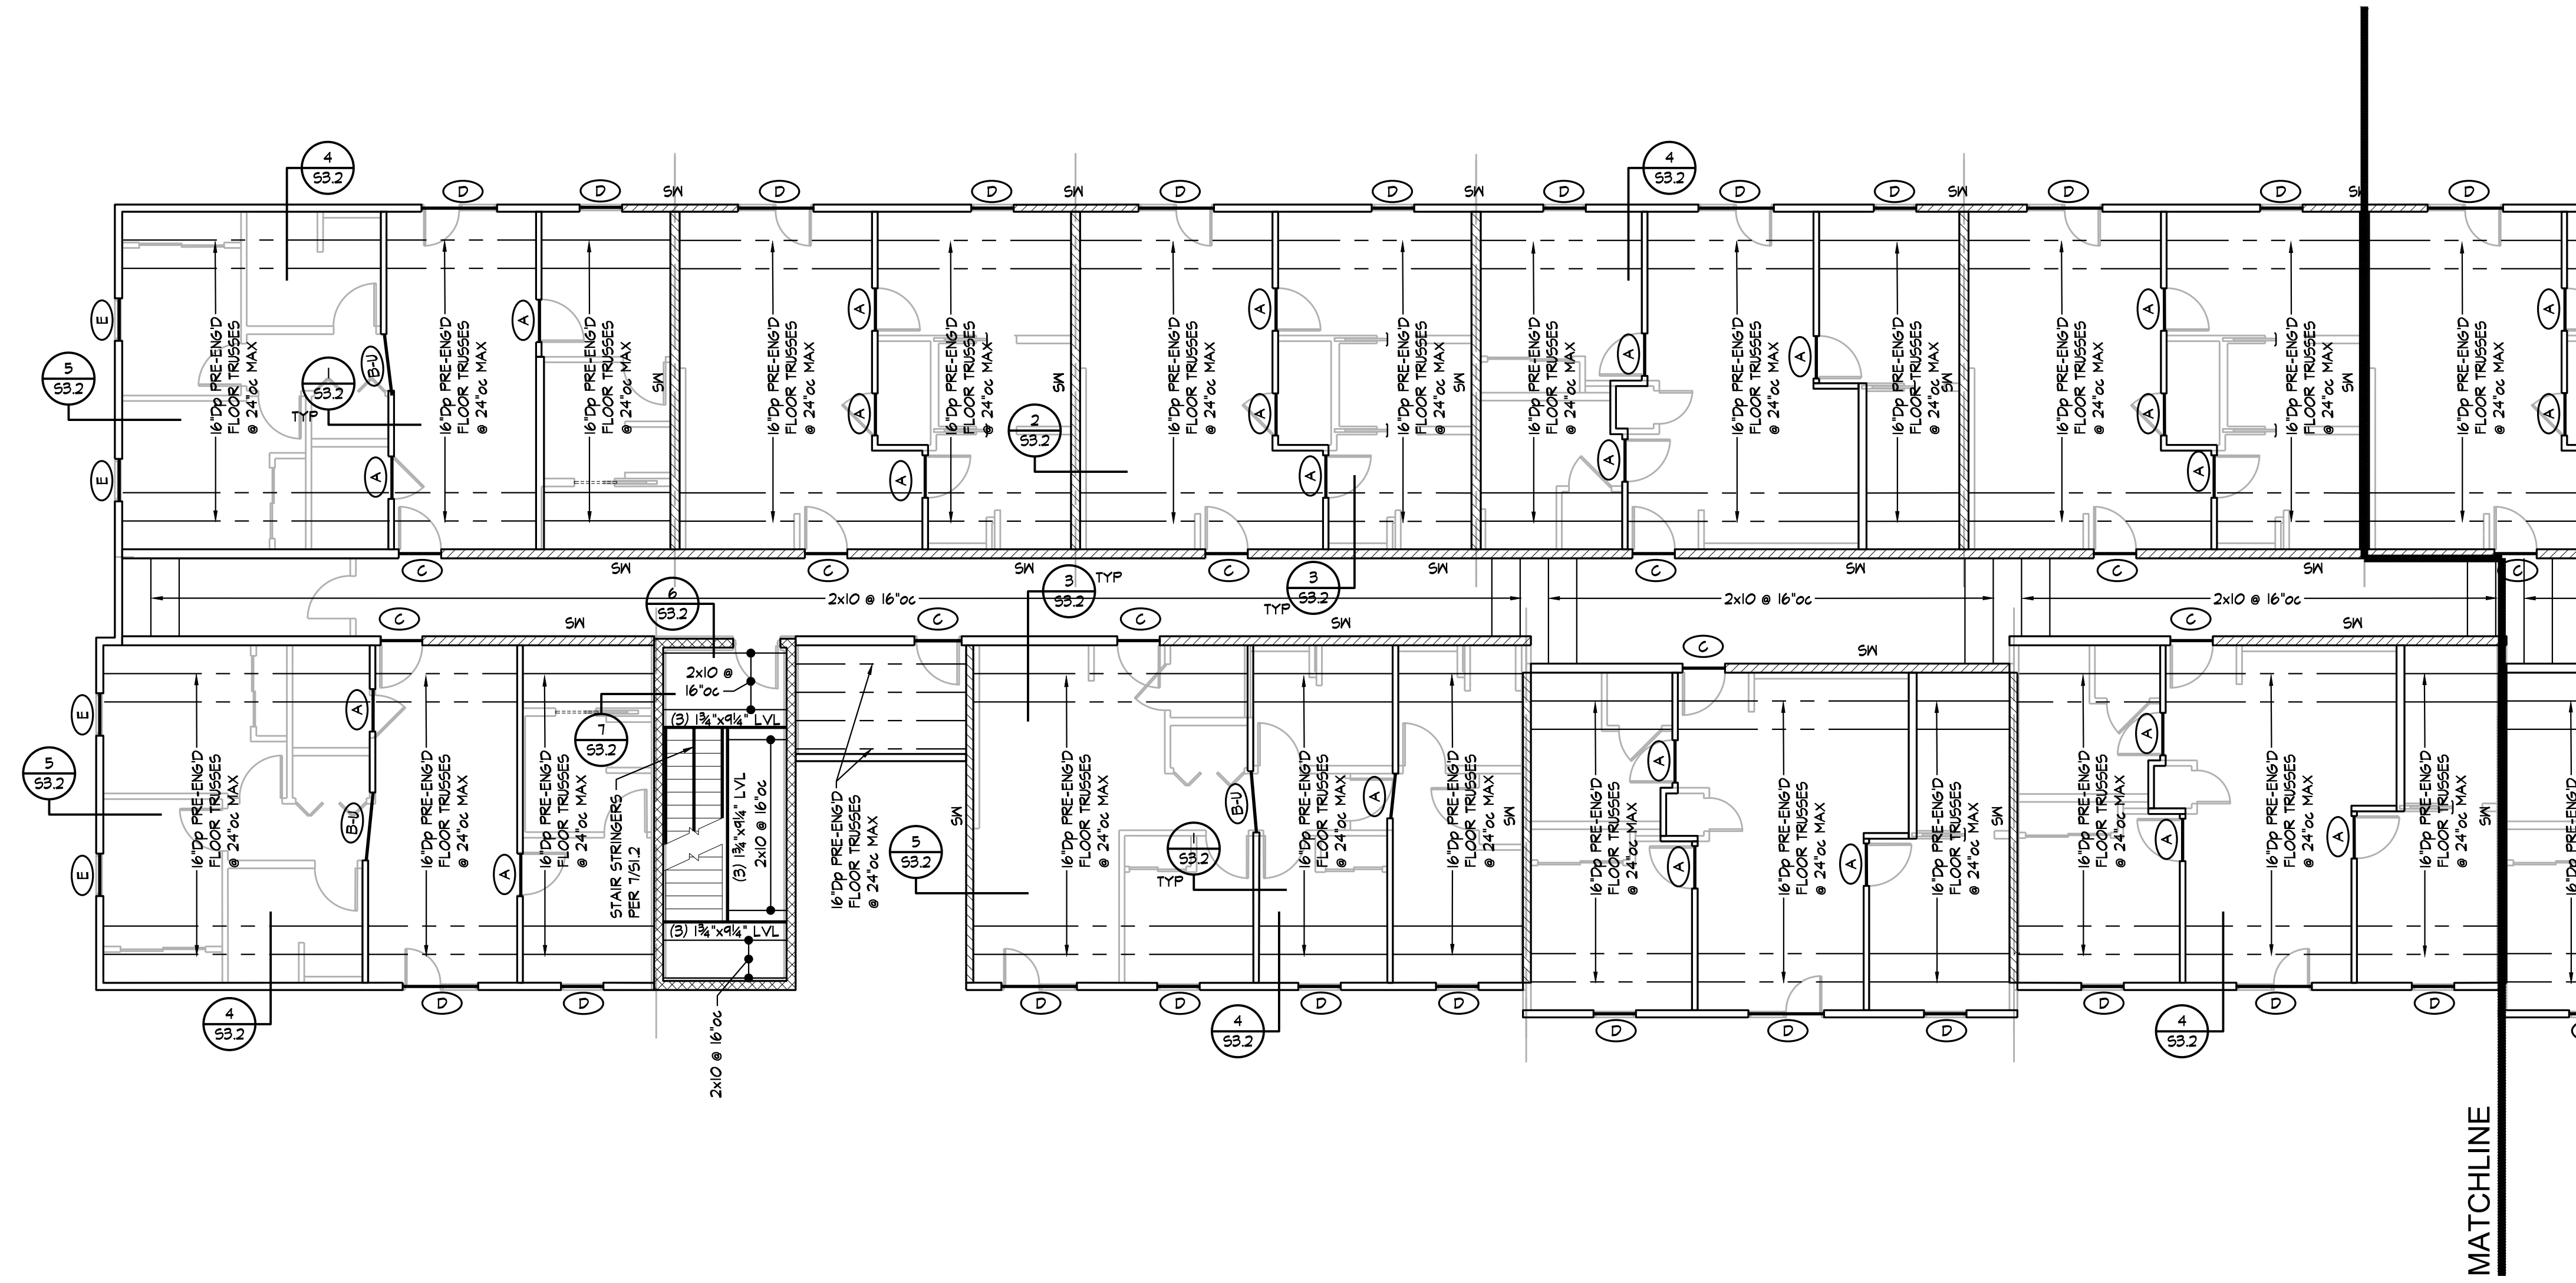

FOURTH FLOOR FRAMING PLAN

1/8" = 1'-0"

- NOTES:
1. REFER TO GENERAL NOTES ON SHEET S01
 2. REFER TO COLUMN & FOOTING SCHEDULE ON SHEET S11
 3. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS NOT SHOWN
 4. REFER TO SHEETS S01 AND S11 FOR TYPICAL NAILING WOOD FRAMING DETAILS
 5. REFER TO SHEARMALL & HOLDOWN SCHEDULES ON SHEET S12
 6. SHEARMALLS/HOLDOWNS DESIGNED AS FOLLOWS:

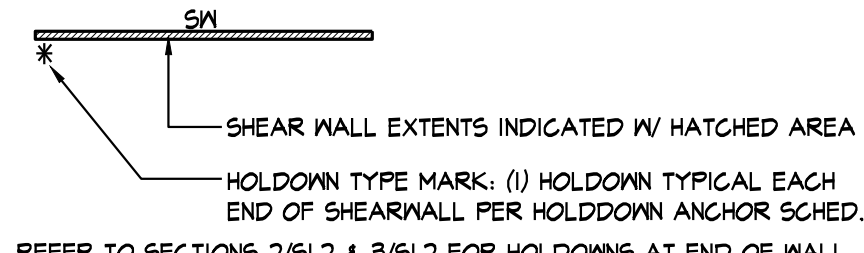

7. REFER TO SECTIONS 2/5/12 & 3/5/12 FOR HOLDOWNS AT END OF WALL

THE RESERVES AT MEADOWS 25

NEW APARTMENTS

GODDARD, KANSAS



REVISION:

DATE: 4-17-2026


JOB: 25-3465

SHEET NO.:

BOB D. CAMPBELL & CO.
 Structural Engineers Since 1957
 4338 Bellevue Ave. 816.531.4144
 Kansas City, MO 64111 www.bdc-engrs.com

S2.4A

COPYRIGHTED ©

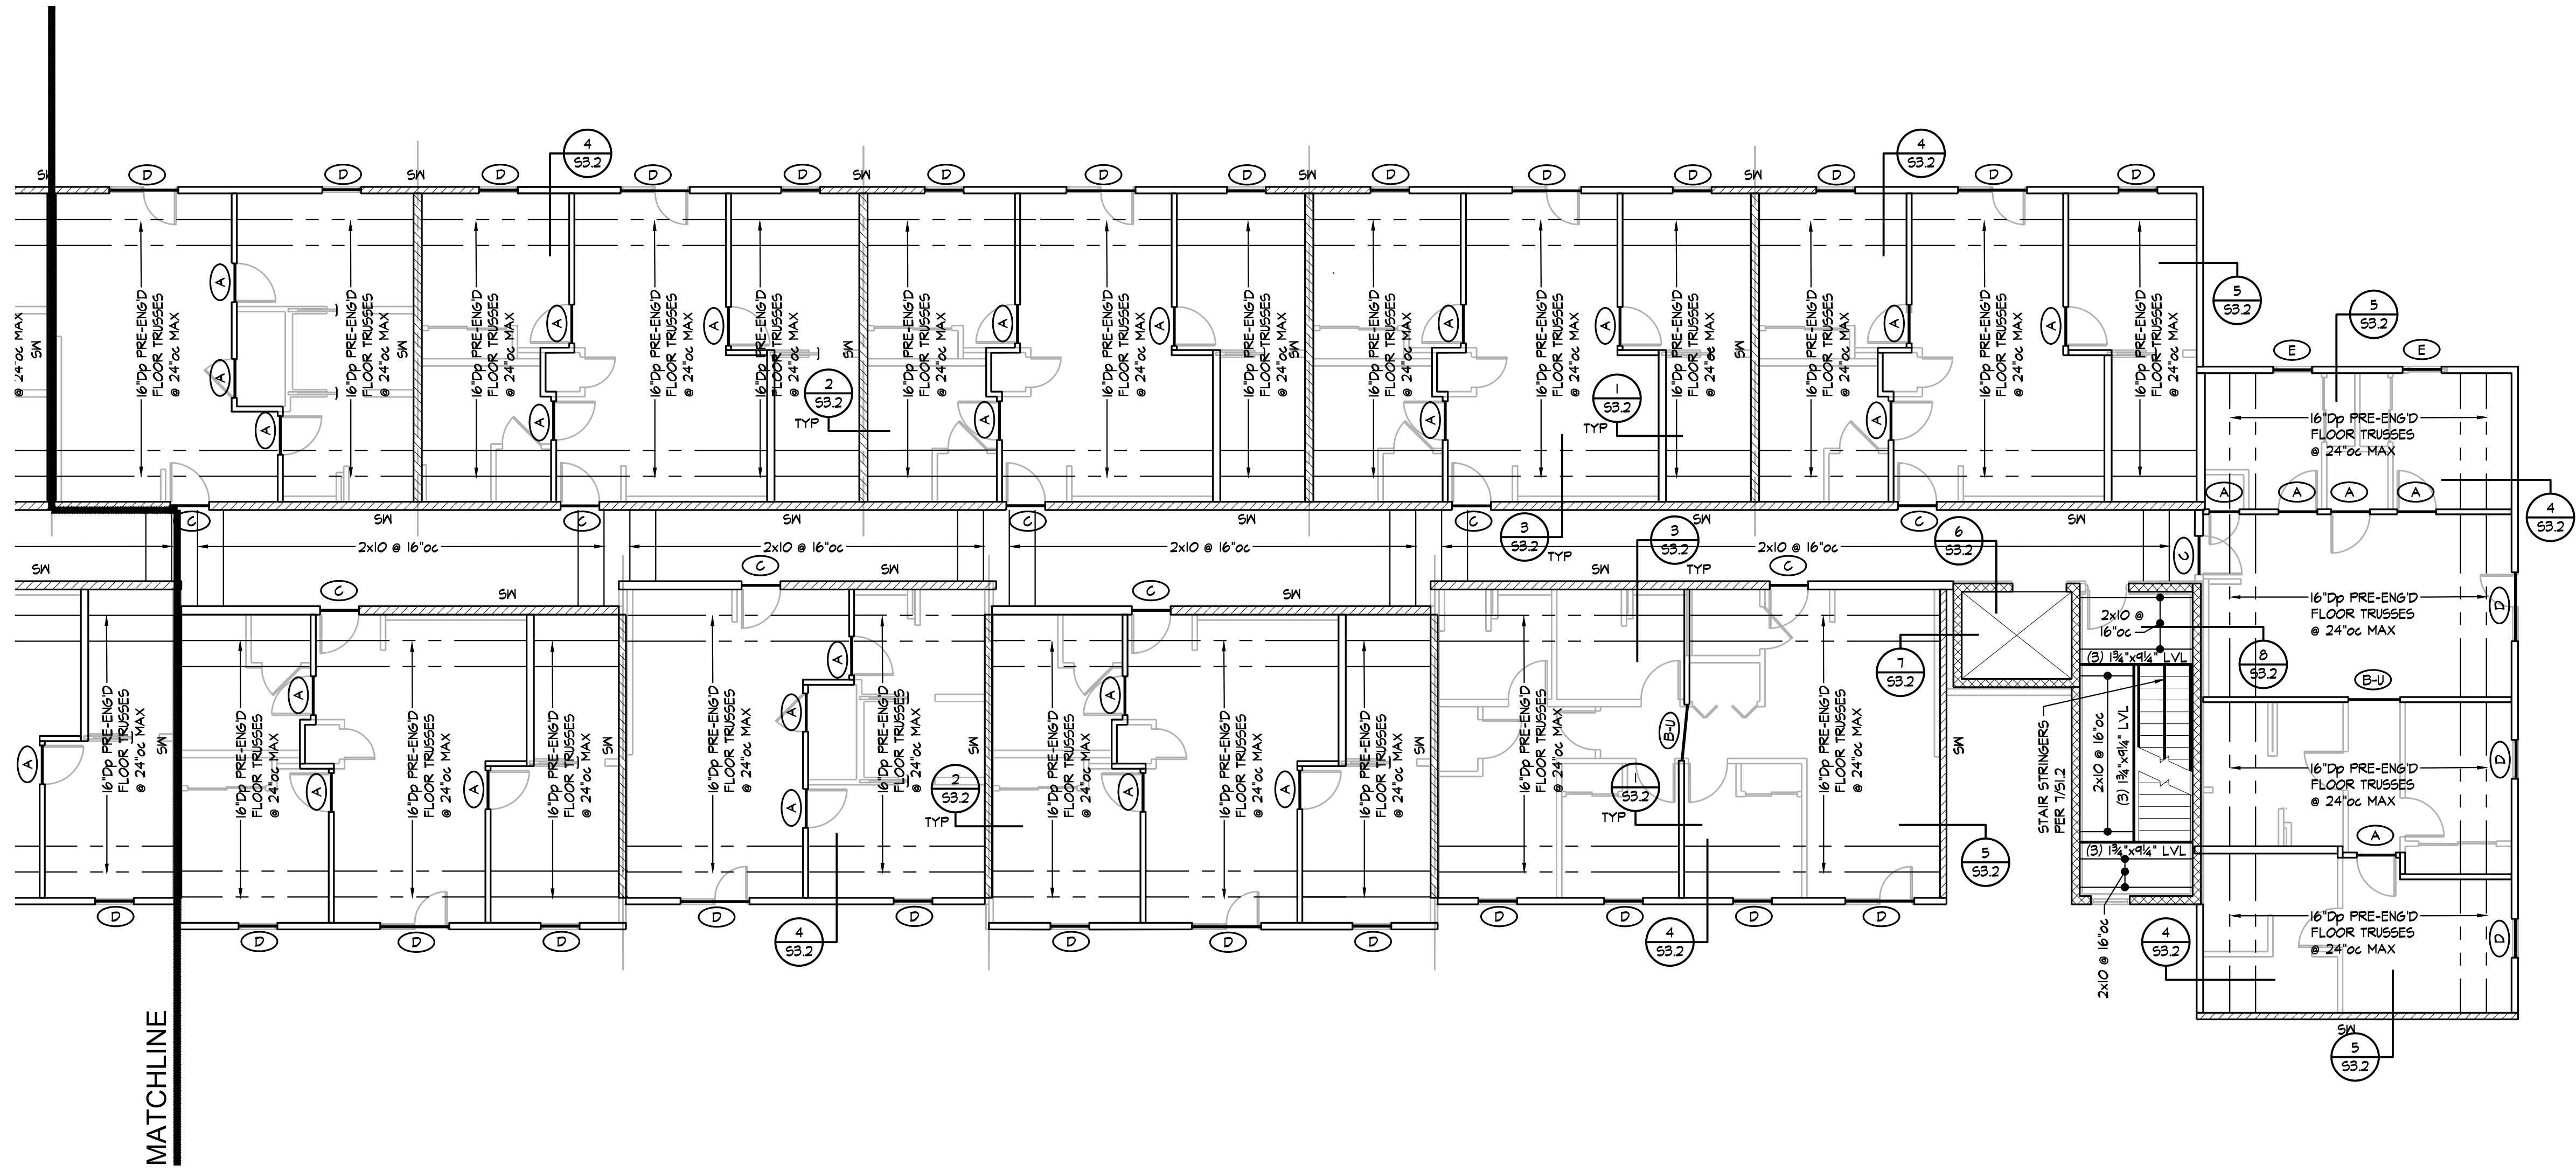


FOURTH FLOOR FRAMING PLAN

1/8" = 1'-0"

NOTES:

1. REFER TO GENERAL NOTES ON SHEET 501
2. REFER TO COLUMN & FOOTING SCHEDULE ON SHEET 511
3. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS NOT SHOWN
4. REFER TO SHEETS 501 AND 511 FOR TYPICAL WALLING WOOD FRAMING DETAILS
5. REFER TO SHEARWALL & HOLDOWN SCHEDULES ON SHEET 512
6. SHEARWALLS/HOLDOWNS DESIGNED AS FOLLOWS:

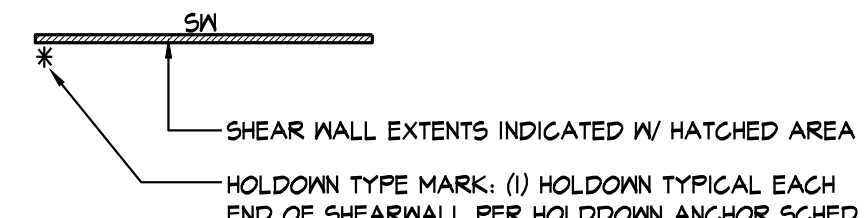

7. REFER TO SECTIONS 2/51.2 & 3/51.2 FOR HOLDOWNS AT END OF WALL

THE RESERVES AT MEADOWS 25

NEW APARTMENTS

GODDARD, KANSAS



REVISION:


DATE: 4-17-2026

JOB: 25-3465

SHEET NO.:

BOB D. CAMPBELL & CO.
 Structural Engineers Since 1957
 4338 Belleview Ave. 816.531.4144
 Kansas City, MO 64111 www.bdc-engrs.com

S2.4B

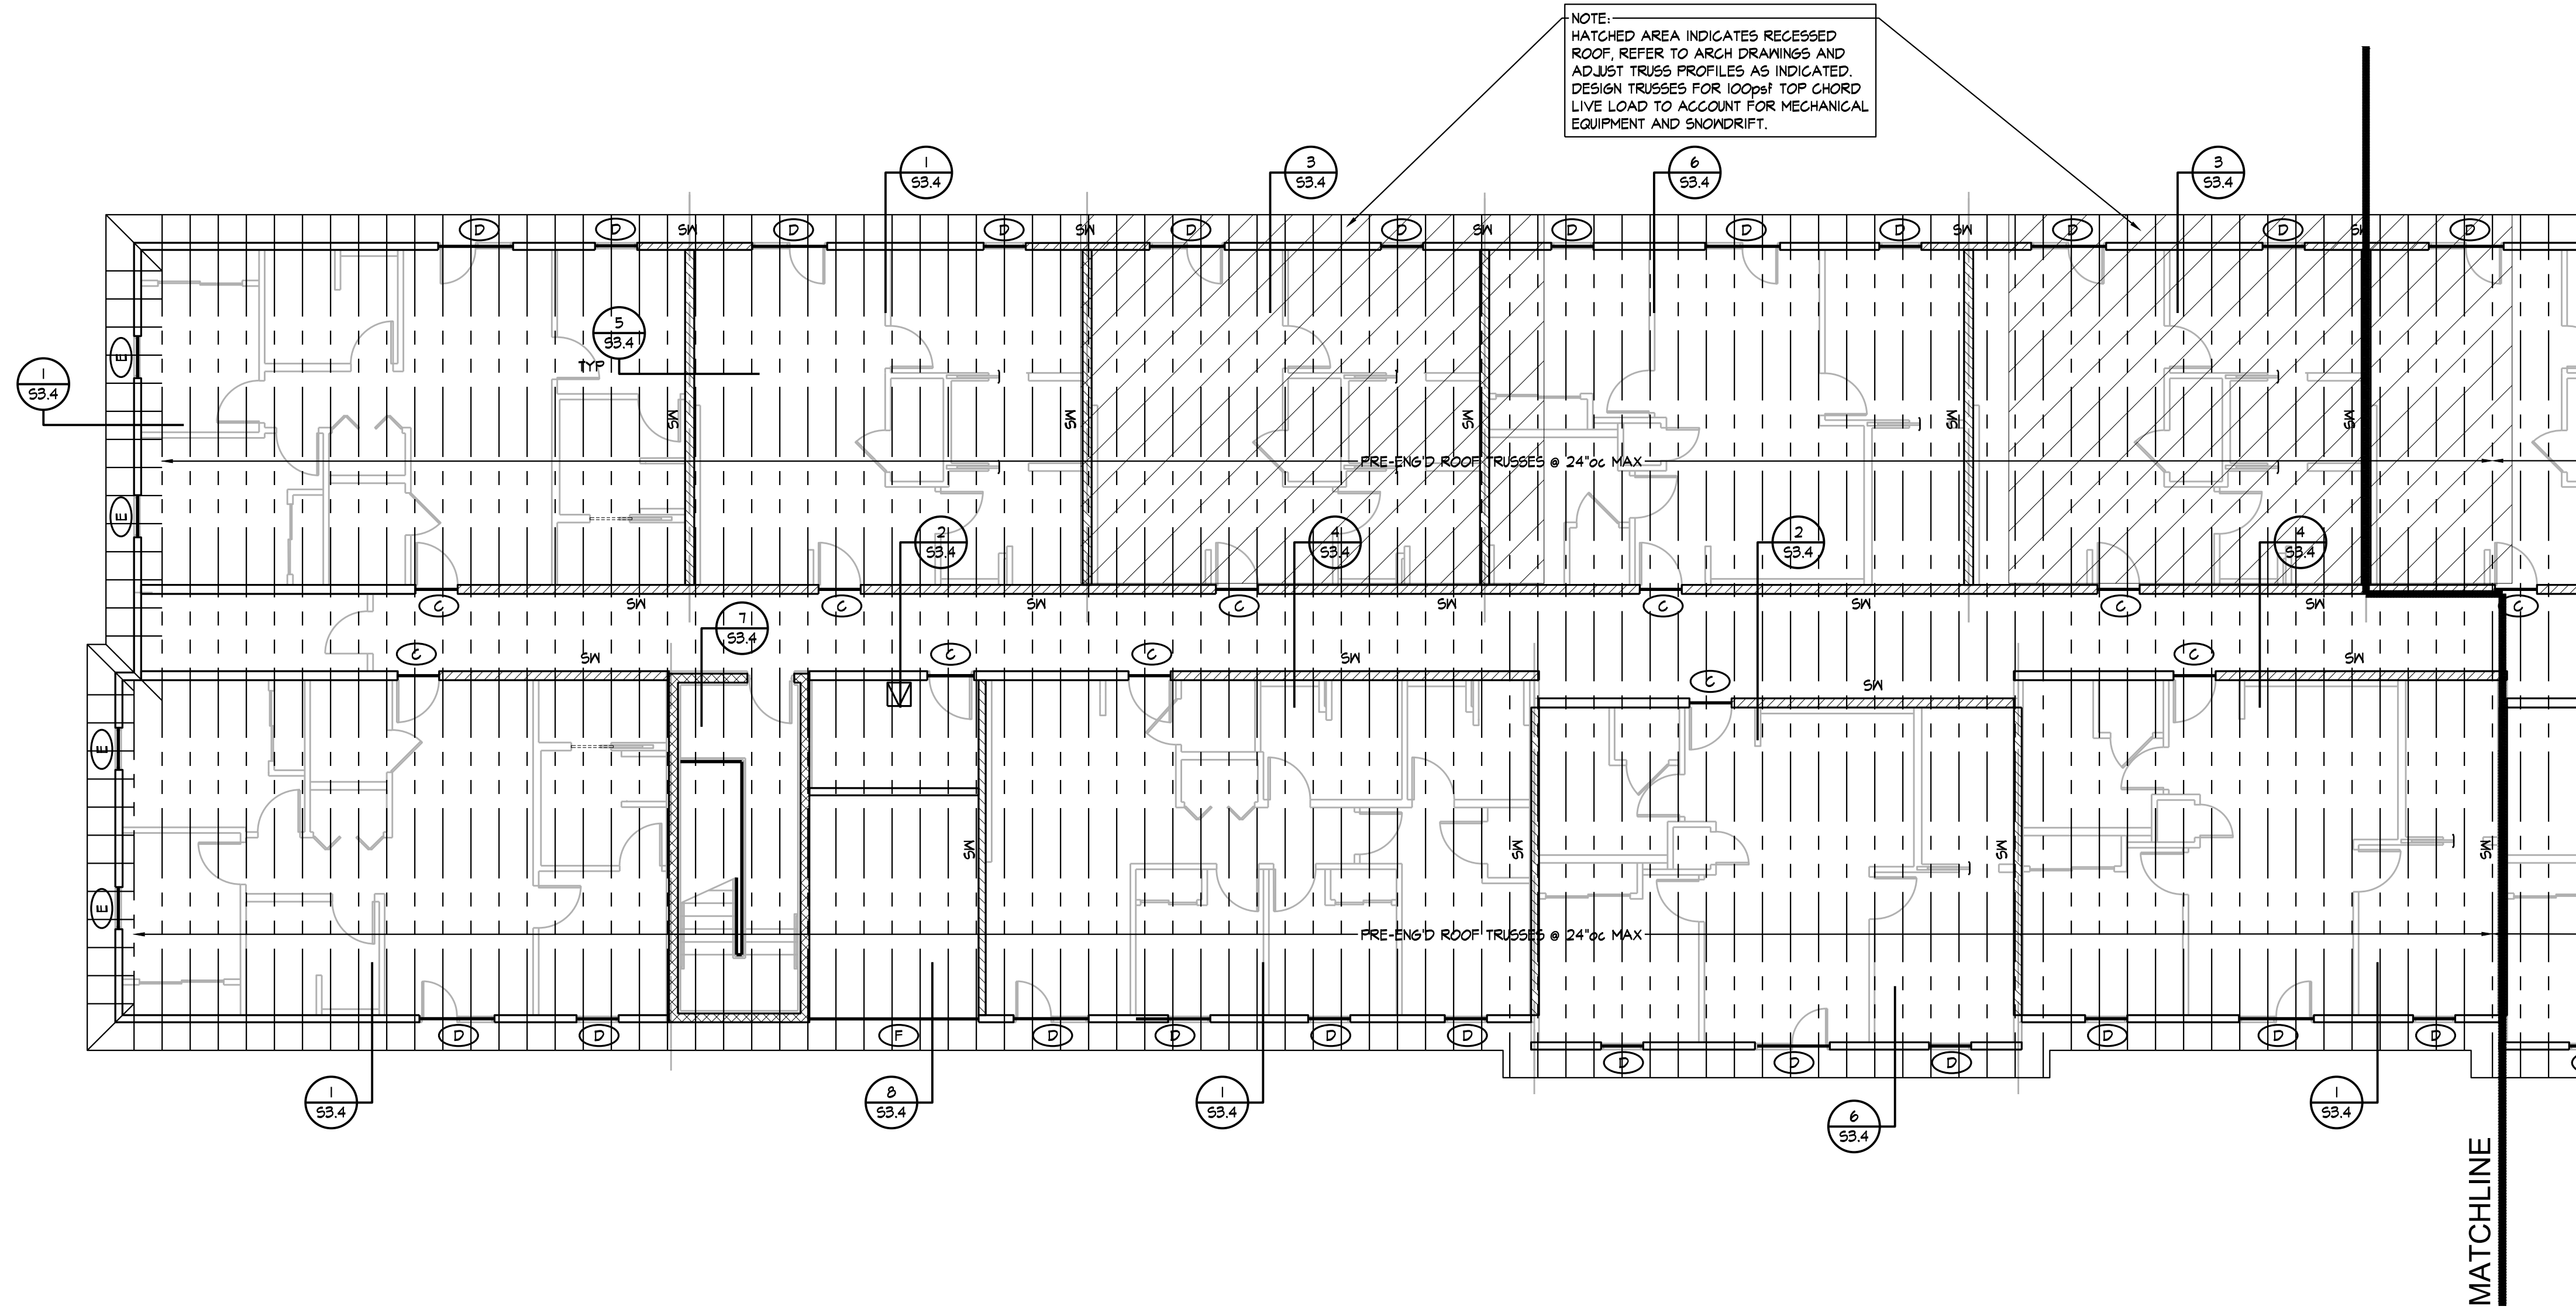


NOTE:
 HATCHED AREA INDICATES RECESSED
 ROOF. REFER TO ARCH DRAWINGS AND
 ADJUST TRUSS PROFILES AS INDICATED.
 DESIGN TRUSSES FOR 100psf TOP CHORD
 LIVE LOAD TO ACCOUNT FOR MECHANICAL
 EQUIPMENT AND SNOWDRIFT.

ROOF FRAMING PLAN

1/8" = 1'-0"

NOTES:

1. REFER TO GENERAL NOTES ON SHEET S01
2. REFER TO COLUMN & FOOTING SCHEDULE ON SHEET S11
3. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS NOT SHOWN
4. REFER TO SHEETS S01 AND S11 FOR TYPICAL WALLING WOOD FRAMING DETAILS
5. REFER TO SHEARWALL & HOLDDOWN SCHEDULES ON SHEET S12
6. SHEARWALLS/HOLDDOWNS DESIGNED AS FOLLOWS:

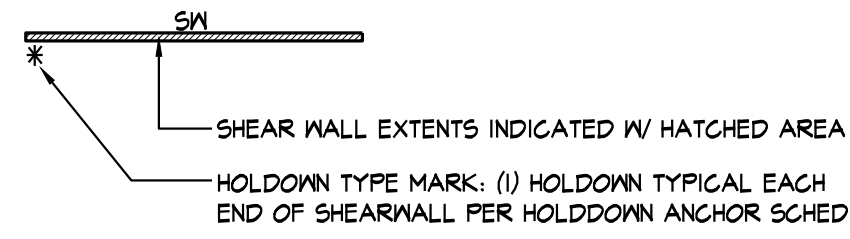

7. REFER TO SECTIONS 2/S12 & 3/S12 FOR HOLDDOWNS AT END OF WALL

THE RESERVES AT MEADOWS 25
 NEW APARTMENTS
 GODDARD, KANSAS



REVISION:

DATE: 4-17-2026


JOB: 25-3465

SHEET NO.:

BOB D. CAMPBELL & CO.
 Structural Engineers Since 1957
 4338 Belleview Ave. 816.531.4144
 Kansas City, MO 64111 www.bdc-engrs.com


S2.5A

COPYRIGHTED ©

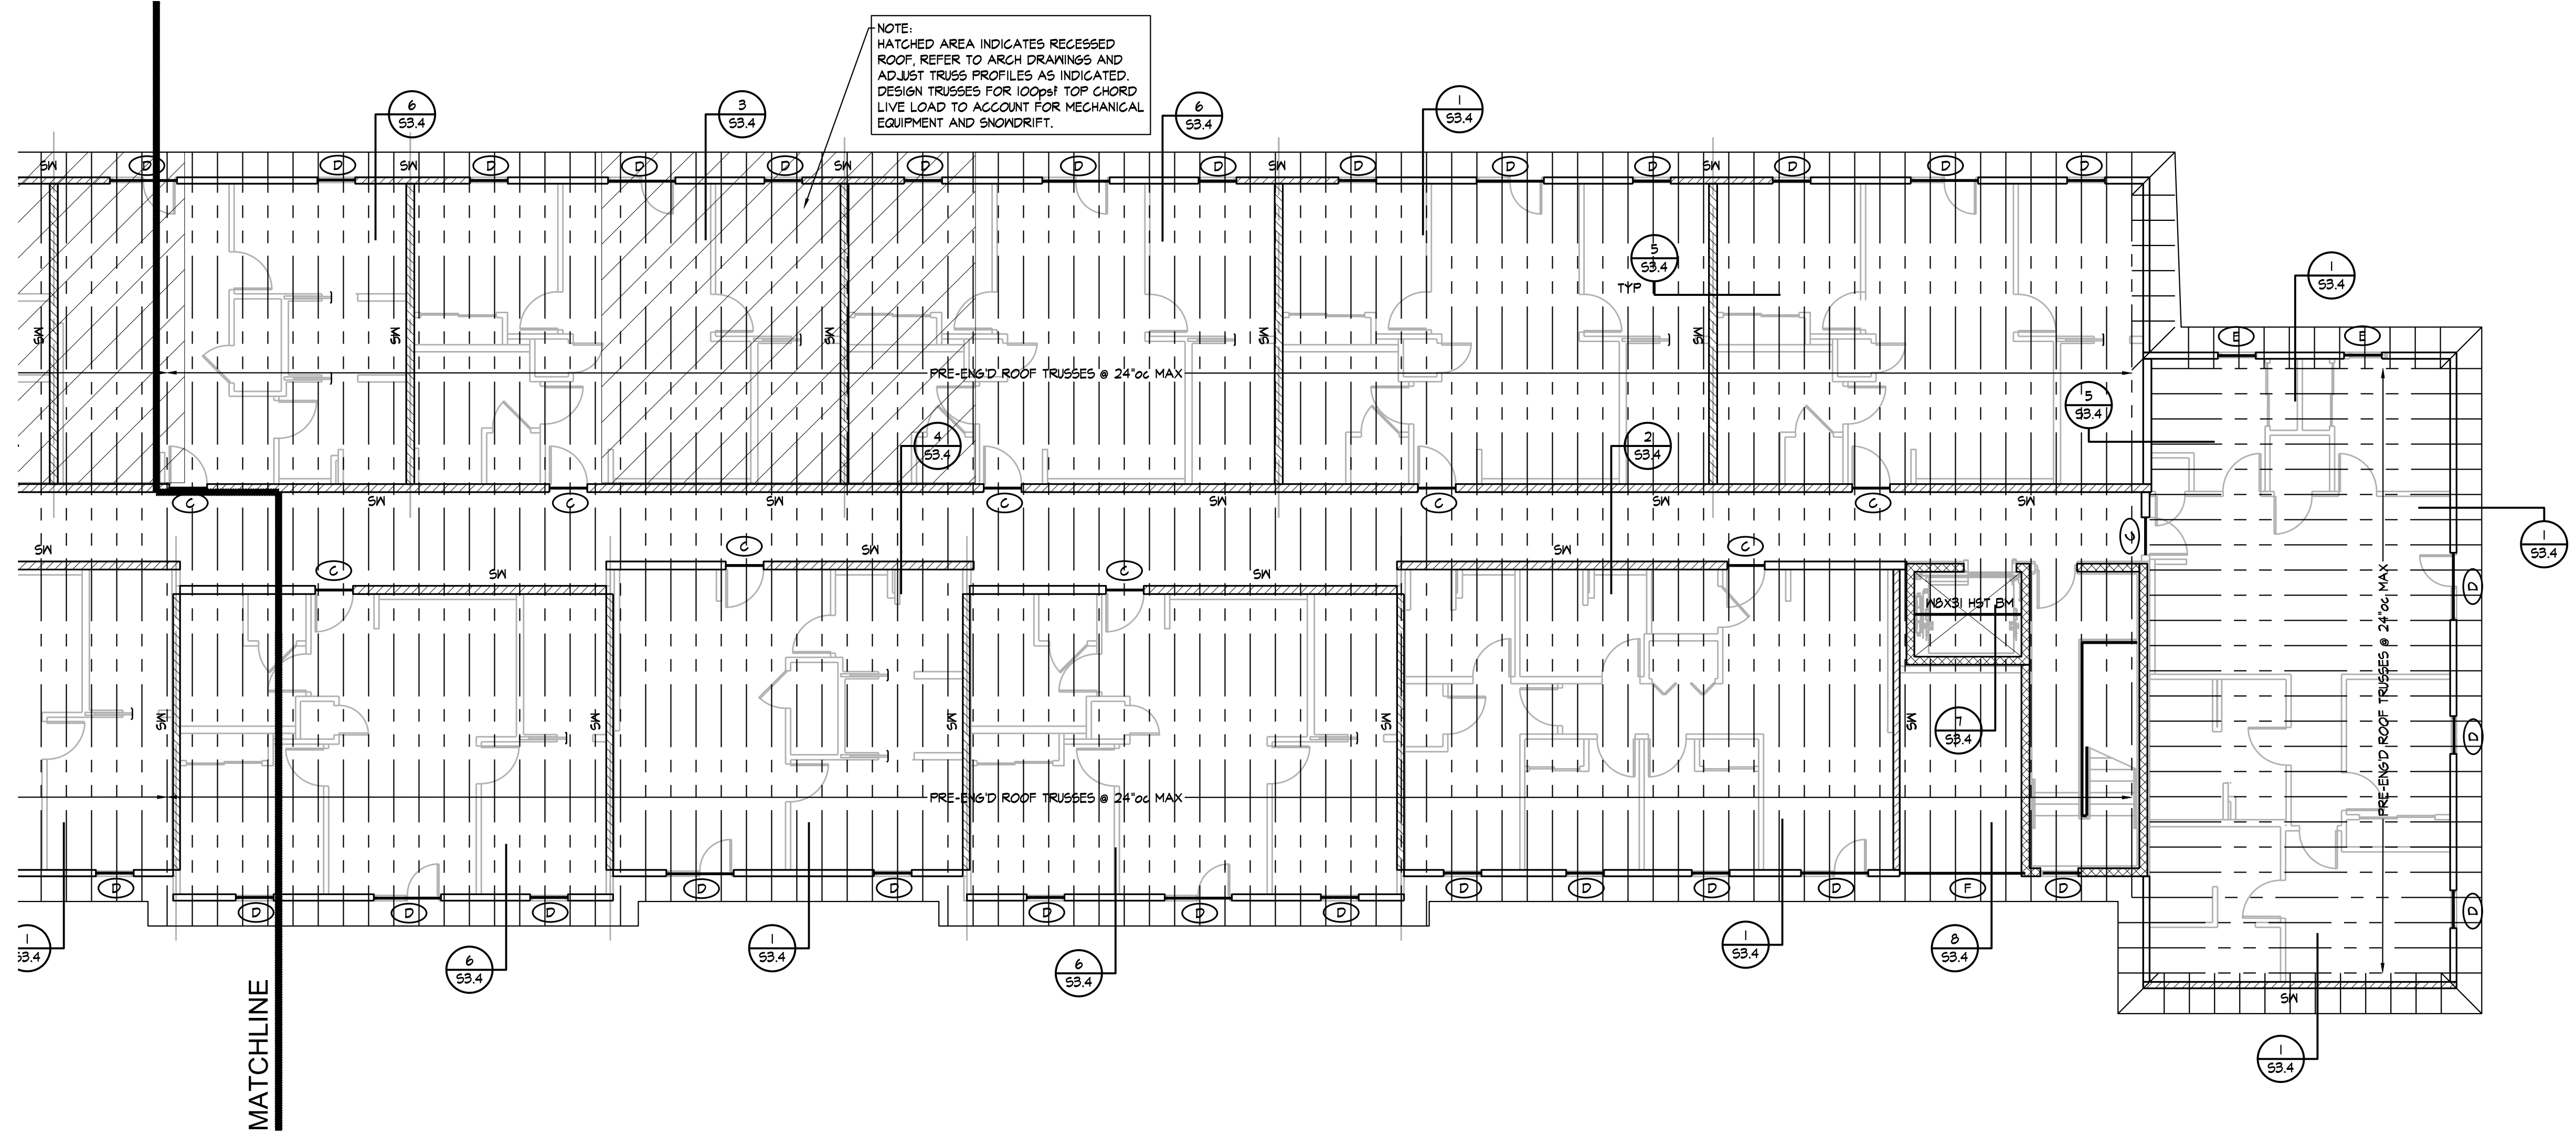

ROOF FRAMING PLAN
1/8" = 1'-0"

- NOTES:
1. REFER TO GENERAL NOTES ON SHEET S01
 2. REFER TO COLUMN & FOOTING SCHEDULE ON SHEET S11
 3. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS NOT SHOWN
 4. REFER TO SHEETS S01 AND S11 FOR TYPICAL NAILING WOOD FRAMING DETAILS
 5. REFER TO SHEARWALL & HOLDDOWN SCHEDULES ON SHEET S12
 6. SHEARWALLS/HOLDDOWNS DESIGNED AS FOLLOWS:

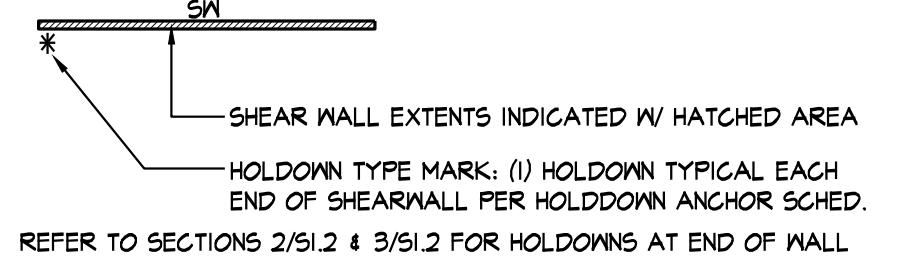

REVISION:

DATE:	4-17-2026
JOB:	25-3465
SHEET NO.:	




2 SHEARWALL PLAN

1/8" = 1'-0"

NOTES:


1. REFER TO GENERAL NOTES ON SHEET S01
2. REFER TO COLUMN & FOOTING SCHEDULE ON SHEET S11
3. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS NOT SHOWN
4. REFER TO SHEETS S01 AND S11 FOR TYPICAL NAILING WOOD FRAMING DETAILS
5. REFER TO SHEARWALL & HOLDOWN SCHEDULES ON SHEET S12
6. SHEARWALLS/HOLDOWNS DESIGNED AS FOLLOWS:

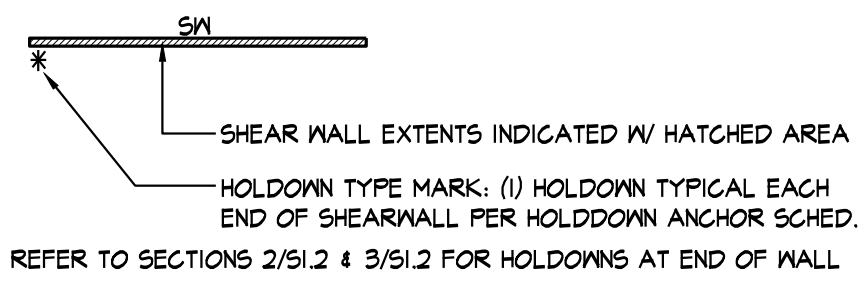

1. REFER TO SECTIONS 2/S1.2 & 3/S1.2 FOR HOLDOWNS AT END OF WALL



REVISION:	
DATE:	4-17-2026
JOB:	25-3465
SHEET NO.:	

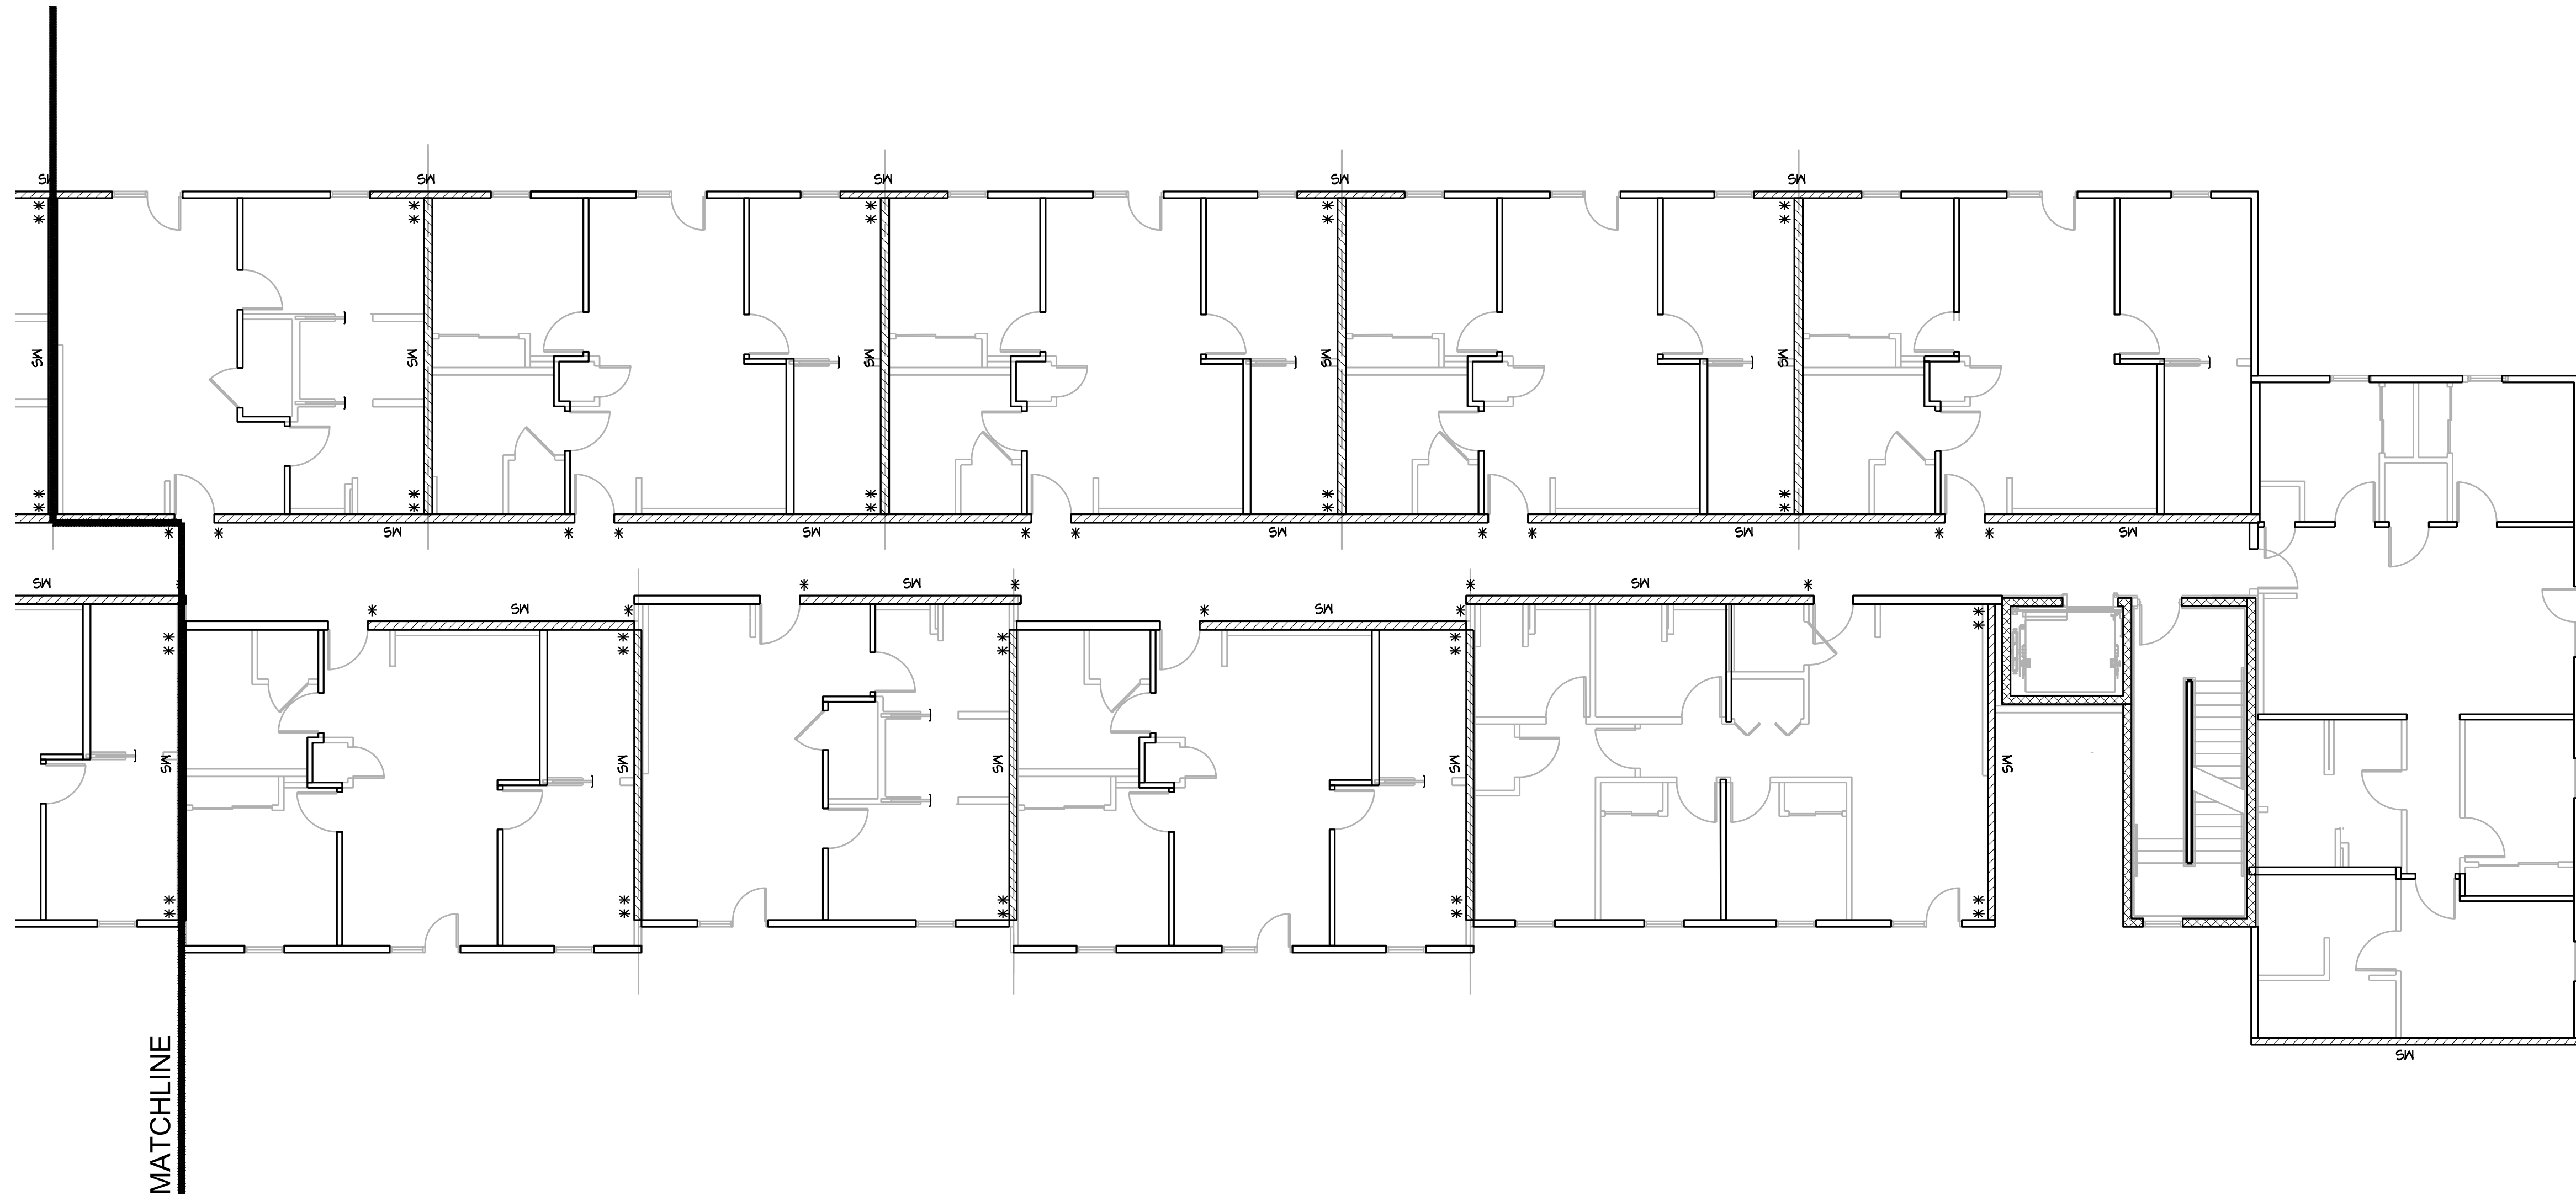


SHEARWALL PLAN

1/8" = 1'-0"

NOTES:

1. REFER TO GENERAL NOTES ON SHEET S01
2. REFER TO COLUMN & FOOTING SCHEDULE ON SHEET S11
3. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS NOT SHOWN
4. REFER TO SHEETS S01 AND S11 FOR TYPICAL NAILING WOOD FRAMING DETAILS
5. REFER TO SHEARWALL & HOLDOWN SCHEDULES ON SHEET S12
6. SHEARWALLS/HOLDOWNS DESIGNED AS FOLLOWS:

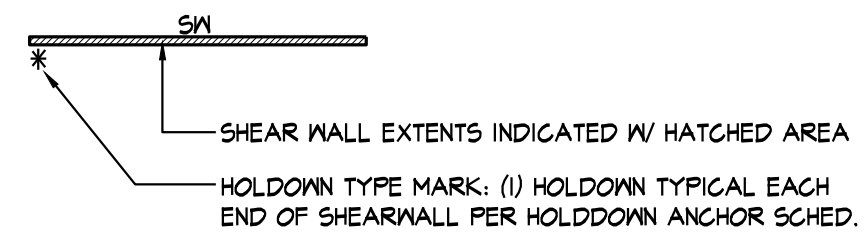

7. REFER TO SECTIONS 2/S1.2 & 3/S1.2 FOR HOLDOWNS AT END OF WALL

THE RESERVES AT MEADOWS 25
NEW APARTMENTS
GODDARD, KANSAS



REVISION:

DATE: 4-17-2026

JOB: 25-3465

SHEET NO.:

BOB D. CAMPBELL & CO.
 Structural Engineers Since 1957
 4338 Belleview Ave. 816.531.4144
 Kansas City, MO 64111 www.bdc-engrs.com



















S2.6B


COPYRIGHTED ©




REVISION:

DATE:	4-17-2026
JOB:	25-3465
SHEET NO.:	

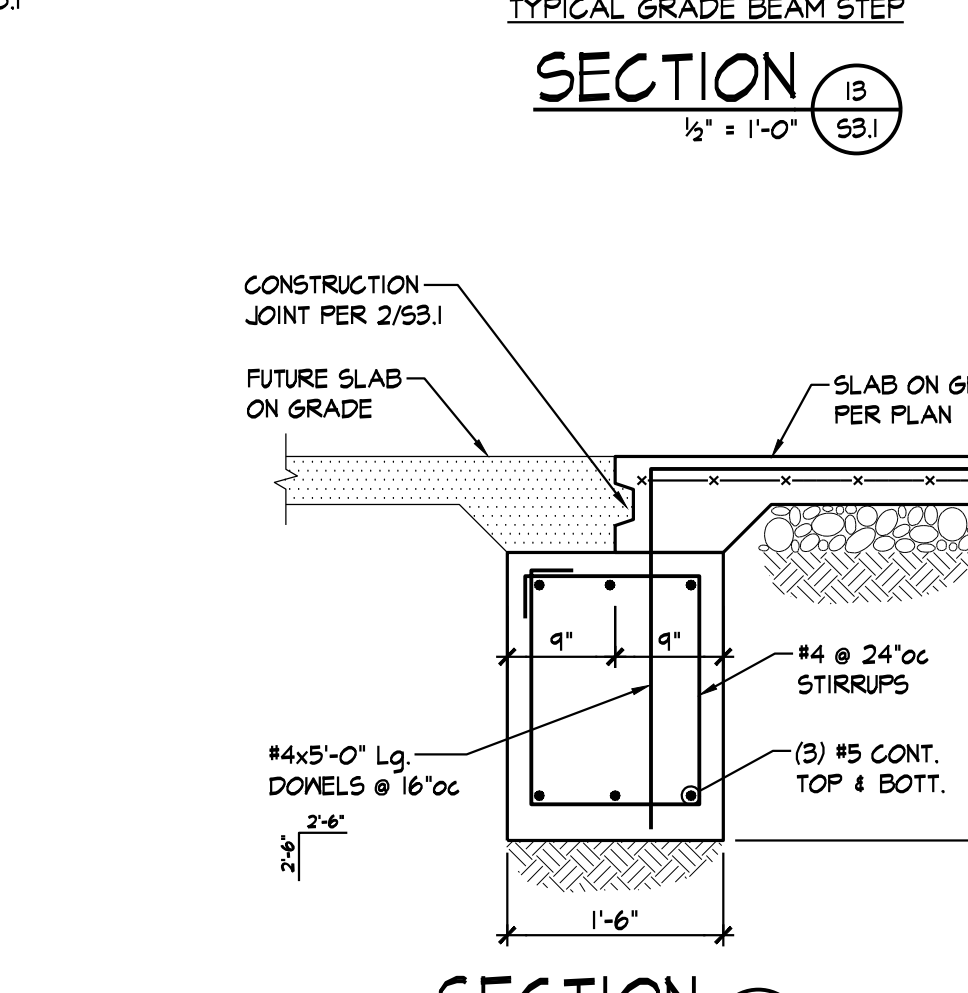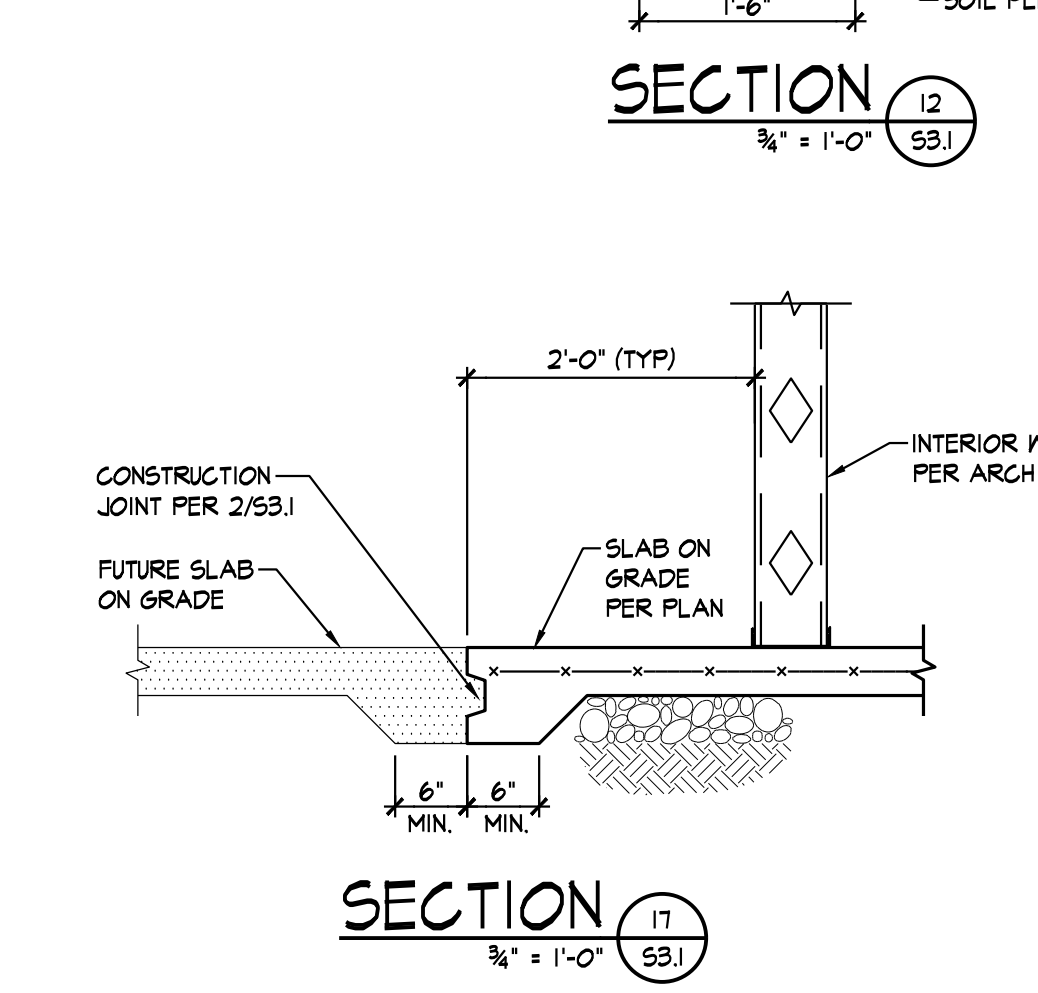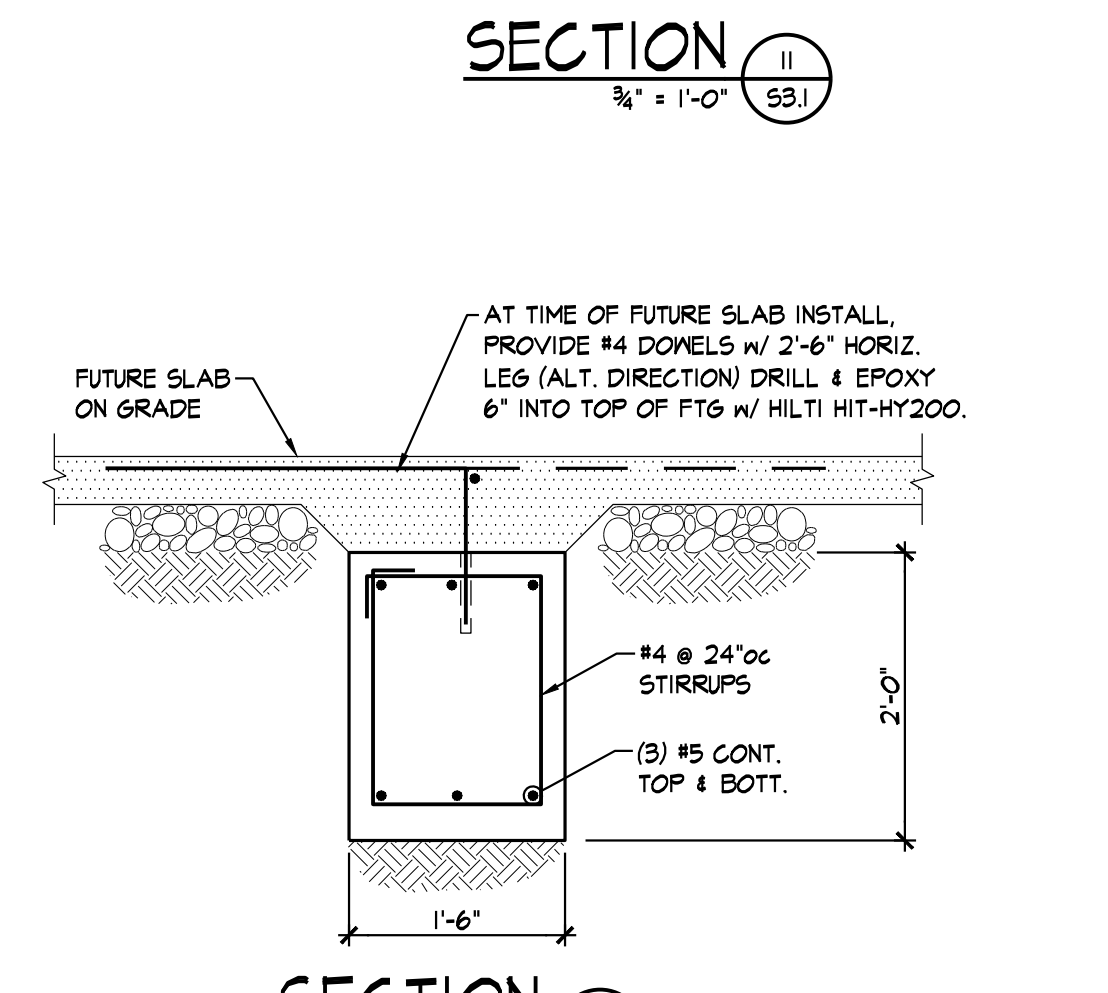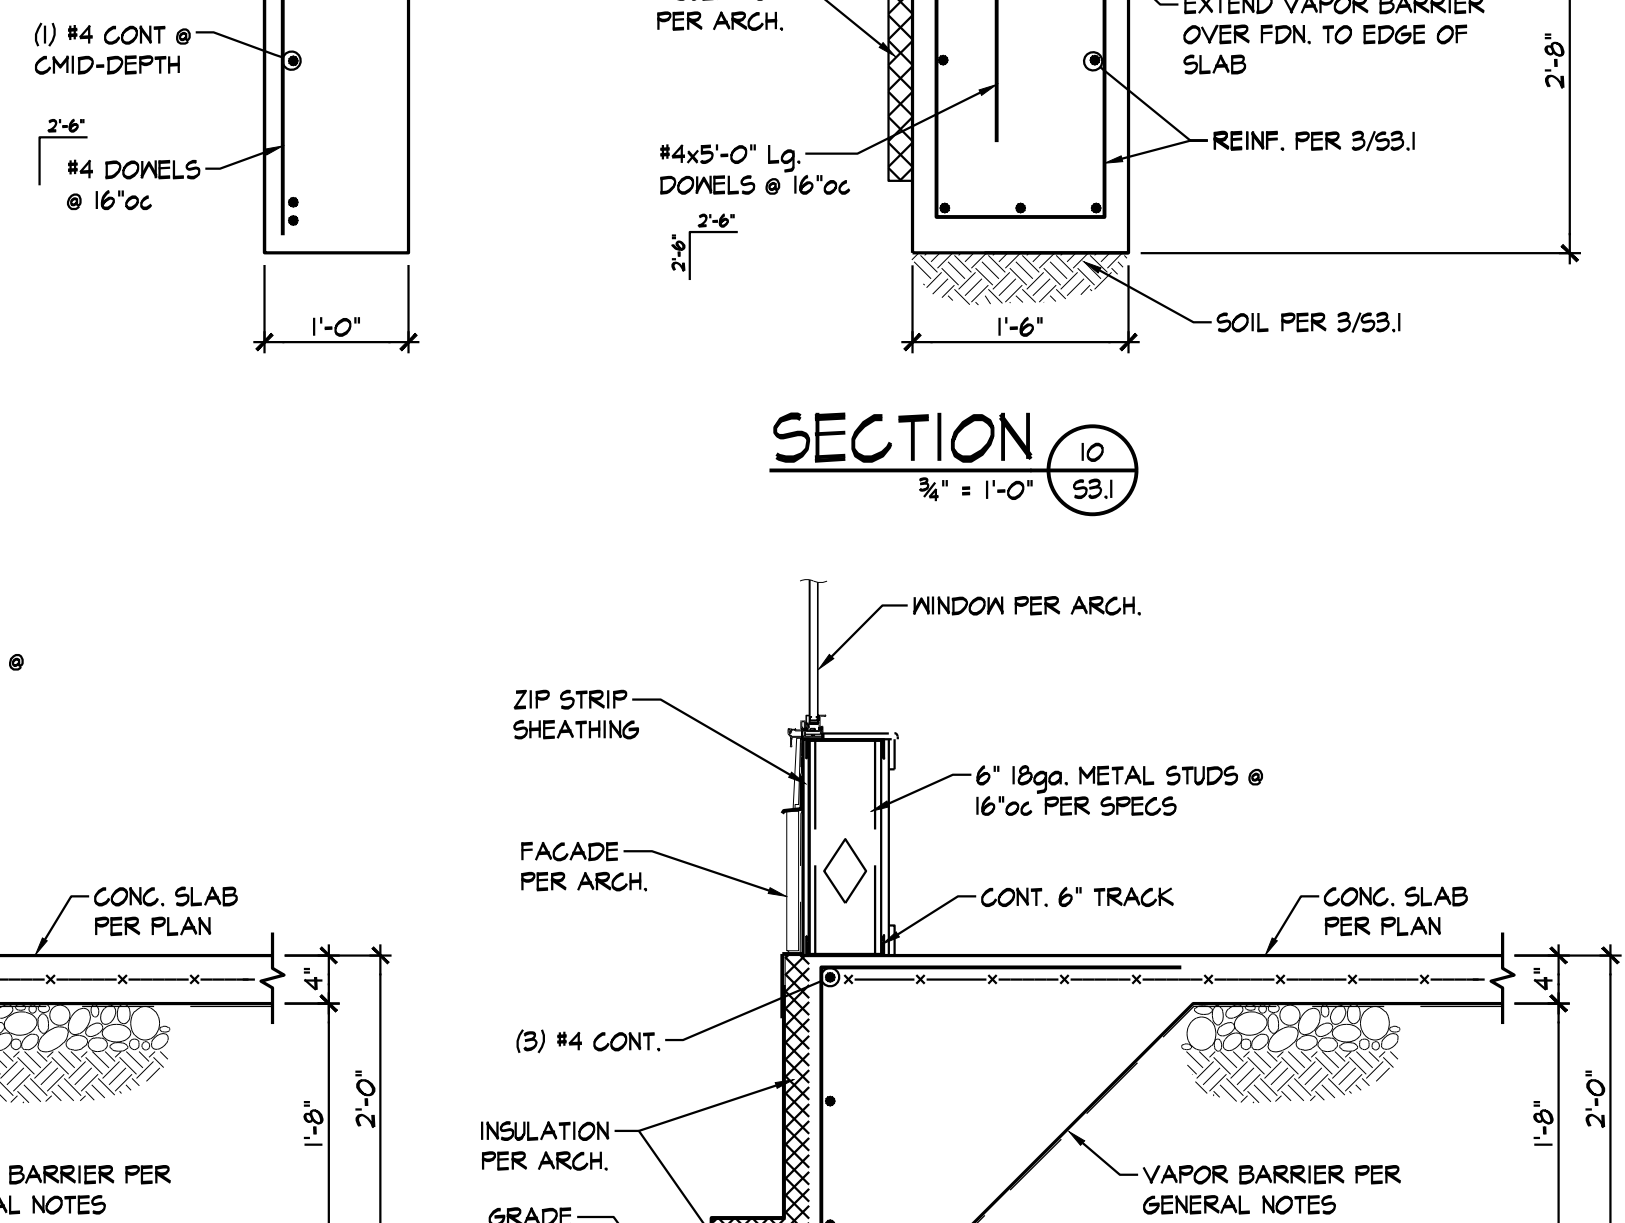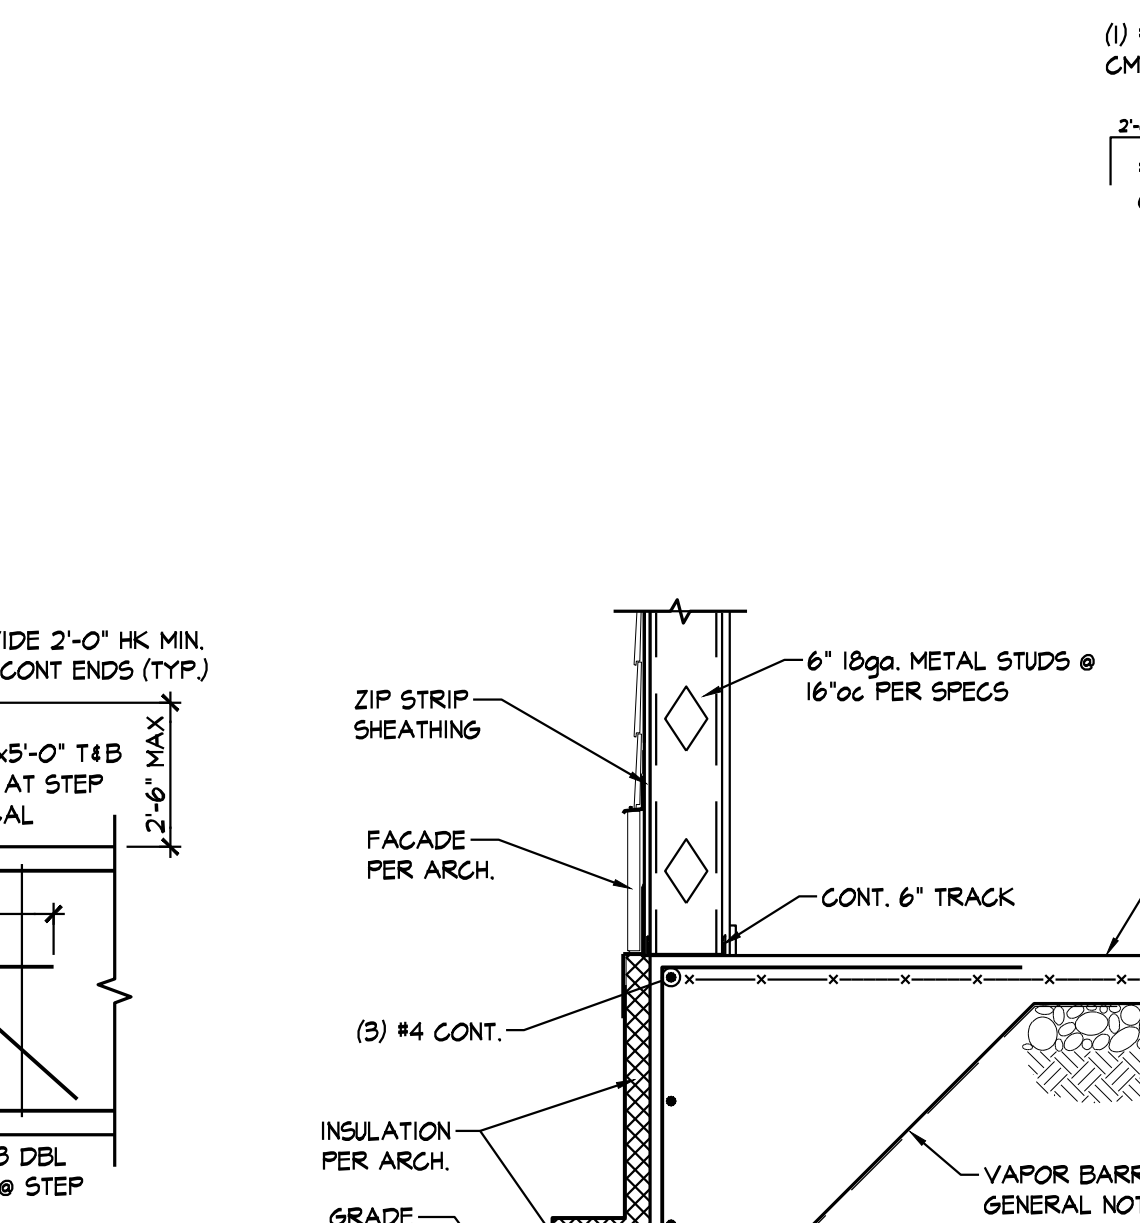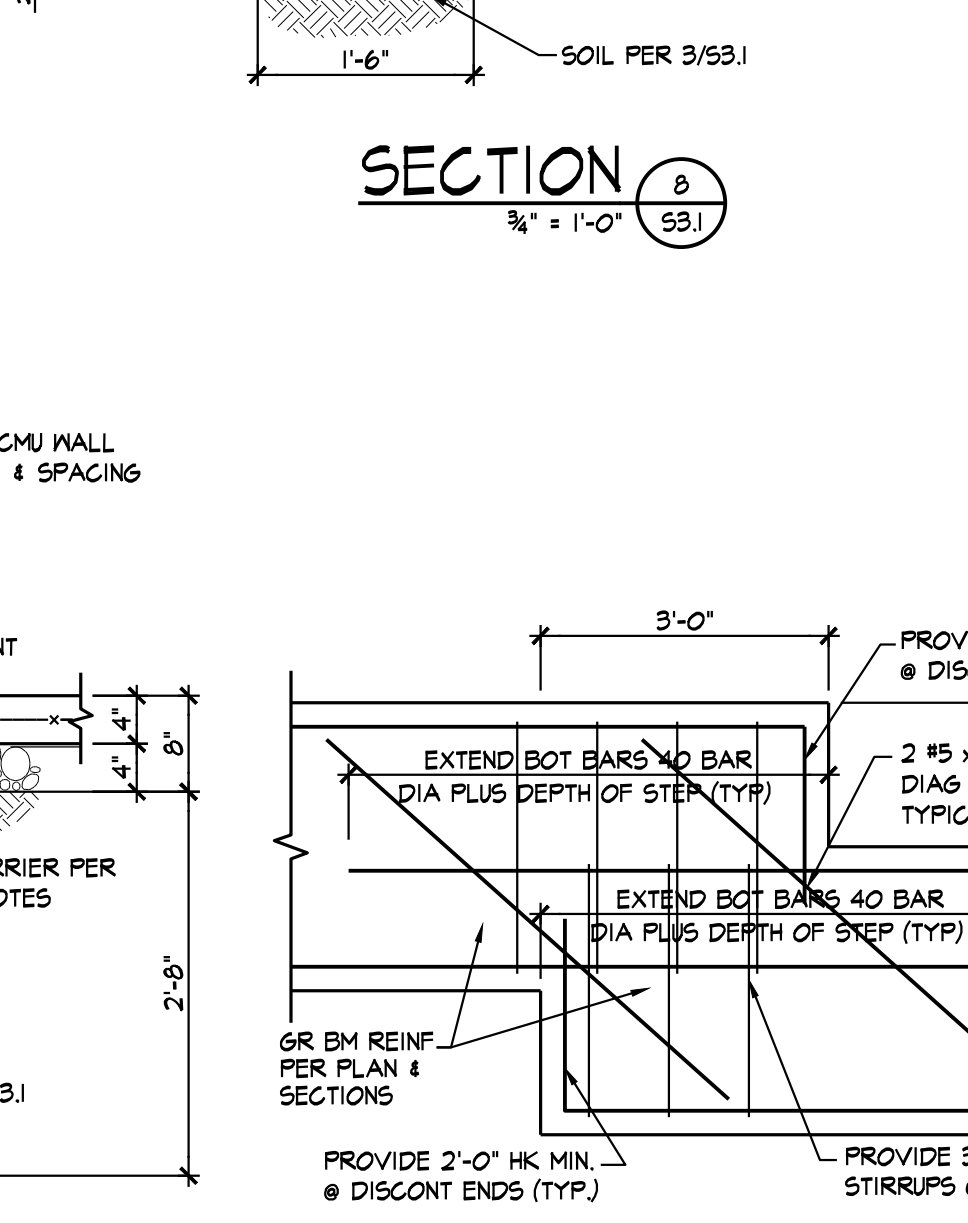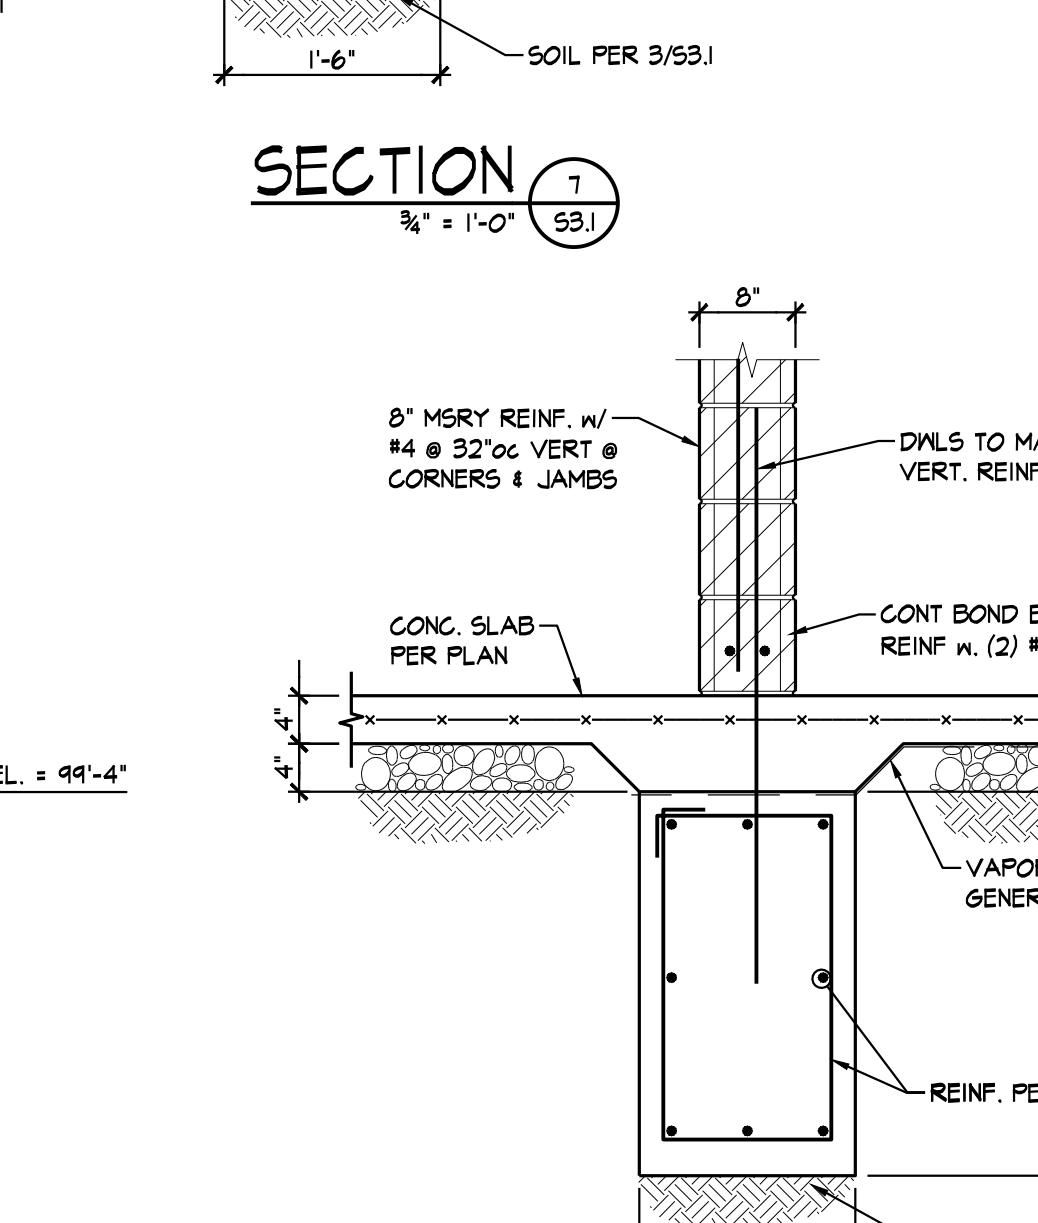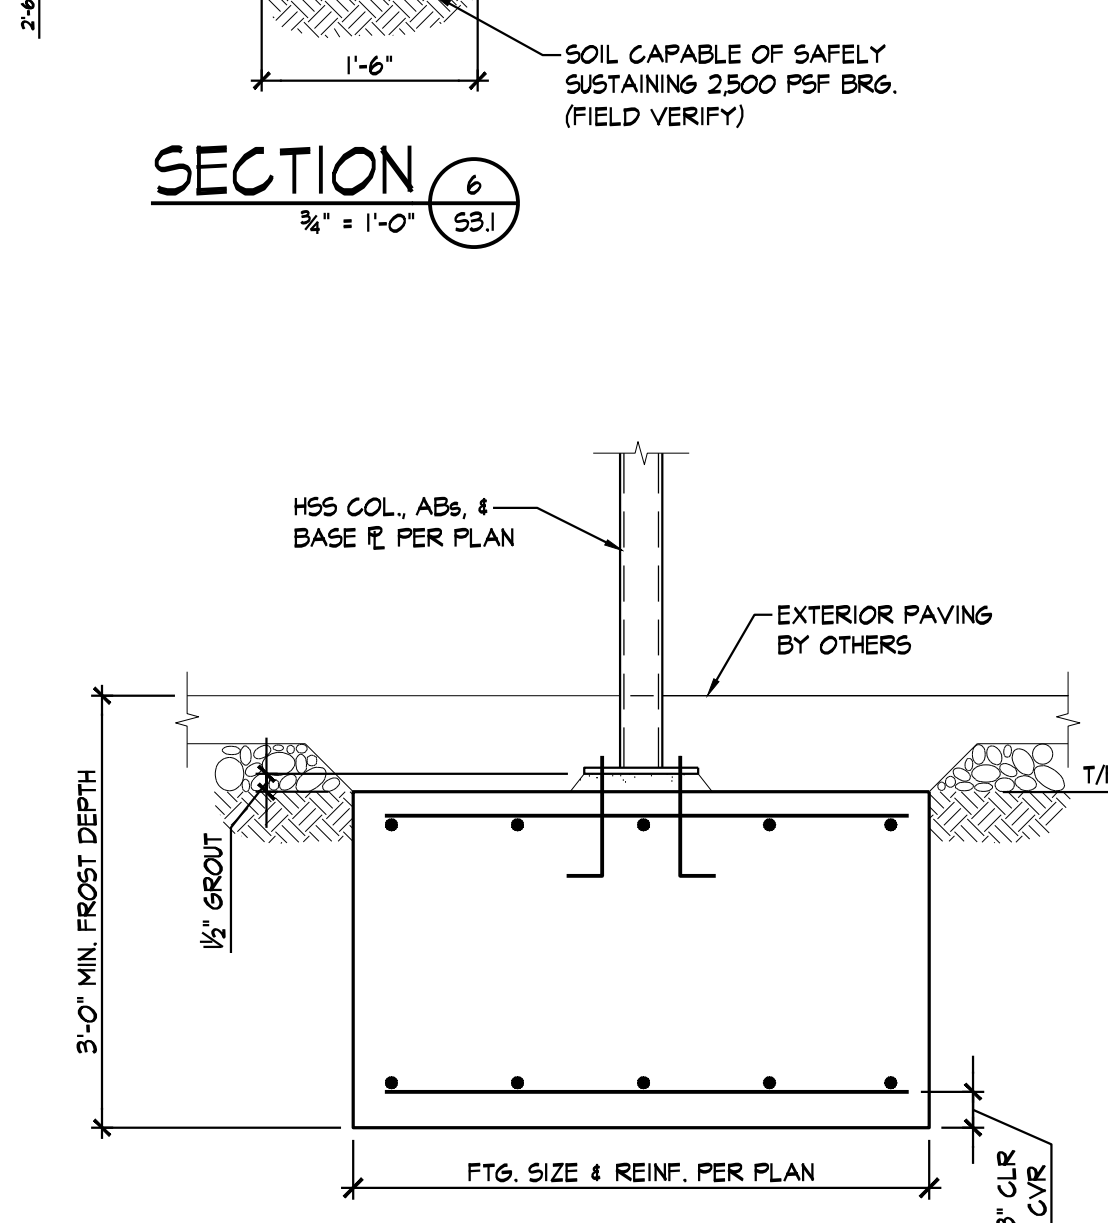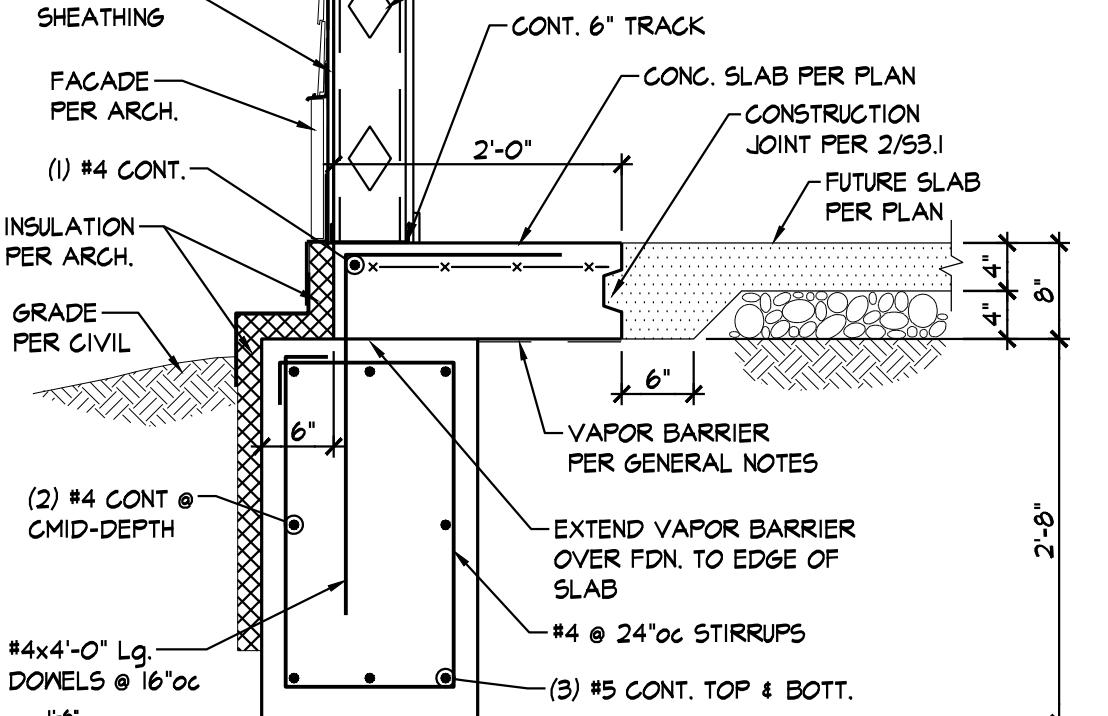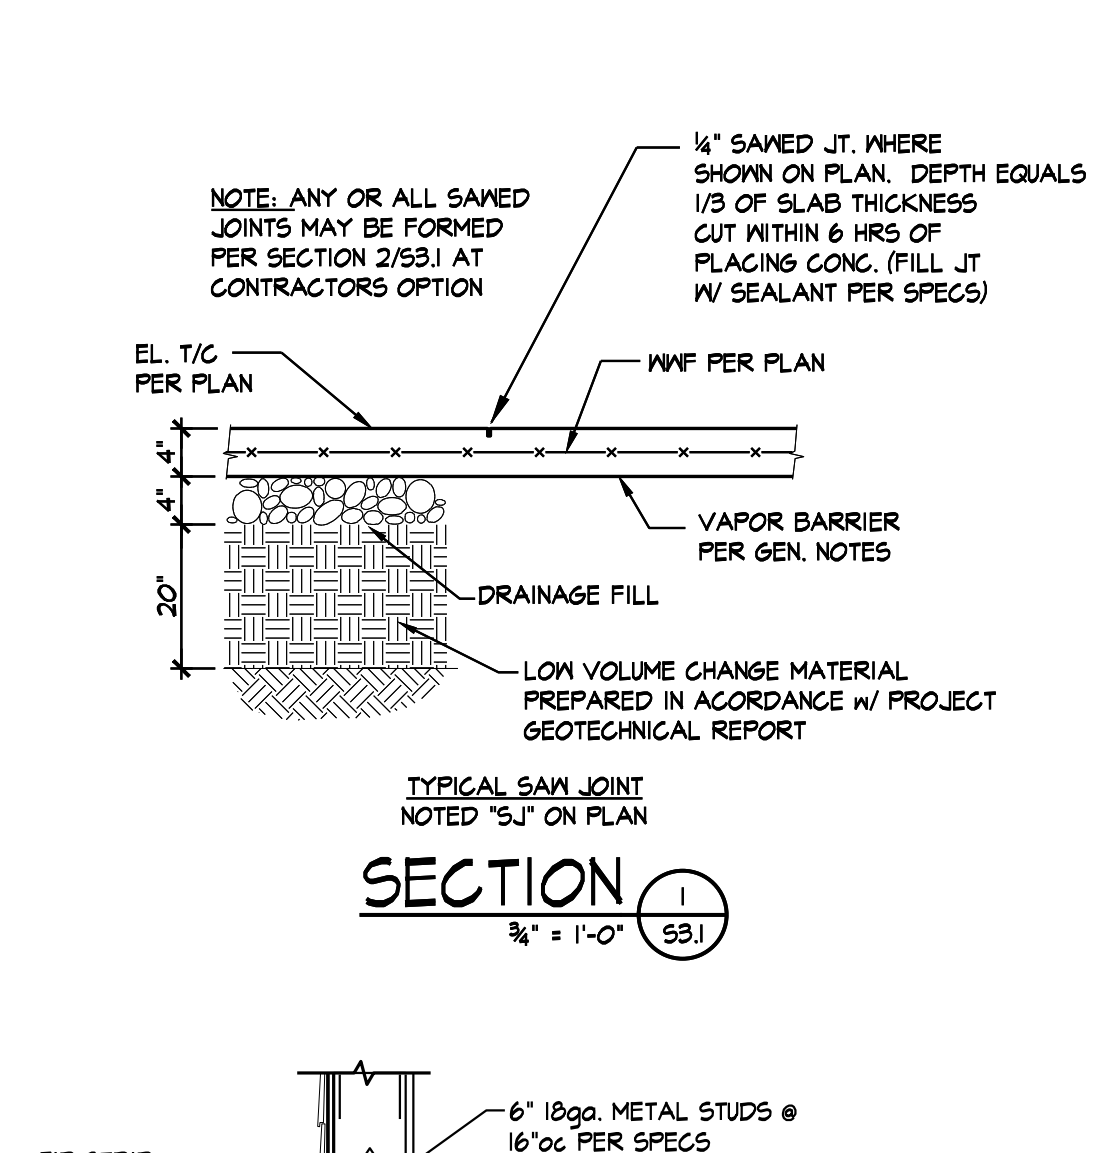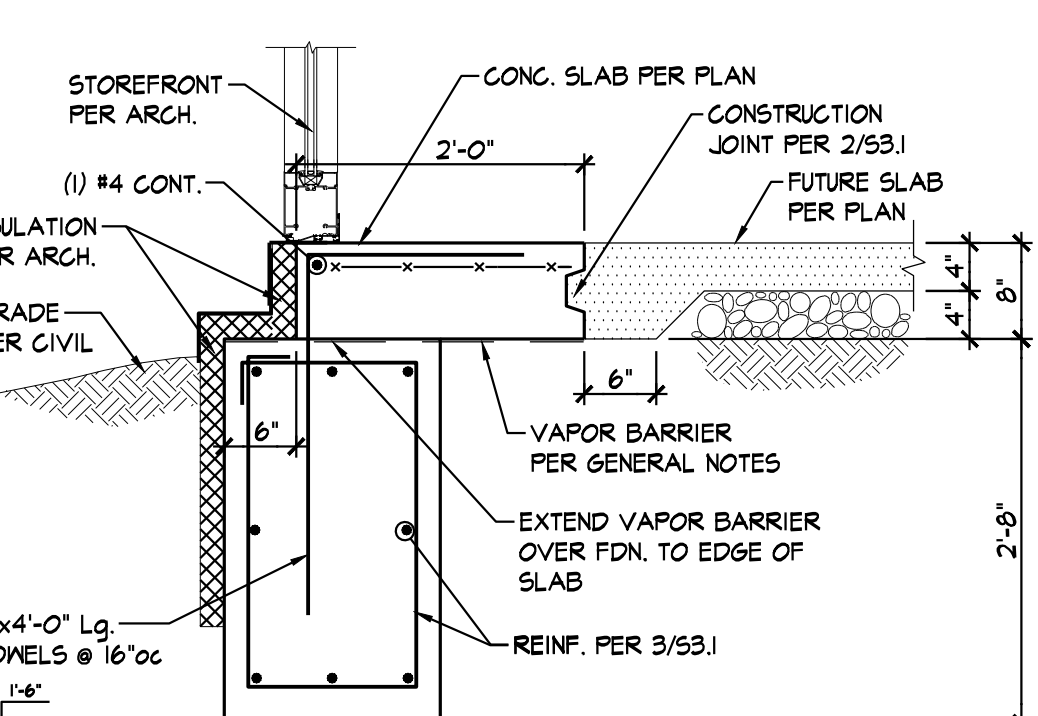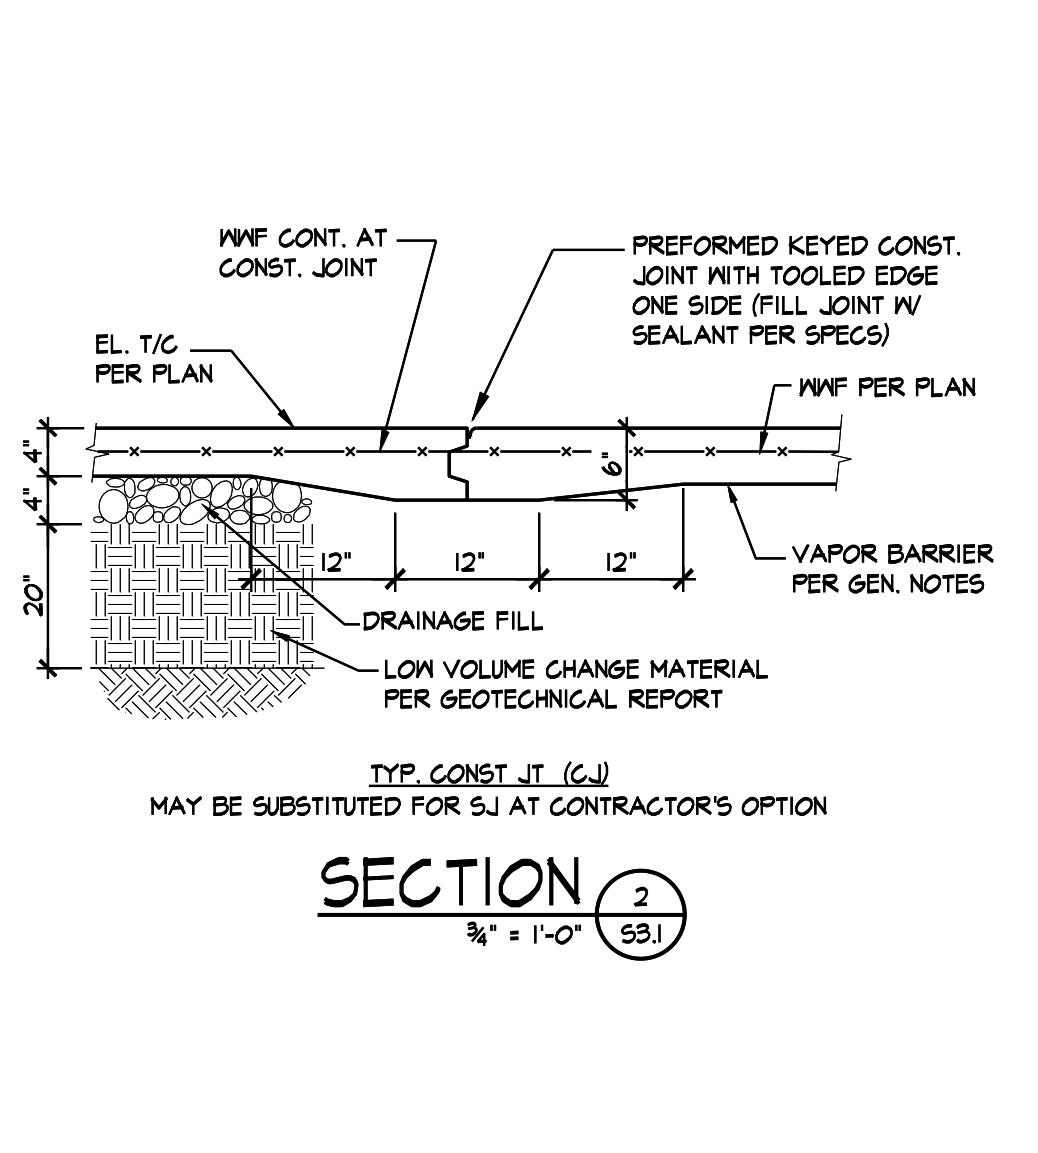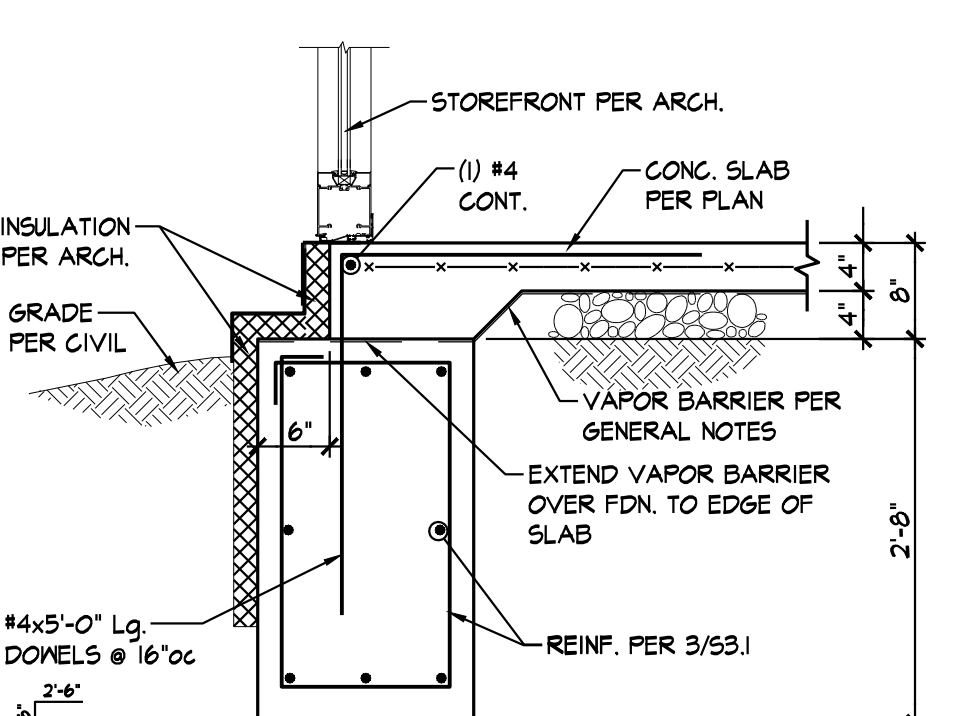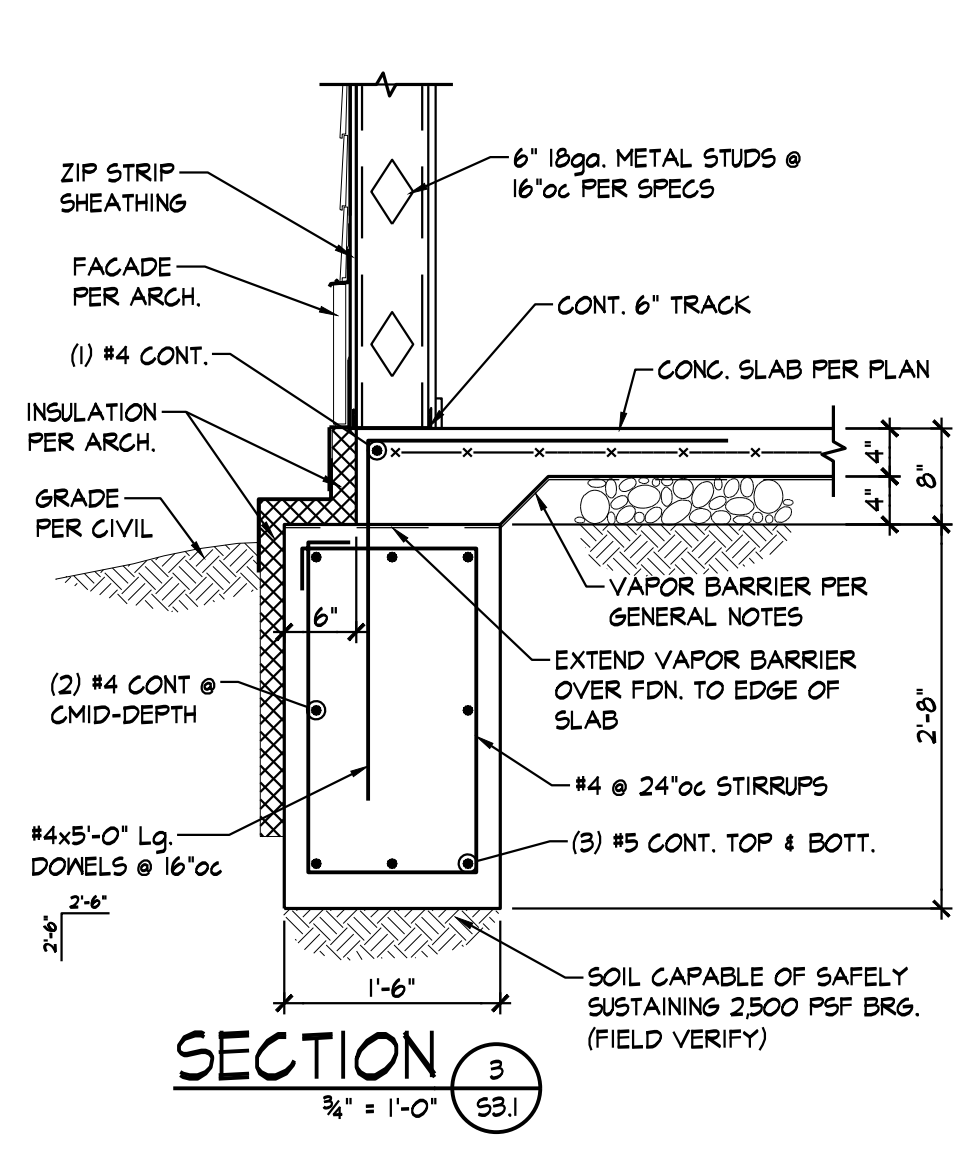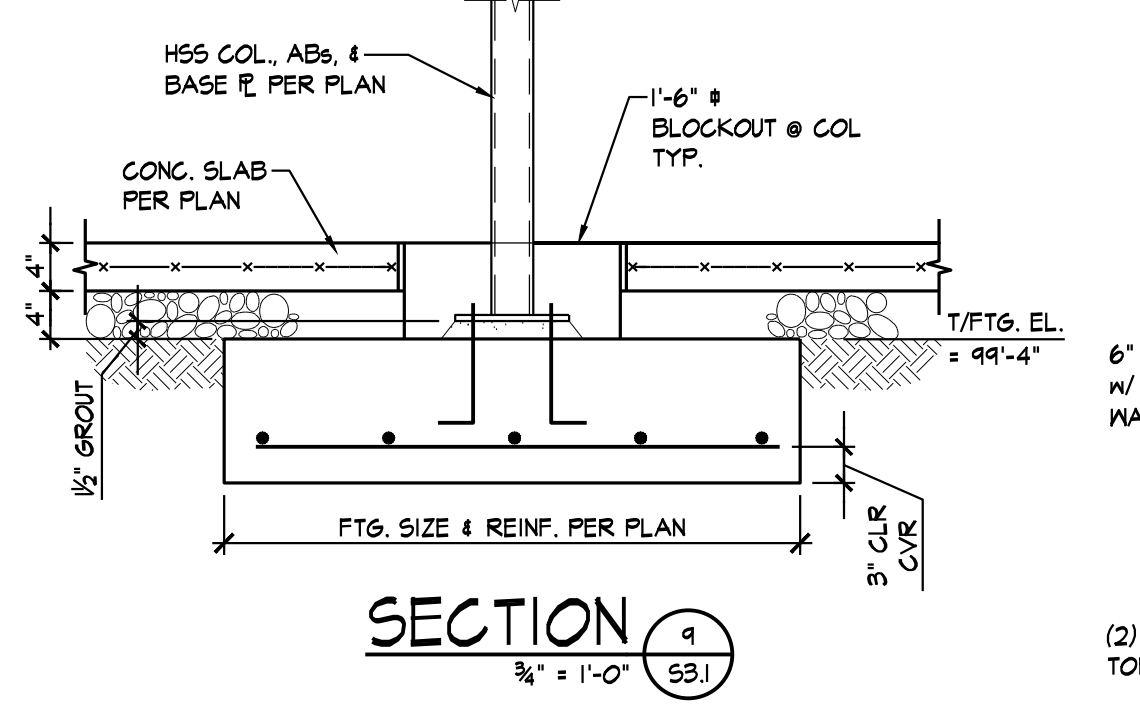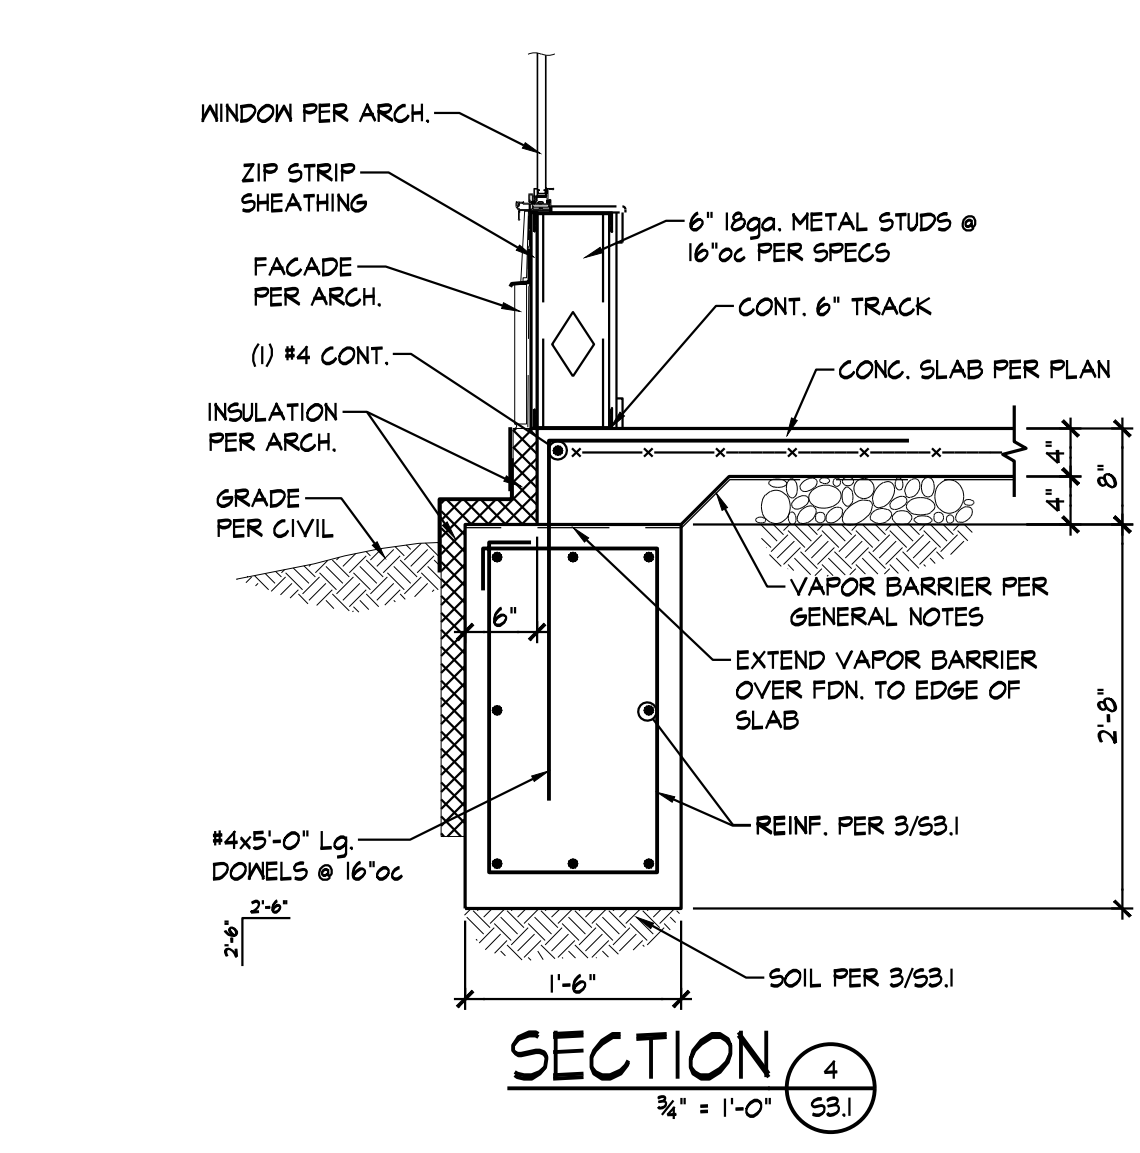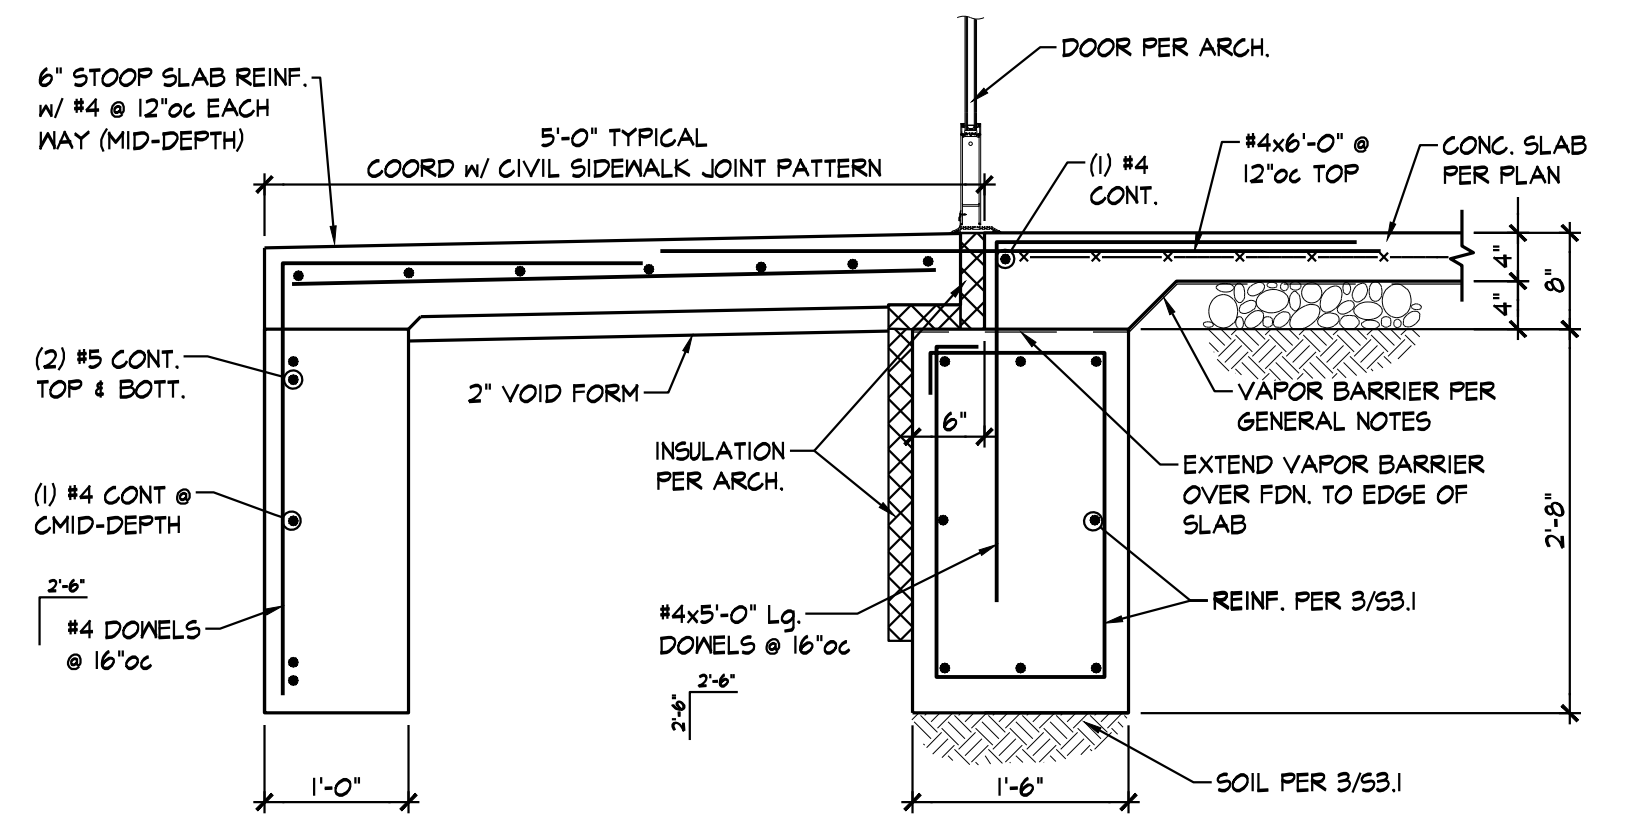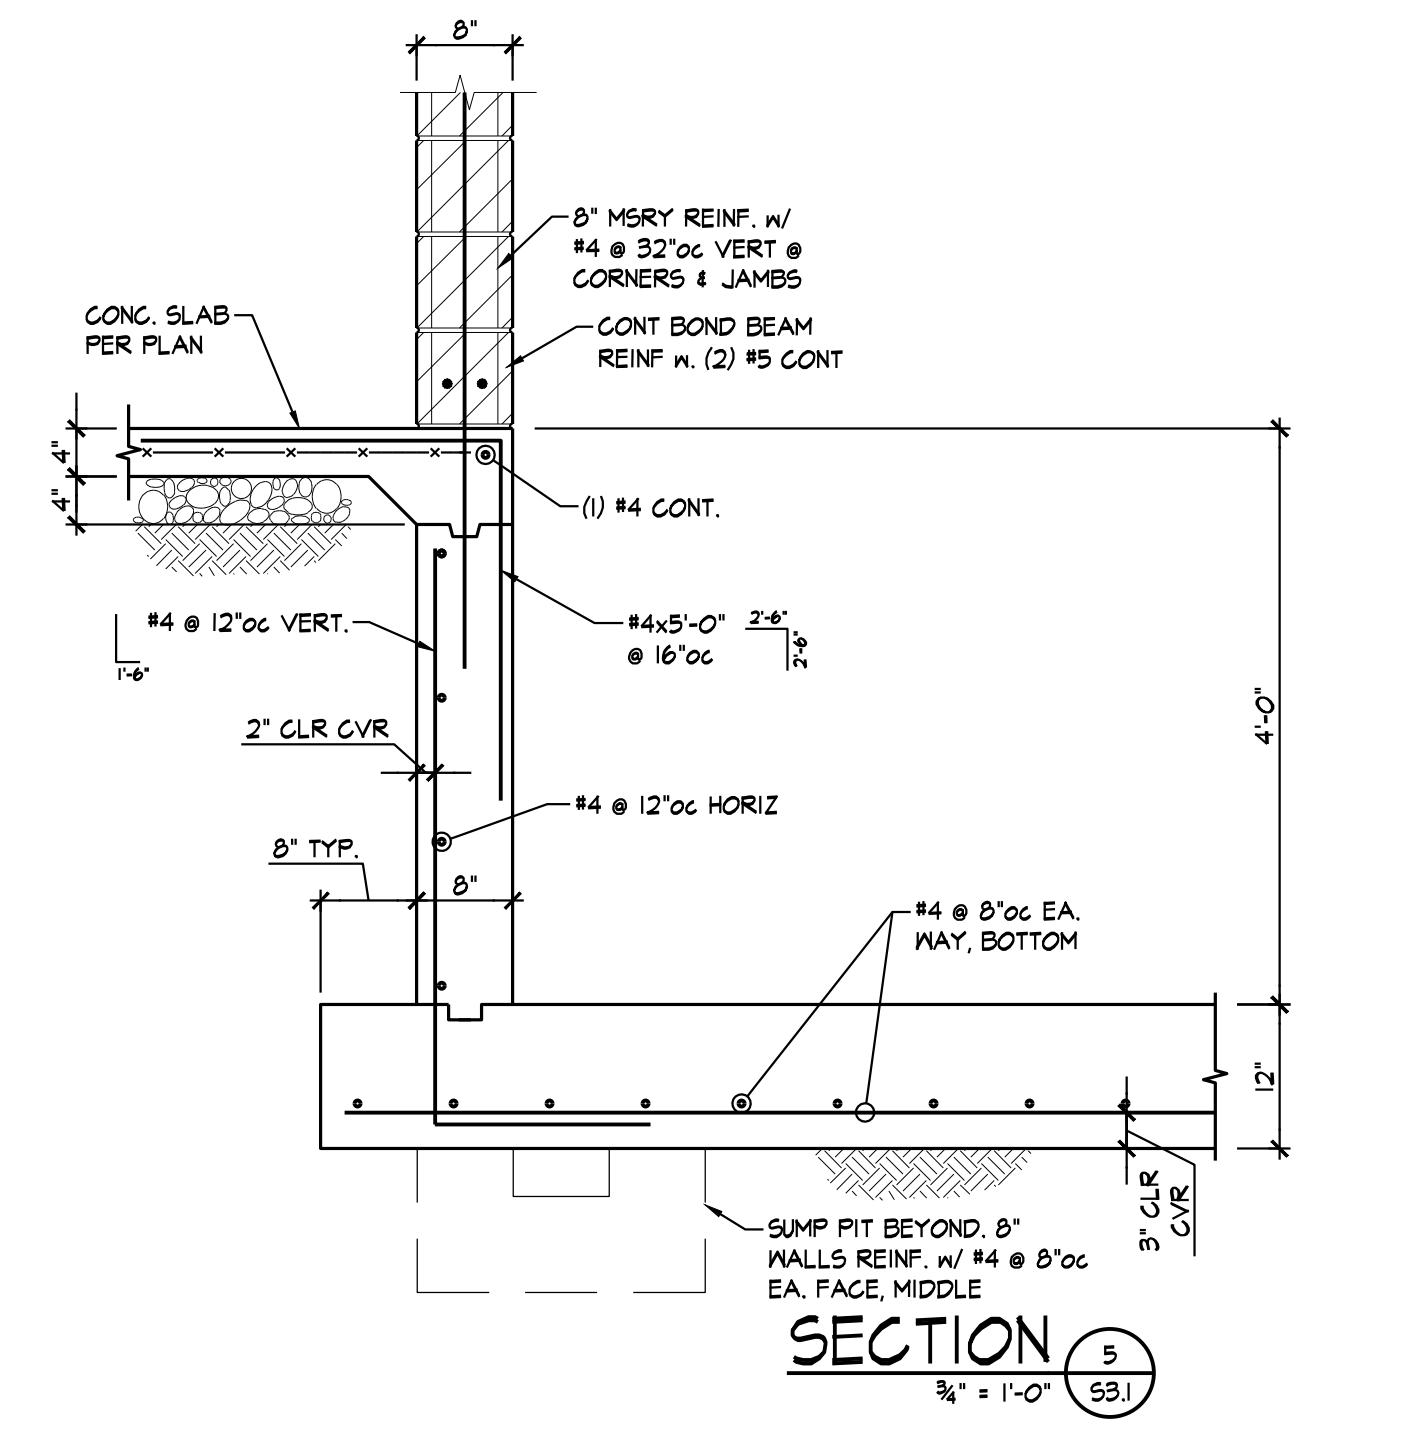


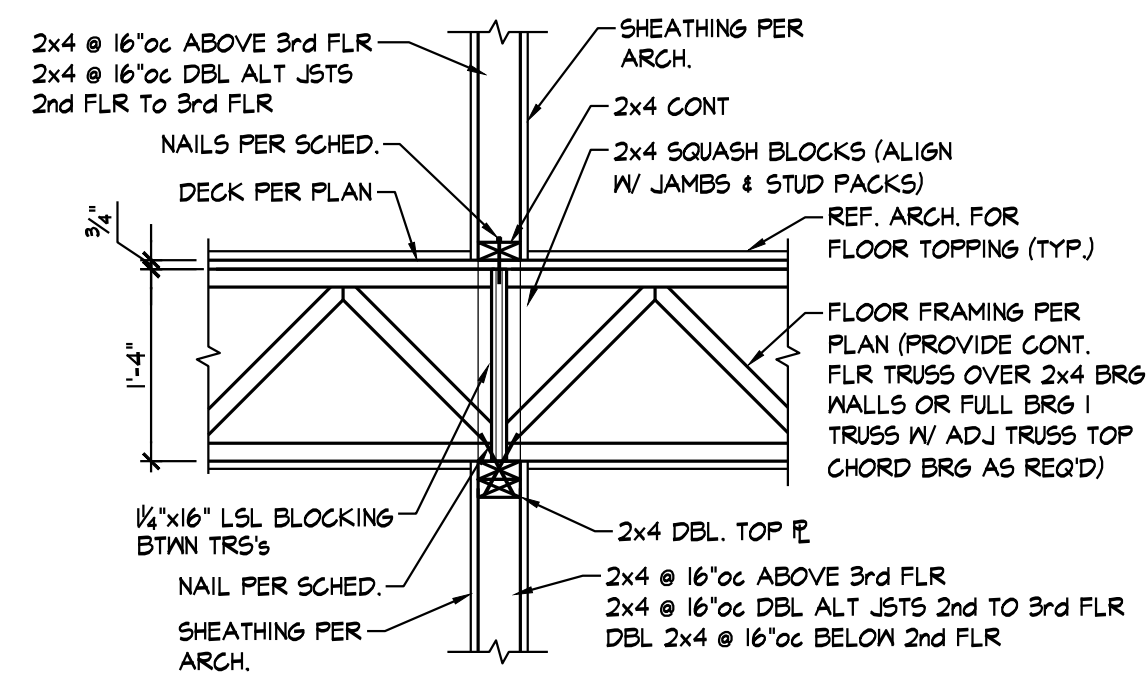


SECTION 1
3/4" = 1'-0" 53.2

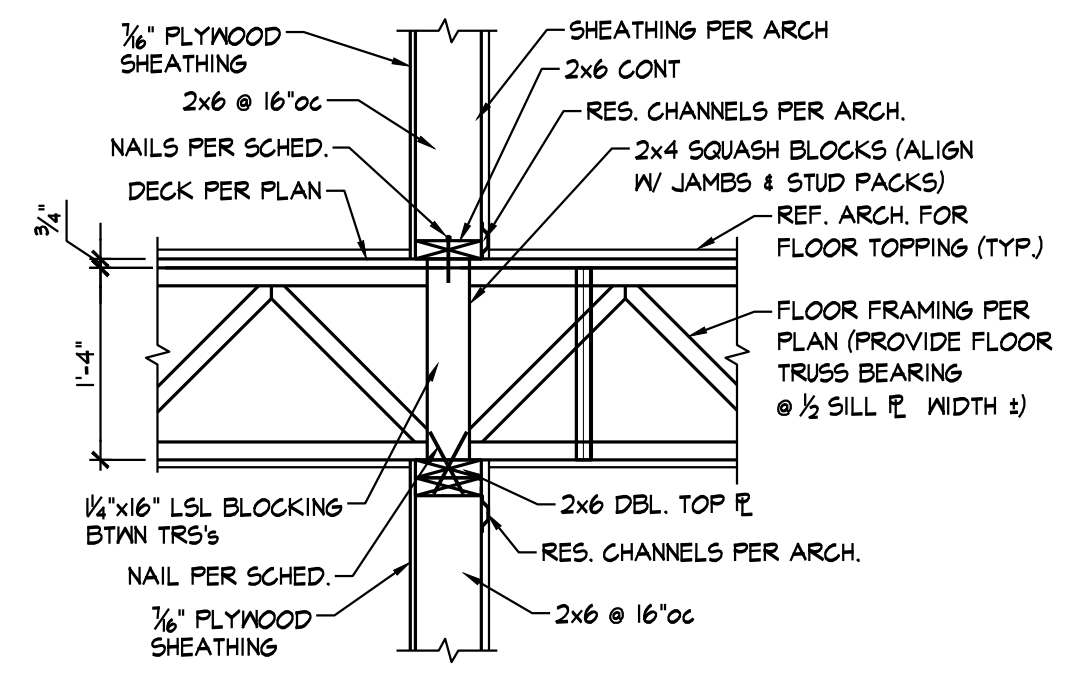


SECTION 2
3/4" = 1'-0" 53.2

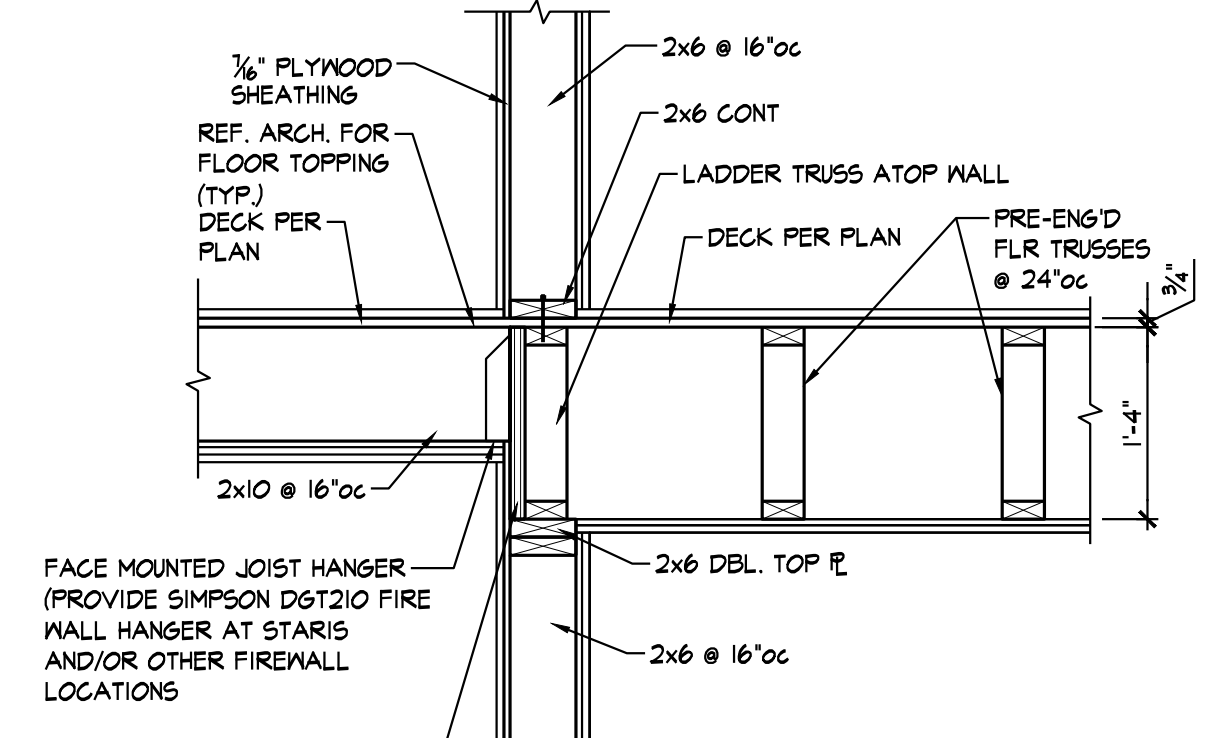


SECTION 3
3/4" = 1'-0" 53.2

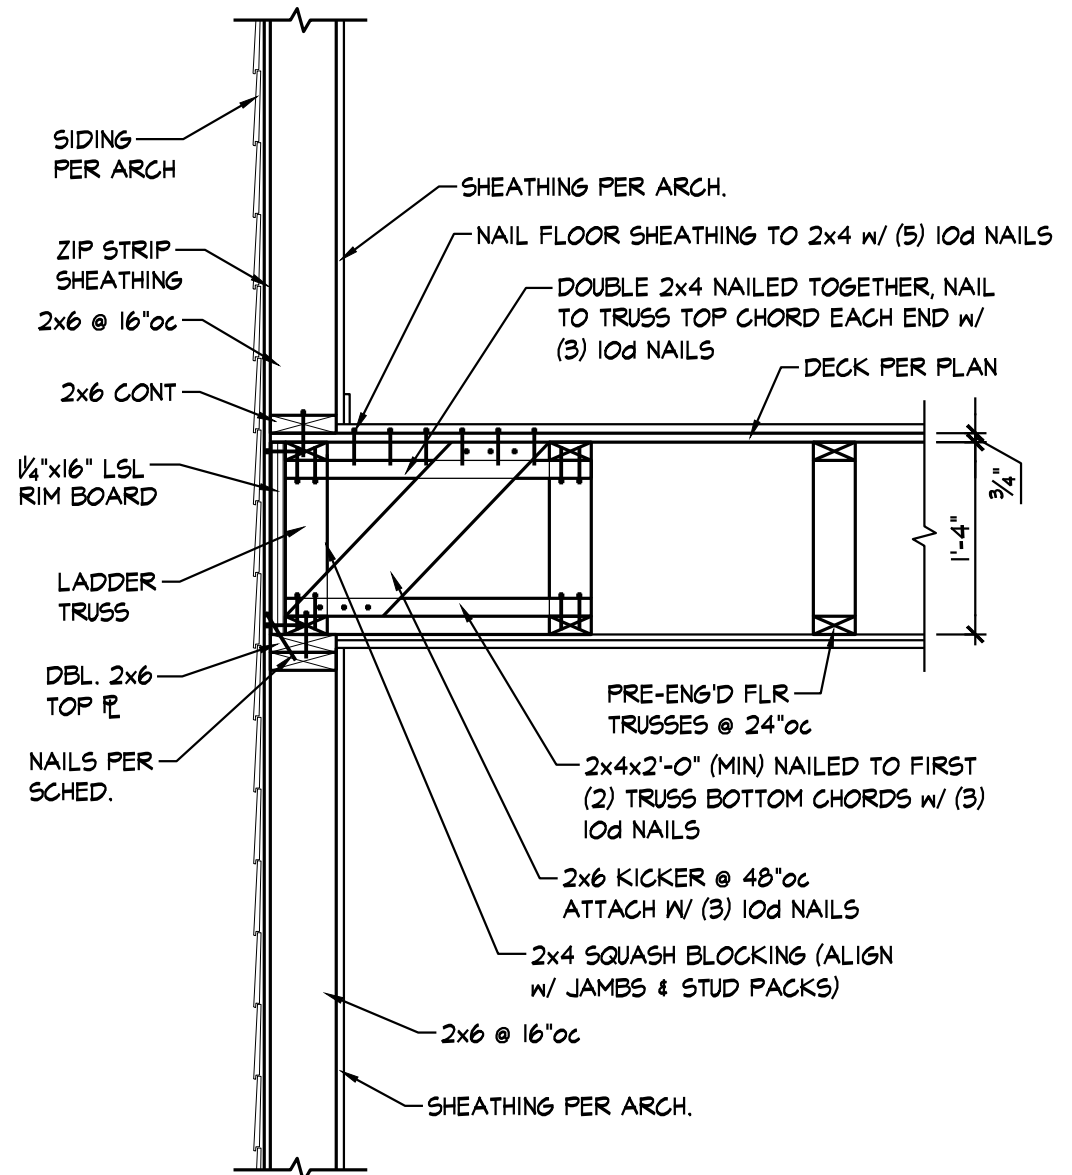


SECTION 4
3/4" = 1'-0" 53.2

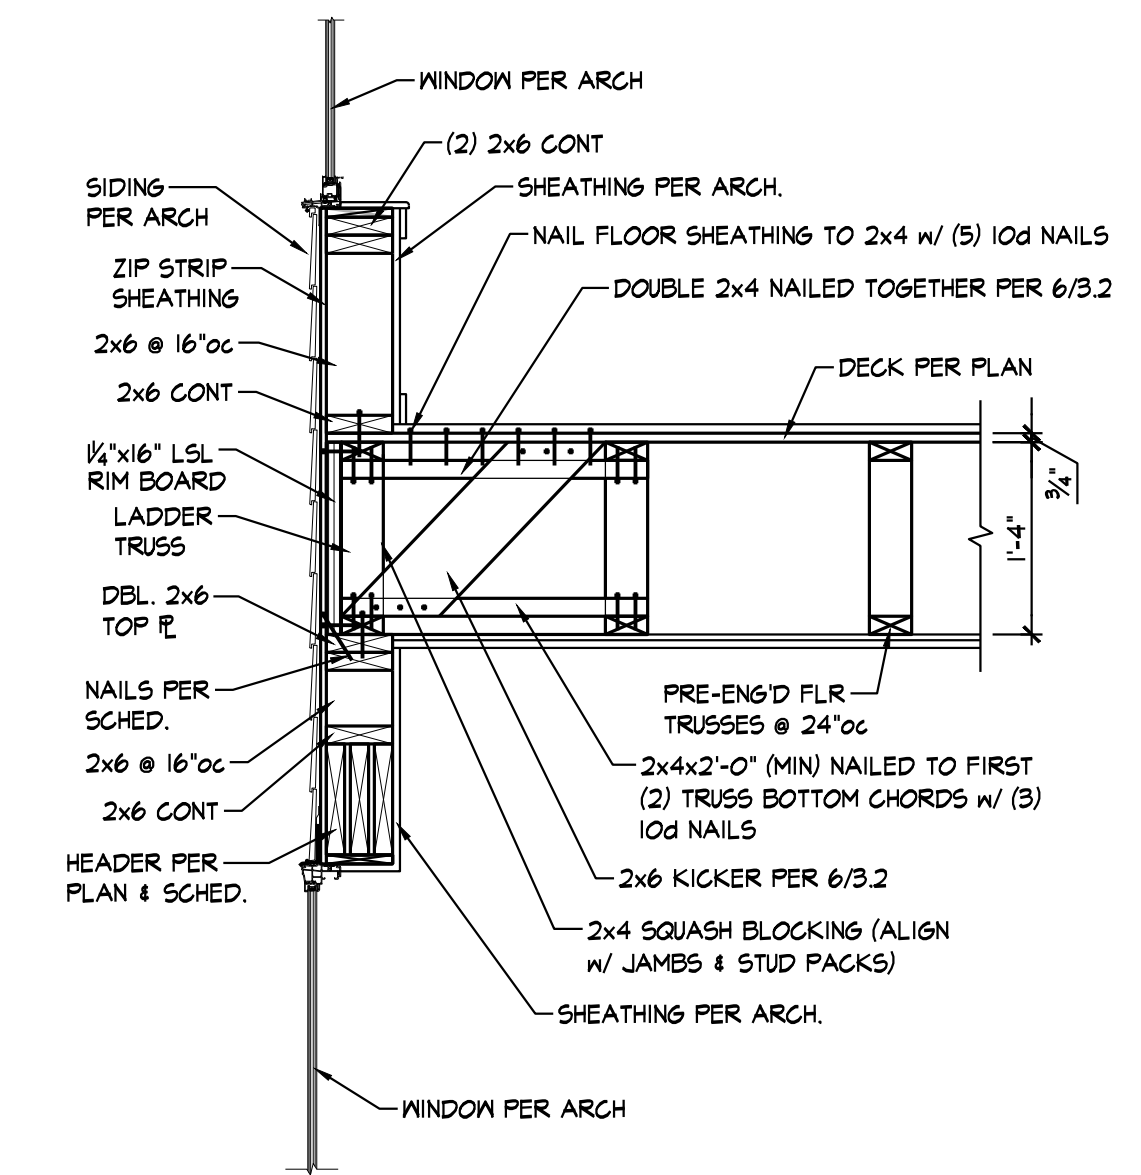


SECTION 4A
3/4" = 1'-0" 53.2

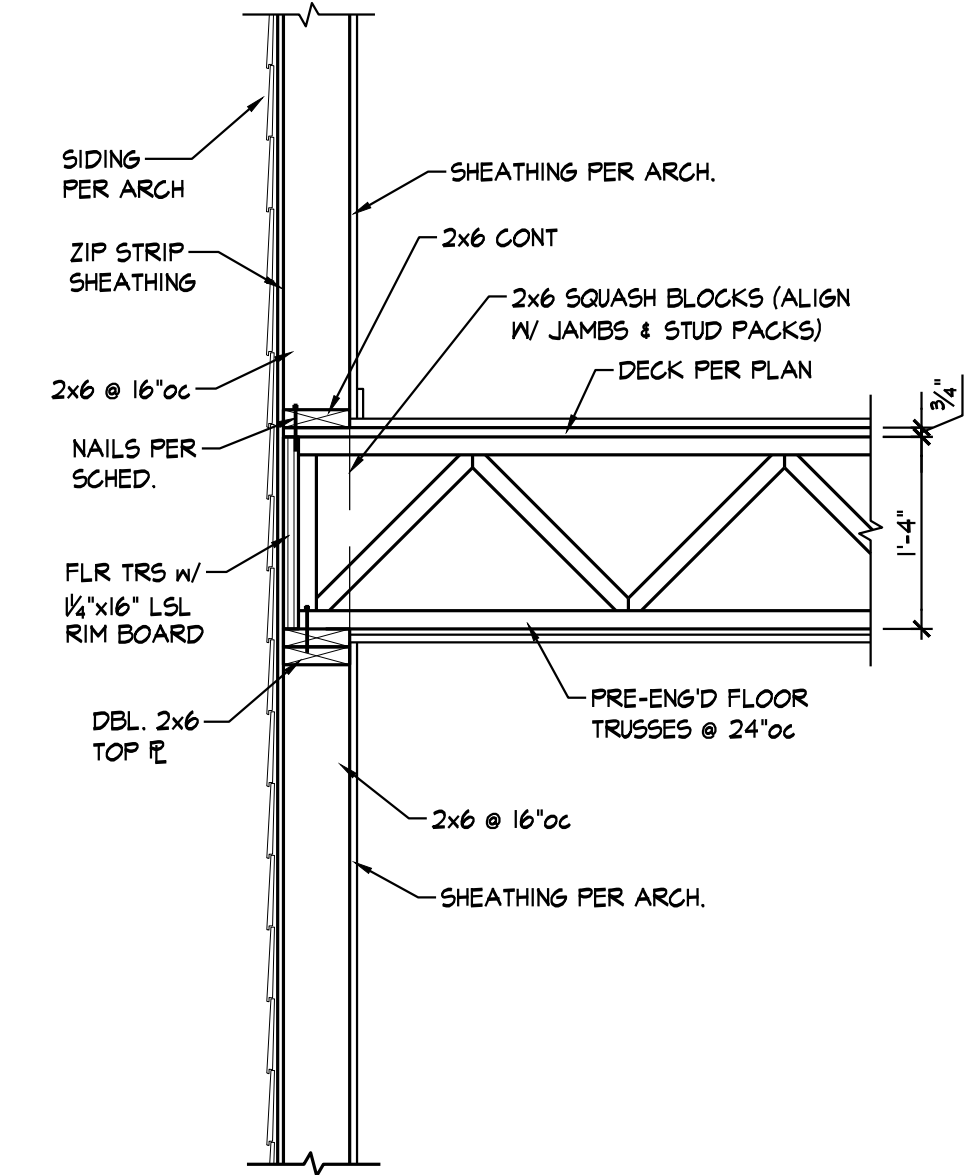


SECTION 5
3/4" = 1'-0" 53.2

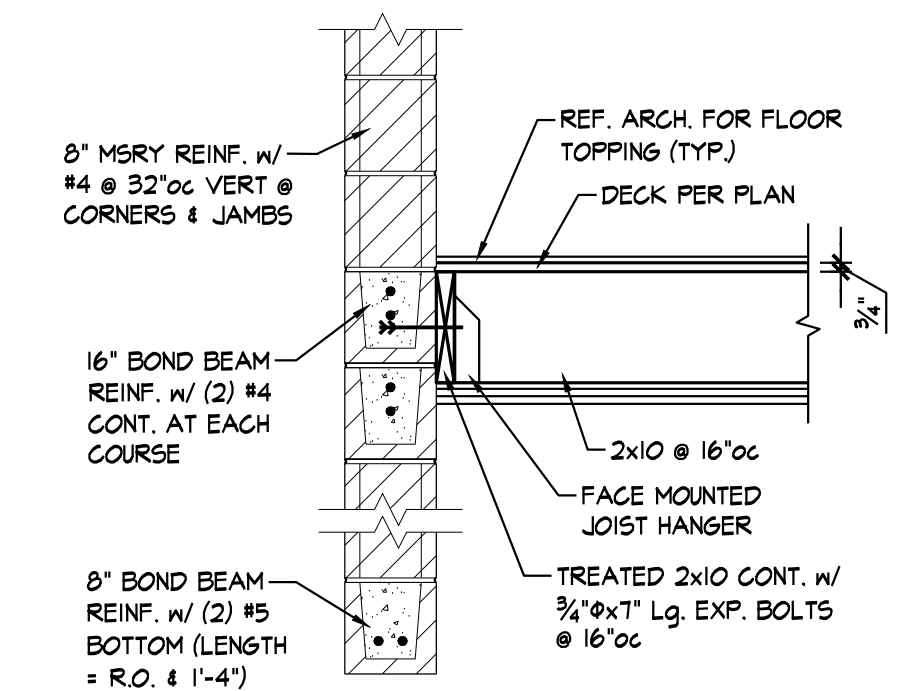


SECTION 6
3/4" = 1'-0" 53.2

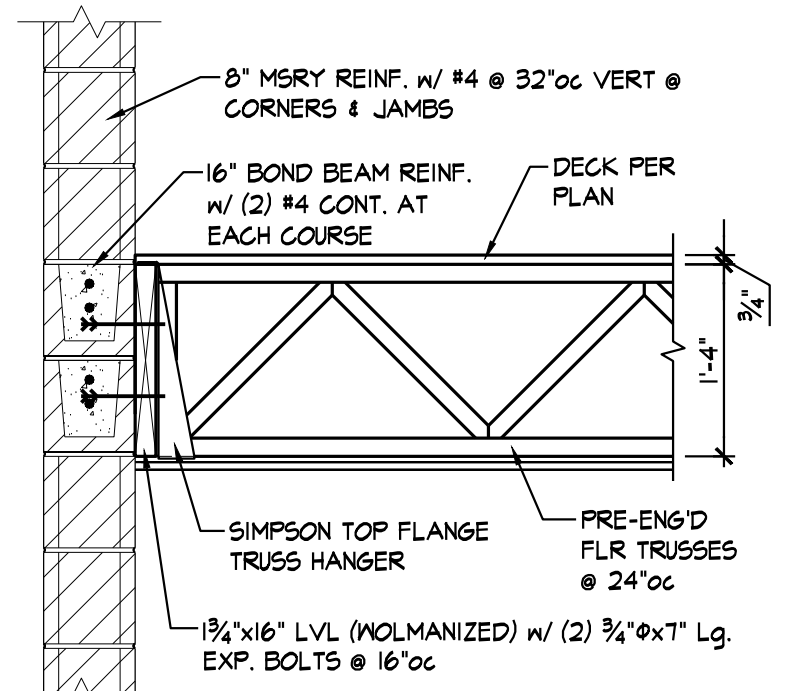

SECTION 7
3/4" = 1'-0" 53.2

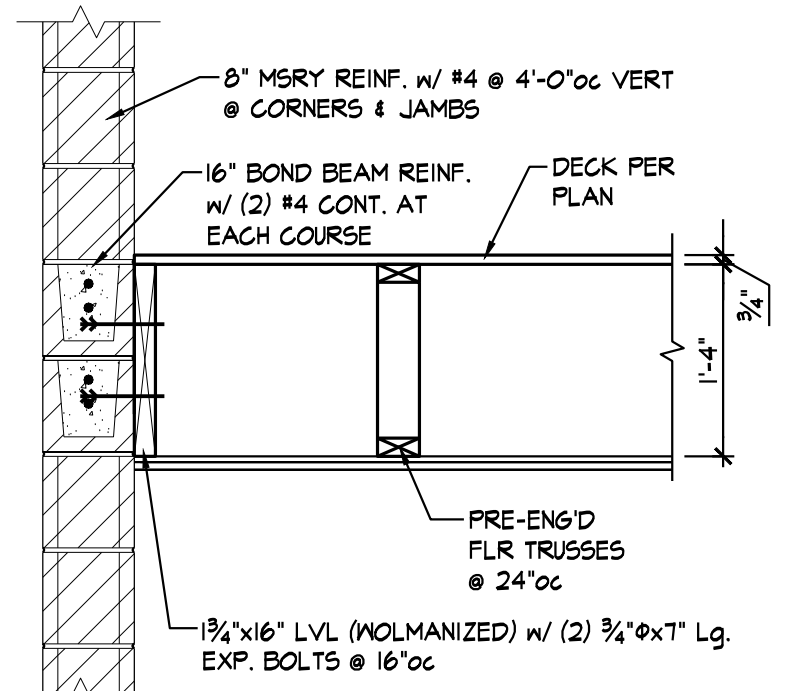

SECTION 8
3/4" = 1'-0" 53.2

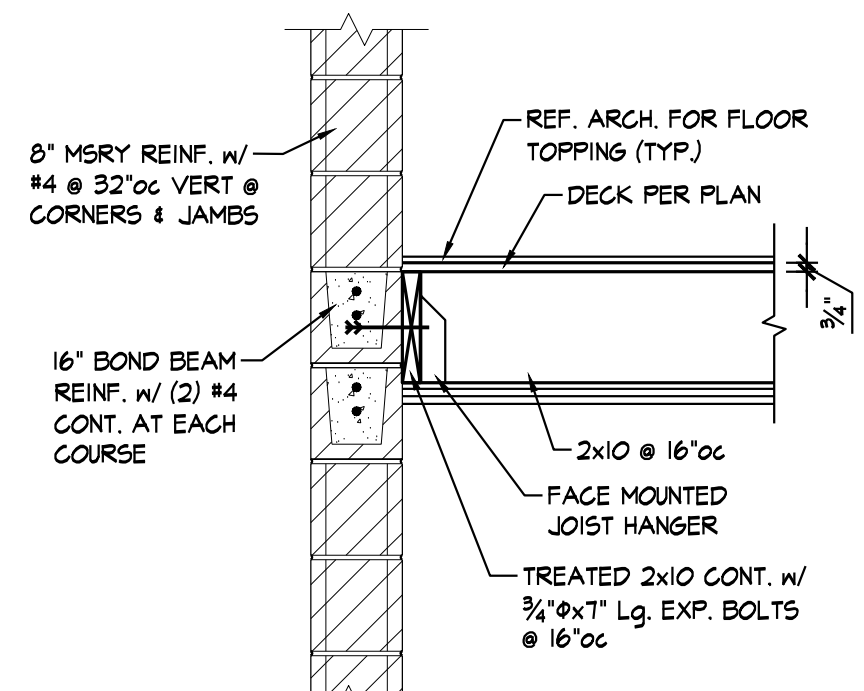

SECTION 9
3/4" = 1'-0" 53.2


TYPICAL STAIR LANDING




REVISION:	
DATE:	4-17-2026
JOB:	25-3465
SHEET NO.:	




REVISION:
 DATE: 4-17-2026
 JOB: 25-3465
 SHEET NO.:

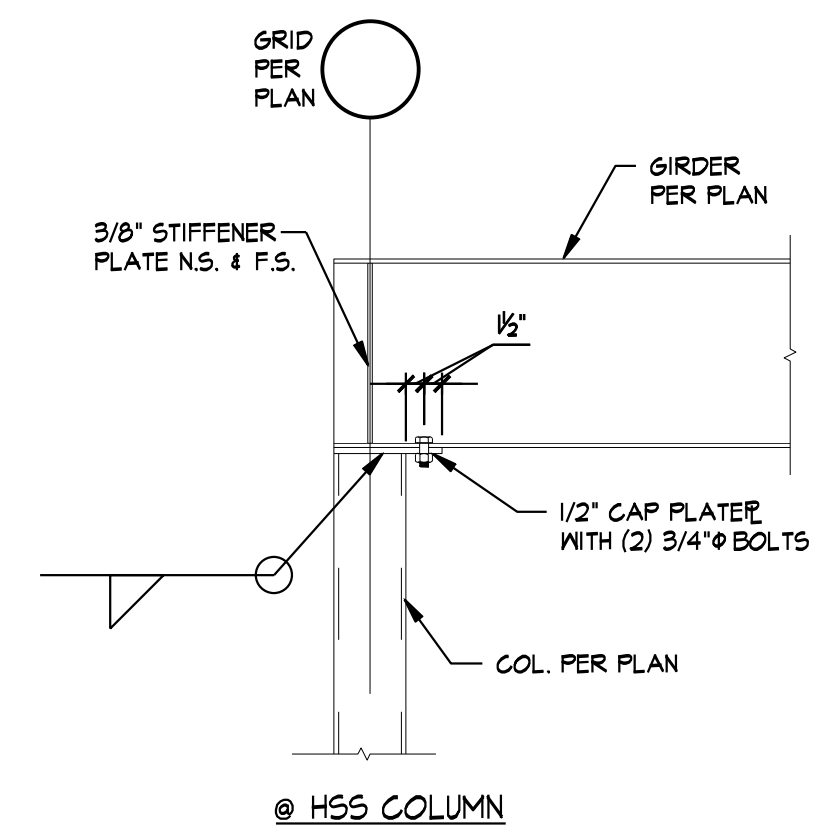


SECTION 4
 3/4" = 1'-0" S3.3

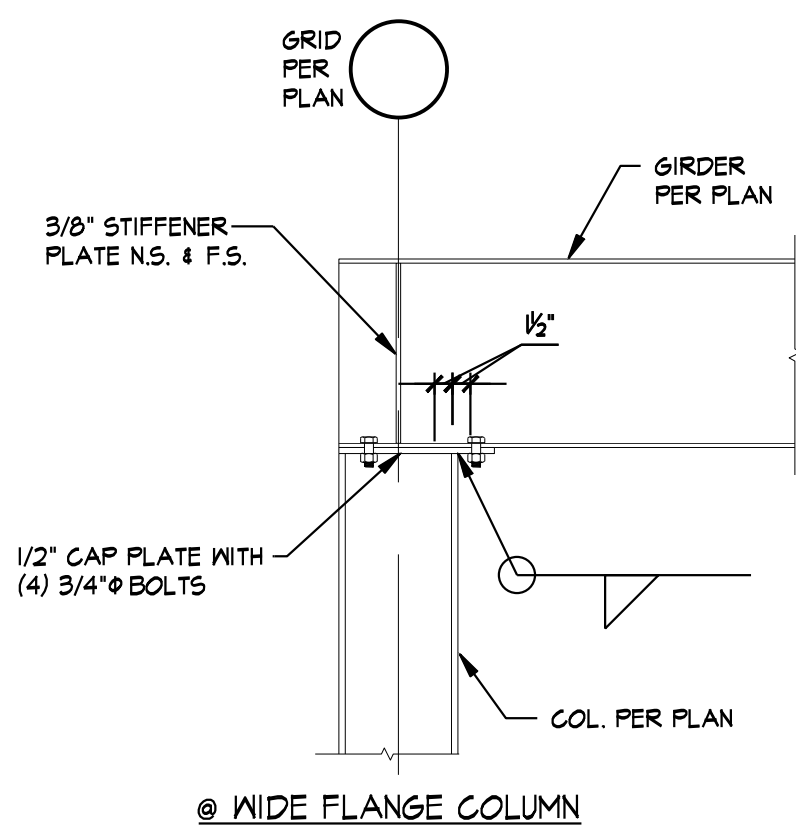


TYPICAL ROOF BEAM TO COLUMN CONNECTION AT EXTERIOR WALL

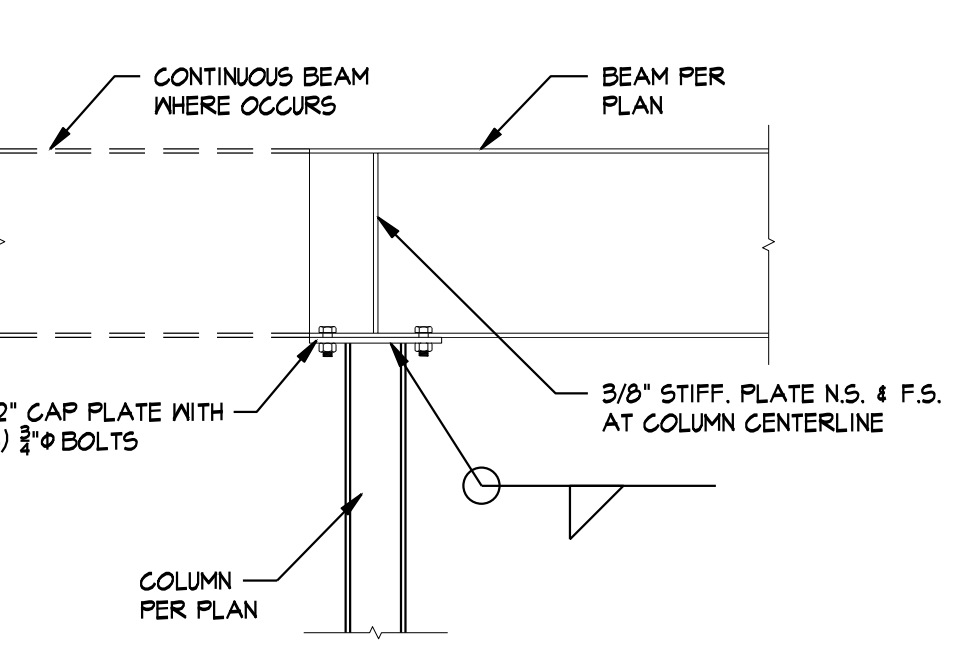

DETAIL 3
 3/4" = 1'-0" S3.3

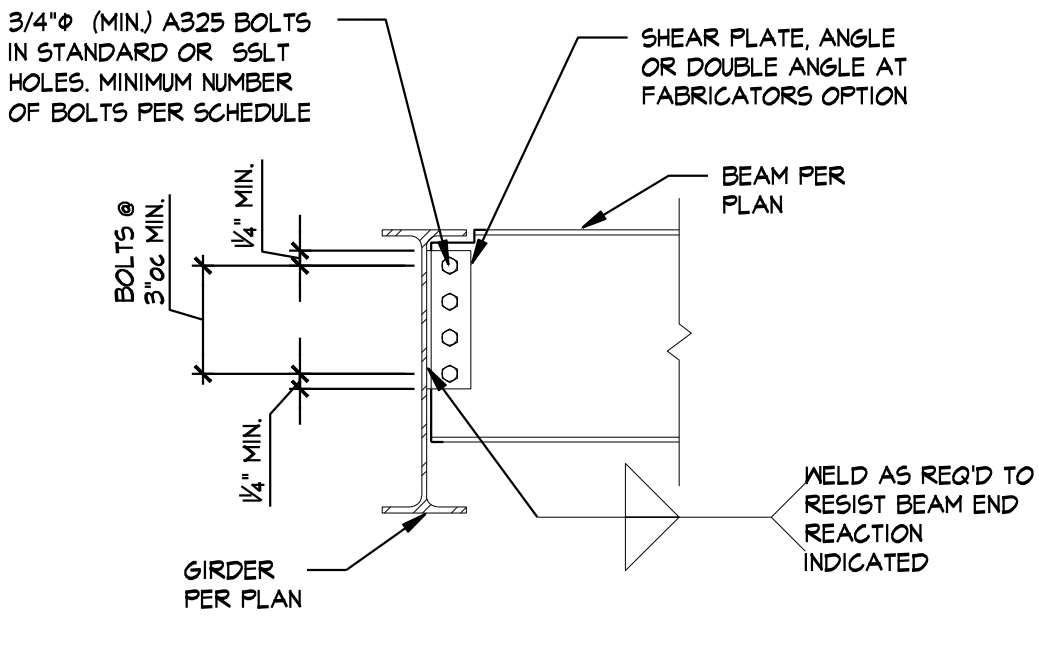


DETAIL 2
 3/4" = 1'-0" S3.3

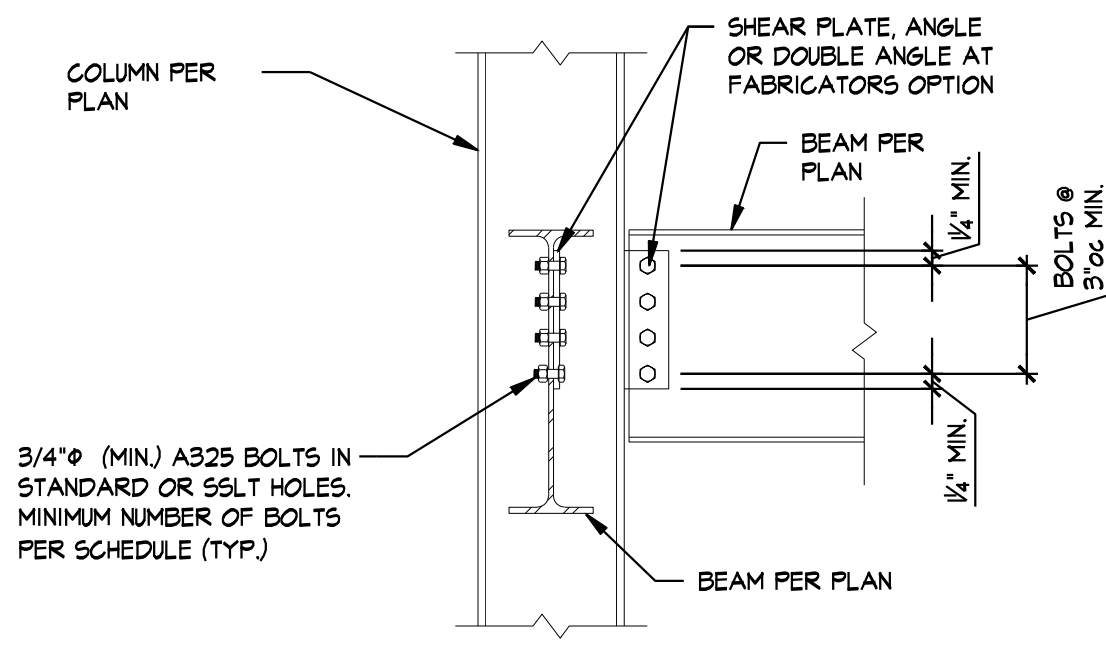


TYPICAL BEAM TO COLUMN SHEAR CONNECTION

DETAIL 1
 3/4" = 1'-0" S3.3

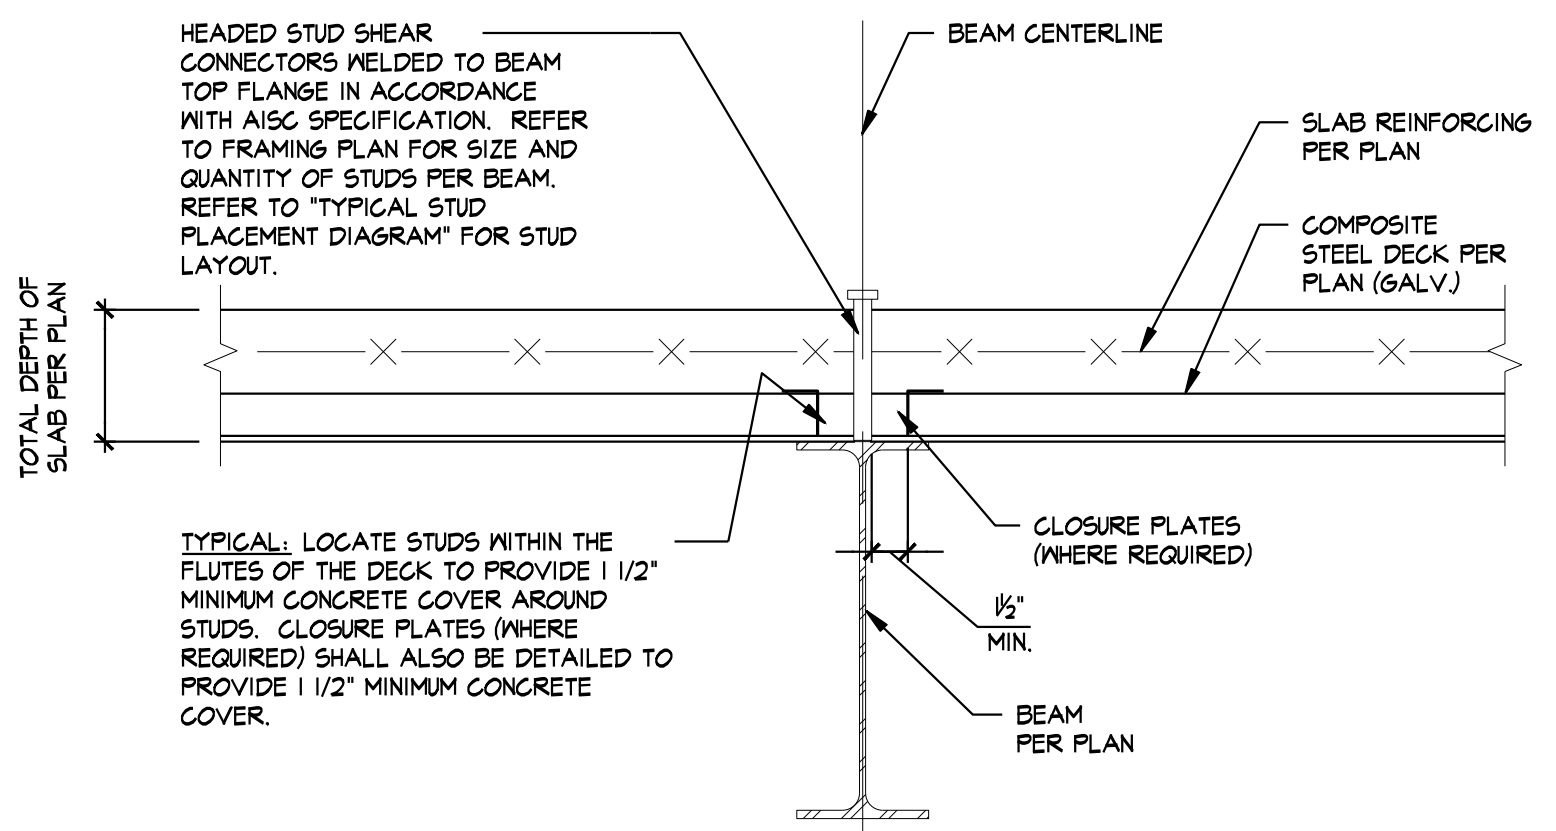

TYPICAL COMPOSITE BEAM DETAIL
 (DECK SPAN PERPENDICULAR TO BEAM)


SECTION 6
 1/2" = 1'-0" S3.3

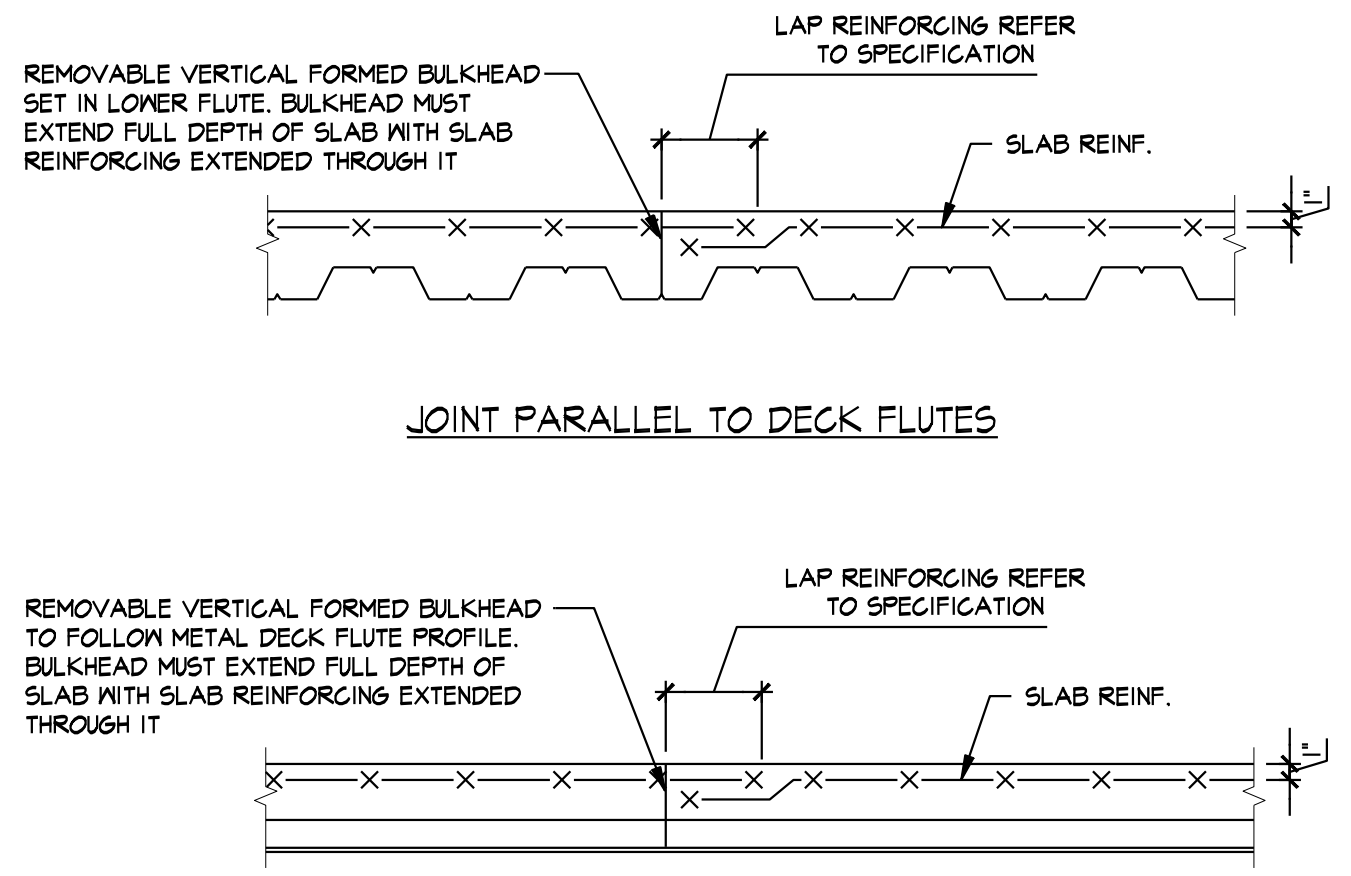

JOINT PERPENDICULAR TO DECK FLUTES


TYPICAL SLAB ON METAL DECK CONSTRUCTION JOINT

SECTION 5
 1" = 1'-0" S3.3

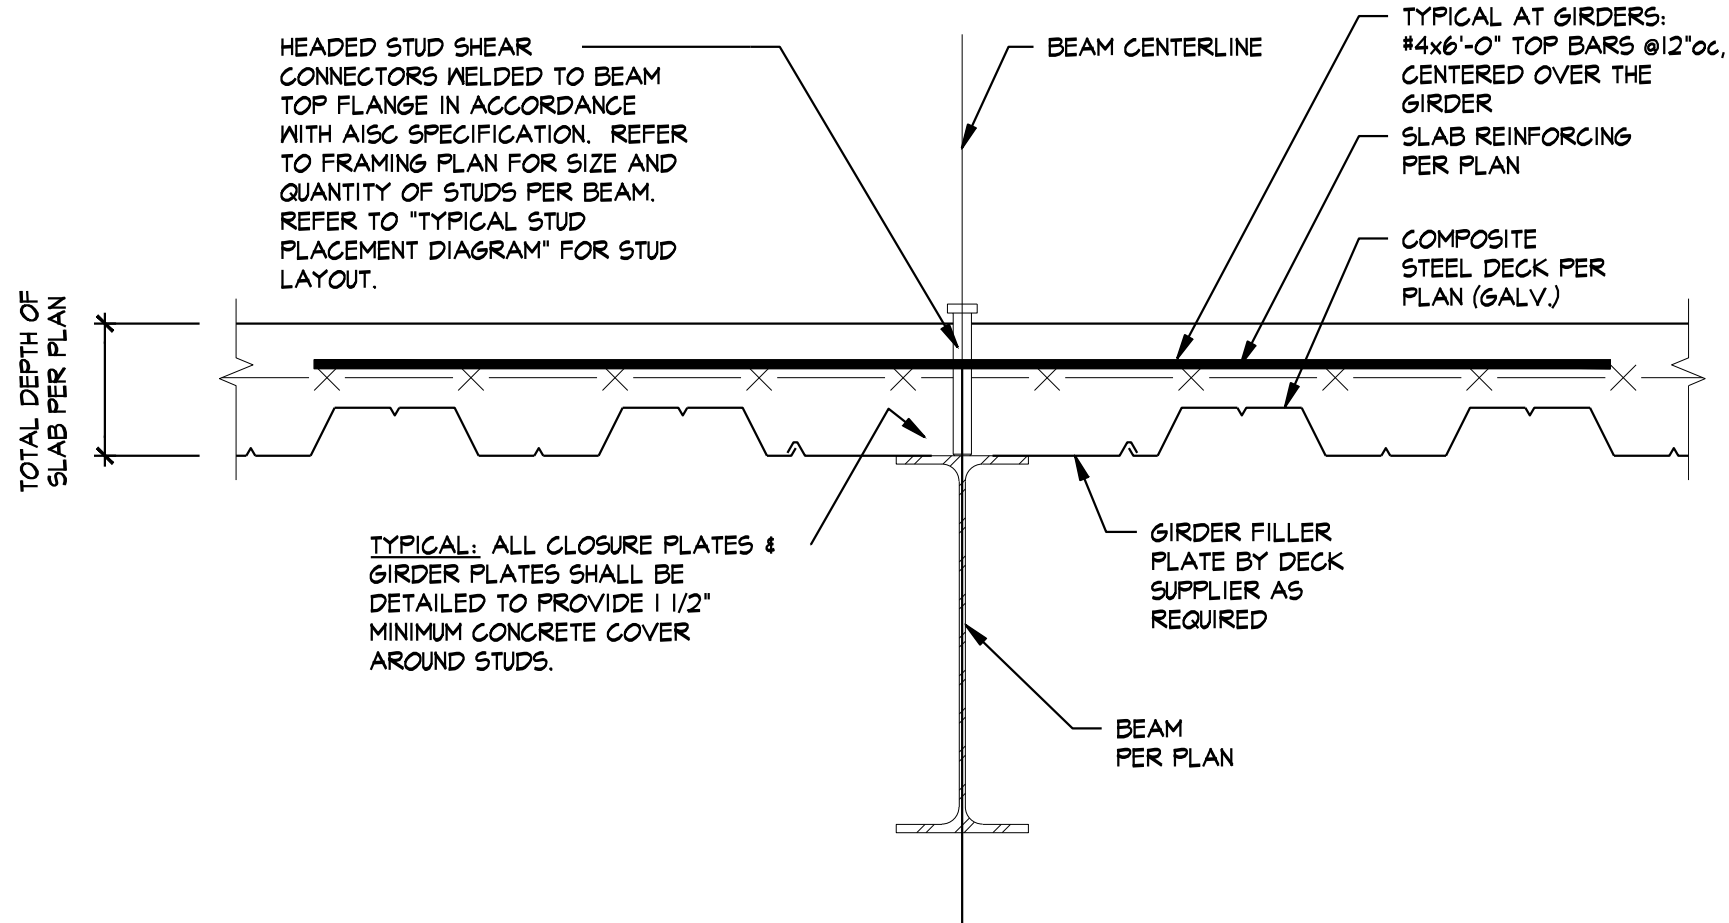

TYPICAL COMPOSITE BEAM/GIRDER DETAIL
 (DECK SPAN PARALLEL TO BEAM)

SECTION 7
 1/2" = 1'-0" S3.3

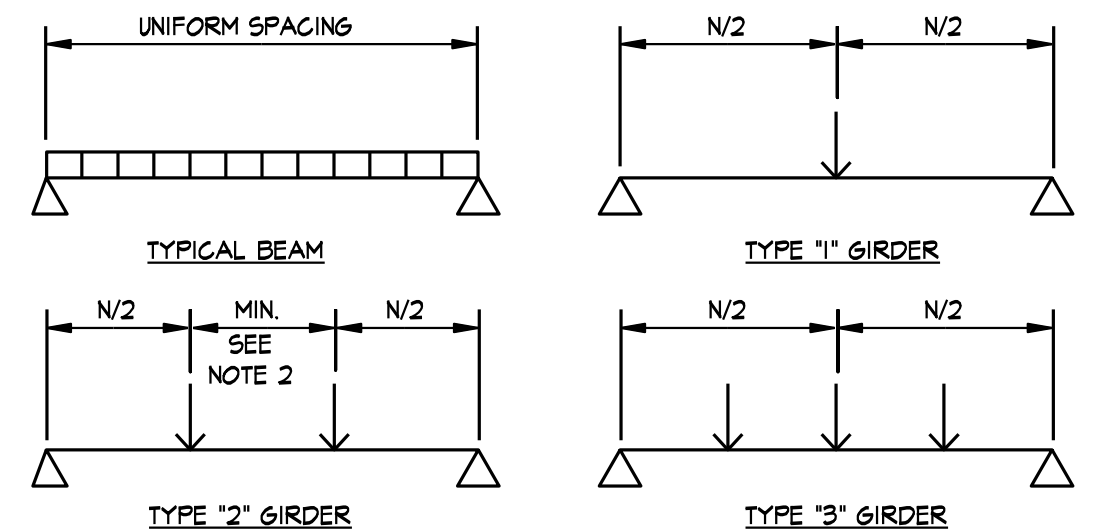

TYPICAL STUD PLACEMENT DIAGRAM

- ALL DIAGRAMS REPRESENT IDEALIZED CONDITIONS. ACTUAL FRAMING CONFIGURATIONS MAY REQUIRE ADDITIONAL INTERPRETATION.
- MAXIMUM SPACINGS OF STUDS SHALL BE 36" o.c. IF STUD SPACING EXCEEDS 12' o.c. PROVIDE 5/8" DIA. PUDDLE WELD ATTACHMENT SUCH THAT THE MAXIMUM AVERAGE SPACING OF STUD/WELD ATTACHMENTS IS 12' o.c. AND MAXIMUM SPACING BETWEEN ATTACHMENTS IS 18".
- THE NUMBER OF STUDS PER BEAM SHOWN ON THE DRAWINGS IS BASED ON AN ASSUMED DESIGN VALUE OF 13.3 KIPS/STUD. THE ACTUAL NUMBER OF STUDS PER BEAM (N) MAY VARY BASED WIDTH, DECK DEPTH, NUMBER OF STUDS PER CELL, DECK RIB ORIENTATION, ETC. AS PER AISC SPECIFICATIONS FOR COMPOSITE CONSTRUCTION. METAL DECK CONTRACTOR SHALL SUBMIT ALL CALCULATIONS VERIFYING THE HORIZONTAL SHEAR CAPACITY OF SHEAR STUDS DETAILED ON SHOP DRAWINGS AND PROVIDE THE STUDS REQUIRED.
- SHEAR CONNECTOR PLACEMENT SHALL BE FULLY DETAILED ON THE METAL DECK SHOP DRAWINGS.


TYPICAL STUD PLACEMENT
 3/4" = 1'-0" S3.3

STEEL CONNECTION NOTES:


- REFER TO GENERAL NOTES ON SHEET S001.
- CONNECTIONS SHOWN IN THESE DETAILS ARE MINIMUM REQUIREMENTS.
- FABRICATOR SHALL BE RESPONSIBLE FOR THE ENGINEERING, DESIGNING, AND DETAILING OF EACH CONNECTION FOR LOADS SHOWN ON THE DRAWINGS IN ACCORDANCE WITH THE SPECIFICATIONS AND THE STRUCTURAL GENERAL NOTES.
- SUGGESTED CONNECTION DETAILS ARE SHOWN. FINAL CONNECTION CONFIGURATION AND DESIGN SHALL BE COMPLETED BY THE CONNECTION ENGINEER. CONNECTION DESIGN SHALL INCLUDE COLUMN OR BEAM CONTINUITY PLATES, WEB STIFFENERS, AND/OR DOUBLER PLATES AS REQUIRED FOR THE FORCES INDICATED.
- FABRICATOR MAY OPT TO USE OTHER AISC APPROVED CONNECTIONS IN LIEU OF THESE SHOWN HEREIN TO MEET END REACTION REQUIREMENTS (i.e. DOUBLE ANGLE CONNECTION).
- CONNECTION DETAILING SHALL COMPLY WITH THE STANDARD DETAILS SHOWN IN THE LATEST EDITION OF THE AISC MANUAL OF STEEL CONSTRUCTION.
- ALL BOLTS SHALL BE 3/4" ASTM A325 MINIMUM.
- ALL BOLTS SHALL BE SPACED AT 3" o.c. MINIMUM.
- ALL BOLTS SHALL HAVE HEAVY HEX NUTS.
- ALL BOLTS SHALL BE FULLY PRE-TENSIONED.
- BOLT SPACING AND EDGE DISTANCES SHALL BE ADJUSTED PER AISC MANUAL FOR BOLTS LARGER THAN 3/4" DIAMETER.
- CLIP ANGLES MAY BE SHOP WELDED TO BEAM WEB PER AISC.
- FOR BEAMS WITH AXIAL LOADS PER DRAWINGS, BOLTS AND CONNECTIONS SHALL BE SLIP-CRITICAL PER AISC GUIDELINES. INCREASE NUMBER OF BOLTS AND/OR PROVIDE EXTENDED SHEAR PLATE CONNECTION W/ AN ADDITIONAL COLUMN OF BOLTS TO ACCOMMODATE COMBINED FORCES.
- PROVIDE ASTM A490 BOLTS IF REQUIRED TO MEET END REACTION LOAD REQUIREMENTS.
- REFER TO ELEVATIONS ON SHEET S... FOR BRACE FORCES. REFER TO PLANS FOR ADDITIONAL BEAM AXIAL FORCES. BRACE AND BEAM FORCES INDICATED ARE UNFACTORED (ASD) LOADS AND SHALL BE CONSIDERED CONCURRENT W/ BEAM SHEAR DESIGN FORCES LISTED IN THE BEAM SHEAR CONNECTION SCHEDULE.
- COORDINATE BRACED FRAME CONNECTION W/ ARCHITECTURAL WALLS AS REQUIRED TO AVOID CONFLICT OR EXPOSURE OUTSIDE OF WALL OR FINISH.
- ALL END REACTIONS INDICATED ARE UNFACTORED (ASD) LOADS.

BEAM SHEAR CONNECTION SCHEDULE		
BEAM SIZE	MINIMUM ROWS OF BOLTS	END REACTION (kips)/U.O.
W8,C8	2	16
W10,C10	2	16
W12,C12	2	16
W14	3	24
W16,C15	3	24
W18	4	32
W21	5	40
W24	5	40
W27	6	48
W30	7	56
W33	8	64
W36	8	64


- NOTES:
- CONSTRUCTION JOINTS PARRALLEL TO DECK FLUTES SHALL BE LOCATED NO CLOSER THAN 5'-0" FROM CENTERLINE OF THE NEAREST GIRDER.
 - CONSTRUCTION JOINTS PERPENDICULAR TO DECK FLUTES SHALL BE LOCATED AT MID-SPAN OF THE METAL DECK SPAN.
 - AT CONTRACTOR'S OPTION, PREFORMED PERMENT METAL SHEAR KEY FOLLOWING CONTOUR OF METAL DECK FLUTES MAY BE USED WITH SLAB REINFORCEMENT STOPPING EACH SIDE AND #3 DOWELS x 2'-0" CENTERED AT 18" o.c.

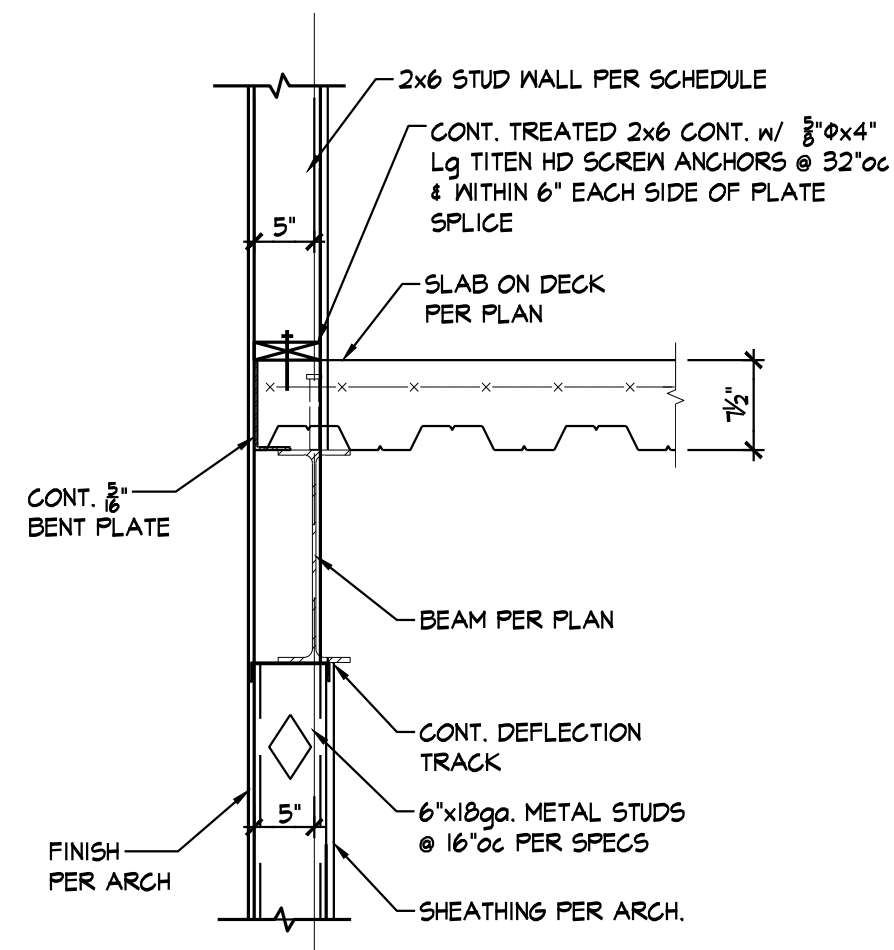


SECTION 1
3/4" = 1'-0" S3.5

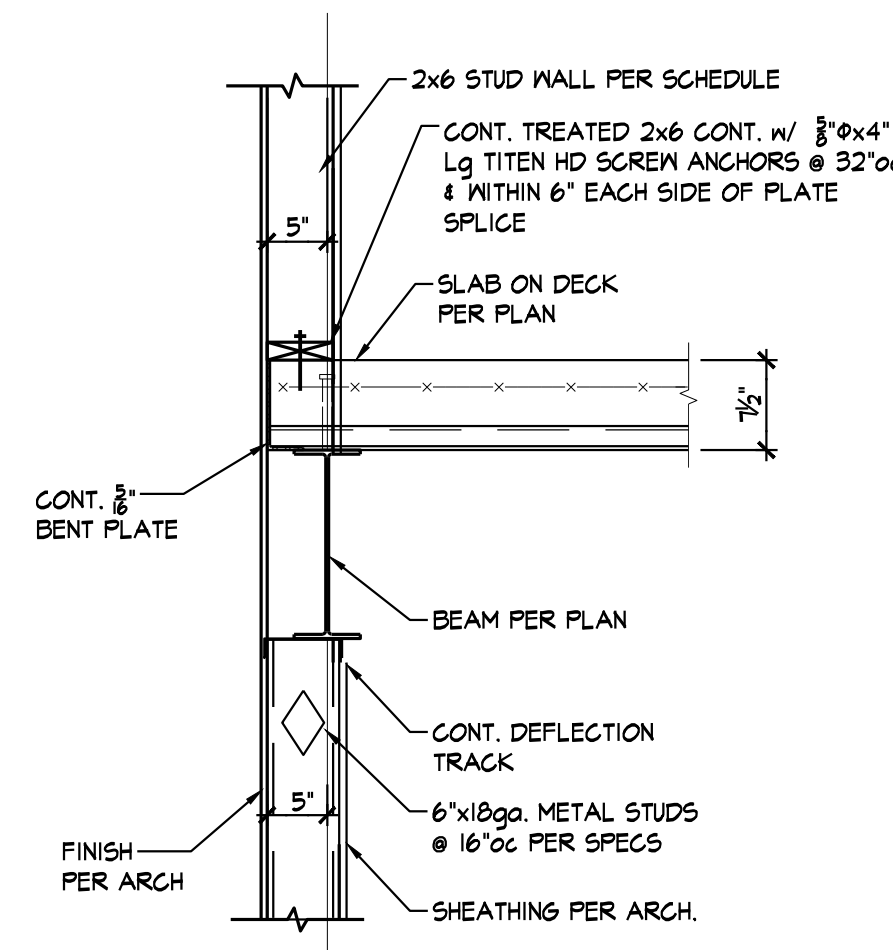


SECTION 2
3/4" = 1'-0" S3.5

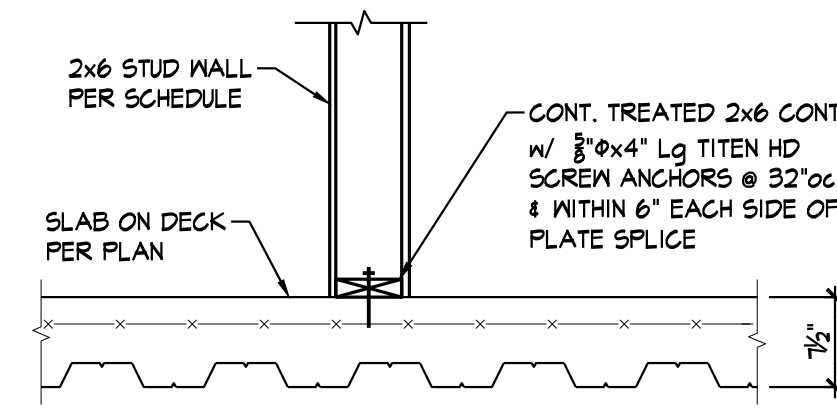


SECTION 3
3/4" = 1'-0" S3.5

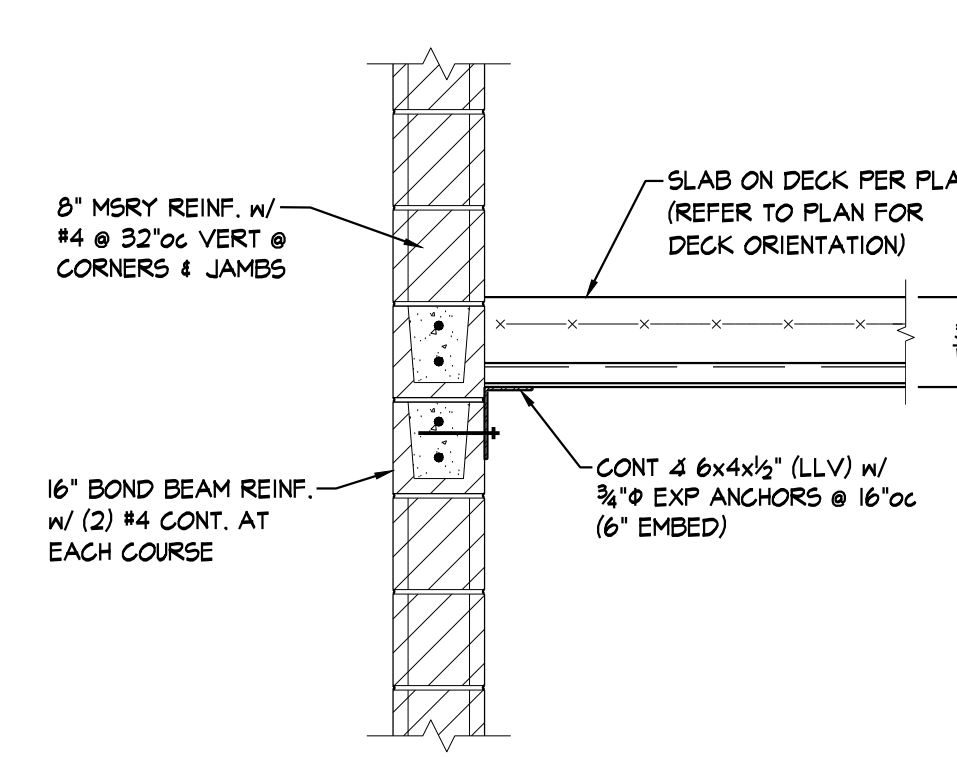


SECTION 4
3/4" = 1'-0" S3.5

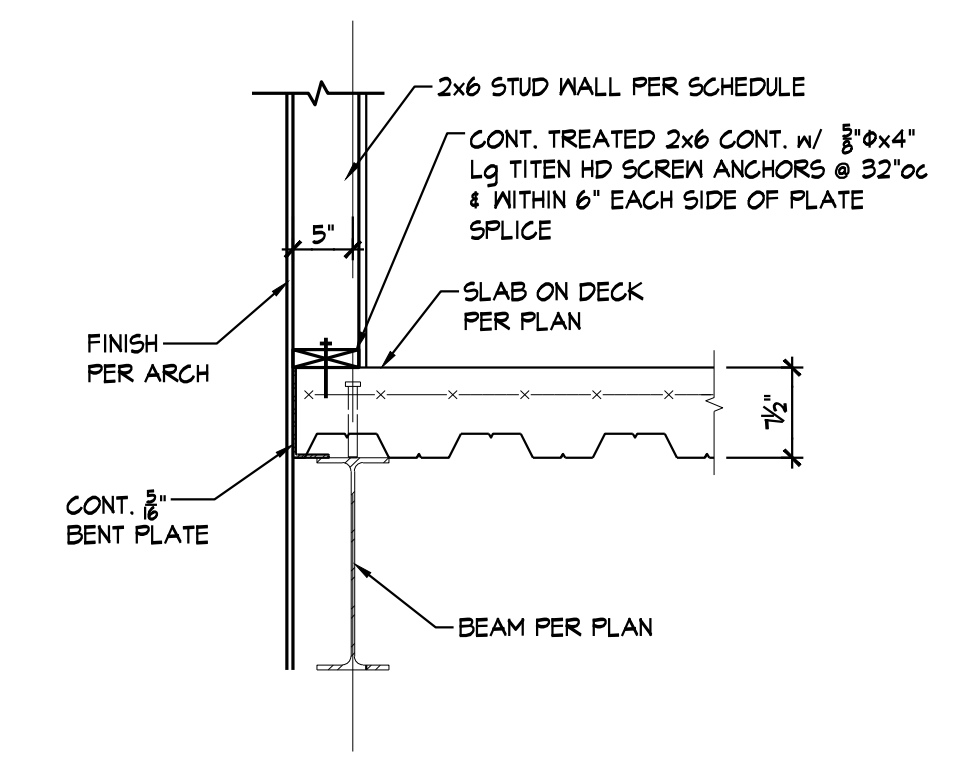


SECTION 5
3/4" = 1'-0" S3.5

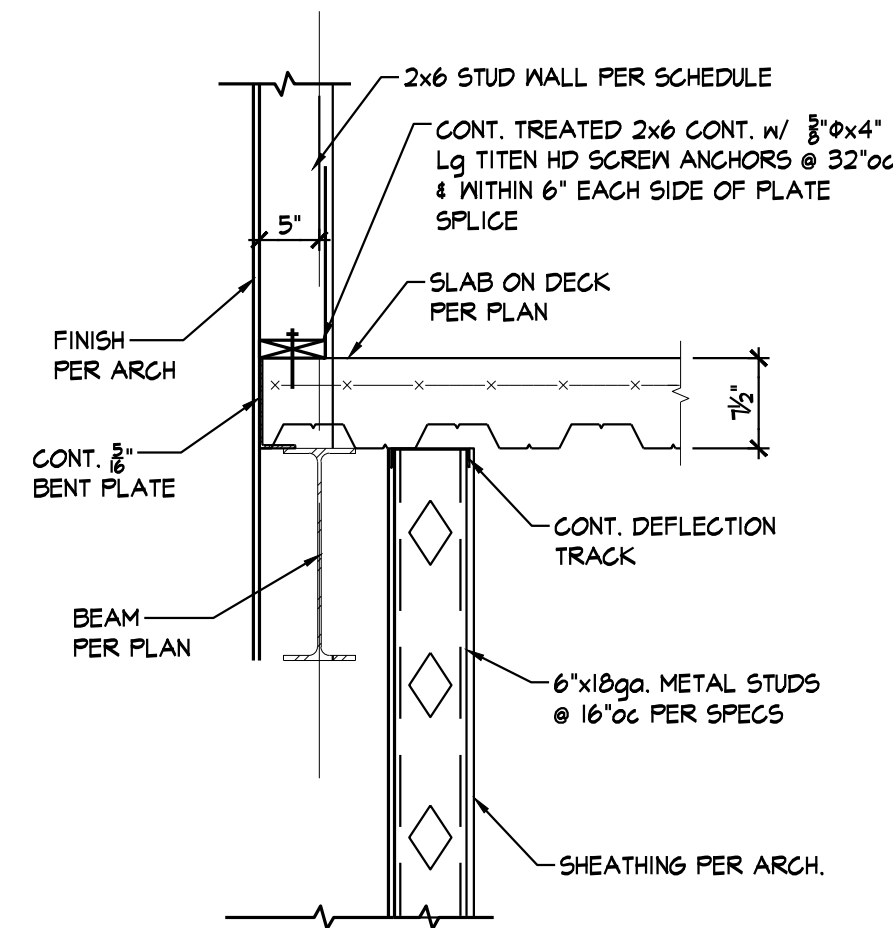


SECTION 6
3/4" = 1'-0" S3.5

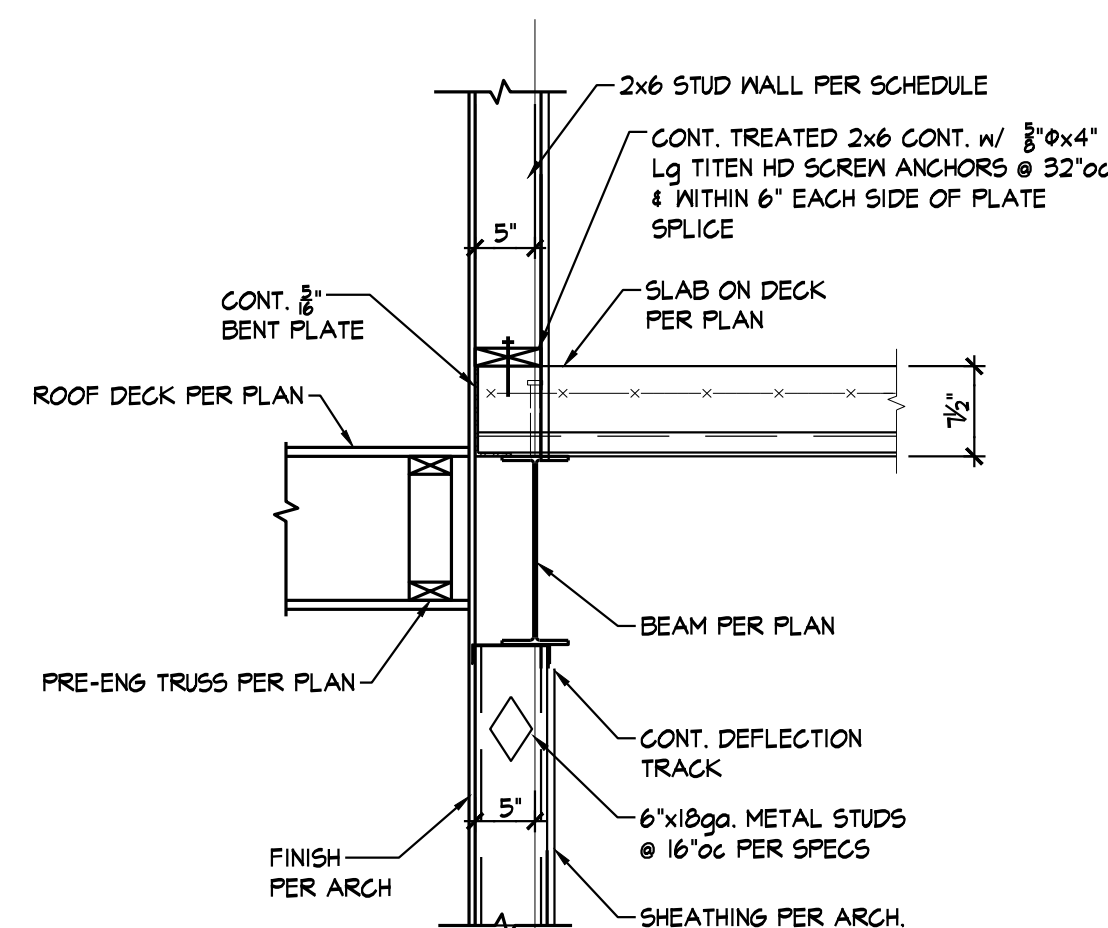

SECTION 7
3/4" = 1'-0" S3.5

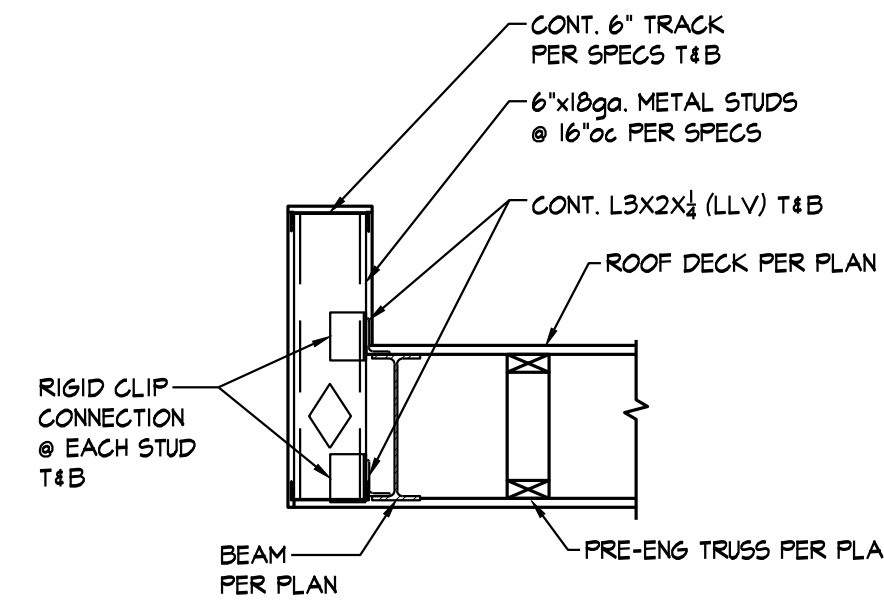


SECTION 8
3/4" = 1'-0" S3.5

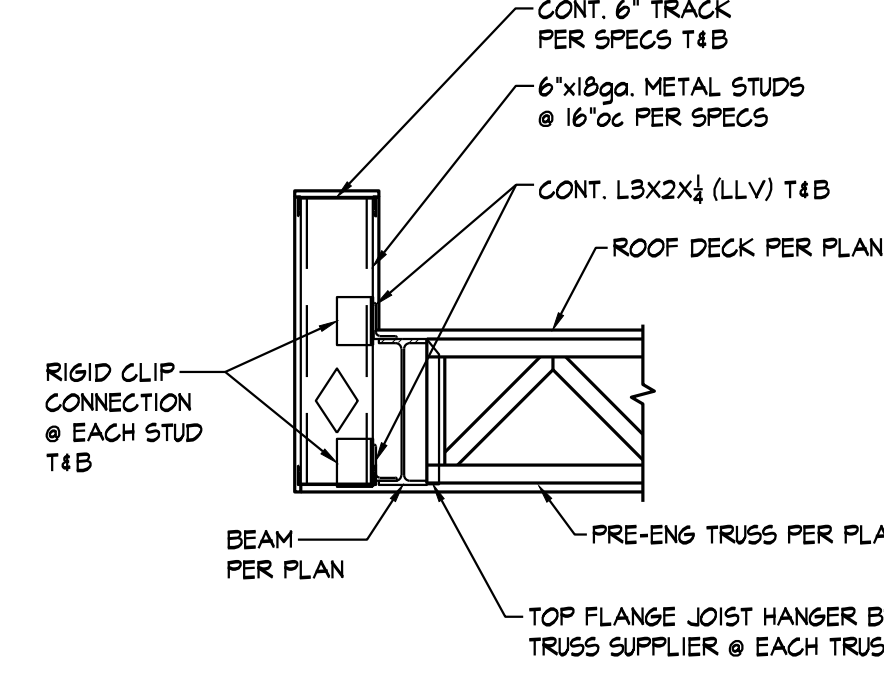


SECTION 9
3/4" = 1'-0" S3.5




REVISION:	
DATE:	4-17-2026
JOB:	25-3465
SHEET NO.:	

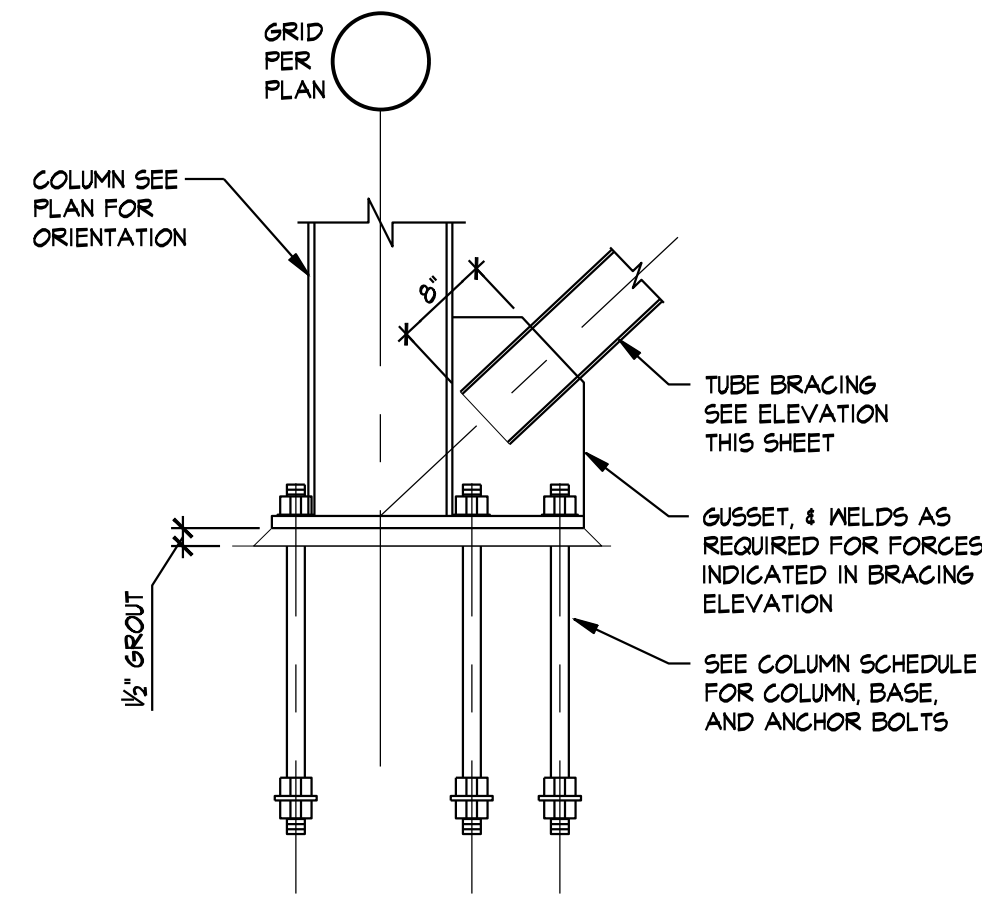


SECTION 1
3/4" = 1'-0" S4.1

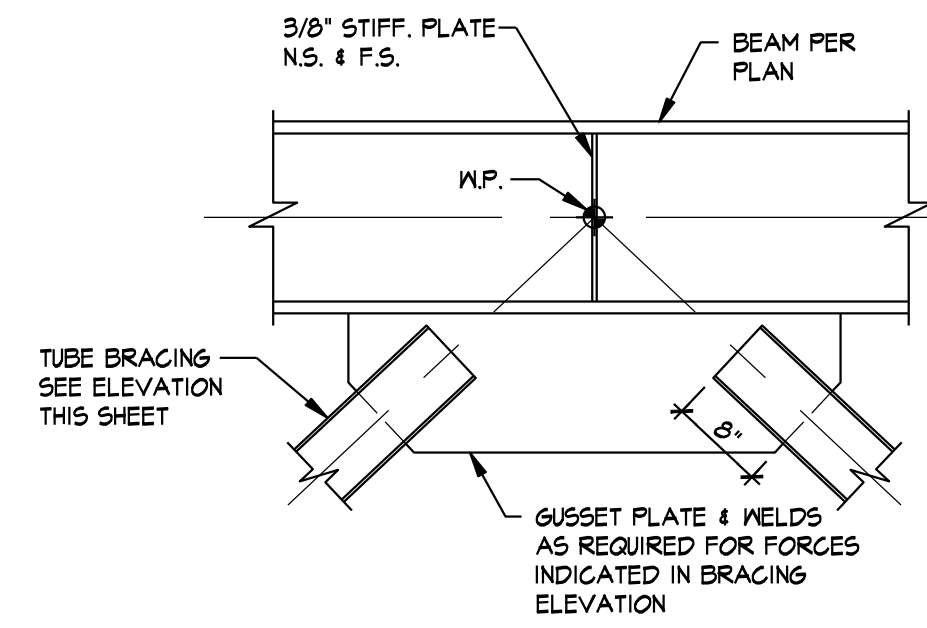


SECTION 2
3/4" = 1'-0" S4.1

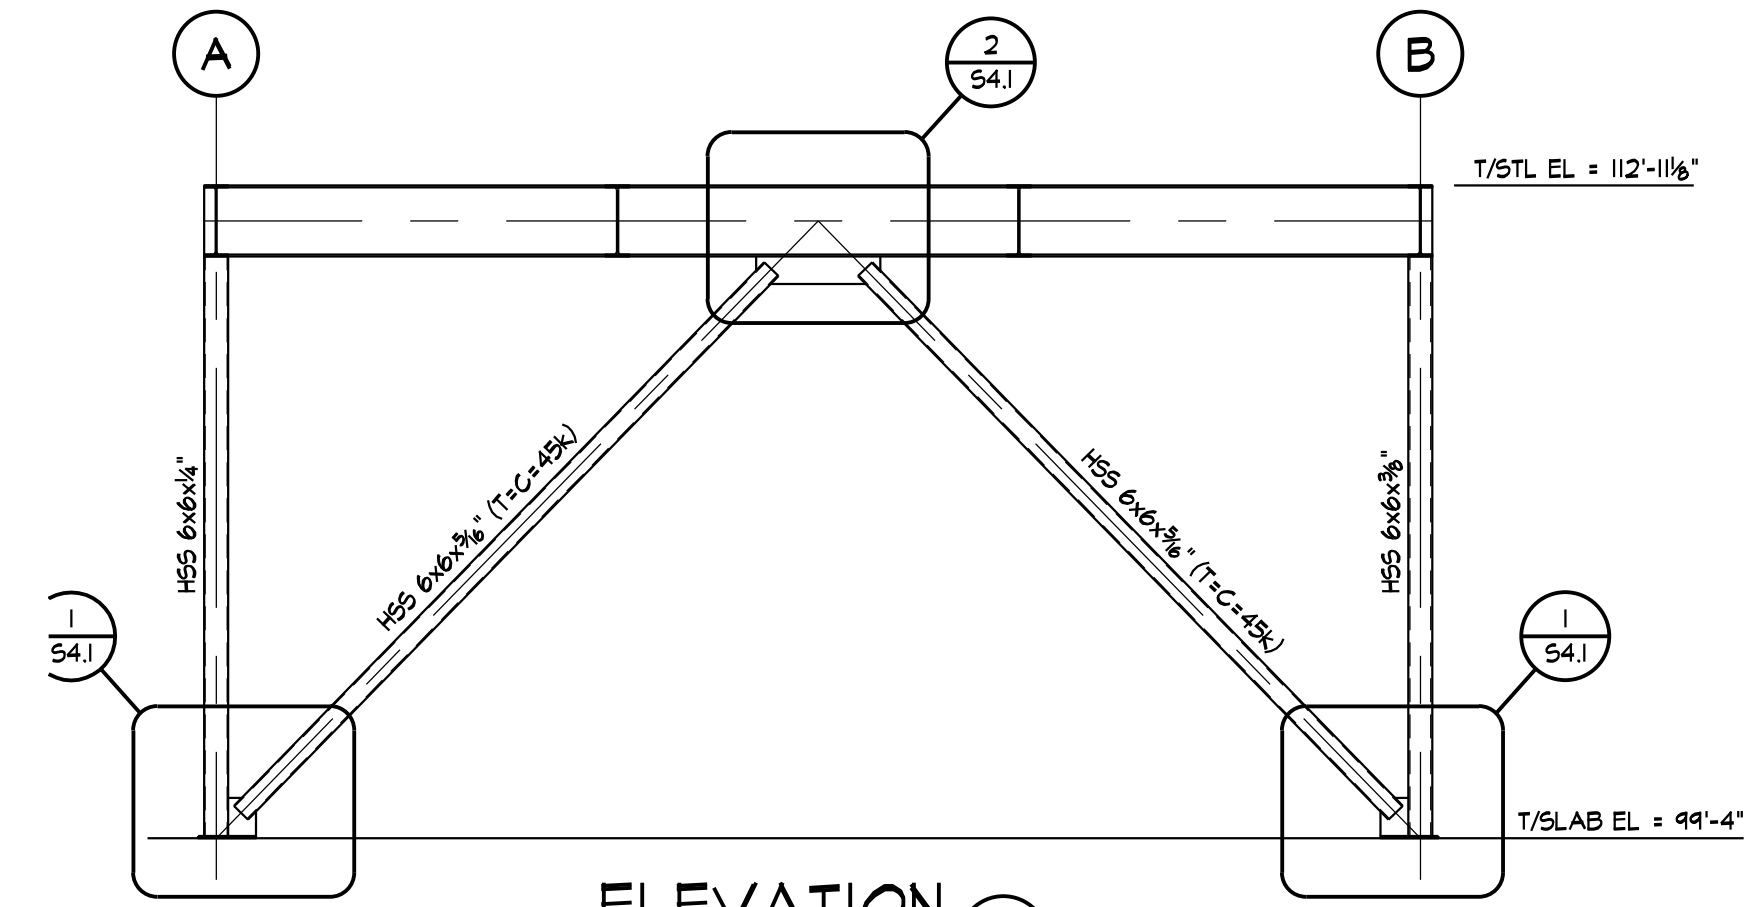


ELEVATION 3
1/4" = 1'-0" S4.1

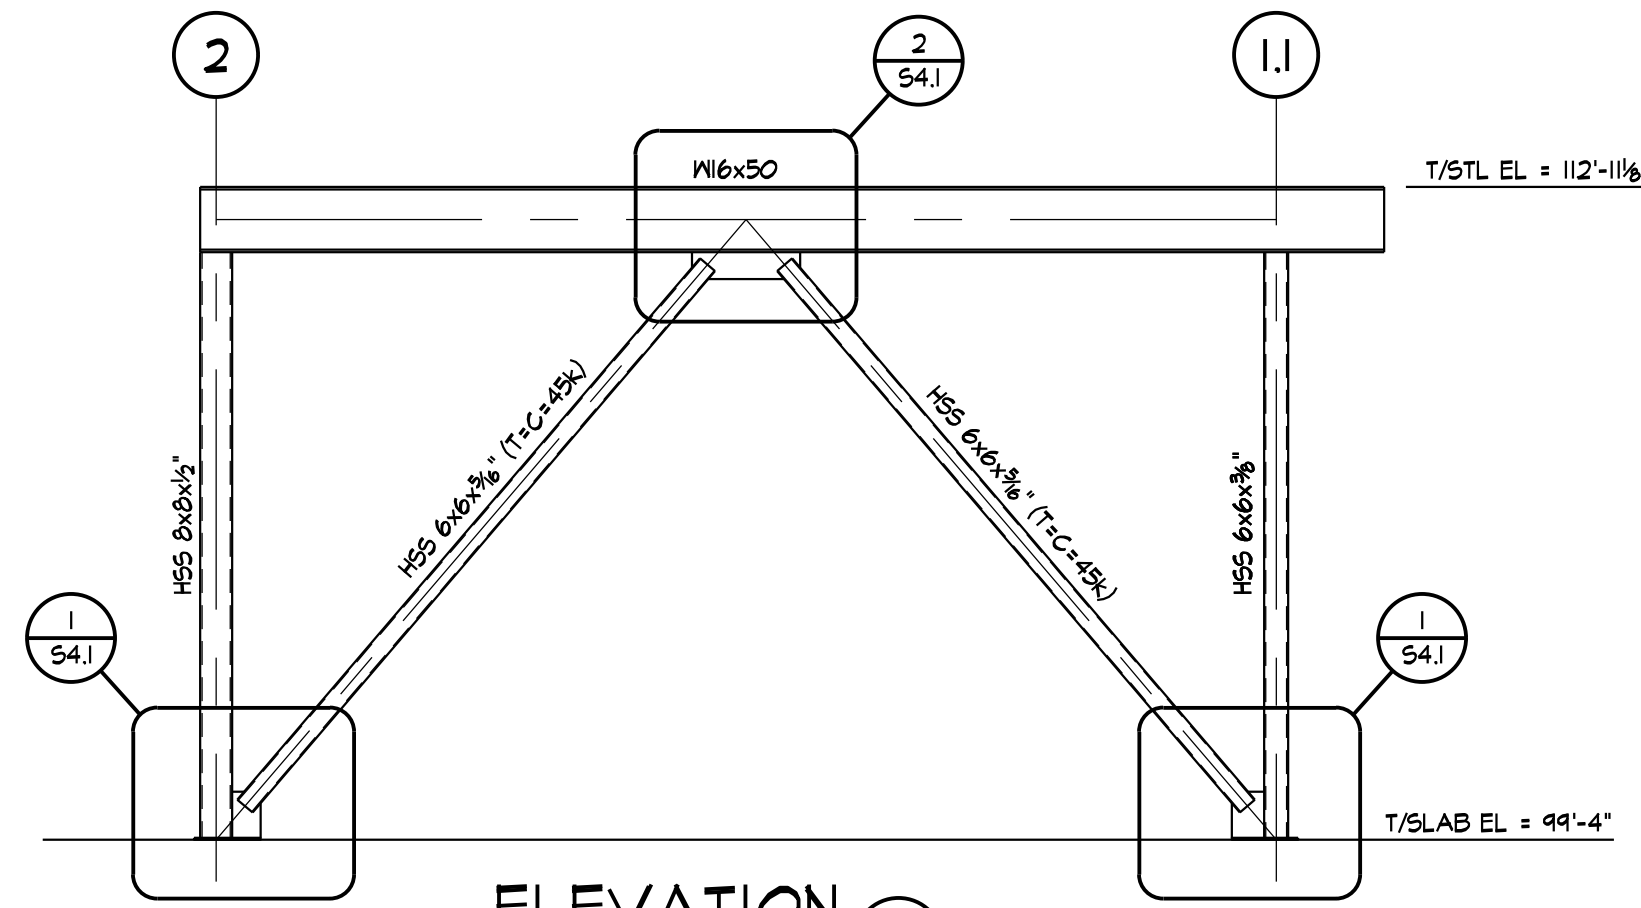

ELEVATION 4
1/4" = 1'-0" S4.1

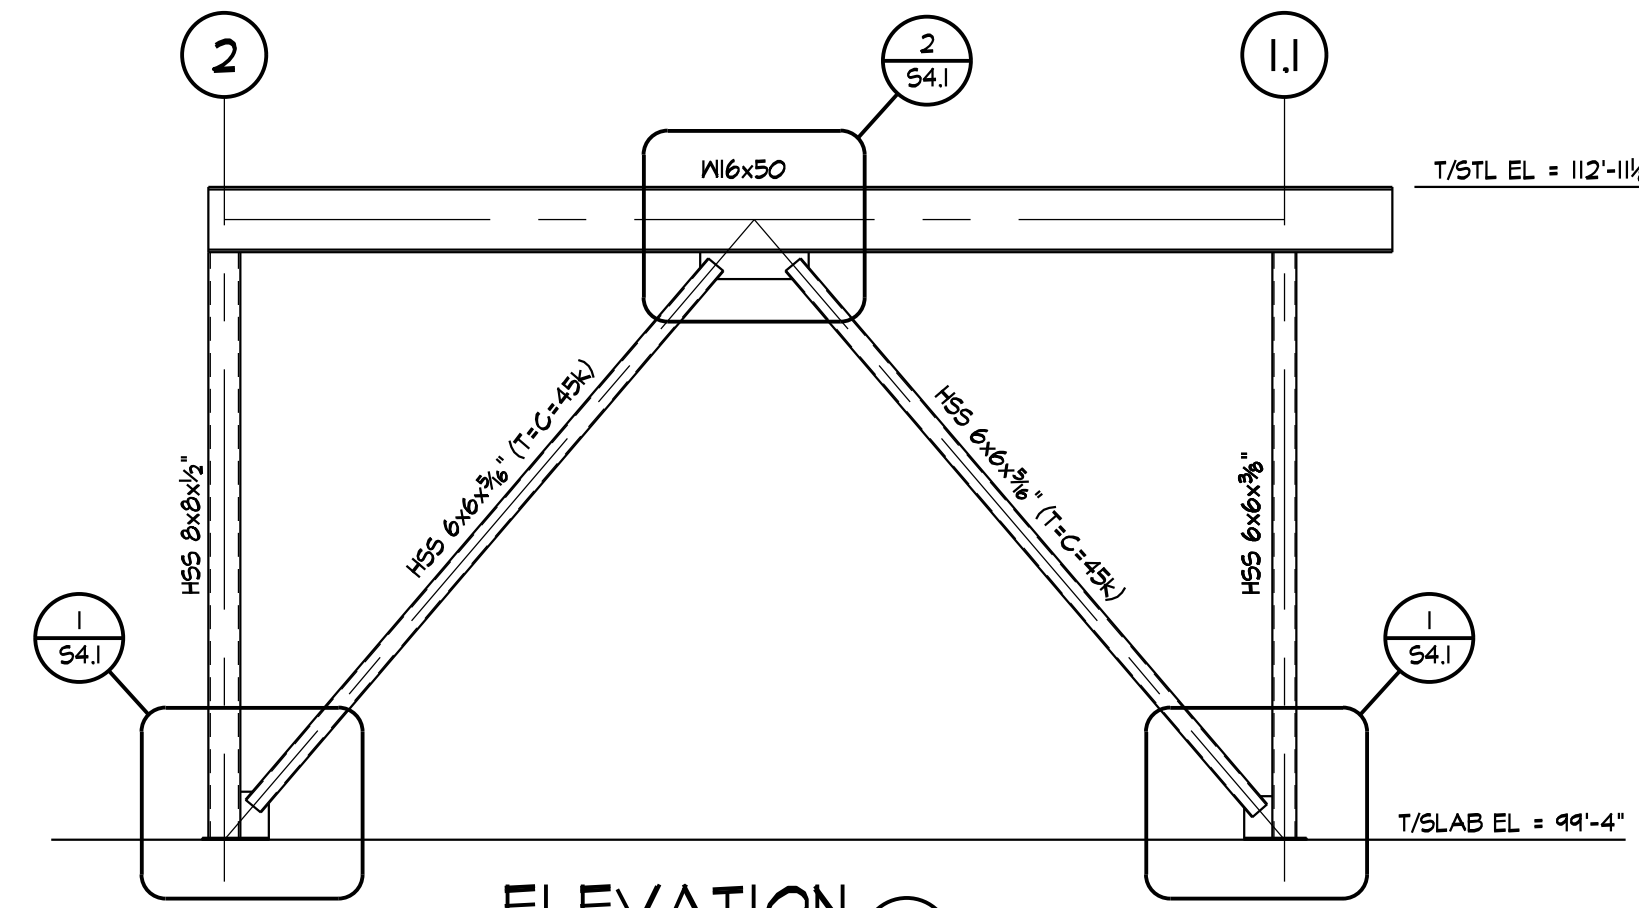

ELEVATION 5
1/4" = 1'-0" S4.1

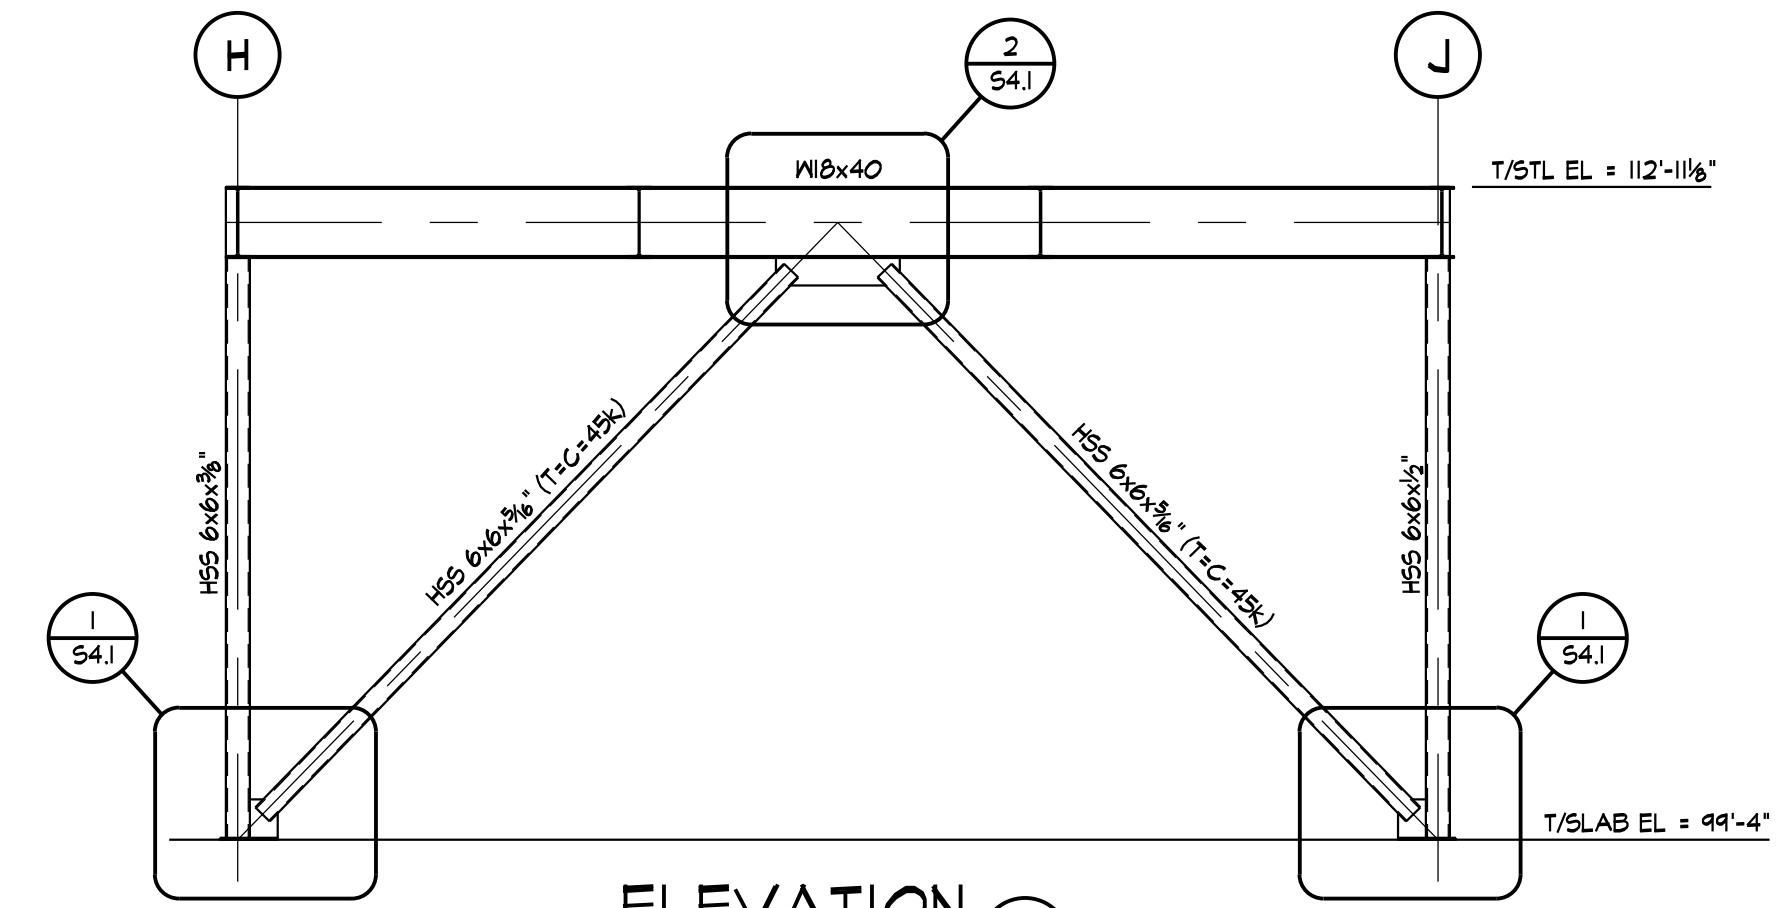

ELEVATION 6
1/4" = 1'-0" S4.1



REVISION:	
DATE:	4-17-2026
JOB:	25-3465
SHEET NO.:	