

- GENERAL NOTES - STRUCTURAL
1. The contractor shall verify dimensions and conditions before construction and notify the engineer of any discrepancies, inconsistencies, or difficulties affecting the work before proceeding.
2. The contractor shall coordinate all disciplines, verifying size and location of all openings, whether shown on structural drawings or not, as called for on architectural drawings, mechanical, electrical drawings. All conflicts, inconsistencies, or other difficulties affecting structural work shall be called to the architect or engineer's attention for direction before proceeding.
3. All design and construction work for this project shall conform to the requirements of the 2024 International Building Code, as amended by the City of Goddard, Kansas.
4. These drawings are for this specific project and no other use is authorized.
5. Structural Design Load Criteria:
- A. Dead Load:
Roofs = 100 psf
Roof/Top Patio = 20 psf
- B. Live Load:
Roofs = 25 psf
Floors = 40 psf
Maintenance Platform = 40 psf
Public = 100 psf
- C. Snow:
 $P_g = 24 \text{ psf}$, $C_e = 1.0$
 $P_F = 20 \text{ psf}$, $P_S = 20 \text{ psf}$, $P_M = 24 \text{ psf}$
 $I_s = 1.0$, $C_s = 1.0$, $C_t = 1.18$
Drift: 6 unbalanced snow loads per ASCE/SEI T-22
- D. Lateral Loads:
1) Wind $V = 110 \text{ mph}$, exposure B, $GCP_i = +/- 1.08$
Design wind pressures to be used for the design of exterior components and cladding materials on the designated zones of walls and roof structures shall be per Section 507.1 and Table 30.1-2 of ASCE/SEI T-10. Tabulated pressures shall be multiplied by effective area reduction factors, exposure adjustment factors, and topographic factors where applicable.
- 2) Seismic: $S_s = 0.12$, $S_1 = 0.08$, $I_e = 1.0$
Site Classification D (Assumed).
Seismic Design Category B.
Basic Seismic Force-Resisting System:
A.I.T. Light-Framed Walls with Shear Panels of All Other Materials
 $R=2$, $\Omega = 2.0$, $C_d = 2.0$, $V = 1.009M$
- E. This project is designed to resist the most critical effects resulting from the load combinations of section 1605.3 of the 2024 International Building Code.

6. Concrete:
- A. All concrete for foundations (walls, grade beams, and footings) shall develop minimum ultimate compressive design strength of 3500 psi in 28 days, but not less than 500 pounds of cement shall be used per cubic yard of concrete regardless of strengths obtained, not over 6 gallons of water per 100 pounds of cement and not over 4 inches of slump.
- B. All concrete for interior flat work shall develop minimum ultimate compressive design strength of 4000 psi in 28 days, but not less than 560 pounds of cement shall be used per cubic yard of concrete regardless of strengths obtained, not over 5 gallons of water per 100 pounds of cement and not over 4 inches of slump.
- C. Concrete for exterior flatwork shall have a minimum design compressive strength of 4500 psi in 28 days, with not less than 560 pounds of cement per cubic yard of concrete, not over 5 gallons of water per 100 pounds of cement, with 6% +/- 1% air entrainment, and a maximum of 4 inches of slump.
- D. The preceding minimum mix requirements may have water-reducing admixtures conforming to ASTM C494 added to the mix at manufacturer's dosage rates for improved workability.
- E. The preceding minimum mix requirements may have up to 15% maximum of the cement content replaced with an approved ASTM C618 Class C fly ash, provided the total minimum cementitious content is not reduced.
- F. All interior concrete slabs on grade shall be placed over 15 mil, Class A Vapor Barrier per ASTM E1745 with less than 0.01 perms, tested after mandatory conditioning. All joints shall be lapped and sealed per manufacturer's recommendations. All penetrations, as well as damaged vapor barrier material shall also be sealed per manufacturer's recommendation prior to concrete placement. Install barrier per manufacturer's recommended details at all discontinuous edges (at interior columns, exterior edge of slab, etc.) to ensure terms of warranty are followed. The vapor barrier shall be placed over free-draining granular material as prescribed by the project soils report.
- G. All concrete is reinforced concrete unless specifically called out as unreinforced. Reinforce all concrete not otherwise shown with same steel as in similar sections or areas. Any details not shown shall be detailed per ACI 318 and meet requirements of ACI 318, current editions.
- H. Contractor shall verify that all concrete inserts, reinforcing and embedded items are correctly located and rigidly secured prior to concrete placement.
- I. Construction joints in beams, slabs, and grade beams shall occur at midspan (middle third) unless noted otherwise. Provide 2 x 4 horizontal keys at construction joints for shear transfer.
- J. No aluminum items shall be embedded in any concrete.

7. Reinforcing Steel:
- A. All reinforcing steel shall conform to the requirements of ASTM A615 or A706 grade 60 steel. Welded plain wire fabric shall be supplied in sheets and conform to the requirements of ASTM A185.
- B. Clear minimum coverage of concrete over reinforcing steel shall be as follows:
- | | |
|-------------------------------|----|
| Concrete placed against earth | 3" |
| Formed concrete against earth | 2" |
| Size | 1" |
| Other | 2" |
- All coverage shall be nominal bar diameter minimum.
- C. All dowels shall be the same size and spacing as adjoining main bars (splice top 48 bar diameters or 30" minimum unless noted otherwise).
- D. At corners of all walls, beams, and grade beams supply corner bars (minimum 2-6" in each direction or 48 bar diameters) to outside face of wall, matching size and spacing of horizontal bars. Where there are no vertical bars in outside face of wall, supply 3 - #4 vertical support bars for corner bars.
- E. Bars marked continuous shall be lapped 48 bar diameters (3'-0" minimum) at splices and embedments, unless shown otherwise. Splice top bars near midspan and splice bottom bars over supports, unless noted otherwise.
- F. Accessories shall be as specified in latest edition of the ACI Detailing Handbook and the concrete Reinforcing Steel Institute Design Handbook. Maximum accessory spacing shall be 4'-0" on center, and all accessories on exposed surfaces are to have plastic coated feet.
- G. All sills and stairs not shown otherwise shall be 6" thick with #4 bars at 12" on center each way.

- B. Structural Steel:
- A. All structural steel beams and columns shall be ASTM A992, grade 50 steel and all miscellaneous steel shall be ASTM A36 grade steel. Hollow Structural Sections (HSS) shall be ASTM A500, grade C. Fabrication and erection shall be in accordance with AISC 305 "Code of Standard Practice for Steel Buildings and Bridges" in the referenced edition of the AISC Steel Construction Manual.
- B. All welding shall conform to the recommendations of the AWS.
- C. All bolts not otherwise specified shall be 3/4" diameter high strength (ASTM A325-N). All bolts shall be fully pretensioned. All beam connections shall be designed per the AISC Manual of Steel Construction "Framed Beam Connections" for 40 kip reactions, and shall account for eccentricity when the bolt line is more than 2" from the center of the support. All connections must be two bolt minimum.
- D. All anchor bolts shall be 3/4" diameter, ASTM F1554, Grade 36 unless noted otherwise.

9. Foundations:
- A. The soil investigation was prepared by Terracon, the report number is 01245160 and their telephone number is 913-442-1111.
- B. Spread footings and continuous wall footings are designed to bear on soil capable of safely sustaining 2500 psf.
- C. Contractor shall provide for dewatering at excavations from either surface water or seepage.
- D. All foundation excavations shall be inspected by a qualified soil engineer, approved by the architect and/or structural engineer, prior to placement of steel or concrete. This inspection shall be at the owner's expense.
- E. Moisture content in soils beneath building locations should not be allowed to change after footing excavations and after grading for slabs on grade are completed. If subgrade materials become desiccated or softened by water or other conditions, recompact materials to the density and water content specified for engineered fill. Do not place concrete on frozen ground.

10. Concrete Block Masonry
- A. Concrete block used in exterior walls or load bearing walls shall meet the requirements of ASTM C90 and have a minimum net compressive strength of 2150 psi and laid up using type N mortar such that f_m equals 1500 psi. Mortar shall be volume proportion based cement:lime mortar. Proportioning shall be completed by box measure. Any block in contact with earth shall be normal weight units, laid using type "S" mortar and grouted solid.
- B. The contractor shall provide adequate temporary bracing for all masonry walls during construction.
- C. All concrete block shall have F gage (or larger) horizontal joint reinforcing (ladder or truss) per architectural drawings and specifications (6" maximum vertical spacing).
- D. Concrete block shall be reinforced as follows in 8" walls unless noted otherwise:
- 1) Vertical reinforcing shall be a minimum of 1 - #4 bar in 8" walls at 4'-0" on center, at each corner, at each door and window joint, each side of control joint and in the end and void of each length of wall. Lap splices for masonry vertical reinforcing shall be 48 bar diameters or 24" minimum.
 - 2) Horizontal reinforcing:
 - A) Horizontal joint reinforcing as noted above.
 - B) Continuous horizontal bars shall be included per section or detail in bond beam or optional running bond beam where noted. Where bond beams are continuous at corners of walls, supply corner bars matching size of horizontal bars (minimum 2'-0" or 40 bar diameters in each direction).
- E. Grout, where noted above, shall have a minimum design ultimate compressive strength of 2500 psi at 28 day test and 3/8" maximum aggregate size.
- F. Lintels over all openings in walls not otherwise covered shall be an 8" x 8" bond beam with 2 - #6 bars in the bottom of the bond beam.

11. Post-Installed Anchors:
- A. Post-installed anchors shall be used only where specified on the drawings unless approved in writing by the engineer of record. See drawings for anchor diameter, spacing and embedment. Performance values of the anchors shall be obtained for specified products using appropriate design procedures and/or standards as required by the governing building code. Anchors installed in concrete shall have an ICC-ES Evaluation Service Report. Special inspection is required for all post-installed anchors.
- B. Mechanical anchors used in cracked and uncracked concrete shall have been tested and qualified for use in accordance with ACI 308.2 and ICC-ES AC108.3. All anchors shall be installed per the anchor manufacturer's written instructions.
- C. Adhesive anchors used in cracked and uncracked concrete shall have been tested and qualified for use in accordance with ICC-ES AC308. All anchors shall be installed per the anchor manufacturer's written instructions.

12. Cold-Formed Metal Framing
- A. All cold formed structural studs, track, and bridging shall be of the type, size, gauge and spacing as shown on the drawings, minimum.
- B. All materials shall be 33,000 psi minimum yield, except studs of 16 gauge or heavier shall have a minimum yield of 50,000 psi.
- C. All properties, fabrication, and erection shall be in accordance with latest editions of the AISI "Specification for the Design of Cold-Formed Structural Members".
- D. All framing components shall be cut squarely or at an angle to fit squarely against abutting members. Splicing of axially loaded members is not permitted. Members shall be held firmly in place until properly fastened. Attachments of similar components shall be by welding, screw attachment, or bolting. Wire tying of components is not permitted.
- E. Tracks shall be securely anchored to floor and overhead members. Special anchorage requirements required for wind bracing shall be as shown on the plans.
- F. Prior to fabrication and/or erection, the contractor shall submit shop drawings complete with details of erection, fabrication, attachments, anchorages, lintels, etc. for review by the architect/engineer.

13. Timber and Wood Framing:
- A. Quality and construction of wood framing members and their fasteners for load supporting purposes not otherwise indicated on the drawings shall be in accordance with the 2024 International Building Code.
- B. All studs and top and bottom plates shall be Douglas Fir No. 2 grade visually graded lumber, with an allowable fiber stress in bending of 400 psi minimum and an elastic modulus of 1,600,000 psi unless noted otherwise. All joist, truss members and headers prior to placement of steel or concrete (unless noted otherwise).
- C. Bridging of stud bearing walls and shear walls shall be solid, matching sheathing joints.
- D. Joist blocking and bridging shall be solid wood or cross bridging of either wood or metal straps. Spacing in any case, shall not exceed 8'-0".
- E. Wood members and sheathing shall be fastened with number and size of fasteners not less than that set forth in Table 2304.9.1 of the 2024 International Building Code. Floor sheathing shall be APA rated tongue and groove Surod-Floor, exposure 1, glued and nailed with 10d nails or #10 screws at 6" on center to supports at edges and 12" on center field. Sheathing of shear walls or roof diaphragms shall be edge nailed with bd common nails at 6" on center and nailed to intermediate framing and/or blocking members with bd common nails at 12" on center unless otherwise noted on the drawings.
- F. Sill plates shall be bolted to concrete slabs with 1/2" diameter bolts at 32" on center (N/A). Re. shearnail sched. Provide plate washers at sill plate anchors for shearnails per shearnail sched. Plates in direct contact with concrete or masonry shall be treated lumber.
- G. All hangers, ties and connections shown are based on Simpson Strong Tie as the basis of design, provide Simpson Strong Tie or an approved equal. Joist hangers shall be equal to "LUS" for wood application and "LB" for steel weld-on application. Roof truss ties shall be equal to "H25A" and tie the roof truss to the top plate (provide 2) "H25A" diagonally across from each other when uplift load shown in truss shop submittal exceeds 600lbs). Roof girder ties shall be equal to a "LG12", "LG13" or "LG14" tie (dependent on number of plies) and tie the truss girder to the top plate. Provide "H4" at the top of each stud to top track when the top track has roof truss attached. Service condition - dry with moisture content at or below 19% in service.

- I. Laminated strand lumber (LSL) shall have an allowable flexural stress (Fb) of 1,700 psi (reduced by size factor) and an elastic modulus (E) of 1,300,000 psi.
- J. Laminated veneer lumber (LVL) shall have an allowable flexural stress (Fb) of 2,600 psi (reduced by size factor) and an elastic modulus (E) of 1,600,000 psi.
- K. Parallel Strand Lumber (PSL) shall have an allowable flexural stress (Fb) of 2,900 psi (reduced by size factor) and an elastic modulus (E) of 2,000,000 psi. (E) = 2,000,000 psi for members > 18")
- L. Pre-engineered wood trusses shall be designed in accordance with the Truss Plate Institute's national design standard for metal-plate connected wood truss construction (ANSI/TPI-1 latest edition). Trusses shall be designed and manufactured by an authorized member of the Wood Truss Council of America (WTCOA). Truss design shall conform to specified codes, allowable stress increases, deflection limitations and other applicable criteria of the governing code.
- M. Truss shop drawings showing complete erection and fabrication details and calculations (including connections) shall be submitted to the project architect / engineer for review prior to fabrication and/or erection. Calculations shall bear the seal of a professional engineer, registered in the state of the project location. Shop drawings shall also be submitted to the local government controlling agency when requested by that agency.
- N. All trusses shall be securely braced both during erection and permanently, as indicated on the approved truss design drawings and in accordance with TPI's commentary and recommendations for handling, installing and bracing metal-plate connected wood trusses (H18-1, booklet) and the latest edition of ANSI/TPI-1.
- O. The truss manufacturer shall supply all hardware and fasteners for joining truss members together and fastening truss members to their supports. Metal connector plates shall be manufactured by a member of the Wood Truss Council of America (WTCOA) and shall be 20 gauge minimum. Connector plates shall meet or exceed ASTM A653, grade 33, with ASTM A424 galvanized coating designation 560.
- P. Provide truss space directly above and centered over HVAC closets. Refer to Architectural and MEP drawings for exact locations.
- Q. Shipment, handling and erection of trusses shall be by experienced, qualified persons and shall be performed in a manner so as not to endanger life or property. Apparent truss damage shall be reported to the truss manufacturer for evaluation prior to erection. Cutting or alteration of trusses is not permitted.
- R. Pre-Engineered Floor Trusses Design Criteria:
Top Chord Dead Load = 30 psf
Top Chord Live Load = Per General Note 5B
Bottom Chord Dead Load = 10 psf
Live Load Deflection = L/480 (1/2" max)
Total Load Deflection = L/360
Refer to Sheet 52.4 for 4th floor roof & exterior deck load criteria.
- S. Roof Truss Design criteria:
Top Chord Dead Load = 10 psf
Top Chord Live Load = 25 psf (100 psf at Rooftop mech. zones)
Top Chord Snow Load = 20 psf or 14 psf plus Drift
Bottom Chord Dead Load = 10 psf
Bottom Chord Live Load = 5 psf
Live Load Deflection = L/360
Total Load Deflection = L/300
Refer to Sheet 52.4 for 4th floor roof & exterior deck load criteria.
- T. Roof trusses shall be designed per IBC 2024 for net uplift resulting from wind loading as calculated using components and cladding loading.
- U. Construction bracing shall be provided by the contractor as required to keep the building and studs plumb.
- V. Structural members shall not be cut for pipes, etc., unless specifically detailed. Notching and boring of studs and top of plates shall conform to the provisions of section 2308.9.1.0 and 2308.9.1.1 of the IBC. Where top plates or sole plates are cut for pipes, a metal tension tie with minimum 0.026 inches thick and 1/2" inches wide shall be fastened to each plate across and to each side of the opening with not less than (6) 16d nails, in accordance section 2308.9.2 of the IBC.
- W. All fasteners for wood to wood connections and wood connections shall be as indicated in structural drawings or manufacturer literature to achieve full capacity of connector. Alternate fasteners may be submitted as a substitution request. Submittal must show that alternative fasteners will not reduce the capacity of the connection.

14. Shop Drawing Review:
- A. Bob D. Campbell and Company, Inc., will review the General Contractor's (GC) shop drawings and related submittals (as indicated below) with respect to the ability of the detailed work, when complete, to be a properly functioning integral element of the overall structural system designed by Bob D. Campbell and Company, Inc.
- B. Prior to submittal of a shop drawing or any related material to Bob D. Campbell and Company, Inc., the GC shall:
- 1) Review each submission for conformance with the means, methods, techniques, sequences and operations of construction and safety precautions and programs indicated thereto, all of which are the sole responsibility of the GC.
 - 2) Review and approve each submission.
 - 3) Stamp each submission as approved.
- C. Bob D. Campbell and Company, Inc. shall assume that no submission comprises a variation unless the GC advises Bob D. Campbell and Company, Inc. with written documentation.
- D. Shop drawings and related material (if any) required are indicated below. Should Bob D. Campbell and Company, Inc. require more than ten (10) working days to perform the review, Bob D. Campbell and Company, Inc. shall so notify the GC.
- 1) Concrete mix designs and material certificates including admixtures and compounds applied to the concrete after placement.
 - 2) Reinforcing steel shop drawings including erection drawings, nail elevations (include all mesh openings) and bending details. Bar list will not be reviewed for correct quantities.
 - 3) Structural steel shop drawings including erection drawings and piece details. Include connection submittals and miscellaneous framing.
 - 4) Miscellaneous anchors shown on the structural drawings.
 - 5) Wood truss design calculations and detailed erection and fabrication drawings. Standard stick framing shop drawings need not be submitted.
 - 6) Construction and control joint plans and/or elevations.
- E. Bob D. Campbell and Company, Inc. shall review shop drawings and related materials with comments provided that each submission has met the above requirements. Bob D. Campbell and Company, Inc. shall return without comment unrequired material or submissions without GC approval stamp.

15. Structural Special Inspection:
- A. The structural design for this project is based on completion of special inspections during construction in accordance with chapter 17 of the 2024 International Building Code. The owner shall employ one or more qualified special inspectors to provide the required special inspections.
- B. Special inspections shall be required for the items indicated below. The General Contractor shall provide notification to the inspector when items requiring inspection are ready to be inspected and provide access for those inspections.
- 1) Placement of Concrete
 - 2) Testing of Concrete
 - 3) Bolts in Concrete
 - 4) Placement of Reinforcing Steel
 - 5) Verification of Soil Bearing Capacities
 - 6) High Strength Bolting
 - 7) Drill & Epoxy Bolts
 - 8) Structural Welding
 - 9) Shear wall installation
 - 10) Post-Installed Anchors
 - 11) Wood shear walls and holdowns
 - 12) Wood gravity framing and placement
- C. The special inspector shall furnish inspection reports to the building official, owner, architect and structural engineer, and any other designated person.
- D. All discrepancies shall be brought to the immediate attention of the contractor for correction, then, if uncorrected, to the proper design authority, building official and structural engineer.
- E. The special inspector shall submit a final signed report stating that the work requiring special inspection was, to the best of the inspector's knowledge in conformance with the approved plans and specifications and the applicable workmanship provisions of the building code.

16. Copyright and Disclaimer:
- A. All drawings in the structural set (5-series drawings) are the copyrighted work of Bob D. Campbell and Company, Inc. These drawings may not be photographed, traced, or copied in any manner without the written permission of Bob D. Campbell and Company, Inc. Exception: Original drawings may be printed for distribution to the owner, architect, and general contractor for coordination, bidding, and construction. Subcontractors may not reproduce these drawings for any purpose or in any manner.
- B. 1. Ryan M. Hagedorn, P.E., registered engineer and a representative of Bob D. Campbell and Company, Inc., do hereby accept professional responsibility as required by the professional registration laws of this state for the structural design drawings consisting of 5-series drawings. I hereby disclaim responsibility for all other drawings in the construction document package, they being the responsibility of other design professionals whose seals and signed statements may appear elsewhere in the construction document package.

NAILING SCHEDULE (REFER TO NOTES #1 and #2)			
CONNECTION		ATTACHMENTS (REF NOTE #3 and #4)	
1	JOIST TO SILL OR GIRDER	3- 3" x 0.131" NAILS-TOENAIL	3-8d NAILS-TOENAIL
2	BRIDGING TO JOIST	2- 3" x 0.131" NAILS-TOENAIL EACH END	2-8d NAILS-TOENAIL EACH END
3	SOLE PLATE TO JOIST OR BLOCKING & TRUSS TO TOP P	3" x 0.131" NAILS AT 8"o.c.-TYPICAL FACE NAIL 4-3" x 0.131" NAILS AT 16"o.c.-BRACED WALL PANELS	16d BOX NAILS AT 16"o.c. MAX. FACE NAILING 3-16d BOX NAILS AT 16"o.c. BRACED WALL PANEL
4	TOP PLATE TO STUD	3- 3" x 0.131" NAILS-END NAIL	2-16d NAILS-END NAIL
5	STUD TO SOLE PLATE	4- 3" x 0.131" NAILS-TOENAIL OR 3- 3" x 0.131" NAILS-END NAIL	4-8d NAILS-TOENAIL OR 2-16d NAILS-END NAIL
6	DOUBLE STUDS	3" x 0.131" NAILS AT 8"o.c.-FACE NAIL	16d BOX NAILS AT 24"o.c. MAX. FACE NAIL
7	DOUBLED TOP PLATES	3" x 0.131" NAILS AT 12"o.c.-FACE NAIL	16d BOX NAILS AT 16"o.c. MAX. FACE NAIL
8	DOUBLE TOP PLATE LAPS AND INTERSECTIONS	12-3" x 0.131" NAILS	8-16d NAILS
9	BLOCKING BETWEEN JOISTS OR RAFTERS TO TOP PLATE	3-3" x 0.131" NAILS -TOENAIL	3-8d NAILS-TOENAIL
10	RIM JOIST TO TOP PLATE	3" x 0.131" NAILS AT 6"o.c.-TOENAIL	10d NAILS AT 6"o.c. MAX.-TOENAIL
11	TOP PLATE LAPS AND INTERSECTIONS	3- 3" x 0.131" NAILS-FACE NAIL	2-16d NAILS-FACE NAIL
12	CONTINUOUS HEADER, TWO PIECES	3" x 0.131" NAILS AT 10"o.c. ALONG EACH EDGE	16d NAILS AT 16"o.c. MAX. ALONG EACH EDGE-TOENAIL
13	CEILING JOISTS TO PLATE	5- 3" x 0.131" NAILS-TOENAIL	3-8d NAILS-TOENAIL
14	CONTINUOUS HEADER TO STUD	4- 3" x 0.131" NAILS-TOENAIL	4-8d NAILS-TOENAIL
15	CEILING JOISTS, LAPS OVER PARTITIONS	4- 3" x 0.131" NAILS-FACE NAIL	3-16d NAILS-FACE NAIL
16	CEILING JOISTS TO PARALLEL RAFTERS	4- 3" x 0.131" NAILS-FACE NAIL	3-16d NAILS-FACE NAIL
17	RAFTER TO PLATE	3- 3" x 0.131" NAILS-TOENAIL	3-8d NAILS-TOENAIL
18	1" BRACE TO EACH STUD AND PLATE	2- 3" x 0.131" NAILS-FACE NAIL	2-8d NAILS-FACE NAIL
19	BUILT-UP CORNER AND MULTIPLE STUDS	3" x 0.131" NAILS AT 16"o.c.	16d NAILS AT 24"o.c. MAX.
20	BUILT-UP GIRDER AND BEAMS	3" x 0.131" NAILS AT 24"o.c. FACE NAILED TOP AND BOTTOM STAGGERED ON OPPOSITE SIDES 3- 3" x 0.131" NAILS AT ENDS AND EACH SPLICE	20d NAILS AT 32"o.c. MAX. TOP AND BOTTOM, STAGGERED ON OPPOSITE SIDES 2-20d NAILS AT ENDS AND EACH SPLICE
21	BUILT-UP LAMINATED VENEER LUMBER BEAMS	3" x 0.131" NAILS AT 6"o.c. TOP AND BOTTOM ALONG EDGE	16d NAILS AT 12"o.c. TOP AND BOTTOM ALONG EDGE
22	2" PLANKING	4- 3" x 0.131" NAILS AT EACH SUPPORT	16d NAILS AT EACH SUPPORT
23	RIM BOARD TO TRUSS	2 - 3" x 0.131" FACE NAILS (17/16 TRUSS)	2-10d NAILS - FACE NAILS (17/16 EA TRUSS)
24	BUILT-UP STUD PACK COLUMNS	REFER TO DETAIL 6/5.1	REFER TO DETAIL 6/5.1

- NOTES:
- 1) ALL NAILS SHALL BE AS NOTED UNLESS OTHERWISE SPECIFIED ON STRUCTURAL DRAWINGS OR ALTERNATE PROVIDED BY ENGINEER IN WRITING.
 - 2) CONDITIONS NOT SPECIFIED SHALL BE IN ACCORDANCE WITH CURRENT INTERNATIONAL BUILDING CODE.
 - 3) NAILING DESIGNATION:

4- 3" x 0.131" NAILS

DIAMETER IN INCHES

— NAIL LENGTH

— QUANTITY
 - 4) ALL NAILS NOTED AS 8d, 10d, 16d, ETC. SHALL BE COMMON NAILS UNLESS NOTED BOX.
 - 5) REFER TO SHEARMALL SCHEDULE FOR ADDTL NAILING REQUIREMENTS


THE RESERVES AT MEADOWS 25

NEW APARTMENTS

GODDARD,

KANSAS

JonesGillamRenz
730 N. Ninth 1881 Main Street, Suite 301
Salina, KS 67401 Kansas City, MO 64108
785.827.0386
jgr@jgrarchitects.com

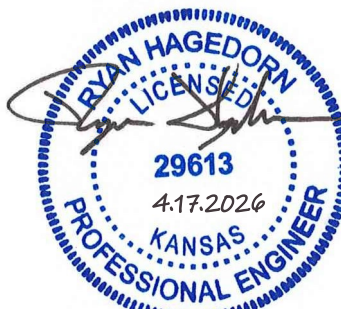

REVISION:

DATE: 4-17-2026

JOB: 25-3465

SHEET NO.:

S0.1

BOB D. CAMPBELL & CO.
Structural Engineers Since 1957
4338 Bellevue Ave. 816.531.4144
Kansas City, MO 64111 www.bdc-engrs.com




REVISION:


DATE: 4-17-2026

JOB: 25-3465


SHEET NO.:

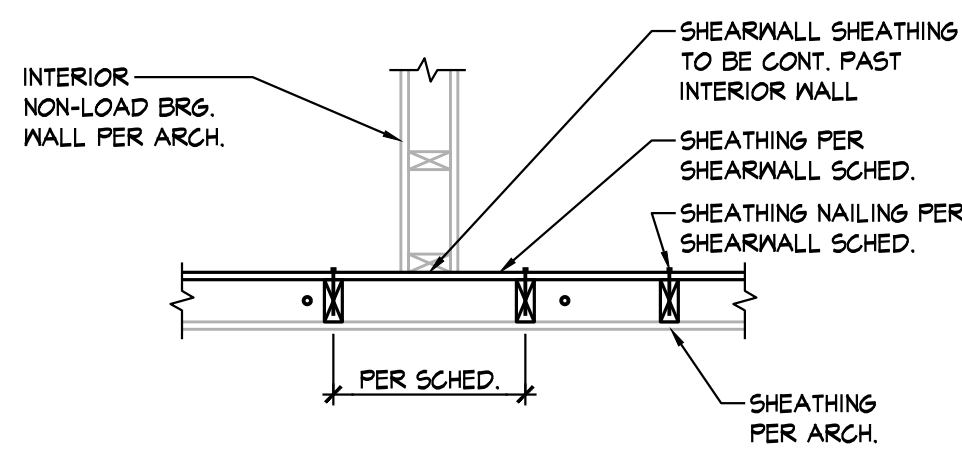


SECTION 4B
3/4" = 1'-0" S1.2

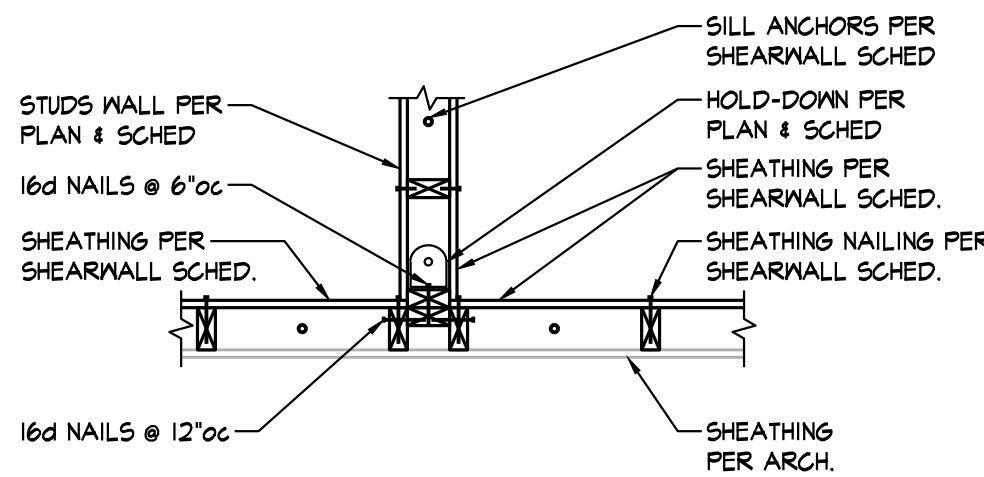


SECTION 4A
3/4" = 1'-0" S1.2

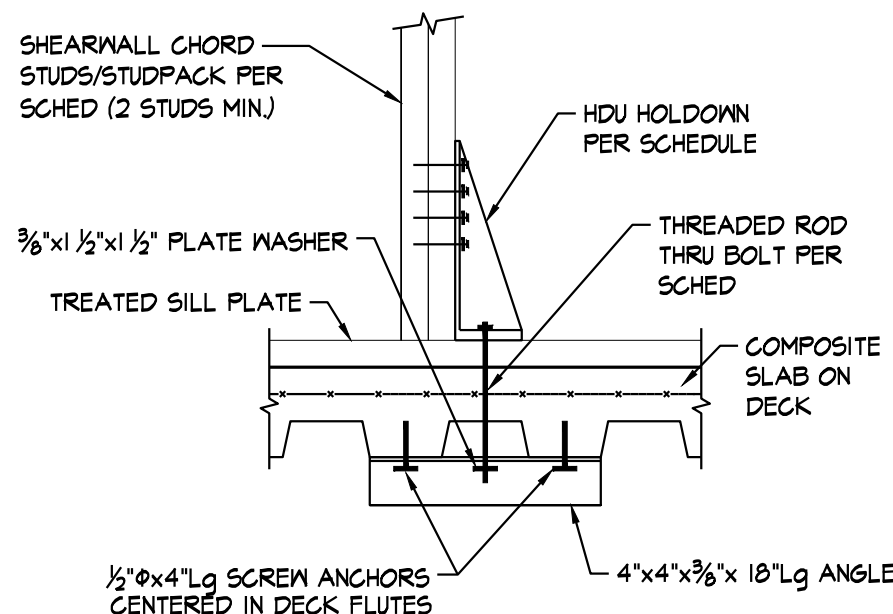


SECTION 3
3/4" = 1'-0" S1.2

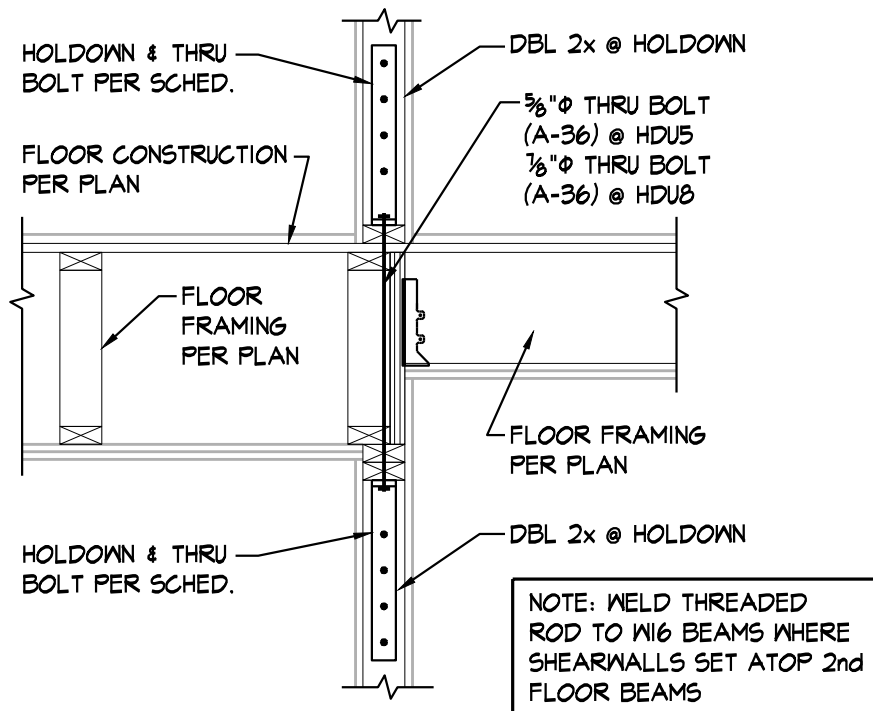


SECTION 2
3/4" = 1'-0" S1.2

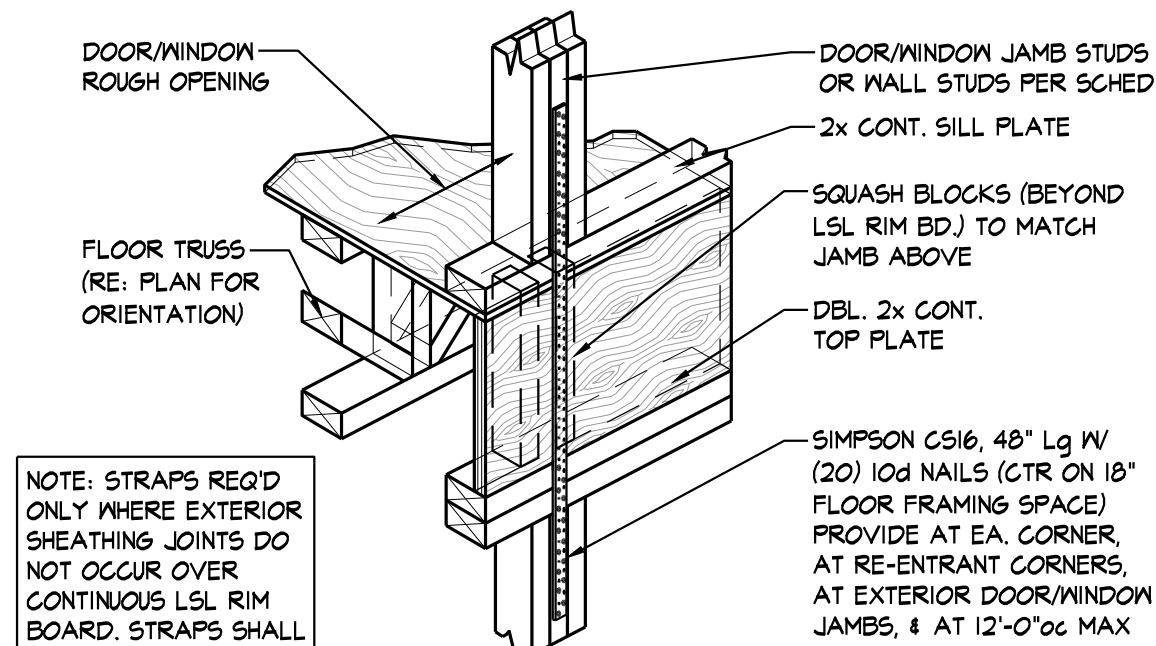


DETAIL 6B
3/4" = 1'-0" S1.2

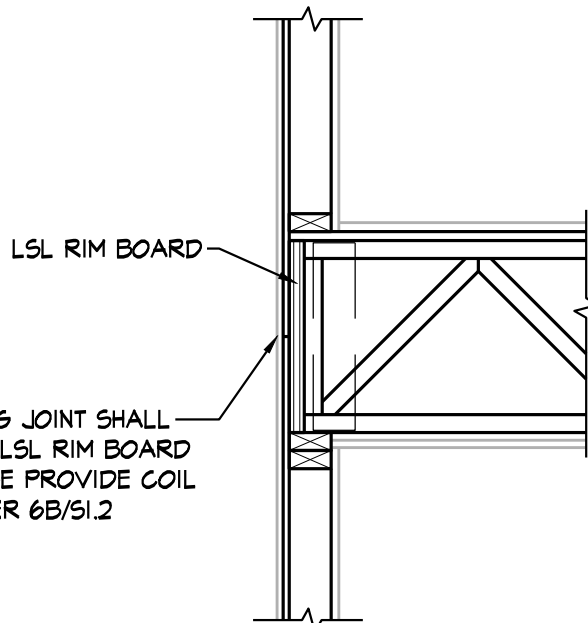

TYPICAL EXTERIOR SHEATHING JOINT
3/4" = 1'-0" S1.2

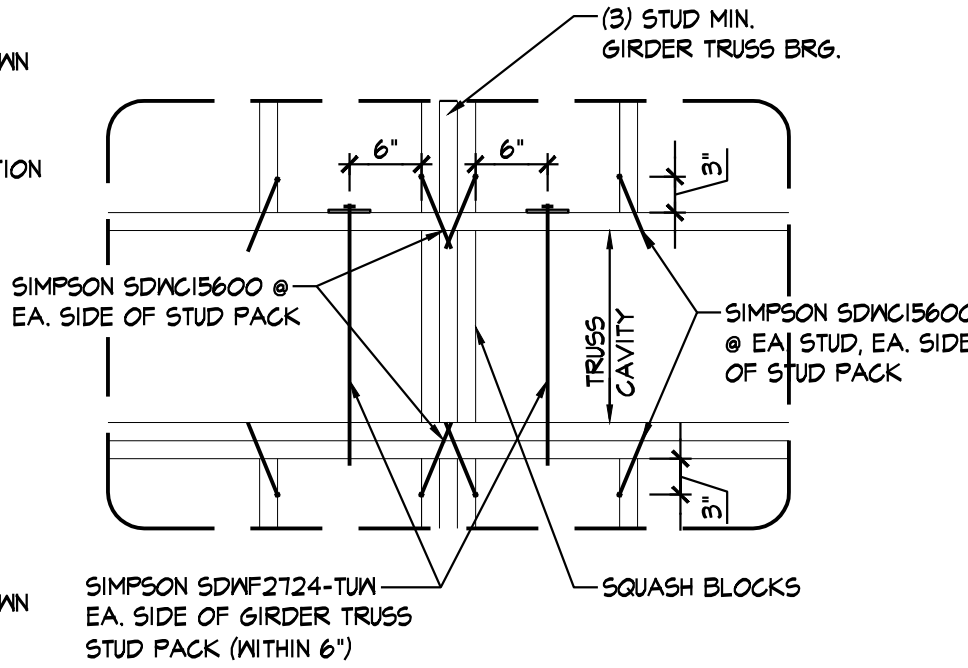

SECTION 5B
3/4" = 1'-0" S1.2

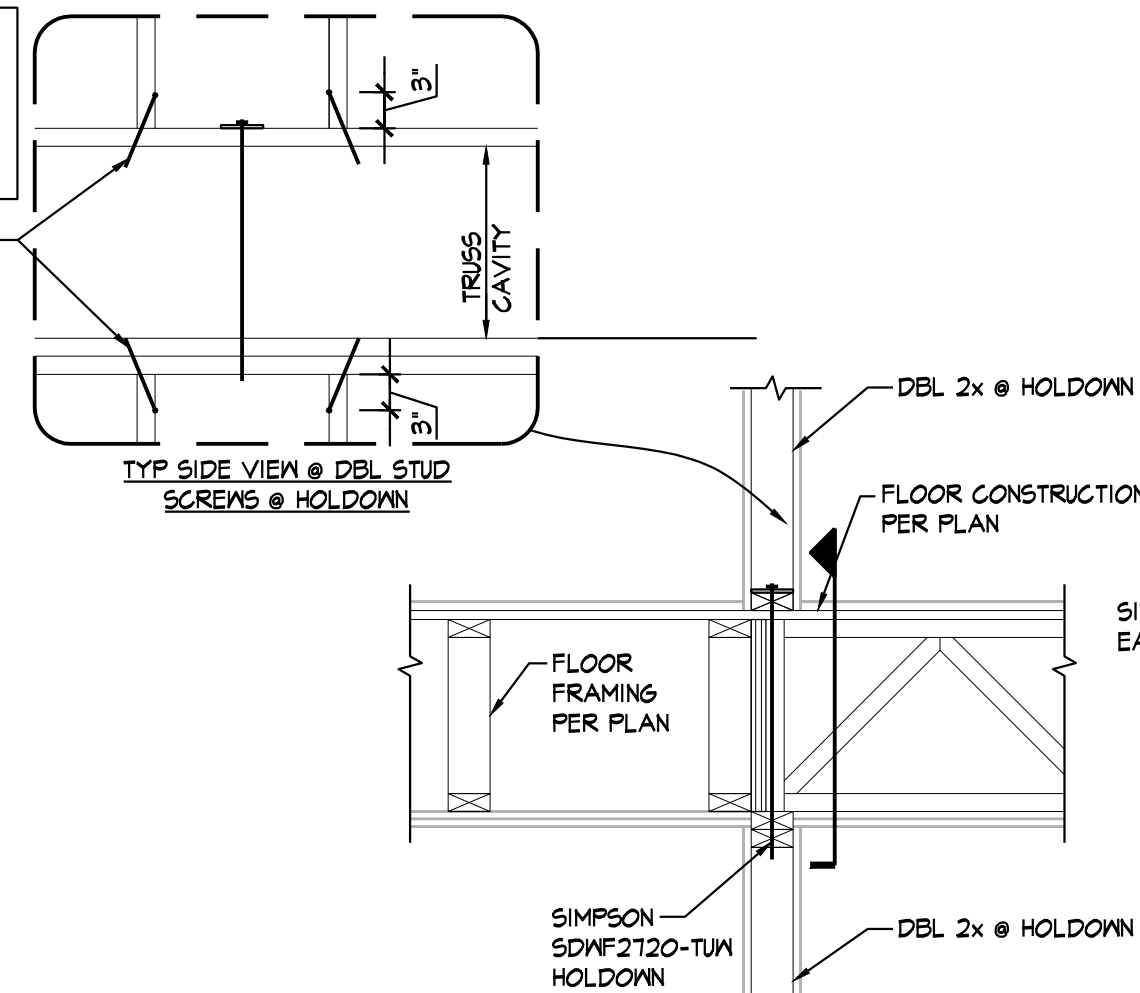

SECTION 5A
3/4" = 1'-0" S1.2

PROVIDE UNIT UPLIFT HOLD-DOWNS @ 48" OC MAX @ LOAD BEARING INTERIOR WALLS SUPPORTING ROOF TRUSSES. HOLD-DOWNS SHALL BE PROVIDED WITHIN 6' OF JAMBS OF ALL INTERIOR LOAD BEARING ROOF HEADERS & GIRDER TRUSS BEARING AND WITHIN 48" OF SHEARWALL HOLD-DOWNS


SIMPSON SDWCI5600 @ EA. STUD ADJACENT TO SDWF SCREW USE TEMPLATE FOR 22 DEG INSTALLATION

SHEARWALL SCHEDULE					
SHEARWALL LOCATION	SHEARWALL TYPE	FLOOR	FLOOR		NUMBER OF WALL STUDS AT HOLD-DOWN (RE: NOTE 4)
			2nd FLOOR WALLS	3rd & 4th FLOOR WALLS	
AT DEMISING WALLS & EXTERIOR WALLS	SM	MATERIAL & THICKNESS	3/8" OSB SHEATHING ONE SIDE, W/ EDGES BLOCKED	3/8" OSB SHEATHING ONE SIDE, W/ EDGES BLOCKED	20d NAILS @ 9" OC @ 3rd FLR (3) 2x6 @ 2nd FLR
		NAIL SIZE & SPACING	8d NAILS 4/12	8d NAILS 6/12	
AT CORRIDOR WALLS	SM	MATERIAL & THICKNESS	3/8" GYP SHEATHING ONE SIDE, W/ EDGES BLOCKED	3/8" GYP SHEATHING ONE SIDE, W/ EDGES BLOCKED	
		NAIL SIZE & SPACING	8d NAILS 4/7	8d NAILS 4/7	


- NOTES:
- NAILING SHALL BE TO ALL STUDS, TOP & BOTTOM PLATES, AND BLOCKING WHERE INDICATED.
 - HOLD-DOWNS PER PLAN & SCHEDULE.
 - WHERE THE ENDS OF PERPENDICULAR SHEAR WALLS INTERSECT AND ONLY ONE HOLD-DOWN SHOWN ON PLAN, FASTEN ALL STUDS TOGETHER PER SCHEDULE AND USE LARGER OF THE TWO HOLD-DOWNS SHOWN IN THE SHEARWALL SCHEDULE. REFERENCE DETAILS 4A, 4B, 4C, AND 4D ON SHEET S1.2 FOR SHEATHING AND HOLD-DOWN ATTACHMENT AT PERPENDICULAR WALLS AND STUD WALL SIZE TRANSITIONS.
 - PROVIDE 2 WALL STUDS AT EACH HOLD-DOWN UNLESS NOTED OTHERWISE IN SCHEDULE. AT LOCATIONS WHERE A SHEARWALL TERMINATES AT A OPENING JAMB, PROVIDE NUMBER OF STUDS PER JAMB SCHEDULE PLUS AN ADDITIONAL STUD FOR THE SHEARWALL. ATTACH ALL STUDS TOGETHER PER 6/S1.
 - NAIL SPACING SHOWN AS (N/I) INDICATES FASTENERS SPACING IN INCHES AT THE EDGES/FIELD WHERE FIELD IS THE INTERMEDIATE MEMBERS.
 - TYPICAL SILL PLATE TO MOOD SHALL BE 20d COMMON NAILS (1.09x2x4") AT 12" OC UNLESS NOTED OTHERWISE IN SCHEDULE.
 - TYPICAL SILL PLATE TO CONCRETE SHALL BE 1/2" @ ANCHORS:
AT 2x4 WALLS SPACE AT 24" OC MAX WITH 1/4" x 2 1/2" x 2 1/2" PLATE WASHER OR SIMPSON BPS 1/2 - 3 @ CONTRACTORS OPTION
PLATE WASHERS TO MAINTAIN MAX OF 1/2" BETWEEN EDGE OF SILL PLATE AND EDGE OF PLATE WASHER
 - SHEARWALL SHEATHING CALLED OUT AT CORRIDOR WALLS SHALL BE LOCATED AT UNIT SIDE OF WALL.
 - AT GYPSUM SHEARWALLS NO. 6 x 1 1/4" TYPE S OR W SCREWS CAN BE UTILIZED AS THE SAME SPACINGS AS SPECIFIED 8d NAILS.
 - NAILS @ MOOD STRUCTURE PANEL SHEAR WALLS SHALL BE GALVANIZED COMMON OF TYPE INDICATED IN SCHED.

HOLD-DOWN SCHEDULE				
MARK	FLOOR LEVEL (W/ APPLICABLE HOLD-DOWN TYPE PER FLOOR)			
	2nd FLOOR	3rd FLOOR	4th FLOOR	
	HDEU9-SDS3.5	HDEU5-SDS3	HDEU5-SDS3	
*				
**	HDEU5-SDS3	HDEU5-SDS3	HDEU5-SDS3	

- NOTES:
- HOLD-DOWN TYPES ARE BASED UPON MANUFACTURER SIMPSON STRONG-TIE.
 - REFER TO SECTION DETAILS ON S1.2 FOR TYPICAL HOLD-DOWN DETAILS.
 - WHERE THE ENDS OF PERPENDICULAR SHEAR WALLS INTERSECT AND ONLY ONE HOLD-DOWN SHOWN ON PLAN, FASTEN ALL STUDS TOGETHER PER SCHEDULE AND USE LARGER OF THE TWO HOLD-DOWNS SHOWN ON THE SHEAR WALL SCHEDULE.
 - ALL HOLD-DOWN POSTS TO BE (2) 2x6 (MIN) (I.N.O.) TO MATCH STUD SIZE & GRADE NOTED IN WALL SCHEDULE. PROVIDE ADDITIONAL STUDS AS REQD TO MEET QUANTITY NOTED IN SCHED.
 - REFER TO SECTIONS 2/S1.2, 3/S1.2, 4A/S1.2 & 4B/S1.2 FOR HOLD-DOWN ANCHOR REQUIREMENTS.

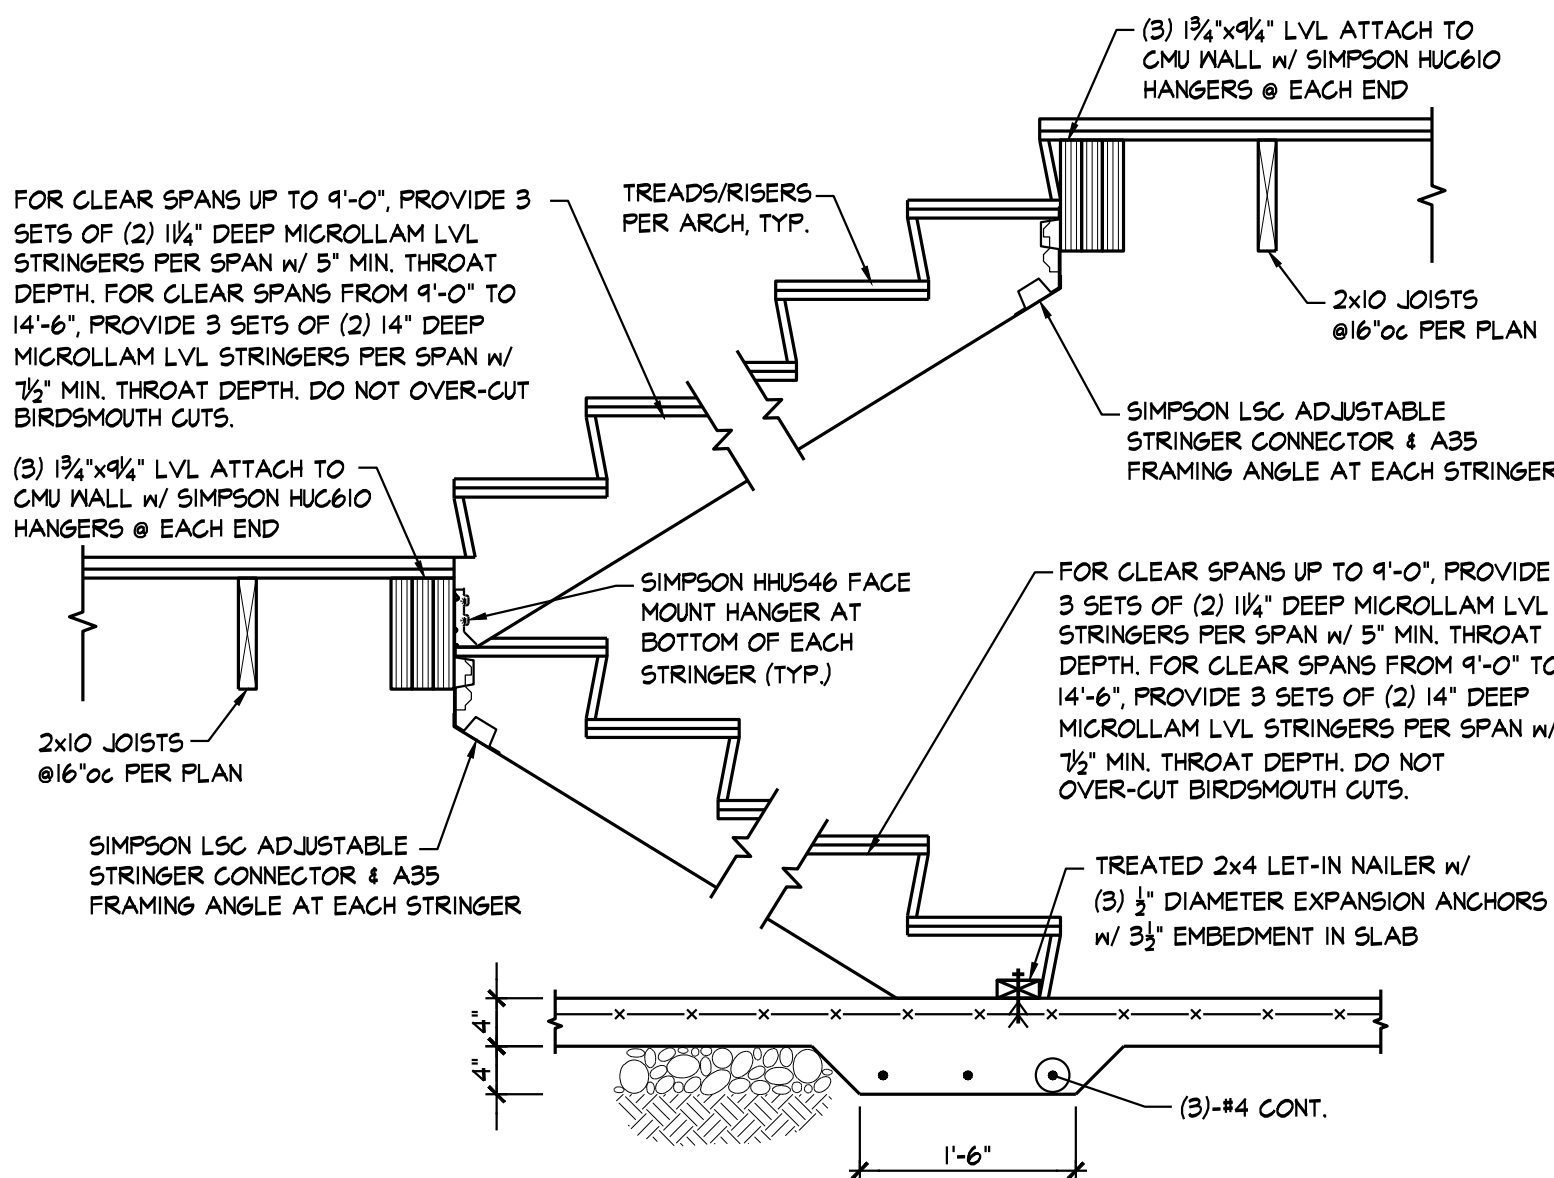

SECTION 7
3/4" = 1'-0" S1.2

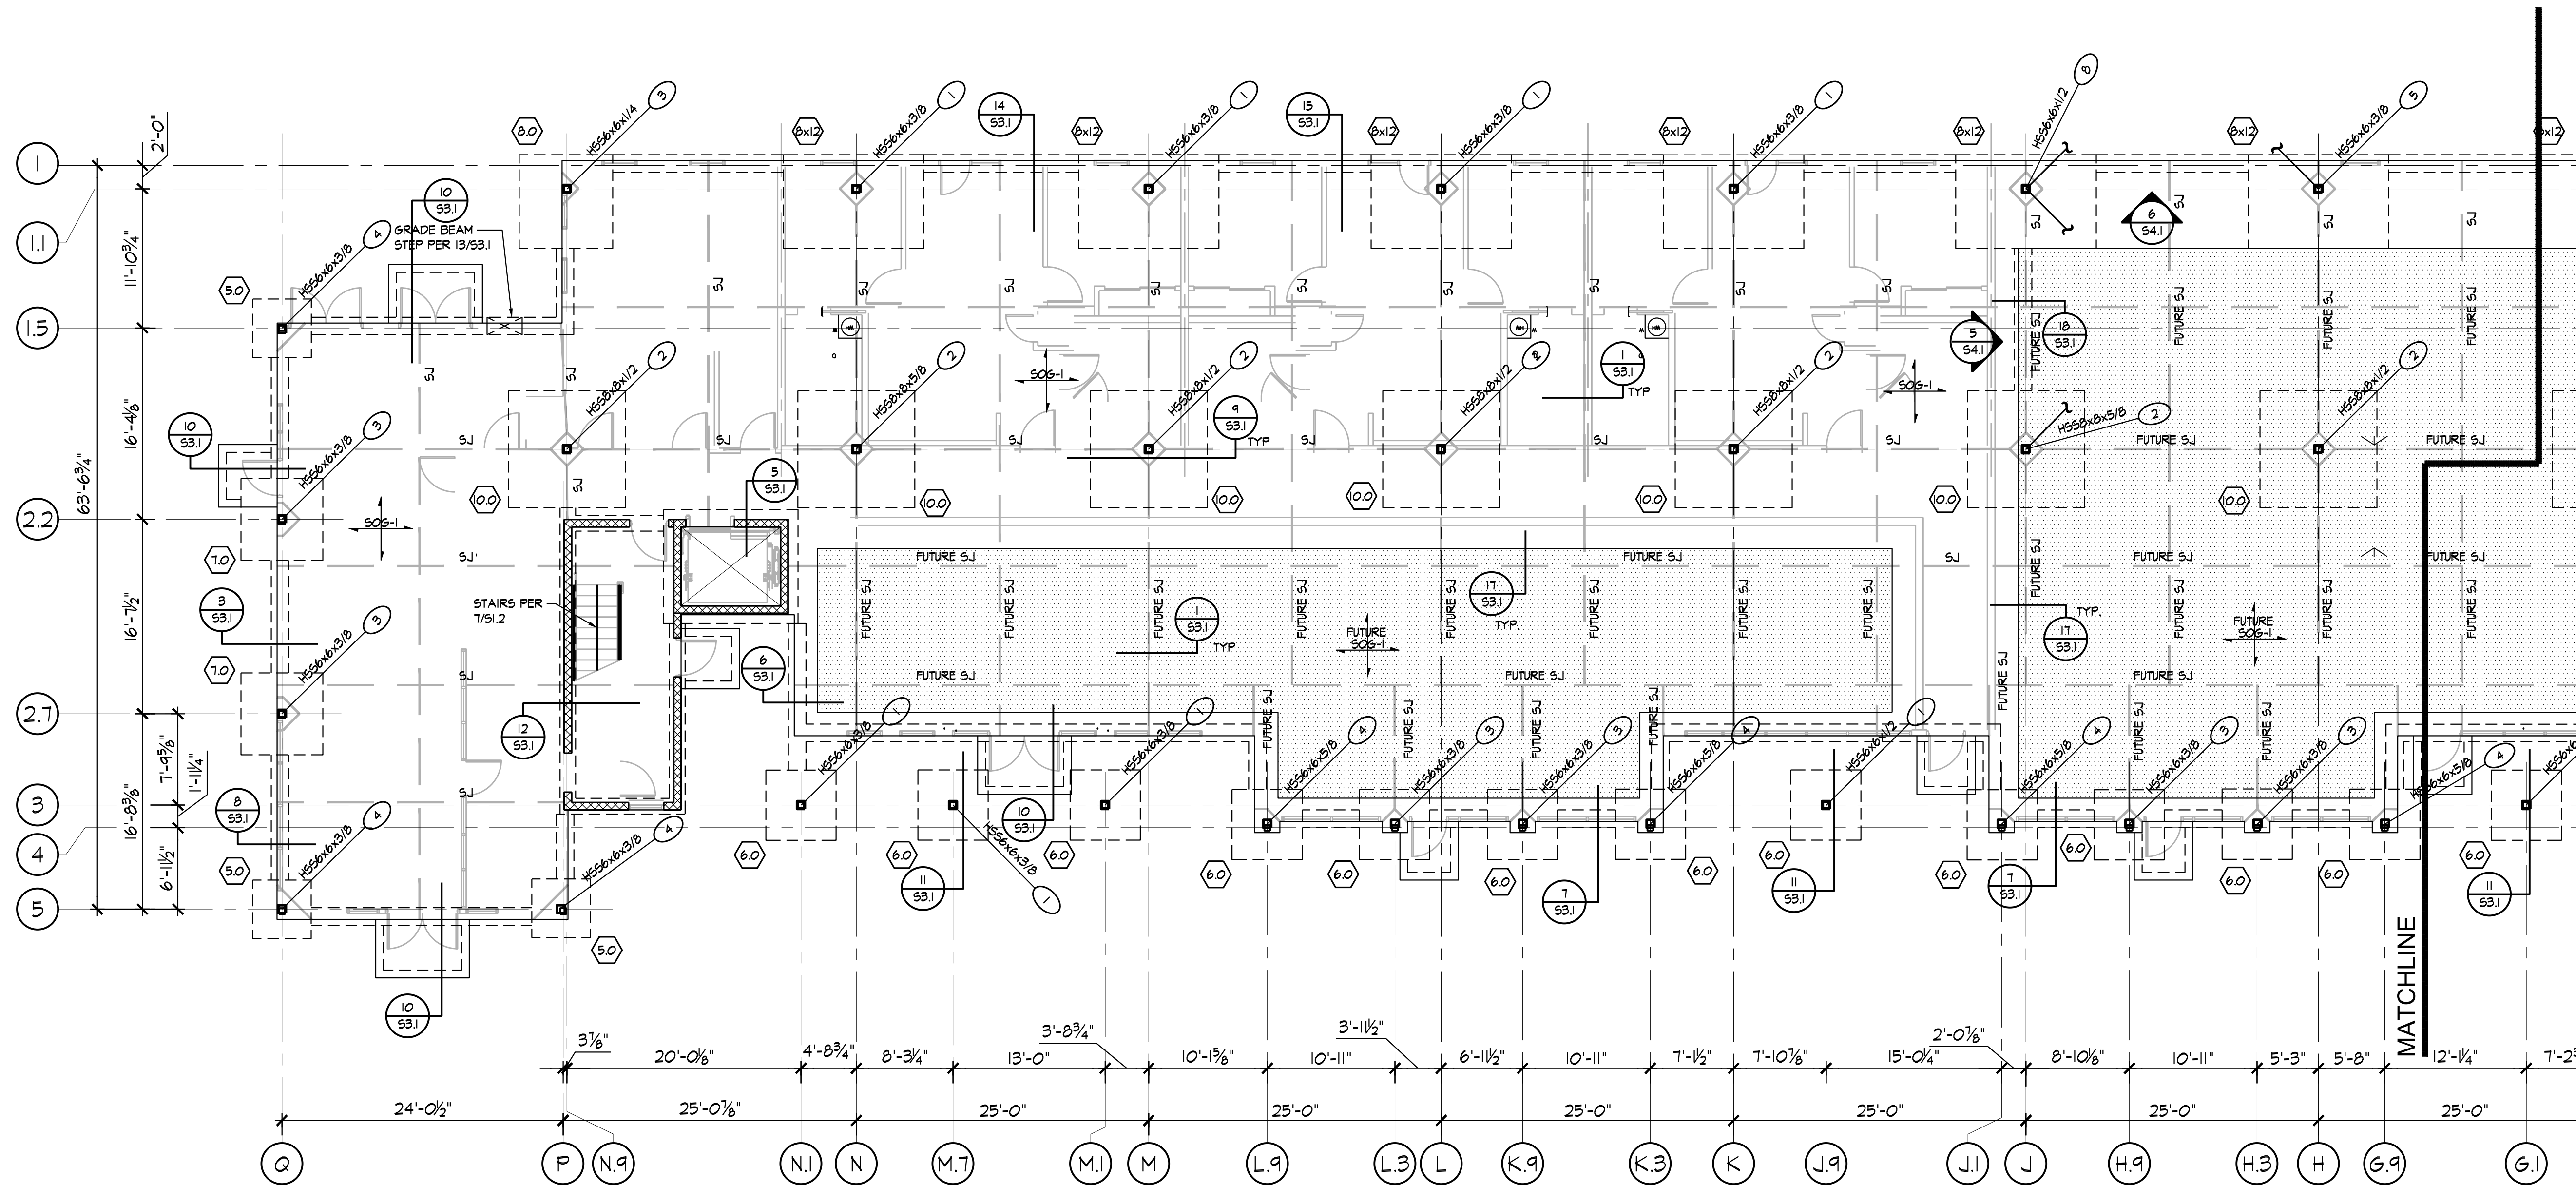

FOUNDATION PLAN

- NOTES:
1. REFER TO GENERAL NOTES ON SHEET S0.1
 2. REFER TO COLUMN & FOOTING SCHEDULE ON SHEET S1.1
 3. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS NOT SHOWN
 4. REFER TO SHEETS S0.1 AND S1.1 FOR TYPICAL NAILING WOOD FRAMING DETAILS
 5. REFER TO SHEARWALL & HOLDOWN SCHEDULES ON SHEET S1.2
 6. SHEARWALLS/HOLDOWNS DESIGNED AS FOLLOWS:
1. REFER TO SECTIONS 2/S1.2 & 3/S1.2 FOR HOLDOWNS AT END OF WALL

BOB D. CAMPBELL & CO.
Structural Engineers Since 1957
4338 Belleview Ave. 816.531.4144
Kansas City, MO 64111 www.bdc-engrs.com

THE RESERVES AT MEADOWS 25 NEW APARTMENTS


KANSAS

GODDARD,



REVISION:	
DATE:	4-17-2026
JOB:	25-3465
SHEET NO.:	

S2.1A

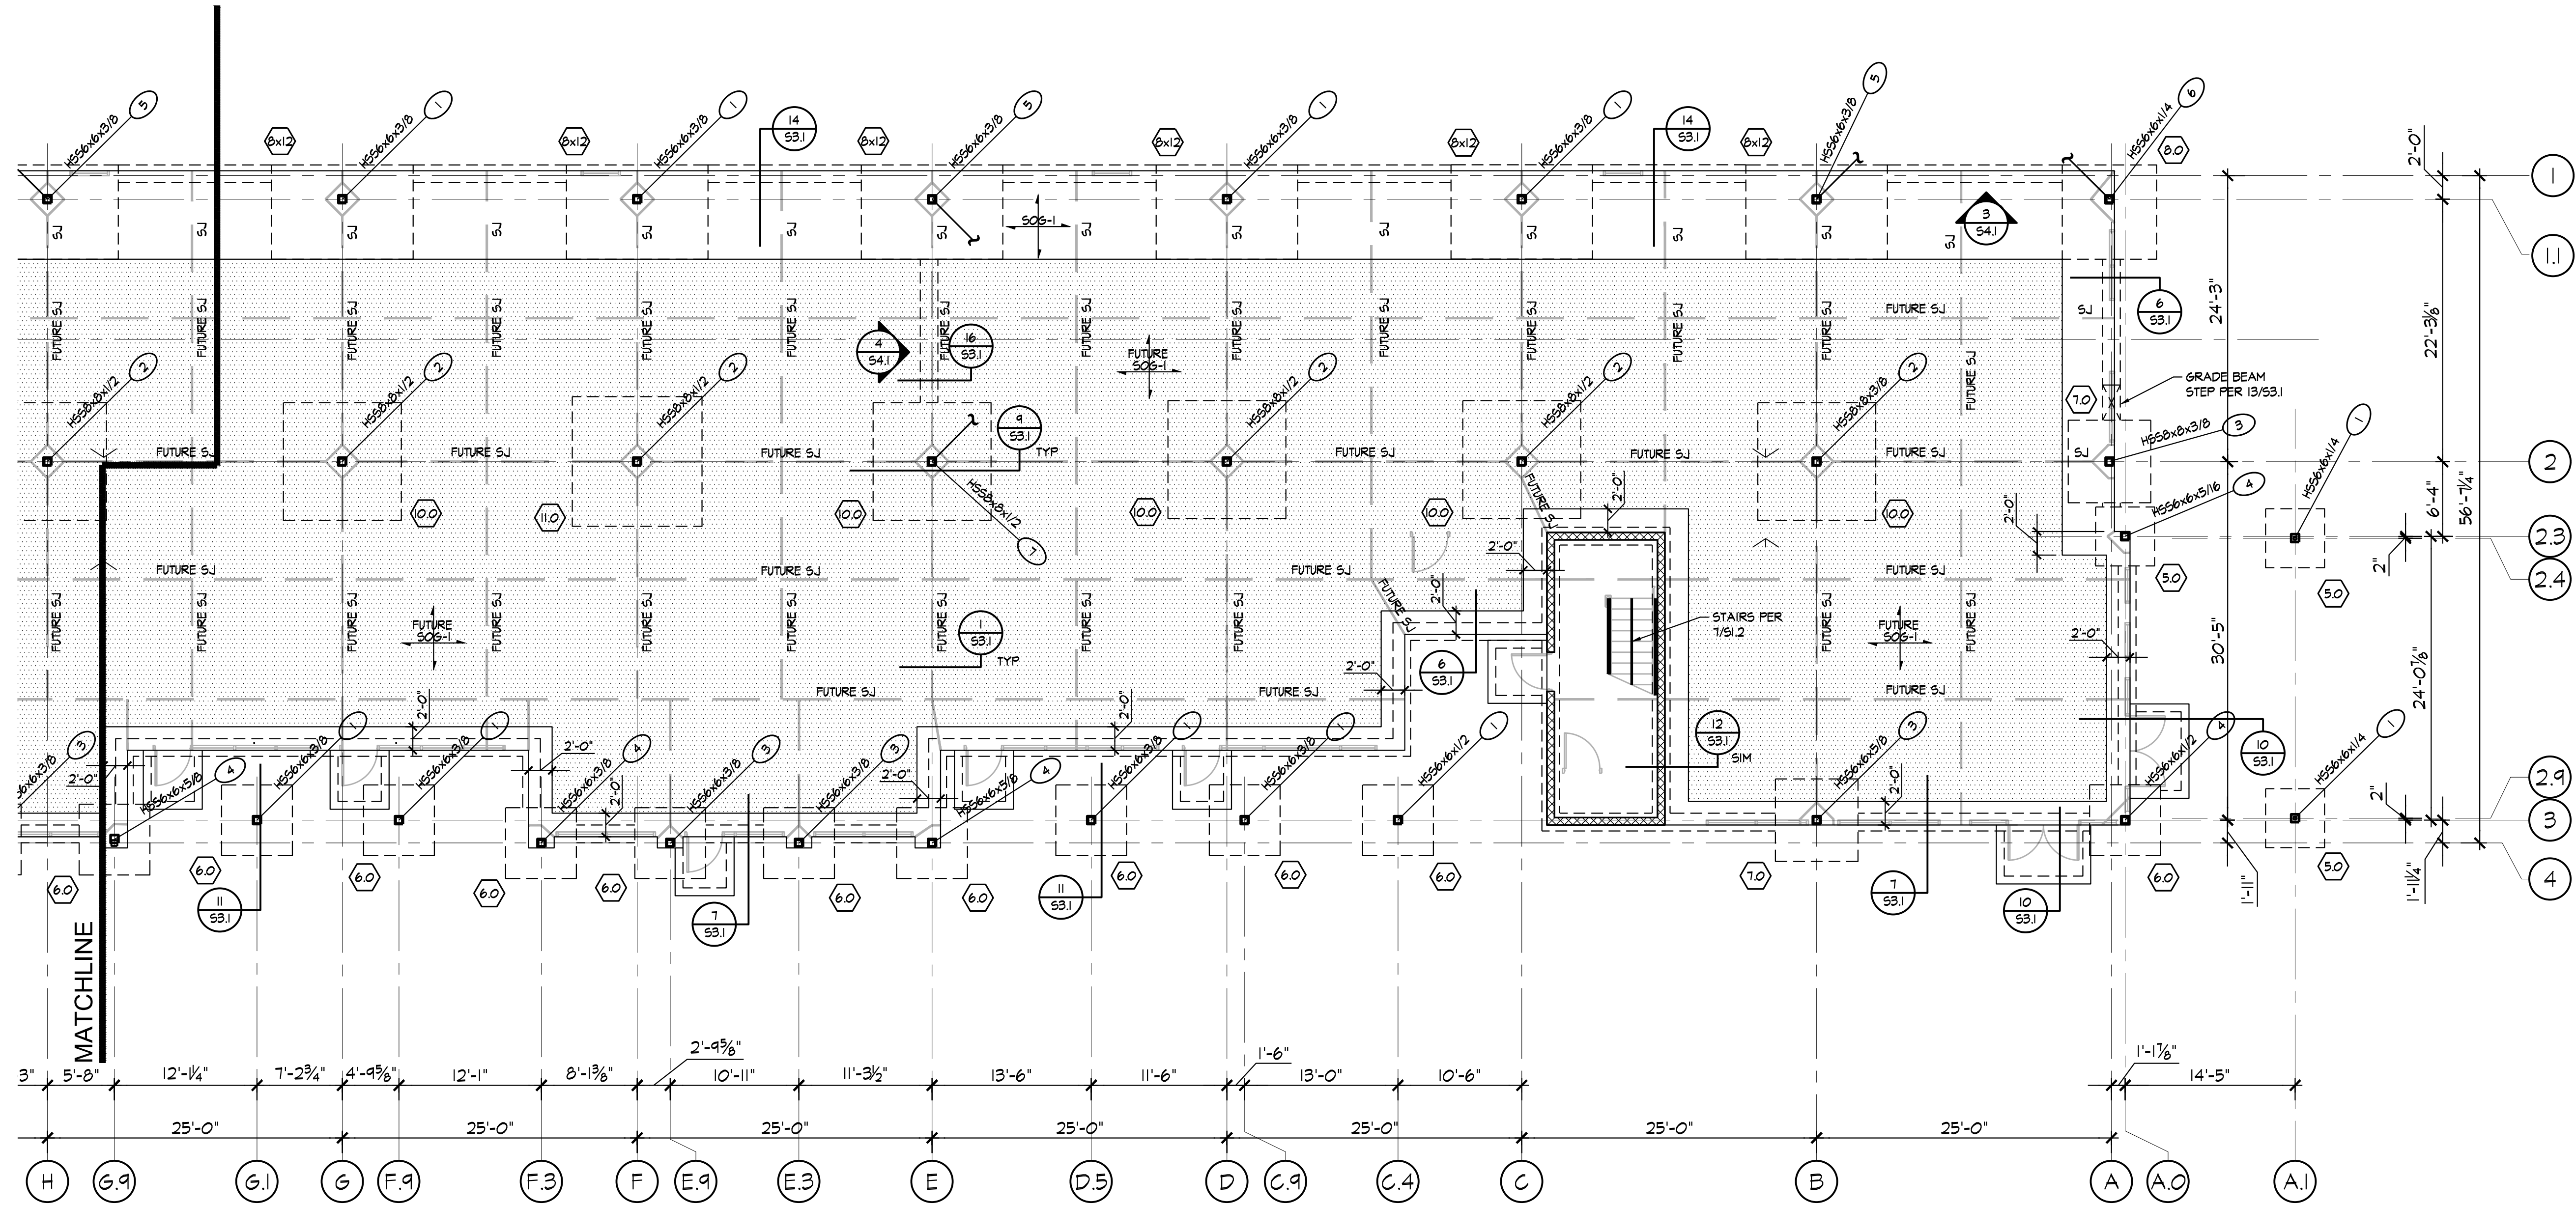

FOUNDATION PLAN

1/8" = 1'-0"

- NOTES:
1. REFER TO GENERAL NOTES ON SHEET S0.1
 2. REFER TO COLUMN & FOOTING SCHEDULE ON SHEET S1.1
 3. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS NOT SHOWN
 4. REFER TO SHEETS S0.1 AND S1.1 FOR TYPICAL NAILING WOOD FRAMING DETAILS
 5. REFER TO SHEARWALL & HOLDOWN SCHEDULES ON SHEET S1.2
 6. SHEARWALLS/HOLDOWNS DESIGNED AS FOLLOWS:

7. REFER TO SECTIONS 2/S1.2 & 3/S1.2 FOR HOLDOWNS AT END OF WALL

BOB D. CAMPBELL & CO.
Structural Engineers Since 1957
4338 Belleview Ave. 818.531.4144
Kansas City, MO 64111 www.bdc-engrs.com

THE RESERVES AT MEADOWS 25

NEW APARTMENTS

GODDARD,

KANSAS



REVISION:

DATE: 4-17-2026

JOB: 25-3465

SHEET NO.:

S2.1B


JGR
JonesGillamRenz
730 N. Ninth 1881 Main Street, Suite 301
Salina, KS 67401 Kansas City, MO 64108
785.827.0386 jgr@jgarchitects.com



1/8" = 1'-0"

-
- SW
- SHEAR WALL EXTENTS INDICATED W/ HATCHED AREA
- HOLDDOWN TYPE MARK: (1) HOLDDOWN TYPICAL EACH END OF SHEARWALL PER HOLDDOWN ANCHOR SCHED

COPYRIGHTED ©

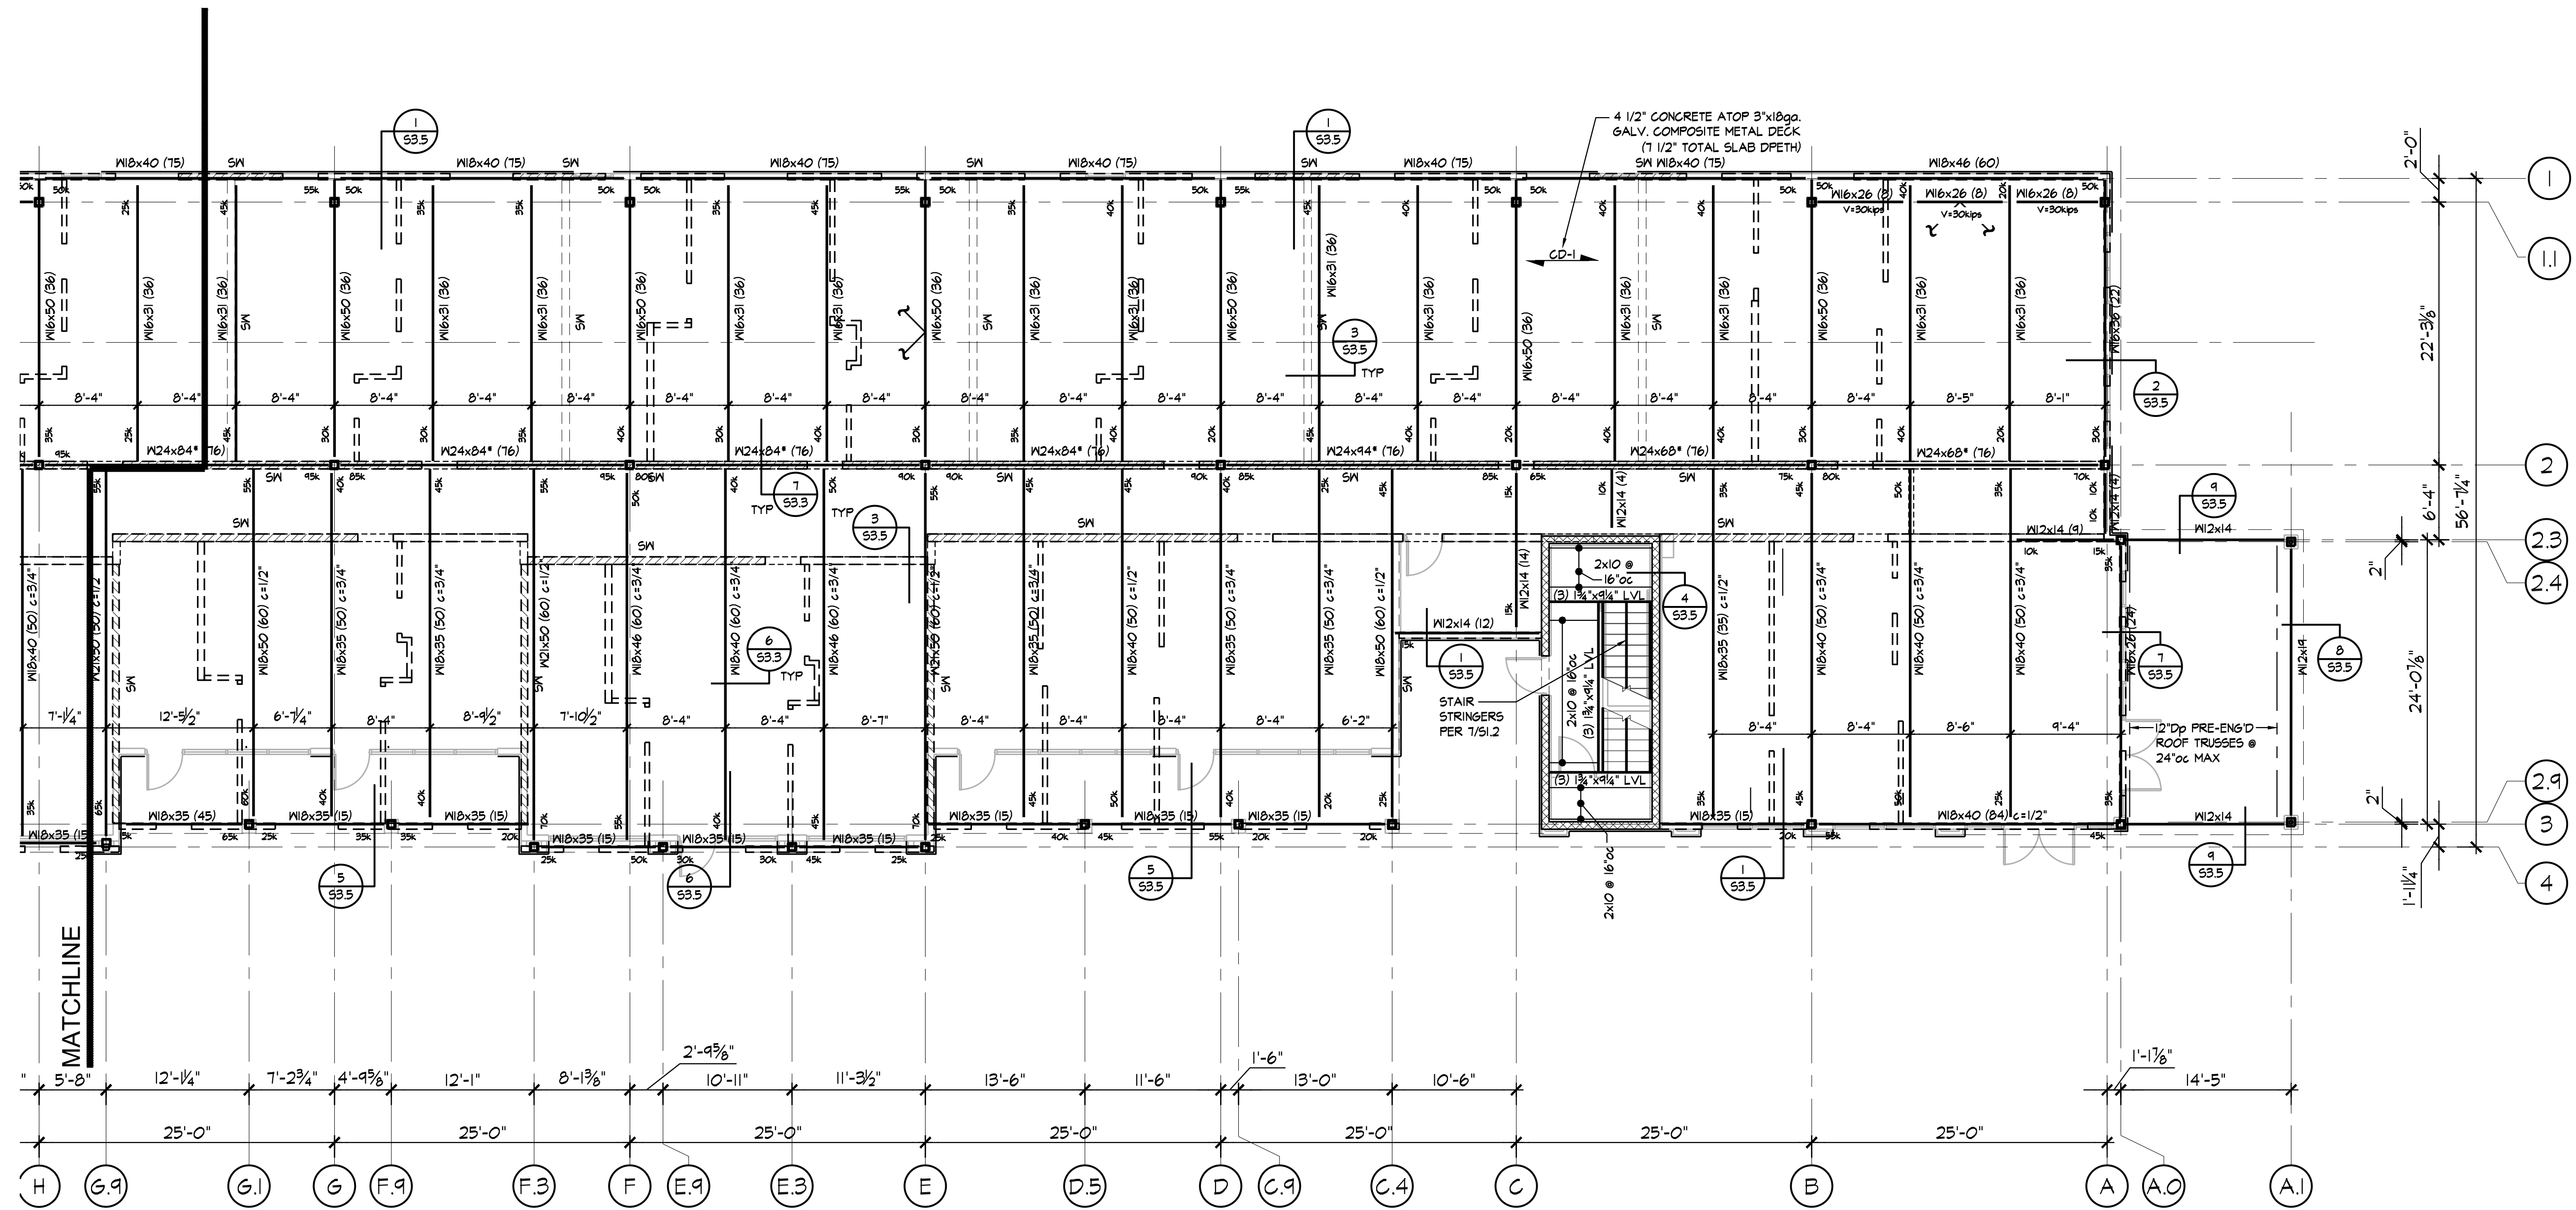


SECOND FLOOR FRAMING PLAN

- NOTES:
1. REFER TO GENERAL NOTES ON SHEET S0.1
 2. REFER TO COLUMN & FOOTING SCHEDULE ON SHEET S1.1
 3. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS NOT SHOWN
 4. REFER TO SHEETS S0.1 AND S1.1 FOR TYPICAL NAILING WOOD FRAMING DETAILS
 5. REFER TO SHEARWALL & HOLDOWN SCHEDULES ON SHEET S1.2
 6. SHEARWALLS/HOLDOWNS DESIGNED AS FOLLOWS:

1. REFER TO SECTIONS 2/S1.2 & 3/S1.2 FOR HOLDOWNS AT END OF WALL
2. BEAMS SHOWN WITH AN * SYMBOL ARE DESIGNED TO HAVE AN 8" TALL x 12" WIDE RECTANGULAR OPENING LOCATED AT MIDSPAN & MID-DEPTH WITHOUT WEB STIFFENERS (I.E. W24X60* (60))

BOB D. CAMPBELL & CO.
Structural Engineers Since 1957
4338 Bellevue Ave. 818.531.4144
Kansas City, MO 64111 www.bdc-engrs.com

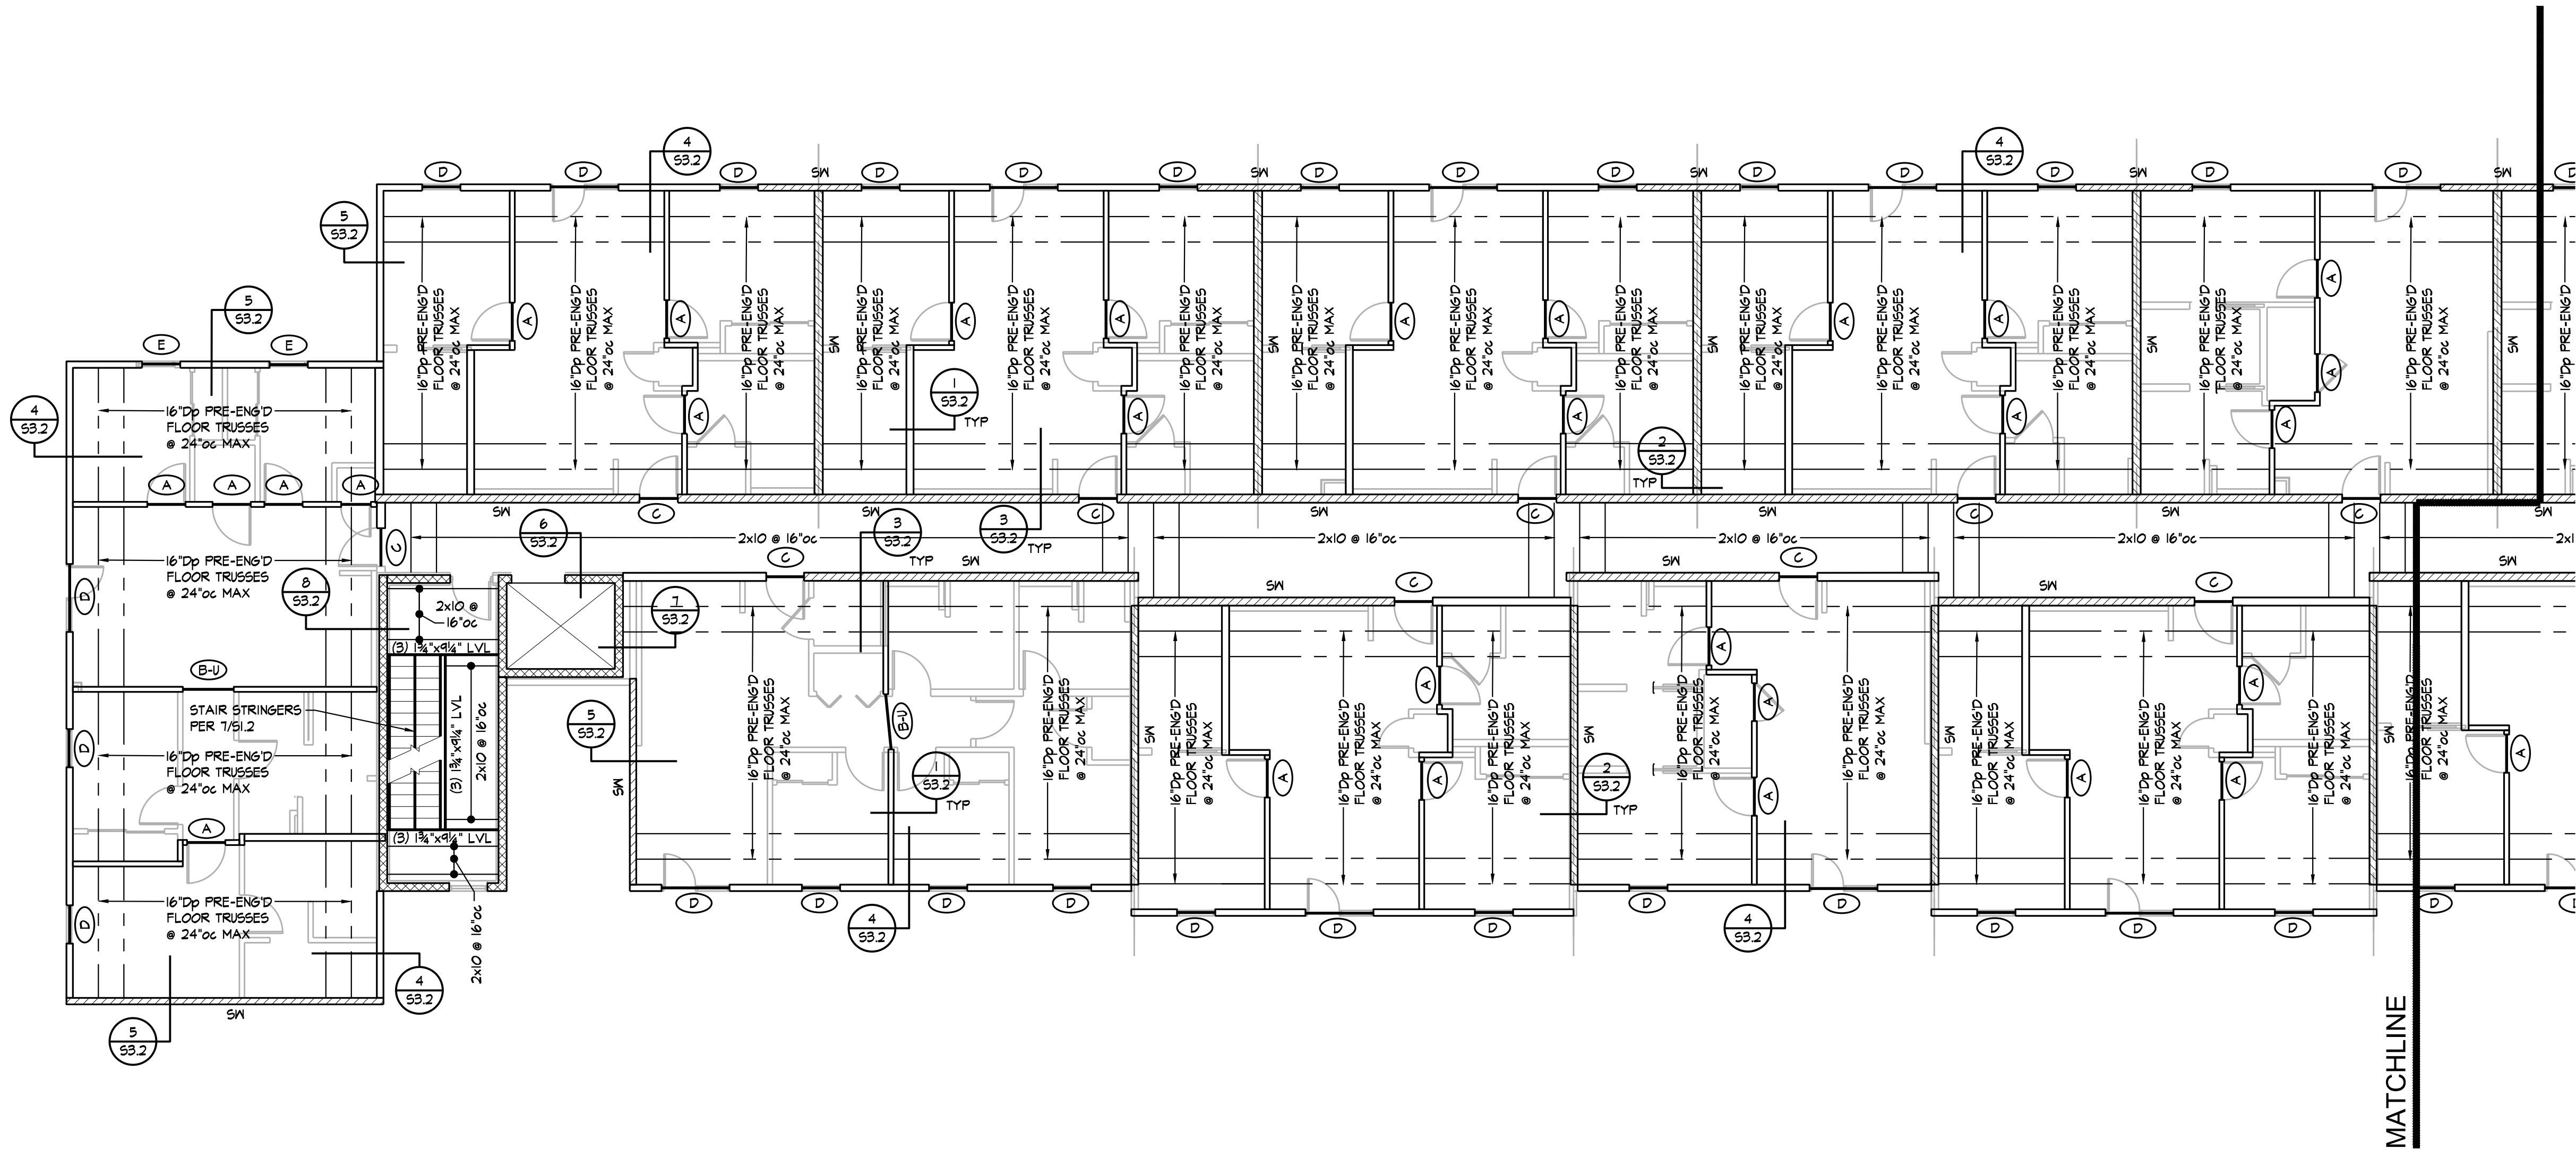


THIRD FLOOR FRAMING PLAN

- NOTES:
1. REFER TO GENERAL NOTES ON SHEET S0.1
 2. REFER TO COLUMN & FOOTING SCHEDULE ON SHEET S1.1
 3. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS NOT SHOWN
 4. REFER TO SHEETS S0.1 AND S1.1 FOR TYPICAL NAILING WOOD FRAMING DETAILS
 5. REFER TO SHEARWALL & HOLDOWN SCHEDULES ON SHEET S1.2
 6. SHEARWALLS/HOLDOWNS DESIGNED AS FOLLOWS:
- 1/8" = 1'-0"
- SHEAR WALL EXTENTS INDICATED W/ HATCHED AREA
- HOLDOWN TYPE MARK: (1) HOLDOWN TYPICAL EACH END OF SHEARWALL PER HOLDOWN ANCHOR SCHED.
7. REFER TO SECTIONS 2/S1.2 & 3/S1.2 FOR HOLDOWNS AT END OF WALL



REVISION:	
DATE:	4-17-2026
JOB:	25-3465
SHEET NO.:	

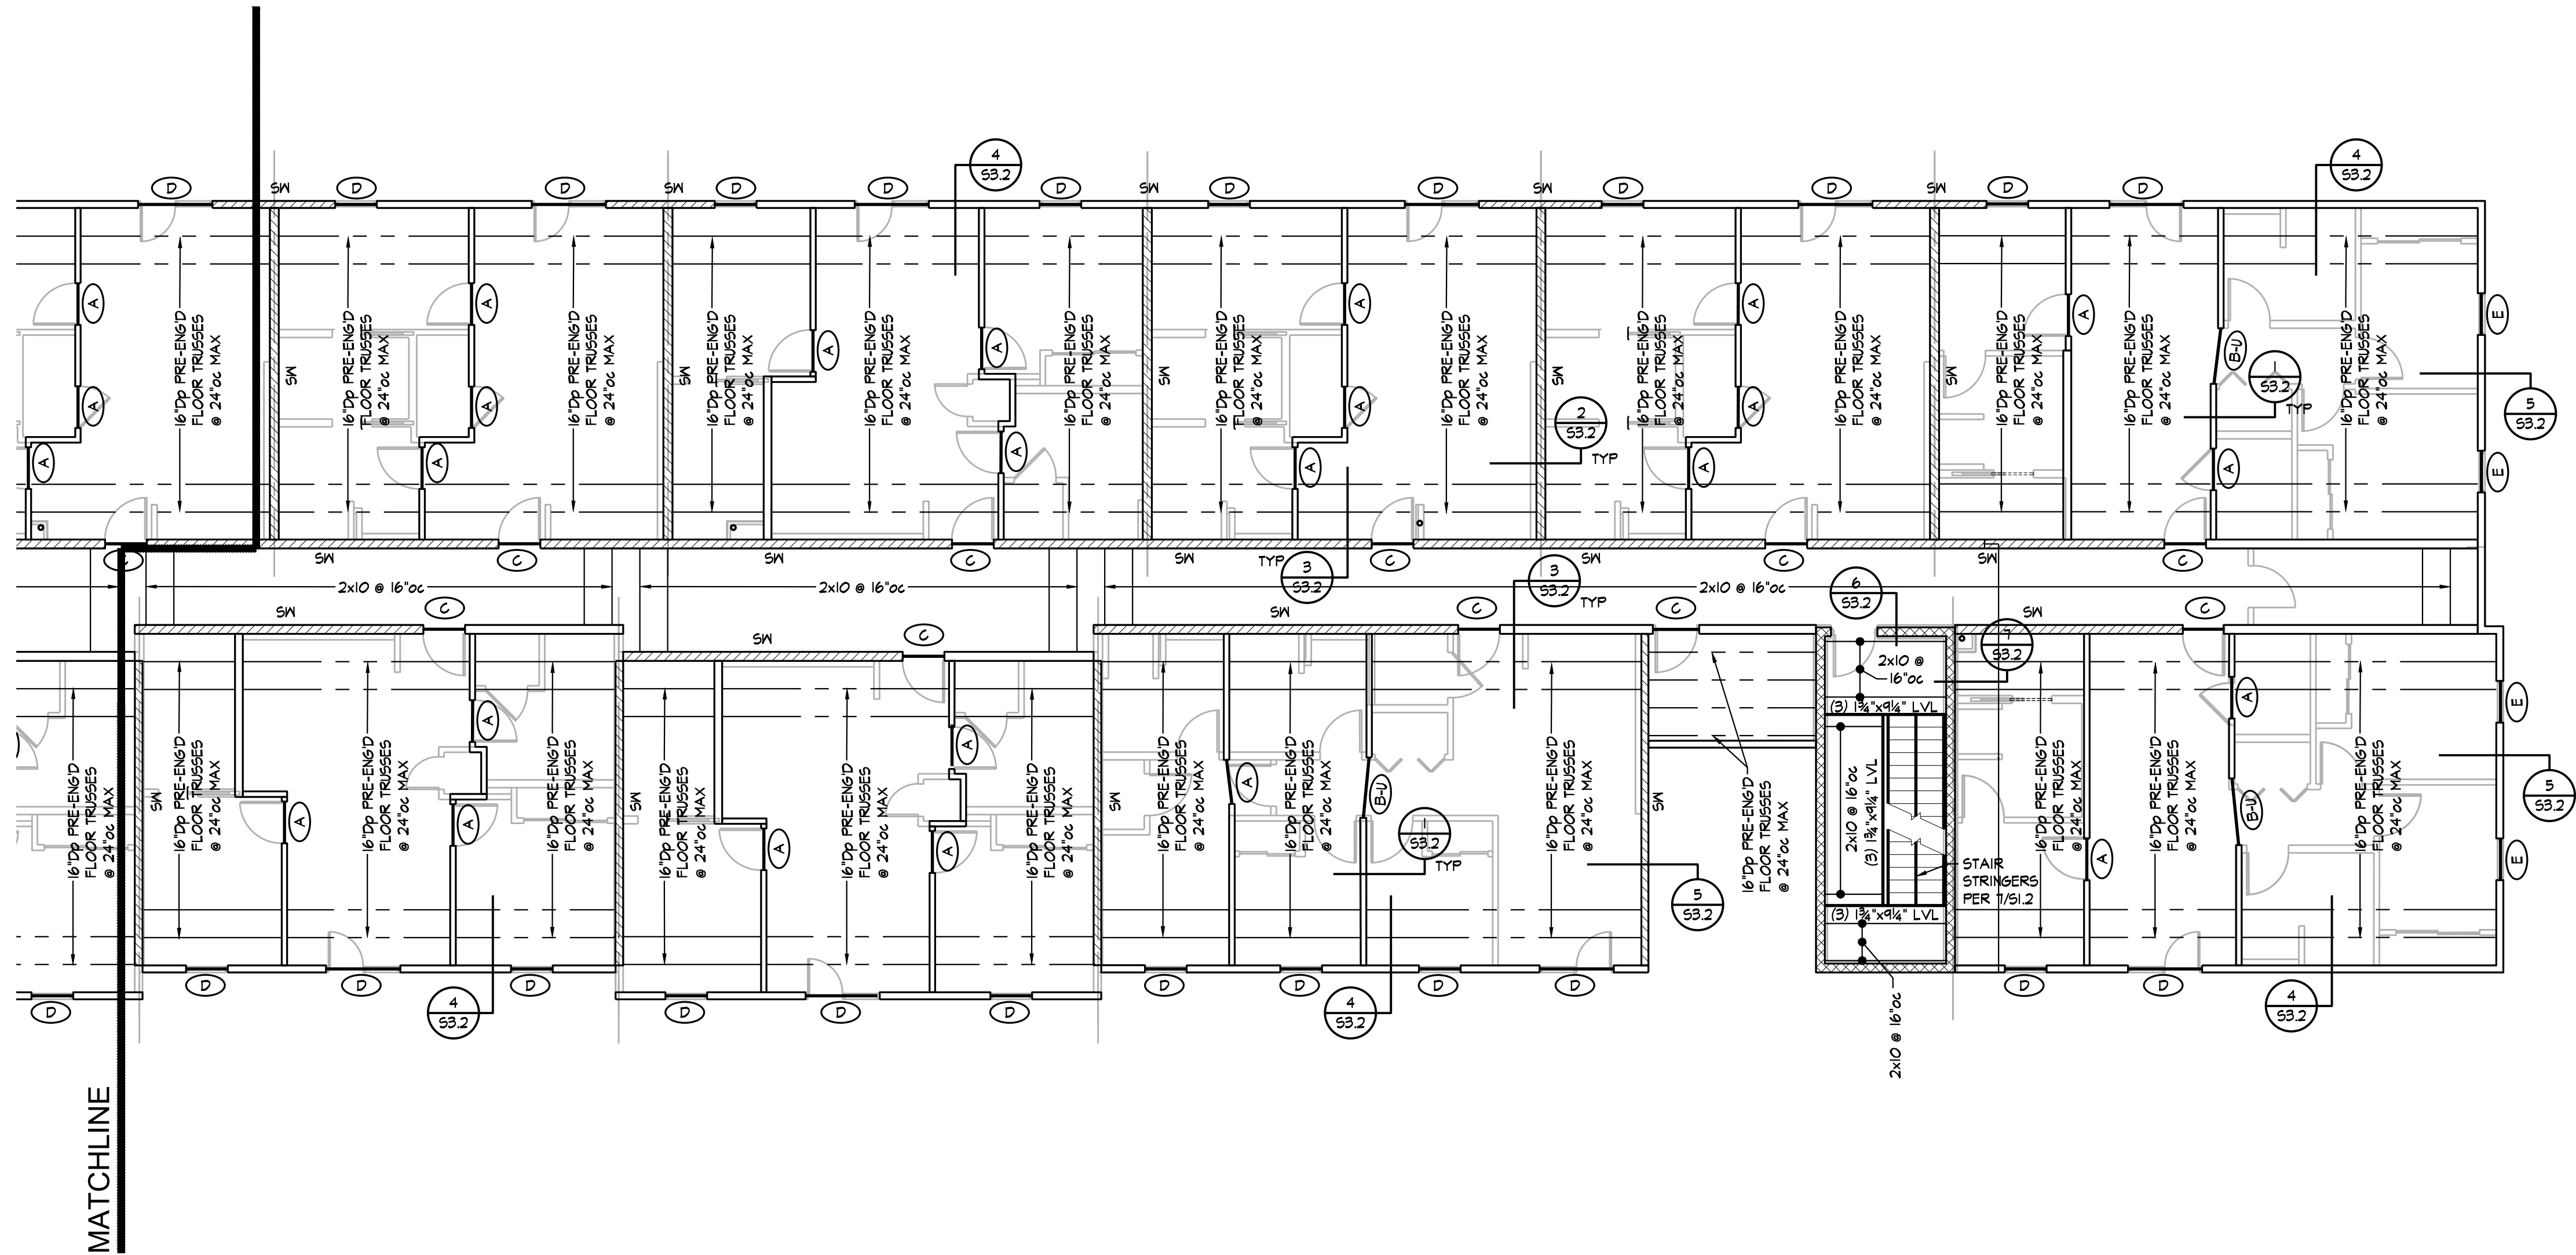

THIRD FLOOR FRAMING PLAN
1/8" = 1'-0"


- NOTES:
1. REFER TO GENERAL NOTES ON SHEET S0.1
 2. REFER TO COLUMN & FOOTING SCHEDULE ON SHEET S1.1
 3. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS NOT SHOWN
 4. REFER TO SHEETS S0.1 AND S1.1 FOR TYPICAL NAILING WOOD FRAMING DETAILS
 5. REFER TO SHEARMALL & HOLDOWN SCHEDULES ON SHEET S1.2
 6. SHEARMALLS/HOLDOWNS DESIGNED AS FOLLOWS:

S/M

SHEAR WALL EXTENTS INDICATED W/ HATCHED AREA

HOLDOWN TYPE MARK: (1) HOLDOWN TYPICAL EACH END OF SHEARMALL PER HOLDOWN ANCHOR SCHED.

7. REFER TO SECTIONS 2/S1.2 & 3/S1.2 FOR HOLDOWNS AT END OF WALL

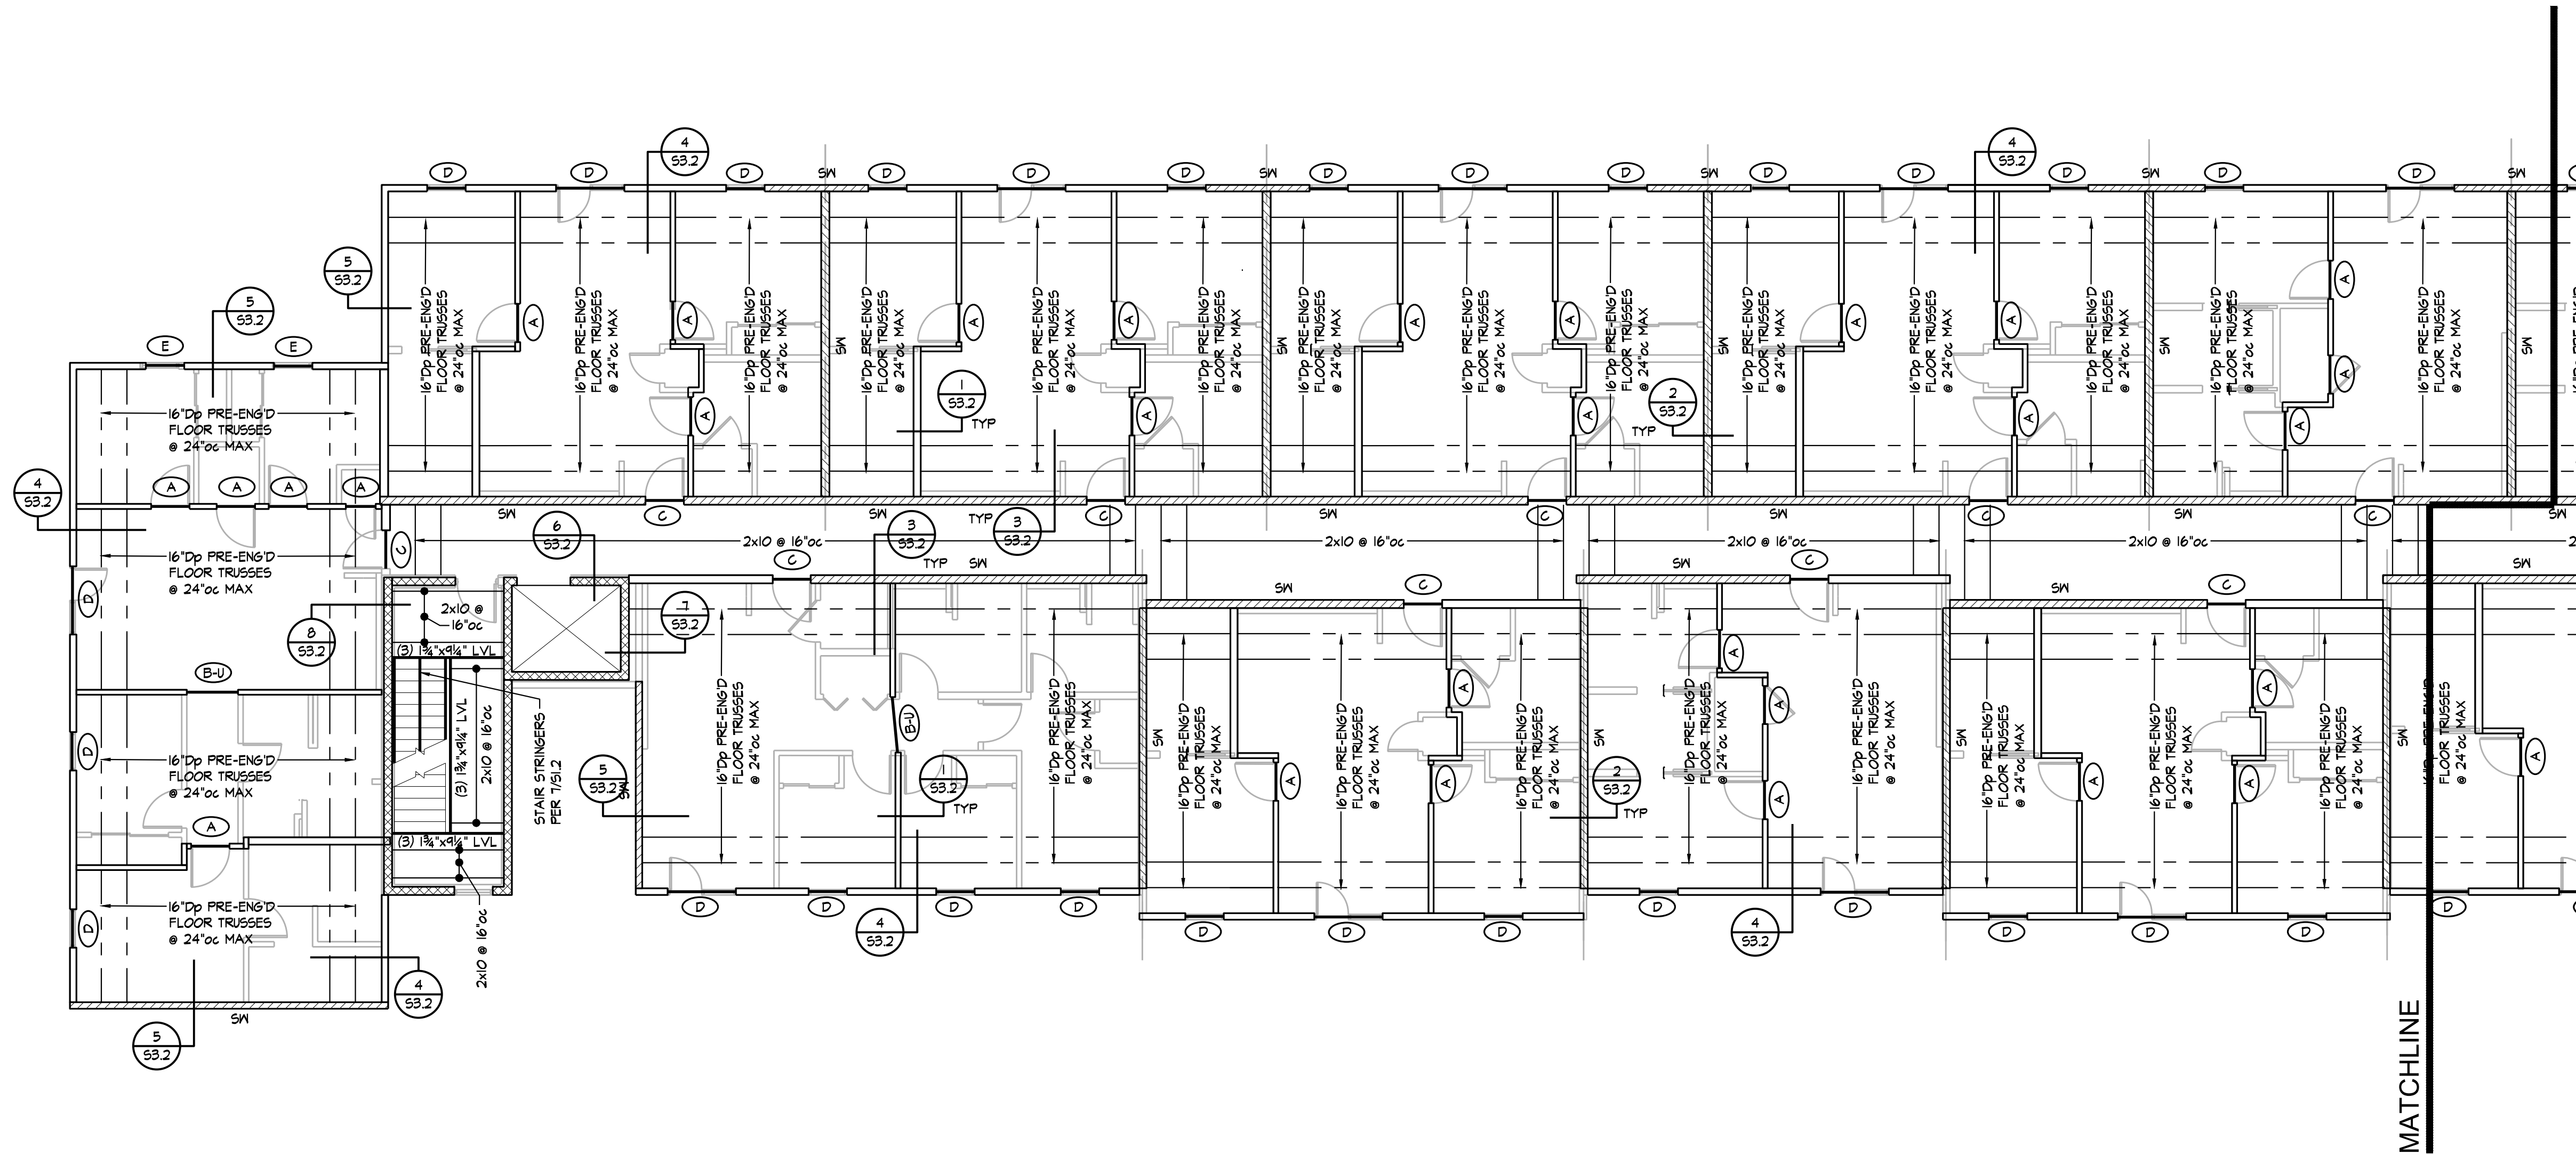


FOURTH FLOOR FRAMING PLAN

1/8" = 1'-0"

NOTES:

1. REFER TO GENERAL NOTES ON SHEET S0.1
2. REFER TO COLUMN & FOOTING SCHEDULE ON SHEET S1.1
3. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS NOT SHOWN
4. REFER TO SHEETS S0.1 AND S1.1 FOR TYPICAL NAILING WOOD FRAMING DETAILS
5. REFER TO SHEARMALL & HOLDOWN SCHEDULES ON SHEET S1.2
6. SHEARMALLS/HOLDOWNS DESIGNED AS FOLLOWS:

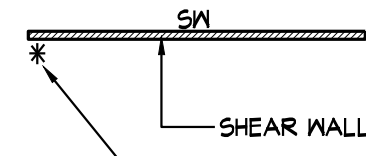

SHEAR WALL EXTENTS INDICATED W/ HATCHED AREA

HOLDOWN TYPE MARK: (1) HOLDOWN TYPICAL EACH
END OF SHEARMALL PER HOLDOWN ANCHOR SCHED.

7. REFER TO SECTIONS 2/S1.2 & 3/S1.2 FOR HOLDOWNS AT END OF WALL

REVISION:

DATE: 4-17-2026

JOB: 25-3465

SHEET NO.:


S2.4A

THE RESERVES AT MEADOWS 25

NEW APARTMENTS

GODDARD,


KANSAS

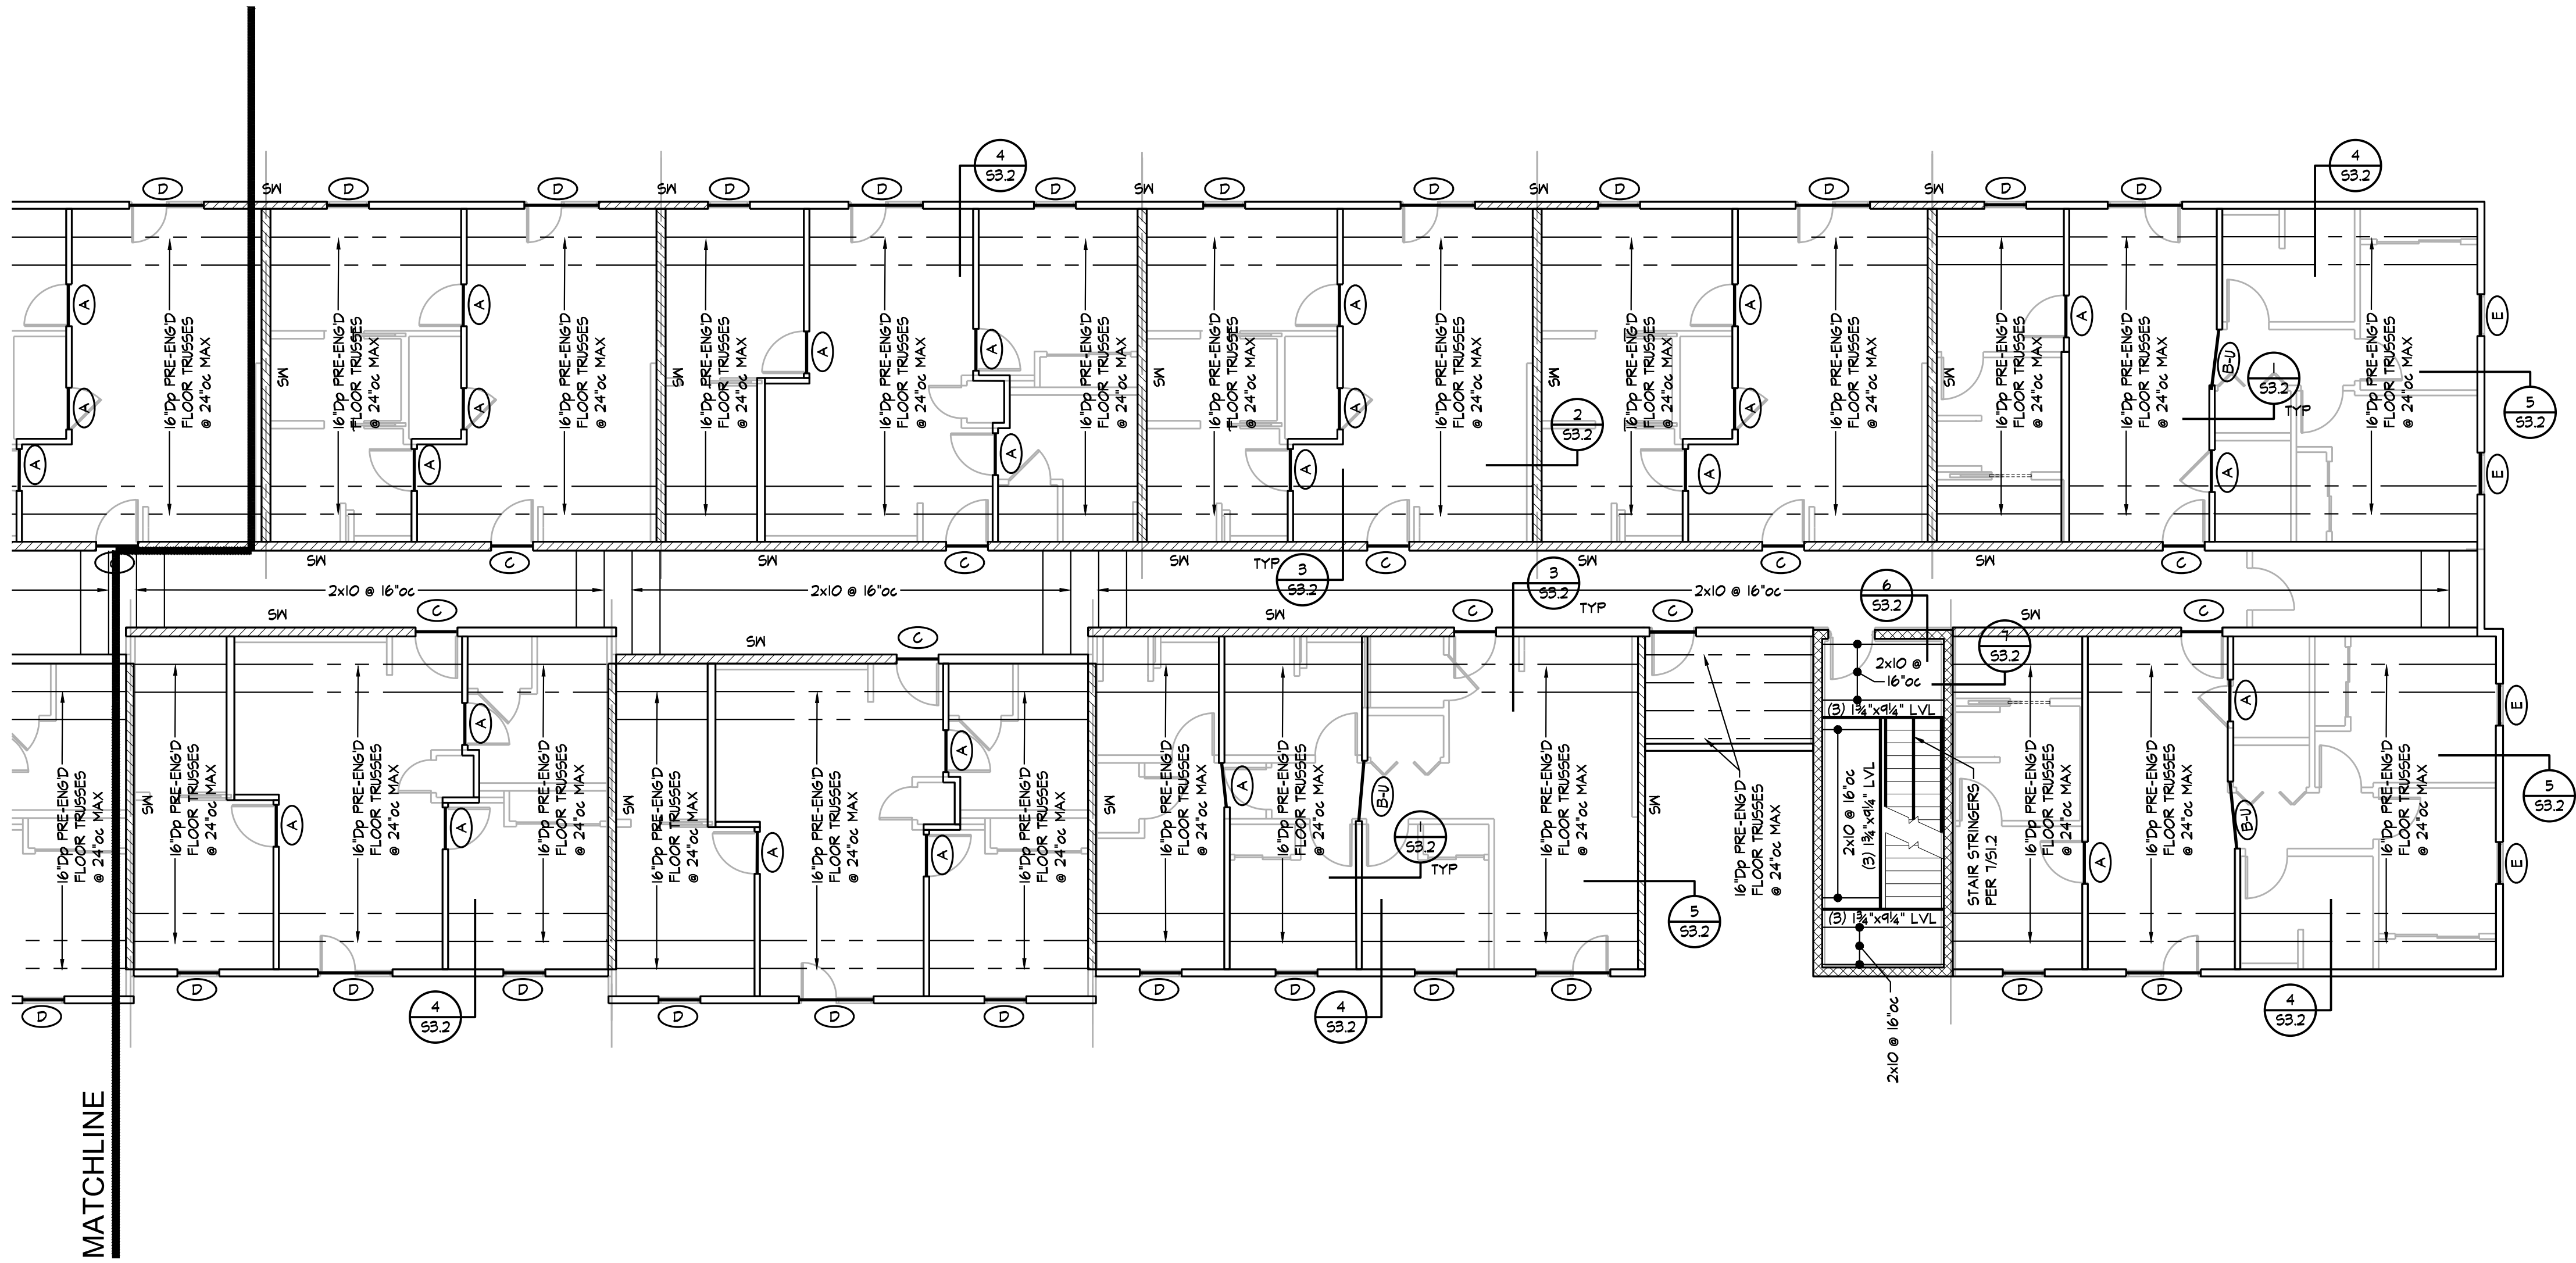

FOURTH FLOOR FRAMING PLAN

1/8" = 1'-0"

NOTES:

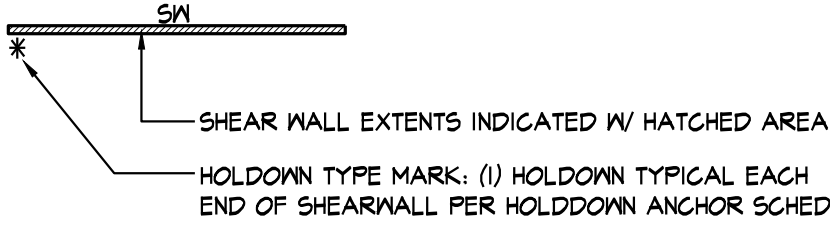1. REFER TO GENERAL NOTES ON SHEET 501
2. REFER TO COLUMN & FOOTING SCHEDULE ON SHEET 511
3. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS NOT SHOWN
4. REFER TO SHEETS 501 AND 511 FOR TYPICAL NAILING WOOD FRAMING DETAILS
5. REFER TO SHEARWALL & HOLDOWN SCHEDULES ON SHEET 512
6. SHEARWALLS/HOLDOWNS DESIGNED AS FOLLOWS:

SHEAR WALL EXTENTS INDICATED W/ HATCHED AREA
HOLDOWN TYPE MARK: (1) HOLDOWN TYPICAL EACH END OF SHEARWALL PER HOLDOWN ANCHOR SCHED.
7. REFER TO SECTIONS 2/51.2 & 3/51.2 FOR HOLDOWNS AT END OF WALL



REVISION:

DATE: 4-17-2026

JOB: 25-3465

SHEET NO.:


S2.4B

THE RESERVES AT MEADOWS 25

NEW APARTMENTS

GODDARD,

KANSAS

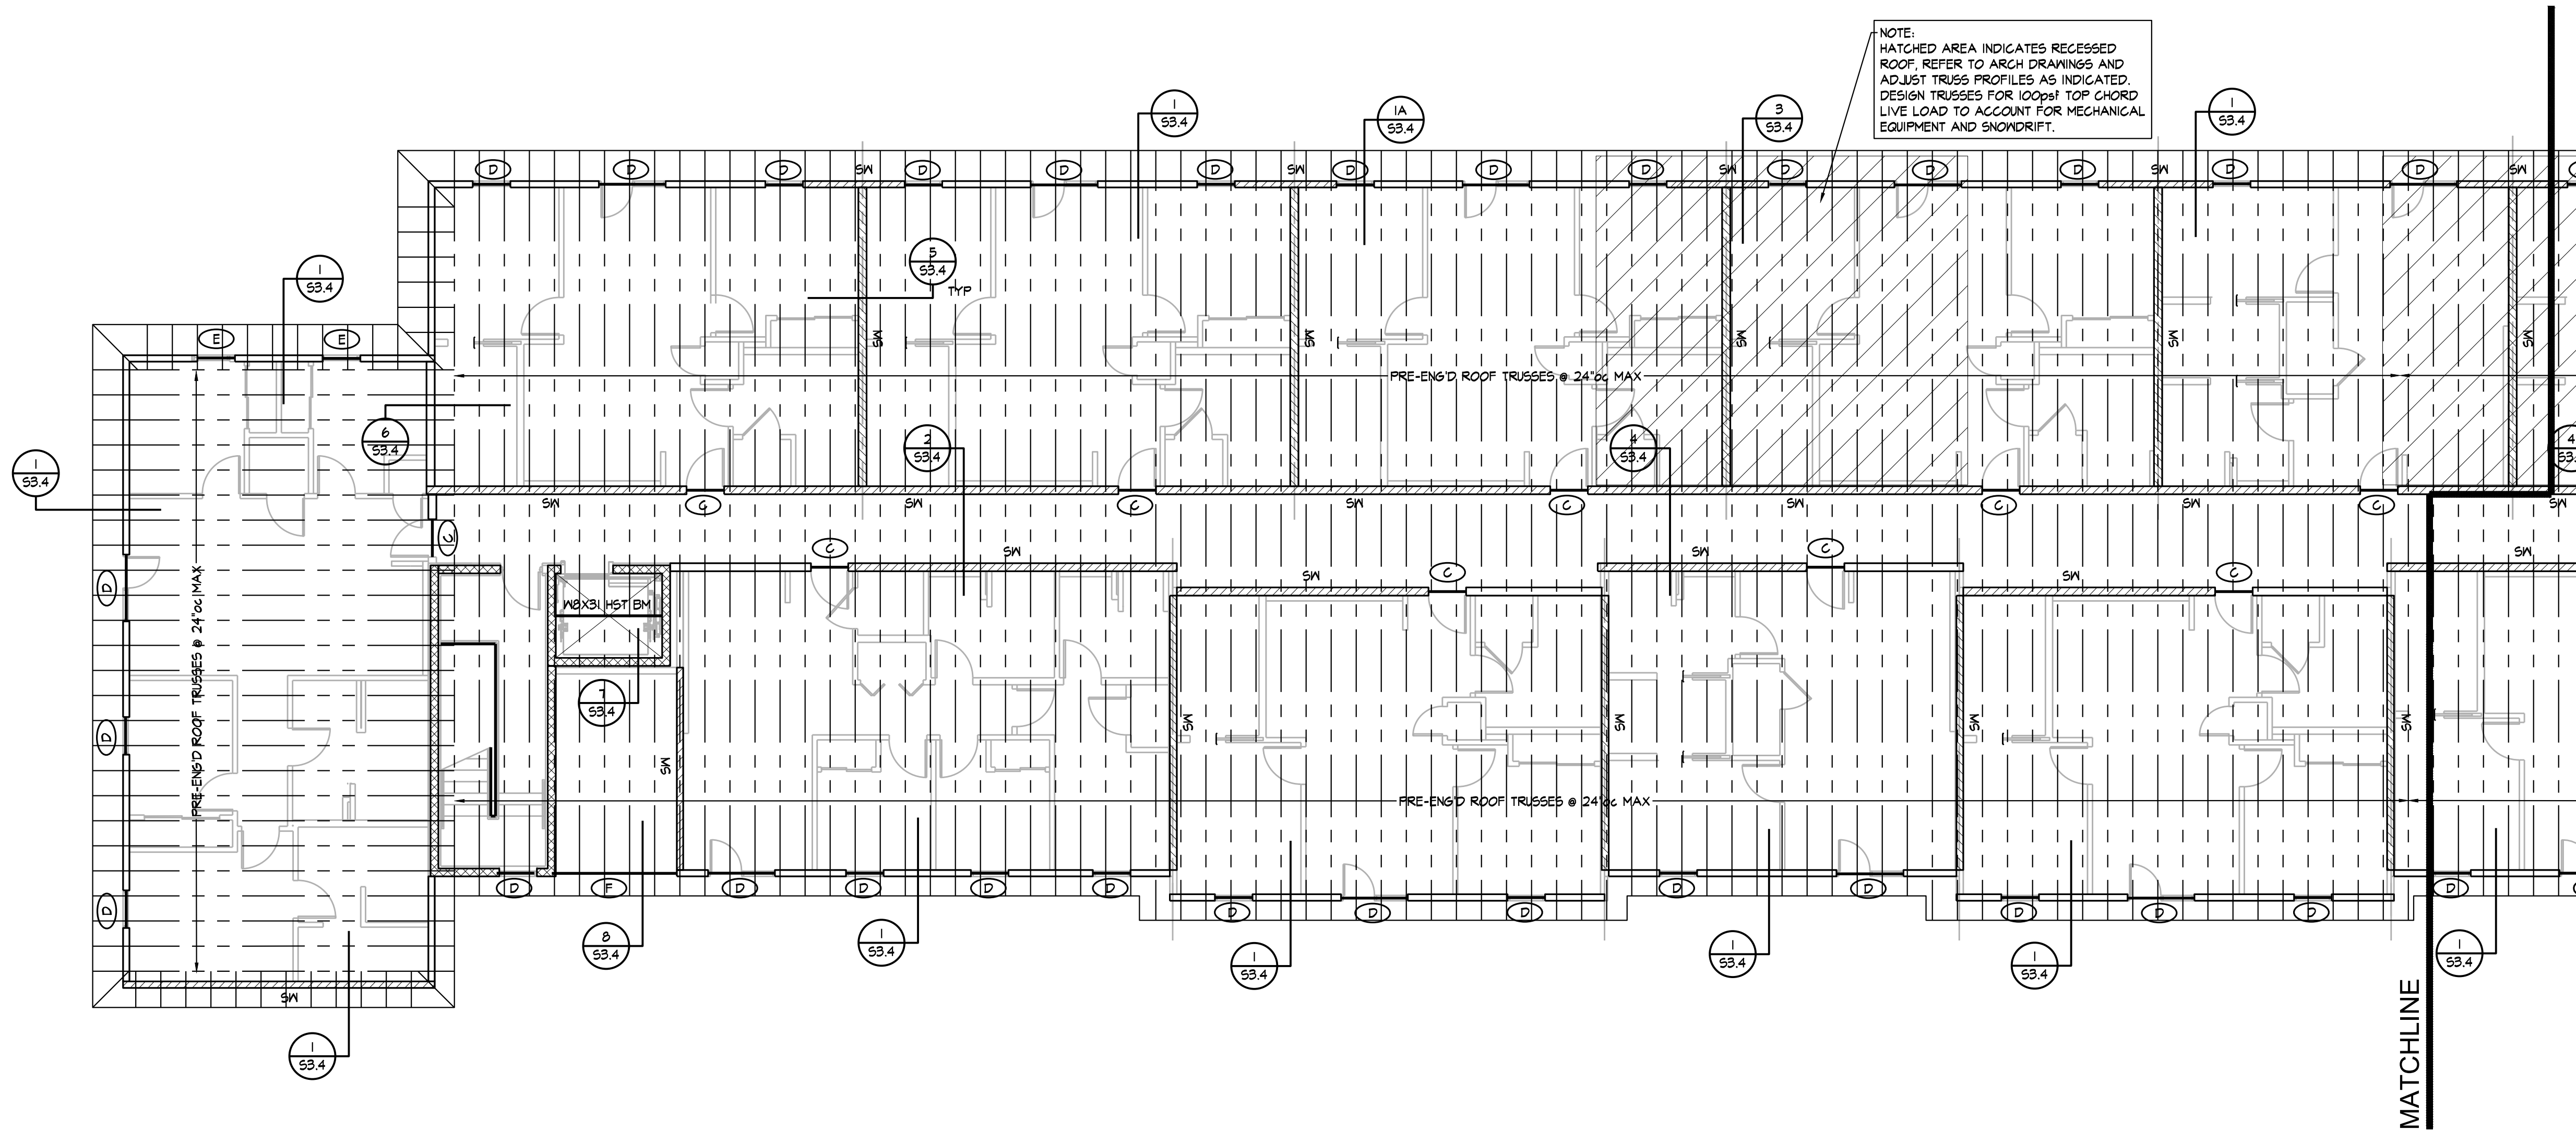

ROOF FRAMING PLAN

- NOTES:
1. REFER TO GENERAL NOTES ON SHEET S0.1
 2. REFER TO COLUMN & FOOTING SCHEDULE ON SHEET S1.1
 3. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS NOT SHOWN
 4. REFER TO SHEETS S0.1 AND S1.1 FOR TYPICAL NAILING WOOD FRAMING DETAILS
 5. REFER TO SHEARWALL & HOLDOWN SCHEDULES ON SHEET S1.2
 6. SHEARWALLS/HOLDOWNS DESIGNED AS FOLLOWS:
- SW
- SHEAR WALL EXTENTS INDICATED W/ HATCHED AREA
- HOLDOWN TYPE MARK: (1) HOLDOWN TYPICAL EACH END OF SHEARWALL PER HOLDOWN ANCHOR SCHED.
7. REFER TO SECTIONS 2/S1.2 & 3/S1.2 FOR HOLDOWNS AT END OF WALL

BOB D. CAMPBELL & CO.
Structural Engineers Since 1957
4338 Belleview Ave. 816.531.4144
Kansas City, MO 64111 www.bdc-engrs.com


THE RESERVES AT MEADOWS 25
NEW APARTMENTS
GODDARD, KANSAS



REVISION:

DATE: 4-17-2026
JOB: 25-3465
SHEET NO.:

S2.5A

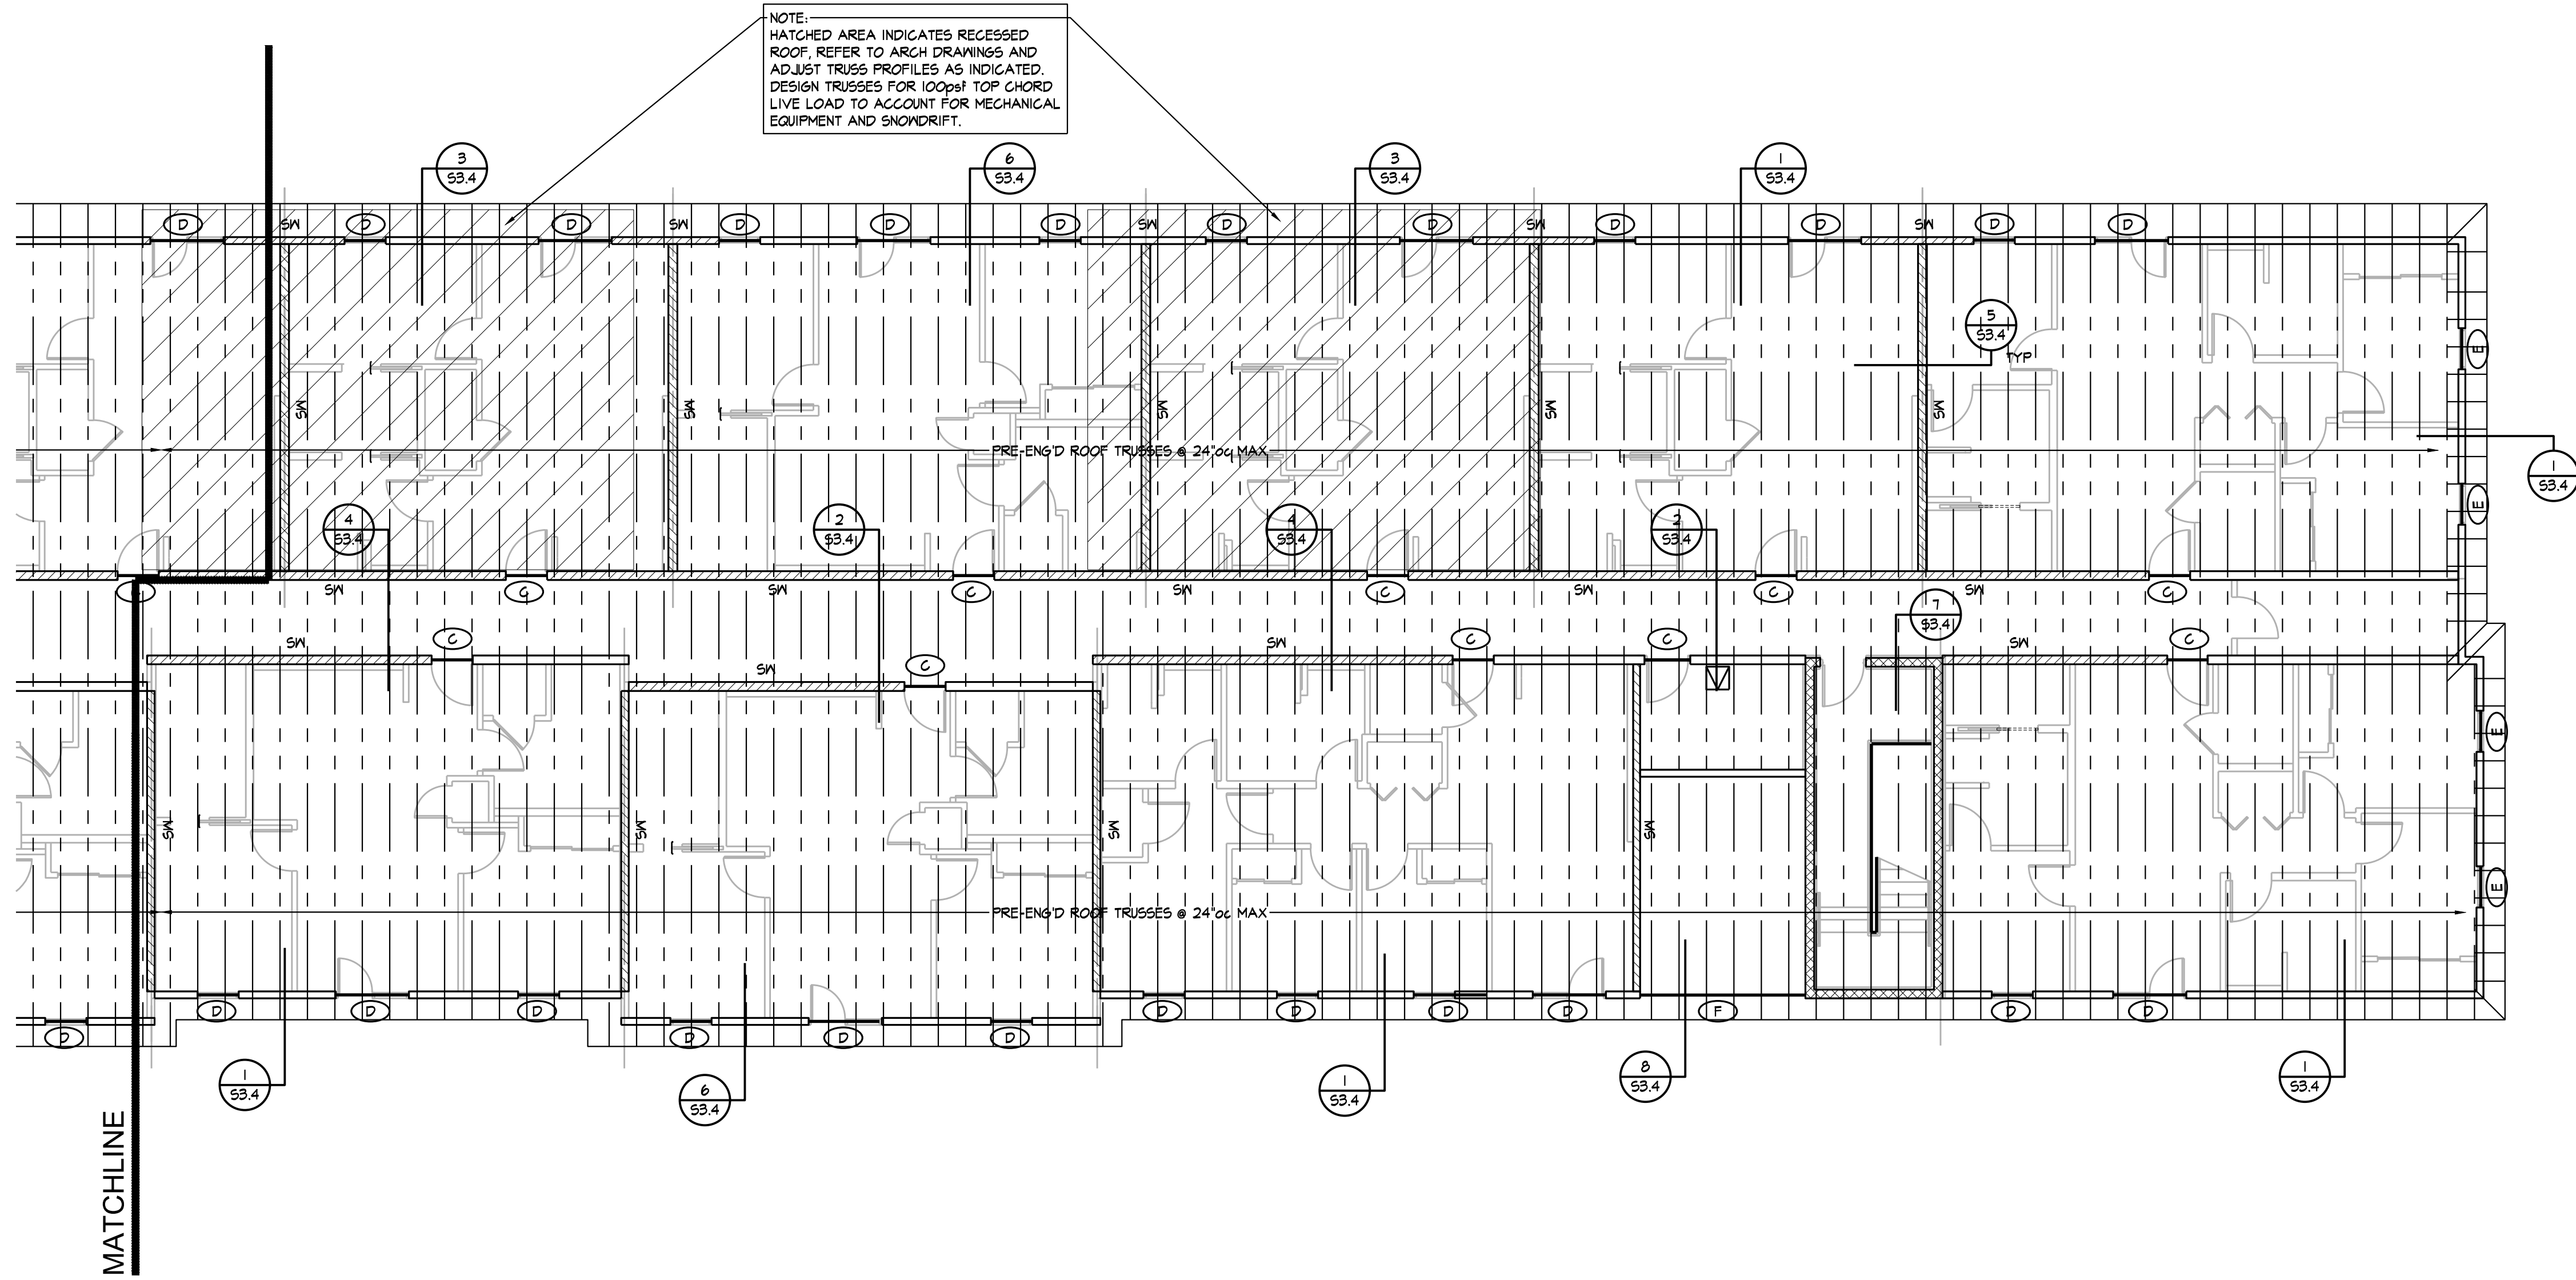

ROOF FRAMING PLAN

1/8" = 1'-0"

NOTES:

1. REFER TO GENERAL NOTES ON SHEET S0.1
2. REFER TO COLUMN & FOOTING SCHEDULE ON SHEET S1.1
3. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS NOT SHOWN
4. REFER TO SHEETS S0.1 AND S1.1 FOR TYPICAL NAILING WOOD FRAMING DETAILS
5. REFER TO SHEARWALL & HOLDOWN SCHEDULES ON SHEET S1.2
6. SHEARWALLS/HOLDOWNS DESIGNED AS FOLLOWS:



SHEAR WALL EXTENTS INDICATED W/ HATCHED AREA

HOLDOWN TYPE MARK: (1) HOLDOWN TYPICAL EACH
END OF SHEARWALL PER HOLDOWN ANCHOR SCHED.

1. REFER TO SECTIONS 2/S1.2 & 3/S1.2 FOR HOLDOWNS AT END OF WALL

REVISION:

DATE: 4-17-2026

JOB: 25-3465

SHEET NO.:


S2.5B

THE RESERVES AT MEADOWS 25

NEW APARTMENTS

GODDARD,

KANSAS

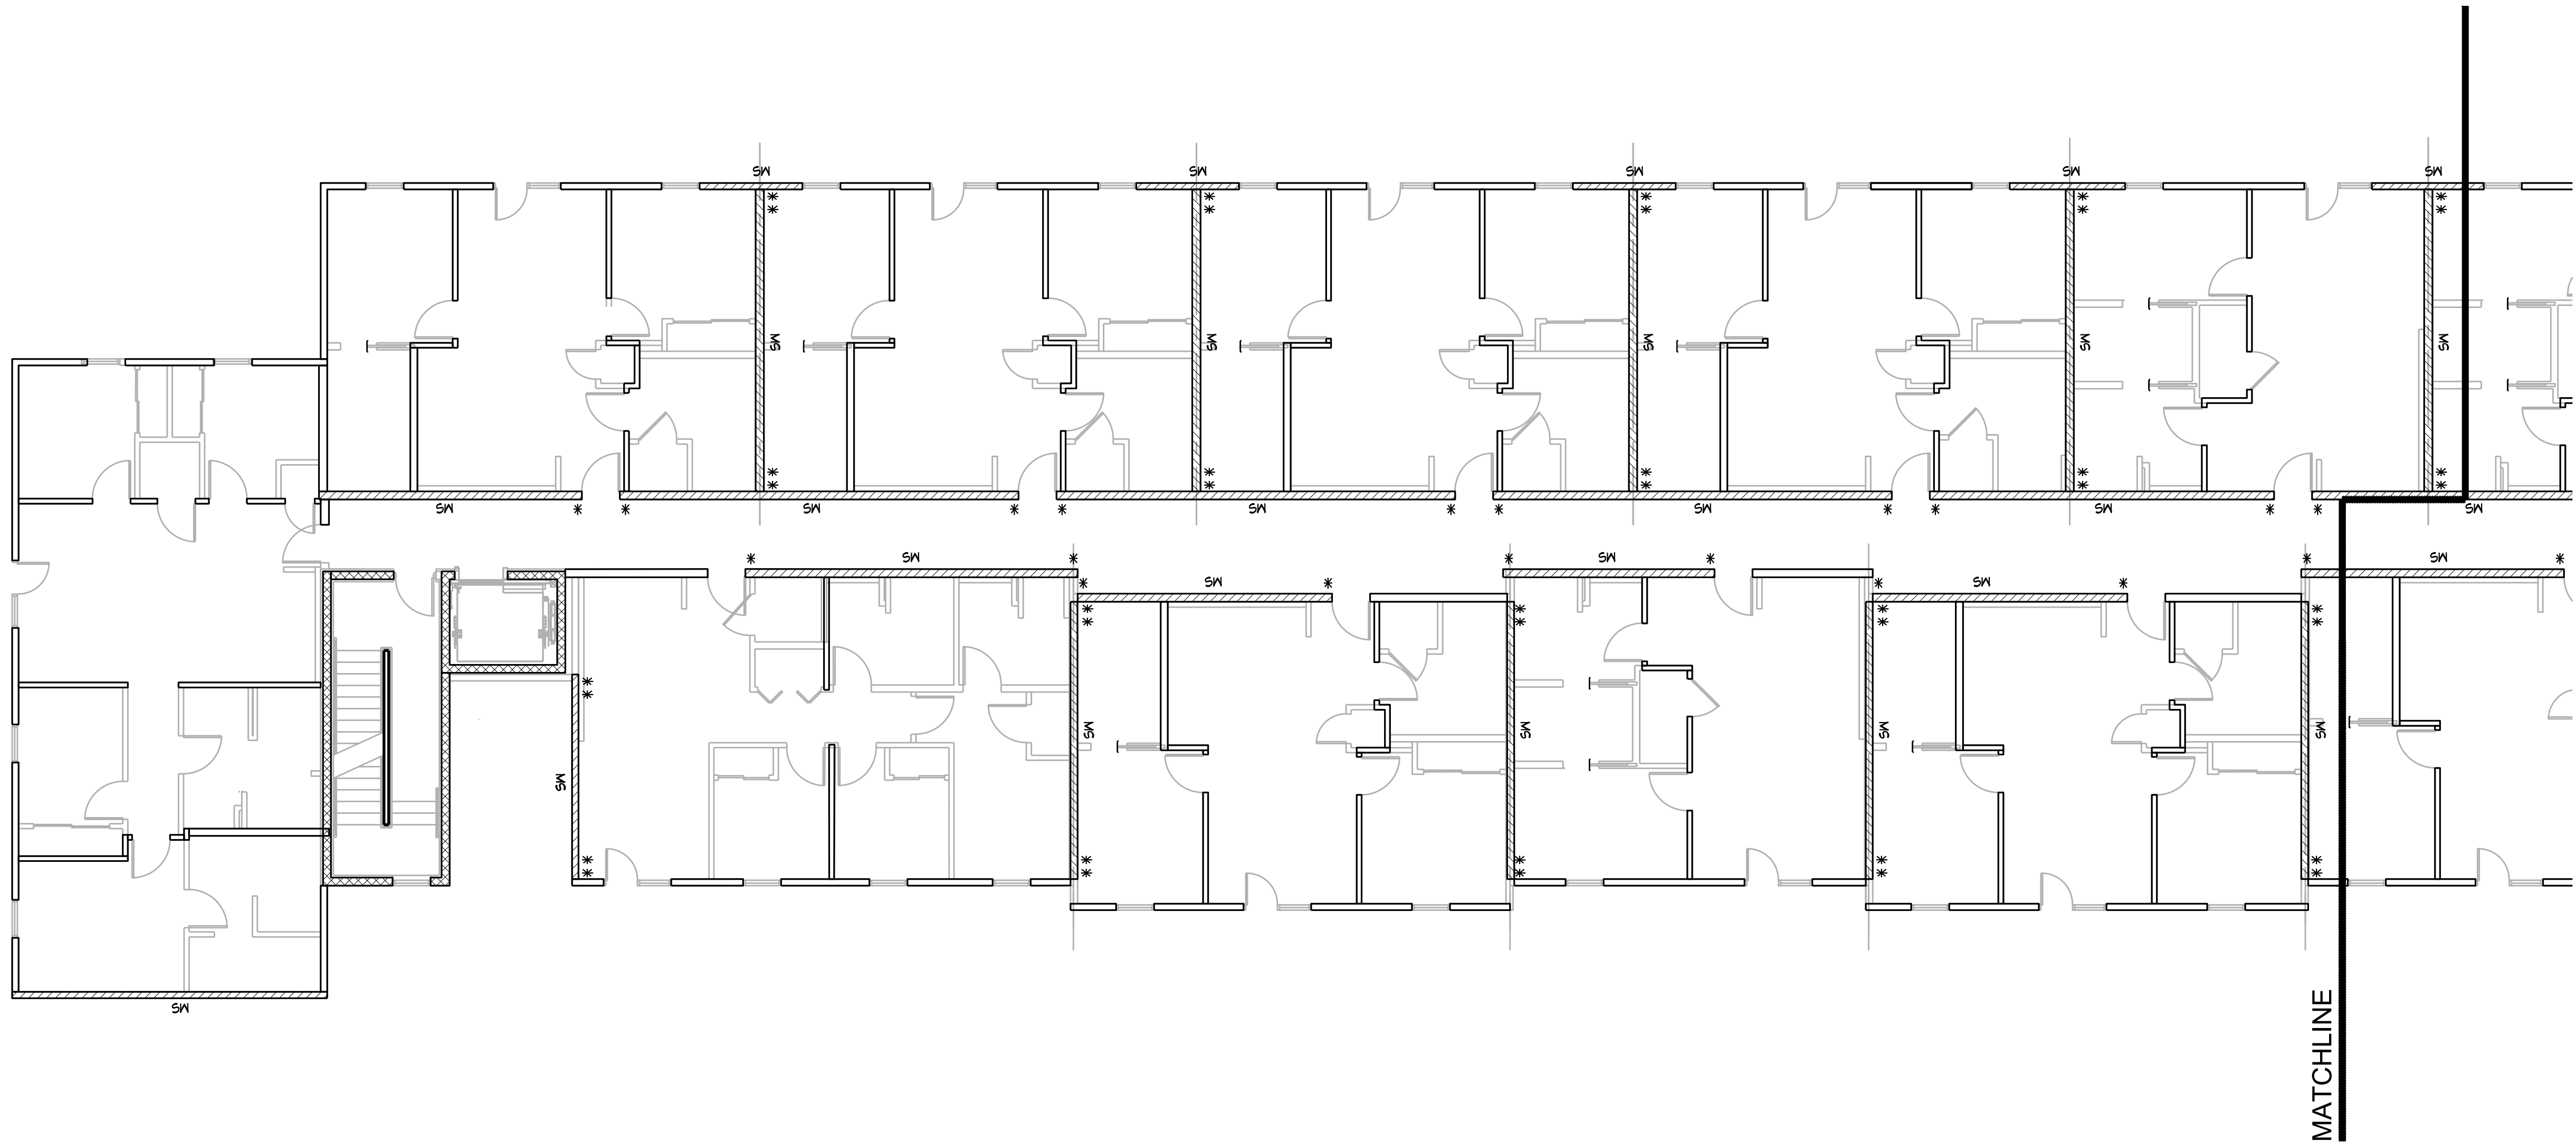

SHEARWALL PLAN

1/8" = 1'-0"

NOTES:

1. REFER TO GENERAL NOTES ON SHEET S01.
2. REFER TO COLUMN & FOOTING SCHEDULE ON SHEET S11.
3. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS NOT SHOWN.
4. REFER TO SHEETS S01 AND S11 FOR TYPICAL NAILING WOOD FRAMING DETAILS.
5. REFER TO SHEARWALL & HOLDOWN SCHEDULES ON SHEET S12.
6. SHEARWALLS/HOLDOWNS DESIGNED AS FOLLOWS:

SW

SHEAR WALL EXTENTS INDICATED W/ HATCHED AREA

HOLDOWN TYPE MARK: (1) HOLDOWN TYPICAL EACH
END OF SHEARWALL PER HOLDOWN ANCHOR SCHED.

7. REFER TO SECTIONS 2/S1.2 & 3/S1.2 FOR HOLDOWNS AT END OF WALL.


BOB D. CAMPBELL & CO.
Structural Engineers Since 1957
4338 Belleview Ave. 816.531.4144
Kansas City, MO 64111 www.bdc-engrs.com



REVISION:

DATE: 4-17-2026

JOB: 25-3465

SHEET NO.:

S2.6A

THE RESERVES AT MEADOWS 25


NEW APARTMENTS

GODDARD,


KANSAS

JGR JonesGillamRenz
730 N. Ninth 1881 Main Street, Suite 301
Salina, KS 67401 Kansas City, MO 64108
785.827.0386 jgr@jgarchitects.com

COPYRIGHTED ©

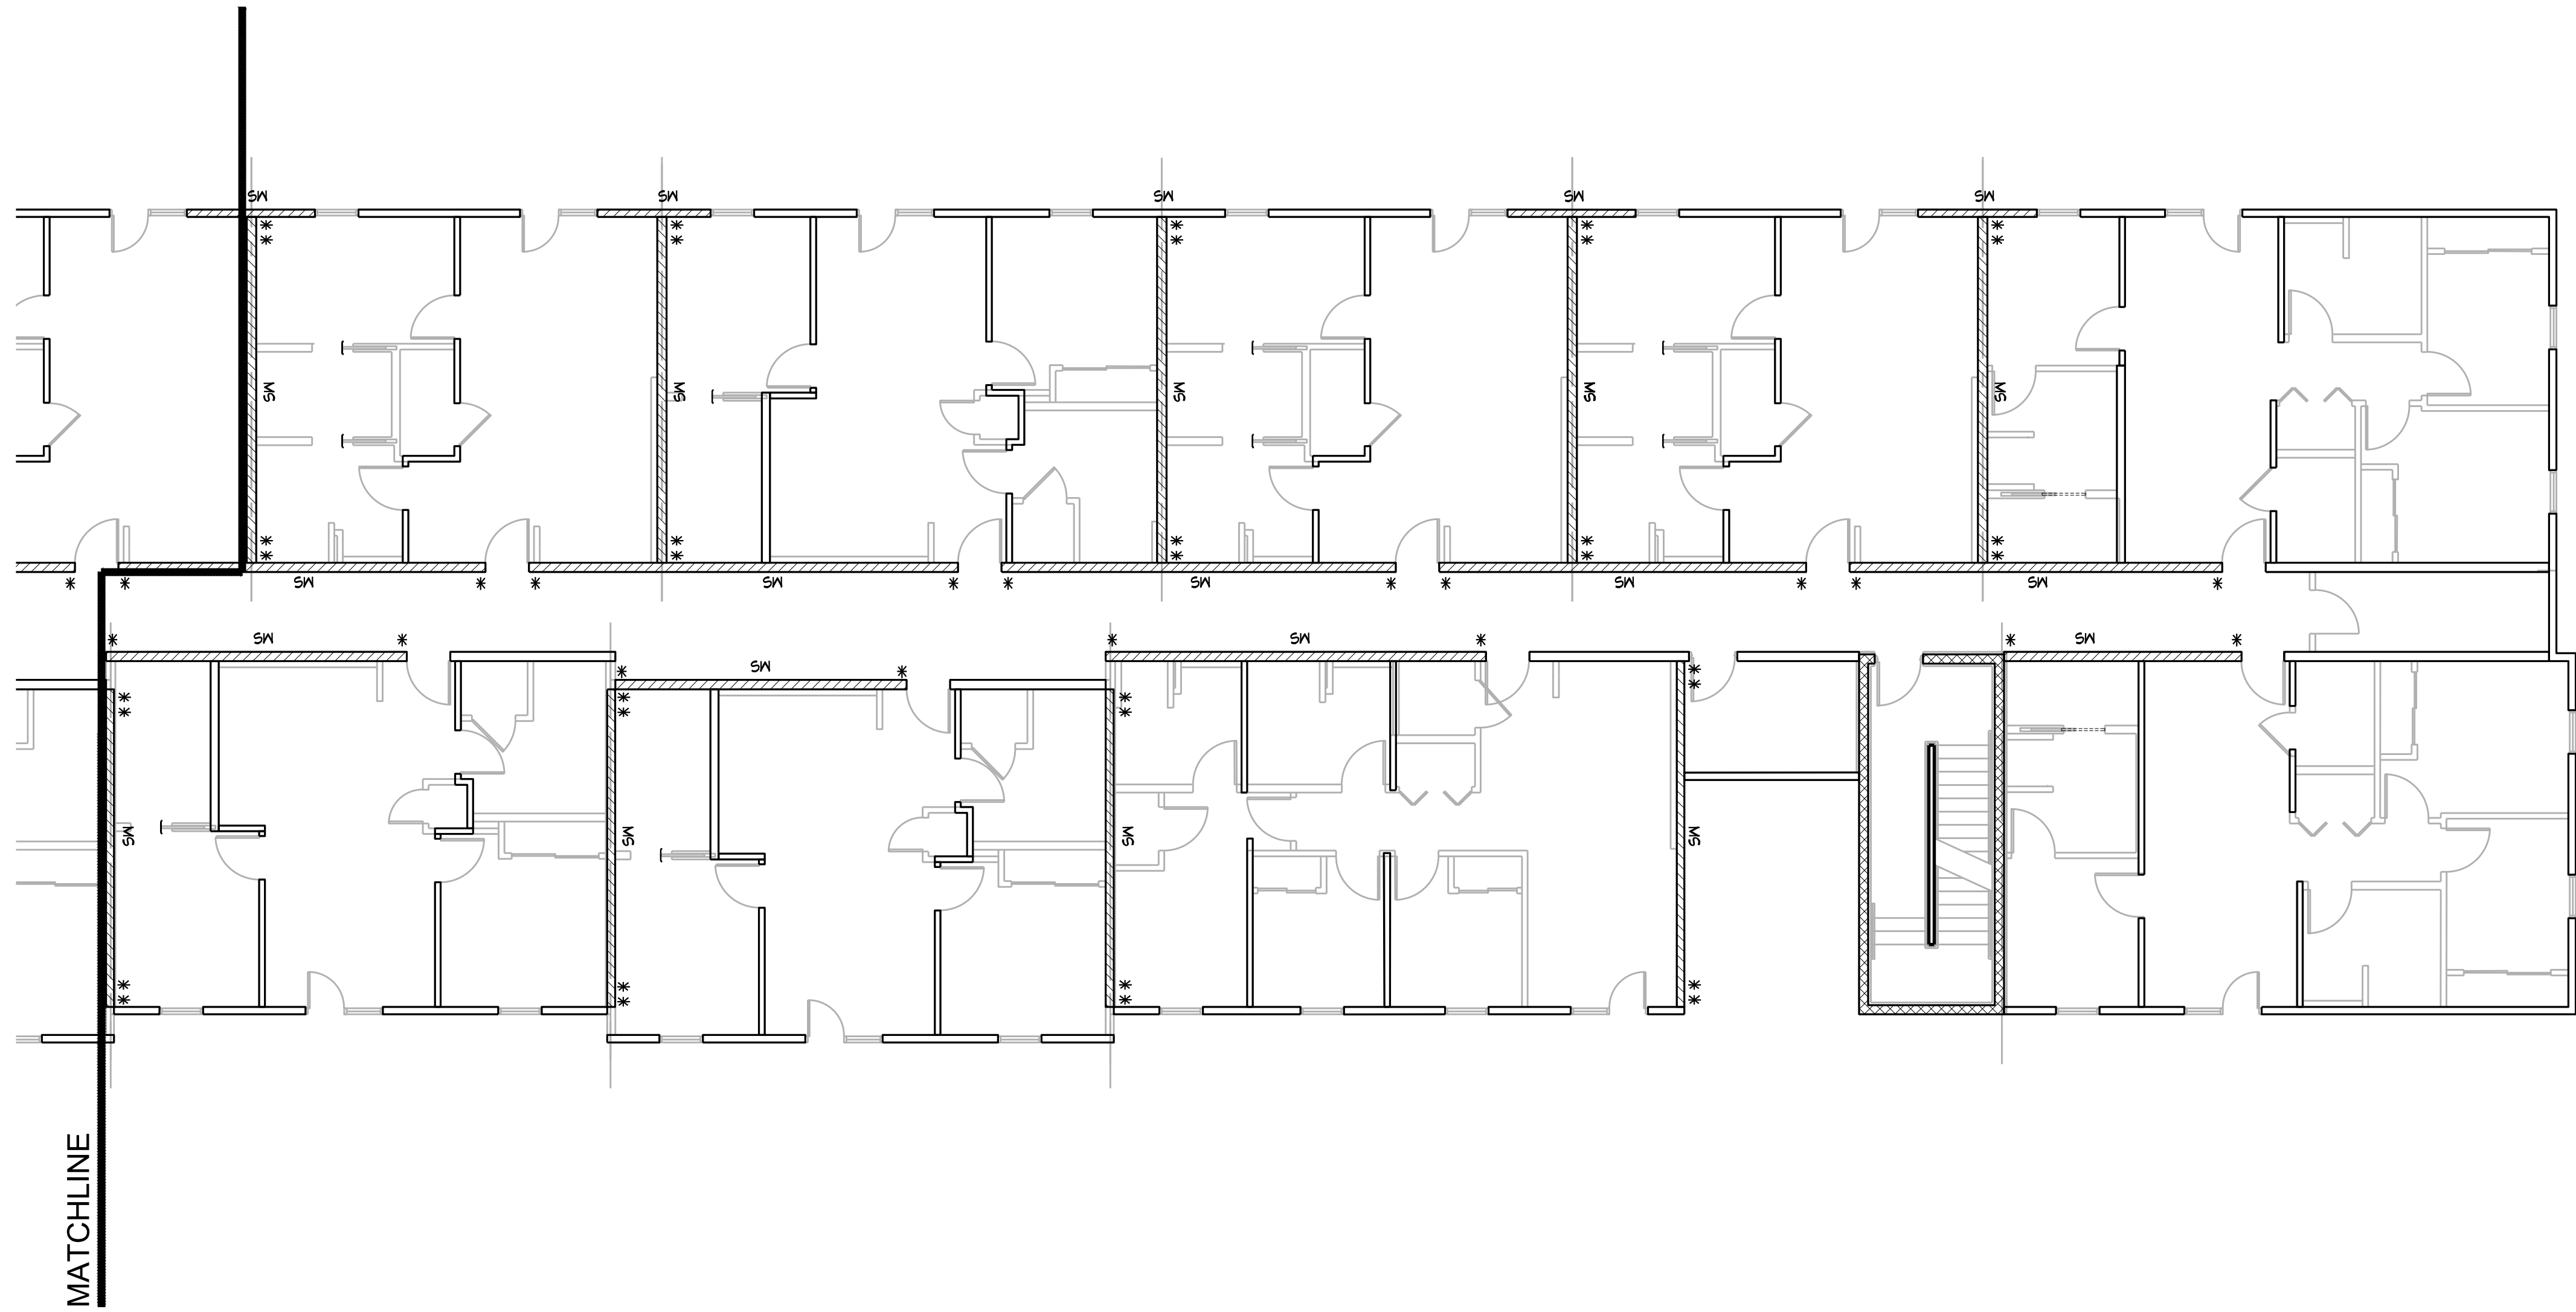

 SHEARWALL PLAN
1/8" = 1'-0"

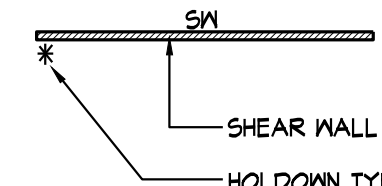- NOTES:
1. REFER TO GENERAL NOTES ON SHEET S01
 2. REFER TO COLUMN & FOOTING SCHEDULE ON SHEET S11
 3. REFER TO ARCHITECTURAL DRAWINGS FOR DIMENSIONS NOT SHOWN
 4. REFER TO SHEETS S01 AND S11 FOR TYPICAL NAILING WOOD FRAMING DETAILS
 5. REFER TO SHEARWALL & HOLDOWN SCHEDULES ON SHEET S12
 6. SHEARWALLS/HOLDOWNS DESIGNED AS FOLLOWS:

SHEAR WALL EXTENTS INDICATED W/ HATCHED AREA
HOLDOWN TYPE MARK: (1) HOLDOWN TYPICAL EACH END OF SHEARWALL PER HOLDOWN ANCHOR SCHED.
 7. REFER TO SECTIONS 2/51.2 & 3/51.2 FOR HOLDOWNS AT END OF WALL






















REVISION:

DATE: 4-17-2026
JOB: 25-3465
SHEET NO.:


S2.6B

THE RESERVES AT MEADOWS 25
NEW APARTMENTS
GODDARD, KANSAS

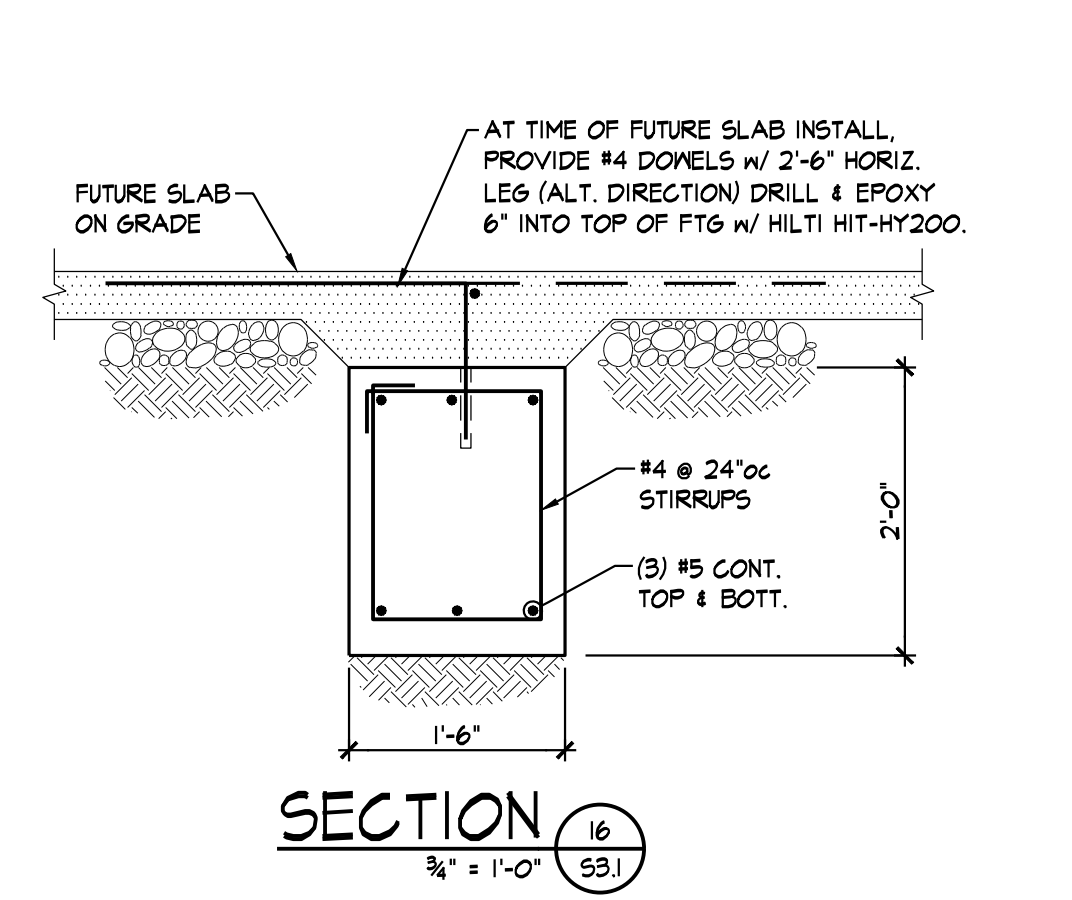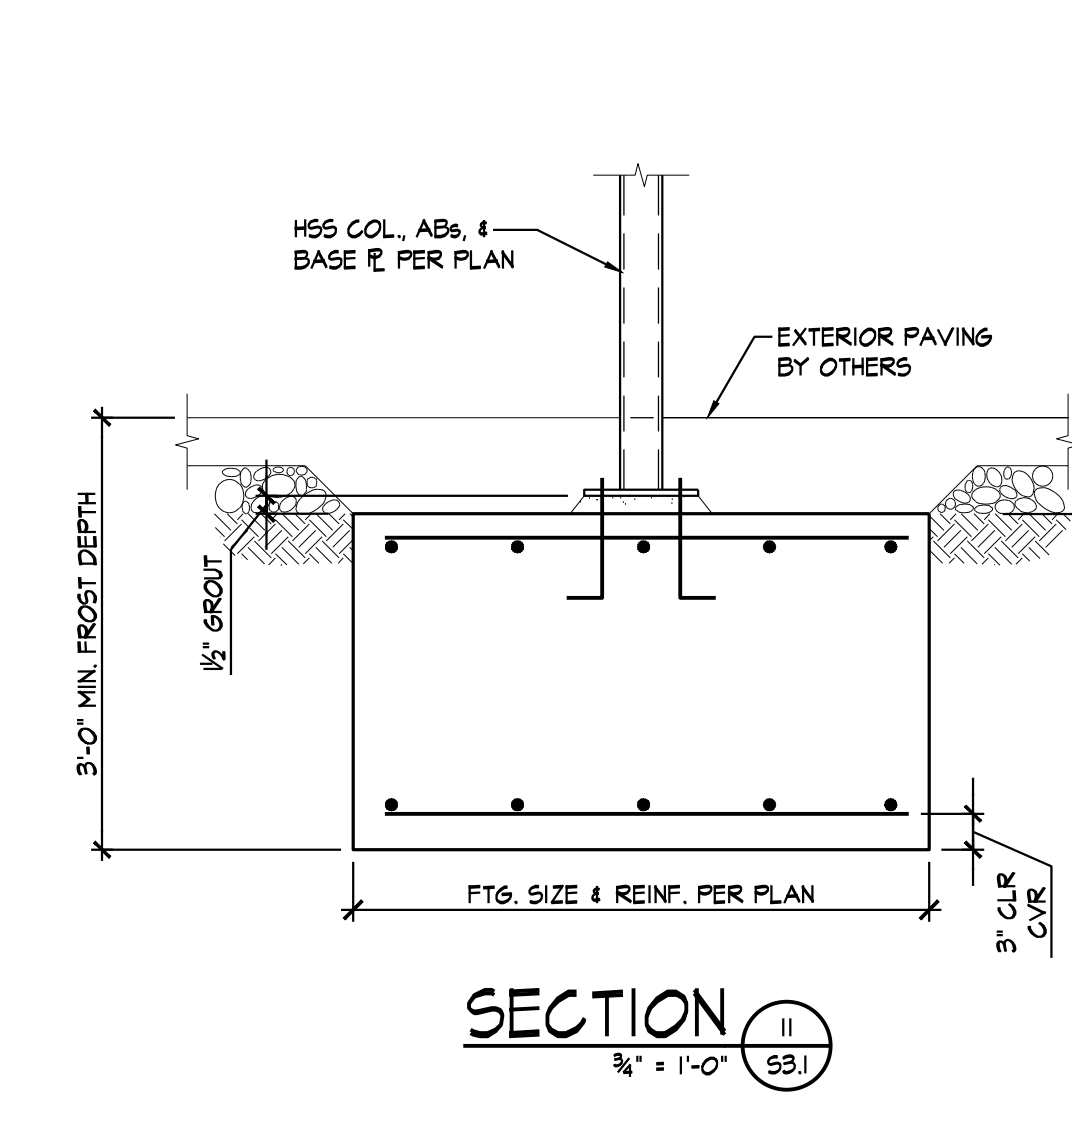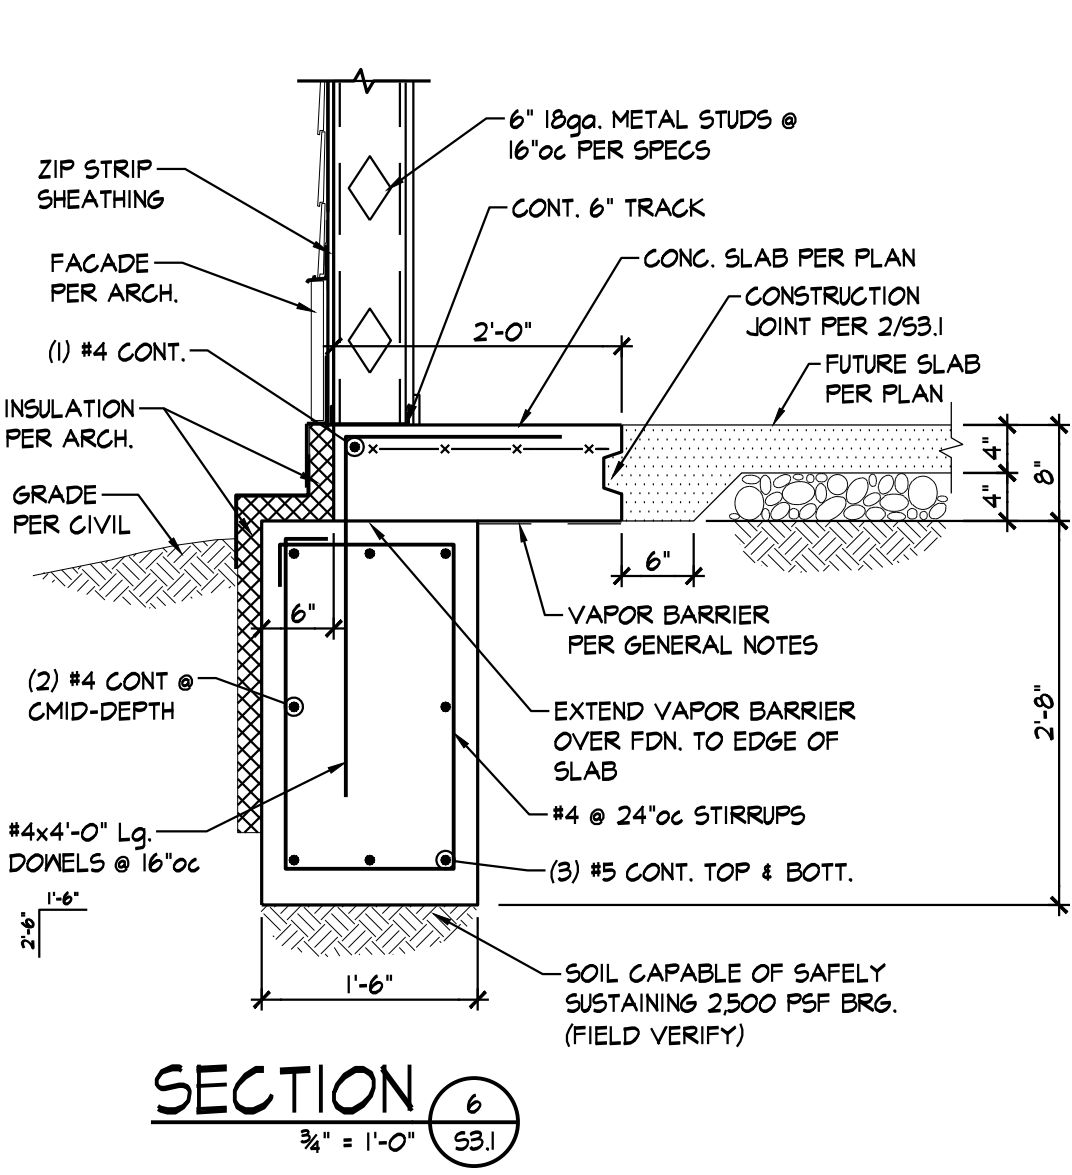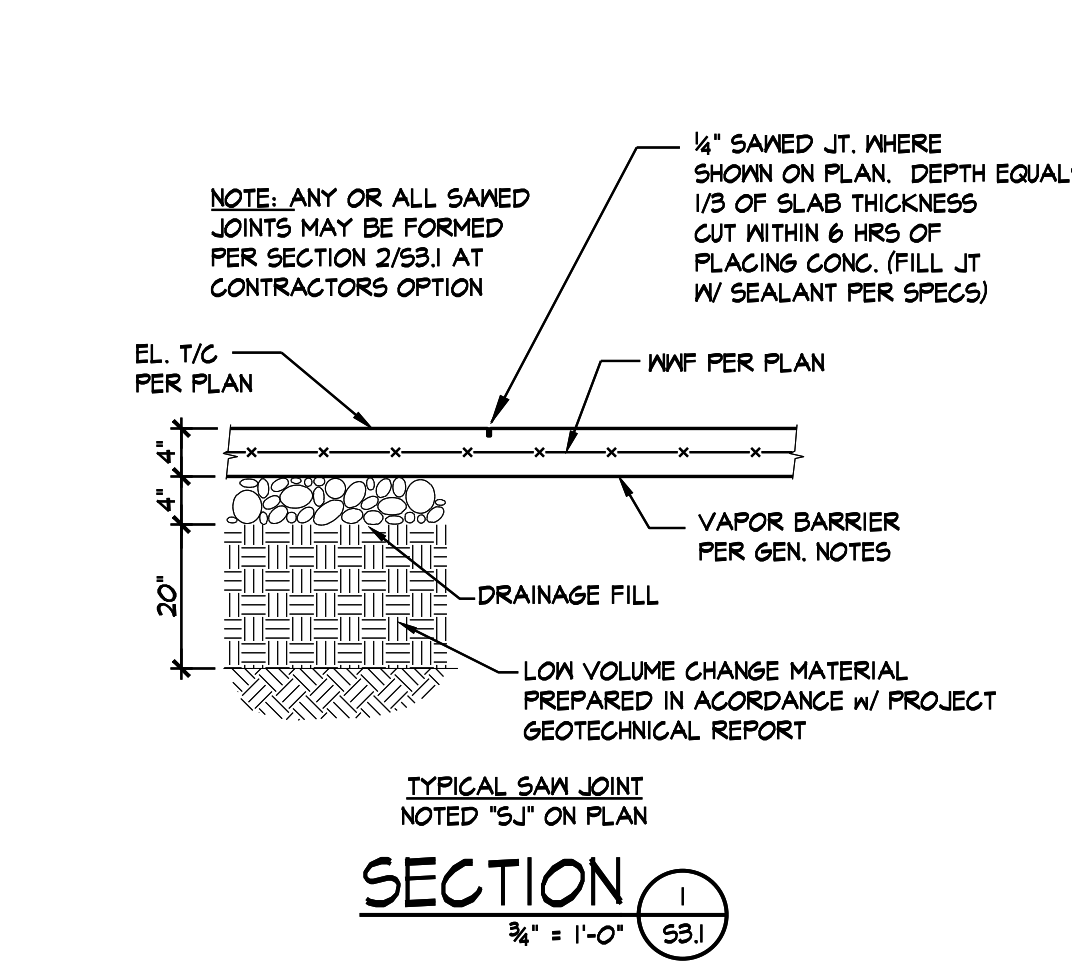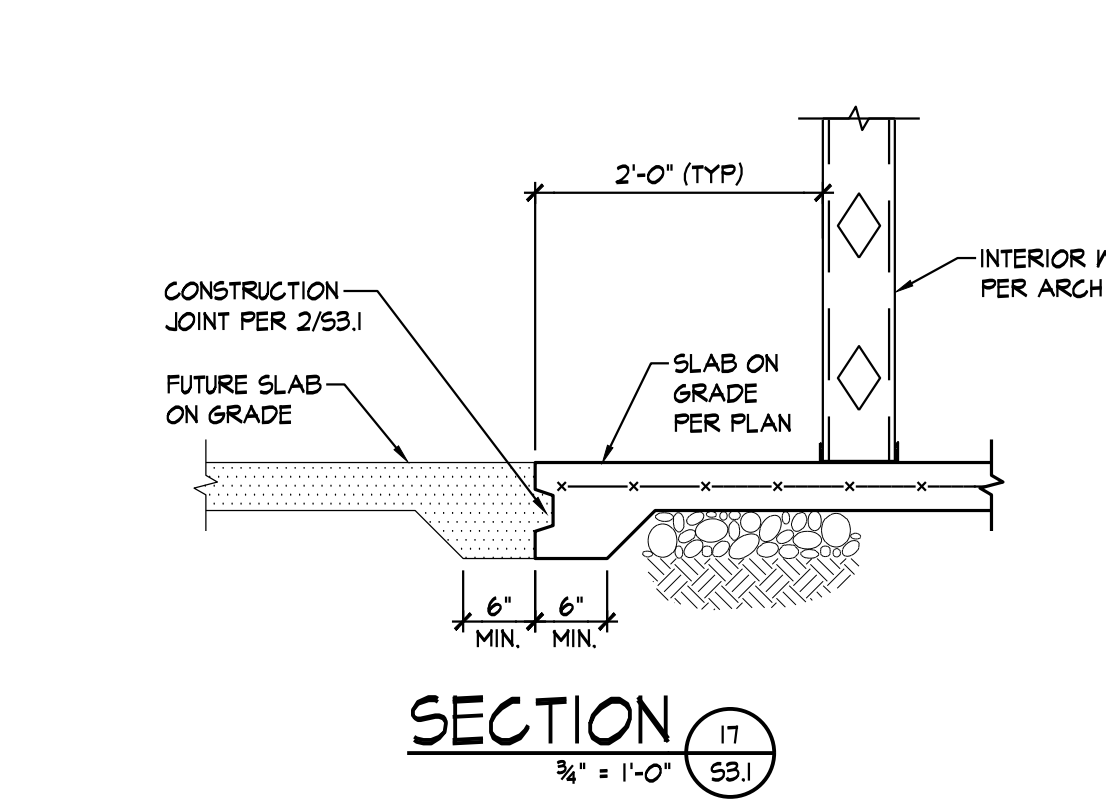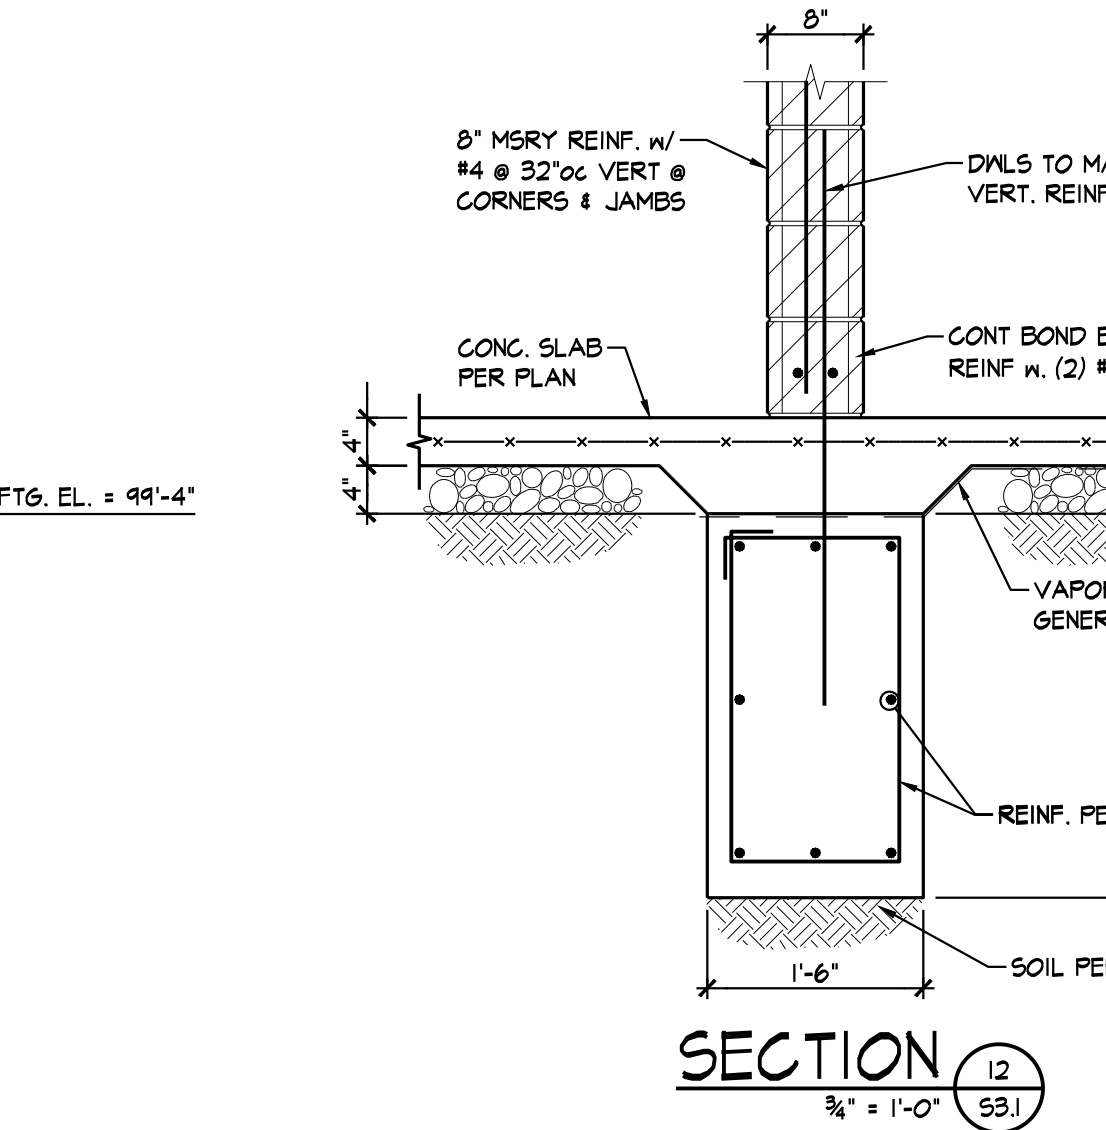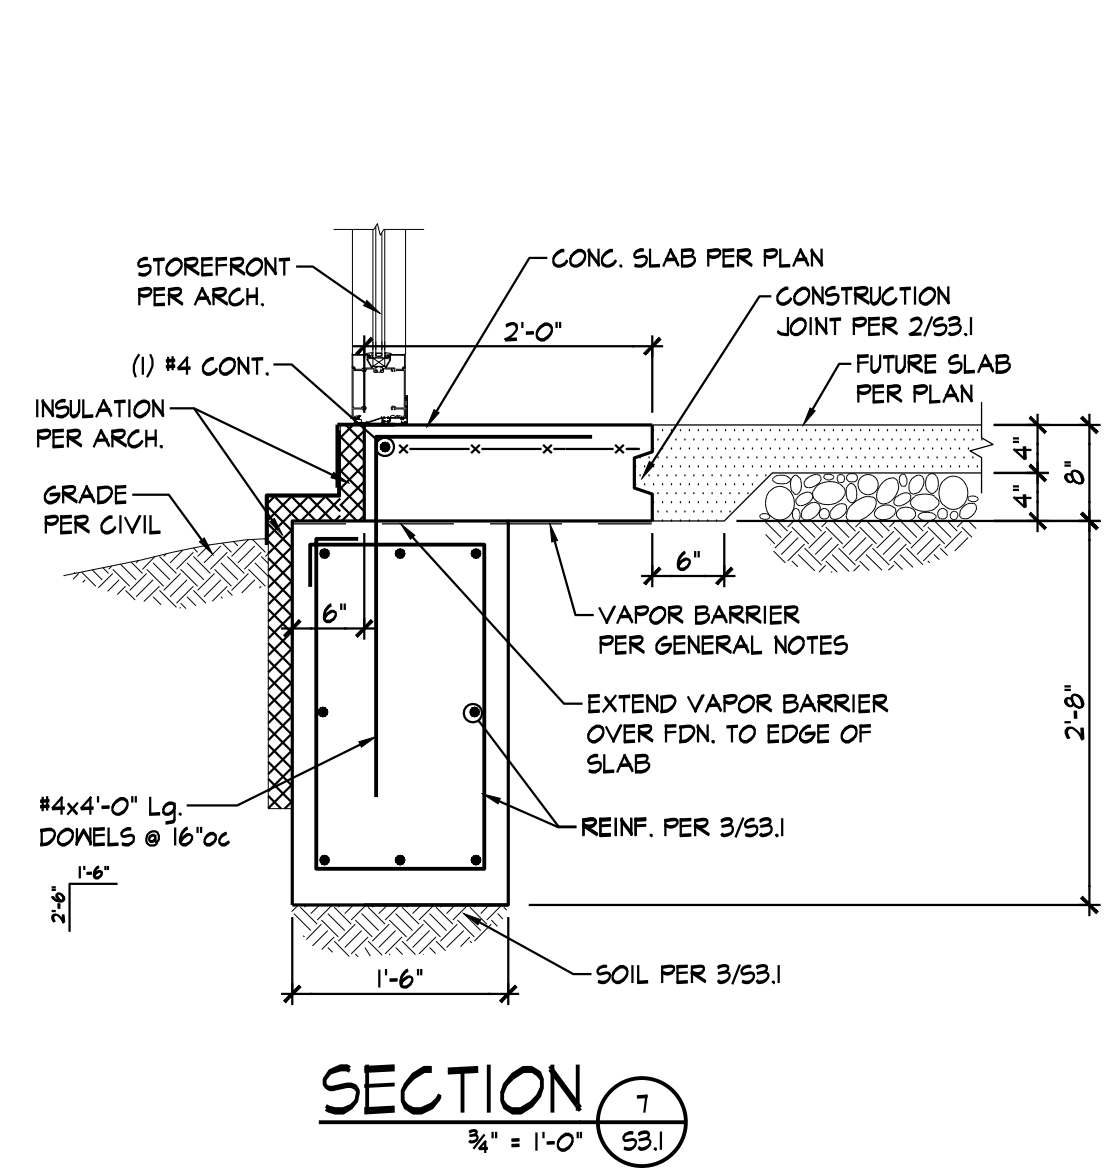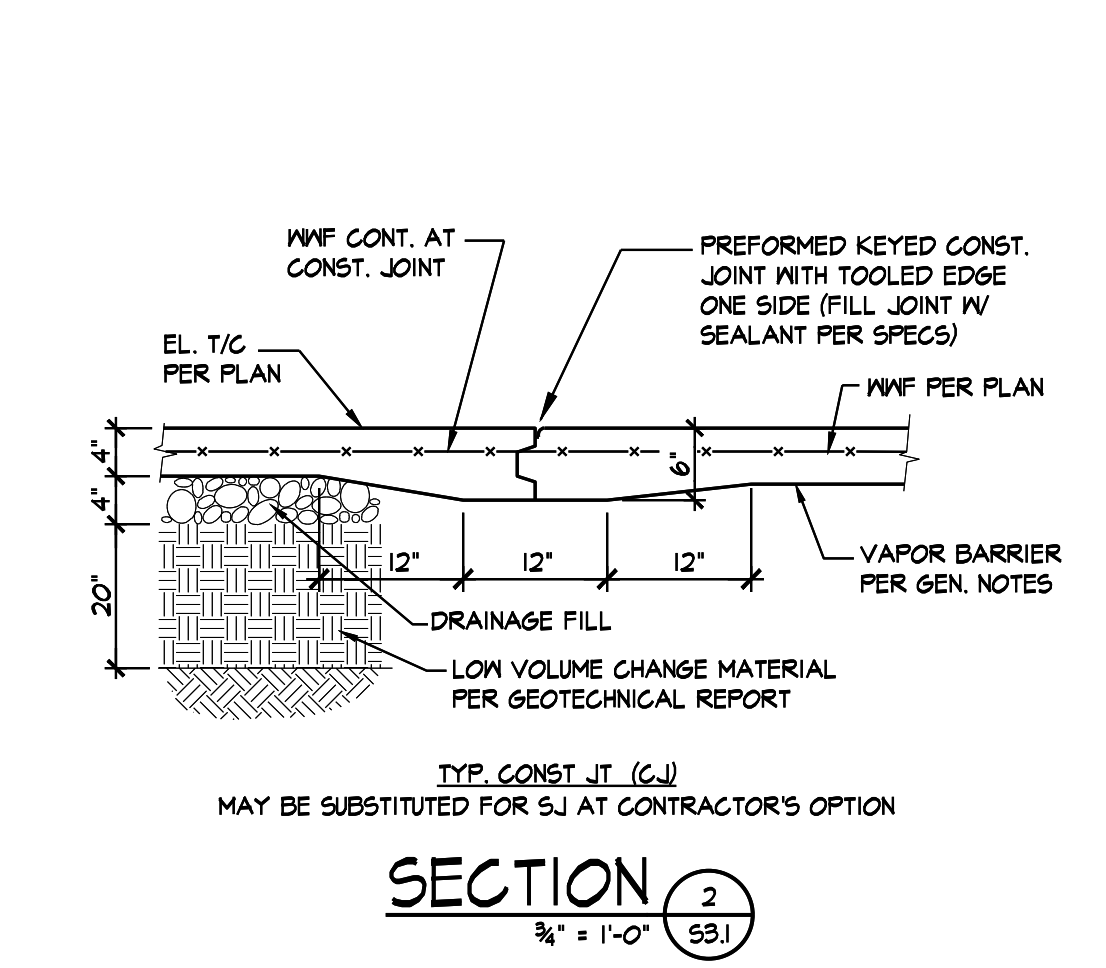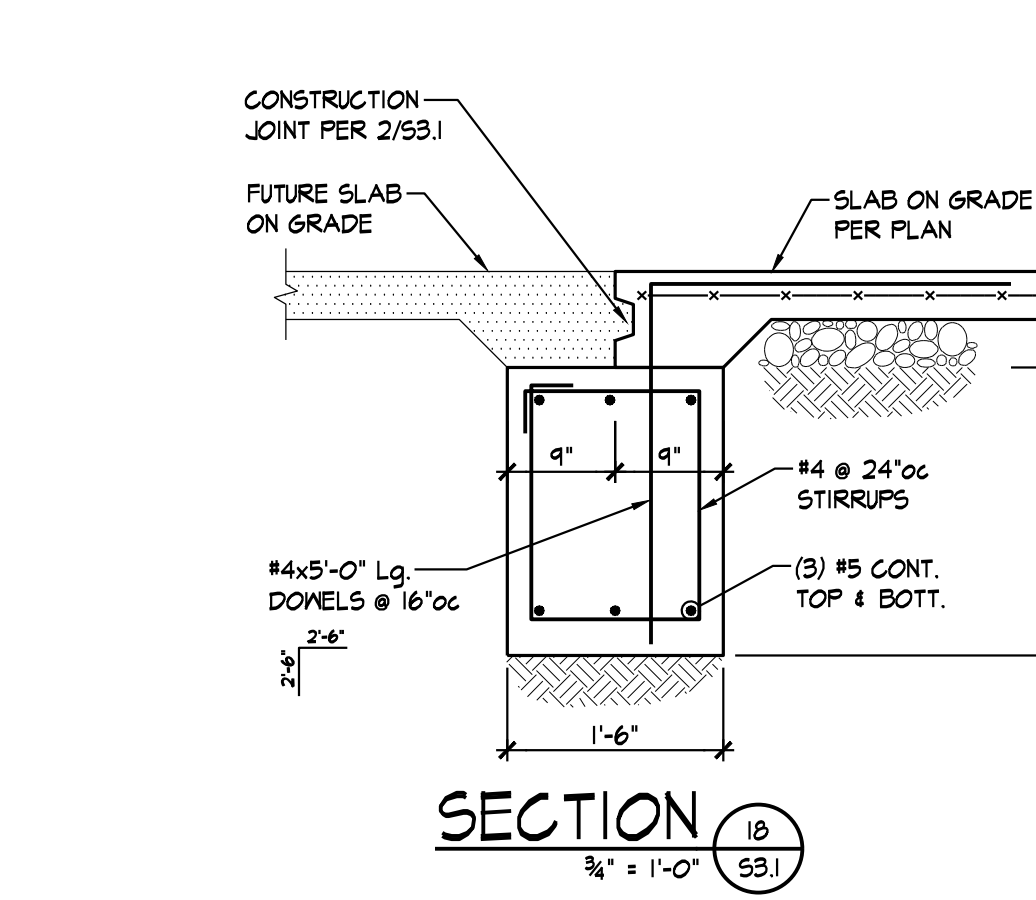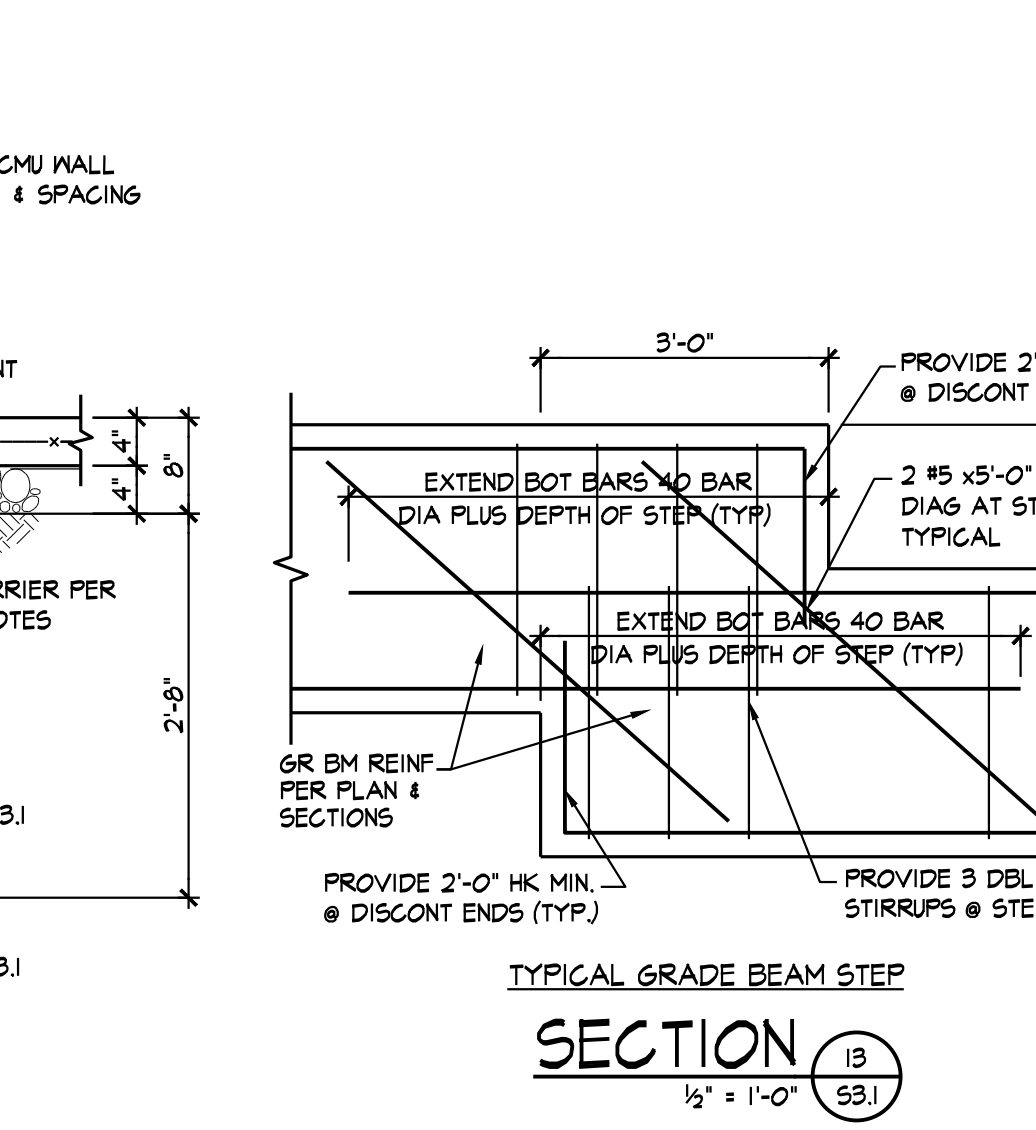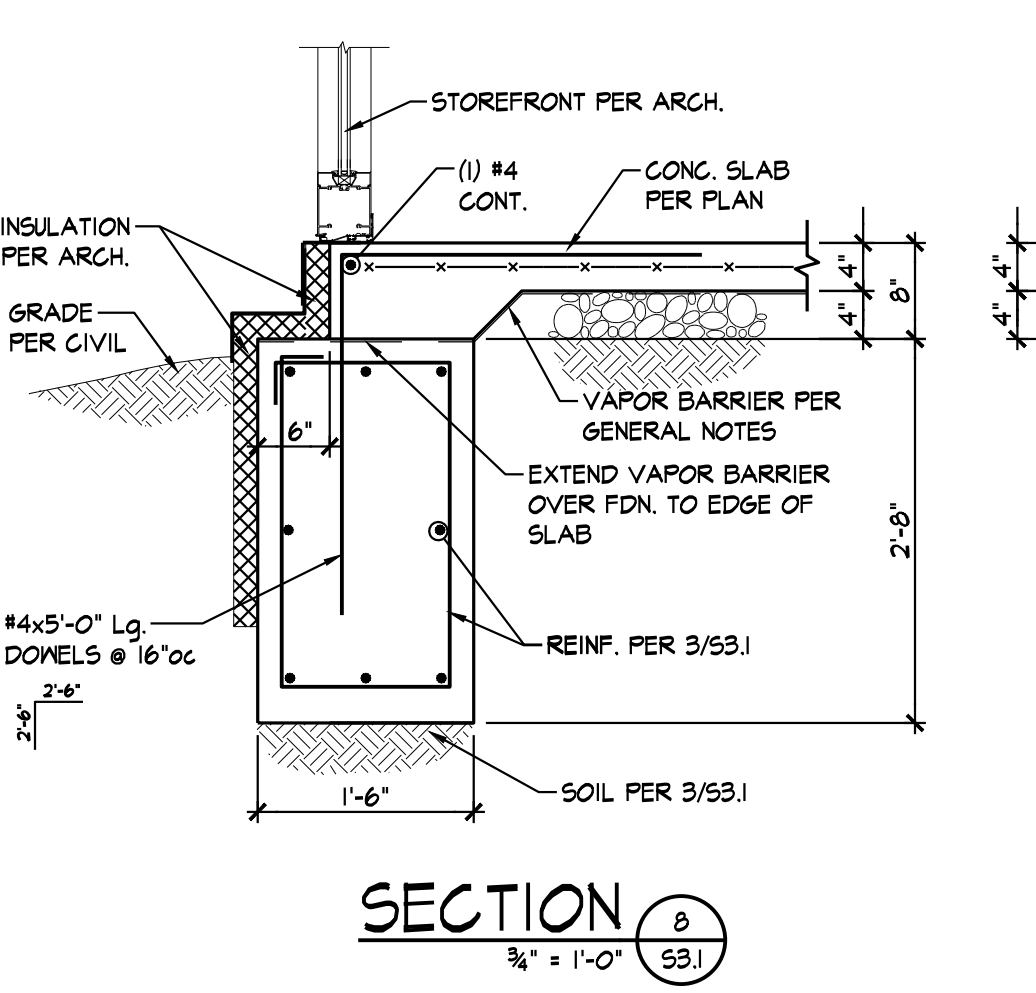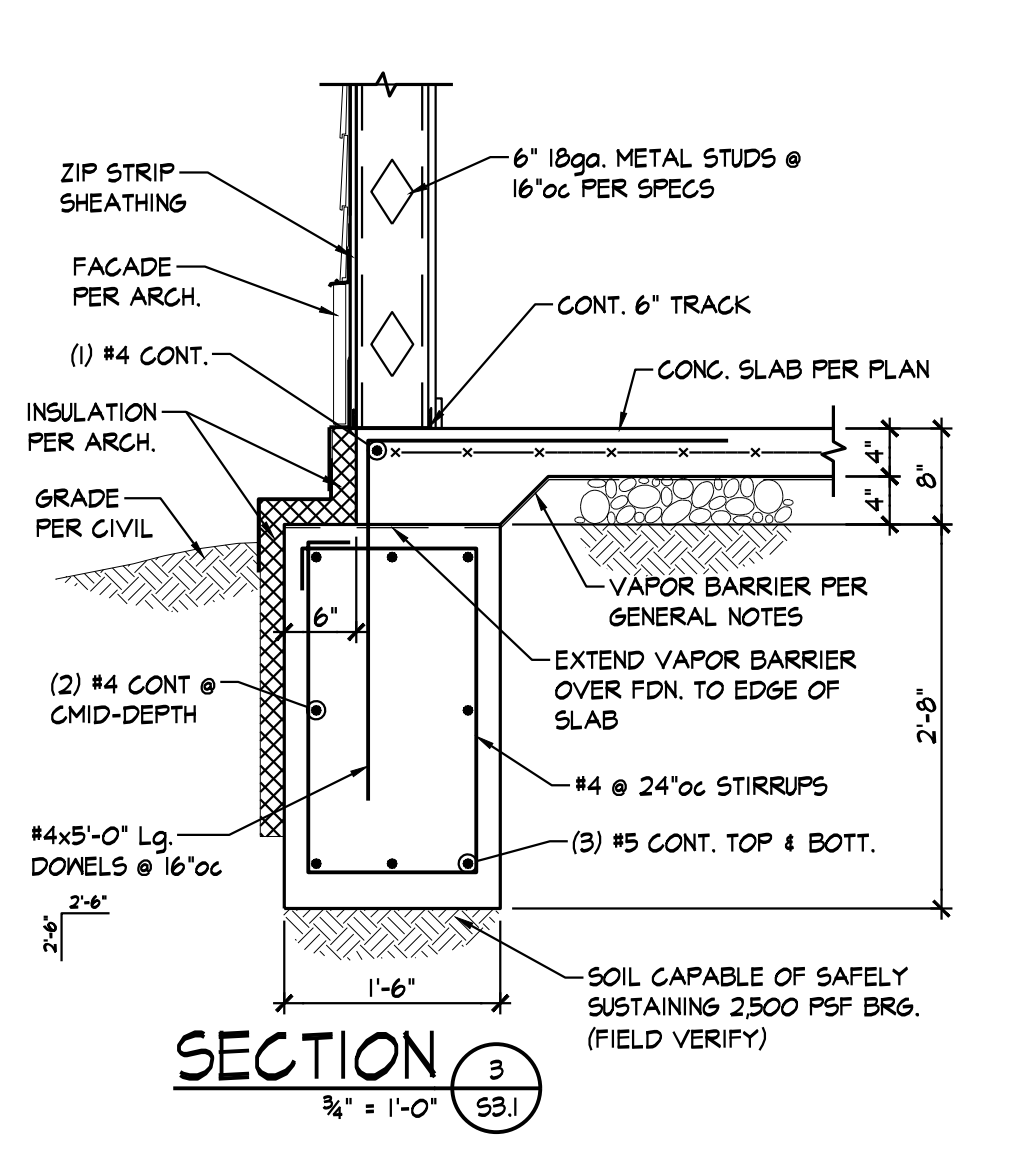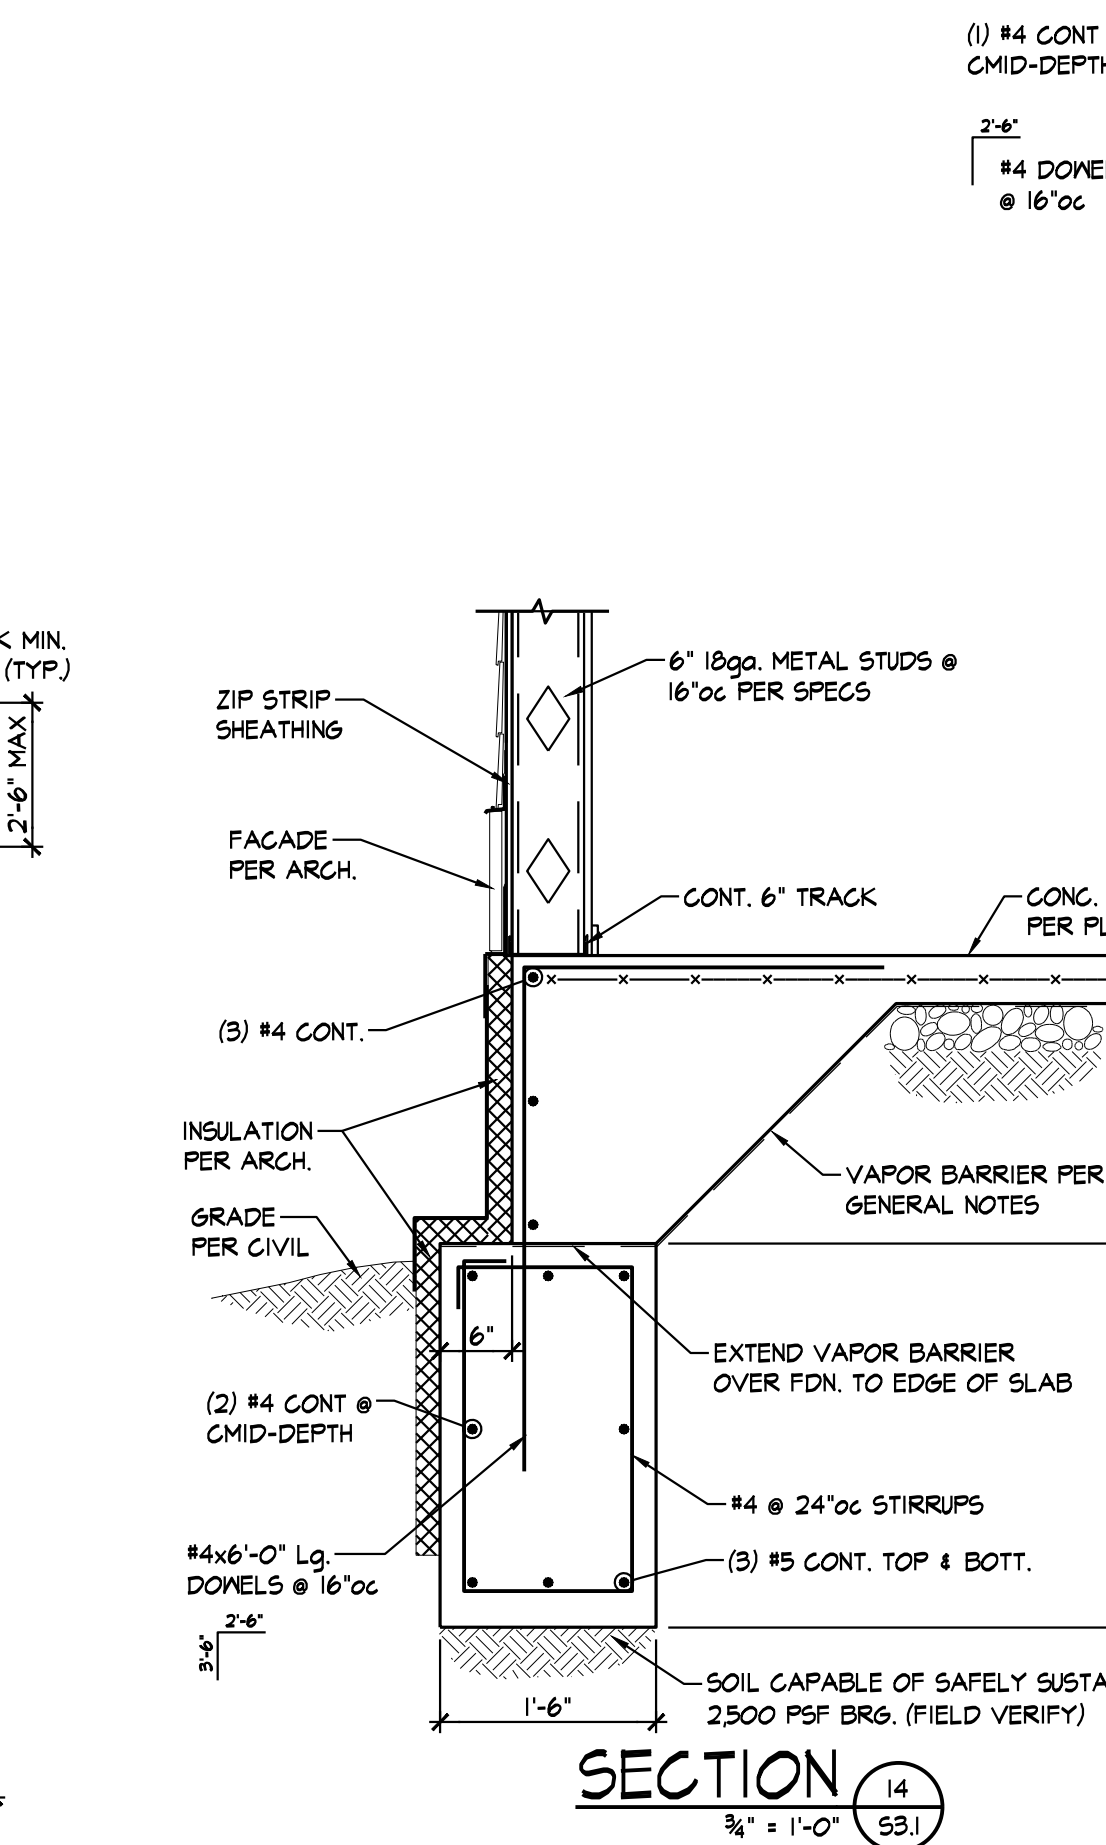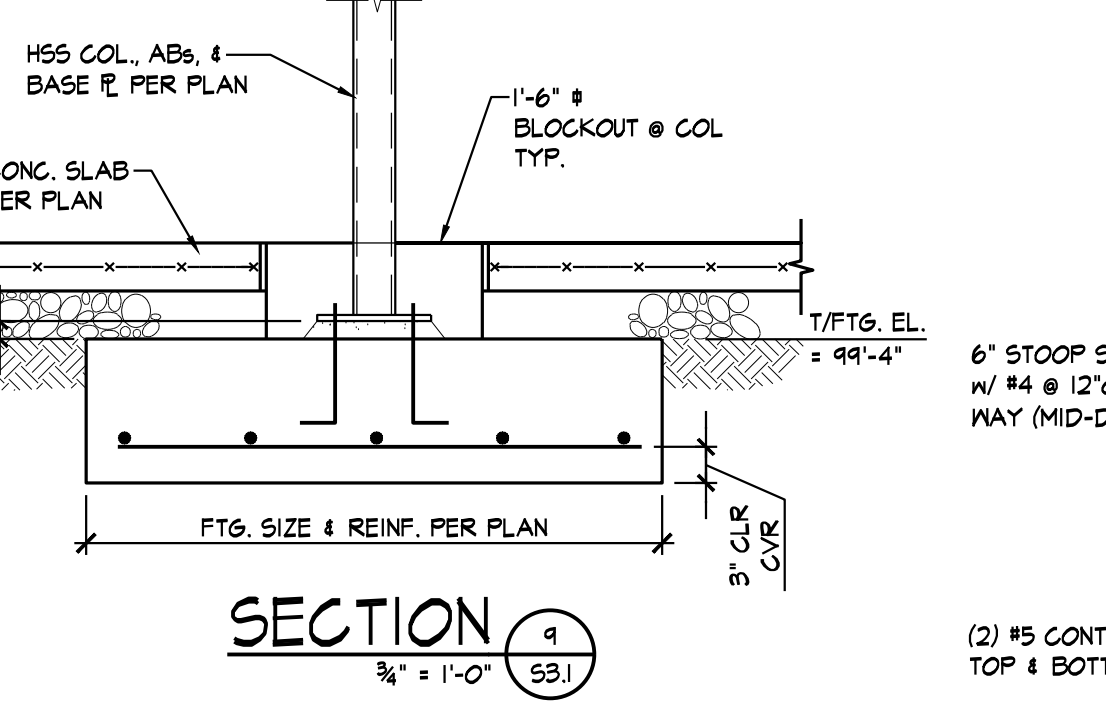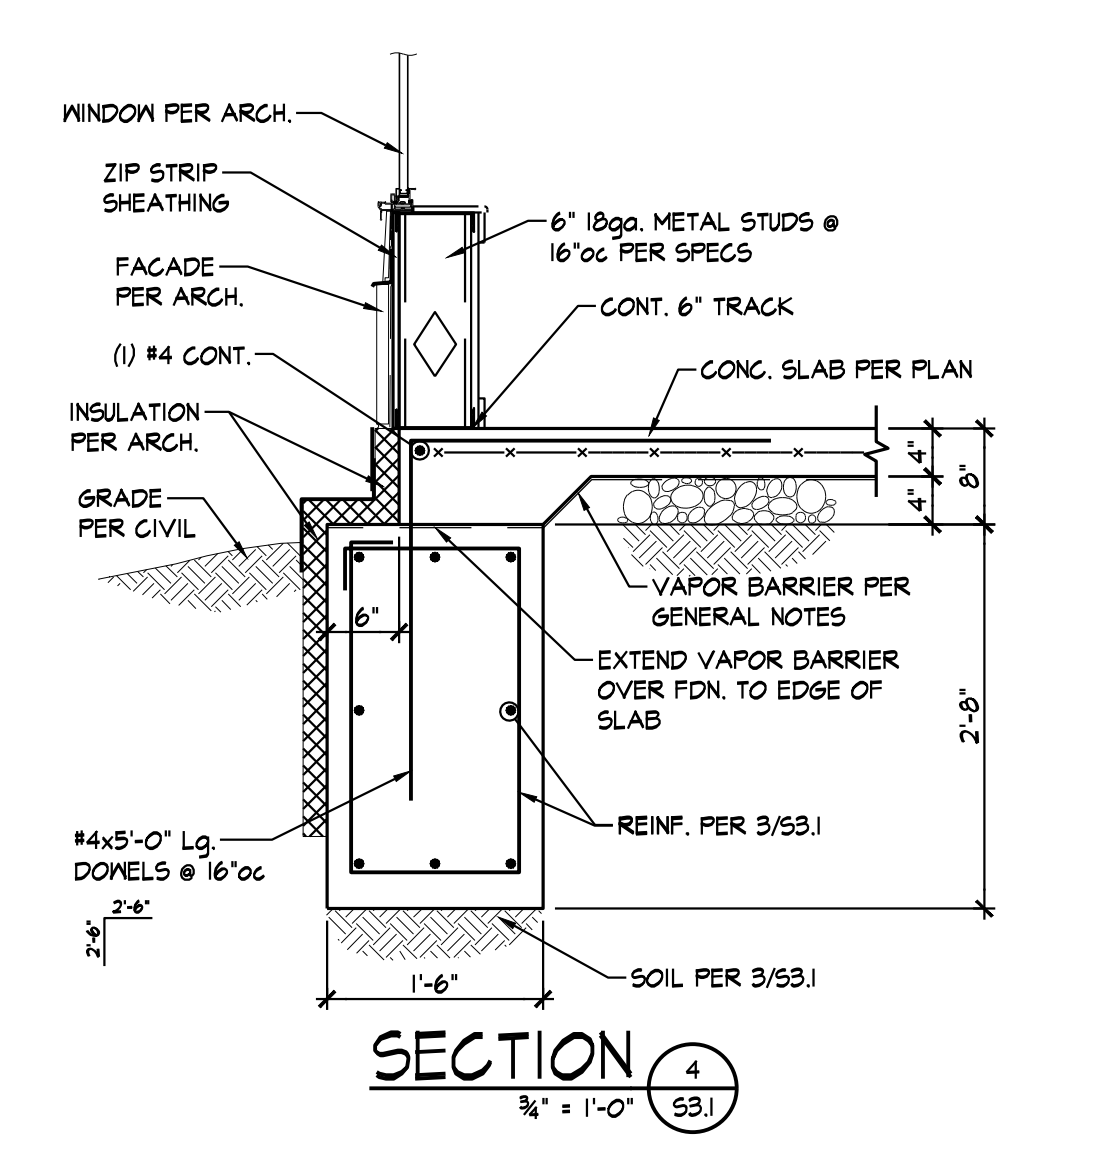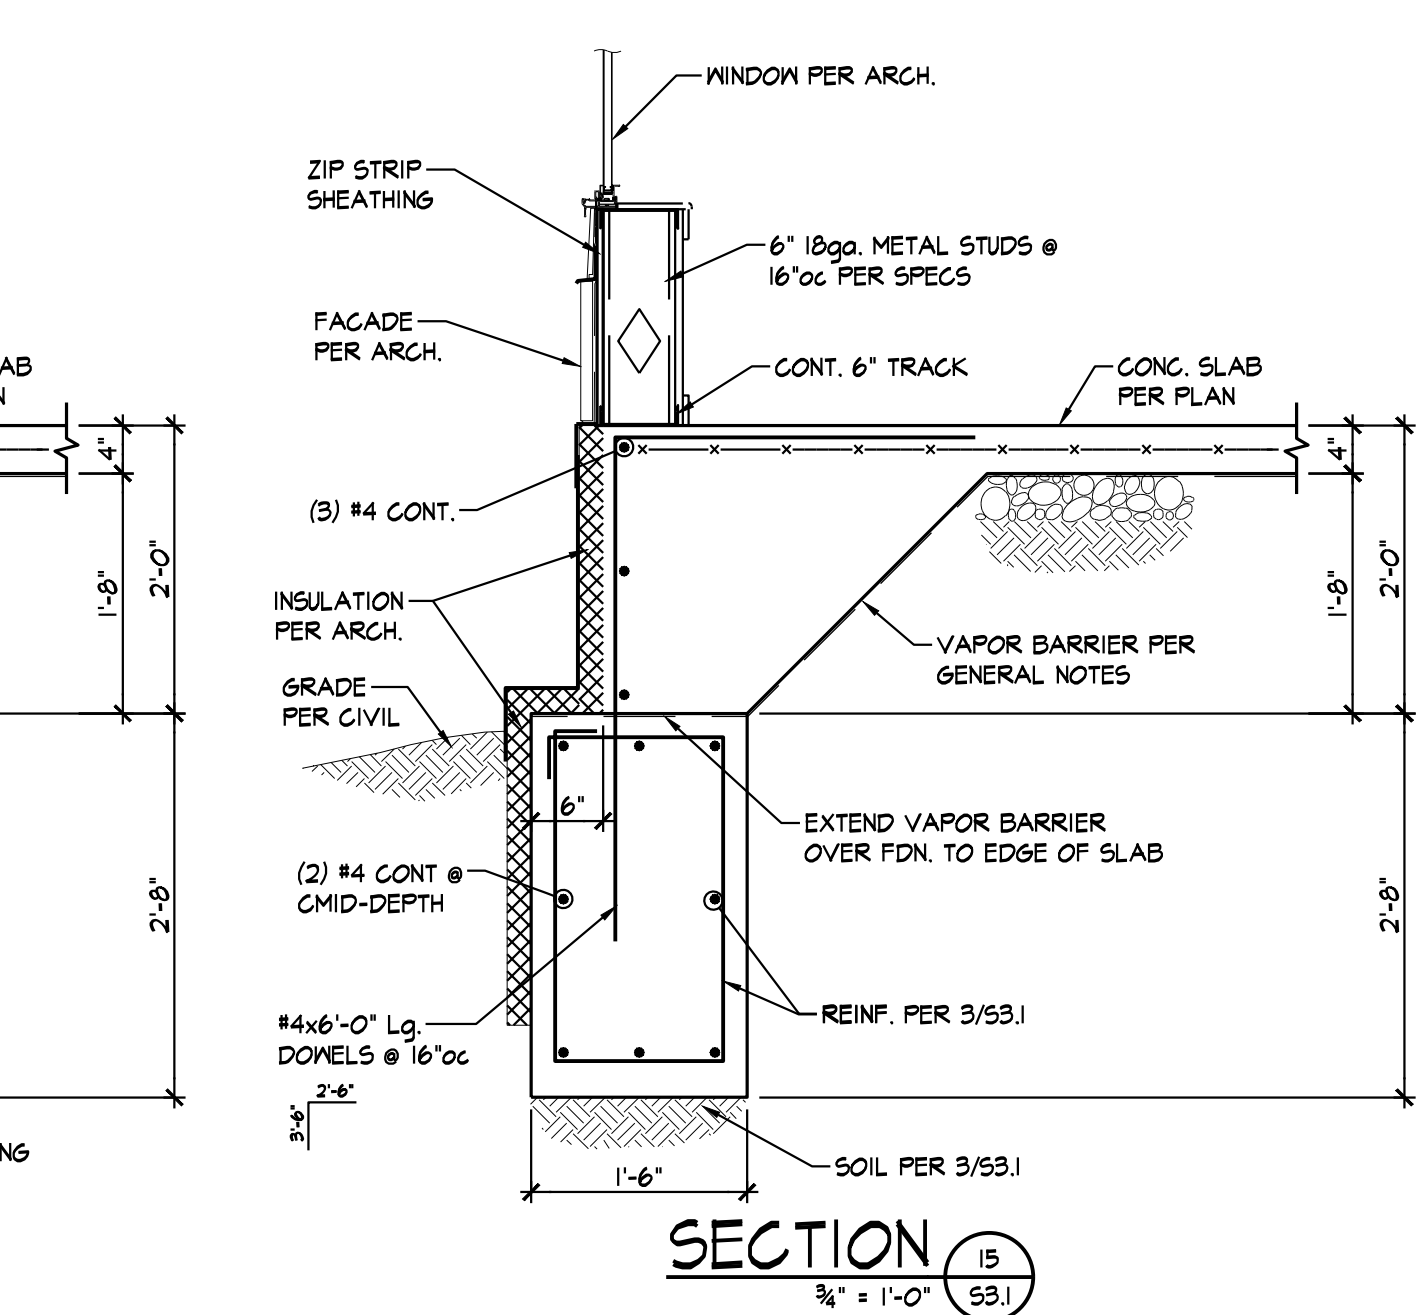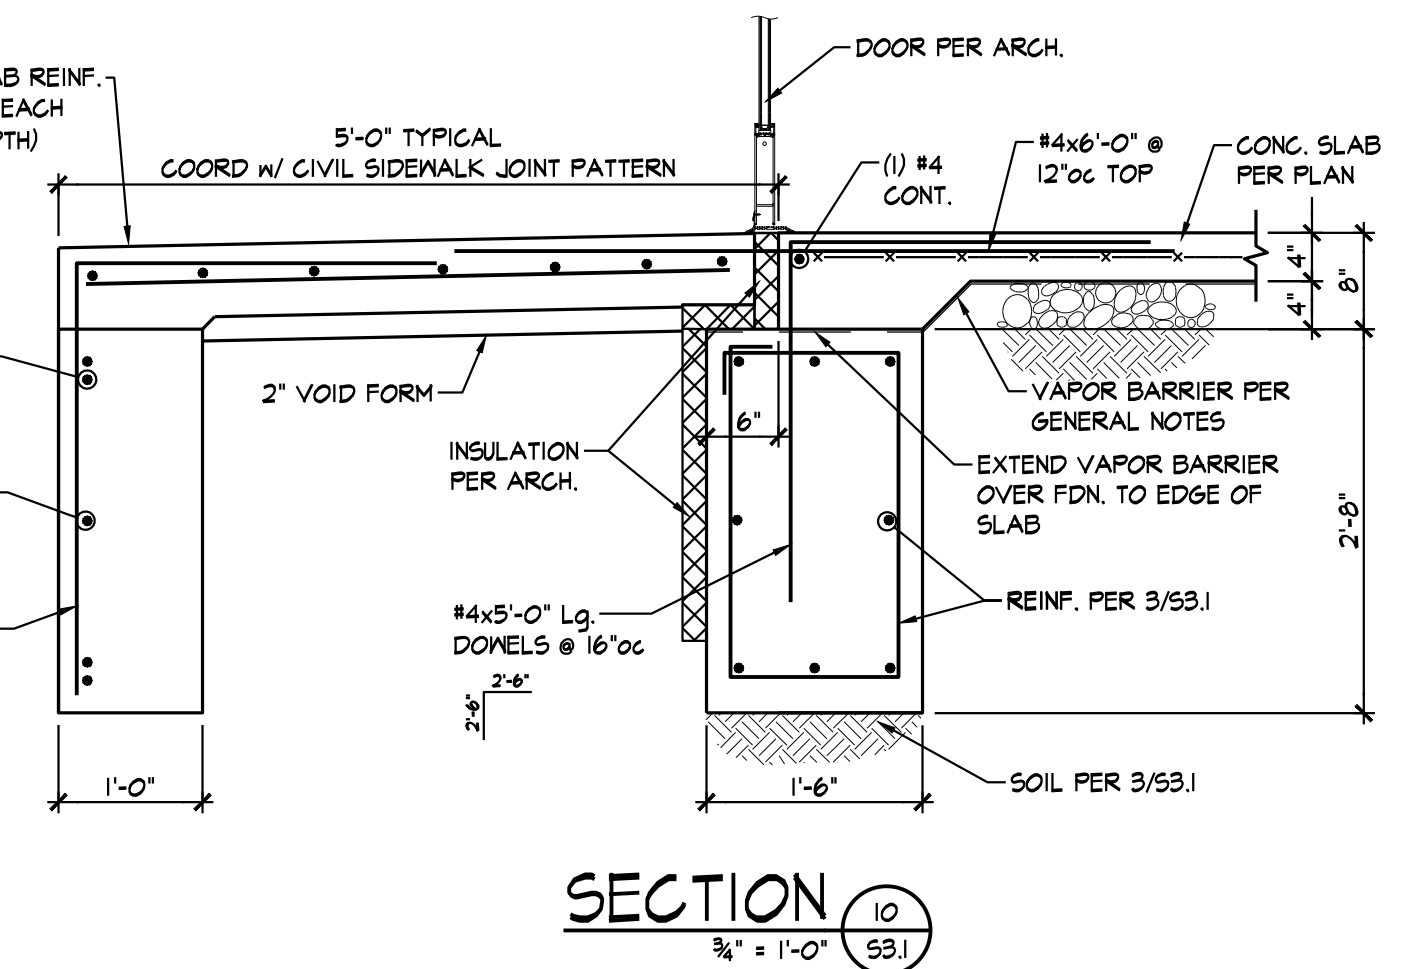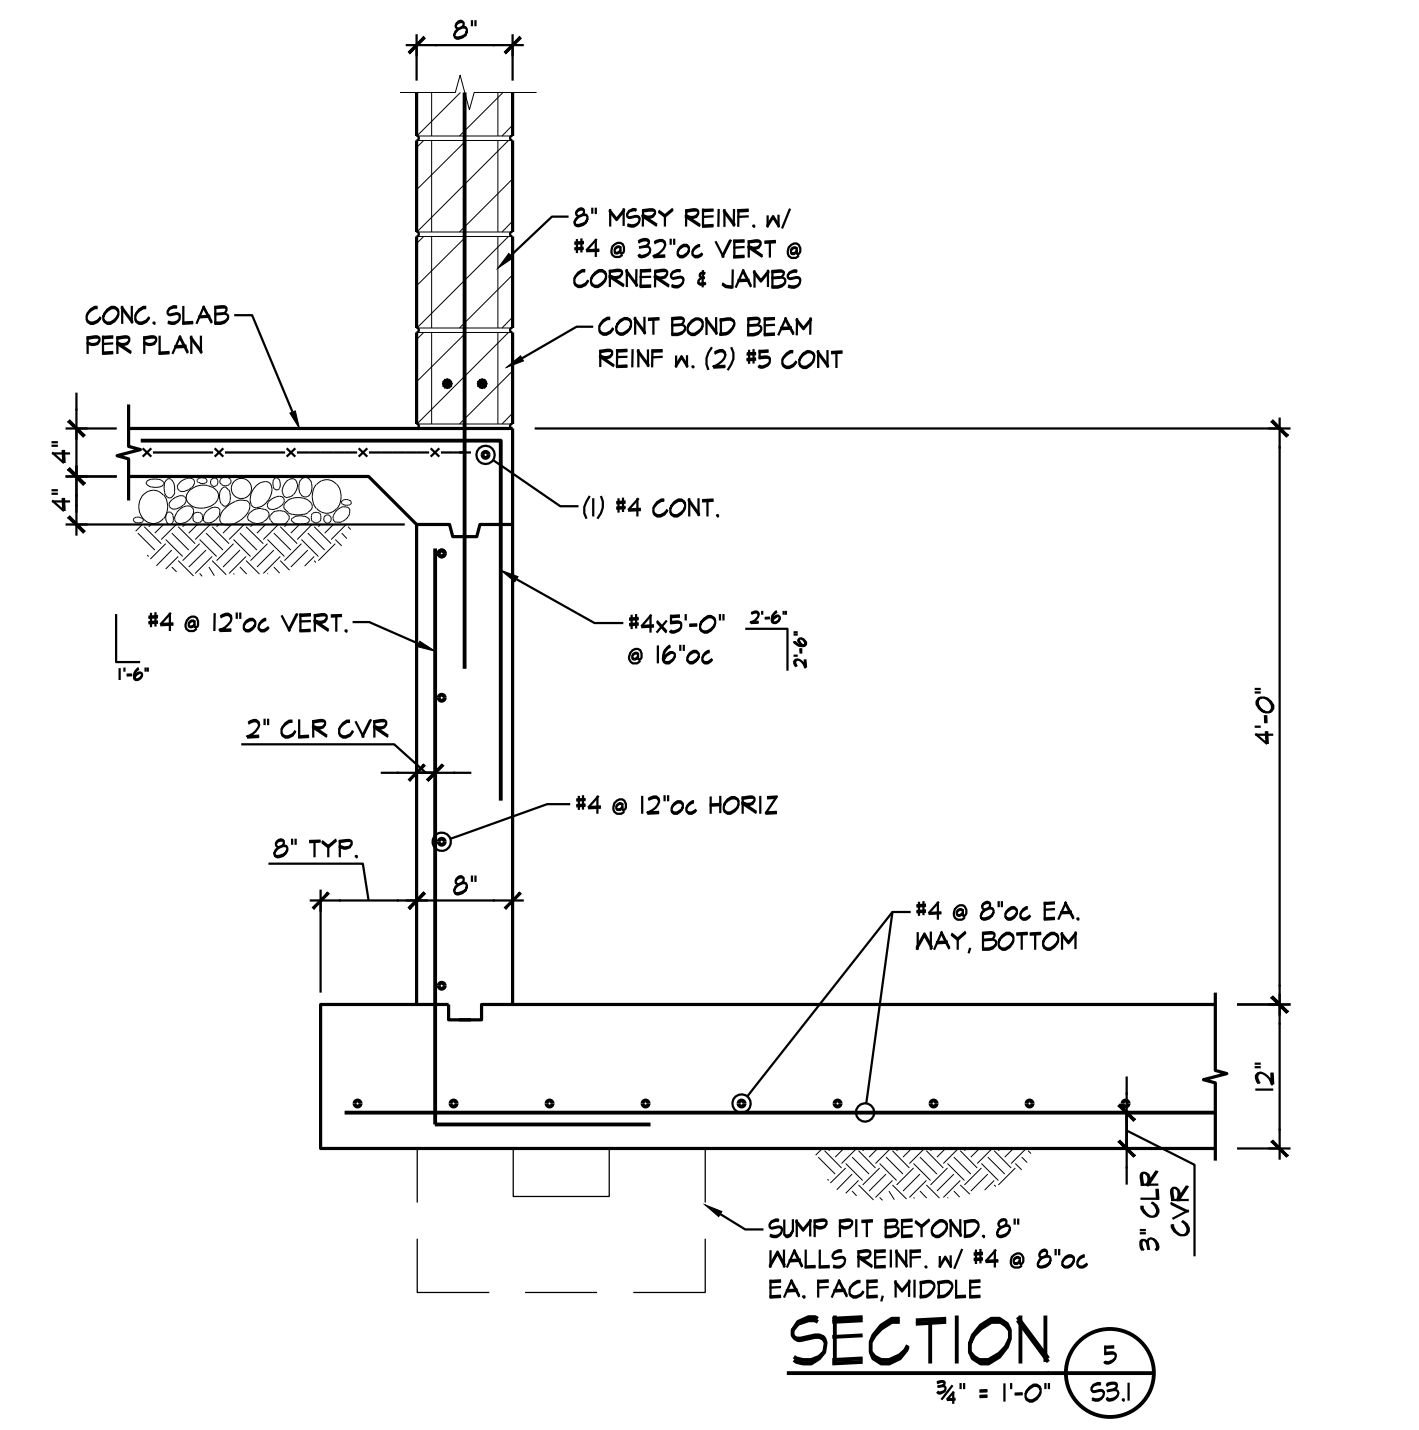


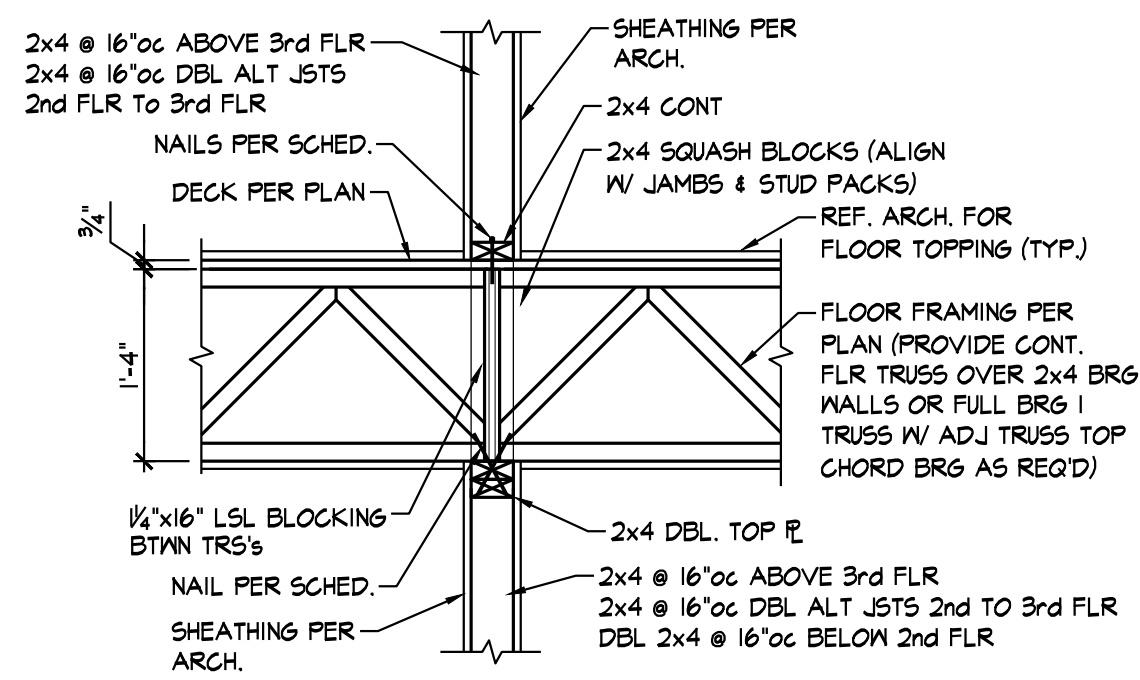


SECTION 1
3/4" = 1'-0" S3.2

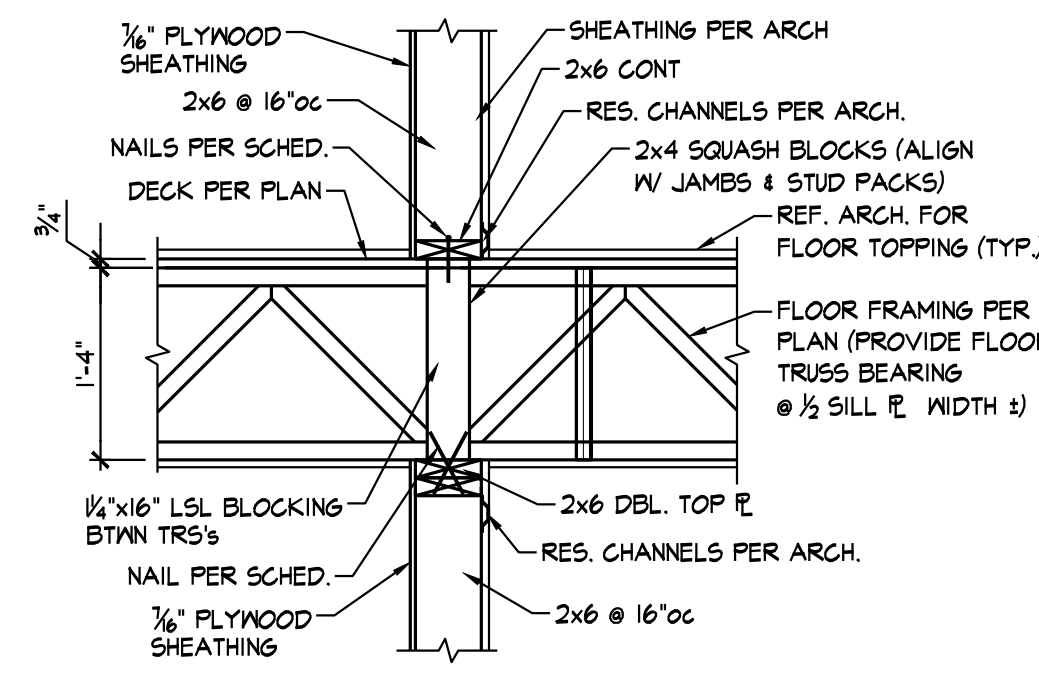


SECTION 2
3/4" = 1'-0" S3.2

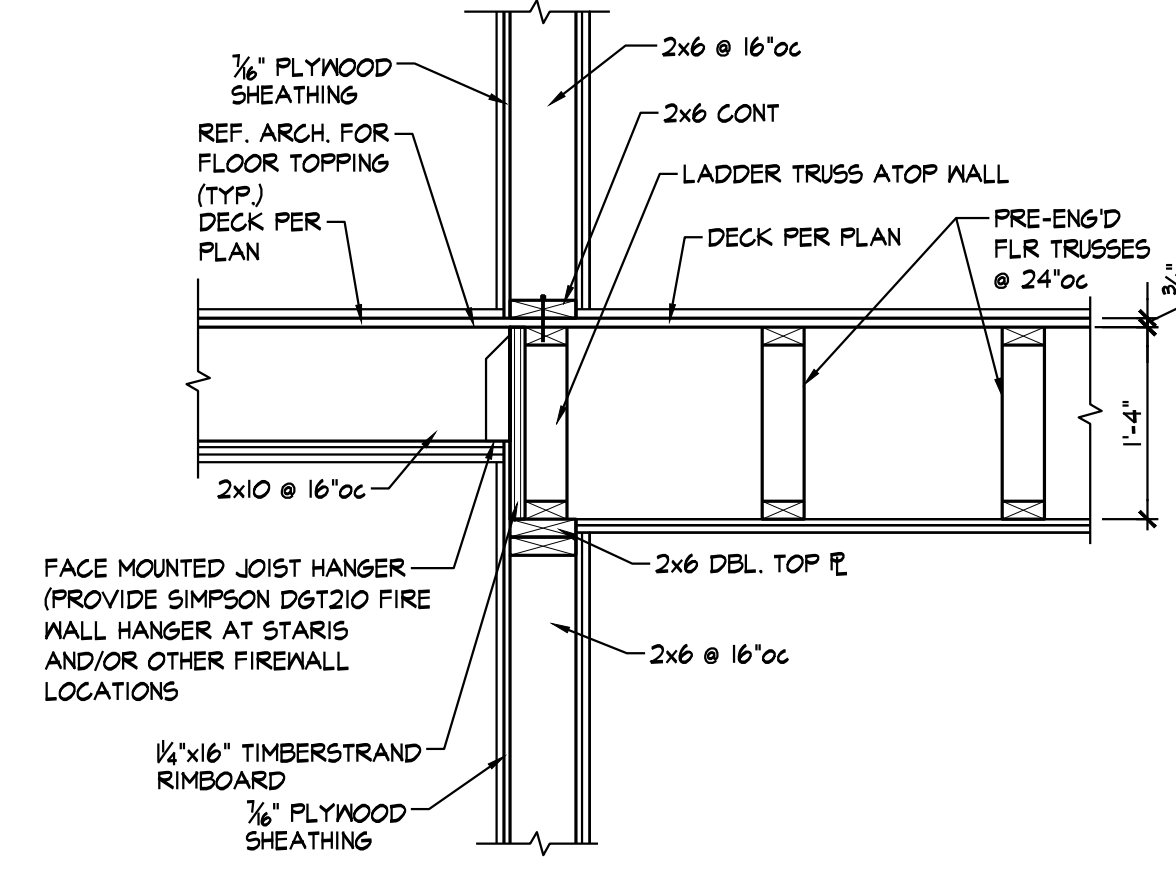


SECTION 3
3/4" = 1'-0" S3.2

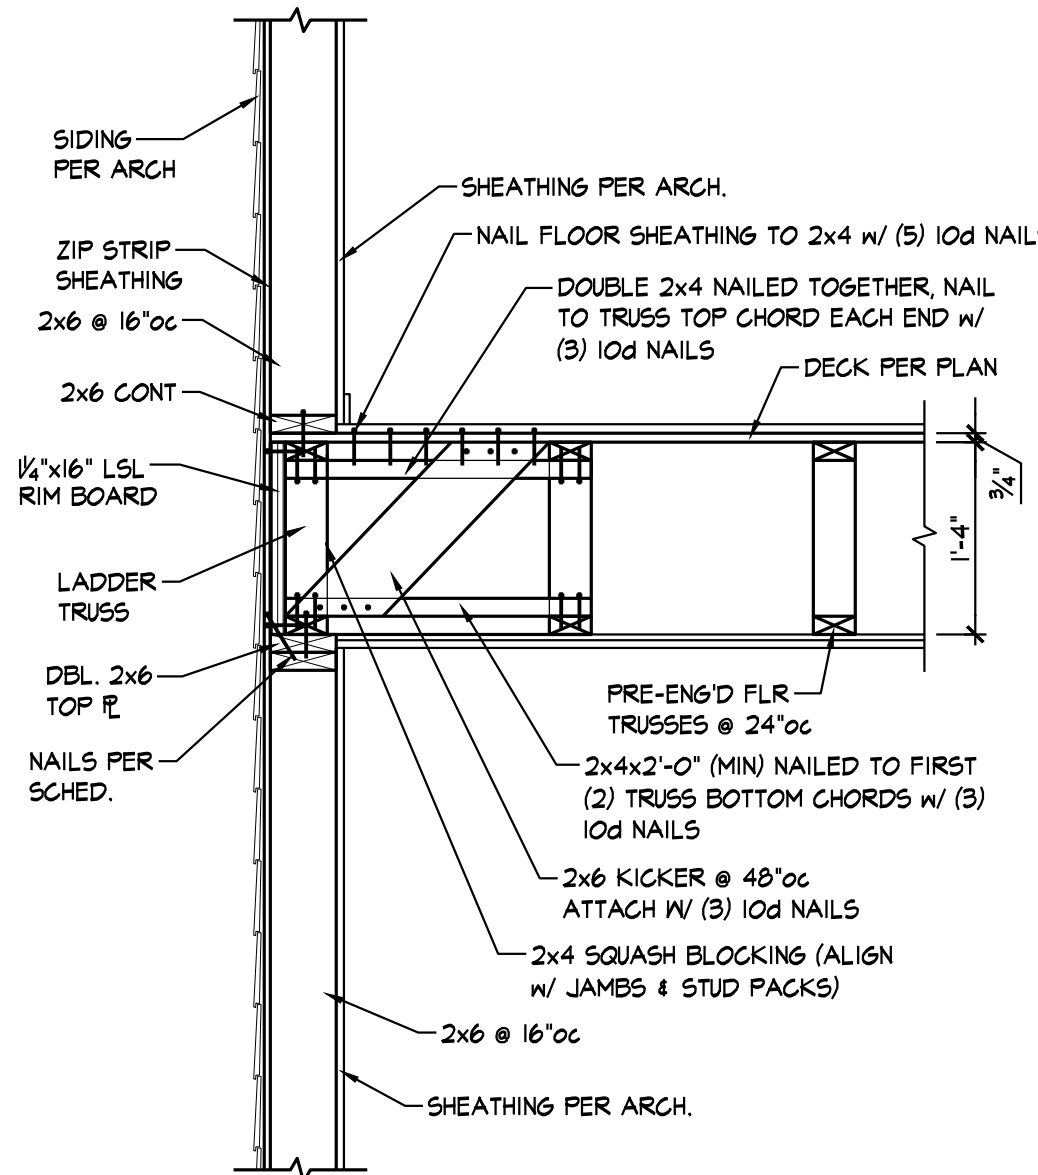


SECTION 4
3/4" = 1'-0" S3.2

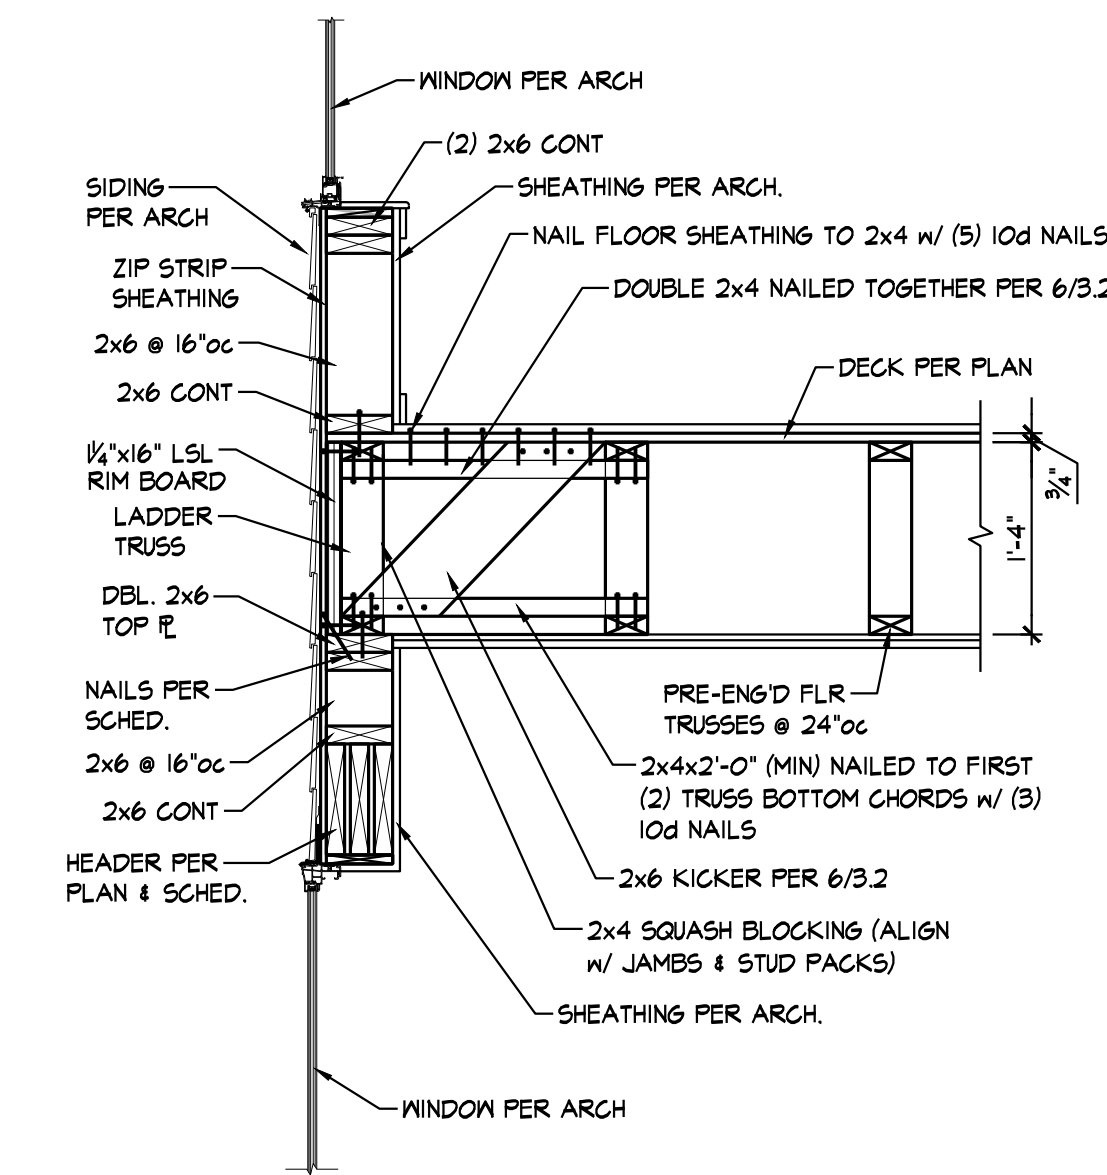


SECTION 4A
3/4" = 1'-0" S3.2

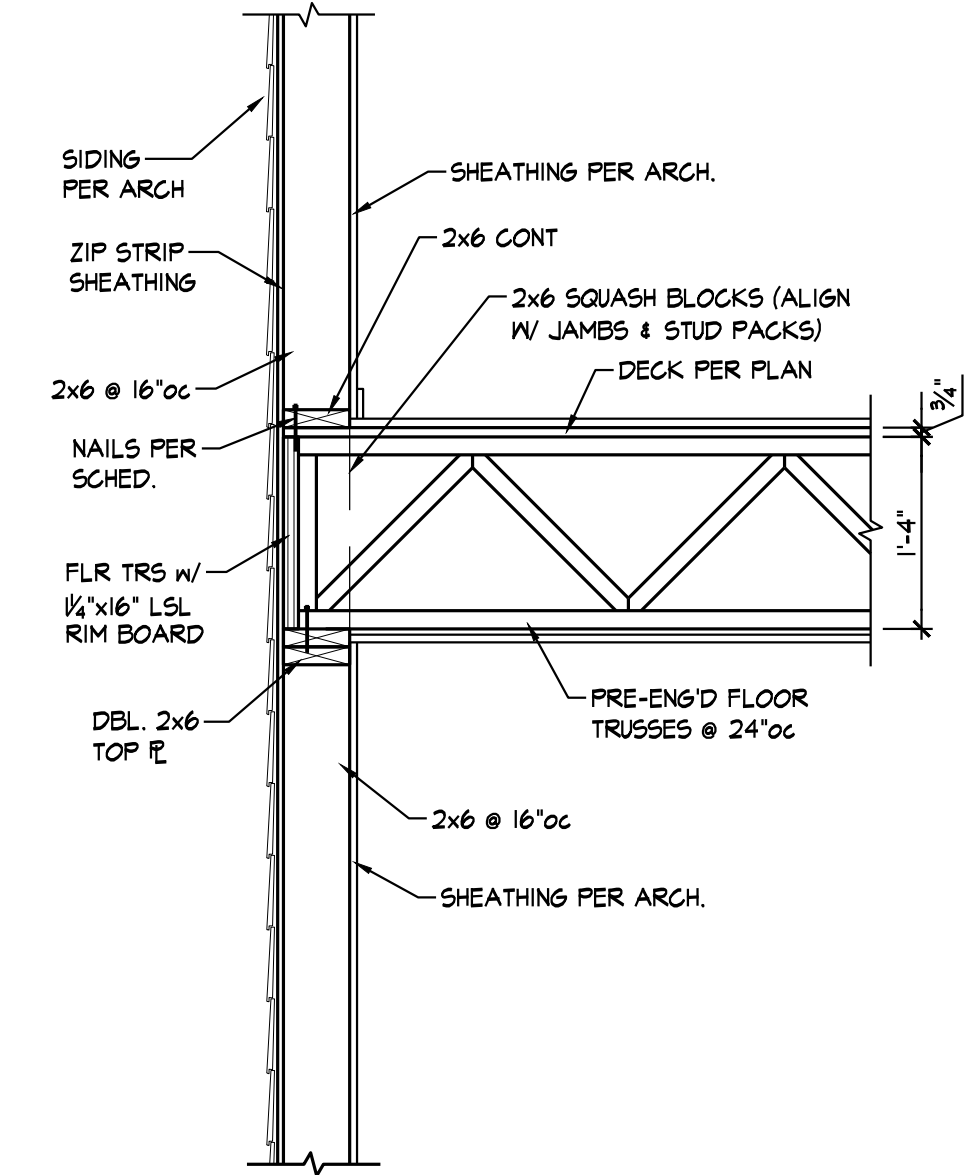


SECTION 5
3/4" = 1'-0" S3.2

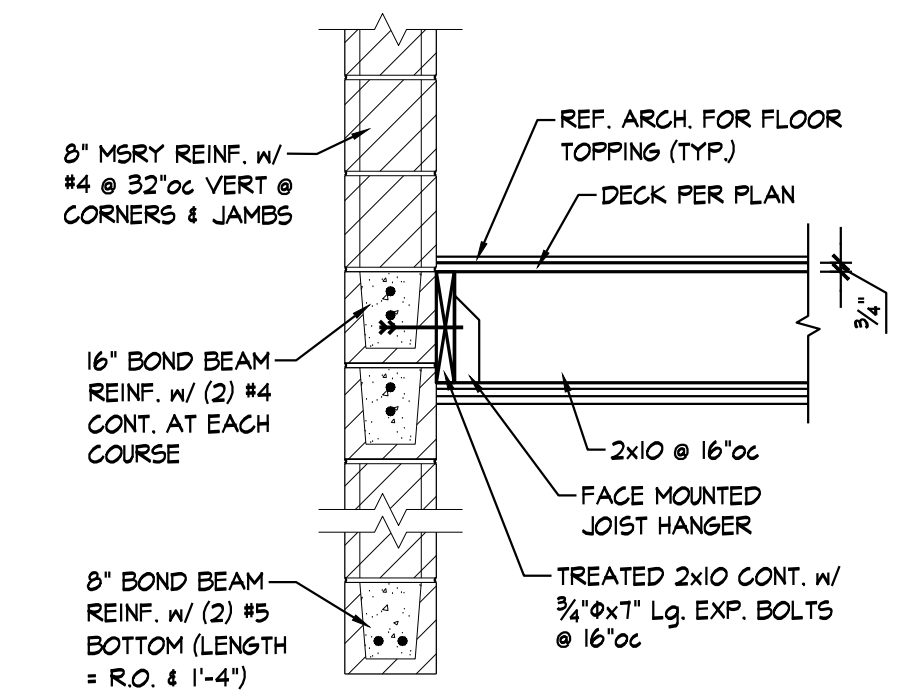


SECTION 6
3/4" = 1'-0" S3.2

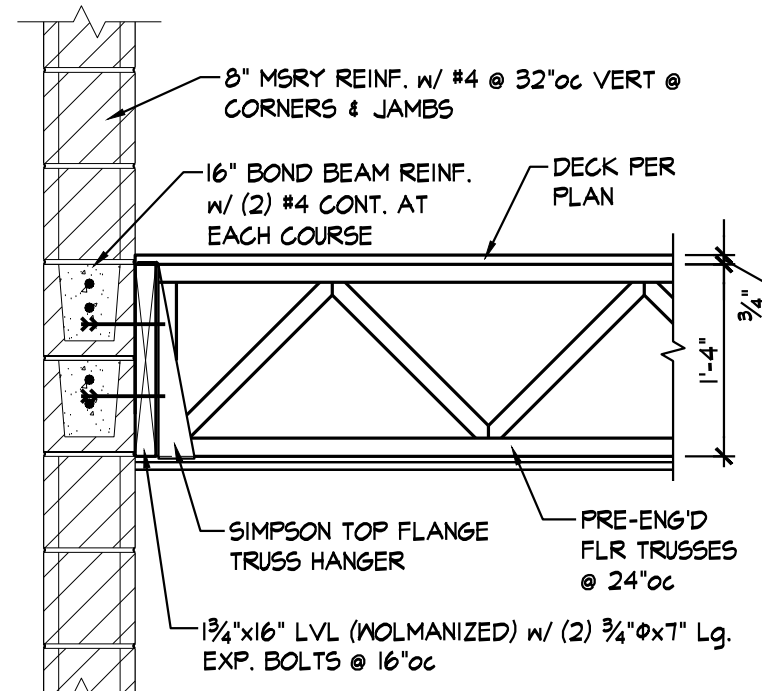

SECTION 7
3/4" = 1'-0" S3.2

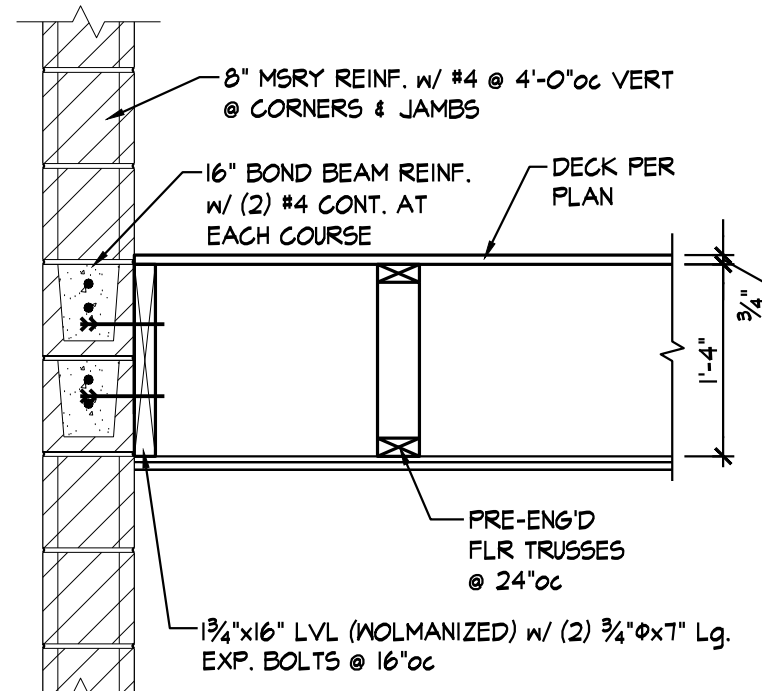

SECTION 8
3/4" = 1'-0" S3.2

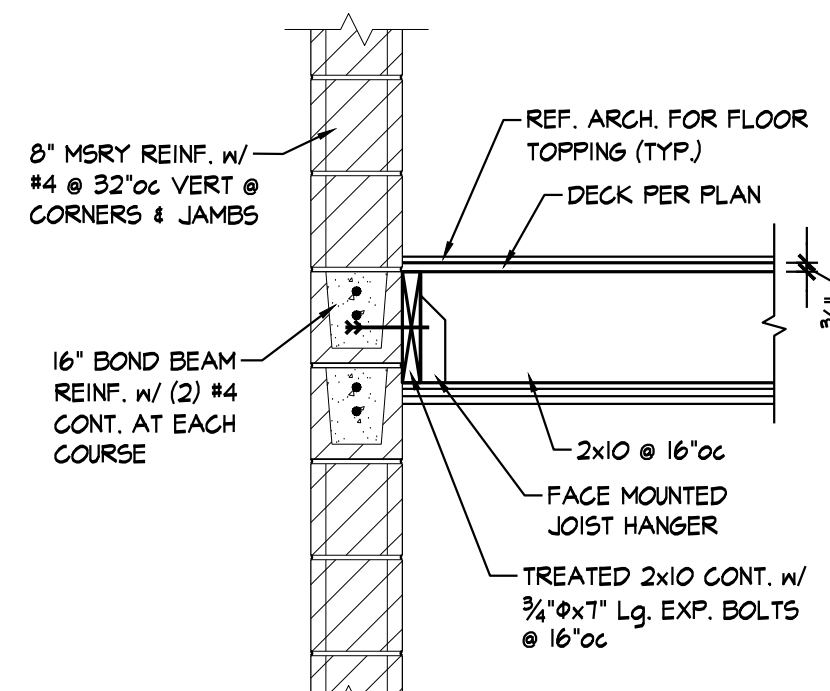

SECTION 9
3/4" = 1'-0" S3.2

TYPICAL STAIR LANDING

THE RESERVES AT MEADOWS 25
NEW APARTMENTS
GODDARD, KANSAS




REVISION:	
DATE:	4-17-2026
JOB:	25-3465
SHEET NO.:	

BOB D. CAMPBELL & CO.
Structural Engineers Since 1957
4398 Belleview Ave. 816.531.4144
Kansas City, MO 64111 www.bdc-engrs.com


S3.2

COPYRIGHTED ©

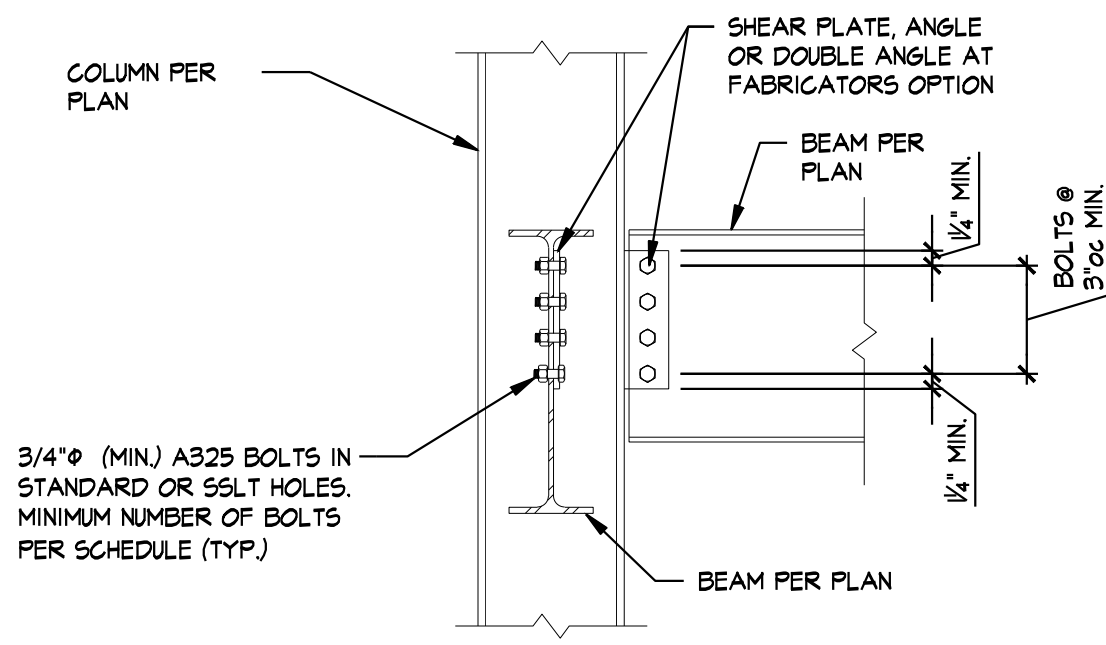


TYPICAL BEAM TO COLUMN SHEAR CONNECTION

DETAIL 1
3/4" = 1'-0" S3.3

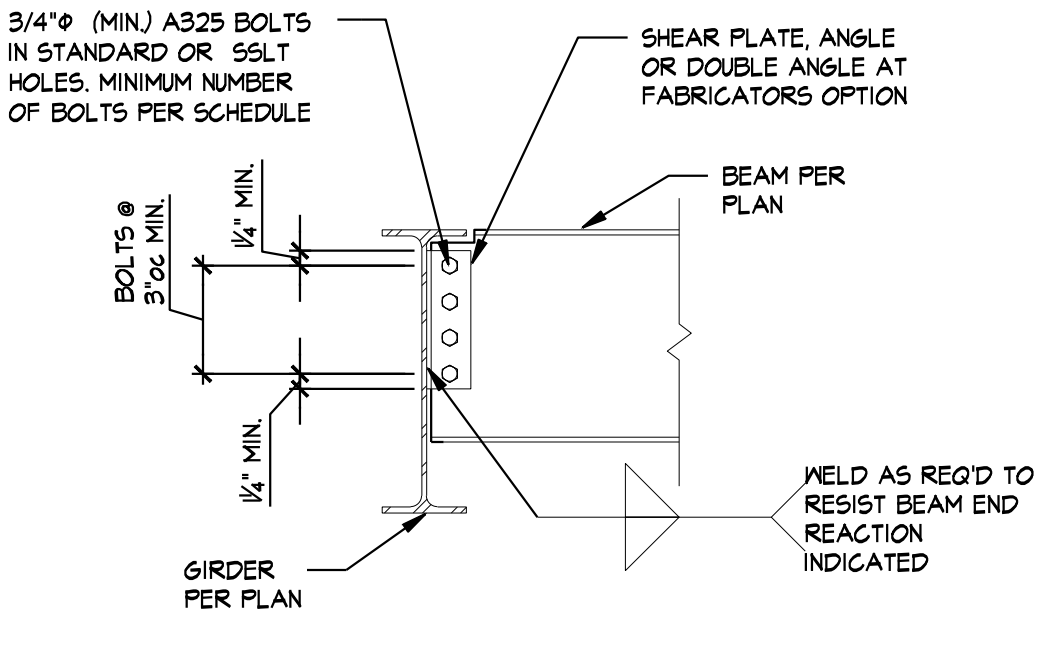


TYPICAL BEAM TO GIRDER CONNECTION

DETAIL 2
3/4" = 1'-0" S3.3

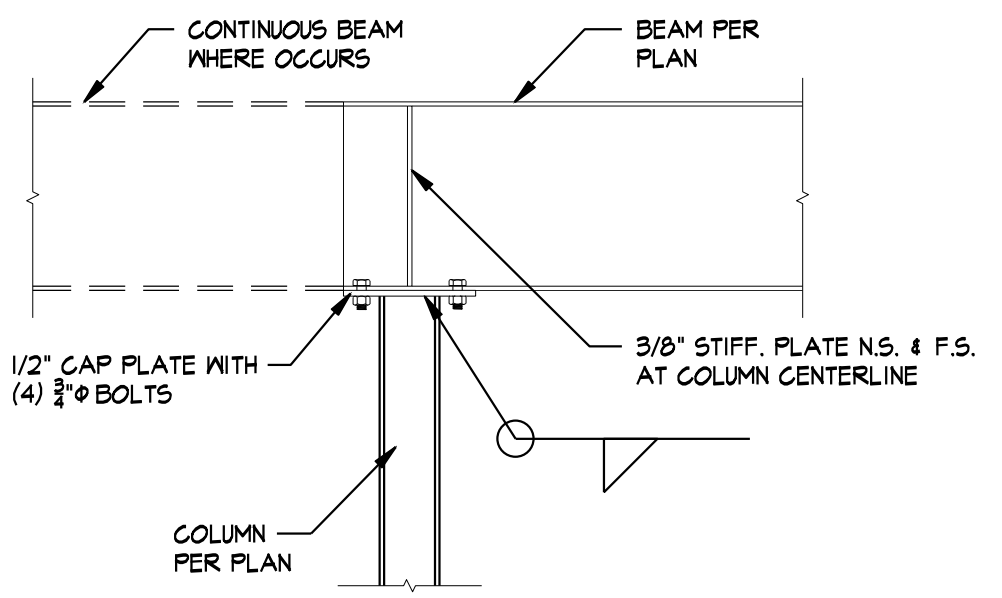



TYPICAL BEAM TO COLUMN CONNECTION

DETAIL 3
3/4" = 1'-0" S3.3

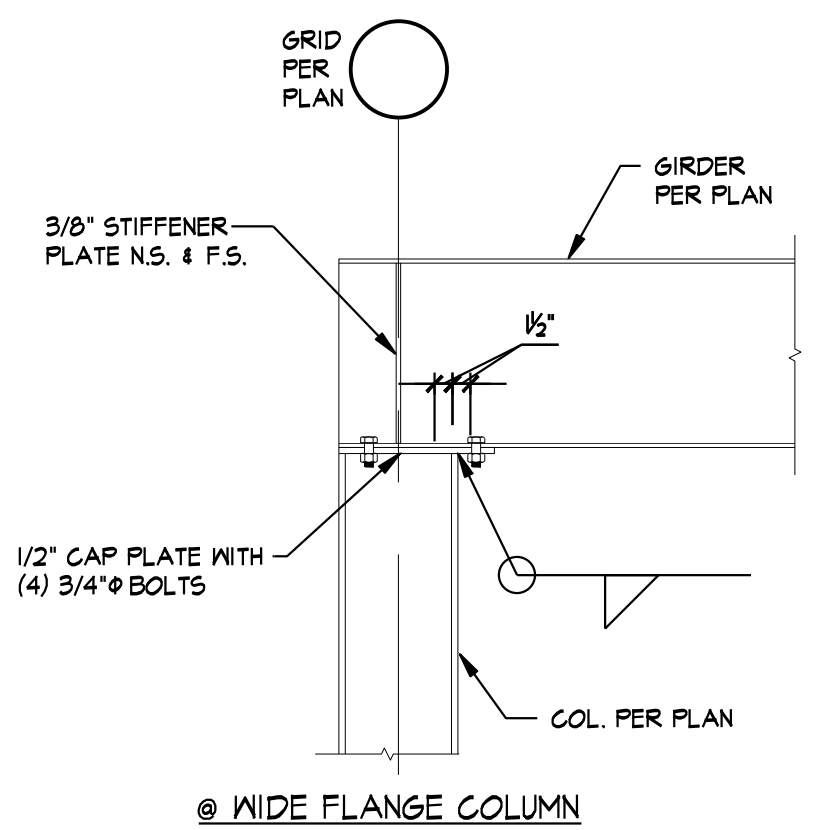


TYPICAL ROOF BEAM TO COLUMN CONNECTION AT EXTERIOR WALL

SECTION 4
3/4" = 1'-0" S3.3

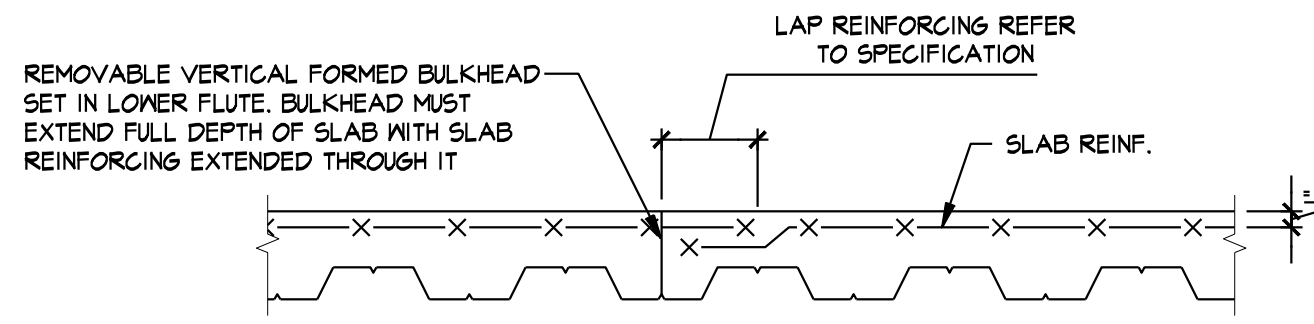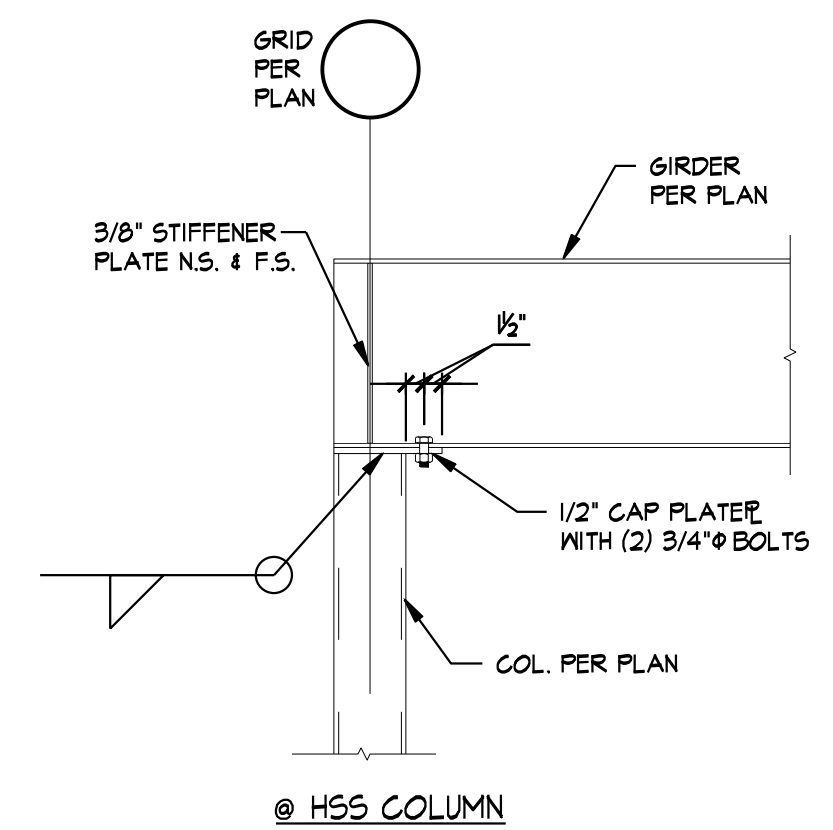

JOINT PARALLEL TO DECK FLUTES

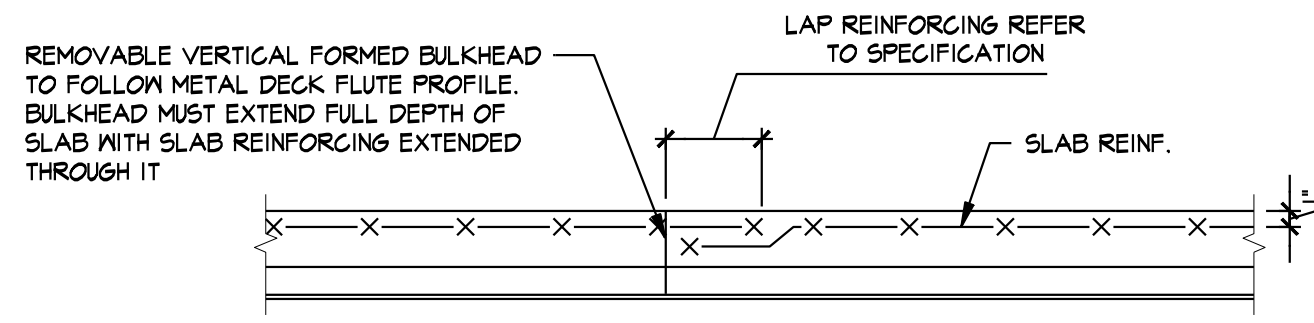


JOINT PERPENDICULAR TO DECK FLUTES

- NOTES:
- CONSTRUCTION JOINTS PARRALLEL TO DECK FLUTES SHALL BE LOCATED NO CLOSER THAN 5'-0" FROM CENTERLINE OF THE NEAREST GIRDER.
 - CONSTRUCTION JOINTS PERPENDICULAR TO DECK FLUTES SHALL BE LOCATED AT MID-SPAN OF THE METAL DECK SPAN.
 - AT CONTRACTOR'S OPTION, PREFORMED PERMENENT METAL SHEAR KEY FOLLOWING CONTOUR OF METAL DECK FLUTES MAY BE USED WITH SLAB REINFORCEMENT STOPPING EACH SIDE AND #3 DOWELS x 2'-0" CENTERED AT 18" o.c.


TYPICAL SLAB ON METAL DECK CONSTRUCTION JOINT

SECTION 5
1" = 1'-0" S3.3

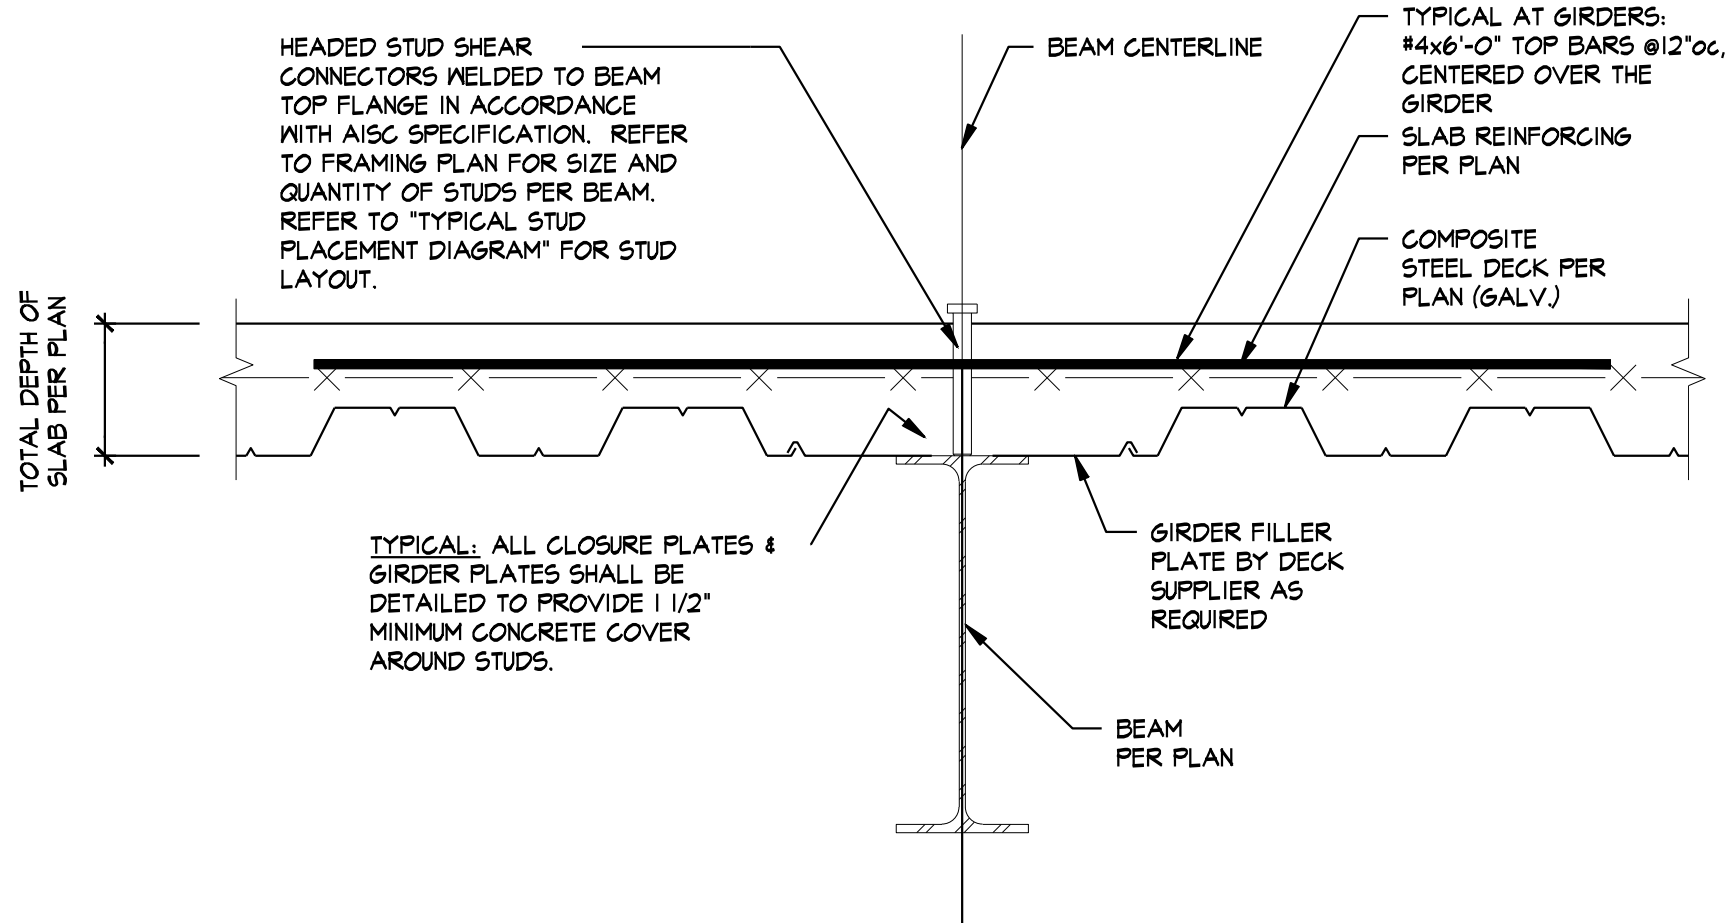


TYPICAL COMPOSITE BEAM/GIRDER DETAIL (DECK SPAN PARALLEL TO BEAM)

SECTION 7
1/2" = 1'-0" S3.3

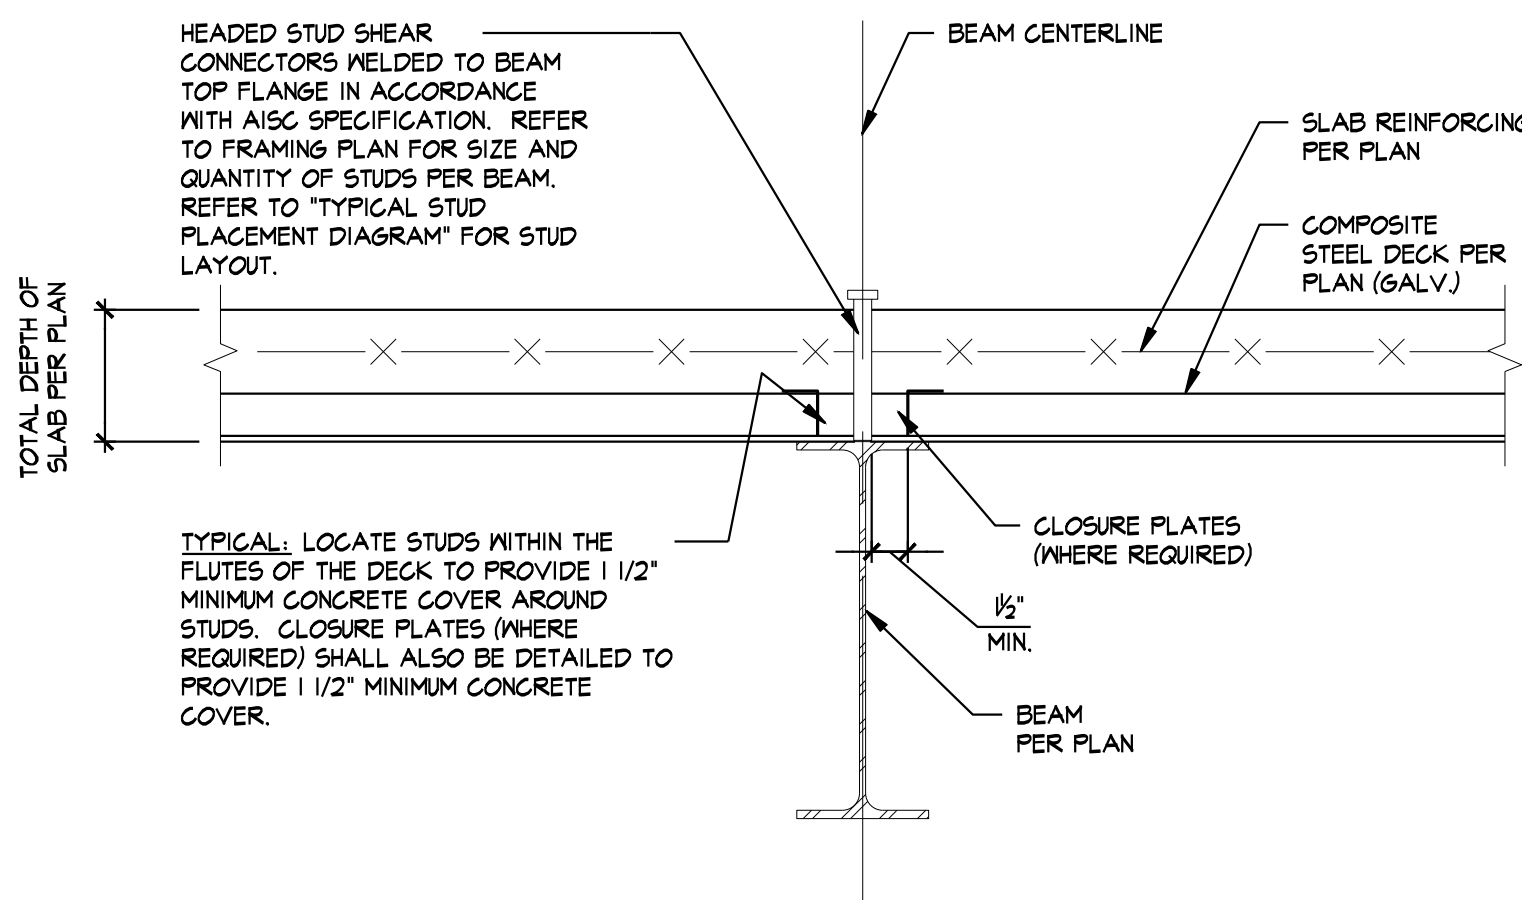

TYPICAL COMPOSITE BEAM DETAIL (DECK SPAN PERPENDICULAR TO BEAM)

SECTION 6
1/2" = 1'-0" S3.3

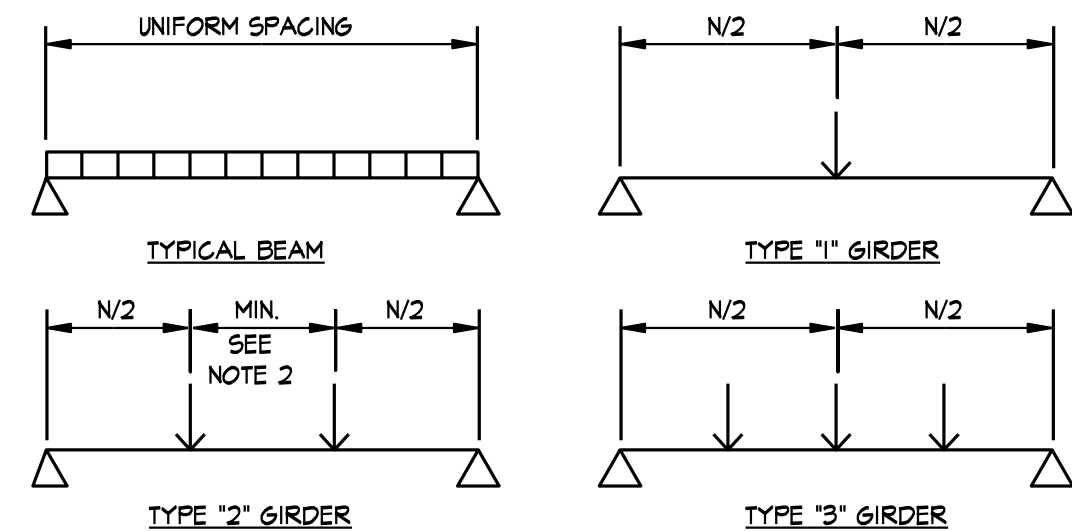

TYPICAL STUD PLACEMENT DIAGRAM

- ALL DIAGRAMS REPRESENT IDEALIZED CONDITIONS. ACTUAL FRAMING CONFIGURATIONS MAY REQUIRE ADDITIONAL INTERPRETATION.
- MAXIMUM SPACINGS OF STUDS SHALL BE 36" o.c. IF STUD SPACING EXCEEDS 12" o.c. PROVIDE 5/8" DIA. PUDDLE WELD ATTACHMENT SUCH THAT THE MAXIMUM AVERAGE SPACINGS OF STUD/WELD ATTACHMENT IS 12" o.c. AND MAXIMUM SPACING BETWEEN ATTACHMENTS IS 18".
- THE NUMBER OF STUDS PER BEAM SHOWN ON THE DRAWINGS IS BASED ON AN ASSUMED DESIGN VALUE OF 13.3 KIPS/STUD. THE ACTUAL NUMBER OF STUDS PER BEAM (N) MAY VARY BASED WIDTH, DECK DEPTH, NUMBER OF STUDS PER CELL, DECK RIB ORIENTATION, ETC. AS PER AISC SPECIFICATIONS FOR COMPOSITE CONSTRUCTION. METAL DECK CONTRACTOR SHALL SUBMIT ALL CALCULATIONS VERIFYING THE HORIZONTAL SHEAR CAPACITY OF SHEAR STUDS DETAILED ON SHOP DRAWINGS AND PROVIDE THE STUDS REQUIRED.
- SHEAR CONNECTOR PLACEMENT SHALL BE FULLY DETAILED ON THE METAL DECK SHOP DRAWINGS.

TYPICAL STUD PLACEMENT

3/4" = 1'-0" S3.3

BEAM SHEAR CONNECTION SCHEDULE

BEAM SIZE	MINIMUM ROWS OF BOLTS	END REACTION (kips)/U.N.O.
W8,C8	2	16
W10,C10	2	16
W12,C12	2	16
W14	3	24
W16,C15	3	24
W18	4	32
W21	5	40
W24	5	40
W27	6	48
W30	7	56
W33	8	64
W36	8	64

STEEL CONNECTION NOTES:

- REFER TO GENERAL NOTES ON SHEET S001.
- CONNECTIONS SHOWN IN THESE DETAILS ARE MINIMUM REQUIREMENTS.
- FABRICATOR SHALL BE RESPONSIBLE FOR THE ENGINEERING, DESIGNING, AND DETAILING OF EACH CONNECTION FOR LOADS SHOWN ON THE DRAWINGS IN ACCORDANCE WITH THE SPECIFICATIONS AND THE STRUCTURAL GENERAL NOTES.
- SUGGESTED CONNECTION DETAILS ARE SHOWN. FINAL CONNECTION CONFIGURATION AND DESIGN SHALL BE COMPLETED BY THE CONNECTION ENGINEER. CONNECTION DESIGN SHALL INCLUDE COLUMN OR BEAM CONTINUITY PLATES, WEB STIFFENERS, AND/OR DOUBLER PLATES AS REQUIRED FOR THE FORCES INDICATED.
- FABRICATOR MAY OPT TO USE OTHER AISC APPROVED CONNECTIONS IN LIEU OF THESE SHOWN HEREIN TO MEET END REACTION REQUIREMENTS (i.e. DOUBLE ANGLE CONNECTION).
- CONNECTION DETAILING SHALL COMPLY WITH THE STANDARD DETAILS SHOWN IN THE LATEST EDITION OF THE AISC MANUAL OF STEEL CONSTRUCTION.
- ALL BOLTS SHALL BE 3/4" ASTM A325 MINIMUM.
- ALL BOLTS SHALL BE SPACED AT 3" o.c. MINIMUM.
- ALL BOLTS SHALL HAVE HEAVY HEX NUTS.
- ALL BOLTS SHALL BE FULLY PRE-TENSIONED.
- BOLT SPACING AND EDGE DISTANCES SHALL BE ADJUSTED PER AISC MANUAL FOR BOLTS LARGER THAN 3/4" DIAMETER.
- CLIP ANGLES MAY BE SHOP WELDED TO BEAM WEB PER AISC.
- FOR BEAMS WITH AXIAL LOADS PER DRAWINGS, BOLTS AND CONNECTIONS SHALL BE SLIP-CRITICAL PER AISC GUIDELINES. INCREASE NUMBER OF BOLTS AND/OR PROVIDE EXTENDED SHEAR PLATE CONNECTION W/ AN ADDITIONAL COLUMN OF BOLTS TO ACCOMODATE COMBINED FORCES.
- PROVIDE ASTM A490 BOLTS IF REQUIRED TO MEET END REACTION LOAD REQUIREMENTS.
- REFER TO ELEVATIONS ON SHEET S... FOR BRACE FORCES. REFER TO PLANS FOR ADDITIONAL BEAM AXIAL FORCES, BRACE AND BEAM FORCES INDICATED ARE UNFACTORED (ASD) LOADS AND SHALL BE CONSIDERED CONCURRENT W/ BEAM SHEAR DESIGN FORCES LISTED IN THE BEAM SHEAR CONNECTION SCHEDULE.
- COORDINATE BRACED FRAME CONNECTION W/ ARCHITECTURAL WALLS AS REQUIRED TO AVOID CONFLICT OR EXPOSURE OUTSIDE OF WALL OR FINISH.
- ALL END REACTIONS INDICATED ARE UNFACTORED (ASD) LOADS.



REVISION:

DATE: 4-17-2026

JOB: 25-3465

SHEET NO.:










BOB D. CAMPBELL & CO.
Structural Engineers Since 1957
4338 Belleview Ave. 818.531.4144
Kansas City, MO 64111 www.bdc-engrs.com

S3.3


JCR
JonesGillamRenz
730 N. Ninth 1881 Main Street, Suite 301
Solina, KS 67401 Kansas City, MO 64108
785.827.0386 jgr@jgarchitects.com

THE RESERVES AT MEADOWS 25
NEW APARTMENTS
KANSAS
GODDARD,


COPYRIGHTED ©

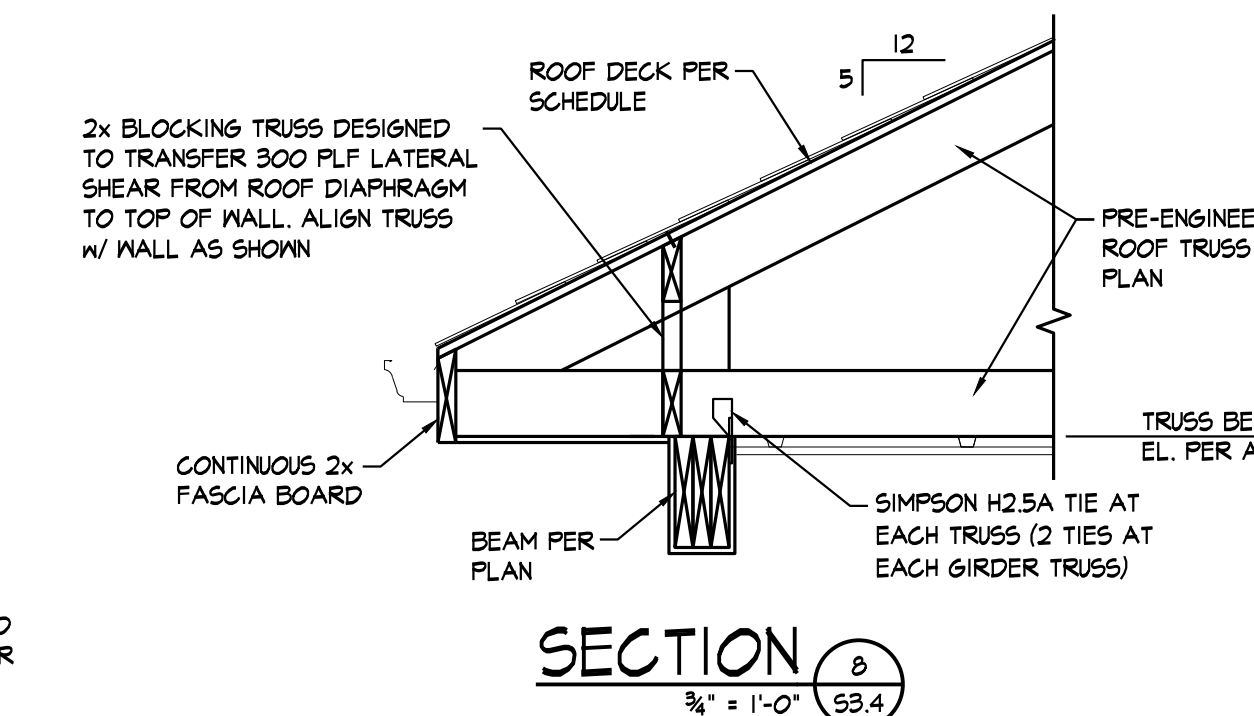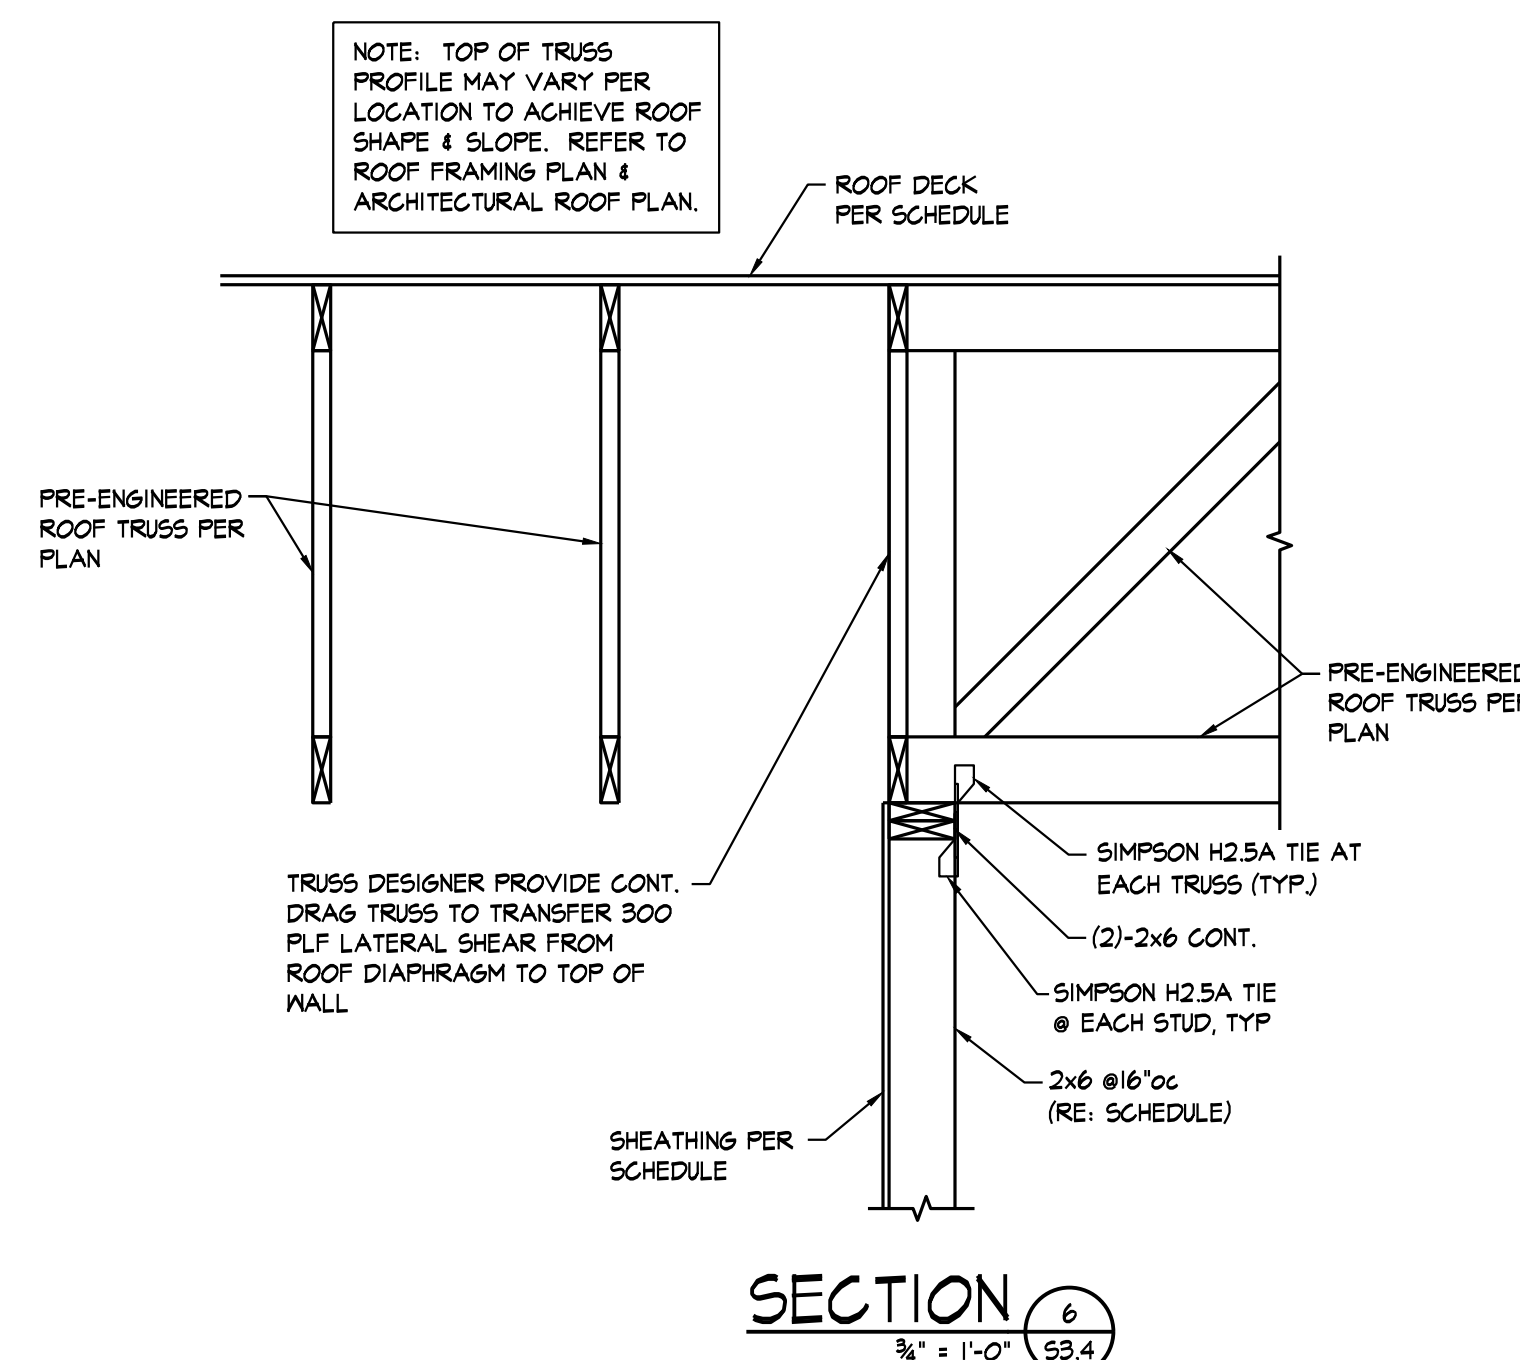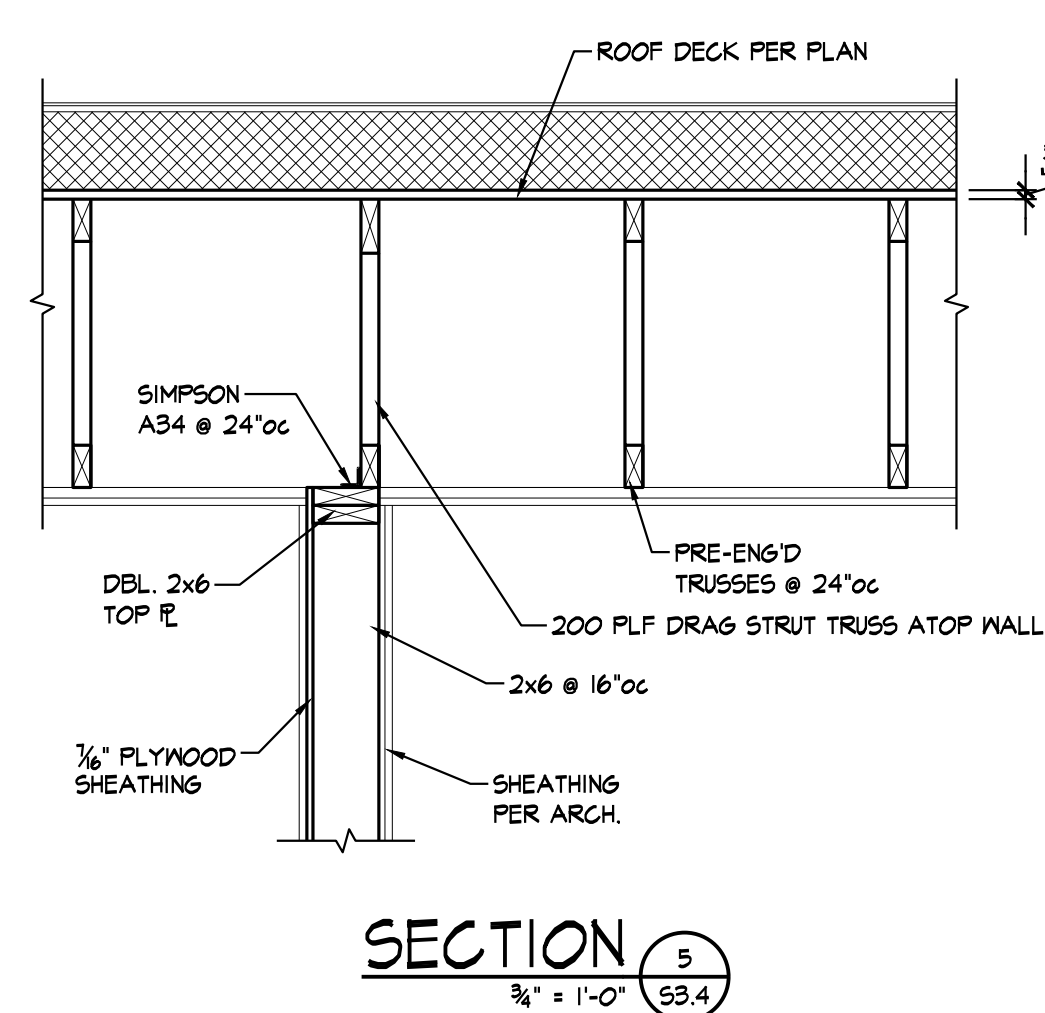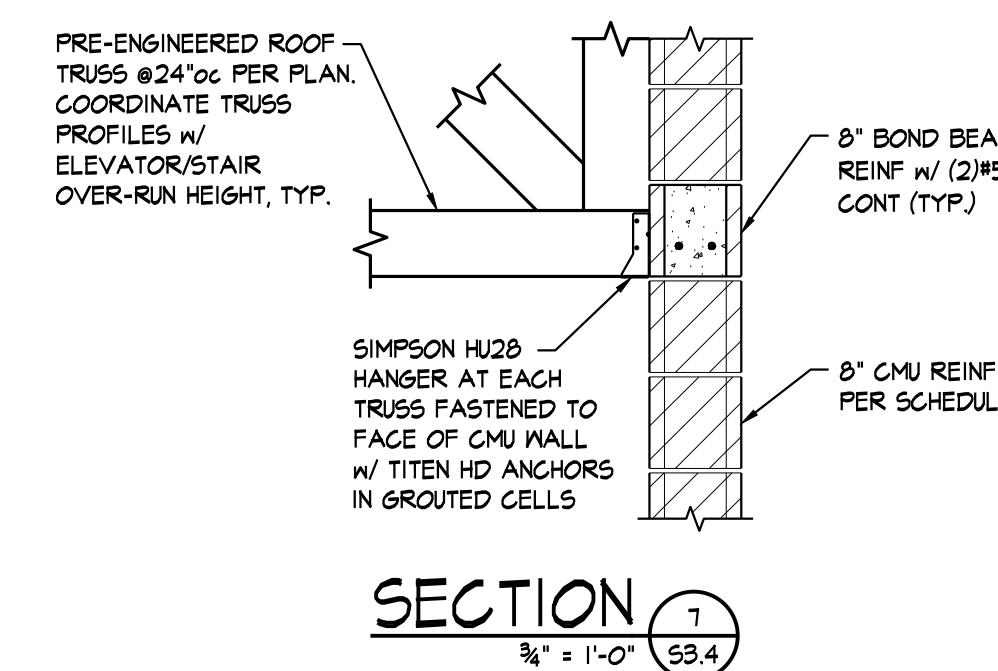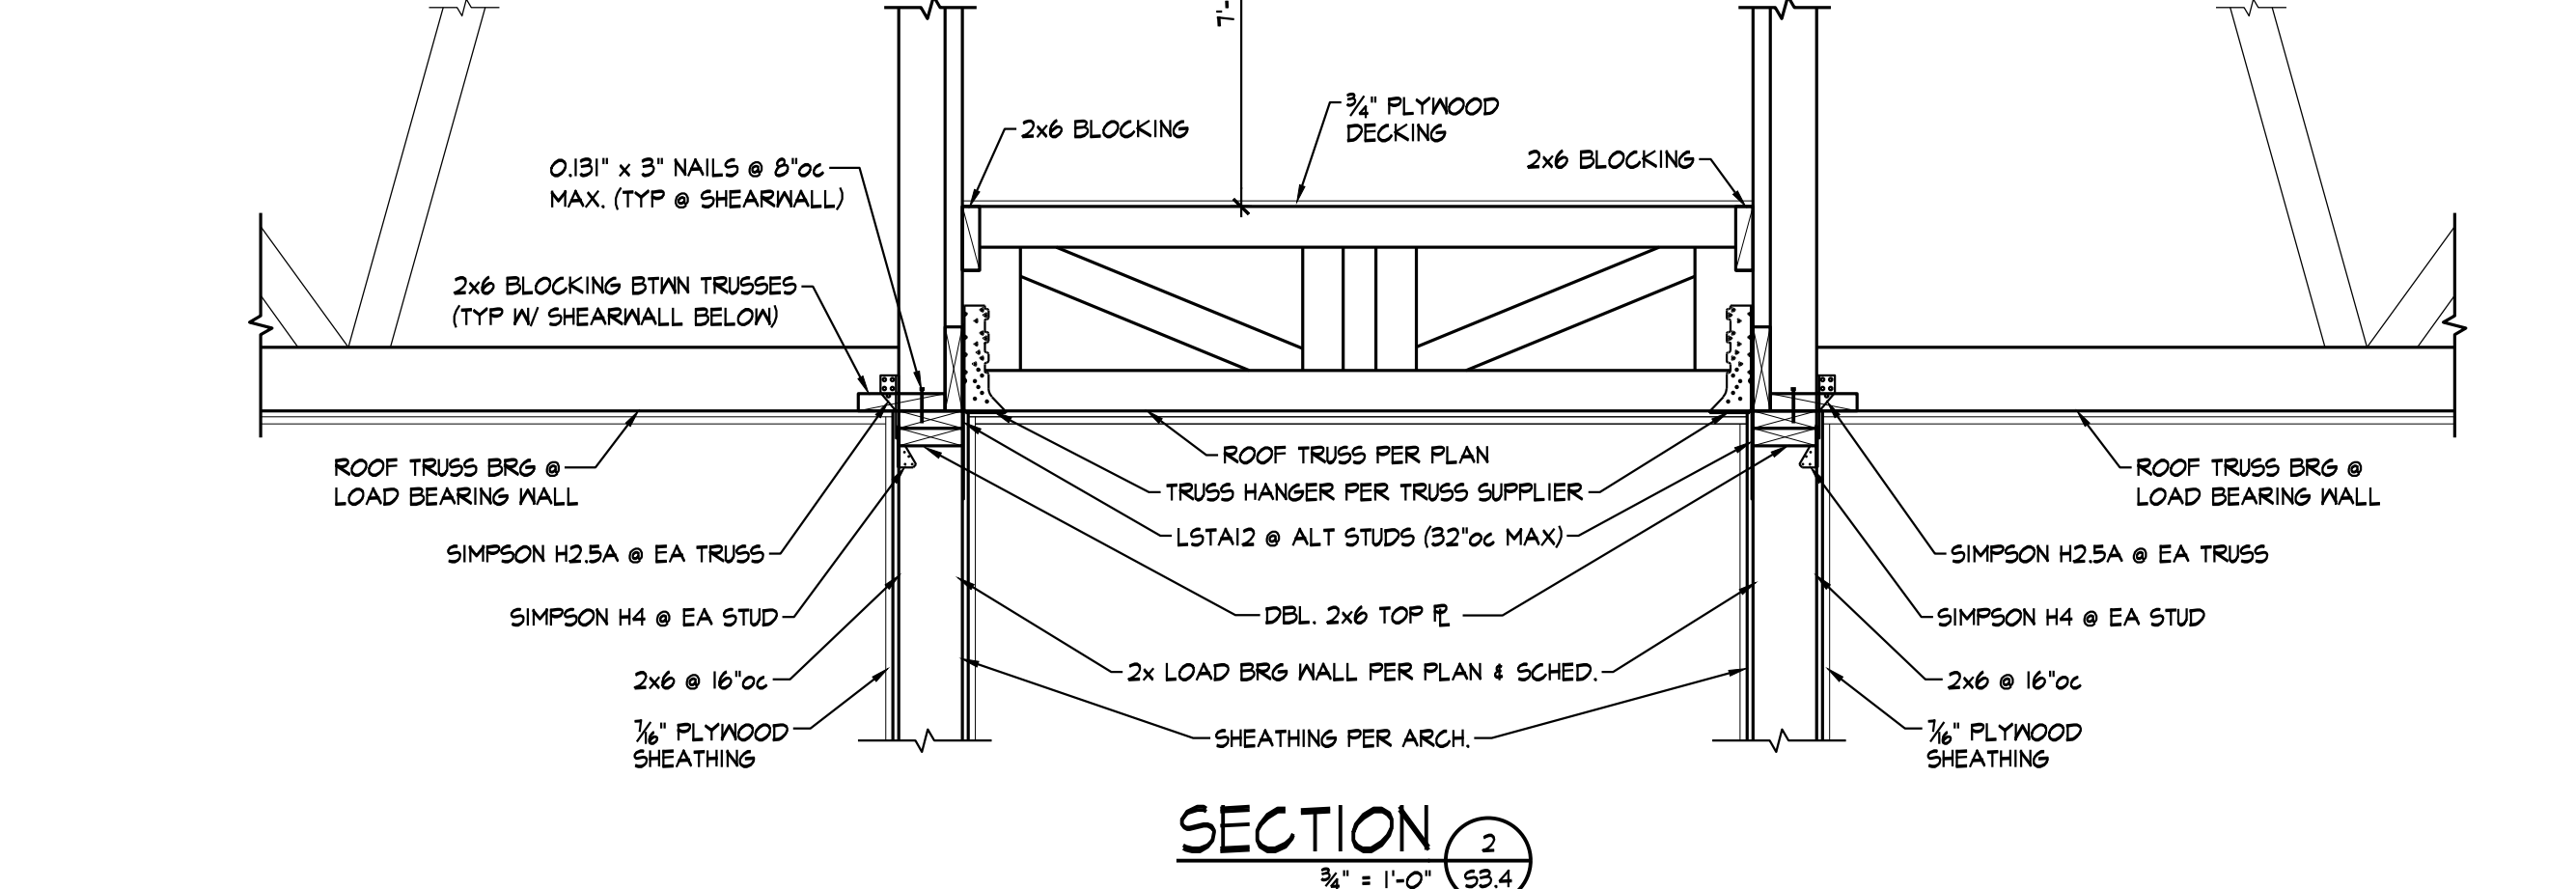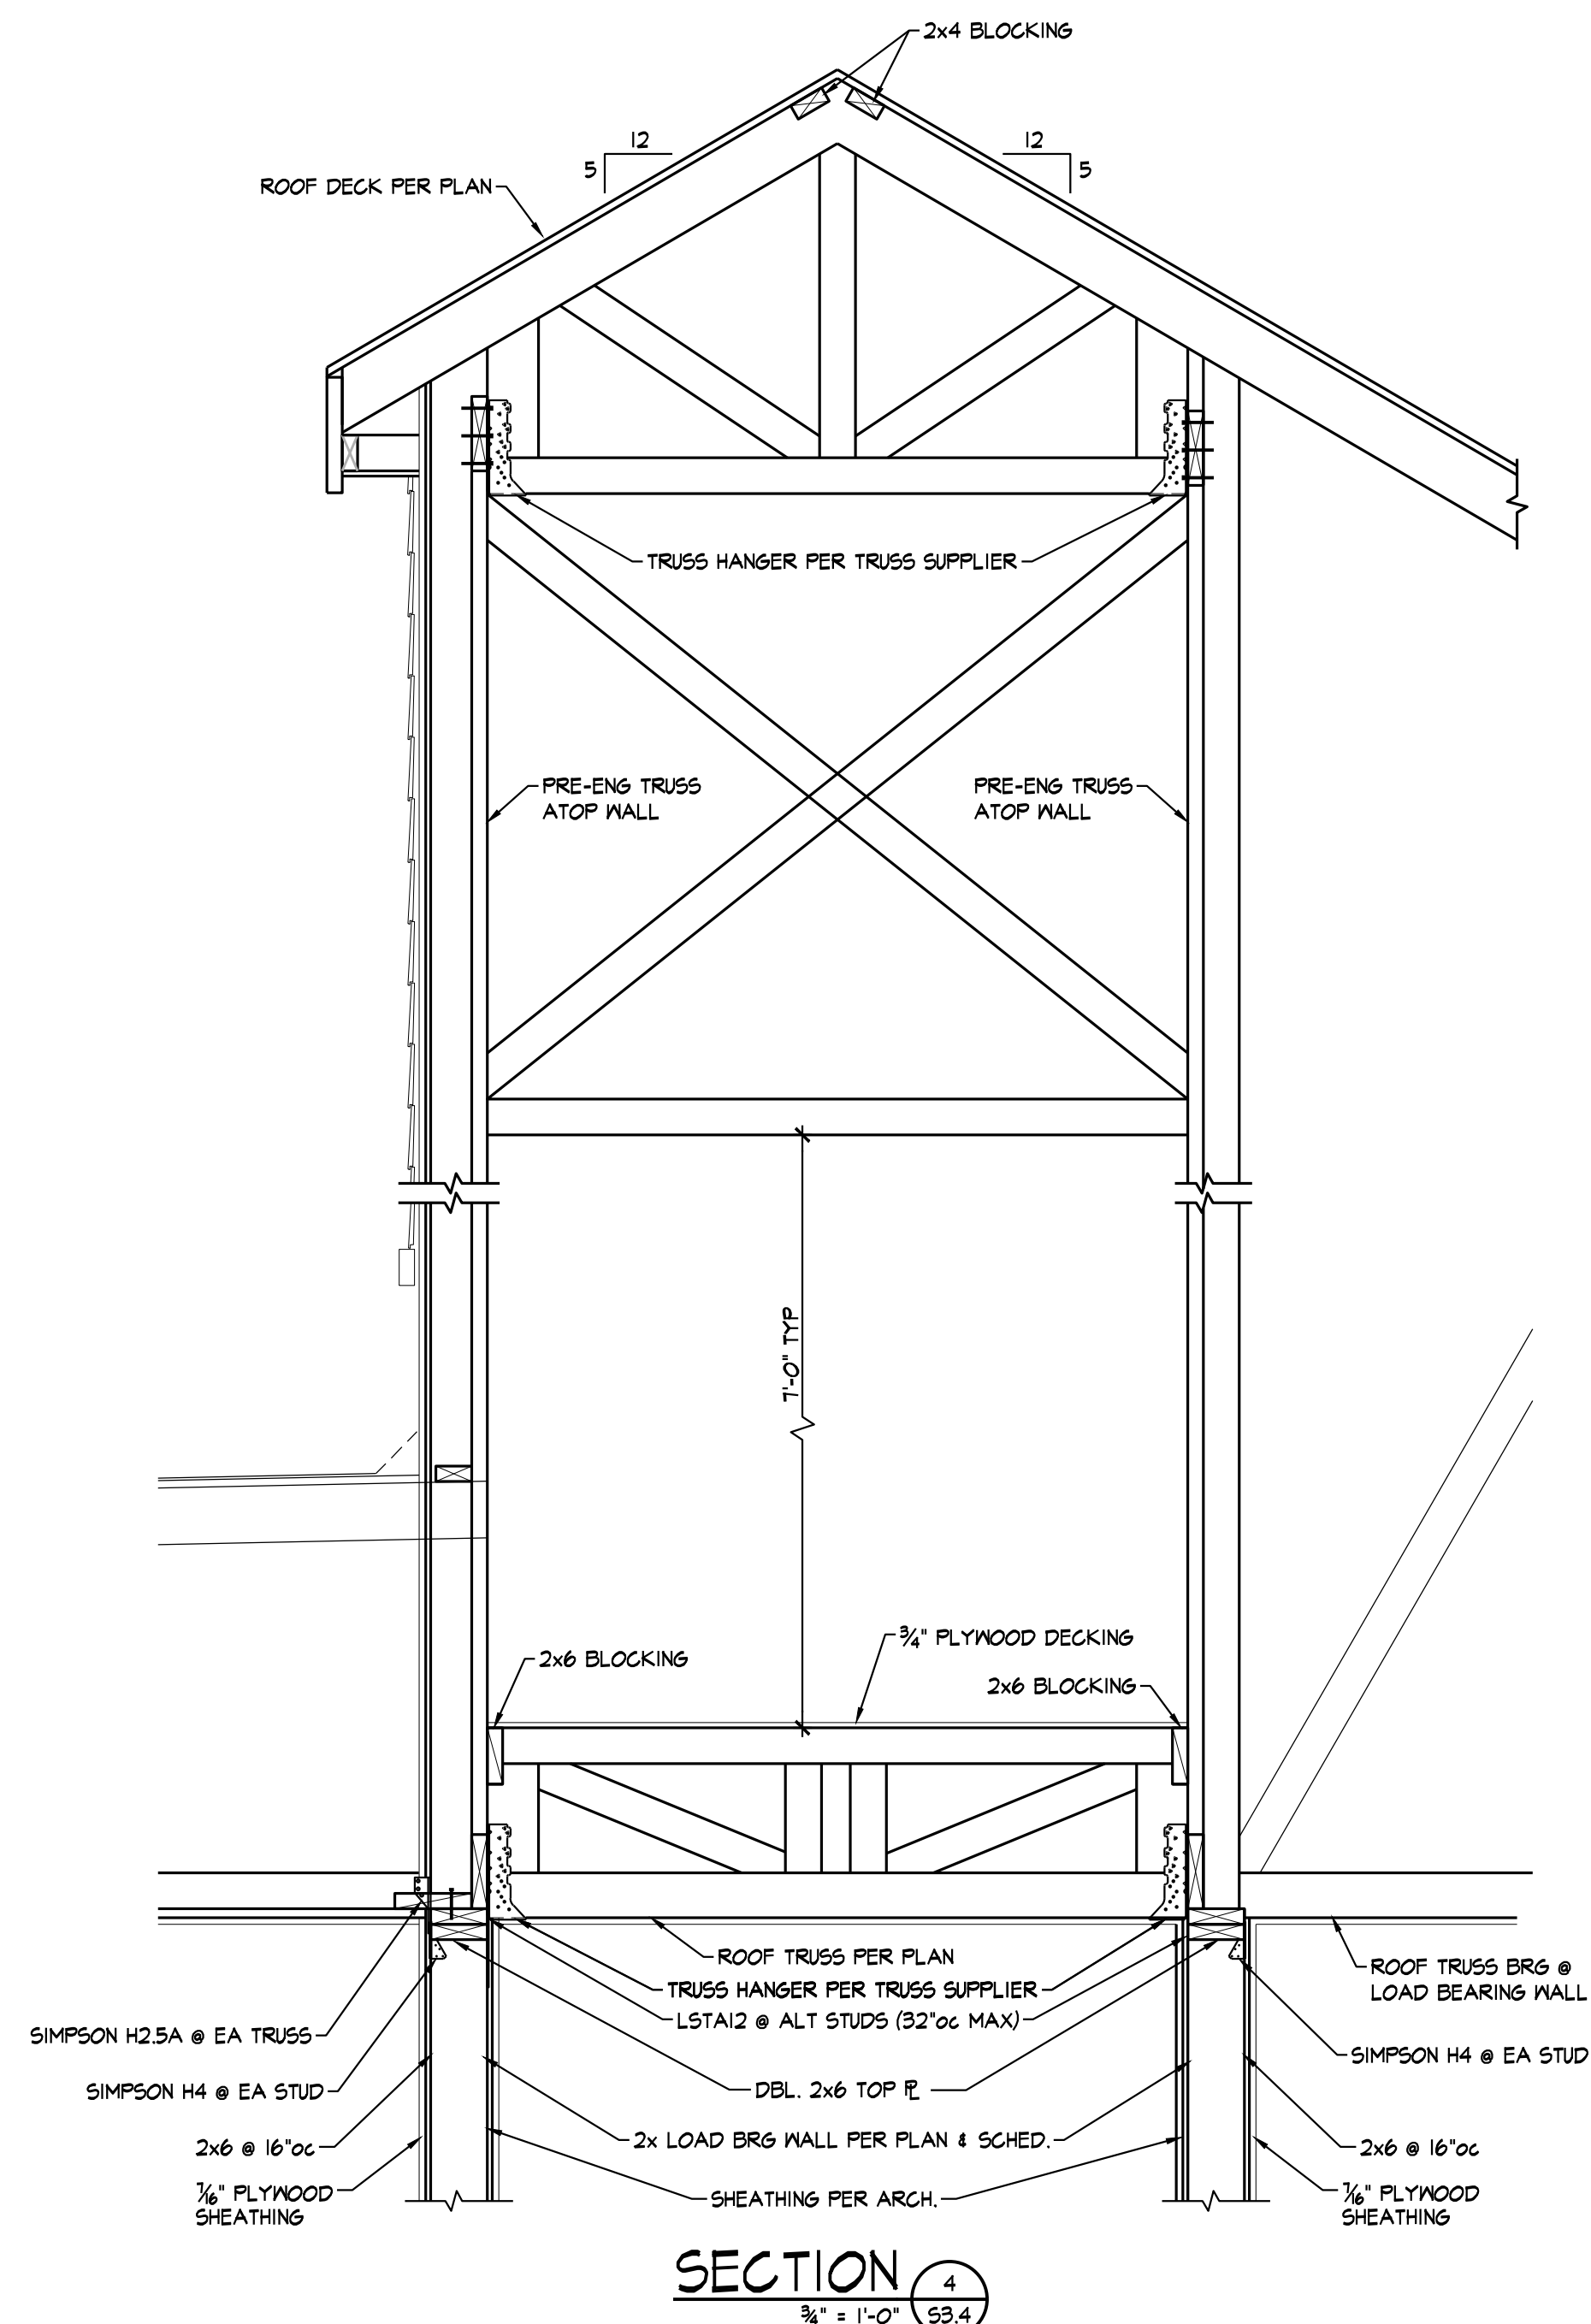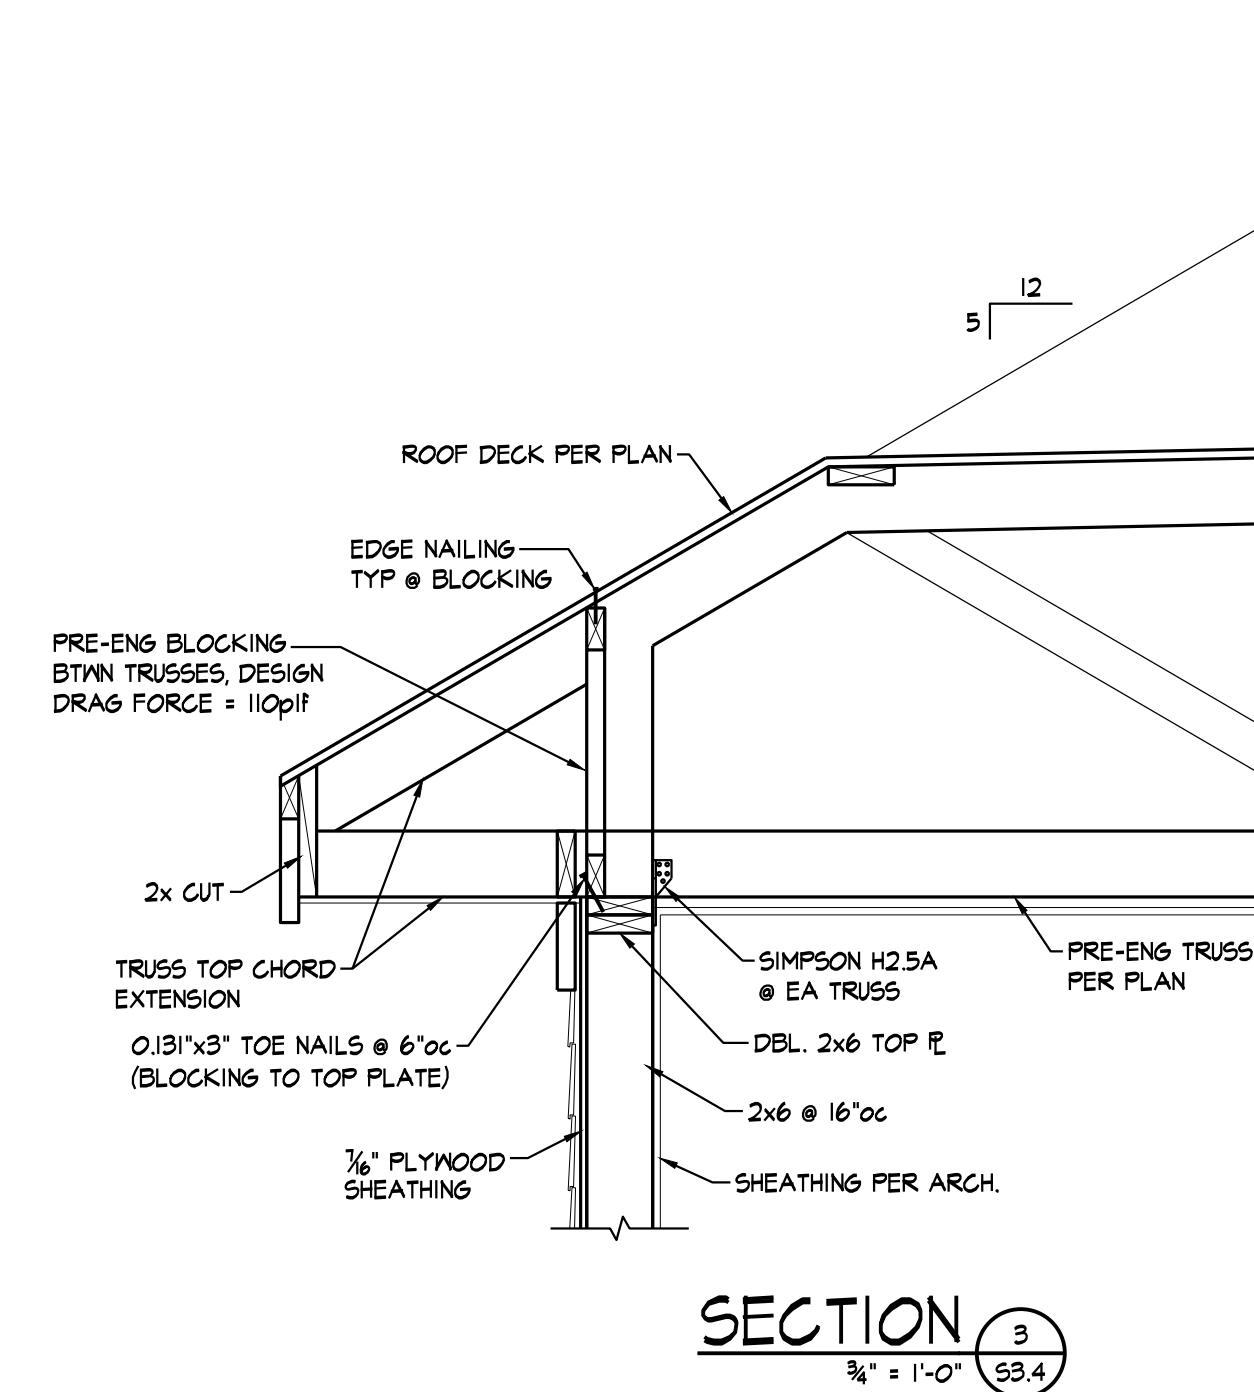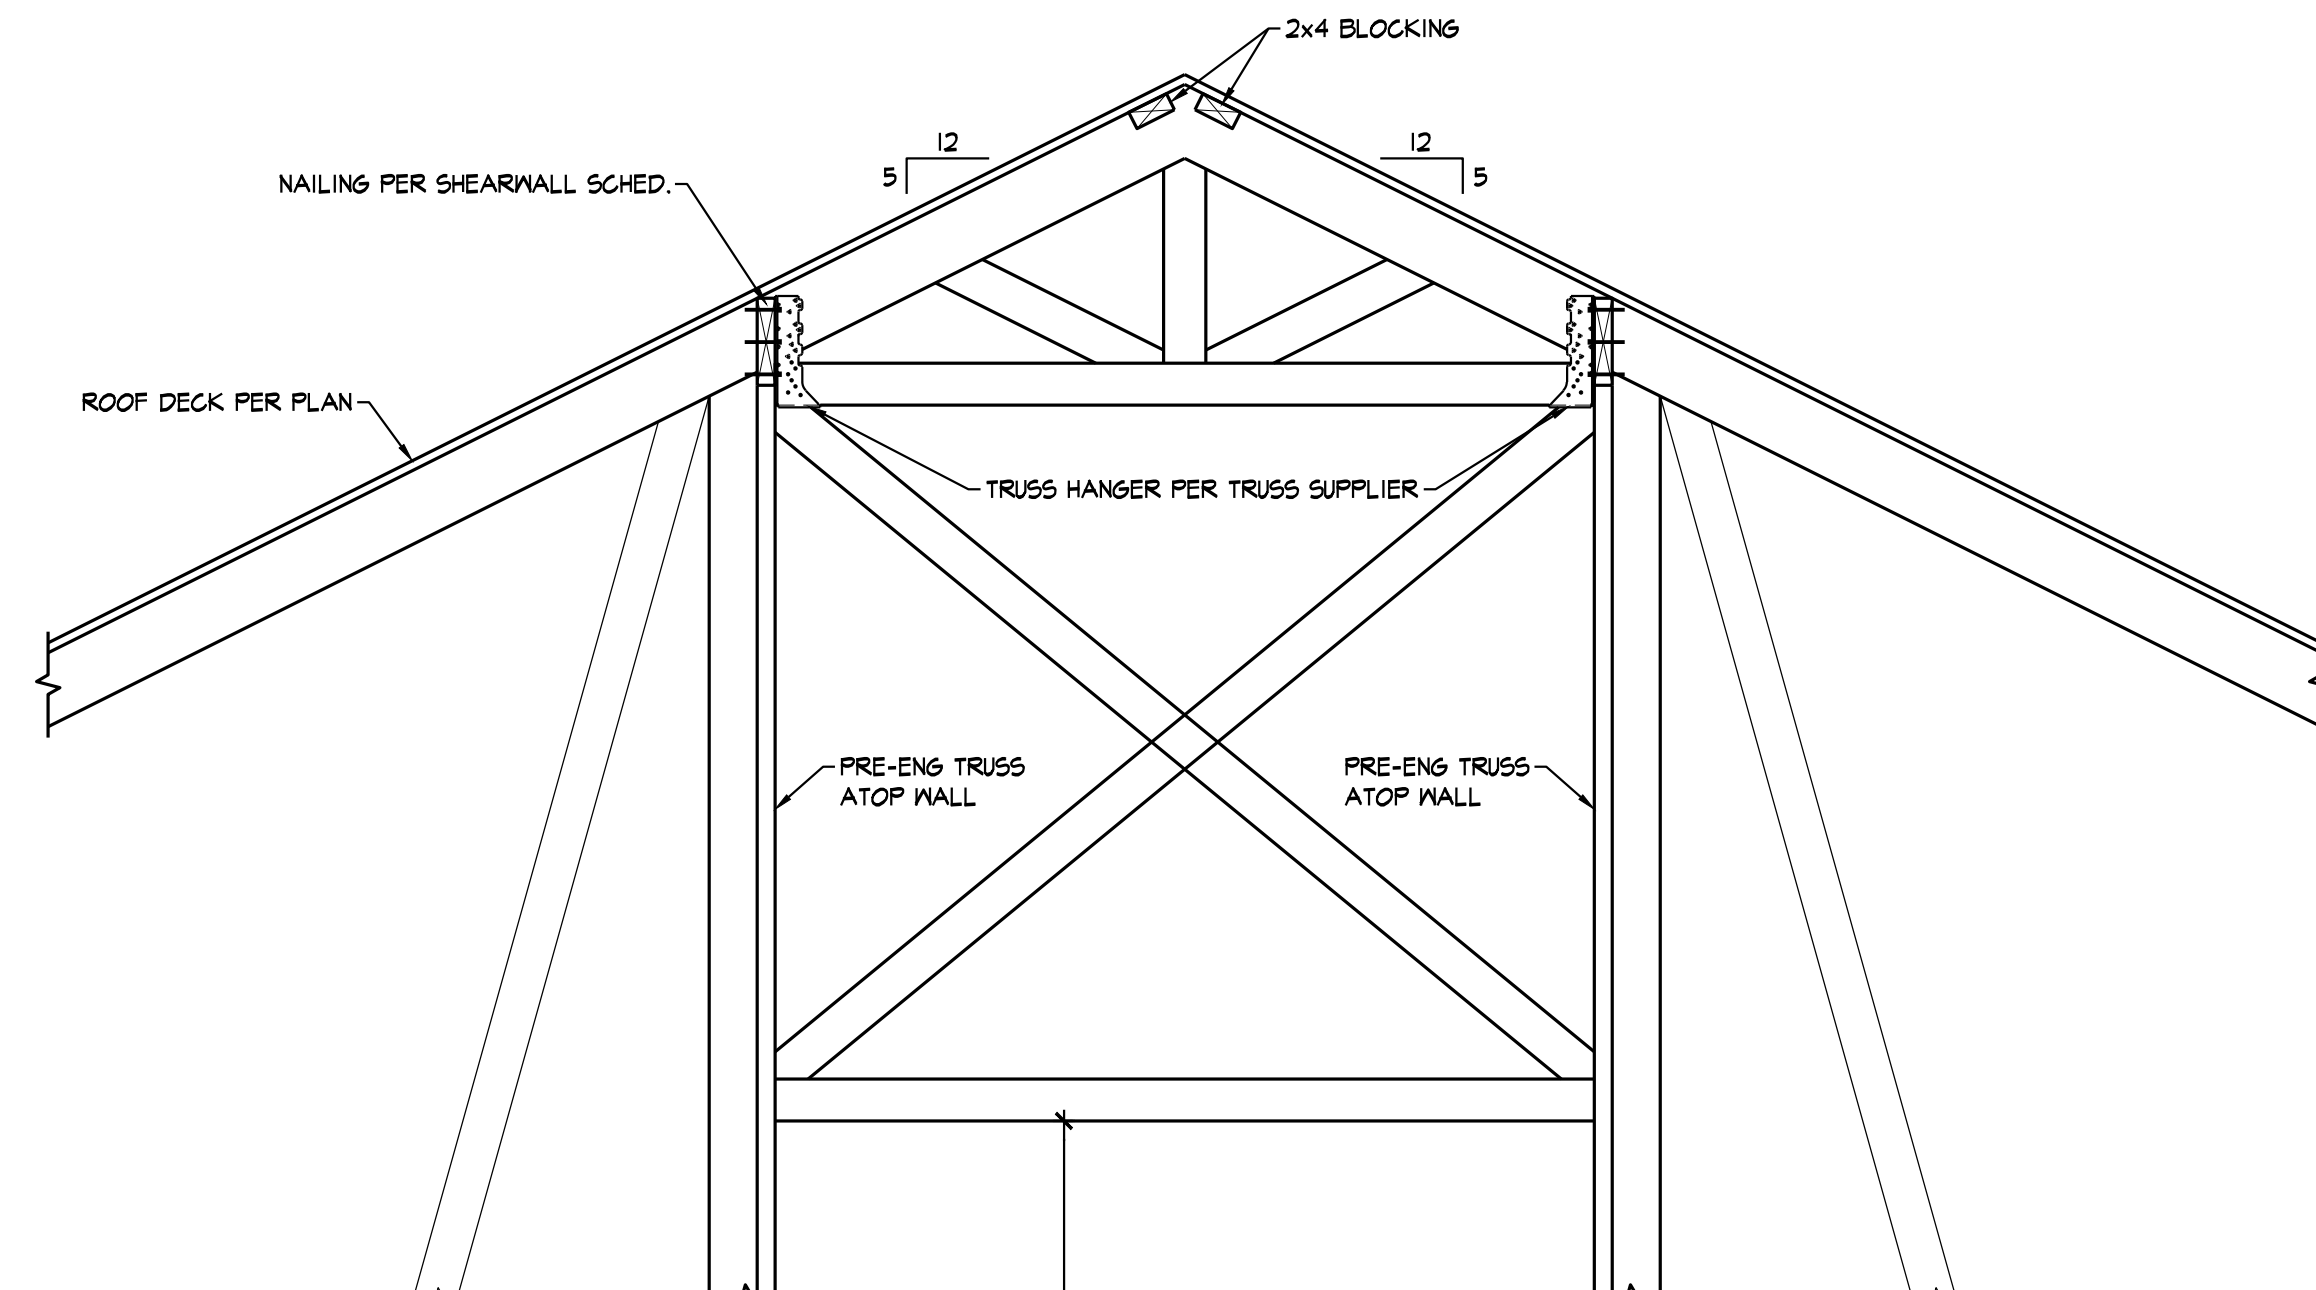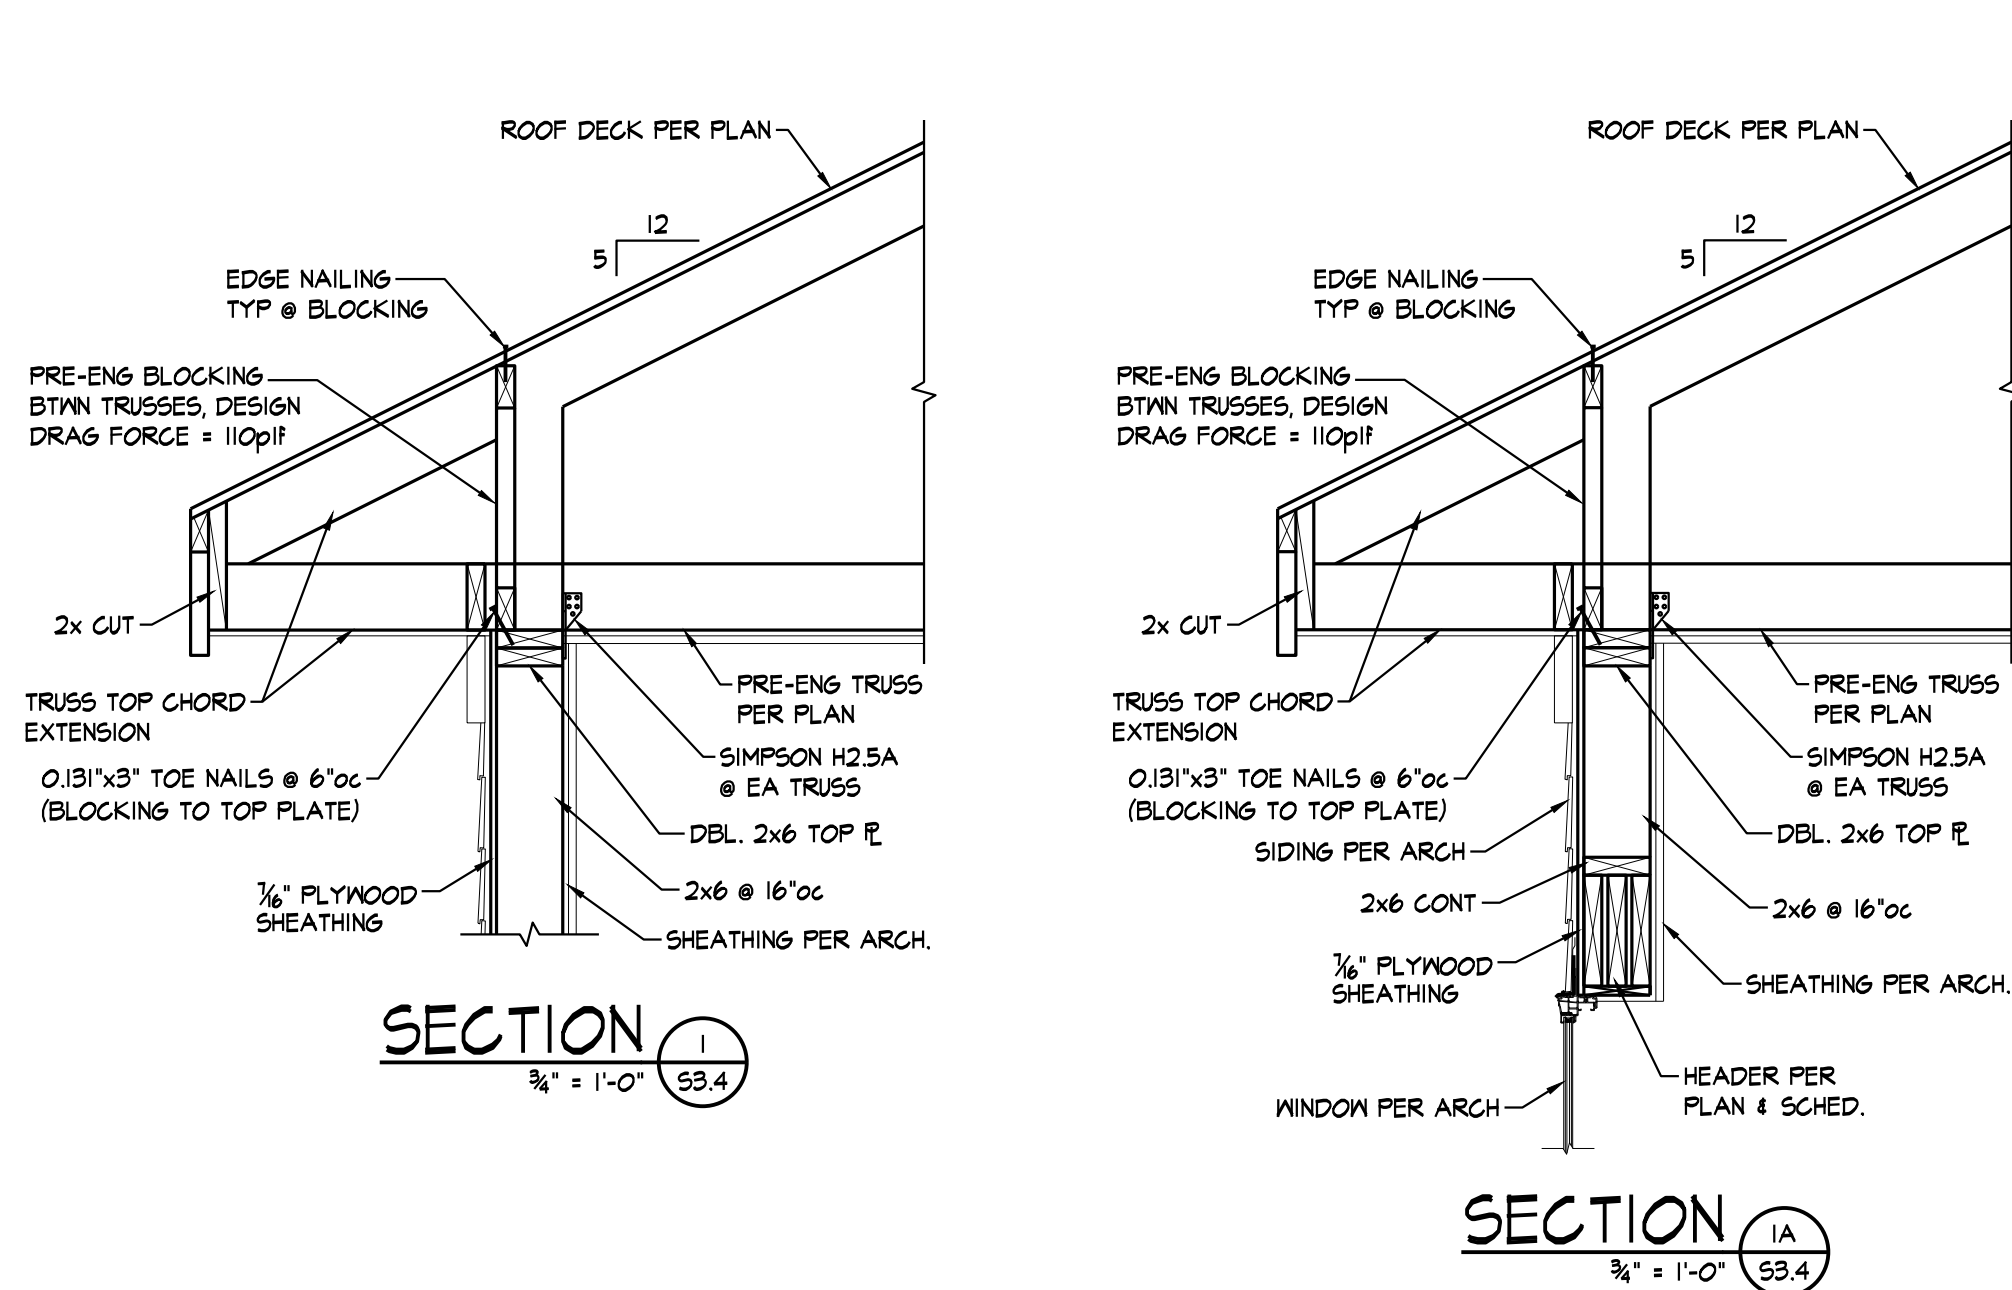


BOB D. CAMPBELL & CO.
Structural Engineers Since 1957
4398 Bellevue Ave. 818.531.4144
Kansas City, MO 64111 www.bdc-engrs.com

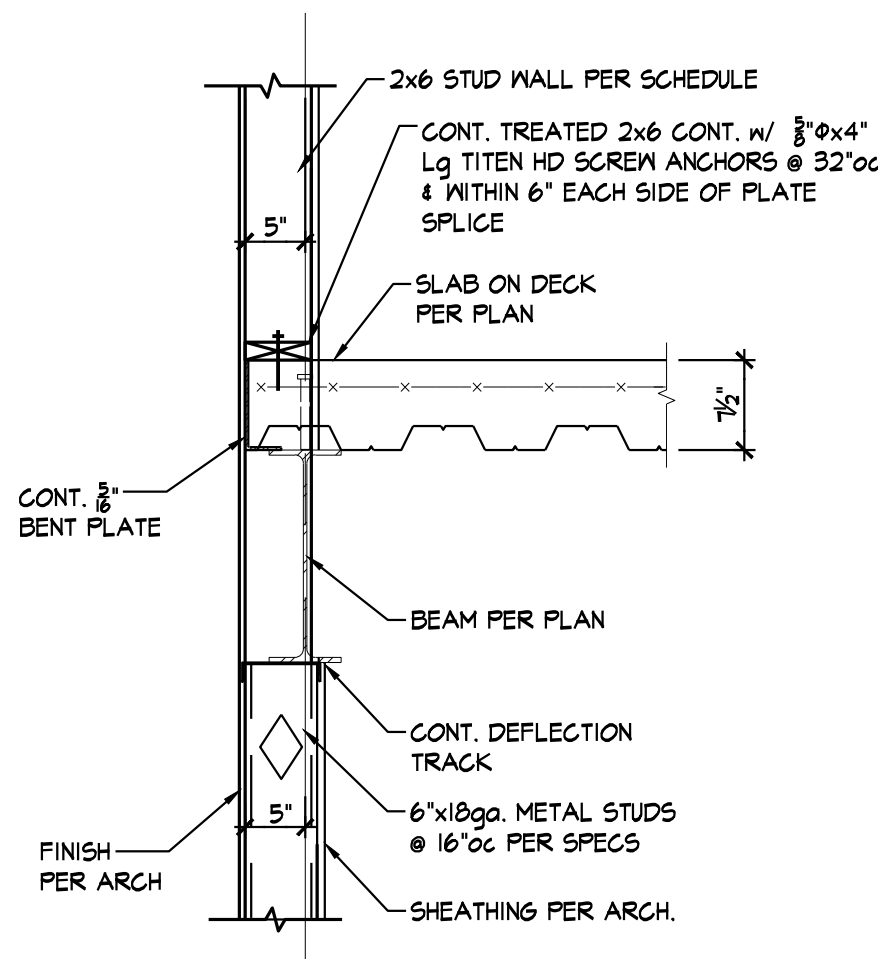


SECTION 1
3/4" = 1'-0" S3.5

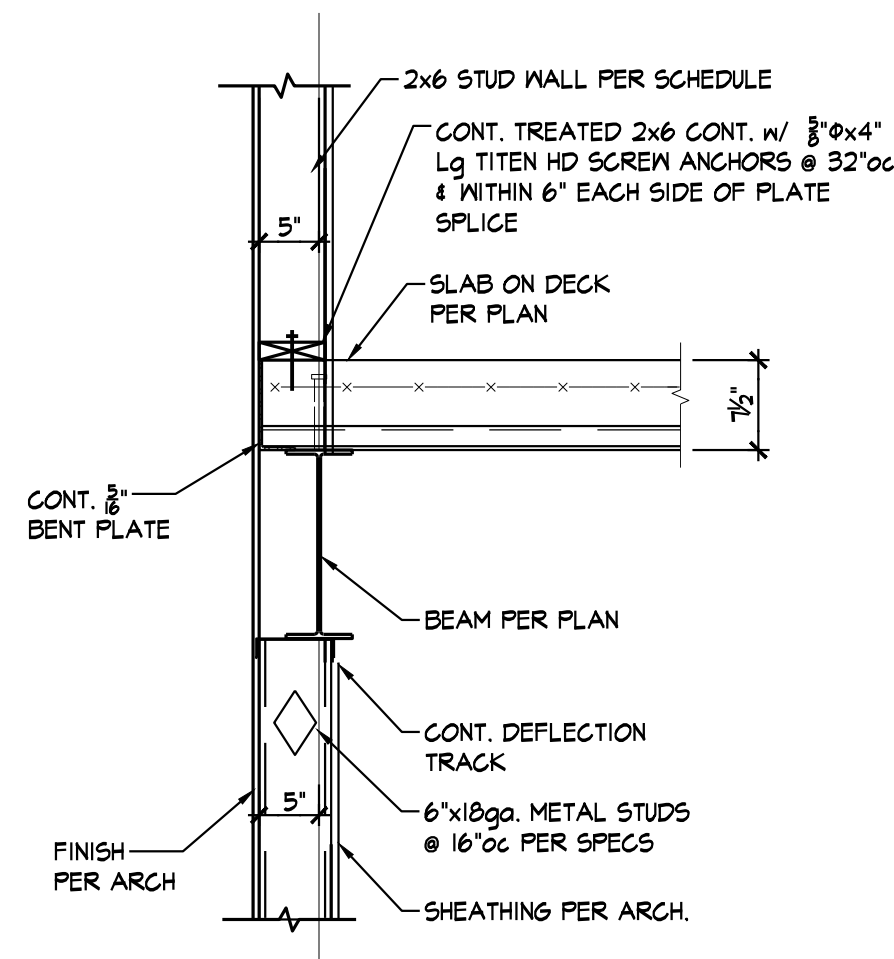


SECTION 2
3/4" = 1'-0" S3.5

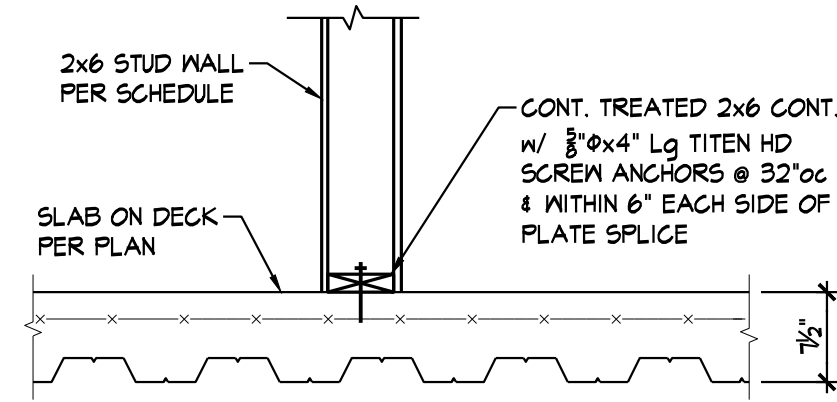


SECTION 3
3/4" = 1'-0" S3.5

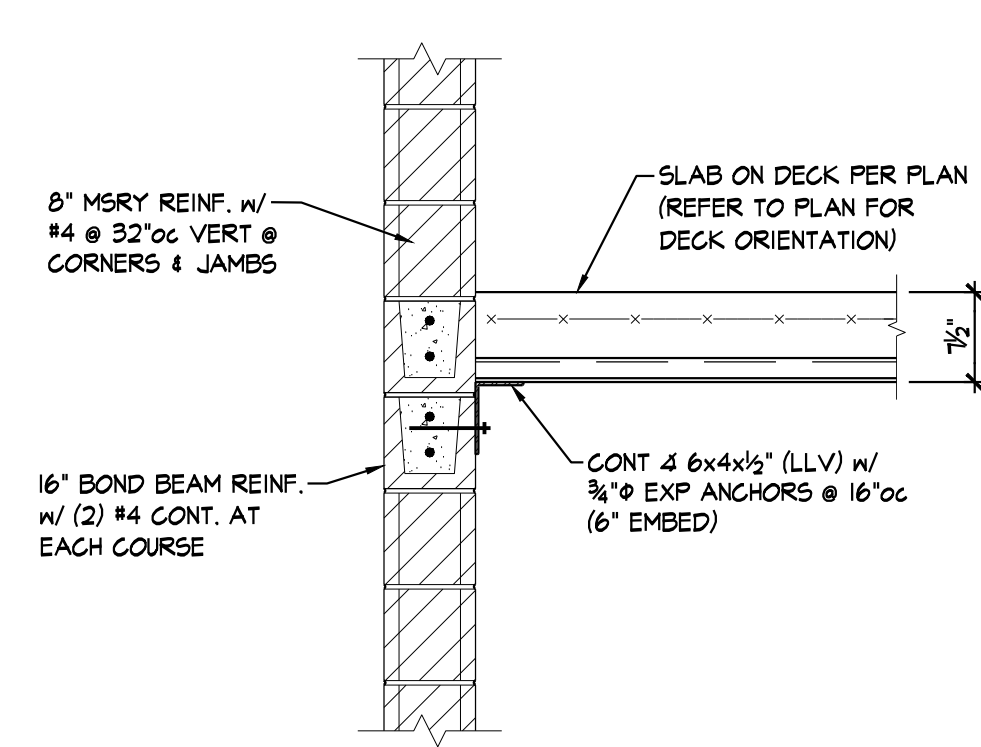


SECTION 4
3/4" = 1'-0" S3.5

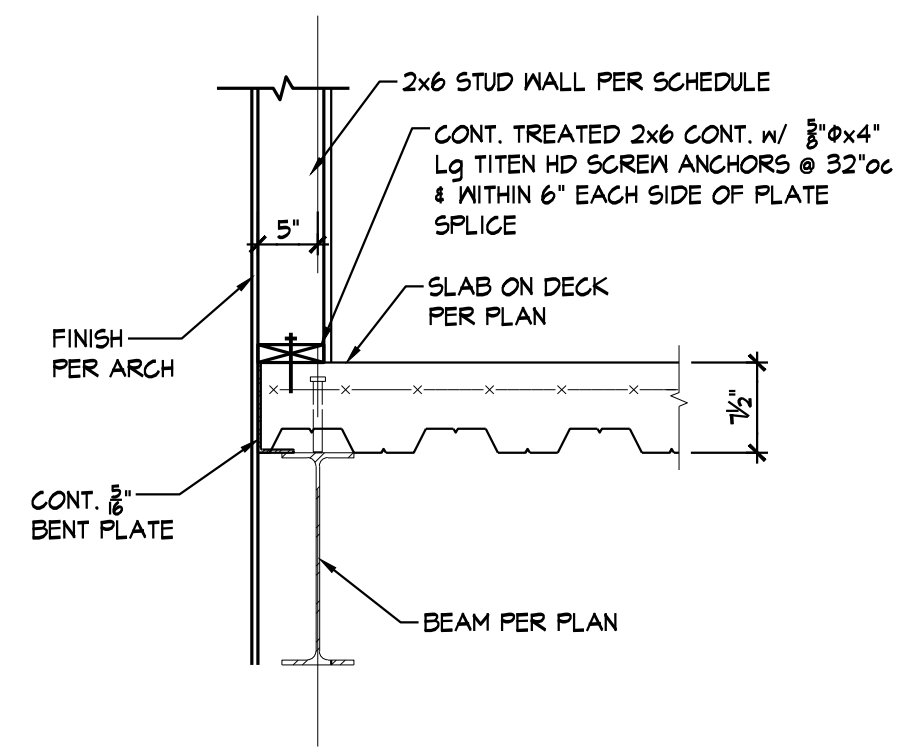


SECTION 5
3/4" = 1'-0" S3.5

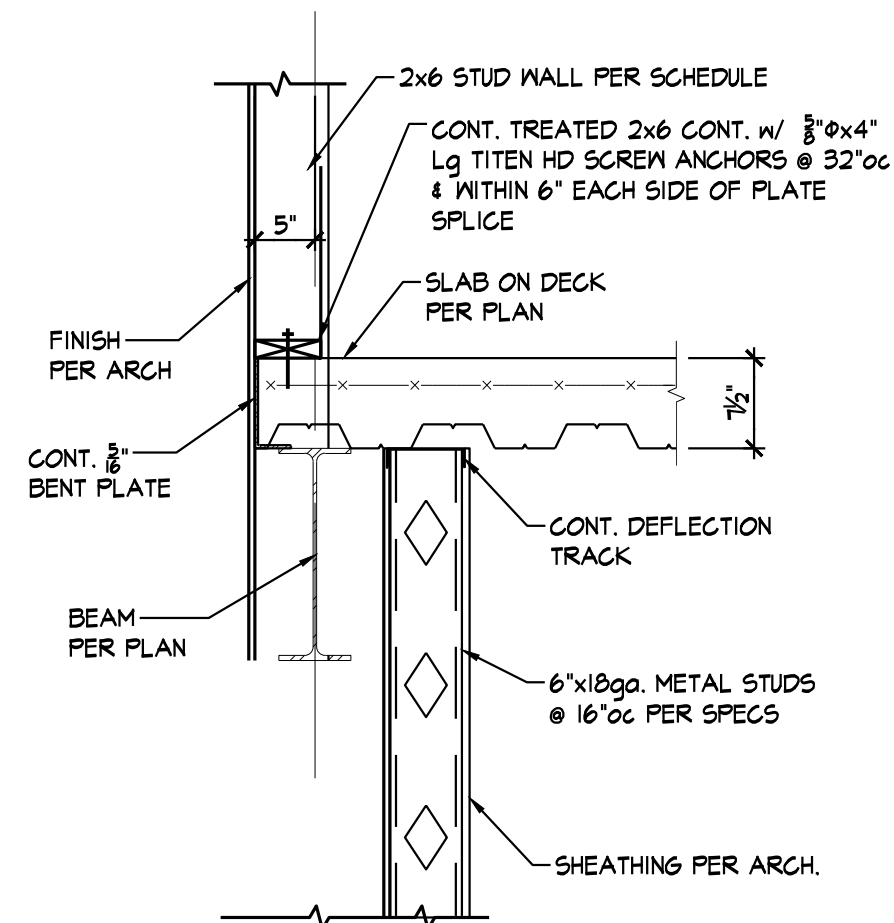


SECTION 6
3/4" = 1'-0" S3.5

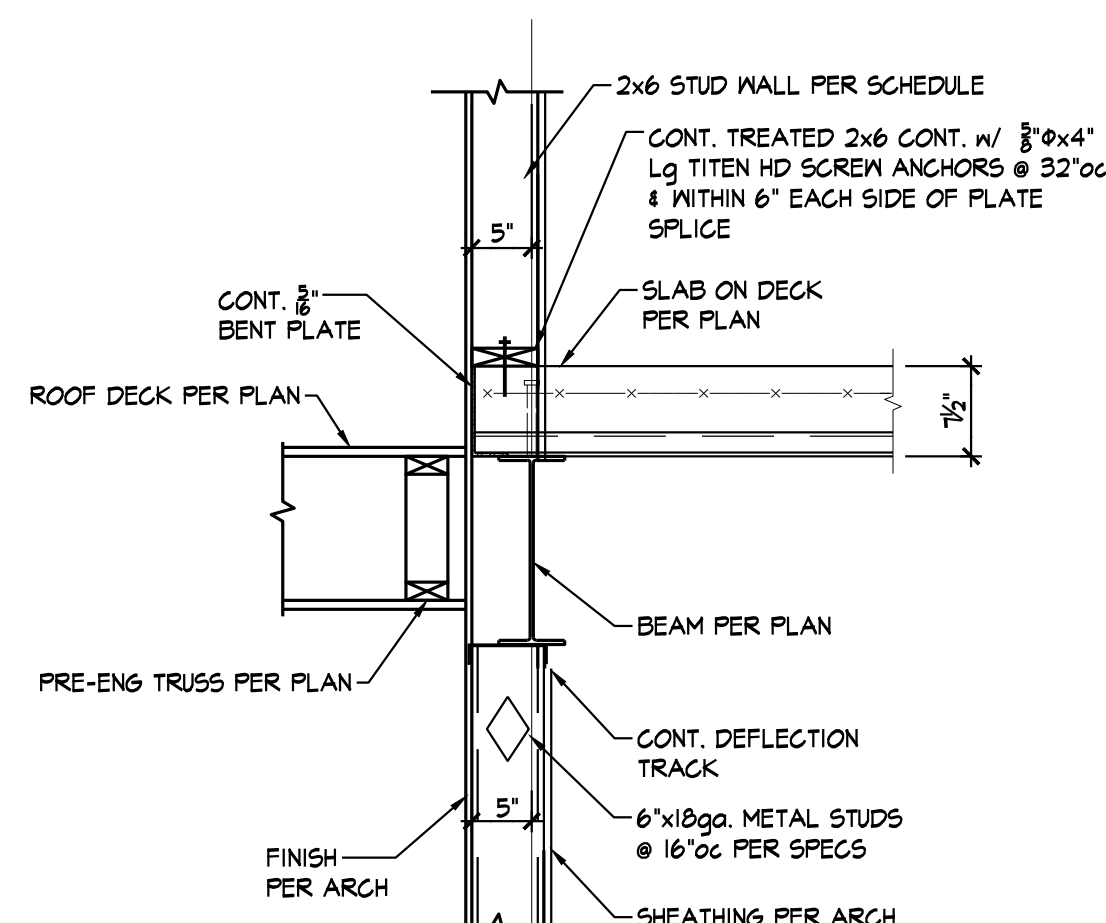


SECTION 7
3/4" = 1'-0" S3.5

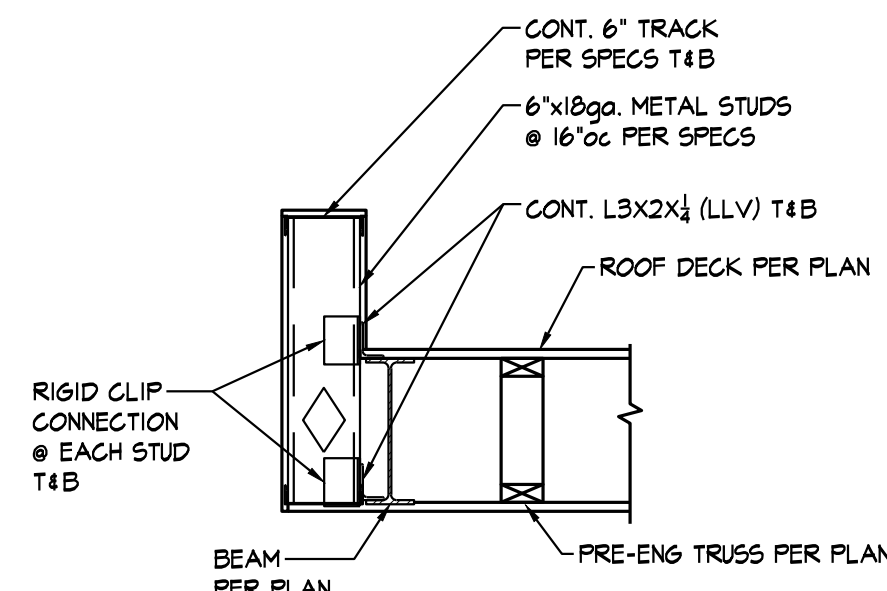

SECTION 8
3/4" = 1'-0" S3.5

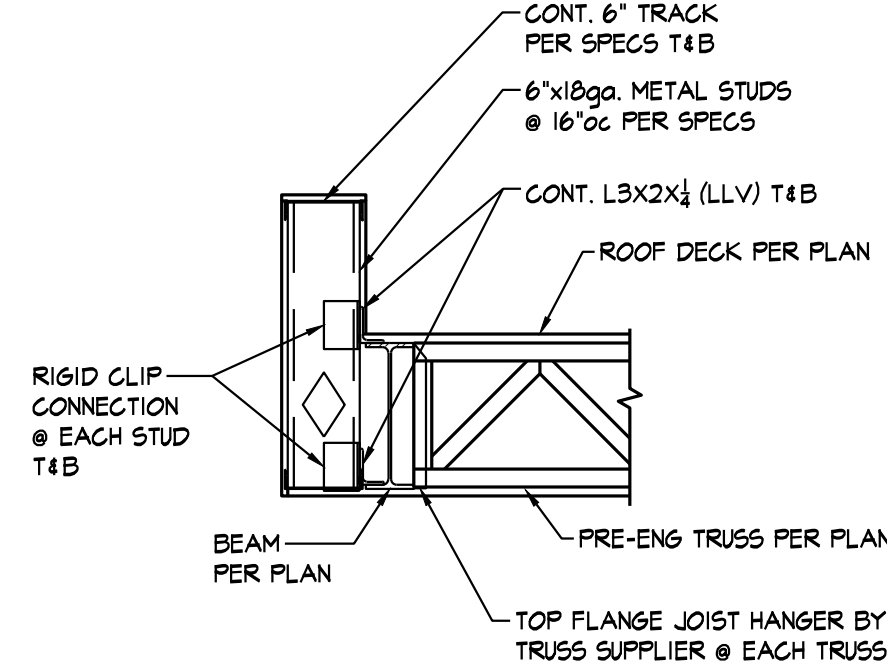

SECTION 9
3/4" = 1'-0" S3.5

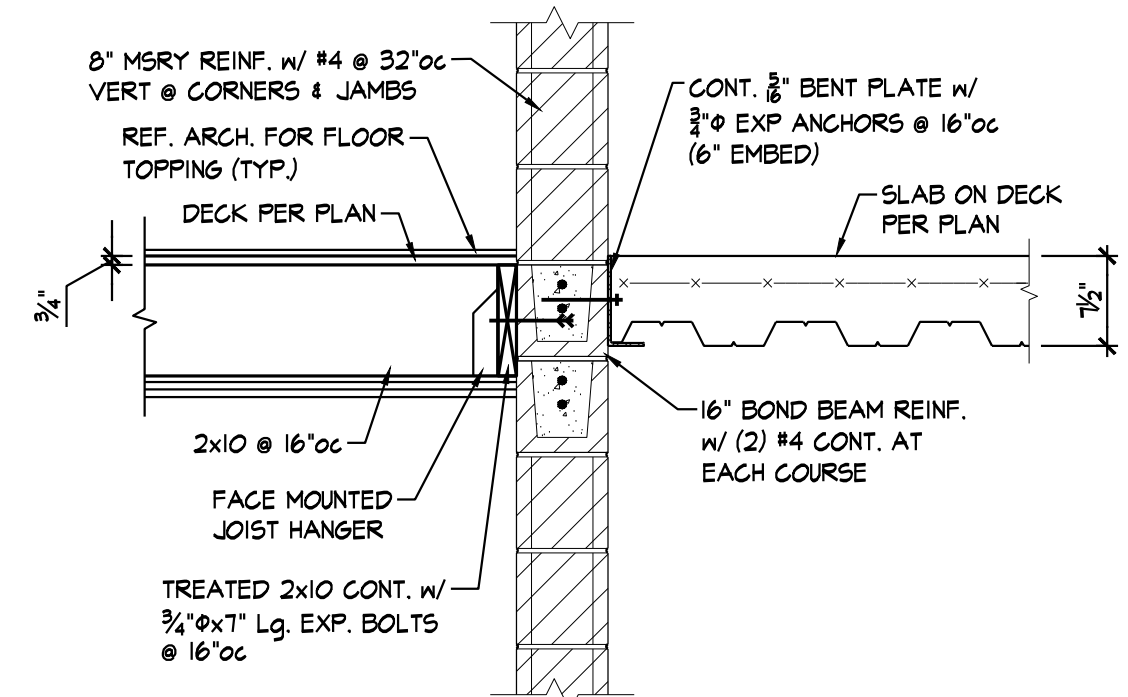

SECTION 10
3/4" = 1'-0" S3.5

THE RESERVES AT MEADOWS 25

KANSAS

NEW APARTMENTS

GODDARD,

JCR JonesGillamRenz
730 N. Ninth Street, Suite 301
Salina, KS 67401 Kansas City, MO 64108
785.827.0386 jgr@jgarchitects.com



REVISION:

DATE: 4-17-2026

JOB: 25-3465

SHEET NO.:

BOB D. CAMPBELL & CO.
Structural Engineers Since 1957
4338 Belleview Ave. 816.531.4144
Kansas City, MO 64111 www.bdc-engrs.com

S3.5

COPYRIGHTED ©

