


SALINA,

22-3239

KANSAS

VICINITY PLAN NOT TO SCALE

NOT TO SCALE

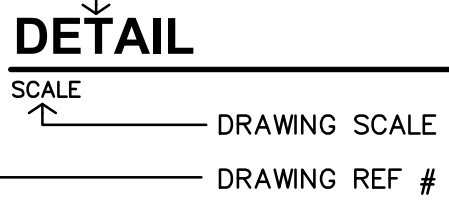

	BATT INSULATION		PLYWOOD
	BRICK MASONRY		ROUGH WOOD
	COMPACTED EARTH		FINISH WOOD
	RIGID INSULATION		METAL STUD
	POURED CONCRETE		GLASS LARGE SCALE
	WALL W/ BRICK VENEER		STRUCTURAL STEEL
	METAL STUD WALL		CONC. MASONRY UNIT SECTION
	CONCRETE WALL		MTL JOIST
	WOOD STUD WALL		MTL FURRING
	C.M.U. WALL		PRECAST CONC. SLAB

& @ #	AND Angle At Centerline Diameter or Round Pound or Number	Cntr. Col. Conc. Ceramic Tile CMU Ctr.	Counter Column Concrete Concrete Masonry Unit Center	Exp. Ext. F.A. F.D. F.E.C. Det. D.P. Dia. Dim. Dm. Down Dr. Ds. Dwg. Dwr.	Expansion Exterior Fire Alarm Fire Drain Foundation Fire Extinguisher F.E.C. Cabinet Finish Floor Flashing Flow Line Foot or feet Footing Furring Future	Hr. Ht. I.S. Insulation Interior	Hour Height Inside Diameter Inch Janitor	N.I.C. North Not In Contract No. or Number Nominal N.T.S. On or Over Obscure O.C. On Center O.D. Office Oppg. Opposite	Reinf. Req'd Resil. R.O. S. S.B. Sched. Sec. Shower Sheet Sim. N.D. Plastic Laminate Plas. Plaster PLYWD. Pdrt. Pt. P.T.D. Pln. P.L.R.	Reinforced Required Resilient Rough Opening South Splash Block Solid Core Schedule Shop Dispenser Section Shower Lamination Similar Sanitary Napkin Disp. Unit Spec. Square Stainless Steel Stand. Steel Storage Struct. Suspended Sheet Vinyl Sym.	Temp. T.&G. Thick Thin Top Of Masonry Top Of Steel Top Of Pavement Toilet Paper Dispenser Television T.W. Typical Tread Ur. Unless Otherwise Noted Vinyl Composition Tile V.B. Vert. Vestibule Vyn. West With w/o W.C. Wood Wp. Wdw. Wt. Weight		
Acqus.	Acoustical	Dbl.	Double	Furr.	F.F.E.C.	Int.	Janitor	O/S.	On or Over	S.	South	I.P.	Toilet Paper Dispenser
Adj.	Adjustable	Det.	Detail	Fin.	Finish	Jt.	Joint	O.C.	On Center	S.B.	Splash Block	P.D.	Television
A.F.F.	Above Finished Floor	D.P.	Drinking Fountain	Fl.	Floor	Kit.	Kitchen	O.D.	On Diameter	Sched.	Solid Core	T.W.	Tackwall
Aggr.	Aggregate	Dia.	Diameter	Flash.	Flashing	Lam.	Lamination	Off.	Offset	Sect.	Section	Typ.	Typical
Al.	Aluminum	Dim.	Dimension	Fl.	Flow line	Lab.	Laboratory	Oppg.	Opening	Shr.	Shower	U.O.N.	Unless Otherwise Noted
Approx.	Approximate	Dn.	Down	Dr.	Drainage	Lav.	Lavatory	P.	Paint	Sim.	Similar	V.C.T.	Vinyl Composition Tile
Asb.	Asbestos	Dsg.	Drawings	Furr.	Furring	Lck.	Locker	Pl.	Plate	N.D.	No. Diameter	V.N.R.	Vapor Napkin Recept.
Asph.	Asphalt	Dwg.	Drawing	Fut.	Future	Lt.	Light	P.Lam.	Plastic Laminate	Plas.	Plaster	V.B.	Vapor Barrier
A.V.	Audio Visual	Dwr.	Drawer	Ga.	Gauge	Mas.	Masonry	Plywd.	Plywood	Spec.	Specification	Vert.	Vertical
Bd.	Board	(E)	Existing	Galv.	Galvanized	Max.	Maximum	Pdr Pt.	Point	Rst.	Rustless Steel	Vest.	Vestibule
Bitum.	Bituminous	Ea.	Each	Gl.	Glass	Mech.	Mechanical	Pt.	Point	Std.	Standard	Vyn.	Vinyl
Bldg.	Building	E.J.	Expansion Joint	Gnd.	Ground	Memb.	Membrane	P.T.D.	Paper Towel Dispenser	Stor.	Storage	W.	West
Blk.	Block	El.	Elevation	Met.	Electrical	Mfr.	Manufacturer	Part.	Partition	Susp.	Suspended	w/o	Without
Blk.g.	Blocking	Elev.	Elevator	H.B.	Hose Bibb	Mh.	Manhole	Q.T.	Quarry Tile	Sym.	Symmetrical	W.C.	Wall Covering
Bldgm.	Buildng	Eq.	Equipment	H.C.	Hollow Core	Mn.	Minimum	R.	Riser	Tex.	Texture	Wd.	Width
Bot.	Bottom	E.W.	Each Way	Hdw.	Hardwood	Mir.	Mirror	R.	Riser	Tbd.	Tack Board	Wp.	Waterproof
BO	BY OWNER	Elec.	Electric	Hdw.	Hardware	Misc.	Miscellaneous	Rad.	Radius	Txt.	Texture	Wdw.	Window
Bearing	Bearing	Exp.	Exposed	H.M.	Hollow Metal	M.O.	Masonry Opening	Ref.	Reference	U.O.	Unless Otherwise Noted	Wainsc.	Wainscoting
Brk.	Brick	Equip.	Equipment	Horiz.	Horizontal	Mntd.	Mounted	Ref.	Reference	Tbd.	Tack Board	Wt.	Weight

#1 - INSTALL EIFS @ THE DANCE STUDIO ADDITION FACADE IN LIEU OF ACM PANELS

#2 - ELIMINATING THE PAINTING THE STEEL STRUCTURE, & DUCTWORK, CONDUIT, PIPING, ETC. AT THE SCENE SHOP ADDITION

#3 - EIFS SYSTEM WARRANTY OF 20 YEARS

#4 - DANCE STUDIO FLOOR



GENERAL

	COVER
	SITE SURVEY
CFP1	CODE FOOTPRINT
CFP2	CODE FOOTPRINT
ADA	ADA DIAGRAMS

CIVIL

C01 DEMOLITION PLAN
C02 SITE & UTILITY PLAN
C03 GRADING & EROSION CONTROL PLAN
C04 DETAIL SHEET
C05 DETAIL SHEET

DEMOLITION

D1.1 DEMOLITION SITE PLAN
D1.2 PHOTOGRAPHS
D2.1 DEMOLITION FLOOR PLANS
D2.2 PHOTOGRAPHS

ARCHITECTURAL

- A1.1 SITE PLAN
- A1.2 ENLARGED SITE PLAN
- A2.1 MAIN LEVEL FLOOR PLAN
- A2.2 STAGE LEVEL FLOOR PLAN
- A2.3 BASEMENT LEVEL & SECOND LEVEL PLANS
- A3.1 EXTERIOR ELEVATIONS
- A3.2 EXTERIOR ELEVATIONS
- A3.3 BUILDING SECTIONS
- A3.4 BUILDING SECTIONS & DETAILS
- A3.5 BUILDING SECTIONS
- A3.6 MANUFACTURER DETAILS
- A4.1 WALL SECTION KEY PLAN
- A4.2 EXISTING WALL SECTIONS
- A4.3 EXISTING WALL SECTIONS
- A4.1 WALL SECTIONS
- A4.2 WALL SECTIONS
- A4.3 WALL SECTIONS
- A4.4 WALL SECTIONS
- A4.5 WALL SECTIONS
- A4.6 WALL SECTIONS
- A4.7 WALL SECTIONS
- A4.8 WALL SECTIONS
- A4.9 WALL SECTIONS
- A4.10 WALL SECTIONS
- A4.11 WALL SECTIONS
- A4.12 WALL SECTIONS
- A4.13 DETAILS
- A4.14 DETAILS
- A5.1 ROOF PLAN
- A5.2 DETAILS
- A6.1 STAIR PLANS & SECTIONS
- A6.2 STAIR SECTIONS
- A6.3 STAIR SECTIONS
- A7.1 PARTIAL MAIN & STAGE LEVEL REFLECTED CEILING PLAN
- A7.2 PARTIAL MAIN & STAGE LEVEL REFLECTED CEILING PLAN
- A7.3 PARTIAL MAIN & STAGE LEVEL FLOOR FINISH PLAN
- A8.1 PARTIAL MAIN & STAGE LEVEL FLOOR FINISH PLAN
- A9.1 PARTIAL MAIN & STAGE LEVEL FLOOR FINISH PLAN
- A9.2 INTERIOR ELEVATIONS
- A9.3 INTERIOR ELEVATIONS
- A9.4 INTERIOR ELEVATIONS
- A9.5 INTERIOR ELEVATIONS
- A9.6 CASEWORK ELEVATIONS & SECTIONS
- A10.1 FINISH, DOOR & WINDOW SCHEDULES
- A10.2 DETAILS

STRUCTURAL

- S0.1 STRUCTURAL GENERAL NOTES
- S0.2 STANDARD DETAILS
- S0.3 STANDARD DETAILS
- S2.1 BASEMENT FOUNDATION PLAN
- S2.2 STAGE LEVEL FOUNDATION & FRAMING PLAN
- S2.3 MAIN LEVEL FOUNDATION & SECOND LEVEL FRAMING PLAN
- S2.4 ROOF FRAMING PLAN
- S3.0 TYPICAL CONCRETE SLAB DETAILS
- S3.1 SECTIONS
- S3.2 SECTIONS
- S3.3 SECTIONS
- S3.4 SECTIONS
- S3.5 SECTIONS
- S3.6 SECTIONS
- S3.7 SECTIONS
- S3.8 SECTIONS
- S3.9 SECTIONS
- S4.1 BRACING SECTIONS
- S4.2 BRACING SECTIONS
- S4.3 BRACING SECTIONS
- S4.4 BRACING SECTIONS
- S4.5 BRACING SECTIONS
- S4.6 BRACING SECTIONS

MECHANICAL

- ME1.1 MECHANICAL ELECTRICAL DEMOLITION
- ME1.2 MECHANICAL ELECTRICAL ROOF PLAN
- W0.1 MECHANICAL LEGEND
- W1.1 LEVEL 1 HVAC PLAN
- M6.1 SCHEDULE
- PP0.1 PLUMBING LEGEND
- PP1.1 DRAIN & VENT – UNDERFLOOR PLAN
- PP2.1 DRAIN & VENT – MAIN FLOOR PLAN
- PP1.3 DOMESTIC WATER AND GAS – MAIN LEVEL FLOOR PLAN
- PP6.1 SCHEDULES & DETAILS
- PP9.1 WATER, WASTE & VENT RISER DIAGRAMS

ELECTRICAL

E0.1	ELECTRICAL LEGEND AND NOTES
E6.1	FIXTURE AND PANELBOARD SCHEDULES
EL1.1	LIGHTING PLANS – BASEMENT AND STAGE LEVEL FLOOR PLAN
EL1.2	LIGHTING PLAN – MAIN LEVEL FLOOR PLAN
EP1.1	POWER PLANS – LOWER LEVEL AND STAGE LEVEL FLOOR PLAN
EP1.2	POWER PLAN – MAIN LEVEL FLOOR PLAN

The logo for JonesGillamRenz, featuring the letters JGR in a large, bold, stylized font, with the full name JonesGillamRenz in a smaller, sans-serif font below it.

730 N. Ninth St. 1881 Main Street, Suite 301
Salina, KS 67401 Kansas City, MO 64108
785.827.0386 jgr@jgrarchitects.com


Civil Engineer ;



KAW Valley Engineers

1627 Sunflower Lane
SALINA, KS. 67401
ph. (785) 823-3400
sa@kveng.com

Mechanical & Electrical Engineer ;



LST Consulting Engineers, PA

4809 Vue Du Lac Place, Suite 301
MANHATTAN, KS. 66503
ph. (785) 587-8042
mail@LSTengineers.com

Structural Engineer ;



Bob D. Campbell & Co., Inc.

4338 Belleview
Kansas City, MO 64111
816.531.4144
info@bdc-engrs.com

PERMIT SET 9-18-2026

CERTIFICATE OF SURVEY FOR

SALINA COMMUNITY THEATRE ADDITION

TO THE CITY OF SALINA, SALINE COUNTY, KANSAS

A REPLAT OF A PORTION OF LOTS 93, 95, 97, 99 AND ALL OF LOTS 101, 103, 105, AND 107 ON FOURTH STREET, A PORTION OF THE VACATED NORTH SOUTH ALLEY BETWEEN THIRD STREET AND FOURTH STREET, A PORTION OF LOTS 88, 90, 92, AND ALL OF LOTS 94, 96, 98, 100, 102, 104, 106, AND 108 ON THIRD STREET, A PORTION OF VACATED THIRD STREET, A PORTION OF LOT 87, AND ALL OF LOTS 89, 91, 93, 95, 97, 99, 101, 103, 105, AND 107 ON THIRD STREET, A PORTION OF THE NORTH SOUTH ALLEY BETWEEN SECOND AND THIRD STREET, A PORTION OF LOT 88, 92, AND ALL OF LOTS 90, 94, 96, AND 98 ON SECOND STREET, ORIGINAL TOWN OF SALINA, SALINE COUNTY, KANSAS

PROPERTY DESCRIPTION:

A REPLAT OF A PORTION OF LOTS 93, 95, 97, 99 AND ALL OF LOTS 101, 103, 105, AND 107 ON FOURTH STREET, A PORTION OF THE VACATED NORTH SOUTH ALLEY BETWEEN THIRD STREET AND FOURTH STREET, A PORTION OF LOTS 88, 90, 92, AND ALL OF LOTS 94, 96, 98, 100, 102, 104, 106, AND 108 ON THIRD STREET, A PORTION OF VACATED THIRD STREET, A PORTION OF LOT 87, AND ALL OF LOTS 89, 91, 93, 95, 97, 99, 101, 103, 105, AND 107 ON THIRD STREET, A PORTION OF THE NORTH SOUTH ALLEY BETWEEN SECOND AND THIRD STREET, A PORTION OF LOT 88, 92, AND ALL OF LOTS 90, 94, 96, AND 98 ON SECOND STREET, ORIGINAL TOWN OF SALINA, SALINE COUNTY, KANSAS BEING MORE PARTICULARLY DESCRIBED BY LOREN REITER, LS 1762, ON JUNE 19, 2026 AS FOLLOWS:

BEGINNING AT THE SOUTHWEST CORNER OF LOT 107 ON THIRD STREET, ORIGINAL TOWN OF SALINA; THENCE ON THE NORTH RIGHT-OF-WAY LINE OF IRON STREET, N 89°30'25" W 79.09 FEET TO THE SOUTHEAST CORNER OF LOT 108 ON THIRD STREET; THENCE CONTINUING ON SAID NORTH RIGHT-OF-WAY LINE, N 89°36'33" W 121.08 FEET TO THE SOUTHWEST CORNER OF LOT 108 ON THIRD STREET; THENCE CONTINUING ON SAID RIGHT-OF-WAY LINE, N 89°30'51" W 61.71 FEET; THENCE CONTINUING ON SAID NORTH RIGHT-OF-WAY LINE, N 89°33'15" W 68.43 FEET TO THE SOUTHWEST CORNER OF LOT 107 ON FOURTH STREET, ORIGINAL TOWN OF SALINA; THENCE ON THE EAST RIGHT-OF-WAY LINE OF SAID FOURTH STREET, N 00°12'18" E 237.36 FEET TO THE SOUTHWEST CORNER OF A TRACT OF LAND DESCRIBED IN THE REGISTER OF DEEDS OFFICE OF SALINE COUNTY, KANSAS IN BOOK 1408, PAGE 253; THENCE ON THE SOUTH LINE OF SAID TRACT OF LAND, N 39°12'26" E 301.35 FEET; THENCE CONTINUING ON SAID SOUTH LINE, N 51°11'14" E 80.39 FEET TO THE SOUTHEAST CORNER OF SAID TRACT OF LAND, SAID POINT ALSO BEING ON THE WEST RIGHT-OF-WAY LINE OF THE VACATED THIRD STREET PER ORDINANCE 07-10378 IN SAID REGISTER OF DEEDS OFFICE; THENCE ON SAID WEST VACATED RIGHT-OF-WAY LINE, S 00°18'10" W 109.44 FEET TO A POINT ON THE APPARENT CENTERLINE OF THE OLD SMOKY HILL RIVER CHANNEL; THENCE ALONG SAID CENTERLINE ON A CURVE TO THE RIGHT HAVING A RADIUS OF 488.28 FEET, AN ARC LENGTH OF 280.39 FEET, AND WHOSE CHORD BEARS N 72°42'01" E 276.55 FEET TO A POINT OF CURVATURE; THENCE CONTINUING ALONG SAID CENTERLINE ON A CURVE TO THE RIGHT HAVING A RADIUS OF 4640.67 FEET, AN ARC LENGTH OF 66.38 FEET, AND WHOSE CHORD BEARS N 89°11'39" E 66.38 FEET TO A POINT ON THE WEST RIGHT-OF-WAY LINE OF SECOND STREET; THENCE ON SAID WEST RIGHT-OF-WAY LINE, S 00°09'42" W 51.20 FEET TO THE NORTHEAST CORNER OF A TRACT OF LAND DESCRIBED IN BOOK 1082, PAGE 62 OF SAID REGISTER OF DEEDS OFFICE SAID POINT ALSO BEING THE NORTHEAST CORNER OF LOT 92 ON SECOND STREET; THENCE ON THE NORTH LINE OF SAID LOT 92 AND THE PROLONGATION THEREOF, N 88°51'23" W 124.97 FEET TO THE ALLEY CENTERLINE; THENCE ON SAID CENTERLINE S 00°04'24" W 20.00 FEET TO THE PROLONGATION OF THE SOUTH LINE OF SAID TRACT OF LAND; THENCE ON SAID PROLONGATION AND SAID SOUTH LINE, S 88°51'23" E 124.94 FEET TO THE SOUTHEAST CORNER OF SAID TRACT OF LAND, SAID CORNER ALSO BEING ON SAID WEST RIGHT-OF-WAY LINE; THENCE ON SAID WEST RIGHT-OF-WAY LINE, S 00°09'42" W 180.03 FEET TO THE NORTHEAST CORNER OF LOT 100 ON SECOND STREET; THENCE ON THE NORTH LINE OF LOT 100 ON SECOND STREET AND THE EXTENSION THEREOF, N 88°54'00" W 129.66 FEET TO THE WEST LINE OF A PLATTED ALLEY; THENCE CONTINUING ON SAID WEST ALLEY LINE, S 00°04'20" W 100.03 FEET; THENCE ON SAID WEST ALLEY LINE, S 00°23'41" W 149.96 FEET TO THE SOUTHEAST CORNER OF A TRACT OF LAND DESCRIBED IN SAID REGISTER OF DEEDS OFFICE IN BOOK 1399, PAGE 969 SAID POINT ALSO BEING ON THE NORTH RIGHT-OF-WAY LINE OF SAID IRON STREET; THENCE ON SAID NORTH RIGHT-OF-WAY LINE, N 89°26'56" W 121.73 FEET TO THE POINT OF BEGINNING. ALL BEARINGS HEREIN ARE BASED ON AN ASSUMED BEARING OF N 89°36'33" W ON THE SOUTH LINE OF LOT 108 ON THIRD STREET, ORIGINAL TOWN OF SALINA, SALINE COUNTY, KANSAS. CONTAINS 5.06 ACRES, MORE OR LESS.

BASIS OF BEARINGS:

THE BASIS OF BEARINGS FOR THIS SURVEY IS AN ASSUMED BEARING OF N 89°36'33" W ON THE SOUTH LINE OF LOT 108 ON THIRD STREET, ORIGINAL TOWN OF SALINA, SALINE COUNTY, KANSAS.

PLAT NOTES:

- ALL MONUMENTS FOUND HAVE A KNOWN ORIGIN, UNLESS OTHERWISE NOTED.
- ALL DISTANCES WERE MEASURED IN THE FIELD UNLESS OTHERWISE NOTED.
- UNABLE TO SET, FALLS IN RIVER CHANNEL
- PER ORDINANCE #07-10378 RECORDED IN BOOK 1148, PAGE 1581 OF ALL THIRD STREET RIGHT-OF-WAY NORTH OF IRON TO THE SMOKY HILL RIVER HAS BEEN VACATED. HOWEVER, THE EAST 25.0 FEET OF THE VACATED RIGHT-OF-WAY IS RETAINED AS A PUBLIC UTILITY EASEMENT AND ALL OF THE REMAINING VACATED RIGHT-OF-WAY IS RETAINED AS A PUBLIC ACCESS AND MAINTENANCE EASEMENT. THE REMAINING 40 FOOT PUBLIC ACCESS EASEMENT TO BE VACATED WITH FINAL PLAT. NEW 50 FOOT ACCESS EASEMENT TO BE DEDICATED OVER EXISTING DRIVE WITH FINAL PLAT.

FLOOD STATEMENT:

THE ACCURACY OF ANY FLOOD HAZARD DATA SHOWN HEREON IS SUBJECT TO MAP SCALE UNCERTAINTY AND TO ANY OTHER UNCERTAINTY IN LOCATION OR ELEVATION ON THE REFERENCED FLOOD INSURANCE RATE MAP. THE SURVEY PARCEL LIES WITHIN OTHER AREAS OF FLOOD HAZARD ZONE "X" AND SPECIAL FLOOD HAZARD AREAS ZONE "AE" AS SAID PARCEL PLOTS BY SCALE ON THE FLOOD INSURANCE RATE MAP FOR THE CITY OF SALINA, COMMUNITY PANEL NO. 20169C0228C, EFFECTIVE ON 04/18/2018. THE BASE FLOOD ELEVATION FOR THIS SUBDIVISION IS 1216. VERTICAL DATUM: NAVD 1988

UNDERGROUND UTILITY STATEMENT:


WITH REGARD TO UNDERGROUND UTILITIES, INFORMATION FROM THE SOURCES LISTED HEREON WILL BE COMBINED WITH OBSERVED EVIDENCE OF UTILITIES TO DEVELOP A VIEW OF THE UNDERGROUND UTILITIES. HOWEVER, LACKING EXCAVATION, THE EXACT LOCATION OF UNDERGROUND FEATURES CANNOT BE ACCURATELY, COMPLETELY, AND RELIABLY DEPICTED. IN ADDITION, IN SOME JURISDICTIONS, 811 OR OTHER SIMILAR UTILITY LOCATE REQUESTS FROM SURVEYORS MAY BE IGNORED OR RESULT IN AN INCOMPLETE RESPONSE. WHERE ADDITIONAL OR MORE DETAILED INFORMATION IS REQUIRED, THE CLIENT IS ADVISED THAT EXCAVATION MAY BE NECESSARY. ONE CALL TICKET NUMBER 26099614.

BENCHMARKS:

VERTICAL DATUM IS NAVD88 DERIVED FROM S 279 (JF1029) ELEV=1229.36
BM #1: CHISELED "SQUARE" ON BACK OF CURB ON THE EAST END OF THE MEDIAN ON RIFFEL DRIVE EAST OF NINTH STREET. ELEV=1246.66
BM #2: THE SOUTHEAST CORNER OF AN AREA INLET LOCATED 357.8± WEST AND 6.7± NORTH FROM THE NORTHEAST CORNER OF THE SURVEYED PROPERTY. ELEV=1245.73

LEGEND

- MONUMENT FOUND
- 1/2" X 24" REBAR W/ "KVE CLS 20" CAP SET
- (D1) DESCRIBED DISTANCE PER BOOK 1408, PAGE 253
- (D2) DESCRIBED DISTANCE PER BOOK 1165, PAGE 242
- (D3) DESCRIBED DISTANCE PER BOOK 1399, PAGE 969
- (D4) DESCRIBED DISTANCE PER DEED BOOK 1082, PAGE 62
- (S1) SURVEYED DISTANCE PER CITY OF SALINA SURVEY FILED IN VOLUME 2, PAGE 115
- (S2) SURVEYED DISTANCE PER KAW VALLEY ENGINEERING PROJECT E21S3040, DATED DECEMBER 3, 2021
- (P) PLATTED DISTANCE, ORIGINAL TOWN OF SALINA
- (M) MEASURED BEARING AND DISTANCE
- (C) CALCULATED MEASUREMENT

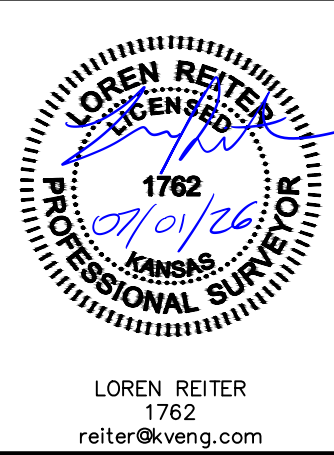

	1627 SUNFLOWER LANE SALINA, KANSAS 67401 PH. (785) 823-3400 sa@kveng.com www.kveng.com	PROJECT NO. E23S3468 DRAWN BY ABELL CHECKED BY LR C/FN 3468CS SHEET 1 OF 2
	PROJECT: SALINA COMMUNITY THEATRE 303 EAST IRON STREET SALINA, KANSAS 67401	PREPARED FOR: JGR ARCHITECTS, INC. 730 NORTH NINTH STREET SALINA, KANSAS 67401




KAW VALLEY ENGINEERING, INC. IS AUTHORIZED TO OFFER SURVEYING SERVICES BY KANSAS STATE CERTIFICATE OF AUTHORIZATION NO. LS-20. EXPIRES 12/31/26

CERTIFICATE OF SURVEY FOR

SALINA COMMUNITY THEATRE ADDITION

TO THE CITY OF SALINA, SALINE COUNTY, KANSAS

A REPLAT OF A PORTION OF LOTS 93, 95, 97, 99 AND ALL OF LOTS 101, 103, 105, AND 107 ON FOURTH STREET, A PORTION OF THE VACATED NORTH SOUTH ALLEY BETWEEN THIRD STREET AND FOURTH STREET, A PORTION OF LOTS 88, 90, 92, AND ALL OF LOTS 94, 96, 98, 100, 102, 104, 106, AND 108 ON THIRD STREET, A PORTION OF VACATED THIRD STREET, A PORTION OF LOT 87, AND ALL OF LOTS 89, 91, 93, 95, 97, 99, 101, 103, 105, AND 107 ON THIRD STREET, A PORTION OF THE NORTH SOUTH ALLEY BETWEEN SECOND AND THIRD STREET, A PORTION OF LOT 88, 92, AND ALL OF LOTS 90, 94, 96, AND 98 ON SECOND STREET, ORIGINAL TOWN OF SALINA, SALINE COUNTY, KANSAS

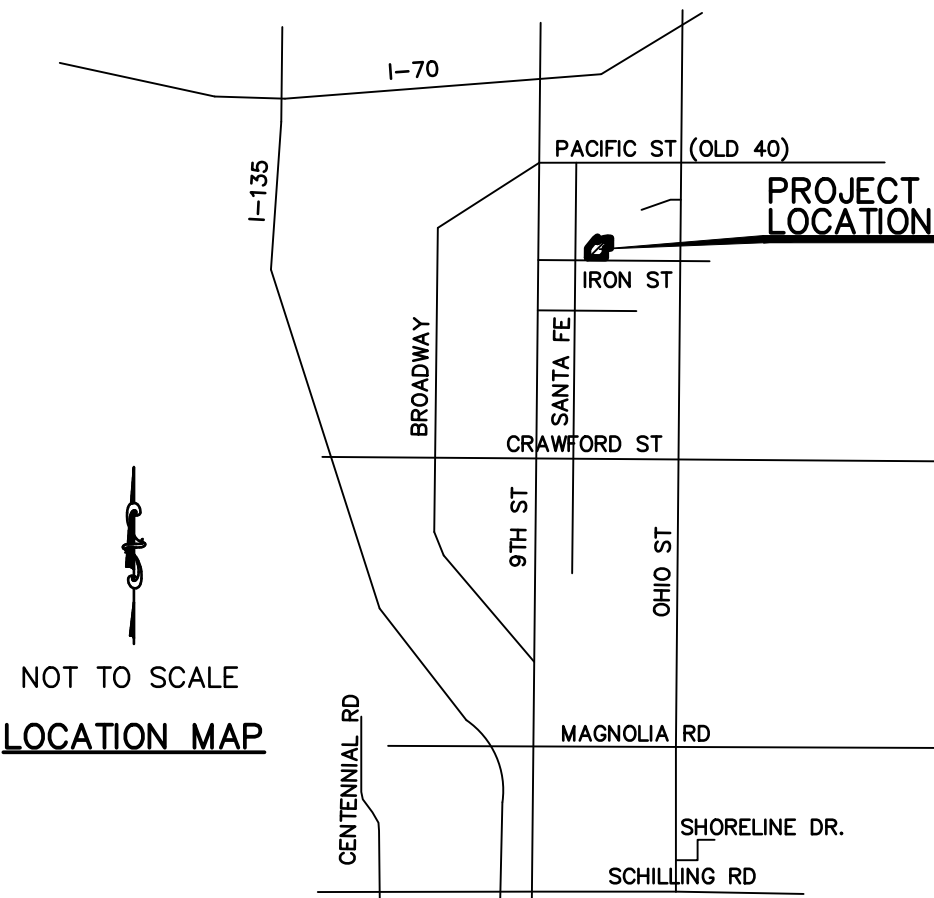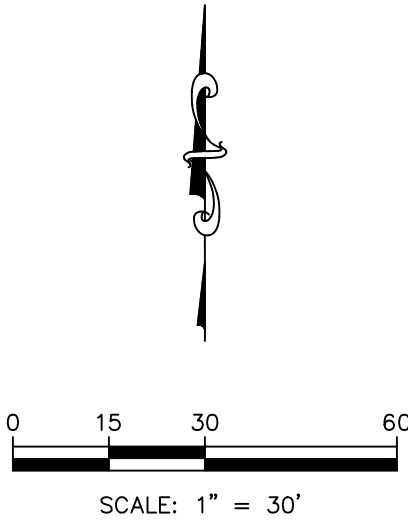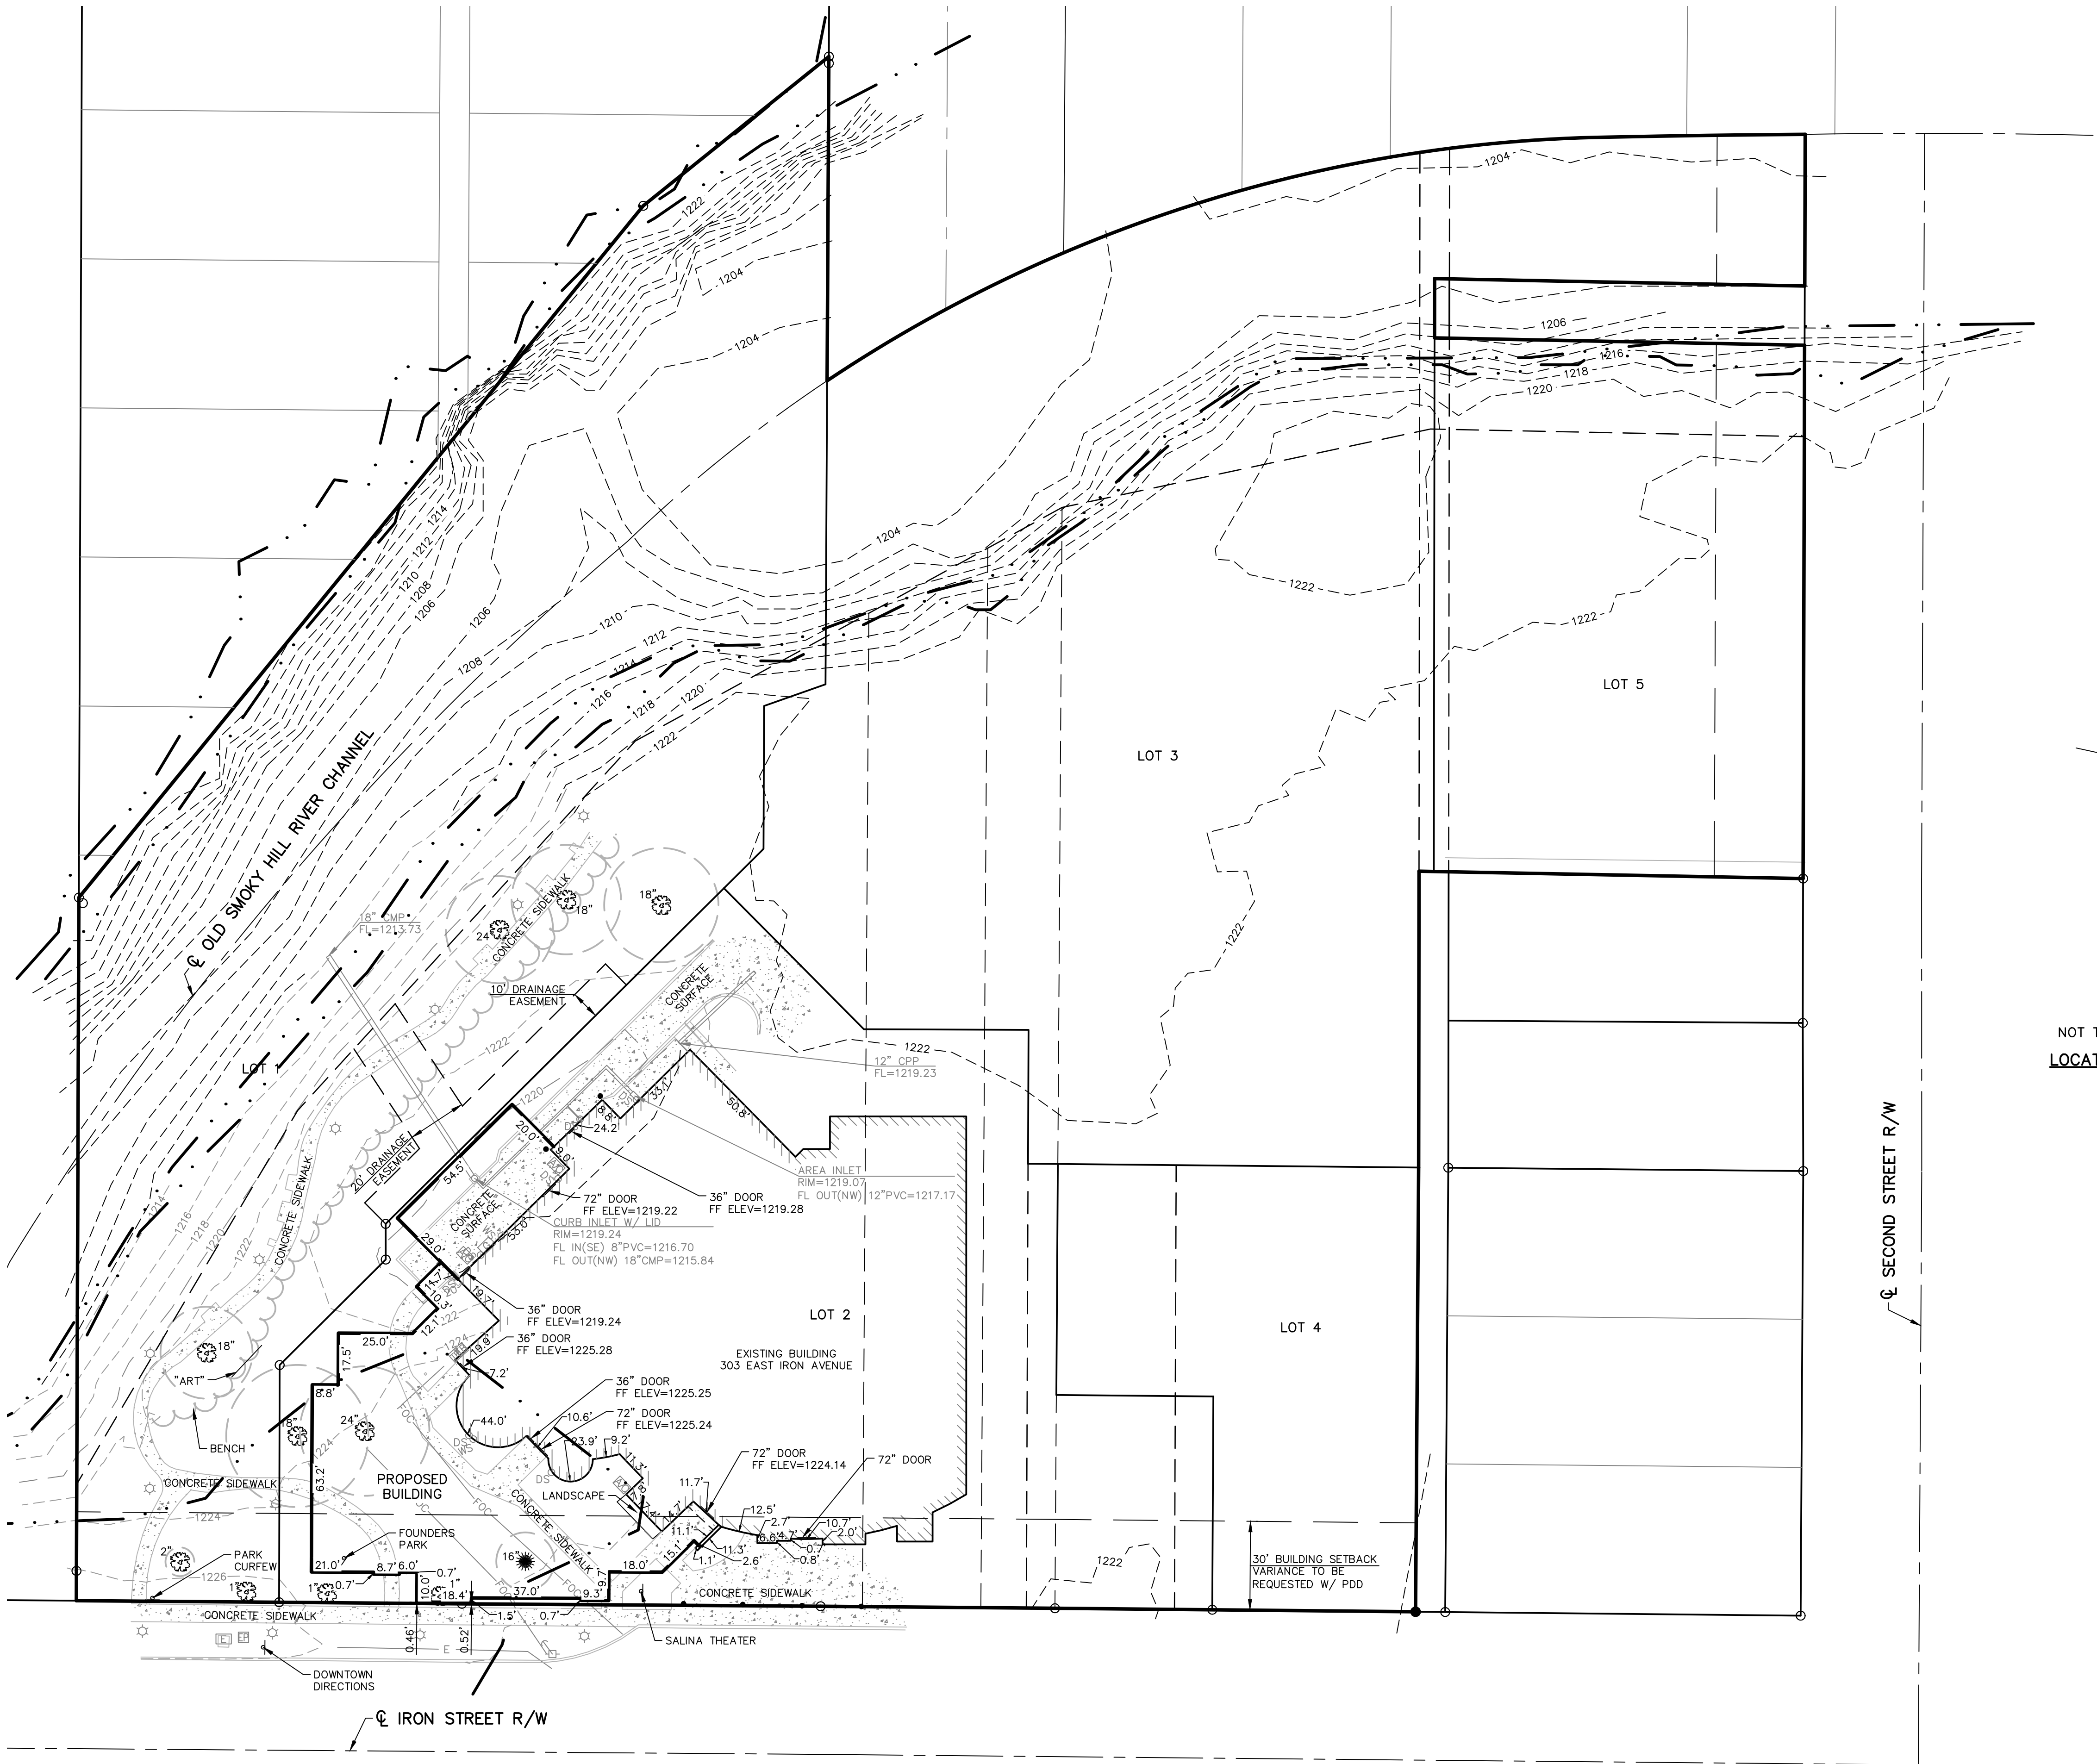


LEGEND	
○	MONUMENT FOUND
●	1/2" X 24" REBAR W/ "KVE CLS 20" CAP SET
⊠	UTILITY POLE
☆	LIGHT POLE
⊠	AIR CONDITIONING UNIT
⊠	ELECTRIC PEDESTAL
⊠	ELECTRIC METER
⊠	ELECTRIC BOX
—E—	UNDERGROUND ELECTRIC LINE
←	DEADMAN ANCHOR
⊠	GAS METER
WS	WATER SPIGOT
DS	DOWN SPOUT
⊠	TELEPHONE PEDESTAL
—FOC—	UNDERGROUND FIBER OPTIC CABLE
X 1213.75	SPOT ELEVATION AT GROUND/PAVEMENT
26.00 25.66	SPOT ELEVATION AT TOP AND FLOWLINE OF CURB (ADD 1200)
— 1220 —	2' CONTOUR INTERVAL (FROM SURVEY DATA)
- - - 1220 - - -	2' CONTOUR INTERVAL (FROM CITY OF SALINA DATA)
24"	DECIDUOUS TREE W/ SIZE & DRIP LINE
16"	EVERGREEN TREE W/ SIZE & DRIP LINE
~~~~~	TREE LINE
=====	BOUNDARY OF PLAT
=====	PROPERTY LINE
-----	INTERNAL LOT LINE
- - - - -	EASEMENT LINE
=====	BUILDING SETBACK LINE
-----	CENTERLINE
=====	FLOOD ZONE

**CERTIFICATION:**  
I, LOREN REITER, BEING A DULY LICENSED SURVEYOR UNDER THE LAWS OF KANSAS, HEREBY CERTIFY THAT THIS PLAT OR MAP IS A TRUE REPRESENTATION OF A SURVEY PERFORMED ON THE GROUND BY ME OR UNDER MY DIRECT SUPERVISION, IN ACCORDANCE WITH THE CURRENT KANSAS MINIMUM STANDARDS FOR BOUNDARY SURVEYS, AND IS CORRECT TO THE BEST OF MY BELIEF AND ABILITY.

DATE OF SURVEY: MAY 7, 2024

(AN ORIGINAL SEAL WITH SIGNATURE IN BLUE INK SIGNIFIES THE CERTIFICATION OF THE ENTIRE FACE OF THIS DOCUMENT AND ALL OF ITS CONTENT)

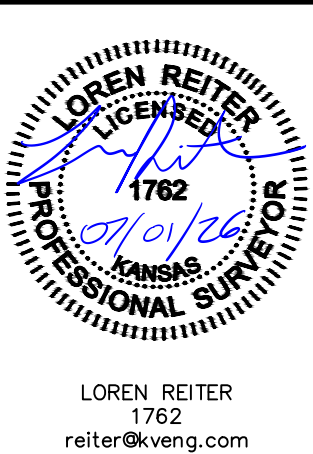

PROJECT: SALINA COMMUNITY THEATRE  
303 EAST IRON STREET  
SALINA, KANSAS 67401

PREPARED FOR: JGR ARCHITECTS, INC.  
730 NORTH NINTH STREET  
SALINA, KANSAS 67401


KAW VALLEY ENGINEERING, INC., IS AUTHORIZED TO OFFER SURVEYING SERVICES BY KANSAS STATE CERTIFICATE OF AUTHORIZATION NO. LS-20. EXPIRES 12/31/26

PROJECT NO. E23S3468  
DRAWN BY ABELL  
CHECKED BY LR  
CPN 3468CS  
SHEET 2 OF 2








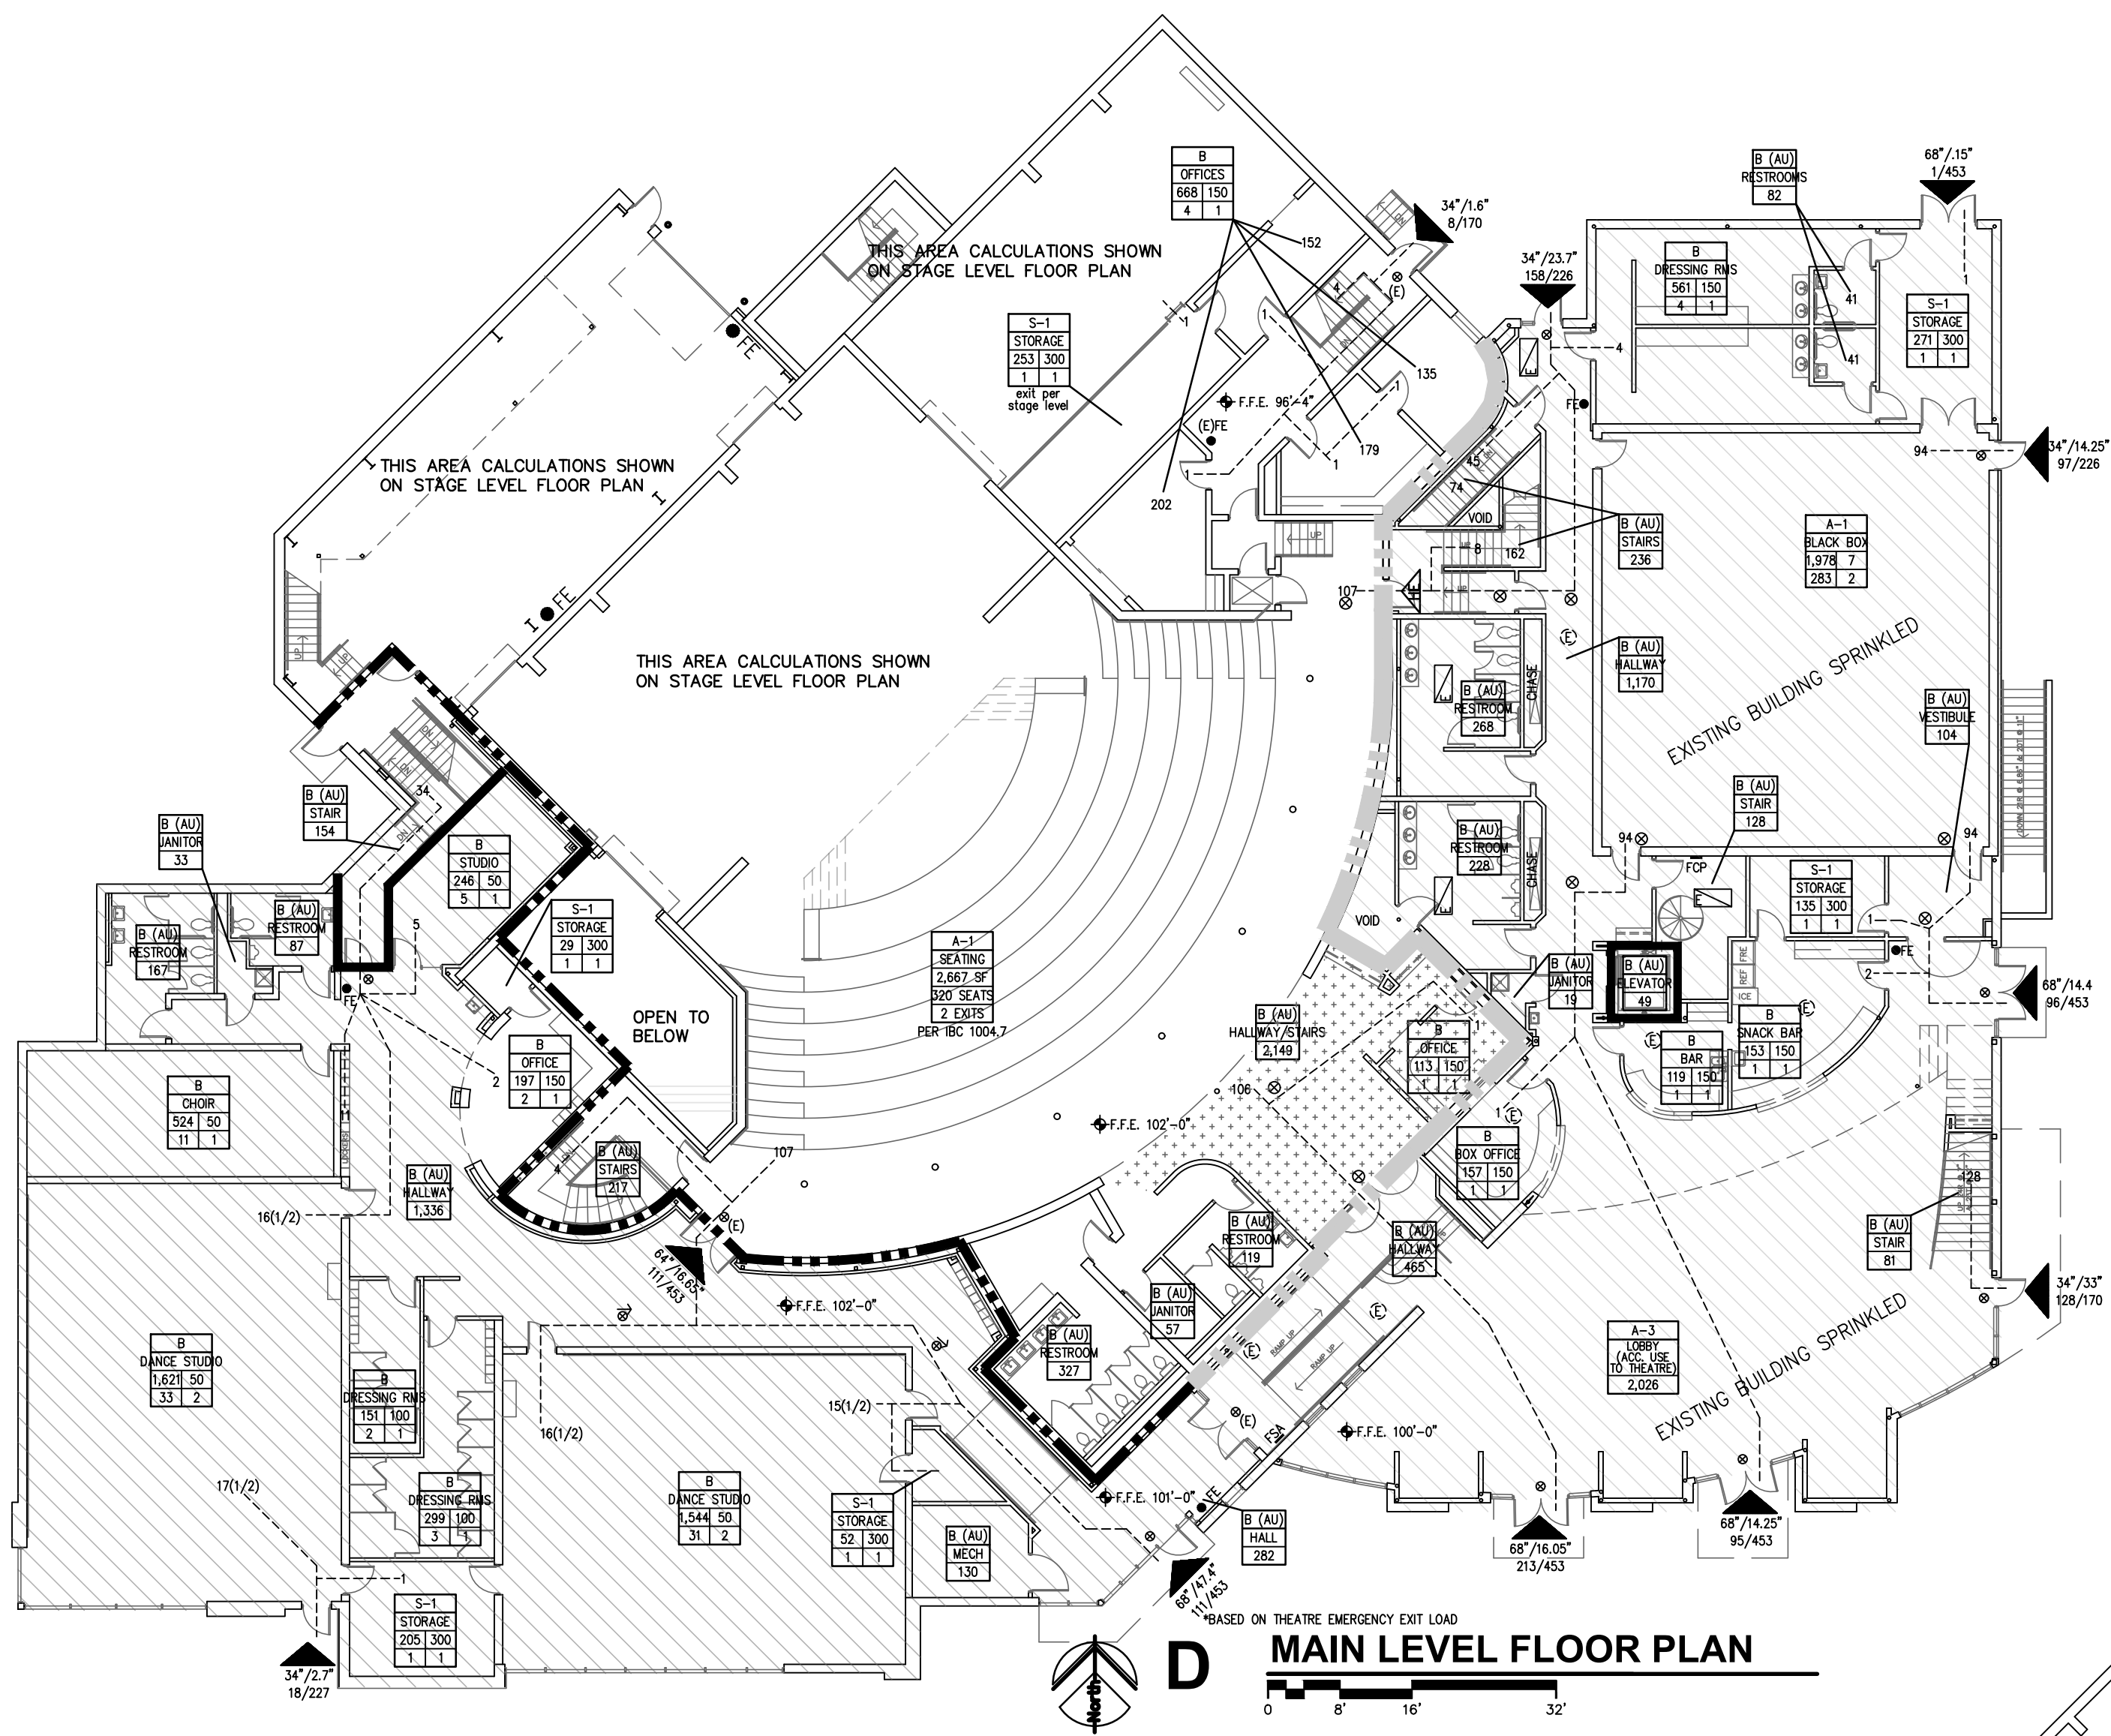

**D MAIN LEVEL FLOOR PLAN**

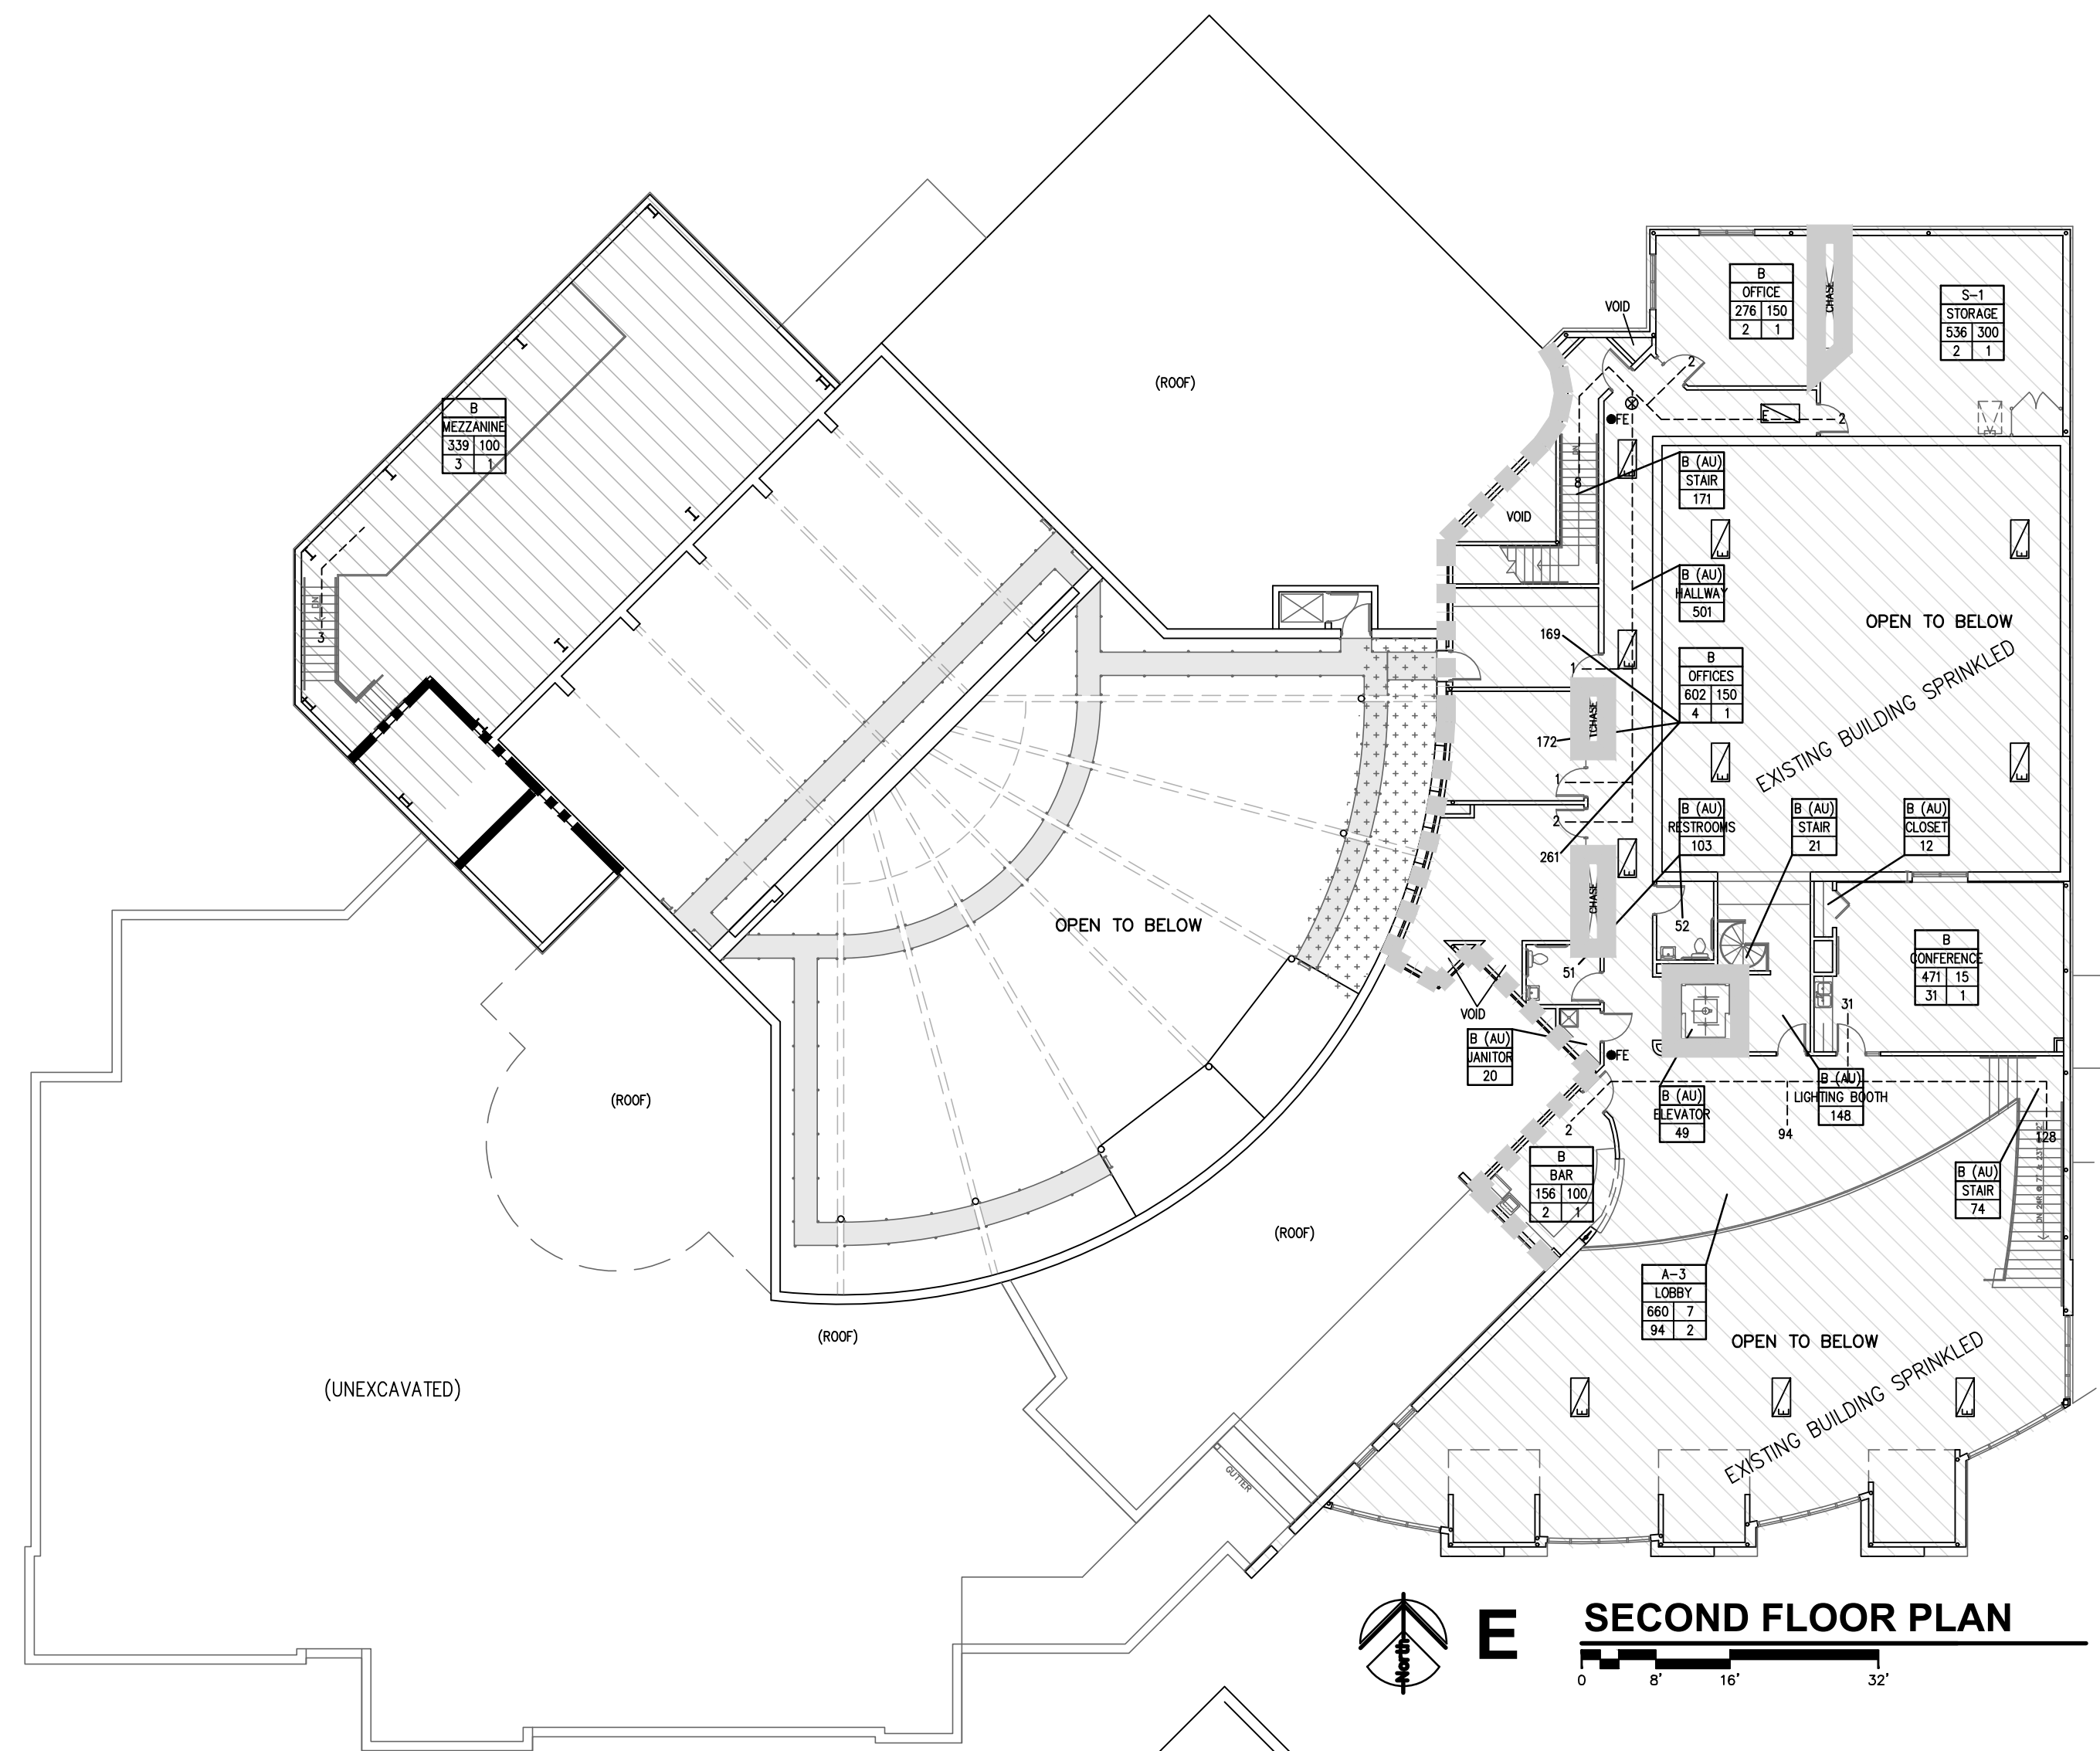

**E SECOND FLOOR PLAN**


## PROJECT INFORMATION

TYPE OF CONSTRUCTION	NEW CONSTRUCTION
FACILITY/OWNER NAME	SALINA COMMUNITY THEATRE
FACILITY/OWNER ADDRESS	303 E. IRON AVENUE SALINA, KS 67401
REASON FOR SUBMITTAL	NEW CONSTRUCTION
COUNTY	SALINE
FIRE DEPARTMENT	CITY OF SALINA
WATER SUPPLY	CITY OF SALINA
BUILDING INSPECTION DEPT	CITY OF SALINA
AUTHORITY HAVING JURISDICTION	CITY OF SALINA
ARCHITECT	JONES GILLAM RENZ ARCHITECTS 730 N. NINTH ST. SALINA, KS 67401 ph: 785-827-0386
CODES/REGULATIONS	2018 INTERNATIONAL BUILDING CODE 2018 UNIFORM MECHANICAL CODE 2018 UNIFORM PLUMBING CODE 2017 NATIONAL ELECTRIC CODE 2018 INTERNATIONAL FIRE CODE 2010 ADA STANDARDS for ACCESSIBLE DESIGN


## LEGEND

DESIGNATED EMERGENCY EXIT	66"/24.4" — EXIT WIDTH (ACTUAL/REQUIRED)
	122/340 — OCCUPANT LOAD (ACTUAL/ALLOWED)
HORIZONTAL EXIT	
0 HOUR CONSTRUCTION	
2HR RATED FIRE BARRIER	
90min PROTECTED OPENINGS	
1HR RATED SHAFT WALLS	
60min PROTECTED OPENINGS	
EXISTING 2HR RATED CONSTRUCTION	
90min PROTECTED OPENINGS	
EXISTING 2HR RATED WALL	
90min PROTECTED OPENINGS	
EXISTING 2HR RATED FIRE BARRIER	
90min PROTECTED OPENINGS	
EXISTING 1HR RATED SHAFT WALLS	
60min PROTECTED OPENINGS	
ADDITION TO EXISTING FACILITY TO RECEIVE	
AUTOMATIC FIRE SPRINKLER	
EXISTING AREA OF FACILITY WITH	
AUTOMATIC FIRE SPRINKLER	
EXIT LIGHT	FIRE HYDRANT
FIRE EXTINGUISHER	FIRE SYSTEM ANNUNCIATION PANEL
EMERGENCY LIGHTS	FIRE ALARM CONTROL PANEL

OCCUPANCY GROUP (AU - ACCESSORY USE)	A-1
OCCUPANCY USE	ASSEMBLY HALL
ROOM SQUARE FOOTAGE/OCCUPANT LOAD FACTOR	5,550 15
OCCUPANT LOAD/REQUIRED NUMBER OF EXITS	370 2

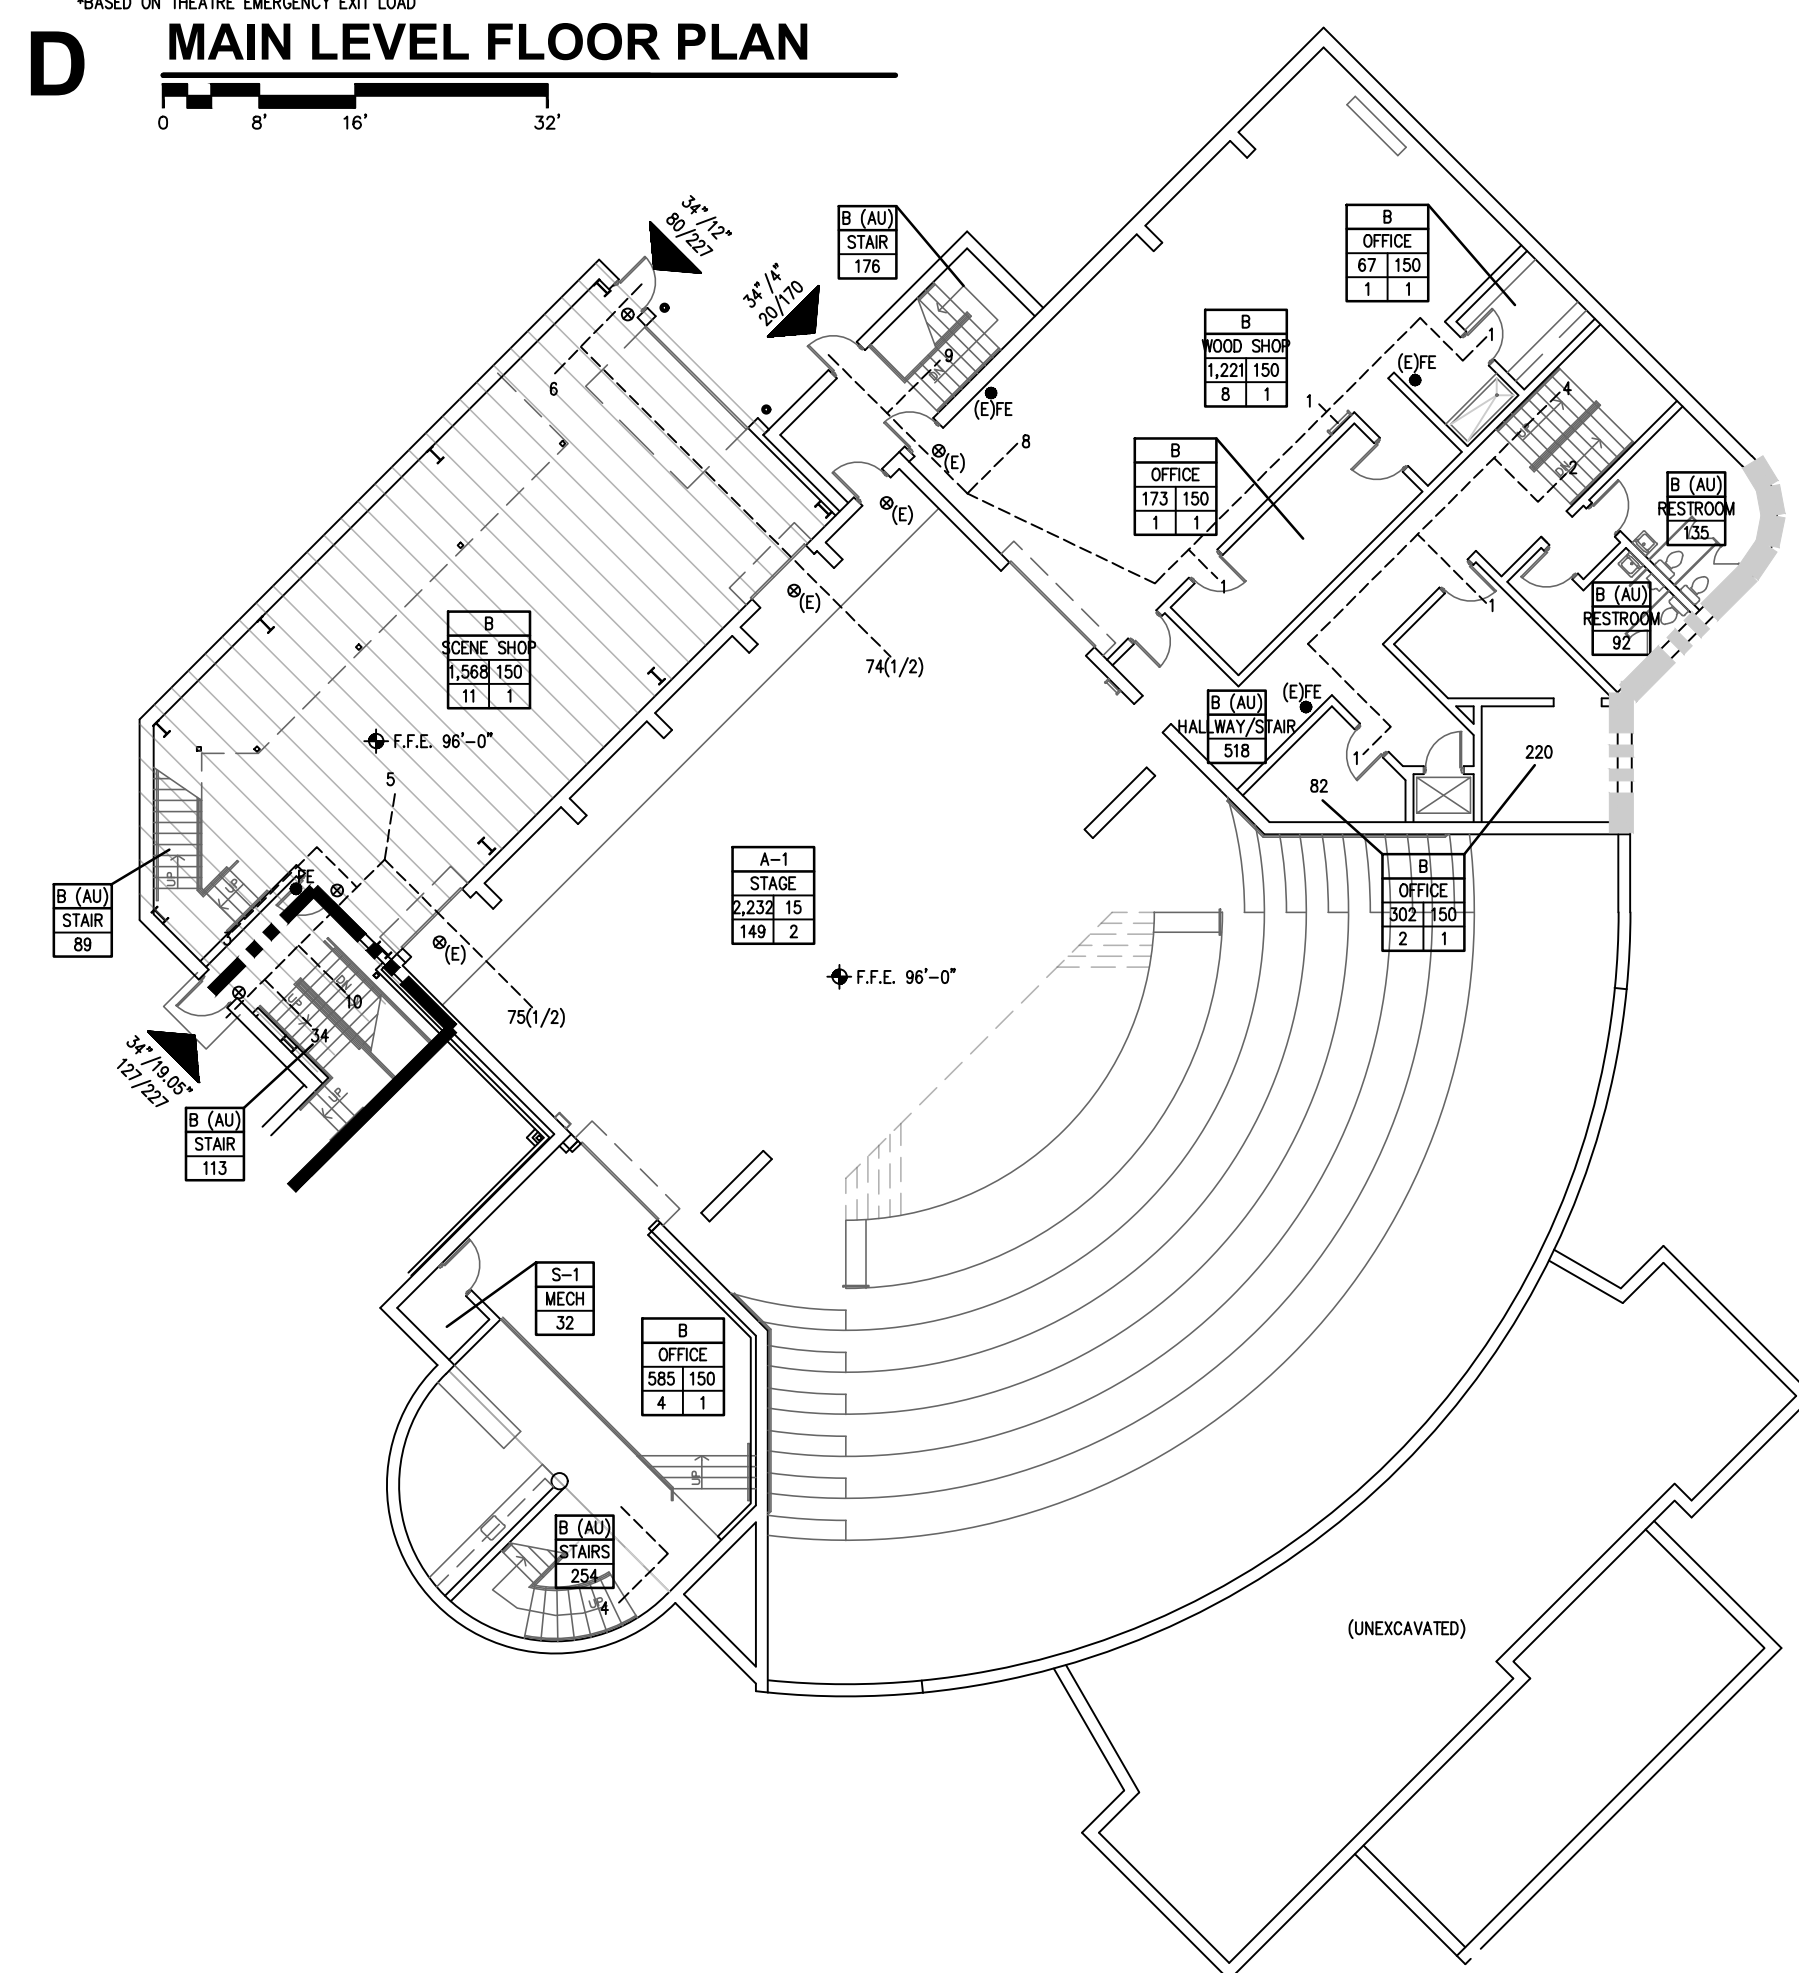


**C STAGE LEVEL FLOOR PLAN**

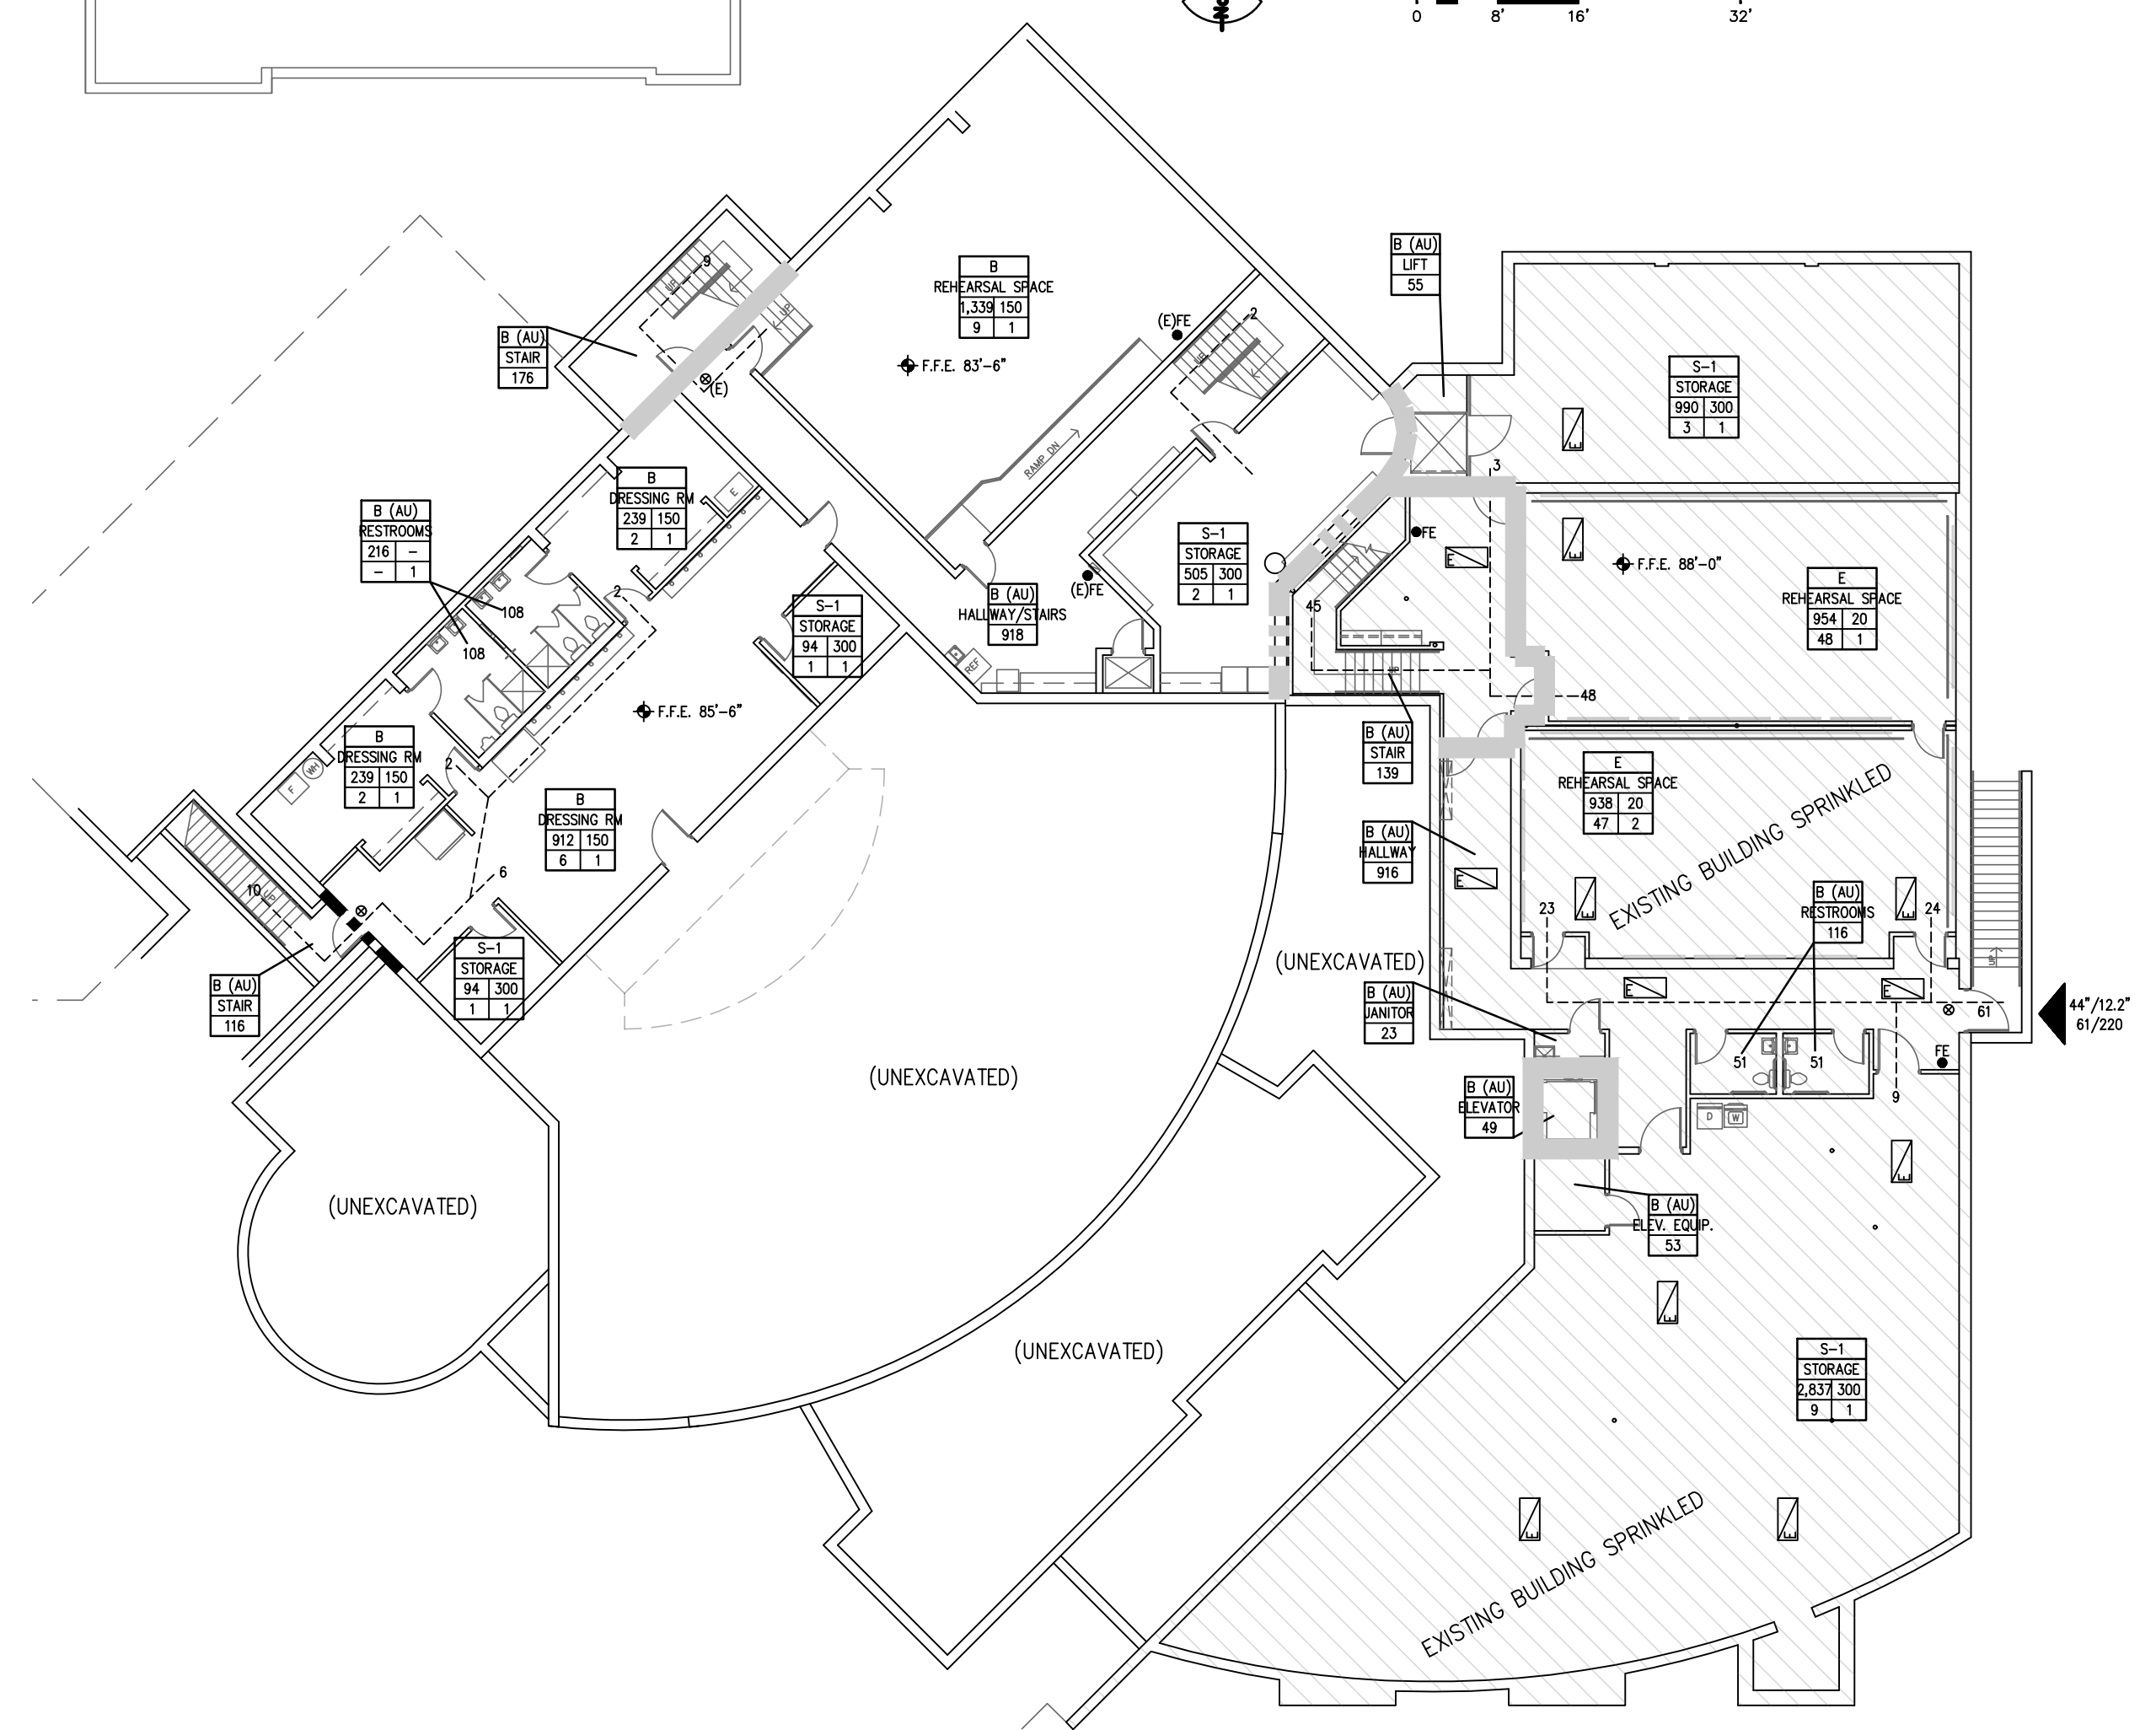


**B BASEMENT FLOOR PLAN**



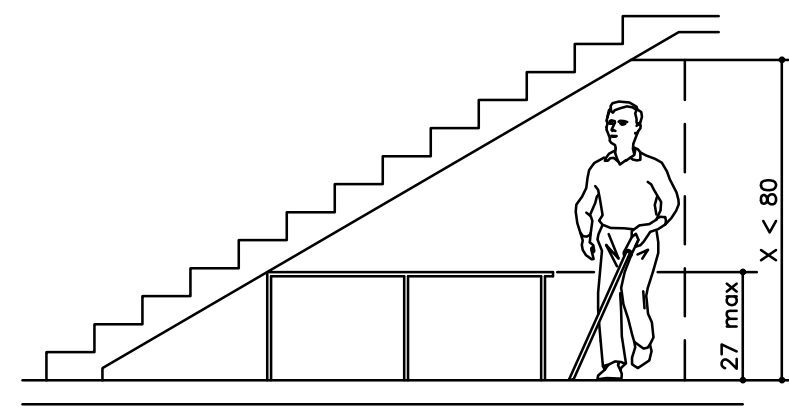


Vertical Clearance

**S STANDARD VERTICAL CLEARANCE**  
NO SCALE

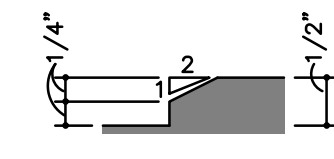


Beveled Change in Level

**P THRESHOLD ADA DIAGRAMS**  
NO SCALE

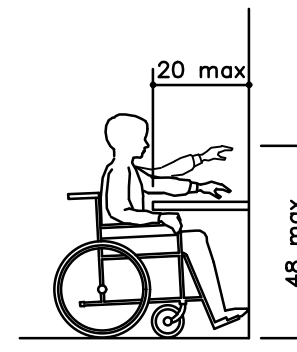


Obstructed High Forward Reach


**R STANDARD REACH ADA DIAGRAMS**  
NO SCALE

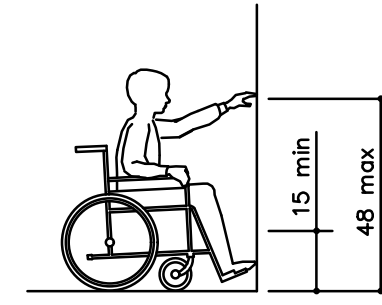


Unobstructed Forward Reach

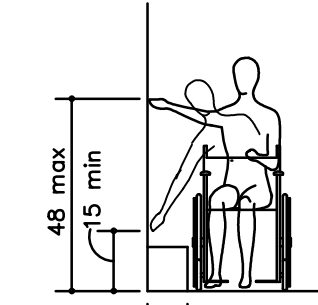


Unobstructed Side Reach

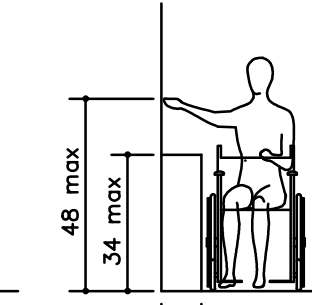


Obstructed High Side Reach

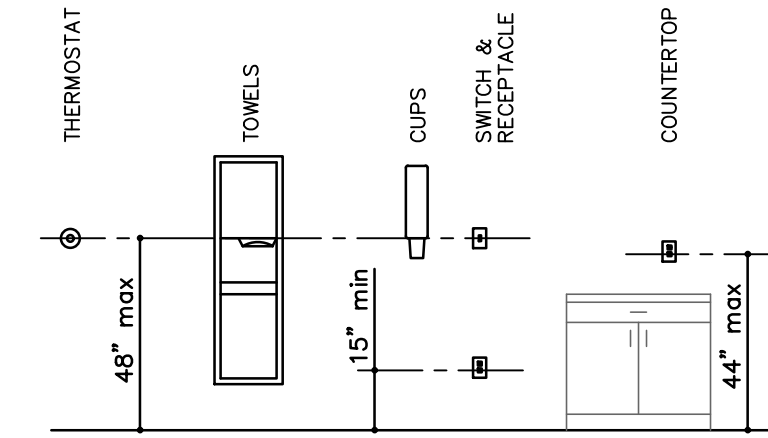

**Q STANDARD CONTROL REACH LIMITATIONS DETAILS**  
NO SCALE

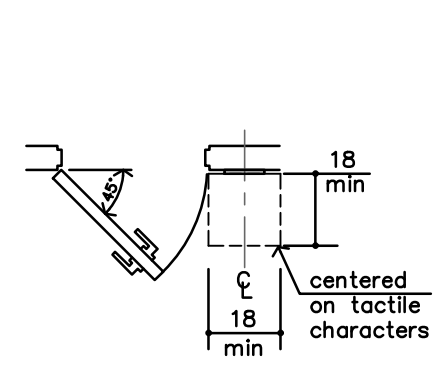


Location of Tactile Signs at Doors

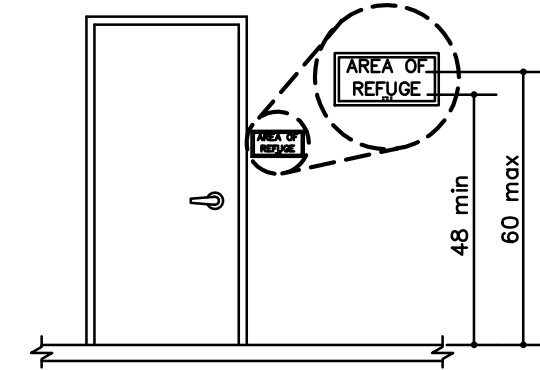


Height of Tactile Signs above Finish Floors


**F TACTILE SIGN DIAGRAM**  
NO SCALE

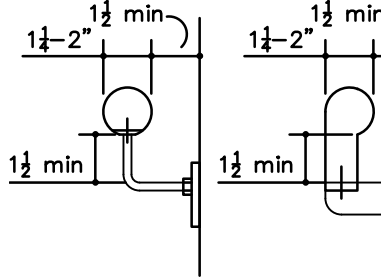


Handrail

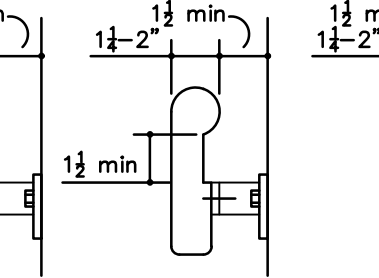

Handrail

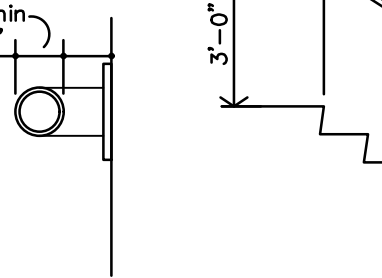


Handrail

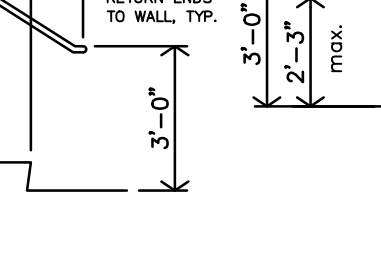


Grab Bar


**K STANDARD HANDRAIL/GRAB BAR DETAILS**  
NO SCALE

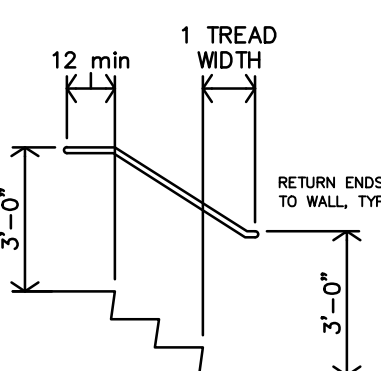


Stair Handrail Extensions at Walls

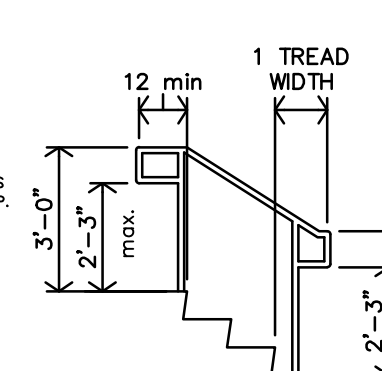

Stair Handrail Extensions at Freestanding Handrails

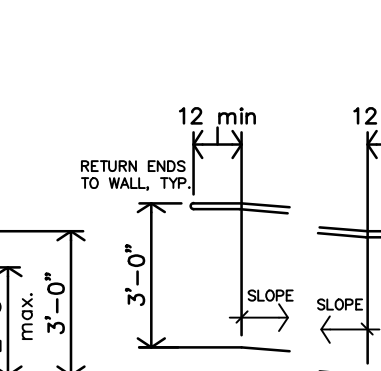


Ramp Handrail Extensions at Walls

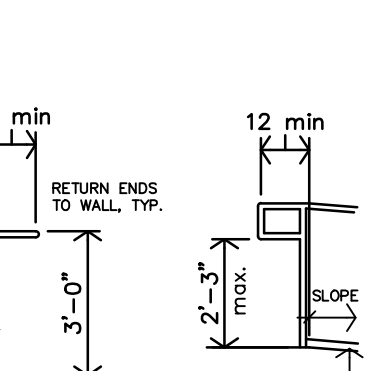


Ramp Handrail Extensions at Freestanding Handrails

**M STANDARD RAMP/STAIR HANDRAIL EXTENSIONS**  
NO SCALE

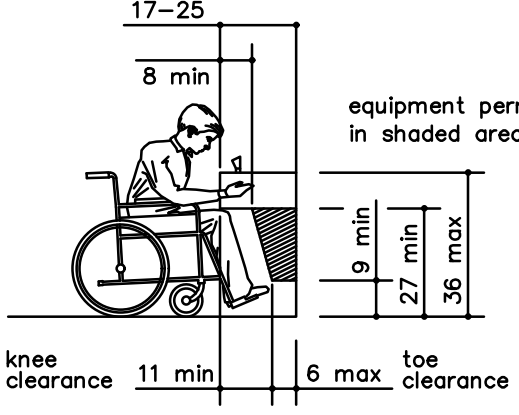


Toe and Knee Clearance Elevation


**J STANDARD DRINKING FOUNTAIN DETAILS**  
NO SCALE

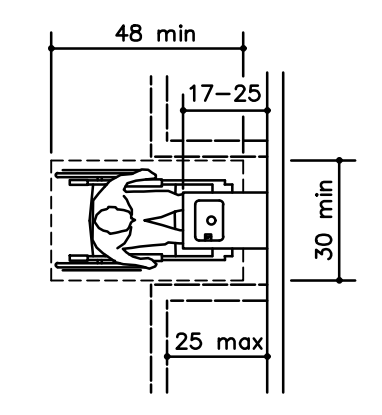


Toe and Knee Clearance Plan

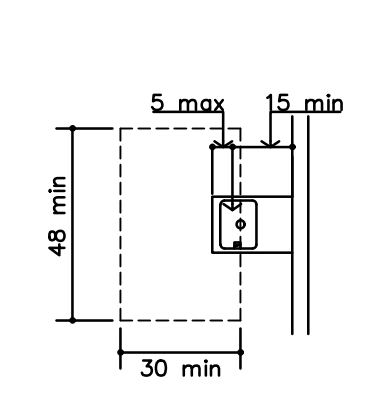

Drinking Fountain Spout Location

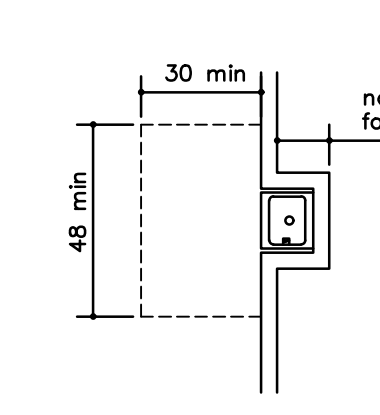


Built-in Fountain or Cooler

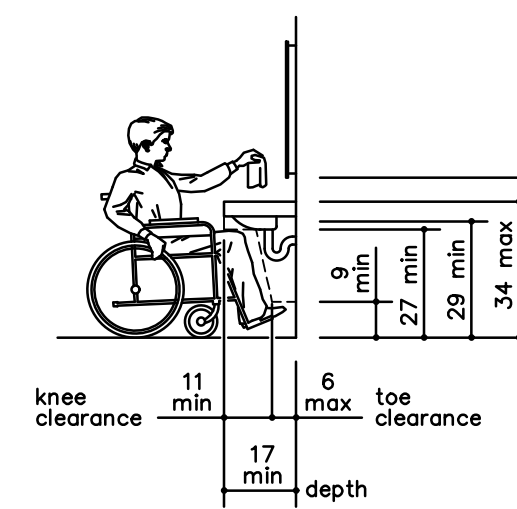


Lavatory Clearances


**H STANDARD LAVATORY DETAILS**  
NO SCALE

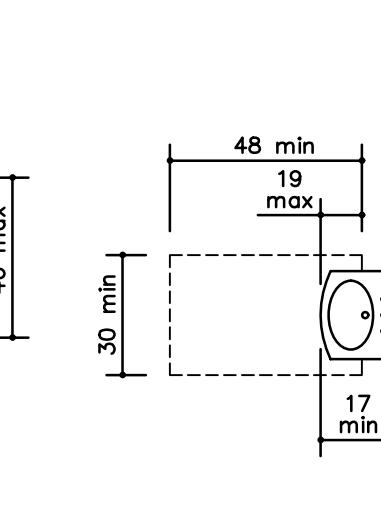


Clear Floor Space at Lavatories

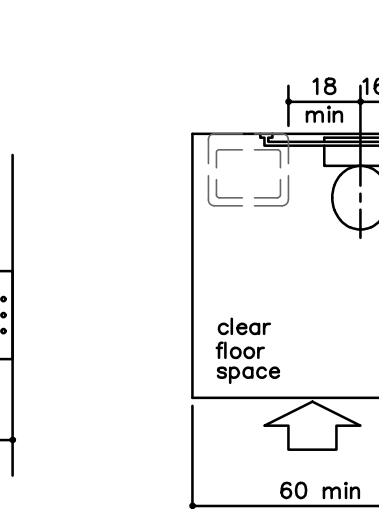


Overlap of Water Closet Clearance in Residential Dwelling Units (Exception)

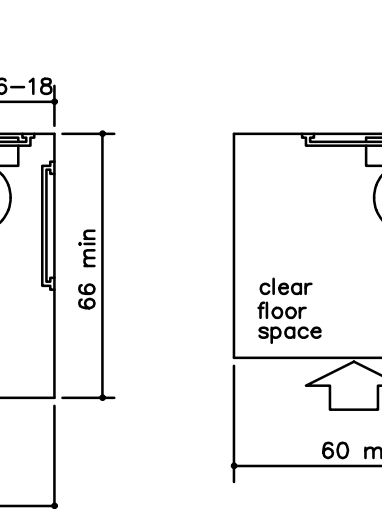

Clear Floor Space at Water Closet

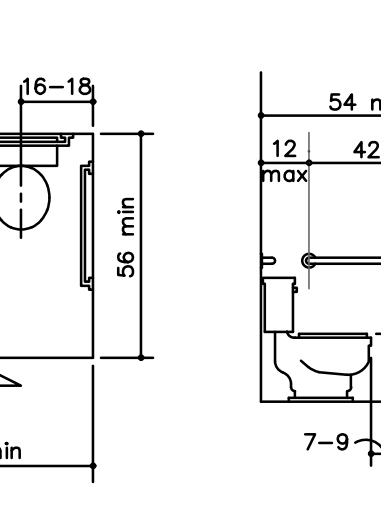


Grab Bars at Water Closets

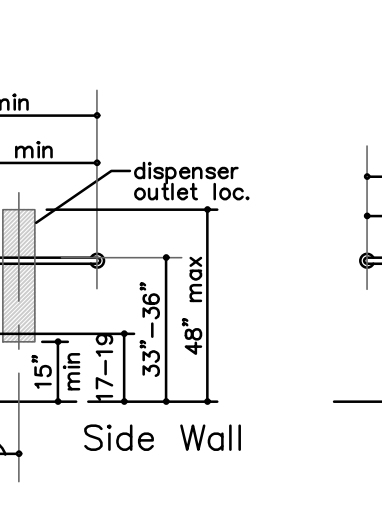


Back Wall of Standard Stall

**D STANDARD TOILET ADA DIAGRAMS**  
NO SCALE

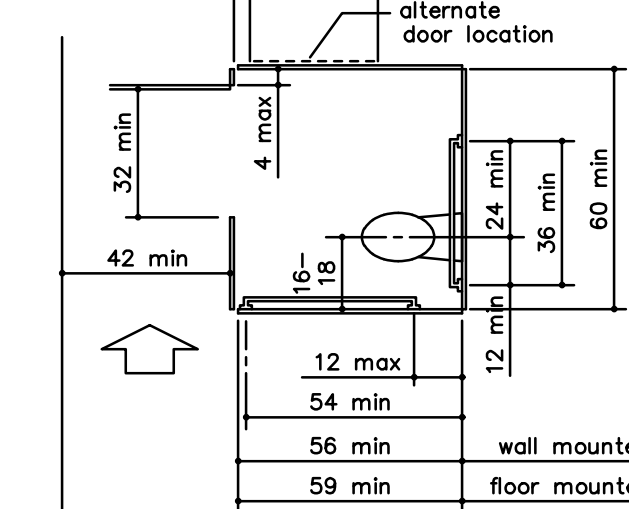


Wheelchair Accessible Toilet Compartment

**B STANDARD TOILET STALL ADA DIAGRAMS**  
NO SCALE

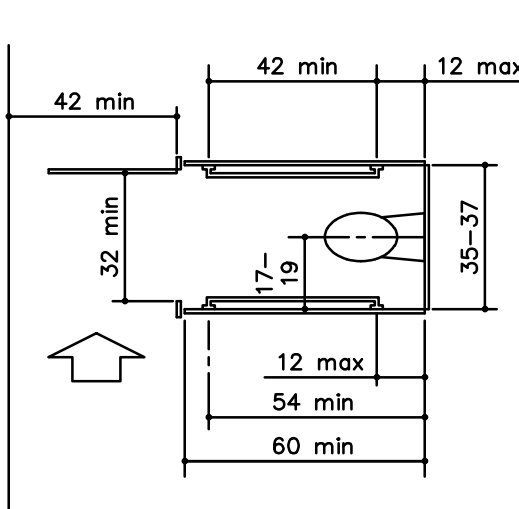


Ambulatory Accessible Toilet Compartment

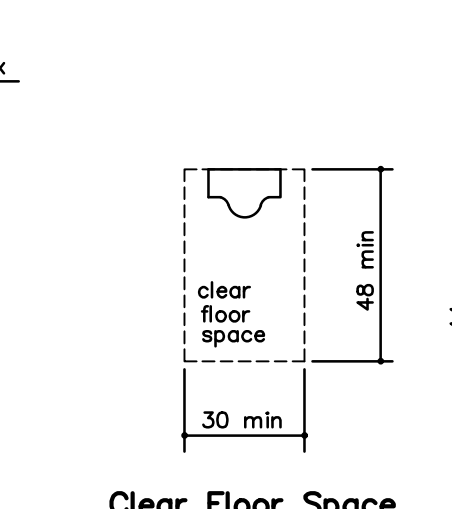


Clear Floor Space at Urinal


**C STANDARD URINAL ADA DIAGRAMS**  
NO SCALE

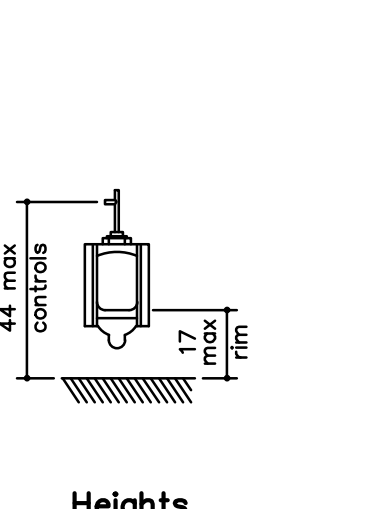


Heights at Urinal

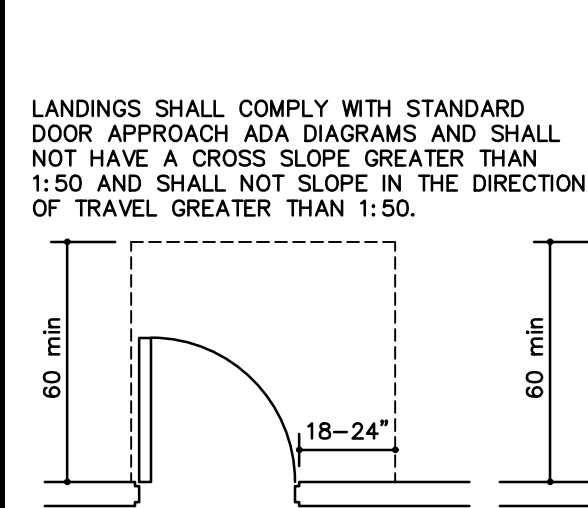


Exterior Landing

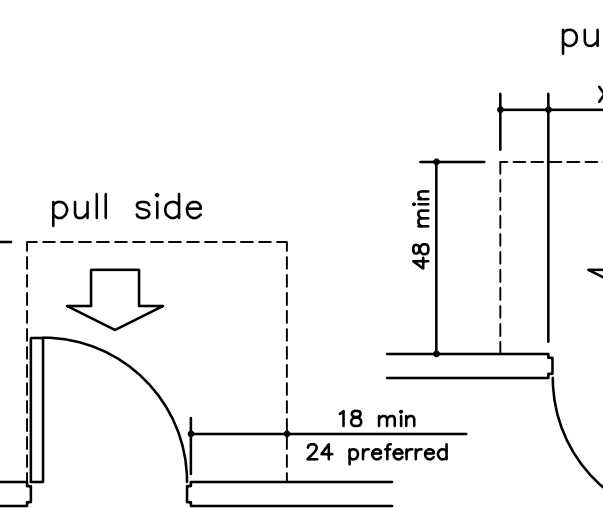


Front Approach - Swinging Door

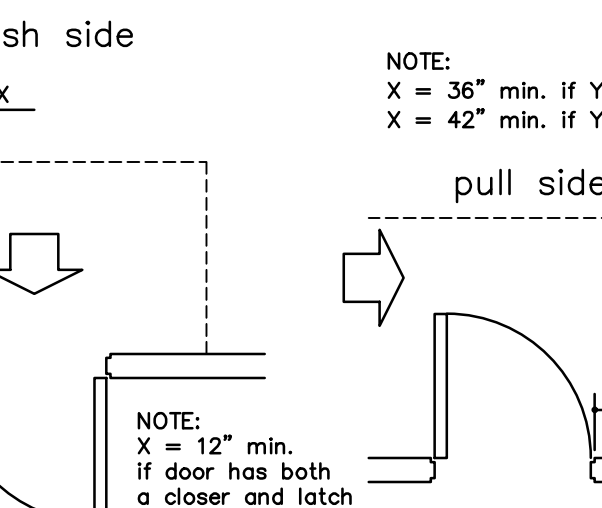


Front Approach - Swinging Door

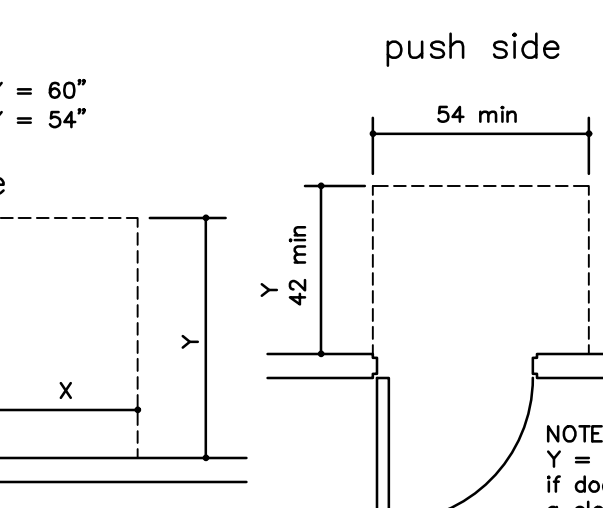


Hinge Side Approach - Swinging Door

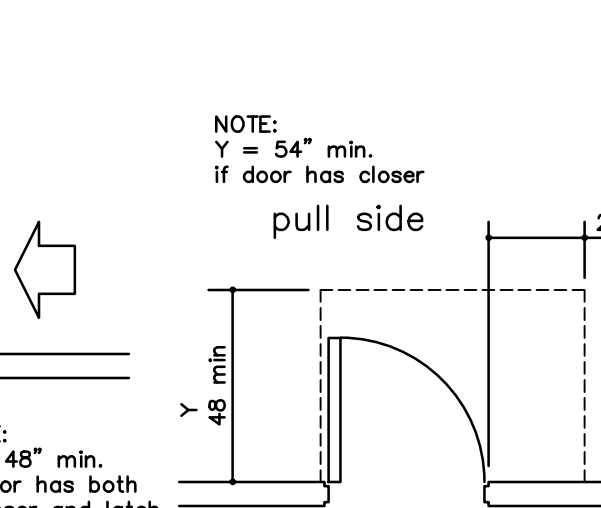


Side Approach - Swinging Door

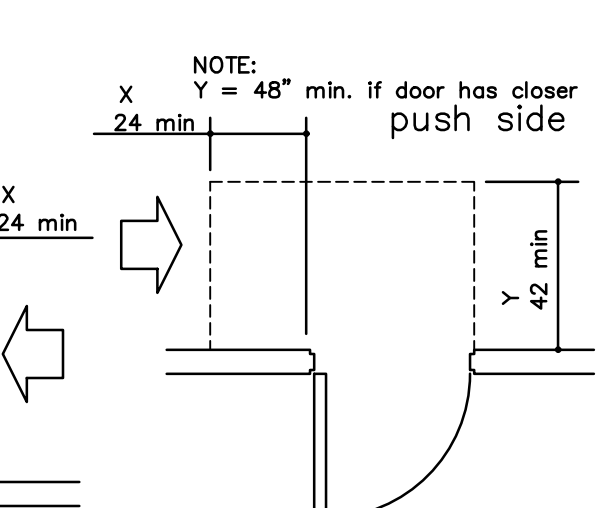


Latch Side Approach - Swinging Door

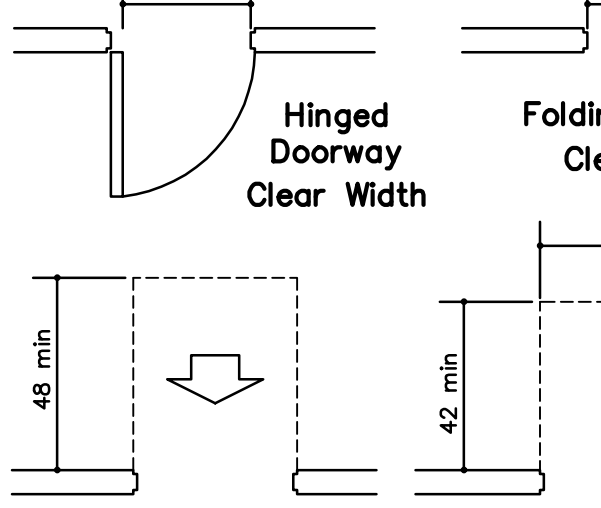


Latch Side Approach - Swinging Door

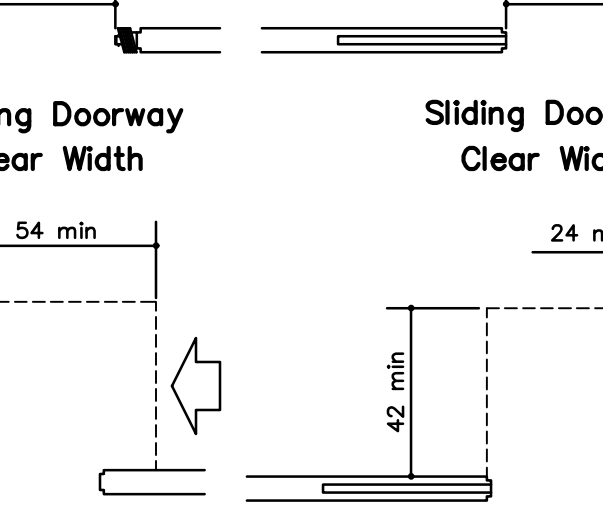

Front Approach - Sliding or Folding Doors

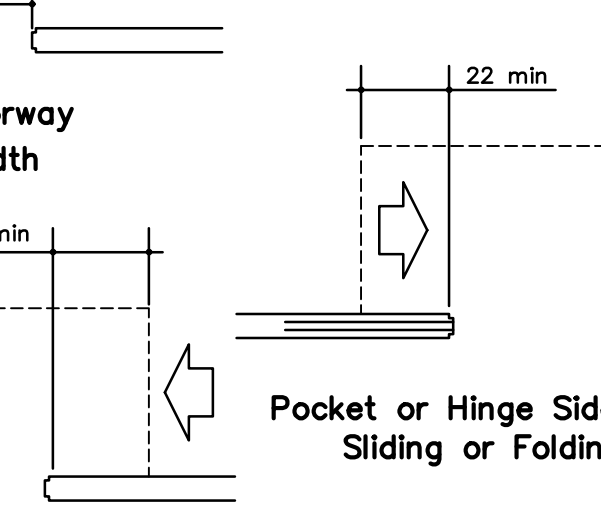


Side Approach - Sliding or Folding Doors

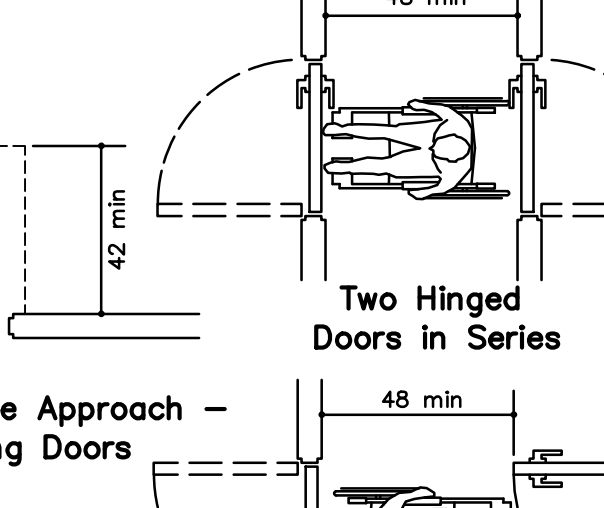


Stop or Latch Side Approach - Sliding or Folding Doors


**G STANDARD DOOR APPROACH ADA DIAGRAMS**  
NO SCALE

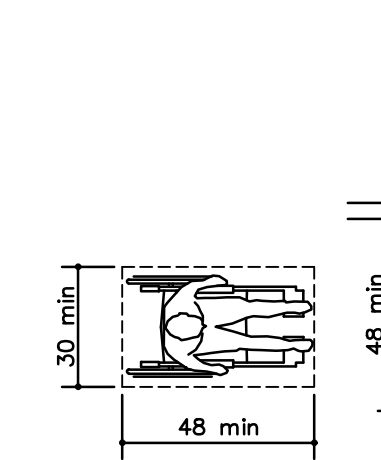


Clear Floor or Ground Space

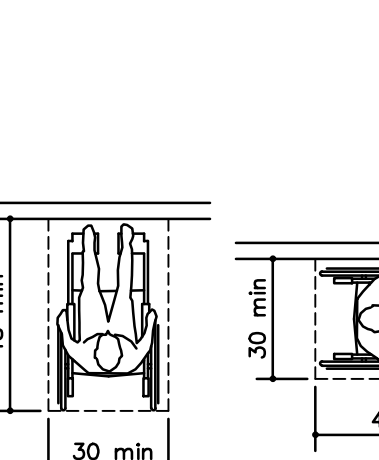


(a) Forward Approach

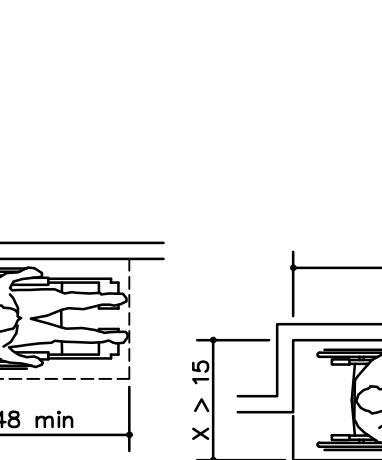


(b) Parallel Approach

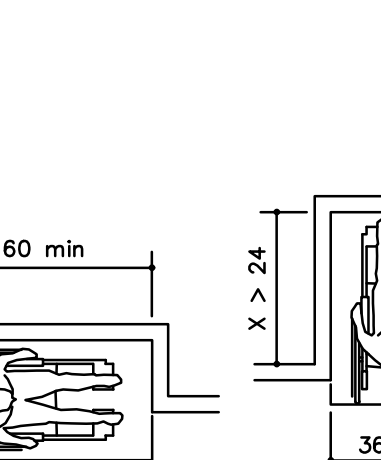

Maneuvering Clearance in an Alcove, Parallel Approach

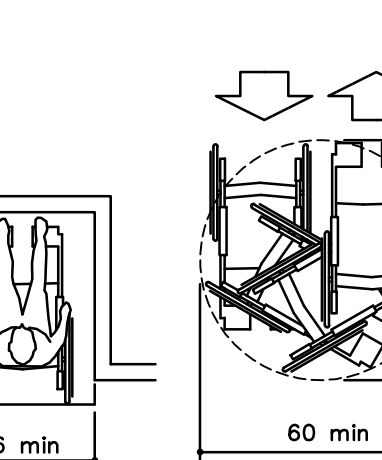


Maneuvering Clearance in an Alcove, Forward Approach

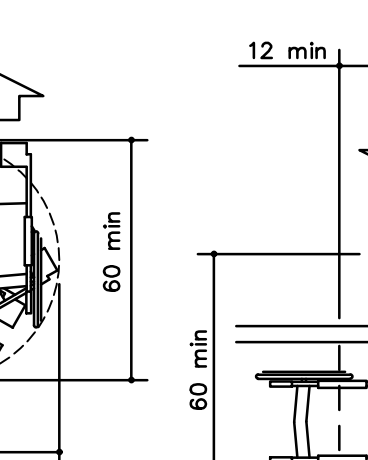


Wheelchair Turning Space


**A STANDARD ADA DIAGRAMS**  
NO SCALE

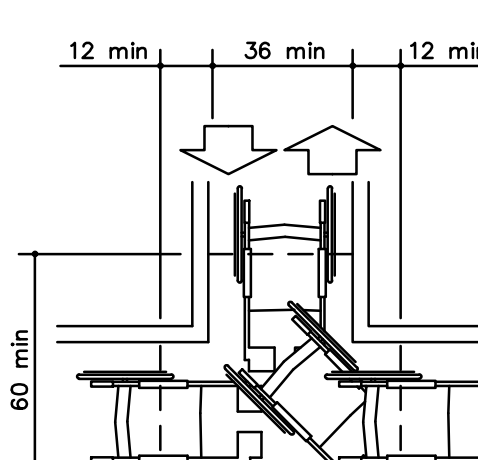

T-Shaped Space for 180° Turns

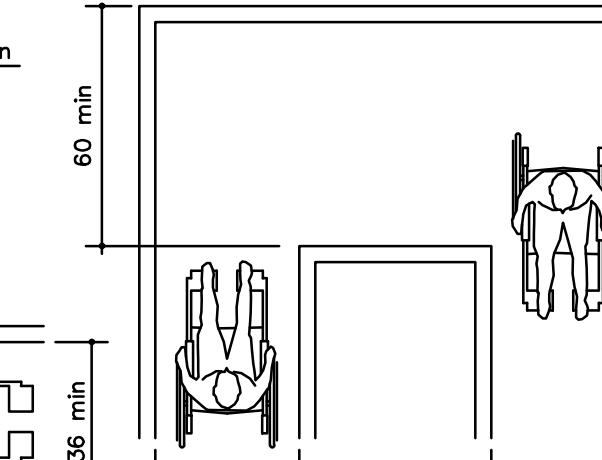


180° Turn Exception

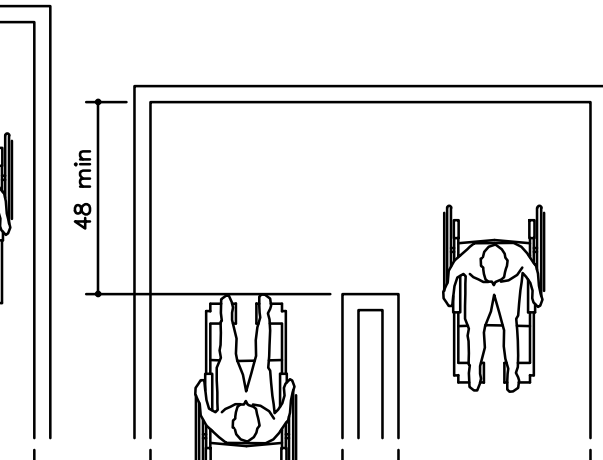

180° Turn


FOR REFERENCE ONLY



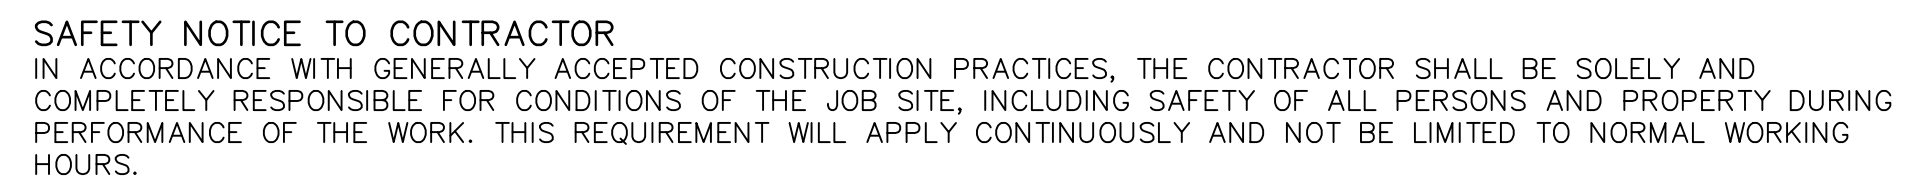

<b>SALINA COMMUNITY THEATRE</b> <b>303 EAST IRON AVENUE</b> <b>SALINA, KANSAS 67401</b>		PROJ. NO. <b>E2303468</b>	
		DESIGNER <b>MJR</b>	DRAWN BY <b>TDA</b>
CFN <b>3468DEMO</b>		M/JR TDA	
SHEET <b>C01</b>		REV <b>0</b>	
<b>CIVIL PLANS</b> <b>DEMOLITION PLAN</b>		09/18/26	
1627 SUNFLOWER LANE SALINA, KANSAS 67401 PH: (785) 823-3460 so@kvweng.com   www.kvweng.com		29241 9/18/26	
 <b>KAW VALLEY ENGINEERING</b> KAW VALLEY ENGINEERING, INC. IS AUTHORIZED TO OFFER ENGINEERING SERVICES BY KANSAS STATE CERTIFICATE OF AUTHORIZATION # E-113. EXPIRES 12/31/26		09/18/26	
MATTHEW J. ROWE ENGINEER KS # 29241		INITIAL ISSUE	
0		REV DATE DESCRIPTION	
0		M/JR TDA	
0		DSN DWN CHK	



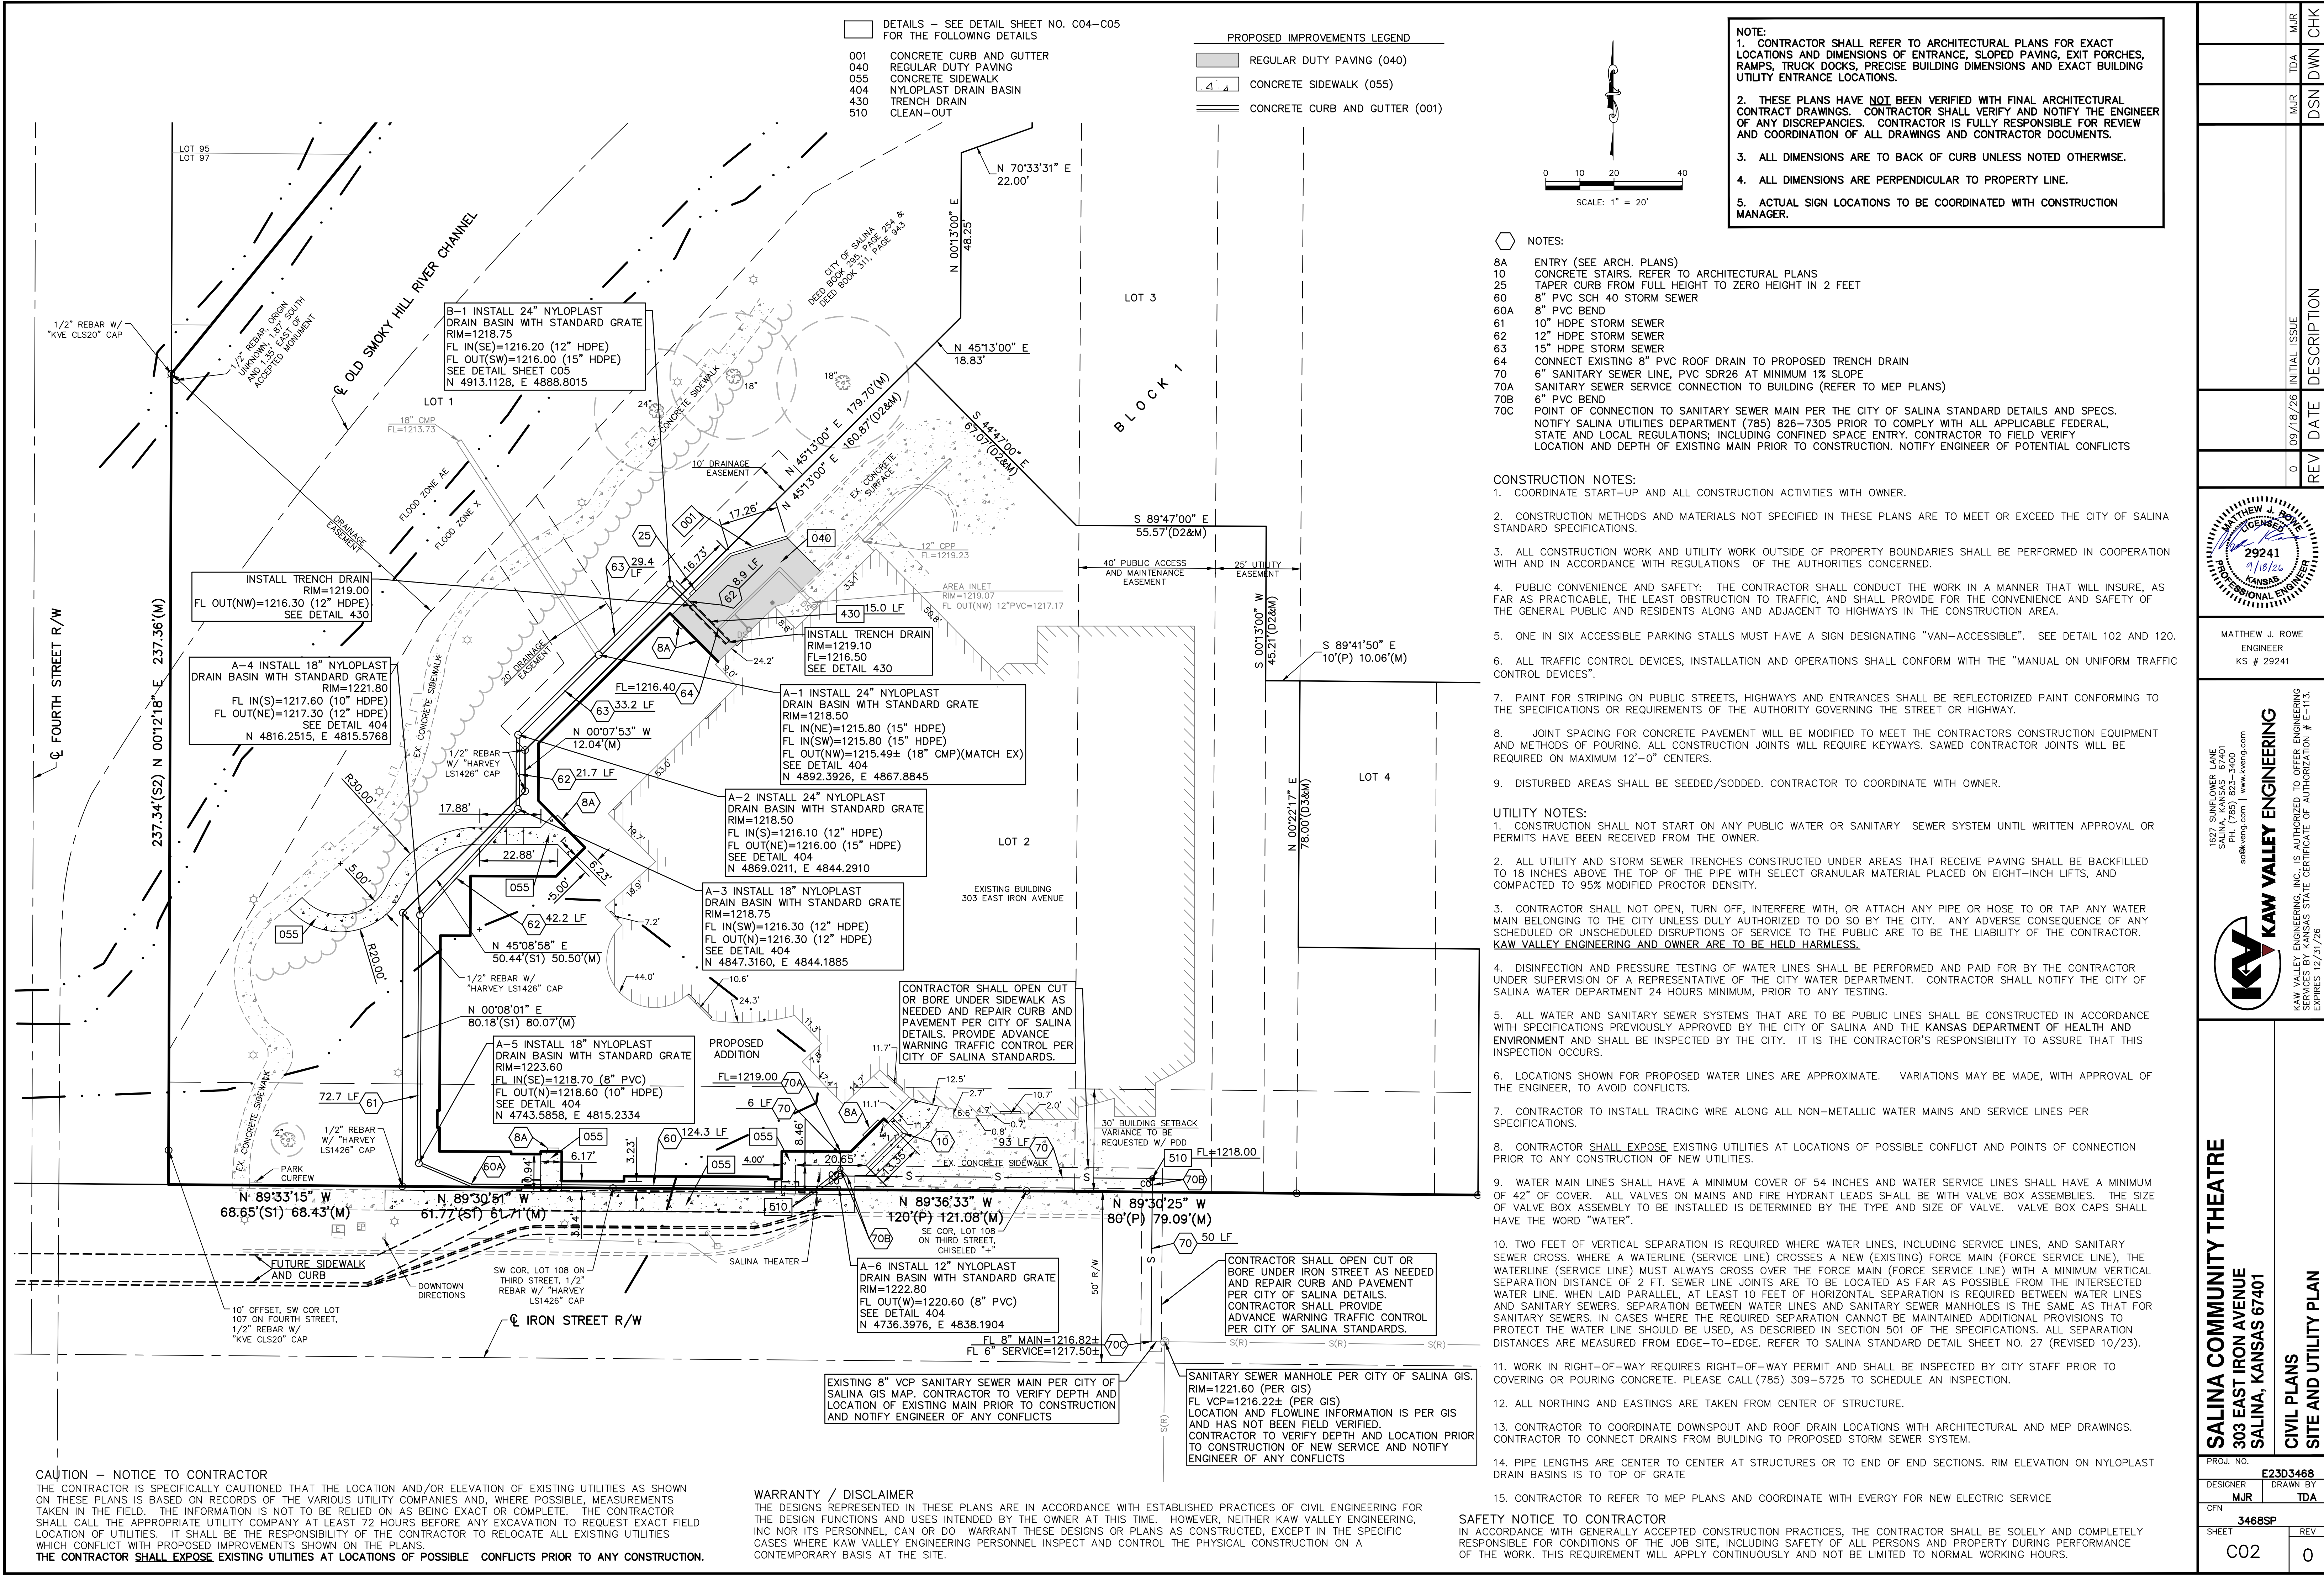

**CAUTION – NOTICE TO CONTRACTOR**  
THE CONTRACTOR IS SPECIFICALLY CAUTIONED THAT THE LOCATION AND/OR ELEVATION OF EXISTING UTILITIES AS SHOWN ON THESE PLANS IS BASED ON RECORDS OF THE VARIOUS UTILITY COMPANIES AND, WHERE POSSIBLE, MEASUREMENTS TAKEN IN THE FIELD. THE INFORMATION IS NOT TO BE RELIED ON AS BEING EXACT OR COMPLETE. THE CONTRACTOR SHALL CALL THE APPROPRIATE UTILITY COMPANY AT LEAST 72 HOURS BEFORE ANY EXCAVATION TO REQUEST EXACT FIELD LOCATION OF UTILITIES. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO RELOCATE ALL EXISTING UTILITIES WHICH CONFLICT WITH PROPOSED IMPROVEMENTS SHOWN ON THE PLANS.  
**THE CONTRACTOR SHALL EXPOSE EXISTING UTILITIES AT LOCATIONS OF POSSIBLE CONFLICTS PRIOR TO ANY CONSTRUCTION.**

**WARRANTY / DISCLAIMER**  
THE DESIGNS REPRESENTED IN THESE PLANS ARE IN ACCORDANCE WITH ESTABLISHED PRACTICES OF CIVIL ENGINEERING FOR THE DESIGN FUNCTIONS AND USES INTENDED BY THE OWNER AT THIS TIME. HOWEVER, NEITHER KAW VALLEY ENGINEERING, INC NOR ITS PERSONNEL CAN OR DO WARRANT THESE DESIGNS OR PLANS AS CONSTRUCTED, EXCEPT IN THE SPECIFIC CASES WHERE KAW VALLEY ENGINEERING PERSONNEL INSPECT AND CONTROL THE PHYSICAL CONSTRUCTION ON A CONTEMPORARY BASIS AT THE SITE.

**SAFETY NOTICE TO CONTRACTOR**  
IN ACCORDANCE WITH GENERALLY ACCEPTED CONSTRUCTION PRACTICES, THE CONTRACTOR SHALL BE SOLELY AND COMPLETELY RESPONSIBLE FOR CONDITIONS OF THE JOB SITE, INCLUDING SAFETY OF ALL PERSONS AND PROPERTY DURING PERFORMANCE OF THE WORK. THIS REQUIREMENT WILL APPLY CONTINUOUSLY AND NOT BE LIMITED TO NORMAL WORKING HOURS.


- NOTE:**
1. CONTRACTOR SHALL REFER TO ARCHITECTURAL PLANS FOR EXACT LOCATIONS AND DIMENSIONS OF ENTRANCE, SLOPED PAVING, EXIT PORCHES, RAMPS, TRUCK DOCKS, PRECISE BUILDING DIMENSIONS AND EXACT BUILDING UTILITY ENTRANCE LOCATIONS.
  2. THESE PLANS HAVE **NOT** BEEN VERIFIED WITH FINAL ARCHITECTURAL CONTRACT DRAWINGS. CONTRACTOR SHALL VERIFY AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES. CONTRACTOR IS FULLY RESPONSIBLE FOR REVIEW AND COORDINATION OF ALL DRAWINGS AND CONTRACTOR DOCUMENTS.
  3. ALL DIMENSIONS ARE TO BACK OF CURB UNLESS NOTED OTHERWISE.
  4. ALL DIMENSIONS ARE PERPENDICULAR TO PROPERTY LINE.
  5. ACTUAL SIGN LOCATIONS TO BE COORDINATED WITH CONSTRUCTION MANAGER.

- NOTES:**
- 8A ENTRY (SEE ARCH. PLANS)
  - 10 CONCRETE STAIRS. REFER TO ARCHITECTURAL PLANS
  - 25 TAPER CURB FROM FULL HEIGHT TO ZERO HEIGHT IN 2 FEET
  - 60 8" PVC SCH 40 STORM SEWER
  - 60A 8" PVC BEND
  - 61 10" HDPE STORM SEWER
  - 62 12" HDPE STORM SEWER
  - 63 15" HDPE STORM SEWER
  - 64 CONNECT EXISTING 8" PVC ROOF DRAIN TO PROPOSED TRENCH DRAIN
  - 70 6" SANITARY SEWER LINE, PVC SDR26 AT MINIMUM 1% SLOPE
  - 70A SANITARY SEWER SERVICE CONNECTION TO BUILDING (REFER TO MEP PLANS)
  - 70B 6" PVC BEND
  - 70C POINT OF CONNECTION TO SANITARY SEWER MAIN PER THE CITY OF SALINA STANDARD DETAILS AND SPECS. NOTIFY SALINA UTILITIES DEPARTMENT (785) 826-7305 PRIOR TO COMPLY WITH ALL APPLICABLE FEDERAL, STATE AND LOCAL REGULATIONS; INCLUDING CONFINED SPACE ENTRY. CONTRACTOR TO FIELD VERIFY LOCATION AND DEPTH OF EXISTING MAIN PRIOR TO CONSTRUCTION. NOTIFY ENGINEER OF POTENTIAL CONFLICTS

- CONSTRUCTION NOTES:**
1. COORDINATE START-UP AND ALL CONSTRUCTION ACTIVITIES WITH OWNER.
  2. CONSTRUCTION METHODS AND MATERIALS NOT SPECIFIED IN THESE PLANS ARE TO MEET OR EXCEED THE CITY OF SALINA STANDARD SPECIFICATIONS.
  3. ALL CONSTRUCTION WORK AND UTILITY WORK OUTSIDE OF PROPERTY BOUNDARIES SHALL BE PERFORMED IN COOPERATION WITH AND IN ACCORDANCE WITH REGULATIONS OF THE AUTHORITIES CONCERNED.
  4. PUBLIC CONVENIENCE AND SAFETY: THE CONTRACTOR SHALL CONDUCT THE WORK IN A MANNER THAT WILL INSURE, AS FAR AS PRACTICABLE, THE LEAST OBSTRUCTION TO TRAFFIC, AND SHALL PROVIDE FOR THE CONVENIENCE AND SAFETY OF THE GENERAL PUBLIC AND RESIDENTS ALONG AND ADJACENT TO HIGHWAYS IN THE CONSTRUCTION AREA.
  5. ONE IN SIX ACCESSIBLE PARKING STALLS MUST HAVE A SIGN DESIGNATING "VAN-ACCESSIBLE". SEE DETAIL 102 AND 120.
  6. ALL TRAFFIC CONTROL DEVICES, INSTALLATION AND OPERATIONS SHALL CONFORM WITH THE "MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES".
  7. PAINT FOR STRIPING ON PUBLIC STREETS, HIGHWAYS AND ENTRANCES SHALL BE REFLECTORIZED PAINT CONFORMING TO THE SPECIFICATIONS OR REQUIREMENTS OF THE AUTHORITY GOVERNING THE STREET OR HIGHWAY.
  8. JOINT SPACING FOR CONCRETE PAVEMENT WILL BE MODIFIED TO MEET THE CONTRACTORS CONSTRUCTION EQUIPMENT AND METHODS OF POURING. ALL CONSTRUCTION JOINTS WILL REQUIRE KEYWAYS. SAWED CONTRACTOR JOINTS WILL BE REQUIRED ON MAXIMUM 12'-0" CENTERS.
  9. DISTURBED AREAS SHALL BE SEEDED/SODDED. CONTRACTOR TO COORDINATE WITH OWNER.

- UTILITY NOTES:**
1. CONSTRUCTION SHALL NOT START ON ANY PUBLIC WATER OR SANITARY SEWER SYSTEM UNTIL WRITTEN APPROVAL OR PERMITS HAVE BEEN RECEIVED FROM THE OWNER.
  2. ALL UTILITY AND STORM SEWER TRENCHES CONSTRUCTED UNDER AREAS THAT RECEIVE PAVING SHALL BE BACKFILLED TO 18 INCHES ABOVE THE TOP OF THE PIPE WITH SELECT GRANULAR MATERIAL PLACED ON EIGHT-INCH LIFTS, AND COMPACTED TO 95% MODIFIED PROCTOR DENSITY.
  3. CONTRACTOR SHALL NOT OPEN, TURN OFF, INTERFERE WITH, OR ATTACH ANY PIPE OR HOSE TO OR TAP ANY WATER MAIN BELONGING TO THE CITY UNLESS DULY AUTHORIZED TO DO SO BY THE CITY. ANY ADVERSE CONSEQUENCE OF ANY SCHEDULED OR UNSCHEDULED DISRUPTIONS OF SERVICE TO THE PUBLIC ARE TO BE THE LIABILITY OF THE CONTRACTOR. **KAW VALLEY ENGINEERING AND OWNER ARE TO BE HELD HARMLESS.**
  4. DISINFECTION AND PRESSURE TESTING OF WATER LINES SHALL BE PERFORMED AND PAID FOR BY THE CONTRACTOR UNDER SUPERVISION OF A REPRESENTATIVE OF THE CITY WATER DEPARTMENT. CONTRACTOR SHALL NOTIFY THE CITY OF SALINA WATER DEPARTMENT 24 HOURS MINIMUM, PRIOR TO ANY TESTING.
  5. ALL WATER AND SANITARY SEWER SYSTEMS THAT ARE TO BE PUBLIC LINES SHALL BE CONSTRUCTED IN ACCORDANCE WITH SPECIFICATIONS PREVIOUSLY APPROVED BY THE CITY OF SALINA AND THE KANSAS DEPARTMENT OF HEALTH AND ENVIRONMENT AND SHALL BE INSPECTED BY THE CITY. IT IS THE CONTRACTOR'S RESPONSIBILITY TO ASSURE THAT THIS INSPECTION OCCURS.
  6. LOCATIONS SHOWN FOR PROPOSED WATER LINES ARE APPROXIMATE. VARIATIONS MAY BE MADE, WITH APPROVAL OF THE ENGINEER, TO AVOID CONFLICTS.
  7. CONTRACTOR TO INSTALL TRACING WIRE ALONG ALL NON-METALLIC WATER MAINS AND SERVICE LINES PER SPECIFICATIONS.
  8. CONTRACTOR SHALL EXPOSE EXISTING UTILITIES AT LOCATIONS OF POSSIBLE CONFLICT AND POINTS OF CONNECTION PRIOR TO ANY CONSTRUCTION OF NEW UTILITIES.
  9. WATER MAIN LINES SHALL HAVE A MINIMUM COVER OF 54 INCHES AND WATER SERVICE LINES SHALL HAVE A MINIMUM OF 42" OF COVER. ALL VALVES ON MAINS AND FIRE HYDRANT LEADS SHALL BE WITH VALVE BOX ASSEMBLIES. THE SIZE OF VALVE BOX ASSEMBLY TO BE INSTALLED IS DETERMINED BY THE TYPE AND SIZE OF VALVE. VALVE BOX CAPS SHALL HAVE THE WORD "WATER".
  10. TWO FEET OF VERTICAL SEPARATION IS REQUIRED WHERE WATER LINES, INCLUDING SERVICE LINES, AND SANITARY SEWER CROSS. WHERE A WATERLINE (SERVICE LINE) CROSSES A NEW (EXISTING) FORCE MAIN (FORCE SERVICE LINE), THE WATERLINE (SERVICE LINE) MUST ALWAYS CROSS OVER THE FORCE MAIN (FORCE SERVICE LINE) WITH A MINIMUM VERTICAL SEPARATION DISTANCE OF 2 FT. SEWER LINE JOINTS ARE TO BE LOCATED AS FAR AS POSSIBLE FROM THE INTERSECTED WATER LINE. WHEN LAID PARALLEL, AT LEAST 10 FEET OF HORIZONTAL SEPARATION IS REQUIRED BETWEEN WATER LINES AND SANITARY SEWERS. SEPARATION BETWEEN WATER LINES AND SANITARY SEWER MANHOLES IS THE SAME AS THAT FOR SANITARY SEWERS. IN CASES WHERE THE REQUIRED SEPARATION CANNOT BE MAINTAINED ADDITIONAL PROVISIONS TO PROTECT THE WATER LINE SHOULD BE USED, AS DESCRIBED IN SECTION 501 OF THE SPECIFICATIONS. ALL SEPARATION DISTANCES ARE MEASURED FROM EDGE-TO-EDGE. REFER TO SALINA STANDARD DETAIL SHEET NO. 27 (REVISED 10/23).
  11. WORK IN RIGHT-OF-WAY REQUIRES RIGHT-OF-WAY PERMIT AND SHALL BE INSPECTED BY CITY STAFF PRIOR TO COVERING OR POURING CONCRETE. PLEASE CALL (785) 309-5725 TO SCHEDULE AN INSPECTION.
  12. ALL NORTHING AND EASTINGS ARE TAKEN FROM CENTER OF STRUCTURE.
  13. CONTRACTOR TO COORDINATE DOWNSPOUT AND ROOF DRAIN LOCATIONS WITH ARCHITECTURAL AND MEP DRAWINGS. CONTRACTOR TO CONNECT DRAINS FROM BUILDING TO PROPOSED STORM SEWER SYSTEM.
  14. PIPE LENGTHS ARE CENTER TO CENTER AT STRUCTURES OR TO END OF END SECTIONS. RIM ELEVATION ON NYLOPLAST DRAIN BASINS IS TO TOP OF GRATE.
  15. CONTRACTOR TO REFER TO MEP PLANS AND COORDINATE WITH EVERGY FOR NEW ELECTRIC SERVICE



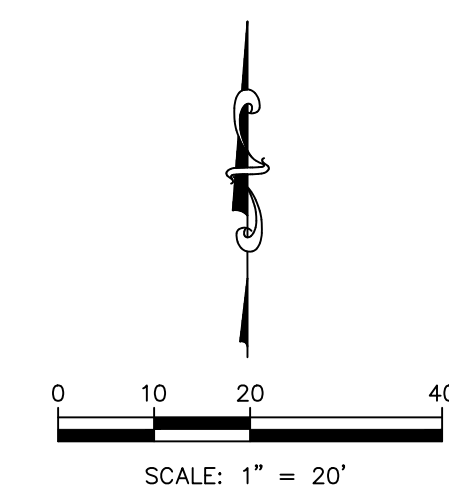

**IF DISCREPANCIES EXIST BETWEEN THE GRADING NOTES HERON AND THE RECOMMENDATIONS OUTLINED IN THE PROJECT GEOTECHNICAL REPORT, THE RECOMMENDATIONS OUTLINED IN THE GEOTECHNICAL REPORT SHALL GOVERN.**

GRADING NOTES:

1. REFERENCE GEOTECHNICAL REPORT BY UES PROFESSIONAL SOLUTIONS 25, LLC DATED AUGUST 7, 2026.
2. THE CONSTRUCTION AREA SHALL BE CLEARED, GRUBBED, AND STRIPPED OF TOPSOIL AND ORGANIC MATTER FROM ALL AREAS TO BE OCCUPIED BY BUILDING AND PAVING. TOPSOIL FOR REPLACEMENT ON SLOPES MAY BE STOCKPILED ON SITE. EXCESS TOPSOIL MAY BE WASTED IN FILL SLOPES PROVIDED THAT NO TOPSOIL WILL BE WASTED WITHIN 10 FEET OF THE EDGE OF THE BUILDING OR PARKING AREA. BURNING OF TIMBER WILL NOT BE PERMITTED UNLESS APPROVAL IS OBTAINED FROM GOVERNING OFFICIALS. STRIPPING EXISTING TOPSOIL AND ORGANIC MATTER SHALL BE TO A MINIMUM DEPTH OF 12 INCHES.
3. AREAS TO RECEIVE FILL SHALL BE SCARIFIED AND THE TOP 9-INCH DEPTH COMPACTED TO 95% STANDARD PROCTOR DENSITY. ANY UNSUITABLE AREAS SHALL BE UNDERCUT AND REPLACED WITH SUITABLE MATERIAL BEFORE ANY FILL MATERIAL CAN BE APPLIED.
4. OFF-SITE FILL MATERIAL SHALL HAVE A PLASTICITY INDEX BETWEEN 10 AND 20, A LIQUID LIMIT OF 40 OR LESS AND CONTAIN NO ROCK LARGER THAN THREE INCHES. OFF-SITE FILL MATERIAL SHALL BE APPROVED BY THE OWNER PRIOR TO BRINGING ON SITE.
5. EARTHWORK UNDER THE BUILDING SHALL COMPLY WITH THE PROJECT ARCHITECTURAL PLANS. OTHER FILL MATERIAL SHALL BE MADE IN LIFTS NOT TO EXCEED EIGHT INCHES DEPTH COMPACTED TO 95% STANDARD PROCTOR DENSITY. FILL MATERIAL MAY INCLUDE ROCK FROM ON-SITE EXCAVATION IF CAREFULLY PLACED SO THAT LARGE STONES ARE WELL DISTRIBUTED AND VOIDS ARE COMPLETELY FILLED WITH SMALLER STONES, EARTH, SAND OR GRAVEL TO FURNISH A SOLID EMBANKMENT. NO ROCK LARGER THAN THREE INCHES IN ANY DIMENSION NOR ANY SHALE SHALL BE PLACED IN THE TOP 12 INCHES OF EMBANKMENT.
6. AREAS THAT ARE TO BE CUT TO SUBGRADE LEVELS SHALL BE PROOF ROLLED WITH A MODERATELY HEAVY LOADED DUMP TRUCK OR SIMILAR APPROVED CONSTRUCTION EQUIPMENT TO DETECT UNSUITABLE SOIL CONDITIONS.
7. IN ALL AREAS OF EXCAVATION, IF UNSUITABLE SOIL CONDITIONS ARE ENCOUNTERED, A QUALIFIED GEOTECHNICAL ENGINEER SHALL RECOMMEND TO THE OWNER THE METHODS OF UNDERCUTTING AND REPLACEMENT OF PROPERLY COMPACTED APPROVED FILL MATERIAL. ALL PROOFROLLING AND UNDERCUTTING SHOULD BE PERFORMED DURING A PERIOD OF DRY WEATHER.
8. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE CONTROL OF DUST AND DIRT RISING AND SCATTERING IN THE AIR DURING CONSTRUCTION AND SHALL PROVIDE WATER SPRINKLING OR OTHER SUITABLE METHODS OF CONTROL. THE CONTRACTOR SHALL COMPLY WITH ALL GOVERNING REGULATIONS PERTAINING TO ENVIRONMENTAL PROTECTION.
9. ALL SLOPES ARE TO BE 3:1 OR FLATTER UNLESS OTHERWISE INDICATED.
10. ALL SLOPES EXCEEDING 3:1 SHALL BE PROTECTED BY RIP RAP, CONCRETE PAVING, OR OTHER METHODS INDICATED ON THESE PLANS, THAT WILL PREVENT EROSION AND PLACED SUCH THAT THE SURFACE IS FLUSH WITH SURROUNDING GROUND AND SHAPED TO CHANNEL WATER IN DIRECTIONS INDICATED.
11. ALL SLOPES AND AREAS DISTURBED BY CONSTRUCTION SHALL BE GRADED SMOOTH AND FOUR INCHES OF TOPSOIL APPLIED. IF ADEQUATE TOPSOIL IS NOT AVAILABLE ON-SITE, THE CONTRACTOR SHALL PROVIDE TOPSOIL APPROVED BY THE OWNER. AS NEEDED, THE AREA SHALL THEN BE SEEDDED, FERTILIZED, MULCHED, WATERED AND MAINTAINED UNTIL HARDY GRASS GROWTH IS ESTABLISHED IN ALL AREAS. ANY AREAS DISTURBED FOR ANY REASON SHALL BE CORRECTED BY THE CONTRACTOR AT NO ADDITIONAL COST TO THE OWNER PRIOR TO FINAL ACCEPTANCE OF THE PROJECT.
12. CONTRACTOR SHALL USE SILT FENCE, STRAW WATTLES OR OTHER MEANS OF CONTROLLING EROSION ALONG THE EDGE OF THE PROPERTY OR OTHER BOTTOM OF SLOPE LOCATIONS.
13. CONTRACTOR IS TO REMOVE AND DISPOSE OF ALL DEBRIS, RUBBISH AND OTHER MATERIALS RESULTING FROM PREVIOUS AND CURRENT DEMOLITION OPERATIONS.
14. THE CONTRACTOR SHALL TAKE ALL PRECAUTIONS NECESSARY TO AVOID PROPERTY DAMAGE TO ADJACENT PROPERTIES DURING THE CONSTRUCTION PHASES OF THIS PROJECT. THE CONTRACTOR WILL BE HELD SOLELY RESPONSIBLE FOR ANY DAMAGES TO THE ADJACENT PROPERTIES OCCURRING DURING THE CONSTRUCTION PHASES OF THIS PROJECT.
15. IT IS NOT THE DUTY OF THE ENGINEER OR THE OWNER TO REVIEW THE ADEQUACY OF THE CONTRACTOR'S SAFETY MEASURES, IN, ON OR NEAR THE CONSTRUCTION SITE AT ANY TIME DURING CONSTRUCTION.
16. PIPE LENGTHS ARE CENTER TO CENTER OF STRUCTURE OR TO END OF END SECTIONS.
17. CONTRACTOR TO PROVIDE WALL DETAILS AND PLANS SEALED BY A KANSAS LICENSED ENGINEER. WALL DESIGNER TO VERIFY BEARING CAPACITY AND GLOBAL STABILITY FOR WALL CALCULATIONS.
18. HANDICAP STALLS SHALL MEET ADA REQUIREMENTS AND SHALL NOT EXCEED 2% SLOPE IN ANY DIRECTION AT THE BUILDING ENTRY AND ACCESSIBLE PARKING STALLS. SLOPES EXCEEDING 2.0% WILL BE REPLACED AT THE CONTRACTOR'S EXPENSE. SIDEWALK RUNNING SLOPE SHALL NOT EXCEED 5% AND CROSS SLOPE SHALL NOT EXCEED 2%.
19. EROSION AND SEDIMENT CONTROLS SHALL BE INSTALLED PRIOR TO OR DURING THE CONSTRUCTION PHASE DURING WHICH THEY ARE NEEDED. APPLICANT SHALL CONTACT THE CITY ENGINEERS OFFICE AT (785) 309-5725 TO SCHEDULE AN INSPECTION PRIOR TO COMMENCING CONSTRUCTION.

**NOTE:**

1. CONTRACTOR SHALL REFER TO ARCHITECTURAL PLANS FOR EXACT LOCATIONS AND DIMENSIONS OF ENTRANCE, SLOPED PAVING, EXIT PORCHES, RAMPS, TRUCK DOCKS, PRECISE BUILDING DIMENSIONS AND EXACT BUILDING UTILITY ENTRANCE LOCATIONS.
2. THESE PLANS HAVE NOT BEEN VERIFIED WITH FINAL ARCHITECTURAL CONTRACT DRAWINGS. CONTRACTOR SHALL VERIFY AND NOTIFY THE ENGINEER OF ANY DISCREPANCIES. CONTRACTOR IS FULLY RESPONSIBLE FOR REVIEW AND COORDINATION OF ALL DRAWINGS AND CONTRACT DOCUMENTS.

## SAFETY NOTICE TO CONTRACTOR

IN ACCORDANCE WITH GENERALLY ACCEPTED CONSTRUCTION PRACTICES, THE CONTRACTOR SHALL BE SOLELY AND COMPLETELY RESPONSIBLE FOR CONDITIONS OF THE JOB SITE, INCLUDING SAFETY OF ALL PERSONS AND PROPERTY DURING PERFORMANCE OF THE WORK. THIS REQUIREMENT WILL APPLY CONTINUOUSLY AND NOT BE LIMITED TO NORMAL WORKING HOURS.

## WARRANTY / DISCLAIMER

THE DESIGNS REPRESENTED IN THESE PLANS ARE IN ACCORDANCE WITH ESTABLISHED PRACTICES OF CIVIL ENGINEERING FOR THE DESIGN FUNCTIONS AND USES INTENDED BY THE OWNER AT THIS TIME. HOWEVER, NEITHER KAW VALLEY ENGINEERING, INC NOR ITS PERSONNEL CAN OR DO WARRANTY THESE DESIGNS OR PLANS AS CONSTRUCTED, EXCEPT IN THE SPECIFIC CASES WHERE KAW VALLEY ENGINEERING PERSONNEL INSPECT AND CONTROL THE PHYSICAL CONSTRUCTION ON A CONTEMPORARY BASIS AT THE SITE.


CAUTION - NOTICE TO CONTRACTOR

THE CONTRACTOR IS SPECIFICALLY CAUTIONED THAT THE LOCATION AND/OR ELEVATION OF EXISTING UTILITIES AS SHOWN ON THESE PLANS IS BASED ON RECORDS OF THE VARIOUS UTILITY COMPANIES AND, WHERE POSSIBLE, MEASUREMENTS TAKEN IN THE FIELD. THE INFORMATION IS NOT TO BE RELIED ON AS BEING EXACT OR COMPLETE. THE CONTRACTOR SHALL CALL THE APPROPRIATE UTILITY COMPANY AT LEAST 72 HOURS BEFORE ANY EXCAVATION TO REQUEST EXACT FIELD LOCATION OF UTILITIES. IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO RELOCATE ALL EXISTING UTILITIES WHICH CONFLICT WITH PROPOSED IMPROVEMENTS SHOWN ON THE PLANS.

THE CONTRACTOR SHALL EXPOSE EXISTING UTILITIES AT LOCATIONS OF POSSIBLE CONFLICTS PRIOR TO ANY CONSTRUCTION.


THE COORDINATES PROVIDED ON THIS PLAN ARE FOR INFORMATION AND CHECKING PURPOSES ONLY. IT IS THE CONTRACTOR'S RESPONSIBILITY TO CALCULATE CONSTRUCTION STAKING COORDINATES ACCORDING TO THE DIMENSIONS SHOWN ON THESE PLANS. CONTRACTOR SHALL VERIFY THE ACCURACY OF THE COORDINATES SHOWN HEREON BEFORE CONSTRUCTION.



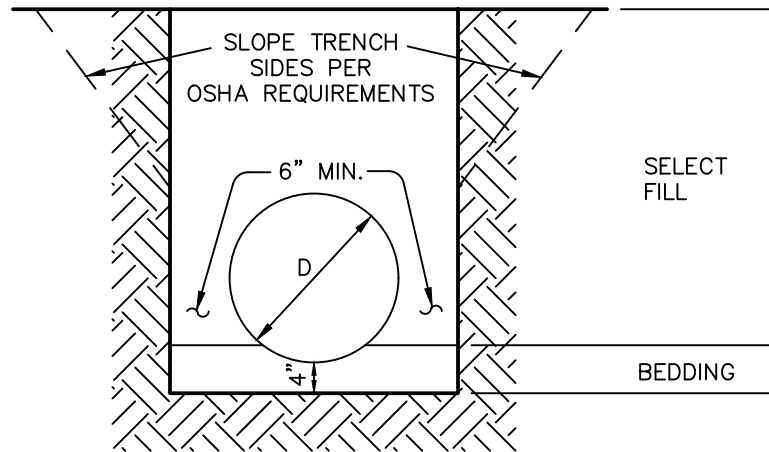

RIGID PIPE: INCLUDES REINFORCED CONCRETE, DUCTILE IRON, & CAST IRON

1. BEDDING SHALL BE COMPACTED SAND AND SHALL BE SHAPED TO THE BOTTOM OF THE PIPE.
2. SELECT FILL SHALL BE NATIVE MATERIAL FREE OF LARGE ROCKS, DEBRIS, AND ORGANICS (3"+) AND SHALL BE PLACED IN 6" MAX. LOOSE LIFTS AND COMPACTED IN ACCORDANCE WITH SPECIFICATIONS.

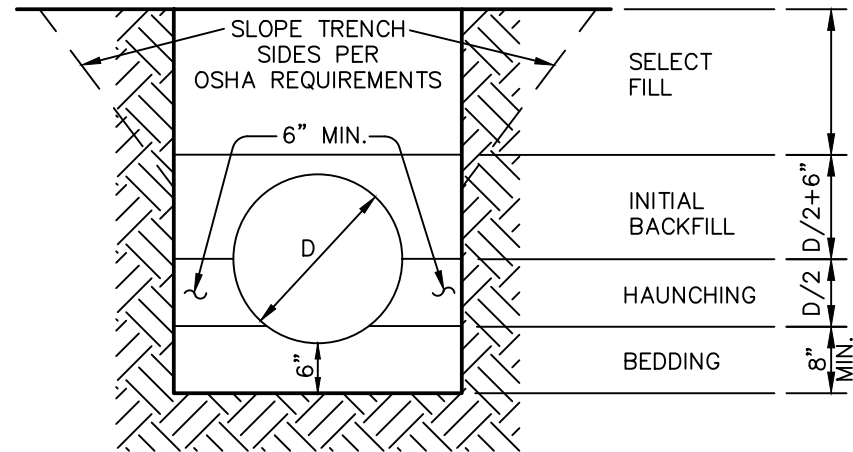

FLEXIBLE PIPE: INCLUDES CORRUGATED METAL PIPE, CORRUGATED POLYETHYLENE PIPE AND/OR POLYVINYL CHLORIDE PIPE.


1. BEDDING AND HAUNCHING MATERIAL SHALL BE COMPACTED SAND, UNLESS NOTED OTHERWISE ON PLANS AND SHALL BE SHAPED TO THE BOTTOM OF THE PIPE.
2. INITIAL BACKFILL MATERIAL SHALL BE GRANULAR MATERIAL OR SELECT MATERIAL (INCLUDING SAND) COMPACTED IN ACCORDANCE TO SPECIFICATIONS.
3. SELECT FILL PLACEMENT AND COMPACTION SAME AS FOR RIGID PIPE.

## TRENCH AND BEDDING DETAILS


206

### GENERAL NOTES:

1. PROPERTY LINE IS LIMITS OF CONSTRUCTION EXCEPT AS SHOWN.
2. THE CONTRACTOR SHALL INSTALL EROSION CONTROL MEASURES AS SHOWN ON THE DRAWINGS PRIOR TO BEGINNING EARTHWORK OPERATIONS.
3. THE CONTRACTOR SHALL MAINTAIN ALL SILT CONTROL MEASURES DURING CONSTRUCTION.
4. ALL SILT SHALL REMAIN ON SITE AND SURROUNDING STREETS SHALL BE KEPT CLEAR OF ALL MUD AND DEBRIS.
5. A SEDIMENTATION BARRIER IS TO BE INSTALLED AS SHOWN.
6. ACCUMULATED SEDIMENT SHALL BE REMOVED AND THE SEDIMENTATION BARRIERS MAINTAINED AS NEEDED TO PREVENT SEDIMENTATION BYPASS OF THE BARRIER.
7. SLOPES ARE TO BE LEFT IN A ROUGH CONDITION DURING GRADING.
8. CURB INLET SEDIMENTATION BARRIERS ARE TO BE INSTALLED AROUND INLETS AND WEIRS WHERE SEDIMENTATION IS A CONCERN. INLET BARRIERS SHALL BE EITHER BLOCK AND GRAVEL, OR SECURED STRAW BALES, OR SILT FENCE.
9. SEDIMENT IS TO BE REMOVED FROM STORM WATER DRAINAGE SYSTEMS.
10. RIPRAP IS TO BE INSTALLED AT AREAS OF CONCENTRATED FLOW (I.E. CULVERT OUTLETS).
11. CONTRACTOR IS RESPONSIBLE FOR INSTALLING ANY ADDITIONAL EROSION CONTROL AS HE/SHE DEEMS NECESSARY.
12. THE CONTRACTOR SHALL PROVIDE ALL MATERIALS, TOOLS, EQUIPMENT AND LABOR AS NECESSARY TO INSTALL AND MAINTAIN ADEQUATE EROSION AND SILTATION CONTROLS REQUIRED TO PREVENT SOIL EROSION FROM LEAVING THE PROJECT SITE. IT SHALL BE THE CONTRACTOR'S SOLE RESPONSIBILITY TO ENSURE THAT METHODS UTILIZED ARE ADEQUATE AND COMPLY WITH REQUIREMENTS OF THE SPECIFICATIONS AND GOVERNMENTAL AGENCIES HAVING JURISDICTION OVER THE WORK.
13. TEMPORARY SEDIMENT FENCE/STRAW BALES TO REMAIN UNTIL ADEQUATE VEGETATION IS ESTABLISHED.
14. MUD AND DEBRIS SHALL BE CLEANED UP AT THE CONCLUSION OF EACH WORKING DAY, OR AFTER EACH RAINFALL IF SILT IS PRESENT.
15. INSPECTION, MAINTENANCE AND REPAIR OF EROSION CONTROL DEVICES SHALL BE ON GOING THROUGHOUT THE LIFE OF BUILDING CONSTRUCTION TO KEEP THE DEVICES IN OPERABLE CONDITION AT ALL TIMES. ADDITIONAL MEASURES SHALL BE INSTALLED AS REQUIRED BY ACTUAL FIELD CONDITIONS AND/OR GOVERNING INSPECTION AGENCIES.
16. INSTALL CONSTRUCTION ENTRANCE AT ANY POINT WHERE TRAFFIC WILL BE ENTERING OR LEAVING THE SITE AND AS SHOWN ON PLANS.
17. AT COMPLETION OF SITE GRADING AND OTHER RELATED CONSTRUCTION ACTIVITIES, ALL DISTURBED AREAS WITHIN THE PROJECT SITE SHALL BE SEEDED USING MULCH OR EQUIVALENT STABILIZING BMP, SODDED, OR LANDSCAPED AS SHOWN ON THE LANDSCAPE PLAN WITHIN 14 DAYS.
18. TOPSOIL IS TO BE PLACED IN AREAS UNSUITABLE FOR VEGETATIVE GROWTH.
19. STRIP TOPSOIL PRIOR TO EXCAVATION, STOCKPILE AND SPREAD ONTO DISKED SUBGRADE (4" MIN) A THICKNESS OF 4 INCHES.
20. ROCK LINING (RIPRAP) SHALL BE DURABLE STONE CONTAINING A COMBINED TOTAL OF NOT MORE THAN 10 PERCENT OF EARTH, SAND, SHALE AND NON-DURABLE ROCK. AT LEAST 60 PERCENT OF THE MASS SHALL BE OF PIECES HAVING A MINIMUM WEIGHT OF 150 POUNDS OR MORE PER CUBIC FOOT.
21. THE CONTRACTOR SHALL HAVE THE RESPONSIBILITY FOR RESOLVING COMPLAINTS IN THE EVENT THAT COMPLAINTS OR DAMAGE CLAIMS ARE FILED DUE TO DAMAGES OCCURRING ADJACENT TO OR DOWNSTREAM FROM PROPERTY BY SEDIMENT RESULTING FROM EROSION ON THE PROJECT SITE.
22. GOOD HOUSEKEEPING PRACTICES SHALL BE MAINTAINED ON SITE TO KEEP SOLID WASTE FROM ENTRY INTO WATERS.
23. ALL FUELING FACILITIES PRESENT ON SITE SHALL ADHERE TO APPLICABLE FEDERAL AND STATE REQUIREMENTS CONCERNING UNDERGROUND STORAGE, ABOVE GROUND STORAGE AND DISPENSERS, INCLUDING SPILL PREVENTION, CONTROL AND COUNTER MEASURES.
24. RIGHT OF WAY TO BE STABILIZED AS REQUIRED BY APWA SECTION 2400.
25. EROSION CONTROL IS TO BE PLACED IN PHASING AS CONSTRUCTION PROGRESSES.
26. MINIMAL WASHING OF CONCRETE EQUIPMENT ALLOWED, CHUTE ETC. CONCRETE WASHOUT OF THE DRUM IS NOT ALLOWED. ANY PIT/WASHOUT AREA NEEDS TO BE MAINTAINED IN A NON-DISCHARGING MANNER AND ANY WASTE RESIDUE WILL NEED TO BE CLEANED OUT AND REMOVED AT THE END OF PROJECT.
27. CONTRACTOR/DEVELOPER IS RESPONSIBLE FOR HAVING LOT BUILDERS FOLLOW THE GUIDELINES OF "CONTROLLING EROSION WHEN BUILDING YOUR HOME" PROVIDED BY KANSAS DEPARTMENT OF HEALTH AND ENVIRONMENT.
28. EROSION CONTROL SEDIMENT FENCE TO BE INSTALLED 1'-0" BEHIND CURB & GUTTER UPON COMPLETION OF BACKFILL OF CURB IN ALL AREAS WHERE SLOPES FROM LOT DRAIN TOWARDS CURB. UPON COMPLETION OF FINAL GRADING THE TOES OF ALL EMBANKMENTS IN EXCESS OF TWO FEET IN HEIGHT WILL HAVE EROSION CONTROL SEDIMENT FENCE INSTALLED.

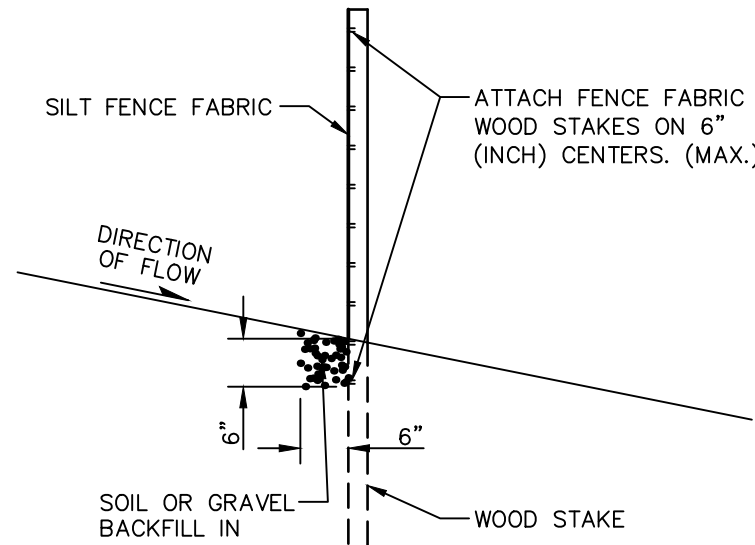


SECTION A-A

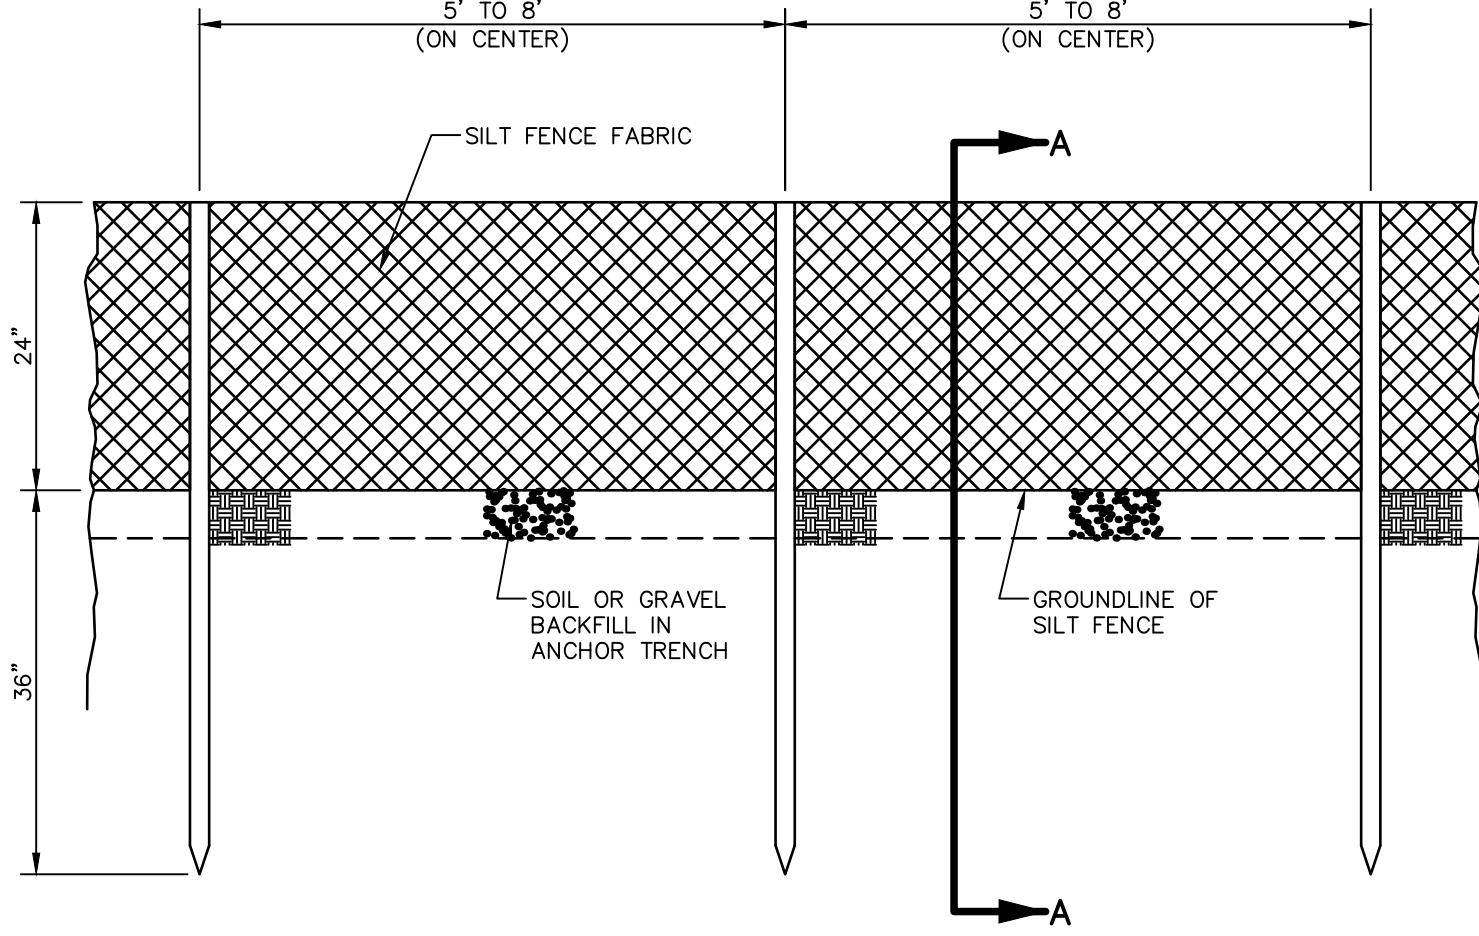

## SEDIMENTATION FENCE


812

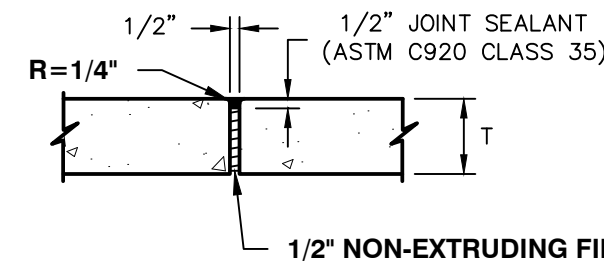

NOTE:

1. TYPE 1 JOINTS SHALL BE PLACED WHERE NEW CONCRETE ABUTS EXISTING CONCRETE AND IN AREAS WHERE CONCRETE ABUTS BUILDINGS. UNLESS NOTED OTHERWISE.


### EXPANSION JOINT - TYPE 1

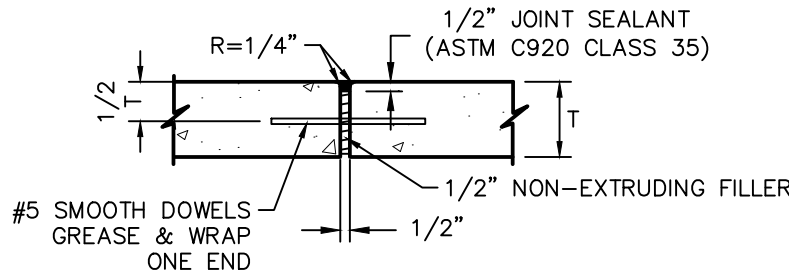

### TYPE 2

NOTE:


1. TYPE 2 JOINTS SHALL BE PLACED AS NOTED AND AT ALL P.C.'S, P.T.'S AND TRANSITIONS, AND WHERE NEW CURB OR CONCRETE PAVEMENT TIES INTO EXISTING CURB OR CONCRETE PAVEMENT AND AT DOORWAYS.
2. SMOOTH BARS SHALL BE 24" LONG

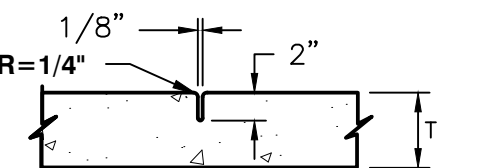


### CONTRACTION JOINT - TYPE 3

NOTE:

- CONTRACTION JOINTS SHALL BE ARRANGED TO PROVIDE APPROXIMATELY SQUARE PANELS (ONE SIDE SHALL NOT EXCEED ANOTHER SIDE BY MORE THAN 30%) AND MAXIMUM SPACING SHALL BE THE THICKNESS OF THE SLAB IN FEET (IE. 4" THICKNESS YIELDS 4" SPACING MAX.)

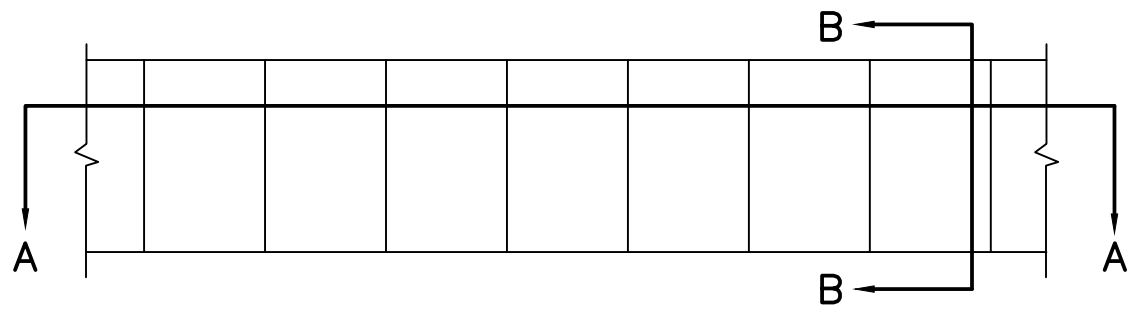


### PLAN VIEW

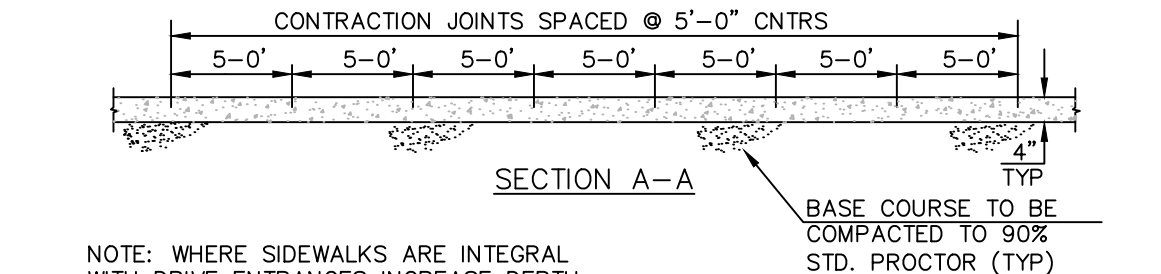

### SECTION A-A

NOTE: WHERE SIDEWALKS ARE INTEGRAL WITH DRIVE ENTRANCES INCREASE DEPTH TO 6" AND PROVIDE REINFORCING USING 6x6 #10 WIRE MINIMUM.

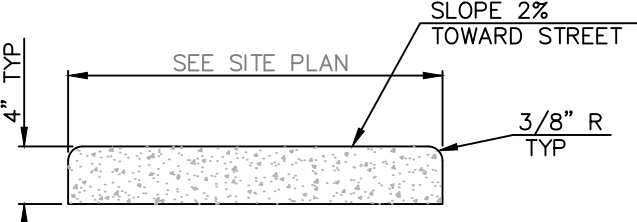


### SECTION B-B

## CONCRETE SIDEWALK

055

NOTE: CONCRETE SHALL BE CLASS A WITH  $f'_c = 4000$  PSI.

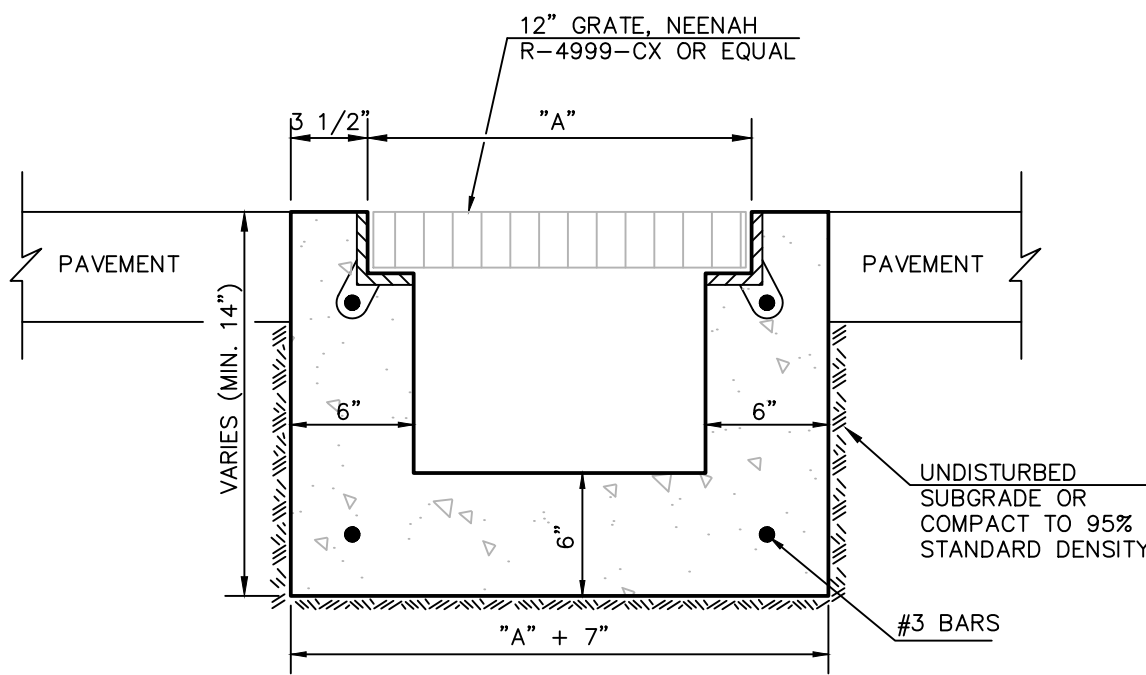


## TRENCH DRAIN

430

NOTE:

1. CONTRACTOR TO CONNECT EXISTING ROOF DRAIN TO TRENCH DRAIN PER PLANS.
2. CONTRACTOR TO GRADE DRAIN TO PROPOSED 12" OUTLET PIPE AS SHOWN ON UTILITY PLAN.
3. REFER TO DETAIL 040 FOR CONCRETE NOTES & SPECS.

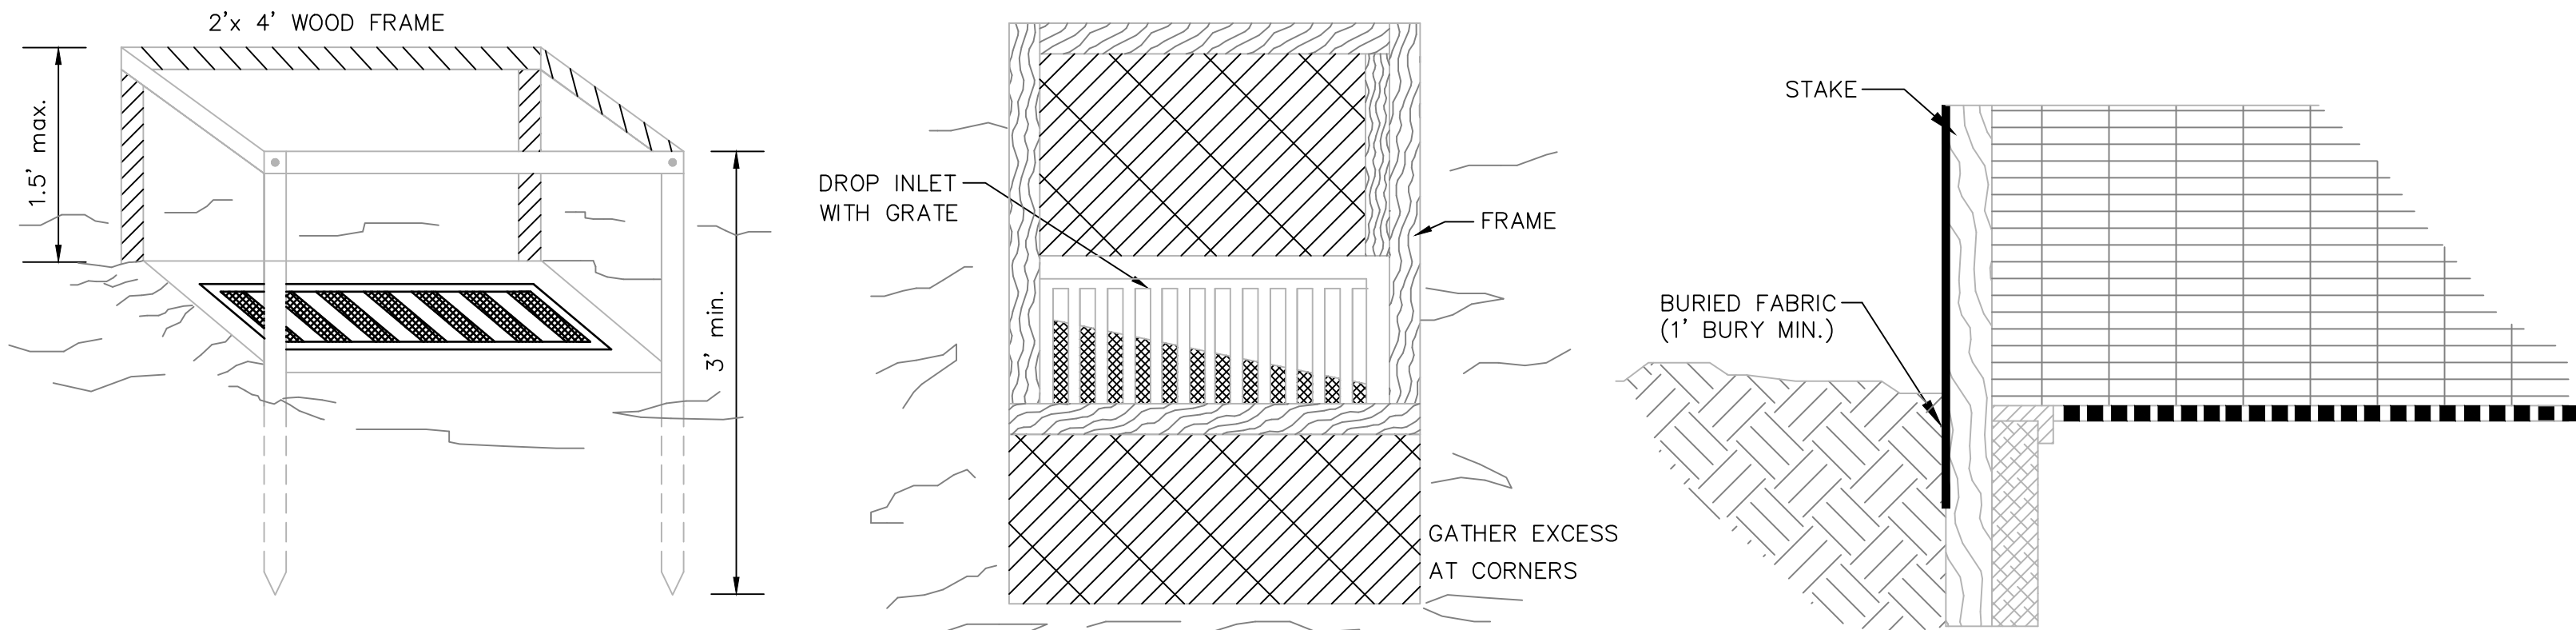

### CONSTRUCTION SPECIFICATIONS

1. AS SYNTHETIC FABRIC, USE A PERVIOUS SHEET OF NYLON, POLYESTER, OR ETHYLENE YARN - EXTRA STRENGTH - THAT CONTAINS ULTRAVIOLET RAY INHIBITORS AND STABILIZERS. FABRIC SHOULD BE SUFFICIENTLY POROUS TO PROVIDE ADEQUATE DRAINAGE OF THE TEMPORARY SEDIMENT POOL. BURLAP MAY BE USED FOR SHORT-TERM APPLICATIONS. IT MUST BE REPLACED EVERY 60 DAYS.
2. CUT FABRIC FROM A CONTINUOUS ROLL TO ELIMINATE JOINTS.
3. FOR STAKES, USE 2 X 4 INCH WOOD (PREFERRED) OR EQUIVALENT METAL WITH A MINIMUM LENGTH OF THREE FEET.
4. SPACE STAKES EVENLY AROUND THE PERIMETER OF THE INLET A MAXIMUM OF THREE FEET APART, AND SECURELY DRIVE THEM INTO THE GROUND, APPROXIMATELY 18 INCHES APART.
5. TO PROVIDE NEEDED STABILITY TO THE INSTALLATION, FRAME WITH 2 X 4 INCH WOOD STRIPS AROUND THE CREST TO THE OVERFLOW AREA AT A MINIMUM OF 1.5 FEET ABOVE THE DROP INLET CREST.
6. PLACE THE BOTTOM 12 INCHES OF THE FABRIC IN A TRENCH AND BACKFILL THE TRENCH WITH AT LEAST FOUR INCHES OF CRUSHED STONE OR TWELVE INCHES OF COMPACTED SOIL.
7. FASTEN FABRIC SECURELY TO THE STAKES AND FRAME. JOINTS MUST BE OVERLAPPED TO THE NEXT STAKE.
8. THE TOP OF THE FRAME AND FABRIC MUST BE WELL BELOW THE GROUND ELEVATION DOWNSLOPE FROM THE DROP INLET TO KEEP RUNOFF FROM BYPASSING THE INLET. IT MAY BE NECESSARY TO BUILD A TEMPORARY DIKE ON THE DOWN SLOPE SIDE OF THE STRUCTURE TO PREVENT BYPASS FLOW. MATERIAL FROM WITHIN THE SEDIMENT POOL MAY BE USED FOR DIKING.

### MAINTENANCE

1. INSPECT THE FABRIC BARRIER AFTER EACH RAIN AND MAKE REPAIRS AS NEEDED.
2. REMOVE SEDIMENT FROM THE POOL AREA NECESSARY TO PROVIDE ADEQUATE STORAGE VOLUME FOR THE NEXT RAIN EVENT. TAKE CARE NOT TO DAMAGE OR UNDERCUT THE FABRIC DURING SEDIMENT REMOVAL.
3. WHEN THE CONTRIBUTING DRAINAGE AREA HAS BEEN ADEQUATELY STABILIZED, REMOVE ALL MATERIALS AND ANY UNSTABLE SEDIMENT AND DISPOSE OF THEM PROPERLY. BRING THE DISTURBED AREA TO THE GRADE OF THE DROP INLET AND SMOOTH AND COMPACT IT. APPROPRIATELY STABILIZE ALL BARE AREAS AROUND THE INLET.

## TEMPORARY DROP INLET PROTECTION

N.T.S.

816










26  
39






9 PHOTOGRAPH  
NO SCALE

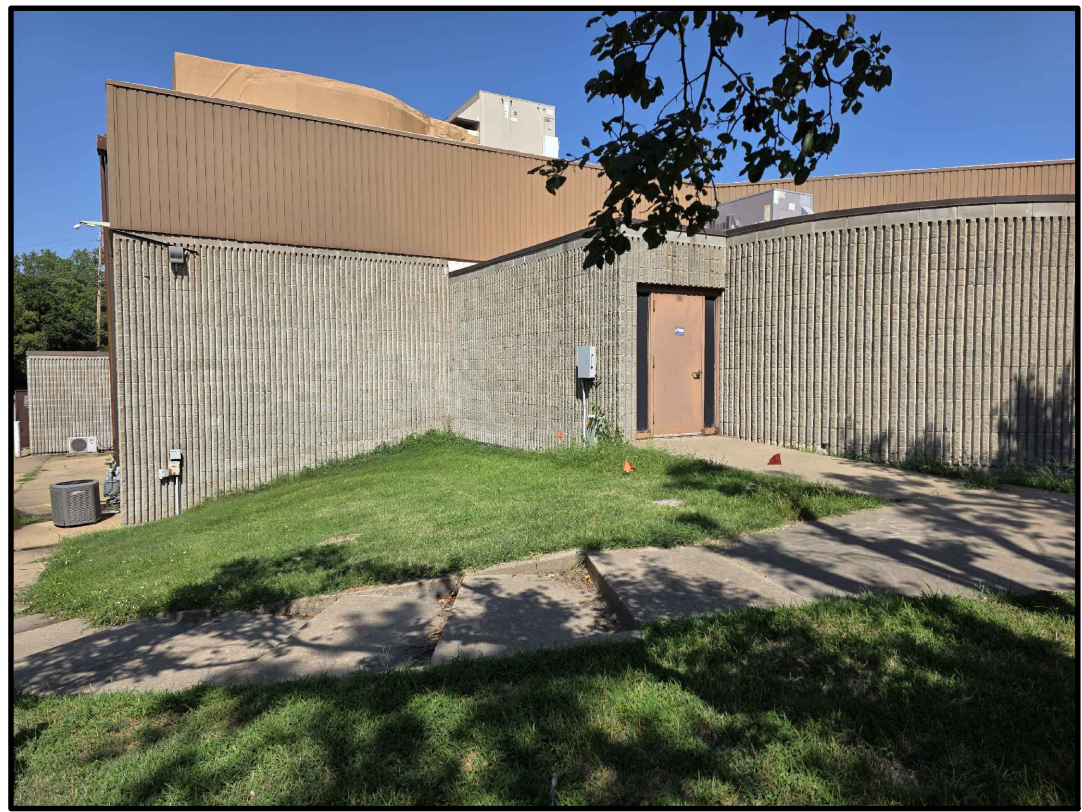

8 PHOTOGRAPH  
NO SCALE

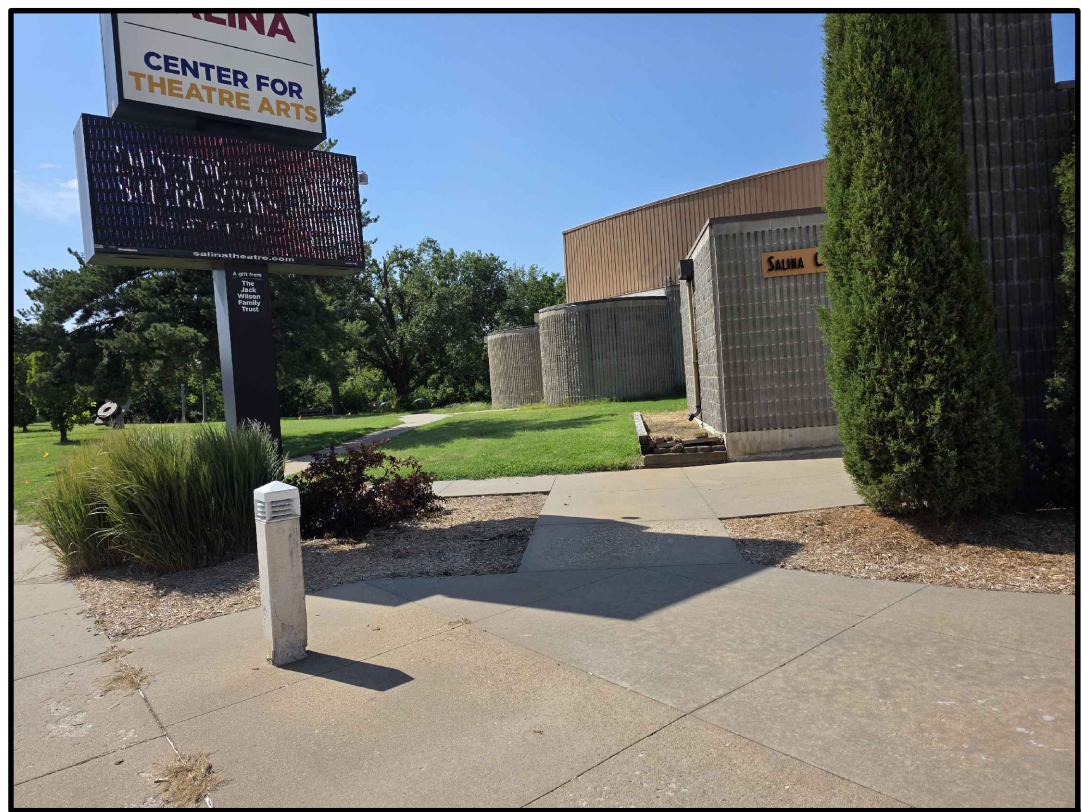

4 PHOTOGRAPH  
NO SCALE




13 PHOTOGRAPH  
NO SCALE



7 PHOTOGRAPH  
NO SCALE



12 PHOTOGRAPH  
NO SCALE

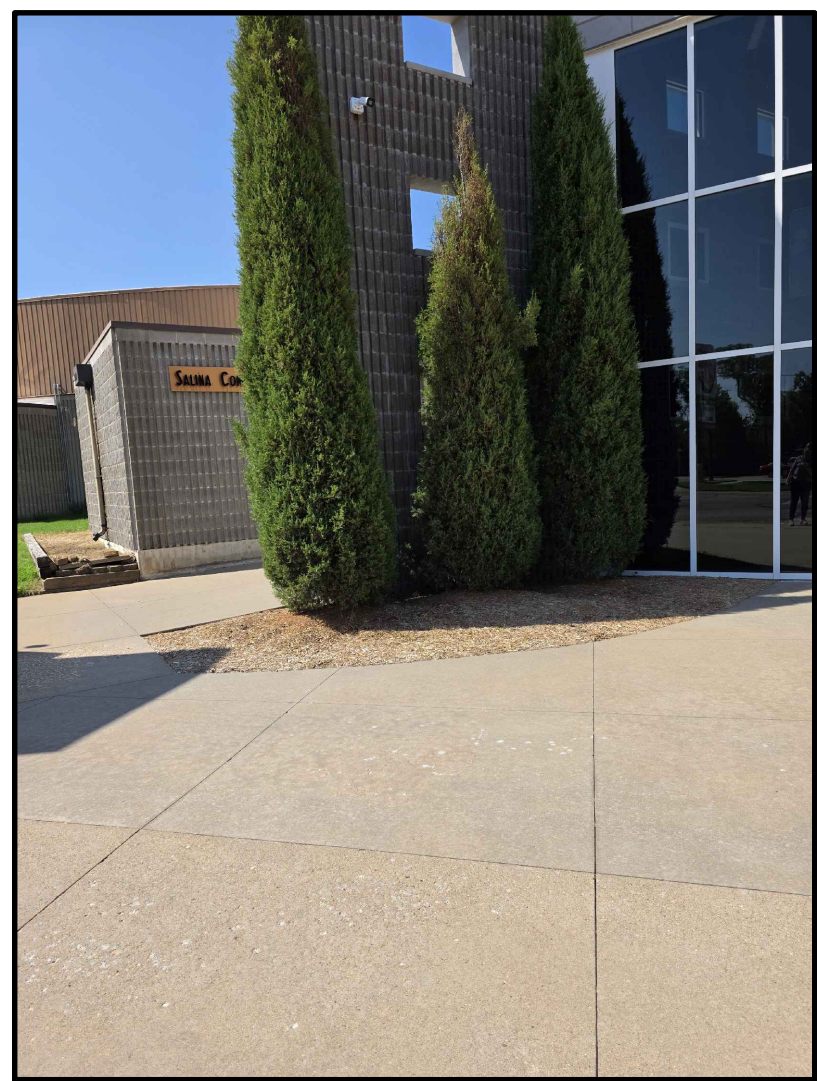


3 PHOTOGRAPH  
NO SCALE



6 PHOTOGRAPH  
NO SCALE



11 PHOTOGRAPH  
NO SCALE

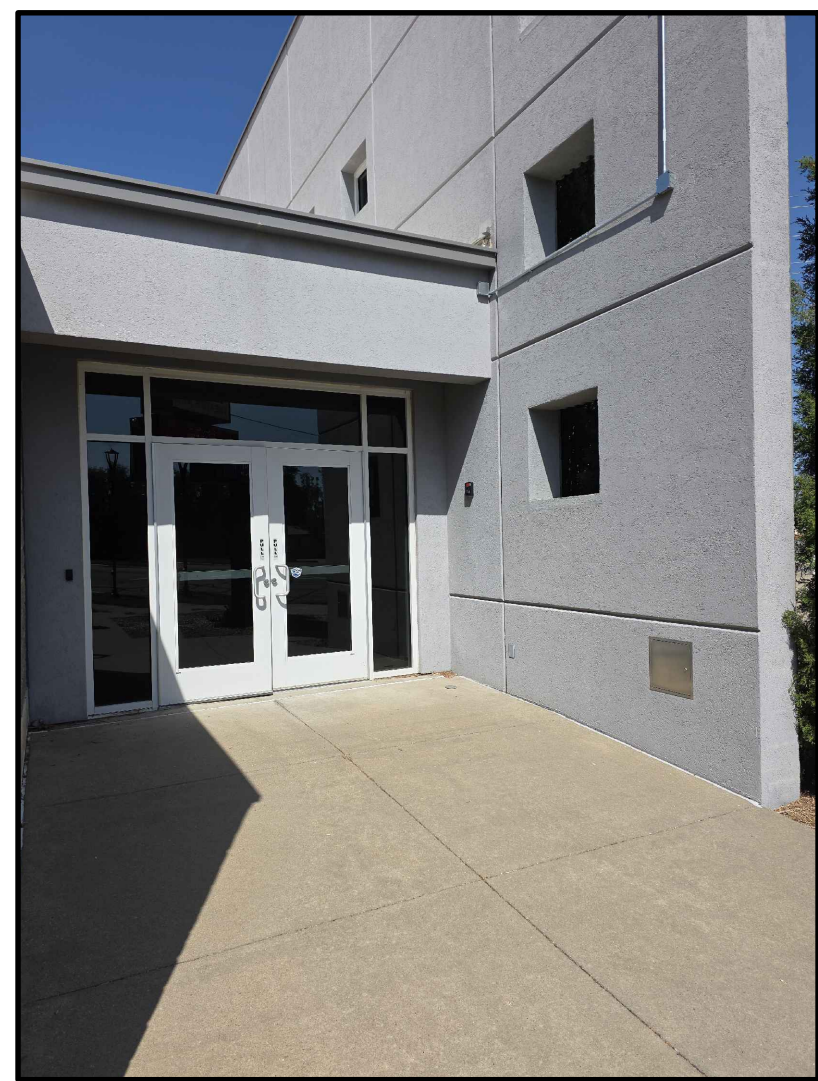


2 PHOTOGRAPH  
NO SCALE



5 PHOTOGRAPH  
NO SCALE






10 PHOTOGRAPH  
NO SCALE

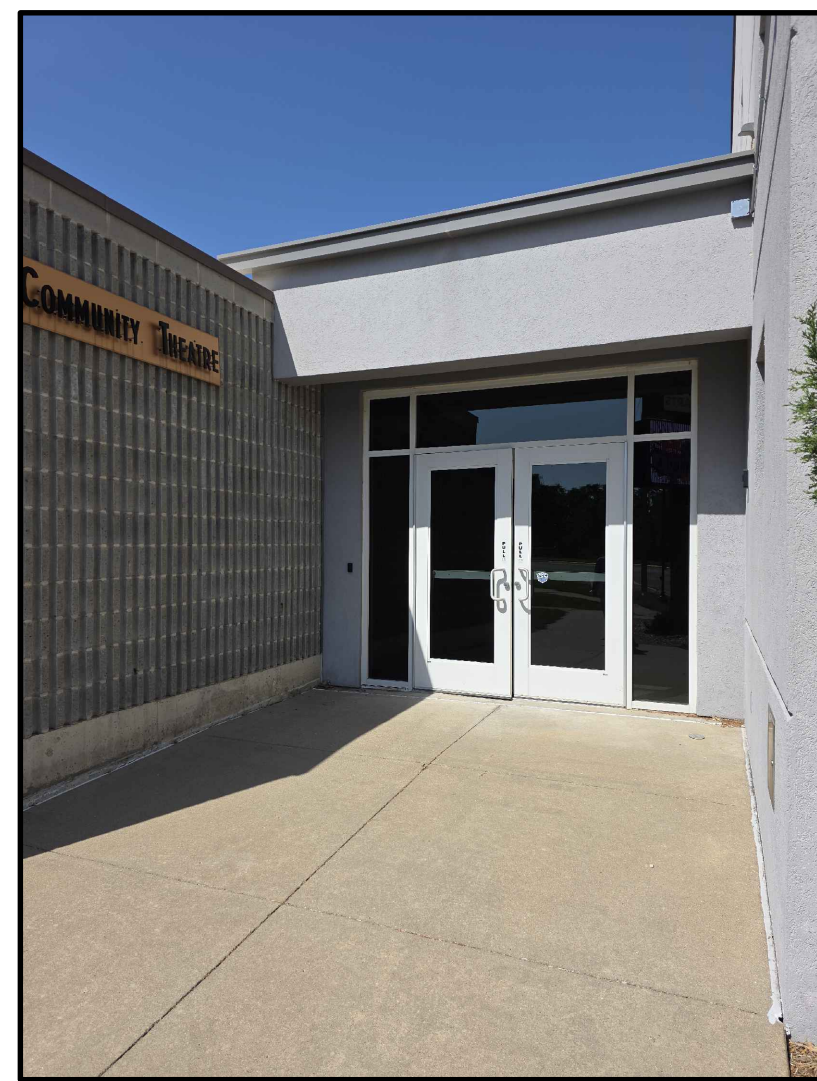


1 PHOTOGRAPH  
NO SCALE



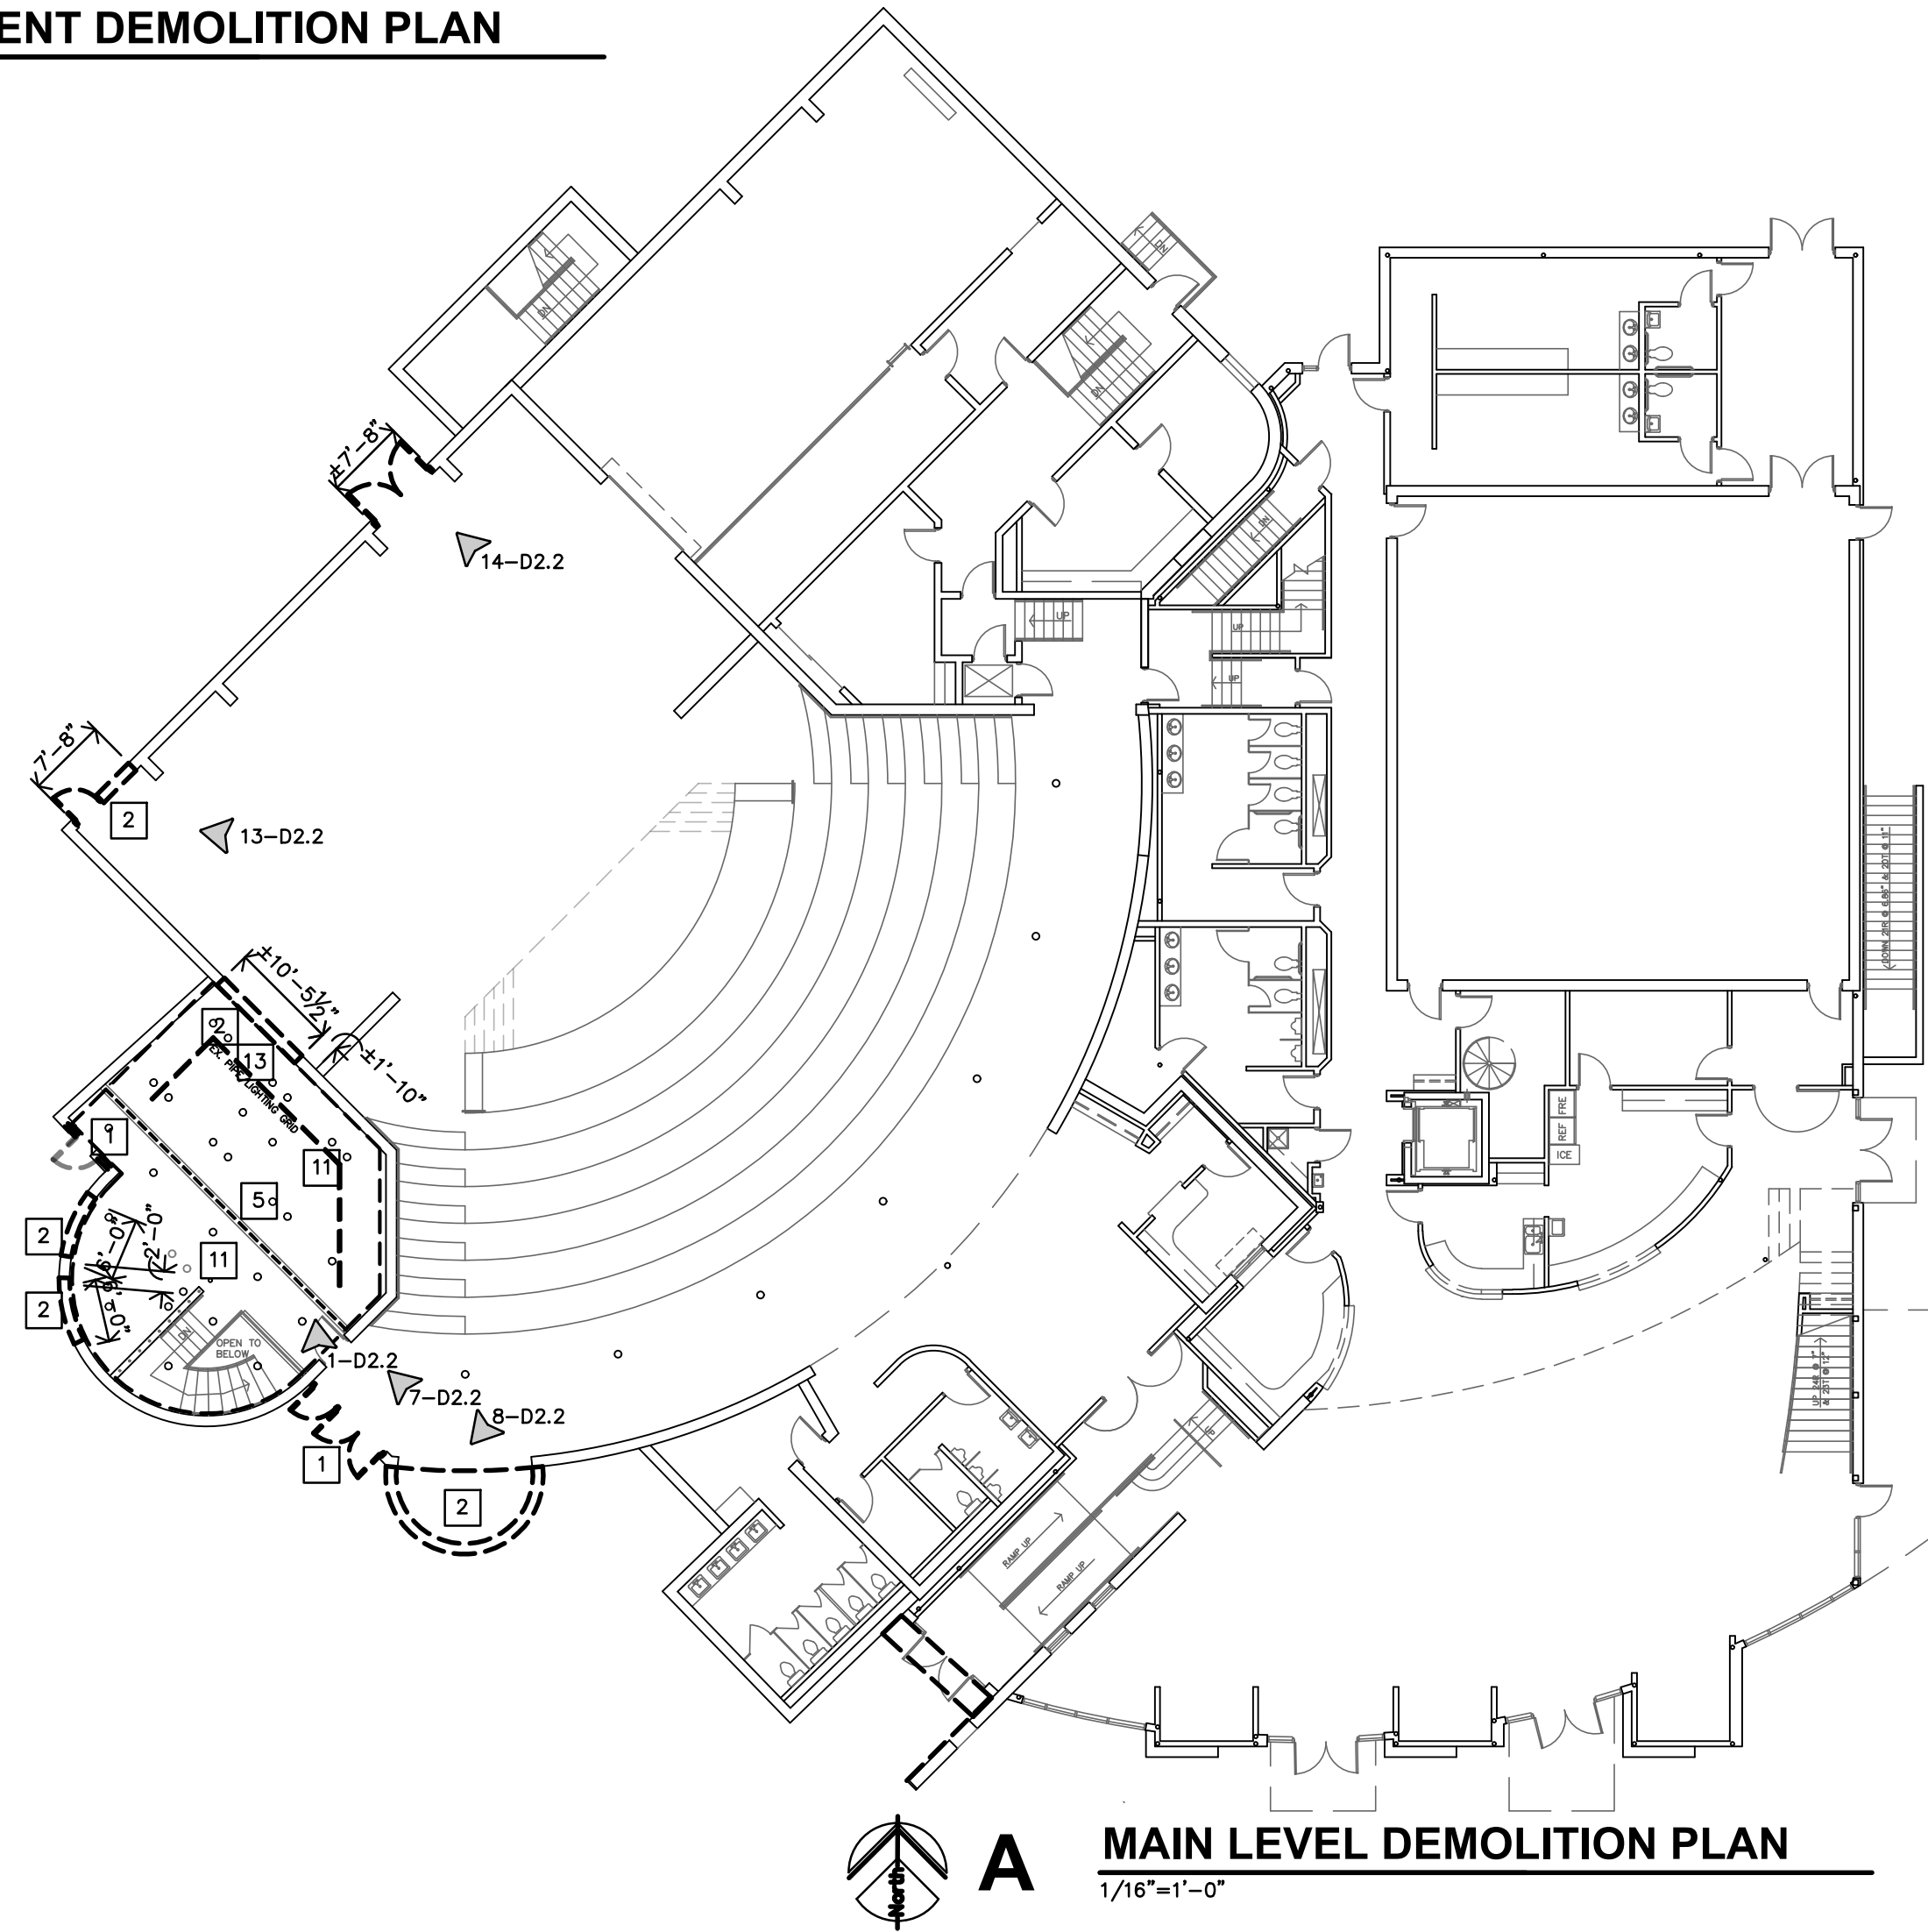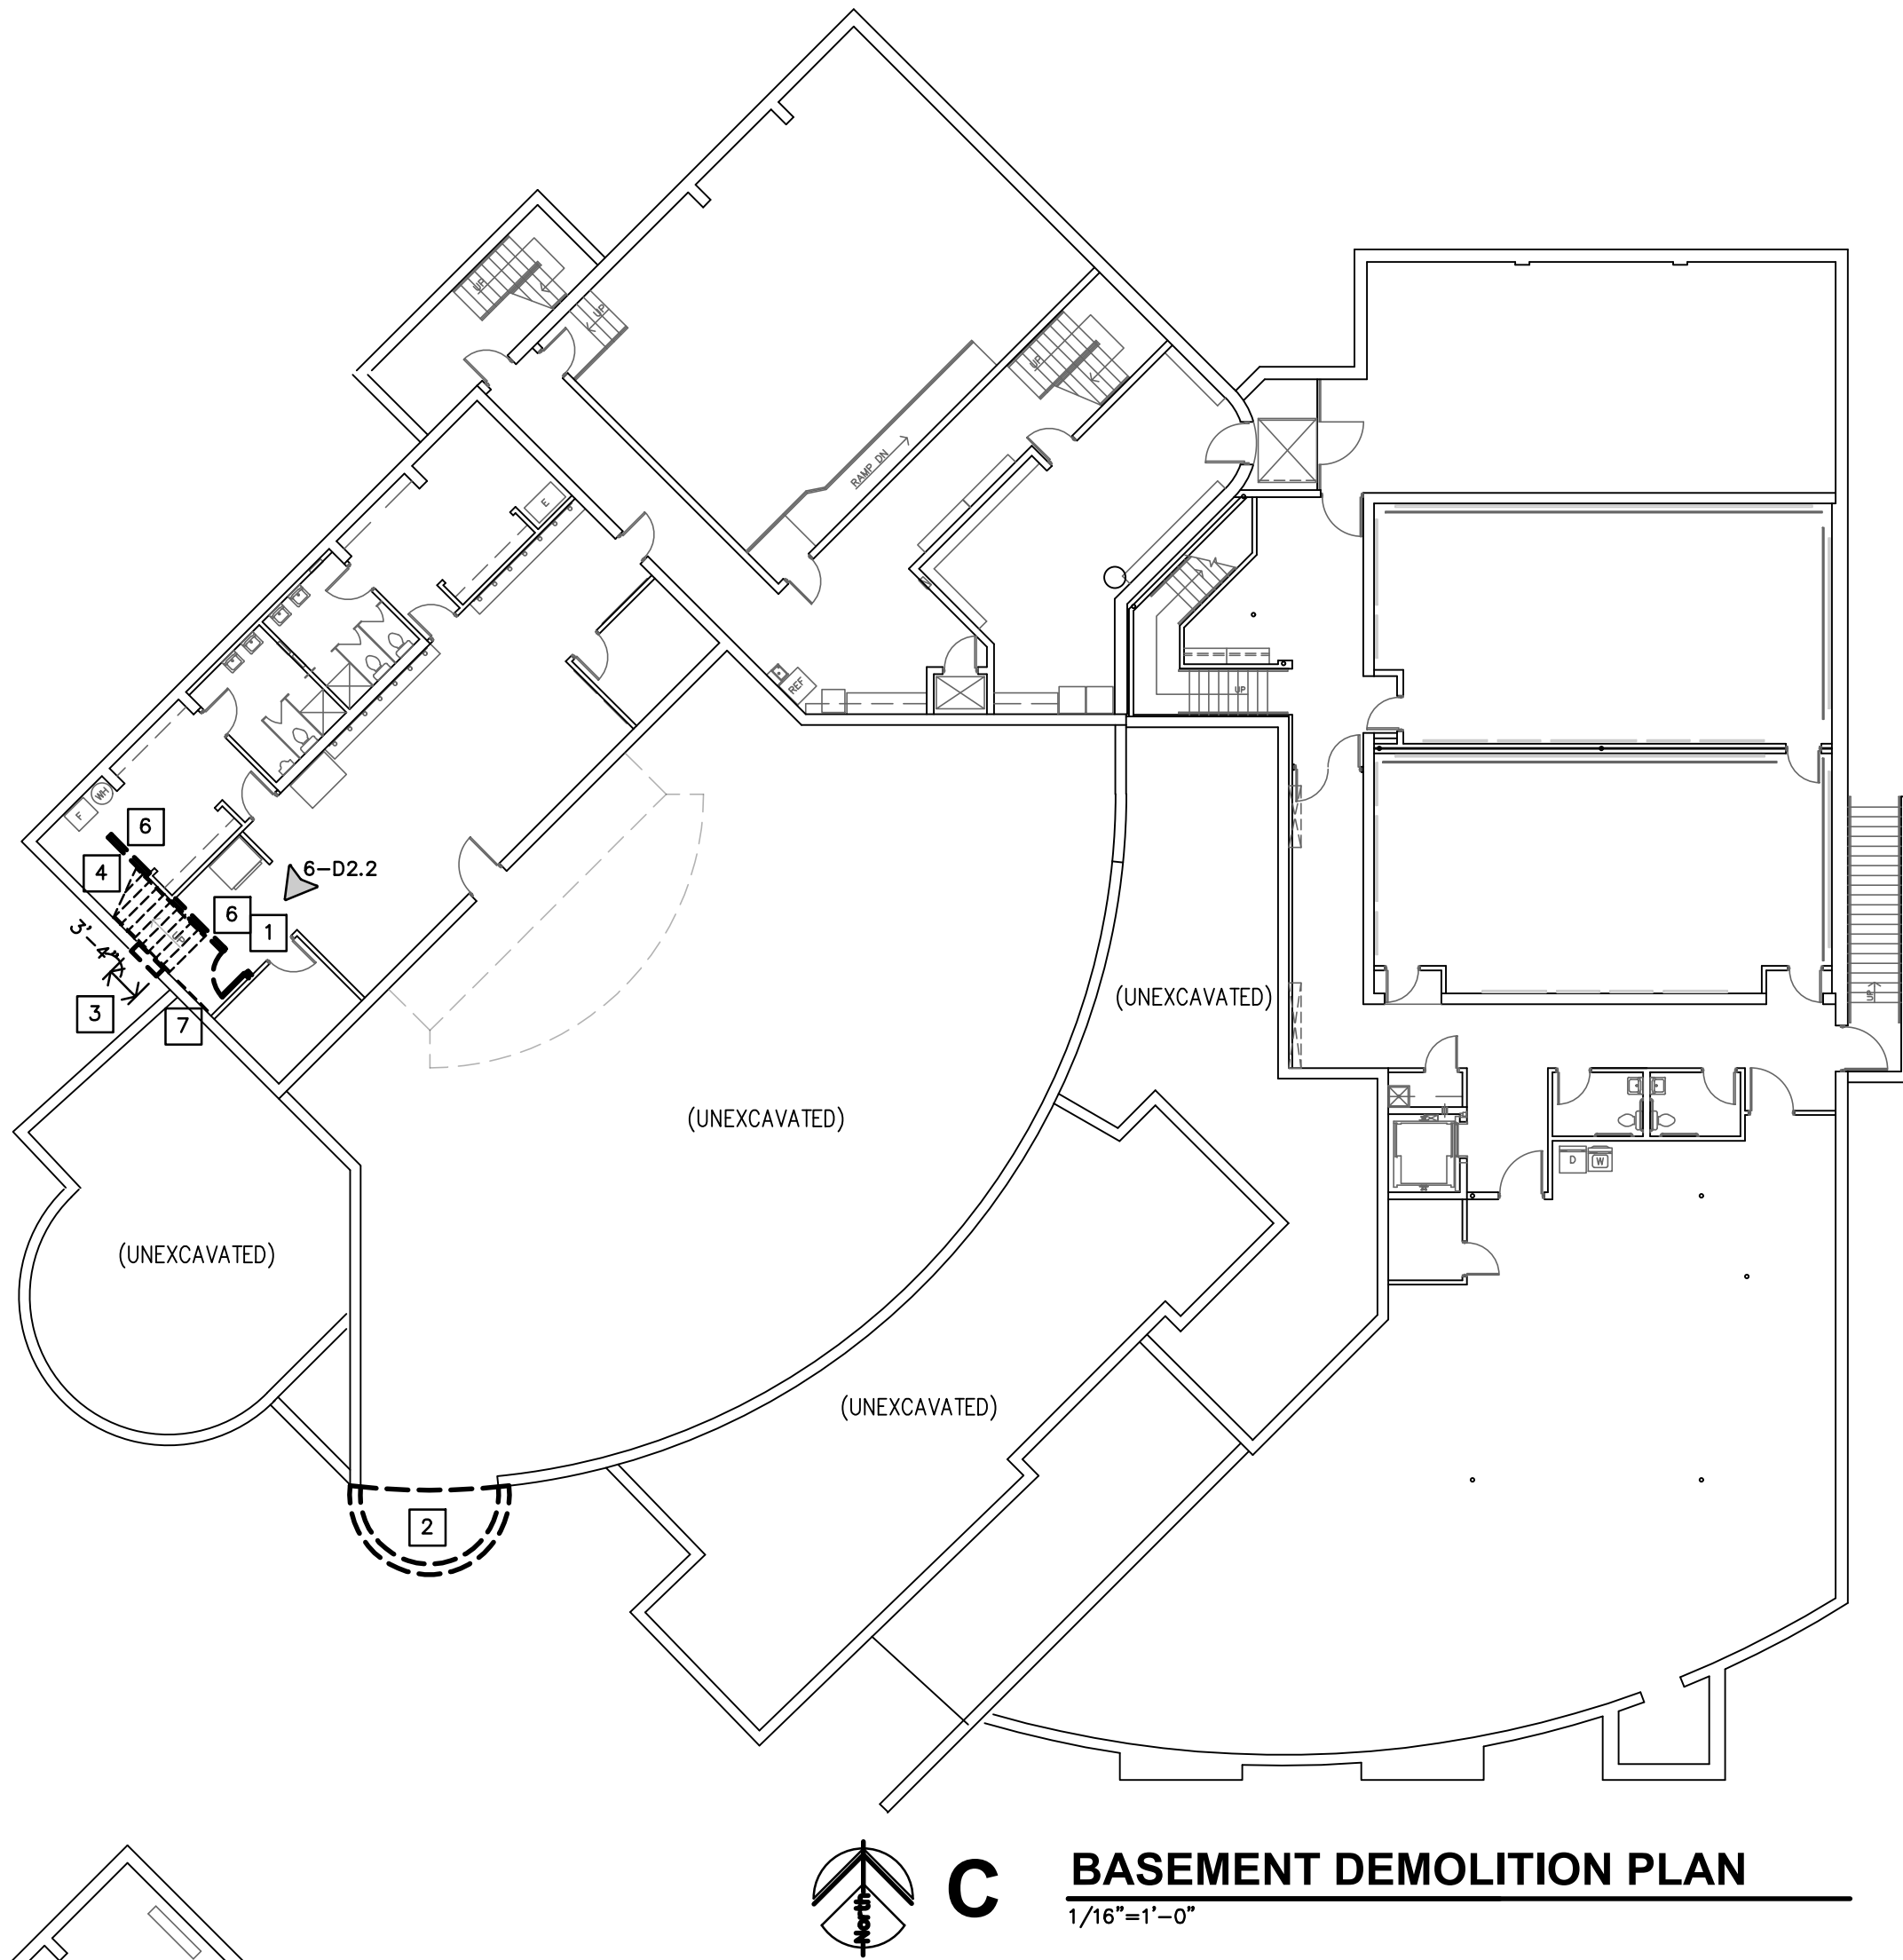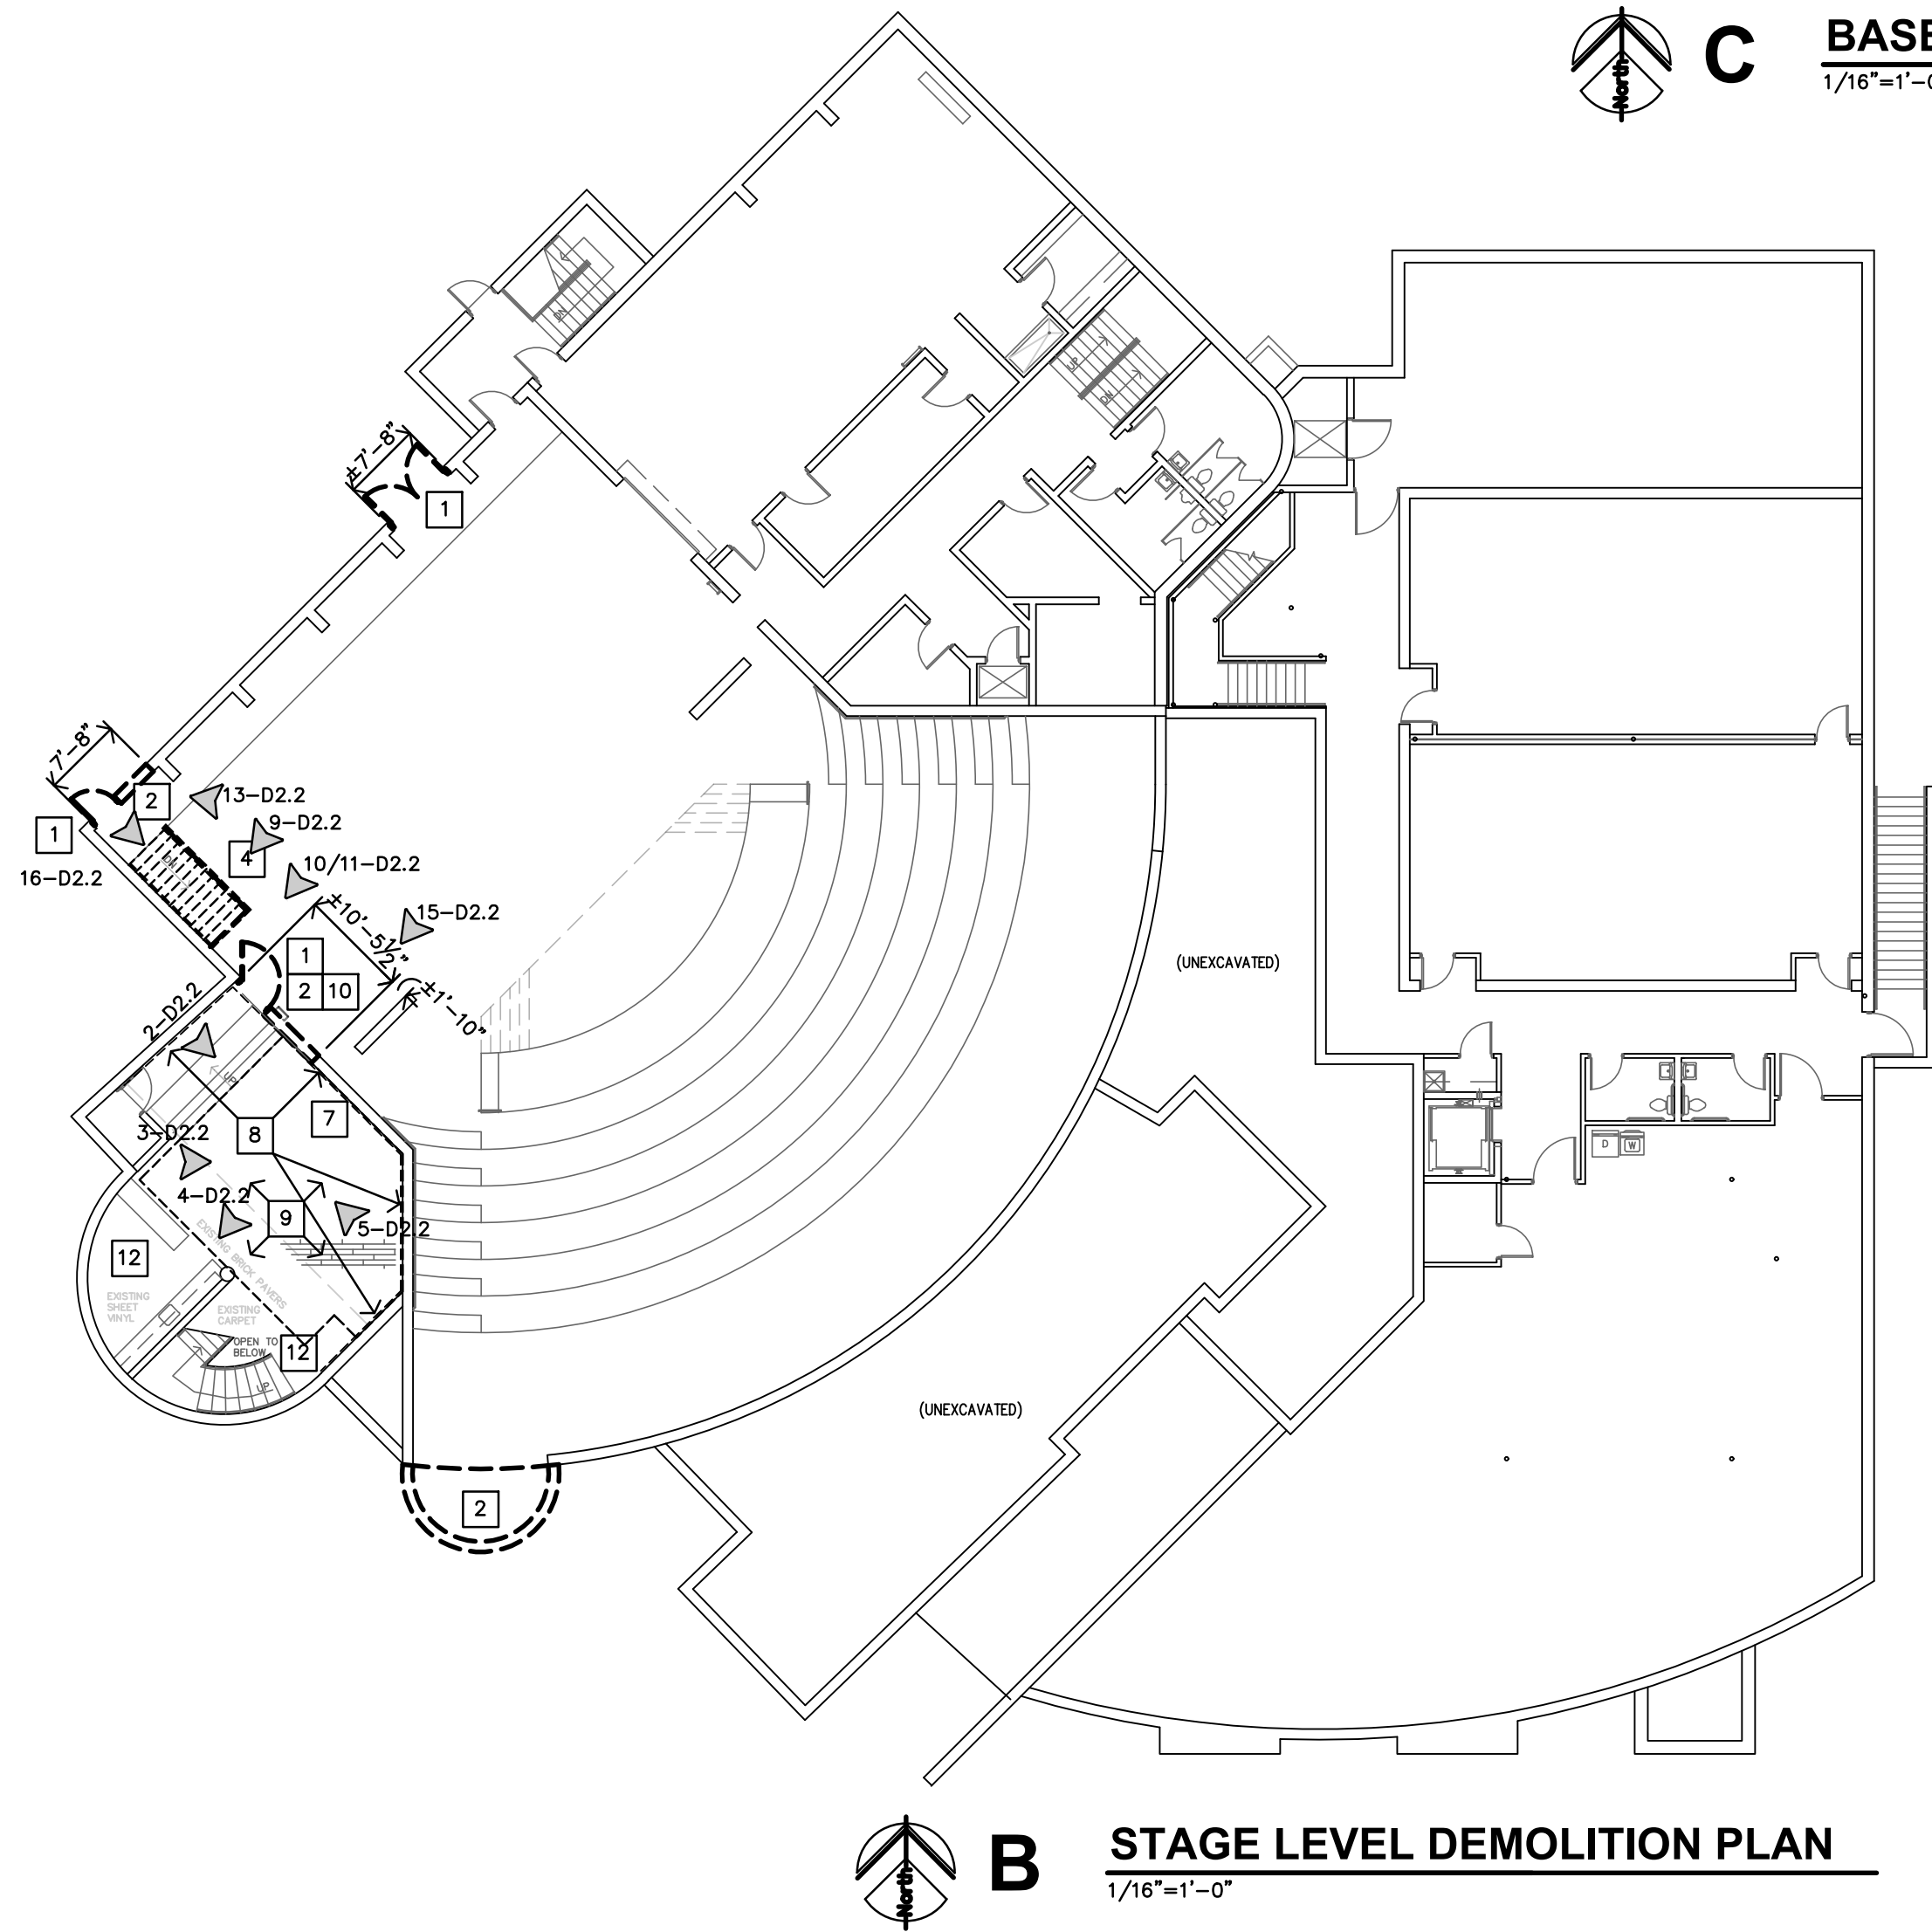


DEMOLITION NOTES	
<b>GENERAL</b>	
1. WHERE EXIST. BLDG. COMPONENTS ARE TO BE REMOVED; PATCH & REPAIR THE SURFACES TO MATCH EXIST. FINISH, UNLESS NEW FINISHES ARE CALLED FOR IN THE FINISH SCHEDULE.	
2. REMOVE EXIST. BLDG. COMPONENTS AS INDICATED, IMPLIED OR AS REQUIRED SCHEMATICALLY SHOWN AS DASHED LINES. FIELD VERIFY ALL LOCATIONS.	
3. THE ELECTRICAL & MECHANICAL CONTRACTORS SHALL BE RESPONSIBLE FOR ALL CORE DRILLING FOR PIPING & CONDUIT INSTALLATION.	
4. ALL OTHER CUTTING, PATCHING & FINISHING, U.N.O. SHALL BE THE RESPONSIBILITY OF THE GENERAL CONTRACTOR.	
5. SHORING OF EXISTING STRUCTURE SHALL BE THE RESPONSIBILITY OF THE GENERAL CONTRACTOR.	
6. NOTIFY ARCHITECT IMMEDIATELY IF ASBESTOS OR OTHER HAZARDOUS MATERIAL IS SUSPECTED ON SITE. DO NOT DISTURB UNLESS DIRECTED.	
7. IT SHALL BE THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO COORDINATE THE DEMOLITION BY DIFFERING TRADES.	
8. CONTRACTOR COORDINATE SCHEDULE & LOCATION OF ANY OR ALL EXISTING RECEPTACLES, SWITCHES, DEVICES, ETC. PRIOR TO DEMOLITION, RELOCATE OR ABANDON ACCORDINGLY.	
9. COORDINATE & REFERENCE MECHANICAL & ELECTRICAL DRAWINGS FOR ADDITIONAL DEMOLITION ITEMS AND DETAILS	
<b>SPECIFIC</b>	
1	REMOVE EXISTING H.M. DOOR & FRAME
2	SAWCUT & REMOVE PORTION OF EXISTING MASONRY WALL
3	SAWCUT & REMOVE PORTION OF EXISTING FOUNDATION WALL
4	REMOVE EXISTING STAIR, RAILING, ETC. PREP OPENING FOR NEW FLOOR INFILL TO MATCH EXIST.
5	REMOVE EXISTING RAILING. PREP OPENING FOR NEW WALL INFILL.
6	REMOVE EXISTING STUD & G.B. WALL.
7	REMOVE EXISTING WALL MOUNTED MIRROR.
8	REMOVE EXISTING WALL MOUNTED SOUND ABSORBING MATERIAL.
9	REMOVE EXISTING WOOD PLATFORM. BRICK PAVERS & STEPS TO REMAIN.
10	REMOVE & SALVAGE EXISTING WALL MOUNTED LADDER.
11	REMOVE EXISTING SUSP. ACOUS. CLG. TILE & GRID.
12	REMOVE EXISTING FLOORING & BASE. PREP FOR NEW.
13	SAWCUT/CHIP OUT & REMOVE PORTION OF EXISTING CONCRETE FOR SMOOTH TRANSITION @ REMOVED WALL.
14	
15	



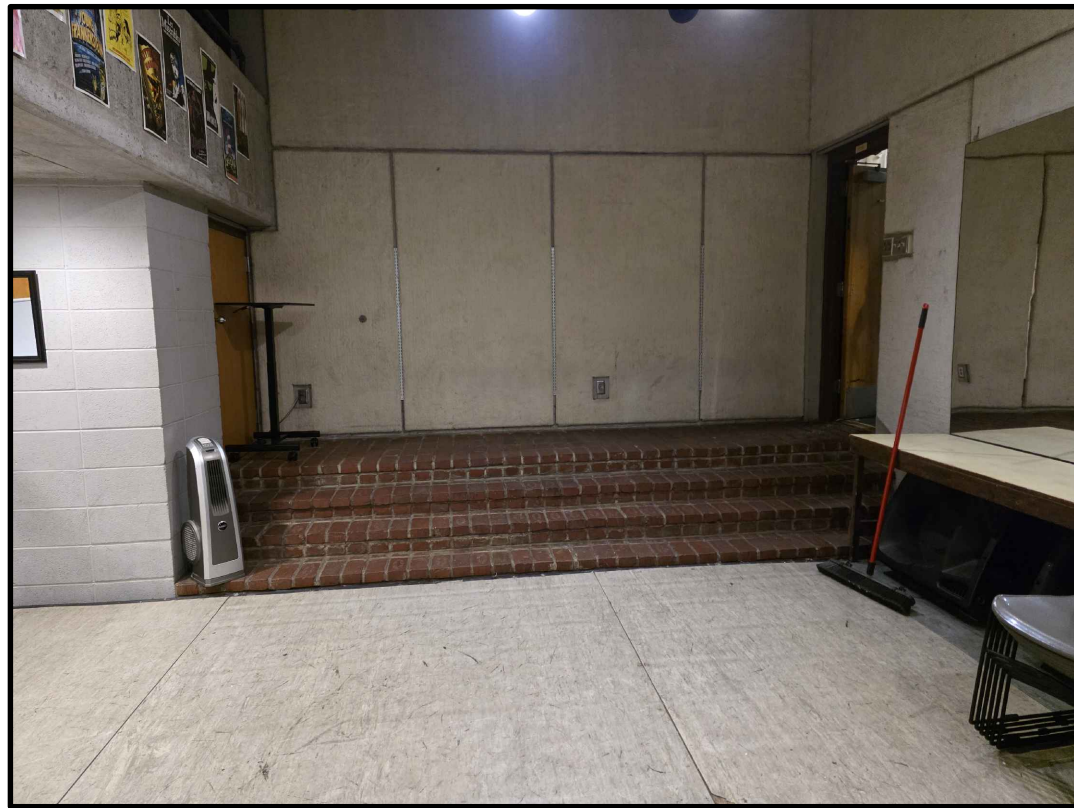

5 PHOTOGRAPH  
NO SCALE

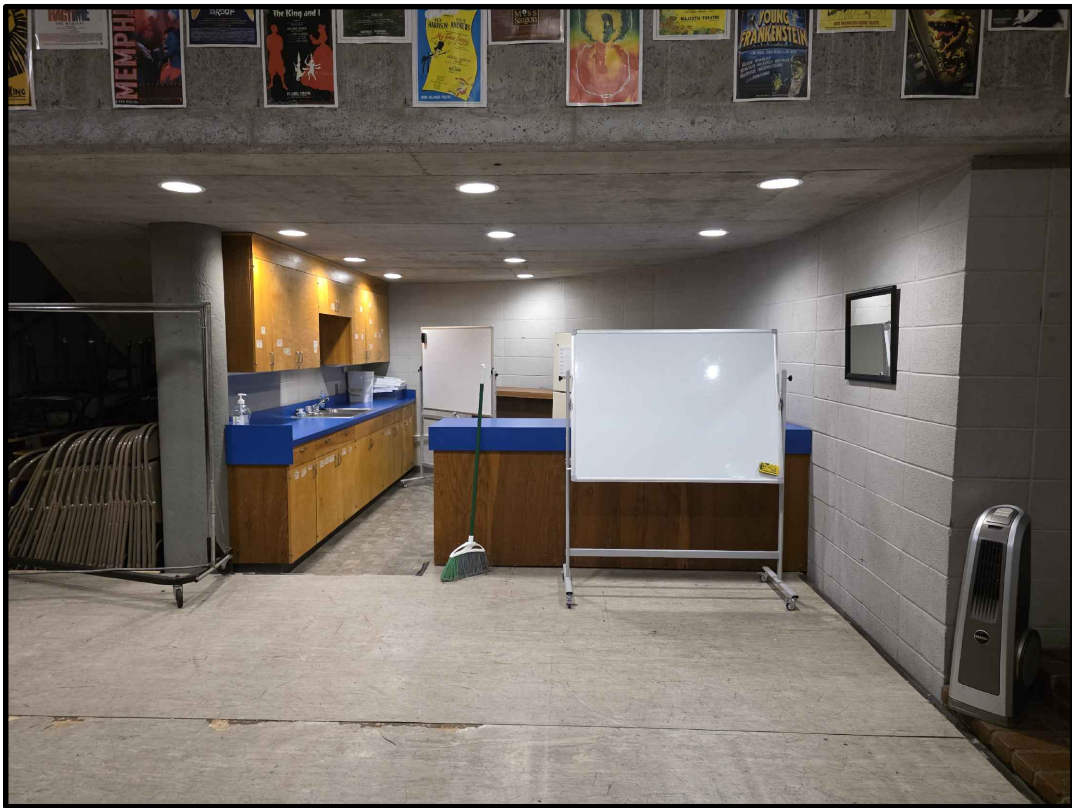


4 PHOTOGRAPH  
NO SCALE




3 PHOTOGRAPH  
NO SCALE



2 PHOTOGRAPH  
NO SCALE

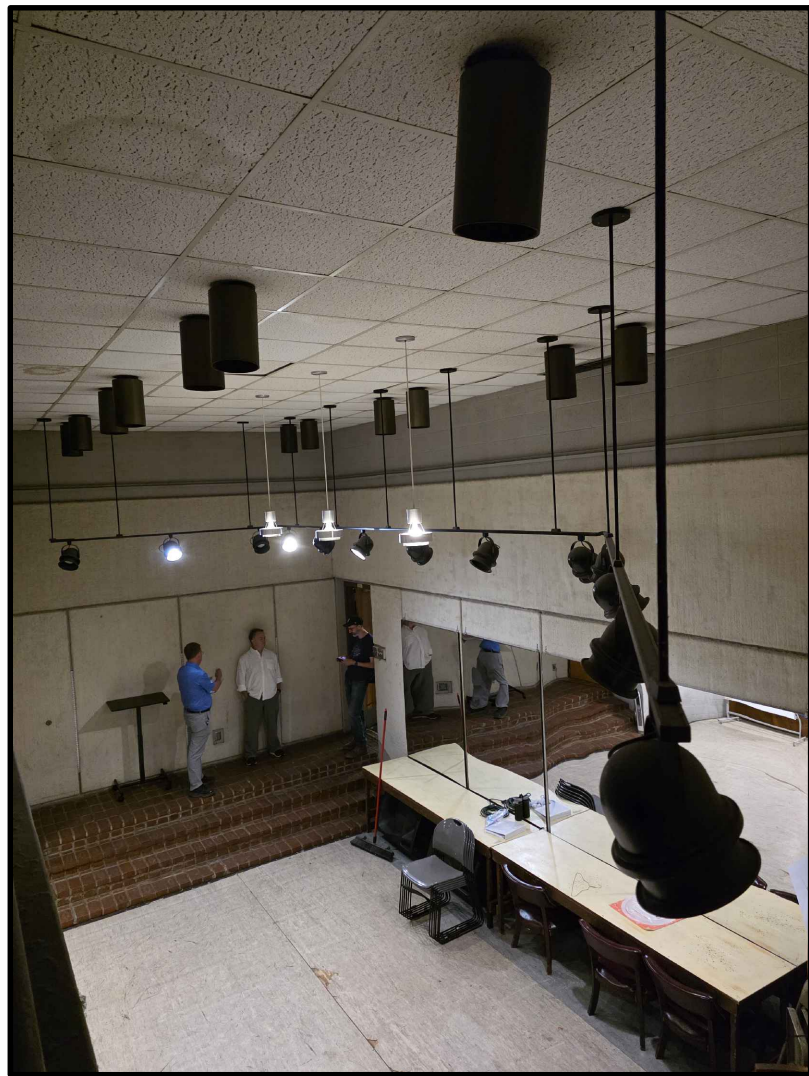

1 PHOTOGRAPH  
NO SCALE

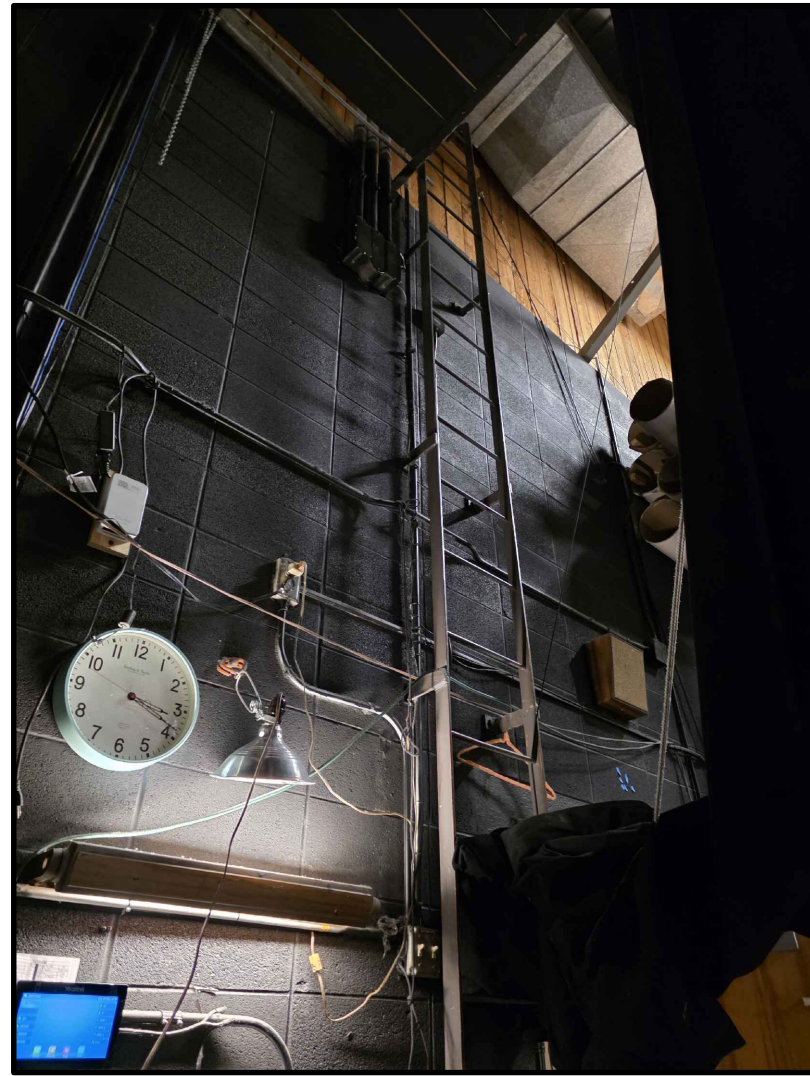


11 PHOTOGRAPH  
NO SCALE




10 PHOTOGRAPH  
NO SCALE



9 PHOTOGRAPH  
NO SCALE

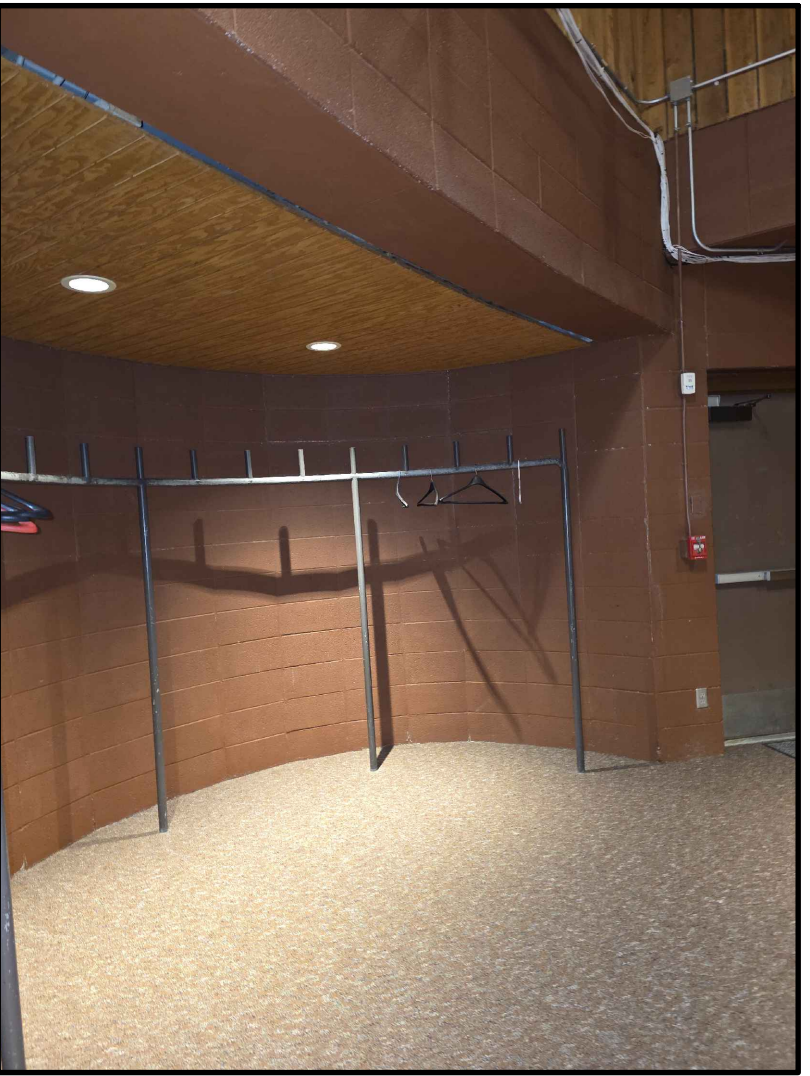


8 PHOTOGRAPH  
NO SCALE

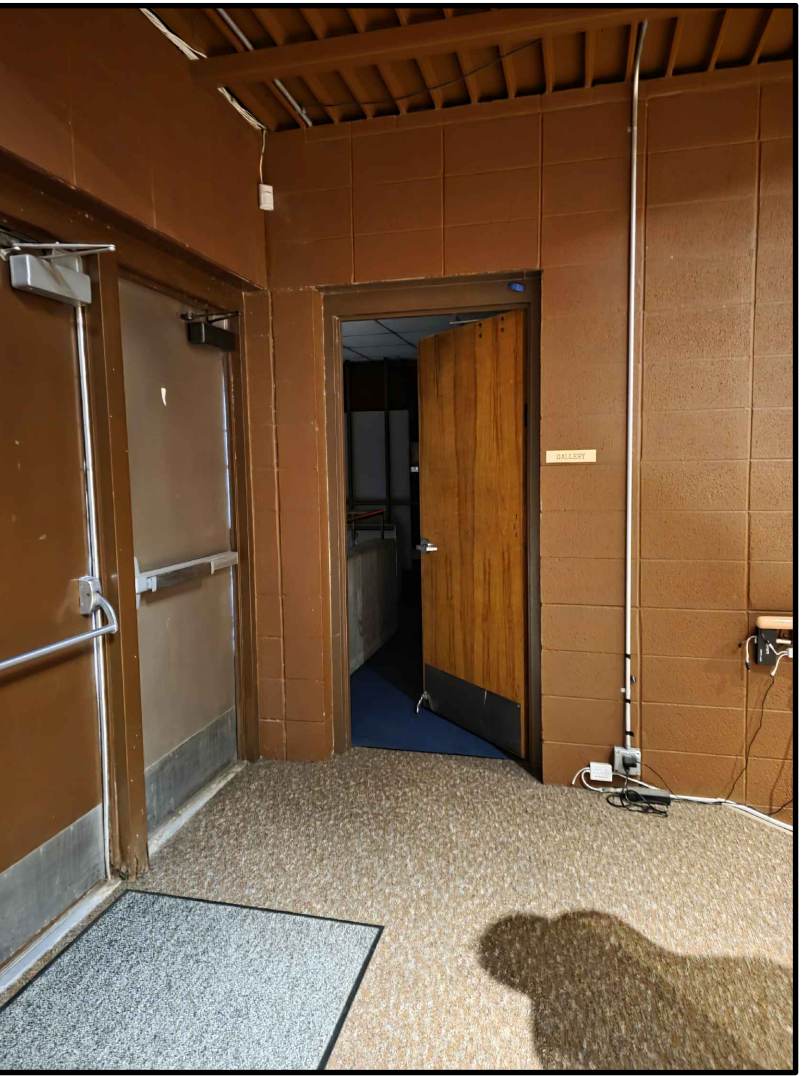

7 PHOTOGRAPH  
NO SCALE




6 PHOTOGRAPH  
NO SCALE

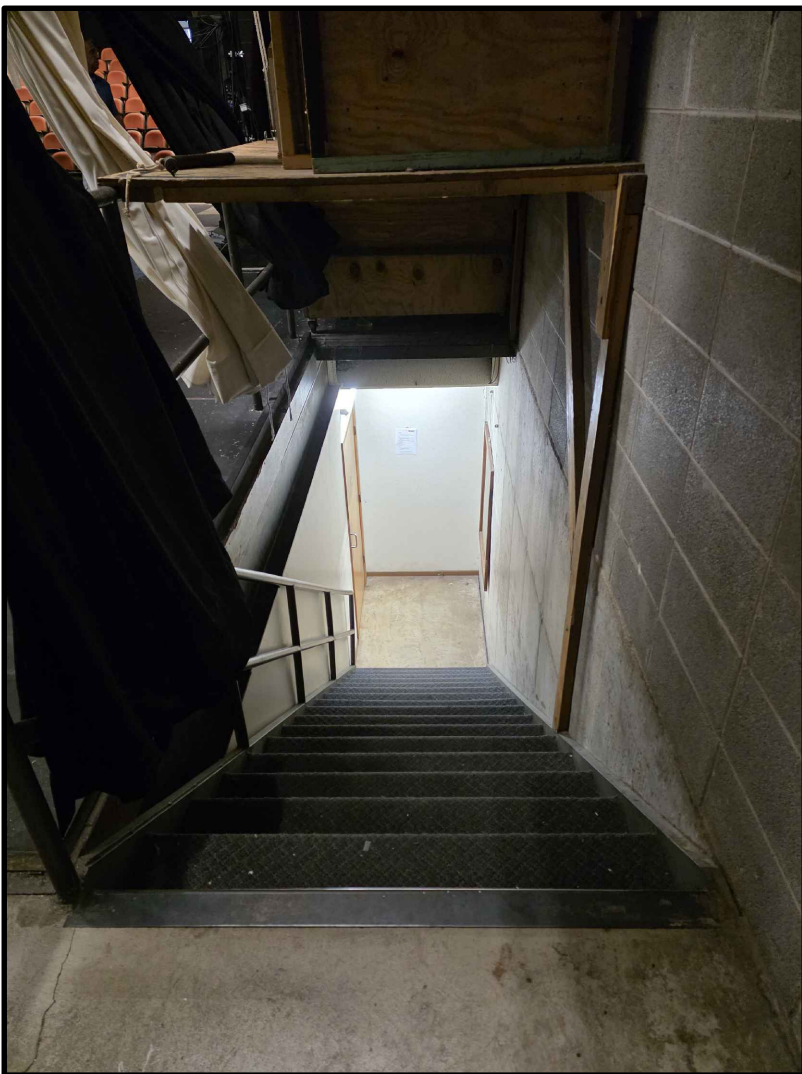

16 PHOTOGRAPH  
NO SCALE



15 PHOTOGRAPH  
NO SCALE

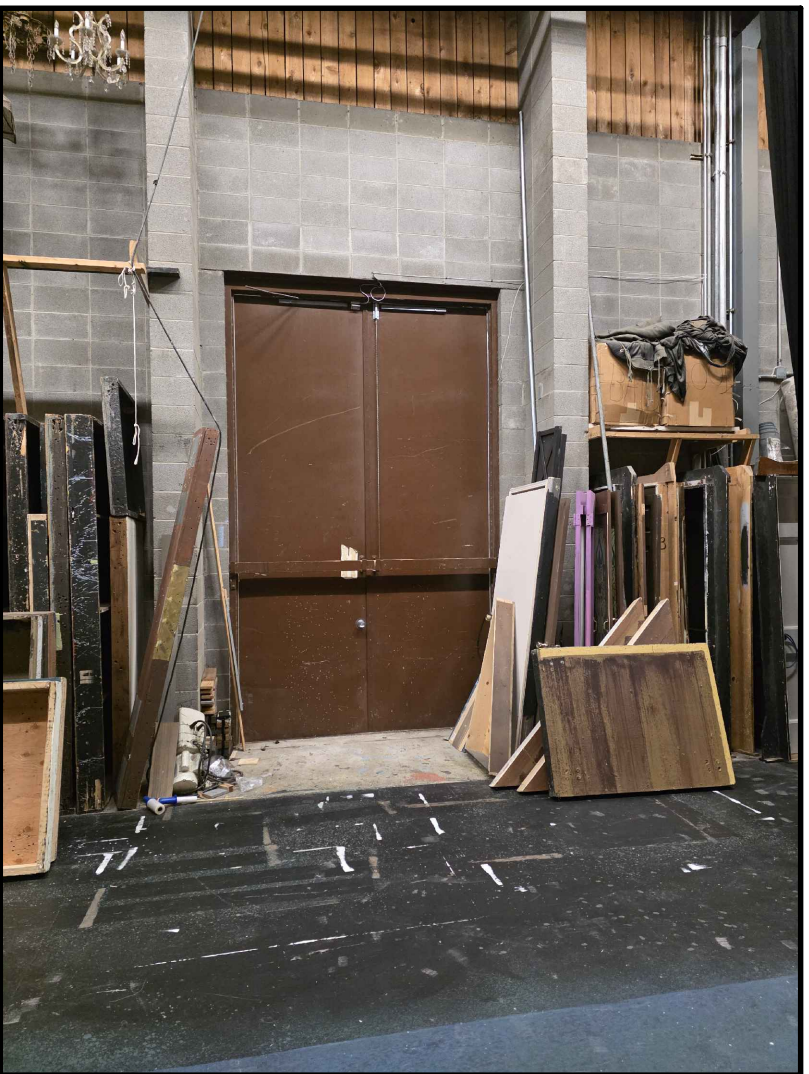

14 PHOTOGRAPH  
NO SCALE




13 PHOTOGRAPH  
NO SCALE




12 PHOTOGRAPH  
NO SCALE



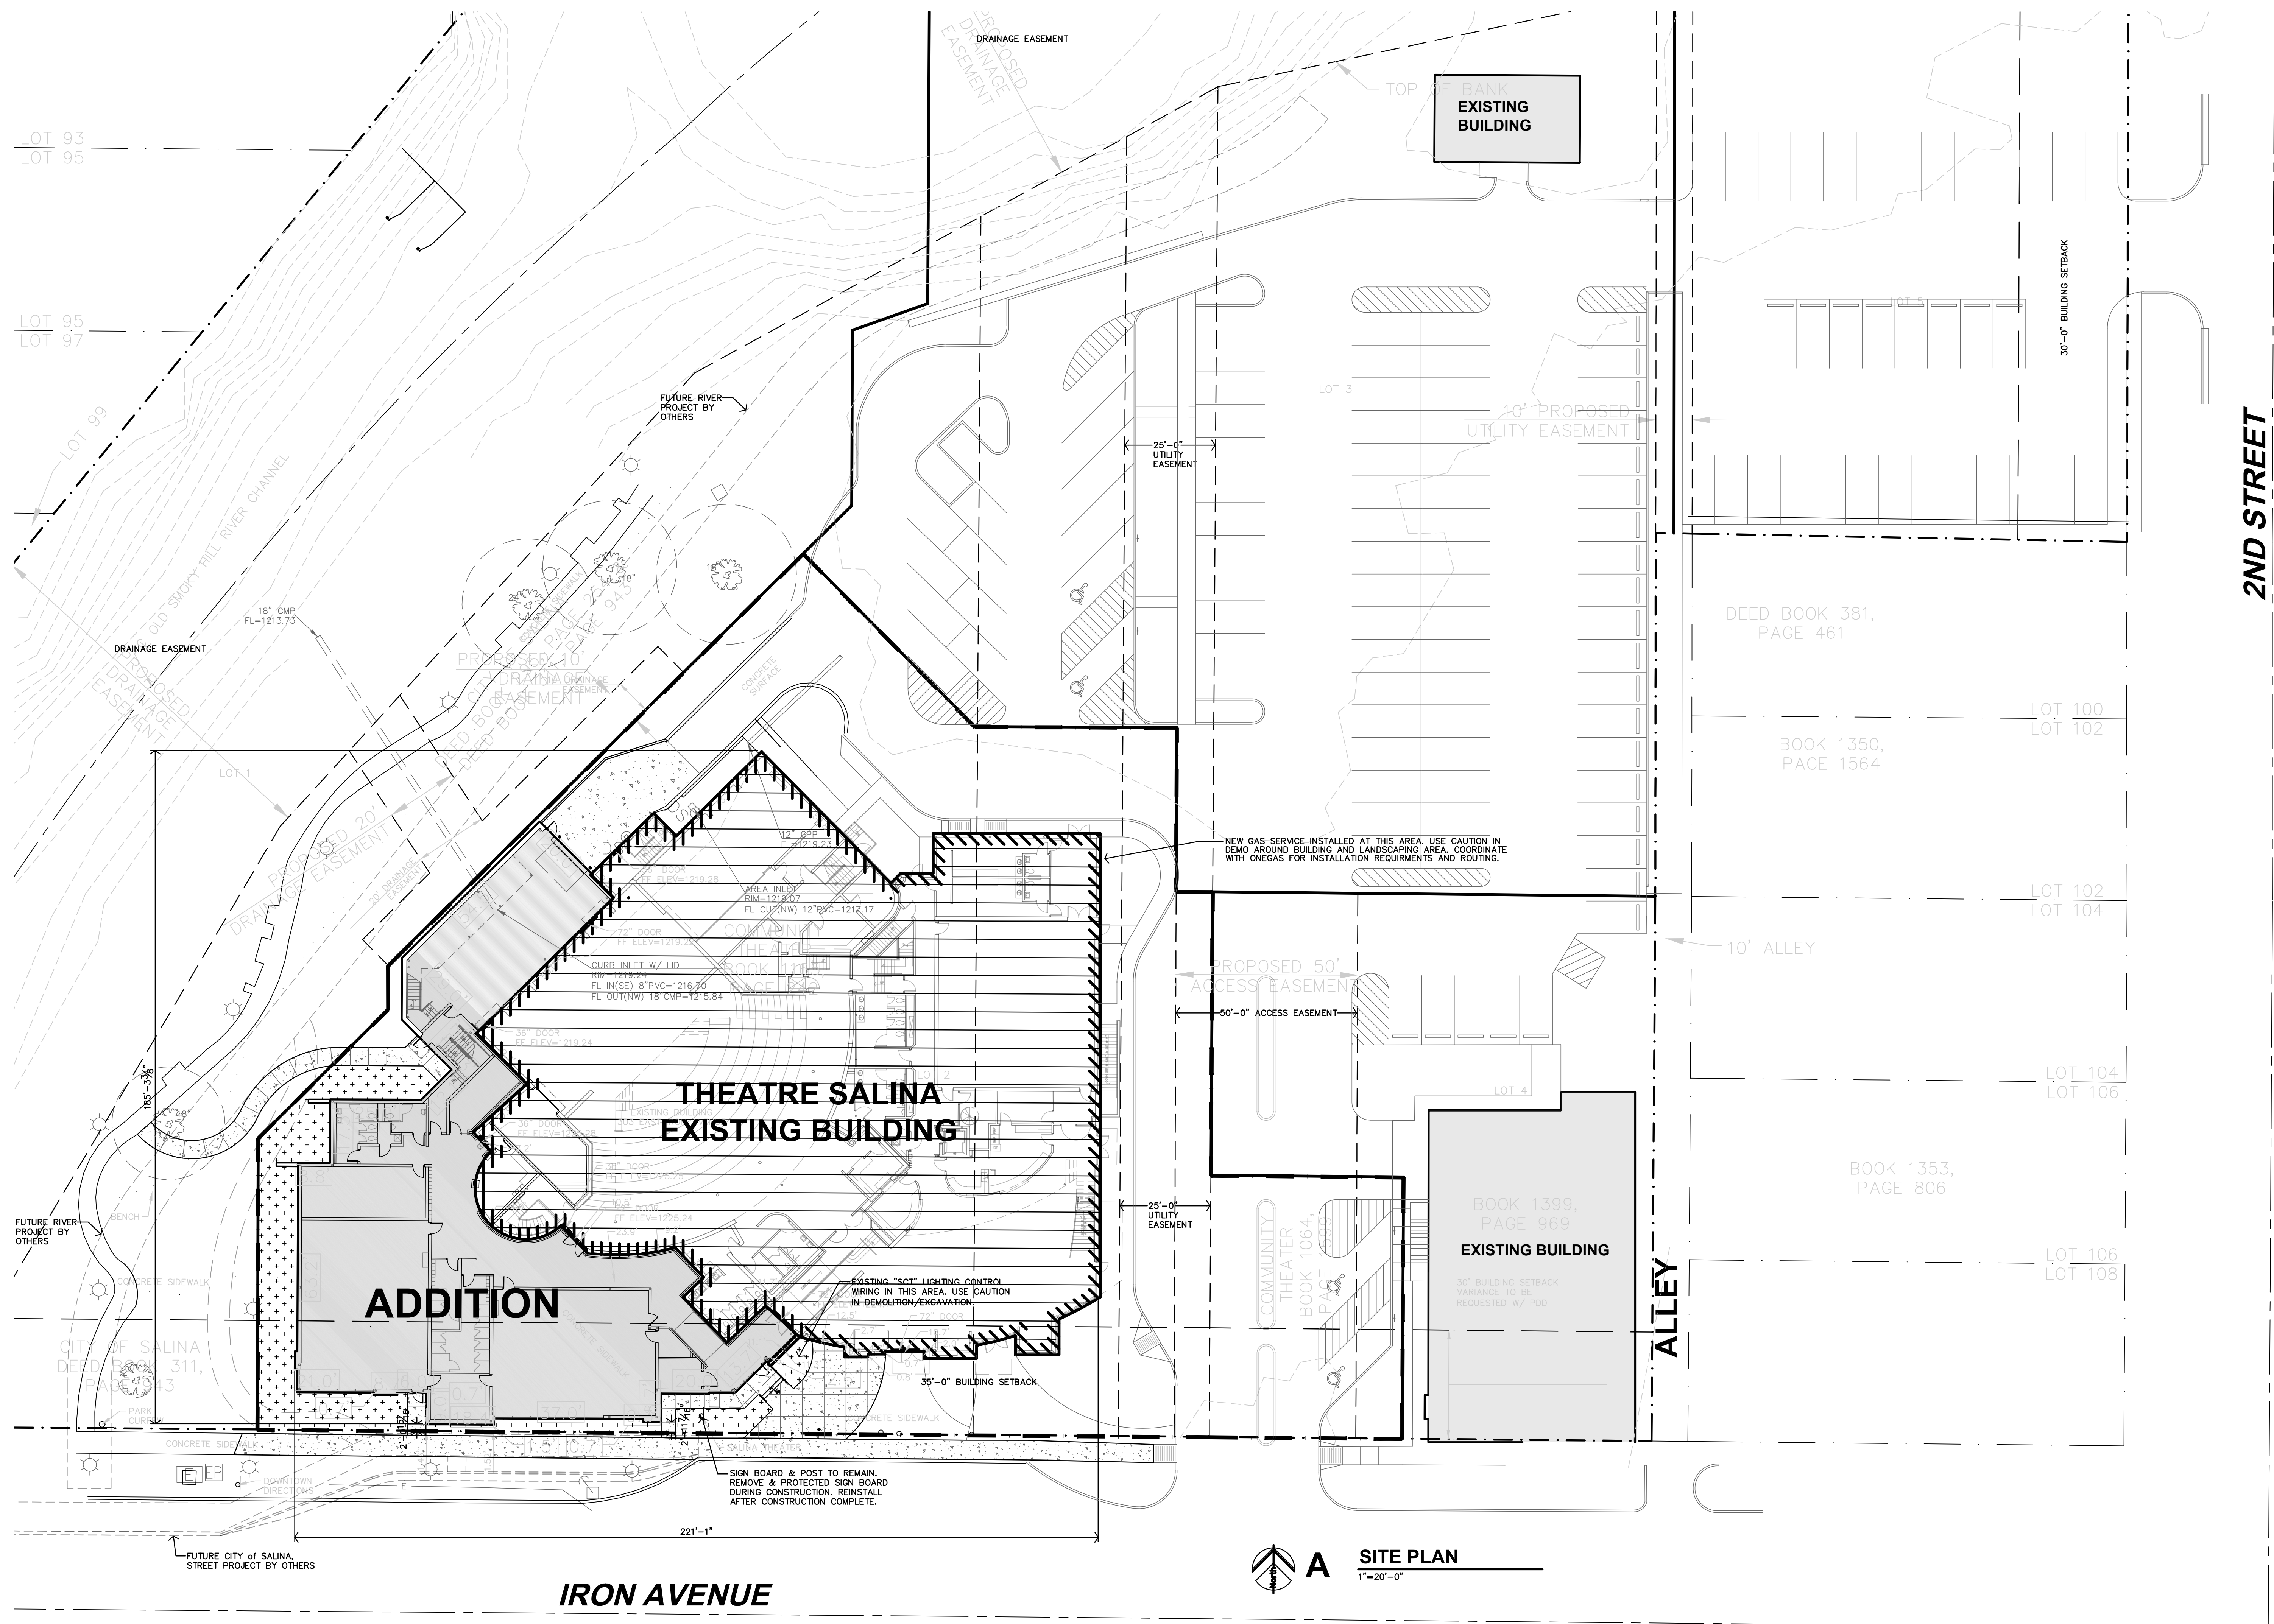




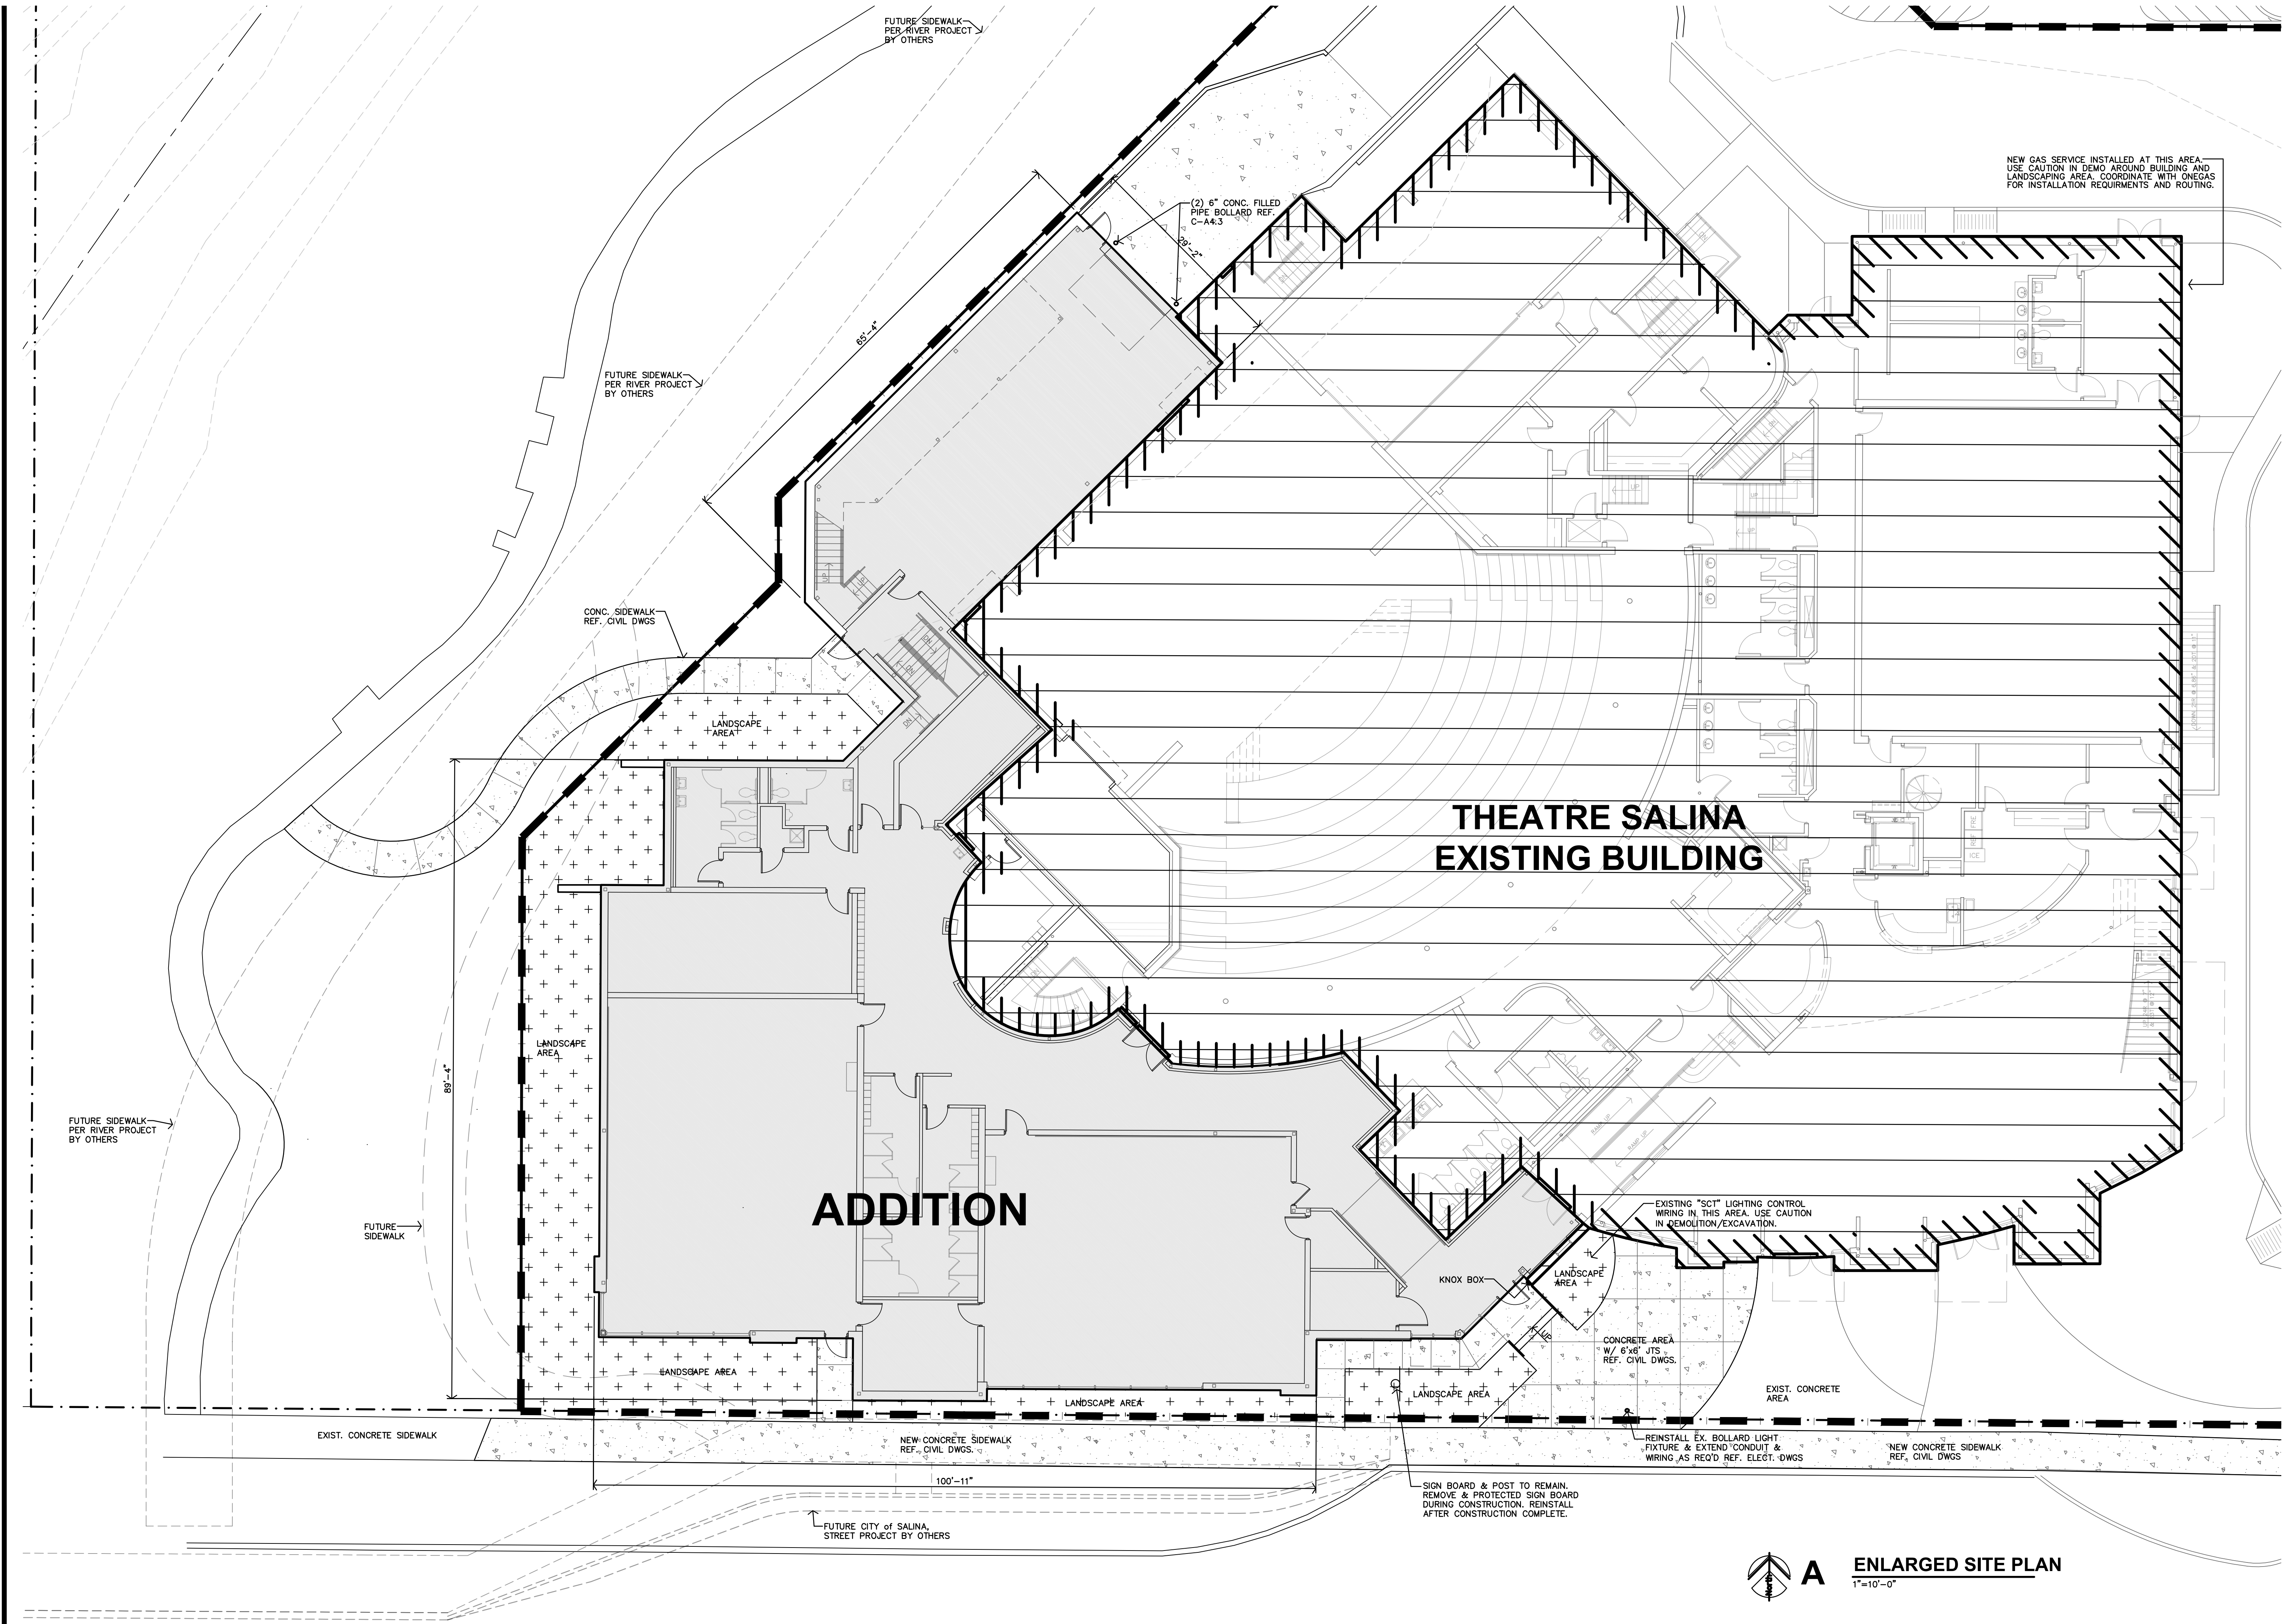

JonesGillamRenz  
1881 Main Street, Suite 301  
Kansas City, MO 64108  
jgr@jgarchitects.com




**THEATRE SALINA**  
DANCE STUDIOS & SCENE SHOP EXPANSION  
SALINA, KANSAS

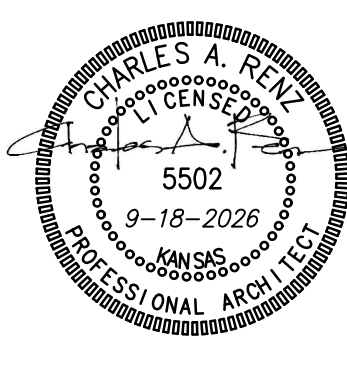

REVISION:	
DATE:	9-18-2026
JOB:	22-3239
SHEET NO.:	

**A1.2**

COPYRIGHTED ©

 **A** **ENLARGED SITE PLAN**  
1"=10'-0"



The diagrams illustrate four different exterior wall assembly configurations:

- Diagram 1 (Left):** Shows a wall assembly with liquid applied air/vapor barrier and 5/8" dens glass sheathing. The insulation consists of 1 1/2" cont. rigid insul. and 2" furring strips. The cavity is filled with wood cladding (ipe rainscreen). The exterior finish is 6" batt insul. and 8" mtl studs. The interior finish is 5/8" type x g.b. The total thickness is 1'-0 1/2".
- Diagram 2 (Second from Left):** Shows a wall assembly with liquid applied air/vapor barrier and 5/8" dens glass sheathing. The insulation consists of 1 1/2" cont. rigid insul. and 2" furring strips. The cavity is filled with wood cladding (ipe rainscreen). The exterior finish is 6" batt insul. and 8" mtl studs. The interior finish is 5/8" type x g.b. The total thickness is 1'-0 1/2".
- Diagram 3 (Third from Left):** Shows a wall assembly with liquid applied air/vapor barrier and 5/8" dens glass sheathing. The insulation consists of 1 1/2" cont. rigid insul. and 2" furring strips. The cavity is filled with 1" air space and a fluted cmu ref. struct. The exterior finish is 6" batt insul. and 8" mtl studs. The interior finish is 5/8" type x g.b. The total thickness is 1'-4".
- Diagram 4 (Right):** Shows a wall assembly with liquid applied air/vapor barrier and 5/8" dens glass sheathing. The insulation consists of 1 1/2" cont. rigid insul. and 2" furring strips. The cavity is filled with pre-fin. mtl wall panels. The exterior finish is 6" batt insul. and 8" mtl studs. The interior finish is 5/8" type x g.b. The total thickness is 1'-0 1/2".

1. CONTRACTOR SHALL FIELD VERIFY ALL DIMENSIONS & CONDITIONS.
2. IF THERE IS A DISCREPANCY BETWEEN DRAWINGS AND FIELD CONDITIONS NOTIFY ARCHITECT PRIOR TO PROCEEDING WITH WORK SO THAT ISSUES CAN BE CLARIFIED.
3. ALL WORK SHALL BE IN CONFORMANCE W/ APPLICABLE BUILDING CODES & ORDINANCES.
4. ALL NEW CONSTRUCTION SHALL BE IN CONFORMANCE TO ADA REQUIREMENTS. REFERENCE ADA FOR TYPICAL MINIMUM CLEARANCE REQ'D.
5. INSTALL MATERIALS AND/OR FINISHES AS INDICATED, IMPLIED OR AS REQUIRED FOR COMPLETE & FINISHED INSTALLATION.
6. ALL NEW DOOR HANDLES SHALL BE LEVEL LATCH SETS UNLESS OTHERWISE NOTED OTHERWISE W/ MFR FOR ADA INSTALLATION REQUIREMENTS. COORDINATE KEYING REQUIREMENTS WITH OWNER.
7. DOORS ARE TYPICALLY LOCATED WITH HINGE-SIDE JAMB 4" FROM ADJACENT WALLS UNLESS NOTED OTHERWISE OR REQUIRED TO MEET LATCH-SIDE CLEARANCE PER ADA.
8. DIMENSIONS TO NEW INTERIOR WALLS ARE TO THE FACE OF G.B. UNO.
9. ALL FURNITURE SHOWN IS TO BE PROVIDED BY OWNER.
10. FEC - INDICATES NEW RECESSED FIRE EXTINGUISHER CABINET.
11. CG - INDICATES LOCATION OF FULL HEIGHT CORNER GUARDS.

#1 - INSTALL EIFS @ THE DANCE STUDIO ADDITION FACADE IN LIEU OF ACM PANELS

#2 - ELIMINATING THE PAINTING THE STEEL STRUCTURE, & DUCTWORK, CONDUIT, PIPING, ETC. AT THE SCENE SHOP ADDITION

#3 - EIFS SYSTEM WARRANTY OF 20 YEARS

#4 - DANCE STUDIO FLOOR

- ALL G.B. WALLS FULL HEIGHT TO B.O. DECK, U.N.O.

**1** **TYPE 1**  
TYPICALLY DIMENSIONED AS 5" ON PLANS

**2** **TYPE 2**  
TYPICALLY DIMENSIONED AS 8" ON PLANS

**3** **TYPE 3**  
TYPICALLY DIMENSIONED AS 5" ON PLANS

**4** **TYPE 4**  
2hr RATED  
TYPICALLY DIMENSIONED

**5** **TYPE 5**  
STC RATING: 60


**6** **TYPE 6**  
STC RATING: 60

Diagram illustrating the cross-section of a wall assembly, showing the following components and dimensions:

- 2hr 1" LINER PANEL
- 2 LAYERS 5/8" TYPE X G.B.
- 2 1/2" H-STUDS & 2hr LINER PANEL
- FILL VOID W/ BATT INSUL.
- 1'-0" (Overall height dimension)
- STL COLUMN REF. STRUCT.
- ADJACENT WALL

5/8" TYPE X G.B.  
2 1/2" MTL STUDS @ 16" O.C.  
3" BATT INSULATION  
4"  
ADJACENT WALL

5/8" TYPE X G.B.  
3 5/8" MTL STUDS  
@ 16" O.C.  
5"  
ADJACENT WALL

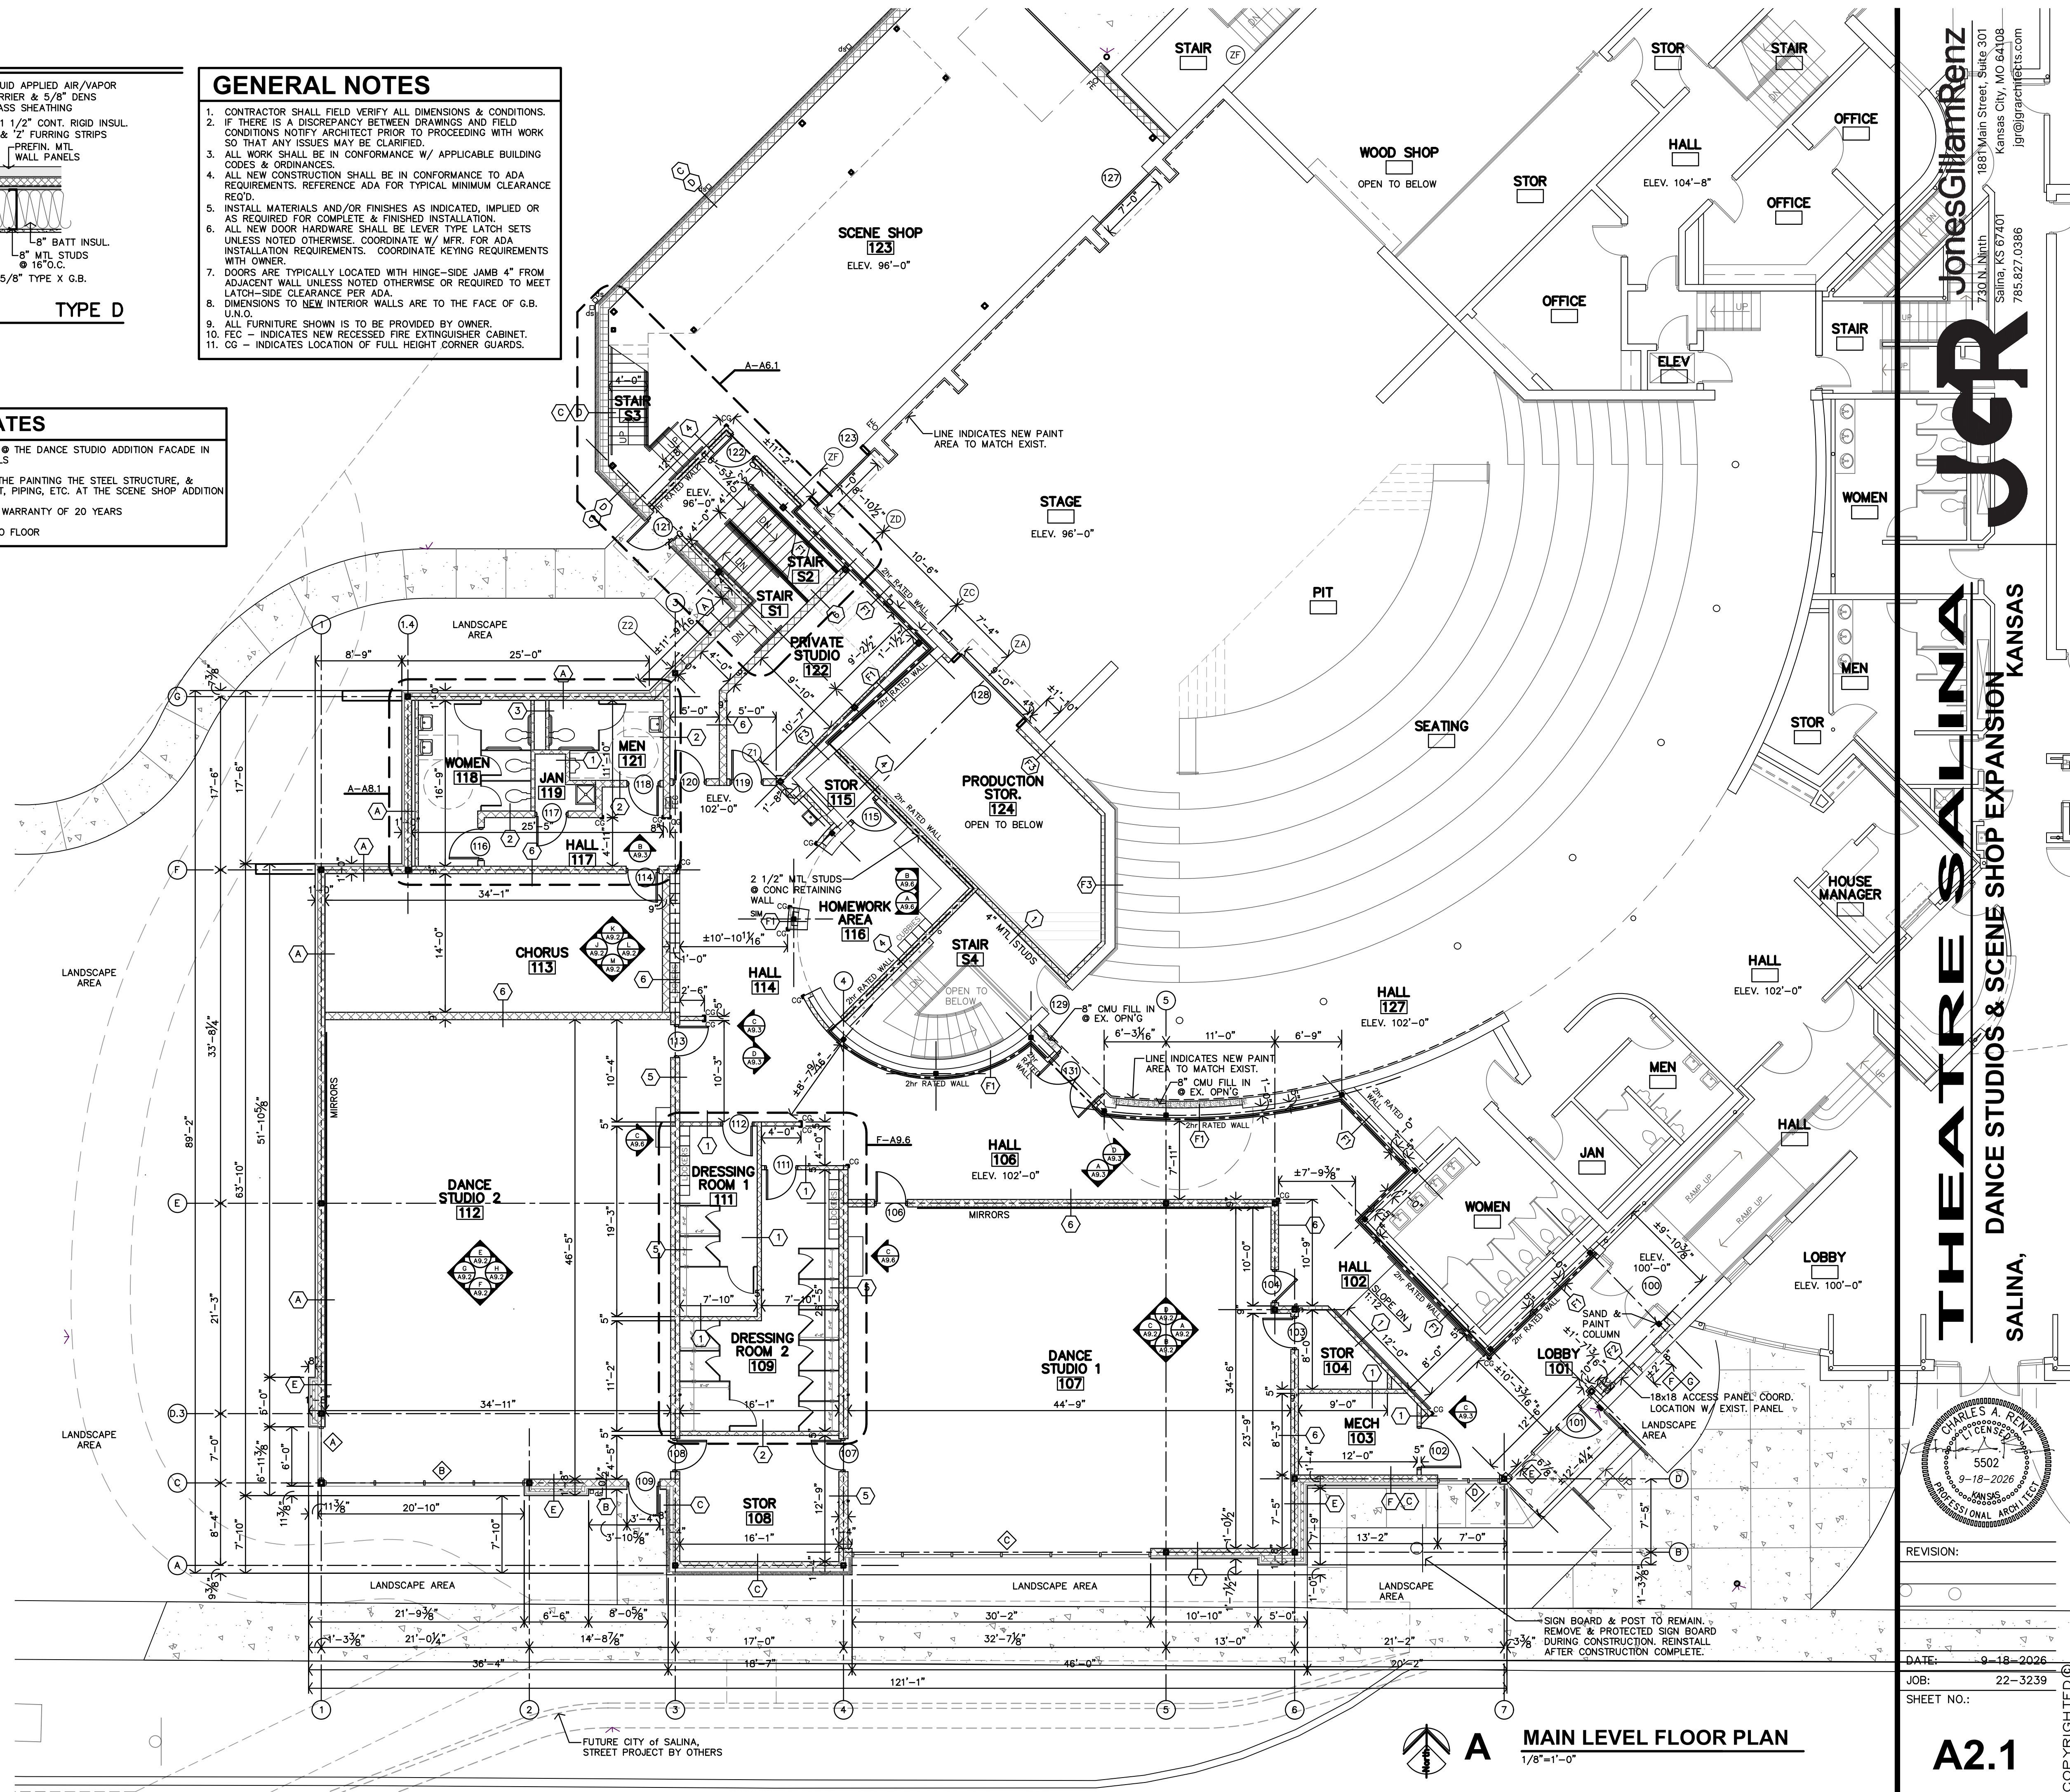

**Jones Gilliam Renz**  
730 N. Ninth  
Salina, KS 67401  
785-827.0386  
1881 Main Street, Suite 301  
Kansas City, MO 64108  
jgr@jgrarchitects.com

**THEATRE SALINA**  
DANCE STUDIOS & SCENE SHOP EXPANSION  
SALINA, KANSAS

ON:

9-18-2026


22-3239

NO.:


## A2.1



EXTERIOR PARTITION TYPES

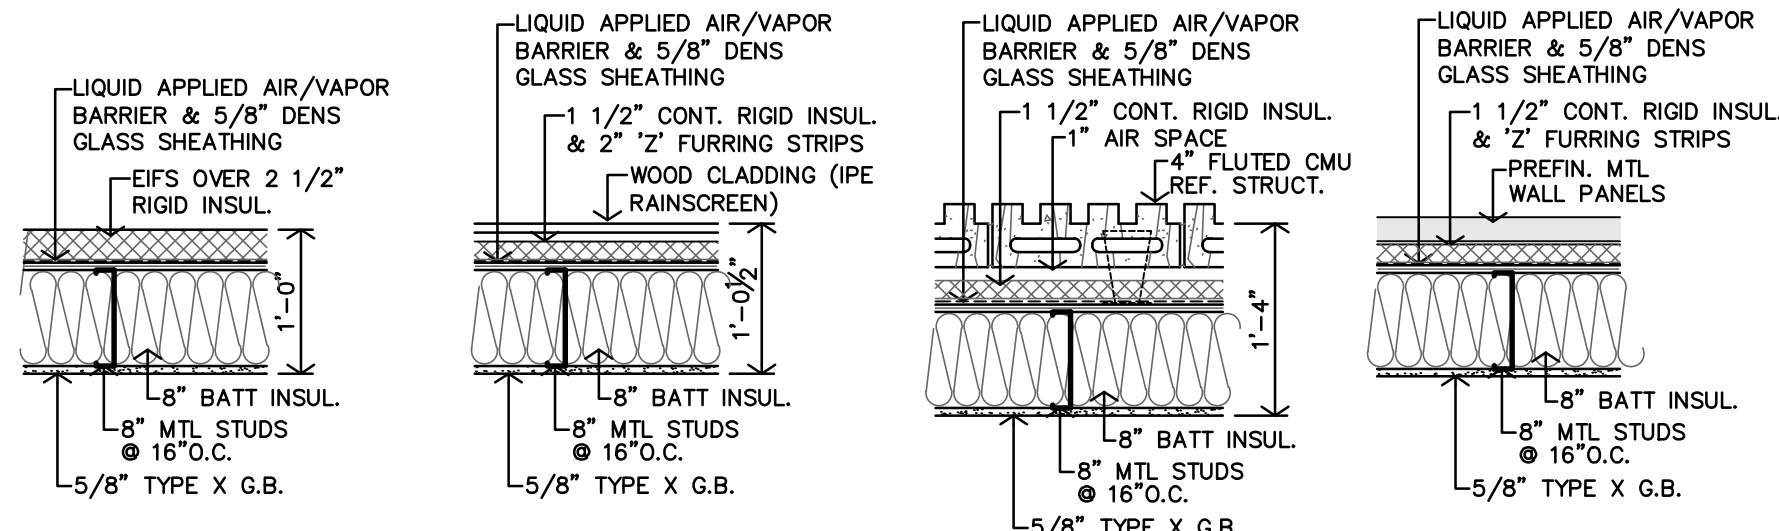


TYPE A TYPE B TYPE C TYPE D

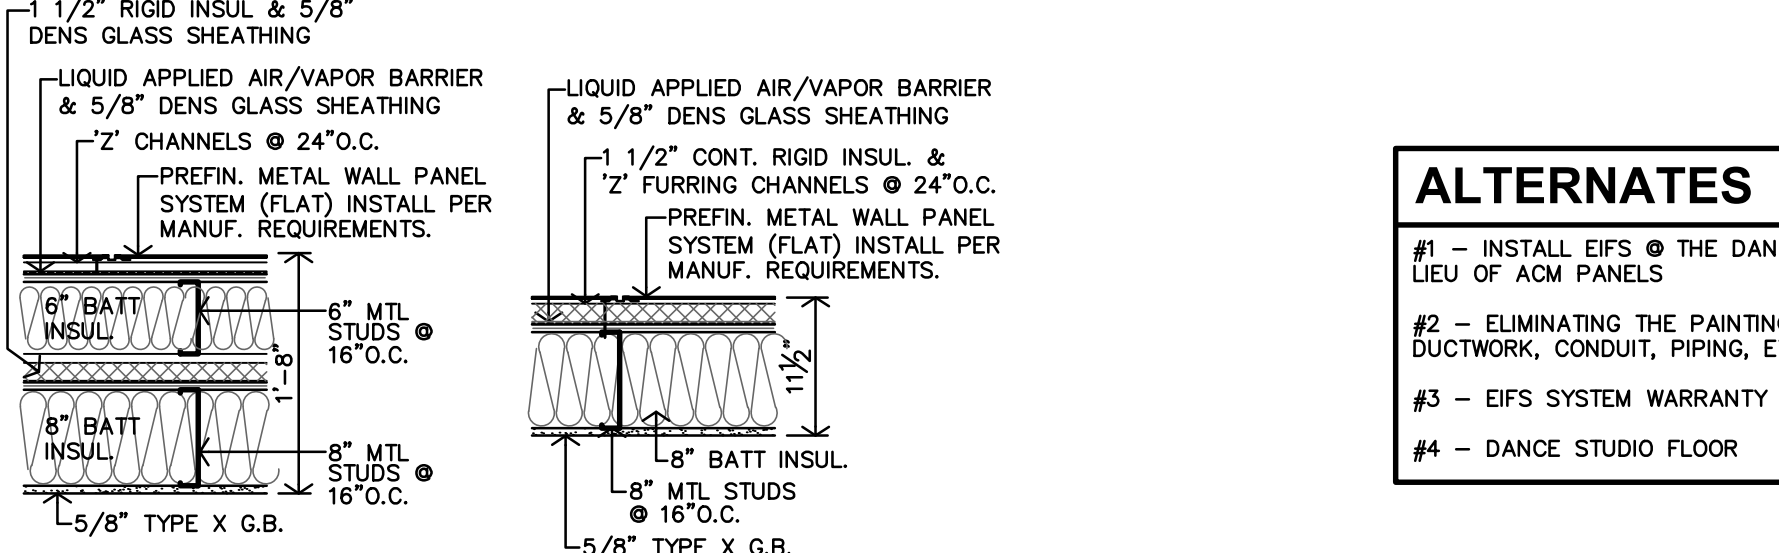

TYPE E TYPE F


INTERIOR PARTITION TYPES

• ALL G.B. WALLS FULL HEIGHT TO B.O. DECK, U.N.O.

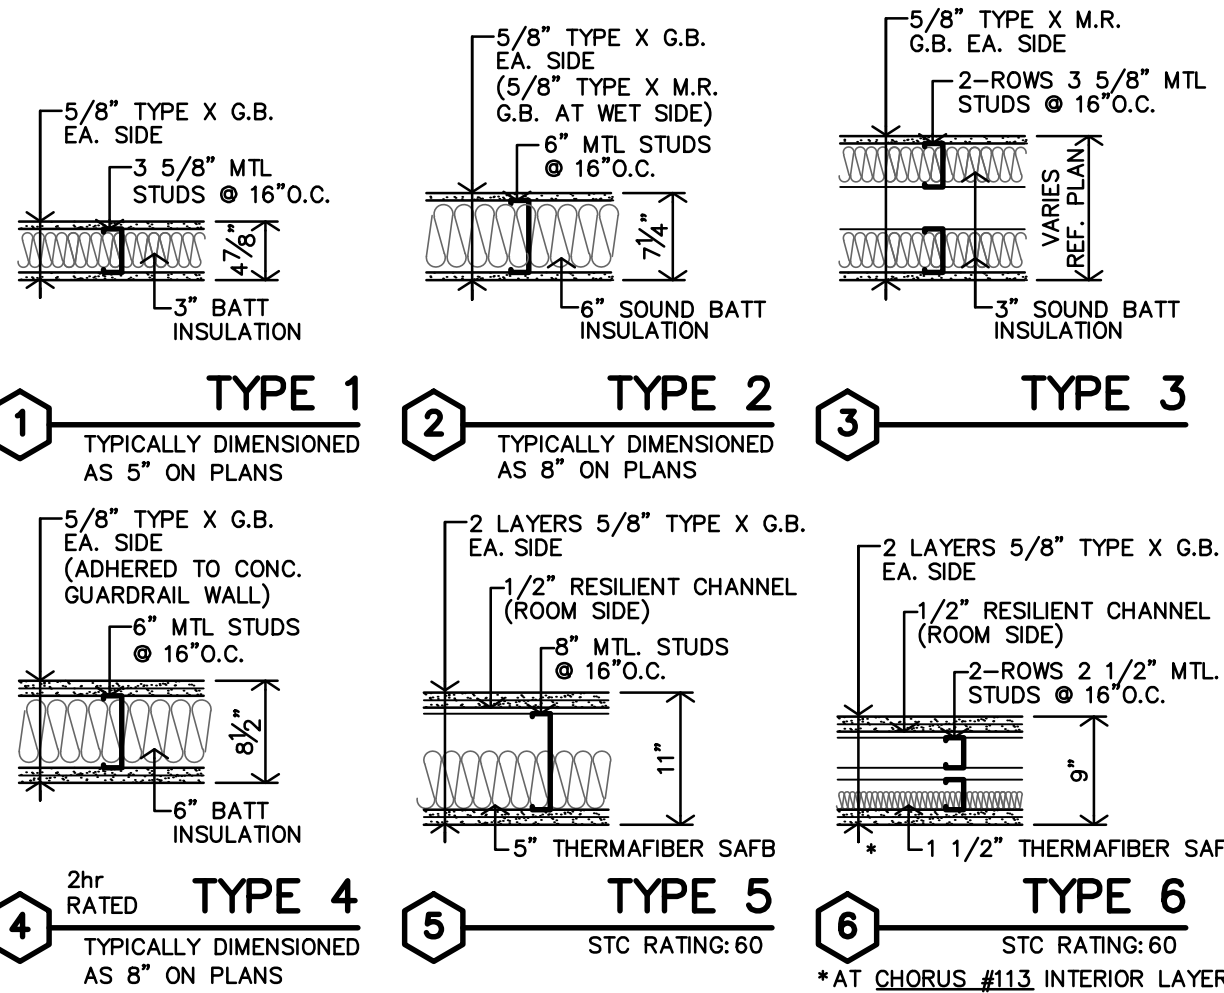

TYPE 1 TYPE 2 TYPE 3 TYPE 4 TYPE 5 TYPE 6

FURRING PARTITION TYPES

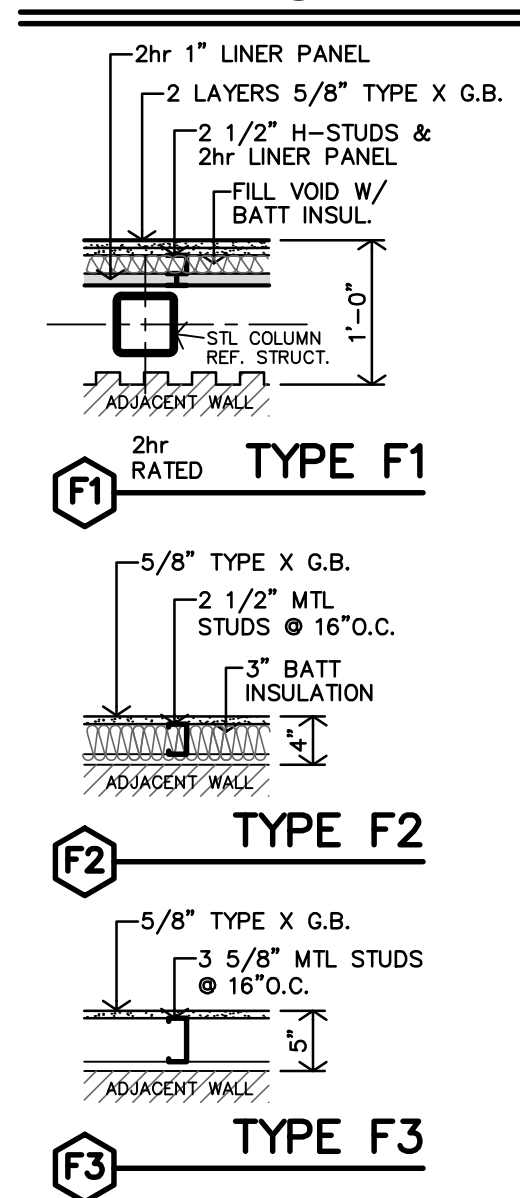


TYPE F1 TYPE F2 TYPE F3

GENERAL NOTES

1. CONTRACTOR SHALL FIELD VERIFY ALL DIMENSIONS & CONDITIONS.
2. IF THERE IS A DISCREPANCY BETWEEN DRAWINGS AND FIELD CONDITIONS NOTIFY ARCHITECT PRIOR TO PROCEEDING WITH WORK SO THAT ANY ISSUES MAY BE CLARIFIED.
3. ALL WORK SHALL BE IN CONFORMANCE W/ APPLICABLE BUILDING CODES & ORDINANCES.
4. ALL NEW CONSTRUCTION SHALL BE IN CONFORMANCE TO ADA REQUIREMENTS. REFERENCE ADA FOR TYPICAL MINIMUM CLEARANCE REQ'D.
5. INSTALL MATERIALS AND/OR FINISHES AS INDICATED, IMPLIED OR AS REQUIRED FOR COMPLETE & FINISHED INSTALLATION.
6. ALL NEW DOOR HARDWARE SHALL BE LEVER TYPE LATCH SETS UNLESS NOTED OTHERWISE. COORDINATE KEYING REQUIREMENTS WITH OWNER.
7. DOORS ARE TYPICALLY LOCATED WITH HINGE-SIDE JAMB 4" FROM ADJACENT WALL UNLESS NOTED OTHERWISE OR REQUIRED TO MEET LATCH-SIDE CLEARANCE PER ADA.
8. DIMENSIONS TO NEW INTERIOR WALLS ARE TO THE FACE OF G.B. U.N.O.
9. ALL FURNITURE SHOWN IS TO BE PROVIDED BY OWNER.
10. FEC - INDICATES NEW RECESSED FIRE EXTINGUISHER CABINET.
11. CG - INDICATES LOCATION OF FULL HEIGHT CORNER GUARDS.

ALTERNATES

- #1 - INSTALL EIFS @ THE DANCE STUDIO ADDITION FACADE IN LIEU OF ACM PANELS
- #2 - ELIMINATING THE PAINTING THE STEEL STRUCTURE, & DUCTWORK, CONDUIT, PIPING, ETC. AT THE SCENE SHOP ADDITION
- #3 - EIFS SYSTEM WARRANTY OF 20 YEARS
- #4 - DANCE STUDIO FLOOR

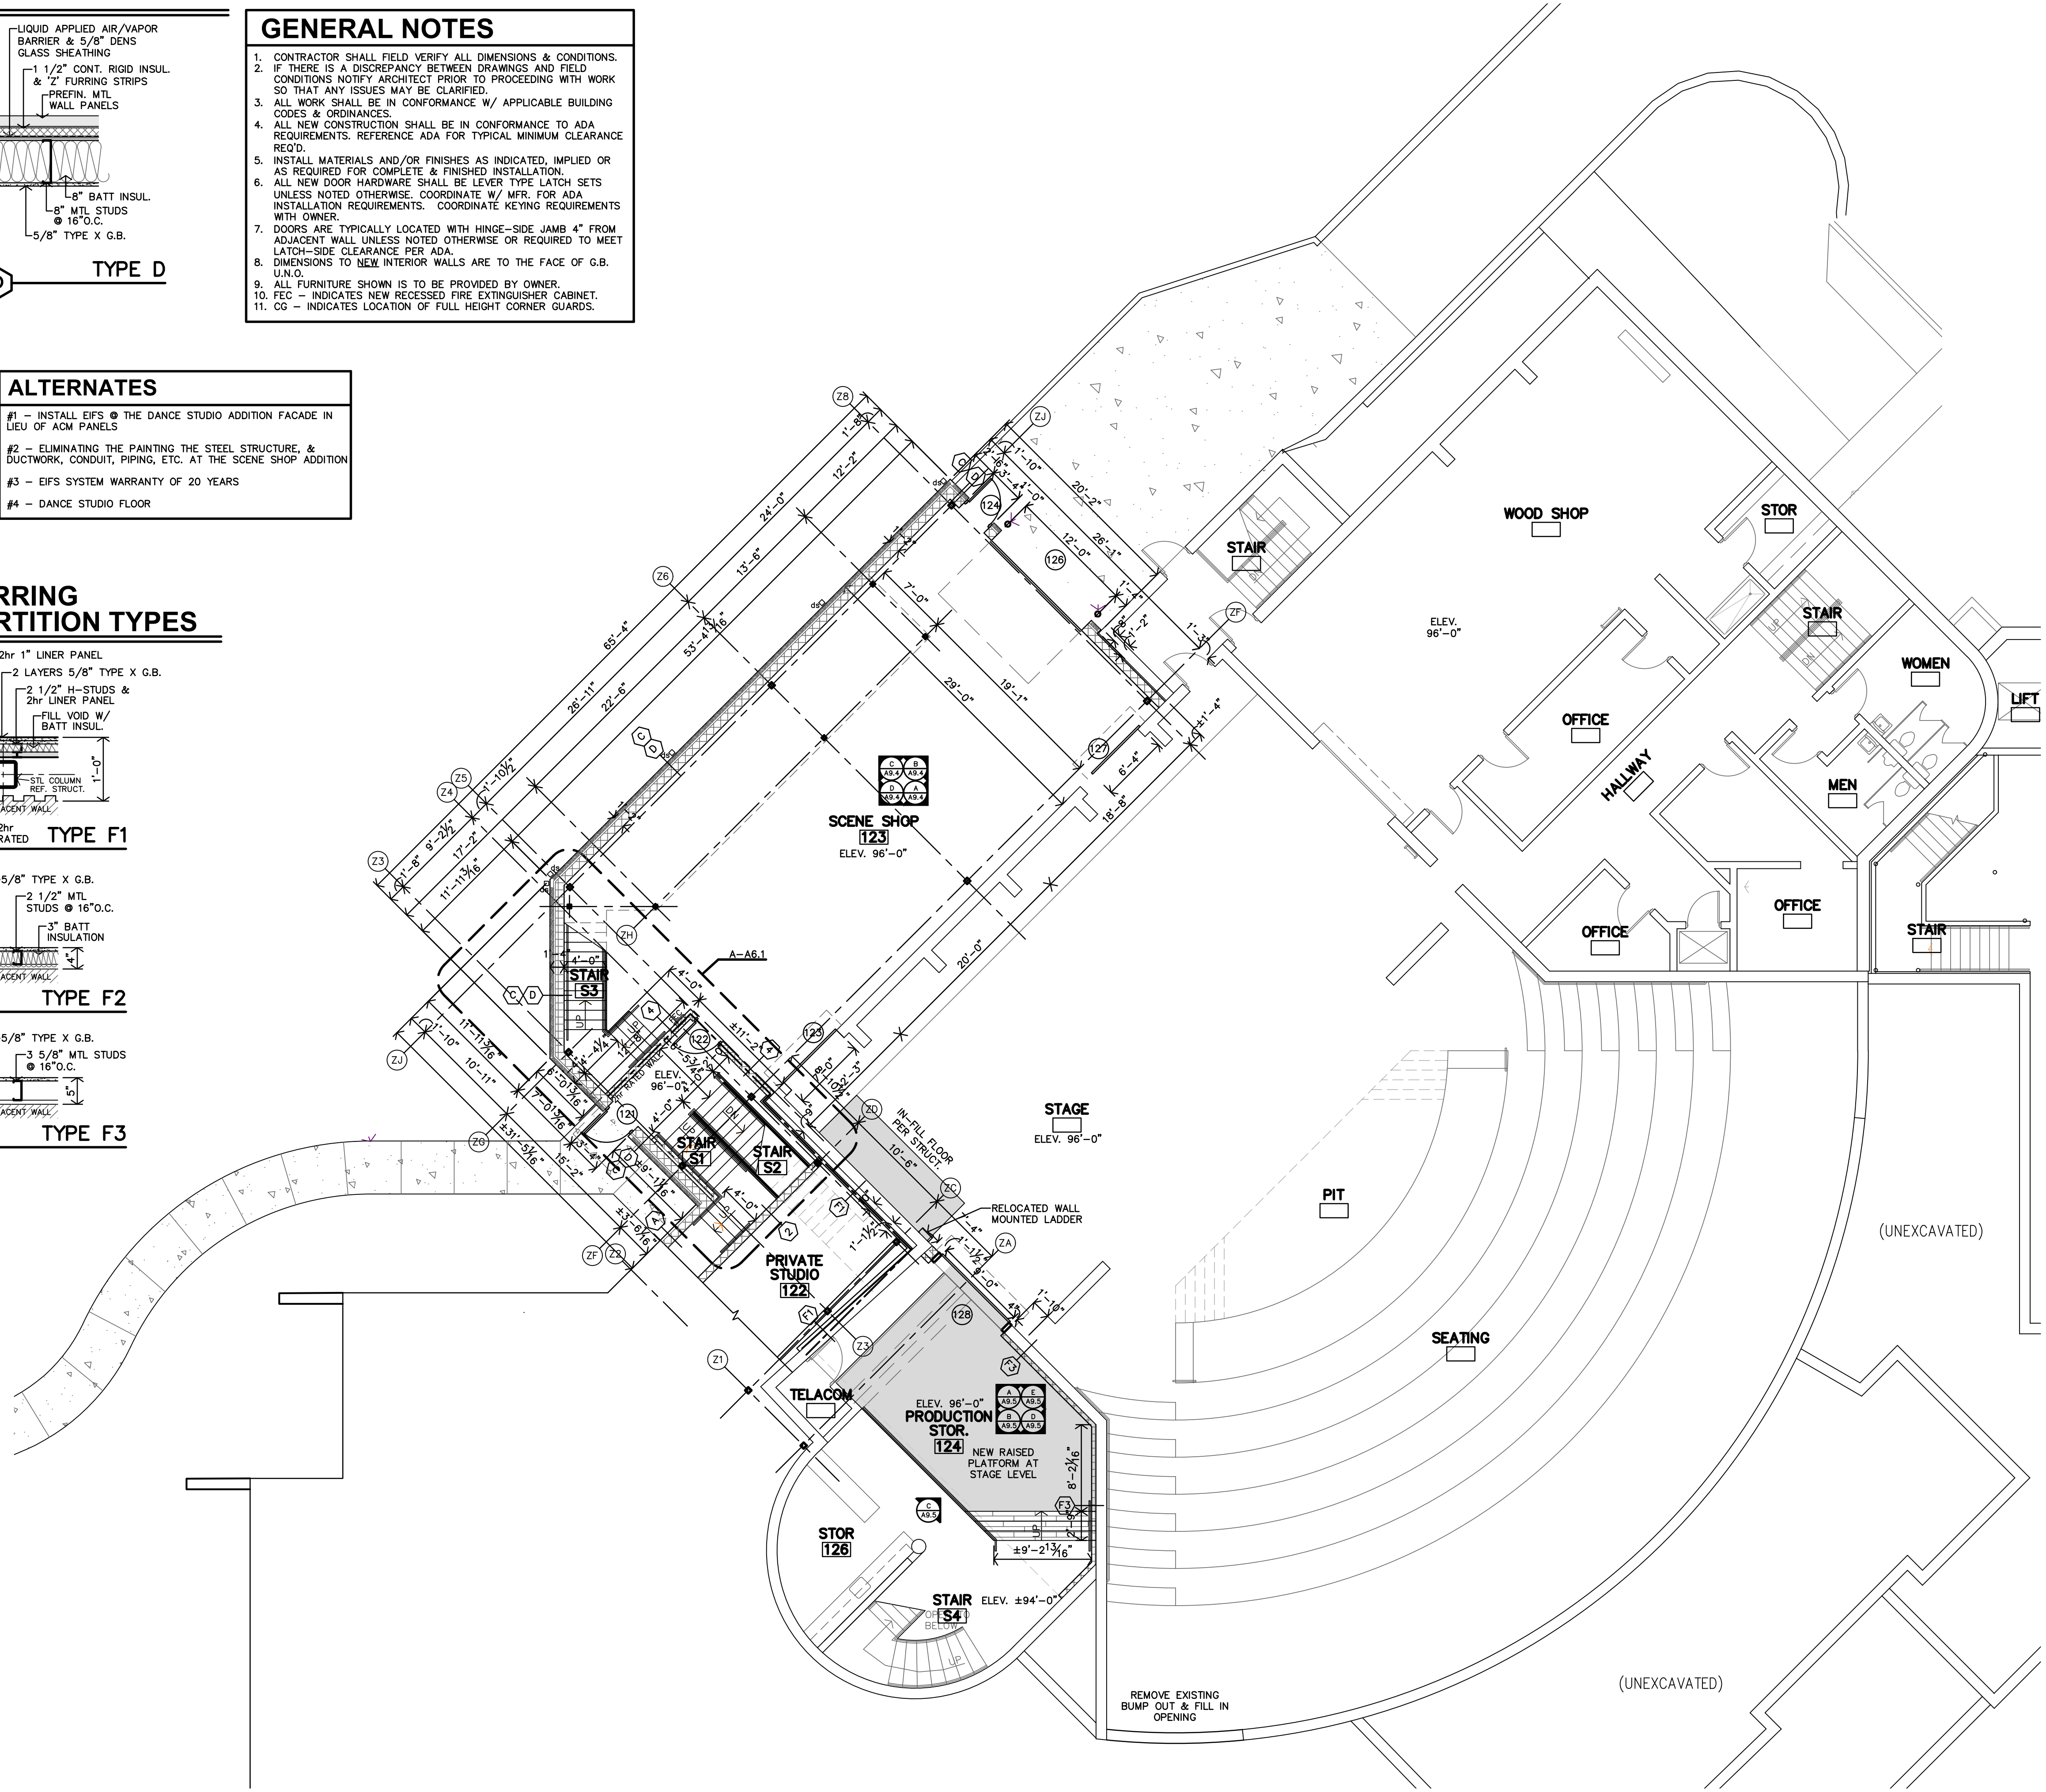


A STAGE LEVEL FLOOR PLAN  
1/8"=1'-0"

JonesGillamRenz  
1881 Main Street, Suite 301  
Salina, KS 67401  
785.827.0386  
jgr@jgarchitects.com

JGR

THEATRE SALINA  
DANCE STUDIOS & SCENE SHOP EXPANSION  
SALINA, KANSAS

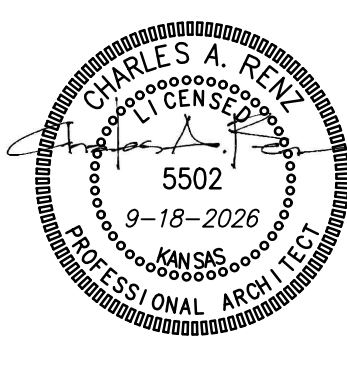


REVISION:  
DATE: 9-18-2026  
JOB: 22-3239  
SHEET NO.:

A2.2

COPYRIGHTED




## EXTERIOR PARTITION TYPES


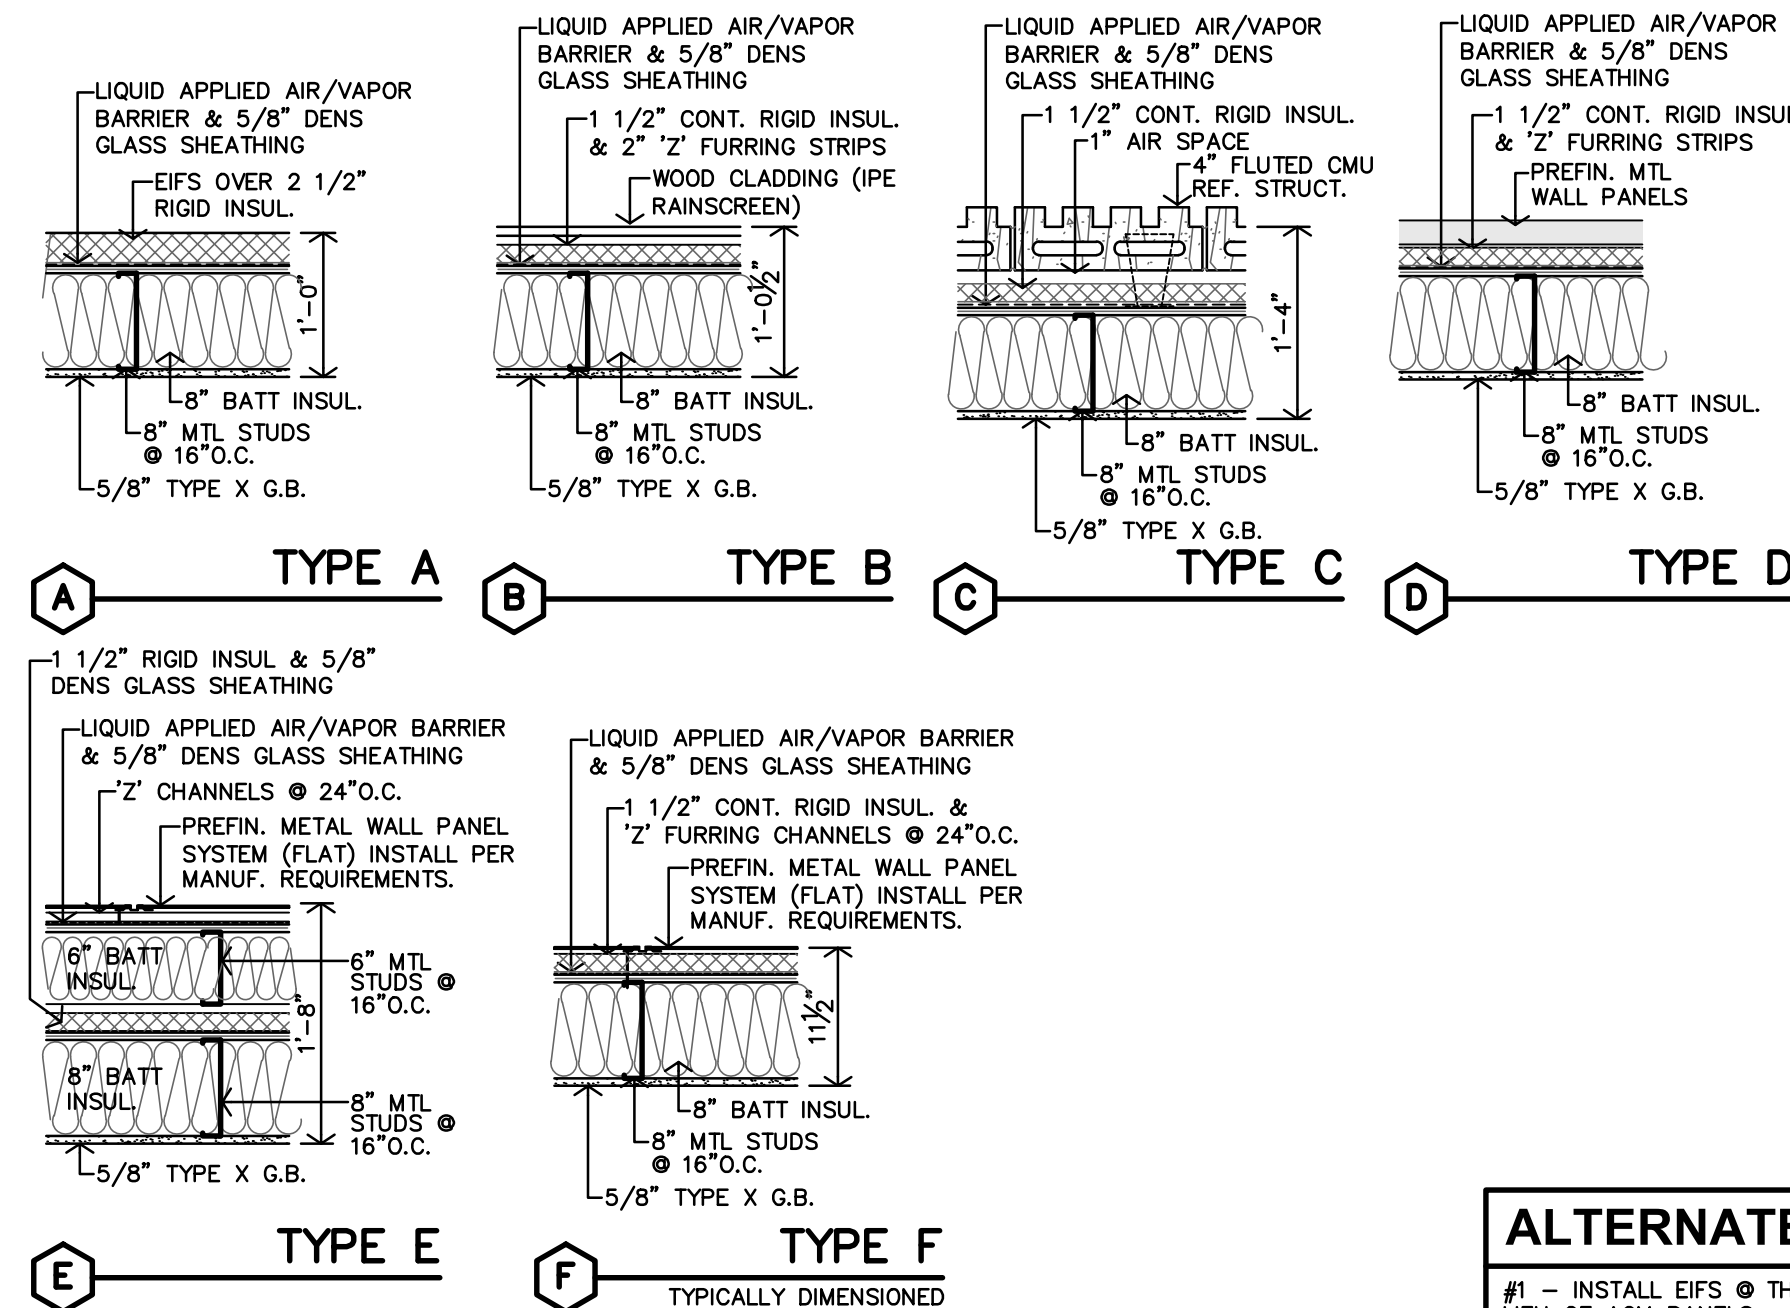


## INTERIOR PARTITION TYPES

• ALL G.B. WALLS FULL HEIGHT TO B.O. DECK, U.N.O.

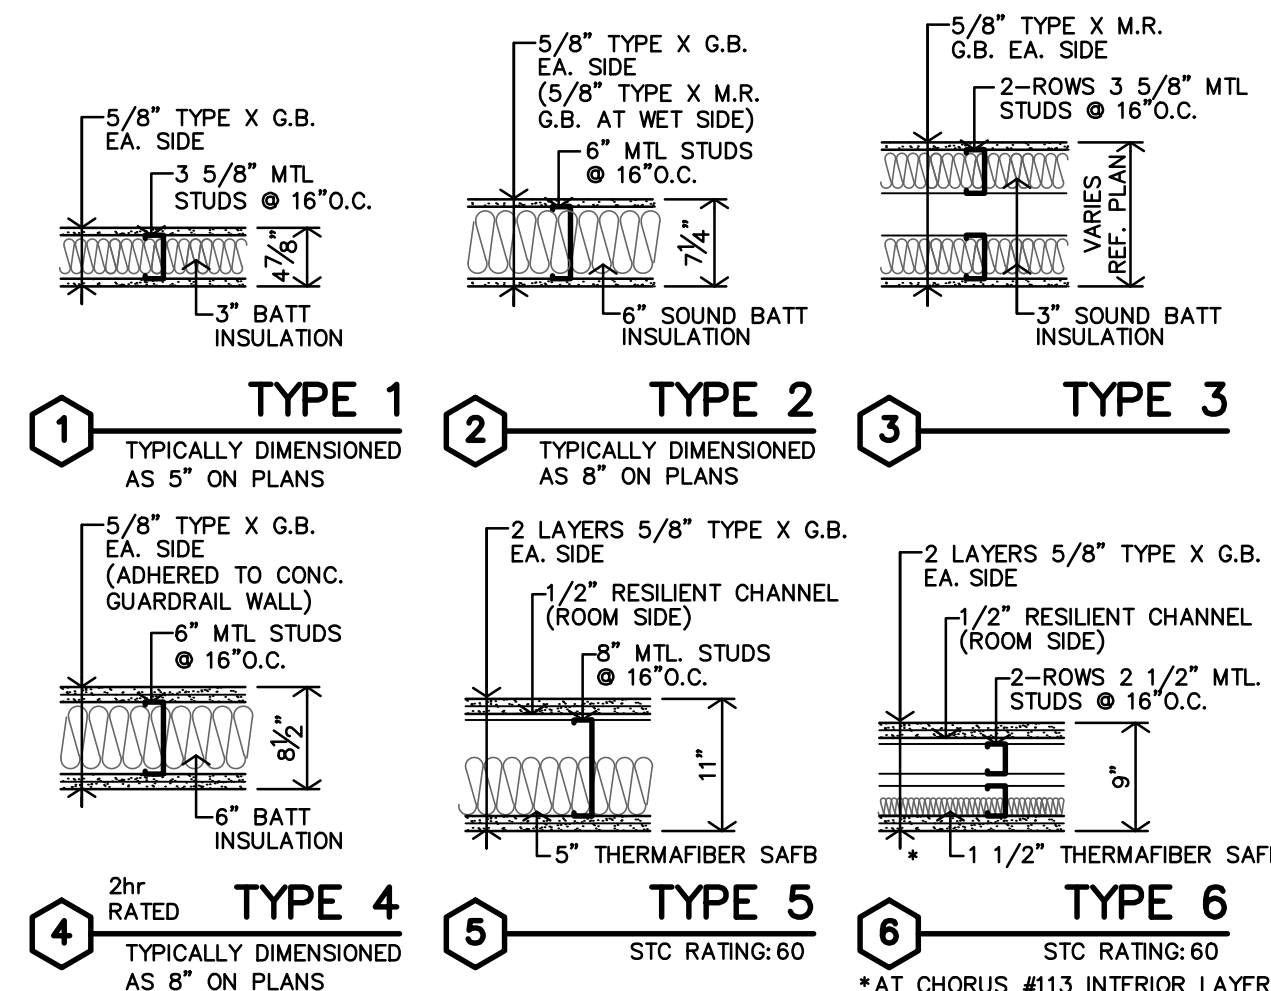

## FURRING PARTITION TYPES

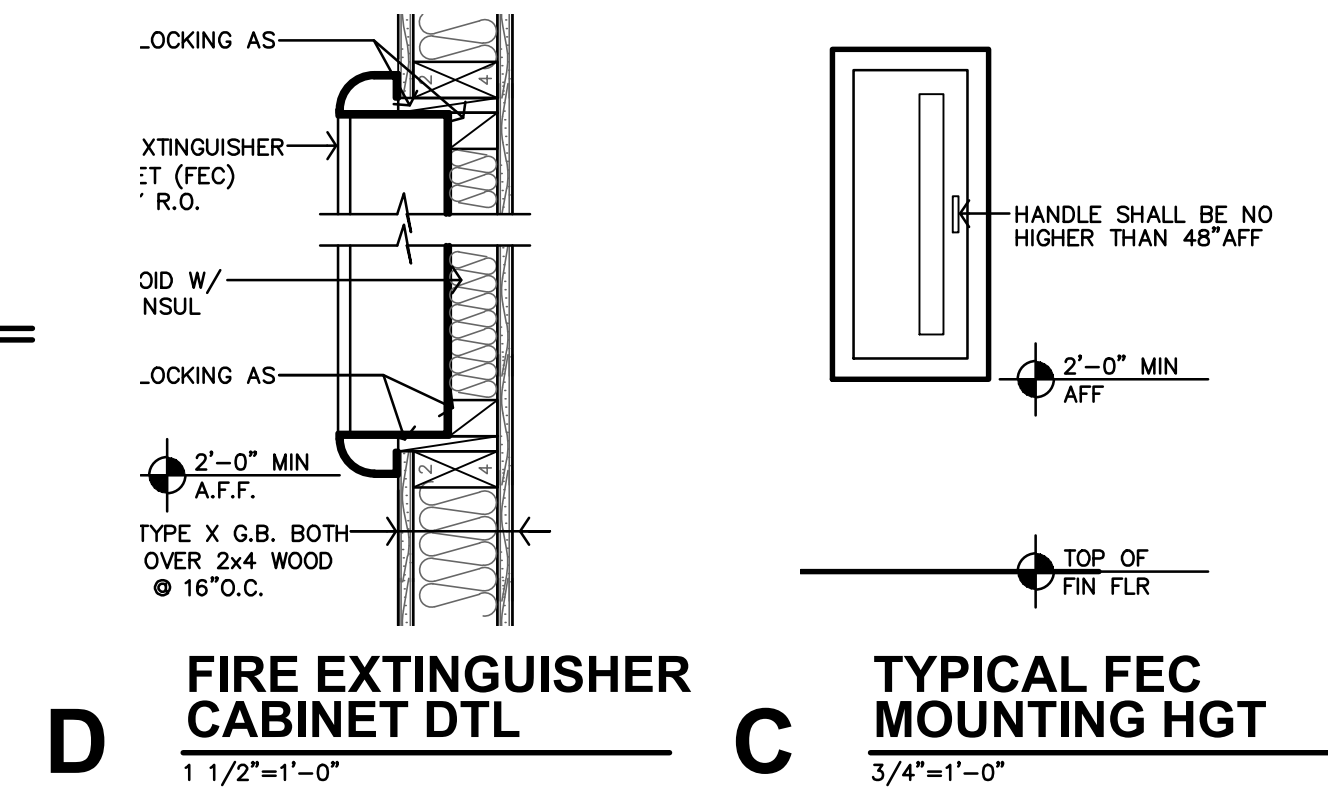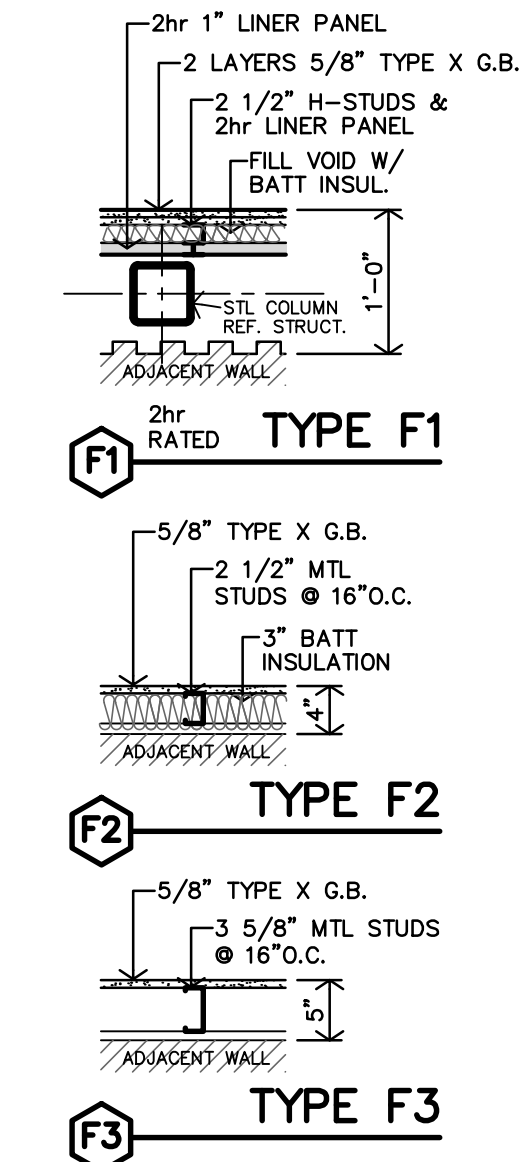


## GENERAL NOTES


- CONTRACTOR SHALL FIELD VERIFY ALL DIMENSIONS & CONDITIONS. IF THERE IS A DISCREPANCY BETWEEN DRAWINGS AND FIELD CONDITIONS NOTIFY ARCHITECT PRIOR TO PROCEEDING WITH WORK SO THAT ANY ISSUES MAY BE CLARIFIED.
- ALL WORK SHALL BE IN CONFORMANCE W/ APPLICABLE BUILDING CODES & ORDINANCES.
- ALL NEW CONSTRUCTION SHALL BE IN CONFORMANCE TO ADA REQUIREMENTS. REFERENCE ADA FOR TYPICAL MINIMUM CLEARANCE REQ'D.
- INSTALL MATERIALS AND/OR FINISHES AS INDICATED, IMPLIED OR AS REQUIRED FOR COMPLETE & FINISHED INSTALLATION.
- ALL NEW DOOR HARDWARE SHALL BE LEVER TYPE LATCH SETS UNLESS NOTED OTHERWISE. COORDINATE W/ MFR. FOR ADA INSTALLATION REQUIREMENTS. COORDINATE KEYING REQUIREMENTS WITH OWNER.
- DOORS ARE TYPICALLY LOCATED WITH HINGE-SIDE JAMB 4" FROM ADJACENT WALL UNLESS NOTED OTHERWISE OR REQUIRED TO MEET LATCH-SIDE CLEARANCE PER ADA.
- DIMENSIONS TO NEW INTERIOR WALLS ARE TO THE FACE OF G.B. U.N.O.
- ALL FURNITURE SHOWN IS TO BE PROVIDED BY OWNER.
- FEC - INDICATES NEW RECESSED FIRE EXTINGUISHER CABINET.
- CG - INDICATES LOCATION OF FULL HEIGHT CORNER GUARDS.

## ALTERNATES

- #1 - INSTALL EIFS @ THE DANCE STUDIO ADDITION FACADE IN LIEU OF ACM PANELS
- #2 - ELIMINATING THE PAINTING THE STEEL STRUCTURE, & DUCTWORK, CONDUIT, PIPING, ETC. AT THE SCENE SHOP ADDITION
- #3 - EIFS SYSTEM WARRANTY OF 20 YEARS
- #4 - DANCE STUDIO FLOOR

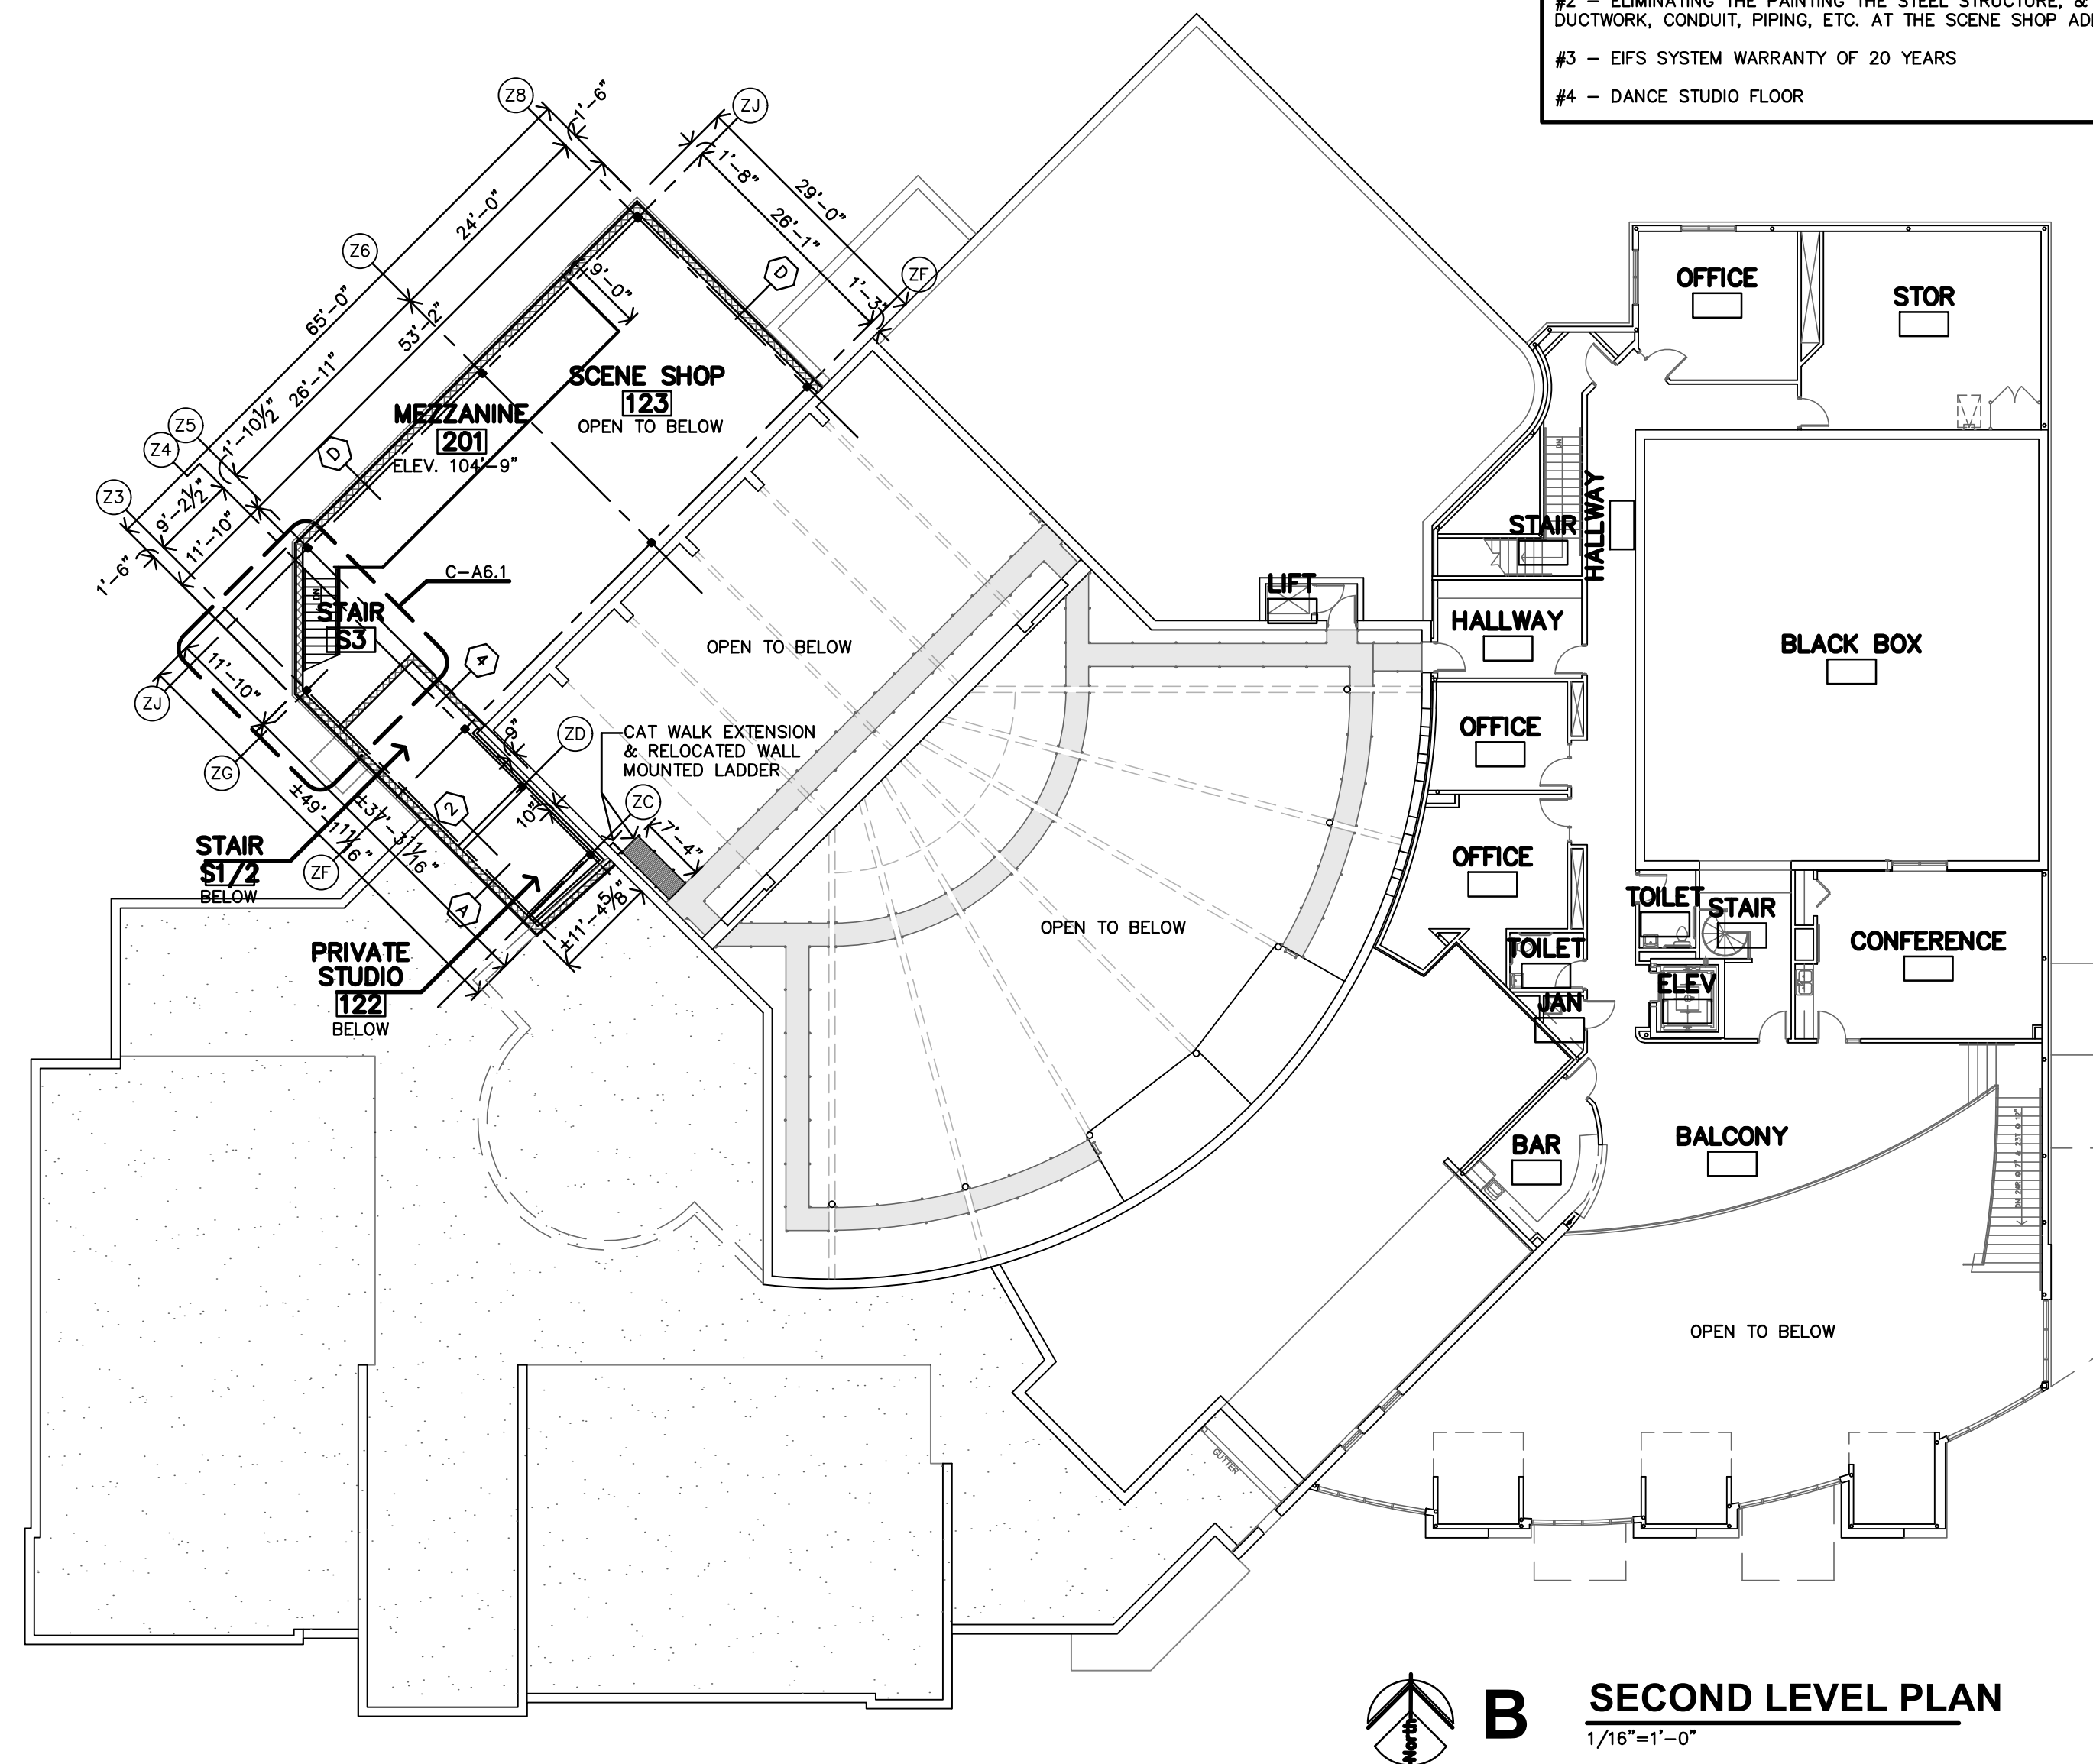


**B SECOND LEVEL PLAN**  
1/16"=1'-0"

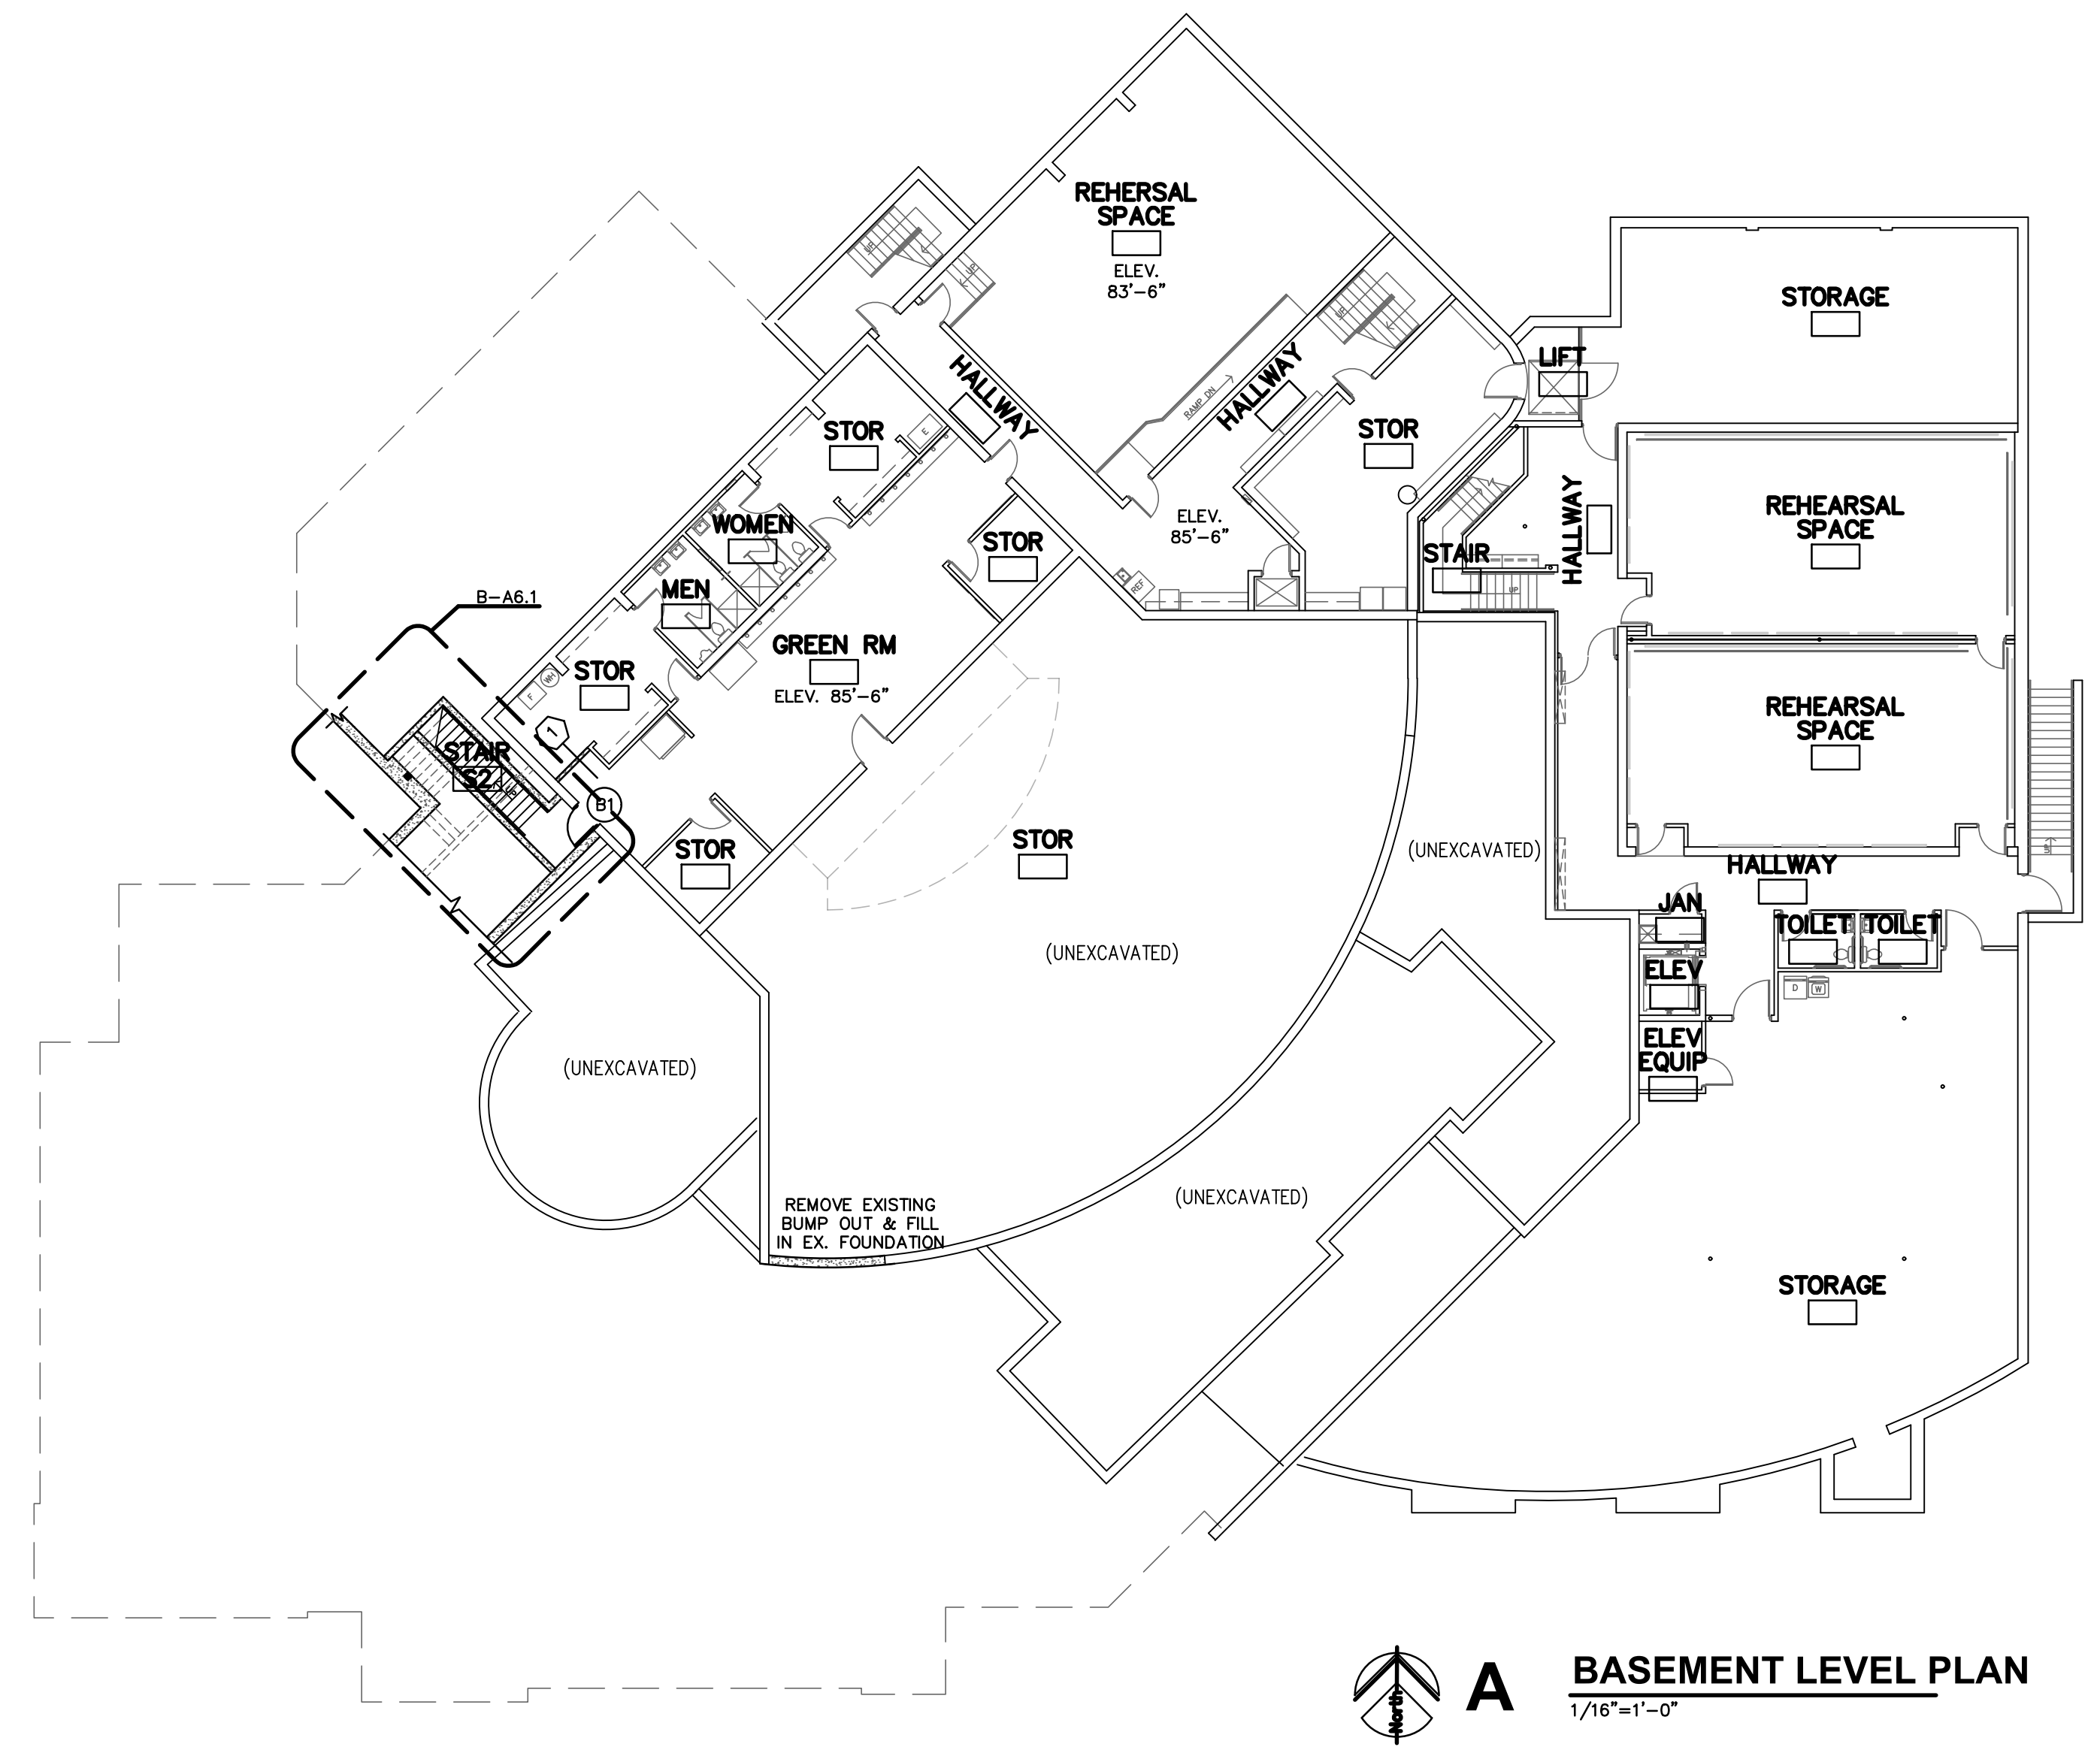

**A BASEMENT LEVEL PLAN**  
1/16"=1'-0"







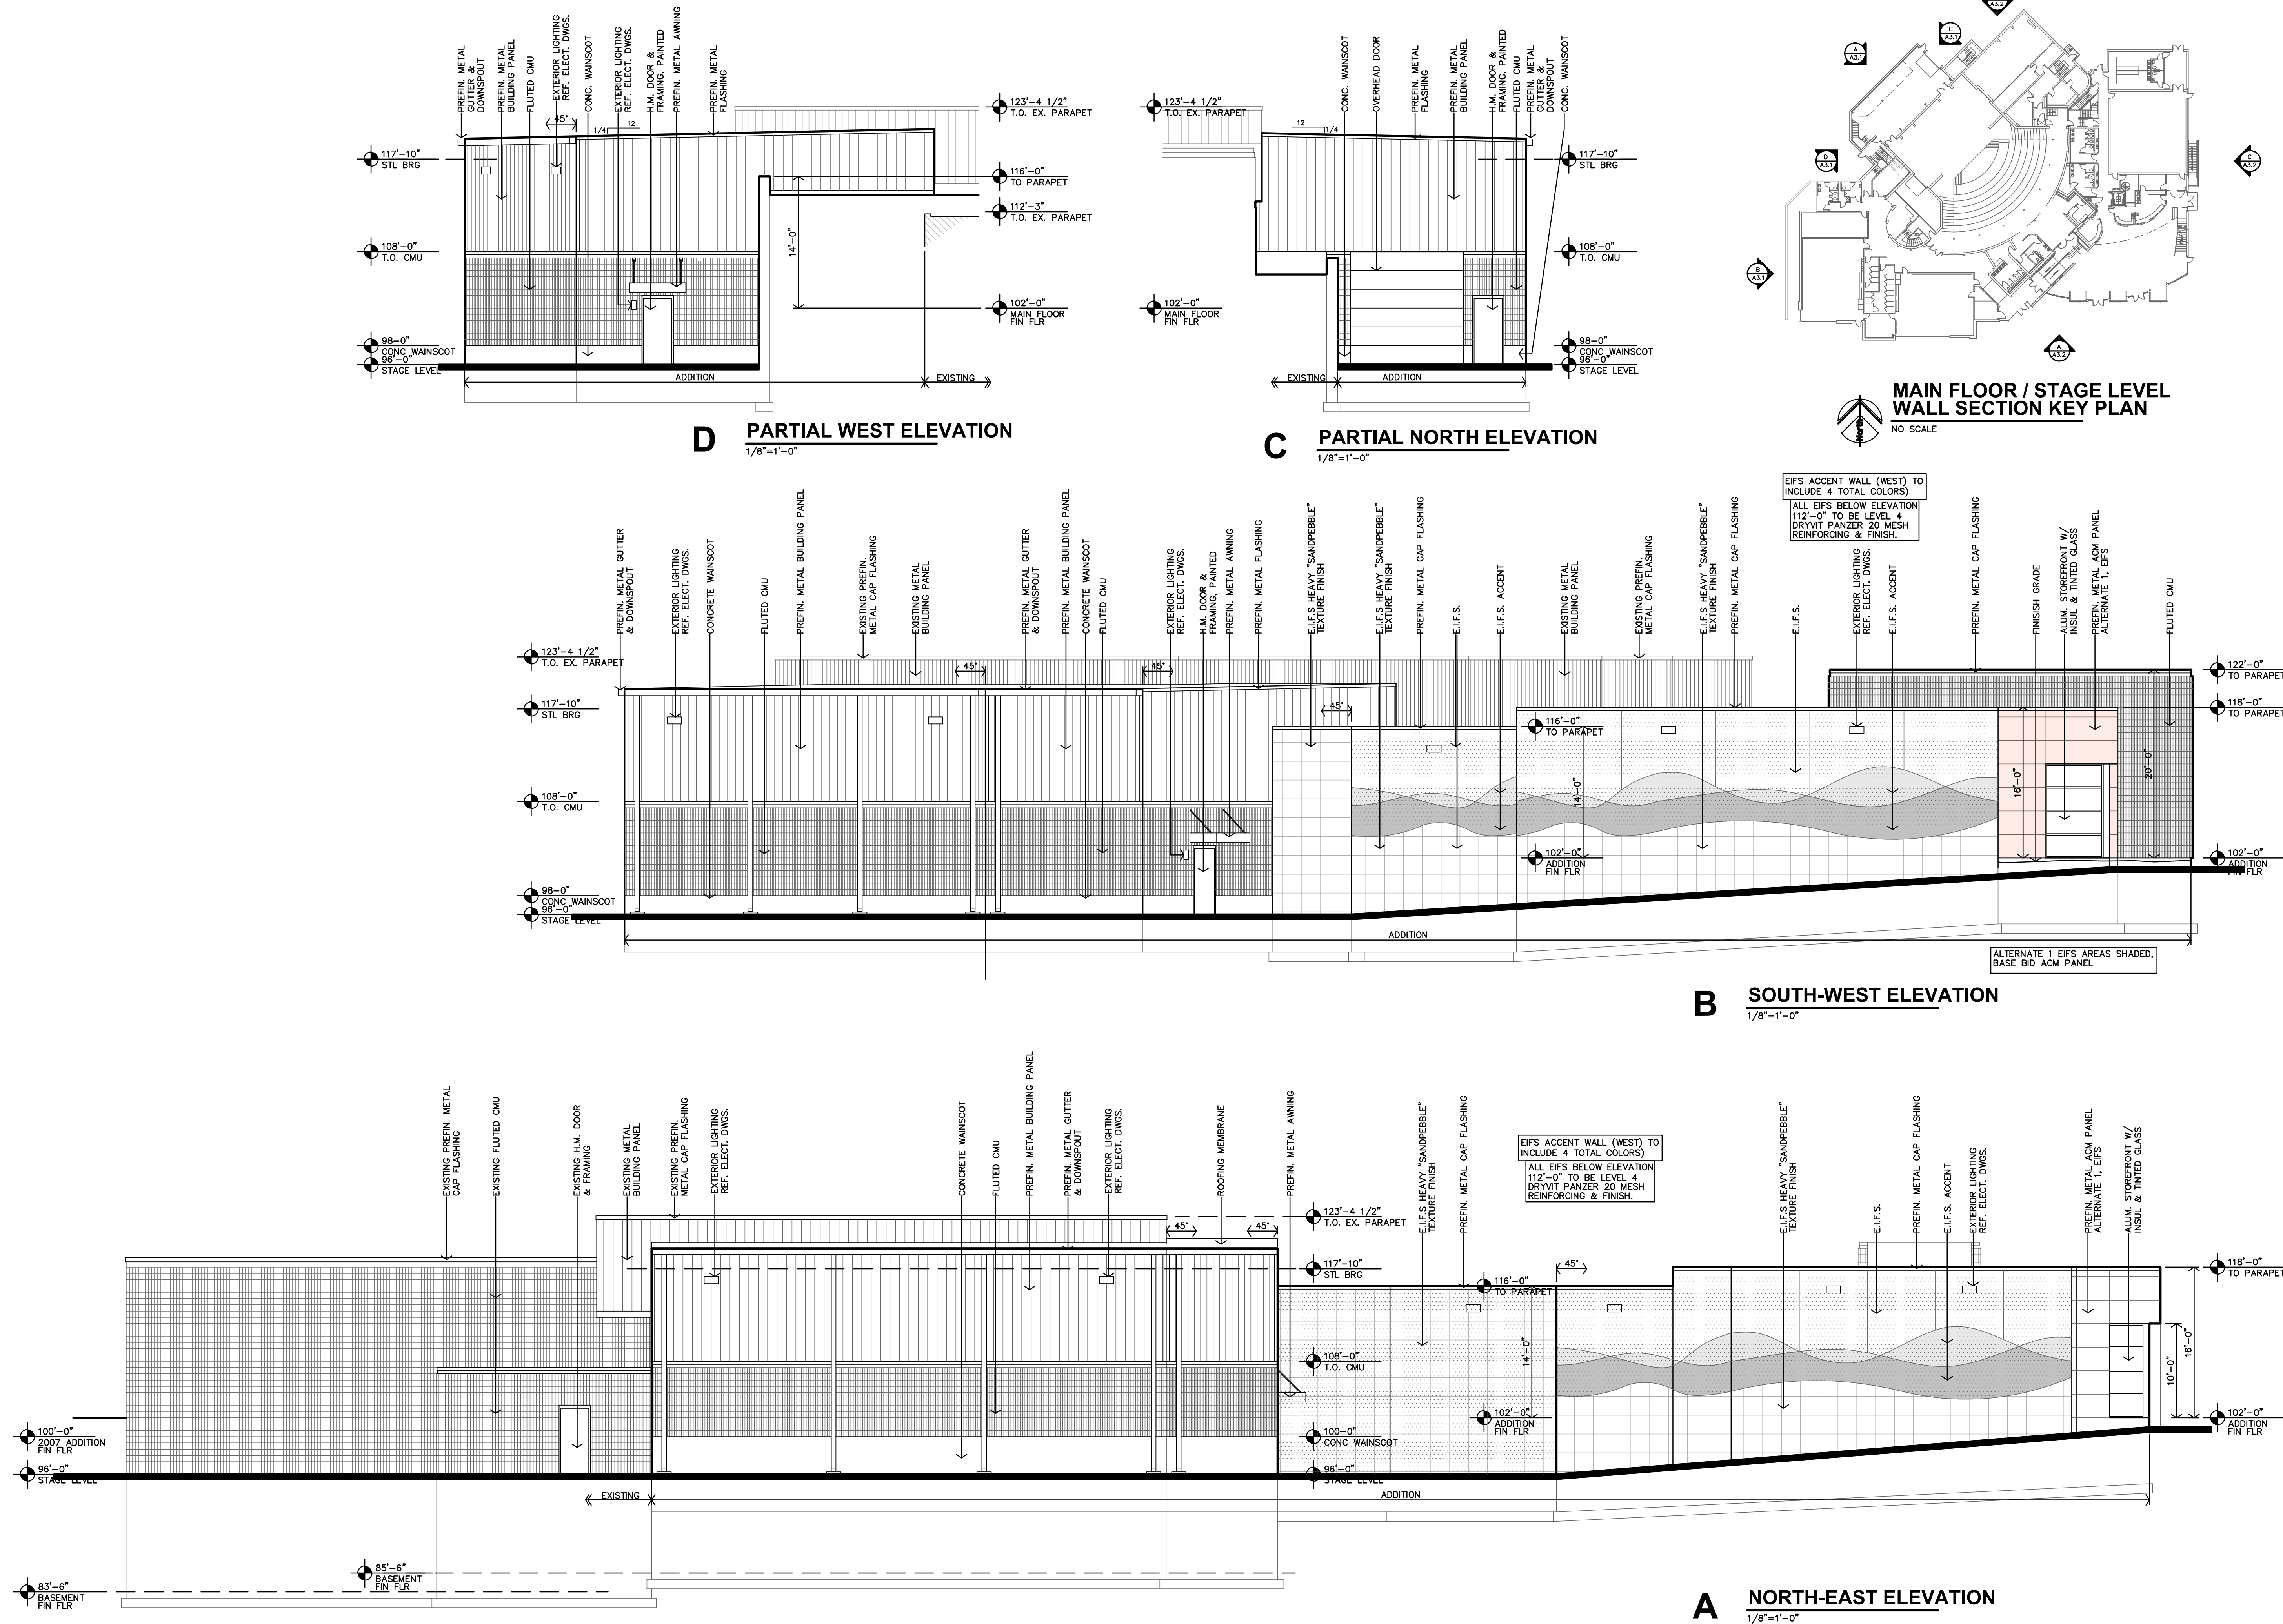







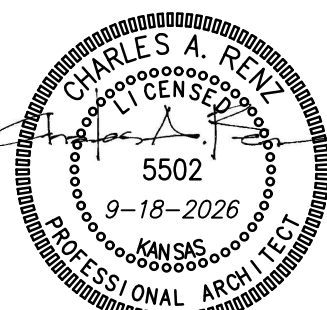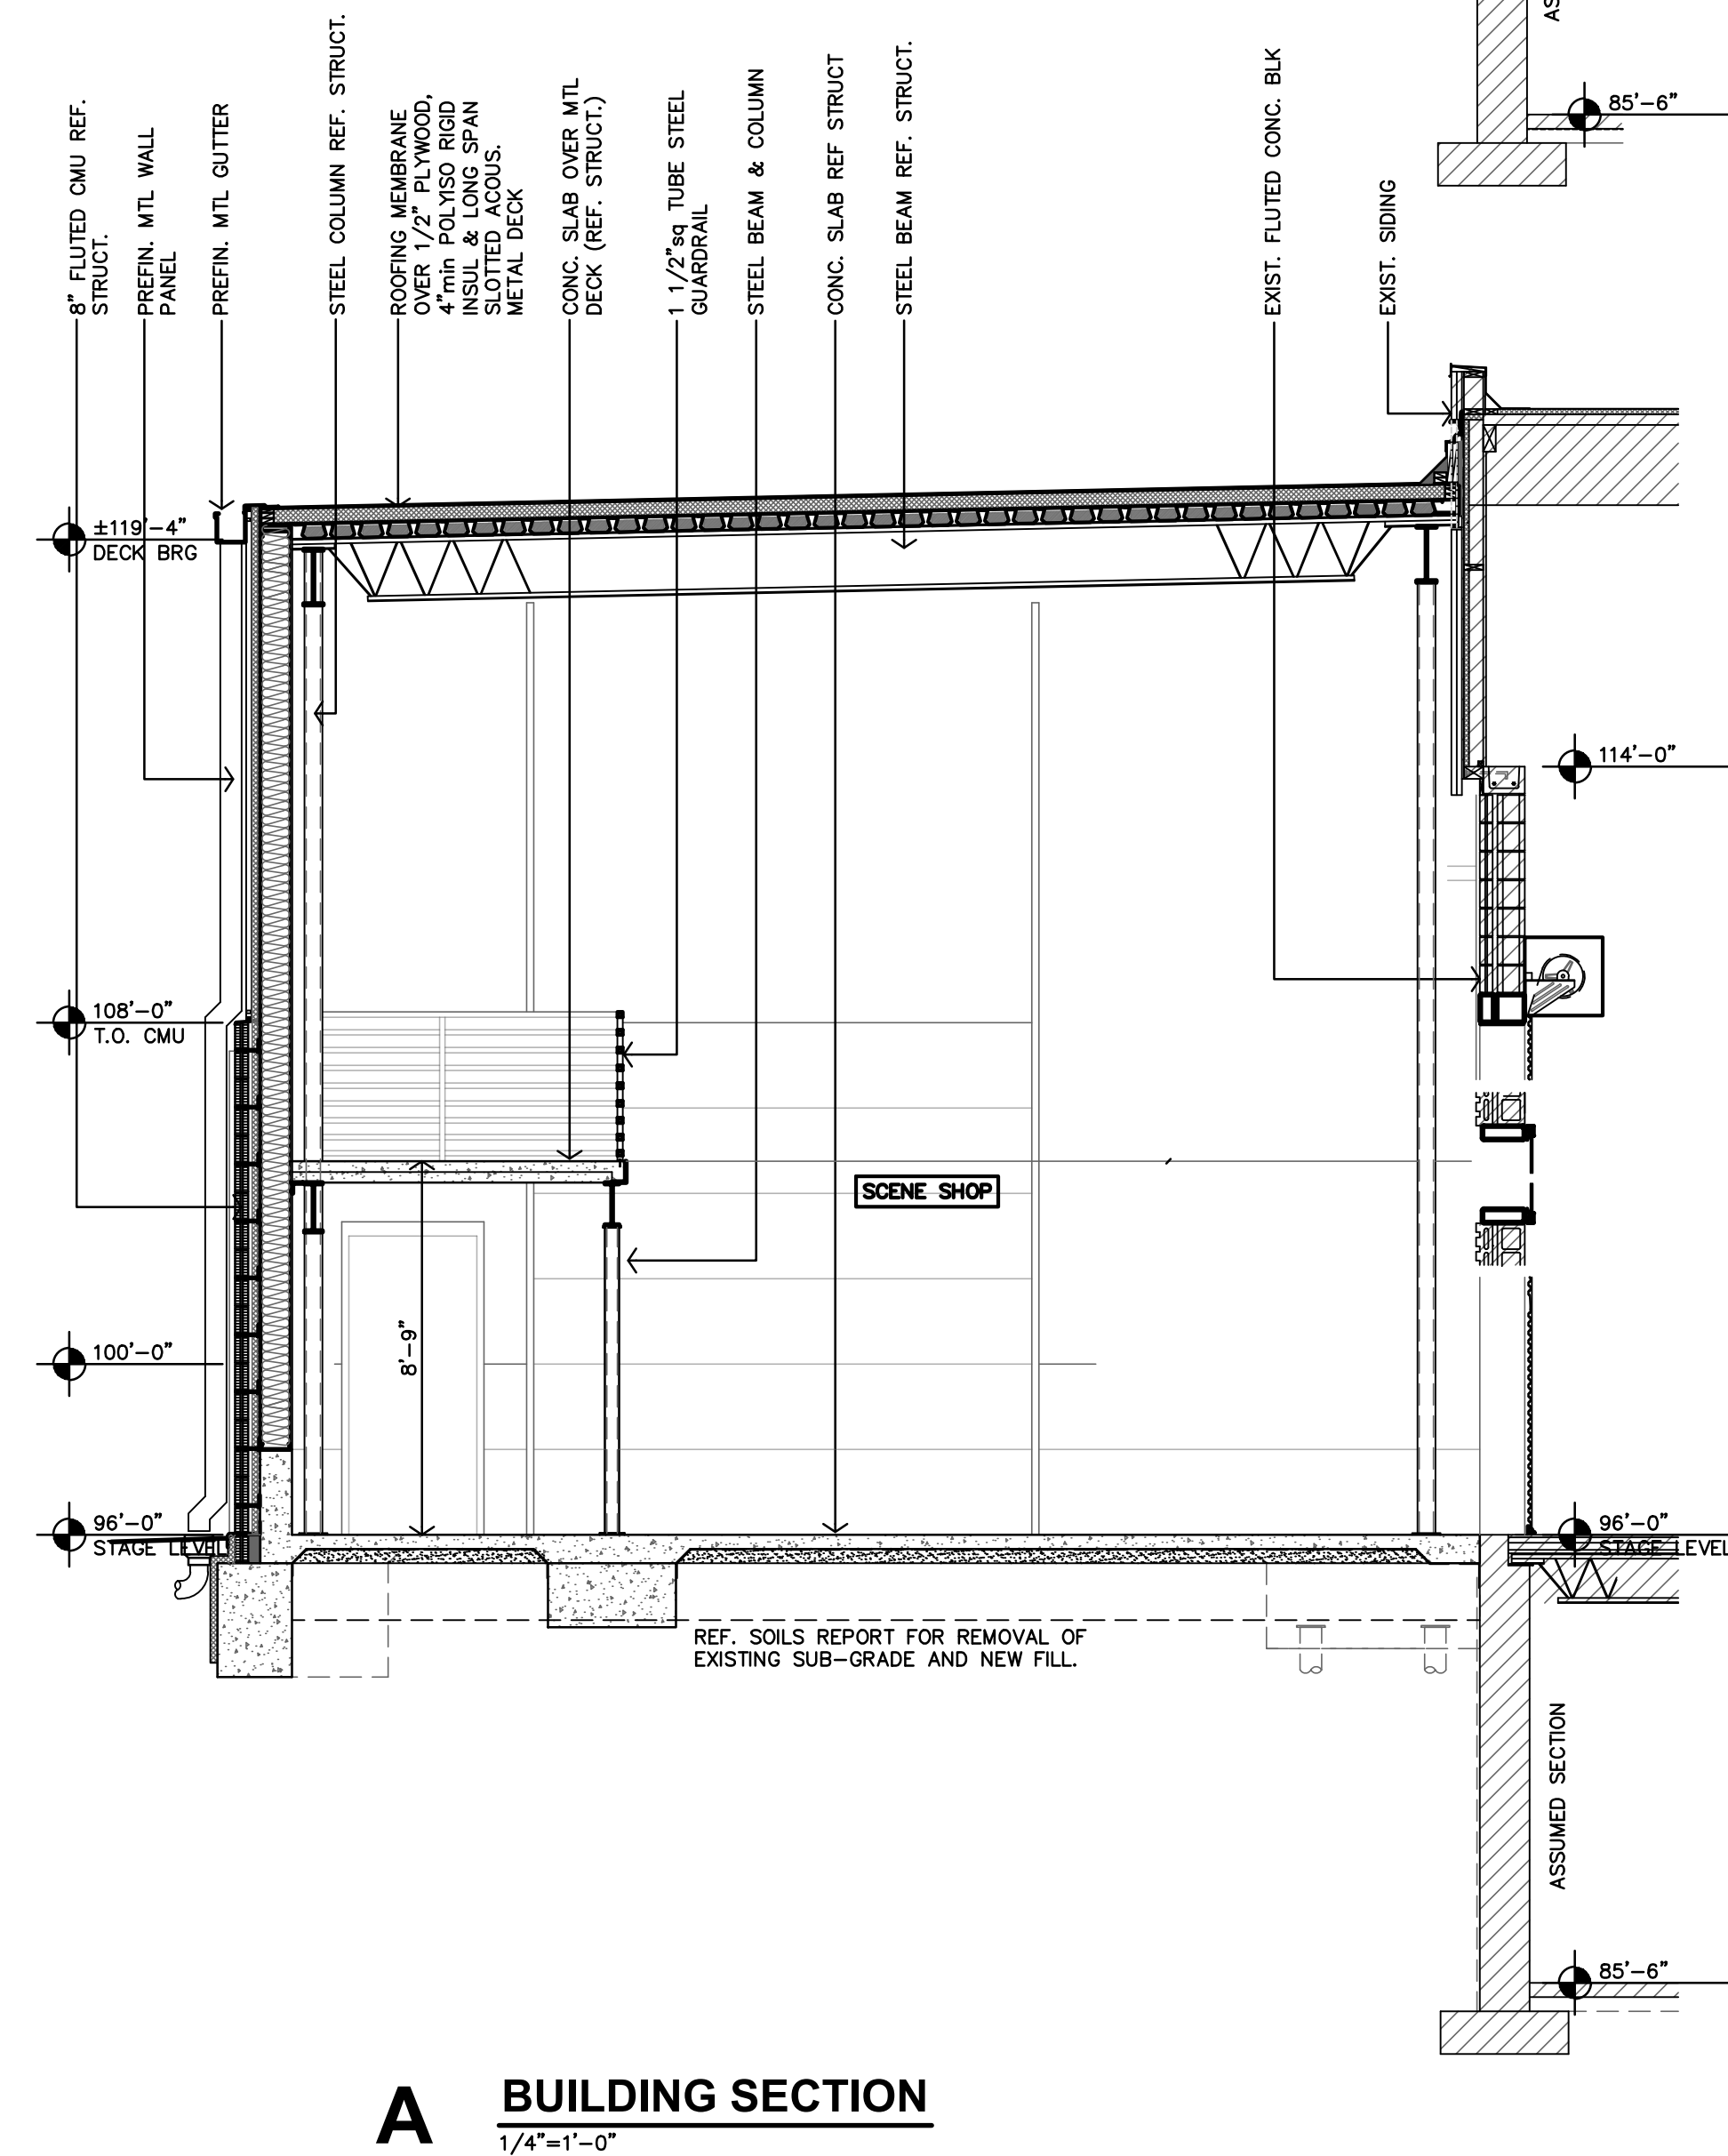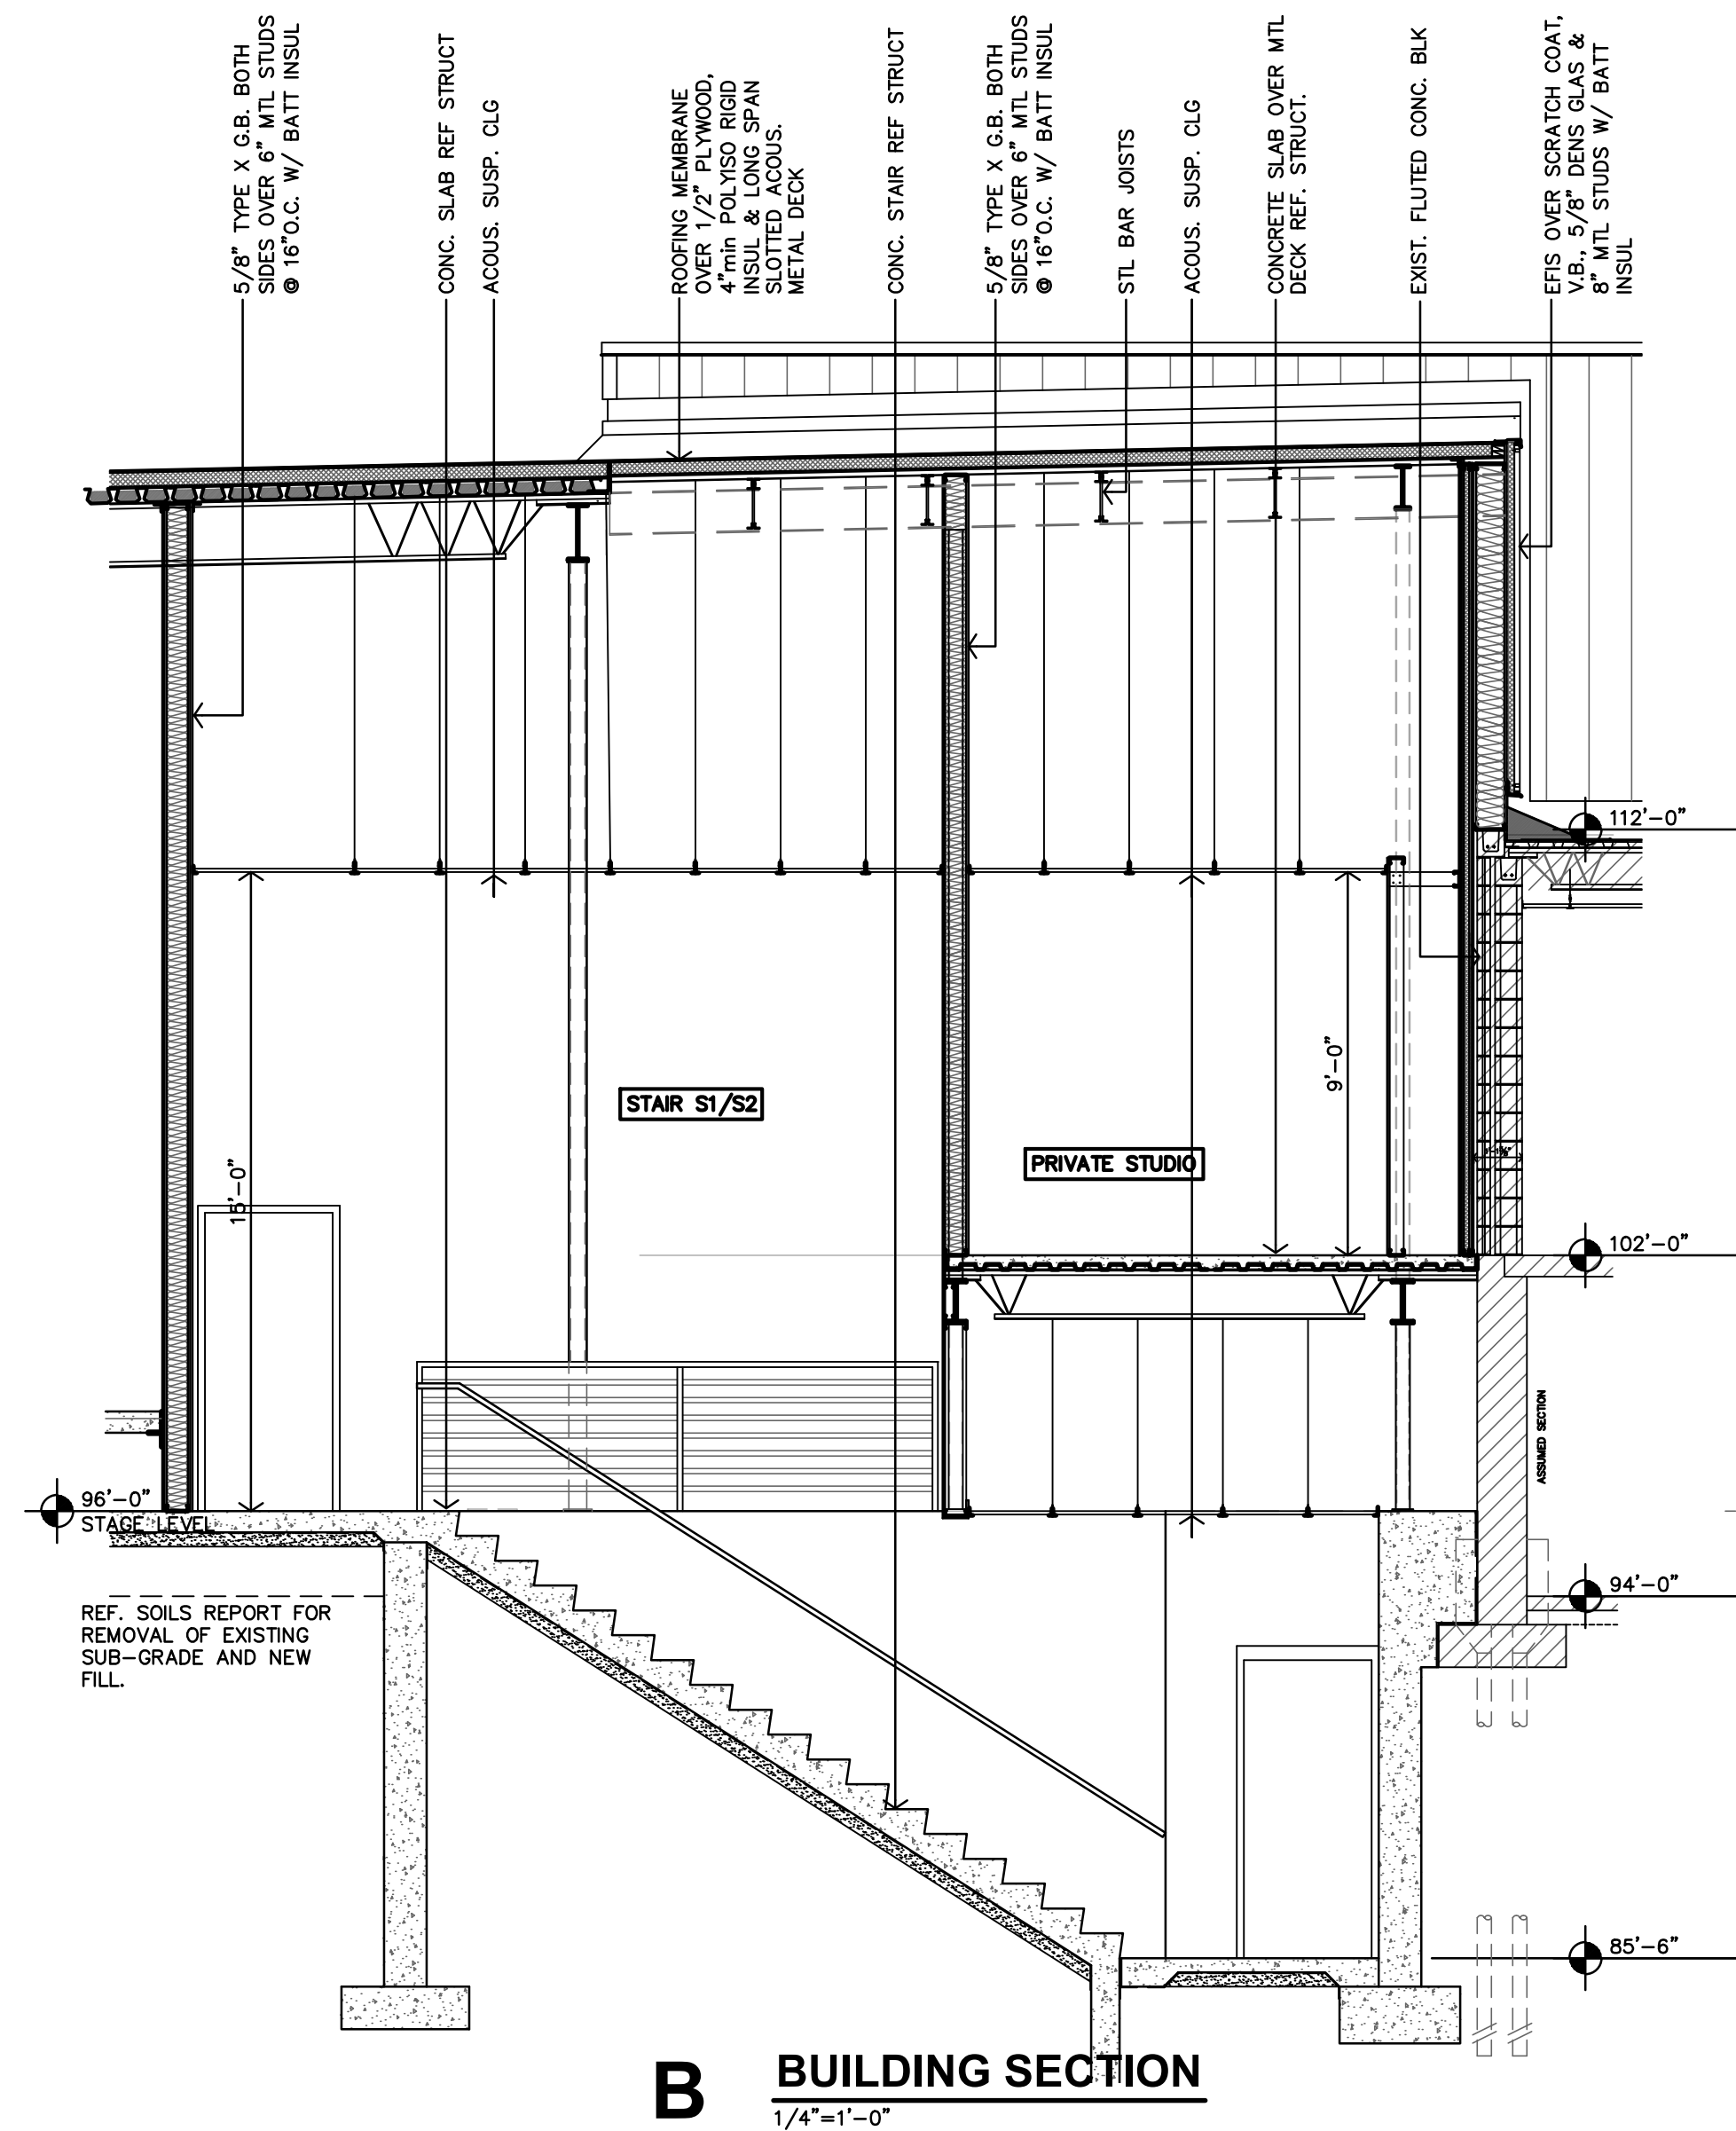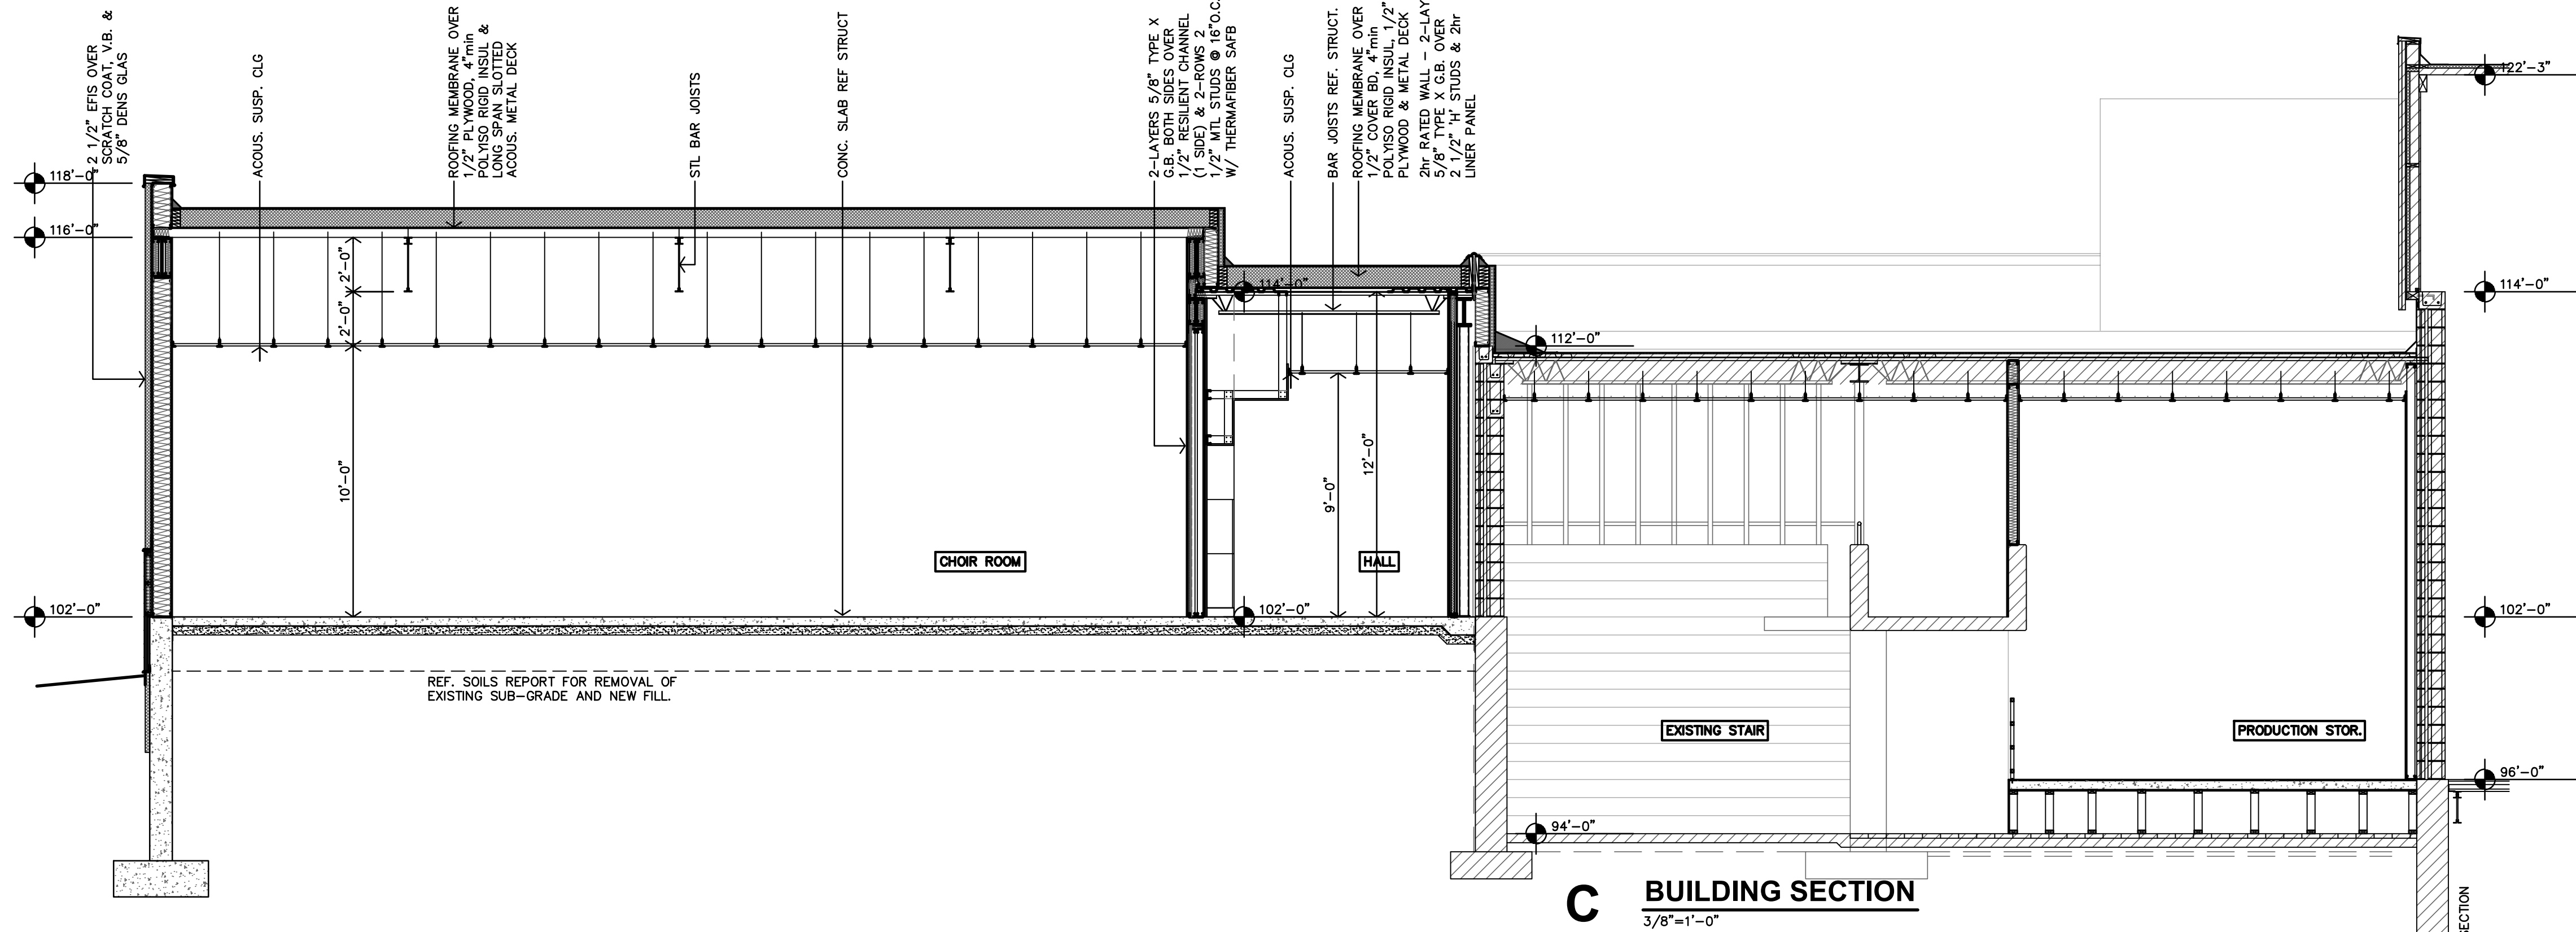











REVISION:	
DATE:	9-18-2026
JOB:	22-3239
SHEET NO.:	

**A3.3**


**THEATRE SALINA**  
DANCE STUDIOS & SCENE SHOP EXPANSION  
SALINA, KANSAS

**JCR**  
JonesGillamRenz  
730 N. Ninth  
Salina, KS 67401  
785.827.0386  
jgr@jgarchitects.com




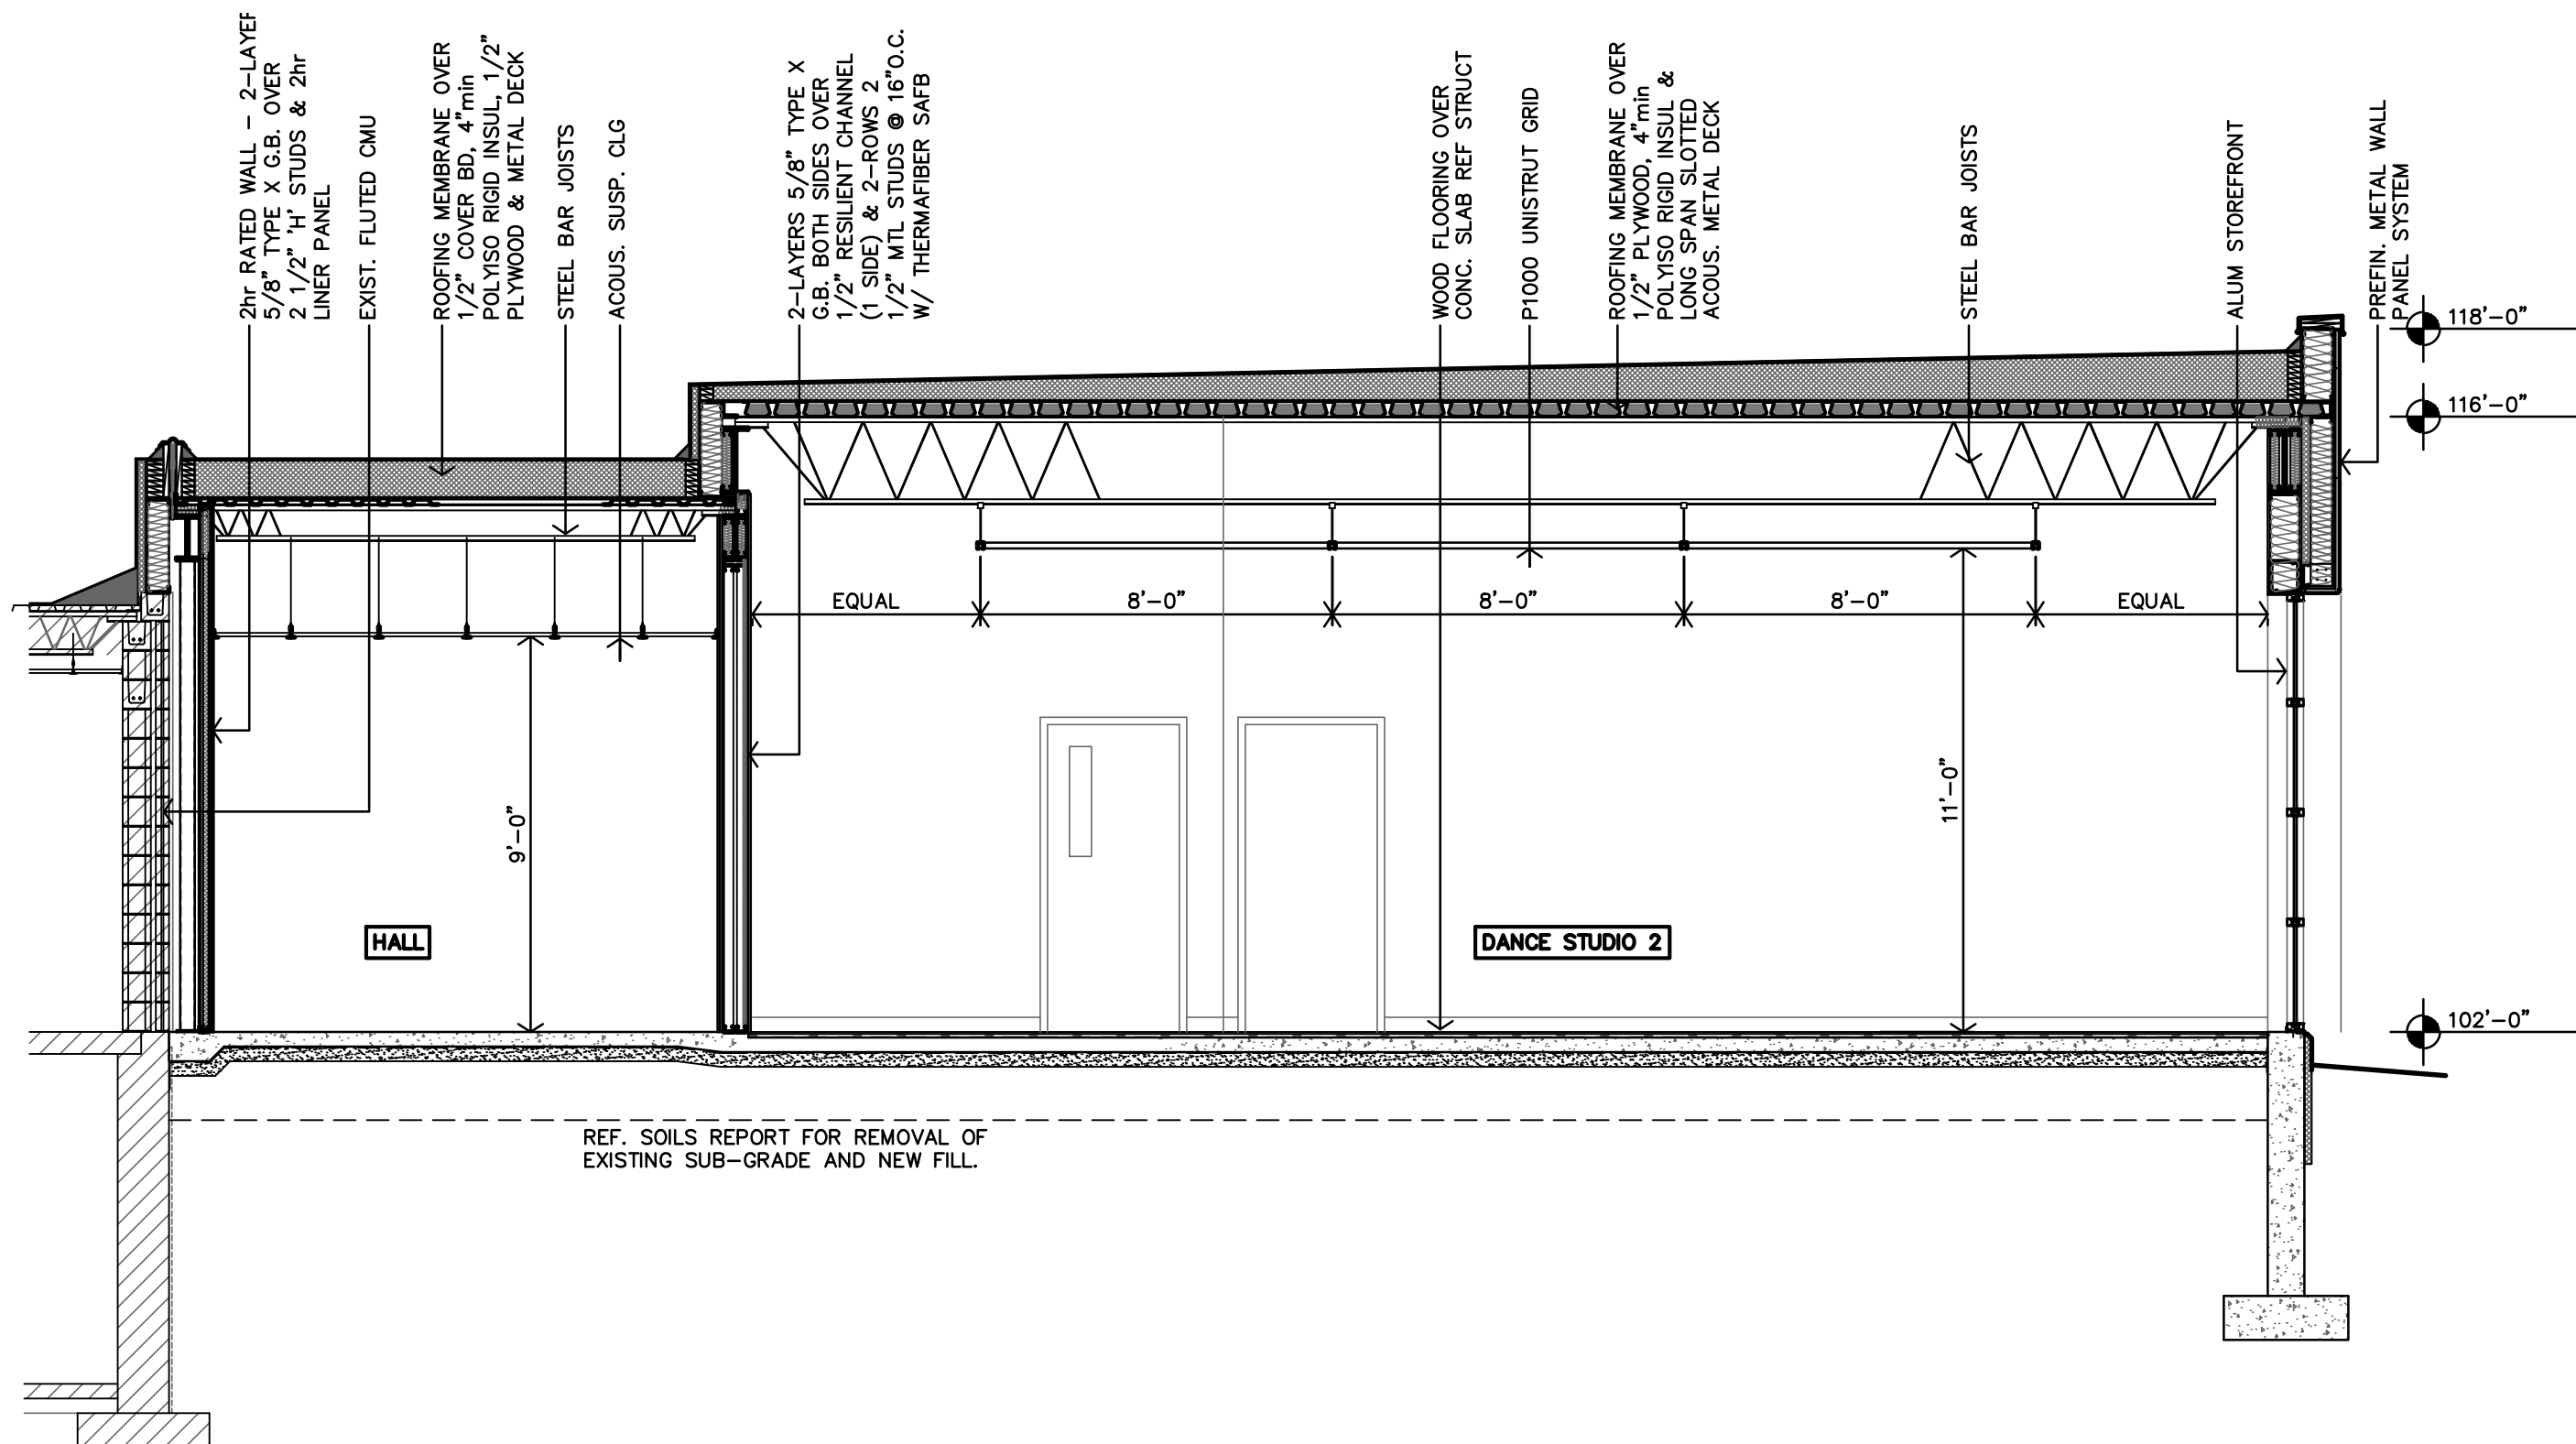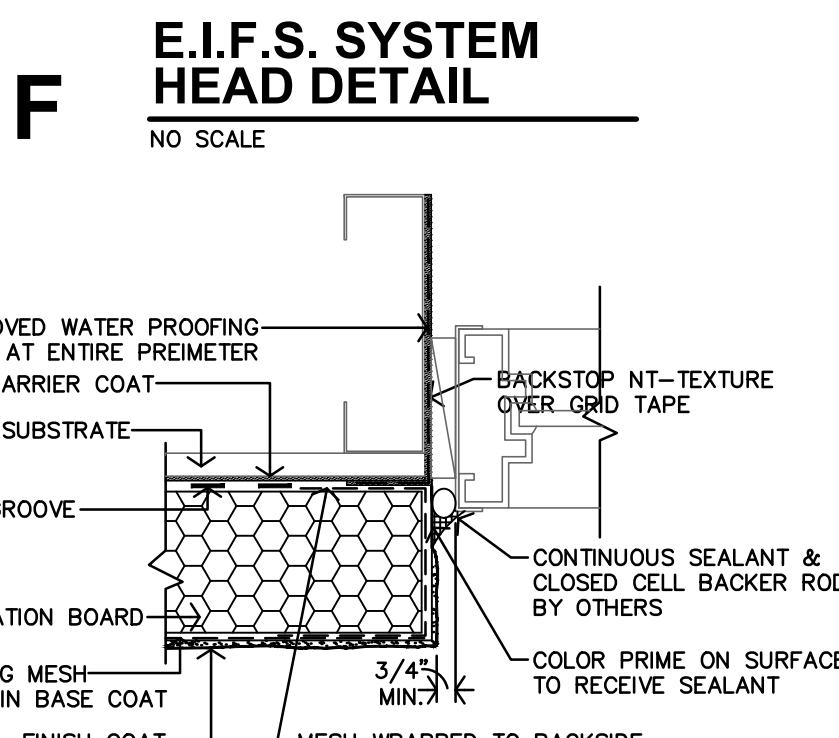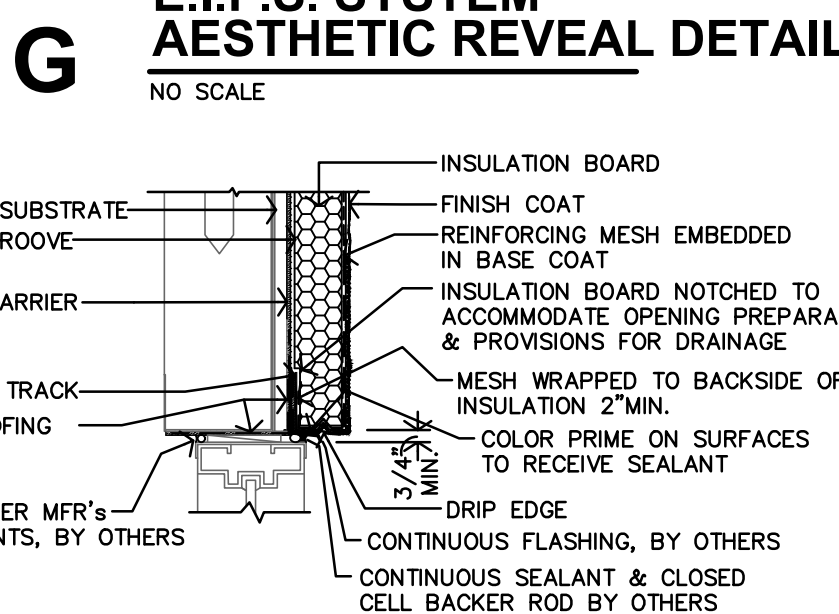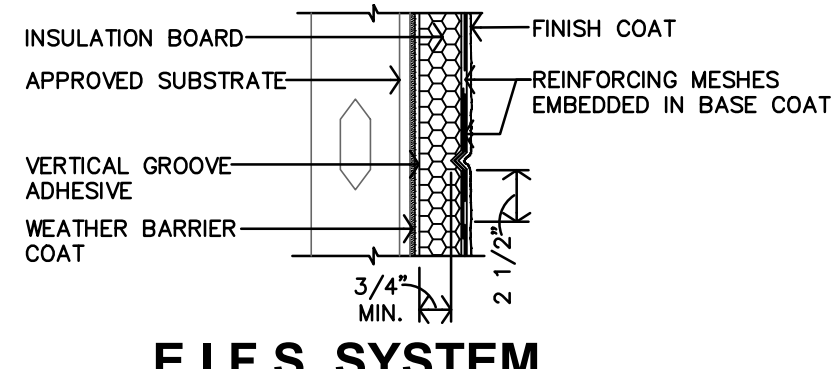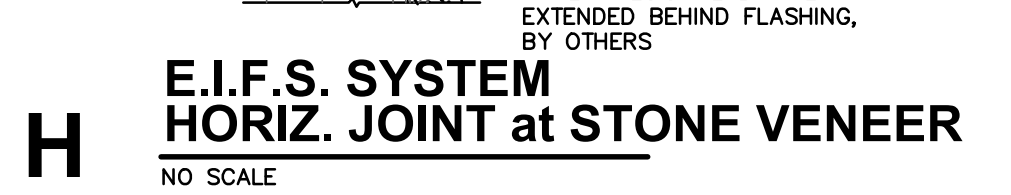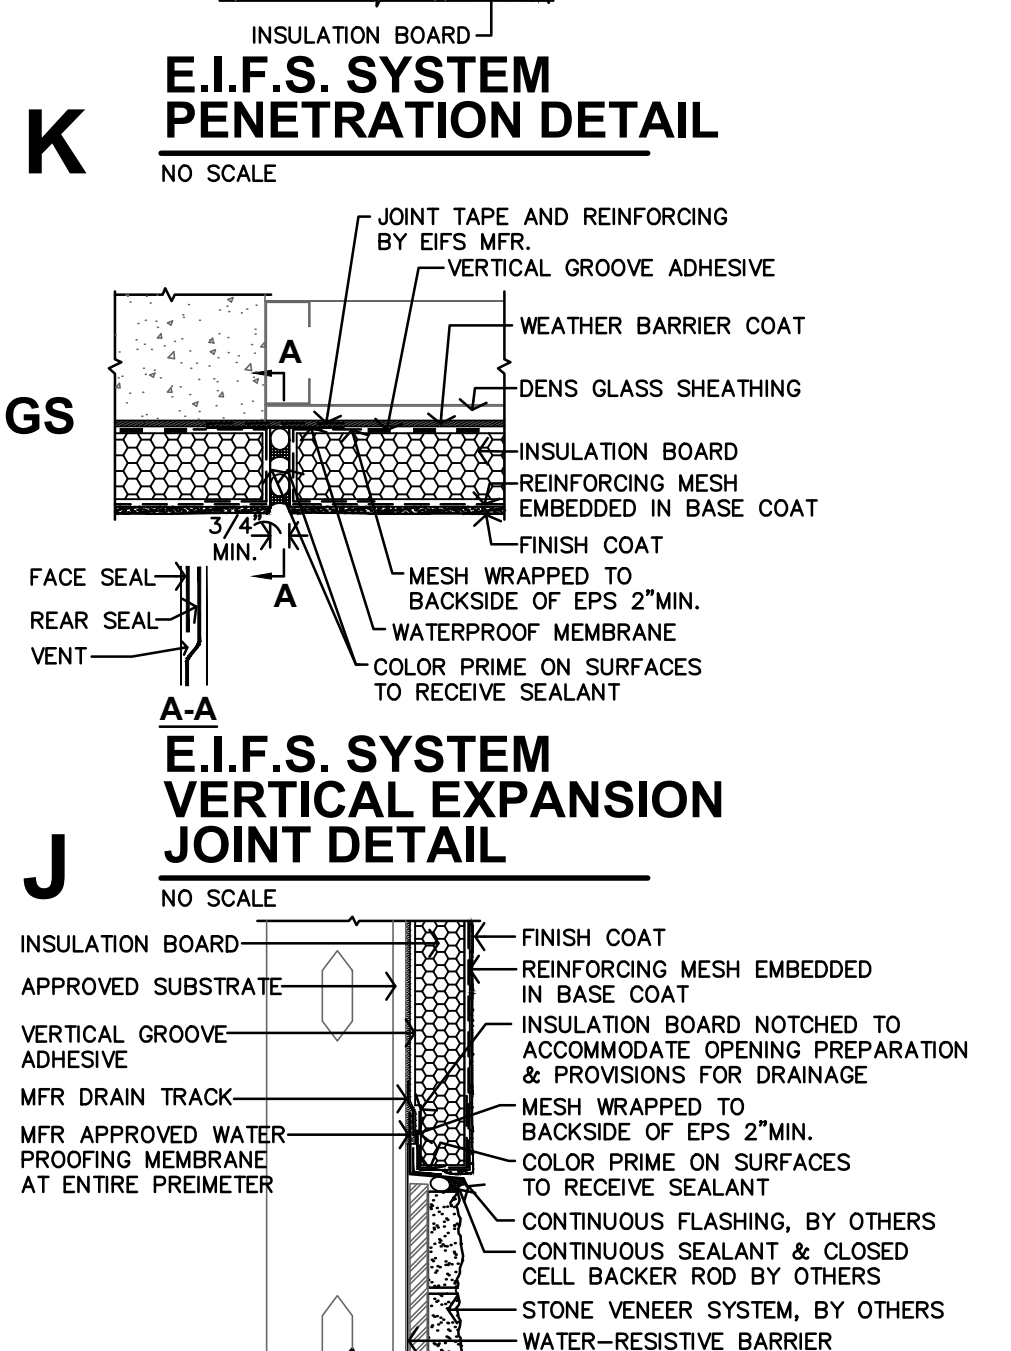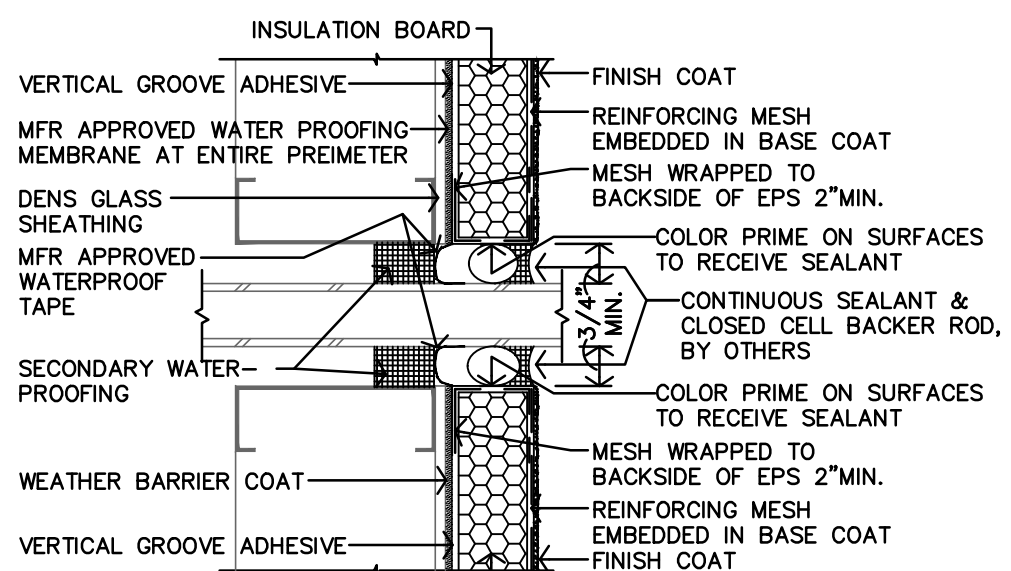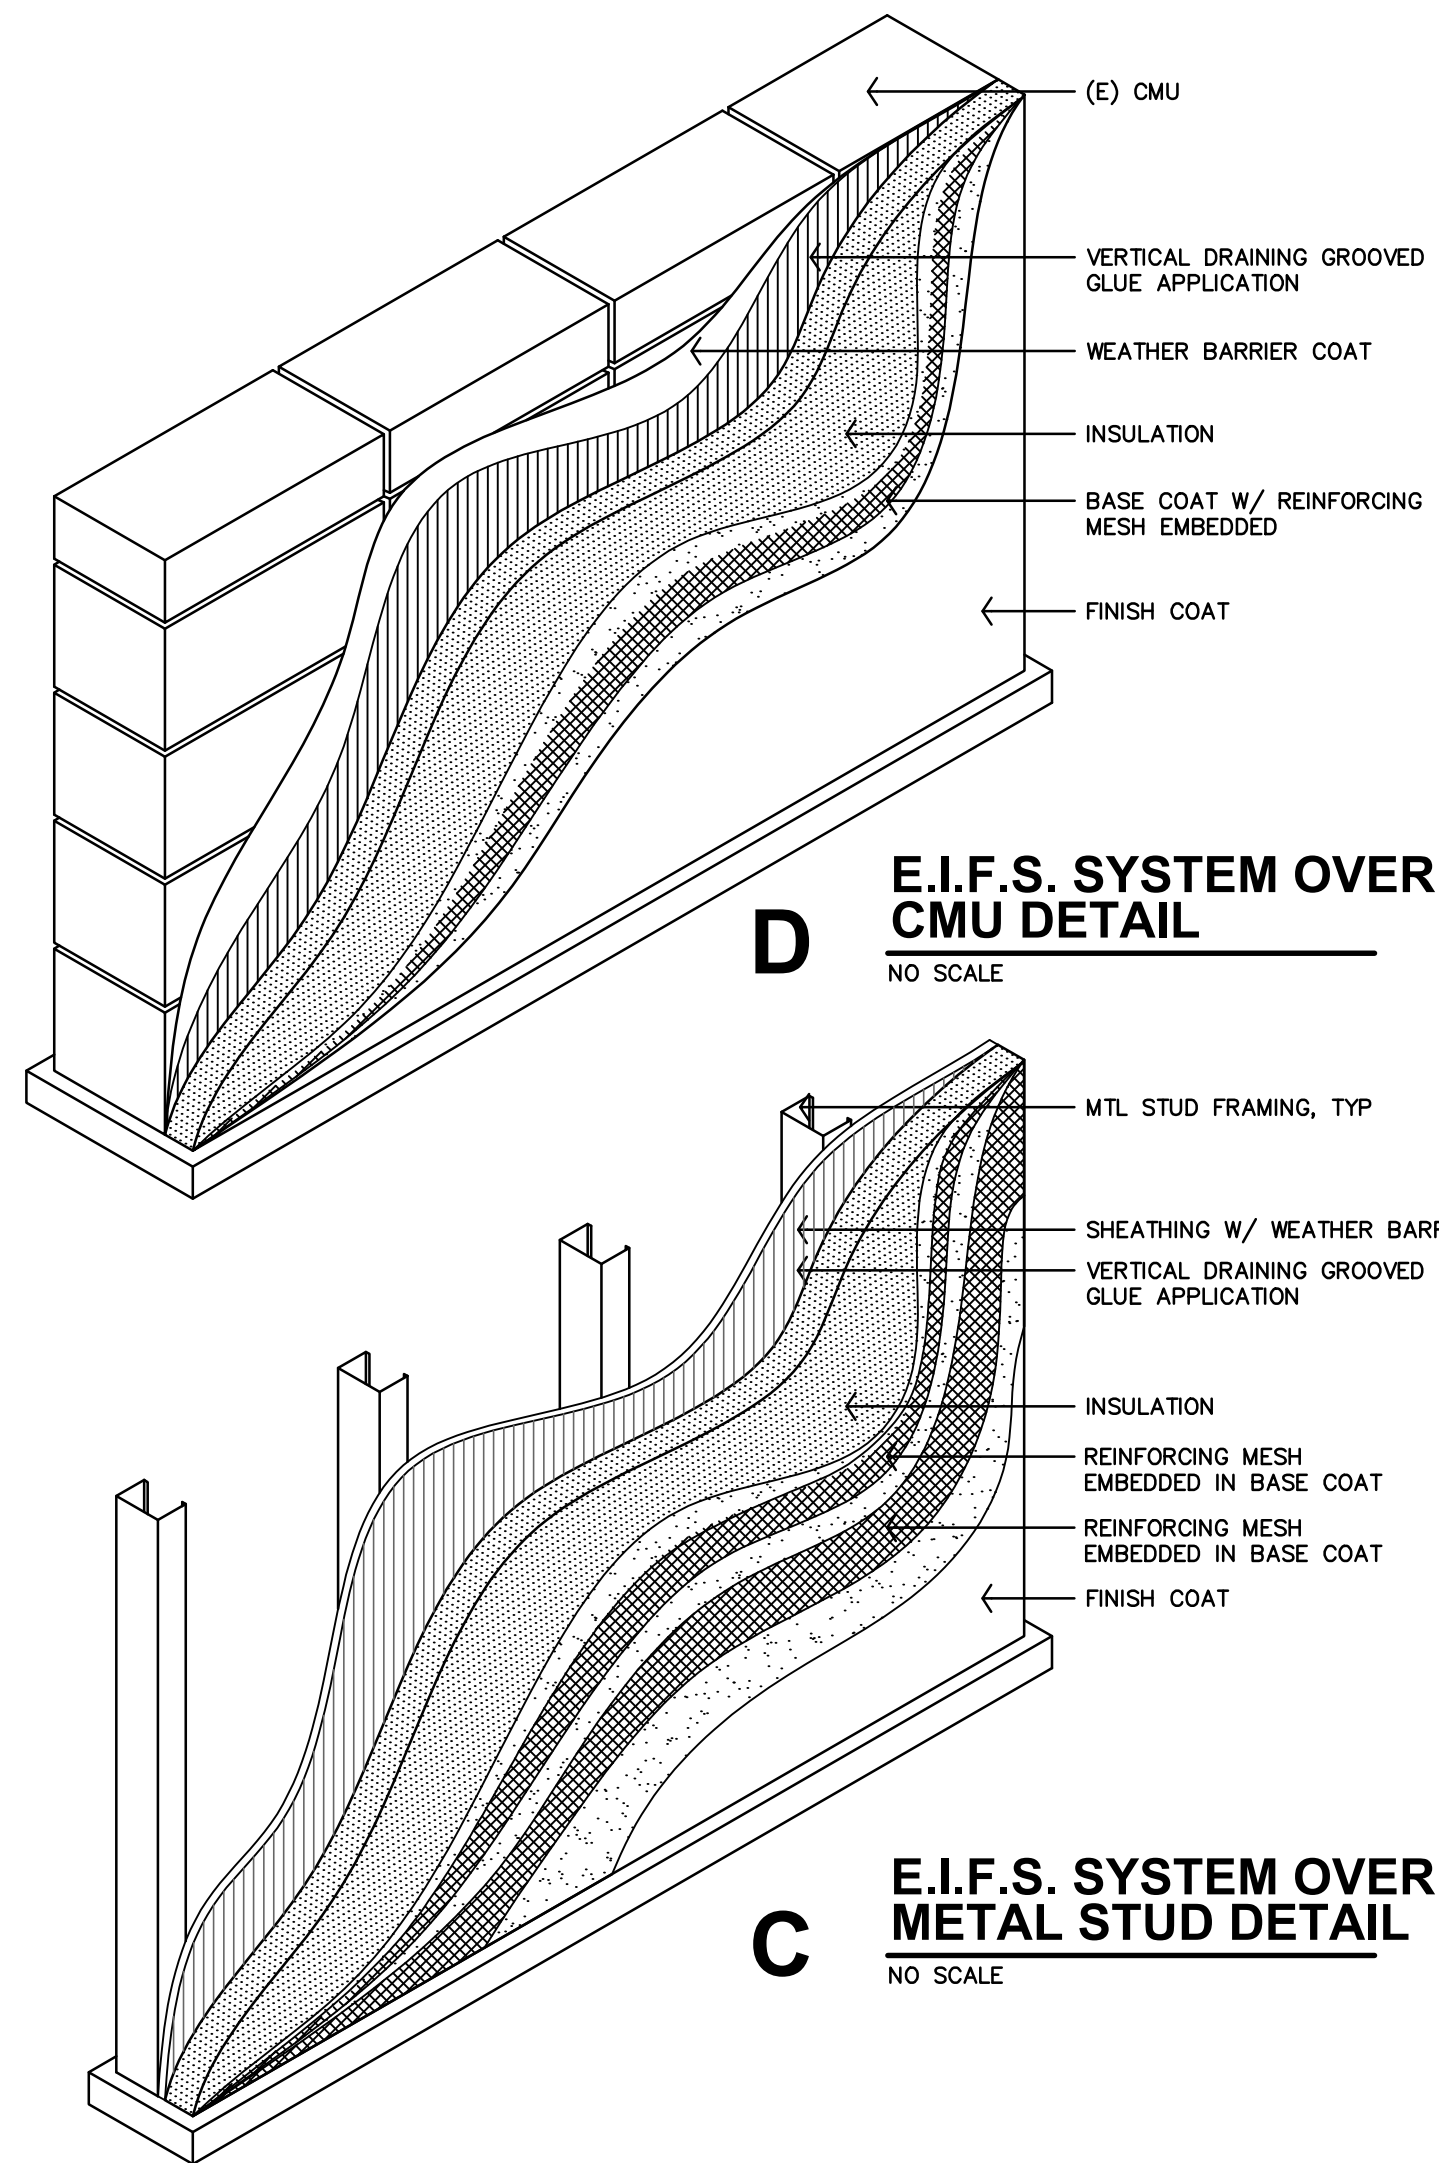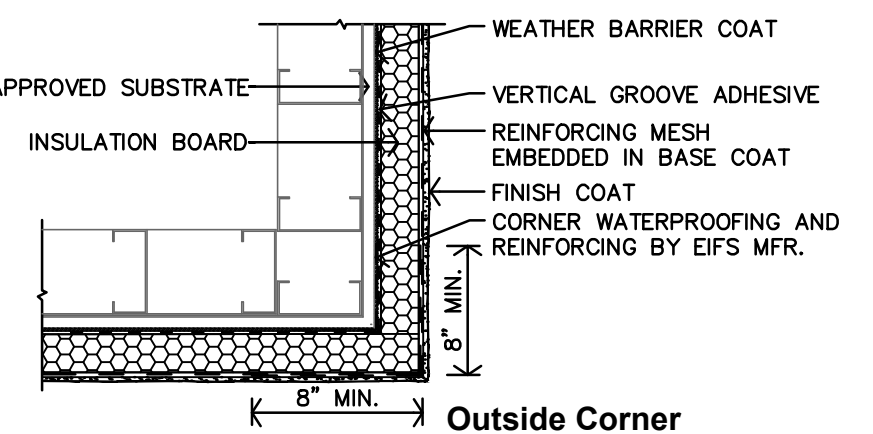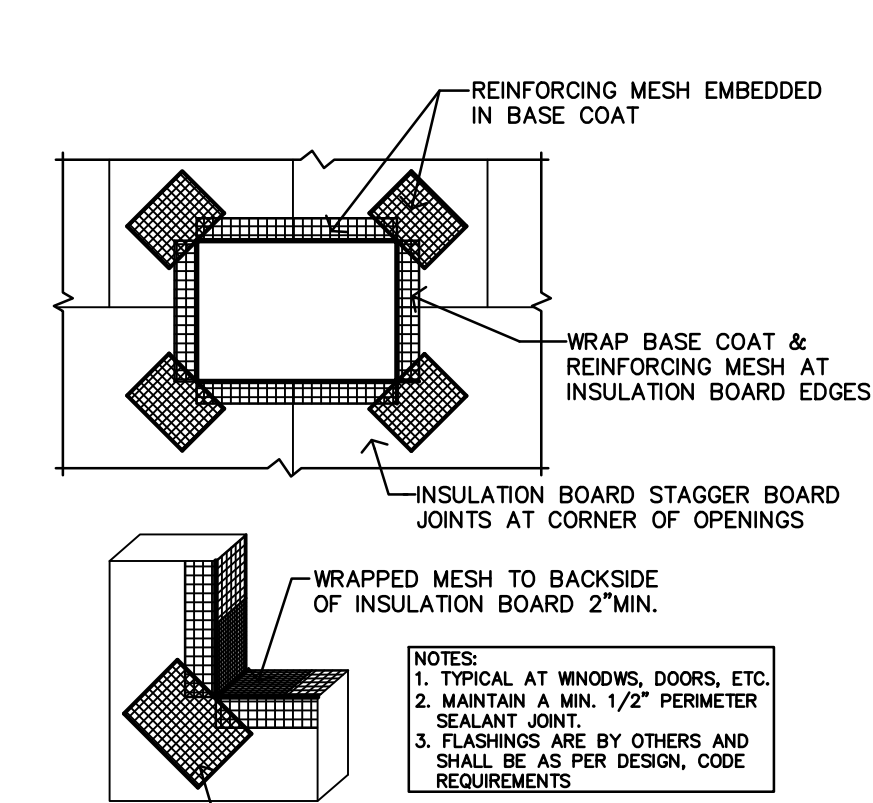


REFERENCE MFR DETAILS FOR ADDITIONAL INFORMATION, DETAILS & RECOMMENDATIONS

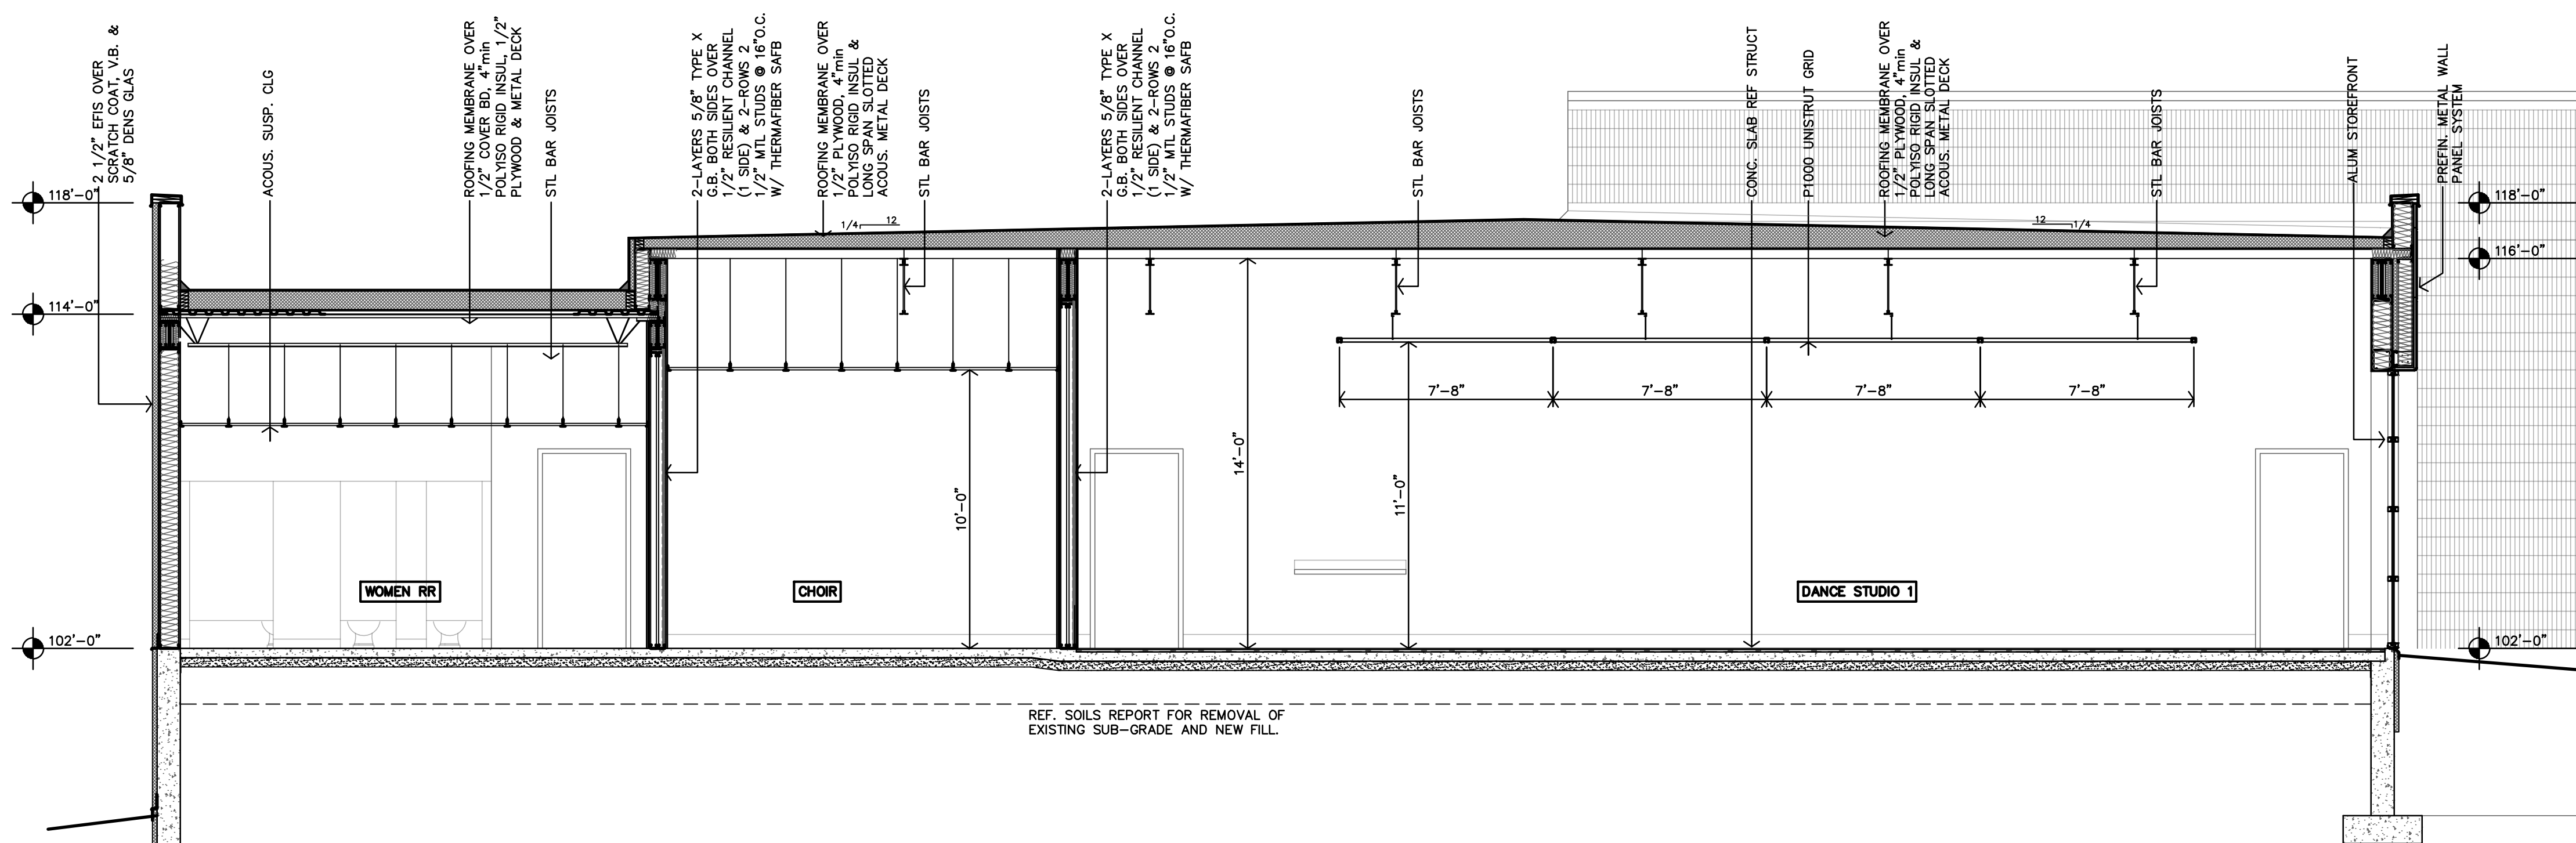




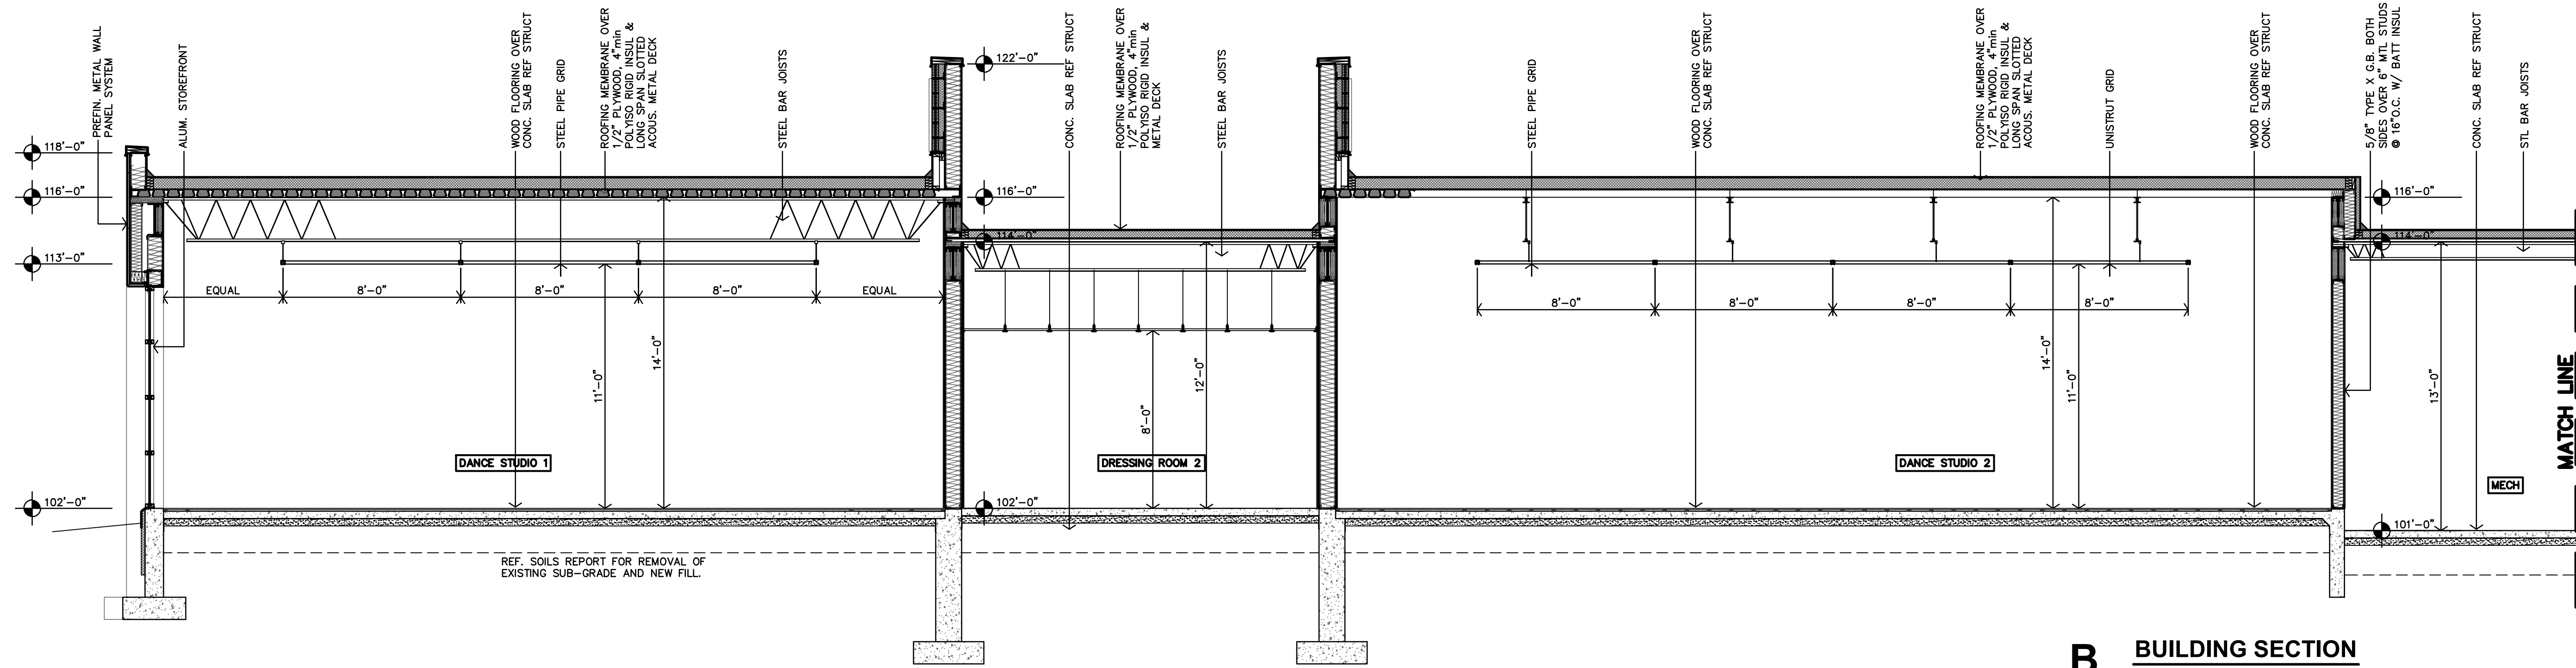

**B BUILDING SECTION**  
1/4"=1'-0"

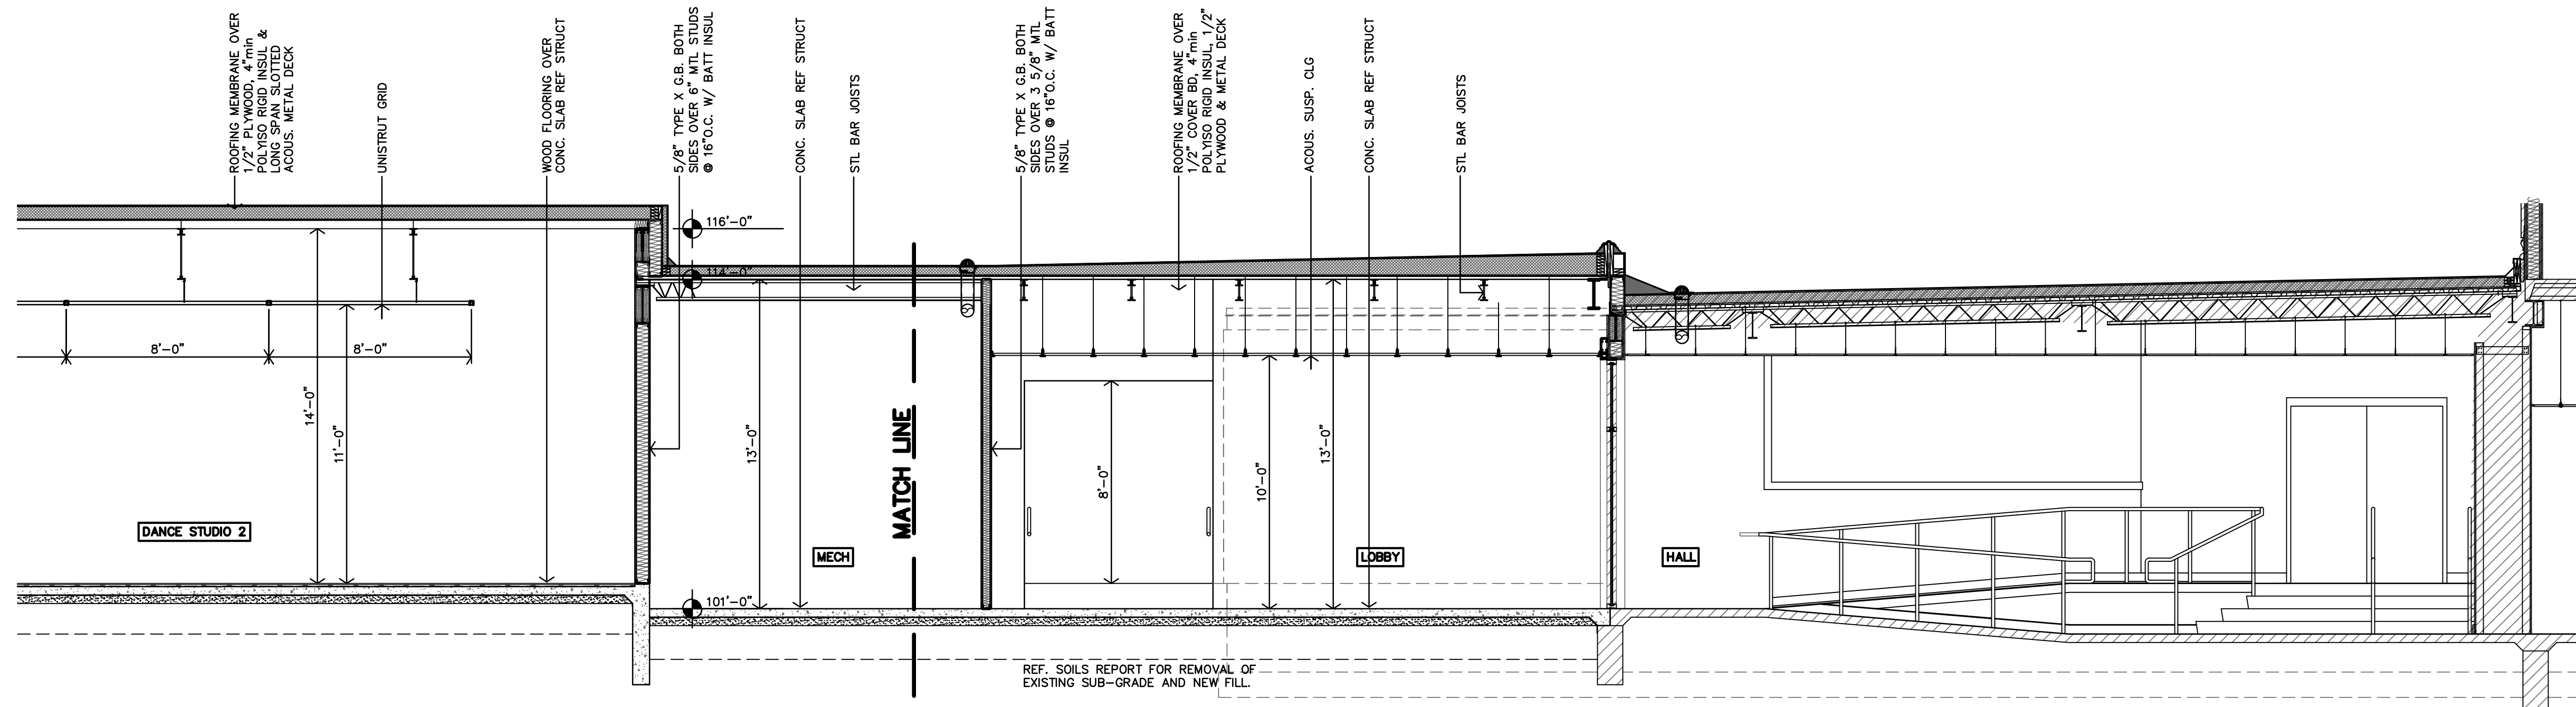

**A BUILDING SECTION**  
1/4"=1'-0"

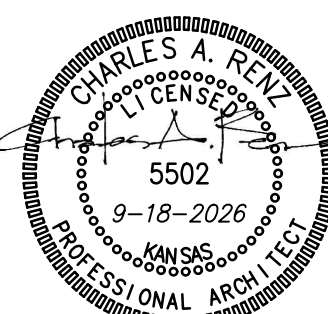

REVISION:

DATE: 9-18-2026

JOB: 22-3239

SHEET NO.:


**A3.5**

**THEATRE SALINA**  
DANCE STUDIOS & SCENE SHOP EXPANSION  
SALINA, KANSAS

**JGR**  
JonesGillamRenz  
730 N. Ninth  
Salina, KS 67401  
785.827.0386  
1881 Main Street, Suite 301  
Kansas City, MO 64108  
jgr@jgrarchitects.com


COPYRIGHTED ©



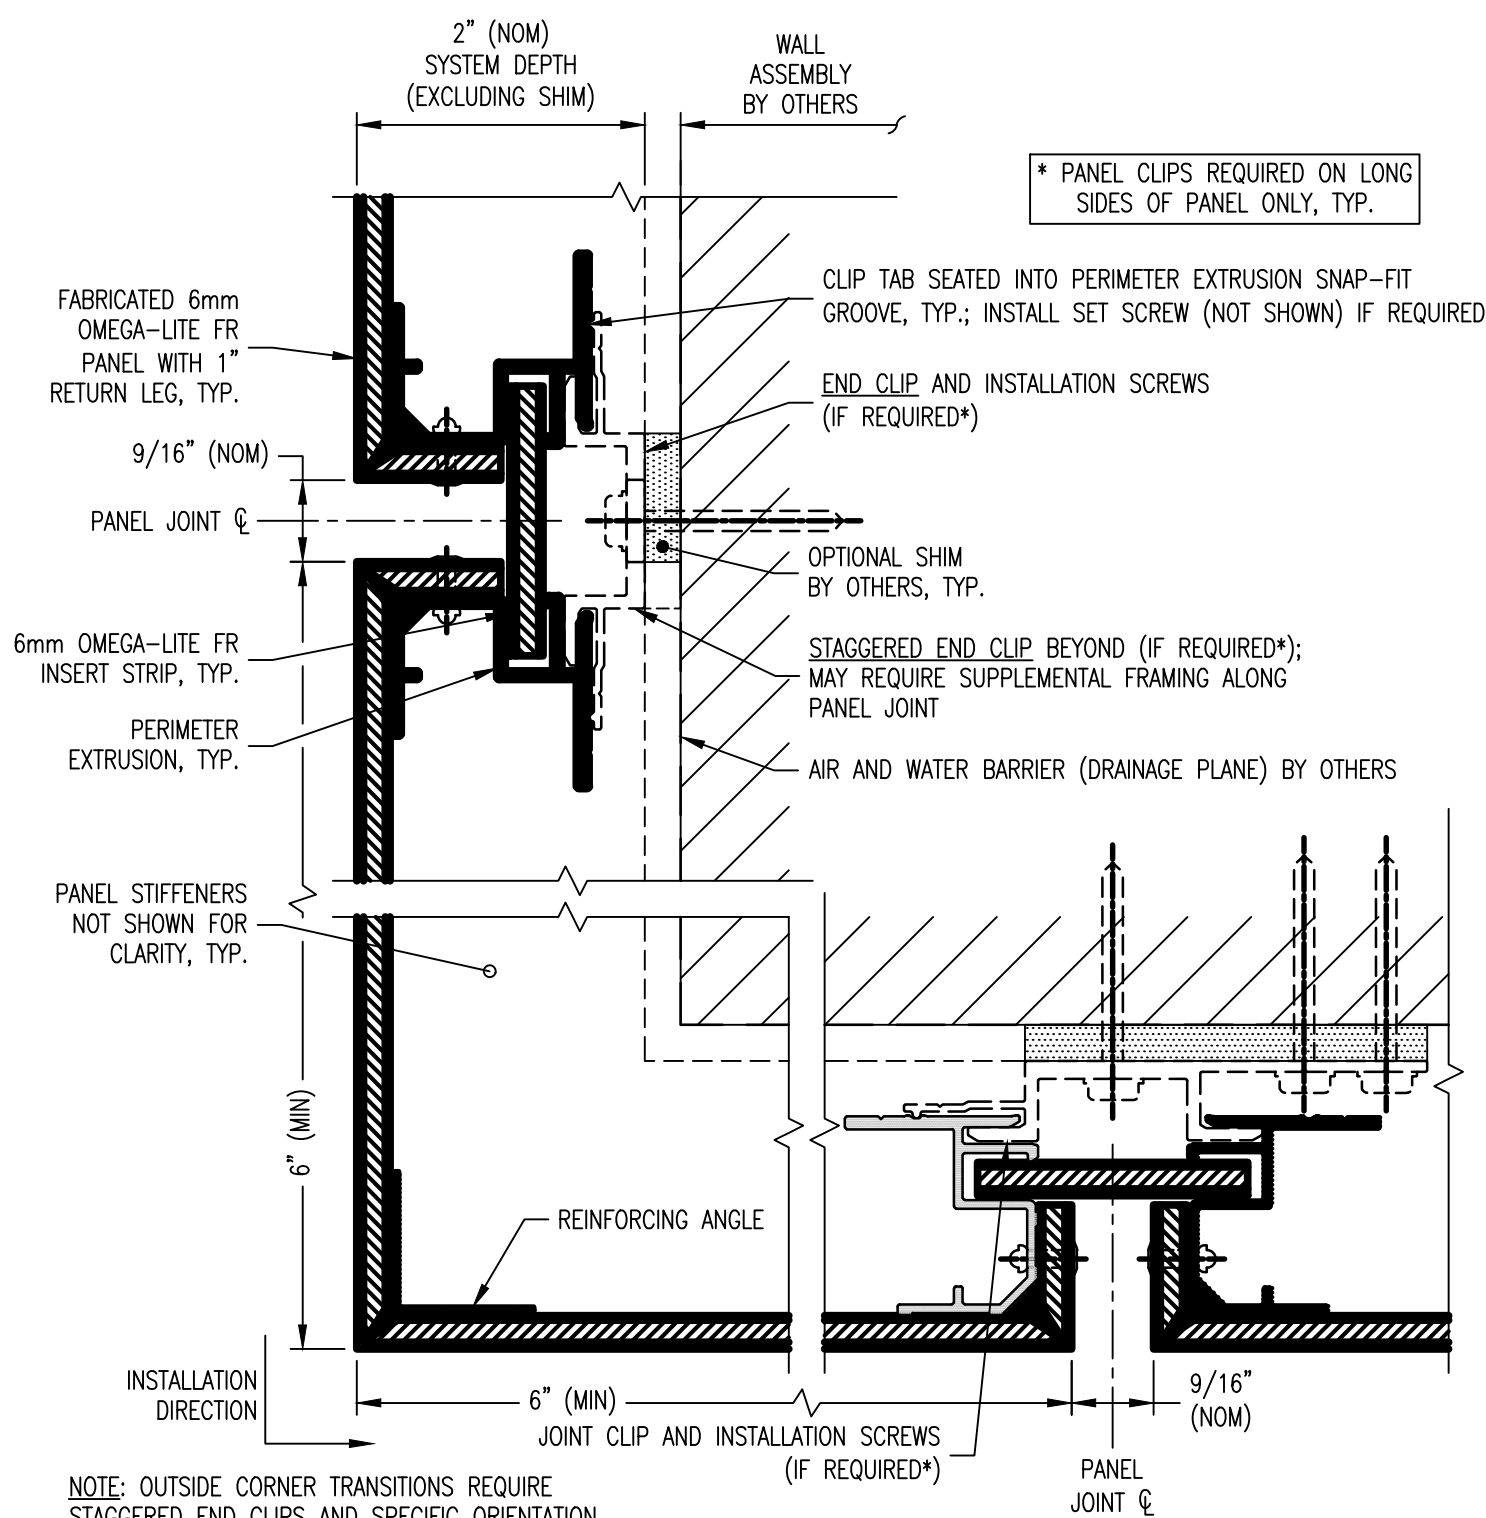


NOTE: OUTSIDE CORNER TRANSITIONS REQUIRE STAGGERED END CLIPS AND SPECIFIC ORIENTATION OF JOINT CLIPS TO SECURE PANEL; REFER TO A-404 FOR MORE INFORMATION

10 OUTSIDE CORNER DETAIL

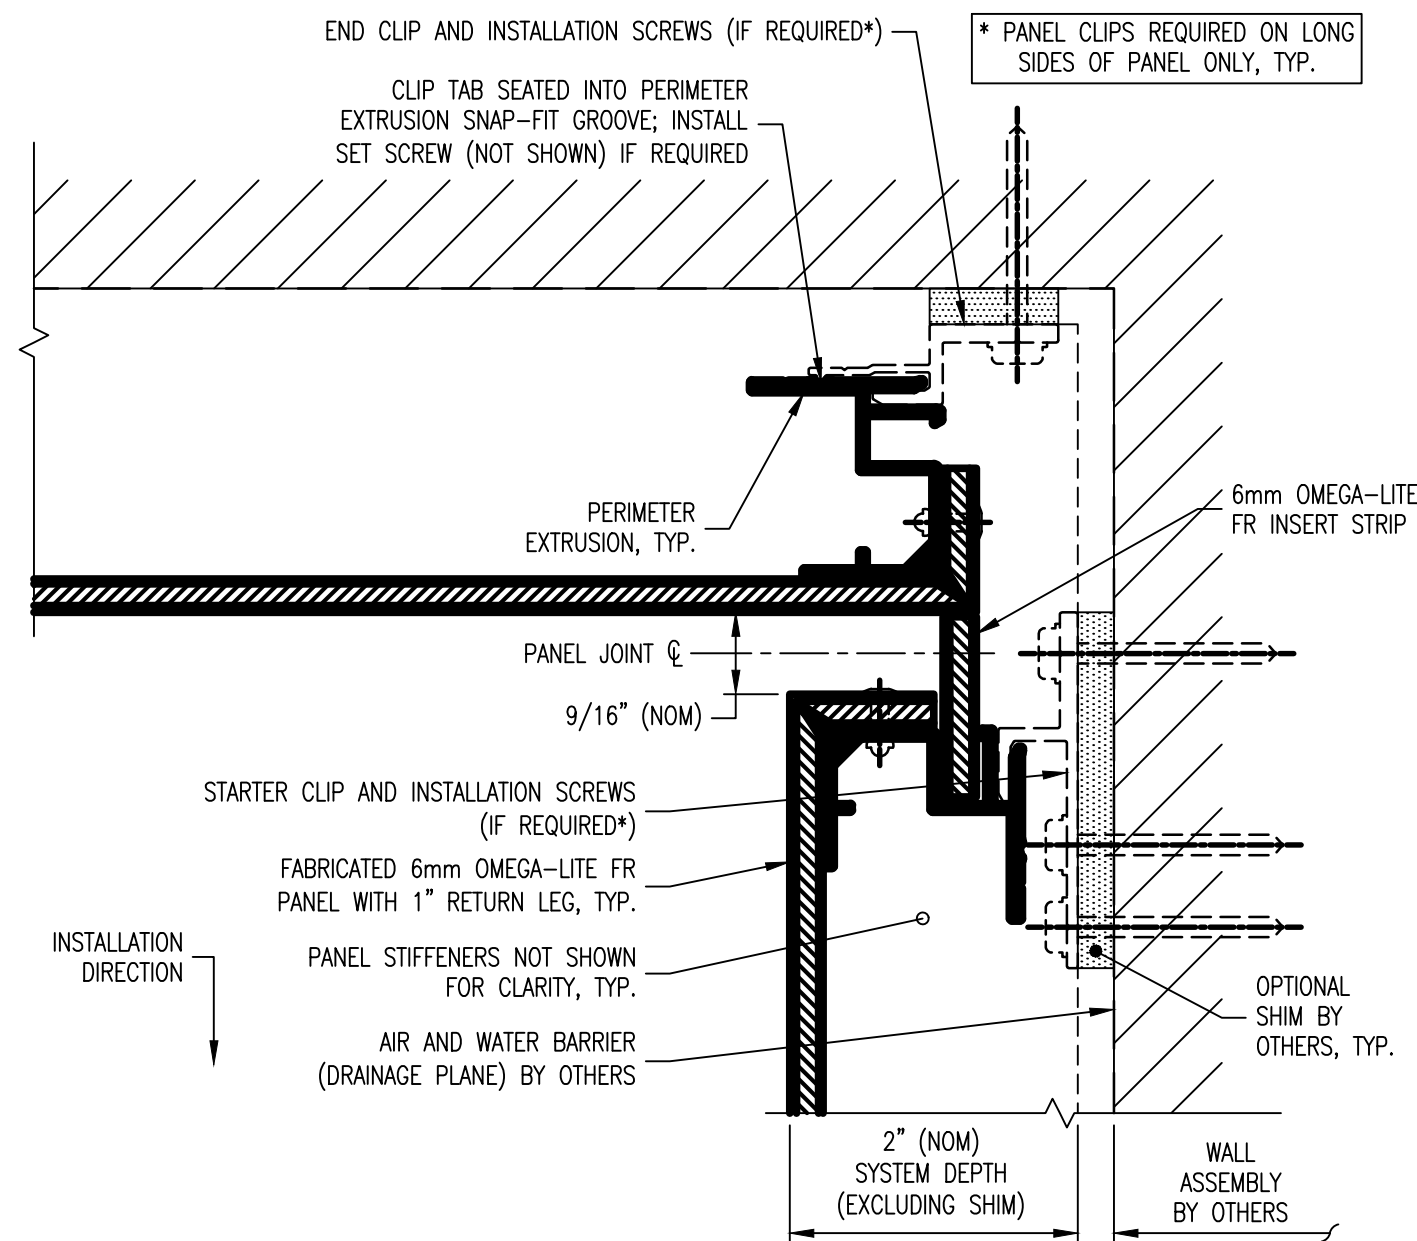


9 INSIDE CORNER DETAIL

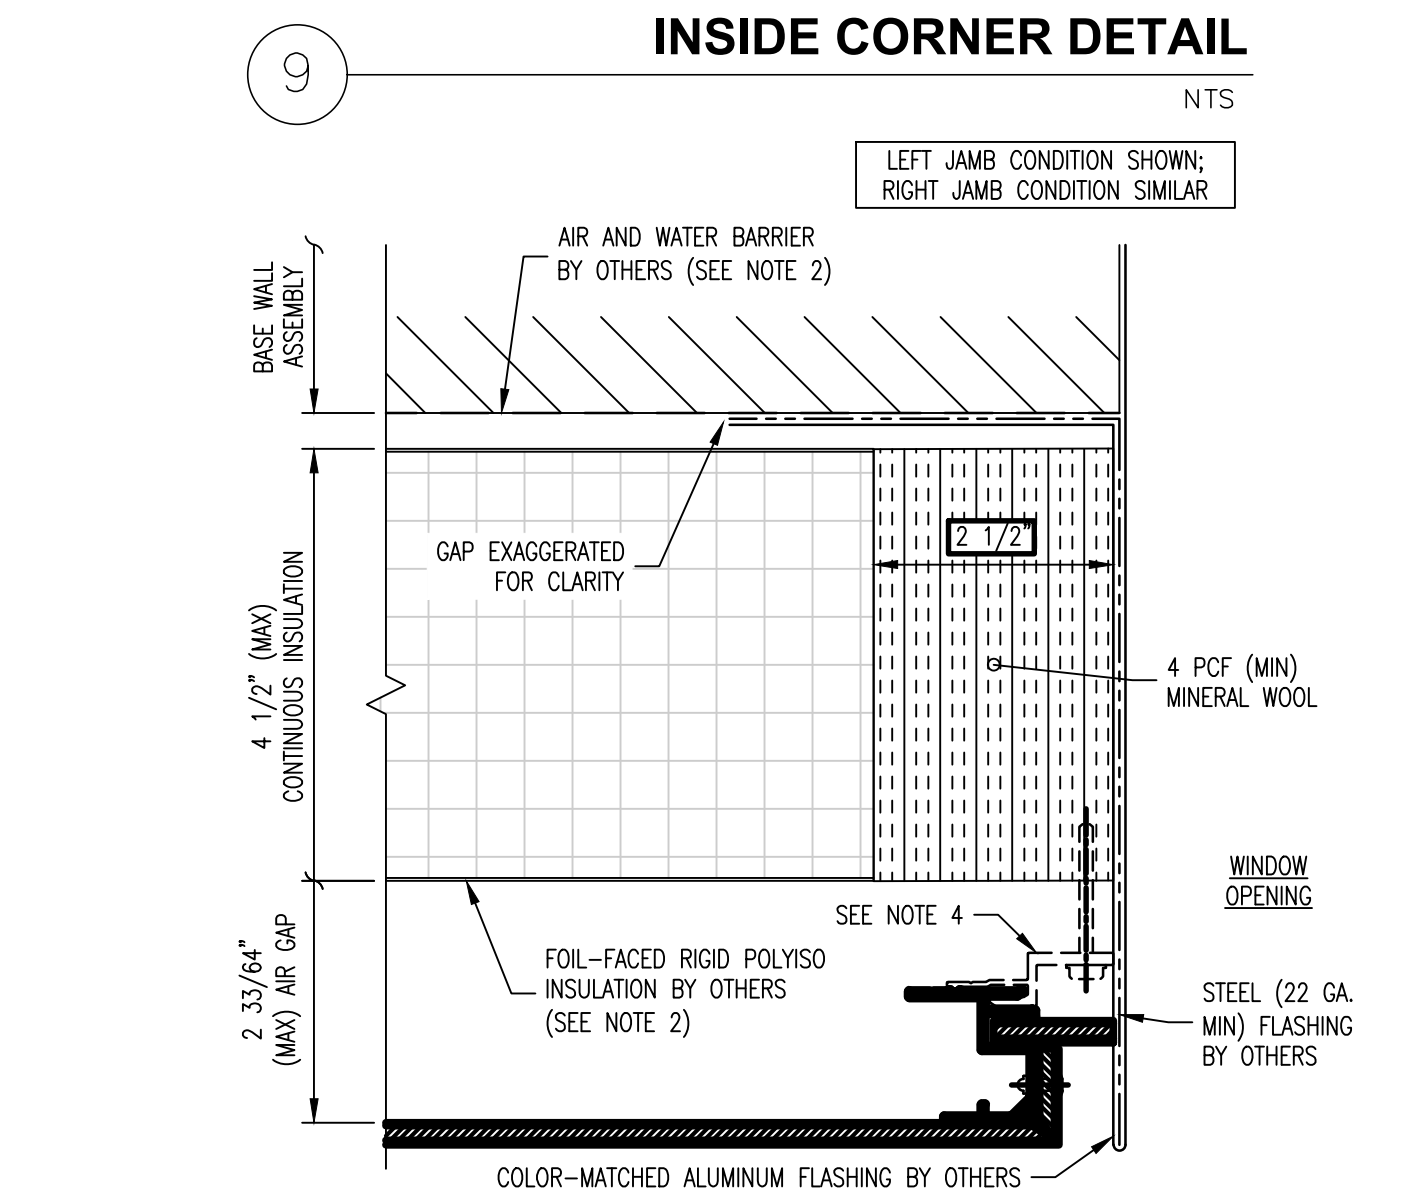


- NOTES:
1. REFER TO A-309 FOR TYPICAL COMPONENTS NOT ANNOTATED
  2. REFER TO EEV AVAILABLE FROM LAMINATORS FOR COMPLIANT INSULATION AND AWB/WRB PRODUCTS
  3. LAMINATORS NFPA 285 TESTING PERFORMED WITH CLADIATOR SLOTTED-Z FIBERGLASS Z-GIRTS; EEV AVAILABLE FROM LAMINATORS PERMITS USE OF 18 GA. (MIN) CFSF IN LIEU OF CLADIATOR PRODUCTS
  4. DETAIL ASSUMES HORIZONTAL Z-GIRT ORIENTATION WITH PANEL CLIPS LOCATED ON LONG SIDES OF PANEL ONLY; PROVIDE SUPPLEMENTAL FRAMING AS REQUIRED TO SUPPORT CLIP LOCATIONS

8 LEFT JAMB AT OPENING (RIGID INSULATION W/ Z GIRTS)

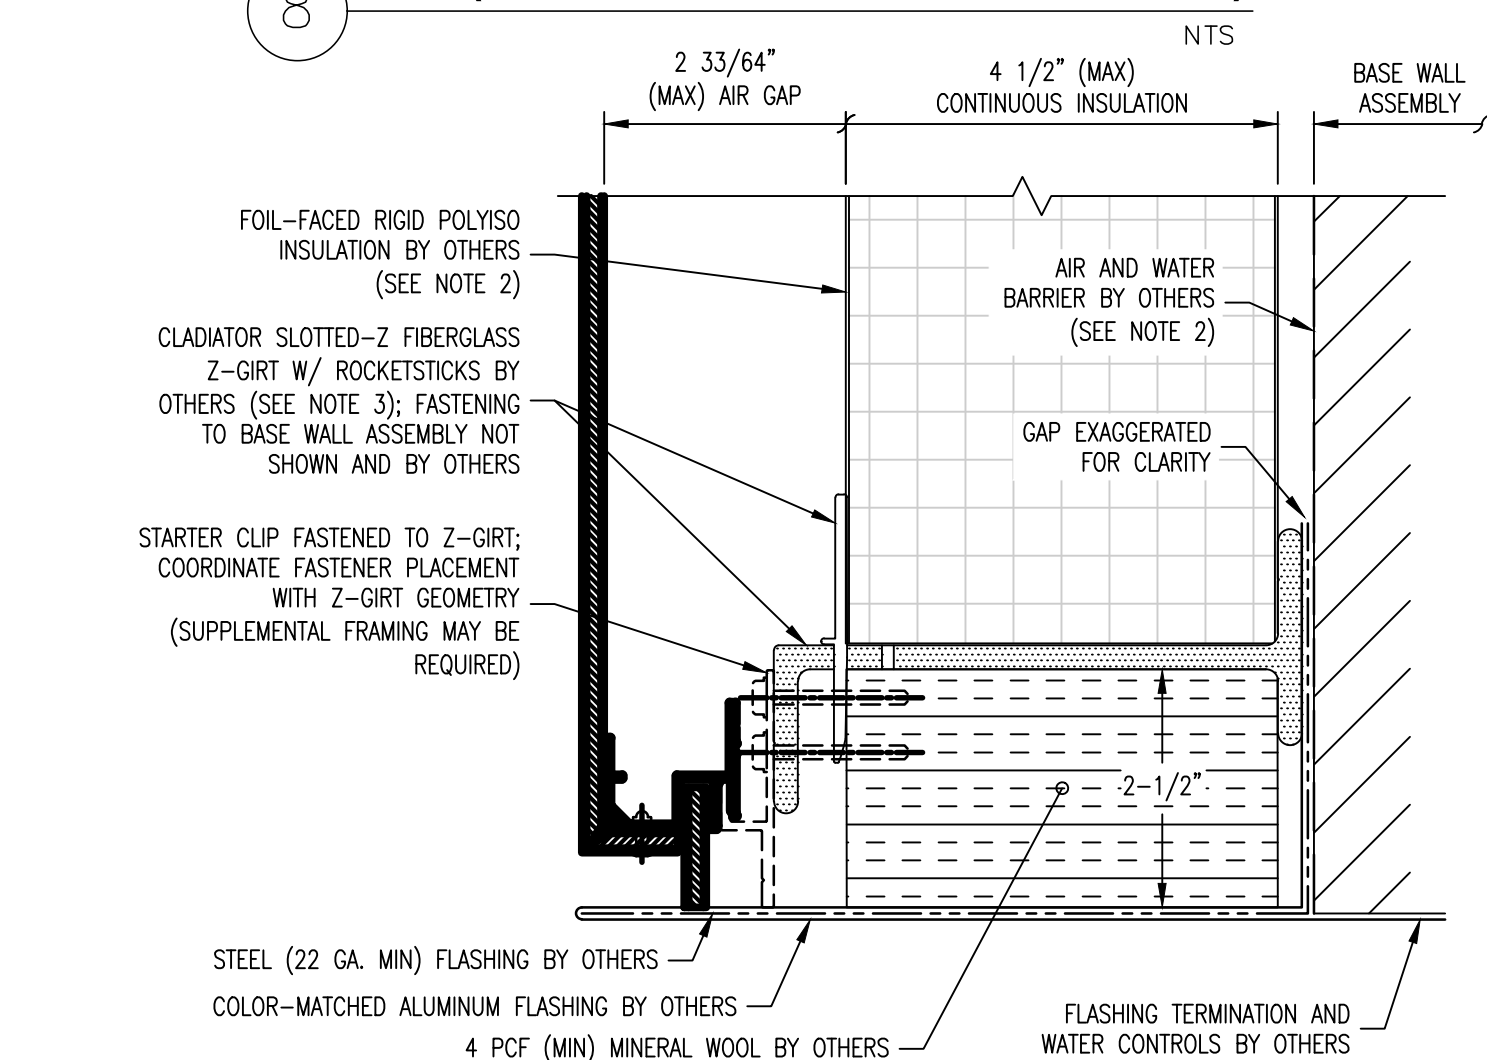


- NOTES:
1. REFER TO A-307 FOR TYPICAL COMPONENTS NOT ANNOTATED
  2. REFER TO EEV AVAILABLE FROM LAMINATORS FOR COMPLIANT INSULATION AND AWB/WRB PRODUCTS
  3. LAMINATORS NFPA 285 TESTING PERFORMED WITH CLADIATOR SLOTTED-Z FIBERGLASS Z-GIRTS; EEV AVAILABLE FROM LAMINATORS PERMITS USE OF 18 GA. (MIN) CFSF IN LIEU OF CLADIATOR PRODUCTS


7 HEAD DETAIL AT OPENING (RIGID INSULATION W/ Z GIRTS)

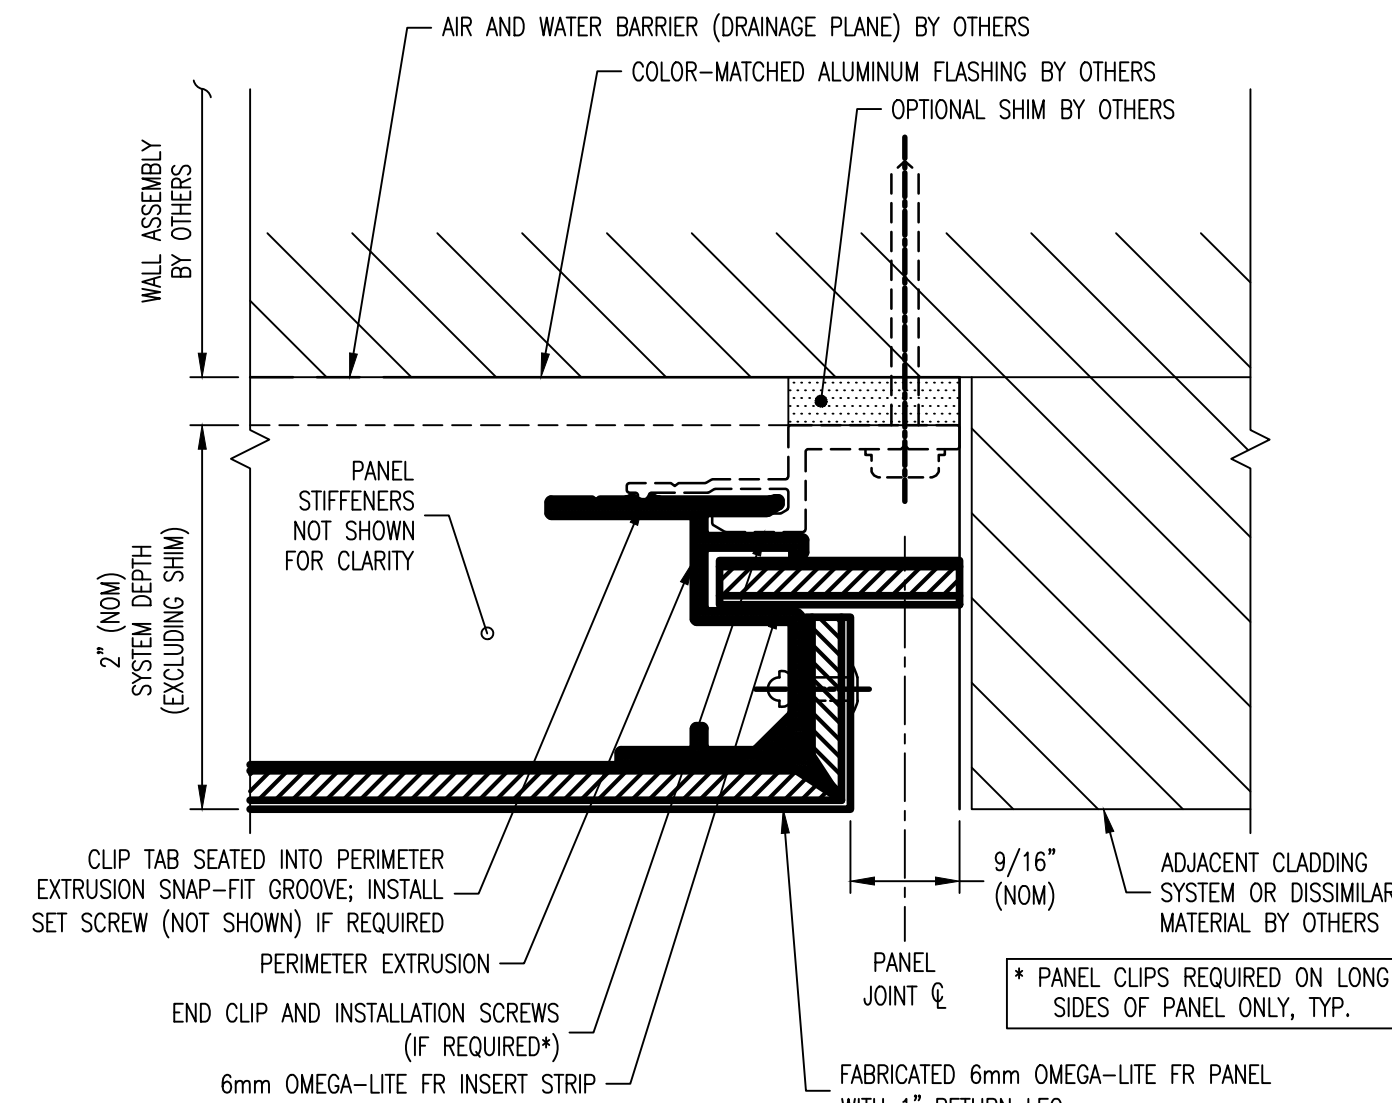

6 RIGHT VERTICAL EDGE DETAIL

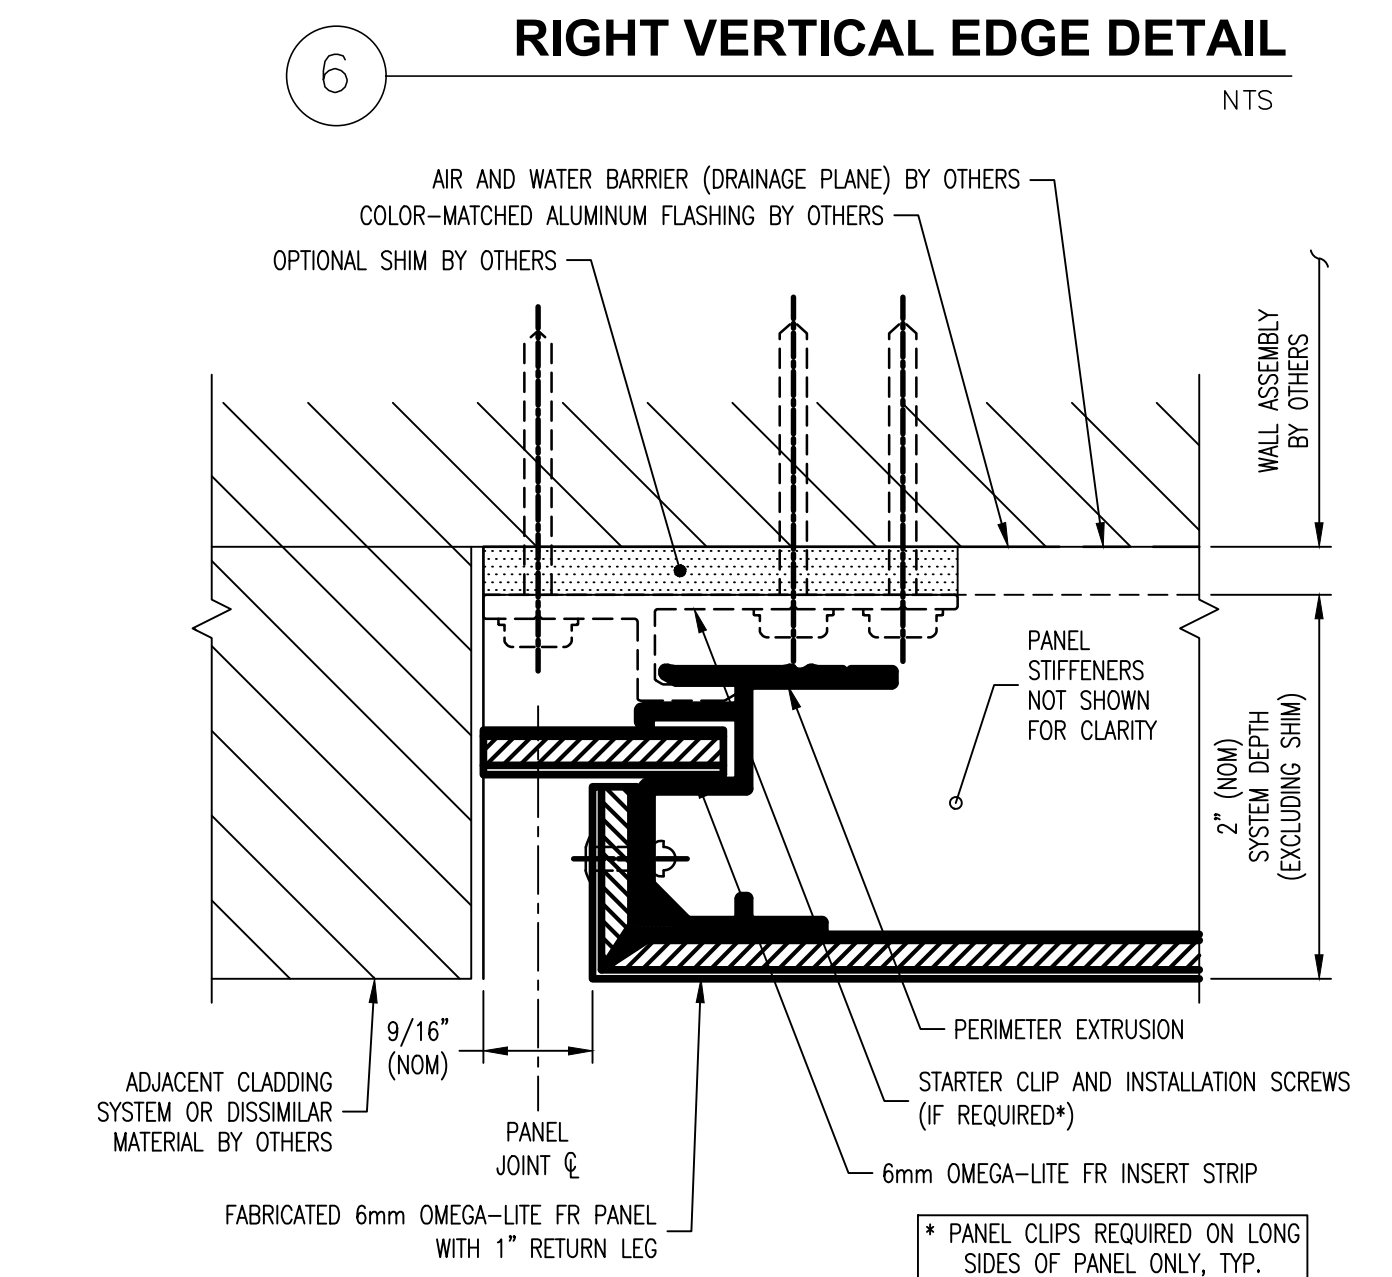


5 LEFT VERTICAL EDGE DETAIL

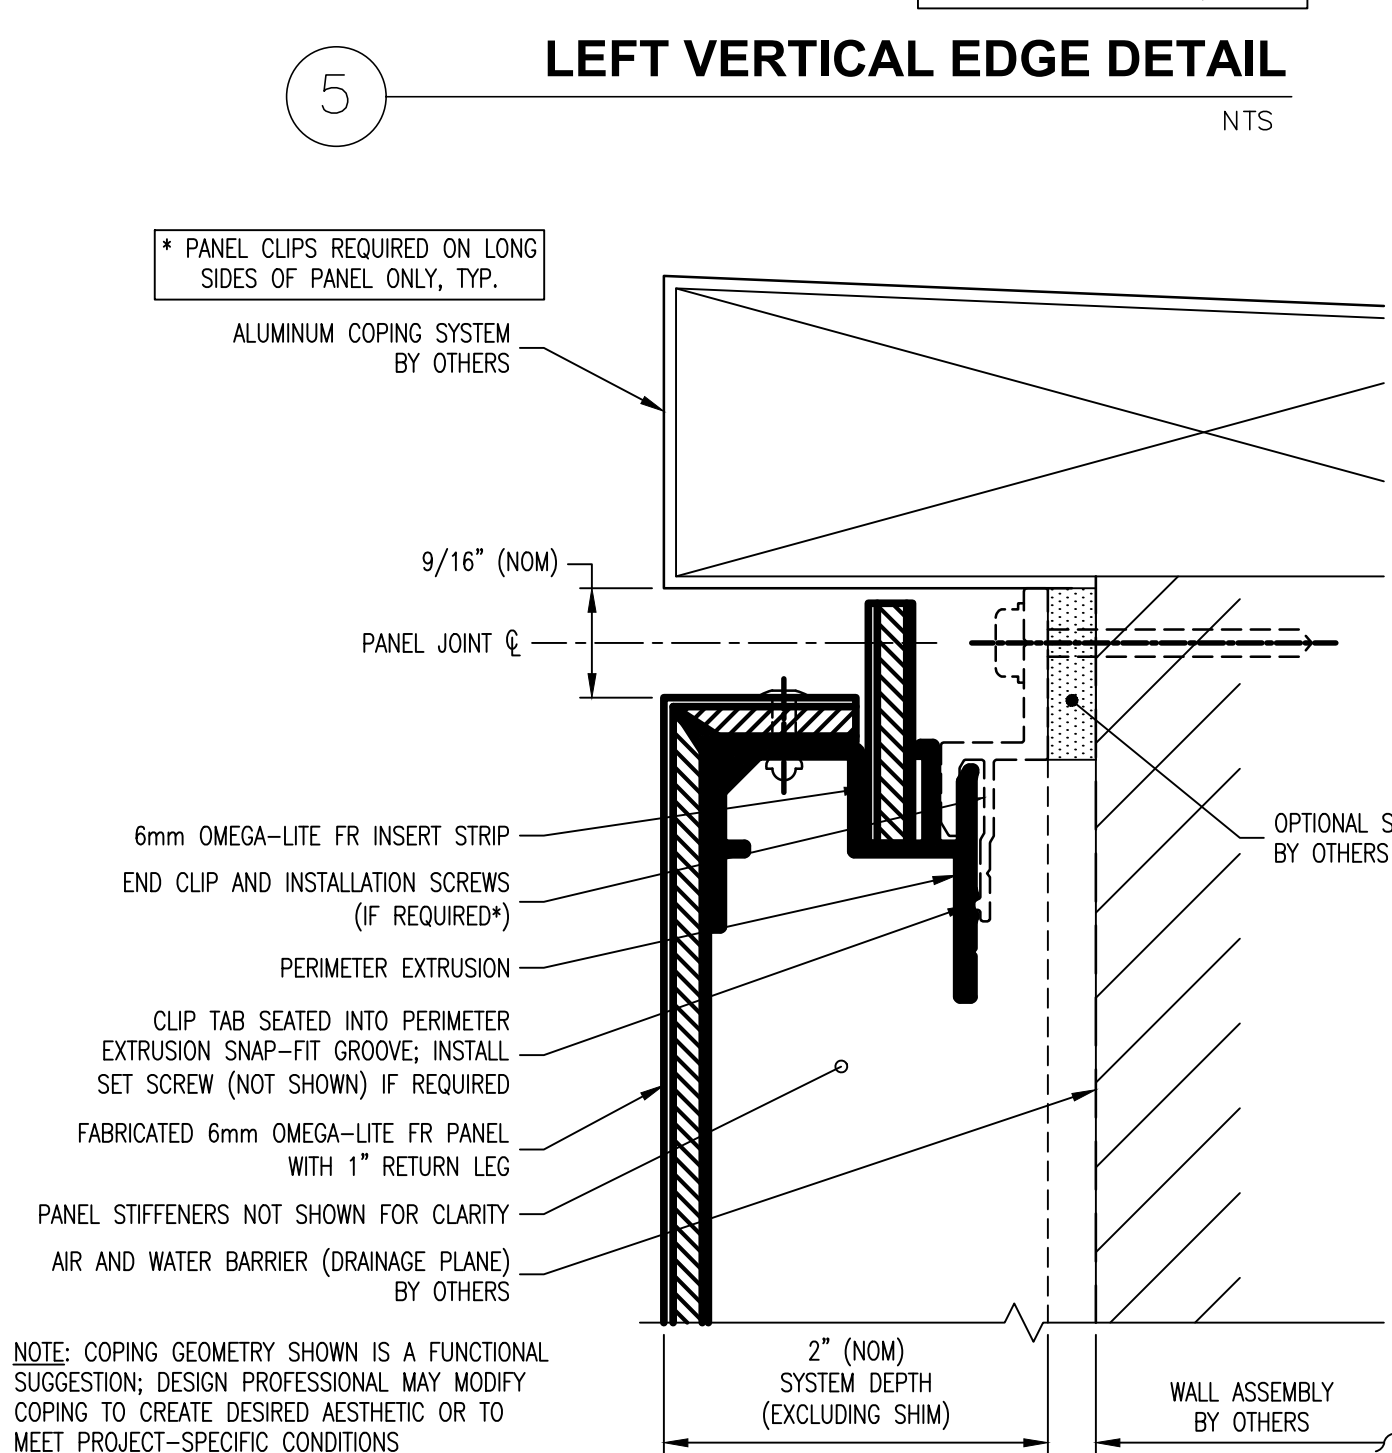


4 TOP HORIZONTAL EDGE DETAIL


NOTE: COPING GEOMETRY SHOWN IS A FUNCTIONAL SUGGESTION; DESIGN PROFESSIONAL MAY MODIFY COPING TO CREATE DESIRED AESTHETIC OR TO MEET PROJECT-SPECIFIC CONDITIONS

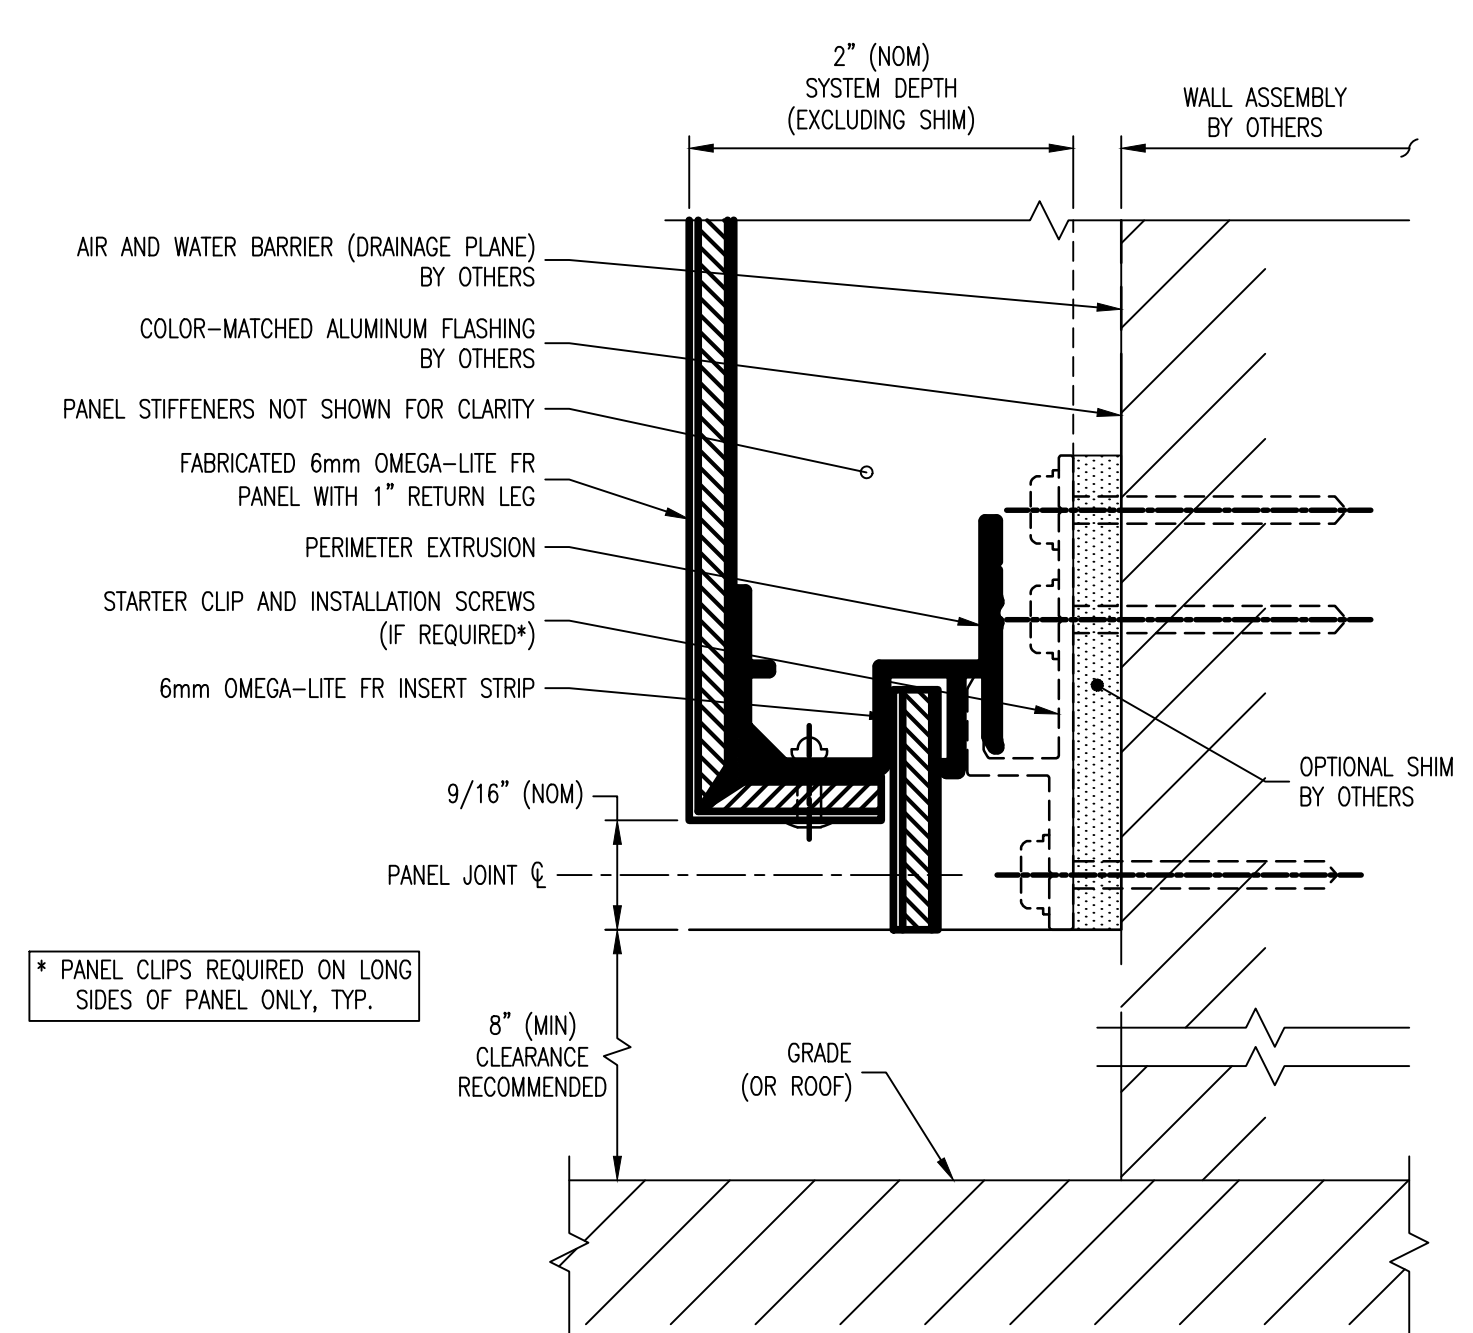

3 BOTTOM HORIZONTAL EDGE DETAIL

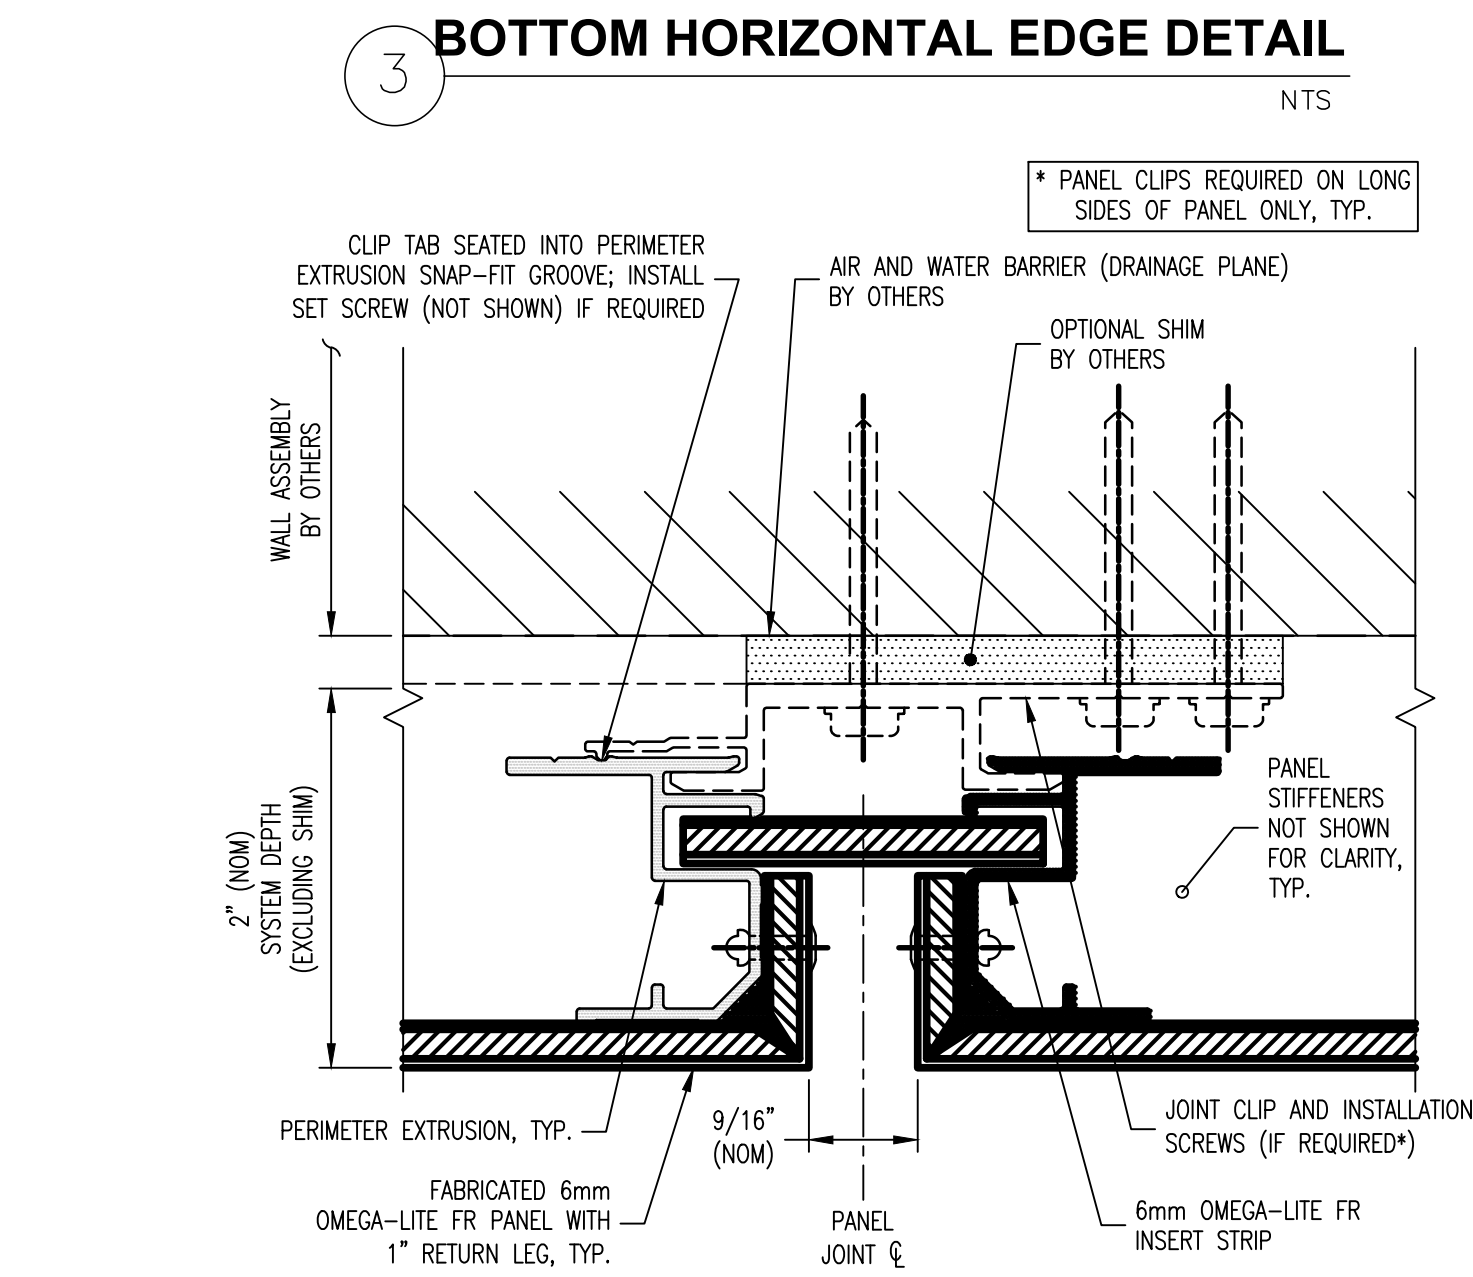

2 VERTICAL JOINT DETAIL

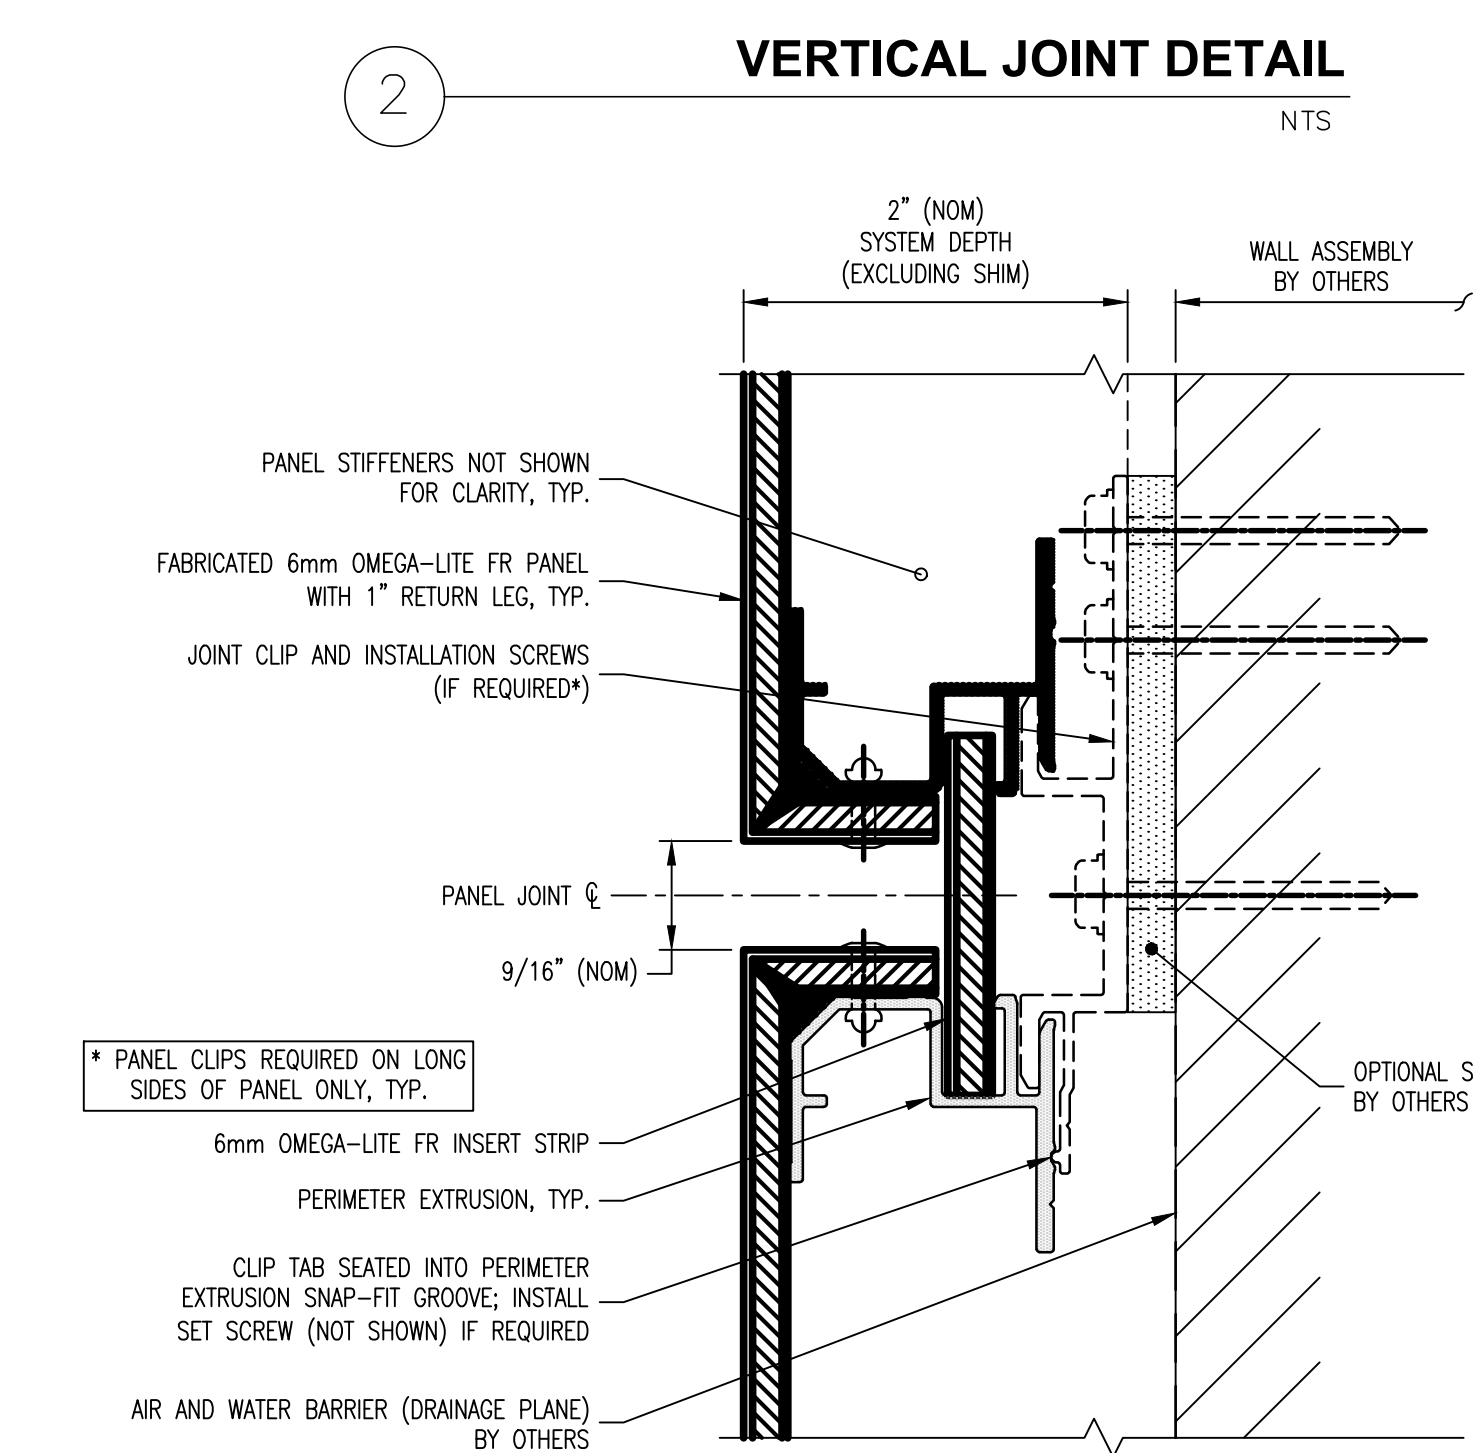

1 HORIZONTAL JOINT DETAIL

## LAMINATORS INC. PANEL SYSTEM

Manufacturers Installation Details, Install as indicated, Actual Conditions May Vary


DETAILS ARE NOT TO SCALE

REFERENCE MFR DETAILS FOR ADDITIONAL INFORMATION, DETAILS & RECOMMENDATIONS

JonesGillamRenz  
1881 Main Street, Suite 301  
Salina, KS 67401  
785.827.0386  
jgr@jgarchitects.com

JGR

THEATRE SALINA  
DANCE STUDIOS & SCENE SHOP EXPANSION  
SALINA, KANSAS

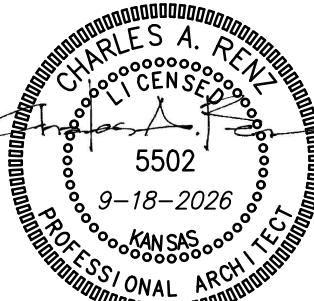



REVISION:

DATE:	9-18-2026
JOB:	22-3239
SHEET NO.:	

A3.6



COPYRIGHTED ©



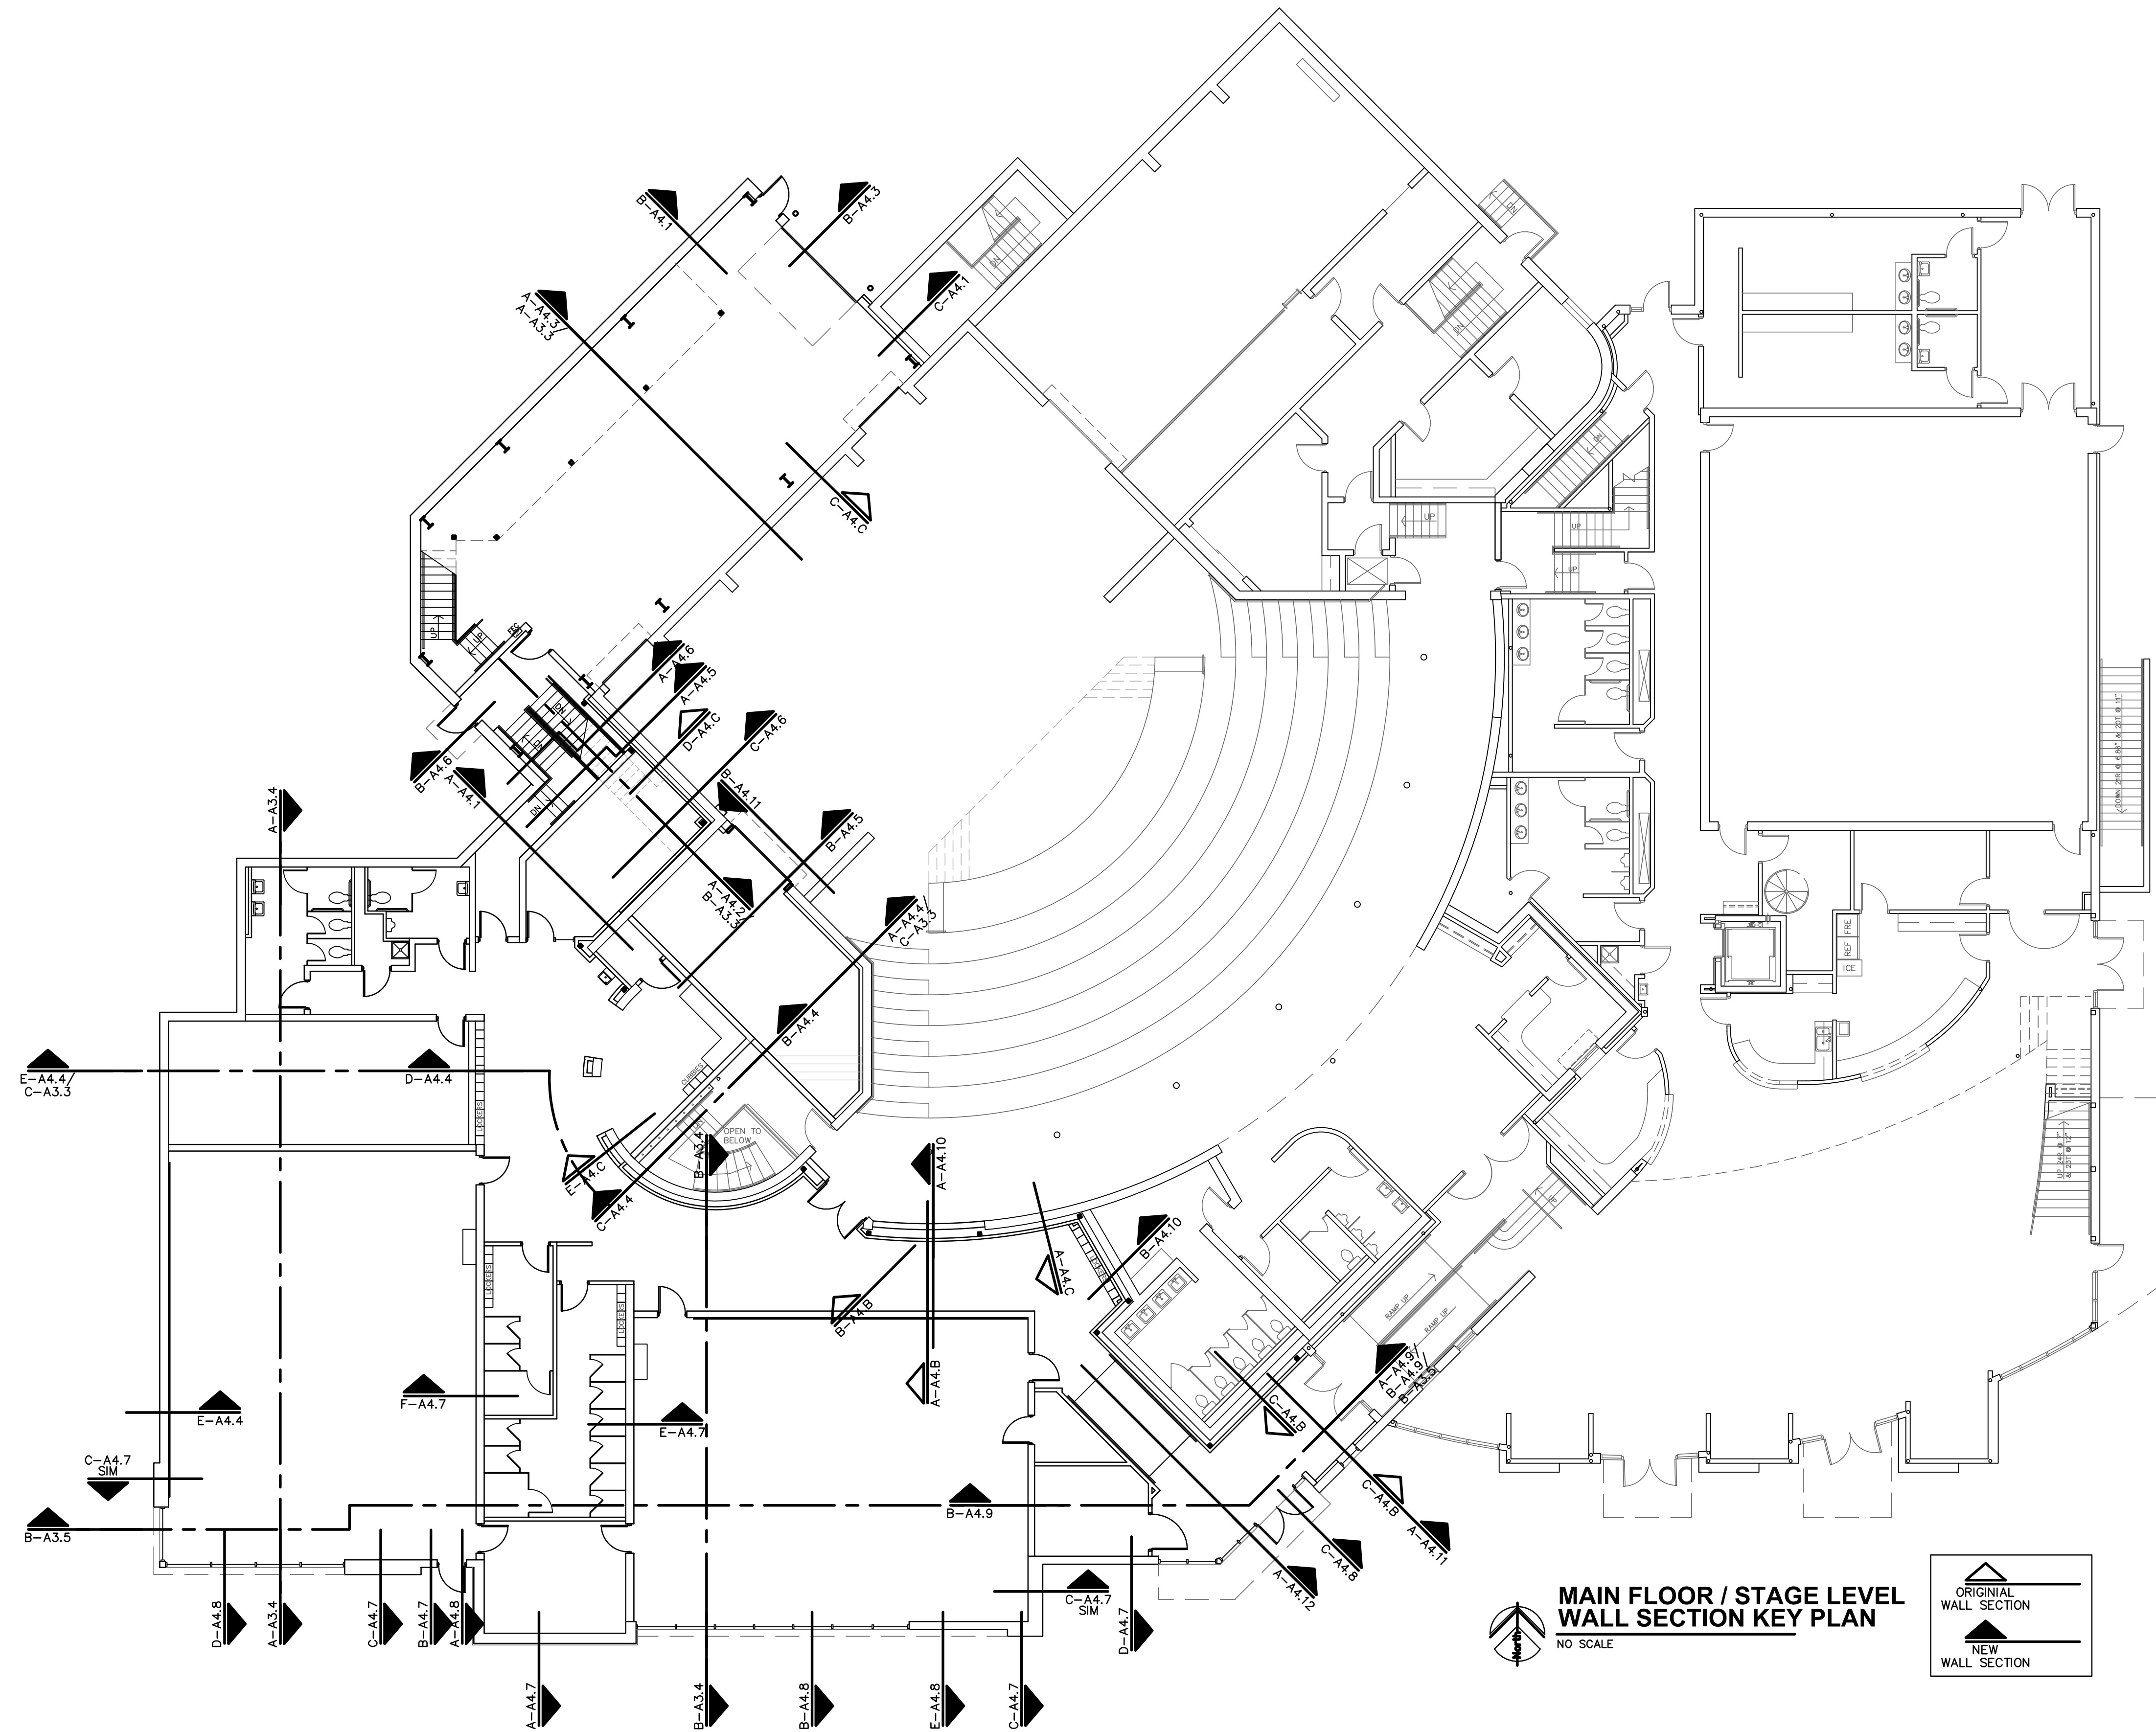

MAIN FLOOR / STAGE LEVEL  
WALL SECTION KEY PLAN

NO SCALE

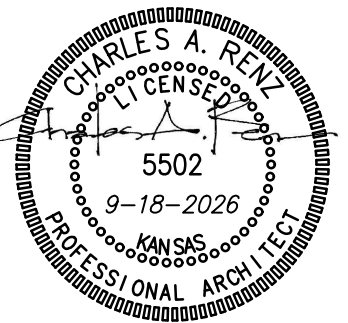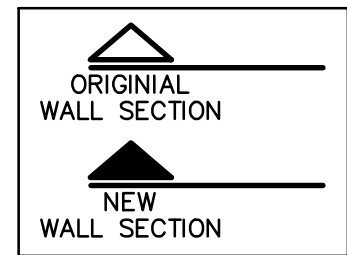

REVISION:

DATE: 9-18-2026

JOB: 22-3239

SHEET NO.:



A4.A

COPYRIGHTED ©


**THEATRE SALINA**  
DANCE STUDIOS & SCENE SHOP EXPANSION  
SALINA, KANSAS

**JGR**  
JonesGillamRenz  
730 N. Ninth  
Salina, KS 67401  
785.827.0386  
jgr@jgrarchitects.com



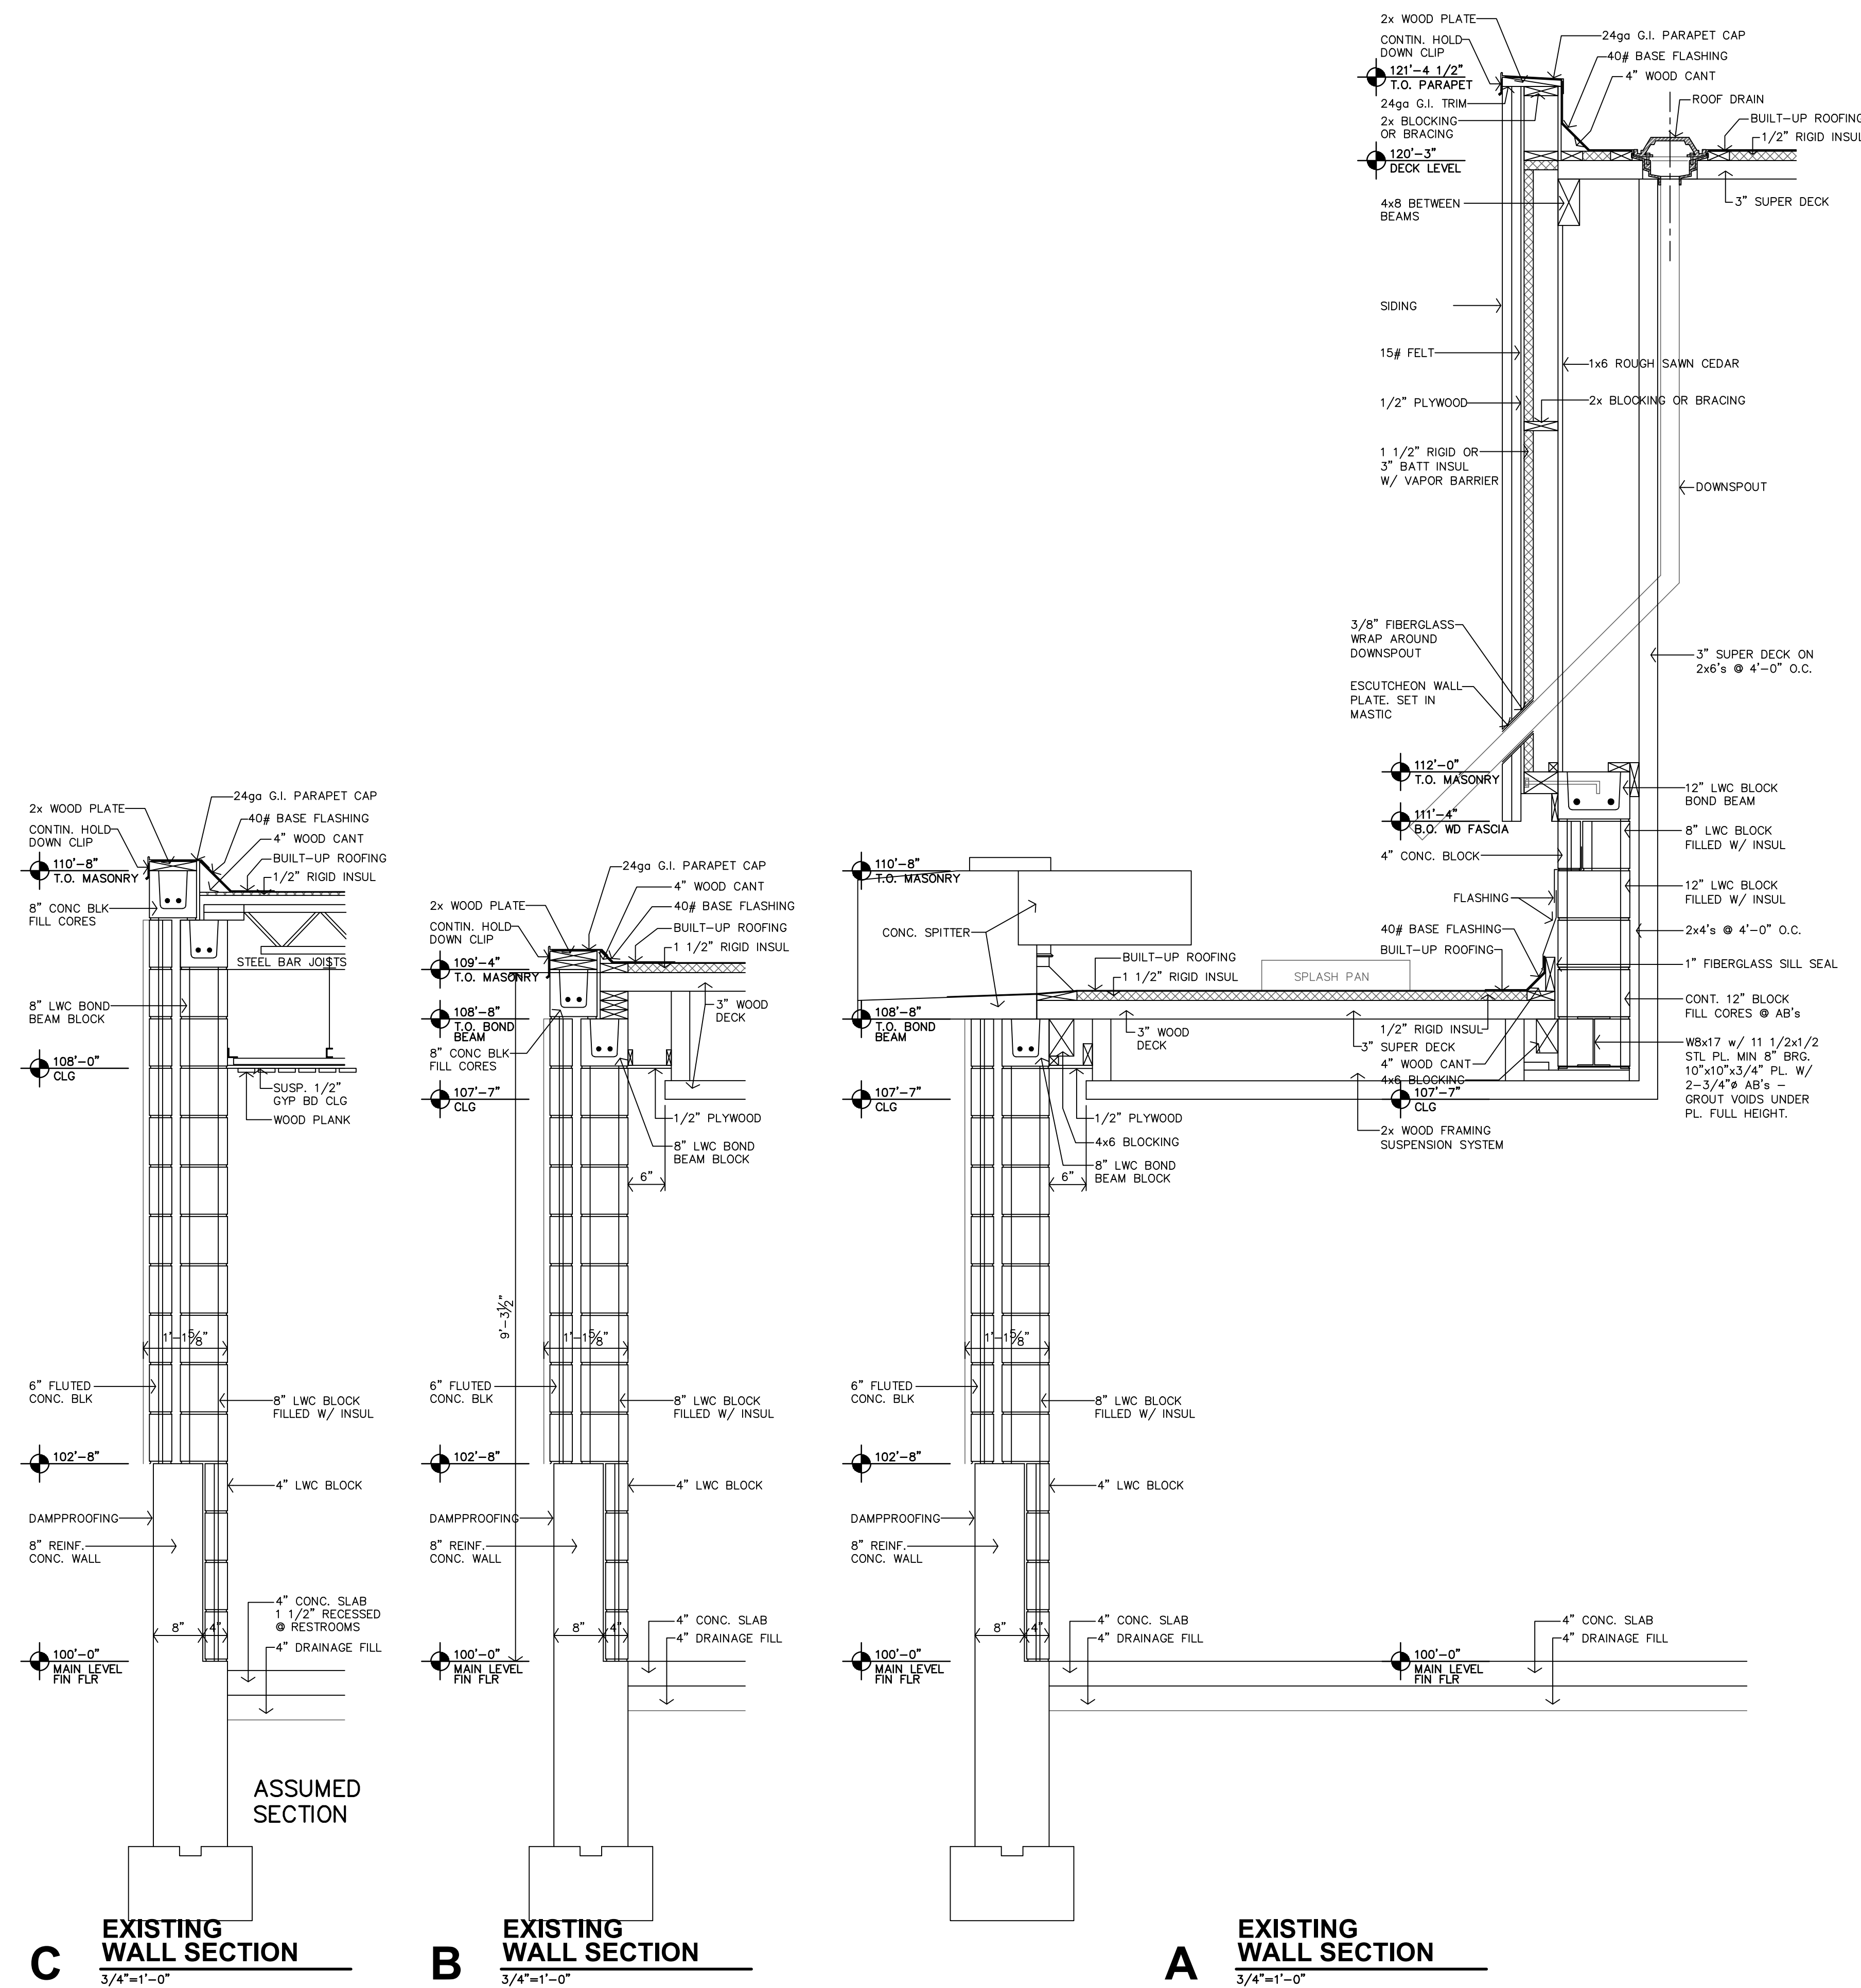



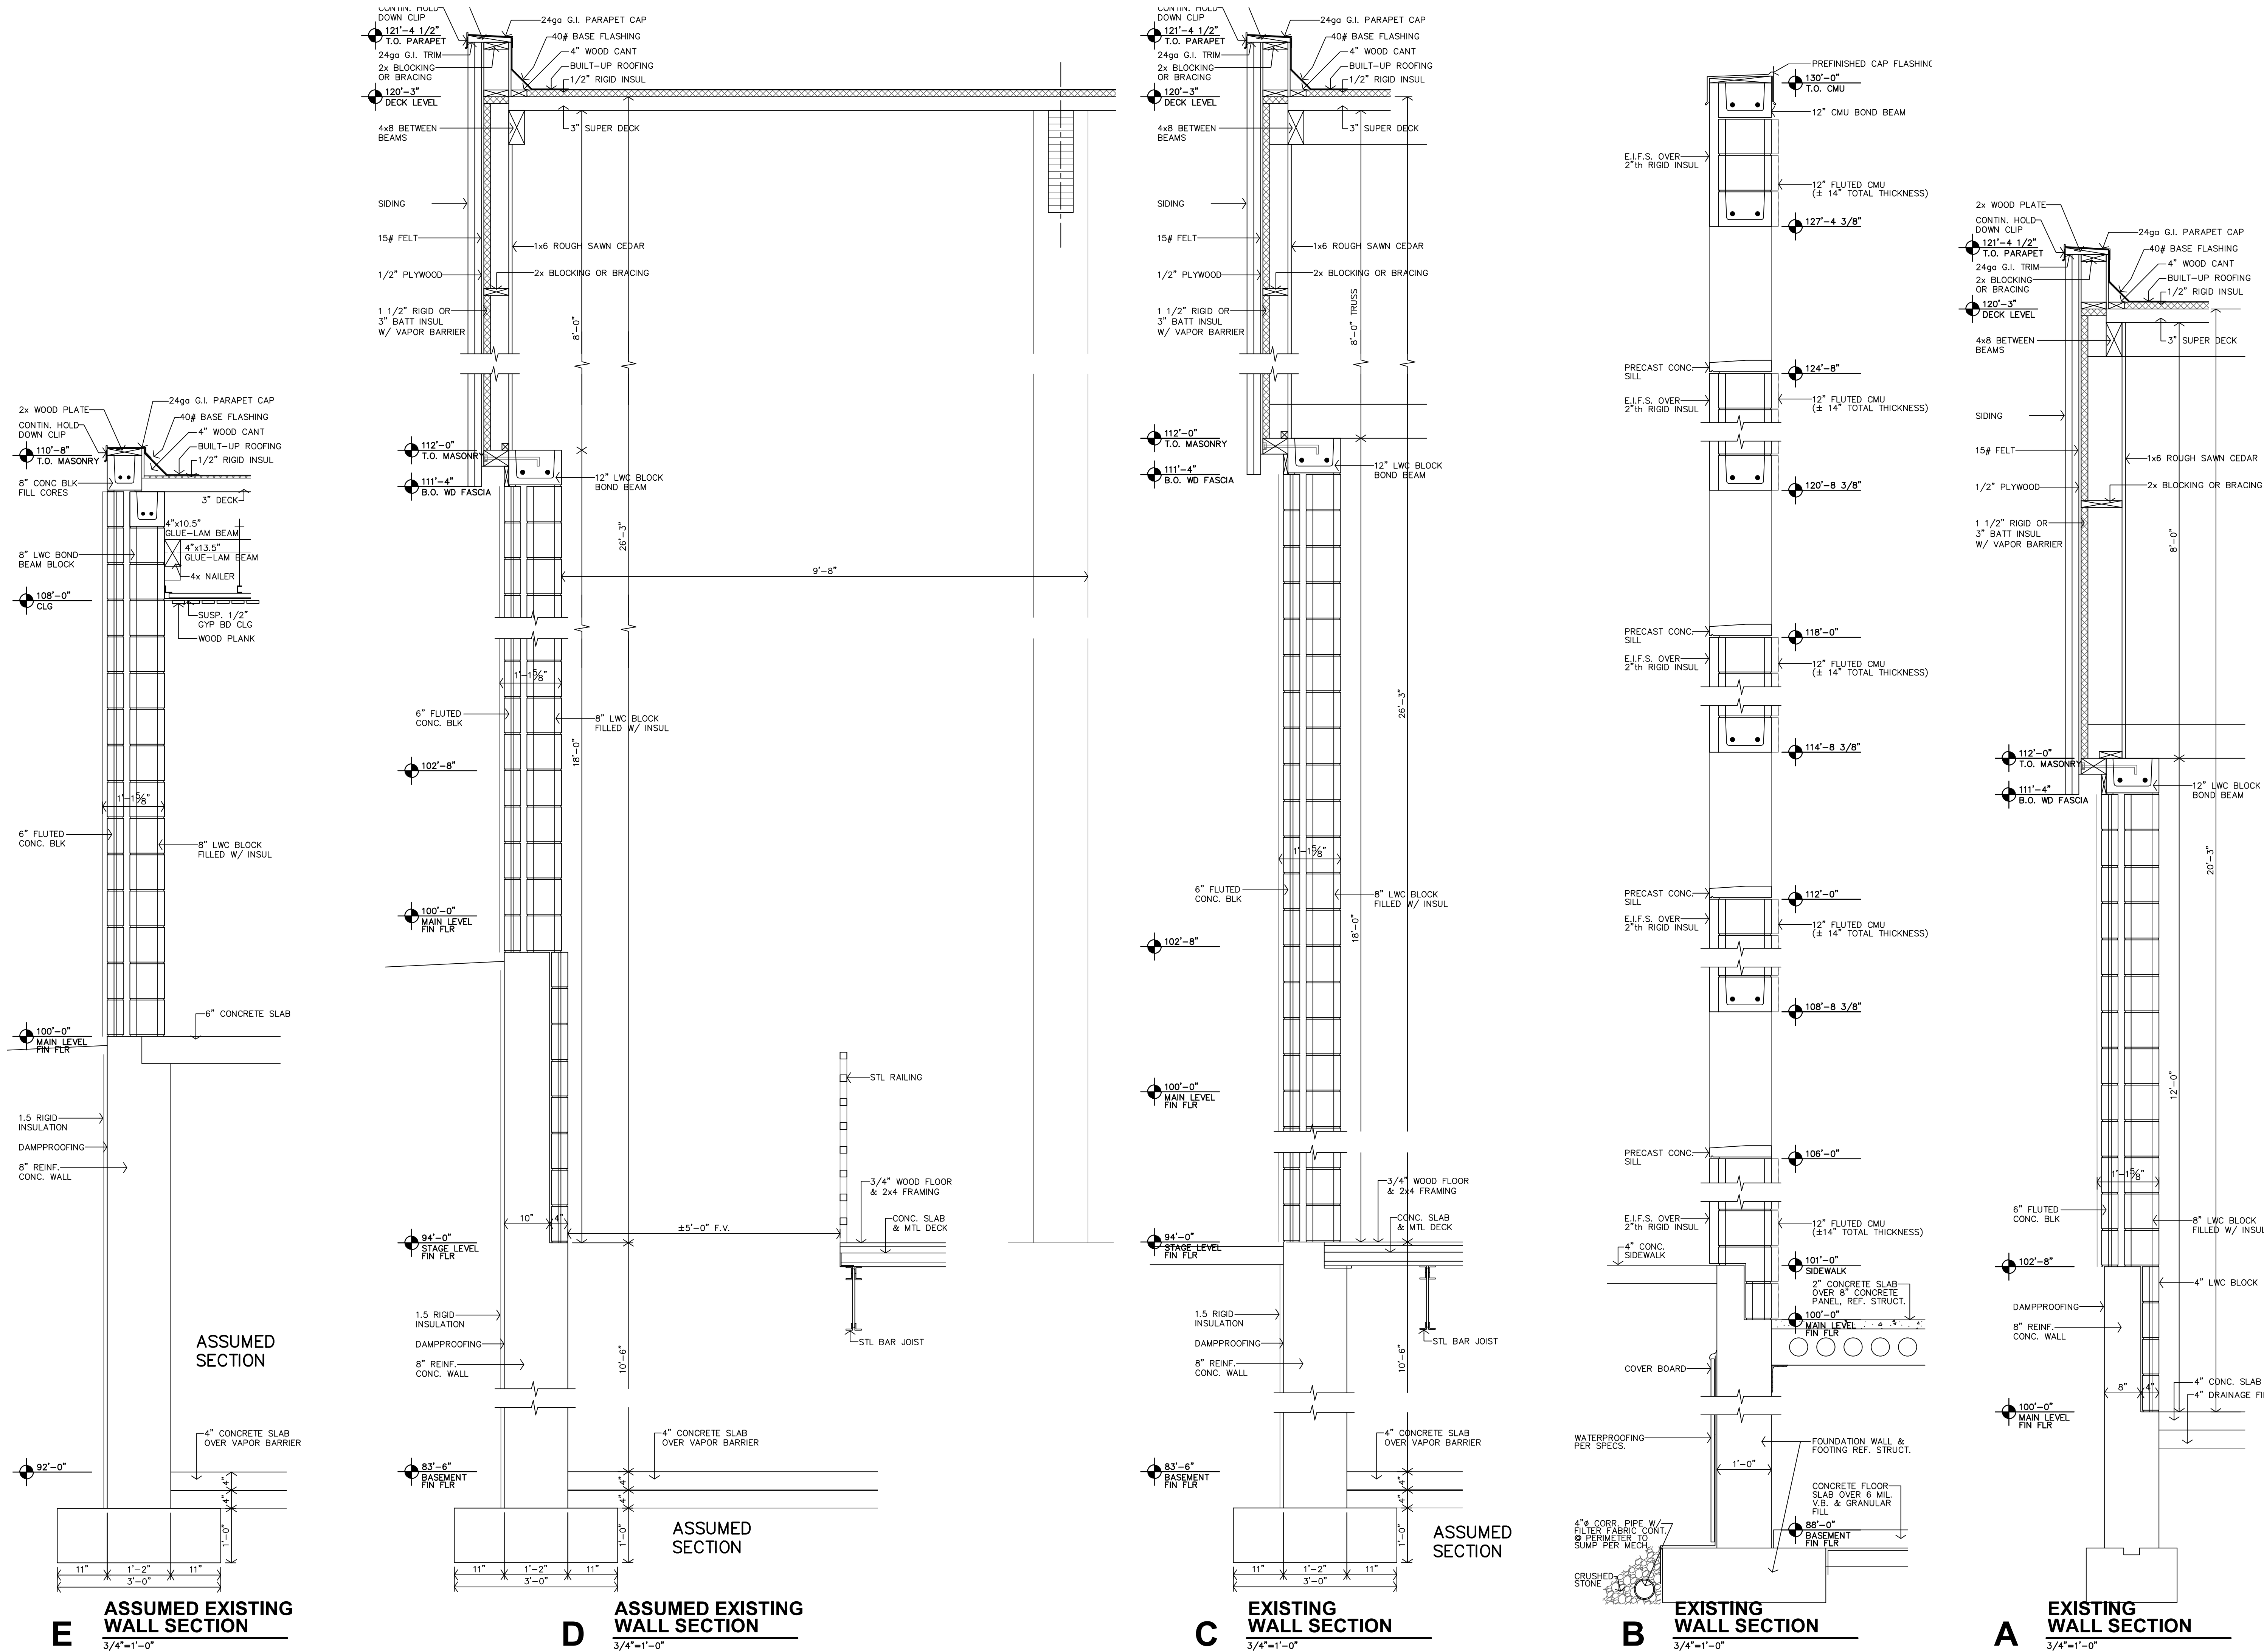

**JCR**

**JonesGillamRenz**

1881 Main Street, Suite 301  
Salina, KS 67401  
785.827.0386  
jgr@jgarchitects.com

**THEATRE SALINA**

**DANCE STUDIOS & SCENE SHOP EXPANSION**

**SALINA, KANSAS**

CHARLES A. RENZ  
REGISTERED PROFESSIONAL ARCHITECT  
KANSAS  
5502  
9-18-2026





REVISION:

DATE:	9-18-2026
JOB:	22-3239
SHEET NO.:	

**A4.C**

COPYRIGHTED ©



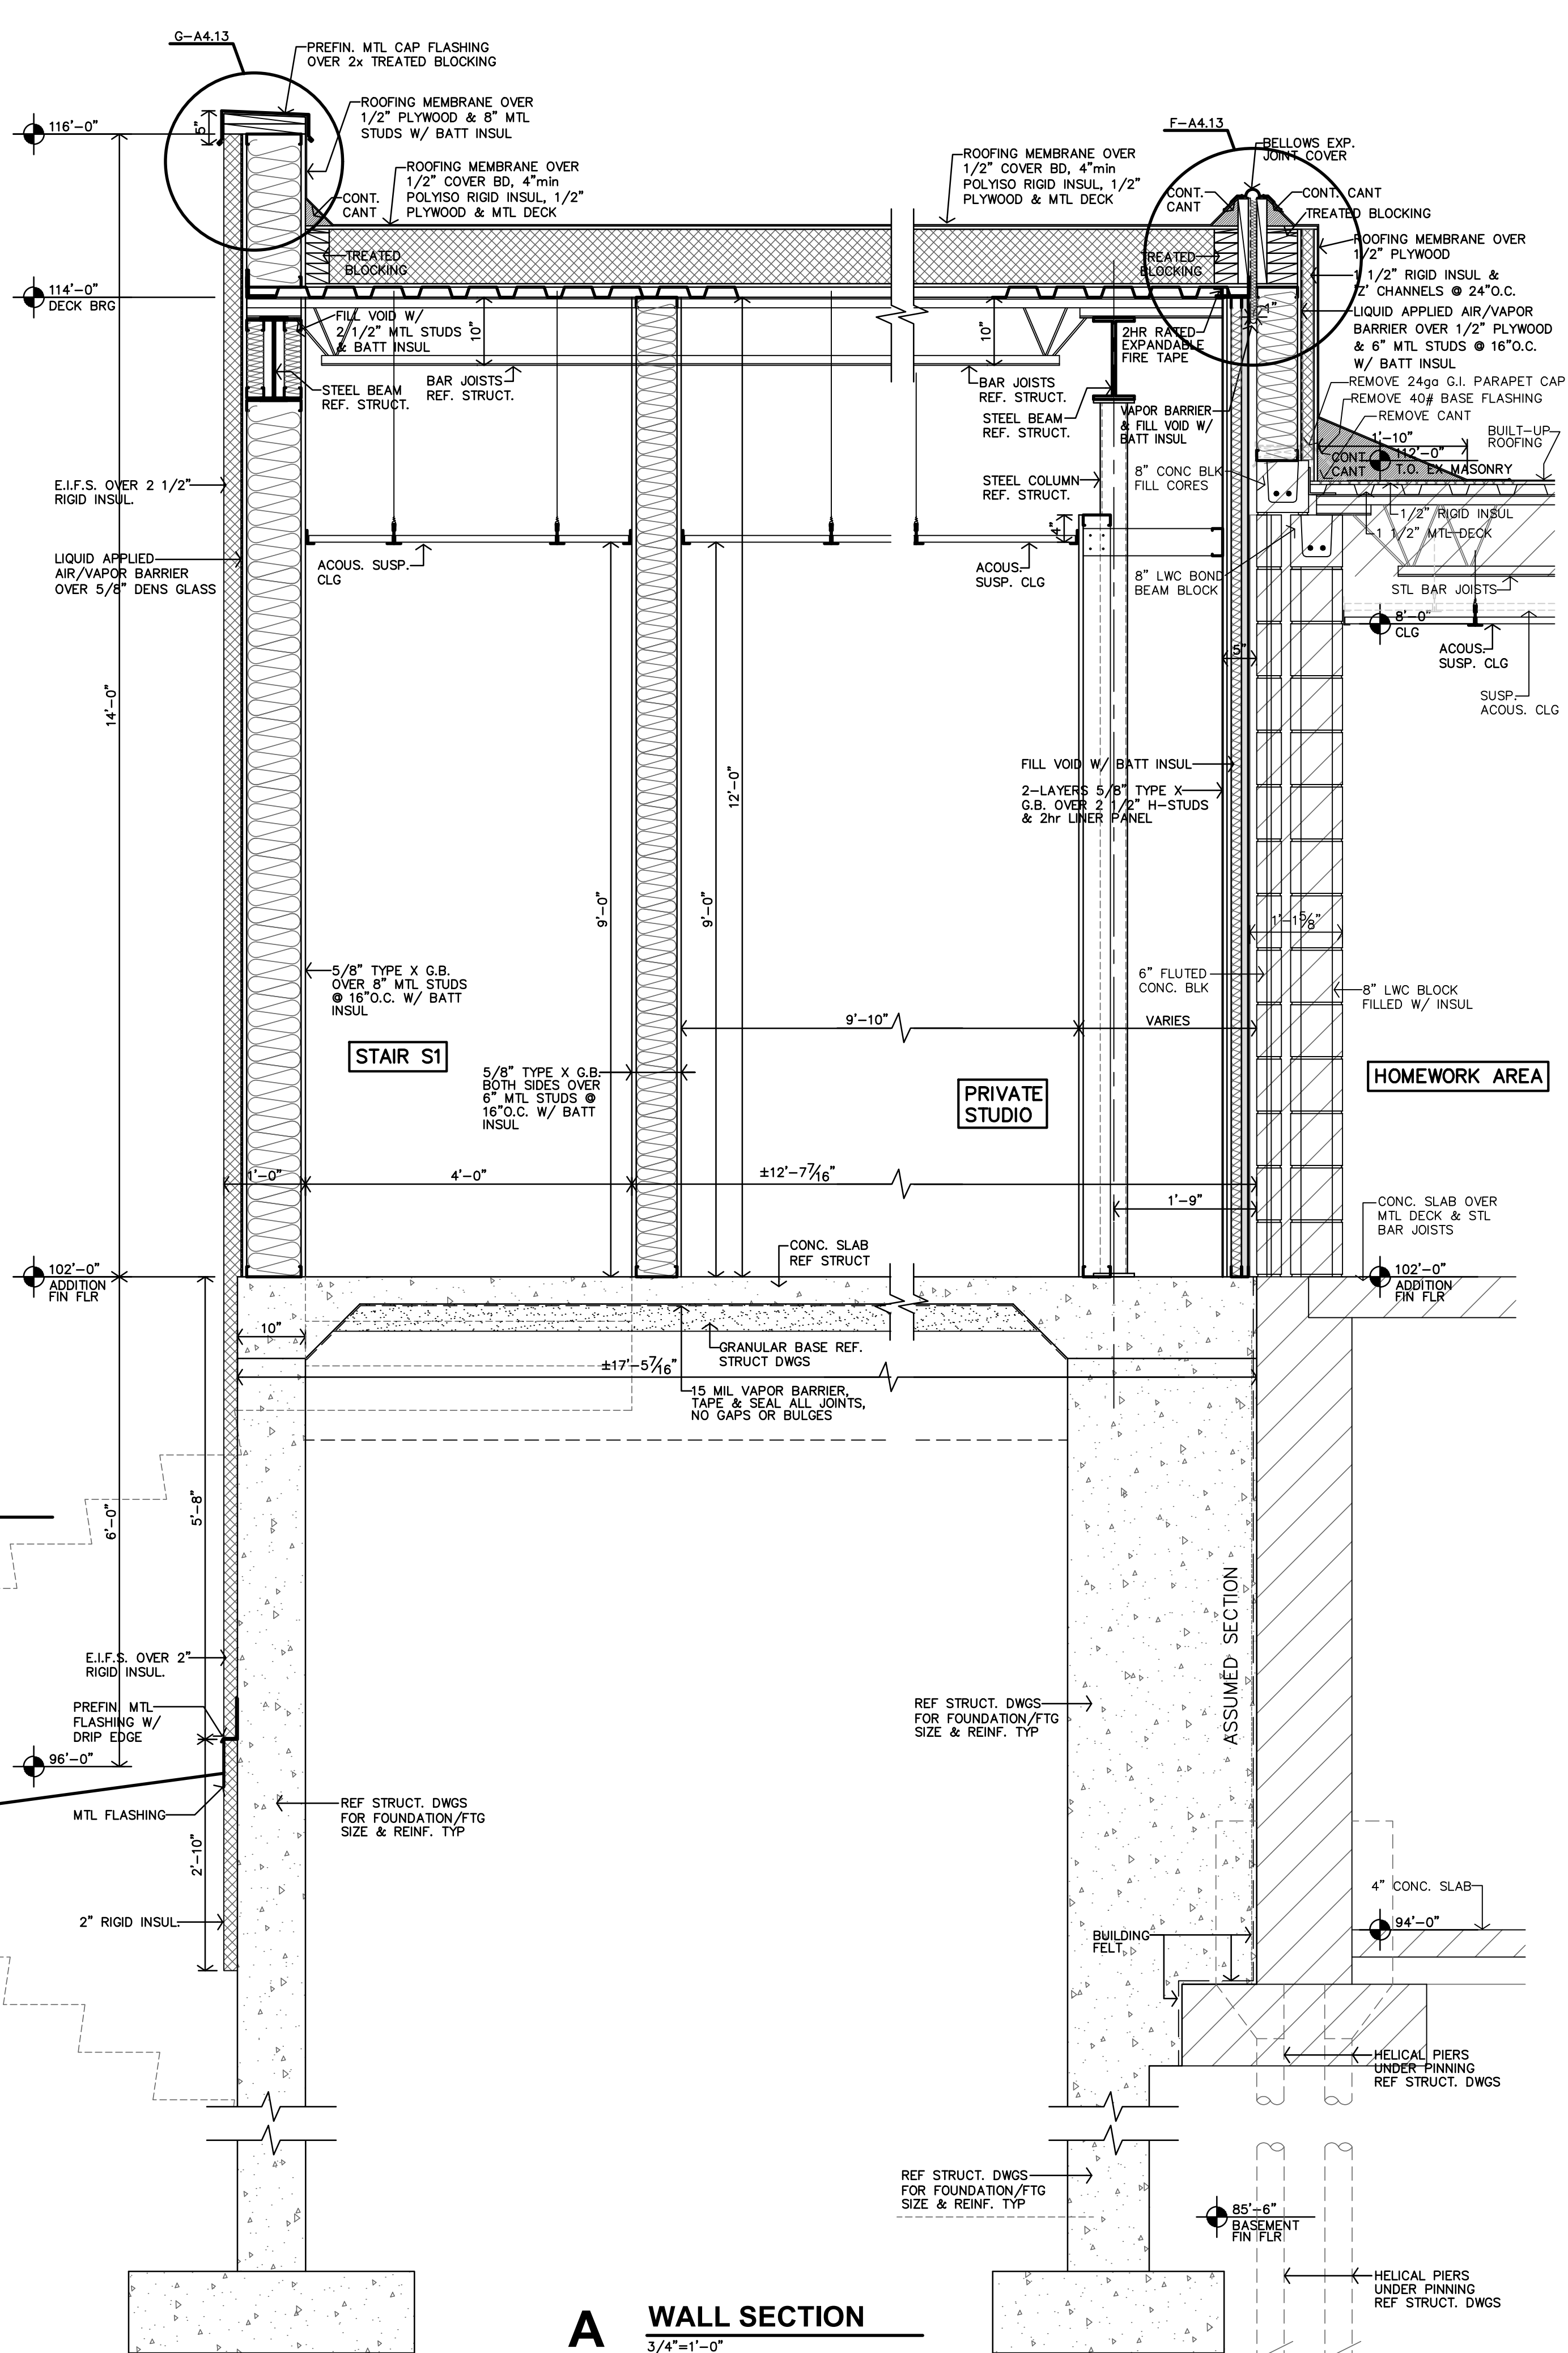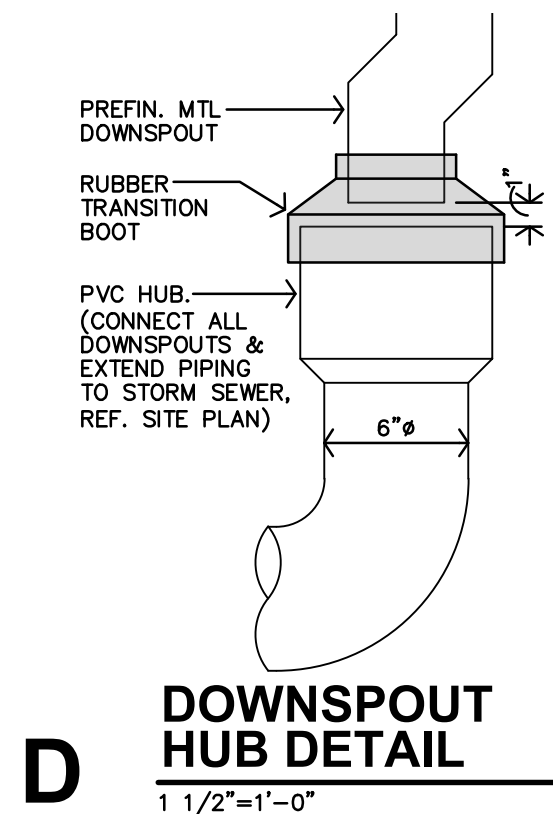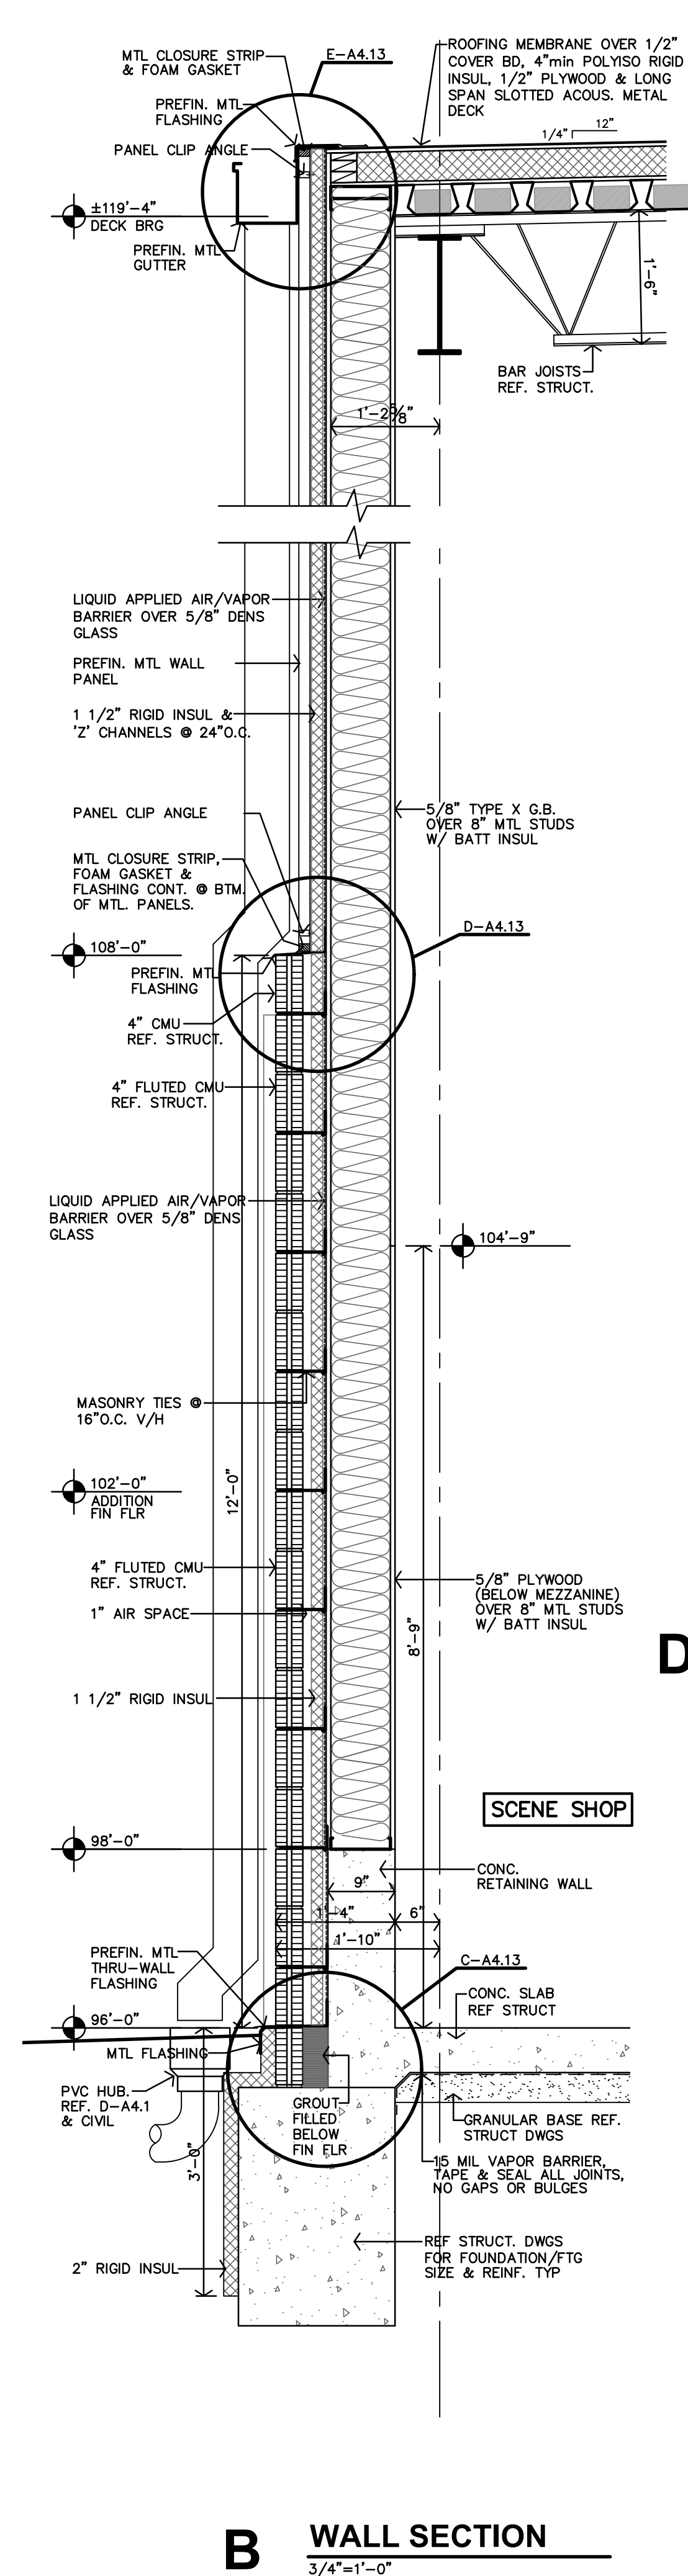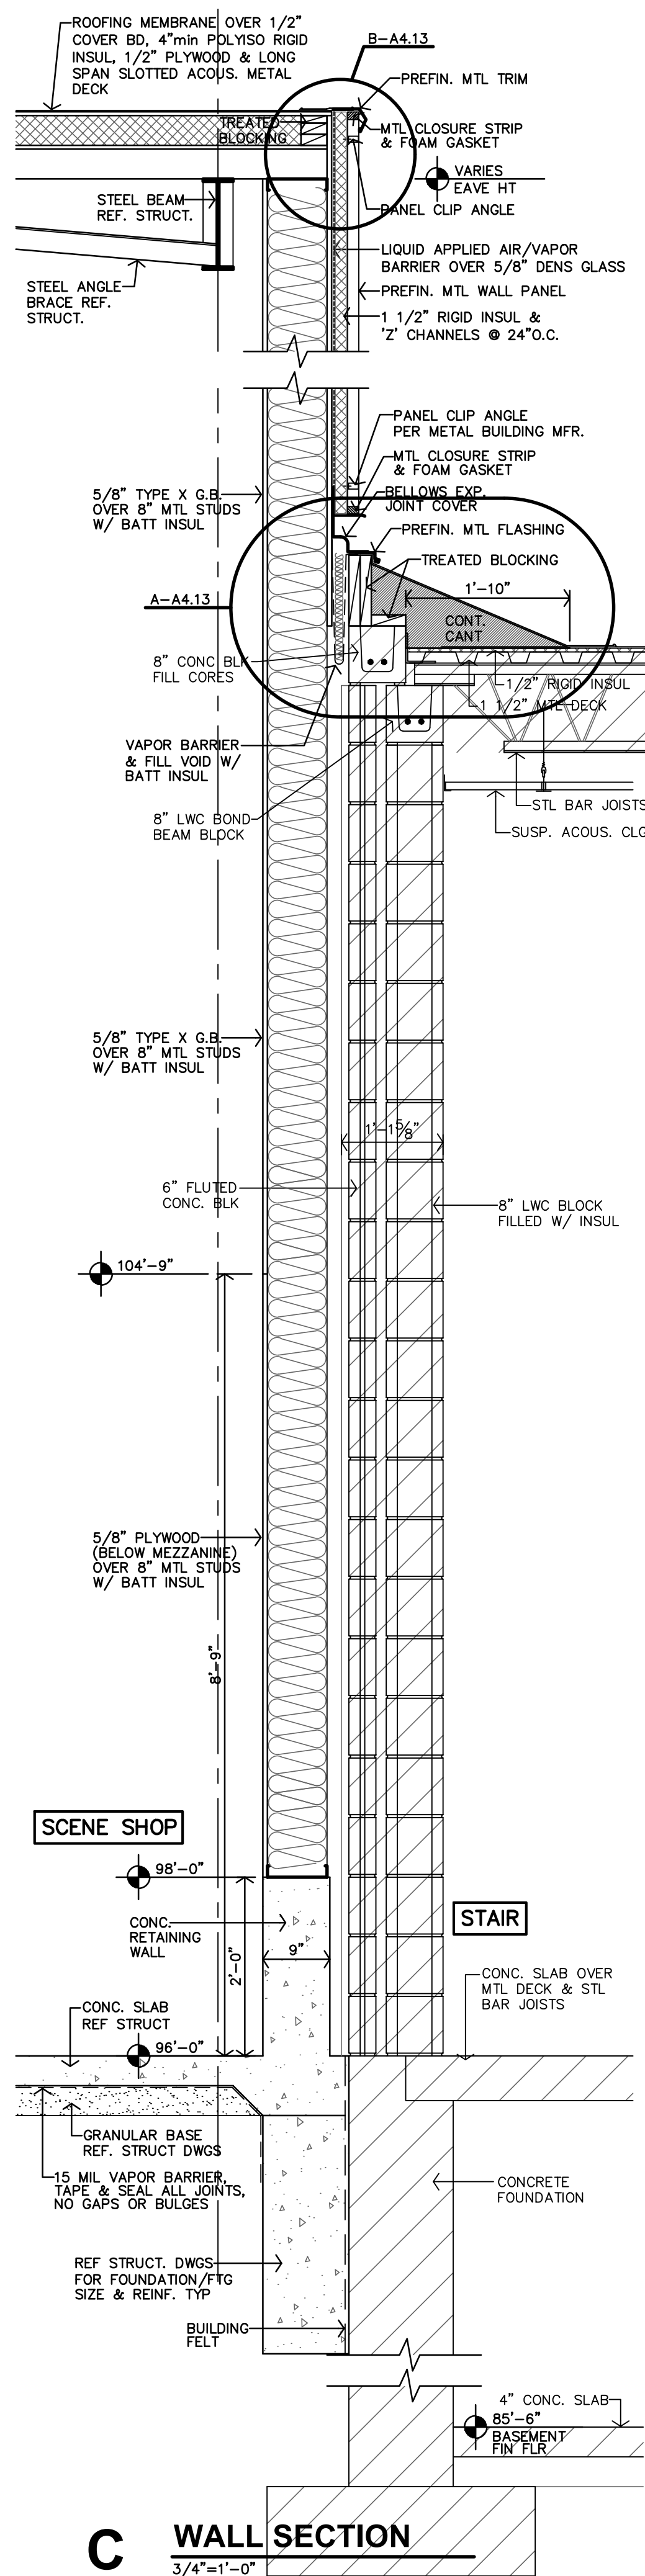

**JonesGillamRenz**  
1881 Main Street, Suite 301  
Salina, KS 67401  
785.827.0386  
jgr@jgarchitects.com

**THEATRE SALINA**  
DANCE STUDIOS & SCENE SHOP EXPANSION  
SALINA, KANSAS

REVISION:

DATE: 9-18-2026


JOB: 22-3239

SHEET NO.:

A4.1

COPYRIGHTED ©




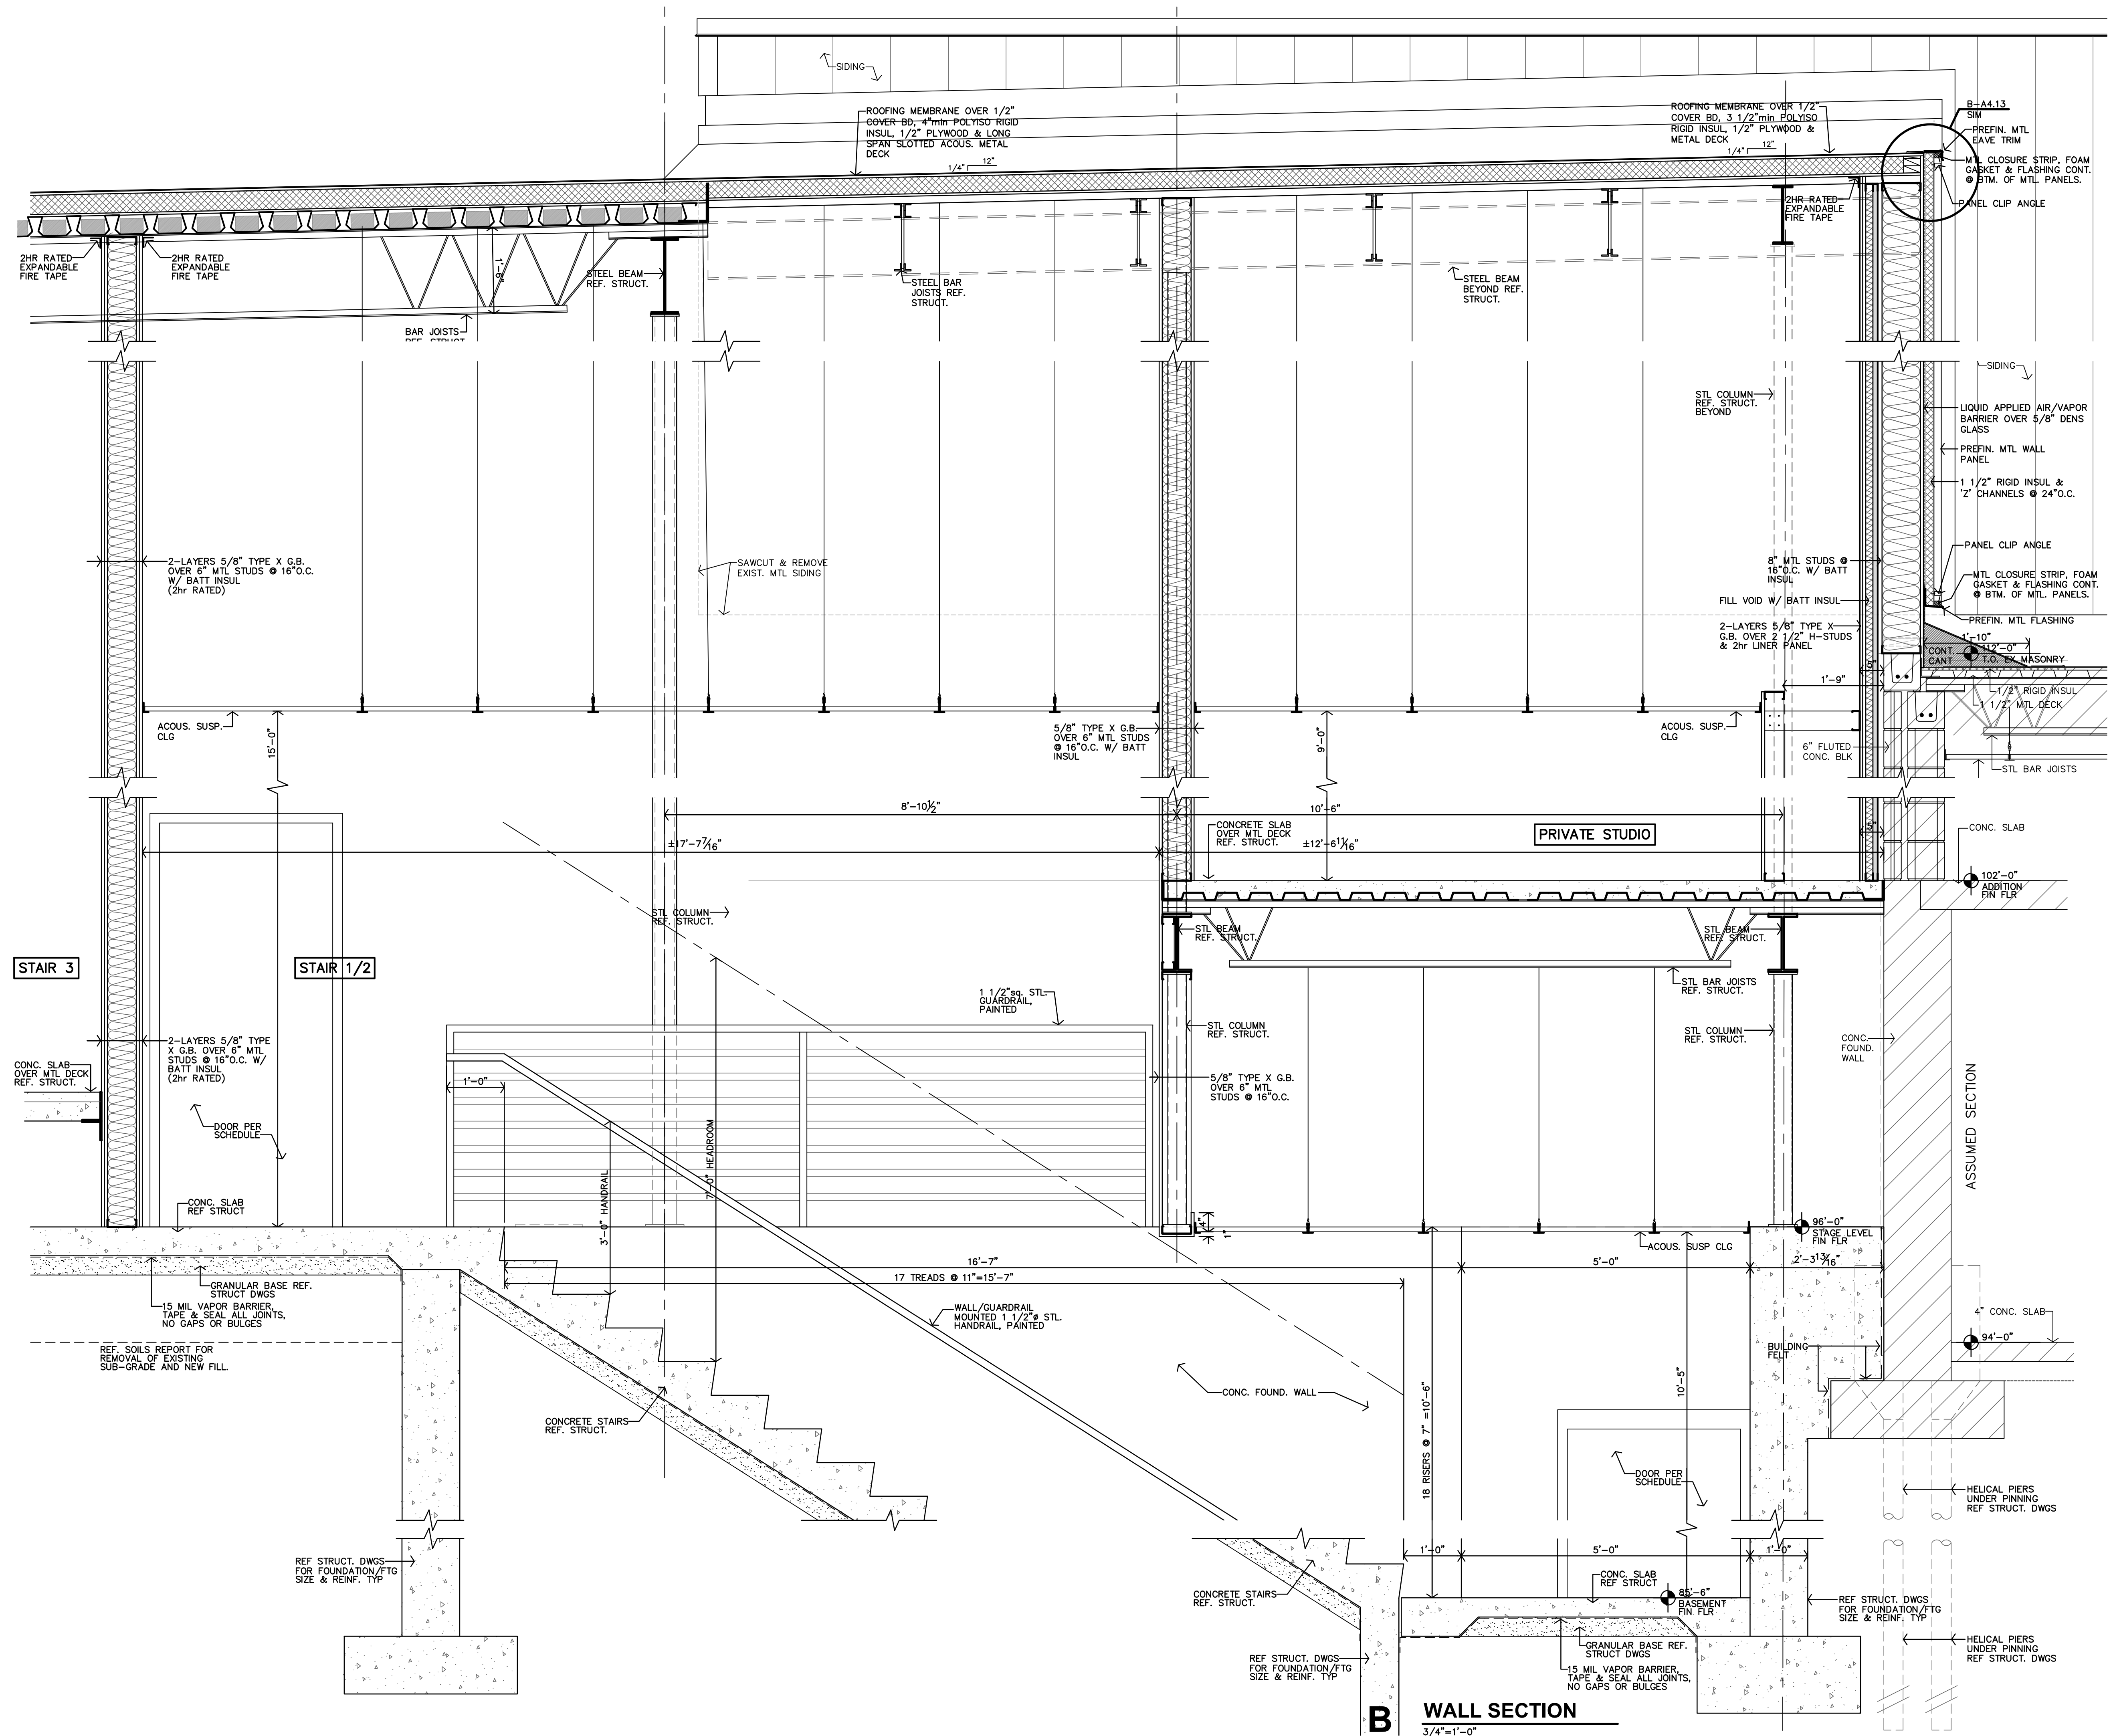

JonesGillamRenz  
1881 Main Street, Suite 301  
Salina, KS 67401  
785.827.0386  
jgr@jgarchitects.com



THEATRE SALINA  
DANCE STUDIOS & SCENE SHOP EXPANSION  
SALINA, KANSAS

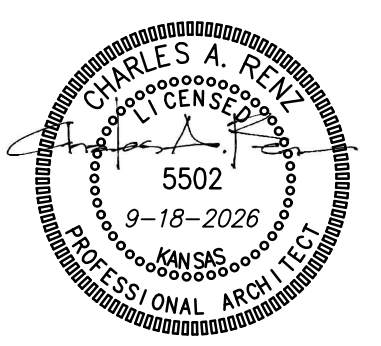


REVISION:	
DATE:	9-18-2026
JOB:	22-3239
SHEET NO.:	

A4.2

COPYRIGHTED ©




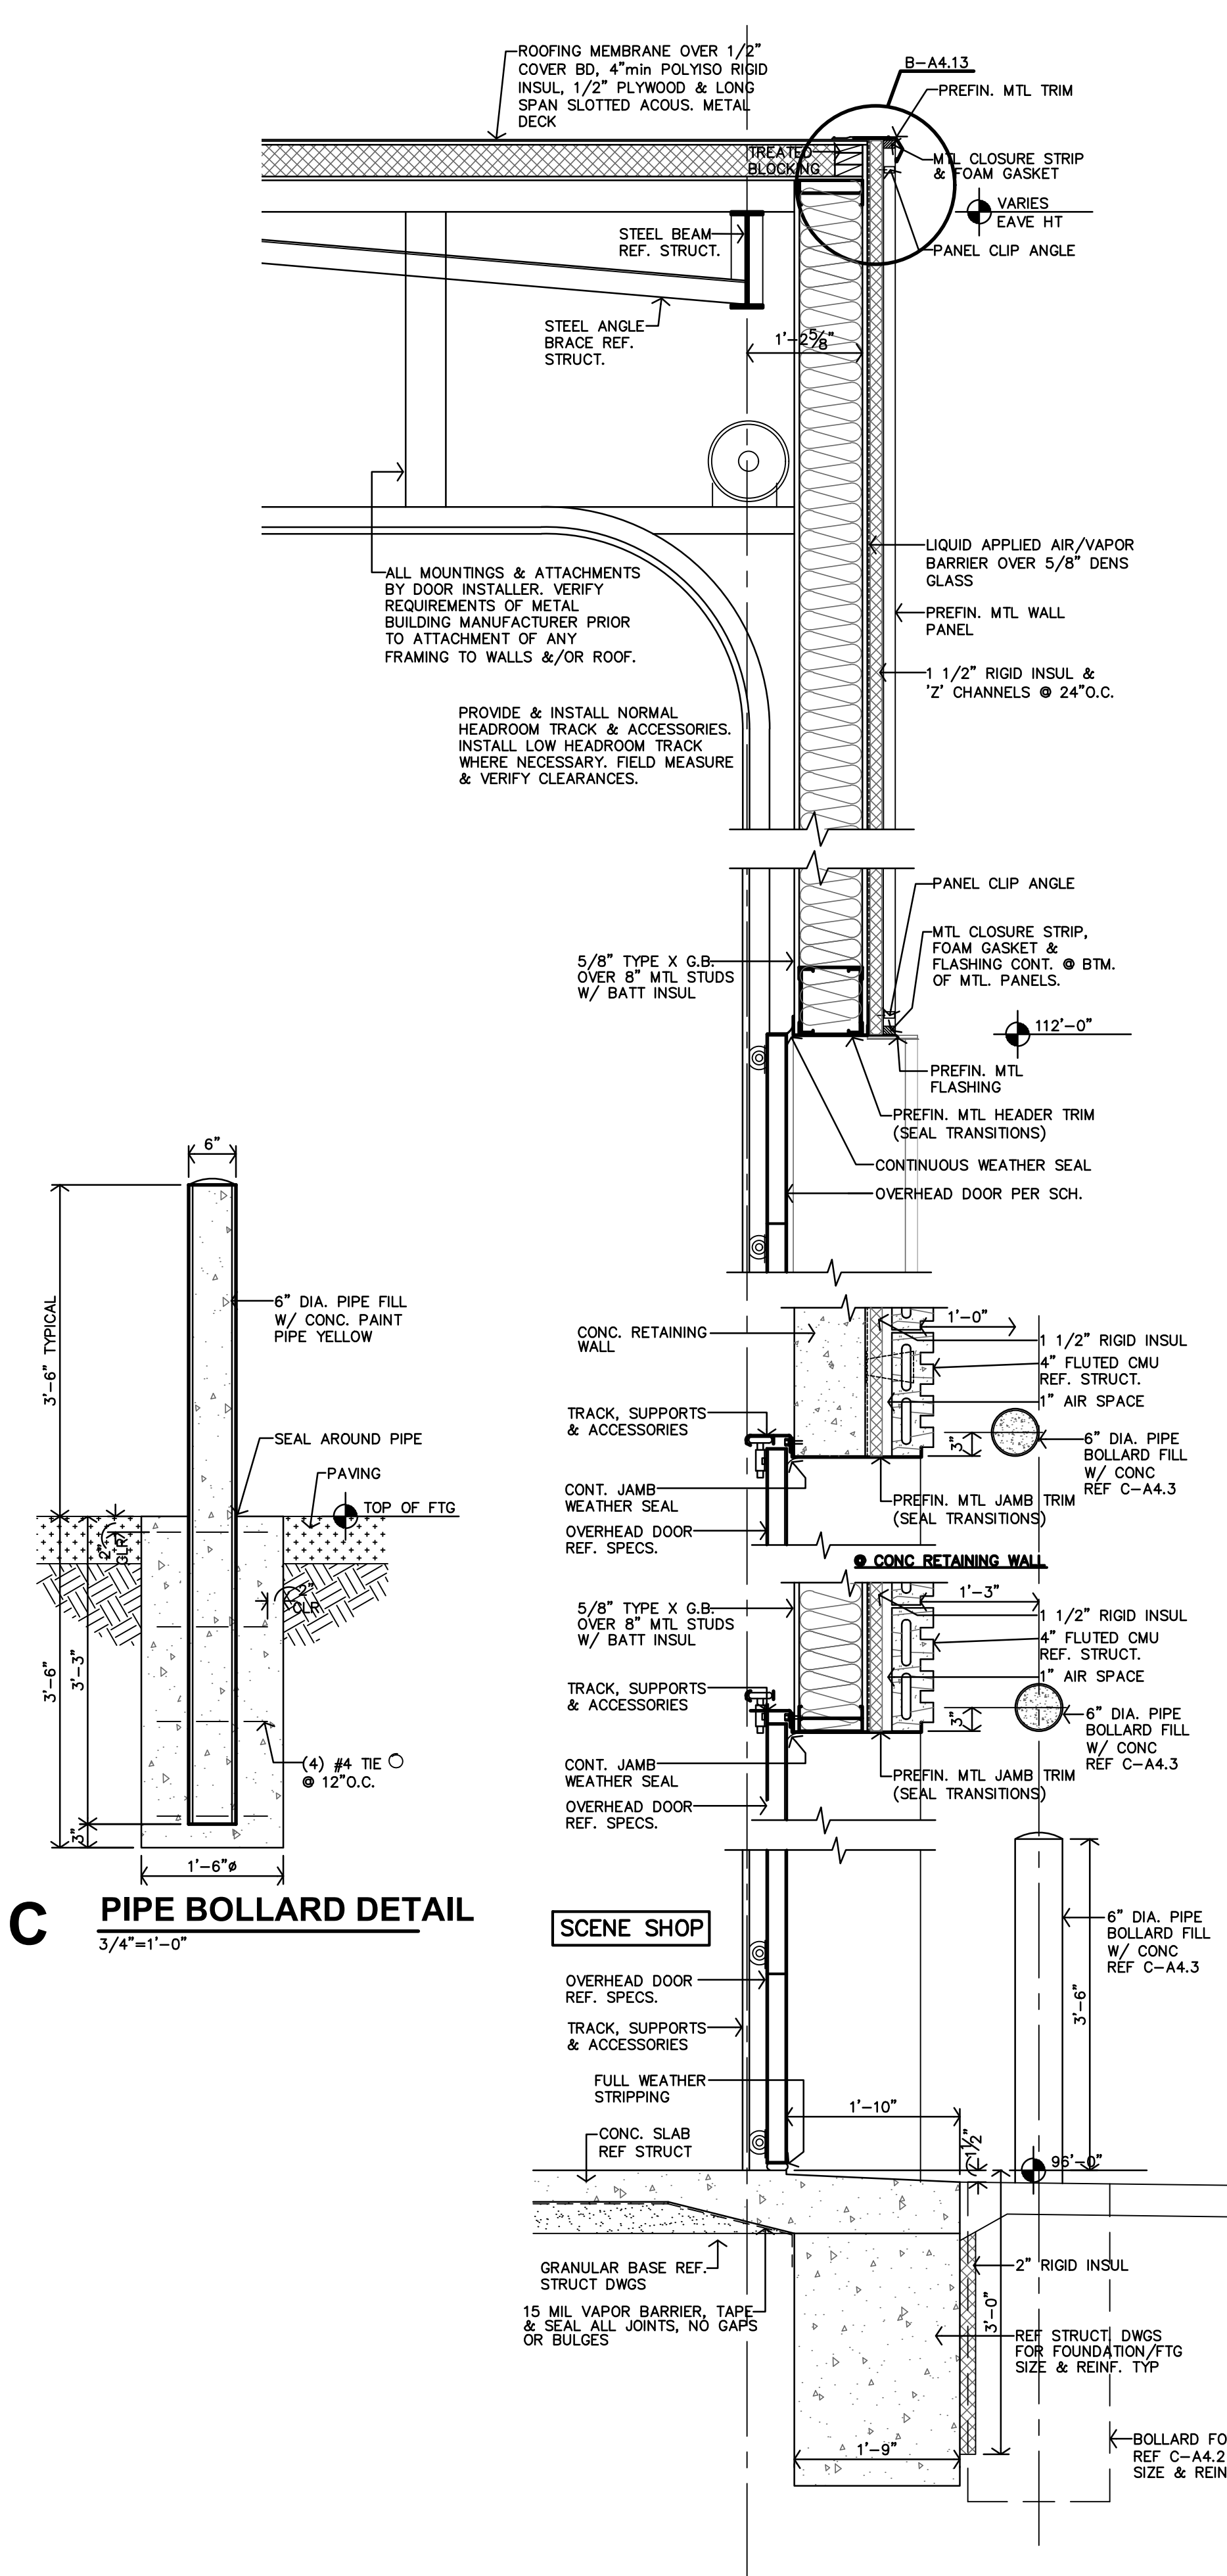

**C PIPE BOLLARD DETAIL**  
3/4"=1'-0"

**SCENE SHOP**

**B WALL SECTION**  
3/4"=1'-0"


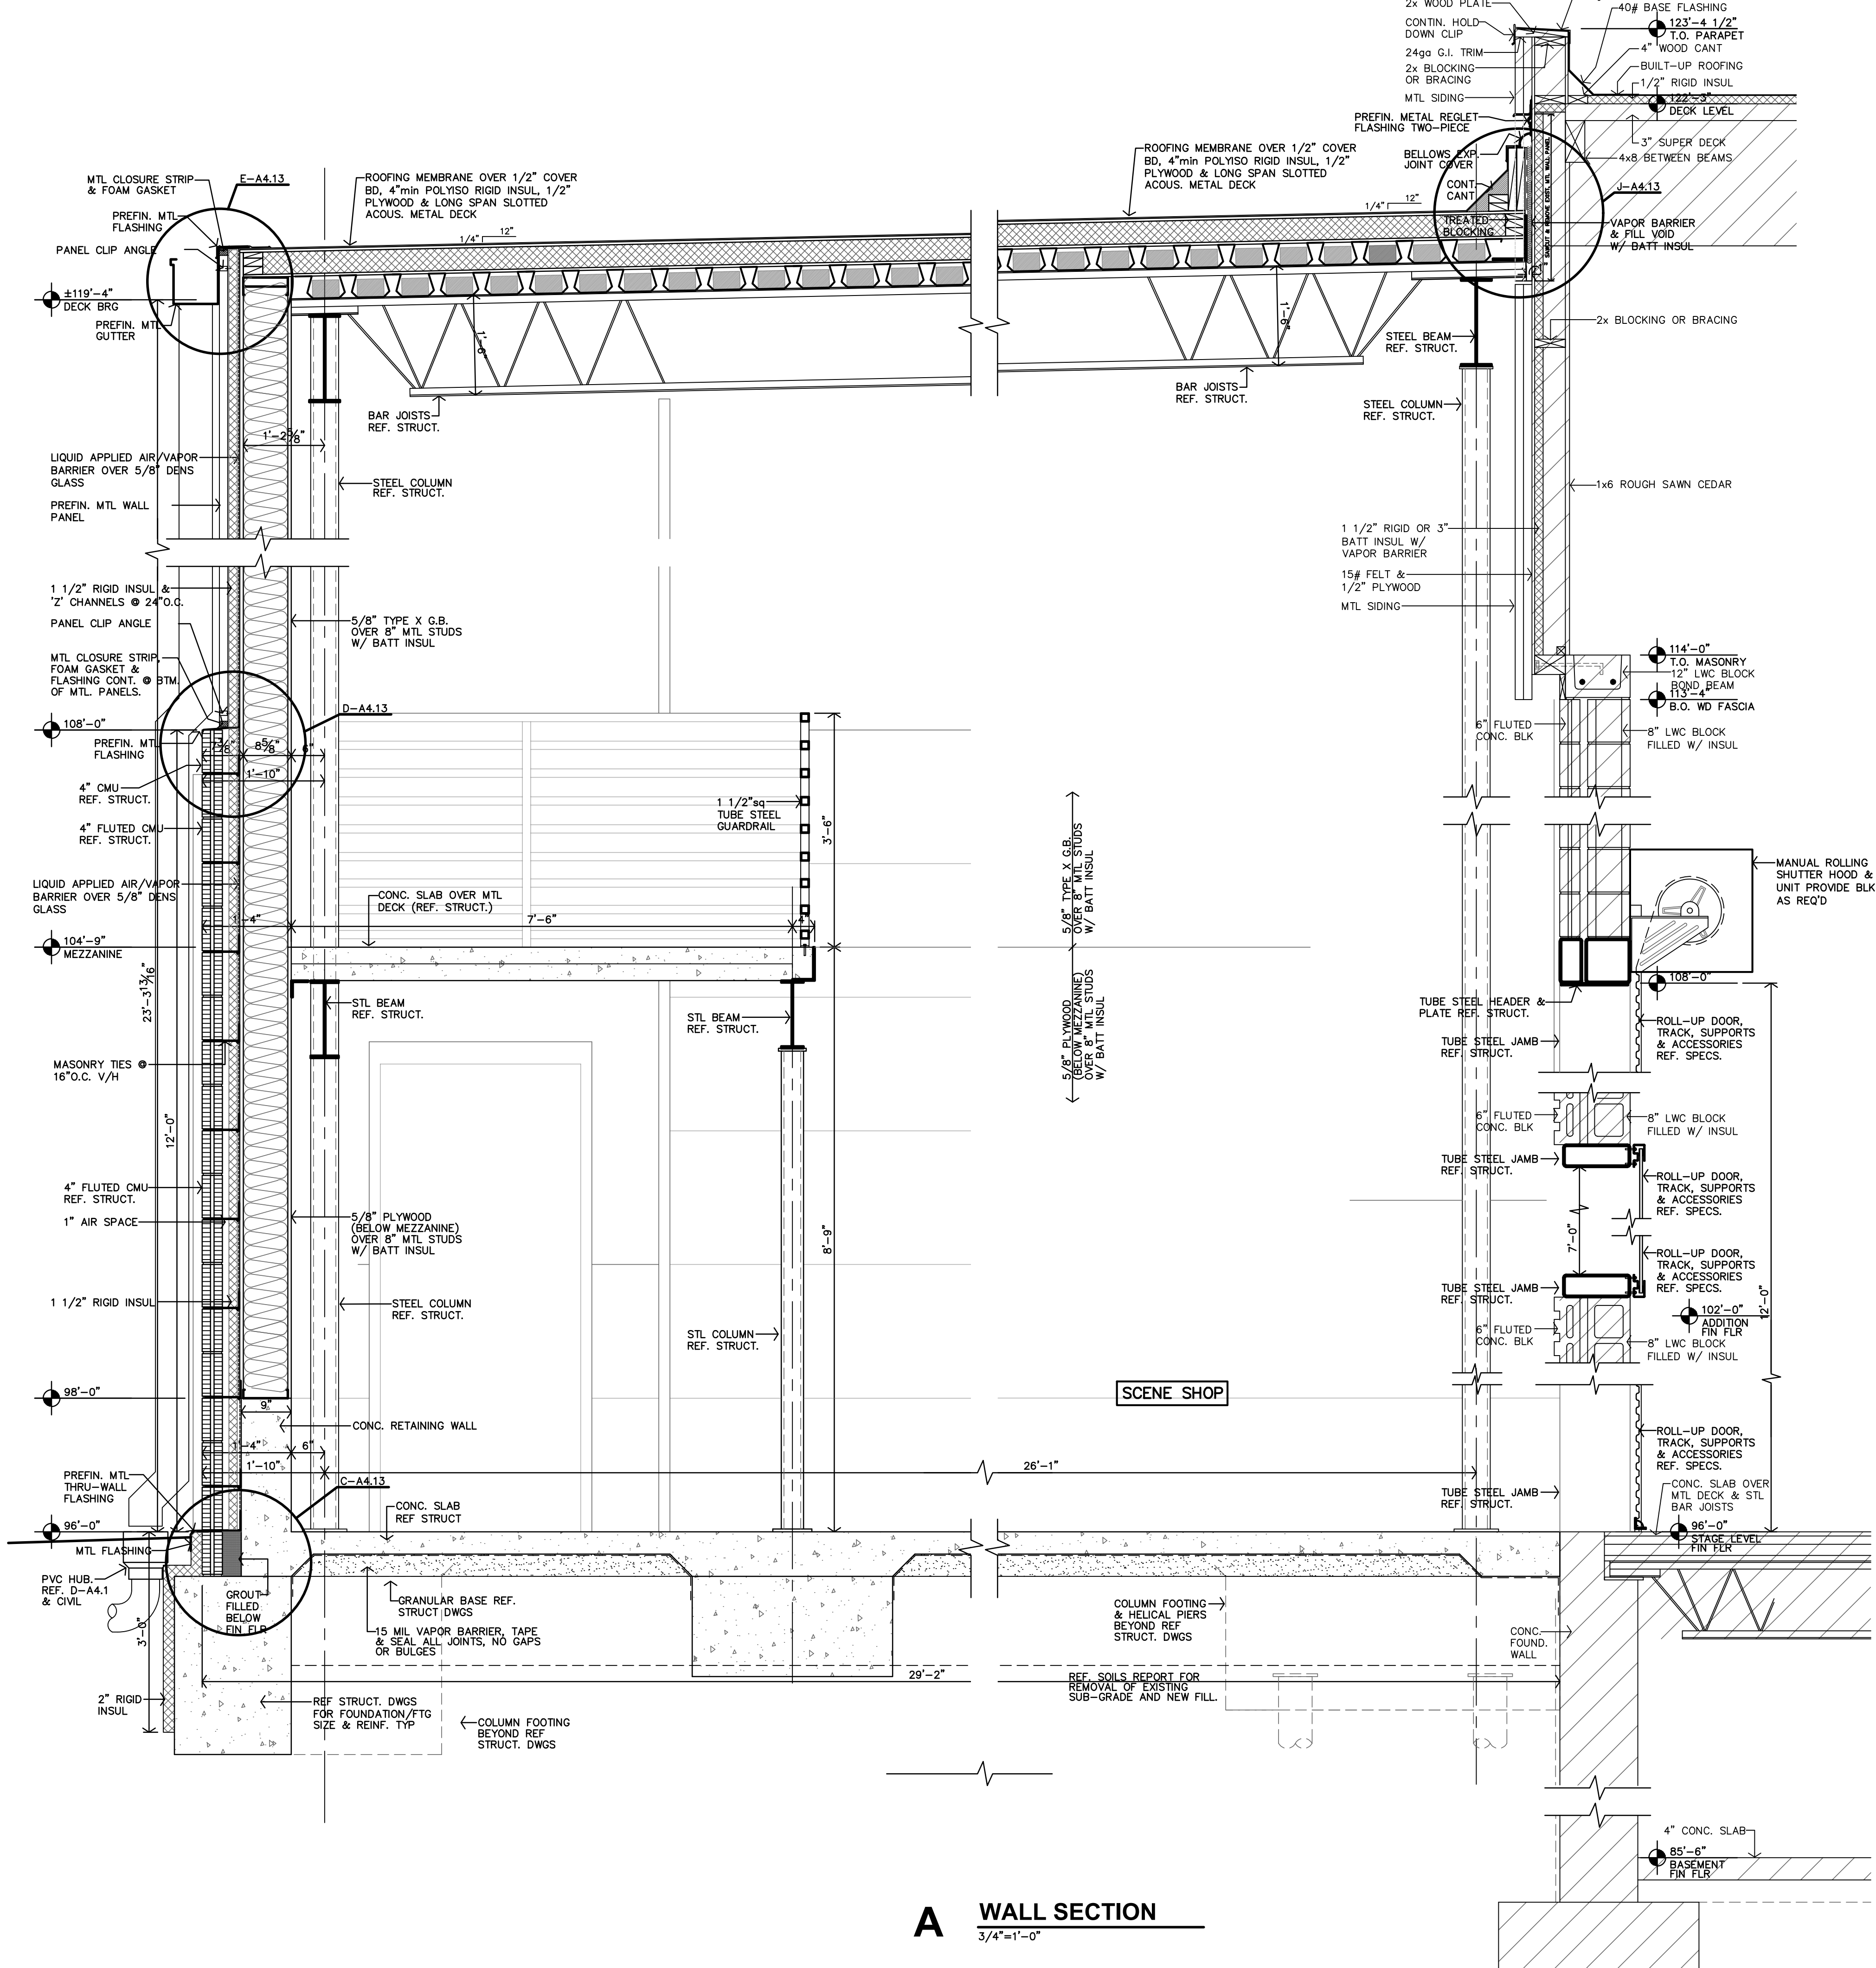


**A WALL SECTION**  
3/4"=1'-0"














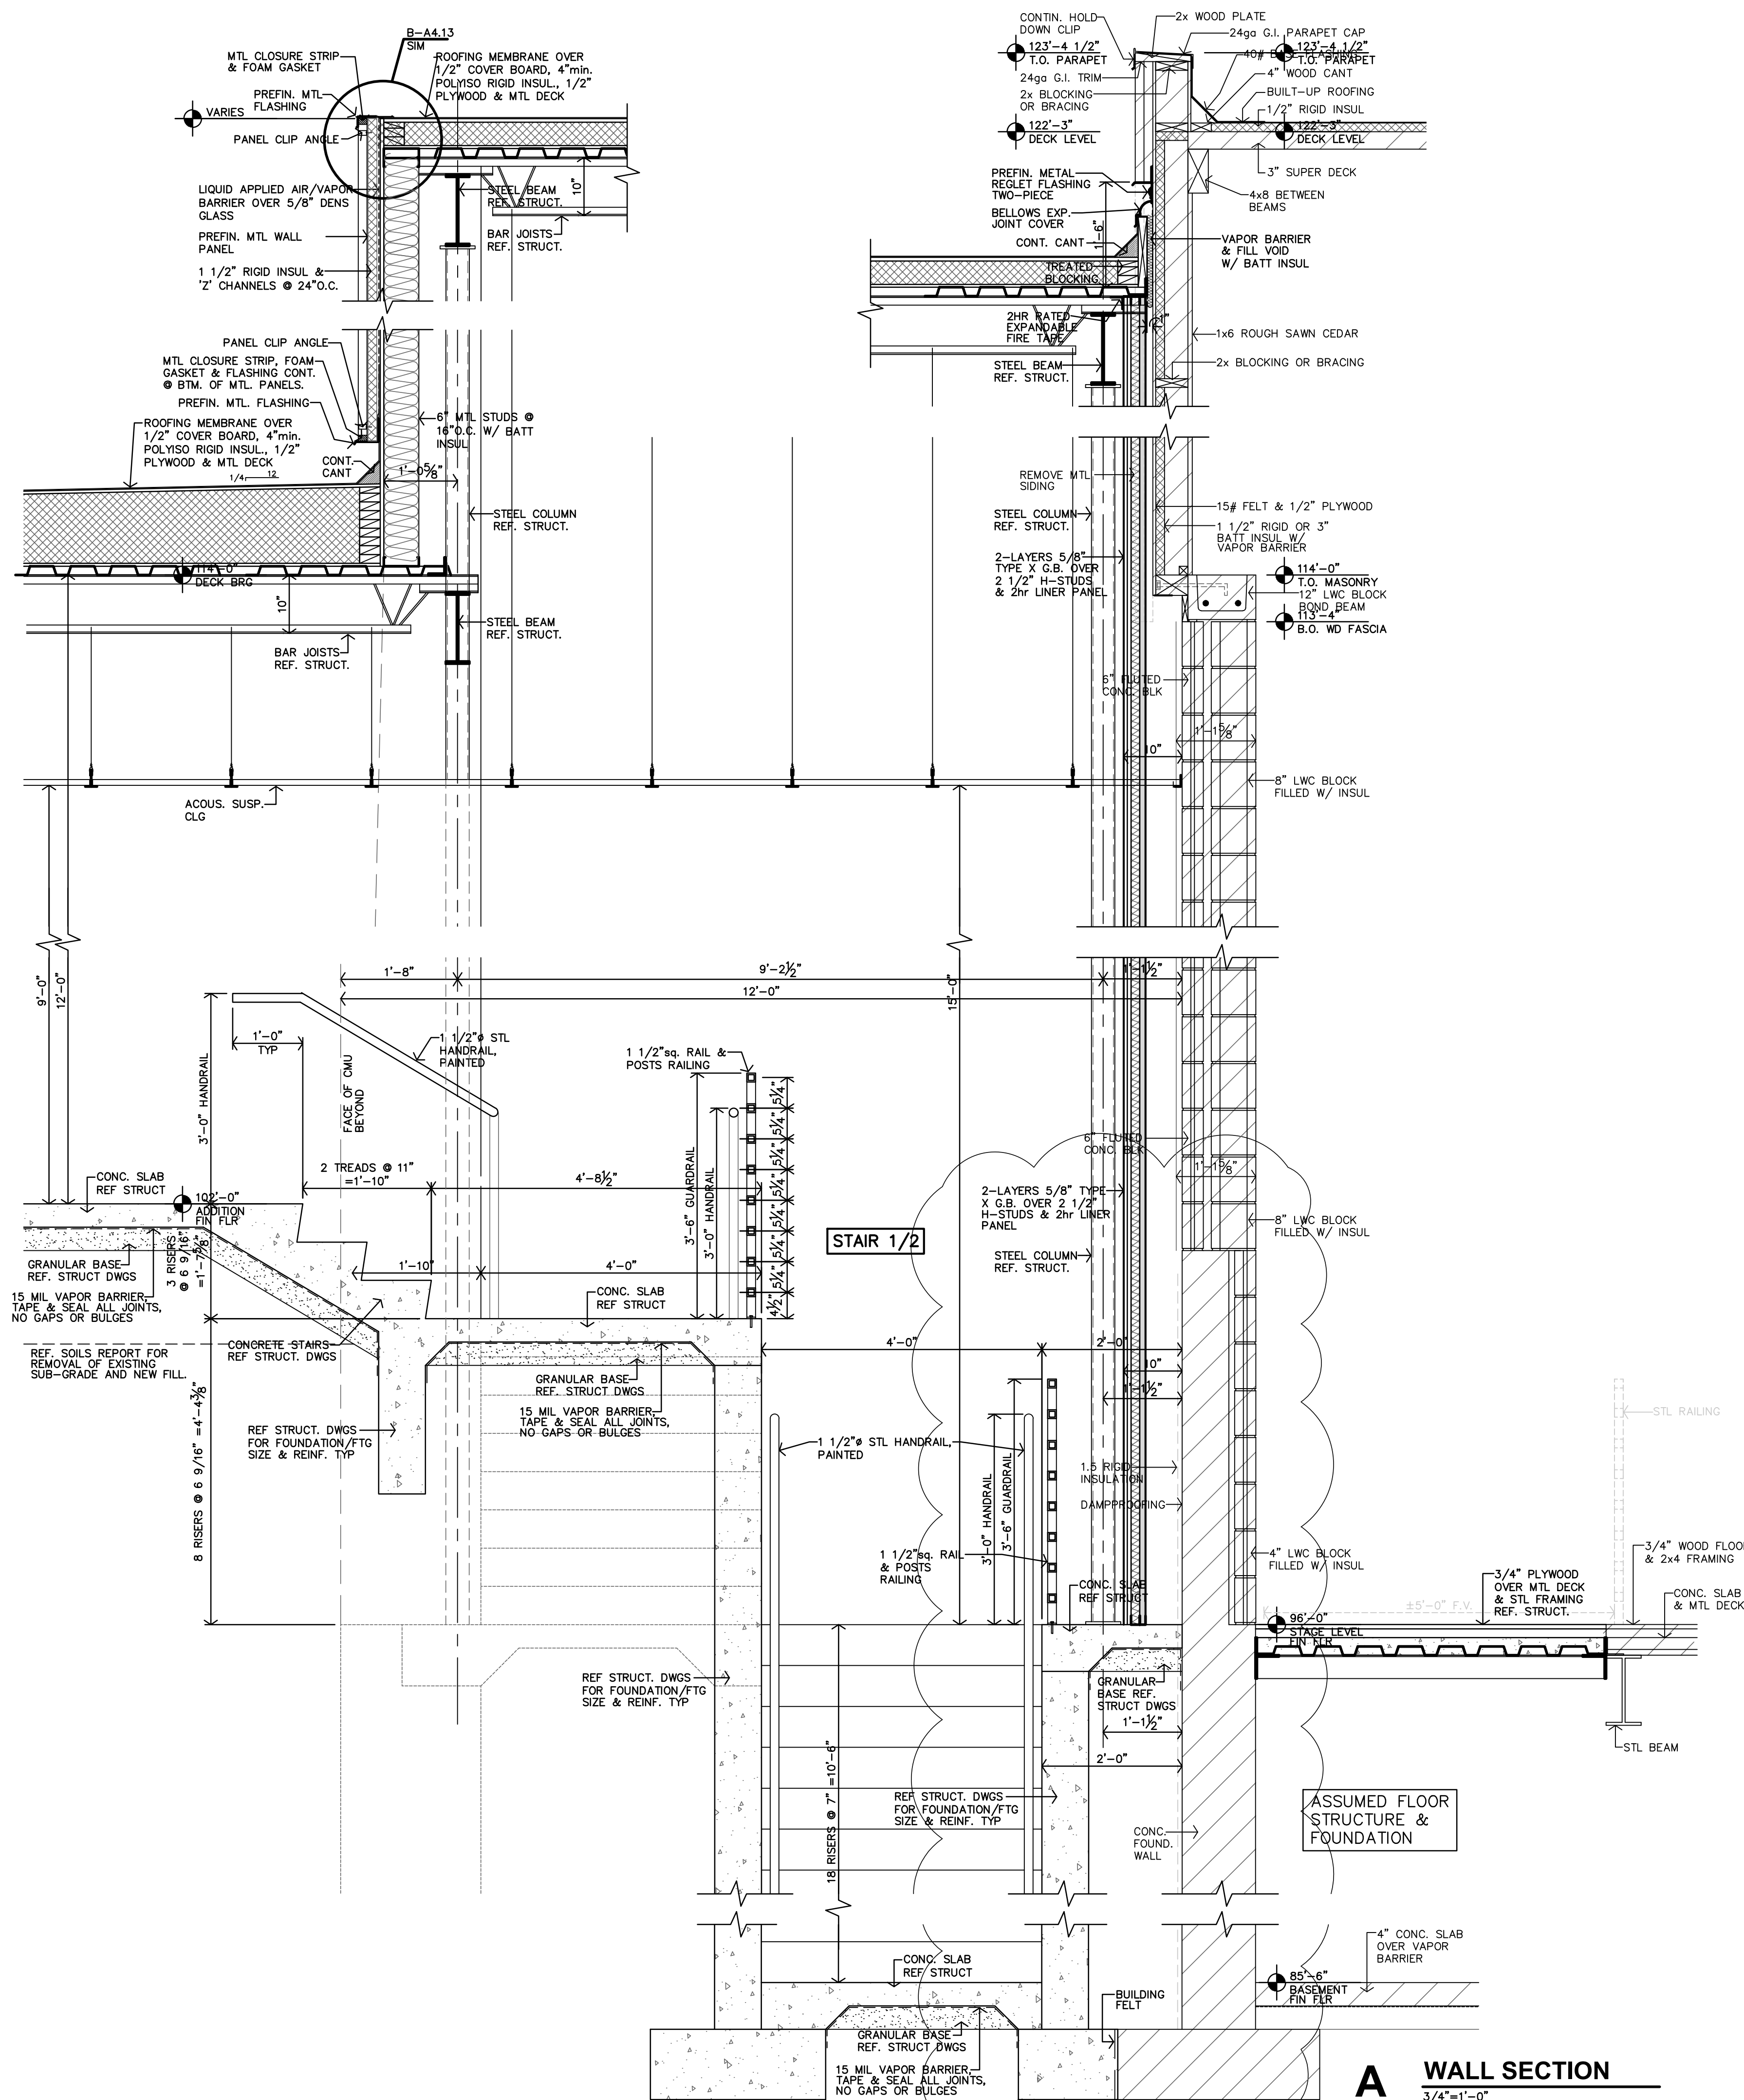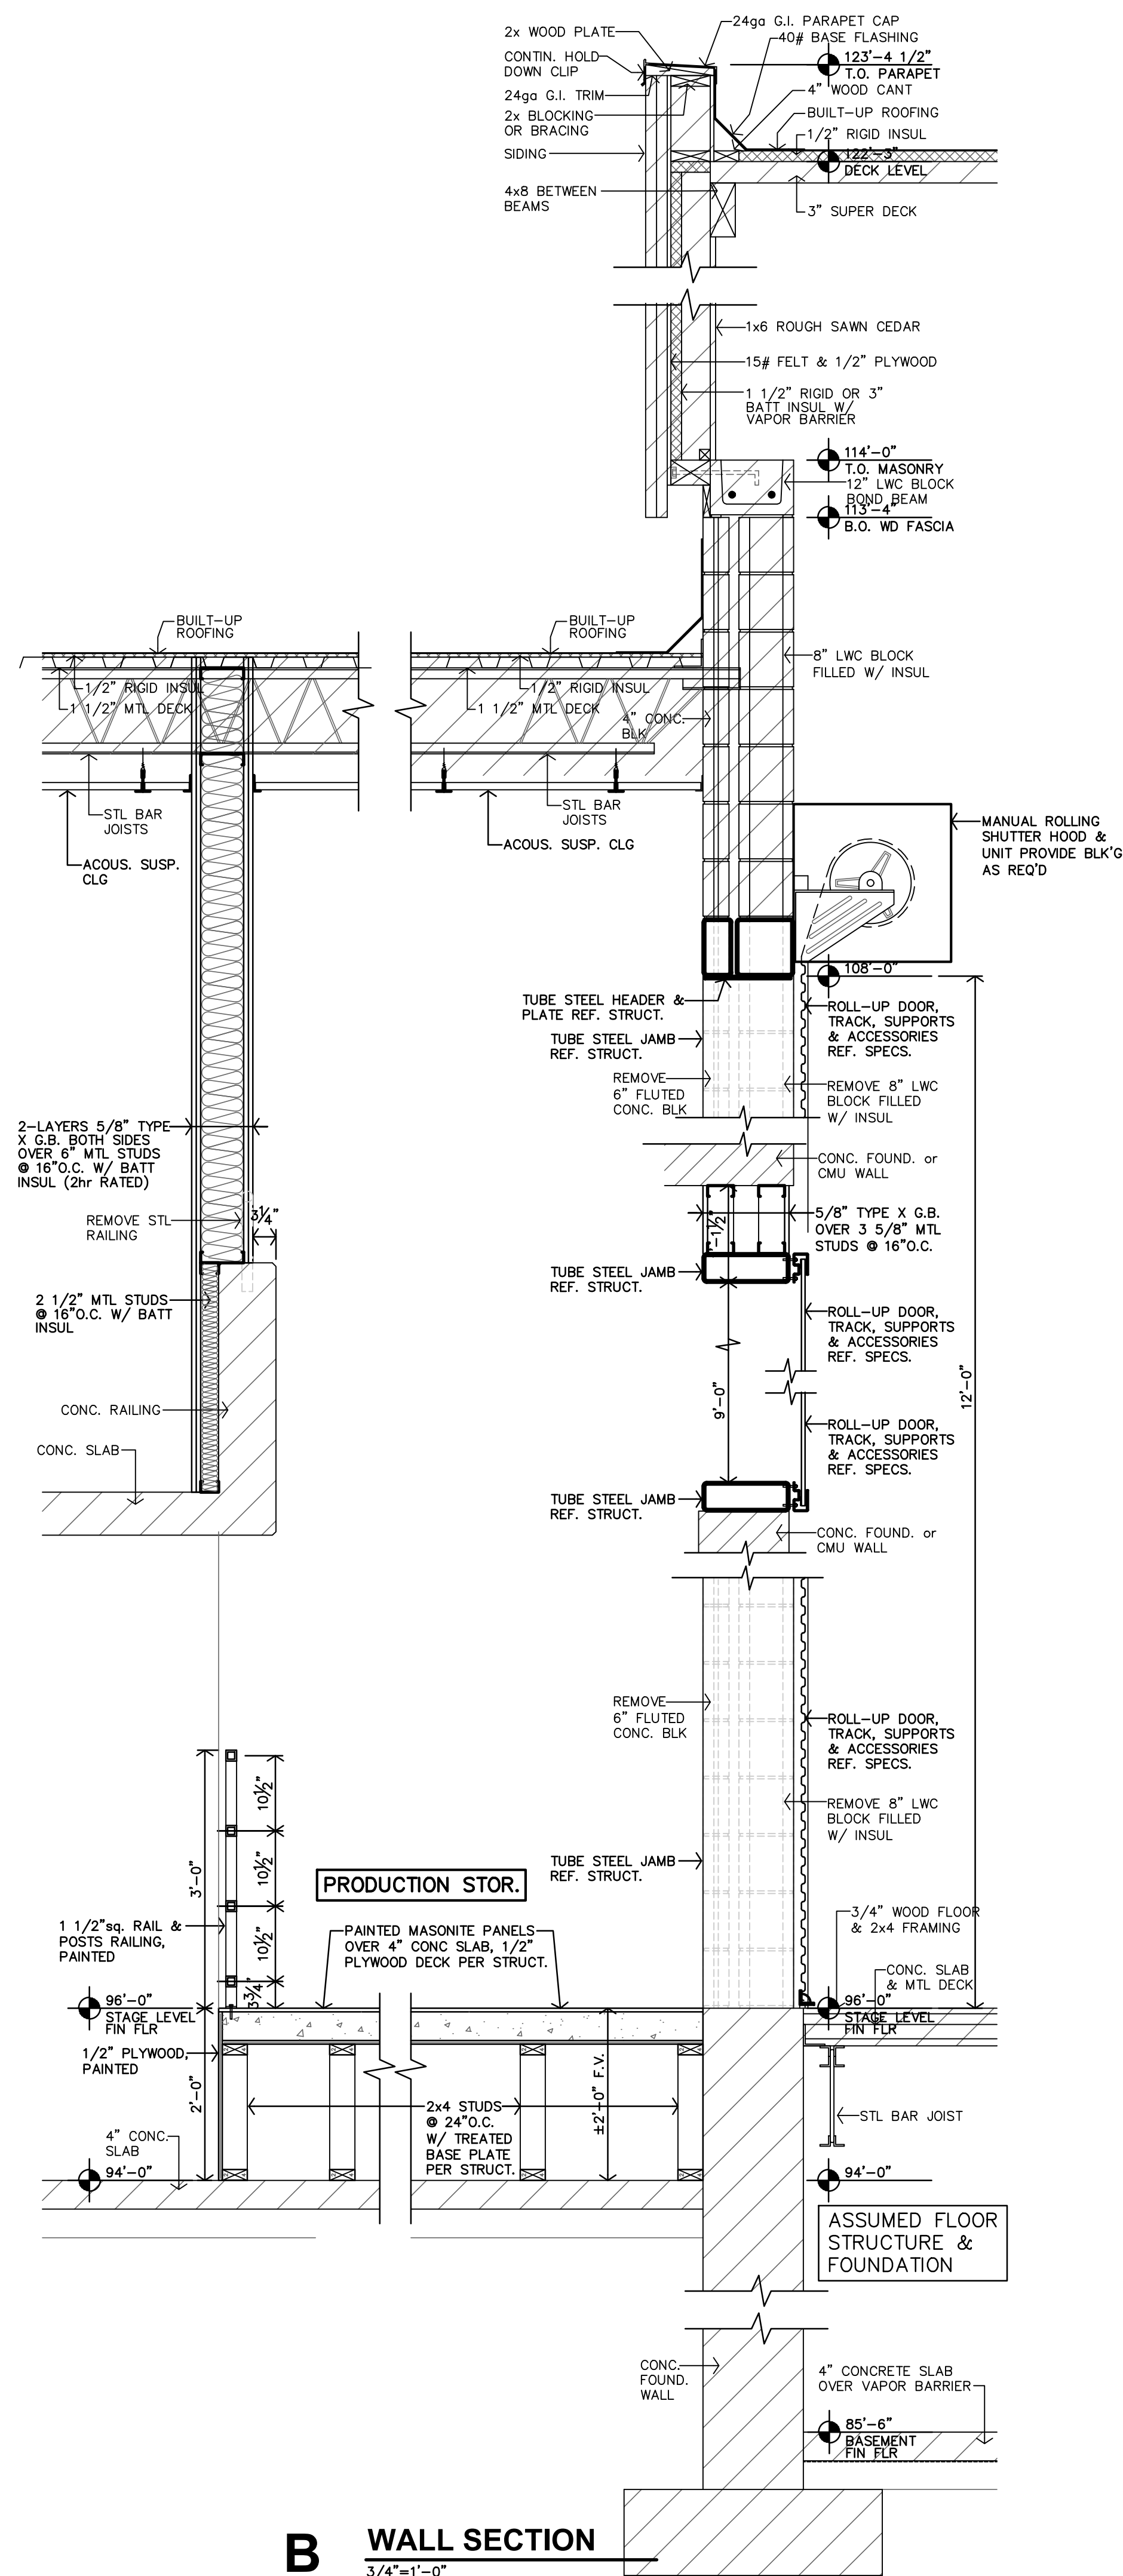








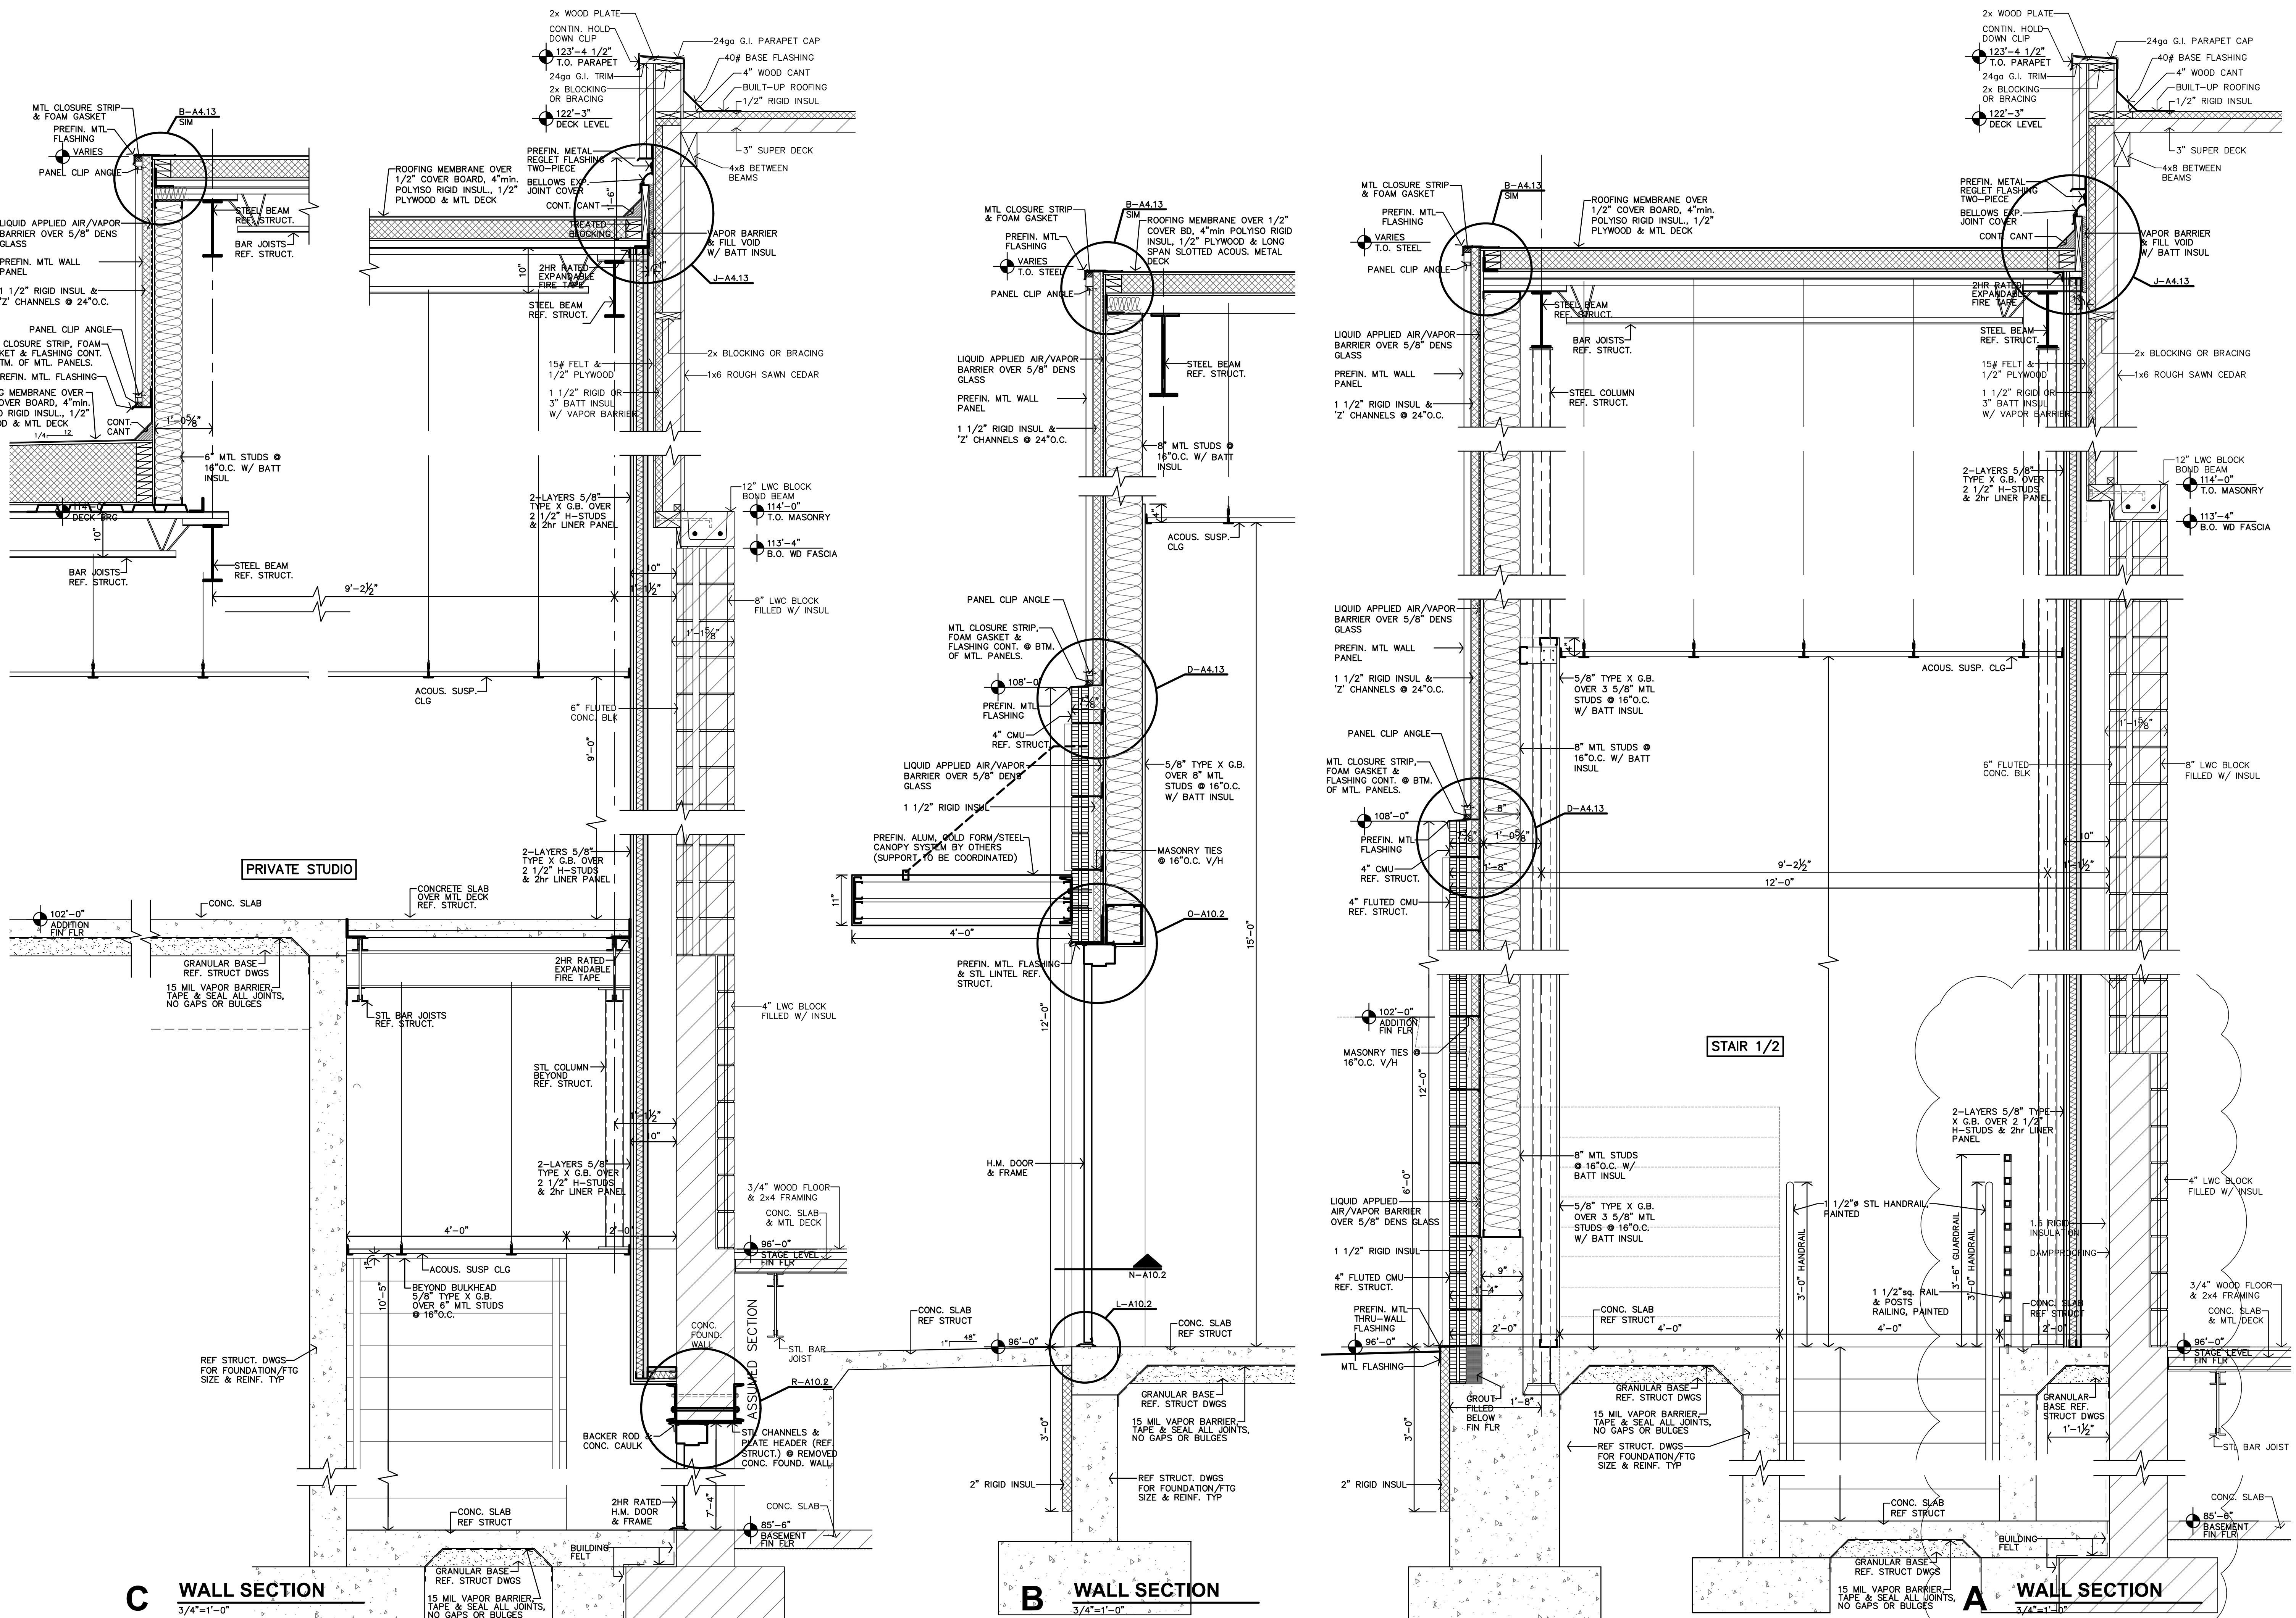




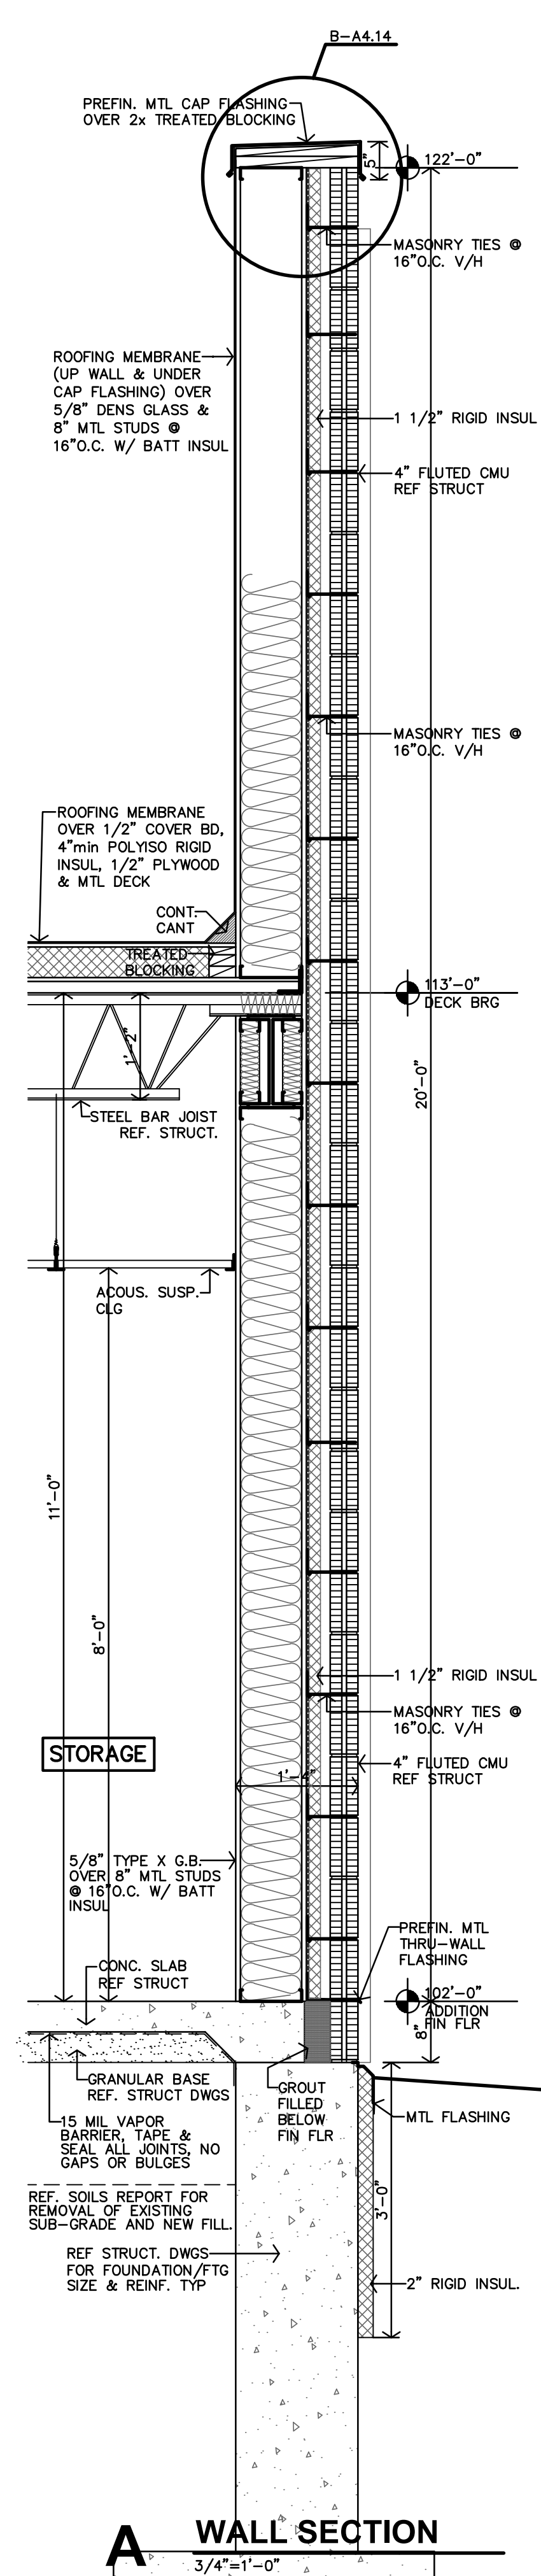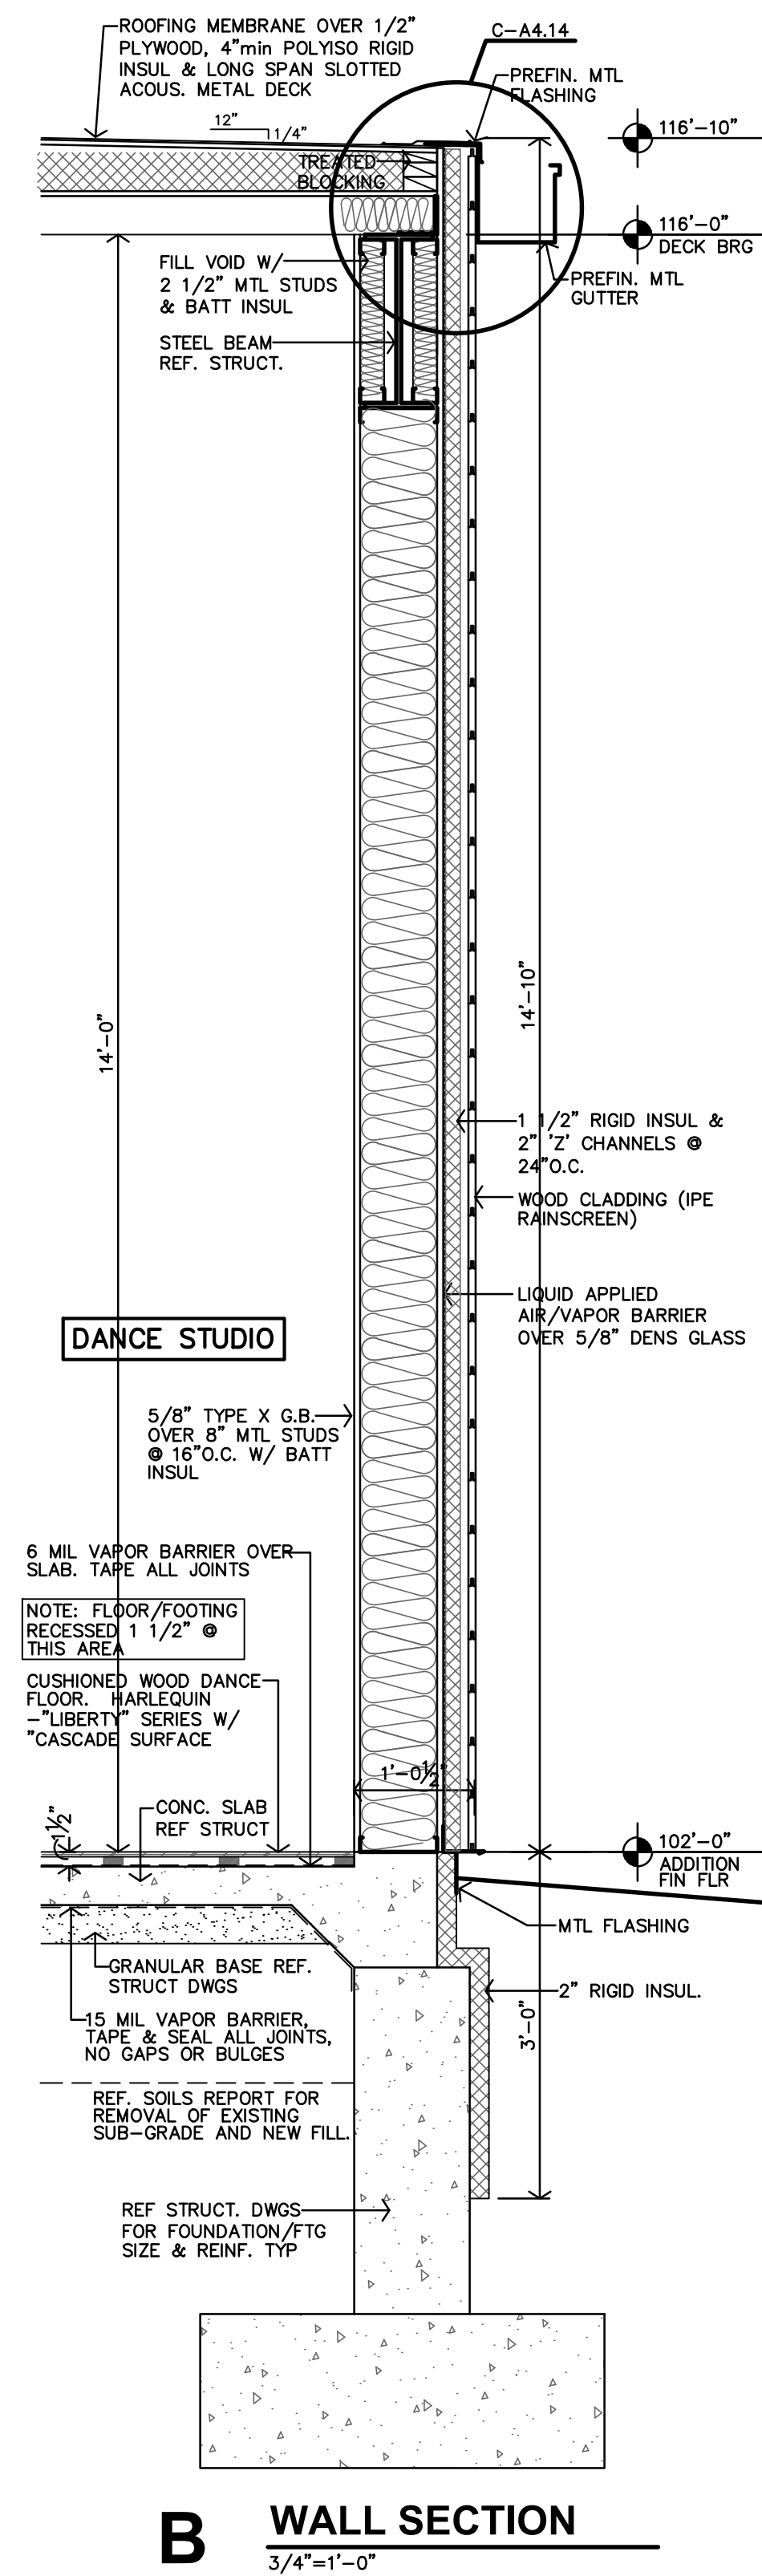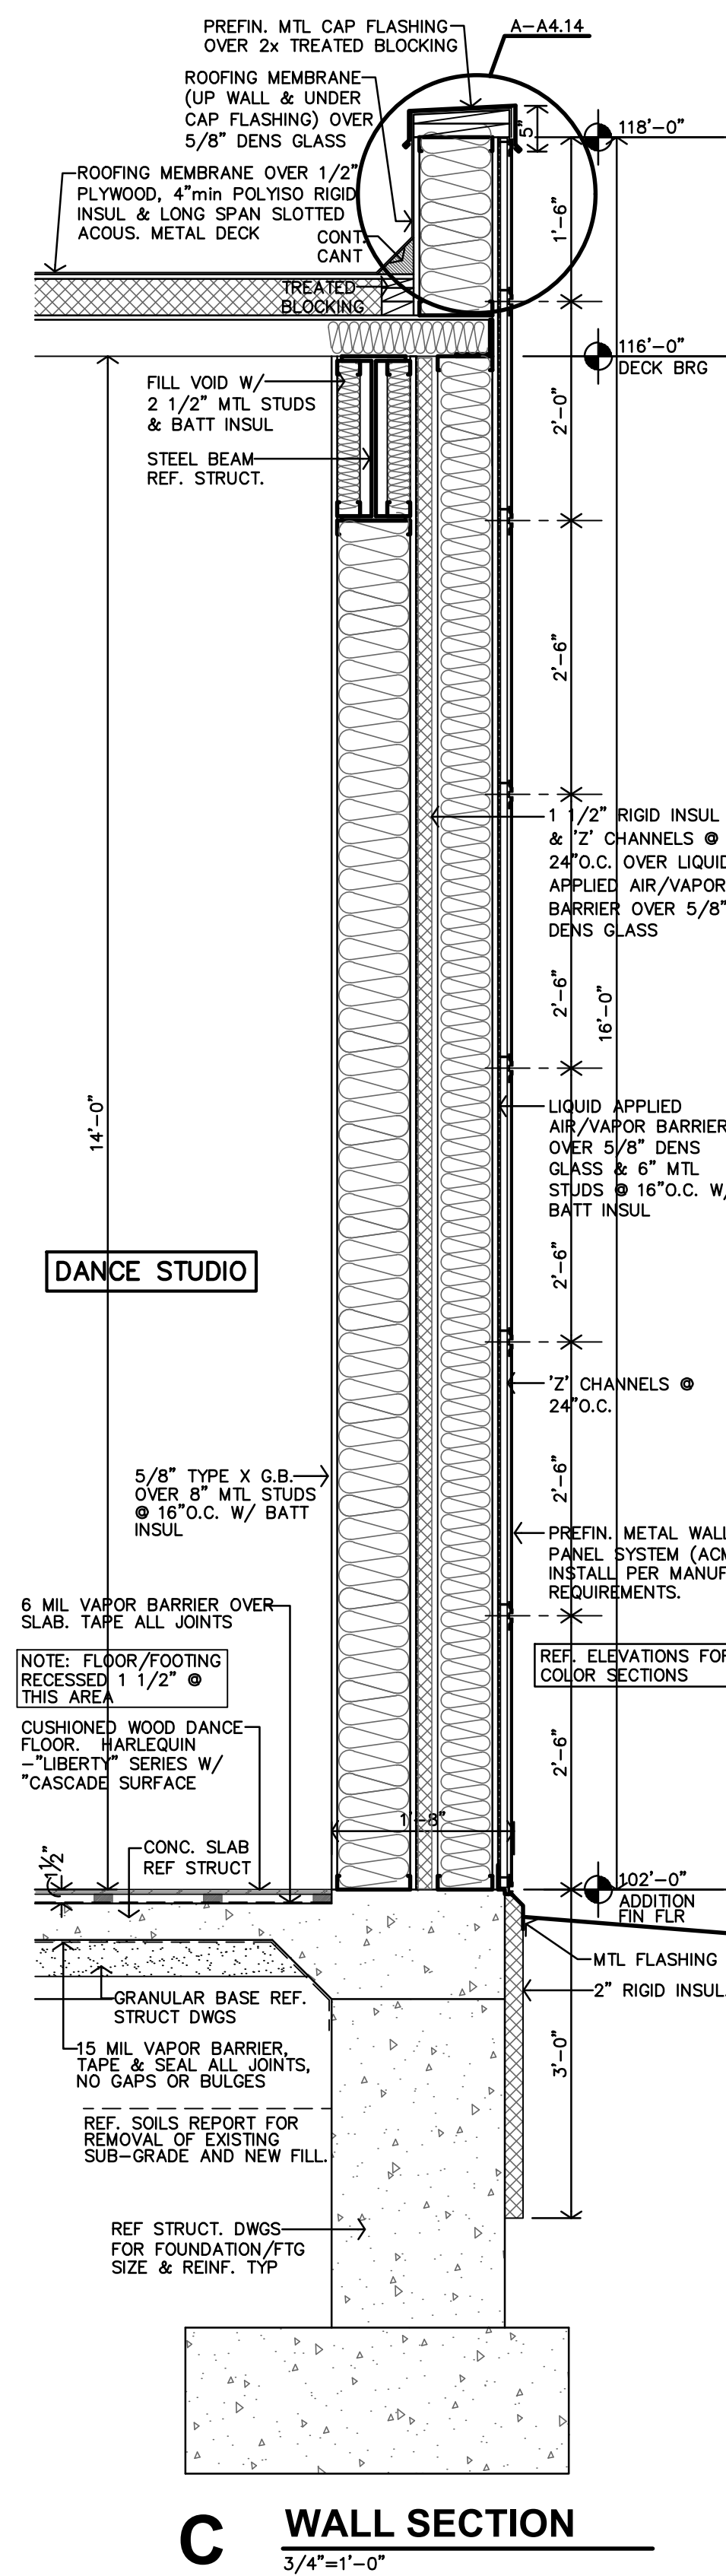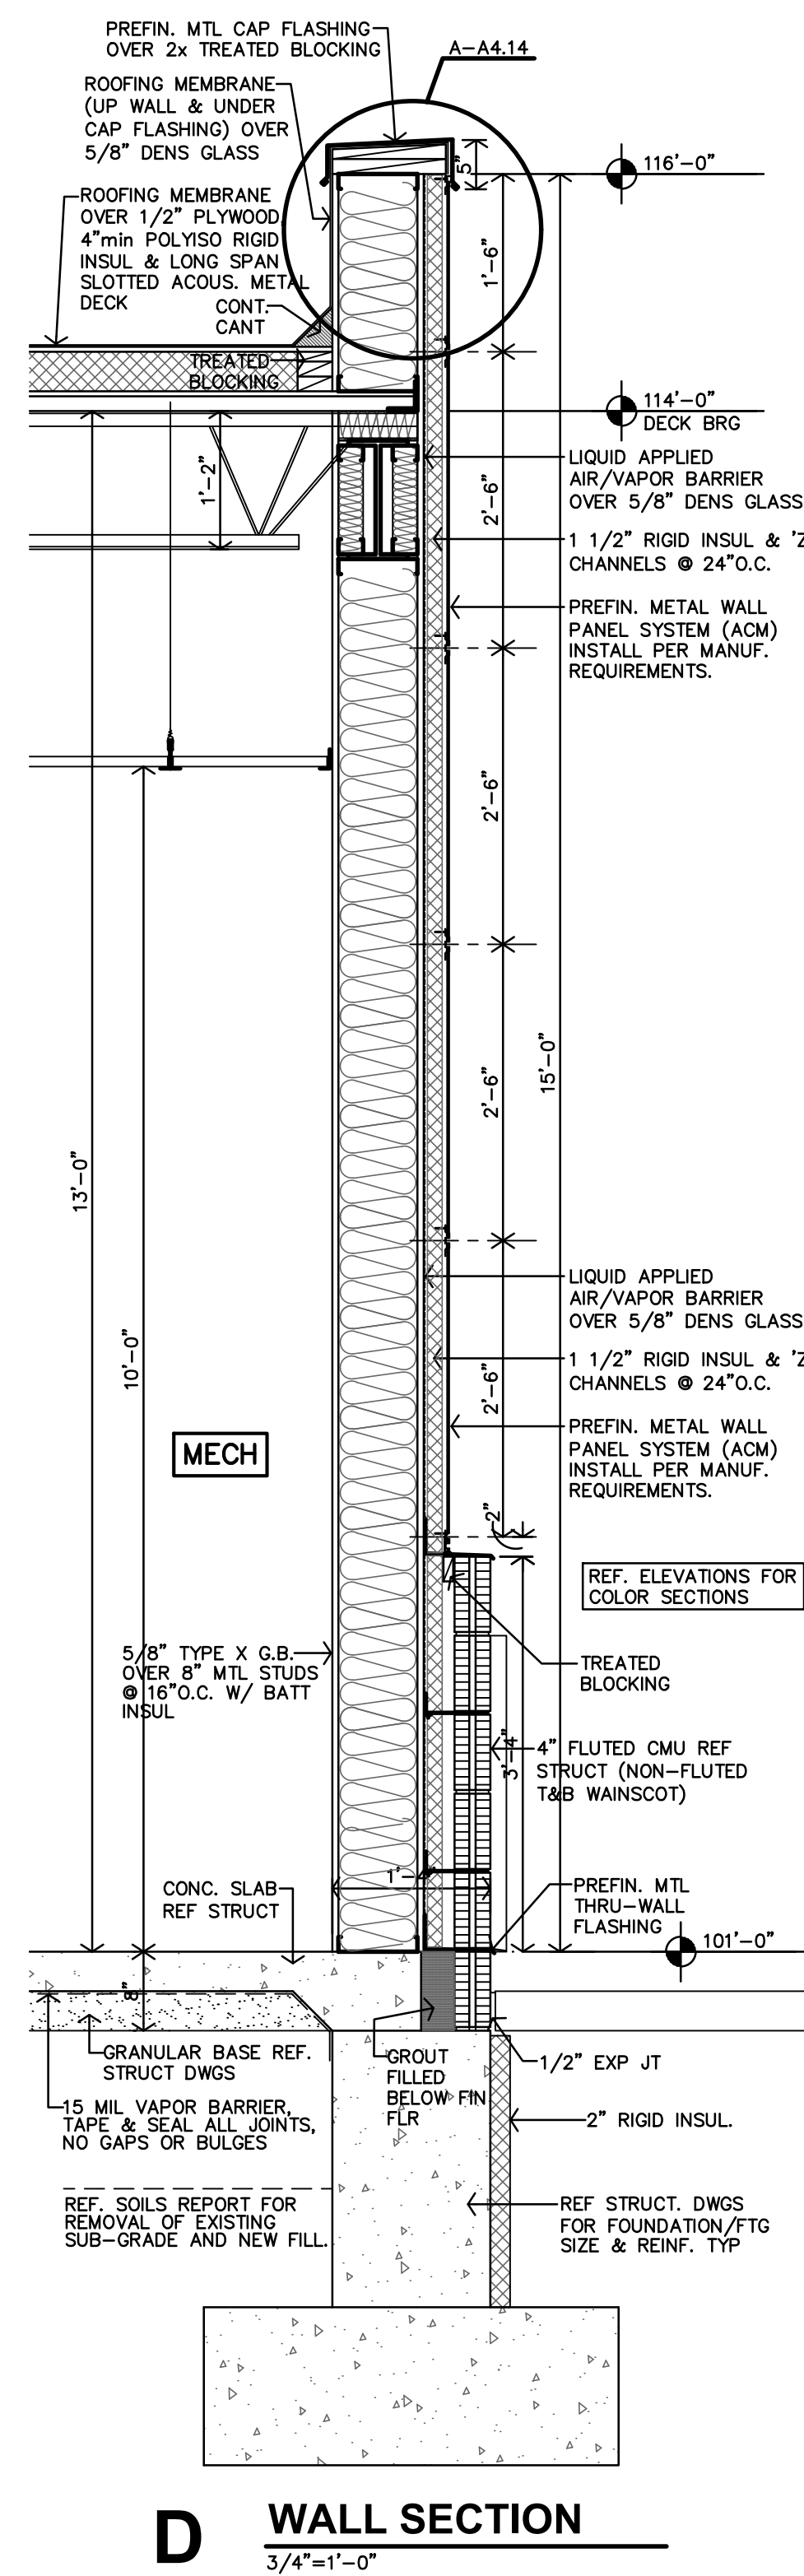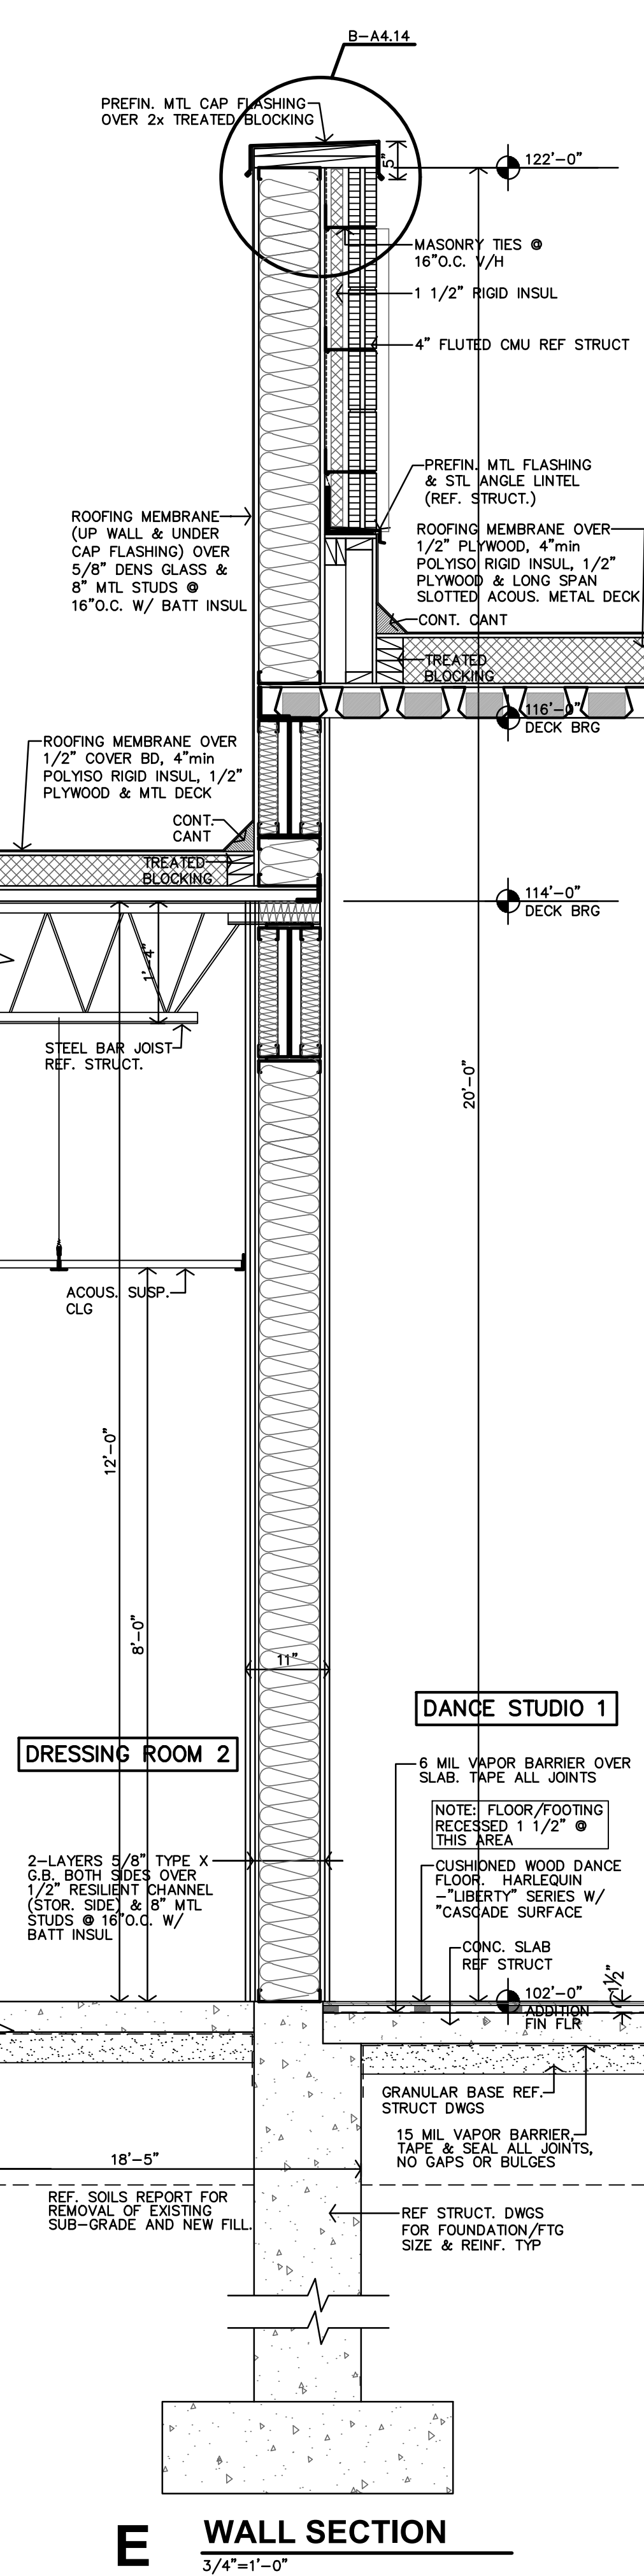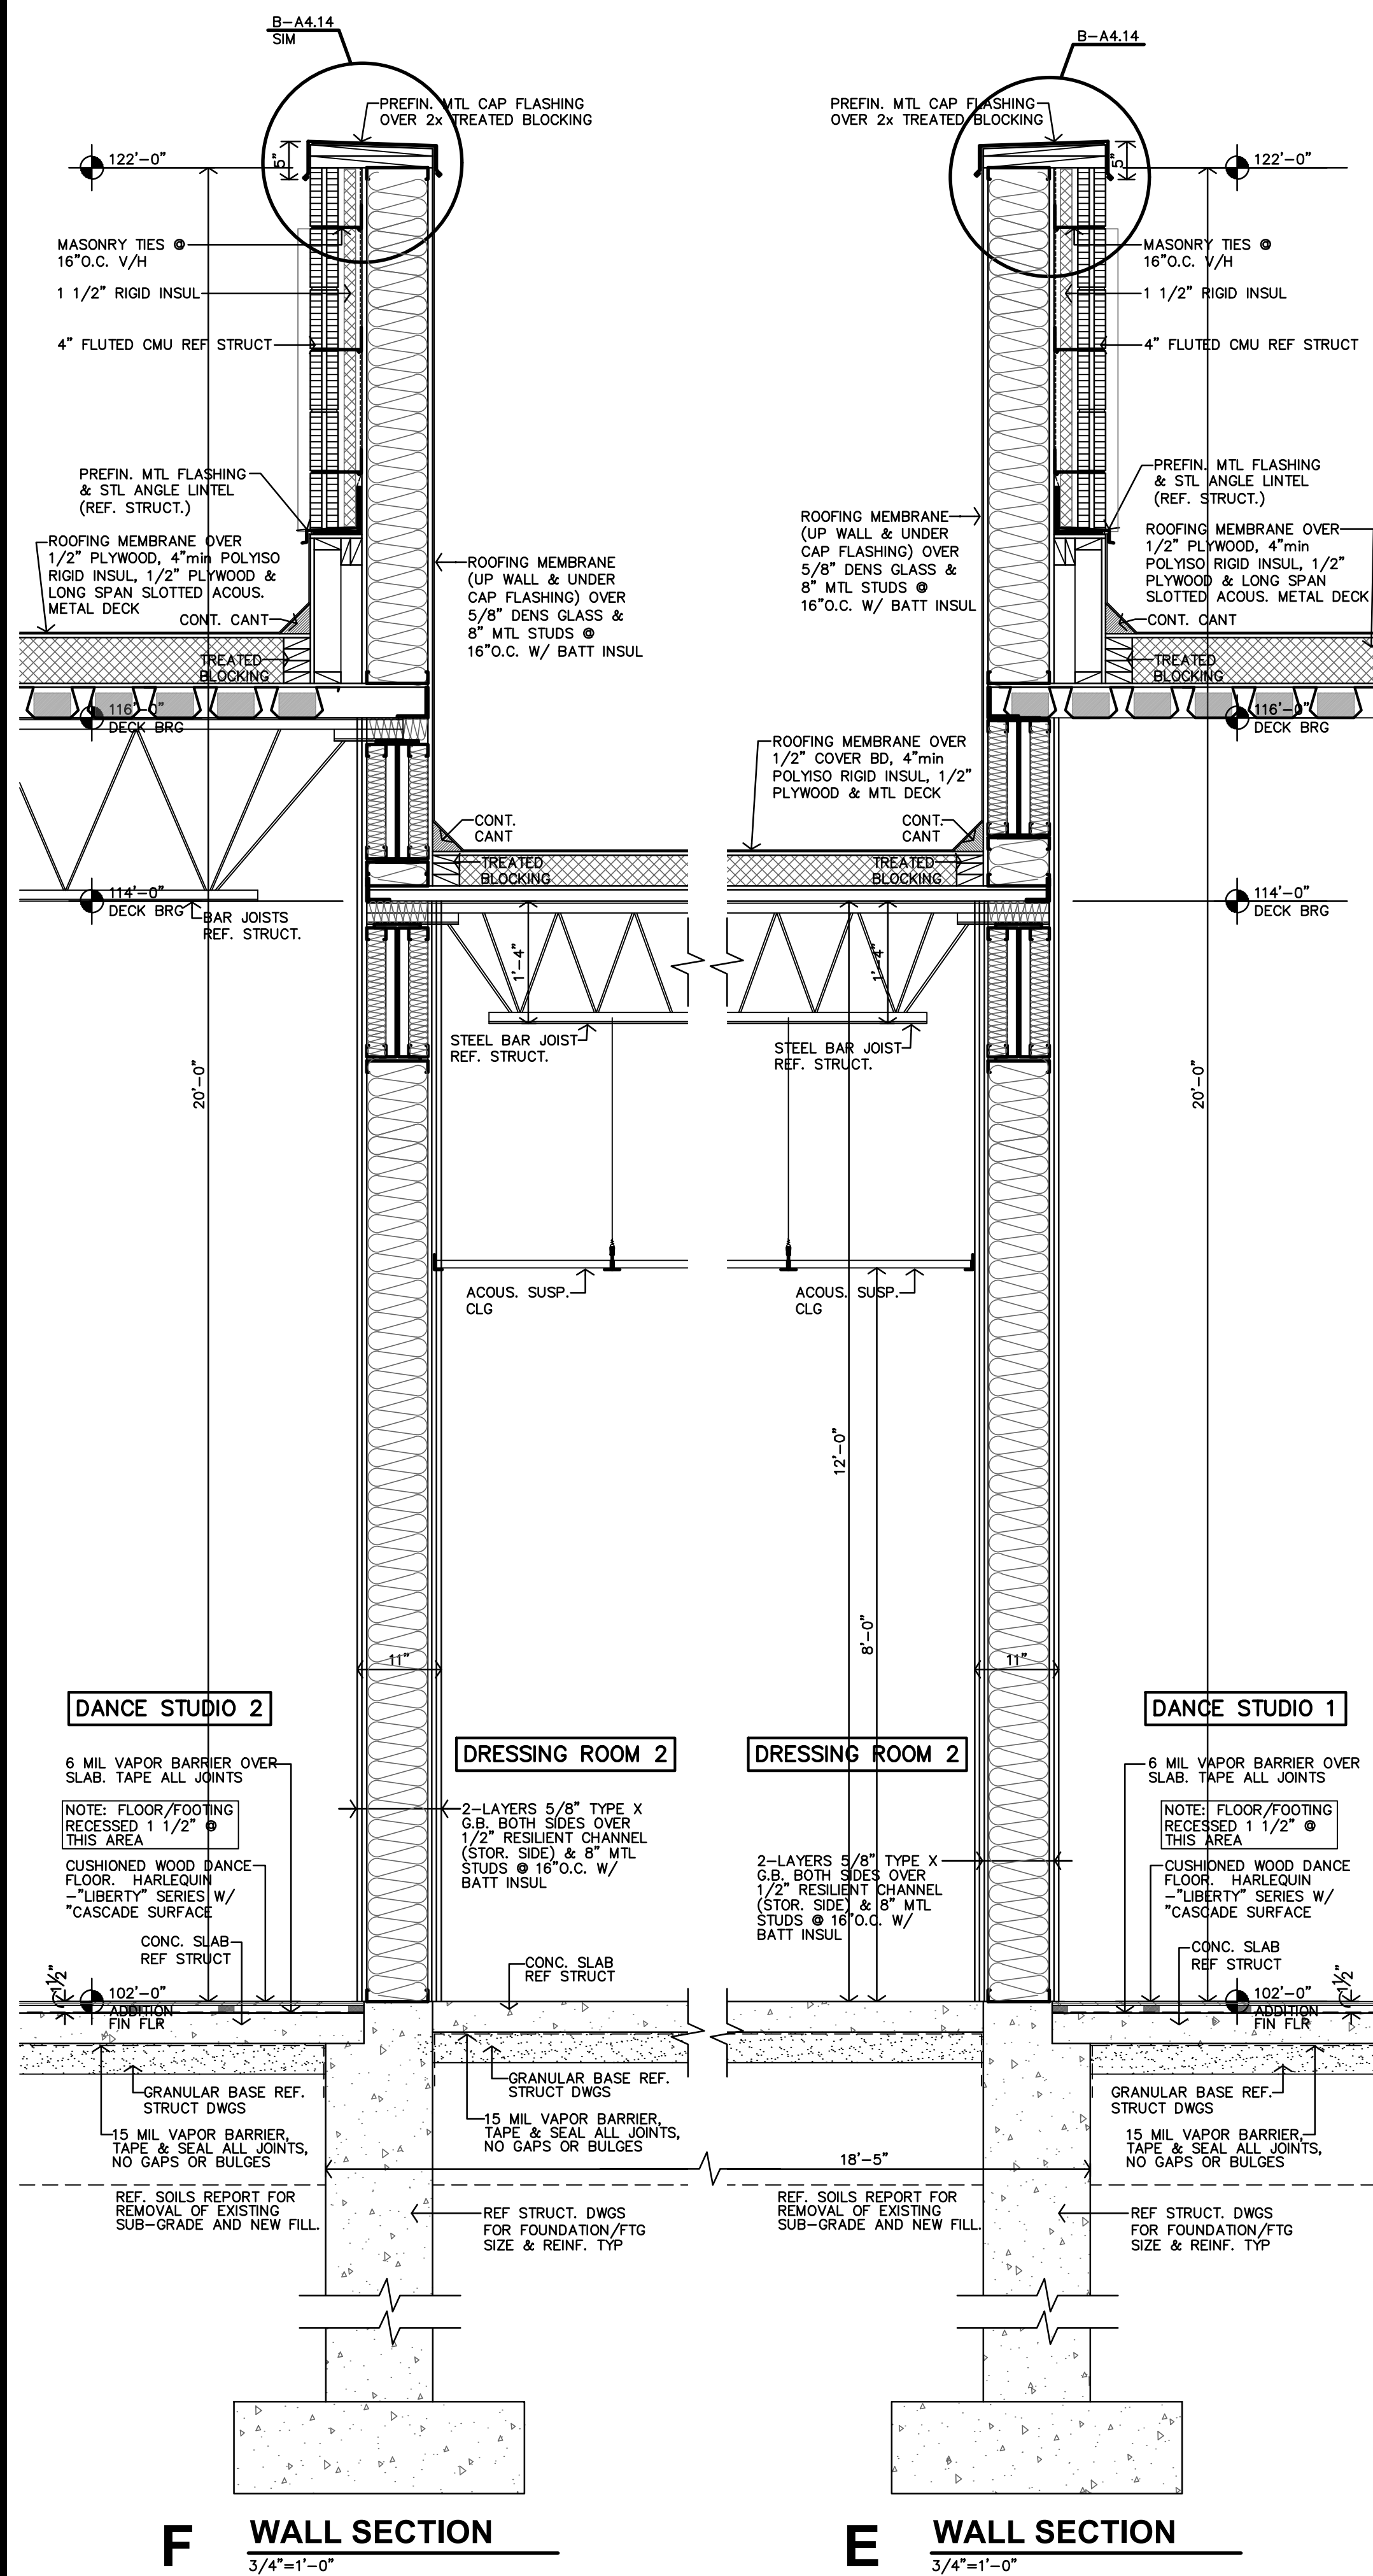









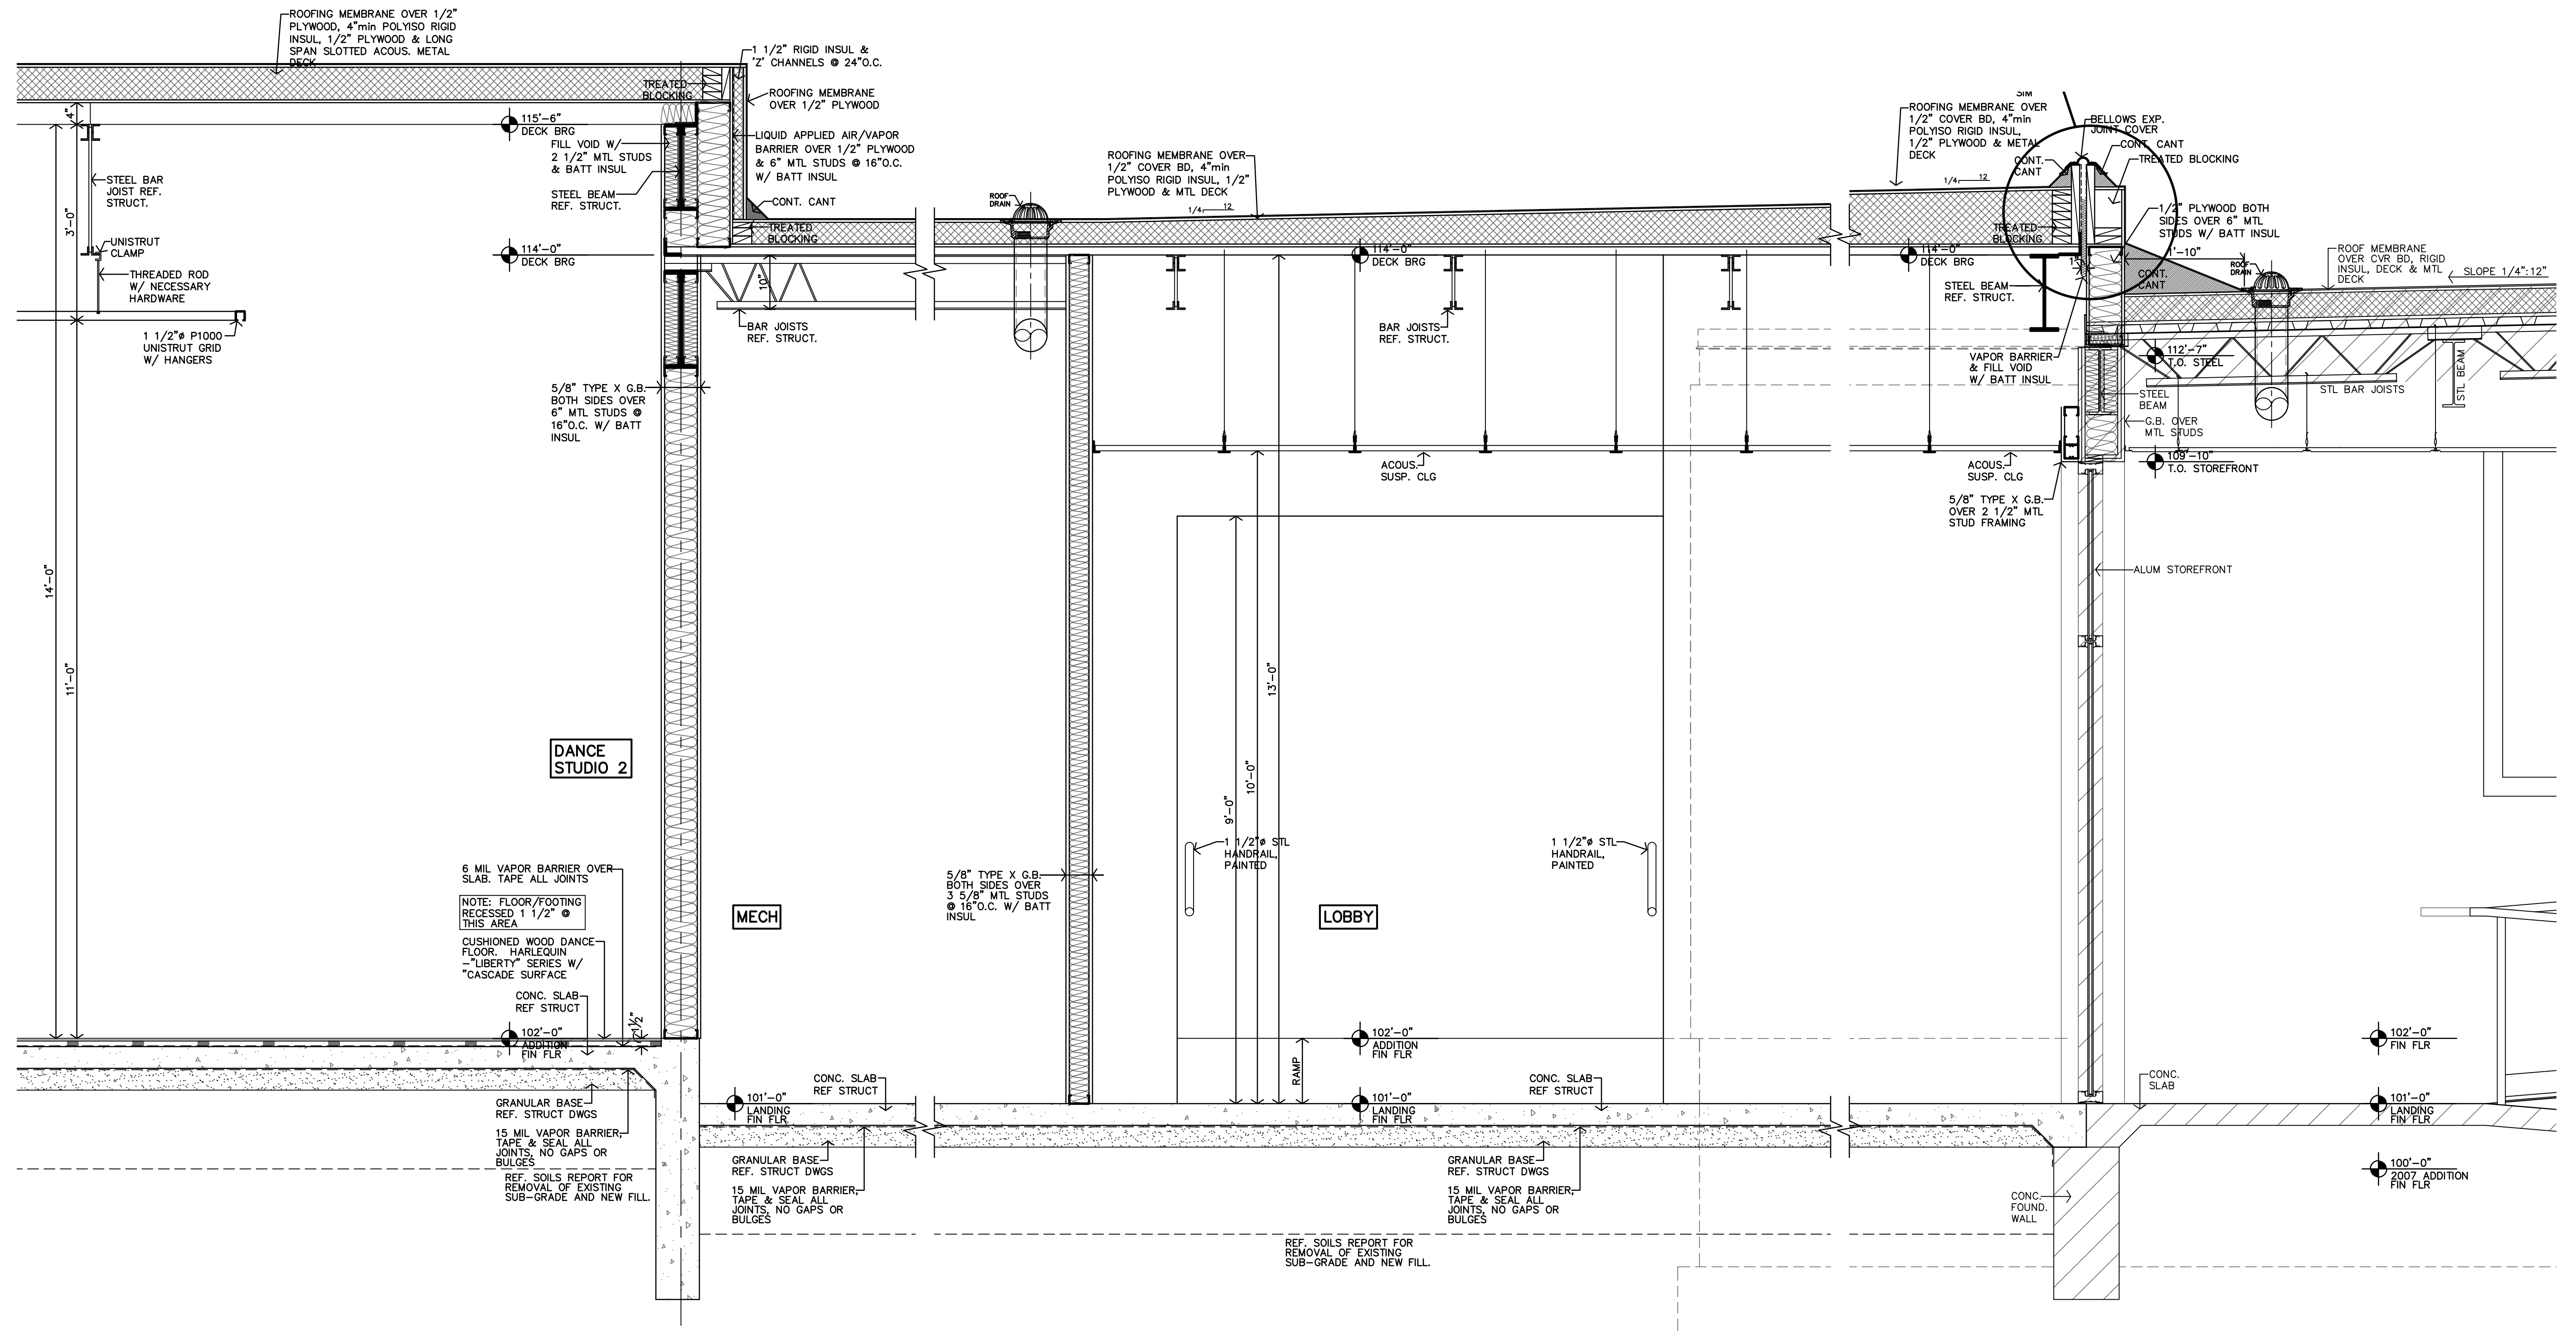


**B** WALL SECTION  
3/4"=1'-0"

**A** WALL SECTION  
3/4"=1'-0"




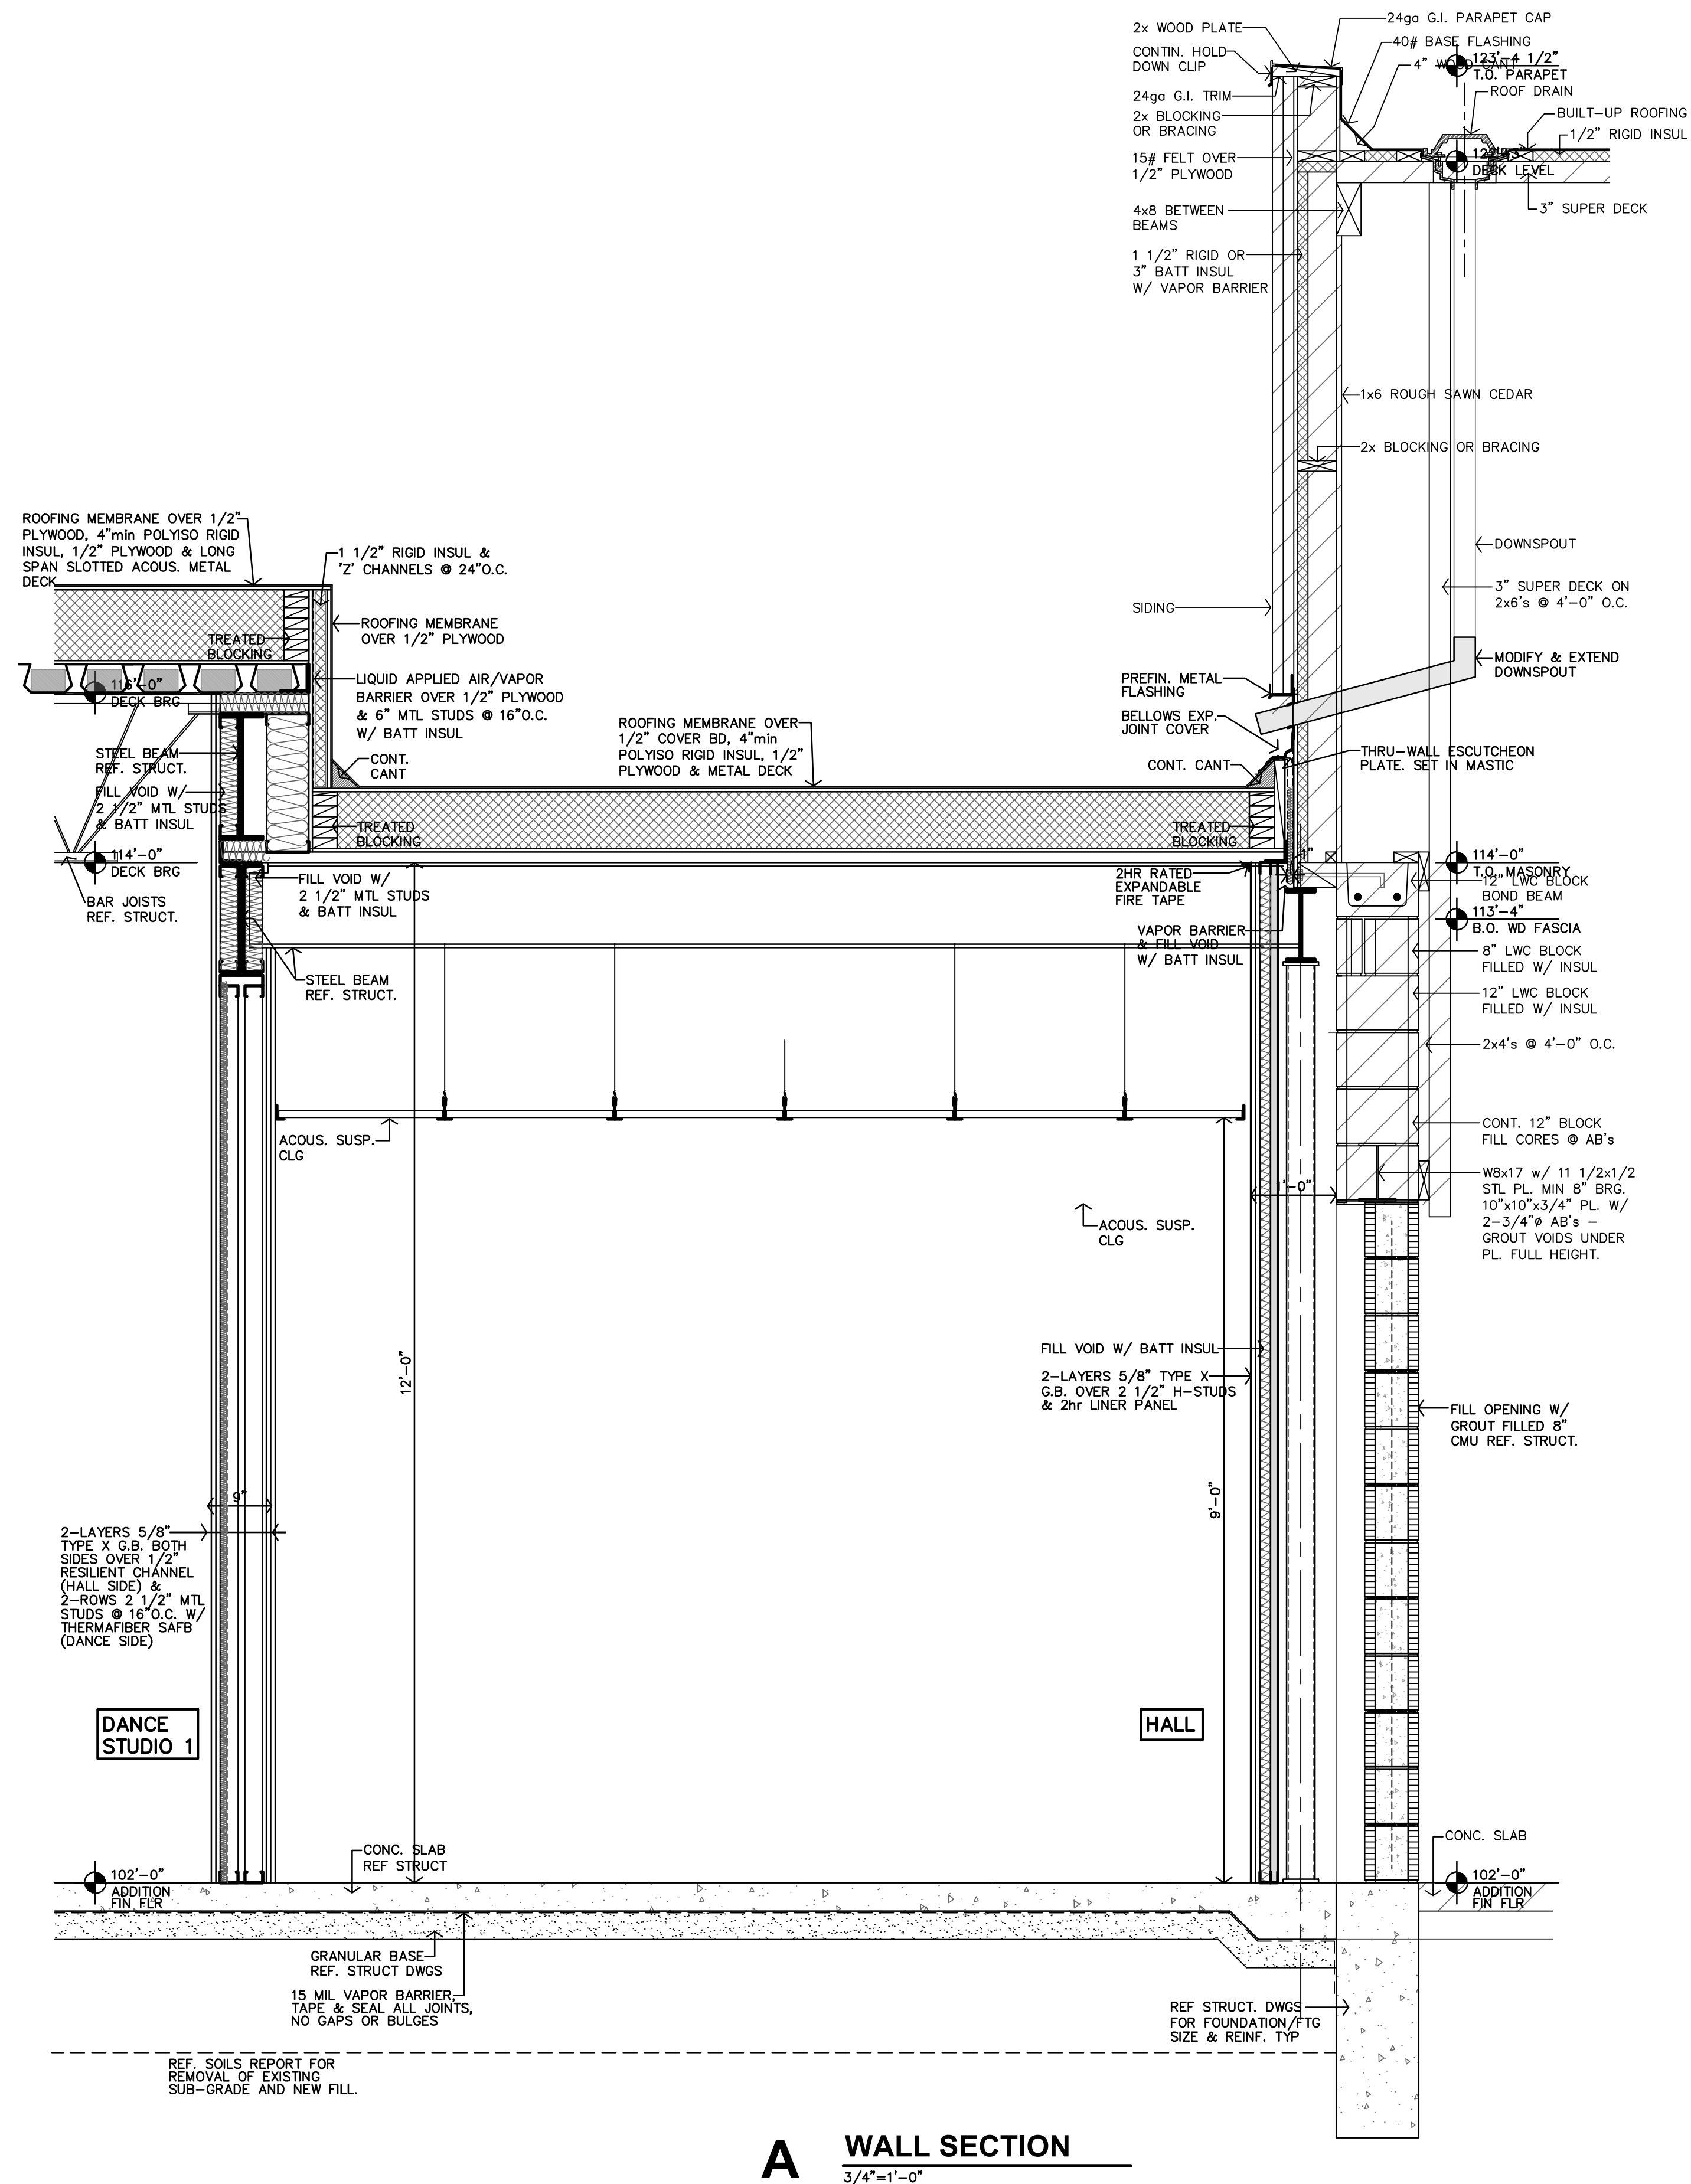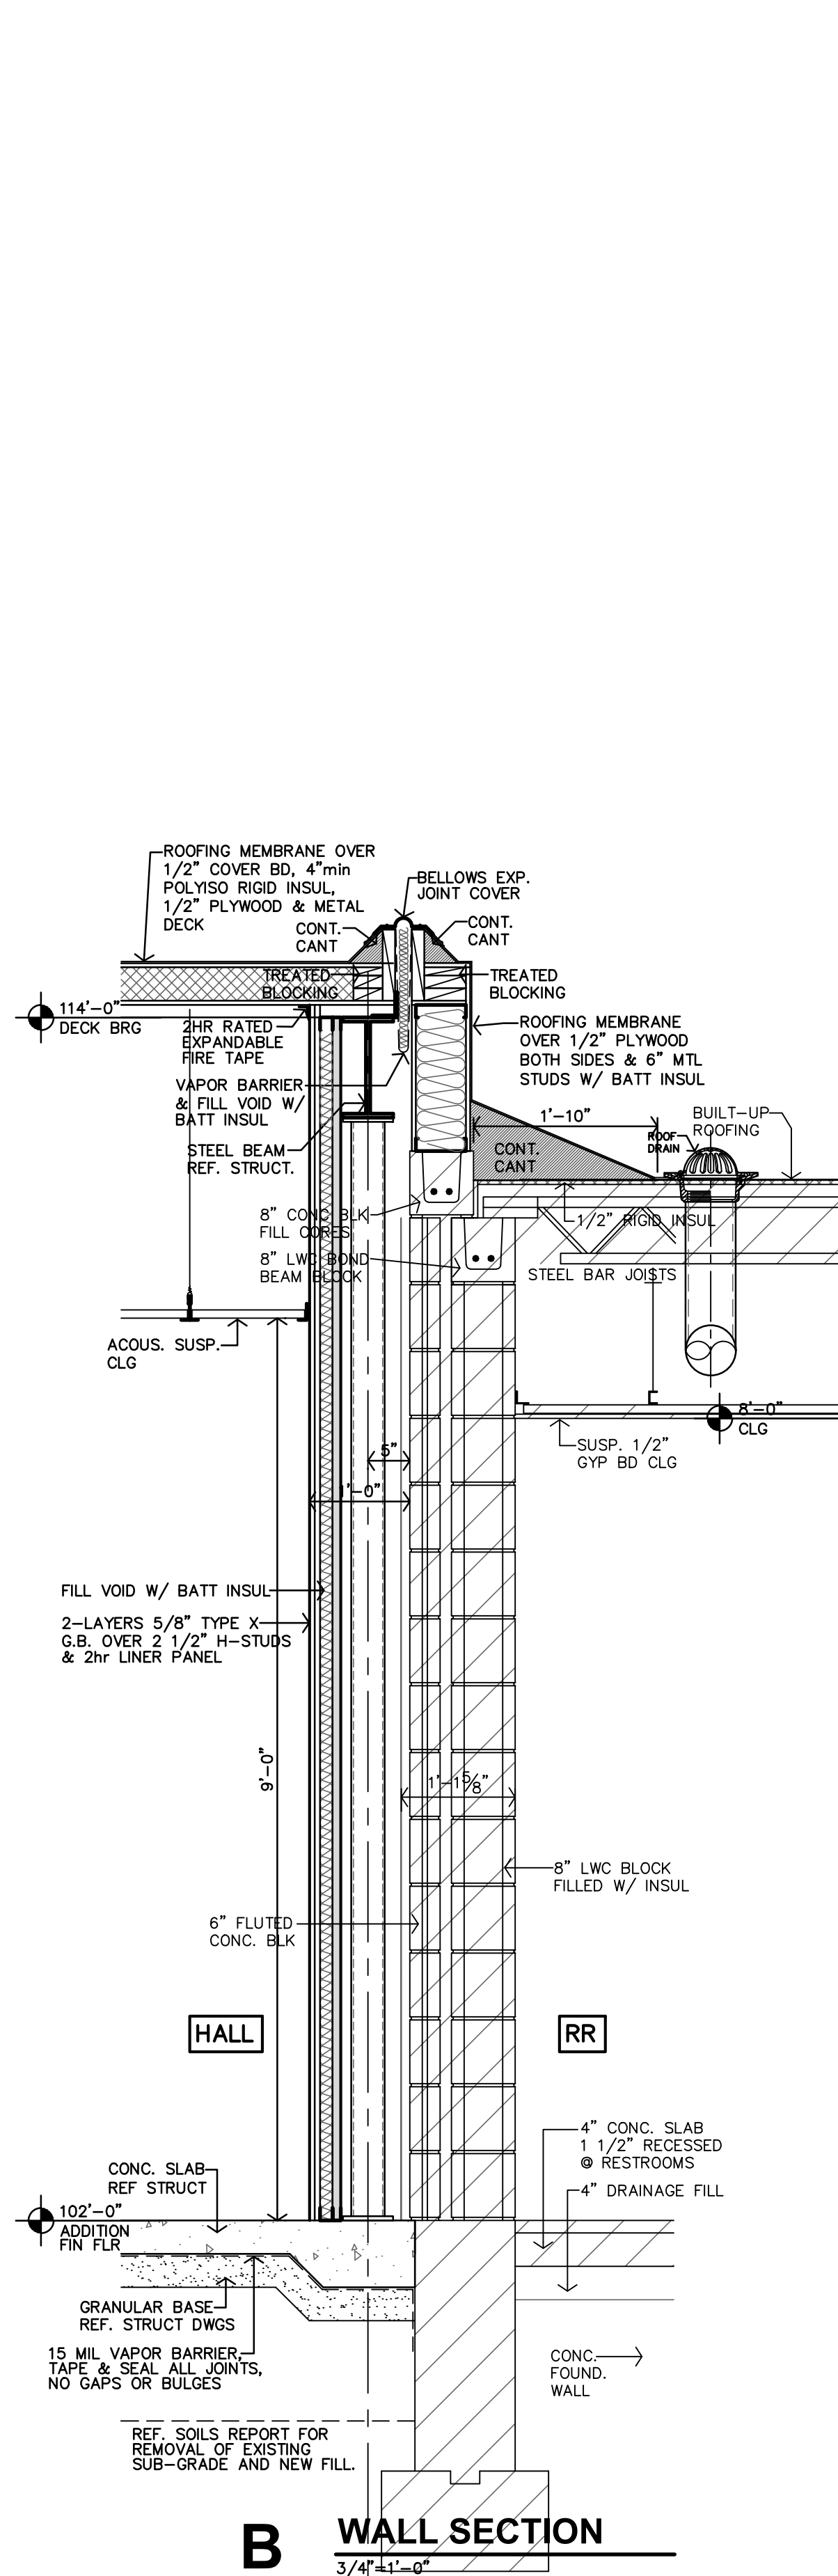



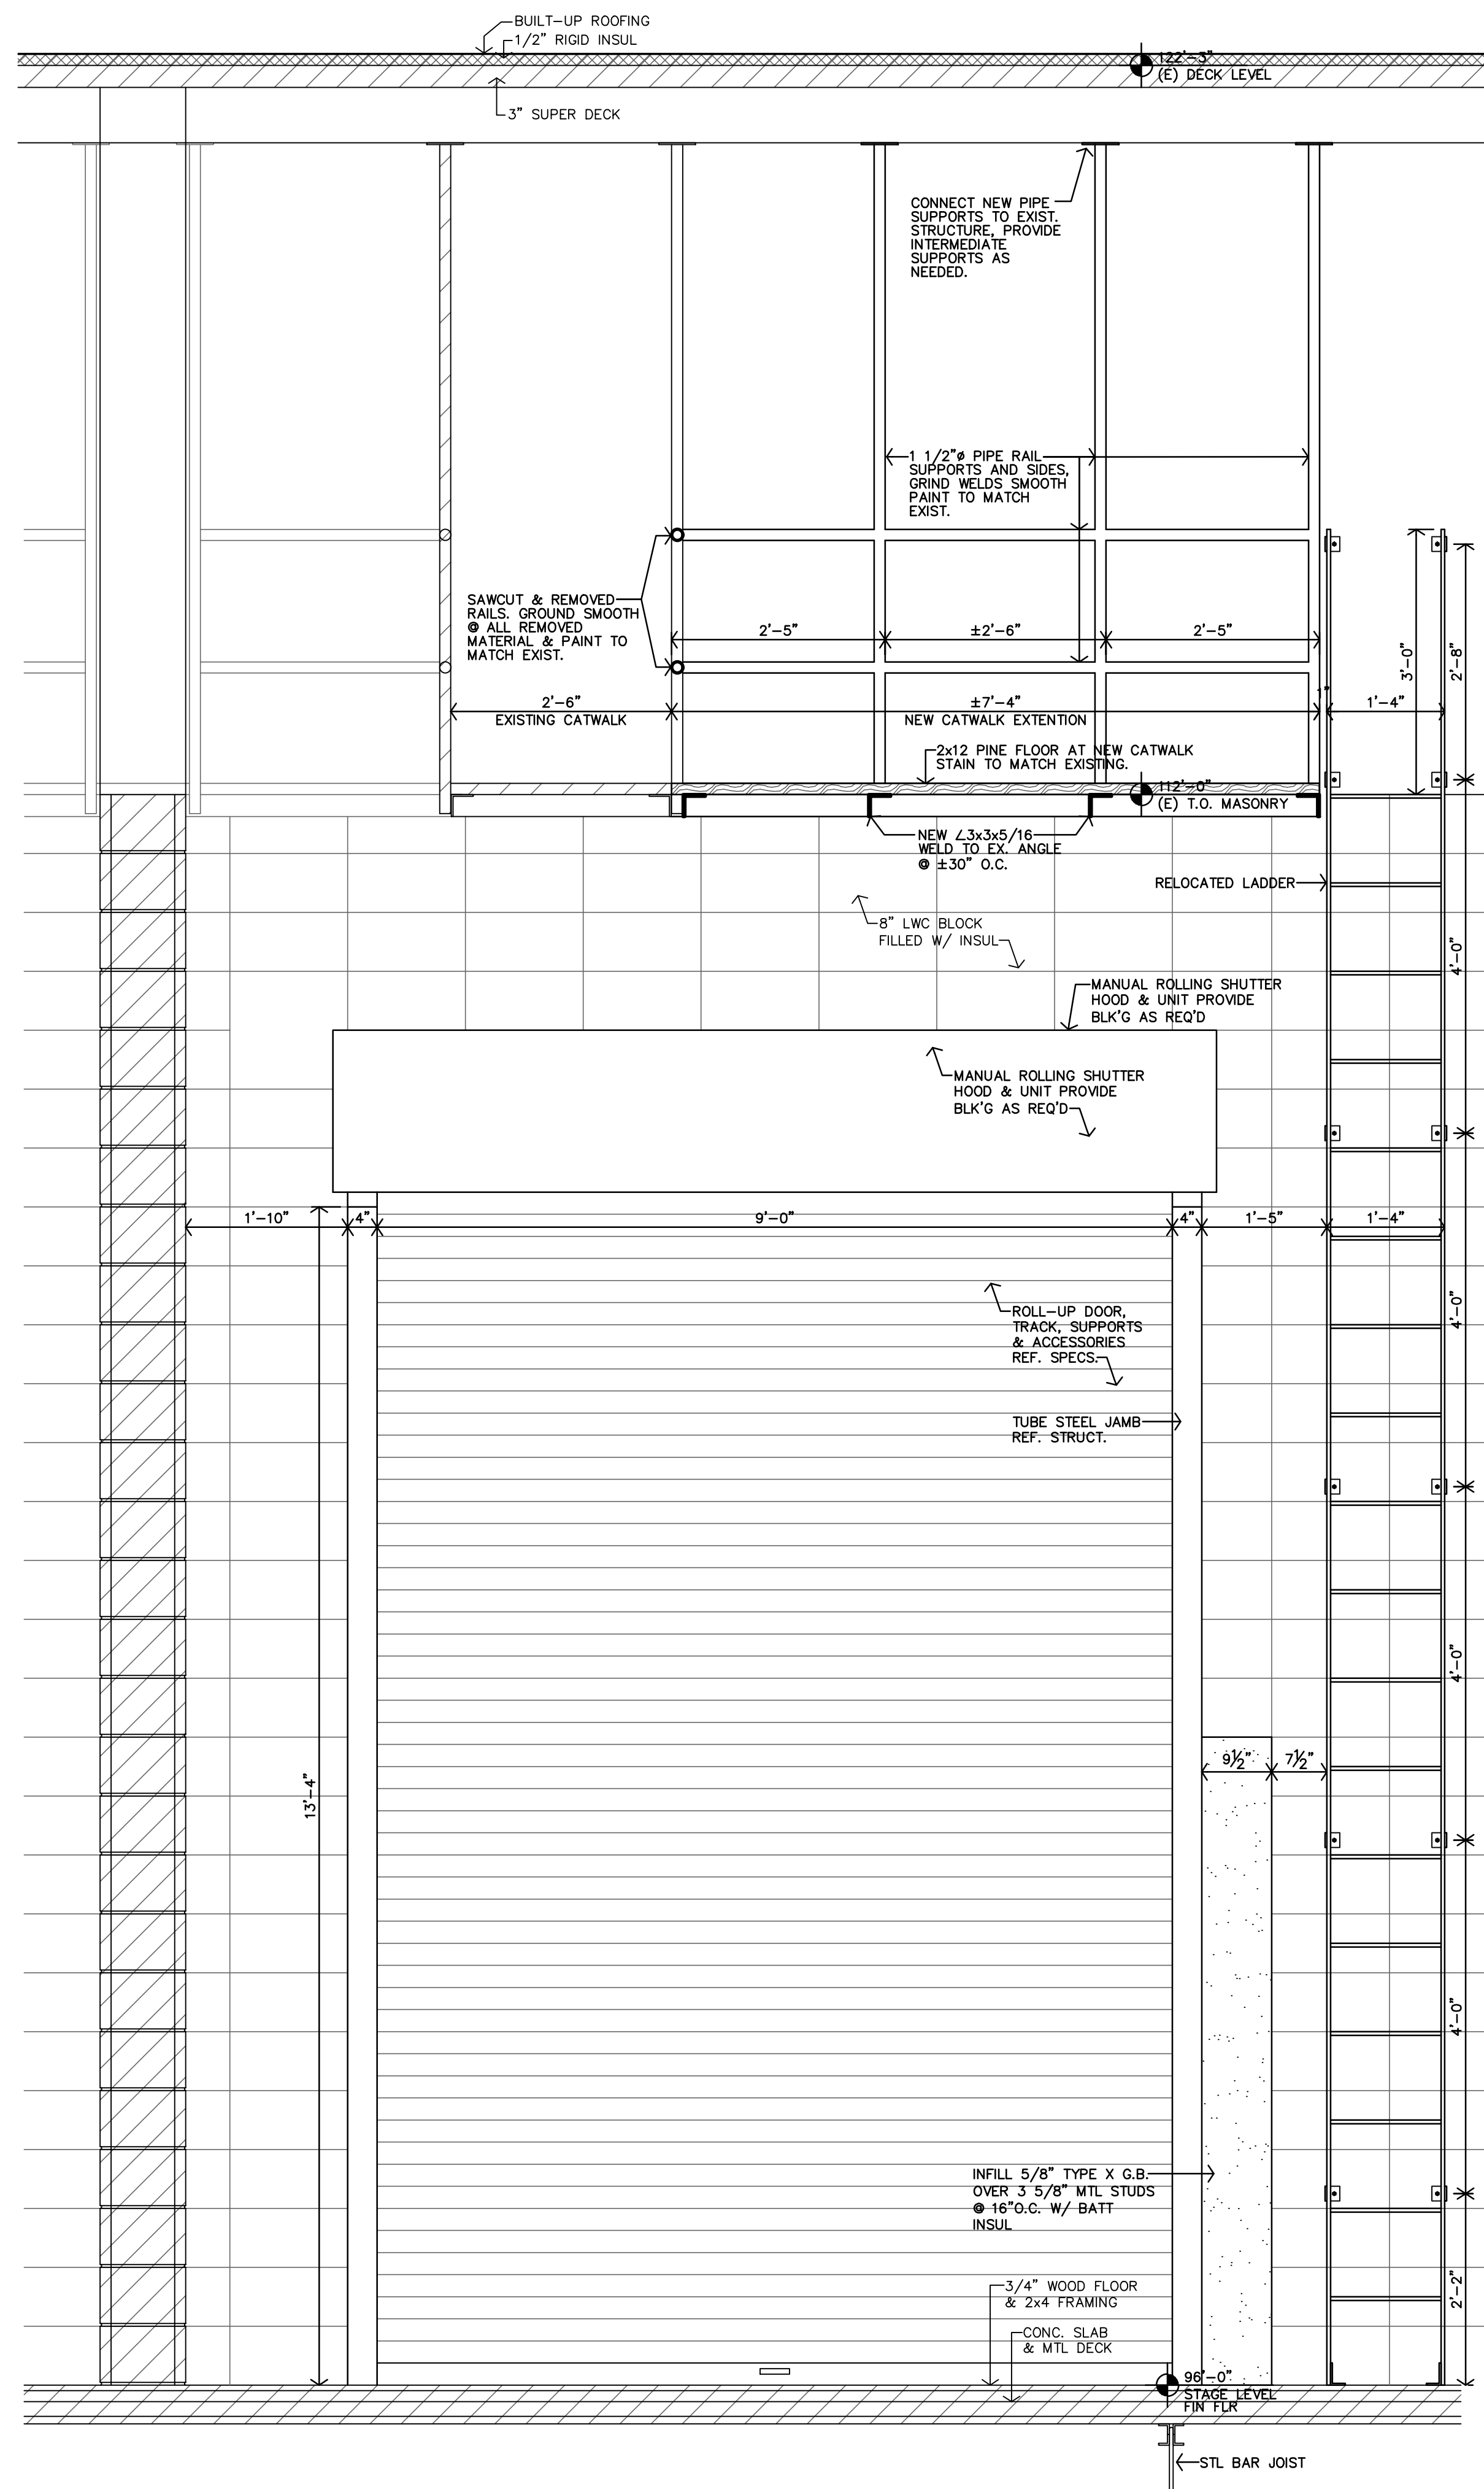

**B** WALL SECTION  
3/4"=1'-0"

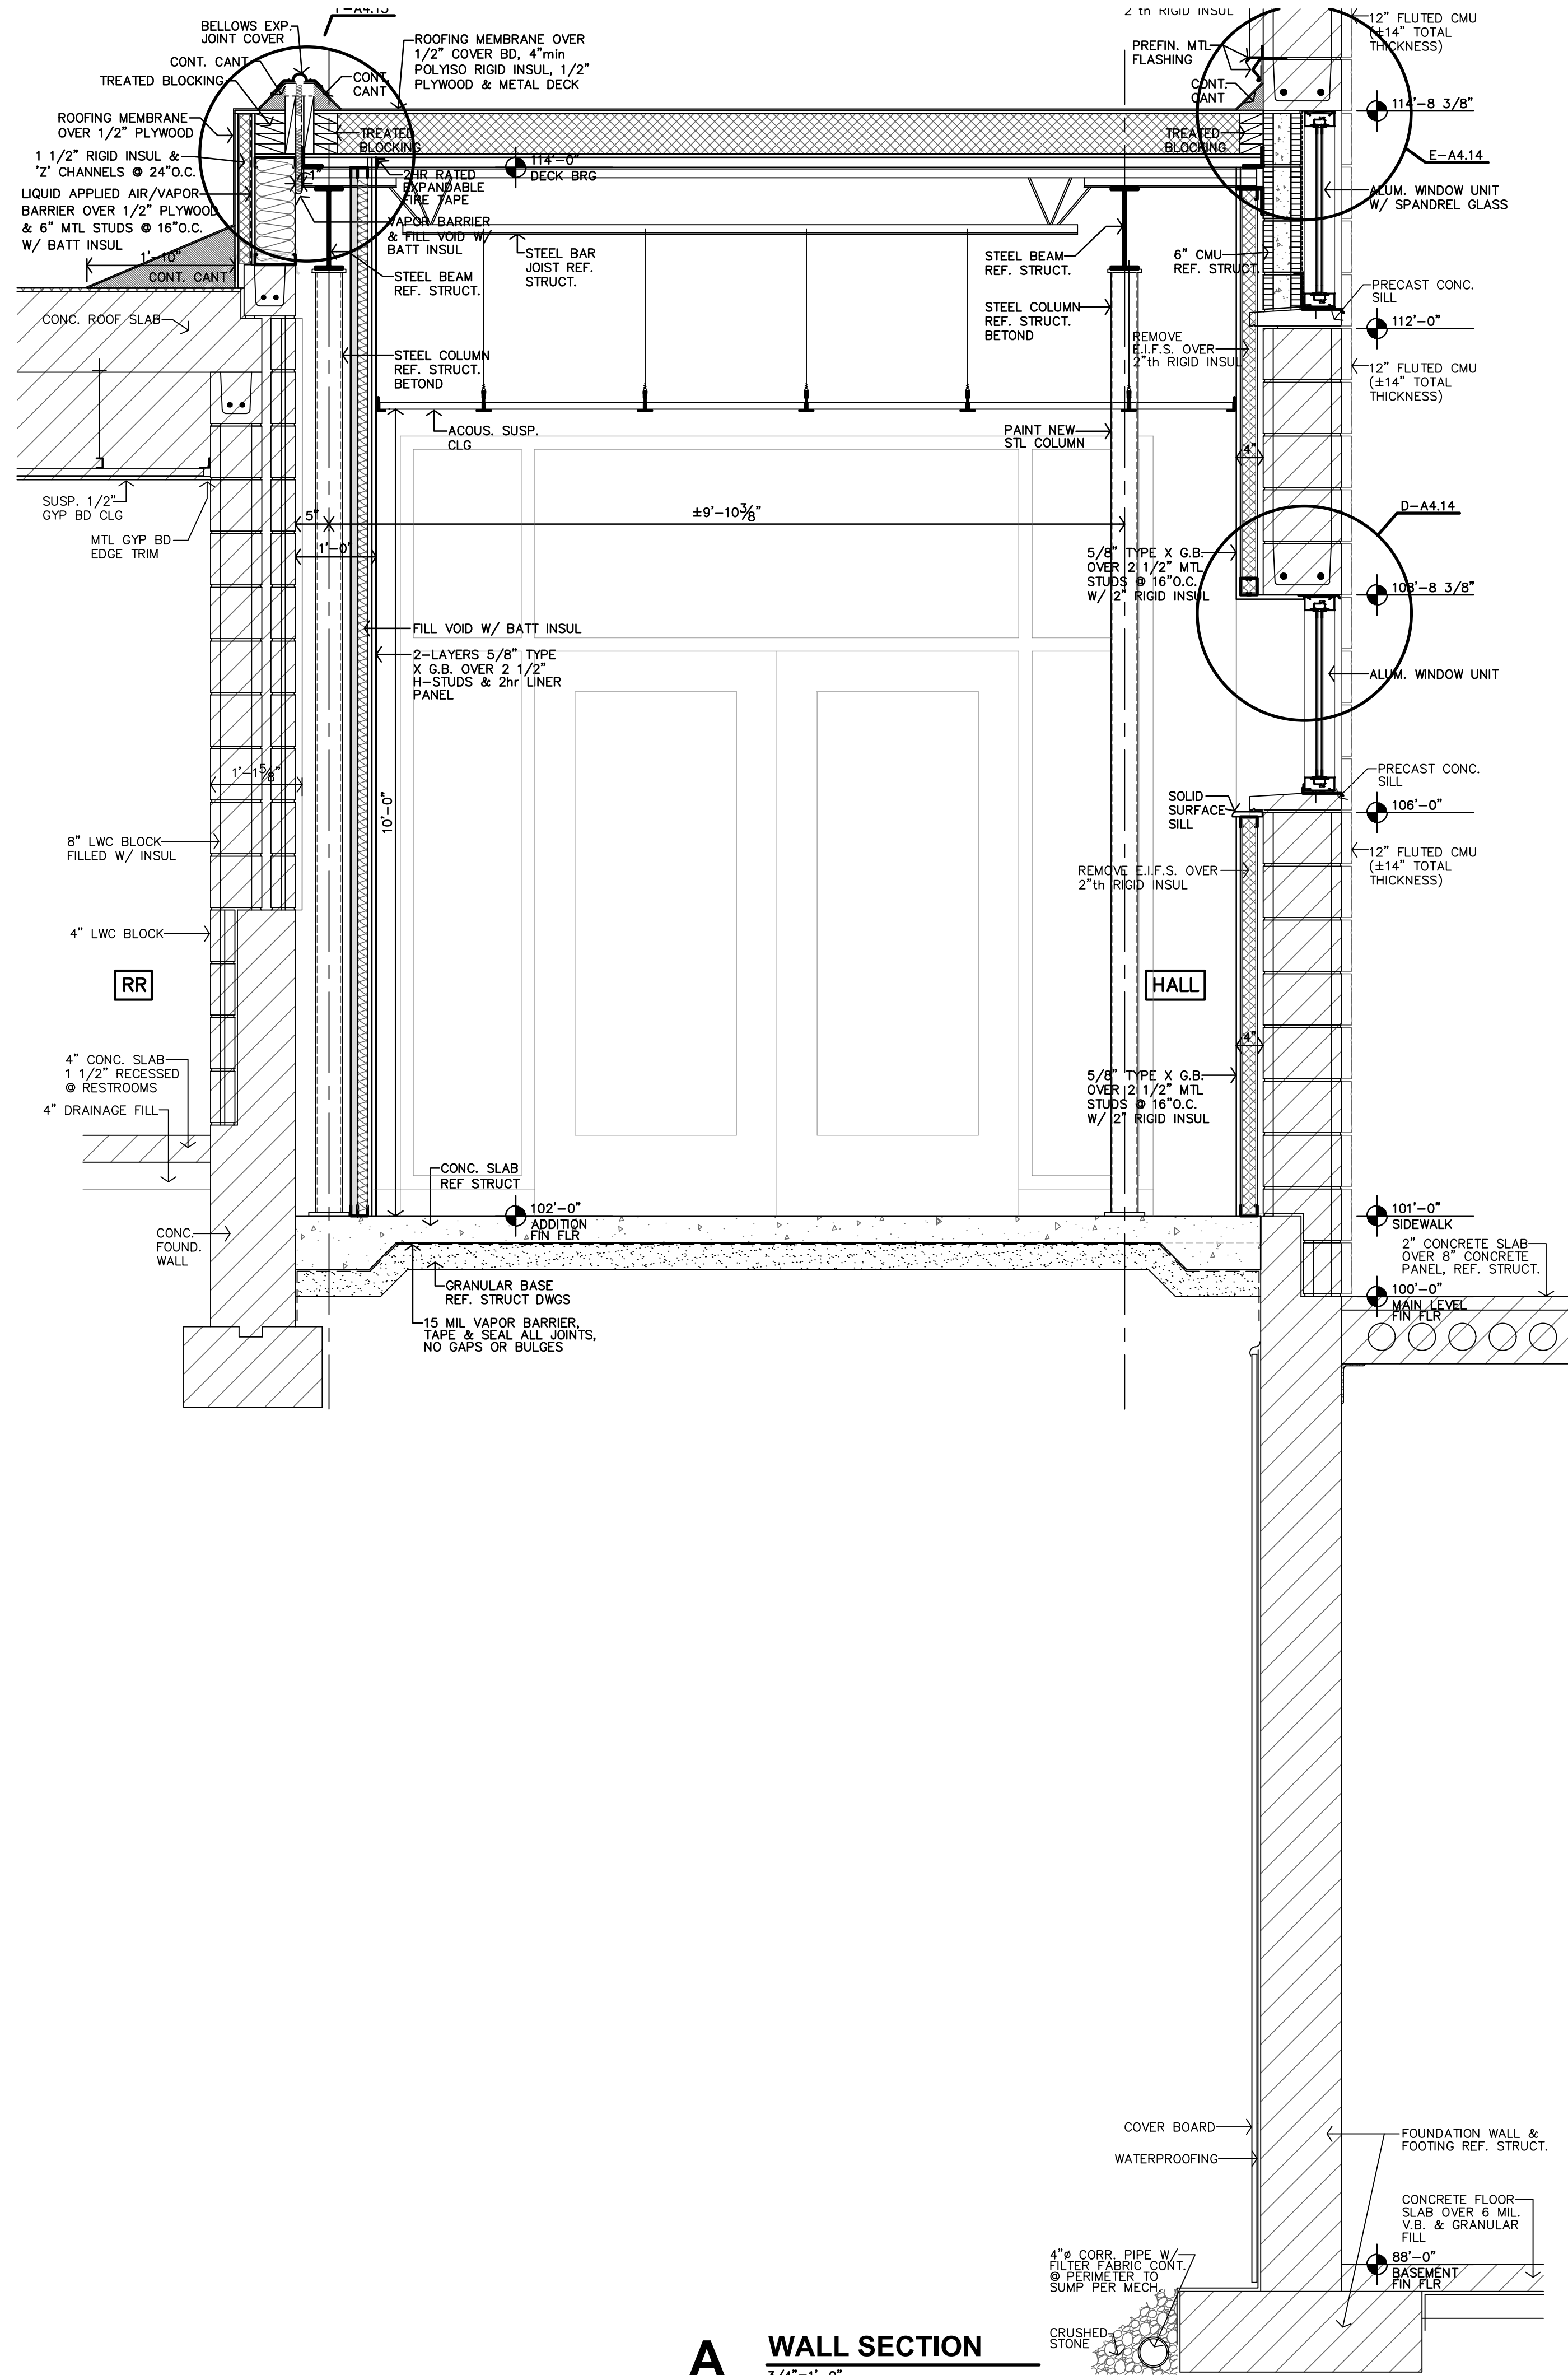


**A** WALL SECTION  
3/4"=1'-0"

**JonesGillamRenz**  
1881 Main Street, Suite 301  
Salina, KS 67401  
785.827.0386  
jgr@jgarchitects.com

**JGR**

**THEATRE SALINA**  
DANCE STUDIOS & SCENE SHOP EXPANSION  
SALINA, KANSAS

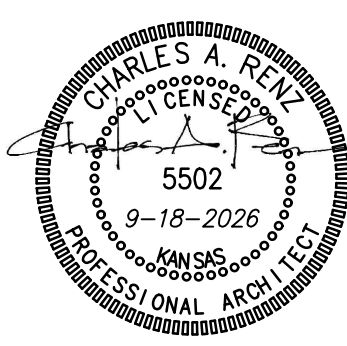


REVISION:	
DATE:	9-18-2026
JOB:	22-3239
SHEET NO.:	

**A4.11**


COPYRIGHTED ©








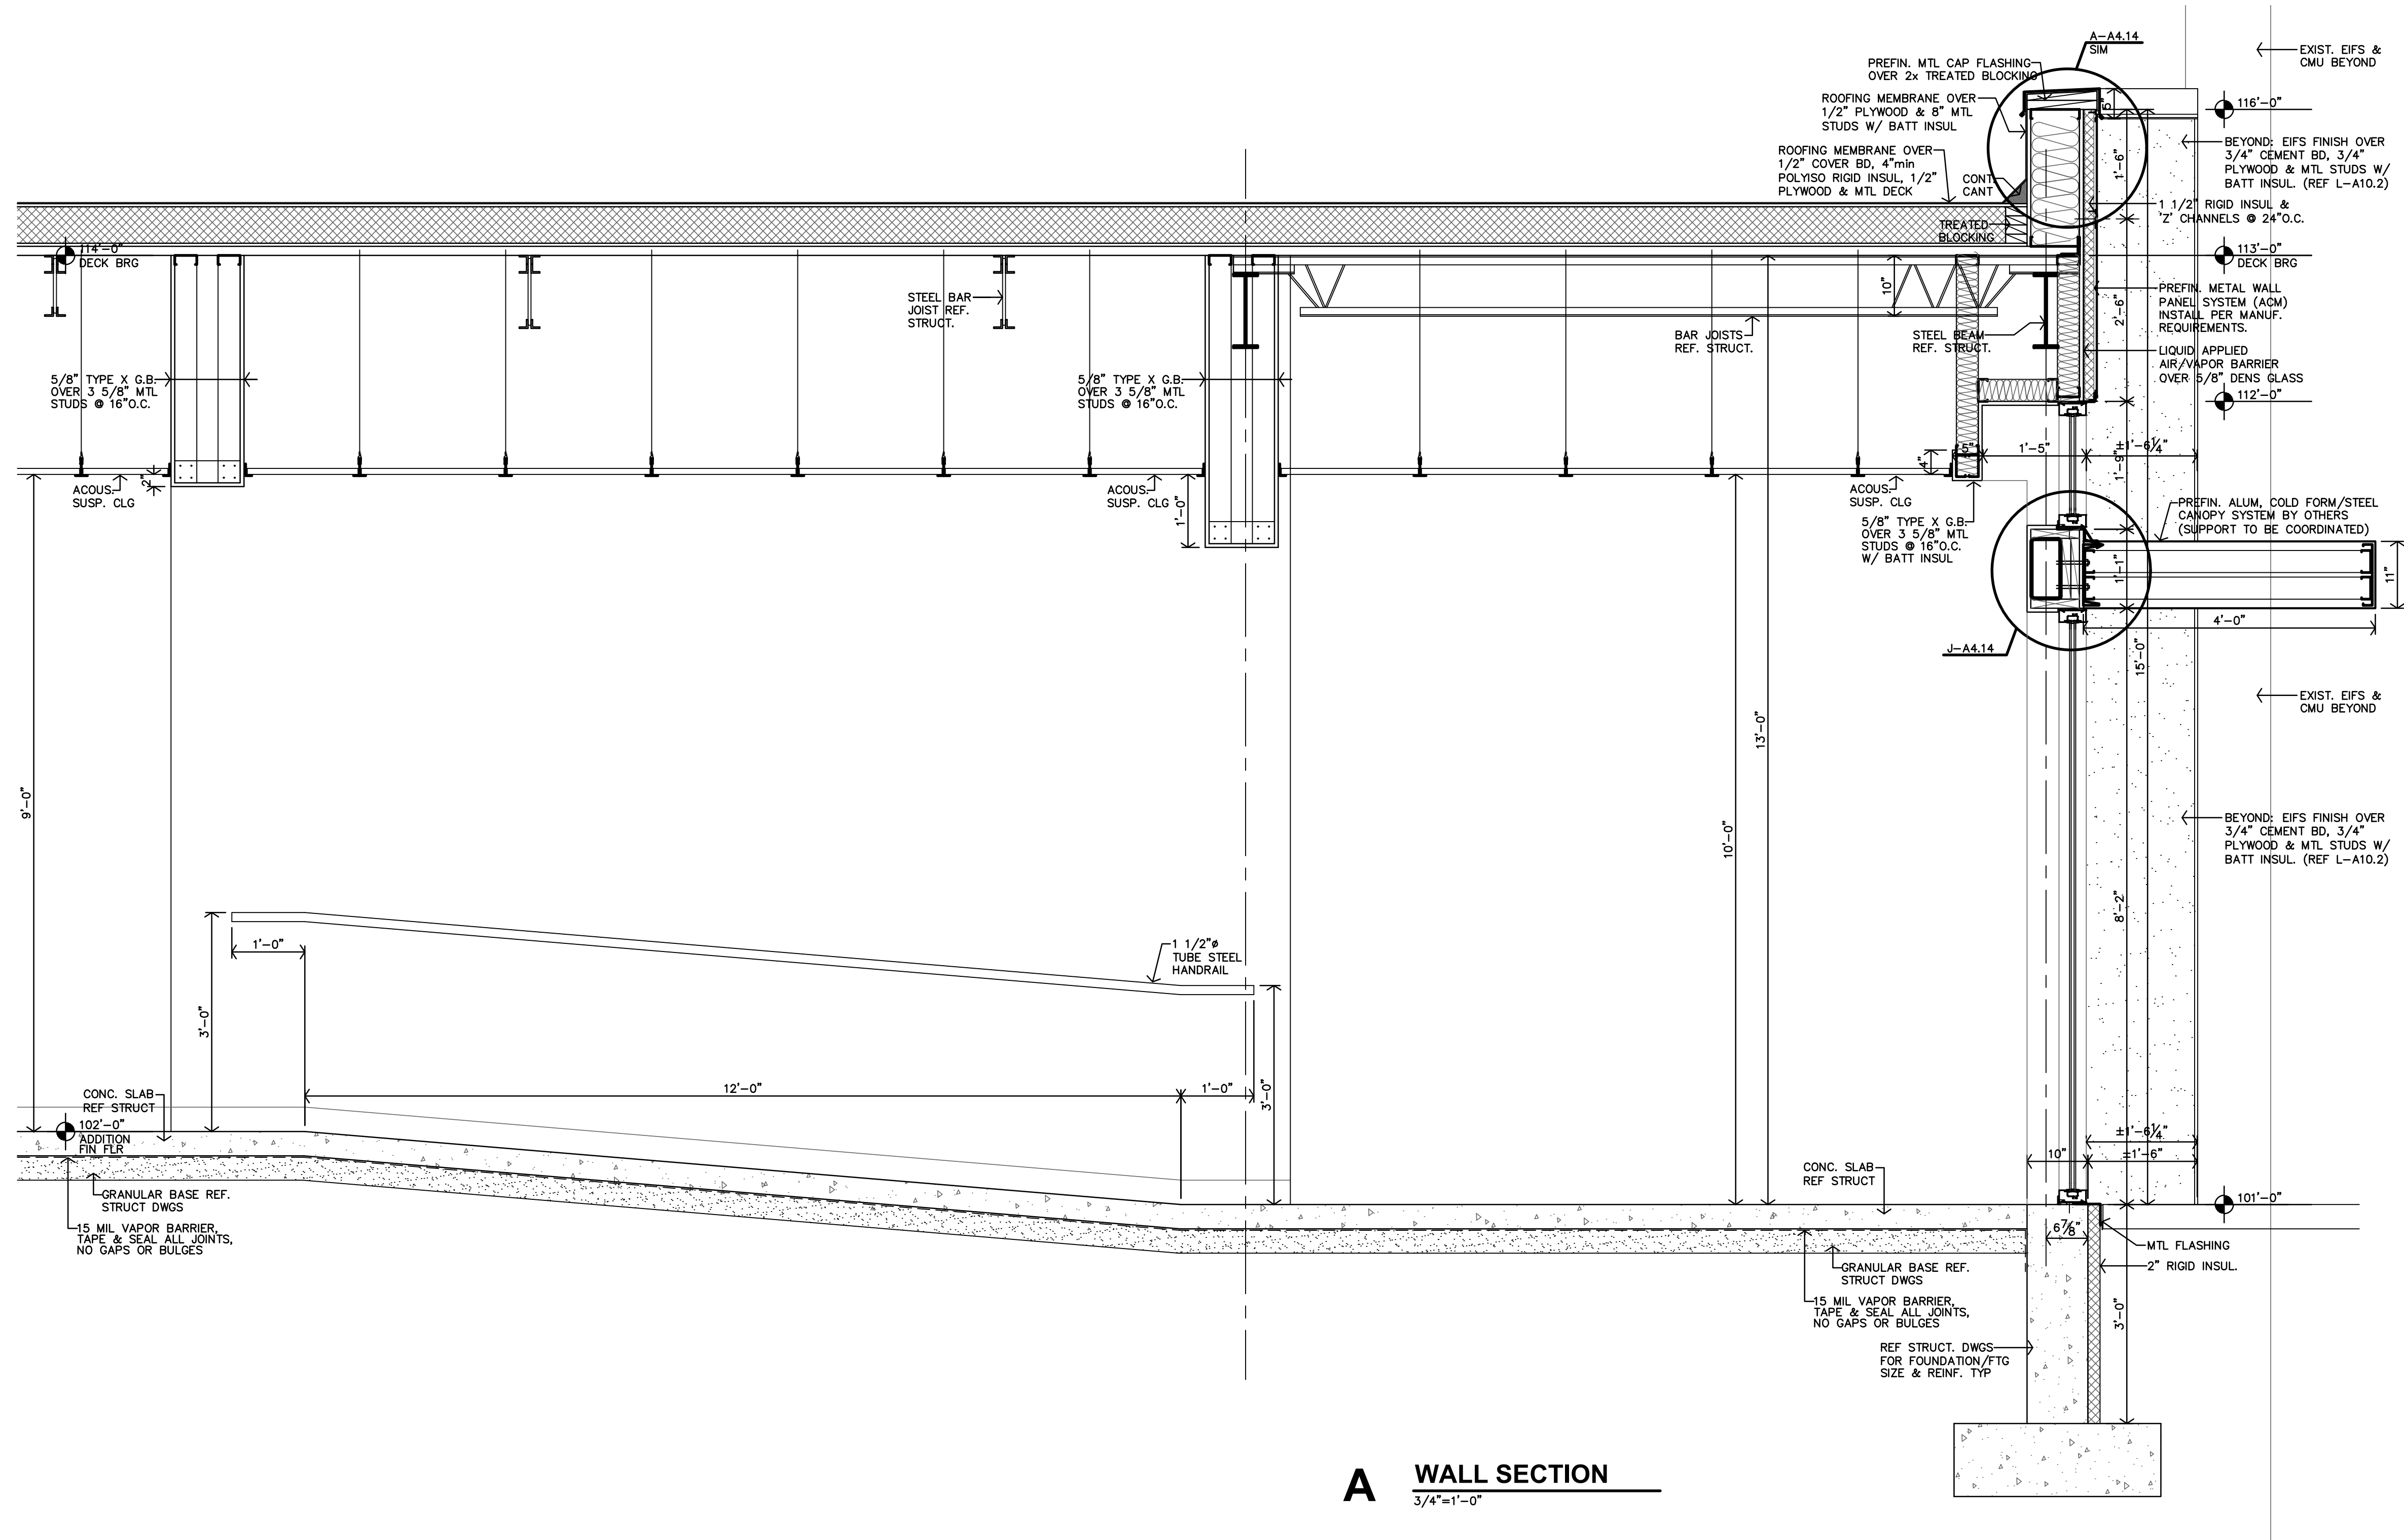


**A** WALL SECTION  
3/4"=1'-0"





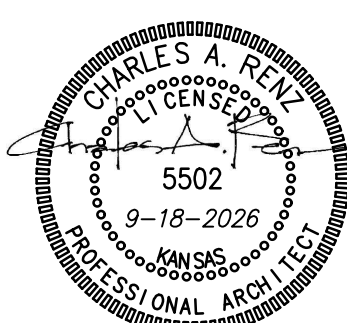




REVISION:	
DATE:	9-18-2026
JOB:	22-3239
SHEET NO.:	

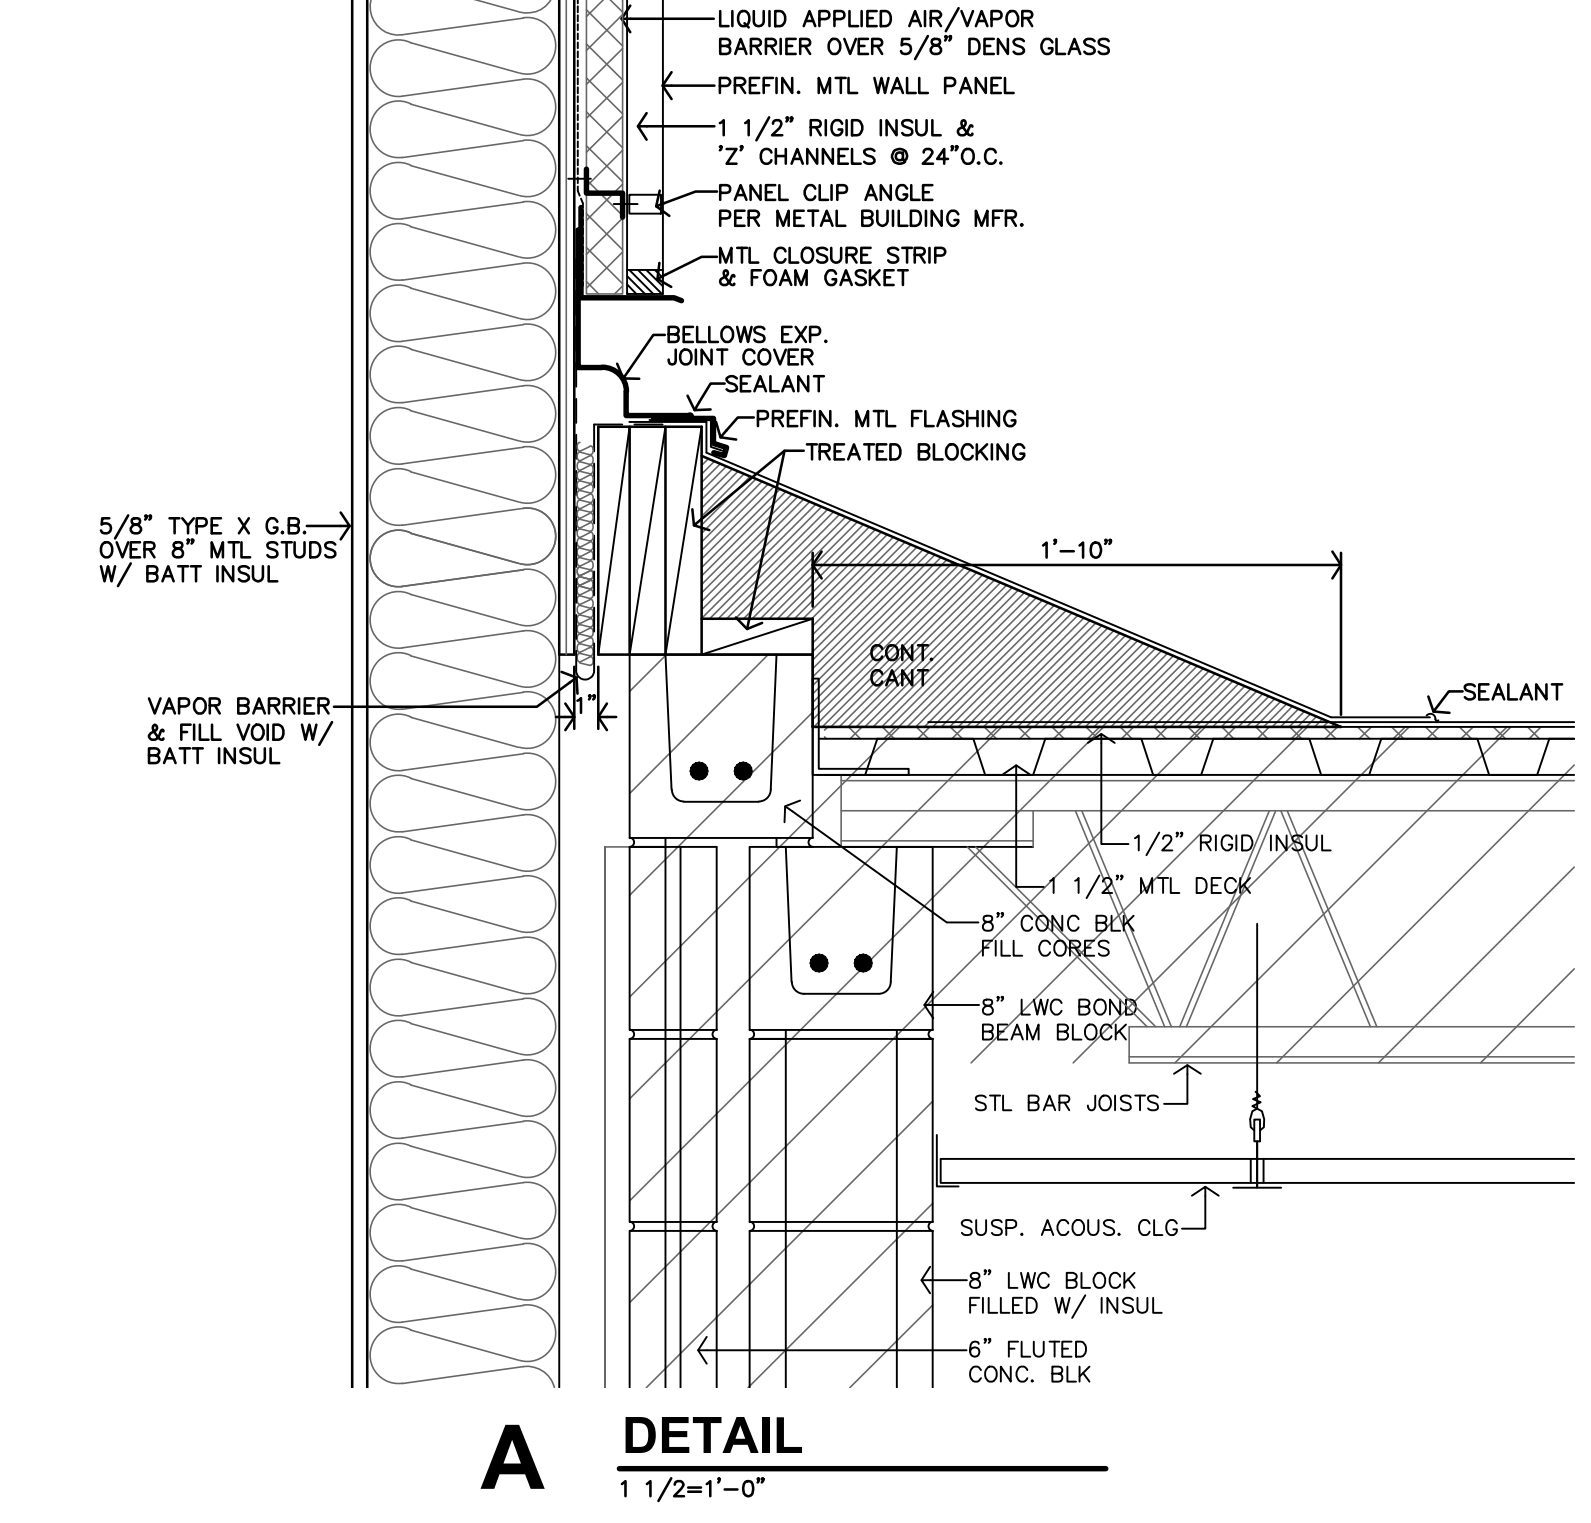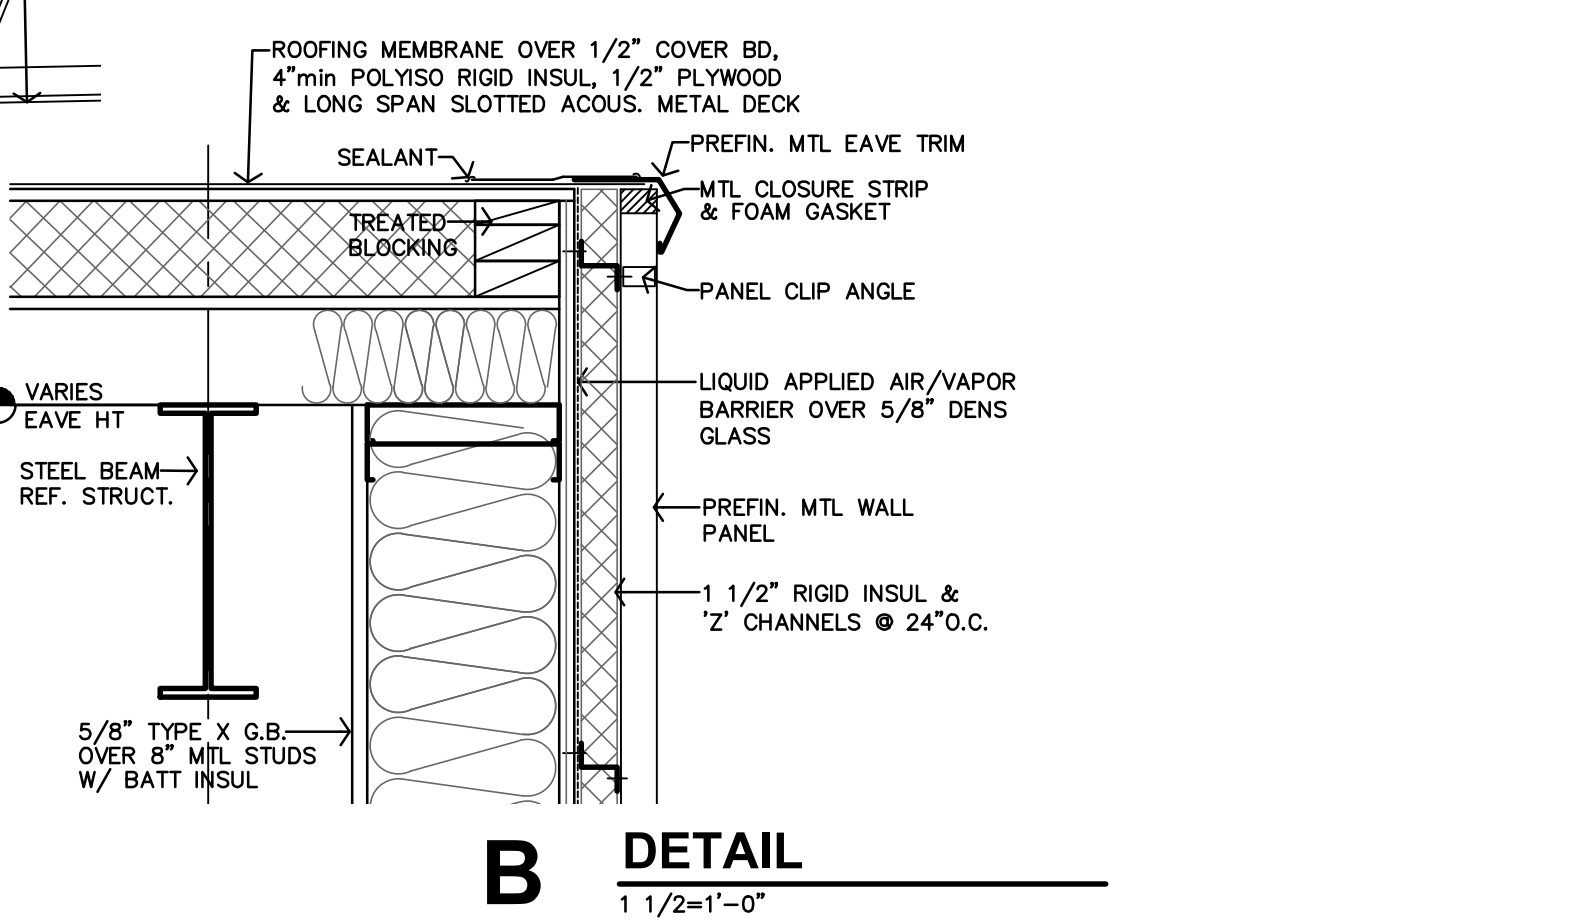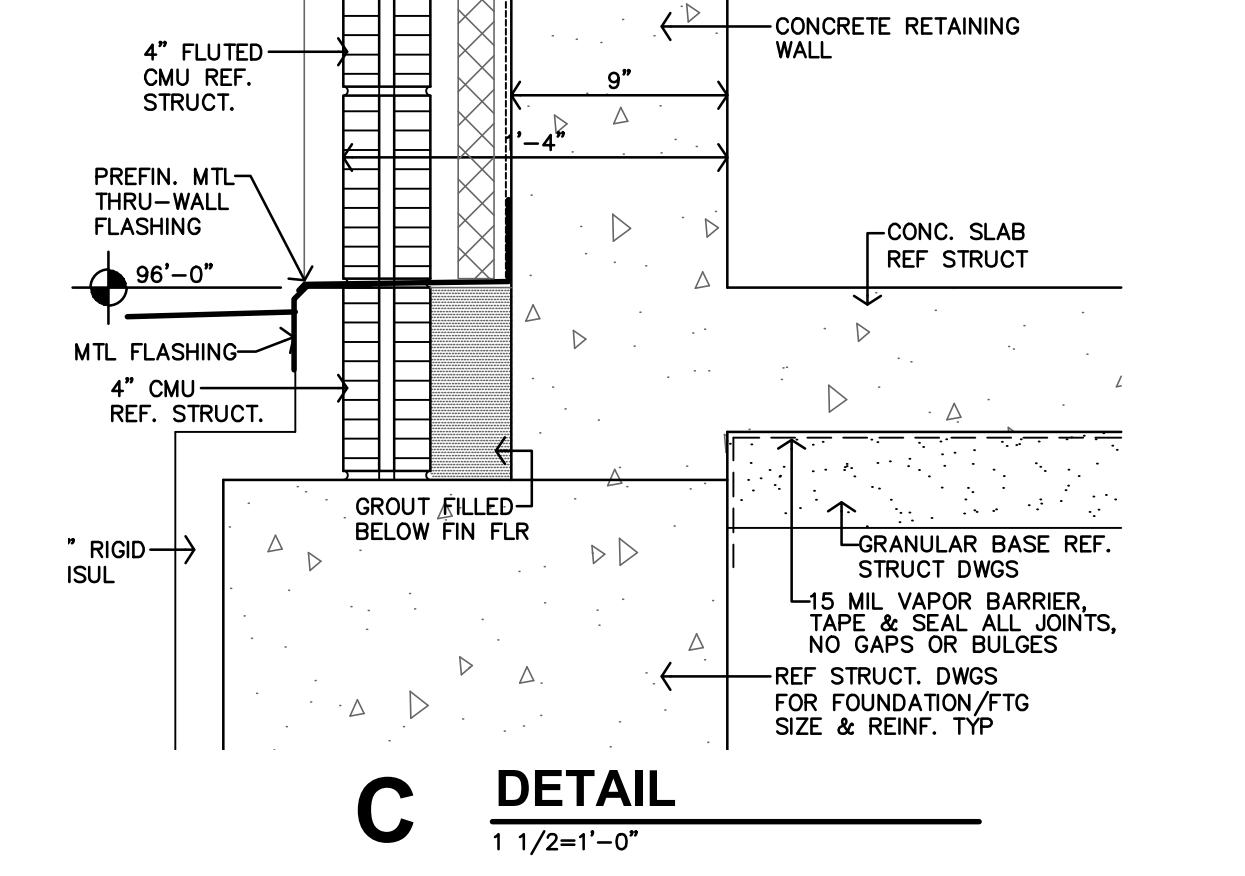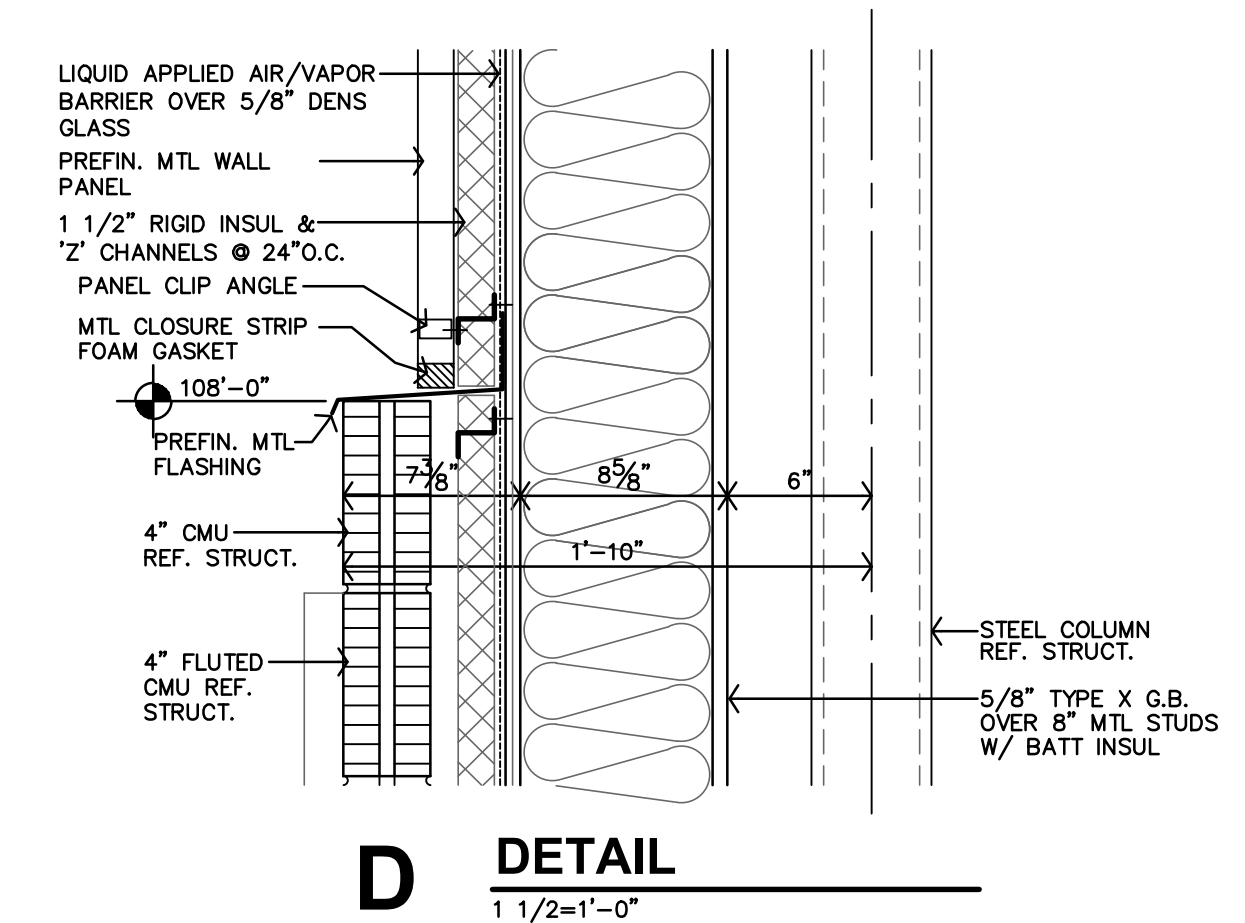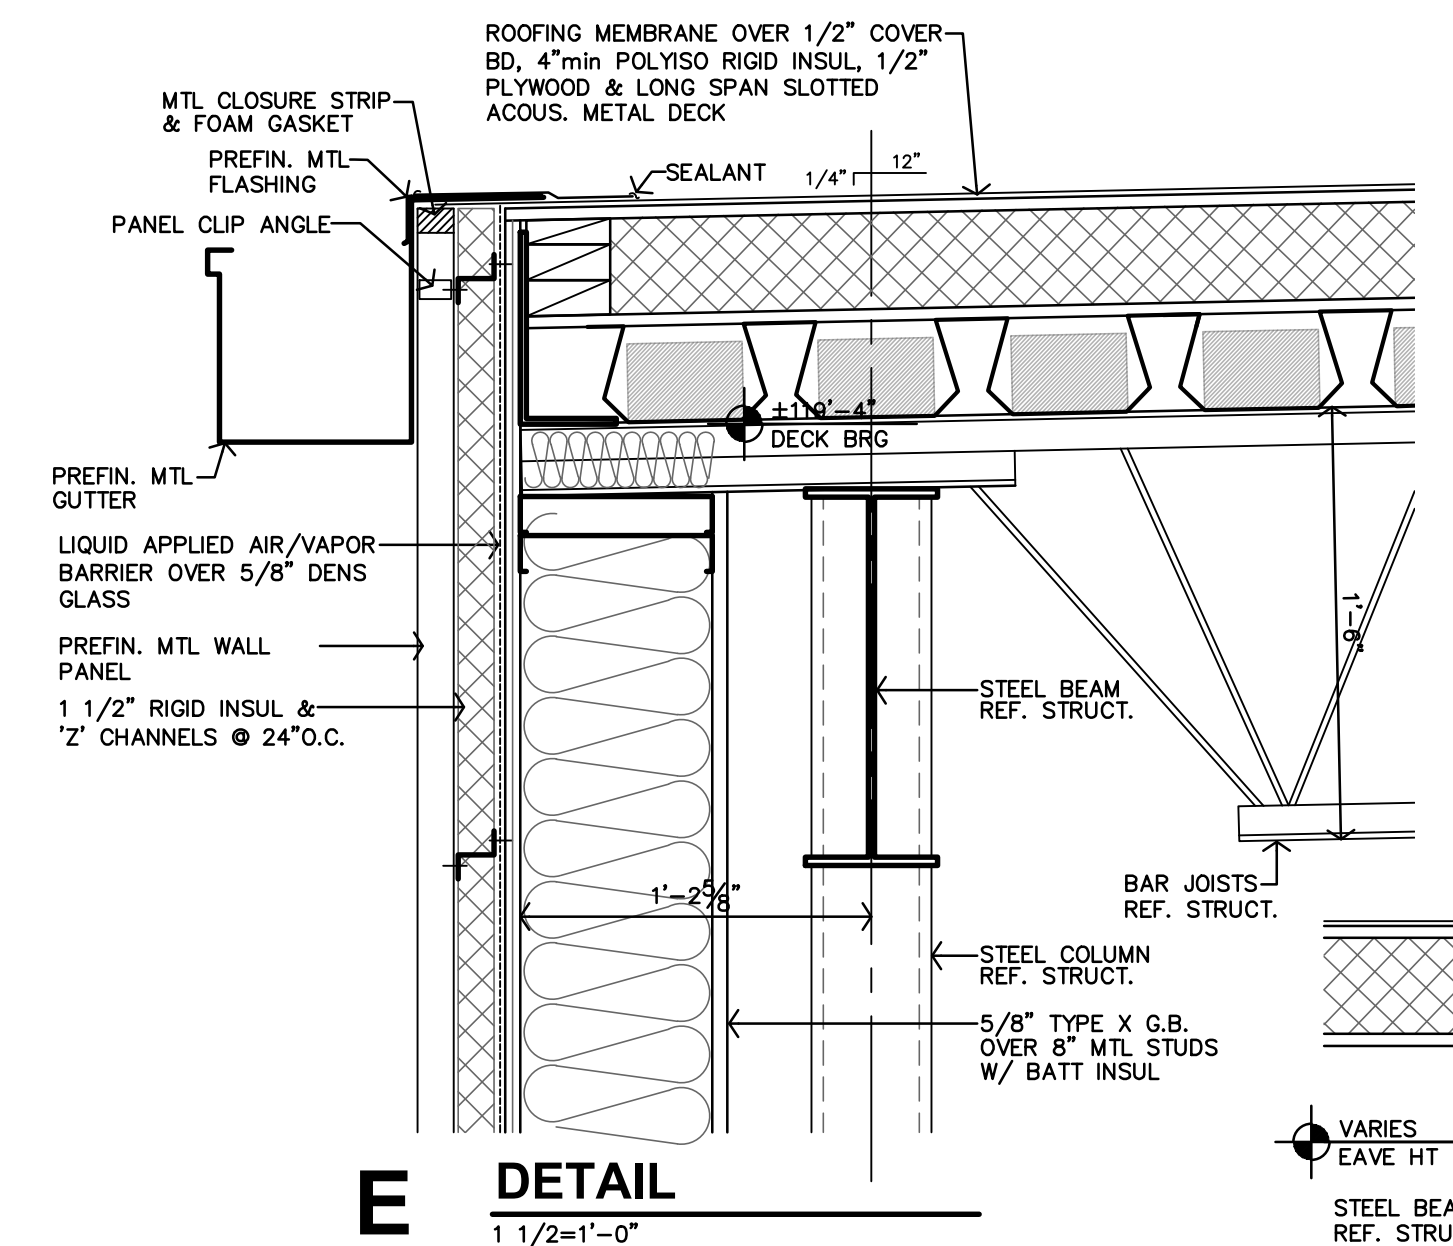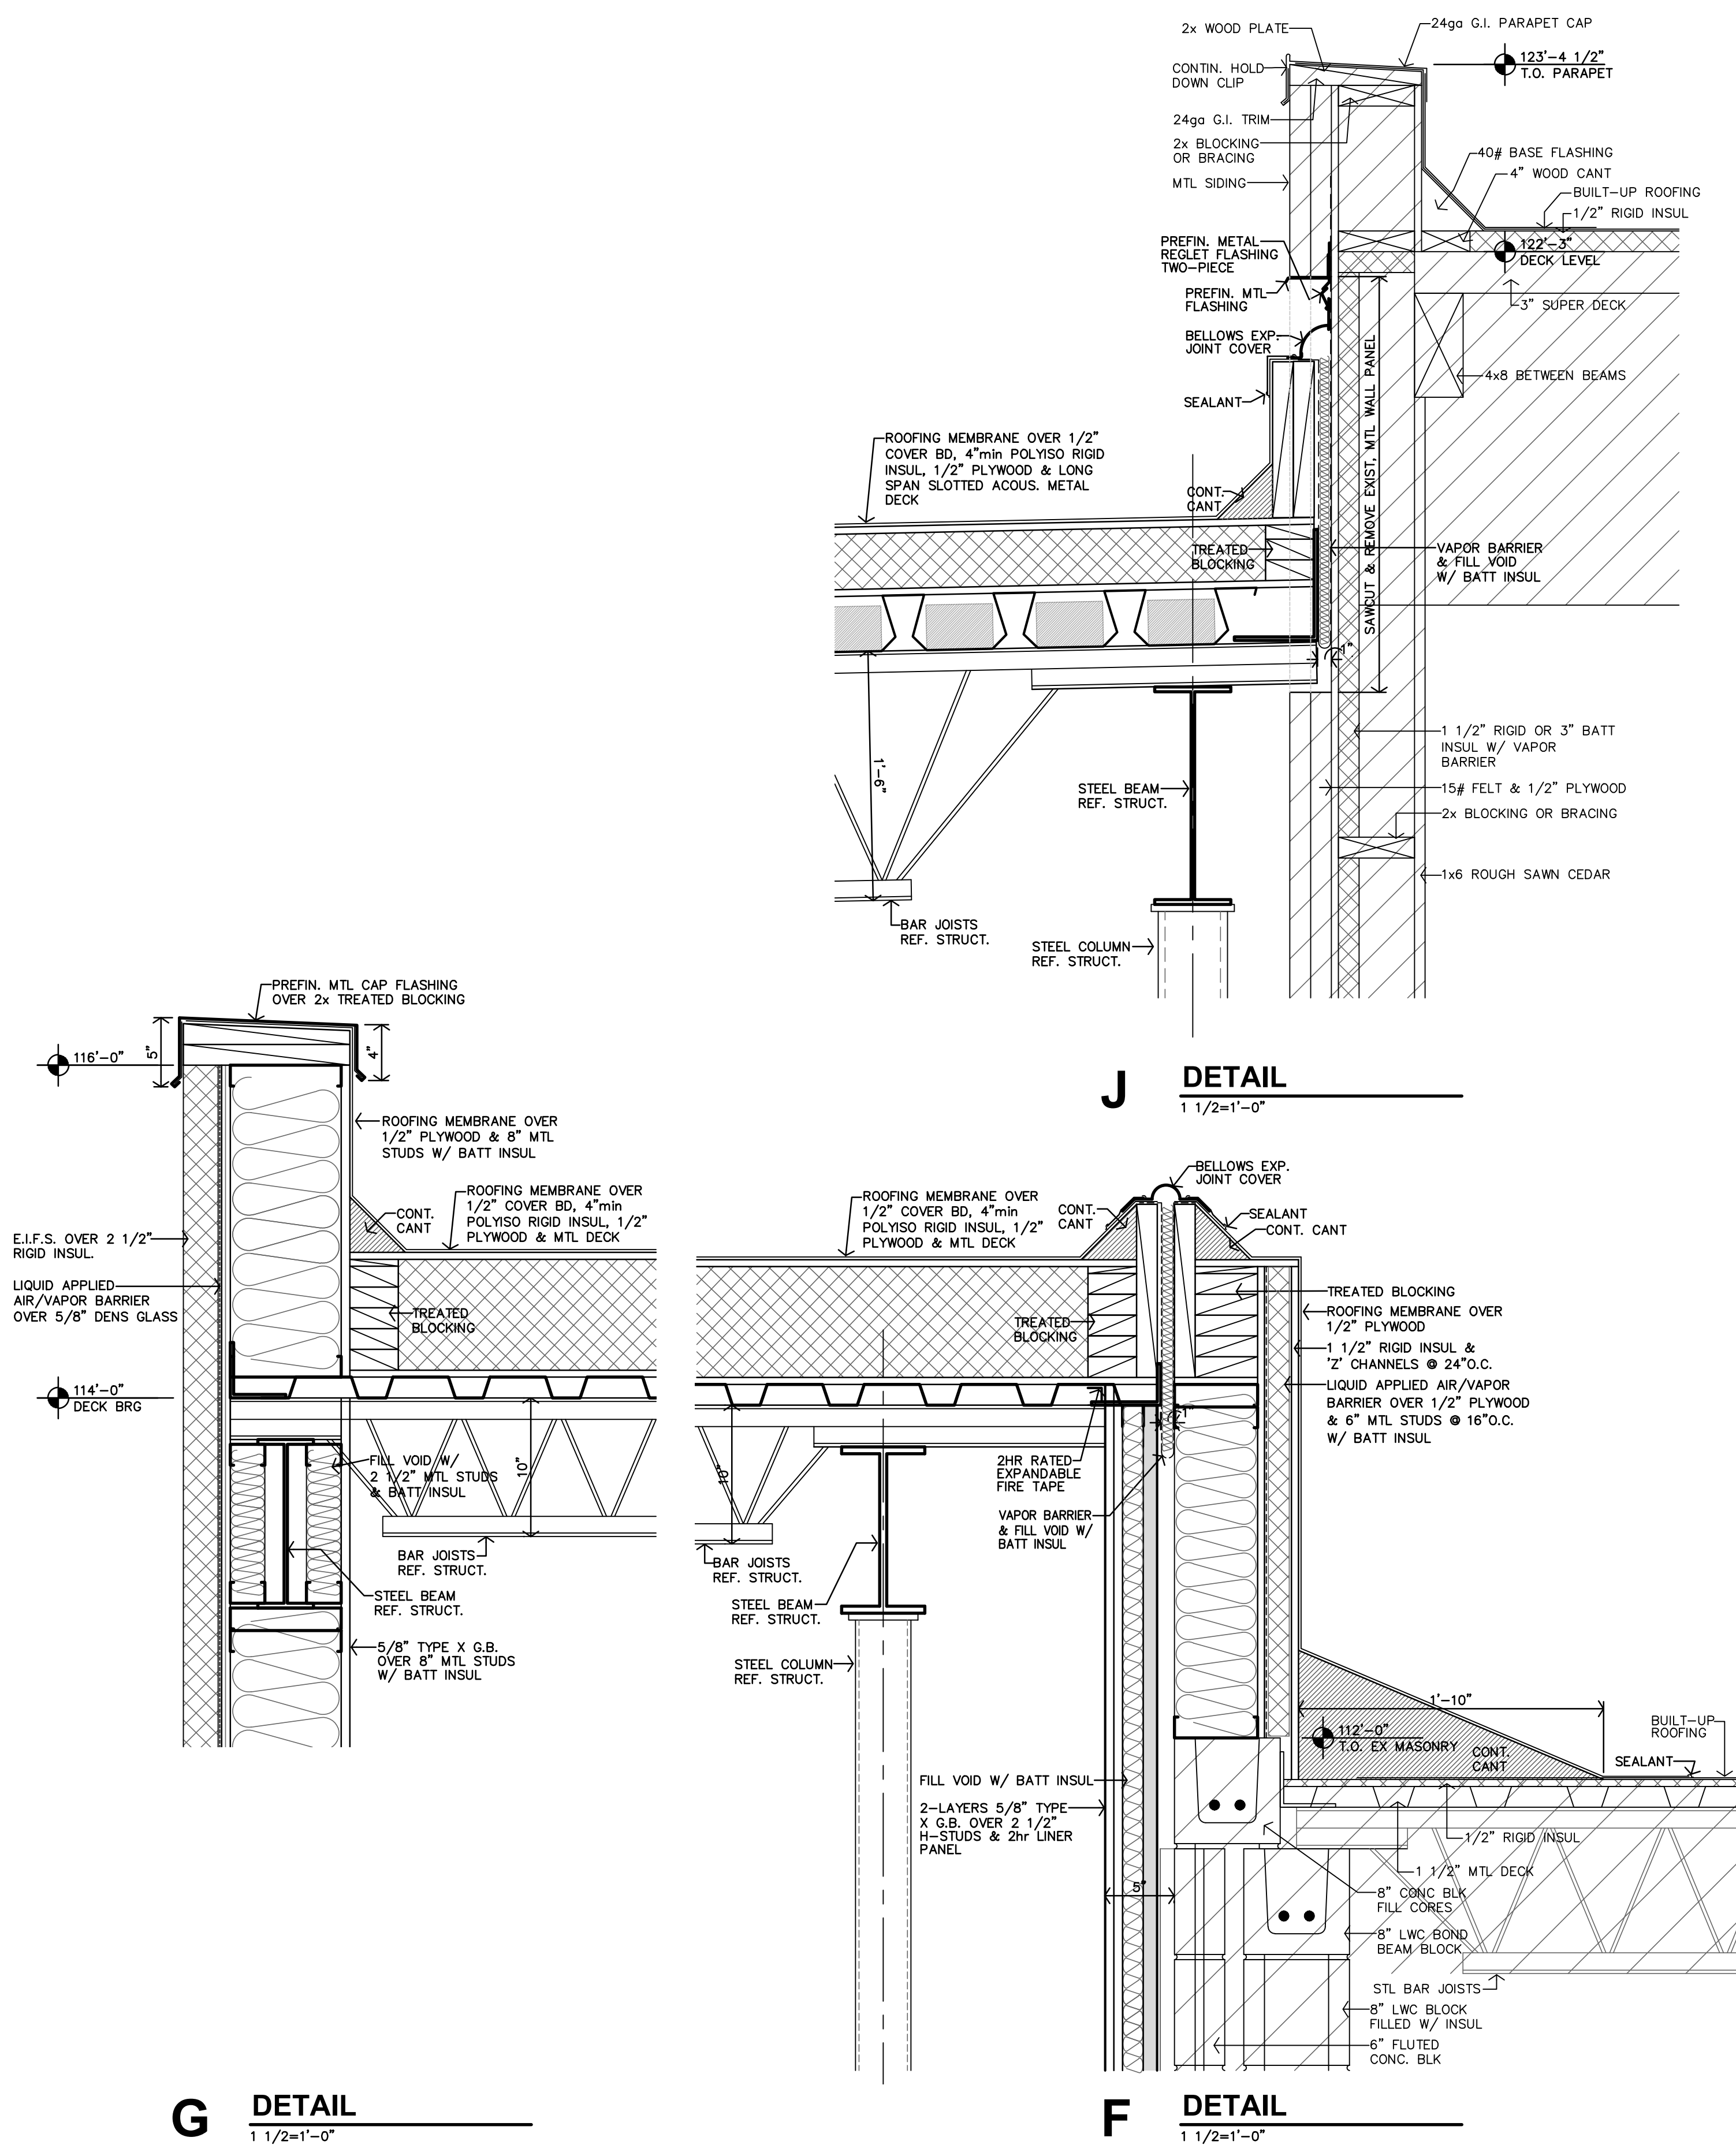




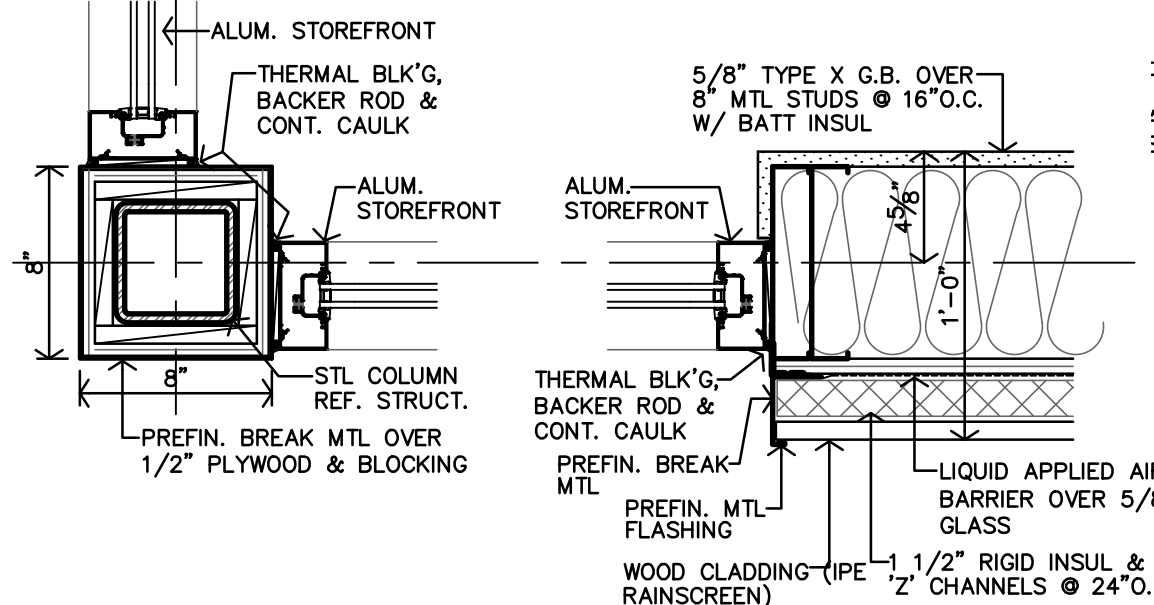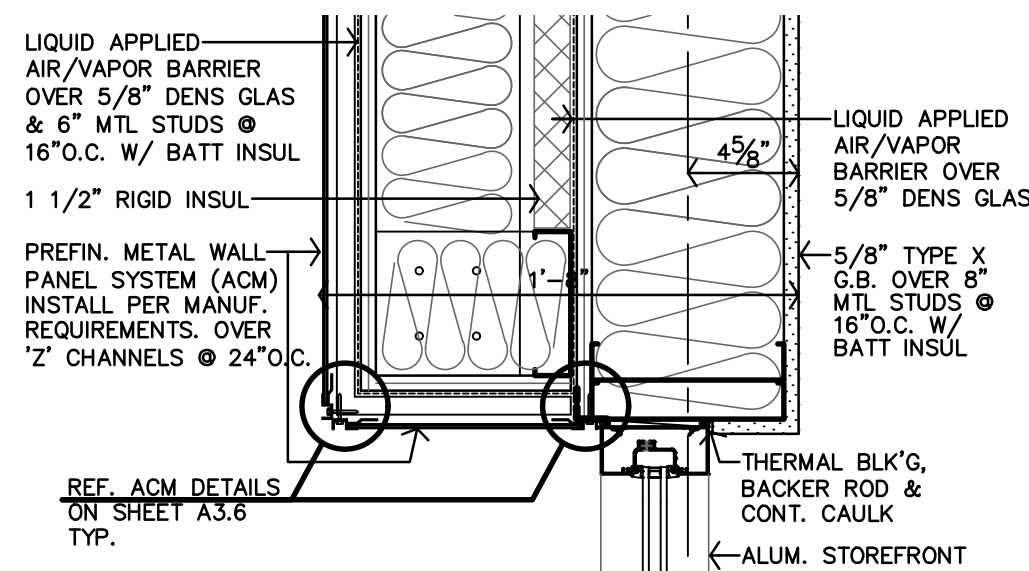




**K STOREFRONT DETAILS**  
1 1/2"=1'-0"

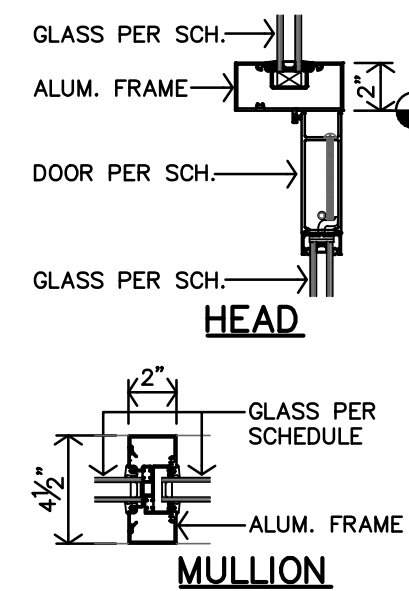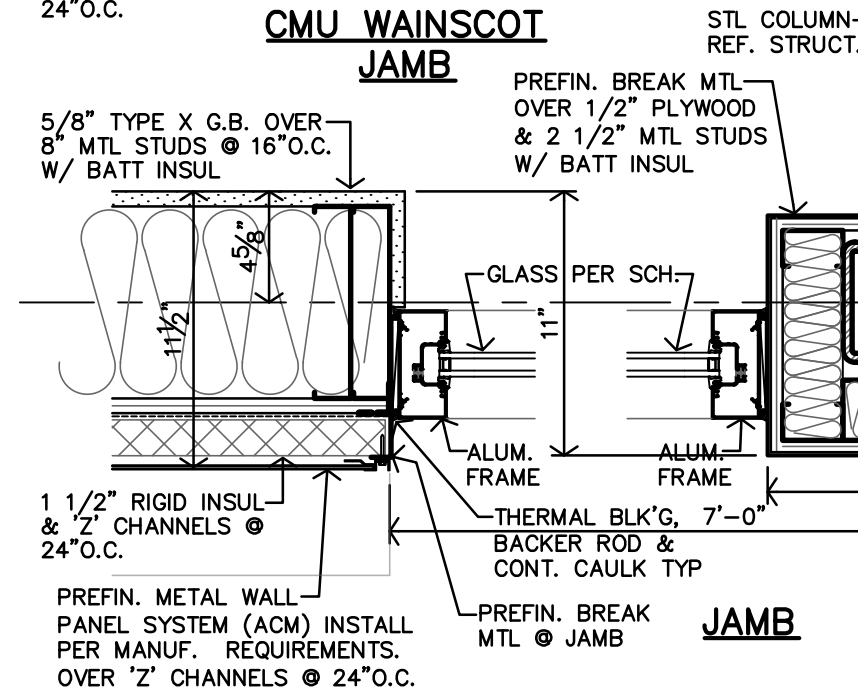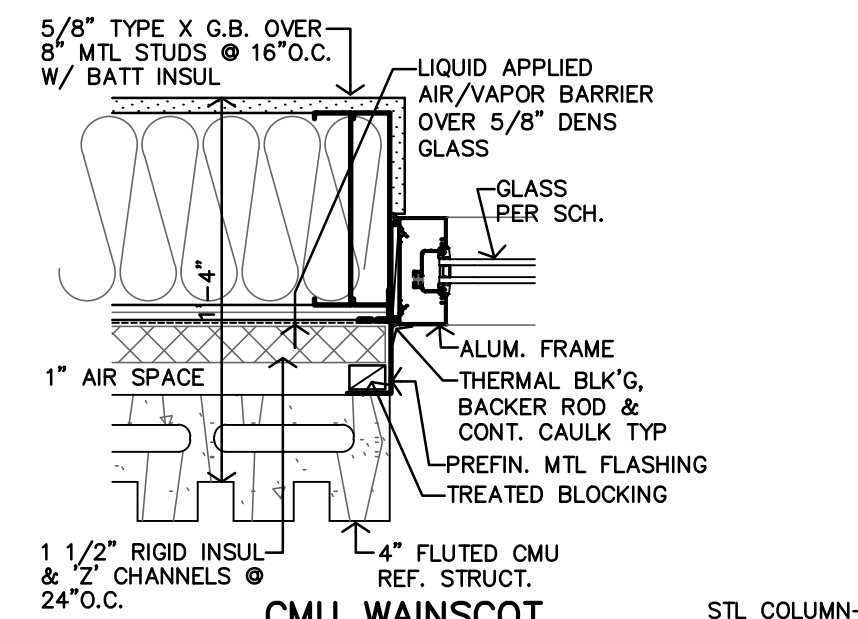


**H STOREFRONT DETAILS**  
1 1/2"=1'-0"

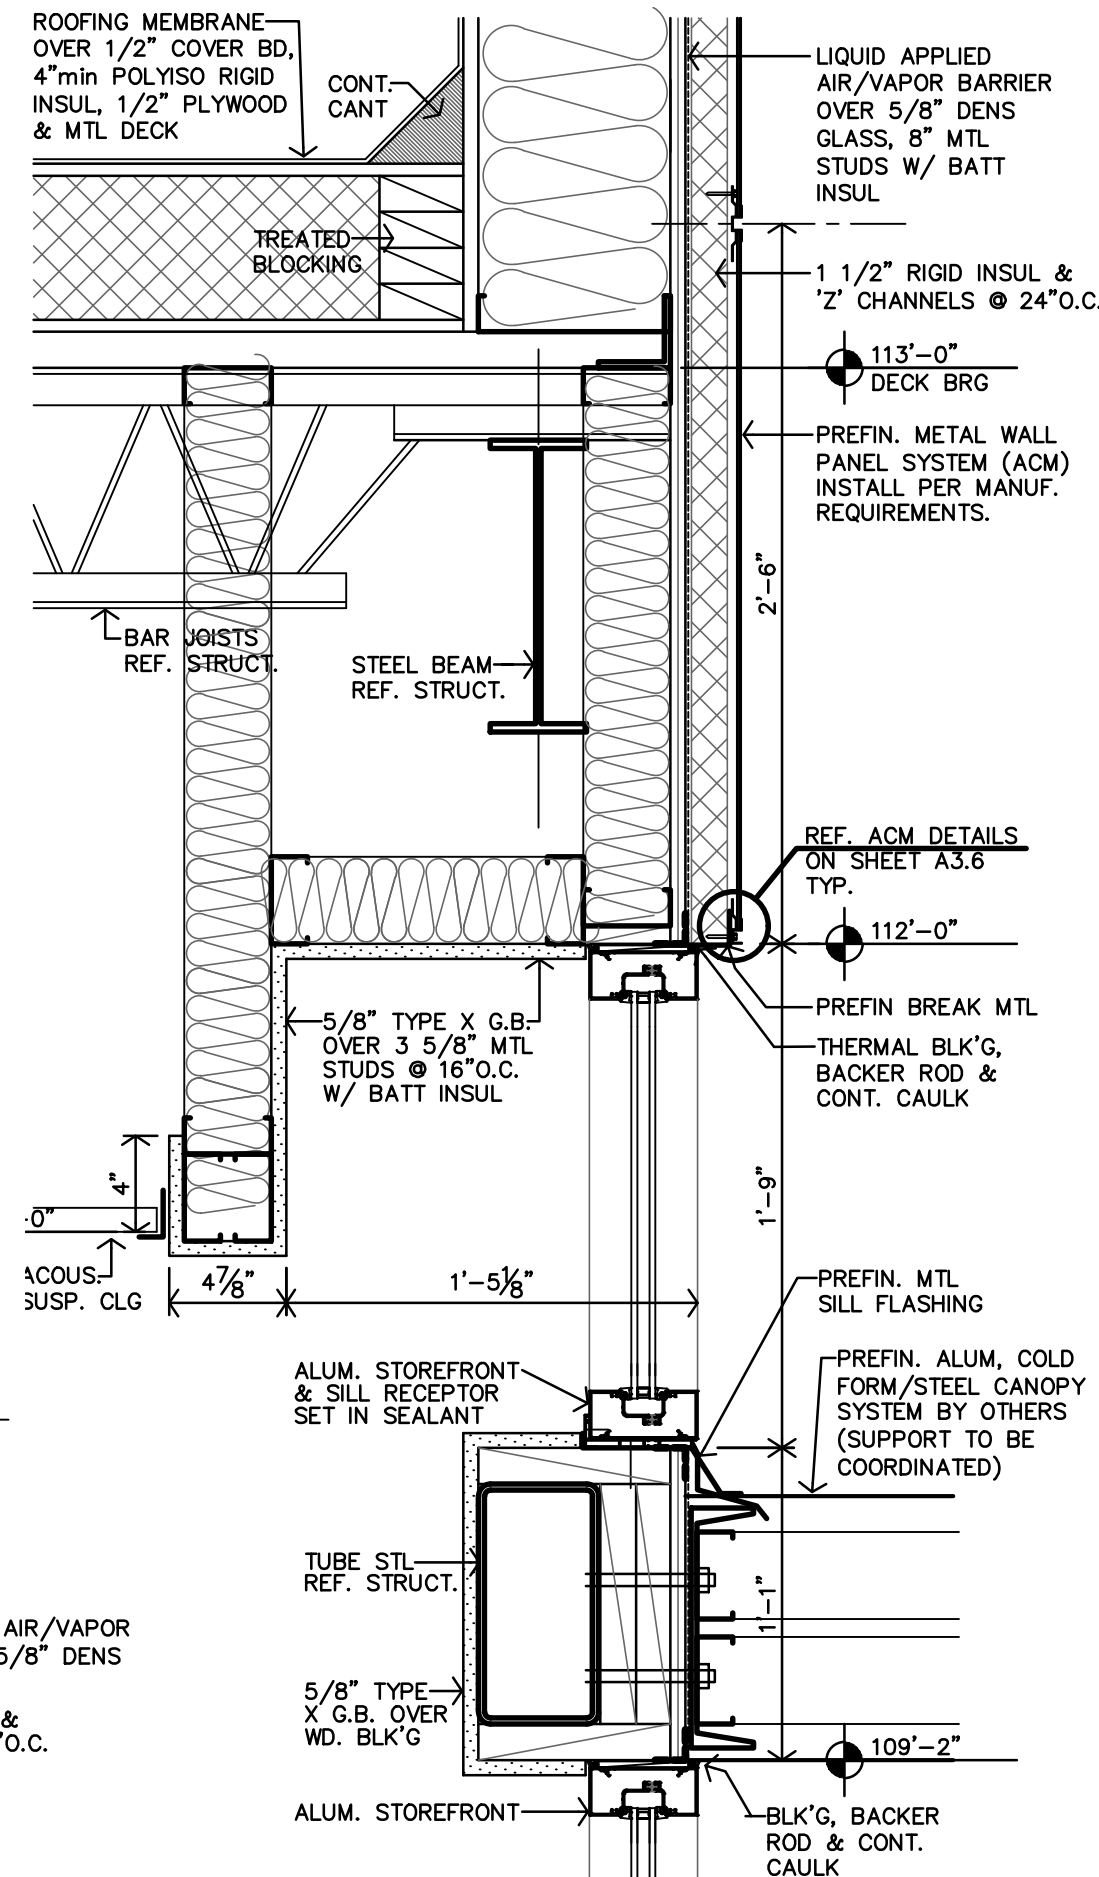


**J WINDOW DETAILS**  
1 1/2"=1'-0"

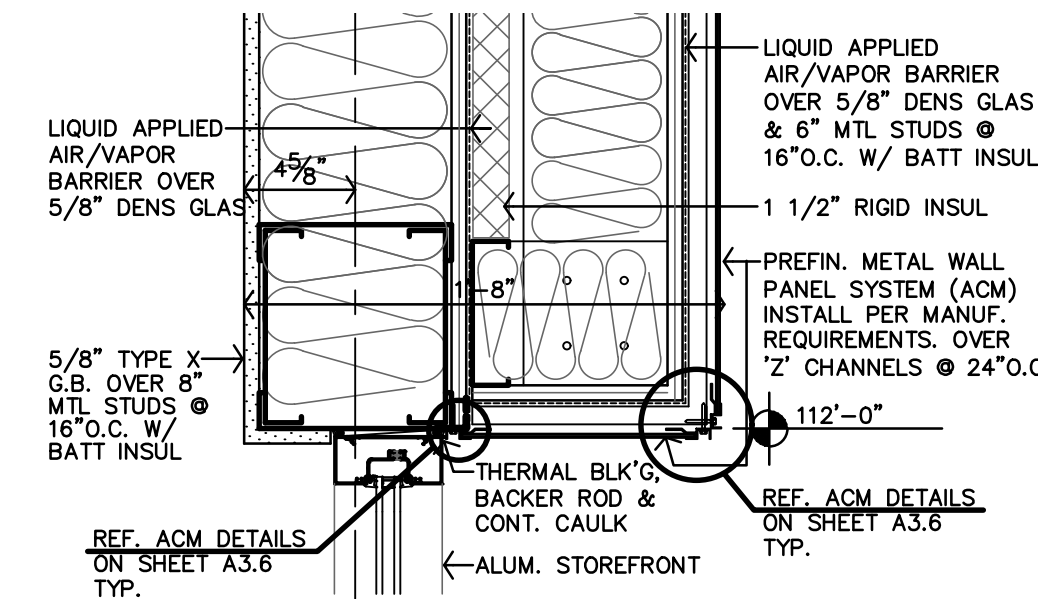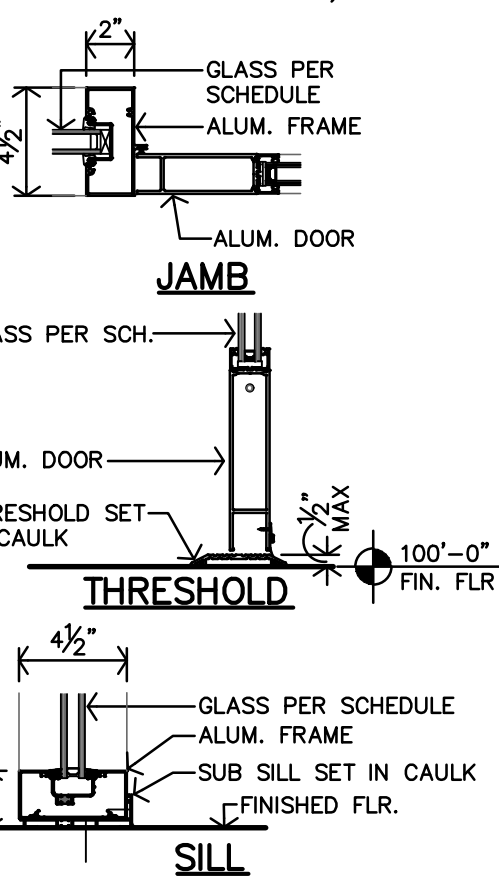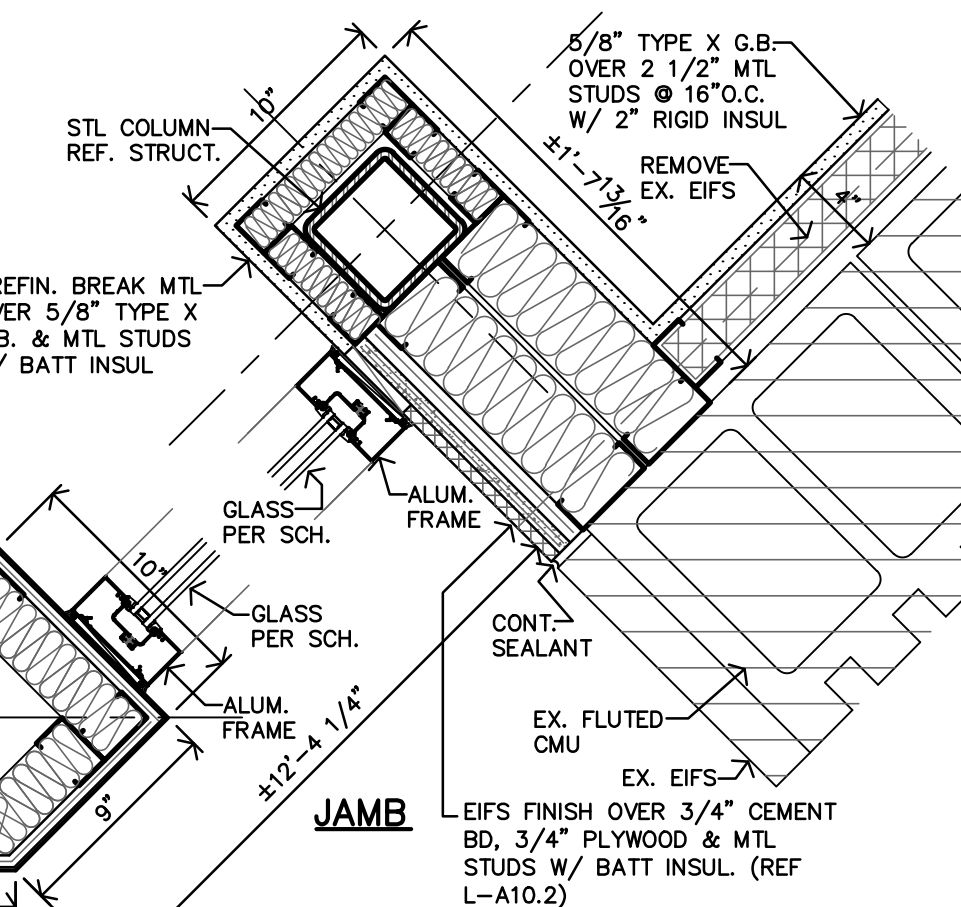


**G STOREFRONT HEAD DETAIL**  
1 1/2"=1'-0"

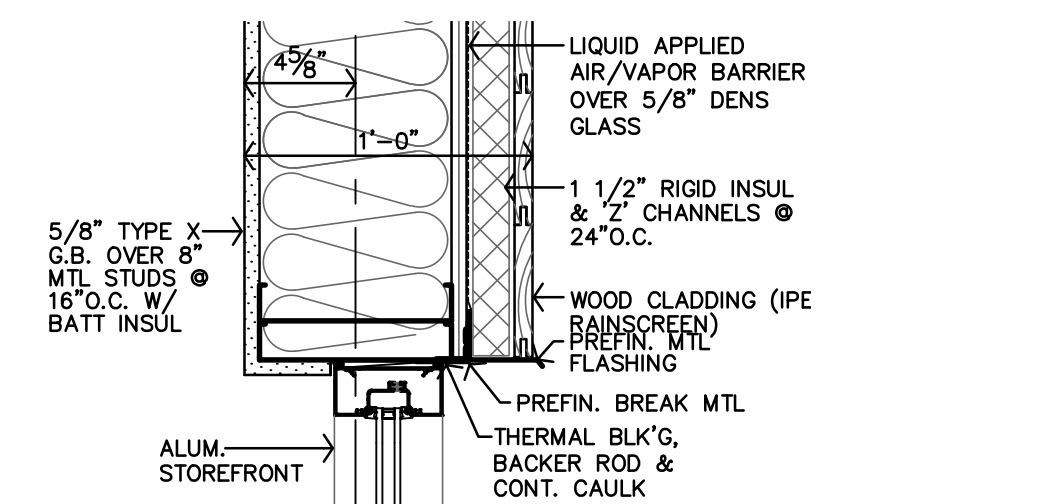


**F STOREFRONT JAMB DETAILS**  
1 1/2"=1'-0"

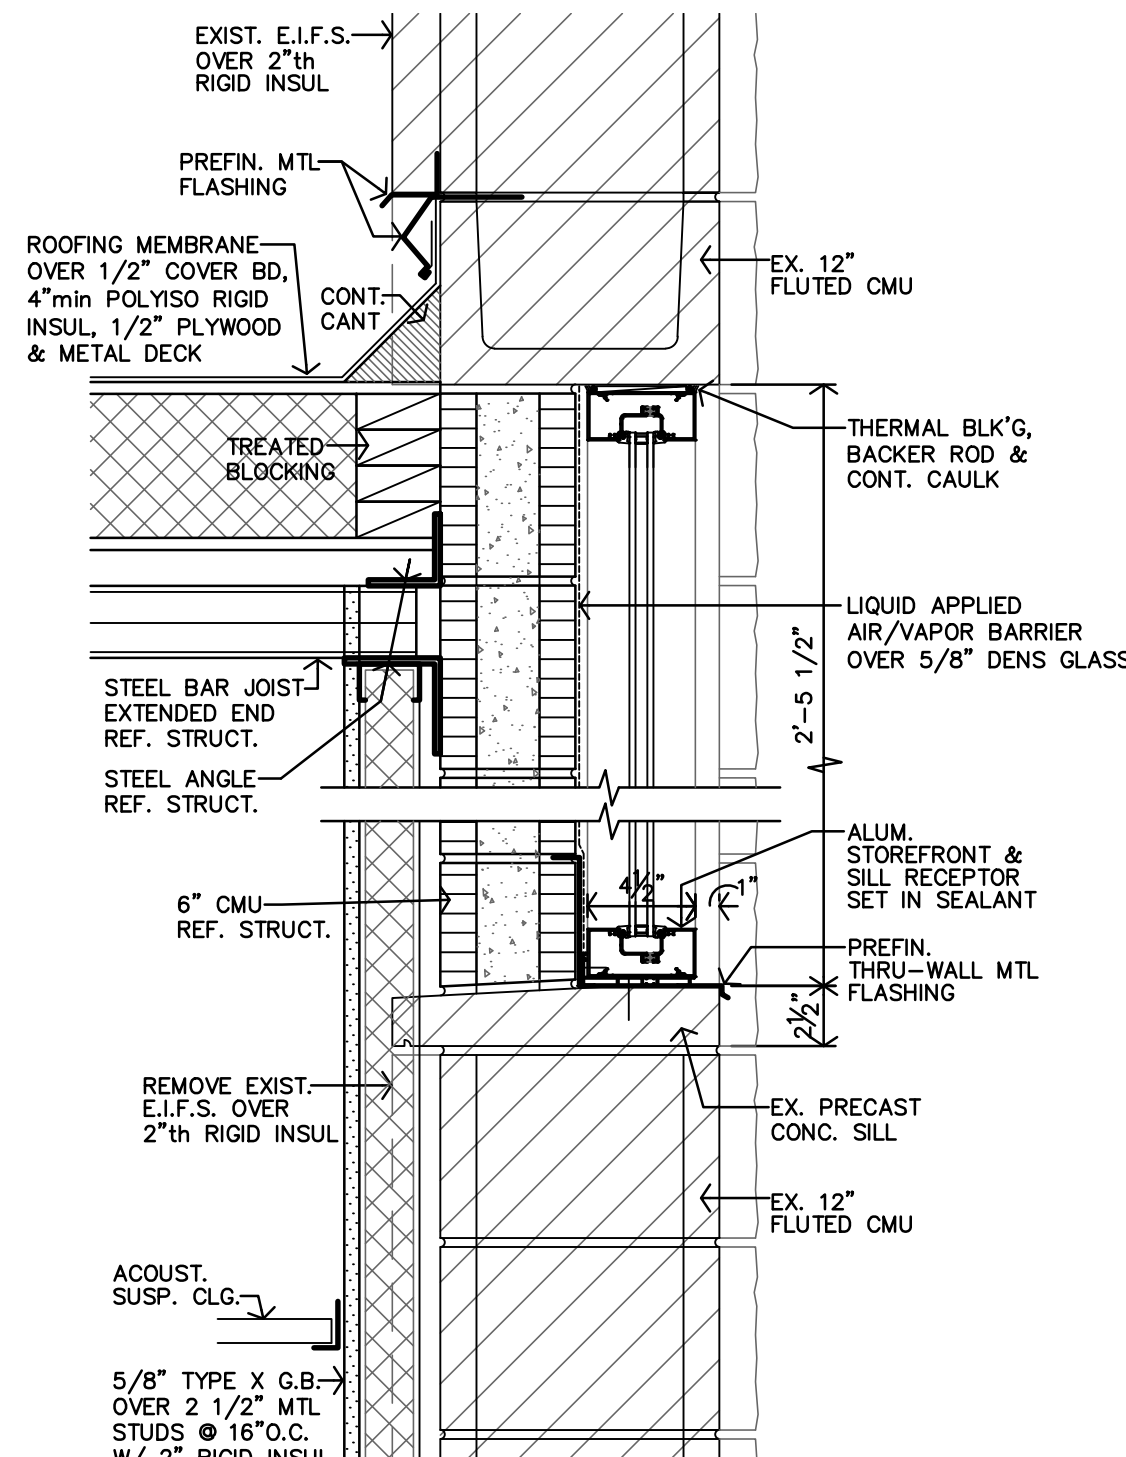


**E WINDOW DETAILS**  
1 1/2"=1'-0"

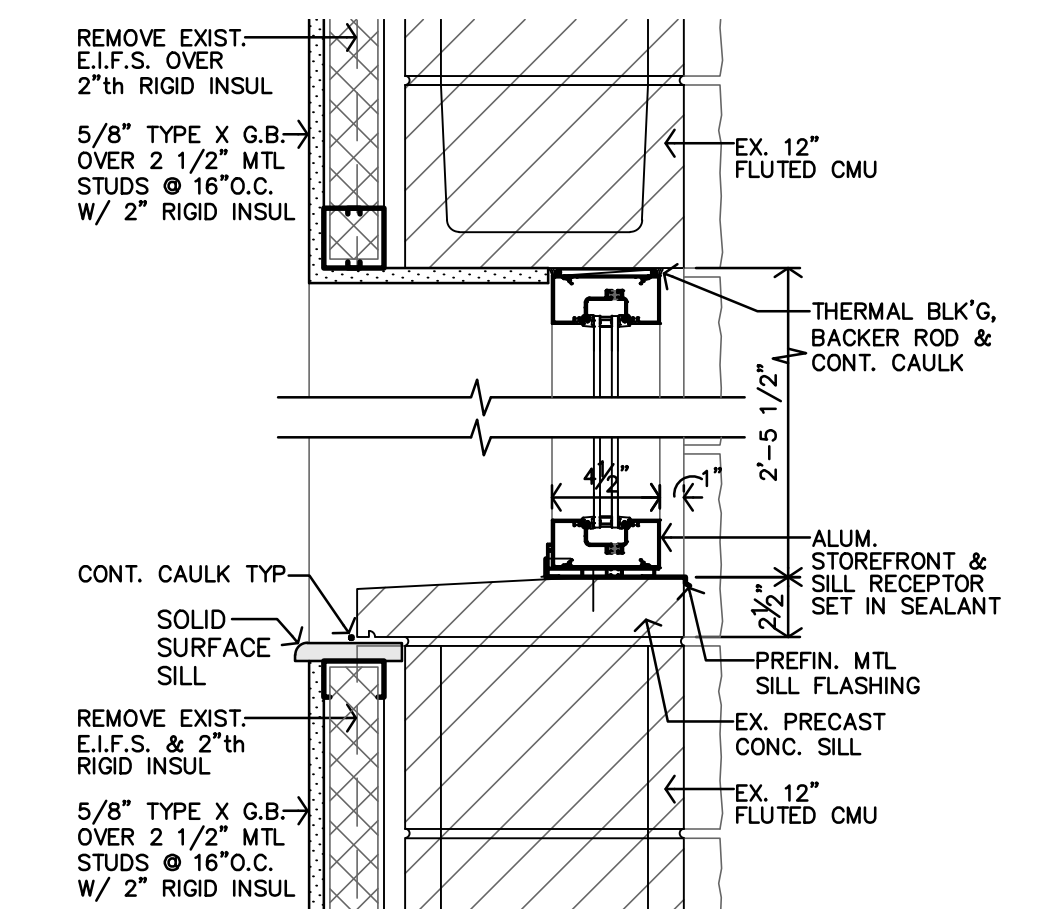


**D WINDOW DETAILS**  
1 1/2"=1'-0"

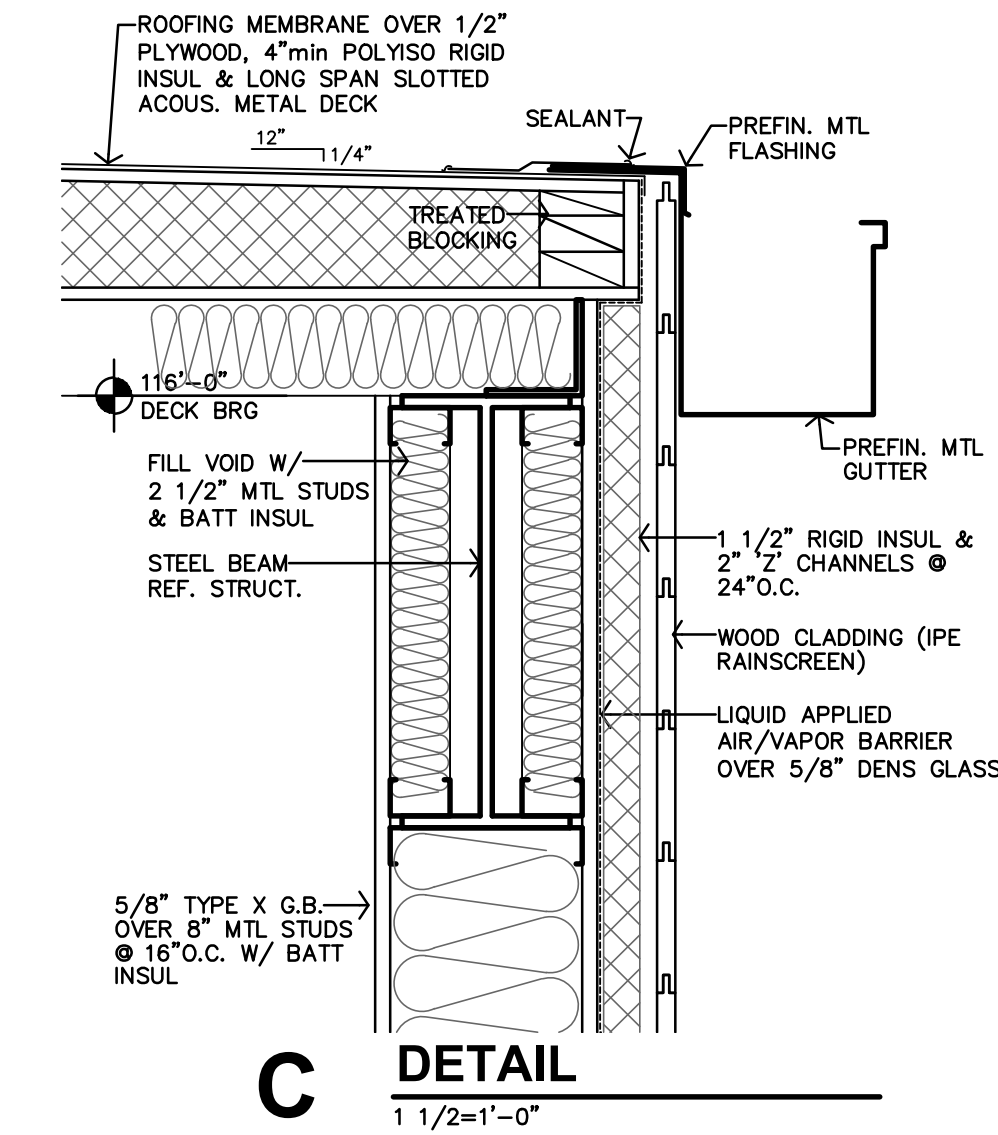

**C DETAIL**  
1 1/2"=1'-0"

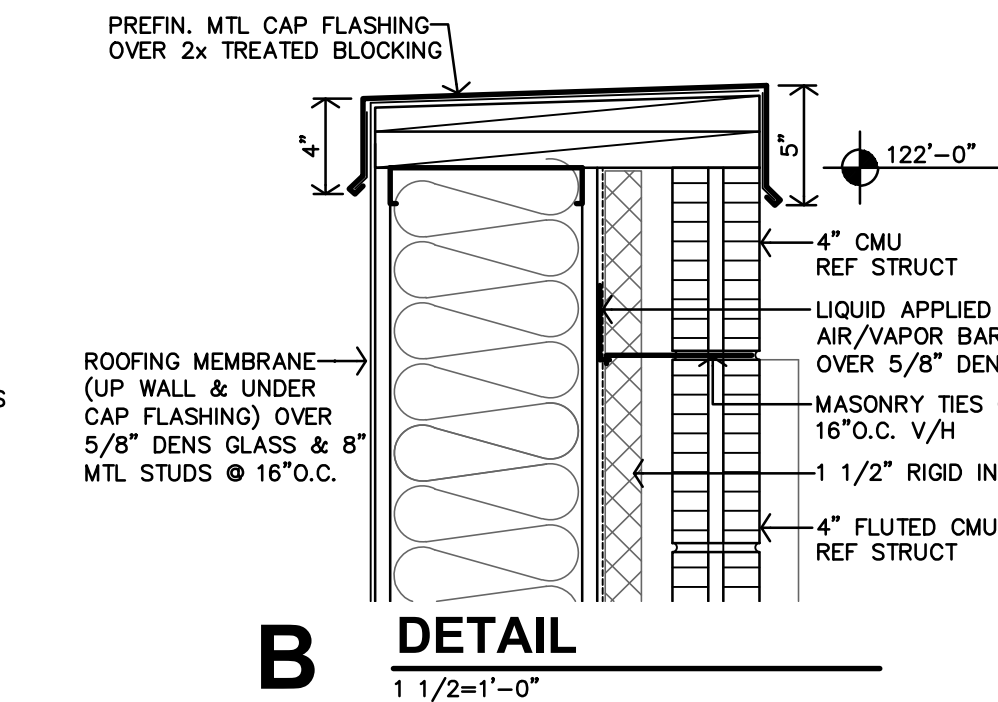

**B DETAIL**  
1 1/2"=1'-0"

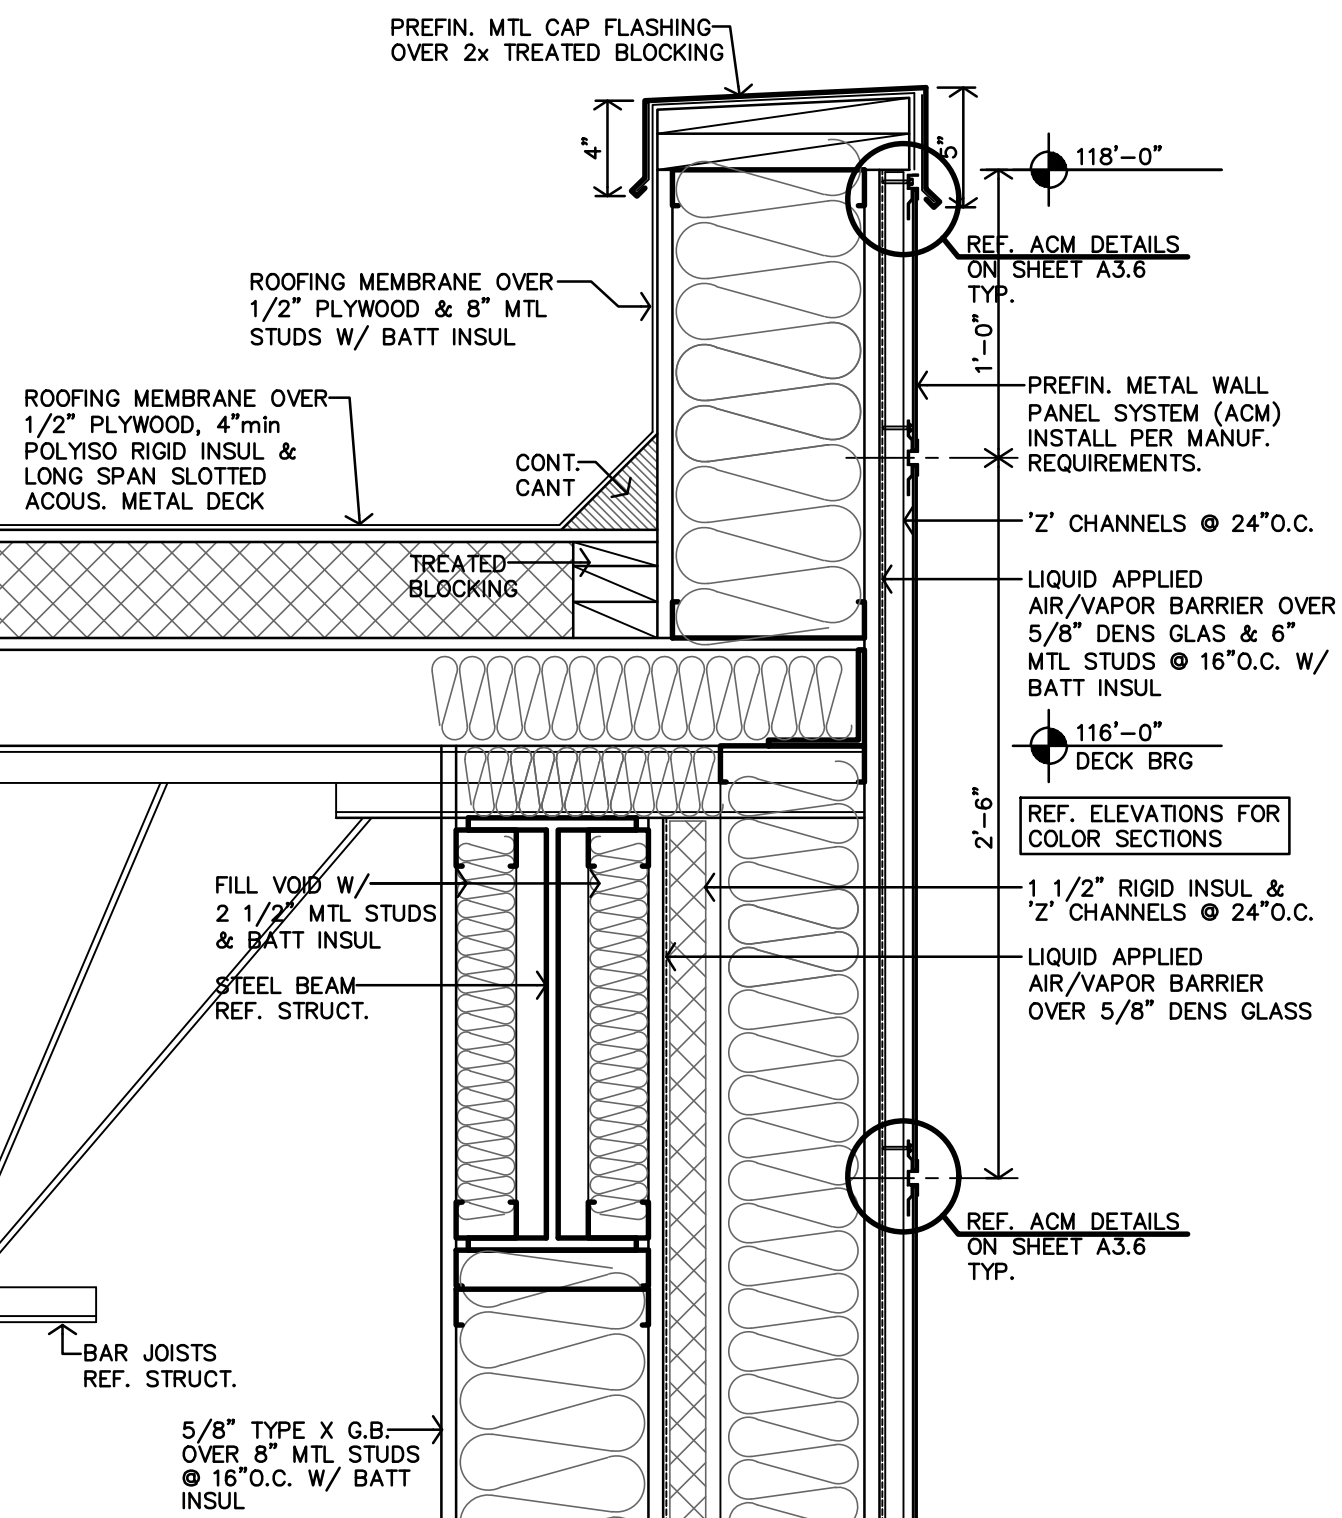

**A DETAIL**  
1 1/2"=1'-0"




## ROOFING GENERAL NOTES

1. ROOFING INSTALLATION: MANUFACTURERS DETAILS ARE GENERIC/GENERAL. CONTRACTOR SHALL COMPLY WITH MANUFACTURER'S DETAILS & RECOMMENDATIONS AND THOSE RECOMMENDED BY NRCA'S "THE ROOFING & WATERPROOFING MANUAL".
2. CONTRACTOR MUST COMPLY W/ ALL STATE & LOCAL CODES & REGULATIONS.
3. CAULK & SEAL WATER TIGHT ALL JOINTS & TRANSITIONS.
4. DIMENSIONS ON ROOF PLAN REFLECT DIMENSIONS PARALLEL WITH FLOOR PLANE. ACTUAL ROOF AREA IS LARGER DUE TO ROOF SLOPE.
5. ALL METAL MATERIALS (I.E. FLASHINGS, ETC.) SHALL BE .0217" (26 GA.) THICK PREFINISHED GALVANIZED OR ALUM. ZINC ALLOY. ALL FASTENERS MUST BE COMPATIBLE WITH ASSOCIATED METALS/MATERIALS. METALS MUST BE INSTALLED PER SMACNA'S "ARCHITECTURAL SHEET METAL MANUAL."
6. ALL DOWNSPOUTS & ROOF DRAINS TO BE TIED TOGETHER AND CONNECTED TO STORM SYSTEM. REF. CIVIL DWGS.

## LEGEND

- 1 MECHANICALLY ATTACH NEW 60-MIL PVC ROOF MEMBRANE OVER EXIST. COVER BOARD, RIGID INSUL, DECKING & METAL DECK. PROVIDE ALL TERMINATION BARS, FLASHINGS, SEALANT, & CAULKING. INSTALL PARAPET METAL FLASHING CAPS & PREFIN. MTL GUTTER/FLASHING. 20-YEAR FULL COVERAGE WARRANTY.

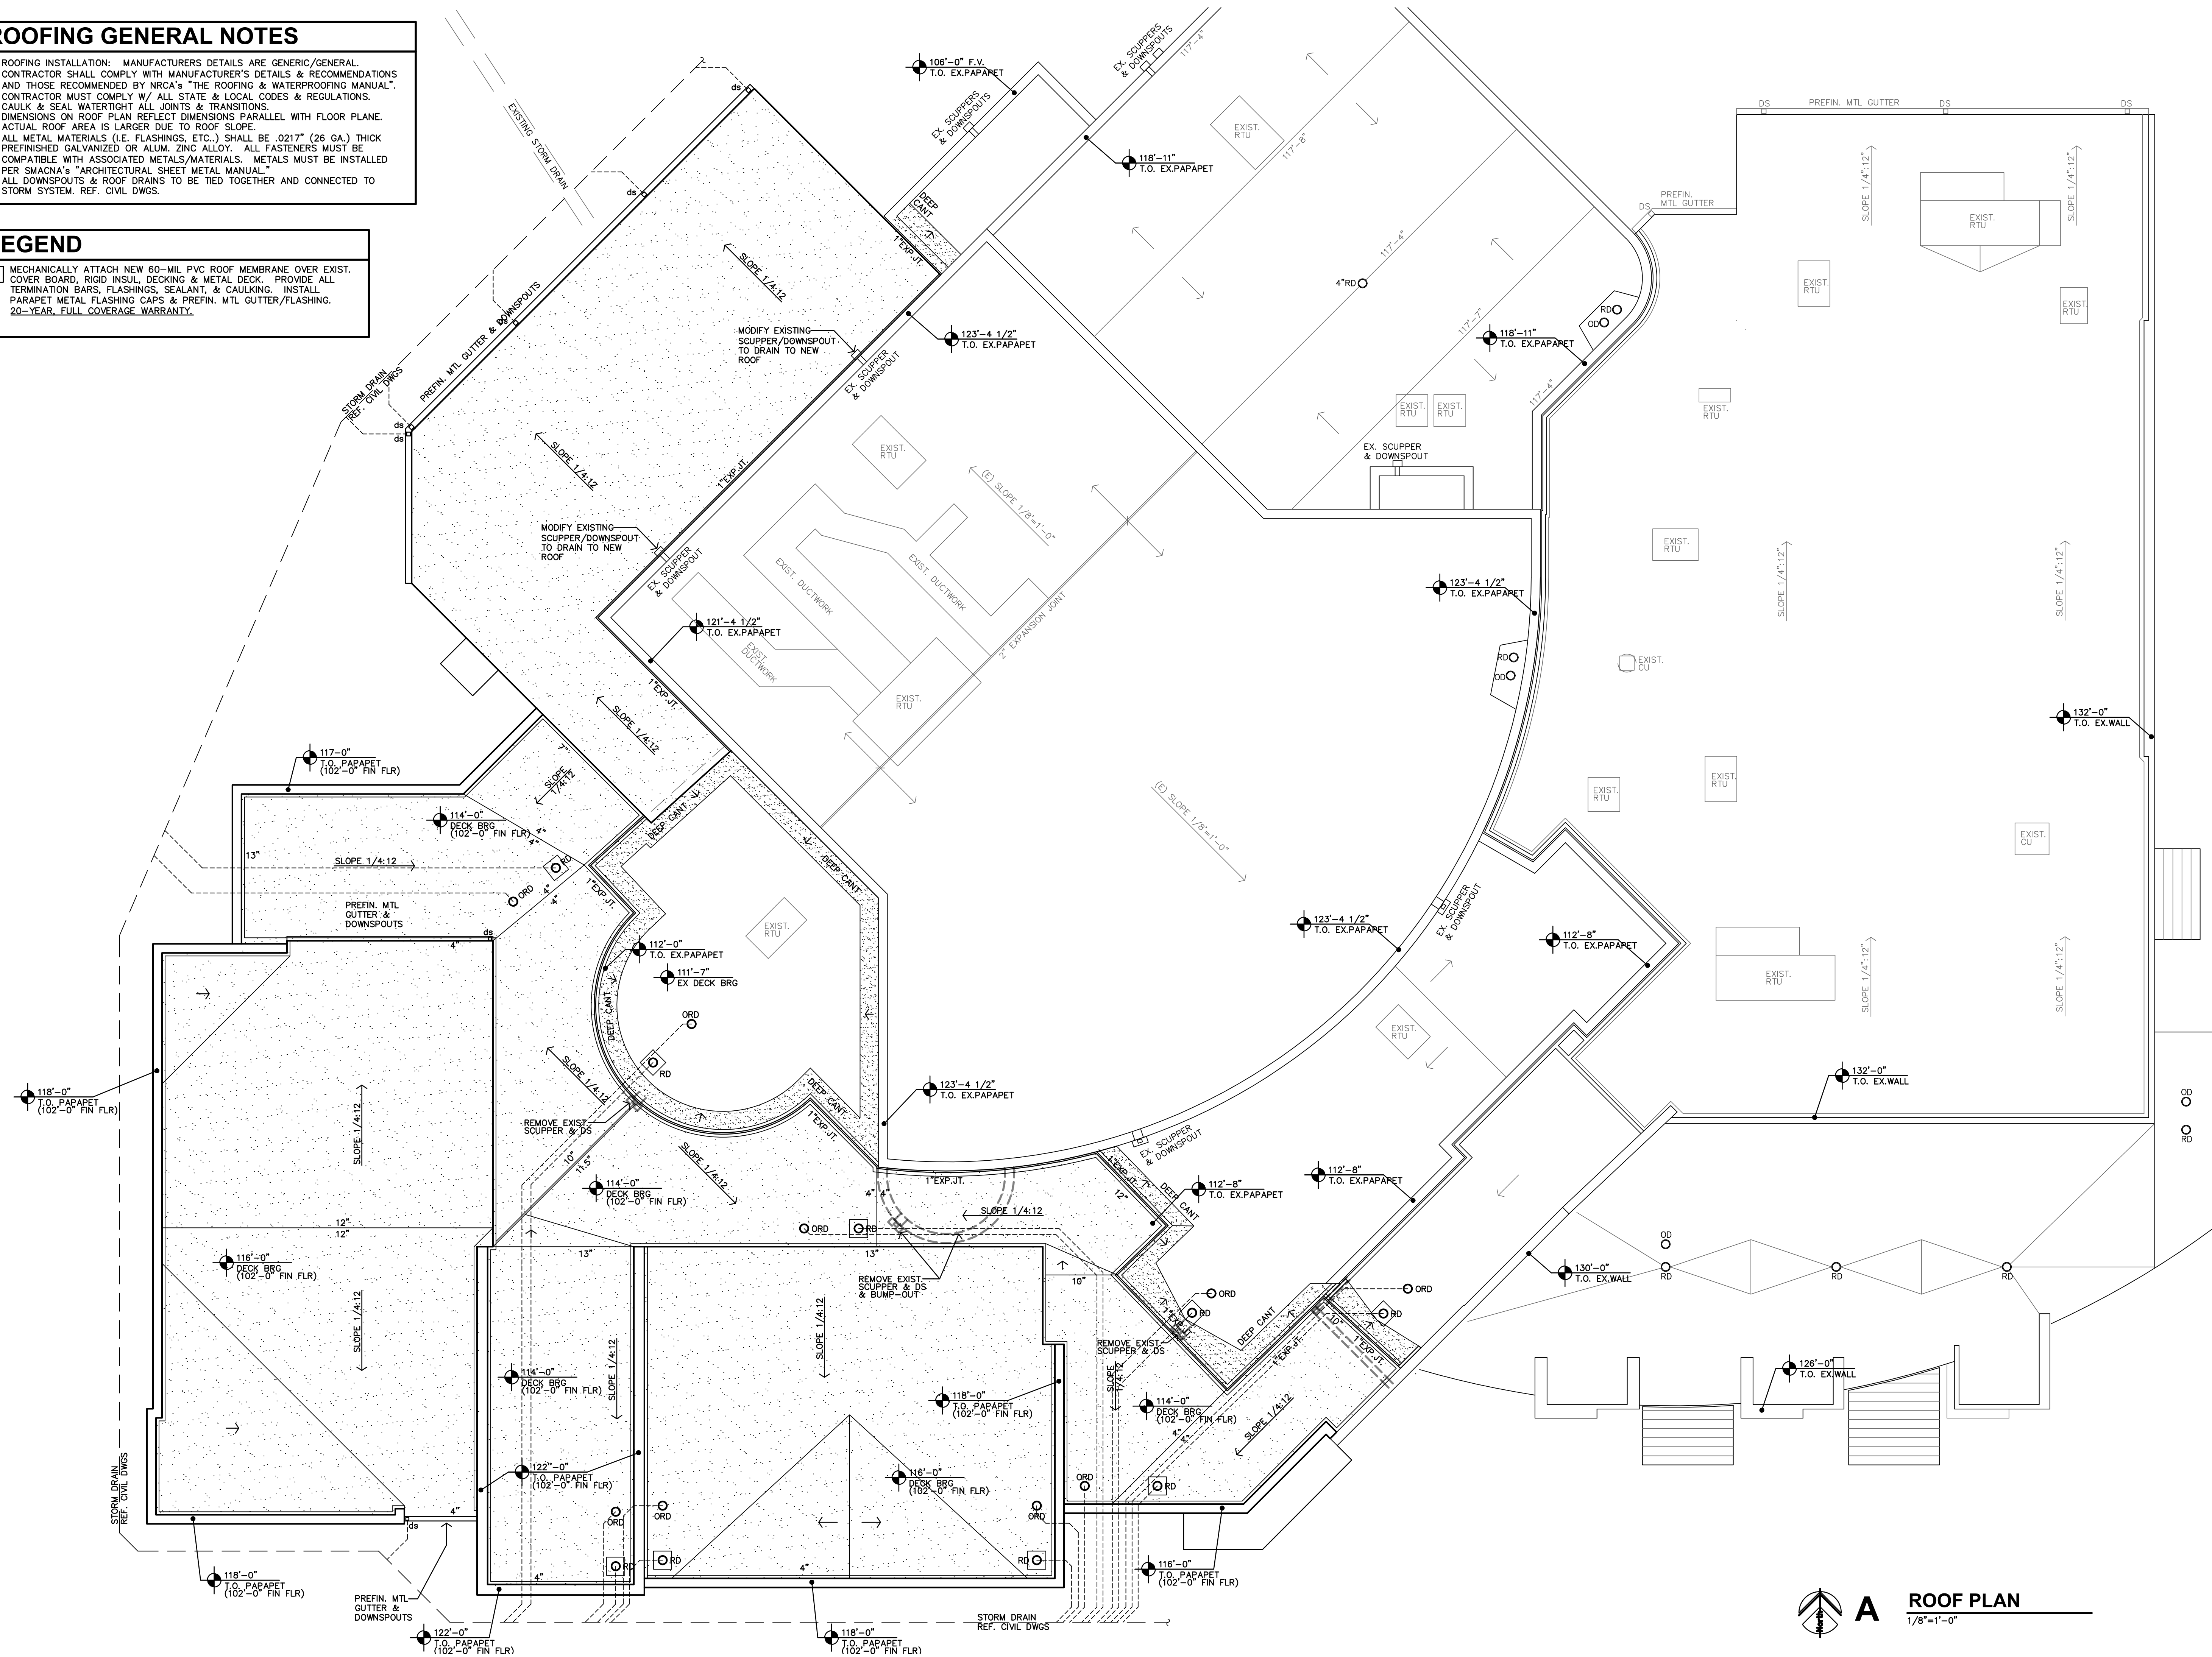




MANUFACTURER'S STANDARD DETAILS

FOR REFERENCE PURPOSES ONLY


THE DETAILS BELOW ARE DURA-LAST STANDARD DETAILS FOR REFERENCE PURPOSES. REFERENCE WALL SECTIONS AND SPECIFIC DETAILS FOR SPECIAL CONDITIONS INCLUDING BUT NOT LIMITED TO FLASHINGS, COUNTERFLASHINGS, INSULATION, VAPOR BARRIERS, SEALANTS, ETC.

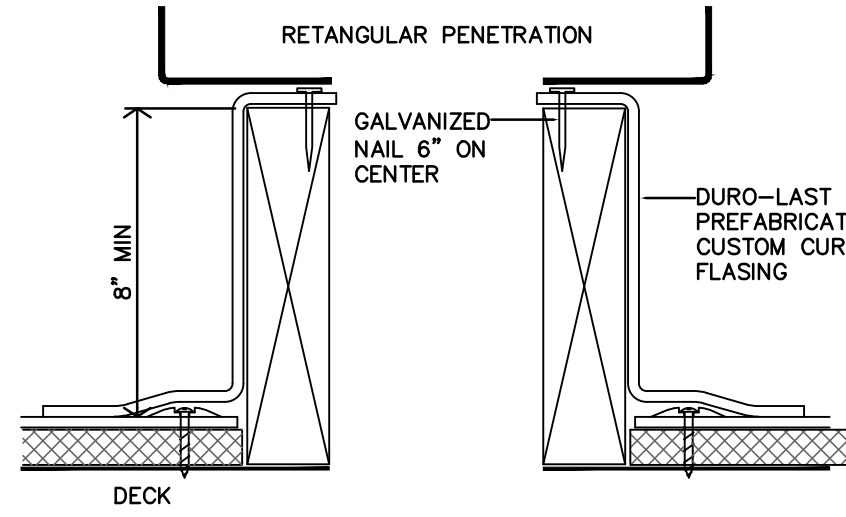

NOTE: PERIMETER FASTENING OF DECK MEMBRANE SHALL BE THE SAME PATTERN AS THE FIELD MEMBRANE, MAX 18" ON CENTER, AND NO LESS THAN ONE FASTENER PER SIDE.


MECHANICAL PENETRATION

N.T.S.

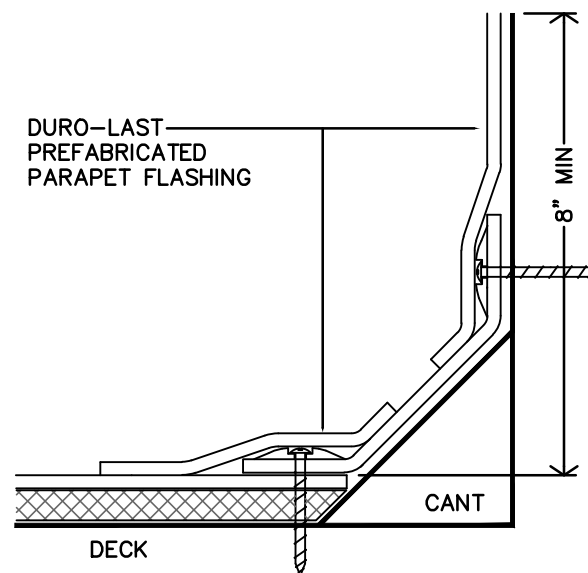


ROOF TO WALL

N.T.S.

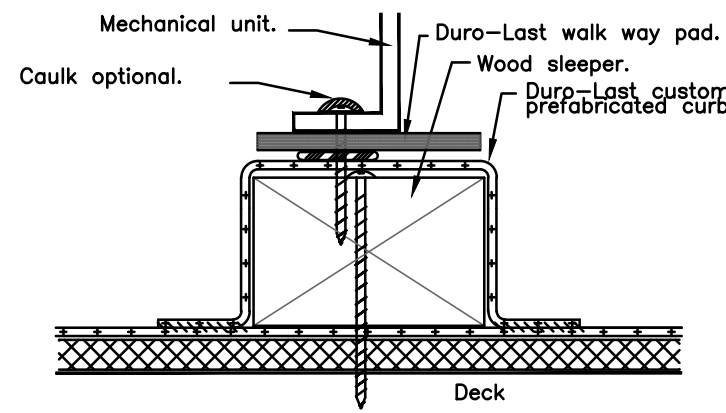

EQUIPMENT BLOCKING

N.T.S.

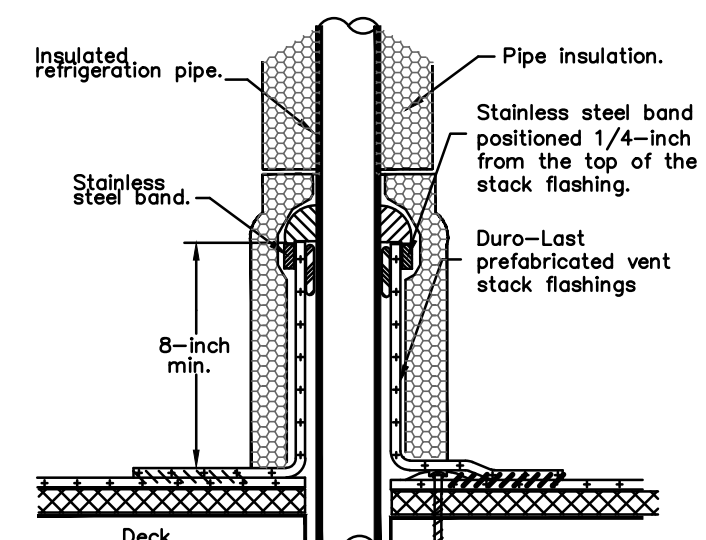


Note: Membrane attachment around the penetration will be the same as the deck membrane, max. 18-inches on center, and a minimum of one plate/fastener per flashing.

Note: Fill resulting vertical and horizontal gaps with a urethane foam and tape closed.

PIPE PENETRATION

N.T.S.

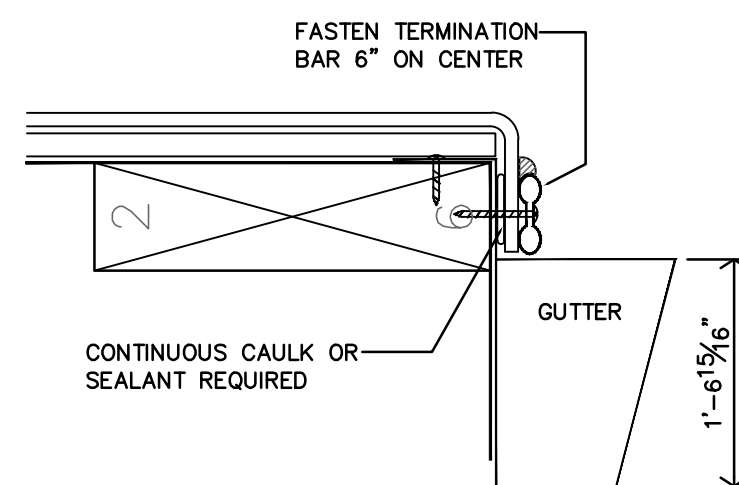


NOTE: A 1/4" GAP REQUIRED BETWEEN SECTIONS OF DURA-LAST TERMINATION BAR.

NOTE: A WOOD NAILER IS REQUIRED WHEN INSULATION IS GREATER THAN 1" IS INSTALLED. TOP OF WOOD NAILER TO BE FLUSH W/ TOP OF INSULATION. FASTENERS USED TO ATTACH WOOD NAILERS SHALL BE SPACED NO GREATER THAN 18" ON CENTER.

GUTTER DETAIL


N.T.S.

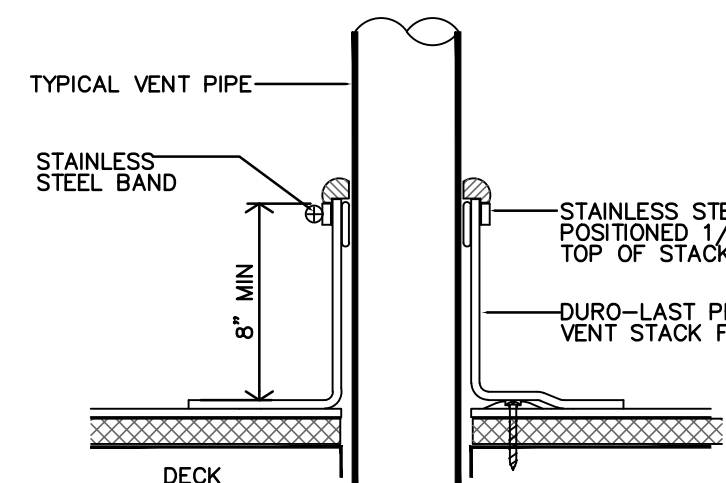

NOTE: MEMBRANE ATTACHMENT AROUND PENETRATION WILL BE THE SAME AS THE DECK MEMBRANE, MAX 18" ON CENTER, AND MINIMUM ONE PLATE/FASTNER PER FLASHING.


VENT PIPE DETAIL

N.T.S.

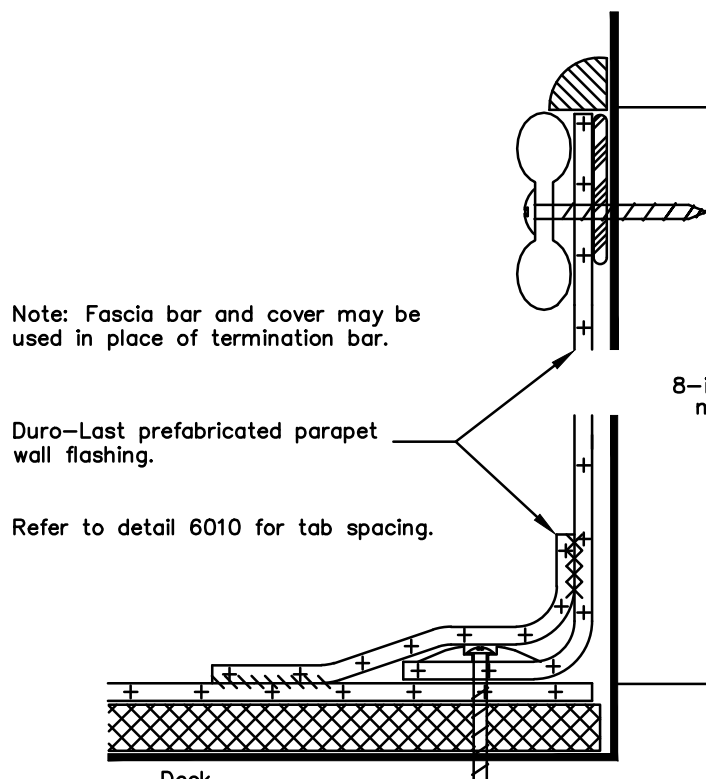

ROOF WALL TERMINATION

N.T.S.

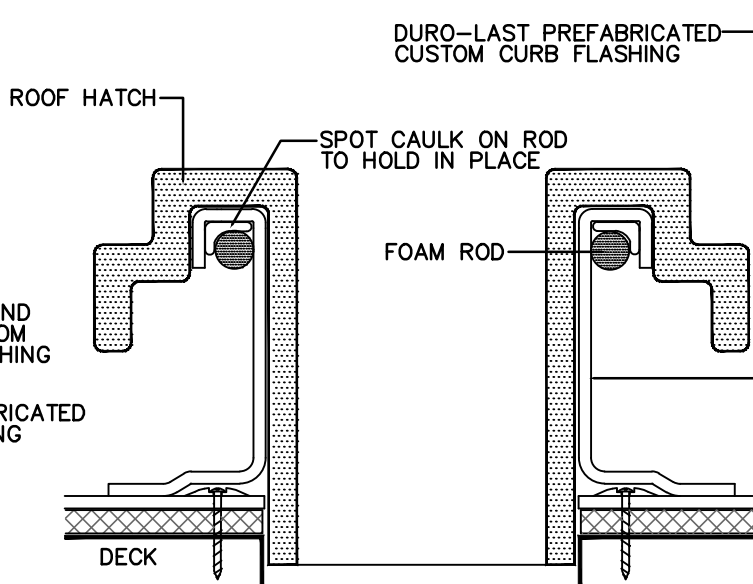


NOTE: PERIMETER FASTENING OF DECK MEMBRANE SHALL BE THE SAME PATTERN AS THE FIELD MEMBRANE, MAX 18" ON CENTER, AND NO LESS THAN ONE FASTENER PER SIDE.

NOTE: FLASHING MEMBRANE MUST LOOP OVER FOAM ROD. FOAM ROD SHALL BE OF SUFFICIENT SIZE TO COMPRESS WHEN INSTALLED.


ROOF HATCH

N.T.S.

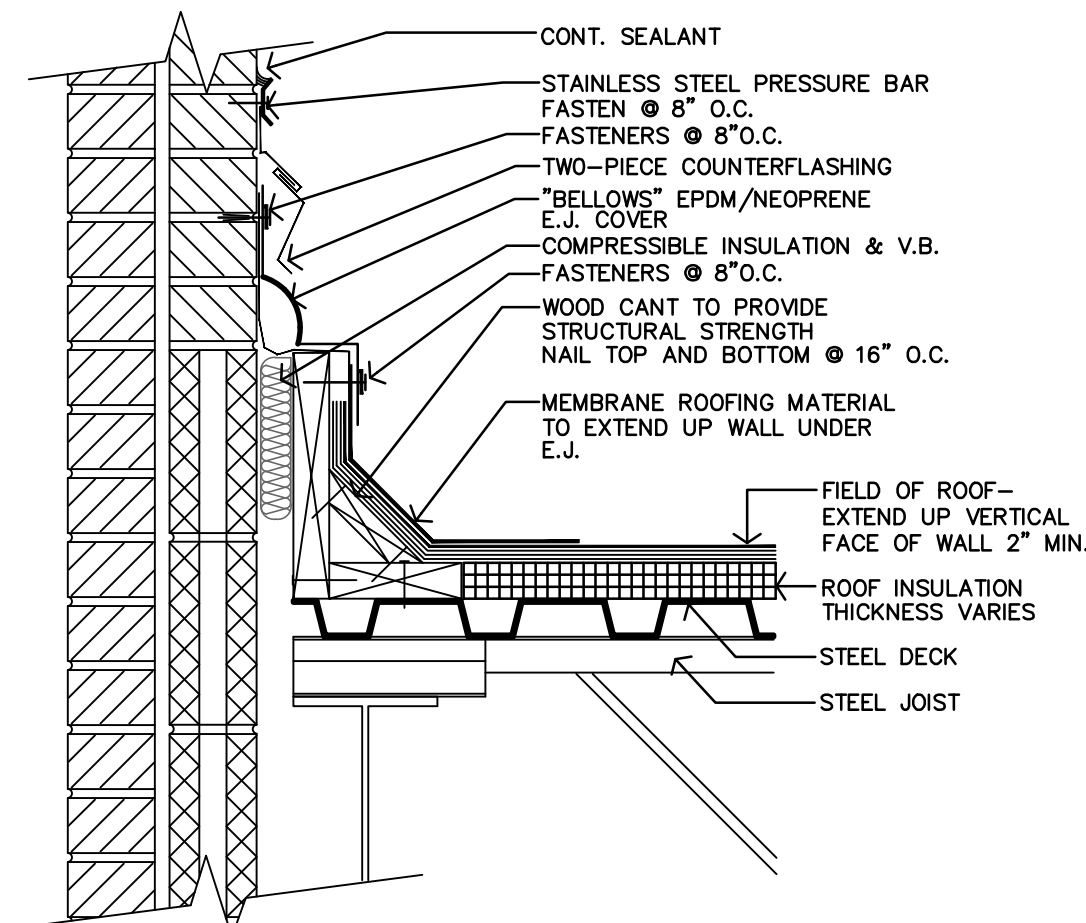


ROOF TRANSITION @ MASONRY

1 1/2"=1'-0"

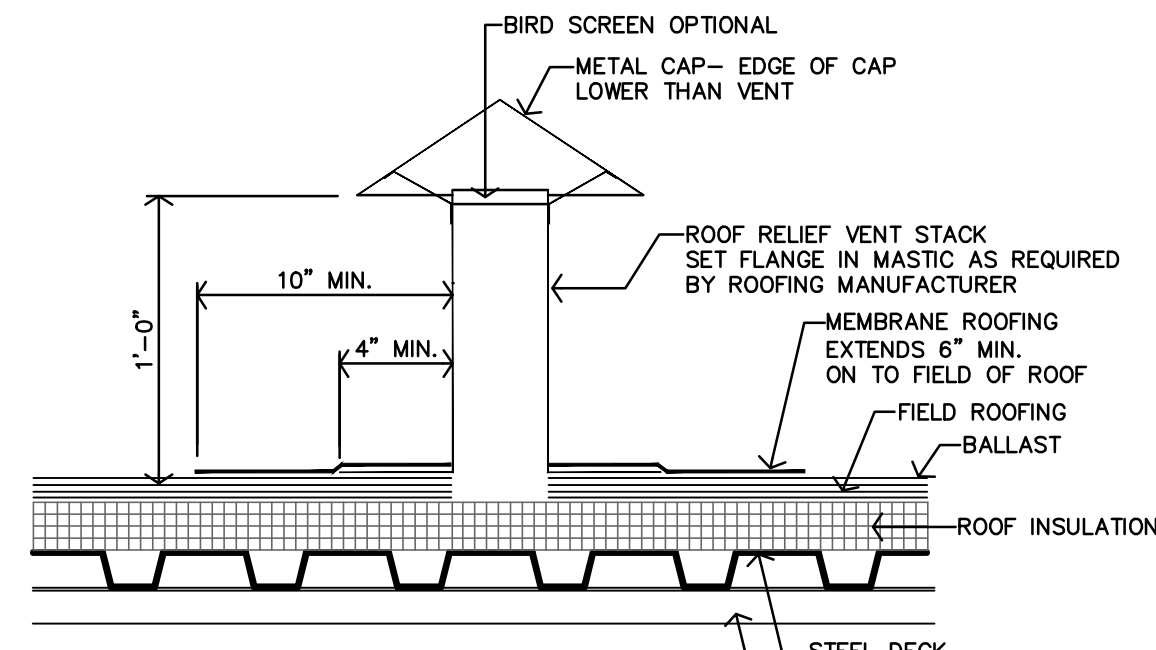

ROOF RELIEF VENT

1 1/2"=1'-0"

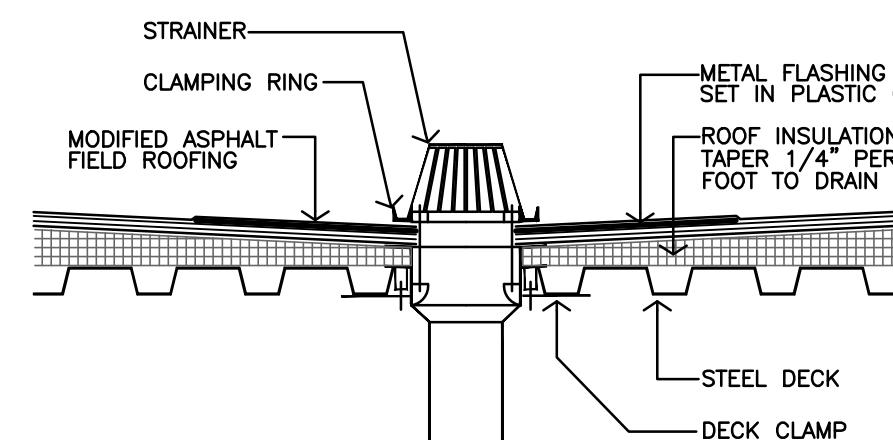


NOTE: METAL FLASHING IS MIN. 30" SQUARE 2 1/2" LB. TO 4 LB. LEAD OR 16 oz. SOFT COPPER FLASHING. THIS FLASHING IS SET ON THE BASE SHEET IN MASTIC. PRIME THE TOP SURFACE BEFORE APPLYING ROOFING MATERIAL. REFERENCE MANUFACTURER'S INSTALLATION REQUIREMENTS AND RECOMMENDATIONS.

THE BASE SHEET FLASHING AND FIELD ROOFING EXTEND UNDER THE CLAMPING RING.


ROOF DRAIN DETAIL

NOT TO SCALE

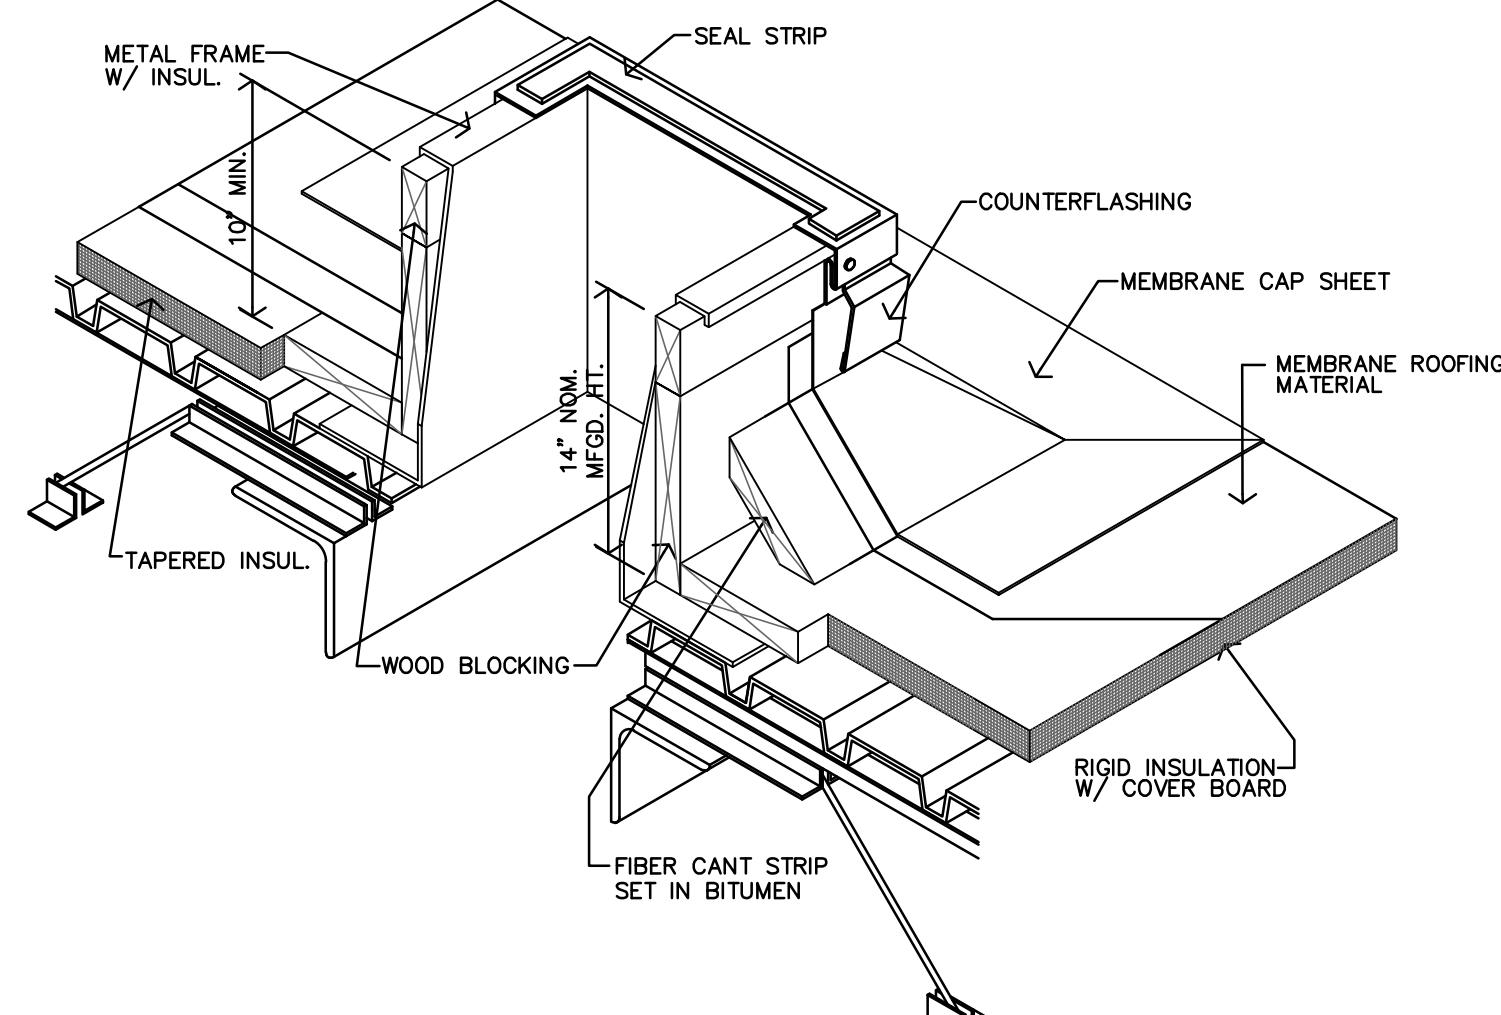


TYP ROOF CURB

1 1/2"=1'-0"

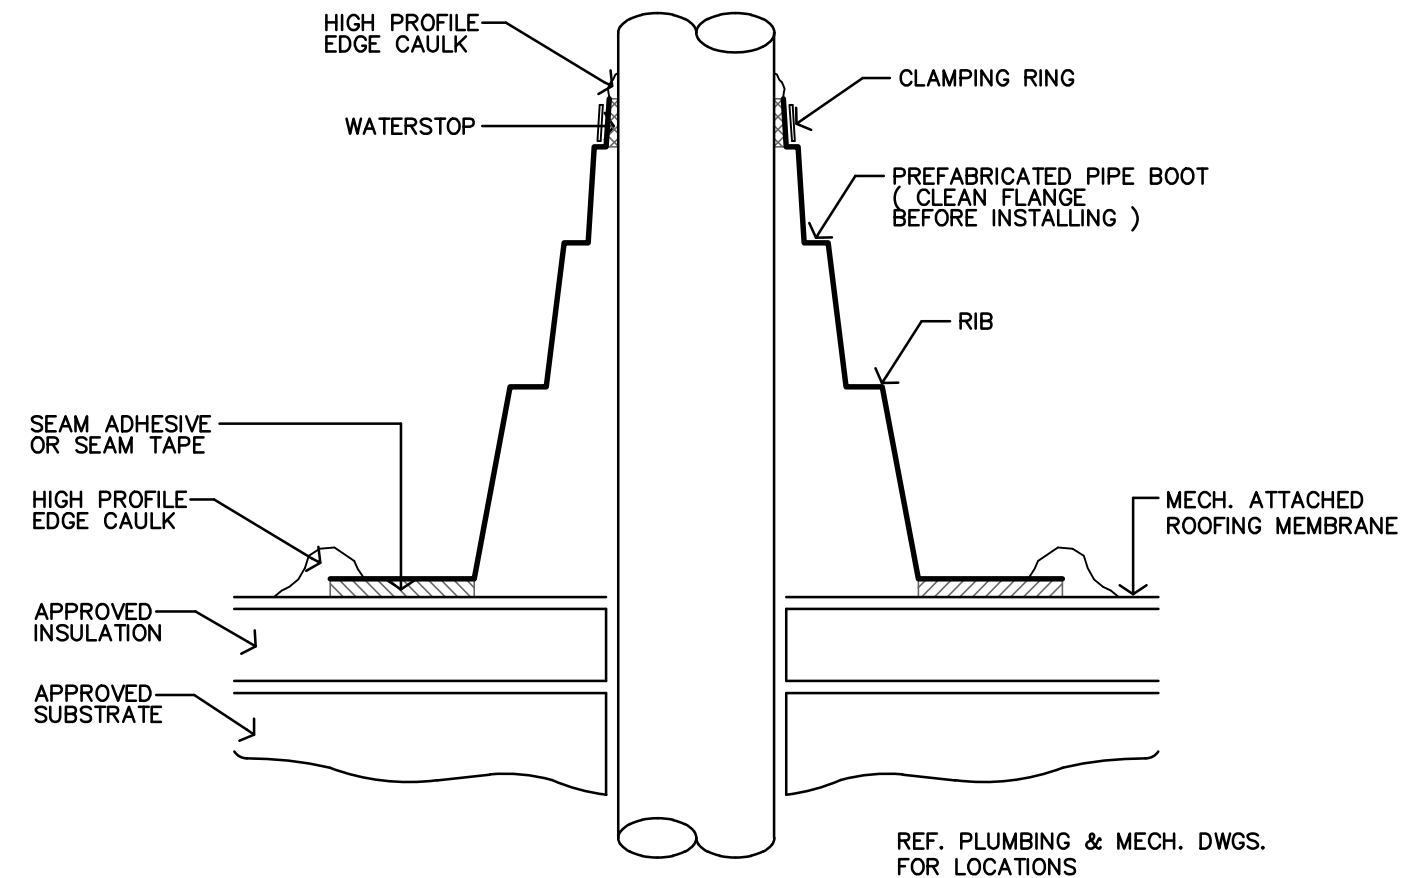


TYP PIPE PENetration

1 1/2"=1'-0"

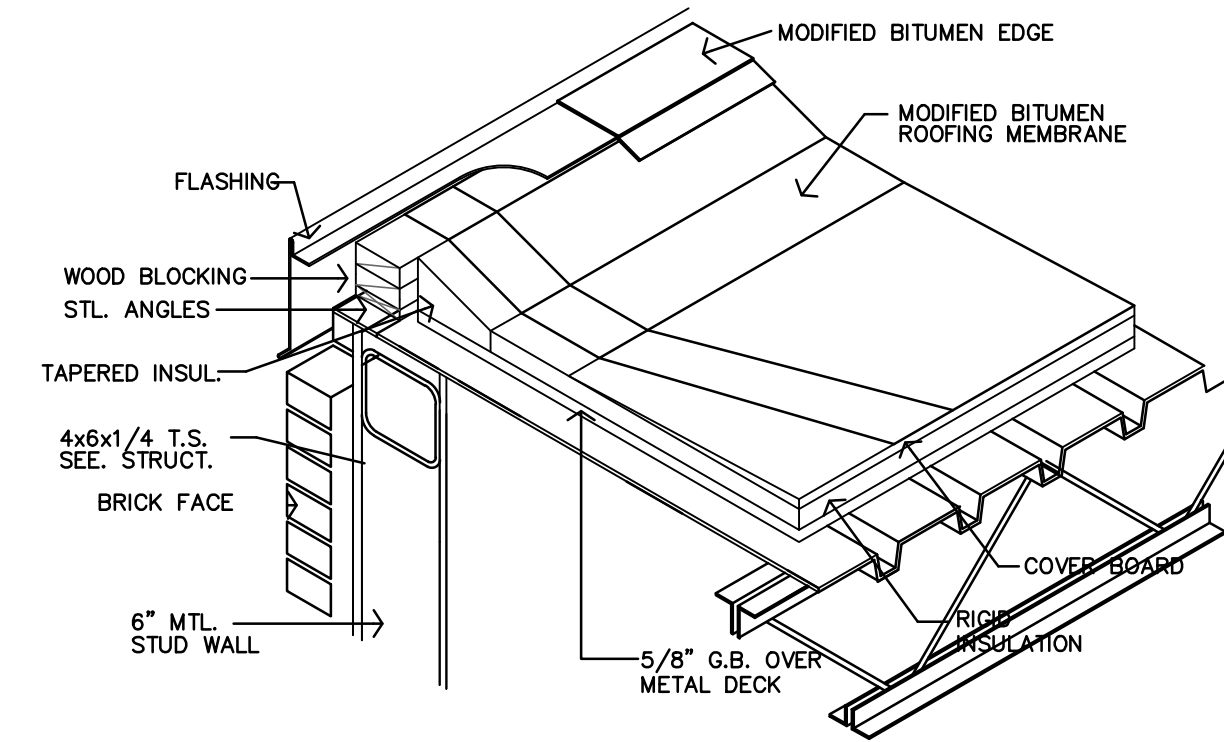

TYP ROOF EDGE FLASHING






1 1/2"=1'-0"

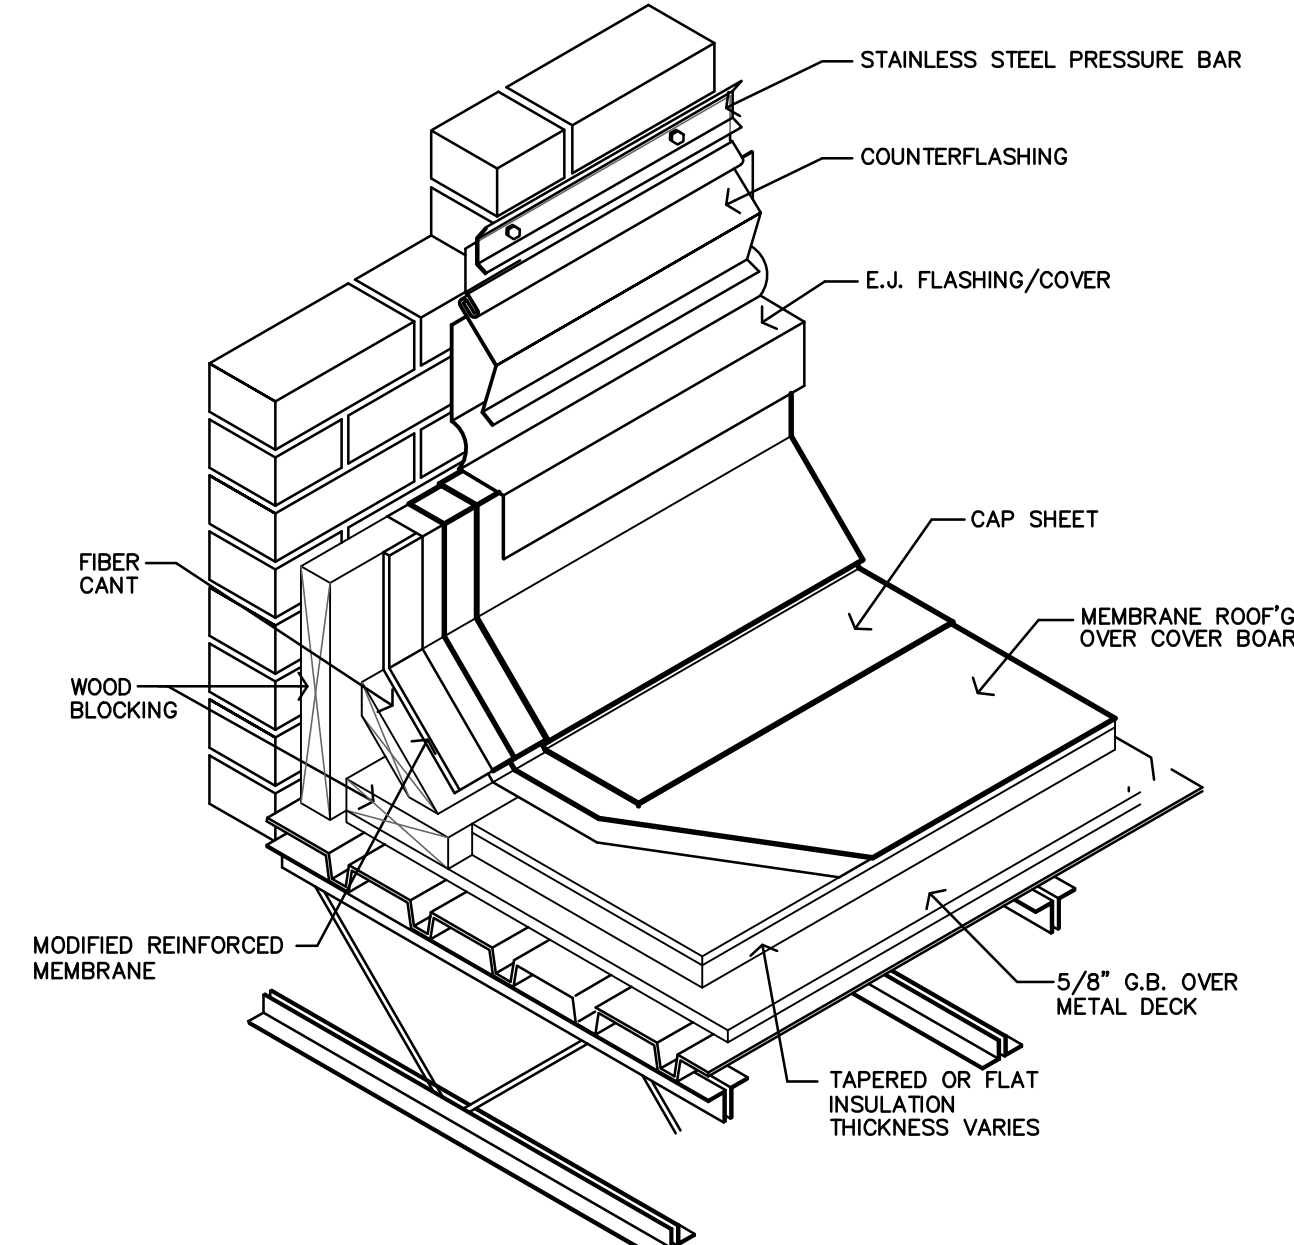

TYP ROOF FLASHING

1 1/2"=1'-0"



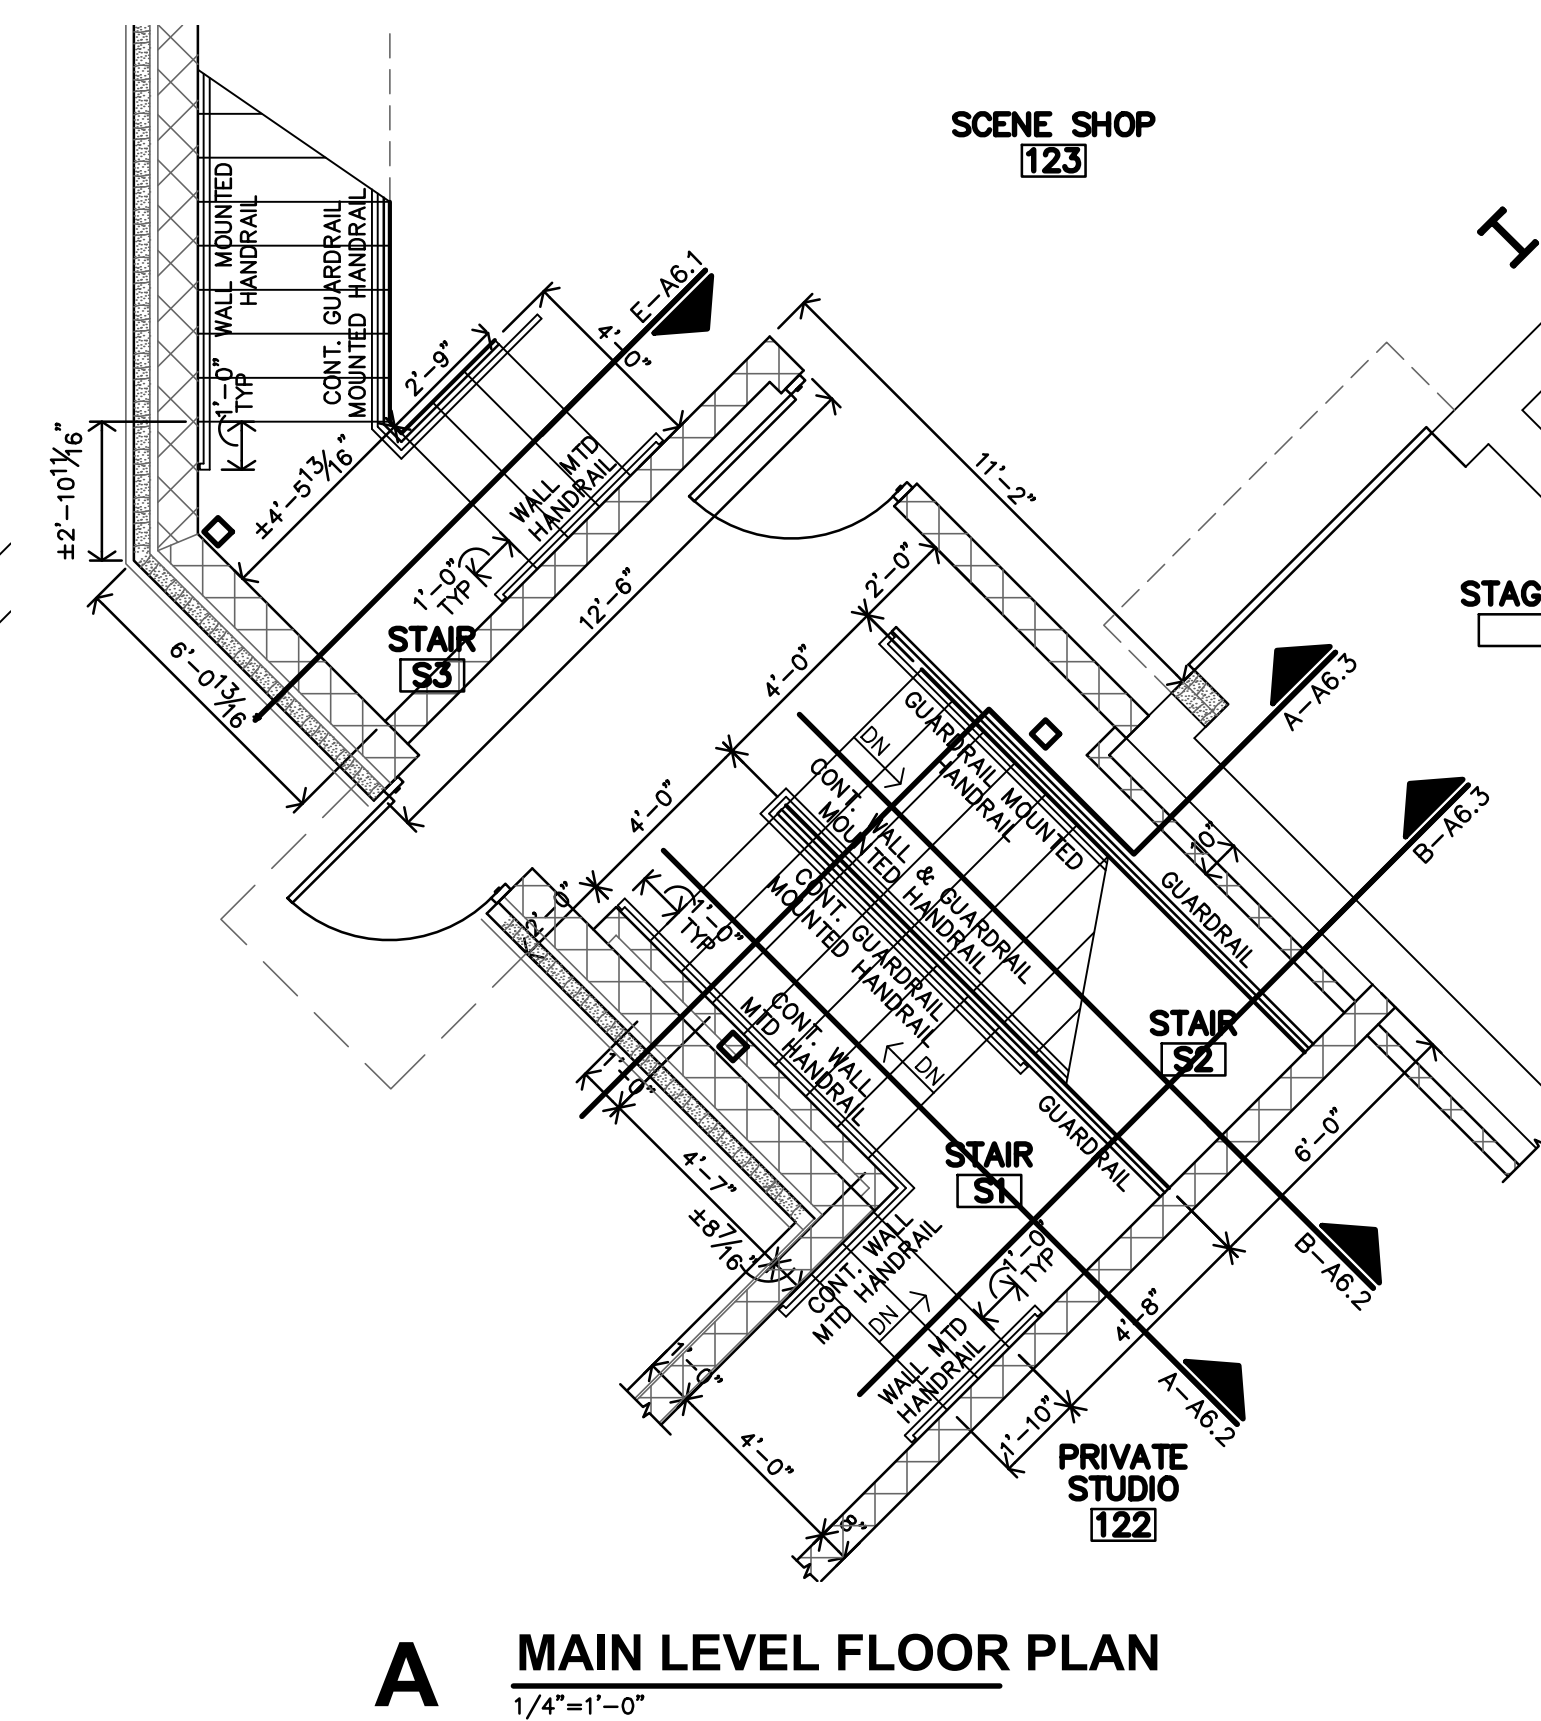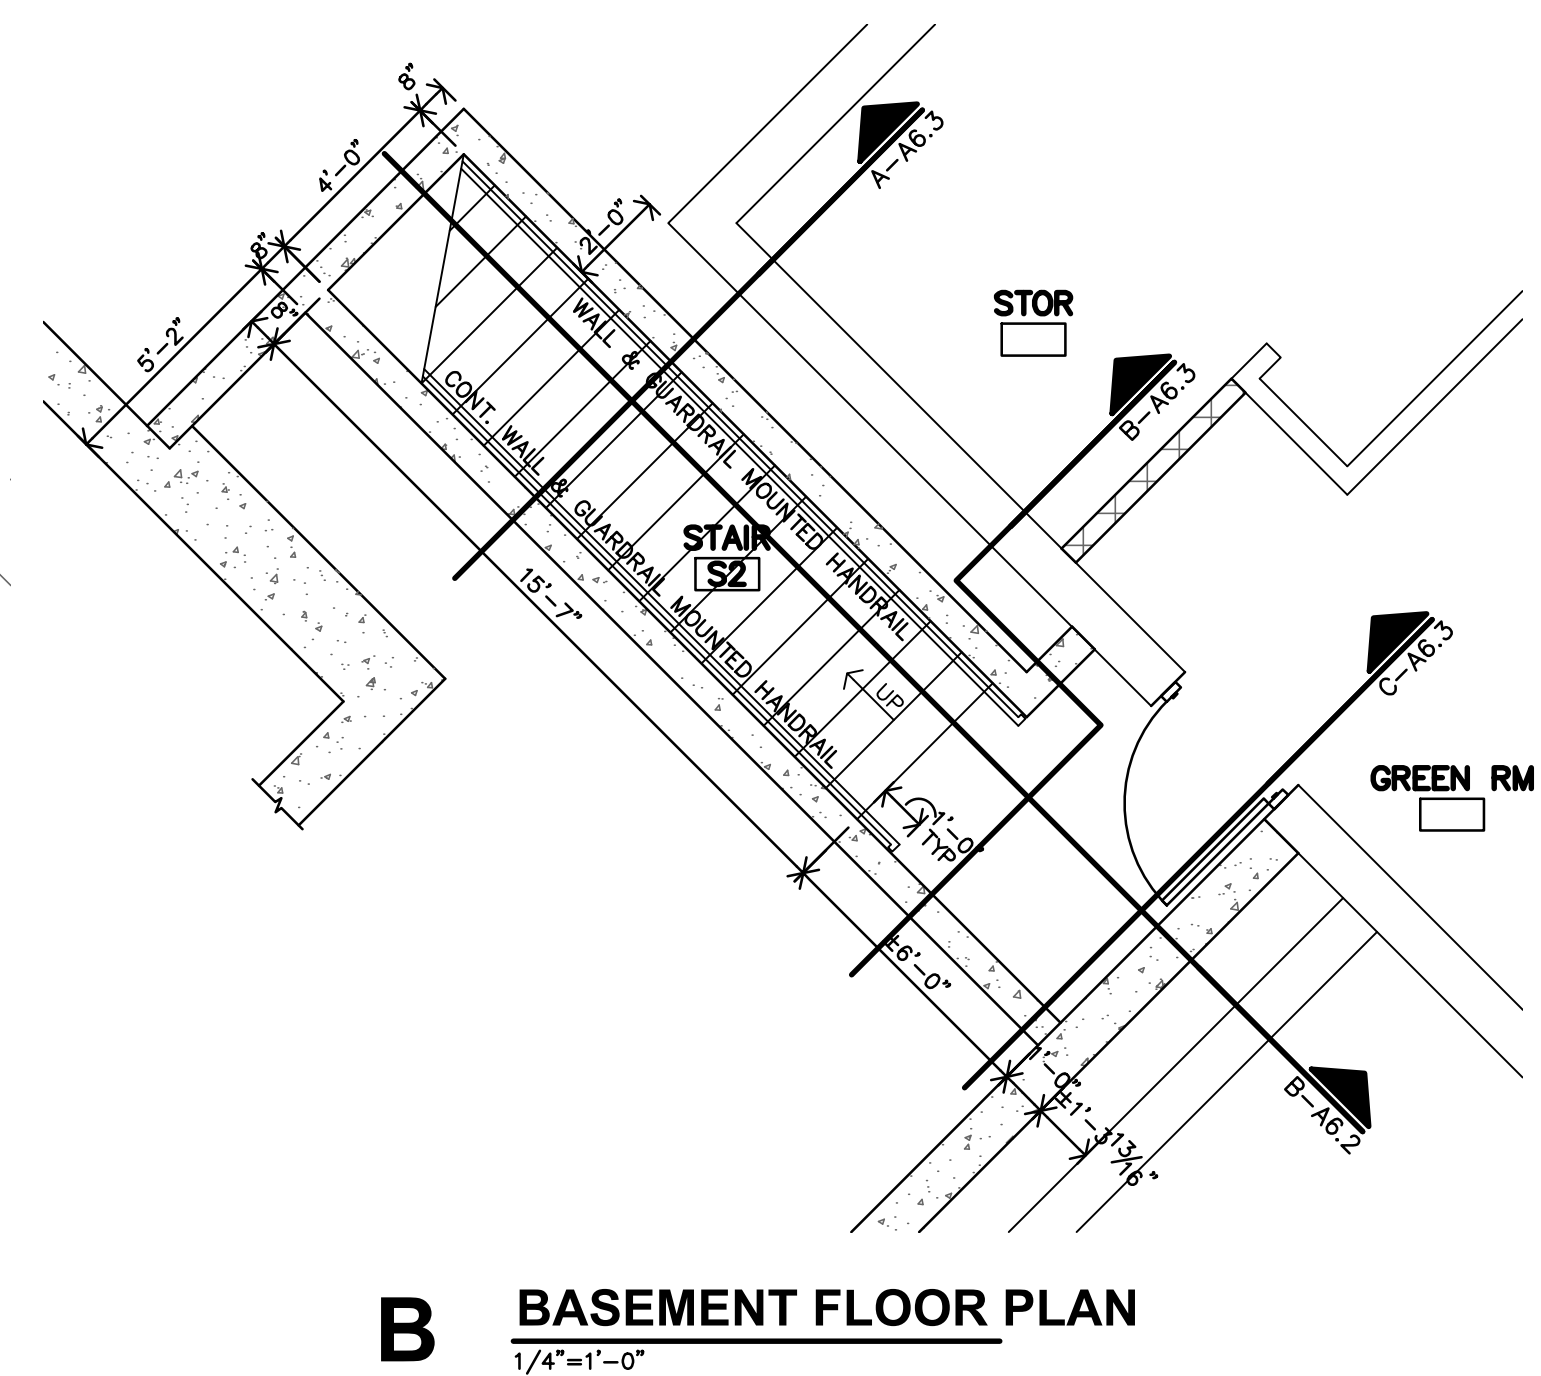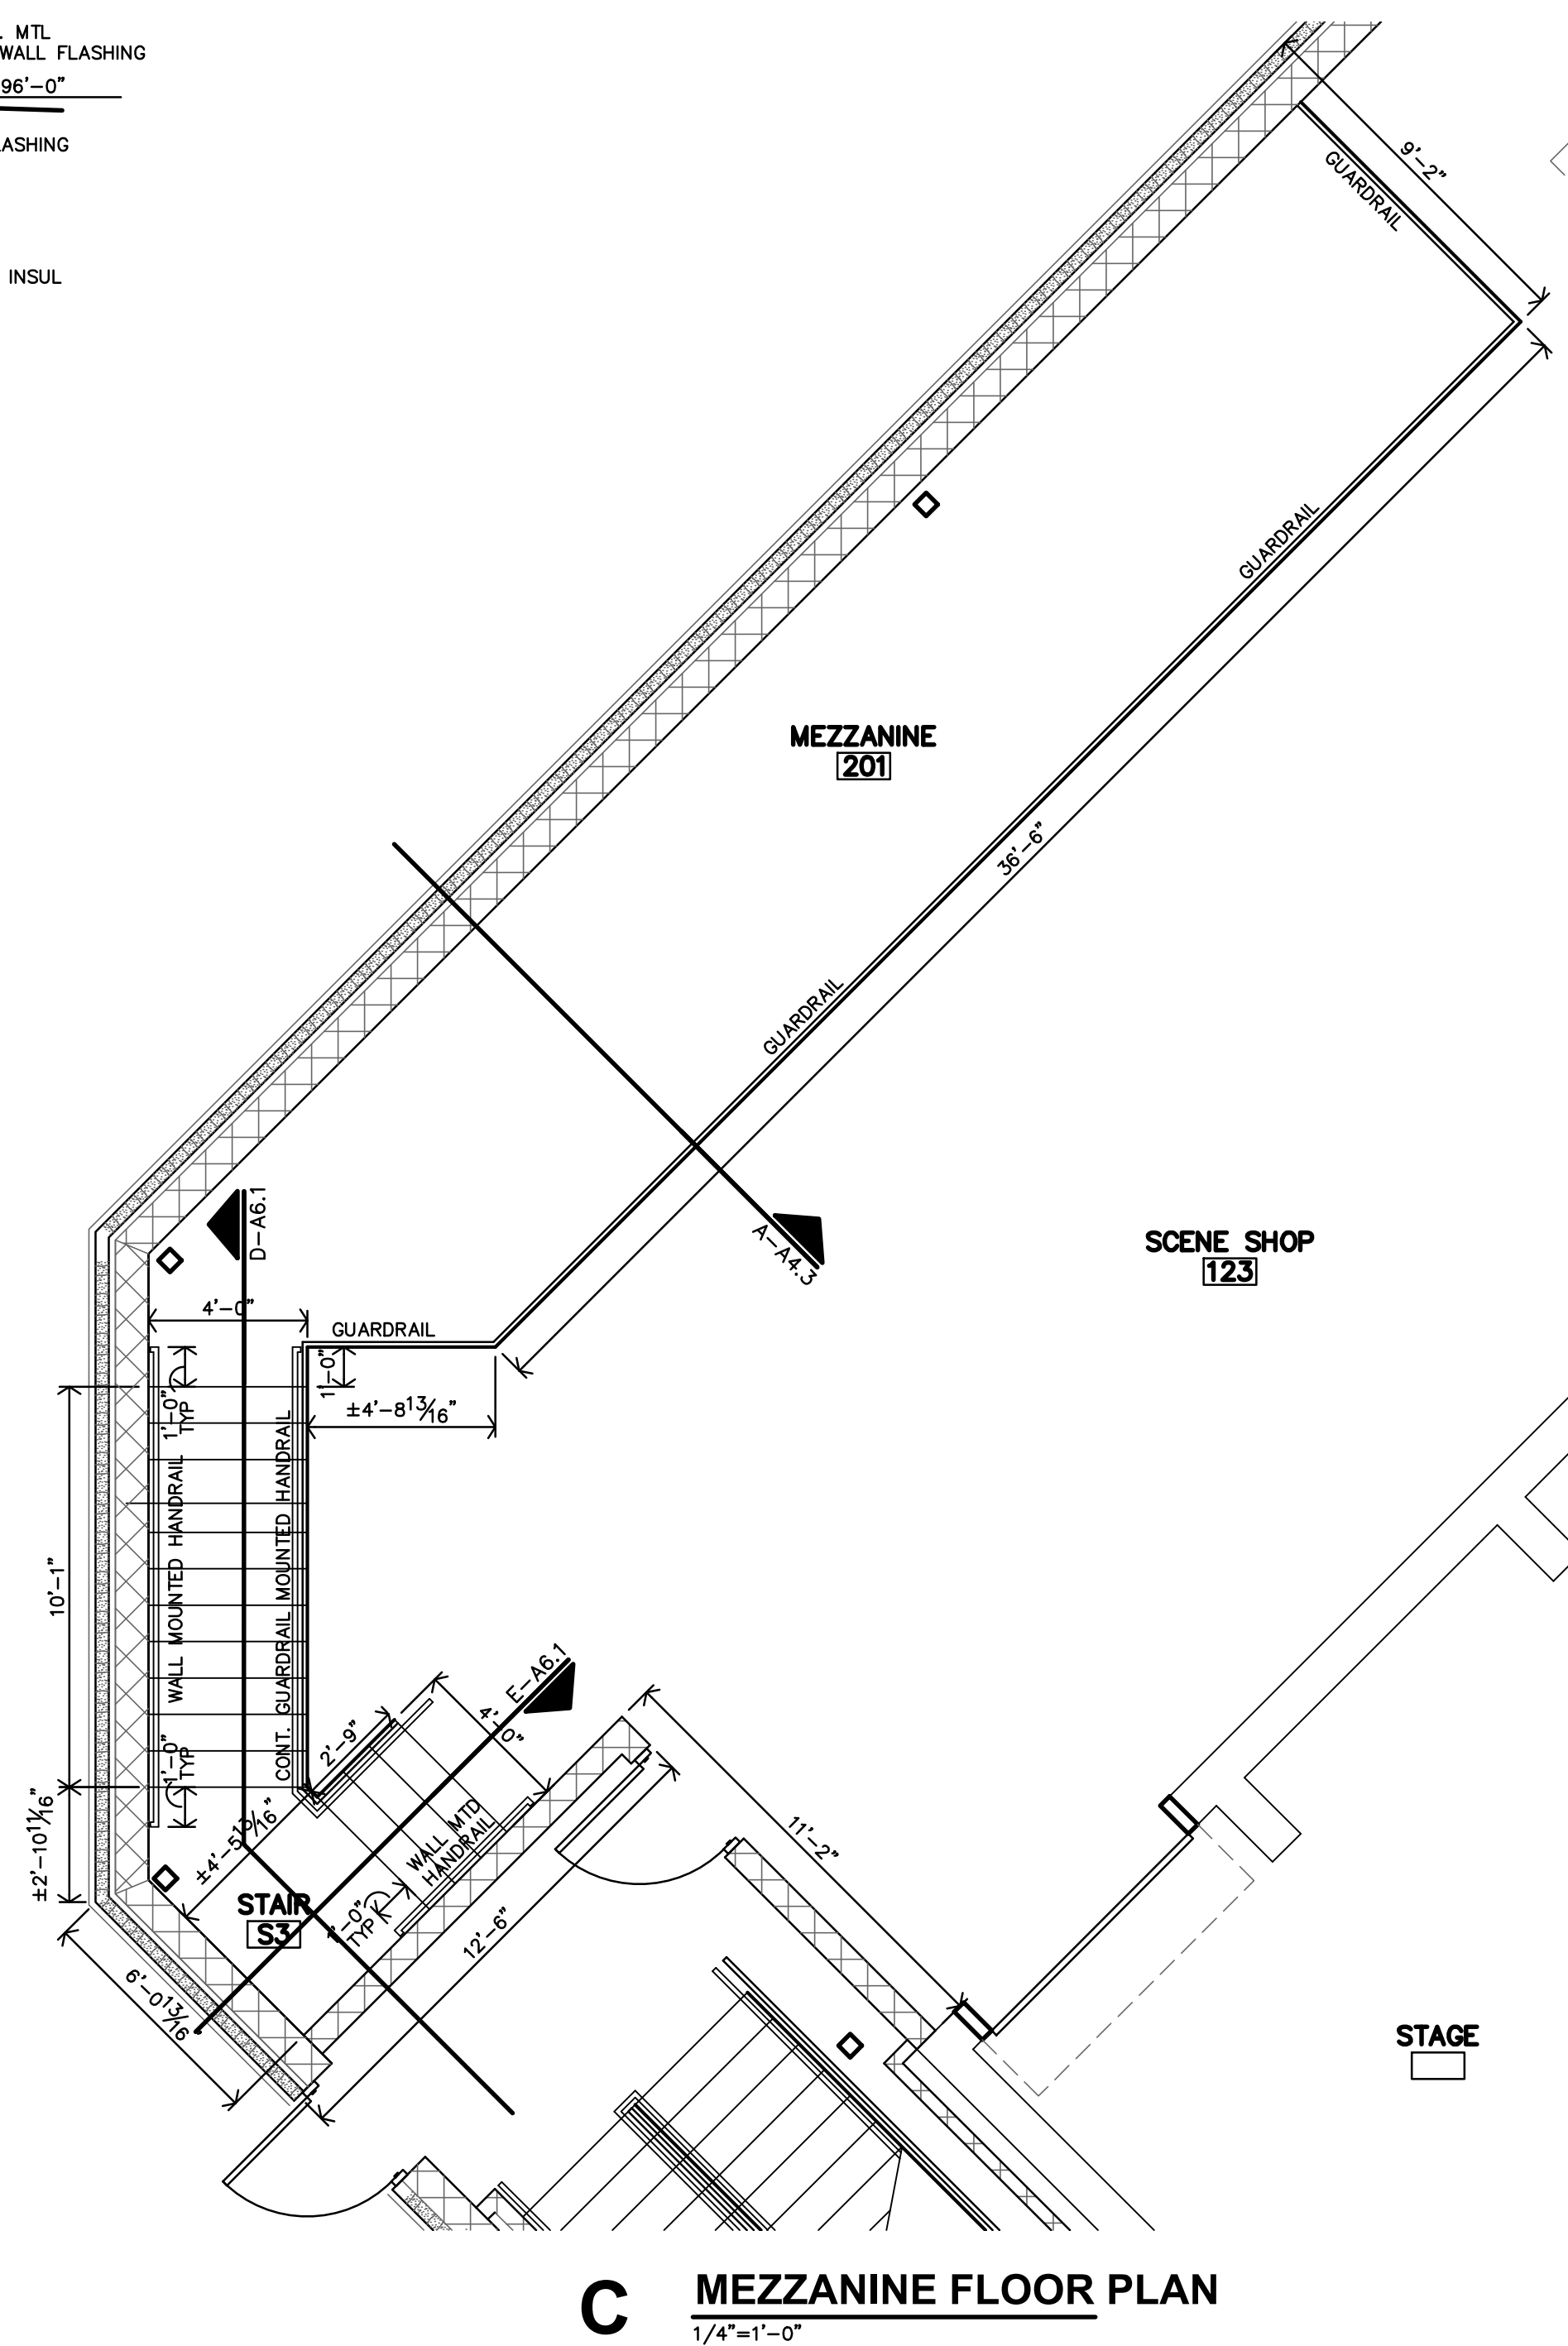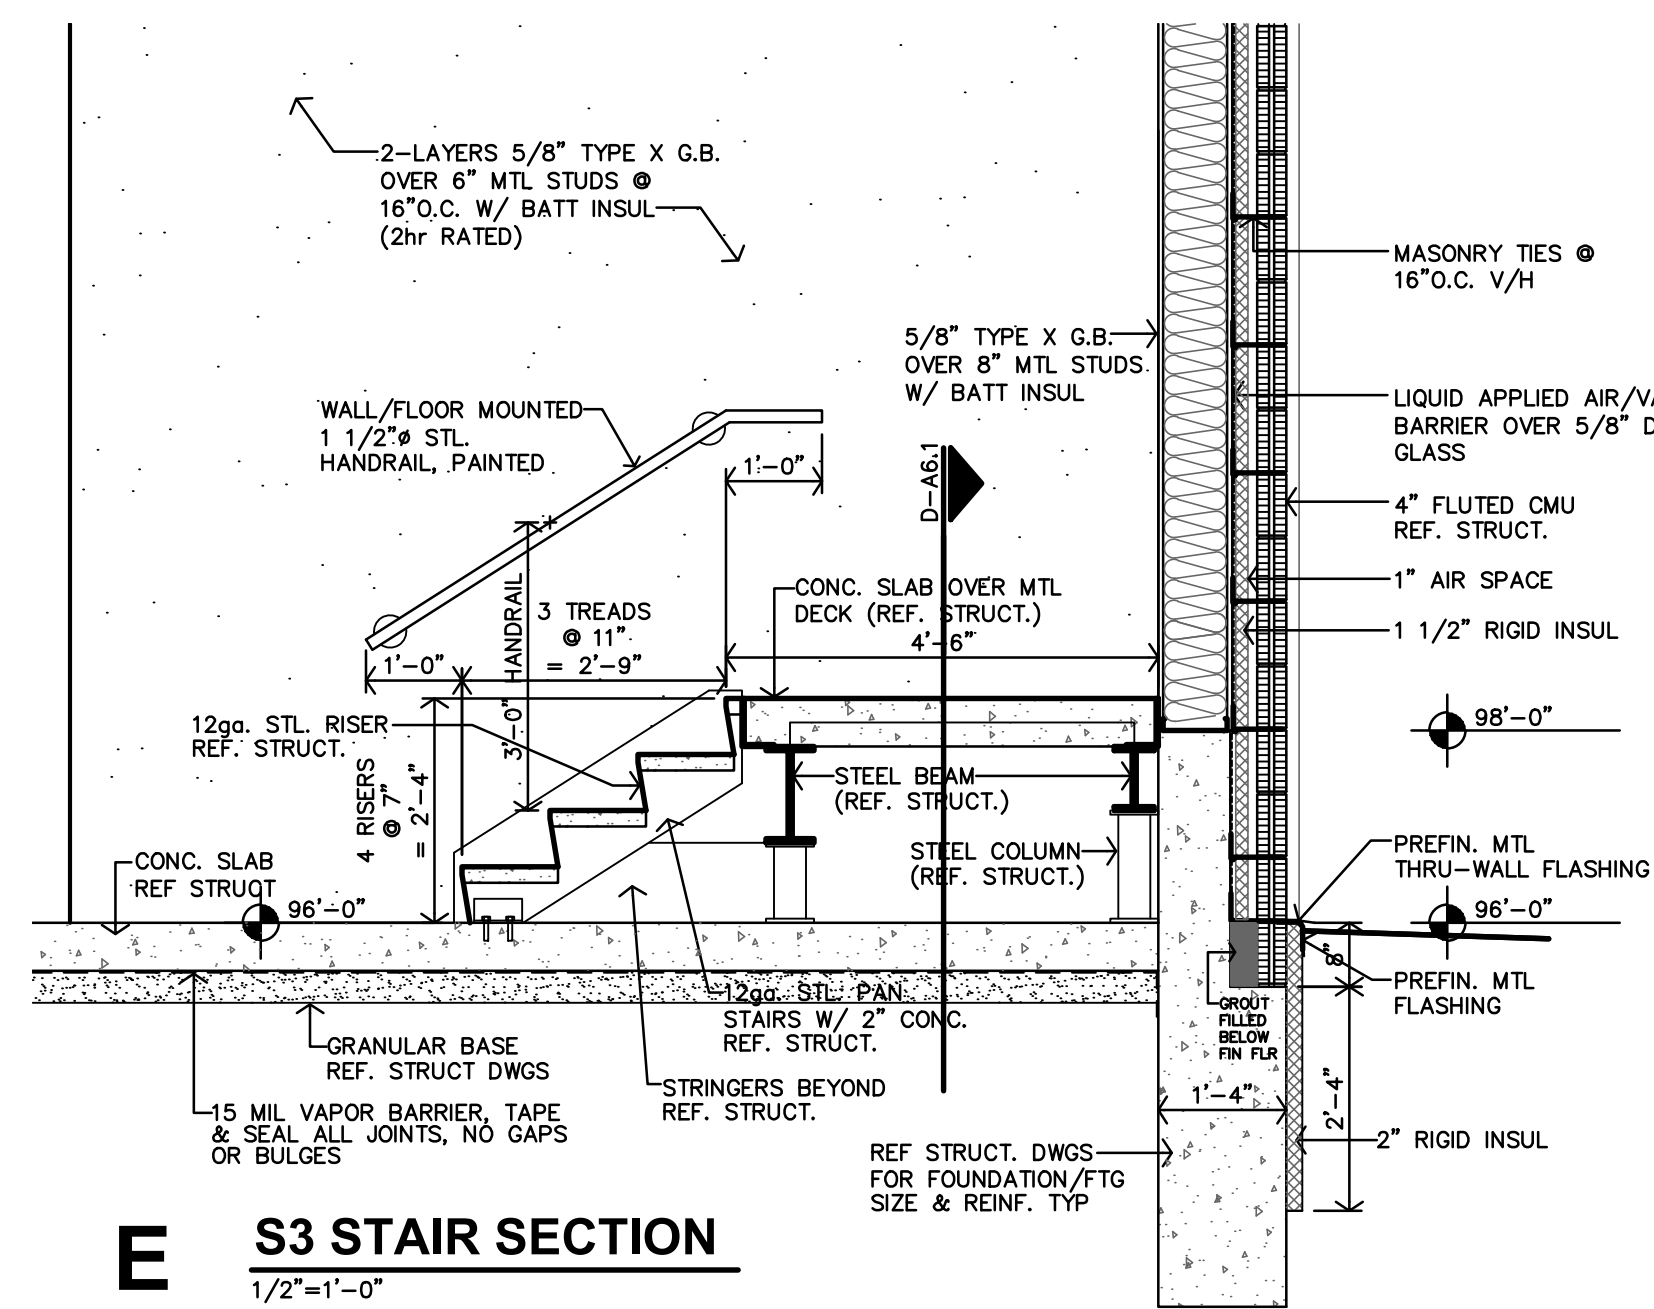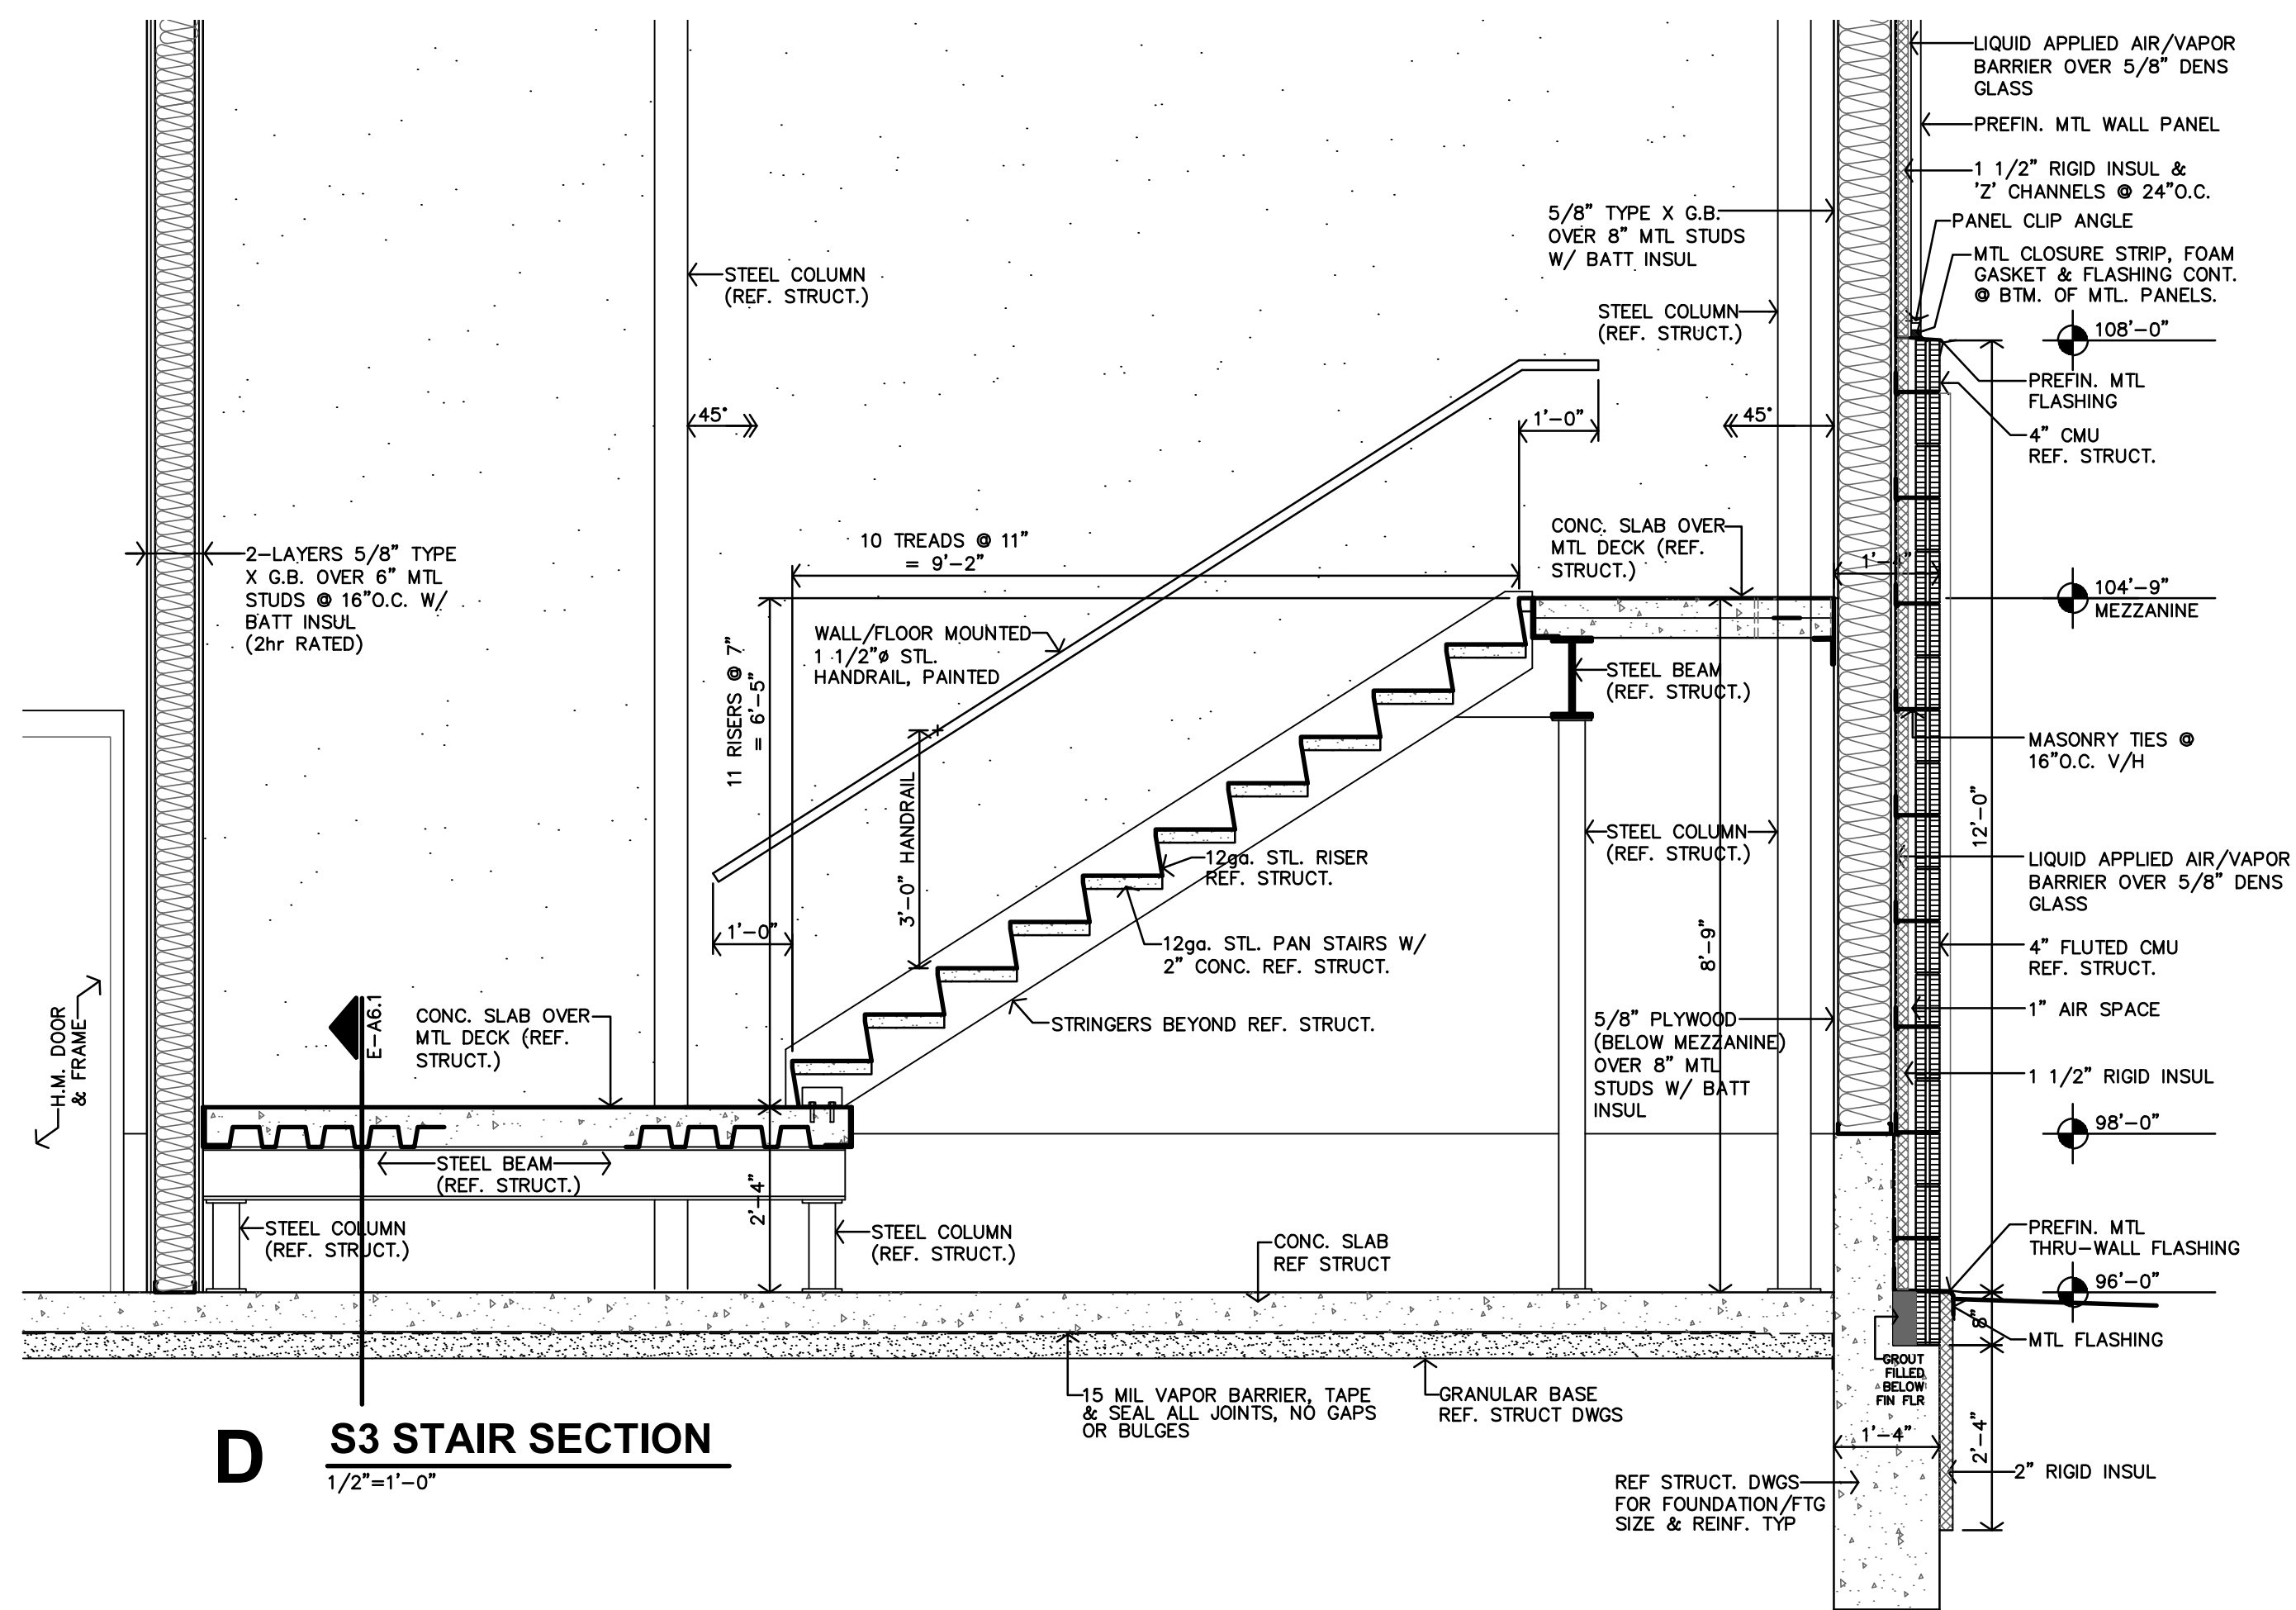











# REFLECTED CEILING PLAN NOTES

## GENERAL

1. CONTRACTOR SHALL COORDINATE CEILING LAYOUT WITH MECHANICAL AND ELECTRICAL FIXTURE LOCATIONS. NOTIFY ARCHITECT IMMEDIATELY OF ANY CONFLICT OF DISCREPANCY.
2. MECHANICAL/ELECTRICAL FIXTURES AT RATED CEILINGS SHALL BE HUNG IN CONFORMANCE TO U.L. SYSTEM REQUIREMENTS.
3. CEILING MOUNTED MECHANICAL EQUIPMENT AND SUSPENDED MECHANICAL EQUIPMENT MUST BE SUSPENDED DIRECTLY FROM THE STRUCTURE.
4. AREAS ABOVE THE FINISHED CEILING ARE PART OF A RETURN AIR PLENUM. ALL MATERIALS INCLUDING THE INSULATION SHALL HAVE FLAME SPREAD LESS THAN 25 AND SMOKE DEVELOPED LESS THAN 50.
5. SPECIAL CEILING GRID FRAMING IS REQUIRED AT SOME CEILING MOUNTED MECHANICAL EQUIPMENT. CONTRACTOR SHALL COORDINATE WITH MECHANICAL UNITS AND PROVIDE ALL SUSPENSION, TRIM, CLIPS, ETC. AS REQUIRED FOR A NEAT, FINISHED, AND SECURE CEILING SYSTEM.
6. WHERE SUSPENSION DEVICES, WIRES, RODS, ETC. PENETRATE CEILING GRID AND/OR TILE OR G.B. PENETRATIONS SHALL BE NEAT AND CLEANLY CUT. PENETRATION OPENING SHALL BE AS SMALL AS POSSIBLE. SEAL AT G.B. ALL SOUND WALLS SHALL EXTEND TO STRUCTURE OR DECK, TAPE SEAL AT TOP.
7. SEAL VOIDS AT TOPS OF WALLS AND PENETRATIONS WITH U.L. LISTED FIRE BATT INSULATION, PILLOWS, AND/OR FIRE SEALANT AS REQUIRED BY CONDITION AT RATED WALLS.

## CEILING TYPES


REFER SPECIFICATIONS

1	2x2 FISSURED ACOUSTICAL TILE
2	2x2 SMOOTH ACOUST. TILE (BLACK TILE & GRID)
AC	ACOUSTICAL DECK
GB	GYP BD (PAINTED)
GBA	ACOUSTICAL GYP BD (PAINTED)
ST	EXPOSED STRUCTURE & DECK
1	CLG. TYPE
8'-8"	CLG. HEIGHT A.F.F.




## G.B. REVEAL DETAIL

3/8"=1'-0"

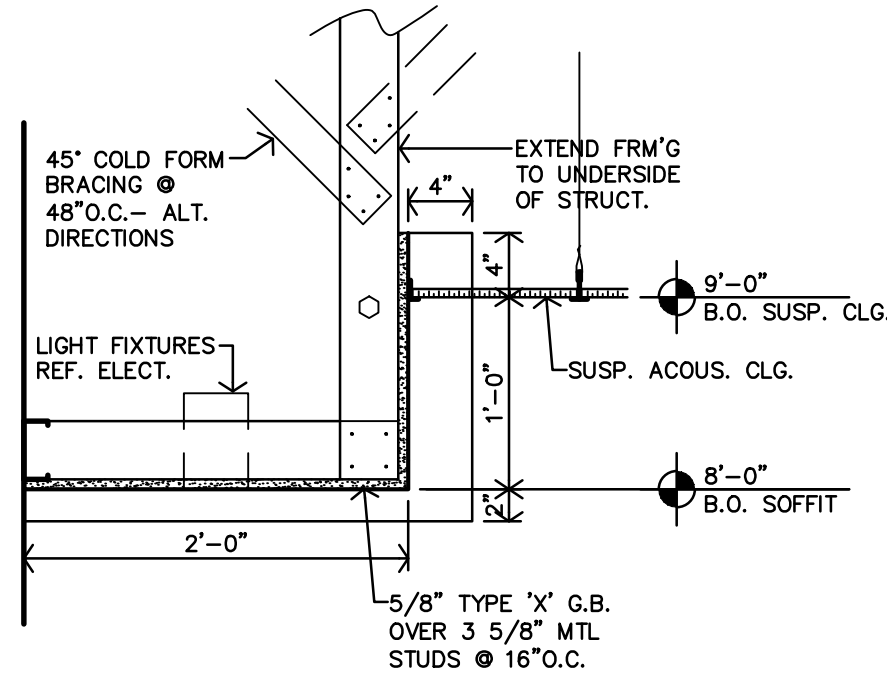


## CEILING DETAIL

1/8"=1'-0"

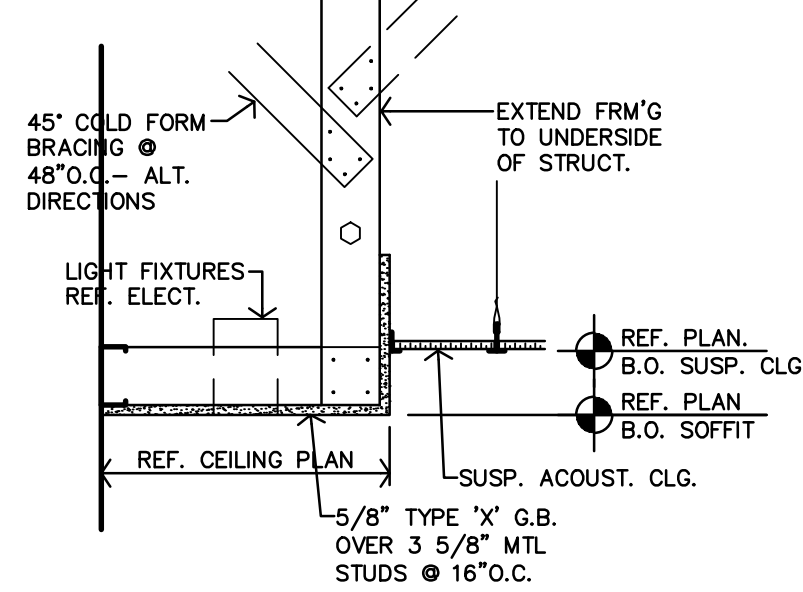

## TYP. CEILING DETAIL

1/8"=1'-0"

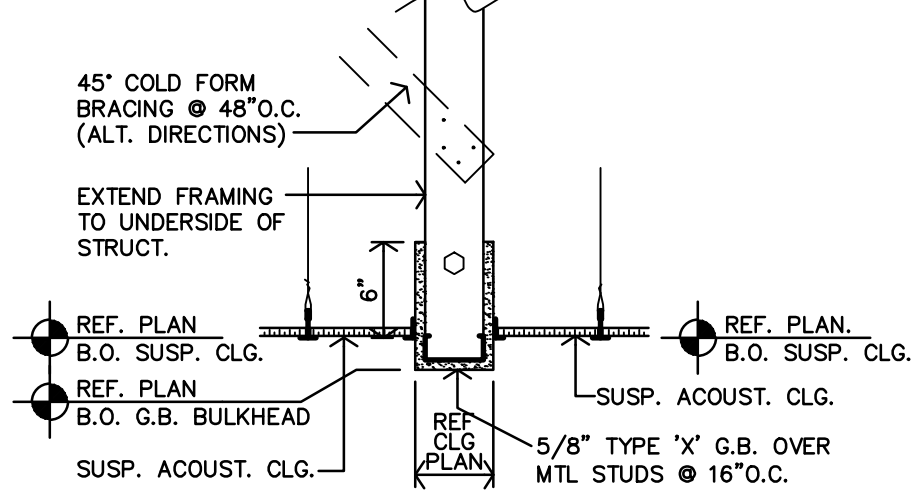

## TYP. CEILING DETAIL



1/8"=1'-0"



B

## PARTIAL BASEMENT REFLECTED CEILING PLAN

1/8"=1'-0"

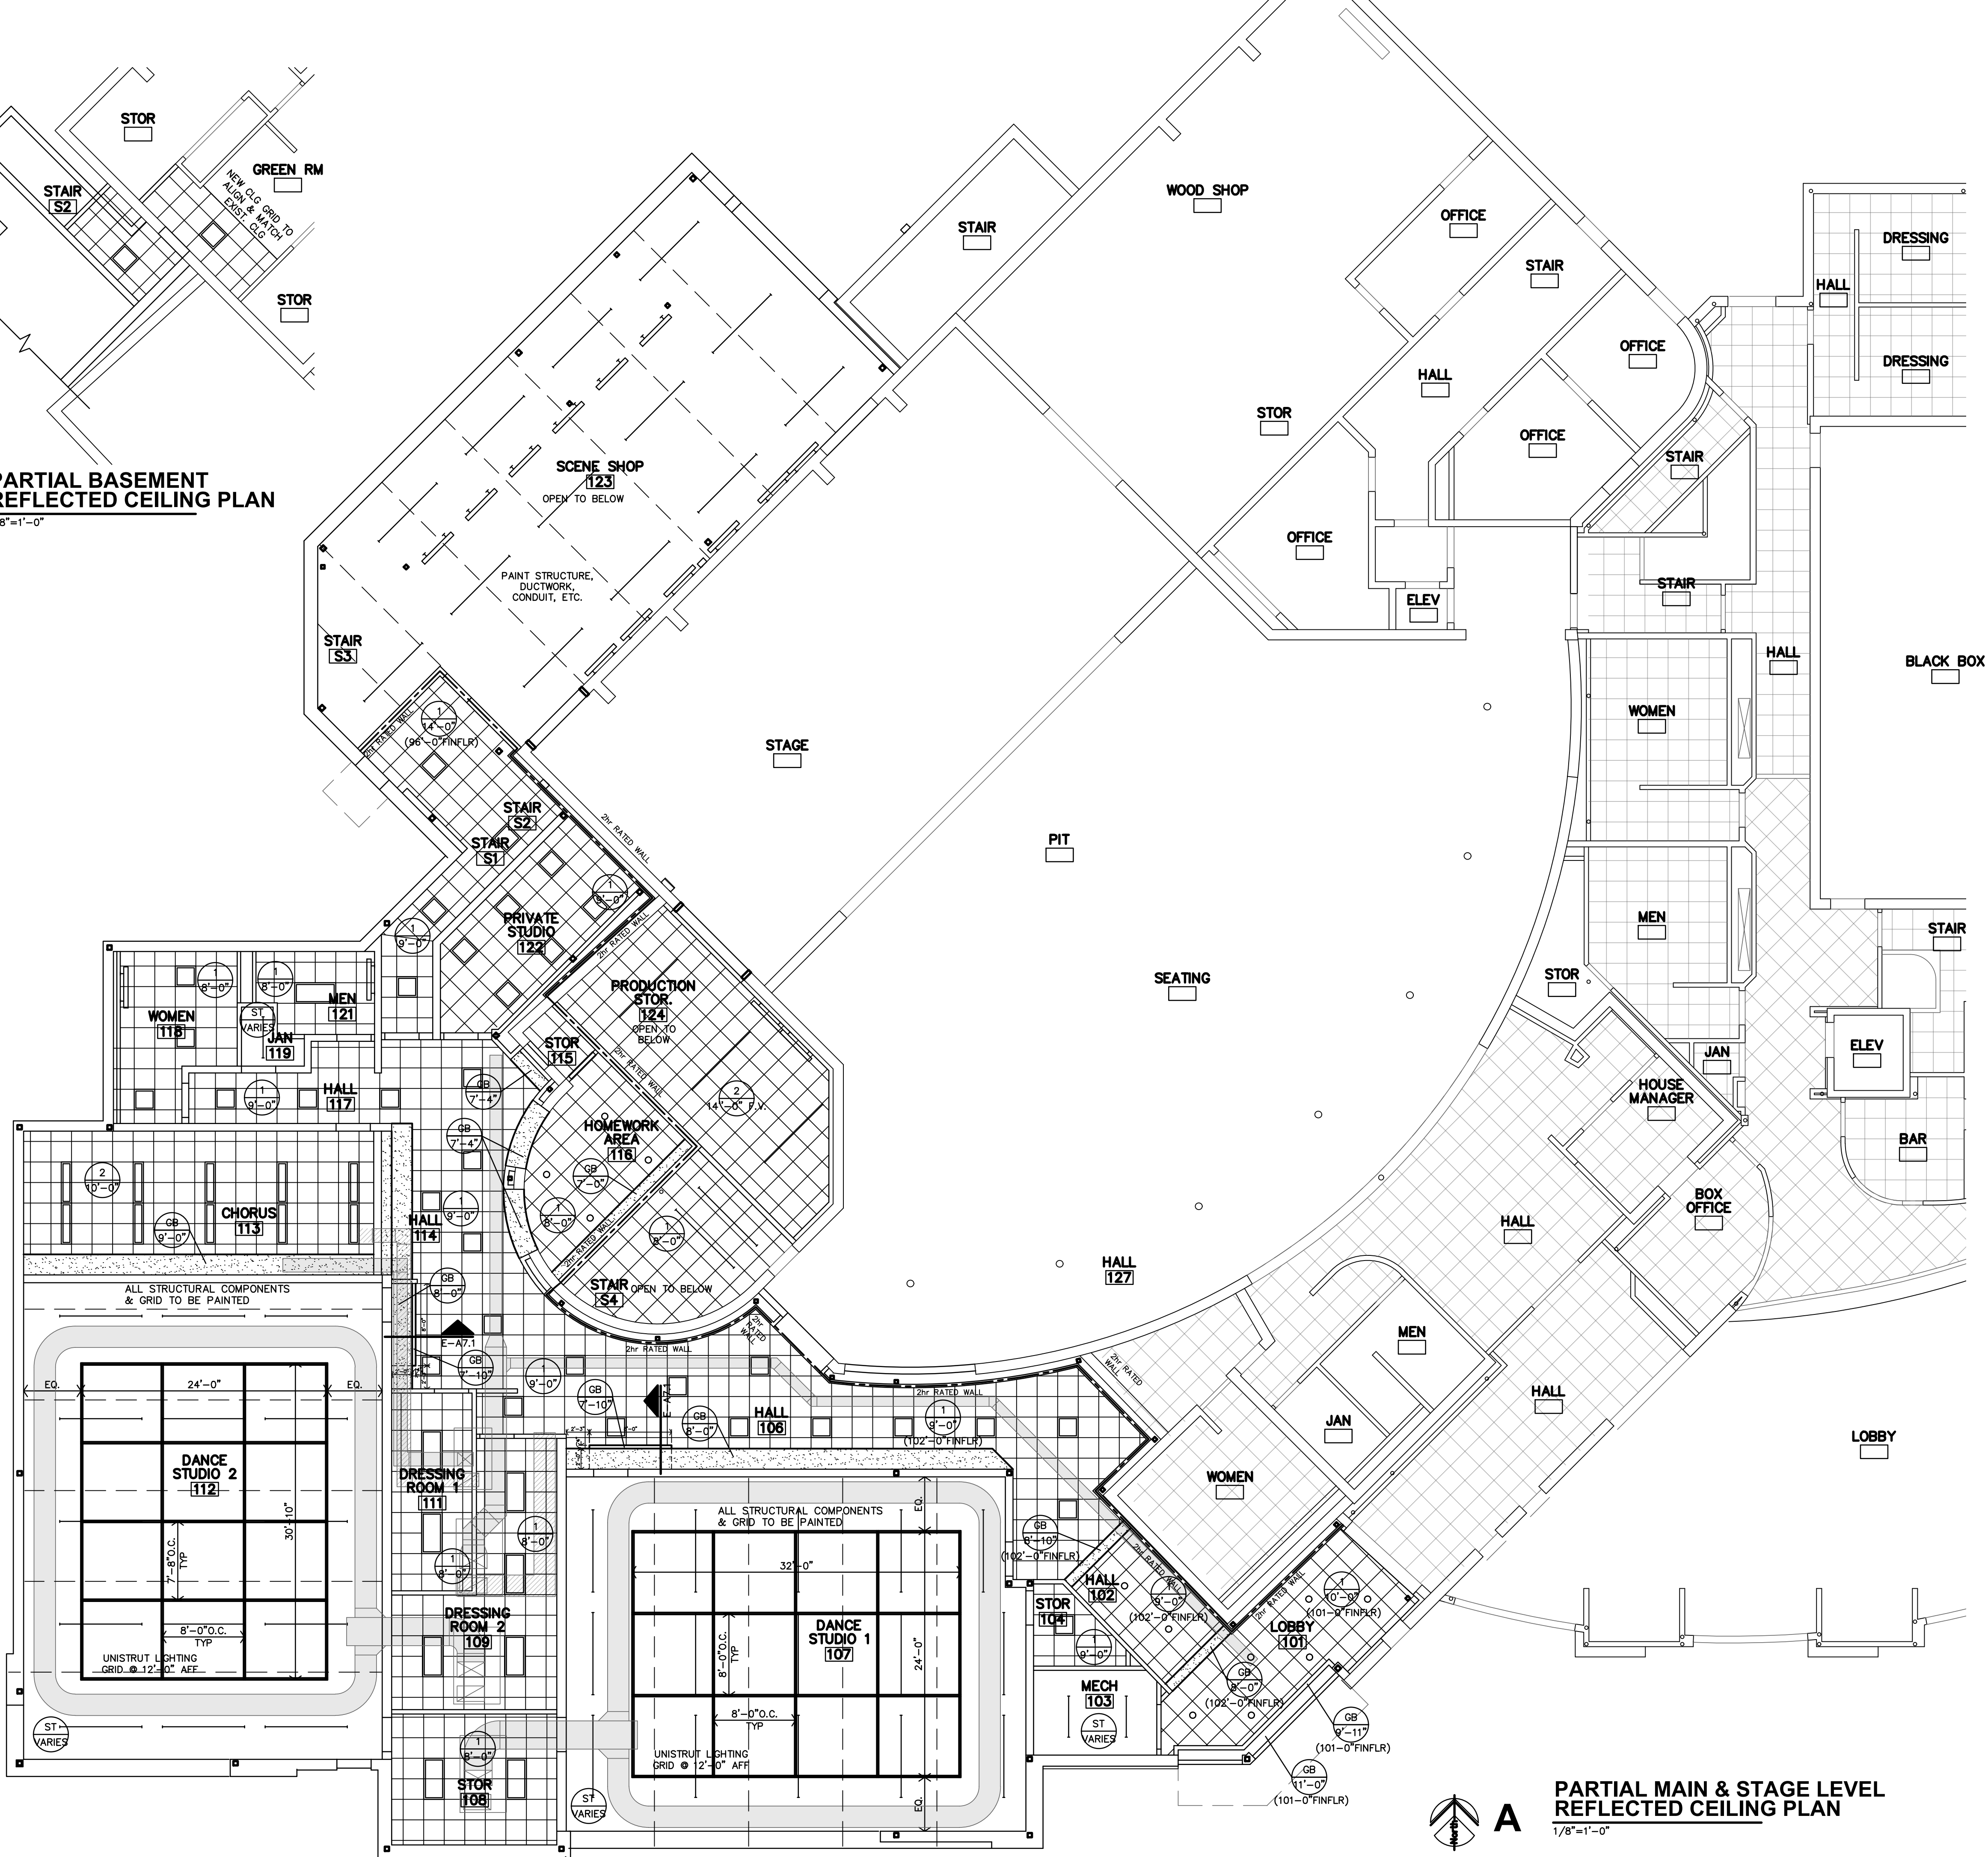

A


## PARTIAL MAIN & STAGE LEVEL REFLECTED CEILING PLAN

1/8"=1'-0"

JonesGillamRenz  
1881 Main Street, Suite 301  
Salina, KS 67401  
785.827.0386  
jgr@jgrarchitects.com

JGR

THEATRE SALINA  
DANCE STUDIOS & SCENE SHOP EXPANSION  
SALINA, KANSAS

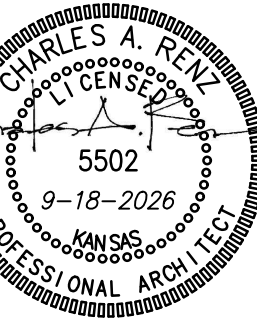

REVISION:

DATE: 9-18-2026


JOB: 22-3239

SHEET NO.:


A7.1

COPYRIGHTED ©



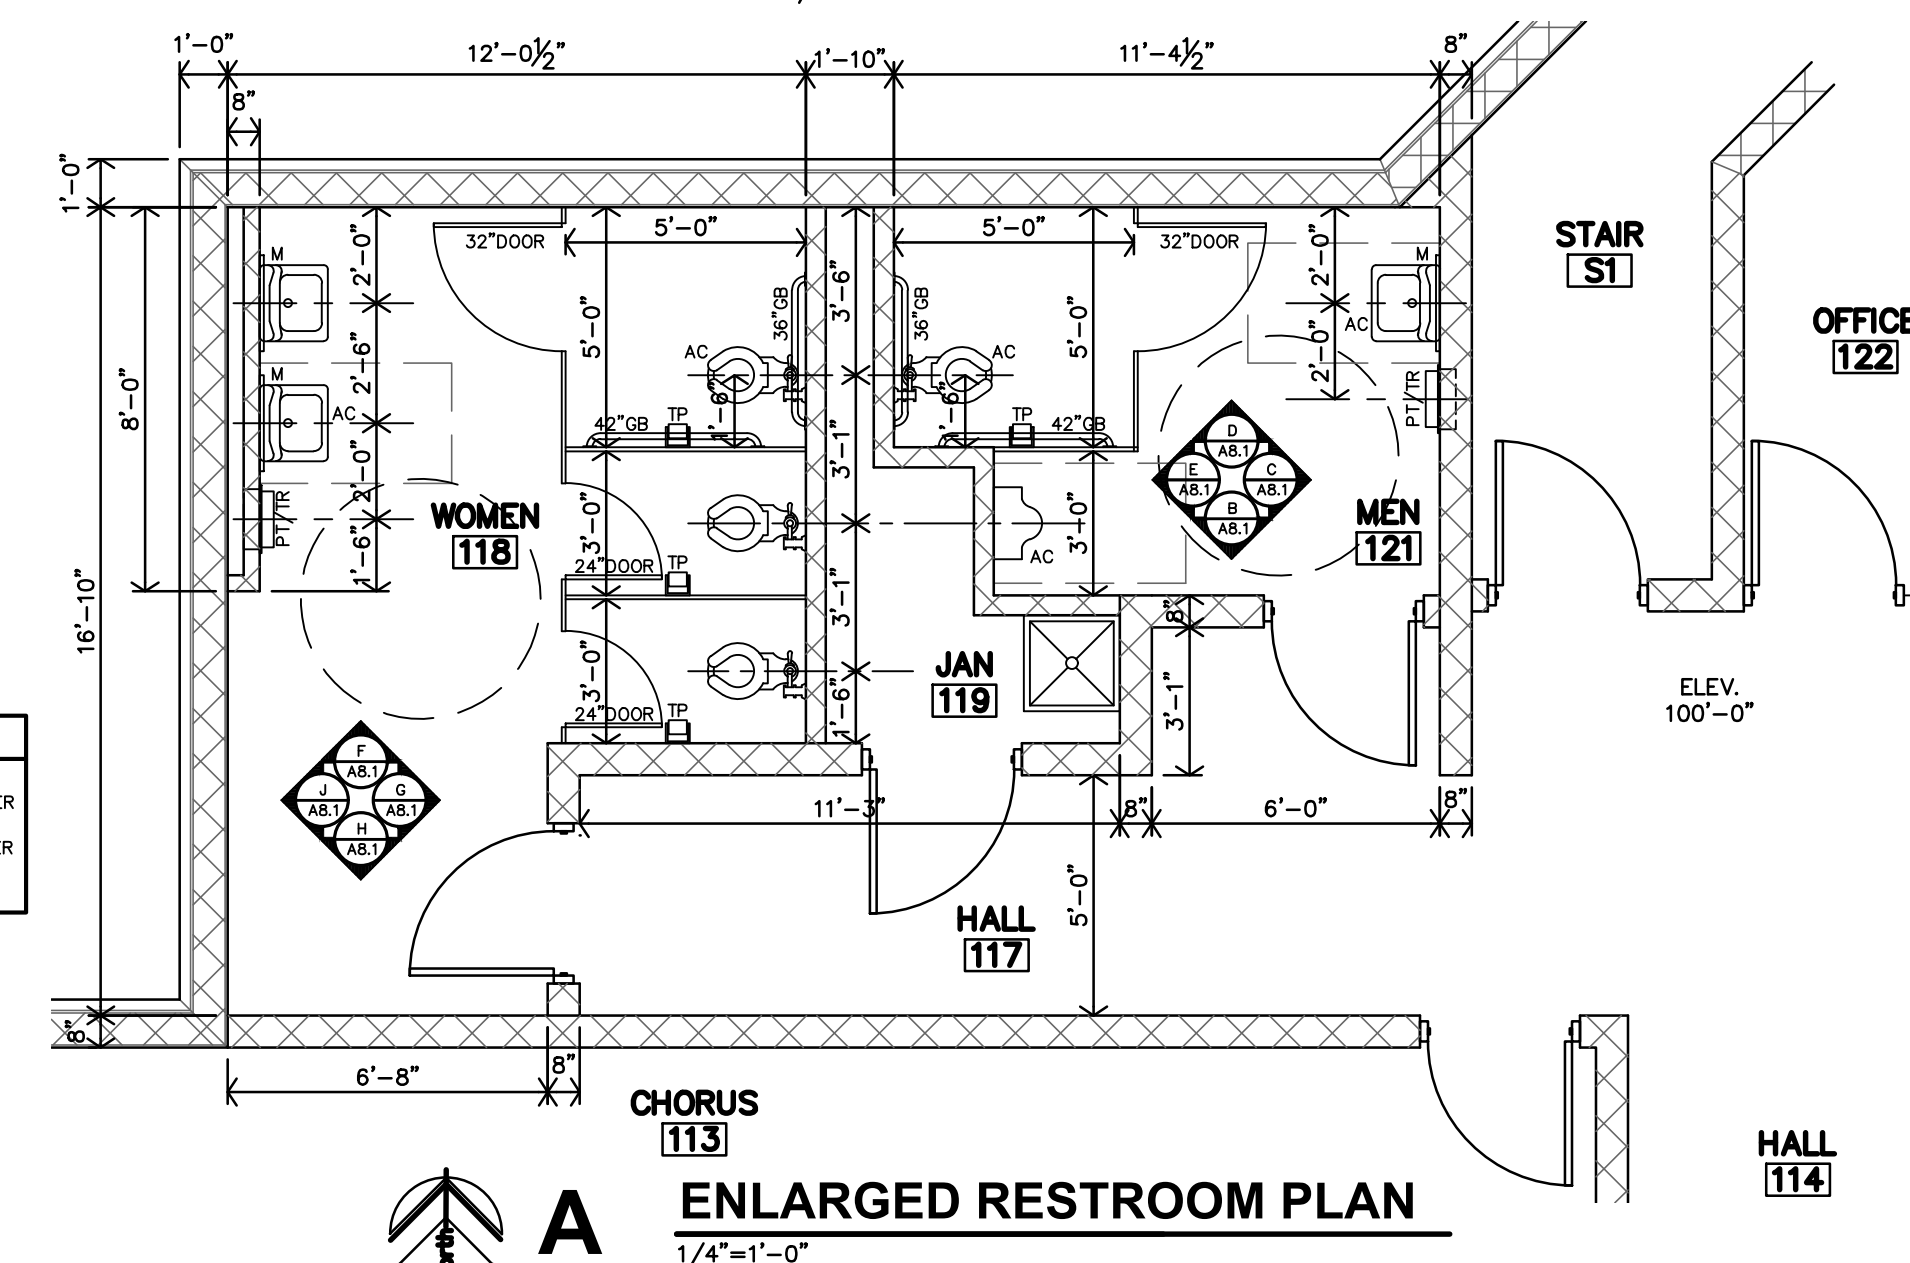




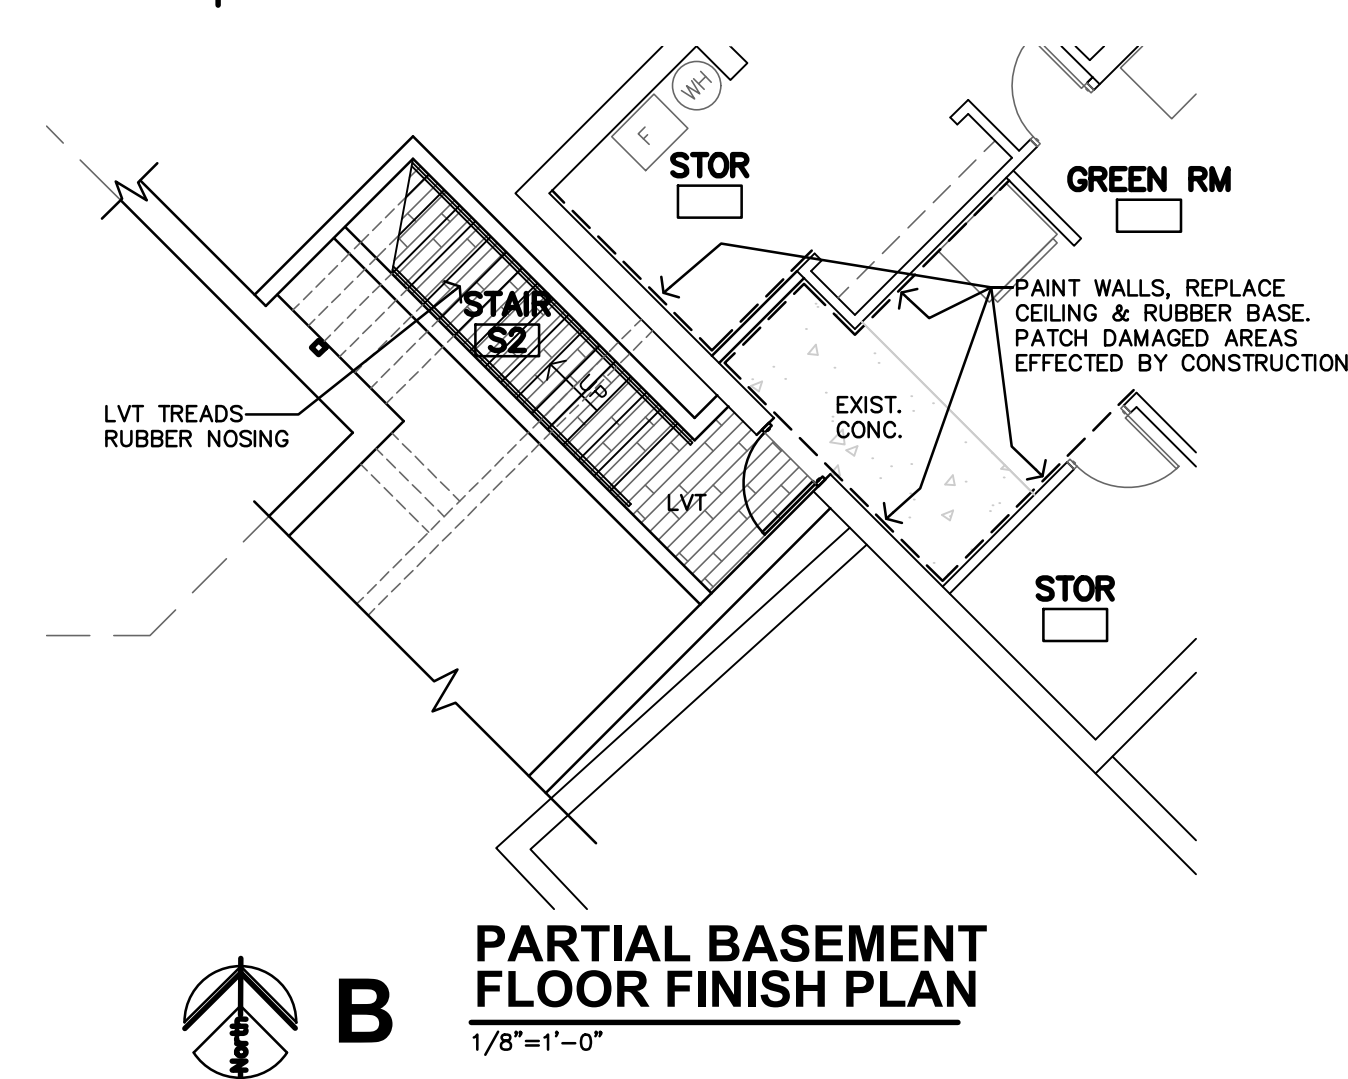

- A. NEW FLOOR TILES ARE TO BE INSTALLED AS INDICATED ON PLAN WITH FULL TILES WHEREVER POSSIBLE. SEE FINISH SCHEDULE FOR SPECIFICATIONS.
- B. ALL FLOOR FINISHES SHALL BE INSTALLED WITH TOP EDGES LEVEL W/ ADJACENT WALL TOP EDGES. TOP EDGES OF ALL FINISHES THESE MAY VARY. CONFIRM THAT NO OVERALL FLOATING OF FLOOR IS REQUIRED.
- C. COORDINATE FLOORING TRANSITIONS & BASE LINE INSTALLATION W/ MILLWORK, PARTITIONS & CASEWORK.
- D. ALL THRESHOLDS SHALL HAVE A MAX HEIGHT OF 1/2" ABOVE EXISTING CONCRETE SLAB &/OR INTERIOR FINISHES.
- E. FLOOR FINISHES SHALL BE INSTALLED TO SPEC ON ALL FLOOR COVERINGS.
- F. TILE TRANSITIONS BETWEEN ROOMS TO BE CENTERED ON DOOR FRAME.
- G. SEE PLUMBING DRAWINGS FOR DIMENSIONS & LOCATIONS OF FLOOR DRAINS & SINKS.
- H. INSTALL ALUMINUM TRANSITION STRIPS/TRIM AT OFFERING MATERIALS.

KEY	KEYNOTE TEXT
1	RESTROOM FLOOR TILE TO START AT CENTER OF FLOOR DRAIN.
2	
3	

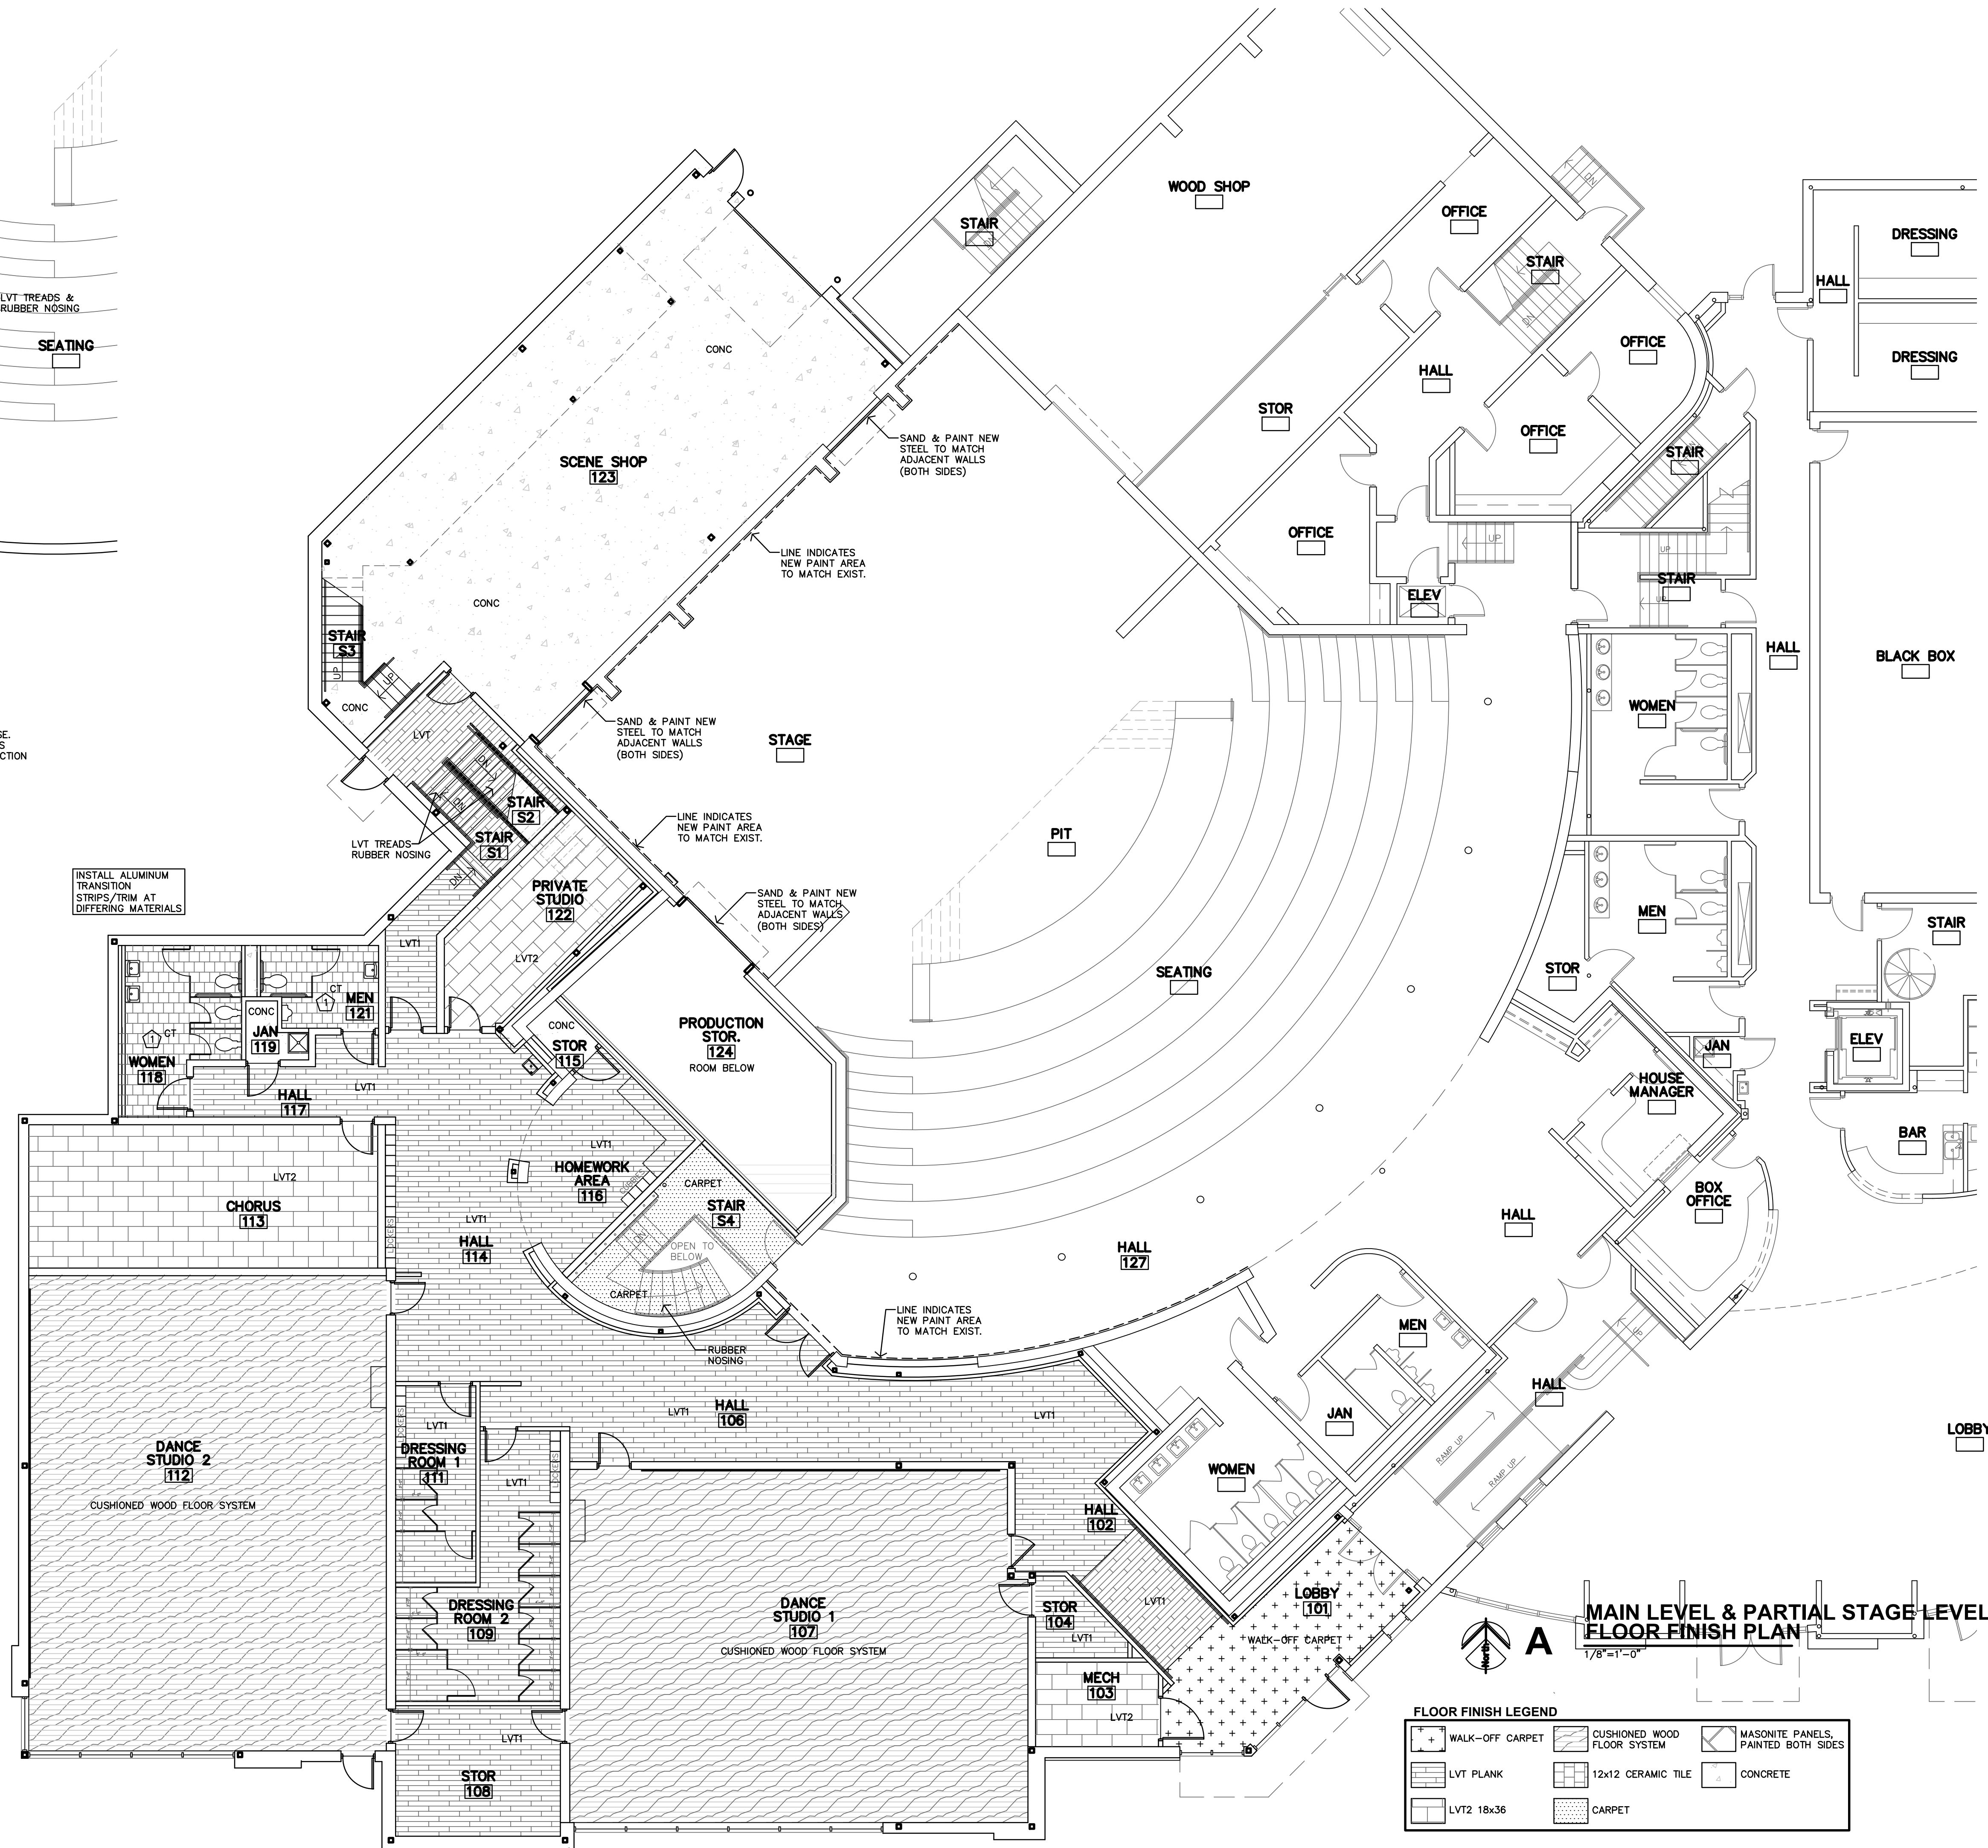




**N**


MOLDED G.B. REVEAL  
FRY-REGLET MODEL  
DRM 50x25

**G.B. REVEAL  
DETAIL**  
3/4"=1'-0"

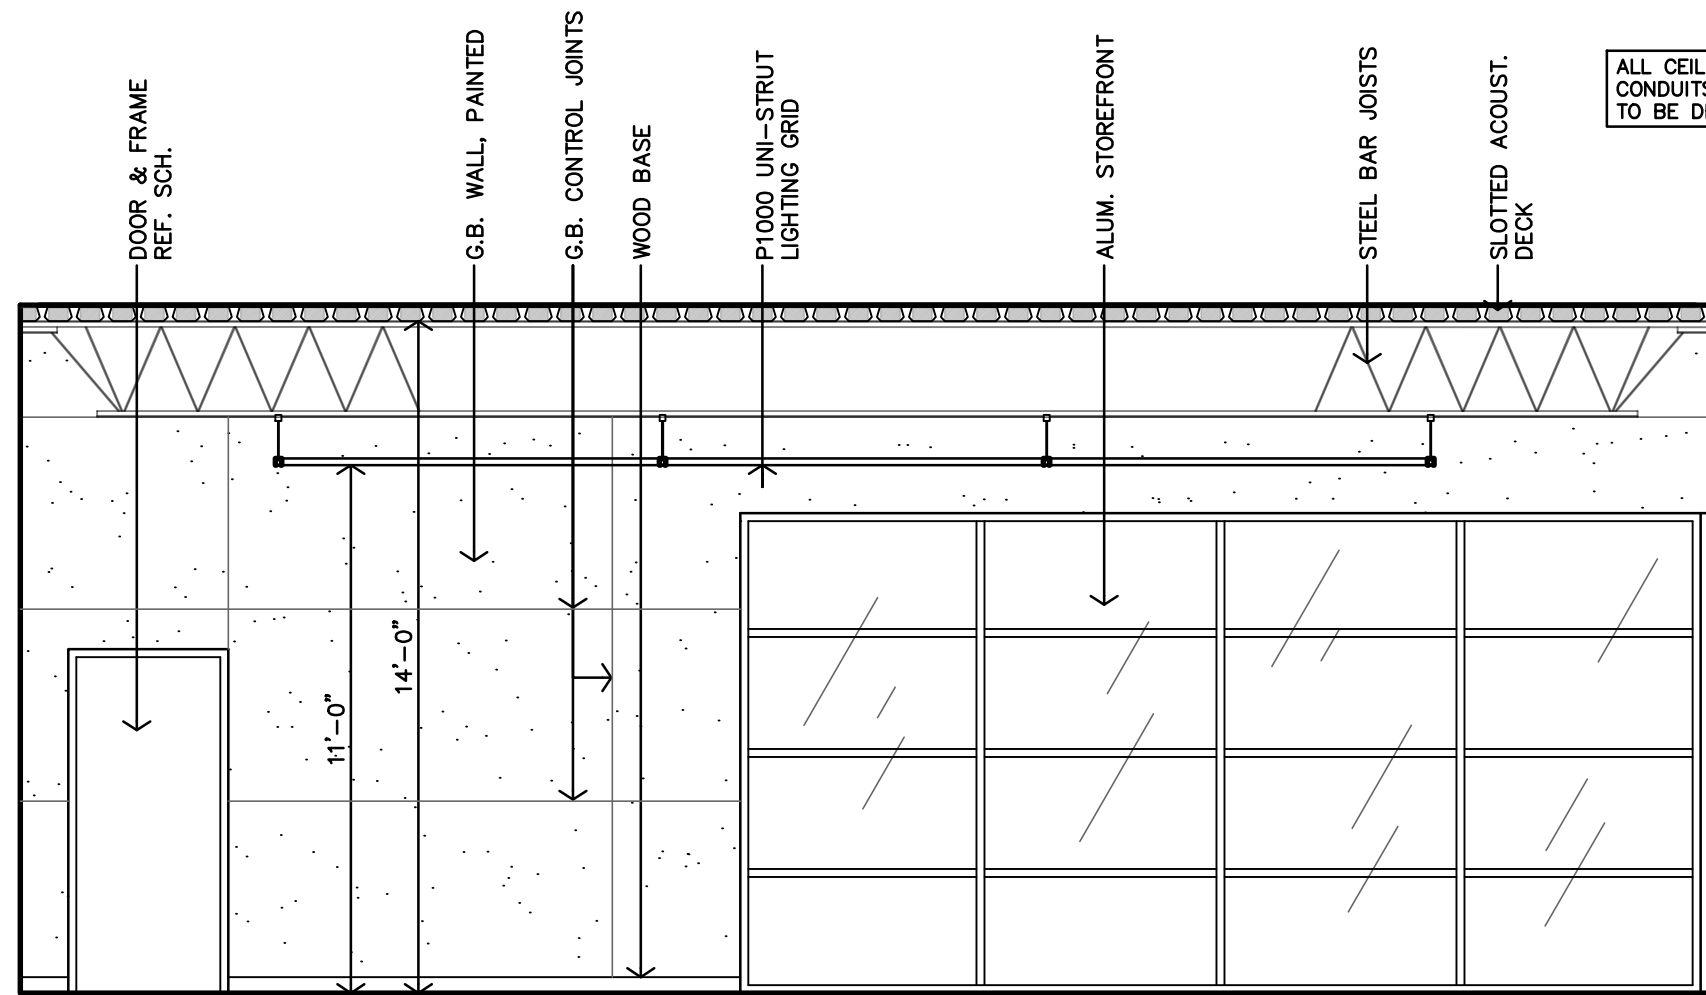


**F**

**DANCE STUDIO 2 #112  
INTERIOR ELEVATION**  
1/4"=1'-0"

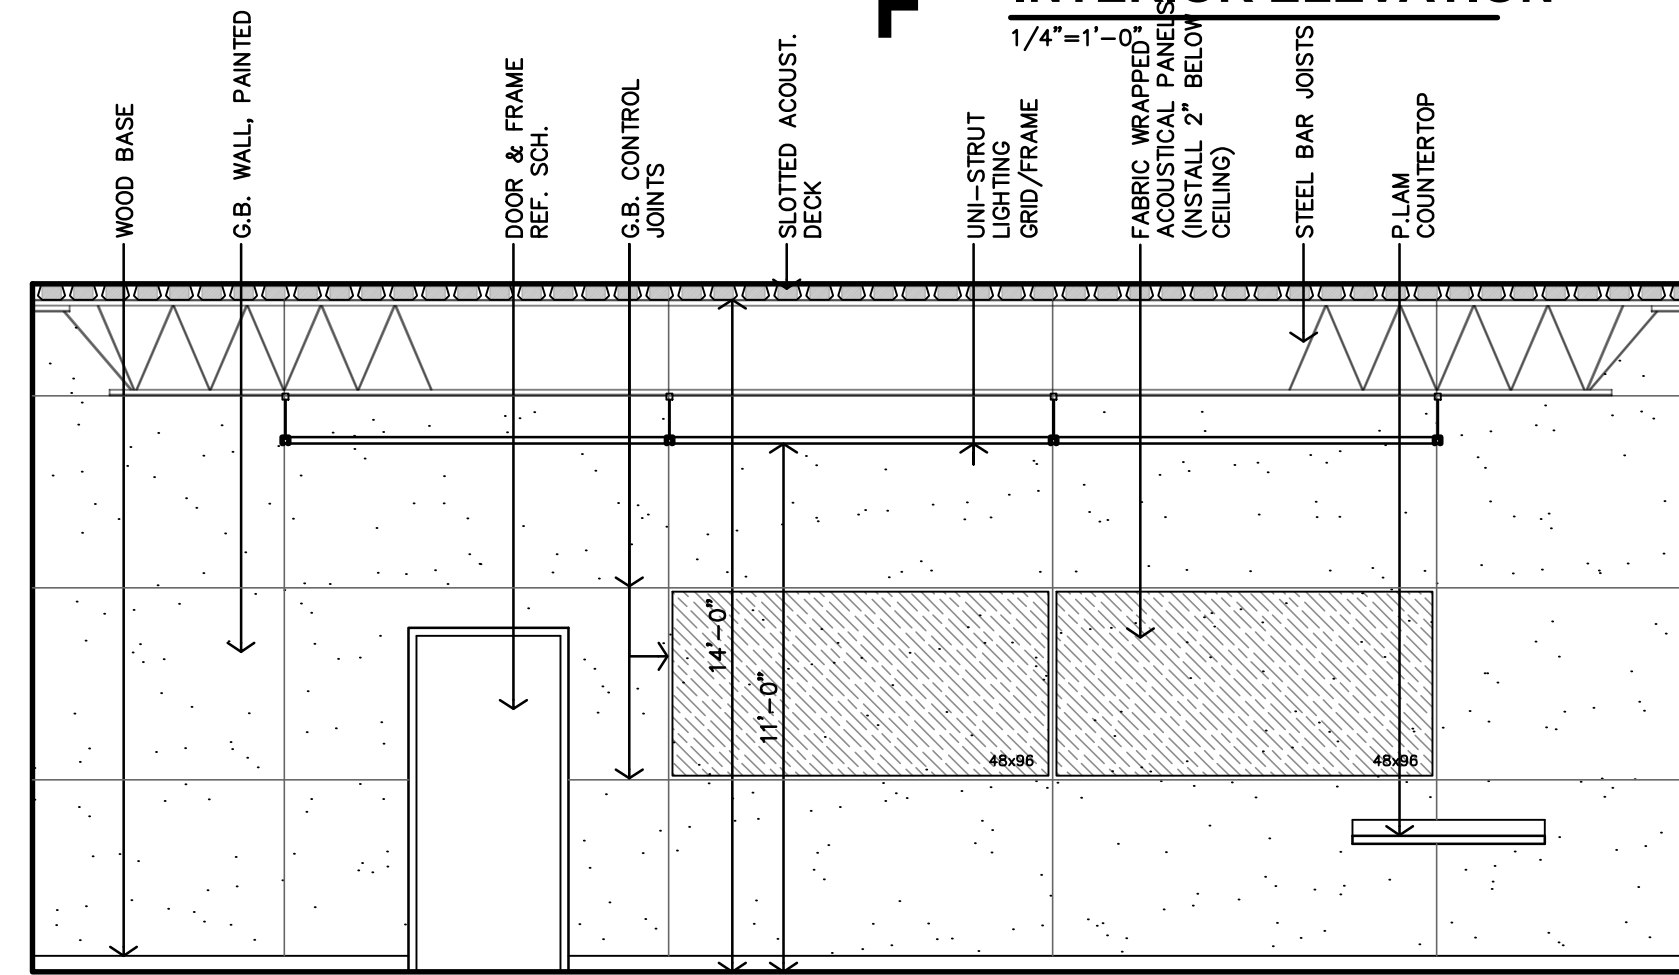


**C**

**DANCE STUDIO 1 #107  
INTERIOR ELEVATION**  
1/4"=1'-0"

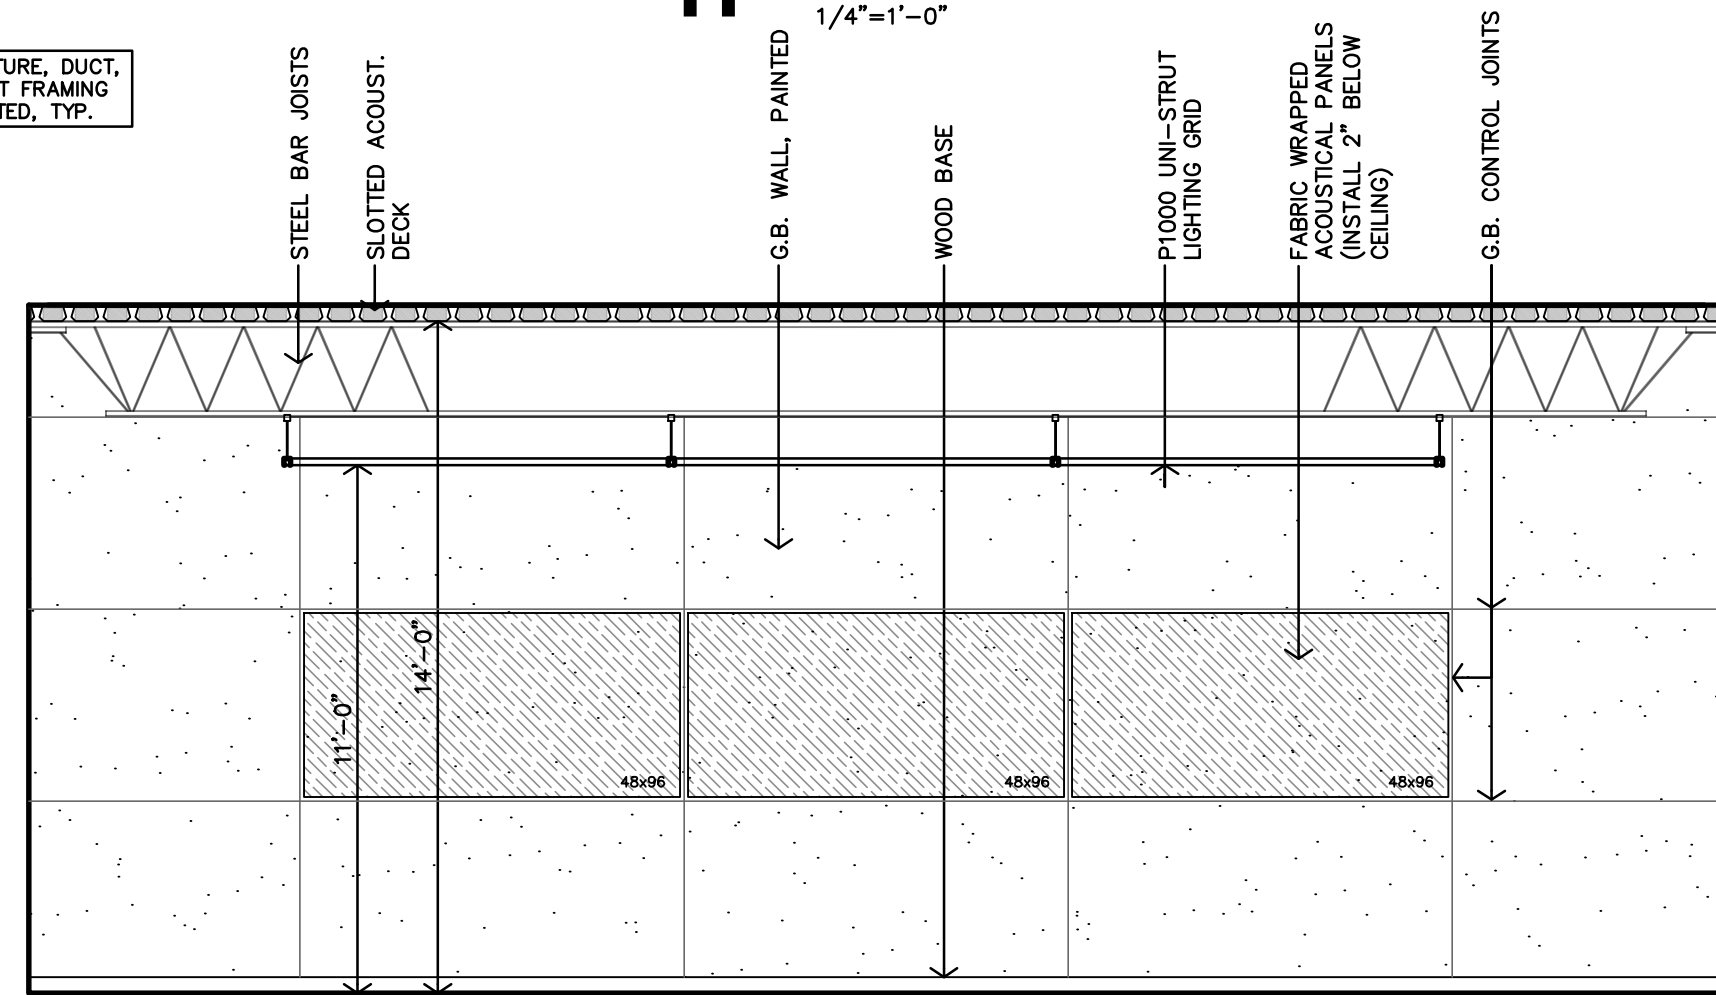


**H**

**DANCE STUDIO 2 #112  
INTERIOR ELEVATION**  
1/4"=1'-0"

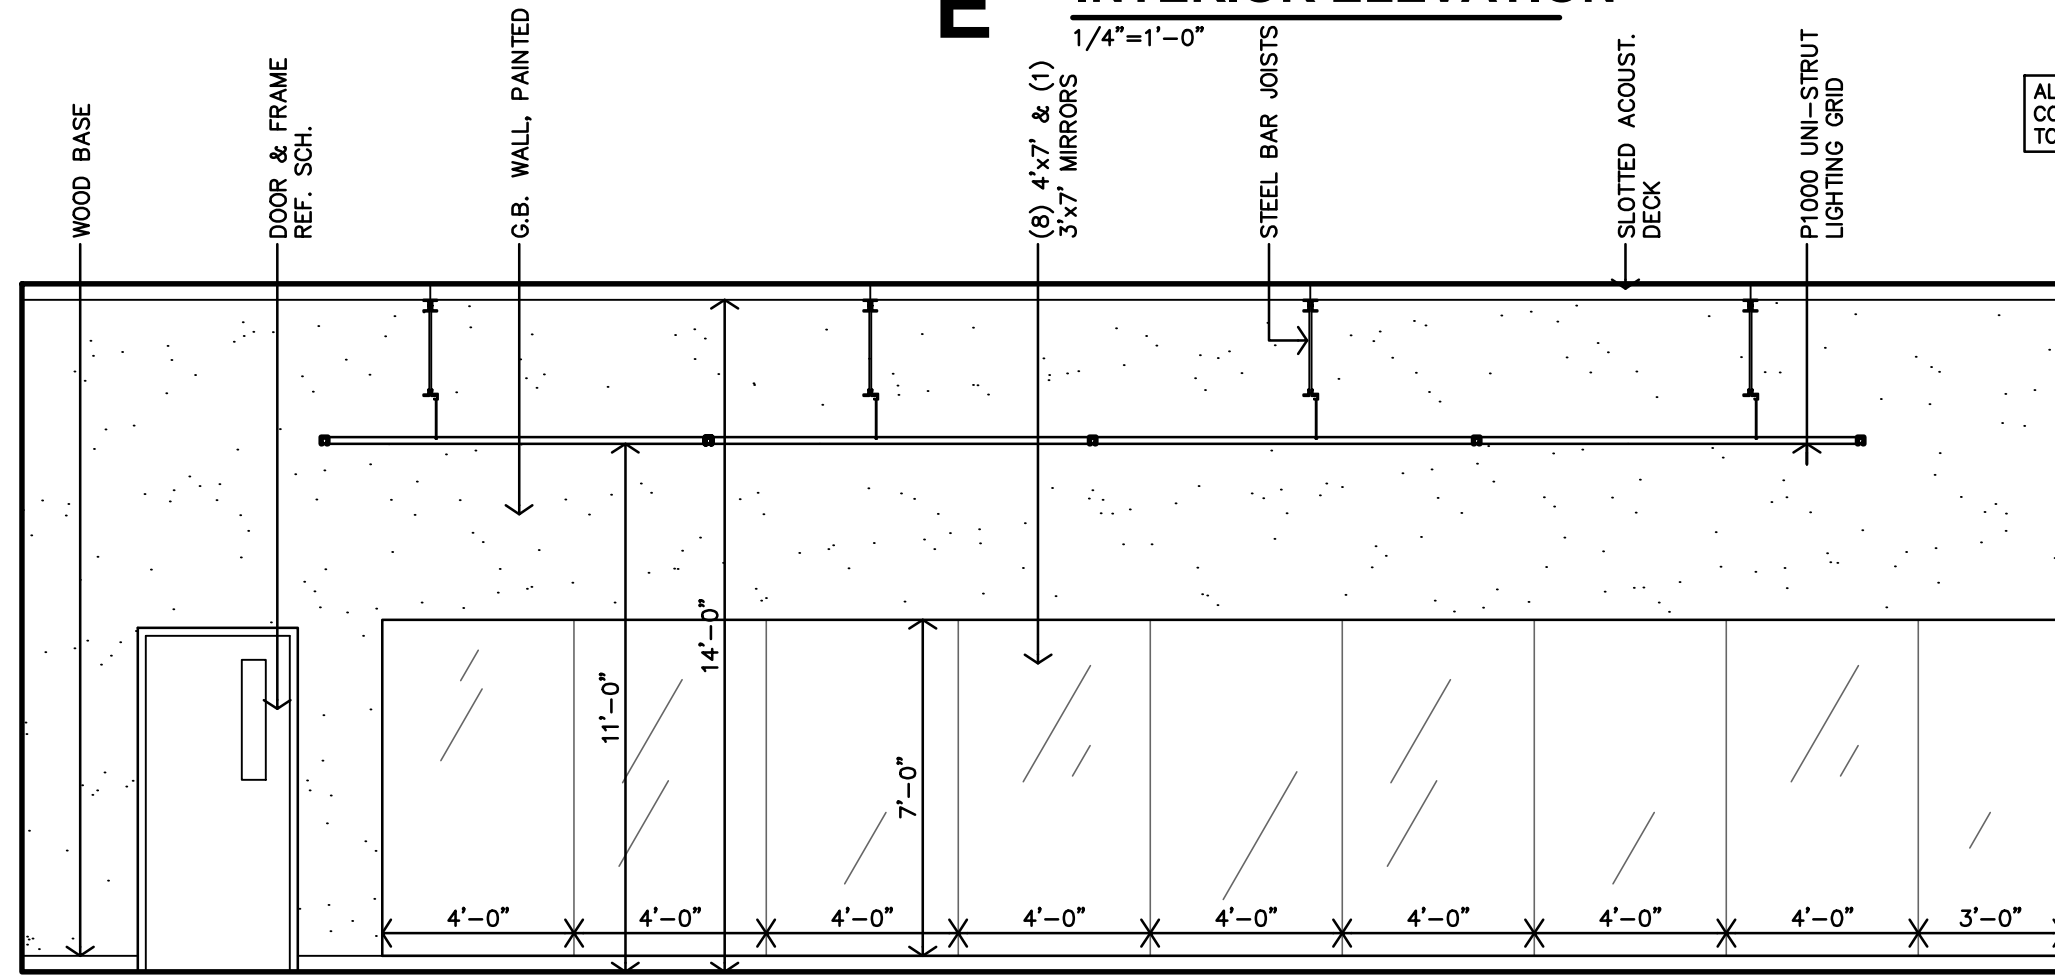


**E**

**DANCE STUDIO 2 #112  
INTERIOR ELEVATION**  
1/4"=1'-0"

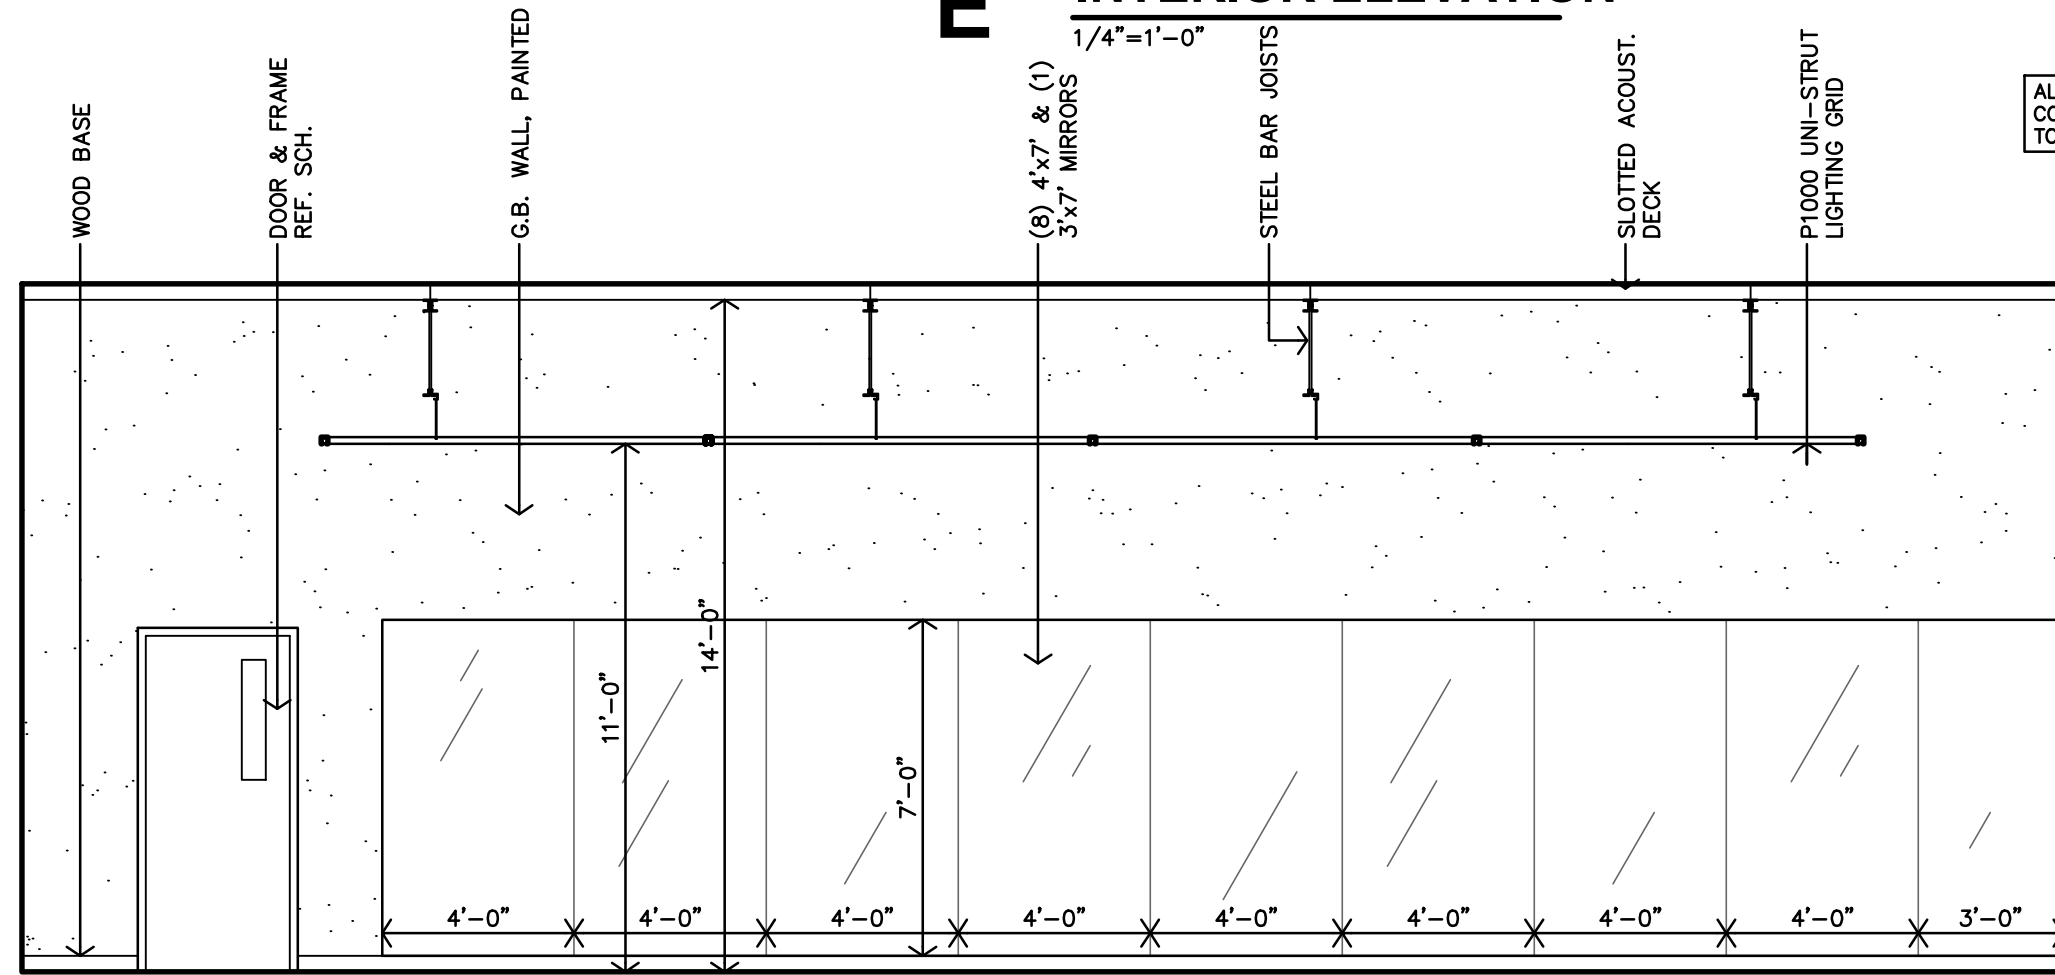


**B**

**DANCE STUDIO 1 #107  
INTERIOR ELEVATION**  
1/4"=1'-0"

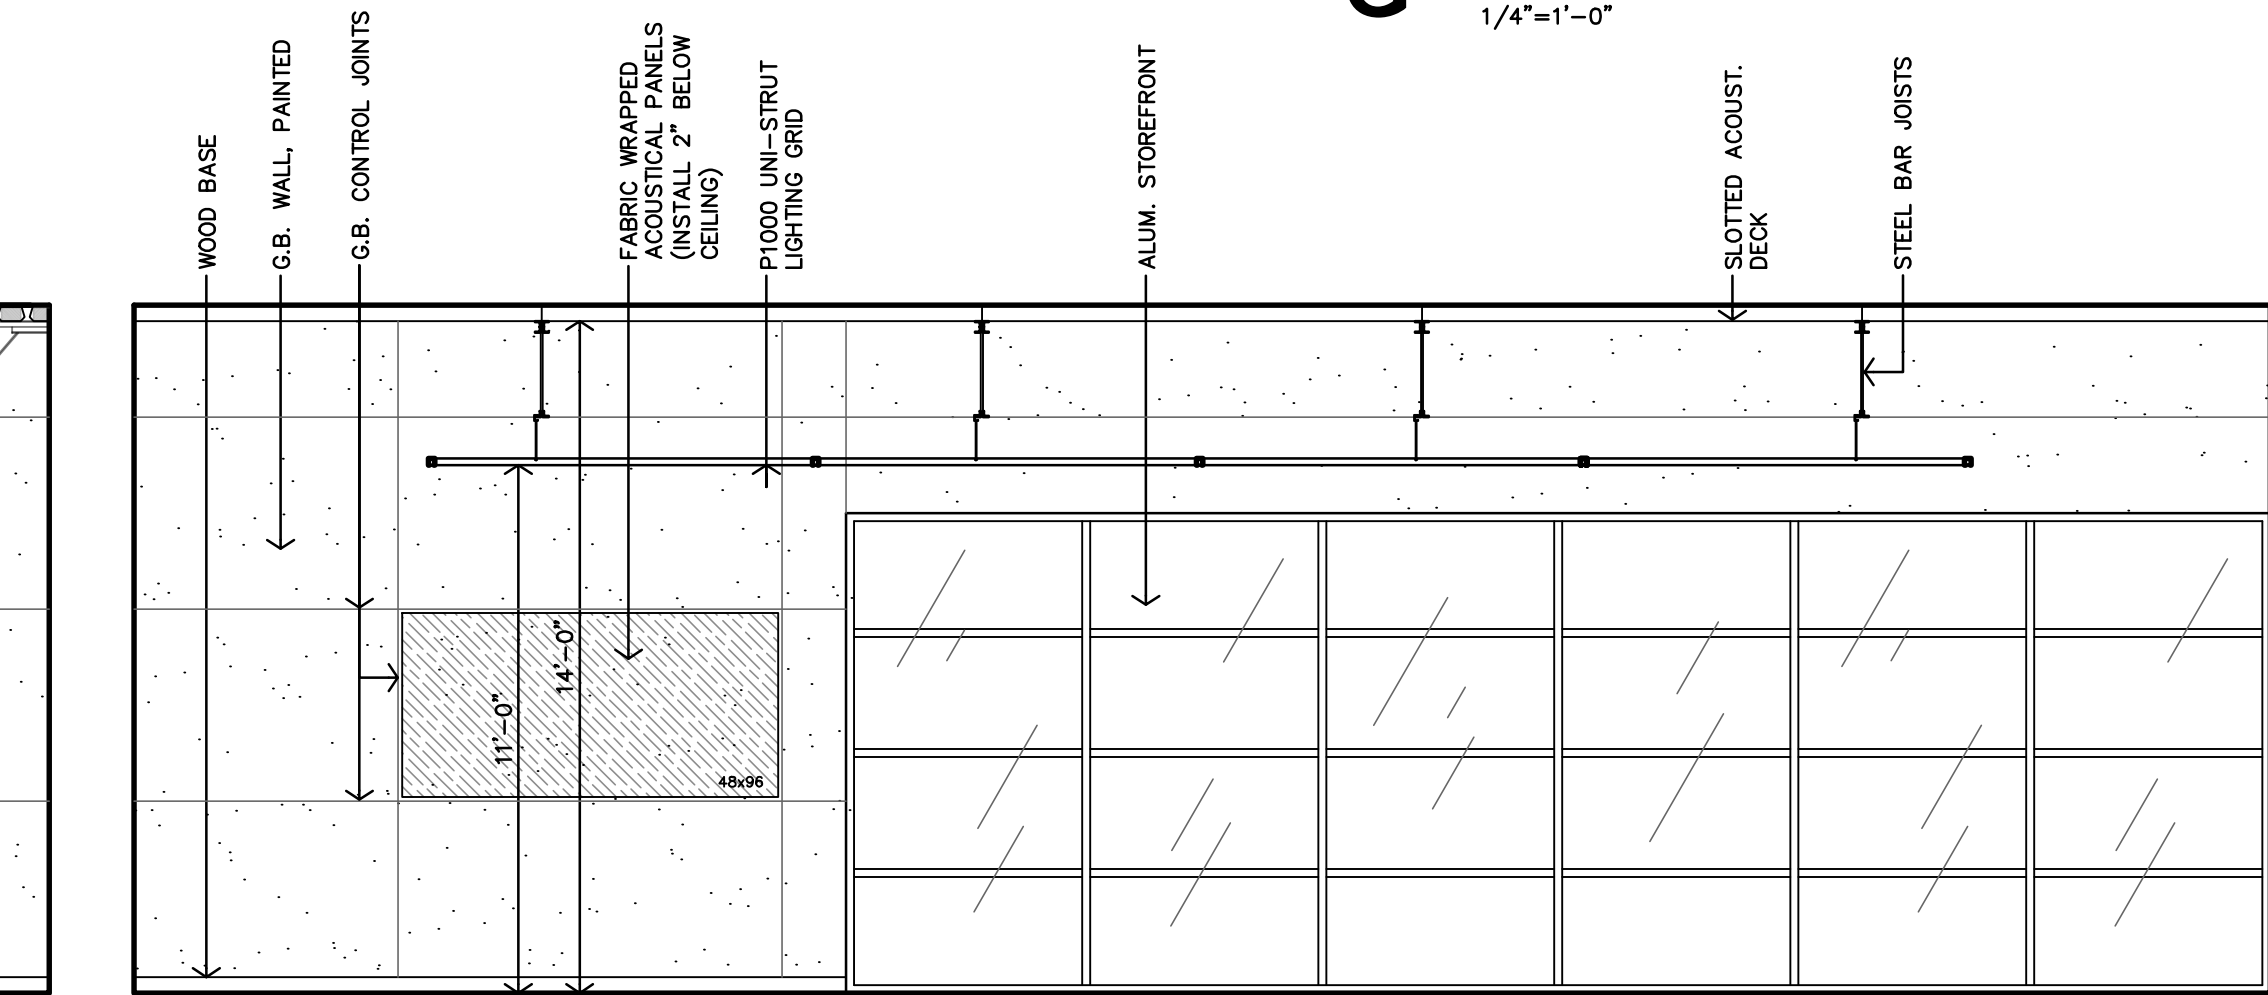


**G**

**DANCE STUDIO 2 #112  
INTERIOR ELEVATION**  
1/4"=1'-0"

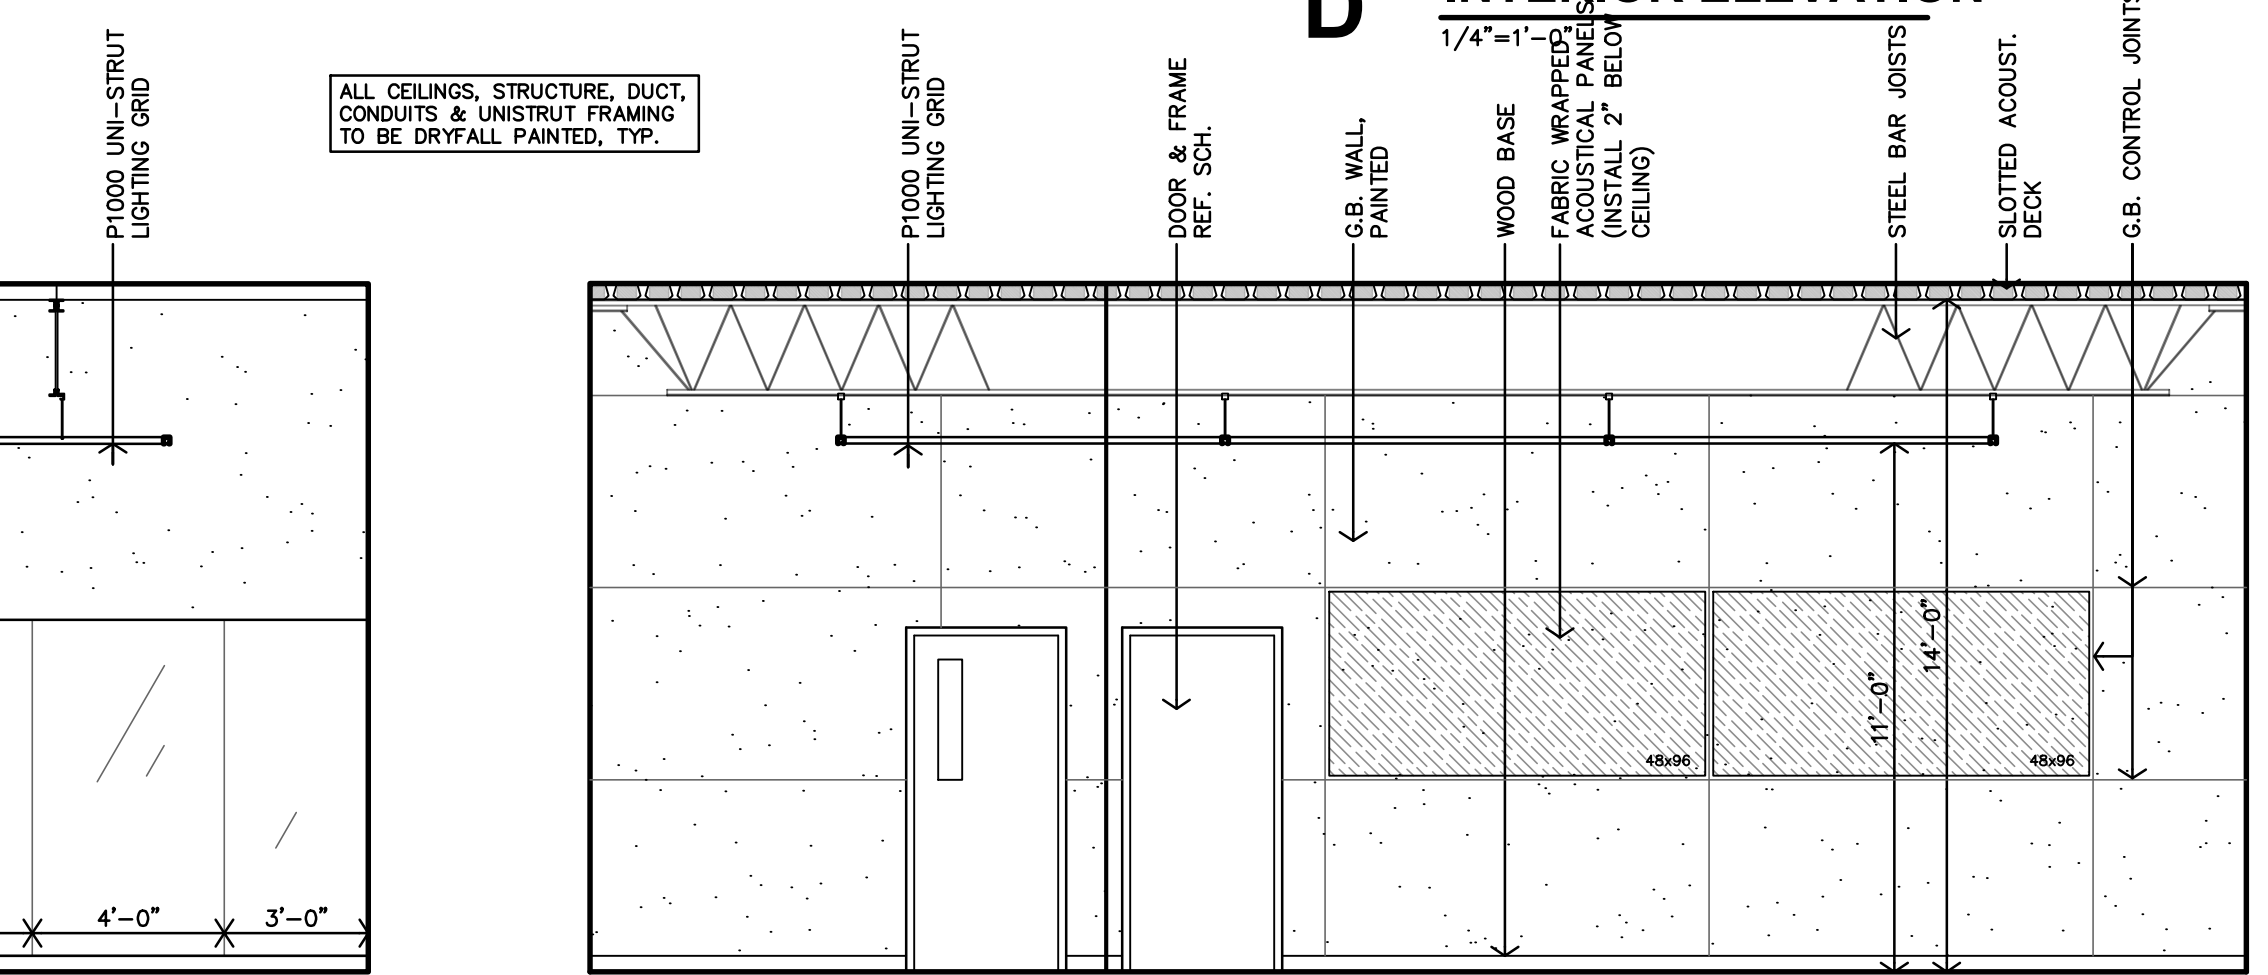


**D**

**DANCE STUDIO 1 #107  
INTERIOR ELEVATION**  
1/4"=1'-0"

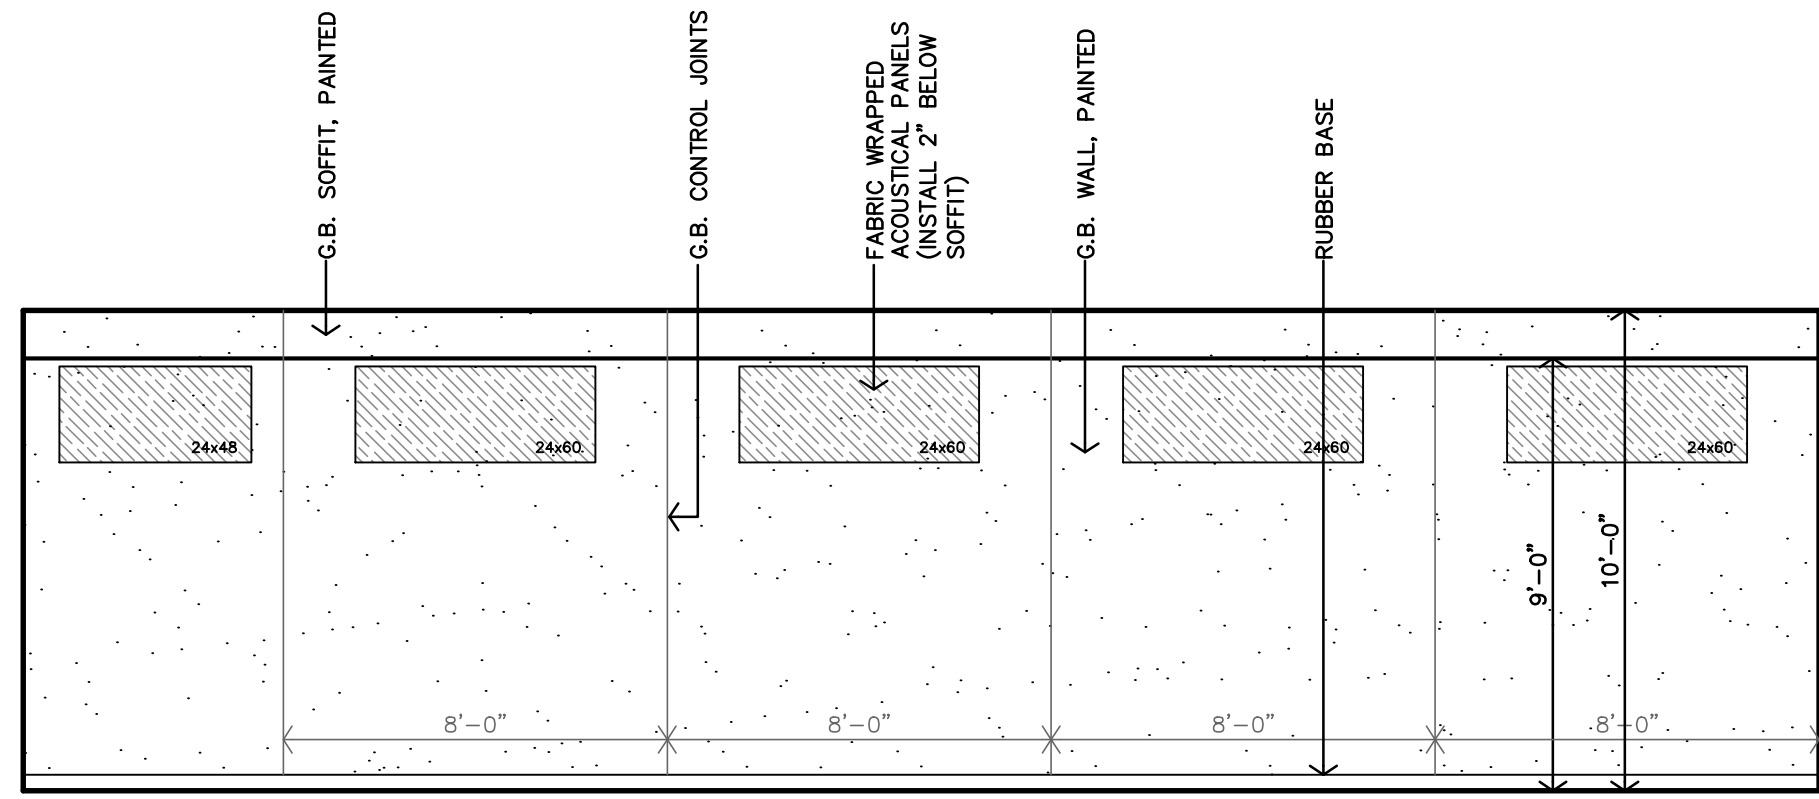


**M**

**CHORUS #113  
INTERIOR ELEVATION**  
1/4"=1'-0"

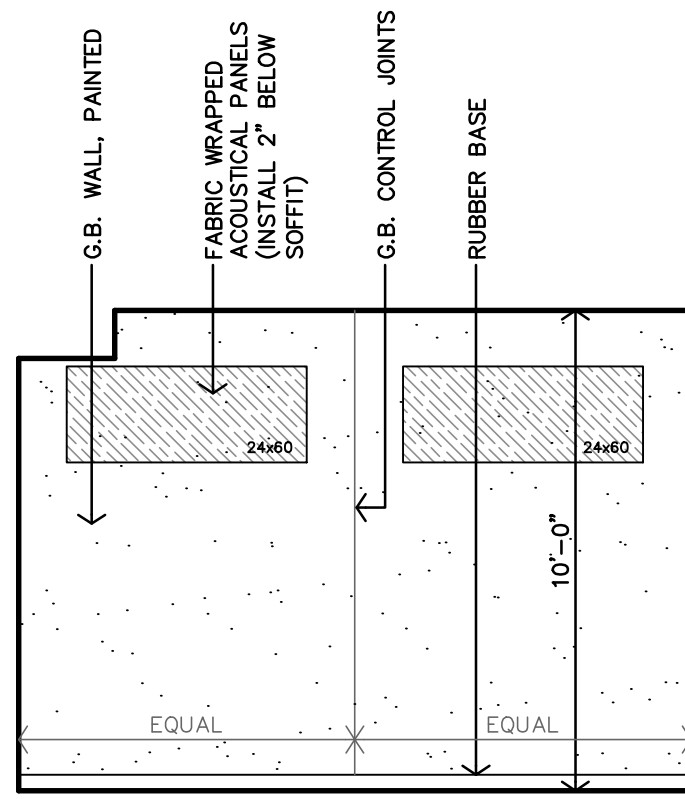


**L**

**CHORUS #113  
INTERIOR ELEVATION**  
1/4"=1'-0"

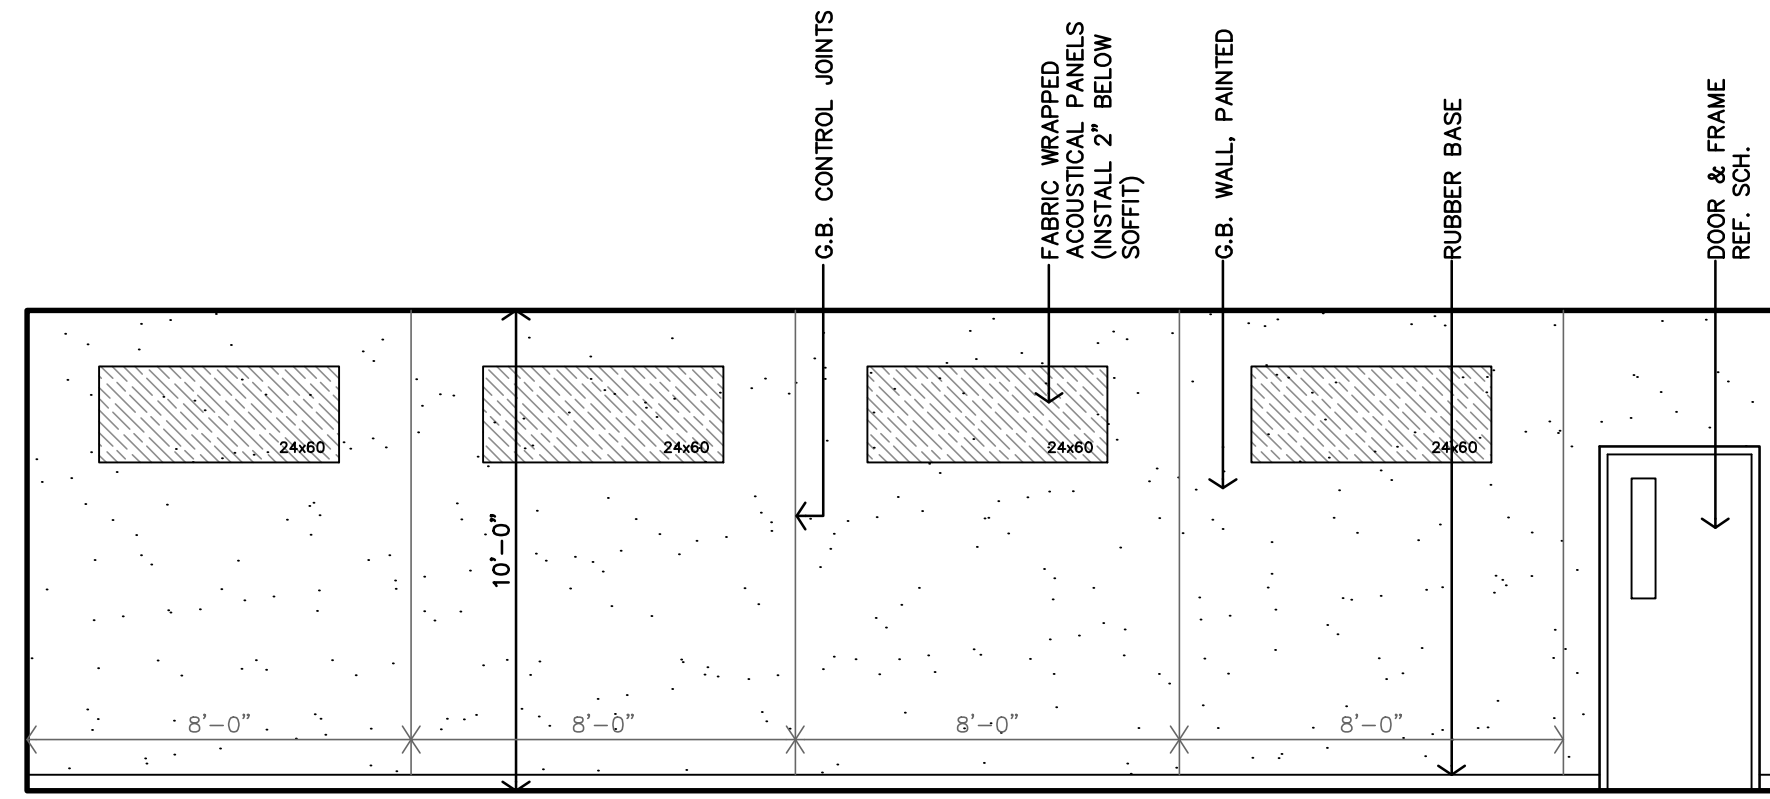

**K**


**CHORUS #113  
INTERIOR ELEVATION**  
1/4"=1'-0"

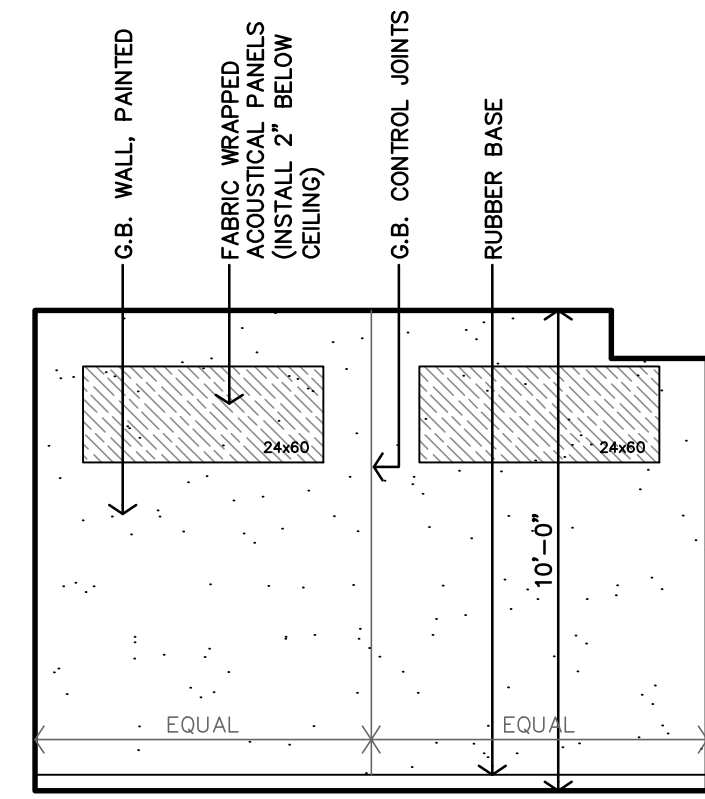

**J**

**CHORUS #113  
INTERIOR ELEVATION**  
1/4"=1'-0"

ALL CEILINGS, STRUCTURE, DUCT,  
CONDUITS & UNISTRUT FRAMING  
TO BE DRYFALL PAINTED, TYP.

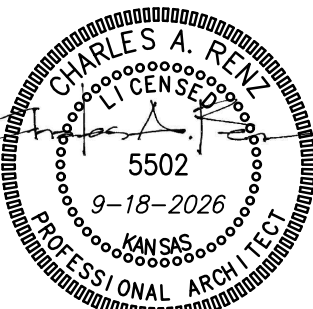

REVISION:

DATE: 9-18-2026

JOB: 22-3239

SHEET NO.:

**A9.2**


**JCR**

**JonesGillamRenz**  
1881 Main Street, Suite 301  
Kansas City, MO 64108  
jgr@jgarchitects.com


**THEATRE SALINA**  
DANCE STUDIOS & SCENE SHOP EXPANSION  
SALINA, KANSAS

COPYRIGHTED ©




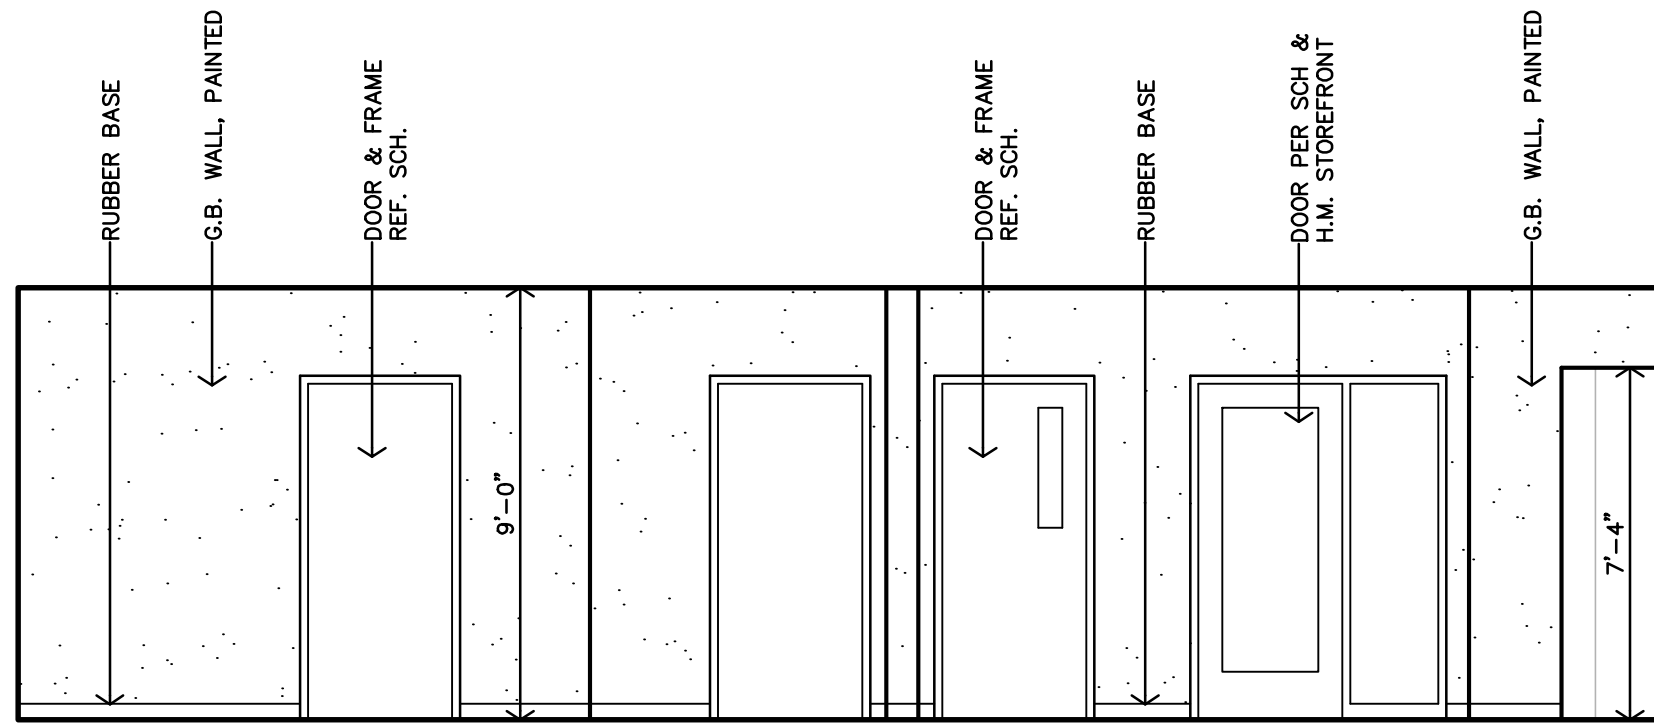


**B** HALL #114/117  
INTERIOR ELEVATION  
1/4"=1'-0"

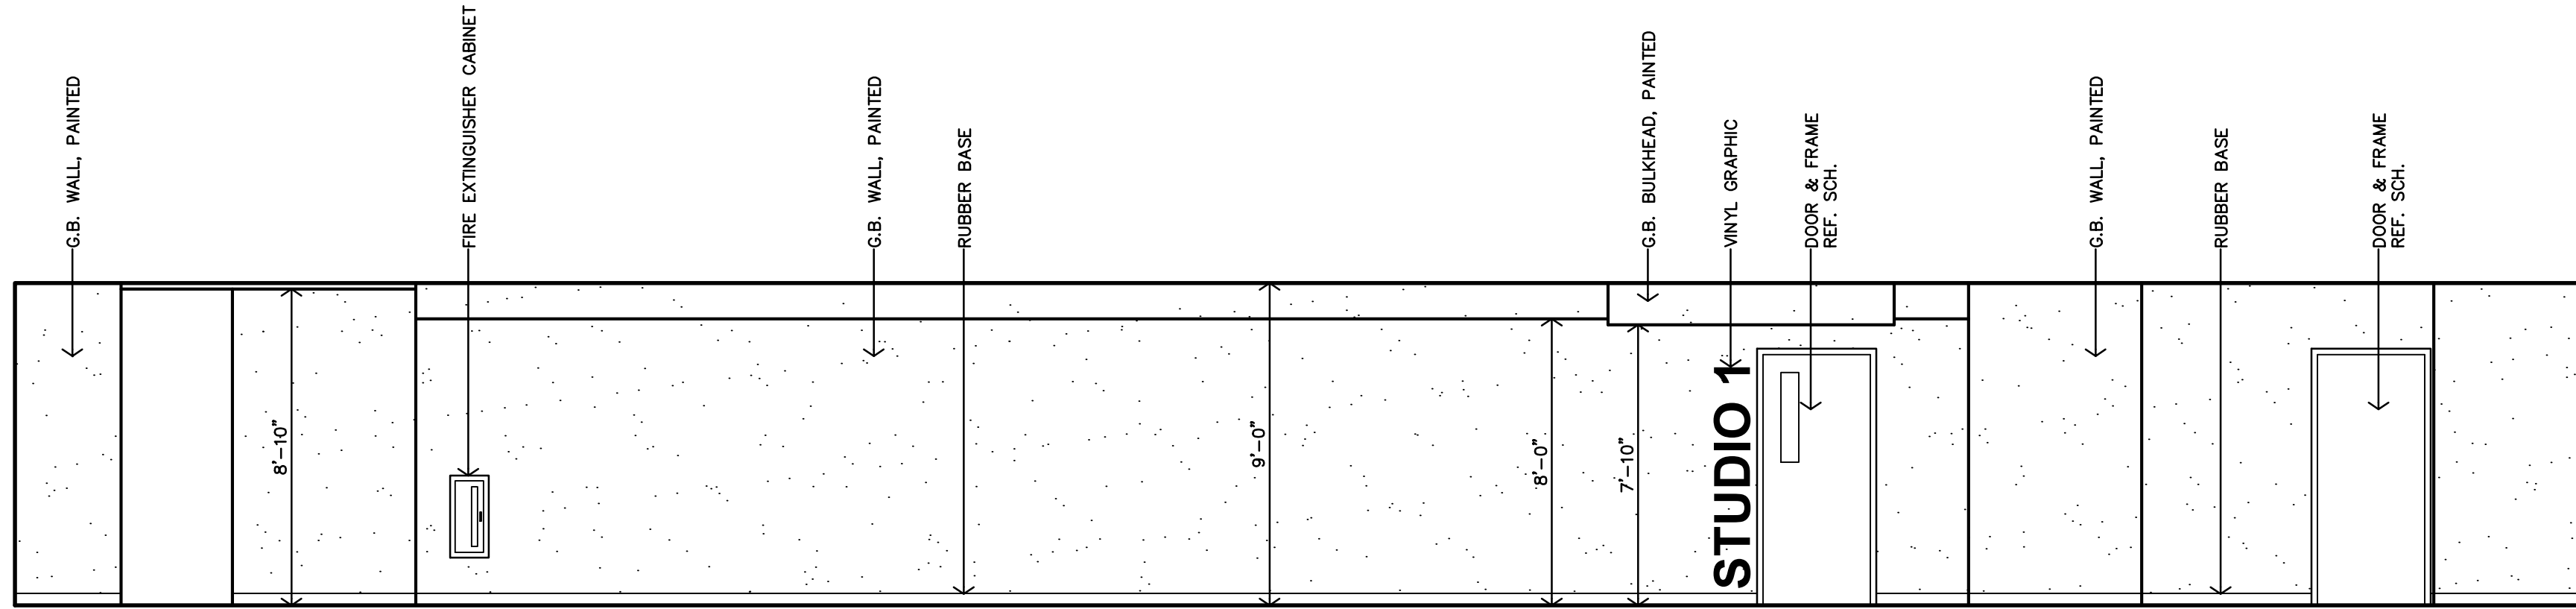


**A** HALL #106/114  
INTERIOR ELEVATION  
1/4"=1'-0"

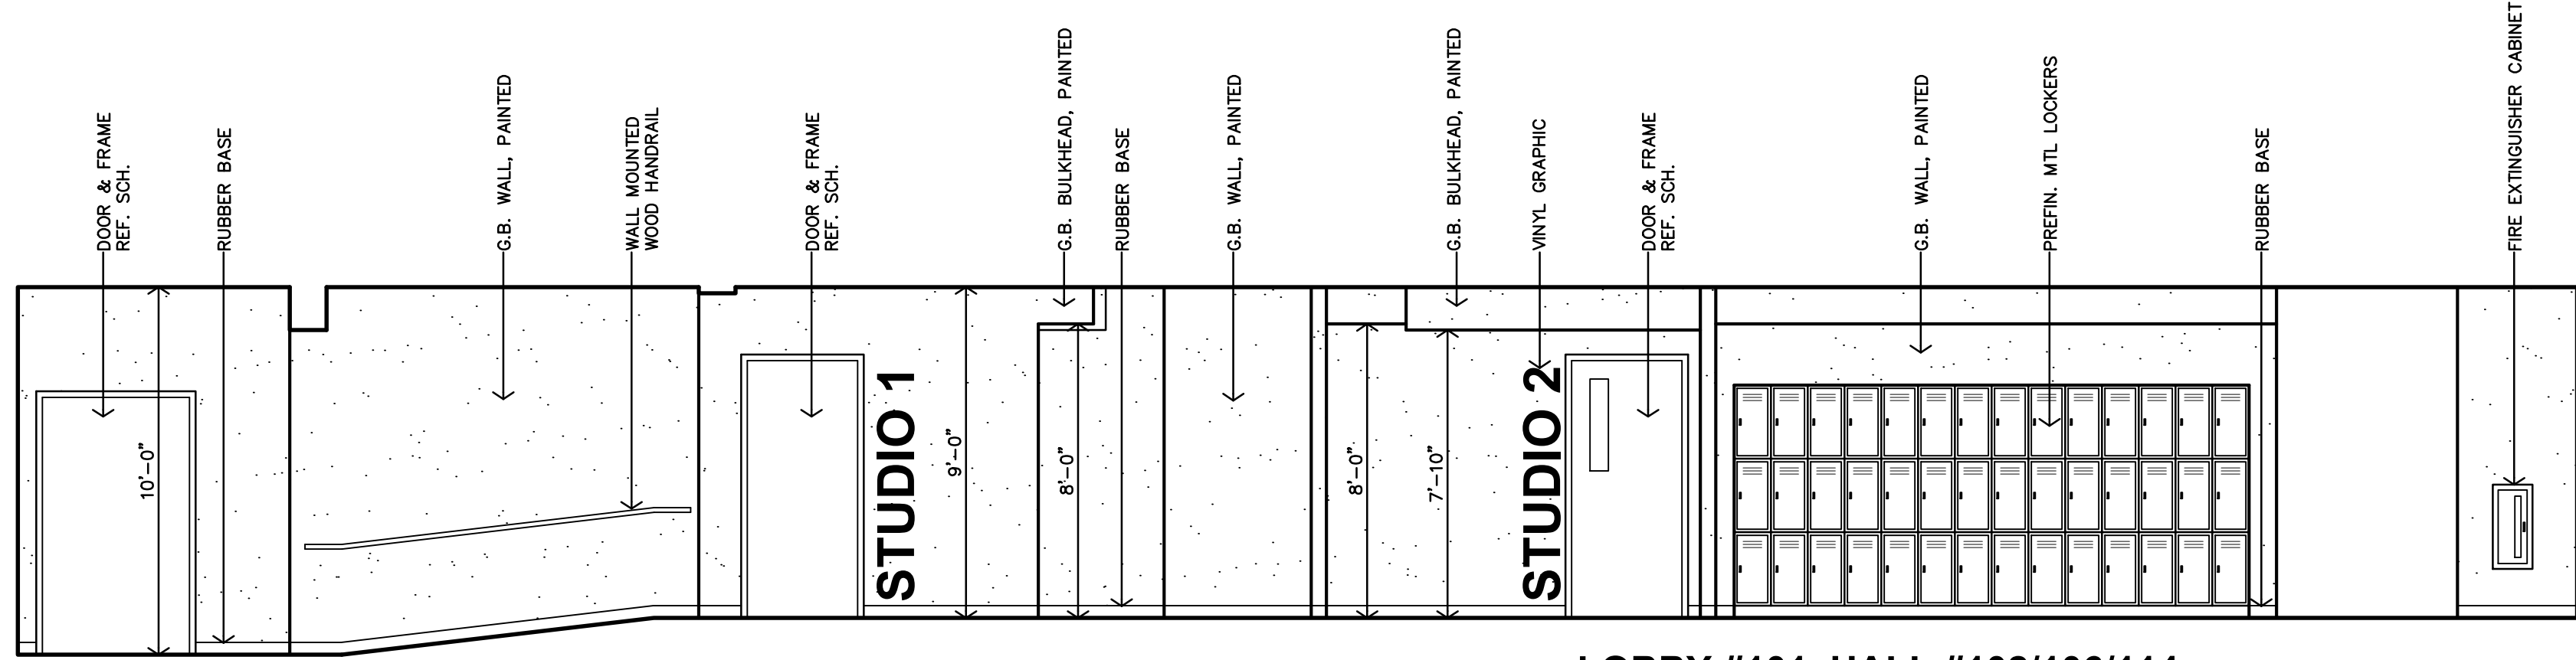

**C** LOBBY #101, HALL #102/106/114  
INTERIOR ELEVATION  
1/4"=1'-0"

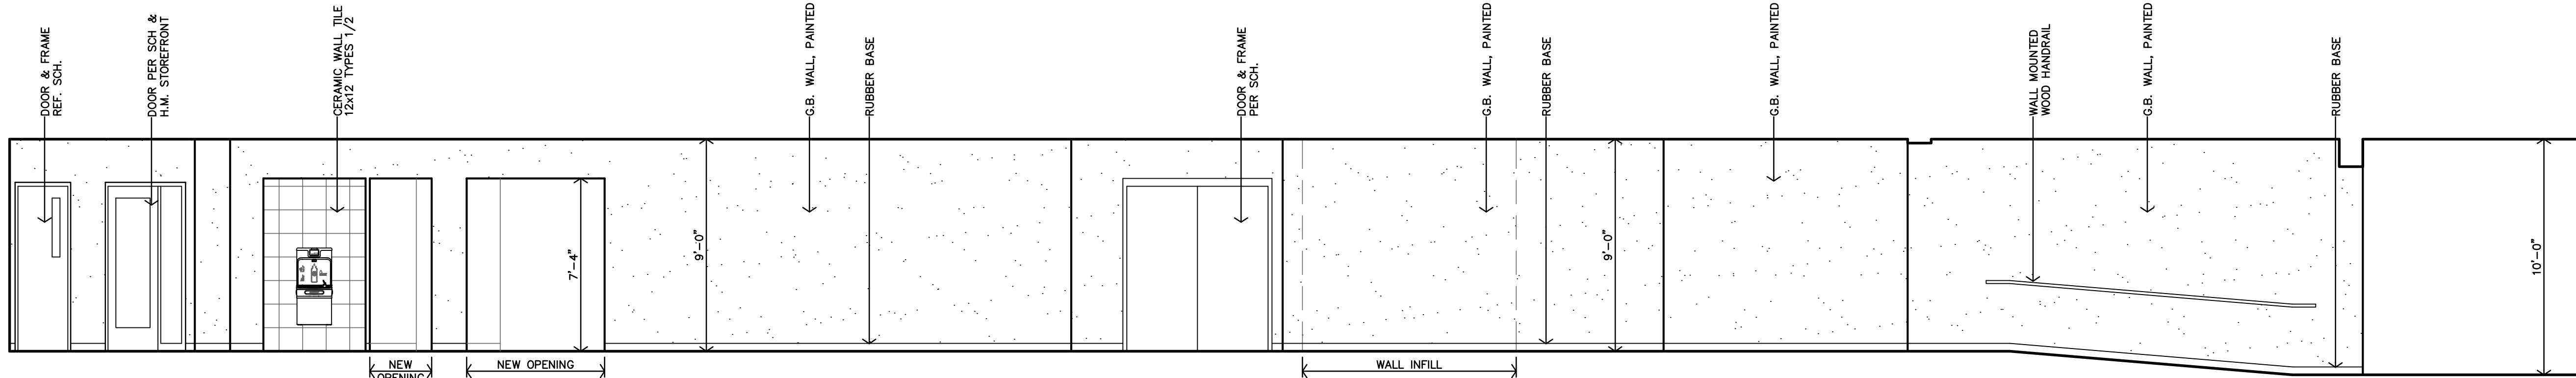


**D** HALL #106/114  
INTERIOR ELEVATION  
1/4"=1'-0"

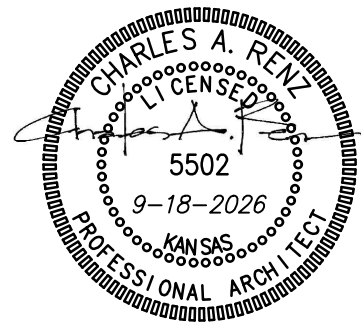


REVISION:	
DATE:	9-18-2026
JOB:	22-3239
SHEET NO.:	




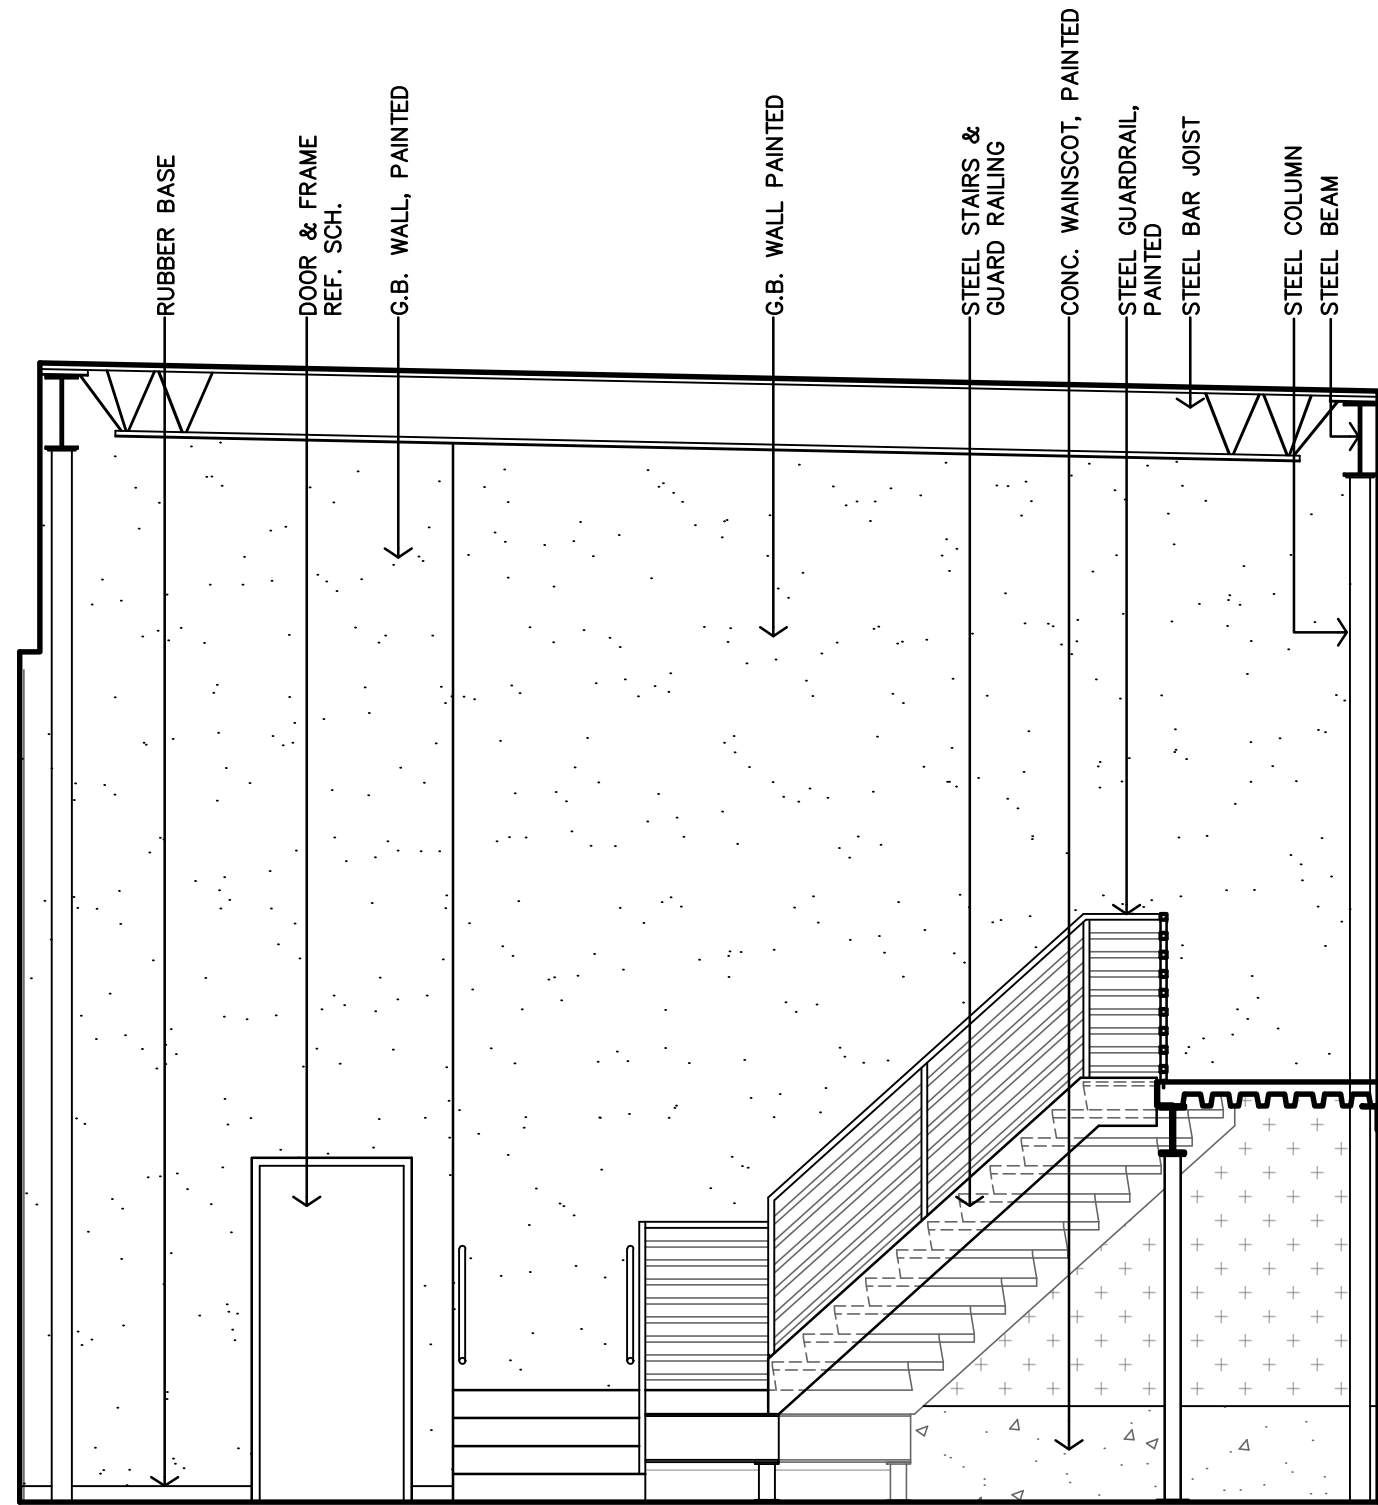


**D** SCENE SHOP #123  
INTERIOR ELEVATION  
1/4"=1'-0"

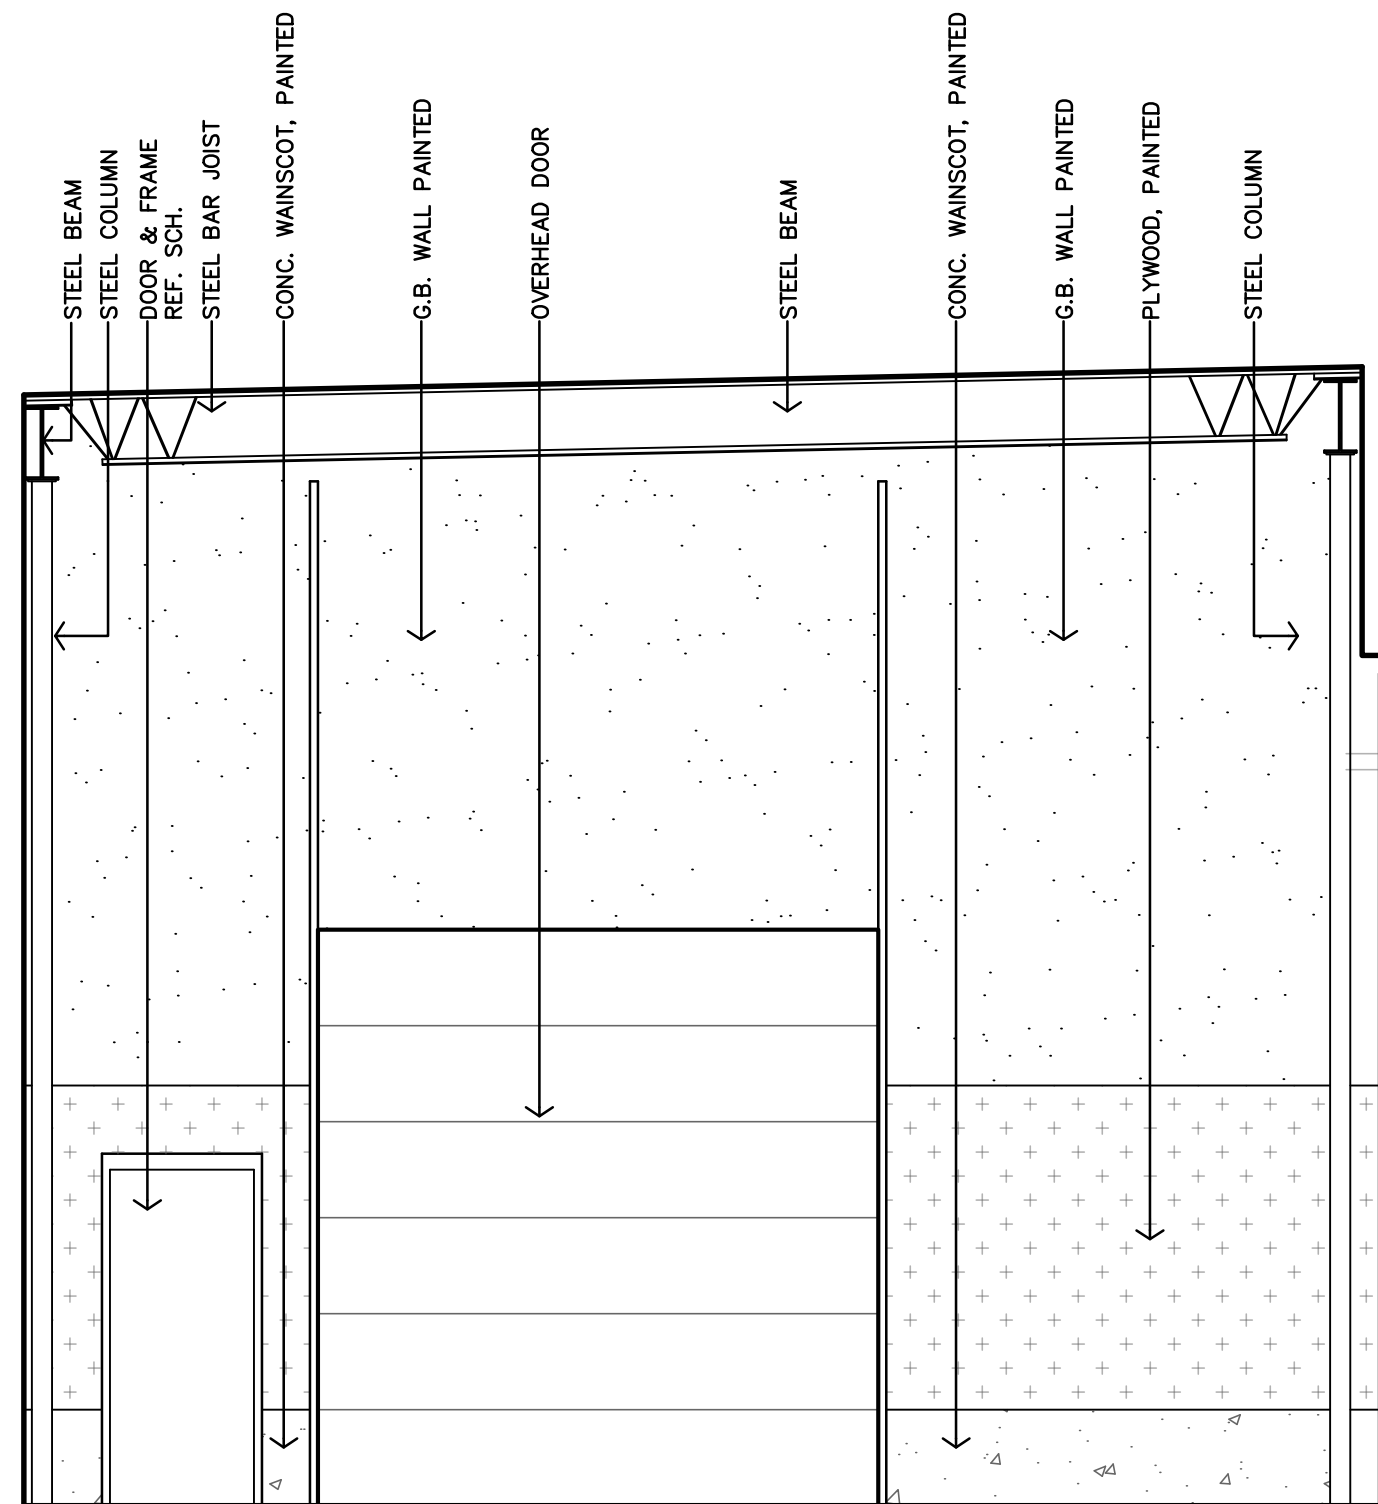


**B** SCENE SHOP #123  
INTERIOR ELEVATION  
1/4"=1'-0"

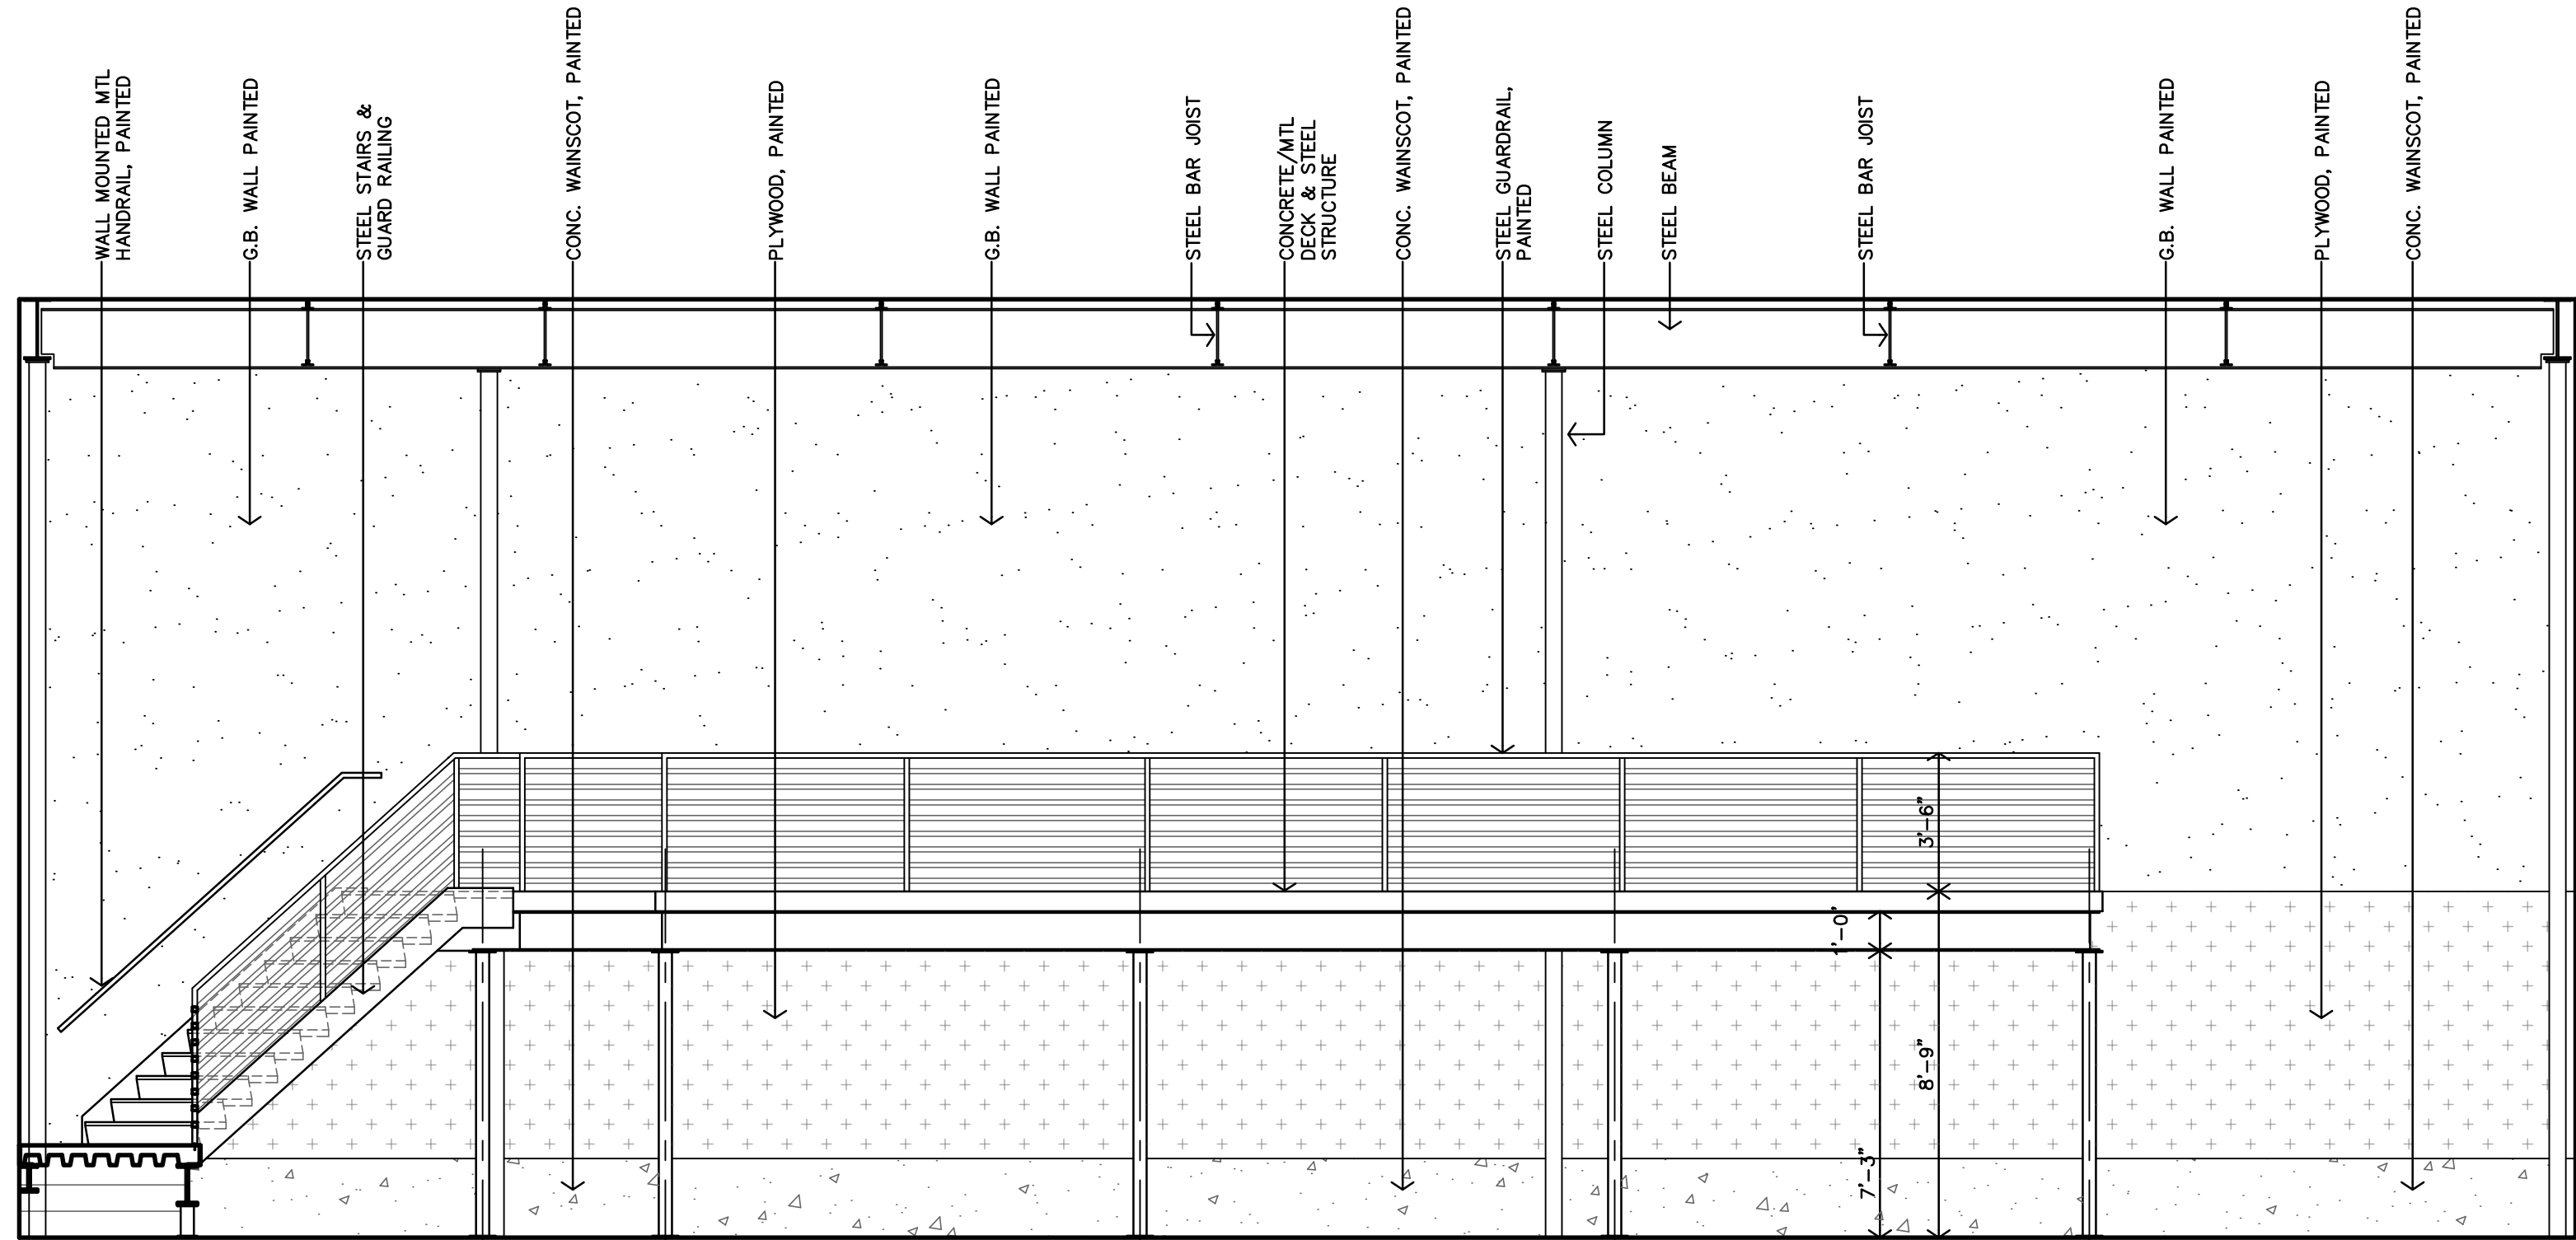

**C** SCENE SHOP #123  
INTERIOR ELEVATION  
1/4"=1'-0"

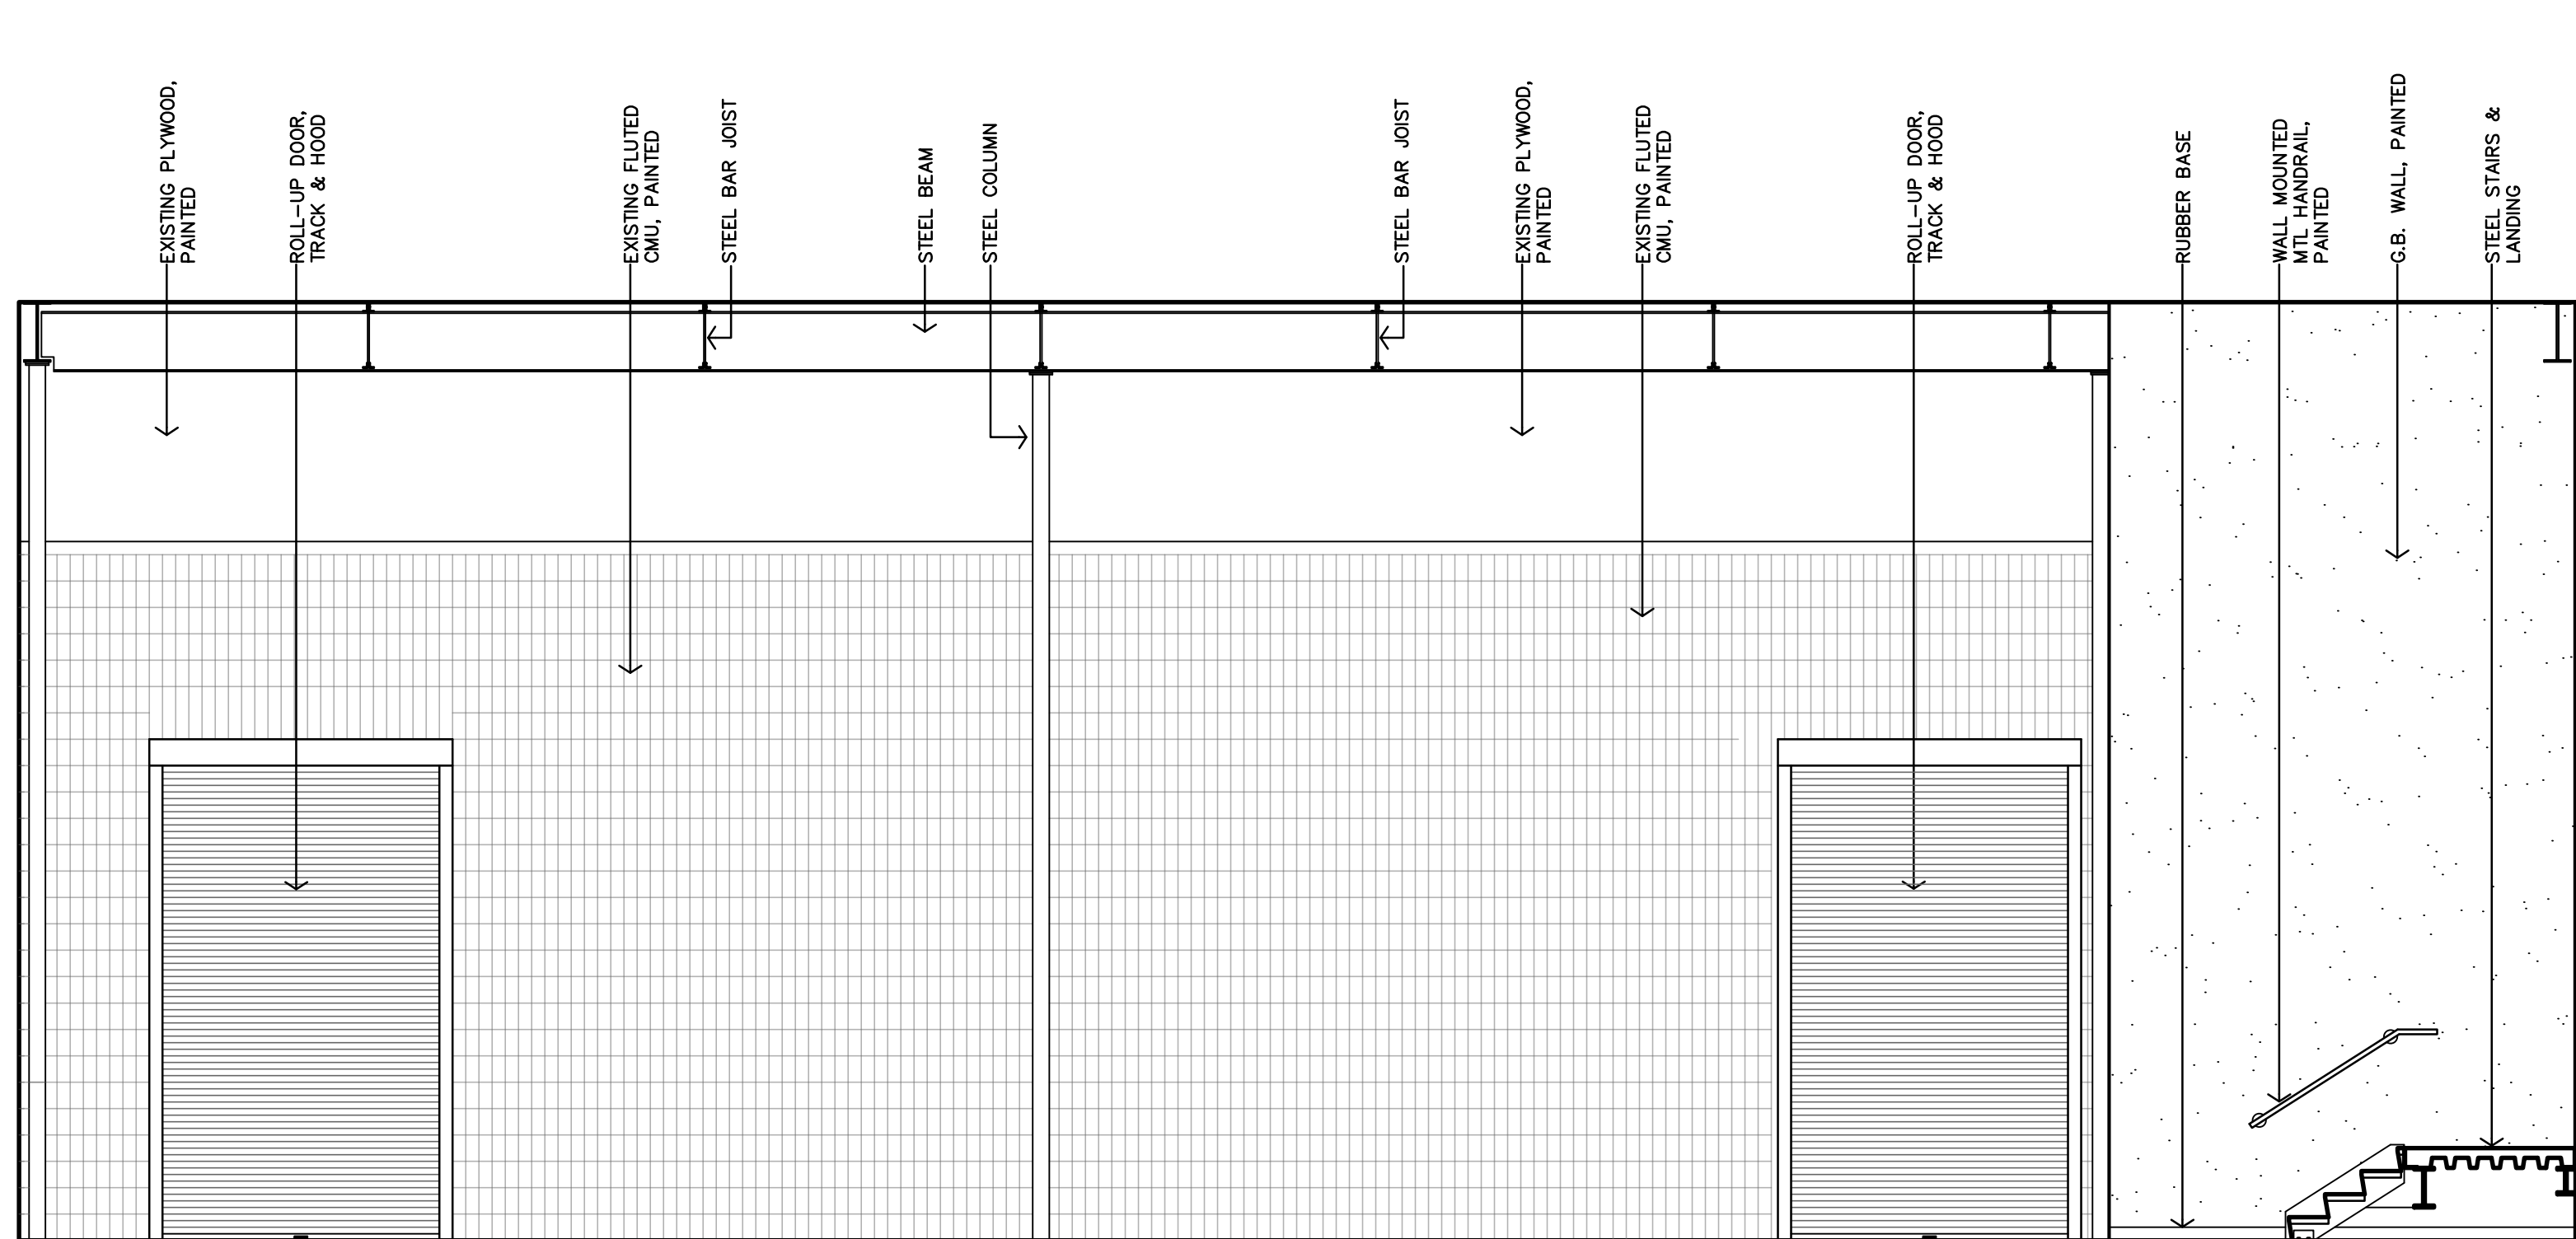

**A** SCENE SHOP #123  
INTERIOR ELEVATION  
1/4"=1'-0"

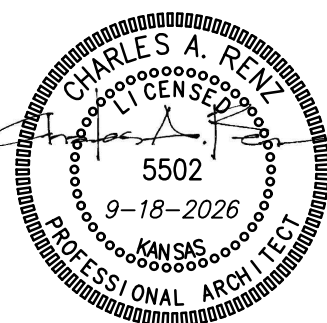

REVISION:

DATE: 9-18-2026

JOB: 22-3239

SHEET NO.:


**A9.4**

**THEATRE SALINA**  
DANCE STUDIOS & SCENE SHOP EXPANSION  
SALINA, KANSAS


**JGR**  
JonesGillamRenz  
730 N. Ninth  
Salina, KS 67401  
785.827.0386  
1881 Main Street, Suite 301  
Kansas City, MO 64108  
jgr@jgrarchitects.com

COPYRIGHTED ©




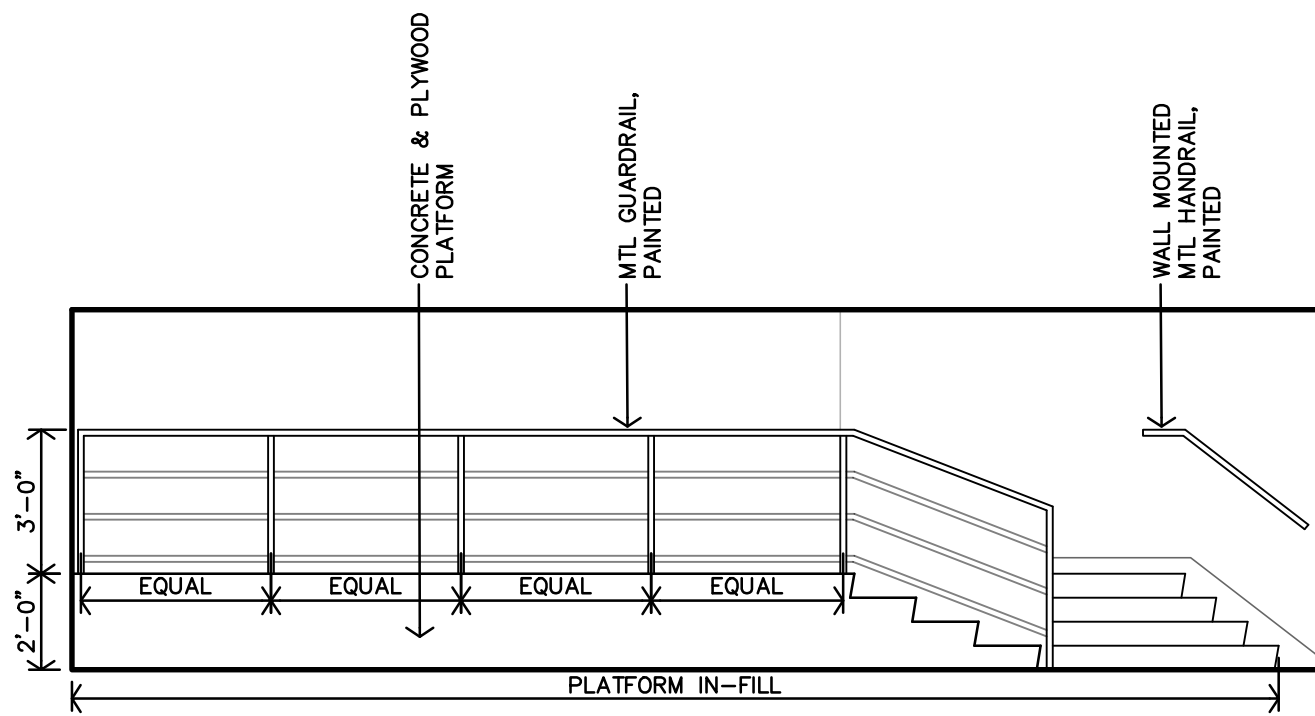


**C** **DRESSING #124**  
**INTERIOR ELEVATION**  
1/4"=1'-0"

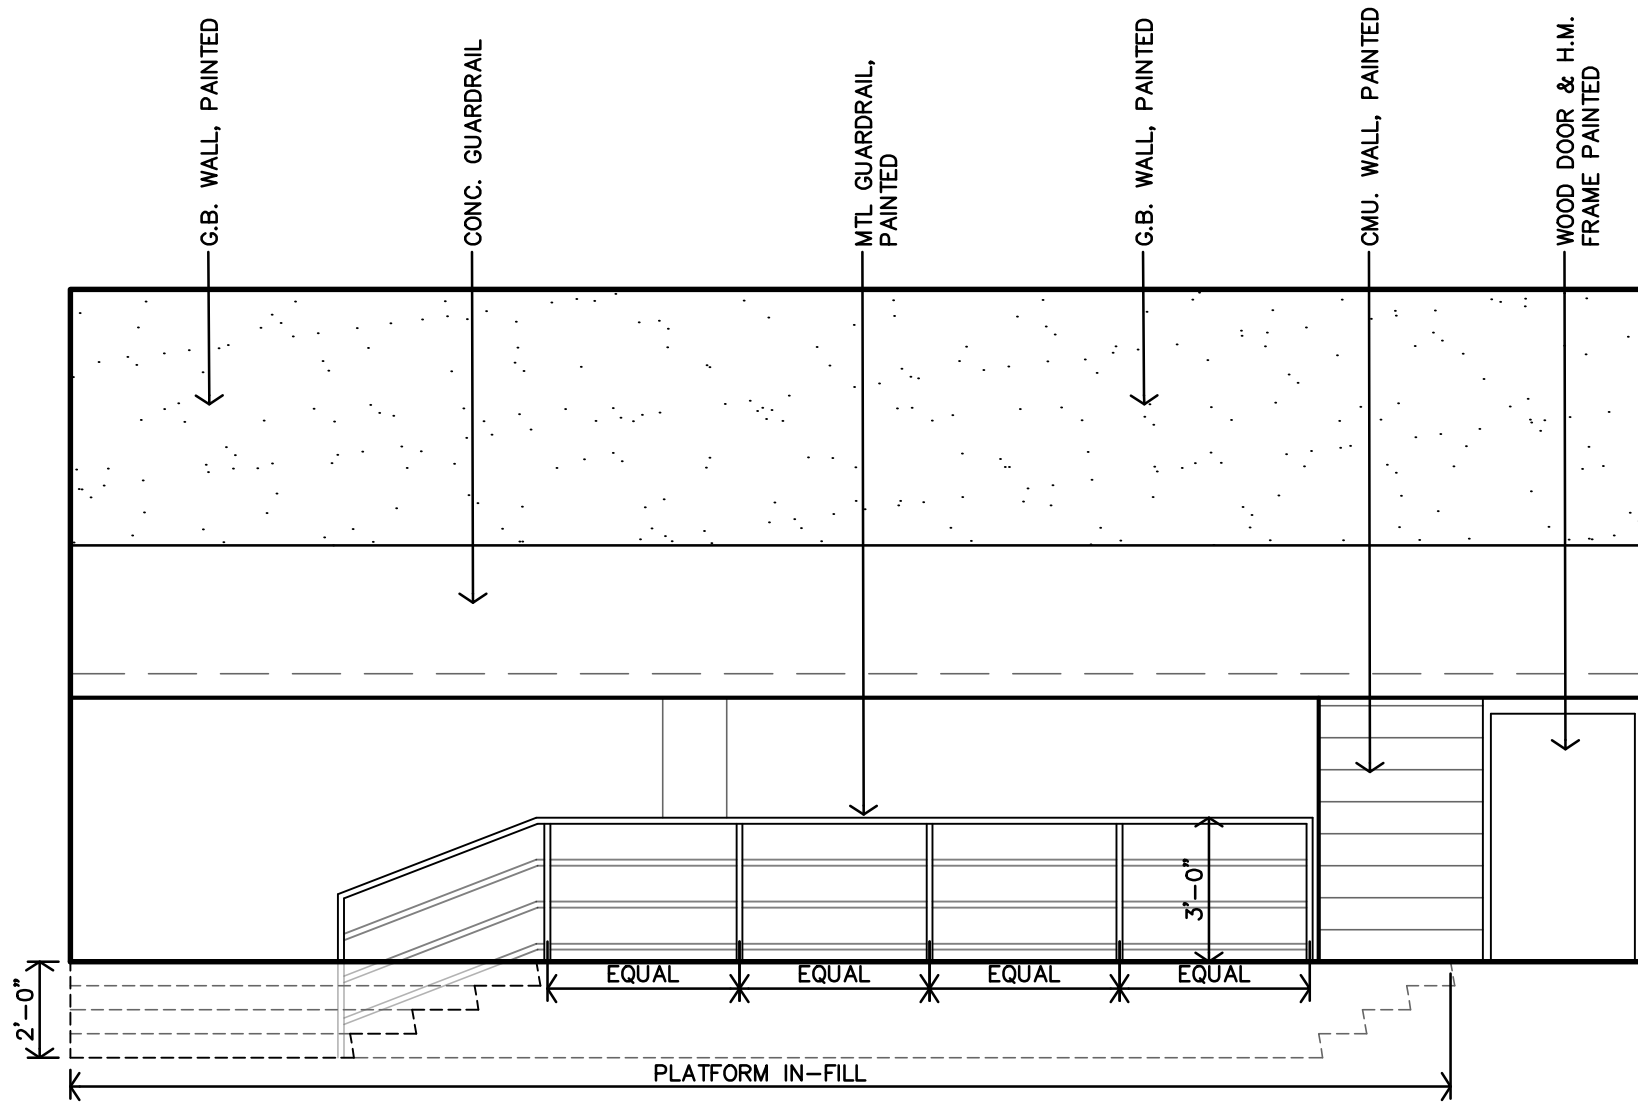


**B** **STORAGE #124**  
**INTERIOR ELEVATION**  
1/4"=1'-0"

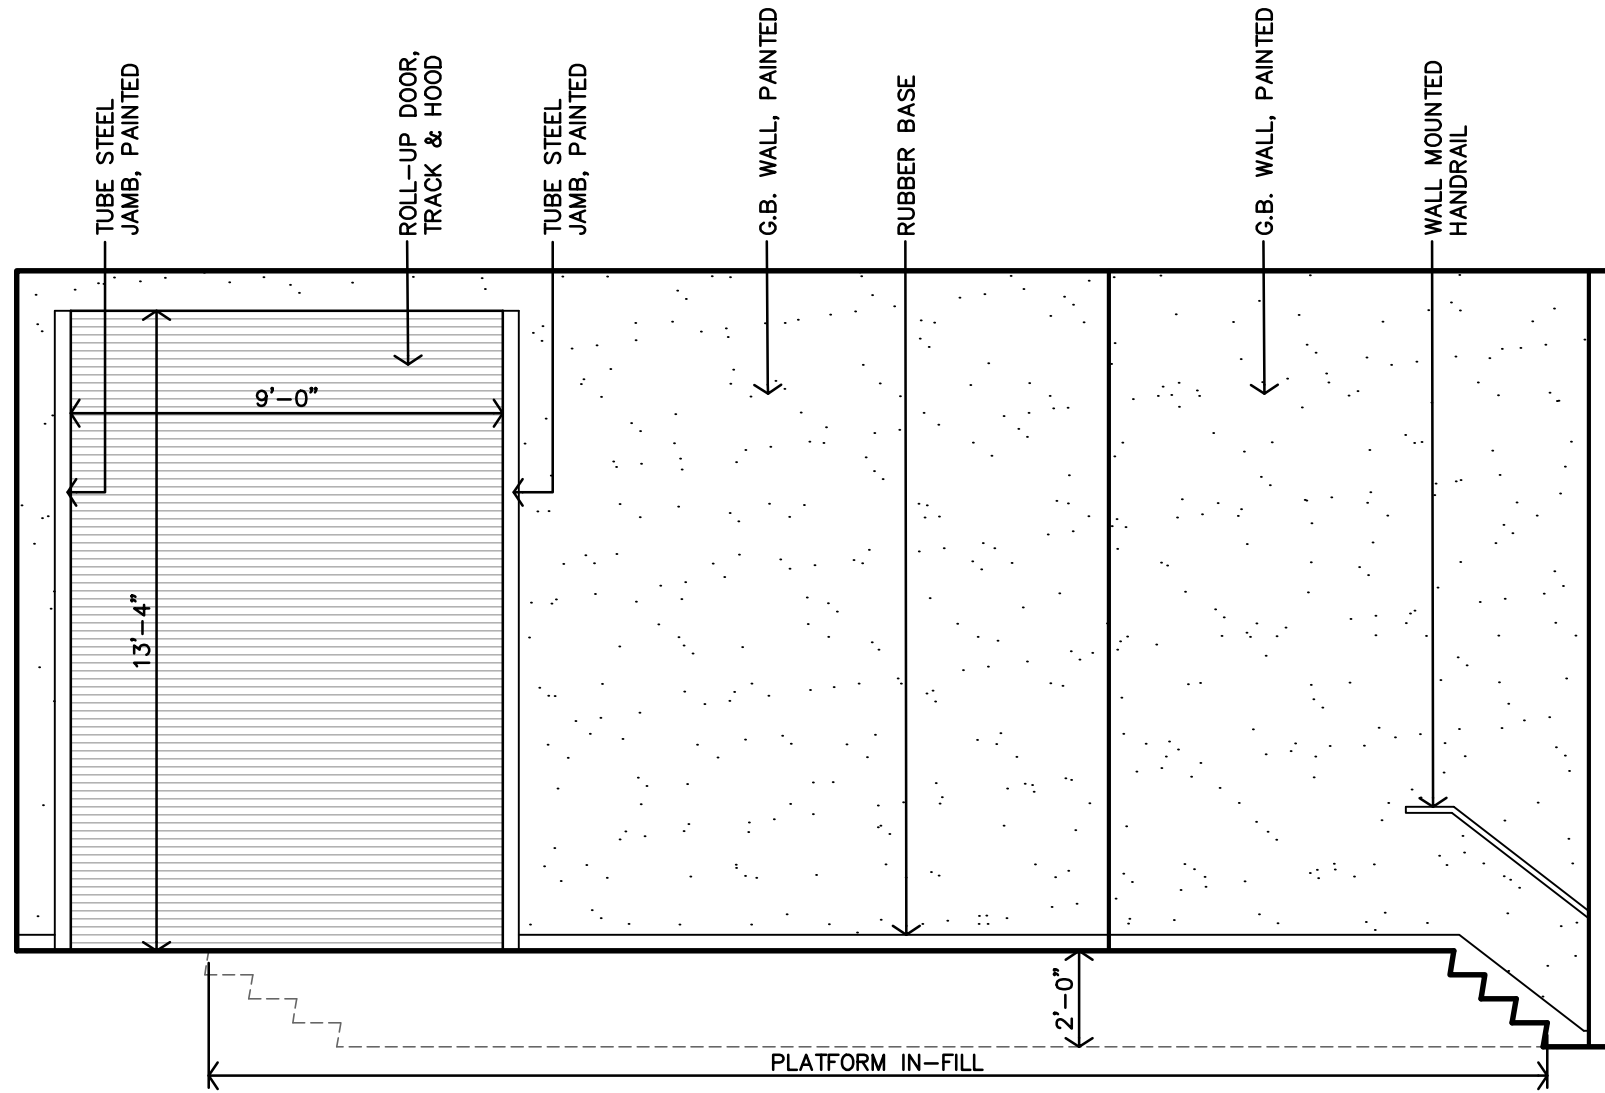


**E** **DRESSING #124**  
**INTERIOR ELEVATION**  
1/4"=1'-0"

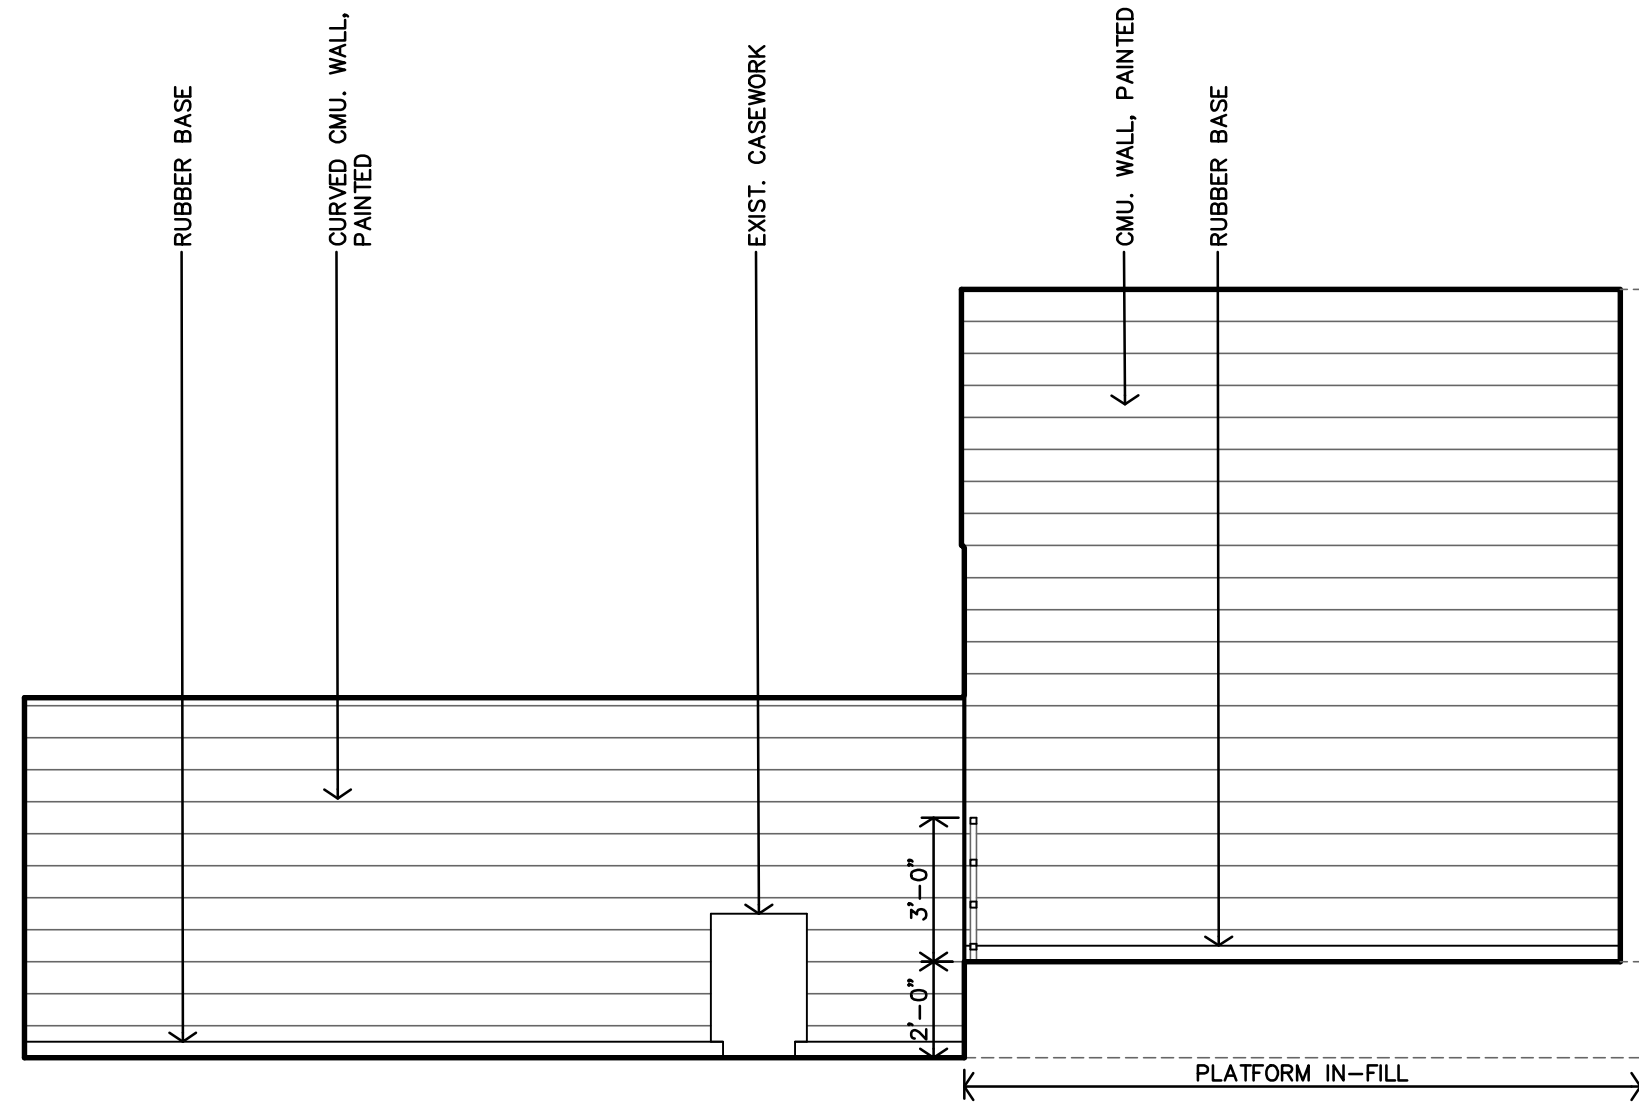

**A** **STORAGE #124**  
**INTERIOR ELEVATION**  
1/4"=1'-0"

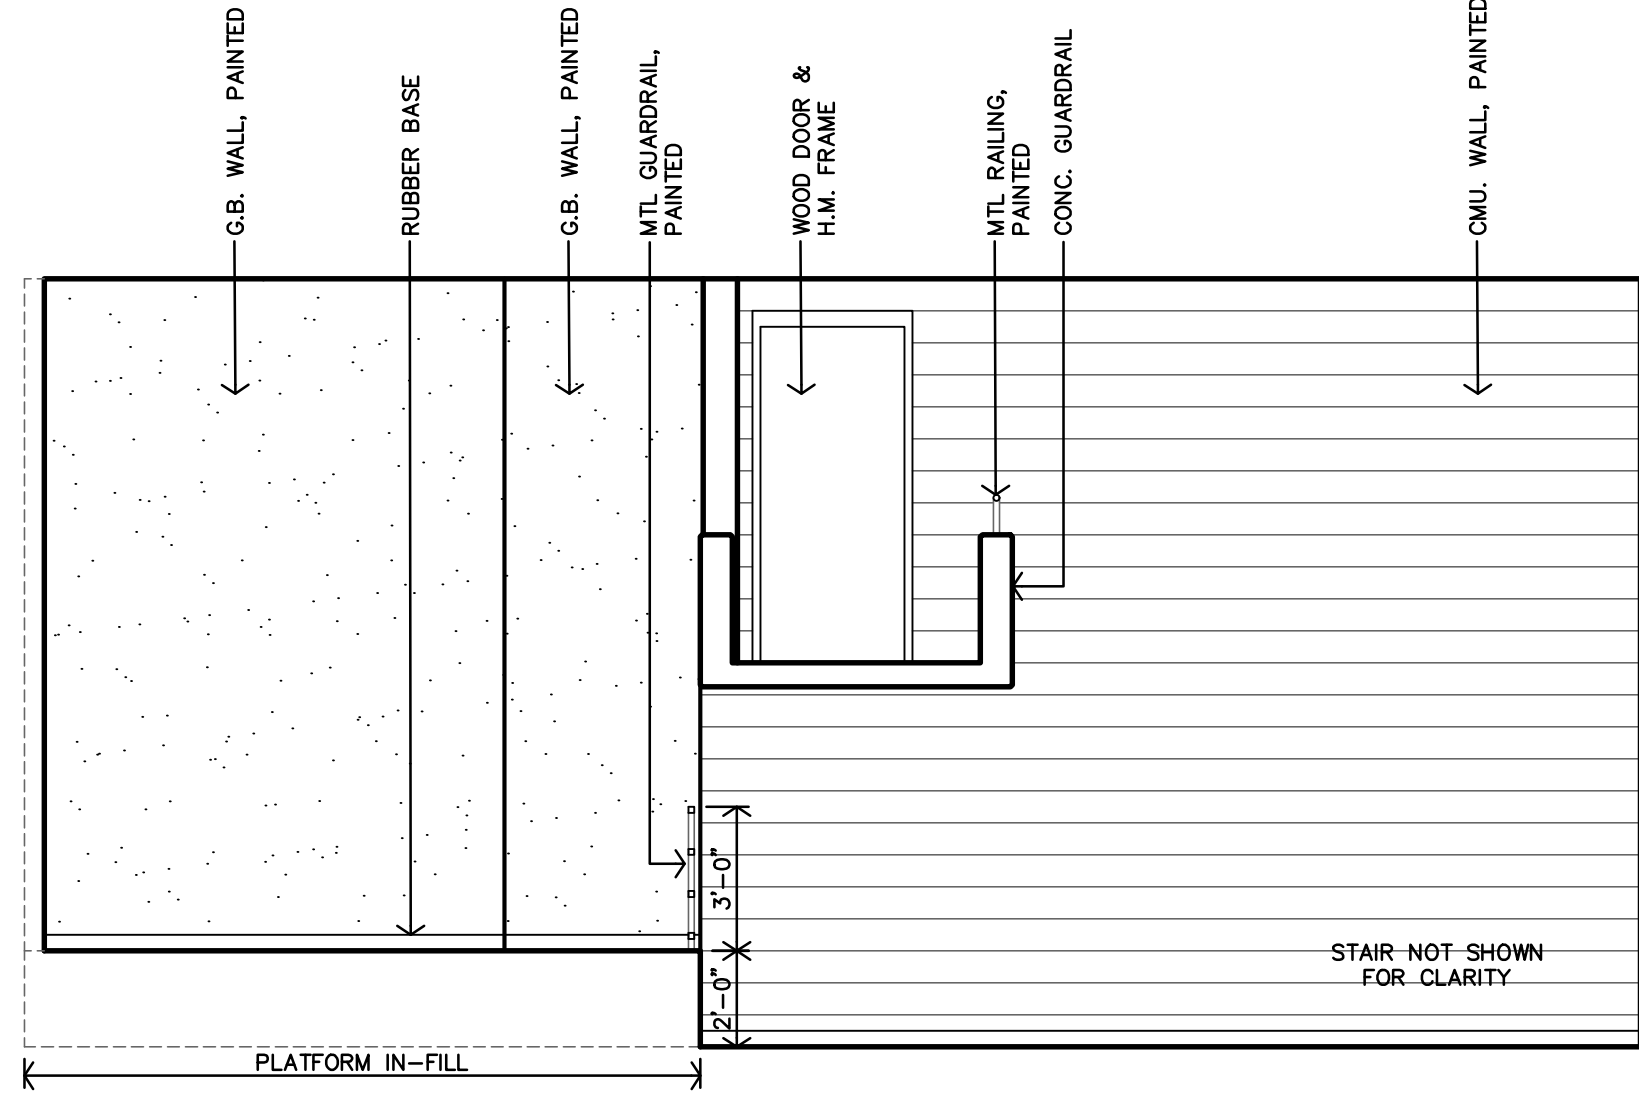

**D** **DRESSING #124**  
**INTERIOR ELEVATION**  
1/4"=1'-0"

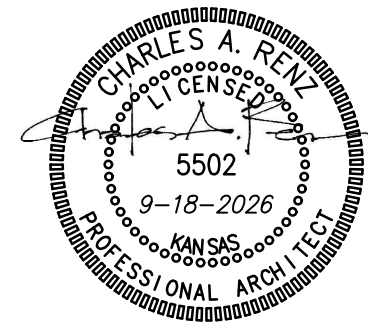


REVISION:	
DATE:	9-18-2026
JOB:	22-3239
SHEET NO.:	

**A9.5**


**THEATRE SALINA**  
DANCE STUDIOS & SCENE SHOP EXPANSION  
SALINA, KANSAS

**JGR**  
JonesGillamRenz  
730 N. Ninth  
Salina, KS 67401  
785.827.0386  
jgr@jgrarchitects.com




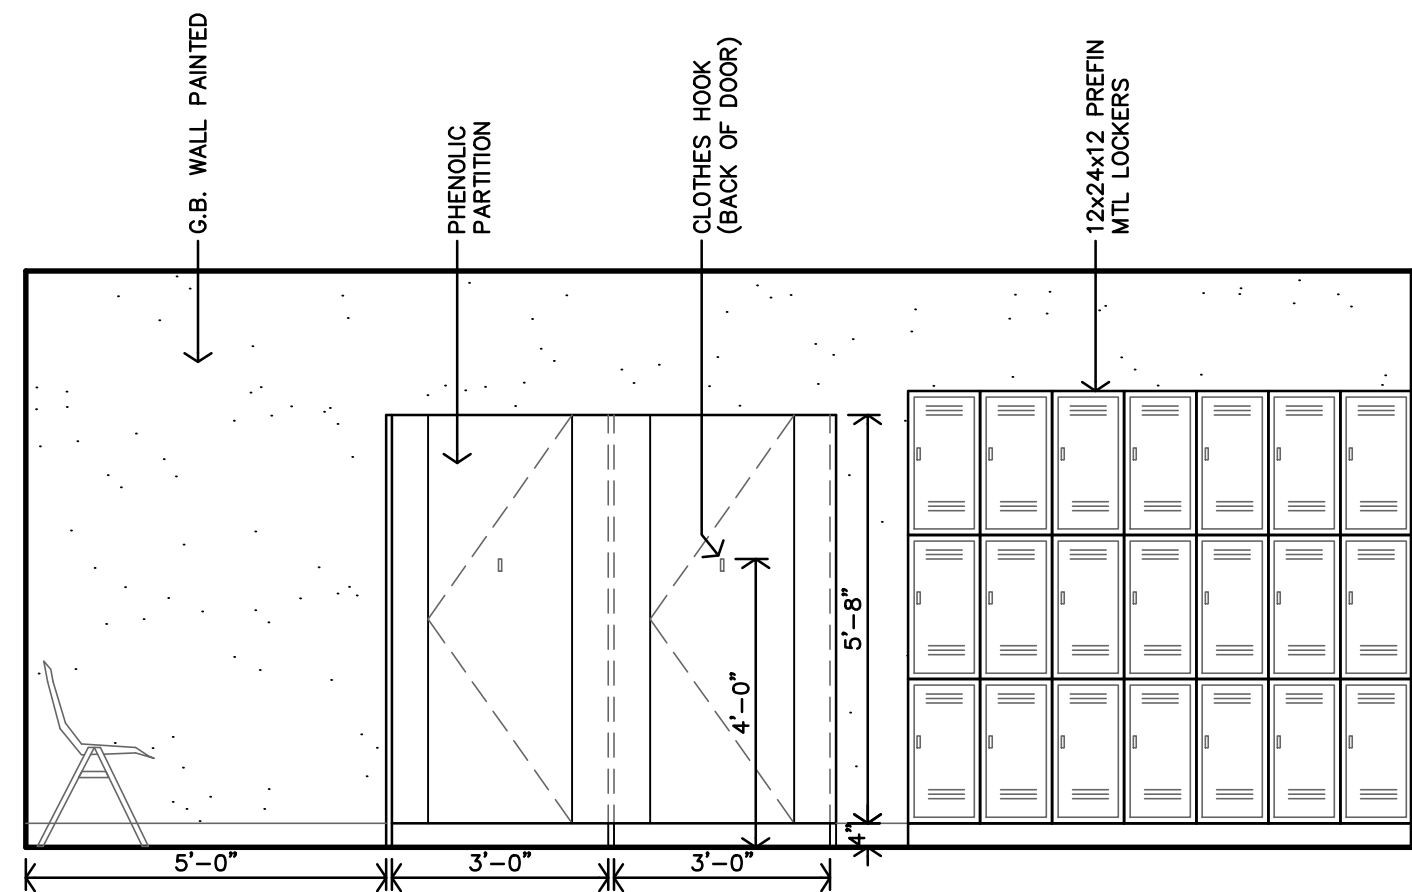


**J** DRESSING ROOM 1 #111  
ENLARGED PLAN  
3/8"=1'-0"

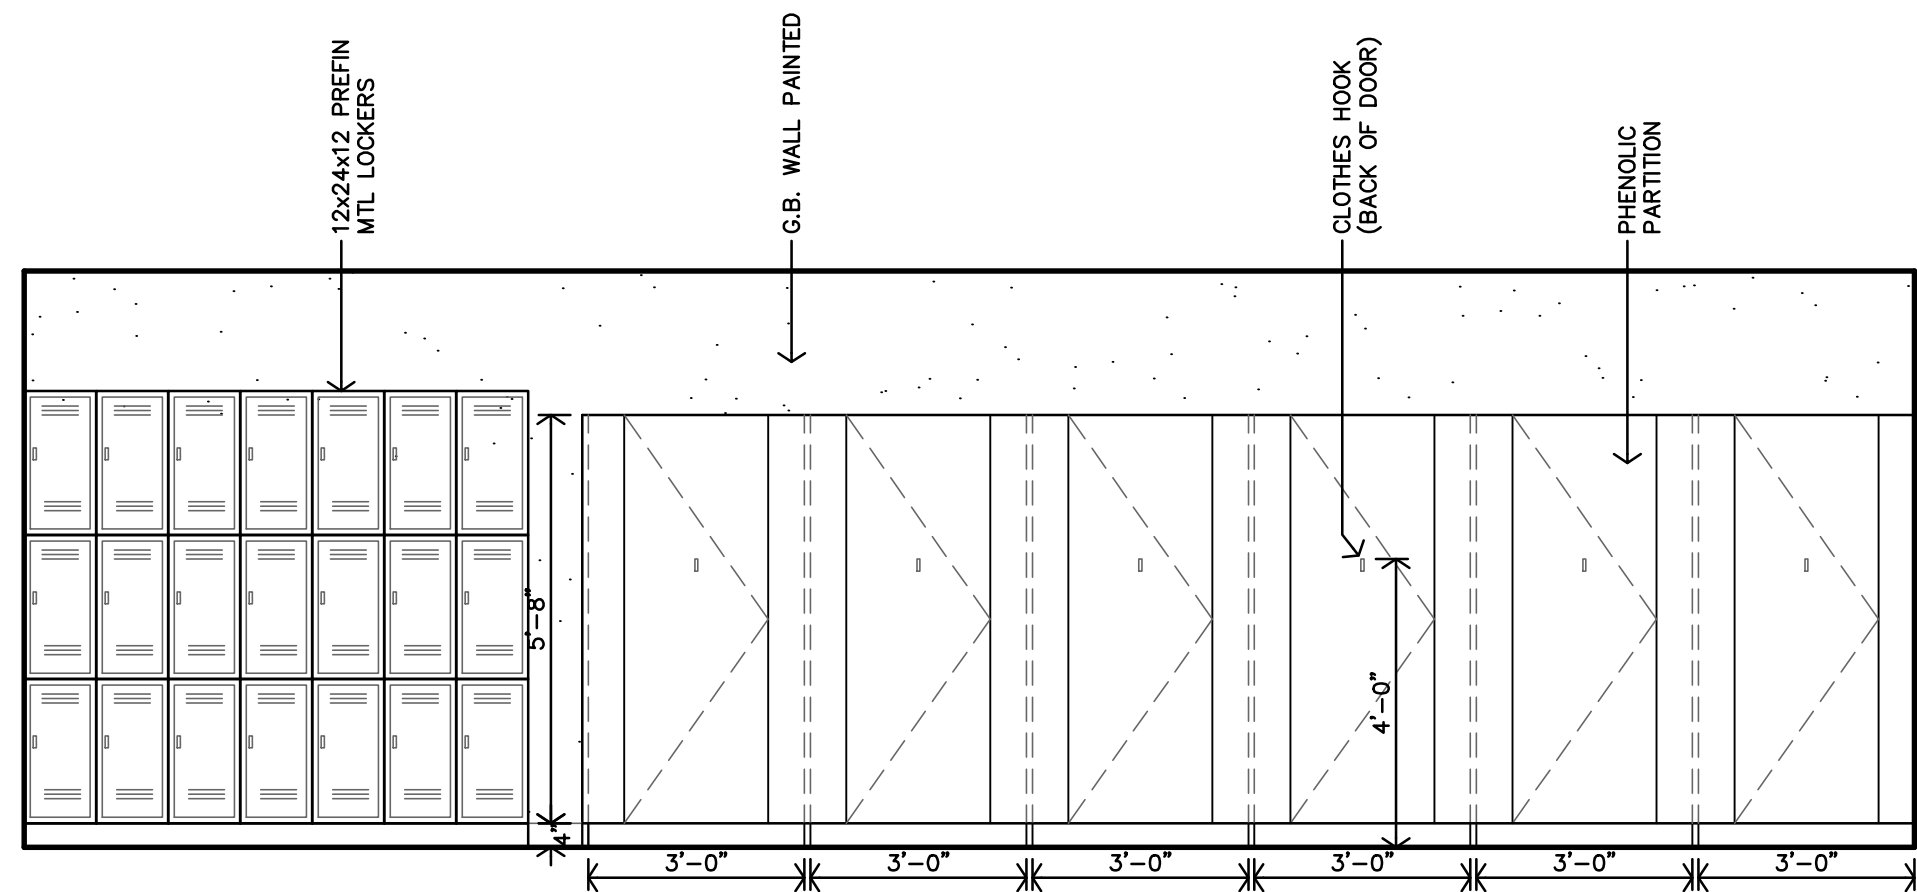

**H** DRESSING ROOM 2 #109  
ENLARGED PLAN  
3/8"=1'-0"

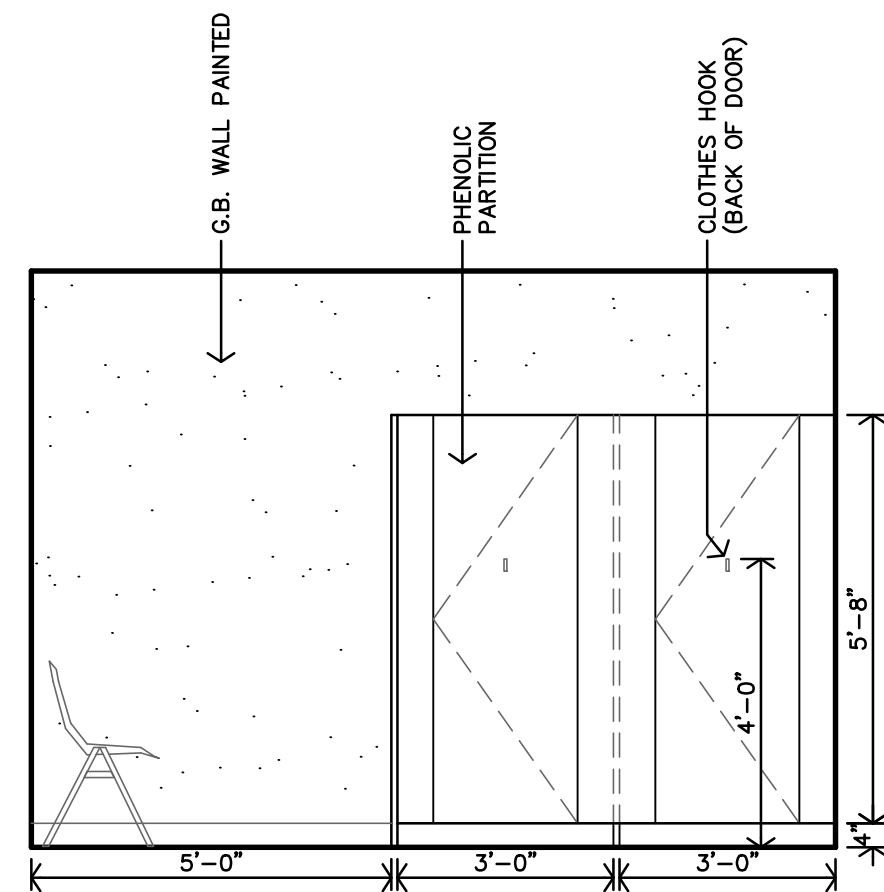


**G** DRESSING ROOM 2 #109  
ENLARGED PLAN  
3/8"=1'-0"

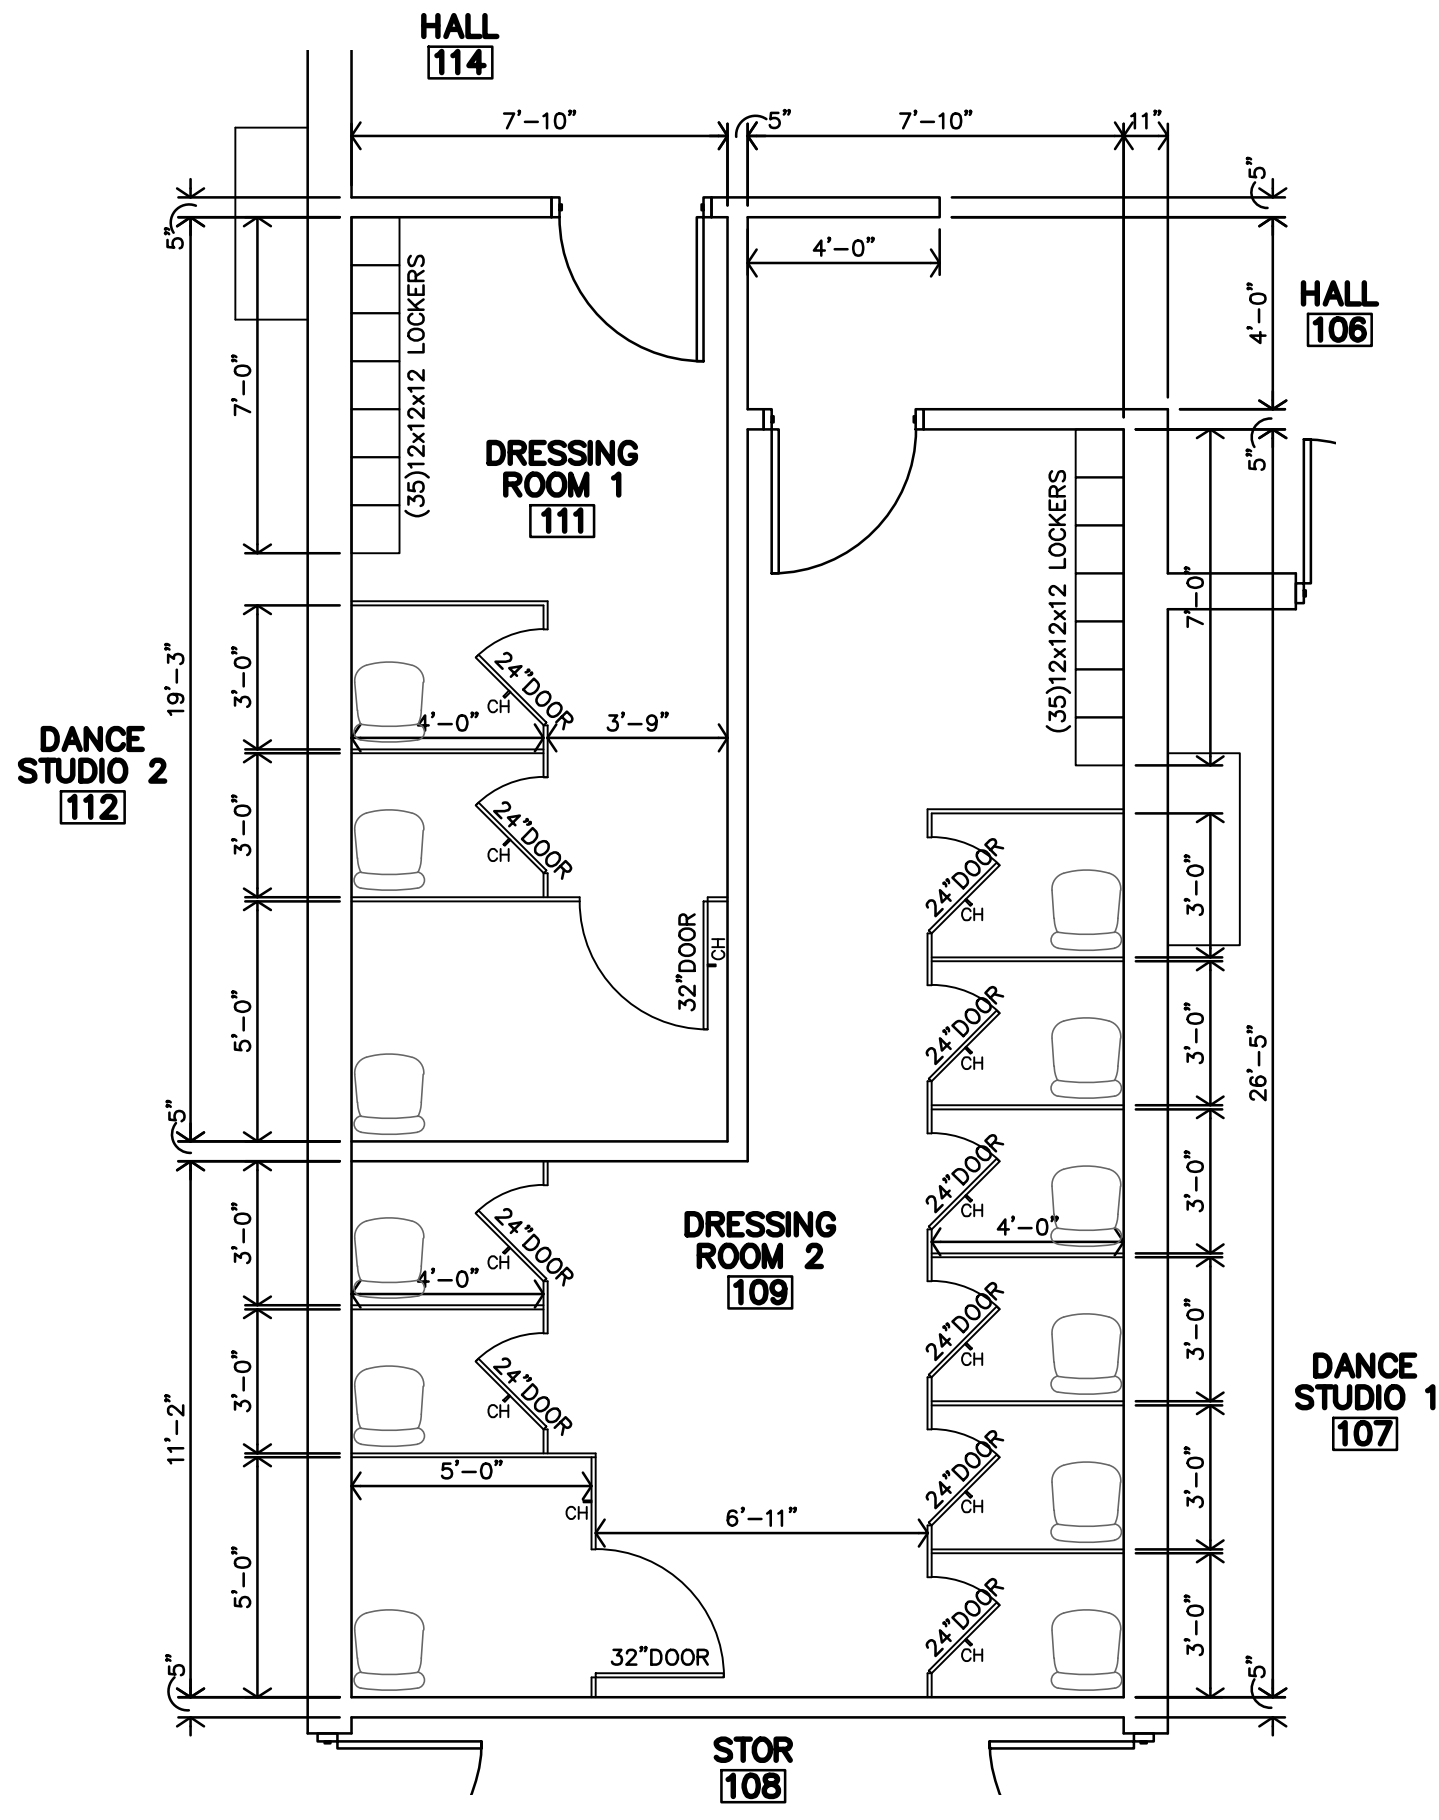


**F** DRESSING ROOMS #109/111  
ENLARGED PLAN  
3/8"=1'-0"

### CASEWORK NOTES


1. GRANITE COUNTERTOPS & BACKSPASHES W/ EASED EDGES, U.N.O.
2. ENTIRE CABINET DOOR (INTERIOR & EXTERIOR) TO BE WOOD, STAINED.
3. PROVIDE ALL NECESSARY FILLERS OF MATCHING MATERIALS.
4. INSTALL CONTINUOUS FINISH FLOORING BASE @ CASEWORK TOE/KICK.
5. ALL ADJUSTABLE SHELVING SHALL BE 3/4" THICK MATERIAL.
6. ALL UPPER CABINETS SHALL HAVE (2) ADJUSTABLE SHELVES PER EACH CABINET, U.N.O.
7. ALL BASE CABINETS SHALL HAVE (1) ADJUSTABLE SHELF PER EACH CABINET, U.N.O.
8. CABINETS TO BE FLUSH OVERLAY, U.N.O.
9. PROVIDE BLOCKING BEHIND WALL FOR SUPPORT OF CABINETRY.
10. PROVIDE & INSTALL ANGLE SUPPORT BRACKETS WHERE COUNTERTOP SPAN EXCEEDS 36" INCH WIDTH.
11. RUBBER BASE @ TOE KICK, TYP.

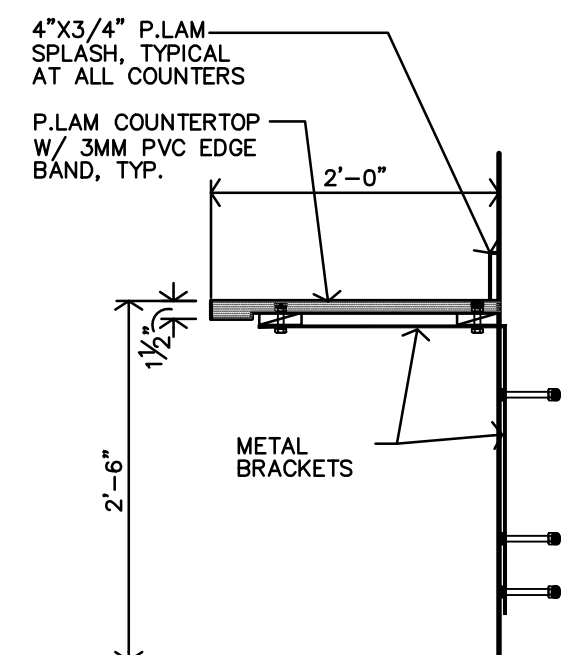


**E** TYPICAL  
CASEWORK SECTION  
3/4"=1'-0"

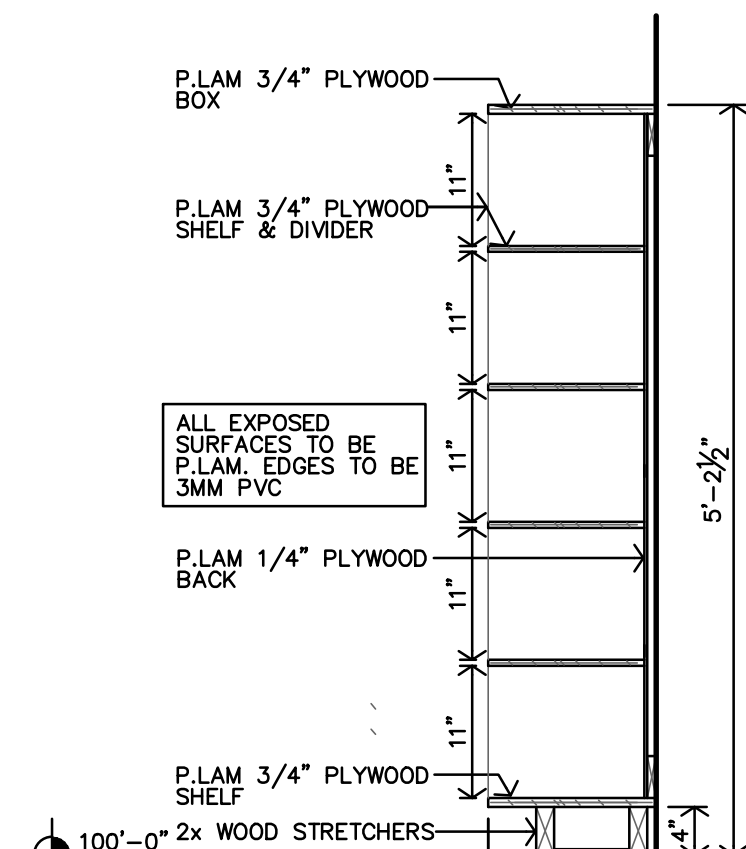


**D** TYPICAL  
CASEWORK SECTION  
3/4"=1'-0"

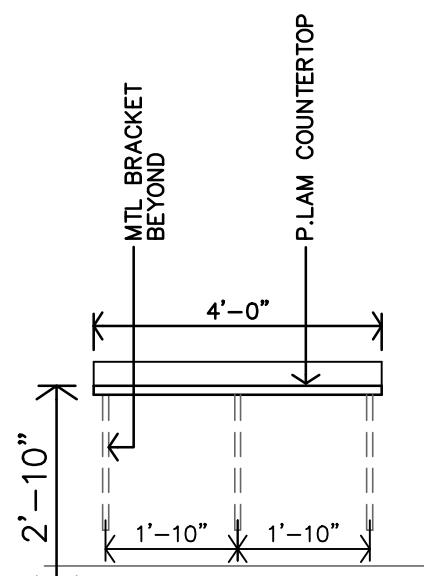


**C** DANCE STUDIO 1/2 #107/112  
CASEWORK ELEVATION  
3/8"=1'-0"

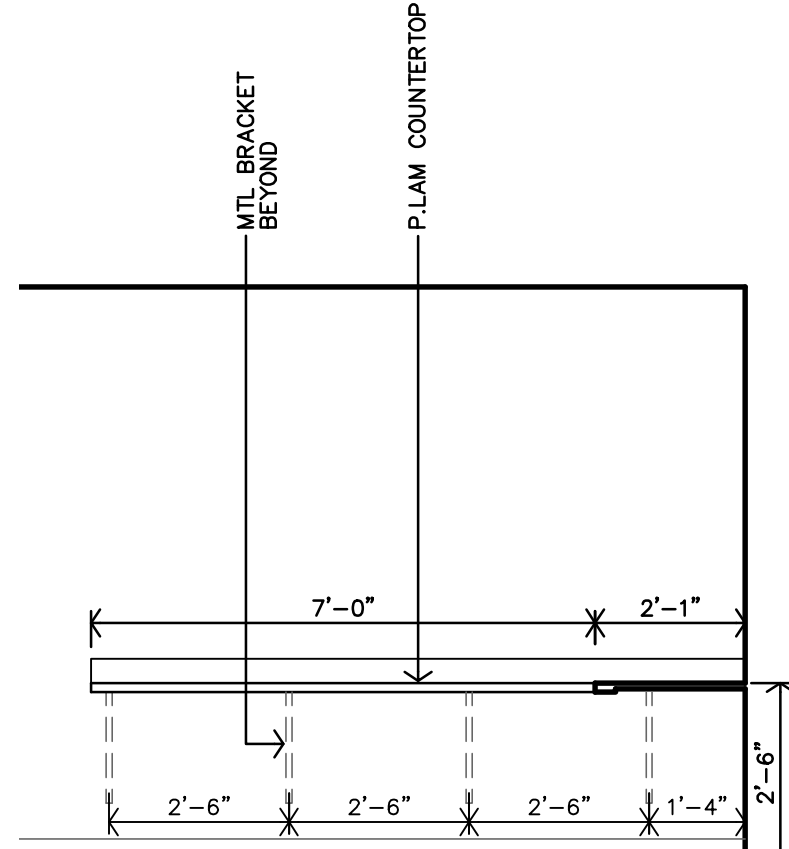

**B** HOMEWORK AREA #116  
CASEWORK ELEVATION  
3/8"=1'-0"

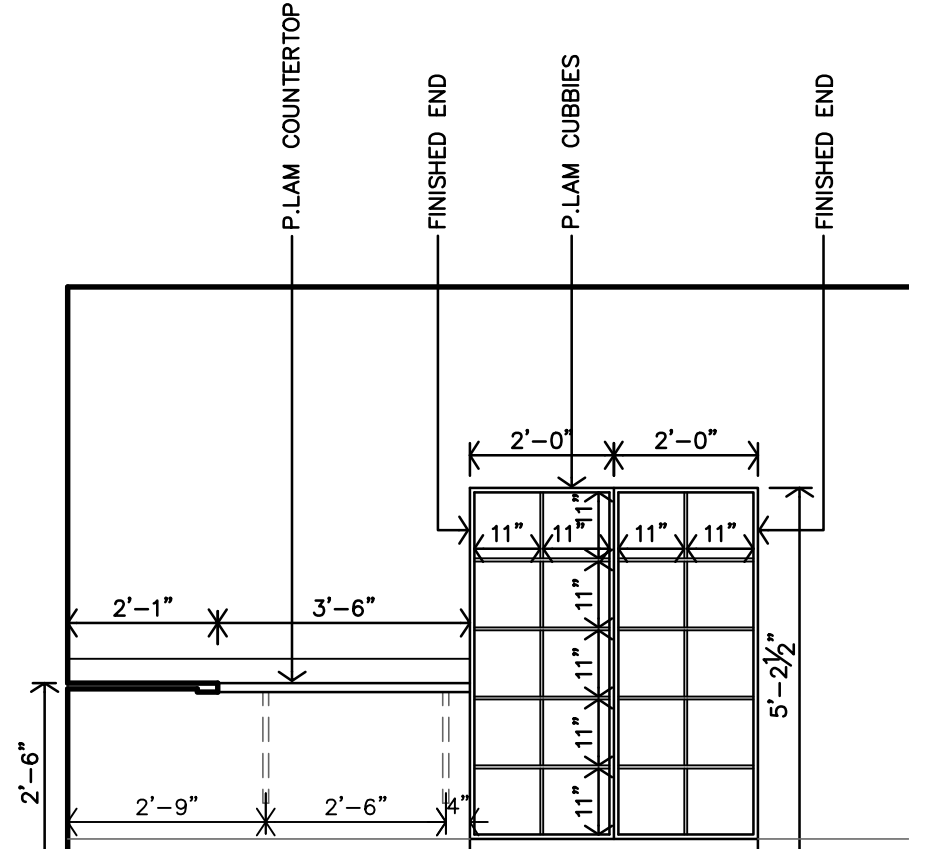

**A** HOMEWORK AREA #116  
CASEWORK ELEVATION  
3/8"=1'-0"

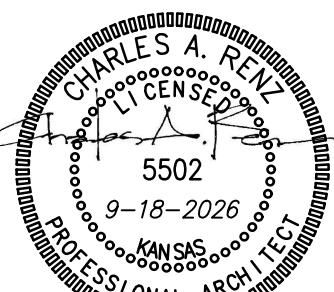

REVISION:

DATE: 9-18-2026

JOB: 22-3239

SHEET NO.:

**A9.6**

COPYRIGHTED ©

**THEATRE SALINA**  
DANCE STUDIOS & SCENE SHOP EXPANSION  
SALINA, KANSAS

**JCR**  
JonesGillamRenz  
730 N. Ninth  
Salina, KS 67401  
785.827.0386  
jg@jgarchitects.com

1881 Main Street, Suite 301  
Kansas City, MO 64108




WINDOW SCHEDULE						
MARK	WIDTH	HEIGHT	STYLE	QUANTITY	DETAILS	NOTES
A	5'-4"	10'-0"	ALUM STOREFRONT - FIXED	1	F/G/H-A4.14	
B	20'-2"	10'-0"	ALUM STOREFRONT - FIXED	1	F/G/H-A4.14	
C	30'-2"	10'-0"	ALUM STOREFRONT - FIXED	1	F/G/H-A4.14 (K sim)	
D	6'-3"	11'-0"	ALUM STOREFRONT - FIXED	1	H/J-A4.14	
E	±11'-7 1/4"	11'-0"	ALUM STOREFRONT - FIXED	1	H/J-A4.14	
F	2'-8"	2'-5"	ALUM STOREFRONT - FIXED	1	D-A4.14	A
G	2'-8"	2'-5"	ALUM STOREFRONT - FIXED SPANDREL GLASS	1	E-A4.14	A
GENERAL NOTES: 1. CONTRACTOR MUST INSTALL MTL. FLASHINGS & CAULK FOR A WEATHER & WATERIGHT CONDITIONS @ ALL EXTERIOR WINDOW UNITS. 2. CONTRACTOR MUST INSTALL 1/4" INSUL. OR THERMAL BREAK, CONTINUOUS AROUND WINDOW.				SPECIFIC NOTES: A. F.V. EXISTING OPENING WIDTH & HEIGHT.		

GLAZING SCHEDULE					
MARK	INTERIOR	EXTERIOR	THICKNESS	TYPE	
			1/4"	1" INSULATED	
				TINTED	
				TEMPERED	
				SPANDREL	
A1	•	•	•	•	•
A2	•	•	•	•	•
B1	•	•	•	•	•


DOOR SCHEDULE																	
MARK	DOOR							FRAME				RATING	DETAILS	REMARKS			
	SIZE			MATERIAL	TYPE	FINISH		MATERIAL	TYPE	FINISH							
	W	H	T			ALUMINUM	WOOD			HOLLOW METAL	METAL				TYPE	OVERHEAD	MANUAL ROLL-UP
BASEMENT																	
B1	3'-0"	7'-0"	1 3/4"	•	•	C			•	•	•	2	•	90min	R-A10.2		
MAIN LEVEL																	
100				EXISTING	ALUMINUM	DOOR	&	FRAME	TO	REMAIN						D	
101	3'-0"	8'-0"	1 3/4"	•	•	A		•	•	E	•	•			H/J-A4.14		
102	3'-0"	7'-0"	1 3/4"		•	C			•	•	1	•	•		A/B-A10.2		
103	3'-0"	7'-0"	1 3/4"		•	C			•	•	1	•	•		J/K-A10.2		
104	3'-0"	7'-0"	1 3/4"		•	B			•	•	1	•	•		A/B-A10.2	B	
106	3'-0"	7'-0"	1 3/4"		•	B			•	•	1	•	•		A/B-A10.2	B	
107	3'-0"	7'-0"	1 3/4"		•	C			•	•	1	•	•		G/H-A10.2		
108	4'-0"	7'-0"	1 3/4"		•	C			•	•	1	•	•		G/H-A10.2		
109	3'-0"	7'-0"	1 3/4"		•	C			•	•	1	•	•		L/M-A10.2		
111	3'-0"	7'-0"	1 3/4"		•	C			•	•	1	•	•		A/B-A10.2		
112	3'-0"	7'-0"	1 3/4"		•	C			•	•	1	•	•		A/B-A10.2		
113	3'-0"	7'-0"	1 3/4"		•	B			•	•	1	•	•		G/H-A10.2	B	
114	3'-0"	7'-0"	1 3/4"		•	B			•	•	1	•	•		J/K-A10.2	B	
115	3'-0"	7'-0"	1 3/4"		•	C			•	•	1	•	•		A/B-A10.2		
116	3'-0"	7'-0"	1 3/4"		•	C			•	•	1	•	•		C/D-A10.2		
117	3'-0"	7'-0"	1 3/4"		•	C			•	•	1	•	•		C/D-A10.2		
118	3'-0"	7'-0"	1 3/4"		•	B			•	•	1	•	•		C/D-A10.2	B	
119	3'-0"	7'-0"	1 3/4"		•	B			•	•	1	•	•		C/D-A10.2	B	
120	3'-0"	7'-0"	1 3/4"		•	B			•	•	1	•	•		C/D-A10.2	B	
121	3'-0"	7'-0"	1 3/4"		•	C			•	•	2	•	•		N/O-A10.2	B	
122	3'-0"	7'-0"	1 3/4"		•	B			•	•	1	•	•	90min	E/F-A10.2	B	
123	7'-0"	12'-0"				C	E	•							A-A4.3		
124	3'-0"	7'-0"	1 3/4"		•	C			•	•	1	•	•		N/O-A10.2		
126	12'-0"	12'-0"			•	D			•	•					B-A4.3		
127	±7'-0"	±12'-0"			•	E	•		•	•					A-A4.3sim, EX. OPN'G	C	
128	9'-0"	12'-0"			•	E	•		•	•					B-A4.5		
129				EXISTING H.M. DOOR & FRAME TO REMAIN												A	
131	PR3'-0"	7'-0"	1 3/4"		•	C			•	•	2	•	•	90min	P-A10.2		
GENERAL NOTES: 1. ALL EXPOSED UNITS TO BE PAINTED AT INTERIOR AND EXTERIOR. 2. CONTRACTOR MUST INSTALL MTL. FLASHINGS & CONT. CAULK FOR A WEATHERIGHT SEAL AT ALL EXTERIOR DOORS & FRAMES. 3. H.M. DOOR & FRAME TO BE PAINTED W/ INDUSTRIAL ENAMEL UNLESS NOTED OTHERWISE. SAND SMOOTH PRIOR TO PAINTING. SPRAY FINISH ONLY, NO BRUSH FINISH.																	
SPECIFIC NOTES: A. EXISTING DOOR & FRAME: SAND & PAINT. B. INSULATED GLASS @ INTERIOR DOOR LITE KIT. C. F.V. EXISTING OPENING WIDTH & HEIGHT. D. REPAIR VERTICAL RODS TO ENSURE SMOOTH OPERATION AND LATCHING OF BOTH DOORS ADJUST ALL COMPONENTS AS NECESSARY.																	

INTERIOR FINISH SCHEDULE																											
FINISHES & INSTRUCTIONS																											
P1 LATEX ENAMEL					C SEALED CONCRETE					CT CERAMIC TILE					FP FIBERGLAS REINF. PANEL												
P2 EPOXY PAINT					W1/W2 WOOD BASE PER SHEET A9.5					ST STAIN & SEAL					EX EXISTING												
C1 CARPET					RB RUBBER COVE BASE					S1 SHEET VINYL					TX TEXTURE												
LVT LUXURY VINYL TILE					RN RUBBER NON-SLIP																						
NO.	DESCRIPTION	FLOOR							BASE		N.WALL		E.WALL		S.WALL		W.WALL		CEILING		REMARKS						
		CARPET	WALK-OFF CARPET	CERAMIC TILE	LUXURY VINYL TILE	CUSHIONED WOOD DANCE FLOOR	SEALED CONC.	STEEL STAIR	EXISTING FLOORING TO REMAIN	CERAMIC TILE	WOOD	RUBBER	EXISTING FLOORING TO REMAIN	5/8" FIRE RATED G.B.	CONCRETE BLOCK	EXPOSED CONCRETE	5/8" FIRE RATED G.B.	CONCRETE BLOCK	EXPOSED CONCRETE	5/8" FIRE RATED G.B.		CONCRETE BLOCK	EXPOSED CONCRETE	2x2 SUSPENDED	5/8" FIRE RATED G.B.	STRUCTURE EXPOSED	EXISTING TO REMAIN
BASEMENT																											
	GREEN ROOM									RB		P1		P1		P1		P1									6,7,8
MAIN LEVEL																											
101	LOBBY		×							RB		●		P1		●		P1		P1		●	P1				
102	HALL				LVT					RB				P1		P1		P1		P1		●	P1				
103	MECHANICAL					C				RB		P1		P1		P1		P1		P1		●	P1				
104	STORAGE				LVT					RB		P1		P1		P1		P1		P1		●	P1				
106	HALL				LVT					RB		●		P1		P1		P1		P1		●	P1				
107	DANCE STUDIO 1				×				W			P1		P1		P1		P1		P1		●	×				12, 13, 15
108	STORAGE				LVT					RB		P1		P1		P1		P1		P1		●	×				
109	DRESSING ROOM 2				LVT					RB		P1		P1		P1		P1		P1		●	×				
111	DRESSING ROOM 1				LVT					RB		P1		P1		P1		P1		P1		●	×				
112	DANCE STUDIO 2				×				W			P1		P1		P1		P1		P1		●	×				12, 13, 15
113	CHORUS				LVT					RB		P1		P1		P1		P1		P1		●	×				
114	HALL				LVT					RB		P1		P1		●		P1		P1		●	P1				
116	HOMEWORK AREA				LVT					RB		P1		P1		P1		P1		P1		●	×				
117	HALL				LVT					RB		P1		P1		P1		P1		P1		●	×				
118	WOMEN			CT					CT	RB		CT		CT		CT		CT		CT		●	×				1
119	JANITOR					C				RB		P1		P1		P1		P1		P1		●	×				
121	MEN			CT					CT	RB		CT		CT		CT		CT		CT		●	×				1
122	PRIVATE STUDIO				LVT					RB		P1		P1		P1		P1		P1		●	×				
123	SCENE SHOP					C				×	×	●			P1		P1		P1		P1		●	×			10, 11, 12 ALT
124	STAGE				×					×	×	P1		P1		P1		P1		P1		●	×				11
124	PRODUCTION STOR.				LVT					RB		P1		P1		P1		P1		P1		●	×				2, 2A, 2B, 4, 9, 10, 14
125	TELECOM												NO CHANGES									●	×				
126	STORAGE				LVT					RB		P1		P1		P1		P1		P1		●	×				
127	HALL									RB	×			P1		P1		P1		P1		●	×				5
STAIR																											
S1	STAIR				LVT					RB		P1		P1		P1		P1		P1		●	×				4
S2	STAIR				LVT					RB		P1		P1		P1		P1		P1		●	×				4
S3	STAIR									RB		P1		P1		P1		P1		P1		●	×				
S4	STAIR	C1			LVT					RB		P1		P1		P1		P1		P1		●	×				3, 9
GENERAL NOTES:																											
A. INSTALL ALUMINUM TRANSITION STRIP BETWEEN FLOOR MATERIAL OF DIFFERING HEIGHTS, INCLUDING BUT NOT LIMITED TO CONCRETE/LVT TRANSITIONS. ALL TRANSITIONS TO E RAMP STYLE.																											
B. CUT TILE TIGHT AROUND DOOR FRAMES, AT LVT FLOORS INSTALL CLEAR SILICONE SEALANT AT THE FLOOR/FRAME TRANSITION.																											
C. ALL OPSYUM BOARD AREAS WHICH ARE ACCESSORIES TO THE ROOM INCLUDING BUT NOT LIMITED TO SOFFITS, BULKHEADS, TRIM, ETC. SHALL BE PAINTED REGARDLESS OF WHETHER IT IS SPECIFICALLY INDICATED PER SCHEDULE.																											
D. ALL G.B. WALLS & PERMANENT PARTITIONS SHALL RECEIVE RUBBER BASE UNLESS NOTED OTHERWISE.																											
E. AT REMOVED FLOOR FINISHES - SAND, FILL &/OR PREP SMOOTH & LEVEL TO RECEIVE NEW FLOOR FINISH. EXPOSED CONC SHALL BE SANDED, ALL GLUE REMOVED, AND SEALED.																											
F. AT THE EXISTING BUILDING: ALL AREAS INDICATED TO RECEIVE NEW FLOORING/BASE, THE CONTRACTOR SHALL BE RESPONSIBLE TO REMOVE EXISTING MATERIALS & COMPLETELY CLEAN & PREP SUBFLOOR FOR INSTALLATION OF NEW MATERIALS.																											
G. WALL TYPE SHOWN FOR GENERAL INFORMATION ONLY. CONTRACTOR SHALL COORDINATE WALL MATERIAL W/ DRAWINGS AND FIELD CONDITIONS. ALL AREAS INDICATED TO RECEIVE NEW FINISH SHALL RECEIVE COMPLETE FINISH AS SCHEDULED AT ENTIRE ROOM. CONTRACTOR SHALL COORDINATE FINISHES AND ACCENTS WITH DETAILS AND INTERIOR ELEVATIONS.																											
H. AT PATCHED AREAS THE CONTRACTOR TO PAINT OR REFINISH ADJACENT AREA AS REQUIRED TO BLEND THE PATCH COMPLETELY WITH EXISTING, CORNER TO CORNER.																											
I. INSTALL ALUMINUM TRANSITION STRIP AT ALL DIFFERING FLOOR MATERIALS.																											
J. CONTRACTOR SHALL COORDINATE ALL AREAS & QUANTITY FOR DEMOLITION & PATCHING AS REQ'D BY ALL TRADES FOR BASE BID &/OR ALTERNATE. WHETHER INDICATED BY INTERIOR FINISH SCHEDULE OR NOT.																											
K. PATCH FLOOR AND WALLS & FIRE SEAL AROUND ALL PIPE PENETRATIONS THRU FLOORS AND WALLS.																											
L. ALL H.M. DOORS & FRAMES TO BE PAINTED W/ INDUSTRIAL ENAMEL UNLESS NOTED OTHERWISE. H.M. DOORS AND FRAMES SHALL BE SANDED SMOOTH PRIOR TO PAINTING.																											
M. WHERE FLOOR AND/OR WALL FINISHES REQUIRE REMOVAL OF PLUMBING AND/OR ELECTRICAL DEVICES G.C. SHALL BE RESPONSIBLE TO COORDINATE WITH SUBCONTRACTORS FOR REINSTALLATION.																											
N. FLOORING CONTRACTOR SHALL VERIFY THAT SUBFLOOR IS LEVEL AND PROPERLY PREPPED PRIOR TO INSTALLATION OF ANY FLOORING MATERIALS.																											
O. ALL CONTROL JOINTS AT EXPOSED CONCRETE FLOORS SHALL RECEIVE SEALANT COMPATIBLE W/ FLOOR SEALER.																											
P. CONTRACTOR SHALL COORDINATE WITH INTERIOR ELEVATIONS, FLOOR PLANS AND MISCELLANEOUS DETAILS TO VERIFY ALL AESTHETIC ACCENTS AND DETAILS.																											
Q. INSTALL PAINTABLE SILICONE SEALANT AT ALL G.B. TO CMU AND G.B. TO CONCRETE WALL TRANSITIONS.																											
R. CONTRACTOR SHALL VERIFY THAT FLOORS ARE PREPPED/"FLOORSTONED" FOR LEVEL TRANSITION BETWEEN DIFFERING MATERIALS.																											
SPECIFIC NOTES:																											
1. ALL WALLS TO RECEIVE CERAMIC TILE SHALL BE INSTALLED OVER 5/8" CEMENT BACKER BD.																											
2. 1/4" MASONITE OVER NEW CONCRETE PAINT BOTH SIDES OF MASONITE PRIOR TO INSTALL.																											
3. PREP EXISTING BRICK FLOOR AREA AND INSTALL NEW MASONITE PER NOTE 2.																											
4. LVT TREADS & RUBBER NOSING.																											
5. RUBBER NOSING & CARPET TREADS.																											
6. RUBBER BASE @ NEW WALLS TO MATCH EXISTING.																											
7. PAINT EXIST/NEW CMU TO MATCH EXISTING CORNER TO CORNER. REF. PLAN.																											
8. EXIST. SUSP CLO TO REMAIN. NEW CEILING TO MATCH GRID & TILES.																											
9. DOOR FRAME TO BE PAINTED.																											
10. EXISTING DOOR FRAMES AND EXPOSED RAILINGS TO BE PAINTED.																											
11. STEEL JAMBS & HEADERS TO BE PAINTED.																											
12. ALL ROOF STRUCTURE, DECK, JOISTS, PIPING, CONDUIT, UNISTRUT GRID & SUPPORTS TO BE DRYFALL PAINTED.																											
13. PAINT BAND AT ELEVATION 13'-0" AFF TO BE PAINTED ABOVE LINE TO MATCH DRYWALL STRUCTURE/																											
14. PREP NORTH WALL WHERE CARPET REMOVED FOR PAINT.																											
15. DANCE STUDIO FLOOR IS TO BE RECESSED TO RECEIVE NEW CUSHIONED WOOD FLOORING. SUBFLOOR TO RECEIVE 15ML VAPOR BARRIER WITH TAPED EDGES AND JOINTS.																											
EXTERIOR - PAINTING NOTES:																											
1. ALL NEW EXTERIOR GAS PIPING AT ROOF AND EXTERIOR WALLS SHALL BE PAINTED WITH SHERWIN WILLIAMS DTM ACRYLIC OR SHERWIN WILLIAMS ALL SURFACE ENAMEL. APPLY TWO COATS OR AS REQUIRED FOR FULL COVERAGE AND PROTECTION OF PIPES.																											
2. EXTERIOR METAL RAILINGS, GUARDS, UNTELS, DOOR FRAMES, BOLLARDS, ETC. SHALL BE PAINTED PER SPECIFICATIONS TO MATCH EXISTING ADJACENT FINISHES.																											
3. ALL PARKING STRIPING, AFFECTED BY NEW CONSTRUCTION AND SITE ACCESS IS TO BE PAINTED TO MATCH EXISTING STRIPING.																											




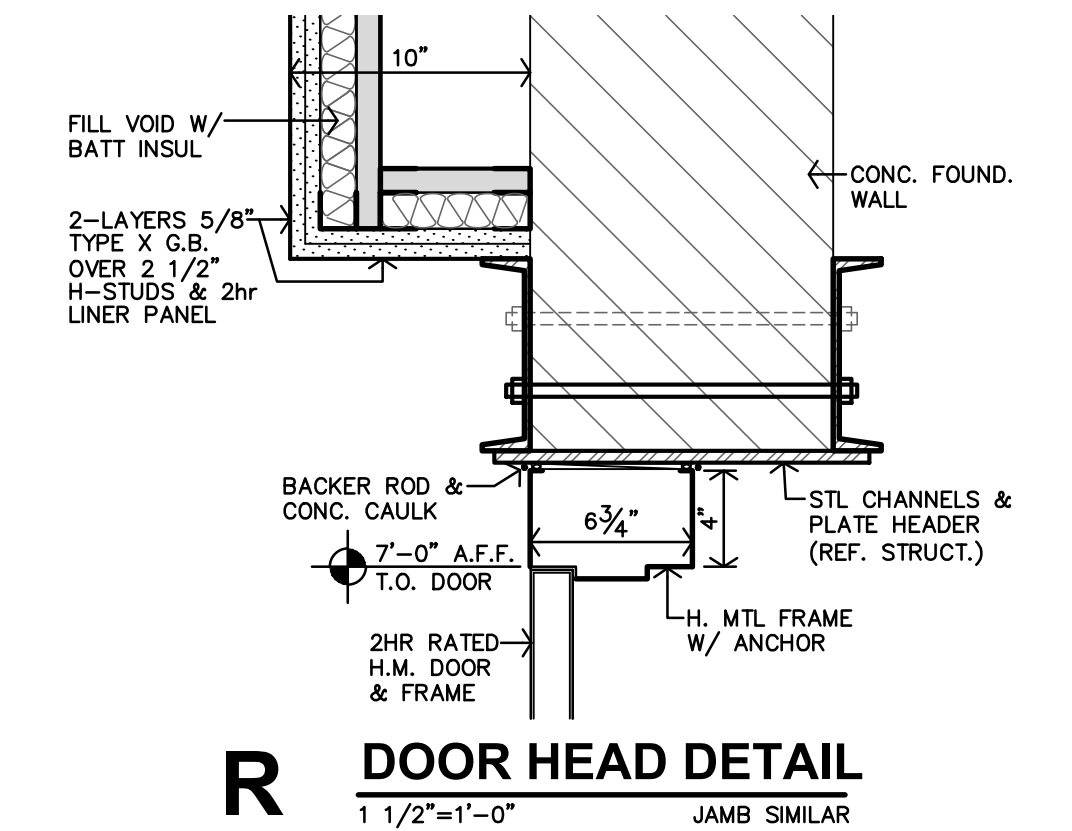


**R DOOR HEAD DETAIL**  
1 1/2"=1'-0" JAMB SIMILAR

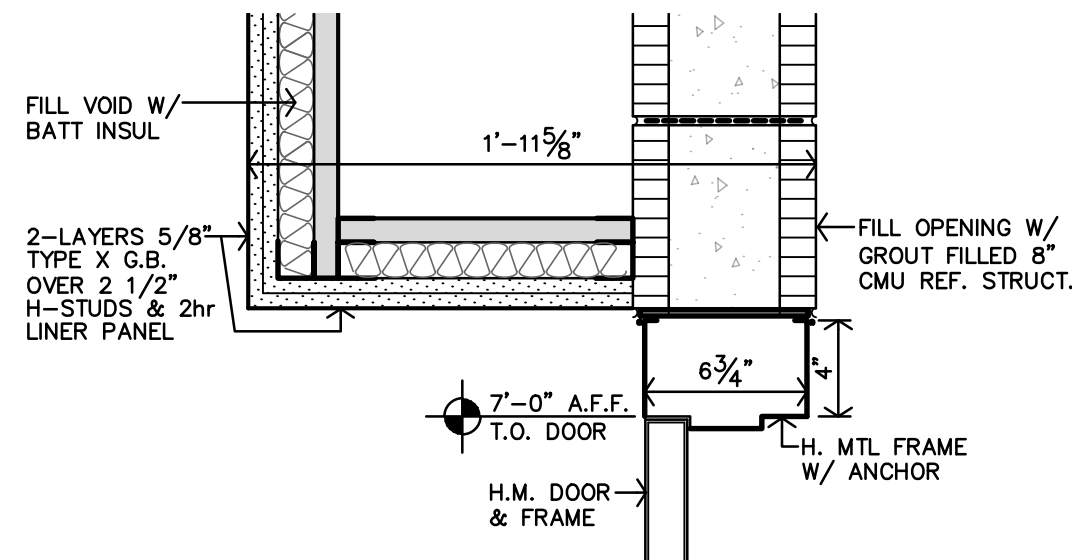


**P DOOR HEAD DETAIL**  
1 1/2"=1'-0" JAMB SIMILAR

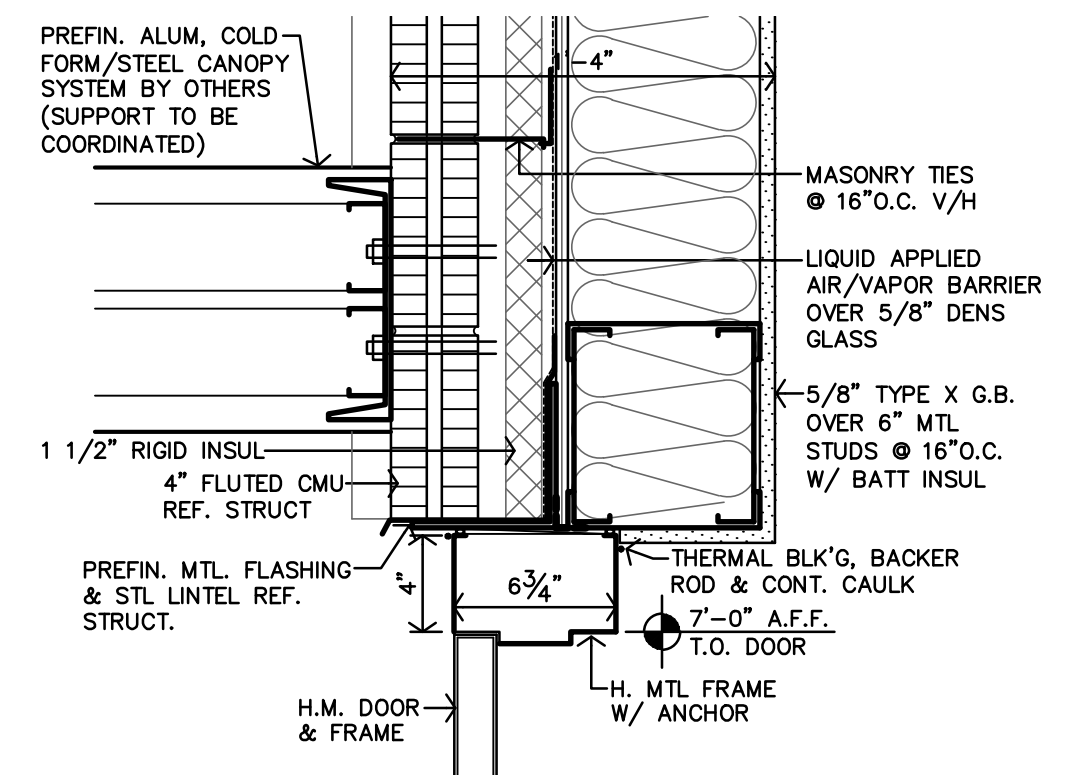


**O DOOR HEAD DETAIL**  
1 1/2"=1'-0" JAMB SIMILAR

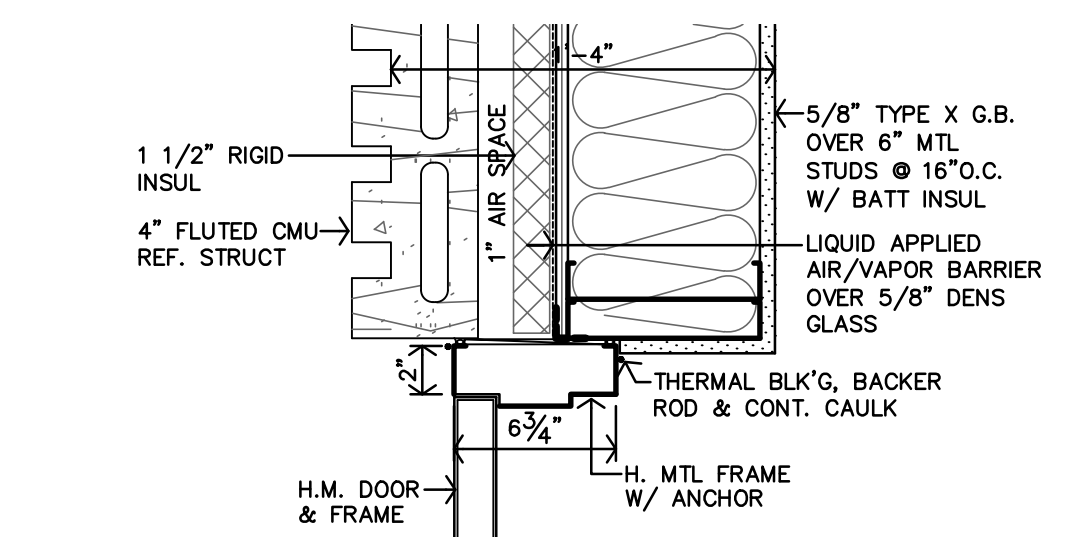


**N DOOR JAMB DETAIL**  
1 1/2"=1'-0"

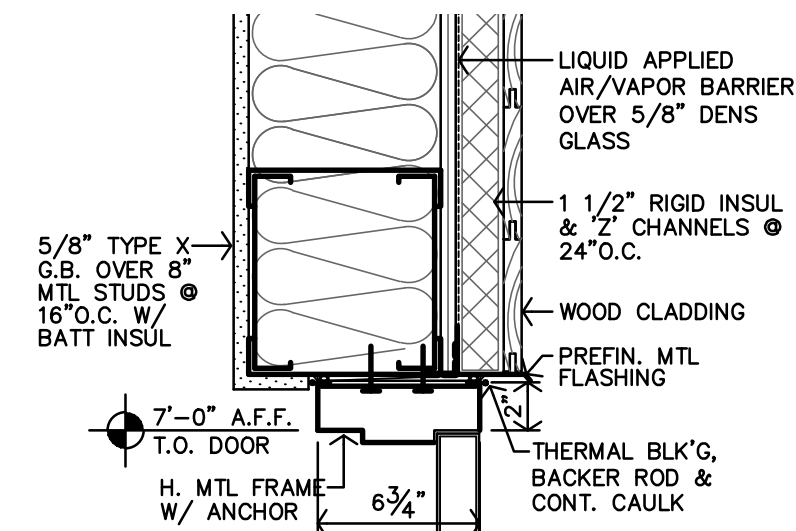


**M DOOR HEAD DETAIL**  
1 1/2"=1'-0" JAMB SIMILAR

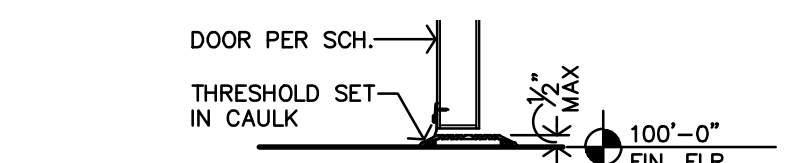


**L THRESHOLD DETAIL**  
1 1/2"=1'-0"

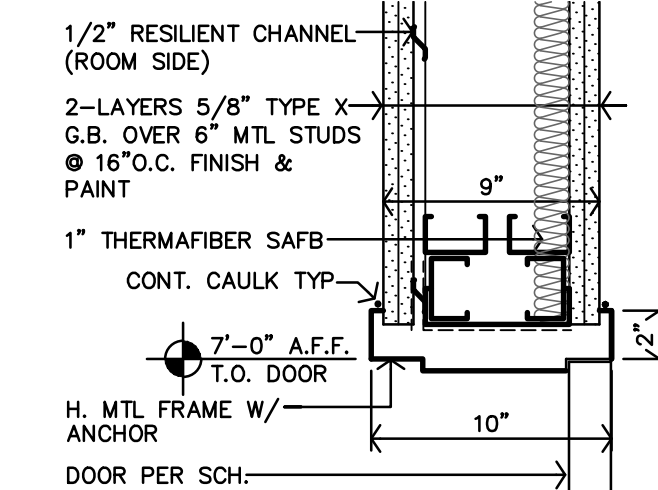


**K DOOR HEAD DTL.**  
1 1/2"=1'-0"

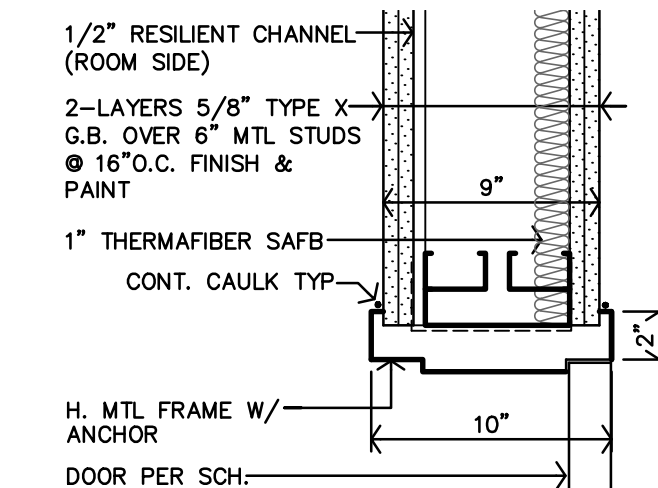


**J DOOR JAMB DTL.**  
1 1/2"=1'-0"

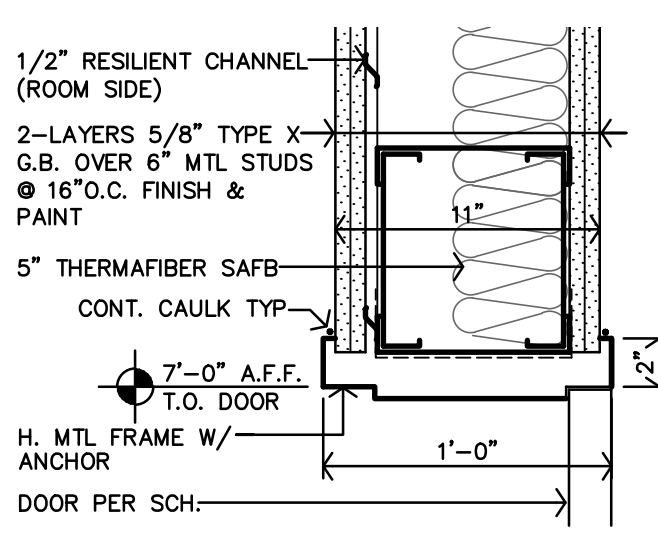


**H DOOR HEAD DTL.**  
1 1/2"=1'-0"

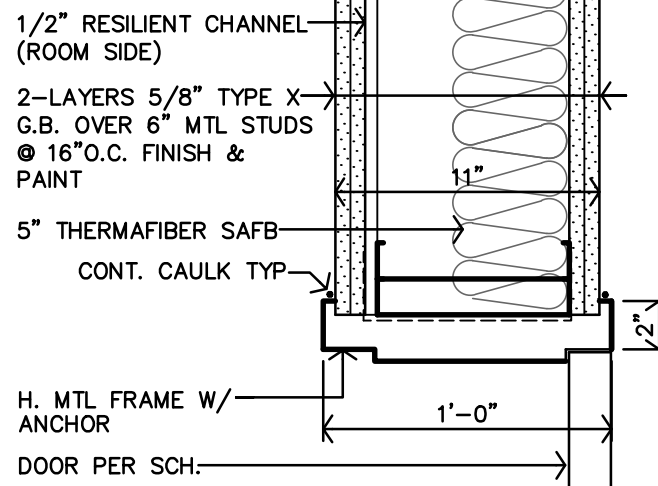


**G DOOR JAMB DTL.**  
1 1/2"=1'-0"

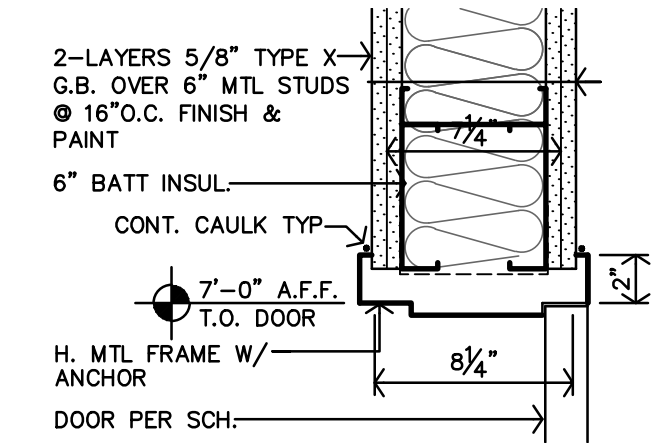


**F DOOR HEAD DTL.**  
1 1/2"=1'-0"

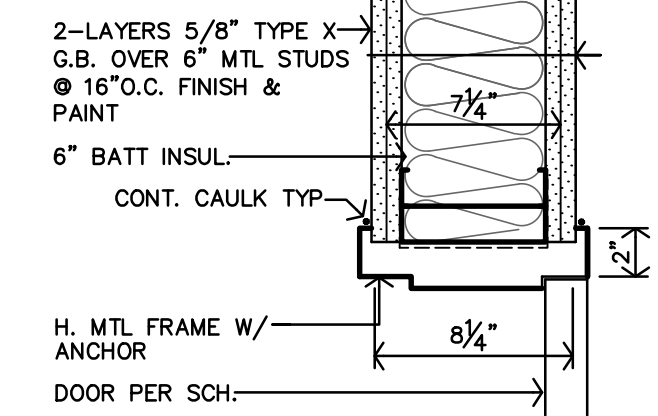


**E DOOR JAMB DTL.**  
1 1/2"=1'-0"

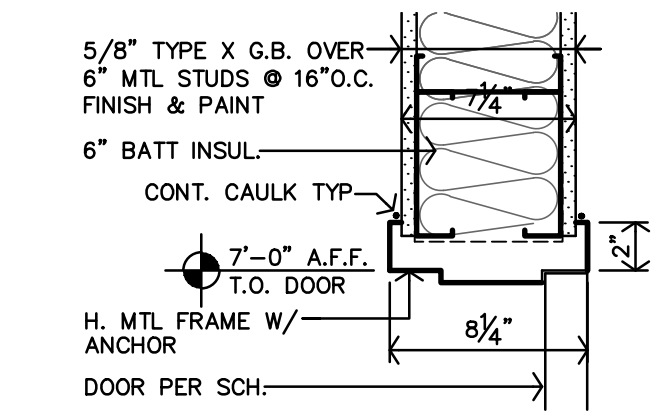


**D DOOR HEAD DTL.**  
1 1/2"=1'-0"

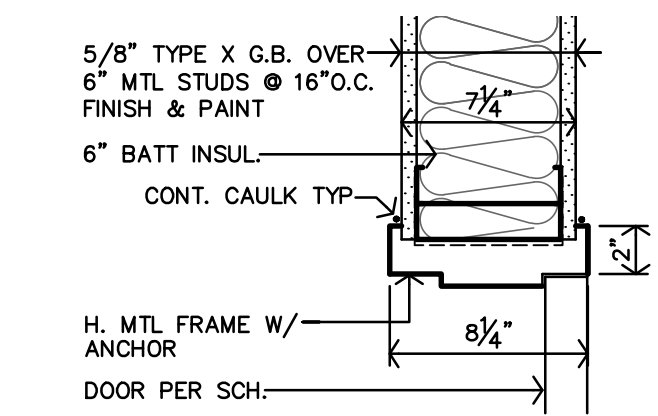

**C DOOR JAMB DTL.**  
1 1/2"=1'-0"

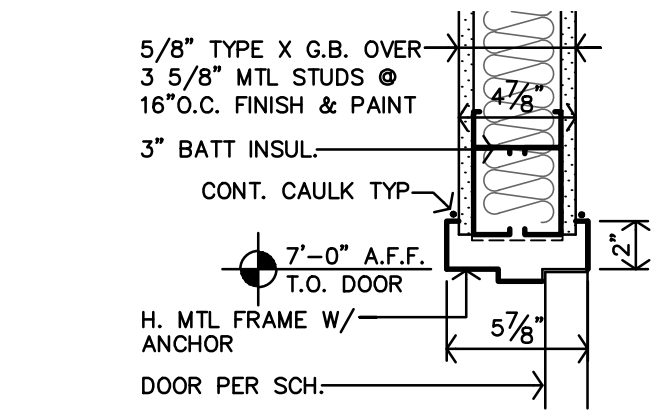

**B DOOR HEAD DTL.**  
1 1/2"=1'-0"

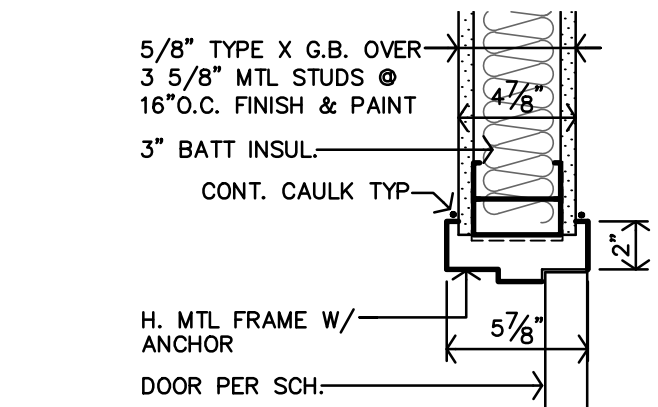

**A DOOR JAMB DTL.**  
1 1/2"=1'-0"



## 1. General Information:

- A. The contractor shall verify dimensions and conditions before construction and notify the engineer of any discrepancies, inconsistencies, or difficulties affecting the work before proceeding.
- B. The contractor shall coordinate all disciplines, verifying size and location of all openings, whether shown on structural drawings or not, as called for on architectural, mechanical, or electrical drawings. In the case of work in an existing building the contractor shall scan existing structure to locate all rebar in the area of the new core/opening using ground penetrating radar and notify the engineer of record for review prior to core/cutting. Conflicts, inconsistencies, or other difficulties affecting structural work shall be called to the architect or engineer's attention for direction before proceeding.
- C. All design and construction work for this project shall conform to the requirements of the 20XX International Building Code, as amended by the City of Salina, Kansas.
- D. These drawings are for this specific project and no other use is authorized.

## 2. Structural Design Load Criteria:

- A. Floor Live= 100psf  
B. Roof Live= 20psf  
C. Snow= Pg= 20psf, Pf=15.4psf, Is= 1.0  
Ce=1.0, Cf=1.1, Drift per ASCE/SEI T-16
- D. Lateral Loads:  
1) Wind Vel=10 mph, Exposure C  
Occupancy [Risk] Category II, Iw=1.0  
GcPf=+/-0.18  
Design wind pressures to be used for the design of exterior component and cladding materials on the designated zones of wall and roof surfaces shall be per section 30.7.1 and Table 30.7-2 of ASCE/SEI T-16. Tabulated pressures shall be multiplied by exposure, reduction factors, exposure adjustment factors, and topographic factors where applicable.
- 2) Seismic: S_s = 0.076, S₁ = 0.048  
Occupancy [Risk] Category II, Ie=1.0  
Site Classification B, S_{ds}=0.026, S_{u1}=0.077  
Seismic Design Category B  
Basic Seismic Force-resisting System:  
H. Steel System not Specifically Detailed for Seismic Resistance  
Equivalent Lateral Force Procedure  
(R=3, V=_____, Omega=3, Cd=3)
- E. This project is designed to resist the most critical effects resulting from the load combinations of section 1605.3 of the 2018 International Building Code.

## 3. Concrete:

- A. All concrete for foundations (walls, grade beams, footings and piers) shall develop minimum ultimate compressive design strength of 3500 psi in 28 days, but not less than 500 pounds of cement shall be used per cubic yard of concrete regardless of strengths obtained, not over 6 gallons of water per 100 pounds of cement and not over 4 inches of slump.
- B. All concrete for interior flatwork shall develop minimum ultimate compressive design strength of 4000 psi in 28 days, but not less than 540 pounds of cement shall be used per cubic yard of concrete regardless of strengths obtained, not over 540 gallons of water per 100 pounds of cement and not over 4 inches of slump. Concrete mix shall contain testing data proving concrete design mix shrinkage is less than 0.034% at 28 days when tested according to ASTM C157 (air drying method only).
- C. All concrete for exterior flatwork shall have a minimum design compressive strength of 4500 psi in 28 days, but not less than 560 pounds of cement per cubic yard concrete, not over 5 gallons of water per 100 pounds of cement, with 6% +/- 1% air maximum at 4 inches of slump.
- D. The preceding minimum mix requirements may have water-reducing admixtures conforming to ASTM C494 added to the mix at manufacturer's dosage rates for improved workability.
- E. The preceding minimum mix requirements may have up to 15% maximum of the cement content, replaced with an approved ASTM C618 Class C fly ash, provided the total minimum cementitious content is not reduced.
- F. All interior concrete slabs on grade shall be placed over 15 mil, Class A Vapor Barrier per ASTM E1145 with less than 0.01 perms, tested after mandatory conditioning. All joints shall be lapped and sealed per manufacturer's recommendations. All penetrations, as well as damaged vapor barrier material shall also be sealed per manufacturer's recommendation prior to concrete placement. Install barrier per manufacturer recommended details at all discontinuous edges (at interior columns, exterior edge of slab, etc.) to ensure terms of warranty are followed. The vapor barrier shall be placed over free-draining granular material as prescribed by the project soils report.
- G. Basement foundation walls shall be braced at the base and top of wall by the contractor until the slab on grade at the base and the floor framing/slab at the top of wall is complete and the concrete has achieved 75% of the design strength. The contractor is responsible for engineering and design of the wall bracing, if required.
- H. All concrete is reinforced concrete unless specifically called out as unreinforced. Reinforce all concrete not otherwise shown with same steel as in similar sections or areas. Any details not shown shall be detailed per ACI 318 and meet requirements of ACI 318, current editions.
- I. Control joints in dirt formed slab to be as shown on plans. Where not shown, limit controlled areas to not more than 144 square feet, or 12 feet on any side. Slab panel side ratio shall not exceed 1/2 to 1.
- J. Contractor shall verify that all concrete inserts, reinforcing and embedded items are correctly located and rigidly secured prior to concrete placement.
- K. Construction joints in beams, slabs, and grade beams shall occur at midspan (middle third) unless noted otherwise. Provide 2 x 4 horizontal keys at construction joints for shear transfer.
- L. No aluminum items shall be embedded in any concrete.

## 4. Reinforcing Steel:

- A. All reinforcing steel shall conform to the requirements of ASTM A615 or A706 grade 60 steel. Welded plain wire fabric shall be supplied in sheets and conform to the requirements of ASTM A1064.
- B. Clear coverage of concrete over reinforcing steel shall be as follows:  
Concrete placed against earth 3"  
Slabs 1"  
Beams or Columns 1-1/2"  
Other 2"  
All coverage shall be nominal bar diameter minimum.
- C. All details shall be the same size and spacing as adjoining main bars (splice up 48 bar diameters or 24" minimum unless noted otherwise).
- D. At corners of all walls, beams, and grade beams supply corner bars (minimum 2'-0" in each direction or 48 bar diameters) in outside face of wall, matching size and spacing of horizontal bars. Where there are no vertical bars in outside face of wall, supply 3 - #4 vertical support bars for corner bars.
- E. Bars marked continuous and all vertical steel shall be lapped 48 bar diameters (2'-0" minimum) at splices and embedments, unless shown otherwise. Splice top bars near midspan and splice bottom bars over supports, unless noted otherwise.
- F. At all holes in concrete walls and slabs, add 2 - #5 bars (opening dimension plus 46 diameters long) at each of four sides and add 2 - #5 x 5'-0" diagonally at each of four corners of hole. Openings in 8" thick walls are reinforced similar, but with 1 - #5 instead of 2 - #5, respectively.
- G. Unless otherwise covered on architectural plans or specifications, vertical control joints in concrete wall shall be spaced at a maximum of 20'-0" on center and coordinated with the architect. Every other horizontal wall reinforcing bar shall be discontinuous at control joints except heavy top and bottom bars unless noted otherwise. Provide base seal waterstop style number 712 (by Greenstreak Inc. or approved equal) on dirt face side of wall at all walls below grade.
- H. Accessories shall be as specified in latest edition of the ACI Detailing Handbook and the concrete Reinforcing Steel Institute Design Handbook. Maximum accessory spacing shall be 4'-0" on center, and all accessories on exposed surfaces are to have plastic coated feet.
- I. All slabs and stairs not shown otherwise shall be 6" thick with #4 bars at 12" on center each way. All exterior porches and stoops not otherwise detailed may be constructed in any standard manner, solid or hollow, but must be reinforced with #4 bars at 12" on center each way minimum. Porches shall be dove-tailed to adjacent walls or grade beams with #4 bars at 12" on center, hooked or embedded 48 diameters into both members. Slope porches 1/8" per foot for drainage unless noted otherwise.
- J. Allow 1/2 ton of reinforcing bars #4 or larger to be used as directed in the field for special conditions by the engineer of record (labor for placing same to be included).

## 5. Structural Steel:

- A. All structural steel beams and columns shall be ASTM A992, grade 50 steel and all miscellaneous steel shall be ASTM A36 grade steel (except at moment connections where plates shall be ASTM A572, grade 50). Hollow Structural Sections (HSS) shall be ASTM A500, grade C. Fabrication and erection shall be in accordance with AISC 308-05 "Code of Standard Practice for Steel Buildings and Bridges" in the 13th Edition of the AISC Steel Construction Manual.
- B. All welding shall conform to the recommendations of the AWS.
- C. All exterior steel and connections, and brick relief angles shall be hot-dip galvanized.
- D. All bolts not otherwise specified shall be 3/4" diameter high strength (ASTM A325-N). All bolts shall be fully pretensioned. All open connections shall be designed per the AISC Steel Construction Manual "Framed Beam Connections" for the indicated reactions or at least 0.4 x beam total shear capacity, Vn/Omega, shown in the maximum total uniform load tables, whichever is greater; and, shall account for eccentricity when the bolt line is more than 24" from the center of the support. All connections must be two bolt minimum. Additional connection elements may not be specifically shown in the conceptual details in this set but may be required by the final connection design, such as stiffener plates, doubler plates, supplement/reinforcing plates or other connection material. Connection design and shop drawing preparation shall be completed under the direct supervision of a professional engineer licensed in the state the project is located and shop drawings and connection calculations shall be submitted to the engineer of record for review and approval. The above loading information is given at the service-load level. Allowable Stress Design is to be used in the selection and completion of the connection design and details.
- E. All anchor bolts shall be 3/4" diameter, ASTM F1554, Grade 36 unless noted otherwise. Washers of minimum size and thickness for the given anchor diameter in Table 14-2 of the AISC Steel Construction Manual shall be provided for every column anchor bolt. Washers shall have a standard size hole for the anchor bolt. At building perimeter columns and columns at braced frames washers shall be welded all around to the column base plate with 3/16" fillet weld.
- F. Design, fabrication and erection of all open-web bar joists shall comply with the recommendations of the Steel Joist Institute (SJI). Joists shall be designed to support the loads in the standard load tables of SJI Spacing and Tables plus an additional point load of 200 lbs. on the top or bottom chord at any location without additional web reinforcing.
- G. All K-series joists shall bear 2'-1/2" minimum on structural steel beams and be welded to the beams with 2 1/2" of 1/8" fillet weld each side (minimum).
- H. All K-series joists bearing on masonry walls shall have 6" x 3/8" x 6" bearing plates set in bond beams with 2 1/2" of 1/8" fillet weld each side (minimum). Bearing plates shall be located not more than 1/2" from the face of the wall on the bearing side. Joists shall bear 4" minimum on bearing plates and be welded to beams or bearing plates with 2 1/2" of 1/8" fillet weld each side (minimum).
- I. All steel joists shall have horizontal bar or angle bridging per Steel Joist Institute specifications. Provide rigid bridging in addition to so and provide horizontal bridging where joists are discontinuous unless horizontal bridging is anchored to wall top and bottom. Joist sleep allowance shall comply with AISC Standard Practice.
- J. Steel joists shall be designed for 20psf net uplift resulting from wind loading as measured 12ft from a building corner, 10psf net uplift as measured from the over 4 ft edge and 10psf net uplift. Net uplift loads are resultant from ASD load combination D+D₁ + 0.6W.
- K. All openings in steel joist roof to have 3 x 3 x 1/4" angle frame set between joists. Support mechanical equipment with 4 x 4 x 5/16" angles laid between joists framed to 4 x 4 x 5/16" angles (length equals mechanical unit dimension plus distance each end to next panel point) laid parallel to and welded to top and/or bottom cord of joists to distribute load to joist panel points.
- L. All steel joists shall have a midspan camber approximately equal to that recommended by the Steel Joist Institute specifications.
- M. Design and installation of steel decking shall comply with the recommendations of the Steel Deck Institute (SDI). All decking shall be galvanized unless noted otherwise.
- N. Allow 2.0 tons structural steel to be used as directed in field for special conditions by the engineer of record. Cost for shop drawings, fabrication, delivery, detailing, and erection to be included. 50% of structural steel allowance shall be bid as miscellaneous galvanized angle and plate.

## 6. Post-installed Anchors:

- A. Post-installed anchors shall be used only where specified on the drawings unless approved in writing by the engineer of record. See drawings for anchor diameter, spacing and embedment. Performance values of the anchors shall be obtained for specified products using appropriate design procedures and/or standards as required by the governing building code. Anchors installed in concrete shall have an ICC-ES Evaluator's Report. Special inspection is required for all post-installed anchors. The general contractor shall coordinate an on-site meeting with the post-installed anchor manufacturer field representative and subcontractor performing the anchor installation to educate the construction team on the anchor installation guidelines and requirements. The contractor shall send a record copy of the meeting meetings to the design team.
- B. Mechanical anchors used in cracked and uncracked concrete shall have been tested and qualified for use in accordance with ACI 308.2 and ICC-ES AC108. All anchors shall be installed per the anchor manufacturer's written instructions.
- C. Adhesive anchors used in cracked and uncracked concrete shall have been tested and qualified for use in accordance with ICC-ES AC308. All anchors shall be installed per the anchor manufacturer's written instructions.
- D. Mechanical anchors used in solid grouted masonry shall have been tested and qualified for use in accordance with ICC-ES AC108. All anchors shall be installed per the anchor manufacturer's written instructions.
- E. Adhesive anchors used in solid grouted masonry shall have been tested and qualified for use in accordance with ICC-ES AC508. All anchors shall be installed per the anchor manufacturer's written instructions.
- F. Anchors used in hollow concrete masonry shall have been tested and qualified in accordance with ICC-ES AC106 or ICC-ES AC58 as appropriate. All anchors shall be installed per the anchor manufacturer's written instructions with appropriate screen tubes used for adhesives.

## 7. Foundations:

- A. The soil investigation was prepared by UES, the report number is A26125.00474.000 and their telephone number is 316-554-0725.
- B. Spread footings, grade beams, thickened slabs, and retaining walls are designed to bear on an engineered system of rammed aggregate piers spaced at a maximum of 10'-0" on center and capable of safely sustaining 6,000 psf and limiting overall settlement to 14" maximum with differential settlement of 1/2" maximum.
- C. Retaining structures are designed for a lateral load of 52 psf equivalent fluid pressure and an at-rest lateral load of 73 psf.
- D. Contractor shall provide for dewatering at excavations from either surface water or seepage.
- E. All foundation excavations shall be inspected by a qualified soil engineer, approved by the architect and/or structural engineer, prior to placement of steel or concrete. This inspection shall be at the owner's expense.
- F. All concrete in the structural portion retaining the backfill shall have attained its design strength prior to being backfilled.
- G. Moisture content in soils beneath building locations should not be allowed to change after footing excavations and after grading for slabs on grade are completed. If subgrade materials become desiccated or softened by water or other conditions, recompact materials to the density and water content specified for engineered fill. Do not place concrete on frozen ground.
- H. Provide helical piers where indicated on plan capable of safely sustaining the loads indicated on the foundation plan. The helical pier designer shall utilize the geotech to determine the quantity and length of the piers.

## 8. Light Gauge Structural Stud Framing:

- A. All load bearing, light gauge structural studs, track, and bridging shall be of the same size, gage, and spacing as shown on the plans, minimum.
- B. All materials shall be 33,000 psi minimum yield, except studs of 16 gage or heavier shall have a minimum yield of 50,000 psi.
- C. All properties, fabrication, and erection shall be in accordance with latest editions of the AISI "Specifications for the Design of Cold-Formed Structural Members".
- D. All framing components shall be cut squarely and at an angle to fit squarely against abutting members. Splicing of fully loaded members is not permitted. Members shall be held firmly in place until properly fastened. Attachments of similar components shall be by welding, screw attachment, or bolting. Wire tying of components is not permitted.

- E. Tracks shall be securely anchored to floor and overhead members. Special anchorage requirements required for wind bracing shall be as shown on the plans.

## 9. Shop Drawing Review:

- A. Bob D. Campbell and Company, Inc. will review the General Contractor's (GC) shop drawings and related submittals (as indicated below) with respect to the ability of the detailed work, when complete, to be a properly functioning integral element of the overall structural system designed by Bob D. Campbell and Company, Inc. Deferred submittals shall be submitted to the architect of record for review who shall forward to the building official for review and approval. Design calculations for deferred submittals shall be submitted at the same time as the shop drawings for review. Design calculations shall be prepared and sealed by a Professional Engineer licensed in the state of the project. The deferred submittal items shall not be installed until the deferred submittal documents have been approved by the building official.
- B. Prior to submittal of a shop drawing or any related material to Bob D. Campbell and Company, Inc., the GC shall:
- 1) Review each submittal for conformance with the means, methods, techniques, sequences and operations of construction and safety precautions and programs incidental thereto, all of which are the sole responsibility of the GC.
  - 2) Revisions and approve each submittal.
  - 3) Stamp each submittal as approved.
- C. Bob D. Campbell and Company, Inc. shall assume that no submission comprises a variation unless the GC advises Bob D. Campbell and Company, Inc. with written documentation.
- D. Shop drawings and related material (if any) required are indicated below. Should Bob D. Campbell and Company, Inc. require more than ten (10) working days to perform the review, Bob D. Campbell and Company, Inc. shall so notify the GC.
- 1) Concrete mix designs and material certificates including admixtures and compounds applied to the concrete after placement.
  - 2) Reinforcing steel shop drawings including erection drawings and bending details. Bar list will not be reviewed for correct quantities.
  - 3) Grout mix designs (for CMU).
  - 4) Location and control joint plans and/or elevations.
  - 5) Structural steel shop drawings including erection drawings and piece details. Include joist, decking and connector submittals. Include miscellaneous framing specified on the structural drawings, but do not submit filled in details for non-structural drawings for Bob D. Campbell and Company, Inc. review.
  - 6) Deferred Submittal: Structural steel connection design calculations submitted concurrently with structural steel shop drawings.
  - 7) Miscellaneous anchors shown on the structural drawings.
  - 8) Standard details and bridging information for light gage metal framing. Erection specifications and details for light gage metal joists and lintels spanning more than 6'-0" shall be submitted. Standard wall framing need not be submitted.
  - 9) Deferred Submittal: Cold-Formed metal framing for exterior walls.
  - 10) Deferred Submittal: Railings and guardrails.
  - 11) Deferred Submittal: Metal stair framing.
- E. Bob D. Campbell and Company, Inc. shall review shop drawings and related materials with comments provided that each submission has met the above requirements. Bob D. Campbell and Company, Inc. shall return without comment unrequired material or submissions without GC approval stamp.

## 10. Statement of Structural Special Inspection:

- A. The structural design for this project is based on completion of special inspections during construction in accordance with section 1704 of the 2012 International Building Code. The owner shall employ one or more qualified special inspectors to provide the required special inspections.
- B. The following inspections and tests are required with the frequency (continuous or periodic) as defined within the referenced section or standard listed below. The General Contractor shall provide notification to the inspector when items requiring inspection are ready to be inspected and provide access for those inspections.
- 1) Shop Fabrication - structural steel and steel bar joist per Section 1705.1 of the 2012 International Building Code.
  - 2) Steel Construction per Section 1705.2 and the quality assurance requirements of AISC 341 chapter J (as referenced by AISC 360).
  - 3) Cold-Formed Steel Deck per Section 1705.2.2 and the quality assurance requirements of SDI GA/VAC.
  - 4) Concrete Construction per Section 1705.3 and Table 1705.3
    - a. Reinforcing Steel Placement
    - b. Reinforcing Steel Welding
    - c. Cast in Place Anchors
    - d. Post Installed Anchors
    - e. Design Mix Verification
    - f. Concrete Sampling and Testing
    - g. Concrete Placement
    - h. Concrete Curing
    - i. Formwork Shape, Location and Dimensions
  - 5) Verification of Soils per Table 1705.6
  - 6) Inspections and Tests of Driven Deep Foundation per Table 1705.7
- C. The special inspector shall submit inspection reports to the building official, with the following information and any other designated person.
- D. All discrepancies shall be brought to the immediate attention of the contractor for correction, then, if uncorrected, to the proper design authority, building official and structural engineer.
- E. The special inspector shall submit a final signed report stating that the work requiring special inspection was, to the best of the inspector's knowledge, in conformance with the approved plans and specifications and the applicable workmanship provisions of the building code.

## 11. Copyright and Disclaimer:

- A. All drawings in the structural set (5-series drawings) are the copyrighted work of Bob D. Campbell and Company, Inc. These drawings may not be photographed, traced, or copies in any manner without the written permission of Bob D. Campbell and Company, Inc. Exception: Original drawings may be printed for distribution to the owner, architect, and general contractor for coordination, bidding, and construction. Subcontractors may not reproduce these drawings for any purpose or in any manner.
- B. I, Christopher A. Bevin, P.E., registered engineer and a representative of Bob D. Campbell and Company, Inc. do hereby accept professional responsibility as required by the professional registration laws of this state for the structural design drawings consisting of 5-series drawings. I hereby disclaim responsibility for all other drawings in the construction document package, they being the responsibility of other design professionals whose names and signature statements may appear elsewhere in the construction document package.

## LEGEND:

- ..... SPAN DIRECTION OF DECK AND DECK/SLAB TYPE PER SCHED. ON SO-1
- HSS 6x6x1/4 COLUMN SIZE
- BASE PLATE MARK - SEE SCHEDULE ON THIS SHEET
- ..... FOOTING MARK PER SCHED ON THIS SHEET

- ..... MOMENT CONNECTION TO DEVELOP 50% OF MOMENT CAPACITY OF BEAM AND 40% OF SHEAR CAPACITY


M21x44 CONT. (25) c=1"

- CAMBER  
# OF 3/4" DIA x 5'Lg STUDS  
BEAM CONTINUOUS OVER COLUMN (WHERE INDICATED)  
BEAM SIZE

CONCRETE FOOTING SCHEDULE			
SOIL PRESSURE :		CONCRETE F _c :	REBAR F _y :
1500 psf		3500 psi	60,000 psi
TYPE	FOOTING SIZE (FT) x THICKNESS (IN)	REBAR SIZE & SPACING EA. WAY ³	
3	3'-0" x 3'-0" x 18"	#4 @ 6"oc BOTTOM	
3A	3'-0" x 3'-0" x 32"	#4 @ 6"oc TOP & BOTTOM	
4	4'-0" x 4'-0" x 32"	#4 @ 6"oc TOP & BOTTOM	
4	4'-0" x 4'-0" x 18"	#4 @ 6"oc BOTTOM	
5	5'-0" x 5'-0" x 28"	#4 @ 6"oc BOTTOM	
5P	5'-0" x 5'-0" x 36" PILE CAP	REFER TO 11/53.0	

## NOTES:

1. EXTERIOR FOOTINGS OR FOOTING AT GRADE BEAM SHALL MATCH GRADE BEAM DEPTH AND BE PLACED WITH GRADE BEAM. PROVIDE SPECIFIED REBAR TOP AND BOTTOM WITH 4 STANDARD TO SUPPORT WALLS.
  2. CENTER FOOTINGS ON COLUMNS AND/OR WALL. CENTER LINES PER PLAN, UNLESS OTHERWISE NOTED.
  3. FOOTING REINFORCEMENT TO BE PLACED @ BOTTOM OF FOOTING UNO. IN SCHED.
- C. The special inspector shall submit inspection reports to the building official, with the following information and any other designated person.
- D. All discrepancies shall be brought to the immediate attention of the contractor for correction, then, if uncorrected, to the proper design authority, building official and structural engineer.
- E. The special inspector shall submit a final signed report stating that the work requiring special inspection was, to the best of the inspector's knowledge, in conformance with the approved plans and specifications and the applicable workmanship provisions of the building code.

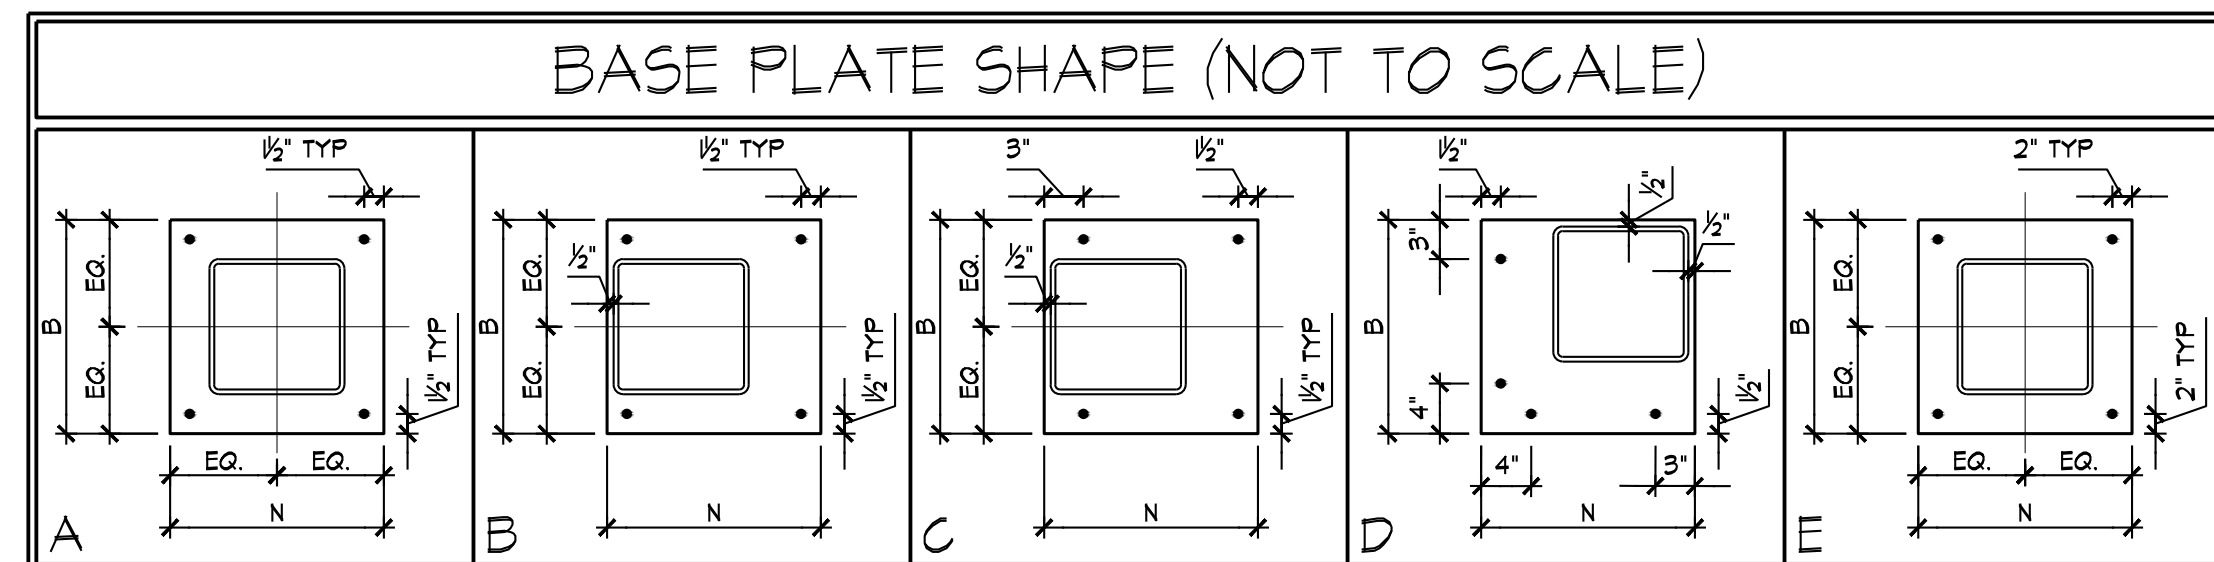

STRUCTURAL DECK & SLAB SCHEDULE	
MARK	DESCRIPTION
SOB-1	4" CONC. (4000 psi) SLAB ATOP 15 MIL VAPOR BARRIER ATOP 4" CLEAN GRANULAR LEVELING COURSE, ATOP SUITABLE SUBGRADE MATERIAL PER GEOTECH SPECIFICATIONS. REINF. SLAB WITH 6x6-M2.4xM2.4 WWF. T/SLAB EL. PER PLAN. SLOPE TO DRAIN
SOB-2	4" CONC. (4500 psi, AIR ENTRAINED) SLAB ATOP 4" GRANULAR LEVELING, ATOP LOW VOLUME CHANGE (LVC) COMPACTED MATERIAL PER GEOTECH SPECIFICATIONS. REINF. SLAB W/ 6x6-M2.4xM2.4 WWF. T/SLAB ELEV= PER PLAN.
CD-1	5" CONC (4,000 PSI) SLAB. 3" NORMAL WEIGHT CONCRETE ATOP 2" DEEP 20ga GALVANIZED COMPOSITE DECK REINF SLAB W/ 6x6-M2.4xM2.4 WWF. TOP OF SLAB PER PLAN
CD-2	4" CONC. (4000 psi) SLAB. REINF. SLAB WITH #3 @ 12"oc EA WAY MID-HT ATOP 1/2" APA-RATED PLYWOOD SHEATHING
RD-1	1/2" 22ga TYPE B WIDE RIB ROOF DECK (PRIMED). ATTACH W/ No. 12 SCREWS IN 36/4 PATTERN W/ No. 10 SIDELAP FASTENERS @ 12"oc
RD-2	3/8" 20ga GALVANIZED ACoustical DOVETAIL ROOF DECK. 3-SPAN CONTINUOUS BASIS OF DESIGN. NICKOR VULCRAFT 3.5DA. ATTACH W/ 3/8" PUDDLE WELDS IN 24/3 PATTERN W/ No. 10 SIDELAP FASTENERS @ 12"oc

## NOTES:

1. SOB = SLAB-ON-GRADE TYP.
2. CD = CONCRETE SLAB & DECK TYP.
3. RD = ROOF DECK TYP.

## STRUCTURAL ABBREVIATIONS

AT	AT	FS	FAR SIDE	PERP	PERPENDICULAR
AND	AND	FT6	FOOTING	PL	PLATE
ROUND, DIAMETER	ROUND, DIAMETER	FT6	FIELD VERIFY	PLF	POUNDS PER LINEAR FOOT
ADTL	ADDITIONAL	FV	FAR SIDE	PJP	PARTIAL JOINT PENETRATION
ABOVE FINISHED FLOOR	ABOVE FINISHED FLOOR	FT6	FOOTING	PSF	POUNDS PER SQUARE FOOT
ALTERNATE	ALTERNATE	GA	GAUGE	PSI	POUNDS PER SQUARE INCH
ARCH	ARCHITECTURAL	GA/V	GALVANIZE(D)	QTY	QUANTITY
BLDG	BUILDING	GEN	GENERAL	RAD	RADIUS
B/	BOTTOM OF	GR	GRADE	RD-#	ROOF DECK TYPE
BM	BEAM	HORIZ	HORIZONTAL	REF	REFERENCE
BOTT	BOTTOM	HORIZ	HOLLOW STRUCTURAL SECTION	REINFC	REINFORCEMENT
BRG	BRIDGE	INSIDE	INSIDE FACE	REQD	REQUIRED
C	CAMBER	INT	INTERIOR	REV	REVISION
CD-#	CONCRETE DECK TYPE	JOIST	JOIST	RL	ROOF LIVE LOAD
C-J	CONSTRUCTION/CONTROL JOINT	JST	JOINT	RTU	ROOF TOP UNIT
C/L	COMPLETE JOINT PENETRATION	SC	SCHEDULE	SC	SCHEDULE
CL	CENTERLINE	SECT	SECTION	SECT	SECTION
CMU	CONCRETE MASONRY UNIT	SHT	SHEET	SIM	SIMILAR
COL	COLUMN	SIM	SIMILAR	SNOW	SNOW LOAD
CONC	CONCRETE	SOG	SLAB-ON-GRADE	SOG-#	SLAB-ON-GRADE TYPE
CONN	CONNECTION	SOG-#	SLAB-ON-GRADE TYPE	SPC6	SPACING
CONT	CONTINUOUS	SPRT	SUPPORT	SPEC	SPECIFICATION
COORD	COORDINATE	SQ	SQUARE	SQ	SQUARE
COV, CVR	COVER	S6	STEEL	S6	STEEL
DBL	DOUBLE	S6LT	SHORT-SLOTTED HOLE TRANSVERSE	S6LT	SHORT-SLOTTED HOLE TRANSVERSE
DET	DETAIL	STD	STANDARD	STD	STANDARD
DIM	DIAMETER	STIFF	STIFFENER	STIFF	STIFFENER
DL	DEAD LOAD	STIRRUP	STIRRUP	STIRRUP	STIRRUP
DWG	DRAWING	STL	STEEL	STL	STEEL
EA	EACH	STRUCT	STRUCTURE, STRUCTURAL	STRUCT	STRUCTURE, STRUCTURAL
EAC	EACH	T	TOP	T	TOP
EF	EDGE OF DECK	THRU	THROUGH	THRU	THROUGH
EJ	EXPANSION JOINT	TOP	TOP OF STEEL, TOP OF SLAB	TOP	TOP OF STEEL, TOP OF SLAB
EL ELEV	ELEVATION	TRANS	TRANSVERSE	TRANS	TRANSVERSE
EMBED	EMBEDMENT, EMBEDDED	TRS	TRUSSES	TRS	TRUSSES
ENGR	ENGINEER	TYP	TYPICAL	TYP	TYPICAL
ENG	ENGINEER	UNO	UNLESS NOTED OTHERWISE	UNO	UNLESS NOTED OTHERWISE
EOR	ENGINEER OF RECORD	V	SHEAR FORCE	V	SHEAR FORCE
EOS	EDGE OF SLAB	VERT	VERTICAL	VERT	VERTICAL
EQ	EQUAL	V	VERTICAL	V	VERTICAL
EQUIP	EQUIPMENT	N/O	NOT OUT	N/O	NOT OUT
EXP	EXPANSION	NF	NICE FLANGE	NF	NICE FLANGE
EXT	EXTERIOR	PL	PLATE	PL	PLATE
EXTS, EXIST	EXISTING	PCF	POUNDS PER CUBIC FOOT	PCF	POUNDS PER CUBIC FOOT
FD-#	FLOOR DECK TYPE	PEMB	PRE-ENGINEERED METAL BUILDING	PEMB	PRE-ENGINEERED METAL BUILDING
FDN	FOUNDATION				
FF	FAR FACE				
FIN	FINISH				
FLR	FLOOR				

COLUMN BASE PLATE SCHEDULE					
TYPE	COLUMN	BASE PLATE (LxBxN)	SHAPE	ANCHOR RODS	EMBEDMENT
1	PER PLAN	3/4"x11"x11"	A	(4) 3/4"Ø	15"
2	PER PLAN	3/4"x10"x10"	B	(4) 3/4"Ø	15"
3	PER PLAN	3/4"x12"x12"	A	(4) 3/4"Ø	15"
4	PER PLAN	1 1/2"x12"x22"	A/54.1	(6) 1"Ø	24"
5	PER PLAN	1"x12"x12"	B	(4) 3/4"Ø	15"

## NOTES:


1. SEE PLAN FOR ORIENTATION OF COLUMNS.
2. PROVIDE PLATE WASHER & EMBEDDED PLATE PER SCHEDULE @ ALL ANCHOR BOLTS.
3. UNO. ALL THREADED ROD A.B.'S SHALL BE F1554 (36ksi) MATERIAL.

ANCHOR-ROD CRITERIA				
ANCHOR-ROD DIAMETER	MIN. PLATE WASHER HOLE DIAMETER	MIN. PLATE WASHER SIZE	MIN. PLATE WASHER THICKNESS	EMBEDDED ANCHOR PLATE SIZE
3/4"	1 5/16"	2"	1/4"	1/2"x2 1/2"x2 1/2"
1"	1 13/16"	3"	3/8"	5/8"x3"x3"

## NOTES:


1. HOLE SIZES PROVIDED ARE BASED ON ANCHOR ROD SIZE AND CORRELATE WITH ACI 117 (ACI, 2010)
2. CIRCULAR OR SQUARE WASHERS MEETING THE



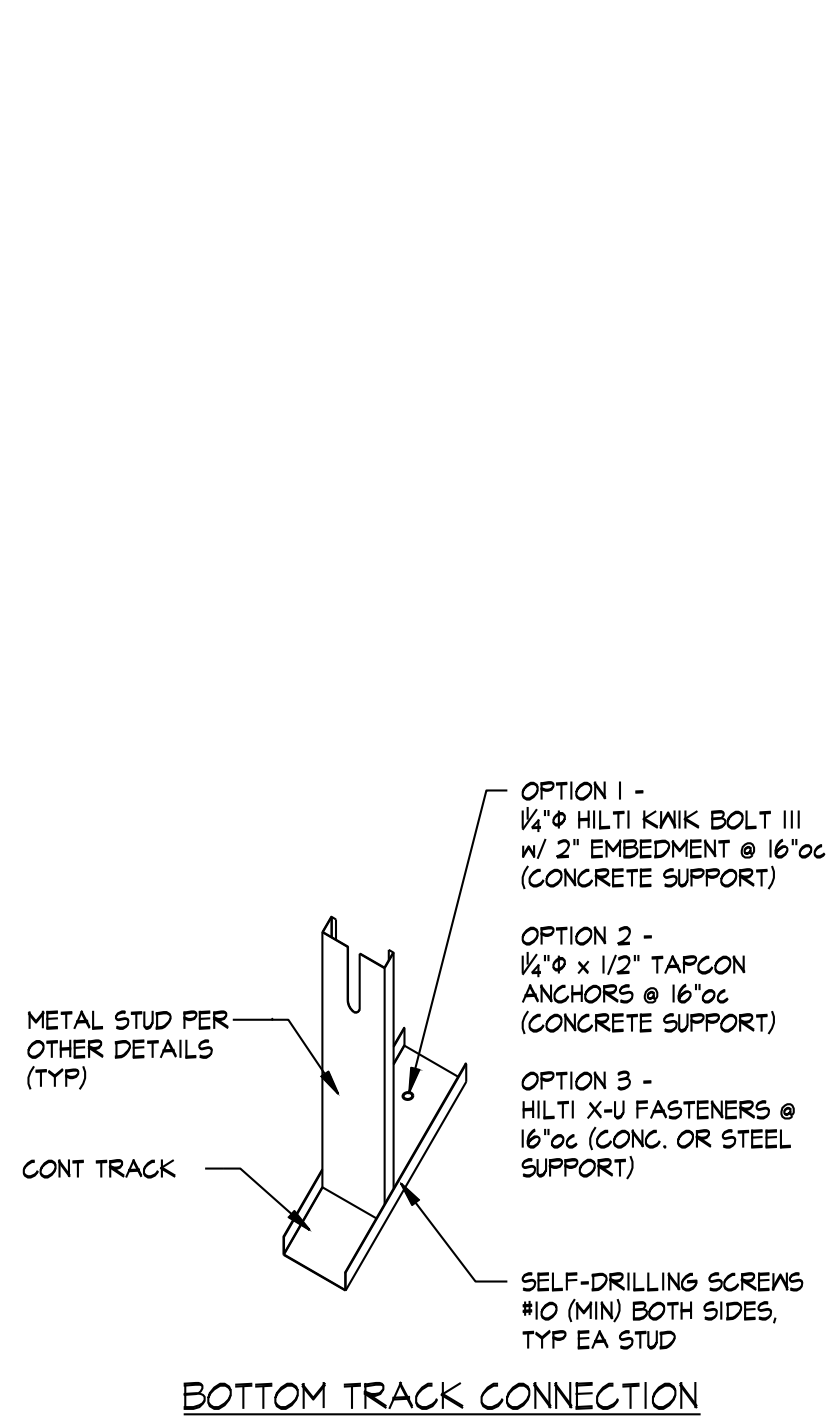


BOTTOM TRACK CONNECTION

SECTION 1  
3/4" = 1'-0" SO.2

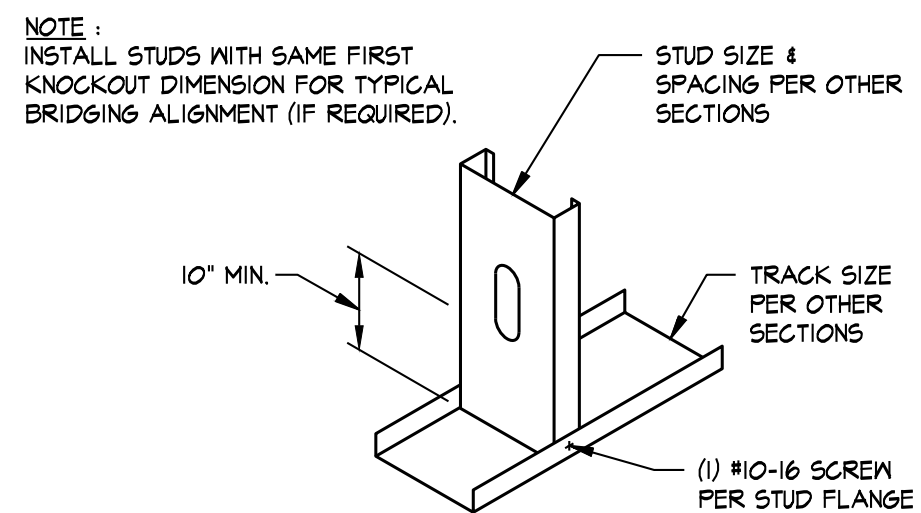


STUD-TO-TRACK CONNECTION

SECTION 6  
3/4" = 1'-0" SO.2

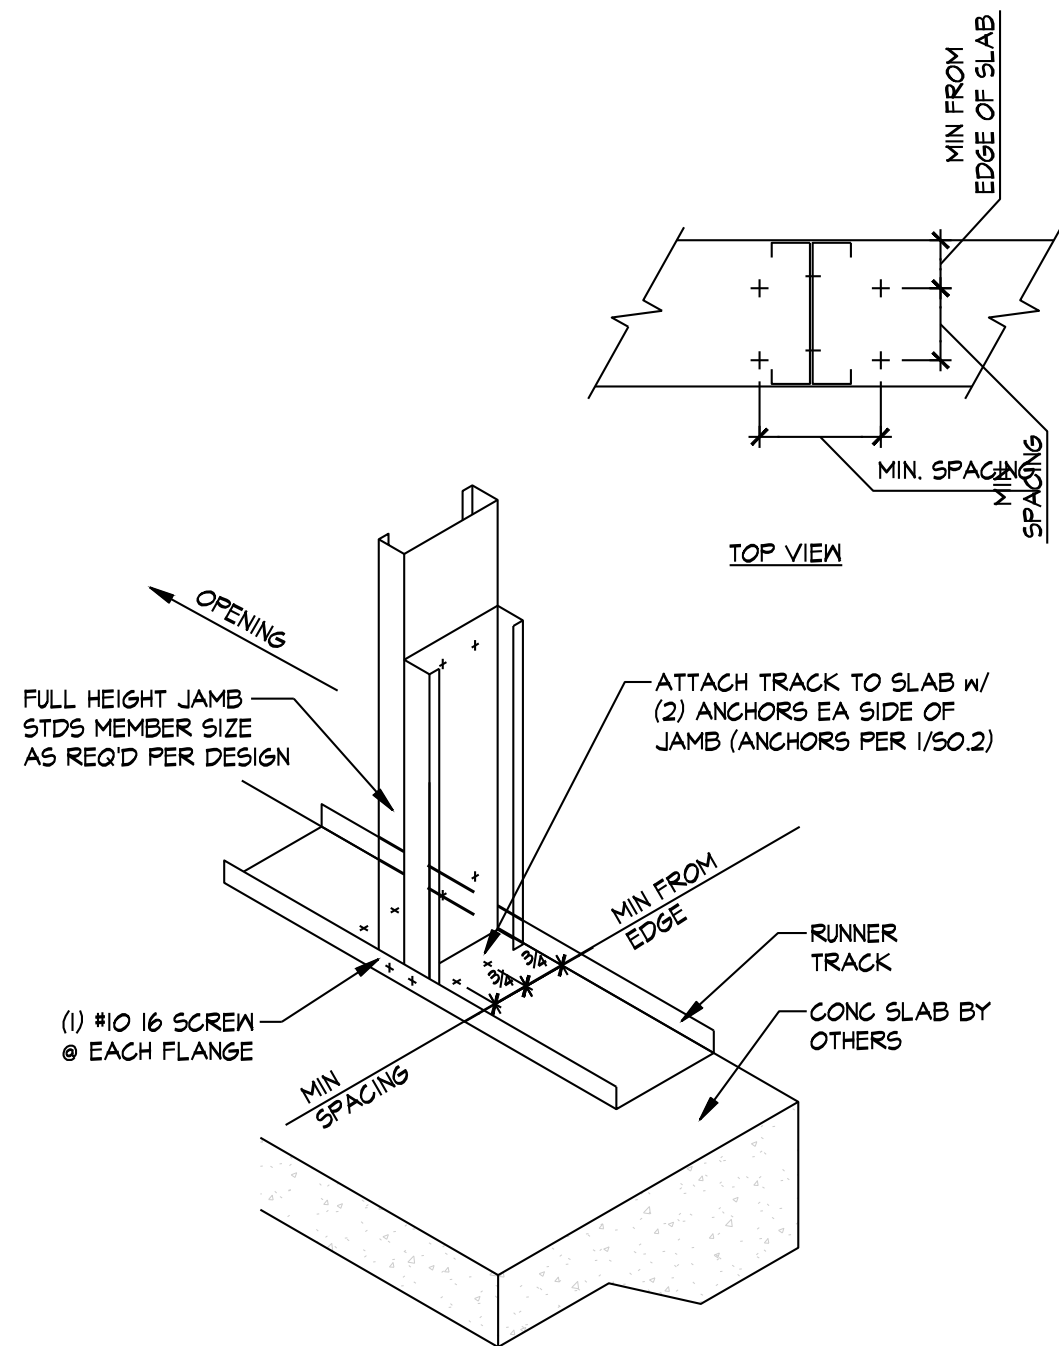


TYPICAL WINDOW JAMB ANCHORAGE

SECTION 2  
3/4" = 1'-0" SO.2

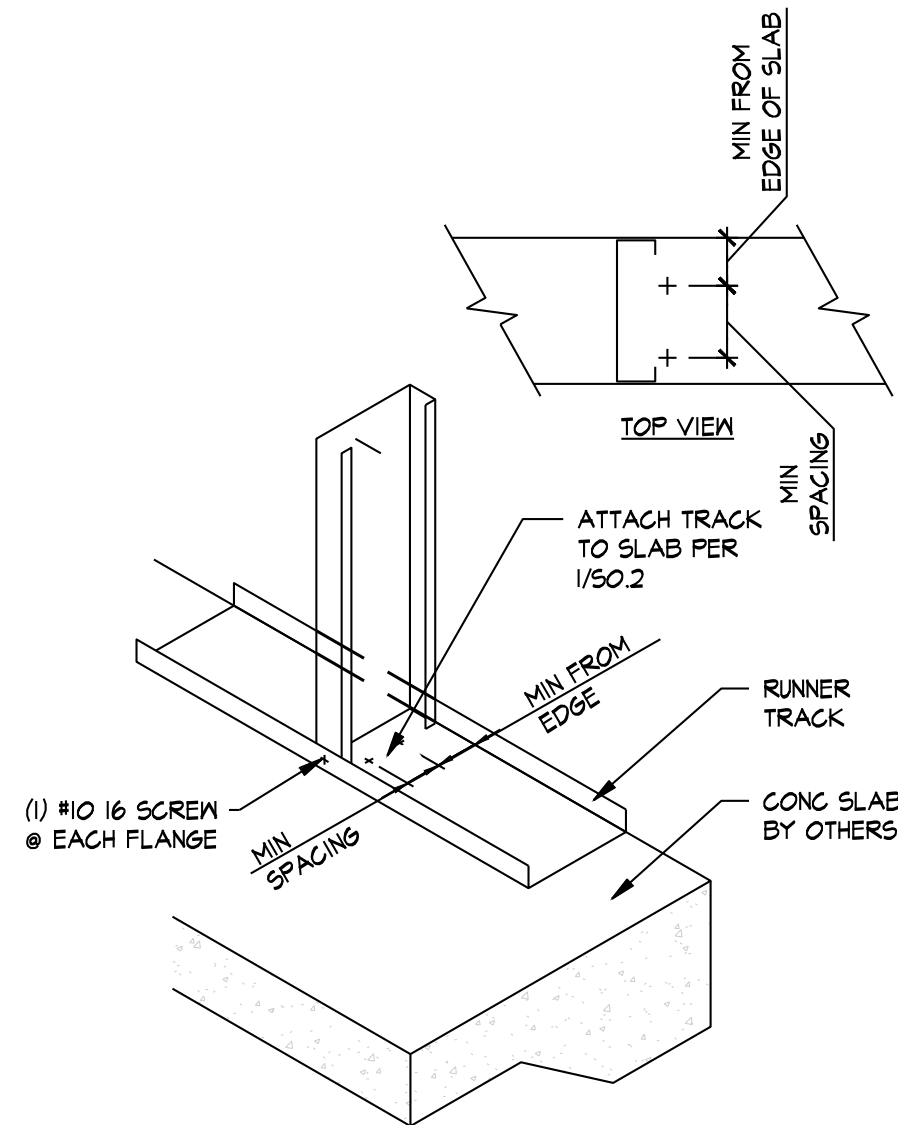


TYPICAL STUD TO TRACK DETAIL

SECTION 3  
3/4" = 1'-0" SO.2

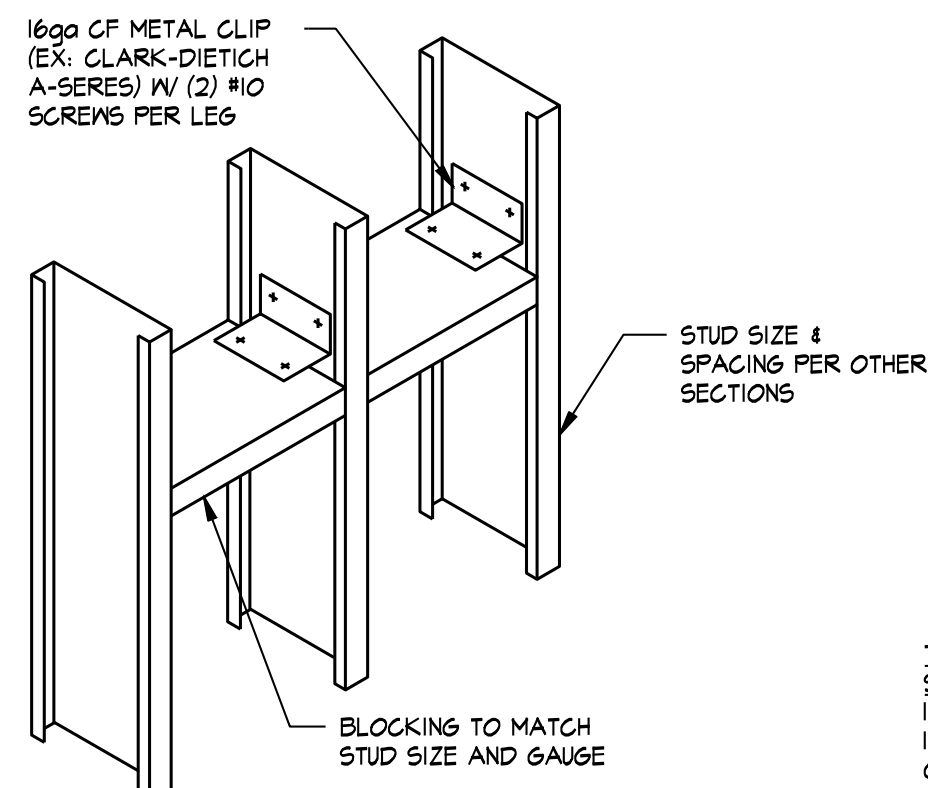


SOLID BLOCKING

SECTION 8  
3/4" = 1'-0" SO.2

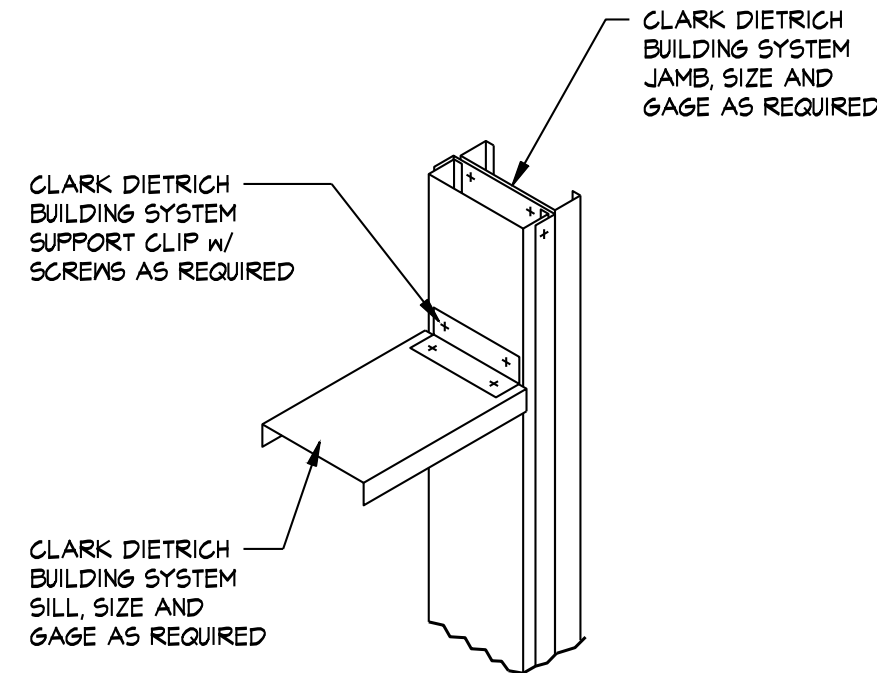

TYPICAL SILL DETAIL


SECTION 4  
3/4" = 1'-0" SO.2

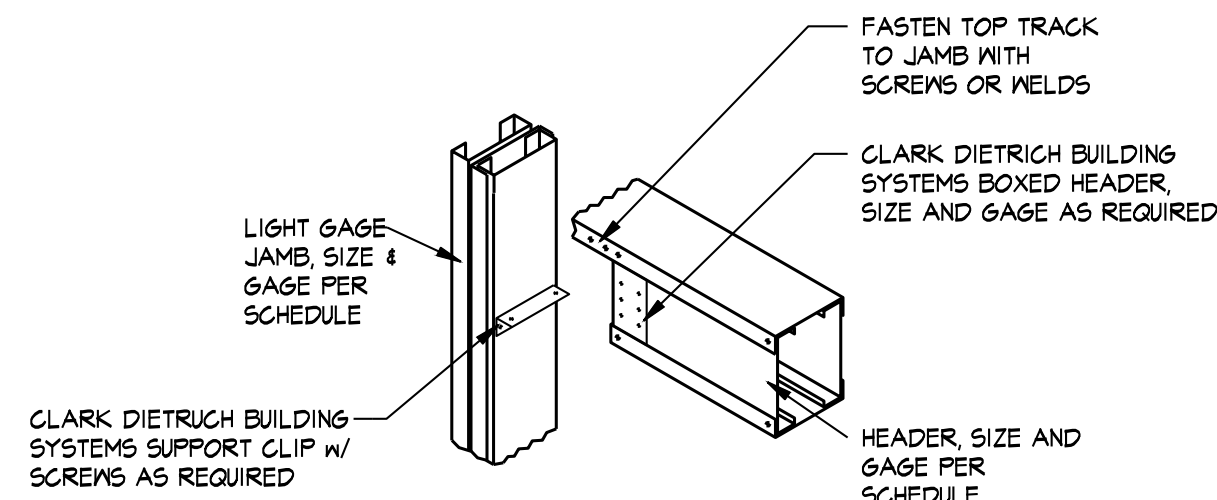

TYPICAL HEADER DETAIL


SECTION 5  
1/2" = 1'-0" SO.2

TABLE I	
STUD THICKNESS	CONNECTOR
33 - 43 MIL	18ga
54 - 91 MIL	14ga

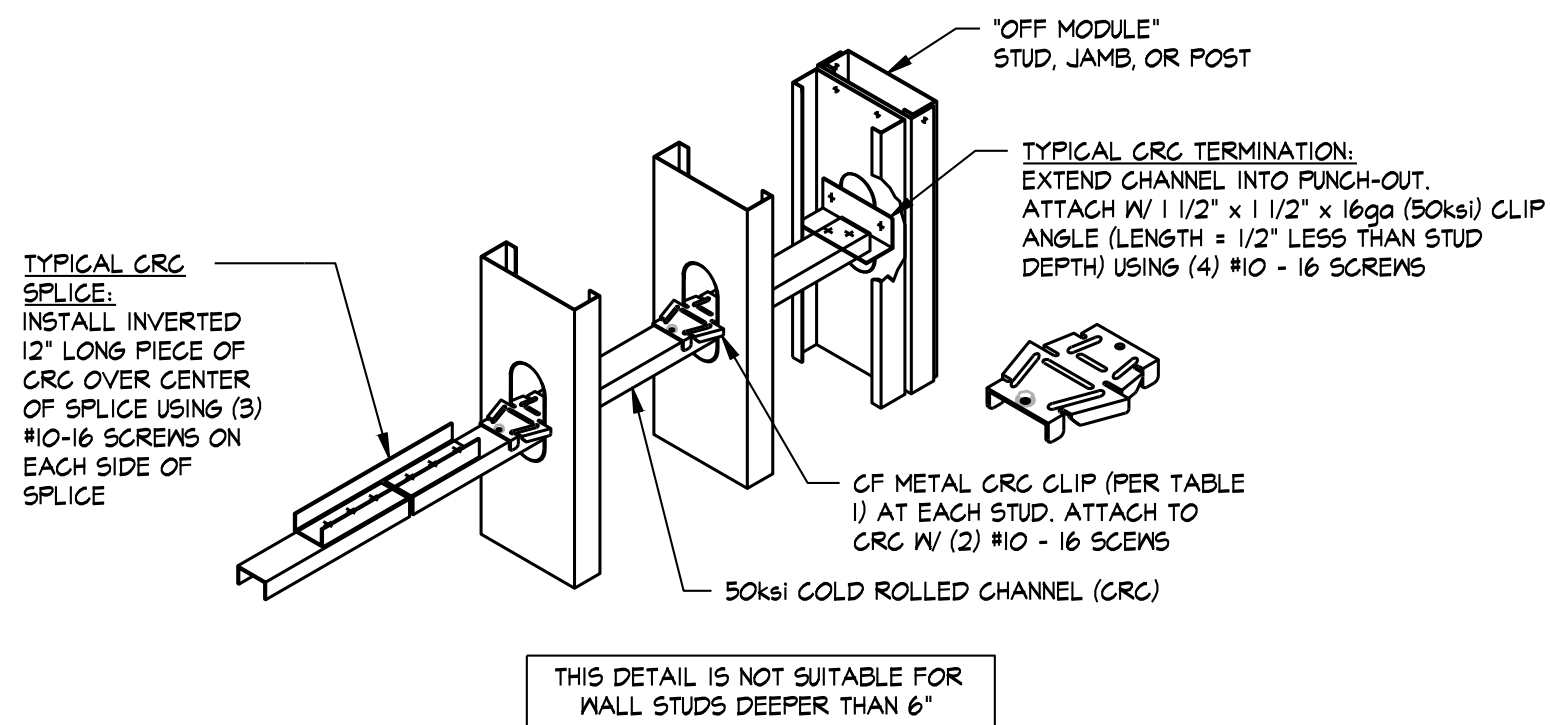

COLD-FORMED OPENING SCHEDULE								
MARK	1 HEADER ³	2 HEADER CONNECTION	3 SILL	4 SILL CONNECTION	5 JAMB STUDS ⁵	6 JAMB STUD BASE CONNECTION	7 JAMB STUD HEAD CONNECTION	8 SILL STUDS BASE CONNECTION
CF1	(2) 800T125-43 & (2) 800S162-43	H546 HEADER HANGER EA SIDE w/ (30) #10-16 SCREWS	800T125-43	UNICLIP-2 #12 SCREWS EACH LEG OF CLIP	(2) 800S162-43 (1) 800T125-54	UNICLIP- 2 #12 SCREWS TO JAMB (2) HILTI XU TO FOUNDATION	FASTCLIP- 2 #12 SCREWS EACH LEG OF CLIPS	PER NOTE 5
CF2	(2) 800T125-54 & (2) 800S162-54	H686 HEADER HANGER EA SIDE w/ (30) 1/4"-14 SCREWS	800T125-54	UNICLIP-2 #12 SCREWS EACH LEG OF CLIP	(2) 800S162-43 (1) 800T125-54	UNICLIP- 2 #12 SCREWS TO JAMB (2) HILTI XU TO FOUNDATION	FASTCLIP- 2 #12 SCREWS EACH LEG OF CLIPS	PER NOTE 5
CF3	(2) 800T125-54 & (2) 800S162-54	H686 HEADER HANGER EA SIDE w/ (30) 1/4"-14 SCREWS	800T125-54	UNICLIP-2 #12 SCREWS EACH LEG OF CLIP	(4) 800S162-54 (2) 800T125-54	UNICLIP- 2 #12 SCREWS TO JAMB (2) HILTI XU TO FOUNDATION	FASTCLIP- 2 #12 SCREWS EACH LEG OF CLIPS	PER NOTE 5

- NOTES:
- ALL MEMBERS SHALL BE FULLY CONTINUOUS (DO NOT CUT NOR SPLICE) AND BE 660 COATED.
  - ALL MEMBERS GREATER THAN 18ga SHALL BE 50ksi.
  - CONNECT HEADER TRACKS TO EACH HEADER JOIST w/ #12 SCREW @24" OC MAX ALONG EACH TRACK FLANGE AND WEB.
  - FASTEN SHEATHING TO STUDS, TOP & BOTTOM TRACKS (BUT NOT DEFLECTION TRACKS) AT 12" OC IN FIELD OF PANEL & 6" OC AT EDGES UNO.
  - FASTEN TRACKS THROUGH EACH FLANGE TO EACH STUD w/ #10 SCREWS UNO.





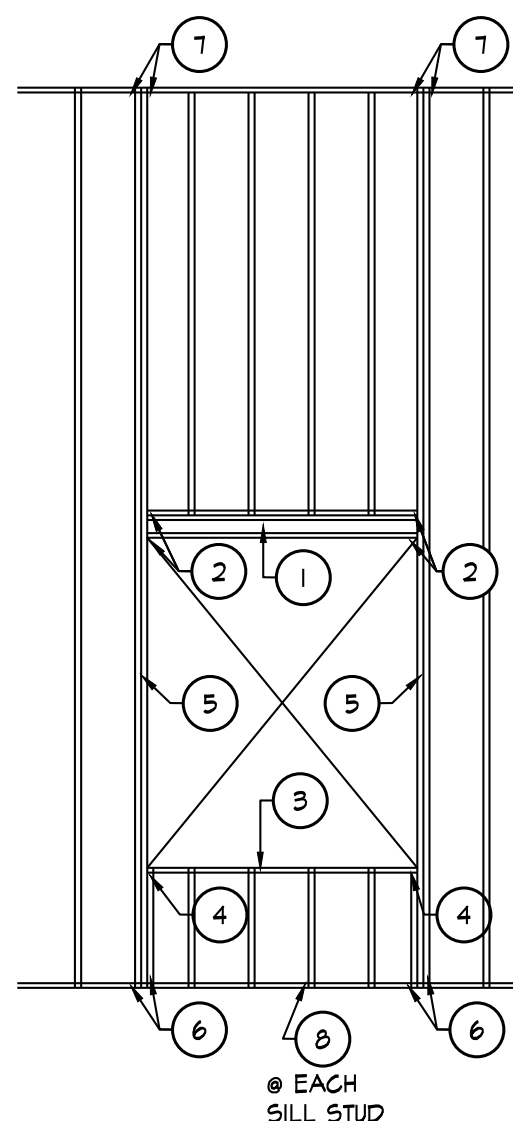


TYPICAL LOOSE LINTEL DETAIL @ COLD-FORMED FRAMED WALL

SECTION 11  
3/4" = 1'-0" SO.2



















LOOSE LINTEL SCHEDULE	
FOR OPENINGS:	GALV. ANGLE
LESS THAN 6'-0"	5"x3 1/2"x3/8" (LLV)
6'-0" < OPENINGS < 9'-0"	6"x3 1/2"x3/8" (LLV)



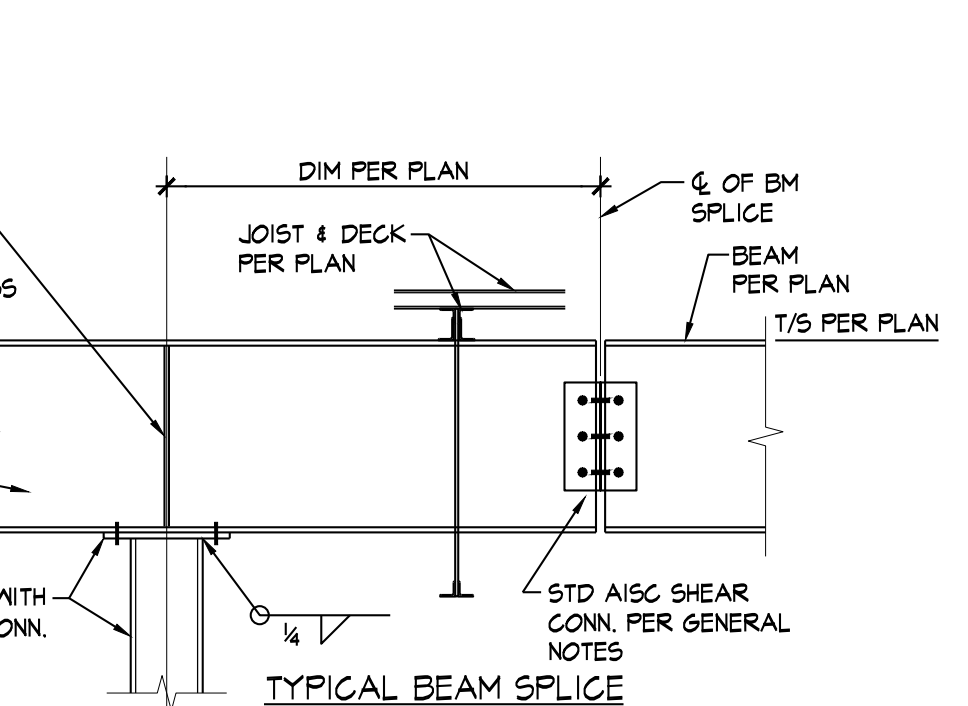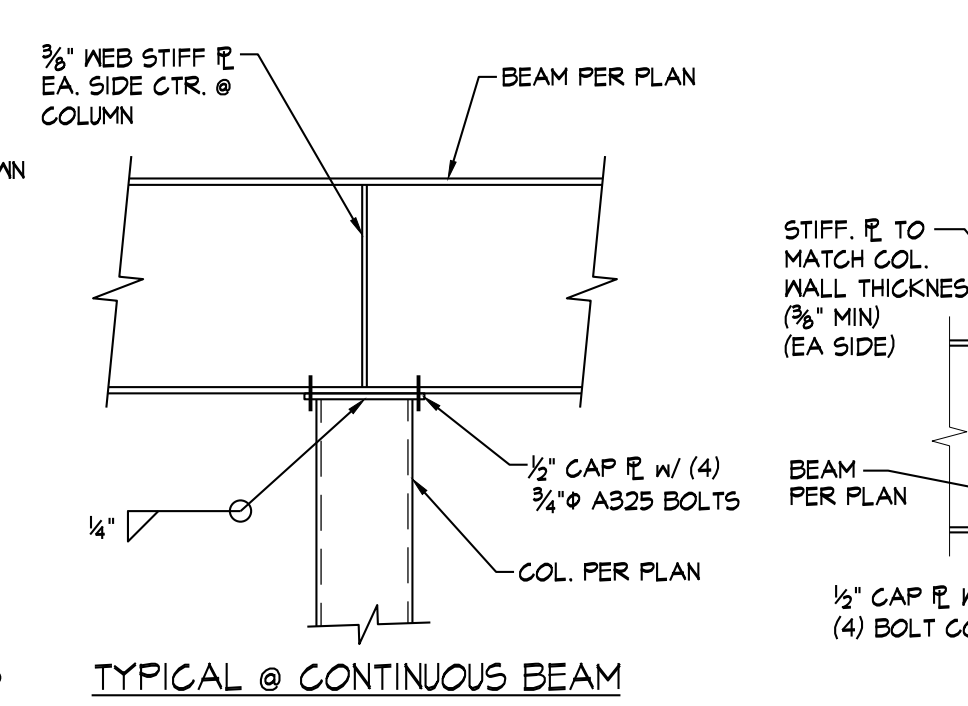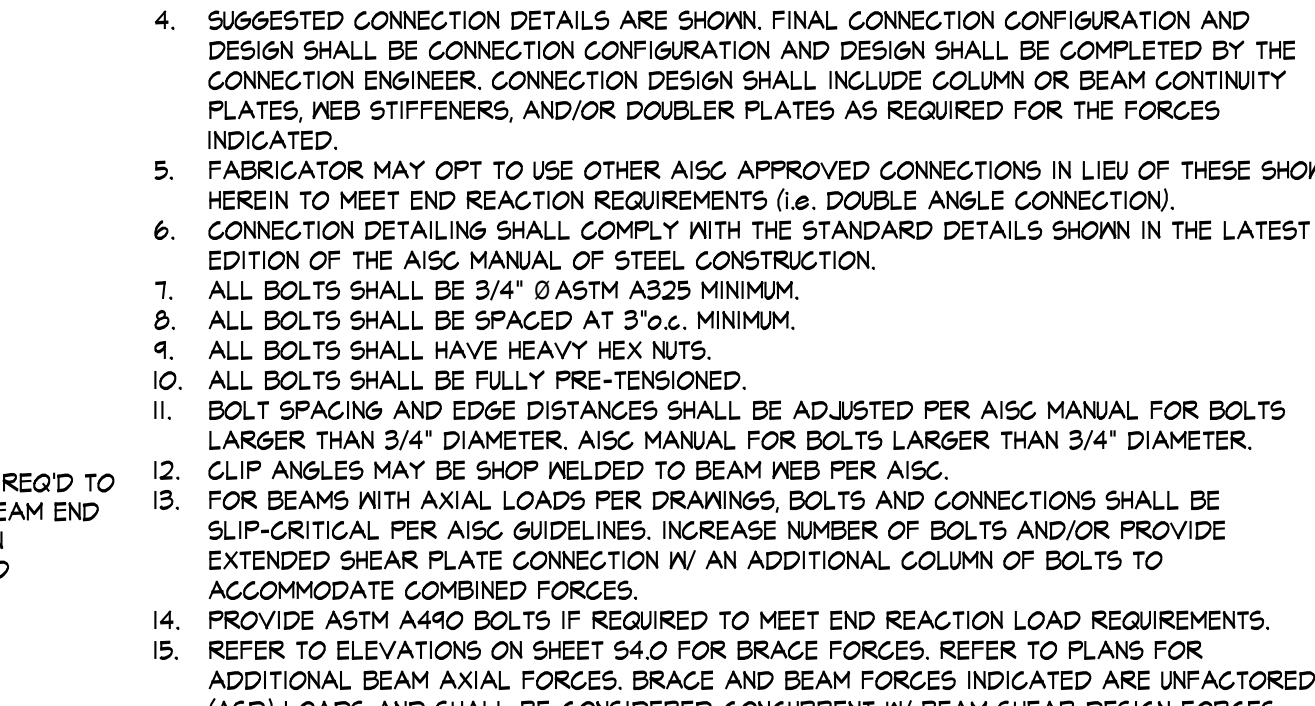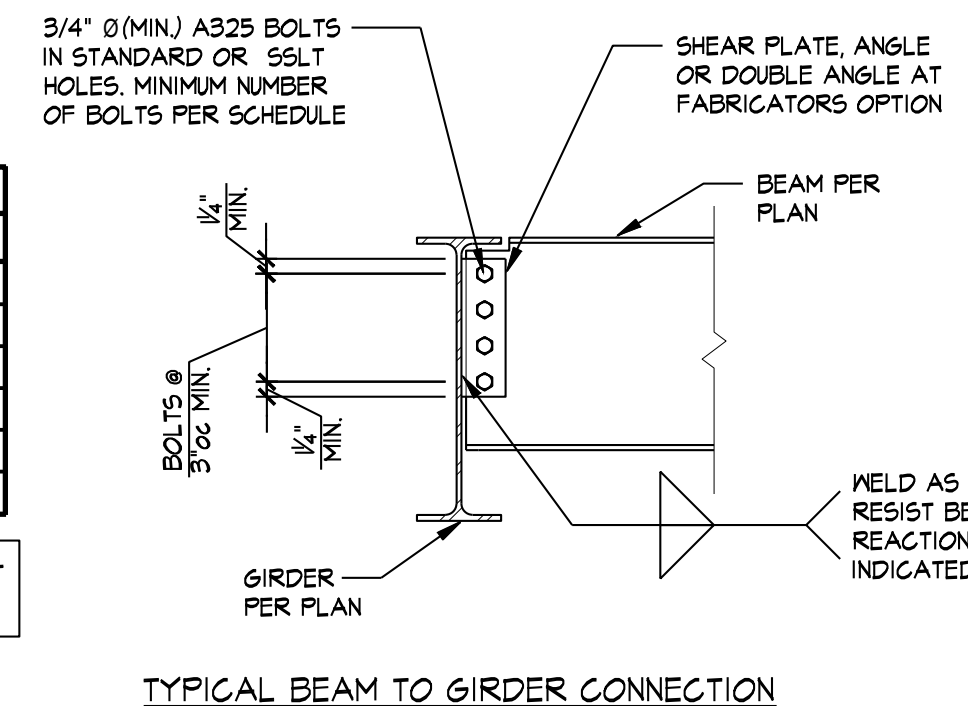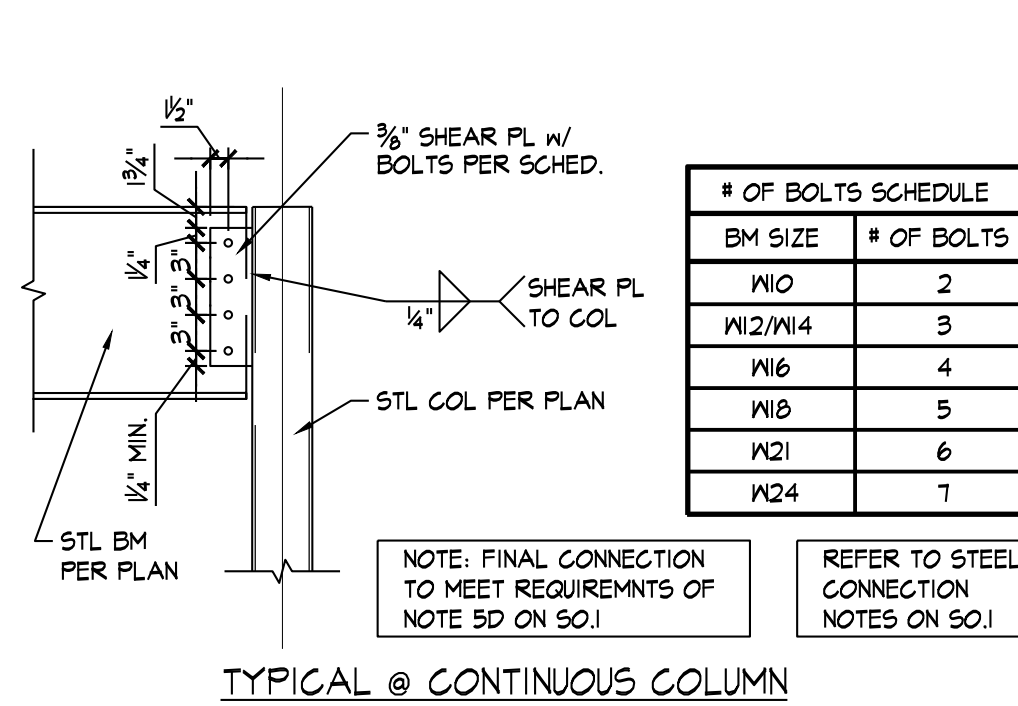

MINIMUM CONNECTION SCHEDULE		
BEAM SIZE	MINIMUM "N" QUANTITY 3/4" BOLTS IN WEB	MINIMUM LENGTH, "L" (IN)
W8C8	2	6
W10C10	3	9
W12C12	3	9
W14C15	3	9
W16	4	12
W18	5	15
W21	6	18
W24	6	18

SCHEDULE NOTES:  
1. ALL BOLTS SHALL BE 3/4" Ø ASTM A325.  
2. ALL BOLTS SHALL HAVE HEAVY HEX NUTS.  
3. ALL BOLTS SHALL BE FULLY PRE-TENSIONED.

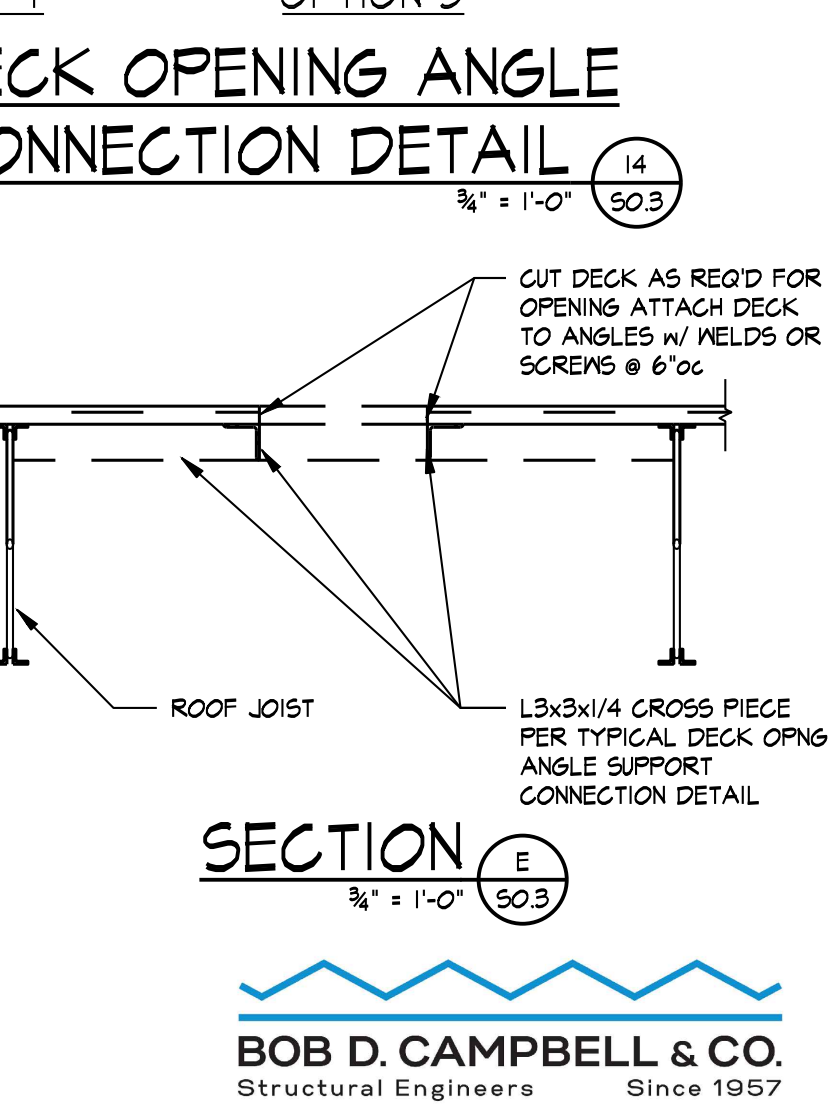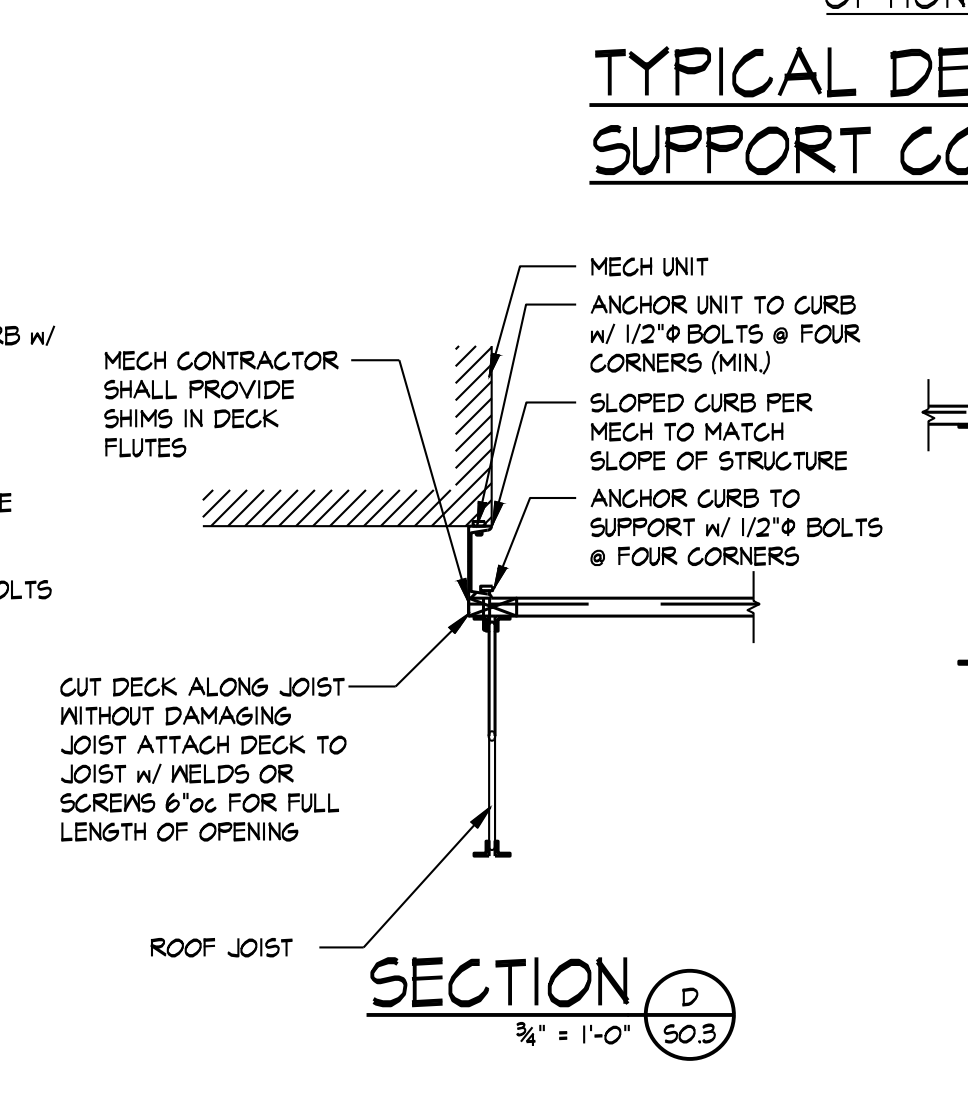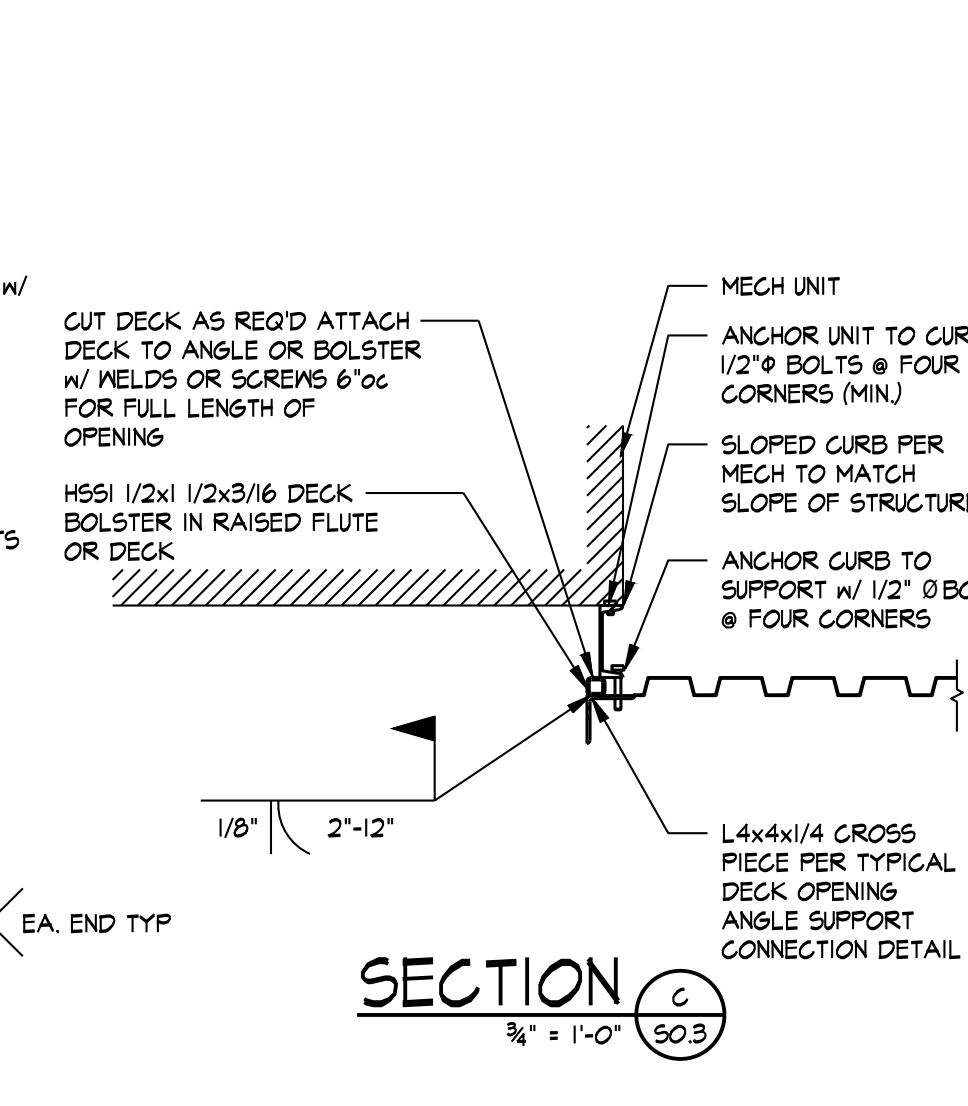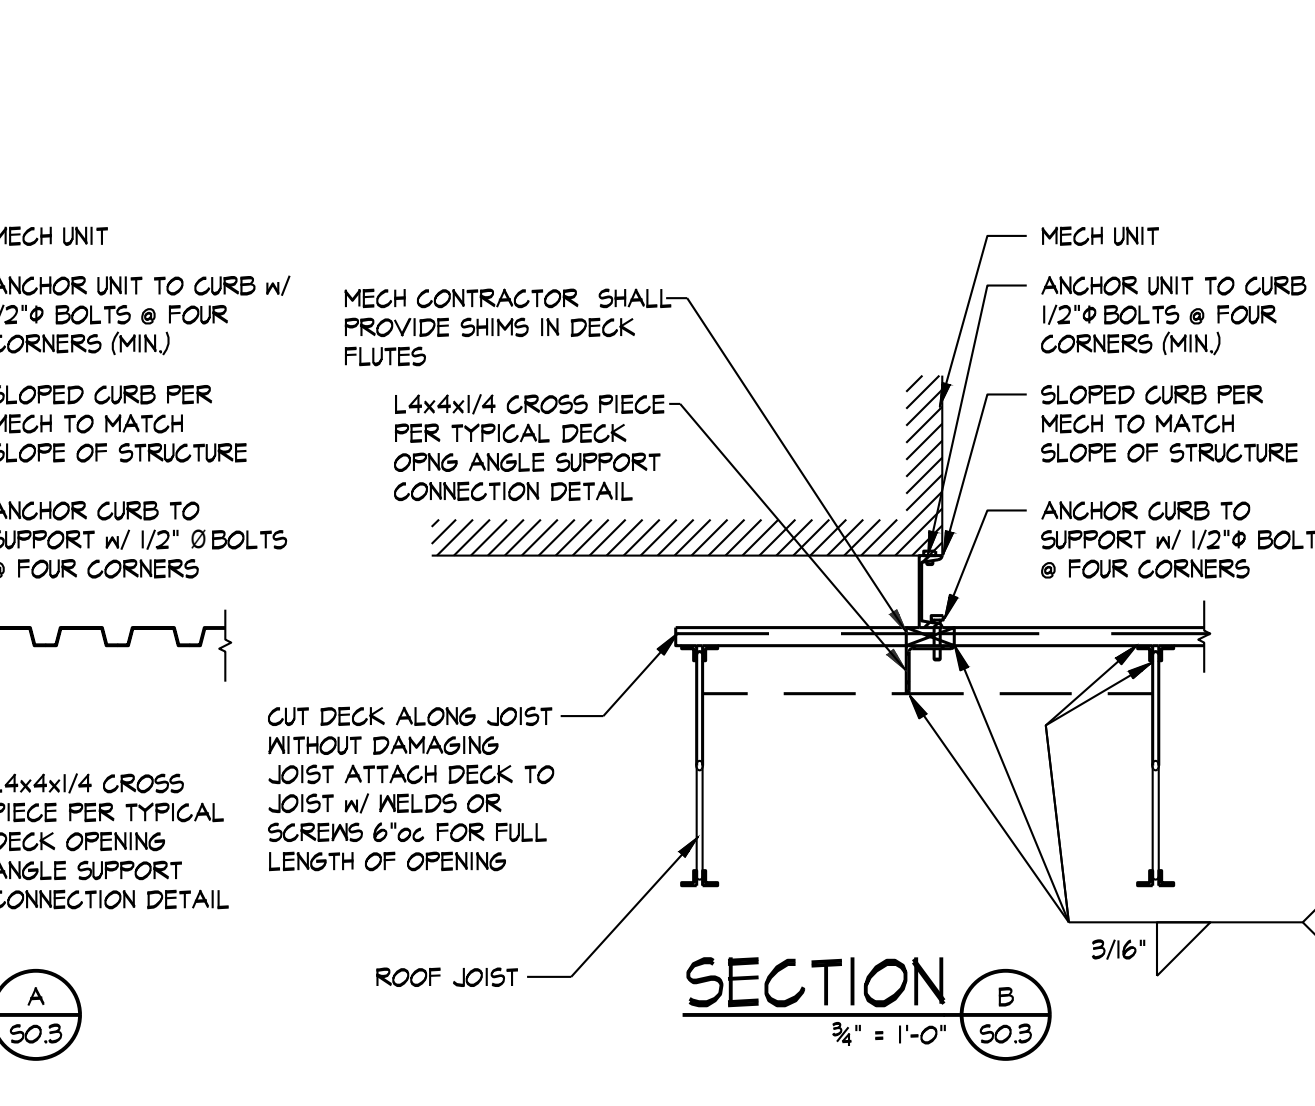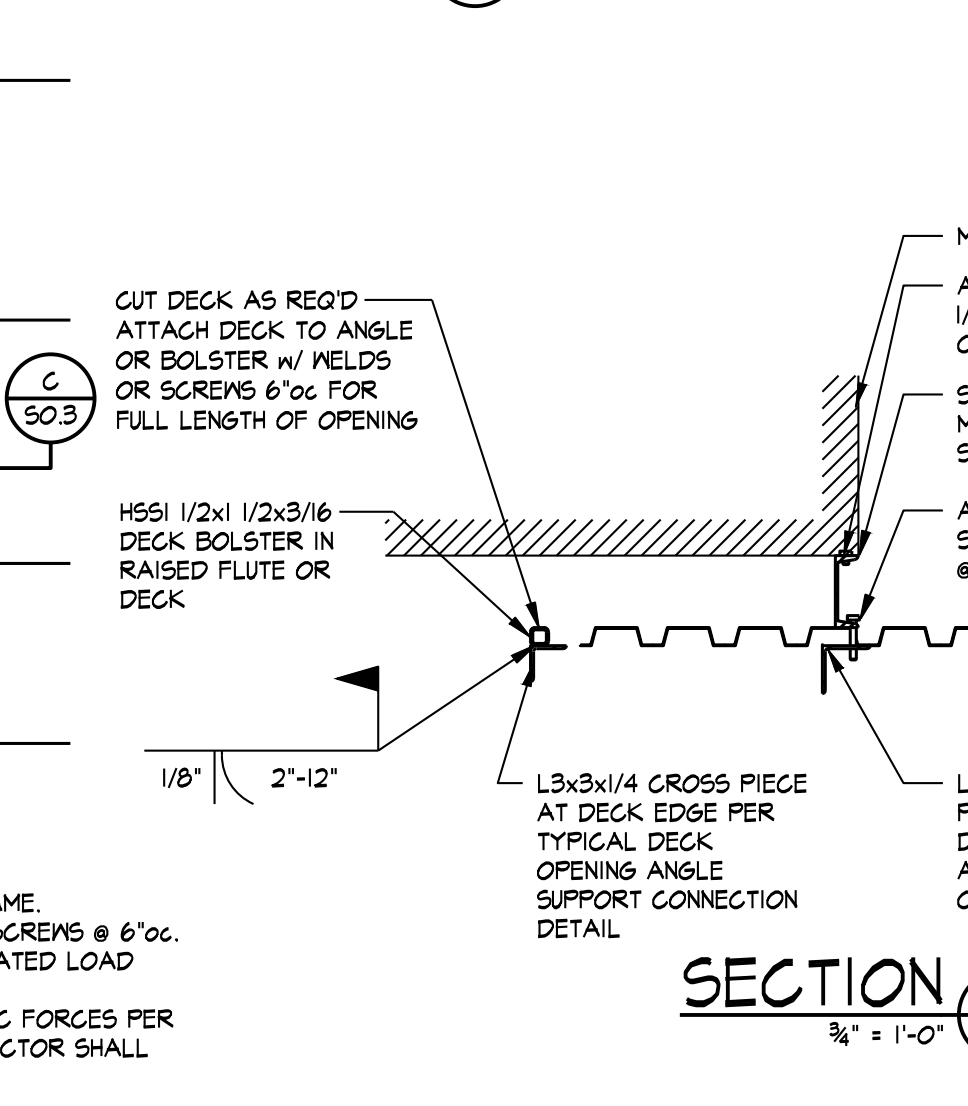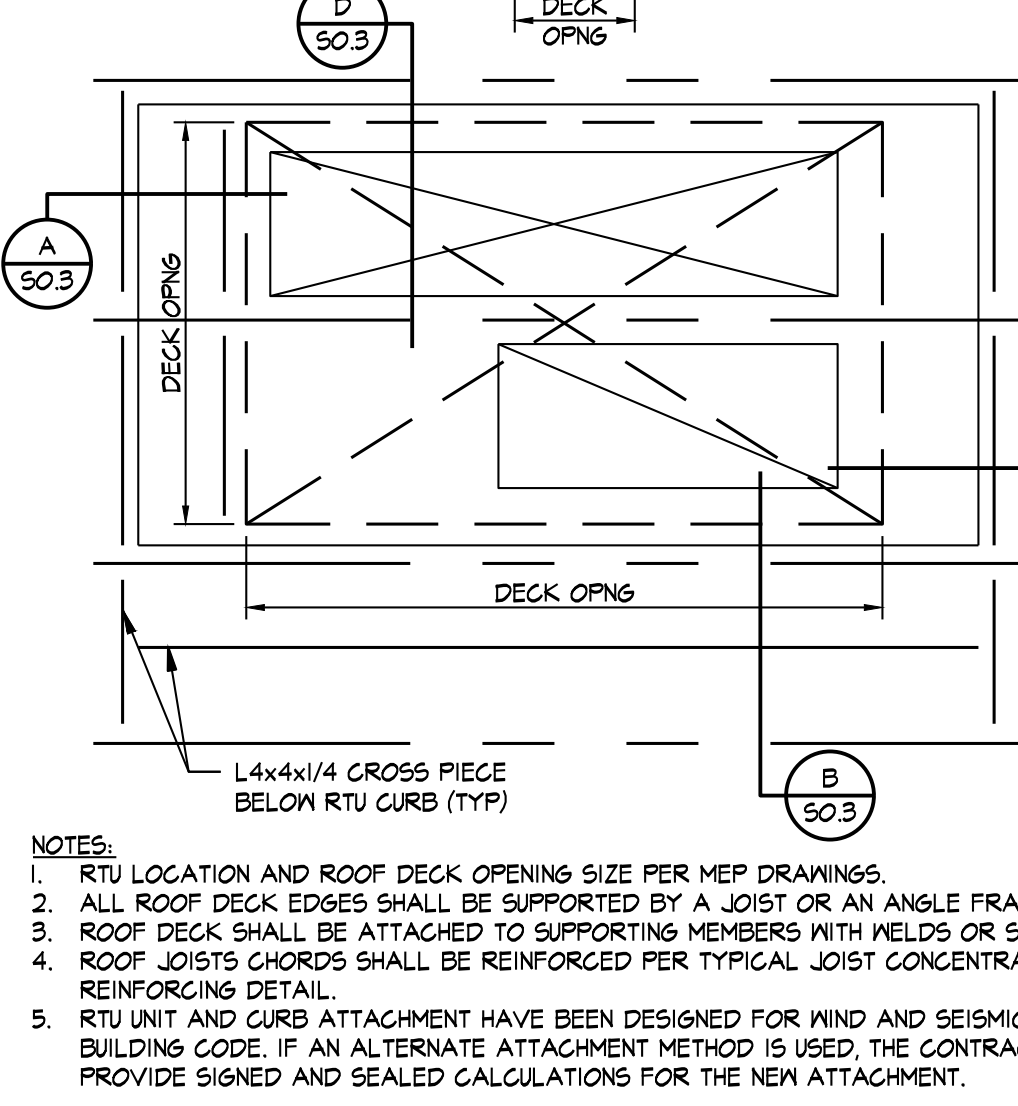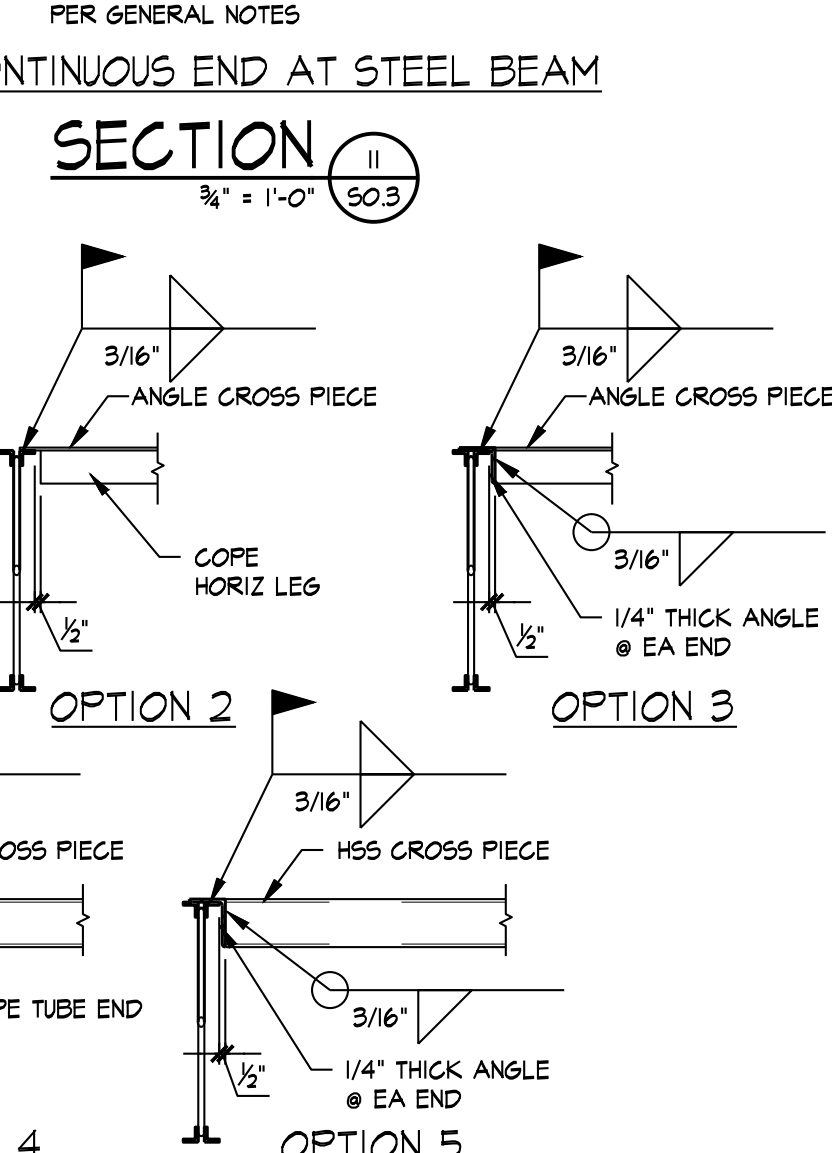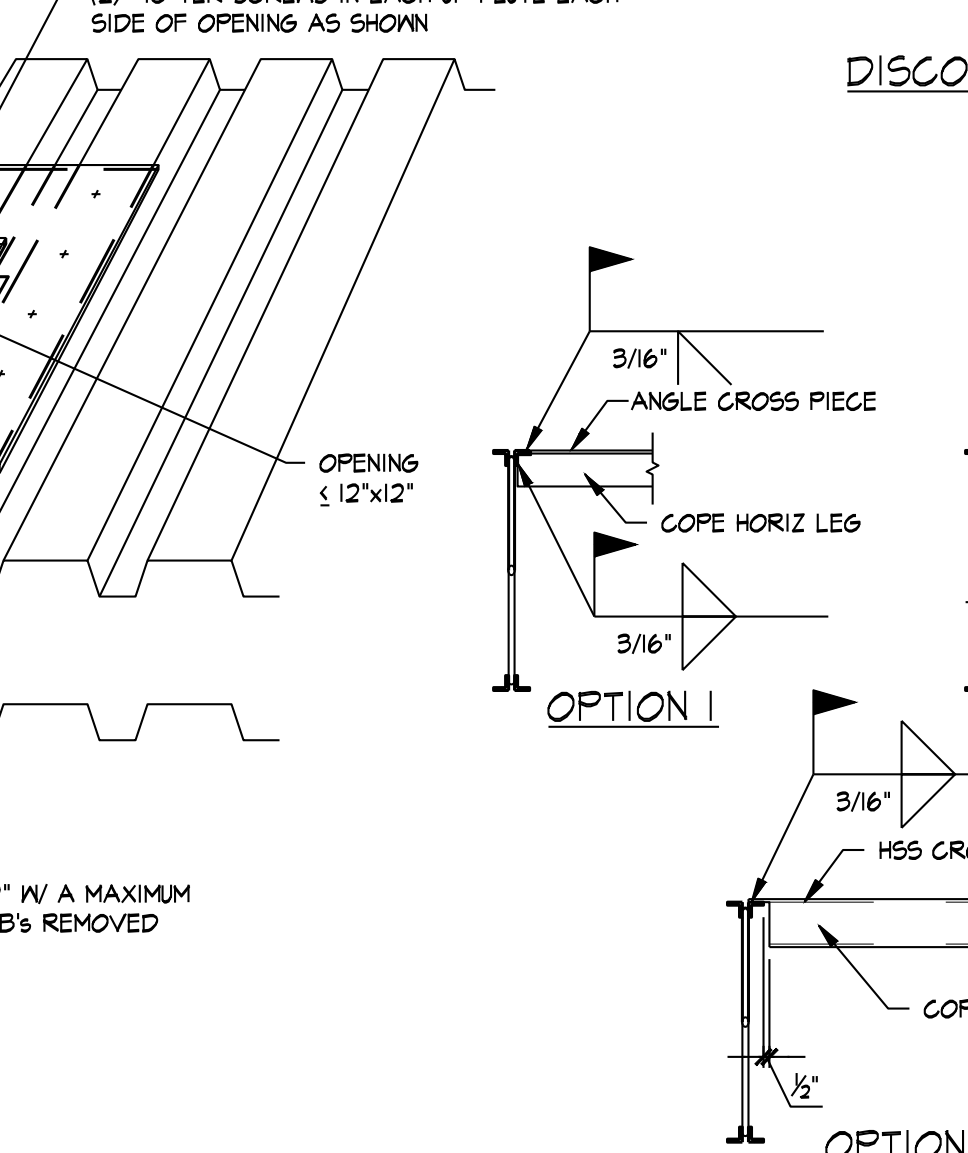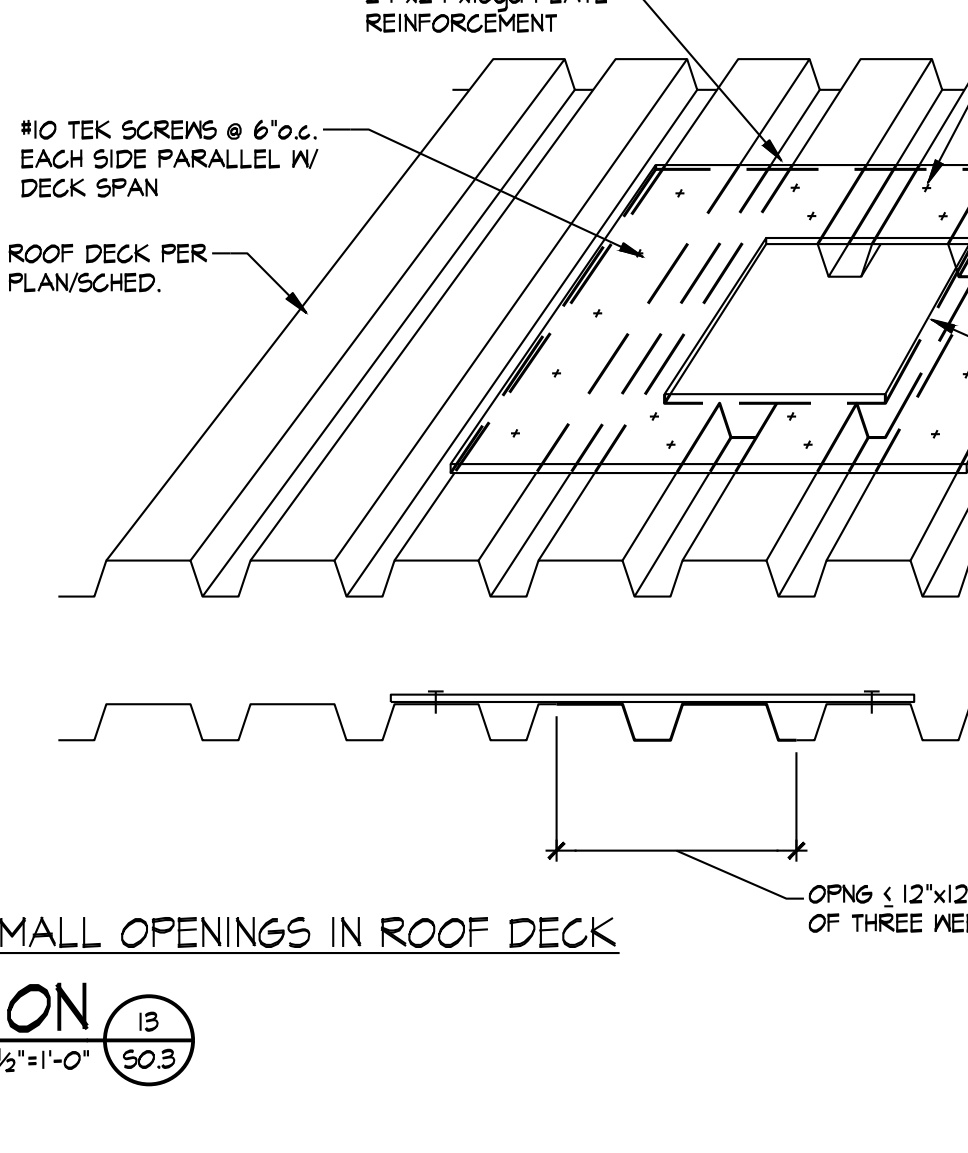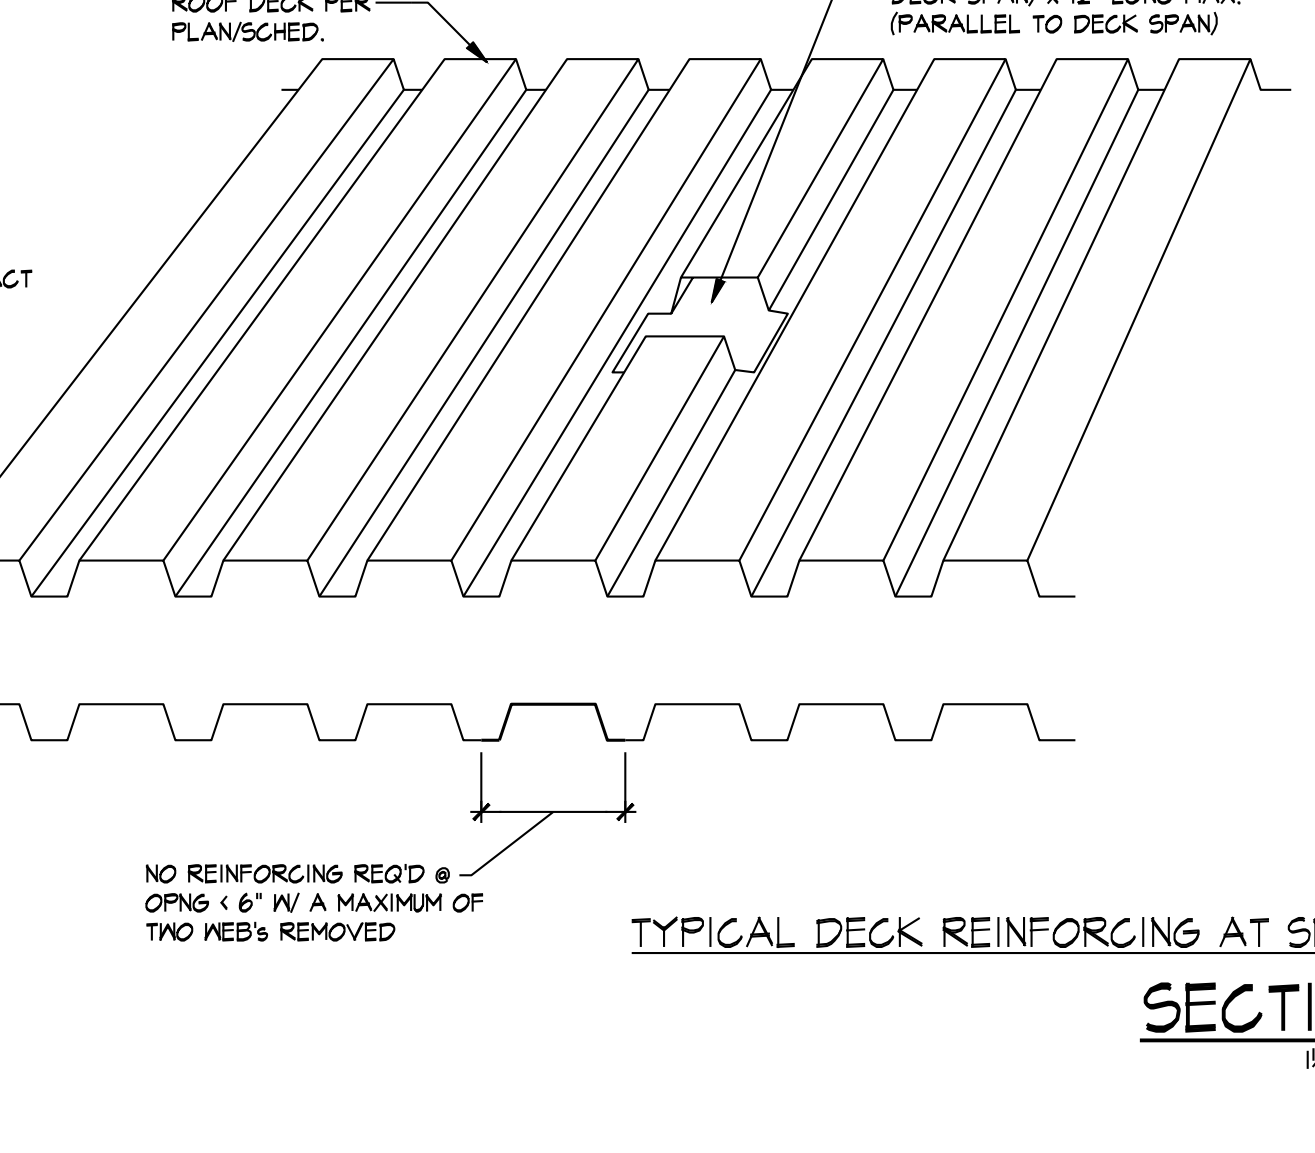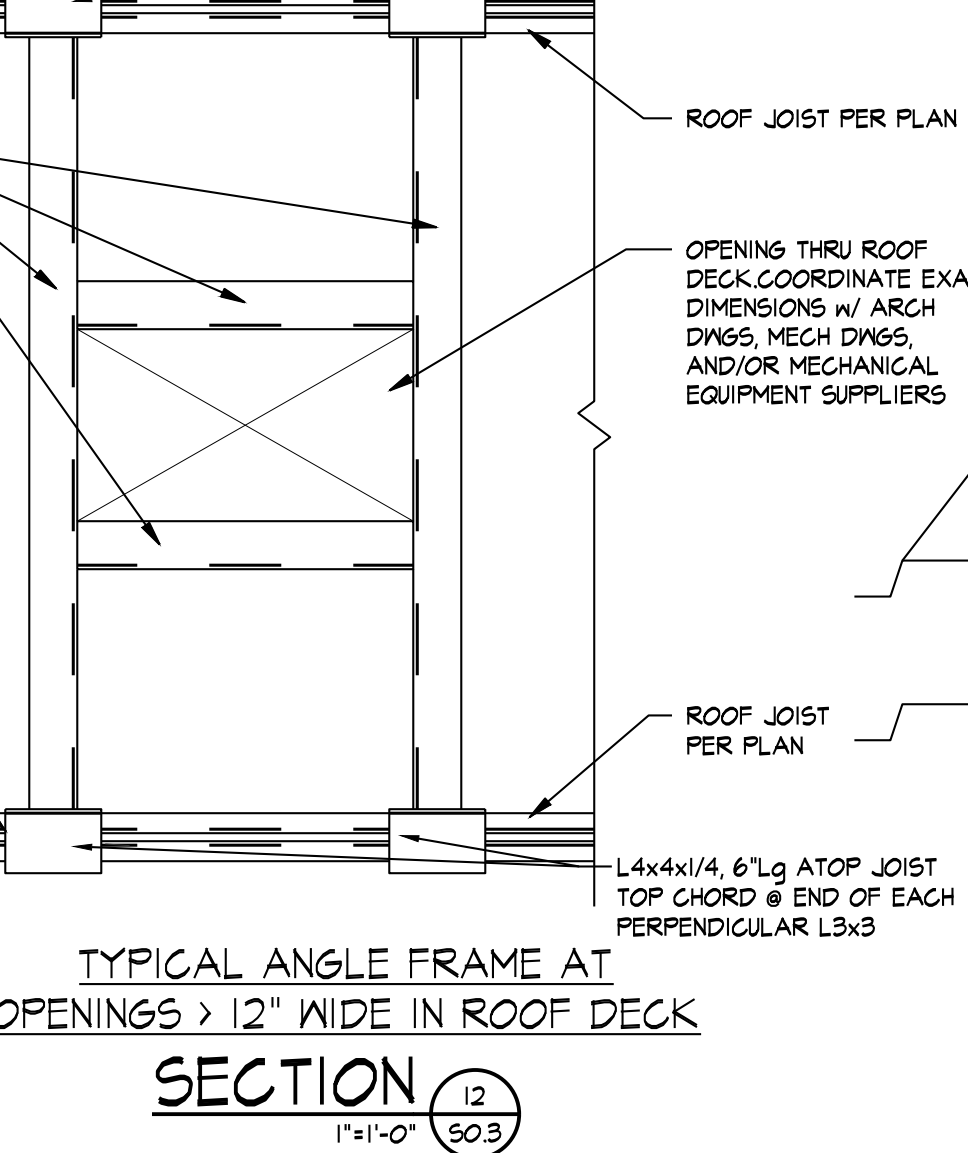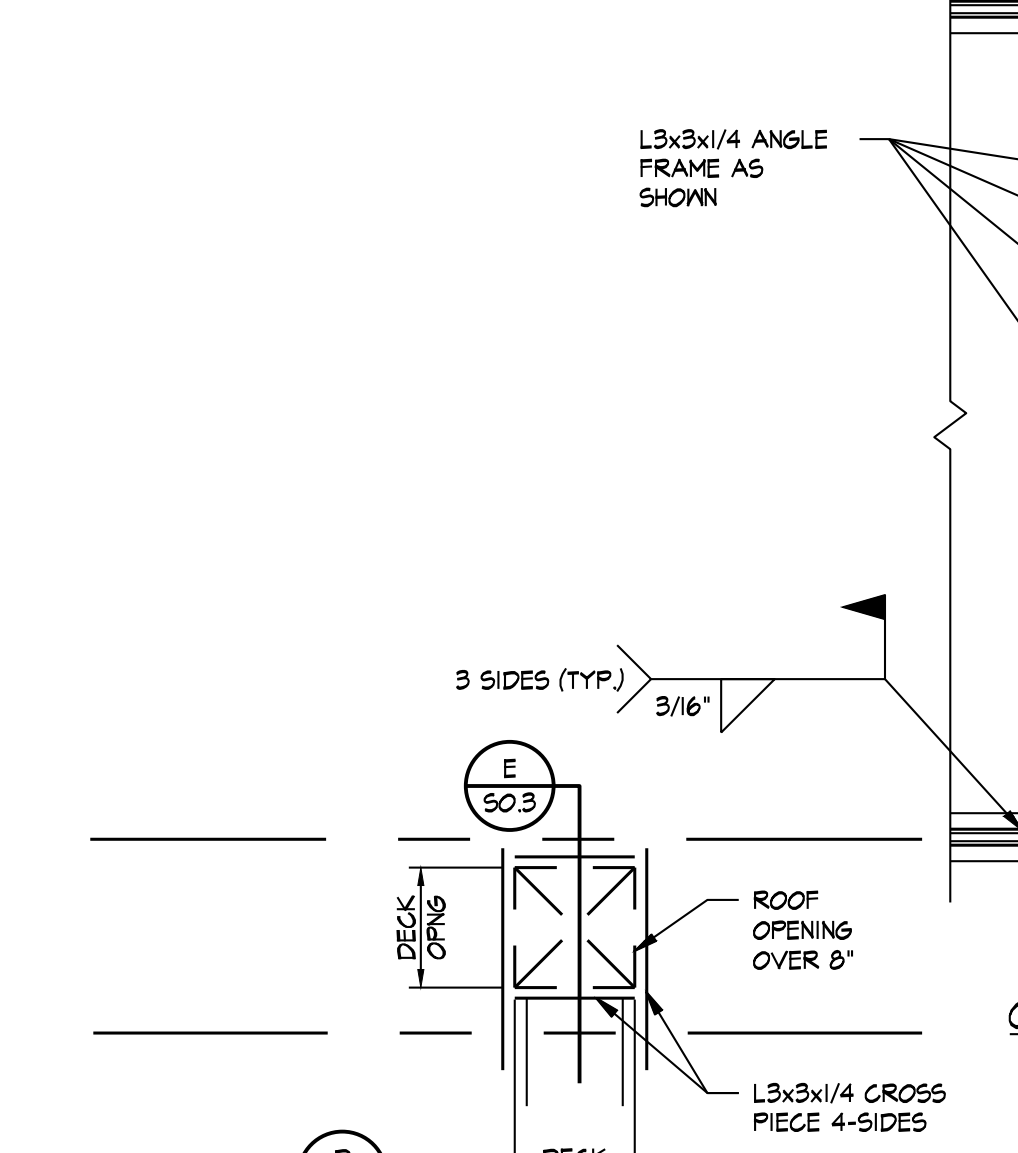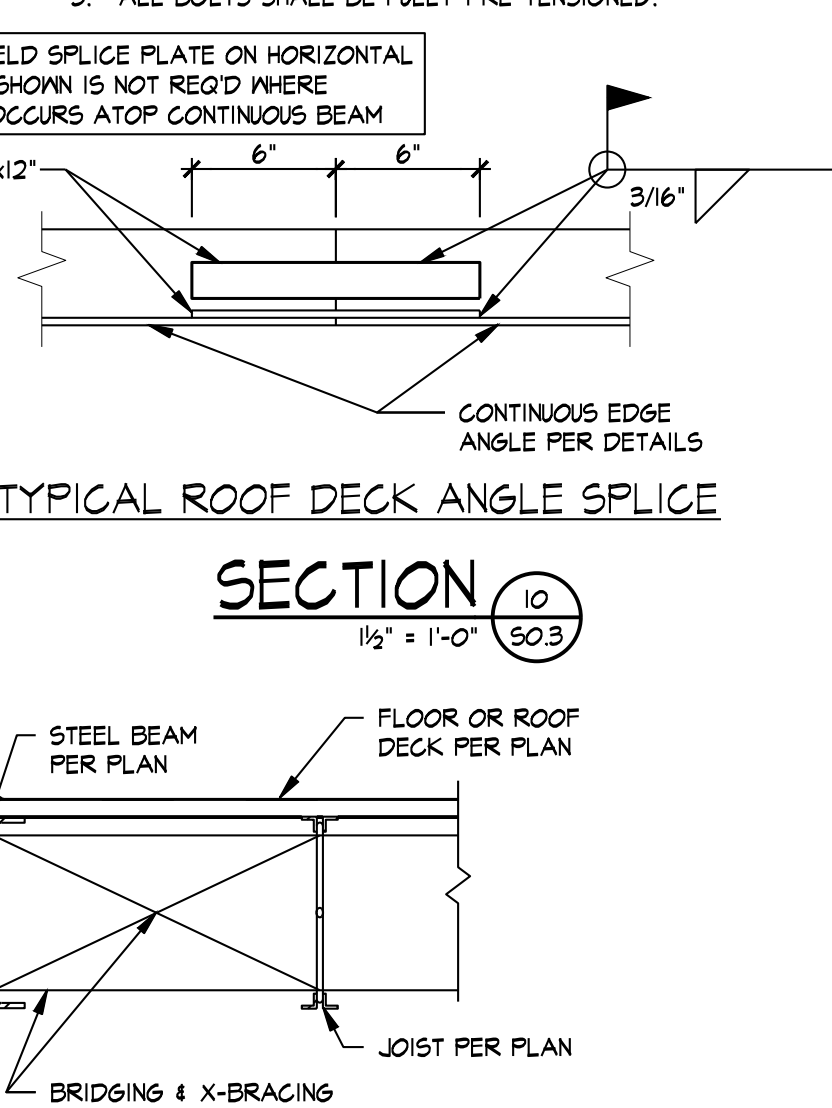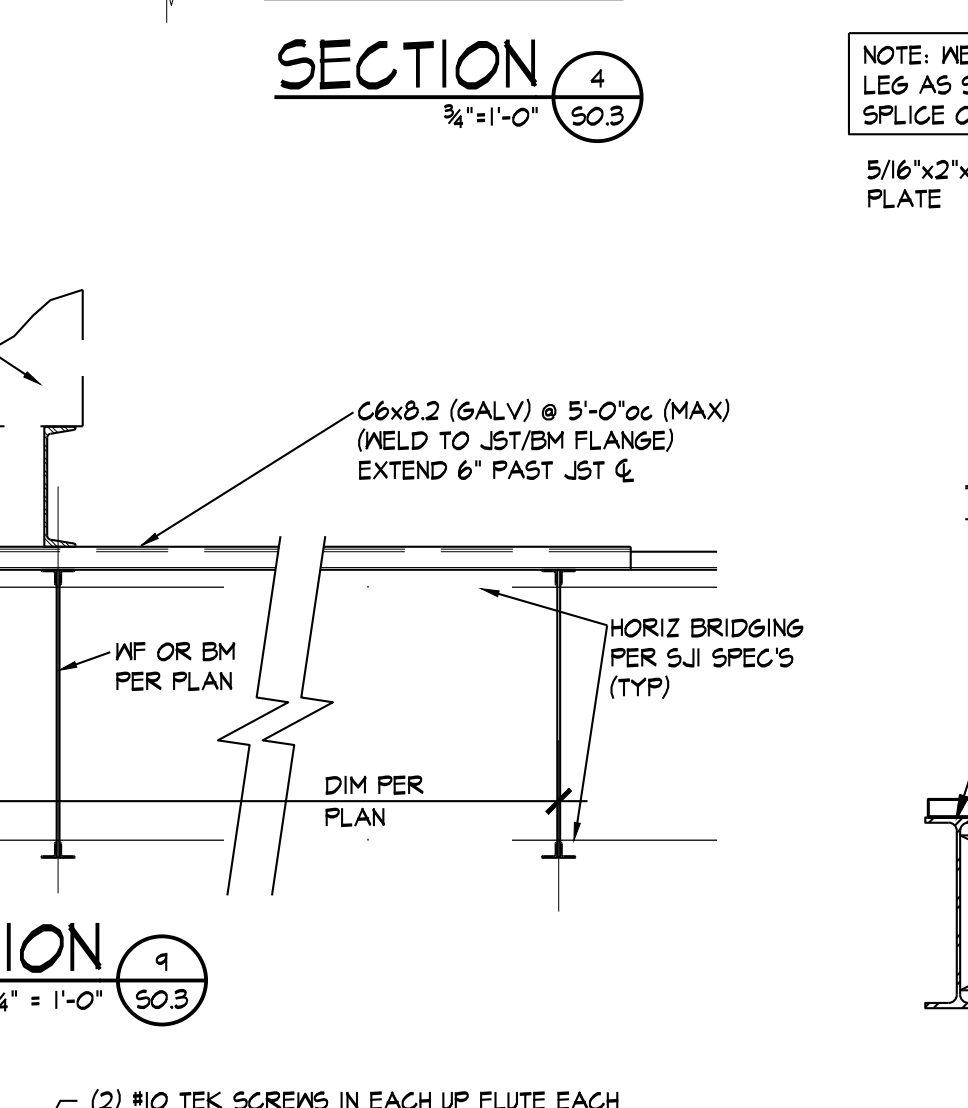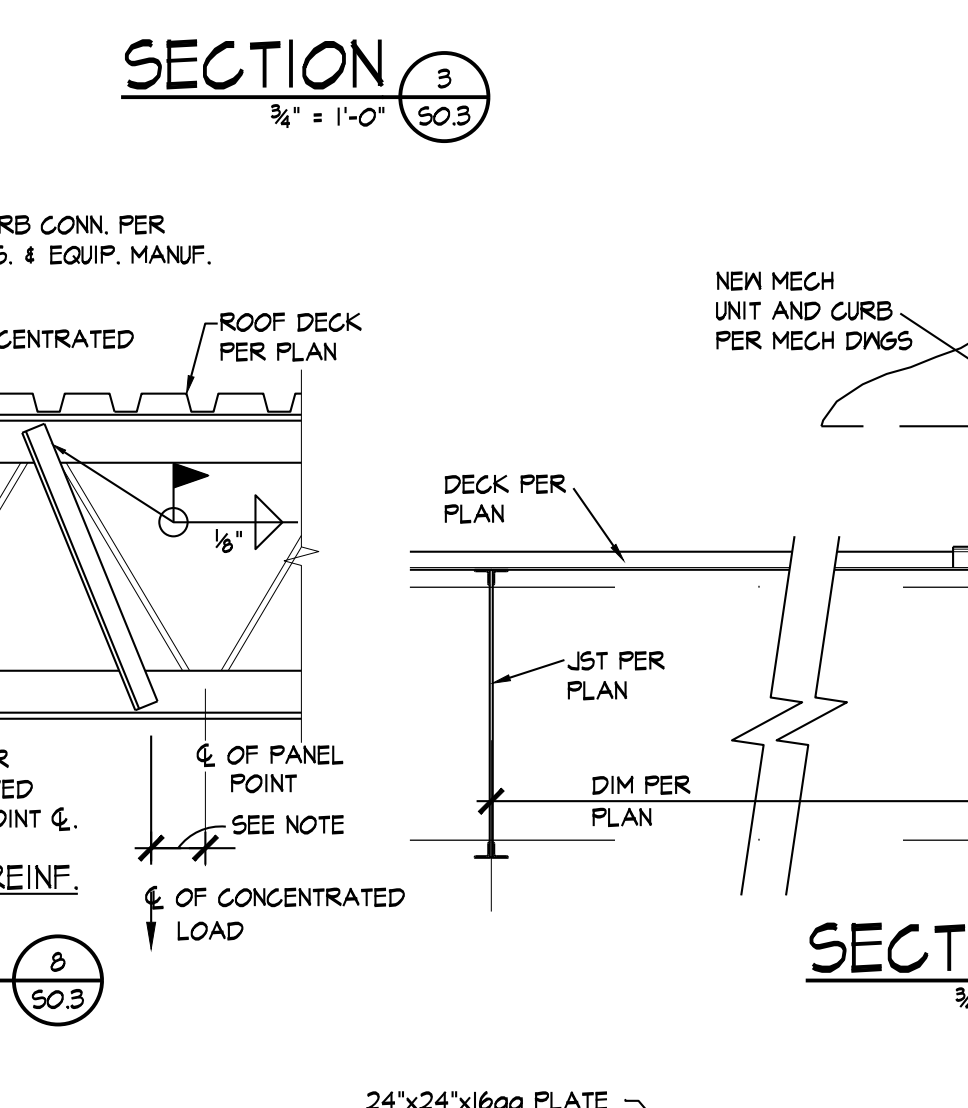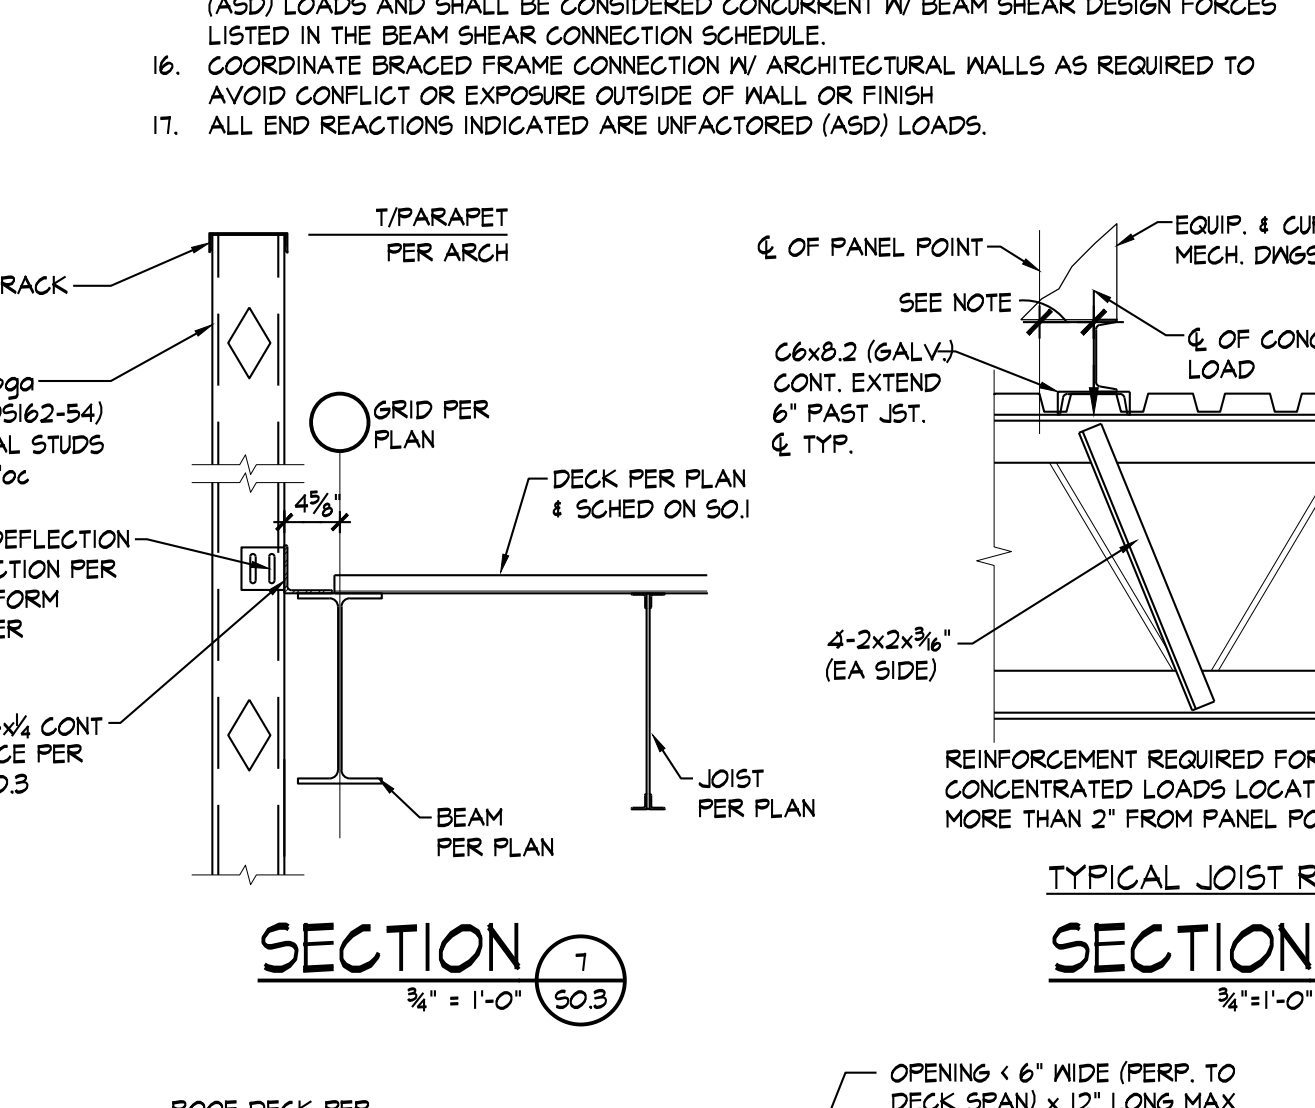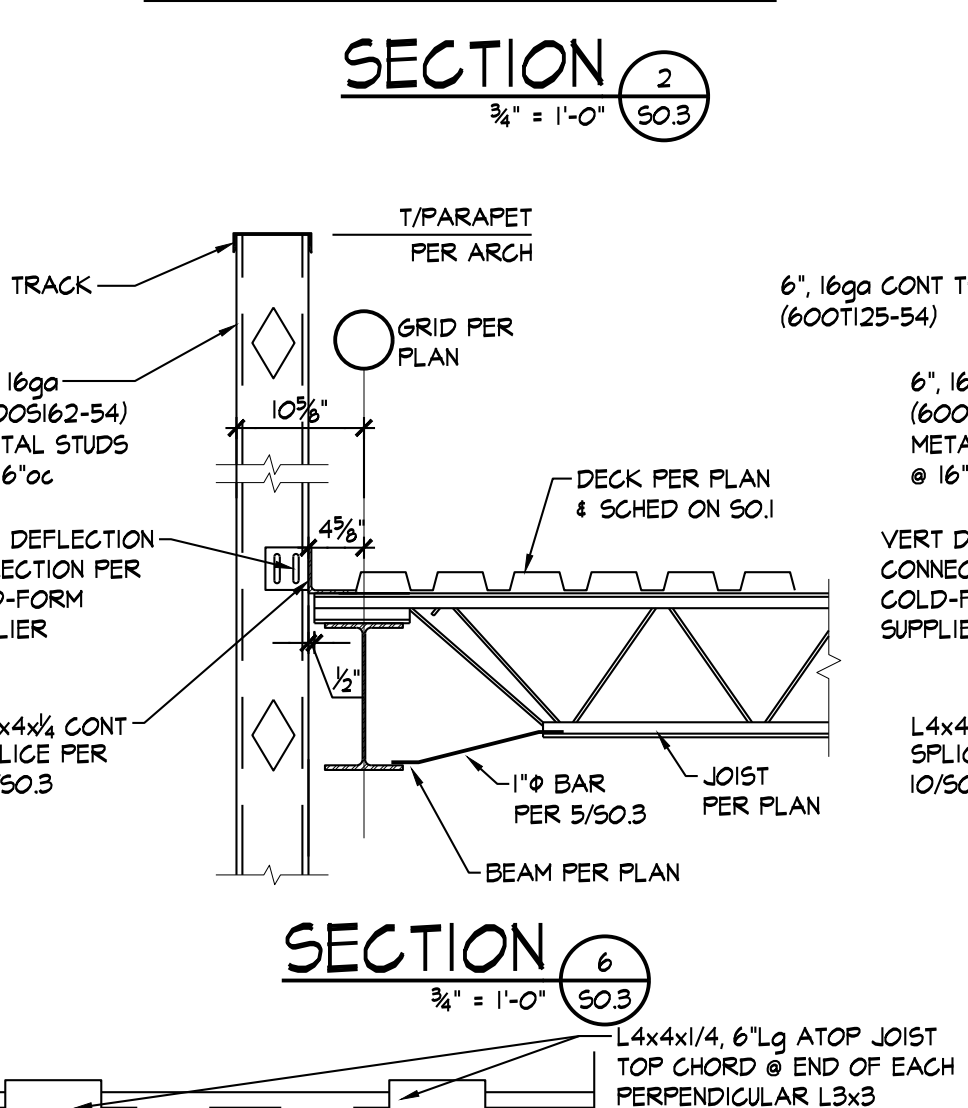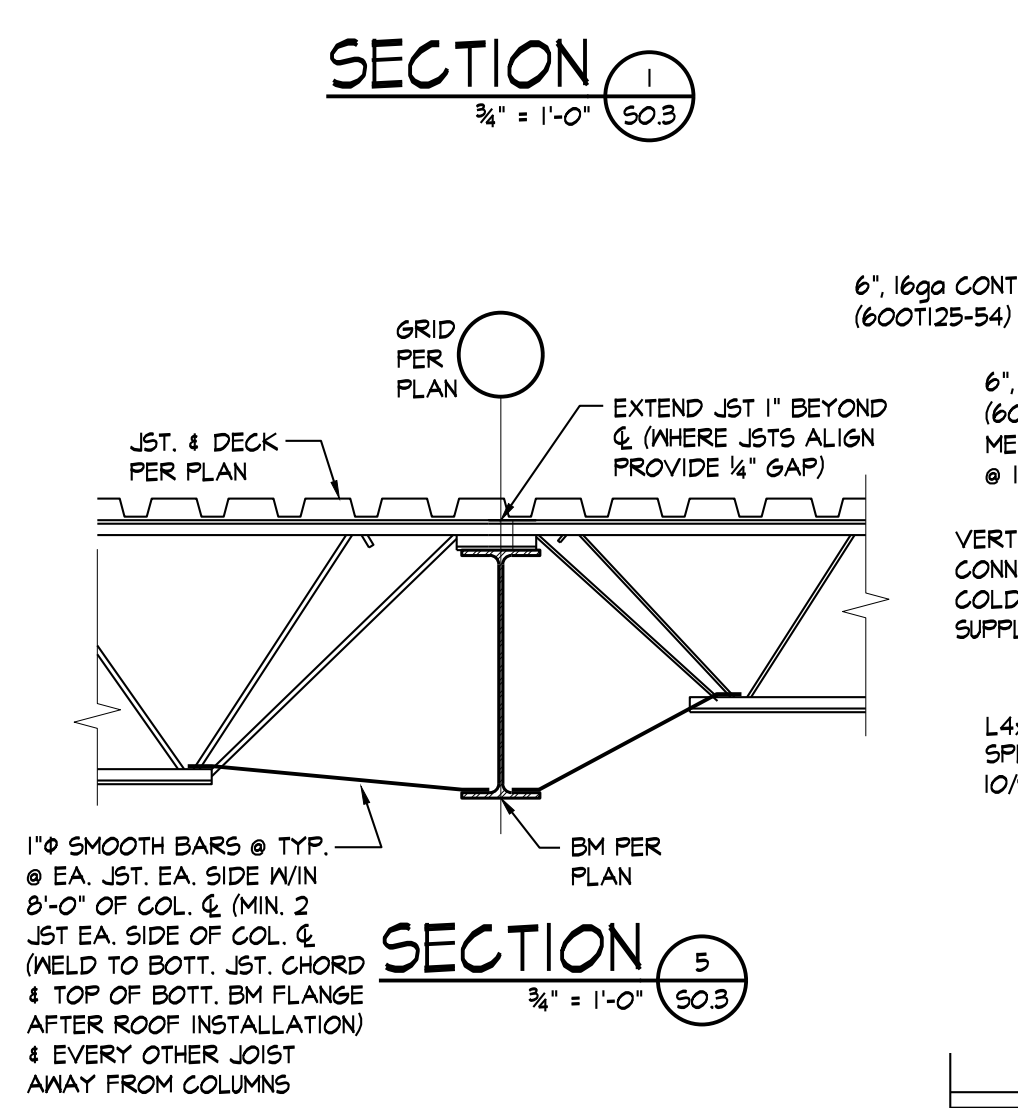

NOTES:  
1. RTU LOCATION AND ROOF DECK OPENING SIZE PER MEP DRAWINGS.  
2. ALL ROOF DECK EDGES SHALL BE SUPPORTED BY A JOIST OR AN ANGLE FRAME.  
3. ROOF DECK SHALL BE ATTACHED TO SUPPORTING MEMBERS WITH WELDS OR SCREWS @ 6\"/>

RTU FRAMING DETAILS  
SECTION 15  
3/4\"/>

SECTION 16  
3/4\"/>

SECTION 17  
3/4\"/>

SECTION 18  
3/4\"/>

SECTION 19  
3/4\"/>





$\frac{1}{8}" = 1'-0"$

**FOUNDATION NOTES:**


1. REFER TO GENERAL NOTES ON SHEET 50.1
2. TOP OF FOOTING ELEVATION EQUALS 1'-0" BELOW FINISH FLOOR U.N.O. ON PLAN
3. REFER TO 55.0 FOR TYPICAL FOUNDATION DETAILS NOT CUT ON PLAN
4. SEE EXISTING AS-BUILT ON GRADE AS REQUIRED TO PERFORM WORK AND REPAIR PER 7/53.0
5. REFER TO SCHEDULES ON 50.1
6. PROVIDE (6)X3'-6" (3T, 3B) DRILL & EPOXY 12" INTO EXISTING FOOTING & PROJECT INTO NEW FOOTING. LOCATE 4" CLEAR FROM TOP/BOTTOM OF EXISTING FOOTING

## S2.1

**JonesGillamRenz**  
730 N. Ninth 1881 Main Street, Suite 301  
Salina, KS 67401 Kansas City, MO 64108  
785.827.0386 [jgr@jgarchitects.com](mailto:jgr@jgarchitects.com)

COPYRIGHTED ©



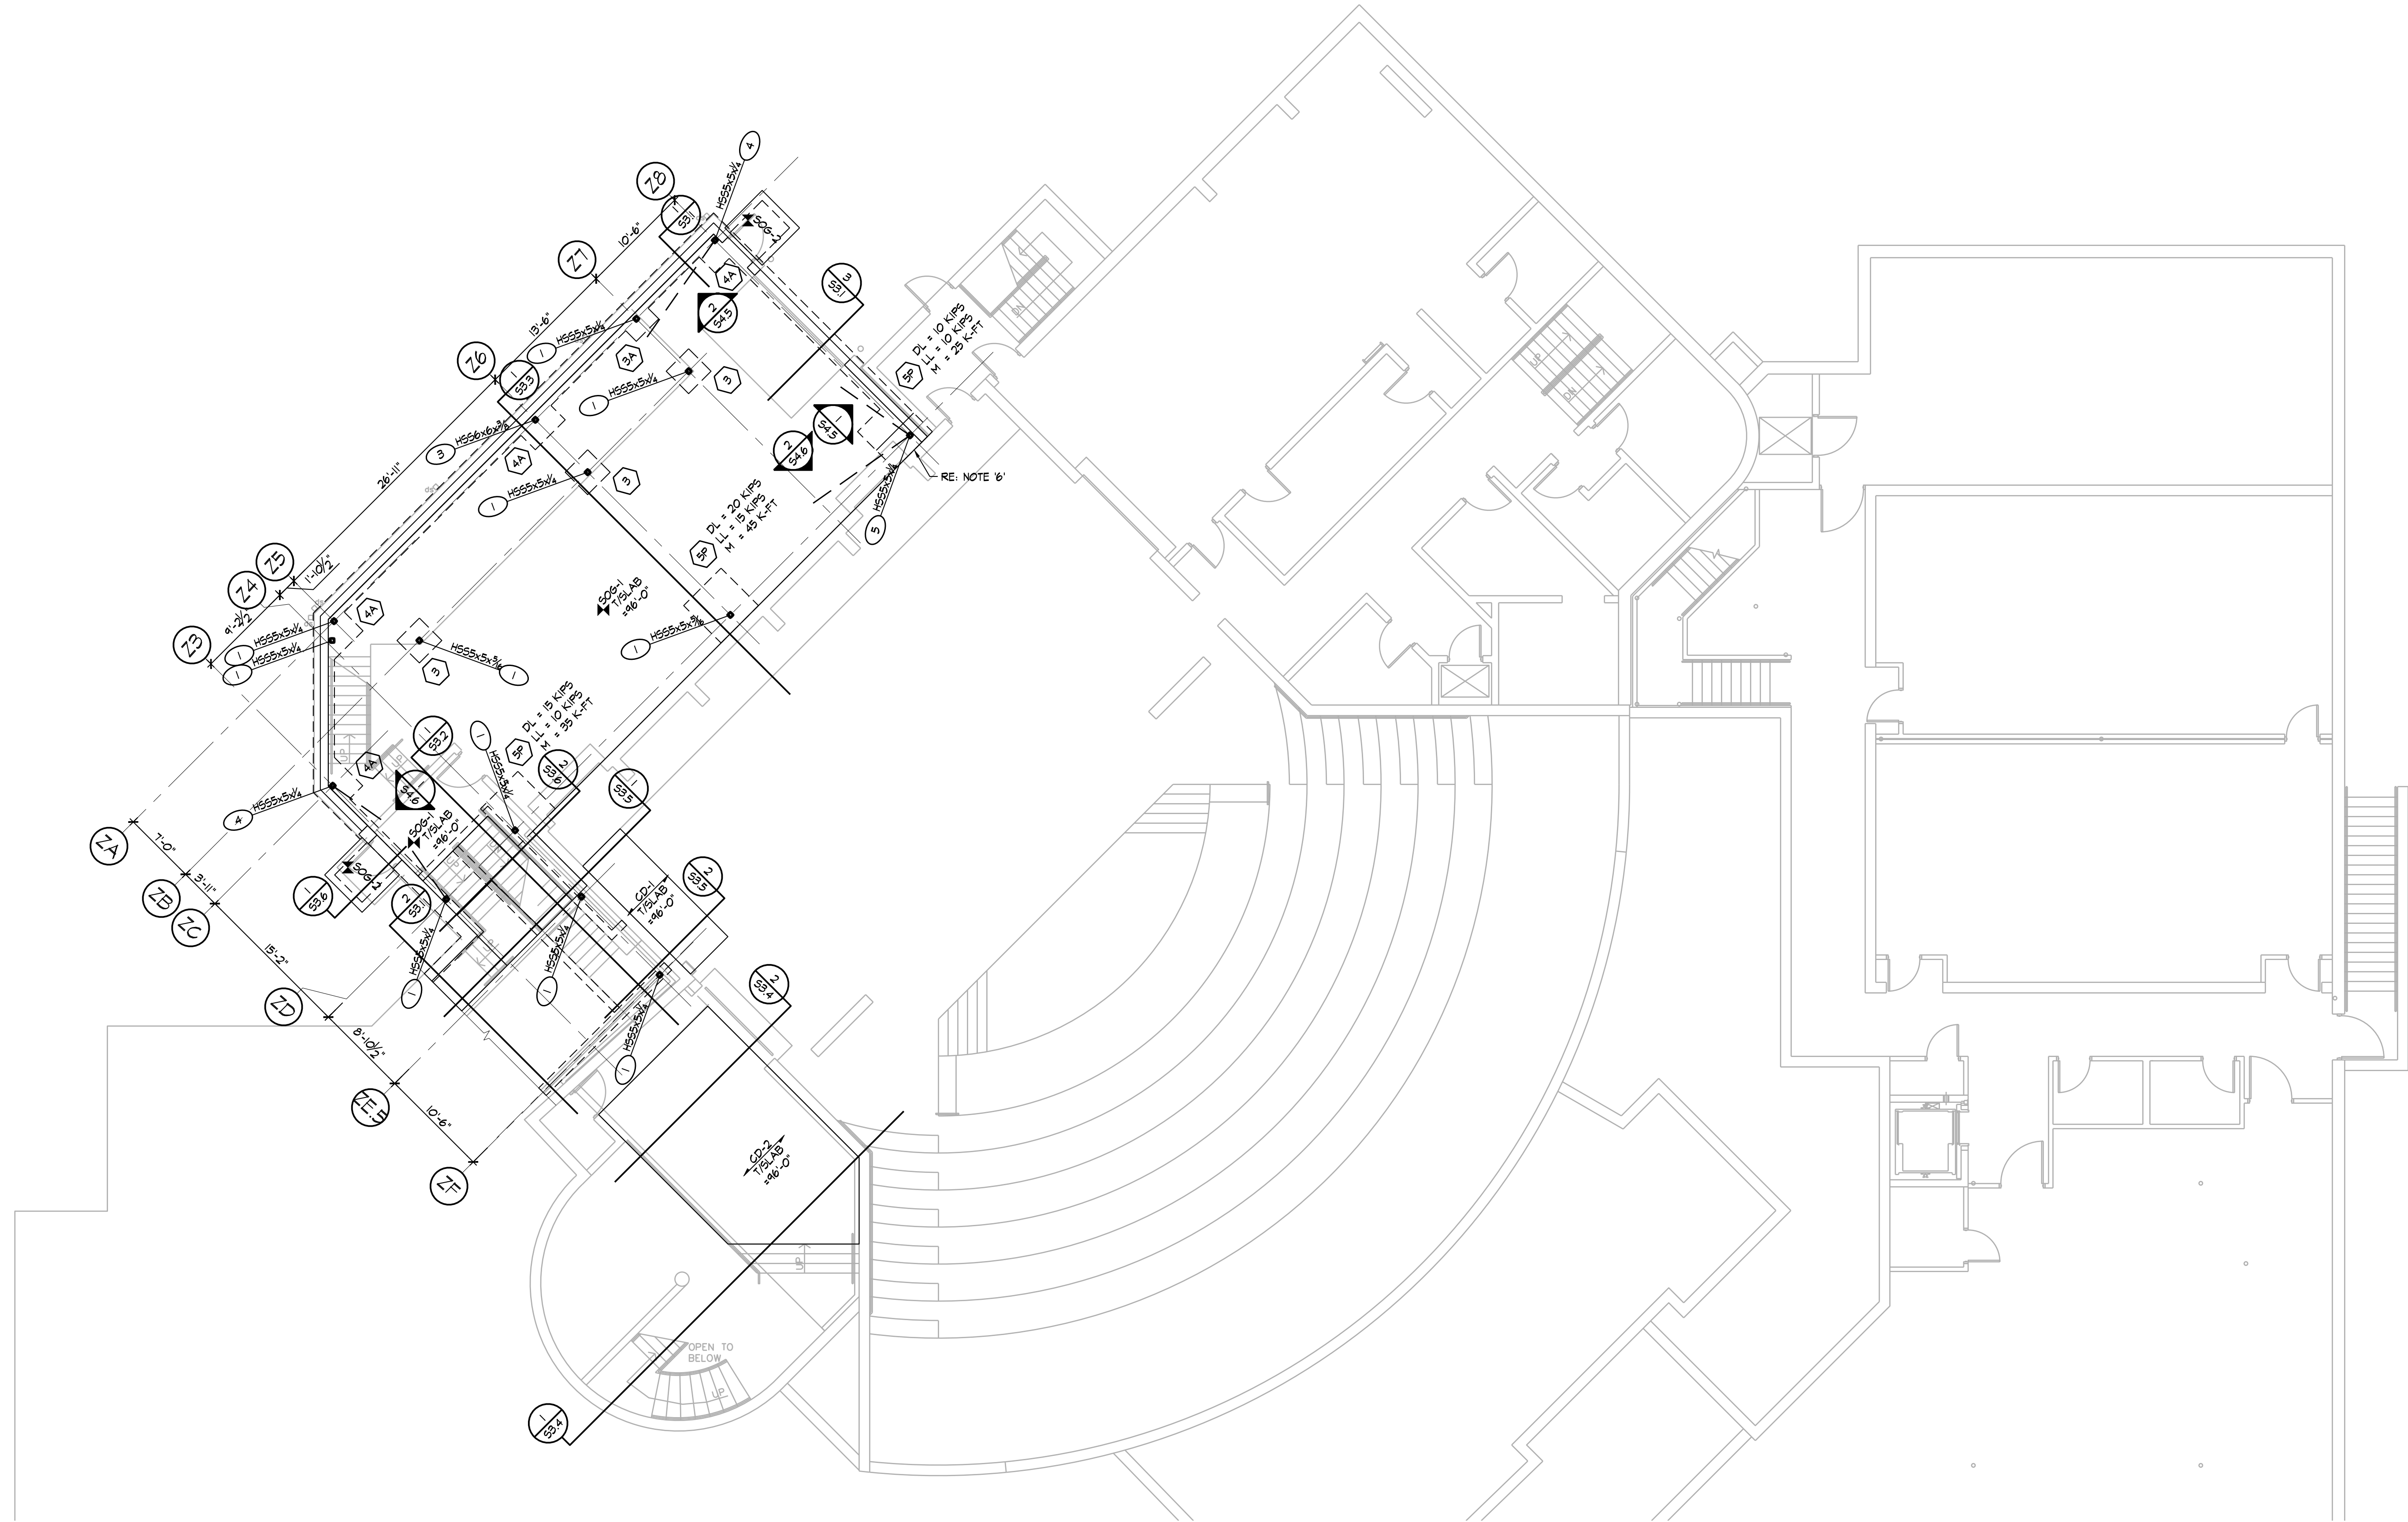

# STAGE LEVEL FOUNDATION & FRAMING PLAN

- FOUNDATION NOTES:
1. REFER TO GENERAL NOTES ON SHEET 501
  2. TOP OF FOOTING ELEVATION EQUALS 1'-0" BELOW FINISH FLOOR U.N.O. ON PLAN
  3. REFER TO 53.0 FOR TYPICAL FOUNDATION DETAILS NOT CUT ON PLAN
  4. REMOVE EXISTING SLAB ON GRADE AS REQUIRED TO PERFORM WORK AND REPAIR PER 7/53.0
  5. REFER TO SCHEDULES ON 501
  6. PROVIDE (6) #5X3'-6" (3T, 3B) DRILL & EPOXY 12" INTO EXISTING FOOTING & PROJECT INTO NEW FOOTING. LOCATE 4" CLEAR FROM TOP/BOTTOM OF EXISTING FOOTING

**BOB D. CAMPBELL & CO.**  
Structural Engineers Since 1957  
4338 Belleview Ave. 816.531.4144  
Kansas City, MO 64111 www.bdc-engrs.com

**THEATRE SALINA**  
DANCE STUDIOS & SCENE SHOP EXPANSION  
SALINA, KANSAS




REVISION:	
DATE:	9-18-2026
JOB:	22-3239
SHEET NO.:	

**S2.2**

COPYRIGHTED ©

**JGR**  
JonesGillamRenz  
730 N. Ninth Street, Suite 301  
Salina, KS 67401 Kansas City, MO 64108  
785.827.0386  
jgr@jgarchitects.com



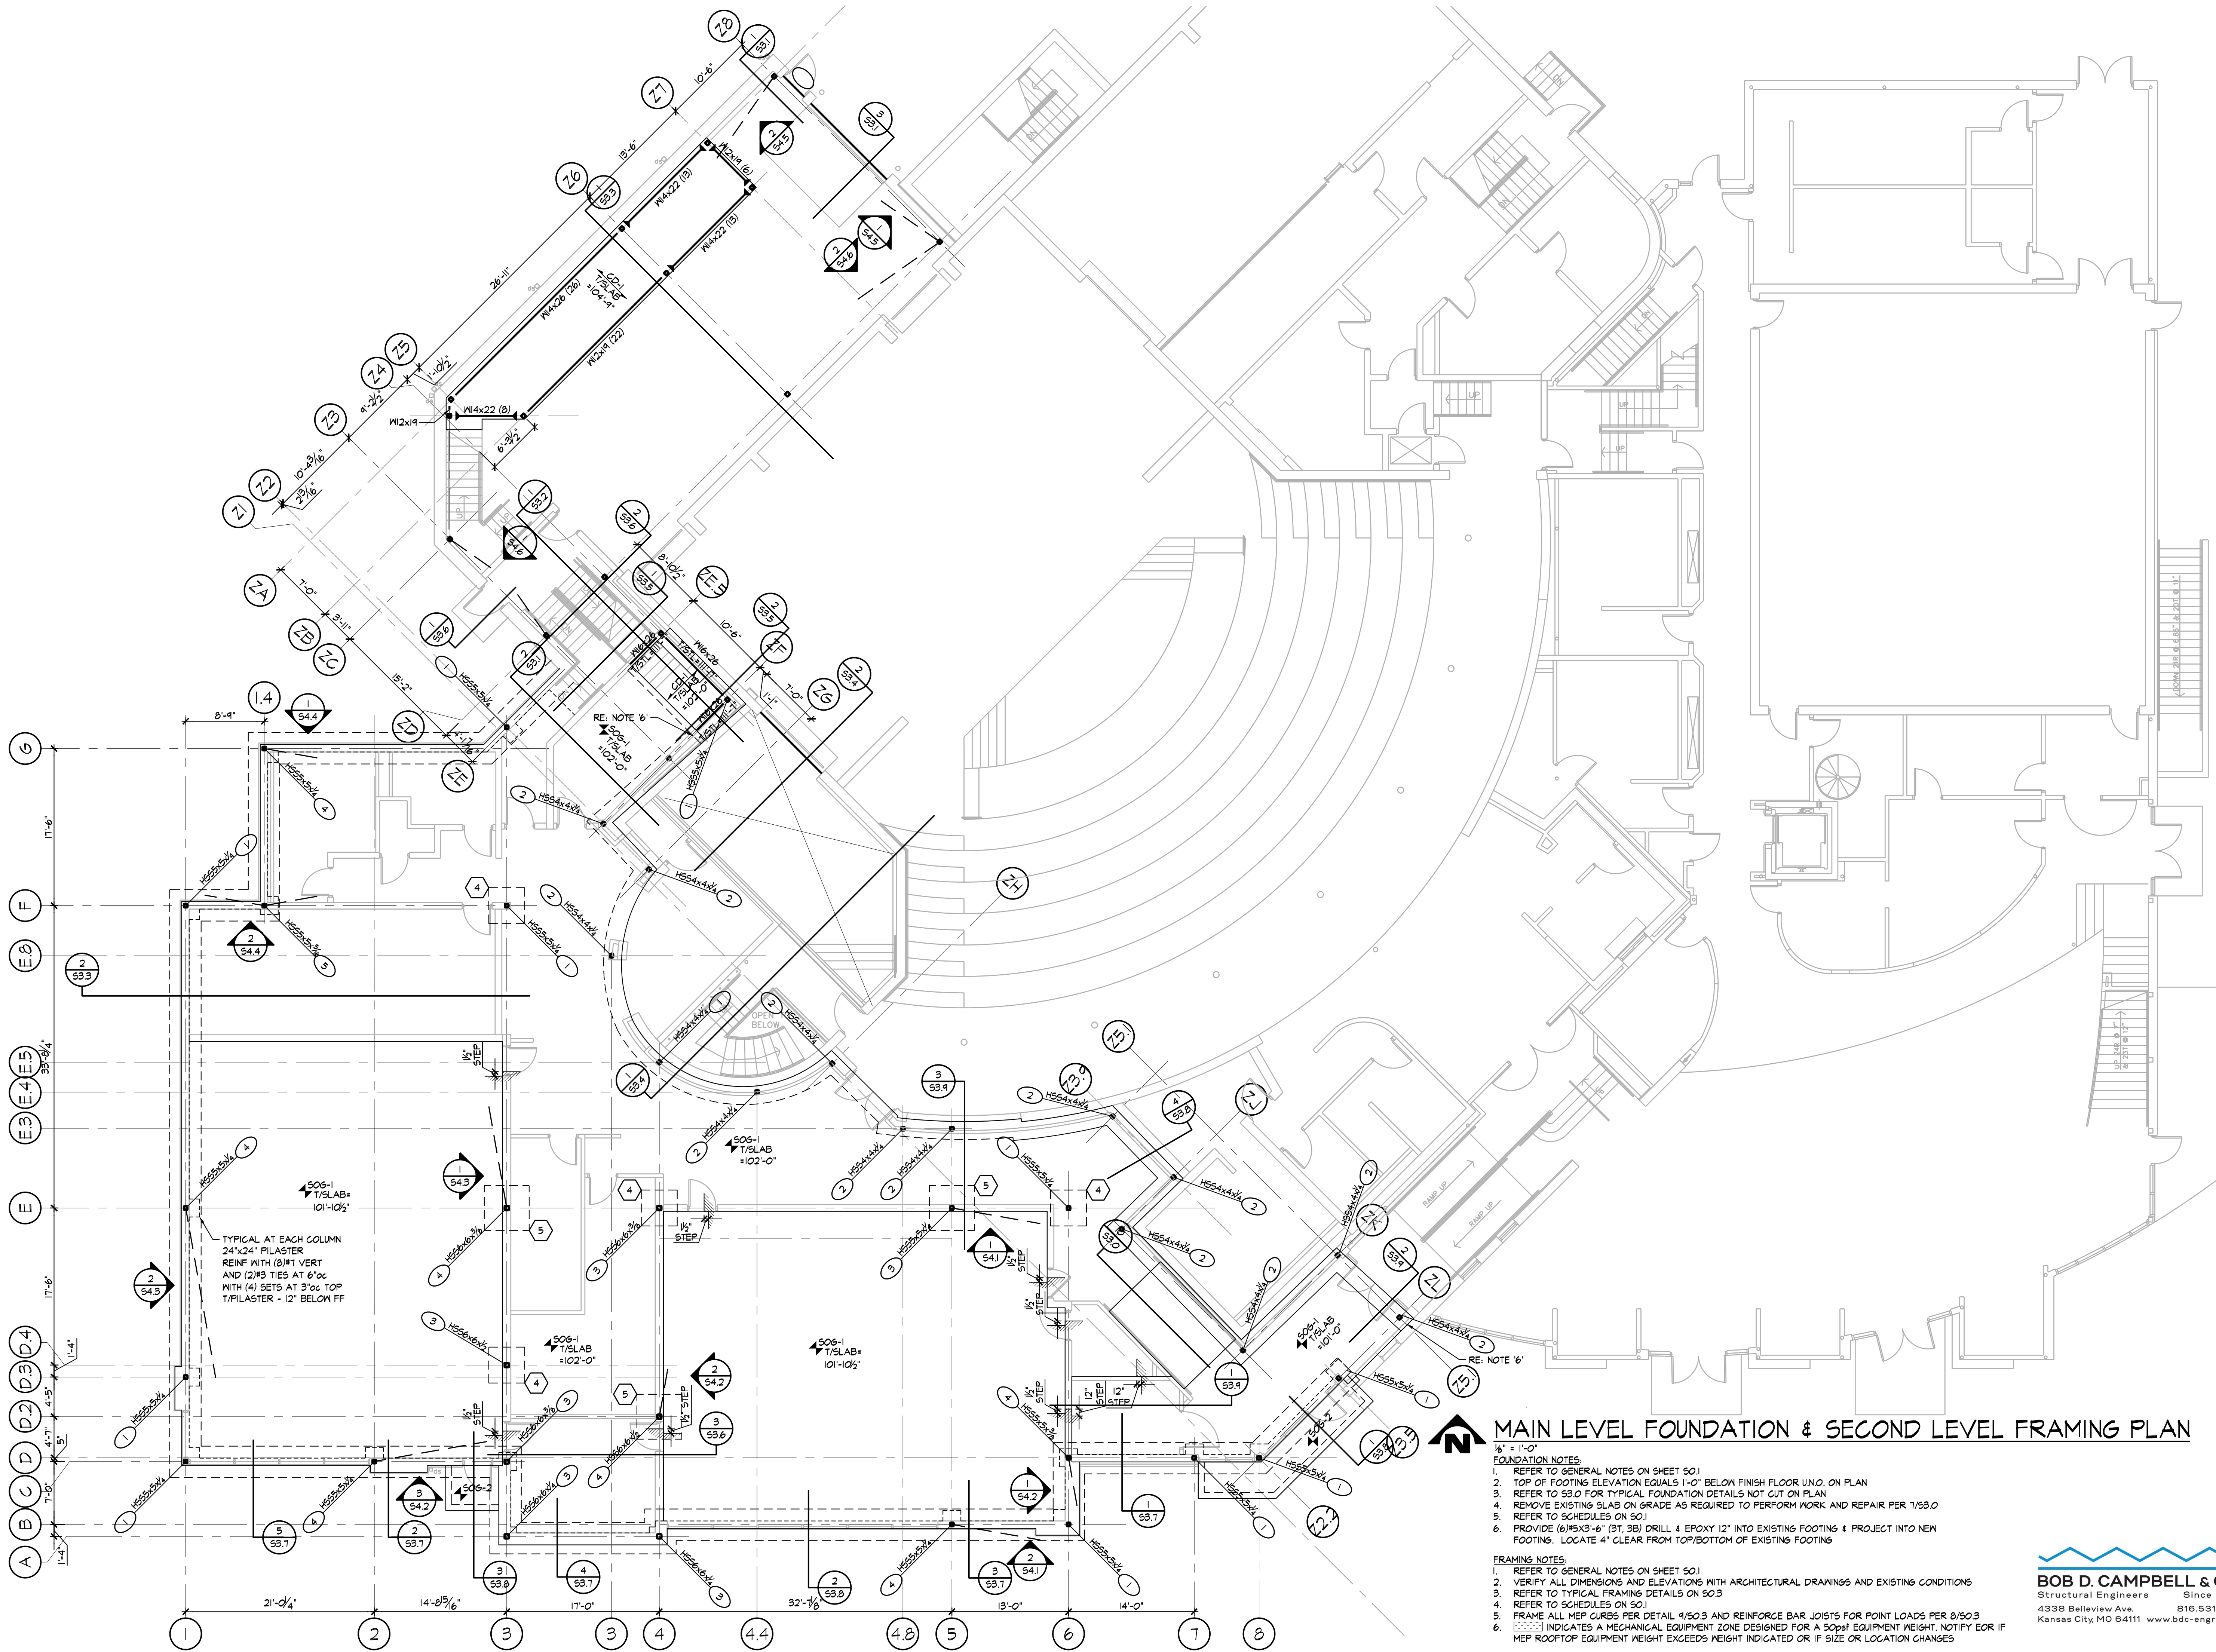

MAIN LEVEL FOUNDATION & SECOND LEVEL FRAMING PLAN


- 1/8" = 1'-0"
- FOUNDATION NOTES:
1. REFER TO GENERAL NOTES ON SHEET S0.1
  2. TOP OF FOOTING ELEVATION EQUALS 1'-0" BELOW FINISH FLOOR U.N.O. ON PLAN
  3. REFER TO S3.0 FOR TYPICAL FOUNDATION DETAILS NOT CUT ON PLAN
  4. REMOVE EXISTING SLAB ON GRADE AS REQUIRED TO PERFORM WORK AND REPAIR PER 1/53.0
  5. REFER TO SCHEDULES ON S0.1
  6. PROVIDE (6) 5x3'-6" (31, 38) DRILL & EPOXY 12" INTO EXISTING FOOTING & PROJECT INTO NEW FOOTING. LOCATE 4" CLEAR FROM TOP/BOTTOM OF EXISTING FOOTING
- FRAMING NOTES:
1. REFER TO GENERAL NOTES ON SHEET S0.1
  2. VERIFY ALL DIMENSIONS AND ELEVATIONS WITH ARCHITECTURAL DRAWINGS AND EXISTING CONDITIONS
  3. REFER TO TYPICAL FRAMING DETAILS ON S0.3
  4. REFER TO SCHEDULES ON S0.1
  5. FRAME ALL MEP CURBS PER DETAIL 9/50.3 AND REINFORCE BAR JOISTS FOR POINT LOADS PER 8/50.3
  6. [Symbol] INDICATES A MECHANICAL EQUIPMENT ZONE DESIGNED FOR A 50psf EQUIPMENT WEIGHT. NOTIFY EOR IF MEP ROOFTOP EQUIPMENT WEIGHT EXCEEDS WEIGHT INDICATED OR IF SIZE OR LOCATION CHANGES

**BOB D. CAMPBELL & CO.**  
Structural Engineers Since 1957  
4338 Bellevue Ave. 818.531.4144  
Kansas City, MO 64111 www.bdc-engrs.com




REVISION:	
DATE:	9-18-2026
JOB:	22-3239
SHEET NO.:	




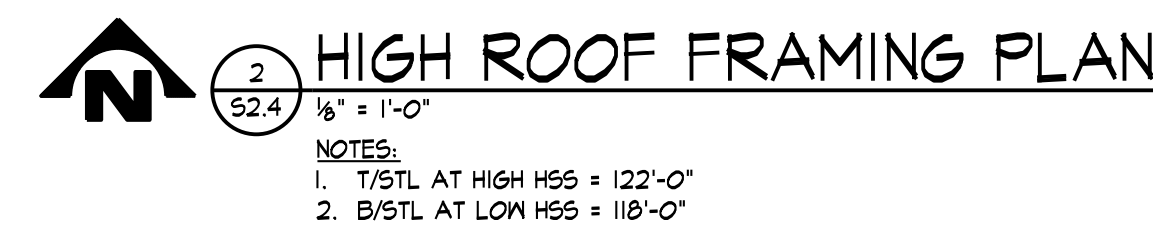






SECTION   
¾" = 1'-0"

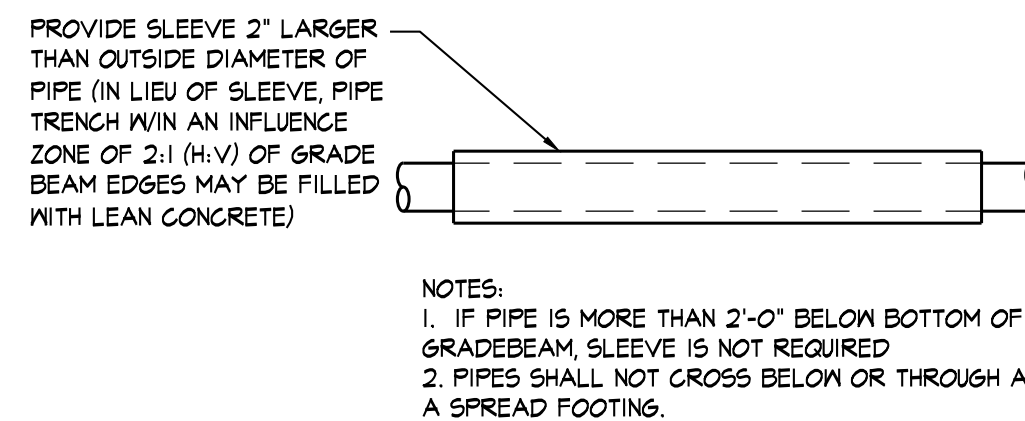

### TYPICAL GRADEBEAM SLEEVE

NOTES:  
1. IF PIPE IS MORE THAN 2'-0" BELOW BOTTOM OF GRADEBEAM, SLEEVE IS NOT REQUIRED  
2. PIPES SHALL NOT CROSS BELOW OR THROUGH A SPREAD FOOTING.



SECTION 6  
 $\frac{3}{4}" = 1'-0"$  53.0



SECTION 7  
3/4" = 1'-0" 53.0




SECTION 8  
 $\frac{3}{4}" = 1'-0"$  53.0



SECTION 9  
 $\frac{3}{4}" = 1'-0"$  53.0




SECTION 10  
 $\frac{3}{4}" = 1'-0"$  53.0




NOTE:

- 1) POUR PILE CAP MONOLITHIC w/ ADJACENT GRADE BEAM
- 2) PILE CAP IS CENTERED AT COLUMN ABOVE UNLESS NOTED OTHERWISE ON PLAN




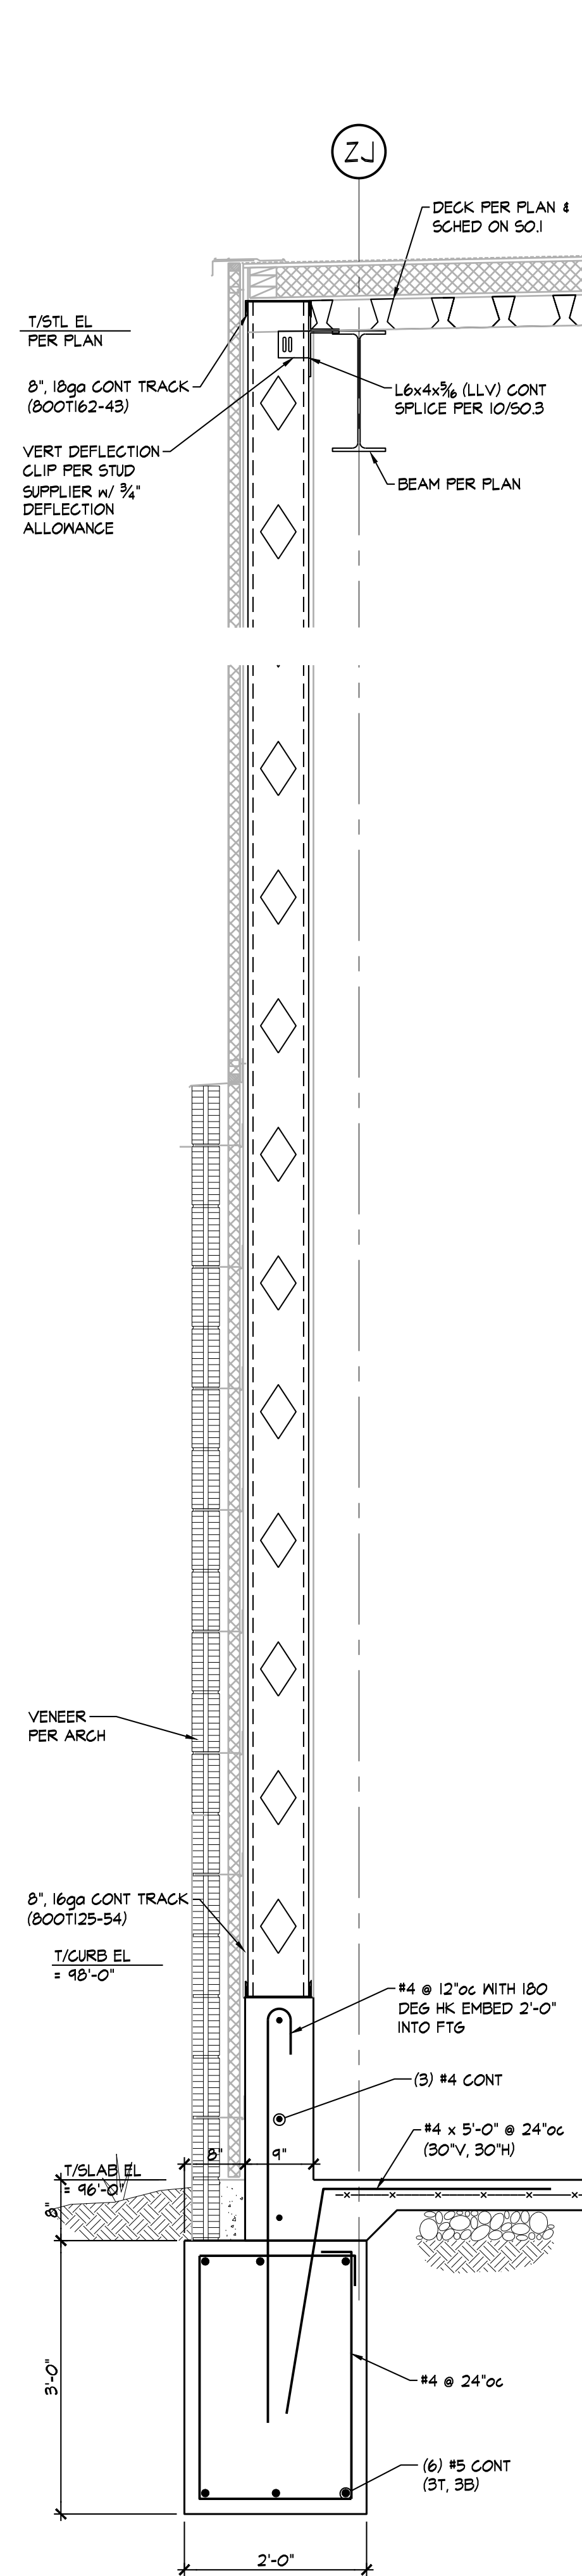

SECTION 1  
3/4" = 1'-0" (S3.1)

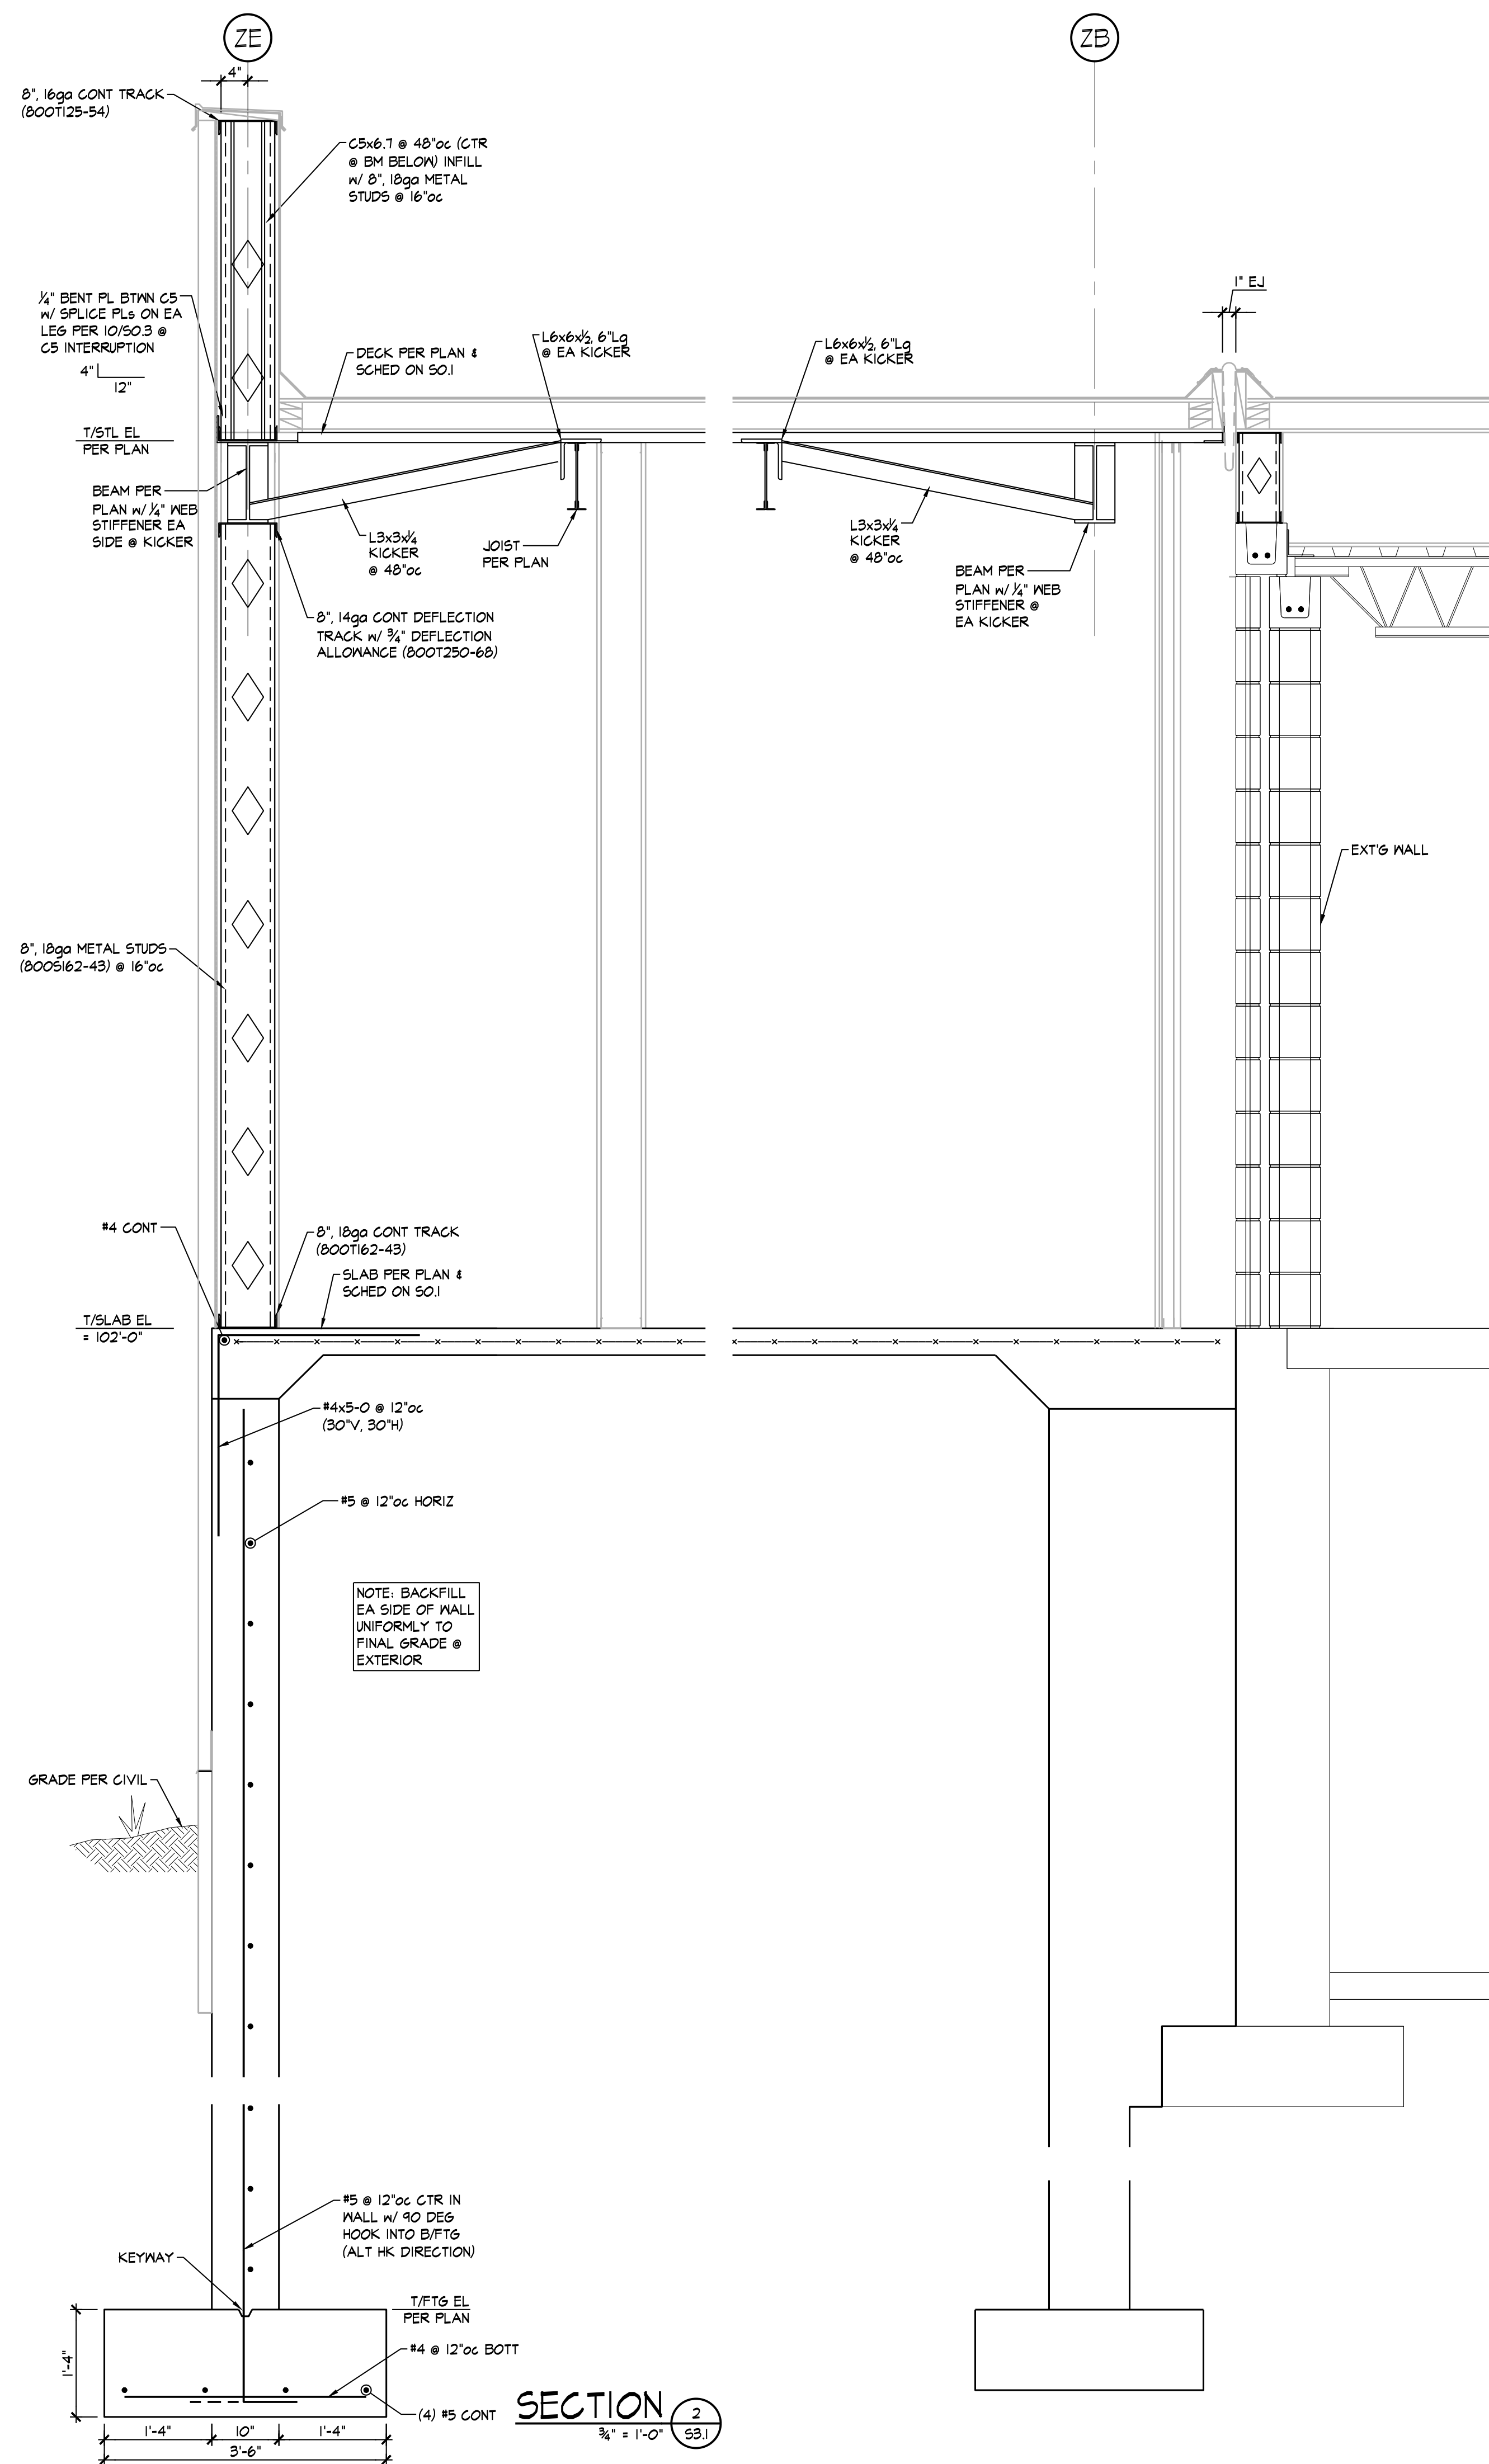


SECTION 2  
3/4" = 1'-0" (S3.1)

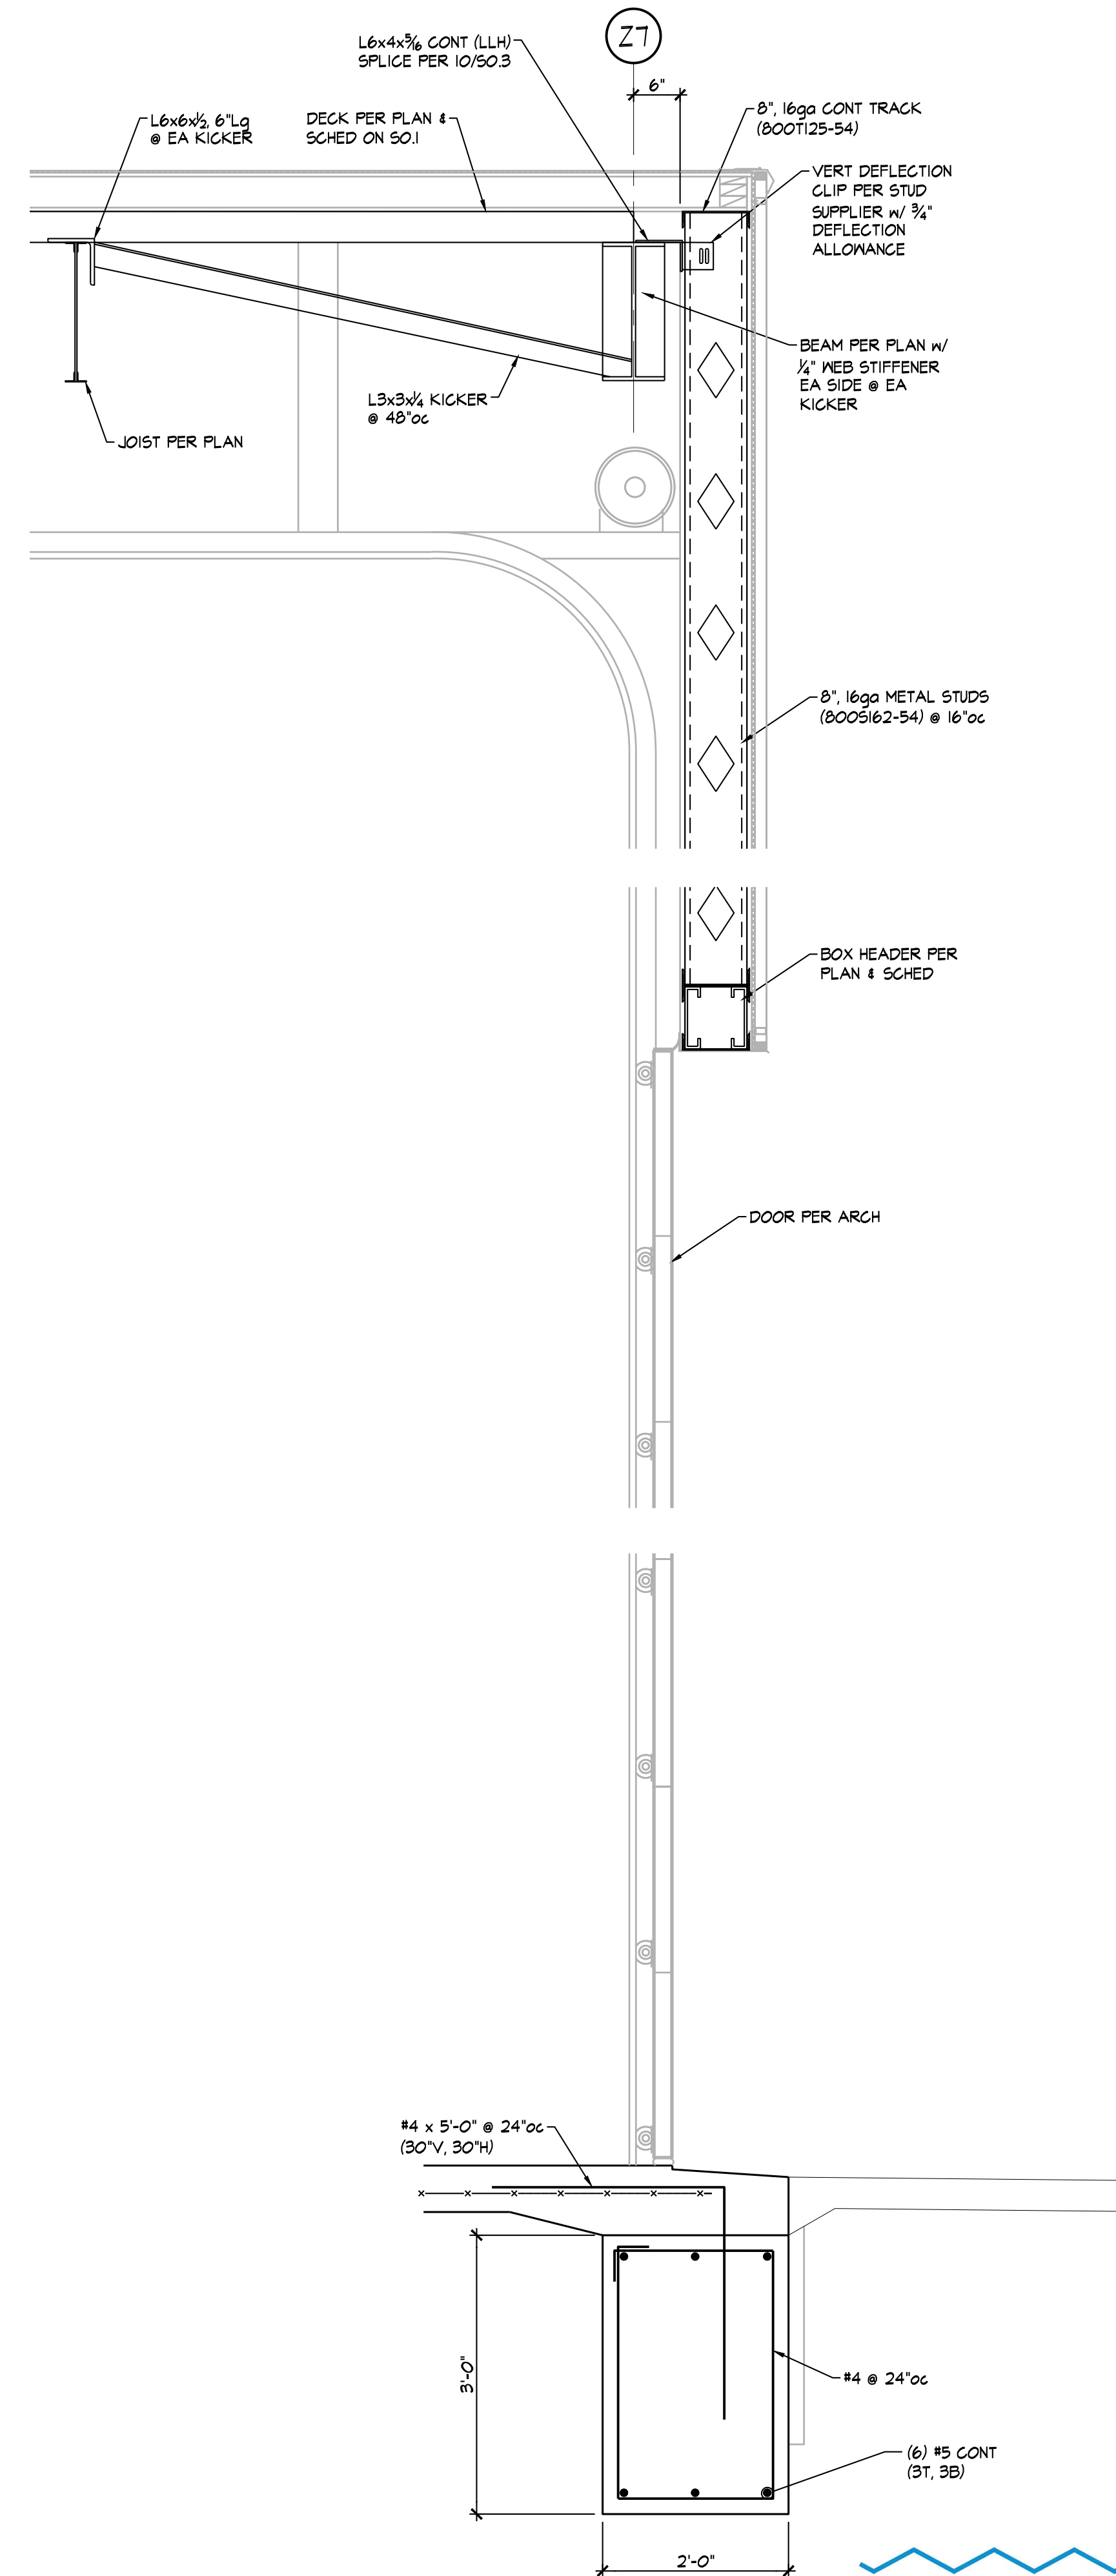


SECTION 3  
3/4" = 1'-0" (S3.1)

**BOB D. CAMPBELL & CO.**  
Structural Engineers Since 1957  
4338 Belleview Ave. 816.531.4144  
Kansas City, MO 64111 www.bdc-engrs.com




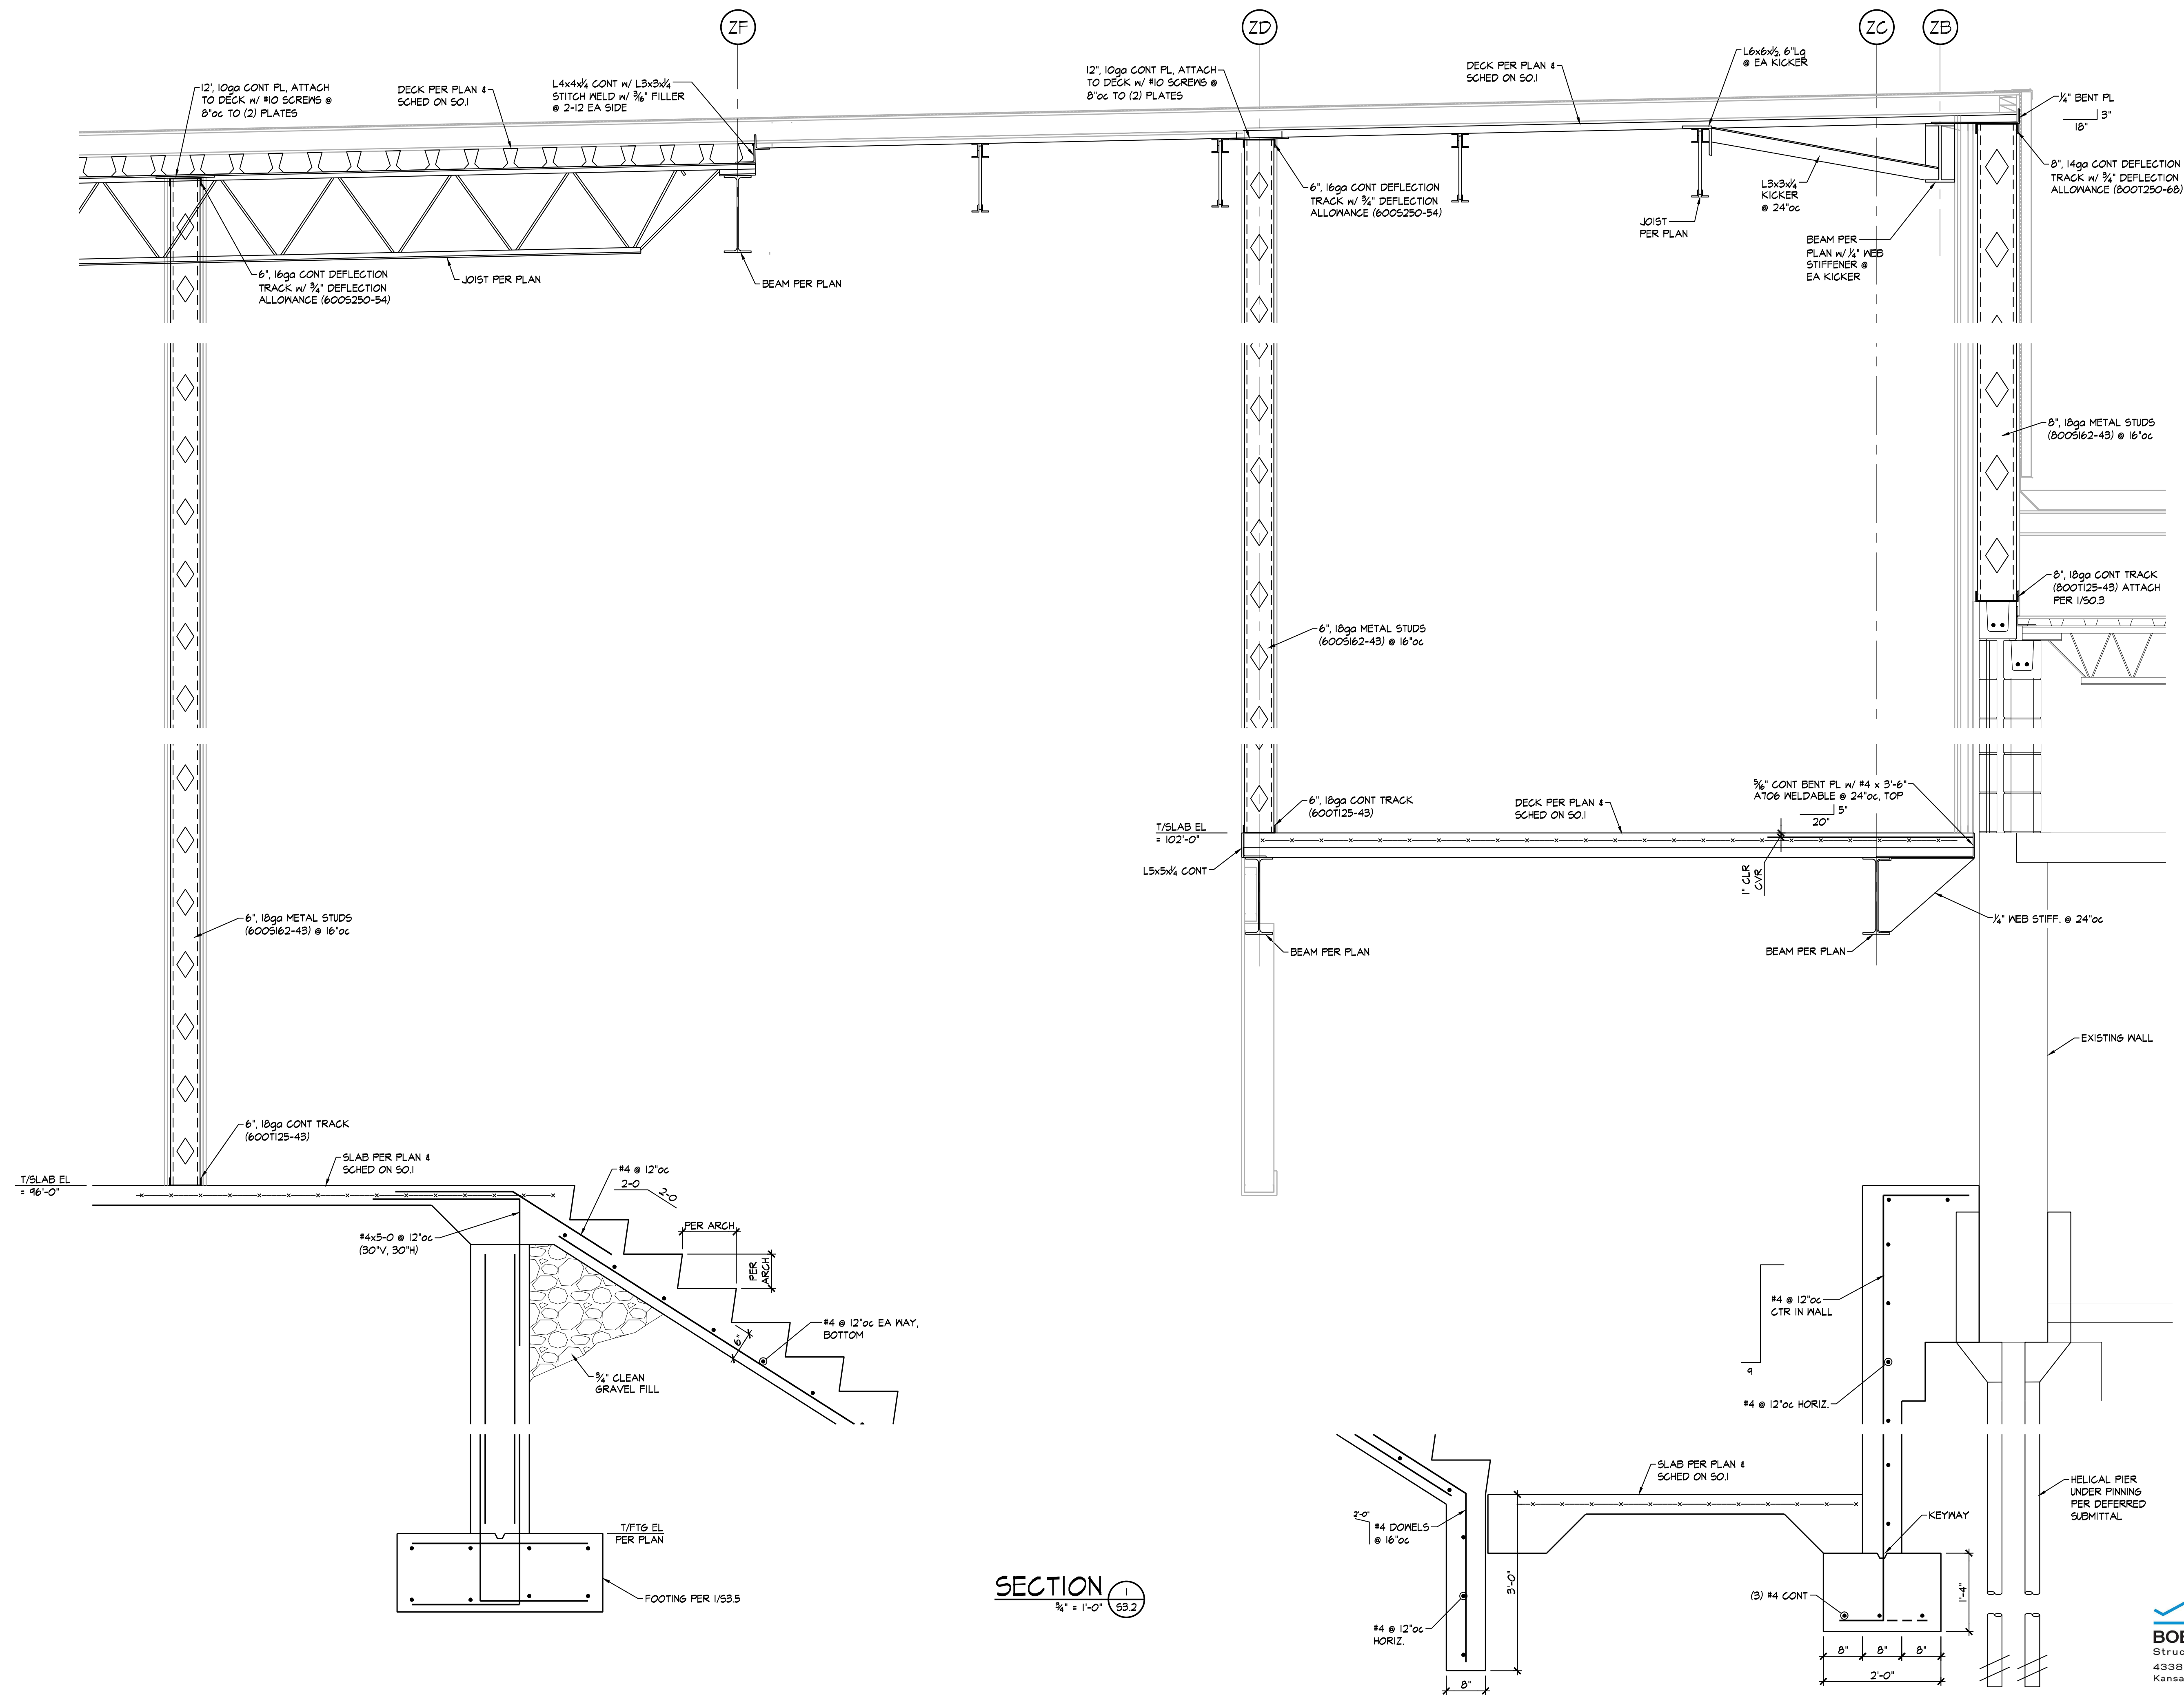




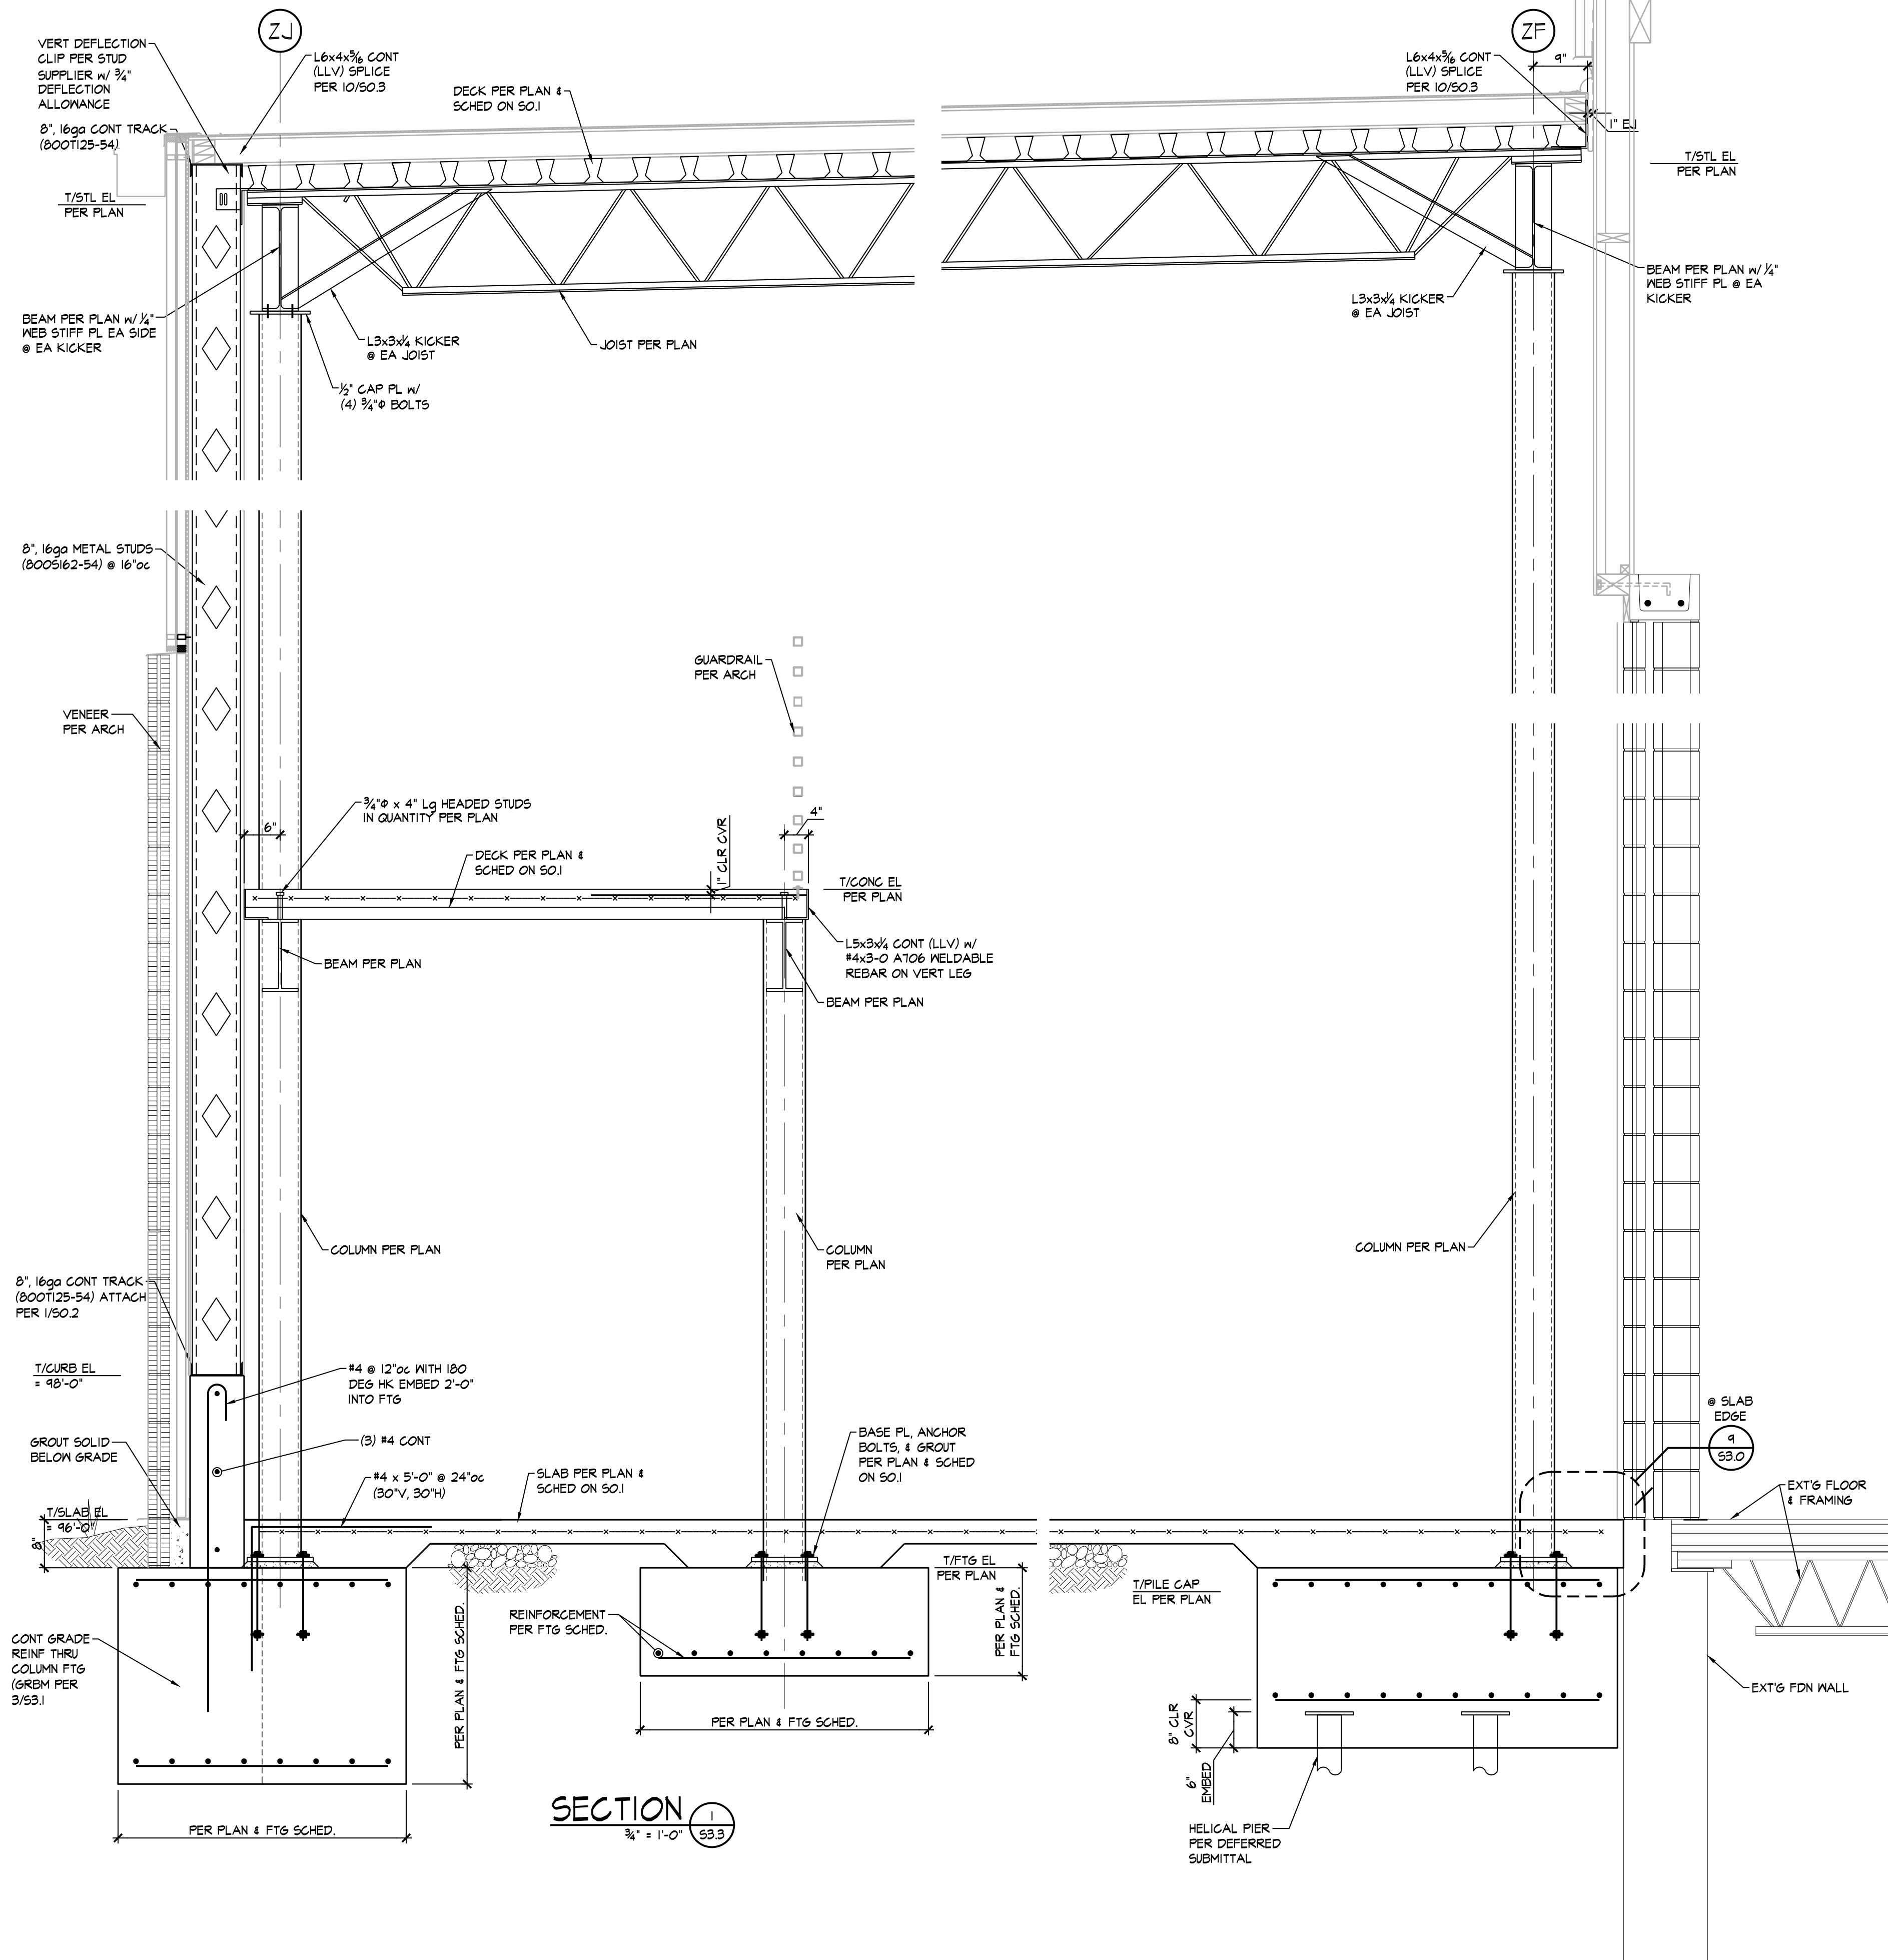




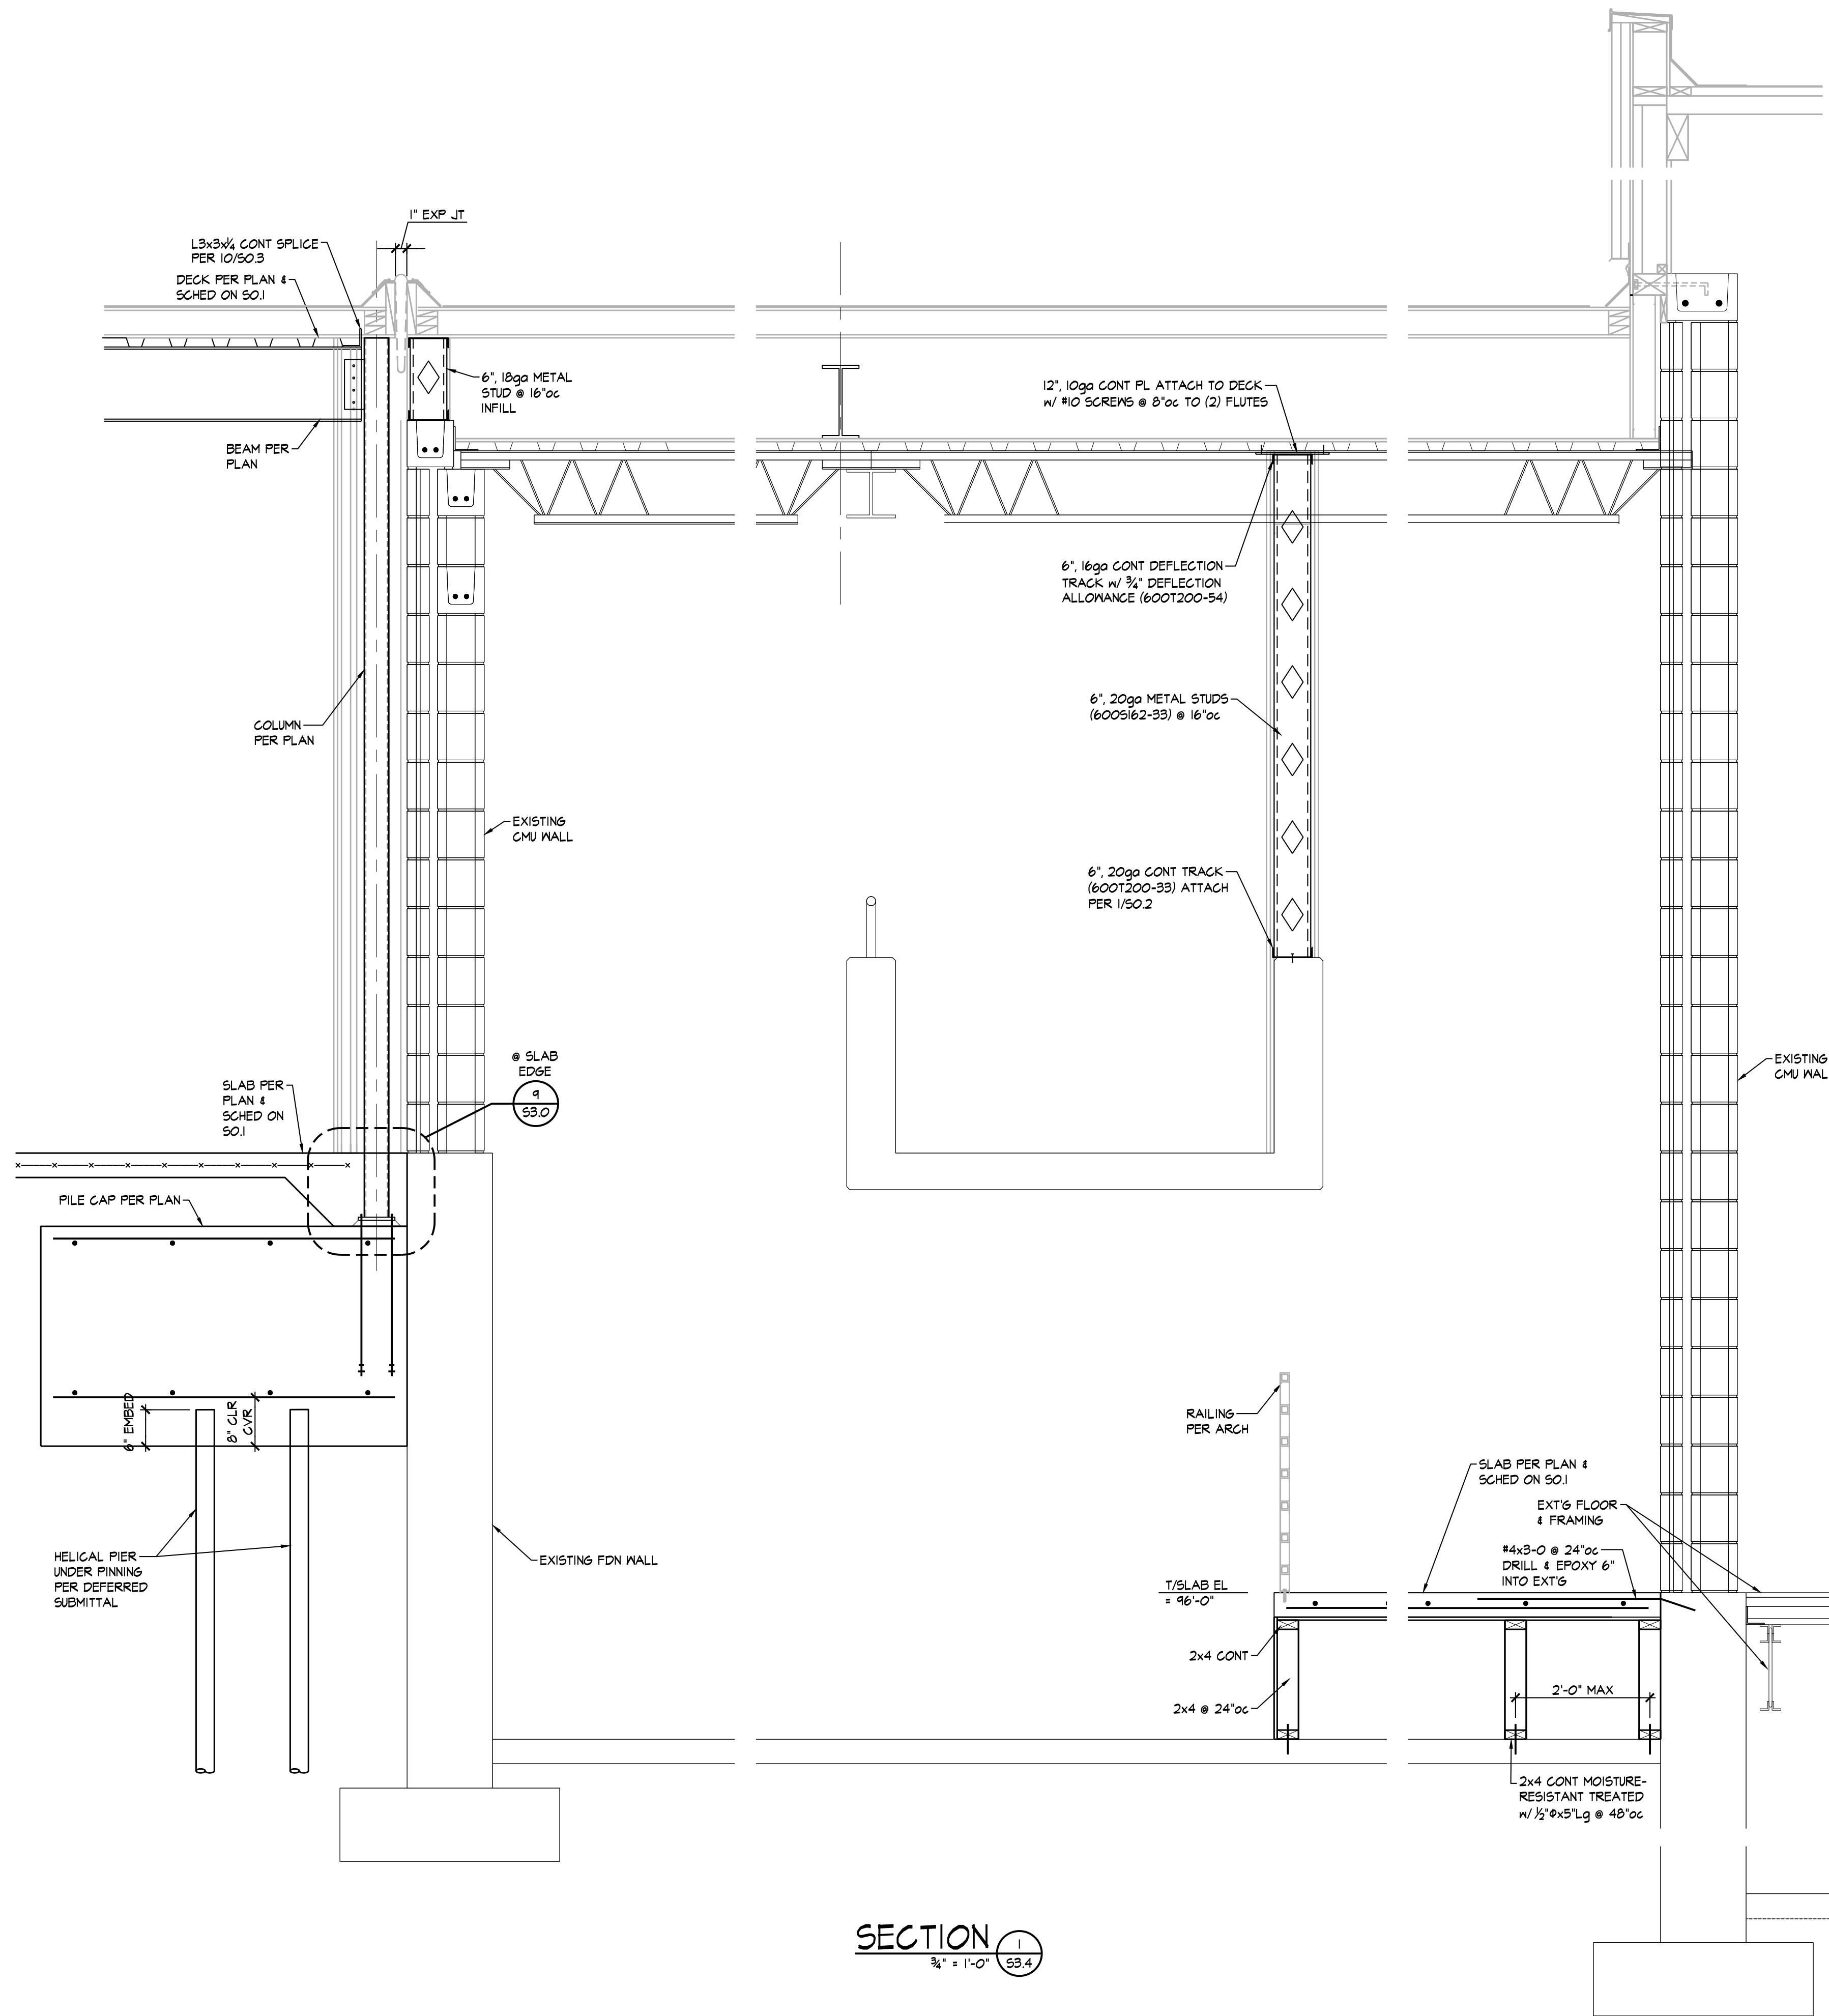


SECTION 1  
3/4" = 1'-0" S3.4

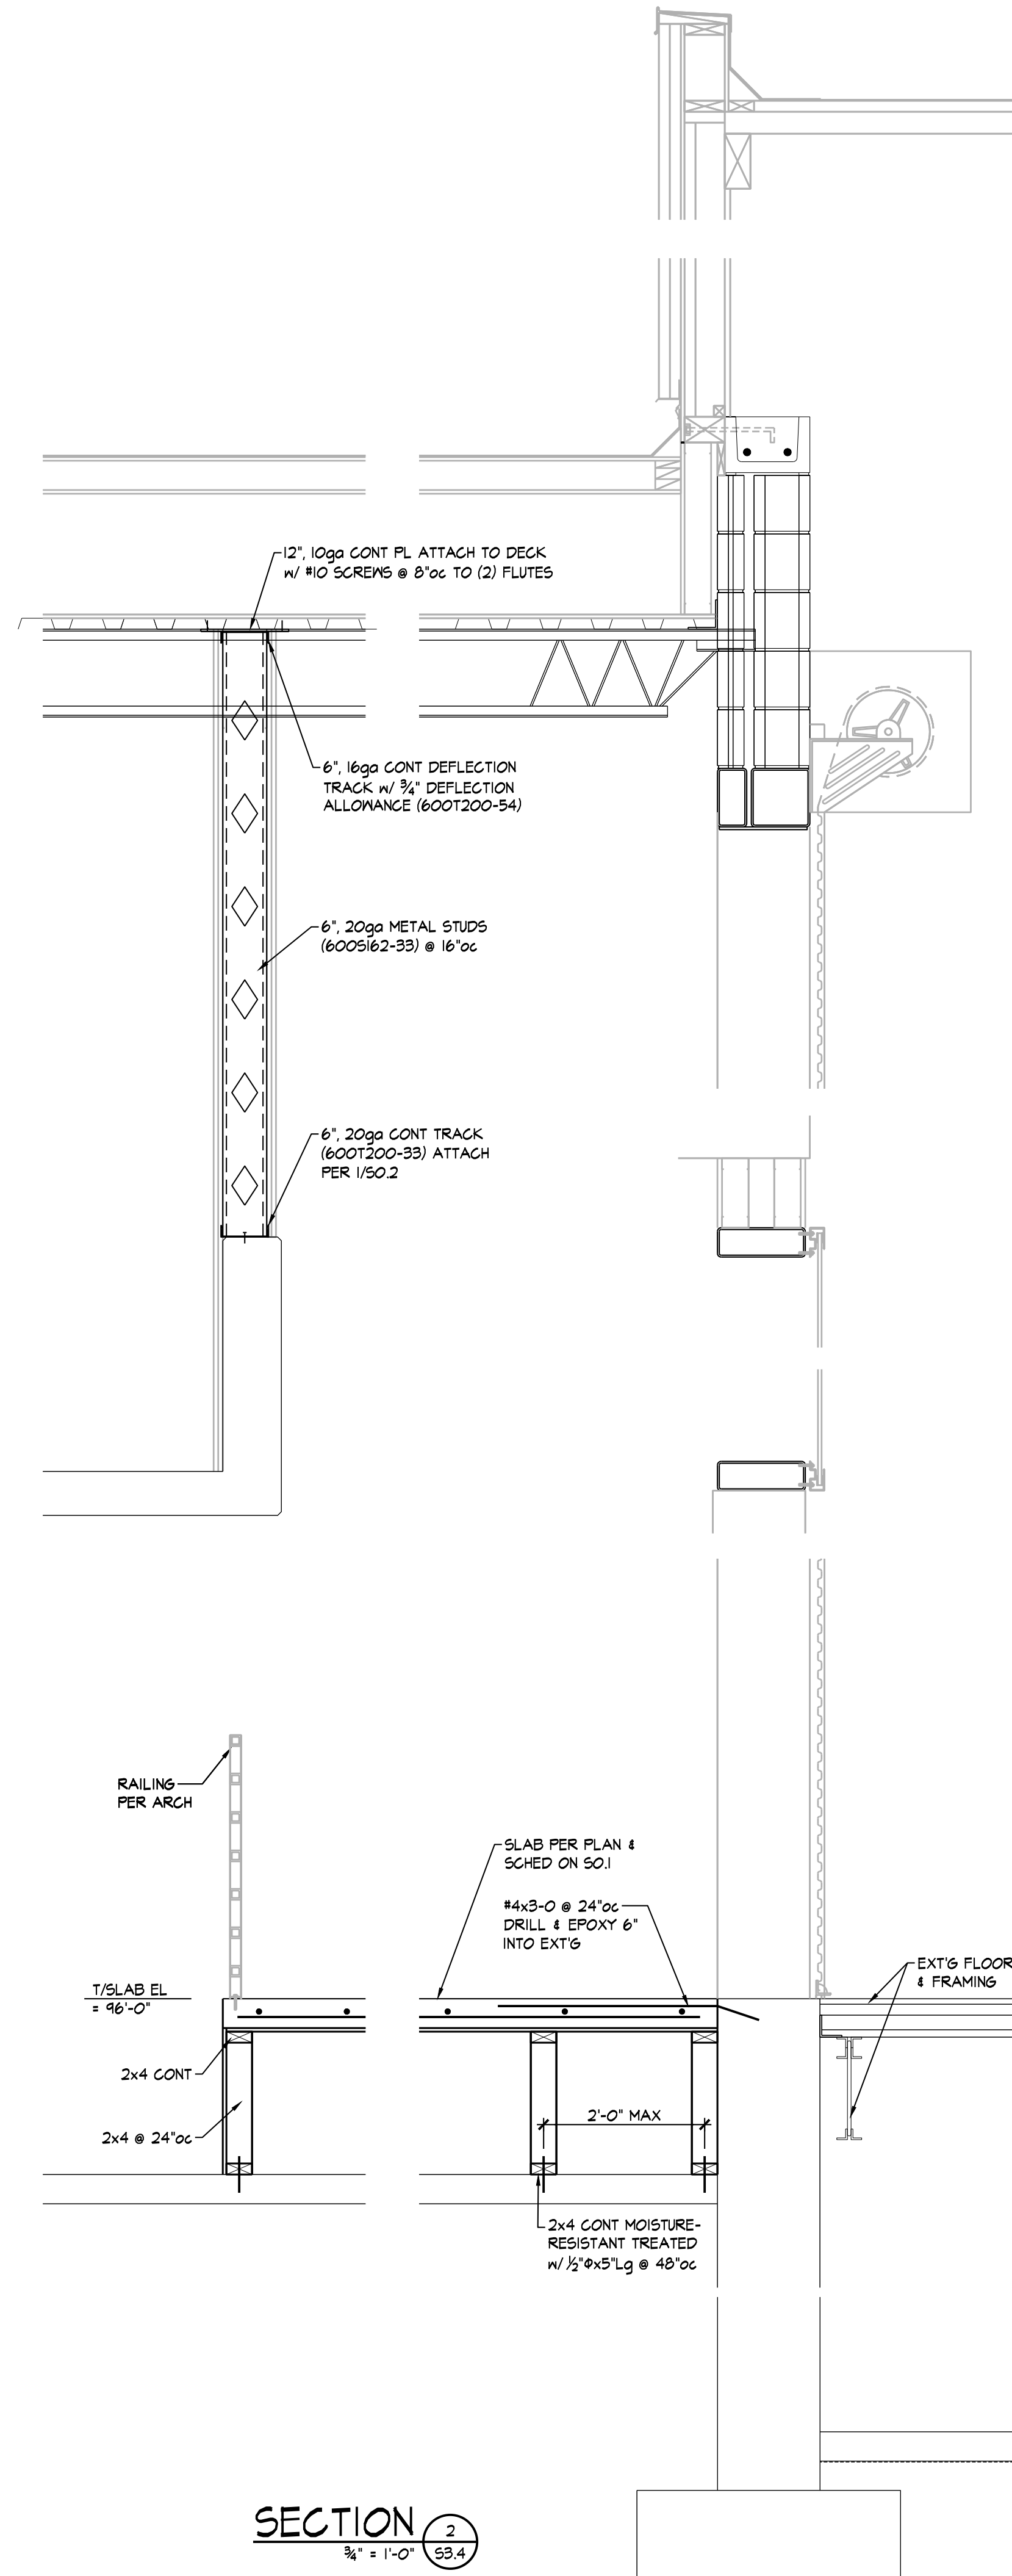

SECTION 2  
3/4" = 1'-0" S3.4



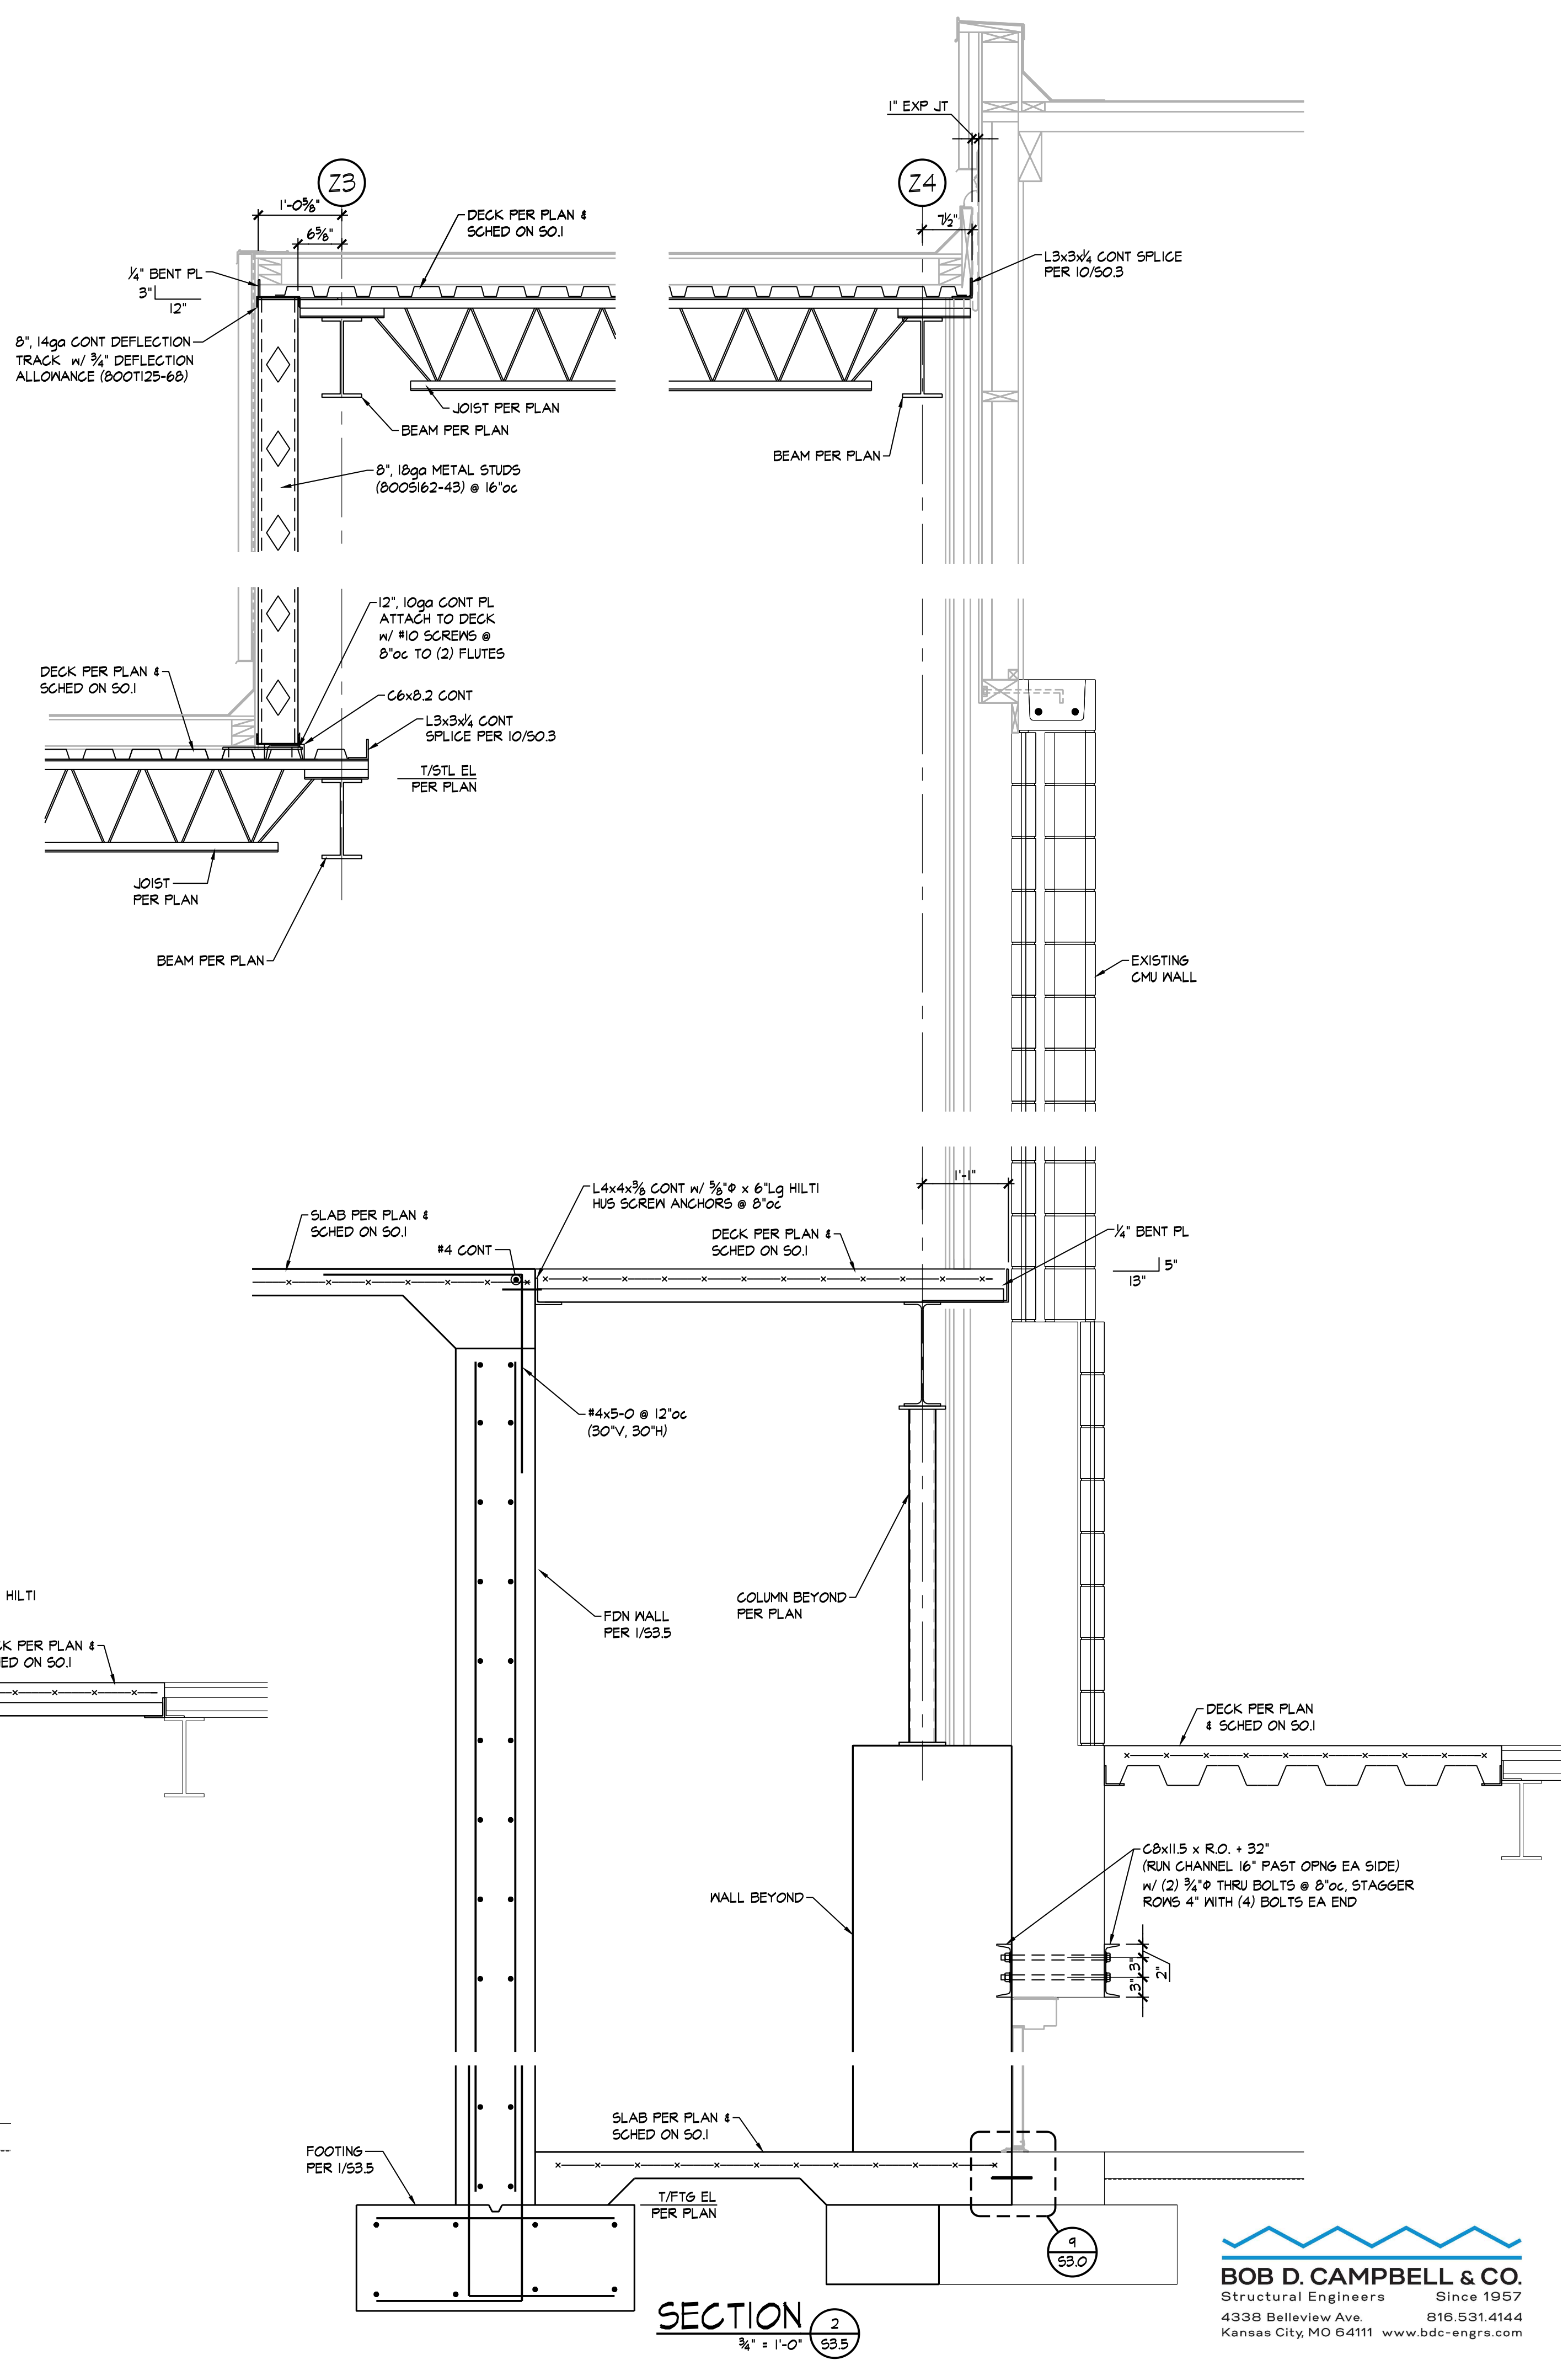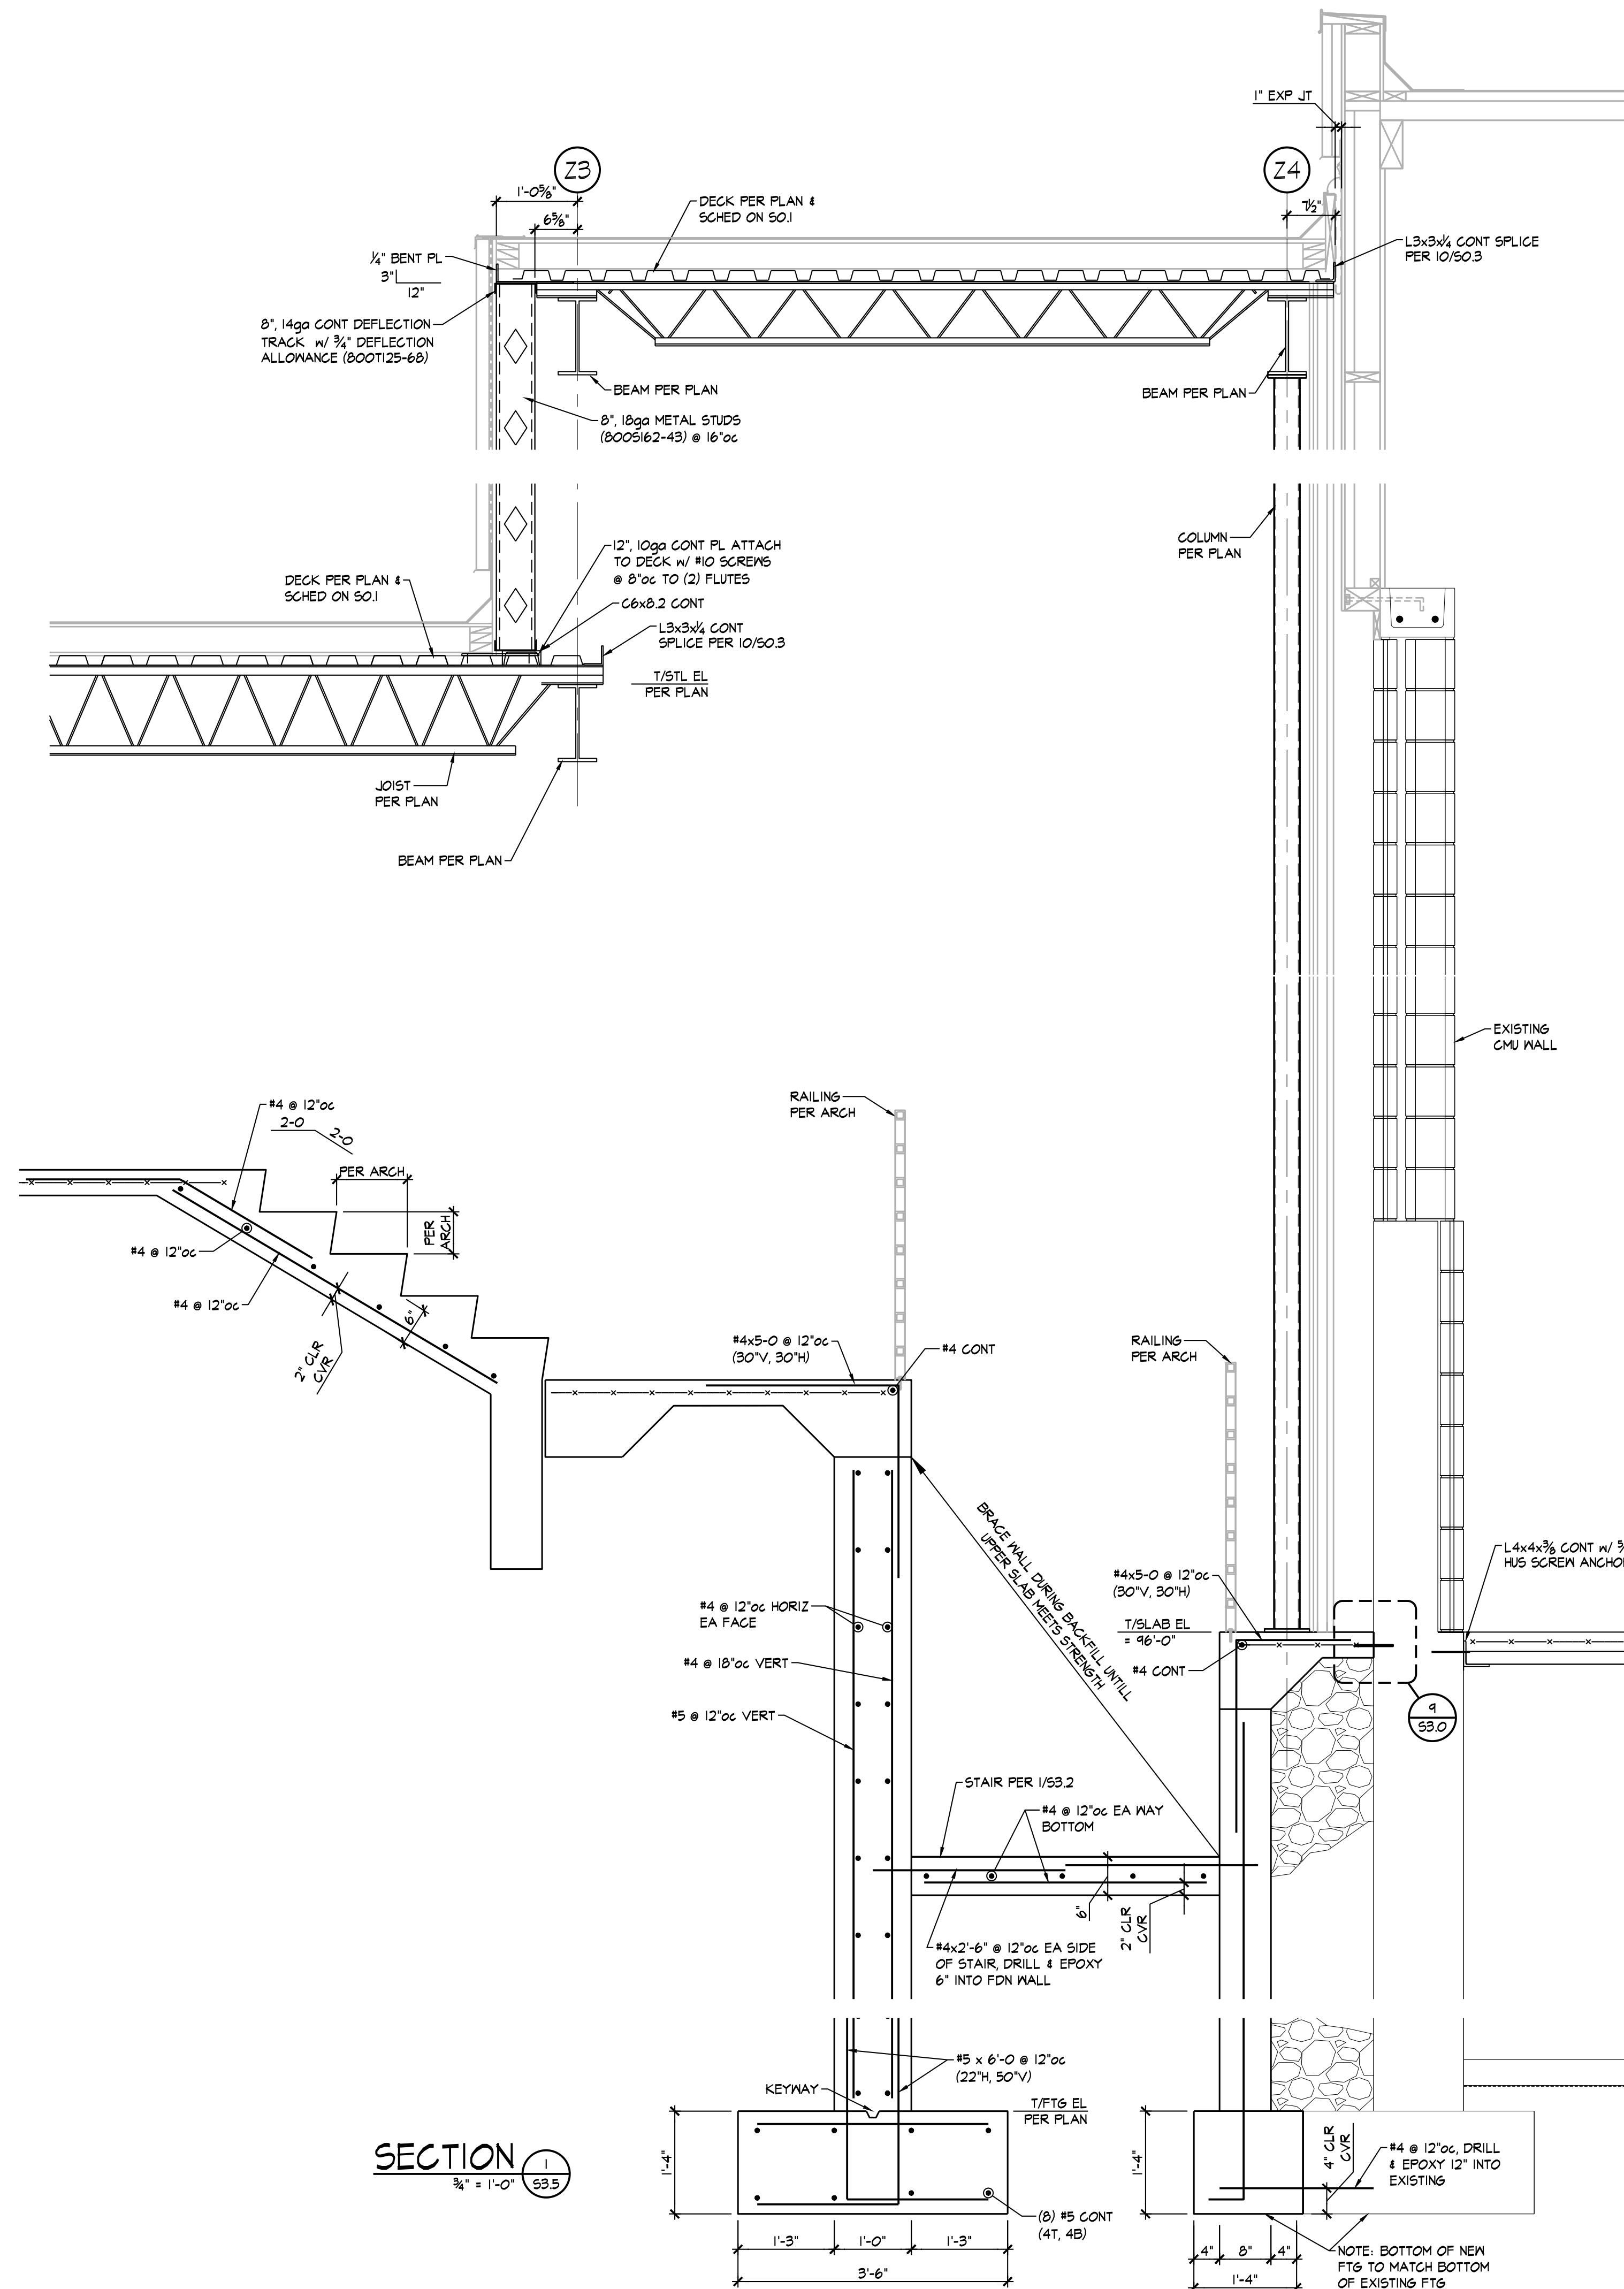

SECTION 1  
3/8" = 1'-0"

SECTION 2  
3/8" = 1'-0"

**BOB D. CAMPBELL & CO.**  
Structural Engineers Since 1957  
4338 Bellevue Ave. 816.531.4144  
Kansas City, MO 64111 www.bdc-engrs.com

**JonesGillamRenz**  
730 N. Ninth Street, Suite 301  
Salina, KS 67401 Kansas City, MO 64108  
jgr@jgarchitects.com 785.827.0386

**JGR**

**THEATRE SALINA**  
DANCE STUDIOS & SCENE SHOP EXPANSION  
SALINA, KANSAS

REVISION:

DATE: 9-18-2026




JOB: 22-3239

SHEET NO.:

**S3.5**

PROF. A. BENNETT  
23831  
9-18-26  
KANSAS  
PROFESSIONAL ENGINEER



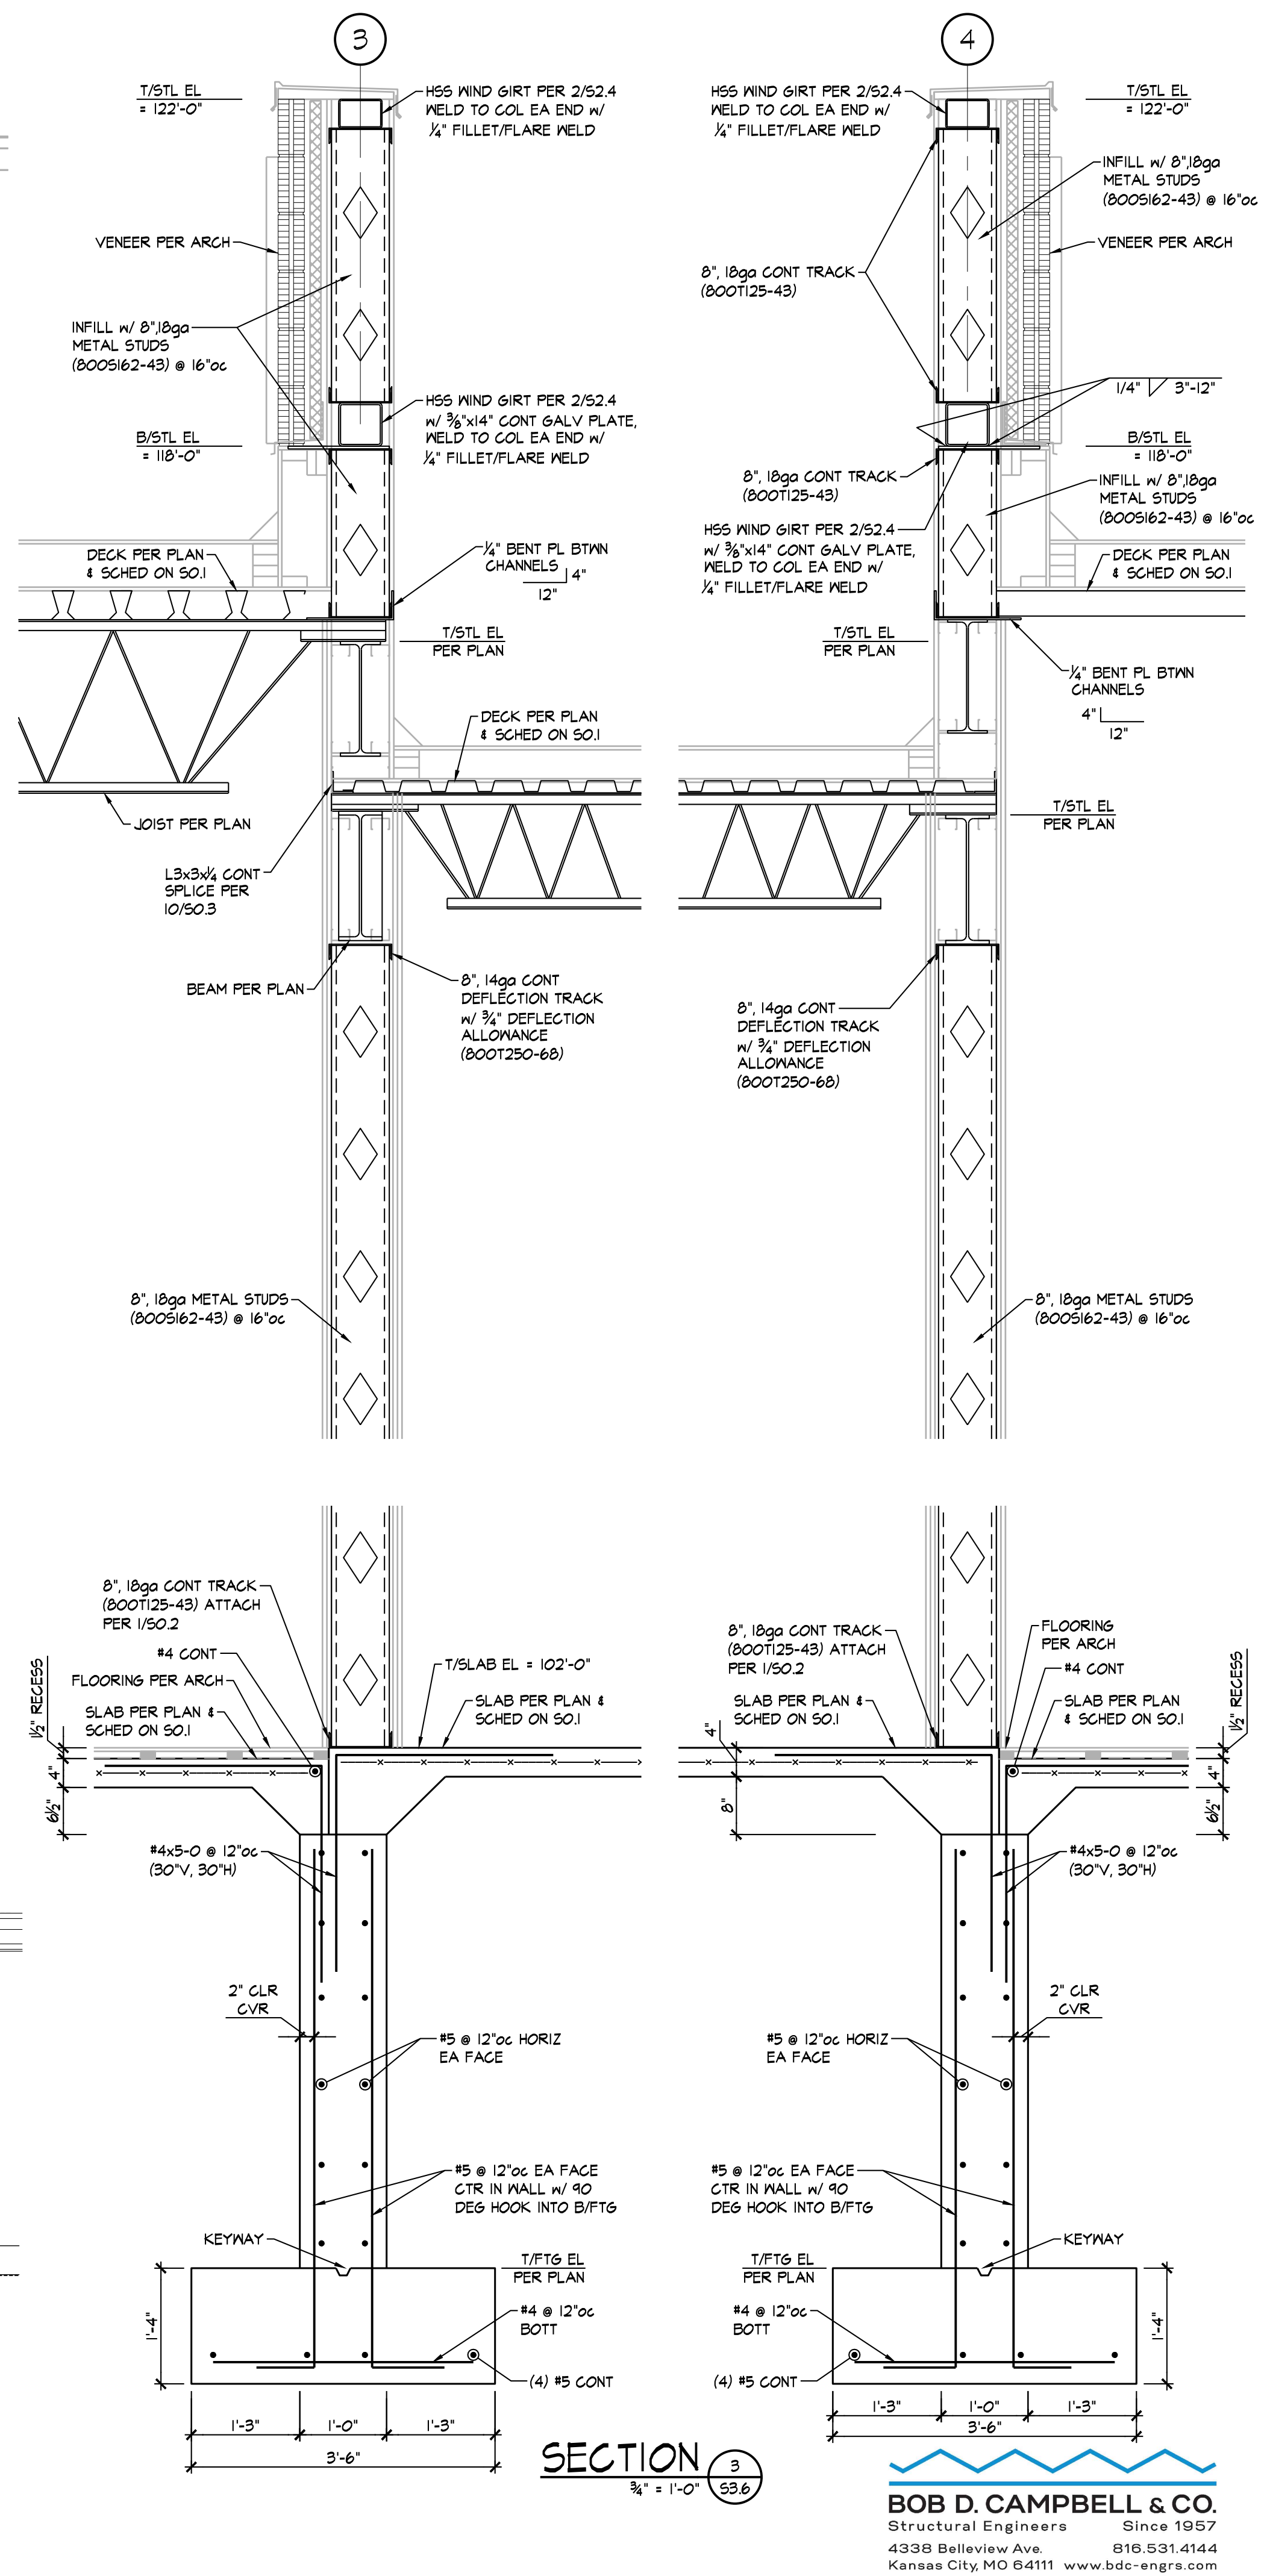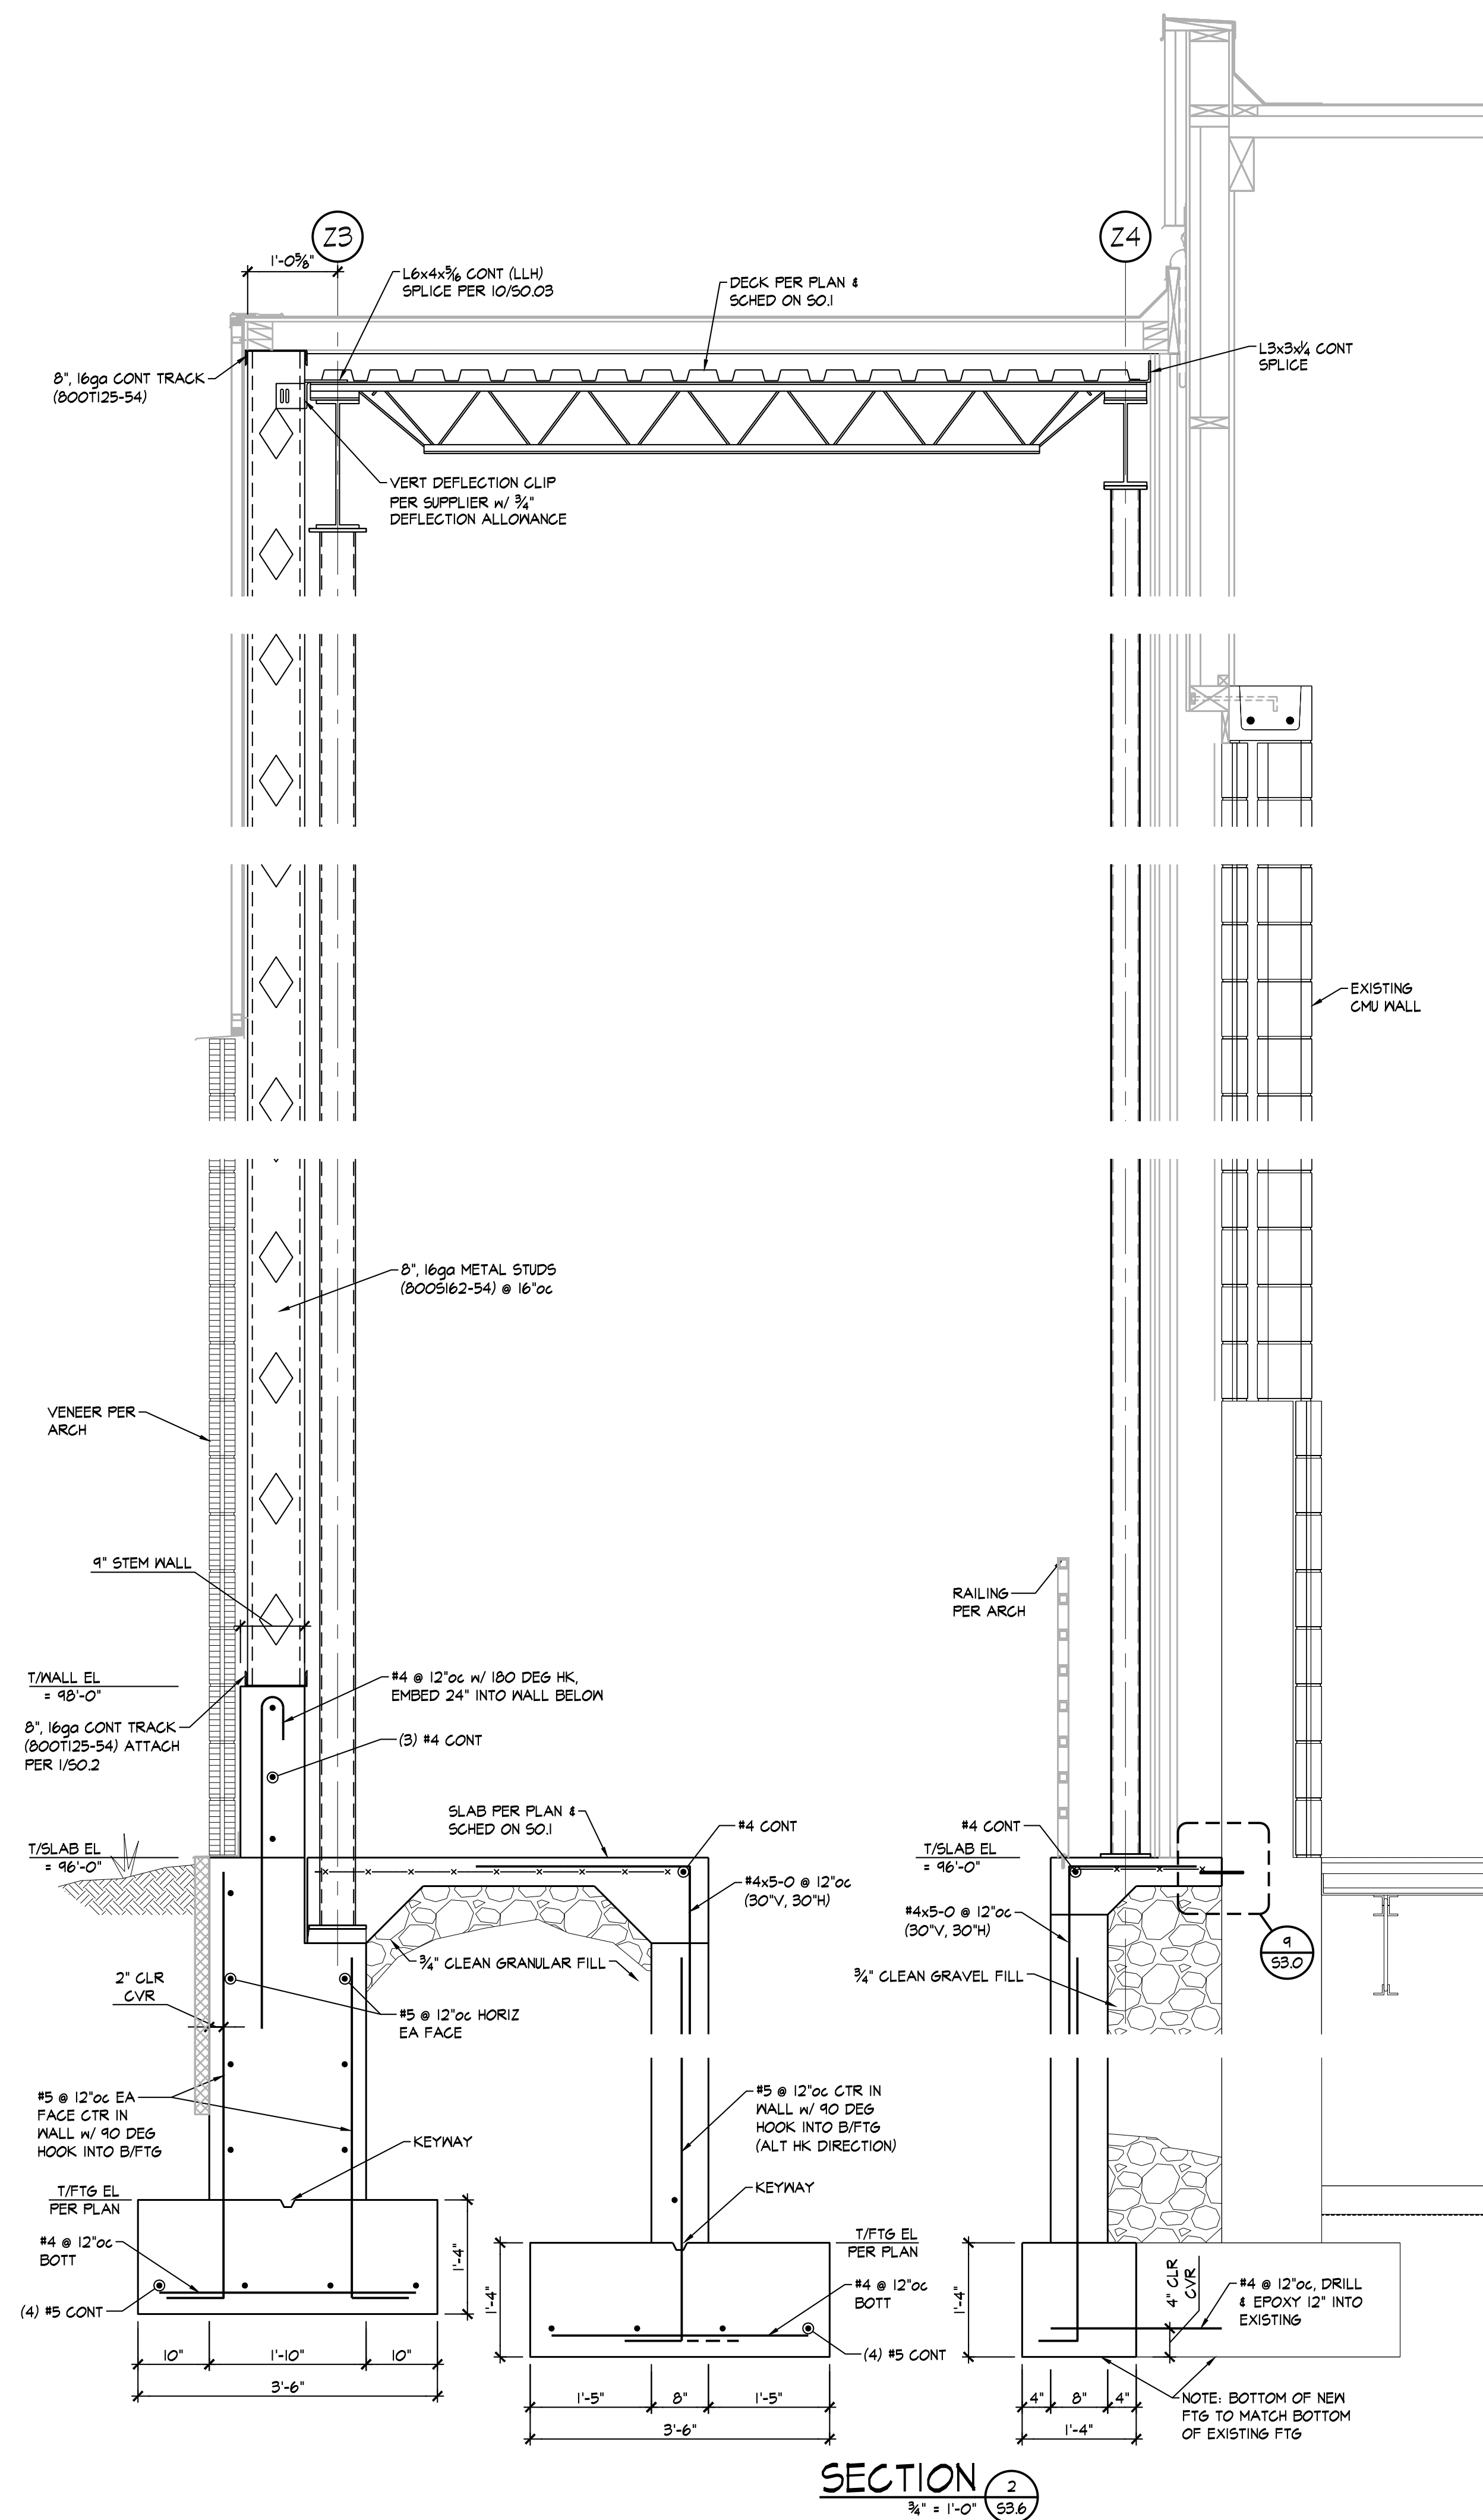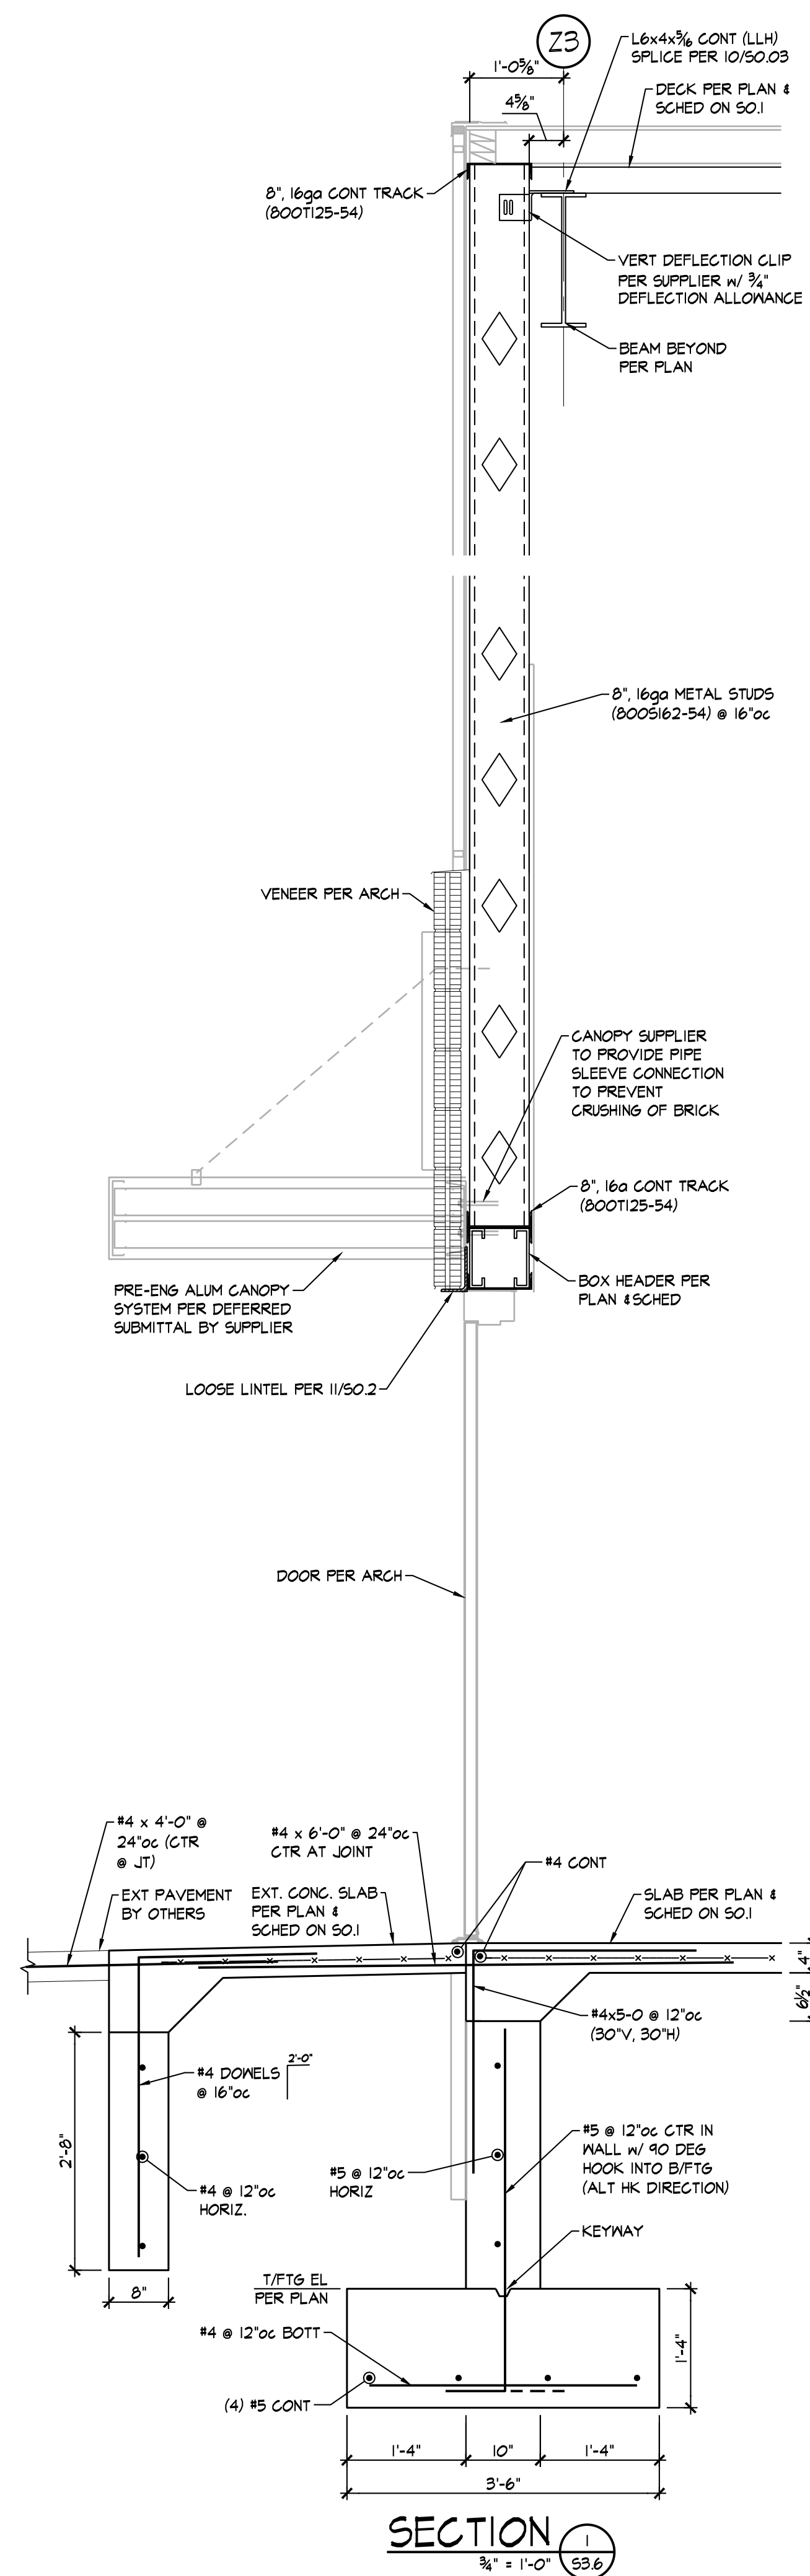

**JonesGillamRenz**  
730 N. Ninth 1881 Main Street, Suite 301  
Salina, KS 67401 Kansas City, MO 64108  
785.827.0386 jgr@jgrarchitects.com

SR

**THEATRE SALINA**  
DANCE STUDIOS & SCENE SHOP EXPANSION  
SALINA, KANSAS



REVISION:

DATE: 9-18-2026

JOB: 22-3239

SHEET NO.:





### S3.6

COPYRIGHTED ©







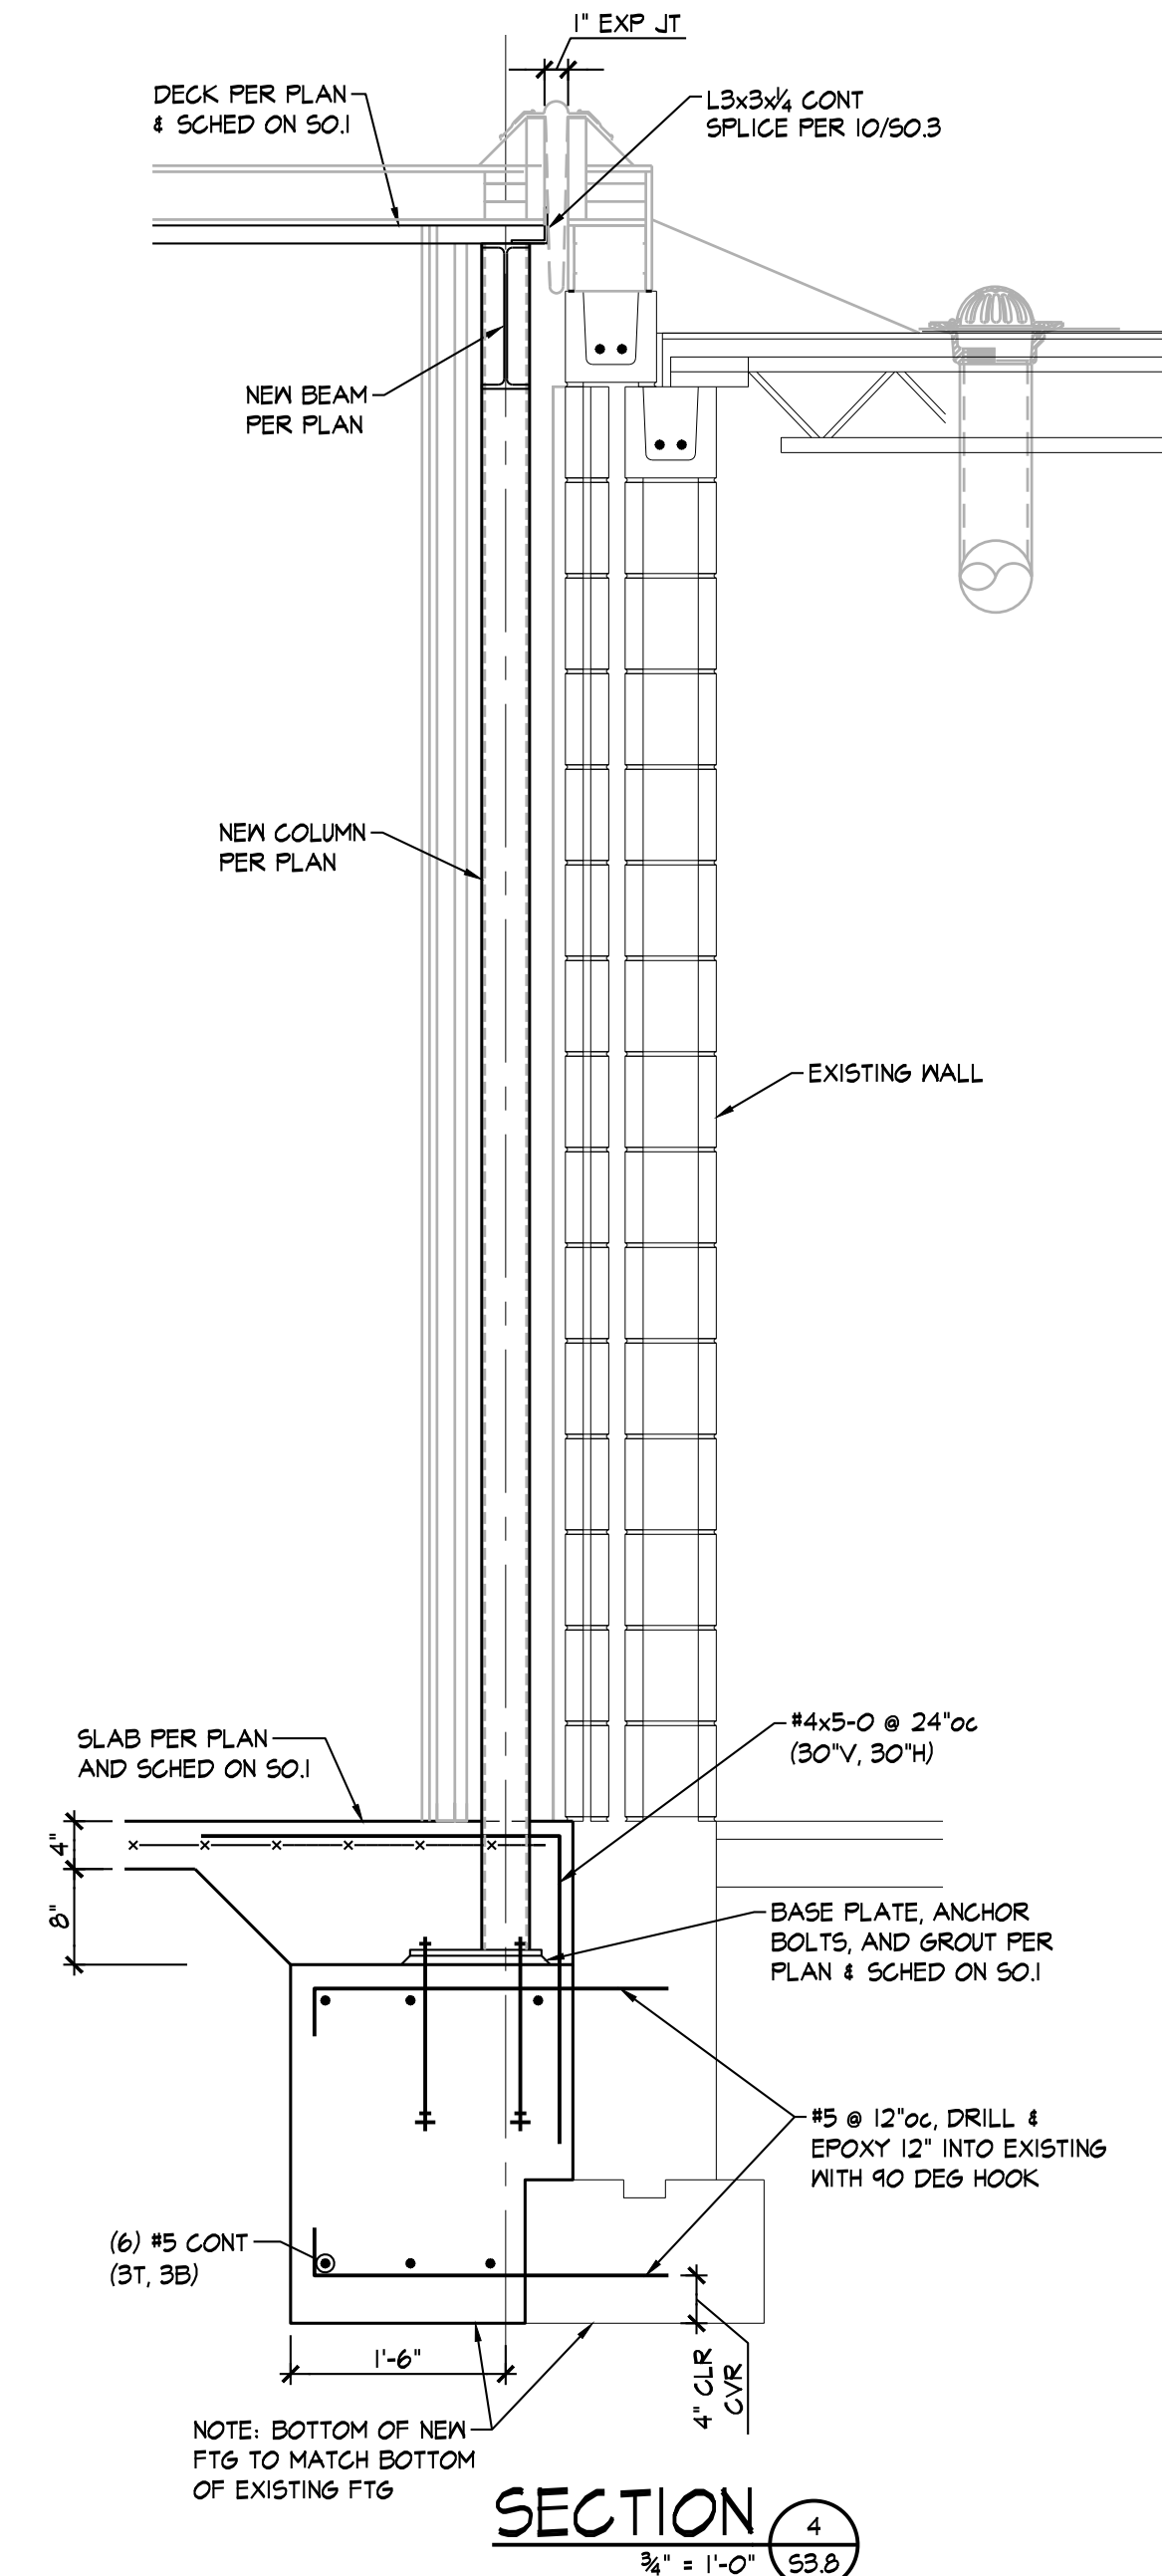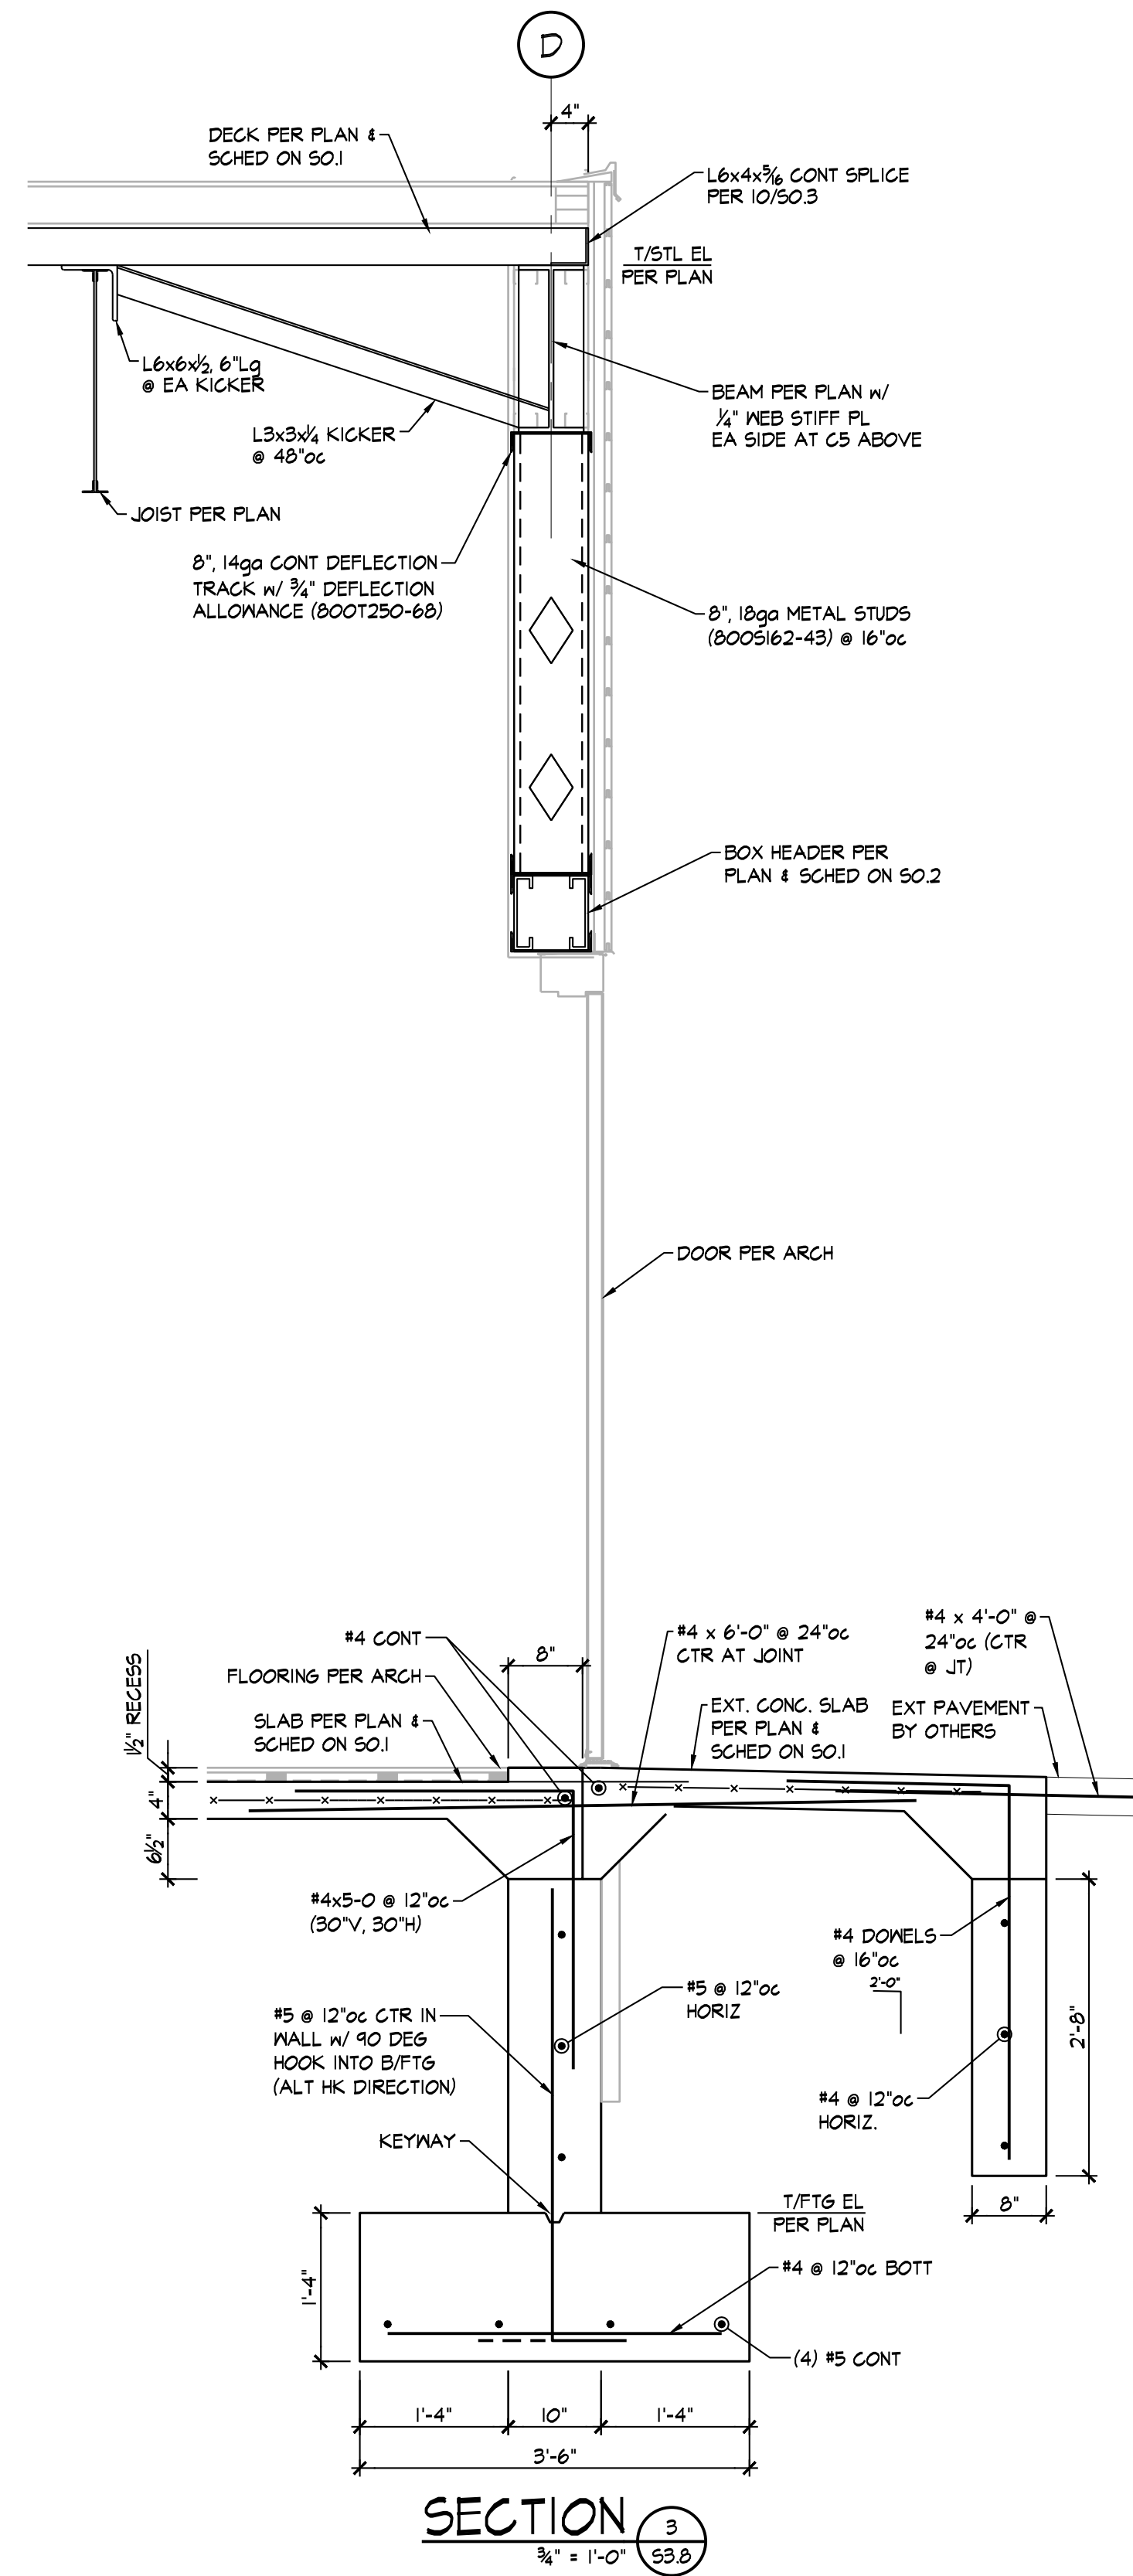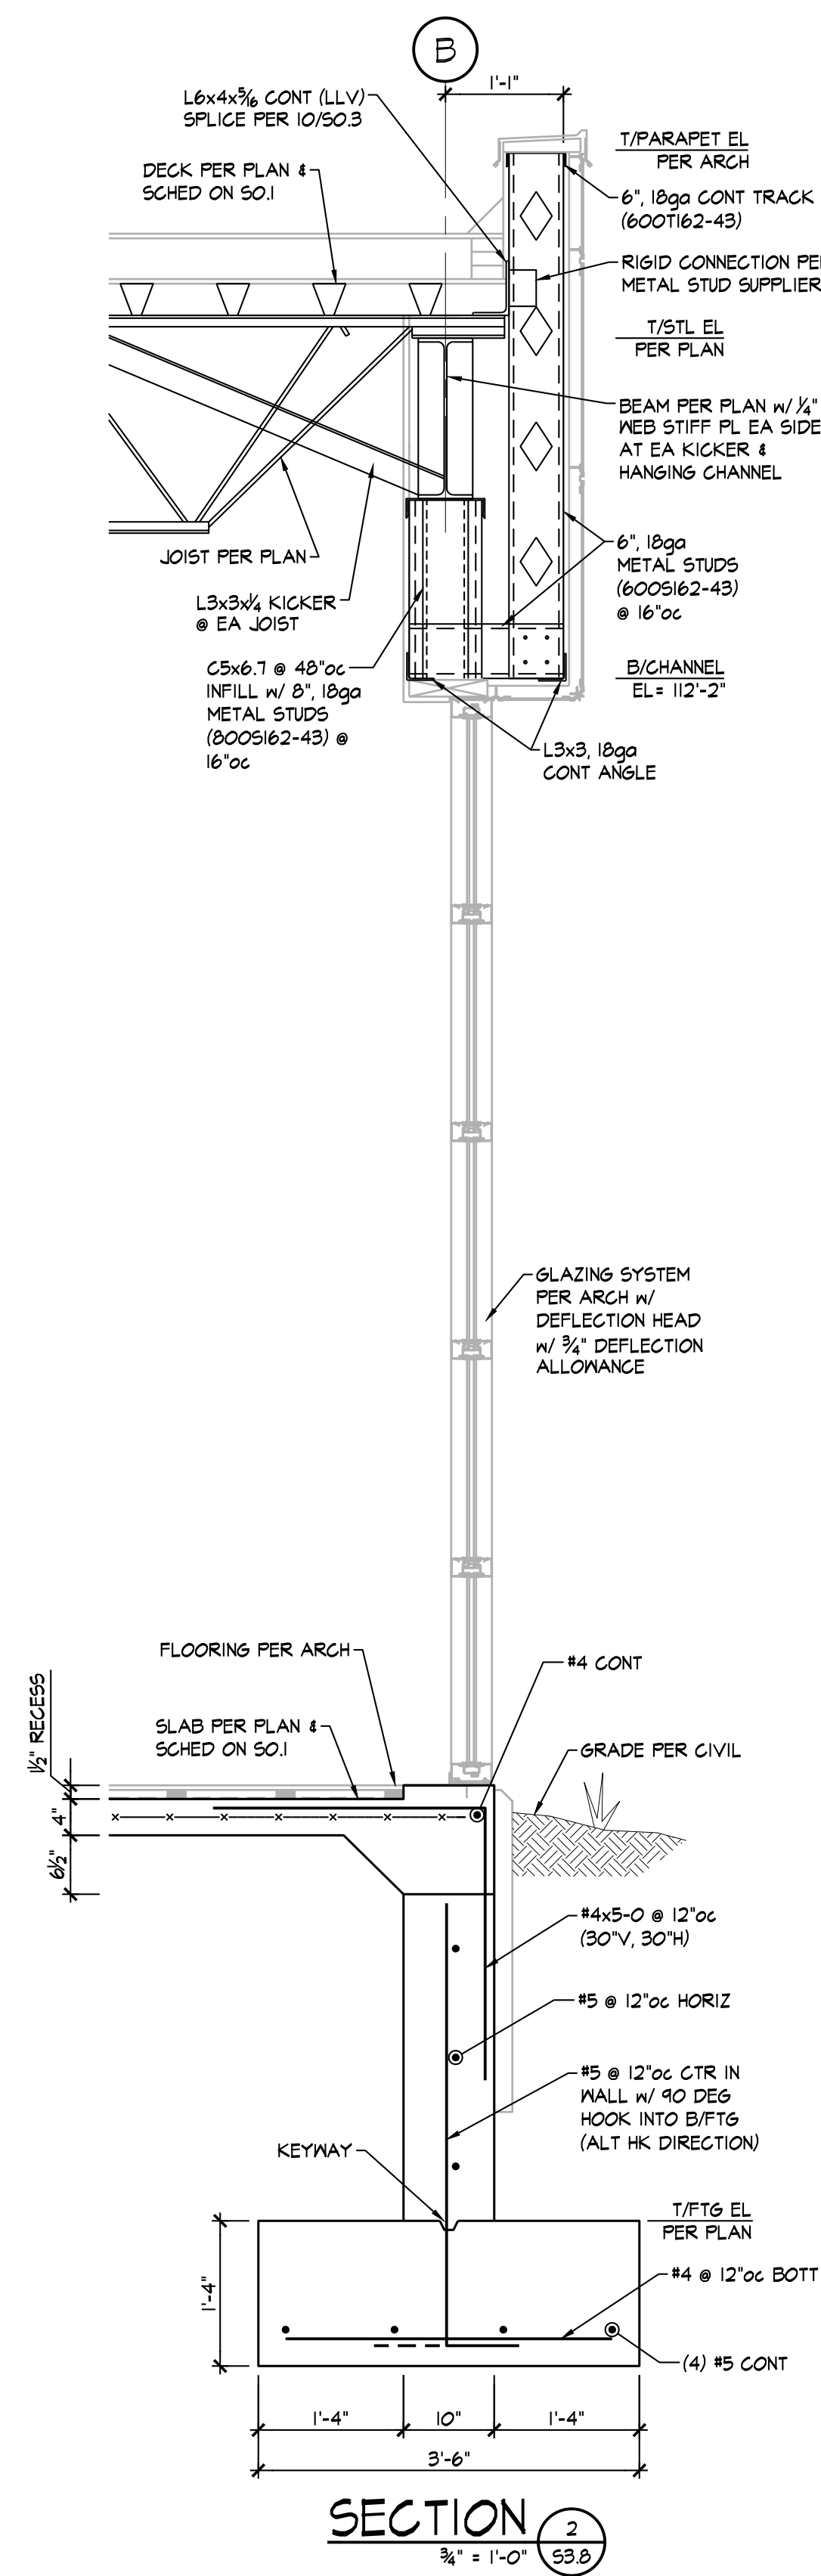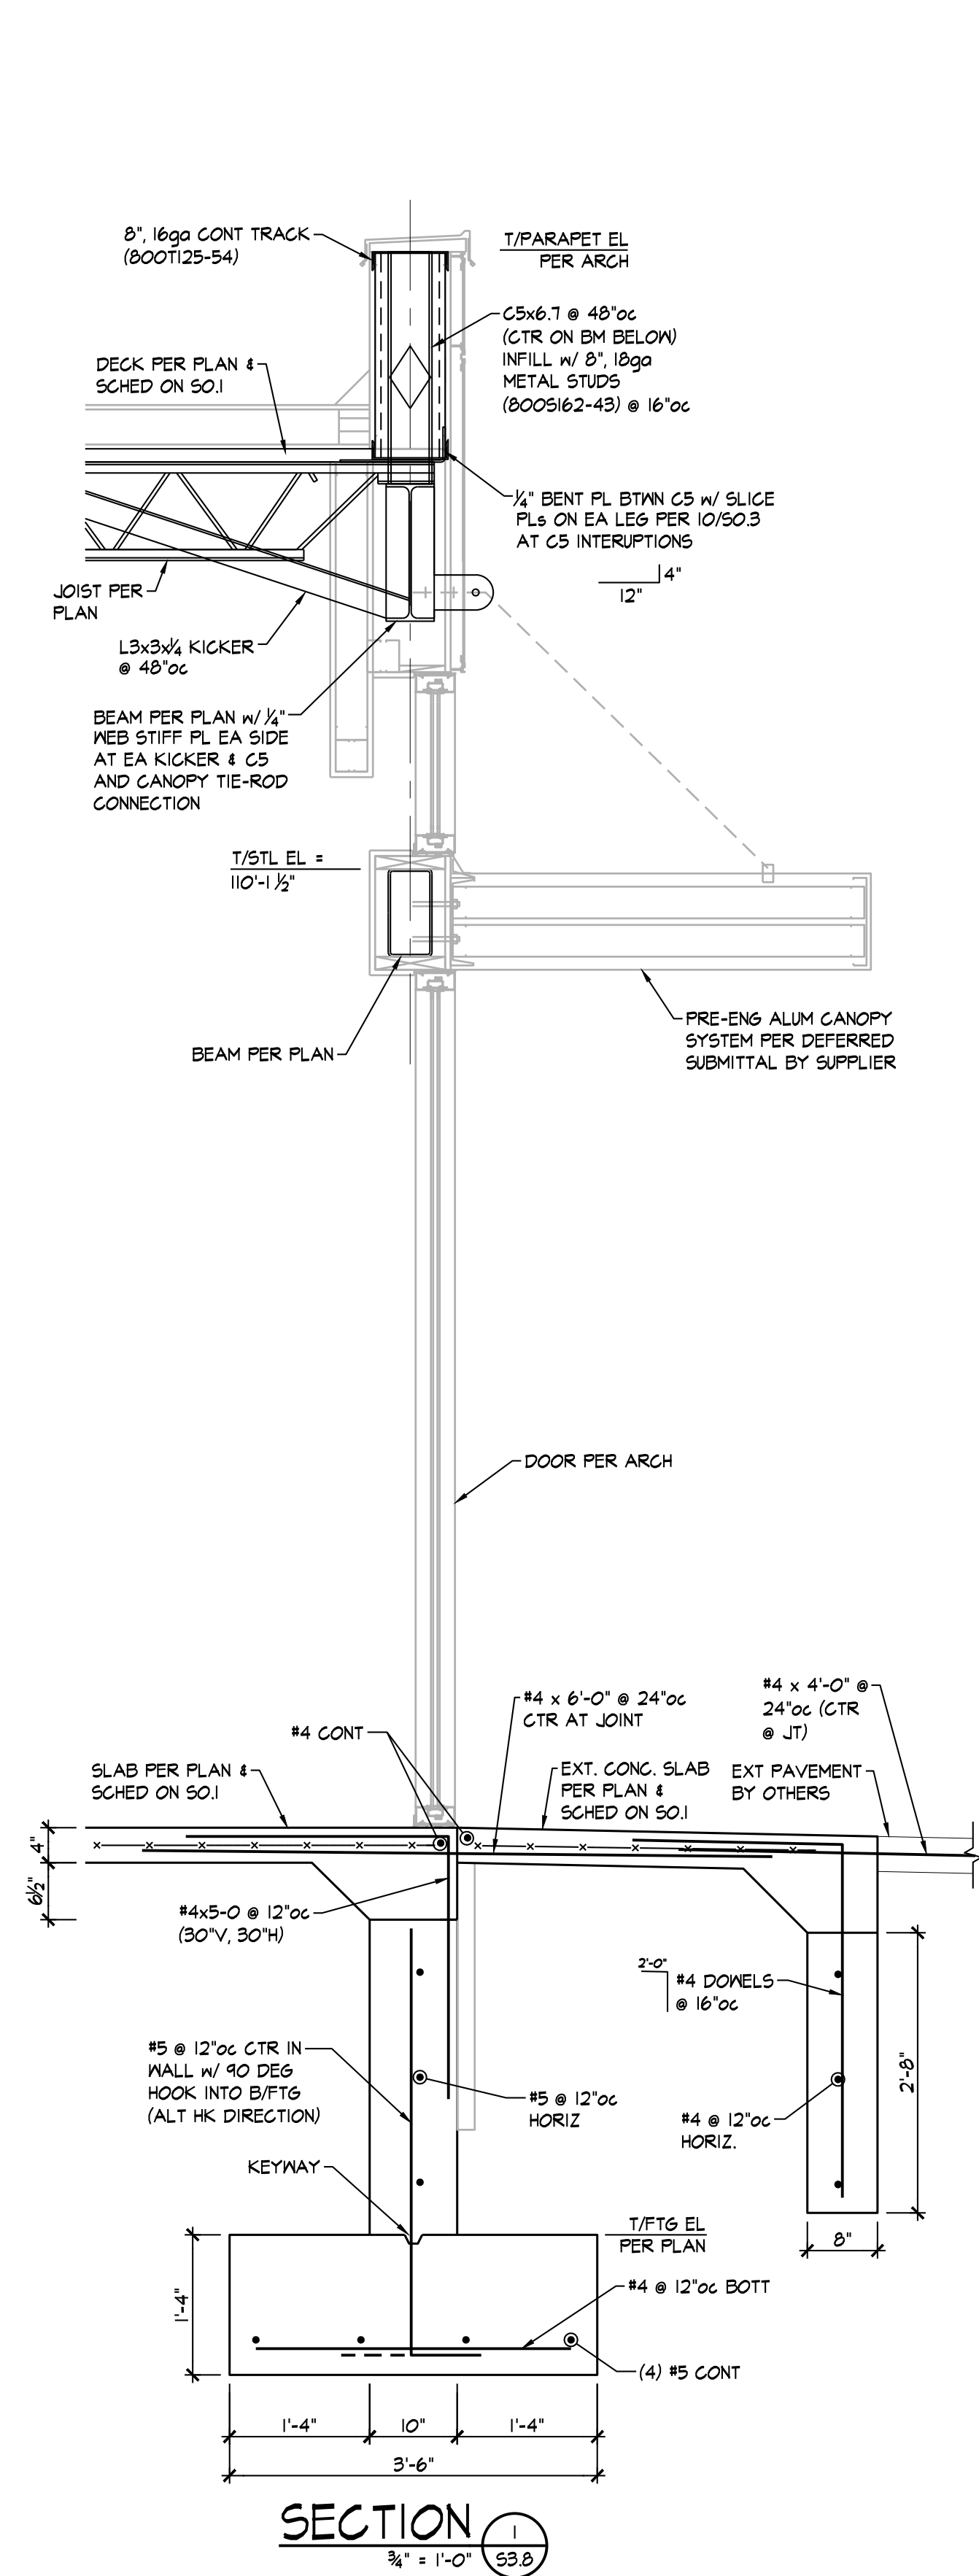














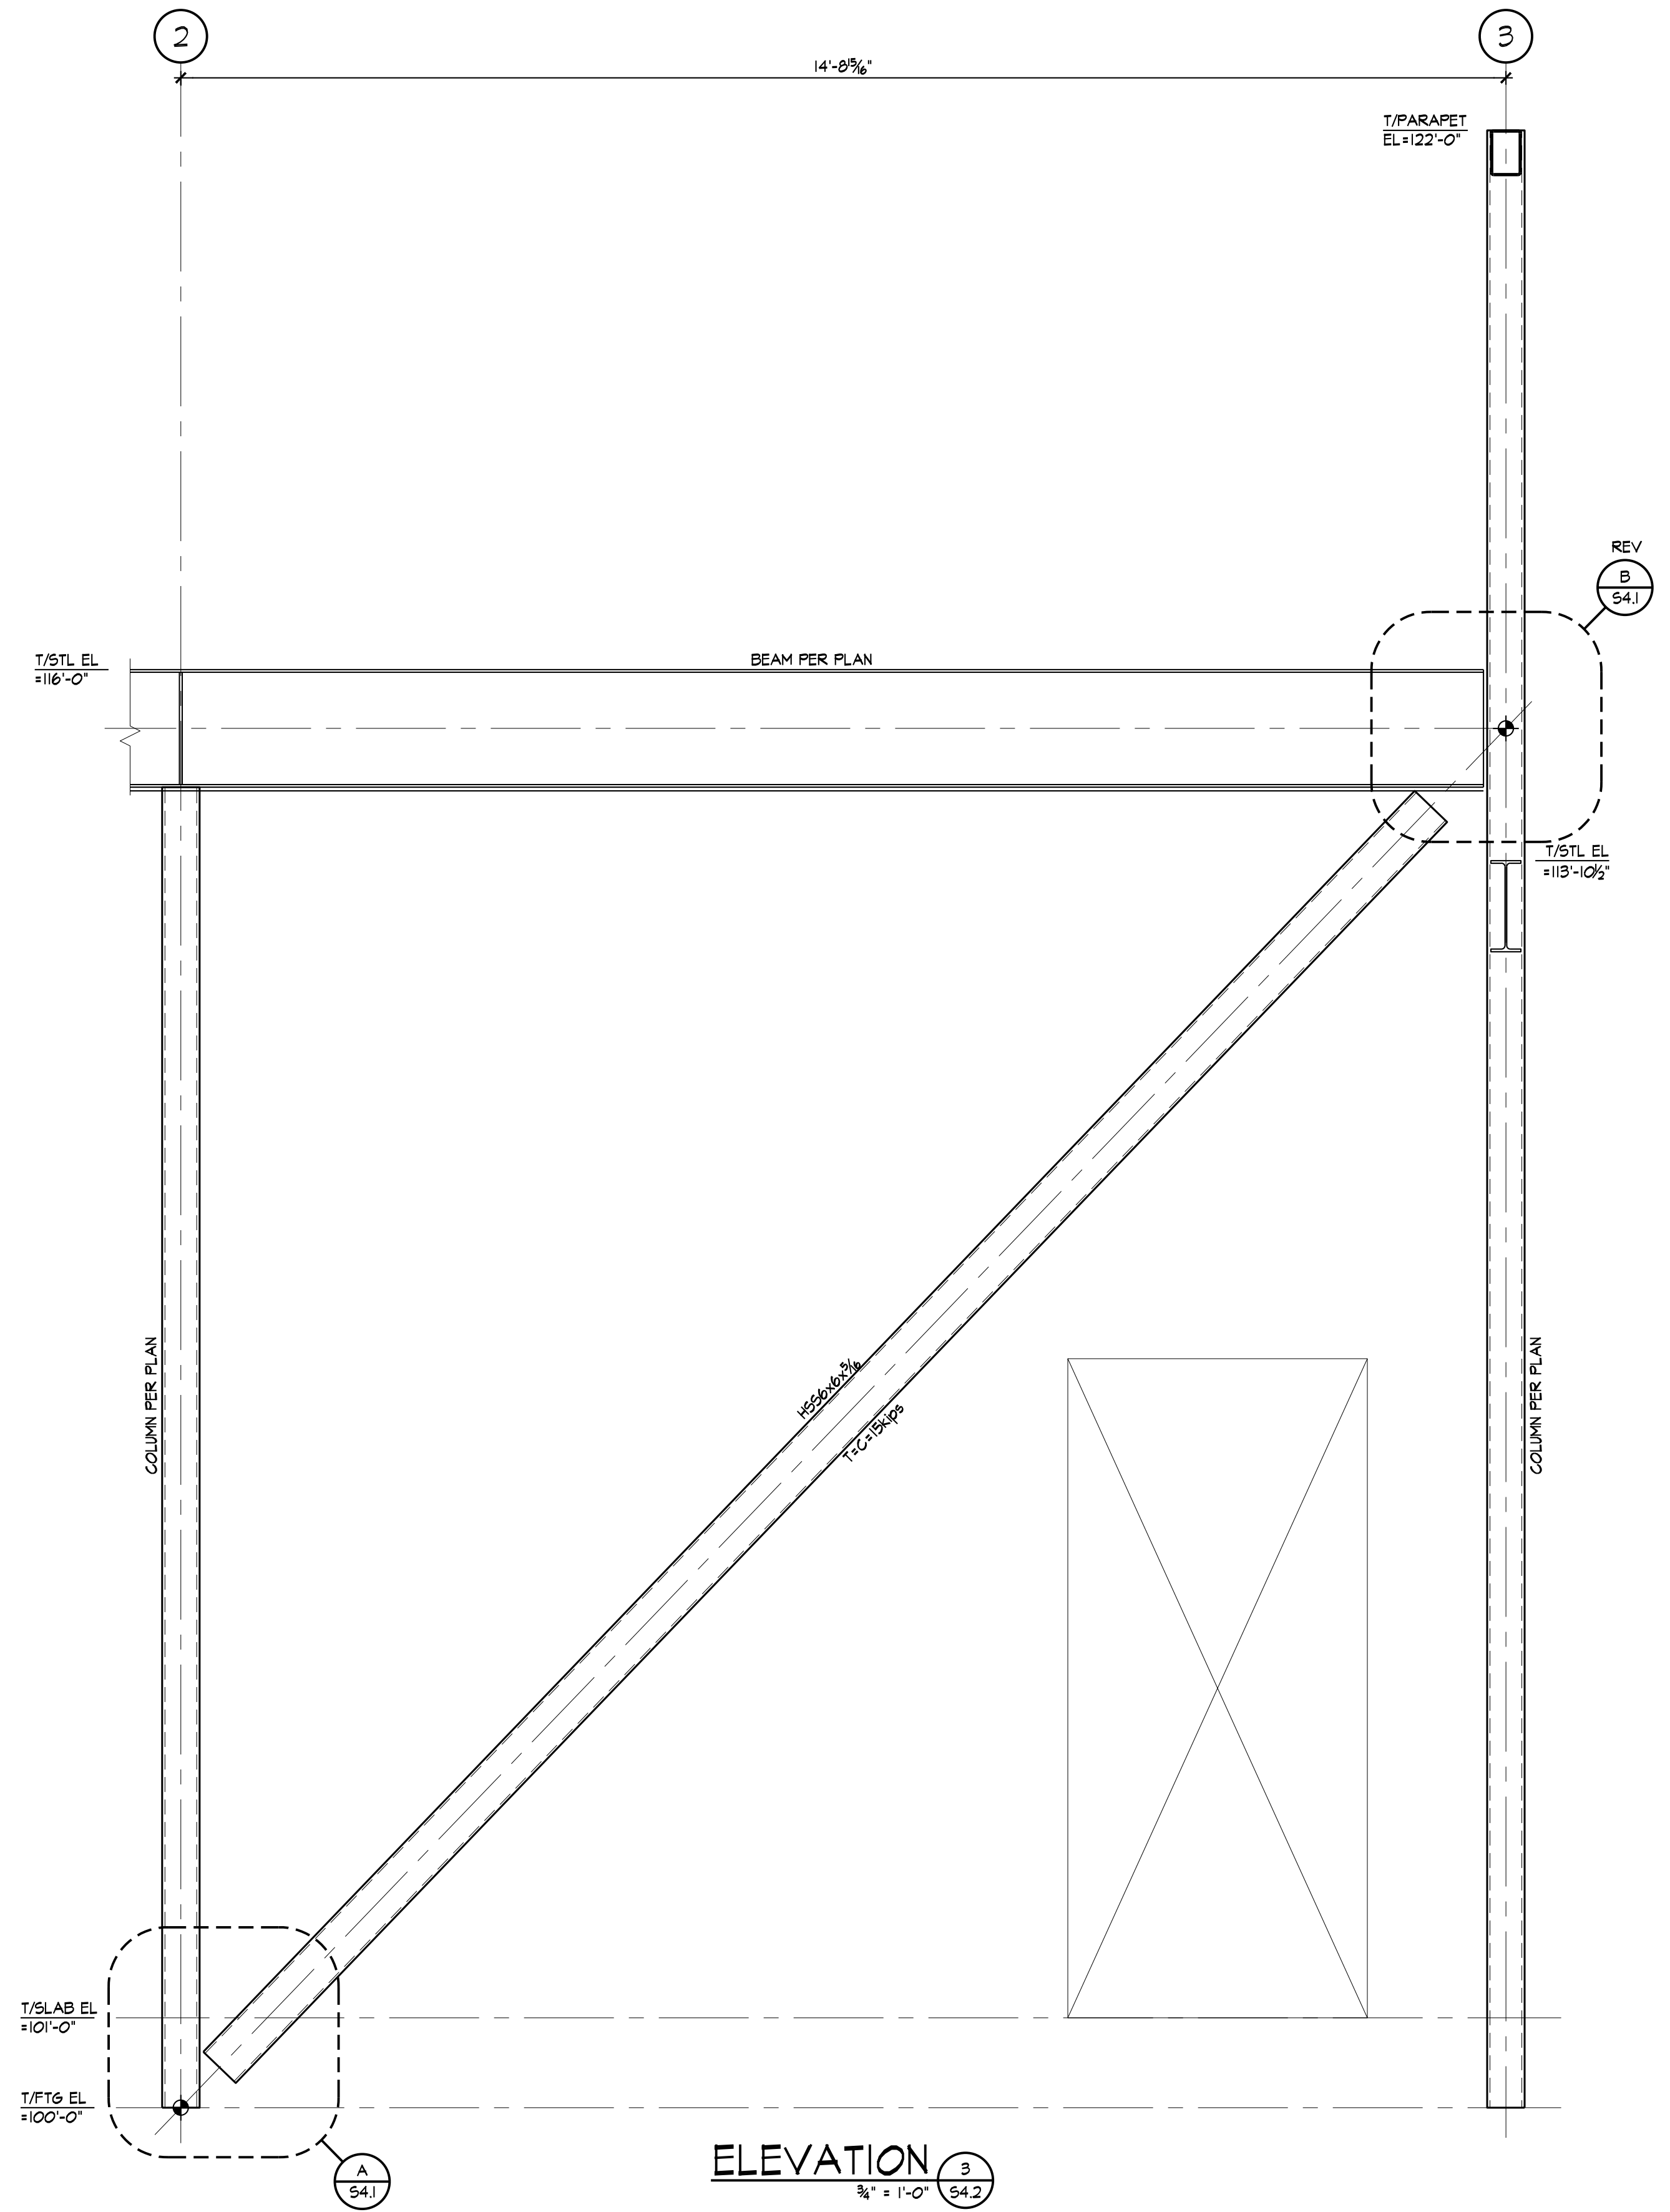



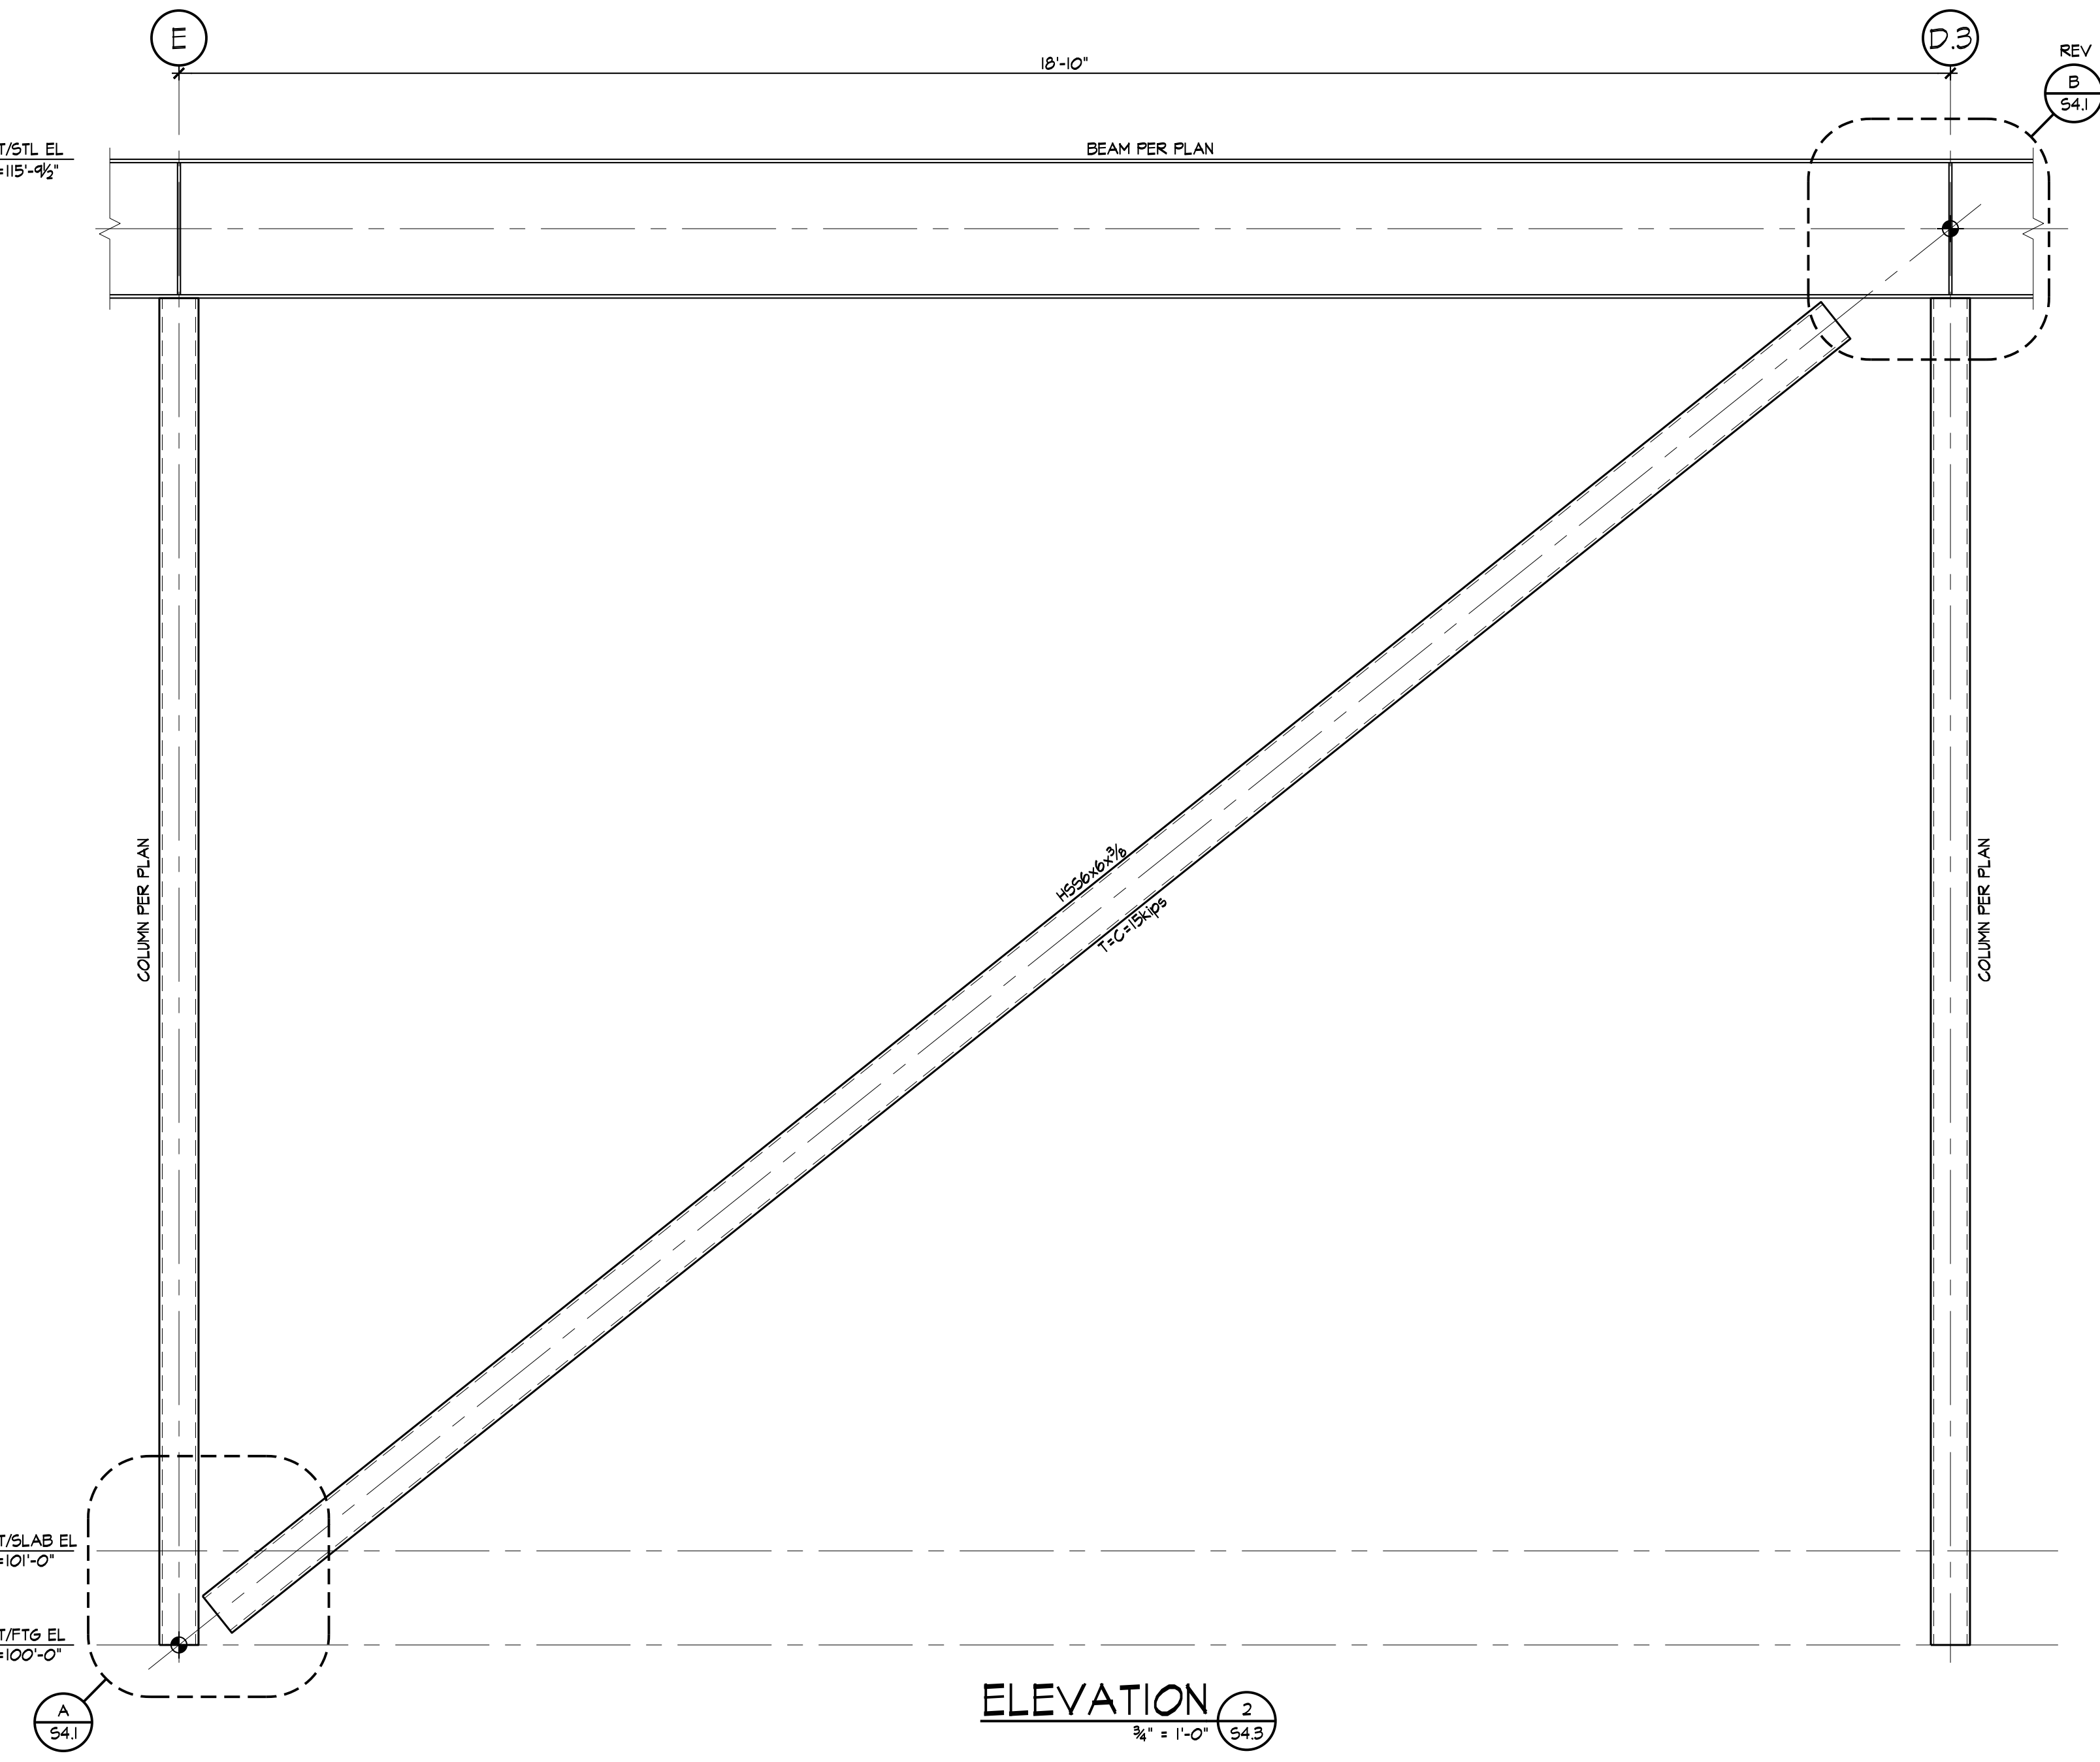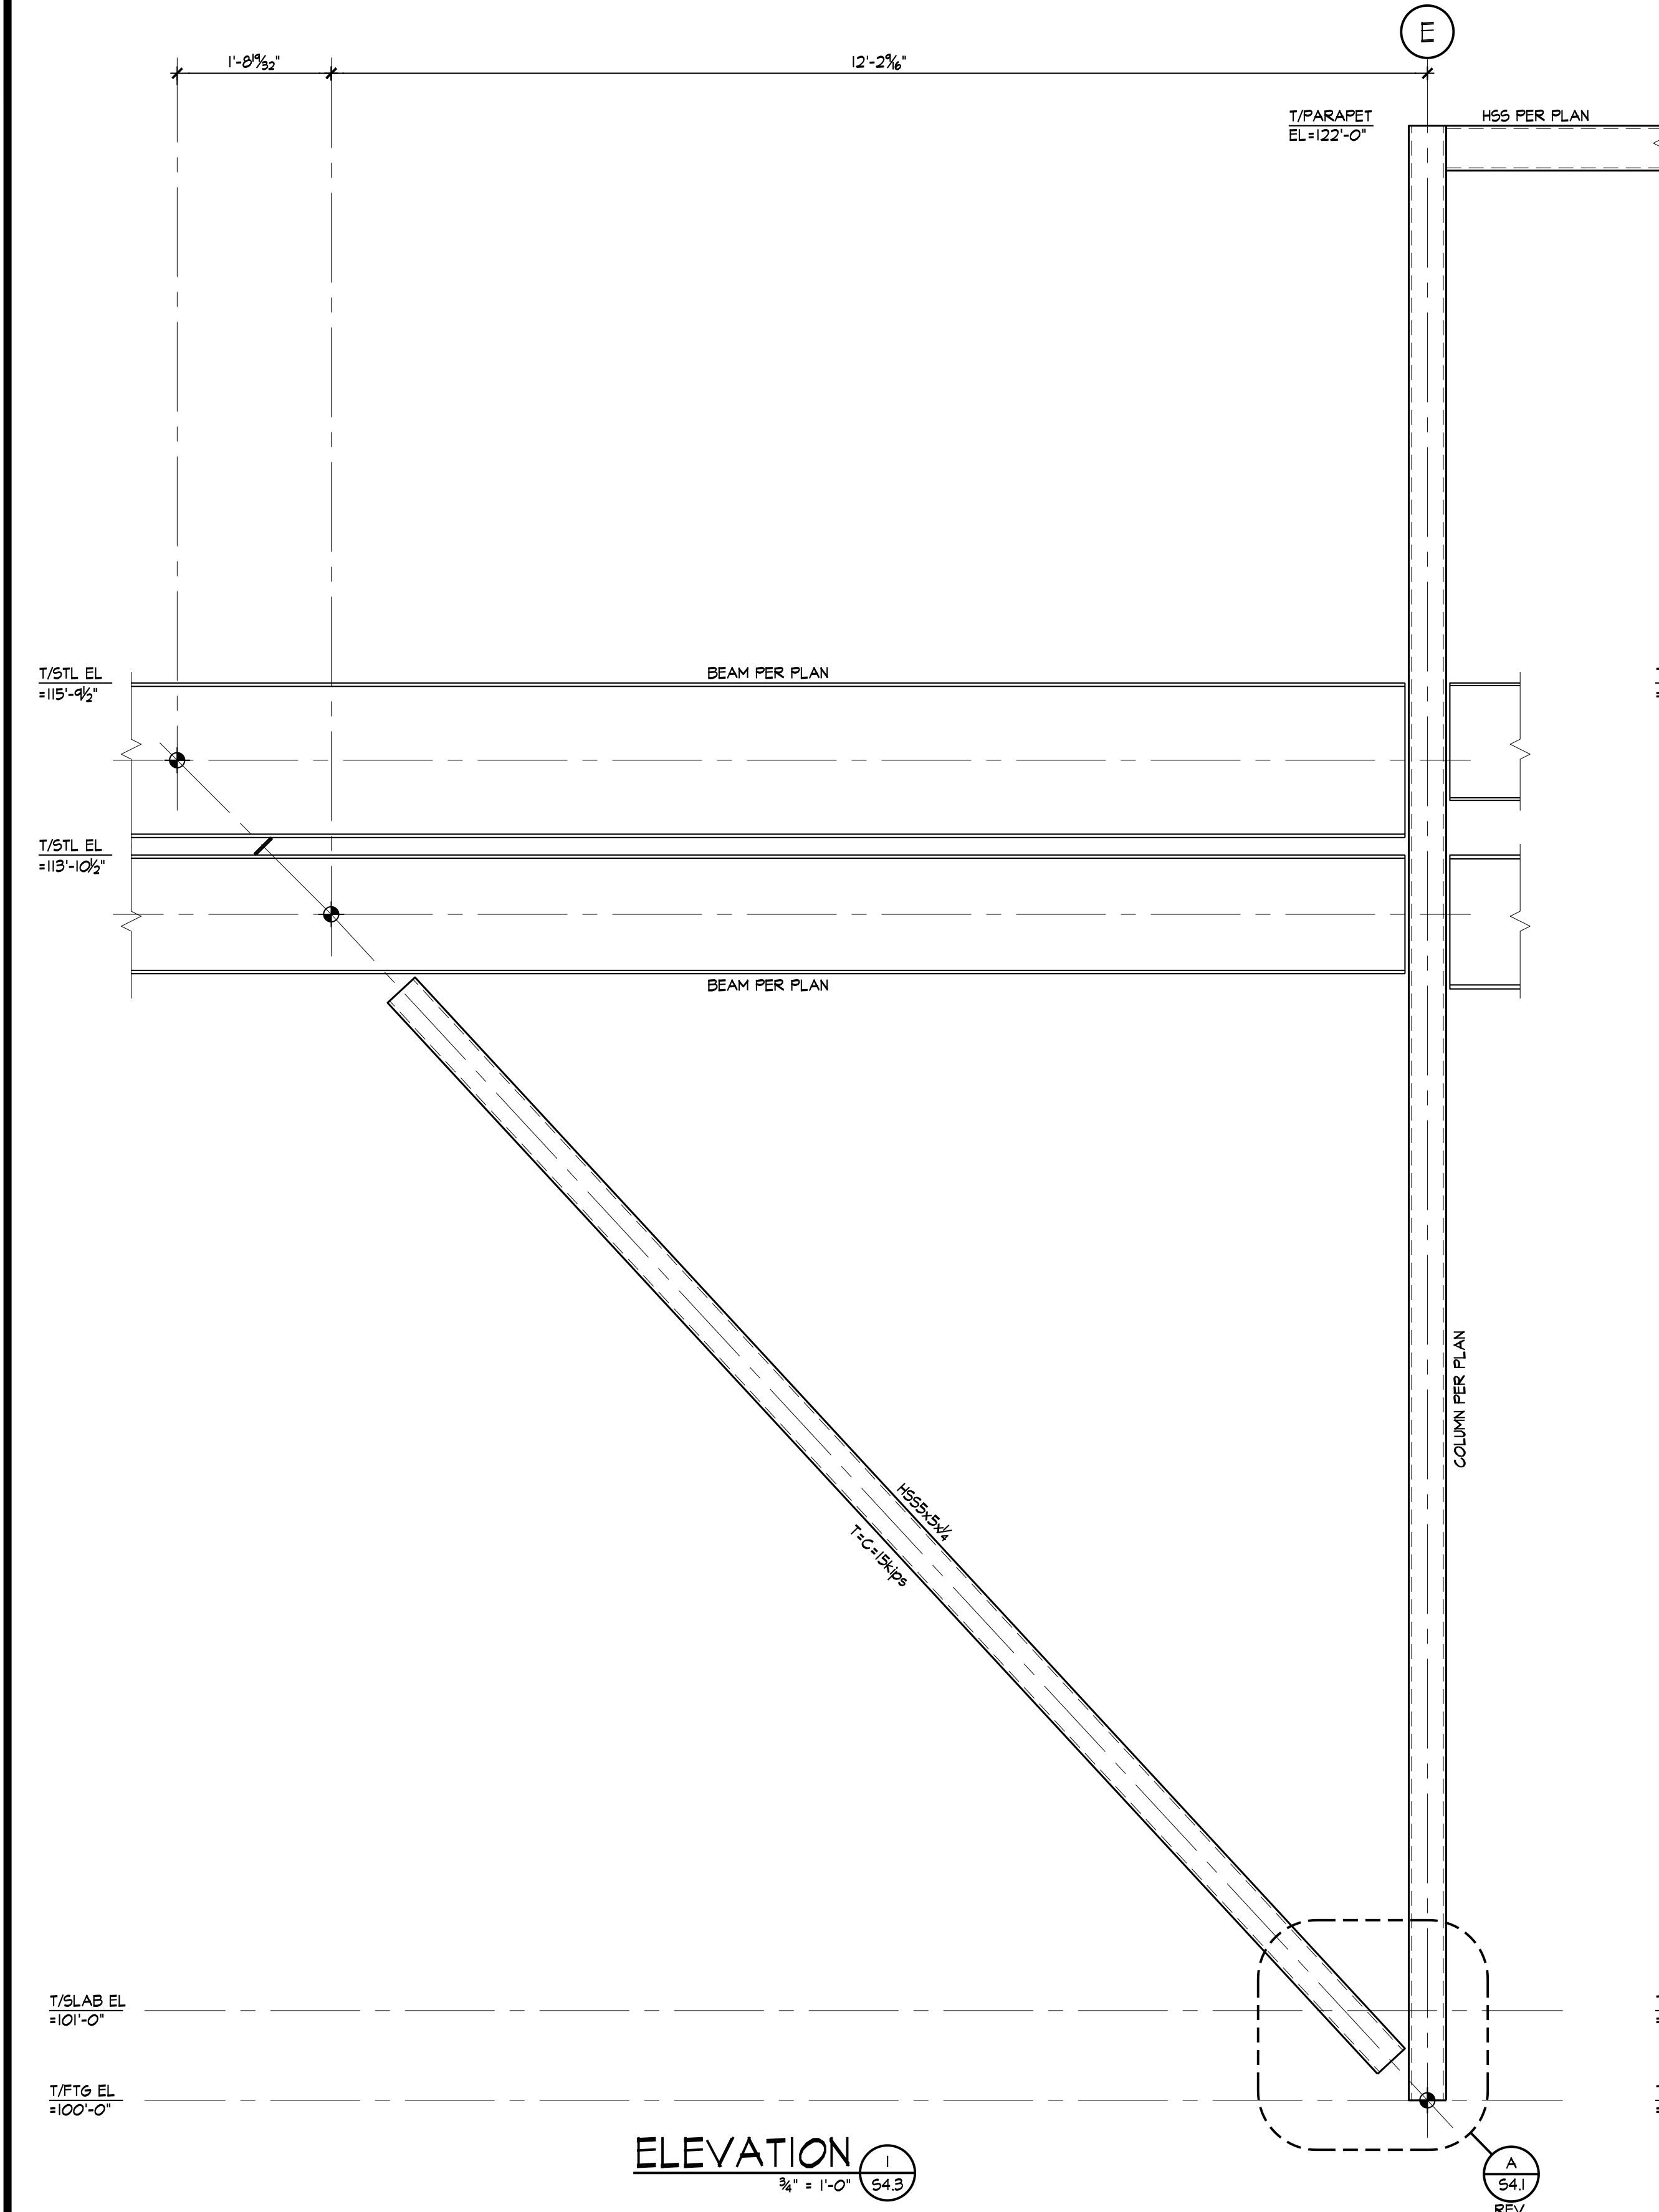

**BOB D. CAMPBELL & CO.**  
Structural Engineers Since 1957  
4338 Belleview Ave. 816.531.4144  
Kansas City, MO 64111 www.bdc-engrs.com

**THEATRE SALINA**  
DANCE STUDIOS & SCENE SHOP EXPANSION  
SALINA, KANSAS





REVISION:	
DATE:	9-18-2026
JOB:	22-3239
SHEET NO.:	

**S4.3**



**JGR**  
**JonesGillamRenz**  
730 N. Ninth 1881 Main Street, Suite 301  
Salina, KS 67401 Kansas City, MO 64108  
785.827.0386 jgr@jgarchitects.com

COPYRIGHTED ©



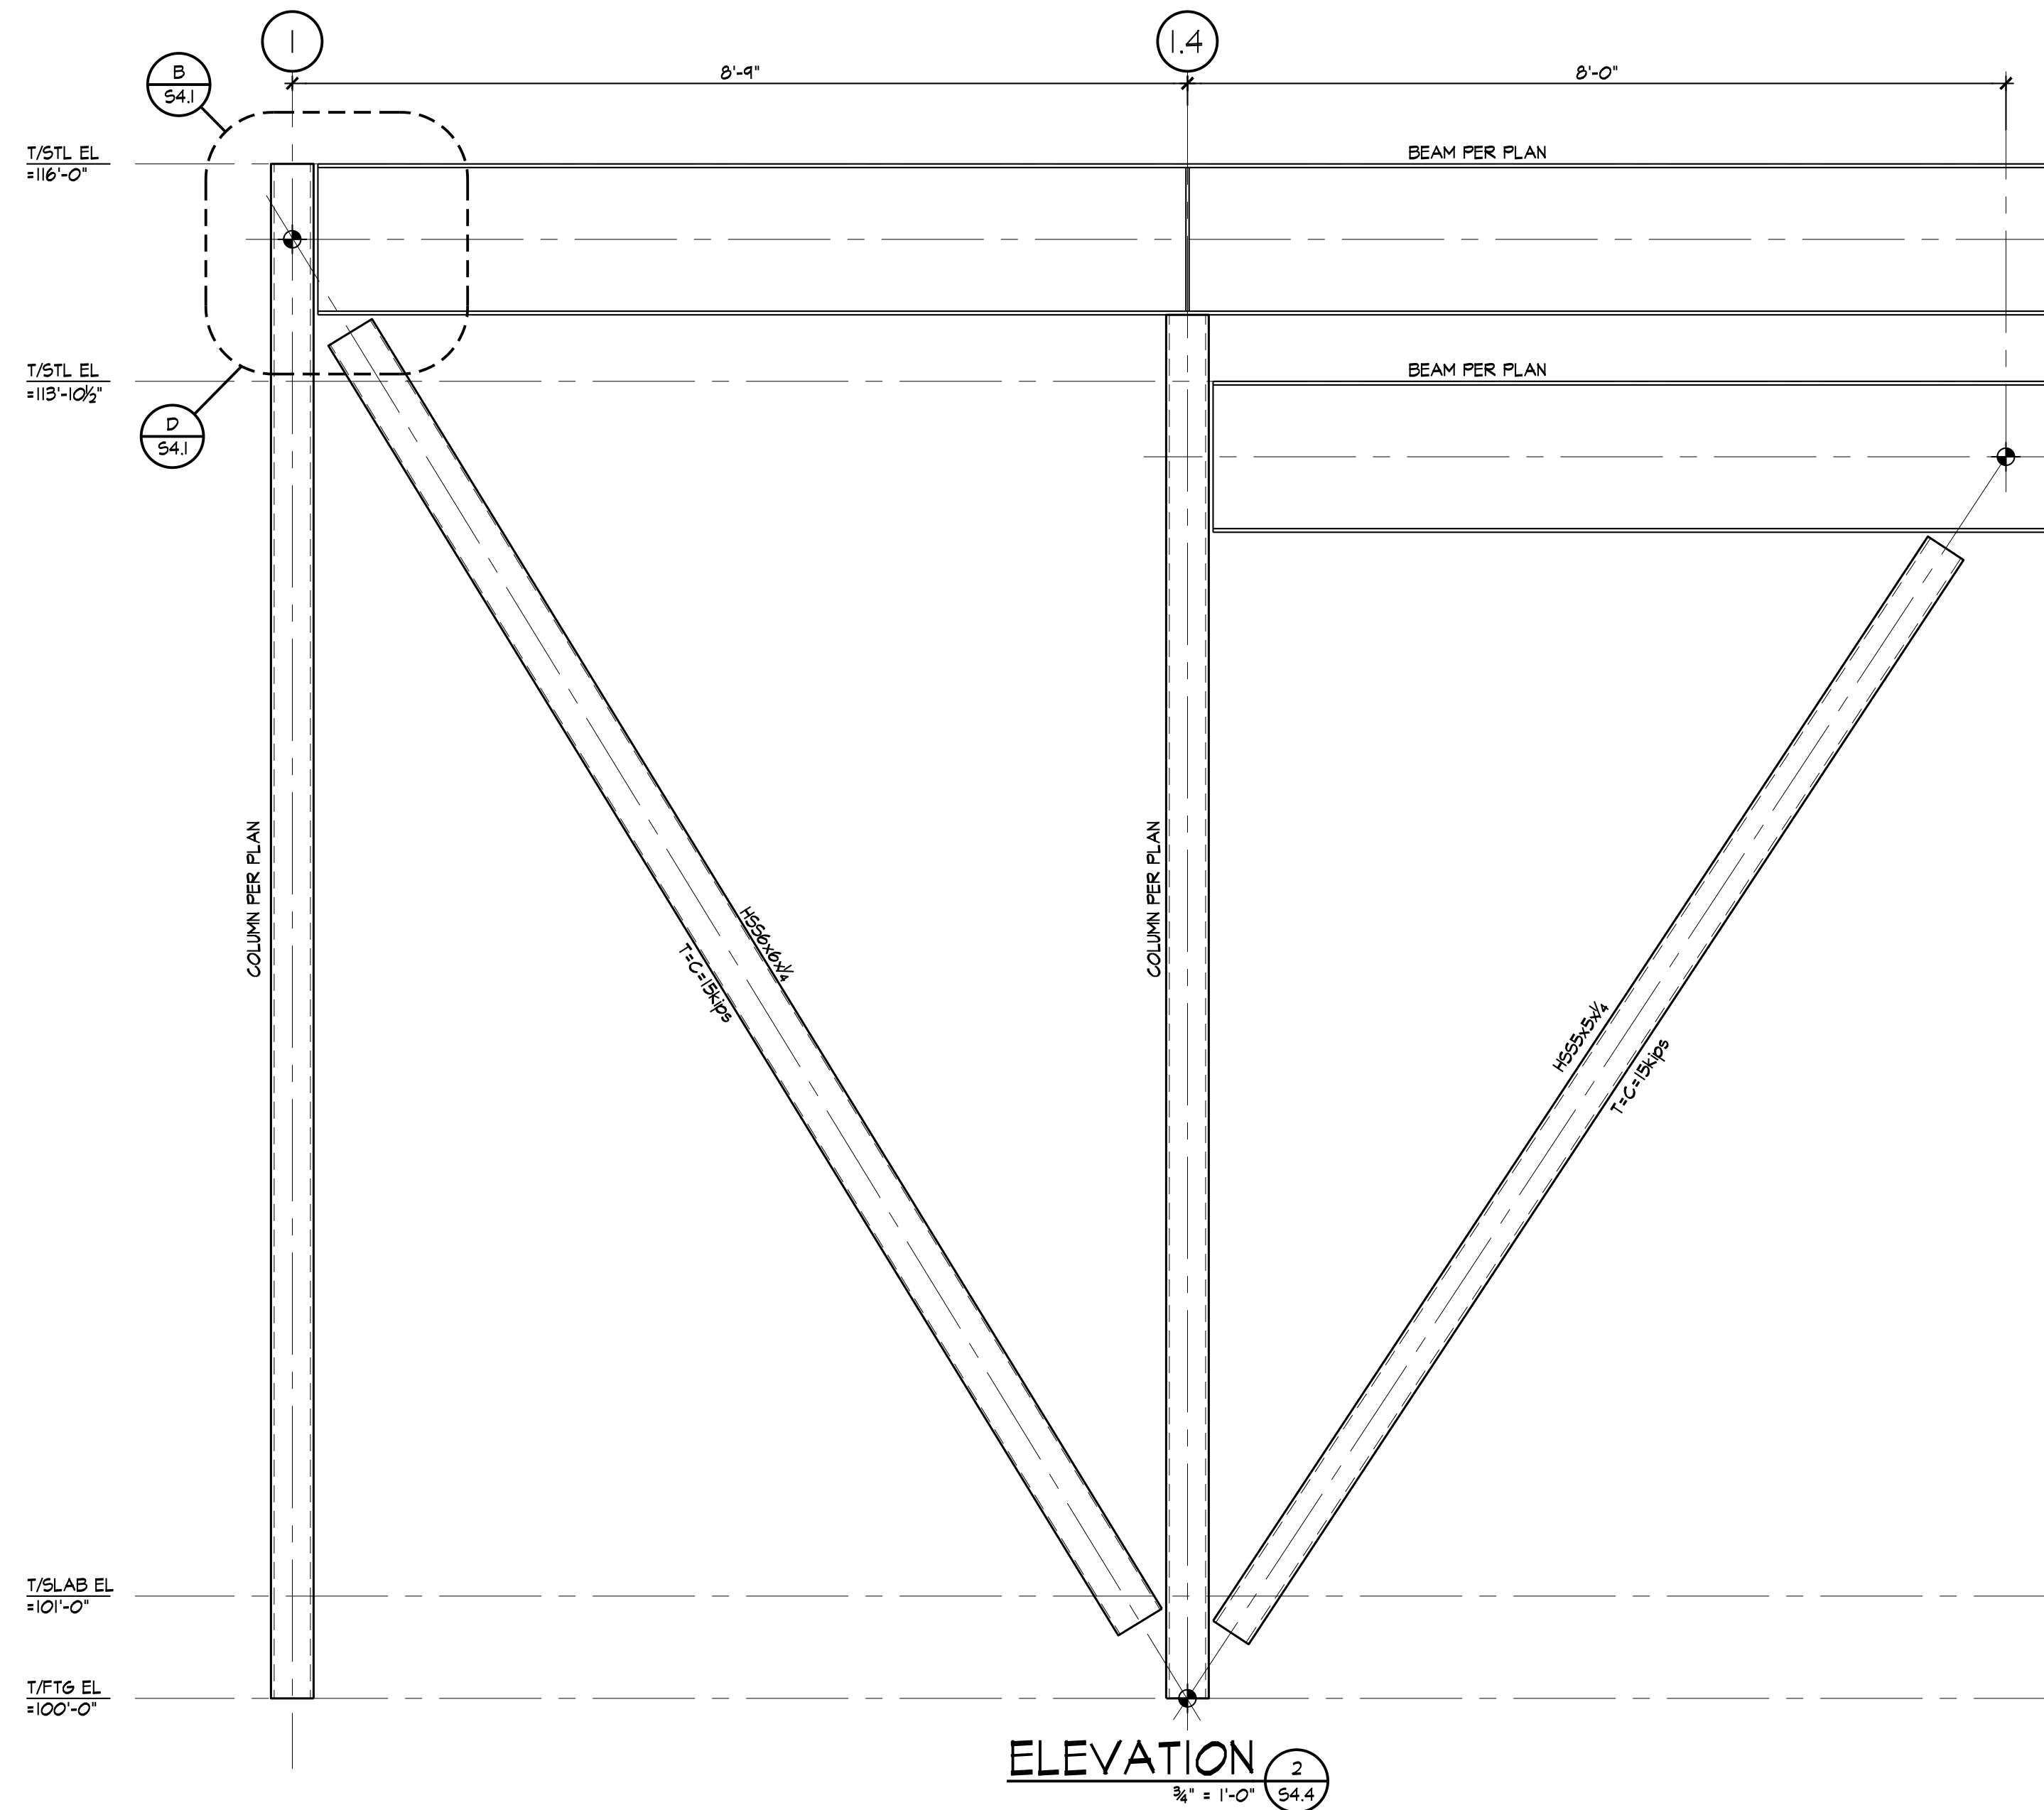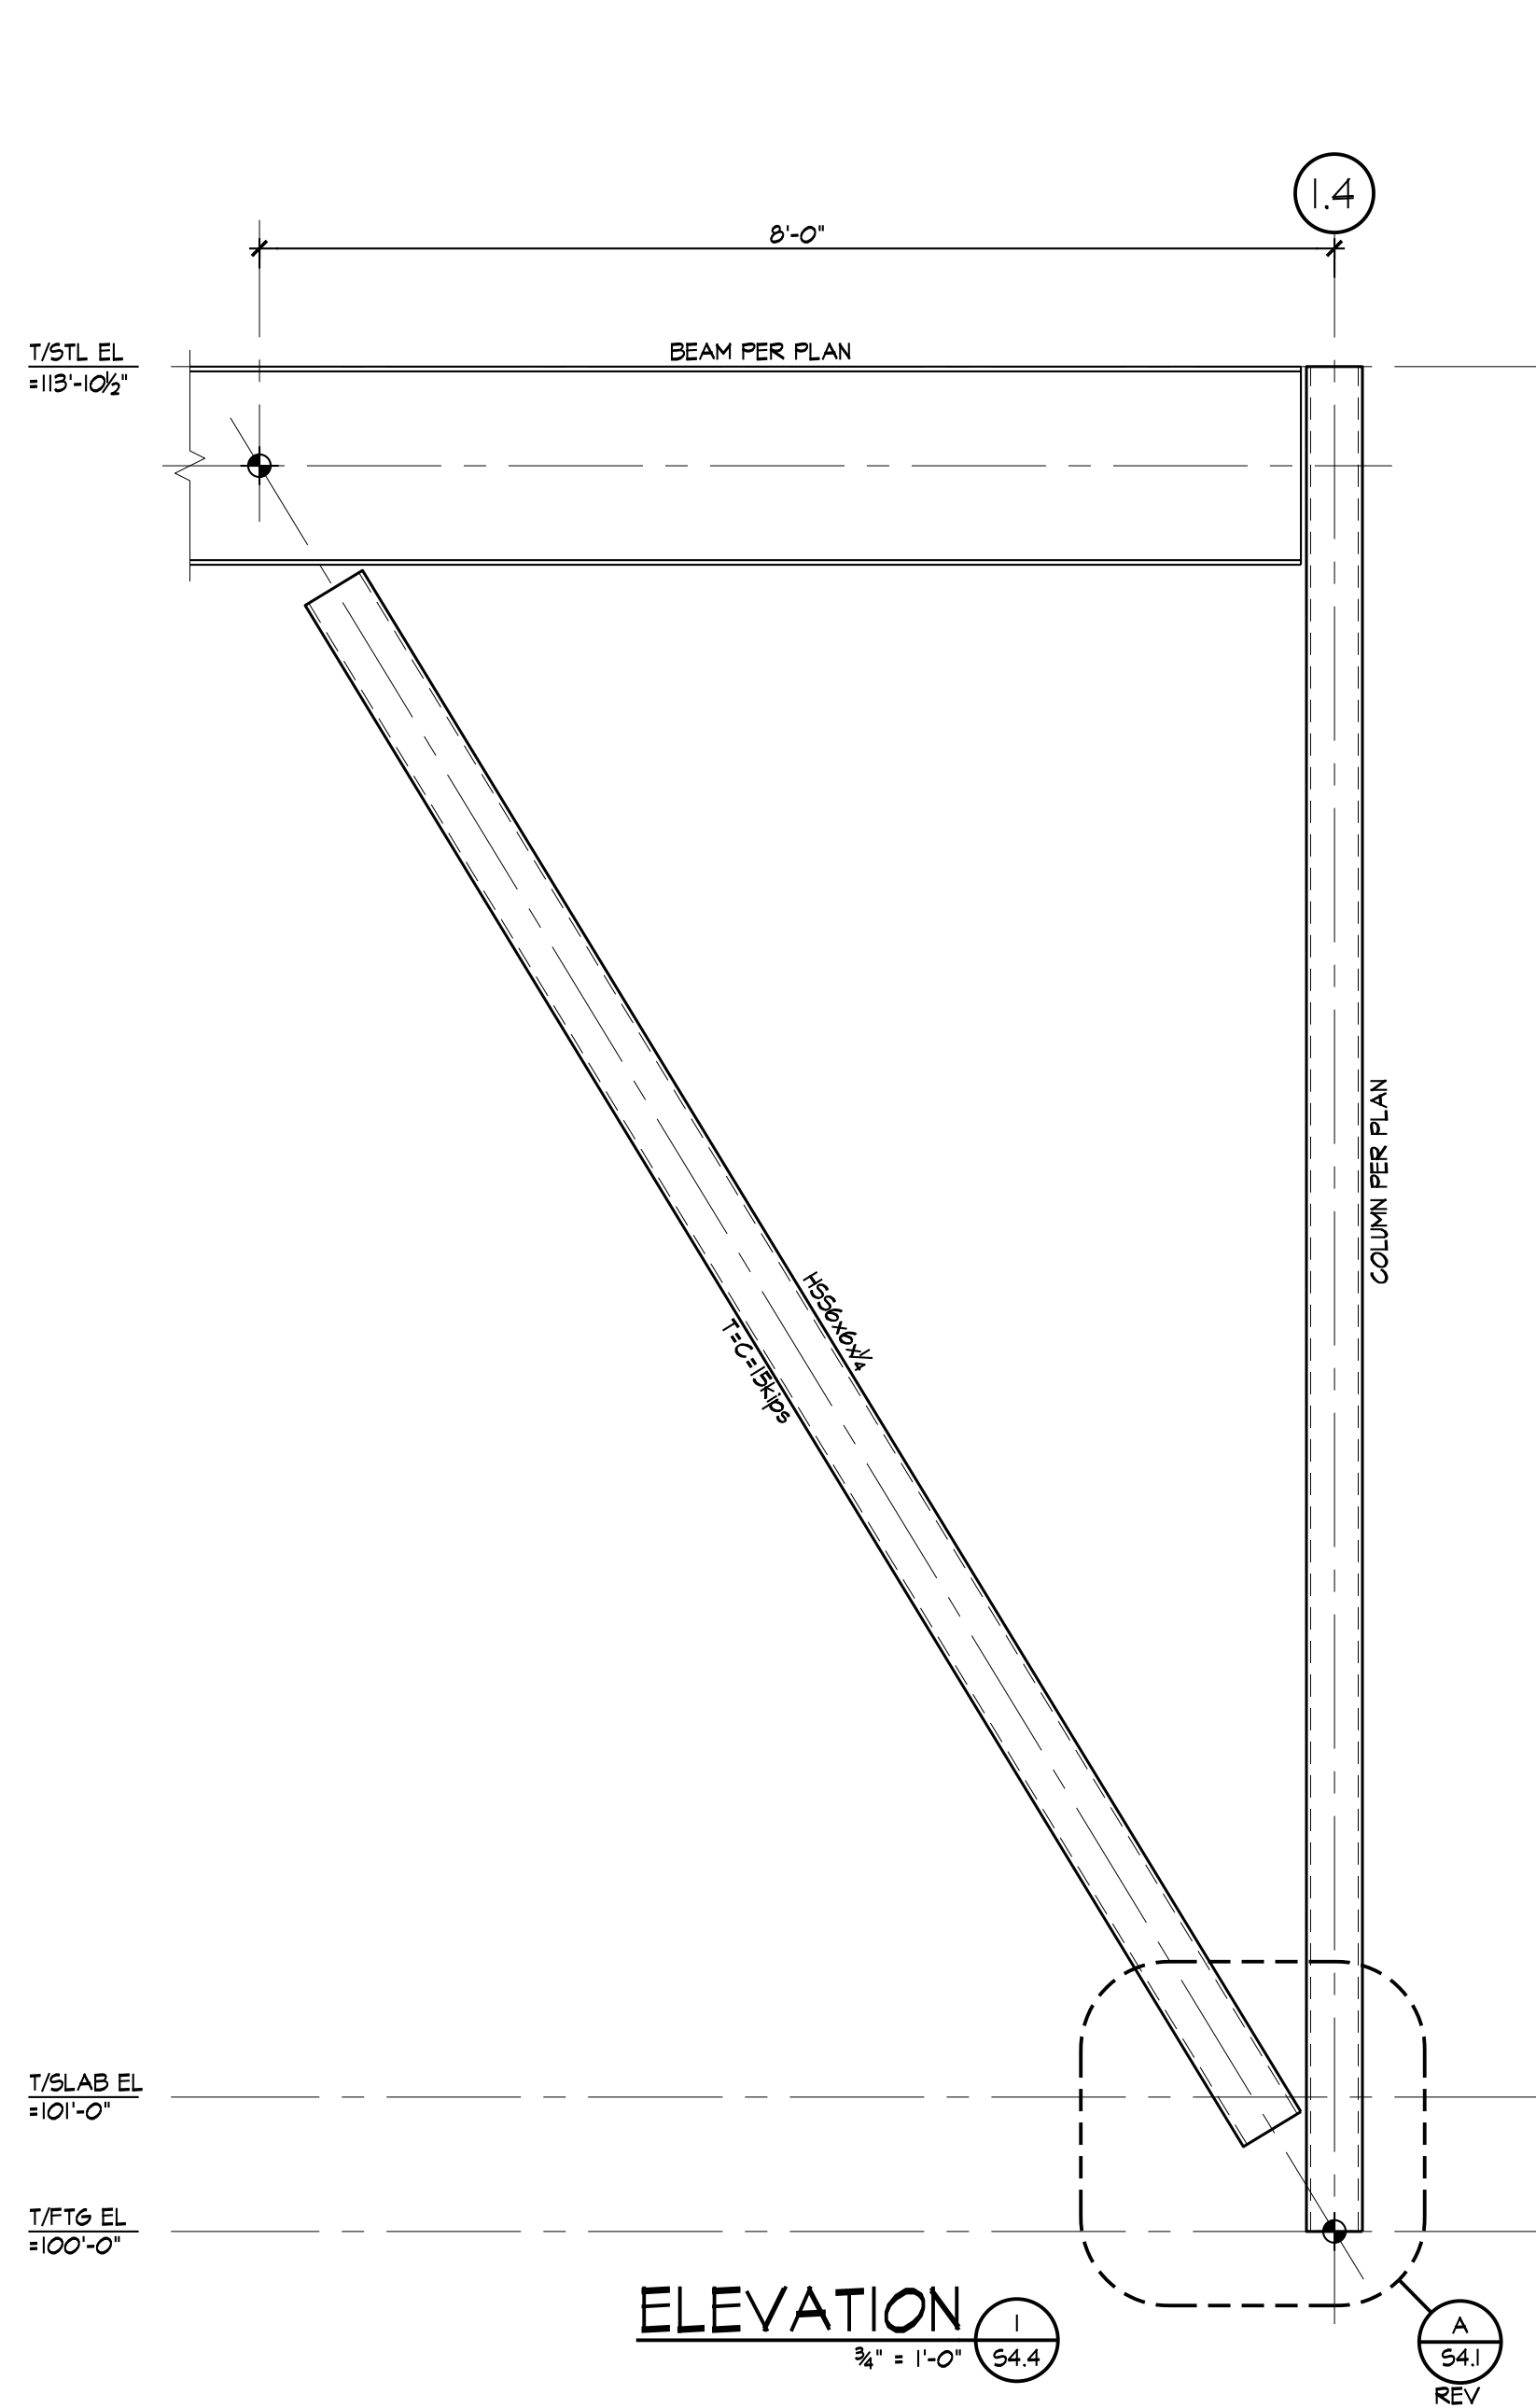



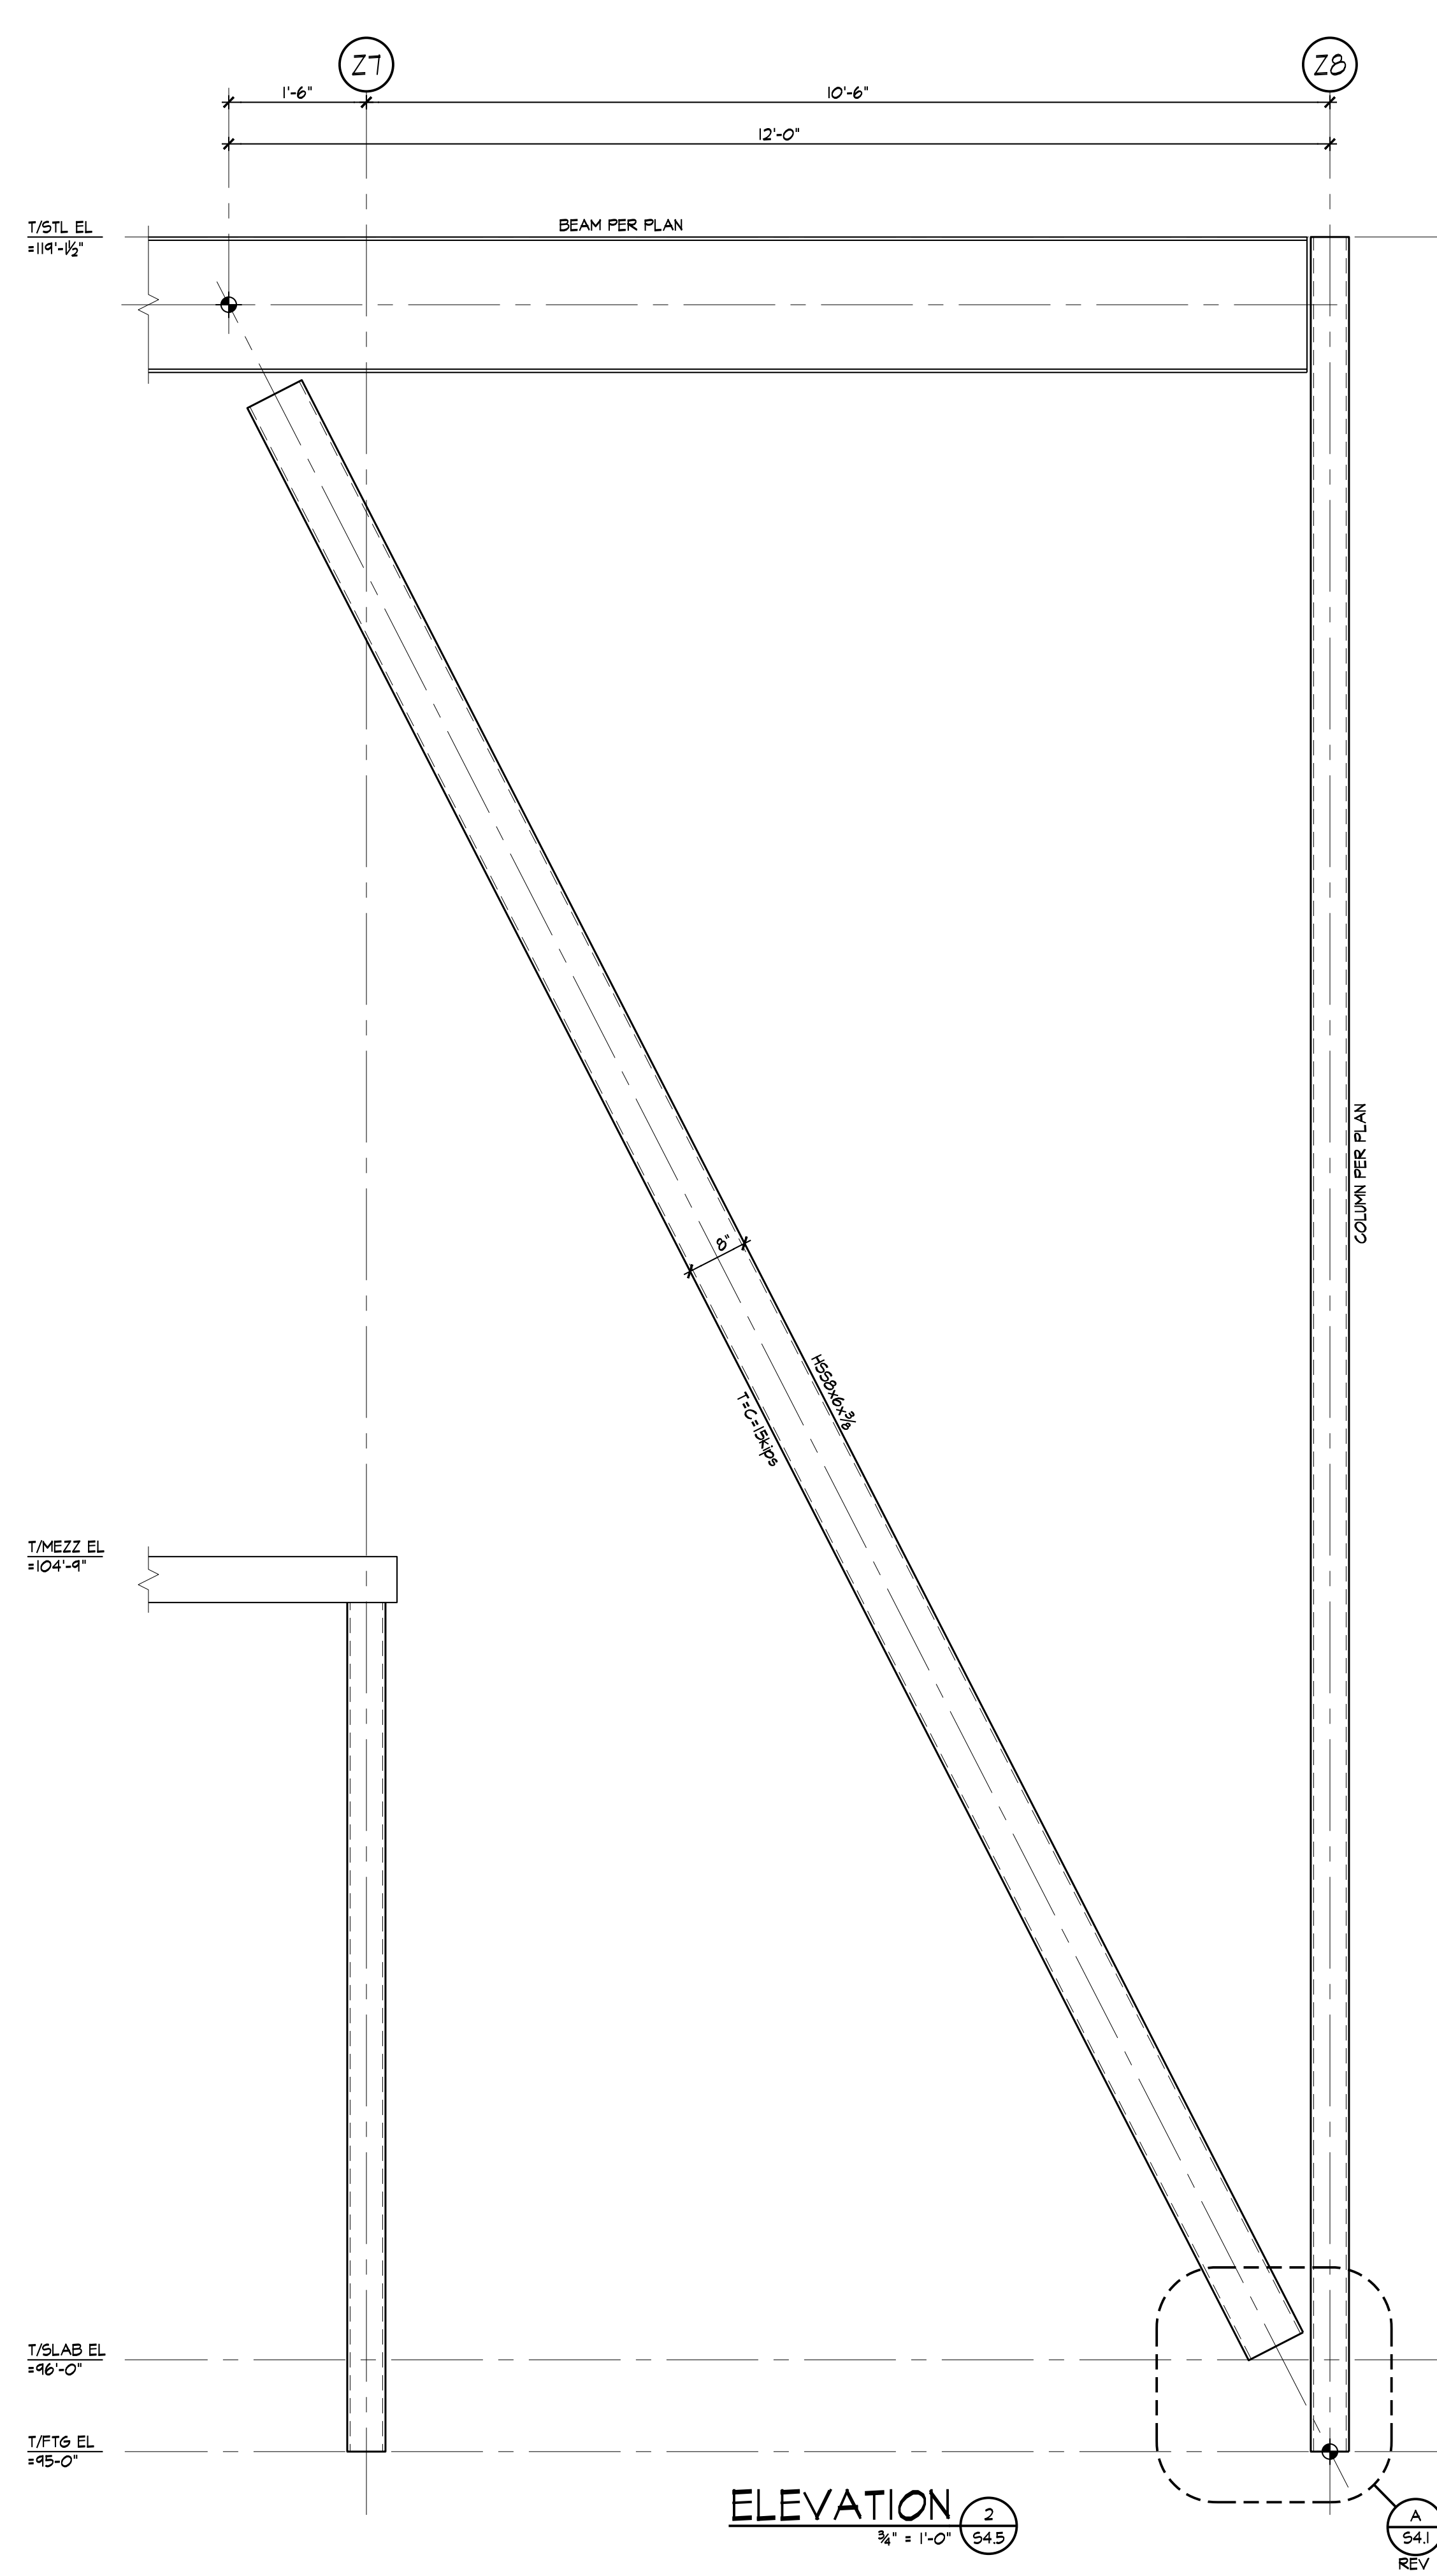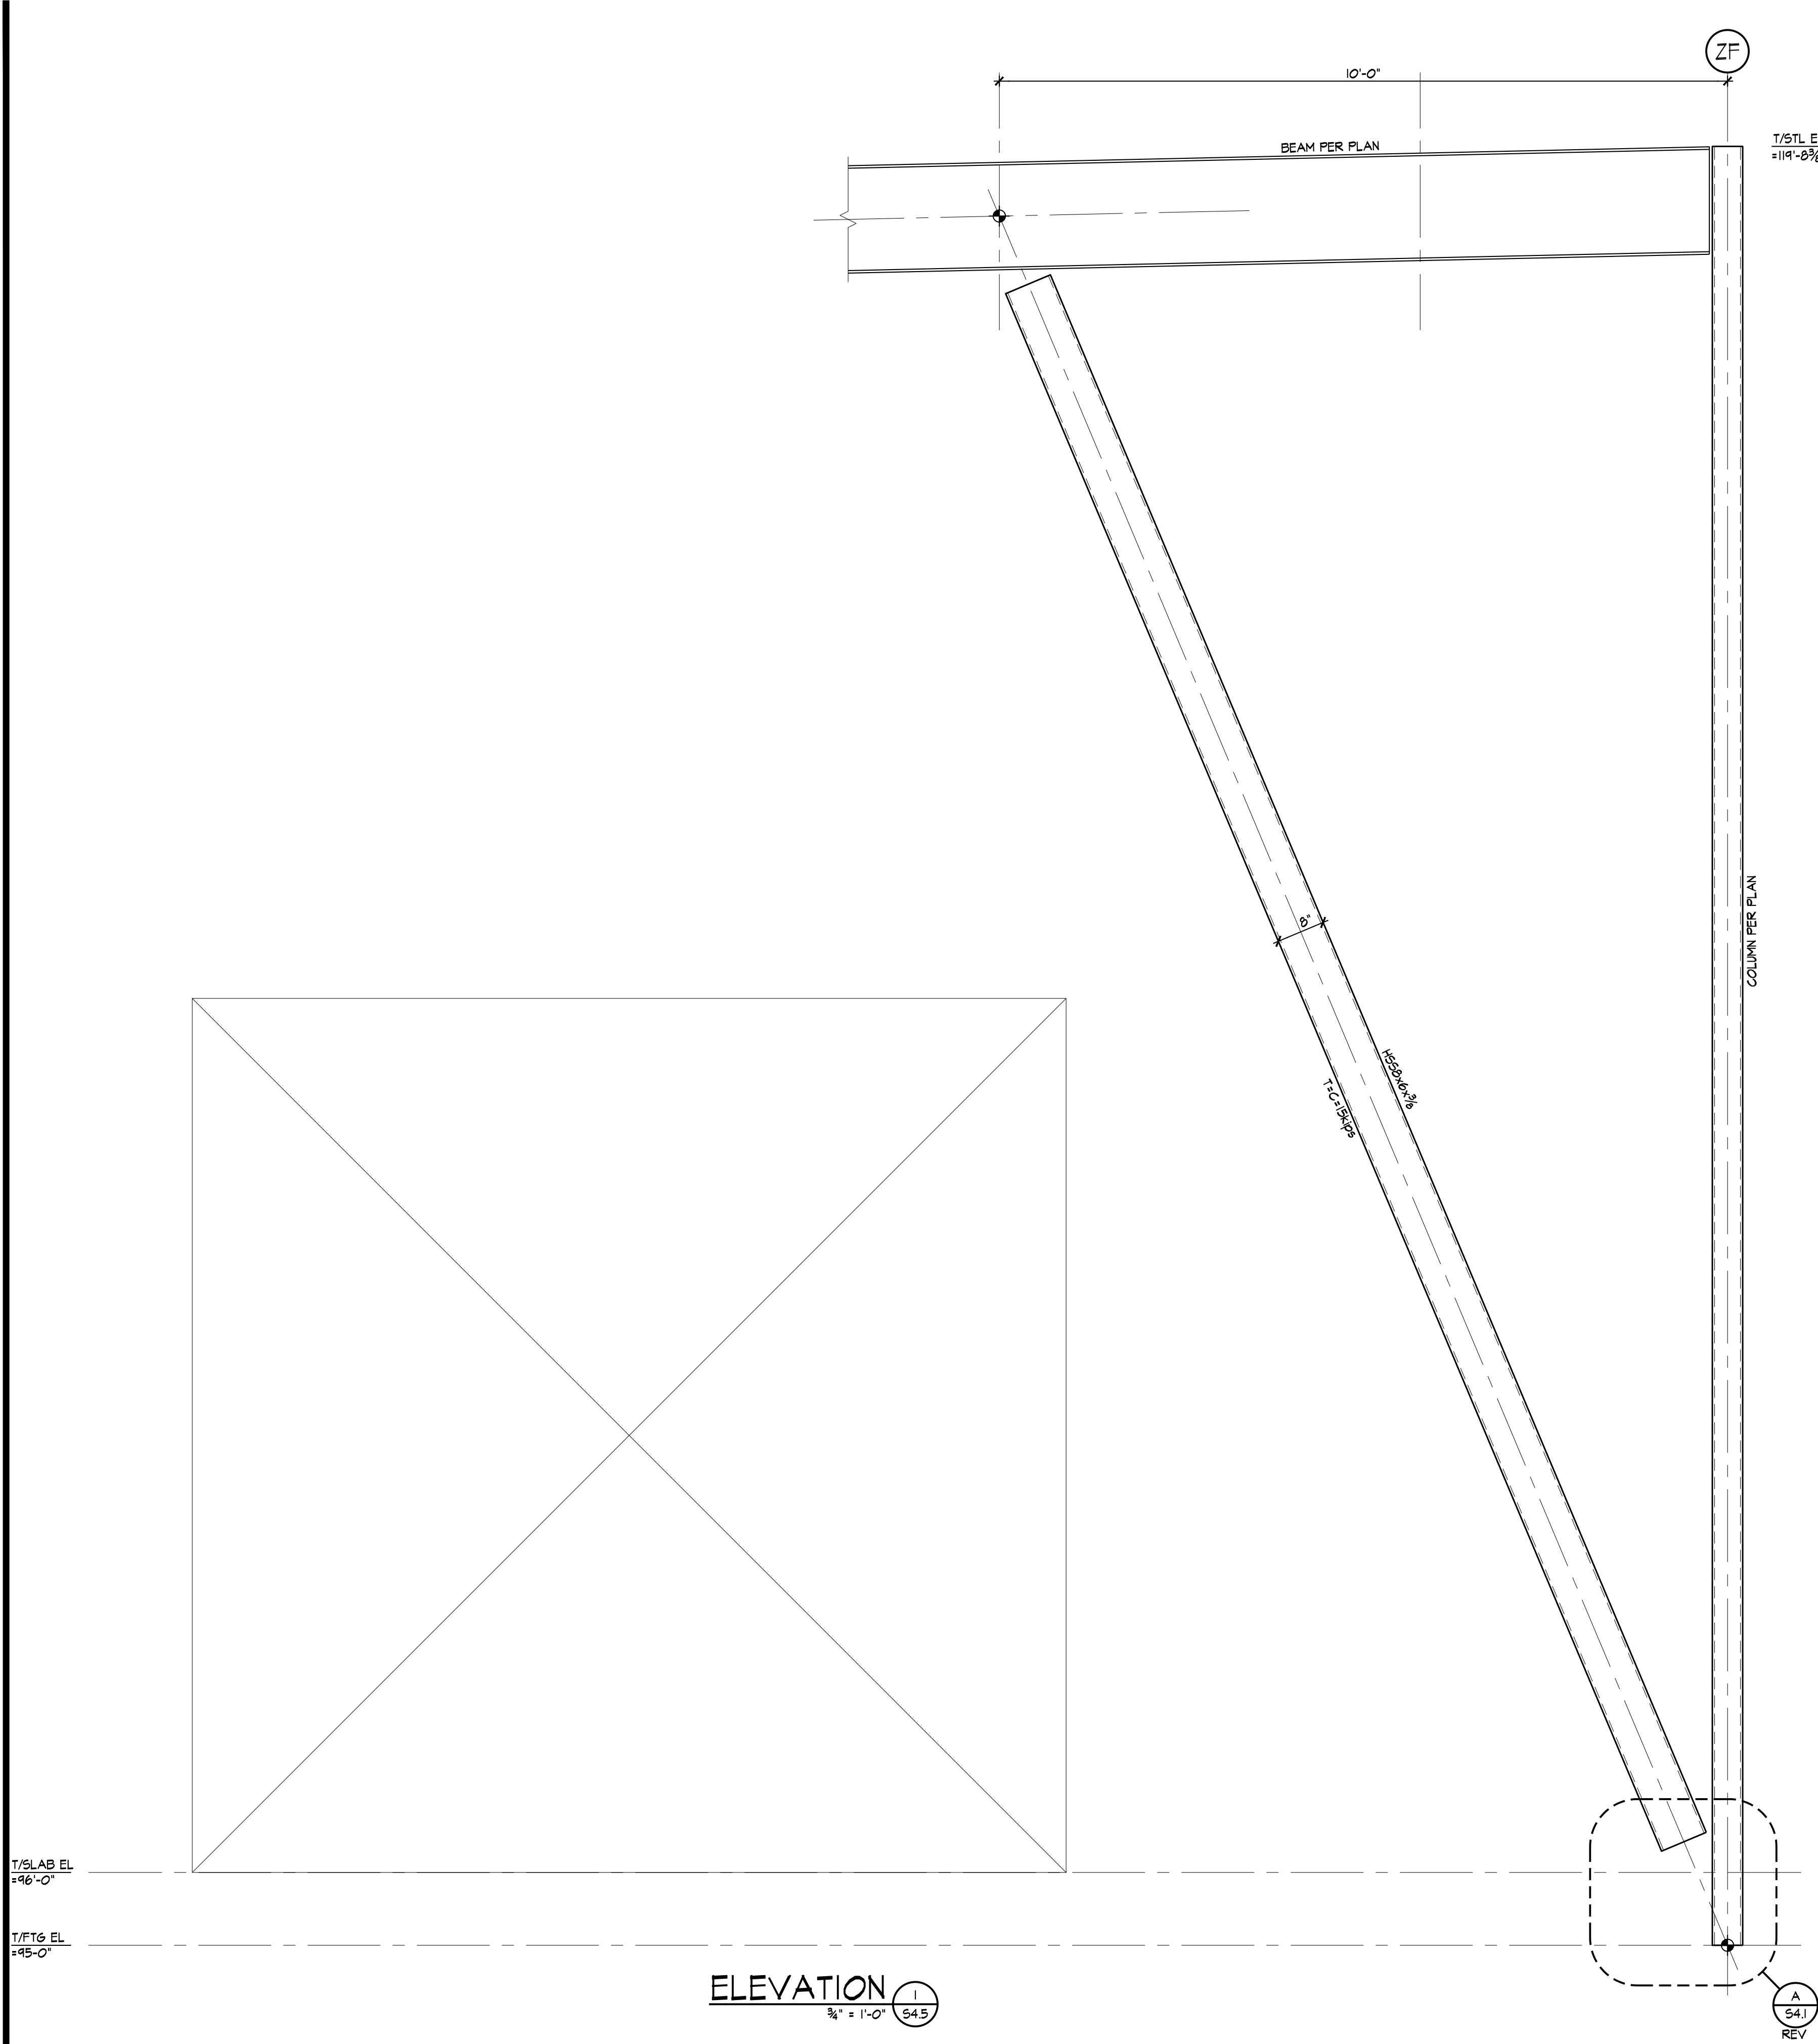

**BOB D. CAMPBELL & CO.**  
Structural Engineers Since 1957  
4338 Belleview Ave. 818.531.4144  
Kansas City, MO 64111 www.bdc-engrs.com

**THEATRE SALINA**  
DANCE STUDIOS & SCENE SHOP EXPANSION  
SALINA, KANSAS

PROFESSIONAL ENGINEER  
KANSAS  
23831  
9-18-26  
CHRISTOPHER A. BENTLEY  
LICENSED

REVISION:  
DATE: 9-18-2026  
JOB: 22-3239  
SHEET NO.:

**S4.5**


**JGR**  
JonesGillamRenz  
730 N. Ninth 1881 Main Street, Suite 301  
Salina, KS 67401 Kansas City, MO 64108  
785.827.0386 jgr@jgarchitects.com

COPYRIGHTED ©







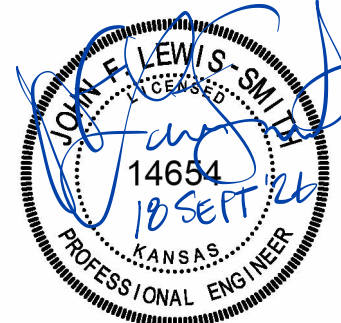

REVISIONS:  
NO DATE REVISION


DATE: 9-18-2026

JOB: 22-3239

SHEET NO.:

ME1.1


COPYRIGHTED ©

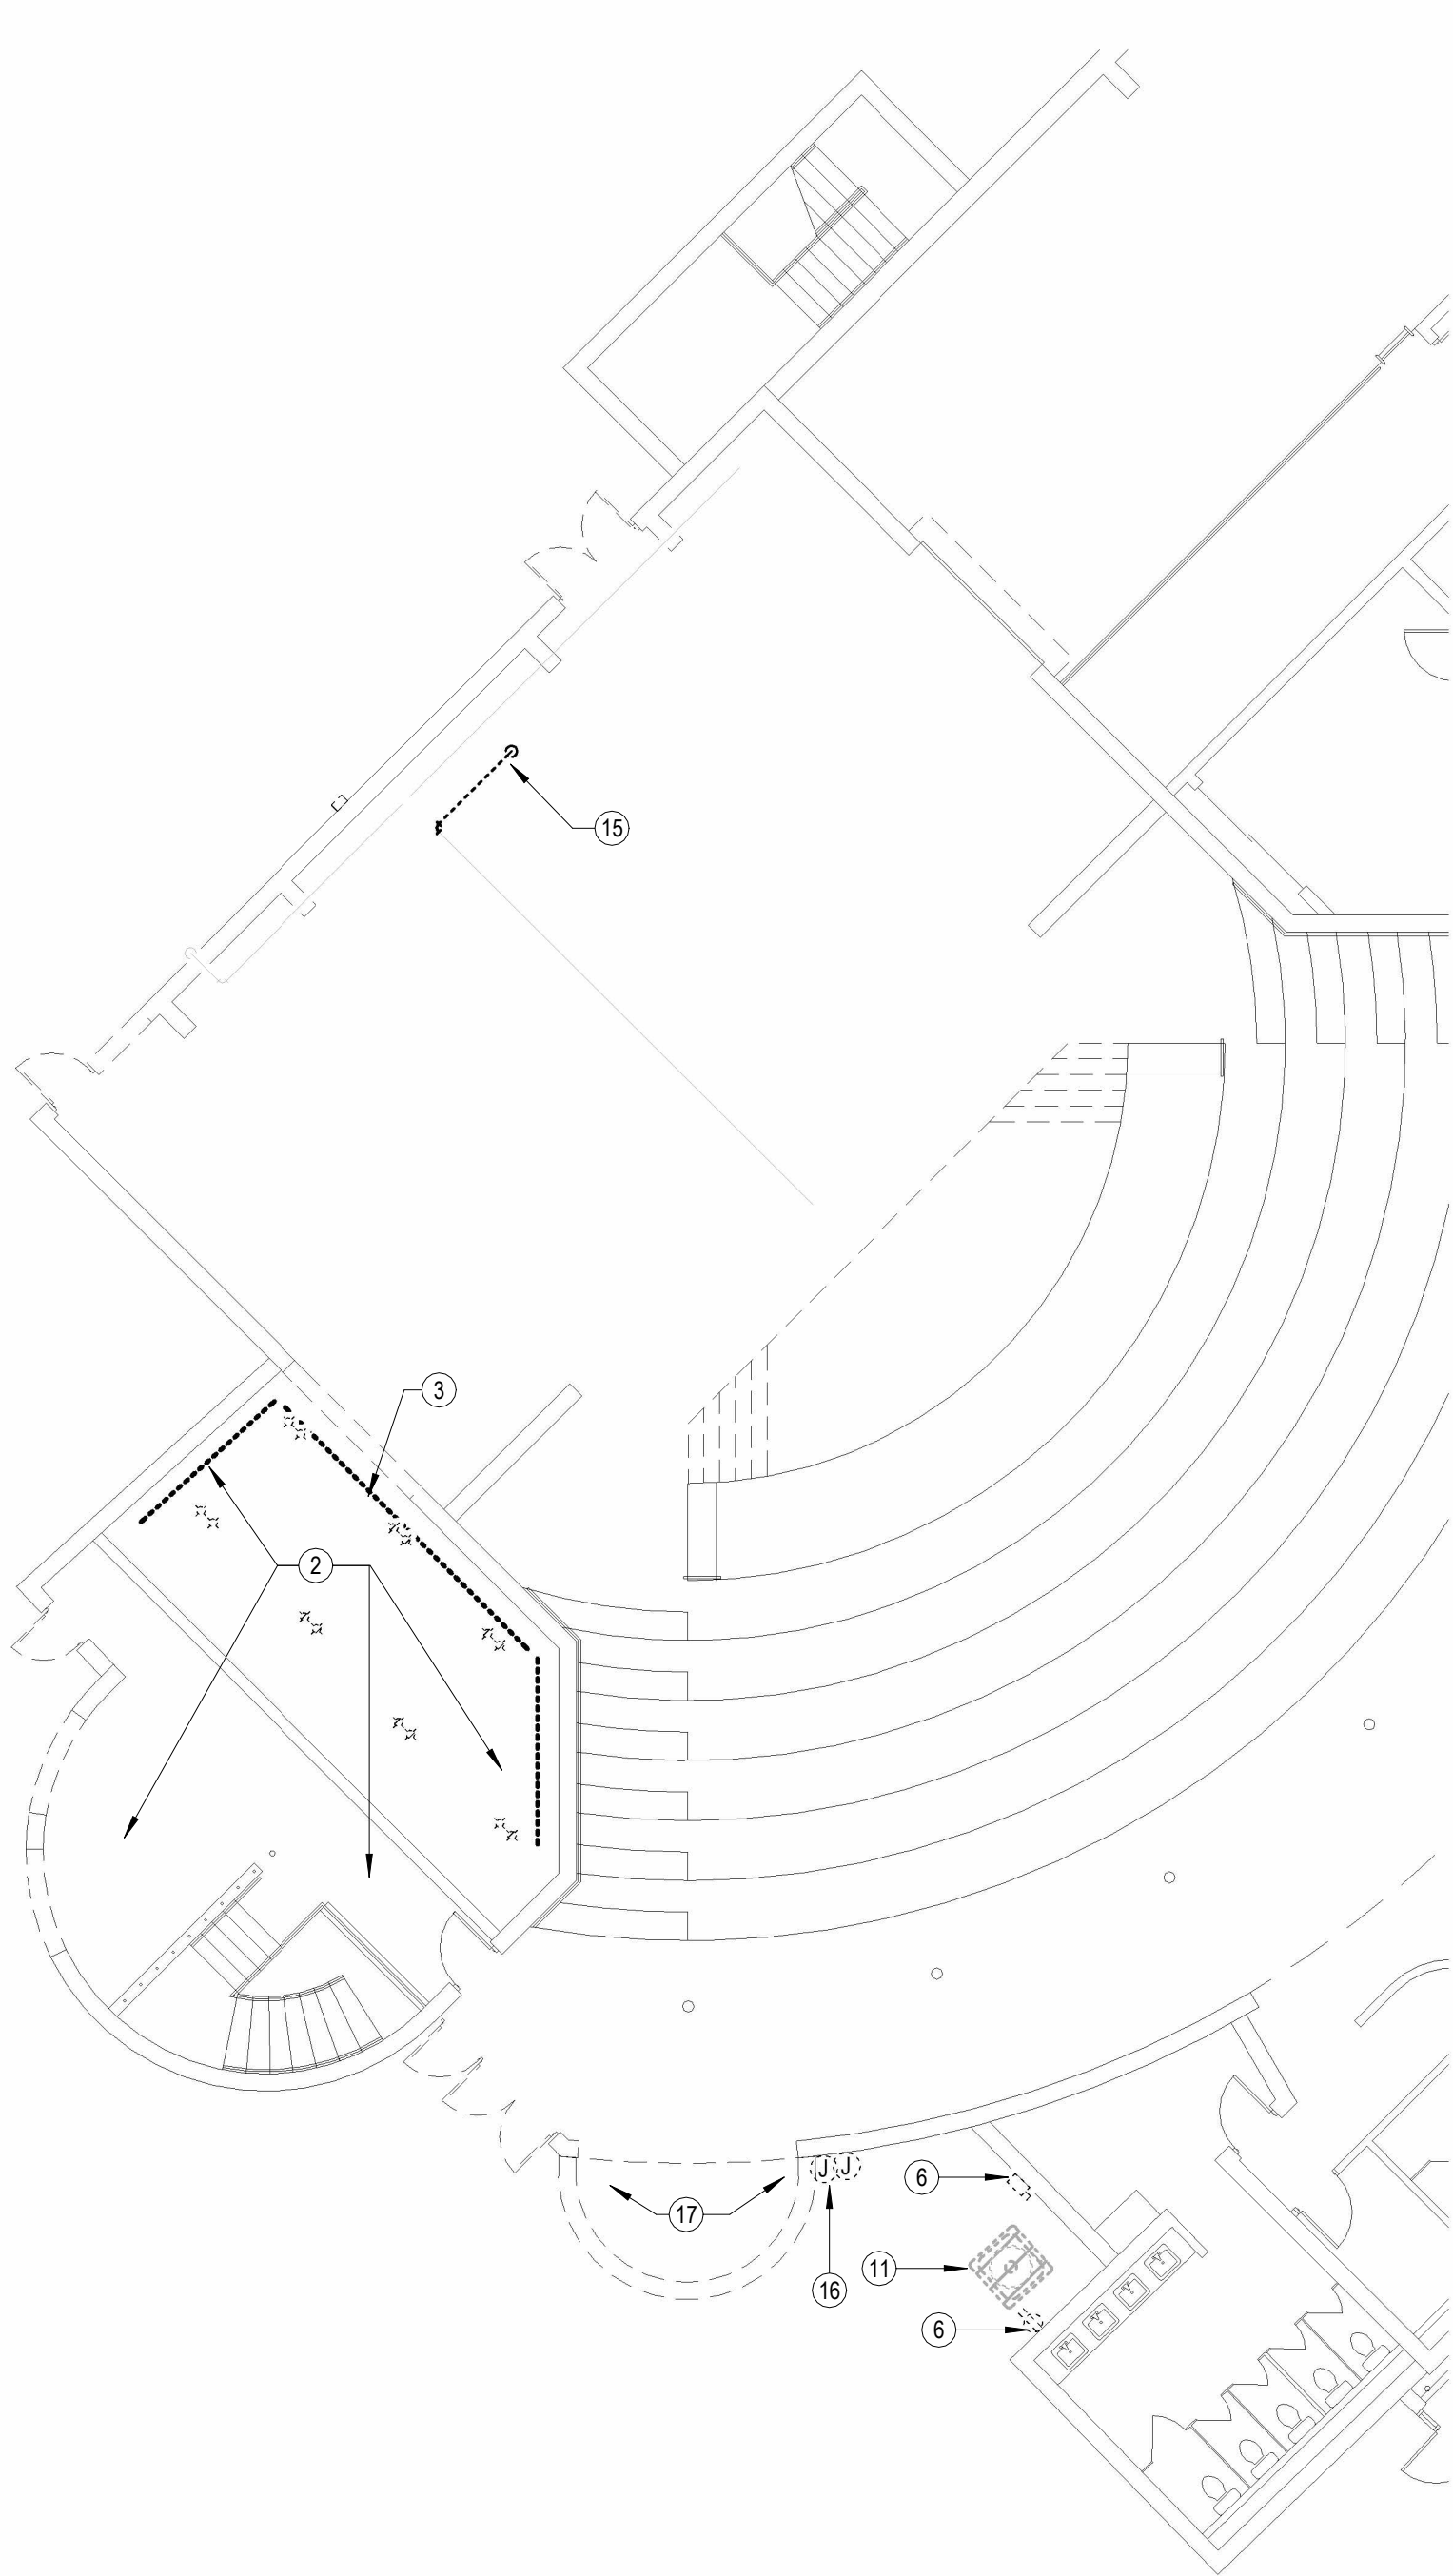

**C ME DEMOLITION PLAN - MAIN LEVEL**  
3/32" = 1'-0"

**GENERAL PLUMBING DEMOLITION NOTES**

- ALL PIPING TAKEN OUT OF SERVICE SHALL BE REMOVED. WHERE PIPING TO BE REMOVED IS CONNECTED TO EXISTING PIPING TO REMAIN, PIPING SHALL BE REMOVED BACK TO MAIN AND CAPPED, UNLESS INDICATED OTHERWISE. CONTRACTOR SHALL DISPOSE OF PIPING OR DELIVER TO OWNER, AS DIRECTED BY OWNER.
- WHERE PIPING TAKEN OUT OF SERVICE IS LOCATED BELOW SLAB AND IS UNABLE TO BE REMOVED, CAP BELOW SLAB.
- COORDINATE CUTTING, PATCHING OF EXISTING WALLS, CEILINGS, ROOF AND FLOORS AFFECTED BY MECHANICAL DEMOLITION WITH G.C.
- ALL EQUIPMENT TAKEN OUT OF SERVICE SHALL BE REMOVED. EQUIPMENT SHALL BE DELIVERED TO OWNER OR DISPOSED OF AS DIRECTED BY OWNER.
- REMOVE ALL PLUMBING INSTALLATION FROM PROJECT AREA, UNLESS REQUIRED FOR NEW WORK OR EXISTING INSTALLATION NOT AFFECTED BY REMODEL. COORDINATE WITH OWNER AND G.C.
- SERVICES TO ITEMS NOT REMOVED AS PART OF THIS WORK SHALL BE RESTORED UPON COMPLETION OF THIS WORK TO FULLY OPERATIONAL CONDITION.
- NOT ALL ITEMS REQUIRED TO BE DEMOLISHED MAY BE INDICATED ON DRAWINGS. ALL DEMOLITION OF AFFECTED SPACE SHALL BE PERFORMED AS IF INDICATED.
- FIELD VERIFY EXACT LOCATION OF ALL EXISTING PLUMBING INSTALLATION INDICATED ON DRAWINGS.
- ALL ITEMS TO BE RE-USED OR RELOCATED SHALL BE CLEANED, REPAIRED, AND RESTORED TO LIKE NEW CONDITION PRIOR TO RE-USE.

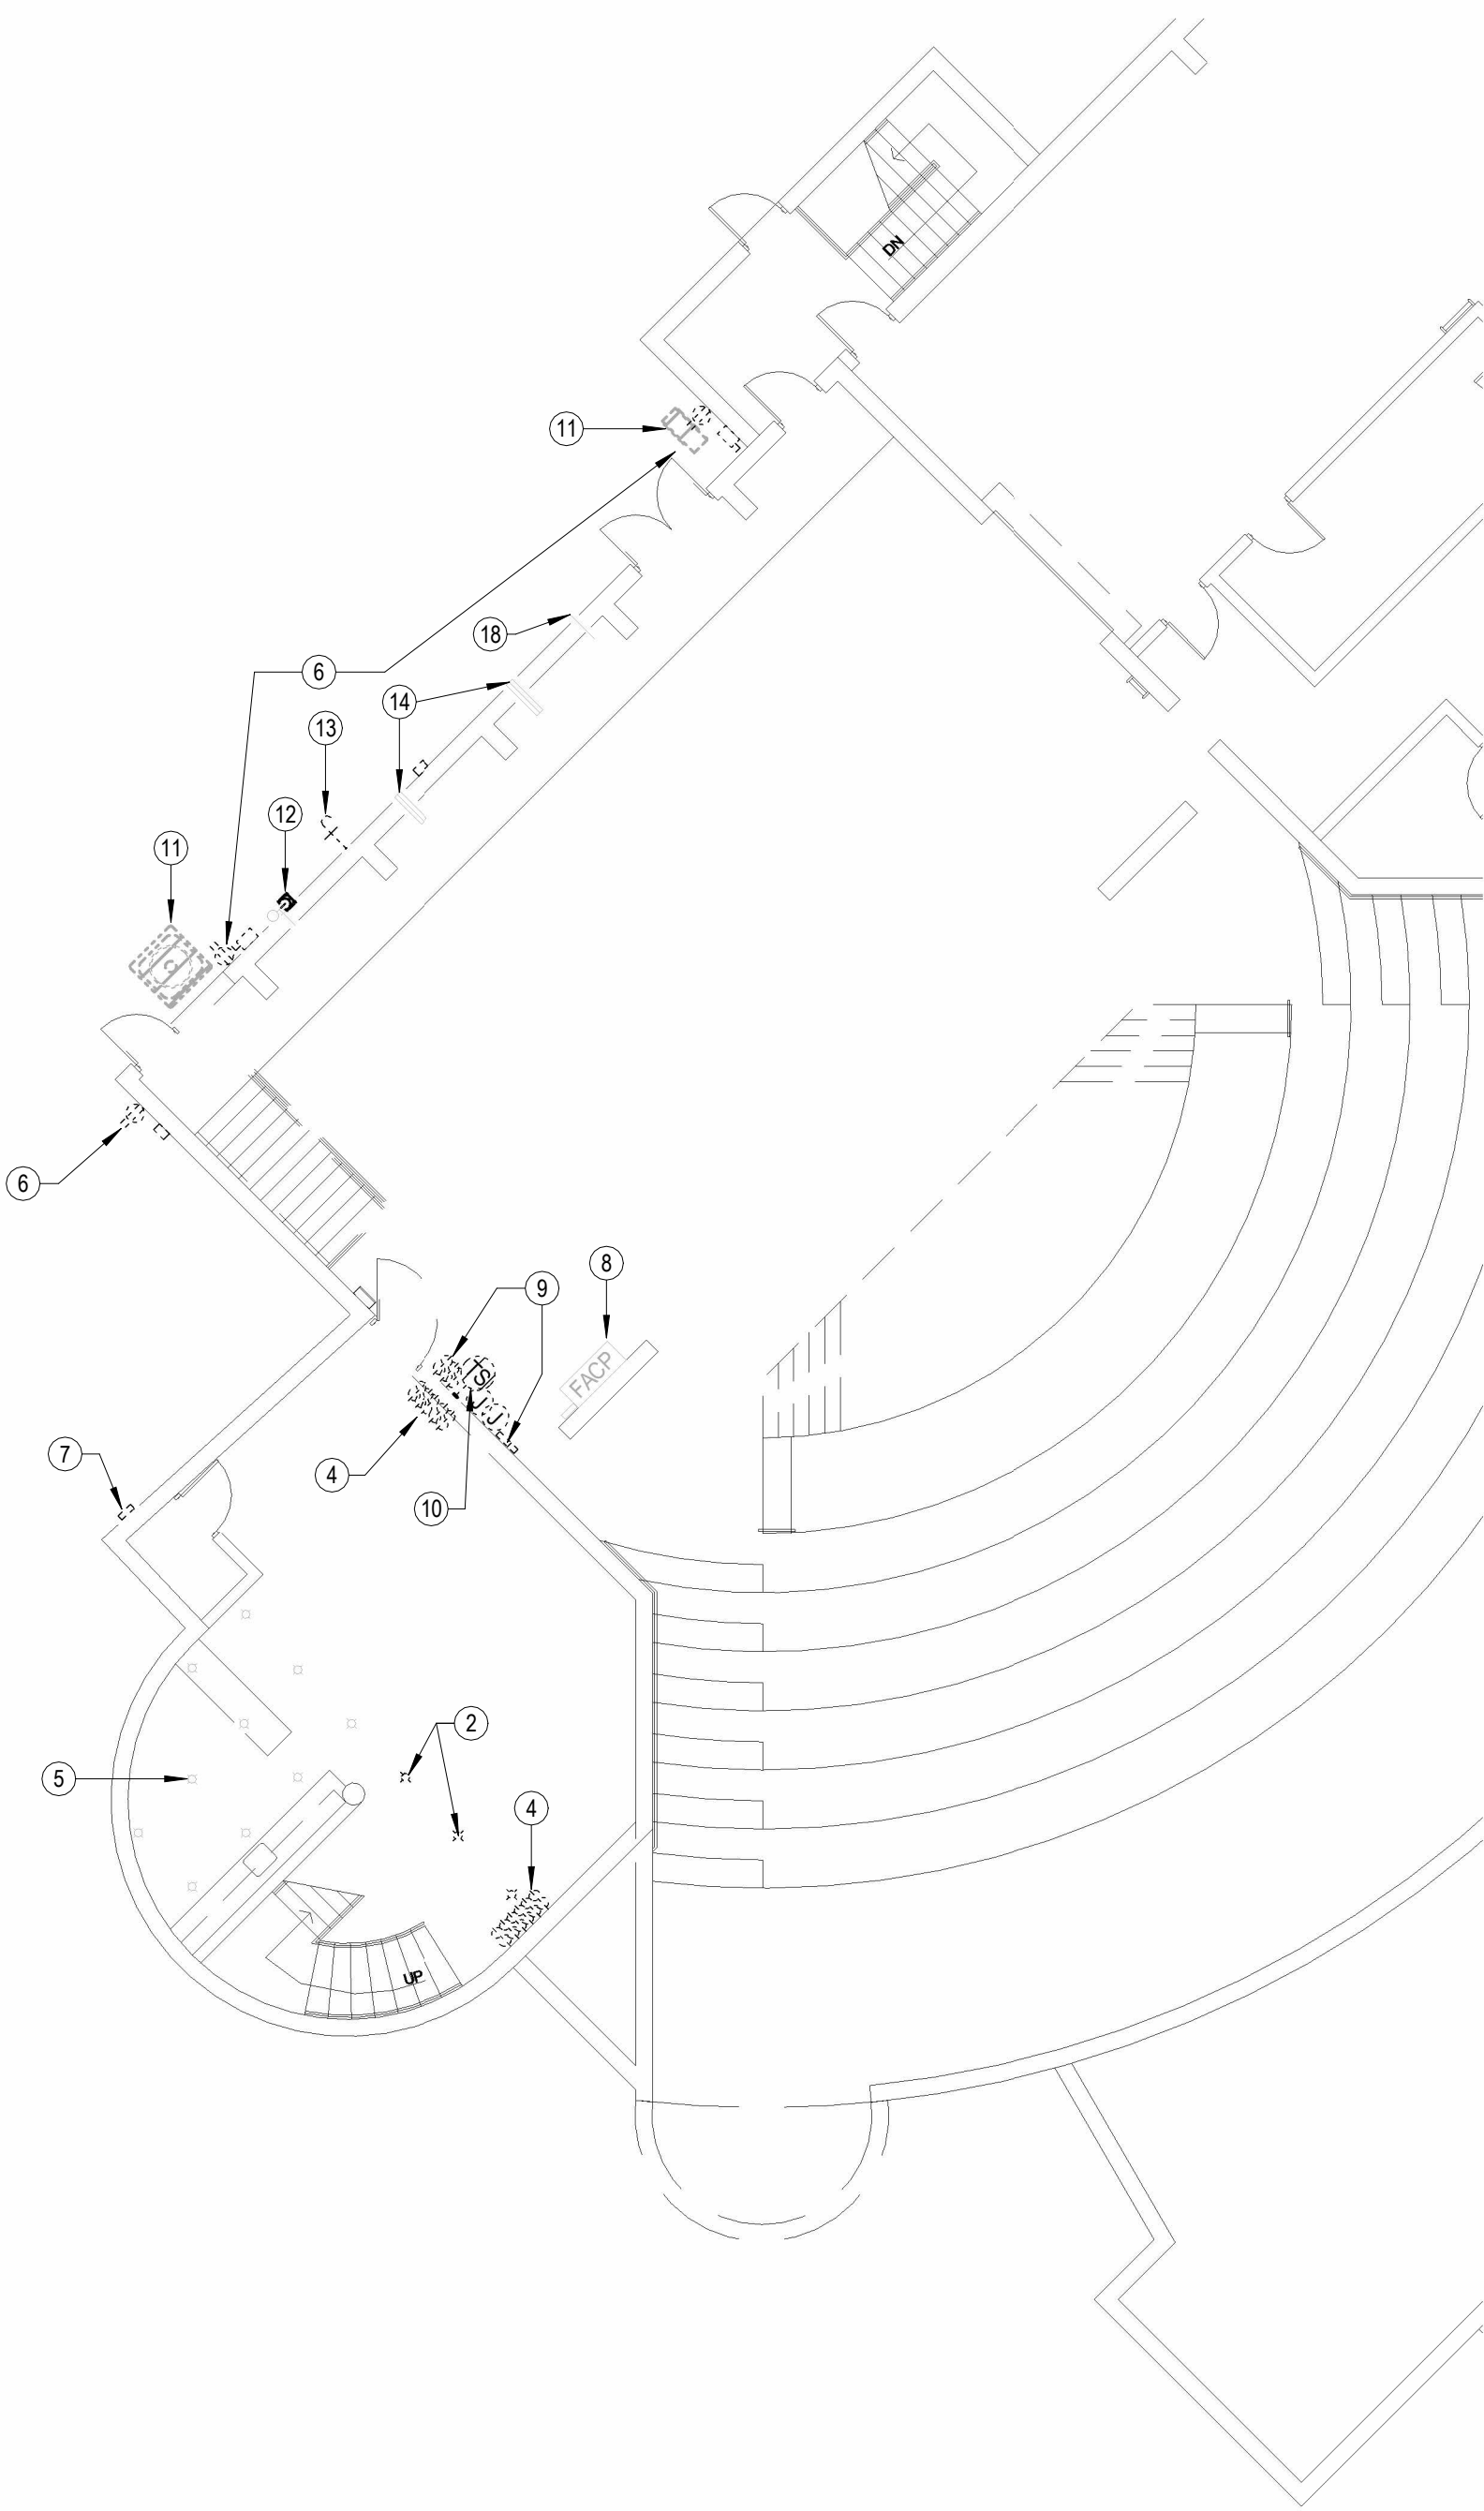

**B ME DEMOLITION PLAN - STAGE LEVEL**  
3/32" = 1'-0"

**GENERAL MECHANICAL DEMOLITION NOTES**

- ALL PIPING TAKEN OUT OF SERVICE SHALL BE REMOVED. WHERE PIPING TO BE REMOVED IS CONNECTED TO EXISTING PIPING TO REMAIN, PIPING SHALL BE REMOVED BACK TO MAIN AND CAPPED, UNLESS INDICATED OTHERWISE. CONTRACTOR SHALL DISPOSE OF PIPING OR DELIVER TO OWNER, AS DIRECTED BY OWNER.
- WHERE PIPING TAKEN OUT OF SERVICE IS LOCATED BELOW SLAB AND IS UNABLE TO BE REMOVED, CAP BELOW SLAB.
- ALL DUCTWORK TAKEN OUT OF SERVICE SHALL BE REMOVED.
- COORDINATE CUTTING, PATCHING OF EXISTING WALLS, CEILINGS, ROOF AND FLOORS AFFECTED BY MECHANICAL DEMOLITION WITH G.C.
- ALL EQUIPMENT TAKEN OUT OF SERVICE SHALL BE REMOVED. EQUIPMENT SHALL BE DELIVERED TO OWNER OR DISPOSED OF AS DIRECTED BY OWNER.
- REMOVE ALL MECHANICAL INSTALLATION FROM PROJECT AREA, UNLESS REQUIRED FOR NEW WORK OR EXISTING INSTALLATION NOT AFFECTED BY REMODEL. COORDINATE WITH OWNER AND G.C.
- SERVICES TO ITEMS NOT REMOVED AS PART OF THIS WORK SHALL BE RESTORED UPON COMPLETION OF THIS WORK TO FULLY OPERATIONAL CONDITION.
- NOT ALL ITEMS REQUIRED TO BE DEMOLISHED MAY BE INDICATED ON DRAWINGS. ALL DEMOLITION OF AFFECTED SPACE SHALL BE PERFORMED AS IF INDICATED.
- FIELD VERIFY EXACT LOCATION OF ALL EXISTING MECHANICAL INSTALLATION INDICATED ON DRAWINGS.
- ALL ITEMS TO BE RE-USED OR RELOCATED SHALL BE CLEANED, REPAIRED, AND RESTORED TO LIKE NEW CONDITION PRIOR TO RE-USE.

**GENERAL ELECTRICAL DEMOLITION NOTES**

- REMOVE ALL NM, BX, MC, AC AND OTHER CABLE SYSTEMS AND WIRING FOR ALL ABANDONED CIRCUITS.
- REMOVE ALL ABANDONED CONDUITS ABOVE LAY-IN CEILINGS, EXPOSED CONDUITS, FLEXIBLE CONDUITS, SURFACE RACEWAY, SURFACE MOUNTED OUTLET/JUNCTION BOXES AND EQUIPMENT UNLESS NOTED OTHERWISE.
- WHERE ABANDONED FEEDERS AND BRANCH CIRCUITS ARE CONCEALED WITHIN WALLS, FLOORS AND HARD CEILINGS THAT ARE TO REMAIN, REMOVE ALL WIRING AND CAP CONDUITS AT BOTH ENDS.
- WHERE ABANDONED OUTLET AND JUNCTION BOXES ARE RECESSED FLUSH IN WALLS, FLOORS AND HARD CEILINGS THAT ARE TO REMAIN, REMOVE ALL WIRING AND WIRING DEVICES AND PROVIDE BLANK STAINLESS STEEL COVERPLATES FOR BOXES 6"x6" AND SMALLER. REMOVE BOXES LARGER THAN 6"x6" AND PATCH SURFACE TO MATCH EXISTING. COORDINATE WITH ARCHITECT FOR FINAL DIRECTION.
- ALL EQUIPMENT, FIXTURES, RACEWAY, WIRING AND DEVICES WHICH ARE REMOVED SHALL BE REMOVED FROM THE JOB SITE BY THIS CONTRACTOR, UNLESS DIRECTED OTHERWISE BY THE ARCHITECT OR OWNER'S REPRESENTATIVE. CONFORM TO ALL LAWS AND ORDINANCES IN EFFECT CONCERNING THE PROPER DISPOSAL OF LUMINAIRES AND LAMPS.
- COORDINATE THE REMOVAL OF MECHANICAL AND PLUMBING EQUIPMENT WITH THE MECHANICAL AND PLUMBING CONTRACTORS. ELECTRICAL CONTRACTOR SHALL DISCONNECT AND REMOVE ELECTRICAL POWER AND CONTROL CIRCUITS FOR EQUIPMENT BEING REMOVED. REMOVE ALL ELECTRICAL EQUIPMENT ASSOCIATED WITH DEMOLISHED MECHANICAL AND PLUMBING EQUIPMENT (DISCONNECT SWITCHES, MOTOR STARTERS, RELAYS, ETC.).




**A ME DEMOLITION PLAN - BASEMENT**  
3/32" = 1'-0"

**NOTES BY SYMBOL**

- REMOVE ALL MECHANICAL AND ELECTRICAL INSTALLATION AS REQUIRED FOR REMOVAL OF STAIRS.
- REMOVE LIGHTING IN THIS AREA. MODIFY CIRCUITRY FOR NEW LIGHTING.
- MODIFY HVAC IN THIS AREA TO ACCOMMODATE REMOVAL AND REPLACEMENT OF CEILING.
- REMOVE SWITCHES AND ASSOCIATED CIRCUITRY.
- LIGHTING IN THIS AREA TO REMAIN. MODIFY CIRCUITRY AS REQUIRED TO CONTROL WITH NEW SWITCH, SEE LIGHTING PLAN.
- REMOVE ALL MECHANICAL AND ELECTRICAL INSTALLATION FROM WALL, UNLESS INDICATED TO REMAIN OR BE RELOCATED.
- COORDINATE RELOCATION OF TELECOMMUNICATIONS PEDESTAL WITH UTILITY PROVIDER.
- FIRE ALARM CONTROL PANEL TO REMAIN.
- REMOVE ALL MECHANICAL AND ELECTRICAL INSTALLATION FROM WALL BEING REMOVED. PROVIDE JUNCTION BOXES, CONDUIT, WIRING, ETC. AS REQUIRED TO KEEP ITEMS IN SERVICE AS DIRECTED BY OWNER.
- RELOCATE TEMPERATURE SENSOR, COORDINATE WITH BAS PROVIDER.
- RELOCATE CONDENSING UNIT. SEE ROOF PLAN.
- REMOVE GAS SERVICE. COORDINATE WITH KANSAS GAS. BRANCH LINE TO BASEMENT AND ROOF TO REMAIN.
- REMOVE WALL HYDRANT.
- EXTEND EXHAUST DUCTS TO NEW ROOF.
- REMOVE GAS PIPING THROUGH ROOF. EXTEND REMAINING PIPE TO CONNECT TO ELEVATED PRESSURE LINE ON ROOF.
- RELOCATE CIRCUITRY FOR MONUMENT SIGN. PROVIDE BOXES, WIRING, ETC. AS REQUIRED.
- REMOVE ALL MECHANICAL AND ELECTRICAL INSTALLATION FROM AREA BEING DEMOLISHED.
- EXTEND PIPING AS REQUIRED TO ACCOMMODATE NEW CONSTRUCTION.

**THEATER COMMUNICATIONS SYSTEMS: PRIOR TO DEMOLITION, COORDINATE WITH OWNER TO IDENTIFY ALL EXISTING THEATER COMMUNICATIONS, AUDIO/VISUAL, INTERCOM, PAGING, PRODUCTION, AND RELATED LOW-VOLTAGE SYSTEMS AFFECTED BY THE WORK. VERIFY EQUIPMENT, DEVICES, CABLING, AND CONNECTIONS TO REMAIN, BE RELOCATED, OR BE REMOVED. DO NOT DISCONNECT, REMOVE, OR MODIFY EXISTING SYSTEMS WITHOUT PRIOR OWNER APPROVAL. PROVIDE ALL MODIFICATIONS, EXTENSIONS, RELOCATIONS, AND RECONNECTIONS REQUIRED TO MAINTAIN SYSTEM OPERATION FOLLOWING COMPLETION OF THE WORK.**



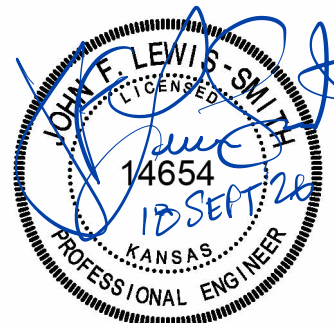


**REVISIONS:**  
NO DATE REVISION

**DATE:** 9-18-2026  
**JOB:** 22-3239  
**SHEET NO.:**


**ME1.2**

COPYRIGHTED ©

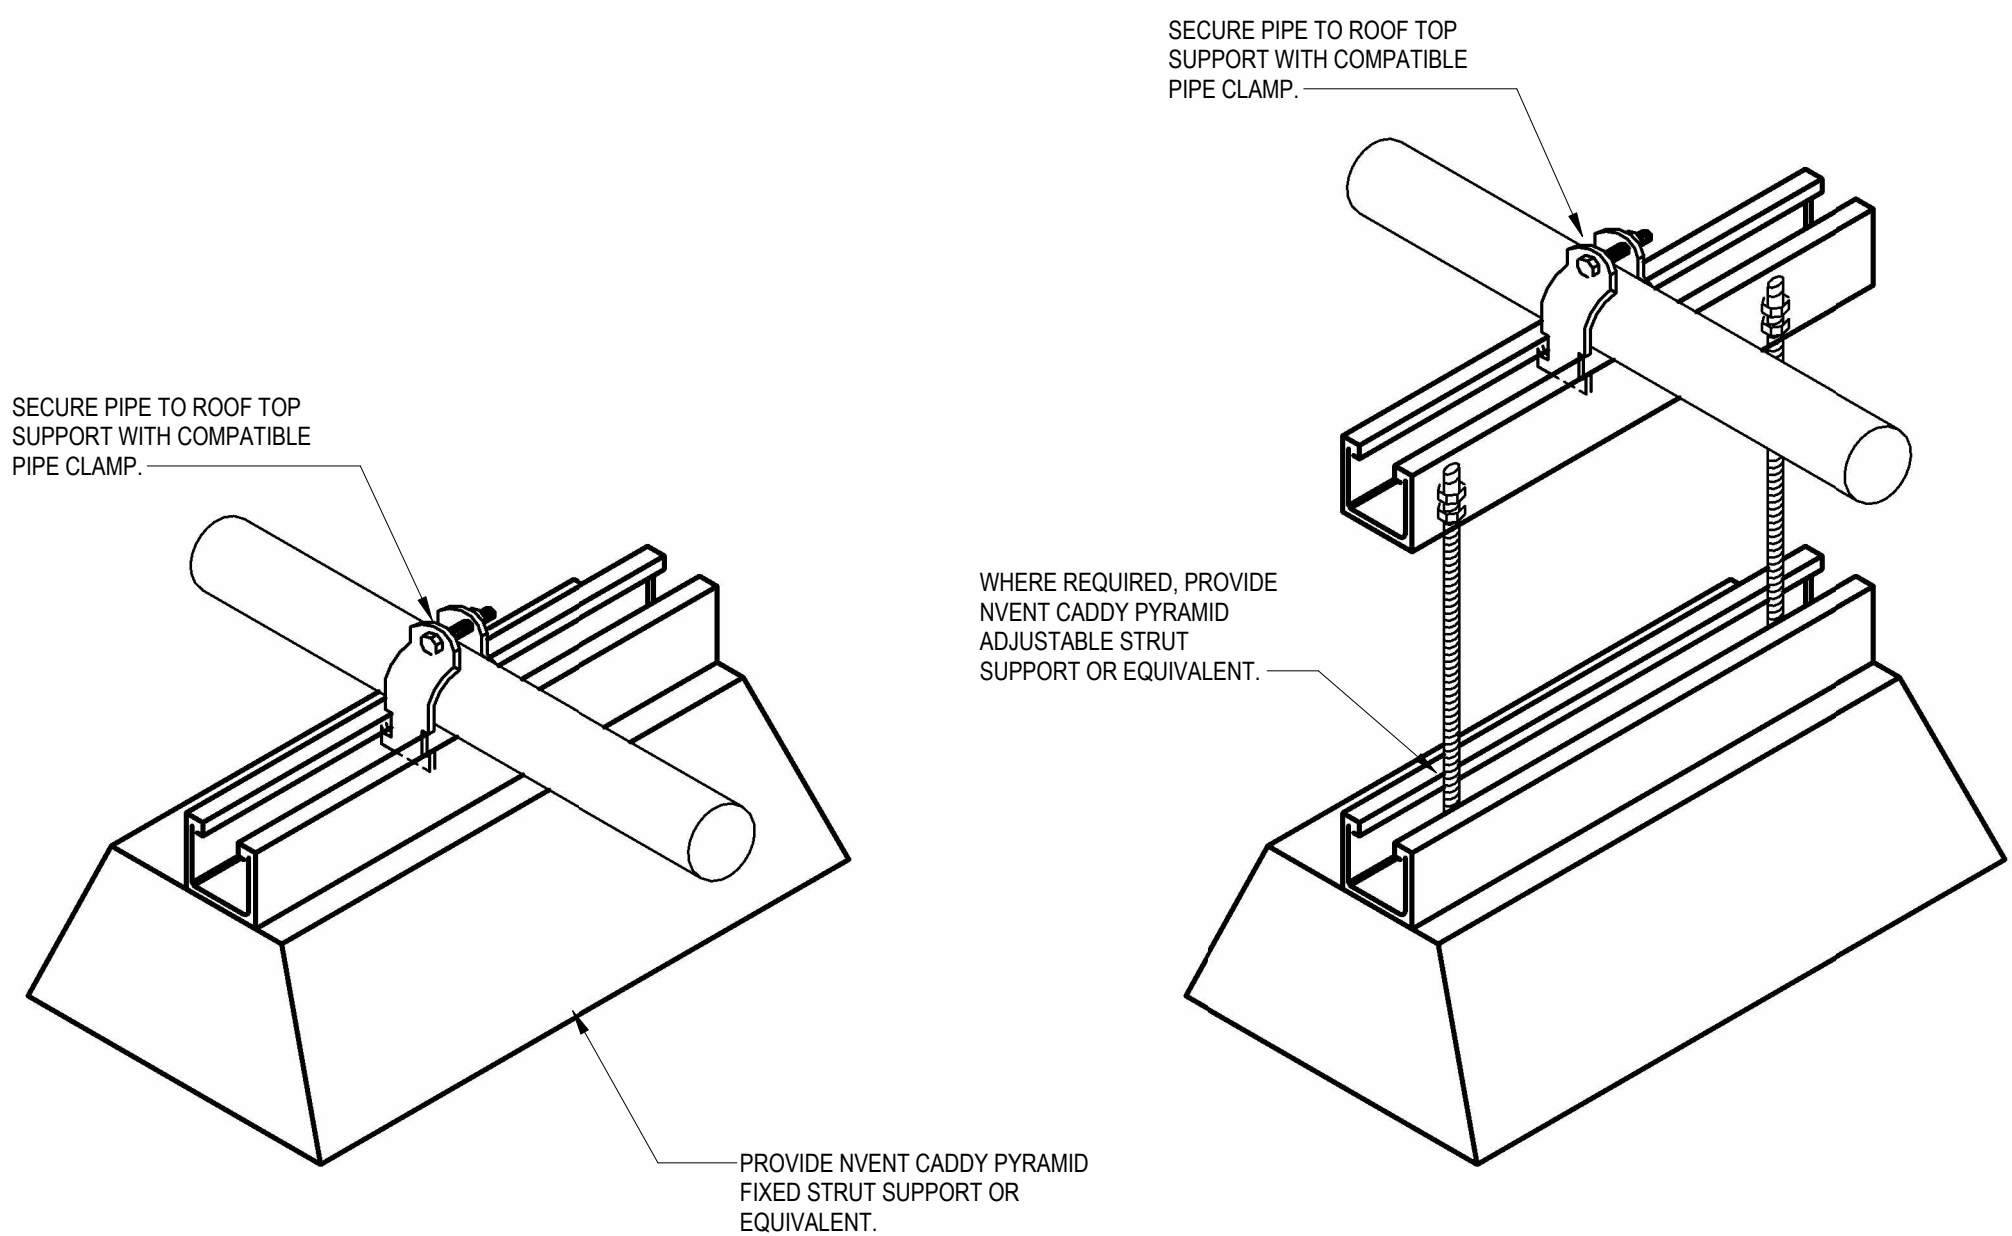

**B ROOFTOP PIPING SUPPORT DETAIL**  
NO SCALE

- NOTES BY SYMBOL**
- CIRCUIT FAN FOR OPERATION WITH TIMECLOCK.
  - FIELD WIRE RECEPTACLE PROVIDED WITH ROOFTOP UNIT.
  - CONNECT ROOFTOP UNIT. RTU TO BE SUPPLIED WITH INTEGRAL DISCONNECT SWITCH. VERIFY REQUIREMENTS WITH EQUIPMENT SUPPLIED BY OTHERS.
  - COORDINATE EXACT LOCATION OF ROOF DRAIN WITH ARCHITECT.
  - EXTEND EXHAUST DUCT UP THROUGH NEW ROOF AND TERMINATE WITH GOOSENECK AND SCREEN.
  - ROUTE 2" GAS DOWN TO NEW METER. COORDINATE EXACT LOCATION OF METER WITH KANSAS GAS, AND PAY ASSOCIATED SERVICE RELOCATION FEES. TOTAL BUILDING DEMAND = 2,662 CFH @ 2PSI.
  - SUPPORT GAS PIPING ON ROOF PER DETAIL.
  - CONNECT TO EXISTING 3" PIPING ON ROOF.
  - PROVIDE REGULATOR ON ROOF TO REDUCE PRESSURE FROM 2 PSI TO 7" WC (ADJUSTABLE).
  - CONNECT TO EXISTING VERTICAL GAS PIPE WITH 1" AND 3/4" BRANCHES SHOWN. PROVIDE REGULATOR TO REDUCE FROM 2 PSI TO 11" WC (ADJUSTABLE) AND EXTEND 1-1/2" DOWN TO CONNECT TO EXISTING PIPING SERVING BASEMENT.
  - CONNECT GAS TO ROOFTOP UNIT. PROVIDE GAS COCK, DIRT LEG, AND UNION.
  - PROVIDE ERICO PYRAMID SUPPORTS AND INSTALL RELOCATED CONDENSING UNIT. ROUTE REFRIGERANT PIPING TO EXISTING. COORDINATE ROUTING WITH ARCHITECT. WHERE PIPING MUST BE EXPOSED INSIDE BUILDING, PROVIDE LINE HIDE ENCLOSURE.
  - EXTEND EXISTING CIRCUITRY TO RELOCATED CONDENSING UNIT. PROVIDE NEW NEMA 3R DISCONNECT SWITCH.
  - RELOCATE PACKAGED UNIT TO NEW ROOF. PROVIDE NEW CURB, AND EXTEND CIRCUITRY, PIPING, DUCTWORK, ETC. FOR RELOCATION.

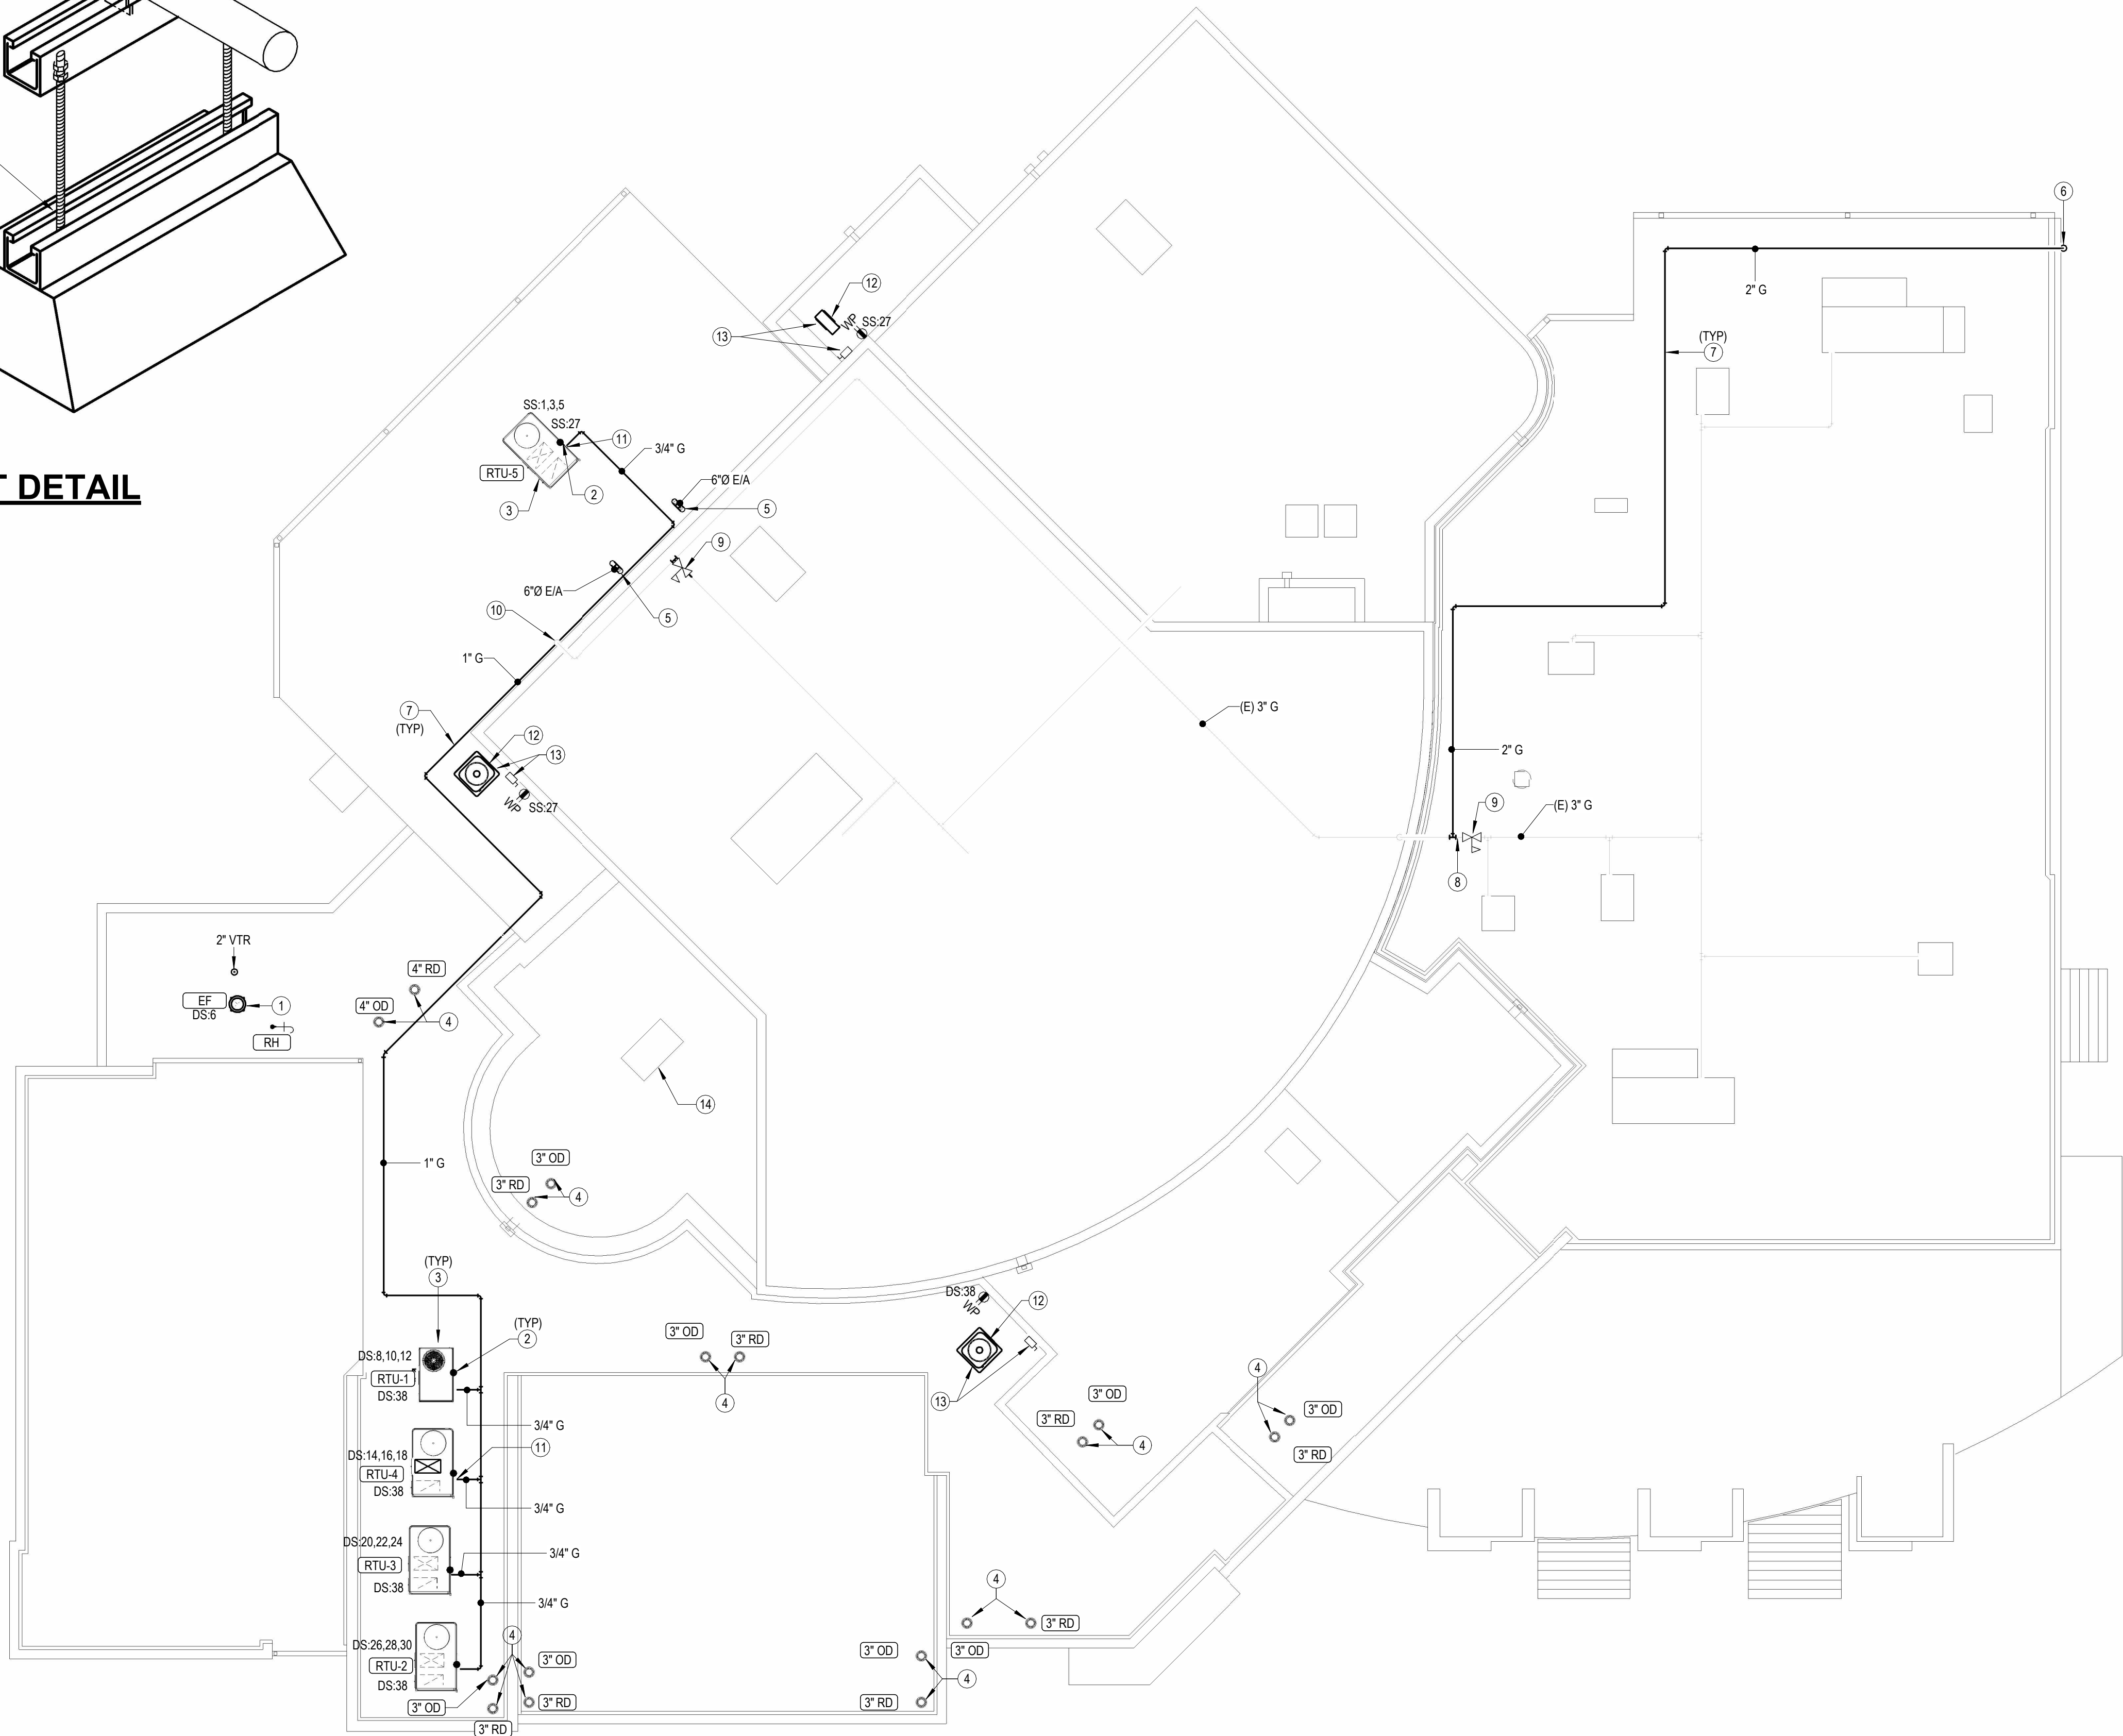

**A MECHANICAL/ELECTRICAL ROOF PLAN**  
3/32" = 1'-0"








NOTES BY SYMBOL

- 1 CONNECT FULL SIZE DUCT TO ROOFTOP UNIT. TRANSITION IN VERTICAL AS REQUIRED.
- 2 INSTALL SUPPLY GRILLES ON BOTTOM OF FLAT OVAL DUCT IN THIS AREA.
- 3 INSTALL SPIRAL DUCT AND DIFFUSERS PER DETAIL.
- 4 EXTEND RETURN DUCT TO 6" FROM DECK AND TERMINATE WITH EXPANDED METAL GRATE.
- 5 STUB RETURN AIR INTO PLENUM.
- 6 PROVIDE TEMPERATURE SENSOR FOR NEW ROOFTOP UNIT. INTEGRATE NEW ROOFTOP UNIT INTO EXISTING TRANE BAS.

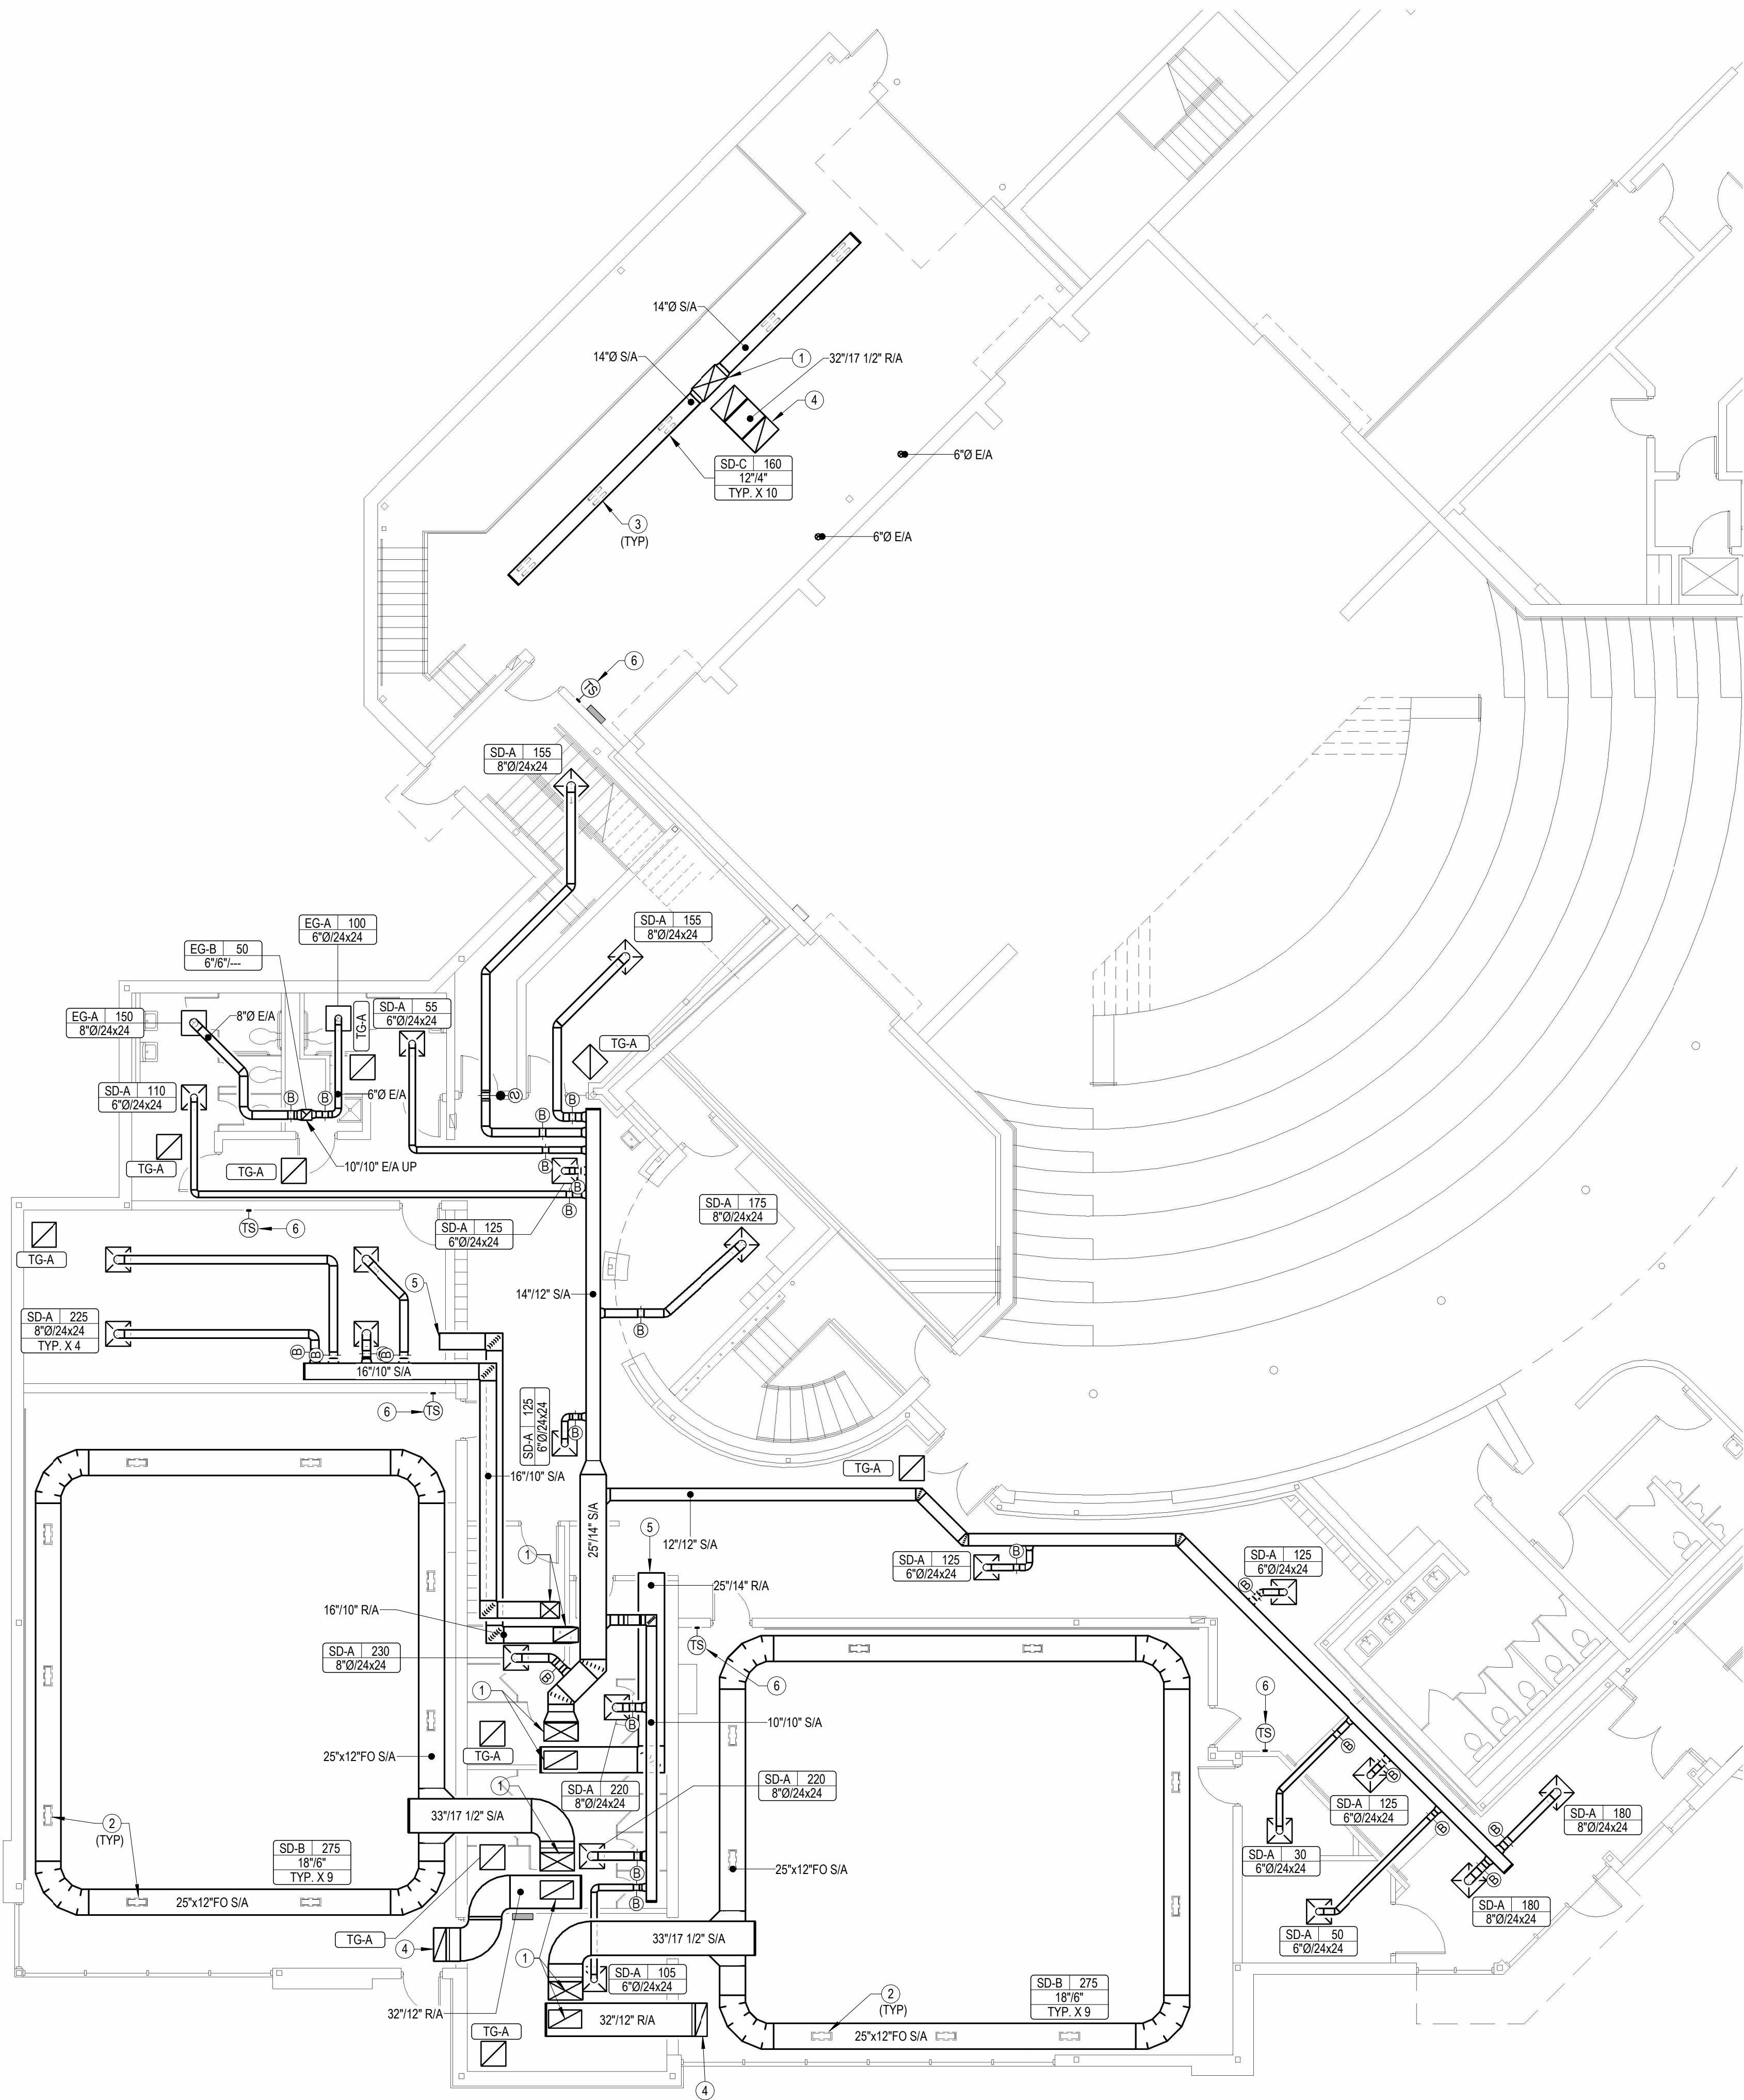

A

**HVAC PLAN - MAIN LEVEL**

1/8" = 1'-0"

COORDINATED DUCTWORK SHOP DRAWINGS SHALL BE PREPARED AND SUBMITTED FOR REVIEW PRIOR TO INSTALLATION. SHOP DRAWINGS SHALL SHOW DUCT ROUTING, ELEVATIONS, FITTINGS, AND COORDINATION WITH STRUCTURE, PIPING, ELECTRICAL, AND OTHER BUILDING SYSTEMS. DO NOT BEGIN DUCTWORK FABRICATION OR INSTALLATION UNTIL COORDINATION IS COMPLETE AND SHOP DRAWINGS HAVE BEEN REVIEWED.



REVISIONS:

NO DATE REVISION

DATE: 9-18-2026

JOB: 22-3239

SHEET NO.:

M1.1

COPYRIGHTED

THEATRE SALINA

DANCE STUDIOS & SCENE SHOP EXPANSION

SALINA

KANSAS

JonesGillamRenz  
1881 Main Street, Suite 301  
Salina, KS 67401  
785.827.0386  
jg@jgarchitects.com


JGR



NOTES:																		
1. PROVIDE WITH HAIL GUARDS. 2. PROVIDE WITH DRY BULB ECONOMIZER WITH BAROMETRIC RELIEF. 3. PROVIDE WITH 2" MERV 8 PLEATED FILTERS. 4. PROVIDE WITH HINGED SERVICE ACCESS PANELS. 5. PROVIDE WITH ROOF CURB COMPATIBLE WITH ROOF TYPE AND SLOPE, COORDINATE WITH G.C. 6. PROVIDE WITH THROUGH BASE ELECTRICAL, FACTORY INSTALLED AND WIRED DISCONNECT SWITCH, AND FIELD WIRED CONVENIENCE OUTLET. 7. PROVIDE WITH DEHUMIDIFICATION OPTION WITH HOT GAS REHEAT COIL AND RETURN DUCT MOUNTED HUMIDISTAT. 8. UNIT TO BE INTEGRATED INTO EXISTING TRANE BAS SYSTEM. PROVIDE UNITS WITH BACNET CARD OR MODULE FOR INTEGRATION.																		
MARK	MANUFACTURER	MODEL	OA INTAKE	SUPPLY FAN			NET COOLING			OUTDOOR DB	FUEL TYPE	HEATING		WEIGHT	VOLTS/PH	MCA	MOCP	NOTES
				AIRFLOW	ESP	HP	TOTAL	EAT DB/WB	INPUT			OUTPUT						
RTU-1	TRANE	YHK036A3S0L	235 CFM	900 CFM	0.75 in-wg	0.75	22,170 Btu/h	33,370 Btu/h	80 °F/67 °F	105 °F	NG	80,000 Btu/h	64,800 Btu/h	748 lb	208 V / 3	23.0 A	30.0 A	1,2,3,4,5,6,7,8
RTU-2	TRANE	YSK090A3S0L	405 CFM	2,475 CFM	0.75 in-wg	3	60,750 Btu/h	82,770 Btu/h	80 °F/67 °F	105 °F	NG	120,000 Btu/h	97,200 Btu/h	1092 lb	208 V / 3	43.0 A	50.0 A	1,2,3,4,5,6,7,8
RTU-3	TRANE	YSK090A3S0L	405 CFM	2,475 CFM	0.75 in-wg	3	60,750 Btu/h	82,770 Btu/h	80 °F/67 °F	105 °F	NG	120,000 Btu/h	97,200 Btu/h	1092 lb	208 V / 3	43.0 A	50.0 A	1,2,3,4,5,6,7,8
RTU-4	TRANE	YSK090A3S0L	605 CFM	2,475 CFM	0.75 in-wg	3	60,750 Btu/h	82,770 Btu/h	80 °F/67 °F	105 °F	NG	120,000 Btu/h	97,200 Btu/h	1092 lb	208 V / 3	43.0 A	50.0 A	1,2,3,4,5,6,7,8
RTU-5	TRANE	YHK048A3S0L	280 CFM	1,600 CFM	0.75 in-wg	3	35,450 Btu/h	45,790 Btu/h	80 °F/67 °F	105 °F	NG	80,000 Btu/h	64,800 Btu/h	944 lb	208 V / 3	32.0 A	45.0 A	1,2,3,4,5,6,7,8

EXHAUST FAN SCHEDULE					
<b>NOTES:</b> 1. PROVIDE INTEGRAL DISCONNECT SWITCH. 2. PROVIDE WITH INTEGRAL BACKRAFT DAMPER. 3. PROVIDE WITH SPEED CONTROLLER. 4. PROVIDE INSULATED ROOF CURB COMPATIBLE WITH ROOF CONSTRUCTION.					
MARK	MANUFACTURER	AIRFLOW	ESP	VOLTAGE	HP
EF	GREENHECK	300 CFM	0.38 in-wg	115 V	0.17 hp

<b>GENERAL</b> • MAXIMUM NOISE CRITERIA SHALL BE 25. <b>AL</b> • RUNOUTS TO DIFFUSERS SHALL BE SAME SIZE AS NECK, U.N.O. • PAINT OBJECTS VISIBLE THROUGH GRILLES WITH FLAT BLACK PAINT. • PROVIDE MOUNTING FRAME AS REQUIRED FOR CEILING TYPE. COORDINATE WITH ARCHITECT. • CEILING DEVICES SHALL HAVE 4-WAY ADJUSTABLE BLOW PATTERN U.N.O. • COORDINATE DEVICE LOCATIONS WITH ARCHITECTURAL CEILING PLANS AND ELEVATIONS.						
MARK	MANUFACTURER	MODEL	MATERIAL	FINISH	DESCRIPTION	NOTES
EG-A	TITUS	PAR-AA	ALUMINUM	WHITE ENAMEL	CEILING EXHAUST GRILLE	
EG-B	TITUS	350RL	STEEL	WHITE ENAMEL	DUCT MOUNTED EXHAUST REGISTER	
SD-A	TITUS	TMS	STEEL	WHITE ENAMEL	CEILING MOUNTED SUPPLY	
SD-B	TITUS	300R	STEEL	WHITE ENAMEL	DUCT MOUNTED SUPPLY GRILLE	
SD-C	TITUS	S300FL	ALUMINUM	MILL	SPIRAL DUCT MOUNTED SUPPLY GRILLE	
TG-	TITUS	PXP	STEEL	WHITE ENAMEL	NON-DUCTED 2 x 2 PERFORATED GRILLE	PROVIDE RCP SOUND CANOPY
TG-A	TITUS	PXP	STEEL	WHITE ENAMEL	NON-DUCTED 2 x 2 PERFORATED GRILLE	PROVIDE RCP SOUND CANOPY

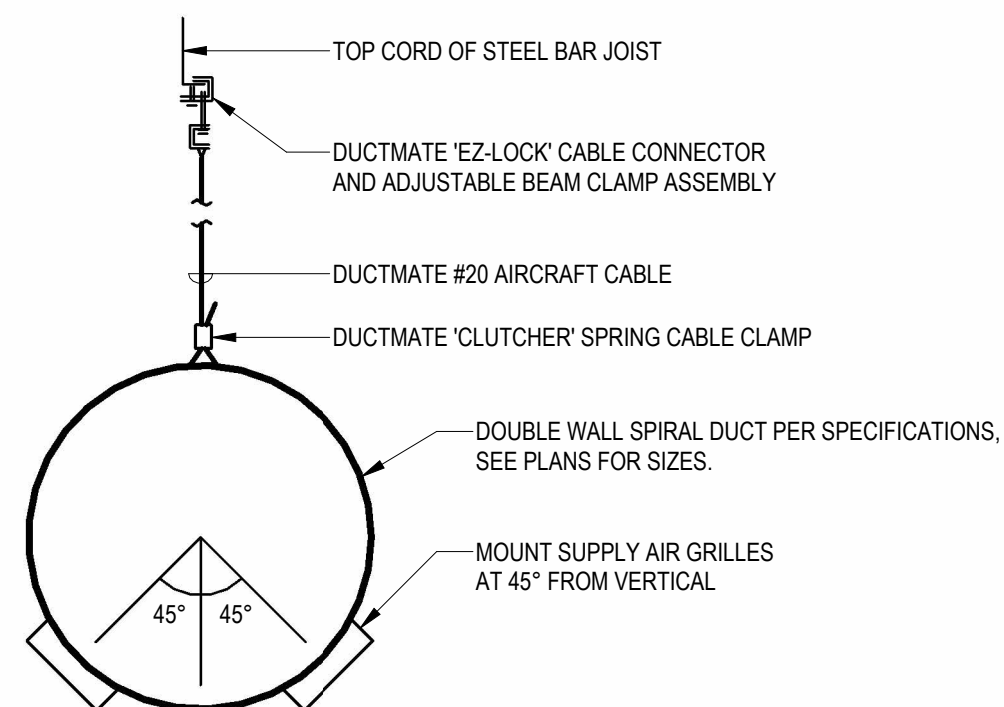


## A SPIRAL DUCT INSTALLATION DETAIL


- TYPICAL INSTALLATION DETAILS:**
- A. RETAINING ANGLES: MINIMUM  $1\text{'}/2\text{'}$ " X  $1\text{'}/2\text{'}$ " X 0.054 (16 GA)
  - B. CLEARANCE:  $1/8\text{'}$ " PER LINEAR FOOT BOTH DIMENSIONS.
  - C. STEEL SLEEVE PER SMACNA
  - D. APPROVED FIRE/SMOKE DAMPER
  - E. SECURE RETAINING ANGLES TO SLEEVE ONLY:
    - $1/2\text{'}$ " 8 CENTER WITH
    - $1/2\text{'}$ " LONG WELDS, OR
    - $1/4\text{'}$ " BOLTS & NUTS, OR
    - #10 STEEL SCREWS, OR
    - MIN.  $3/16\text{'}$ " STEEL RIVETS
  - F. SECURE DAMPER TO SLEEVE ON 8" CENTER WITH:
    - $1/2\text{'}$ " LONG WELDS, OR
    - $1/4\text{'}$ " BOLTS & NUTS IN HOLES PROVIDED, OR
    - #10 STEEL SCREWS, OR
    - MIN.  $3/16\text{'}$ " STEEL RIVETS
  - G. CONNECT DUCT TO SLEEVE WITH BREAK-AWAY JOINT AS PER SMACNA
  - H. INSTALL ACCESS DOOR OR PANEL

### MANUFACTURER'S INSTALLATION DETAILS


THE FIRE/SMOKE DAMPER MANUFACTURERS' INSTALLATION DETAILS AND INSTRUCTIONS AS TESTED AND APPROVED BY U.L. MUST BE USED IN LIEU OF THE ABOVE DETAILS WHERE APPLICABLE

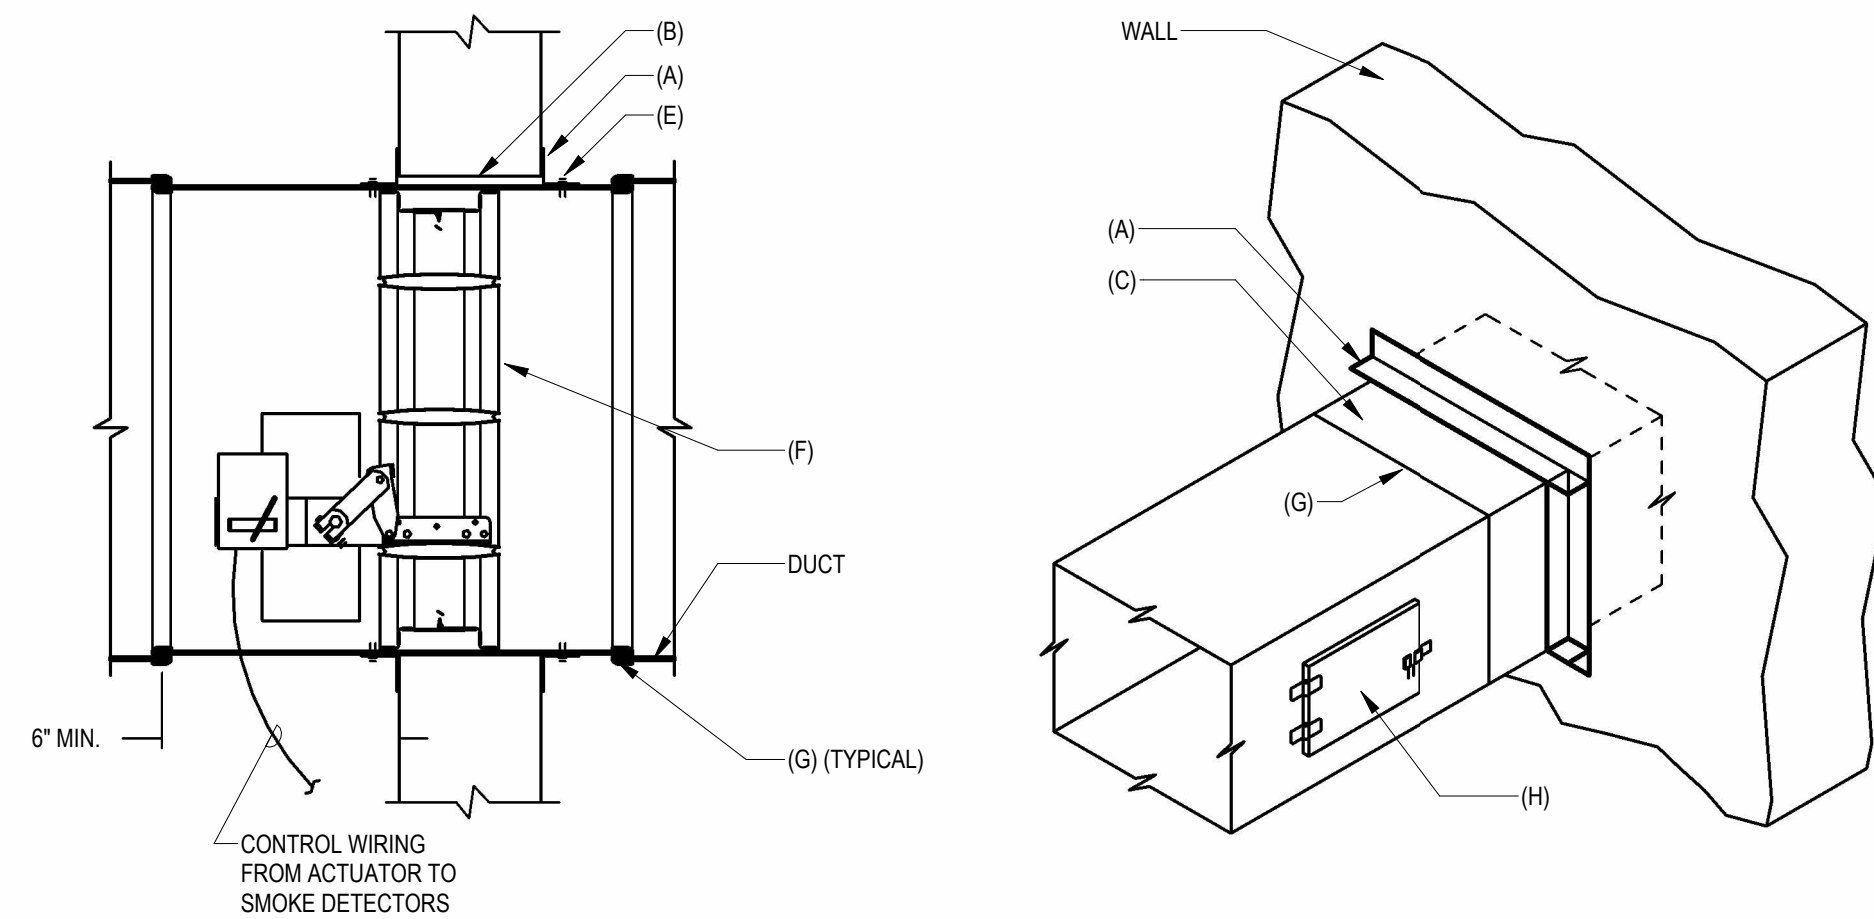


## B FIRE SMOKE DAMPER INSTALLATION DETAIL

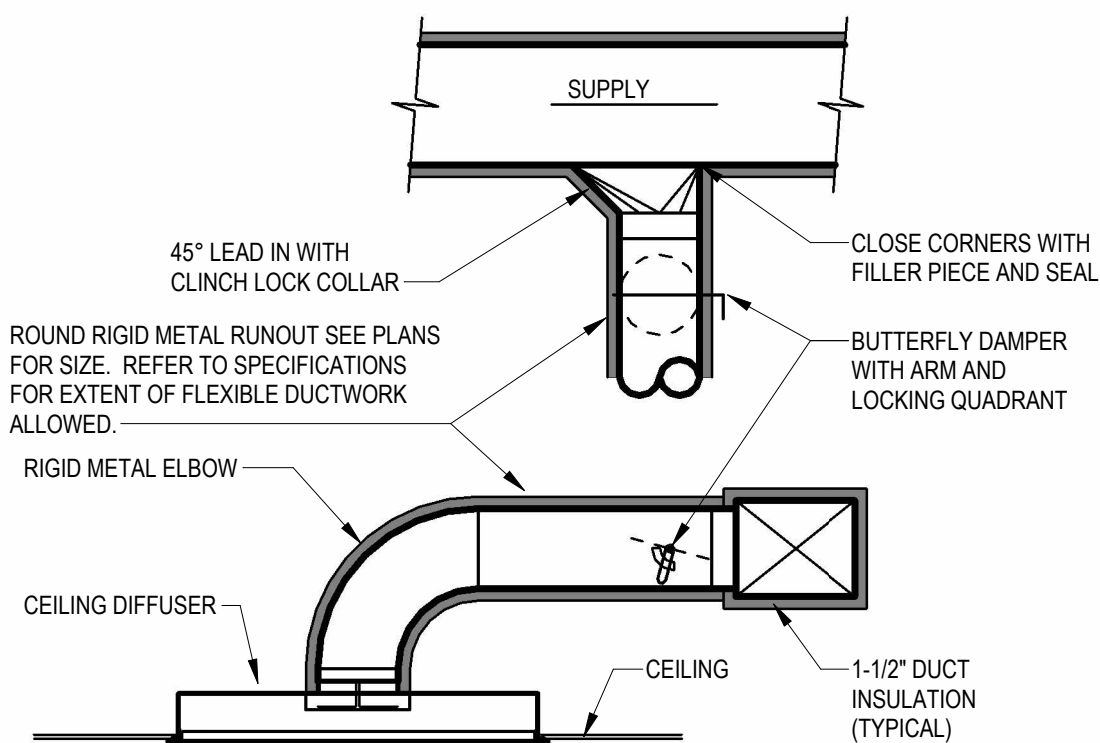


## C DIFFUSER INSTALLATION DETAIL

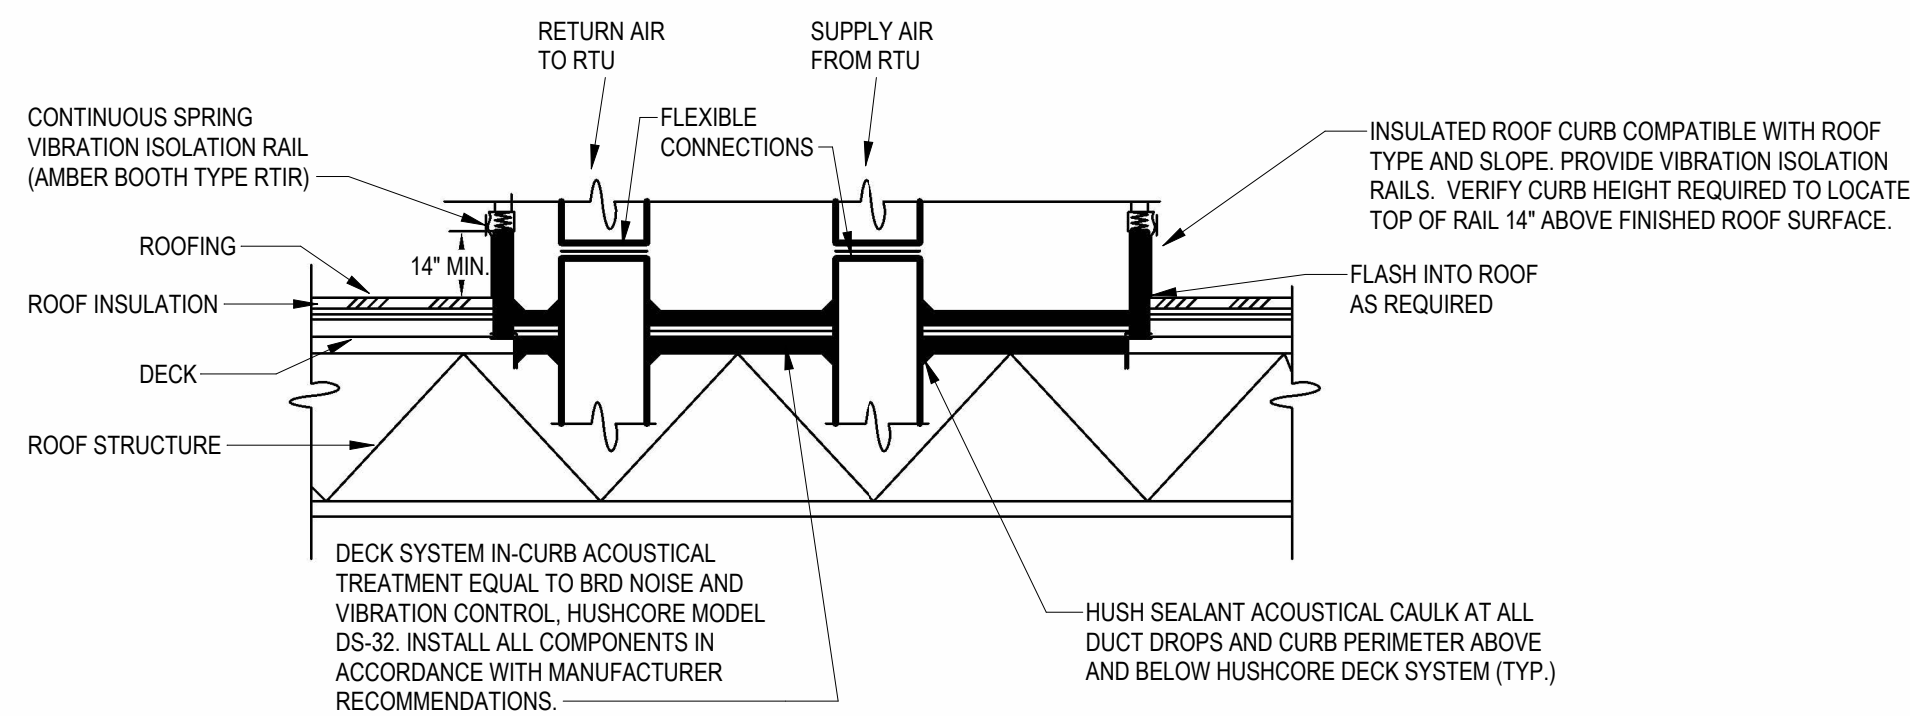

**D** **RTU INSTALLATION DETAIL**  
NO SCALE

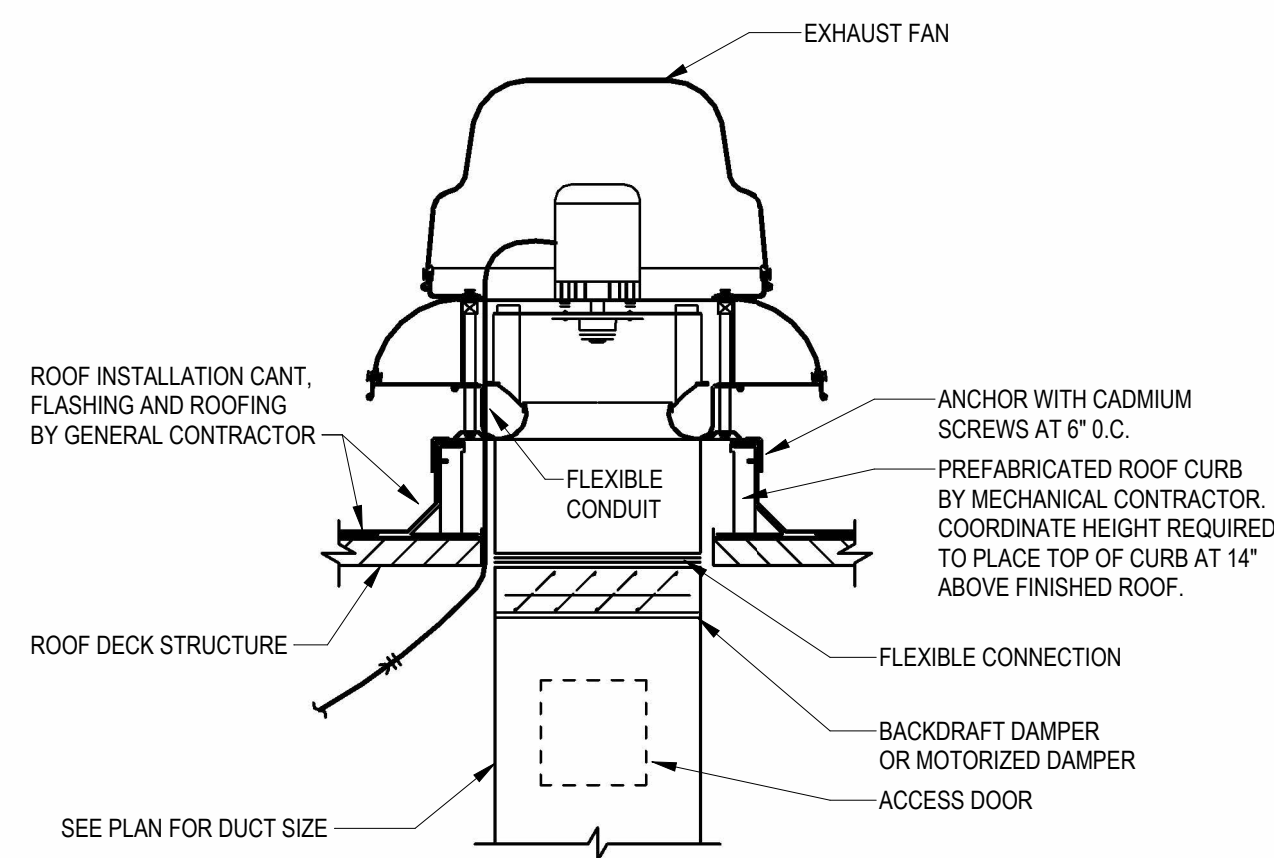

## E EXHAUST FAN DETAIL

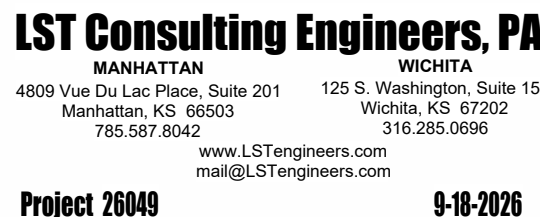

# THEATRE SALINA

## DANCE STUDIOS & SCENE SHOP EXPANSION

# SALINA

# KANSAS

**JonesGillamRenz**  
730 N. Ninth  
Salina, KS 67401  
785.827.0386  
1881 Main Street, Suite 301  
Kansas City, MO 64108  
jgr@jgrarchitects.com



REVISIONS:		
NO	DATE	REVISION

**DATE:** 9-18-2026

**JOB:** 22-3239

**SHEET NO.:**

## M-6.1

COPYRIGHT ©





**LST Consulting Engineers, PA**

<b>MANHATTAN</b>	<b>WICHITA</b>
4809 Vus Du Lac Place, Suite 201 Manhattan, KS 66503 785.587.8042	125 S. Washington, Suite 150 Wichita, KS 67202 316.285.0696

[www.LSTengineers.com](http://www.LSTengineers.com)  
[mail@LSTengineers.com](mailto:mail@LSTengineers.com)

**Project 26049** **9-18-2026**

9-18-2026

730 N. Ninth  
Salina, KS 67401  
785.827.0386

)

# KANSAS

# THEATRE SALINA

## DANCE STUDIOS & SCENE SHOP EXPANSION

# SALINA



NO	DATE	REVISION
----	------	----------

**DATE:** 9-18-2026

**JOB:** 22-3239

**SHEET NO.:**


## PP0.1

COPYRIGHTED ©

General Plan Symbols	
	Plan Revision Number
	Detail Number on Sheet
	Sheet Number Where Detail is Placed
	Keynote Symbol
	Continuation Symbol
	Point Where New Connects To Existing
	Room Name / Number
	Area Being Demolished
	Area Not In Contract
	Electrical Equipment. Do not route HVAC installation above or below equipment. Maintain working clearances as indicated by dashed line.
Abbreviations	
Ø ROUND ABV ABOVE ACR AIR CONDITIONING AD AREA DRAIN ADD ADDENDUM AFF ABOVE FINISHED FLOOR AFUE ANNUAL FUEL UTILIZATION EFFICIENCY ALT ALTERNATE AP ACCESS PANEL ARCH ARCHITECT/ARCHITECTURAL BFF BELOW FINISHED FLOOR BLW BELOW BTU BRITISH THERMAL UNITS BTUH BRITISH THERMAL UNITS PER HOUR CAP CAPACITY CB CATCH BASIN CFM CUBIC FEET PER MINUTE CLG CEILING CO CLEAN OUT CW COLD WATER D DEGREE DB DRY BULB DIA DIAMETER DN DOWN DW DISTILLED WATER EA EACH EAT ENTERING AIR TEMPERATURE ELEC ELECTRICAL EQUIP EQUIPMENT EWEC ELECTRIC WATER COOLER EXT EXTERIOR WATER TEMPERATURE E/A EXHAUST AIR EXIST EXISTING F DEGREES FAHRENHEIT FCO FLOOR CLEAN OUT FD FLOOR DRAIN FDC FIRE DEPARTMENT CONNECTION FL FLOOR FO FUEL OIL FOV FUEL OIL VENT FOR FUEL OIL RETURN FOS FUEL OIL SUPPLY FPM FEET PER MINUTE FS FLOOR SINK FT FOOT/FEET FTR FIN TUBE RADIATION GAL GALLON GF GAS-FIRED GC GENERAL CONTRACTOR GPM GALLONS PER MINUTE GW GREASE WASTE HB HOSE BIB HP HORSE POWER HTG HEATING HTR HEATER HW HOT WATER HYD HYDRANT ID INCH INV INVERT LBOUND LBOUND LBHR POUNDS PER HOUR LAT LEAVING AIR TEMPERATURE LP LOW PRESSURE LPG LIQUEFIED PETROLEUM GAS	LVR LOUVER LWT LEAVING WATER TEMPERATURE M/A MIXED AIR MAX MAXIMUM MBH ONE THOUSAND BTU PER HOUR MCF ONE THOUSAND CUBIC FEET MD MOTORIZED DAMPER MECH MECHANICAL MFR MANUFACTURER MIN MINIMUM MISC MISCELLANEOUS MTR MOTOR MUJA MAKE-UP/AIR NC NORMALLY CLOSED NIC NOT IN CONTRACT NO NUMBER NO NORMALLY OPEN NTS NOT TO SCALE O OXYGEN O/A OUTSIDE AIR ORD OVERFLOW ROOF DRAIN PD PRESSURE DROP PIV POST INDICATOR VALVE PLBG PLUMBING PRESS PRESSURE PRV PRESSURE REDUCING VALVE PSI POUNDS PER SQUARE INCH PPS POUNDS PER SQUARE INCH GAUGE PWR POWER R DUCT RISER R/A RETURN AIR RCP RADIANT CEILING PANEL RD ROOF DRAIN REC RECESSED RED REDUCER RH RELATIVE HUMIDITY RLA RELIEF AIR RM ROOM RPM REVOLUTIONS PER MINUTE RW RAIN WATER SF SQUARE FOOT S/A SUPPLY AIR SAN SANITARY SF SQUARE FOOT SD SMOKE DAMPER SM SURFACE MOUNT SP STANDPIPE SP STATIC PRESSURE STM STEAM T THERMOSTAT TD TEMPERATURE DROP TDR TRENCH DRAIN TEMP TEMPERATURE TYP TYPICAL UG UNDERGROUND VG VACUUM V VENT VAV VARIABLE AIR VOLUME VENT VENTILATION VTR VENT THROUGH ROOF W WASTE WB WET BULB WCO WALL CLEAN OUT WH WALL HYDRANT
Equipment Abbreviations	
AC AIR CONDITIONING UNIT ACCU AIR COOLING CONDENSING UNIT AHU AIR HANDLING UNIT AS AIR SEPARATOR B BOILER CH CHILLER CT COOLING TOWER CUH CABINET UNIT HEATER CHWP CHILLED WATER PUMP DBP DOMESTIC WATER BOOSTER PUMP DC DUCT MOUNTED COIL DCP DOMESTIC WATER CIRCULATING PUMP EP EXHAUST FAN EDC ELECTRIC DUCT COIL	EH EXPANSION TANK EWH ELECTRIC WATER HEATER FCU FAN COIL UNIT FP FIRE PUMP GI GREASE INTERCEPTOR GRV GRAVITY ROOF VENTILATOR HWP HEATING WATER PUMP HRU HEAT RECOVERY UNIT PRV POWER ROOF VENTILATOR RE RETURN/EXHAUST FAN RTU ROOFTOP UNIT SP SUMP PUMP UH UNIT HEATER WH WATER HEATER
* NOTE *   ALL OF GENERAL NOTES ON THIS SHEET ARE TO BE APPLIED TO ALL OTHER DRAWINGS IN THIS SET. THE SYMBOLS AND ABBREVIATIONS SHOWN ON THIS SHEET MAY OR MAY NOT BE USED IN THIS SET OF DRAWINGS.	

Plumbing Symbols	
	Nominal Pipe Size
	Above Ground Piping
	Below Ground Piping
	Pipe Slope (When Applicable)
	Existing Pipe To Remain
	Pipe To Be Demolished
	Domestic Cold-Water
	Non-Potable Water
	Soft Cold-Water
	Filtered Cold-Water
	Reverse Osmosis Water
	Domestic Hot-Water
	Domestic Hot-Water 140°
	Hot-Water Recirculation
	Hot-Water Recirculation 140°
	Sanitary Drain
	Sanitary Vent
	Sanitary Wet Vent
	Combination DWV
	Condensate Drain
	Indirect Drain
	Grease Waste
	Grease Vent
	Pump Discharge
	Storm Drain
	Storm Overflow
	Compressed Air
	Natural Gas
	Liquid Propane
	Pipe Rise / Drop
Pipe Accessory Notes	
	Cleanout
	Check Valve
	Balancing Valve
	Circuit Setter
	Gate Valve
	Ball Valve
	Fluid Strainer
	Emergency Gas Shutoff
	Plug Valve
	Gas Shutoff Cock
	Gas Regulator
	Thermostatic Valve
	Mixing Valve
	Emergency Mixer
	Pressure Reducing Valve
	Water Meter
	Double Check Valve
	Reduced Pressure Zone
Plumbing Fixture Notes	
Floor Drain	Design Size
	Identity Type
	Drainage Fixture Units
	Floor Drain w/ Deep Seal Trap
	Floor Drain w/ Trap Primer
"P" Indicates Primer Connection	"P" Indicates Primer Connection
	Floor Drain w/ Integral Cleanout
	Area Drain (No Trap)
	Deck Drain
	Hub Drain (Funnel Type)
	Floor Sink
	Roof Drain
	Combination Drain Rainfall Surface Area



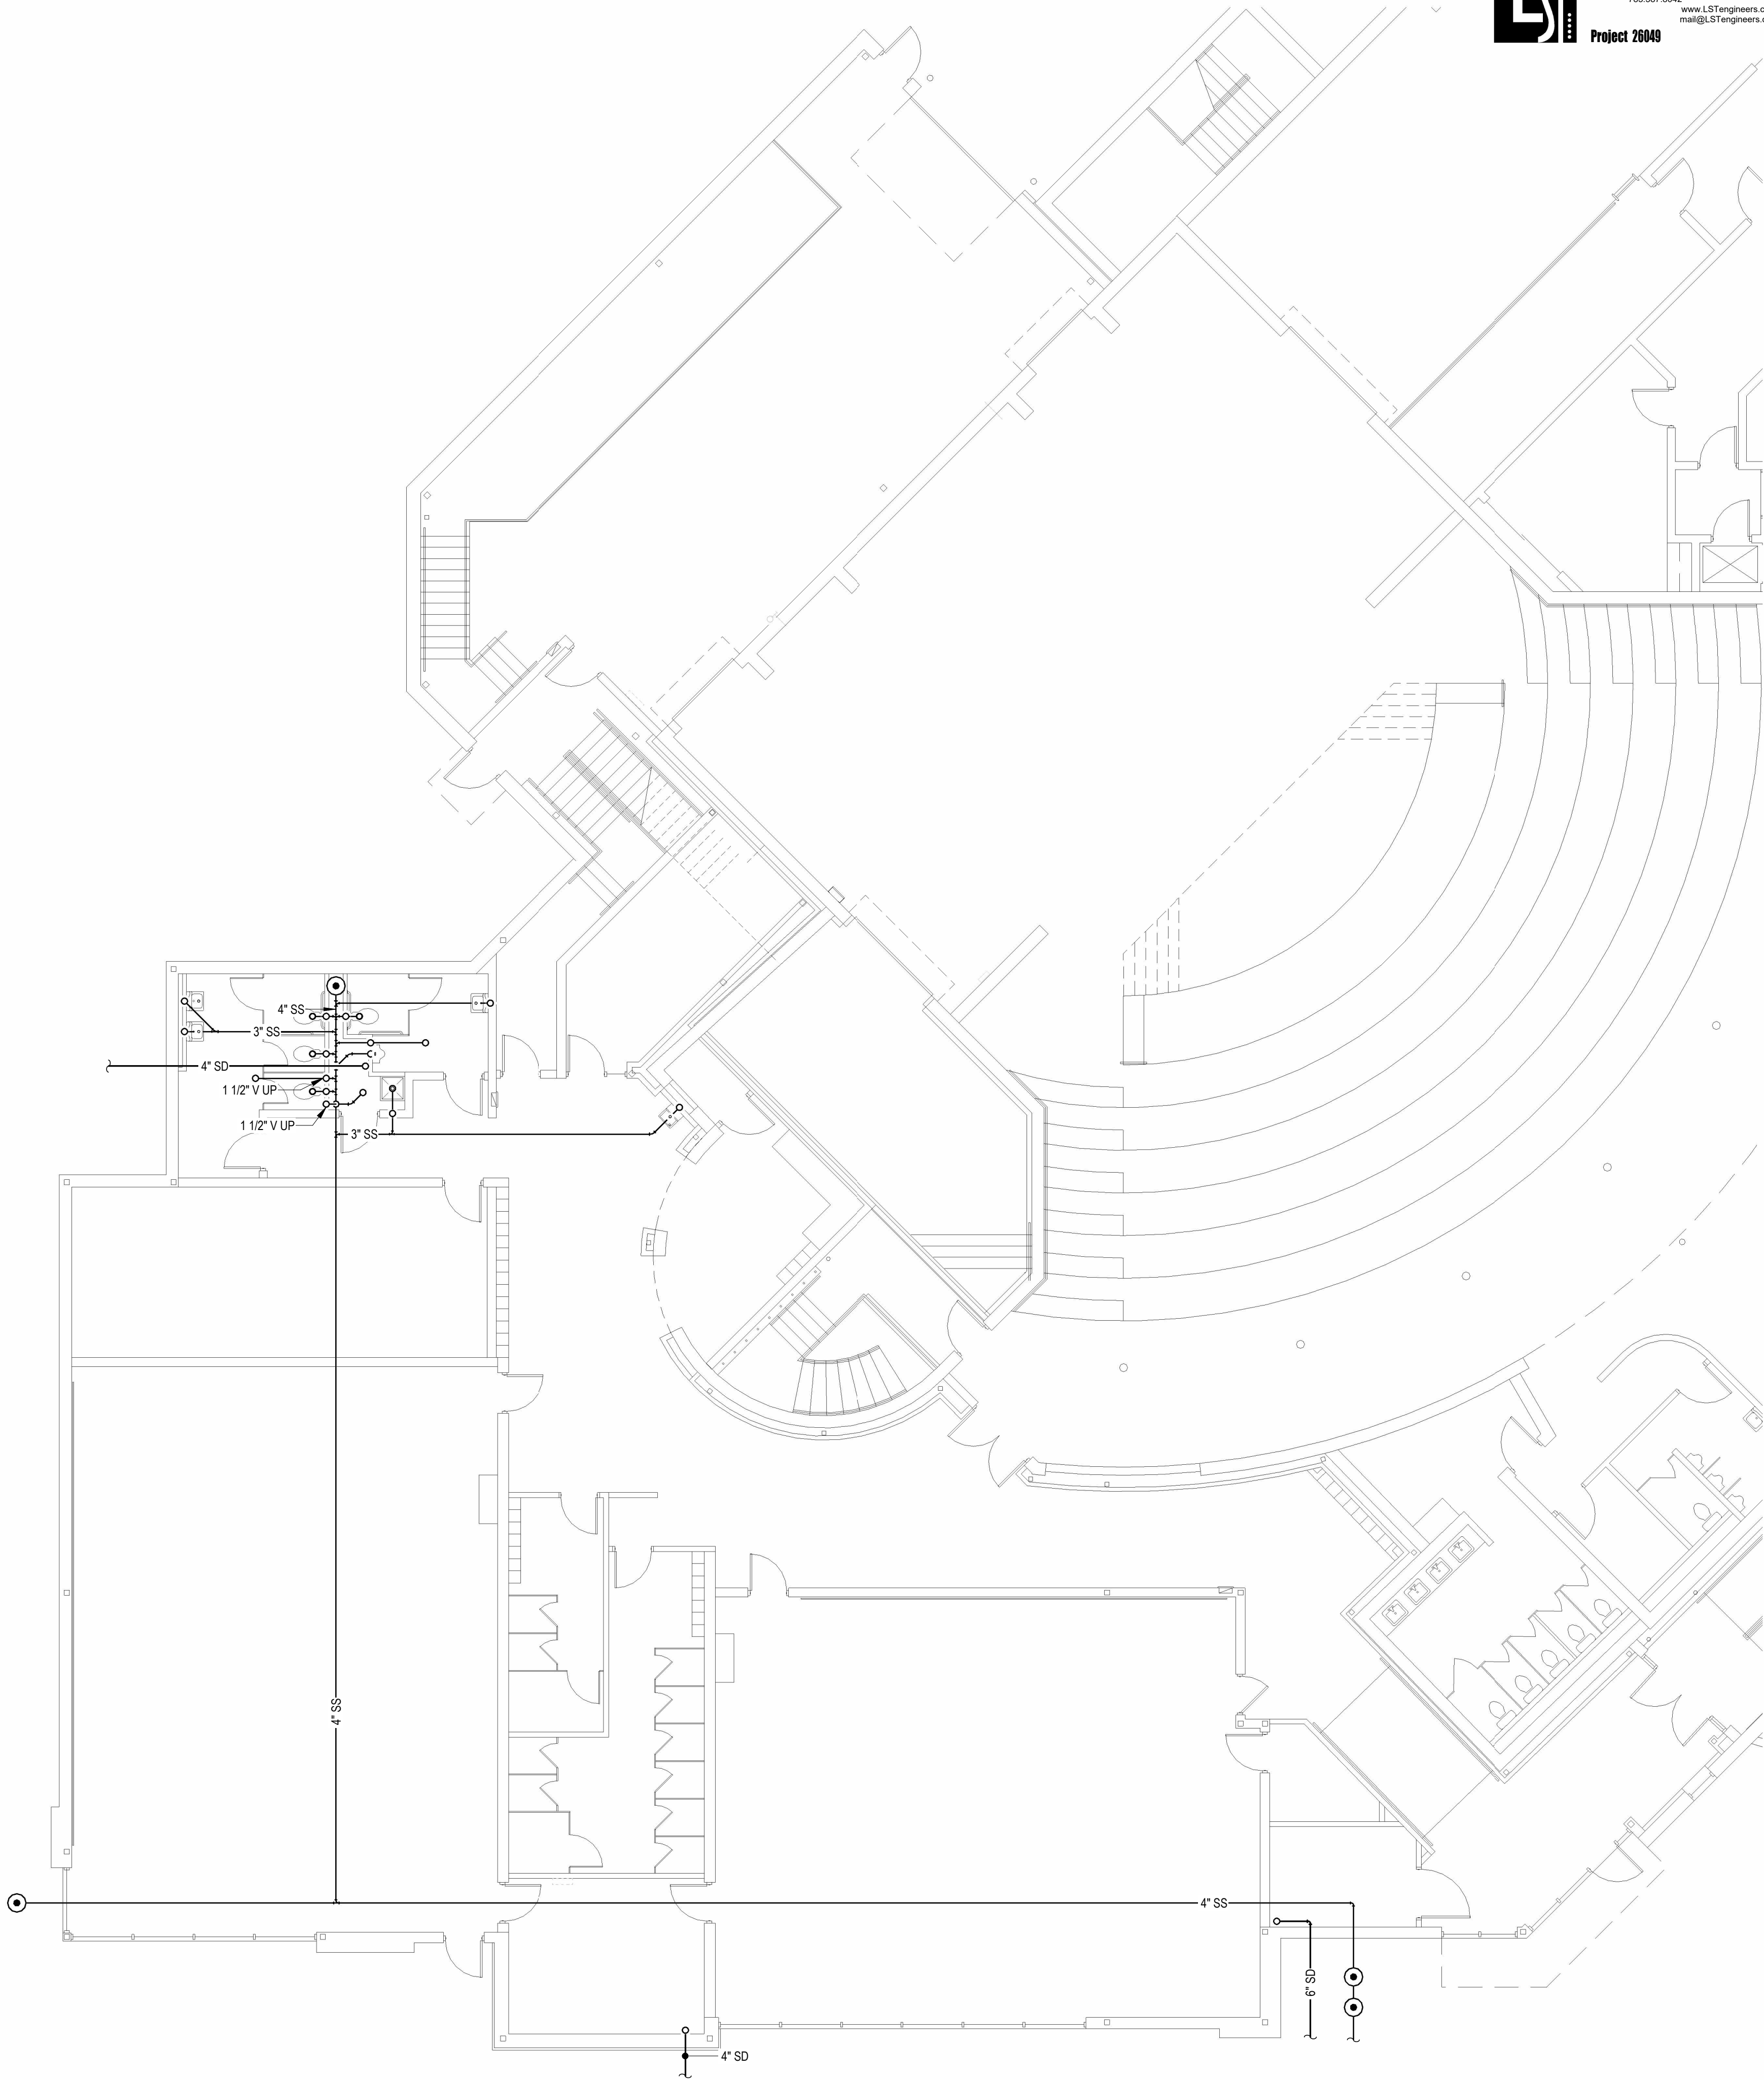

A

**DRAIN AND VENT PLAN - UNDERFLOOR**

1/8" = 1'-0"



REVISIONS:		
NO	DATE	REVISION

DATE: 9-18-2026  
JOB: 22-3239  
SHEET NO.:

PP1.1

COPYRIGHTED ©

THEATRE SALINA

DANCE STUDIOS & SCENE SHOP EXPANSION

SALINA

KANSAS

JGR JonesGillamRenz  
730 N. Ninth  
Salina, KS 67401  
785.827.0386  
jg@jgarchitects.com









NOTES BY SYMBOL


- 1 3/4" COLD WATER UP TO ROOF HYDRANT. PROVIDE DEDICATED 1/2" DRAIN LINE FROM HYDRANT TO SERVICE SINK IN JANITOR CLOSET. COORDINATE ROUTING AND TERMINATION WITH G.C.
- 2 CONNECT TO EXISTING 2" OR LARGER DOMESTIC COLD WATER IN CHASE. PROVIDE ACCESSIBLE SHUTOFF BALL VALVE.

**THEATRE SALINA**

DANCE STUDIOS & SCENE SHOP EXPANSION

KANSAS

SALINA

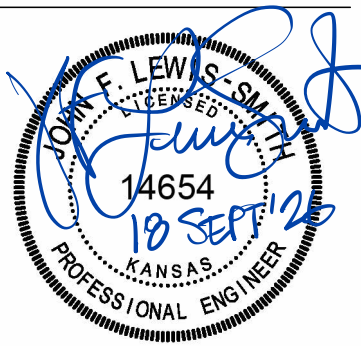


REVISIONS:		
NO	DATE	REVISION

DATE: 9-18-2026  
JOB: 22-3239  
SHEET NO.:

COORDINATE ALL PIPE ROUTING WITH STRUCTURE,  
PIPING, ELECTRICAL, AND OTHER BUILDING SYSTEMS.  
DO NOT BEGIN PIPE INSTALLATION UNTIL  
COORDINATION IS COMPLETE.

PP1.3

COPYRIGHTED ©

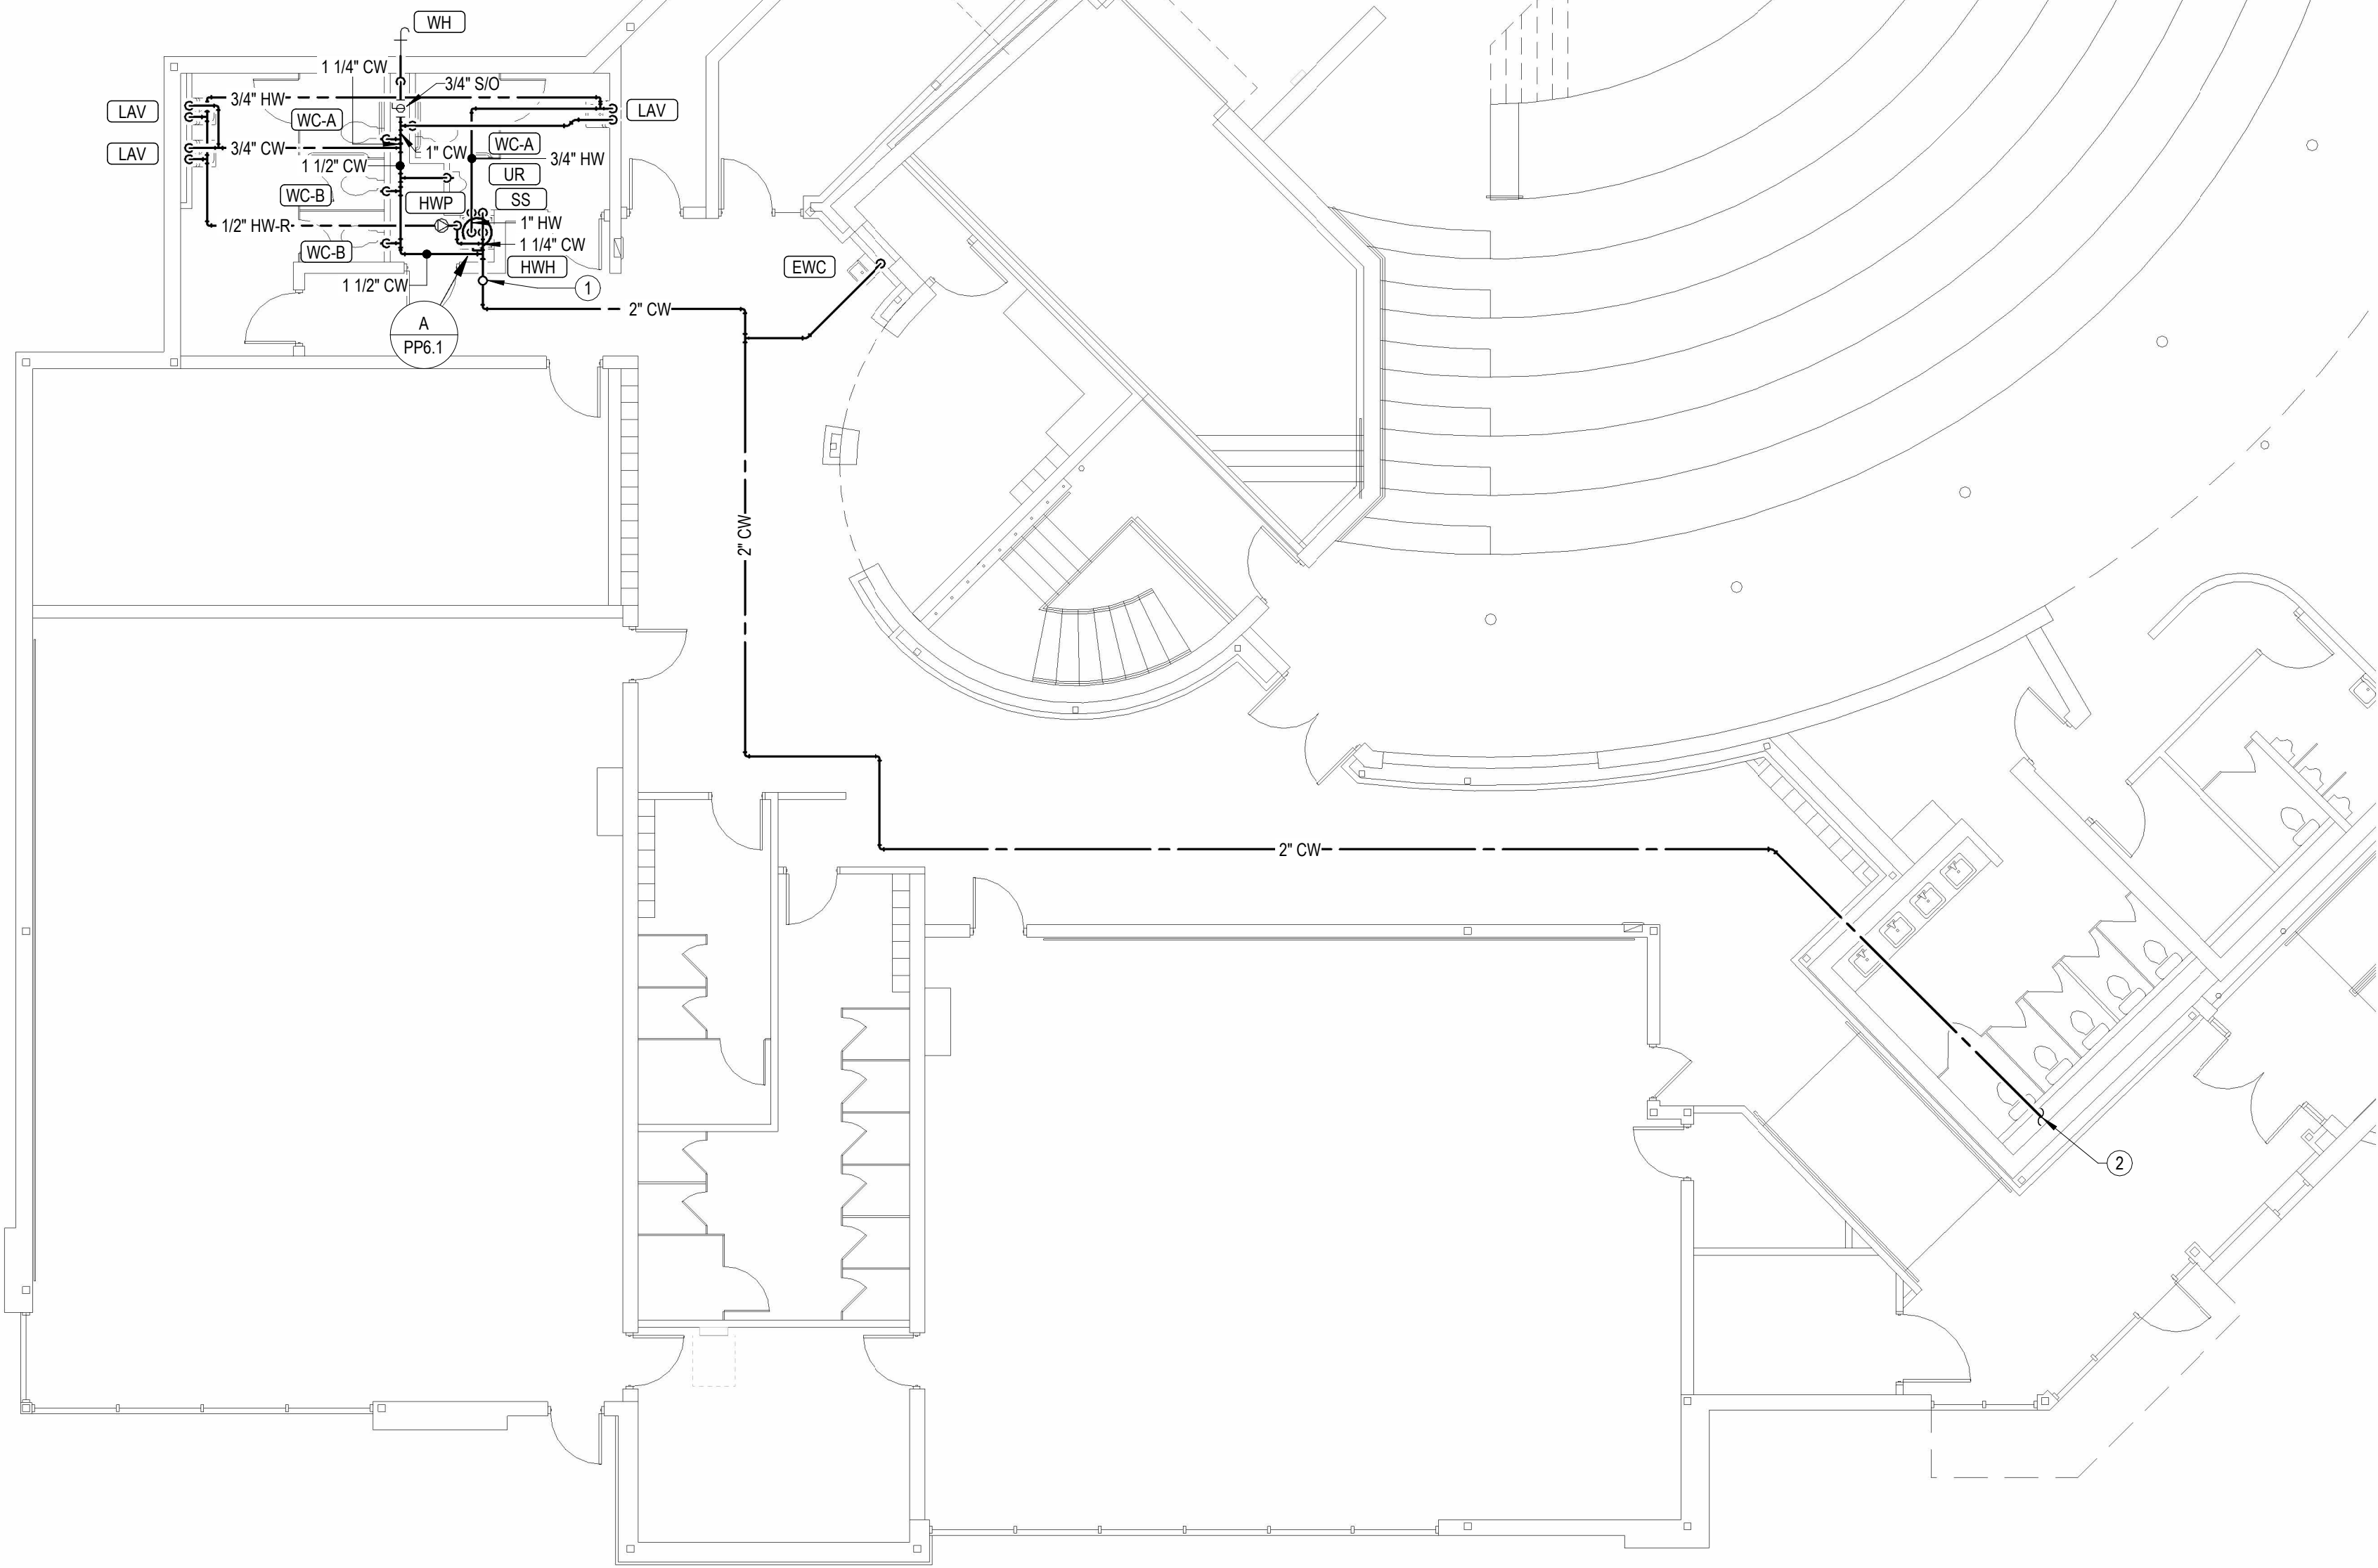

**A**

**DOMESTIC WATER AND GAS PLAN - MAIN LEVEL**

1/8" = 1'-0"



WATER HEATER SCHEDULE

NOTES: 1. PROVIDE WALL HUNG PLATFORM FOR WATER HEATER EQUAL TO HOLDRITE #40SQHP-W. COORDINATE EXACT LOCATION AND MOUNTING HEIGHT WITH ARCHITECT.								
MARK	MANUFACTURER	MODEL	STORAGE	RECOVERY		ELECTRIC HEAT	VOLTAGE/PHASE	DESCRIPTION
				CAPACITY	TEMP. RISE			
HWH	AO SMITH	EJC-10	10 gal	0.3 GPM	90 °F	1650 W	120 V/1	ELECTRIC WATER HEATER, SUPPLIED WITH TEMPERATURE AND PRESSURE RELIEF VALVE AND BRASS DRAIN VALVE. WATER HEATER SHALL HAVE TEMPERATURE CONTROLS SET TO LIMIT SUPPLY TEMPERATURE TO 120°F OR LESS.
								1


PUMP SCHEDULE

MARK	MANUFACTURER	MODEL	FLOW	HEAD	VOLTAGE/PHASE	DESCRIPTION
HWP	BELL & GOSSETT	NBF-33	10.0 GPM	10.0 FT	120 V/1	CIRCULATION PUMP, BRONZE BODY, PROVIDE CLAMP-ON AQUASTAT FOR PUMP CONTROL.

PLUMBING FIXTURE SCHEDULE

GENERAL:		- PROVIDE FIXTURES WITH ALL TRIM NECESSARY FOR COMPLETE INSTALLATION.   - VENT SIZES ARE APPLICABLE ONLY FOR INDIVIDUAL FIXTURE VENTS WHERE ALTERNATE VENTING METHOD HAS NOT BEEN INDICATED ON PLANS.   - PROVIDE 1/4 TURN STOP VALVES ON ALL HOT AND COLD WATER SUPPLY LINE CONNECTIONS FOR FIXTURES. SHOWER VALVES SHALL HAVE INTEGRAL STOP VALVES.   - PROVIDE FLOOR DRAINS AND FLOOR SINKS WITH TRAP PRIMER OR TRAP PRIMER ALTERNATIVE EQUIVALENT TO PREVENT TRAP GUARD. PROVIDE AUTOMATIC TRAP PRIMER DEVICE WITH SINGLE OR MULTIPLE OUTLET PIPES AND ROUTE DRAINS TO PRIMER PORTS.
NOTES:		- IN AREAS OPEN TO THE PUBLIC, FIXTURE AND INSTALLATION TO MEET REQUIREMENTS OF AMERICANS WITH DISABILITIES ACT. IN APARTMENTS, FIXTURE AND INSTALLATION TO MEET REQUIREMENTS OF THE FAIR HOUSING ACT.   - PROVIDE DEARBORN SUPPLIES WITH STOPS AND EXCUTHEON PLATE, 1-1/4" CAST BRASS P-TRAP.   - INSULATE WATER AND WASTE PIPING BELOW SINK. UTILIZE INSULATION KIT EQUIVALENT TO LAVGUARD BY TRUEBRO. PROVIDE PLUMBEREX MODEL #3071WD-N WASTE DISPOSAL COVER.   - TRIM SHALL BE PROVIDED WITH POLISHED CHROME FINISH.   - TRANSITION FROM 1/8" DRAIN TUBING TO 1/2" PVC DRAIN AND TERMINATE WITH AIR GAP AT NEAREST TENANT FLOOR DRAIN.   - PLUMBING FIXTURE SELECTED BY INTERIOR DESIGNER, ALL SUBSTITUTIONS SHALL BE APPROVED BY INTERIOR DESIGNER.

MARK	MANUFACTURER	MODEL	PRODUCT DESCRIPTION	TRIM	ROUGH-IN SIZES			COLD	HOT	ADA COMPLIANT	NOTES
					DRAIN	VENT	WATER				
4" DN	WATTS	RD-943	CAST NICKEL BRONZE DOWNSPOUT NOZZLE		4"						
6" DN	WATTS	RD-943	CAST NICKEL BRONZE DOWNSPOUT NOZZLE		6"						
EWC	MURDOCK	A171108F-UG-BF12	SELF-CONTAINED WATER COOLER WITH STAINLESS STEEL BASIN, FRONT PUSH BUTTON ACTUATOR, SENSOR OPERATED BOTTLE FILLER, LEAD-FREE COOLING SYSTEM, 120 VOLTS.		2"	1 1/2"	1/2"	Yes	No	Yes	
LAV	AMERICAN STANDARD	0355.012	WALL HUNG LAVATORY, WHITE VITREOUS CHINA, 21-1/4"W X 16-1/4", FRONT OVERFLOW, FAUCET HOLES ON 4" CENTERS.	DELTA MODEL 22C151 SINGLE HANDLE FAUCET, LEONARD MODEL TM-1 POINT OF USE MIXING VALVE, PROVIDE GRID DRAIN.	2"	1 1/2"	1/2"	Yes	Yes	Yes	
3" OD	WADE	3000	CAST IRON SIDE OUTLET BODY ROOF DRAIN WITH FLANGE, FLASHING RING WITH GRAVEL STOP, UNDER DECK CLAMP AND CAST IRON DOME STRAINER.		3"						
4" OD	WADE	3000	CAST IRON SIDE OUTLET BODY ROOF DRAIN WITH FLANGE, FLASHING RING WITH GRAVEL STOP, UNDER DECK CLAMP AND CAST IRON DOME STRAINER.		4"						
3" RD	WADE	3000	CAST IRON SIDE OUTLET BODY ROOF DRAIN WITH FLANGE, FLASHING RING WITH GRAVEL STOP, UNDER DECK CLAMP AND CAST IRON DOME STRAINER.		3"						
4" RD	WADE	3000	CAST IRON SIDE OUTLET BODY ROOF DRAIN WITH FLANGE, FLASHING RING WITH GRAVEL STOP, UNDER DECK CLAMP AND CAST IRON DOME STRAINER.		4"						
RH	WOODFORD	RHY2-MS	FROST PROOF ROOF HYDRANT WITH ASSE 1052 DOUBLE CHECK BACKFLOW PREVENTER THAT IS FIELD TESTABLE, INTEGRAL VENT THAT ALLOWS DRAINAGE WITH 1/8" DRAIN HOLE DRILLED AND TAPPED IN BODY OF HYDRANT. PROVIDE WITH MANUFACTURER'S ROOF MOUNTING SYSTEM CONSISTING OF CAST IRON HYDRANT SUPPORT, UNDER DECK FLANGE, WELL SEAL, EPDM BOOT, AND SHIMS AS REQUIRED. COORDINATE INSTALLATION WITH G.C.				3/4"	Yes	No	No	
SS	FIAT	MSB-2424	ONE PIECE MOLDED STONE MOP BASIN, 24" SQUARE, STAINLESS STEEL INTEGRAL DRAIN BODY WITH CAULK CONNECTION, STAINLESS STEEL WALL GUARDS.	CHICAGO FAUCET MODEL 897-CPP FAUCET WITH HOSE THREAD OUTLET, VACUUM BREAKER SPOUT, PAIL HOOK, WALL BRACE, INTEGRAL CHECK VALVES, METAL LEVER HANDLES.	3"	1 1/2"	3/4"	Yes	Yes	No	
UR	AMERICAN STANDARD	6002.001	WALL HUNG URINAL, VITREOUS CHINA, 3/4" TOP SPUD, ELONGATED FLUSHING RIM, WASHDOWN FLUSHING ACTION, MOUNT WITH RIM AT 17" AFF.	0.125 GPF PISTON TYPE MANUAL CHROME PLATED FLUSH VALVE.	2"	2"	3/4"	Yes	No	Yes	
WC-A	AMERICAN STANDARD	3043.001	FLOOR MOUNTED FLUSH VALVE WATER CLOSET, WHITE VITREOUS CHINA, TOP SPUD 1.28 GPF, 12" ROUGH-IN, ELONGATED 16-1/2" HIGH BOWL.	1.28 GPF PISTON TYPE MANUAL CHROME PLATED FLUSH VALVE / WHITE OPEN FRONT SOFT CLOSE PLASTIC SEAT	4"	2"	1"	Yes	No	Yes	
WC-B	AMERICAN STANDARD	2234.001	FLOOR MOUNTED FLUSH VALVE WATER CLOSET, WHITE VITREOUS CHINA, TOP SPUD 1.28 GPF, 12" ROUGH-IN, ELONGATED 15" HIGH BOWL.	1.28 GPF PISTON TYPE MANUAL CHROME PLATED FLUSH VALVE / WHITE OPEN FRONT SOFT CLOSE PLASTIC SEAT	4"	2"	1"	Yes	No	No	
WH	WOODFORD	B67	AUTOMATIC DRAINING FREEZELESS WALL HYDRANT WITH ASSE 1052 DOUBLE CHECK BACKFLOW PREVENTOR, LOOSE TEE KEY HANDLE, WITH RECESSED BOX WITH DOOR. PROVIDE WITH CHROME PLATED EXTERIOR FINISH.				3/4"	Yes	No	No	

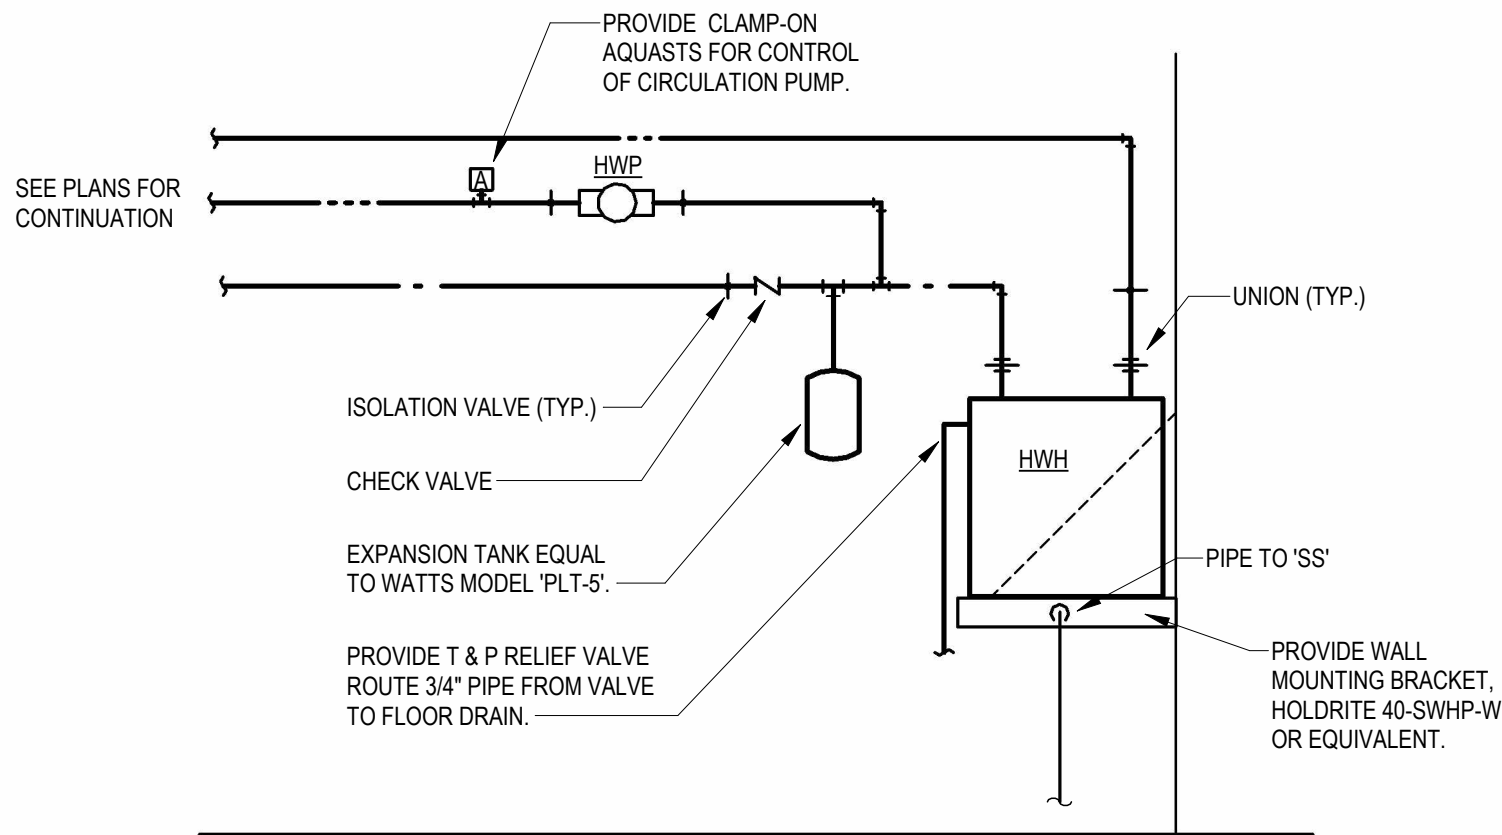

**A** **WATER HEATER INSTALLATION DETAIL**  
NO SCALE






REVISIONS:		
NO	DATE	REVISION


DATE: 9-18-2026

JOB: 22-3239

SHEET NO.:

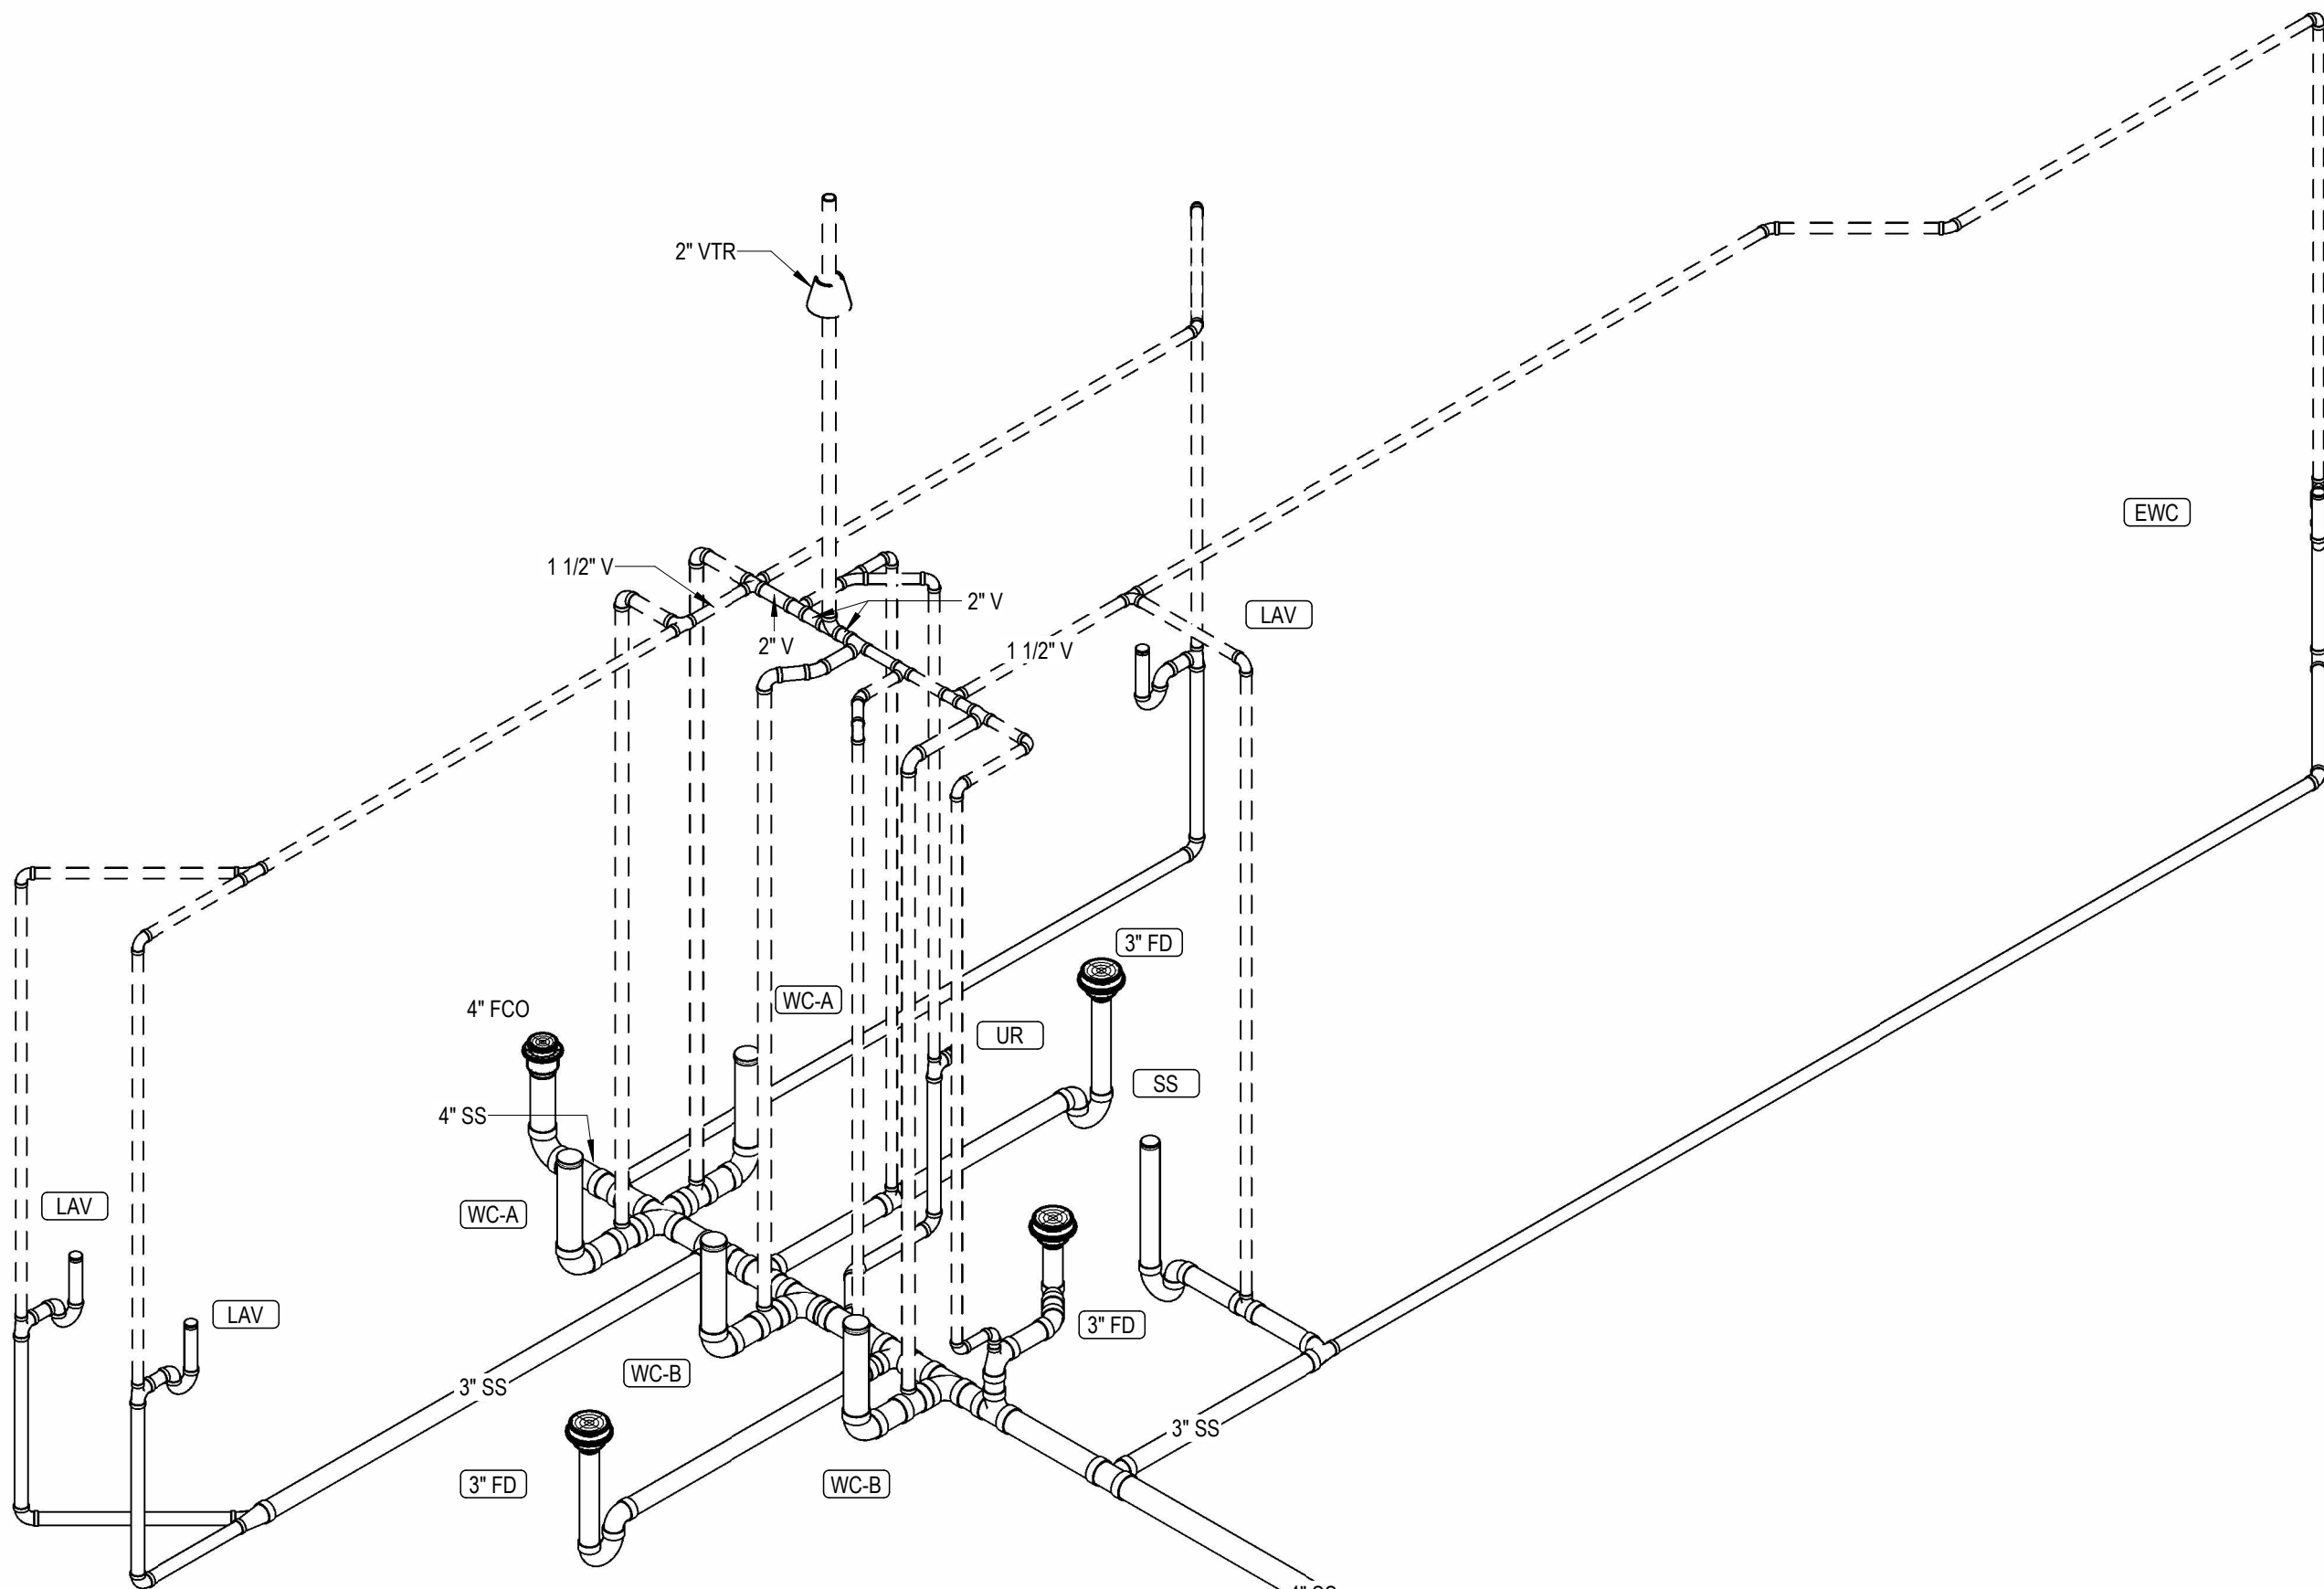

A WASTE & VENT RISER DIAGRAM

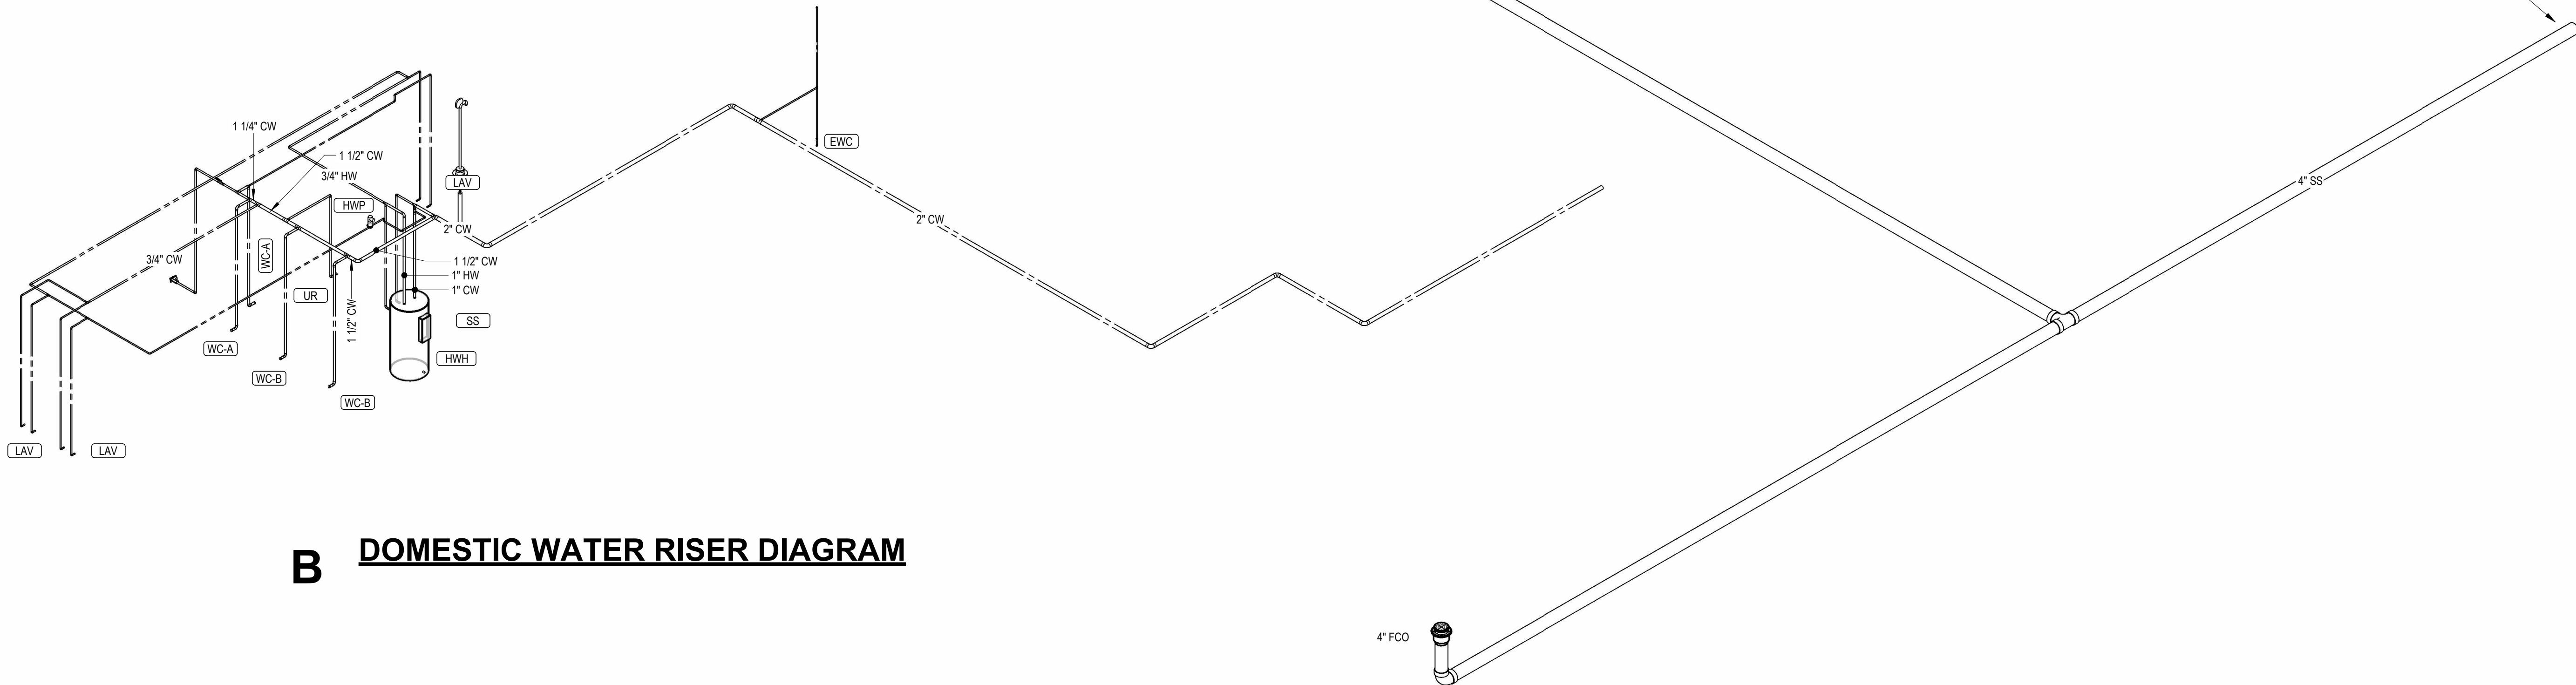

B DOMESTIC WATER RISER DIAGRAM

SEE OVERALL WASTE AND VENT  
UNDERFLOOR PLAN FOR  
CONTINUATION.



**JonesGillamRenz**  
730 N. Ninth  
Salina, KS 67401  
785.827.0386  
1881 Main Street, Suite 301  
Kansas City, MO 64108  
jgr@jgarchitects.com

# KANSAS

# SALINA

REVISIONS:		
NO	DATE	REVISION

# E0.1

## E0.1

Electrical Symbol Legend											
<b>Lighting Symbols</b>          Lighting Fixtures, Typical, Rectangular (Various Symbols)         Lighting Fixtures, Typical, Round (Various Symbols) Center dot indicates pendant. Chevron indicates wall wash.                  Wall-mounted fixtures, Typical (Various Symbols) Strip Fixture Directional Light, Track Light, Flood Light Linear Light, Tape Light Emergency Lighting Unit, Ceiling-Mounted, Integral Battery Emergency Lighting Unit, Ceiling-Mounted, Remote Battery Emergency Lighting Unit, Wall-Mounted, Integral Battery Emergency Lighting Unit, Wall-Mounted, Remote Battery Exit Light, Ceiling-Mounted. Shading and arrows indicate faces and directional chevrons. Exit Light, Wall-Mounted. Shading and arrows indicate faces and directional chevrons. Exit/ELU Combo           Pole/Area Lights Post-Top Area Light Bollard Light Hatch indicates light on an emergency or life safety circuit.          Single-Pole Switch Two-Pole Switch Three-Pole Switch   Switch Modifiers:  <table> <tr> <td>3: 3-Way</td><td>OS: Occupancy Sensor</td></tr> <tr> <td>4: 4-Way</td><td>VS: Vacancy Sensor</td></tr> <tr> <td>K: Keyed</td><td>CT: Above-Counter</td></tr> <tr> <td>D: Dimming</td><td>LV: Low-Voltage</td></tr> <tr> <td>T: Timer</td><td>M: Motor-Rated</td></tr> </table>          Lighting Contactor Lighting Control Panel Occupancy Sensor Daylight Harvesting Sensor   <b>Lighting Tags</b>        Top Value: Fixture Type ID (Underlined) A MDP-1a Bottom Value, Lowercase Letter: Switch ID Bottom Value, Number(s): Circuit Number Bottom Value, Uppercase Letter(s): Panel   Absence of a switch designation on a lighting fixture indicates fixture is controlled by the only switch in the space. An "x" in place of the switch designation indicates unswitched.   Switch ID indicated by a lowercase letter. Switch IDs are unique per space. A switch with an ID "a" controls all devices within the space in which it is located tagged with "a". A switch without a tagged ID controls all lighting fixtures within a space. ID tags may be used on control devices other than switches, such as occupancy sensors or contactors.	3: 3-Way	OS: Occupancy Sensor	4: 4-Way	VS: Vacancy Sensor	K: Keyed	CT: Above-Counter	D: Dimming	LV: Low-Voltage	T: Timer	M: Motor-Rated	<b>Power Symbols</b>              Simplex Receptacle Duplex Receptacle Quadplex Receptacle Special Receptacle, Type as Indicated   Receptacle Modifiers:   #F: Height AFF (to center) CT: Device Mounted Above Counter Top IG: Isolated Ground H: Device Mounted Horizontally WP: Weatherproof In-Use Cover              Half shading indicates split (typically switched) Outside shading indicates tamperproof device Center shading indicates GFI type Full shading indicates tamperproof GFI type Multioutlet Assembly Filled squares indicate 120V outlet Open squares indicate with USB                   Cord Reel, Device Varies Drop Cord, Device Varies Junction Box Floor Box, see schedule for type Emergency Power Off Door Opener Push Plate Power Meter Safety Switch, Fused Safety Switch, Unfused Motor Starter Combination Starter/Disconnect Contactor   <b>Power Device and Equipment Tags</b>   LP1A-1   Equipment Devices: Uppercase letter(s) indicates Panel ID and circuit number. Lowercase letter indicates designation of controlling switch (where applicable).   Equipment Tags: Equipment ID is indicated by an underlined tag adjacent to the equipment. See the equipment connection schedule for description, electrical requirements, and panel and circuit number. Symbols/graphic appearance of equipment varies.   <b>Wiring</b>          Solid, aced lines connecting equipment, devices, or fixtures indicate unswitched power circuiting. Wires are only intended to indicate to what circuit devices are connected. Actual connections, circuit routing, installation, junction boxes, etc. shall be field-determined by the contractor.   Dashed, aced lines connecting equipment, devices, or fixtures indicate switched power.   Home run to branch circuit panelboard. The equipment name and circuit number(s) are indicated, separated by a hyphen. Homenums are only intended to indicate panel and circuit number. Actual homerun location shall be field-determined by the contractor.   <b>Power Distribution Equipment</b>           SB1   Hatched fill indicates distribution panel or switchboard. Solid fill indicates branch panel or load center. Dashed box indicates code-required clearance (width and depth). Door indicates front of recessed panel.   Devices and fixtures are tagged with Panel and circuit number. For example, a device tagged with "A.1" indicates the device is circuitied to panel designated "A," circuit number 1.   <b>Telecom Symbols</b>               Wall Ceiling Floor Data Outlet Telephone Outlet Data/Telephone Outlet Wireless Access Point TV Outlet   Outlet Modifiers:   #F: Height AFF (to center) CT: Mounted Above Counter Top
3: 3-Way	OS: Occupancy Sensor										
4: 4-Way	VS: Vacancy Sensor										
K: Keyed	CT: Above-Counter										
D: Dimming	LV: Low-Voltage										
T: Timer	M: Motor-Rated										
<b>Miscellaneous</b>         Area Not in Contract Note by Symbol   Callout: Top Value: Detail Number on Sheet Bottom Value: Sheet Number of Detail   <b>Room</b>        Room Name and Number											



Designation: DS

Installed Location: STORAGE 108				Bus Amps: 400				SCCR/AIC: 22.0 kA				
Voltage: 208Y/120 3PH 4W-3Ph-4W				MCB Amps: MLO				Mains FN/Note: -				
Mounting: Surface				Features & Modifications: -								
Enclosure: NEMA 1												
Ckt	Description	Circuitry	Trip (A)	FN	A (kVA)	B (kVA)	C (kVA)	FN	Trip (A)	Circuitry	Description	Ckt
DS-1	LIGHTING - W. DANCE	1/2"C,1#12, #12N, #12G	20		1.19	0.18			G	20	1/2"C,1#12, #12N, #12G	DS-2
DS-3	LIGHTING - E. DANCE	1/2"C,1#12, #12N, #12G	20			1.31	1.65			20	1/2"C,1#10, #10N, #10G	DS-4
DS-5	LIGHTING - HALLWAY, ETC.	1/2"C,1#12, #12N, #12G	20					0.90	0.13	20	1/2"C,1#12, #12N, #12G	DS-6
DS-7	LIGHTING - CHORUS, TOILET RMS.	1/2"C,1#12, #12N, #12G	20		0.99	2.76						DS-8
DS-9	RECEPTACLES - HALLWAY	1/2"C,1#12, #12N, #12G	20			0.90	2.76		H	30	1/2"C,3#10, #10G	RTU-1
DS-11	RECEPTACLES - E. DANCE	1/2"C,1#12, #12N, #12G	20					1.08	2.76			DS-12
DS-13	RECEPTACLES - E. DANCE	1/2"C,1#12, #12N, #12G	20		0.90	5.16						DS-14
DS-15	CLG. RECEPTACLES - E. DANCE	1/2"C,1#12, #12N, #12G	20			0.72	5.16		H	50	3/4"C,3#6, #10G	RTU-4
DS-17	CLG. RECEPTACLES - E. DANCE	1/2"C,1#12, #12N, #12G	20					0.72	5.16			DS-18
DS-19	CLG. RECEPTACLES - E. DANCE	1/2"C,1#12, #12N, #12G	20		0.72	5.16						DS-20
DS-21	RECEPTACLES - DRESSING RMS	1/2"C,1#12, #12N, #12G	20			1.44	5.16		H	50	3/4"C,3#6, #10G	RTU-3
DS-23	RECEPTACLES - W. DANCE	1/2"C,1#12, #12N, #12G	20					1.08	5.16			DS-24
DS-25	RECEPTACLES - W. DANCE	1/2"C,1#12, #12N, #12G	20		1.08	5.16						DS-26
DS-27	CLG. RECEPTACLES - W. DANCE	1/2"C,1#12, #12N, #12G	20			0.72	5.16		H	50	3/4"C,3#6, #10G	RTU-2
DS-29	CLG. RECEPTACLES - W. DANCE	1/2"C,1#12, #12N, #12G	20					0.72	5.16			DS-30
DS-31	CLG. RECEPTACLES - W. DANCE	1/2"C,1#12, #12N, #12G	20		0.72	5.97						DS-32
DS-33	RECEPTACLES - CHORUS	1/2"C,1#12, #12N, #12G	20			0.72	5.58					DS-34
DS-35	RECEPTACLES - CHORUS	1/2"C,1#12, #12N, #12G	20					1.08	5.28		PANEL 'SS'	DS-36
DS-37	RECEPTACLES - TOILET RMS	1/2"C,1#12, #12N, #12G	20		0.66	0.90				20	1/2"C,1#12, #12N, #12G	DS-38
DS-39	RECEPTACLES - OFFICE	1/2"C,1#12, #12N, #12G	20			1.08	1.08			20	1/2"C,1#12, #12N, #12G	DS-40
DS-41	RECEPTACLES - HOMEWORK	1/2"C,1#12, #12N, #12G	20					0.72	--	--	SPACE	DS-42
DS-43	EXTERIOR LIGHTING	1/2"C,1#12, #12N, #12G	20		0.26	--	--	--	--	--	SPACE	DS-44
DS-45	SMOKE DAMPER	1/2"C,1#12, #12N, #12G	20	L	--	0.00	--	--	--	--	SPACE	DS-46
DS-47	CEILING FANS - W. DANCE	1/2"C,1#12, #12N, #12G	20					0.67	--	--	SPACE	DS-48
DS-49	CEILING FANS - W. DANCE	1/2"C,1#12, #12N, #12G	20		0.67	--	--	--	--	--	SPACE	DS-50
DS-51	SPARE	--	20			0.00	--	--	--	--	SPACE	DS-52
DS-53	SPARE	--	20					0.00	--	--	SPACE	DS-54
DS-55	SPARE	--	20		0.00	--	--	--	--	--	SPACE	DS-56
DS-57	SPARE	--	20			0.00	--	--	--	--	SPACE	DS-58
DS-59	SPARE	--	20					0.00	--	--	SPACE	DS-60
Connected Load:					32482 VA	34432 VA	30611 VA					
Connected Amps:					273.1 A	289.3 A	255.1 A					

Designation: SS


Installed Location: SCENE SHOP				Bus Amps: 100				SCCR/AIC: 10.0 kA				
Voltage: 208Y/120 3PH 4W-3Ph-4W				MCB Amps: MLO				Mains FN/Note: -				
Mounting: Surface				Features & Modifications: -								
Enclosure: NEMA 1												
Ckt	Description	Circuitry	Trip (A)	FN	A (kVA)	B (kVA)	C (kVA)	FN	Trip (A)	Circuitry	Description	Ckt
SS-1					3.84	1.18			20	1/2"C,1#12, #12N, #12G	OVERHEAD DOOR OPERATOR	SS-2
SS-3						3.84	0.00		20	--	SPARE	SS-4
SS-5	RTU-5	3/4"C,3#6, #10G	45					3.84	0.00	20	--	SS-6
SS-7	LIGHTING	1/2"C,1#12, #12N, #12G	20		0.41	0.00			20	--	SPARE	SS-8
SS-9	LIGHTING	1/2"C,1#12, #12N, #12G	20			1.48	0.00		20	--	SPARE	SS-10
SS-11	RECEPTACLES	1/2"C,1#12, #12N, #12G	20					0.36	0.00	20	--	SS-12
SS-13	RECEPTACLES	1/2"C,1#12, #12N, #12G	20		0.18	0.00			20	--	SPARE	SS-14
SS-15	RECEPTACLES	1/2"C,1#12, #12N, #12G	20			0.18	--		--	--	SPACE	SS-16
SS-17	RECEPTACLES	1/2"C,1#12, #12N, #12G	20				0.18	--	--	--	SPACE	SS-18
SS-19	RECEPTACLES	1/2"C,1#12, #12N, #12G	20		0.18	--	--	--	--	--	SPACE	SS-20
SS-21	RECEPTACLES	1/2"C,1#12, #12N, #12G	20			0.18	--	--	--	--	SPACE	SS-22
SS-23	RECEPTACLES	1/2"C,1#12, #12N, #12G	20				0.18	--	--	--	SPACE	SS-24
SS-25	RECEPTACLES	1/2"C,1#12, #12N, #12G	20		0.18	--	--	--	--	--	SPACE	SS-26
SS-27	RECEPTACLES	1/2"C,1#12, #12N, #12G	20			0.90	--	--	--	--	SPACE	SS-28
SS-29	RECEPTACLES	1/2"C,1#12, #12N, #12G	20					0.72	--	--	SPACE	SS-30
Connected Load:					5969 VA	6577 VA	5280 VA					
Connected Amps:					50.6 A	55.7 A	44.0 A					

Breaker Function Schedule

#	For any number, see panel schedule footer note
A	Arc-Fault Interrupter (AFCI) Protection
AR	Arc Energy Reduction Maintenance Switch
D	Demolished Circuit (now Spare or Space) (former circuit in brackets)
E	Existing-to-remain circuit
EM	Provide identification per NEC 700.12(1)(2)(4)
G	Ground-Fault Circuit Interrupter (GFCI) Protection (5 mA)
GE	Ground-Fault Protection for Equipment (30 mA)
GF	Adjustable Ground-Fault Protection for Equipment
H	HACR Rated
L	Lockable Closed
LSI	Long-Time, Short-Time, Instantaneous Adjustment
LSIG	Long-Time, Short-Time, Instantaneous and Ground-Fault Adjustments
N	New Circuit (in existing panel, previously spare or space)
NB	New breaker to replace existing breaker or space (new trip rating shown)
NR	New circuit to replace existing circuit (former circuit in brackets)
R	Relocated circuit
S	Switch-rated per NEC 240.83(D)

LIGHT FIXTURE SCHEDULE

<b>GENERAL:</b> •ALL LEDS SHALL BE 4000K CORRELATED COLOR TEMPERATURE, MINIMUM 80 CRI •ALL LED FIXTURES SHALL ADHERE TO LM79 AND LM80 STANDARDS •PROVIDE MANUFACTURERS' FLANGE KIT WHERE LAY-IN FIXTURES ARE TO BE INSTALLED IN HARD CEILINGS. •WHERE LED FIXTURES ARE SCHEDULED WITH ADJUSTABLE LUMEN OUTPUT, INSTALL WITH OUTPUT SET TO MEDIUM LEVEL. ADJUST OUTPUT HIGHER OR LOWER AS DIRECTED BY OWNER AT SUBSTANTIAL COMPLETION. •PROVIDE FACTORY INSTALLED LED BATTERY BACK-UP FOR FIXTURES SHOWN HALF SHADED OR WITH 'EM' DESIGNATION TO OPERATE FIXTURE FOR 90 MINUTES UPON LOSS OF NORMAL POWER.											
<b>NOTES:</b> 1. PROVIDE FIXTURE WITH INTEGRAL EMERGENCY BATTERY AND CHARGER WITH SELF-DIAGNOSTIC/SELF-TESTING ELECTRONICS. 2. FIXTURE SHALL BE CAPABLE OF WALL OR CEILING MOUNT APPLICATIONS AND SHALL HAVE BREAK-OUT DIRECTIONAL CHEVRONS. 3. INSTALL FIXTURE PER DETAIL A, SHEET E6.1. 4. U.L. LISTED FOR 'WET LOCATION'. 5. U.L. LISTED FOR 'DAMP LOCATION'. 6. COORDINATE EXACT MOUNTING HEIGHT WITH ARCHITECT.											
MARK	MANUFACTURER	MODEL NUMBER	WATTAGE	LUMEN OUTPUT	DRIVER	MOUNTING	FINISH	DESCRIPTION	NOTES		
A	PACLIGHTS	FPNB/4-24D-SCCT-43/36/30/22	36 W	5040 lm	0-10V DIMMING TO 10%	LAY-IN	WHITE	2X4 BACKLIT LED FLAT PANEL WITH ADJUSTABLE CCT AND LUMEN OUTPUT	3		
B	PACLIGHTS	FPNB/4-22D-SCCT-32/26/19/16	26 W	3640 lm	0-10V DIMMING TO 10%	LAY-IN	WHITE	2X2 BACKLIT LED FLAT PANEL WITH ADJUSTABLE CCT AND LUMEN OUTPUT	3		
C	PACLIGHTS	FPNB/4-14D-SCCT-32/26/19/16	26 W	3640 lm	0-10V DIMMING TO 10%	LAY-IN	WHITE	1X4 BACKLIT LED FLAT PANEL WITH ADJUSTABLE CCT AND LUMEN OUTPUT	3		
CF	MACROAIR	LINCOLN STREET 3	150 W	0 lm	--	SUSPENDED	BY ARCHITECT	3-BLADE AIRFOIL CEILING FAN, 72" DIAMETER, RF REMOTE CONTROL, FINISH SELECTED BY ARCHITECT.	--		
D	DAY-BRITE CFI	CSW48-2840UDZTZO	31 W	2800 lm	0-10V DIMMING TO 10%	SURFACE WALL HORIZONTAL	WHITE	4FT WALL BRACKET WITH OPAL ACRYLIC LENS			
F	PACLIGHTS	FSLE-4D40M-8CT	30 W	3990 lm	0-10V DIMMING TO 10%	SUSPENDED	WHITE	4' STANDARD STRIP WITH CURVED FROSTED ACRYLIC LENS			
G	HE WILLIAMS	75R-8-1/100/9TW2	66 W	4077 lm	0-10V DIMMING TO 10%, TUNABLE WHITE 2700K - 6500K	SUSPENDED	WHITE	8' TUNABLE WHITE STRIP WITH CURVED FROSTED ACRYLIC LENS			
H	PACLIGHTS	FLDA-8D30-50CT	30 W	2875 lm	0-10V DIMMING TO 1%	SURFACE	SEMI-SPECULAR	6" DIA. ROUND SURFACE DOWNLIGHT			
J	PACLIGHTS	FSLE-8D90H-8CT	90 W	11970 lm	0-10V DIMMING TO 10%	SUSPENDED/SURFACE	WHITE	8' STANDARD STRIP WITH CURVED FROSTED ACRYLIC LENS			
K	AEL	LLPS4-BLUE-5000-FL-M	31 W	5000 lm	0-10V DIMMING TO 10%	SURFACE WALL HORIZONTAL	WHITE	4FT LINEAR WALL BRACKET, BLUE LEDS			
R	GARDCO	GBM-B04-840-WAW-U-WAW-UNV	16 W	1467 lm	LED DRIVER	SURFACE WALL	BRONZE	EXTERIOR WALLPACK WITH UP/DOWN WALL WASH	4,6		
S	GARDCO	GBS-A01-T2M-UNV	10 W	1537 lm	LED DRIVER	SURFACE WALL	BRONZE	EXTERIOR WALLPACK WITH IES TYPEII DISTRIBUTION	4,6		
SE	GARDCO	GBS-A01-T2M-UNV-EM	10 W	1537 lm	LED DRIVER	SURFACE WALL	BRONZE	EXTERIOR WALLPACK WITH IES TYPEII DISTRIBUTION AND EMERGENCY BATTERY BACKUP	4,6		
X	LIFE SAFETY LIGHTING	LSXS2RWEMSDT	5 W	0 lm	--	CEILING/WALL	WHITE	UNIVERSAL SINGLE/DOUBLE FACE POLYCARBONATE EXIT SIGN	1,2		

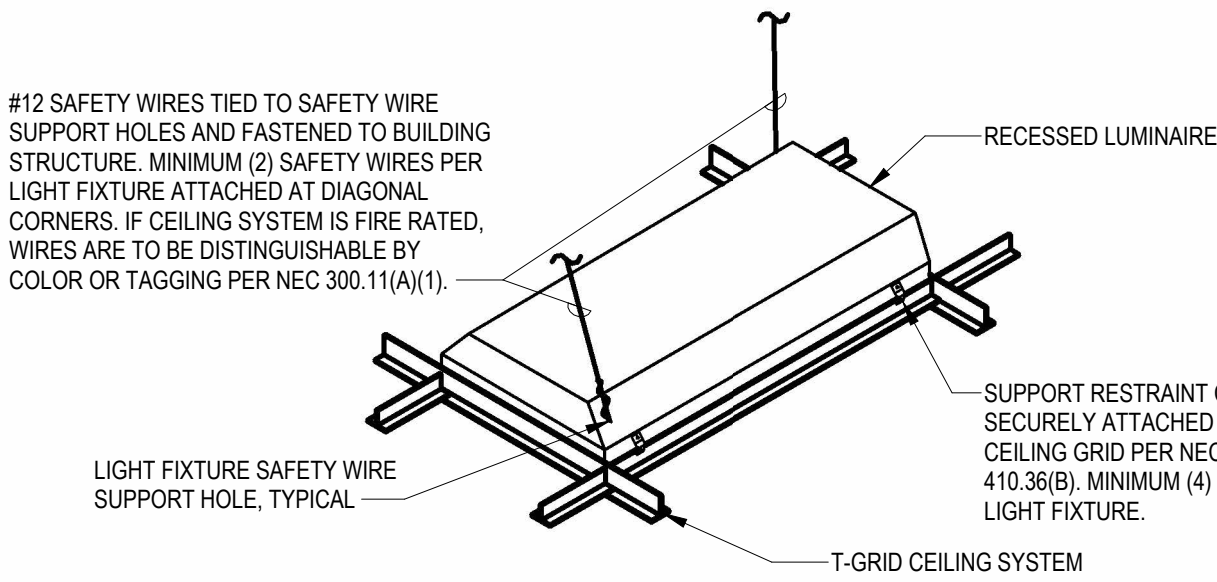

RECESSED LUMINAIRE SUPPORT  
NO SCALE



REVISIONS:		
NO	DATE	REVISION

<b>DATE:</b>	9-18-2026
<b>JOB:</b>	22-3239
<b>SHEET NO.:</b>	







- NOTES BY SYMBOL
- 1

PROVIDE PUSHBUTTON SWITCH WITH 0-10V SLIDE DIMMER, TYPICAL.
- 2


PROVIDE 0-10V SLIDER FOR TUNABLE WHITE CONTROL.
- 3

'EM' OR SOLID HATCH INDICATES FIXTURE TO BE WIRED FOR EMERGENCY OPERATION, TYPICAL.
- 4

CONNECT TO EXISTING LIGHTING CIRCUIT SERVING THIS AREA.
- 5

HEAVY DUTY 7-DAY DIGITAL WALL SWITCH TIMER FOR CONTROL OF EXTERIOR LIGHTING. TIMER SHALL HAVE LCD DIGITAL CLOCK AND READOUT, MANUAL OVERRIDE, AND SHALL BE RATED FOR 20A AT 120V. INTERMATIC #E1600 OR EQUAL INSTALL AT 45° AFF AND COORDINATE WITH OWNER FOR PROGRAMMING AND SCHEDULING.
- 6

PROVIDE JUNCTION BOX FOR EXTERIOR SIGN. COORDINATE EXACT REQUIREMENTS WITH ARCHITECT.

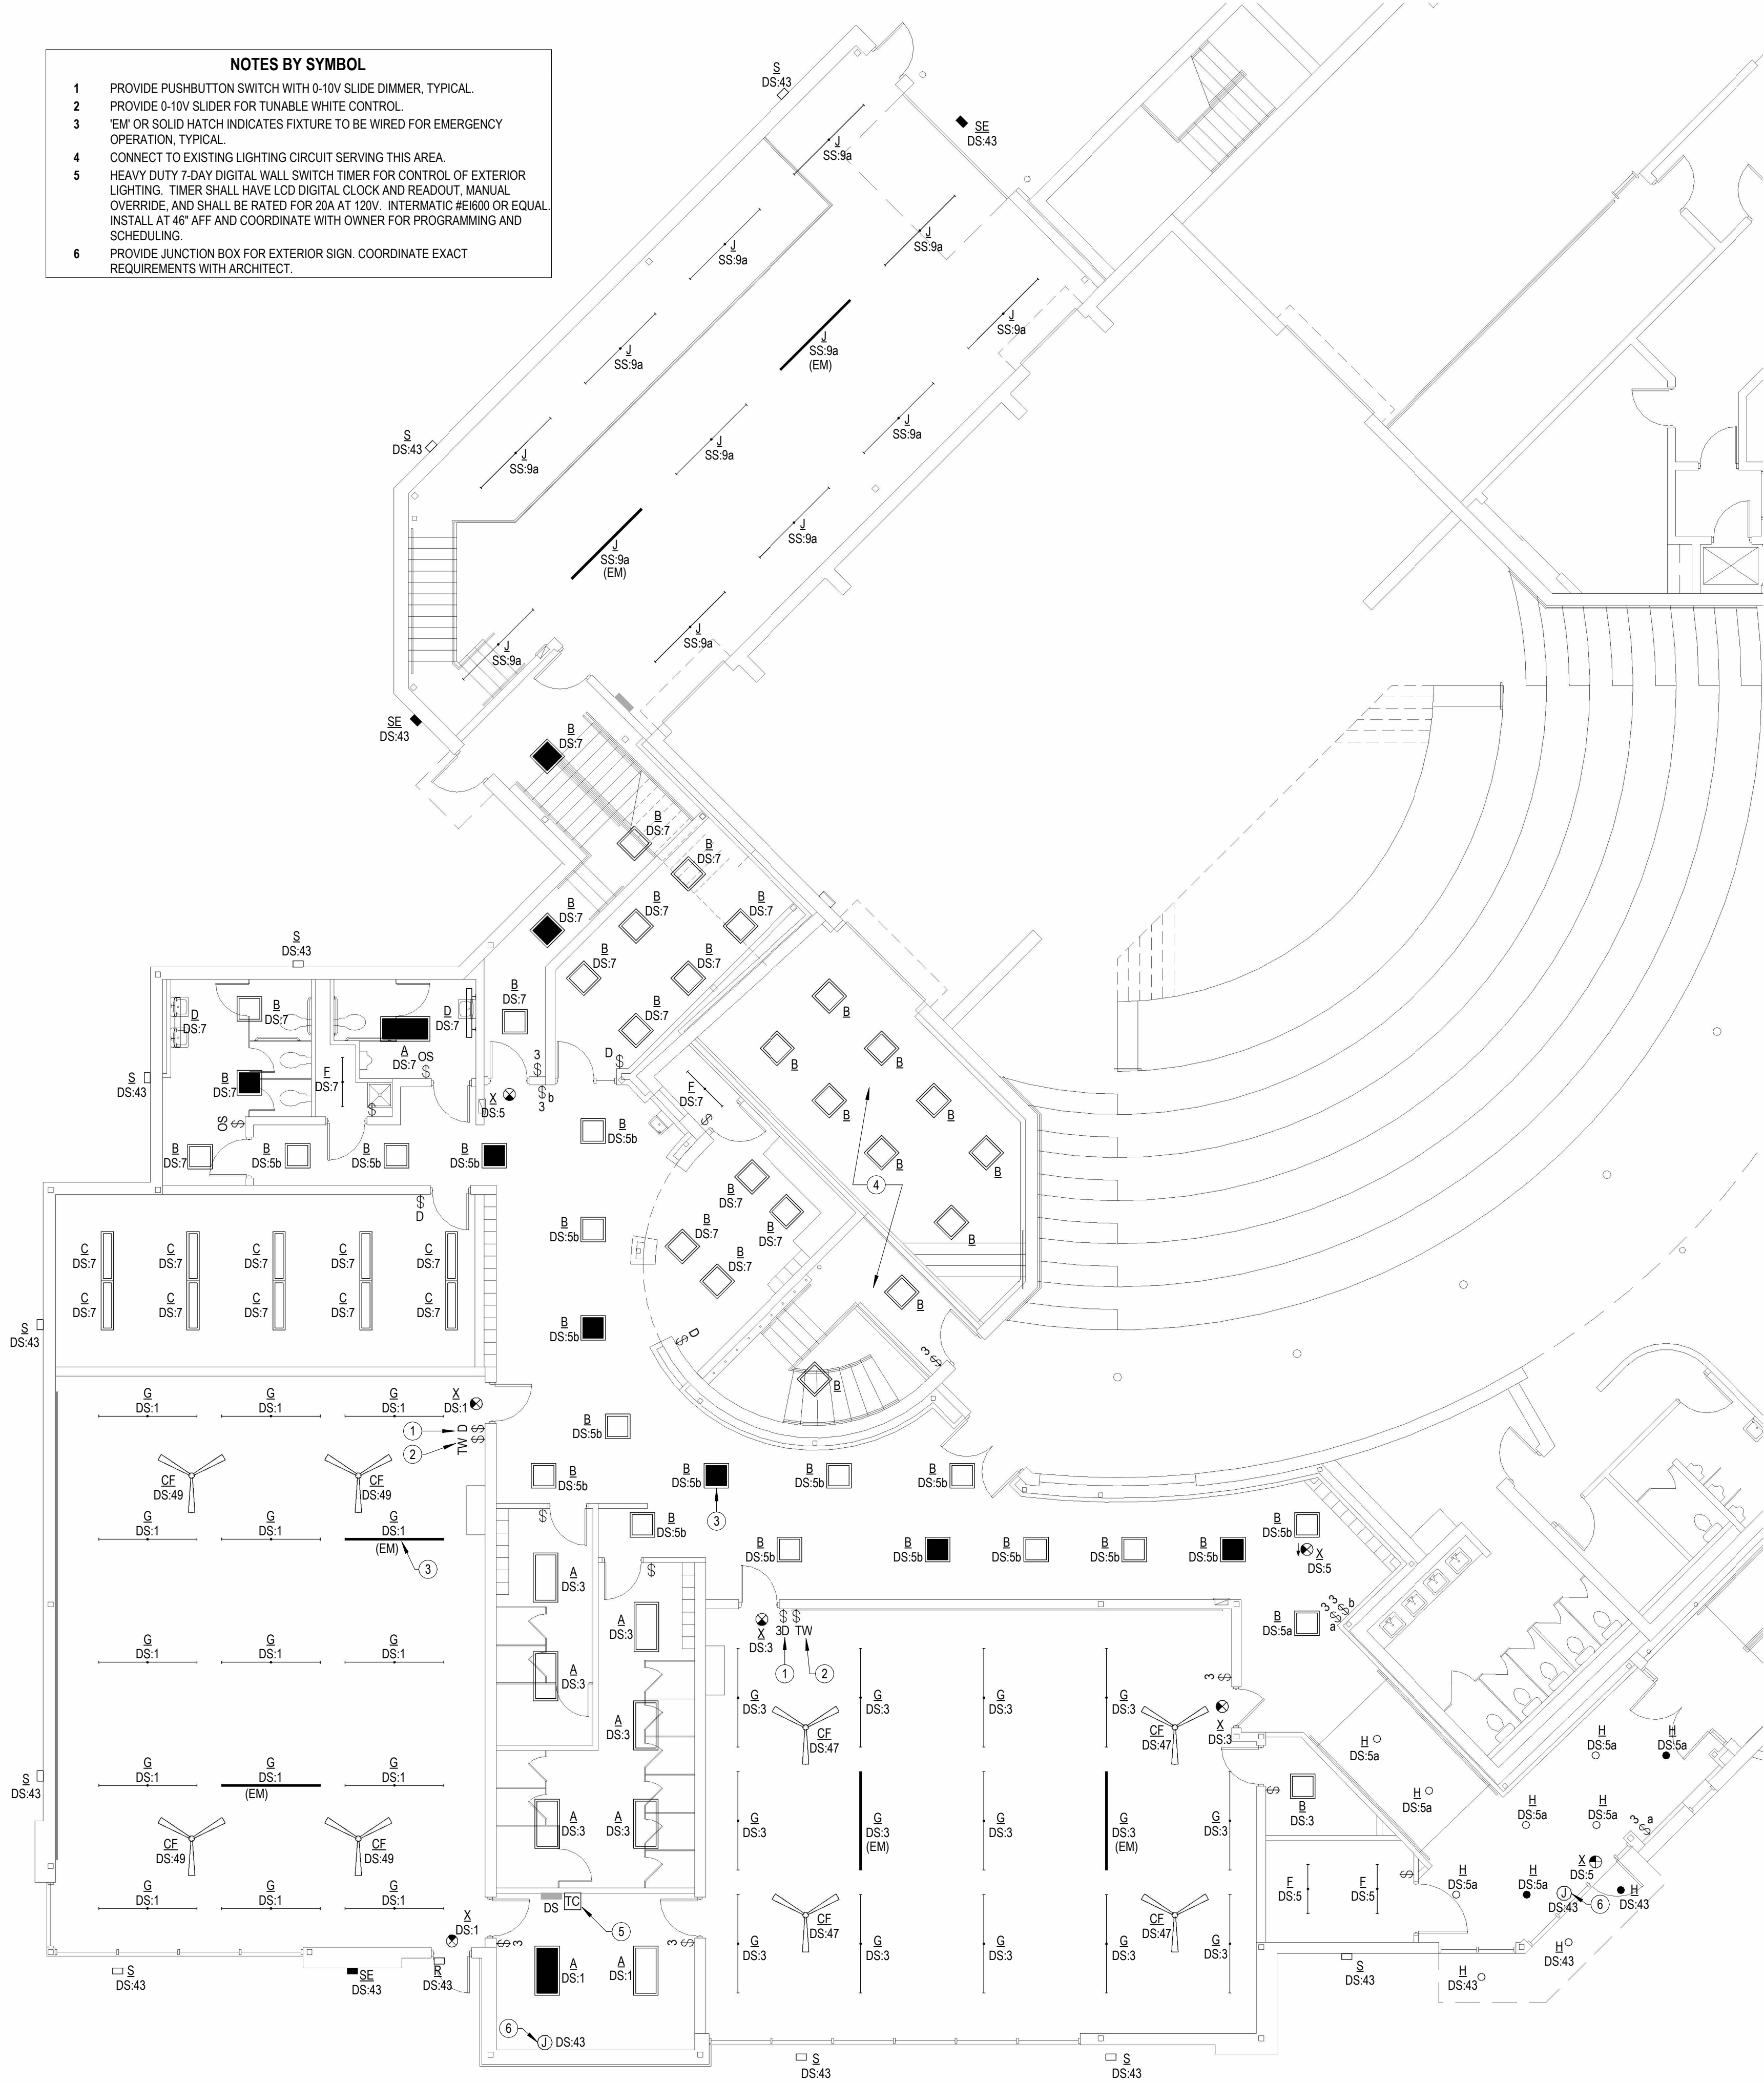

A


LIGHTING PLAN - MAIN LEVEL

1/8" = 1'-0"



NOTES BY SYMBOL


- 1 SUGGESTED ROUTING FOR FEEDER TO PANEL 'DS'. PROVIDE (2) SETS OF (4) #500 KCMIL #3G (COPPER) IN 3" CONDUIT. VERIFY ROUTING IN FIELD PRIOR TO INSTALLATION. PROVIDE PULL BOXES AS REQUIRED BY NEC. COORDINATE ROUTING WITH EXISTING CONDITIONS, STRUCTURE, AND OTHER BUILDING SYSTEMS. SUBMIT PROPOSED ROUTING TO ARCHITECT FOR REVIEW AND APPROVAL PRIOR TO INSTALLATION.
- 2 EXISTING SERVICE SWITCHBOARD 'SES'. 208Y/120V 3-PHASE, 4-WIRE, G.E. "SPECTRA SERIES" WITH 65 KAIC SCOR. REMOVE SINGLE BREAKER MOUNTING BRACKET HOUSING EXISTING "DIMMER RACK" BREAKER AND REPLACE WITH DUAL MOUNTING BRACKET. REINSTALL EXISTING BREAKER FOR "DIMMER RACK" AND PROVIDE NEW 400A/3P BREAKER RATED AT 65 KAIC TO FEED NEW PANEL 'DS'. PROVIDE RETROFIT MOUNTING KIT AS REQUIRED.
- 3 EXISTING SIMPLEX FIRE ALARM PANEL. PROVIDE ADDITIONAL COMPONENTS AS REQUIRED TO EXPAND SYSTEM INTO NEW ADDITION.
- 4 PROVIDE (6) EMPTY 2-GANG BOXES, EACH WITH 1-1/4" CONDUIT TO ABOVE ACCESSIBLE CEILING FOR CABLE BY OTHERS. ADDITIONALLY, FOR ONE BOX, PROVIDE (1) EMPTY 1" CONDUIT TO ABOVE ACCESSIBLE CEILING IN EXISTING BASEMENT DRESSING ROOM AREA. VERIFY LOCATION AND REQUIREMENTS WITH OWNER PRIOR TO INSTALLATION.
- 5 FOR EACH DATA OUTLET, PROVIDE 2-GANG BOX WITH SINGLE GANG PLASTER RING, AND 1" CONDUIT TO ABOVE ACCESSIBLE CEILING, TERMINATED WITH SMOOTH BUSHING. PROVIDE (2) CAT 6 CABLES TO HEAD END ROOM. LEAVE 3' SLACK CABLE AT BOX AND AT HEAD END EQUIPMENT. TERMINATIONS, JACKS, AND COVERPLATES TO BE BY OTHERS. COORDINATE WITH OWNER PRIOR TO INSTALLATION.
- 6 CONNECT OVERHEAD DOOR OPERATOR. PROVIDE REQUIRED CONTROLS, ETC. FOR COMPLETE OPERATION. COORDINATE WITH EQUIPMENT PROVIDED.

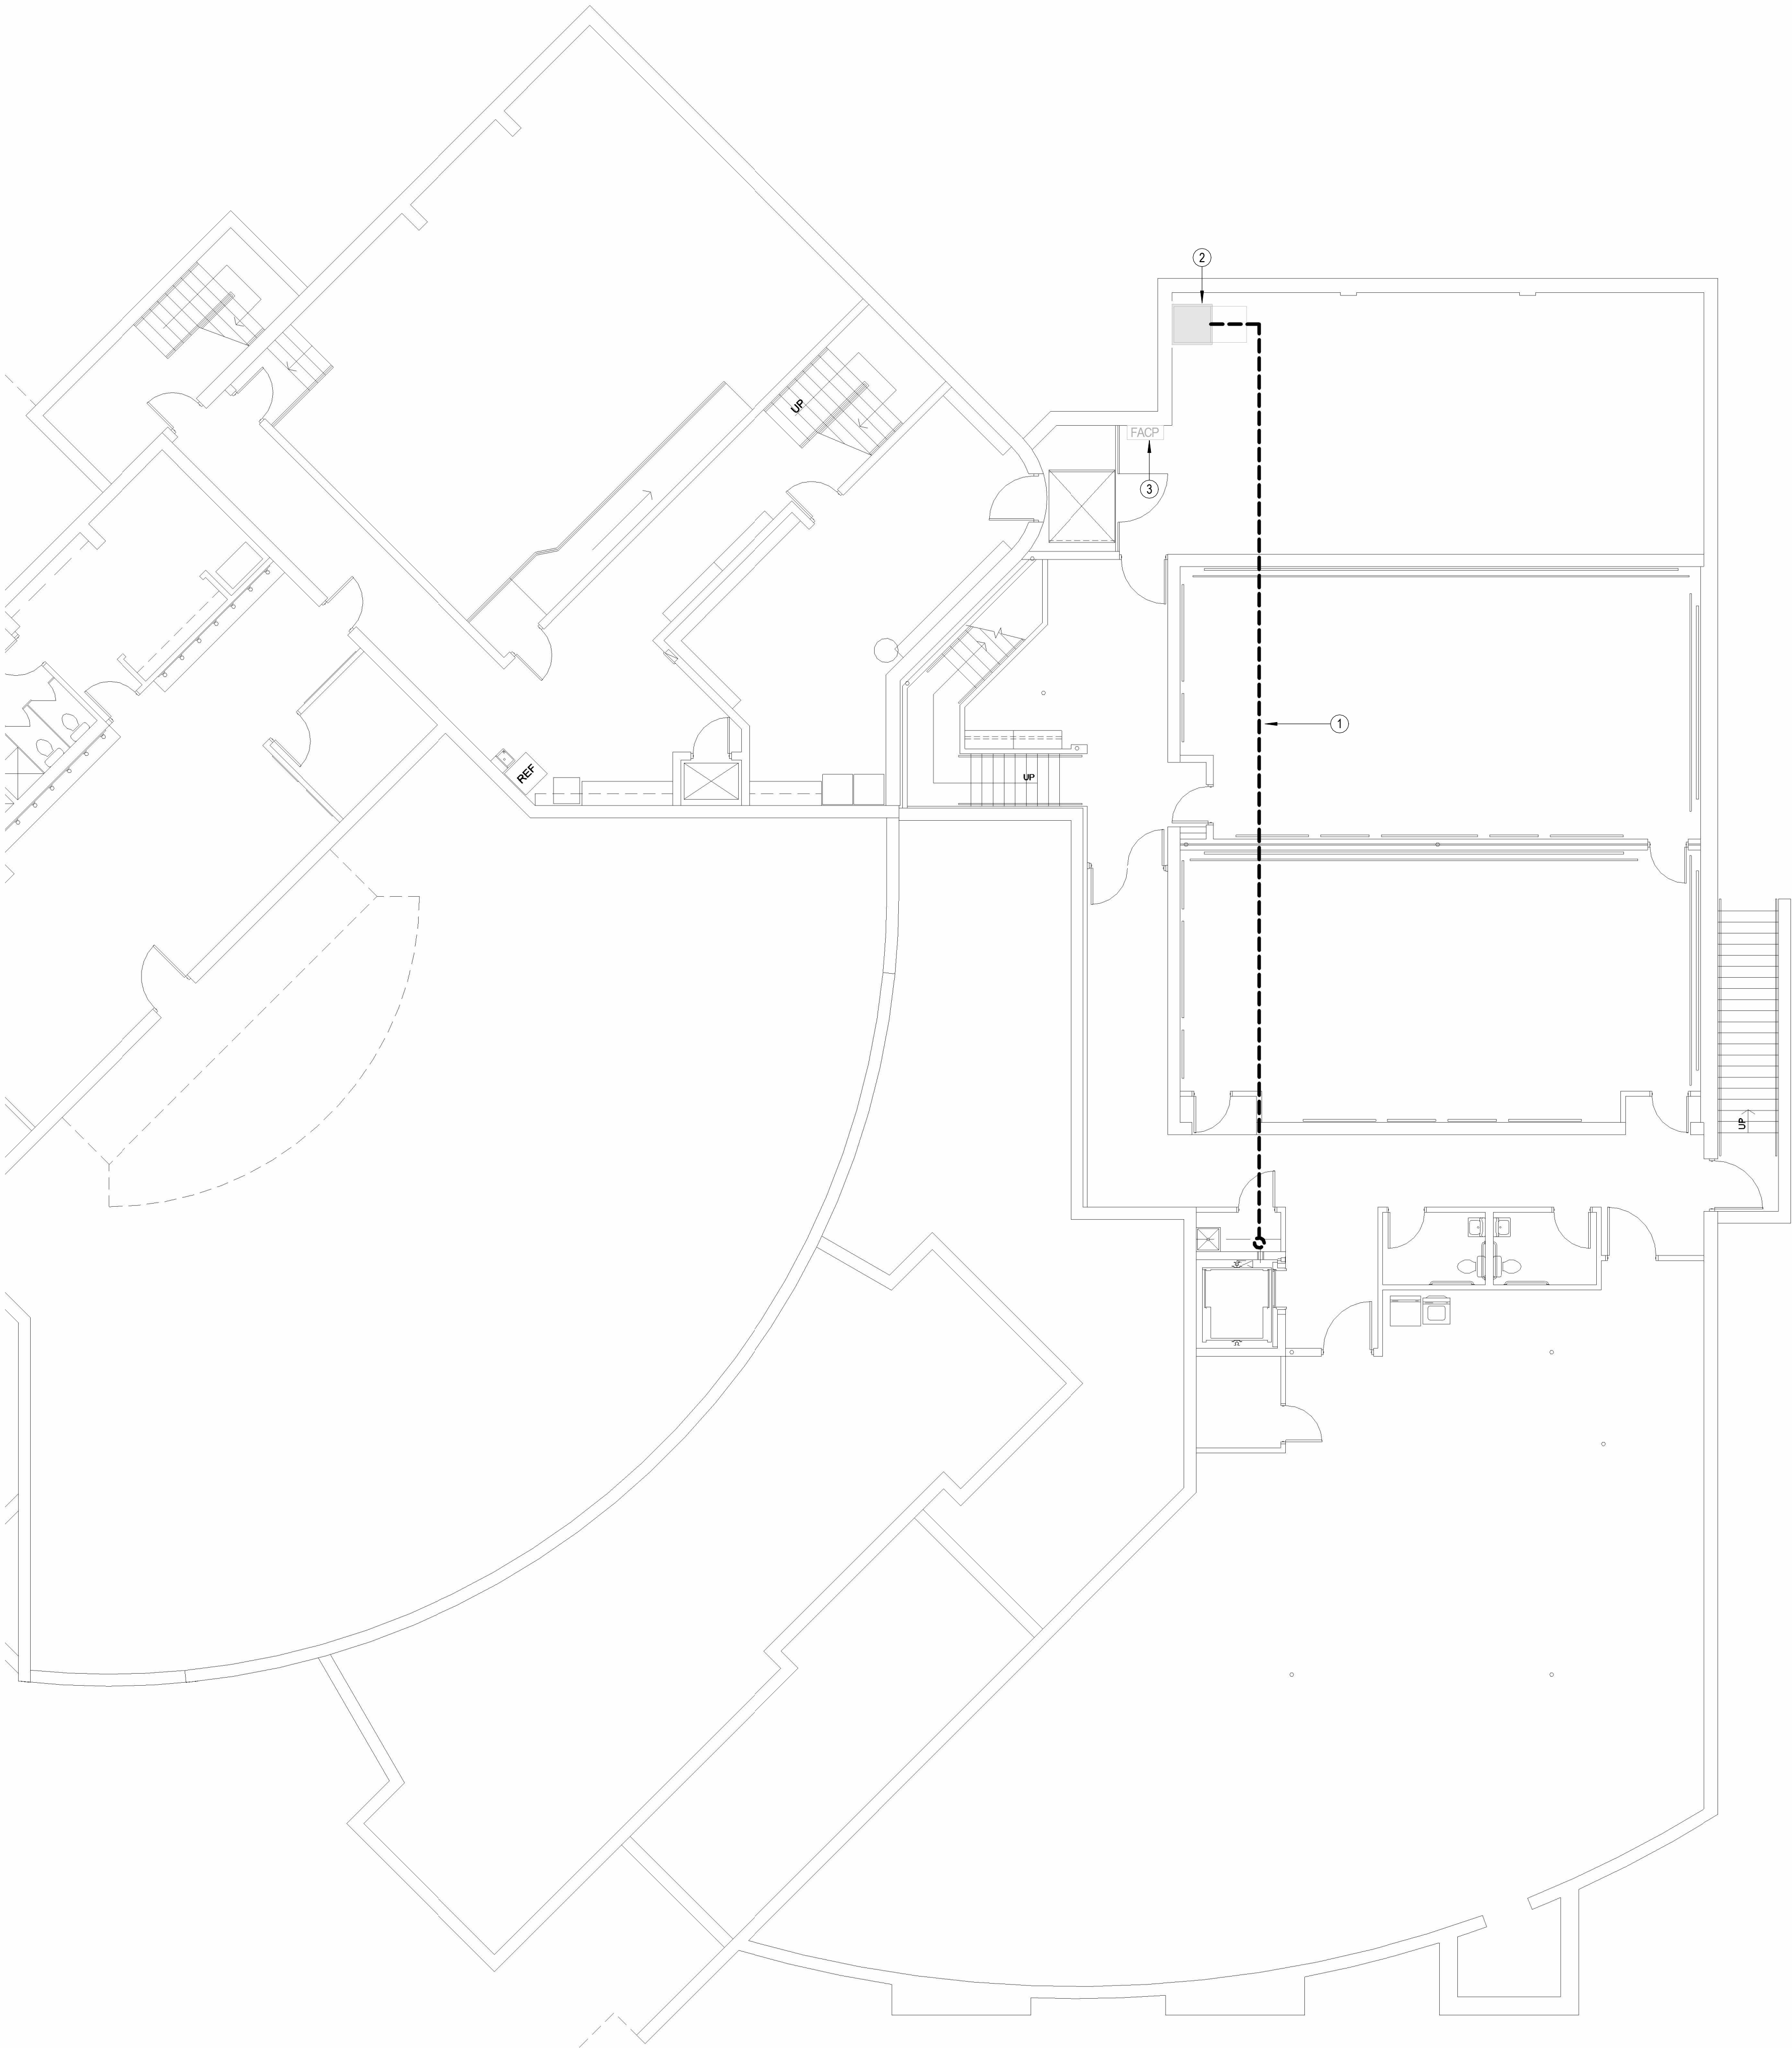

A

POWER PLAN - BASEMENT

1/8" = 1'-0"

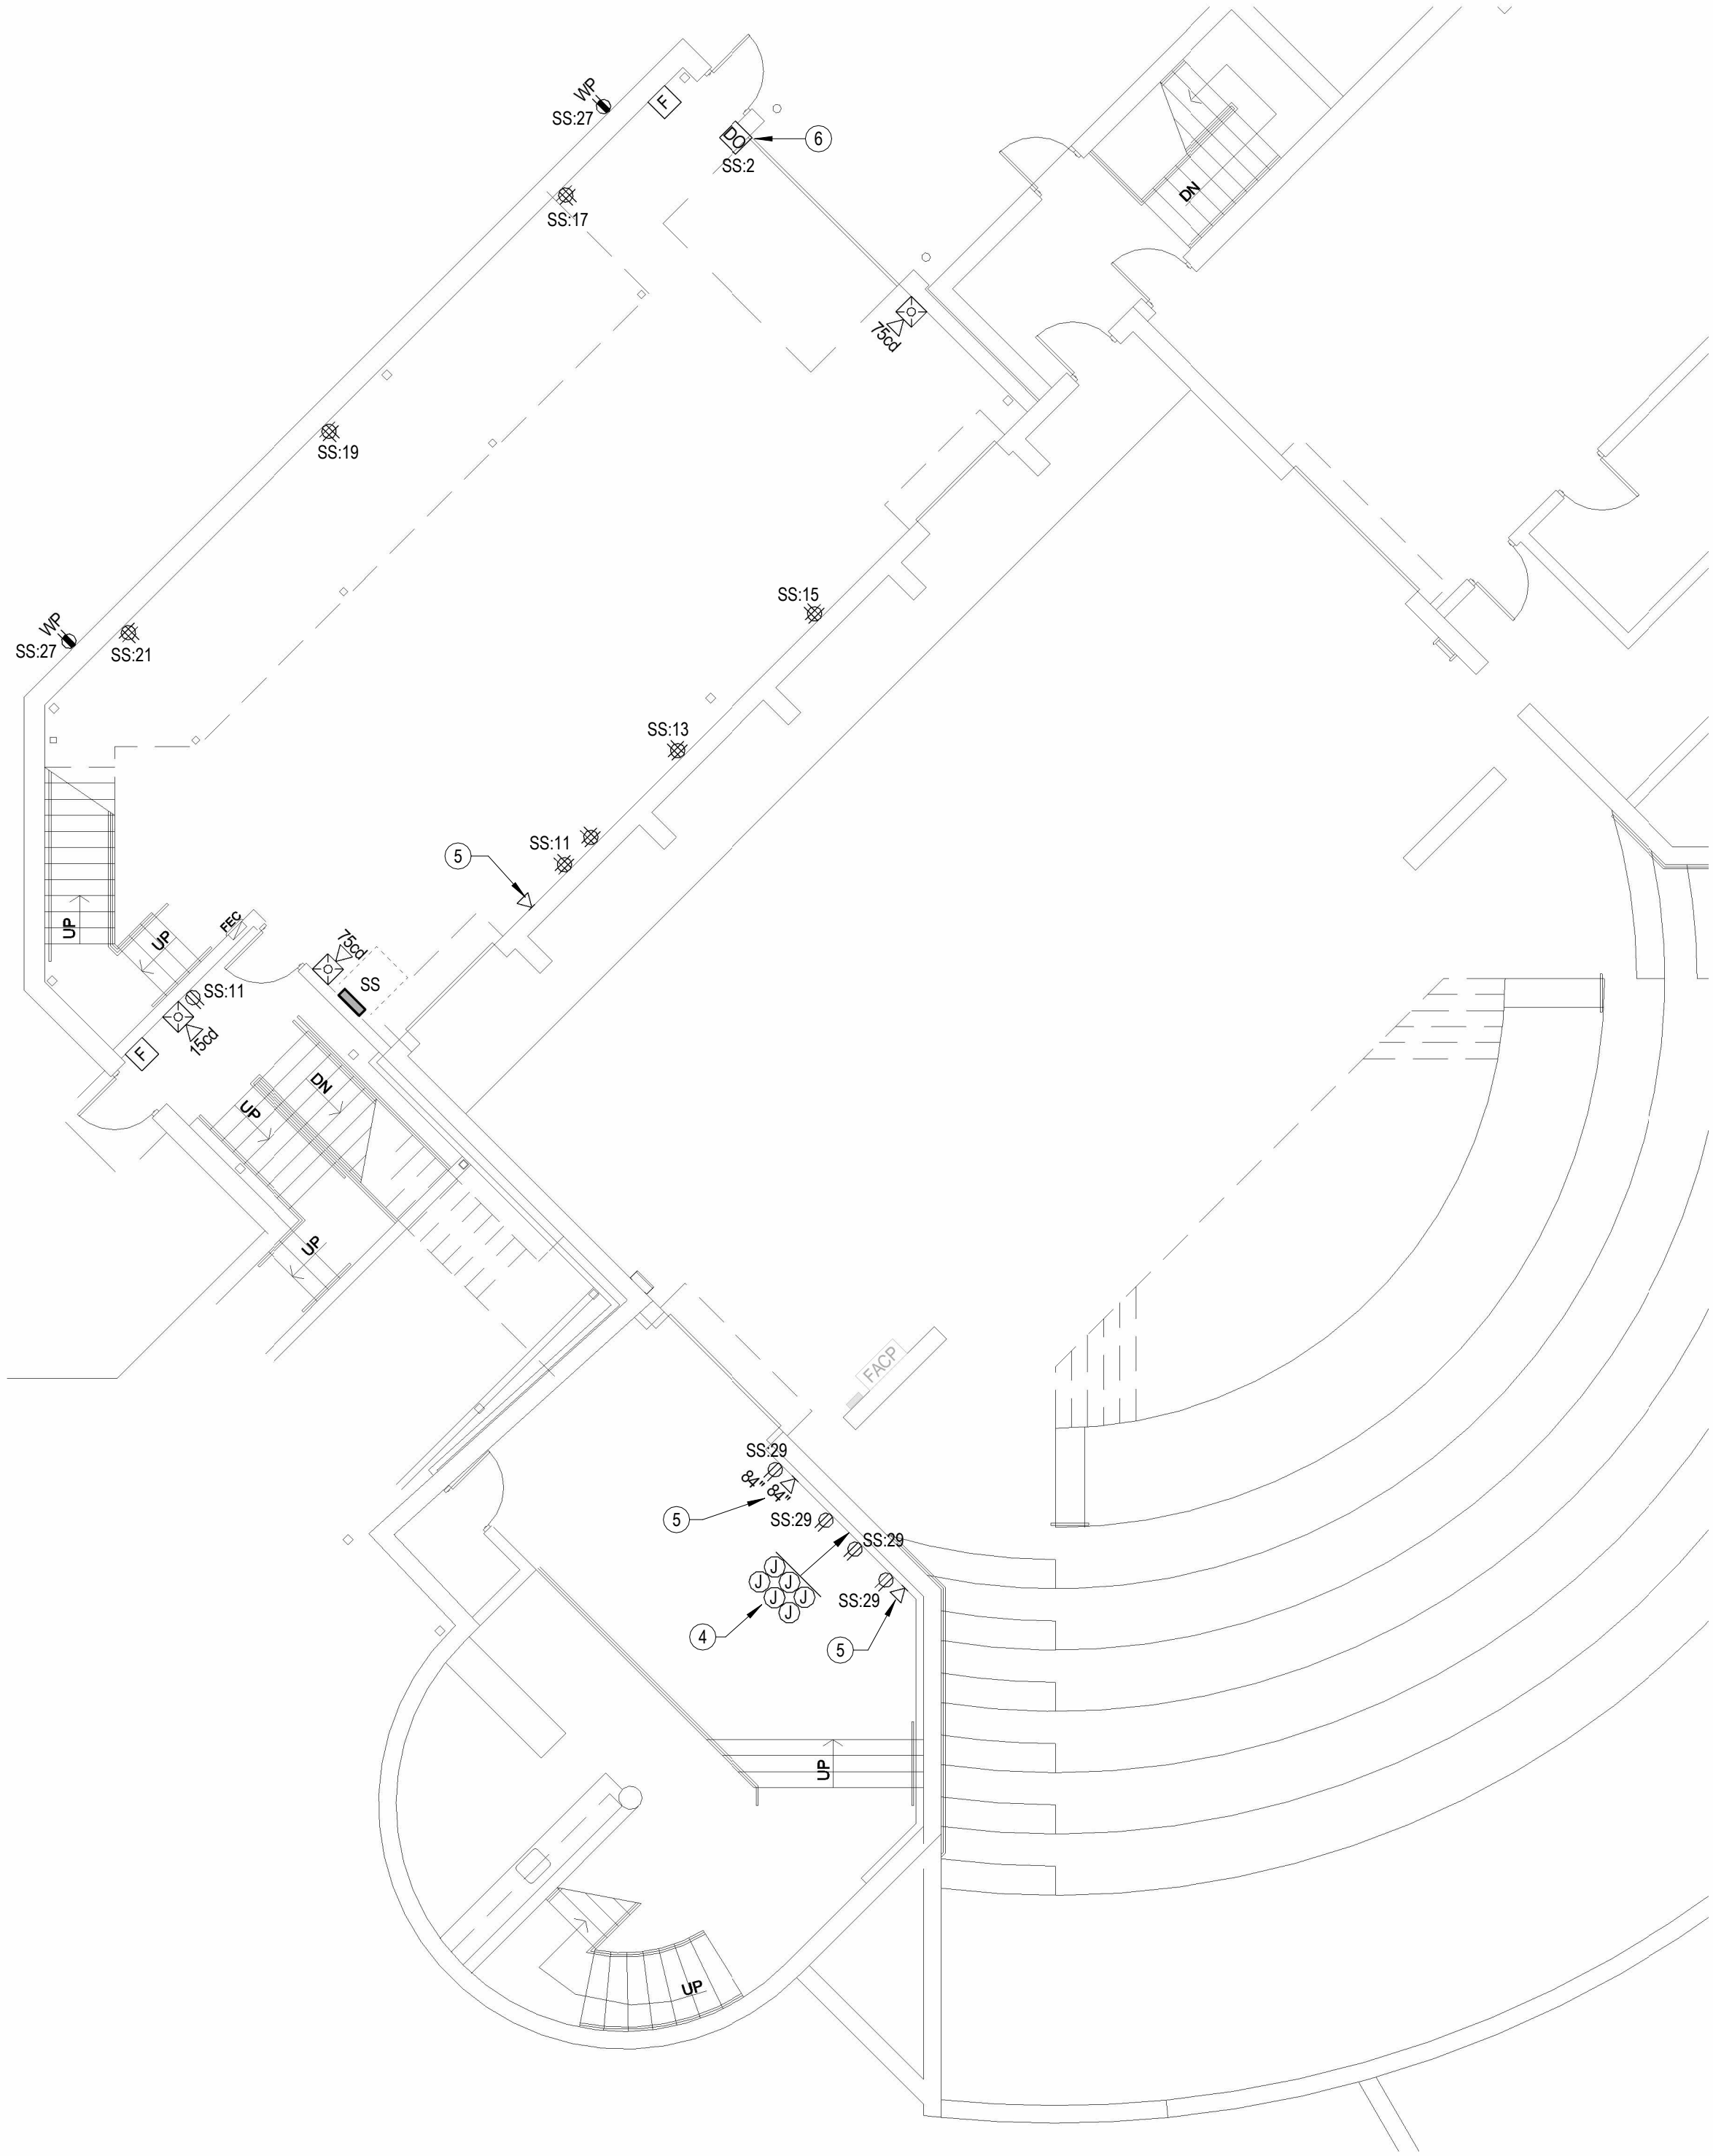

B

POWER PLAN - STAGE LEVEL


1/8" = 1'-0"

THEATRE SALINA

DANCE STUDIOS & SCENE SHOP EXPANSION

SALINA

KANSAS

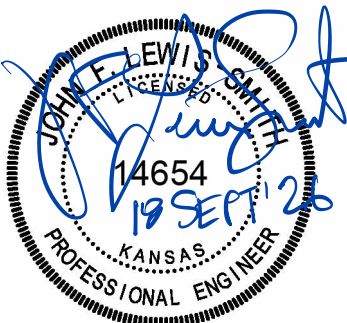

REVISIONS:

NO	DATE	REVISION
----	------	----------

DATE: 9-18-2026

JOB: 22-3239

SHEET NO.:

EP1.1


JonesGillamRenz  
1881 Main Street, Suite 301  
Salina, KS 67401  
785.827.0386  
jg@jgarchitects.com



COPYRIGHTED ©



- NOTES BY SYMBOL**
- 1 SUGGESTED ROUTING FOR FEEDER TO PANEL 'DS'. PROVIDE (2) SETS OF (4) #500 KCMIL, #3G (COPPER) IN 3" CONDUIT. VERIFY ROUTING IN FIELD PRIOR TO INSTALLATION. PROVIDE PULL BOXES AS REQUIRED BY NEC. COORDINATE ROUTING WITH EXISTING CONDITIONS, STRUCTURE, AND OTHER BUILDING SYSTEMS. SUBMIT PROPOSED ROUTING TO ARCHITECT FOR REVIEW AND APPROVAL PRIOR TO INSTALLATION.
  - 2 INSTALL SWITCHED RECEPTACLES TIGHT TO STRUCTURE IN THIS AREA.
  - 3 PROVIDE DUCT SMOKE DETECTORS AND TEST SWITCH, AND CONNECT ROOFTOP UNIT FOR SHUTDOWN UPON DETECTION OF SMOKE.
  - 4 ROUTE 120V CIRCUIT FOR HOT WATER RECIRCULATION PUMP THROUGH ADJACENT AQUASTAT. PROVIDE 20A/1P SNAP SWITCH ADJACENT TO PUMP AND MAKE FINAL FLEXIBLE CONNECTION. COORDINATE WITH PLUMBING CONTRACTOR.
  - 5 PROVIDE 20A SNAP SWITCH AND CONNECT WATER HEATER. COORDINATE WITH EQUIPMENT PROVIDED BY OTHERS.
  - 6 COORDINATE MOUNTING LOCATION FOR WATER COOLER WITH EQUIPMENT PROVIDED BY OTHERS.
  - 7 HEAVY DUTY 7-DAY DIGITAL WALL SWITCH TIMER FOR EXHAUST FAN CONTROL. TIMER SHALL HAVE LCD DIGITAL CLOCK AND READOUT, MANUAL OVERRIDE, AND SHALL BE RATED FOR 20A AND 1HP AT 120V. INTERMATIC #E6001 OR EQUAL. INSTALL AT 48" AFF AND COORDINATE WITH OWNER FOR PROGRAMMING AND SCHEDULING.
  - 8 FOR EACH DATA OUTLET, PROVIDE 2-GANG BOX WITH SINGLE GANG PLASTER RING, AND 1" CONDUIT TO ABOVE ACCESSIBLE CEILING, TERMINATED WITH SMOOTH BUSHING. PROVIDE (2) CAT 6 CABLES TO HEAD END ROOM. LEAVE 3' SLACK CABLE AT BOX AND AT HEAD END EQUIPMENT. TERMINATIONS, JACKS, AND COVERPLATES TO BE BY OTHERS. COORDINATE WITH OWNER PRIOR TO INSTALLATION.
  - 9 TERMINATE DATA CABLE AT HEAD END ROOM.
  - 10 PROVIDE DUCT SMOKE DETECTOR WITHIN 5' OF FIRE/SMOKE DAMPER WITH REMOTE TEST SWITCH/INDICATOR LIGHT ON WALL AT 48" AFF. PROVIDE ADDRESSABLE FIRE ALARM RELAY FOR CONTROL OF 120V POWER TO DAMPER ACTUATOR. DAMPER SHALL CLOSE UPON DETECTION OF SMOKE.

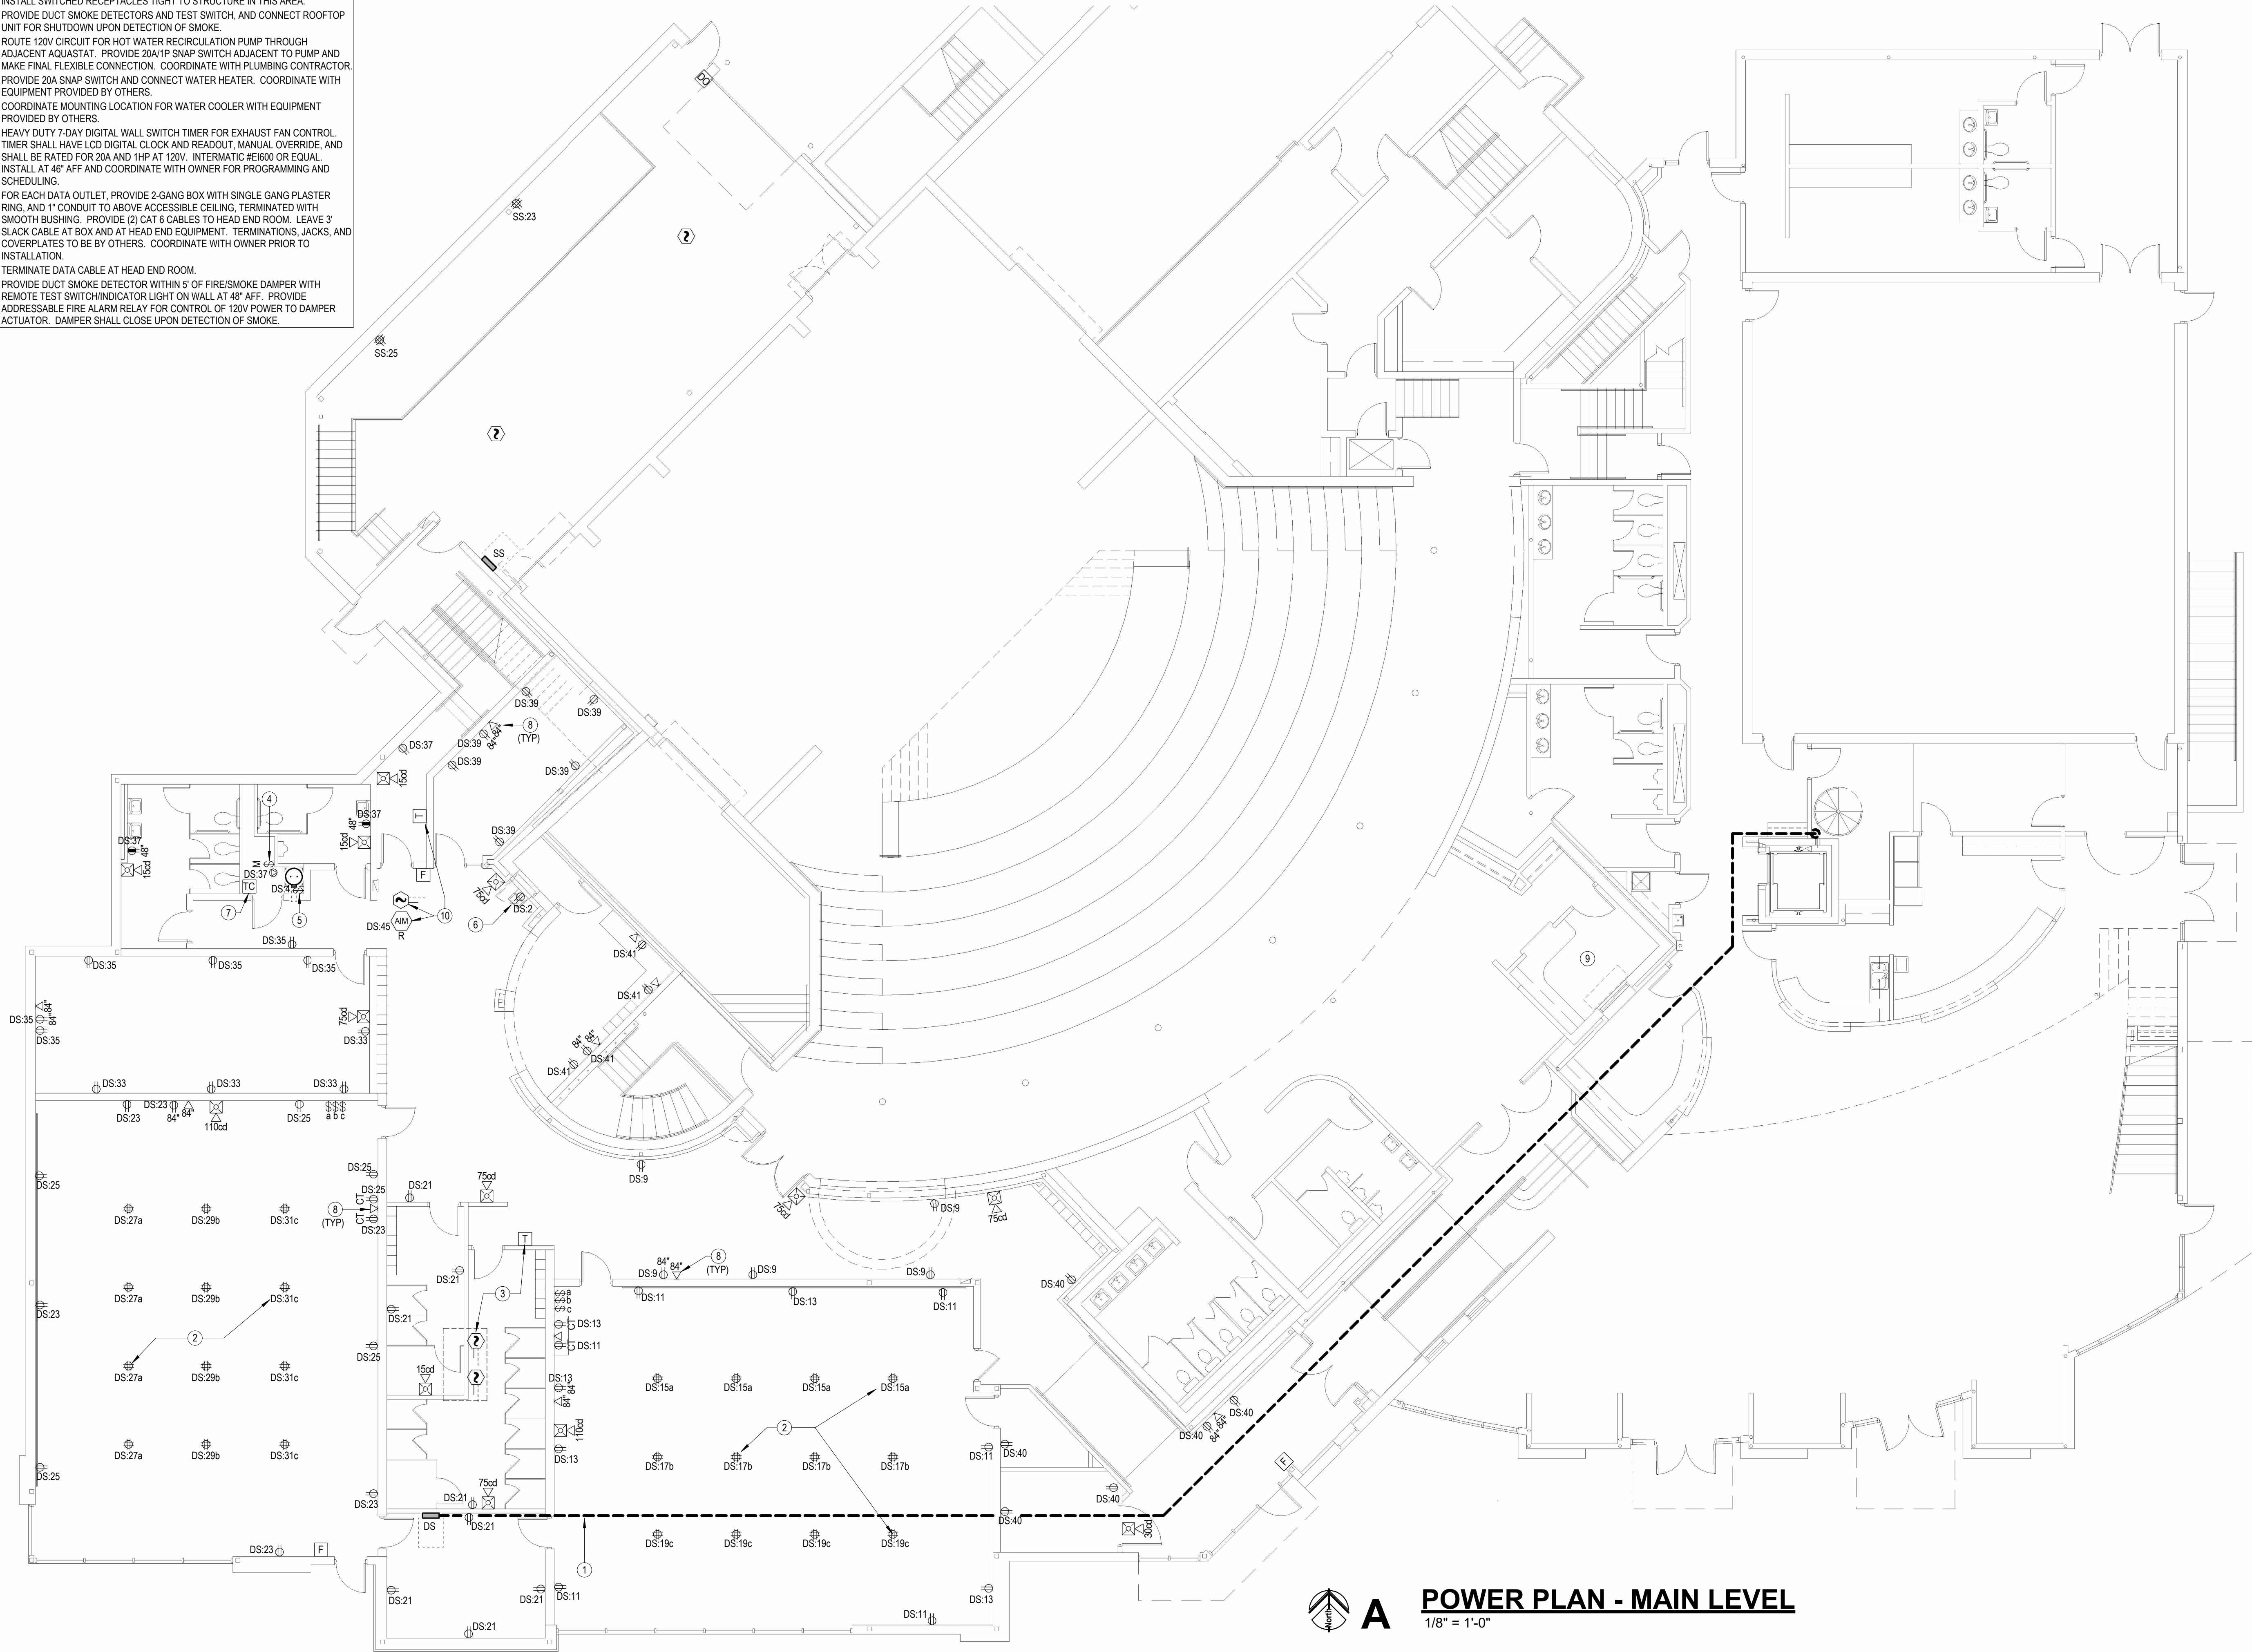

**A**

**POWER PLAN - MAIN LEVEL**  
1/8" = 1'-0"



**LST Consulting Engineers, PA**  
MANHATTAN  
4809 Via Du Lac Place, Suite 201  
Manhattan, KS 66503  
785.587.8042  
www.LSTengineers.com  
mail@LSTengineers.com  
Project 26049  
WICHITA  
125 S. Washington, Suite 150  
Wichita, KS 67202  
316.285.0896  
9-18-2026

**JonesGillamRenz**  
1881 Main Street, Suite 301  
Salina, KS 67401  
785.827.0386  
jg@jgarchitects.com




**THEATRE SALINA**

**DANCE STUDIOS & SCENE SHOP EXPANSION**

**SALINA**

**KANSAS**

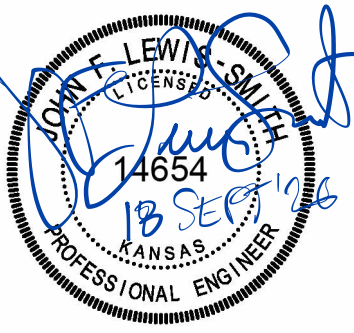

**REVISIONS:**  
NO. DATE REVISION

**DATE:** 9-18-2026  
**JOB:** 22-3239  
**SHEET NO.:**

**EP1.2**

**COPYRIGHTED**